




Combustion Turbine Monthly Report

April 2006

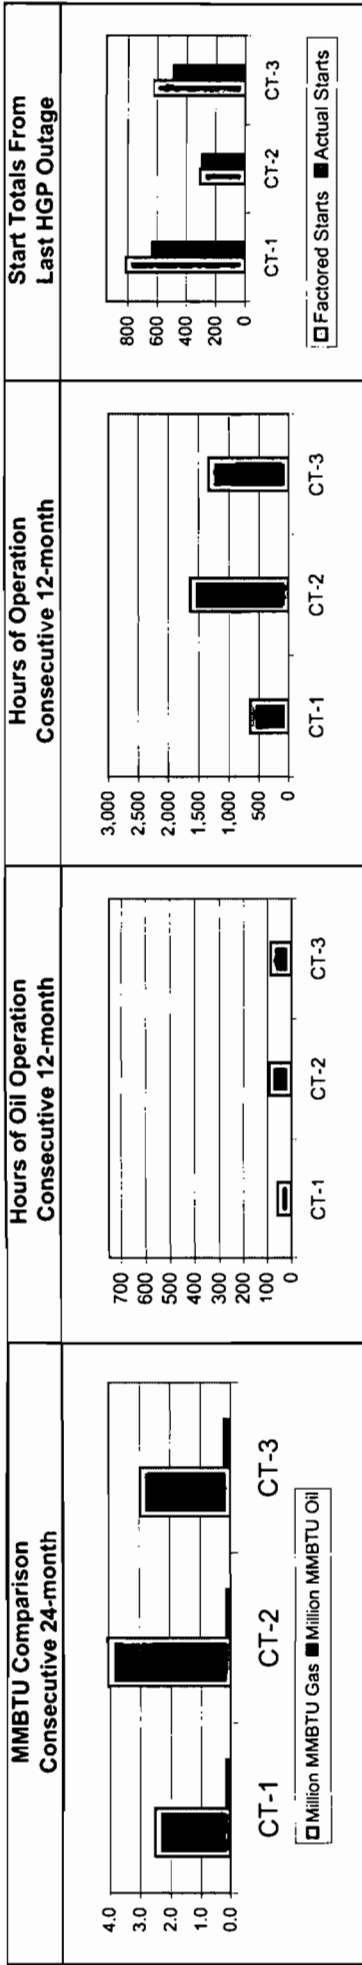

Consecutive Monthly Data

	CT 1			CT 2			CT 3		
	Gas MMBTU	Oil MMBTU	MMBTU	Gas MMBTU	Oil MMBTU	MMBTU	Gas MMBTU	Oil MMBTU	MMBTU
Jan-06	11,948	0	56,201	0	0	0	71,754	0	0
Feb-06	84	7,429	48,263	0	0	0	105,138	387	0
Mar-06	0	0	118,625	0	0	0	134,321	0	0
Apr-06	30,208	0	245,820	0	0	0	193,080	16,984	0
May-04	316,886	0	259,707	0	0	0	0	0	0
Jun-04	353,076	154	223,081	0	0	68	257,819	0	0
Jul-04	361,563	0	302,782	0	0	0	121,597	0	0
Aug-04	292,115	5	317,755	0	0	6	107,044	0	0
Sep-04	239,566	46,676	227,221	5,524	5,524	105,609	129,170	105,609	0
Oct-04	12,197	13,838	153,575	2,596	2,596	0	201,650	0	0
Nov-04	0	0	59,121	0	0	0	68,732	0	0
Dec-04	0	0	68,639	8,592	8,592	36	81,377	0	0
Jan-05	0	0	109,883	0	0	0	106,700	0	0
Feb-05	0	0	35,729	0	0	0	64,919	0	0
Mar-05	0	0	73,818	0	0	0	82,768	0	0
Apr-05	0	0	85,384	0	0	0	34,611	0	0
May-05	8,764	13,788	161,226	0	0	0	41,287	0	0
Jun-05	68,139	0	262,858	0	0	0	235,554	0	0
Jul-05	237,409	44,206	366,440	55,054	55,054	24,955	358,013	24,955	0
Aug-05	293,049	13,066	363,501	46,517	46,517	25,546	273,164	25,546	0
Sep-05	168,217	12,270	166,962	9,917	9,917	6,536	98,760	6,536	0
Oct-05	108,653	0	224,269	130	130	164	138,495	164	0
Nov-05	0	0	59,923	0	0	0	37,052	8,185	0
Dec-05	0	0	61,258	12,879	12,879	35,417	36,200	35,417	0
24-Month	2,501,875	151,432	4,052,041	141,209	141,209	223,892	2,979,208	223,892	0

	CT 1		CT 2		CT 3		PPA Starts for 2006	
	Fired Hours	Hours on Oil	Fired Hours	Hours on Oil	Fired Hours	Hours on Oil	CT 2	CT 3
Jan-06	8	0	40	0	54	0	11	19
Feb-06	5.0	4.5	37	0	80	0.5	10	15
Mar-06	0	0	85	0	94	0	16	15
Apr-06	19	0	172	0	151	13	22	21
May-06	17	10.1	117	0	30	0		
Jun-06	43	0	193	0	171	0		
Jul-06	178	26.4	300	40	271	14		
Aug-06	196	8	298	34	213	19		
Sep-06	114	8.3	127	8.2	79	5.3		
Oct-06	72	0.0	164	0.5	103	1		
Nov-06	0	0	44	0	33	6		
Dec-06	0	0.0	60	9.0	59	27.0		
12 Month	651	57	1,637	92	1,336	86	59	70

To stay within environmental compliance:

1. The fuel oil BTUs shall not exceed the natural gas BTUs during any consecutive 24-month period
2. The max allowable hours of operation on oil in any consecutive 12-month period = 750 (per unit)
3. The max allowable hours of operation in any consecutive 12-month period = 3,000 (per unit)

Note: Figures and calculations are based on plant operating data, OEM factors for equivalent starts and outage intervals, and Florida DEP for operating limits. **Future figures will use continuous emission monitoring system (CEMS) data, and be consistent with figures reported to the DEP.**

CT-3 operating in place of CT-1 for Seminole beginning Oct., 2004.