


Combustion Turbine Monthly Report September 2002

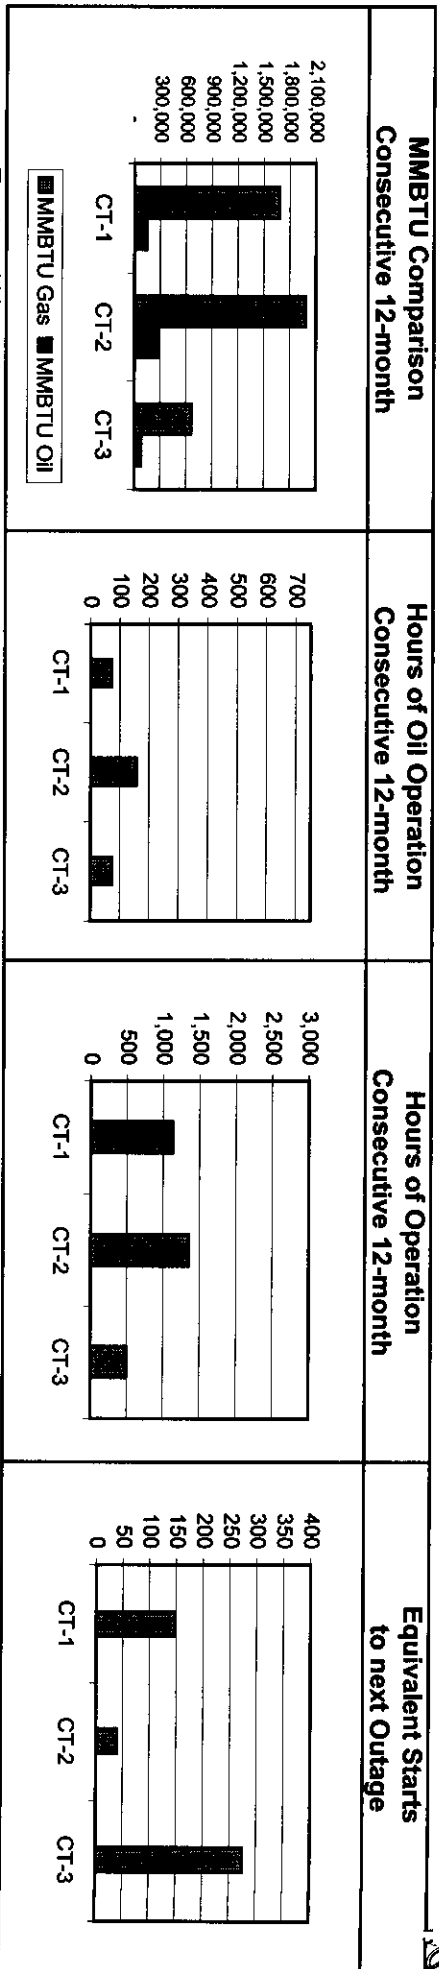

- To stay within environmental compliance:
1. The fuel oil BTUs shall not exceed the natural gas BTUs during any consecutive 12-month period
 2. The max allowable hours of operation on oil in any consecutive 12-month period = 750 (per unit)
 3. The max allowable hours of operation in any consecutive 12-month period = 3,000 (per unit)

Monthly Data

	CT 1						CT 2						CT 3					
	Gas MMBTU	Oil MMBTU	Fired Hours	Hours on Oil	Equip Start	PPA Starts	Gas MMBTU	Oil MMBTU	Fired Hours	Hours on Oil	Equip Start	PPA Starts	Gas MMBTU	Oil MMBTU	Fired Hours	Hours on Oil	Equip Start	
Oct-01					43.0													
Nov-01	152,966	108,520	108	45.0	17.0		177,888	72,553	84	34.0	18.0							
Dec-01	79,299	0	56	0.0	11.0	10	80,379	0	40	0.0	10.0	9						
Jan-02	53,351	6,096	37	3.8	21.0	9	65,659	0	41	0.0	16.0	9						
Feb-02	24,941	0	18	0.0	12.0	3	17,528	0	13	0.0	5.0	3						
Mar-02	16,416	2,333	13	2.1	7.0	3	125,266	7,629	86	1.6	34.0	14						
Apr-02	0	0	0	0.0	0.0	0	331,335	18,072	217	11.0	39.0	23	31,041	0	26	0	6.0	
May-02	0	500	1	1.0	0.5	0	117,919	174,823	180	98.0	23.0	20	66,830	71,600	100	65	36.5	
Jun-02	373,406	0	244	0.0	41.5	30	288,579	24	187	0.1	46.0	24	66,877	11,251	52	9	12.0	
Jul-02	265,987	7,913	179	5.0	39.0	24	208,117	1,386	134	6.5	47.0	22	136,616	0	89	0	28.5	
Aug-02	350,734	1,509	225	2	29.0	27	221,171	262	143	0	32.0	21	77,353	0	49	0	6.0	
Sep-02	358,083	18,540	245	13	31.5	25	346,377	2,026	227	4	59.5	27	281,197	105	179	1	37.0	
12-Month	1,675,183	145,411	1,126	72	252.5	131	1,980,218	276,775	1,352	156	360.5	172	659,914	82,956	495	74	126.0	

Note: Figures and calculations are based on plant operating data, OEM factors for equivalent starts and outage intervals, and Florida DEP for operating limits.
 Future figures will use continuous emission monitoring system (CEMS) data, and be consistent with figures reported to the DEP.