
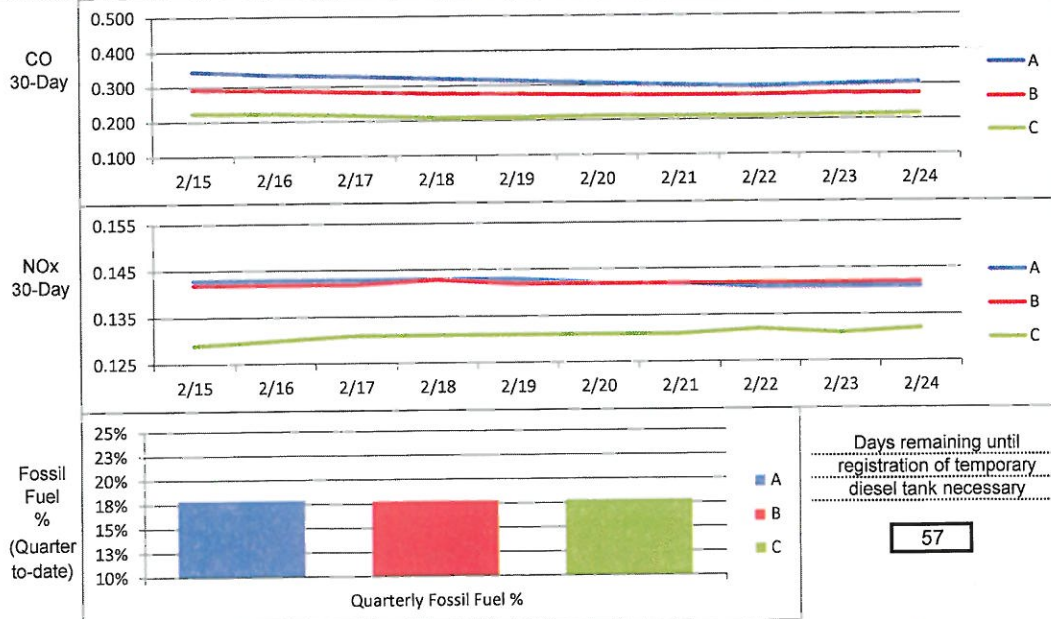


		Boiler A			
		2/21	2/22	2/23	2/24
24-Hr	CO	0.312	0.421	0.438	0.330
	Nox	0.145	0.140	0.144	0.148
	SO2	0.026	0.025	0.023	0.027
30-Day	CO	0.299	0.295	0.299	0.304
	Nox	0.142	0.141	0.141	0.141
	SO2	0.019	0.019	0.020	0.020
Opcty	%	3.6%	3.6%	3.6%	3.6%
	Outs	0	0	0	0
Avlbty	CO	99%	99%	99%	99.0%
	Nox	97%	97%	97%	96.8%
	SO2	97%	97%	97%	97.3%
	Opacity	100%	100%	100%	99.7%
12-Mnth	Month	Nov.	Dec.	Jan.	Feb.
	CO	0.281	0.276	0.283	0.284

		Boiler B			
		2/21	2/22	2/23	2/24
24-Hr	CO	0.335	0.328	0.404	0.319
	Nox	0.145	0.147	0.146	0.148
	SO2	0.014	0.012	0.010	0.014
30-Day	CO	0.273	0.273	0.276	0.274
	Nox	0.142	0.142	0.142	0.142
	SO2	0.009	0.009	0.010	0.010
Opcty	%	2.8%	2.9%	2.9%	3.0%
	Outs	0	0	0	0
Avlbty	CO	99%	100%	100%	99.5%
	Nox	100%	100%	100%	99.7%
	SO2	100%	100%	100%	99.7%
	Opacity	100%	100%	100%	99.8%
12-Mnth	Month	Nov.	Dec.	Jan.	Feb.
	CO	0.259	0.250	0.252	0.257

		Boiler C			
		2/21	2/22	2/23	2/24
24-Hr	CO	0.272	0.190	0.272	0.334
	Nox	0.141	0.134	0.138	0.137
	SO2	0.020	0.017	0.017	0.022
30-Day	CO	0.211	0.210	0.212	0.214
	Nox	0.131	0.132	0.131	0.132
	SO2	0.015	0.015	0.016	0.016
Opcty	%	1.9%	1.8%	1.9%	1.8%
	Outs	0	0	0	0
Avlbty	CO	99%	99%	100%	99.1%
	Nox	98%	99%	99%	98.5%
	SO2	99%	99%	100%	99.1%
	Opacity	99%	99%	100%	99.1%
12-Mnth	Month	Nov.	Dec.	Jan.	Feb.
	CO	0.262	0.275	0.277	0.264

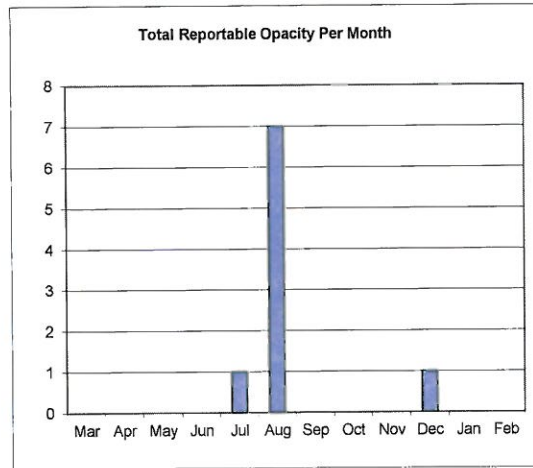

12-month avg. SO₂

A 0.03 B 0.028 C 0.021

Average Data

Plant: New Hope Power Company Okeelanta Cogen

Interval: 1 Hour

Type: Block

Report Period: 02/27/2013 00:00 Through 02/27/2013 11:42

Time Online Criteria: 1 minute(s)

Source Parameter)Unit(UNIT1		UNIT2		UNIT3	
	CO#/MM (LB/MMBTU)	NOX#/MM (LB/MMBTU)	CO#/MM (LB/MMBTU)	NOX#/MM (LB/MMBTU)	CO#/MM (LB/MMBTU)	NOX#/MM (LB/MMBTU)
02/27/13 00:00	0.273	0.161	0.832	0.104	0.577	0.126
02/27/13 01:00	0.391	0.159	0.580	0.116	0.558	0.131
02/27/13 02:00	0.394	0.159	0.407	0.121	0.444	0.125
02/27/13 03:00	0.518	0.158	0.227	0.129	0.345	0.131
02/27/13 04:00	0.474	0.162	0.182	0.132	0.220	0.139
02/27/13 05:00	0.725C	0.148C	0.295	0.129	0.223	0.136
02/27/13 06:00	0.896C	0.150C	0.434C	0.124C	0.279	0.139
02/27/13 07:00	0.860	0.146	0.252C	0.130C	0.271C	0.146C
02/27/13 08:00	0.571	0.156	0.172	0.141	0.295C	0.131C
02/27/13 09:00	0.557	0.159	0.232	0.140	0.302	0.125
02/27/13 10:00	0.549	0.159	0.233	0.137	0.286	0.118
02/27/13 11:00	0.000FI	0.000FI	0.000FI	0.000FI	0.000FI	0.000FI

Average	0.564	0.156	0.350	0.128	0.345	0.132
Minimum	0.273	0.146	0.172	0.104	0.220	0.118
Maximum	0.896	0.162	0.832	0.141	0.577	0.146
Summation	6.208	1.717	3.846	1.403	3.800	1.447
Included Data Points	11	11	11	11	11	11
Total number of Data Points	12	12	12	12	12	12

F = Unit Offline

E = Exceedance

C = Calibration

S = Substituted

U - Startup

I = Invalid

M = Maintenance

T = Out Of Control

* = Suspect

D - Shutdown

Average Data

Plant: New Hope Power Company Okeelanta Cogen

Interval: 1 Hour

Type: Block

Report Period: 02/26/2013 00:00 Through 02/26/2013 23:59

Time Online Criteria: 1 minute(s)

Source Parameter)Unit(UNIT1		UNIT2		UNIT3	
	CO#/MM (LB/MMBTU)	NOX#/MM (LB/MMBTU)	CO#/MM (LB/MMBTU)	NOX#/MM (LB/MMBTU)	CO#/MM (LB/MMBTU)	NOX#/MM (LB/MMBTU)
02/26/13 00:00	0.481	0.148	0.699	0.144	0.027	0.151
02/26/13 01:00	0.467	0.143	0.599	0.143	0.029	0.144
02/26/13 02:00	0.369	0.151	0.518	0.149	0.032	0.147
02/26/13 03:00	0.270	0.156	0.429	0.153	0.025	0.149
02/26/13 04:00	0.289	0.155	0.257	0.157	0.021	0.151
02/26/13 05:00	0.638C	0.125C	0.814	0.139	0.045	0.138
02/26/13 06:00	0.549C	0.148C	0.586C	0.153C	0.009	0.151
02/26/13 07:00	0.577	0.142	1.600IC	0.151IC	0.028C	0.157C
02/26/13 08:00	1.688I	0.095	0.000F	0.000F	0.136C	0.158C
02/26/13 09:00	0.720	0.135	0.000F	0.000F	0.372	0.136
02/26/13 10:00	1.269	0.133	0.000F	0.000F	0.789	0.130
02/26/13 11:00	0.799	0.141	0.000F	0.000F	0.597	0.138
02/26/13 12:00	0.887	0.131	0.000F	0.000F	0.617	0.131
02/26/13 13:00	0.770	0.142	0.000F	0.000F	0.644	0.136
02/26/13 14:00	0.778	0.138	0.000F	0.000F	0.691	0.130
02/26/13 15:00	0.357	0.163	0.000F	0.000F	0.358	0.162
02/26/13 16:00	0.753I	0.140	0.000F	0.000F	0.317	0.153
02/26/13 17:00	1.821	0.123	0.000	0.000	0.409	0.140
02/26/13 18:00	1.392	0.130	0.154	0.046	0.416	0.143
02/26/13 19:00	1.110	0.136	0.146C	0.054C	0.368	0.150
02/26/13 20:00	1.327I	0.114	0.467	0.054	0.409	0.147
02/26/13 21:00	2.081I	0.082	0.523	0.058	0.429	0.145
02/26/13 22:00	1.374	0.123	0.054	0.092	0.484	0.148
02/26/13 23:00	0.542	0.147	0.334	0.102	0.513	0.140

Average	0.773	0.135	0.399	0.103	0.324	0.145
Minimum	0.270	0.082	0.000	0.000	0.009	0.130
Maximum	1.821	0.163	0.814	0.157	0.789	0.162
Summation	15.459	3.241	5.580	1.444	7.765	3.476
Included Data Points	20	24	14	14	24	24
Total number of Data Points	24	24	24	24	24	24

F = Unit Offline

E = Exceedance

C = Calibration

S = Substituted

U - Startup

I = Invalid

M = Maintenance

T = Out Of Control

* = Suspect

D - Shutdown

30 Day Rolling Average Detail

Plant: New Hope Power Company Okeelanta Cogen
Operating Day Criteria = 1 hours

Report Period: 02/26/2013 Through 02/26/2013

Source: UNIT1 Standard Limit: 0.5

Parameter: CO#/MM

Date	Daily			30 - Day		
	Operating Hours	Valid Hours	Average	Valid Days	Valid Hours	Average
02/26/13	24	20	0.773	30	665	0.317

Source: UNIT1 Standard Limit: 0.15

Parameter: NOX#/MM

Date	Daily			30 - Day		
	Operating Hours	Valid Hours	Average	Valid Days	Valid Hours	Average
02/26/13	24	24	0.135	30	658	0.140

Source: UNIT1 Standard Limit: 0.1

Parameter: SO2#/MM

Date	Daily			30 - Day		
	Operating Hours	Valid Hours	Average	Valid Days	Valid Hours	Average
02/26/13	24	24	0.023	30	672	0.020

Source: UNIT2 Standard Limit: 0.5

Parameter: CO#/MM

Date	Daily			30 - Day		
	Operating Hours	Valid Hours	Average	Valid Days	Valid Hours	Average
02/26/13	15	14	0.399	30	678	0.268

Source: UNIT2 Standard Limit: 0.15

Parameter: NOX#/MM

Date	Daily			30 - Day		
	Operating Hours	Valid Hours	Average	Valid Days	Valid Hours	Average
02/26/13	15	14	0.103	30	678	0.141

Source: UNIT2 Standard Limit: 0.1

Parameter: SO2#/MM

Date	Daily			30 - Day		
	Operating Hours	Valid Hours	Average	Valid Days	Valid Hours	Average
02/26/13	15	14	0.008	30	678	0.010

Source: UNIT3 Standard Limit: 0.5

Parameter: CO#/MM

Date	Daily			30 - Day		
	Operating Hours	Valid Hours	Average	Valid Days	Valid Hours	Average
02/26/13	24	24	0.323	30	686	0.212

F = Unit Offline I = Invalid E = Exceedance

30 Day Rolling Average Detail

Plant: New Hope Power Company Okeelanta Cogen

Operating Day Criteria = 1 hours

Report Period: 02/26/2013 Through 02/26/2013

Source: UNIT3 Standard Limit: 0.15

Parameter: NOX#/MM

Date	Daily			30 - Day		
	Operating Hours	Valid Hours	Average	Valid Days	Valid Hours	Average
02/26/13	24	24	0.145	30	686	0.133

Source: UNIT3 Standard Limit: 0.1

Parameter: SO2#/MM

Date	Daily			30 - Day		
	Operating Hours	Valid Hours	Average	Valid Days	Valid Hours	Average
02/26/13	24	24	0.015	30	686	0.016

F = Unit Offline I = Invalid E = Exceedance

Average Data

Plant: New Hope Power Company Okeelanta Cogen

Interval: 6 Minute

Type: Block

Report Period: 02/26/2013 00:00 Through 02/26/2013 23:59

Time Online Criteria: 1 minute(s)

Source	UNIT1	UNIT2	UNIT3
Parameter Unit(OPACITY (PERCENT)	OPACITY (PERCENT)	OPACITY (PERCENT)
02/26/13 00:00	3.8	2.9	1.8
02/26/13 00:06	3.7	2.9	1.8
02/26/13 00:12	3.7	2.9	2.2
02/26/13 00:18	3.8	3.0	1.9
02/26/13 00:24	3.8	3.0	2.0
02/26/13 00:30	3.8	3.0	2.1
02/26/13 00:36	3.8	2.9	2.2
02/26/13 00:42	3.8	3.0	2.0
02/26/13 00:48	3.7	2.9	2.0
02/26/13 00:54	3.8	3.4	2.1
02/26/13 01:00	3.7	5.4	2.1
02/26/13 01:06	3.7	3.1	2.1
02/26/13 01:12	3.7	3.1	2.1
02/26/13 01:18	3.7	3.0	2.1
02/26/13 01:24	3.8	3.0	2.0
02/26/13 01:30	3.7	2.9	2.0
02/26/13 01:36	3.8	3.0	2.1
02/26/13 01:42	3.8	3.5	2.1
02/26/13 01:48	3.8	3.1	2.2
02/26/13 01:54	3.8	3.1	2.2
02/26/13 02:00	3.9	3.2	2.3
02/26/13 02:06	3.8	3.2	2.2
02/26/13 02:12	3.9	3.4	2.3
02/26/13 02:18	3.9	3.5	2.3
02/26/13 02:24	3.9	3.1	2.3
02/26/13 02:30	3.9	3.3	2.3
02/26/13 02:36	3.9	3.3	2.2
02/26/13 02:42	3.9	3.1	2.2
02/26/13 02:48	3.9	3.5	2.2
02/26/13 02:54	3.9	3.4	2.3
02/26/13 03:00	3.9	3.1	2.2
02/26/13 03:06	3.8	3.2	2.2
02/26/13 03:12	3.9	3.2	2.3
02/26/13 03:18	3.9	3.2	2.2
02/26/13 03:24	3.9	3.6	2.2
02/26/13 03:30	3.9	3.3	3.1
02/26/13 03:36	3.9	3.3	2.3
02/26/13 03:42	3.9	3.4	2.3
02/26/13 03:48	3.8	3.3	2.3
02/26/13 03:54	3.8	3.2	2.3
02/26/13 04:00	3.9	3.2	2.2
02/26/13 04:06	3.8	3.1	2.2
02/26/13 04:12	3.8	3.1	2.2
02/26/13 04:18	3.8	3.1	2.2
02/26/13 04:24	3.8	3.1	2.2
02/26/13 04:30	3.8	3.1	2.2
02/26/13 04:36	3.8	4.1	2.2
02/26/13 04:42	3.8	3.2	2.2
02/26/13 04:48	3.8	3.2	2.2
02/26/13 04:54	3.8	3.2	2.1

F = Unit Offline

E = Exceedance

C = Calibration

S = Substituted

U - Startup

I = Invalid

M = Maintenance

T = Out Of Control

*** = Suspect**

D - Shutdown

Average Data

Plant: New Hope Power Company Okeelanta Cogen

Interval: 6 Minute

Type: Block

Report Period: 02/26/2013 00:00 Through 02/26/2013 23:59

Time Online Criteria: 1 minute(s)

Source	UNIT1	UNIT2	UNIT3
Parameter Unit(OPACITY (PERCENT)	OPACITY (PERCENT)	OPACITY (PERCENT)
02/26/13 05:00	3.7	3.1	2.1
02/26/13 05:06	3.8	3.1	2.1
02/26/13 05:12	3.9	3.2	2.3
02/26/13 05:18	3.8	3.2	2.2
02/26/13 05:24	3.8	3.4	2.2
02/26/13 05:30	3.8	3.2	2.3
02/26/13 05:36	3.8	3.2	2.3
02/26/13 05:42	3.8	3.3	2.3
02/26/13 05:48	3.8	3.2	2.3
02/26/13 05:54	13.4IC	3.2	2.3
02/26/13 06:00	3.8C	3.3	2.2
02/26/13 06:06	3.8	3.2	2.2
02/26/13 06:12	3.8	3.2	2.2
02/26/13 06:18	3.8	3.2	2.2
02/26/13 06:24	3.8	3.3	2.3
02/26/13 06:30	3.8	3.2	2.3
02/26/13 06:36	3.8	3.5	2.2
02/26/13 06:42	3.8	10.7	2.3
02/26/13 06:48	3.9	4.3	2.2
02/26/13 06:54	3.9	12.9IC	2.2
02/26/13 07:00	3.9	6.2C	2.3
02/26/13 07:06	3.8	3.9	2.3
02/26/13 07:12	7.4	3.5	2.2
02/26/13 07:18	4.0	13.6	2.2
02/26/13 07:24	4.0	13.4	2.3
02/26/13 07:30	4.0	5.4	2.2
02/26/13 07:36	4.0	4.1	2.2
02/26/13 07:42	4.0	3.8	2.2
02/26/13 07:48	4.2	3.5	2.2
02/26/13 07:54	4.1	3.4	12.9IC
02/26/13 08:00	4.0	3.3	2.2C
02/26/13 08:06	4.0	3.2	2.2
02/26/13 08:12	4.0	3.4	2.4
02/26/13 08:18	4.6	3.2	2.2
02/26/13 08:24	6.4	3.5	2.2
02/26/13 08:30	5.8	3.4	2.2
02/26/13 08:36	6.6	3.2	2.2
02/26/13 08:42	7.1	3.1	2.1
02/26/13 08:48	9.7	12.8	2.1
02/26/13 08:54	6.0	14.4	2.0
02/26/13 09:00	4.2	16.9I	1.9
02/26/13 09:06	4.0	13.2F	1.9
02/26/13 09:12	4.1	12.0F	1.8
02/26/13 09:18	4.0	8.9F	1.7
02/26/13 09:24	3.9	8.2F	1.7
02/26/13 09:30	3.9	6.1F	1.8
02/26/13 09:36	4.3	6.6F	1.8
02/26/13 09:42	4.1	5.3F	1.7
02/26/13 09:48	3.8	4.6F	1.7
02/26/13 09:54	3.8	8.3F	1.7

F = Unit Offline

E = Exceedance

C = Calibration

S = Substituted

U - Startup

I = Invalid

M = Maintenance

T = Out Of Control

* = Suspect

D - Shutdown

Average Data

Plant: New Hope Power Company Okeelanta Cogen

Interval: 6 Minute

Type: Block

Report Period: 02/26/2013 00:00 Through 02/26/2013 23:59

Time Online Criteria: 1 minute(s)

Source	UNIT1	UNIT2	UNIT3
Parameter)Unit(OPACITY (PERCENT)	OPACITY (PERCENT)	OPACITY (PERCENT)
02/26/13 10:00	3.8	7.9F	1.8
02/26/13 10:06	3.9	7.6F	1.9
02/26/13 10:12	4.0	6.4F	2.0
02/26/13 10:18	3.9	6.5F	1.9
02/26/13 10:24	3.9	6.9F	1.8
02/26/13 10:30	3.9	5.9F	1.8
02/26/13 10:36	3.8	6.7F	1.7
02/26/13 10:42	3.7	6.6F	1.8
02/26/13 10:48	3.7	7.0F	1.7
02/26/13 10:54	3.7	7.9F	1.7
02/26/13 11:00	3.6	6.1F	1.6
02/26/13 11:06	3.5	6.8F	1.5
02/26/13 11:12	3.6	6.3F	1.8
02/26/13 11:18	3.6	6.1F	7.1
02/26/13 11:24	3.7	7.1F	3.7
02/26/13 11:30	3.9	7.8F	2.7
02/26/13 11:36	3.7	8.8F	2.2
02/26/13 11:42	3.8	7.2F	2.1
02/26/13 11:48	3.8	7.1F	2.1
02/26/13 11:54	4.0	7.8F	2.2
02/26/13 12:00	4.0	6.4F	2.2
02/26/13 12:06	3.8	7.4F	1.8
02/26/13 12:12	3.6	8.0F	1.6
02/26/13 12:18	3.6	7.3F	1.8
02/26/13 12:24	5.0	9.0F	1.8
02/26/13 12:30	3.8	8.5F	1.9
02/26/13 12:36	3.8	10.0F	2.0
02/26/13 12:42	3.8	7.9F	1.9
02/26/13 12:48	3.7	6.3F	1.7
02/26/13 12:54	3.7	9.5F	1.7
02/26/13 13:00	3.7	7.3F	1.7
02/26/13 13:06	3.7	7.6F	1.8
02/26/13 13:12	3.7	8.3F	1.7
02/26/13 13:18	3.7	6.4F	1.7
02/26/13 13:24	3.8	8.4F	1.8
02/26/13 13:30	3.8	6.4F	1.8
02/26/13 13:36	3.7	6.4F	1.8
02/26/13 13:42	3.8	7.9F	1.9
02/26/13 13:48	3.8	6.2F	1.8
02/26/13 13:54	3.7	7.8F	1.6
02/26/13 14:00	3.6	6.6F	1.6
02/26/13 14:06	3.5	8.0F	1.5
02/26/13 14:12	3.7	8.0F	2.0
02/26/13 14:18	3.8	6.9F	2.1
02/26/13 14:24	3.9	11.9F	1.9
02/26/13 14:30	4.0	10.7F	2.0
02/26/13 14:36	3.8	13.5F	2.0
02/26/13 14:42	4.0	18.9F	1.9
02/26/13 14:48	3.8	10.6F	1.9
02/26/13 14:54	3.7	14.0F	1.8

F = Unit Offline

E = Exceedance

C = Calibration

S = Substituted

U - Startup

I = Invalid

M = Maintenance

T = Out Of Control

* = Suspect

D - Shutdown

Average Data

Plant: New Hope Power Company Okeelanta Cogen

Interval: 6 Minute

Type: Block

Report Period: 02/26/2013 00:00 Through 02/26/2013 23:59

Time Online Criteria: 1 minute(s)

Source	UNIT1	UNIT2	UNIT3
Parameter Unit(OPACITY (PERCENT)	OPACITY (PERCENT)	OPACITY (PERCENT)
02/26/13 15:00	3.7	10.7F	1.6
02/26/13 15:06	3.7	11.9F	1.9
02/26/13 15:12	3.7	11.6F	1.6
02/26/13 15:18	3.6	8.5F	1.5
02/26/13 15:24	3.6	12.5F	1.7
02/26/13 15:30	3.6	7.2F	1.6
02/26/13 15:36	3.6	7.3F	1.7
02/26/13 15:42	3.7	10.0F	1.6
02/26/13 15:48	3.6	8.9F	1.6
02/26/13 15:54	3.6	10.9F	1.6
02/26/13 16:00	3.6	7.3F	1.6
02/26/13 16:06	3.7	7.4F	1.6
02/26/13 16:12	3.6	9.8F	1.6
02/26/13 16:18	3.6	9.5F	1.6
02/26/13 16:24	3.6	15.5F	1.6
02/26/13 16:30	3.7	18.0F	1.6
02/26/13 16:36	3.6	7.0F	1.5
02/26/13 16:42	3.6	7.8F	1.6
02/26/13 16:48	3.7	5.6I	1.6
02/26/13 16:54	3.6	4.9	1.6
02/26/13 17:00	3.6	6.0	1.7
02/26/13 17:06	3.7	24.6E	1.7
02/26/13 17:12	3.6	28.6E	1.6
02/26/13 17:18	3.6	8.0	1.6
02/26/13 17:24	3.7	10.5	1.6
02/26/13 17:30	3.7	5.6	1.6
02/26/13 17:36	3.7	4.8	1.6
02/26/13 17:42	3.7	9.5	1.5
02/26/13 17:48	3.6	4.8	1.6
02/26/13 17:54	3.7	15.7	1.5
02/26/13 18:00	3.6	7.2	1.5
02/26/13 18:06	3.5	5.8	1.5
02/26/13 18:12	3.6	9.3	1.6
02/26/13 18:18	3.6	6.1	1.6
02/26/13 18:24	3.6	10.8	1.6
02/26/13 18:30	3.6	5.5	1.6
02/26/13 18:36	3.6	5.1	1.6
02/26/13 18:42	3.6	8.7	1.6
02/26/13 18:48	3.6	4.6	1.6
02/26/13 18:54	3.6	6.9	1.6
02/26/13 19:00	3.6	4.4	1.6
02/26/13 19:06	3.5	3.9	1.7
02/26/13 19:12	3.6	6.1	1.7
02/26/13 19:18	3.6	4.0	1.6
02/26/13 19:24	3.6	5.5	1.8
02/26/13 19:30	3.5	3.9	1.6
02/26/13 19:36	3.6	3.7	1.6
02/26/13 19:42	3.6	5.2	1.6
02/26/13 19:48	3.6	3.7	1.6
02/26/13 19:54	3.7	5.2	1.6

F = Unit Offline

E = Exceedance

C = Calibration

S = Substituted

U - Startup

I = Invalid

M = Maintenance

T = Out Of Control

* = Suspect

D - Shutdown

Average Data

Plant: New Hope Power Company Okeelanta Cogen

Interval: 6 Minute

Type: Block

Report Period: 02/26/2013 00:00 Through 02/26/2013 23:59

Time Online Criteria: 1 minute(s)

Source	UNIT1	UNIT2	UNIT3
Parameter Unit(OPACITY (PERCENT)	OPACITY (PERCENT)	OPACITY (PERCENT)
02/26/13 20:00	3.6	3.8	1.7
02/26/13 20:06	3.6	4.9	1.7
02/26/13 20:12	3.6	5.8	1.7
02/26/13 20:18	3.6	4.3	1.7
02/26/13 20:24	3.6	5.5	1.7
02/26/13 20:30	3.5	4.2	1.7
02/26/13 20:36	3.5	3.9	1.7
02/26/13 20:42	3.6	5.3	1.7
02/26/13 20:48	3.8	4.0	1.7
02/26/13 20:54	4.0	5.5	1.7
02/26/13 21:00	5.1	4.1	1.7
02/26/13 21:06	9.5	4.0	1.7
02/26/13 21:12	15.9	5.1	1.7
02/26/13 21:18	16.7	4.1	1.8
02/26/13 21:24	19.4	5.1	1.8
02/26/13 21:30	6.8	4.0	1.8
02/26/13 21:36	4.6	3.9	1.8
02/26/13 21:42	4.4	4.8	1.8
02/26/13 21:48	4.9	3.8	1.8
02/26/13 21:54	5.0	4.5	1.8
02/26/13 22:00	4.0	3.7	1.8
02/26/13 22:06	3.8	3.7	1.8
02/26/13 22:12	3.8	4.5	1.8
02/26/13 22:18	3.9	4.0	1.8
02/26/13 22:24	3.8	4.9	1.8
02/26/13 22:30	3.7	3.9	1.9
02/26/13 22:36	3.7	4.4	1.9
02/26/13 22:42	3.7	6.1	1.9
02/26/13 22:48	3.8	4.4	1.9
02/26/13 22:54	3.9	4.8	1.9
02/26/13 23:00	3.7	58.1E	1.9
02/26/13 23:06	3.7	8.6	1.8
02/26/13 23:12	3.8	4.6	1.8
02/26/13 23:18	3.7	3.6	1.8
02/26/13 23:24	3.8	6.6	1.8
02/26/13 23:30	3.9	7.8	2.1
02/26/13 23:36	3.8	8.1	2.0
02/26/13 23:42	3.7	13.3	1.8
02/26/13 23:48	3.8	7.5	1.9
02/26/13 23:54	3.7	5.5	1.9

Average	4.1	5.3	1.9
Minimum	3.5	2.9	1.5
Maximum	19.4	58.1	7.1
Summation	980.0	842.9	465.6
Included Data Points	239	160	239
Total number of Data Points	240	240	240

F = Unit Offline

E = Exceedance

C = Calibration

S = Substituted

U - Startup

I = Invalid

M = Maintenance

T = Out Of Control

* = Suspect

D - Shutdown