


July 2001 - Daily 30 Day Rolling Avg. NOx Lbs./Ton of Clinker

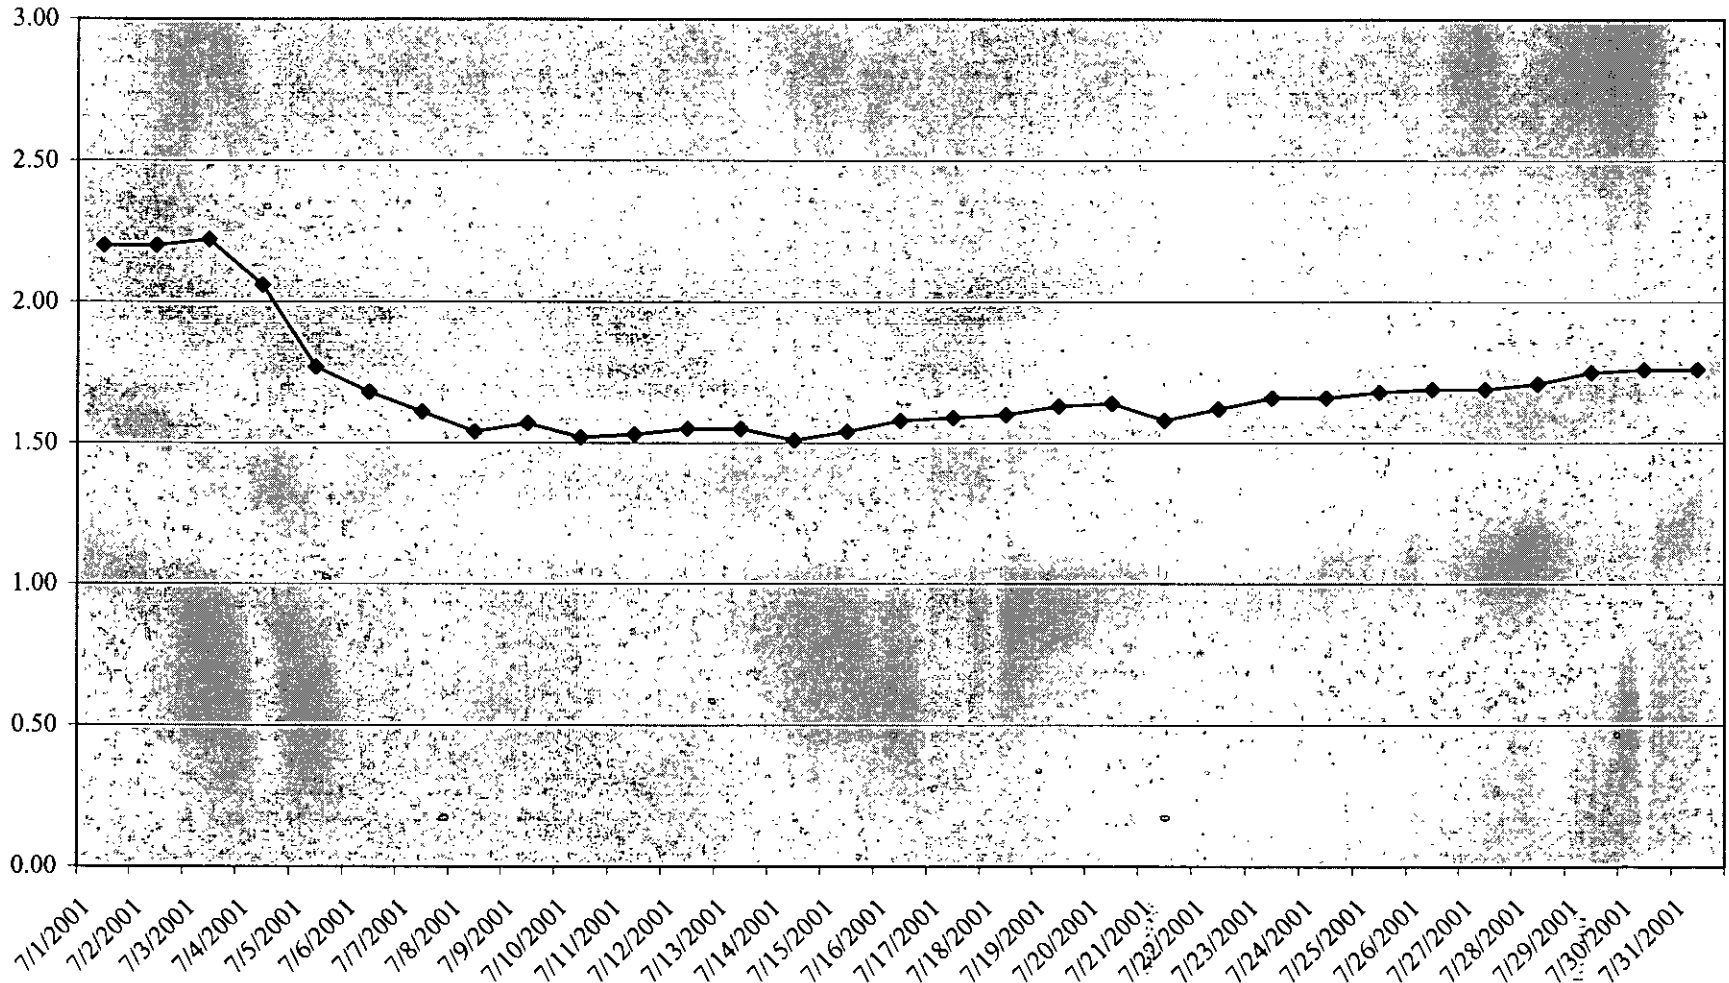

—●— 30 Day Rolling Avg. NOx Lbs./Ton of Clinker

RECEIVED

APR 11 2002

BUREAU OF AIR REGULATION

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 07/01/2001

Time	Clinker Prod. Tons/Hr. Avg. T7	Kiln SO2 SO2 Lbs./Hr. Avg T11	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	106.00	1.29	ND	200.71	1.89	9.83	ND
02:00	106.00	1.20	ND	204.59	1.93	10.17	ND
03:00	106.00	1.54	ND	229.34	2.16	10.34	ND
04:00	106.00	1.50	ND	167.06	1.58	12.36	ND
05:00	106.00	1.46	ND	184.79	1.74	10.38	ND
06:00	106.00	1.96	ND	250.61	2.36	9.99	ND
07:00	106.00	1.42	ND	242.05	2.28	10.60	ND
08:00	106.00	1.63	ND	210.49	1.99	9.92	ND
09:00	106.00	1.47	ND	229.31	2.16	9.83	ND
10:00	106.00	1.79	ND	250.93	2.37	8.14	ND
11:00	106.00	1.96	ND	245.57	2.32	8.08	ND
12:00	106.00	2.98	ND	253.18	2.39	8.96	ND
13:00	106.00	2.63	ND	206.55	1.95	15.03	ND
14:00	106.00	2.66	ND	262.23	2.47	8.90	ND
15:00	106.00	1.98	ND	247.18	2.33	8.56	ND
16:00	106.00	1.68	ND	275.36X	2.60	7.71	ND
17:00	106.00	1.72	ND	245.27	2.31	6.67	ND
18:00	106.00	1.53	ND	231.76	2.19	7.43	ND
19:00	106.00	1.09	ND	226.72	2.14	7.37	ND
20:00	106.00	1.34	ND	253.91	2.40	6.50	ND
21:00	106.00	1.23	ND	258.55	2.44	5.91	ND
22:00	106.00	1.40	ND	242.29	2.29	6.75	ND
23:00	106.00	1.67	ND	248.13	2.34	7.09	ND
24:00	106.00	2.02	ND	238.91	2.25	6.84	ND
Total	2544.00	41.20	INS	5605.49	52.88	213.30	INS
Average	106.00	1.70	INS	233.56	2.20	8.90	INS
Maximum	106.00	3.00	INS	275.36	2.60	15.00	INS
Minimum	106.00	1.10	INS	167.06	1.58	5.90	INS
Rolling	100.10	1.70	MNR	144.94	2.20	5.60	MNR
Excess		0	0	1	0	0	0
Uptm %	100.00	100.00	0.00	100.00	100.00	100.00	0.00
# Per	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0
ND	0	0	24	0	0	0	24
OC		0	0	0	0	0	0
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	100.00	100.00	0.00	100.00	100.00	100.00	0.00
MDT Per	0	0	24	0	0	0	24

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Emissions Data

Daily Report for 07/01/2001

Time	Kiln SO2 SO2 ppm Avg.	Kiln NOx NOx ppm Avg.	Kiln THC THC ppm Avg.	Kiln Flow ACFM Avg.	Kiln Flow Flow SCFM Avg.	Kiln Flow DSCFM Avg.	Kiln Temp. Deg. F Avg.	Coal Mill Temp. Deg. F Avg.
01:00	0.81	175.33	7.62	240944	183540	156008	221	172
02:00	0.76	180.40	7.95	239348	181208	154024	223	172
03:00	0.97	201.27	8.04	241408	186136	158216	226	171
04:00	0.96	149.04	9.77	237500	191656	162908	225	171
05:00	0.94	165.55	8.24	236856	171432	145716	226	171
06:00	1.30	231.95	8.20	230148	171908	146124	229	171
07:00	0.91	217.82	8.45	235008	180236	153204	225	172
08:00	1.06	191.48	8.01	230872	177612	150968	220	172
09:00	0.97	212.67	8.19	230384	175916	149528	232	173
10:00	1.15	225.50	6.49	234752	177524	150896	223	174
11:00	1.34	234.16	6.84	220572	174364	148208	221	175
12:00	1.95	229.89	7.24	228724	180432	153364	213	175
13:00	1.62	177.50	11.44	241200	190540	161956	211	175
14:00	1.66	229.29	6.90	237820	194368	165212	213	176
15:00	1.25	217.51	6.66	233600	182200	154868	205	175
16:00	1.05	243.38	6.02	235476	188096	159884	212	175
17:00	1.10	218.61	5.28	231192	186932	158892	208	172
18:00	0.98	205.70	5.85	234860	189136	160764	215	171
19:00	0.68	199.29	5.74	236004	176836	150308	211	171
20:00	0.85	224.03	5.09	238528	189684	161236	221	170
21:00	0.78	227.53	4.62	238064	185324	157520	218	168
22:00	0.88	212.09	5.24	239088	183204	155724	217	164
23:00	1.06	219.39	5.56	238148	179440	152524	222	166
24:00	1.29	213.18	5.42	238332	191348	162644	228	169
Average	1.10	208.00	7.00	235368	182878	155446	219	172
Maximum	1.95	243.00	11.40	241408	194368	165212	232	176
Minimum	0.68	149.00	4.60	220572	171432	145716	205	164
Rolling	1.73	151.00	5.60	153785	121610	103368	201	140
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0	0
OC	0	0	0	0	0	0	0	0
CAL	0	0	0	0	0	0	0	0
Bad Per	0	0	0	0	0	0	0	0
MUT %	100.00	100.00	100.00	100.00	100.00	100.00	100.00	100.00
MDT Per	0	0	0	0	0	0	0	0

Key:
 U, UD User Disable F, IF Instrument Failure C, Cal Calibration
 R, OC Out of Control N, ND No Data M, MNR Monitoring Not Required
 V, Valid Valid Data W, Warning Drift Warning

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 07/02/2001

Time	Clinker Prod. Tons/Hr. Avg. T7	Kiln SO2 SO2 Lbs./Hr. Avg T11	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	106.00	1.89	ND	255.24	2.41	6.67	ND
02:00	106.00	1.62	ND	249.96	2.36	6.84	ND
03:00	106.00	1.29	ND	241.70	2.28	7.31	ND
04:00	106.00	1.30	ND	224.47	2.12	7.76	ND
05:00	106.00	1.58	ND	224.21	2.12	7.18	ND
06:00	106.00	1.38	ND	205.54	1.94	8.05	ND
07:00	106.00	OC	ND	OC	OC	8.57	ND
08:00	106.00	1.24	ND	188.14	1.78	7.84	ND
09:00	75.00	ND	ND	ND	ND	ND	ND
10:00	75.00	1.33	ND	187.22	2.50	6.94	ND
11:00	75.00	2.52	ND	194.39	2.59	22.20	ND
12:00	75.00	3.69	ND	185.06	2.47	32.85	ND
13:00	75.00	4.40	ND	163.32	2.18	44.37	ND
14:00	75.00	4.51	ND	224.10	2.99	12.61	ND
15:00	75.00	2.60	ND	230.81	3.08	10.12	ND
16:00	75.00	2.58	ND	189.04	2.52	11.13	ND
17:00	75.00	3.49	ND	183.20	2.44	11.43	ND
18:00	102.00	2.77	ND	177.33	1.80	9.09	ND
19:00	102.00	1.20	ND	202.71	1.99	11.43	ND
20:00	102.00	2.25	ND	194.86	1.91	8.54	ND
21:00	102.00	4.43	ND	157.92	1.55	10.75	ND
22:00	102.00	0.47	ND	159.72	1.57	13.91	ND
23:00	102.00	0.55	ND	179.19	1.76	18.13	ND
24:00	102.00	2.21	ND	239.81	2.35	7.26	ND
Total	2237.00	52.00	INS	4457.94	48.71	298.30	INS
Average	93.20	2.20	INS	202.63	2.21	12.40	INS
Maximum	106.00	4.50	INS	255.24	3.08	44.40	INS
Minimum	75.00	0.50	INS	157.92	1.55	6.70	INS
Rolling	101.80	1.40	MNR	150.26	2.20	6.20	MNR
Excess		0	0	0	0	0	0
Uptm %	100.00	91.67	0.00	91.67	91.67	95.83	0.00
# Per	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0
ND	0	1	24	1	1	1	24
OC		1	0	1	1	0	0
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	100.00	95.83	0.00	95.83	95.83	97.92	0.00
MDT Per	0	2	48	2	2	1	48

Key:
 U, UD User Disable F, IF Instrument Failure C, Cal Calibration
 R, OC Out of Control N, ND No Data M, MNR Monitoring Not Required
 V, Valid Valid Data W, Warning Drift Warning

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Emissions Data

Daily Report for 07/02/2001

Time	Kiln SO2 SO2 ppm Avg.	Kiln NOx NOx ppm Avg.	Kiln THC THC ppm Avg.	Kiln Flow ACFM Avg.	Kiln Flow Flow SCFM Avg.	Kiln Flow Flow DSCFM Avg.	Kiln Temp. Deg. F Avg.	Coal Mill Temp. Deg. F Avg.
01:00	1.20	226.59	5.25	238484	180496	153424	225	168
02:00	1.03	221.65	5.38	238764	178780	151964	225	168
03:00	0.82	213.89	5.74	238024	180144	153124	222	167
04:00	0.82	197.02	6.04	239072	185032	157276	219	165
05:00	1.01	198.30	5.63	238484	190864	162236	223	164
06:00	0.87	180.32	6.27	238896	185792	157920	218	164
07:00	OC	OC	6.54	242060	178972	152128	216	165
08:00	0.80	166.90	6.09	238840	178800	151984	217	165
09:00	ND	ND	ND	ND	190296	161752	ND	ND
10:00	0.82	160.88	5.29	240880	197804	168128	210	169
11:00	1.57	167.60	17.02	238472	197816	168140	206	173
12:00	2.32	161.86	25.39	238952	194840	165612	216	173
13:00	2.80	144.76	35.32	238324	187980	159784	225	173
14:00	2.98	206.02	10.28	230372	189308	160912	225	178
15:00	1.69	208.45	8.17	231016	181564	154328	216	173
16:00	1.64	167.79	8.73	234380	177960	151268	212	173
17:00	2.20	160.80	8.90	235112	177372	150768	209	173
18:00	1.78	157.86	7.19	231772	180260	153224	208	169
19:00	0.79	211.84	10.23	215144	180712	153604	238	168
20:00	1.42	170.73	6.67	233984	188376	160116	204	168
21:00	3.72	153.03	9.72	207516	107674	91520	222	166
22:00	0.47	219.11	17.06	157700	124882	106148	242	168
23:00	0.43	203.29	18.43	190400	157456	133836	237	169
24:00	1.55	234.44	6.29	216448	170520	144940	224	169
Average	1.43	186.00	10.30	228873	177654	151006	220	169
Maximum	3.72	234.00	35.30	242060	197816	168140	242	178
Minimum	0.43	145.00	5.20	157700	107674	91520	204	164
Rolling	1.49	155.00	6.10	155553	122941	104499	201	141
Uptm %	91.67	91.67	95.83	95.83	100.00	100.00	95.83	95.83
# Per	24	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0	0
ND	1	1	1	1	0	0	1	1
OC	1	1	0	0	0	0	0	0
CAL	0	0	0	0	0	0	0	0
Bad Per	1	0	0	0	0	0	0	0
MJT %	95.83	95.83	97.92	97.92	100.00	100.00	97.92	97.92
MDT Per	2	2	1	1	0	0	1	1

Key: User Disable F, IF Instrument Failure C, Cal Calibration
 U, UD N, ND No Data M, MNR Monitoring Not Required
 R, OC W, Warning Drift Warning

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 07/03/2001

Time	Clinker Prod. Tons/Hr. Avg. T7	Kiln SO2 SO2 Lbs./Hr. Avg T11	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	102.00	2.22	ND	231.90	2.27	8.09	ND
02:00	102.00	1.48	ND	209.86	2.06	8.52	ND
03:00	102.00	1.37	ND	210.38	2.06	8.39	ND
04:00	102.00	1.35	ND	244.32	2.40	7.19	ND
05:00	102.00	0.57	ND	269.27X	2.64	9.60	ND
06:00	102.00	0.11	ND	250.73	2.46	11.43	ND
07:00	102.00	0.11	ND	263.19	2.58	11.03	ND
08:00	102.00	0.11	ND	249.03	2.44	12.27	ND
09:00	102.00	0.12	ND	256.09	2.51	11.55	ND
10:00	102.00	0.13	ND	250.54	2.46	OC	ND
11:00	102.00	0.17	ND	263.62	2.58	OC	ND
12:00	102.00	0.45	ND	261.15	2.56	10.00	ND
13:00	102.00	0.97	ND	247.46	2.43	9.14	ND
14:00	102.00	0.35	ND	264.81	2.60	7.80	ND
15:00	102.00	0.19	ND	258.09	2.53	8.73	ND
16:00	102.00	0.20	ND	227.33	2.23	8.89	ND
17:00	102.00	0.63	ND	190.94	1.87	10.88	ND
18:00	102.00	2.69	ND	192.39	1.89	7.97	ND
19:00	102.00	2.70	ND	228.98	2.25	9.49	ND
20:00	102.00	2.05	ND	230.13	2.26	9.62	ND
21:00	102.00	1.63	ND	180.39	1.77	9.10	ND
22:00	102.00	1.60	ND	159.13	1.56	12.16	ND
23:00	102.00	1.63	ND	191.23	1.87	8.90	ND
24:00	102.00	2.17	ND	194.89	1.91	8.27	ND
Total	2448.00	25.00	INS	5525.85	54.19	230.70	INS
Average	102.00	1.00	INS	230.24	2.26	9.60	INS
Maximum	102.00	2.70	INS	269.27	2.64	12.30	INS
Minimum	102.00	0.10	INS	159.13	1.56	7.20	INS
Rolling	102.90	1.30	MNR	152.15	2.22	6.40	MNR
Excess		0	0	1	0	0	0
Uptm %	100.00	100.00	0.00	100.00	100.00	91.67	0.00
# Per	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0
ND	0	0	24	0	0	0	24
OC		0	0	0	0	2	0
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	100.00	97.22	0.00	97.22	97.22	95.83	0.00
MDT Per	0	2	72	2	2	3	72

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Emissions Data

Daily Report for 07/03/2001

Time	Kiln SO2 SO2 ppm Avg.	Kiln NOx NOx ppm Avg.	Kiln THC THC ppm Avg.	Kiln Flow ACFM Avg.	Kiln Flow Flow SCFM Avg.	Kiln Flow Flow DSCFM Avg.	Kiln Temp. Deg. F Avg.	Coal Mill Temp. Deg. F Avg.
01:00	1.55	225.22	6.96	218988	172108	146292	228	168
02:00	1.00	198.63	7.16	220952	174632	148432	217	168
03:00	0.91	193.13	6.84	226372	184112	156492	212	169
04:00	0.87	218.46	5.70	229600	178760	151944	205	169
05:00	0.39	287.65	9.28	200840	143036	121582	229	168
06:00	0.09	290.73	11.76	186288	147668	125518	240	168
07:00	0.09	299.89	11.18	188196	150792	128172	235	168
08:00	0.09	280.03	12.21	190392	153568	130530	232	169
09:00	0.09	273.13	10.94	199432	155128	131856	229	170
10:00	0.10	268.54	OC	198044	155948	132560	227	171
11:00	0.13	271.88	OC	205972	157548	133916	228	173
12:00	0.34	272.76	9.27	203732	159316	135420	229	174
13:00	0.75	266.26	8.69	197796	153952	130858	229	173
14:00	0.28	291.02	7.60	193500	147180	125106	228	173
15:00	0.15	282.45	8.48	194288	151012	128358	228	173
16:00	0.18	272.02	9.59	178208	128692	109388	234	173
17:00	0.45	201.53	10.15	204968	168476	143200	234	174
18:00	1.72	170.61	6.23	234692	189076	160716	213	174
19:00	1.70	199.74	7.32	238620	182480	155108	214	173
20:00	1.28	199.99	7.43	237988	185232	157448	210	170
21:00	1.02	156.48	7.00	238052	187408	159296	208	169
22:00	0.99	137.02	9.29	236660	178128	151408	199	169
23:00	1.01	164.57	6.80	237012	186032	158124	200	170
24:00	1.35	169.04	6.36	236400	194312	165164	204	170
Average	0.69	233.00	8.60	212375	166025	141120	221	171
Maximum	1.72	300.00	12.20	238620	194312	165164	240	174
Minimum	0.09	137.00	5.70	178208	128692	109388	199	168
Rolling	1.43	158.00	6.30	155655	123006	104554	201	141
Uptm %	100.00	100.00	91.67	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0	0
OC	0	0	2	0	0	0	0	0
CAL	0	0	0	0	0	0	0	0
Bad Per	0	0	0	0	0	0	0	0
MUT %	97.22	97.22	95.83	98.61	100.00	100.00	98.61	98.61
MDT Per	2	2	3	1	0	0	1	1

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 07/04/2001

Time	Clinker Prod. Tons/Hr. Avg. T7	Kiln SO2 SO2 Lbs./Hr. Avg T11	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	102.00	2.90	ND	201.73	1.98	9.08	ND
02:00	102.00	2.56	ND	201.54	1.98	7.64	ND
03:00	102.00	1.63	ND	180.63	1.77	8.88	ND
04:00	102.00	1.15	ND	147.85	1.45	9.00	ND
05:00	102.00	1.21	ND	161.80	1.59	8.80	ND
06:00	102.00	1.34	ND	170.99	1.68	7.69	ND
07:00	102.00	1.12	ND	174.64	1.71	10.43	ND
08:00	102.00	1.00	ND	146.82	1.44	12.90	ND
09:00	102.00	1.51	ND	130.20	1.28	25.84	ND
10:00	102.00	1.57	ND	100.53	0.99	20.43	ND
11:00	102.00	1.86	ND	111.08	1.09	19.77	ND
12:00	102.00	3.29	ND	200.47	1.97	14.99	ND
13:00	102.00	3.23	ND	176.16	1.73	12.88	ND
14:00	102.00	2.43	ND	160.07	1.57	24.60	ND
15:00	102.00	1.12	ND	130.99	1.28	33.27	ND
16:00	102.00	1.49	ND	158.54	1.55	16.20	ND
17:00	102.00	1.22	ND	122.02	1.20	42.86	ND
18:00	102.00	1.54	ND	164.30	1.61	21.25	ND
19:00	102.00	1.81	ND	164.88	1.62	24.06	ND
20:00	102.00	1.67	ND	145.96	1.43	30.57	ND
21:00	102.00	2.64	ND	197.54	1.94	13.68	ND
22:00	102.00	2.94	ND	164.07	1.61	25.35	ND
23:00	102.00	3.46	ND	145.93	1.43	28.53	ND
24:00	102.00	3.79	ND	124.34	1.22	32.01	ND
Total	2448.00	48.40	INS	3783.08	37.12	460.80	INS
Average	102.00	2.00	INS	157.63	1.55	19.20	INS
Maximum	102.00	3.80	INS	201.73	1.98	42.90	INS
Minimum	102.00	1.00	INS	100.53	0.99	7.60	INS
Rolling	102.50	1.40	MNR	154.37	2.06	7.10	MNR
Excess		0	0	0	0	0	0
Uptm %	100.00	100.00	0.00	100.00	100.00	100.00	0.00
# Per	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0
ND	0	0	24	0	0	0	24
OC		0	0	0	0	0	0
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	100.00	97.92	0.00	97.92	97.92	96.88	0.00
MDT Per	0	2	96	2	2	3	96

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Emissions Data

Daily Report for 07/04/2001

Time	Kiln SO2 SO2 ppm Avg.	Kiln NOx NOx ppm Avg.	Kiln THC THC ppm Avg.	Kiln Flow ACFM Avg.	Kiln Flow Flow SCFM Avg.	Kiln Flow Flow DSCFM Avg.	Kiln Temp. Deg. F Avg.	Coal Mill Temp. Deg. F Avg.
01:00	1.80	174.30	6.97	237076	188796	160476	203	171
02:00	1.58	173.03	5.82	238164	191964	163164	202	170
03:00	1.01	156.29	6.81	237160	189368	160964	204	169
04:00	0.71	127.06	6.84	238020	184984	157236	202	169
05:00	0.74	138.36	6.68	238488	191148	162476	200	168
06:00	0.83	147.64	5.89	236984	189248	160856	202	168
07:00	0.69	149.56	7.97	239068	190960	162316	203	168
08:00	0.63	127.92	9.97	236424	188896	160564	207	169
09:00	0.96	114.66	20.19	234332	197092	167528	208	171
10:00	0.98	86.99	15.68	236544	185116	157344	203	171
11:00	1.17	98.12	15.45	234256	187992	159792	209	172
12:00	2.05	173.89	11.51	238040	187552	159416	208	175
13:00	2.02	153.07	10.00	238008	189492	161068	210	174
14:00	1.51	138.24	19.02	238116	188856	160528	208	173
15:00	0.69	111.95	25.35	238996	186668	158668	202	168
16:00	0.93	137.45	12.47	234860	196988	167440	199	163
17:00	0.75	104.86	32.67	238268	192220	163388	203	168
18:00	0.95	141.14	16.20	237972	192124	163304	202	171
19:00	1.13	142.39	18.43	238788	194904	165668	208	171
20:00	1.03	125.77	23.38	240264	191756	162992	210	172
21:00	1.63	170.20	10.45	239012	189920	161432	206	171
22:00	1.83	141.69	19.47	238020	192728	163820	206	171
23:00	2.13	124.66	21.65	240300	191756	162988	205	170
24:00	2.32	105.93	24.22	239660	189248	160856	201	170
Average	1.25	136.00	14.70	237784	190407	161845	205	170
Maximum	2.32	174.00	32.70	240300	197092	167528	210	175
Minimum	0.63	87.00	5.80	234256	184984	157236	199	163
Rolling	1.44	158.00	6.80	159721	126285	107342	200	142
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0	0
OC	0	0	0	0	0	0	0	0
CAL	0	0	0	0	0	0	0	0
Bad Per	0	0	0	0	0	0	0	0
MUT %	97.92	97.92	96.88	98.96	100.00	100.00	98.96	98.96
MDT Per	2	2	3	1	0	0	1	1

Key: U, UD User Disable F, IF Instrument Failure C, Cal Calibration
R, OC Out of Control N, ND No Data M, MNR Monitoring Not Required
V, Valid V, Valid Data W, Warning Drift Warning

**Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Mass Emissions Report**

Daily Report for 07/05/2001

Time	Clinker Prod. Tons/Hr. Avg.	Kiln SO2 SO2 Lbs./Hr. Avg.	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	102.00	2.56	ND	128.09	1.26	32.25	ND
02:00	102.00	2.18	ND	119.77	1.17	24.74	ND
03:00	102.00	2.43	ND	98.00	0.96	35.62	ND
04:00	102.00	2.05	ND	83.90	0.82	37.36	ND
05:00	102.00	2.28	ND	100.38	0.98	25.43	ND
06:00	102.00	2.43	ND	112.35	1.10	24.52	ND
07:00	102.00	2.09	ND	121.51	1.19	20.31	ND
08:00	102.00	0.71	ND	114.13	1.12	15.03	ND
09:00	MNR	0.08	ND	MNR	0.02	0.19	ND
10:00	MNR	0.08	ND	MNR	0.00	0.12	ND
11:00	MNR	0.76	ND	MNR	0.02	0.33	ND
12:00	MNR	1.41	ND	MNR	0.10	0.42	ND
13:00	MNR	22.30	ND	MNR	0.06	0.04	ND
14:00	MNR	9.13	ND	MNR	0.10	0.04	ND
15:00	MNR	44.32	ND	MNR	0.11	0.19	ND
16:00	MNR	11.04	ND	MNR	0.43	6.46	ND
17:00	MNR	4.95	ND	MNR	0.46	10.13	ND
18:00	MNR	9.85	ND	MNR	0.51	13.06	ND
19:00	102.00	7.01	ND	91.38	0.90	11.71	ND
20:00	102.00	2.57	ND	133.66	1.31	7.02	ND
21:00	102.00	1.46	ND	133.98	1.31	9.98	ND
22:00	102.00	2.20	ND	142.39	1.40	6.73	ND
23:00	MNR	0.58	ND	MNR	0.14	0.13	ND
24:00	MNR	0.11	ND	MNR	0.03	0.08	ND
Total	2448.00	134.50	INS	1379.54	15.50	281.70	INS
Average	102.00	5.60	INS	114.96	0.65	11.70	INS
Maximum	102.00	44.30	INS	142.39	1.40	37.40	INS
Minimum	102.00	0.10	INS	83.90	0.00	0.00	INS
Rolling	102.50	1.50	MNR	148.59	1.77	7.20	MNR
Excess		0	0	0	0	0	0
Uptm %	100.00	100.00	0.00	100.00	100.00	100.00	0.00
# Per	24	24	24	24	24	24	24
MNR	0	0	0	12	0	0	0
ND	0	0	24	0	0	0	24
OC		0	0	0	0	0	0
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	100.00	98.33	0.00	98.15	98.33	97.50	0.00
MDT Per	0	2	120	2	2	3	120

Key:
 U, UD User Disable F, IF Instrument Failure C, Cal Calibration
 R, OC Out of Control N, ND No Data M, MNR Monitoring Not Required
 V, Valid Valid Data W, Warning Drift Warning

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Emissions Data

Daily Report for 07/05/2001

Time	Kiln SO2 SO2 ppm Avg.	Kiln NOx NOx ppm Avg.	Kiln THC THC ppm Avg.	Kiln Flow ACFM Avg.	Kiln Flow Flow SCFM Avg.	Kiln Flow DSCFM Avg.	Kiln Temp. Deg. F Avg.	Coal Mill Temp. Deg. F Avg.
01:00	1.58	110.35	24.60	239556	185444	157624	208	171
02:00	1.35	103.02	18.85	239128	186584	158596	206	170
03:00	1.49	83.89	27.03	239380	195268	165976	203	170
04:00	1.26	71.76	28.34	237520	190032	161528	198	170
05:00	1.39	85.49	19.04	238032	190004	161504	196	170
06:00	1.50	96.15	18.56	238420	195844	166464	200	170
07:00	1.28	103.98	16.81	237356	189700	161244	198	170
08:00	0.53	157.43	16.38	154888	57491	48867	230	164
09:00	0.29	6.16	0.76	49807	14747	12535	238	117
10:00	0.43	0.84	0.74	30577	23649	20101	222	104
11:00	1.98	7.44	1.24	49715	48231	40996	234	149
12:00	3.49	36.83	1.28	63784	48624	41329	241	153
13:00	54.87	20.82	0.14	62176	35621	30278	234	159
14:00	21.79	36.23	0.14	61491	60811	51689	228	158
15:00	101.43	32.90	0.38	69054	94444	80276	226	162
16:00	15.39	83.13	11.14	114000	85786	72918	248	163
17:00	6.45	85.35	16.30	120538	90716	77108	255	171
18:00	12.83	94.24	21.20	121226	89356	75952	259	173
19:00	8.43	154.67	17.47	131852	103052	87594	264	172
20:00	2.60	173.82	8.24	169496	143928	122340	255	171
21:00	1.00	133.52	8.72	216776	178128	151408	227	169
22:00	1.41	128.20	5.25	228876	171136	145464	209	171
23:00	0.50	14.17	0.14	169476	54778	46561	209	166
24:00	0.15	5.05	0.14	114720	101802	86534	230	115
Average	10.14	76.00	10.90	149910	113966	96870	226	160
Maximum	101.43	174.00	28.30	239556	195844	166464	264	173
Minimum	0.15	1.00	0.10	30577	14747	12535	196	104
Rolling	1.72	154.00	7.00	156638	123751	105188	201	142
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0	0
OC	0	0	0	0	0	0	0	0
CAL	0	0	0	0	0	0	0	0
Bad Per	0	0	0	0	0	0	0	0
MUT %	98.33	98.33	97.50	99.17	100.00	100.00	99.17	99.17
MDT Per	2	2	3	1	0	0	1	1

Key:
 U, UD User Disable F, IF Instrument Failure C, Cal Calibration
 R, OC Out of Control N, ND No Data M, MNR Monitoring Not Required
 V, Valid Valid Data W, Warning Drift Warning

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 07/06/2001

Time	Clinker Prod. Tons/Hr. Avg. T7	Kiln SO2 SO2 Lbs./Hr. Avg T11	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	102.00	0.44	ND	4.47	0.04	0.11	ND
02:00	102.00	0.58	ND	13.11	0.13	0.12	ND
03:00	102.00	0.61	ND	23.41	0.23	0.12	ND
04:00	102.00	8.31	ND	37.61	0.37	0.97	ND
05:00	102.00	2.74	ND	105.62	1.04	9.28	ND
06:00	102.00	2.08	ND	89.96	0.88	19.18	ND
07:00	102.00	1.85	ND	114.29	1.12	9.78	ND
08:00	102.00	2.06	ND	130.34	1.28	9.29	ND
09:00	102.00	1.79	ND	120.65	1.18	15.36	ND
10:00	102.00	1.90	ND	145.50	1.43	11.47	ND
11:00	102.00	1.89	ND	108.53	1.06	21.26	ND
12:00	102.00	1.90	ND	102.37	1.00	23.15	ND
13:00	102.00	0.47	ND	77.14	0.76	32.35	ND
14:00	102.00	0.11	ND	104.56	1.03	25.53	ND
15:00	105.00	0.11	ND	107.94	1.03	26.82	ND
16:00	105.00	0.11	ND	88.64	0.84	38.38	ND
17:00	105.00	1.75	ND	84.60	0.81	27.75	ND
18:00	105.00	2.41	ND	160.41	1.53	11.36	ND
19:00	105.00	4.01	ND	202.43	1.93	11.18	ND
20:00	105.00	3.47	ND	271.79X	2.59	9.76	ND
21:00	105.00	1.41	ND	287.32X	2.74	11.34	ND
22:00	105.00	0.13	ND	205.18	1.95	16.30	ND
23:00	105.00	0.11	ND	180.00	1.71	15.74	ND
24:00	105.00	0.10	ND	195.45	1.86	15.43	ND
Total	2478.00	40.20	INS	2961.32	28.54	362.20	INS
Average	103.30	1.70	INS	123.39	1.19	15.10	INS
Maximum	105.00	8.30	INS	287.32	2.74	38.40	INS
Minimum	102.00	0.10	INS	4.47	0.04	0.10	INS
Rolling	102.60	1.40	MNR	145.27	1.68	7.90	MNR
Excess		0	0	2	0	0	0
Uptm %	100.00	100.00	0.00	100.00	100.00	100.00	0.00
# Per	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0
ND	0	0	24	0	0	0	24
OC		0	0	0	0	0	0
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	100.00	98.61	0.00	98.48	98.61	97.92	0.00
MDT Per	0	2	144	2	2	3	144

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Emissions Data

Daily Report for 07/06/2001

Time	Kiln SO2 SO2 ppm Avg.	Kiln NOx NOx ppm Avg.	Kiln THC THC ppm Avg.	Kiln Flow ACFM Avg.	Kiln Flow Flow SCFM Avg.	Kiln Flow DSCFM Avg.	Kiln Temp. Deg. F Avg.	Coal Mill Temp. Deg. F Avg.
01:00	0.47	6.49	0.14	143532	118890	101056	224	96
02:00	0.56	17.15	0.14	151000	116660	99162	186	133
03:00	0.58	31.04	0.14	151176	123724	105168	190	142
04:00	8.70	51.35	1.06	151752	135880	115500	217	140
05:00	1.92	97.72	7.60	227424	186052	158144	224	159
06:00	1.32	79.51	15.02	237352	187400	159292	219	169
07:00	1.17	100.62	7.67	241188	186944	158904	227	170
08:00	1.33	117.14	7.40	236488	188556	160272	228	169
09:00	1.13	106.39	12.06	238440	188640	160348	221	173
10:00	1.19	127.19	8.90	240344	190952	162308	220	173
11:00	1.20	96.28	16.69	238372	190920	162284	224	173
12:00	1.23	92.58	18.55	236352	137892	117208	231	173
13:00	0.45	100.85	37.63	173792	123974	105376	277	173
14:00	0.11	134.12	28.91	176556	127746	108584	272	169
15:00	0.10	135.95	29.94	177792	133756	113694	265	169
16:00	0.09	105.97	39.78	189564	170320	144768	259	170
17:00	1.11	75.63	22.12	233996	191300	162604	217	172
18:00	1.51	139.91	8.79	238568	191092	162428	214	172
19:00	2.56	179.82	8.80	235348	184304	156660	216	175
20:00	2.18	237.42	7.56	238576	189144	160772	215	178
21:00	0.89	279.77	10.26	220688	125440	106622	227	178
22:00	0.12	267.88	18.89	172020	125734	106874	267	178
23:00	0.10	236.31	18.33	170708	124350	105698	265	178
24:00	0.09	253.53	17.77	172632	125190	106412	265	178
Average	1.25	128.00	14.30	203903	156869	133339	232	165
Maximum	8.70	280.00	39.80	241188	191300	162604	277	178
Minimum	0.09	6.00	0.10	143532	116660	99162	186	96
Rolling	1.44	153.00	7.60	159187	125973	107076	200	142
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0	0
OC	0	0	0	0	0	0	0	0
CAL	0	0	0	0	0	0	0	0
Bad Per	0	0	0	0	0	0	0	0
MUT %	98.61	98.61	97.92	99.31	100.00	100.00	99.31	99.31
MDT Per	2	2	3	1	0	0	1	1

Key: User Disable F, IF Instrument Failure C, Cal Calibration
 R, OC N, ND No Data M, MNR Monitoring Not Required
 V, Valid W, Warning Drift Warning

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 07/07/2001

Time	Clinker Prod. Tons/Hr. Avg. T7	Kiln SO2 SO2 Lbs./Hr. Avg T11	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	105.00	0.11	ND	195.25	1.86	15.59	ND
02:00	105.00	0.10	ND	177.78	1.69	15.00	ND
03:00	105.00	0.10	ND	152.66	1.45	20.07	ND
04:00	105.00	0.11	ND	144.16	1.37	29.10	ND
05:00	105.00	0.34	ND	128.82	1.23	20.11	ND
06:00	105.00	0.78	ND	126.33	1.20	12.34	ND
07:00	105.00	1.03	ND	140.27	1.34	10.59	ND
08:00	105.00	0.94	ND	93.81	0.89	23.28	ND
09:00	105.00	0.93	ND	82.98	0.79	37.76	ND
10:00	105.00	1.16	ND	95.60	0.91	29.88	ND
11:00	105.00	1.55	ND	73.15	0.70	30.22	ND
12:00	105.00	2.24	ND	79.96	0.76	26.37	ND
13:00	105.00	2.78	ND	81.48	0.78	24.77	ND
14:00	105.00	2.93	ND	86.63	0.83	24.73	ND
15:00	105.00	2.79	ND	116.10	1.11	11.71	ND
16:00	105.00	3.10	ND	125.32	1.19	13.05	ND
17:00	105.00	2.38	ND	148.73	1.42	12.50	ND
18:00	105.00	3.33	ND	140.86	1.34	14.29	ND
19:00	105.00	4.42	ND	160.40	1.53	14.43	ND
20:00	105.00	3.43	ND	148.50	1.41	14.59	ND
21:00	105.00	3.50	ND	126.73	1.21	14.89	ND
22:00	105.00	2.31	ND	129.24	1.23	11.15	ND
23:00	105.00	2.87	ND	124.04	1.18	12.23	ND
24:00	106.24	2.65	ND	123.11	1.17	12.87	ND
Total	2521.20	45.80	INS	3001.91	28.59	451.70	INS
Average	105.00	1.90	INS	125.08	1.19	18.80	INS
Maximum	106.20	4.40	INS	195.25	1.86	37.80	INS
Minimum	105.00	0.10	INS	73.15	0.70	10.60	INS
Rolling	102.60	1.50	MNR	142.60	1.61	8.40	MNR
Excess		0	0	0	0	0	0
Uptm %	100.00	100.00	0.00	100.00	100.00	100.00	0.00
# Per	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0
ND	0	0	24	0	0	0	24
OC		0	0	0	0	0	0
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	100.00	98.81	0.00	98.72	98.81	98.21	0.00
MDT Per	0	2	168	2	2	3	168

Key:
 U, UD User Disable F, IF Instrument Failure C, Cal Calibration
 R, OC Out of Control N, ND No Data M, MNR Monitoring Not Required
 V, Valid Valid Data W, Warning Drift Warning

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Emissions Data

Daily Report for 07/07/2001

Time	Kiln SO2 SO2 ppm Avg.	Kiln NOx NOx ppm Avg.	Kiln THC THC ppm Avg.	Kiln Flow ACFM Avg.	Kiln Flow Flow SCFM Avg.	Kiln Flow Flow DSCFM Avg.	Kiln Temp. Deg. F Avg.	Coal Mill Temp. Deg. F Avg.
01:00	0.10	257.47	18.25	169720	117696	100044	265	178
02:00	0.09	237.87	17.79	167408	127036	107980	265	178
03:00	0.09	197.91	23.09	172724	135884	115506	264	179
04:00	0.10	177.33	31.48	181112	149880	127400	257	178
05:00	0.23	127.38	18.43	217396	188384	160124	238	177
06:00	0.48	109.44	9.47	238772	192152	163328	209	177
07:00	0.63	118.72	8.04	242548	191200	162520	205	177
08:00	0.58	79.68	17.54	244880	195888	166500	213	177
09:00	0.58	72.33	29.23	241896	185448	157628	223	178
10:00	0.73	84.00	23.41	239684	185380	157572	224	179
11:00	0.98	64.34	23.62	239460	189204	160824	222	180
12:00	1.41	70.00	20.45	238408	187388	159284	215	179
13:00	1.75	71.52	19.26	237708	190904	162268	215	177
14:00	1.84	75.88	19.21	239444	186156	158228	219	178
15:00	1.76	101.94	9.13	238560	186140	158220	218	177
16:00	1.94	108.83	10.06	239712	189496	161072	214	177
17:00	1.48	129.18	9.62	239704	188724	160416	214	176
18:00	2.10	123.68	11.13	238144	182596	155204	217	177
19:00	2.79	140.81	11.23	238464	188372	160112	218	177
20:00	2.14	129.16	11.26	241220	186452	158484	219	177
21:00	2.20	110.76	11.54	240772	187664	159516	221	174
22:00	1.43	111.40	8.54	242364	189820	161344	217	173
23:00	1.80	107.85	9.44	240664	187232	159144	218	173
24:00	1.65	106.65	9.88	241272	187016	158964	216	172
Average	1.20	121.00	15.90	228002	179005	152153	225	177
Maximum	2.79	257.00	31.50	244880	195888	166500	265	180
Minimum	0.09	64.00	8.00	167408	117696	100044	205	172
Rolling	1.72	149.00	8.00	157766	124911	106174	200	142
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0	0
OC	0	0	0	0	0	0	0	0
CAL	0	0	0	0	0	0	0	0
Bad Per	0	0	0	0	0	0	0	0
MUT %	98.81	98.81	98.21	99.40	100.00	100.00	99.40	99.40
MDT Per	2	2	3	1	0	0	1	1

Key:
 U, UD User Disable F, IF Instrument Failure C, Cal Calibration
 R, OC Out of Control N, ND No Data M, MNR Monitoring Not Required
 V, Valid Valid Data W, Warning Drift Warning

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 07/08/2001

Time	Clinker Prod. Tons/Hr. Avg. T7	Kiln SO2 SO2 Lbs./Hr. Avg T11	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	106.24	4.46	ND	154.55	1.45	13.06	ND
02:00	107.52	4.02	ND	152.82	1.42	12.44	ND
03:00	108.80	3.17	ND	130.51	1.20	12.41	ND
04:00	108.80	2.81	ND	125.46	1.15	12.36	ND
05:00	108.80	2.67	ND	109.55	1.01	13.15	ND
06:00	108.80	3.17	ND	137.97	1.27	12.34	ND
07:00	108.80	3.09	ND	118.62	1.09	13.02	ND
08:00	108.80	2.91	ND	87.96	0.81	16.10	ND
09:00	108.80	2.23	ND	76.68	0.70	18.20	ND
10:00	108.80	2.02	ND	118.76	1.09	15.06	ND
11:00	108.80	1.93	ND	130.41	1.20	14.92	ND
12:00	108.80	1.08	ND	101.01	0.93	18.28	ND
13:00	108.80	2.34	ND	73.49	0.68	33.45	ND
14:00	108.80	2.83	ND	119.32	1.10	22.14	ND
15:00	108.80	2.70	ND	127.29	1.17	27.86	ND
16:00	108.80	2.33	ND	145.28	1.34	50.25	ND
17:00	108.80	1.99	ND	106.41	0.98	48.70	ND
18:00	108.80	1.51	ND	67.63	0.62	41.80	ND
19:00	108.80	1.69	ND	113.94	1.05	10.90	ND
20:00	108.80	2.65	ND	145.15	1.33	10.77	ND
21:00	108.80	1.69	ND	129.66	1.19	10.42	ND
22:00	108.80	1.02	ND	79.46	0.73	18.11	ND
23:00	108.80	0.69	ND	80.20	0.74	28.34	ND
24:00	108.80	1.75	ND	118.46	1.09	20.53	ND
Total	2607.30	56.70	INS	2750.59	25.34	494.60	INS
Average	108.60	2.40	INS	114.61	1.06	20.60	INS
Maximum	108.80	4.50	INS	154.55	1.45	50.30	INS
Minimum	106.20	0.70	INS	67.63	0.62	10.40	INS
Rolling	102.50	1.50	MNR	142.58	1.54	9.00	MNR
Excess		0	0	0	0	0	0
Uptm %	100.00	100.00	0.00	100.00	100.00	100.00	0.00
# Per	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0
ND	0	0	24	0	0	0	24
OC		0	0	0	0	0	0
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	100.00	98.96	0.00	98.89	98.96	98.44	0.00
MDT Per	0	2	192	2	2	3	192

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Emissions Data

Daily Report for 07/08/2001

Time	Kiln SO2 SO2 ppm Avg.	Kiln NOx NOx ppm Avg.	Kiln THC THC ppm Avg.	Kiln Flow ACFM Avg.	Kiln Flow Flow SCFM Avg.	Kiln Flow DSCFM Avg.	Kiln Temp. Deg. F Avg.	Coal Mill Temp. Deg. F Avg.
01:00	2.70	130.39	9.78	244264	194192	165060	207	172
02:00	2.42	128.29	9.25	246448	199180	169300	209	172
03:00	1.90	108.59	9.16	246172	198252	168512	203	172
04:00	1.68	104.41	9.13	246600	200032	170024	204	172
05:00	1.60	91.47	9.74	245372	194756	165540	203	172
06:00	1.91	115.27	9.15	245252	196716	167208	203	173
07:00	1.85	98.98	9.64	247312	193904	164816	208	173
08:00	1.75	73.93	12.02	247164	193580	164544	213	173
09:00	1.39	66.42	13.98	243660	188352	160100	223	174
10:00	1.25	102.08	11.48	241640	193292	164300	212	175
11:00	1.19	115.70	11.68	236716	133624	113584	212	175
12:00	0.72	107.75	16.50	215780	183600	156060	250	177
13:00	1.46	63.64	25.67	239876	191600	162860	212	176
14:00	1.74	101.83	16.76	241068	190024	161520	206	177
15:00	1.65	108.28	21.00	241952	198820	168996	206	175
16:00	1.43	124.19	38.13	240764	191324	162628	206	175
17:00	1.20	88.85	36.02	245636	198104	168388	203	170
18:00	0.89	55.55	30.46	248108	199516	169588	199	170
19:00	1.01	95.59	8.11	247088	193364	164360	211	172
20:00	1.60	121.57	8.01	247912	196620	167124	212	173
21:00	1.01	107.95	7.69	248172	198248	168508	208	174
22:00	0.69	80.01	17.74	215076	125608	106766	239	174
23:00	0.54	93.28	30.00	195584	177328	150724	267	173
24:00	1.11	105.14	16.25	237040	187756	159588	221	174
Average	1.45	100.00	16.10	239777	188241	160004	214	173
Maximum	2.70	130.00	38.10	248172	200032	170024	267	177
Minimum	0.54	56.00	7.70	195584	125608	106766	199	170
Rolling	1.69	147.00	8.40	160387	127041	107984	199	143
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0	0
OC	0	0	0	0	0	0	0	0
CAL	0	0	0	0	0	0	0	0
Bad Per	0	0	0	0	0	0	0	0
MUT %	98.96	98.96	98.44	99.48	100.00	100.00	99.48	99.48
MDT Per	2	2	3	1	0	0	1	1

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 07/09/2001

Time	Clinker Prod. Tons/Hr. Avg. T7	Kiln SO2 SO2 Lbs./Hr. Avg T11	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	108.80	2.02	ND	81.01	0.74	31.01	ND
02:00	108.80	2.48	ND	112.28	1.03	16.45	ND
03:00	108.80	0.82	ND	197.33	1.81	16.46	ND
04:00	108.80	2.00	ND	138.07	1.27	20.22	ND
05:00	108.80	1.80	ND	157.53	1.45	19.04	ND
06:00	108.80	2.10	ND	154.43	1.42	19.28	ND
07:00	108.80	1.19	ND	240.09	2.21	12.90	ND
08:00	108.80	0.38	ND	251.41	2.31	9.87	ND
09:00	108.80	0.44	ND	252.27	2.32	9.02	ND
10:00	108.80	0.70	ND	258.00	2.37	9.53	ND
11:00	108.80	1.11	ND	250.42	2.30	10.32	ND
12:00	108.80	1.35	ND	236.59	2.17	1.89	ND
13:00	108.80	2.28	ND	251.52	2.31	3.71	ND
14:00	108.80	1.30	ND	236.35	2.17	2.13	ND
15:00	108.80	0.89	ND	240.10	2.21	1.33	ND
16:00	108.80	1.38	ND	255.22	2.35	2.99	ND
17:00	108.80	1.39	ND	255.02	2.34	4.06	ND
18:00	108.80	0.93	ND	271.44X	2.49	7.32	ND
19:00	108.80	1.02	ND	160.75	1.48	30.00	ND
20:00	108.80	0.76	ND	163.35	1.50	22.56	ND
21:00	108.80	0.60	ND	211.05	1.94	19.49	ND
22:00	108.80	0.14	ND	184.57	1.70	22.79	ND
23:00	108.80	0.41	ND	134.43	1.24	37.16	ND
24:00	108.80	1.21	ND	167.20	1.54	22.19	ND
Total	2611.20	28.70	INS	4860.43	44.67	351.80	INS
Average	108.80	1.20	INS	202.52	1.86	14.70	INS
Maximum	108.80	2.50	INS	271.44	2.49	37.20	INS
Minimum	108.80	0.10	INS	81.01	0.74	1.30	INS
Rolling	102.60	1.40	MNR	142.25	1.57	9.40	MNR
Excess		0	0	1	0	0	0
Uptm %	100.00	100.00	0.00	100.00	100.00	100.00	0.00
# Per	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0
ND	0	0	24	0	0	0	24
OC		0	0	0	0	0	0
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	100.00	99.07	0.00	99.02	99.07	98.61	0.00
MDT Per	0	2	216	2	2	3	216

Key:
 U, UD User Disable F, IF Instrument Failure C, Cal Calibration
 R, OC Out of Control N, ND No Data M, MNR Monitoring Not Required
 V, Valid Valid Data W, Warning Drift Warning

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Emissions Data

Daily Report for 07/09/2001

Time	Kiln SO2 SO2 ppm Avg.	Kiln NOx NOx ppm Avg.	Kiln THC THC ppm Avg.	Kiln Flow ACFM Avg.	Kiln Flow Flow SCFM Avg.	Kiln Flow DSCFM Avg.	Kiln Temp. Deg. F Avg.	Coal Mill Temp. Deg. F Avg.
01:00	1.26	70.43	23.87	240804	189568	161132	216	173
02:00	1.54	107.42	13.13	234688	135884	115504	219	175
03:00	0.63	218.93	16.08	208028	181004	153852	271	175
04:00	1.27	121.84	15.89	241212	186736	158728	231	175
05:00	1.11	135.72	14.54	245232	194216	165084	223	175
06:00	1.30	133.55	14.78	244552	191904	163116	224	174
07:00	0.74	208.76	10.00	244168	187900	159716	228	168
08:00	0.24	219.06	7.63	241472	193112	164144	221	172
09:00	0.29	228.16	7.23	231188	183484	155960	215	176
10:00	0.47	241.37	7.91	220672	168256	143020	209	179
11:00	0.73	227.12	8.33	227528	188984	160640	207	178
12:00	0.84	205.67	1.46	237892	190000	161496	210	177
13:00	1.49	228.87	3.00	226724	187528	159400	207	179
14:00	0.87	220.25	1.76	220824	185732	157868	207	180
15:00	0.61	227.05	1.12	216800	166756	141744	204	180
16:00	0.91	235.07	2.44	224712	178308	151560	210	180
17:00	0.91	233.82	3.30	227088	176804	150284	214	180
18:00	0.66	282.35	7.14	206756	124748	106036	231	179
19:00	0.92	202.23	33.31	179852	127466	108346	271	177
20:00	0.71	211.97	25.98	173308	135812	115442	268	175
21:00	0.54	261.88	21.45	180164	136280	115838	264	173
22:00	0.12	227.69	24.34	182724	162608	138216	261	173
23:00	0.27	134.67	30.84	220556	186348	158392	233	173
24:00	0.74	143.30	16.96	240288	195412	166096	207	173
Average	0.80	197.00	13.00	221551	173119	147151	227	176
Maximum	1.54	282.00	33.30	245232	195412	166096	271	180
Minimum	0.12	70.00	1.10	173308	124748	106036	204	168
Rolling	1.63	148.00	8.90	160661	127403	108292	200	144
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0	0
OC	0	0	0	0	0	0	0	0
CAL	0	0	0	0	0	0	0	0
Bad Per	1	0	0	0	0	0	0	0
MUT %	99.07	99.07	98.61	99.54	100.00	100.00	99.54	99.54
MDT Per	2	2	3	1	0	0	1	1

Key: U, UD User Disable F, IF Instrument Failure C, Cal Calibration
R, OC Out of Control N, ND No Data M, MNR Monitoring Not Required
V, Valid Valid Data W, Warning Drift Warning

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 07/10/2001

Time	Clinker Prod. Tons/Hr. Avg. T7	Kiln SO2 SO2 Lbs./Hr. Avg T11	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	108.80	2.22	ND	192.05	1.77	13.93	ND
02:00	108.80	1.17	ND	187.59	1.72	16.63	ND
03:00	108.80	0.84	ND	161.03	1.48	26.12	ND
04:00	108.80	1.08	ND	190.73	1.75	18.66	ND
05:00	108.80	0.39	ND	88.80	0.82	60.90	ND
06:00	108.80	1.00	ND	83.11	0.76	54.67	ND
07:00	108.80	1.14	ND	117.34	1.08	36.06	ND
08:00	108.80	1.09	ND	151.33	1.39	21.77	ND
09:00	108.80	0.50	ND	70.42	0.65	53.25	ND
10:00	108.80	0.64	ND	134.27	1.23	15.44	ND
11:00	108.80	0.88	ND	114.01	1.05	26.29	ND
12:00	108.80	0.51	ND	90.47	0.83	47.57	ND
13:00	108.80	0.82	ND	61.63	0.57	52.73	ND
14:00	108.80	1.17	ND	155.99	1.43	19.65	ND
15:00	108.80	0.86	ND	99.51	0.91	45.02	ND
16:00	108.80	5.76	ND	103.23	0.95	4.79	ND
17:00	108.80	0.21	ND	5.74	0.05	0.06	ND
18:00	108.80	0.05	ND	4.25	0.04	0.06	ND
19:00	108.80	0.10	ND	2.67	0.02	0.06	ND
20:00	108.80	20.35	ND	29.60	0.27	3.12	ND
21:00	108.80	2.96	ND	143.99	1.32	9.60	ND
22:00	108.80	0.15	ND	231.86	2.13	13.82	ND
23:00	108.80	0.61	ND	124.17	1.14	25.40	ND
24:00	108.80	1.07	ND	154.48	1.42	15.18	ND
Total	2611.20	45.70	INS	2698.27	24.78	580.90	INS
Average	108.80	1.90	INS	112.43	1.03	24.20	INS
Maximum	108.80	20.40	INS	231.86	2.13	60.90	INS
Minimum	108.80	0.00	INS	2.67	0.02	0.10	INS
Rolling	102.80	1.50	MNR	145.97	1.52	10.40	MNR
Excess		0	0	0	0	0	0
Uptm %	100.00	100.00	0.00	100.00	100.00	100.00	0.00
# Per	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0
ND	0	0	24	0	0	0	24
OC		0	0	0	0	0	0
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	100.00	99.17	0.00	99.12	99.17	98.75	0.00
MDT Per	0	2	240	2	2	3	240

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Emissions Data

Daily Report for 07/10/2001

Time	Kiln SO2 SO2 ppm Avg.	Kiln NOx NOx ppm Avg.	Kiln THC THC ppm Avg.	Kiln Flow ACFM Avg.	Kiln Flow Flow SCFM Avg.	Kiln Flow Flow DSCFM Avg.	Kiln Temp. Deg. F Avg.	Coal Mill Temp. Deg. F Avg.
01:00	1.36	163.56	10.53	239744	188044	159836	201	172
02:00	0.71	159.53	12.54	240616	191604	162864	202	173
03:00	0.52	137.65	19.79	242232	189600	161160	210	174
04:00	0.66	163.02	14.18	241212	188028	159824	208	173
05:00	0.24	76.21	46.26	243180	191776	163004	215	173
06:00	0.61	71.10	41.50	241916	188748	160436	210	173
07:00	0.70	99.31	27.05	245400	189640	161192	210	174
08:00	0.68	130.15	16.61	242208	187140	159068	215	174
09:00	0.32	62.52	41.94	238416	188412	160148	225	173
10:00	0.40	117.72	11.99	237116	190272	161732	212	174
11:00	0.55	99.75	20.35	237364	188652	160356	212	177
12:00	0.33	80.84	37.84	233452	186840	158812	216	179
13:00	0.52	54.45	41.37	235952	185060	157300	215	181
14:00	0.74	137.69	15.38	236300	188656	160356	215	174
15:00	0.54	87.53	35.14	237372	188536	160252	216	171
16:00	10.40	97.23	3.78	186752	55392	47084	209	163
17:00	0.41	15.59	0.14	77460	66110	56194	219	100
18:00	0.09	11.93	0.14	74406	61561	52327	223	79
19:00	0.19	7.43	0.14	75132	48828	41504	220	83
20:00	30.98	50.37	4.81	107740	98054	83344	232	145
21:00	3.26	207.74	12.28	153032	123878	105294	260	174
22:00	0.12	257.09	13.50	198152	165352	140552	248	175
23:00	0.39	113.75	20.46	230588	183328	155832	220	174
24:00	0.68	149.47	12.28	229208	141576	120340	227	173
Average	2.31	106.00	19.20	205206	157295	133700	218	162
Maximum	30.98	257.00	46.30	245400	191776	163004	260	181
Minimum	0.09	7.00	0.10	74406	48828	41504	201	79
Rolling	1.69	148.00	9.60	164771	130404	110843	200	147
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0	0
OC	0	0	0	0	0	0	0	0
CAL	0	0	0	0	0	0	0	0
Bad Per	0	0	0	0	0	0	0	0
MUT %	99.17	99.17	98.75	99.58	100.00	100.00	99.58	99.58
MDT Per	2	2	3	1	0	0	1	1

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 07/11/2001

Time	Clinker Prod. Tons/Hr. Avg. T7	Kiln SO2 SO2 Lbs./Hr. Avg T11	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	108.80	1.97	ND	255.40	2.35	8.62	ND
02:00	108.80	4.15	ND	295.55X	2.72	10.05	ND
03:00	108.80	3.27	ND	340.77X	3.13	10.39	ND
04:00	108.80	4.12	ND	327.27X	3.01	8.28	ND
05:00	108.80	4.29	ND	304.59X	2.80	10.20	ND
06:00	108.80	2.64	ND	304.75X	2.80	11.18	ND
07:00	108.80	0.39	ND	313.41X	2.88	11.20	ND
08:00	108.80	0.10	ND	216.54	1.99	22.00	ND
09:00	108.80	27.50	ND	55.15	0.51	6.29	ND
10:00	108.80	23.80	ND	67.43	0.62	4.03	ND
11:00	108.80	19.17	ND	58.62	0.54	13.43	ND
12:00	108.80	3.53	ND	82.14	0.75	9.86	ND
13:00	108.80	3.42	ND	63.49	0.58	21.75	ND
14:00	108.80	0.09	ND	107.73	0.99	26.08	ND
15:00	108.80	0.10	ND	150.63	1.38	28.55	ND
16:00	108.80	0.09	ND	101.17	0.93	41.06	ND
17:00	108.80	0.16	ND	131.32	1.21	39.67	ND
18:00	108.80	0.25	ND	170.38	1.57	23.78	ND
19:00	108.80	0.85	ND	152.44	1.40	26.25	ND
20:00	108.80	0.57	ND	200.39	1.84	16.17	ND
21:00	108.80	1.56	ND	146.49	1.35	14.83	ND
22:00	108.80	0.25	ND	156.00	1.43	28.53	ND
23:00	108.80	0.16	ND	68.41	0.63	42.32	ND
24:00	108.80	0.15	ND	65.42	0.60	42.30	ND
Total	2611.20	102.90	INS	4135.49	38.01	477.00	INS
Average	108.80	4.30	INS	172.31	1.58	19.90	INS
Maximum	108.80	27.50	INS	340.77	3.13	42.30	INS
Minimum	108.80	0.10	INS	55.15	0.51	4.00	INS
Rolling	103.00	1.60	MNR	151.70	1.53	10.70	MNR
Excess		0	0	6	0	0	0
Uptm %	100.00	100.00	0.00	100.00	100.00	100.00	0.00
# Per	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0
ND	0	0	24	0	0	0	24
OC		0	0	0	0	0	0
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	100.00	99.24	0.00	99.21	99.24	98.86	0.00
MDT Per	0	2	264	2	2	3	264

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Emissions Data

Daily Report for 07/11/2001

Time	Kiln SO2 SO2 ppm Avg.	Kiln NOx NOx ppm Avg.	Kiln THC THC ppm Avg.	Kiln Flow ACFM Avg.	Kiln Flow Flow SCFM Avg.	Kiln Flow Flow DSCFM Avg.	Kiln Temp. Deg. F Avg.	Coal Mill Temp. Deg. F Avg.
01:00	1.68	306.44	9.18	195256	142896	121462	299	173
02:00	3.68	362.90	10.96	191132	140320	119270	300	174
03:00	2.81	406.55	10.99	196576	119360	101456	300	174
04:00	3.39	374.17	8.38	205724	148176	125950	300	177
05:00	3.76	372.14	11.05	192376	142024	120722	300	176
06:00	2.26	364.74	11.89	195284	131380	111674	297	175
07:00	0.34	384.72	12.13	187104	135068	114810	279	176
08:00	0.09	265.70	24.28	177472	130742	111132	248	177
09:00	68.30	97.01	9.85	89150	51692	43939	231	181
10:00	56.28	118.05	6.21	98974	103810	88240	232	181
11:00	26.79	103.09	21.83	117822	84414	71752	255	179
12:00	4.65	139.55	14.96	129630	88016	74814	260	178
13:00	4.06	102.81	30.96	137308	103364	87858	259	168
14:00	0.09	154.57	34.22	152976	122458	104088	262	168
15:00	0.09	204.64	34.58	163648	118936	101094	261	165
16:00	0.09	136.54	49.20	165400	127218	108138	263	170
17:00	0.13	156.21	41.20	185624	153896	130810	249	168
18:00	0.19	179.13	22.19	207244	173936	147844	245	172
19:00	0.71	186.27	27.35	187000	150732	128122	262	174
20:00	0.39	200.28	14.20	222036	184176	156544	250	175
21:00	0.97	136.73	11.96	235272	130414	110854	222	175
22:00	0.24	201.16	33.33	174348	126364	107410	275	175
23:00	0.15	91.15	49.97	170108	126310	107364	273	174
24:00	0.15	87.23	50.00	169940	129036	109682	273	174
Average	7.55	214.00	23.00	172809	127697	108543	266	174
Maximum	68.30	407.00	50.00	235272	184176	156544	300	181
Minimum	0.09	87.00	6.20	89150	51692	43939	222	165
Rolling	1.87	158.00	10.20	169557	133897	113812	206	151
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0	0
OC	0	0	0	0	0	0	0	0
CAL	0	0	0	0	0	0	0	0
Bad Per	0	0	0	0	0	0	0	0
MUT %	99.24	99.24	98.86	99.62	100.00	100.00	99.62	99.62
MDT Per	2	2	3	1	0	0	1	1

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

**Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Mass Emissions Report**

Daily Report for 07/12/2001

Time	Clinker Prod. Tons/Hr. Avg. T7	Kiln SO2 SO2 Lbs./Hr. Avg T11	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	108.80	100.22	ND	50.14	0.46	50.48	ND
02:00	108.80	28.82	ND	74.43	0.68	36.33	ND
03:00	108.80	2.38	ND	172.77	1.59	18.64	ND
04:00	108.80	1.53	ND	101.82	0.94	52.69	ND
05:00	108.80	2.25	ND	129.84	1.19	15.89	ND
06:00	108.80	0.94	ND	187.95	1.73	19.91	ND
07:00	108.80	1.39	ND	145.01	1.33	29.72	ND
08:00	108.80	1.02	ND	261.58	2.40	9.26	ND
09:00	108.80	1.23	ND	278.09X	2.56	7.35	ND
10:00	108.80	1.04	ND	218.92	2.01	12.34	ND
11:00	108.80	0.54	ND	208.49	1.92	15.84	ND
12:00	108.80	0.62	ND	160.61	1.48	18.73	ND
13:00	108.80	0.45	ND	150.57	1.38	17.03	ND
14:00	108.80	0.51	ND	111.67	1.03	20.10	ND
15:00	108.80	0.73	ND	162.60	1.49	4.72	ND
16:00	108.80	0.97	ND	182.75	1.68	5.66	ND
17:00	108.80	0.37	ND	195.50	1.80	21.19	ND
18:00	108.80	0.28	ND	227.14	2.09	21.10	ND
19:00	108.80	5.75	ND	229.35	2.11	21.81	ND
20:00	108.80	0.36	ND	238.04	2.19	14.28	ND
21:00	108.80	0.18	ND	284.98X	2.62	13.07	ND
22:00	108.80	0.17	ND	263.01	2.42	12.78	ND
23:00	108.80	0.12	ND	294.33X	2.71	12.21	ND
24:00	108.80	0.16	ND	295.74X	2.72	16.05	ND
Total	2611.20	152.00	INS	4625.33	42.53	467.00	INS
Average	108.80	6.30	INS	192.72	1.77	19.50	INS
Maximum	108.80	100.20	INS	295.74	2.72	52.70	INS
Minimum	108.80	0.10	INS	50.14	0.46	4.70	INS
Rolling	103.20	1.70	MNR	158.10	1.55	11.50	MNR
Excess		0	0	4	0	0	0
Uptm %	100.00	100.00	0.00	100.00	100.00	100.00	0.00
# Per	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0
ND	0	0	24	0	0	0	24
OC		0	0	0	0	0	0
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MJT %	100.00	99.31	0.00	99.28	99.31	98.96	0.00
MDT Per	0	2	288	2	2	3	288

Key:
 U, UD User Disable F, IF Instrument Failure C, Cal Calibration
 R, OC Out of Control N, ND No Data M, MNR Monitoring Not Required
 V, Valid Valid Data W, Warning Drift Warning

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Emissions Data

Daily Report for 07/12/2001

Time	Kiln SO2 SO2 ppm Avg.	Kiln NOx NOx ppm Avg.	Kiln THC THC ppm Avg.	Kiln Flow ACFM Avg.	Kiln Flow Flow SCFM Avg.	Kiln Flow DSCFM Avg.	Kiln Temp. Deg. F Avg.	Coal Mill Temp. Deg. F Avg.
01:00	75.85	57.99	50.00	197852	150276	127736	256	175
02:00	21.88	77.72	33.80	209408	157464	133840	248	175
03:00	1.53	155.46	14.81	231196	186740	158724	214	175
04:00	0.96	89.09	40.89	235256	192060	163252	206	175
05:00	1.40	112.62	12.23	236312	188384	160128	203	175
06:00	0.65	202.50	18.31	211000	157880	134196	244	176
07:00	0.93	134.63	25.15	226692	183188	155708	222	167
08:00	0.63	226.18	7.10	238080	188168	159944	206	173
09:00	0.77	242.57	5.68	236388	191964	163172	208	178
10:00	0.66	191.64	9.58	236624	186896	158860	210	178
11:00	0.34	182.09	12.29	236400	190784	162168	209	179
12:00	0.39	139.52	14.46	238460	188856	160528	211	177
13:00	0.28	131.42	13.19	238340	189992	161496	214	178
14:00	0.32	96.91	15.47	237380	189296	160904	207	178
15:00	0.46	140.82	3.63	237872	191692	162936	207	177
16:00	0.60	157.11	4.33	239592	163328	138828	206	176
17:00	0.30	225.38	21.85	195776	138544	117764	267	176
18:00	0.23	264.44	21.77	193660	139976	118980	270	175
19:00	4.65	267.45	22.37	191584	148768	126454	261	173
20:00	0.30	274.30	14.58	191932	141800	120530	256	174
21:00	0.14	320.10	13.03	195136	138364	117612	250	175
22:00	0.13	290.65	12.53	195692	145248	123462	240	173
23:00	0.10	325.13	11.95	194744	145632	123786	236	171
24:00	0.13	324.78	15.61	195140	150968	128322	233	170
Average	4.73	193.00	17.30	218355	168595	143305	229	175
Maximum	75.85	325.00	50.00	239592	192060	163252	270	179
Minimum	0.10	58.00	3.60	191584	138364	117612	203	167
Rolling	1.84	161.00	10.60	176224	138812	117989	209	153
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0	0
OC	0	0	0	0	0	0	0	0
CAL	0	0	0	0	0	0	0	0
Bad Per	0	0	0	0	0	0	0	0
MUT %	99.31	99.31	98.96	99.65	100.00	100.00	99.65	99.65
MDT Per	2	2	3	1	0	0	1	1

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 07/13/2001

Time	Clinker Prod. Tons/Hr. Avg. T7	Kiln SO2 SO2 Lbs./Hr. Avg T11	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	108.80	0.45	ND	265.12	2.44	11.18	ND
02:00	108.80	0.12	ND	253.93	2.33	20.48	ND
03:00	108.80	0.15	ND	230.88	2.12	25.25	ND
04:00	108.80	0.12	ND	221.40	2.04	25.92	ND
05:00	108.80	0.11	ND	236.45	2.17	23.91	ND
06:00	108.80	0.11	ND	187.16	1.72	32.10	ND
07:00	108.80	0.26	ND	246.43	2.26	11.10	ND
08:00	108.80	0.55	ND	180.60	1.66	15.14	ND
09:00	108.80	1.28	ND	128.55	1.18	23.66	ND
10:00	108.80	1.11	ND	130.58	1.20	25.72	ND
11:00	108.80	1.08	ND	176.04	1.62	13.82	ND
12:00	108.80	2.52	ND	48.60	0.45	6.87	ND
13:00	108.80	8.53	ND	45.73	0.42	8.56	ND
14:00	108.80	19.39	ND	61.06	0.56	18.40	ND
15:00	108.80	0.13	ND	91.61	0.84	18.56	ND
16:00	108.80	0.09	ND	95.98	0.88	27.49	ND
17:00	108.80	0.25	ND	151.28	1.39	25.75	ND
18:00	108.80	1.09	ND	252.62	2.32	4.71	ND
19:00	108.80	0.69	ND	218.52	2.01	3.50	ND
20:00	108.80	1.89	ND	191.99	1.76	7.37	ND
21:00	108.80	1.98	ND	169.73	1.56	6.06	ND
22:00	108.80	1.22	ND	182.05	1.67	3.22	ND
23:00	108.80	0.10	ND	170.35	1.57	8.13	ND
24:00	108.80	0.10	ND	103.20	0.95	17.21	ND
Total	2611.20	43.30	INS	4039.86	37.12	384.10	INS
Average	108.80	1.80	INS	168.33	1.55	16.00	INS
Maximum	108.80	19.40	INS	265.12	2.44	32.10	INS
Minimum	108.80	0.10	INS	45.73	0.42	3.20	INS
Rolling	103.50	1.70	MNR	163.70	1.55	12.10	MNR
Excess		0	0	0	0	0	0
Uptm %	100.00	100.00	0.00	100.00	100.00	100.00	0.00
# Per	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0
ND	0	0	24	0	0	0	24
OC		0	0	0	0	0	0
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	100.00	99.36	0.00	99.33	99.36	99.04	0.00
MDT Per	0	2	312	2	2	3	312

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Emissions Data

Daily Report for 07/13/2001

Time	Kiln SO2 SO2 ppm Avg.	Kiln NOx NOx ppm Avg.	Kiln THC THC ppm Avg.	Kiln Flow ACFM Avg.	Kiln Flow Flow SCFM Avg.	Kiln Flow Flow DSCFM Avg.	Kiln Temp. Deg. F Avg.	Coal Mill Temp. Deg. F Avg.
01:00	0.36	291.60	10.90	194712	149472	127048	234	170
02:00	0.09	278.71	19.93	194496	148376	126122	231	171
03:00	0.12	254.23	24.64	194364	148336	126088	233	172
04:00	0.09	243.13	25.19	194672	149252	126868	231	171
05:00	0.09	264.27	23.70	191344	145228	123446	232	172
06:00	0.09	219.05	31.58	185936	158732	134924	226	165
07:00	0.18	236.46	10.97	220580	177800	151132	220	166
08:00	0.36	161.97	12.05	231048	185728	157864	211	170
09:00	0.81	113.35	18.43	234636	185252	157464	209	172
10:00	0.71	116.76	20.38	231836	183512	155984	211	173
11:00	0.71	163.10	11.21	225904	139624	118680	220	174
12:00	2.96	80.05	9.91	135028	98988	84140	248	157
13:00	10.13	76.78	12.75	131184	106070	90160	253	154
14:00	21.36	94.06	24.93	142744	109658	93208	251	158
15:00	0.14	136.13	24.31	148656	108524	92244	254	165
16:00	0.09	131.91	34.11	159684	149760	127296	256	164
17:00	0.18	164.10	26.39	198932	171824	146048	251	165
18:00	0.73	236.72	3.91	227376	172832	146912	229	168
19:00	0.46	203.25	2.88	228092	166188	141256	227	167
20:00	1.25	176.69	5.93	231912	186936	158896	229	168
21:00	1.27	151.66	4.80	232336	190340	161788	211	166
22:00	0.77	160.45	2.54	233296	155168	131896	206	167
23:00	0.09	222.66	9.40	172212	123452	104930	271	164
24:00	0.09	141.71	21.48	164096	139352	118448	268	161
Average	1.80	180.00	16.30	196045	152100	129285	234	167
Maximum	21.36	292.00	34.10	234636	190340	161788	271	174
Minimum	0.09	77.00	2.50	131184	98988	84140	206	154
Rolling	1.99	167.00	11.30	179270	140643	119546	215	156
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0	0
OC	0	0	0	0	0	0	0	0
CAL	0	0	0	0	0	0	0	0
Bad Per	0	0	0	0	0	0	0	0
MUT %	99.36	99.36	99.04	99.68	100.00	100.00	99.68	99.68
MDT Per	2	2	3	1	0	0	1	1

Key:
 U, UD User Disable F, IF Instrument Failure C, Cal Calibration
 R, OC Out of Control N, ND No Data M, MNR Monitoring Not Required
 V, Valid Valid Data W, Warning Drift Warning

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 07/14/2001

Time	Clinker Prod. Tons/Hr. Avg. T7	Kiln SO2 SO2 Lbs./Hr. Avg T11	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	108.80	0.12	ND	99.46	0.91	16.15	ND
02:00	108.80	0.37	ND	89.60	0.82	11.04	ND
03:00	108.80	0.40	ND	67.76	0.62	20.46	ND
04:00	108.80	0.78	ND	45.81	0.42	34.85	ND
05:00	108.80	34.42	ND	40.88	0.38	10.90	ND
06:00	108.80	26.45	ND	80.19	0.74	17.97	ND
07:00	108.80	9.59	ND	36.34	0.33	4.90	ND
08:00	108.80	16.40	ND	6.58	0.06	0.20	ND
09:00	108.80	0.89	ND	42.95	0.39	0.06	ND
10:00	108.80	6.52	ND	53.28	0.49	3.52	ND
11:00	108.80	14.00	ND	41.98	0.39	3.31	ND
12:00	108.80	16.09	ND	35.99	0.33	6.45	ND
13:00	108.80	17.24	ND	87.77	0.81	20.63	ND
14:00	108.80	8.29	ND	135.86	1.25	23.01	ND
15:00	108.80	0.17	ND	89.69	0.82	22.14	ND
16:00	108.80	0.24	ND	86.04	0.79	23.96	ND
17:00	108.80	0.41	ND	109.97	1.01	34.73	ND
18:00	108.80	0.45	ND	141.45	1.30	33.21	ND
19:00	108.80	0.52	ND	162.31	1.49	24.98	ND
20:00	108.80	0.82	ND	124.51	1.14	30.11	ND
21:00	108.80	1.21	ND	169.92	1.56	15.43	ND
22:00	108.80	1.00	ND	222.03	2.04	13.25	ND
23:00	108.80	0.58	ND	269.97X	2.48	11.62	ND
24:00	108.80	0.68	ND	286.27X	2.63	14.59	ND
Total	2611.20	157.60	INS	2526.61	23.20	397.40	INS
Average	108.80	6.60	INS	105.28	0.97	16.60	INS
Maximum	108.80	34.40	INS	286.27	2.63	34.80	INS
Minimum	108.80	0.10	INS	6.58	0.06	0.10	INS
Rolling	103.70	2.10	MNR	167.21	1.51	12.70	MNR
Excess		0	0	2	0	0	0
Uptm %	100.00	100.00	0.00	100.00	100.00	100.00	0.00
# Per	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0
ND	0	0	24	0	0	0	24
OC		0	0	0	0	0	0
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	100.00	99.40	0.00	99.38	99.40	99.11	0.00
MDT Per	0	2	336	2	2	3	336

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Emissions Data

Daily Report for 07/14/2001

Time	Kiln SO2 SO2 ppm Avg.	Kiln NOx NOx ppm Avg.	Kiln THC THC ppm Avg.	Kiln Flow ACFM Avg.	Kiln Flow Flow SCFM Avg.	Kiln Flow DSCFM Avg.	Kiln Temp. Deg. F Avg.	Coal Mill Temp. Deg. F Avg.
01:00	0.10	111.52	16.06	198528	167736	142572	253	163
02:00	0.25	83.84	9.27	224020	137748	117090	219	161
03:00	0.33	83.42	22.25	187228	140708	119600	271	161
04:00	0.70	63.43	42.85	165708	116782	99264	273	162
05:00	47.13	69.87	16.53	126276	97038	82482	270	160
06:00	29.81	128.26	25.36	140784	104198	88568	271	167
07:00	11.88	63.17	9.93	102122	46288	39344	265	170
08:00	50.16	27.47	0.73	51515	41994	35695	240	170
09:00	2.65	105.53	0.14	76414	82084	69770	239	166
10:00	9.13	106.65	6.19	110646	84104	71488	256	164
11:00	19.68	83.36	5.79	112078	81544	69312	260	168
12:00	20.05	61.46	10.43	130568	101826	86552	266	171
13:00	18.02	126.20	26.74	153544	116374	98916	269	174
14:00	7.88	178.44	26.87	168768	129742	110280	257	175
15:00	0.13	101.67	22.24	192992	158240	134504	240	174
16:00	0.15	79.75	19.90	229728	188328	160072	228	175
17:00	0.25	94.75	26.42	241336	192380	163528	212	174
18:00	0.28	121.99	25.40	240708	190484	161908	212	173
19:00	0.32	141.17	19.23	239544	185248	157460	215	174
20:00	0.52	108.72	23.40	242160	189872	161388	225	175
21:00	0.75	146.95	11.81	242796	189352	160948	219	175
22:00	0.61	188.52	9.98	241832	187100	159036	204	174
23:00	0.36	228.95	8.76	240992	189944	161456	202	174
24:00	0.42	244.90	11.08	239820	187116	159044	204	175
Average	9.23	115.00	16.60	179171	137760	117095	240	170
Maximum	50.16	245.00	42.90	242796	192380	163528	273	175
Minimum	0.10	27.00	0.10	51515	41994	35695	202	160
Rolling	2.37	172.00	11.90	184626	144516	122838	219	159
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0	0
OC	0	0	0	0	0	0	0	0
CAL	0	0	0	0	0	0	0	0
Bad Per	0	0	0	0	0	0	0	0
MUT %	99.40	99.40	99.11	99.70	100.00	100.00	99.70	99.70
MDT Per	2	2	3	1	0	0	1	1

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 07/15/2001

Time	Clinker Prod. Tons/Hr. Avg. T7	Kiln SO2 SO2 Lbs./Hr. Avg T11	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	108.80	0.48	ND	234.35	2.15	25.06	ND
02:00	108.80	0.24	ND	170.42	1.57	29.84	ND
03:00	108.80	0.24	ND	151.91	1.40	34.46	ND
04:00	108.80	0.37	ND	169.16	1.55	21.46	ND
05:00	108.80	0.30	ND	167.05	1.54	16.95	ND
06:00	108.80	0.31	ND	187.16	1.72	17.92	ND
07:00	108.80	0.65	ND	282.74X	2.60	12.21	ND
08:00	108.80	0.51	ND	270.41X	2.49	14.50	ND
09:00	108.80	0.58	ND	185.34	1.70	25.84	ND
10:00	108.80	0.47	ND	165.21	1.52	28.48	ND
11:00	108.80	0.28	ND	171.23	1.57	23.08	ND
12:00	108.80	0.22	ND	130.42	1.20	26.21	ND
13:00	108.80	0.39	ND	182.77	1.68	18.19	ND
14:00	108.80	0.36	ND	201.21	1.85	16.31	ND
15:00	108.80	3.94	ND	179.71	1.65	18.96	ND
16:00	108.80	0.32	ND	148.20	1.36	21.50	ND
17:00	108.80	0.45	ND	207.50	1.91	12.11	ND
18:00	108.80	0.42	ND	243.56	2.24	12.00	ND
19:00	108.80	0.62	ND	280.36X	2.58	11.08	ND
20:00	108.80	0.96	ND	292.70X	2.69	10.11	ND
21:00	108.80	0.77	ND	258.35	2.37	11.14	ND
22:00	108.80	0.97	ND	296.34X	2.72	10.25	ND
23:00	108.80	0.56	ND	285.20X	2.62	10.70	ND
24:00	108.80	0.57	ND	291.94X	2.68	9.93	ND
Total	2611.20	15.10	INS	5153.24	47.36	438.20	INS
Average	108.80	0.60	INS	214.72	1.97	18.30	INS
Maximum	108.80	3.90	INS	296.34	2.72	34.50	INS
Minimum	108.80	0.20	INS	130.42	1.20	9.90	INS
Rolling	103.90	2.10	MNR	174.37	1.54	13.30	MNR
Excess		0	0	7	0	0	0
Uptm %	100.00	100.00	0.00	100.00	100.00	100.00	0.00
# Per	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0
ND	0	0	24	0	0	0	24
OC		0	0	0	0	0	0
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	100.00	99.44	0.00	99.43	99.44	99.17	0.00
MDT Per	0	2	360	2	2	3	360

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

**Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Emissions Data**

Daily Report for 07/15/2001

Time	Kiln SO2 SO2 ppm Avg.	Kiln NOx NOx ppm Avg.	Kiln THC THC ppm Avg.	Kiln Flow ACFM Avg.	Kiln Flow Flow SCFM Avg.	Kiln Flow DSCFM Avg.	Kiln Temp. Deg. F Avg.	Coal Mill Temp. Deg. F Avg.
01:00	0.30	201.43	19.14	240516	189848	161364	210	175
02:00	0.15	146.94	22.84	241208	195540	166208	213	174
03:00	0.15	130.70	26.31	240704	194236	165100	210	174
04:00	0.23	145.32	16.32	238876	187260	159164	204	174
05:00	0.19	144.11	12.95	237856	188612	160320	204	173
06:00	0.19	158.55	13.48	240604	192000	163200	200	174
07:00	0.40	239.71	9.17	240908	194620	165424	201	174
08:00	0.31	229.86	10.94	240132	191024	162368	201	174
09:00	0.36	158.06	19.57	241408	191300	162604	207	175
10:00	0.37	185.38	25.71	205508	125848	106970	245	176
11:00	0.26	221.31	26.51	174896	125986	107088	272	173
12:00	0.19	157.40	27.04	189476	162648	138252	256	173
13:00	0.34	233.25	20.08	180496	120742	102630	260	173
14:00	0.36	276.30	19.84	164196	117788	100116	270	173
15:00	3.86	247.17	22.43	165652	139756	118792	263	174
16:00	0.22	145.51	18.99	216076	181932	154640	228	174
17:00	0.30	188.28	9.75	226788	186328	158380	206	173
18:00	0.27	218.96	9.56	228104	189800	161328	203	173
19:00	0.40	251.23	8.82	229244	183732	156164	205	173
20:00	0.62	263.03	8.06	229064	181724	154464	206	172
21:00	0.50	231.77	8.87	228776	190468	161896	205	172
22:00	0.61	257.68	7.90	234880	186740	158724	201	172
23:00	0.36	250.30	8.32	233744	187332	159228	204	171
24:00	0.36	256.97	7.75	234524	182376	155016	208	172
Average	0.47	206.00	15.80	220985	174485	148310	220	173
Maximum	3.86	276.00	27.00	241408	195540	166208	272	176
Minimum	0.15	131.00	7.70	164196	117788	100116	200	171
Rolling	2.38	178.00	12.50	189981	148322	126073	223	162
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0	0
OC	0	0	0	0	0	0	0	0
CAL	0	0	0	0	0	0	0	0
Bad Per	0	0	0	0	0	0	0	0
MUT %	99.44	99.44	99.17	99.72	100.00	100.00	99.72	99.72
MDT Per	2	2	3	1	0	0	1	1

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 07/16/2001

Time	Clinker Prod. Tons/Hr. Avg. T7	Kiln SO2 SO2 Lbs./Hr. Avg T11	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	108.80	1.01	ND	304.55X	2.80	10.17	ND
02:00	108.80	0.55	ND	297.13X	2.73	10.27	ND
03:00	108.80	0.35	ND	259.55	2.39	11.04	ND
04:00	108.80	0.31	ND	263.59	2.42	9.84	ND
05:00	108.80	0.31	ND	281.59X	2.59	8.67	ND
06:00	108.80	0.29	ND	207.57	1.91	12.68	ND
07:00	108.80	0.45	ND	201.34	1.85	15.02	ND
08:00	108.80	0.49	ND	214.81	1.97	10.00	ND
09:00	89.60	0.29	ND	143.64	1.45	15.54	ND
10:00	89.60	0.21	ND	221.48	2.47	10.60	ND
11:00	89.60	0.22	ND	220.75	2.46	14.36	ND
12:00	89.60	0.73	ND	194.04	2.17	19.93	ND
13:00	89.60	0.95	ND	201.99	2.25	18.65	ND
14:00	89.60	0.73	ND	214.37	2.39	17.97	ND
15:00	89.60	1.12	ND	216.94	2.42	5.38	ND
16:00	89.60	1.17	ND	235.96	2.63	OC	ND
17:00	89.60	0.88	ND	250.18	2.79	7.29	ND
18:00	89.60	0.68	ND	242.27	2.70	6.53	ND
19:00	89.60	ND	ND	ND	ND	ND	ND
20:00	89.60	0.57	ND	233.85	2.61	9.27	ND
21:00	89.60	0.74	ND	221.23	2.47	9.41	ND
22:00	89.60	0.56	ND	180.51	2.01	13.25	ND
23:00	89.60	0.50	ND	180.23	2.01	9.19	ND
24:00	89.60	0.61	ND	135.74	1.51	17.59	ND
Total	2304.00	14.20	INS	5123.31	53.00	276.80	INS
Average	96.00	0.60	INS	222.75	2.30	11.50	INS
Maximum	108.80	1.20	INS	304.55	2.80	19.90	INS
Minimum	89.60	0.20	INS	135.74	1.45	5.40	INS
Rolling	103.70	2.10	MNR	181.76	1.58	13.50	MNR
Excess		0	0	3	0	0	0
Uptm %	100.00	95.83	0.00	95.83	95.83	91.67	0.00
# Per	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0
ND	0	1	24	1	1	1	24
OC		0	0	0	0	1	0
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	100.00	99.22	0.00	99.19	99.22	98.70	0.00
MDT Per	0	3	384	3	3	5	384

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Emissions Data

Daily Report for 07/16/2001

Time	Kiln SO2 SO2 ppm Avg.	Kiln NOx NOx ppm Avg.	Kiln THC THC ppm Avg.	Kiln Flow ACFM Avg.	Kiln Flow Flow SCFM Avg.	Kiln Flow DSCFM Avg.	Kiln Temp. Deg. F Avg.	Coal Mill Temp. Deg. F Avg.
01:00	0.63	266.09	7.86	235296	187076	159012	205	173
02:00	0.34	259.57	7.96	234392	188596	160300	203	173
03:00	0.22	229.16	8.65	231516	186004	158104	202	173
04:00	0.19	230.48	7.63	234372	182268	154932	203	173
05:00	0.20	248.38	6.78	233972	190020	161516	208	172
06:00	0.18	181.39	9.84	235476	181488	154264	206	173
07:00	0.28	176.46	11.40	234324	189224	160840	204	173
08:00	0.31	188.04	7.76	235296	186032	158124	207	173
09:00	0.18	126.12	12.10	234520	189556	161120	207	172
10:00	0.20	288.87	12.11	173992	123852	105270	267	172
11:00	0.18	272.88	15.53	183872	160456	136384	260	174
12:00	0.49	179.76	16.24	224756	182404	155040	212	173
13:00	0.62	182.50	14.88	228544	174112	147992	208	174
14:00	0.47	192.00	14.17	229564	183164	155688	205	175
15:00	0.71	193.12	4.25	232664	184888	157156	211	174
16:00	0.75	210.37	OC	232720	180264	153228	212	173
17:00	0.56	223.19	5.77	233528	182824	155400	214	173
18:00	0.44	214.36	5.09	235420	189668	161220	213	171
19:00	ND	ND	ND	ND	186056	158148	ND	ND
20:00	0.36	205.99	7.24	232228	188152	159928	202	170
21:00	0.47	196.17	7.40	229348	181504	154276	198	169
22:00	0.35	160.50	10.43	229720	180908	153772	201	171
23:00	0.32	159.80	7.22	232748	184848	157120	208	172
24:00	0.39	121.20	13.92	230544	186236	158300	206	172
Average	0.39	205.00	9.40	228027	181233	154047	211	172
Maximum	0.75	289.00	16.20	235476	190020	161516	267	175
Minimum	0.18	121.00	4.20	173992	123852	105270	198	169
Rolling	2.37	184.00	12.40	194659	151675	128923	226	165
Uptm %	95.83	95.83	91.67	95.83	100.00	100.00	95.83	95.83
# Per	24	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0	0
ND	1	1	1	1	0	0	1	1
OC	0	0	1	0	0	0	0	0
CAL	0	0	0	0	0	0	0	0
Bad Per	0	0	0	0	0	0	0	0
MUT %	99.22	99.22	98.70	99.48	100.00	100.00	99.48	99.48
MDT Per	3	3	5	2	0	0	2	2

Key: U, UD User Disable F, IF Instrument Failure C, Cal Calibration
R, OC Out of Control N, ND No Data M, MNR Monitoring Not Required
V, Valid Valid Data W, Warning Drift Warning

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 07/17/2001

Time	Clinker Prod. Tons/Hr. Avg. T7	Kiln SO2 SO2 Lbs./Hr. Avg T11	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	89.60	0.32	ND	127.31	1.42	13.67	ND
02:00	89.60	0.48	ND	133.44	1.49	8.69	ND
03:00	89.60	0.45	ND	152.01	1.70	8.12	ND
04:00	89.60	0.51	ND	183.22	2.04	7.77	ND
05:00	89.60	0.64	ND	157.50	1.76	11.86	ND
06:00	89.60	0.44	ND	90.16	1.01	26.75	ND
07:00	89.60	0.27	ND	121.77	1.36	OC	ND
08:00	89.60	0.34	ND	155.61	1.74	5.32	ND
09:00	89.60	0.17	ND	169.92	1.90	8.96	ND
10:00	89.60	0.34	ND	153.90	1.72	9.88	ND
11:00	89.60	0.26	ND	143.04	1.60	9.01	ND
12:00	89.60	0.44	ND	78.19	0.87	17.53	ND
13:00	89.60	0.62	ND	107.95	1.20	11.31	ND
14:00	89.60	0.82	ND	87.01	0.97	22.75	ND
15:00	89.60	1.28	ND	99.12	1.11	39.06	ND
16:00	89.60	1.10	ND	112.72	1.26	20.85	ND
17:00	89.60	1.06	ND	91.02	1.02	30.91	ND
18:00	89.60	0.88	ND	195.41	2.18	5.38	ND
19:00	89.60	0.90	ND	210.82	2.35	3.26	ND
20:00	89.60	0.64	ND	206.56	2.31	3.55	ND
21:00	89.60	0.46	ND	204.64	2.28	2.29	ND
22:00	89.60	0.81	ND	135.19	1.51	19.45	ND
23:00	89.60	0.77	ND	189.05	2.11	6.97	ND
24:00	89.60	0.28	ND	207.54	2.32	10.96	ND
Total	2150.40	14.20	INS	3513.10	39.23	320.40	INS
Average	89.60	0.60	INS	146.38	1.63	13.30	INS
Maximum	89.60	1.30	INS	210.82	2.35	39.10	INS
Minimum	89.60	0.20	INS	78.19	0.87	2.30	INS
Rolling	104.10	2.10	MNR	186.57	1.59	14.20	MNR
Excess		0	0	0	0	0	0
Uptm %	100.00	100.00	0.00	100.00	100.00	95.83	0.00
# Per	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0
ND	0	0	24	0	0	0	24
OC		0	0	0	0	1	0
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	100.00	99.26	0.00	99.24	99.26	98.53	0.00
MDT Per	0	3	408	3	3	6	408

Key:
 U, UD User Disable F, IF Instrument Failure C, Cal Calibration
 R, OC Out of Control N, ND No Data M, MNR Monitoring Not Required
 V, Valid Valid Data W, Warning Drift Warning

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Emissions Data

Daily Report for 07/17/2001

Time	Kiln SO2 SO2 ppm Avg.	Kiln NOx NOx ppm Avg.	Kiln THC THC ppm Avg.	Kiln Flow ACFM Avg.	Kiln Flow Flow SCFM Avg.	Kiln Flow Flow DSCFM Avg.	Kiln Temp. Deg. F Avg.	Coal Mill Temp. Deg. F Avg.
01:00	0.30	173.15	16.65	165012	144676	122974	256	172
02:00	0.35	133.18	7.69	213908	183664	156108	231	173
03:00	0.30	140.01	6.65	225520	180804	153680	212	173
04:00	0.33	162.95	6.14	229744	188780	160460	201	174
05:00	0.41	140.63	9.39	227828	179132	152260	199	173
06:00	0.28	80.16	21.14	230408	184760	157044	203	173
07:00	0.17	108.17	OC	230276	187740	159572	203	172
08:00	0.22	140.66	4.29	224580	165592	140752	197	172
09:00	0.15	203.85	9.60	183132	116374	98916	249	173
10:00	0.36	227.25	12.91	151496	109866	93388	264	174
11:00	0.28	212.64	11.87	150268	109080	92718	263	174
12:00	0.47	115.99	23.09	150484	109810	93338	263	175
13:00	0.61	147.92	13.14	164748	134024	113922	251	176
14:00	0.61	90.86	21.15	205196	169884	144396	235	177
15:00	0.86	92.80	32.43	222848	174880	148652	216	176
16:00	0.74	105.45	17.33	222800	173040	147080	215	175
17:00	0.70	84.16	25.10	225632	180776	153664	213	175
18:00	0.58	179.57	4.40	226660	178928	152092	215	171
19:00	0.58	189.41	2.60	228848	182780	155364	205	171
20:00	0.41	185.54	2.86	231804	183624	156080	214	171
21:00	0.29	181.30	1.79	230684	182304	154956	201	173
22:00	0.52	120.24	15.30	230488	184064	156452	203	175
23:00	0.48	166.49	5.45	231408	184068	156460	199	174
24:00	0.20	212.49	12.35	202320	151560	128826	218	173
Average	0.42	150.00	12.30	208587	164175	139548	222	174
Maximum	0.86	227.00	32.40	231804	188780	160460	264	177
Minimum	0.15	80.00	1.80	150268	109080	92718	197	171
Rolling	2.34	189.00	13.00	199450	155346	132043	227	167
Uptm %	100.00	100.00	95.83	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0	0
OC	0	0	1	0	0	0	0	0
CAL	0	0	0	0	0	0	0	0
Bad Per	1	0	0	0	0	0	0	0
MUT %	99.26	99.26	98.53	99.51	100.00	100.00	99.51	99.51
MDT Per	3	3	6	2	0	0	2	2

Key: User Disable F, IF Instrument Failure C, Cal Calibration
 U, UD N, ND No Data M, MNR Monitoring Not Required
 R, OC W, Warning Drift Warning

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 07/18/2001

Time	Clinker Prod. Tons/Hr. Avg. T7	Kiln SO2 SO2 Lbs./Hr. Avg T11	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	89.60	0.29	ND	168.94	1.89	14.96	ND
02:00	89.60	0.37	ND	161.51	1.80	23.98	ND
03:00	89.60	0.17	ND	99.98	1.12	42.17	ND
04:00	89.60	0.28	ND	147.63	1.65	20.51	ND
05:00	89.60	0.27	ND	195.44	2.18	5.41	ND
06:00	89.60	5.75	ND	123.28	1.38	7.72	ND
07:00	89.60	0.35	ND	156.56	1.75	OC	ND
08:00	89.60	0.26	ND	140.14	1.56	25.45	ND
09:00	89.60	0.53	ND	115.78	1.29	36.94	ND
10:00	89.60	0.79	ND	128.67	1.44	31.22	ND
11:00	89.60	1.72	ND	153.69	1.72	26.38	ND
12:00	89.60	1.56	ND	200.11	2.23	14.98	ND
13:00	89.60	1.50	ND	184.16	2.06	22.54	ND
14:00	89.60	1.56	ND	176.43	1.97	24.65	ND
15:00	89.60	1.32	ND	174.53	1.95	24.44	ND
16:00	89.60	1.91	ND	192.59	2.15	22.79	ND
17:00	89.60	2.55	ND	169.36	1.89	22.11	ND
18:00	89.60	2.49	ND	198.17	2.21	14.16	ND
19:00	89.60	2.52	ND	215.11	2.40	15.16	ND
20:00	89.60	1.34	ND	167.88	1.87	21.61	ND
21:00	89.60	1.06	ND	128.23	1.43	29.40	ND
22:00	89.60	0.78	ND	127.89	1.43	31.63	ND
23:00	89.60	0.26	ND	146.91	1.64	21.41	ND
24:00	89.60	0.32	ND	180.29	2.01	15.44	ND
Total	2150.40	30.20	INS	3853.28	43.02	531.60	INS
Average	89.60	1.30	INS	160.55	1.79	22.20	INS
Maximum	89.60	5.70	INS	215.11	2.40	42.20	INS
Minimum	89.60	0.20	INS	99.98	1.12	5.40	INS
Rolling	103.70	2.10	MNR	185.06	1.60	14.90	MNR
Excess		0	0	0	0	0	0
Uptm %	100.00	100.00	0.00	100.00	100.00	95.83	0.00
# Per	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0
ND	0	0	24	0	0	0	24
OC		0	0	0	0	1	0
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	100.00	99.31	0.00	99.29	99.31	98.38	0.00
MDT Per	0	3	432	3	3	7	432

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Emissions Data

Daily Report for 07/18/2001

Time	Kiln SO2 SO2 ppm Avg.	Kiln NOx NOx ppm Avg.	Kiln THC THC ppm Avg.	Kiln Flow ACFM Avg.	Kiln Flow Flow SCFM Avg.	Kiln Flow Flow DSCFM Avg.	Kiln Temp. Deg. F Avg.	Coal Mill Temp. Deg. F Avg.
01:00	0.19	157.85	12.05	225288	187980	159780	214	173
02:00	0.24	144.67	19.15	229120	185052	157296	205	174
03:00	0.11	88.63	33.16	232244	186224	158292	206	174
04:00	0.18	131.26	16.21	231624	184220	156588	207	174
05:00	0.17	172.86	4.22	232120	187208	159124	204	173
06:00	5.31	132.81	6.90	201412	170172	144648	236	173
07:00	0.23	142.07	OC	229596	189296	160904	212	174
08:00	0.17	124.63	20.01	231948	176968	150420	207	175
09:00	0.34	104.09	29.47	230196	185404	157592	210	176
10:00	0.51	115.95	24.85	229292	178564	151780	208	178
11:00	1.11	138.16	20.91	229728	187680	159528	208	178
12:00	0.99	176.99	11.74	231652	187368	159260	203	177
13:00	0.96	164.54	17.91	228780	180112	153096	202	174
14:00	1.00	157.14	19.39	230768	186004	158104	204	176
15:00	0.85	155.43	19.42	230080	182368	155008	204	178
16:00	1.22	171.66	18.00	230044	179108	152236	204	178
17:00	1.63	150.54	17.42	231028	182944	155504	204	175
18:00	1.60	176.09	11.18	230884	183364	155860	205	175
19:00	1.62	192.66	12.06	230164	180232	153200	208	173
20:00	0.86	149.62	17.16	230824	184056	156448	207	173
21:00	0.67	113.38	23.03	232640	182896	155460	205	173
22:00	0.50	114.08	24.97	232124	188820	160496	210	173
23:00	0.17	129.40	16.75	231760	190716	162108	201	172
24:00	0.20	159.66	12.15	231044	185256	157468	203	172
Average	0.87	144.00	17.60	229348	183834	156258	207	175
Maximum	5.31	193.00	33.20	232640	190716	162108	236	178
Minimum	0.11	89.00	4.20	201412	170172	144648	201	172
Rolling	2.32	187.00	13.50	202241	157922	134233	224	168
Uptm %	100.00	100.00	95.83	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0	0
OC	0	0	1	0	0	0	0	0
CAL	0	0	0	0	0	0	0	0
Bad Per	0	0	0	0	0	0	0	0
MUT %	99.31	99.31	98.38	99.54	100.00	100.00	99.54	99.54
MDT Per	3	3	7	2	0	0	2	2

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 07/19/2001

Time	Clinker Prod. Tons/Hr. Avg. T7	Kiln SO2 SO2 Lbs./Hr. Avg T11	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	89.60	0.54	ND	155.45	1.73	18.06	ND
02:00	89.60	0.73	ND	179.50	2.00	16.31	ND
03:00	89.60	0.44	ND	155.77	1.74	20.27	ND
04:00	89.60	0.42	ND	182.59	2.04	13.94	ND
05:00	89.60	0.58	ND	210.56	2.35	14.10	ND
06:00	89.60	0.88	ND	235.73	2.63	14.66	ND
07:00	89.60	1.18	ND	220.24	2.46	OC	ND
08:00	89.60	1.71	ND	226.93	2.53	9.37	ND
09:00	89.60	1.29	ND	217.08	2.42	10.56	ND
10:00	89.60	1.70	ND	231.54	2.58	11.27	ND
11:00	89.60	1.33	ND	221.13	2.47	11.83	ND
12:00	89.60	1.16	ND	231.71	2.59	11.53	ND
13:00	89.60	2.28	ND	165.37	1.85	24.43	ND
14:00	89.60	1.72	ND	228.50	2.55	18.22	ND
15:00	89.60	1.75	ND	213.09	2.38	22.40	ND
16:00	89.60	0.65	ND	119.54	1.33	46.63	ND
17:00	89.60	0.43	ND	103.89	1.16	52.21	ND
18:00	89.60	4.87	ND	125.87	1.40	39.29	ND
19:00	89.60	2.21	ND	147.65	1.65	34.40	ND
20:00	89.60	1.73	ND	193.72	2.16	21.52	ND
21:00	89.60	0.89	ND	191.41	2.14	19.66	ND
22:00	89.60	1.06	ND	214.64	2.40	14.69	ND
23:00	89.60	0.21	ND	180.15	2.01	23.64	ND
24:00	89.60	1.48	ND	200.67	2.24	15.06	ND
Total	2150.40	31.10	INS	4552.73	50.81	496.10	INS
Average	89.60	1.30	INS	189.70	2.12	20.70	INS
Maximum	89.60	4.90	INS	235.73	2.63	52.20	INS
Minimum	89.60	0.20	INS	103.89	1.16	9.40	INS
Rolling	103.40	2.10	MNR	191.19	1.63	15.30	MNR
Excess		0	0	0	0	0	0
Uptm %	100.00	100.00	0.00	100.00	100.00	95.83	0.00
# Per	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0
ND	0	0	24	0	0	0	24
OC		0	0	0	0	1	0
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	100.00	99.34	0.00	99.32	99.34	98.25	0.00
MDT Per	0	3	456	3	3	8	456

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Emissions Data

Daily Report for 07/19/2001

Time	Kiln SO2 SO2 ppm Avg.	Kiln NOx NOx ppm Avg.	Kiln THC THC ppm Avg.	Kiln Flow ACFM Avg.	Kiln Flow Flow SCFM Avg.	Kiln Flow Flow DSCFM Avg.	Kiln Temp. Deg. F Avg.	Coal Mill Temp. Deg. F Avg.
01:00	0.34	136.72	14.10	234268	183460	155940	207	173
02:00	0.46	158.00	12.72	232756	187484	159364	203	172
03:00	0.28	137.42	15.83	233068	188160	159932	205	172
04:00	0.26	159.16	10.78	235492	186736	158728	205	173
05:00	0.36	183.60	10.90	234708	190164	161640	203	173
06:00	0.55	205.78	11.35	233804	190748	162132	201	172
07:00	0.74	192.27	OC	234116	189884	161400	202	172
08:00	1.07	197.40	7.27	235592	186656	158656	203	172
09:00	0.81	188.51	8.13	236108	189160	160784	204	173
10:00	1.06	202.11	8.68	236584	186380	158420	208	175
11:00	0.84	193.13	9.16	237120	183484	155960	210	175
12:00	0.72	201.98	8.91	235952	184408	156744	206	175
13:00	1.44	145.29	19.01	234448	177384	150780	206	177
14:00	1.19	224.52	16.19	217872	178656	151852	230	175
15:00	1.18	197.93	18.54	223648	183952	156356	213	170
16:00	0.41	105.75	36.59	232548	180032	153028	206	167
17:00	0.27	93.96	40.30	231980	133740	113684	202	174
18:00	3.48	151.89	39.65	193128	173788	147720	261	175
19:00	1.44	133.86	27.90	231220	183808	156236	220	176
20:00	1.11	173.12	17.13	233396	183508	155984	216	175
21:00	0.61	200.89	18.46	209404	176952	150408	235	173
22:00	0.71	223.09	13.93	207520	133232	113246	224	172
23:00	0.19	223.05	25.72	182516	143696	122140	266	173
24:00	0.99	188.70	12.68	221672	176268	149828	216	174
Average	0.85	176.00	17.20	226622	177989	151290	215	173
Maximum	3.48	225.00	40.30	237120	190748	162132	266	177
Minimum	0.19	94.00	7.30	182516	133232	113246	201	167
Rolling	2.22	193.00	13.80	207010	161602	137361	225	171
Uptm %	100.00	100.00	95.83	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0	0
OC	0	0	1	0	0	0	0	0
CAL	0	0	0	0	0	0	0	0
Bad Per	0	0	0	0	0	0	0	0
MUT %	99.34	99.34	98.25	99.56	100.00	100.00	99.56	99.56
MDT Per	3	3	8	2	0	0	2	2

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 07/20/2001

Time	Clinker Prod. Tons/Hr. Avg. T7	Kiln SO2 SO2 Lbs./Hr. Avg T11	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	89.60	0.85	ND	216.84	2.42	16.31	ND
02:00	89.60	1.03	ND	198.38	2.21	20.23	ND
03:00	89.60	1.95	ND	181.13	2.02	16.20	ND
04:00	89.60	1.54	ND	170.80	1.91	16.60	ND
05:00	89.60	1.50	ND	188.84	2.11	14.03	ND
06:00	89.60	1.02	ND	178.81	2.00	14.56	ND
07:00	89.60	0.42	ND	161.32	1.80	12.15	ND
08:00	89.60	0.60	ND	164.95	1.84	14.27	ND
09:00	89.60	0.47	ND	203.11	2.27	5.89	ND
10:00	89.60	0.56	ND	201.70	2.25	4.41	ND
11:00	89.60	0.40	ND	202.54	2.26	1.62	ND
12:00	89.60	0.91	ND	203.93	2.28	3.82	ND
13:00	89.60	1.00	ND	228.13	2.55	1.22	ND
14:00	89.60	1.08	ND	197.89	2.21	2.74	ND
15:00	89.60	2.05	ND	226.86	2.53	1.92	ND
16:00	89.60	2.26	ND	227.31	2.54	4.78	ND
17:00	89.60	1.91	ND	215.97	2.41	4.11	ND
18:00	89.60	0.44	ND	205.37	2.29	3.09	ND
19:00	89.60	0.19	ND	345.28X	3.85	0.87	ND
20:00	89.60	0.35	ND	128.15	1.43	18.81	ND
21:00	89.60	0.44	ND	140.39	1.57	3.72	ND
22:00	89.60	0.17	ND	64.15	0.72	0.54	ND
23:00	89.60	0.26	ND	9.81	0.11	0.12	ND
24:00	89.60	0.18	ND	3.94	0.04	0.12	ND
Total	2150.40	21.60	INS	4265.60	47.62	181.90	INS
Average	89.60	0.90	INS	177.73	1.98	7.60	INS
Maximum	89.60	2.30	INS	345.28	3.85	20.20	INS
Minimum	89.60	0.20	INS	3.94	0.04	0.10	INS
Rolling Excess	103.00	2.00	MNR	189.28	1.64	14.10	MNR
		0	0	1	0	0	0
Uptm %	100.00	100.00	0.00	100.00	100.00	100.00	0.00
# Per	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0
ND	0	0	24	0	0	0	24
OC		0	0	0	0	0	0
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	100.00	99.38	0.00	99.36	99.38	98.33	0.00
MDT Per	0	3	480	3	3	8	480

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Emissions Data

Daily Report for 07/20/2001

Time	Kiln SO2 SO2 ppm Avg.	Kiln NOx NOx ppm Avg.	Kiln THC THC ppm Avg.	Kiln Flow ACFM Avg.	Kiln Flow Flow SCFM Avg.	Kiln Flow Flow DSCFM Avg.	Kiln Temp. Deg. F Avg.	Coal Mill Temp. Deg. F Avg.
01:00	0.58	230.02	14.79	208768	164952	140204	236	173
02:00	0.67	179.37	16.20	231940	185084	157316	219	173
03:00	1.24	159.79	12.65	234756	189748	161280	210	173
04:00	0.99	151.18	12.99	235232	182688	155284	213	173
05:00	0.96	168.81	11.12	235632	180144	153124	222	173
06:00	0.66	160.77	11.58	234128	182020	154716	221	174
07:00	0.27	143.06	9.56	234060	187808	159636	212	174
08:00	0.38	147.45	11.20	232556	176048	149640	211	175
09:00	0.30	182.26	4.68	231236	189112	160744	211	174
10:00	0.36	178.73	3.47	231812	179448	152532	206	167
11:00	0.26	184.63	1.30	226996	179352	152452	210	175
12:00	0.59	183.50	3.06	231964	173784	147712	216	175
13:00	0.65	206.87	0.98	230676	180108	153092	217	176
14:00	0.71	179.68	2.21	229252	186052	158144	214	177
15:00	1.32	205.27	1.54	230476	172356	146500	215	179
16:00	1.47	205.41	3.84	231340	173916	147828	217	179
17:00	1.24	195.11	3.29	231444	181912	154628	216	173
18:00	0.28	184.04	2.48	230260	182260	154920	209	163
19:00	0.12	295.23	0.67	230656	189928	161436	180	153
20:00	0.22	111.07	14.49	236652	190164	161640	204	165
21:00	0.27	122.46	2.88	232896	186136	158216	198	161
22:00	0.12	59.60	0.44	194496	137048	116494	185	131
23:00	0.24	12.24	0.14	153500	121098	102934	175	86
24:00	0.17	5.24	0.14	149324	123130	104660	183	78
Average	0.59	160.00	6.10	222919	174762	148547	208	163
Maximum	1.47	295.00	16.20	236652	190164	161640	236	179
Minimum	0.12	5.00	0.10	149324	121098	102934	175	78
Rolling	2.02	189.00	12.80	208735	163116	138648	224	171
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0	0
OC	0	0	0	0	0	0	0	0
CAL	0	0	0	0	0	0	0	0
Bad Per	0	0	0	0	0	0	0	0
MUT %	99.38	99.38	98.33	99.58	100.00	100.00	99.58	99.58
MDT Per	3	3	8	2	0	0	2	2

Key:
 U, UD User Disable F, IF Instrument Failure C, Cal Calibration
 R, OC Out of Control N, ND No Data M, MNR Monitoring Not Required
 V, Valid Valid Data W, Warning Drift Warning

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 07/21/2001

Time	Clinker Prod. Tons/Hr. Avg.	Kiln SO2 SO2 Lbs./Hr. Avg.	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	MNR	0.67	ND	MNR	MNR	2.51	ND
02:00	MNR	0.51	ND	MNR	MNR	0.98	ND
03:00	MNR	0.19	ND	MNR	MNR	0.12	ND
04:00	MNR	0.24	ND	MNR	MNR	0.12	ND
05:00	MNR	0.29	ND	MNR	MNR	0.12	ND
06:00	MNR	0.64	ND	MNR	MNR	0.12	ND
07:00	MNR	3.04	ND	MNR	MNR	0.11	ND
08:00	MNR	9.68	ND	MNR	MNR	0.11	ND
09:00	MNR	0.39	ND	MNR	MNR	0.11	ND
10:00	MNR	15.18	ND	MNR	MNR	2.06	ND
11:00	MNR	2.52	ND	MNR	MNR	4.86	ND
12:00	MNR	44.07	ND	MNR	MNR	0.08	ND
13:00	MNR	24.22	ND	MNR	MNR	0.07	ND
14:00	MNR	0.32	ND	MNR	MNR	0.22	ND
15:00	MNR	7.13	ND	MNR	MNR	5.68	ND
16:00	MNR	0.46	ND	MNR	MNR	0.08	ND
17:00	MNR	30.80	ND	MNR	MNR	2.05	ND
18:00	MNR	0.88	ND	MNR	MNR	1.03	ND
19:00	MNR	0.64	ND	MNR	MNR	0.53	ND
20:00	89.60	0.76	ND	94.50	1.05	5.41	ND
21:00	89.60	0.57	ND	89.24	1.00	3.24	ND
22:00	89.60	0.36	ND	59.74	0.67	7.77	ND
23:00	89.60	0.89	ND	64.29	0.72	20.74	ND
24:00	89.60	1.80	ND	93.09	1.04	18.08	ND
Total	448.00	146.30	INS	400.86	4.48	76.20	INS
Average	89.60	6.10	INS	80.17	0.90	3.20	INS
Maximum	89.60	44.10	INS	94.50	1.05	20.70	INS
Minimum	89.60	0.20	INS	59.74	0.67	0.10	INS
Rolling	102.63	2.20	MNR	182.18	1.59	13.60	MNR
Excess		0	0	0	0	0	0
Uptm %	100.00	100.00	0.00	100.00	100.00	100.00	0.00
# Per	24	24	24	24	24	24	24
MNR	19	0	0	19	19	0	0
ND	0	0	24	0	0	0	24
OC		0	0	0	0	0	0
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	100.00	99.40	0.00	99.37	99.38	98.41	0.00
MDT Per	0	3	504	3	3	8	504

Key:
U, UD User Disable F, IF Instrument Failure C, Cal Calibration
R, OC Out of Control N, ND No Data M, MNR Monitoring Not Required
V, Valid Valid Data W, Warning Drift Warning

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Emissions Data

Daily Report for 07/21/2001

Time	Kiln SO2 SO2 ppm Avg.	Kiln NOx NOx ppm Avg.	Kiln THC THC ppm Avg.	Kiln Flow ACFM Avg.	Kiln Flow Flow SCFM Avg.	Kiln Flow Flow DSCFM Avg.	Kiln Temp. Deg. F Avg.	Coal Mill Temp. Deg. F Avg.
01:00	0.63	4.55	2.90	152480	126226	107294	187	76
02:00	0.48	4.61	1.14	154284	130870	111238	192	75
03:00	0.17	6.13	0.14	158124	128304	109056	192	74
04:00	0.22	15.41	0.14	157900	128160	108934	190	88
05:00	0.27	23.20	0.14	153488	122116	103800	190	122
06:00	0.60	18.59	0.14	155052	128924	109582	189	127
07:00	2.89	19.07	0.13	149044	120358	102304	188	125
08:00	9.41	10.26	0.13	148152	123114	104646	190	126
09:00	0.39	26.14	0.13	146096	118756	100944	191	133
10:00	11.86	55.85	1.77	186860	173108	147140	200	134
11:00	3.04	37.33	4.23	112722	55935	47544	242	162
12:00	59.82	17.73	0.13	114628	117706	100052	238	157
13:00	40.70	39.66	0.13	100282	95964	81570	217	139
14:00	0.32	26.95	0.24	151276	120654	102558	212	148
15:00	7.41	36.83	6.37	156060	59616	50672	209	154
16:00	1.01	19.97	0.21	68642	57258	48669	242	148
17:00	53.25	87.72	3.04	104010	100830	85708	244	147
18:00	1.36	70.01	4.60	54296	96142	81720	207	164
19:00	0.68	43.51	0.57	132528	155532	132200	216	149
20:00	0.55	94.49	4.94	202344	164220	139588	199	167
21:00	0.40	86.47	2.78	211992	171620	145876	203	163
22:00	0.25	56.72	6.55	215088	176128	149712	202	167
23:00	0.58	58.78	17.09	226164	182836	155416	213	171
24:00	1.14	82.35	14.19	235152	188716	160404	214	170
Average	8.23	39.00	3.00	151944	126796	107776	207	137
Maximum	59.82	94.00	17.10	235152	188716	160404	244	171
Minimum	0.17	5.00	0.10	54296	55935	47544	187	74
Rolling	2.24	181.00	12.40	206915	161948	137655	223	170
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0	0
OC	0	0	0	0	0	0	0	0
CAL	0	0	0	0	0	0	0	0
Bad Per	1	0	0	0	0	0	0	0
MUT %	99.40	99.40	98.41	99.60	100.00	100.00	99.60	99.60
MDT Per	3	3	8	2	0	0	2	2

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 07/22/2001

Time	Clinker Prod. Tons/Hr. Avg. T7	Kiln SO2 SO2 Lbs./Hr. Avg T11	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	89.60	2.61	ND	96.45	1.08	27.10	ND
02:00	89.60	1.94	ND	90.21	1.01	37.14	ND
03:00	89.60	1.81	ND	108.38	1.21	21.10	ND
04:00	89.60	1.86	ND	200.32	2.24	11.36	ND
05:00	89.60	1.76	ND	177.67	1.98	32.87	ND
06:00	89.60	1.56	ND	221.42	2.47	10.45	ND
07:00	89.60	1.47	ND	145.30	1.62	OC	ND
08:00	89.60	1.90	ND	183.95	2.05	OC	ND
09:00	89.60	1.83	ND	261.09	2.91	OC	ND
10:00	89.60	0.62	ND	79.94	0.89	OC	ND
11:00	89.60	0.47	ND	64.05	0.71	OC	ND
12:00	89.60	1.03	ND	175.76	1.96	OC	ND
13:00	89.60	2.40	ND	236.74	2.64	OC	ND
14:00	89.60	3.30	ND	254.66	2.84	OC	ND
15:00	89.60	2.24	ND	291.11	3.25	OC	ND
16:00	89.60	2.55	ND	279.08	3.11	OC	ND
17:00	89.60	3.06	ND	286.66	3.20	OC	ND
18:00	89.60	2.41	ND	280.76	3.13	OC	ND
19:00	89.60	1.80	ND	288.35	3.22	OC	ND
20:00	89.60	2.36	ND	291.55	3.25	OC	ND
21:00	89.60	2.10	ND	269.43	3.01	OC	ND
22:00	89.60	1.74	ND	266.48	2.97	OC	ND
23:00	89.60	1.73	ND	287.66	3.21	OC	ND
24:00	89.60	2.32	ND	314.55	3.51	OC	ND
Total	2150.40	46.90	INS	5151.80	57.47	559.40	INS
Average	89.60	2.00	INS	214.70	2.39	23.30	INS
Maximum	89.60	3.30	INS	314.60	3.51	37.10	INS
Minimum	89.60	0.50	INS	64.10	0.71	10.40	INS
Rolling Excess	102.20	2.00	MNR	184.10	1.62	14.20	MNR
		0	0	0	0	0	0
Uptm %	100.00	100.00	0.00	100.00	100.00	25.00	0.00
# Per	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0
ND	0	0	24	0	0	0	24
OC		0	0	0	0	18	0
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	100.00	99.43	0.00	99.43	99.43	95.08	0.00
MDT Per	0	3	528	3	3	26	528

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Emissions Data

Daily Report for 07/22/2001

Time	Kiln SO2 SO2 ppm Avg.	Kiln NOx NOx ppm Avg.	Kiln THC THC ppm Avg.	Kiln Flow ACFM Avg.	Kiln Flow Flow SCFM Avg.	Kiln Flow DSCFM Avg.	Kiln Temp. Deg. F Avg.	Coal Mill Temp. Deg. F Avg.
01:00	1.63	83.93	20.92	237492	193052	164092	209	171
02:00	1.22	78.63	28.69	236640	190140	161620	208	171
03:00	1.14	95.21	16.43	236280	187700	159540	212	171
04:00	1.17	175.58	8.83	238224	183404	155888	216	169
05:00	1.11	155.17	25.47	237700	185196	157416	212	168
06:00	0.98	194.03	8.12	236732	187172	159092	212	168
07:00	0.93	127.48	OC	237168	187652	159504	214	169
08:00	1.20	161.48	OC	236472	185992	158088	211	169
09:00	1.15	228.38	OC	237260	185404	157592	212	169
10:00	0.44	71.66	OC	197996	128740	109428	202	144
11:00	0.43	84.71	OC	161168	151060	128402	208	147
12:00	0.71	169.80	OC	218984	182108	154792	226	164
13:00	1.54	211.20	OC	231008	187648	159500	207	172
14:00	2.07	222.06	OC	237124	188452	160184	209	174
15:00	1.40	253.55	OC	237424	188956	160612	209	174
16:00	1.59	241.55	OC	237768	190944	162300	206	169
17:00	1.90	248.28	OC	236528	188296	160052	203	176
18:00	1.50	243.68	OC	237716	192912	163972	208	176
19:00	1.12	251.15	OC	237972	189536	161108	211	176
20:00	1.47	253.60	OC	237980	191480	162760	210	175
21:00	1.30	232.81	OC	237624	187780	159612	205	174
22:00	1.08	230.17	OC	237016	186236	158300	203	173
23:00	1.07	247.56	OC	238076	190108	161592	203	174
24:00	1.43	269.43	OC	238888	192608	163716	202	175
Average	1.23	189.00	18.10	231552	184274	156632	209	170
Maximum	2.07	269.00	28.70	238888	193052	164092	226	176
Minimum	0.43	72.00	8.10	161168	128740	109428	202	144
Rolling	1.98	183.00	12.70	210247	164440	139773	223	171
Uptm %	100.00	100.00	25.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0	0
OC	0	0	18	0	0	0	0	0
CAL	0	0	0	0	0	0	0	0
Bad Per	1	0	0	0	0	0	0	0
MUT %	99.43	99.43	95.08	99.62	100.00	100.00	99.62	99.62
MDT Per	3	3	26	2	0	0	2	2

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 07/23/2001

Time	Clinker Prod. Tons/Hr. Avg. T7	Kiln SO2 SO2 Lbs./Hr. Avg T11	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	89.60	1.66	ND	309.25	3.45	OC	ND
02:00	89.60	2.14	ND	289.38	3.23	OC	ND
03:00	89.60	2.65	ND	279.70	3.12	OC	ND
04:00	89.60	2.08	ND	245.68	2.74	OC	ND
05:00	89.60	2.05	ND	276.28	3.08	OC	ND
06:00	89.60	1.65	ND	261.26	2.92	OC	ND
07:00	89.60	1.19	ND	200.88	2.24	OC	ND
08:00	89.60	1.49	ND	210.36	2.35	9.08	ND
09:00	89.60	0.93	ND	214.39	2.39	OC	ND
10:00	89.60	1.42	ND	233.96	2.61	OC	ND
11:00	89.60	1.82	ND	223.66	2.50	11.06	ND
12:00	89.60	1.39	ND	201.61	2.25	22.53	ND
13:00	89.60	1.88	ND	247.11	2.76	10.97	ND
14:00	89.60	1.62	ND	222.95	2.49	14.79	ND
15:00	89.60	1.20	ND	229.52	2.56	11.67	ND
16:00	89.60	0.46	ND	239.45	2.67	9.77	ND
17:00	96.00	0.44	ND	201.50	2.17	14.64	ND
18:00	96.00	0.35	ND	210.60	2.19	16.85	ND
19:00	96.00	0.14	ND	157.87	1.64	14.75	ND
20:00	96.00	0.14	ND	203.47	2.12	12.38	ND
21:00	96.00	0.35	ND	196.55	2.05	10.30	ND
22:00	96.00	0.32	ND	227.68	2.37	9.17	ND
23:00	96.00	0.31	ND	243.46	2.54	10.28	ND
24:00	96.00	0.27	ND	266.83	2.78	11.78	ND
Total	2201.60	27.70	INS	5593.70	61.22	299.20	INS
Average	91.70	1.20	INS	233.10	2.55	12.50	INS
Maximum	96.00	2.60	INS	309.30	3.45	22.50	INS
Minimum	89.60	0.10	INS	157.90	1.64	9.10	INS
Rolling Excess	101.60	2.10	MNR	177.50	1.66	13.70	MNR
		0	0	0	0	0	0
Uptm %	100.00	100.00	0.00	100.00	100.00	62.50	0.00
# Per	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0
ND	0	0	24	0	0	0	24
OC		0	0	0	0	9	0
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	100.00	99.46	0.00	99.46	99.46	93.66	0.00
MDT Per	0	3	552	3	3	35	552

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Emissions Data

Daily Report for 07/23/2001

Time	Kiln SO2 SO2 ppm Avg.	Kiln NOx NOx ppm Avg.	Kiln THC THC ppm Avg.	Kiln Flow ACFM Avg.	Kiln Flow Flow SCFM Avg.	Kiln Flow DSCFM Avg.	Kiln Temp. Deg. F Avg.	Coal Mill Temp. Deg. F Avg.
01:00	1.02	265.48	OC	235476	183880	156296	194	175
02:00	1.32	248.04	OC	235952	189700	161244	195	176
03:00	1.65	242.29	OC	232532	184656	156956	193	176
04:00	1.32	216.32	OC	231896	191420	162708	201	176
05:00	1.28	240.89	OC	238228	188016	159812	212	175
06:00	1.05	230.86	OC	236372	184004	156404	216	175
07:00	0.78	183.64	OC	231644	180740	153628	226	176
08:00	0.97	190.91	7.30	230320	181188	154012	217	174
09:00	0.61	194.36	OC	229544	191360	162652	213	175
10:00	0.89	204.39	OC	235672	188512	160232	206	175
11:00	1.12	192.02	8.32	240252	199812	169836	205	175
12:00	0.85	172.56	17.09	241644	190976	162332	207	174
13:00	1.17	213.56	8.38	237884	186984	158936	204	173
14:00	1.01	193.11	11.37	237100	186832	158808	206	176
15:00	0.74	198.34	8.91	236292	194724	165512	200	169
16:00	0.29	209.52	7.59	232168	190440	161872	197	166
17:00	0.28	176.43	11.33	233424	186052	158140	201	169
18:00	0.31	260.29	18.43	180568	135808	115438	260	171
19:00	0.12	191.53	15.85	180628	133156	113186	249	171
20:00	0.11	220.77	12.08	198580	186856	158828	239	171
21:00	0.22	175.24	8.15	237012	194840	165612	223	171
22:00	0.20	195.30	6.97	244272	187940	159748	218	169
23:00	0.22	246.67	9.31	218124	140532	119452	232	170
24:00	0.22	303.61	11.88	196536	142916	121480	263	169
Average	0.74	215.00	10.60	227172	180056	153047	216	173
Maximum	1.65	304.00	18.40	244272	199812	169836	263	176
Minimum	0.11	173.00	7.00	180568	133156	113186	193	166
Rolling	2.19	177.00	12.40	208178	163005	138554	223	170
Uptm %	100.00	100.00	62.50	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0	0
OC	0	0	9	0	0	0	0	0
CAL	0	0	0	0	0	0	0	0
Bad Per	0	0	0	0	0	0	0	0
MUT %	99.46	99.46	93.66	99.64	100.00	100.00	99.64	99.64
MDT Per	3	3	35	2	0	0	2	2

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 07/24/2001

Time	Clinker Prod. Tons/Hr. Avg. T7	Kiln SO2 SO2 Lbs./Hr. Avg T11	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	96.00	0.14	ND	221.38	2.31	13.51	ND
02:00	96.00	0.18	ND	136.75	1.42	30.22	ND
03:00	96.00	0.31	ND	167.59	1.75	19.03	ND
04:00	96.00	0.47	ND	153.45	1.60	31.78	ND
05:00	96.00	0.70	ND	182.25	1.90	14.02	ND
06:00	96.00	0.21	ND	185.65	1.93	15.35	ND
07:00	96.00	0.12	ND	158.20	1.65	16.08	ND
08:00	96.00	0.18	ND	120.79	1.26	17.48	ND
09:00	89.60	0.16	ND	106.25	1.17	14.76	ND
10:00	89.60	0.14	ND	98.94	1.10	12.94	ND
11:00	89.60	0.16	ND	138.97	1.55	15.82	ND
12:00	89.60	0.23	ND	162.06	1.81	15.53	ND
13:00	89.60	0.28	ND	148.43	1.66	16.76	ND
14:00	89.60	0.26	ND	112.81	1.26	25.87	ND
15:00	89.60	0.40	ND	128.60	1.44	23.41	ND
16:00	89.60	0.23	ND	180.99	2.02	19.09	ND
17:00	89.60	0.27	ND	139.20	1.55	28.43	ND
18:00	89.60	0.44	ND	158.15	1.77	23.24	ND
19:00	89.60	0.71	ND	123.44	1.38	20.96	ND
20:00	89.60	0.49	ND	161.81	1.81	17.26	ND
21:00	89.60	1.08	ND	182.00	2.03	17.19	ND
22:00	89.60	1.10	ND	175.54	1.96	20.46	ND
23:00	89.60	0.89	ND	206.72	2.31	18.81	ND
24:00	89.60	0.96	ND	227.75	2.54	17.46	ND
Total	2201.60	10.20	INS	3777.60	41.18	465.60	INS
Average	91.70	0.40	INS	157.40	1.72	19.40	INS
Maximum	96.00	1.10	INS	227.70	2.54	31.80	INS
Minimum	89.60	0.10	INS	98.90	1.10	12.90	INS
Rolling Excess	101.00	2.10	MNR	178.60	1.66	14.60	MNR
		0	0	0	0	0	0
Uptm %	100.00	100.00	0.00	100.00	100.00	100.00	0.00
# Per	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0
ND	0	0	24	0	0	0	24
OC		0	0	0	0	0	0
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	100.00	99.48	0.00	99.48	99.48	93.92	0.00
MDT Per	0	3	576	3	3	35	576

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Emissions Data

Daily Report for 07/24/2001

Time	Kiln SO2 SO2 ppm Avg.	Kiln NOx NOx ppm Avg.	Kiln THC THC ppm Avg.	Kiln Flow ACFM Avg.	Kiln Flow Flow SCFM Avg.	Kiln Flow DSCFM Avg.	Kiln Temp. Deg. F Avg.	Coal Mill Temp. Deg. F Avg.
01:00	0.11	249.97	13.56	193380	152612	129722	245	169
02:00	0.13	139.57	26.18	215832	185764	157896	234	168
03:00	0.20	149.14	14.96	233620	186960	158916	212	169
04:00	0.30	134.07	24.61	238328	188076	159864	214	168
05:00	0.44	159.11	10.82	236408	151592	128854	206	170
06:00	0.17	214.10	15.71	190336	143592	122056	251	162
07:00	0.10	179.59	16.19	190304	143444	121928	240	166
08:00	0.14	135.27	17.38	191788	144540	122862	235	168
09:00	0.13	120.00	14.74	189724	145680	123830	233	169
10:00	0.11	112.58	13.06	187568	143836	122262	231	171
11:00	0.13	157.49	15.90	187916	148128	125906	229	169
12:00	0.19	182.55	15.54	187768	143668	122116	225	163
13:00	0.22	166.51	16.68	188780	147712	125556	226	168
14:00	0.21	126.57	25.73	188952	145664	123816	226	169
15:00	0.32	144.59	23.34	188384	144816	123096	226	170
16:00	0.18	203.48	18.98	188656	142864	121434	226	171
17:00	0.22	156.89	28.41	187988	149308	126912	226	172
18:00	0.36	178.75	23.40	187188	134212	114078	226	174
19:00	0.62	152.20	22.80	174052	126368	107412	233	174
20:00	0.43	201.01	18.94	173884	139404	118492	237	175
21:00	0.91	213.81	17.83	183800	149184	126808	237	175
22:00	0.90	198.96	20.60	188864	146112	124194	234	174
23:00	0.73	236.48	19.11	186920	146112	124194	233	174
24:00	0.78	258.10	17.55	188528	145908	124022	232	172
Average	0.33	174.00	18.80	194540	149815	127343	230	170
Maximum	0.91	258.00	28.40	238328	188076	159864	251	175
Minimum	0.10	113.00	10.80	173884	126368	107412	206	162
Rolling	2.14	178.00	13.10	209892	164309	139662	223	170
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0	0
OC	0	0	0	0	0	0	0	0
CAL	0	0	0	0	0	0	0	0
Bad Per	0	0	0	0	0	0	0	0
MUT %	99.48	99.48	93.92	99.65	100.00	100.00	99.65	99.65
MDT Per	3	3	35	2	0	0	2	2

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 07/25/2001

Time	Clinker Prod. Tons/Hr. Avg. T7	Kiln SO2 SO2 Lbs./Hr. Avg T11	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	89.60	0.20	ND	199.19	2.22	16.37	ND
02:00	89.60	0.47	ND	205.04	2.29	15.77	ND
03:00	89.60	0.33	ND	219.79	2.45	16.45	ND
04:00	89.60	0.17	ND	206.84	2.31	16.43	ND
05:00	89.60	0.16	ND	185.68	2.07	17.88	ND
06:00	89.60	0.14	ND	211.67	2.36	16.33	ND
07:00	89.60	0.14	ND	203.13	2.27	OC	ND
08:00	89.60	0.13	ND	209.09	2.33	15.76	ND
09:00	89.60	0.14	ND	220.15	2.46	17.93	ND
10:00	89.60	0.17	ND	225.43	2.52	18.67	ND
11:00	89.60	0.29	ND	226.85	2.53	20.21	ND
12:00	89.60	0.23	ND	215.79	2.41	19.83	ND
13:00	89.60	0.32	ND	223.12	2.49	18.07	ND
14:00	89.60	0.27	ND	137.86	1.54	8.27	ND
15:00	76.80	0.18	ND	148.41	1.83	13.04	ND
16:00	76.80	0.22	ND	182.69	2.38	9.33	ND
17:00	76.80	0.45	ND	172.13	2.24	10.53	ND
18:00	76.80	0.35	ND	159.12	2.07	10.58	ND
19:00	76.80	0.23	ND	153.13	1.99	10.24	ND
20:00	76.80	0.28	ND	145.38	1.89	7.30	ND
21:00	76.80	0.20	ND	147.86	1.93	5.78	ND
22:00	76.80	0.15	ND	152.06	1.98	6.11	ND
23:00	76.80	0.14	ND	172.02	2.24	5.61	ND
24:00	76.80	0.20	ND	171.84	2.24	5.86	ND
Total	2022.40	5.50	INS	4494.10	53.04	318.40	INS
Average	84.30	0.20	INS	187.30	2.21	13.30	INS
Maximum	89.60	0.50	INS	226.80	2.53	20.20	INS
Minimum	76.80	0.10	INS	137.90	1.54	5.60	INS
Rolling	100.30	2.00	MNR	178.90	1.68	14.70	MNR
Excess		0	0	0	0	0	0
Uptm %	100.00	100.00	0.00	100.00	100.00	95.83	0.00
# Per	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0
ND	0	0	24	0	0	0	24
OC		0	0	0	0	1	0
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	100.00	99.50	0.00	99.50	99.50	94.00	0.00
MDT Per	0	3	600	3	3	36	600

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Emissions Data

Daily Report for 07/25/2001

Time	Kiln SO2 SO2 ppm Avg.	Kiln NOx NOx ppm Avg.	Kiln THC THC ppm Avg.	Kiln Flow ACFM Avg.	Kiln Flow Flow SCFM Avg.	Kiln Flow DSCFM Avg.	Kiln Temp. Deg. F Avg.	Coal Mill Temp. Deg. F Avg.
01:00	0.17	227.97	16.61	186376	144660	122960	230	172
02:00	0.39	234.39	15.99	187064	143304	121804	232	173
03:00	0.27	251.25	16.68	187188	143360	121856	233	174
04:00	0.14	235.13	16.57	188100	141540	120312	232	173
05:00	0.13	211.49	18.06	187472	144872	123138	231	173
06:00	0.11	239.60	16.41	188184	144928	123188	230	173
07:00	0.11	229.07	OC	189324	141576	120342	231	173
08:00	0.11	236.17	15.82	189300	144180	122552	232	174
09:00	0.11	251.89	18.19	187072	143304	121804	233	174
10:00	0.14	254.98	18.73	189576	149460	127040	234	177
11:00	0.23	254.96	20.15	191336	144524	122848	236	178
12:00	0.19	246.29	20.09	188184	139784	118818	236	178
13:00	0.26	255.30	18.34	187904	142316	120972	236	179
14:00	0.24	171.14	8.72	163012	126196	107264	225	179
15:00	0.16	182.77	14.26	171808	129364	109956	226	179
16:00	0.19	225.90	10.23	172660	133956	113864	231	179
17:00	0.37	216.18	11.35	171760	134700	114492	233	179
18:00	0.31	197.49	11.63	172608	131836	112056	233	177
19:00	0.22	200.75	11.91	163952	125174	106396	236	176
20:00	0.25	181.32	8.16	176812	177000	150448	233	174
21:00	0.14	140.72	4.90	218828	169684	144232	216	172
22:00	0.11	147.11	5.24	218680	164436	139768	225	175
23:00	0.11	184.21	5.29	201172	139460	118542	231	174
24:00	0.17	203.11	6.14	183960	137348	116746	244	175
Average	0.19	216.00	13.60	185931	143207	121725	232	175
Maximum	0.39	255.00	20.10	218828	177000	150448	244	179
Minimum	0.11	141.00	4.90	163012	125174	106396	216	172
Rolling	2.12	179.00	13.10	209854	164226	139592	223	171
Uptm %	100.00	100.00	95.83	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0	0
OC	0	0	1	0	0	0	0	0
CAL	0	0	0	0	0	0	0	0
Bad Per	0	0	0	0	0	0	0	0
MUT %	99.50	99.50	94.00	99.67	100.00	100.00	99.67	99.67
MDT Per	3	3	36	2	0	0	2	2

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 07/26/2001

Time	Clinker Prod. Tons/Hr. Avg. T7	Kiln SO2 SO2 Lbs./Hr. Avg T11	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	76.80	0.27	ND	154.25	2.01	6.44	ND
02:00	76.80	0.30	ND	135.29	1.76	6.24	ND
03:00	76.80	0.39	ND	156.30	2.04	5.99	ND
04:00	76.80	0.23	ND	160.18	2.09	6.28	ND
05:00	76.80	0.24	ND	156.45	2.04	8.91	ND
06:00	76.80	0.16	ND	149.97	1.95	6.38	ND
07:00	76.80	0.23	ND	138.14	1.80	9.12	ND
08:00	76.80	0.25	ND	116.43	1.52	7.64	ND
09:00	76.80	0.75	ND	140.92	1.84	8.39	ND
10:00	76.80	0.75	ND	126.10	1.64	8.80	ND
11:00	76.80	1.15	ND	158.66	2.07	12.27	ND
12:00	76.80	1.04	ND	137.16	1.79	11.62	ND
13:00	76.80	2.46	ND	140.77	1.83	12.62	ND
14:00	76.80	7.04	ND	130.93	1.70	16.10	ND
15:00	76.80	2.17	ND	121.86	1.59	16.91	ND
16:00	76.80	2.36	ND	135.13	1.76	6.88	ND
17:00	76.80	2.29	ND	120.84	1.57	14.88	ND
18:00	76.80	0.36	ND	113.25	1.47	15.14	ND
19:00	76.80	0.67	ND	117.93	1.54	7.66	ND
20:00	76.80	0.27	ND	141.07	1.84	6.74	ND
21:00	76.80	0.44	ND	167.71	2.18	8.70	ND
22:00	76.80	0.25	ND	171.45	2.23	7.74	ND
23:00	76.80	0.31	ND	164.65	2.14	8.85	ND
24:00	76.80	0.63	ND	179.13	2.33	8.23	ND
Total	1843.20	25.20	INS	3434.40	44.73	228.30	INS
Average	76.80	1.00	INS	143.10	1.86	9.50	INS
Maximum	76.80	7.00	INS	179.10	2.33	16.90	INS
Minimum	76.80	0.20	INS	113.20	1.47	6.00	INS
Rolling Excess	99.70	2.10	MNR	173.30	1.69	14.80	MNR
		0	0	0	0	0	0
Uptm %	100.00	100.00	0.00	100.00	100.00	100.00	0.00
# Per	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0
ND	0	0	24	0	0	0	24
OC		0	0	0	0	0	0
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	100.00	99.52	0.00	99.52	99.52	94.23	0.00
MDT Per	0	3	624	3	3	36	624

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Emissions Data

Daily Report for 07/26/2001

Time	Kiln SO2 SO2 ppm Avg.	Kiln NOx NOx ppm Avg.	Kiln THC THC ppm Avg.	Kiln Flow ACFM Avg.	Kiln Flow Flow SCFM Avg.	Kiln Flow Flow DSCFM Avg.	Kiln Temp. Deg. F Avg.	Coal Mill Temp. Deg. F Avg.
01:00	0.23	184.73	6.85	183236	135916	115528	251	174
02:00	0.26	164.73	6.74	180512	132024	112220	252	174
03:00	0.34	188.86	6.42	182316	133700	113646	253	173
04:00	0.20	196.37	6.83	179636	132776	112862	253	172
05:00	0.21	192.60	9.73	178948	128968	109622	253	173
06:00	0.14	185.43	6.98	178288	142940	121502	254	173
07:00	0.18	142.85	9.03	209620	170076	144564	243	172
08:00	0.17	109.13	6.32	219788	181488	154264	204	172
09:00	0.49	128.48	6.81	227560	177132	150564	214	174
10:00	0.49	114.29	7.08	229236	179168	152292	214	176
11:00	0.77	147.55	10.06	225164	176192	149760	216	175
12:00	0.69	125.91	9.48	225332	175896	149508	210	175
13:00	1.63	130.35	10.38	227636	187880	159692	223	176
14:00	6.75	165.00	18.40	183240	101414	86202	272	176
15:00	2.39	183.77	22.78	150576	109578	93142	277	177
16:00	3.00	232.59	10.36	130552	92310	78464	275	176
17:00	2.74	196.16	21.53	138784	107114	91046	272	173
18:00	0.30	149.06	17.62	170944	160952	136808	242	165
19:00	0.47	115.70	6.68	211220	173556	147524	211	173
20:00	0.19	143.98	6.07	208876	121316	103120	212	171
21:00	0.47	244.25	11.25	154308	111070	94408	267	171
22:00	0.28	259.43	10.39	147508	107354	91250	263	171
23:00	0.34	243.83	11.61	150960	140500	119430	261	172
24:00	0.49	192.87	7.97	200356	173328	147328	236	173
Average	0.97	172.00	10.30	187275	143860	122281	243	173
Maximum	6.75	259.00	22.80	229236	187880	159692	277	177
Minimum	0.14	109.00	6.10	130552	92310	78464	204	165
Rolling	2.13	172.00	13.10	209956	164229	139594	223	170
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0	0
OC	0	0	0	0	0	0	0	0
CAL	0	0	0	0	0	0	0	0
Bad Per	1	0	0	0	0	0	0	0
MUT %	99.52	99.52	94.23	99.68	100.00	100.00	99.68	99.68
MDT Per	3	3	36	2	0	0	2	2

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 07/27/2001

Time	Clinker Prod. Tons/Hr. Avg. T7	Kiln SO2 SO2 Lbs./Hr. Avg T11	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	76.80	0.85	ND	174.39	2.27	6.90	ND
02:00	76.80	0.43	ND	160.39	2.09	7.02	ND
03:00	76.80	0.35	ND	169.68	2.21	6.87	ND
04:00	76.80	0.26	ND	212.96	2.77	6.78	ND
05:00	76.80	0.32	ND	186.54	2.43	6.14	ND
06:00	76.80	0.27	ND	195.20	2.54	6.11	ND
07:00	76.80	0.29	ND	152.13	1.98	OC	ND
08:00	76.80	0.30	ND	162.07	2.11	OC	ND
09:00	76.80	0.67	ND	173.80	2.26	5.42	ND
10:00	76.80	0.48	ND	82.75	1.08	2.03	ND
11:00	76.80	0.78	ND	59.03	0.77	1.34	ND
12:00	76.80	2.57	ND	118.87	1.55	9.24	ND
13:00	76.80	3.63	ND	65.10	0.85	8.52	ND
14:00	76.80	3.60	ND	61.16	0.80	13.38	ND
15:00	76.80	5.01	ND	118.79	1.55	13.55	ND
16:00	76.80	3.52	ND	179.71	2.34	13.92	ND
17:00	76.80	1.99	ND	99.48	1.30	17.17	ND
18:00	76.80	0.42	ND	92.95	1.21	15.18	ND
19:00	76.80	0.36	ND	61.76	0.80	28.46	ND
20:00	76.80	0.77	ND	58.27	0.76	8.76	ND
21:00	76.80	0.22	ND	110.44	1.44	8.47	ND
22:00	76.80	0.57	ND	157.17	2.05	6.02	ND
23:00	76.80	0.39	ND	14.88	0.19	0.13	ND
24:00	76.80	0.52	ND	9.37	0.12	0.13	ND
Total	1843.20	28.60	INS	2877.10	37.47	203.10	INS
Average	76.80	1.20	INS	119.90	1.56	8.50	INS
Maximum	76.80	5.00	INS	213.00	2.77	28.50	INS
Minimum	76.80	0.20	INS	9.40	0.12	0.10	INS
Rolling Excess	99.10	2.00	MNR	170.80	1.69	14.80	MNR
		0	0	0	0	0	0
Uptm %	100.00	100.00	0.00	100.00	100.00	91.67	0.00
# Per	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0
ND	0	0	24	0	0	0	24
OC		0	0	0	0	2	0
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	100.00	99.54	0.00	99.54	99.54	94.14	0.00
MDT Per	0	3	648	3	3	38	648

Key:
 U, UD User Disable F, IF Instrument Failure C, Cal Calibration
 R, OC Out of Control N, ND No Data M, MNR Monitoring Not Required
 V, Valid Valid Data W, Warning Drift Warning

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Emissions Data

Daily Report for 07/27/2001

Time	Kiln SO2 SO2 ppm Avg.	Kiln NOx NOx ppm Avg.	Kiln THC THC ppm Avg.	Kiln Flow ACFM Avg.	Kiln Flow Flow SCFM Avg.	Kiln Flow Flow DSCFM Avg.	Kiln Temp. Deg. F Avg.	Coal Mill Temp. Deg. F Avg.
01:00	0.57	164.23	5.75	221348	179168	152292	213	173
02:00	0.29	147.19	5.71	224496	179616	152672	207	173
03:00	0.23	155.86	5.60	223868	178724	151916	206	173
04:00	0.17	192.48	5.43	226320	187260	159168	202	172
05:00	0.21	170.26	4.97	224548	181156	153980	203	172
06:00	0.18	176.76	4.91	225348	180588	153496	201	172
07:00	0.19	138.40	OC	225752	179824	152848	205	172
08:00	0.20	147.73	OC	224040	183816	156240	201	172
09:00	0.45	160.62	4.45	223904	177216	150632	210	172
10:00	0.34	80.78	1.68	203092	162740	138328	211	167
11:00	0.60	61.75	1.23	192960	161668	137416	216	159
12:00	1.84	118.54	8.16	213092	162144	137816	226	169
13:00	2.50	62.48	7.25	221672	169964	144468	228	177
14:00	2.47	58.43	11.35	223244	172720	146808	231	179
15:00	3.98	136.83	13.10	203748	140336	119284	257	179
16:00	2.87	202.66	13.97	197128	146704	124700	261	178
17:00	1.56	108.99	16.58	199432	153184	130208	245	176
18:00	0.32	99.52	14.45	200492	156060	132648	235	159
19:00	0.26	61.36	24.88	211964	169080	143716	220	167
20:00	0.53	56.02	7.48	216492	181844	154568	214	166
21:00	0.14	102.59	6.96	220980	171532	145804	202	162
22:00	0.37	145.38	4.90	222324	166356	141400	207	157
23:00	0.36	18.17	0.15	156756	125504	106676	203	102
24:00	0.50	12.65	0.15	150744	116880	99348	198	85
Average	0.88	116.00	7.40	210573	166004	141101	217	164
Maximum	3.98	203.00	24.90	226320	187260	159168	261	179
Minimum	0.14	13.00	0.20	150744	116880	99348	198	85
Rolling	2.10	169.00	13.10	210440	164664	139964	223	170
Uptm %	100.00	100.00	91.67	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0	0
OC	0	0	2	0	0	0	0	0
CAL	0	0	0	0	0	0	0	0
Bad Per	0	0	0	0	0	0	0	0
MUT %	99.54	99.54	94.14	99.69	100.00	100.00	99.69	99.69
MDT Per	3	3	38	2	0	0	2	2

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 07/28/2001

Time	Clinker Prod. Tons/Hr. Avg. T7	Kiln SO2 SO2 Lbs./Hr. Avg T11	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	76.80	0.42	ND	10.06	0.13	0.12	ND
02:00	76.80	0.84	ND	83.32	1.08	7.22	ND
03:00	76.80	0.96	ND	130.42	1.70	7.43	ND
04:00	76.80	2.19	ND	235.97	3.07	11.06	ND
05:00	76.80	0.92	ND	246.56	3.21	11.65	ND
06:00	76.80	0.94	ND	170.20	2.22	29.32	ND
07:00	76.80	0.40	ND	207.46	2.70	11.72	ND
08:00	76.80	0.45	ND	219.47	2.86	10.17	ND
09:00	76.80	0.98	ND	222.98	2.90	11.10	ND
10:00	76.80	1.18	ND	180.82	2.35	30.66	ND
11:00	76.80	2.09	ND	207.61	2.70	11.75	ND
12:00	76.80	2.70	ND	196.19	2.55	11.67	ND
13:00	76.80	2.70	ND	156.53	2.04	19.12	ND
14:00	76.80	2.51	ND	118.78	1.55	36.92	ND
15:00	76.80	3.59	ND	198.39	2.58	6.96	ND
16:00	76.80	3.06	ND	180.79	2.35	15.07	ND
17:00	76.80	3.88	ND	175.44	2.28	26.83	ND
18:00	76.80	2.90	ND	211.33	2.75	13.38	ND
19:00	76.80	1.92	ND	185.92	2.42	11.10	ND
20:00	76.80	1.64	ND	214.45	2.79	7.12	ND
21:00	76.80	1.28	ND	245.52	3.20	4.12	ND
22:00	76.80	0.98	ND	238.23	3.10	3.62	ND
23:00	76.80	1.07	ND	251.58	3.28	4.76	ND
24:00	76.80	1.44	ND	250.12	3.26	5.14	ND
Total	1843.20	41.10	INS	4538.20	59.07	308.00	INS
Average	76.80	1.70	INS	189.10	2.46	12.80	INS
Maximum	76.80	3.90	INS	251.60	3.28	36.90	INS
Minimum	76.80	0.40	INS	10.10	0.13	0.10	INS
Rolling	98.20	2.00	MNR	171.00	1.71	14.80	MNR
Excess		0	0	0	0	0	0
Uptm %	100.00	100.00	0.00	100.00	100.00	100.00	0.00
# Per	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0
ND	0	0	24	0	0	0	24
OC		0	0	0	0	0	0
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	100.00	99.55	0.00	99.55	99.55	94.35	0.00
MDT Per	0	3	672	3	3	38	672

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Emissions Data

Daily Report for 07/28/2001

Time	Kiln SO2 SO2 ppm Avg.	Kiln NOx NOx ppm Avg.	Kiln THC THC ppm Avg.	Kiln Flow ACFM Avg.	Kiln Flow Flow SCFM Avg.	Kiln Flow DSCFM Avg.	Kiln Temp. Deg. F Avg.	Coal Mill Temp. Deg. F Avg.
01:00	0.43	14.35	0.15	141204	119692	101740	192	147
02:00	0.62	81.19	6.14	201816	177364	150760	202	169
03:00	0.62	118.99	6.02	223440	181156	153984	204	172
04:00	1.41	210.72	8.76	230516	177728	151068	207	171
05:00	0.66	265.55	11.64	203500	111832	95058	226	171
06:00	1.02	254.46	38.32	151460	135884	115500	267	172
07:00	0.29	209.27	11.11	209616	175816	149440	232	171
08:00	0.30	203.16	8.35	222808	177704	151048	207	172
09:00	0.65	204.09	9.01	225240	182804	155384	207	174
10:00	0.76	163.87	24.67	228452	184076	156468	210	176
11:00	1.34	185.29	9.34	229620	187180	159100	204	176
12:00	2.09	211.08	11.11	203332	115022	97770	224	176
13:00	2.53	203.52	20.83	179076	142844	121420	267	177
14:00	1.84	124.87	33.00	209632	147104	125040	235	178
15:00	2.53	195.29	6.24	214696	174224	148092	227	177
16:00	2.08	171.18	12.64	223188	172372	146516	224	177
17:00	2.60	163.62	22.11	224908	178240	151504	218	177
18:00	1.95	198.40	11.18	222496	177104	150536	217	174
19:00	1.30	175.12	9.27	222852	176124	149708	220	172
20:00	1.11	201.64	5.94	223012	175048	148792	219	174
21:00	0.84	225.52	3.36	226692	176520	150040	214	172
22:00	0.65	218.57	2.94	225016	180324	153272	208	169
23:00	0.68	223.36	3.74	231200	180048	153044	204	169
24:00	0.92	222.76	4.06	230592	186144	158220	205	169
Average	1.22	185.00	11.70	212682	166348	141396	218	172
Maximum	2.60	266.00	38.30	231200	187180	159100	267	178
Minimum	0.29	14.00	0.20	141204	111832	95058	192	147
Rolling	2.11	170.00	13.10	210037	164131	139511	224	170
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0	0
OC	0	0	0	0	0	0	0	0
CAL	0	0	0	0	0	0	0	0
Bad Per	0	0	0	0	0	0	0	0
MUT %	99.55	99.55	94.35	99.70	100.00	100.00	99.70	99.70
MDT Per	3	3	38	2	0	0	2	2

Key:
 U, UD User Disable F, IF Instrument Failure C, Cal Calibration
 R, OC Out of Control N, ND No Data M, MNR Monitoring Not Required
 V, Valid Valid Data W, Warning Drift Warning

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 07/29/2001

Time	Clinker Prod. Tons/Hr. Avg. T7	Kiln SO2 SO2 Lbs./Hr. Avg T11	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	76.80	1.46	ND	249.49	3.25	3.95	ND
02:00	76.80	1.41	ND	252.68	3.29	4.12	ND
03:00	76.80	1.59	ND	252.40	3.29	5.28	ND
04:00	76.80	0.72	ND	267.91	3.49	7.21	ND
05:00	76.80	0.99	ND	271.77	3.54	11.33	ND
06:00	76.80	1.96	ND	271.95	3.54	9.39	ND
07:00	76.80	1.04	ND	274.97	3.58	7.61	ND
08:00	76.80	0.76	ND	257.10	3.35	10.15	ND
09:00	76.80	1.16	ND	208.10	2.71	19.83	ND
10:00	76.80	1.98	ND	252.80	3.29	10.41	ND
11:00	76.80	2.14	ND	234.59	3.05	9.17	ND
12:00	76.80	2.11	ND	225.21	2.93	14.86	ND
13:00	76.80	2.63	ND	231.41	3.01	12.49	ND
14:00	76.80	3.00	ND	249.99	3.25	12.99	ND
15:00	76.80	1.87	ND	219.14	2.85	13.53	ND
16:00	76.80	2.66	ND	212.53	2.77	12.16	ND
17:00	76.80	2.04	ND	174.44	2.27	20.23	ND
18:00	76.80	2.84	ND	188.07	2.45	10.90	ND
19:00	76.80	2.43	ND	235.84	3.07	9.76	ND
20:00	76.80	1.12	ND	203.55	2.65	11.24	ND
21:00	76.80	0.28	ND	152.94	1.99	9.13	ND
22:00	76.80	0.20	ND	90.47	1.18	5.41	ND
23:00	76.80	0.27	ND	114.70	1.49	23.60	ND
24:00	76.80	0.26	ND	183.62	2.39	8.87	ND
Total	1843.20	37.00	INS	5275.70	68.68	263.50	INS
Average	76.80	1.50	INS	219.80	2.86	11.00	INS
Maximum	76.80	3.00	INS	275.00	3.58	23.60	INS
Minimum	76.80	0.20	INS	90.50	1.18	3.90	INS
Rolling	97.40	2.00	MNR	168.00	1.75	14.80	MNR
Excess		0	0	0	0	0	0
Uptm %	100.00	100.00	0.00	100.00	100.00	100.00	0.00
# Per	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0
ND	0	0	24	0	0	0	24
OC		0	0	0	0	0	0
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	100.00	99.57	0.00	99.57	99.57	94.54	0.00
MDT Per	0	3	696	3	3	38	696

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Emissions Data

Daily Report for 07/29/2001

Time	Kiln SO2 SO2 ppm Avg.	Kiln NOx NOx ppm Avg.	Kiln THC THC ppm Avg.	Kiln Flow ACFM Avg.	Kiln Flow Flow SCFM Avg.	Kiln Flow Flow DSCFM Avg.	Kiln Temp. Deg. F Avg.	Coal Mill Temp. Deg. F Avg.
01:00	0.93	222.63	3.12	230716	188016	159812	206	168
02:00	0.90	225.08	3.26	231628	191824	163048	208	169
03:00	1.02	225.48	4.18	230832	186380	158420	207	170
04:00	0.61	331.70	8.14	181544	117652	100004	250	169
05:00	0.97	374.55	13.69	163696	142184	120854	267	168
06:00	1.46	276.84	8.66	210692	174016	147912	233	169
07:00	0.69	252.63	6.20	224580	176596	150108	208	169
08:00	0.67	332.27	11.79	172900	116516	99038	257	169
09:00	1.05	254.69	21.32	184376	150708	128100	259	171
10:00	1.37	245.63	9.03	222240	169608	144168	239	173
11:00	1.43	217.77	7.55	228532	172964	147016	226	173
12:00	1.39	206.92	12.11	227292	179528	152596	216	174
13:00	1.75	213.78	10.23	227608	168920	143580	221	175
14:00	2.80	326.48	15.15	173296	119850	101868	274	174
15:00	1.71	274.66	15.47	179536	149436	127018	267	174
16:00	1.89	210.60	10.69	218740	171712	145956	241	174
17:00	1.40	166.79	17.24	221204	171732	145976	225	173
18:00	1.93	177.84	9.14	222132	180624	153532	220	171
19:00	1.82	247.93	9.21	207732	120826	102700	233	171
20:00	1.15	296.64	14.61	155772	107942	91752	276	171
21:00	0.31	262.12	13.62	127230	38155	32433	264	171
22:00	0.26	156.69	8.34	122760	101560	86326	263	171
23:00	0.30	148.76	29.34	169164	154208	131076	257	170
24:00	0.18	180.00	7.68	214700	173552	147520	220	170
Average	1.17	243.00	11.20	197871	151021	128367	239	171
Maximum	2.80	375.00	29.30	231628	191824	163048	276	175
Minimum	0.18	149.00	3.10	122760	38155	32433	206	168
Rolling	2.12	168.00	13.20	209210	163374	138867	224	170
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0	0
OC	0	0	0	0	0	0	0	0
CAL	0	0	0	0	0	0	0	0
Bad Per	0	0	0	0	0	0	0	0
MUT %	99.57	99.57	94.54	99.71	100.00	100.00	99.71	99.71
MDT Per	3	3	38	2	0	0	2	2

Key: U, UD User Disable F, IF Instrument Failure C, Cal Calibration
R, OC Out of Control N, ND No Data M, MNR Monitoring Not Required
V, Valid W, Warning D, DW Drift Warning

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 07/30/2001

Time	Clinker Prod. Tons/Hr. Avg. T7	Kiln SO2 SO2 Lbs./Hr. Avg T11	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	76.80	0.39	ND	171.18	2.23	11.25	ND
02:00	76.80	0.41	ND	144.22	1.88	10.38	ND
03:00	76.80	0.66	ND	131.30	1.71	10.73	ND
04:00	76.80	0.65	ND	129.19	1.68	7.87	ND
05:00	76.80	0.49	ND	125.51	1.63	6.44	ND
06:00	76.80	0.30	ND	110.67	1.44	7.98	ND
07:00	76.80	0.38	ND	74.52	0.97	15.76	ND
08:00	76.80	0.42	ND	113.54	1.48	16.57	ND
09:00	76.80	0.59	ND	84.24	1.10	34.04	ND
10:00	86.40	0.71	ND	202.17	2.60	5.56	ND
11:00	86.40	0.65	ND	191.43	2.22	14.50	ND
12:00	86.40	0.71	ND	208.28	2.41	4.09	ND
13:00	86.40	1.52	ND	173.39	2.01	6.95	ND
14:00	86.40	3.73	ND	163.49	1.89	5.89	ND
15:00	86.40	1.72	ND	126.94	1.47	7.17	ND
16:00	86.40	1.29	ND	127.02	1.47	5.53	ND
17:00	86.40	1.80	ND	221.18	2.56	3.23	ND
18:00	86.40	1.18	ND	219.75	2.54	2.60	ND
19:00	86.40	1.16	ND	157.77	1.83	1.33	ND
20:00	86.40	0.80	ND	228.99	2.65	0.58	ND
21:00	86.40	0.70	ND	249.96	2.89	0.47	ND
22:00	86.40	0.73	ND	272.09	3.15	0.65	ND
23:00	86.40	1.00	ND	235.03	2.72	0.99	ND
24:00	86.40	1.69	ND	236.08	2.73	3.02	ND
Total	1987.20	23.70	INS	4098.00	49.26	183.70	INS
Average	82.80	1.00	INS	170.80	2.05	7.70	INS
Maximum	86.40	3.70	INS	272.10	3.15	34.00	INS
Minimum	76.80	0.30	INS	74.50	0.97	0.50	INS
Rolling	96.70	2.10	MNR	165.70	1.76	14.80	MNR
Excess		0	0	0	0	0	0
Uptm %	100.00	100.00	0.00	100.00	100.00	100.00	0.00
# Per	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0
ND	0	0	24	0	0	0	24
OC		0	0	0	0	0	0
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	100.00	99.58	0.00	99.58	99.58	94.72	0.00
MDT Per	0	3	720	3	3	38	720

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Emissions Data

Daily Report for 07/30/2001

Time	Kiln SO2 SO2 ppm Avg.	Kiln NOx NOx ppm Avg.	Kiln THC THC ppm Avg.	Kiln Flow ACFM Avg.	Kiln Flow Flow SCFM Avg.	Kiln Flow Flow DSCFM Avg.	Kiln Temp. Deg. F Avg.	Coal Mill Temp. Deg. F Avg.
01:00	0.27	161.60	9.44	218820	173804	147732	209	169
02:00	0.27	135.71	8.67	219680	176176	149748	209	170
03:00	0.45	123.88	8.99	219244	174364	148208	210	169
04:00	0.44	120.94	6.53	220988	176596	150108	209	169
05:00	0.33	118.73	5.40	218048	174472	148300	207	170
06:00	0.20	102.21	6.53	222760	184828	157104	205	170
07:00	0.25	67.91	12.60	224980	173084	147120	203	171
08:00	0.27	104.40	13.55	225216	178532	151752	211	171
09:00	0.39	78.03	27.96	225332	179276	152384	216	172
10:00	0.46	184.63	4.47	229164	175620	149276	216	171
11:00	0.45	182.10	12.06	223860	172016	146212	228	170
12:00	0.49	196.52	3.42	223964	176820	150296	224	172
13:00	1.04	165.25	5.88	221168	167500	142376	222	174
14:00	3.39	206.37	6.64	178892	125750	106886	270	174
15:00	1.55	159.64	7.96	179228	144988	123240	265	174
16:00	0.93	126.07	5.14	213356	172700	146796	237	173
17:00	1.20	206.18	2.67	225888	173544	147516	222	171
18:00	0.80	206.65	2.17	225504	174212	148076	227	165
19:00	0.78	147.43	1.11	229192	178988	152136	234	166
20:00	0.54	214.67	0.48	225952	177200	150616	226	166
21:00	0.48	235.71	0.39	224872	176480	150008	226	165
22:00	0.50	258.10	0.55	223596	173388	147380	226	166
23:00	0.68	223.06	0.83	223888	175756	149392	228	167
24:00	1.17	227.48	2.58	222688	168776	143460	235	167
Average	0.72	165.00	6.50	219428	171870	146088	224	170
Maximum	3.39	258.00	28.00	229192	184828	157104	270	174
Minimum	0.20	68.00	0.40	178892	125750	106886	203	165
Rolling	2.13	164.00	13.10	210081	164307	139660	223	170
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0	0
OC	0	0	0	0	0	0	0	0
CAL	0	0	0	0	0	0	0	0
Bad Per	0	0	0	0	0	0	0	0
MUT %	99.58	99.58	94.72	99.72	100.00	100.00	99.72	99.72
MDT Per	3	3	38	2	0	0	2	2

Key:
 U, UD User Disable F, IF Instrument Failure C, Cal Calibration
 R, OC Out of Control N, ND No Data M, MNR Monitoring Not Required
 V, Valid Valid Data W, Warning Drift Warning

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 07/31/2001

Time	Clinker Prod. Tons/Hr. Avg. T7	Kiln SO2 SO2 Lbs./Hr. Avg T11	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	86.40	1.56	ND	249.18	2.88	3.06	ND
02:00	86.40	1.96	ND	266.39	3.08	5.28	ND
03:00	86.40	2.22	ND	244.29	2.83	7.70	ND
04:00	86.40	1.26	ND	190.40	2.20	6.07	ND
05:00	86.40	1.42	ND	191.25	2.21	5.96	ND
06:00	86.40	1.34	ND	101.33	1.17	10.92	ND
07:00	86.40	0.33	ND	145.16	1.68	OC	ND
08:00	86.40	0.11	ND	167.80	1.94	OC	ND
09:00	86.40	0.11	ND	222.57	2.58	OC	ND
10:00	86.40	0.12	ND	237.65	2.75	7.27	ND
11:00	86.40	0.15	ND	182.38	2.11	9.17	ND
12:00	86.40	0.12	ND	174.79	2.02	9.58	ND
13:00	86.40	0.19	ND	142.46	1.65	14.56	ND
14:00	86.40	0.34	ND	201.55	2.33	11.99	ND
15:00	86.40	0.12	ND	282.66	3.27	9.70	ND
16:00	86.40	0.12	ND	276.80	3.20	5.56	ND
17:00	86.40	0.11	ND	179.15	2.07	7.66	ND
18:00	86.40	0.16	ND	163.70	1.89	4.65	ND
19:00	86.40	0.33	ND	134.61	1.56	4.74	ND
20:00	86.40	0.35	ND	147.18	1.70	7.87	ND
21:00	86.40	0.61	ND	124.72	1.44	8.16	ND
22:00	86.40	0.87	ND	103.53	1.20	9.51	ND
23:00	86.40	0.90	ND	71.65	0.83	8.44	ND
24:00	86.40	1.01	ND	73.22	0.85	8.10	ND
Total	2073.60	15.70	INS	4274.80	49.44	193.60	INS
Average	86.40	0.70	INS	178.10	2.06	8.10	INS
Maximum	86.40	2.20	INS	282.70	3.27	14.60	INS
Minimum	86.40	0.10	INS	71.70	0.83	3.10	INS
Rolling Excess	96.00	2.10	MNR	166.40	1.76	14.70	MNR
		0	0	0	0	0	0
Uptm %	100.00	100.00	0.00	100.00	100.00	87.50	0.00
# Per	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0
ND	0	0	24	0	0	0	24
OC	1	0	0	0	0	3	0
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	100.00	99.60	0.00	99.60	99.60	94.49	0.00
MDT Per	0	3	744	3	3	41	744

Key:
 U, UD User Disable F, IF Instrument Failure C, Cal Calibration
 R, OC Out of Control N, ND No Data M, MNR Monitoring Not Required
 V, Valid Valid Data W, Warning Drift Warning

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Emissions Data

Daily Report for 07/31/2001

Time	Kiln SO2 SO2 ppm Avg.	Kiln NOx NOx ppm Avg.	Kiln THC THC ppm Avg.	Kiln Flow ACFM Avg.	Kiln Flow Flow SCFM Avg.	Kiln Flow DSCFM Avg.	Kiln Temp. Deg. F Avg.	Coal Mill Temp. Deg. F Avg.
01:00	1.08	238.61	2.60	223640	170480	144908	233	167
02:00	1.44	275.13	5.05	211500	123364	104860	239	166
03:00	2.20	337.03	9.42	165156	118966	101120	278	165
04:00	1.08	228.00	6.56	188668	162432	138068	261	165
05:00	1.02	192.56	5.27	211644	170508	144932	228	166
06:00	0.95	100.08	9.58	213776	126458	107490	224	165
07:00	0.32	198.91	OC	162684	111076	94414	268	150
08:00	0.10	210.73	OC	177276	138308	117562	256	159
09:00	0.09	253.25	OC	191528	146488	124514	246	161
10:00	0.10	271.91	7.55	192000	129856	110376	247	171
11:00	0.13	228.36	10.18	179804	144108	122488	264	171
12:00	0.12	232.34	11.36	166728	112614	95722	258	169
13:00	0.19	199.50	18.13	160048	117460	99840	266	173
14:00	0.35	285.24	15.07	157904	120426	102358	264	168
15:00	0.12	398.63	12.14	157588	114466	97294	260	160
16:00	0.10	294.77	5.29	203456	153860	130782	239	169
17:00	0.10	232.83	8.86	175316	142648	121250	259	170
18:00	0.12	166.59	4.27	215408	172836	146916	237	171
19:00	0.23	129.77	4.08	219832	168976	143632	227	172
20:00	0.25	142.98	6.78	218952	173344	147344	228	173
21:00	0.42	118.92	6.89	219284	170772	145152	216	174
22:00	0.59	98.05	7.99	218632	169644	144192	210	174
23:00	0.62	68.40	7.15	218652	170996	145348	216	174
24:00	0.69	69.53	6.82	219128	184792	157072	213	172
Average	0.52	207.00	8.20	194525	146453	124485	243	168
Maximum	2.20	399.00	18.10	223640	184792	157072	278	174
Minimum	0.09	68.00	2.60	157588	111076	94414	210	150
Rolling	2.13	166.00	13.10	208656	162864	138434	224	169
Uptm %	100.00	100.00	87.50	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0	0
OC	0	0	3	0	0	0	0	0
CAL	0	0	0	0	0	0	0	0
Bad Per	0	0	0	0	0	0	0	0
MUT %	99.60	99.60	94.49	99.73	100.00	100.00	99.73	99.73
MDT Per	3	3	41	2	0	0	2	2

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required