


September 2001 - Daily 30 Day Rolling Avg. NOx Lbs./Ton of Clinker

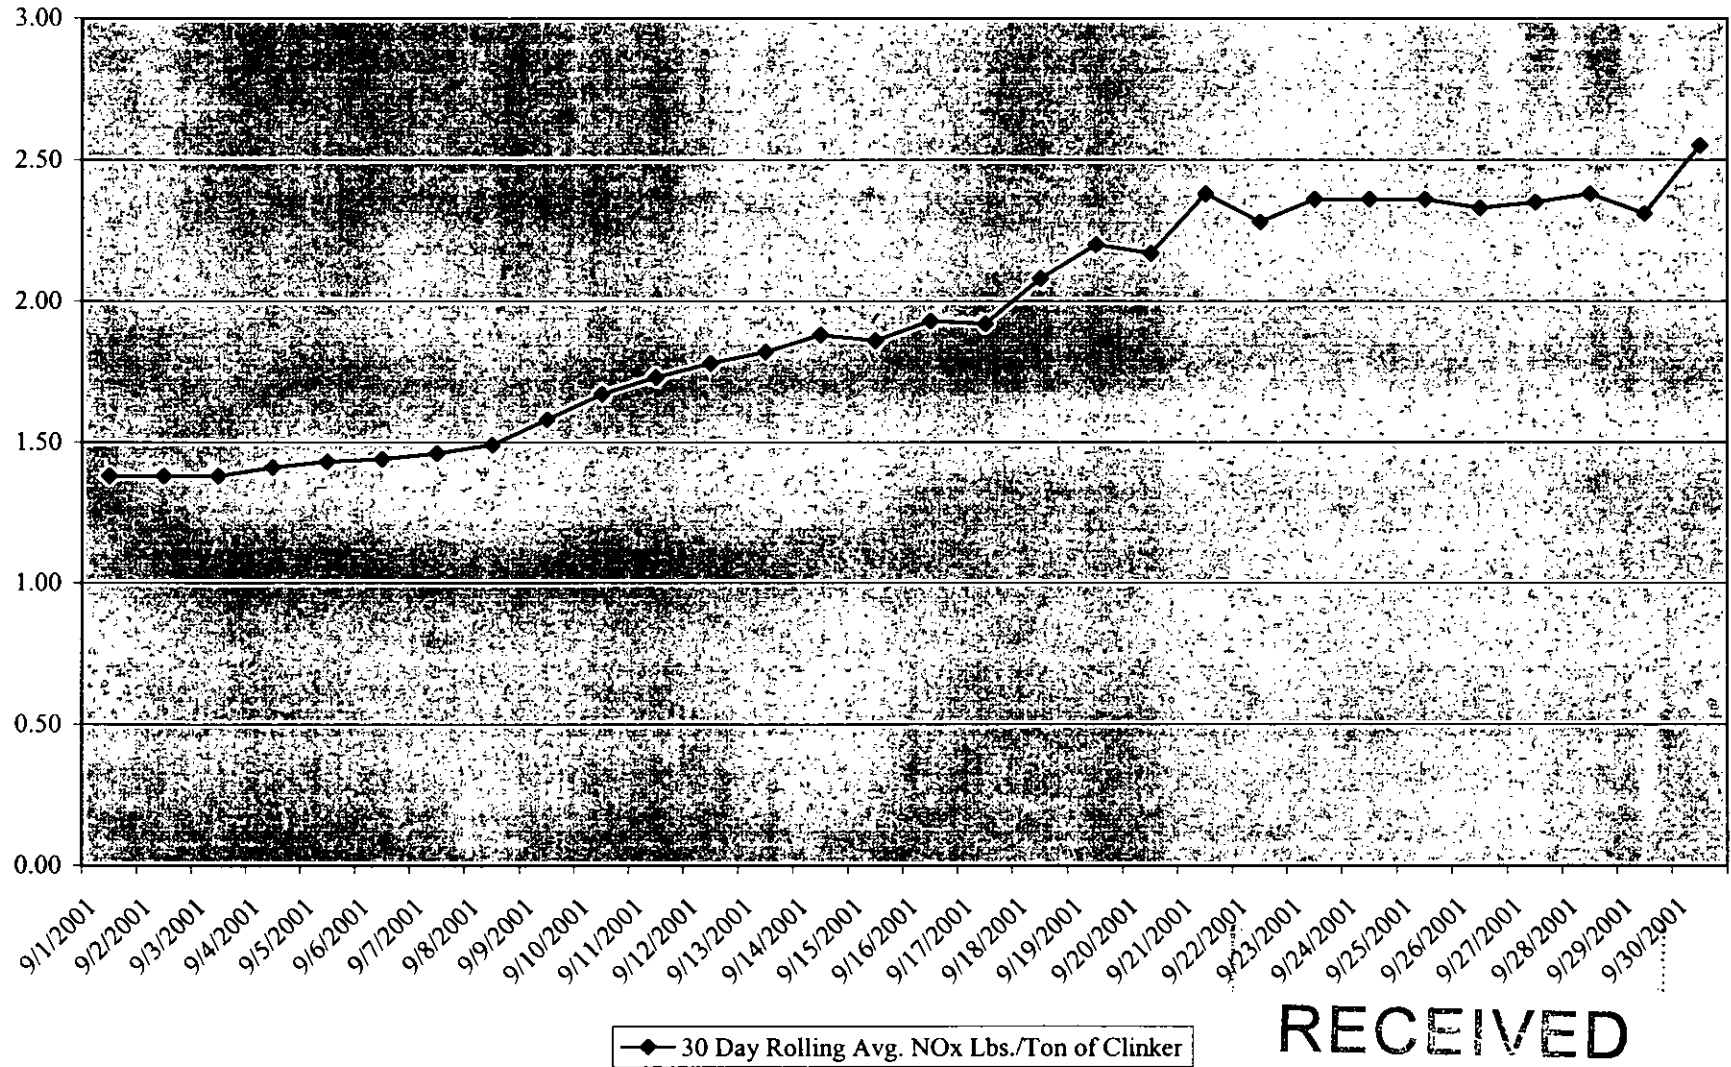

RECEIVED

APR 11 2002

BUREAU OF AIR REGULATION

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 09/01/2001

Time	Clinker Prod. Tons/Hr. Avg.	Kiln SO2 SO2 Lbs./Hr. Avg.	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	ND	ND	ND	ND	ND	ND	ND
02:00	ND	ND	ND	ND	ND	ND	ND
03:00	ND	ND	ND	ND	ND	ND	ND
04:00	ND	ND	ND	ND	ND	ND	ND
05:00	ND	ND	ND	ND	ND	ND	ND
06:00	ND	ND	ND	ND	ND	ND	ND
07:00	ND	ND	ND	ND	ND	ND	ND
08:00	ND	ND	ND	ND	ND	ND	ND
09:00	ND	ND	ND	ND	ND	ND	ND
10:00	ND	ND	ND	ND	ND	ND	ND
11:00	ND	ND	ND	ND	ND	ND	ND
12:00	ND	ND	ND	ND	ND	ND	ND
13:00	ND	ND	ND	ND	ND	ND	ND
14:00	ND	ND	ND	ND	ND	ND	ND
15:00	ND	ND	ND	ND	ND	ND	ND
16:00	ND	ND	ND	ND	ND	ND	ND
17:00	ND	ND	ND	ND	ND	ND	ND
18:00	ND	ND	ND	ND	ND	ND	ND
19:00	ND	ND	ND	ND	ND	ND	ND
20:00	ND	ND	ND	ND	ND	ND	ND
21:00	ND	ND	ND	ND	ND	ND	ND
22:00	ND	ND	ND	ND	ND	ND	ND
23:00	ND	ND	ND	ND	ND	ND	ND
24:00	ND	ND	ND	ND	ND	ND	ND
Total	INS	INS	INS	INS	INS	INS	INS
Average	INS	INS	INS	INS	INS	INS	INS
Maximum	INS	INS	INS	INS	INS	INS	INS
Minimum	INS	INS	INS	INS	INS	INS	INS
Rolling Excess	89.32	2.87	0.034	124.88	1.38	19.46	0.03
		0	0	0	0	0	0
Uptm %	0.00	0.00	0.00	0.00	0.00	0.00	0.00
# Per	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0
ND	24	24	24	24	24	24	24
OC		0	0	0	0	0	0
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	0.00	0.00	0.00	0.00	0.00	0.00	0.00
MDT Per	24	24	24	24	24	24	24

Key: U, UD User Disable F, IF Instrument Failure C, Cal Calibration
R, OC Out of Control N, ND No Data M, MNR Monitoring Not Required
V, Valid W, Warning Drift Warning

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Emissions Data

Daily Report for 09/01/2001

Time	Kiln SO2 SO2 ppm Avg.	Kiln NOx NOx ppm Avg.	Kiln THC THC ppm Avg.	Kiln Flow ACFM Avg.	Kiln Flow Flow SCFM Avg.	Kiln Flow Flow DSCFM Avg.	Kiln Temp. Deg. F Avg.	Coal Mill Temp. Deg. F Avg.
01:00	ND	ND	ND	ND	ND	ND	ND	ND
02:00	ND	ND	ND	ND	ND	ND	ND	ND
03:00	ND	ND	ND	ND	ND	ND	ND	ND
04:00	ND	ND	ND	ND	ND	ND	ND	ND
05:00	ND	ND	ND	ND	ND	ND	ND	ND
06:00	ND	ND	ND	ND	ND	ND	ND	ND
07:00	ND	ND	ND	ND	ND	ND	ND	ND
08:00	ND	ND	ND	ND	ND	ND	ND	ND
09:00	ND	ND	ND	ND	ND	ND	ND	ND
10:00	ND	ND	ND	ND	ND	ND	ND	ND
11:00	ND	ND	ND	ND	ND	ND	ND	ND
12:00	ND	ND	ND	ND	ND	ND	ND	ND
13:00	ND	ND	ND	ND	ND	ND	ND	ND
14:00	ND	ND	ND	ND	ND	ND	ND	ND
15:00	ND	ND	ND	ND	ND	ND	ND	ND
16:00	ND	ND	ND	ND	ND	ND	ND	ND
17:00	ND	ND	ND	ND	ND	ND	ND	ND
18:00	ND	ND	ND	ND	ND	ND	ND	ND
19:00	ND	ND	ND	ND	ND	ND	ND	ND
20:00	ND	ND	ND	ND	ND	ND	ND	ND
21:00	ND	ND	ND	ND	ND	ND	ND	ND
22:00	ND	ND	ND	ND	ND	ND	ND	ND
23:00	ND	ND	ND	ND	ND	ND	ND	ND
24:00	ND	ND	ND	ND	ND	ND	ND	ND
Average	INS	INS	INS	INS	INS	INS	INS	INS
Maximum	INS	INS	INS	INS	INS	INS	INS	INS
Minimum	INS	INS	INS	INS	INS	INS	INS	INS
Rolling	2.55	128.27	17.02	202249	158621	134827	223	158
Uptm %	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
# Per	24	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0	0
ND	24	24	24	24	24	24	24	24
OC	0	0	0	0	0	0	0	0
CAL	0	0	0	0	0	0	0	0
Bad Per	0	0	0	0	0	0	0	0
MUT %	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
MDT Per	24	24	24	24	24	24	24	24

Key:
U, UD
R, OC
V, Valid

User Disable
Out of Control
Valid Data

F, IF
N, ND
W, Warning

Instrument Failure
No Data
Drift Warning

C, Cal
M, MNR

Calibration
Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 09/02/2001

Time	Clinker Prod. Tons/Hr. Avg.	Kiln SO2 SO2 Lbs./Hr. Avg.	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	ND	ND	ND	ND	ND	ND	ND
02:00	ND	ND	ND	ND	ND	ND	ND
03:00	ND	ND	ND	ND	ND	ND	ND
04:00	ND	ND	ND	ND	ND	ND	ND
05:00	ND	ND	ND	ND	ND	ND	ND
06:00	ND	ND	ND	ND	ND	ND	ND
07:00	ND	ND	ND	ND	ND	ND	ND
08:00	ND	ND	ND	ND	ND	ND	ND
09:00	ND	ND	ND	ND	ND	ND	ND
10:00	ND	ND	ND	ND	ND	ND	ND
11:00	ND	ND	ND	ND	ND	ND	ND
12:00	ND	ND	ND	ND	ND	ND	ND
13:00	ND	ND	ND	ND	ND	ND	ND
14:00	ND	ND	ND	ND	ND	ND	ND
15:00	ND	ND	ND	ND	ND	ND	ND
16:00	ND	ND	ND	ND	ND	ND	ND
17:00	ND	ND	ND	ND	ND	ND	ND
18:00	ND	ND	ND	ND	ND	ND	ND
19:00	ND	ND	ND	ND	ND	ND	ND
20:00	ND	ND	ND	ND	ND	ND	ND
21:00	ND	ND	ND	ND	ND	ND	ND
22:00	ND	ND	ND	ND	ND	ND	ND
23:00	ND	ND	ND	ND	ND	ND	ND
24:00	ND	ND	ND	ND	ND	ND	ND
Total	INS	INS	INS	INS	INS	INS	INS
Average	INS	INS	INS	INS	INS	INS	INS
Maximum	INS	INS	INS	INS	INS	INS	INS
Minimum	INS	INS	INS	INS	INS	INS	INS
Rolling	89.32	2.87	0.034	124.88	1.38	19.46	0.03
Excess		0	0	0	0	0	0
Uptm %	0.00	0.00	0.00	0.00	0.00	0.00	0.00
# Per	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0
ND	24	24	24	24	24	24	24
OC		0	0	0	0	0	0
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	0.00	0.00	0.00	0.00	0.00	0.00	0.00
MDT Per	48	48	48	48	48	48	48

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Emissions Data

Daily Report for 09/02/2001

Time	Kiln SO2 SO2 ppm Avg.	Kiln NOx NOx ppm Avg.	Kiln THC THC ppm Avg.	Kiln Flow ACFM Avg.	Kiln Flow Flow SCFM Avg.	Kiln Flow DSCFM Avg.	Kiln Temp. Deg. F Avg.	Coal Mill Temp. Deg. F Avg.
01:00	ND	ND	ND	ND	ND	ND	ND	ND
02:00	ND	ND	ND	ND	ND	ND	ND	ND
03:00	ND	ND	ND	ND	ND	ND	ND	ND
04:00	ND	ND	ND	ND	ND	ND	ND	ND
05:00	ND	ND	ND	ND	ND	ND	ND	ND
06:00	ND	ND	ND	ND	ND	ND	ND	ND
07:00	ND	ND	ND	ND	ND	ND	ND	ND
08:00	ND	ND	ND	ND	ND	ND	ND	ND
09:00	ND	ND	ND	ND	ND	ND	ND	ND
10:00	ND	ND	ND	ND	ND	ND	ND	ND
11:00	ND	ND	ND	ND	ND	ND	ND	ND
12:00	ND	ND	ND	ND	ND	ND	ND	ND
13:00	ND	ND	ND	ND	ND	ND	ND	ND
14:00	ND	ND	ND	ND	ND	ND	ND	ND
15:00	ND	ND	ND	ND	ND	ND	ND	ND
16:00	ND	ND	ND	ND	ND	ND	ND	ND
17:00	ND	ND	ND	ND	ND	ND	ND	ND
18:00	ND	ND	ND	ND	ND	ND	ND	ND
19:00	ND	ND	ND	ND	ND	ND	ND	ND
20:00	ND	ND	ND	ND	ND	ND	ND	ND
21:00	ND	ND	ND	ND	ND	ND	ND	ND
22:00	ND	ND	ND	ND	ND	ND	ND	ND
23:00	ND	ND	ND	ND	ND	ND	ND	ND
24:00	ND	ND	ND	ND	ND	ND	ND	ND
Average	INS	INS	INS	INS	INS	INS	INS	INS
Maximum	INS	INS	INS	INS	INS	INS	INS	INS
Minimum	INS	INS	INS	INS	INS	INS	INS	INS
Rolling	2.55	128.27	17.02	202249	158621	134827	223	158
Uptm %	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
# Per	24	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0	0
ND	24	24	24	24	24	24	24	24
OC	0	0	0	0	0	0	0	0
CAL	0	0	0	0	0	0	0	0
Bad Per	0	0	0	0	0	0	0	0
MUT %	0.00	0.00	0.00	0.00	0.00	0.00	0.00	0.00
MDT Per	48	48	48	48	48	48	48	48

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 09/03/2001

Time	Clinker Prod. Tons/Hr. Avg.	Kiln SO2 SO2 Lbs./Hr. Avg.	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	ND	ND	ND	ND	ND	ND	ND
02:00	ND	ND	ND	ND	ND	ND	ND
03:00	ND	ND	ND	ND	ND	ND	ND
04:00	ND	ND	ND	ND	ND	ND	ND
05:00	ND	ND	ND	ND	ND	ND	ND
06:00	ND	ND	ND	ND	ND	ND	ND
07:00	ND	ND	ND	ND	ND	ND	ND
08:00	ND	ND	ND	ND	ND	ND	ND
09:00	ND	ND	ND	ND	ND	ND	ND
10:00	ND	ND	ND	ND	ND	ND	ND
11:00	ND	ND	ND	ND	ND	ND	ND
12:00	ND	ND	ND	ND	ND	ND	ND
13:00	ND	ND	ND	ND	ND	ND	ND
14:00	ND	ND	ND	ND	ND	ND	ND
15:00	ND	ND	ND	ND	ND	ND	ND
16:00	ND	ND	ND	ND	ND	ND	ND
17:00	ND	ND	ND	ND	ND	ND	ND
18:00	ND	ND	ND	ND	ND	ND	ND
19:00	94.42	0.19	0.002	177.80	1.88	4.95	0.05
20:00	94.36	0.15	0.002	190.30	2.02	3.72	0.04
21:00	93.24	0.13	0.001	194.13	2.08	3.44	0.04
22:00	92.25	0.34	0.004	158.32	1.72	7.64	0.08
23:00	93.91	0.28	0.003	156.80	1.67	9.06	0.10
24:00	94.39	0.27	0.003	174.66	1.85	7.21	0.08
Total	562.57	1.37	0.015	1052.01	11.22	36.02	0.38
Average	93.76	0.23	0.003	175.34	1.87	6.00	0.06
Maximum	94.42	0.34	0.004	194.13	2.08	9.06	0.10
Minimum	92.25	0.13	0.001	156.80	1.67	3.44	0.04
Rolling Excess	89.89	2.84	0.023	125.95	1.38	19.34	0.04
Excess		0	0	0	0	0	0
Uptm %	25.00	25.00	25.00	25.00	25.00	25.00	25.00
# Per	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0
ND	18	18	18	18	18	18	18
OC		0	0	0	0	0	0
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	8.33	8.33	8.33	8.33	8.33	8.33	8.33
MDT Per	66	66	66	66	66	66	66

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Emissions Data

Daily Report for 09/03/2001

Time	Kiln SO2 SO2 ppm Avg.	Kiln NOx NOx ppm Avg.	Kiln THC THC ppm Avg.	Kiln Flow ACFM Avg.	Kiln Flow Flow SCFM Avg.	Kiln Flow DSCFM Avg.	Kiln Temp. Deg. F Avg.	Coal Mill Temp. Deg. F Avg.
01:00	ND	ND	ND	ND	ND	ND	ND	ND
02:00	ND	ND	ND	ND	ND	ND	ND	ND
03:00	ND	ND	ND	ND	ND	ND	ND	ND
04:00	ND	ND	ND	ND	ND	ND	ND	ND
05:00	ND	ND	ND	ND	ND	ND	ND	ND
06:00	ND	ND	ND	ND	ND	ND	ND	ND
07:00	ND	ND	ND	ND	ND	ND	ND	ND
08:00	ND	ND	ND	ND	ND	ND	ND	ND
09:00	ND	ND	ND	ND	ND	ND	ND	ND
10:00	ND	ND	ND	ND	ND	ND	ND	ND
11:00	ND	ND	ND	ND	ND	ND	ND	ND
12:00	ND	ND	ND	ND	ND	ND	ND	ND
13:00	ND	ND	ND	ND	ND	ND	ND	ND
14:00	ND	ND	ND	ND	ND	ND	ND	ND
15:00	ND	ND	ND	ND	ND	ND	ND	ND
16:00	ND	ND	ND	ND	ND	ND	ND	ND
17:00	ND	ND	ND	ND	ND	ND	ND	ND
18:00	ND	ND	ND	ND	ND	ND	ND	ND
19:00	0.13	168.55	4.20	216320	170352	144796	205	175
20:00	0.10	181.10	3.14	215296	161680	137432	203	176
21:00	0.09	187.45	2.95	212420	169888	144408	204	178
22:00	0.24	152.70	6.55	212716	163656	139104	205	179
23:00	0.20	153.20	7.86	210780	163936	139344	207	178
24:00	0.19	167.09	6.14	215616	163948	139352	208	179
Average	0.16	168.00	5.14	213858	165577	140739	205	178
Maximum	0.24	187.00	7.86	216320	170352	144796	208	179
Minimum	0.09	153.00	2.95	210780	161680	137432	203	175
Rolling	2.49	130.00	16.85	201770	159345	135443	223	158
Uptm %	25.00	25.00	25.00	25.00	25.00	25.00	25.00	25.00
# Per	24	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0	0
ND	18	18	18	18	18	18	18	18
OC	0	0	0	0	0	0	0	0
CAL	0	0	0	0	0	0	0	0
Bad Per	0	0	0	0	0	0	0	0
MUT %	8.33	8.33	8.33	8.33	8.33	8.33	8.33	8.33
MDT Per	66	66	66	66	66	66	66	66

Key:
U, UD
R, OC
V, Valid

User Disable
Out of Control
Valid Data

F, IF
N, ND
W, Warning

Instrument Failure
No Data
Drift Warning

C, Cal
M, MNR

Calibration
Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 09/04/2001

Time	Clinker Prod. Tons/Hr. Avg.	Kiln SO2 SO2 Lbs./Hr. Avg.	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	93.88	0.45	0.005	178.72	1.90	7.15	0.08
02:00	93.87	0.15	0.002	150.89	1.61	11.01	0.12
03:00	93.91	0.13	0.001	148.56	1.58	10.46	0.11
04:00	94.42	0.20	0.002	149.30	1.58	9.37	0.10
05:00	94.37	0.35	0.004	176.94	1.87	7.45	0.08
06:00	93.36	0.32	0.003	176.67	1.89	8.61	0.09
07:00	94.43	0.65	0.007	191.64	2.03	5.75	0.06
08:00	94.39	0.11	0.001	193.82	2.05	8.19	0.09
09:00	93.87	0.13	0.001	157.26	1.68	9.22	0.10
10:00	93.91	0.12	0.001	162.85	1.73	9.52	0.10
11:00	94.39	0.12	0.001	172.85	1.83	7.67	0.08
12:00	93.88	0.12	0.001	161.79	1.72	9.39	0.10
13:00	93.91	0.21	0.002	165.29	1.76	10.46	0.11
14:00	94.39	0.16	0.002	227.23	2.41	8.63	0.09
15:00	93.91	0.12	0.001	221.73	2.36	7.23	0.08
16:00	94.40	0.12	0.001	228.34	2.42	8.13	0.09
17:00	93.91	0.12	0.001	212.05	2.26	9.67	0.10
18:00	94.37	0.34	0.004	253.47	2.69	6.07	0.06
19:00	93.35	0.61	0.007	264.90	2.84X	3.84	0.04
20:00	94.42	0.57	0.006	271.27X	2.87X	3.25	0.03
21:00	94.39	0.73	0.008	281.93X	2.99X	3.66	0.04
22:00	93.88	1.18	0.013	273.20X	2.91X	3.69	0.04
23:00	93.91	1.12	0.012	257.98	2.75	3.82	0.04
24:00	94.40	0.58	0.006	284.51X	3.01X	3.59	0.04
Total	2257.92	8.69	0.092	4963.19	52.74	175.83	1.87
Average	94.08	0.36	0.004	206.80	2.20	7.33	0.08
Maximum	94.43	1.18	0.013	284.51	3.01	11.01	0.12
Minimum	93.35	0.11	0.001	148.56	1.58	3.25	0.03
Rolling	90.46	2.81	0.019	128.85	1.41	19.30	0.05
Excess		0	0	4	5	0	0
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0
OC		0	0	0	0	0	0
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	31.25	31.25	31.25	31.25	31.25	31.25	31.25
MDT Per	66	66	66	66	66	66	66

Key:
 U, UD User Disable F, IF Instrument Failure C, Cal Calibration
 R, OC Out of Control N, ND No Data M, MNR Monitoring Not Required
 V, Valid Valid Data W, Warning Drift Warning

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Emissions Data

Daily Report for 09/04/2001

Time	Kiln SO2 SO2 ppm Avg.	Kiln NOx NOx ppm Avg.	Kiln THC THC ppm Avg.	Kiln Flow ACFM Avg.	Kiln Flow Flow SCFM Avg.	Kiln Flow Flow DSCFM Avg.	Kiln Temp. Deg. F Avg.	Coal Mill Temp. Deg. F Avg.
01:00	0.32	173.84	6.17	211316	177304	150704	205	180
02:00	0.10	146.10	9.51	212060	168340	143084	205	178
03:00	0.09	142.83	8.90	213436	172492	146616	204	179
04:00	0.14	142.94	7.96	214632	162868	138436	206	180
05:00	0.24	170.79	6.38	213144	173500	147476	206	179
06:00	0.22	171.15	7.41	212700	160300	136256	207	178
07:00	0.45	186.98	4.99	211300	140752	119638	205	176
08:00	0.09	225.14	8.44	192200	142840	121416	263	176
09:00	0.10	172.87	8.99	198432	149864	127384	246	176
10:00	0.09	173.03	8.97	203508	156452	132984	240	177
11:00	0.09	186.73	7.35	199364	156852	133320	237	178
12:00	0.10	175.41	9.02	198520	151084	128422	236	180
13:00	0.16	177.10	9.94	200896	150924	128286	237	179
14:00	0.12	239.68	8.08	204112	157632	133988	237	180
15:00	0.09	241.32	6.98	197664	152136	129314	236	178
16:00	0.09	249.04	7.86	197196	150588	127998	236	177
17:00	0.09	237.94	9.47	193836	142820	121396	235	176
18:00	0.23	233.00	5.02	227292	179644	152696	218	175
19:00	0.38	230.78	2.97	238044	192856	163924	211	176
20:00	0.35	230.98	2.45	242404	197224	167640	208	175
21:00	0.45	242.46	2.79	240460	191244	162556	209	174
22:00	0.72	232.73	2.79	241676	183708	156148	207	175
23:00	0.69	220.93	2.90	241536	190112	161596	209	175
24:00	0.35	241.39	2.70	242776	189632	161188	207	175
Average	0.24	202.00	6.58	214521	166299	141353	221	177
Maximum	0.72	249.00	9.94	242776	197224	167640	263	180
Minimum	0.09	143.00	2.45	192200	140752	119638	204	174
Rolling	2.46	131.00	16.82	202678	159355	135451	222	158
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0	0
OC	0	0	0	0	0	0	0	0
CAL	0	0	0	0	0	0	0	0
Bad Per	0	0	0	0	0	0	0	0
MUT %	31.25	31.25	31.25	31.25	31.25	31.25	31.25	31.25
MDT Per	66	66	66	66	66	66	66	66

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 09/05/2001

Time	Clinker Prod. Tons/Hr. Avg.	Kiln SO2 SO2 Lbs./Hr. Avg.	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	93.91	0.20	0.002	284.67X	3.03X	2.93	0.03
02:00	94.40	0.35	0.004	271.88X	2.88X	3.36	0.04
03:00	93.88	0.43	0.005	286.00X	3.05X	3.30	0.04
04:00	93.91	0.37	0.004	312.78X	3.33X	3.26	0.03
05:00	94.40	0.41	0.004	299.21X	3.17X	4.19	0.04
06:00	93.88	0.67	0.007	294.12X	3.13X	5.19	0.06
07:00	93.91	0.67	0.007	323.91X	3.45X	5.77	0.06
08:00	94.43	0.61	0.006	307.70X	3.26X	6.27	0.07
09:00	94.39	0.34	0.004	293.86X	3.11X	1.65	0.02
10:00	93.85	0.77	0.008	279.63X	2.98X	0.42	0.00
11:00	93.90	1.39	0.015	296.21X	3.15X	0.24	0.00
12:00	94.38	2.24	0.024	311.06X	3.30X	0.49	0.01
13:00	93.87	1.76	0.019	336.66X	3.59X	0.20	0.00
14:00	93.91	1.59	0.017	337.78X	3.60X	0.32	0.00
15:00	94.39	0.38	0.004	330.40X	3.50X	0.31	0.00
16:00	93.87	0.71	0.008	345.52X	3.68X	0.67	0.01
17:00	93.91	0.32	0.003	314.78X	3.35X	1.59	0.02
18:00	94.43	0.25	0.003	281.07X	2.98X	2.86	0.03
19:00	94.37	0.23	0.002	298.58X	3.16X	0.85	0.01
20:00	93.36	0.17	0.002	300.91X	3.22X	0.23	0.00
21:00	94.44	0.17	0.002	246.83	2.61	1.13	0.01
22:00	94.41	0.19	0.002	279.41X	2.96X	1.14	0.01
23:00	93.88	0.16	0.002	254.09	2.71	2.54	0.03
24:00	93.88	0.24	0.003	284.11X	3.03X	2.35	0.03
Total	2257.96	14.61	0.157	7171.17	76.23	51.26	0.54
Average	94.08	0.61	0.007	298.80	3.18	2.14	0.02
Maximum	94.44	2.24	0.024	345.52	3.68	6.27	0.07
Minimum	93.36	0.16	0.002	246.83	2.61	0.20	0.00
Rolling Excess	91.04	2.78	0.016	132.50	1.43	18.95	0.05
		0	0	22	22	0	0
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0
OC	0	0	0	0	0	0	0
CAL	0	0	0	0	0	0	0
Bad Per	0	0	0	0	0	0	0
MUT %	45.00	45.00	45.00	45.00	45.00	45.00	45.00
MDT Per	66	66	66	66	66	66	66

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Emissions Data

Daily Report for 09/05/2001

Time	Kiln SO2 SO2 ppm Avg.	Kiln NOx NOx ppm Avg.	Kiln THC THC ppm Avg.	Kiln Flow ACFM Avg.	Kiln Flow Flow SCFM Avg.	Kiln Flow Flow DSCFM Avg.	Kiln Temp. Deg. F Avg.	Coal Mill Temp. Deg. F Avg.
01:00	0.12	245.58	2.24	241304	188300	160052	214	174
02:00	0.22	235.01	2.58	240040	195344	166040	211	175
03:00	0.26	244.85	2.51	241028	188928	160588	208	175
04:00	0.23	269.69	2.49	240596	197416	167800	211	175
05:00	0.25	256.89	3.19	239528	186752	158736	206	175
06:00	0.41	251.95	3.94	238540	192640	163744	202	175
07:00	0.42	278.96	4.40	240864	194440	165276	211	175
08:00	0.38	263.39	4.77	241392	190264	161720	209	175
09:00	0.21	252.10	1.25	241652	185284	157496	211	175
10:00	0.47	239.70	0.32	240812	189876	161392	208	177
11:00	0.85	251.92	0.18	241404	191032	162376	205	178
12:00	1.36	264.09	0.37	240896	192484	163612	201	179
13:00	1.08	288.46	0.16	238672	189772	161304	202	179
14:00	0.98	290.68	0.24	238444	191092	162428	204	179
15:00	0.23	279.12	0.23	243772	195900	166512	207	178
16:00	0.44	296.09	0.51	240036	193516	164492	206	179
17:00	0.20	268.88	1.21	240416	190720	162112	205	179
18:00	0.15	243.40	2.20	236000	191796	163020	202	178
19:00	0.14	260.02	0.65	235100	191392	162684	203	174
20:00	0.10	259.34	0.18	237188	185180	157396	202	172
21:00	0.11	215.09	0.88	234896	187388	159276	202	175
22:00	0.12	242.28	0.87	236980	189448	161032	205	176
23:00	0.10	228.03	2.02	235852	167784	142616	226	176
24:00	0.16	259.33	1.91	230904	187036	158980	223	173
Average	0.37	258.00	1.64	239013	189741	161279	208	176
Maximum	1.36	296.00	4.77	243772	197416	167800	226	179
Minimum	0.10	215.00	0.16	230904	167784	142616	201	172
Rolling	2.44	135.00	16.49	203626	160134	136114	222	159
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0	0
OC	0	0	0	0	0	0	0	0
CAL	0	0	0	0	0	0	0	0
Bad Per	0	0	0	0	0	0	0	0
MUT %	45.00	45.00	45.00	45.00	45.00	45.00	45.00	45.00
MDT Per	66	66	66	66	66	66	66	66

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 09/06/2001

Time	Clinker Prod. Tons/Hr. Avg.	Kiln SO2 SO2 Lbs./Hr. Avg.	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	93.92	0.21	0.002	300.73X	3.20X	3.67	0.04
02:00	94.44	0.15	0.002	286.71X	3.04X	3.31	0.04
03:00	94.39	0.18	0.002	266.59	2.82X	2.93	0.03
04:00	93.88	0.15	0.002	250.10	2.66	3.34	0.04
05:00	93.91	0.19	0.002	278.73X	2.97X	2.89	0.03
06:00	94.39	0.28	0.003	286.63X	3.04X	3.67	0.04
07:00	93.91	0.39	0.004	300.65X	3.20X	OC	OC
08:00	94.39	0.46	0.005	295.01X	3.13X	OC	OC
09:00	93.88	0.55	0.006	300.77X	3.20X	OC	OC
10:00	93.87	0.58	0.006	294.16X	3.13X	5.98	0.06
11:00	93.91	1.16	0.012	316.82X	3.37X	6.54	0.07
12:00	94.40	1.75	0.019	296.19X	3.14X	8.34	0.09
13:00	93.92	1.70	0.018	288.69X	3.07X	8.57	0.09
14:00	94.39	0.64	0.007	336.05X	3.56X	7.98	0.08
15:00	93.88	0.15	0.002	333.48X	3.55X	8.30	0.09
16:00	93.91	0.10	0.001	328.07X	3.49X	7.51	0.08
17:00	94.39	0.11	0.001	322.27X	3.41X	8.27	0.09
18:00	93.90	0.13	0.001	284.12X	3.03X	8.47	0.09
19:00	94.39	0.15	0.002	277.71X	2.94X	6.61	0.07
20:00	93.88	0.15	0.002	299.14X	3.19X	5.37	0.06
21:00	93.91	0.18	0.002	286.38X	3.05X	6.05	0.06
22:00	94.41	0.15	0.002	269.48X	2.85X	6.97	0.07
23:00	93.91	0.24	0.003	290.61X	3.10X	6.79	0.07
24:00	94.40	0.18	0.002	271.28X	2.87X	7.53	0.08
Total	2258.58	9.91	0.108	7060.37	75.01	129.09	1.37
Average	94.11	0.41	0.004	294.18	3.13	6.15	0.06
Maximum	94.44	1.75	0.019	336.05	3.56	8.57	0.09
Minimum	93.87	0.10	0.001	250.10	2.66	2.89	0.03
Rolling Excess	91.62	2.74	0.014	134.98	1.44	18.79	0.05
		0	0	22	23	0	0
Uptm %	100.00	100.00	100.00	100.00	100.00	87.50	87.50
# Per	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0
OC		0	0	0	0	3	3
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	54.17	54.17	54.17	54.17	54.17	52.08	52.08
MDT Per	66	66	66	66	66	69	69

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Emissions Data

Daily Report for 09/06/2001

Time	Kiln SO2 SO2 ppm Avg.	Kiln NOx NOx ppm Avg.	Kiln THC THC ppm Avg.	Kiln Flow ACFM Avg.	Kiln Flow Flow SCFM Avg.	Kiln Flow Flow DSCFM Avg.	Kiln Temp. Deg. F Avg.	Coal Mill Temp. Deg. F Avg.
01:00	0.13	258.52	2.80	239908	188720	160412	207	171
02:00	0.09	250.78	2.57	234968	189624	161184	205	170
03:00	0.11	232.53	2.26	236100	193516	164492	206	171
04:00	0.09	217.57	2.57	237028	190632	162036	207	171
05:00	0.12	240.35	2.21	238712	190424	161856	206	171
06:00	0.17	246.93	2.81	238988	183512	155988	207	172
07:00	0.24	261.14	OC	236104	186352	158396	204	170
08:00	0.28	254.95	OC	237756	181908	154620	205	171
09:00	0.34	261.73	OC	237656	199036	169184	209	171
10:00	0.36	252.85	4.56	238800	193472	164448	204	171
11:00	0.72	273.73	5.01	240512	191756	162988	213	173
12:00	1.13	264.75	6.62	235916	189688	161240	223	175
13:00	1.07	255.19	6.73	237616	177660	151008	220	175
14:00	0.44	349.85	7.32	212320	137112	116546	239	176
15:00	0.14	425.14	9.40	177520	130416	110852	273	174
16:00	0.09	409.16	8.31	176560	126762	107746	252	170
17:00	0.09	375.21	8.53	188636	153448	130428	246	171
18:00	0.09	282.91	7.40	216068	176000	149600	230	171
19:00	0.09	245.94	5.23	233572	193300	164300	210	170
20:00	0.09	260.41	4.14	238108	188808	160488	211	170
21:00	0.11	249.20	4.67	237092	181836	154556	208	171
22:00	0.09	239.03	5.48	234460	191296	162604	213	170
23:00	0.15	250.95	5.20	239456	195388	166080	209	171
24:00	0.11	236.94	5.84	236584	186668	158664	209	171
Average	0.26	275.00	5.22	228352	179889	152905	217	172
Maximum	1.13	425.00	9.40	240512	199036	169184	273	176
Minimum	0.09	218.00	2.21	176560	126762	107746	204	170
Rolling	2.41	138.00	16.29	204149	161097	136932	222	159
Uptm %	100.00	100.00	87.50	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0	0
OC	0	0	3	0	0	0	0	0
CAL	0	0	0	0	0	0	0	0
Bad Per	0	0	0	0	0	0	0	0
MUT %	54.17	54.17	52.08	54.17	54.17	54.17	54.17	54.17
MDT Per	66	66	69	66	66	66	66	66

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 09/07/2001

Time	Clinker Prod. Tons/Hr. Avg.	Kiln SO2 SO2 Lbs./Hr. Avg.	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	93.88	0.15	0.002	309.01X	3.29X	6.09	0.06
02:00	93.91	0.22	0.002	297.70X	3.17X	7.01	0.07
03:00	94.39	0.17	0.002	289.45X	3.07X	6.77	0.07
04:00	93.91	0.15	0.002	309.17X	3.29X	5.43	0.06
05:00	94.39	0.16	0.002	307.52X	3.26X	5.86	0.06
06:00	93.87	0.21	0.002	291.18X	3.10X	7.18	0.08
07:00	92.38	0.20	0.002	208.00	2.28	3.22	0.04
08:00	56.34	0.29	0.005	179.68	3.20X	21.25X	0.38X
09:00	69.26	0.36	0.005	164.03	2.36	16.49X	0.24X
10:00	79.92	0.57	0.007	195.93	2.45	16.50X	0.21X
11:00	86.75	0.77	0.009	213.18	2.46	18.51X	0.21X
12:00	92.82	1.20	0.013	233.10	2.51	13.03	0.14
13:00	94.43	1.24	0.013	220.81	2.34	15.19	0.16X
14:00	94.37	1.49	0.016	213.68	2.26	14.63	0.16
15:00	93.36	0.62	0.007	210.41	2.25	13.45	0.14
16:00	94.42	0.59	0.006	213.28	2.26	9.08	0.10
17:00	94.38	0.38	0.004	233.34	2.47	4.75	0.05
18:00	93.87	0.33	0.004	244.05	2.60	3.19	0.03
19:00	93.90	0.69	0.007	257.90	2.75	2.78	0.03
20:00	94.38	0.15	0.002	245.15	2.60	1.84	0.02
21:00	93.90	0.16	0.002	272.40X	2.90X	0.84	0.01
22:00	94.39	0.31	0.003	208.79	2.21	8.95	0.09
23:00	93.88	0.23	0.002	215.91	2.30	10.64	0.11
24:00	93.91	0.23	0.002	278.78X	2.97X	0.98	0.01
Total	2171.01	10.86	0.121	5812.45	64.35	213.66	2.53
Average	90.46	0.45	0.005	242.19	2.68	8.90	0.11
Maximum	94.43	1.49	0.016	309.17	3.29	21.25	0.38
Minimum	56.34	0.14	0.002	164.03	2.21	0.84	0.01
Rolling	91.87	2.72	0.013	137.36	1.46	18.83	0.06
Excess		0	0	8	9	4	5
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0
OC	0	0	0	0	0	0	0
CAL	0	0	0	0	0	0	0
Bad Per	0	0	0	0	0	0	0
MUT %	60.71	60.71	60.71	60.71	60.71	58.93	58.93
MDT Per	66	66	66	66	66	69	69

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Emissions Data

Daily Report for 09/07/2001

Time	Kiln SO2 SO2 ppm Avg.	Kiln NOx NOx ppm Avg.	Kiln THC THC ppm Avg.	Kiln Flow ACFM Avg.	Kiln Flow Flow SCFM Avg.	Kiln Flow Flow DSCFM Avg.	Kiln Temp. Deg. F Avg.	Coal Mill Temp. Deg. F Avg.
01:00	0.09	267.78	4.68	237976	189388	160984	208	170
02:00	0.13	260.09	5.43	235560	194024	164920	206	171
03:00	0.10	252.33	5.23	235608	189284	160892	205	170
04:00	0.09	269.77	4.20	234980	181332	154128	204	170
05:00	0.10	269.13	4.55	234740	192244	163408	205	171
06:00	0.13	251.87	5.51	237032	184616	156924	204	170
07:00	0.14	196.50	2.61	213784	164992	140240	206	172
08:00	0.20	171.95	18.27	213668	170500	144924	205	171
09:00	0.24	151.70	13.75	221832	185800	157928	207	171
10:00	0.37	180.54	13.37	223396	199208	169324	205	171
11:00	0.49	190.07	14.59	233388	186924	158888	213	174
12:00	0.77	208.16	10.34	236436	188464	160196	223	176
13:00	0.80	199.81	12.14	235436	176144	149720	229	175
14:00	0.99	200.84	12.33	228524	158316	134568	237	176
15:00	0.40	190.84	10.81	235932	182632	155236	232	176
16:00	0.39	197.60	7.47	228796	182032	154728	226	176
17:00	0.25	216.20	3.90	230068	177468	150852	230	175
18:00	0.22	221.56	2.57	232792	189452	161032	224	175
19:00	0.44	228.01	2.18	233348	189844	161368	208	172
20:00	0.09	216.05	1.43	232512	176552	150064	203	171
21:00	0.10	240.88	0.66	232572	187352	159248	206	169
22:00	0.19	181.84	6.88	236228	196084	166668	205	172
23:00	0.14	187.91	8.17	237600	192448	163576	209	172
24:00	0.15	242.63	0.76	236752	191572	162832	207	172
Average	0.29	217.00	7.16	231623	184445	156777	213	172
Maximum	0.99	270.00	18.27	237976	199208	169324	237	176
Minimum	0.09	152.00	0.66	213668	158316	134568	203	169
Rolling	2.38	137.00	16.31	205274	161516	137288	221	159
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0	0
OC	0	0	0	0	0	0	0	0
CAL	0	0	0	0	0	0	0	0
Bad Per	0	0	0	0	0	0	0	0
MUT %	60.71	60.71	58.93	60.71	60.71	60.71	60.71	60.71
MDT Per	66	66	69	66	66	66	66	66

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 09/08/2001

Time	Clinker Prod. Tons/Hr. Avg.	Kiln SO2 SO2 Lbs./Hr. Avg.	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	94.39	0.17	0.002	286.89X	3.04X	1.09	0.01
02:00	93.91	0.51	0.005	271.95X	2.90X	1.98	0.02
03:00	94.39	0.34	0.004	241.92	2.56	4.35	0.05
04:00	93.88	0.27	0.003	209.14	2.23	10.95	0.12
05:00	93.91	0.36	0.004	219.71	2.34	7.98	0.08
06:00	94.38	0.55	0.006	228.35	2.42	7.04	0.07
07:00	93.88	1.04	0.011	246.85	2.63	8.41	0.09
08:00	93.91	0.75	0.008	234.41	2.50	9.99	0.11
09:00	94.39	0.47	0.005	229.41	2.43	9.38	0.10
10:00	93.91	0.95	0.010	209.40	2.23	13.58	0.14
11:00	94.39	0.90	0.010	236.41	2.50	8.12	0.09
12:00	93.84	1.14	0.012	256.07	2.73	9.41	0.10
13:00	93.27	1.84	0.020	207.10	2.22	24.42X	0.26X
14:00	92.80	0.72	0.008	308.65X	3.33X	10.52	0.11
15:00	93.91	0.11	0.001	314.84X	3.35X	10.12	0.11
16:00	94.38	0.65	0.007	305.37X	3.23X	9.43	0.10
17:00	93.87	0.92	0.010	322.84X	3.44X	8.21	0.09
18:00	93.87	0.48	0.005	315.46X	3.36X	7.66	0.08
19:00	93.79	0.61	0.007	253.11	2.70	19.74X	0.21X
20:00	92.14	0.60	0.006	285.85X	3.10X	10.97	0.12
21:00	91.71	0.49	0.005	298.34X	3.25X	11.33	0.12
22:00	93.88	0.56	0.006	292.52X	3.12X	12.29	0.13
23:00	93.91	0.56	0.006	291.77X	3.11X	11.38	0.12
24:00	94.40	0.49	0.005	318.35X	3.37X	10.40	0.11
Total	2251.11	15.48	0.166	6384.71	68.09	238.75	2.55
Average	93.80	0.64	0.007	266.03	2.84	9.95	0.11
Maximum	94.40	1.84	0.020	322.84	3.44	24.42	0.26
Minimum	91.71	0.10	0.001	207.10	2.22	1.09	0.01
Rolling	92.12	2.72	0.012	140.29	1.49	18.89	0.06
Excess		0	0	12	12	2	2
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0
OC		0	0	0	0	0	0
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	65.63	65.63	65.63	65.63	65.63	64.06	64.06
MDT Per	66	66	66	66	66	69	69

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Emissions Data

Daily Report for 09/08/2001

Time	Kiln SO2 SO2 ppm Avg.	Kiln NOx NOx ppm Avg.	Kiln THC THC ppm Avg.	Kiln Flow ACFM Avg.	Kiln Flow Flow SCFM Avg.	Kiln Flow Flow DSCFM Avg.	Kiln Temp. Deg. F Avg.	Coal Mill Temp. Deg. F Avg.
01:00	0.11	247.40	0.84	239104	195240	165952	207	171
02:00	0.32	235.04	1.51	237608	192384	163524	205	172
03:00	0.21	209.27	3.34	238000	189888	161400	206	172
04:00	0.17	181.28	8.43	235396	191212	162532	200	172
05:00	0.23	193.23	6.19	233828	183784	156216	205	172
06:00	0.35	201.11	5.49	233864	187504	159380	207	172
07:00	0.66	216.82	6.55	236788	184340	156684	214	172
08:00	0.49	211.96	8.04	234048	179612	152668	226	172
09:00	0.31	209.85	7.61	228356	176528	150044	216	172
10:00	0.62	190.00	10.97	229296	174300	148148	213	172
11:00	0.59	214.40	6.53	229516	177604	150964	214	173
12:00	0.72	226.16	7.34	233040	185900	158012	206	172
13:00	1.15	180.06	18.88	237484	189172	160792	209	173
14:00	0.45	307.85	9.31	219376	124266	105622	227	173
15:00	0.09	383.63	10.94	184388	169332	143932	264	171
16:00	0.46	308.38	8.53	216912	185136	157364	248	172
17:00	0.60	289.68	6.54	233052	178380	151624	217	170
18:00	0.31	281.55	6.05	232080	188892	160556	210	169
19:00	0.38	221.30	15.30	233488	194524	165344	200	169
20:00	0.37	248.53	8.47	235204	184968	157224	202	169
21:00	0.31	260.87	8.79	233676	187428	159312	201	170
22:00	0.35	257.20	9.58	231676	185952	158056	199	172
23:00	0.35	256.06	8.85	232252	197720	168064	200	171
24:00	0.31	278.86	8.08	233236	186032	158128	201	171
Average	0.41	242.00	8.01	230486	182921	155481	212	171
Maximum	1.15	384.00	18.88	239104	197720	168064	264	173
Minimum	0.09	180.00	0.84	184388	124266	105622	199	169
Rolling	2.37	140.00	16.30	205642	162731	138321	221	159
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0	0
OC	0	0	0	0	0	0	0	0
CAL	0	0	0	0	0	0	0	0
Bad Per	0	0	0	0	0	0	0	0
MUT %	65.63	65.63	64.06	65.63	65.63	65.63	65.63	65.63
MDT Per	66	66	69	66	66	66	66	66

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 09/09/2001

Time	Clinker Prod. Tons/Hr. Avg.	Kiln SO2 SO2 Lbs./Hr. Avg.	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	93.91	0.54	0.006	309.58X	3.30X	11.81	0.13
02:00	94.39	0.30	0.003	271.29X	2.87X	13.85	0.15
03:00	93.84	0.18	0.002	319.46X	3.40X	10.47	0.11
04:00	93.19	0.21	0.002	329.66X	3.54X	9.37	0.10
05:00	90.48	0.24	0.003	308.81X	3.41X	10.34	0.11
06:00	90.54	0.39	0.004	304.88X	3.37X	10.47	0.12
07:00	91.69	0.84	0.009	304.75X	3.32X	8.76	0.10
08:00	93.34	0.80	0.009	315.38X	3.38X	9.36	0.10
09:00	93.88	0.59	0.006	298.17X	3.18X	10.45	0.11
10:00	93.91	0.22	0.002	274.04X	2.92X	12.41	0.13
11:00	94.39	0.66	0.007	277.15X	2.94X	12.04	0.13
12:00	93.88	1.41	0.015	302.96X	3.23X	11.30	0.12
13:00	93.91	2.06	0.022	303.84X	3.24X	12.03	0.13
14:00	94.40	2.56	0.027	286.88X	3.04X	13.58	0.14
15:00	93.91	1.87	0.020	268.72X	2.86X	16.09X	0.17X
16:00	94.39	1.93	0.020	276.94X	2.93X	17.24X	0.18X
17:00	93.87	1.42	0.015	321.55X	3.43X	13.40	0.14
18:00	93.91	1.14	0.012	344.69X	3.67X	11.14	0.12
19:00	94.39	0.92	0.010	302.53X	3.20X	10.74	0.11
20:00	93.91	0.34	0.004	271.30X	2.89X	9.68	0.10
21:00	94.39	0.44	0.005	252.71	2.68	9.95	0.11
22:00	93.88	0.87	0.009	256.76	2.73	11.25	0.12
23:00	93.91	0.90	0.010	249.48	2.66	11.55	0.12
24:00	94.39	0.28	0.003	245.86	2.60	10.69	0.11
Total	2246.70	21.13	0.225	6997.39	74.79	277.97	2.97
Average	93.61	0.88	0.009	291.56	3.12	11.58	0.12
Maximum	94.40	2.56	0.027	344.69	3.67	17.24	0.18
Minimum	90.48	0.18	0.002	245.86	2.60	8.76	0.10
Rolling	92.36	2.74	0.012	149.20	1.58	19.23	0.07
Excess		0	0	20	20	2	2
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0
OC		0	0	0	0	0	0
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	69.44	69.44	69.44	69.44	69.44	68.06	68.06
MDT Per	66	66	66	66	66	69	69

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Emissions Data

Daily Report for 09/09/2001

Time	Kiln SO2 SO2 ppm Avg.	Kiln NOx NOx ppm Avg.	Kiln THC THC ppm Avg.	Kiln Flow ACFM Avg.	Kiln Flow Flow SCFM Avg.	Kiln Flow DSCFM Avg.	Kiln Temp. Deg. F Avg.	Coal Mill Temp. Deg. F Avg.
01:00	0.34	267.99	9.08	235944	182112	154796	202	170
02:00	0.19	235.56	10.68	235528	191476	162756	202	171
03:00	0.11	274.96	8.00	238468	187128	159052	205	171
04:00	0.13	284.27	7.16	237736	195704	166348	204	172
05:00	0.15	269.77	8.01	232564	181592	154352	198	171
06:00	0.25	266.29	8.11	231180	181484	154260	194	172
07:00	0.53	268.89	6.86	230052	187832	159656	197	172
08:00	0.50	273.74	7.21	236432	191856	163076	204	171
09:00	0.37	261.16	8.12	234888	188484	160208	206	172
10:00	0.14	241.37	9.69	234252	190080	161564	208	173
11:00	0.42	242.14	9.34	235952	183964	156368	207	178
12:00	0.87	261.57	8.65	239352	194148	165020	209	182
13:00	1.27	260.70	9.17	240492	194904	165664	208	182
14:00	1.59	247.79	10.38	239268	191360	162652	209	181
15:00	1.17	232.89	12.35	237820	187524	159396	207	182
16:00	1.21	240.41	13.29	237408	182108	154792	207	180
17:00	0.89	279.05	10.32	237996	194904	165664	209	178
18:00	0.71	297.47	8.53	238960	189656	161208	208	176
19:00	0.64	298.34	9.39	208244	157892	134212	204	176
20:00	0.26	283.96	8.98	194788	152008	129210	200	174
21:00	0.34	267.75	9.35	191664	155232	131948	197	174
22:00	0.66	271.71	10.56	192096	160028	136028	198	176
23:00	0.68	262.27	10.77	194320	150564	127980	201	174
24:00	0.21	260.77	10.06	192248	152300	129456	200	175
Average	0.57	265.00	9.34	226152	180181	153153	204	175
Maximum	1.59	298.00	13.29	240492	195704	166348	209	182
Minimum	0.11	233.00	6.86	191664	150564	127980	194	170
Rolling	2.37	142.00	16.58	206697	165192	140412	219	159
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0	0
OC	0	0	0	0	0	0	0	0
CAL	0	0	0	0	0	0	0	0
Bad Per	0	0	0	0	0	0	0	0
MUT %	69.44	69.44	68.06	69.44	69.44	69.44	69.44	69.44
MDT Per	66	66	69	66	66	66	66	66

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 09/10/2001

Time	Clinker Prod. Tons/Hr. Avg.	Kiln SO2 SO2 Lbs./Hr. Avg.	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	93.91	0.24	0.003	248.90	2.65	10.44	0.11
02:00	94.40	0.37	0.004	257.31	2.73	9.93	0.11
03:00	93.88	0.26	0.003	271.58X	2.89X	8.94	0.10
04:00	93.91	0.24	0.003	261.29	2.78	8.44	0.09
05:00	94.39	0.34	0.004	263.40	2.79	8.99	0.10
06:00	93.87	0.32	0.003	259.02	2.76	9.28	0.10
07:00	93.91	0.41	0.004	248.14	2.64	10.01	0.11
08:00	94.39	0.44	0.005	235.30	2.49	12.24	0.13
09:00	93.91	0.38	0.004	245.29	2.61	12.61	0.13
10:00	94.40	0.18	0.002	210.20	2.23	17.01X	0.18X
11:00	93.88	0.53	0.006	257.00	2.74	13.52	0.14
12:00	93.91	0.86	0.009	255.49	2.72	15.63X	0.17X
13:00	94.43	0.57	0.006	261.31	2.77	14.92	0.16
14:00	94.37	0.86	0.009	263.13	2.79	15.09	0.16X
15:00	93.36	0.30	0.003	269.09X	2.88X	14.79	0.16
16:00	94.38	0.61	0.006	279.59X	2.96X	13.18	0.14
17:00	93.91	0.36	0.004	280.15X	2.98X	13.08	0.14
18:00	94.38	0.82	0.009	256.64	2.72	13.28	0.14
19:00	93.90	1.07	0.011	231.11	2.46	17.09X	0.18X
20:00	94.39	1.12	0.012	244.30	2.59	13.32	0.14
21:00	93.87	1.37	0.015	241.10	2.57	13.12	0.14
22:00	93.91	2.02	0.021	247.57	2.64	13.18	0.14
23:00	94.39	1.59	0.017	226.50	2.40	14.93	0.16
24:00	93.87	1.40	0.015	274.64X	2.93X	11.01	0.12
Total	2257.92	16.66	0.178	6088.05	64.72	304.03	3.23
Average	94.08	0.69	0.007	253.67	2.70	12.67	0.14
Maximum	94.43	2.02	0.021	280.15	2.98	17.09	0.18
Minimum	93.36	0.18	0.002	210.20	2.23	8.44	0.09
Rolling Excess	92.61	2.76	0.011	157.45	1.67	19.65	0.08
		0	0	5	5	3	4
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0
OC		0	0	0	0	0	0
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	72.50	72.50	72.50	72.50	72.50	71.25	71.25
MDT Per	66	66	66	66	66	69	69

Key: U, UD User Disable F, IF Instrument Failure C, Cal Calibration
R, OC Out of Control N, ND No Data M, MNR Monitoring Not Required
V, Valid Valid Data W, Warning Drift Warning

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Emissions Data

Daily Report for 09/10/2001

Time	Kiln SO2 SO2 ppm Avg.	Kiln NOx NOx ppm Avg.	Kiln THC THC ppm Avg.	Kiln Flow ACFM Avg.	Kiln Flow Flow SCFM Avg.	Kiln Flow Flow DSCFM Avg.	Kiln Temp. Deg. F Avg.	Coal Mill Temp. Deg. F Avg.
01:00	0.18	257.60	9.59	197592	157640	133992	202	176
02:00	0.27	266.18	9.11	196756	157776	134108	199	176
03:00	0.19	280.84	8.20	197036	162244	137908	199	175
04:00	0.18	270.99	7.76	196824	159052	135192	201	175
05:00	0.25	271.37	8.22	198432	159796	135824	202	175
06:00	0.24	269.30	8.57	196572	151092	128428	202	175
07:00	0.30	255.24	9.13	198720	157160	133584	202	176
08:00	0.32	239.26	11.05	201476	166204	141276	203	176
09:00	0.28	247.62	11.29	203056	164688	139988	203	175
10:00	0.13	211.12	15.14	204140	167300	142204	203	176
11:00	0.38	255.09	11.90	207164	159676	135720	206	175
12:00	0.61	254.05	13.78	207520	162588	138196	208	176
13:00	0.42	264.41	13.39	204320	156468	132996	209	177
14:00	0.62	263.10	13.37	206456	159336	135432	208	179
15:00	0.21	267.49	13.04	207600	162916	138476	208	177
16:00	0.43	277.40	11.60	206788	163520	138988	204	175
17:00	0.25	278.01	11.51	206792	165408	140596	204	174
18:00	0.59	257.24	11.80	203548	159860	135884	200	173
19:00	0.77	230.88	15.13	204784	168276	143036	202	174
20:00	0.79	240.41	11.61	208900	157240	133656	205	174
21:00	0.97	238.70	11.52	208168	158064	134356	207	174
22:00	1.45	247.34	11.67	205404	169092	143724	204	175
23:00	1.14	225.80	13.21	206320	168196	142960	206	174
24:00	1.01	275.72	9.80	204012	161144	136976	203	173
Average	0.50	256.00	11.31	203266	161447	137229	204	175
Maximum	1.45	281.00	15.14	208900	169092	143724	209	179
Minimum	0.13	211.00	7.76	196572	151092	128428	199	173
Rolling	2.39	150.00	16.95	209062	166945	141903	220	161
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0	0
OC	0	0	0	0	0	0	0	0
CAL	0	0	0	0	0	0	0	0
Bad Per	0	0	0	0	0	0	0	0
MUT %	72.50	72.50	71.25	72.50	72.50	72.50	72.50	72.50
MDT Per	66	66	69	66	66	66	66	66

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 09/11/2001

Time	Clinker Prod. Tons/Hr. Avg.	Kiln SO2 SO2 Lbs./Hr. Avg.	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	93.91	1.28	0.014	287.66X	3.06X	10.33	0.11
02:00	94.43	1.41	0.015	275.63X	2.92X	12.38	0.13
03:00	94.38	1.31	0.014	285.33X	3.02X	11.71	0.12
04:00	93.35	1.17	0.013	287.00X	3.07X	10.98	0.12
05:00	94.43	1.11	0.012	270.05X	2.86X	12.14	0.13
06:00	94.40	0.51	0.005	276.31X	2.93X	12.39	0.13
07:00	93.88	0.33	0.003	332.37X	3.54X	11.10	0.12
08:00	93.91	0.10	0.001	319.91X	3.41X	12.72	0.14
09:00	94.40	0.10	0.001	295.92X	3.13X	15.93X	0.17X
10:00	93.88	2.91	0.031	233.43	2.49	21.90X	0.23X
11:00	93.91	0.10	0.001	290.33X	3.09X	14.62	0.16
12:00	93.74	0.09	0.001	223.42	2.38	12.25	0.13
13:00	75.48	22.52	0.299X	189.02	2.50	24.31X	0.32X
14:00	72.37	36.98X	0.516X	204.45	2.83X	27.82X	0.39X
15:00	88.92	0.10	0.001	281.70X	3.17X	16.25X	0.18X
16:00	93.88	0.10	0.001	274.75X	2.93X	14.32	0.15
17:00	93.91	0.10	0.001	276.34X	2.94X	13.42	0.14
18:00	94.40	0.15	0.002	253.52	2.69	15.49	0.16X
19:00	93.88	0.38	0.004	254.38	2.71	14.75	0.16
20:00	93.80	0.27	0.003	260.72	2.78	15.06	0.16X
21:00	92.13	0.22	0.002	281.48X	3.05X	12.49	0.14
22:00	91.11	0.27	0.003	281.40X	3.09X	13.16	0.14
23:00	92.22	0.55	0.006	286.85X	3.11X	12.64	0.14
24:00	92.78	0.66	0.007	285.09X	3.07X	13.59	0.15
Total	2203.50	72.74	0.956	6507.06	70.77	351.75	3.92
Average	91.81	3.03	0.040	271.13	2.95	14.66	0.16
Maximum	94.43	36.98	0.516	332.37	3.54	27.82	0.39
Minimum	72.37	0.09	0.001	189.02	2.38	10.33	0.11
Rolling	92.58	2.84	0.014	162.98	1.73	19.63	0.08
Excess		1	2	17	18	5	7
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0
OC		0	0	0	0	0	0
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	75.00	75.00	75.00	75.00	75.00	73.86	73.86
MDT Per	66	66	66	66	66	69	69

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Emissions Data

Daily Report for 09/11/2001

Time	Kiln SO2 SO2 ppm Avg.	Kiln NOx NOx ppm Avg.	Kiln THC THC ppm Avg.	Kiln Flow ACFM Avg.	Kiln Flow Flow SCFM Avg.	Kiln Flow Flow DSCFM Avg.	Kiln Temp. Deg. F Avg.	Coal Mill Temp. Deg. F Avg.
01:00	0.92	287.72	9.17	205616	165284	140492	206	173
02:00	1.01	276.52	11.02	204728	162928	138484	205	174
03:00	0.93	282.34	10.27	208472	172360	146500	208	174
04:00	0.84	286.66	9.73	206108	163156	138684	206	173
05:00	0.80	271.99	10.84	203956	160980	136832	205	174
06:00	0.36	272.31	10.84	209852	167084	142024	210	175
07:00	0.23	360.32	10.82	197412	138432	117668	221	175
08:00	0.09	394.30	13.89	177504	137520	116890	248	174
09:00	0.09	369.96	17.69	174884	132880	112950	248	174
10:00	2.67	296.52	24.65	172220	121602	103362	248	173
11:00	0.09	374.89	16.73	169260	121670	103418	248	175
12:00	0.09	310.88	14.76	153244	104434	88770	244	176
13:00	21.63	262.30	29.24	156652	119152	101276	238	174
14:00	34.43	264.84	31.92	167524	111834	95060	243	175
15:00	0.09	358.08	18.34	171144	137212	116630	244	174
16:00	0.09	352.43	16.30	169192	131340	111638	243	174
17:00	0.09	342.16	14.60	175312	153260	130272	237	176
18:00	0.11	265.10	14.37	203664	178052	151340	227	173
19:00	0.25	232.75	11.93	226288	188036	159828	209	173
20:00	0.17	231.76	11.86	234636	187388	159276	215	173
21:00	0.14	254.32	10.01	232268	178276	151532	220	173
22:00	0.17	250.42	10.37	235664	193432	164420	218	173
23:00	0.35	253.87	9.93	234336	181308	154112	212	172
24:00	0.42	250.64	10.63	235864	180464	153388	211	174
Average	2.75	296.00	14.58	196908	153670	130619	226	174
Maximum	34.43	394.00	31.92	235864	193432	164420	248	176
Minimum	0.09	232.00	9.17	153244	104434	88770	205	172
Rolling	2.47	159.00	17.03	211218	166734	141723	221	164
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0	0
OC	0	0	0	0	0	0	0	0
CAL	0	0	0	0	0	0	0	0
Bad Per	0	0	0	0	0	0	0	0
MUT %	75.00	75.00	73.86	75.00	75.00	75.00	75.00	75.00
MDT Per	66	66	69	66	66	66	66	66

Key: U, UD User Disable F, IF Instrument Failure C, Cal Calibration
R, OC Out of Control N, ND No Data M, MNR Monitoring Not Required
V, Valid Valid Data W, Warning Drift Warning

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 09/12/2001

Time	Clinker Prod. Tons/Hr. Avg.	Kiln SO2 SO2 Lbs./Hr. Avg.	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	93.36	0.63	0.007	257.57	2.76	18.82X	0.20X
02:00	94.43	0.52	0.005	281.03X	2.98X	14.07	0.15
03:00	94.37	0.49	0.005	272.95X	2.89X	12.90	0.14
04:00	93.36	0.51	0.006	273.83X	2.93X	13.23	0.14
05:00	94.42	0.38	0.004	268.98X	2.85X	14.26	0.15
06:00	94.39	0.20	0.002	254.19	2.69	13.51	0.14
07:00	93.87	0.27	0.003	272.81X	2.91X	14.40	0.15
08:00	93.90	0.29	0.003	273.68X	2.91X	15.83X	0.17X
09:00	94.39	0.53	0.006	222.13	2.35	28.65X	0.30X
10:00	93.87	0.49	0.005	209.23	2.23	22.78X	0.24X
11:00	93.91	2.74	0.029	233.57	2.49	21.58X	0.23X
12:00	94.39	0.41	0.004	291.27X	3.09X	16.02X	0.17X
13:00	93.87	0.23	0.002	294.98X	3.14X	16.26X	0.17X
14:00	93.91	0.29	0.003	309.64X	3.30X	16.01X	0.17X
15:00	94.43	0.22	0.002	302.29X	3.20X	16.58X	0.18X
16:00	94.39	0.33	0.004	301.25X	3.19X	15.75X	0.17X
17:00	93.87	0.22	0.002	297.02X	3.16X	14.81	0.16
18:00	93.88	0.19	0.002	301.04X	3.21X	14.29	0.15
19:00	93.91	0.20	0.002	299.59X	3.19X	15.27	0.16X
20:00	94.39	0.16	0.002	304.22X	3.22X	14.35	0.15
21:00	93.91	0.14	0.002	304.18X	3.24X	14.28	0.15
22:00	94.39	0.15	0.002	296.84X	3.14X	14.29	0.15
23:00	93.91	0.14	0.002	304.15X	3.24X	14.21	0.15
24:00	94.39	0.20	0.002	292.48X	3.10X	13.13	0.14
Total	2257.91	9.94	0.106	6718.92	71.41	385.28	4.10
Average	94.08	0.41	0.004	279.95	2.98	16.05	0.17
Maximum	94.43	2.74	0.029	309.64	3.30	28.65	0.30
Minimum	93.36	0.14	0.002	209.23	2.23	12.90	0.14
Rolling	92.30	2.70	0.013	166.79	1.78	19.32	0.09
Excess		0	0	19	19	10	11
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0
OC		0	0	0	0	0	0
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	77.08	77.08	77.08	77.08	77.08	76.04	76.04
MDT Per	66	66	66	66	66	69	69

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Emissions Data

Daily Report for 09/12/2001

Time	Kiln SO2 SO2 ppm Avg.	Kiln NOx NOx ppm Avg.	Kiln THC THC ppm Avg.	Kiln Flow ACFM Avg.	Kiln Flow Flow SCFM Avg.	Kiln Flow DSCFM Avg.	Kiln Temp. Deg. F Avg.	Coal Mill Temp. Deg. F Avg.
01:00	0.40	228.66	14.83	233700	186260	158316	212	174
02:00	0.34	255.57	11.36	227496	176152	149728	210	173
03:00	0.32	245.80	10.29	229544	186116	158196	209	174
04:00	0.34	248.36	10.65	227824	175024	148764	209	173
05:00	0.25	244.34	11.49	227568	179828	152852	209	174
06:00	0.13	232.33	10.94	226484	176952	150408	210	173
07:00	0.18	253.85	11.84	223476	168740	143428	213	172
08:00	0.20	256.45	13.15	223076	181316	154120	216	172
09:00	0.36	208.50	24.01	222172	169872	144392	217	173
10:00	0.34	200.95	19.40	218500	175024	148768	219	172
11:00	1.93	222.91	18.25	220476	177048	150488	221	172
12:00	0.29	279.39	13.63	219100	168176	142948	220	173
13:00	0.16	283.09	13.83	218872	175236	148948	220	173
14:00	0.20	292.15	13.40	221892	174832	148608	218	173
15:00	0.15	288.99	14.06	218388	166016	141112	216	173
16:00	0.23	289.55	13.43	216640	164876	140144	214	173
17:00	0.15	285.80	12.63	216520	172504	146624	214	172
18:00	0.13	290.34	12.22	216160	167644	142492	215	171
19:00	0.14	287.42	12.99	217376	166796	141776	215	171
20:00	0.11	289.61	12.12	219512	167084	142020	216	171
21:00	0.10	286.80	11.95	221868	171908	146120	217	172
22:00	0.10	283.78	12.11	217388	182424	155060	213	171
23:00	0.10	282.41	11.70	222956	177776	151104	210	172
24:00	0.14	279.46	11.12	217020	166512	141536	211	172
Average	0.28	263.00	13.39	221834	173922	147831	214	172
Maximum	1.93	292.00	24.01	233700	186260	158316	221	174
Minimum	0.10	201.00	10.29	216160	164876	140144	209	171
Rolling	2.47	165.00	16.70	212081	166841	141814	222	165
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0	0
OC	0	0	0	0	0	0	0	0
CAL	0	0	0	0	0	0	0	0
Bad Per	0	0	0	0	0	0	0	0
MUT %	77.08	77.08	76.04	77.08	77.08	77.08	77.08	77.08
MDT Per	66	66	69	66	66	66	66	66

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 09/13/2001

Time	Clinker Prod. Tons/Hr. Avg.	Kiln SO2 SO2 Lbs./Hr. Avg.	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	93.88	0.25	0.003	297.73X	3.17X	13.28	0.14
02:00	93.91	0.17	0.002	304.53X	3.24X	12.16	0.13
03:00	94.39	0.21	0.002	293.45X	3.11X	11.19	0.12
04:00	93.90	0.20	0.002	280.67X	2.99X	12.26	0.13
05:00	94.38	0.14	0.002	270.66X	2.87X	13.34	0.14
06:00	93.87	0.21	0.002	272.97X	2.91X	13.19	0.14
07:00	93.90	0.14	0.001	268.63X	2.86X	9.37	0.10
08:00	94.38	0.16	0.002	266.30	2.82X	9.61	0.10
09:00	93.81	0.17	0.002	240.29	2.56	11.84	0.13
10:00	92.79	0.20	0.002	235.54	2.54	12.64	0.14
11:00	93.90	0.18	0.002	249.05	2.65	10.63	0.11
12:00	94.39	0.15	0.002	238.18	2.52	11.14	0.12
13:00	93.90	0.22	0.002	239.12	2.55	10.57	0.11
14:00	94.37	0.18	0.002	201.97	2.14	21.27X	0.23X
15:00	93.35	0.17	0.002	240.77	2.58	4.24	0.05
16:00	94.42	0.16	0.002	223.26	2.36	4.42	0.05
17:00	94.39	0.18	0.002	234.30	2.48	3.92	0.04
18:00	92.97	0.14	0.002	204.34	2.20	0.46	0.00
19:00	71.78	0.14	0.002	163.46	2.28	3.14	0.04
20:00	89.48	0.17	0.002	157.73	1.76	4.16	0.05
21:00	94.38	0.20	0.002	159.14	1.69	4.09	0.04
22:00	93.86	0.19	0.002	186.20	1.98	0.90	0.01
23:00	93.89	0.20	0.002	195.94	2.09	0.33	0.00
24:00	94.38	0.17	0.002	216.17	2.29	0.24	0.00
Total	2228.67	4.29	0.048	5640.40	60.64	198.39	2.12
Average	92.86	0.18	0.002	235.02	2.53	8.27	0.09
Maximum	94.42	0.25	0.003	304.53	3.24	21.27	0.22
Minimum	71.78	0.14	0.001	157.73	1.69	0.24	0.00
Rolling	91.98	2.69	0.012	170.40	1.82	18.51	0.09
Excess		0	0	7	8	1	1
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0
OC		0	0	0	0	0	0
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	78.85	78.85	78.85	78.85	78.85	77.88	77.88
MDT Per	66	66	66	66	66	69	69

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Emissions Data

Daily Report for 09/13/2001

Time	Kiln SO2 SO2 ppm Avg.	Kiln NOx NOx ppm Avg.	Kiln THC THC ppm Avg.	Kiln Flow ACFM Avg.	Kiln Flow Flow SCFM Avg.	Kiln Flow DSCFM Avg.	Kiln Temp. Deg. F Avg.	Coal Mill Temp. Deg. F Avg.
01:00	0.17	277.70	10.99	222312	177892	151204	211	173
02:00	0.11	282.30	10.00	223120	177892	151204	210	173
03:00	0.14	281.48	9.52	216316	176288	149840	212	173
04:00	0.14	267.92	10.36	217816	172036	146232	213	172
05:00	0.10	255.17	11.16	220384	180340	153288	212	172
06:00	0.14	257.30	11.02	219448	167248	142164	210	173
07:00	0.09	255.24	7.89	216804	176476	150004	206	173
08:00	0.11	253.39	8.10	216964	172244	146404	208	173
09:00	0.11	222.51	9.76	222968	172712	146804	209	173
10:00	0.13	217.89	10.37	222904	183544	156008	207	171
11:00	0.12	226.93	8.59	225540	171744	145980	205	171
12:00	0.10	217.37	9.01	225040	187164	159084	205	172
13:00	0.14	214.60	8.42	229016	176000	149600	205	173
14:00	0.11	180.79	16.66	230088	179560	152624	205	173
15:00	0.11	217.09	3.39	228296	182312	154964	206	168
16:00	0.10	200.39	3.52	229304	176324	149876	206	171
17:00	0.12	222.11	3.30	220440	182420	155060	214	168
18:00	0.10	195.09	0.39	213236	176244	149808	198	159
19:00	0.09	152.13	2.57	220372	177920	151232	203	165
20:00	0.11	143.73	3.36	227148	179364	152460	210	167
21:00	0.13	144.69	3.30	225848	179352	152448	205	169
22:00	0.12	169.07	0.72	225996	179124	152256	204	169
23:00	0.13	179.24	0.27	221724	183644	156100	196	171
24:00	0.11	193.07	0.19	227736	177560	150928	199	171
Average	0.12	218.00	6.79	222868	177725	151066	207	171
Maximum	0.17	282.00	16.66	230088	187164	159084	214	173
Minimum	0.09	144.00	0.19	213236	167248	142164	196	159
Rolling	2.33	167.00	16.04	212205	166894	141859	221	164
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0	0
OC	0	0	0	0	0	0	0	0
CAL	0	0	0	0	0	0	0	0
Bad Per	0	0	0	0	0	0	0	0
MUT %	78.85	78.85	77.88	78.85	78.85	78.85	78.85	78.85
MDT Per	66	66	69	66	66	66	66	66

Key:

U, UD
R, OC
V, Valid

User Disable
Out of Control
Valid Data

F, IF
N, ND
W, Warning

Instrument Failure
No Data
Drift Warning

C, Cal
M, MNR

Calibration
Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 09/14/2001

Time	Clinker Prod. Tons/Hr. Avg.	Kiln SO2 SO2 Lbs./Hr. Avg.	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	93.89	0.14	0.002	199.14	2.12	1.13	0.01
02:00	94.38	0.15	0.002	194.38	2.06	0.97	0.01
03:00	93.86	0.14	0.001	188.18	2.00	1.53	0.02
04:00	93.89	0.14	0.002	183.16	1.95	2.17	0.02
05:00	94.38	0.14	0.002	183.68	1.95	2.61	0.03
06:00	93.67	0.30	0.003	202.34	2.16	2.72	0.03
07:00	89.24	0.14	0.002	234.90	2.63	OC	OC
08:00	88.67	0.12	0.001	184.48	2.08	OC	OC
09:00	88.09	2.77	0.031	96.21	1.09	OC	OC
10:00	86.38	0.12	0.001	152.21	1.76	OC	OC
11:00	84.88	13.94	0.164	146.23	1.72	OC	OC
12:00	87.60	3.18	0.036	152.53	1.73	OC	OC
13:00	71.78	0.08	0.036	12.99	1.73	OC	OC
14:00	0.72	51.48X	0.036	28.62	1.73	OC	OC
15:00	21.47	40.97X	2.067X	156.15	7.74X	OC	OC
16:00	69.53	0.12	0.002	124.80	1.80	OC	OC
17:00	89.32	5.97	0.067	167.09	1.87	OC	OC
18:00	90.51	13.78	0.152	197.32	2.18	OC	OC
19:00	91.59	0.15	0.002	195.85	2.14	OC	OC
20:00	91.56	2.16	0.024	197.83	2.16	OC	OC
21:00	91.03	7.14	0.078	195.71	2.15	OC	OC
22:00	91.07	29.94X	0.329X	251.33	2.76	OC	OC
23:00	91.56	182.47X	1.993X	392.92X	4.29X	OC	OC
24:00	91.08	215.03X	2.361X	818.86X	8.99X	OC	OC
Total	1980.15	570.56	7.394	4856.91	62.79	11.13	0.12
Average	82.51	23.77	0.308	202.37	2.62	1.86	0.02
Maximum	94.38	215.03	2.361	818.86	8.99	2.72	0.03
Minimum	0.72	0.09	0.001	12.99	1.09	0.97	0.01
Rolling	91.92	3.37	0.033	175.12	1.88	17.74	0.09
Excess		5	4	2	3	0	0
Uptm %	100.00	100.00	100.00	100.00	100.00	25.00	25.00
# Per	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0
OC		0	0	0	0	18	18
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	80.36	80.36	80.36	80.36	80.36	74.11	74.11
MDT Per	66	66	66	66	66	87	87

Key: U, UD User Disable F, IF Instrument Failure C, Cal Calibration
R, OC Out of Control N, ND No Data M, MNR Monitoring Not Required
V, Valid W, Warning Drift Warning

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Emissions Data

Daily Report for 09/14/2001

Time	Kiln SO2 SO2 ppm Avg.	Kiln NOx NOx ppm Avg.	Kiln THC THC ppm Avg.	Kiln Flow ACFM Avg.	Kiln Flow Flow SCFM Avg.	Kiln Flow Flow DSCFM Avg.	Kiln Temp. Deg. F Avg.	Coal Mill Temp. Deg. F Avg.
01:00	0.09	178.41	0.90	231224	177728	151068	211	170
02:00	0.10	179.93	0.80	227760	173784	147716	223	170
03:00	0.09	172.98	1.25	227532	171820	146044	217	169
04:00	0.09	168.97	1.78	225192	175308	149012	212	168
05:00	0.09	169.39	2.14	225972	177408	150800	215	168
06:00	0.19	186.95	2.22	223784	175508	149180	209	167
07:00	0.09	225.36	OC	215972	155280	131988	208	169
08:00	0.09	195.91	OC	190780	146504	124530	197	167
09:00	2.14	103.51	OC	187204	146412	124454	192	167
10:00	0.09	165.68	OC	185016	150480	127908	191	148
11:00	10.25	152.79	OC	187296	161076	136912	172	151
12:00	2.23	154.62	OC	192420	134008	113908	174	155
13:00	0.09	20.22	OC	129298	75906	64519	173	148
14:00	55.64	49.25	OC	112420	110118	93602	212	136
15:00	40.94	203.08	OC	165304	150224	127690	234	135
16:00	0.09	132.66	OC	197604	159924	135936	217	158
17:00	4.39	173.87	OC	190028	160192	136160	181	154
18:00	10.19	202.98	OC	192152	165556	140720	180	158
19:00	0.11	205.72	OC	190332	157380	133772	187	162
20:00	1.51	200.93	OC	193276	172148	146328	175	160
21:00	4.84	183.45	OC	198800	174580	148392	144	153
22:00	20.50	238.70	OC	201204	162052	137744	157	154
23:00	130.27	385.84	OC	199588	169716	144256	184	157
24:00	149.77	794.19	OC	205312	173776	147704	185	157
Average	18.08	202.00	1.51	195645	157370	133764	194	158
Maximum	149.77	794.00	2.22	231224	177728	151068	234	170
Minimum	0.09	20.00	0.80	112420	75906	64519	144	135
Rolling	2.92	169.00	15.34	211326	167392	142282	220	164
Uptm %	100.00	100.00	25.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0	0
OC	0	0	18	0	0	0	0	0
CAL	0	0	0	0	0	0	0	0
Bad Per	0	0	0	0	0	0	0	0
MUT %	80.36	80.36	74.11	80.36	80.36	80.36	80.36	80.36
MDT Per	66	66	87	66	66	66	66	66

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 09/15/2001

Time	Clinker Prod. Tons/Hr. Avg.	Kiln SO2 SO2 Lbs./Hr. Avg.	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	91.54	162.56X	1.775X	375.20X	4.10X	OC	OC
02:00	89.89	34.24X	0.380X	140.41	1.57	OC	OC
03:00	75.94	2.96	0.039	105.31	1.39	OC	OC
04:00	70.14	0.12	0.002	91.41	1.30	OC	OC
05:00	74.44	0.12	0.002	105.56	1.42	OC	OC
06:00	73.92	0.12	0.002	133.18	1.80	OC	OC
07:00	74.08	0.53	0.007	157.30	2.13	OC	OC
08:00	78.07	20.49	0.262	145.73	1.87	OC	OC
09:00	80.85	2.57	0.032	168.38	2.08	OC	OC
10:00	83.13	10.48	0.126	121.94	1.47	OC	OC
11:00	85.86	2.42	0.028	136.72	1.59	OC	OC
12:00	85.38	9.00	0.105	104.15	1.22	OC	OC
13:00	85.92	1.52	0.018	179.53	2.09	OC	OC
14:00	86.53	0.12	0.001	219.77	2.54	OC	OC
15:00	86.00	0.10	0.001	71.84	0.84	OC	OC
16:00	32.09	0.27	0.009	52.32	1.63	OC	OC
17:00	MNR	0.59	MNR	31.04	MNR	OC	OC
18:00	MNR	16.90	MNR	119.16	MNR	OC	OC
19:00	35.07	0.41	0.012	222.86	6.65X	OC	OC
20:00	77.10	0.13	0.002	186.68	2.42	OC	OC
21:00	85.49	0.13	0.001	180.46	2.11	OC	OC
22:00	88.91	0.13	0.001	207.76	2.34	OC	OC
23:00	93.86	0.13	0.001	201.13	2.14	OC	OC
24:00	93.91	0.13	0.001	207.98	2.22	OC	OC
Total	1728.12	266.17	2.807	3665.82	46.92	INS	INS
Average	78.55	11.09	0.128	152.74	2.13	INS	INS
Maximum	93.91	162.56	1.775	375.20	6.65	INS	INS
Minimum	32.09	0.10	0.001	31.04	0.84	INS	INS
Rolling	91.99	2.91	0.021	180.55	1.86	18.84	0.12
Excess		2	4	1	4	0	0
Uptm %	100.00	100.00	100.00	100.00	100.00	0.00	0.00
# Per	24	24	24	24	24	24	24
MNR	2	0	2	0	2	0	0
ND	0	0	0	0	0	0	0
OC		0	0	0	0	24	24
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	81.56	81.67	81.56	81.67	81.56	69.17	69.17
MDT Per	66	66	66	66	66	111	111

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Emissions Data

Daily Report for 09/15/2001

Time	Kiln SO2 SO2 ppm Avg.	Kiln NOx NOx ppm Avg.	Kiln THC THC ppm Avg.	Kiln Flow ACFM Avg.	Kiln Flow Flow SCFM Avg.	Kiln Flow Flow DSCFM Avg.	Kiln Temp. Deg. F Avg.	Coal Mill Temp. Deg. F Avg.
01:00	114.83	367.81	OC	203260	161400	137192	189	160
02:00	24.90	143.35	OC	195564	162788	138376	185	159
03:00	2.21	109.66	OC	190388	154832	131604	182	164
04:00	0.09	95.07	OC	190468	160268	136228	181	157
05:00	0.09	109.03	OC	193240	161840	137564	186	166
06:00	0.09	136.99	OC	193324	164176	139544	184	164
07:00	0.38	161.77	OC	193896	163040	138584	186	166
08:00	14.89	149.20	OC	197996	154208	131072	196	163
09:00	1.96	178.24	OC	193060	160852	136724	202	165
10:00	7.91	128.54	OC	191468	154788	131568	193	168
11:00	1.84	143.08	OC	192360	158576	134788	192	165
12:00	6.92	111.56	OC	188952	154432	131268	194	168
13:00	1.19	193.02	OC	187908	170760	145144	197	167
14:00	0.09	228.83	OC	195420	150356	127804	200	171
15:00	0.11	102.41	OC	132784	88124	74906	208	167
16:00	0.36	107.09	OC	111514	81618	69376	249	161
17:00	0.47	86.93	OC	IF	64091	54477	243	143
18:00	23.48	188.97	OC	117080	123890	105306	231	148
19:00	0.43	255.28	OC	187580	IF	IF	234	164
20:00	0.09	187.06	OC	204344	161668	137416	229	174
21:00	0.09	182.80	OC	201040	157448	133828	199	173
22:00	0.09	205.55	OC	204296	164244	139608	194	173
23:00	0.09	203.12	OC	201576	160468	136396	199	174
24:00	0.09	210.86	OC	200844	163664	139112	199	173
Average	8.45	166.00	INS	185581	147719	125560	202	165
Maximum	114.83	368.00	INS	204344	170760	145144	249	174
Minimum	0.09	87.00	INS	111514	64091	54477	181	143
Rolling	3.10	173.00	15.34	211465	166566	141580	220	164
Uptm %	100.00	100.00	0.00	95.83	95.83	95.83	100.00	100.00
# Per	24	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0	0
OC	0	0	24	0	0	0	0	0
CAL	0	0	0	0	0	0	0	0
Bad Per	0	0	0	1	1	1	0	0
MUT %	81.67	81.67	69.17	81.39	81.39	81.39	81.67	81.67
MDT Per	66	66	111	67	67	67	66	66

Key: U, UD User Disable F, IF Instrument Failure C, Cal Calibration
R, OC Out of Control N, ND No Data M, MNR Monitoring Not Required
V, Valid Valid Data W, Warning Drift Warning

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 09/16/2001

Time	Clinker Prod. Tons/Hr. Avg.	Kiln SO2 SO2 Lbs./Hr. Avg.	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	94.32	0.13	0.001	212.38	2.25	OC	OC
02:00	92.24	0.13	0.001	190.84	2.07	OC	OC
03:00	93.89	0.13	0.001	209.43	2.23	OC	OC
04:00	91.25	0.07	0.001	57.03	0.68	OC	OC
05:00	19.07	0.08	0.004	141.12	7.36X	OC	OC
06:00	28.84	0.11	0.004	288.35X	9.30X	OC	OC
07:00	55.08	0.11	0.002	267.69	4.84X	2.63	0.05
08:00	67.65	0.12	0.002	260.96	3.86X	3.62	0.05
09:00	81.56	0.12	0.001	202.99	2.49	6.17	0.08
10:00	87.80	0.12	0.001	142.28	1.62	17.27X	0.20X
11:00	92.79	0.14	0.001	144.23	1.55	15.30	0.16X
12:00	93.90	0.34	0.004	137.44	1.46	17.88X	0.19X
13:00	94.40	0.46	0.005	80.58	0.85	33.27X	0.35X
14:00	93.77	0.12	0.001	153.84	1.64	13.56	0.14
15:00	91.35	0.11	0.001	250.95	2.74	3.97	0.04
16:00	81.46	0.07	MNR	71.34	MNR	IF	MNR
17:00	0.00	0.04	MNR	6.47	MNR	IF	MNR
18:00	0.00	0.04	MNR	5.85	MNR	0.05	MNR
19:00	0.00	0.02	MNR	3.21	MNR	0.03	MNR
20:00	0.00	0.04	MNR	4.94	MNR	0.04	MNR
21:00	0.00	0.04	MNR	5.57	MNR	0.04	MNR
22:00	0.00	0.04	MNR	7.04	MNR	0.05	MNR
23:00	0.00	0.04	MNR	7.89	MNR	0.04	MNR
24:00	0.19	0.04	MNR	19.24	MNR	0.13	MNR
Total	1259.56	2.66	0.030	2871.66	44.94	114.05	1.26
Average	52.48	0.11	0.002	119.65	3.00	7.13	0.14
Maximum	94.40	0.46	0.005	288.35	9.30	33.27	0.35
Minimum	0.00	0.02	0.001	3.21	0.68	0.03	0.04
Rolling	89.65	3.31	0.031	183.37	1.93	16.96	0.11
Excess		0	0	1	4	3	4
Uptm %	100.00	100.00	100.00	100.00	100.00	66.67	60.00
# Per	24	24	24	24	24	24	24
MNR	0	0	9	0	9	0	9
ND	0	0	0	0	0	0	0
OC		0	0	0	0	6	6
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	2	0
MUT %	82.81	82.81	82.31	82.81	82.31	69.01	68.80
MDT Per	66	66	66	66	66	119	117

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Emissions Data

Daily Report for 09/16/2001

Time	Kiln SO2 SO2 ppm Avg.	Kiln NOx NOx ppm Avg.	Kiln THC THC ppm Avg.	Kiln Flow ACFM Avg.	Kiln Flow Flow SCFM Avg.	Kiln Flow Flow DSCFM Avg.	Kiln Temp. Deg. F Avg.	Coal Mill Temp. Deg. F Avg.
01:00	0.09	214.09	OC	202224	160176	136144	200	174
02:00	0.09	194.94	OC	199876	159752	135784	201	172
03:00	0.09	209.99	OC	201360	166080	141168	193	170
04:00	0.09	65.18	OC	120694	72544	61662	216	178
05:00	0.09	200.98	OC	140968	152500	129626	248	173
06:00	0.09	320.26	OC	IF	134816	114594	245	174
07:00	0.09	312.80	2.69	184604	152448	129582	231	172
08:00	0.09	283.05	3.48	187744	156104	132680	199	172
09:00	0.09	218.02	5.89	188700	157776	134112	197	170
10:00	0.09	148.77	15.99	193208	151112	128444	194	171
11:00	0.10	150.66	14.06	195336	154408	131244	200	174
12:00	0.26	144.96	16.77	193256	160420	136356	200	175
13:00	0.35	85.34	31.26	193840	152712	129802	204	176
14:00	0.09	161.53	12.59	196240	153920	130834	204	175
15:00	0.09	282.87	3.94	186328	84024	71420	216	175
16:00	0.09	69.03	0.14	IF	IF	IF	248	123
17:00	0.09	27.60	0.14	IF	76606	65114	230	94
18:00	0.09	18.78	0.14	65198	26525	22546	223	86
19:00	0.09	17.95	0.14	37401	18850	16022	220	84
20:00	0.09	17.45	0.14	57641	37585	31948	217	96
21:00	0.09	20.14	0.14	57242	54704	46499	211	119
22:00	0.09	23.58	0.14	61647	40137	34116	207	110
23:00	0.09	28.35	0.14	56950	48407	41146	202	122
24:00	0.09	47.90	0.25	65550	110050	93542	200	145
Average	0.11	136.00	6.00	142191	112246	95408	213	149
Maximum	0.35	320.00	31.26	202224	166080	141168	248	178
Minimum	0.09	17.00	0.14	37401	18850	16022	193	84
Rolling	3.09	173.00	14.71	208970	165596	140756	220	164
Uptm %	100.00	100.00	75.00	87.50	95.83	95.83	100.00	100.00
# Per	24	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0	0
OC	0	0	6	0	0	0	0	0
CAL	0	0	0	0	0	0	0	0
Bad Per	0	0	0	3	1	1	0	0
MUT %	82.81	82.81	69.53	81.77	82.29	82.29	82.81	82.81
MDT Per	66	66	117	70	68	68	66	66

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 09/17/2001

Time	Clinker Prod. Tons/Hr. Avg.	Kiln SO2 SO2 Lbs./Hr. Avg.	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	MNR	0.09	MNR	171.52	MNR	1.89	MNR
02:00	51.09	0.11	0.002	123.10	2.43	3.88	0.08
03:00	78.91	0.13	0.002	98.68	1.25	6.50	0.08
04:00	87.87	0.12	0.001	165.20	1.88	3.04	0.03
05:00	80.46	0.13	0.002	159.13	1.98	3.60	0.04
06:00	86.65	0.13	0.001	149.83	1.73	4.39	0.05
07:00	90.58	0.14	0.002	109.31	1.21	5.76	0.06
08:00	92.79	0.19	0.002	124.04	1.34	5.58	0.06
09:00	93.87	0.19	0.002	157.52	1.68	6.06	0.06
10:00	93.87	0.30	0.003	177.51	1.89	5.87	0.06
11:00	93.91	0.27	0.003	212.45	2.26	6.26	0.07
12:00	94.39	0.39	0.004	185.06	1.96	7.03	0.07
13:00	93.88	1.34	0.014	195.48	2.08	6.60	0.07
14:00	93.91	1.01	0.011	203.77	2.17	5.76	0.06
15:00	94.42	0.53	0.006	200.12	2.12	5.70	0.06
16:00	94.38	0.21	0.002	192.14	2.04	5.88	0.06
17:00	93.88	0.17	0.002	202.72	2.16	6.32	0.07
18:00	93.92	0.19	0.002	194.90	2.08	6.69	0.07
19:00	94.43	0.15	0.002	207.92	2.20	6.03	0.06
20:00	93.88	0.14	0.001	204.02	2.17	6.64	0.07
21:00	93.91	0.15	0.002	166.63	1.77	6.76	0.07
22:00	94.38	0.16	0.002	159.71	1.69	10.29	0.11
23:00	93.36	0.22	0.002	169.50	1.82	7.31	0.08
24:00	93.52	0.12	0.001	173.59	1.84	3.27	0.03
Total	2078.53	6.56	0.071	4103.85	43.75	137.11	1.47
Average	86.61	0.27	0.003	170.99	1.90	5.71	0.06
Maximum	94.43	1.34	0.014	212.45	2.43	10.29	0.11
Minimum	6.27	0.09	0.001	98.68	1.21	1.89	0.03
Rolling	89.32	3.06	0.037	178.17	1.92	16.09	0.11
Excess		0	0	0	1	0	1
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24
MNR	0	0	1	0	1	0	1
ND	0	0	0	0	0	0	0
OC	0	0	0	0	0	0	0
CAL	0	0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	83.82	82.84	83.33	82.84	83.33	70.83	70.60
MDT Per	66	70	66	70	66	119	117

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Emissions Data

Daily Report for 09/17/2001

Time	Kiln SO2 SO2 ppm Avg.	Kiln NOx NOx ppm Avg.	Kiln THC THC ppm Avg.	Kiln Flow ACFM Avg.	Kiln Flow Flow SCFM Avg.	Kiln Flow Flow DSCFM Avg.	Kiln Temp. Deg. F Avg.	Coal Mill Temp. Deg. F Avg.
01:00	0.09	237.60	2.30	150296	121932	103642	215	166
02:00	0.09	144.10	4.04	184124	143396	121886	230	172
03:00	0.10	104.27	6.04	194580	157944	134252	205	175
04:00	0.09	171.53	2.80	198048	155988	132592	206	175
05:00	0.10	166.30	3.33	197788	157096	133536	209	173
06:00	0.09	152.50	3.96	203044	157496	133872	209	174
07:00	0.10	113.20	5.28	198888	162476	138104	206	175
08:00	0.14	128.08	5.11	198604	168848	143520	204	174
09:00	0.13	155.58	5.30	207144	177268	150676	202	172
10:00	0.22	179.14	5.26	202756	162296	137952	202	175
11:00	0.19	208.99	5.46	209996	156816	133292	208	176
12:00	0.28	186.98	6.31	205976	166680	141680	214	178
13:00	0.96	195.19	5.84	207832	166184	141252	212	177
14:00	0.72	201.62	5.05	208720	164472	139800	208	177
15:00	0.37	195.92	4.95	210116	169560	144124	206	177
16:00	0.15	191.17	5.20	206840	163036	138580	206	177
17:00	0.12	201.95	5.59	206604	162684	138284	206	177
18:00	0.14	197.13	6.01	204780	181524	154296	210	176
19:00	0.11	200.66	5.15	216660	174416	148252	215	175
20:00	0.09	189.60	5.47	220768	167240	142152	204	176
21:00	0.11	162.98	5.87	210116	165884	141000	206	177
22:00	0.11	158.48	9.11	206484	160652	136556	203	171
23:00	0.16	168.97	6.43	203600	162452	138080	198	174
24:00	0.09	178.14	2.93	189604	106904	90870	194	172
Average	0.20	175.00	5.12	201807	159719	135760	207	175
Maximum	0.96	238.00	9.11	220768	181524	154296	230	178
Minimum	0.09	104.00	2.30	150296	106904	90870	194	166
Rolling	2.23	173.00	13.72	209520	164909	140172	218	164
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0	0
OC	0	0	0	0	0	0	0	0
CAL	0	0	0	0	0	0	0	0
Bad Per	0	0	0	0	0	0	0	0
MUT %	83.82	83.82	71.32	82.84	83.33	83.33	83.82	83.82
MDT Per	66	66	117	70	68	68	66	66

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 09/18/2001

Time	Clinker Prod. Tons/Hr. Avg.	Kiln SO2 SO2 Lbs./Hr. Avg.	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	67.10	3.59	MNR	45.64	MNR	0.30	MNR
02:00	MNR	0.11	0.015	232.16	32.54X	2.18	0.30X
03:00	57.88	0.12	0.002	249.27	4.31X	1.41	0.02
04:00	68.77	0.13	0.002	263.78	3.83X	1.08	0.02
05:00	68.24	0.13	0.002	272.73X	4.00X	1.26	0.02
06:00	68.41	0.13	0.002	267.23	3.91X	2.08	0.03
07:00	73.21	0.13	0.002	232.61	3.18X	2.69	0.04
08:00	83.97	0.14	0.002	175.19	2.09	3.66	0.04
09:00	91.36	0.11	0.001	174.33	1.91	5.43	0.06
10:00	84.80	0.11	0.001	188.77	2.23	4.63	0.05
11:00	69.01	0.08	0.001	124.29	1.78	2.23	0.03
12:00	40.00	0.05	0.001	22.53	1.78	0.05	0.03
13:00	MNR	0.14	MNR	21.78	MNR	0.05	MNR
14:00	MNR	0.12	MNR	82.63	MNR	0.07	MNR
15:00	23.95	0.09	0.004	175.20	7.54X	0.47	0.02
16:00	54.82	0.10	0.002	197.52	3.61X	1.26	0.02
17:00	62.58	0.12	0.002	162.87	2.60	1.43	0.02
18:00	62.65	0.14	0.002	172.64	2.76	1.51	0.02
19:00	64.23	0.83	0.013	173.35	2.70	0.23	0.00
20:00	63.71	0.40	0.006	159.96	2.51	0.42	0.01
21:00	63.83	0.24	0.004	184.50	2.89X	0.84	0.01
22:00	66.94	1.47	0.022	201.13	3.00X	1.65	0.02
23:00	77.62	0.13	0.002	234.92	3.03X	0.59	0.01
24:00	84.25	0.13	0.002	245.07	2.91X	0.83	0.01
Total	1397.33	8.72	0.090	4260.10	95.11	36.35	0.78
Average	66.54	0.36	0.004	177.50	4.53	1.51	0.04
Maximum	91.36	3.59	0.022	272.73	32.54	5.43	0.30
Minimum	23.95	0.05	0.001	21.78	1.78	0.05	0.00
Rolling Excess	89.07	2.96	0.035	180.92	2.08	14.34	0.11
		0	0	1	12	0	1
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24
MNR	3	0	3	0	3	0	3
ND	0	0	0	0	0	0	0
OC	0	0	0	0	0	0	0
CAL	0	0	0	0	0	0	0
Bad Per	0	0	0	0	0	0	0
MUT %	84.62	83.80	84.17	83.80	84.17	72.45	72.08
MDT Per	66	70	66	70	66	119	117

Key: U, UD User Disable F, IF Instrument Failure C, Cal Calibration
R, OC Out of Control N, ND No Data M, MNR Monitoring Not Required
V, Valid W, Warning Drift Warning

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Emissions Data

Daily Report for 09/18/2001

Time	Kiln SO2 SO2 ppm Avg.	Kiln NOx NOx ppm Avg.	Kiln THC THC ppm Avg.	Kiln Flow ACFM Avg.	Kiln Flow Flow SCFM Avg.	Kiln Flow DSCFM Avg.	Kiln Temp. Deg. F Avg.	Coal Mill Temp. Deg. F Avg.
01:00	6.85	101.50	0.49	89948	98144	83422	201	179
02:00	0.09	274.66	2.32	186028	162096	137784	251	160
03:00	0.09	262.87	1.34	203452	158928	135084	234	175
04:00	0.09	265.78	0.97	205320	162108	137792	209	172
05:00	0.09	273.16	1.12	203840	155612	132268	201	176
06:00	0.09	271.86	1.88	200152	154564	131380	199	176
07:00	0.09	232.32	2.39	203360	161144	136972	198	173
08:00	0.10	174.06	3.23	204928	161812	137544	199	176
09:00	0.09	203.21	5.77	186144	106394	90434	233	174
10:00	0.11	267.76	5.82	157980	127738	108578	265	177
11:00	0.11	192.02	2.91	119264	52449	44582	253	176
12:00	0.11	64.29	0.12	74266	71756	60993	229	179
13:00	0.27	63.37	0.13	73098	70952	60310	225	173
14:00	0.23	138.03	0.13	105594	116402	98940	232	163
15:00	0.10	266.66	0.63	142908	89898	76410	247	171
16:00	0.10	287.77	1.60	150168	73996	62897	248	175
17:00	0.11	207.32	1.62	168300	124886	106152	231	179
18:00	0.13	221.89	1.72	172580	115952	98560	258	178
19:00	0.67	198.39	0.23	181324	160532	136452	211	178
20:00	0.35	191.94	0.43	171636	133088	113128	207	177
21:00	0.19	204.70	0.84	184728	159080	135216	204	177
22:00	1.10	218.30	1.55	190328	158912	135072	206	175
23:00	0.09	233.84	0.52	206164	159240	135352	204	175
24:00	0.09	245.39	0.74	203660	165088	140324	200	173
Average	0.47	211.00	1.60	166049	129199	109819	223	174
Maximum	6.85	288.00	5.82	206164	165088	140324	265	179
Minimum	0.09	63.00	0.12	73098	52449	44582	198	160
Rolling	2.24	178.00	12.32	207492	163384	138875	219	164
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0	0
OC	0	0	0	0	0	0	0	0
CAL	0	0	0	0	0	0	0	0
Bad Per	0	0	0	0	0	0	0	0
MUT %	84.72	84.72	72.92	83.80	84.26	84.26	84.72	84.72
MDT Per	66	66	117	70	68	68	66	66

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 09/19/2001

Time	Clinker Prod. Tons/Hr. Avg.	Kiln SO2 SO2 Lbs./Hr. Avg.	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	85.41	0.13	0.001	248.55	2.91X	1.44	0.02
02:00	87.09	0.13	0.001	243.68	2.80X	1.69	0.02
03:00	88.71	0.13	0.001	245.38	2.77	2.04	0.02
04:00	88.67	0.13	0.001	229.40	2.59	2.60	0.03
05:00	88.15	0.11	0.001	243.76	2.77	5.34	0.06
06:00	88.18	0.11	0.001	240.99	2.73	5.07	0.06
07:00	86.21	15.54	0.175	66.41	0.80	OC	0.00
08:00	19.05	0.07	0.175	32.55	0.80	0.08	0.00
09:00	MNR	0.07	MNR	26.13	MNR	0.08	MNR
10:00	MNR	0.07	MNR	32.85	MNR	0.25	MNR
11:00	MNR	0.09	MNR	112.66	MNR	1.69	MNR
12:00	36.05	0.08	0.002	48.29	1.49	0.84	0.03
13:00	MNR	0.18	MNR	135.95	MNR	3.23	MNR
14:00	44.58	0.10	0.002	159.79	3.59X	4.23	0.09
15:00	51.22	0.10	0.002	157.88	3.08X	4.95	0.10
16:00	52.35	0.39	0.007	154.03	2.94X	5.79	0.11
17:00	53.57	33.04X	0.617X	113.71	2.12	20.23X	0.38X
18:00	57.28	1.18	0.021	85.90	1.50	36.47X	0.64X
19:00	68.00	1.55	0.023	155.53	2.29	10.29	0.15
20:00	76.81	0.85	0.011	179.02	2.33	10.31	0.13
21:00	77.72	0.15	0.002	225.31	2.90X	5.07	0.07
22:00	71.79	0.31	0.004	194.54	2.71	6.88	0.10
23:00	74.69	0.39	0.005	122.84	1.64	31.77X	0.43X
24:00	79.77	0.20	0.002	198.24	2.48	9.45	0.12
Total	1375.30	55.08	1.432	3653.39	78.06	169.79	3.07
Average	68.76	2.30	0.060	152.22	3.25	7.38	0.13
Maximum	88.71	33.04	0.617	248.55	19.90	36.47	0.64
Minimum	19.05	0.07	0.001	26.13	0.80	0.08	0.00
Rolling	88.82	2.80	0.035	183.60	2.20	13.58	0.09
Excess		1	1	0	8	3	5
Uptm %	100.00	100.00	100.00	100.00	100.00	95.83	95.83
# Per	24	24	24	24	24	24	24
MNR	4	0	0	0	0	0	0
ND	0	0	0	0	0	0	0
OC		0	0	0	0	1	0
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	1
MUT %	85.30	84.65	85.09	84.65	84.87	73.68	73.68
MDT Per	66	70	68	70	69	120	120

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Emissions Data

Daily Report for 09/19/2001

Time	Kiln SO2 SO2 ppm Avg.	Kiln NOx NOx ppm Avg.	Kiln THC THC ppm Avg.	Kiln Flow ACFM Avg.	Kiln Flow Flow SCFM Avg.	Kiln Flow Flow DSCFM Avg.	Kiln Temp. Deg. F Avg.	Coal Mill Temp. Deg. F Avg.
01:00	0.09	250.13	1.29	202768	157396	133788	201	176
02:00	0.09	244.53	1.50	203528	169236	143848	201	173
03:00	0.09	246.89	1.83	202488	166644	141644	200	175
04:00	0.09	233.06	2.37	200056	139192	118318	199	174
05:00	0.09	278.91	5.44	193844	143616	122076	257	175
06:00	0.09	271.27	5.08	195148	149572	127138	250	175
07:00	11.83	97.75	OC	124862	92878	78946	220	179
08:00	0.09	62.51	0.14	103532	82166	69840	183	173
09:00	0.10	48.81	0.14	105620	92724	78816	177	162
10:00	0.09	53.16	0.33	114130	123326	104826	174	164
11:00	0.09	151.34	1.98	153948	106420	90458	213	160
12:00	0.09	73.76	1.06	122862	121284	103090	210	177
13:00	0.17	179.21	3.78	158468	126114	107196	218	165
14:00	0.10	211.89	4.97	157900	126774	107758	217	155
15:00	0.09	201.15	5.59	164420	118658	100860	219	149
16:00	0.37	202.37	6.77	159988	109594	93156	220	152
17:00	30.16	147.87	22.78	164924	129454	110038	226	149
18:00	0.90	90.71	34.34	198216	160808	136684	218	148
19:00	1.14	158.02	9.33	203432	160792	136668	210	152
20:00	0.60	176.52	9.01	209320	164688	139984	208	168
21:00	0.10	225.07	4.50	206708	171344	145644	208	171
22:00	0.22	197.38	6.17	203756	170240	144700	209	177
23:00	0.28	125.56	28.47	203088	149680	127230	210	175
24:00	0.14	196.51	8.40	206944	164096	139480	207	177
Average	1.96	172.00	7.19	173331	137362	116758	211	167
Maximum	30.16	279.00	34.34	209320	171344	145644	257	179
Minimum	0.09	49.00	0.14	103532	82166	69840	174	148
Rolling	2.24	180.00	11.74	205833	162236	137900	219	164
Uptm %	100.00	100.00	95.83	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0	0
OC	0	0	1	0	0	0	0	0
CAL	0	0	0	0	0	0	0	0
Bad Per	0	0	0	0	0	0	0	0
MUT %	85.53	85.53	74.12	84.65	85.09	85.09	85.53	85.53
MDT Per	66	66	118	70	68	68	66	66

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 09/20/2001

Time	Clinker Prod. Tons/Hr. Avg.	Kiln SO2 SO2 Lbs./Hr. Avg.	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	82.95	0.15	0.002	253.41	3.05X	5.47	0.07
02:00	81.95	0.15	0.002	252.16	3.08X	5.91	0.07
03:00	83.00	0.16	0.002	226.59	2.73	6.85	0.08
04:00	82.97	0.20	0.002	222.83	2.69	7.32	0.09
05:00	82.46	0.46	0.006	239.25	2.90X	7.76	0.09
06:00	82.50	0.51	0.006	233.73	2.83X	7.81	0.09
07:00	83.00	0.56	0.007	246.21	2.97X	5.72	0.07
08:00	83.19	0.25	0.003	216.60	2.60	6.53	0.08
09:00	87.17	0.36	0.004	167.28	1.91	4.45	0.05
10:00	74.39	0.12	0.007	25.55	1.38	0.13	0.01
11:00	MNR	0.21	MNR	56.92	MNR	0.31	MNR
12:00	MNR	27.91	MNR	73.60	MNR	17.53X	MNR
13:00	52.07	1.42	0.027	150.45	2.90X	6.08	0.12
14:00	80.39	1.31	0.016	180.41	2.25	5.33	0.07
15:00	87.74	1.84	0.021	152.64	1.74	7.06	0.08
16:00	94.35	1.28	0.014	160.63	1.70	5.75	0.06
17:00	95.43	1.44	0.015	170.14	1.78	8.17	0.09
18:00	94.85	21.09	0.221	190.64	2.01	10.82	0.11
19:00	80.38	1.30	0.016	201.59	2.51	4.16	0.05
20:00	87.52	1.13	0.013	219.07	2.50	3.16	0.04
21:00	88.42	0.20	0.002	240.14	2.72	2.46	0.03
22:00	84.70	0.15	0.002	248.04	2.93X	2.28	0.03
23:00	85.70	0.15	0.002	243.33	2.84X	2.25	0.03
24:00	83.15	0.17	0.002	206.23	2.49	0.53	0.01
Total	1838.28	62.51	0.392	4577.44	54.51	133.84	1.42
Average	83.56	2.61	0.018	190.73	2.48	5.58	0.06
Maximum	95.43	27.91	0.221	253.41	3.08	17.53	0.12
Minimum	52.07	0.12	0.002	25.55	1.38	0.13	0.01
Rolling	88.32	2.80	0.033	188.65	2.17	12.51	0.10
Excess		0	1	0	10	1	2
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24
MNR	2	0	2	0	2	0	2
ND	0	0	0	0	0	0	0
OC		0	0	0	0	0	0
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	85.99	85.42	85.77	85.42	85.56	75.00	74.90
MDT Per	66	70	68	70	69	120	120

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Emissions Data

Daily Report for 09/20/2001

Time	Kiln SO2 SO2 ppm Avg.	Kiln NOX NOx ppm Avg.	Kiln THC THC ppm Avg.	Kiln Flow ACFM Avg.	Kiln Flow Flow SCFM Avg.	Kiln Flow Flow DSCFM Avg.	Kiln Temp. Deg. F Avg.	Coal Mill Temp. Deg. F Avg.
01:00	0.10	235.02	4.50	222556	175160	148884	208	175
02:00	0.10	231.62	4.81	224036	177544	150916	206	175
03:00	0.11	209.86	5.62	222828	178052	151340	208	174
04:00	0.13	207.59	6.05	221824	184816	157092	209	176
05:00	0.30	220.30	6.34	223968	172712	146804	208	175
06:00	0.34	215.39	6.38	223756	188320	160076	207	177
07:00	0.36	219.64	4.53	230184	176216	149784	206	176
08:00	0.17	202.19	5.43	219172	172240	146400	203	177
09:00	0.26	163.45	3.82	207728	110618	94028	206	176
10:00	0.12	34.93	0.15	147152	127826	108650	188	180
11:00	0.18	65.64	0.32	166520	151316	128620	187	173
12:00	23.04	83.05	17.42	182532	153136	130166	207	167
13:00	0.99	146.27	5.25	211616	169592	144152	206	179
14:00	0.88	170.50	4.47	218908	173344	147344	210	179
15:00	1.24	143.32	5.87	219544	168460	143188	207	180
16:00	0.85	149.11	4.73	222336	175452	149136	208	180
17:00	0.96	158.51	6.76	222496	166424	141460	211	179
18:00	14.17	177.27	8.97	222548	170072	144560	210	178
19:00	0.87	187.07	3.42	223856	173532	147500	212	178
20:00	0.74	200.64	2.57	226056	181008	153856	210	177
21:00	0.13	220.02	2.00	227560	184468	156796	215	176
22:00	0.10	226.80	1.85	228272	170580	144992	216	177
23:00	0.10	221.06	1.81	230032	189684	161232	216	177
24:00	0.11	190.13	0.43	224340	181084	153920	210	178
Average	1.93	178.00	4.73	215409	169652	144204	207	177
Maximum	23.04	235.00	17.42	230184	189684	161232	216	180
Minimum	0.10	35.00	0.15	147152	110618	94028	187	167
Rolling	2.14	184.00	10.84	205675	162145	137823	218	164
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0	0
OC	0	0	0	0	0	0	0	0
CAL	0	0	0	0	0	0	0	0
Bad Per	0	0	0	0	0	0	0	0
MUT %	86.25	86.25	75.42	85.42	85.83	85.83	86.25	86.25
MDT Per	66	66	118	70	68	68	66	66

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

**Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Mass Emissions Report**

Daily Report for 09/21/2001

Time	Clinker Prod. Tons/Hr. Avg.	Kiln SO2 SO2 Lbs./Hr. Avg.	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	62.03	0.19	0.003	171.26	2.77	0.46	0.01
02:00	53.28	3.45	0.065	195.07	3.67X	1.74	0.03
03:00	66.72	0.49	0.007	179.98	2.70	3.35	0.05
04:00	75.06	0.56	0.007	191.08	2.55	3.49	0.05
05:00	78.34	0.49	0.006	194.63	2.48	3.97	0.05
06:00	77.75	0.35	0.004	226.44	2.91X	3.23	0.04
07:00	77.86	0.14	0.002	223.09	2.87X	2.14	0.03
08:00	80.19	0.17	0.002	230.54	2.88X	2.76	0.03
09:00	83.02	0.34	0.004	199.54	2.40	3.63	0.04
10:00	86.40	0.50	0.006	150.93	1.75	3.86	0.04
11:00	88.14	0.64	0.007	125.68	1.43	4.79	0.05
12:00	90.88	0.72	0.008	116.49	1.28	4.39	0.05
13:00	91.44	0.57	0.006	114.14	1.25	5.12	0.06
14:00	90.90	0.65	0.007	142.61	1.57	0.20	0.00
15:00	92.14	0.32	0.003	91.65	1.00	10.49	0.11
16:00	94.33	0.55	0.006	67.10	0.71	5.47	0.06
17:00	94.87	0.62	0.007	73.18	0.77	2.71	0.03
18:00	94.90	0.28	0.003	81.39	0.86	0.27	0.00
19:00	95.38	0.13	0.001	83.32	0.87	0.71	0.01
20:00	94.87	0.13	0.001	67.21	0.71	6.45	0.07
21:00	94.90	0.13	0.001	71.94	0.76	1.17	0.01
22:00	95.38	0.13	0.001	80.93	0.85	0.64	0.01
23:00	94.85	0.14	0.001	74.26	0.78	0.53	0.01
24:00	94.89	0.36	0.004	77.31	0.81	0.36	0.00
Total	2048.52	12.02	0.162	3229.77	40.63	71.93	0.85
Average	85.36	0.50	0.007	134.57	1.69	3.00	0.04
Maximum	95.38	3.45	0.065	230.54	3.67	10.49	0.11
Minimum	53.28	0.13	0.001	67.10	0.71	0.20	0.00
Rolling Excess	85.96	2.74	0.037	191.07	2.38	10.96	0.09
		0	0	0	4	0	0
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0
OC	0	0	0	0	0	0	0
CAL	0	0	0	0	0	0	0
Bad Per	0	0	0	0	0	0	0
MUT %	86.90	86.11	86.51	86.11	86.31	76.19	76.19
MDT Per	66	70	68	70	69	120	120

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Emissions Data

Daily Report for 09/21/2001

Time	Kiln SO2 SO2 ppm Avg.	Kiln NOx NOx ppm Avg.	Kiln THC THC ppm Avg.	Kiln Flow ACFM Avg.	Kiln Flow Flow SCFM Avg.	Kiln Flow Flow DSCFM Avg.	Kiln Temp. Deg. F Avg.	Coal Mill Temp. Deg. F Avg.
01:00	0.13	169.31	0.39	204572	167748	142584	203	178
02:00	2.38	187.45	1.48	214652	170284	144736	207	176
03:00	0.34	173.28	2.86	213548	170408	144844	205	177
04:00	0.39	183.39	2.98	213824	172492	146616	204	176
05:00	0.34	186.08	3.36	213744	167996	142796	202	178
06:00	0.24	214.95	2.73	216644	174448	148280	206	176
07:00	0.10	225.12	1.91	206164	157752	134092	210	177
08:00	0.12	240.84	2.56	196284	167276	142180	204	176
09:00	0.25	206.74	3.34	196616	153872	130792	200	177
10:00	0.38	158.88	3.60	195056	157480	133856	204	178
11:00	0.48	130.81	4.42	197212	157316	133720	204	179
12:00	0.54	122.25	4.09	196524	156848	133320	208	180
13:00	0.42	119.43	4.75	198036	156164	132740	211	180
14:00	0.49	150.13	0.18	198820	160172	136148	217	180
15:00	0.24	97.65	10.10	198136	153576	130538	226	180
16:00	0.41	69.73	5.09	199984	163036	138584	213	181
17:00	0.45	73.31	2.40	204836	159068	135212	204	179
18:00	0.20	81.49	0.24	205204	165592	140752	205	177
19:00	0.09	83.26	0.63	203988	160636	136540	200	175
20:00	0.09	67.71	5.73	202560	160076	136064	200	177
21:00	0.09	72.27	1.05	204968	166264	141324	206	177
22:00	0.09	80.54	0.57	206332	165464	140644	205	176
23:00	0.10	74.01	0.48	205204	164760	140044	203	177
24:00	0.26	77.35	0.32	203680	160404	136340	199	177
Average	0.36	135.00	2.72	204025	162881	138448	206	178
Maximum	2.38	241.00	10.10	216644	174448	148280	226	181
Minimum	0.09	68.00	0.18	195056	153576	130538	199	175
Rolling	2.09	187.00	9.55	205154	161762	137497	218	164
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0	0
OC	0	0	0	0	0	0	0	0
CAL	0	0	0	0	0	0	0	0
Bad Per	0	0	0	0	0	0	0	0
MUT %	86.90	86.90	76.59	86.11	86.51	86.51	86.90	86.90
MDT Per	66	66	118	70	68	68	66	66

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 09/22/2001

Time	Clinker Prod. Tons/Hr. Avg.	Kiln SO2 SO2 Lbs./Hr. Avg.	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	95.38	0.22	0.002	71.70	0.75	1.21	0.01
02:00	94.90	0.28	0.003	67.52	0.71	2.20	0.02
03:00	95.32	0.26	0.003	79.18	0.83	4.57	0.05
04:00	93.23	0.32	0.003	75.81	0.81	2.01	0.02
05:00	94.82	0.22	0.002	79.09	0.83	2.42	0.03
06:00	94.22	0.24	0.003	86.68	0.92	12.05	0.13
07:00	92.34	0.20	0.002	122.25	1.32	3.95	0.04
08:00	85.99	0.16	0.002	140.60	1.64	1.57	0.02
09:00	77.00	0.23	0.003	130.66	1.70	0.77	0.01
10:00	72.23	0.26	0.004	131.28	1.82	1.33	0.02
11:00	75.01	0.72	0.010	137.00	1.83	1.42	0.02
12:00	76.62	0.40	0.005	138.42	1.81	1.89	0.02
13:00	74.04	0.24	0.004	12.89	0.17	0.13	0.00
14:00	MNR	0.39	MNR	0.55	MNR	0.06	MNR
15:00	MNR	0.42	MNR	0.79	MNR	0.05	MNR
16:00	MNR	0.27	MNR	0.61	MNR	0.06	MNR
17:00	MNR	0.05	MNR	0.35	MNR	0.05	MNR
18:00	MNR	0.04	MNR	0.27	MNR	0.05	MNR
19:00	MNR	0.04	MNR	0.32	MNR	0.05	MNR
20:00	MNR	0.04	MNR	0.36	MNR	0.06	MNR
21:00	MNR	0.04	MNR	0.27	MNR	0.06	MNR
22:00	MNR	0.05	MNR	0.20	MNR	0.06	MNR
23:00	MNR	0.04	MNR	0.12	MNR	0.05	MNR
24:00	MNR	0.04	MNR	0.11	MNR	0.04	MNR
Total	1121.10	5.15	0.046	1277.03	15.14	36.11	0.39
Average	86.24	0.21	0.004	53.21	1.16	1.50	0.03
Maximum	95.38	0.72	0.010	140.60	1.83	12.05	0.13
Minimum	72.23	0.04	0.002	0.11	0.17	0.04	0.00
Rolling	87.23	2.69	0.033	188.35	2.28	9.31	0.10
Excess		0	1	0	0	0	0
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24
MNR	11	0	11	0	11	0	11
ND	0	0	0	0	0	0	0
OC		0	0	0	0	0	0
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	87.23	86.74	86.85	86.74	86.65	77.27	76.79
MDT Per	66	70	68	70	69	120	120

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Emissions Data

Daily Report for 09/22/2001

Time	Kiln SO2 SO2 ppm Avg.	Kiln NOx NOx ppm Avg.	Kiln THC THC ppm Avg.	Kiln Flow ACFM Avg.	Kiln Flow Flow SCFM Avg.	Kiln Flow Flow DSCFM Avg.	Kiln Temp. Deg. F Avg.	Coal Mill Temp. Deg. F Avg.
01:00	0.16	72.18	1.11	203012	161584	137344	203	177
02:00	0.20	67.14	1.95	206068	161264	137076	203	177
03:00	0.18	78.62	4.02	205116	163904	139316	200	178
04:00	0.23	75.27	1.77	205448	162632	138236	200	177
05:00	0.15	77.29	2.11	209564	166976	141928	204	177
06:00	0.17	84.70	10.49	209300	169768	144300	203	177
07:00	0.14	120.32	3.44	209756	164608	139916	208	177
08:00	0.11	140.38	1.39	207352	159388	135484	210	177
09:00	0.16	132.73	0.70	204624	161708	137448	213	177
10:00	0.19	134.15	1.20	204356	157708	134048	216	178
11:00	0.53	140.34	1.29	204168	156440	132972	217	179
12:00	0.30	140.48	1.70	206056	167140	142068	217	176
13:00	0.39	17.17	0.19	92708	62234	52896	243	129
14:00	0.76	1.52	0.14	78644	61896	52612	252	104
15:00	0.98	3.12	0.15	62674	48799	41480	251	98
16:00	0.57	1.72	0.15	76068	34024	28920	255	97
17:00	0.13	1.19	0.15	63195	47005	39954	238	92
18:00	0.09	0.94	0.15	62753	58208	49477	235	87
19:00	0.10	1.02	0.15	66874	51617	43874	231	86
20:00	0.09	1.08	0.15	69742	54200	46070	214	77
21:00	0.09	0.78	0.14	72298	60842	51715	218	73
22:00	0.09	0.56	0.14	74976	59416	50505	220	73
23:00	0.09	0.40	0.14	63373	49892	42409	221	72
24:00	0.09	0.39	0.14	58362	42991	36543	221	72
Average	0.25	54.00	1.37	138187	107677	91525	221	133
Maximum	0.98	140.00	10.49	209756	169768	144300	255	179
Minimum	0.09	0.00	0.14	58362	34024	28920	200	72
Rolling	2.05	187.00	8.17	202383	160598	136507	218	162
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0	0
OC	0	0	0	0	0	0	0	0
CAL	0	0	0	0	0	0	0	0
Bad Per	0	0	0	0	0	0	0	0
MUT %	87.50	87.50	77.65	86.74	87.12	87.12	87.50	87.50
MDT Per	66	66	118	70	68	68	66	66

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 09/23/2001

Time	Clinker Prod. Tons/Hr. Avg.	Kiln SO2 SO2 Lbs./Hr. Avg.	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	MNR	MNR	MNR	MNR	MNR	MNR	MNR
02:00	MNR	MNR	MNR	MNR	MNR	MNR	MNR
03:00	MNR	MNR	MNR	MNR	MNR	MNR	MNR
04:00	MNR	MNR	MNR	MNR	MNR	MNR	MNR
05:00	MNR	MNR	MNR	MNR	MNR	MNR	MNR
06:00	MNR	MNR	MNR	MNR	MNR	MNR	MNR
07:00	MNR	MNR	MNR	MNR	MNR	MNR	MNR
08:00	MNR	MNR	MNR	MNR	MNR	MNR	MNR
09:00	MNR	MNR	MNR	MNR	MNR	MNR	MNR
10:00	MNR	MNR	MNR	MNR	MNR	MNR	MNR
11:00	MNR	MNR	MNR	MNR	MNR	MNR	MNR
12:00	MNR	MNR	MNR	MNR	MNR	MNR	MNR
13:00	MNR	MNR	MNR	MNR	MNR	MNR	MNR
14:00	MNR	MNR	MNR	MNR	MNR	MNR	MNR
15:00	MNR	MNR	MNR	MNR	MNR	MNR	MNR
16:00	MNR	MNR	MNR	MNR	MNR	MNR	MNR
17:00	MNR	MNR	MNR	MNR	MNR	MNR	MNR
18:00	MNR	MNR	MNR	MNR	MNR	MNR	MNR
19:00	MNR	MNR	MNR	MNR	MNR	MNR	MNR
20:00	MNR	MNR	MNR	MNR	MNR	MNR	MNR
21:00	MNR	MNR	MNR	MNR	MNR	MNR	MNR
22:00	MNR	MNR	MNR	MNR	MNR	MNR	MNR
23:00	MNR	MNR	MNR	MNR	MNR	MNR	MNR
24:00	MNR	MNR	MNR	MNR	MNR	MNR	MNR
Total	MNR	MNR	MNR	MNR	MNR	MNR	MNR
Average	MNR	MNR	MNR	MNR	MNR	MNR	MNR
Maximum	MNR	MNR	MNR	MNR	MNR	MNR	MNR
Minimum	MNR	MNR	MNR	MNR	MNR	MNR	MNR
Rolling	84.44	2.69	0.037	188.35	2.36	9.31	0.08
Excess		0	0	0	0	0	0
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24
MNR	24	24	24	24	24	24	24
ND	0	0	0	0	0	0	0
OC		0	0	0	0	0	0
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	87.50	86.74	87.12	86.74	86.93	77.27	77.27
MDT Per	66	70	68	70	69	120	120

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Emissions Data

Daily Report for 09/23/2001

Time	Kiln SO2 SO2 ppm Avg.	Kiln NOx NOx ppm Avg.	Kiln THC THC ppm Avg.	Kiln Flow ACFM Avg.	Kiln Flow Flow SCFM Avg.	Kiln Flow Flow DSCFM Avg.	Kiln Temp. Deg. F Avg.	Coal Mill Temp. Deg. F Avg.
01:00	0.09	0.26	0.14	75462	59412	50500	222	73
02:00	0.09	0.29	0.14	69622	57394	48784	224	72
03:00	0.09	0.46	0.14	75002	60122	51103	225	72
04:00	0.09	0.28	0.14	76596	59227	50343	226	72
05:00	0.09	0.26	0.14	71852	53323	45324	226	72
06:00	0.09	0.26	0.14	74064	63459	53939	224	72
07:00	0.09	0.26	OC	72618	58156	49433	217	72
08:00	0.09	0.27	OC	54956	50288	42744	207	72
09:00	0.09	0.34	OC	46077	17613	14971	197	73
10:00	0.09	0.17	OC	34395	27843	23665	175	75
11:00	0.09	0.39	OC	37572	33656	28608	159	78
12:00	0.09	0.22	OC	37832	38347	32595	152	81
13:00	0.13	0.47	OC	36851	27554	23421	149	83
14:00	0.12	0.59	OC	42202	38647	32850	146	85
15:00	0.10	0.21	OC	41356	36503	31027	144	86
16:00	0.09	0.33	OC	39445	29982	25485	144	87
17:00	0.09	0.12	OC	29821	38068	32358	136	87
18:00	0.09	0.08	OC	49190	38462	32694	141	85
19:00	0.09	0.06	OC	48991	48353	41100	147	81
20:00	0.09	0.00	OC	42959	21157	17983	145	79
21:00	0.09	0.03	OC	31127	36792	31273	141	77
22:00	0.09	0.09	OC	49007	44435	37769	139	76
23:00	0.09	0.01	OC	40966	34656	29458	139	75
24:00	0.09	0.01	OC	45987	38143	32423	136	74
Average	0.09	0.00	0.14	50998	42150	35827	173	77
Maximum	0.13	1.00	0.14	76596	63459	53939	226	87
Minimum	0.09	0.00	0.14	29821	17613	14971	136	72
Rolling	2.00	182.00	7.73	198017	157206	133624	217	160
Uptm %	100.00	100.00	25.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0	0
OC	0	0	18	0	0	0	0	0
CAL	0	0	0	0	0	0	0	0
Bad Per	0	0	0	0	0	0	0	0
MUT %	88.04	88.04	75.36	87.32	87.68	87.68	88.04	88.04
MDT Per	66	66	136	70	68	68	66	66

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 09/24/2001

Time	Clinker Prod. Tons/Hr. Avg.	Kiln SO2 SO2 Lbs./Hr. Avg.	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	MNR	MNR	MNR	MNR	MNR	MNR	MNR
02:00	MNR	MNR	MNR	MNR	MNR	MNR	MNR
03:00	MNR	MNR	MNR	MNR	MNR	MNR	MNR
04:00	MNR	MNR	MNR	MNR	MNR	MNR	MNR
05:00	MNR	MNR	MNR	MNR	MNR	MNR	MNR
06:00	MNR	MNR	MNR	MNR	MNR	MNR	MNR
07:00	MNR	MNR	MNR	MNR	MNR	MNR	MNR
08:00	MNR	MNR	MNR	MNR	MNR	MNR	MNR
09:00	MNR	MNR	MNR	MNR	MNR	MNR	MNR
10:00	MNR	MNR	MNR	MNR	MNR	MNR	MNR
11:00	MNR	MNR	MNR	MNR	MNR	MNR	MNR
12:00	MNR	MNR	MNR	MNR	MNR	MNR	MNR
13:00	MNR	MNR	MNR	MNR	MNR	MNR	MNR
14:00	MNR	MNR	MNR	MNR	MNR	MNR	MNR
15:00	MNR	MNR	MNR	MNR	MNR	MNR	MNR
16:00	MNR	MNR	MNR	MNR	MNR	MNR	MNR
17:00	MNR	MNR	MNR	MNR	MNR	MNR	MNR
18:00	MNR	MNR	MNR	MNR	MNR	MNR	MNR
19:00	MNR	MNR	MNR	MNR	MNR	MNR	MNR
20:00	MNR	MNR	MNR	MNR	MNR	MNR	MNR
21:00	MNR	MNR	MNR	MNR	MNR	MNR	MNR
22:00	MNR	MNR	MNR	MNR	MNR	MNR	MNR
23:00	MNR	MNR	MNR	MNR	MNR	MNR	MNR
24:00	MNR	MNR	MNR	MNR	MNR	MNR	MNR
Total	MNR	MNR	MNR	MNR	MNR	MNR	MNR
Average	MNR	MNR	MNR	MNR	MNR	MNR	MNR
Maximum	MNR	MNR	MNR	MNR	MNR	MNR	MNR
Minimum	MNR	MNR	MNR	MNR	MNR	MNR	MNR
Rolling	84.44	2.69	0.037	188.35	2.36	9.31	0.08
Excess		0	0	0	0	0	0
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24
MNR	24	24	24	24	24	24	24
ND	0	0	0	0	0	0	0
OC		0	0	0	0	0	0
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	87.50	86.74	87.12	86.74	86.93	77.27	77.27
MDT Per	66	70	68	70	69	120	120

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Emissions Data

Daily Report for 09/24/2001

Time	Kiln SO2 SO2 ppm Avg.	Kiln NOx NOx ppm Avg.	Kiln THC THC ppm Avg.	Kiln Flow ACFM Avg.	Kiln Flow Flow SCFM Avg.	Kiln Flow DSCFM Avg.	Kiln Temp. Deg. F Avg.	Coal Mill Temp. Deg. F Avg.
01:00	0.09	0.01	OC	35387	29294	24900	134	74
02:00	0.09	0.00	OC	40228	31479	26757	134	74
03:00	0.09	0.01	OC	28996	19292	16398	133	74
04:00	0.09	0.01	OC	47495	48530	41250	131	74
05:00	0.09	0.01	OC	59424	35266	29977	129	74
06:00	0.09	0.00	OC	45535	51156	43482	126	73
07:00	0.09	0.01	0.15	59462	48993	41644	125	73
08:00	0.09	0.01	0.15	41287	29861	25381	123	73
09:00	0.09	0.03	0.15	49257	59442	50525	122	74
10:00	0.09	0.19	0.15	65378	65079	55318	122	77
11:00	0.09	0.20	0.15	61635	65079	55318	122	99
12:00	0.09	0.36	0.15	56746	46868	39838	123	183
13:00	0.12	0.94	0.15	60932	70718	60110	123	116
14:00	0.11	0.79	0.15	70060	62721	53313	123	99
15:00	0.10	0.09	0.15	49711	36784	31267	122	88
16:00	0.09	0.03	0.15	44490	47419	40307	118	80
17:00	0.09	0.01	0.15	58377	59001	50150	116	79
18:00	0.09	0.00	0.15	58293	52175	44349	114	96
19:00	0.09	0.03	0.15	57455	55563	47228	114	81
20:00	0.09	0.25	0.15	50615	38594	32804	112	78
21:00	0.09	0.04	0.15	43013	41093	34928	109	76
22:00	0.09	0.09	0.15	46946	50545	42963	109	74
23:00	0.09	0.23	0.15	47715	35570	30235	104	74
24:00	0.09	0.13	0.15	43569	42656	36257	103	73
Average	0.09	0.14	0.15	50917	46799	39779	120	85
Maximum	0.12	0.94	0.15	70060	70718	60110	134	183
Minimum	0.09	0.00	0.15	28996	19292	16398	103	73
Rolling	2.00	180.24	7.21	199501	154122	131003	214	160
Uptm %	100.00	100.00	75.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0	0
OC	0	0	6	0	0	0	0	0
CAL	0	0	0	0	0	0	0	0
Bad Per	0	0	0	0	0	0	0	0
MUT %	88.54	88.54	75.35	87.85	88.19	88.19	88.54	88.54
MDT Per	66	66	142	70	68	68	66	66

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 09/25/2001

Time	Clinker Prod. Tons/Hr. Avg.	Kiln SO2 SO2 Lbs./Hr. Avg.	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	MNR	MNR	MNR	MNR	MNR	MNR	MNR
02:00	MNR	MNR	MNR	MNR	MNR	MNR	MNR
03:00	MNR	MNR	MNR	MNR	MNR	MNR	MNR
04:00	MNR	MNR	MNR	MNR	MNR	MNR	MNR
05:00	MNR	MNR	MNR	MNR	MNR	MNR	MNR
06:00	MNR	MNR	MNR	MNR	MNR	MNR	MNR
07:00	MNR	MNR	MNR	MNR	MNR	MNR	MNR
08:00	MNR	MNR	MNR	MNR	MNR	MNR	MNR
09:00	MNR	MNR	MNR	MNR	MNR	MNR	MNR
10:00	MNR	MNR	MNR	MNR	MNR	MNR	MNR
11:00	MNR	MNR	MNR	MNR	MNR	MNR	MNR
12:00	MNR	MNR	MNR	MNR	MNR	MNR	MNR
13:00	MNR	MNR	MNR	MNR	ERROR	MNR	MNR
14:00	MNR	MNR	MNR	MNR	MNR	MNR	MNR
15:00	MNR	MNR	MNR	MNR	MNR	MNR	MNR
16:00	MNR	MNR	MNR	MNR	MNR	MNR	MNR
17:00	MNR	MNR	MNR	MNR	MNR	MNR	MNR
18:00	MNR	MNR	MNR	MNR	MNR	MNR	MNR
19:00	MNR	MNR	MNR	MNR	MNR	MNR	MNR
20:00	MNR	MNR	MNR	MNR	MNR	MNR	MNR
21:00	MNR	MNR	MNR	MNR	MNR	MNR	MNR
22:00	MNR	MNR	MNR	MNR	MNR	MNR	MNR
23:00	MNR	MNR	MNR	MNR	MNR	MNR	MNR
24:00	MNR	MNR	MNR	MNR	MNR	MNR	MNR
Total	MNR	MNR	MNR	MNR	MNR	MNR	MNR
Average	MNR	MNR	MNR	MNR	MNR	MNR	MNR
Maximum	MNR	MNR	MNR	MNR	MNR	MNR	MNR
Minimum	MNR	MNR	MNR	MNR	MNR	MNR	MNR
Rolling Excess	84.44	2.69	0.037	188.35	2.36	9.31	0.08
		0	2	0	0	0	10
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24
MNR	24	24	24	24	24	24	24
ND	0	0	0	0	0	0	0
OC	0	0	0	0	0	0	0
CAL	0	0	0	0	0	0	0
Bad Per	0	0	0	0	0	0	0
MUT %	87.50	86.74	87.12	86.74	86.93	77.27	77.27
MDT Per	66	70	68	70	69	120	120

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Emissions Data

Daily Report for 09/25/2001

Time	Kiln SO2 SO2 ppm Avg.	Kiln NOx NOx ppm Avg.	Kiln THC THC ppm Avg.	Kiln Flow ACFM Avg.	Kiln Flow Flow SCFM Avg.	Kiln Flow Flow DSCFM Avg.	Kiln Temp. Deg. F Avg.	Coal Mill Temp. Deg. F Avg.
01:00	0.09	0.19	0.15	36434	36686	31183	103	72
02:00	0.09	0.17	0.15	56780	68612	58323	103	73
03:00	0.09	0.08	0.15	60993	47397	40288	102	73
04:00	0.09	0.10	0.15	51712	47445	40328	102	73
05:00	0.09	0.11	0.15	48377	54987	46739	98	72
06:00	0.09	0.00	0.15	49289	42026	35723	96	70
07:00	0.09	0.00	0.13	44966	39625	33681	95	67
08:00	0.09	0.00	0.13	54385	59664	50714	96	67
09:00	0.09	0.00	0.13	61356	51369	43663	97	67
10:00	0.09	0.00	0.13	57637	53736	45675	97	68
11:00	0.09	0.00	0.13	48903	47563	40429	98	71
12:00	0.09	0.00	0.13	59888	65209	55428	101	74
13:00	0.09	0.00	0.13	59433	26166	22241	102	76
14:00	0.09	0.01	0.96	36028	59265	50375	109	78
15:00	0.09	0.04	0.37	63877	57767	49101	121	79
16:00	1.71	59.29	24.37	36373	5876	4995	130	80
17:00	18.83	0.69	10.36	45510	49846	42369	143	82
18:00	0.22	0.50	6.26	34802	47743	40582	162	81
19:00	0.11	0.56	4.74	16185	0	0	171	80
20:00	0.09	0.81	0.13	0	0	0	176	77
21:00	0.09	1.11	0.12	0	0	0	176	74
22:00	0.09	1.29	0.12	0	0	0	178	71
23:00	0.09	0.71	0.12	0	0	0	182	68
24:00	0.09	1.25	0.12	0	0	0	186	66
Average	0.94	2.79	2.06	38455	35874	30493	126	73
Maximum	18.83	59.29	24.37	63877	68612	58323	186	82
Minimum	0.09	0.00	0.12	0	0	0	95	66
Rolling	1.87	176.06	6.65	194743	150099	127583	213	156
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0	0
OC	0	0	0	0	0	0	0	0
CAL	0	0	0	0	0	0	0	0
Bad Per	0	0	0	0	0	0	0	0
MUT %	89.00	89.00	76.33	88.33	88.67	88.67	89.00	89.00
MDT Per	66	66	142	70	68	68	66	66

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 09/26/2001

Time	Clinker Prod. Tons/Hr. Avg.	Kiln SO2 SO2 Lbs./Hr. Avg.	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	0.96	0.00	0.004	0.07	0.08	0.00	0.00
02:00	0.96	0.00	0.000	0.00	0.00	0.00	0.00
03:00	0.96	0.03	0.030	0.48	0.50	0.03	0.03
04:00	0.96	0.04	0.041	0.78	0.81	0.04	0.04
05:00	0.97	24.75	0.041	1.34	1.38	0.04	0.04
06:00	0.98	24.68	0.041	9.47	0.00	0.02	0.02
07:00	0.98	65.23X	0.041	112.47	0.00	0.05	0.05
08:00	0.99	76.76X	0.041	289.29X	0.00	0.05	0.05
09:00	0.99	72.49X	0.041	273.16X	0.00	0.05	0.05
10:00	0.99	64.24X	0.041	177.86	0.00	0.04	0.05
11:00	0.99	57.67X	0.041	165.55	0.00	0.04	0.04
12:00	0.99	50.25X	0.041	189.39	0.00	0.04	0.04
13:00	0.99	46.38X	0.041	174.79	0.00	0.03	0.03
14:00	0.99	55.69X	0.041	209.89	0.00	0.04	0.04
15:00	2.18	38.39X	0.041	120.95	0.00	6.21	5.39X
16:00	35.10	95.82X	0.041	75.13	2.18	31.75X	0.92X
17:00	61.81	14.84	0.242	55.65	0.90	36.64X	0.59X
18:00	74.14	14.99	0.203	144.47	1.95	24.14X	0.33X
19:00	82.40	0.11	0.001	216.78	2.63	11.02	0.13
20:00	84.23	0.10	0.001	204.55	2.43	10.43	0.12
21:00	89.29	0.10	0.001	134.50	1.51	27.21X	0.30X
22:00	92.03	8.72	0.095	74.55	0.81	36.36X	0.40X
23:00	91.40	0.10	0.001	192.06	2.10	11.71	0.13
24:00	89.77	0.10	0.001	200.41	2.23	13.44	0.15
Total	716.05	711.47	1.112	3023.59	19.51	209.38	8.94
Average	29.84	29.64	0.046	125.98	0.81	8.72	0.37
Maximum	92.03	95.82	0.242	289.29	2.63	36.64	5.39
Minimum	0.96	0.00	0.000	0.00	0.00	0.00	0.00
Rolling	82.34	3.60	0.038	187.50	2.33	9.14	0.10
Excess		10	0	2	0	5	6
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0
OC	0	0	0	0	0	0	0
CAL	0	0	0	0	0	0	0
Bad Per	0	0	0	0	0	0	0
MUT %	88.04	87.32	87.68	87.32	87.50	78.26	78.26
MDT Per	66	70	68	70	69	120	120

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Emissions Data

Daily Report for 09/26/2001

Time	Kiln SO2 SO2 ppm Avg.	Kiln NOx NOx ppm Avg.	Kiln THC THC ppm Avg.	Kiln Flow ACFM Avg.	Kiln Flow Flow SCFM Avg.	Kiln Flow DSCFM Avg.	Kiln Temp. Deg. F Avg.	Coal Mill Temp. Deg. F Avg.
01:00	0.09	1.88	0.12	6641	0	0	193	65
02:00	0.09	1.95	0.12	0	0	0	198	64
03:00	0.09	2.16	0.12	46484	54899	46664	203	64
04:00	0.09	2.53	0.12	63682	39818	33846	207	66
05:00	63.04	4.88	0.12	57660	53281	45289	212	108
06:00	147.76	78.50	0.12	24491	0	0	216	115
07:00	149.73	371.52	0.13	65864	56430	47965	221	125
08:00	149.76	785.91	0.13	78062	60035	51029	226	154
09:00	149.75	785.91	0.12	73836	56980	48433	228	161
10:00	149.52	572.34	0.13	66048	43913	37325	233	152
11:00	149.73	604.52	0.13	59918	35913	30526	242	145
12:00	149.75	785.89	0.13	53256	27674	23523	256	146
13:00	149.75	785.98	0.13	50373	39689	33736	272	144
14:00	149.77	786.08	0.13	61755	61658	52409	288	142
15:00	57.98	267.20	10.63	113770	85330	72530	289	147
16:00	119.15	132.21	48.24	130532	113028	96074	264	173
17:00	16.17	82.56	48.29	149600	117074	99512	260	175
18:00	15.18	201.94	30.42	157548	123806	105230	257	175
19:00	0.11	297.88	13.50	161024	123744	105178	257	175
20:00	0.09	272.79	12.33	165728	121474	103252	255	175
21:00	0.09	176.78	31.70	167632	127264	108176	253	174
22:00	8.31	98.51	42.70	166732	125796	106928	254	174
23:00	0.09	250.52	13.54	169816	117284	99690	257	174
24:00	0.09	263.40	15.63	168404	121100	102936	256	174
Average	67.76	317.24	11.20	94119	71091	60427	242	140
Maximum	149.77	786.08	48.29	169816	127264	108176	289	175
Minimum	0.09	1.88	0.12	0	0	0	193	64
Rolling	4.03	181.85	6.88	191561	146595	124605	214	156
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0	0
OC	0	0	0	0	0	0	0	0
CAL	0	0	0	0	0	0	0	0
Bad Per	0	0	0	0	0	0	0	0
MUT %	89.42	89.42	77.24	88.78	89.10	89.10	89.42	89.42
MDT Per	66	66	142	70	68	68	66	66

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 09/27/2001

Time	Clinker Prod. Tons/Hr. Avg.	Kiln SO2 SO2 Lbs./Hr. Avg.	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	90.71	0.10	0.001	269.71X	2.97X	8.96	0.10
02:00	87.37	0.10	0.001	283.71X	3.25X	9.14	0.10
03:00	85.31	0.10	0.001	167.16	1.96	15.79X	0.19X
04:00	87.58	0.10	0.001	123.27	1.41	22.45X	0.26X
05:00	89.95	0.10	0.001	155.89	1.73	13.48	0.15
06:00	95.39	0.10	0.001	170.17	1.78	10.54	0.11
07:00	94.87	0.11	0.001	157.57	1.66	7.70	0.08
08:00	94.91	0.11	0.001	134.16	1.41	7.69	0.08
09:00	95.38	0.11	0.001	214.38	2.25	6.34	0.07
10:00	94.75	0.11	0.001	201.07	2.12	8.01	0.08
11:00	92.67	0.11	0.001	171.59	1.85	8.92	0.10
12:00	94.34	0.20	0.002	92.58	0.98	14.14	0.15
13:00	95.35	0.50	0.005	103.52	1.09	11.69	0.12
14:00	94.34	0.26	0.003	174.93	1.85	9.23	0.10
15:00	95.42	0.24	0.003	168.75	1.77	9.79	0.10
16:00	95.38	0.68	0.007	161.91	1.70	8.45	0.09
17:00	94.90	0.32	0.003	178.45	1.88	8.03	0.08
18:00	95.36	0.95	0.010	99.36	1.04	15.17	0.16
19:00	94.35	0.42	0.004	86.31	0.91	11.60	0.12
20:00	95.43	0.44	0.005	133.93	1.40	25.50X	0.27X
21:00	95.38	0.53	0.006	182.25	1.91	10.39	0.11
22:00	94.87	0.34	0.004	212.55	2.24	6.70	0.07
23:00	94.90	0.27	0.003	160.68	1.69	6.74	0.07
24:00	95.38	0.21	0.002	149.54	1.57	8.17	0.09
Total	2244.29	6.50	0.068	3953.44	42.42	264.62	2.85
Average	93.51	0.27	0.003	164.73	1.77	11.03	0.12
Maximum	95.43	0.95	0.010	283.71	3.25	25.50	0.27
Minimum	85.31	0.10	0.001	86.31	0.91	6.34	0.07
Rolling	82.37	3.47	0.036	189.31	2.35	8.98	0.10
Excess		0	0	2	2	3	3
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0
OC	0	0	0	0	0	0	0
CAL	0	0	0	0	0	0	0
Bad Per	0	0	0	0	0	0	0
MUT %	88.54	87.85	88.19	87.85	88.02	79.17	79.17
MDT Per	66	70	68	70	69	120	120

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Emissions Data

Daily Report for 09/27/2001

Time	Kiln SO2 SO2 ppm Avg.	Kiln NOx NOx ppm Avg.	Kiln THC THC ppm Avg.	Kiln Flow ACFM Avg.	Kiln Flow Flow SCFM Avg.	Kiln Flow Flow DSCFM Avg.	Kiln Temp. Deg. F Avg.	Coal Mill Temp. Deg. F Avg.
01:00	0.09	355.85	10.48	168936	125452	106632	262	174
02:00	0.09	380.08	10.88	167920	118956	101110	269	175
03:00	0.09	227.84	18.76	166608	128290	109044	270	175
04:00	0.09	161.74	26.33	170936	125676	106824	269	175
05:00	0.09	202.13	15.52	174620	129036	109682	273	174
06:00	0.09	215.91	11.83	178696	144436	122772	272	174
07:00	0.09	175.61	7.61	194336	150472	127902	242	174
08:00	0.09	152.75	7.77	193604	146556	124576	254	174
09:00	0.09	245.54	6.44	194284	142392	121034	261	174
10:00	0.09	241.16	8.53	188372	136888	116356	272	173
11:00	0.09	208.85	9.61	187116	128928	109590	276	174
12:00	0.17	111.71	15.15	189348	133672	113618	280	175
13:00	0.44	125.23	12.57	189572	148372	126114	284	178
14:00	0.26	244.80	11.47	167640	118456	100686	298	178
15:00	0.25	240.36	12.38	164628	112266	95426	300	179
16:00	0.54	195.62	9.07	192608	162268	137928	280	179
17:00	0.22	184.39	7.41	215012	158428	134660	241	179
18:00	0.67	99.66	14.27	218936	125448	106630	252	178
19:00	0.34	104.91	12.58	191004	161520	137288	279	180
20:00	0.29	124.13	20.59	230272	180484	153412	228	178
21:00	0.34	164.69	8.31	231932	186176	158248	218	179
22:00	0.22	191.96	5.36	230308	180748	153636	213	179
23:00	0.17	144.10	5.36	231508	191896	163112	212	176
24:00	0.13	133.02	6.46	231688	186200	158268	208	175
Average	0.21	193.00	11.45	194579	146792	124773	259	176
Maximum	0.67	380.08	26.33	231932	191896	163112	300	180
Minimum	0.09	99.66	5.36	164628	112266	95426	208	173
Rolling	1.71	172.70	6.91	188757	146762	124747	211	153
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0	0
OC	0	0	0	0	0	0	0	0
CAL	0	0	0	0	0	0	0	0
Bad Per	0	0	0	0	0	0	0	0
MUT %	89.81	89.81	78.09	89.20	89.51	89.51	89.81	89.81
MDT Per	66	66	142	70	68	68	66	66

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 09/28/2001

Time	Clinker Prod. Tons/Hr. Avg.	Kiln SO2 SO2 Lbs./Hr. Avg.	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	94.91	0.14	0.002	100.54	1.06	15.60X	0.16X
02:00	95.38	0.16	0.002	88.86	0.93	29.52X	0.31X
03:00	94.87	0.19	0.002	86.38	0.91	28.38X	0.30X
04:00	94.74	0.14	0.002	86.03	0.91	21.95X	0.23X
05:00	91.95	0.14	0.002	73.50	0.80	31.70X	0.34X
06:00	89.80	0.15	0.002	68.21	0.76	34.92X	0.39X
07:00	91.63	0.14	0.002	62.69	0.68	OC	OC
08:00	94.88	0.16	0.002	89.75	0.95	19.04X	0.20X
09:00	95.35	0.15	0.002	120.85	1.27	9.64	0.10
10:00	ND	ND	ND	ND	ND	ND	ND
11:00	95.41	0.15	0.002	134.60	1.41	6.90	0.07
12:00	95.38	0.21	0.002	163.32	1.71	4.44	0.05
13:00	92.03	0.13	0.002	96.40	1.07	0.65	0.01
14:00	22.29	0.09	0.007	24.32	1.43	0.12	0.01
15:00	0.97	0.07	0.070	4.85	4.98X	0.08	0.08
16:00	0.97	0.05	0.047	1.95	2.00	0.06	0.06
17:00	0.98	0.05	0.049	1.69	1.73	0.06	0.06
18:00	0.98	2.93	2.991X	10.96	11.23X	0.06	0.06
19:00	0.98	0.06	0.060	7.13	7.31X	0.05	0.06
20:00	0.98	0.05	0.048	1.49	1.52	0.06	0.06
21:00	0.98	0.05	0.049	1.51	1.54	0.06	0.06
22:00	0.97	0.05	0.050	2.07	2.13	0.06	0.06
23:00	0.97	0.04	0.039	2.03	2.09	0.05	0.05
24:00	0.97	0.14	0.147	4.29	4.40X	0.05	0.05
Total	1158.37	5.44	3.581	1233.42	52.82	203.45	2.77
Average	50.36	0.24	0.156	53.63	2.30	9.25	0.13
Maximum	95.41	2.93	2.991	163.32	11.23	34.92	0.39
Minimum	0.97	0.04	0.002	1.49	0.68	0.05	0.01
Rolling	80.95	3.38	0.041	186.27	2.38	8.58	0.10
Excess		0	1	0	4	8	8
Uptm %	95.83	95.83	95.83	95.83	95.83	91.67	91.67
# Per	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0
ND	1	1	1	1	1	1	1
OC		0	0	0	0	1	1
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	88.83	88.17	88.50	88.17	88.33	79.67	79.67
MDT Per	67	71	69	71	70	122	122

Key:
 U, UD User Disable F, IF Instrument Failure C, Cal Calibration
 R, OC Out of Control N, ND No Data M, MNR Monitoring Not Required
 V, Valid Valid Data W, Warning Drift Warning

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Emissions Data

Daily Report for 09/28/2001

Time	Kiln SO2 SO2 ppm Avg.	Kiln NOx NOx ppm Avg.	Kiln THC THC ppm Avg.	Kiln Flow ACFM Avg.	Kiln Flow Flow SCFM Avg.	Kiln Flow DSCFM Avg.	Kiln Temp. Deg. F Avg.	Coal Mill Temp. Deg. F Avg.
01:00	0.09	89.47	12.31	231676	179832	152856	207	177
02:00	0.10	79.41	23.42	229852	180288	153244	205	177
03:00	0.12	77.10	22.46	230044	186264	158324	205	177
04:00	0.09	76.35	17.28	231960	179124	152256	207	178
05:00	0.09	65.58	25.08	231124	176452	149984	208	177
06:00	0.09	60.20	27.28	233708	185444	157628	208	176
07:00	0.09	56.27	OC	229000	195240	165948	205	175
08:00	0.09	73.74	14.93	236500	184672	166208	207	175
09:00	0.09	100.56	7.51	233576	185736	167164	206	175
10:00	ND	ND	ND	ND	190168	161644	ND	ND
11:00	0.09	117.12	5.33	236276	185884	158000	206	173
12:00	0.13	143.91	3.47	233024	182384	155024	205	173
13:00	0.10	99.37	0.54	182780	130832	117750	202	126
14:00	0.09	31.96	0.15	140416	108786	97910	193	98
15:00	0.10	8.93	0.15	94394	49560	44605	204	90
16:00	0.09	5.47	0.15	71160	59279	53352	226	89
17:00	0.09	4.48	0.15	74578	53704	48334	224	98
18:00	5.29	28.26	0.15	77182	53821	48441	219	109
19:00	0.12	21.29	0.15	68302	65443	58899	222	88
20:00	0.09	4.08	0.15	72078	51149	46034	218	81
21:00	0.09	3.99	0.15	74220	51623	46462	215	76
22:00	0.09	5.47	0.15	73648	43258	38933	207	74
23:00	0.09	6.92	0.15	56699	58362	52525	201	72
24:00	0.29	12.60	0.15	61682	63073	56766	201	87
Average	0.33	50.98	7.33	156690	125016	108679	209	131
Maximum	5.29	143.91	27.28	236500	195240	167164	226	178
Minimum	0.09	3.99	0.15	56699	43258	38933	193	72
Rolling	3.87	175.37	6.85	184642	145188	123489	211	152
Uptm %	95.83	95.83	91.67	95.83	100.00	100.00	95.83	95.83
# Per	24	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0	0
ND	1	1	1	1	0	0	1	1
OC	0	0	1	0	0	0	0	0
CAL	0	0	0	0	0	0	0	0
Bad Per	0	0	0	0	0	0	0	0
MUT %	90.03	90.03	78.57	89.43	89.88	89.88	90.03	90.03
MDT Per	67	67	144	71	68	68	67	67

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 09/29/2001

Time	Clinker Prod. Tons/Hr. Avg.	Kiln SO2 SO2 Lbs./Hr. Avg.	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	MNR	6.21	MNR	89.95	MNR	1.85	MNR
02:00	33.60	0.20	0.006	163.60	4.93X	0.16	0.00
03:00	53.57	0.09	0.002	164.09	3.06X	0.17	0.00
04:00	59.99	0.10	0.002	222.87	3.72X	0.13	0.00
05:00	70.05	0.13	0.002	247.98	3.54X	0.15	0.00
06:00	76.51	0.15	0.002	244.81	3.20X	0.18	0.00
07:00	73.93	0.15	0.002	229.06	3.10X	1.04	0.01
08:00	64.32	0.15	0.002	245.70	3.82X	1.36	0.02
09:00	68.76	0.15	0.002	247.46	3.60X	1.89	0.03
10:00	71.07	0.15	0.002	279.19X	3.93X	2.91	0.04
11:00	73.31	0.16	0.002	287.74X	3.93X	3.62	0.05
12:00	75.06	0.15	0.002	222.25	2.96X	4.70	0.06
13:00	77.91	0.15	0.002	197.95	2.54	4.50	0.06
14:00	81.36	0.15	0.002	152.44	1.87	5.20	0.06
15:00	85.35	0.16	0.002	170.83	2.00	8.37	0.10
16:00	88.63	0.16	0.002	110.80	1.25	7.23	0.08
17:00	89.67	0.15	0.002	145.05	1.62	5.86	0.07
18:00	89.19	0.15	0.002	136.75	1.53	6.29	0.07
19:00	89.67	0.15	0.002	128.83	1.44	5.32	0.06
20:00	89.14	0.15	0.002	145.41	1.63	4.87	0.05
21:00	89.18	0.16	0.002	157.78	1.77	5.26	0.06
22:00	89.74	0.16	0.002	143.19	1.60	5.69	0.06
23:00	90.26	0.15	0.002	144.88	1.61	6.68	0.07
24:00	90.33	0.15	0.002	164.07	1.82	6.25	0.07
Total	1770.60	9.64	0.050	4442.68	60.47	89.68	1.02
Average	76.98	0.40	0.002	185.11	2.63	3.74	0.04
Maximum	90.33	6.21	0.006	287.74	4.93	8.37	0.10
Minimum	33.60	0.09	0.002	89.95	1.25	0.13	0.00
Rolling	84.38	3.25	0.030	187.04	2.31	8.54	0.11
Excess		0	1	2	12	0	1
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24
MNR	1	0	1	0	1	0	1
ND	0	0	0	0	0	0	0
OC		0	0	0	0	0	0
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	89.25	88.62	88.92	88.62	88.76	80.45	80.42
MDT Per	67	71	69	71	70	122	122

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Emissions Data

Daily Report for 09/29/2001

Time	Kiln SO2 SO2 ppm Avg.	Kiln NOx NOx ppm Avg.	Kiln THC THC ppm Avg.	Kiln Flow ACFM Avg.	Kiln Flow Flow SCFM Avg.	Kiln Flow Flow DSCFM Avg.	Kiln Temp. Deg. F Avg.	Coal Mill Temp. Deg. F Avg.
01:00	7.31	147.63	2.70	117276	99732	89760	224	107
02:00	0.23	258.65	0.24	129248	95266	85738	241	138
03:00	0.09	242.02	0.24	139224	116680	105014	246	169
04:00	0.09	278.25	0.15	165612	149488	134540	245	169
05:00	0.09	255.17	0.15	199516	185852	167268	241	169
06:00	0.09	212.09	0.15	226768	185376	166844	213	168
07:00	0.09	191.75	0.81	232968	190872	171788	209	169
08:00	0.09	209.40	1.09	228468	184276	165852	207	168
09:00	0.09	209.84	1.51	228064	176828	159148	203	167
10:00	0.09	237.69	2.33	226884	169504	152560	201	168
11:00	0.10	247.39	2.92	223436	185204	166684	198	169
12:00	0.09	187.45	3.74	226836	172792	155520	197	168
13:00	0.09	168.80	3.60	225632	185324	166792	200	167
14:00	0.09	130.45	4.19	223888	181428	163288	197	170
15:00	0.10	145.01	6.67	226488	182020	163820	198	169
16:00	0.09	93.65	5.74	227052	175744	158172	198	169
17:00	0.09	121.62	4.62	230260	187016	168316	202	167
18:00	0.09	115.50	4.98	227844	188632	169772	199	169
19:00	0.09	108.19	4.20	228832	191792	172612	199	171
20:00	0.09	121.14	3.81	231368	188220	169400	201	172
21:00	0.09	129.62	4.06	236904	180052	162048	207	172
22:00	0.09	117.57	4.39	239628	178976	161080	214	171
23:00	0.09	120.14	5.20	237884	194480	175028	216	172
24:00	0.09	135.30	4.84	236624	187348	168616	209	171
Average	0.40	174.35	3.01	213196	172204	154986	211	165
Maximum	7.31	278.25	6.67	239628	194480	175028	246	172
Minimum	0.09	93.65	0.15	117276	95266	85738	197	107
Rolling	3.82	179.45	6.68	185604	146020	124484	212	153
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0	0
OC	0	0	0	0	0	0	0	0
CAL	0	0	0	0	0	0	0	0
Bad Per	0	0	0	0	0	0	0	0
MUT %	90.37	90.37	79.31	89.80	90.23	90.23	90.37	90.37
MDT Per	67	67	144	71	68	68	67	67

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 09/30/2001

Time	Clinker Prod. Tons/Hr. Avg.	Kiln SO2 SO2 Lbs./Hr. Avg.	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	91.49	0.15	0.002	168.60	1.84	6.92	0.08
02:00	92.14	0.15	0.002	174.35	1.89	7.56	0.08
03:00	94.33	0.15	0.002	152.71	1.62	8.20	0.09
04:00	95.41	0.15	0.002	180.48	1.89	7.52	0.08
05:00	95.35	0.15	0.002	199.67	2.09	7.56	0.08
06:00	94.33	0.15	0.002	179.09	1.90	8.91	0.09
07:00	95.40	0.15	0.002	195.86	2.05	3.98	0.04
08:00	95.18	0.15	0.002	206.30	2.17	3.60	0.04
09:00	90.76	0.15	0.002	203.45	2.24	3.52	0.04
10:00	89.66	0.15	0.002	201.89	2.25	4.09	0.05
11:00	89.13	0.15	0.002	168.06	1.89	4.71	0.05
12:00	89.27	0.15	0.002	128.63	1.44	7.80	0.09
13:00	92.08	0.15	0.002	140.53	1.53	6.79	0.07
14:00	93.15	0.15	0.002	121.32	1.30	7.80	0.08
15:00	93.00	0.15	0.002	130.67	1.40	5.56	0.06
16:00	89.67	0.15	0.002	132.74	1.48	5.11	0.06
17:00	89.18	0.15	0.002	143.54	1.61	5.11	0.06
18:00	89.71	0.16	0.002	139.34	1.55	5.36	0.06
19:00	89.91	0.15	0.002	123.54	1.37	5.33	0.06
20:00	94.33	0.16	0.002	123.24	1.31	5.16	0.05
21:00	95.38	0.15	0.002	130.63	1.37	4.29	0.04
22:00	94.64	0.16	0.002	138.49	1.46	4.26	0.04
23:00	90.23	0.16	0.002	135.78	1.50	3.97	0.04
24:00	89.71	0.15	0.002	137.12	1.53	4.27	0.05
Total	2213.44	3.69	0.048	3756.03	40.68	137.38	1.49
Average	92.23	0.15	0.002	156.50	1.69	5.72	0.06
Maximum	95.41	0.16	0.002	206.30	2.25	8.91	0.09
Minimum	89.13	0.15	0.002	121.32	1.30	3.52	0.04
Rolling	80.30	3.13	0.045	189.11	2.55	8.31	0.10
Excess		0	0	0	0	0	0
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0
OC	0	0	0	0	0	0	0
CAL	0	0	0	0	0	0	0
Bad Per	0	0	0	0	0	0	0
MUT %	89.66	89.04	89.35	89.04	89.20	81.17	81.17
MDT Per	67	71	69	71	70	122	122

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.
Thompson S. Baker Cement Plant
Kiln/Raw Mill Stack Emissions Data

Daily Report for 09/30/2001

Time	Kiln SO2 SO2 ppm Avg.	Kiln NOx NOx ppm Avg.	Kiln THC THC ppm Avg.	Kiln Flow ACFM Avg.	Kiln Flow Flow SCFM Avg.	Kiln Flow Flow DSCFM Avg.	Kiln Temp. Deg. F Avg.	Coal Mill Temp. Deg. F Avg.
01:00	0.09	140.16	5.39	234368	185600	167048	207	173
02:00	0.09	147.09	5.99	231192	177384	159652	209	174
03:00	0.09	129.36	6.53	229656	176752	159080	207	175
04:00	0.09	151.29	5.92	231684	178108	160300	206	175
05:00	0.09	168.65	5.99	229900	180776	162704	205	175
06:00	0.09	150.67	7.04	229692	179332	161400	202	175
07:00	0.09	163.65	3.12	231296	193604	174248	202	175
08:00	0.09	174.11	2.85	226160	177084	159372	194	175
09:00	0.09	173.45	2.82	224880	182136	163924	197	173
10:00	0.09	170.97	3.26	227200	187396	168656	199	172
11:00	0.09	142.83	3.76	226352	181412	163268	200	173
12:00	0.09	110.11	6.28	225132	184840	166356	201	174
13:00	0.09	120.39	5.46	225688	176420	158776	203	175
14:00	0.09	103.80	6.27	226844	183752	165376	205	175
15:00	0.09	110.72	4.43	229620	183312	164980	207	176
16:00	0.09	111.59	4.03	232112	177468	159724	209	176
17:00	0.09	118.86	3.98	237100	189492	170548	213	177
18:00	0.09	115.54	4.18	236156	175564	158012	212	176
19:00	0.09	105.60	4.28	226264	180760	162688	203	176
20:00	0.10	105.99	4.17	223308	177688	159920	198	178
21:00	0.09	111.79	3.45	224744	179092	161184	199	178
22:00	0.10	118.19	3.41	224900	177980	160188	198	178
23:00	0.10	116.42	3.19	225372	183156	164840	202	178
24:00	0.09	116.27	3.40	227472	177024	159324	201	177
Average	0.09	132.40	4.55	228629	181089	162982	203	175
Maximum	0.10	174.11	7.04	237100	193604	174248	213	178
Minimum	0.09	103.80	2.82	223308	175564	158012	194	172
Rolling	3.81	172.49	6.52	184941	146037	124800	211	152
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0	0
OC	0	0	0	0	0	0	0	0
CAL	0	0	0	0	0	0	0	0
Bad Per	0	0	0	0	0	0	0	0
MUT %	90.69	90.69	80.00	90.14	90.56	90.56	90.69	90.69
MDT Per	67	67	144	71	68	68	67	67

Key:
 U, UD User Disable
 R, OC Out of Control
 V, Valid Valid Data
 F, IF Instrument Failure
 N, ND No Data
 W, Warning Drift Warning
 C, Cal Calibration
 M, MNR Monitoring Not Required