

**FLORIDA ROCK INDUSTRIES INC**

CEMENT GROUP / 4000 N.W. CR 235 / P.O. Box 459 / Newberry, FL 32669 / (352) 472-4722



April 19, 2002

Mr. Greg DeAngelo  
Bureau of Air Regulations  
New Source Review Section  
Division of Air resource Management  
Florida Department of Environmental Protection  
Twin Towers Office Building  
2600 Blair Stone Road MS 5510  
Tallahassee, Florida 32399-2400

RECEIVED

APR 22 2002

BUREAU OF AIR REGULATION

Re: CEMS Data Submittal

Dear Mr. DeAngelo:

After the errors that you pointed out in the clinker tons per hour for the dates of March 5, 7, 14, 16, 17, 2002 were corrected and the corrected sheets were faxed to you, I realized that it would be necessary to reprint the data sheets for March 5 - 31, 2002 after the clinker ton per hour corrections. The changes in the data for the aforementioned dates, even though minor, would impact the remaining dates of March and CEMS quarterly and annual averages. Therefore, I am resubmitting the mass emission data sheets for March 5 - 31, 2002 and the associated chart for the month of march.

Should you have any question and/or comments concerning the above or require additional information, please contact me at (352) 472-4722.


Respectfully,

A handwritten signature in black ink that reads "George Townsend". The signature is written in a cursive, flowing style.

George Townsend  
Environmental & Safety Manager

pc: Cary O. Cohrs, Vice President, Operations

# March 2002 - Daily 30 Day Rolling Avg. NOx Lbs./Ton of Clinker

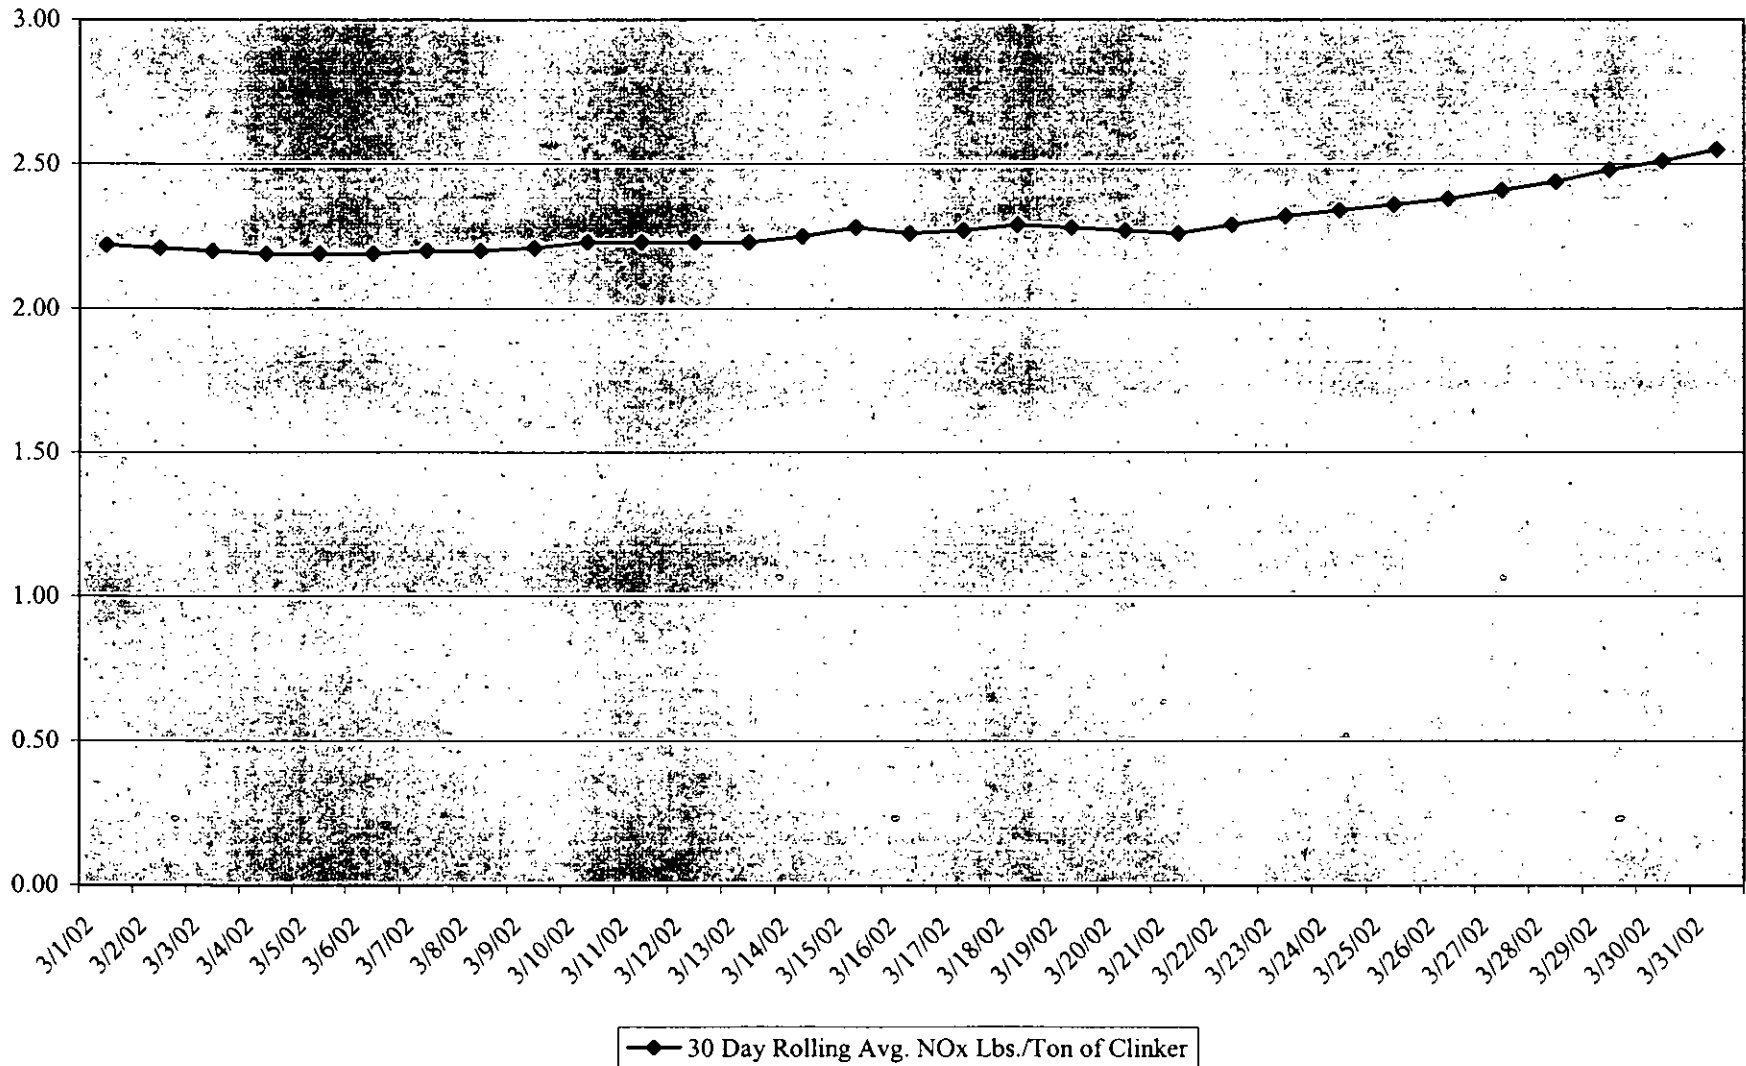

Florida Rock Industries Inc.  
Thompson S. Baker Cement Plant  
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 03/05/2002

Time	Clinker Prod. Tons/Hr. Avg.	Kiln SO2 SO2 Lbs./Hr. Avg.	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	96.66	0.00	0.000	205.07	2.12	2.65	0.03
02:00	96.68	0.00	0.000	216.82	2.24	2.69	0.03
03:00	96.66	0.00	0.000	217.43	2.25	3.08	0.03
04:00	96.65	0.00	0.000	192.30	1.99	3.13	0.03
05:00	96.67	0.00	0.000	200.82	2.08	3.19	0.03
06:00	96.09	0.00	0.000	201.09	2.09	3.03	0.03
07:00	90.96	0.00	0.000	236.89	2.60	2.95	0.03
08:00	90.94	0.00	0.000	216.34	2.38	2.66	0.03
09:00	90.96	0.00	0.000	224.53	2.47	1.87	0.02
10:00	91.93	0.00	0.000	209.55	2.28	1.42	0.02
11:00	92.72	0.00	0.000	194.68	2.10	1.85	0.02
12:00	94.97	0.02	0.000	178.96	1.89	1.92	0.02
13:00	96.14	0.30	0.003	176.31	1.83	1.88	0.02
14:00	58.57	0.11	0.001	127.82	2.18	1.60	0.03
15:00	MNR	0.00	MNR	31.23	MNR	-0.05	MNR
16:00	MNR	2.28	MNR	23.70	MNR	-0.04	MNR
17:00	MNR	10.05	MNR	12.32	MNR	-0.05	MNR
18:00	42.48	0.33	0.067	96.42	1.28	3.33	0.04
19:00	60.97	0.00	0.000	180.39	2.99X	0.07	0.00
20:00	74.75	0.00	0.000	184.27	2.46	1.41	0.02
21:00	82.64	0.00	0.000	184.17	2.24	0.18	0.00
22:00	92.37	0.00	0.000	154.71	1.68	0.03	0.00
23:00	93.88	0.02	0.000	152.16	1.62	0.03	0.00
24:00	93.88	0.03	0.000	150.91	1.61	0.02	0.00
Total	1827.57	13.14	0.071	3968.89	44.38	38.85	0.43
Average	87.03	0.55	0.003	165.37	2.11	1.62	0.02
Maximum	96.68	10.05	0.067	236.89	2.99	3.33	0.04
Minimum	42.48	0.00	0.000	12.32	1.28	-0.05	0.00
Rolling	86.95	1.84	0.017	175.02	2.19	5.59	0.07
Excess		0	2	0	3	0	0
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24
MNR	3	0	3	0	3	0	3
ND	0	0	0	0	0	0	0
OC		0	0	0	0	0	0
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	100.00	100.00	100.00	100.00	100.00	100.00	100.00
MDT Per	0	0	0	0	0	0	0

Key:  
 U, UD      User Disable  
 R, OC      Out of Control  
 V, Valid    Valid Data  
 F, IF      Instrument Failure  
 N, ND      No Data  
 W, Warning    Drift Warning  
 C, Cal      Calibration  
 M, MNR      Monitoring Not Required

Florida Rock Industries Inc.  
Thompson S. Baker Cement Plant  
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 03/06/2002

Time	Clinker Prod. Tons/Hr. Avg.	Kiln SO2 SO2 Lbs./Hr. Avg.	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	94.87	0.03	0.000	140.63	1.48	0.10	0.00
02:00	95.08	0.00	0.000	140.37	1.48	2.09	0.02
03:00	95.06	0.00	0.000	132.41	1.39	2.11	0.02
04:00	95.05	0.02	0.000	142.22	1.50	0.03	0.00
05:00	87.26	0.00	0.000	164.91	1.90	0.07	0.00
06:00	90.88	0.00	0.000	160.43	1.77	0.08	0.00
07:00	91.95	0.00	0.000	165.86	1.81	0.37	0.00
08:00	94.36	0.00	0.000	138.90	1.47	7.47	0.08
09:00	96.16	0.00	0.000	145.42	1.51	11.71	0.12
10:00	95.15	0.00	0.000	146.46	1.54	6.34	0.07
11:00	95.12	0.00	0.000	171.52	1.80	3.94	0.04
12:00	96.27	0.00	0.000	189.00	1.96	5.84	0.06
13:00	95.99	0.00	0.000	197.10	2.05	6.36	0.07
14:00	96.72	0.00	0.000	180.72	1.87	6.59	0.07
15:00	96.70	0.00	0.000	201.09	2.08	5.80	0.06
16:00	96.73	0.01	0.000	212.90	2.20	5.18	0.05
17:00	96.67	0.02	0.000	255.38	2.64	5.78	0.06
18:00	96.68	0.02	0.000	263.89	2.73	5.94	0.06
19:00	96.69	0.00	0.000	232.58	2.41	6.29	0.07
20:00	96.77	0.16	0.002	246.56	2.55	6.13	0.06
21:00	93.46	1.08	0.011	247.70	2.66	4.26	0.05
22:00	90.97	0.69	0.008	254.88	2.80X	4.32	0.05
23:00	90.97	0.59	0.007	259.73	2.85X	5.18	0.06
24:00	91.01	1.80	0.020	243.29	2.67	3.88	0.04
Total	2266.57	4.42	0.048	4633.95	49.12	105.86	1.11
Average	94.44	0.18	0.002	193.08	2.05	4.41	0.05
Maximum	96.77	1.80	0.020	263.89	2.85	11.71	0.12
Minimum	87.26	0.00	0.000	132.41	1.39	0.03	0.00
Rolling	86.86	1.77	0.018	174.48	2.19	5.57	0.07
Excess		0	0	0	2	0	0
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0
OC		0	0	0	0	0	0
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	100.00	100.00	100.00	100.00	100.00	100.00	100.00
MDT Per	0	0	0	0	0	0	0

Key:  
 U, UD      User Disable                      F, IF      Instrument Failure                      C, Cal      Calibration  
 R, OC      Out of Control                              N, ND      No Data                                      M, MNR      Monitoring Not Required  
 V, Valid      Valid Data                                      W, Warning      Drift Warning

Florida Rock Industries Inc.  
Thompson S. Baker Cement Plant  
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 03/07/2002

Time	Clinker Prod. Tons/Hr. Avg.	Kiln SO2 SO2 Lbs./Hr. Avg.	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	91.01	1.24	0.014	222.50	2.45	3.48	0.04
02:00	91.03	0.68	0.008	241.15	2.65	3.94	0.04
03:00	90.98	0.59	0.006	222.56	2.45	3.97	0.04
04:00	91.01	0.65	0.007	217.00	2.38	4.02	0.04
05:00	90.99	0.53	0.006	230.91	2.54	3.93	0.04
06:00	91.00	0.35	0.004	217.89	2.39	3.73	0.04
07:00	90.97	0.15	0.002	225.17	2.48	4.01	0.04
08:00	91.71	0.19	0.002	228.55	2.49	4.44	0.05
09:00	81.44	0.77	0.009	202.40	2.29	3.77	0.04
10:00	MNR	0.13	0.000	MNR	0.00	MNR	MNR
11:00	MNR	0.20	0.002	MNR	1.15	2.78	MNR
12:00	55.25	5.00	0.099	137.88	2.51	6.73	0.13
13:00	85.71	0.71	0.008	231.56	2.70	9.74	0.11
14:00	71.90	1.59	0.008	171.69	2.39	9.29	0.13
15:00	MNR	0.96	0.008	MNR	MNR	0.01	MNR
16:00	MNR	1.19	2.513X	MNR	MNR	0.04	MNR
17:00	MNR	0.97	0.003	MNR	MNR	0.45	MNR
18:00	62.50	1.25	0.020	179.26	2.82X	8.89	0.16X
19:00	88.58	2.28	0.026	238.41	2.69	4.37	0.05
20:00	86.78	1.83	0.021	265.99	3.07X	4.21	0.05
21:00	85.29	1.70	0.020	270.77X	3.17X	4.49	0.05
22:00	87.90	1.99	0.023	255.82	2.91X	5.03	0.06
23:00	91.26	1.88	0.021	260.88	2.86X	5.27	0.06
24:00	92.43	1.74	0.019	265.22	2.87X	5.23	0.06
Total	1617.74	28.57	2.849	4285.61	51.26	101.82	1.23
Average	85.14	1.19	0.119	225.56	2.44	4.43	0.06
Maximum	92.43	5.00	2.513	270.77	3.17	9.74	0.16
Minimum	55.25	0.13	0.000	137.88	0.00	0.01	0.04
Rolling	86.57	1.73	0.021	174.03	2.20	5.48	0.07
Excess		0	1	1	8	0	2
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24
MNR	5	0	0	5	3	1	5
ND	0	0	0	0	0	0	0
OC		0	0	0	0	0	0
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	100.00	100.00	100.00	100.00	100.00	100.00	100.00
MDT Per	0	0	0	0	0	0	0

Key:  
 U, UD      User Disable  
 R, OC      Out of Control  
 V, Valid    Valid Data  
 F, IF      Instrument Failure  
 N, ND      No Data  
 W, Warning    Drift Warning  
 C, Cal      Calibration  
 M, MNR      Monitoring Not Required

Florida Rock Industries Inc.  
Thompson S. Baker Cement Plant  
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 03/08/2002

Time	Clinker Prod. Tons/Hr. Avg.	Kiln SO2 SO2 Lbs./Hr. Avg.	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	92.77	1.47	0.016	262.33	2.83X	5.23	0.06
02:00	93.88	1.59	0.017	246.33	2.62	6.04	0.06
03:00	93.86	1.09	0.012	251.32	2.68	5.52	0.06
04:00	93.76	1.17	0.012	243.00	2.59	5.49	0.06
05:00	94.39	1.54	0.016	240.82	2.55	5.92	0.06
06:00	93.70	1.48	0.016	234.66	2.50	5.70	0.06
07:00	94.30	1.12	0.012	222.12	2.36	5.48	0.06
08:00	94.50	1.44	0.015	215.46	2.28	3.98	0.04
09:00	94.78	1.20	0.013	211.29	2.23	4.15	0.04
10:00	95.61	1.66	0.017	205.29	2.15	4.45	0.05
11:00	93.32	2.64	0.028	230.19	2.47	5.00	0.05
12:00	91.23	2.73	0.030	228.33	2.50	4.56	0.05
13:00	91.11	2.15	0.024	217.86	2.39	3.88	0.04
14:00	91.00	2.61	0.029	209.67	2.30	5.19	0.06
15:00	90.92	1.73	0.019	211.89	2.33	8.16	0.09
16:00	91.00	3.36	0.037	211.73	2.33	5.74	0.06
17:00	90.99	3.56	0.039	263.17	2.89X	5.67	0.06
18:00	78.31	2.66	0.035	249.83	3.20X	5.13	0.06
19:00	73.95	2.96	0.040	188.61	2.55	5.55	0.07
20:00	73.92	2.34	0.032	218.86	2.96X	5.74	0.08
21:00	73.95	2.40	0.032	241.25	3.26X	5.80	0.08
22:00	73.97	2.38	0.032	220.15	2.98X	6.08	0.08
23:00	76.35	1.04	0.014	175.67	2.30	13.47	0.18X
24:00	76.75	1.44	0.019	213.67	2.78	7.06	0.09
Total	2108.32	47.76	0.556	5413.50	62.03	138.99	1.60
Average	87.85	1.99	0.023	225.56	2.58	5.79	0.07
Maximum	95.61	3.56	0.040	263.17	3.26	13.47	0.18
Minimum	73.92	1.04	0.012	175.67	2.15	3.88	0.04
Rolling	86.75	1.77	0.022	175.17	2.20	5.19	0.07
Excess		0	0	0	6	0	1
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0
OC		0	0	0	0	0	0
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	100.00	100.00	100.00	100.00	100.00	100.00	100.00
MDT Per	0	0	0	0	0	0	0

Key:  
 U, UD      User Disable  
 R, OC      Out of Control  
 V, Valid    Valid Data  
 F, IF      Instrument Failure  
 N, ND      No Data  
 W, Warning    Drift Warning  
 C, Cal      Calibration  
 M, MNR      Monitoring Not Required

Florida Rock Industries Inc.  
Thompson S. Baker Cement Plant  
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 03/09/2002

Time	Clinker Prod. Tons/Hr. Avg.	Kiln SO2 SO2 Lbs./Hr. Avg.	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	74.85	1.74	0.023	194.20	2.59	6.21	0.08
02:00	73.99	1.60	0.022	201.53	2.72	6.34	0.09
03:00	73.86	1.57	0.021	197.50	2.67	5.45	0.07
04:00	72.09	1.40	0.019	115.03	1.60	8.64	0.12
05:00	73.97	1.83	0.025	169.57	2.29	6.34	0.09
06:00	73.96	1.52	0.020	177.35	2.40	6.76	0.09
07:00	74.53	1.54	0.021	209.04	2.80X	6.78	0.09
08:00	75.07	2.34	0.031	210.04	2.80X	5.24	0.07
09:00	75.48	2.87	0.038	200.82	2.66	5.58	0.07
10:00	76.74	2.61	0.034	210.32	2.74	6.11	0.08
11:00	76.79	2.41	0.031	206.15	2.68	7.19	0.09
12:00	76.74	3.06	0.040	186.04	2.42	7.65	0.10
13:00	76.71	4.02	0.052	217.68	2.84X	6.68	0.09
14:00	76.77	4.79	0.062	217.53	2.83X	8.02	0.10
15:00	76.70	4.75	0.062	204.47	2.67	7.85	0.10
16:00	76.77	3.14	0.041	193.15	2.52	10.10	0.13
17:00	76.78	4.06	0.053	191.55	2.49	5.90	0.08
18:00	76.74	4.28	0.056	181.38	2.36	6.04	0.08
19:00	76.74	3.77	0.049	183.61	2.39	5.56	0.07
20:00	77.01	2.76	0.036	165.16	2.15	7.18	0.09
21:00	77.34	2.37	0.031	183.16	2.37	5.65	0.07
22:00	77.34	2.38	0.031	182.16	2.36	5.08	0.07
23:00	77.31	2.90	0.038	162.90	2.11	12.61	0.16X
24:00	77.34	2.00	0.026	193.68	2.50	4.46	0.06
Total	1821.62	65.71	0.862	4554.02	59.96	163.42	2.14
Average	75.90	2.74	0.036	189.75	2.50	6.81	0.09
Maximum	77.34	4.79	0.062	217.68	2.84	12.61	0.16
Minimum	72.09	1.40	0.019	115.03	1.60	4.46	0.06
Rolling Excess	86.11	1.86	0.023	175.78	2.21	5.12	0.07
		0	0	0	4	0	1
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0
OC		0	0	0	0	0	0
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	100.00	100.00	100.00	100.00	100.00	100.00	100.00
MDT Per	0	0	0	0	0	0	0

Key:  
 U, UD      User Disable  
 R, OC      Out of Control  
 V, Valid    Valid Data  
 F, IF      Instrument Failure  
 N, ND      No Data  
 W, Warning    Drift Warning  
 C, Cal      Calibration  
 M, MNR      Monitoring Not Required

Florida Rock Industries Inc.  
Thompson S. Baker Cement Plant  
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 03/10/2002

Time	Clinker Prod. Tons/Hr. Avg.	Kiln SO2 SO2 Lbs./Hr. Avg.	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	77.34	1.68	0.022	198.65	2.57	4.93	0.06
02:00	77.35	2.94	0.038	194.88	2.52	5.57	0.07
03:00	77.35	3.28	0.042	159.42	2.06	6.85	0.09
04:00	77.36	2.19	0.028	185.11	2.39	5.16	0.07
05:00	77.34	1.09	0.014	158.07	2.04	6.08	0.08
06:00	77.34	0.29	0.004	132.46	1.71	7.44	0.10
07:00	76.77	0.10	0.001	152.89	1.99	6.02	0.08
08:00	76.72	0.00	0.000	172.38	2.25	6.88	0.09
09:00	76.76	0.02	0.000	180.30	2.35	6.35	0.08
10:00	76.73	0.12	0.002	159.80	2.08	7.82	0.10
11:00	76.78	0.34	0.004	191.03	2.49	6.63	0.09
12:00	76.76	1.28	0.017	196.69	2.56	6.41	0.08
13:00	76.75	1.78	0.023	176.66	2.30	6.63	0.09
14:00	76.74	1.14	0.015	182.02	2.37	6.42	0.08
15:00	76.75	1.06	0.014	178.52	2.33	10.07	0.13
16:00	76.72	0.99	0.013	195.14	2.54	6.98	0.09
17:00	76.75	1.07	0.014	191.11	2.49	7.29	0.10
18:00	76.71	1.06	0.014	188.28	2.45	6.57	0.09
19:00	76.72	1.14	0.015	180.79	2.36	8.01	0.10
20:00	76.78	0.10	0.001	188.39	2.45	8.37	0.11
21:00	76.74	0.04	0.000	175.48	2.29	7.63	0.10
22:00	76.75	0.00	0.000	168.93	2.20	7.67	0.10
23:00	76.75	0.00	0.000	162.52	2.12	8.22	0.11
24:00	76.75	0.00	0.000	176.52	2.30	6.92	0.09
Total	1845.51	21.71	0.281	4246.04	55.21	166.92	2.18
Average	76.90	0.90	0.012	176.92	2.30	6.95	0.09
Maximum	77.36	3.28	0.042	198.65	2.57	10.07	0.13
Minimum	76.71	0.00	0.000	132.46	1.71	4.93	0.06
Rolling	85.71	1.89	0.024	173.98	2.23	5.11	0.07
Excess		0	0	0	0	0	0
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0
OC		0	0	0	0	0	0
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	100.00	100.00	100.00	100.00	100.00	100.00	100.00
MDT Per	0	0	0	0	0	0	0

Key:  
 U, UD User Disable  
 R, OC Out of Control  
 V, Valid Valid Data  
 F, IF Instrument Failure  
 N, ND No Data  
 W, Warning Drift Warning  
 C, Cal Calibration  
 M, MNR Monitoring Not Required



Florida Rock Industries Inc.  
Thompson S. Baker Cement Plant  
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 03/11/2002

Time	Clinker Prod. Tons/Hr. Avg.	Kiln SO2 SO2 Lbs./Hr. Avg.	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	76.75	0.00	0.000	160.52	2.09	8.72	0.11
02:00	76.78	0.00	0.000	161.00	2.10	8.68	0.11
03:00	76.78	0.00	0.000	140.86	1.83	11.68	0.15
04:00	76.77	0.00	0.000	138.69	1.81	9.93	0.13
05:00	76.72	0.00	0.000	153.46	2.00	8.15	0.11
06:00	76.76	0.00	0.000	170.31	2.22	6.41	0.08
07:00	76.72	0.00	0.000	193.68	2.52	8.67	0.11
08:00	76.75	0.01	0.000	182.00	2.37	5.74	0.07
09:00	76.75	0.22	0.003	179.41	2.34	4.56	0.06
10:00	76.75	0.39	0.005	187.84	2.45	6.46	0.08
11:00	78.60	0.01	0.000	192.33	2.45	7.45	0.09
12:00	85.13	0.00	0.000	210.15	2.47	8.07	0.09
13:00	85.32	0.00	0.000	218.56	2.56	6.79	0.08
14:00	72.25	0.54	0.008	196.33	2.73	3.68	0.05
15:00	81.51	0.07	0.001	211.02	2.59	7.98	0.10
16:00	67.01	1.37	0.020	184.85	2.80X	3.96	0.06
17:00	18.91	0.64	0.020	77.66	6.49X	0.81	0.04
18:00	MNR	0.21	0.020	38.74	MNR	0.01	MNR
19:00	MNR	0.05	0.383X	11.80	MNR	0.01	MNR
20:00	MNR	0.02	0.383X	17.88	MNR	0.01	MNR
21:00	21.87	2.87	0.383X	55.84	9.05X	2.35	0.11
22:00	64.58	0.00	0.000	154.83	2.41	5.78	0.09
23:00	74.66	0.32	0.004	158.96	2.13	5.66	0.08
24:00	76.74	0.43	0.006	172.19	2.24	4.64	0.06
Total	1494.11	7.15	1.236	3568.91	59.65	136.20	1.86
Average	71.15	0.30	0.051	148.70	2.84	5.67	0.09
Maximum	85.32	2.87	0.383	218.56	9.05	11.68	0.15
Minimum	18.91	0.00	0.000	11.80	1.81	0.01	0.04
Rolling	85.62	1.90	0.025	173.75	2.23	5.10	0.07
Excess		0	3	0	6	0	0
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24
MNR	3	0	0	0	3	0	3
ND	0	0	0	0	0	0	0
OC		0	0	0	0	0	0
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	100.00	100.00	100.00	100.00	100.00	100.00	100.00
MDT Per	0	0	0	0	0	0	0

Key: U, UD User Disable F, IF Instrument Failure C, Cal Calibration  
R, OC Out of Control N, ND No Data M, MNR Monitoring Not Required  
V, Valid W, Warning Drift Warning

Florida Rock Industries Inc.  
Thompson S. Baker Cement Plant  
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 03/12/2002

Time	Clinker Prod. Tons/Hr. Avg.	Kiln SO2 SO2 Lbs./Hr. Avg.	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	76.76	0.17	0.002	176.25	2.30	4.53	0.06
02:00	76.75	0.10	0.001	179.44	2.34	4.74	0.06
03:00	76.77	0.01	0.000	171.87	2.24	4.80	0.06
04:00	76.72	0.00	0.000	160.59	2.09	5.24	0.07
05:00	76.72	0.00	0.000	162.59	2.12	4.96	0.06
06:00	76.76	0.00	0.000	162.85	2.12	5.05	0.07
07:00	77.79	0.00	0.000	169.09	2.17	5.64	0.07
08:00	78.47	0.00	0.000	201.44	2.57	7.15	0.09
09:00	78.45	0.41	0.005	191.00	2.43	6.99	0.09
10:00	78.43	1.23	0.016	196.88	2.51	8.47	0.11
11:00	79.99	1.43	0.018	200.68	2.51	8.43	0.11
12:00	81.04	1.98	0.024	208.62	2.57	8.89	0.11
13:00	79.80	2.05	0.026	213.13	2.67	7.85	0.10
14:00	88.85	2.88	0.032	203.85	2.30	10.49	0.12
15:00	96.73	3.88	0.040	237.74	2.46	11.45	0.12
16:00	96.72	4.44	0.046	234.59	2.43	11.60	0.12
17:00	96.70	4.43	0.046	229.38	2.37	11.93	0.12
18:00	96.80	4.68	0.048	243.99	2.52	10.44	0.11
19:00	93.43	4.60	0.049	239.47	2.57	9.76	0.10
20:00	90.84	4.63	0.051	271.57X	2.99X	8.95	0.10
21:00	MNR	MNR	0.051	MNR	MNR	MNR	MNR
22:00	MNR	MNR	0.000	MNR	MNR	MNR	MNR
23:00	MNR	MNR	0.000	MNR	MNR	MNR	MNR
24:00	MNR	MNR	0.000	MNR	MNR	MNR	MNR
Total	1674.52	36.92	0.455	4055.02	48.28	157.36	1.85
Average	83.73	1.85	0.019	202.75	2.41	7.87	0.09
Maximum	96.80	4.68	0.051	271.57	2.99	11.93	0.12
Minimum	76.72	0.00	0.000	160.59	2.09	4.53	0.06
Rolling	85.83	1.96	0.026	175.16	2.23	5.00	0.07
Excess		0	0	1	5	0	0
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24
MNR	4	4	0	4	4	4	4
ND	0	0	0	0	0	0	0
OC		0	0	0	0	0	0
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	100.00	100.00	100.00	100.00	100.00	100.00	100.00
MDT Per	0	0	0	0	0	0	0

Key: U, UD User Disable F, IF Instrument Failure C, Cal Calibration  
R, OC Out of Control N, ND No Data M, MNR Monitoring Not Required  
V, Valid Valid Data W, Warning Drift Warning

Florida Rock Industries Inc.  
Thompson S. Baker Cement Plant  
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 03/13/2002

Time	Clinker Prod. Tons/Hr. Avg.	Kiln SO2 SO2 Lbs./Hr. Avg.	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	MNR	MNR	0.000	MNR	MNR	MNR	MNR
02:00	MNR	MNR	0.000	MNR	MNR	MNR	MNR
03:00	MNR	MNR	0.000	MNR	MNR	MNR	MNR
04:00	MNR	MNR	0.000	MNR	MNR	MNR	MNR
05:00	MNR	MNR	0.000	MNR	MNR	MNR	MNR
06:00	MNR	MNR	0.000	MNR	MNR	MNR	MNR
07:00	MNR	MNR	0.000	MNR	MNR	MNR	MNR
08:00	MNR	MNR	0.000	MNR	MNR	MNR	MNR
09:00	MNR	MNR	0.000	MNR	MNR	MNR	MNR
10:00	MNR	MNR	0.000	MNR	MNR	MNR	MNR
11:00	MNR	MNR	0.000	MNR	MNR	MNR	MNR
12:00	MNR	MNR	0.000	MNR	MNR	MNR	MNR
13:00	MNR	MNR	0.000	MNR	MNR	MNR	MNR
14:00	MNR	MNR	0.000	MNR	MNR	MNR	MNR
15:00	MNR	MNR	0.000	MNR	MNR	MNR	MNR
16:00	MNR	MNR	0.000	MNR	MNR	MNR	MNR
17:00	MNR	MNR	0.000	MNR	MNR	MNR	MNR
18:00	MNR	MNR	0.000	MNR	MNR	MNR	MNR
19:00	MNR	MNR	0.000	MNR	MNR	MNR	MNR
20:00	MNR	MNR	0.000	MNR	MNR	MNR	MNR
21:00	MNR	MNR	0.000	MNR	MNR	MNR	MNR
22:00	MNR	MNR	0.000	MNR	MNR	MNR	MNR
23:00	MNR	MNR	0.000	MNR	MNR	MNR	MNR
24:00	MNR	MNR	0.000	MNR	MNR	MNR	MNR
Total	MNR	MNR	0.000	MNR	MNR	MNR	MNR
Average	MNR	MNR	0.000	MNR	MNR	MNR	MNR
Maximum	MNR	MNR	0.000	MNR	MNR	MNR	MNR
Minimum	MNR	MNR	0.000	MNR	MNR	MNR	MNR
Rolling Excess	85.83	1.96	0.026	175.16	2.23	5.00	0.07
		0	0	0	8	0	0
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24
MNR	24	24	0	24	24	24	24
ND	0	0	0	0	0	0	0
OC		0	0	0	0	0	0
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	100.00	100.00	100.00	100.00	100.00	100.00	100.00
MDT Per	0	0	0	0	0	0	0

Key:  
 U, UD      User Disable      F, IF      Instrument Failure      C, Cal      Calibration  
 R, OC      Out of Control      N, ND      No Data      M, MNR      Monitoring Not Required  
 V, Valid      Valid Data      W, Warning      Drift Warning

Florida Rock Industries Inc.  
Thompson S. Baker Cement Plant  
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 03/14/2002

Time	Clinker Prod. Tons/Hr. Avg.	Kiln SO2 SO2 Lbs./Hr. Avg.	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	MNR	MNR	0.000	MNR	MNR	MNR	MNR
02:00	MNR	MNR	0.000	MNR	MNR	MNR	MNR
03:00	MNR	MNR	0.000	MNR	MNR	MNR	MNR
04:00	MNR	MNR	0.000	MNR	MNR	MNR	MNR
05:00	MNR	MNR	0.000	MNR	MNR	MNR	MNR
06:00	MNR	MNR	0.000	MNR	MNR	MNR	MNR
07:00	MNR	MNR	0.000	MNR	MNR	MNR	MNR
08:00	MNR	MNR	0.000	MNR	MNR	MNR	MNR
09:00	MNR	MNR	0.000	MNR	MNR	MNR	MNR
10:00	MNR	16.20	0.000	MNR	MNR	0.00	MNR
11:00	MNR	5.88	0.000	MNR	MNR	0.00	MNR
12:00	MNR	12.49	0.000	MNR	MNR	0.00	MNR
13:00	MNR	17.95	0.000	MNR	MNR	0.00	MNR
14:00	MNR	22.56	0.000	MNR	MNR	0.01	MNR
15:00	MNR	50.80X	0.000	MNR	MNR	0.01	MNR
16:00	12.36	10.33	0.000	42.24	3.14X	1.21	MNR
17:00	27.84	3.09	0.000	70.51	2.53	4.14	0.15
18:00	15.27	0.70	0.000	51.83	3.37X	1.38	0.09
19:00	38.80	0.56	0.014	110.43	2.85X	3.73	0.10
20:00	48.21	1.04	0.057	155.87	3.24X	9.69	0.20X
21:00	58.18	0.00	0.001	201.27	3.46X	8.93	0.15
22:00	66.45	0.00	0.000	216.27	3.26X	10.39	0.16X
23:00	70.22	0.00	0.000	217.14	3.09X	11.46	0.16X
24:00	79.32	0.00	0.000	230.14	2.90X	15.29	0.19X
Total	416.65	141.60	0.072	1295.70	27.84	66.24	1.20
Average	46.29	9.44	0.003	143.97	3.09	4.42	0.15
Maximum	79.32	50.80	0.057	230.14	3.46	15.29	0.20
Minimum	12.36	0.00	0.000	42.24	2.53	0.00	0.09
Rolling Excess	84.38	2.28	0.026	173.43	2.25	4.75	0.06
		1	0	0	8	0	4
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24
MNR	15	9	0	15	15	9	16
ND	0	0	0	0	0	0	0
OC		0	0	0	0	0	0
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	100.00	100.00	100.00	100.00	100.00	100.00	100.00
MDT Per	0	0	0	0	0	0	0

Key:  
 U, UD User Disable  
 R, OC Out of Control  
 V, Valid Valid Data  
 F, IF Instrument Failure  
 N, ND No Data  
 W, Warning Drift Warning  
 C, Cal Calibration  
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.  
Thompson S. Baker Cement Plant  
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 03/15/2002

Time	Clinker Prod. Tons/Hr. Avg.	Kiln SO2 SO2 Lbs./Hr. Avg.	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	84.96	0.00	0.000	244.48	2.88X	14.93	0.18X
02:00	85.64	0.71	0.008	239.60	2.80X	14.67	0.17X
03:00	86.19	1.52	0.018	238.44	2.77	13.32	0.15
04:00	86.39	1.30	0.015	235.66	2.73	12.88	0.15
05:00	88.21	0.66	0.007	241.16	2.73	14.37	0.16X
06:00	88.34	0.22	0.003	247.39	2.80X	13.96	0.16X
07:00	89.80	0.09	0.001	249.11	2.77	14.41	0.16X
08:00	91.64	0.00	0.000	252.42	2.76	9.22	0.10
09:00	96.47	0.18	0.002	283.38X	2.94X	10.00	0.10
10:00	96.71	1.04	0.011	304.18X	3.15X	10.82	0.11
11:00	96.75	2.35	0.024	304.73X	3.15X	12.22	0.13
12:00	96.75	4.02	0.042	302.29X	3.12X	11.24	0.12
13:00	96.75	3.93	0.041	303.79X	3.14X	7.63	0.08
14:00	96.66	3.53	0.036	284.05X	2.94X	12.05	0.12
15:00	96.71	3.40	0.035	265.81	2.75	12.00	0.12
16:00	96.74	3.31	0.034	252.18	2.61	8.99	0.09
17:00	96.74	3.37	0.035	234.59	2.43	7.31	0.08
18:00	96.72	3.05	0.032	241.41	2.50	8.38	0.09
19:00	96.74	2.60	0.027	240.11	2.48	8.35	0.09
20:00	96.73	2.13	0.022	234.42	2.42	7.03	0.07
21:00	96.68	1.74	0.018	232.26	2.40	6.74	0.07
22:00	96.76	2.00	0.021	227.09	2.35	7.24	0.07
23:00	96.75	1.98	0.020	228.14	2.36	5.92	0.06
24:00	96.71	1.13	0.012	242.30	2.51	9.13	0.09
Total	2248.54	44.26	0.464	6128.99	65.49	252.81	2.72
Average	93.69	1.84	0.019	255.37	2.73	10.53	0.11
Maximum	96.76	4.02	0.042	304.73	3.15	14.93	0.18
Minimum	84.96	0.00	0.000	227.09	2.35	5.92	0.06
Rolling	84.76	2.34	0.027	175.30	2.28	4.71	0.07
Excess		0	0	6	9	0	5
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0
OC		0	0	0	0	0	0
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	100.00	100.00	100.00	100.00	100.00	100.00	100.00
MDT Per	0	0	0	0	0	0	0

Key:  
 U, UD      User Disable  
 R, OC      Out of Control  
 V, Valid    Valid Data  
 F, IF      Instrument Failure  
 N, ND      No Data  
 W, Warning    Drift Warning  
 C, Cal      Calibration  
 M, MNR      Monitoring Not Required

Florida Rock Industries Inc.  
Thompson S. Baker Cement Plant  
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 03/16/2002

Time	Clinker Prod. Tons/Hr. Avg.	Kiln SO2 SO2 Lbs./Hr. Avg.	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	96.34	0.94	0.010	238.71	2.48	7.74	0.08
02:00	94.60	0.70	0.007	254.91	2.70	6.28	0.07
03:00	93.87	0.23	0.002	237.18	2.53	6.44	0.07
04:00	93.64	0.41	0.004	254.29	2.72	6.82	0.07
05:00	92.58	0.21	0.002	248.96	2.69	6.32	0.07
06:00	91.65	0.07	0.001	246.26	2.69	6.12	0.07
07:00	94.50	0.02	0.000	240.60	2.55	6.57	0.07
08:00	94.40	0.04	0.000	239.73	2.54	9.45	0.10
09:00	93.87	0.32	0.003	248.56	2.65	10.43	0.11
10:00	93.89	1.05	0.011	248.63	2.65	14.98	0.16X
11:00	95.20	4.04	0.042	257.03	2.70	14.72	0.15
12:00	95.10	4.68	0.049	232.86	2.45	16.30X	0.17X
13:00	95.05	6.32	0.067	250.46	2.64	13.54	0.14
14:00	95.07	4.75	0.050	245.04	2.58	14.52	0.15
15:00	95.07	4.23	0.044	246.40	2.59	14.02	0.15
16:00	95.12	4.14	0.043	234.38	2.46	13.71	0.14
17:00	95.03	3.60	0.038	227.63	2.40	14.16	0.15
18:00	95.08	2.89	0.030	238.61	2.51	13.22	0.14
19:00	95.07	2.05	0.022	241.48	2.54	13.12	0.14
20:00	95.13	1.65	0.017	243.33	2.56	12.96	0.14
21:00	94.01	2.09	0.022	233.83	2.49	12.23	0.13
22:00	89.18	1.85	0.021	240.47	2.70	10.76	0.12
23:00	90.34	1.66	0.018	242.59	2.69	10.93	0.12
24:00	90.96	2.54	0.028	242.39	2.66	11.58	0.13
Total	2254.75	50.48	0.531	5834.33	62.17	266.92	2.84
Average	93.95	2.10	0.022	243.10	2.59	11.12	0.12
Maximum	96.34	6.32	0.067	257.03	2.72	16.30	0.17
Minimum	89.18	0.02	0.000	227.63	2.40	6.12	0.07
Rolling	84.83	2.41	0.028	177.05	2.26	4.91	0.07
Excess		0	0	0	0	1	2
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0
OC		0	0	0	0	0	0
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	100.00	100.00	100.00	100.00	100.00	100.00	100.00
MDT Per	0	0	0	0	0	0	0

Key:  
 U, UD      User Disable  
 R, OC      Out of Control  
 V, Valid    Valid Data  
 F, IF      Instrument Failure  
 N, ND      No Data  
 W, Warning    Drift Warning  
 C, Cal      Calibration  
 M, MNR      Monitoring Not Required

Florida Rock Industries Inc.  
Thompson S. Baker Cement Plant  
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 03/17/2002

Time	Clinker Prod. Tons/Hr. Avg.	Kiln SO2 SO2 Lbs./Hr. Avg.	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	88.69	2.53	0.029	240.87	2.72	10.28	0.12
02:00	90.68	2.30	0.025	232.46	2.57	10.26	0.11
03:00	85.60	1.29	0.015	232.83	2.72	9.46	0.11
04:00	86.52	0.91	0.010	237.23	2.74	9.49	0.11
05:00	88.71	1.59	0.018	230.68	2.60	11.66	0.13
06:00	90.64	2.21	0.024	246.32	2.72	11.51	0.13
07:00	93.81	2.45	0.026	244.59	2.61	11.68	0.12
08:00	94.46	1.27	0.013	239.07	2.53	11.03	0.12
09:00	94.49	0.35	0.004	241.31	2.55	12.01	0.13
10:00	92.82	0.94	0.010	242.05	2.61	9.77	0.11
11:00	88.85	1.09	0.012	242.11	2.72	9.00	0.10
12:00	91.35	3.26	0.036	240.14	2.63	12.41	0.14
13:00	93.89	4.23	0.045	258.26	2.75	12.40	0.13
14:00	93.83	3.41	0.036	274.58X	2.93X	12.47	0.13
15:00	93.91	3.38	0.036	269.98X	2.87X	12.48	0.13
16:00	93.88	3.88	0.041	243.18	2.59	12.22	0.13
17:00	93.89	3.96	0.042	237.54	2.53	11.79	0.13
18:00	93.41	2.00	0.022	248.11	2.66	12.21	0.13
19:00	93.92	0.09	0.001	247.25	2.63	15.14	0.16X
20:00	93.30	0.29	0.003	249.02	2.67	14.93	0.16X
21:00	90.65	1.10	0.012	235.02	2.59	10.26	0.11
22:00	87.32	2.42	0.028	238.94	2.74	8.08	0.09
23:00	90.13	1.44	0.016	248.41	2.76	7.43	0.08
24:00	91.87	0.68	0.007	252.11	2.74	7.39	0.08
Total	2196.62	47.07	0.511	5872.06	64.18	265.36	2.89
Average	91.53	1.96	0.021	244.67	2.67	11.06	0.12
Maximum	94.49	4.23	0.045	274.58	2.93	15.14	0.16
Minimum	85.60	0.09	0.001	230.68	2.53	7.39	0.08
Rolling	85.03	2.47	0.028	177.78	2.27	4.99	0.07
Excess		0	0	2	2	0	2
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0
OC		0	0	0	0	0	0
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	100.00	100.00	100.00	100.00	100.00	100.00	100.00
MDT Per	0	0	0	0	0	0	0

Key:  
 U, UD      User Disable  
 R, OC      Out of Control  
 V, Valid    Valid Data  
 F, IF      Instrument Failure  
 N, ND      No Data  
 W, Warning    Drift Warning  
 C, Cal      Calibration  
 M, MNR      Monitoring Not Required

Florida Rock Industries Inc.  
Thompson S. Baker Cement Plant  
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 03/18/2002

Time	Clinker Prod. Tons/Hr. Avg.	Kiln SO2 SO2 Lbs./Hr. Avg.	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	93.09	1.03	0.011	250.87	2.70	8.34	0.09
02:00	94.35	0.83	0.009	242.64	2.57	7.81	0.08
03:00	92.93	0.09	0.001	235.11	2.53	6.87	0.07
04:00	92.96	0.11	0.001	236.34	2.54	7.66	0.08
05:00	92.65	0.49	0.005	245.13	2.65	7.77	0.08
06:00	93.71	0.46	0.005	237.25	2.53	7.39	0.08
07:00	93.87	0.16	0.002	244.34	2.60	7.42	0.08
08:00	93.81	0.01	0.000	252.57	2.69	6.24	0.07
09:00	93.85	0.79	0.008	245.79	2.62	5.53	0.06
10:00	93.88	1.22	0.013	243.21	2.59	4.71	0.05
11:00	93.90	1.41	0.015	246.90	2.63	5.26	0.06
12:00	95.00	2.83	0.030	263.05	2.77	1.71	0.02
13:00	91.17	3.93	0.043	266.59	2.92X	0.50	0.01
14:00	94.10	3.17	0.034	266.52	2.83X	3.51	0.04
15:00	90.98	2.36	0.026	256.25	2.82X	0.80	0.01
16:00	91.01	2.24	0.025	253.55	2.79	1.00	0.01
17:00	91.03	2.69	0.030	252.53	2.77	0.59	0.01
18:00	91.58	2.95	0.032	243.05	2.65	1.80	0.02
19:00	94.05	2.36	0.025	235.75	2.51	3.02	0.03
20:00	95.20	1.15	0.012	260.17	2.73	2.50	0.03
21:00	95.08	0.75	0.008	251.84	2.65	2.33	0.02
22:00	95.15	0.60	0.006	251.39	2.64	2.49	0.03
23:00	95.54	1.09	0.011	259.98	2.72	2.53	0.03
24:00	95.66	1.40	0.015	243.93	2.55	3.78	0.04
Total	2244.55	34.12	0.367	5984.75	64.00	101.56	1.10
Average	93.52	1.42	0.015	249.36	2.67	4.23	0.05
Maximum	95.66	3.93	0.043	266.59	2.92	8.34	0.09
Minimum	90.98	0.01	0.000	235.11	2.51	0.50	0.01
Rolling	85.15	2.52	0.029	178.97	2.29	4.97	0.07
Excess		0	0	0	3	0	0
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0
OC		0	0	0	0	0	0
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	100.00	100.00	100.00	100.00	100.00	100.00	100.00
MDT Per	0	0	0	0	0	0	0

Key: U, UD User Disable F, IF Instrument Failure C, Cal Calibration  
R, OC Out of Control N, ND No Data M, MNR Monitoring Not Required  
V, Valid Valid Data W, Warning Drift Warning



Florida Rock Industries Inc.  
Thompson S. Baker Cement Plant  
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 03/19/2002

Time	Clinker Prod. Tons/Hr. Avg.	Kiln SO2 SO2 Lbs./Hr. Avg.	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	95.65	1.55	0.016	215.29	2.25	3.55	0.04
02:00	95.66	2.04	0.021	231.48	2.42	2.73	0.03
03:00	95.61	1.67	0.018	244.19	2.55	3.11	0.03
04:00	95.63	1.03	0.011	251.73	2.63	3.42	0.04
05:00	95.60	1.30	0.014	238.61	2.50	4.26	0.04
06:00	95.65	1.19	0.012	221.32	2.31	4.33	0.05
07:00	95.64	0.90	0.009	205.95	2.15	4.05	0.04
08:00	95.63	0.83	OC	224.96	OC	3.41	0.04
09:00	95.60	1.37	0.014	242.04	2.53	7.00	0.07
10:00	95.68	0.57	0.006	239.63	2.50	11.91	0.12
11:00	95.32	0.00	0.000	269.45X	2.83X	6.86	0.07
12:00	91.81	0.07	0.001	264.67	2.88X	6.48	0.07
13:00	89.74	0.45	0.005	251.00	2.80X	7.56	0.08
14:00	94.93	1.63	0.017	269.41X	2.84X	5.73	0.06
15:00	96.74	5.53	0.057	277.70X	2.87X	1.97	0.02
16:00	96.72	6.35	0.066	257.21	2.66	11.78	0.12
17:00	96.70	3.36	0.035	211.12	2.18	7.90	0.08
18:00	96.67	3.72	0.038	217.87	2.25	6.50	0.07
19:00	96.74	3.34	0.034	208.74	2.16	8.59	0.09
20:00	96.71	2.29	0.024	225.30	2.33	9.53	0.10
21:00	96.71	3.84	0.040	221.99	2.30	8.85	0.09
22:00	96.74	3.20	0.033	225.28	2.33	5.81	0.06
23:00	96.70	1.36	0.014	214.38	2.22	7.97	0.08
24:00	96.71	0.62	0.006	223.48	2.31	5.08	0.05
Total	2295.29	48.21	0.491	5652.80	56.80	148.38	1.54
Average	95.64	2.01	0.021	235.53	2.47	6.18	0.06
Maximum	96.74	6.35	0.066	277.70	2.88	11.91	0.12
Minimum	89.74	0.00	0.000	205.95	2.15	1.97	0.02
Rolling	87.21	1.49	0.016	185.78	2.28	5.14	0.07
Excess		0	0	3	5	0	0
Uptm %	100.00	100.00	95.83	100.00	95.83	100.00	100.00
# Per	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0
OC		0	1	0	1	0	0
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	100.00	100.00	99.78	100.00	99.75	100.00	100.00
MDT Per	0	0	1	0	1	0	0

Key: U, UD User Disable F, IF Instrument Failure C, Cal Calibration  
R, OC Out of Control N, ND No Data M, MNR Monitoring Not Required  
V, Valid Valid Data W, Warning Drift Warning

Florida Rock Industries Inc.  
Thompson S. Baker Cement Plant  
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 03/20/2002

Time	Clinker Prod. Tons/Hr. Avg.	Kiln SO2 SO2 Lbs./Hr. Avg.	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	96.73	0.41	0.004	206.93	2.14	8.03	0.08
02:00	96.69	0.25	0.003	224.80	2.33	6.46	0.07
03:00	96.79	0.17	0.002	230.00	2.38	5.30	0.05
04:00	96.74	0.03	0.000	216.33	2.24	6.47	0.07
05:00	96.74	0.00	0.000	229.12	2.37	5.22	0.05
06:00	96.71	0.00	0.000	234.96	2.43	5.08	0.05
07:00	96.70	0.00	0.000	235.07	2.43	8.19	0.08
08:00	96.71	0.00	0.000	234.91	2.43	7.81	0.08
09:00	96.05	0.00	0.000	244.32	2.54	7.57	0.08
10:00	91.83	0.48	0.005	233.77	2.55	7.20	0.08
11:00	96.77	2.09	0.022	232.12	2.40	10.30	0.11
12:00	96.71	2.95	0.030	247.98	2.56	7.08	0.07
13:00	96.74	3.22	0.033	302.21X	3.12X	8.68	0.09
14:00	96.72	2.20	0.023	278.38X	2.88X	12.76	0.13
15:00	94.55	0.31	0.003	299.61X	3.29X	11.74	0.13
16:00	22.78	0.82	2.246X	91.27	4.01X	0.91	0.03
17:00	72.73	2.12	0.027	263.76	3.67X	4.16	0.06
18:00	96.10	3.45	0.036	285.17X	2.97X	11.12	0.12
19:00	96.74	3.57	0.037	269.51X	2.79	11.71	0.12
20:00	96.75	2.60	0.027	260.16	2.69	8.35	0.09
21:00	96.77	2.32	0.024	256.39	2.65	9.95	0.10
22:00	96.68	3.83	0.040	233.42	2.41	7.79	0.08
23:00	96.73	3.72	0.038	242.61	2.51	6.67	0.07
24:00	96.68	3.57	0.037	229.21	2.37	11.45	0.12
Total	2215.14	38.11	2.637	5782.01	64.16	190.00	2.01
Average	92.30	1.59	0.110	240.92	2.67	7.92	0.08
Maximum	96.79	3.83	2.246	302.21	4.01	12.76	0.13
Minimum	22.78	0.00	0.000	91.27	2.14	0.91	0.03
Rolling	87.43	1.51	0.019	187.05	2.27	5.31	0.07
Excess		0	1	5	6	0	0
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0
OC		0	0	0	0	0	0
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	100.00	100.00	99.79	100.00	99.77	100.00	100.00
MDT Per	0	0	1	0	1	0	0

Key:  
 U, UD User Disable  
 R, OC Out of Control  
 V, Valid Valid Data  
 F, IF Instrument Failure  
 N, ND No Data  
 W, Warning Drift Warning  
 C, Cal Calibration  
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.  
Thompson S. Baker Cement Plant  
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 03/21/2002

Time	Clinker Prod. Tons/Hr. Avg.	Kiln SO2 SO2 Lbs./Hr. Avg.	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	96.78	3.41	0.035	232.10	2.40	6.18	0.06
02:00	96.69	3.46	0.036	223.37	2.31	7.73	0.08
03:00	96.78	3.39	0.035	223.89	2.31	5.93	0.06
04:00	95.27	3.27	0.034	238.27	2.50	6.04	0.06
05:00	94.88	3.39	0.036	230.52	2.43	5.38	0.06
06:00	95.07	1.22	0.013	216.04	2.27	8.81	0.09
07:00	94.49	0.38	0.004	208.34	2.21	8.82	0.09
08:00	92.90	0.00	OC	226.48	2.40	13.75	0.15
09:00	96.53	0.00	0.000	219.30	2.27	10.94	0.11
10:00	96.66	0.00	0.000	212.84	2.20	12.21	0.13
11:00	96.74	0.00	0.000	219.92	2.27	10.18	0.11
12:00	96.90	0.00	0.000	201.54	2.08	11.81	0.12
13:00	96.75	0.00	0.000	207.27	2.14	11.45	0.12
14:00	97.39	0.00	0.000	205.41	2.11	15.33	0.16X
15:00	97.25	0.00	0.000	219.45	2.26	15.00	0.15
16:00	93.17	0.00	0.000	229.05	2.52	10.30	0.11
17:00	MNR	MNR	0.000	MNR	MNR	MNR	MNR
18:00	MNR	MNR	0.000	MNR	MNR	MNR	MNR
19:00	MNR	MNR	0.000	MNR	MNR	MNR	MNR
20:00	MNR	MNR	0.000	MNR	MNR	MNR	MNR
21:00	MNR	MNR	0.000	MNR	MNR	MNR	MNR
22:00	MNR	MNR	0.000	MNR	MNR	MNR	MNR
23:00	MNR	MNR	0.000	MNR	MNR	MNR	MNR
24:00	48.23	0.00	0.000	134.40	2.79	2.84	0.06
Total	1582.48	18.52	0.193	3648.19	39.47	162.70	1.72
Average	93.09	1.09	0.008	214.60	2.32	9.57	0.10
Maximum	97.39	3.46	0.036	238.27	2.79	15.33	0.16
Minimum	48.23	0.00	0.000	134.40	2.08	2.84	0.06
Rolling	87.33	1.52	0.019	187.94	2.26	5.52	0.07
Excess		1	0	0	7	0	1
Uptm %	100.00	100.00	95.83	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24
MNR	7	7	0	7	7	7	7
ND	0	0	0	0	0	0	0
OC		0	1	0	0	0	0
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	100.00	100.00	99.60	100.00	99.78	100.00	100.00
MDT Per	0	0	2	0	1	0	0

Key:  
 U, UD      User Disable  
 R, OC      Out of Control  
 V, Valid    Valid Data  
 F, IF      Instrument Failure  
 N, ND      No Data  
 W, Warning    Drift Warning  
 C, Cal      Calibration  
 M, MNR      Monitoring Not Required

Florida Rock Industries Inc.  
Thompson S. Baker Cement Plant  
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 03/22/2002

Time	Clinker Prod. Tons/Hr. Avg.	Kiln SO2 SO2 Lbs./Hr. Avg.	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	59.96	0.00	0.000	193.29	3.22X	3.09	0.05
02:00	71.54	0.00	0.000	230.68	3.23X	3.75	0.05
03:00	83.21	0.00	0.000	233.23	2.81X	5.64	0.07
04:00	88.48	0.00	0.000	257.41	2.91X	6.82	0.08
05:00	88.15	0.00	0.000	256.10	2.91X	7.23	0.08
06:00	91.96	0.00	0.000	241.36	2.63	6.96	0.08
07:00	95.09	0.00	0.000	244.50	2.57	6.68	0.07
08:00	96.02	0.00	0.000	231.80	2.41	5.44	0.06
09:00	96.76	0.00	0.000	229.23	2.37	5.54	0.06
10:00	97.05	0.00	0.000	262.60	2.71	7.28	0.08
11:00	97.87	0.00	0.000	254.43	2.60	7.17	0.07
12:00	96.89	0.00	0.000	251.82	2.60	4.83	0.05
13:00	96.70	0.00	0.000	244.38	2.53	4.42	0.05
14:00	84.59	0.00	0.000	220.15	2.61	5.54	0.07
15:00	79.65	0.00	0.000	217.66	2.73	2.95	0.04
16:00	79.64	0.00	0.000	216.70	2.72	2.91	0.04
17:00	79.63	0.00	0.000	237.75	2.99X	1.00	0.01
18:00	79.65	0.00	0.000	213.63	2.68	2.22	0.03
19:00	79.63	0.00	0.000	221.75	2.79	1.80	0.02
20:00	79.63	0.00	0.000	212.04	2.66	0.97	0.01
21:00	79.62	0.00	0.000	213.45	2.68	0.00	0.00
22:00	79.83	0.00	0.000	207.19	2.60	0.00	0.00
23:00	79.85	0.00	0.000	199.47	2.50	0.00	0.00
24:00	80.32	0.00	0.000	212.36	2.64	0.00	0.00
Total	2041.72	0.00	0.000	5502.98	65.10	92.24	1.07
Average	85.07	0.00	0.000	229.29	2.71	3.84	0.04
Maximum	97.87	0.00	0.000	262.60	3.23	7.28	0.08
Minimum	59.96	0.00	0.000	193.29	2.37	0.00	0.00
Rolling Excess	87.09	1.50	0.019	189.68	2.29	5.54	0.07
		0	0	0	6	0	0
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0
OC		0	0	0	0	0	0
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	100.00	100.00	99.62	100.00	99.79	100.00	100.00
MDT Per	0	0	2	0	1	0	0

Key:  
 U, UD      User Disable  
 R, OC      Out of Control  
 V, Valid    Valid Data  
 F, IF      Instrument Failure  
 N, ND      No Data  
 W, Warning    Drift Warning  
 C, Cal      Calibration  
 M, MNR      Monitoring Not Required

Florida Rock Industries Inc.  
Thompson S. Baker Cement Plant  
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 03/23/2002

Time	Clinker Prod. Tons/Hr. Avg.	Kiln SO2 SO2 Lbs./Hr. Avg.	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	79.54	0.00	0.000	192.40	2.42	0.01	0.00
02:00	78.72	0.00	0.000	226.38	2.88X	-0.01	0.00
03:00	79.62	0.00	0.000	215.90	2.71	-0.02	0.00
04:00	79.63	0.00	0.000	234.21	2.94X	1.34	0.02
05:00	79.65	0.00	0.000	229.33	2.88X	5.71	0.07
06:00	79.67	0.00	0.000	247.39	3.11X	3.41	0.04
07:00	78.88	0.00	0.000	232.80	2.95X	6.01	0.08
08:00	70.44	0.00	0.000	195.79	2.79	8.42	0.12
09:00	68.19	0.00	0.000	201.19	2.95X	4.66	0.07
10:00	68.19	0.00	0.000	185.15	2.72	5.68	0.08
11:00	68.69	0.05	0.001	193.27	2.82X	5.80	0.08
12:00	68.17	0.31	0.005	200.14	2.94X	3.14	0.05
13:00	68.20	0.33	0.005	168.09	2.46	4.82	0.07
14:00	68.18	0.07	0.001	150.53	2.21	8.96	0.13
15:00	68.20	0.55	0.008	196.18	2.88X	3.62	0.05
16:00	68.21	0.90	0.013	172.90	2.54	7.95	0.12
17:00	68.20	0.82	0.012	162.72	2.39	7.65	0.11
18:00	68.20	1.12	0.016	161.33	2.37	5.77	0.08
19:00	68.18	1.43	0.021	145.53	2.13	9.42	0.14
20:00	69.37	1.33	0.019	191.37	2.76	4.75	0.07
21:00	70.56	0.23	0.003	189.97	2.69	4.78	0.07
22:00	73.27	0.06	0.001	176.29	2.41	7.61	0.10
23:00	71.68	0.00	0.000	200.44	2.80X	4.65	0.07
24:00	71.84	0.00	0.000	199.02	2.77	5.92	0.08
Total	1733.48	7.20	0.105	4668.32	64.52	120.05	1.70
Average	72.23	0.30	0.004	194.51	2.69	5.00	0.07
Maximum	79.67	1.43	0.021	247.39	3.11	9.42	0.14
Minimum	68.17	0.00	0.000	145.53	2.13	-0.02	0.00
Rolling	86.43	1.48	0.019	191.90	2.32	5.62	0.07
Excess		0	0	0	10	0	0
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0
OC		0	0	0	0	0	0
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	100.00	100.00	99.64	100.00	99.80	100.00	100.00
MDT Per	0	0	2	0	1	0	0

Key:  
 U, UD User Disable  
 R, OC Out of Control  
 V, Valid Valid Data  
 F, IF Instrument Failure  
 N, ND No Data  
 W, Warning Drift Warning  
 C, Cal Calibration  
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.  
Thompson S. Baker Cement Plant  
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 03/24/2002

Time	Clinker Prod. Tons/Hr. Avg.	Kiln SO2 SO2 Lbs./Hr. Avg.	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	71.88	0.00	0.000	204.77	2.85X	5.93	0.08
02:00	71.25	0.00	0.000	200.29	2.81X	5.89	0.08
03:00	71.06	0.00	0.000	198.02	2.79	5.69	0.08
04:00	70.15	0.00	0.000	191.19	2.73	5.89	0.08
05:00	72.01	0.00	0.000	174.62	2.43	10.88	0.15
06:00	71.40	0.00	0.000	194.76	2.73	7.58	0.11
07:00	69.13	0.00	0.000	198.13	2.87X	8.63	0.12
08:00	69.33	0.01	0.000	186.85	2.70	5.87	0.08
09:00	71.34	0.18	0.002	214.84	3.01X	5.08	0.07
10:00	78.93	0.70	0.009	218.16	2.77	6.42	0.08
11:00	79.65	0.33	0.004	224.95	2.82X	3.30	0.04
12:00	77.33	8.07	0.109	196.65	2.54	8.91	0.12
13:00	MNR	0.55	3.180X	21.45	MNR	0.13	MNR
14:00	35.93	0.13	0.692X	70.31	5.96X	2.59	0.07
15:00	57.07	0.38	0.007	176.75	3.10X	2.10	0.04
16:00	66.27	3.99	0.062	169.88	2.55	14.37	0.22X
17:00	74.38	1.86	0.025	206.30	2.78	6.58	0.09
18:00	79.65	1.83	0.023	163.20	2.05	21.69X	0.27X
19:00	79.62	1.69	0.021	168.26	2.11	13.08	0.16X
20:00	79.66	0.84	0.011	165.95	2.08	16.14X	0.20X
21:00	79.63	0.41	0.005	171.30	2.15	8.84	0.11
22:00	79.94	0.33	0.004	187.27	2.34	7.68	0.10
23:00	79.66	0.01	0.000	231.51	2.91X	7.67	0.10
24:00	79.65	0.03	0.000	208.22	2.61	8.81	0.11
Total	1664.92	21.34	4.154	4343.63	63.69	189.75	2.56
Average	72.39	0.89	0.173	180.98	2.77	7.91	0.11
Maximum	79.94	8.07	3.180	231.51	5.96	21.69	0.27
Minimum	35.93	0.00	0.000	21.45	2.05	0.13	0.04
Rolling	86.07	1.33	0.025	193.54	2.34	5.74	0.07
Excess		0	2	0	9	2	4
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24
MNR	1	0	0	0	1	0	1
ND	0	0	0	0	0	0	0
OC		0	0	0	0	0	0
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	100.00	100.00	99.65	100.00	99.81	100.00	100.00
MDT Per	0	0	2	0	1	0	0

Key:  
 U, UD      User Disable  
 R, OC      Out of Control  
 V, Valid    Valid Data  
 F, IF      Instrument Failure  
 N, ND      No Data  
 W, Warning    Drift Warning  
 C, Cal      Calibration  
 M, MNR      Monitoring Not Required

Florida Rock Industries Inc.  
Thompson S. Baker Cement Plant  
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 03/25/2002

Time	Clinker Prod. Tons/Hr. Avg.	Kiln SO2 SO2 Lbs./Hr. Avg.	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	79.63	0.00	0.000	215.66	2.71	6.85	0.09
02:00	79.59	0.00	0.000	215.80	2.71	6.53	0.08
03:00	79.63	0.00	0.000	216.11	2.71	6.21	0.08
04:00	79.56	0.00	0.000	214.34	2.69	6.19	0.08
05:00	79.67	0.00	0.000	211.25	2.65	6.34	0.08
06:00	79.66	0.00	0.000	221.02	2.77	8.88	0.11
07:00	79.69	0.00	0.000	200.91	2.52	7.05	0.09
08:00	79.64	0.00	0.000	205.98	2.59	6.60	0.08
09:00	80.89	0.01	0.000	145.61	1.80	42.16X	0.52X
10:00	57.97	1.28	0.018	117.36	2.39	22.23X	0.28X
11:00	43.59	0.07	0.001	130.37	2.99X	2.56	0.06
12:00	MNR	2.49	0.000	63.79	MNR	4.97	MNR
13:00	53.57	1.46	0.000	185.58	6.46X	8.23	0.15
14:00	90.13	2.83	0.031	222.37	2.47	17.91X	0.20X
15:00	93.59	3.31	0.035	262.00	2.80X	7.56	0.08
16:00	95.50	3.62	0.038	261.38	2.74	8.19	0.09
17:00	96.14	4.12	0.043	261.53	2.72	8.37	0.09
18:00	96.14	3.82	0.040	262.58	2.73	8.82	0.09
19:00	96.16	3.01	0.031	245.20	2.55	8.28	0.09
20:00	96.15	1.21	0.013	230.00	2.39	18.22X	0.19X
21:00	96.10	1.42	0.015	261.91	2.73	10.62	0.11
22:00	93.93	1.84	0.019	283.16X	3.02X	7.69	0.08
23:00	83.40	0.62	0.007	253.83	3.07X	4.42	0.05
24:00	86.84	0.96	0.011	254.02	2.93X	7.71	0.09
Total	1897.17	32.07	0.302	5141.76	65.14	242.59	2.86
Average	82.49	1.34	0.013	214.24	2.83	10.11	0.12
Maximum	96.16	4.12	0.043	283.16	6.46	42.16	0.52
Minimum	43.59	0.00	0.000	63.79	1.80	2.56	0.05
Rolling	85.75	1.34	0.025	194.74	2.36	5.88	0.07
Excess		0	0	1	6	4	4
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24
MNR	1	0	0	0	1	0	1
ND	0	0	0	0	0	0	0
OC		0	0	0	0	0	0
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	100.00	100.00	99.66	100.00	99.81	100.00	100.00
MDT Per	0	0	2	0	1	0	0

Key:  
 U, UD      User Disable  
 R, OC      Out of Control  
 V, Valid    Valid Data  
 F, IF      Instrument Failure  
 N, ND      No Data  
 W, Warning    Drift Warning  
 C, Cal      Calibration  
 M, MNR      Monitoring Not Required

Florida Rock Industries Inc.  
Thompson S. Baker Cement Plant  
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 03/26/2002

Time	Clinker Prod. Tons/Hr. Avg.	Kiln SO2 SO2 Lbs./Hr. Avg.	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	91.82	0.13	0.001	257.03	2.80X	6.39	0.07
02:00	91.63	0.15	0.002	250.81	2.74	6.36	0.07
03:00	93.35	0.05	0.001	250.53	2.68	6.80	0.07
04:00	89.54	0.01	0.000	248.08	2.77	7.82	0.09
05:00	87.81	0.00	0.000	233.81	2.66	6.35	0.07
06:00	92.28	0.00	0.000	231.79	2.51	8.96	0.10
07:00	93.77	0.00	0.000	242.53	2.59	6.53	0.07
08:00	93.84	0.00	0.000	265.04	2.82X	6.71	0.07
09:00	92.95	0.02	0.000	264.52	2.84X	6.61	0.07
10:00	91.00	0.78	0.009	257.89	2.83X	8.01	0.09
11:00	90.98	1.21	0.013	271.27X	2.98X	8.07	0.09
12:00	90.96	2.57	0.028	265.09	2.91X	10.64	0.12
13:00	91.45	3.34	0.037	223.75	2.45	34.73X	0.38X
14:00	93.80	3.01	0.032	213.42	2.28	36.73X	0.39X
15:00	93.88	1.10	0.012	232.07	2.47	33.71X	0.36X
16:00	93.86	2.27	0.024	234.94	2.50	26.16X	0.28X
17:00	93.91	2.56	0.027	240.90	2.57	11.55	0.12
18:00	93.86	1.69	0.018	233.61	2.49	9.37	0.10
19:00	93.85	0.67	0.007	172.74	1.84	40.85X	0.44X
20:00	94.46	0.09	0.001	217.01	2.30	18.74X	0.20X
21:00	95.59	0.32	0.003	214.68	2.25	14.47	0.15
22:00	80.56	0.43	0.005	228.46	2.87X	8.01	0.10
23:00	68.22	1.80	0.026	205.83	3.02X	8.02	0.12
24:00	70.13	0.75	0.011	215.23	3.06X	14.12	0.21X
Total	2163.50	22.95	0.257	5671.03	63.23	345.71	3.83
Average	90.15	0.96	0.011	236.29	2.63	14.40	0.16
Maximum	95.59	3.34	0.037	271.27	3.06	40.85	0.44
Minimum	68.22	0.00	0.000	172.74	1.84	6.35	0.07
Rolling	85.76	1.37	0.025	196.56	2.38	6.17	0.08
Excess		0	0	1	9	6	7
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0
OC		0	0	0	0	0	0
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	100.00	100.00	99.68	100.00	99.82	100.00	100.00
MDT Per	0	0	2	0	1	0	0

Key:  
 U, UD      User Disable      F, IF      Instrument Failure      C, Cal      Calibration  
 R, OC      Out of Control      N, ND      No Data      M, MNR      Monitoring Not Required  
 V, Valid      Valid Data      W, Warning      Drift Warning



Florida Rock Industries Inc.  
Thompson S. Baker Cement Plant  
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 03/27/2002

Time	Clinker Prod. Tons/Hr. Avg.	Kiln SO2 SO2 Lbs./Hr. Avg.	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	71.66	1.93	0.027	216.04	3.01X	12.06	0.17X
02:00	68.34	0.22	0.003	209.14	3.06X	8.39	0.12
03:00	68.21	1.11	0.016	199.68	2.93X	7.27	0.11
04:00	69.32	0.48	0.007	197.73	2.85X	9.74	0.14
05:00	71.09	0.04	0.001	221.36	3.11X	4.71	0.07
06:00	73.25	0.00	0.000	213.27	2.91X	7.82	0.11
07:00	75.63	0.12	0.002	204.63	2.71	18.40X	0.24X
08:00	80.18	0.00	0.000	252.32	3.14X	7.74	0.10
09:00	84.10	0.08	0.001	261.01	3.11X	9.10	0.11
10:00	89.73	0.23	0.003	222.02	2.48	40.64X	0.45X
11:00	81.49	0.96	0.013	241.00	2.98X	21.06X	0.25X
12:00	90.96	0.20	0.002	218.43	2.41	45.00X	0.49X
13:00	93.89	0.00	0.000	193.61	2.06	56.24X	0.60X
14:00	93.78	0.28	0.003	284.73X	3.04X	11.98	0.13
15:00	94.39	0.90	0.009	294.23X	3.12X	14.19	0.15
16:00	96.74	1.13	0.012	298.80X	3.09X	15.14	0.16X
17:00	96.71	1.48	0.015	295.66X	3.06X	16.08X	0.17X
18:00	96.74	1.48	0.015	296.93X	3.07X	16.73X	0.17X
19:00	96.73	0.92	0.010	298.52X	3.09X	16.64X	0.17X
20:00	96.76	0.38	0.004	308.13X	3.18X	15.75X	0.16X
21:00	96.71	0.03	0.000	316.82X	3.28X	18.28X	0.19X
22:00	96.68	0.00	0.000	291.59X	3.02X	18.95X	0.20X
23:00	96.27	0.00	0.000	272.73X	2.83X	31.47X	0.33X
24:00	93.38	0.01	0.000	267.86	2.87X	38.52X	0.41X
Total	2072.74	11.98	0.143	6076.24	70.41	461.90	5.20
Average	86.36	0.50	0.006	253.18	2.93	19.25	0.22
Maximum	96.76	1.93	0.027	316.82	3.28	56.24	0.60
Minimum	68.21	0.00	0.000	193.61	2.06	4.71	0.07
Rolling	85.47	1.38	0.025	198.63	2.41	6.70	0.08
Excess		0	0	10	20	13	15
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0
OC		0	0	0	0	0	0
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	100.00	100.00	99.69	100.00	99.83	100.00	100.00
MDT Per	0	0	2	0	1	0	0

Key:  
 U, UD User Disable  
 R, OC Out of Control  
 V, Valid Valid Data  
 F, IF Instrument Failure  
 N, ND No Data  
 W, Warning Drift Warning  
 C, Cal Calibration  
 M, MNR Monitoring Not Required

Florida Rock Industries Inc.  
Thompson S. Baker Cement Plant  
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 03/28/2002

Time	Clinker Prod. Tons/Hr. Avg.	Kiln SO2 SO2 Lbs./Hr. Avg.	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	93.48	0.00	0.000	252.73	2.70	44.45X	0.48X
02:00	94.14	0.00	0.000	288.37X	3.06X	17.42X	0.19X
03:00	94.53	0.00	0.000	272.09X	2.88X	29.87X	0.32X
04:00	94.53	0.00	0.000	282.93X	2.99X	22.06X	0.23X
05:00	94.52	0.00	0.000	255.47	2.70	43.80X	0.46X
06:00	93.52	0.00	0.000	279.55X	2.99X	32.81X	0.35X
07:00	93.21	0.00	0.000	292.55X	3.14X	17.17X	0.18X
08:00	93.29	0.00	0.000	290.72X	3.12X	6.69	0.07
09:00	93.21	0.00	0.000	259.67	2.79	15.52	0.17X
10:00	93.74	0.43	0.005	247.26	2.64	34.49X	0.37X
11:00	95.37	1.22	0.013	264.95	2.78	26.08X	0.27X
12:00	95.62	2.03	0.021	289.67X	3.03X	18.47X	0.19X
13:00	95.60	2.42	0.025	269.73X	2.82X	43.20X	0.45X
14:00	95.64	2.00	0.021	315.81X	3.30X	16.29X	0.17X
15:00	95.64	10.63	0.111	285.39X	2.98X	31.03X	0.32X
16:00	95.60	10.88	0.114	293.95X	3.07X	29.50X	0.31X
17:00	95.60	0.00	0.000	330.80X	3.46X	20.79X	0.22X
18:00	93.06	12.28	0.133	238.46	2.56	34.95X	0.38X
19:00	91.04	2.93	0.032	301.56X	3.31X	28.67X	0.32X
20:00	91.03	0.60	0.007	291.80X	3.21X	26.80X	0.29X
21:00	91.48	0.23	0.003	284.11X	3.11X	24.81X	0.27X
22:00	93.02	0.14	0.001	289.41X	3.11X	19.97X	0.21X
23:00	92.76	0.01	0.000	229.39	2.47	54.57X	0.59X
24:00	93.83	0.26	0.003	296.57X	3.16X	13.91	0.15
Total	2253.46	46.06	0.489	6702.94	71.38	653.32	6.96
Average	93.89	1.92	0.020	279.29	2.97	27.22	0.29
Maximum	95.64	12.28	0.133	330.80	3.46	54.57	0.59
Minimum	91.03	0.00	0.000	229.39	2.47	6.69	0.07
Rolling	85.90	1.43	0.026	203.58	2.44	7.60	0.09
Excess		0	0	17	17	21	22
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0
OC		0	0	0	0	0	0
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	100.00	100.00	99.70	100.00	99.84	100.00	100.00
MDT Per	0	0	2	0	1	0	0

Key:  
 U, UD      User Disable      F, IF      Instrument Failure      C, Cal      Calibration  
 R, OC      Out of Control      N, ND      No Data      M, MNR      Monitoring Not Required  
 V, Valid      Valid Data      W, Warning      Drift Warning

Florida Rock Industries Inc.  
Thompson S. Baker Cement Plant  
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 03/29/2002

Time	Clinker Prod. Tons/Hr. Avg.	Kiln SO2 SO2 Lbs./Hr. Avg.	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	92.58	0.23	0.002	277.31X	3.00X	41.49X	0.45X
02:00	92.31	1.61	0.017	262.54	2.84X	23.23X	0.25X
03:00	91.80	0.00	0.000	269.81X	2.94X	28.10X	0.31X
04:00	91.32	0.00	0.000	259.46	2.84X	31.76X	0.35X
05:00	90.95	0.00	0.000	301.92X	3.32X	9.59	0.11
06:00	90.28	0.00	0.000	225.98	2.50	42.66X	0.47X
07:00	92.63	0.00	0.000	311.55X	3.36X	15.32	0.17X
08:00	91.48	5.89	0.064	254.00	2.77	35.53X	0.39X
09:00	96.61	0.00	0.000	334.13X	3.46X	13.36	0.14
10:00	96.77	0.11	0.001	263.95	2.73	35.00X	0.36X
11:00	96.70	0.87	0.009	268.54X	2.78	32.58X	0.34X
12:00	96.19	4.50	0.047	259.01	2.69	33.71X	0.35X
13:00	95.74	0.00	0.000	274.88X	2.87X	16.31X	0.17X
14:00	96.69	0.83	0.009	269.61X	2.79	27.36X	0.28X
15:00	96.41	0.00	0.000	318.90X	3.31X	10.92	0.11
16:00	95.93	1.07	0.011	305.29X	3.18X	13.31	0.14
17:00	96.76	1.16	0.012	314.16X	3.25X	12.24	0.13
18:00	96.80	1.73	0.018	278.65X	2.88X	24.29X	0.25X
19:00	96.72	1.47	0.015	299.02X	3.09X	13.20	0.14
20:00	96.72	0.92	0.010	290.19X	3.00X	14.49	0.15
21:00	96.75	0.45	0.005	277.03X	2.86X	23.86X	0.25X
22:00	96.73	0.25	0.003	281.59X	2.91X	14.43	0.15
23:00	96.72	0.55	0.006	273.36X	2.83X	17.79X	0.18X
24:00	96.73	0.81	0.008	300.88X	3.11X	4.94	0.05
Total	2278.32	22.45	0.237	6771.76	71.31	535.47	5.69
Average	94.93	0.94	0.010	282.16	2.97	22.31	0.24
Maximum	96.80	5.89	0.064	334.13	3.46	42.66	0.47
Minimum	90.28	0.00	0.000	225.98	2.50	4.94	0.05
Rolling	86.24	1.42	0.026	207.81	2.48	8.19	0.10
Excess		0	0	18	18	14	15
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0
OC		0	0	0	0	0	0
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	100.00	100.00	99.71	100.00	99.84	100.00	100.00
MDT Per	0	0	2	0	1	0	0

Key:  
 U, UD      User Disable                      F, IF      Instrument Failure                      C, Cal      Calibration  
 R, OC      Out of Control                      N, ND      No Data                                      M, MNR      Monitoring Not Required  
 V, Valid      Valid Data                              W, Warning      Drift Warning

Florida Rock Industries Inc.  
Thompson S. Baker Cement Plant  
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 03/30/2002

Time	Clinker Prod. Tons/Hr. Avg.	Kiln SO2 SO2 Lbs./Hr. Avg.	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	96.76	0.10	0.001	258.88	2.68	14.73	0.15
02:00	96.70	0.56	0.006	290.55X	3.01X	5.28	0.05
03:00	96.73	0.87	0.009	286.66X	2.96X	4.82	0.05
04:00	96.74	0.94	0.010	278.17X	2.88X	4.98	0.05
05:00	95.31	0.27	0.003	286.73X	3.01X	4.66	0.05
06:00	96.71	0.01	0.000	290.89X	3.01X	7.27	0.08
07:00	96.69	0.00	0.000	223.48	2.31	20.08X	0.21X
08:00	96.68	0.00	0.000	254.73	2.63	9.37	0.10
09:00	96.73	0.01	0.000	259.18	2.68	9.87	0.10
10:00	96.66	0.18	0.002	281.05X	2.91X	14.22	0.15
11:00	96.68	0.52	0.005	283.34X	2.93X	11.22	0.12
12:00	96.66	1.95	0.020	268.42X	2.78	17.07X	0.18X
13:00	96.70	1.84	0.019	282.73X	2.92X	12.18	0.13
14:00	96.72	1.70	0.018	280.77X	2.90X	10.71	0.11
15:00	96.67	3.14	0.032	251.80	2.60	27.63X	0.29X
16:00	96.70	1.95	0.020	222.82	2.30	37.12X	0.38X
17:00	92.71	0.11	0.001	247.93	2.67	21.27X	0.23X
18:00	81.79	0.23	0.003	157.69	1.93	40.06X	0.49X
19:00	73.57	1.12	0.015	185.45	2.52	22.96X	0.31X
20:00	73.94	0.18	0.002	189.68	2.57	17.67X	0.24X
21:00	71.25	0.00	0.000	216.93	3.06X	12.69	0.18X
22:00	68.21	0.00	0.000	215.22	3.16X	10.46	0.15
23:00	68.20	0.00	0.000	217.02	3.18X	9.57	0.14
24:00	68.23	0.00	0.000	219.83	3.22X	9.65	0.14
Total	2143.74	15.68	0.166	5949.95	66.82	355.54	4.08
Average	89.32	0.65	0.007	247.91	2.78	14.81	0.17
Maximum	96.76	3.14	0.032	290.89	3.22	40.06	0.49
Minimum	68.20	0.00	0.000	157.69	1.93	4.66	0.05
Rolling	86.14	1.44	0.026	210.76	2.51	8.50	0.10
Excess		0	0	10	13	8	9
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0
OC		0	0	0	0	0	0
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	100.00	100.00	99.72	100.00	99.85	100.00	100.00
MDT Per	0	0	2	0	1	0	0

Key:  
 U, UD      User Disable  
 R, OC      Out of Control  
 V, Valid    Valid Data  
 F, IF      Instrument Failure  
 N, ND      No Data  
 W, Warning    Drift Warning  
 C, Cal      Calibration  
 M, MNR      Monitoring Not Required

Florida Rock Industries Inc.  
Thompson S. Baker Cement Plant  
Kiln/Raw Mill Stack Mass Emissions Report

Daily Report for 03/31/2002

Time	Clinker Prod. Tons/Hr. Avg.	Kiln SO2 SO2 Lbs./Hr. Avg.	Kiln SO2 Lbs/Ton of Clinker Avg.	Kiln NOx NOx Lbs./Hr. Avg.	Kiln NOx Lbs/Ton of Clinker Avg.	Kiln THC THC Lbs./Hr. Avg.	Kiln THC Lbs/Ton of Clinker Avg.
01:00	68.24	0.00	0.000	211.63	3.10X	7.76	0.11
02:00	68.22	0.00	0.000	187.66	2.75	8.54	0.13
03:00	68.20	0.00	0.000	195.76	2.87X	4.68	0.07
04:00	68.19	0.00	0.000	199.21	2.92X	5.40	0.08
05:00	68.19	0.00	0.000	188.32	2.76	11.33	0.17X
06:00	68.22	0.00	0.000	196.50	2.88X	7.90	0.12
07:00	68.25	0.00	0.000	167.97	2.46	32.43X	0.48X
08:00	68.21	0.00	0.000	198.40	2.91X	13.53	0.20X
09:00	68.23	0.06	0.001	209.93	3.08X	9.74	0.14
10:00	69.97	0.62	0.009	216.78	3.10X	7.93	0.11
11:00	71.08	1.31	0.018	192.66	2.71	19.96X	0.28X
12:00	71.08	1.60	0.023	225.89	3.18X	9.06	0.13
13:00	71.08	2.61	0.037	196.05	2.76	22.49X	0.32X
14:00	71.86	1.04	0.014	234.96	3.26X	12.66	0.18X
15:00	68.38	1.80	0.026	220.49	3.23X	12.63	0.18X
16:00	68.21	2.36	0.035	226.22	3.32X	6.52	0.10
17:00	68.23	1.96	0.029	208.49	3.06X	4.47	0.07
18:00	68.24	2.09	0.031	190.54	2.79	13.81	0.20X
19:00	68.18	2.11	0.031	178.91	2.62	26.38X	0.39X
20:00	69.08	1.25	0.018	264.15	3.82X	4.88	0.07
21:00	68.54	1.99	0.029	255.56	3.73X	4.23	0.06
22:00	75.41	2.58	0.034	220.97	2.93X	24.19X	0.32X
23:00	80.02	3.02	0.038	245.98	3.07X	15.10	0.19X
24:00	85.11	2.49	0.029	304.13X	3.57X	5.07	0.06
Total	1688.42	28.89	0.402	5137.16	72.88	290.69	4.16
Average	70.35	1.20	0.017	214.05	3.04	12.11	0.17
Maximum	85.11	3.02	0.038	304.13	3.82	32.43	0.48
Minimum	68.18	0.00	0.000	167.97	2.46	4.23	0.06
Rolling	85.91	1.44	0.026	213.76	2.55	8.74	0.10
Excess		0	0	1	17	5	11
Uptm %	100.00	100.00	100.00	100.00	100.00	100.00	100.00
# Per	24	24	24	24	24	24	24
MNR	0	0	0	0	0	0	0
ND	0	0	0	0	0	0	0
OC		0	0	0	0	0	0
CAL		0	0	0	0	0	0
Bad Per		0	0	0	0	0	0
MUT %	100.00	100.00	99.73	100.00	99.85	100.00	100.00
MDT Per	0	0	2	0	1	0	0

Key:  
 U, UD User Disable  
 R, OC Out of Control  
 V, Valid Valid Data  
 F, IF Instrument Failure  
 N, ND No Data  
 W, Warning Drift Warning  
 C, Cal Calibration  
 M, MNR Monitoring Not Required