

Jeb Bush
Governor

Department of Environmental Protection

South District
P.O. Box 2549
Fort Myers, Florida 33902-2549

David B. Struhs
Secretary

NOTICE OF FINAL PERMIT

June 24, 1999

CERTIFIED MAIL #Z 459 522 810
RETURN RECEIPT REQUESTED

In the Matter of an
Application for Permit by:

Mr. Charles Drake
Manager, Sebring Power
Tampa Electric Company
Post Office Box 111
Tampa, Florida 33601-0111 /


Re: Highlands County - AP
FINAL Permit No.: 0550018-001-AV
J.H. Phillips Station
EMA - Lake Wales Ridge

Enclosed is FINAL Permit Number 0550018-001-AV for the operation of the Sebring Power (J.H. Phillips Station) located at 7301 Airport Road, Sebring, Florida, Highlands County, issued pursuant to Chapter 403, Florida Statutes (F.S.).

Any party to this order (permit) has the right to seek judicial review of it under Section 120.68 of the Florida Statutes., by the filing of a Notice of Appeal under Rule 9.110 of the Florida Rules of Appellate Procedure, with the clerk of the Department of Environmental Protection in the Office of General Counsel, 3900 Commonwealth Boulevard, Mail Station #35, Tallahassee, Florida, 32399-3000; and by filing a copy of the Notice of Appeal accompanied by the applicable filing fees with the appropriate District Court of Appeal. The Notice of Appeal must be filed within thirty days from the date this notice is filed with the clerk of the permitting authority.

Executed in Fort Myers, Florida.

Sincerely,


Margaret F. Highsmith
Director of
District Management

MFH/JRS/jw

FILE

Is your RETURN ADDRESS completed on the reverse side?

SENDER:

- Complete items 1 and/or 2 for additional services.
- Complete items 3, 4a, and 4b.
- Print your name and address on the reverse of this form so that we can return this card to you.
- Attach this form to the front of the mailpiece, or on the back if space does not permit.
- Write "Return Receipt Requested" on the mailpiece below the article number.
- The Return Receipt will show to whom the article was delivered and the date delivered.

I also wish to receive the following services (for an extra fee):

1. Addressee's Address
2. Restricted Delivery

Consult postmaster for fee.

3. Article Addressed to:

MR CHARLES DRAKE
 MANAGER SEBRING POWER
 TAMPA ELECTRIC CO
 P O BOX 111
 TAMPA FL 33601-0111

4a. Article Number

Z 459 522 810

4b. Service Type

- | | |
|---|---|
| <input type="checkbox"/> Registered | <input checked="" type="checkbox"/> Certified |
| <input type="checkbox"/> Express Mail | <input type="checkbox"/> Insured |
| <input type="checkbox"/> Return Receipt for Merchandise | <input type="checkbox"/> COD |

7. Date of Delivery

JUN 25 1999

5. Received By: (Print Name)

6. Signature: (Addressee or Agent)

X

8. Addressee's Address (Only if requested and fee is paid)

JRS/jw

PS Form 3811, December 1994

102595-98-B-0229

Domestic Return Receipt

Thank you for using Return Receipt Service.

Z 459 522 810

**US Postal Service
 Receipt for Certified Mail**

No Insurance Coverage Provided.
 Do not use for International Mail (See reverse)

Sent to	MR CHARLES DRAKE
Street & Number	MANAGER SEBRING POWER
Post Office, State, & ZIP Code	TAMPA ELECTRIC CO
Postage	BOX 111 \$
CERTIFIED MAIL	FL 33601-0111
Special Delivery Fee	
Restricted Delivery Fee	
Return Receipt Showing to Whom & Date Delivered	
Return Receipt Showing to Whom, Date, & Addressee's Address	
TOTAL Postage & Fees	\$
Postmark or Date	JRS
	0550018

PS Form 3800, April 1995

Tampa Electric Company
J. H. Phillips Station
Facility ID No.: 0550018

Highlands County

Initial Title V Air Operation Permit
FINAL Permit No.: 0550018-001-AV

Permitting Authority:


State of Florida Department of Environmental Protection
Post Office Box 2549
Fort Myers, Florida 33902-2549
Telephone: (941) 332-6975
Fax: (941) 332-6969

Drafted on February 5, 1999

Initial Title V Air Operation Permit
FINAL Permit No.: 0550018-001-AV

Table of Contents

Section	Page Number
Placard Page	1
I. Facility Information	2-3
A. Facility Description.	
B. Summary of Emissions Unit ID Nos. and Brief Descriptions.	
C. Relevant Documents.	
II. Facility-wide Conditions	4-5
III. Emissions Unit(s) and Conditions	
A. Diesel Engine No. 1 (E.U. I. D. Number 001)	6-7
Diesel Engine No. 2 (E.U. I. D. Number 002)	6-7
B. Steam Boiler (E.U. I. D. Number 004)	8
C. Common Conditions	9

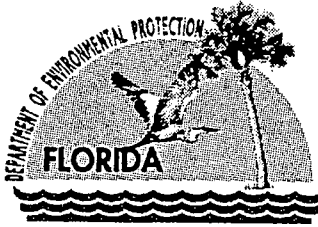

Department of Environmental Protection

Jeb Bush
Governor

South District
P.O. Box 2549
Fort Myers, Florida 33902-2549

David B. Struhs
Secretary

Permittee:
Tampa Electric Company

FINAL Permit No.: 0550018-001-AV
Facility ID No.: 0550018
SIC Nos.: 4911
Project: Initial Title V Air Operation Permit

This permit is for the operation of two slow speed diesel engines and a steam boiler.

The slow speed diesel engines drive electric generators and burn No. 6 fuel oil. The maximum heat input for each engine is 172 MMBtu/hour. The boiler burns No. 2 fuel oil and the steam is used to heat the No. 6 fuel oil. The maximum heat input for the boiler is 10.4 MMBtu/hour. The facility is located at 7301 Airport Road, Sebring, Florida, Highlands County; UTM Coordinates: Zone 17, 464.30 km East and 3035.40 km North; Latitude: 27°26' 35" North and Longitude: 81°21'40" West.

STATEMENT OF BASIS: This Title V air operation permit is issued under the provisions of Chapter 403, Florida Statutes (F.S.), and Florida Administrative Code (F.A.C.) Chapters 62-4, 62-210, and 62-213. The above named permittee is hereby authorized to perform the work or operate the facility shown on the application and approved drawing(s), plans, and other documents, attached hereto or on file with the permitting authority, in accordance with the terms and conditions of this permit.

Referenced attachments made a part of this permit:

APPENDIX TV-3, TITLE V CONDITIONS (version dated 04/30/99)
[Rule 62-296.406, F.A.C.] BACT dated September 3, 1992

Effective Date: June 24, 1999

Renewal Application Due Date: December 24, 2003

Expiration Date: June 24, 2004

STATE OF FLORIDA DEPARTMENT
OF ENVIRONMENTAL PROTECTION

Margaret F. Highsmith
Director of
District Management

MFH/JRS/jw

Section I. Facility Information.

Subsection A. Facility Description.

This facility consists of two 19.535 MW slow speed diesel engines, two heat recovery steam boilers, an auxiliary 10.4 MMBtu/hour steam boiler, a steam turbine, and recirculating cooling water system, fuel oil storage tanks and auxiliary support equipment.

Based on the initial Title V permit application received June 14, 1996 this facility is a major source of air pollutants.

Subsection B. Summary of Emissions Unit ID No(s). and Brief Description(s).

E.U.

<u>ID No.</u>	<u>Brief Description</u>
001	19.535 MW slow speed diesel generating unit
002	19.535 MW slow speed diesel generating unit
003	Emergency diesel generating unit
004	Steam Boiler

Two slow speed diesel engines fired with No. 6 fuel oil, and an auxiliary steam boiler fired with No. 2 fuel oil. The emergency diesel generating unit operates less than 400 hours/year.

Please reference the Permit No., Facility ID No., and appropriate Emissions Unit(s) ID No(s). on all correspondence, test report submittals, applications, etc.

Subsection C. Relevant Documents.

The documents listed below are not a part of this permit, however, are specifically related to this permitting action.

These documents are provided to the permittee for information purposes only:

Appendix A-1, Abbreviations, Acronyms, Citations, and Identification Numbers

Appendix H-1, Permit History/ID Number Changes

Appendix I-1, List of Insignificant Emissions Units and/or Activities

Table 1-1, Summary of Air Pollutant Standards and Terms

Table 2-1, Summary of Compliance Requirements

These documents are on file with permitting authority:
Initial Title V Permit Application received June 14, 1996.

<u>E.U. ID No.</u>	<u>Description</u>	<u>Permit No.</u>	<u>Issue Date</u>	<u>Expiration Date</u>
001	Diesel Generator	AO28-234787	10/15/93	10/05/98
		AO28-154204	09/16/88	09/16/93
		AO28-71313	07/28/83	07/28/88
		AC28-7377	03/16/81	08/16/83
002	Diesel Generator	AO28-234794	10/15/93	10/05/98
		AO28-154205	09/16/88	09/16/93
		AO28-71315	07/28/83	07/28/88
		AC28-7291	03/16/81	08/16/83
003	Diesel Generator	AO28-125884	05/14/87	05/14/92 Declared Exempt 3/3/92
004	Steam Boiler	AO28-234735	11/17/93	10/05/98
		AC28-221558	03/10/93	03/10/98

Section II. Facility-wide Conditions.

The following conditions apply facility-wide:

1. APPENDIX TV-3, TITLE V CONDITIONS, (version dated 04/30/99) is a part of this permit. {Permitting note: APPENDIX TV-3, TITLE V CONDITIONS, is distributed to the permittee only. Other persons requesting copies of these conditions shall be provided one copy when requested or otherwise appropriate.}
2. **Not federally enforceable.** General Pollutant Emission Limiting Standards. Objectionable Odor Prohibited. The permittee shall not cause, suffer, allow, or permit the discharge of air pollutants which cause or contribute to an objectionable odor.
[Rule 62-296.320(2), F.A.C.]
3. General Particulate Emission Limiting Standards. General Visible Emissions Standard. Except for emissions units that are subject to a particulate matter or opacity limit set forth or established by rule and reflected by conditions in this permit, no person shall cause, let, permit, suffer or allow to be discharged into the atmosphere the emissions of air pollutants from any activity, the density of which is equal to or greater than that designated as Number 1 on the Ringelmann Chart (20 percent opacity). EPA Method 9 is the method of compliance pursuant to Chapter 62-297, F.A.C.
[Rule 62-296.320(4)(b)1. & 4., F.A.C.]
4. Prevention of Accidental Releases (Section 112(r) of CAA
 - a. The permittee shall submit its Risk Management Plan (RMP) to the Chemical Emergency Preparedness and Prevention Office (CEPPO) RMP Reporting Center when, and if, such requirement becomes applicable; and
 - b. The permittee shall submit to the permitting authority Title V certification forms or a compliance schedule in accordance with Rule 62-213.440(2), F.A.C.[40 CFR 68]
5. Insignificant Emissions Units and or Activities. Appendix I - List of insignificant emission units and/or activities, is a part of this permit.
6. **Not federally enforceable.** General Pollutant Emission Limiting Standards. Volatile Organic Compounds (VOC) Emissions or Organic Solvents (OS) Emissions. The permittee shall allow no person to store, pump, handle, process, load, unload or use in any process or installation, volatile organic compounds (VOC) or organic solvents (OS) without applying known and existing vapor emission control devices or systems deemed necessary and ordered by the Department.
[Rule 62-296.320(1)(a), F.A.C.]
7. The hours of operation of this facility are not limited.

8. If the department has reason to believe that any applicable emission standard or condition of the permit is being violated, then the department may require the permittee to conduct compliance tests or keep additional records which identify the nature and quantity of pollutant emissions.

[Rule 62-297.310(7)(b), F.A.C.]

9. When appropriate, any recording, monitoring, or reporting requirements that are time-specific shall be in accordance with the effective date of the permit, which defines day one.

[Rule 62-213.440, F.A.C.]

10. Annual Operating Report for Air Pollutant Emitting Facility. The Annual Operating Report for Air Pollutant Emitting Facility (DEP Form No. 62-210.900(5)) shall be completed each year for all Title V sources. The annual operating report shall be submitted to the Department of Environmental Protection (DEP) South District office by March 1 of the following year unless otherwise indicated by permit condition or Department request.

[Rule 62-210.370(3)(a)&(c), F.A.C.]

11. The permittee shall submit all compliance related notifications and reports required of this permit to the Department's South District office:

Department of Environmental Protection

South District

Post Office Box 2549

Fort Myers, Florida 33902-2549

Telephone: 941/332-6975

Fax: 941/332-6969

12. Any reports, data, notifications, certifications, and requests required to be sent to the United States Environmental Protection Agency, Region 4, should be sent to:

United States Environmental Protection Agency

Region 4

Air & EPCRA Enforcement Branch, Air Enforcement Section

61 Forsyth Street

Atlanta, Georgia 30303

Telephone: 404/562-9155, Fax: 404/562-9164

Section III. Emissions Unit(s) and Conditions.

Subsection A. This section addresses the following emissions unit(s).

E.U.

<u>ID No.</u>	<u>Brief Description</u>
001	19.535 MW slow speed diesel generating unit
002	19.535 MW slow speed diesel generating unit

The following specific conditions apply:

Essential Potential to Emit (PTE) Parameters

A.1. Permitted Capacity. The maximum operation heat input rate is as follows:

<u>Unit No.</u>	<u>MMBtu/hour</u>	<u>Fuel Type</u>
001	172	No. 6 fuel oil
002	172	No. 6 fuel oil

A.2. Methods of Operation. Fuels.

a. This facility is authorized to fire Number 6 fuel oil with a sulfur content of $\leq 2.5\%$ in the diesel generating units.

[Rule 62-210.200, F.A.C., Definitions: Potential-to-Emit].

A.3. Hours of Operation. These emissions units are allowed to operate continuously, i.e. 8760 hours/year.

[Rules 62-4,160(2) and 62-210.200(PTE), F.A.C.]

Emission Limitations and Standards

A.4. The allowable emissions for each slow-speed diesel engine shall be as follows:

<u>Pollutant</u>	<u>Maximum Emissions</u>	<u>lb/hour</u>
Nitrogen Oxides (NO _x)	819 PPM @ 15% O ₂	572
Carbon Monoxide (CO)	0.575 lb/MMBtu	99
Hydrocarbons (HC)	0.26 lb/MMBtu	45
Particulate Matter (PM)	0.1 lb/MMBtu	17
Sulfur Dioxide (SO ₂)	2.67 lb/MMBtu	460

[BACT Dated February 17, 1981]

Test Methods and Procedures

A.5. Nitrogen oxide emission tests are required to show continuing compliance with the standards of the Department. The test results must provide reasonable assurance that the unit is capable of compliance at the permitted maximum operating rate. Test shall be conducted in accordance with EPA Method 7E as published in 40 CFR-60, Appendix A, or State approved equivalent method. Such tests shall be conducted once during each Federal fiscal year.

[Construction permit No. AC28-221558 dated March 16, 1981 and Rule 62-212.410, F.A.C.]

A.6. Carbon monoxide emission tests are required to show continuing compliance with the standards of the Department. The test results must provide reasonable assurance that the unit is capable of compliance at the permitted maximum operating rate. Test shall be conducted in accordance with EPA Method 10 as published in 40 CFR-60, Appendix A, or State approved equivalent method. Such tests shall be conducted once during each Federal fiscal year.

[Construction permit No. AC28-221558 dated March 16, 1981.]

A.7. Visible emission tests are required to show continuing compliance with the standards of the Department. The test results must provide reasonable assurance that the unit is capable of compliance at the permitted maximum operating rate. Test shall be conducted in accordance with EPA Method 9 as published in 40 CFR-60, Appendix A, or State approved equivalent method. Such tests shall be conducted once during each Federal fiscal year.

[Construction permit No. AC28-221558 dated March 16, 1981 and Rule 62-297.310(7), F.A.C.]

A.8. If the opacity determined by EPA method 9 is greater than 10% then a particulate matter emissions test is required. The test shall be conducted in accordance with EPA Method 5 as published in 40 CFR-60, Appendix A, or State approved equivalent method.

[Construction permit No. AC28-221558 dated March 16, 1981.]

A.9. Compliance with the sulfur dioxide emission limit may be calculated from analyses of sulfur in the fuel oil. Sulfur content in fuel shall not exceed 2.5% by weight.

[Construction permit No. AC28-221558 dated March 16, 1981.]

A.10. The following parameters are to be monitored on a daily basis. Appropriate records shall be maintained on site for Department Inspection:

- (a) Intake manifold temperature
- (b) Intake manifold pressure
- (c) Fuel flow
- (d) Injector flow

[Construction permit No. AC28-221558 dated March 16, 1981.]

A.11. Stack sampling facilities provided by the owner shall be in accordance with the requirements of Chapter 62-297. F.A.C.

Subsection B. This section addresses the following emission unit(s).

E.U.

<u>ID No.</u>	<u>Brief Description</u>
004	Steam Boiler

The following specific conditions apply:

Essential Potential to Emit (PTE) Parameters

B.1. Permitted Capacity. The maximum operation heat input rate is 10.46 MMBtu/hour.
[Construction permit No. AC28-221558 dated March 10, 1993]

B.2. Methods of Operation. Fuel. This boiler is authorized to burn No. 2 fuel oil with a sulfur content $\leq 0.5\%$ by weight.
[Construction permit No. AC28-221558 dated March 10, 1993]

B.3. This emissions unit is allowed to operate continuously, i.e., 8760 hours/year.

Emission Limitations and Standards

B.4. Visible emissions shall not exceed 20% opacity under normal operation except for up to 6 minutes in any one hour during which the average opacity shall not exceed 27%.
[Rule 62-296.406(1), F.A.C.]

Test Methods and Procedures

B.5. Visible emissions tests are required to show continuing compliance with the standards of the Department. The test results must provide reasonable assurance that the unit is capable of compliance at the permitted maximum operating rate. Tests shall be conducted in accordance with EPA Method 9 as published in 40 CFR-60, Appendix A, or State approved equivalent method. Such tests shall be conducted once during each Federal fiscal year. Results shall be submitted to the Department within 45 days after testing. The Department shall be notified at least 15 days prior to testing to allow witnessing.
[Rule 62-297.310(7), F.A.C.]

Subsection C. Common Conditions

E.U.

<u>ID No.</u>	<u>Brief Description</u>
001	Diesel Generator
002	Diesel Generator
004	Steam Boiler

The following conditions apply to the emissions units listed above:

C.1. Tampa Electric Company shall maintain daily records, in a permanent form suitable for inspection, documenting the sulfur content of all fuels burned. The records shall contain, as a minimum, for each day, the sulfur content of the fuels, the amount of each fuel burned, Btu content, and density of the fuel. The records shall contain sufficient detail to allow the Department to determine whether the emissions were properly computed. All recorded data shall be maintained on file for a period of at least 5 years. Quarterly reports shall be submitted for those quarters in which the facility is in service. The reports shall be sent to the Department within 30 days of the end of the quarter giving monthly summaries of the following data:

- a) Pounds of sulfur dioxide per million Btu of heat input based on a monthly average.
- b) The amount of each type of fuel burned for the reporting period.

[BACT dated February 17, 1981]

C.2. Annual compliance testing is not required for these emissions units while burning only liquid fuel(s) for less than 400 hour per year.

[Rules 62-297.310(7)(a)3 . and 5., F.A.C.; and ASP Number 97-B-01.]

Test Methods and Procedures

C.3. Operating Rate During Testing. Testing of emissions should be conducted with the source operating within 10% of its rated capacity. Testing may be conducted at less than 90% of rated capacity; however, if so, subsequent source operation is limited to up to 110% of the test load. Once the unit is so limited, operation at higher capacities is allowed for purposes of additional compliance testing to regain rated capacity in the permit with prior notification of Department's South District. [Rule 62-297.310(2) and (2)(b), F.A.C.]

C.4. Issuance of this permit does not relieve the permittee from complying with applicable emission limiting standards or other requirements of Rules 62-210, 62-212, 62-252, 62-272, 62-273, 62-275, 62-296, and 62-297, F.A.C., or any other requirements under Federal, State, or local law. [Rule 62-210.300, F.A.C.]

Tampa Electric Company
J. H. Phillips Station

FINAL Permit No.: 0550018-001-AV

Appendix H-1, Permit History/ID Number Changes

Permit History (for tracking purposes):

<u>E.U. ID No.</u>	<u>Description</u>	<u>Permit No.</u>	<u>Issue Date</u>	<u>Expiration Date</u>
001	Diesel Generator	AO28-234787	10/15/93	10/05/98
		AO28-154204	09/16/88	09/16/93
		AO28-71313	07/28/83	07/28/88
		AC28-7377	03/16/81	08/16/83
002	Diesel Generator	AO28-234794	10/15/93	10/05/98
		AO28-154205	09/16/88	09/16/93
		AO28-71315	07/28/83	07/28/88
		AC28-7291	03/16/81	08/16/83
003	Diesel Generator	AO28-125884	05/14/87	05/14/92 Declared Exempt 3/3/92
004	Steam Boiler	AO28-234735	11/17/93	10/05/98
		AC28-221558	03/10/93	03/10/98

From: Facility ID No.: 52FTM280018

To: Facility ID No.: 0550018

Notes:

- 1 - AO permit(s) automatic extension(s) in Rule 62-210.300(2)(a)3.a., F.A.C., effective 3/21/96.
- 2 - AC permit(s) automatic extension(s) in Rule 62-213.420(1)(a)4., F.A.C., effective 03/20/96.
{Rule 62-213.420(1)(b)2., F.A.C., effective 03/20/96, allows Title V Sources to operate under existing valid permits}

Tampa Electric Company
J. H. Phillips Station

FINAL Permit No.: 0550018-001-AV

Appendix I-1, List of Insignificant Emissions Units and/or Activities.

The facilities, emissions units, or pollutant-emitting activities listed in Rule 62-210.300(3)(a), F.A.C., Categorical Exemptions, are exempt from the permitting requirements of Chapters 62-210 and 62-4, F.A.C.; provided, however, that exempt emissions units shall be subject to any applicable emission limiting standards and the emissions from exempt emissions units or activities shall be considered in determining the potential emissions of the facility containing such emissions units. Emissions units and pollutant-emitting activities exempt from permitting under Rule 62-210.300(3)(a), F.A.C., shall not be exempt from the permitting requirements of Chapter 62-213, F.A.C., if they are contained within a Title V source; however, such emissions units and activities shall be considered insignificant for Title V purposes provided they also meet the criteria of Rule 62-213.430(6)(b), F.A.C. No emissions unit shall be entitled to an exemption from permitting under Rule 62.210.300(3)(a), F.A.C., if its emissions, in combination with the emissions of other units and activities at the facility, would cause the facility to emit or have the potential to emit any pollutant in such amount as to make the facility a Title V source.

The below listed emissions units and/or activities are considered insignificant pursuant to Rule 62-213.430(6), F.A.C.

<u>Emission Source</u>	<u>Process Area</u>
1. Emergency Diesel Generator	Facility-Wide
2. Fuel Oil Storage Tanks	Facility-Wide
3. Ancillary Support Equipment	Facility-Wide

Table 1-1, Summary of Air Pollutant Standards and Terms

Tampa Electric Company
 J. H. Phillips Station

Permit No.: 0550018-001-AV
Facility ID No.: 0550018

This table summarizes information for convenience purposes only. This table does not supersede any of the terms of conditions of this permit.

E.U. ID No. **Brief Description:**
 001& 002 Diesel Generator

Pollutant Name	Fuel(s)	Hours/Year	Allowable Emissions			Equivalent Emissions		Regulatory Citation(s)	See Permit Conditions
			Standard(s)	lbs/hour	TPY	lbs/hour	TPY		
NO _x	Oil	8760	819PPM @15% O ₂	572	2505	572	2505	BACT Dated 02/17/81	A.4.
CO	Oil	8760	0.575 lb/MMBtu	99	434	99	434	BACT Dated 02/17/81	A.4.
HC	Oil	8760	0.26 lb/MMBtu	45	197	45	197	BACT Dated 02/17/81	A.4.
PM	Oil	8760	0.1 LB/MMBtu	17	74.5	17	74.5	BACT Dated 02/17/81	A.4.
SO ₂	Oil	8760	2.5% S 2.67lb/MMBtu	460	2015	460	2015	BACT Dated 02/17/81	A.4.

Notes:
 * The "Equivalent Emissions" listed are for informational purpose only.

Table 1-1, Summary of Air Pollutant Standards and Terms

Tampa Electric Company
 J. H. Phillips Station

Permit No.: 0550018-001-AV
Facility ID No.: 0550018

This table summarizes information for convenience purposes only. This table does not supersede any of the terms of conditions of this permit.

E.U. ID No. **Brief Description:**
 004 Steam Boiler

Pollutant Name	Fuel(s)	Hours/Year	Allowable Emissions			Equivalent Emissions		Regulatory Citation(s)	See Permit Conditions
			Standard(s)	lbs/hour	TPY	lbs/hour	TPY		
NO _x	Oil	8760				1.49	6.53	Construction Permit Dated 03/10/93 Rule 62-296	B.1., B.2., B.3. B.4., B.5., C.2.
SO ₂	Oil	8760	0.5% S	5.29	23.2	5.29	23.2		
PM	Oil	8760				0.15	0.65		

Notes:
 * The "Equivalent Emissions" listed are for informational purpose only.

Table 2-1, Summary of Compliance Requirements

Tampa Electric Company
J. H. Phillips Station

Permit No.: 0550018-001-AV
Facility ID No.: 0550018

This table summarizes information for convenience purposes only. This table does not supersede any of the terms of conditions of this permit.

E.U. ID No. **Brief Description:**
001& 002 Diesel Generator

Pollutant Name or Parameter	Fuels	Compliance Method	Testing Time Frequency	Frequency Base Date*	Minimum Compliance Test Duration	CMS**	See Permit Condition(s)
NO _x	Oil	EPA Method 7 E	Once/Year	09/30/99	3 Hours		A.4., A.5., A.11.,
CO	Oil	EPA Method 10	Once/Year	09/30/99	3 Hours		A.4., A.6., A.11.
HC	Oil	Record Keeping					A.4.
PM	Oil	VE	Once/Year	09/30/99	0.5 Hour		A.4., 3, A.7., A.8.
SO ₂	Oil	Record Keeping					A.2., A.3., A.4., A.9.

Notes:

* The frequency base date is established for planning only; see Rule 62-297.310, F.A.C.

** CMS [=] continuous monitoring system

Table 2-1, Summary of Compliance Requirements

Tampa Electric Company
J. H. Phillips Station

Permit No.: 0550018-001-AV
Facility ID No.: 0550018

This table summarizes information for convenience purposes only. This table does not supersede any of the terms of conditions of this permit.

E.U. ID No. **Brief Description:**
004 Steam Boiler


Pollutant Name or Parameter	Fuels	Compliance Method	Testing Time Frequency	Frequency Base Date*	Minimum Compliance Test Duration	CMS**	See Permit Condition(s)
NO _x SO ₂ PM	Oil Oil Oil	Record Keeping Record Keeping V.E.	Once/Year	09/30/99	1 Hour		B.2., C.1. B.2., C.1. B.4., B.5., C.2.

Notes:
* The frequency base date is established for planning only; see Rule 62-297.310, F.A.C.
** CMS [=] continuous monitoring system

CERTIFICATION

Application No.: 0550018 -001-AO
Applicant: Tampa Electric Company
Project: Sugar Refinery

I HEREBY CERTIFY that the engineering features described in the above referenced application provide reasonable assurance of compliance with applicable provisions of Chapter 403, Florida Statutes, and Florida Administrative Code Title 62. However, I have not evaluated and I do not certify aspects of the proposal outside of my area of expertise (including, but not limited to, the electrical, mechanical, structural, hydrological, and geological features).



(Signed)

6-23-99

(Date)

(Seal)

FedEx USA Airbill

FedEx
Tracking
Number

09689265963

Form
I.D. No.

0210

SOR 11

Recipient's Copy


1 From
Date 3/10/99
Sender's Name Shannon Todd Phone (813) 671-3361
Company TAMPA ELECTRIC CO/PROD ENGR
Address 6944 US HIGHWAY 41 N
City APOLLO BEACH State FL ZIP 33572

2 Your Internal Billing Reference Information 4415-5419-28-18-381

3 To
Recipient's Name David Knowles, P.E. Phone ()
Company EDEP
Address 2295 Victoria Ave Suite 304
City FL Myers State FL ZIP 33901

For HOLD at FedEx Location check here
 Hold Weekday (Not available with FedEx First Overnight)
 Hold Saturday (Not available at all locations and FedEx 2Day only)

For WEEKEND Delivery check here (Extra Charge, Not available at all locations)
 Saturday Delivery (Available for FedEx Priority Overnight and FedEx 2Day only)
 NEW Sunday Delivery (Available for FedEx Priority Overnight only)

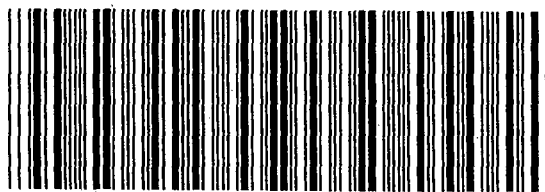

8 0 9 6 8 9 2 6 5 9 6 3

4a Express Package Service Packages under 150 lbs. Delivery commitment may be later in some areas.
 FedEx Priority Overnight (Next business morning)
 FedEx Standard Overnight (Next business afternoon)
 FedEx First Overnight (Earliest next business morning delivery to select locations) (Higher rates apply)
 FedEx 2Day (Second business day)
 FedEx Express Saver (Third business day)
FedEx Letter Rate not available. Minimum charge: One pound rate.

4b Express Freight Service Packages over 150 lbs. Delivery commitment may be later in some areas.
 FedEx Overnight Freight (Next business day)
 FedEx 2Day Freight (Second business day)
 FedEx Express Saver Freight (Up to 3 business days)
(Call for delivery schedule. See back for detailed descriptions of freight services.)

5 Packaging
 FedEx Letter
 FedEx Pak
 FedEx Box
 FedEx Tube
 Other Pkg.
Declared value limit \$500

6 Special Handling (One box must be checked)
Does this shipment contain dangerous goods? No Yes (Shipper's Declaration not required)
 Dry Ice (Dry Ice, 9, UN 1845, x kg)
 Cargo Aircraft Only
*Dangerous Goods cannot be shipped in FedEx packaging.

7 Payment
Bill to: Sender (Account No. in Section 1 will be billed) Recipient (Enter FedEx Account No. or Credit Card No. below) Third Party Credit Card Cash/Check
 Obtain Recipient FedEx Account No.



Total Packages _____ Total Weight _____ Total Declared Value \$ _____
Total Charges _____
Credit Card Auth. _____

8 Release Signature

Your signature authorizes Federal Express to deliver this shipment without obtaining a signature and agrees to indemnify and hold harmless Federal Express from any resulting claims.

Questions?
Call 1-800-Go-FedEx® (800)463-3339

321

0079096568

WCSL 1098
Rev. Date 7/98
Part #153023PS
©1994-98 Fed
PRINTED IN U.S.