



Jeb Bush
Governor

Department of Environmental Protection

Twin Towers Office Building
2600 Blair Stone Road
Tallahassee, Florida 32399-2400

Colleen M. Castille
Secretary

P.E. Certification Statement

Permittee:
Tampa Electric Company
Big Bend Station

DRAFT Permit No.: 0570039-017-AV
Facility ID No.: 0570039

Project type: Title V Air Operation Permit Revision/Renewal

I HEREBY CERTIFY that the engineering features described in the above referenced application and subject to the proposed permit conditions provide reasonable assurance of compliance with applicable provisions of Chapter 403, Florida Statutes; and Florida Administrative Code Chapters 62-4, 62-210, 62-296, and 62-297. However, I have not evaluated and I do not certify aspects of the proposal outside of my area of expertise (including, but not limited to, the electrical, mechanical, structural, hydrological, geological features, and the acid rain part).

C. L. Phillips, P.E.

Registration Number: 50246

9/27/04
date

Permitting Authority:

State of Florida
Department of Environmental Protection
Division of Air Resources Management
Bureau of Air Regulation
Title V Section MS #5505
2600 Blair Stone Road
Tallahassee, FL 32399-2400

Telephone: 850/488-0114

Fax: 805/921-9533

"More Protection, Less Process"

Printed on recycled paper.



Jeb Bush
Governor

Department of Environmental Protection

Twin Towers Office Building
2600 Blair Stone Road
Tallahassee, Florida 32399-2400

Colleen M. Castille
Secretary

September 27, 2004

Ms. Karen Sheffield
General Manager, Big Bend Station
Tampa Electric Company
P.O. Box 111
Tampa, FL 33601-0111

Re: Air Construction Permit 0570039-016-AC and Title V Air Operation Permit No. 0570039-017-AV
Tampa Electric Company – Big Bend Station
Renewal and Revision of Title V Operation Permit including Air Construction Permit to remove redundant conditions and add clarifying language.

Dear Ms. Sheffield:

On January 16, and May 18, 2004, you respectively submitted an application for a Title V air operation permit revision and an application for an air construction permit revision to remove redundant Title V permit conditions and to clarify permit language. In addition, on June 28, 2004, you submitted an application for the renewal of the Title V air operation permit for Big Bend Station, which is located at Big Bend Road, North Ruskin. Enclosed are the following documents: "Technical Evaluation and Preliminary Determination", "DRAFT Air Construction Permit", "Statement of Basis", "DRAFT Title V Air Operation Permit", "Written Notice of Intent to Issue Air Construction Permit and Title V Air Operation Permit", and "Public Notice of Intent to Issue Air Construction Permit and Title V Air Operation Permit".

The "Technical Evaluation and Preliminary Determination" summarizes the Permitting Authority's technical review of the application and provides the rationale for making the preliminary determination to issue the DRAFT air construction permit. The "Statement of Basis" summarizes the emissions units regulated by the Title V permit and the revisions made to the permit. The "DRAFT Air Construction Permit" and "DRAFT Title V Air Operation Permit" (DRAFT Permits) include specific conditions that regulate the emissions units at this facility. The "Written Notice of Intent to Issue Air Construction Permit and Title V Air Operation Permit" provides important information regarding: the Permitting Authority's intent to issue the DRAFT Permits; the requirements for publishing a Public Notice of the Permitting Authority's intent to issue the DRAFT Permits; the procedures for submitting comments on the DRAFT Permits; the requirements for requesting a public meeting; the requirements for filing a petition for an administrative hearing; and the availability of mediation. The "Public Notice of Intent to Issue Air Construction Permit and Title V Air Operation Permit" is the actual notice that you must have published in the legal advertisement section of a newspaper of general circulation in the area affected by this project.

If you have any questions, please contact the Project Engineer, Ms. Cindy Phillips, P.E., at 850/921-9534 or Cindy.Phillips@dep.state.fl.us.

Sincerely,

Trina L. Vielhauer, Chief
Bureau of Air Regulation

Enclosures

"More Protection, Less Process"

Printed on recycled paper.

**WRITTEN NOTICE OF INTENT TO ISSUE AIR CONSTRUCTION PERMIT AND
TITLE V AIR OPERATION PERMIT**

In the Matter of an

Application for Air Construction Permit and Title V Air Operation Permit by:

Ms. Karen Sheffield, General Manger
Tampa Electric Company
P.O. Box 111
Tampa, FL 33601-0111

DRAFT Air Permits Nos.:
0570039-016-AC & 0570039-017-AV
Big Bend Station
Title V Permit Clarifications and Renewal
Hillsborough County, Florida

Facility Location: The applicant requests a Title V air operation permit (Permit) to operate an Electric Utility, which is located at Big Bend Road in North Ruskin, Hillsborough County, Florida.

Project: On January 16, and May 18, 2004, respectively, the applicant applied to the Permitting Authority for an application for a Title V air operation permit revision and an application for an air construction permit revision to remove redundant Title V permit conditions and to clarify permit language. In addition, on June 28, 2004, the applicant applied to the Permitting Authority for the renewal of the Title V air operation permit. Details of the project are provided in the in the applications and the enclosed "Technical Evaluation and Preliminary Determination". The enclosed "Statement of Basis" summarizes the emissions units regulated by the Title V permit and the revisions made to the permit.

Permitting Authority: These applications for an air construction permit and a Title V air operation permit are subject to review in accordance with the provisions of Chapter 403, Florida Statutes (F.S.) and Chapters 62-4, 62-210, and 62-213 and 62-214, Florida Administrative Code (F.A.C.). The proposed project is not exempt from air permitting requirements and air permits are required to operate the facility and to renew and make revisions to the current permit. The FDEP Bureau of Air Regulation is the Permitting Authority responsible for making a permit determination regarding this project. The Permitting Authority's physical address is: FDEP Bureau of Air Regulation at 111 S. Magnolia, Suite 4, Tallahassee, FL 32301. The Permitting Authority's mailing address is: FDEP Bureau of Air Regulation, MS 5505, 2600 Blair Stone Road, Tallahassee, FL 32399-2400.. The Permitting Authority's telephone number is 850/488-0114 and facsimile 850/921-9533.

Project File: A complete project file is available for public inspection during the normal business hours of 8:00 a.m. to 5:00 p.m., Monday through Friday (except legal holidays), at the address indicated above for the Permitting Authority. The complete project file includes the Technical Evaluation and Preliminary Determination, the DRAFT Permits, the Statement of Basis, the applications, and the information submitted by the applicant, exclusive of confidential records under Section 403.111, F.S. Interested persons may view the DRAFT Permits and file electronic comments by visiting the following website: <http://www.dep.state.fl.us/air/eproducts/ards/> . A copy of the complete project file is also available at the following offices:

FDEP Southwest District Office, 8407 Laurel Fair Circle, Tampa, FL 33610
(Telephone: 850/488-0114).

Environmental Protection Commission of Hillsborough County, 1410 North 21 Street, Tampa, FL 33605
(Telephone: 813/272-5605)

Notice of Intent to Issue Air Permit: The Permitting Authority gives notice of its intent to issue permits to the applicant for the project described above. The applicant has provided reasonable assurance that operation of the facility will not adversely impact air quality and that the project will comply with all appropriate provisions of Chapters 62-4, 62-204, 62-210, 62-212, 62-213, 62-214, 62-256, 62-257, 62-281, 62-296, and 62-297, F.A.C. The Permitting Authority will issue a FINAL Air Construction Permit, a PROPOSED Title V Operation Permit and subsequent FINAL Title V Operation

Tampa Electric Company – Big Bend Station

DRAFT Air Permits Nos. 0570039-016-AC
0570039-017-AV

**WRITTEN NOTICE OF INTENT TO ISSUE AIR CONSTRUCTION PERMIT AND
TITLE V AIR OPERATION PERMIT**

Permit in accordance with the conditions of the DRAFT Permits unless a response received in accordance with the following procedures results in a different decision or a significant change of terms or conditions.

Public Notice: Pursuant to Section 403.815, F.S. and Rules 62-110.106 and 62-210.350, F.A.C., you (the applicant) are required to publish at your own expense the enclosed "Public Notice of Intent to Issue Air Construction Permit and Title V Air Operation Permit" (Public Notice). The Public Notice shall be published one time only as soon as possible in the legal advertisement section of a newspaper of general circulation in the area affected by this project. The newspaper used must meet the requirements of Sections 50.011 and 50.031, F.S. in the county where the activity is to take place. If you are uncertain that a newspaper meets these requirements, please contact the Permitting Authority at above address or phone number. Pursuant to Rule 62-110.106(5), F.A.C., the applicant shall provide proof of publication to the Permitting Authority at the above address within seven (7) days of publication. Failure to publish the notice and provide proof of publication may result in the denial of the permits pursuant to Rule 62-110.106(11), F.A.C.

Comments: The Permitting Authority will accept written comments concerning the DRAFT Permits for a period of thirty (30) days from the date of publication of this Public Notice. Written comments must be post-marked, and all e-mail or facsimile comments must be received by the close of business (5 pm), on or before the end of this 30-day period by the Permitting Authority at the above address, email or facsimile. As part of his or her comments, any person may also request that the Permitting Authority hold a public meeting on this permitting action. If the Permitting Authority determines there is sufficient interest for a public meeting, it will publish notice of the time, date, and location on the Department's official web site for notices at <http://tlhora6.dep.state.fl.us/onw> and in a newspaper of general circulation in the area affected by the permitting action. For additional information, contact the Permitting Authority at the above address or phone number. If written comments or comments received at a public meeting result in a significant change to the DRAFT Permits, the Permitting Authority issue Revised DRAFT Permits and require, if applicable, another Public Notice. All comments filed will be made available for public inspection.

Petitions: A person whose substantial interests are affected by the proposed permitting decision may petition for an administrative hearing in accordance with Sections 120.569 and 120.57, F.S. The petition must contain the information set forth below and must be filed with (received by) the Department's Agency Clerk in the Office of General Counsel of the Department of Environmental Protection, 3900 Commonwealth Boulevard, Mail Station #35, Tallahassee, Florida 32399-3000. Petitions filed by the applicant or any of the parties listed below must be filed within fourteen (14) days of receipt of this Written Notice of Intent to Issue Title V Air Operation Permit. Petitions filed by any persons other than those entitled to written notice under Section 120.60(3), F.S., must be filed within fourteen (14) days of publication of the attached Public Notice or within fourteen (14) days of receipt of this Written Notice of Intent to Issue Air Construction Permit and Title V Air Operation Permit, whichever occurs first. Under Section 120.60(3), F.S., however, any person who asked the Permitting Authority for notice of agency action may file a petition within fourteen (14) days of receipt of that notice, regardless of the date of publication. A petitioner shall mail a copy of the petition to the applicant at the address indicated above, at the time of filing. The failure of any person to file a petition within the appropriate time period shall constitute a waiver of that person's right to request an administrative determination (hearing) under Sections 120.569 and 120.57, F.S., or to intervene in this proceeding and participate as a party to it. Any subsequent intervention will be only at the approval of the presiding officer upon the filing of a motion in compliance with Rule 28-106.205, F.A.C.

A petition that disputes the material facts on which the Permitting Authority's action is based must contain the following information: (a) The name and address of each agency affected and each agency's

**WRITTEN NOTICE OF INTENT TO ISSUE AIR CONSTRUCTION PERMIT AND
TITLE V AIR OPERATION PERMIT**


file or identification number, if known; (b) The name, address, and telephone number of the petitioner; the name, address and telephone number of the petitioner's representative, if any, which shall be the address for service purposes during the course of the proceeding; and an explanation of how the petitioner's substantial interests will be affected by the agency determination; (c) A statement of how and when each petitioner received notice of the agency action or proposed action; (d) A statement of all disputed issues of material fact. If there are none, the petition must so state; (e) A concise statement of the ultimate facts alleged, including the specific facts the petitioner contends warrant reversal or modification of the agency's proposed action; (f) A statement of the specific rules or statutes the petitioner contends require reversal or modification of the agency's proposed action; and, (g) A statement of the relief sought by the petitioner, stating precisely the action the petitioner wishes the agency to take with respect to the agency's proposed action. A petition that does not dispute the material facts upon which the Permitting Authority's action is based shall state that no such facts are in dispute and otherwise shall contain the same information as set forth above, as required by Rule 28-106.301, F.A.C.

Because the administrative hearing process is designed to formulate final agency action, the filing of a petition means that the Permitting Authority's final action may be different from the position taken by it in this Written Notice of Intent to Issue Air Construction Permit and Title V Air Operation Permit. Persons whose substantial interests will be affected by any such final decision of the Permitting Authority on the application have the right to petition to become a party to the proceeding, in accordance with the requirements set forth above.

Mediation: Mediation is not available in this proceeding.

Objections: Finally, pursuant to 42 United States Code (U.S.C.) Section 7661d(b)(2), any person may petition the Administrator of the EPA within sixty (60) days of the expiration of the Administrator's 45 (forty-five) day review period as established at 42 U.S.C. Section 7661d(b)(1), to object to the issuance of any Title V air operation permit. Any petition shall be based only on objections to the Permit that were raised with reasonable specificity during the thirty (30) day public comment period provided in the Public Notice, unless the petitioner demonstrates to the Administrator of the EPA that it was impracticable to raise such objections within the comment period or unless the grounds for such objection arose after the comment period. Filing of a petition with the Administrator of the EPA does not stay the effective date of any permit properly issued pursuant to the provisions of Chapter 62-213, F.A.C. Petitions filed with the Administrator of EPA must meet the requirements of 42 U.S.C. Section 7661d(b)(2) and must be filed with the Administrator of the EPA at: U.S. EPA, 401 M Street, S.W., Washington, D.C. 20460. For more information regarding EPA review and objections, visit EPA's web site at <http://www.epa.gov/region4/air/permits/Florida.htm>.

Executed in Tallahassee, Florida.



Trina L. Vielhauer, Chief
Bureau of Air Regulation

WRITTEN NOTICE OF INTENT TO ISSUE AIR CONSTRUCTION PERMIT AND
TITLE V AIR OPERATION PERMIT

CERTIFICATE OF SERVICE

The undersigned duly designated deputy agency clerk hereby certifies that this "Written Notice of Intent to Issue Air Permit" package (including the Public Notice, the Statement of Basis, and the Draft Permit) was sent by certified mail (*) and copies were mailed by U.S. Mail or electronic mail before the close of business on 9/28/04 to the persons listed below.

Ms. Karen Sheffield, TEC*
Ms. Raiza Calderon, TEC
Mr. Thomas Davis, P.E., ECT
Ms. Cindy Phillips, P.E., Bureau of Air Regulation
Mr. Jason Waters, FDEP-SWD
Ms. Alice Harman, EPCHC
EPA Region 4

9/28/04 cc: Cindy Phillips
Rebecca J. Sunday

Clerk Stamp

FILING AND ACKNOWLEDGMENT FILED, on this date, pursuant to Section 120.52(7), Florida Statutes, with the designated agency clerk, receipt of which is hereby acknowledged.

Rebecca J. Sunday 9/28/04
(Clerk) (Date)

SENDER: COMPLETE THIS SECTION	COMPLETE THIS SECTION ON DELIVERY
<ul style="list-style-type: none"> Complete items 1, 2, and 3. Also complete item 4 if Restricted Delivery is desired. Print your name and address on the reverse so that we can return the card to you. Attach this card to the back of the mailpiece, or on the front if space permits. <p>1. Article Addressed to: Ms. Karen Sheffield General Manager, Big Bend Station Tampa Electric Company P.O. Box 111 Tampa, Florida 33601-0111</p>	<p>A. Received by (Please Print Clearly) _____ B. Date of Delivery _____</p> <p>C. Signature <i>[Handwritten Signature]</i> <input type="checkbox"/> Agent <input checked="" type="checkbox"/> Addressee</p> <p>D. Is delivery address different from item 1? <input type="checkbox"/> Yes If YES, enter delivery address below: <input type="checkbox"/> No</p> <p>3. Service Type <input checked="" type="checkbox"/> Certified Mail <input type="checkbox"/> Express Mail <input type="checkbox"/> Registered <input type="checkbox"/> Return Receipt for Merchandise <input type="checkbox"/> Insured Mail <input type="checkbox"/> C.O.D.</p> <p>4. Restricted Delivery? (Extra Fee) <input type="checkbox"/> Yes</p>
<p>2. Article Number (Copy from service label)</p>	<p>7001 1140 0002 1577 7317</p>



PS Form 3811, July 1999 Domestic Return Receipt 10295-99-M-177

**U.S. Postal Service
 CERTIFIED MAIL RECEIPT
 (Domestic Mail Only; No Insurance Coverage Provided)**

7001 1140 0002 1577 7317

Ms. Karen Sheffield, General Manager

Postage	\$	Postmark Here
Certified Fee		
Return Receipt Fee (Endorsement Required)		
Restricted Delivery Fee (Endorsement Required)		
Total Postage & Fees	\$	

Sent To
 Ms. Karen Sheffield, General Manager
 Street, Apt. No.,
 or PO Box No. P.O. Box 111
 City, State, ZIP+4
 Tampa, Florida 33601-0111

PS Form 3800, January 2001 See Reverse for Instructions

**PUBLIC NOTICE OF INTENT TO ISSUE AIR CONSTRUCTION PERMIT AND
TITLE V AIR OPERATION PERMIT**

Florida Department of Environmental Protection
DRAFT Air Construction Permit No. 0570039-016-AC
DRAFT Title V Air Operation Permit No. 0570039-017-AV
Tampa Electric Company – Big Bend Station
Hillsborough County

Applicant: The applicant for this project is Tampa Electric Company, Big Bend Station, P.O. Box 111, Tampa, FL 33601-0111. The applicant's responsible official is Ms. Karen Sheffield, General Manager.

Facility Location: The applicant operates an Electric Utility which is located at Big Bend Road in Hillsborough County, Florida.

Project: The applicant applied to the Permitting Authority for an application for a Title V air operation permit revision and an application for an air construction permit revision to remove redundant Title V permit conditions and to clarify permit language. In addition, the applicant applied to the Permitting Authority for the renewal of the Title V Air Operation Permit for this facility.

Permitting Authority: Applications for Title V air operation permits are subject to review in accordance with the provisions of Chapter 403, Florida Statutes (F.S.) and Chapters 62-4, 62-210, and 62-213 and 62-214 of the Florida Administrative Code (F.A.C.). The proposed project is not exempt from air permitting requirements and an air permit is required to operate the facility. The FDEP Bureau of Air Regulation is the Permitting Authority responsible for making a permit determination regarding this project. The Permitting Authority's physical address is: FDEP Bureau of Air Regulation at 111 S. Magnolia, Suite 4, Tallahassee, FL 32301. The Permitting Authority's mailing address is: FDEP Bureau of Air Regulation, MS 5505, 2600 Blair Stone Road, Tallahassee, FL 32399-2400.. The Permitting Authority's telephone number is 850/488-0114 and facsimile 850/921-9533.

Project File: A complete project file is available for public inspection during the normal business hours of 8:00 a.m. to 5:00 p.m., Monday through Friday (except legal holidays), at address indicated above for the Permitting Authority. The complete project file includes the DRAFT Permit, the Statement of Basis, the application, and the information submitted by the applicant, exclusive of confidential records under Section 403.111, F.S. Interested persons may view the DRAFT Permits and file electronic comments by visiting the following website: <http://www.dep.state.fl.us/air/eproducts/ards/> . A copy of the complete project file is also available at the following offices:

FDEP Southwest District Office, 8407 Laurel Fair Circle, Tampa, FL 33610
(Telephone: 850/488-0114).

Environmental Protection Commission of Hillsborough County, 1410 North 21 Street, Tampa, FL 33605
(Telephone: 813/272-5605)

Notice of Intent to Issue A Permit: The Permitting Authority gives notice of its intent to issue permits to the applicant for the project described above. The applicant has provided reasonable assurance that operation of the facility will not adversely impact air quality and that the project will comply with all appropriate provisions of Chapters 62-4, 62-204, 62-210, 62-212, 62-213, 62-214, 62-256, 62-257, 62-281, 62-296, and 62-297, F.A.C. The Permitting Authority will issue a FINAL Air Construction Permit, a PROPOSED Title V Operation Permit and subsequent FINAL Title V Operation Permit in accordance with the conditions of the DRAFT Permits unless a response received in accordance with the following procedures results in a different decision or a significant change of terms or conditions.

Comments: The Permitting Authority will accept written comments concerning the DRAFT Permits for a period of thirty (30) days from the date of publication of this Public Notice. Written comments must be post-marked and all e-mail or facsimile comments must be received by the close of business (5 pm) on or before the end of this 30-day period by the Permitting Authority at the above address, email or facsimile. As part of his or her comments, any person may also request that the Permitting Authority hold a public meeting on this permitting action. If the Permitting Authority determines there is sufficient interest for a

(Public Notice to be Published in the Newspaper)

**PUBLIC NOTICE OF INTENT TO ISSUE AIR CONSTRUCTION PERMIT AND
TITLE V AIR OPERATION PERMIT**

public meeting, it will publish notice of the time, date, and location on the Department's official web site for notices at <http://tlhora6.dep.state.fl.us/onw> and in a newspaper of general circulation in the area affected by the permitting action. For additional information, contact the Permitting Authority at the above address or phone number. If written comments or comments received at a public meeting result in a significant change to the DRAFT Permits, the Permitting Authority shall issue Revised DRAFT Permits and require, if applicable, another Public Notice. All comments filed will be made available for public inspection.

Petitions: A person whose substantial interests are affected by the proposed permitting decision may petition for an administrative hearing in accordance with Sections 120.569 and 120.57, F.S. The petition must contain the information set forth below and must be filed with (received by) the Department's Agency Clerk in the Office of General Counsel of the Department of Environmental Protection at 3900 Commonwealth Boulevard, Mail Station #35, Tallahassee, Florida 32399-3000. Petitions filed by any persons other than those entitled to written notice under Section 120.60(3), F.S., must be filed within fourteen (14) days of publication of this Public Notice or receipt of a written notice, whichever occurs first. Under Section 120.60(3), F.S., however, any person who asked the Permitting Authority for notice of agency action may file a petition within fourteen (14) days of receipt of that notice, regardless of the date of publication. A petitioner shall mail a copy of the petition to the applicant at the address indicated above, at the time of filing. The failure of any person to file a petition within the appropriate time period shall constitute a waiver of that person's right to request an administrative determination (hearing) under Sections 120.569 and 120.57, F.S., or to intervene in this proceeding and participate as a party to it. Any subsequent intervention will be only at the approval of the presiding officer upon the filing of a motion in compliance with Rule 28-106.205, F.A.C.

A petition that disputes the material facts on which the Permitting Authority's action is based must contain the following information: (a) The name and address of each agency affected and each agency's file or identification number, if known; (b) The name, address and telephone number of the petitioner; the name address and telephone number of the petitioner's representative, if any, which shall be the address for service purposes during the course of the proceeding; and an explanation of how the petitioner's substantial rights will be affected by the agency determination; (c) A statement of how and when the petitioner received notice of the agency action or proposed action; (d) A statement of all disputed issues of material fact. If there are none, the petition must so state; (e) A concise statement of the ultimate facts alleged, including the specific facts the petitioner contends warrant reversal or modification of the agency's proposed action; (f) A statement of the specific rules or statutes the petitioner contends require reversal or modification of the agency's proposed action; and, (g) A statement of the relief sought by the petitioner, stating precisely the action the petitioner wishes the agency to take with respect to the agency's proposed action. A petition that does not dispute the material facts upon which the Permitting Authority's action is based shall state that no such facts are in dispute and otherwise shall contain the same information as set forth above, as required by Rule 28-106.301, F.A.C.

Because the administrative hearing process is designed to formulate final agency action, the filing of a petition means that the Permitting Authority's final action may be different from the position taken by it in this Public Notice of intent. Persons whose substantial interests will be affected by any such final decision of the Permitting Authority on the application have the right to petition to become a party to the proceeding, in accordance with the requirements set forth above.

Mediation: Mediation is not available for this proceeding.

Objections: In addition to the above right to petition, pursuant to 42 United States Code (U.S.C.) Section 7661d(b)(2), any person may petition the Administrator of the EPA within sixty (60) days of the expiration of the Administrator's 45 (forty-five) day review period as established at 42 U.S.C. Section 7661d(b)(1), to object to the issuance of any Title V air operation permit. Any petition shall be based only on objections to the Permit that were raised with reasonable specificity during the thirty (30) day public comment period provided in the Public Notice, unless the petitioner demonstrates to the

**PUBLIC NOTICE OF INTENT TO ISSUE AIR CONSTRUCTION PERMIT AND
TITLE V AIR OPERATION PERMIT**

Administrator of the EPA that it was impracticable to raise such objections within the comment period or unless the grounds for such objection arose after the comment period. Filing of a petition with the Administrator of the EPA does not stay the effective date of any permit properly issued pursuant to the provisions of Chapter 62-213, F.A.C. Petitions filed with the Administrator of EPA must meet the requirements of 42 U.S.C. Section 7661d(b)(2) and must be filed with the Administrator of the EPA at: U.S. EPA, 401 M Street, S.W., Washington, D.C. 20460. For more information regarding EPA review and objections, visit EPA's Region 4 web site at <http://www.epa.gov/region4/air/permits/Florida.htm>.

STATEMENT OF BASIS

Tampa Electric Company
Big Bend Station
Facility ID No.: 0570039
Hillsborough County

Title V Air Operation Permit Revision/Renewal
DRAFT Permit Project No.: 0570039-017-AV

The initial Title V Air Operation Permit No. 0570039-002-AV became final on December 28, 2000, and effective on January 1, 2001. Subsequently, Title V Air Operation Permits Nos. 0570039-010-AV and 0570039-013-AV revised the initial permit. This Title V Air Operation Permit Revision/Renewal is issued under the provisions of Chapter 403, Florida Statutes (F.S.), and Florida Administrative Code (F.A.C.) Chapters 62-4, 62-210, 62-213, and 62-214. The above named permittee is hereby authorized to perform the work or operate the facility shown on the application and approved drawing(s), plans, and other documents, attached hereto or on file with the permitting authority, in accordance with the terms and conditions of this permit.

The purpose of this permit is: to incorporate the changes approved in air construction permit 0570039-016-AC, which is simultaneously processed with this revision; to make some administrative corrections; and to revise the existing Title V permit.

TEC Big Bend is a nominal 2,028 MW electric generation facility. This facility consists of four steam boilers (Units Nos. 1 through 4); four steam turbines; three simple-cycle combustion turbines (CT Nos. 1, 2, and 3); solid fuels, fly ash, limestone, gypsum, slag, and bottom ash storage and handling facilities, and fuel oil storage tanks. Units No. 1, 2, 3, and 4 have nominal maximum heat inputs of 4037, 3996, 4115 and 4330 million BTU per hour, respectively. Units No. 1 through 4 are fired with coal and with petcoke in a mixture with coal up to 20.0% petcoke/80.0% coal (by weight), or a coal blended with coal residual generated from the Polk Power Station, or a coal/petroleum coke blend further blended with coal residual generated from the Polk Power Station. The combustion turbines are fired with No. 2 distillate fuel oil. In addition, there is a ship surface coating operation.

Also included in this permit are miscellaneous unregulated emissions units and insignificant emissions units and/or activities.

Based on the initial Title V permit application received June 14, 1996, and the renewal application received June 28, 2004, this facility is a major source of hazardous air pollutants (HAPs).

The following descriptions and conditions established in the initial Title V Air Operation Permit, No. 0570039-002-AV, and the previous Title V Air Operation Permit Revisions, Nos. 0570039-010-AV and 0570039-013-AV, are changed as follows. Additions are highlighted, and deletions are shown by ~~strikethroughs~~:

Table of Contents. [Pages renumbered.]

I. Subsection A. Facility Description. [Corrections to clarify the overview of the facility's operation have been made]:

Overview of the facility's operation:

Solid fuel is unloaded from ship/barge into the solid fuel yard, ~~the blending bins~~ or directly to the tripper room via belt conveyors. Solid fuel from the piles is loaded onto belt conveyors using a rail mounted or mobile reclaimer. The solid fuel is then belt conveyed to the blending ~~bins tower~~, which consists of six

storage bins, where the solid fuel may be blended for use at the plant, or transloaded into trucks for shipment off site. From the solid fuel yard conveyors, the solid fuel is screw conveyed into the bins. Particulate matter (PM) emissions from the conveyors in the solid fuel yard blending bins are controlled by 3-4 rotoclones, one at the conveyor drop and one for every 2 bins. PM emissions from the screw conveyor are controlled by the fourth rotoclone. Blending bins can either Each has 2 hoppers, which feed the transloader, or solid fuel can be are conveyed, via 2 parallel belts (T1, T2) to 2 crushers (each belt has a crusher), or diverted directly to the tripper room. PM emissions from the 2 crushers and transfer tower are controlled by 2 rotoclones.

From the tripper room solid fuel yard, the solid fuel is conveyed to the tripper room where 2 trippers bunker the solid fuels into 4 solid fuel bunkers. Each unit has its own respective bunker. Solid fuel samples are taken every 15 minutes during bunking, and composited for analysis. From the bunkers, the solid fuel is gravity fed into 14 crushers mills, and then gravity fed into the boilers. There are 3 ball mills tall crushers, each for Unit Nos. 1 – 3, and 5 bowl mills crushers for Unit No. 4. From the mills crushers, the solid fuel is pneumatically fed into classifiers, two for each mill on Unit Nos. 1-3 and one for each mill on Unit No. 4 crusher for a total of 23-8 classifiers, and then into the respective boiler. PM emissions from Boiler Nos. 1-4 are controlled by individual Electrostatic Precipitators (ESPs). Unit Nos. 1-4 PM emissions are controlled by an ESP, and the SO₂ emissions are controlled by an FGD scrubber systems. When Unit No. 1-3 burns petroleum coke, the exhaust gases, following particulate matter removal by the units' s ESPs, will be routed to the inlet of the Unit No. 4 flue gas desulfurization (FGD) system scrubber. In the this integrated mode, Unit No. 3 will meet the same sulfur dioxide emissions limitations as Unit No. 4. The FGD scrubber will continue to treat the exhaust gas from Unit No. 4. The FGD scrubber outlet stream, consisting of the combined Unit No. 3 and Unit No. 4 treated exhaust, will then be split and discharged through stacks CS002 and CS003.

Fly ash from Units No. 1 and No. 2 is vented into Fly Ash Silo #1 which is controlled by a baghouse. Fly ash from Unit No. 3 is vented into Silo #2, which can also receive fly ash from Units No. 1 and 2, while fly ash from Unit No. 4 is vented into Silo #3. The fly ash from each silo is then loaded into trucks and transported off site, while the bottom ash from Unit No. 4 is conveyed across Big Bend Road south of the Big Bend facility to a settling pond. Each fly ash silo is controlled by a baghouse.

The byproduct gypsum is conveyed to the east side of the plant for dewatering diverting and transporting off site. Limestone is unloaded to an underground hopper conveyor belt system to the limestone storage building on the east side of the by-product gypsum area. Particulate matter emissions from the limestone trucks unloading is controlled by a baghouse. From the storage building, limestone is belt conveyed into 2-3 storage silos and then gravity fed into the mill room. Two Three rotary mills grind the limestone and mix it with water to form a slurry that is stored in 2-3 storage tanks for use in the FGD. The slurry is then pumped to the 4 reaction tanks of Units 1-4 scrubbers that are located directly south of and adjacent to the absorption towers of the FGD scrubber. Gypsum is sold and transported offsite and can be stored south of Big Bend Road prior to offsite removal. Most of the by-product gypsum is wallboard grade, however, gypsum that is produced during start-up, shutdown or upset conditions is de-watered and belt conveyed across the street to the southeast of the plant for drying and transportation off site.

There are 3-combustion turbines (CT) manufactured by Westinghouse. They are all fired on No. 2 fuel oil. Unit CT No. 1 is near the plant and Unit CT Nos. 2 and 3 are on the north side of the property. There is a large No. 2 fuel oil storage tank near Unit CT Nos. 2 and 3 and a small day tank near Unit CT No. 1.

I. Subsection B.

- [Descriptions of Emissions Units 26 and 28 clarified as follows:]
 - 026 Fly Ash Handling and Storage Fugitive Emissions from Unit Nos. 1-3 (all except silos)
 - 028 Fly Ash Handling System Fugitive Emissions from Unit No. 4.

- [Unit No. 4 Coal Bunker, formerly included in Emission Unit 31, has been given its own identification of Emission Unit 39, for consistency with the coal bunkers for Units Nos. 13.]
~~039 Unit No. 4 Coal Bunker~~
- [Emissions Units 24 and 31 have been deleted. These emissions units are duplicates of emissions units already addressed in Emissions Units 20, 15, 16, 17, and newly created 39.]
~~-024 Limestone Handling Conveyor LE to South Storage Silo with Baghouse~~
~~-031 Cyclone collectors for bunkers (FH 059 through FH 062)~~

II.4. [Change of address]:

Prevention of Accidental Releases (Section 112(r) of CAA).

a. The permittee shall submit its Risk Management Plan (RMP) to the Chemical Emergency Preparedness and Prevention Office (CEPPO) RMP Reporting Center when, and if, such requirement becomes applicable. Any Risk Management Plans, original submittals, revisions or updates to submittals, should be sent to:

RMP Reporting Center
Post Office Box 3346
Merrifield, VA 22116-3346
Telephone: 703/816-4434
~~P.O. Box 1515~~
~~Lanham-Seabrook, Maryland 20703-1515~~
~~Telephone: 301/429-5018~~

and,

b. The permittee shall submit to the permitting authority Title V certification forms or a compliance schedule in accordance with Rule 62-213.440(2), F.A.C. [40 CFR 68]

III.A.2. [format change]:

b. Other operation:

~~i~~ In addition to the fuels allowed to be burned during normal operation, each unit may also burn new No. 2 fuel during startup, shutdown, flame stabilization, and during the start of a mill on an already operating unit.

~~ii~~ Evaporation of up to 150,000 gallons per year, total at the facility, is allowed of non-hazardous, but potentially HAP-emitting, mineral acid solution boiler chemical cleaning waste which was generated on site.

III.A.16. [Deletion of obsolete petcoke fuel sulfur content monitoring condition after 2005. SO₂ emissions are measured directly using continuous monitoring systems (CEMS), however, the permittee must submit on an annual basis through 2005, data demonstrating that removal of the sulfur content limit in the petroleum coke fired did not result in a significant increase in the representative actual annual emission of any regulated pollutant. (See Specific Condition III.A.2.)

Petcoke Sulfur Content: Until January 1, 2006 The owner or operator shall measure the sulfur content of representative samples of all petcoke received using appropriate ASTM methods to demonstrate compliance with the sulfur content limit of this permit. [Permit Nos. 0570039-003-AC & 0570039-004-AC]

III.A.26. [Deletion of obsolete petcoke fuel sulfur content recordkeeping condition after 2005. SO₂ emissions are measured directly using continuous monitoring systems (CEMS), however, the permittee must submit on an annual basis through 2005, data demonstrating that removal of the sulfur content limit in the petroleum coke fired did not result in a significant increase in the representative actual annual emission of any regulated pollutant. (See Specific Condition III.A.2.)

Records of Petcoke Sulfur Content: Until January 1, 2006 The owner or operator shall maintain records of petcoke sampling and analysis results performed as required by Specific Condition A.16. of this section. [Rule 62-4.070(3), F.A.C., and permit nos. 0570039-003-AC & 0570039-004-AC]

III.A.29. [Correction of typographical error]:

For Unit No. 3, gravimetric instrument data verifying that the 20.0% maximum petroleum coke content by weight has not been exceeded shall be maintained for two years and submitted to the Department and the EPCHC with each annual operating report. Also to be maintained and available for inspection shall be a record of operation showing the date, fuel used, mode of operation (integrated/non-integrated), and the duration of all startups, shutdowns and malfunctions.

[Rule 62-4.070(3), F.A.C.]

III.A.30. [Deletion of obsolete data reporting condition after 2005.]

~~Until January 1, 2006,~~ For Unit No. 3, TEC shall maintain and submit to the Department and the EPCHC on an annual basis ~~for a period of 5 years from the date the unit begins firing petroleum coke~~ data demonstrating that the operational change ~~of firing petcoke~~ did not result in an emissions increase.

[Rule 62-4.070(3), F.A.C.]

III.A.32. [Clarification.] Continuous Emission Monitoring Network and Alarms:

To demonstrate compliance with emission limits that are protective of AAQS, data inputs will consist of hourly CEM data from the SO₂, flow, and CO₂ monitors for Units 1-3 at Big Bend Station. TEC will use CEM data from common stack CS0W1 and/or CS001 to represent combined unit compliance with the emission limitations for each Unit 1 and Unit 2. When Unit 3 is operated in the integrated mode, TEC will use apportioned CEM data from both common stacks CS002 and CS003 to represent individual unit compliance with the emission limitations for Unit 3. In the event any monitor fails, TEC will comply with 40 CFR 75, Subpart D – Missing Data Substitution Procedures.

[Applicant request.]

~~III.A.34. These emissions units are subject to requirements contained in Consent Final Judgment (DEP vs. TEC) dated December 6, 1999 and the Consent Decree (U.S. vs. TEC) dated February 29, 2000, including the October 4, 2000 amendment.~~

~~[Permit No. 0570039-014-AC]~~

~~III.A.35. The first in a series of equipment installed pursuant to the Consent Final Judgment and Consent Decree for the purposes of NO_x requirements contained therein include:~~

- ~~a. Steam Generator Units No. 1 – 3 are equipped with Low NO_x burners (LNB).~~
- ~~b. Steam Generators Units 1 and 2 are equipped with coal and air flow monitoring equipment.~~
- ~~c. Steam Generator Unit 2 is equipped with a neural network system that monitors the following parameters: excess O₂ bias, force draft fan balance bias, mill outlet temperature bias, rating damper bias, and mill bypass damper bias.~~

~~[Permit No. 0570039-014-AC]~~

~~III.A.36. Units 1, 2, and 3 shall be operated using the Low NO_x burners and in accordance with the operational procedures that have been developed to minimize NO_x emissions.~~

~~[Permit No. 0570039-014-AC]~~

~~III.A.37. These emissions units are subject to the Compliance Assurance Monitoring requirements contained in the attached APPENDIX CAM.~~

III. Subsection B. Description. [Clarification added.]

As an option, Unit No. 3 exhaust gas, following particulate matter removal by the unit's ESP, will be routed to the inlet of the Unit No. 4 flue gas desulfurization (FGD) system scrubber. In this integrated mode, Unit No. 3 will meet the same sulfur dioxide emissions limitations as Unit No. 4. The FGD scrubber will continue to treat the exhaust gas from Unit No. 4. The FGD scrubber outlet stream, consisting of the combined Unit No. 3 and Unit No. 4 treated exhaust, will then be split and discharged through stacks CS002 and CS003. Stack CS002 does *not* include a recirculation duct to return exhaust gas to the inlet of

the FGD scrubber. Continuous opacity monitoring systems (COMS) will be located at the outlet of Unit No. 3 and Unit No. 4 ESPs. Continuous SO₂ and CO₂ emissions monitoring systems (CEMS) will be located in stacks CS002 and CS003. Continuous NO_x emissions monitoring systems (CEMS) will be located in the inlet ducts ~~of each unit~~. These monitoring systems will be used to determine compliance with all current applicable requirements.

III.B.2. Methods of Operation - Fuels. [Format change and clarification added to condition B.2.b.

Condition B.2.d. deleted per permit 0570039-016-AC; Coal washing requirement made redundant by inclusion of 90% SO₂ reduction requirement found in condition B.7.]

a. Normal operation: The fuel fired in Unit No. 4 shall consist of coal, or a coal/petroleum coke blend containing a maximum of 20% petroleum coke by weight, or coal blended with coal residual generated from the Polk Power Station, or a coal/petroleum coke blend further blended with coal residual generated from the Polk Power Station. In any case, the petroleum coke content of any fuel blend shall not exceed 20% by weight. The vanadium content of the petroleum coke fired shall not exceed 2660 ppm vanadium. The ash content of the petroleum coke fired shall not exceed 0.76% by weight on a dry basis. The permittee shall maintain and submit to the Department, and to the Environmental Protection Commission of Hillsborough County, on an annual basis for the years 2001, 2002, 2003, 2004, and 2005 data demonstrating that removal of the sulfur content limit and the revision of the vanadium content limit in the petroleum coke fired did not result in a significant increase in the representative actual annual emissions of any regulated pollutant.

b. Other operation:

~~i.~~ In addition to the fuels allowed to be burned during normal operation, Unit No. 4 may also burn new No. 2 fuel during startup, shutdown, flame stabilization and during the start of an additional solid fuel ~~mill pulverizer~~ on an already operating unit.

~~ii.~~ Evaporation of up to 150,000 gallons per year, total at the facility, is allowed of non-hazardous, but potentially HAP-emitting, mineral acid solution boiler chemical cleaning waste which was generated on site.

c. Coal shall not be burned in Unit No. 4 unless both the electrostatic precipitator and limestone scrubber are operating properly.

d. ~~[Reserved]~~ Coal burned in Unit No. 4 shall be washed before it is transported to the plant site. TEC shall maintain records of all coal washing and preparation activities for any coal which is to be fired in Big Bend Unit No. 4. These reports shall be submitted to the Department on a quarterly basis.

e. TEC shall maintain a daily log of the amounts and types of fuels used and copies of fuel analyses containing information on sulfur content, ash content and heating values.

f. Beneficiated, or refined, coal residual: The total amount of beneficiated, or refined, coal residual fired at Big Bend Station (all Unit Nos. 1-4 combined) shall be limited to 500 tons per day. The beneficiated, or refined, coal residual results from using the beneficiated process, described in permit application 0570039-012-AC, to wash and screen the raw coal residual to remove fines and oversized materials. This beneficiation process shall be performed at Polk Power Station, not Big Bend Station.

g. Raw coal residual: The total amount of raw coal residual fired at Big Bend Station (all Unit Nos. 1-4 combined) shall be limited to 200 tons per day. The raw coal residual is a by-product of the gasification of coal at the Polk Power Station. At the time of the issuance of permit 0570039-012-AC on October 4, 2001, there were approximately 100,000 tons of raw coal residual stored at Polk Power Station. Once this raw coal residual pile has been fired, TEC shall only fire raw coal residual in the event of a significant beneficiation process malfunction. TEC shall document all beneficiation process malfunctions and record the amount of raw coal residual, if any, fired at Big Bend Station. These records should be kept on site at Big Bend and made readily available to the Department and the Environmental Protection Commission of Hillsborough County upon request.

h. No coal residual shall be fired in any Unit when the corresponding scrubber is not in operation. [Rules 62-4.070(3), 62-4.160(2), 62-210.200, and 62-213.440(1), F.A.C.; PSD-FL-040; Power Plant Siting Certification PA 79-12; Permit No. 0570039-012-AC; ~~Permit No. 0570039-016-AC~~]

III. B. 12. [Correction to cross-reference.]

During emergency conditions in the principal company, an affected facility with a malfunctioning flue gas desulfurization system may be operated if sulfur dioxide emissions are minimized by:

- (1) Operating all operable flue gas desulfurization system modules, and bringing back into operation any malfunctioned module as soon as repairs are completed,
- (2) Bypassing flue gases around only those flue gas desulfurization system modules that have been taken out of operation because they were incapable of any sulfur dioxide emission reduction or which would have suffered significant physical damage if they had remained in operation, and
- (3) Operating a *spare* flue gas desulfurization system module. The Department or EPCHC may at their discretion require TEC within 60 days of notification to demonstrate spare module capability. To demonstrate this capability, the owner or operator must demonstrate compliance with the appropriate requirements of specific conditions ~~B.5. and B.7.~~ for any period of operation lasting from 24 hours to 30 days when:

- (i) Any one flue gas desulfurization module is not operated,
 - (ii) The affected facility is operating at the maximum heat input rate,
 - (iii) The fuel fired during the 24-hour to 30-day period is representative of the type and average sulfur content of fuel used over a typical 30-day period, and
 - (iv) TEC has given the Department or EPCHC at least 30 days notice of the date and period of time over which the demonstration will be performed.
- [Rule 62-204.800(7)(b)2., F.A.C.; 40 CFR 60.46a(d)]

III.B.19. [Clarifications to monitoring configuration.]

TEC shall calibrate, maintain, and operate a continuous monitoring system, and record the output of the system, for measuring the oxygen and/or carbon dioxide content of the flue gases at each location where sulfur dioxide or nitrogen oxides emissions are monitored. The sulfur dioxide, nitrogen dioxide, oxygen and/or carbon dioxide, and opacity monitoring devices shall meet the applicable requirements of Section 62-214, F.A.C., 40 CFR 60.47a., and 40 CFR 75.). The opacity monitor shall be placed in the duct work between the electrostatic precipitator and the FGD scrubber. ~~When Units 3 and 4 are operating in the integrated mode (Unit 3 flue gases routed through the Unit 4 FGD system),~~ The continuous monitoring system will measure sulfur dioxide emissions at the inlet of each unit and outlet of the Unit 4 FGD system and from the Unit 3 stack (CS002) and Unit 4 stack (CS003), while emissions of nitrogen oxides, oxygen and/or carbon dioxide, and opacity shall be measured in the Units 3 and 4 ducts prior to the FGD system. When Unit 4 is operating and Unit 3 is not operating in the integrated mode, the continuous monitoring system will measure only Unit 4's inlet duct and stack for SO₂ emissions. The emissions of nitrogen oxides and opacity shall be measured in the Unit 4 duct prior to the FGD system. The emissions of carbon dioxide and sulfur dioxide are both measured in the inlet and outlet ducts.

[Rule 62-204.800(7)(b)2., F.A.C.; 40 CFR 60.47a(d); Power Plant Siting Certification PA 79-12D]

III.B.28. [Applicant request to eliminate references to optional fuel pretreatment. Deleted per permit 0570039-016-AC]

TEC shall determine compliance with the SO₂ standards in specific condition B.7. as follows:

- (1) The percent of potential SO₂ emissions (%P_s) to the atmosphere shall be computed using the following equation:

$$\%P_s = \frac{(100 - \%R_f)(100 - \%R_g)}{100}$$

where:

- %P_s = percent of potential SO₂ emissions, percent.
%R_f = percent reduction from fuel pretreatment, percent.
%R_g = percent reduction by SO₂ control system, percent.

- (2) ~~[Reserved.] The procedures in Method 19 may be used to determine percent reduction (%R_f) of sulfur by such processes as fuel pretreatment (physical coal cleaning, hydrodesulfurization of fuel oil, etc.), coal pulverizers, and bottom and flyash interactions. This determination is optional.~~

(3) The procedures in Method 19 shall be used to determine the percent SO₂ reduction (%R_g of any SO₂ control system. Alternatively, a combination of an "as fired" fuel monitor and emission rates measured after the control system, following the procedures in Method 19, may be used if the percent reduction is calculated using the average emission rate from the SO₂ control device and the average SO₂ input rate from the "as fired" fuel analysis for 30 successive boiler operating days.

(4) The appropriate procedures in Method 19 shall be used to determine the emission rate.

(5) The continuous monitoring systems specified in conditions B.17. and B.19. shall be used to determine the concentrations of SO₂ and CO₂ or O₂.

[Rule 62-204.800(7)(b)2., F.A.C.; 40 CFR 60.48a (c); 40 CFR 60 43a; 40 CFR 60.47a(b) and (d); 40 CFR 60 Appendix A, Method 19; Applicant request; 0570039-016-AC]

B.35. [Coal washing requirement made redundant by inclusion of 90% SO₂ reduction requirement found in condition B.7. Applicant request to eliminate references to fuel pretreatment. Deleted per permit 0570039-016-AC]

[Reserved.] If fuel pretreatment credit is claimed toward the sulfur dioxide emission standards in specific condition B.7. TEC shall submit a signed statement:

—(1) Indicating what percentage cleaning credit was taken for the calendar quarter, and whether the credit was determined in accordance with the provisions of specific condition B.28. and Method 19 (Appendix A of 40 CFR 60); and

—(2) Listing the quantity, heat content, and date each pretreated fuel shipment was received during the previous quarter; the name and location of the fuel pretreatment facility; and the total quantity and total heat content of all fuels received at the affected facility during the previous quarter.

[Rule 62-204.800(7)(b)2., F.A.C.; 40 CFR 60.49a(e), 40 CFR 60.48a(c)]

III.B.66. These emissions units are subject to requirements contained in Consent Final Judgment (DEP vs. TEC) dated December 6, 1999 and the Consent Decree (U.S. vs. TEC) dated February 29, 2000, including the October 4, 2000 amendment.

[Permit No. 0570039-014-AC]

III.B.67. The first in a series of equipment installed pursuant to the Consent Final Judgment and Consent Decree for the purposes of NO_x requirements contained therein include:

a. Steam Generator Unit No. 4 is equipped with Low NO_x burners (LNB).

b. Steam Generator No. 4 is equipped with separate overfire air (SOFA).

[Permit No. 0570039-014-AC]

III.B.68. Unit 4 shall be operated using the Low NO_x burners and in accordance with the operational procedures that have been developed to minimize NO_x emissions.

[Permit No. 0570039-014-AC]

III.B.69. Unit 4 shall be operated using the Separate Overfire Air System (SOFA) and in accordance with the operational procedures that have been developed to minimize NO_x emissions.

[Permit No. 0570039-014-AC]

III.B.70. These emissions units are subject to the Compliance Assurance Monitoring requirements contained in the attached APPENDIX CAM.

III. Subsection D. Descriptions. [Clarifications to descriptions.]

Fly Ash Silo No. 2 handles fly ash from Steam Generator Units Nos. 1, 2, and/or 3. Fly ash is pneumatically conveyed in a series of pipes from the individual unit precipitators (Units 1, 2, and/or 3, only two units at any time) to the silo for temporary storage. Fly ash from Silo No. 2 is discharged in either a wet or dry state. From the silo, the dry fly ash is gravity fed by tubing into closed tanker trucks and transported to an off-site consumer. The wet fly ash is processed through a pugmill and then unloaded into a dump truck to be transported to an off-site consumer. Particulate emissions generated during silo loading

operation and from the tanker truck loadout chutes are controlled by a 20,081 DSCFM Flex Kleen, Model No. 84 UDTR-640 baghouse in addition to reasonable precautions.

III.D.1. [Reformatting of permitted loading rate language for Fly Ash Silo No. 2 to be consistent with the format with loading rate language for Fly Ash Silo No. 1. Also, permitting note deleted because operation during testing information already contained in condition D.1. and loading rate limits in federally enforceable construction permit.]

Capacity. The maximum permitted loading rate for all Fly Ash Silo No. 1 processes combined is 44.5 tons per hour. ~~The maximum permitted loading rate for all Fly Ash Silo No. 2 processes combined is 44.5 tons per hour.~~ For Fly Ash Silo No. 2, the maximum permitted loading rate is the simultaneous maximum transfer of flyash from boiler Units 1, 2, and 3. Separate testing of emissions from each unit shall be conducted with each emissions unit operation at 90 to 100 percent of the maximum permitted ~~capacity~~ heat input rate. If it is impractical to test at permitted capacity, an emissions unit may be tested at less than the ~~maximum~~ minimum permitted capacity; in this case, subsequent emissions unit operation is limited to 110 percent of the test ~~rate~~ load until a new test is conducted. Once the unit is so limited, operation at higher capacities is allowed for no more than 15 consecutive days for the purpose of additional compliance testing to regain the authority to operate at the permitted capacity.

[AC29-194516; AO29-161082; Rule 62-4.160(2), and Rule 62-297.310(2), F.A.C.]

~~{Permitting note: The material loading limitations have been placed in each permit to identify the capacity of each emissions unit for the purposes of confirming that emissions testing is conducted within 90 to 100 percent of the emissions unit's rated capacity (or to limit future operation to 110 percent of the test load), to establish appropriate emission limits and to aid in determining future rule applicability. Regular recordkeeping is not required for material loading. Instead the owner or operator is expected to determine material loading whenever the emission testing is required, to demonstrate at what percentage of the rated capacity that the emissions unit was tested. Rule 62-297.310(5), F.A.C., included in the permit, requires measurement of process variables for emission tests. Material loading demonstrations may be based on best engineering evaluation of the operating requirements necessary to achieve 90 to 100 percent of the rated loading, unless such operating conditions are otherwise specified by permit condition.}~~

III.D.10. [Applicant request to remove the word "completely" from condition III.D.10.d since the truck loading valve is not normally operated completely open.]

Compliance testing for the silo and tanker truck loading operations shall be conducted under the following conditions:

- a. All conveyance hoppers will be operational during the test.
- b. All fly ash will be directed to the silo, no reinjection of fly ash to the boiler systems will occur during the test.
- c. The boilers shall operate at the maximum capability of this unit under normal operating conditions during the test.
- d. Two tanker trucks shall be loaded during the test. The loading valve shall be ~~completely open to allow 90%-100% of the maximum loading rate during testing filling. The loading valve position shall be calibrated, and the position of the valve during testing shall be recorded~~
- e. The visible emission test shall be at least 30 minutes in duration and the period of time during which truck loading occurred indicated on the test report.

[Rules 62-4.070(3) and 62-297.310, F.A.C.]

III. Subsection E. Description. [Clarification of description.]

Fly Ash Silo No. 3 handles fly ash from Steam Generator Unit No. 4. Also, fly ash may be pneumatically conveyed from tanker trucks to Silo No. 3. Particulate matter emissions are controlled by a 1,200 DSCFM Flex Kleen Model 84-WRTC-80-II-G baghouse. The wet flyash ~~may be~~ is processed through a pugmill and then unloaded into a dump truck.

III. Subsection F. Limestone Handling and Storage [Revised per permit 0570039-016-AC.]
This section addresses the following Regulated Emissions Units:

<u>E.U. ID No.</u>	<u>Brief Description</u>
-011	Truck/Railcar Limestone Unloading Receiving Hopper with baghouse
-012	Limestone Silo A with 2 baghouses
-013	Limestone Silo B with 2 baghouses
-023	Limestone Handling Conveyor LB to Conveyor LC with baghouse, Limestone Handling Conveyor LD to Conveyor LE with baghouse
-024	Limestone Handling Conveyor LE to South Storage Silo with baghouse, Limestone Handling Conveyor LE to North Storage Silo with baghouse
-025	Limestone Storage and Handling Fugitive Emissions

Descriptions

~~Particulate matter emissions from the truck and railcar unloading of limestone are controlled by a Mikro Pulsaire Model 400S12TR baghouse. Particulate matter emissions generated by the transfer of limestone from Handling Conveyor LB to Conveyor LC are controlled by a Sternvent Model DKED18003 baghouse. Particulate matter emissions generated by the transfer of limestone from Handling Conveyor LD to Conveyor LE are controlled by a Sternvent Model DKED 18003 baghouse. Particulate matter emissions generated by the transfer of limestone from Handling Conveyor LE to the South Storage Silo are controlled by a Flex Kleen Model 58-BVBC-36-HG baghouse. Particulate matter emissions generated by the transfer of limestone from Handling Conveyor LE to the North Storage Silo are controlled by a Flex Kleen Model 58-BVBC-36-HG baghouse.~~

III. F.1. [Clarification of process.]

Total combined particulate matter emissions from the limestone handling hoppers/conveyors shall not exceed 0.65 lb/hr. Visible emissions are limited to 5% opacity. Compliance testing for particulate matter emissions is not required provided the opacity limit is maintained.
 [PSD-FL-040; Power Plant Siting Certification PA 79-12]

III.F.4. [Revised per permit 0570039-016-AC.]

The limestone handling receiving hopper, conveyor transfer points and silos shall be maintained at negative pressures with the exhaust vented to a control system(s).
 [PSD-FL-040]

Subsection G. Coal Bunkers with Roto-Clones [Removal of Unit No. 4 Coal Bunker from E.U. 031 to make new E.U. 039 for Unit No. 4 Coal Bunker for consistency with format for Unit 1-3 Coal Bunkers.]

This section addresses the following Regulated Emissions Units:

<u>E.U. ID No.</u>	<u>Brief Description</u>
-015	Unit No. 1 Coal Bunker with Roto-Clone
-016	Unit No. 2 Coal Bunker with Roto-Clone
-017	Unit No. 3 Coal Bunker with Roto-Clone
039	Unit No. 4 Coal Bunker with Roto-Clone

Descriptions

These emission units are Steam Generator Units Nos. 1- ~~43~~ Coal Bunkers with an exhaust fan/cyclone collector (Roto-Clone) controlling dust emission from each unit's respective bunker. Two moving transfer stations via their respective conveyor belts route coal through enclosed chutes to the various bunkers. Coal Bunkers 1- ~~43~~ are each equipped with a 9400 ACFM American Air Filter (AAF) Company Type D Roto-Clone to abate dust emissions during ventilation. A number of vent pipes convey fresh air from each bunker to a Roto-Clone during particulate matter removal. Particulate matter removed by the Roto-Clones

is returned to the coal bunkers via a hopper and return line. Unit No. 1 Coal Bunker is situated west of Unit No. 2 Coal Bunker. Unit No. 3 Coal Bunker is situated east of Unit No. 2 Coal Bunker. ~~Unit No. 4 Coal Bunker is located east of Unit No. 3.~~

III.G.4. [Equipment clarification.]

Since a source of less than 1 TPY is exempt from particulate matter RACT provisions, the maximum allowable particulate emissions shall not exceed 0.99 tons per year from each ~~rotoclone~~ cyclone exhaust. Also maximum allowable particulate matter emissions shall not exceed 0.48 lbs/hr from each cyclone exhaust.

[AO29-163788 to escape RACT]

Subsection H. Solid Fuel Yard [Deletion of redundant EU 031, and clarification of descriptions.]

This section addresses the following Regulated Emissions Units:

<u>E.U. ID No.</u>	<u>Brief Description</u>
-010	Solid Fuel Yard, Fugitive Emissions
-029	Cyclone collectors for fuel blending bins (FH-032 through FH-035)
-030	Cyclone collectors for fuel crushers (FH-048 and FH-049)
-031	Cyclone collectors for bunkers (FH-059 through FH-062)

Descriptions

Solid fuel is unloaded from ship/barge into the Solid fuel yard, ~~the blending bins~~ or directly to the tripper room via belt conveyors. Solid fuel from the piles is loaded onto belt conveyors using a rail mounted or mobile reclaimer. The solid fuel is then belt conveyed to the ~~blending bins tower~~, which consists of six storage bins, where the solid ~~fuel may be~~ is blended for use at the plant, or transloaded into trucks for shipment off site. ~~From the solid fuel yard conveyors, the solid fuel is screw conveyed into the bins.~~ Particulate matter (PM) emissions from the conveyors in the ~~blending bins solid fuel yard~~ are controlled by ~~3 4~~ ⁴ rotoclones, ~~one at the conveyor drop, and one for every 2 bins.~~ ^{PM emissions from the screw conveyor are controlled by the fourth rotoclone.} ~~Blending bins can either~~ Each has 2 hoppers, which feed the transloader, or ~~solid fuel can be~~ are conveyed, via 2 parallel belts (T1, T2) to 2 crushers (each belt has a crusher), or diverted directly to the tripper room. PM emissions from the 2 crushers and transfer tower are controlled by 2 rotoclones.

From the ~~tripper room~~ solid fuel yard, the solid fuel is conveyed to the tripper room where 2 trippers bunker the solid fuels into 4 solid fuel bunkers. Each unit has its own respective bunker. ~~Solid fuel samples are taken every 15 minutes during bunking, and composited for analysis.~~ From the bunkers, the solid fuel is gravity fed into 14 ~~mills~~ crushers, and then gravity-fed into the boilers. There are 3 ~~ball mills~~ tall crushers, each for Unit Nos. 1 – 3, and 5 bowl ~~mills~~ crushers for Unit No. 4. From the ~~mills~~ crushers, the solid fuel is pneumatically fed into classifiers, two for each crusher ~~mill on Unit Nos. 1-3 and one for each mill on Unit No. 4~~ for a total of ~~238~~ classifiers, and then into the respective boilers.

IV. Updates were made to the Phase II Acid Rain Part.

TECHNICAL EVALUATION AND PRELIMINARY DETERMINATION

1.0 APPLICATION INFORMATION

1.1 Applicant Name and Address

Tampa Electric Company
P.O. Box 111
Tampa, Florida 33601-0111

Representative:
Ms. Karen Sheffield
General Manager
Big Bend Station

1.2 Reviewing and Process Schedule

05-18-04: Date of receipt of request at FDEP Bureau of Air Regulation
05-18-04 Application deemed complete
08-xx-04: Issued intent

2.0 FACILITY INFORMATION

2.1 Facility Location: Big Bend Station located at Big Bend Road, North Ruskin, Hillsborough County

2.2 Standard Industrial Classification Code (SIC)

Major Group No.	49	Electric, Gas, and Sanitary Services
Group No.	491	Electric Services
Industry No.	4911	Electric Services

2.3 Existing Facility/Emission Unit Description

This facility is an electric utility.
TEC Big Bend is a nominal 2,028 MW electric generation facility. This facility consists of four steam boilers (Units Nos. 1 through 4); four steam turbines; three simple-cycle combustion turbines (CT Nos. 1, 2, and 3); solid fuels, fly ash, limestone, gypsum, slag, and bottom ash storage and handling facilities, and fuel oil storage tanks. Units No. 1, 2, 3, and 4 have nominal maximum heat inputs of 4037, 3996, 4115 and 4330 million BTU per hour, respectively. Units No. 1 through 4 are fired with coal and with petcoke in a mixture with coal up to 20.0% petcoke/80.0% coal (by weight), or a coal blended with coal residual generated from the Polk Power Station, or a coal/petroleum coke blend further blended with coal residual generated from the Polk Power Station. The combustion turbines are fired with No. 2 distillate fuel oil. In addition, there is a ship surface coating operation.

2.4 Regulatory Classification

The facility is classified as a major Title V source of air pollution because emissions of at least one regulated air pollutant, such as sulfur dioxide, exceed 100 tons per year.

3. PERMITTING STATUS

This facility is currently operating under Title V Operation Permit 0570039-013-AV. This Construction Permit 0570039-016-AC is being concurrently processed with Title V Operation Permit Revision 0570039-015-AV.

4. **PRESENT APPLICATION AND DEPARTMENT PROPOSED ACTIONS**

Tampa Electric Company (TEC) has requested to establish the deletion of redundant conditions and the clarification of process descriptions and conditions as applicable Title V Operation Permit descriptions and conditions.

The following descriptions and conditions established in the initial Title V Air Operation Permit, No. 0570039-002-AV, and the previous Title V Air Operation Permit Revisions, Nos. 0570039-010-AV and 0570039-013-AV, are proposed to be changed as follows. Additions are highlighted, and deletions are shown by strikethroughs. Justifications for changes are provided in [brackets].

I. Subsection A. Facility Description. [Corrections to clarify the overview of the facility's operation have been made]:

Overview of the facility's operation:

Solid fuel is unloaded from ship/barge into the solid fuel yard, ~~the blending bins~~ or directly to the tripper room via belt conveyors. Solid fuel from the piles is loaded onto belt conveyors using a rail mounted or mobile reclaimer. The solid fuel is then belt conveyed to the blending ~~bins tower~~, which consists of six storage bins, where the solid ~~fuel may be~~ is blended for use at the plant, or transloaded into trucks for shipment off site. ~~From the solid fuel yard conveyors, the solid fuel is screw conveyed into the bins.~~ Particulate matter (PM) emissions from the conveyors in the solid fuel yard ~~blending bins~~ are controlled by 3 ~~4~~ rotocones, ~~one at the conveyor drop and one for every 2 bins.~~ PM emissions from the screw conveyor ~~are controlled by the fourth rotocone.~~ ~~Blending bins can either~~ Each has 2 hoppers, which feed the transloader, or ~~solid fuel can be~~ are conveyed, via 2 parallel belts (T1, T2) to 2 crushers (each belt has a crusher), or diverted directly to the tripper room. PM emissions from the 2 crushers and transfer tower are controlled by 2 rotocones.

From the ~~tripper room solid fuel yard, the solid fuel is conveyed to the tripper room where~~ 2 trippers bunker the solid fuels into 4 solid fuel bunkers. Each unit has its own respective bunker. ~~Solid fuel samples are taken every 15 minutes during bunking, and composited for analysis.~~ From the bunkers, the solid fuel is gravity fed into 14 ~~crushers mills~~, and then gravity fed into the boilers. There are 3 ~~ball mills tall crushers~~, each for Unit Nos. 1 – 3, and 5 bowl ~~mills crushers~~ for Unit No. 4. From the ~~mills crushers~~, the solid fuel is pneumatically fed into classifiers, two for each ~~mill on Unit Nos. 1-3 and one for each mill on Unit No. 4 crusher~~ for a total of 23 ~~8~~ classifiers, and then into the respective boilers.

PM emissions from Boiler Nos. 1- ~~4~~3 are controlled by individual Electrostatic Precipitators (ESPs). Unit Nos. ~~1- 4~~ PM emissions are controlled by an ESP, and the SO₂ emissions are controlled by an FGD scrubber systems. When Unit Nos. ~~1-3~~ burns petroleum coke, the exhaust gases, following particulate matter removal by the units' s ESPs, will be routed to the inlet of the Unit No. 4 flue gas desulfurization (FGD) system scrubber. In ~~the this~~ integrated mode, Unit No. 3 will meet the same sulfur dioxide emissions limitations as Unit No. 4. The FGD scrubber will continue to treat the exhaust gas from Unit No. 4. The FGD scrubber outlet stream, consisting of the combined Unit No. 3 and Unit No. 4 treated exhaust, will then be split and discharged through stacks CS002 and CS003.

Fly ash from Units No. 1 and No. 2 is vented into Fly Ash Silo #1 which is controlled by a baghouse. Fly ash from Unit No. 3 is vented into Silo #2, ~~which can also receive fly ash from Units No. 1 and 2 while~~ fly ash from Unit No. 4 is vented into Silo #3. The fly ash from each silo is then loaded into trucks and transported off site, while the bottom ash from Unit No. 4 is conveyed across Big Bend Road south of the Big Bend facility to a settling pond. ~~Each fly ash silo is controlled by a baghouse.~~

The byproduct gypsum is conveyed to the east side of the plant for ~~dewatering diverting~~ and transporting off site. Limestone is unloaded to an underground hopper conveyor belt system to the limestone storage

building on the east side of the by-product gypsum area. ~~Particulate matter emissions from the limestone trucks unloading is controlled by a baghouse.~~ From the storage building, limestone is belt conveyed into 2 ~~3~~ storage silos and then gravity fed into the mill room. ~~Two~~ ~~Three~~ rotary mills grind the limestone and mix it with water to form a slurry that is stored in 2 ~~3~~ storage tanks for use in the FGD. The slurry is then pumped to the 4 reaction tanks ~~of Units 1-4 scrubbers~~ that are located directly south of and adjacent to the absorption towers of the FGD scrubber. ~~Gypsum is sold and transported offsite and can be stored south of Big Bend Road prior to offsite removal.~~ Most of the by-product gypsum is wallboard grade, however, gypsum that is produced during start-up, shutdown or upset conditions is de-watered and belt conveyed across the street to the southeast of the plant for drying and transportation off-site.

There are 3-combustion turbines (~~CT~~) manufactured by Westinghouse. They are all fired on No. 2 fuel oil. ~~Unit CT~~ No. 1 is near the plant and ~~Unit CT~~ Nos. 2 and 3 are on the north side of the property. There is a large No. 2 fuel oil storage tank near ~~Unit CT~~ Nos. 2 and 3 and a small day tank near ~~Unit CT~~ No. 1.

I. Subsection B.

- [Descriptions of Emissions Units 26 and 28 clarified as follows:]
 - 026 Fly Ash Handling and Storage Fugitive Emissions ~~from Unit Nos. 1-3~~ (all except silos)
 - 028 Fly Ash Handling System Fugitive Emissions ~~from Unit No. 4.~~
- [Unit No. 4 Coal Bunker, formerly included in Emission Unit 31, has been given its own identification of Emission Unit 39, for consistency with the coal bunkers for Units Nos. 1-3.]
~~039: Unit No. 4 Coal Bunker~~
- [Emissions Units 24 and 31 have been deleted. These emissions units are duplicates of emissions units already addressed in Emissions Units 20, 15, 16, 17, and newly created 39.]
 - 024 Limestone Handling Conveyor LE to South Storage Silo with Baghouse
 - 031 Cyclone collectors for bunkers (FH 059 through FH 062)

II.4. [Change of address]:

Prevention of Accidental Releases (Section 112(r) of CAA).

a. The permittee shall submit its Risk Management Plan (RMP) to the Chemical Emergency Preparedness and Prevention Office (CEPPO) RMP Reporting Center when, and if, such requirement becomes applicable. Any Risk Management Plans, original submittals, revisions or updates to submittals, should be sent to:

RMP Reporting Center
Post Office Box 3346
Merrifield, VA 22116-3346
Telephone: 703/816-4434
P.O. Box 1515

Lanham-Seabrook, Maryland 20703-1515
Telephone: 301/429-5018

and,

b. The permittee shall submit to the permitting authority Title V certification forms or a compliance schedule in accordance with Rule 62-213.440(2), F.A.C. [40 CFR 68]

III.A.2. [format change]:

b. Other operation:

i In addition to the fuels allowed to be burned during normal operation, each unit may also burn new No. 2 fuel during startup, shutdown, flame stabilization, and during the start of a mill on an already operating unit.

ii Evaporation of up to 150,000 gallons per year, total at the facility, is allowed of non-hazardous, but potentially HAP-emitting, mineral acid solution boiler chemical cleaning waste which was generated on site.

III.A.16. [Deletion of obsolete petcoke fuel sulfur content monitoring condition after 2005. SO₂ emissions are measured directly using continuous monitoring systems (CEMS), however, the permittee must submit on an annual basis through 2005, data demonstrating that removal of the sulfur content limit in the petroleum coke fired did not result in a significant increase in the representative actual annual emission of any regulated pollutant. (See Specific Condition III.A.2.)]

Petcoke Sulfur Content: ~~Until January 1, 2006,~~ The owner or operator shall measure the sulfur content of representative samples of all petcoke received using appropriate ASTM methods to demonstrate compliance with the sulfur content limit of this permit. [Permit Nos. 0570039-003-AC & 0570039-004-AC]

III.A.26. [Deletion of obsolete petcoke fuel sulfur content recordkeeping condition after 2005. SO₂ emissions are measured directly using continuous monitoring systems (CEMS), however, the permittee must submit on an annual basis through 2005, data demonstrating that removal of the sulfur content limit in the petroleum coke fired did not result in a significant increase in the representative actual annual emission of any regulated pollutant. (See Specific Condition III.A.2.)]

Records of Petcoke Sulfur Content: ~~Until January 1, 2006,~~ The owner or operator shall maintain records of petcoke sampling and analysis results performed as required by Specific Condition A.16. of this section. [Rule 62-4.070(3), F.A.C., and permit nos. 0570039-003-AC & 0570039-004-AC]

III.A.29. [Correction of typographical error]:

For Unit No. ~~1-3,~~ gravimetric instrument data verifying that the 20.0% maximum petroleum coke content by weight has not been exceeded shall be maintained for two years and submitted to the Department and the EPCHC with each annual operating report. Also to be maintained and available for inspection shall be a record of operation showing the date, fuel used, mode of operation (integrated/non-integrated), and the duration of all startups, shutdowns and malfunctions. [Rule 62-4.070(3), F.A.C.]

III.A.30. [Deletion of obsolete data reporting condition after 2005.]

~~Until January 1, 2006,~~ For Unit No. 3, TEC shall maintain and submit to the Department and the EPCHC on an annual basis for a period of 5 years from the date the unit begins firing petroleum coke, data demonstrating that the operational change ~~of firing petcoke~~ did not result in an emissions increase. [Rule 62-4.070(3), F.A.C.]

III. Subsection B. Description. [Clarification added.]

As an option, Unit No. 3 exhaust gas, following particulate matter removal by the unit's ESP, will be routed to the inlet of the Unit No. 4 flue gas desulfurization (FGD) system scrubber. In this integrated mode, Unit No. 3 will meet the same sulfur dioxide emissions limitations as Unit No. 4. The FGD scrubber will continue to treat the exhaust gas from Unit No. 4. The FGD scrubber outlet stream, consisting of the combined Unit No. 3 and Unit No. 4 treated exhaust, will then be split and discharged through stacks CS002 and CS003. Stack CS002 does *not* include a recirculation duct to return exhaust gas to the inlet of the FGD scrubber. Continuous opacity monitoring systems (COMS) will be located at the outlet of Unit No. 3 and Unit No. 4 ESPs. Continuous SO₂ and CO₂ emissions monitoring systems (CEMS) will be located in stacks CS002 and CS003. Continuous NO_x emissions monitoring systems (CEMS) will be located in the inlet ducts of each unit. These monitoring systems will be used to determine compliance with all current applicable requirements.

III.B.2. Methods of Operation - Fuels. [Format change and clarification added to condition B.2.b.; Coal washing requirement, Condition B.2.d, made redundant by inclusion of 90% SO₂ reduction requirement found in Condition B.7.]

a. Normal operation: The fuel fired in Unit No. 4 shall consist of coal, or a coal/petroleum coke blend containing a maximum of 20% petroleum coke by weight, or coal blended with coal residual

generated from the Polk Power Station, or a coal/petroleum coke blend further blended with coal residual generated from the Polk Power Station. In any case, the petroleum coke content of any fuel blend shall not exceed 20% by weight. The vanadium content of the petroleum coke fired shall not exceed 2660 ppm vanadium. The ash content of the petroleum coke fired shall not exceed 0.76% by weight on a dry basis. The permittee shall maintain and submit to the Department, and to the Environmental Protection Commission of Hillsborough County, on an annual basis for the years 2001, 2002, 2003, 2004, and 2005 data demonstrating that removal of the sulfur content limit and the revision of the vanadium content limit in the petroleum coke fired did not result in a significant increase in the representative actual annual emissions of any regulated pollutant.

b. Other operation:

~~ii~~ In addition to the fuels allowed to be burned during normal operation, Unit No. 4 may also burn new No. 2 fuel during startup, shutdown, flame stabilization and during the start of an additional solid fuel mill pulverizer on an already operating unit.

~~iii~~ Evaporation of up to 150,000 gallons per year, total at the facility, is allowed of non-hazardous, but potentially HAP-emitting, mineral acid solution boiler chemical cleaning waste which was generated on site.

c. Coal shall not be burned in Unit No. 4 unless both the electrostatic precipitator and limestone scrubber are operating properly.

d. ~~[Reserved] Coal burned in Unit No. 4 shall be washed before it is transported to the plant site. TEC shall maintain records of all coal washing and preparation activities for any coal which is to be fired in Big Bend Unit No. 4. These reports shall be submitted to the Department on a quarterly basis.~~

e. TEC shall maintain a daily log of the amounts and types of fuels used and copies of fuel analyses containing information on sulfur content, ash content and heating values.

f. Beneficiated, or refined, coal residual: The total amount of beneficiated, or refined, coal residual fired at Big Bend Station (all Unit Nos. 1-4 combined) shall be limited to 500 tons per day. The beneficiated, or refined, coal residual results from using the beneficiated process, described in permit application 0570039-012-AC, to wash and screen the raw coal residual to remove fines and oversized materials. This beneficiation process shall be performed at Polk Power Station, not Big Bend Station.

g. Raw coal residual: The total amount of raw coal residual fired at Big Bend Station (all Unit Nos. 1-4 combined) shall be limited to 200 tons per day. The raw coal residual is a by-product of the gasification of coal at the Polk Power Station. At the time of the issuance of permit 0570039-012-AC on October 4, 2001, there were approximately 100,000 tons of raw coal residual stored at Polk Power Station. Once this raw coal residual pile has been fired, TEC shall only fire raw coal residual in the event of a significant beneficiation process malfunction. TEC shall document all beneficiation process malfunctions and record the amount of raw coal residual, if any, fired at Big Bend Station. These records should be kept on site at Big Bend and made readily available to the Department and the Environmental Protection Commission of Hillsborough County upon request.

h. No coal residual shall be fired in any Unit when the corresponding scrubber is not in operation. [Rules 62-4.070(3), 62-4.160(2), 62-210.200, and 62-213.440(1), F.A.C.; PSD-FL-040; Power Plant Siting Certification PA 79-12; Permit No. 0570039-012-AC]

III. B. 12. [Correction to cross-reference.]

During emergency conditions in the principal company, an affected facility with a malfunctioning flue gas desulfurization system may be operated if sulfur dioxide emissions are minimized by:

(1) Operating all operable flue gas desulfurization system modules, and bringing back into operation any malfunctioned module as soon as repairs are completed,

(2) Bypassing flue gases around only those flue gas desulfurization system modules that have been taken out of operation because they were incapable of any sulfur dioxide emission reduction or which would have suffered significant physical damage if they had remained in operation, and

(3) Operating a *spare* flue gas desulfurization system module. The Department or EPCHC may at their discretion require TEC within 60 days of notification to demonstrate spare module capability. To demonstrate this capability, the owner or operator must demonstrate compliance with the appropriate requirements of specific conditions ~~B.5. and B.7.~~ for any period of operation lasting from 24 hours to 30 days when:

- (i) Any one flue gas desulfurization module is not operated,
 - (ii) The affected facility is operating at the maximum heat input rate,
 - (iii) The fuel fired during the 24-hour to 30-day period is representative of the type and average sulfur content of fuel used over a typical 30-day period, and
 - (iv) TEC has given the Department or EPCHC at least 30 days notice of the date and period of time over which the demonstration will be performed.
- [Rule 62-204.800(7)(b)2., F.A.C.; 40 CFR 60.46a(d)]

III.B.19. [Clarifications to monitoring configuration.]

TEC shall calibrate, maintain, and operate a continuous monitoring system, and record the output of the system, for measuring the oxygen and/or carbon dioxide content of the flue gases at each location where sulfur dioxide or nitrogen oxides emissions are monitored. The sulfur dioxide, nitrogen dioxide, oxygen and/or carbon dioxide, and opacity monitoring devices shall meet the applicable requirements of Section 62-214, F.A.C., 40 CFR 60.47a., and 40 CFR 75.). The opacity monitor shall be placed in the duct work between the electrostatic precipitator and the FGD scrubber. ~~When Units 3 and 4 are operating in the integrated mode (Unit 3 flue gases routed through the Unit 4 FGD system),~~ The continuous monitoring system will measure sulfur dioxide emissions at the inlet of each unit and outlet of the Unit 4 FGD system and from the Unit 3 stack (CS002) and Unit 4 stack (CS003), while emissions of nitrogen oxides, oxygen and/or carbon dioxide, and opacity shall be measured in the Units 3 and 4 ducts prior to the FGD system. When Unit 4 is operating and Unit 3 is not operating in the integrated mode, the continuous monitoring system will measure only Unit 4's inlet duct and stack for SO₂ emissions. The emissions of nitrogen oxides and opacity shall be measured in the Unit 4 duct prior to the FGD system. The emissions of carbon dioxide and sulfur dioxide are both measured in the inlet and outlet ducts.

[Rule 62-204.800(7)(b)2., F.A.C.; 40 CFR 60.47a(d); Power Plant Siting Certification PA 79-12D]

III.B.28. [Applicant request to eliminate references to optional fuel pretreatment.]

TEC shall determine compliance with the SO₂ standards in specific condition B.7. as follows:

- (1) The percent of potential SO₂ emissions (%P_s) to the atmosphere shall be computed using the following equation:

$$\%P_s = \frac{(100 - \%R_f)(100 - \%R_g)}{100}$$

where:

- %P_s = percent of potential SO₂ emissions, percent.
- %R_f = percent reduction from fuel pretreatment, percent.
- %R_g = percent reduction by SO₂ control system, percent.

- (2) ~~[Reserved.] The procedures in Method 19 may be used to determine percent reduction (%R_f) of sulfur by such processes as fuel pretreatment (physical coal cleaning, hydrodesulfurization of fuel oil, etc.), coal pulverizers, and bottom and flyash interactions. This determination is optional.~~

(3) The procedures in Method 19 shall be used to determine the percent SO₂ reduction (%R_g) of any SO₂ control system. Alternatively, a combination of an "as fired" fuel monitor and emission rates measured after the control system, following the procedures in Method 19, may be used if the percent reduction is calculated using the average emission rate from the SO₂ control device and the average SO₂ input rate from the "as fired" fuel analysis for 30 successive boiler operating days.

(4) The appropriate procedures in Method 19 shall be used to determine the emission rate.

(5) The continuous monitoring systems specified in conditions B.17. and B.19. shall be used to determine the concentrations of SO₂ and CO₂ or O₂.

[Rule 62-204.800(7)(b)2., F.A.C.; 40 CFR 60.48a (c); 40 CFR 60 43a; 40 CFR 60.47a(b) and (d); 40 CFR 60 Appendix A, Method 19; ~~Applicant request~~]

B.35. [Coal washing requirement made redundant by inclusion of 90% SO₂ reduction requirement found in condition B.7. Applicant request to eliminate references to fuel pretreatment. Deleted per permit 0570039-016-AC]

[Reserved.] If fuel pretreatment credit is claimed toward the sulfur dioxide emission standards in specific condition B.7, TEC shall submit a signed statement:

—(1) Indicating what percentage cleaning credit was taken for the calendar quarter, and whether the credit was determined in accordance with the provisions of specific condition B.28. and Method 19 (Appendix A of 40 CFR 60); and

—(2) Listing the quantity, heat content, and date each pretreated fuel shipment was received during the previous quarter; the name and location of the fuel pretreatment facility; and the total quantity and total heat content of all fuels received at the affected facility during the previous quarter.

[Rule 62-204.800(7)(b)2., F.A.C.; 40 CFR 60.49a(e), 40 CFR 60.48a(e)]

III. Subsection D. Descriptions. [Clarifications to descriptions.]

Fly Ash Silo No. 2 handles fly ash from Steam Generator Units Nos. 1, 2, and/or 3. Fly ash is pneumatically conveyed in a series of pipes from the individual unit precipitators (Units 1, 2, and/or 3, only two units at any time) to the silo for temporary storage. Fly ash from Silo No. 2 is discharged in either a wet or dry state. From the silo, the dry fly ash is gravity fed by tubing into closed tanker trucks and transported to an off-site consumer. The wet fly ash is processed through a pugmill and then unloaded into a dump truck to be transported to an off-site consumer. Particulate emissions generated during silo loading operation and from the tanker truck loadout chutes are controlled by a 20,081 DSCFM Flex Kleen, Model No. 84 UDTR-640 baghouse in addition to reasonable precautions.

III.D.1. [Reformatting of permitted loading rate language for Fly Ash Silo No. 2 to be consistent with the format with loading rate language for Fly Ash Silo No. 1. Also, permitting note deleted because operation during testing information already contained in condition D.1. and loading rate limits in federally enforceable construction permit.]

Capacity. The maximum permitted loading rate for all Fly Ash Silo No. 1 processes combined is 44.5 tons per hour. The maximum permitted loading rate for all Fly Ash Silo No. 2 processes combined is 44.5 tons per hour. For Fly Ash Silo No. 2, the maximum permitted loading rate is the simultaneous maximum transfer of flyash from boiler Units 1, 2, and 3. Separate testing of emissions from each unit shall be conducted with each emissions unit operation at 90 to 100 percent of the maximum permitted capacity, heat input rate. If it is impractical to test at permitted capacity, an emissions unit may be tested at less than the maximum minimum permitted capacity; in this case, subsequent emissions unit operation is limited to 110 percent of the test rate load until a new test is conducted. Once the unit is so limited, operation at higher capacities is allowed for no more than 15 consecutive days for the purpose of additional compliance testing to regain the authority to operate at the permitted capacity.

[AC29-194516; AO29-161082; Rule 62-4.160(2), and Rule 62-297.310(2), F.A.C.]

~~{Permitting note: The material loading limitations have been placed in each permit to identify the capacity of each emissions unit for the purposes of confirming that emissions testing is conducted within 90 to 100 percent of the emissions unit's rated capacity (or to limit future operation to 110 percent of the test load), to establish appropriate emission limits and to aid in determining future rule applicability. Regular recordkeeping is not required for material loading. Instead the owner or operator is expected to determine material loading whenever the emission testing is required, to demonstrate at what percentage of the rated capacity that the emissions unit was tested. Rule 62-297.310(5), F.A.C., included in the permit, requires measurement of process variables for emission tests. Material loading demonstrations may be based on best engineering evaluation of the operating requirements necessary to achieve 90 to 100 percent of the rated loading, unless such operating conditions are otherwise specified by permit condition.}~~

III.D.10. [Applicant request to remove the word "completely" from condition III.D.10.d since the truck loading valve is not normally operated completely open.]

Compliance testing for the silo and tanker truck loading operations shall be conducted under the following conditions:

a. All conveyance hoppers will be operational during the test.

- b. All fly ash will be directed to the silo, no reinjection of fly ash to the boiler systems will occur during the test.
 - c. The boilers shall operate at the maximum capability of this unit under normal operating conditions during the test.
 - d. Two tanker trucks shall be loaded during the test. The loading valve shall be completely open to allow 90%-100% of the maximum loading rate during testing filling. The loading valve position shall be calibrated, and the position of the valve during testing shall be recorded.
 - e. The visible emission test shall be at least 30 minutes in duration and the period of time during which truck loading occurred indicated on the test report.
- [Rules 62-4.070(3) and 62-297.310, F.A.C.]

III. Subsection E. Description. [Clarification of description.]

Fly Ash Silo No. 3 handles fly ash from Steam Generator Unit No. 4. Also, fly ash may be pneumatically conveyed from tanker trucks to Silo No. 3. Particulate matter emissions are controlled by a 1,200 DSCFM Flex Kleen Model 84-WRTC-80-II-G baghouse. The wet flyash may be processed through a pugmill and then unloaded into a dump truck.

III. Subsection F. Limestone Handling and Storage [Reference to railcar unloading deleted because limestone is no longer received by railcar. Receiving hopper baghouse requirement deleted because the limestone has a high moisture content (average moisture content of 12.4 wt. %) and therefore the limestone truck unloading process generates insignificant amounts of fugitive particulate matter emissions. Limestone truck unloading potential emission rates, using AP-42 procedures, are estimated to total 0.12 and 0.06 tons per year for PM and PM₁₀ respectively. Since the existing baghouse is prone to high maintenance, and is not needed to meet current Title V operation permit limits, the permittee has requested to remove of this baghouse.]

This section addresses the following Regulated Emissions Units:

<u>E.U. ID No.</u>	<u>Brief Description</u>
-011	Truck/Railcar Limestone Unloading Receiving Hopper with baghouse
-012	Limestone Silo A with 2 baghouses
-013	Limestone Silo B with 2 baghouses
-023	Limestone Handling Conveyor LB to Conveyor LC with baghouse, Limestone Handling Conveyor LD to Conveyor LE with baghouse
-024	Limestone Handling Conveyor LE to South Storage Silo with baghouse, Limestone Handling Conveyor LE to North Storage Silo with baghouse
-025	Limestone Storage and Handling Fugitive Emissions

Descriptions

Particulate matter emissions from the truck and railcar unloading of limestone are controlled by a Mikro-Pulsaire Model 400S12TR baghouse. Particulate matter emissions generated by the transfer of limestone from Handling Conveyor LB to Conveyor LC are controlled by a Sternvent Model DKED18003 baghouse. Particulate matter emissions generated by the transfer of limestone from Handling Conveyor LD to Conveyor LE are controlled by a Sternvent Model DKED 18003 baghouse. Particulate matter emissions generated by the transfer of limestone from Handling Conveyor LE to the South Storage Silo are controlled by a Flex Kleen Model 58-BVBC-36-HG baghouse. Particulate matter emissions generated by the transfer of limestone from Handling Conveyor LE to the North Storage Silo are controlled by a Flex Kleen Model 58-BVBC-36-HG baghouse.

III. F.1. [Clarification of process.]

Total combined particulate matter emissions from the limestone handling hoppers/conveyors shall not exceed 0.65 lb/hr. Visible emissions are limited to 5% opacity. Compliance testing for particulate matter emissions is not required provided the opacity limit is maintained.
[PSD-FL-040; Power Plant Siting Certification PA 79-12]

III.F.4. [Receiving hopper baghouse requirement deleted because the limestone has a high moisture content.]

The limestone handling ~~receiving hopper~~, conveyor transfer points and silos shall be maintained at negative pressures with the exhaust vented to a control system(s).

[PSD-FL-040]

Subsection G. Coal Bunkers with Roto-Clones [Removal of Unit No. 4 Coal Bunker from E.U. 031 to make new E.U. 039 for Unit No. 4 Coal Bunker for consistency with format for Unit 1-3 Coal Bunkers.]

This section addresses the following Regulated Emissions Units:

<u>E.U. ID No.</u>	<u>Brief Description</u>
-015	Unit No. 1 Coal Bunker with Roto-Clone
-016	Unit No. 2 Coal Bunker with Roto-Clone
-017	Unit No. 3 Coal Bunker with Roto-Clone
<u>039</u>	<u>Unit No. 4 Coal Bunker with Roto-Clone</u>

Descriptions

These emission units are Steam Generator Units Nos. 1-~~43~~ Coal Bunkers with an exhaust fan/cyclone collector (Roto-Clone) controlling dust emission from each unit's respective bunker. Two moving transfer stations via their respective conveyor belts route coal through enclosed chutes to the various bunkers. Coal Bunkers 1-~~43~~ are each equipped with a 9400 ACFM American Air Filter (AAF) Company Type D Roto-Clone to abate dust emissions during ventilation. A number of vent pipes convey fresh air from each bunker to a Roto-Clone during particulate matter removal. Particulate matter removed by the Roto-Clones is returned to the coal bunkers via a hopper and return line. Unit No. 1 Coal Bunker is situated west of Unit No. 2 Coal Bunker. Unit No. 3 Coal Bunker is situated east of Unit No. 2 Coal Bunker. Unit No. 4 Coal Bunker is located east of Unit No. 3.

III.G.4. [Equipment clarification.]

Since a source of less than 1 TPY is exempt from particulate matter RACT provisions, the maximum allowable particulate emissions shall not exceed 0.99 tons per year from each ~~rotoclone cyclone~~ exhaust. Also maximum allowable particulate matter emissions shall not exceed 0.48 lbs/hr from each cyclone exhaust.

[AO29-163788 to escape RACT]

Subsection H. Solid Fuel Yard [Deletion of redundant EU 031, and clarification of descriptions.]

This section addresses the following Regulated Emissions Units:

<u>E.U. ID No.</u>	<u>Brief Description</u>
-010	Solid Fuel Yard, Fugitive Emissions
-029	Cyclone collectors for fuel blending bins (FH-032 through FH-035)
-030	Cyclone collectors for fuel crushers (FH-048 and FH-049)
-031	Cyclone collectors for bunkers (FH-059 through FH-062)

Descriptions

Solid fuel is unloaded from ship/barge into the Solid fuel yard, the blending bins or directly to the tripper room via belt conveyors. Solid fuel from the piles is loaded onto belt conveyors using a rail mounted or mobile reclaimer. The solid fuel is then belt conveyed to the blending bins tower, which consists of six storage bins, where the solid fuel may be is blended for use at the plant, or transloaded into trucks for shipment off site. ~~From the solid fuel yard conveyors, the solid fuel is screw conveyed into the bins.~~ Particulate matter (PM) emissions from the conveyors in the blending bins solid fuel yard are controlled by ~~3 4~~ rotoclones, one at the conveyor drop, and one for every 2 bins. ~~PM emissions from the screw conveyor are controlled by the fourth rotoclone.~~ Blending bins can either Each has 2 hoppers, which feed the

transloader, or solid fuel can be conveyed, via 2 parallel belts (T1, T2) to 2 crushers (each belt has a crusher), or diverted directly to the tripper room. PM emissions from the 2 crushers and transfer tower are controlled by 2 rotoclones.

From the ~~tripper room solid fuel yard, the solid fuel is conveyed to the tripper room where~~ 2 trippers bunker the solid fuels into 4 solid fuel bunkers. Each unit has its own respective bunker. Solid fuel samples are taken every 15 minutes during bunkering, and composited for analysis. From the bunkers, the solid fuel is gravity fed into 14 mills crushers, and then gravity-fed into the boilers. There are 3 ball mills crushers, each for Unit Nos. 1 – 3, and 5 bowl mills crushers for Unit No. 4. From the mills crushers, the solid fuel is pneumatically fed into classifiers, two for each crusher mill on Unit Nos. 1-3 and one for each mill on Unit No. 4 for a total of 238 classifiers, and then into the respective boilers.

5. CONCLUSION

The conditions agreed to by the Department provide reasonable assurance that there will be no significant increase in the representative actual annual emissions of any regulated pollutant.



Department of Environmental Protection

Jeb Bush
Governor

Twin Towers Office Building
2600 Blair Stone Road
Tallahassee, Florida 32399-2400

Colleen M. Castille
Secretary

PERMITTEE:

Tampa Electric Company
Big Bend Station
PO Box 111
Tampa, Florida 33601-0111

Permit No.	0570039-016-AC
Project:	Deletion of Redundant Conditions and Clarification of Process Descriptions
SIC:	4911
Expires:	December 31, 2004

Authorized Representative:

Karen Sheffield, General Manager
Big Bend Station.

PROJECT AND LOCATION:

This air construction permit is to establish the deletion of redundant conditions, and the clarification of process descriptions and conditions as applicable Title V Operation Permit descriptions and conditions.

The Tampa Electric Company (TEC) Big Bend Station is located at Big Bend Road, North Ruskin, Hillsborough County. UTM coordinates are Zone 17; 361.9 km E; 3075.0 km N.

STATEMENT OF BASIS:

This air construction permit is issued under the provisions of Chapter 403 of the Florida Statutes (F.S.), and Chapters 62-4, 62-204, 62-210, 62-212, 62-296 and 62-297 of the Florida Administrative Code (F.A.C.). The above named permittee is authorized to construct/operate the facility in accordance with the conditions of this permit and as described in the application, approved drawings, plans, and other documents on file with the Department of Environmental Protection (Department).

Attached appendices made a part of this permit:

Appendix GC Construction Permit General Conditions

Michael G. Cooke, Director
Division of Air Resource
Management

"More Protection, Less Process"

Printed on recycled paper.

SECTION I. GENERAL INFORMATION

FACILITY DESCRIPTION

This facility is an electric utility.

TEC Big Bend is a nominal 2,028 MW electric generation facility. This facility consists of four steam boilers (Units Nos. 1 through 4); four steam turbines; three simple-cycle combustion turbines (CT Nos. 1, 2, and 3); solid fuels, fly ash, limestone, gypsum, slag, and bottom ash storage and handling facilities, and fuel oil storage tanks. Units No. 1, 2, 3, and 4 have nominal maximum heat inputs of 4037, 3996, 4115 and 4330 million BTU per hour, respectively. Units No. 1 through 4 are fired with coal and with petcoke in a mixture with coal up to 20.0% petcoke/80.0% coal (by weight), or a coal blended with coal residual generated from the Polk Power Station, or a coal/petroleum coke blend further blended with coal residual generated from the Polk Power Station. The combustion turbines are fired with No. 2 distillate fuel oil. In addition, there is a ship surface coating operation.

EMISSIONS UNITS

This permit revision addresses the following emissions units:

EMISSION UNIT NO.	EMISSION UNIT DESCRIPTION
001	Unit No. 1 Steam Generator
002	Unit No. 2 Steam Generator
003	Unit No. 3 Steam Generator
004	Unit No. 4 Steam Generator
008	Fly Ash Silo No. 1 Baghouse
018	Fly Ash Silo No. 1 Truck Loadout
009	Fly Ash Silo No. 2 Baghouse
019	Fly Ash Silo No. 2 Truck Loadout
026	Fly Ash Handling and Storage Fugitive Emissions (all except silos)
014	Fly Ash Silo No. 3 Baghouse
027	Fly Ash Silo No. 3 Truck Loadout
028	Fly Ash Handling System Fugitive Emissions
011	Truck/Railcar Limestone Unloading Receiving Hopper with baghouse
024	Limestone Handling Conveyor LE to South Storage Silo with baghouse, Limestone Handling Conveyor LE to North Storage Silo with baghouse
039	Unit No. 4 Coal Bunker with Roto-Clone
029	Cyclone collectors for fuel blending bins (FH-032 through FH-035)
030	Cyclone collectors for fuel crushers (FH-048 and FH-049)
031	Cyclone collectors for bunkers (FH-059 through FH-062)

REGULATORY CLASSIFICATION

Because potential emissions of at least one regulated pollutant exceed 100 tons per year, the existing facility is a Title V major source of air pollution in accordance with Chapter 62-213, F.A.C. Regulated pollutants include pollutants such as carbon monoxide (CO), nitrogen oxides (NO_x), particulate matter (PM/PM₁₀), sulfur dioxide (SO₂), and volatile organic compounds (VOC).

The existing facility is major source of hazardous air pollutants (HAPs).

The facility operates emissions units subject to the acid rain provisions of the Clean Air Act.

The facility is considered a "fossil fuel fired steam electric plant of more than 250 million BTU per hour of heat input", which is one of the 28 PSD source categories with the lower PSD applicability threshold of 100 tons per

SECTION I. GENERAL INFORMATION

year. Potential emissions of at least one regulated pollutant exceed 100 tons per year. Therefore, the facility is classified as a PSD-major source of air pollution with respect to Rule 62-212.400, F.A.C., Prevention of Significant Deterioration (PSD) of Air Quality.

Unit 4 was certified pursuant Electrical Power Plant Siting in accordance with Chapter 62-17, F.A.C. and Chapter 403, Part II, F.S.

This facility is classified as a "Major Source of Air Pollution or Title V Source" due to emissions of at least one regulated air pollutant, such as sulfur dioxide, that exceeds 100 tons per year.

RELEVANT DOCUMENTS

- Construction Permit Application 0570039-016-AC received May 18, 2004.
- Title V Air Operation Permit Revision Application No. 0570039-015-AV received on January 16, 2004.

DRAFT

SECTION II. FACILITY-WIDE SPECIFIC CONDITIONS

1. Permitting Authority: All documents related to applications for permits to construct or modify an emissions unit should be submitted to the Bureau of Air Regulation (BAR), Florida Department of Environmental Protection (FDEP), at 2600 Blair Stone Road, Tallahassee, Florida 32399-2400 and phone number (850)488-0114.
2. Compliance Authority: All documents related to operation, reports, tests, and notifications should be submitted to the Environmental Protection Commission of Hillsborough County (EPC) at

Environmental Protection Commission
of Hillsborough County
1410 North 21 Street
Tampa, Florida 33605
Telephone: 813/272-5530
Fax: 813/272-5605

3. General Conditions: The owner and operator is subject to and shall operate under the attached General Permit Conditions G.1 through G.15 listed in Appendix GC of this permit. General Permit Conditions are binding and enforceable pursuant to Chapter 403 of the Florida Statutes. [Rule 62-4.160, F.A.C.]
4. Terminology: The terms used in this permit have specific meanings as defined in the corresponding chapters of the Florida Administrative Code.
5. Forms and Application Procedures: The permittee shall use the applicable forms listed in Rule 62-210.900, F.A.C. and follow the application procedures in Chapter 62-4, F.A.C. [Rule 62-210.900, F.A.C.]
6. Modifications: The permittee shall give written notification to the Department when there is any modification to this facility. This notice shall be submitted sufficiently in advance of any critical date involved to allow sufficient time for review, discussion, and revision of plans, if necessary. Such notice shall include, but not be limited to, information describing the precise nature of the change; modifications to any emission control system; production capacity of the facility before and after the change; and the anticipated completion date of the change. [Chapters 62-210 and 62-212, F.A.C.]
7. New or Additional Conditions: Pursuant to Rule 62-4.080, F.A.C., for good cause shown and after notice and an administrative hearing, if requested, the Department may require the permittee to conform to new or additional conditions. The Department shall allow the permittee a reasonable time to conform to the new or additional conditions, and on application of the permittee, the Department may grant additional time. [Rule 62-4.080, F.A.C.]
8. Completion of Construction: The permit expiration date is December 31, 2004.
9. Permit Expiration Date Extension: The permittee, for good cause, may request that this permit be extended. Such a request shall be submitted to the Bureau of Air Regulation prior to 60 days before the expiration of the permit (Rule 62-4.080, F.A.C.).
10. Application for Title V Permit Revision: Concurrent processing of Air Construction Permit Application and Title V Permit Revision.
11. Plant Operation - Problems: If temporarily unable to comply with any of the conditions of the permit due to breakdown of equipment or destruction by fire, wind or other cause, the permittee shall notify each Compliance Authority as soon as possible, but at least within one working day, excluding weekends and holidays. The notification shall include: pertinent information as to the cause of the problem; steps being taken to correct the problem and prevent future recurrence; and, where applicable, the owner's intent toward reconstruction of destroyed facilities. Such notification does not release the permittee from any liability for failure to comply with the conditions of this permit or the regulations. [Rule 62-4.130, F.A.C.]

SECTION II. FACILITY-WIDE SPECIFIC CONDITIONS

12. Operating Procedures: Operating procedures shall include good operating practices and proper training of all operators and supervisors. The good operating practices shall meet the guidelines and procedures as established by the equipment manufacturers. All plant operators (including supervisors) of air pollution control devices shall be properly trained in plant specific equipment. [Rule 62-4.070(3), F.A.C.]
13. Circumvention: The permittee shall not circumvent the air pollution control equipment or allow the emission of air pollutants without the applicable air control device operating properly. [Rule 62-210.650, F.A.C.]
14. Unconfined Particulate Matter Emissions: During the construction period, unconfined particulate matter emissions shall be minimized by dust suppressing techniques such as covering and/or application of water or chemicals to the affected areas, as necessary. [Rule 62-296.320(4)(c), F.A.C.]
15. Test Notification: The permittee shall notify each Compliance Authority in writing at least 30 days prior to any initial performance tests and at least 15 days prior to any other required tests. Notification shall include the date, time, and place of each such test, and the test contact person who will be responsible for coordinating and conducting the test. [Rule 62-297.310(7)(a)9., F.A.C. and 40 CFR 60.7, 60.8]
16. Calculation of Emission Rate: For each emissions performance test, the indicated emission rate or concentration shall be the arithmetic average of the emission rate or concentration determined by each of the three separate test runs unless otherwise specified in a particular test method or applicable rule. [Rule 62-297.310(3), F.A.C.]
17. Applicable Test Procedures
 - a. Required Sampling Time. Unless otherwise specified in the applicable rule, the required sampling time for each test run shall be no less than one hour and no greater than four hours, and the sampling time at each sampling point shall be of equal intervals of at least two minutes. The minimum observation period for a visible emissions compliance test shall be sixty (60) minutes. The observation period shall include the period during which the highest opacity can reasonably be expected to occur. [Rule 62-297.310(4)(a)1. and 2., F.A.C.]
 - b. Minimum Sample Volume. Unless otherwise specified in the applicable rule or test method, the minimum sample volume per run shall be 25 dry standard cubic feet. [Rule 62-297.310(4)(b), F.A.C.]
 - c. Calibration of Sampling Equipment. Calibration of the sampling train equipment shall be conducted in accordance with the schedule shown in Table 297.310-1, F.A.C. [Rule 62-297.310(4)(d), F.A.C.]
18. Determination of Process Variables
 - a. Required Equipment. The owner or operator of an emissions unit for which compliance tests are required shall install, operate, and maintain equipment or instruments necessary to determine process variables, such as process weight input or heat input, when such data are needed in conjunction with emissions data to determine the compliance of the emissions unit with applicable emission limiting standards. [Rule 62-297.310(5)(a), F.A.C.]
 - b. Accuracy of Equipment. Equipment or instruments used to directly or indirectly determine process variables, including devices such as belt scales, weight hoppers, flow meters, and tank scales, shall be calibrated and adjusted to indicate the true value of the parameter being measured with sufficient accuracy to allow the applicable process variable to be determined within 10% of its true value. [Rule 62-297.310(5)(b), F.A.C.]

SECTION II. FACILITY-WIDE SPECIFIC CONDITIONS

19. Special Compliance Tests: When the Department, or EPC, after investigation, has good reason (such as complaints, increased visible emissions or questionable maintenance of control equipment) to believe that any applicable emission standard contained in a Department rule or in a permit issued pursuant to those rules is being violated, it shall require the owner or operator of the emissions unit to conduct compliance tests which identify the nature and quantity of pollutant emissions from the emissions unit and to provide a report on the results of said tests to the Department. [Rule 62-297.310(7)(b), F.A.C.]
20. Stack Testing Facilities: Required stack sampling facilities shall be installed in accordance with Rule 62-297.310(6), F.A.C. [Rule 62-297.310]
21. Operating Rate During Testing: Testing of emissions shall be conducted with the emissions unit operating at permitted capacity. Permitted capacity is defined as 90 to 100 percent of the maximum operation rate allowed by the permit. If it is impractical to test at permitted capacity, an emissions unit may be tested at less than the maximum permitted capacity; in this case, subsequent emissions unit operation is limited to 110 percent of the test rate until a new test is conducted. Once the unit is so limited, operation at higher capacities is allowed for no more than 15 consecutive days for the purpose of additional compliance testing to regain the authority to operate at the permitted capacity. [Rule 62-297.310(2)(b), F.A.C.]
22. Records Retention: All measurements, records, and other data required by this permit shall be documented in a permanent, legible format and retained for at least five (5) years following the date on which such measurements, records, or data are recorded. Records shall be made available to the Department, or EPC, upon request. [Rules 62-4.160(14) and 62-213.440(1)(b)2., F.A.C.]
23. Emissions Performance Test Results Reports: A report indicating the results of any required emissions performance test shall be submitted to each Compliance Authority no later than 45 days after completion of the last test run. The test report shall provide sufficient detail on the tested emission unit and the procedures used to allow the Department to determine if the test was properly conducted and if the test results were properly computed. At a minimum, the test report shall provide the applicable information listed in Rule 62-297.310(8)(c), F.A.C. [Rule 62-297.310(8), F.A.C.]
24. Annual Operating Reports: The permittee is required to submit annual reports on the actual operating rates and emissions from this facility. Annual operating reports shall be sent to the Environmental Protection Commission of Hillsborough County by March 1st of each year. [Rule 62-210.370(2), F.A.C.]

SECTION III. EMISSIONS UNITS SPECIFIC CONDITIONS

The following descriptions and specific conditions established in the initial Title V Air Operation Permit, No. 0570039-002-AV, and the previous Title V Air Operation Permit Revisions, Nos. 0570039-010-AV and 0570039-013-AV, are changed as follows. Additions are highlighted, and deletions are shown by strikethroughs:

I. Subsection A. Facility Description.

Overview of the facility's operation:

Solid fuel is unloaded from ship/barge into the solid fuel yard, the blending bins or directly to the tripper room via belt conveyors. Solid fuel from the piles is loaded onto belt conveyors using a rail mounted or mobile reclaimer. The solid fuel is then belt conveyed to the blending bins tower, which consists of six storage bins, where the solid fuel may be is blended for use at the plant, or transloaded into trucks for shipment off site. From the solid fuel yard conveyors, the solid fuel is screw conveyed into the bins. Particulate matter (PM) emissions from the conveyors in the solid fuel yard blending bins are controlled by 3 4 rotocones, one at the conveyor drop and one for every 2 bins. PM emissions from the screw conveyor are controlled by the fourth rotocone. Blending bins can either Each has 2 hoppers, which feed the transloader, or solid fuel can be are conveyed, via 2 parallel belts (T1, T2) to 2 crushers (each belt has a crusher), or diverted directly to the tripper room. PM emissions from the 2 crushers and transfer tower are controlled by 2 rotocones.

From the tripper room solid fuel yard, the solid fuel is conveyed to the tripper room where 2 trippers bunker the solid fuels into 4 solid fuel bunkers. Each unit has its own respective bunker. Solid fuel samples are taken every 15 minutes during bunking, and composited for analysis. From the bunkers, the solid fuel is gravity fed into 14 crushers mills, and then gravity fed into the boilers. There are 3 ball mills tall crushers, each for Unit Nos. 1 - 3, and 5 bowl mills crushers for Unit No. 4. From the mills crushers, the solid fuel is pneumatically fed into classifiers, two for each mill on Unit Nos. 1-3 and one for each mill on Unit No. 4 crusher for a total of 23 8 classifiers, and then into the respective boilers.

PM emissions from Boiler Nos. 1- 43 are controlled by individual Electrostatic Precipitators (ESPs). Unit Nos. 1 4 PM emissions are controlled by an ESP, and the SO₂ emissions are controlled by an FGD scrubber systems. When Unit Nos. 1,3 burns petroleum coke, the exhaust gases, following particulate matter removal by the units' ESPs, will be routed to the inlet of the Unit No. 4 flue gas desulfurization (FGD) system scrubber. In the this integrated mode, Unit No. 3 will meet the same sulfur dioxide emissions limitations as Unit No. 4. The FGD scrubber will continue to treat the exhaust gas from Unit No. 4. The FGD scrubber outlet stream, consisting of the combined Unit No. 3 and Unit No. 4 treated exhaust, will then be split and discharged through stacks CS002 and CS003.

Fly ash from Units No. 1 and No. 2 is vented into Fly Ash Silo #1 which is controlled by a baghouse. Fly ash from Unit No. 3 is vented into Silo #2, which can also receive fly ash from Units No. 1 and 2, while fly ash from Unit No. 4 is vented into Silo #3. The fly ash from each silo is then loaded into trucks and transported off site, while the bottom ash from Unit No. 4 is conveyed across Big Bend Road south of the Big Bend facility to a settling pond. Each fly ash silo is controlled by a baghouse.

The byproduct gypsum is conveyed to the east side of the plant for dewatering diverting and transporting off site. Limestone is unloaded to an underground hopper conveyor belt system to the limestone storage building on the east side of the by-product gypsum area. Particulate matter emissions from the limestone trucks unloading is controlled by a baghouse. From the storage building, limestone is belt conveyed into 2-3 storage silos and then gravity fed into the mill room. Two Three rotary mills grind the limestone and mix it with water to form a slurry that is stored in 2-3 storage tanks for use in the FGD. The slurry is then pumped to the 4 reaction tanks of Units 1-4 scrubbers that are located directly south of and adjacent to the absorption towers of the FGD scrubber. Gypsum is sold and transported offsite and can be stored south of Big Bend Road prior to offsite removal. Most of the by-product gypsum is wallboard grade, however, gypsum that is produced during start-up, shutdown or upset conditions is de-watered and belt conveyed across the street to the southeast of the plant for drying and transportation off site.

SECTION III. EMISSIONS UNITS SPECIFIC CONDITIONS

There are 3-combustion turbines (CT) manufactured by Westinghouse. They are all fired on No. 2 fuel oil. Unit CT No. 1 is near the plant and Unit CT Nos. 2 and 3 are on the north side of the property. There is a large No. 2 fuel oil storage tank near Unit CT Nos. 2 and 3 and a small day tank near Unit CT No. 1.

I. Subsection B.

- 026 Fly Ash Handling and Storage Fugitive Emissions from Unit Nos. 1-3 (all except silos)
- 028 Fly Ash Handling System Fugitive Emissions from Unit No. 4
- ~~-039 Unit No. 4 Coal Bunker~~
- 024 Limestone Handling Conveyor LE to South Storage Silo with Baghouse
- 031 Cyclone collectors for bunkers (FH 059 through FH 062)

II.4. Prevention of Accidental Releases (Section 112(r) of CAA).

a. The permittee shall submit its Risk Management Plan (RMP) to the Chemical Emergency Preparedness and Prevention Office (CEPPO) RMP Reporting Center when, and if, such requirement becomes applicable. Any Risk Management Plans, original submittals, revisions or updates to submittals, should be sent to:

RMP Reporting Center

Post Office Box 3346
Merrifield, VA 22116-3346
Telephone: 703/816-4434

P.O. Box 1515
Lanham-Seabrook, Maryland 20703-1515
Telephone: 301/429-5018

and,

b. The permittee shall submit to the permitting authority Title V certification forms or a compliance schedule in accordance with Rule 62-213.440(2), F.A.C. [40 CFR 68]

III.A.2. b. Other operation:

i. In addition to the fuels allowed to be burned during normal operation, each unit may also burn new No. 2 fuel during startup, shutdown, flame stabilization, and during the start of a mill on an already operating unit.

ii. Evaporation of up to 150,000 gallons per year, total at the facility, is allowed of non-hazardous, but potentially HAP-emitting, mineral acid solution boiler chemical cleaning waste which was generated on site.

III.A.16. Petcoke Sulfur Content: Until January 1, 2006, The owner or operator shall measure the sulfur content of representative samples of all petcoke received using appropriate ASTM methods to demonstrate compliance with the sulfur content limit of this permit. [Permit Nos. 0570039-003-AC & 0570039-004-AC]

III.A.26. [Deletion of obsolete petcoke fuel sulfur content recordkeeping condition after 2005. SO₂ emissions are measured directly using continuous monitoring systems (CEMS), however, the permittee must submit on an annual basis through 2005, data demonstrating that removal of the sulfur content limit in the petroleum coke fired did not result in a significant increase in the representative actual annual emission of any regulated pollutant. (See Specific Condition III.A.2.)]

III.A.26. Records of Petcoke Sulfur Content: Until January 1, 2006, The owner or operator shall maintain records of petcoke sampling and analysis results performed as required by Specific Condition A.16. of this section. [Rule 62-4.070(3), F.A.C., and permit nos. 0570039-003-AC & 0570039-004-AC]

III.A.29. For Unit Nos. 1-3, gravimetric instrument data verifying that the 20.0% maximum petroleum coke content by weight has not been exceeded shall be maintained for two years and submitted to the Department and the EPCHC with each annual operating report. Also to be maintained and available for inspection shall be a record of operation showing the date, fuel used, mode of operation (integrated/non-integrated), and the duration of all startups, shutdowns and malfunctions. [Rule 62-4.070(3), F.A.C.]

SECTION III. EMISSIONS UNITS SPECIFIC CONDITIONS

III.A.30. ~~Until January 1, 2006, for~~ Unit No. 3, TEC shall maintain and submit to the Department and the EPCHC, on an annual basis ~~for a period of 5 years from the date the unit begins firing petroleum coke,~~ data demonstrating that the operational change ~~of firing petcoke~~ did not result in an emissions increase. [Rule 62-4.070(3), F.A.C.]

III. Subsection B. Description.

As an option, Unit No. 3 exhaust gas, following particulate matter removal by the unit's ESP, will be routed to the inlet of the Unit No. 4 flue gas desulfurization (FGD) system scrubber. In this integrated mode, Unit No. 3 will meet the same sulfur dioxide emissions limitations as Unit No. 4. The FGD scrubber will continue to treat the exhaust gas from Unit No. 4. The FGD scrubber outlet stream, consisting of the combined Unit No. 3 and Unit No. 4 treated exhaust, will then be split and discharged through stacks CS002 and CS003. Stack CS002 does not include a recirculation duct to return exhaust gas to the inlet of the FGD scrubber. Continuous opacity monitoring systems (COMS) will be located at the outlet of Unit No. 3 and Unit No. 4 ESPs. Continuous SO₂ and CO₂ emissions monitoring systems (CEMS) will be located in stacks CS002 and CS003. Continuous NO_x emissions monitoring systems (CEMS) will be located in the inlet ducts of each unit. These monitoring systems will be used to determine compliance with all current applicable requirements.

III.B.2. Methods of Operation - Fuels.

a. Normal operation: The fuel fired in Unit No. 4 shall consist of coal, or a coal/petroleum coke blend containing a maximum of 20% petroleum coke by weight, or coal blended with coal residual generated from the Polk Power Station, or a coal/petroleum coke blend further blended with coal residual generated from the Polk Power Station. In any case, the petroleum coke content of any fuel blend shall not exceed 20% by weight. The vanadium content of the petroleum coke fired shall not exceed 2660 ppm vanadium. The ash content of the petroleum coke fired shall not exceed 0.76% by weight on a dry basis. The permittee shall maintain and submit to the Department, and to the Environmental Protection Commission of Hillsborough County, on an annual basis for the years 2001, 2002, 2003, 2004, and 2005 data demonstrating that removal of the sulfur content limit and the revision of the vanadium content limit in the petroleum coke fired did not result in a significant increase in the representative actual annual emissions of any regulated pollutant.

b. Other operation:

i. In addition to the fuels allowed to be burned during normal operation, Unit No. 4 may also burn new No. 2 fuel during startup, shutdown, flame stabilization and during the start of an additional solid fuel mill pulverizer on an already operating unit.

ii. Evaporation of up to 150,000 gallons per year, total at the facility, is allowed of non-hazardous, but potentially HAP-emitting, mineral acid solution boiler chemical cleaning waste which was generated on site.

c. Coal shall not be burned in Unit No. 4 unless both the electrostatic precipitator and limestone scrubber are operating properly.

d. ~~[Reserved]~~ Coal burned in Unit No. 4 shall be washed before it is transported to the plant site. TEC shall maintain records of all coal washing and preparation activities for any coal which is to be fired in Big Bend Unit No. 4. These reports shall be submitted to the Department on a quarterly basis.

e. TEC shall maintain a daily log of the amounts and types of fuels used and copies of fuel analyses containing information on sulfur content, ash content and heating values.

f. Beneficiated, or refined, coal residual: The total amount of beneficiated, or refined, coal residual fired at Big Bend Station (all Unit Nos. 1-4 combined) shall be limited to 500 tons per day. The beneficiated, or refined, coal residual results from using the beneficiated process, described in permit application 0570039-012-AC, to wash and screen the raw coal residual to remove fines and oversized materials. This beneficiation process shall be performed at Polk Power Station, not Big Bend Station.

g. Raw coal residual: The total amount of raw coal residual fired at Big Bend Station (all Unit Nos. 1-4 combined) shall be limited to 200 tons per day. The raw coal residual is a by-product of the gasification of coal at the Polk Power Station. At the time of the issuance of permit 0570039-012-AC on October 4, 2001, there were approximately 100,000 tons of raw coal residual stored at Polk Power Station. Once this raw coal residual pile has been fired, TEC shall only fire raw coal residual in the event of a significant beneficiation process malfunction. TEC shall document all beneficiation process malfunctions and record the amount of raw coal residual, if any, fired at Big Bend Station. These records should be kept on site at Big Bend and made readily available to the Department and the Environmental Protection Commission of Hillsborough County upon request.

SECTION III. EMISSIONS UNITS SPECIFIC CONDITIONS

h. No coal residual shall be fired in any Unit when the corresponding scrubber is not in operation. [Rules 62-4.070(3), 62-4.160(2), 62-210.200, and 62-213.440(1), F.A.C.; PSD-FL-040; Power Plant Siting Certification PA 79-12; Permit No. 0570039-012-AC ~~Permit No. 0570039-016-AC~~]

III. B. 12. During emergency conditions in the principal company, an affected facility with a malfunctioning flue gas desulfurization system may be operated if sulfur dioxide emissions are minimized by:

- (1) Operating all operable flue gas desulfurization system modules, and bringing back into operation any malfunctioned module as soon as repairs are completed,
- (2) Bypassing flue gases around only those flue gas desulfurization system modules that have been taken out of operation because they were incapable of any sulfur dioxide emission reduction or which would have suffered significant physical damage if they had remained in operation, and
- (3) Operating a *spare* flue gas desulfurization system module. The Department or EPCHC may at their discretion require TEC within 60 days of notification to demonstrate spare module capability. To demonstrate this capability, the owner or operator must demonstrate compliance with the appropriate requirements of specific conditions ~~B.5. and B.7.~~ for any period of operation lasting from 24 hours to 30 days when:
 - (i) Any one flue gas desulfurization module is not operated,
 - (ii) The affected facility is operating at the maximum heat input rate,
 - (iii) The fuel fired during the 24-hour to 30-day period is representative of the type and average sulfur content of fuel used over a typical 30-day period, and
 - (iv) TEC has given the Department or EPCHC at least 30 days notice of the date and period of time over which the demonstration will be performed.[Rule 62-204.800(7)(b)2., F.A.C.; 40 CFR 60.46a(d)]

III.B.19. TEC shall calibrate, maintain, and operate a continuous monitoring system, and record the output of the system, for measuring the oxygen and/or carbon dioxide content of the flue gases at each location where sulfur dioxide or nitrogen oxides emissions are monitored. The sulfur dioxide, nitrogen dioxide, oxygen and/or carbon dioxide, and opacity monitoring devices shall meet the applicable requirements of Section 62-214, F.A.C., 40 CFR 60.47a., and 40 CFR 75.). The opacity monitor shall be placed in the duct work between the electrostatic precipitator and the FGD scrubber. ~~When Units 3 and 4 are operating in the integrated mode (Unit 3 flue gases routed through the Unit 4 FGD system),~~ the continuous monitoring system will measure sulfur dioxide emissions at the inlet of each unit and outlet of the Unit 4 FGD system and from the Unit 3 stack (CS002) and Unit 4 stack (CS003), while emissions of nitrogen oxides, oxygen and/or carbon dioxide, and opacity shall be measured in the Units 3 and 4 ducts prior to the FGD system. When Unit 4 is operating and Unit 3 is not operating in the integrated mode, the continuous monitoring system will measure only Unit 4's inlet duct and stack for SO₂ emissions. The emissions of nitrogen oxides and opacity shall be measured in the Unit 4 duct prior to the FGD system. The emissions of carbon dioxide and sulfur dioxide are both measured in the inlet and outlet ducts. [Rule 62-204.800(7)(b)2., F.A.C.; 40 CFR 60.47a(d); Power Plant Siting Certification PA 79-12D]

III.B.28. TEC shall determine compliance with the SO₂ standards in specific condition B.7. as follows:

- (1) The percent of potential SO₂ emissions (%P_s) to the atmosphere shall be computed using the following equation:

$$\%P_s = [(100 - \%R_f) (100 - \%R_g)] / 100$$

where:

- $\%P_s$ = percent of potential SO₂ emissions, percent.
 $\%R_f$ = percent reduction from fuel pretreatment, percent.
 $\%R_g$ = percent reduction by SO₂ control system, percent.

- (2) ~~[Reserved]~~ The procedures in Method 19 may be used to determine percent reduction (%R_f) of sulfur by such processes as fuel pretreatment (physical coal cleaning, hydrosulfurization of fuel oil, etc.), coal pulverizers, and bottom and flyash interactions. This determination is optional.

- (3) The procedures in Method 19 shall be used to determine the percent SO₂ reduction (%R_g of any SO₂ control system. Alternatively, a combination of an "as fired" fuel monitor and emission rates measured after the control system, following the procedures in Method 19, may be used if the percent reduction is calculated using the

SECTION III. EMISSIONS UNITS SPECIFIC CONDITIONS

average emission rate from the SO₂ control device and the average SO₂ input rate from the "as fired" fuel analysis for 30 successive boiler operating days.

(4) The appropriate procedures in Method 19 shall be used to determine the emission rate.

(5) The continuous monitoring systems specified in conditions B.17. and B.19. shall be used to determine the concentrations of SO₂ and CO₂ or O₂.

[Rule 62-204.800(7)(b)2., F.A.C.; 40 CFR 60.48a (c); 40 CFR 60.43a; 40 CFR 60.47a(b) and (d); 40 CFR 60 Appendix A, Method 19; Applicant request: 0570039-016-AC]

B.35. ~~Reserved.~~ If fuel pretreatment credit is claimed toward the sulfur dioxide emission standards in specific condition B.7. TEC shall submit a signed statement:

~~—(1) Indicating what percentage cleaning credit was taken for the calendar quarter, and whether the credit was determined in accordance with the provisions of specific condition B.28. and Method 19 (Appendix A of 40 CFR 60); and~~

~~—(2) Listing the quantity, heat content, and date each pretreated fuel shipment was received during the previous quarter; the name and location of the fuel pretreatment facility; and the total quantity and total heat content of all fuels received at the affected facility during the previous quarter.~~

~~[Rule 62-204.800(7)(b)2., F.A.C.; 40 CFR 60.49a(e), 40 CFR 60.48a(e)]~~

III. Subsection D. Descriptions.

Fly Ash Silo No. 2 handles fly ash from Steam Generator Units Nos. 1, 2, and/or 3. Fly ash is pneumatically conveyed in a series of pipes from the individual unit precipitators (Units 1, 2, and/or 3, only two units at any time) to the silo for temporary storage. Fly ash from Silo No. 2 is discharged in either a wet or dry state. From the silo, the dry fly ash is gravity fed by tubing into closed tanker trucks and transported to an off-site consumer. The wet fly ash is processed through a pugmill and then unloaded into a dump truck to be transported to an off-site consumer. Particulate emissions generated during silo loading operation and from the tanker truck loadout chutes are controlled by a 20,081 DSCFM Flex Kleen, Model No. 84 UDTR-640 baghouse in addition to reasonable precautions.

III.D.1. Capacity. The maximum permitted loading rate for all Fly Ash Silo No. 1 processes combined is 44.5 tons per hour. The maximum permitted loading rate for all Fly Ash Silo No. 2 processes combined is 44.5 tons per hour. For Fly Ash Silo No. 2, the maximum permitted loading rate is the simultaneous maximum transfer of fly ash from boiler Units 1, 2, and 3. Separate testing of emissions from each unit shall be conducted with each emissions unit operation at 90 to 100 percent of the maximum permitted capacity heat input rate. If it is impractical to test at permitted capacity, an emissions unit may be tested at less than the maximum ~~minimum~~ permitted capacity; in this case, subsequent emissions unit operation is limited to 110 percent of the test rate load until a new test is conducted. Once the unit is so limited, operation at higher capacities is allowed for no more than 15 consecutive days for the purpose of additional compliance testing to regain the authority to operate at the permitted capacity. [AC29-194516; AO29-161082; Rule 62-4.160(2), and Rule 62-297.310(2), F.A.C.]

~~{Permitting note: The material loading limitations have been placed in each permit to identify the capacity of each emissions unit for the purposes of confirming that emissions testing is conducted within 90 to 100 percent of the emissions unit's rated capacity (or to limit future operation to 110 percent of the test load), to establish appropriate emission limits and to aid in determining future rule applicability. Regular recordkeeping is not required for material loading. Instead the owner or operator is expected to determine material loading whenever the emission testing is required, to demonstrate at what percentage of the rated capacity that the emissions unit was tested. Rule 62-297.310(5), F.A.C., included in the permit, requires measurement of process variables for emission tests. Material loading demonstrations may be based on best engineering evaluation of the operating requirements necessary to achieve 90 to 100 percent of the rated loading, unless such operating conditions are otherwise specified by permit condition.}~~

III.D.10. Compliance testing for the silo and tanker truck loading operations shall be conducted under the following conditions:

a. All conveyance hoppers will be operational during the test.

b. All fly ash will be directed to the silo, no reinjection of fly ash to the boiler systems will occur during the test.

SECTION III. EMISSIONS UNITS SPECIFIC CONDITIONS

- c. The boilers shall operate at the maximum capability of this unit under normal operating conditions during the test.
- d. Two tanker trucks shall be loaded during the test. The loading valve shall be completely open to allow 90%-100% of the maximum loading rate during testing filling. The loading valve position shall be calibrated, and the position of the valve during testing shall be recorded.
- e. The visible emission test shall be at least 30 minutes in duration and the period of time during which truck loading occurred indicated on the test report.
- [Rules 62-4.070(3) and 62-297.310, F.A.C.]

III. Subsection E. Description.

Fly Ash Silo No. 3 handles fly ash from Steam Generator Unit No. 4. Also, fly ash may be pneumatically conveyed from tanker trucks to Silo No. 3. Particulate matter emissions are controlled by a 1,200 DSCFM Flex Kleen Model 84-WRTC-80-II-G baghouse. The wet flyash may be processed through a pugmill and then unloaded into a dump truck.

III. SUBSECTION F. LIMESTONE HANDLING AND STORAGE

This section addresses the following Regulated Emissions Units:

<u>E.U. ID No.</u>	<u>Brief Description</u>
-011	Truck/Railcar Limestone Unloading Receiving Hopper with baghouse
-012	Limestone Silo A with 2 baghouses
-013	Limestone Silo B with 2 baghouses
-023	Limestone Handling Conveyor LB to Conveyor LC with baghouse, Limestone Handling Conveyor LD to Conveyor LE with baghouse.
-024	Limestone Handling Conveyor LE to South Storage Silo with baghouse, Limestone Handling Conveyor LE to North Storage Silo with baghouse
-025	Limestone Storage and Handling Fugitive Emissions

DESCRIPTIONS

Particulate matter emissions from the truck and railcar unloading of limestone are controlled by a Mikro-Pulsaire Model 400S12TR baghouse. Particulate matter emissions generated by the transfer of limestone from Handling Conveyor LB to Conveyor LC are controlled by a Sternvent Model DKED18003 baghouse. Particulate matter emissions generated by the transfer of limestone from Handling Conveyor LD to Conveyor LE are controlled by a Sternvent Model DKED 18003 baghouse. Particulate matter emissions generated by the transfer of limestone from Handling Conveyor LE to the South Storage Silo are controlled by a Flex Kleen Model 58-BVBC 36-HG baghouse. Particulate matter emissions generated by the transfer of limestone from Handling Conveyor LE to the North Storage Silo are controlled by a Flex Kleen Model 58-BVBC 36-HG baghouse.

III.F.1. Total combined particulate matter emissions from the limestone handling hoppers/conveyors shall not exceed 0.65 lb/hr. Visible emissions are limited to 5% opacity. Compliance testing for particulate matter emissions is not required provided the opacity limit is maintained.
[PSD-FL-040; Power Plant Siting Certification PA 79-12]

III.F.4. The limestone handling receiving hopper, conveyor transfer points and silos shall be maintained at negative pressures with the exhaust vented to a control system(s).
[PSD-FL-040]

Subsection G. Coal Bunkers with Roto-Clones

This section addresses the following Regulated Emissions Units:

<u>E.U. ID No.</u>	<u>Brief Description</u>
-015	Unit No. 1 Coal Bunker with Roto-Clone

SECTION III. EMISSIONS UNITS SPECIFIC CONDITIONS

-016	Unit No. 2 Coal Bunker with Roto-Clone
-017	Unit No. 3 Coal Bunker with Roto-Clone
039	Unit No. 4 Coal Bunker with Roto-Clone

Descriptions

These emission units are Steam Generator Units Nos. 1-~~43~~ Coal Bunkers with an exhaust fan/cyclone collector (Roto-Clone) controlling dust emission from each unit's respective bunker. Two moving transfer stations via their respective conveyor belts route coal through enclosed chutes to the various bunkers. Coal Bunkers 1-~~43~~ are each equipped with a 9400 ACFM American Air Filter (AAF) Company Type D Roto-Clone to abate dust emissions during ventilation. A number of vent pipes convey fresh air from each bunker to a Roto-Clone during particulate matter removal. Particulate matter removed by the Roto-Clones is returned to the coal bunkers via a hopper and return line. Unit No. 1 Coal Bunker is situated west of Unit No. 2 Coal Bunker. Unit No. 3 Coal Bunker is situated east of Unit No. 2 Coal Bunker. ~~Unit No. 4 Coal Bunker is located east of Unit No. 3~~

III.G.4.

Since a source of less than 1 TPY is exempt from particulate matter RACT provisions, the maximum allowable particulate emissions shall not exceed 0.99 tons per year from each ~~rotoclone cyclone~~ exhaust. Also maximum allowable particulate matter emissions shall not exceed 0.48 lbs/hr from each cyclone exhaust. [AO29-163788 to escape RACT]

Subsection H. Solid Fuel Yard

This section addresses the following Regulated Emissions Units:

<u>E.U. ID No.</u>	<u>Brief Description</u>
-010	Solid Fuel Yard, Fugitive Emissions
-029	Cyclone collectors for fuel blending bins (FH-032 through FH-035)
-030	Cyclone collectors for fuel crushers (FH-048 and FH-049)
-031	Cyclone collectors for bunkers (FH-059 through FH-062)

Descriptions

Solid fuel is unloaded from ship/barge into the Solid fuel yard, ~~the blending bins~~ or directly to the tripper room via belt conveyors. Solid fuel from the piles is loaded onto belt conveyors using a rail mounted or mobile reclaimer. The solid fuel is then belt conveyed to the blending bins tower, which consists of six storage bins, where the solid fuel ~~may be~~ is blended for use at the plant, or transloaded into trucks for shipment off site. ~~From the solid fuel yard conveyors, the solid fuel is screw conveyed into the bins.~~ Particulate matter (PM) emissions from the conveyors in the blending bins solid fuel yard are controlled by 3 ~~4~~ rotoclones, ~~one at the conveyor drop, and one for every 2 bins.~~ PM emissions from the screw conveyor are controlled by the fourth rotoclone. ~~Blending bins can either~~ Each has 2 hoppers, which feed the transloader, or ~~solid fuel can be~~ are conveyed, via 2 parallel belts (T1, T2) to 2 crushers (each belt has a crusher), or diverted directly to the tripper room. PM emissions from the 2 crushers and transfer tower are controlled by 2 rotoclones.

From the ~~tripper room solid fuel yard, the solid fuel is conveyed to the tripper room where 2 trippers~~ bunker the solid fuels into 4 solid fuel bunkers. Each unit has its own respective bunker. Solid fuel samples are taken every 15 minutes during bunkering, and composited for analysis. From the bunkers, the solid fuel is gravity fed into 14 mills crushers, and then gravity fed into the boilers. There are 3 ball mills ~~and~~ crushers, each for Unit Nos. 1 - 3, and 5 bowl mills crushers for Unit No. 4. From the mills crushers, the solid fuel is pneumatically fed into classifiers, two for each crusher ~~mill on Unit Nos. 1-3 and one for each mill on Unit No. 4~~ for a total of 238 classifiers, and then into the respective boilers.

Tampa Electric Company
Big Bend Station
Facility ID No.: 0570039
Hillsborough County

Title V Air Operation Permit Revision/Renewal

DRAFT Permit No.: 0570039-017-AV

Permitting Authority:

State of Florida
Department of Environmental Protection
Division of Air Resources Management
Bureau of Air Regulation
Title V Section

Mail Station #5505
2600 Blair Stone Road
Tallahassee, Florida 32399-2400

Telephone: 850/488-0114
Fax: 850/921-9533


Compliance Authority:

Environmental Protection Commission
of Hillsborough County
1410 North 21 Street
Tampa, Florida 33605
Telephone: 813/272-5530
Fax: 813/272-5605

Title V Air Operation Permit Revision/Renewal
DRAFT Permit No.: 0570039-017-AV

Table of Contents

Section	Page Number
Placard Page	1
I. Facility Information	2 - 5 4
A. Facility Description.	
B. Summary of Emissions Unit ID Nos. and Brief Descriptions.	
C. Relevant Documents.	
II. Facility-wide Conditions	65 - 87
III. Regulated Emissions Units Conditions.....	98 - 776
A. Steam Generators Units Nos. 1, 2, & 3	98 - 187
B. Steam Generator Unit No. 4 (and No. 3 in integrated mode).....	197 - 365
C. Combustion Turbine.....	376 - 398
D. Flyash Handling and Storage.....	4039 - 432
E. Flyash Silo No. 3.....	443
F. Limestone Handling and Storage.....	454 - 465
G. Coal Bunkers with Roto-Clones.....	476 - 487
H. Solid Fuel Yard.....	498 - 5049
I. Surface Coating of Miscellaneous Metal Parts.....	510 - 521
J. Abrasive Blasting.....	532 - 543
K. Surface Coating of Ships.....	554 - 654
L. Limestone Handling System for FGD System for Units 1 & 2.....	665 - 68
M. Lime Silo for Wastewater Treatment Plant for the Chloride Bleed Stream...	69 - 70
N. Common Conditions.....	71 - 75
O. Coal Residual Storage and Transfer.....	76
IV. Acid Rain Part.....	77 - 80

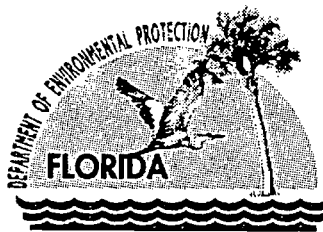

Department of Environmental Protection

Jeb Bush
Governor

Twin Towers Office Building
2600 Blair Stone Road
Tallahassee, Florida 32399-2400

Colleen M. Castille
Secretary

Permittee:
Tampa Electric Company
6944 US HWY 41
Apollo Beach, FL 33572-9200

DRAFT Permit No.: 0570039-017-AV
Facility ID No.: 0570039
SIC Nos.: 49, 4911
Project: Title V Air Operation Permit Revision/Renewal

This permit revision is for the purpose of incorporating the terms and conditions of the air construction permit, No. 0570039-012-AC, to make some administrative corrections, and to renew the current Title V permit. This permit is for the operation of the Tampa Electric Company (TEC) Big Bend Station. This facility is located at Big Bend Road, North Ruskin, Hillsborough County; UTM Coordinates: Zone 17, 361.9 km East and 3075.0 km North; Latitude: 27° 47' 36" North and Longitude: 82° 24' 11" West.

This Title V Air Operation Permit Revision/Renewal is issued under the provisions of Chapter 403, Florida Statutes (F.S.), and Florida Administrative Code (F.A.C.) Chapters 62-4, 62-210, 62-213 and 62-214. The above named permittee is hereby authorized to perform the work or operate the facility shown on the application and approved drawing(s), plans, and other documents, attached hereto or on file with the permitting authority, in accordance with the terms and conditions of this permit.

Referenced attachments made a part of this permit:

Appendix U-1, List of Unregulated Emissions Units and/or Activities
Appendix I-1, List of Insignificant Emissions Units and/or Activities
APPENDIX TV-4, TITLE V CONDITIONS (version dated 2/02/02)
APPENDIX SS-1, STACK SAMPLING FACILITIES (version dated 10/07/96)
TABLE 297.310-1, CALIBRATION SCHEDULE (version dated 10/07/96)
FIGURE 1 - SUMMARY REPORT-GASEOUS AND OPACITY EXCESS EMISSIONS AND MONITORING SYSTEM PERFORMANCE REPORT (version dated 7/96)
DOCUMENT III.I.6 - PROCEDURES FOR STARTUP AND SHUTDOWN UNITS 1 - 4
DOCUMENT III.I.7 - OPERATION AND MAINTENANCE PLAN (version dated 7/18/97)
40 CFR 60 Subpart A - General Provisions
40 CFR 63 Subpart A - General Provisions modified for Subpart II
40 CFR 63 Subpart II - § 63.782 Definitions
40 CFR 63 Subpart II - Figure 1. Flow diagram of compliance procedures
40 CFR 63 Subpart II - TABLE 2 VOLATILE ORGANIC HAP (VOHAP) LIMITS FOR MARINE COATINGS
40 CFR 63 Subpart II - TABLE 3 SUMMARY OF RECORDKEEPING & REPORTING REQUIREMENTS
40 CFR 63 Subpart II - APPENDIX A VOC DATA SHEET
40 CFR 63 Subpart II - APPENDIX B
DEP Form No. 62-210.900(1)(a)
Consent Final Judgement (DEP vs. TEC) dated December 6, 1999
Phase II NOx Compliance Plan
Phase II NOx Averaging Plan
Consent Decree (U.S. vs. TEC) dated February 29, 2000; amended October 4, 2000.
TEC Big Bend Station Unit 3 Corrective Action Plan - EPC Case No. 00-1223CCG0039
APPENDIX CAM

Effective Date: January 1, 2005
Renewal Application Due Date: December 31, 2008
Expiration Date: December 31, 2009

Michael G. Cooke, Director,
Division of Air Resources Management

MGC/CLP

"More Protection, Less Process"

Printed on recycled paper.

Section I. Facility Information.

Subsection A. Facility Description.

TEC Big Bend is a nominal 2,028 MW electric generation facility. This facility consists of four steam boilers (Units Nos. 1 through 4); four steam turbines; three simple-cycle combustion turbines (CT Nos. 1, 2, and 3); solid fuels, fly ash, limestone, gypsum, slag, and bottom ash storage and handling facilities, and fuel oil storage tanks. Units No. 1, 2, 3, and 4 have nominal maximum heat inputs of 4037, 3996, 4115 and 4330 million BTU per hour, respectively. Units No. 1 through 4 are fired with coal and with petcoke in a mixture with coal up to 20.0% petcoke/80.0% coal (by weight), or a coal blended with coal residual generated from the Polk Power Station, or a coal/petroleum coke blend further blended with coal residual generated from the Polk Power Station. The combustion turbines are fired with No. 2 distillate fuel oil. In addition, there is a ship surface coating operation.

Also included in this permit are miscellaneous unregulated emissions units and insignificant emissions units and/or activities.

Based on the initial Title V permit application received June 14, 1996, this facility is a major source of hazardous air pollutants (HAPs).

Overview of the facility's operation:

Solid fuel is unloaded from ship/barge into the solid fuel yard, the blending bins or directly to the tripper room via belt conveyors. Solid fuel from the piles is loaded onto belt conveyors using a rail mounted or mobile reclaimer. The solid fuel is then belt conveyed to the blending bins tower, which consists of six storage bins, where the solid fuel may be blended for use at the plant, or transloaded into trucks for shipment off site. ~~From the solid fuel yard conveyors, the solid fuel is screw conveyed into the bins.~~ Particulate matter (PM) emissions from the conveyors in the solid fuel yard blending bins are controlled by 3 4 rotoclones, one at the conveyor drop and one for every 2 bins. ~~PM emissions from the screw conveyor are controlled by the fourth rotoclone.~~ Blending bins can either ~~Each has 2 hoppers, which feed the transloader, or solid fuel can be~~ are conveyed, via 2 parallel belts (T1, T2) to 2 crushers (each belt has a crusher), or diverted directly to the tripper room. PM emissions from the 2 crushers and transfer tower are controlled by 2 rotoclones.

~~From the tripper room solid fuel yard, the solid fuel is conveyed to the tripper room where 2 trippers bunker the solid fuels into 4 solid fuel bunkers. Each unit has its own respective bunker. Solid fuel samples are taken every 15 minutes during bunking, and composited for analysis.~~ From the bunkers, the solid fuel is gravity fed into 14 crushers mills, and then gravity fed into the boilers. There are 3 ball mills ~~crushers~~, each for Unit Nos. 1 - 3, and 5 bowl mills ~~crushers~~ for Unit No. 4. From the mills ~~crushers~~, the solid fuel is pneumatically fed into classifiers, two for each mill on Unit Nos. 1-3 and one for each mill on Unit No. 4 ~~crusher~~ for a total of 238 classifiers, and then into the respective boilers.

PM emissions from Boiler Nos. 1-4 are controlled by individual Electrostatic Precipitators (ESPs). Unit Nos. 1-4 PM emissions are controlled by an ESP, and the SO₂ emissions are controlled by an FGD scrubber systems. When Unit Nos. 1-3 burns petroleum coke, the exhaust gases, following particulate

matter removal by the units' ESPs, will be routed to the inlet of the Unit No. 4 flue gas desulfurization (FGD) system scrubber. In this integrated mode, Unit No. 3 will meet the same sulfur dioxide emissions limitations as Unit No. 4. The FGD scrubber will continue to treat the exhaust gas from Unit No. 4. The FGD scrubber outlet stream, consisting of the combined Unit No. 3 and Unit No. 4 treated exhaust, will then be split and discharged through stacks CS002 and CS003.

Fly ash from Units No. 1 and No. 2 is vented into Fly Ash Silo #1 which is controlled by a baghouse. Fly ash from Unit No. 3 is vented into Silo #2, which can also receive fly ash from Units No. 1 and 2, while fly ash from Unit No. 4 is vented into Silo #3. The fly ash from each silo is then loaded into trucks and transported off site, while the bottom ash from Unit No. 4 is conveyed across Big Bend Road south of the Big Bend facility to a settling pond. Each fly ash silo is controlled by a baghouse.

The byproduct gypsum is conveyed to the east side of the plant for dewatering and transporting off site. Limestone is unloaded to an underground hopper conveyor belt system to the limestone storage building on the east side of the by-product gypsum area. Particulate matter emissions from the limestone trucks unloading is controlled by a baghouse. From the storage building, limestone is belt conveyed into 2-3 storage silos and then gravity fed into the mill room. Two Three rotary mills grind the limestone and mix it with water to form a slurry that is stored in 2-3 storage tanks for use in the FGD. The slurry is then pumped to the 4 reaction tanks of Units 1-4 scrubbers that are located directly south of and adjacent to the absorption towers of the FGD scrubber. Gypsum is sold and transported offsite and can be stored south of Big Bend Road prior to offsite removal. Most of the by-product gypsum is wallboard grade, however, gypsum that is produced during start up, shutdown or upset conditions is de-watered and belt-conveyed across the street to the southeast of the plant for drying and transportation off site.

There are 3-combustion turbines (CT) manufactured by Westinghouse. They are all fired on No. 2 fuel oil. Unit CT No. 1 is near the plant and Unit CT Nos. 2 and 3 are on the north side of the property. There is a large No. 2 fuel oil storage tank near Unit CT Nos. 2 and 3 and a small day tank near Unit CT No. 1.

Subsection B. Summary of Emissions Unit ID Nos. and Brief Descriptions.

E.U.

<u>ID No.</u>	<u>Brief Description</u>
-001	Unit No. 1 Steam Generator
-002	Unit No. 2 Steam Generator
-003	Unit No. 3 Steam Generator
-004	Unit No. 4 Steam Generator
-005	Combustion Turbine No. 2
-006	Combustion Turbine No. 3
-007	Combustion Turbine No. 1
-008	Fly Ash Silo No. 1 Baghouse
-009	Fly Ash Silo No. 2 Baghouse
-010	Solid Fuel Yard, Fugitive Emissions
-011	Truck Unloading of Limestone
-012	Limestone Silo A with one baghouse and one backup baghouse
-013	Limestone Silo B with one baghouse and one backup baghouse

<u>E.U.</u> <u>ID No.</u>	Subsection B. Summary of Emissions Unit ID Nos. and Brief Descriptions. (continued) <u>Brief Description</u>
-014	Fly Ash Silo No. 3 Baghouse
-015	Unit No. 1 Coal Bunker
-016	Unit No. 2 Coal Bunker
-017	Unit No. 3 Coal Bunker
-018	Flyash Silo No. 1 Truck Loadout
-019	Flyash Silo No. 2 Truck Loadout
-020	Drops from limestone handling conveyors LE, LF, and LG and silo C belt feeder with baghouse
-021	Silo C with one baghouse
-022	Lime silo with one baghouse for the waste water treatment plant for the chloride bleed stream
-023	Limestone Handling Conveyor LB to Conveyor LC with baghouse Limestone Handling Conveyor LD to Conveyor LE with baghouse
-024	Limestone Handling Conveyor LE to South Storage Silo with baghouse Limestone Handling Conveyor LE to North Storage Silo with baghouse
-025	Limestone Storage and Handling Fugitive Emissions
-026	Fly Ash Handling and Storage Fugitive Emissions from Unit Nos. 1-3 (all except silos)
-027	Fly Ash Silo No. 3 Truck Loadout
-028	Fly Ash Handling System Fugitive Emissions from Unit No. 4
-029	Cyclone collectors for fuel blending bins (FH-032 and FH-035)
-030	Cyclone collectors for fuel crushers (FH-048 and FH-049)
-031	Cyclone collectors for bunkers (FH-059 through FH-062)
-032	Surface coating of miscellaneous metal parts
-033	Abrasive Blast Booth with baghouse
-034	Abrasive Blast Media Storage with baghouse
-035	Surface coating of ships
-037	Coal Residual Storage Building
-038	Coal Residual Transfer System
-039	Unit No. 4 Coal Bunker
-036	Unregulated Emissions Units and/or Activities

Please reference the Permit No., Facility ID No., and appropriate Emissions Unit(s) ID No(s). on all correspondence, test report submittals, applications, etc.

Subsection C. Relevant Documents.

The documents listed below are not a part of this permit; however, they are specifically related to this permitting action.

These documents are provided to the permittee for information purposes only:
Appendix A-1, Abbreviations, Acronyms, Citations, and Identification Numbers
Appendix H-1, Permit History

These documents are on file with the permitting authority:

Initial Title V Permit issued December 28, 2000.

Title V Permit Revision issued August 15, 2001.

Form dated November 5, 2002, changing the Responsible Official.

Letter dated November 12, 2003, adding an Alternate Designated Representative.

Application for Air Construction Permit dated December 31, 2003.

Application for a Title V Air Operation Permit Revision received January 16, 2004.

Application for Air Construction Permit dated May 18, 2004.

Application for a Title V Air Operation Permit Revision received January 16, 2004

Additional information dated September 24, 2004.

Section II. Facility-wide Conditions.

The following conditions apply facility-wide:

1. APPENDIX TV-4, TITLE V CONDITIONS, is a part of this permit.

{Permitting note: APPENDIX TV-4, TITLE V CONDITIONS, is distributed to the permittee only. Other persons requesting copies of these conditions shall be provided a copy when requested or otherwise appropriate.}

2. **Not federally enforceable.** General Pollutant Emission Limiting Standards. Objectionable Odor Prohibited. No person shall cause, suffer, allow, or permit the discharge of air pollutants which cause or contribute to an objectionable odor.

[Rule 62-296.320(2), F.A.C.]

3. General Particulate Emission Limiting Standards. General Visible Emissions Standard.

Except for emissions units that are subject to a particulate matter or opacity limit set forth or established by rule and reflected by conditions in this permit, no person shall cause, let, permit, suffer or allow to be discharged into the atmosphere the emissions of air pollutants from any activity, the density of which is equal to or greater than that designated as Number 1 on the Ringelmann Chart (20 percent opacity). EPA Method 9 is the method of compliance pursuant to Chapter 62-297, F.A.C.

[Rules 62-296.320(4)(b)1. & 4., F.A.C.]

{Permitting Note: Although the Permittee is not required to perform a visible emissions compliance test to demonstrate compliance with the facility-wide limitations annually or before renewal, if the Department believes that the general visible emissions standard is being violated, the Department may require that the owner or operator perform a visible emissions compliance test per Chapter 62-297.310(7)(b), Special Compliance Tests. In addition, Department personnel who are certified to perform visible emissions tests may determine compliance with the general visible emissions standard.}

4. Prevention of Accidental Releases (Section 112(r) of CAA).

a. The permittee shall submit its Risk Management Plan (RMP) to the Chemical Emergency Preparedness and Prevention Office (CEPPO) RMP Reporting Center when, and if, such requirement becomes applicable. Any Risk Management Plans, original submittals, revisions or updates to submittals, should be sent to:

RMP Reporting Center
Post Office Box 3346
Merrifield, VA 22116-3346
Telephone: 703/816-4434
P.O. Box 1515

Lanham-Seabrook, Maryland 20703-1515
Telephone: 301/429-5018

and,

b. The permittee shall submit to the permitting authority Title V certification forms or a compliance schedule in accordance with Rule 62-213.440(2), F.A.C.

[40 CFR 68]

5. Unregulated Emissions Units and/or Activities. Appendix U-1, List of Unregulated Emissions Units and/or Activities, is a part of this permit.

[Rule 62-213.440(1), F.A.C.]

6. Insignificant Emissions Units and/or Activities. Appendix I-1, List of Insignificant Emissions Units and/or Activities, is a part of this permit.

[Rules 62-213.440(1), 62-213.430(6) and 62-4.040(1)(b), F.A.C.]

7. General Pollutant Emission Limiting Standards. Volatile Organic Compounds (VOC) Emissions or Organic Solvents (OS) Emissions. The permittee shall allow no person to store, pump, handle, process, load, unload or use in any process or installation, volatile organic compounds or organic solvents without applying known and existing vapor emission control devices or systems deemed necessary and ordered by the Department. Nothing was deemed necessary and ordered at this time.

[Rule 62-296.320(1)(a), F.A.C.]

8. Emissions of Unconfined Particulate Matter. Unconfined particulate matter emissions that may result from operations include: vehicular traffic on paved and unpaved roads; wind-blown dust from yard areas; and periodic abrasive blasting. Pursuant to Rules 62-296.320(4)(c)1., 3. & 4., F.A.C., reasonable precautions to prevent emissions of unconfined particulate matter at this facility include the following requirements (see Condition 57. of APPENDIX TV-4, TITLE V CONDITIONS):

The following requirements are “not federally enforceable”: The following techniques will be used to prevent unconfined particulate matter emissions on an as needed basis:

- a. Chemical or water application to: unpaved roads and unpaved yard areas;
- b. Paving and maintenance of roads, parking areas and yards;
- c. Landscaping or planting of vegetation;
- d. Confining abrasive blasting where possible; and
- e. Other techniques, as necessary.

[Rule 62-296.320(4)(c)2., F.A.C.; and, proposed by the applicant in the initial Title V permit application received June 14, 1996.]

9. When appropriate, any recording, monitoring, or reporting requirements that are time-specific shall be in accordance with the effective date of the permit, which defines day one.

[Rule 62-213.440, F.A.C.]

10. Statement of Compliance. The annual statement of compliance pursuant to Rule 62-213.440(3)(a)2., F.A.C., shall be submitted to the Department and EPA within 60 (sixty) days after the end of the calendar year using DEP Form No. 62-213.900(7), F.A.C.

[Rules 62-213.440(3) and 62-213.900, F.A.C.]

{Permitting Note: This condition implements the requirements of Rules 62-213.440(3)(a)2. & 3., F.A.C. (see Condition 51. of APPENDIX TV-4, TITLE V CONDITIONS)}

11. The Consent Final Judgement (DEP vs. TEC) dated December 6, 1999; and the Consent Decree (U.S. vs. TEC) dated February 29, 2000, including the October 4, 2000 amendment; are attached hereto and made a part of this permit. The permittee shall comply with the Consent Final Judgement and the Consent Decree. Wherever the Consent Decree conflicts with this permit the terms and conditions of the

Consent Decree control. Upon expiration of the Consent Decree the Title V permit shall be modified to incorporate any terms and conditions that are deemed necessary by the permitting authority for the continued operation of the facility.

[Rules 62-4.070(3)&(5) and 62-213.440, F.A.C.]

12. Unless otherwise stated in a specific condition, averaging times for specified emission standards are based on the run time of the test method(s) used for determining compliance.

[Rule 62-4.070(3), F.A.C.]

13. a. The permittee shall submit all compliance related notifications and reports required of this permit to the Environmental Protection Commission of Hillsborough County:

Environmental Protection Commission
of Hillsborough County
1410 North 21 Street
Tampa, Florida 33605
Telephone: 813/272-5530
Fax: 813/272-5605

b. The permittee shall provide timely notification to the Environmental Protection Commission of Hillsborough County prior to implementing any changes that may result in a modification to this permit. The changes may include, but are not limited to, the following, and may also require prior authorization before implementation:

1. Alteration or replacement of any equipment* or parameter listed in the Facility or Subsection descriptions.
2. Installation or addition of any equipment* which is a source of air pollution.
3. Any changes in the method of operation, raw materials, products of fuels.

*Not applicable to normal maintenance and repairs, and vehicles used for transporting material.

[Rules 62-4.070(3) and 62-210.300, F.A.C.]

14. Any reports, data, notifications, certifications, and requests required to be sent to the United States Environmental Protection Agency, Region 4, should be sent to:

United States Environmental Protection Agency
Region 4
Air, Pesticides & Toxics Management Division
Air and EPCRA Enforcement Branch, Air Enforcement Section
61 Forsyth Street
Atlanta, Georgia 30303
Telephone: 404/562-9155, Fax: 404/562-9163

15. Certification by Responsible Official (RO). In addition to the professional engineering certification required for applications by Rule 62-4.050(3), F.A.C., any application form, report, compliance statement, compliance plan and compliance schedule submitted pursuant to Chapter 62-213, F.A.C., shall contain a certification signed by a responsible official that, based on information and belief formed after reasonable inquiry, the statements and information in the document are true, accurate, and complete. Any responsible official who fails to submit any required information or who has submitted incorrect information shall, upon becoming aware of such failure or incorrect submittal, promptly submit such supplementary information or correct information.

[Rule 62-213.420(4), F.A.C.]

Section III. Regulated Emissions Units Conditions.

Subsection A. Steam Generators Units Nos. 1, 2, & 3

This section addresses the following Regulated Emissions Units:

<u>E.U. ID No.</u>	<u>Brief Description</u>
-001	Unit No. 1 Steam Generator
-002	Unit No. 2 Steam Generator
-003	Unit No. 3 Steam Generator

Descriptions. The fuel fired in Units No. 1, No. 2, and No. 3 consists of coal, or a coal/petroleum coke blend containing a maximum of 20% petroleum coke by weight, or coal blended with coal residual generated from the Polk Power Station, or a coal/petroleum coke blend further blended with coal residual generated from the Polk Power Station.

Unit No. 1 is a fossil fuel fired steam boiler generating unit rated at 4037 MMBtu/hour with an electrical generating capacity of 445 MW. It is a "wet" bottom utility boiler manufactured by Riley Stoker Corporation. Unit No. 1 began commercial operation in 1970.

Unit No. 2 is a fossil fuel fired steam boiler generating unit rated at 3996 MMBtu/hour with an electrical generating capacity of 445 MW. It is a "wet" bottom utility boiler manufactured by Riley Stoker Corporation. Unit No. 2 began commercial operation in 1973.

Unit No. 1 and Unit No. 2 share two common stacks (Stacks CS001 and CS0W1). Particulate emissions generated during the operation of the units are controlled by dry electrostatic precipitators (ESPs) manufactured by Western Precipitator Division, Joy Manufacturing Corporation. ESP control efficiency is 99.7%. Whenever either unit is fired with petcoke in any amount up to the allowable ratio (20% petcoke/80% coal, by wt.), its flue gases must be directed from its ESP to the FGD system and then to stack CS0W1. Otherwise, if petcoke is not fired, the flue gases may bypass the FGD system and stack CS0W1, and the flue gases are routed from the ESP directly to stack CS001.

Unit No. 3 is a fossil fuel fired steam boiler generating unit rated at 4115 MMBtu/hour with an electrical generating capacity of 445 MW. It is a "wet" bottom utility boiler manufactured by Riley Stoker Corporation. Operation of this unit may include diverting all of the flue gas into the existing Big Bend Unit No. 4 flue gas desulfurization (FGD) system for sulfur dioxide emission reduction. Sulfur dioxide emissions that are generated and not diverted through the Unit No. 4 FGD system are uncontrolled. Particulate matter emissions generated during the operation of the unit are controlled by a dry electrostatic precipitator (ESP) manufactured by Research-Cottrell, Inc. The ESP control efficiency is 99.7%. Unit No. 3 began commercial operation in 1976.

{Permitting note: Units No. 1, No. 2, and No. 3 are regulated under the federal Acid Rain Program for Phase II SO₂ and NO_x, adopted and incorporated by reference in Rule 62-204.800, F.A.C.; and regulated under 62-296.405, F.A.C. These units were also formerly regulated under the federal Acid Rain Program as Phase I SO₂ substitution units.}

The following specific conditions apply to the emissions units listed above:

ESSENTIAL POTENTIAL TO EMIT (PTE) PARAMETERS

A.1. Capacity. The maximum permitted heat input rate for each unit is as follows:

<u>Unit No.</u>	<u>MMBTU/hr</u>
1	4037
2	3996
3	4115

[Rules 62-4.160(2), 62-210.200(PTE) and 62-296.405, F.A.C.]

{Permitting note: The heat input limitations have been placed in this permit to identify the capacity of each unit for the purposes of confirming that emissions testing is conducted within 90 to 100 percent of the unit's rated capacity (or to limit future operation to 110 percent of the test load), to establish appropriate emission limits and to aid in determining future rule applicability. Regular recordkeeping, other than annual, is not required for heat input. Instead the owner or operator is expected to determine heat input whenever emission testing is required, to demonstrate at what percentage of the rated capacity that the unit was tested. Rule 62-297.310(5), F.A.C., requires measurement of the process variables for emission tests. Such heat input determination may be based on measurements of fuel consumption by various methods to calculate average hourly heat input during the test. Annual heat input must be calculated in order to determine annual emissions of pollutants whose limits are based upon heat input.}

A.2. Methods of Operation - Fuels.

a. Normal operation: The fuel fired in Units No. 1, No. 2, and No. 3 shall consist of coal, or a coal/petroleum coke blend containing a maximum of 20% petroleum coke by weight, or coal blended with coal residual generated from the Polk Power Station, or a coal/petroleum coke blend further blended with coal residual generated from the Polk Power Station. In any case, the petroleum coke content of any fuel blend shall not exceed 20% by weight. The vanadium content of the petroleum coke fired shall not exceed 2660 ppm vanadium. The ash content of the petroleum coke fired shall not exceed 0.76% by weight on a dry basis. The permittee shall maintain and submit to the Department, and to the Environmental Protection Commission of Hillsborough County, on an annual basis for the years 2001, 2002, 2003, 2004, and 2005 data demonstrating that removal of the sulfur content limit and the revision of the vanadium content limit in the petroleum coke fired did not result in a significant increase in the representative actual annual emissions of any regulated pollutant.

b. Other operation:

i. In addition to the fuels allowed to be burned during normal operation, each unit may also burn new No. 2 fuel during startup, shutdown, flame stabilization, and during the start of a mill on an already operating unit.

ii. Evaporation of up to 150,000 gallons per year, total at the facility, is allowed of non-hazardous, but potentially HAP-emitting, mineral acid solution boiler chemical cleaning waste which was generated on site.

c. Beneficiated, or refined, coal residual: The total amount of beneficiated, or refined, coal residual fired at Big Bend Station (all Unit Nos. 1-4 combined) shall be limited to 500 tons per day. The beneficiated, or refined, coal residual results from using the beneficiated process, described in permit application 0570039-012-AC, to wash and screen the raw coal residual to remove fines and oversized materials. This beneficiation process shall be performed at Polk Power Station, not Big Bend Station.

d. Raw coal residual: The total amount of raw coal residual fired at Big Bend Station (all Unit Nos. 1-4 combined) shall be limited to 200 tons per day. The raw coal residual is a by-product of the gasification of coal at the Polk Power Station. At the time of the issuance of permit 0570039-012-AC on

October 4, 2001, there were approximately 100,000 tons of raw coal residual stored at Polk Power Station. Once this raw coal residual pile has been fired, TEC shall only fire raw coal residual in the event of a significant beneficiation process malfunction. TEC shall document all beneficiation process malfunctions and record the amount of raw coal residual, if any, fired at Big Bend Station. These records should be kept on site at Big Bend and made readily available to the Department and the Environmental Protection Commission of Hillsborough County upon request.
[Rules 62-4.070(3), 62-4.160(2), 62-210.200, and 62-213.440(1), F.A.C.; 0570039-012-AC]

{Permitting note: "Flame stabilization" is defined as the use of new No. 2 fuel oil to stabilize a flame during times of unexpected poor coal quality or equipment failure such as coal piping pluggage. Flame stabilization due to poor coal quality occurs when coal is wet or does not provide the necessary heat to maintain a stable flame. In this situation, new No. 2 fuel oil is combusted to provide the additional required heat input to maintain a stable flame. Flame stabilization due to equipment failure occurs when coal piping is plugged, or equipment is otherwise damaged, that results in an inconsistent amount of coal reaching the burners. Under certain conditions, this may result in the burners intermittently seeing large amounts of fuel at one time, causing a potentially explosive flame "puff". In this situation, new No. 2 fuel oil must be used for stabilization to prevent flame "puffing" and ensure safe operation. Combustion of No. 2 fuel oil is also necessary during periods of load change to initialize and stabilize the flame until coal flow to the burners reaches steady state. As defined in 62-210.700(3), F.A.C., Load change occurs when the operational capacity of a unit is in the 10 to 100 percent capacity range, other than startup or shutdown, which exceeds 10 percent of the unit's rated capacity and which occurs at a rate of 0.5 percent per minute or more.}

A.3. FGD Operation Required for Petcoke and Coal Residual:

- a. Whenever emissions Unit No. 1 or No. 2 is fired with petcoke in any amount up to the allowable percentage, or any amount of coal residual, its flue gases shall be directed to FGD system for Units No. 1 and No. 2.

[Permit Nos. 0570039-003-AC, 0570039-004-AC, and 0570039-012-AC]

{Note: The owner or operator may operate each emissions unit without directing its emissions to the FGD system whenever neither petcoke nor coal residual is being fired in the emissions unit.}

{Note: The excess emissions provisions of specific condition A.11. of this permit are also applicable to the FGD system operation.}

- b. The permittee is allowed to divert and integrate all of Unit No. 3 flue gas for purposes of treating that flue gas in the existing Unit No. 4 flue gas desulfurization (FGD) system. At all times while firing any permitted amount of petroleum coke or coal residual, Unit No. 3 shall operate only in the integrated mode except during startups, shutdowns, and/or malfunctions during all of which best operational practices shall be employed including the cessation of petroleum coke and/or coal residual bunkering.

[Rule 62-4.070(3), F.A.C., 40 CFR 60.40a; and Permit Nos. PSD-FL-040 and 0570039-012-AC]

A.4. Limit on Petcoke Bunkering: The owner or operator at any given time shall not bunker more than the amount of petcoke that may be fired in each emissions Unit No. 1 or No. 2 in one day. [0570039-003-AC and 0570039-004-AC]

[Note: This condition is intended to limit possible excess emissions in the event of an unexpected breakdown of the FGD system that requires its shutdown while either emissions unit is firing petcoke.]

A.5. Hours of Operation. Unit No. 1, Unit No. 2, and Unit No. 3 are each allowed to operate continuously, i.e., 8760 hours/year.
[Rule 62-210.200, F.A.C., Definitions (PTE)]

EMISSION LIMITATIONS AND STANDARDS

A.6. Except as provided in Specific Condition No. A.11., visible emissions from each unit shall not exceed 20% opacity except for one six-minute period per hour during which opacity shall not exceed 27%.
[Rule 62-296.405(1)(a), F.A.C.]

A.7. Except as provided in Specific Condition No. A.11., the particulate matter emission rate for each unit shall not exceed 0.1 pounds per million BTU heat input. {Permitting note: The averaging time for the emissions standard in this condition shall be equal to the cumulative run time required by the specified test method.}
[Rule 62-296.405(1)(b), F.A.C.]

A.8.

i. Unit Particulate Matter Emission Limits: Based on the maximum permitted heat input rates listed in Specific Condition A.1., the maximum permitted particulate matter annual emission rate for each unit is as follows:

<u>Unit No.</u>	<u>tons/yr</u>
1	1768
2	1750
3	1802

In the event that a maximum permitted heat input rate for a unit is reduced, the maximum annual permitted particulate matter emission rate for that unit shall also be reduced accordingly.
[Rule 62-296.700(4)(b)1., F.A.C.]

ii. Facility-wide Particulate Matter Emission Limit: In order to provide reasonable assurance that a significant net emission rate increase will not occur as a result of combusting raw and beneficiated coal residual at Big Bend, the combined emissions from Steam Generator Units 1-4 shall not exceed an annual emissions cap of 2,767 tons per year of PM/PM₁₀. This cap corresponds to the average emissions of the years 1999 and 2000. Any relaxation in this limit that increases the facility's potential to emit by at least 1 ton of pollutant per year will result in a reevaluation of PSD applicability for the facility as though construction had not yet commenced at the facility.
[Rule 62-212.400(2)(g) and Permit No. 0570039-012-AC]

A.9.

i. Unit Sulfur Dioxide Emission Limits. {Permitting Note: The Consent Final Judgement (DEP vs. TEC) dated December 6, 1999; and the Consent Decree (U.S. vs. TEC) dated February 29, 2000, including the October 4, 2000 amendment; which are part of this permit, supercede this specific condition. Wherever the Consent Decree conflicts with this permit condition, the Consent Decree takes precedence.}

a. Units No. 1, No. 2, and No. 3, each shall not emit more than 6.5 pounds of sulfur dioxide per million BTU heat input on a two-hour average; nor shall Units No. 1, No. 2, and No. 3, in total, emit

more than 31.5 tons per hour of sulfur dioxide on a three-hour average and 25 tons per hour of sulfur dioxide on a 24-hour block average (midnight to midnight).

[Rules 62-296.405(1)(c)2.b. and 3., F.A.C.; and Rule 62-204.240(1), F.A.C.]

b. Integrated Operation - While in the integrated mode Units No. 3 and 4 shall meet the pounds per million Btu and percent reduction sulfur dioxide limitations that are applicable to Unit No. 4. (Specific Conditions B.7. and B.8.). Unit 3 will be operated in this integrated mode except during unit or FGD startups, shutdowns, maintenance and/or malfunctions, during all of which best operational practices shall be employed, including the cessation of bunkering fuels that would emit higher than 6.5 lb SO₂ per MMBtu.

c. Units No. 1 and No. 2, in total, shall not emit more than 16.5 tons per hour of sulfur dioxide on a 24-hour block average.

d. Unit No. 3 shall not emit more than 8.5 tons per hour of sulfur dioxide on a twenty-four hour block average.

e. While scrubbing sulfur dioxide emissions, the following table lists the sulfur dioxide emissions limits (lbs/hr) for six different operating scenarios:

Operating Scenario	Operating Mode, Emission Limits (lbs/hour)			Averaging Period (Calendar day basis)
	Unit 1	Unit 2	Unit 3	
1	Scrubbed, 3310	Scrubbed*, 3277	Unscrubbed*, 14814	24 hours
2	Scrubbed, 3310	Unscrubbed, 9590	Unscrubbed, 9876	24 hours
3	Scrubbed, 3310	Scrubbed, 3277	Scrubbed, 3374	24 hours
4	Scrubbed, 3310	Unscrubbed, 11588	Scrubbed, 3374	24 hours
5	Unscrubbed, 11707	Scrubbed, 3277	Scrubbed, 3374	24 hours
6	Unscrubbed, 9689	Scrubbed, 3277	Unscrubbed, 9876	24 hours

*"Scrubbed" refers to operation while directing flue gas to the FGD system. "Unscrubbed" refers to operation while not directing flue gas to the FGD system.

[40 CFR 60.40a; Permit Nos. PSD-FL-040, 0570039-003-AC, and 0570039-004-AC; Applicant request.]

ii. Facility-wide Sulfur Dioxide Emission Limit. In order to provide reasonable assurance that a significant net emission rate increase will not occur as a result of combusting raw and beneficiated coal residual at Big Bend, the combined emissions from Steam Generator Units 1-4 shall not exceed an annual emissions cap of 71,810 tons per year of SO₂. This cap corresponds to the average emissions of the years 1999 and 2000. Any relaxation in this limit that increases the facility's potential to emit by at least 1 ton of pollutant per year will result in a reevaluation of PSD applicability for the facility as though construction had not yet commenced at the facility.

[Rule 62-212.400(2)(g) and Permit No. 0570039-012-AC]

A.10. Unit No. 3 shall not emit more than 0.70 of a pound of nitrogen oxides (expressed as NO₂) per million BTU heat input based upon a 30-day rolling average. [Rule 62-296.405(1)(d)4. and Rule 62-296.405(1)(e)4., F.A.C.]

A.11. Excess Emissions.

(1) Excess emissions resulting from startup, shutdown or malfunction of any emissions unit shall be permitted providing (a) best operational practices to minimize emissions are adhered to and (b) the duration of excess emissions shall be minimized but in no case exceed two hours in any 24 hour period unless specifically authorized by the Department or the Environmental Protection Commission of Hillsborough County (EPCHC) for longer duration.

(2) Excess emissions from existing fossil fuel steam generators resulting from startup or shutdown shall be permitted provided that best operational practices to minimize emissions are adhered to and the duration of excess emissions shall be minimized.

(3) Excess emissions from existing fossil fuel steam generators resulting from boiler cleaning (soot blowing) and load change shall be permitted provided the duration of such excess emissions shall not exceed 3 hours in any 24-hour period and visible emissions shall not exceed Number 3 of the Ringelmann Chart (60 percent opacity), and providing (a) best operational practices to minimize emissions are adhered to and (b) the duration of excess emissions shall be minimized. A load change occurs when the operational capacity of a unit is in the 10 percent to 100 percent capacity range, other than startup or shutdown, which exceeds 10 percent of the unit's rated capacity and which occurs at a rate of 0.5 percent per minute or more. Visible emissions above 60 percent opacity shall be allowed for not more than 4, six (6)-minute periods, during the 3-hour period of excess emissions allowed by this specific condition A.11.(3), for boiler cleaning and load changes, at units which have installed and are operating continuous opacity monitors. Particulate matter emissions shall not exceed an average of 0.3 lbs. per million BTU heat input during the 3-hour period of excess emissions allowed by this specific condition A.11.(3).

(4) Excess emissions which are caused entirely or in part by poor maintenance, poor operation, or any other equipment or process failure which may reasonably be prevented during startup, shutdown, or malfunction shall be prohibited.

(5) In case of excess emissions resulting from malfunctions, TECO shall notify the EPCHC in accordance with Rule 62-4.130, F.A.C. A full written report on the malfunctions shall be submitted in a quarterly report, if requested by the permitting authority or the EPCHC.
[Rule 62-210.700, F.A.C.]

TEST METHODS AND PROCEDURES

{Permitting note: Table 2-1, Summary of Compliance Requirements, summarizes information for convenience purposes only. This table does not supersede any of the terms or conditions of this permit.}

A.12. During each federal fiscal year (October 1 - September 30), unless otherwise specified by rule, order, or permit, the TEC shall have formal compliance tests conducted on each Steam Generator Unit. Unit No. 1, Unit No. 2, and Unit No. 3 shall each be individually stack tested for particulate matter and visible emissions, under both sootblowing and non-sootblowing operation conditions. When testing in CS0W1 or when testing in CS001, Unit No. 1 shall not be in operation during the compliance testing of Unit No. 2, and Unit No. 2 shall not be in operation during the compliance testing of Unit No. 1, but when testing in the ductwork between CS001 and the scrubber tower inlet, Unit No. 1 may operate during the compliance testing of Unit No. 2 and Unit No. 2 may operate during the compliance testing of Unit No. 1. Testing of Unit No. 3 emissions shall be prior to their mixing with the exhaust from the scrubber for Unit No. 4.

[Rules 62-297.310(7)(a)2. and 4., and 62-4.070(3), F.A.C.]

A.13. The test method for visible emissions shall be DEP Method 9, incorporated in Chapter 62-297, F.A.C. In lieu of Method 9 testing, a transmissometer utilizing a 6-minute block average for opacity measurement may be used, provided such transmissometer is installed, certified, calibrated, operated and maintained in accordance with the provisions of 40 CFR Part 75.
[Rule 62-296.405(1)(e)1., F.A.C., and request of applicant.]

A.14. The test methods for particulate emissions shall be EPA Methods 17, 5, 5B, or 5F, incorporated and adopted by reference in Chapter 62-297, F.A.C. The minimum sample volume shall be 30 dry standard cubic feet. EPA Method 5 may be used with filter temperature at no more than 320 degrees Fahrenheit. For EPA Method 17, stack temperature shall be less than 375 degrees Fahrenheit. The owner or operator may use EPA Method 5 to demonstrate compliance. EPA Method 3 or 3A with Orsat analysis shall be used when the oxygen base F-factor computed according to EPA Method 19 is used in lieu of heat input. Acetone wash shall be used with EPA Method 5 or 17.
[Rule 62-296.405(1)(e)2., F.A.C.]

A.15. Compliance testing for particulate matter emissions and visible emissions may be conducted either: (a) without fly ash re-injections occurring, or (b) while fly ash collected by the electrostatic precipitator is being re-injected into the boiler at a rate which is representative of the maximum anticipated fly ash re-injection rate. If the most recent particulate and visible emission compliance tests were conducted without fly ash re-injection occurring, and fly ash re-injection occurs for any reason other than a malfunction, then the results from new particulate and visible emissions compliance tests, conducted while fly ash collected by the precipitator is being re-injected into the boiler at a rate which is representative of the maximum anticipated fly ash re-injection rate, shall be submitted to the EPCHC within 60 days of the date that such fly ash re-injection occurred. The EPCHC may, for good cause shown, grant an extension of the 60-day time limit on a case-by-case basis.
[AO29-219924, AO29-179912, and AO29-179911]

A.16. Petcoke Sulfur Content: ~~Until January 1, 2006,~~ The owner or operator shall measure the sulfur content of representative samples of all petcoke received using appropriate ASTM methods to demonstrate compliance with the sulfur content limit of this permit. [Permit Nos. 0570039-003-AC & 0570039-004-AC]

A.17. Monitor Petcoke Usage: The owner or operator shall operate and maintain equipment to record and calculate the weight percentage of petcoke and coal bunkered and fired in each emissions unit, to verify compliance with the bunkering limit and the percentage limitation on petcoke usage of this permit.
[Rule 62-4.070(3), F.A.C.]

A.18. The permittee shall demonstrate compliance with the sulfur dioxide limits in Specific Condition A.9. by means of continuous emissions monitoring systems (CEMS). In addition to any other requirements associated with the operation and maintenance of these CEMS (i.e., Acid Rain requirements), operation of the CEMS shall be in accordance with the requirements listed in Specific Condition A.19. The annual calibration RATA associated with these CEMS may be used in lieu of the required annual EPA Reference Method 6, as long as all of the requirements of Rule 62-297.310, F.A.C., are met (i.e., prior test notification, proper test result submittal, etc.). [Applicant request.]

A.19. Continuous Monitor Performance Specifications. If continuous monitoring systems are required by rule or are elected by the permittee to be used for demonstrating compliance with the standards of the Department, they must be installed, maintained and calibrated, either:

(a) in accordance with the EPA performance specifications listed below. These Performance Specifications are contained in 40 CFR 60, Appendix B, and are adopted by reference in Rule 62-204.800, F.A.C.

(1) [Reserved]

(2) Performance Specification 2--Specifications and Test Procedures for SO₂ Continuous Emission Monitoring Systems in Stationary Sources.

(3) [Reserved], Or,

(b) in accordance with the applicable requirements of 40 CFR 75, Subparts B and C. Excess emissions pursuant to Rule 62-210.700, F.A.C., shall be determined using the 40 CFR part 75 CEMS.

[Rule 62-297.520, F.A.C.; 40 CFR 75; and, Applicant request.]

A.20. Compliance with nitrogen oxides emission limit for Unit No. 3 shall be demonstrated continuously based upon a 30-day rolling average. The 30-day rolling average shall be determined by calculating the arithmetic average of all hourly emission rates for NO_x for the 30 successive boiler operating days, except for data obtained during startup, shutdown, and malfunction. The calculations shall be consistent with the equations in 40 CFR 60, Appendix A, Reference Method 19. For the purpose of calculating a 30-day rolling average, a boiler operating day is defined as a 24-hour period (between 12:01 a.m. and 12:00 midnight) during which fossil fuel is combusted in a steam operating unit for the entire 24-hours. [Permit No. AO29-179911 (July 29, 1994 amendment); 40 CFR 60.46a(g)]

A.21. The continuous emission monitors shall meet the quality assurance requirements and performance specifications contained in 40 CFR 75.

[Rule 62-296.401(1)(e)4., F.A.C.]

A.22. Test procedures shall meet all applicable requirements of Chapter 62-297, F.A.C.

[Rule 62-296.401(1)(e)5., F.A.C.]

A.23. For Units No. 1, No. 2, and No. 3, TEC shall operate, calibrate, and maintain a continuous monitoring system for continuously monitoring opacity. For Unit Nos. 1-3, TECO shall also operate, calibrate, and maintain a continuous monitoring system for continuously monitoring nitrogen oxides (expressed as NO₂). In addition, TEC shall operate, calibrate, and maintain a continuous monitoring system for continuously monitoring sulfur dioxide for Unit Nos. 1, 2, and 3 in a manner sufficient to demonstrate compliance with the emission limits of this permit. Performance specifications, location of monitor, data requirements, data reduction and reporting requirements shall conform with the requirements of 40 CFR Part 51, Appendix P, adopted and incorporated by reference in Rule 62-204.800(2), F.A.C., and 40 CFR Part 60, Appendix B, adopted by reference in Rule 62-204.800(7), F.A.C. [Rule 62-296.401(1)(f), F.A.C.]

A.24. An oxygen or carbon dioxide continuous monitoring system shall be operated for Units No. 1-3. Measurements of oxygen or carbon dioxide in the flue gas shall be utilized to convert nitrogen oxides and sulfur dioxide continuous emission monitoring data to units of pounds per million BTU heat input for proof of compliance.

[Rule 62-296.401(1)(f)1.d., F.A.C.]

REPORTING AND RECORD KEEPING REQUIREMENTS

A.25. Records of Operation: The owner or operator shall make and maintain a daily record of operation of each emissions unit showing the date, fuel(s) used, whether flue gas was directed to the FGD system, and the duration of all startups, shutdowns and malfunctions. Records of fuel bunkering and petcoke usage (weight percent of petcoke fired) shall also be made on at least a daily basis. Data that verifies compliance with the percentage limitation on petcoke usage shall be submitted with the annual operating report. [Rule 62-4.070(3), F.A.C.]

A.26. Records of Petcoke Sulfur Content: ~~Until January 1, 2006,~~ The owner or operator shall maintain records of petcoke sampling and analysis results performed as required by Specific Condition A.16. of this section. [Rule 62-4.070(3), F.A.C., and permit nos. 0570039-003-AC & 0570039-004-AC]

A.27. Quarterly Reporting Requirements: The owner or operator shall submit to the Department a written report of emissions in excess of emission limiting standards of this permit for each calendar quarter. The nature and cause of the excessive emissions shall be explained. This report does not relieve the owner or operator of the legal liability for violations. All recorded data shall be maintained on file for a period of five years. Copies of all submittals shall be submitted to the Air Management Division, Hillsborough County Environmental Protection Commission. [Rules 62-4.070(3) and 62-296.405(1)(g), F.A.C.]

A.28. For each unit, TEC shall submit to the EPCHC a written report of emissions in excess of the emission limiting standards as set forth in Rule 62-296.405(1), F.A.C., for each calendar quarter. The nature and cause of the excessive emissions shall be explained. This report does not relieve TEC of the legal liability for violations. All recorded data shall be maintained on file for a period of at least 5 years. The report shall be submitted within 30 days following each calendar quarter. [Rule 62-296.405(1)(g) and Rule 62-213.440(1)(b)2.b., F.A.C.]

A.29. For Unit No. ~~1~~ 3, gravimetric instrument data verifying that the 20.0% maximum petroleum coke content by weight has not been exceeded shall be maintained for two years and submitted to the Department and the EPCHC with each annual operating report. Also to be maintained and available for inspection shall be a record of operation showing the date, fuel used, mode of operation (integrated/non-integrated), and the duration of all startups, shutdowns and malfunctions. [Rule 62-4.070(3), F.A.C.]

A.30. ~~Until January 1, 2006,~~ For Unit No. 3, TEC shall maintain and submit to the Department and the EPCHC on an annual basis ~~for a period of 5 years from the date the unit begins firing petroleum coke,~~ data demonstrating that the operational change ~~of firing petcoke~~ did not result in an emissions increase. [Rule 62-4.070(3), F.A.C.]

A.31. For Unit No. 3, TEC shall submit a quarterly report to the Department and the EPCHC within 30 days following each calendar quarter. This report shall contain the 30-day NO_x rolling average, all time periods of boiler operation as well as a statement of CEM and/or boiler malfunction, start-up or shutdown.

[Permit No. AO29-179911 (July 29, 1994 amendment)]

A.32. Continuous Emission Monitoring Network and Alarms:

To demonstrate compliance with emission limits that are protective of AAQS, data inputs will consist of hourly CEM data from the SO₂, flow, and CO₂ monitors for Units 1-3 at Big Bend Station. TEC will use CEM data from common stack CS0W1 and/or CS001 to represent combined unit compliance with the emission limitations for each Unit 1 and Unit 2. When Unit 3 is operated in the integrated mode, TEC will use apportioned CEM data from both common stacks CS002 and CS003 to represent individual unit compliance with the emission limitations for Unit 3. In the event any monitor fails, TEC will comply with 40 CFR 75, Subpart D – Missing Data Substitution Procedures.

[Applicant request.]

A.33. Compliance Plan Verification:

1. *Frequency* – Reporting of compliance status shall be performed on a quarterly calendar basis. Reports will be due no later than 45 days following the last day of the reporting quarter.
2. *Content* – Quarterly reports will consist of:
 - a. two-hour average SO₂ emissions rate for each Units 1, 2, and 3 in lb/MMBtu;
 - b. three-hour average SO₂ emissions for Units 1-3 in ton per hour;
 - c. 24-hour average SO₂ emissions for Units 1-3 in tons per hour; and
 - d. 24-hour average SO₂ emissions for Units 1-2 and Unit 3 in tons per hour.

[Applicant request.]

A.34. These emissions units are subject to requirements contained in Consent Final Judgment (DEP vs. TEC) dated December 6, 1999 and the Consent Decree (U.S. vs. TEC) dated February 29, 2000, including the October 4, 2000 amendment.

[Permit No. 0570039-014-AC]

A.35. The first in a series of equipment installed pursuant to the Consent Final Judgment and Consent Decree for the purposes of NO_x requirements contained therein include:

- a. Steam Generator Units No. 1 – 3 are equipped with Low NO_x burners (LNB).
- b. Steam Generators Units 1 and 2 are equipped with coal and air flow monitoring equipment.
- c. Steam Generator Unit 2 is equipped with a neural network system that monitors the following parameters: excess O₂ bias, force draft fan balance bias, mill outlet temperature bias, rating damper bias, and mill bypass damper bias.

[Permit No. 0570039-014-AC]

A.36 Units 1, 2, and 3 shall be operated using the Low NO_x burners and in accordance with the operational procedures that have been developed to minimize NO_x emissions.

[Permit No. 0570039-014-AC]

A.37. These emissions units are subject to the Compliance Assurance Monitoring requirements contained in the attached APPENDIX CAM.

Subsection B. Steam Generator Unit No. 4 (and No. 3 in integrated mode)

This section addresses the following Regulated Emissions Units:

<u>E.U. ID No.</u>	<u>Brief Description</u>
-004	Unit No. 4 Steam Generator
-003	Unit No. 3 Steam Generator, only when operated in integrated mode.

Descriptions. Unit No. 4 is a 4330 MMBTU/hour, dry-bottom tangentially fired utility boiler. The generator nameplate capacity is 486 MW. Unit No. 4 began commercial operation in 1985. Particulate matter emissions generated during the operation of the unit are controlled by a dry electrostatic precipitator (ESP) manufactured by Belco. The control efficiency of the ESP is 99.7%. Sulfur dioxide emissions are controlled by flue gas desulfurization equipment manufactured by Research-Cottrell. The fuel fired in Unit No. 4 consists of coal, or a coal/petroleum coke blend containing a maximum of 20% petroleum coke by weight, or coal blended with coal residual generated from the Polk Power Station, or a coal/petroleum coke blend further blended with coal residual generated from the Polk Power Station.

As an option, Unit No. 3 exhaust gas, following particulate matter removal by the unit's ESP, will be routed to the inlet of the Unit No. 4 flue gas desulfurization (FGD) system scrubber. In this integrated mode, Unit No. 3 will meet the same sulfur dioxide emissions limitations as Unit No. 4. The FGD scrubber will continue to treat the exhaust gas from Unit No. 4. The FGD scrubber outlet stream, consisting of the combined Unit No. 3 and Unit No. 4 treated exhaust, will then be split and discharged through stacks CS002 and CS003. Stack CS002 does *not* include a recirculation duct to return exhaust gas to the inlet of the FGD scrubber. Continuous opacity monitoring systems (COMS) will be located at the outlet of Unit No. 3 and Unit No. 4 ESPs. Continuous SO₂ and CO₂ emissions monitoring systems (CEMS) will be located in stacks CS002 and CS003. Continuous NO_x emissions monitoring systems (CEMS) will be located in the inlet ducts of each unit. These monitoring systems will be used to determine compliance with all current applicable requirements.

{Applicable regulations for Unit No. 4: 40 CFR 60 Subpart Da, and the federal Acid Rain Program, Phase II SO₂ and NO_x, adopted and incorporated by reference in Rule 62-204.800, F.A.C.; PA 79-12, PSD-FL-040 and an ASP for Coal Sampling.}

The following conditions apply to the emissions unit listed above:

Essential Potential to Emit (PTE) Parameters

B.1. Capacity. The maximum permitted heat input rate for Unit No. 4 is 4330 MMBTU/hr.

[Rules 62-4.160(2), and 62-4.070(3), F.A.C.]

{Permitting note: The heat input limitation has been placed in this permit to identify the capacity of the unit for the purposes of confirming that emissions testing is conducted within 90 to 100 percent of the unit's rated capacity (or to limit future operation to 110 percent of the test load), to establish appropriate emission limits and to aid in determining future rule applicability. Regular recordkeeping, other than annual, is not required for heat input. Instead the owner or operator is expected to determine heat input whenever emission testing is required, to demonstrate at what percentage of the rate capacity that the unit was tested. Rule 62-297.310(5), F.A.C., requires measurement of the process variables for emission tests. Such heat input determination may be based on measurements of fuel consumption by various

methods to calculate average hourly heat input during the test. Annual heat input must be calculated in order to determine annual emissions of pollutants whose limits are based upon heat input.}

B.2. Methods of Operation - Fuels.

a. Normal operation: The fuel fired in Unit No. 4 shall consist of coal, or a coal/petroleum coke blend containing a maximum of 20% petroleum coke by weight, or coal blended with coal residual generated from the Polk Power Station, or a coal/petroleum coke blend further blended with coal residual generated from the Polk Power Station. In any case, the petroleum coke content of any fuel blend shall not exceed 20% by weight. The vanadium content of the petroleum coke fired shall not exceed 2660 ppm vanadium. The ash content of the petroleum coke fired shall not exceed 0.76% by weight on a dry basis. The permittee shall maintain and submit to the Department, and to the Environmental Protection Commission of Hillsborough County, on an annual basis for the years 2001, 2002, 2003, 2004, and 2005 data demonstrating that removal of the sulfur content limit and the revision of the vanadium content limit in the petroleum coke fired did not result in a significant increase in the representative actual annual emissions of any regulated pollutant.

b. Other operation:

i. In addition to the fuels allowed to be burned during normal operation, Unit No. 4 may also burn new No. 2 fuel during startup, shutdown, flame stabilization and during the start of an additional solid fuel mill pulverizer on an already operating unit.

ii. Evaporation of up to 150,000 gallons per year, total at the facility, is allowed of non-hazardous, but potentially HAP-emitting, mineral acid solution boiler chemical cleaning waste which was generated on site.

c. Coal shall not be burned in Unit No. 4 unless both the electrostatic precipitator and limestone scrubber are operating properly.

d. ~~Reserved~~ Coal burned in Unit No. 4 shall be washed before it is transported to the plant site. TEC shall maintain records of all coal washing and preparation activities for any coal which is to be fired in Big Bend Unit No. 4. These reports shall be submitted to the Department on a quarterly basis.

e. TEC shall maintain a daily log of the amounts and types of fuels used and copies of fuel analyses containing information on sulfur content, ash content and heating values.

f. Beneficiated, or refined, coal residual: The total amount of beneficiated, or refined, coal residual fired at Big Bend Station (all Unit Nos. 1-4 combined) shall be limited to 500 tons per day. The beneficiated, or refined, coal residual results from using the beneficiated process, described in permit application 0570039-012-AC, to wash and screen the raw coal residual to remove fines and oversized materials. This beneficiation process shall be performed at Polk Power Station, not Big Bend Station.

g. Raw coal residual: The total amount of raw coal residual fired at Big Bend Station (all Unit Nos. 1-4 combined) shall be limited to 200 tons per day. The raw coal residual is a by-product of the gasification of coal at the Polk Power Station. At the time of the issuance of permit 0570039-012-AC on October 4, 2001, there were approximately 100,000 tons of raw coal residual stored at Polk Power Station. Once this raw coal residual pile has been fired, TEC shall only fire raw coal residual in the event of a significant beneficiation process malfunction. TEC shall document all beneficiation process malfunctions and record the amount of raw coal residual, if any, fired at Big Bend Station. These records should be kept on site at Big Bend and made readily available to the Department and the Environmental Protection Commission of Hillsborough County upon request.

h. No coal residual shall be fired in any Unit when the corresponding scrubber is not in operation.

[Rules 62-4.070(3), 62-4.160(2), 62-210.200, and 62-213.440(1), F.A.C.; PSD-FL-040; Power Plant Siting Certification PA 79-12; Permit No. 0570039-012-AC; ~~Permit No. 0570039-016-AC~~]

{Permitting note: “Flame stabilization” is defined as the use of No. 2 fuel oil to stabilize a flame during times of unexpected poor coal quality or equipment failure such as coal piping pluggage. Flame stabilization due to poor coal quality occurs when coal is wet or does not provide the necessary heat to maintain a stable flame. In this situation, No. 2 fuel oil is combusted to provide the additional required heat input to maintain a stable flame. Flame stabilization due to equipment failure occurs when coal piping is plugged, or equipment is otherwise damaged, that results in an inconsistent amount of coal reaching the burners. Under certain conditions, this may result in the burners intermittently seeing large amounts of fuel at one time, causing a potentially explosive flame “puff”. In this situation, No. 2 fuel oil must be used for stabilization to prevent flame “puffing” and ensure safe operation. Combustion of No. 2 fuel oil is also necessary during periods of load change to initialize and stabilize the flame until coal flow to the burners reaches steady state. As defined in 62-210.700(3), F.A.C., Load change occurs when the operational capacity of a unit is in the 10 to 100 percent capacity range, other than startup or shutdown, which exceeds 10 percent of the unit’s rated capacity and which occurs at a rate of 0.5 percent per minute or more.}

B.3. Mode of Operation. Tampa Electric Company is allowed to divert and integrate all of the flue gas from Unit No. 3 for purposes of treating that flue gas in the existing Unit No. 4 flue gas desulfurization (FGD) system.

[Rule 62-4.070(3), F.A.C., 40 CFR 60.40a, and Permit No. PSD-FL-040]

B.4. Hours of Operation. Unit No. 4 is allowed to operate continuously, i.e., 8760 hours/year.

[Rule 62-210.200, F.A.C., Definitions (PTE)]

Emission Limitations and Standards

B.5.i. Unit Particulate Matter Emission Limits:

a. Particulate matter emissions from Unit No. 4 shall not exceed 0.03 lb/million Btu heat input. This standard applies at all times except during periods of startup, shutdown, or malfunction.

[Rule 62-204.800(7)(b)2., F.A.C.; 40 CFR 60.42a(a); 40 CFR 60.46a(a); 40 CFR 60.46a(c)]

b. Based on the maximum permitted heat input rate listed in Specific Condition B.1., particulate matter emissions from Unit No. 4 shall not exceed 129.9 lbs/hour, 3118 lbs/day, and 569.0 tons/year.

ii. Facility-Wide Particulate Matter Emission Limit:

[PSD-FL-040 and Rule 62-296.700(4)(b)1., F.A.C.]

ii. Facility-wide Particulate Matter Emission Limit: In order to provide reasonable assurance that a significant net emission rate increase will not occur as a result of combusting raw and beneficiated coal residual at Big Bend, the combined emissions from Steam Generator Units 1-4 shall not exceed an annual emissions cap of 2,767 tons per year of PM/PM₁₀. This cap corresponds to the average emissions of the years 1999 and 2000. Any relaxation in this limit that increases the facility’s potential to emit by at least 1 ton of pollutant per year will result in a reevaluation of PSD applicability for the facility as though construction had not yet commenced at the facility.

[Rule 62-212.400(2)(g) and Permit No. 0570039-012-AC]

{Permitting note: The averaging time for the emissions standard in this condition shall be equal to the cumulative run time required by the specified test method.}

B.6. Visible emissions from Unit No. 4 shall not exceed 20 (twenty) percent opacity (6-minute average), except for one 6-minute period per hour of not more than 27 (twenty-seven) percent opacity.
[Rule 62-204.800(7)(b)2., F.A.C.; 40 CFR 60.42a(b); PSD-FL-040]

B.7. Unit Sulfur Dioxide Emission Limits.

a. Sulfur dioxide emissions from Unit No. 4 when combusting solid fuel shall not exceed 0.82 lb/million Btu heat input and 10 percent of the potential combustion concentration (90 percent reduction). Based upon a heat input of 4330 million Btu/hour, SO₂ emissions shall not exceed 3551 lb/hr.
[Rule 62-204.800(7)(b)2., F.A.C.; 40 CFR 60.43a(a)(1); PSD-FL-040]

b. Compliance with sulfur dioxide emission limitations and percent reduction requirements is determined on a 30-day rolling average basis.
[Rule 62.204.800(7)(b)2., F.A.C.; 40 CFR 60.43a(g)]

B.8. Facility-wide Sulfur Dioxide Emission Limit. In order to provide reasonable assurance that a significant net emission rate increase will not occur as a result of combusting raw and beneficiated coal residual at Big Bend, the combined emissions from Steam Generator Units 1-4 shall not exceed an annual emissions cap of 71,810 tons per year of SO₂. This cap corresponds to the average emissions of the years 1999 and 2000. Any relaxation in this limit that increases the facility's potential to emit by at least 1 ton of pollutant per year will result in a reevaluation of PSD applicability for the facility as though construction had not yet commenced at the facility.
[Rule 62-212.400(2)(g) and Permit No. 0570039-012-AC]

B.9. Nitrogen dioxide emissions from Unit No. 4 when combusting bituminous or anthracite coal, or a coal/petroleum coke blend, shall not exceed 0.60 lb/million Btu heat input. Based upon a heat input of 4330 million Btu/hour, NO_x emissions shall not exceed 2598 lb/hr. These emission limits are based on a 30-day rolling average. These standards apply at all times except during periods of startup, shutdown, or malfunction.
[Rule 62-204.800(7)(b)2., F.A.C.; 40 CFR 60.44a(a); 40 CFR 60.4a(c), PSD-FL-040]

B.10. Carbon monoxide (CO) emissions from Unit No. 4 shall not exceed 0.029 lb/million Btu heat input, and shall not exceed 124 lb/hr.
[PSD-FL-040 (October 9, 1985 modification)]
{Permitting note: The averaging time for the emissions standard in this condition shall be equal to the cumulative run time required by the specified test method.}

Compliance provisions.

B.11. The sulfur dioxide emission standards in specific condition B.7. apply at all times except during periods of startup, shutdown, or when both emergency conditions exist and the following procedures in specific condition B.12. are implemented.
[Rule 62-296.800(7)(b)2., F.A.C.; 40 CFR 60.46a(c)]

B.12. During emergency conditions in the principal company, an affected facility with a malfunctioning flue gas desulfurization system may be operated if sulfur dioxide emissions are minimized by:

(1) Operating all operable flue gas desulfurization system modules, and bringing back into operation any malfunctioned module as soon as repairs are completed,

(2) Bypassing flue gases around only those flue gas desulfurization system modules that have been taken out of operation because they were incapable of any sulfur dioxide emission reduction or which would have suffered significant physical damage if they had remained in operation, and

(3) Operating a *spare* flue gas desulfurization system module. The Department or EPCHC may at their discretion require TEC within 60 days of notification to demonstrate spare module capability. To demonstrate this capability, the owner or operator must demonstrate compliance with the appropriate requirements of specific conditions ~~B.5.~~ and B.7. for any period of operation lasting from 24 hours to 30 days when:

- (i) Any one flue gas desulfurization module is not operated,
- (ii) The affected facility is operating at the maximum heat input rate,
- (iii) The fuel fired during the 24-hour to 30-day period is representative of the type and average sulfur content of fuel used over a typical 30-day period, and
- (iv) TEC has given the Department or EPCHC at least 30 days notice of the date and period of time over which the demonstration will be performed.

[Rule 62-204.800(7)(b)2., F.A.C.; 40 CFR 60.46a(d)]

B.13. Compliance with the sulfur dioxide emission limitations and percentage reduction requirements in specific condition B.7., and the nitrogen oxides emission limitations in specific condition B.9., is based on the *average emission rate* for 30 successive boiler operating days. A separate performance test is completed at the end of each boiler operating day after the initial performance test, and a new 30 day *average emission rate* for both sulfur dioxide and nitrogen oxides and a new percent reduction for sulfur dioxide are calculated to show compliance with the standards.

[Rule 62-204.800(7)(b)2., F.A.C.; 40 CFR 60.46a(e)]

B.14. Compliance is determined by calculating the arithmetic average of all hourly *emission rates* for SO₂ and NO_x for the 30 successive boiler operating days, except for data obtained during startup, shutdown, malfunction (NO_x only), or emergency conditions (SO₂ only). Compliance with the percentage reduction requirement for SO₂ is determined based on the average inlet and average outlet SO₂ emission rates for the 30 successive boiler operating days.

[Rule 62-204.800(7)(b)2., F.A.C.; 40 CFR 60.46a(g)]

B.15. If TEC has not obtained the minimum quantity of emission data as required in the following emission monitoring specific conditions B.16. through B.25, compliance of Unit No. 4 with the sulfur dioxide and nitrogen oxides standards for the day on which the 30-day period ends may be determined by the Administrator by following the applicable procedures in section 7 of Method 19, *Determination of Compliance When Minimum Data Requirement Is Not Met*.

[Rule 62-204.800(7)(b)2., F.A.C.; 40 CFR 60.46a(h); 40 CFR 60, Appendix A, Method 19]

Emission Monitoring.

B.16. TEC shall calibrate, maintain, and operate a continuous monitoring system, and record the output of the system, for measuring the opacity of emissions discharged to the atmosphere. If opacity interference due to water droplets exists in the stack (for example, from the use of an FGD system), the opacity is monitored upstream of the interference (at the inlet to the FGD system). If opacity interference is experienced at all locations (both at the inlet and outlet of the sulfur dioxide control system), alternate parameters indicative of the particulate matter control system's performance are monitored (subject to the approval of the Department and the EPCHC.)

[Rule 62-204.800(7)(b)2., F.A.C.; 40 CFR 60.47a(a)]

B.17. TEC shall calibrate, maintain, and operate a continuous monitoring system, and record the output of the system, for measuring sulfur dioxide emissions as follows:

(1) Sulfur dioxide emissions are monitored at both the inlet and outlet of the sulfur dioxide control device.

(2) An "as fired" fuel monitoring system (upstream of coal pulverizers) meeting the requirements of Method 19, Determination of Sulfur Dioxide Removal Efficiency and Particulate Matter, Sulfur Dioxide, and Nitrogen Oxides Emission Rates, may be used to determine potential sulfur dioxide emissions in place of a continuous sulfur dioxide emission monitor at the inlet to the sulfur dioxide control device as required in the preceding specific condition B.17.(1).

[Rule 62-204.800(7)(b)2., F.A.C.; 40 CFR 60.47a(b); 40 CFR 60, App. A, Method 19]

B.18. TEC shall calibrate, maintain, and operate a continuous monitoring system, and record the output of the system, for measuring nitrogen oxides emissions discharged to the atmosphere.

[Rule 62-204.800(7)(b)2., F.A.C.; 40 CFR 60.47a(c)]

B.19. TEC shall calibrate, maintain, and operate a continuous monitoring system, and record the output of the system, for measuring the oxygen and/or carbon dioxide content of the flue gases at each location where sulfur dioxide or nitrogen oxides emissions are monitored. The sulfur dioxide, nitrogen dioxide, oxygen and/or carbon dioxide, and opacity monitoring devices shall meet the applicable requirements of Section 62-214, F.A.C., 40 CFR 60.47a., and 40 CFR 75.). The opacity monitor shall be placed in the duct work between the electrostatic precipitator and the FGD scrubber. ~~When Units 3 and 4 are operating in the integrated mode (Unit 3 flue gases routed through the Unit 4 FGD system),~~ the continuous monitoring system will measure sulfur dioxide emissions at the inlet of each unit and outlet of the Unit 4 FGD system and from the Unit 3 stack (CS002) and Unit 4 stack (CS003), while emissions of nitrogen oxides, oxygen and/or carbon dioxide, and opacity shall be measured in the Units 3 and 4 ducts prior to the FGD system. When Unit 4 is operating and Unit 3 is not operating in the integrated mode, the continuous monitoring system will measure only Unit 4's inlet duct and stack for SO₂ emissions. The emissions of nitrogen oxides and opacity shall be measured in the Unit 4 duct prior to the FGD system. The emissions of carbon dioxide and sulfur dioxide are both measured in the inlet and outlet ducts.

[Rule 62-204.800(7)(b)2., F.A.C.; 40 CFR 60.47a(d); Power Plant Siting Certification PA 79-12D]

B.20. The continuous monitoring systems required in specific conditions B.17., B.18., and B.19., shall be operated and record data during all periods of operation of Unit No. 4 including periods of startup, shutdown, malfunction or emergency conditions, except for continuous monitoring system breakdowns, repairs, calibration checks, and zero and span adjustments.

[Rule 62-204.800(7)(b)2., F.A.C.; 40 CFR 60.47a(e)]

B.21. TEC shall obtain emission data for at least 18 hours in at least 22 out of 30 successive boiler operating days. If this minimum data requirement cannot be met with a continuous monitoring system, TEC shall supplement emission data with other monitoring systems approved by the Department or the EPCHC, or the reference methods and procedures as described in Specific Condition B.23.

[Rule 62-204.800(7)(b)2., F.A.C.; 40 CFR 60.47a (f)]

B.22. The 1-hour averages required under 40 CFR 60.13(h), *Monitoring Requirements*, are expressed in lbs/million Btu heat input and used to calculate the average emission rates required in specific

conditions B.13. and B.14. The 1-hour averages are calculated using the data points required under 40 CFR 60.13(b), *Monitoring Requirements*. At least two data points must be used to calculate the 1-hour averages.

[Rule 62-204.800(7)(b)2., F.A.C.; 40 CFR 60.47a(g)]

B.23. When it becomes necessary to supplement continuous monitoring system data to meet the minimum data requirements in specific condition B.21., TEC shall use the following reference methods and procedures. Acceptable alternative methods and procedures are given in specific condition B.25.

(1) Method 6 shall be used to determine the SO₂ concentration at the same location as the SO₂ monitor. Samples shall be taken at 60-minute intervals. The sampling time and sample volume for each sample shall be at least 20 minutes and 0.020 dscm (0.71 dscf). Each sample represents a 1-hour average.

(2) Method 7 shall be used to determine the NO_x concentration at the same location as the NO_x monitor. Samples shall be taken at 30-minute intervals. The arithmetic average of two consecutive samples represents a 1-hour average.

(3) The emission rate correction factor, integrated bag sampling and analysis procedure of Method 3B shall be used to determine the O₂ or CO₂ concentration at the same location as the O₂ or CO₂ monitor. Samples shall be taken for at least 30 minutes in each hour. Each sample represents a 1-hour average.

(4) The procedures in Method 19 shall be used to compute each 1-hour average concentration in lb/million Btu heat input.

[Rule 62-204.800(7)(b)2., F.A.C.; 40 CFR 60.47a(h); 40 CFR 60, Appendix A, Methods 3B, 6, 7, and 19]

B.24. TEC shall use the following methods and procedures to conduct the monitoring system performance evaluations required under 40 CFR 60.13(c), *Monitoring Requirements*, and the calibration checks required under 40 CFR 60.13(d), *Monitoring Requirements*. Acceptable alternative methods and procedures are given in specific condition B.25.

(1) Methods 6, 7, and 3B, as applicable, shall be used to determine O₂, SO₂, and NO_x concentrations

(2) SO₂ or NO_x (NO), as applicable, shall be used for preparing the calibration gas mixtures (in N₂, as applicable) under 40 CFR 60 Appendix B, Performance Specification 2.

(3) The span value for a continuous monitoring system for measuring opacity is between 60 and 80 percent and for a continuous monitoring system measuring nitrogen oxides is determined as follows

Fossil fuel	Span value for nitrogen oxides (ppm)
Solid.....	1,000

(4) Reserved

(5) For affected facilities burning fossil fuel alone or in combination with non-fossil fuel, the span value of the sulfur dioxide continuous monitoring system at the inlet to the sulfur dioxide control device is 125 percent of the maximum estimated hourly potential emissions of the fuel fired, and the outlet of the sulfur dioxide control device is 50 percent of maximum estimated hourly potential emissions oil fuel, alone or in combination with non-fossil fuel, the span value of the fuel fired.

[Rule 62-204.800(7)(b)2., F.A.C.; 40 CFR 60.47a(i); 40 CFR 60.13; 40 CFR 60 Appendix A, Methods 3B, 6, and 7; 40 CFR 60 Appendix B, Performance Specification 2.]

B.25. TEC may use the following as alternatives to the reference methods and procedures specified in conditions B.23. and B.24.:

(1) For Method 6, Method 6A or 6B (whenever Methods 6 and 3 or 3B data are used) or 6C may be used. Each Method 6B sample obtained over 24 hours represents 24 1-hour averages. If Method 6A or 6B is used under specific condition B.24., the conditions under 40 CFR 60.46(d)(1) apply; these conditions do not apply under specific condition B.23.

(2) For Method 7, Method 7A, 7C, 7D, or 7E may be used. If Method 7C, 7D, or 7E is used, the sampling time for each run shall be 1 hour.

(3) For Method 3, Method 3A or 3B may be used if the sampling time is 1 hour.

(4) For Method 3B, Method 3A may be used.

[Rule 62-204.800(7)(b)2., F.A.C.; 40 CFR 60.47a(j); 40 CFR 60.46(d)(1), 40 CFR 60 Appendix A, Methods 3, 3A, 3B, 6, 6A, 6B, 6C, 7, 7A, 7C, 7D, and 7E]

Compliance determination procedures and methods.

B.26. In conducting the performance tests required in 40 CFR 60.8, the owner or operator shall use as reference methods and procedures the methods in appendix A of 40 CFR 60 or the methods and procedures as specified in conditions B.27. through B.30., except as provided in 40 CFR 60.8(b). 40 CFR 60.8(f) does not apply to specific conditions B.28 and B.29. for SO₂ and NO_x. Acceptable alternative methods are given in specific condition B.30.

[Rule 62-204.800(7)(b)2., F.A.C.; 40 CFR 60.48a(a); 40 CFR 60.8]

B.27. TEC shall determine compliance with the particulate matter standards in specific condition B.5. as follows:

(1) The dry basis F factor (O₂) procedures in Method 19 shall be used to compute the emission rate of particulate matter.

(2) For the particulate matter concentration, Method 5B shall be used after wet FGD systems.

(i) The sampling time and sample volume for each run shall be at least 120 minutes and 1.70 dscm (60 dscf). The probe and filter holder heating system in the sampling train may be set to provide an average gas temperature of no greater than 160±14 °C (320±25 °F).

(ii) For each particulate run, the emission rate correction factor, integrated or grab sampling and analysis procedures of Method 3B shall be used to determine the O₂ concentration. The O₂ sample shall be obtained simultaneously with, and at the same traverse points as, the particulate run. If the particulate run has more than 12 traverse points, the O₂ traverse points may be reduced to 12 provided that Method 1 is used to locate the 12 O₂ traverse points. If the grab sampling procedure is used, the O₂ concentration for the run shall be the arithmetic mean of all the individual O₂ concentrations at each traverse point.

(3) Method 9 and the procedures in 40 CFR 60.11 shall be used to determine opacity.

[Rule 62-204.800(7)(b)2., F.A.C.; 40 CFR 60.48a(b); 40 CFR 60.11, 40 CFR 60 Appendix A, Methods 1, 3B, 5B, 9, and 19]

B.28. TEC shall determine compliance with the SO₂ standards in specific condition B.7. as follows:

(1) The percent of potential SO₂ emissions (%Ps) to the atmosphere shall be computed using the following equation:

$$\%P_s = \frac{(100 - \%R_f)(100 - \%R_g)}{100}$$

where:

- $\%P_s$ = percent of potential SO₂ emissions, percent.
 ~~$\%R_f$ = percent reduction from fuel pretreatment, percent.~~
 $\%R_g$ = percent reduction by SO₂ control system, percent.

(2) ~~[Reserved.] The procedures in Method 19 may be used to determine percent reduction ($\%R_f$) of sulfur by such processes as fuel pretreatment (physical coal cleaning, hydrodesulfurization of fuel oil, etc.), coal pulverizers, and bottom and flyash interactions. This determination is optional.~~

(3) The procedures in Method 19 shall be used to determine the percent SO₂ reduction ($\%R_g$ of any SO₂ control system. Alternatively, a combination of an "as fired" fuel monitor and emission rates measured after the control system, following the procedures in Method 19, may be used if the percent reduction is calculated using the average emission rate from the SO₂ control device and the average SO₂ input rate from the "as fired" fuel analysis for 30 successive boiler operating days.

(4) The appropriate procedures in Method 19 shall be used to determine the emission rate.

(5) The continuous monitoring systems specified in conditions B.17. and B.19. shall be used to determine the concentrations of SO₂ and CO₂ or O₂.

[Rule 62-204.800(7)(b)2., F.A.C.; 40 CFR 60.48a (c); 40 CFR 60 43a; 40 CFR 60.47a(b) and (d); 40 CFR 60 Appendix A, Method 19; Applicant request, 0570039-016-AC]

B.29. TEC shall determine compliance with the NO_x standards in specific condition B.9. as follows:

(1) The appropriate procedures in Method 19 shall be used to determine the emission rate of NO_x.

(2) The continuous monitoring systems specified in specific conditions B.18. and B.19. shall be used to determine the concentrations of NO_x and CO₂ or O₂.

[Rule 62-204.800(7)(b)2., F.A.C.; 40 CFR 60.48a(d); 40 CFR 60.44a; 40 CFR 60.47a(c); 40 CFR 60.47a(d)]

B.30. TEC may use the following as alternatives to the reference methods and procedures specified in condition B.27:

(1) For Method 5 or 5B, Method 17 may be used at Unit No. 4 if the stack temperature at the sampling location does not exceed an average temperature of 160 °C (320 °F). The procedures of sections 2.1 and 2.3 of Method 5B may be used in Method 17 only if it is used after wet FGD systems. Method 17 shall not be used after wet FGD systems if the effluent is saturated or laden with water droplets.

(2) The F_c factor (CO₂) procedures in Method 19 may be used to compute the emission rate of particulate matter under the stipulations of 40 CFR 60.46(d)(1). The CO₂ shall be determined in the same manner as the O₂ concentration.

[Rule 62-204.800(7)(b)2., F.A.C.; 40 CFR 60.48a(e); 40 CFR 60.46(d)(1); 40 CFR 60 Appendix A, Methods 5, 5B, 17, and 19]

Reporting requirements.

B.31. For sulfur dioxide, nitrogen oxides, and particulate matter emissions, the performance test data from the initial performance test and from the performance evaluation of the continuous monitors (including the transmissometer) shall be submitted to the Department and the EPCHC.

[Rule 62-204.800(7)(b)2., F.A.C.; 40 CFR 60.49a(a)]

B.32. For sulfur dioxide and nitrogen oxides the following information shall be reported to the Department and the EPCHC for each 24-hour period.

(1) Calendar date.

(2) The average sulfur dioxide and nitrogen oxide emission rates (lb/million Btu heat input) for each 30 successive boiler operating days, ending with the last 30-day period in the quarter; reasons for non-compliance with the emission standards; and, description of corrective actions taken.

(3) Percent reduction of the potential combustion concentration of sulfur dioxide for each 30 successive boiler operating days, ending with the last 30-day period in the quarter; reasons for non-compliance with the standard; and, description of corrective actions taken.

(4) Identification of the boiler operating days for which pollutant or diluent data have not been obtained by an approved method for at least 18 hours of operation of the facility; justification or not obtaining sufficient data; and description of corrective actions taken.

(5) Identification of the times when emissions data have been excluded from the calculation of average emission rates because of startup, shutdown, malfunction (NO_x only), emergency conditions (SO₂ only), or other reasons, and justification for excluding data for reasons other than startup, shutdown, malfunction, or emergency conditions.

(6) Identification of "F" factor used for calculations, method of determination, and type of fuel combusted.

(7) Identification of times when hourly averages have been obtained based on manual sampling methods.

(8) Identification of the times when the pollutant concentration exceeded full span of the continuous monitoring system.

(9) Description of any modifications to the continuous monitoring system which could affect the ability of the continuous monitoring system to comply with 40 CFR 60 Appendix B, Performance Specifications 2 or 3.

[Rule 62-204.800(7)(b)2., F.A.C.; 40 CFR 60.49a(b); 40 CFR 60 Appendix B]

B.33. If the minimum quantity of emission data, as required by the emission monitoring specific conditions B.16. through B.25., is not obtained for any 30 successive boiler operating days, the following information obtained under the requirements of specific condition B.15. shall be reported to the Administrator for that 30-day period:

(1) The number of hourly averages available for outlet emission rates (n_o) and inlet emission rates (n_i) as applicable.

(2) The standard deviation of hourly averages for outlet emission rates (s_o) and inlet emission rates (s_i) as applicable.

(3) The lower confidence limit for the mean outlet emission rate (E_o^*) and the upper confidence limit for the mean inlet emission rate (E_i^*) as applicable.

(4) The applicable potential combustion concentration.

(5) The ratio of the upper confidence limit for the mean outlet emission rate (E_o^*) and the allowable emission rate (E_{std}) as applicable.

[Rule 62-204.800(7)(b)2., F.A.C.; 40 CFR 60.49a(c); 40 CFR 60 Appendix A, Method 19]

B.34. If any sulfur dioxide standards under specific condition B.7. is exceeded during emergency conditions because of control system malfunction, the owner or operator of the affected facility shall submit a signed statement:

(1) Indicating if emergency conditions existed and requirements under specific condition B.14. were met during each period, and

- (2) Listing the following information:
- (i) Time periods the emergency condition existed;
 - (ii) Electrical output and demand on the owner or operator's electric utility system and the affected facility;
 - (iii) Amount of power purchased from interconnected neighboring utility companies during the emergency period;
 - (iv) Percent reduction in emissions achieved;
 - (v) Atmospheric emission rate (ng/J or lb/MMBtu) of the pollutant discharged; and
 - (vi) Actions taken to correct control system malfunction.
- [Rule 62-204.800(7)(b)2., F.A.C.; 40 CFR 60.49a(d); 40 CFR 60.43a; 40 CFR 60.46a(d)]

~~B.35. [Reserved] If fuel pretreatment credit is claimed toward the sulfur dioxide emission standards in specific condition B.7, TEC shall submit a signed statement:~~

- ~~—(1) Indicating what percentage cleaning credit was taken for the calendar quarter, and whether the credit was determined in accordance with the provisions of specific condition B.28 and Method 19 (Appendix A of 40 CFR 60); and~~
- ~~—(2) Listing the quantity, heat content, and date each pretreated fuel shipment was received during the previous quarter; the name and location of the fuel pretreatment facility; and the total quantity and total heat content of all fuels received at the affected facility during the previous quarter.~~

~~[Rule 62-204.800(7)(b)2., F.A.C.; 40 CFR 60.49a(e), 40 CFR 60.48a(e)]~~

B.36. For any periods for which opacity, sulfur dioxide or nitrogen oxides emissions data are not available, the owner or operator of the affected facility shall submit a signed statement indicating if any changes were made in operation of the emission control system during the period of data unavailability. Operations of the control system and affected facility during periods of data unavailability are to be compared with operation of the control system and affected facility before and following the period of data unavailability.

[Rule 62-204.800(7)(b)2., F.A.C.; 40 CFR 60.49a(f)]

B.37. The owner or operator of the affected facility shall submit a signed statement indicating whether:

- (1) The required continuous monitoring system calibration, span, and drift checks or other periodic audits have or have not been performed as specified.
- (2) The data used to show compliance was or was not obtained in accordance with approved methods and procedures of this part and is representative of plant performance.
- (3) The minimum data requirements have or have not been met; or, the minimum data requirements have not been met for errors that were unavoidable.
- (4) Compliance with the standards has or has not been achieved during the reporting period.

[Rule 62-204.800(7)(b)2., F.A.C.; 40 CFR 60.49a(g)]

B.38. For the purposes of the reports required under 40 CFR 60.7, periods of excess emissions are defined as all 6-minute periods during which the average opacity exceeds the applicable opacity standards under specific condition B.6. Opacity levels in excess of the applicable opacity standard and the date of such excesses are to be submitted to the Administrator each calendar quarter.

[Rule 62-204.800(7)(b)2., F.A.C.; 40 CFR 60.49a(h)]

B.39. The owner or operator of an affected facility shall submit the written reports required under this section and subpart A to the Department and the EPCHC for every calendar quarter. All quarterly reports shall be postmarked by the 30th day following the end of each calendar quarter.
[Rule 62-204.800(7)(b)2., F.A.C.; 40 CFR 60.49a(i)]

B.40. Gravimetric instrument data verifying that the 20.0% maximum petroleum coke content by weight has not been exceeded shall be maintained for **five** years and submitted to the Department and the EPCHC with each annual operating report. Also to be maintained and available for inspection shall be a daily record of operation showing the date, fuel used, mode of operation (integrated/non-integrated), and the duration of all startups, shutdowns and malfunctions. TEC shall maintain copies of fuel analyses containing information on sulfur content, ash content, and heating values.
[PSD-FL-040; Rules 62-4.070(3), 62-213.440(1)(b)2.b., F.A.C., and Power Plant Siting Certification PA 79-12]

B.41. TEC shall submit to the Department a standardized plan or procedure that will allow the permittee to monitor emission control equipment efficiency and enable the permittee to return malfunctioning equipment to proper operation as expeditiously as possible.
[Power Plant Siting Certification PA 79-12]

B.42. Pursuant to Rule 62-212.200(2)(d), F.A.C., the actual emissions of the No. 4 Unit shall equal the representative actual emissions as defined in 40 CFR 52.21(b)(33). TEC shall maintain and submit to the Department and the EPCHC on an annual basis for a period of 5 years from the date the unit begins firing petroleum coke, data demonstrating that the operational change did not result in an emissions increase.
[PSD-FL-040; PA 79-12, Conditions of Certification]

B.43. Stack height. The height of the boiler exhaust stack for Unit No. 4 (CS003) shall not be less than 490 ft. above grade.
[Power Plant Siting Certification PA 79-12]

The following requirements of 40 CFR 60, Subpart A - General Provisions Requirements, apply to Unit No. 4:

B.44. Definitions. For the purposes of Rule 62-204.800(7), F.A.C., the definitions contained in the various provisions of 40 CFR 60, shall apply except that the term "Administrator" when used in 40 CFR 60, shall mean the Secretary or the Secretary's designee.
[40 CFR 60.2; Rule 62-204.800(7)(a), F.A.C.]

40 CFR 60.7 Notification and record keeping.

B.45. The owner or operator subject to the provisions of 40 CFR 60 shall furnish the Administrator written notification as follows:

A notification of any physical or operational change to an existing facility which may increase the emission rate of any air pollutant to which a standard applies, unless that change is specifically exempted under an applicable subpart or in 40 CFR 60.14(e). This notice shall be postmarked 60 days or as soon as practicable before the change is commenced and shall include information describing the precise nature of the change, present and proposed emission control systems, productive capacity of the facility

before and after the change, and the expected completion date of the change. The Administrator may request additional relevant information subsequent to this notice.

[40 CFR 60.7(a)(4)]

B.46. The owner or operator subject to the provisions of 40 CFR 60 shall maintain records of the occurrence and duration of any startup, shutdown, or malfunction in the operation of an affected facility; any malfunction of the air pollution control equipment; or, any periods during which a continuous monitoring system or monitoring device is inoperative.

[40 CFR 60.7(b)]

B.47. Each owner or operator required to install a continuous monitoring system (CMS) or monitoring device shall submit an excess emissions and monitoring systems performance report (excess emissions are defined in applicable subparts) and/or a summary report form [see 40 CFR 60.7(d)] to the Administrator semiannually, except when: more frequent reporting is specifically required by an applicable subpart; or, the CMS data are to be used directly for compliance determination, in which case quarterly reports shall be submitted; or, the Administrator, on a case-by-case basis, determines that more frequent reporting is necessary to accurately assess the compliance status of the source. All reports shall be postmarked by the 30th day following the end of each calendar half (or quarter, as appropriate).

Written reports of excess emissions shall include the following information:

- (1) The magnitude of excess emissions computed in accordance with 40 CFR 60.13(h), any conversion factor(s) used, and the date and time of commencement and completion of each time period of excess emissions. The process operating time during the reporting period.
- (2) Specific identification of each period of excess emissions that occurs during startups, shutdowns, and malfunctions of the affected facility. The nature and cause of any malfunction (if known), the corrective action taken or preventative measures adopted.
- (3) The date and time identifying each period during which the continuous monitoring system was inoperative except for zero and span checks and the nature of the system repairs or adjustments.
- (4) When no excess emissions have occurred or the continuous monitoring system(s) have not been inoperative, repaired, or adjusted, such information shall be stated in the report.

[40 CFR 60.7(c)(1), (2), (3), and (4)]

B.48. The summary report form shall contain the information and be in the format shown in Figure 1 (attached) unless otherwise specified by the Administrator. One summary report form shall be submitted for each pollutant monitored at each affected facility.

(1) If the total duration of excess emissions for the reporting period is less than 1 percent of the total operating time for the reporting period and CMS downtime for the reporting period is less than 5 percent of the total operating time for the reporting period, only the summary report form shall be submitted and the excess emission report described in 40 CFR 60.7(c) need not be submitted unless requested by the Administrator.

(2) If the total duration of excess emissions for the reporting period is 1 percent or greater of the total operating time for the reporting period or the total CMS downtime for the reporting period is 5 percent or greater of the total operating time for the reporting period, the summary report form and the excess emission report described in 40 CFR 60.7(c) shall both be submitted.

{See attached Figure 1: Summary Report-Gaseous and Opacity Excess Emission and Monitoring System Performance} (electronic file name: figure1.doc)

[40 CFR 60.7(d)(1) and (2)]

B.49. (1) Notwithstanding the frequency of reporting requirements specified in 40 CFR 60.7(c), an owner or operator who is required by an applicable subpart to submit excess emissions and monitoring systems performance reports (and summary reports) on a quarterly (or more frequent) basis may reduce the frequency of reporting for that standard to semiannual if the following conditions are met:

(i) For 1 full year (e.g., 4 quarterly or 12 monthly reporting periods) the affected facility's excess emissions and monitoring systems reports submitted to comply with a standard under this part continually demonstrate that the facility is in compliance with the applicable standard;

(ii) The owner or operator continues to comply with all recordkeeping and monitoring requirements specified in 40 CFR 60, Subpart A, and the applicable standard; and

(iii) The Administrator does not object to a reduced frequency of reporting for the affected facility, as provided in 40 CFR 60.7(e)(2).

(2) The frequency of reporting of excess emissions and monitoring systems performance (and summary) reports may be reduced only after the owner or operator notifies the Administrator in writing of his or her intention to make such a change and the Administrator does not object to the intended change. In deciding whether to approve a reduced frequency of reporting, the Administrator may review information concerning the source's entire previous performance history during the required recordkeeping period prior to the intended change, including performance test results, monitoring data, and evaluations of an owner or operator's conformance with operation and maintenance requirements. Such information may be used by the Administrator to make a judgment about the source's potential for noncompliance in the future. If the Administrator disapproves the owner or operator's request to reduce the frequency of reporting, the Administrator will notify the owner or operator in writing within 45 days after receiving notice of the owner or operator's intention. The notification from the Administrator to the owner or operator will specify the grounds on which the disapproval is based. In the absence of a notice of disapproval within 45 days, approval is automatically granted.

(3) As soon as monitoring data indicate that the affected facility is not in compliance with any emission limitation or operating parameter specified in the applicable standard, the frequency of reporting shall revert to the frequency specified in the applicable standard, and the owner or operator shall submit an excess emissions and monitoring systems performance report (and summary report, if required) at the next appropriate reporting period following the noncomplying event. After demonstrating compliance with the applicable standard for another full year, the owner or operator may again request approval from the Administrator to reduce the frequency of reporting for that standard as provided for in 40 CFR 60.7(e)(1) and (e)(2).

[40 CFR 60.7(e)(1)]

B.50. Any owner or operator subject to the provisions of 40 CFR 60 shall maintain a file of all measurements, including continuous monitoring system, monitoring device, and performance testing measurements; all continuous monitoring system performance evaluations; all continuous monitoring system or monitoring device calibration checks; adjustments and maintenance performed on these systems or devices; and, all other information required by 40 CFR 60 recorded in a permanent form suitable for inspection. The file shall be retained for at least **5 (five)** years following the date of such measurements, maintenance, reports, and records.

[40 CFR 60.7(f); Rule 62-213.440(1)(b)2.b., F.A.C.]

40 CFR 60.8 Performance tests.

B.51. Performance tests shall be conducted under such conditions as the Administrator shall specify to the plant operator based on representative performance of the affected facility. The owner or operator

shall make available to the Administrator such records as may be necessary to determine the conditions of the performance tests. Operations during periods of startup, shutdown, and malfunction shall not constitute representative conditions for the purpose of a performance test nor shall emissions in excess of the level of the applicable emission limit during periods of startup, shutdown, and malfunction be considered a violation of the applicable emission limit unless otherwise specified in the applicable standard.

[40 CFR 60.8(c)]

B.52. The owner or operator of an affected facility shall provide the Administrator at least 30 days prior notice of any performance test, except as specified under other subparts, to afford the Administrator the opportunity to have an observer present.

[40 CFR 60.8(d)]

40 CFR 60.11 Compliance with standards and maintenance requirements.

B.53. Compliance with standards in 40 CFR 60, other than opacity standards, shall be determined in accordance with performance tests established by 40 CFR 60.8, unless otherwise specified in the applicable standard.

[40 CFR 60.11(a)]

B.54. Compliance with opacity standards in 40 CFR 60 shall be determined by conducting observations in accordance with Reference Method 9 in Appendix A of 40 CFR 60, any alternative method that is approved by the Administrator, or as provided in 40 CFR 60.11(e)(5).

[40 CFR 60.11(b)]

B.55. The opacity standards set forth in 40 CFR 60 shall apply at all times except during periods of startup, shutdown, malfunction, and as otherwise provided in the applicable standard.

[40 CFR 60.11(c)]

B.56. At all times, including periods of startup, shutdown, and malfunction, owners and operators shall, to the extent practicable, maintain and operate any affected facility including associated air pollution control equipment in a manner consistent with good air pollution control practice for minimizing emissions. Determination of whether acceptable operating and maintenance procedures are being used will be based on information available to the Administrator which may include, but is not limited to, monitoring results, opacity observations, review of operating and maintenance procedures, and inspection of the source.

[40 CFR 60.11(d)]

B.57. The owner or operator of an affected facility subject to an opacity standard may submit, for compliance purposes, continuous opacity monitoring system (COMS) data results produced during any performance test required under 40 CFR 60.8 in lieu of EPA Method 9 observation data. If an owner or operator elects to submit COMS data for compliance with the opacity standard, he or she shall notify the Administrator of that decision, in writing, at least 30 days before any performance test required under 40 CFR 60.8 is conducted. Once the owner or operator of an affected facility has notified the Administrator to that effect, the COMS data results will be used to determine opacity compliance during subsequent tests required under 40 CFR 60.8 until the owner or operator notifies the Administrator, in writing, to the contrary. For the purpose of determining compliance with the opacity standard during a performance test

required under 40 CFR 60.8 using COMS data, the minimum total time of COMS data collection shall be averages of all 6-minute continuous periods within the duration of the mass emission performance test. Results of the COMS opacity determinations shall be submitted along with the results of the performance test required under 60.8. The owner or operator of an affected facility using a COMS for compliance purposes is responsible for demonstrating that the COMS meets the requirements specified in 40 CFR 60.13(c), that the COMS has been properly maintained and operated, and that the resulting data have not been altered in any way. If COMS data results are submitted for compliance with the opacity standard for a period of time during which EPA Method 9 data indicates noncompliance, the EPA Method 9 data will be used to determine opacity compliance.

[40 CFR 60.11(e)(5)]

40 CFR 60.12 Circumvention.

B.58. No owner or operator subject to the provisions of 40 CFR 60 shall build, erect, install, or use any article, machine, equipment or process, the use of which conceals an emission which would otherwise constitute a violation of an applicable standard. Such concealment includes, but is not limited to, the use of gaseous diluents to achieve compliance with an opacity standard or with a standard which is based on the concentration of a pollutant in the gases discharged to the atmosphere.

[40 CFR 60.12]

40 CFR 60.13 Monitoring requirements.

B.59. For the purposes of 40 CFR 60.13, all continuous monitoring systems (CMS) required under applicable subparts shall be subject to the provisions of 40 CFR 60.13 upon promulgation of performance specifications for continuous monitoring systems under Appendix B of 40 CFR 60 and, if the continuous monitoring system is used to demonstrate compliance with emission limits on a continuous basis, Appendix F of 40 CFR 60, unless otherwise specified in an applicable subpart or by the Administrator. Appendix F is applicable December 4, 1987.

[40 CFR 60.13(a)]

B.60. If the owner or operator of an affected facility elects to submit continuous opacity monitoring system (COMS) data for compliance with the opacity standard as provided under 40 CFR 60.11(e)(5), he shall conduct a performance evaluation of the COMS as specified in Performance Specification 1, Appendix B, of 40 CFR 60 before the performance test required under 40 CFR 60.8 is conducted. Otherwise, the owner or operator of an affected facility shall conduct a performance evaluation of the COMS or continuous emission monitoring system (CEMS) during any performance test required under 40 CFR 60.8 or within 30 days thereafter in accordance with the applicable performance specification in Appendix B of 40 CFR 60. The owner or operator of an affected facility shall conduct COMS or CEMS performance evaluations at such other times as may be required by the Administrator under section 114 of the Act.

(1) The owner or operator of an affected facility using a COMS to determine opacity compliance during any performance test required under 60.8 and as described in 40 CFR 60.11(e)(5) shall furnish the Administrator two or, upon request, more copies of a written report of the results of the COMS performance evaluation described in 40 CFR 60.13(c) at least 10 days before the performance test required under 60.8 is conducted.

[40 CFR 60.13(c)(1)]

B.61. (1) Owners and operators of all continuous emission monitoring systems (CEMS) installed in accordance with the provisions of this part shall check the zero (or low-level value between 0 and 20 percent of span value) and span (50 to 100 percent of span value) calibration drifts at least once daily in accordance with a written procedure. The zero and span shall, as a minimum, be adjusted whenever the 24-hour zero drift or 24-hour span drift exceeds two times the limits of the applicable performance specifications in Appendix B. The system must allow the amount of excess zero and span drift measured at the 24-hour interval checks to be recorded and quantified, whenever specified. For continuous monitoring systems measuring opacity of emissions, the optical surfaces exposed to the effluent gases shall be cleaned prior to performing the zero and span drift adjustments except that for systems using automatic zero adjustments. The optical surfaces shall be cleaned when the cumulative automatic zero compensation exceeds 4 percent opacity.

(2) Unless otherwise approved by the Administrator, the following procedures shall be followed for continuous monitoring systems measuring opacity of emissions. Minimum procedures shall include a method for producing a simulated zero opacity condition and an upscale (span) opacity condition using a certified neutral density filter or other related technique to produce a known obscuration of the light beam. Such procedures shall provide a system check of the analyzer internal optical surfaces and all electronic circuitry including the lamp and photo detector assembly.
[40 CFR 60.13(d)(1) and (2)]

B.62. Except for system breakdowns, repairs, calibration checks, and zero and span adjustments required under 40 CFR 60.13(d), all continuous monitoring systems (CMS) shall be in continuous operation and shall meet minimum frequency of operation requirements as follows:

(1) All continuous monitoring systems referenced by 40 CFR 60.13(c) for measuring opacity of emissions shall complete a minimum of one cycle of sampling and analyzing for each successive 10-second period and one cycle of data recording for each successive 6-minute period.

(2) All continuous monitoring systems referenced by 40 CFR 60.13(c) for measuring emissions, except opacity, shall complete a minimum of one cycle of operation (sampling, analyzing, and data recording) for each successive 15-minute period.
[40 CFR 60.13(e)(1) and (2)]

B.63. All continuous monitoring systems (CMS) or monitoring devices shall be installed such that representative measurements of emissions or process parameters from the affected facility are obtained. Additional procedures for location of continuous monitoring systems contained in the applicable Performance Specifications of Appendix B of 40 CFR 60 shall be used.
[40 CFR 60.13(f)]

B.64. When the effluents from a single affected facility or two or more affected facilities subject to the same emission standards are combined before being released to the atmosphere, the owner or operator may install applicable continuous monitoring systems (CMS) on each effluent or on the combined effluent. When the affected facilities are not subject to the same emission standards, separate continuous monitoring systems shall be installed on each effluent. When the effluent from one affected facility is released to the atmosphere through more than one point, the owner or operator shall install an applicable continuous monitoring system on each separate effluent unless the installation of fewer systems is approved by the Administrator. When more than one continuous monitoring system is used to measure the emissions from one affected facility (e.g., multiple breechings, multiple outlets), the owner or operator shall report the results as required from each continuous monitoring system.
[40 CFR 60.13(g)]

B.65. Owners or operators of all continuous monitoring systems for measurement of opacity shall reduce all data to 6-minute averages and for continuous monitoring systems other than opacity to 1-hour averages for time periods as defined in 40 CFR 60.2. Six-minute opacity averages shall be calculated from 36 or more data points equally spaced over each 6-minute period. For continuous monitoring systems other than opacity, 1-hour averages shall be computed from four or more data points equally spaced over each 1-hour period. Data recorded during periods of continuous monitoring system breakdowns, repairs, calibration checks, and zero and span adjustments shall not be included in the data averages computed under this paragraph. An arithmetic or integrated average of all data may be used. The data may be recorded in reduced or non reduced form (e.g., ppm pollutant and percent O₂ or ng/J of pollutant). All excess emissions shall be converted into units of the standard using the applicable conversion procedures specified in subparts. After conversion into units of the standard, the data may be rounded to the same number of significant digits as used in the applicable subparts to specify the emission limit (e.g., rounded to the nearest 1 percent opacity).
[40 CFR 60.13(h)]

B.66. These emissions units are subject to requirements contained in Consent Final Judgment (DEP vs. TEC) dated December 6, 1999 and the Consent Decree (U.S. vs. TEC) dated February 29, 2000, including the October 4, 2000 amendment.
[Permit No. 0570039-014-AC]

B.67. The first in a series of equipment installed pursuant to the Consent Final Judgment and Consent Decree for the purposes of NO_x requirements contained therein include:
a. Steam Generator Unit No. 4 is equipped with Low NO_x burners (LNB).
b. Steam Generator No. 4 is equipped with separate overfire air (SOFA).
[Permit No. 0570039-014-AC]

B.68. Unit 4 shall be operated using the Low NO_x burners and in accordance with the operational procedures that have been developed to minimize NO_x emissions.
[Permit No. 0570039-014-AC]

B.69. Unit 4 shall be operated using the Separate Overfire Air System (SOFA) and in accordance with the operational procedures that have been developed to minimize NO_x emissions.
[Permit No. 0570039-014-AC]

B.70. These emissions units are subject to the Compliance Assurance Monitoring requirements contained in the attached APPENDIX CAM.

Subsection C. Combustion Turbines

This section addresses the following Regulated Emissions Units:

<u>E.U. ID No.</u>	<u>Brief Description</u>
-007	Combustion Turbine No. 1
-005	Combustion Turbine No. 2
-006	Combustion Turbine No. 3

Descriptions

Combustion Turbine No. 1 is a self-contained combustion turbine generating unit. The unit is a predesigned integrated simple-cycle, single-shaft, three-bearing machine with the load connected at the exhaust end of the unit. The turbine is fired on No. 2 distillate fuel oil and operated for intermittent peaking and emergency services only. The generator nameplate capacity is 18 MW. Unit No. 1 began commercial operation in 1969.

Combustion Turbine No. 2 is a self-contained Westinghouse combustion turbine generating unit. The unit is a predesigned integrated simple-cycle, single-shaft, three-bearing machine with the load connected at the exhaust end of the unit. The turbine is fired on No. 2 distillate fuel oil and operated for intermittent peaking and emergency services only. The generator nameplate capacity is 78 MW. Unit No. 2 began commercial operation in 1974.

Combustion Turbine No. 3 is a self-contained Westinghouse combustion turbine generating unit. The unit is a predesigned integrated simple-cycle, single-shaft, multi-bearing machine with the load connected at the exhaust end of the unit. The turbine is fired on No. 2 distillate fuel oil and operated for intermittent peaking and emergency services only. The generator nameplate capacity is 78 MW. Unit No. 3 began commercial operation in 1974.

{Permitting note: These are pre-NSPS combustion turbines.}

The following conditions apply to the Emissions Units listed above:

Essential Potential to Emit (PTE) Parameters

C.1. Methods of Operation - Fuels. The combustion turbines shall be fired on No. 2 distillate fuel oil and operated for intermittent peaking and emergency services only.
[Rule 62-4.160(2), F.A.C., Construction application request]

C.2. Hours of Operation. Operation of each gas turbine shall not exceed 3650 hours of operation during any consecutive 12 months. [Design; Rule 62-210.200, F.A.C. (Definitions - PTE), Permit No. 057-0039-006-AC]

C.3. Inlet Fogger Operation: Combined operation of the inlet air foggers for both gas turbines CT-2 and CT-3 shall not exceed 1365 total hours during any consecutive 12 months. [Design; Rule 62-212.400, F.A.C. (BACT); Rule 62-210.200, F.A.C. (Definitions - PTE), Permit No. 057-0039-006-AC]

C.4. Plant Operation - Problems: If temporarily unable to comply with any of the conditions of this permit due to breakdown of equipment or destruction by fire, wind or other cause, the owner or operator

shall notify the Compliance Authority by phone, FAX, or letter as soon as possible, but at least within one working day, excluding weekends and holidays. The notification shall include pertinent information as to the cause of the problem, the steps being taken to correct the problem and prevent future recurrence, and the owner's intent toward reconstruction of destroyed facilities. Such notification does not release the permittee from any liability for failure to comply with the conditions of this permit and the regulations. [Rule 62-4.130, F.A.C., Permit No. 057-0039-006-AC]

Emission Limitations and Standards

C.5. Visible emissions from each combustion turbine shall not be equal to or greater than 20 percent opacity.

[Rule 62-296.320(4)(b)1., F.A.C.]

C.6. During each federal fiscal year (October 1 - September 30) the Tampa Electric Company shall have formal compliance tests conducted on each combustion turbine for opacity. Any combustion turbine that does not operate for more than 400 hours per year shall conduct a visible emissions compliance test once per each five-year period, coinciding with the term of its air operation permit.

[Rule 62-296.712, Rule 62-297.310(7)(a)4.a., and Rule 62-297.310(7)(a)8., F.A.C.]

C.7. The test methods for visible emissions shall be EPA Method 9, incorporated and adopted by reference in Chapter 62-297, F.A.C. Test procedures shall meet all applicable requirements of Chapter 62-297, F.A.C.

Recordkeeping and Reporting Requirements

C.8. If TEC chooses to conduct a visible emissions compliance test only once per five-year period, per Rule 62-297.310(7)(a)8., daily recordkeeping of the hours of operation is required to show that the 400-hour annual limit is not exceeded each year during the five-year period.

[Rule 62-297.310(7)(a)8., and Rule 62-4.070(3), F.A.C.]

C.9. Documentation of the type, quantity, and analysis of the fuel oil used/received is required. Records shall be kept for five years.

[Rules 62-4.070(3) and 62-213.440(1), F.A.C.]

C.10. The average daily and total annual hours of operation for each combustion turbine shall be submitted in an annual operation report. In addition, for each combustion turbine, annual emissions reporting requirements, apply to emissions of each pollutant that a turbine emits in the following quantities:

- (1) for PM₁₀, sulfur oxides, VOC, and nitrogen oxides - 25 tons per year or more,
- (2) for carbon monoxide - 250 tons per year or more,
- (3) for lead or lead compounds, measured as elemental lead - 5 tons per year or more.

[62-210.370(3), F.A.C., 40 CFR 51.322(b)]

Tampa Electric will evaluate emissions from the turbines through the use of AP-42 emission factors or another equivalent method such as fuel analysis. [USEPA objection resolution.]

Compliance Demonstrations

C.11. Records: All measurements, records, and other data required by this permit shall be documented in a permanent, legible format and retained for at least five (5) years following the date on which such measurements, records, or data are recorded. Records shall be made available to DEP representatives upon request. [Rules 62-4.160(14) and 62-213.440(1)(b)2., F.A.C.]

C.12. Monthly Operations Summary: By the fifth calendar day of each month, the permittee shall record the following information in a written log for the previous month of operation and for the previous 12 months of operation: the number of operational hours for each gas turbine; the number of hours of inlet air fogging for each gas turbine; and the total combined number of hours of inlet air fogging for both gas turbines. The Monthly Operations Summary shall be maintained on site in a legible format available for inspection at the Department's request. [Rule 62-4.160(15), F.A.C.]

Subsection D. Flyash Handling and Storage

This section addresses the following Regulated Emissions Units:

<u>E.U. ID No.</u>	<u>Brief Description</u>
-008	Fly Ash Silo No. 1 Baghouse
-018	Fly Ash Silo No. 1 Truck Loadout
-009	Fly Ash Silo No. 2 Baghouse
-019	Fly Ash Silo No. 2 Truck Loadout
-026	Fly Ash Handling and Storage Fugitive Emissions (all except silos)

Descriptions

Fly Ash Silo No. 1 handles fly ash from Steam Generator Units No. 1 and No. 2. Fly ash is pneumatically conveyed from the individual electrostatic precipitators to Silo No. 1. Also, the fly ash may be pneumatically conveyed from tanker trucks to and/or from Silo No. 2 to Silo No. 1. The sum total loading rate to the silo for all the processes combined is 44.5 tons per hour. Fly ash from Silo No. 1 is discharged in either a wet or dry state. The dry fly ash is gravity fed by tubing into totally enclosed tanker trucks. The wet fly ash is processed through a pugmill and then unloaded into a dump truck. Particulate matter emissions generated by silo loading and silo unloading to a tanker truck are controlled by a 20,081 DSCFM Flex Kleen Model No. 84 UDTR-640 baghouse in addition to reasonable precautions. All fly ash handled is generated on-site.

Fly Ash Silo No. 2 handles fly ash from Steam Generator Units Nos. 1, 2, and/or 3. Fly ash is pneumatically conveyed in a series of pipes from the individual unit precipitators (Units 1, 2, and/or 3, only two units at any time) to the silo for temporary storage. Fly ash from Silo No. 2 is discharged in either a wet or dry state. From the silo, the dry fly ash is gravity fed by tubing into closed tanker trucks and transported to an off-site consumer. The wet fly ash is processed through a pugmill and then unloaded into a dump truck to be transported to an off-site consumer. Particulate emissions generated during silo loading operation and from the tanker truck loadout chutes are controlled by a 20,081 DSCFM Flex Kleen, Model No. 84 UDTR-640 baghouse in addition to reasonable precautions.

The following conditions apply to the Emissions Units listed above:

Essential Potential to Emit (PTE) Parameters

D.1. Capacity. The maximum permitted loading rate for all Fly Ash Silo No. 1 processes combined is 44.5 tons per hour. The maximum permitted loading rate for all Fly Ash Silo No. 2 processes combined is 44.5 tons per hour. For Fly Ash Silo No. 2, the maximum permitted loading rate is the simultaneous maximum transfer of fly ash from boiler Units 1, 2, and 3. Separate testing of emissions from each unit shall be conducted with each emissions unit operation at 90 to 100 percent of the maximum permitted capacity heat input rate. If it is impractical to test at permitted capacity, an emissions unit may be tested at less than the maximum minimum permitted capacity; in this case, subsequent emissions unit operation is limited to 110 percent of the test rate load until a new test is conducted. Once the unit is so limited, operation at higher capacities is allowed for no more than 15 consecutive days for the purpose of additional compliance testing to regain the authority to operate at the permitted capacity. [AC29-194516; AO29-161082; Rule 62-4.160(2), and Rule 62-297.310(2), F.A.C.]

~~{Permitting note: The material loading limitations have been placed in each permit to identify the capacity of each emissions unit for the purposes of confirming that emissions testing is conducted within 90 to 100 percent of the emissions unit's rated capacity (or to limit future operation to 110 percent of the test load), to establish appropriate emission limits and to aid in determining future rule applicability. Regular recordkeeping is not required for material loading. Instead the owner or operator is expected to determine material loading whenever the emission testing is required, to demonstrate at what percentage of the rated capacity that the emissions unit was tested. Rule 62-297.310(5), F.A.C., included in the permit, requires measurement of process variables for emission tests. Material loading demonstrations may be based on best engineering evaluation of the operating requirements necessary to achieve 90 to 100 percent of the rated loading, unless such operating conditions are otherwise specified by permit condition.}~~

D.2. Hours of Operation. Fly Ash Silos No. 1 and No. 2 are each allowed to operate continuously, i.e., 8760 hours/year.

[Rule 62-210.200, F.A.C., Definitions (PTE)]

Emission Limitations and Standards

D.3. Visible emissions from each silo baghouse shall not be equal to or greater than 20 percent opacity. Visible emissions from each silo truck loadout shall not be equal to or greater than 20 percent opacity.

[Rule 62-296.320(4)(b)1., F.A.C.]

D.4. Visible emissions from the flyash handling system and flyash silos are limited to 5% opacity.

[Power Plant Siting Certification PA 79-12]

D.5. Total maximum allowable emissions of particulate matter from the each silo baghouse shall not exceed 0.03 grains/DSCF, 5.16 lbs./hr. and 22.62 tons/yr. based on a design flow rate of 20,081 DSCFM. The requirement of formal particulate matter compliance testing as provided in specific condition D.6. shall be waived if the baghouse meets the alternative standard of 5% opacity. If the Department or the Environmental Protection Commission of Hillsborough County has reason to believe that the particulate weight emission standard is not being met, the agency shall require that compliance be demonstrated by EPA Method 17 specified in Rule 62-297, F.A.C.

[Rule 62-4.160(2) and Rule 62-297.620(4), F.A.C.; AO29-160255; AO29-161082]

Test Methods and Procedures

D.6. During each federal fiscal year (October 1 - September 30), unless otherwise specified by rule, order, or permit, the Tampa Electric Company shall have formal compliance tests conducted on each silo baghouse for opacity and particulate matter and formal compliance test conducted on each silo truck loadout for opacity.

[Rule 62-297.310(7)(a)4., F.A.C.]

D.7. The test method for particulate emissions shall be EPA Method 17, with an acetone wash and an average stack temperature below 275 degrees Fahrenheit, or EPA Method 5 with an acetone wash. These test methods are incorporated and adopted by reference in Chapter 62-297, F.A.C. Test procedures shall meet all applicable requirements of Chapter 62-297, F.A.C.

[Rules 62-296.320(4)(a)3.a.(ii) and 62-296.320(4)(a)3.c., F.A.C.]

D.8. The test methods for visible emissions shall be EPA Method 9, incorporated and adopted by reference in Chapter 62-297, F.A.C. Test procedures shall meet all applicable requirements of Chapter 62-297, F.A.C.

[Rule 62-296.320(4)(b)4., F.A.C.]

D.9. All reasonable precautions shall be taken to prevent and control generation of unconfined emissions of particulate matter in accordance with the provisions in Rule 62-296.320(4), F.A.C. These provisions are applicable to any source, including, but not limited to, vehicular movement, transportation of materials, construction, alterations, demolition or wrecking, or industrial related activities such as loading, unloading, storing and handling. The following reasonable precaution shall be taken to control unconfined particulate matter emissions associated with the fly ash silo/truck operations. Reasonable precautions shall include, but not limited to:

- A) Fly ash transported by dump truck shall be adequately wetted and processed through the pugmill.
- B) Dump trucks used to transport fly ash shall utilize tarps at all times except when loading/unloading.
- C) Fly ash transported in a dry state shall be accomplished utilizing an enclosed tanker truck.
- D) Fly ash spilled and/or leaked on plant grounds shall be adequately wetted and disposed of daily.
- E) Fly ash collected from spills and/or leaks must be adequately wetted at all times.
- F) Ensure the proper seating of the unloader chute onto the tanker inlet prior to loading.
- G) Keep the dust extractor operational during loading.
- H) Close the tanker's inlet as soon as practical after the loading process.
- I) Extend the tubing from the silo into the closed tanker type trucks during loadout.
- J) Periodic watering of plant roads.

[Rule 62-296.320(4)(c)2., F.A.C., AO29-160255, and precautions specified in initial Title V application.]

D.10. Compliance testing for the silo and tanker truck loading operations shall be conducted under the following conditions:

- a. All conveyance hoppers will be operational during the test.
- b. All fly ash will be directed to the silo, no reinjection of fly ash to the boiler systems will occur during the test.
- c. The boilers shall operate at the maximum capability of this unit under normal operating conditions during the test.
- d. Two tanker trucks shall be loaded during the test. The loading valve shall be completely open to allow 90%-100% of the maximum loading rate during testing filling. Position of the valve during testing shall be recorded.
- e. The visible emission test shall be at least 30 minutes in duration and the period of time during which truck loading occurred indicated on the test report.

[Rules 62-4.070(3) and 62-297.310, F.A.C.].

D.11. Compliance with the emission limitations of Specific Conditions Nos. 3 and 4 shall be determined using EPA Methods 1, 2, 4, 5 and 9 contained in 40 CFR 60, Appendix A and adopted by reference in Rule 62-297.401, F.A.C. The Method 9 observation period for the silo and tanker truck loading operations shall be at least thirty (30) minutes in duration. The minimum requirements for stack sampling facilities, source sampling and reporting, shall be in accordance with Rule 62-297, F.A.C. and 40 CFR 60, Appendix A.

[Rule 62-297, F.A.C.]

D.12. All compliance tests shall be conducted while loading the silo at approximately the maximum feed rate (24 hour average). Failure to submit the feed rate or operating at conditions during testing which do not reflect normal operating conditions may invalidate the data. [Rule 62-4.070(3), F.A.C.].

Subsection E. Flyash Silo No. 3

This section addresses the following Regulated Emissions Units:

<u>E.U. ID No.</u>	<u>Brief Description</u>
-014	Fly Ash Silo No. 3 Baghouse
-027	Fly Ash Silo No. 3 Truck Loadout
-028	Fly Ash Handling System Fugitive Emissions

Description

Fly Ash Silo No. 3 handles fly ash from Steam Generator Unit No. 4. Also, fly ash may be pneumatically conveyed from tanker trucks to Silo No. 3. Particulate matter emissions are controlled by a 1,200 DSCFM Flex Kleen Model 84-WRTC-80-II-G baghouse. The wet flyash ~~may be~~ is processed through a pugmill and then unloaded into a dump truck.

The following conditions apply to the Emissions Unit listed above:

Essential Potential to Emit (PTE) Parameters

E.1. Particulate matter emissions from the flyash handling system and flyash silo shall not exceed 0.2 lb/hr.

[Power Plant Siting Certification PA 79-12; PSD-FL-040]

E.2. Visible emissions from the flyash handling system and the flyash silo are limited to 5% opacity.

[Power Plant Siting Certification PA 79-12]

E.3. The flyash handling system (including transfer and silo storage) will be maintained at negative pressures and vented to a control system.

[PSD-FL-040]

E.4. Tampa Electric will perform an annual VE test to satisfy the periodic monitoring requirements of these conditions. In addition, the system pressure will be monitored quarterly to assess that the system is operating under negative pressure.

[USEPA objection resolution.]

Subsection F. Limestone Handling and Storage

This section addresses the following Regulated Emissions Units:

<u>E.U. ID No.</u>	<u>Brief Description</u>
-011	Truck/Railcar Limestone Unloading Receiving Hopper with baghouse
-012	Limestone Silo A with 2 baghouses
-013	Limestone Silo B with 2 baghouses
-023	Limestone Handling Conveyor LB to Conveyor LC with baghouse, Limestone Handling Conveyor LD to Conveyor LE with baghouse
-024	Limestone Handling Conveyor LE to South Storage Silo with baghouse, Limestone Handling Conveyor LE to North Storage Silo with baghouse
-025	Limestone Storage and Handling Fugitive Emissions

Descriptions

~~Particulate matter emissions from the truck and railcar unloading of limestone are controlled by a Mikro-Pulsaire Model 400S12TR baghouse. Particulate matter emissions generated by the transfer of limestone from Handling Conveyor LB to Conveyor LC are controlled by a Sternvent Model DKED18003 baghouse. Particulate matter emissions generated by the transfer of limestone from Handling Conveyor LD to Conveyor LE are controlled by a Sternvent Model DKED 18003 baghouse. Particulate matter emissions generated by the transfer of limestone from Handling Conveyor LE to the South Storage Silo are controlled by a Flex Kleen Model 58-BVBC-36-HG baghouse. Particulate matter emissions generated by the transfer of limestone from Handling Conveyor LE to the North Storage Silo are controlled by a Flex Kleen Model 58-BVBC-36-HG baghouse.~~

The following conditions apply to the Emissions Units listed above:

Essential Potential to Emit (PTE) Parameters

F.1. Total combined particulate matter emissions from the limestone handling hoppers/conveyors shall not exceed 0.65 lb/hr. Visible emissions are limited to 5% opacity. Compliance testing for particulate matter emissions is not required provided the opacity limit is maintained.
[PSD-FL-040; Power Plant Siting Certification PA 79-12]

F.2. Total combined particulate matter emissions from the limestone silos shall not exceed 0.05 lb/hr. Visible emissions are limited to 5% opacity. Compliance testing for particulate matter emissions is not required provided the opacity limit is maintained.
[PSD-FL-040; Power Plant Siting Certification PA 79-12]

F.3. All conveyors and conveyor transfer points shall be enclosed to preclude particulate matter emissions.
[PSD-FL-040]

F.4. The limestone handling receiving hopper, conveyor transfer points and silos shall be maintained at negative pressures with the exhaust vented to a control system(s).
[PSD-FL-040]

F.5. Tampa Electric will perform an annual VE test to satisfy the periodic monitoring requirements of these conditions. In addition, the system pressure will be monitored quarterly to assess that the system is operating under negative pressure.
[USEPA objection resolution.]

Subsection G. Coal Bunkers with Roto-Clones

This section addresses the following Regulated Emissions Units:

<u>E.U. ID No.</u>	<u>Brief Description</u>
-015	Unit No. 1 Coal Bunker with Roto-Clone
-016	Unit No. 2 Coal Bunker with Roto-Clone
-017	Unit No. 3 Coal Bunker with Roto-Clone
-039	Unit No. 4 Coal Bunker with Roto-Clone

Descriptions

These emission units are Steam Generator Units Nos. 1- ~~43~~ Coal Bunkers with an exhaust fan/cyclone collector (Roto-Clone) controlling dust emission from each unit's respective bunker. Two moving transfer stations via their respective conveyor belts route coal through enclosed chutes to the various bunkers. Coal Bunkers 1- ~~43~~ are each equipped with a 9400 ACFM American Air Filter (AAF) Company Type D Roto-Clone to abate dust emissions during ventilation. A number of vent pipes convey fresh air from each bunker to a Roto-Clone during particulate matter removal. Particulate matter removed by the Roto-Clones is returned to the coal bunkers via a hopper and return line. Unit No. 1 Coal Bunker is situated west of Unit No. 2 Coal Bunker. Unit No. 3 Coal Bunker is situated east of Unit No. 2 Coal Bunker. ~~Unit No. 4 Coal Bunker is located east of Unit No. 3~~

The following conditions apply to the Emissions Units listed above:

Essential Potential to Emit (PTE) Parameters

G.1. Capacity.. The annual coal throughput shall not exceed 4,000 TPH per bunker.
[Rule 62-4.160(2), F.A.C.]

G.2. Hours of Operation. To show compliance with the annual allowable emission rate, the hours of bunker loading operation shall not exceed 4167 hours per year.
[Rule 62-210.200, F.A.C., Definitions (PTE)]

Emission Limitations and Standards

G.3. Visible emissions from each unit shall not be equal to or greater than 20% opacity. The test method for visible emissions shall be EPA Method 9, incorporated and adopted by reference in Chapter 62-297, F.A.C.
[Rule 62-296.320(4)(b)1. and 4., F.A.C.]

G.4. Since a source of less than 1 TPY is exempt from particulate matter RACT provisions, the maximum allowable particulate emissions shall not exceed 0.99 tons per year from each ~~rotoclone~~ ~~eyclone~~ exhaust. Also maximum allowable particulate matter emissions shall not exceed 0.48 lbs/hr from each cyclone exhaust.
[AO29-163788 to escape RACT]

G.5. The maximum allowable emission rate for particulate matter for this source is set by specific condition no. G.4. Because of the expense and complexity of conducting a stack test on minor sources

of particulate matter, the Department hereby waives the requirement for a stack test. The alternative standard establishes a visible emission limitation not to exceed an opacity of 5%. Compliance with this alternate emission limitation shall be determined using DEP Method 9 contained in 62-297.401, F.A.C.

[AO29-163788]

G.6. Should the Department have reason to believe the particulate matter emission standard is not being met, the Department may require that compliance with the particulate emission standards be demonstrated by testing using EPA Methods 1, 2, 4 and 5 in accordance with 62-297.401, F.A.C.

[Rule 62-297.310(7)(b), F.A.C.]

G.7. Tampa Electric will monitor the hours of operation of coal bunker loading. In addition, Tampa Electric will perform an annual VE test to satisfy the periodic monitoring requirements of this condition.

[USEPA objection resolution.]

Subsection H. Solid Fuel Yard

This section addresses the following Regulated Emissions Units:

<u>E.U. ID No.</u>	<u>Brief Description</u>
-010	Solid Fuel Yard, Fugitive Emissions
-029	Cyclone collectors for fuel blending bins (FH-032 through FH-035)
-030	Cyclone collectors for fuel mills crushers (FH-048 and FH-049)
-031	Cyclone collectors for bunkers (FH-059 through FH-062)

Descriptions

Solid fuel is unloaded from ship/barge into the Solid fuel yard, the blending bins or directly to the tripper room via belt conveyors. Solid fuel from the piles is loaded onto belt conveyors using a rail mounted or mobile reclaimer. The solid fuel is then belt conveyed to the blending bins tower, which consists of six storage bins, where the solid fuel may be blended for use at the plant, or transloaded into trucks for shipment off site. From the solid fuel yard conveyors, the solid fuel is screw conveyed into the bins. Particulate matter (PM) emissions from the conveyors in the blending bins solid fuel yard are controlled by 3 4 rotocones, one at the conveyor drop, and one for every 2 bins. PM emissions from the screw conveyor are controlled by the fourth rotocone. Blending bins can either Each has 2 hoppers, which feed the transloader, or solid fuel can be are conveyed, via 2 parallel belts (T1, T2) to 2 crushers (each belt has a crusher), or diverted directly to the tripper room. PM emissions from the 2 crushers and transfer tower are controlled by 2 rotocones.

From the tripper room solid fuel yard, the solid fuel is conveyed to the tripper room where 2 trippers bunker the solid fuels into 4 solid fuel bunkers. Each unit has its own respective bunker. Solid fuel samples are taken every 15 minutes during bunking, and composited for analysis. From the bunkers, the solid fuel is gravity fed into 14 mills crushers, and then gravity-fed into the boilers. There are 3 ball mills tall crushers, each for Unit Nos. 1 – 3, and 5 bowl mills crushers for Unit No. 4. From the mills crushers, the solid fuel is pneumatically fed into classifiers, two for each crusher mill on Unit Nos. 1-3, and one for each mill on Unit No. 4 for a total of 238 classifiers, and then into the respective boilers.

The following conditions apply to the Emissions Units listed above:

H.1. TEC shall maintain a daily log of the amounts and types of fuels used and copies of fuel analyses containing information on sulfur content, ash content and heating values.

[Power Plant Siting Certification PA 79-12]

H.2. Particulate matter emissions from the solid fuel handling facilities:

(a) Pursuant to Chapter 1-3.62 Rules of the Environmental Protection Commission of Hillsborough County, visible emission shall not exceed 20% opacity for any unconfined emission unit in the fuel yard. Unconfined emissions as defined by Rule 62-296.200, F.A.C., shall include the static fuel piles, etc. Pursuant to Rule 62.296.711(2), F.A.C., visible emissions shall not exceed 5 percent opacity for the remaining emission units in the fuel yard. Visible emissions compliance tests shall be demonstrated using EPA Reference Method 9, 40 CFR Part 60, Appendix A, Visual Determination of Fugitive Emissions from Material Sources (July 1, 1993 version). All testing shall be done within 90 days of completing reconfiguration of the fuel yard, and prior notification of testing shall be submitted in writing at least 15 days beforehand to the EPC of Hillsborough County. Particulate emissions shall

be controlled by use of control devices. Tampa Electric will perform an annual VE test to demonstrate compliance with the opacity standard established for the solid fuel yard.

(b) The permittee must submit to the Department within ten (10) working days after it becomes available, copies of technical data pertaining to the selected particulate emissions control for the coal handling facility. These data should include, but not be limited to, guaranteed efficiency and emission rates, and major design parameters such as air/cloth ratio and flow rate. The Department may, upon review of these data, disapprove the use of such device if the Department determines the selected control device to be inadequate to meet the emission limits specified in condition (a) above. Such disapproval shall be issued within 30 days of receipt of the technical data.

(c) The fuel pile operations are subject to Rule 62-296.310(3), F.A.C., Unconfined Emissions of Particulate Matter. Reasonable precautions to minimize unconfined particulate matter shall be in accordance with Rule 62-296.310(3)(c), F.A.C.,; and, may include, but shall not be limited to, the coating of roads and construction sites used by contractors and regrassing or watering areas of disturbed fuel.

(d) From each fuel transloading source/emissions point (i.e., off-loading and loading of fuel {for export from Big Bend Station}), the maximum hourly transloading transfer of fuel shall not exceed 4,000 tons, 24-hour rolling average.

(e) From each fuel transloading source/emissions point, (i.e., off-loading and loading of fuel {for export from Big Bend Station}), the maximum annual transloading transfer of fuel shall not exceed 1,428,030 tons.

(f) The number of railcars and trucks and the quantity of fuel loaded by each fuel transloading source/emissions point (i.e., off-loading and loading of fuel {for export from Big Bend Station*}) shall be recorded, maintained, and kept on file for a minimum of five years. The annual quantity of fuel loaded by each fuel transloading source/emissions point shall be submitted in the Annual Operation Report.

[Power Plant Siting Certification PA 79-12]

*Permitting Note.

H.3. All conveyors and conveyor transfer points shall be enclosed to preclude particulate matter emissions excepting the coal handling stacker reclaimer, the tail end conveyor feeding the tripper and the barge unloading belt which are exempted for feasibility considerations.

[PSD-FL-040]

H.4. Coal storage piles shall be shaped, compacted and oriented to minimize wind erosion.

[PSD-FL-040]

H.5. Water sprays for storage piles, handling equipment, etc., including the handling equipment exempted from the conveyor enclosure requirement, shall be applied during dry periods and as necessary to all facilities to maintain opacity below 20 percent.

[Rules 62-4.160(2) and 62-296.320(4)(c), F.A.C.]

Subsection I. Surface Coating of Miscellaneous Metal Parts

This section addresses the following Regulated Emissions Units:

-032 Surface coating of miscellaneous metal parts

Description

These conditions apply to the surface coating of miscellaneous metal parts as defined in Rule 62-296.513, F.A.C. These parts include such things as pumps, compressors, conveyor components, fans, blowers, transformers.

The following conditions apply to the Emissions Unit listed above:

I.1. Hours of Operation. Miscellaneous metal parts surface coating operations are allowed to operate for a total 3500 hours/year.

[Rule 62-210.200, F.A.C., Definitions (PTE)]

I.2. Capacity. The total maximum coating usage shall not exceed 2 gallons per hour, on a 24-hr basis, and 7000 gallons per year.

[Rule 62-210.200, F.A.C., Definitions (PTE)]

I.3. Recordkeeping. TEC shall maintain daily records of operations for the most recent 5 year period. The records shall be made available to the local, state, or federal air pollution agency upon request. The records shall include, but not be limited to, the following:

- a. The rule number applicable to the operation for which the records are being maintained.
- b. The application method and substrate type (metal, etc.).
- c. The amount and type of adhesive, coatings (including catalyst and reducer for multicomponent coatings), solvent, and/or graphic arts material used at each point of application, including exempt compounds.
- d. The VOC content as applied in each adhesive, coating, solvent, and/or graphic arts material.
- e. The date for each application of each adhesive, coating, solvent, and/or graphic arts material.
- f. The amount of surface preparation, clean-up, wash-up of solvent (including exempt compounds) used and the VOC content of each.

[Rule 62-296.500(2)(b)1., F.A.C.]

I.4. The VOC content shall be calculated using a percent solids basis (less water and exempt solvents) for adhesives, coating, and inks, using EPA Reference Method 24.

[Rule 62-296.500(2)(b)2., F.A.C.]

I.5. Reporting. Annually, in accordance with a schedule and reporting format provided by the Department or EPCHC, TEC shall provide EPCHC with proof of compliance with the limitations in this section.

[Rule 62-296.500(2)(c), F.A.C.]

The following conditions apply to the Emissions Unit listed above if the Emissions Unit emits more than 15 pounds of VOC in any one day and 3 pounds VOC in any one hour:

I.6. Emissions Limits for surface coating of miscellaneous metal parts.

(a) No owner or operator of a coating line for miscellaneous metal parts and products shall cause, allow, or permit the discharge into the atmosphere of any volatile organic compounds in excess of:

(1) 4.3 pounds per gallon of coating (0.52 kilograms per liter), excluding water, delivered to a coating applicator that applies clear coatings;

(2) 3.5 pounds per gallon of coating (0.42 kilograms per liter), excluding water, delivered to a coating applicator in coating application system that is air dried or forced warm air dried at temperatures up to 194 degrees Fahrenheit (90 degrees Celsius);

(3) 3.5 pounds per gallon of coating (0.42 kilograms per liter), excluding water, delivered to a coating applicator that applies extreme performance coatings; or,

(4) 3.0 pounds per gallon of coating (0.36 kilograms per liter), excluding water, delivered to a coating applicator for all other coatings and coating application systems.

(b) If more than one emission limitation in condition I.6.(a) above applies to a specific coating, then the least stringent emission limitation shall be applied.

(c) All volatile organic compound emissions from solvent washings shall be considered in the emission limitations in condition I.6.(a) above unless the solvent is directed into containers that prevent evaporation into the atmosphere.

[Rule 62-296.513(2), F.A.C.]

I.7. Control Technology. The emission limits in condition I.6.(a) above shall be achieved by: The application of low solvent coating technology.

[Rule 62-296.513(3), F.A.C.]

I.8. Test Methods and Procedures to Determine Low Solvent Technology. The test method for volatile organic compounds shall be EPA Method 24 or EPA 450/3-84-019, incorporated and adopted by reference in Chapter 62-297, F.A.C. Test procedures shall meet all applicable requirements of Chapter 62-297, F.A.C.]

[Rules 62-296.513(4)(a) and (c), F.A.C.]

Subsection J. Abrasive Blasting

This section addresses the following Regulated Emissions Units:

- 033 Abrasive Blast Booth with baghouse**
- 034 Abrasive Blast Media Storage with baghouse**

Description

The abrasive blast booth is used to prepare miscellaneous metal parts for surface coating. Particulate matter emissions from the abrasive blast booth are controlled by a Torit Model No. DFT 4-16 pulse jet baghouse with an inlet flow rate of 7,500 acfm. Particulate emissions from the abrasive blast media storage are controlled by a pulse jet baghouse with an inlet air flow rate of 800 dscfm.

The following conditions apply to the Emissions Units listed above:

J.1. Capacity. The maximum annual usage of abrasive blast media in the abrasive blast booth shall not exceed 300 tons per year.

[Rules 62-4.160(2), 62-210.200(PTE)]

J.2. Hours of Operation. These emissions units are each allowed to operate continuously, i.e., 8760 hours/year.

[Rule 62-210.200, F.A.C., Definitions (PTE)]

J.3. Emission Limitations. The particulate matter emissions from each baghouse shall not exceed 0.03 gr/dscf, or any visible emissions greater than 5% opacity. However, TEC may exceed these emission limits if a pollution control device for particulate matter is utilized that has an actual particulate matter collection efficiency of at least 98 percent. The opacity standard for the emissions units shall be the average opacity level achieved during the initial compliance test which established compliance with the standard, plus 5% opacity.

[Rules 62-296.712(2), F.A.C.]

J.4. Test Methods and Procedures.

(a) The test method for visible emissions shall be EPA Method 9, incorporated and adopted by reference by reference in Chapter 62-297, F.A.C.

(b) The test method for particulate matter emissions shall be EPA Method 5, incorporated and adopted by reference in Chapter 62-297, F.A.C. The minimum sample volume shall be 30 dry standard cubic feet.

(c) A visible emissions test indicating no visible emissions (5 percent opacity) may be submitted in lieu of a particular stack test for materials handling emissions subject to this rule, where the emissions unit is equipped with a baghouse.

(d) Test procedures shall meet all applicable requirements of Chapter 62-297, F.A.C.

[Rule 62-296.712(3), F.A.C.]

J.5. Particulate matter emissions from the abrasive blasting operations shall not exceed 15 tons for any 12 consecutive month period.

[Rule 62-212.300, F.A.C.]

J.6. No used or waste oils shall be burned in the diesel compressors. The observation point for the blasting operation tests shall be at the point of maximum opacity leaving the enclosure.

[Rule 62-070(3), F.A.C.]

J.7. TEC shall maintain monthly records on the type and amount of abrasive blasting material used . A rolling 12-month total shall be kept as well.

[Rule 62-070(3), F.A.C.]

J.8. During each month that the Abrasive Blast Booth is used, a VE test must be performed. A monthly VE test is not required during any month that the Abrasive Blast Booth is not used. During each month that abrasive blast media is transferred to or from Abrasive Blast Media Storage, a VE test must be performed. A monthly VE test is not required during any month that no abrasive blast media is transferred to or from Abrasive Blast Media Storage. However, at a minimum, an annual VE test must be performed.

[USEPA objection resolution.]

Subsection K. Surface Coating of Ships

This section addresses the following Regulated Emissions Units:

-035 Surface coating of ships

Description

Surface coating maintenance of ships.

The following conditions apply to the Emissions Units listed above:

K.1. The emissions unit must comply with the attached 40 CFR 63 Subpart A – General Provisions modified for Subpart II.

[40 CFR 63 Subpart A, Rule 62-204.800, F.A.C.]

K.2. This emissions unit must also comply with the following:

40 CFR 63 Subpart II – National Emission Standards for Shipbuilding and Ship Repair (Surface Coating)

{Source: 40 CFR 63 Subpart II (7/1/96 version), and Fed. Register revision dated 12/17/96}

63.781 Applicability

63.782 Definitions

63.783 Standards.

63.784 Compliance dates.

63.785 Compliance procedures.

63.786 Test methods and procedures.

63.787 Notification requirements.

63.788 Recordkeeping and reporting requirements.}

§ 63.781 Applicability.

(a) The provisions of this subpart apply to shipbuilding and ship repair operations at any facility that is a major source.

(b) The provisions of this subpart do not apply to coatings used in volumes of less than 200 liters (52.8 gallons) per year, provided the total volume of coating exempt under this paragraph does not exceed 1,000 liters per year (264 gallons per year) at any facility. Coatings exempt under this paragraph shall be clearly labeled as “low-usage exempt,” and the volume of each such coating applied shall be maintained in the facility’s records.

(c) The provisions of this subpart do not apply to coatings applied with hand-held, nonrefillable, aerosol containers or to unsaturated polyester resin (i.e., fiberglass lay-up) coatings. Coatings applied to suitably prepared fiberglass surfaces for protective or decorative purposes are subject to this subpart.

(d) The provisions in subpart A of this part [See specific condition K.1., General Provisions] pertaining to startups, shutdowns, and malfunctions and continuous monitoring do not apply to this source category unless an add-on control system is used to comply with this subpart in accordance with § 63.783(c).

The following specific conditions from 40 CFR Part 63, Subpart II - Shipbuilding and Ship Repair (Surface Coating) apply:

40 CFR 63.783 Standards

(a) No owner or operator of any existing or new affected source shall cause or allow the application of any coating to a ship with an as-applied VOHAP content exceeding the applicable limit given in Table 2 of this subpart (see attachment), as determined by the procedures described in 40 CFR 63.785(c)(1)-(4). For the compliance procedures described in 40 CFR 63.785(c)(1)-(3), VOC shall be used as a surrogate for VOHAP, and the EPA Reference Method 24 shall be used as the definitive measure for determining compliance. For the compliance procedure described in 40 CFR 63.785(c)(4), an alternative test method capable of measuring independent VOHAP shall be used to determine compliance. The method must be submitted to and approved by the Administrator.

[40 CFR 63.783(a)]

(b) Each owner or operator of a new or existing affected source shall ensure that:

(1) All handling and transfer of VOHAP-containing materials to and from containers, tanks, vats, drums, and piping systems is conducted in a manner that minimizes spills.

(2) All containers, tanks, vats, drums, and piping systems are free of cracks, holes, and other defects and remain closed unless materials are being added to or removed from them.

[40 CFR 63.783(b)]

(c) Approval of alternative means of limiting emissions

(1) The owner or operator of an affected source may apply to the Permitting authority for permission to use an alternative means (such as an add-on control system) of limiting emissions from coating operations. The application must include:

(i) An engineering material balance evaluation that provides a comparison of the emissions that would be achieved using the alternative means to those that would result from using coatings that comply with the limits in Table 2 of this section, or the results from an emission test that accurately measures the capture efficiency and control device efficiency achieved by the control system and the composition of the associated coatings so that the emissions comparison can be made;

(ii) A proposed monitoring protocol that includes operating parameter values to be monitored for compliance and an explanation of how the operating parameter values will be established through a performance test; and

(iii) Details of appropriate recordkeeping and reporting procedures.

(2) The Permitting authority shall approve the alternative means of limiting emissions if, in the Permitting authority's judgment, postcontrol emissions of VOHAP per volume applied solids will be no greater than those from the use of coatings that comply with the limits in Table 2 of this section.

(3) The Permitting authority may condition approval on operation, maintenance, and monitoring requirements to ensure that emissions from the source are no greater than those that would otherwise result from this subpart. [Rule 62-296.820, F.A.C.; 40 CFR 63.783(c)]

40 CFR 63.784 Compliance Dates

(a) Each owner or operator of an existing affected source shall comply by 12/16/97.
[40 CFR 63.784(a)]

(b) Each owner or operator of an existing unaffected area source that increases its emissions of (or its potential to emit) HAP such that the source becomes a major source that is subject to this subpart shall comply within 1 year after the date of becoming a major source.
[40 CFR 63.784(b)]

(c) Each owner or operator of a new or reconstructed source shall comply with this subpart according to the schedule in 40 CFR 63.6(b) of subpart A.
[40 CFR 63.784(c)]

40 CFR 63.785 Compliance Procedures

(a) For each batch of coating that is received by an affected source, the owner or operator shall (see Figure 1 for a flow diagram of the compliance procedures):

(1) Determine the coating category and the applicable VOHAP limit as specified in 40 CFR 63.783(a).

(2) Certify the as-supplied VOC content of the batch of coating. The owner or operator may use a certification supplied by the manufacturer for the batch, although the owner or operator retains liability should subsequent testing reveal a violation. If the owner or operator performs the certification testing, only one of the containers in which the batch of coating was received is required to be tested.
[40 CFR 63.785(a)]

(b) (1) In lieu of testing each batch of coating, as applied, the owner or operator may determine compliance with the VOHAP limits using any combination of the procedures described in paragraphs (c)(1), (c)(2), (c)(3), and (c)(4) of this section. The procedure used for each coating shall be determined and documented prior to application.

(2) The results of any compliance demonstration conducted by the affected source or any regulatory agency using Method 24 shall take precedence over the results using the procedures in paragraphs (c)(1), (c)(2), or (c)(3) of this section.

(3) The results of any compliance demonstration conducted by the affected source or any regulatory agency using an approved test method to determine VOHAP content shall take precedence over the results using the procedures in paragraph (c)(4) of this section.
[40 CFR 63.785(b)]

(c) (1) Coatings to which thinning solvent will not be added. For coatings to which thinning solvent (or any other material) will not be added under any circumstance or to which only water is added, the owner or operator of an affected source shall comply as follows:

(i) Certify the as-applied VOC content of each batch of coating.

(ii) Notify the persons responsible for applying the coating that no thinning solvent may be added to the coating by affixing a label to each container of coating in the batch or through another means described in the implementation plan required in 40 CFR 63.787(b).

(iii) If the certified as-applied VOC content of each batch of coating used during a calendar month is less than or equal to the applicable VOHAP limit in 40 CFR 63.783(a) (either in terms of g/L of coating or g/L of solids), then compliance is demonstrated for that calendar month, unless a violation is revealed using Method 24.

(2) Coatings to which thinning solvent will be added--coating-by-coating compliance. For a coating to which thinning solvent is routinely or sometimes added, the owner or operator shall comply as follows:

(i) Prior to the first application of each batch, designate a single thinner for the coating and calculate the maximum allowable thinning ratio (or ratios, if the affected source complies with the cold-weather limits in addition to the other limits specified in Table 2) for each batch as follows:

$$R = \frac{(V_s)(VOHAP\ limit) - m_{VOC}}{D_{th}} \quad \text{Eqn. 1}$$

where:

R	=	Maximum allowable thinning ratio for a given batch (L thinner/L coating as supplied);
V _s	=	Volume fraction of solids in the batch as supplied (L solids/L coating as supplied);
VOHAP limit	=	Maximum allowable as-applied VOHAP content of the coating (g VOHAP/L solids);
m _{VOC}	=	VOC content of the batch as supplied [g VOC (including cure volatiles and exempt compounds on the HAP list)/L coating (including water and exempt compounds) as supplied];
D _{th}	=	Density of the thinner (g/L).

If V_s is not supplied directly by the coating manufacturer, the owner or operator shall determine V_s as follows:

$$V_s = 1 - \frac{m_{volatiles}}{D_{avg}} \quad \text{Eqn. 2}$$

where:

m _{volatiles}	=	Total volatiles in the batch, including VOC, water, and exempt compounds, (g/L coating); and
D _{avg}	=	Average density of volatiles in the batch (g/L).

The procedures specified in 40 CFR 63.786(d) may be used to determine the values of variables defined in this paragraph. In addition, the owner or operator may choose to construct nomographs, based on Equation 1, similar or identical to the one provided in appendix B as a means of easily estimating the maximum allowable thinning ratio.

(ii) Prior to the first application of each batch, notify painters and other persons, as necessary, of the designated thinner and maximum allowable thinning ratio(s) for each batch of the coating by affixing a label to each container of coating or through another means described in the implementation plan required in 40 CFR 63.787(b).

(iii) By the 15th day of each calendar month, determine the volume of each batch of the coating used, as supplied, during the previous month.

(iv) By the 15th day of each calendar month, determine the total allowable volume of thinner for the coating used during the previous month as follows:

$$V_{th} = \sum_{i=1}^n (R \times V_b)_i + \sum_{i=1}^n (R_{cold} \times V_{b-cold})_i$$

Eqn. 3

where:

- V_{th} = Total allowable volume of thinner for the previous month (L thinner);
- V_b = Volume of each batch, as supplied and before being thinned, used during non-cold-weather days of the previous month (L coating as supplied);
- R_{cold} = Maximum allowable thinning ratio for each batch used during cold-weather days (L thinner/L coating as supplied);
- V_{b-cold} = Volume of each batch, as supplied and before being thinned, used during cold-weather days of the previous month (L coating as supplied);
- i = Each batch of coating; and
- n = Total number of batches of the coating.

(v) By the 15th day of each calendar month, determine the volume of thinner actually used with the coating during the previous month.

(vi) If the volume of thinner actually used with the coating [paragraph (c)(3)(v) of this section] is less than or equal to the total allowable volume of thinner for the coating [paragraph (c)(3)(iv) of this section], then compliance is demonstrated for the coating for the previous month, unless a violation is revealed using Method 24.

(3) Coatings to which the same thinning solvent will be added--group compliance. For coatings to which the same thinning solvent (or other material) is routinely or sometimes added, the owner or operator shall comply as follows:

(i) Designate a single thinner to be added to each coating during the month and "group" coatings according to their designated thinner.

(ii) Prior to the first application of each batch, calculate the maximum allowable thinning ratio (or ratios, if the affected source complies with the cold-weather limits in addition to the other limits specified in Table 2) for each batch of coating in the group using the equations in paragraph (c)(2) of this section.

(iii) Prior to the first application of each "batch," notify painters and other persons, as necessary, of the designated thinner and maximum allowable thinning ratio(s) for each batch in the group by affixing a label to each container of coating or through another means described in the implementation plan required in 40 CFR 63.787(b).

(iv) By the 15th day of each calendar month, determine the volume of each batch of the group used, as supplied, during the previous month.

(v) By the 15th day of each calendar month, determine the total allowable volume of thinner for the group for the previous month using Equation 3.

(vi) By the 15th day of each calendar month, determine the volume of thinner actually used with the group during the previous month.

(vii) If the volume of thinner actually used with the group [paragraph (c)(3)(vi) of this section] is less than or equal to the total allowable volume of thinner for the group [paragraph (c)(3)(v) of this section], then compliance is demonstrated for the group for the previous month, unless a violation is revealed using Method 24.

(4) Demonstration of compliance through an alternative (i.e., other than Method 24) test method.
The owner or operator shall comply as follows:

(i) Certify the as-supplied VOHAP content (g VOHAP/L solids) of each batch of coating.

(ii) If no thinning solvent will be added to the coating, the owner or operator of an affected source shall follow the procedure described in 40 CFR 63.785(c)(1), except that VOHAP content shall be used in lieu of VOC content.

(iii) If thinning solvent will be added to the coating, the owner or operator of an affected source shall follow the procedure described in 40 CFR 63.785(c)(2) or (3), except that in Equation 1: the term " m_{VOC} " shall be replaced by the term " m_{VOHAP} ," defined as the VOHAP content of the coating as supplied (g VOHAP/L coating) and the term " D_{th} " shall be replaced by the term " $D_{th(VOHAP)}$ " defined as the average density of the VOHAP thinner(s) (g/L).

[40 CFR 63.785(c)]

(d) A violation revealed through any approved test method shall result in a 1-day violation for enforcement purposes. A violation revealed through the recordkeeping procedures described in paragraphs (c)(1) through (c)(4) of this section shall result in a 30-day violation for enforcement purposes, unless the owner or operator provides sufficient data to demonstrate the specific days during which noncompliant coatings were applied.

[40 CFR 63.785(d)]

40 CFR 63.786 Test Methods and Procedures

(a) For the compliance procedures described in 40 CFR 63.785(c)(1)-(3), Method 24 of 40 CFR part 60, appendix A, is the definitive method for determining the VOC content of coatings, as supplied or as applied. When a coating or thinner contains exempt compounds that are volatile HAP or VOHAP, the owner or operator shall ensure, when determining the VOC content of a coating, that the mass of these exempt compounds is included.

[40 CFR 63.786(a)]

(b) For the compliance procedure described in 40 CFR 63.785(c)(4), the Permitting authority must approve the test method for determining the VOHAP content of coatings and thinners. As part of the approval, the test method must meet the specified accuracy limits indicated below for sensitivity, duplicates, repeatability, and reproducibility coefficient of variation each determined at the 95 percent confidence limit. Each percentage value below is the corresponding coefficient of variation multiplied by 2.8 as in the ASTM Method E180-93: Standard Practice for Determining the Precision of ASTM

Methods for Analysis and Testing of Industrial Chemicals (incorporation by reference--see 40 CFR 63.14).

Sensitivity: The overall sensitivity must be sufficient to identify and calculate at least one mass percent of the compounds of interest based on the original sample. The sensitivity is defined as ten times the noise level as specified in ASTM Method D3257-93: Standard Test Methods for Aromatics in Mineral Spirits by Gas Chromatography (incorporation by reference--see 40 CFR 63.14). In determining the sensitivity, the level of sample dilution must be factored in.

Repeatability: First, at the 0.1-5 percent analyte range the results would be suspect if duplicates vary by more than 6 percent relative and/or day to day variation of mean duplicates by the same analyst exceeds 10 percent relative. Second, at greater than 5 percent analyte range the results would be suspect if duplicates vary by more than 5 percent relative and/or day to day variation of duplicates by the same analyst exceeds 5 percent relative.

Reproducibility: First, at the 0.1-5 percent analyte range the results would be suspect if lab to lab variation exceeds 60 percent relative. Second, at greater than 5 percent range the results would be suspect if lab to lab variation exceeds 20 percent relative.

Any test method should include information on the apparatus, reagents and materials, analytical procedure, procedure for identification and confirmation of the volatile species in the mixture being analyzed, precision and bias, and other details to be reported. The reporting should also include information on quality assurance (QA) auditing.

Multiple and different analytical techniques must be used for positive identification if the components in a mixture under analysis are not known. In such cases a single column gas chromatograph (GC) may not be adequate. A combination of equipment may be need such as a GC/mass spectrometer or GC/infrared system. (If a GC method is used, the operator must use practices in ASTM Method E260-91: Standard Practice for Gas Chromatography [incorporation by reference--see 40 CFR 63.14].) . [40 CFR 63.786(b)]

(c) A coating manufacturer or the owner or operator of an affected source may use batch formulation data as a test method in lieu of Method 24 to certify the as-supplied VOC content of a coating if the manufacturer or the owner or operator has determined that batch formulation data have a consistent and quantitatively known relationship to Method 24 results. This determination shall consider the role of cure volatiles, which may cause emissions to exceed an amount based solely upon coating formulation data. Notwithstanding such determination, in the event of conflicting results, Method 24 shall take precedence.

[40 CFR 63.786(c)]

(d) Each owner or operator of an affected source shall use or ensure that the manufacturer uses the form and procedures mentioned in appendix A of this subpart to determine values for the thinner and coating parameters used in Equations 1 and 2. The owner or operator shall ensure that the coating/thinner manufacturer (or supplier) provides information on the VOC and VOHAP contents of the coatings/thinners and the procedure(s) used to determine these values.

[40 CFR 63.786(d)]

40 CFR 63.787 Notification Requirements

(a) Each owner or operator of an affected source shall comply with all applicable notification requirements in 40 CFR 63.9(a)-(d) and (i)-(j) of subpart A (General Provisions), with the exception that the deadline specified in 40 CFR 63.9(b)(2) and (3) shall be extended from 120 days to 180 days. Any owner or operator that receives approval pursuant to 40 CFR 63.783(c) of this subpart to use an add-on control system to control coating emissions shall comply with the applicable requirements of 40 CFR 63.9(e)-(h) of subpart A.

[40 CFR 63.787(a)]

(b) Implementation plan. The provisions of 40 CFR 63.9(a) (Notification requirements/Applicability and general information) of subpart A apply to the requirements of this paragraph.

(1) Each owner or operator of an affected source shall:

(i) Prepare a written implementation plan that addresses each of the subject areas specified in paragraph (b)(3) of this section; and

(ii) Not later than December 16, 1996, submit the implementation plan to the Administrator along with the notification required by 40 CFR 63.9(b)(2) or (5) of subpart A, as applicable.

(2) [Reserved]

(3) *Implementation plan contents*. Each implementation plan shall address the following subject areas:

(i) *Coating compliance procedures*. The implementation plan shall include the compliance procedure(s) under 40 CFR 63.785(c) that the source intends to use.

(ii) *Recordkeeping procedures*. The implementation plan shall include the procedures for maintaining the records required under 40 CFR 63.788, including the procedures for gathering the necessary data and making the necessary calculations.

(iii) *Transfer, handling, and storage procedures*. The implementation plan shall include the procedures for ensuring compliance with 40 CFR 63.783(b).

(4) *Major sources that intend to become area sources by the compliance date*. Existing major sources that intend to become area sources by the December 16, 1997 compliance date may choose to submit, in lieu of the implementation plan required under paragraph (b)(1) of this section, a statement that, by the compliance date, the major source intends to obtain and comply with federally enforceable limits on their potential to emit which make the facility an area source.

[40 CFR 63.787(b)]

40 CFR 63.788 Recordkeeping and reporting requirements.

(a) Each owner or operator of an affected source shall comply with the applicable recordkeeping and reporting requirements in 40 CFR 63.10(a), (b), (d), and (f) of subpart A (General Provisions). Any owner that receives approval pursuant to 40 CFR 63.783(c) of this subpart to use an add-on control system to control coating emissions shall also comply with the applicable requirements of 40 CFR 63.10(c) and (e). A summary of recordkeeping and reporting requirements is provided in Table 3. [40 CFR 63.788(a)]

(b) Recordkeeping requirements.

(1) Each owner or operator of a major source shipbuilding or ship repair facility having surface coating operations with less than 1000 liters (264 gallons) annual marine coating usage shall record the total volume of coating applied at the source to ships. Such records shall be compiled monthly and maintained for a minimum of 5 years.

(2) Each owner or operator of an affected source shall compile records on a monthly basis and maintain those records for a minimum of 5 years. At a minimum, these records shall include:

- (i) All documentation supporting initial notification;
- (ii) A copy of the affected source's approved implementation plan;
- (iii) The volume of each low-usage-exempt coating applied;
- (iv) Identification of the coatings used, their appropriate coating categories, and the applicable VOHAP limit;
- (v) Certification of the as-supplied VOC content of each batch of coating;
- (vi) A determination of whether containers meet the standards as described in 40 CFR 63.783(b)(2); and
- (vii) The results of any Method 24 or approved VOHAP measurement test conducted on individual containers of coating, as applied.

(3) The records required by paragraph (b)(2) of this section shall include additional information, as determined by the compliance procedure(s) described in 40 CFR 63.785(c) that each affected source followed:

(i) Coatings to which thinning solvent will not be added. The records maintained by facilities demonstrating compliance using the procedure described in 40 CFR 63.785(c)(1) shall contain the following information:

- (A) Certification of the as-applied VOC content of each batch of coating; and
- (B) The volume of each coating applied.

(ii) Coatings to which thinning solvent will be added--coating-by-coating compliance. The records maintained by facilities demonstrating compliance using the procedure described in 40 CFR 63.785(c)(2) shall contain the following information:

- (A) The density and mass fraction of water and exempt compounds of each thinner and the volume fraction of solids (nonvolatiles) in each batch, including any calculations;
- (B) The maximum allowable thinning ratio (or ratios, if the affected source complies with the cold-weather limits in addition to the other limits specified in Table 2 of this subpart) for each batch of coating, including calculations;

(C) If an affected source chooses to comply with the cold-weather limits, the dates and times during which the ambient temperature at the affected source was below 4.5°C (40°F) at the time the coating was applied and the volume used of each batch of the coating, as supplied, during these dates;

(D) The volume used of each batch of the coating, as supplied;
(E) The total allowable volume of thinner for each coating, including calculations; and

(F) The actual volume of thinner used for each coating.

(iii) Coatings to which the same thinning solvent will be added--group compliance. The records maintained by facilities demonstrating compliance using the procedure described in 40 CFR 63.785(c)(3) shall contain the following information:

(A) The density and mass fraction of water and exempt compounds of each thinner and the volume fraction of solids in each batch, including any calculations;

(B) The maximum allowable thinning ratio (or ratios, if the affected source complies with the cold-weather limits in addition to the other limits specified in Table 2) for each batch of coating, including calculations;

(C) If an affected source chooses to comply with the cold-weather limits, the dates and times during which the ambient temperature at the affected source was below 4.5°C (40°F) at the time the coating was applied and the volume used of each batch in the group, as supplied, during these dates;

(D) Identification of each group of coatings and their designated thinners;

(E) The volume used of each batch of coating in the group, as supplied;

(F) The total allowable volume of thinner for the group, including calculations;

and

(G) The actual volume of thinner used for the group.

(iv) Demonstration of compliance through an alternative (i.e., non-Method 24) test method. The records maintained by facilities demonstrating compliance using the procedure described in 40 CFR 63.785(c)(4) shall contain the following information:

(A) Identification of the Permitting authority-approved VOHAP test method or certification procedure;

(B) For coatings to which the affected source does not add thinning solvents, the source shall record the certification of the as-supplied and as-applied VOHAP content of each batch and the volume of each coating applied;

(C) For coatings to which the affected source adds thinning solvent on a coating-by-coating basis, the source shall record all of the information required to be recorded by paragraph (b)(3)(ii) of this section; and

(D) For coatings to which the affected source adds thinning solvent on a group basis, the source shall record all of the information required to be recorded by paragraph (b)(3)(iii) of this section.

(4) If the owner or operator of an affected source detects a violation of the standards specified in 40 CFR 63.783, the owner or operator shall, for the remainder of the reporting period during which the violation(s) occurred, include the following information in his or her records:

(i) A summary of the number and duration of deviations during the reporting period, classified by reason, including known causes for which a Federally-approved or promulgated exemption from an emission limitation or standard may apply.

(ii) Identification of the data availability achieved during the reporting period, including a summary of the number and total duration of incidents that the monitoring protocol failed to perform in accordance with the design of the protocol or produced data that did not meet minimum data accuracy and precision requirements, classified by reason.

(iii) Identification of the compliance status as of the last day of the reporting period and whether compliance was continuous or intermittent during the reporting period.

(iv) If, pursuant to paragraph (b)(4)(iii) of this section, the owner or operator identifies any deviation as resulting from a known cause for which no Federally-approved or promulgated exemption from an emission limitation or standard applies, the monitoring report shall also include all

records that the source is required to maintain that pertain to the periods during which such deviation occurred and:

- (A) The magnitude of each deviation;
- (B) The reason for each deviation;
- (C) A description of the corrective action taken for each deviation, including action taken to minimize each deviation and action taken to prevent recurrence; and
- (D) All quality assurance activities performed on any element of the monitoring protocol.

[40 CFR 63.788(b)]

(c) Reporting requirements. Before the 60th day following completion of each 6-month period after the compliance date specified in 40 CFR 63.784, each owner or operator of an affected source shall submit a report to the Permitting authority for each of the previous 6 months. The report shall include all of the information that must be retained pursuant to paragraphs (b)(2)-(3) of this section, except for that information specified in paragraphs (b)(2)(i)-(ii), (b)(2)(v), (b)(3)(i)(A), (b)(3)(ii)(A), and (b)(3)(iii)(A). If a violation at an affected source is detected, the source shall also report the information specified in paragraph (b)(4) of this section for the reporting period during which the violation(s) occurred. To the extent possible, the report shall be organized according to the compliance procedure(s) followed each month by the affected source.

[40 CFR 63.788(c)]

Subsection L. Limestone Handling System for FGD System for Units 1 & 2

This section addresses the following Regulated Emissions Units:

- 020 Drops from limestone conveyors LE, LF and LG and Silo C belt feeder with baghouse
- 021 Silo C with one baghouse

Description

New components of the limestone handling system to provide limestone for the new FGD system. The components are Silo C and its related rotary unloader, belt feeder and wet ball mill, and reversible belt conveyors LF and LG. Conveyors LF and LG replace an existing bifurcated chute which feeds from conveyor LE to silos A and B. Particulate emissions from drops from limestone handling conveyors LE, LF and LG and the silo C belt feeder are controlled by a baghouse: American Air Filter Fabripulse - Model B, size 12-72-1155. Particulate emissions from displaced air in silo C will be controlled by a baghouse: American Air Filter Fabripak, size 6-16-132. The new wet ball mill is a wet process with no expected particulate emissions.

[Note: These emissions units are subject to 40 CFR 60, Subpart OOO, Standards of Performance for Nonmetallic Mineral Processing Plants (40 CFR 60.670 - 60.676) and 40 CFR 60 Subpart A; Rule 1-3.61, Rules of the Environmental Protection Commission (EPC) of Hillsborough County; Rule 62-296.700, F.A.C.; and are subject to the requirements of the state rules as indicated in this permit. The visible emission limit of specific condition 16 is more stringent than the limitations of 40 CFR 60.672(a)(2) and 60.672(f), and compliance with this limit will assure compliance with those requirements.]

The following conditions apply to the Emissions Units listed above:

OPERATIONAL REQUIREMENTS

- L.1. Hours of Operation: These emissions units may operate continuously, i.e., 8,760 hours/year. [Rule 62-210.200, F.A.C., Definitions-potential to emit (PTE)]
- L.2. Enclosure of Equipment: All conveyors and conveyor transfer points shall be enclosed and exhaust from this equipment shall be directed to a baghouse to minimize particulate matter emissions. [62-4.070(3), F.A.C.]
- L.3. Operating Procedures: Enclosures and baghouses for these emissions units shall be properly operated and maintained at all times in a condition to minimize particulate emissions. The owner and operator shall ensure that all facility staff responsible for these emissions units are trained in their operation and maintenance in accordance with the guidelines and procedures as established by the equipment manufacturers. [Rule 62-4.070(3), F.A.C.]

EMISSION LIMITATIONS AND PERFORMANCE STANDARDS

- L.4. Particulate and Visible Emissions: No owner or operator shall cause or allow visible emissions from the baghouses controlling these emissions units in excess of 0.03 gr/dscf and 5% opacity. [40 CFR 60.672(a)(1) and (2); Rules 62-4.070(3) and Rule 62-296.711(2)(b), F.A.C., Rule 1-3.61, Rules of the EPC, and request of applicant (VE limit)]

[Note: The visible emission limit of this condition is more stringent than the limitations of 40 CFR 60.672(a)(2) and 60.672(f), and compliance with this limit will assure compliance with those requirements.]

COMPLIANCE MONITORING AND TESTING REQUIREMENTS

- L.5. Visible Emissions Tests: Compliance with the visible emission limits of this permit shall be demonstrated by an annual compliance test using EPA Method 9. The duration of initial tests shall

be three hours and the duration of subsequent annual tests shall be thirty minutes.
[Rules 62-4.070(3) and 62-297.310(4)(a)2., F.A.C., and 40 CFR 60.11(b)]

[Note: The three hour duration of initial tests complies with the requirements of the NSPS and the thirty minute duration of subsequent tests complies with state rules.]

L.6. Visible Emissions Tests in Lieu of Stack Tests, Emissions Unit 020: After passing the initial test required by specific condition 21 of this section, the owner or operator is permitted to comply with the visible emission limit of specific condition 16 and the testing requirement of specific condition 17 of this section in lieu of regularly demonstrating compliance with the limitations of 40 CFR 60.672(a)(1) and (2) and the particulate matter limitation of specific condition 16 of this section. If the Department has reason to believe that the particulate weight emission limit of 40 CFR 60.672(a)(1) or the particulate matter limitation of specific condition 16 of this section is not being met, it shall require compliance be demonstrated by the test method specified by 40 CFR 60.675.
[Rules 62-4.070(3) and 62-297.620(4), F.A.C.]

REPORTING AND RECORD KEEPING REQUIREMENTS

L.7. Records of Maintenance: The owner or operator shall make and maintain records of maintenance on the enclosures and baghouses sufficient to demonstrate compliance with the operating procedures requirements of specific condition 15 of this section. [Rule 62-4.070(3), F.A.C.]

NSPS SUBPART OOO REQUIREMENTS

[Note: The numbering of the original rules in the following conditions has been preserved for ease of reference to the rules. The definitions of terms of this part shall have the meanings as defined in 40 CFR 60.671 Definitions. The term "Administrator" when used in 40 CFR 60 shall mean the Secretary or the Secretary's designee.]

L.8. Pursuant to 40 CFR 60.672 Standard for Particulate Matter:

[Note: The requirements of 40 CFR 60.672(a)(1) and (2) apply to emissions unit 020, and the requirements of 40 CFR 60.672(f) apply to emissions unit 021.]

- (a) No owner or operator shall cause to be discharged into the atmosphere from any transfer point on belt conveyors or from any other affected facility any stack emissions which:
- (1) Contain particulate matter in excess of 0.05 g/dscm; and
 - (2) Exhibit greater than 7 percent opacity.

[Note: The emission limit of specific condition 16 of this section is more stringent than the limitation of 40 CFR 60.672(a)(2).]

- (f) No owner or operator shall cause to be discharged into the atmosphere from any baghouse that controls emissions from only an individual, enclosed storage bin, stack emissions which exhibit greater than 7 percent opacity.

[Note: The emission limit of specific condition 16 of this section is more stringent than the limitation of 40 CFR 60.672(f). See the note for that condition.]

L.9. Pursuant to 40 CFR 60.675 Test Methods and Procedures:

- (a) In conducting the performance tests required in 40 CFR 60.8, the owner or operator shall use as reference methods and procedures the test methods in appendix A of 40 CFR 60 or other methods and procedures as specified in this section, except as provided in 40 CFR 60.8(b).
- (b) The owner or operator shall determine compliance with the particulate matter standards in 40 CFR 60.672(a) as follows:
 - (1) Method 5 or Method 17 shall be used to determine the particulate matter concentration. The sample volume shall be at least 1.70 dscm (60 dscf). For Method 5, if the gas stream being sampled is at ambient temperature, the sampling probe and filter may be operated without heaters. If the gas stream is above ambient temperature, the sampling probe and filter may be operated at a temperature high enough, but no higher than 121 °C (250 °F), to prevent water condensation on the filter.
 - (2) Method 9 and the procedures in 40 CFR 60.11 shall be used to determine opacity. [Note: The owner or operator is required to demonstrate compliance with the particulate matter emission limitation of 40 CFR 60.672(a)(1) by performing and passing an initial particulate matter test in accordance with the requirements of this section, unless such requirement is waived by the US Environmental Protection Agency. No subsequent regular annual particulate matter testing is required. The owner or operator is permitted to comply with the visible emission limit of specific condition 16 of this section in lieu of regularly demonstrating compliance with the limitations of 40 CFR 60.672(a)(1) and (2). See also specific condition 18 of this section.]
- (c) (2) In determining compliance with the opacity of stack emissions from any baghouse that controls emissions only from an individual enclosed storage bin under 40 CFR 60.672(f) of this subpart, using Method 9, the duration of the Method 9 observations shall be 1 hour (ten 6-minute averages). [Note: The initial Method 9 test duration for emissions unit 021 is one hour pursuant to 40 CFR 60.675(c)(2), while the initial Method 9 test duration for emissions unit 020 is 3 hours pursuant to 40 CFR 60.11(b). Subsequent annual Method 9 tests shall be conducted for 30 minutes for emissions units 020 and 021.]
- (g) If, after 30 days notice for an initially scheduled performance test, there is a delay (due to operational problems, etc.) in conducting any rescheduled performance test required in this section, the owner or operator of an affected facility shall submit a notice to the Administrator at least 7 days prior to any rescheduled performance test.

L.10. Pursuant to 40 CFR 60.676 Reporting and Recordkeeping:

- (f) The owner or operator of any affected facility shall submit written reports of the results of all performance tests conducted to demonstrate compliance with the standards set forth in 40 CFR 60.672 of this subpart.
- (h) The subpart A requirement under 40 CFR 60.7(a)(2) for notification of the anticipated date of initial startup of an affected facility shall be waived for owners or operators of affected facilities regulated under this subpart.
- (i) A notification of the actual date of initial startup of each affected facility shall be submitted to the Administrator.
 - (1) For a combination of affected facilities in a production line that begin actual initial startup on the same day, a single notification of startup may be submitted by the owner or operator to the Administrator. The notification shall be postmarked within 15 days after such date and shall include a description of each affected facility, equipment manufacturer, and serial number of the equipment, if available.

L.11. The attached 40 CFR 60 Subpart A NSPS General Provisions also apply to these emissions units.

Subsection M. Lime Silo for Wastewater Treatment Plant for the Chloride Bleed Stream

This section addresses the following Regulated Emissions Units:

-022 Lime silo with one baghouse for the waste water treatment plant for the chloride bleed stream

Description

A lime silo with one baghouse (Griffin Environmental 36-LS Filter Vent) which supplies limestone to the wastewater treatment plant for the FGD chloride bleed stream. This plant will serve the new and existing FGD systems. Particulate emissions from displaced air from periodically filling the lime silo will be controlled with the related baghouse.

[Note: This emissions unit is subject to the requirements of the state rules as indicated in this permit. This emissions unit is subject to Rule 1-3.61, Rules of the Environmental Protection Commission (EPC) of Hillsborough County, but it exempt from the requirements of Rule 62-296.711, F.A.C., pursuant to Rule 62-296.700(2)(c), F.A.C., because it has an allowable emission rate of less than one ton per year.]

The following conditions apply to the Emissions Unit listed above:

OPERATIONAL REQUIREMENTS

M.1. Hours of Operation: This emissions units may operate continuously, i.e., 8,760 hours/year. [Rule 62-210.200, F.A.C., Definitions-potential to emit (PTE)]

M.2. Operating Procedures: The baghouse for this emissions unit shall be properly operated and maintained at all times in a condition to minimize particulate emissions. The owner and operator shall ensure that all facility staff responsible for these emissions units are trained in their operation and maintenance in accordance with the guidelines and procedures as established by the equipment manufacturers. [Rule 62-4.070(3), F.A.C.]

EMISSION LIMITATIONS AND PERFORMANCE STANDARDS

M.3. Particulate and Visible Emissions: No owner or operator shall cause or allow visible emissions from the baghouse controlling this emissions unit in excess of 0.03 gr/dscf and 5% opacity. [Rules 62-4.070(3) and 62-296.700(2)(c), F.A.C.]

[Note: The particulate matter limitation will ensure that allowable emissions are less than one ton per year for this emissions unit.]

COMPLIANCE MONITORING AND TESTING REQUIREMENTS

M.4. Visible Emissions Tests: Compliance with the visible emission limit of this permit shall be demonstrated by an annual compliance test using EPA Method 9. The duration of annual tests shall be thirty minutes. [Rules 62-4.070(3) and 62-297.310(4)(a)2., F.A.C.]

M.5. Visible Emissions Tests in Lieu of Stack Tests: The owner or operator is permitted to comply with the visible emission limit of specific condition 25 and the testing requirement of specific condition 26 of this section in lieu of regularly demonstrating compliance with the particulate matter limitation of specific condition 25 of this section. If the Department has reason to believe that the particulate matter limitation of specific condition 25 of this section is not being met, it shall require compliance be demonstrated by conducting a particulate matter test in accordance with EPA Method 5 specified at 40 CFR 60 Appendix A. [Rules 62-4.070(3) and 62-297.620(4), F.A.C.]

REPORTING AND RECORD KEEPING REQUIREMENTS

M.6. Records of Maintenance: The owner or operator shall make and maintain records of maintenance on the baghouse sufficient to demonstrate compliance with the operating procedures requirements of specific condition M.2. of this section. [Rule 62-4.070(3), F.A.C.]

M.7. Tampa Electric shall keep records of facility staff training, and shall maintain, on site, an Operations and Maintenance Plan for the baghouse that details how it shall be properly operated and maintained at all times. Tampa Electric shall also take weekly pressure readings from the baghouse pressure-sensing device.

[USEPA objection resolution.]

Subsection N. Common Conditions

This section addresses the all of the Regulated Emissions Units:

{Permitting note: For emissions units subject to NESHAP or NSPS requirements, when more stringent, the requirements of the NESHAPS or NSPS supercede these common conditions.}

N.1. Compliance Test Notification. TECO shall notify the EPCHC, at least 15 days prior to the date on which each formal compliance test is to begin, of the date, time, and place of each such test, and the test contact person who will be responsible for coordinating and having such test conducted for TECO.
[Rule 62-297.310(7)(a)9., F.A.C.]

N.2. Special Compliance Tests. When, after inspection, the Department or the Environmental Protection Commission of Hillsborough County has good reason (such as complaints, increased visible emissions or questionable maintenance of control equipment) to believe that any applicable emission standard contained in a Department rule or in a permit issued pursuant to those rules is being violated, it shall require the Tampa Electric Company to conduct compliance tests which identify the nature and quantity of pollutant emissions from the emission unit and to provide a report on the results of said test to the requesting agency.
[Rule 62-297.310(7)(b), F.A.C.]

GENERAL TEST REQUIREMENTS

N.3. Required Number of Test Runs. For mass emission limitations, a compliance test shall consist of three complete and separate determinations of the total air pollutant emission rate through the test section of the stack or duct and three complete and separate determinations of any applicable process variables corresponding to the three distinct time periods during which the stack emission rate was measured provided, however, that three complete and separate determinations shall not be required if the process variables are not subject to variation during a compliance test, or if three determinations are not necessary in order to calculate the unit's emission rate. The three required test runs shall be completed within one consecutive five day period. In the event that a sample is lost or one of the three runs must be discontinued because of circumstances beyond the control of the owner or operator, and a valid third run cannot be obtained within the five day period allowed for the test, the Secretary or his or her designee may accept the results of the two complete runs as proof of compliance, provided that the arithmetic mean of the results of the two complete runs is at least 20 percent below the allowable emission limiting standards.
[Rule 297.310(1), F.A.C.]

N.4. Operating Rate During Testing for Emission Units other than Combustion Turbines. Unless otherwise stated an emission unit's specific condition in this permit, testing of emissions shall be conducted with the emissions unit operation at 90 to 100 percent of the maximum operation rate allowed by specific condition in this permit. If it is impracticable to test at permitted capacity, an emissions unit may be tested at less than the minimum permitted capacity; in this case, subsequent emissions unit operation is limited to 110 percent of the test load until a new test is conducted. Once the unit is so limited, operation at higher capacities is allowed for no more than 15 consecutive days for the purpose of additional compliance testing to regain the authority to operate at the permitted capacity.
[Rule 62-297.310(2), F.A.C.]

N.5. Calculation of Emission Rate. The indicated emission rate or concentration shall be the arithmetic average of the emission rate or concentration determined by each of the three separate test runs unless otherwise specified in a particular test method or applicable rule.
[Rule 62-297.310(3), F.A.C.]

N.6. Applicable Test Procedures.

(a) *Required Sampling Time.*

1. Unless otherwise specified in the specific conditions of this permit, the required sampling time for each test run shall be no less than one hour and no greater than four hours, and the sampling time at each sampling point shall be of equal intervals of at least two minutes.

2. Opacity Compliance Tests. When either EPA Method 9 or DEP Method 9 is specified as the applicable opacity test method, the required minimum period of observation for a compliance test shall be sixty (60) minutes for emissions units which emit or have the potential to emit 100 tons per year or more of particulate matter, and thirty (30) minutes for emissions units which have potential emissions less than 100 tons per year of particulate matter and are not subject to a multiple-valued opacity standard. The opacity test observation period shall include the period during which the highest opacity emissions can reasonably be expected to occur. Exceptions to these requirements are as follows:

a. For batch, cyclical processes, or other operations which are normally completed within less than the minimum observation period and do not recur within that time, the period of observation shall be equal to the duration of the batch cycle or operation completion time.

b. The observation period for special opacity tests that are conducted to provide data to establish a surrogate standard pursuant to Rule 62-297.310(5)(k), F.A.C., Waiver of Compliance Test Requirements, shall be established as necessary to properly establish the relationship between a proposed surrogate standard and an existing mass emission limiting standard.

c. The minimum observation period for opacity tests conducted by employees or agents of the Department to verify the day-to-day continuing compliance of a unit or activity with an applicable opacity standard shall be twelve minutes.

(b) *Minimum Sample Volume.* Unless otherwise specified in the applicable rule, the minimum sample volume per run shall be 25 dry standard cubic feet.

(c) *Required Flow Rate Range.* For EPA Method 5 particulate sampling, acid mist/sulfur dioxide, and fluoride sampling which uses Greenburg Smith type impingers, the sampling nozzle and sampling time shall be selected such that the average sampling rate will be between 0.5 and 1.0 actual cubic feet per minute, and the required minimum sampling volume will be obtained.

(d) *Calibration of Sampling Equipment.* Calibration of the sampling train equipment shall be conducted in accordance with the schedule shown in Table 297.310-1 (see attachment).

(e) *Allowed Modification to EPA Method 5.* When EPA Method 5 is required, the following modification is allowed: the heated filter may be separated from the impingers by a flexible tube.
[Rule 297.310(4), F.A.C.]

N.7. Determination of Process Variables.

(a) *Required Equipment.* The owner or operator of an emissions unit for which compliance tests are required shall install, operate, and maintain equipment or instruments necessary to determine process variables, such as process weight input or heat input, when such data are needed in conjunction with emissions data to determine the compliance of the emissions unit with applicable emission limiting standards.

(b) *Accuracy of Equipment.* Equipment or instruments used to directly or indirectly determine process variables, including devices such as belt scales, weight hoppers, flow meters, and tank scales, shall be calibrated and adjusted to indicate the true value of the parameter being measured with sufficient accuracy to allow the applicable process variable to be determined within 10% of its true value.

[Rule 62-297.310(5), F.A.C.]

N.8. Frequency of Compliance Tests. The following provisions apply to those emissions units that are subject to an emissions limiting standard for which compliance testing is required, unless otherwise provided in a specific emission unit condition of this permit.

(a) General Compliance Testing.

1. The owner or operator of a new or modified emissions unit that is subject to an emission limiting standard shall conduct a compliance test that demonstrates compliance with the applicable emission limiting standard prior to obtaining an operation permit for such emissions unit
2. For excess emission limitations for particulate matter specified in Rule 62-210.700, F.A.C., a compliance test shall be conducted annually while the emissions unit is operating under soot blowing conditions in each federal fiscal year during which soot blowing is part of normal emissions unit operation, except that such test shall not be required in any federal fiscal year in which a fossil fuel steam generator does not burn liquid and/or solid fuel for more than 400 hours other than during startup.
3. The owner or operator of an emissions unit that is subject to any emission limiting standard shall conduct a compliance test that demonstrates compliance with the applicable emission limiting standard prior to obtaining a renewed operation permit. Emissions units that are required to conduct an annual compliance test may submit the most recent annual compliance test to satisfy the requirements of this provision. In renewing an air operation permit pursuant to Rule 62-210.300(2)(a)3.b., c., or d., F.A.C., the Department shall not require submission of emission compliance test results for any emissions unit that, during the year prior to renewal:
 - a. Did not operate; or
 - b. In the case of a fuel burning emissions unit, burned liquid and/or solid fuel for a total of no more than 400 hours.
4. During each federal fiscal year (October 1 - September 30), unless otherwise specified by rule, order, or permit, the owner or operator of each emissions unit shall have a formal compliance test conducted for:
 - a. Visible emissions, if there is an applicable standard;
 - b. Each of the following pollutants, if there is an applicable standard, and if the emissions unit emits or has the potential to emit: 5 tons per year or more of lead or lead compounds measured as elemental lead; 30 tons per year or more of acrylonitrile; or 100 tons per year or more of any other regulated air pollutant; and
 - c. Each NESHAP pollutant, if there is an applicable emission standard.
5. An annual compliance test for particulate matter emissions shall not be required for any fuel burning emissions unit that, in a federal fiscal year, does not burn liquid and/or solid fuel, other than during startup, for a total of more than 400 hours.
6. For fossil fuel steam generators on a semi-annual particulate matter emission compliance testing schedule, a compliance test shall not be required for any six-month period in which liquid and/or solid fuel is not burned for more than 200 hours other than during startup.
7. For emissions units electing to conduct particulate matter emission compliance testing quarterly pursuant to Rule 62-296.405(2)(a), F.A.C., a compliance test shall not be required for any quarter in which liquid and/or solid fuel is not burned for more than 100 hours other than during startup.
8. Any combustion turbine that does not operate for more than 400 hours per year shall conduct a visible emissions compliance test once per each five-year period, coinciding with the term of its air operation permit.
9. The owner or operator shall notify the Department and the Environmental Protection Commission of Hillsborough County, at least 15 days prior to the date on which each formal compliance test is to begin, of the date, time, and place of each such test, and the test contact person who will be responsible for coordinating and having such test conducted for the owner or operator.

10. An annual compliance test conducted for visible emissions shall not be required for units exempted from permitting at Rule 62-210.300(3)(a), F.A.C., or units permitted under the General Permit provisions at Rule 62-210.300(4), F.A.C.

(b) *Special Compliance Tests.* When the Department or Environmental Protection Commission of Hillsborough County, after investigation, has good reason (such as complaints, increased visible emissions or questionable maintenance of control equipment) to believe that any applicable emission standard contained in a Department rule or in a permit issued pursuant to those rules is being violated, it shall require the owner or operator of the emissions unit to conduct compliance tests which identify the nature and quantity of pollutant emissions from the emissions unit and to provide a report on the results of said tests to the Department and the Environmental Protection Commission of Hillsborough County.

(c) *Waiver of Compliance Test Requirements.* If the owner or operator of an emissions unit that is subject to a compliance test requirement demonstrates to the Department, pursuant to the procedure established in Rule 62-297.620, F.A.C., that the compliance of the emissions unit with an applicable weight emission limiting standard can be adequately determined by means other than the designated test procedure, such as specifying a surrogate standard of no visible emissions for particulate matter sources equipped with a bag house or specifying a fuel analysis for sulfur dioxide emissions, the Department shall waive the compliance test requirements for such emissions units and order that the alternate means of determining compliance be used, provided, however, the provisions of Rule 62-297.310(7)(b), F.A.C., shall apply.

[Rule 62-297.310(7), F.A.C.]

N.9. Test Reports.

(a) The owner or operator of an emissions unit for which a compliance test is required shall file a report with the Department and the EPCHC on the results of each such test.

(b) The required test report shall be filed with the EPCHC as soon as practical but no later than 45 days after the last sampling run of each test is completed.

(c) The test report shall provide sufficient detail on the emissions unit tested and the test procedures used to allow the EPCHC and the Department to determine if the test was properly conducted and the test results properly computed. As a minimum, the test report, other than for an EPA or DEP Method 9 test, shall provide the following information:

1. The type, location, and designation of the emissions unit tested.
2. The facility at which the emissions unit is located.
3. The owner or operator of the emissions unit.
4. The normal type and amount of fuels used and materials processed, and the types and amounts of fuels used and material processed during each test run.

5. The means, raw data and computations used to determine the amount of fuels used and materials processed, if necessary to determine compliance with an applicable emission limiting standard.

6. The type of air pollution control devices installed on the emissions unit, their general condition, their normal operating parameters (pressure drops, total operating current and GPM scrubber water), and their operating parameters during each test run.

7. A sketch of the duct within 8 stack diameters upstream and 2 stack diameters downstream of the sampling ports, including the distance to any upstream and downstream bends or other flow disturbances.

8. The date, starting time and duration of each sampling run.

9. The test procedures used, including any alternative procedures authorized pursuant to Rule 62-297.620, F.A.C. Where optional procedures are authorized in this chapter, indicate which option was used.

10. The number of points sampled and configuration and location of the sampling plane.

11. For each sampling point for each run, the dry gas meter reading, velocity head, pressure drop across the stack, temperatures, average meter temperatures and sample time per point.

12. The type, manufacturer and configuration of the sampling equipment used.
 13. Data related to the required calibration of the test equipment.
 14. Data on the identification, processing and weights of all filters used.
 15. Data on the types and amounts of any chemical solutions used.
 16. Data on the amount of pollutant collected from each sampling probe, the filters, and the impingers, are reported separately for the compliance test.
 17. The names of individuals who furnished the process variable data, conducted the test, analyzed the samples and prepared the report.
 18. All measured and calculated data required to be determined by each applicable test procedure for each run.
 19. The detailed calculations for one run that relate the collected data to the calculated emission rate.
 20. The applicable emission standard, and the resulting maximum allowable emission rate for the emissions unit, plus the test result in the same form and unit of measure.
 21. A certification that, to the knowledge of the owner or his authorized agent, all data submitted are true and correct. When a compliance test is conducted for the EPCHC or the Department, the person who conducts the test shall provide the certification with respect to the test procedures used. The owner or his authorized agent shall certify that all data required and provided to the person conducting the test are true and correct to his knowledge.
- [Rule 62-297.310(8), F.A.C.]

Subsection O. Coal Residual Storage and Transfer

This section addresses the following Regulated Emissions Units:

- 037 Coal Residual Storage Facility
- 038 Coal Residual Transfer System

Description: Enclosed storage and transfer of coal residual received from the Polk Power Station. A nominal 25-ton dump truck empties a load of material into the building, and a bulldozer either pushes the material into a vacant area of the building, or it pushes the material directly into the dozer trap in the rear of the building. The dozer trap is a hopper that is partially below grade, and is used to feed the conveyor, which is capable of transferring up to 200 tons of material per hour. The conveyor is fully enclosed to prevent fugitive dust emissions, and to also prevent wetting of the material. Material inside the building will be periodically sprayed with water in an effort to minimize dust within the building.

The following conditions apply to the Emissions Units listed above:

EMISSION LIMITATIONS

- O.1. Visible emissions shall not exceed 5% opacity in lieu of particulate sampling.
[Rule 62-297.620(4), F.A.C., and Permit No. 0570039-012-AC]
- O.2. All conveyors and conveyor transfer points shall be enclosed to minimize particulate matter emissions. The coal residual shall be stored in an enclosed facility. Open storage of coal residual is prohibited. [Rule 62-296.320(4)(c), F.A.C., and Permit No. 0570039-012-AC]
- O.3. The maximum conveyor transfer rate shall be 200 tons per hour and 255,500 tons per year of coal residual that has been generated at the Polk Power Station gasification process. [0570039-012-AC]

TEST METHODS AND COMPLIANCE PROCEDURES

- O.4. Tampa Electric shall perform annual visible emissions tests for the storage facility and transfer system. Sites to be tested shall be determined by EPCHC. [Permit No. 0570039-012-AC]
[Permit No. 0570039-012-AC]
- O.5. Compliance with the allowable visible emissions limitation shall be determined by using the following reference method as described in 40 CFR 60, Appendix A, adopted by reference in Chapter 62-204, F.A.C.: Method 9 Visual Determination of the Opacity of Emissions from Stationary Sources.
[Permit No. 0570039-012-AC]
- O.6. TEC shall keep records of the following parameters for each specific month/day/year:
 - A) Amount of raw coal residual charged (tpd)
 - B) Amount of refined/beneficiated coal residual charged (tpd)[Permit No. 0570039-012-AC]
- O.7. TEC shall also keep records of:
 - A) Annual amount of raw coal residual charged (tpy)
 - B) Annual amount of refined/beneficiated coal residual charged (tpy)
 - C) Annual VE tests.[Permit No. 0570039-012-AC]

Section IV. This section is the Phase II Acid Rain Part.

Operated by: Tampa Electric Company

ORIS code: 0645

The emissions units listed below are regulated under Acid Rain:

E.U.

<u>ID No.</u>	<u>Brief Description</u>
-001	Unit No. 1 Steam Generator [EPA ID #: BB01]
-002	Unit No. 2 Steam Generator [EPA ID #: BB02]
-003	Unit No. 3 Steam Generator [EPA ID #: BB03]
-004	Unit No. 4 Steam Generator [EPA ID #: BB04]

1. The Phase II permit application, the Phase II NOx compliance plan, and the Phase II NOx averaging plan submitted for this facility, as approved by the Department, is a part of this permit. The owners and operators of these acid rain units must comply with the standard requirements and special provisions set forth in the application listed below:

DEP Form No. 62-210.900(1)(a), version ~~6/16/03~~ ~~07/01/95~~, received ~~9/27/04~~ ~~12/26/95~~ (signed ~~6/07/04~~ ~~12/19/95~~).

DEP Form No. 62-210.900(1)(a)4., F.A.C., received ~~9/27/04~~ ~~12/22/99~~ (signed ~~9/27/04~~ ~~12/20/99~~).

DEP Form No. 62-210.900(1)(a)5., F.A.C., received ~~6/28/04~~ ~~12/22/99~~ (signed ~~6/07/04~~ ~~12/20/99~~).

[Chapter 62-213, F.A.C. and Rule 62-214.320, F.A.C.]

2. Sulfur dioxide (SO₂) allowance allocations and nitrogen oxide (NO_x) requirements for each Acid Rain unit are as follows:

E.U. ID No.	EPA ID		Year				
			2000	2001	2002	2003	2004
-001	BB01	SO ₂ allowances, under Table 2 of 40 CFR 73	12132*	12132*	12132*	12132*	12132*
		NO _x limit**	<p>Note: The applicable emission limitation, under 40 CFR 76.6(a)(3), is 0.84 lb/mmBtu.</p> <p>2.a. Pursuant to 40 CFR 76.11, the Florida Department of Environmental Protection approves the NO_x emissions averaging plan submitted on 12/22/99 6/28/04 for this unit. Under the plan, this unit's NO_x emissions shall not exceed the annual average alternative contemporaneous emission limitation of 0.74 lb/MMBtu. In addition, this unit shall not have an annual heat input of less than 23,000,000 35,364,120 MMBtu.</p>				

E.U. ID No.	EPA ID		Year				
			2000	2001	2002	2003	2004
-002	BB02	SO ₂ allowances, under Table 2 of 40 CFR 73	12196*	12196*	12196*	12196*	12196*
		NO _x limit**	<p>Note: The applicable emission limitation, under 40 CFR 76.6(a)(3), is 0.84 lb/mmBtu.</p> <p>2.b. Pursuant to 40 CFR 76.11, the Florida Department of Environmental Protection approves the NO_x emissions averaging plan submitted on 12/22/99 6/28/04 for this unit. Under the plan, this unit's NO_x emissions shall not exceed the annual average alternative contemporaneous emission limitation of 0.74 lb/MMBtu. In addition, this unit shall not have an annual heat input of less than 24,000,000 35,004,960 MMBtu.</p>				
-003	BB03	SO ₂ allowances, under Table 2 of 40 CFR 73	11444*	11444*	11444*	11444*	11444*
		NO _x limit**	<p>Note: The applicable emission limitation, under 40 CFR 76.6(a)(3), is 0.84 lb/mmBtu.</p> <p>2.c. Pursuant to 40 CFR 76.11, the Florida Department of Environmental Protection approves the NO_x emissions averaging plan submitted on 12/22/99 6/28/04 for this unit. Under the plan, this unit's NO_x emissions shall not exceed the annual average alternative contemporaneous emission limitation of 0.53 lb/MMBtu. In addition, this unit shall not have an annual heat input of less than 10,000,000 36,047,400 MMBtu.</p>				

E.U. ID No.	EPA ID		Year				
			2000	2001	2002	2003	2004
-004	BB04	SO ₂ allowances, under Table 2 of 40 CFR 73	8780*	8780*	8780*	8780*	8780*
		NO _x limit**	<p>Note: The applicable emission limitation, under 40 CFR 76.5(a)(1), is 0.45 lb/mmBtu.</p> <p>2.d. Pursuant to 40 CFR 76.11, the Florida Department of Environmental Protection approves the NO_x emissions averaging plan submitted on 12/22/99 <u>6/28/04</u> for this unit. Under the plan, this unit's NO_x emissions shall not exceed the annual average alternative contemporaneous emission limitation of 0.44 lb/MMBtu. In addition, this unit shall not have an annual heat input of less than 20,000,000 <u>36,047,400</u> MMBtu.</p>				

*The number of allowances held by an Acid Rain source in a unit account may differ from the number allocated by the USEPA under Table 2 of 40 CFR 73. "Allowance" means an authorization by the USEPA Administrator under the federal Acid Rain Program to emit up to one ton of sulfur dioxide during a specified calendar year.

** Based on the Phase II NO_x applications.

2.e. Additional Requirements

i. Under the plan (NO_x Phase II averaging plan), the actual Btu-weighted annual average NO_x emission rate for the units in the plan shall be less than or equal to the Btu-weighted annual average NO_x emission rate for the same units had they each been operated, during the same period of time, in accordance with the applicable emission limitations under 40 CFR 76.5, 76.6, or 76.7, except that for any early election units, the applicable emission limitations shall be under 40 CFR 76.7. If the designated representative demonstrates that the requirement of the prior sentence (as set forth in 40 CFR 76.11(d)(1)(ii)(A)) is met for a year under the plan, then this unit shall be deemed to be in compliance for that year with its alternative contemporaneous annual emission limitation and annual heat input limit.

ii. In addition to the described NO_x compliance plan, these units shall comply with all other applicable requirements of 40 CFR Part 76, including the duty to reapply for a NO_x compliance plan and requirements covering excess emissions.

3. Emission Allowances. Emissions from sources subject to the Federal Acid Rain Program (Title IV) shall not exceed any allowances that the source lawfully holds under the Federal Acid Rain Program. Allowances shall not be used to demonstrate compliance with a non-Title IV applicable requirement of the Act.

a. No permit revision shall be required for increases in emissions that are authorized by allowances acquired pursuant to the Federal Acid Rain Program, provided that such increases do not require a permit revision pursuant to Rule 62-213.400(3), F.A.C.

b. No limit shall be placed on the number of allowances held by the source under the Federal Acid Rain Program.

c. Allowances shall be accounted for under the Federal Acid Rain Program.
[Rule 62-213.440(1)(c), F.A.C.]

4. Fast-Track Revisions of Acid Rain Parts. Those Acid Rain sources making a change described at Rule 62-214.370(4), F.A.C., may request such change as provided in Rule 62-213.413, F.A.C.
[Rules 62-213.413 and 62-214.370(4), F.A.C.]

5. No permit revision shall be required for increases in emissions that are authorized by allowances acquired pursuant to the Federal Acid Rain Program, provided that such increases do not require a permit revision pursuant to Rule 62-213.400, F.A.C.
[40 CFR 70.6(a)(4)(i); and, Rule 62-213.440(1)(c)1., F.A.C.]

6. Where an applicable requirement of the Act is more stringent than applicable regulations promulgated under Title IV of the Act, both provisions shall be incorporated into the permit and shall be enforceable by the Administrator.
[40 CFR 70.6(a)(1)(ii); and, Rule 62-210.200, F.A.C., Definitions – Applicable Requirements.]

7. Comments, notes, and justifications:

~~On 6/07/04, the Certificate of Representation was signed by Gregory M. Nelson, designated representative, and Laura R. Couch, alternate designated representative. The designated representative was changed to Gregory M. Nelson, P.E., effective July 1, 1998.~~

Appendix U-1: List of Unregulated Emissions Units and Activities

Tampa Electric Company
Big Bend Station

DRAFT Title V Operation Permit Revision No.: 0570039-017-AV
Facility ID No.: 0570039

Unregulated Emissions Units and/or Activities. An emissions unit which emits no “emissions-limited pollutant” and which is subject to no unit-specific work practice standard, though it may be subject to regulations applied on a facility-wide basis (e.g., unconfined emissions, odor, general opacity) or to regulations that require only that it be able to prove exemption from unit-specific emissions or work practice standards.

The below listed emissions units and/or activities are neither ‘regulated emissions units’ nor ‘exempt emissions units’.

E.U. ID

<u>No.</u>	<u>Brief Description of Emissions Units and/or Activities</u>
-036	Slag and bottom ash sources BH-001 through BH-004 Gypsum handling and storage sources GH-001 through GH-017 No. 2 Fuel Oil Storage Tanks > 550 gallons Vehicle Refueling Operations Turbine Vapor Extractor

Appendix I-1: List of Insignificant Emissions Units and/or Activities

Tampa Electric Company
Big Bend Station

DRAFT Title V Operation Permit Revision No.: 0570039-017-AV
Facility ID No.: 0570039

Page 1 of 2

The facilities, emissions units, or pollutant-emitting activities listed in Rule 62-210.300(3)(a), F.A.C., Full Exemptions, are exempt from the permitting requirements of Chapters 62-210 and 62-4, F.A.C.; provided, however, that exempt emissions units shall be subject to any applicable emission limiting standards and the emissions from exempt emissions units or activities shall be considered in determining whether a facility containing such emissions units or activities would be subject to any applicable requirements. Emissions units and pollutant-emitting activities exempt from permitting under Rule 62-210.300(3)(a), F.A.C., are also exempt from the permitting requirements of Chapter 62-213, F.A.C., provided such emissions units and activities also meet the exemption criteria of Rule 62-213.430(6)(b), F.A.C. The below listed emissions units and/or activities are hereby exempt pursuant to Rule 62-213.430(6), F.A.C.

Brief Description of Emissions Units and/or Activities

1. Internal combustion engines in boats, aircraft and vehicles used for transportation of passengers or freight.
2. Cold storage refrigeration equipment, except for any such equipment located at a Title V source using an ozone-depleting substance regulated under 40 CFR Part 82.
3. Vacuum pumps in laboratory operations.
4. Equipment used for steam cleaning.
5. Belt or drum sanders having a total sanding surface of five square feet or less and other equipment used exclusively on wood or plastics or their products having a density of 20 pounds per cubic foot or more.
6. Equipment used exclusively for space heating, other than boilers.
7. Laboratory equipment used exclusively for chemical or physical analyses.
8. Brazing, soldering or welding equipment.
9. One or more emergency generators located within a single facility provided:
 - a. None of the emergency generators is subject to the Federal Acid Rain Program; and
 - b. Total fuel consumption by all such emergency generators within the facility is limited to 32,000 gallons per year of diesel fuel, 4,000 gallons per year of gasoline, 4.4 million standard cubic feet per year of natural gas or propane, or an equivalent prorated amount if multiple fuels are used.
10. One or more heating units and general purpose internal combustion engines located within a single facility provided:
 - a. None of the heating units or general purpose internal combustion engines is subject to the Federal Acid Rain Program; and
 - b. Total fuel consumption by all such heating units and general purpose internal combustion engines within the facility is limited to 32,000 gallons per year of diesel fuel, 4,000 gallons per year of gasoline, 4.4 million standard cubic feet per year of natural gas or propane, or an equivalent prorated amount if multiple fuels are used.
11. Fire and safety equipment.
12. Degreasing units using heavier-than-air vapors exclusively, except any such unit using or emitting any substance classified as a hazardous air pollutant.
13. No. 2 and No. 6 fuel oil storage tanks that are not regulated by 40 CFR 60 Subpart Kb.
14. No. 2 and No. 6 fuel oil truck unloading equipment.

Appendix I-1: List of Insignificant Emissions Units and/or Activities

Tampa Electric Company
Big Bend Station

DRAFT Title V Operation Permit Revision No.: 0570039-017-AV
Facility ID No.: 0570039

Page 2 of 2

15. Equipment for physically treating fuel oil by filtration, water separation, etc.
16. Non-halogenated solvent storage and cleaning operations not regulated by 40 CFR 63.
17. Architectural & equipment maintenance painting.
18. Surface coating operations within a single facility if the total quantity of coatings containing greater than 5.0 percent VOCs, by volume, used is 6.0 gallons per day or less, averaged monthly, provided:
- a. Such operations are not subject to a volatile organic compound Reasonably Available Control Technology (RACT) requirement of Chapter 62-296, F.A.C.
 - b. The amount of coating used shall include any solvents and thinners used in the process including those used for cleanup.
 - c. Such operations are not subject to 40 CFR 63.
19. Surface coating operations utilizing only coatings containing 5.0 percent or less VOCs, by volume, and the operations are not subject to 40 CFR 63.
20. Evaporation of up to 150,000 gallons per year of nonhazardous boiler chemical cleaning waste that was generated on site.
21. Any other emissions unit or activity shall be considered insignificant if all of the following criteria are met:
- a. Such unit or activity would be subject to no unit-specific applicable requirement.
 - b. Such unit or activity, in combination with other units and activities proposed as insignificant, would not cause the facility to exceed any major source threshold(s) as defined in subparagraph 62-213.420(3)(c)1., F.A.C., unless it is acknowledged in the permit application that such units or activities would cause the facility to exceed such threshold(s).
3. Such unit or activity would neither emit nor have the potential to emit:
- a. 500 pounds per year or more of lead and lead compounds expressed as lead;
 - b. 1,000 pounds per year or more of any hazardous air pollutant;
 - c. 2,500 pounds per year or more of total hazardous air pollutants; or
 - d. 5.0 tons per year or more of any other regulated pollutant.

Note: No exemption shall be granted to any emissions unit or activity if:

None of the emissions units or activities listed 1 through 20 above shall be considered insignificant if:

- 1. Such unit or activity would be subject to any unit-specific applicable requirement;
- 2. Such unit or activity, in combination with other units and activities proposed for exemption, would cause the facility to exceed any major source threshold(s) as defined in Rule 62-213.420(3)(c)1., F.A.C., unless it is acknowledged in the permit application that such units or activities would cause the facility to exceed such threshold(s); or
- 3. Such unit or activity would emit or have the potential to emit:
 - a. 500 pounds per year or more of lead and lead compounds expressed as lead;
 - b. 1,000 pounds per year or more of any hazardous air pollutant;
 - c. 2,500 pounds per year or more of total hazardous air pollutants; or
 - d. 5.0 tons per year or more of any other regulated pollutant.

[Rule 62-213.430(6), F.A.C.]

APPENDIX TV-4, TITLE V CONDITIONS (version dated 02/12/02)

[Note: This attachment includes "canned conditions" developed from the "Title V Core List."]

{Permitting note: APPENDIX TV-4, TITLE V CONDITIONS, is distributed to the permittee only. Other persons requesting copies of these conditions shall be provided one copy when requested or otherwise appropriate.}

Chapter 62-4, F.A.C.

1. **Not federally enforceable.** General Prohibition. Any stationary installation which will reasonably be expected to be a source of pollution shall not be operated, maintained, constructed, expanded, or modified without the appropriate and valid permits issued by the Department, unless the source is exempted by Department rule. The Department may issue a permit only after it receives reasonable assurance that the installation will not cause pollution in violation of any of the provisions of Chapter 403, F.S., or the rules promulgated thereunder. A permitted installation may only be operated, maintained, constructed, expanded or modified in a manner that is consistent with the terms of the permit.

[Rule 62-4.030, Florida Administrative Code (F.A.C.); Section 403.087, Florida Statute (F.S.)]

2. **Not federally enforceable.** Procedures to Obtain Permits and Other Authorizations; Applications.

(1) Any person desiring to obtain a permit from the Department shall apply on forms prescribed by the Department and shall submit such additional information as the Department by law may require.

(2) All applications and supporting documents shall be filed in quadruplicate with the Department.

(3) To ensure protection of public health, safety, and welfare, any construction, modification, or operation of a installation which may be a source of pollution, shall be in accordance with sound professional engineering practices pursuant to Chapter 471, F.S. All applications for a Department permit shall be certified by a professional engineer registered in the State of Florida except, when the application is for renewal of an air pollution operation permit at a non-Title V source as defined in Rule 62-210.200, F.A.C., or where professional engineering is not required by Chapter 471, F.S. Where required by Chapter 471 or 492, F.S., applicable portions of permit applications and supporting documents which are submitted to the Department for public record shall be signed and sealed by the professional(s) who prepared or approved them.

(4) Processing fees for air construction permits shall be in accordance with Rule 62-4.050(4), F.A.C.

(5)(a) To be considered by the Department, each application must be accompanied by the proper processing fee. The fee shall be paid by check, payable to the Department of Environmental Protection. The fee is non-refundable except as provided in Section 120.60, F.S., and in this section.

(c) Upon receipt of the proper application fee, the permit processing time requirements of Sections 120.60(2) and 403.0876, F.S., shall begin.

(d) If the applicant does not submit the required fee within ten days of receipt of written notification, the Department shall either return the unprocessed application or arrange with the applicant for the pick up of the application.

(e) If an applicant submits an application fee in excess of the required fee, the permit processing time requirements of Sections 120.60(2) and 403.0876, F.S., shall begin upon receipt, and the Department shall refund to the applicant the amount received in excess of the required fee.

(6) Any substantial modification to a complete application shall require an additional processing fee determined pursuant to the schedule set forth in Rule 62-4.050, F.A.C., and shall restart the time requirements of Sections 120.60 and 403.0876 F.S. For purposes of this Subsection, the term "substantial modification" shall mean a modification which is reasonably expected to lead to substantially different environmental impacts which require a detailed review.

(7) Modifications to existing permits proposed by the permittee which require substantial changes in the existing permit or require substantial evaluation by the Department of potential impacts of the proposed modifications shall require the same fee as a new application for the same time duration except for modification under Chapter 62-45, F.A.C.

[Rule 62-4.050, F.A.C.]

3. Standards for Issuing or Denying Permits Except as provided at Rule 62-213.460, F.A.C., the issuance of a permit does not relieve any person from complying with the requirements of Chapter 403, F.S., or Department rules.

[Rule 62-4.070(7), F.A.C.]

APPENDIX TV-4, TITLE V CONDITIONS (version dated 02/12/02) (continued)

4. Modification of Permit Conditions

(1) For good cause and after notice and an administrative hearing, if requested, the Department may require the permittee to conform to new or additional conditions. The Department shall allow the permittee a reasonable time to conform to the new or additional conditions and on application of the permittee the Department may grant additional time. For the purpose of this section, good cause shall include, but not be limited to, any of the following: (also, see Condition No. 38.)

- (a) A showing that an improvement in effluent or emission quality or quantity can be accomplished because of technological advances without unreasonable hardship.
- (b) A showing that a higher degree of treatment is necessary to effect the intent and purpose of Chapter 403, F.S.
- (c) A showing of any change in the environment or surrounding conditions that requires a modification to conform to applicable air or water quality standards.
- (e) Adoption or revision of Florida Statutes, rules, or standards which require the modification of a permit condition for compliance.

(2) A permittee may request a modification of a permit by applying to the Department.

(3) A permittee may request that a permit be extended as a modification of the permit. Such a request must be submitted to the Department in writing before the expiration of the permit. Upon timely submittal of a request for extension, unless the permit automatically expires by statute or rule, the permit will remain in effect until final agency action is taken on the request. For construction permits, an extension shall be granted if the applicant can demonstrate reasonable assurances that, upon completion, the extended permit will comply with the standards and conditions required by applicable regulation. For all other permits, an extension shall be granted if the applicant can demonstrate reasonable assurances that the extended permit will comply with the standards and conditions applicable to the original permit. A permit for which the permit application fee was prorated in accordance with Rule 62.4050(4)(1), F.A.C., shall not be extended. In no event shall a permit be extended or remain in effect longer than the time limits established by statute or rule.

[Rule 62-4.080, F.A.C.]

5. Renewals. Prior to 180 days before the expiration of a permit issued pursuant to Chapter 62-213, F.A.C., the permittee shall apply for a renewal of a permit using forms incorporated by reference in the specific rule chapter for that kind of permit. A renewal application shall be timely and sufficient. If the application is submitted prior to 180 days before expiration of the permit, it will be considered timely and sufficient. If the renewal application is submitted at a later date, it will not be considered timely and sufficient unless it is submitted and made complete prior to the expiration of the operation permit. When the application for renewal is timely and sufficient, the existing permit shall remain in effect until the renewal application has been finally acted upon by the Department or, if there is court review of the Department's final agency action, until a later date is required by Section 120.60, F.S., provided that, for renewal of a permit issued pursuant to Chapter 62-213, F.A.C., the applicant complies with the requirements of Rules 62-213.420(1)(b)3. and 4., F.A.C.

[Rule 62-4.090, F.A.C.]

6. Suspension and Revocation

(1) Permits shall be effective until suspended, revoked, surrendered, or expired and shall be subject to the provisions of Chapter 403, F.S., and rules of the Department.

(2) Failure to comply with pollution control laws and rules shall be grounds for suspension or revocation.

(3) A permit issued pursuant to Chapter 62-4, F.A.C., shall not become a vested property right in the permittee. The Department may revoke any permit issued by it if it finds that the permit holder or the his agent:

- (a) Submitted false or inaccurate information in his application or operational reports.
- (b) Has violated law, Department orders, rules or permit conditions.
- (c) Has failed to submit operational reports or other information required by Department rules.
- (d) Has refused lawful inspection under Section 403.091, F.S.

(4) No revocation shall become effective except after notice is served by personal services, certified mail, or newspaper notice pursuant to Section 120.60(7), F.S., upon the person or persons named therein and a hearing held if requested within the time specified in the notice. The notice shall specify the provision of the law, or rule alleged to be violated, or the permit condition or Department order alleged to be violated, and the facts alleged to constitute a violation thereof.

[Rule 62-4.100, F.A.C.]

APPENDIX TV-4, TITLE V CONDITIONS (version dated 02/12/02) (continued)

7. **Not federally enforceable.** Financial Responsibility. The Department may require an applicant to submit proof of financial responsibility and may require the applicant to post an appropriate bond to guarantee compliance with the law and Department rules. [Rule 62-4.110, F.A.C.]

8. Transfer of Permits.

(1) Within 30 days after the sale or legal transfer of a permitted facility, an "Application for Transfer of Permit" (DEP Form 62 1.201(1)) must be submitted to the Department. This form must be completed with the notarized signatures of both the permittee and the proposed new permittee. For air permits, an "Application for Transfer of Air Permit" (DEP Form 62210.900(7)) shall be submitted.

(2) The Department shall approve the transfer of a permit unless it determines that the proposed new permittee cannot provide reasonable assurances that conditions of the permit will be met. The determination shall be limited solely to the ability of the new permittee to comply with the conditions of the existing permit, and it shall not concern the adequacy of these permit conditions. If the Department proposes to deny the transfer, it shall provide both the permittee and the proposed new permittee a written objection to such transfer together with notice of a right to request a Chapter 120, F.S., proceeding on such determination.

(3) Within 30 days of receiving a properly completed Application for Transfer of Permit form, the Department shall issue a final determination. The Department may toll the time for making a determination on the transfer by notifying both the permittee and the proposed new permittee that additional information is required to adequately review the transfer request. Such notification shall be served within 30 days of receipt of an Application for Transfer of Permit form, completed pursuant to Rule 624.120(1), F.A.C. If the Department fails to take action to approve or deny the transfer within 30 days of receipt of the completed Application for Transfer of Permit form, or within 30 days of receipt of the last item of timely requested additional information, the transfer shall be deemed approved.

(4) The permittee is encouraged to apply for a permit transfer prior to the sale or legal transfer of a permitted facility. However, the transfer shall not be effective prior to the sale or legal transfer.

(5) Until this transfer is approved by the Department, the permittee and any other person constructing, operating, or maintaining the permitted facility shall be liable for compliance with the terms of the permit. The permittee transferring the permit shall remain liable for corrective actions that may be required as a result of any violations occurring prior to the sale or legal transfer of the facility.

[Rule 62-4.120, F.A.C.]

9. Plant Operation-Problems. If the permittee is temporarily unable to comply with any of the conditions of the permit due to breakdown of equipment or destruction by hazard of fire, wind or by other cause, the permittee shall immediately notify the Department. Notification shall include pertinent information as to the cause of the problem, and what steps are being taken to correct the problem and to prevent its recurrence, and where applicable, the owner's intent toward reconstruction of destroyed facilities. Such notification does not release the permittee from any liability for failure to comply with Department rules. ~~Also, see Condition No. 10.~~

[Rule 62-4.130, F.A.C.]

10. For purposes of notification to the Department pursuant to Condition No. 9., Condition No. 12.(8), and Rule 62-4.130, F.A.C., Plant Operation-Problems, "immediately" shall mean the same day, if during a workday (i.e., 8:00 a.m.- 5:00 p.m.), or the first business day after the incident, excluding weekends and holidays; and, for purposes of 40 CFR 70.6(a)(3)(iii)(B), "prompt" shall have the same meaning as "immediately". [also, see Conditions Nos. 9. and 12.(8).]

[40 CFR 70.6(a)(3)(iii)(B)]

11. **Not federally enforceable.** Review. Failure to request a hearing within 14 days of receipt of notice of proposed or final agency action on a permit application or as otherwise required in Chapter 62-103, F.A.C., shall be deemed a waiver of the right to an administrative hearing.

[Rule 62-4.150, F.A.C.]

APPENDIX TV-4, TITLE V CONDITIONS (version dated 02/12/02) (continued)

12. Permit Conditions. All permits issued by the Department shall include the following general conditions:
- (1) The terms, conditions, requirements, limitations and restrictions set forth in this permit, are "permit conditions" and are binding and enforceable pursuant to Sections 403.141, 403.727, or 403.859 through 403.861, F.S. The permittee is placed on notice that the Department will review this permit periodically and may initiate enforcement action for any violation of these conditions.
 - (2) This permit is valid only for the specific processes and operations applied for and indicated in the approved drawings or exhibits. Any unauthorized deviation from the approved drawings, exhibits, specifications, or conditions of this permit may constitute grounds for revocation and enforcement action by the Department.
 - (3) As provided in Subsections 403.087(7) and 403.722(5), F.S., the issuance of this permit does not convey any vested rights or any exclusive privileges. Neither does it authorize any injury to public or private property or any invasion of personal rights, nor any infringement of federal, state, or local laws or regulations. This permit is not a waiver of or approval of any other Department permit that may be required for other aspects of the total project which are not addressed in this permit.
 - (4) This permit conveys no title to land or water, does not constitute State recognition or acknowledgment of title, and does not constitute authority for the use of submerged lands unless herein provided and the necessary title or leasehold interests have been obtained from the State. Only the Trustees of the Internal Improvement Trust Fund may express State opinion as to title.
 - (5) This permit does not relieve the permittee from liability for harm or injury to human health or welfare, animal, or plant life, or property caused by the construction or operation of this permitted source, or from penalties therefore; nor does it allow the permittee to cause pollution in contravention of F.S. and Department rules, unless specifically authorized by an order from the Department.
 - (6) The permittee shall properly operate and maintain the facility and systems of treatment and control (and related appurtenances) that are installed and used by the permittee to achieve compliance with the conditions of this permit, as required by Department rules. This provision includes the operation of backup or auxiliary facilities or similar systems when necessary to achieve compliance with the conditions of the permit and when required by Department rules.
 - (7) The permittee, by accepting this permit, specifically agrees to allow authorized Department personnel, upon presentation of credentials or other documents as may be required by law and at reasonable times, access to the premises where the permitted activity is located or conducted to:
 - (a) Have access to and copy any records that must be kept under conditions of the permit;
 - (b) Inspect the facility, equipment, practices, or operations regulated or required under this permit; and,
 - (c) Sample or monitor any substances or parameters at any location reasonably necessary to assure compliance with this permit or Department rules. Reasonable time may depend on the nature of the concern being investigated.
 - (8) If, for any reason, the permittee does not comply with or will be unable to comply with any condition or limitation specified in this permit, the permittee shall immediately provide the Department with the following information: ~~Also, see Condition No. 10.~~
 - (a) A description of and cause of noncompliance; and,
 - (b) The period of noncompliance, including dates and times; or, if not corrected, the anticipated time the noncompliance is expected to continue, and steps being taken to reduce, eliminate, and prevent recurrence of the noncompliance. The permittee shall be responsible for any and all damages which may result and may be subject to enforcement action by the Department for penalties or for revocation of this permit.
 - (9) In accepting this permit, the permittee understands and agrees that all records, notes, monitoring data and other information relating to the construction or operation of this permitted source which are submitted to the Department may be used by the Department as evidence in any enforcement case involving the permitted source arising under the F.S. or Department rules, except where such use is prescribed by Sections 403.111 and 403.73, F.S. Such evidence shall only be used to the extent it is consistent with the Florida Rules of Civil Procedure and appropriate evidentiary rules.
 - (10) The permittee agrees to comply with changes in Department rules and F.S. after a reasonable time for compliance; provided, however, the permittee does not waive any other rights granted by F.S. or Department rules.
 - (11) This permit is transferable only upon Department approval in accordance with Rule 624.120, F.A.C., as applicable. The permittee shall be liable for any non-compliance of the permitted activity until the transfer is approved by the Department.
 - (12) This permit or a copy thereof shall be kept at the work site of the permitted activity.
 - (14) The permittee shall comply with the following:
 - (a) Upon request, the permittee shall furnish all records and plans required under Department rules. During enforcement actions, the retention period for all records will be extended automatically unless otherwise stipulated by the Department.
 - (b) The permittee shall hold at the facility or other location designated by this permit records of all monitoring information (including all calibration and maintenance records and all original strip chart recordings for continuous monitoring instrumentation) required by the permit, copies of all reports required by this permit, and records of all data used to complete the application for this permit. These materials shall be retained at least five (5) years from the date of the sample, measurement, report, or application unless otherwise specified by Department rule.

- (c) Records of monitoring information shall include:
1. the date, exact place, and time of sampling or measurements;
 2. the person responsible for performing the sampling or measurements;
 3. the dates analyses were performed;
 4. the person responsible for performing the analyses;
 5. the analytical techniques or methods used;
 6. the results of such analyses.

(15) When requested by the Department, the permittee shall within a reasonable time furnish any information required by law which is needed to determine compliance with the permit. If the permittee becomes aware the relevant facts were not submitted or were incorrect in the permit application or in any report to the Department, such facts or information shall be corrected promptly.
[Rules 62-4.160 and 62-213.440(1)(b), F.A.C.]

13. Construction Permits.

(1) No person shall construct any installation or facility which will reasonably be expected to be a source of air or water pollution without first applying for and receiving a construction permit from the Department unless exempted by statute or Department rule. In addition to the requirements of Chapter 62-4, F.A.C., applicants for a Department Construction Permit shall submit the following as applicable:

- (a) A completed application on forms furnished by the Department.
- (b) An engineering report covering:
1. plant description and operations,
 2. types and quantities of all waste material to be generated whether liquid, gaseous or solid,
 3. proposed waste control facilities,
 4. the treatment objectives,
 5. the design criteria on which the control facilities are based, and,
 6. other information deemed relevant.

Design criteria submitted pursuant to Rule 62-4.210(1)(b)5., F.A.C., shall be based on the results of laboratory and pilotplant scale studies whenever such studies are warranted. The design efficiencies of the proposed waste treatment facilities and the quantities and types of pollutants in the treated effluents or emissions shall be indicated. Work of this nature shall be subject to the requirements of Chapter 471, F.S. Where confidential records are involved, certain information may be kept confidential pursuant to Section 403.111, F.S.

(c) The owners' written guarantee to meet the design criteria as accepted by the Department and to abide by Chapter 403, F.S. and the rules of the Department as to the quantities and types of materials to be discharged from the installation. The owner may be required to post an appropriate bond or other equivalent evidence of financial responsibility to guarantee compliance with such conditions in instances where the owner's financial resources are inadequate or proposed control facilities are experimental in nature.

(2) The construction permit may contain conditions and an expiration date as determined by the Secretary or the Secretary's designee.

(3) When the Department issues a permit to construct, the permittee shall be allowed a period of time, specified in the permit, to construct, and to operate and test to determine compliance with Chapter 403, F.S., and the rules of the Department and, where applicable, to apply for and receive an operation permit. The Department may require tests and evaluations of the treatment facilities by the permittee at his/her expense.

[Rule 62-4.210, F.A.C.]

14. **Not federally enforceable.** Operation Permit for New Sources. To properly apply for an operation permit for new sources, the applicant shall submit the appropriate fee and certification that construction was completed noting any deviations from the conditions in the construction permit and test results where appropriate.

[Rule 62-4.220, F.A.C.]

Chapters 28-106 and 62-110, F.A.C.

15. Public Notice, Public Participation, and Proposed Agency Action The permittee shall comply with all of the requirements for public notice, public participation, and proposed agency action pursuant to Rules 62-110.106 and 62-210.350, F.A.C.

[Rules 62-110.106, 62-210.350 and 62-213.430(1)(b), F.A.C.]

APPENDIX TV-4, TITLE V CONDITIONS (version dated 02/12/02) (continued)

16. Administrative Hearing. The permittee shall comply with all of the requirements for a petition for administrative hearing or waiver of right to administrative proceeding pursuant to Rules 28-106.201, 28-106.301 and 62-110.106, F.A.C.
[Rules 28-106.201, 28-106.301 and 62-110.106, F.A.C.]

Chapter 62-204, F.A.C.

17. Asbestos. This permit does not authorize any demolition or renovation of the facility or its parts or components which involves asbestos removal. This permit does not constitute a waiver of any of the requirements of Chapter 62-257, F.A.C., and 40 CFR 61, Subpart M, National Emission Standard for Asbestos, adopted and incorporated by reference in Rule 62-204.800, F.A.C. Compliance with Chapter 62-257, F.A.C., and 40 CFR 61, Subpart M, Section 61.145, is required for any asbestos demolition or renovation at the source.
[40 CFR 61; Rule 62-204.800, F.A.C.; and, Chapter 62-257, F.A.C.]

Chapter 62-210, F.A.C.

18. Permits Required. The owner or operator of any emissions unit which emits or can reasonably be expected to emit any air pollutant shall obtain an appropriate permit from the Department prior to beginning construction, modification, or initial or continued operation of the emissions unit unless exempted pursuant to Department rule or statute. All emissions limitations, controls, and other requirements imposed by such permits shall be at least as stringent as any applicable limitations and requirements contained in or enforceable under the State Implementation Plan (SIP) or that are otherwise federally enforceable. Except as provided at Rule 62-213.460, F.A.C., issuance of a permit does not relieve the owner or operator of an emissions unit from complying with any applicable requirements, any emission limiting standards or other requirements of the air pollution rules of the Department or any other such requirements under federal, state, or local law.

(1) Air Construction Permits.

(a) Unless exempt from permitting pursuant to Rule 62-210.300(3)(a) or (b), F.A.C., or Rule 62-4.040, F.A.C., an air construction permit shall be obtained by the owner or operator of any proposed new or modified facility or emissions unit prior to the beginning of construction or modification, in accordance with all applicable provisions of Chapter 62-210, F.A.C., Chapter 62-212, F.A.C., and Chapter 62-4, F.A.C. Except as provided under Rule 62-213.415, F.A.C., the owner or operator of any facility seeking to create or change an air emissions bubble shall obtain an air construction permit in accordance with all the applicable provisions of Chapter 62-210, F.A.C., Chapter 62-212, F.A.C., and Chapter 62-4, F.A.C. The construction permit shall be issued for a period of time sufficient to allow construction or modification of the facility or emissions unit and operation while the new or modified facility or emissions unit is conducting tests or otherwise demonstrating initial compliance with the conditions of the construction permit.

(b) Notwithstanding the expiration of an air construction permit, all limitations and requirements of such permit that are applicable to the design and operation of the permitted facility or emissions unit shall remain in effect until the facility or emissions unit is permanently shut down, except for any such limitation or requirement that is obsolete by its nature (such as a requirement for initial compliance testing) or any such limitation or requirement that is changed in accordance with the provisions of Rule 62-210.300(1)(b)1., F.A.C. Either the applicant or the Department can propose that certain conditions be considered obsolete. Any conditions or language in an air construction permit that are included for informational purposes only, if they are transferred to the air operation permit, shall be transferred for informational purposes only and shall not become enforceable conditions unless voluntarily agreed to by the permittee or otherwise required under Department rules.

1. Except for those limitations or requirements that are obsolete, all limitations and requirements of an air construction permit shall be included and identified in any air operation permit for the facility or emissions unit. The limitations and requirements included in the air operation permit can be changed, and thereby superseded, through the issuance of an air construction permit, federally enforceable state air operation permit, federally enforceable air general permit or Title V air operation permit; provided, however, that:

- a. Any change that would constitute an administrative correction may be made pursuant to Rule 62-210.360, F.A.C.;
- b. Any change that would constitute a modification, as defined at Rule 62-210.200, F.A.C., shall be accomplished only through the issuance of an air construction permit; and
- c. Any change in a permit limitation or requirement that originates from a permit issued pursuant to 40 CFR 52.21, Rule 62-204.800(10)(d)2., F.A.C., Rule 62-212.400, F.A.C., Rule 62-212.500, F.A.C., or any former codification of Rule 62-212.400 or Rule 62-212.500, F.A.C., shall be accomplished only through the issuance of a new or revised air construction permit under Rule 62-204.800(10)(d)2., Rule 62-212.400, or Rule 62-212.500, F.A.C., as appropriate.

2. The force and effect of any change in a permit limitation or requirement made in accordance with the provisions of Rule 62-210.300(1)(b)1., F.A.C., shall be the same as if such change were made to the original air construction permit.

3. Nothing in Rule 62-210.300(1)(b), F.A.C., shall be construed as to allow operation of a facility or emissions unit without a valid air operation permit.

(2) Air Operation Permits. Upon expiration of the air operation permit for any existing facility or emissions unit, subsequent to construction or modification, or subsequent to the creation of or change to a bubble, and demonstration of compliance with the conditions of the construction permit for any new or modified facility or emissions unit, any air emissions bubble, or as otherwise provided in Chapter 62-210, F.A.C., or Chapter 62-213, F.A.C., the owner or operator of such facility or emissions unit shall obtain a renewal air operation permit, an initial air operation permit or general permit, or an administrative correction or revision of an existing air operation permit, whichever is appropriate, in accordance with all applicable provisions of Chapter 62210, F.A.C., Chapter 62-213, F.A.C., and Chapter 62-4, F.A.C.

(a) Minimum Requirements for All Air Operation Permits. At a minimum, a permit issued pursuant to this subsection shall:

1. Specify the manner, nature, volume and frequency of the emissions permitted, and the applicable emission limiting standards or performance standards, if any;
2. Require proper operation and maintenance of any pollution control equipment by qualified personnel, where applicable in accordance with the provisions of any operation and maintenance plan required by the air pollution rules of the Department.
3. Contain an effective date stated in the permit which shall not be earlier than the date final action is taken on the application and be issued for a period, beginning on the effective date, as provided below.
 - a. The operation permit for an emissions unit which is in compliance with all applicable rules and in operational condition, and which the owner or operator intends to continue operating, shall be issued or renewed for a five-year period, except that, for Title V sources subject to Rule 62-213.420(1)(a)1., F.A.C., operation permits shall be extended until 60 days after the due date for submittal of the facility's Title V permit application as specified in Rule 62-213.420(1)(a)1., F.A.C.
 - b. Except as provided in Rule 62-210.300(2)(a)3.d., F.A.C., the operation permit for an emissions unit which has been shut down for six months or more prior to the expiration date of the current operation permit, shall be renewed for a period not to exceed five years from the date of shutdown, even if the emissions unit is not maintained in operational condition, provided:
 - (i) the owner or operator of the emissions unit demonstrates to the Department that the emissions unit may need to be reactivated and used, or that it is the owner's or operator's intent to apply to the Department for a permit to construct a new emissions unit at the facility before the end of the extension period; and,
 - (ii) the owner or operator of the emissions unit agrees to and is legally prohibited from providing the allowable emission permitted by the renewed permit as an emissions offset to any other person under Rule 62212.500, F.A.C.; and,
 - (iii) the emissions unit was operating in compliance with all applicable rules as of the time the source was shut down.
 - c. Except as provided in Rule 62-210.300(2)(a)3.d., F.A.C., the operation permit for an emissions unit which has been shut down for five years or more prior to the expiration date of the current operation permit shall be renewed for a maximum period not to exceed ten years from the date of shutdown, even if the emissions unit is not maintained in operational condition, provided the conditions given in Rule 62210.300(2)(a)3.b., F.A.C., are met and the owner or operator demonstrates to the Department that failure to renew the permit would constitute a hardship, which may include economic hardship.
 - d. The operation permit for an electric utility generating unit on cold standby or long-term reserve shutdown shall be renewed for a five-year period, and additional five-year periods, even if the unit is not maintained in operational condition, provided the conditions given in Rules 62-210.300(2)(a)3.b.(i) through (iii), F.A.C., are met.
4. In the case of an emissions unit permitted pursuant to Rules 62-210.300(2)(a)3.b., c., and d., F.A.C., include reasonable notification and compliance testing requirements for reactivation of such emissions unit and provide that the owner or operator demonstrate to the Department prior to reactivation that such reactivation would not constitute reconstruction pursuant to Rule 62-204.800(7), F.A.C.

[Rules 62-210.300(1) & (2), F.A.C.]

19. **Not federally enforceable.** Notification of Startup. The owner or operator of any emissions unit or facility which has a valid air operation permit which has been shut down more than one year, shall notify the Department in writing of the intent to start up such emissions unit or facility, a minimum of 60 days prior to the intended startup date.

(a) The notification shall include information as to the startup date, anticipated emission rates or pollutants released, changes to processes or control devices which will result in changes to emission rates, and any other conditions which may differ from the valid outstanding operation permit.

APPENDIX TV-4, TITLE V CONDITIONS (version dated 02/12/02) (continued)

(b) If, due to an emergency, a startup date is not known 60 days prior thereto, the owner shall notify the Department as soon as possible after the date of such startup is ascertained.

[Rule 62-210.300(5), F.A.C.]

20. Emissions Unit Reclassification.

(a) Any emissions unit whose operation permit has been revoked as provided for in Chapter 624, F.A.C., shall be deemed permanently shut down for purposes of Rule 62-212.500, F.A.C. Any emissions unit whose permit to operate has expired without timely renewal or transfer may be deemed permanently shut down, provided, however, that no such emissions unit shall be deemed permanently shut down if, within 20 days after receipt of written notice from the Department, the emissions unit owner or operator demonstrates that the permit expiration resulted from inadvertent failure to comply with the requirements of Rule 624.090, F.A.C., and that the owner or operator intends to continue the emissions unit in operation, and either submits an application for an air operation permit or complies with permit transfer requirements, if applicable.

(b) If the owner or operator of an emissions unit which is so permanently shut down, applies to the Department for a permit to reactivate or operate such emissions unit, the emissions unit will be reviewed and permitted as a new emissions unit.

[Rule 62-210.300(6), F.A.C.]

21. Transfer of Air Permits.

(a) An air permit is transferable only after submission of an Application for Transfer of Air Permit (DEP Form 62-210.900(7)) and Department approval in accordance with Rule 62-4.120, F.A.C. For Title V permit transfers only, a complete application for transfer of air permit shall include the requirements of 40 CFR 70.7(d)(1)(iv), adopted and incorporated by reference at Rule 62-204.800, F.A.C. Within 30 days after approval of the transfer of permit, the Department shall update the permit by an administrative permit correction pursuant to Rule 62-210.360, F.A.C.

(b) For an air general permit, the provision of Rules 62-210.300(7)(a) and 62-4.120, F.A.C., do not apply. Thirty (30) days before using an air general permit, the new owner must submit an air general permit notification to the Department in accordance with Rule 62-210.300(4), F.A.C., or Rule 62-213.300(2)(b), F.A.C.

[Rule 62-210.300(7), F.A.C.]

22. Public Notice and Comment.

(1) Public Notice of Proposed Agency Action.

(a) A notice of proposed agency action on permit application, where the proposed agency action is to issue the permit, shall be published by any applicant for:

1. An air construction permit;
2. An air operation permit, permit renewal or permit revision subject to Rule 62-210.300(2)(b), F.A.C., (i.e., a FESOP), except as provided in Rule 62-210.300(2)(b)1.b., F.A.C.; or
3. An air operation permit, permit renewal, or permit revision subject to Chapter 62213, F.A.C., except Title V air general permits or those permit revisions meeting the requirements of Rule 62213.412(1), F.A.C.

(b) The notice required by Rule 62-210.350(1)(a), F.A.C., shall be published in accordance with all otherwise applicable provisions of Rule 62-110.106, F.A.C. A public notice under Rule 62-210.350(1)(a)1., F.A.C., for an air construction permit may be combined with any required public notice under Rule 62-210.350(1)(a)2. or 3., F.A.C., for air operation permits. If such notices are combined, the public notice must comply with the requirements for both notices.

(c) Except as otherwise provided at Rules 62-210.350(2) and (5), F.A.C., each notice of intent to issue an air construction permit shall provide a 14-day period for submittal of public comments.

(2) Additional Public Notice Requirements for Emissions Units Subject to Prevention of Significant Deterioration or Nonattainment - Area Preconstruction Review.

(a) Before taking final agency action on a construction permit application for any proposed new or modified facility or emissions unit subject to the preconstruction review requirements of Rule 62212.400 or 62-212.500, F.A.C., the Department shall comply with all applicable provisions of Rule 62-110.106, F.A.C., and provide an opportunity for public comment which shall include as a minimum the following:

1. A complete file available for public inspection in at least one location in the district affected which includes the information submitted by the owner or operator, exclusive of confidential records under Section 403.111, F.S., and the Department's analysis of the effect of the proposed construction or modification on ambient air quality including the Department's preliminary determination of whether the permit should be approved or disapproved;
2. A 30-day period for submittal of public comments; and,

3. A notice, by advertisement in a newspaper of general circulation in the county affected, specifying the nature and location of the proposed facility or emissions unit, whether BACT or LAER has been determined, the degree of PSD increment consumption expected, if applicable, and the location of the information specified in paragraph 1. above; and, notifying the public of the opportunity for submitting comments and requesting a public hearing.
- (b) The notice provided for in Rule 62-210.350(2)(a)3., F.A.C., shall be prepared by the Department and published by the applicant in accordance with all applicable provisions of Rule 62-110.106, F.A.C., except that the applicant shall cause the notice to be published no later than thirty (30) days prior to final agency action.
- (c) A copy of the notice provided for in Rule 62-210.350(2)(a)3., F.A.C., shall also be sent by the Department to the Regional Office of the U. S. Environmental Protection Agency and to all other state and local officials or agencies having cognizance over the location of such new or modified facility or emissions unit, including local air pollution control agencies, chief executives of city or county government, regional land use planning agencies, and any other state, Federal Land Manager, or Indian Governing Body whose lands may be affected by emissions from the new or modified facility or emissions unit.
- (d) A copy of the notice provided for in Rule 62-210.350(2)(a)3., F.A.C., shall be displayed in the appropriate district, branch and local program offices.
- (e) An opportunity for public hearing shall be provided in accordance with Chapter 120, F.S., and Rule 62-110.106, F.A.C.
- (f) Any public comments received shall be made available for public inspection in the location where the information specified in Rule 62-210.350(2)(a)1., F.A.C., is available and shall be considered by the Department in making a final determination to approve or deny the permit.
- (g) The final determination shall be made available for public inspection at the same location where the information specified in Rule 62-210.350(2)(a)1., F.A.C., was made available.
- (h) For a proposed new or modified emissions unit which would be located within 100 kilometers of any Federal Class I area or whose emissions may affect any Federal Class I area, and which would be subject to the preconstruction review requirements of Rule 62-212.400, F.A.C., or Rule 62-212.500, F.A.C.:
1. The Department shall mail or transmit to the Administrator a copy of the initial application for an air construction permit and notice of every action related to the consideration of the permit application.
 2. The Department shall mail or transmit to the Federal Land Manager of each affected Class I area a copy of any written notice of intent to apply for an air construction permit; the initial application for an air construction permit, including all required analyses and demonstrations; any subsequently submitted information related to the application; the preliminary determination and notice of proposed agency action on the permit application; and any petition for an administrative hearing regarding the application or the Department's proposed action. Each such document shall be mailed or transmitted to the Federal Land Manager within fourteen (14) days after its receipt by the Department.
- (3) Additional Public Notice Requirements for Facilities Subject to Operation Permits for Title V Sources.
- (a) Before taking final agency action to issue a new, renewed, or revised air operation permit subject to Chapter 62213, F.A.C., the Department shall comply with all applicable provisions of Rule 62-110.106, F.A.C., and provide an opportunity for public comment which shall include as a minimum the following:
1. A complete file available for public inspection in at least one location in the district affected which includes the information submitted by the owner or operator, exclusive of confidential records under Section 403.111, F.S.; and,
 2. A 30-day period for submittal of public comments.
- (b) The notice provided for in Rule 62-210.350(3)(a), F.A.C., shall be prepared by the Department and published by the applicant in accordance with all applicable provisions of Rule 62-110.106, F.A.C., except that the applicant shall cause the notice to be published no later than thirty (30) days prior to final agency action. If written comments received during the 30-day comment period on a draft permit result in the Department's issuance of a revised draft permit in accordance with Rule 62-213.430(1), F.A.C., the Department shall require the applicant to publish another public notice in accordance with Rule 62-210.350(1)(a), F.A.C.
- (c) The notice shall identify:
1. The facility;
 2. The name and address of the office at which processing of the permit occurs;
 3. The activity or activities involved in the permit action;
 4. The emissions change involved in any permit revision;
 5. The name, address, and telephone number of a Department representative from whom interested persons may obtain additional information, including copies of the permit draft, the application, and all relevant supporting materials, including any permit application, compliance plan, permit, monitoring report, and compliance statement required pursuant to Chapter 62-213, F.A.C. (except for information entitled to confidential treatment pursuant to Section 403.111, F.S), and all other materials available to the Department that are relevant to the permit decision;

APPENDIX TV-4, TITLE V CONDITIONS (version dated 02/12/02) (continued)

6. A brief description of the comment procedures required by Rule 62210.350(3), F.A.C.;
7. The time and place of any hearing that may be held, including a statement of procedure to request a hearing (unless a hearing has already been scheduled); and,
8. The procedures by which persons may petition the Administrator to object to the issuance of the proposed permit after expiration of the Administrator's 45-day review period.

[Rule 62-210.350, F.A.C.]

23. Administrative Permit Corrections

- (1) A facility owner shall notify the Department by letter of minor corrections to information contained in a permit. Such notifications shall include:
 - (a) Typographical errors noted in the permit;
 - (b) Name, address or phone number change from that in the permit;
 - (c) A change requiring more frequent monitoring or reporting by the permittee;
 - (d) A change in ownership or operational control of a facility, subject to the following provisions:
 1. The Department determines that no other change in the permit is necessary;
 2. The permittee and proposed new permittee have submitted an Application for Transfer of Air Permit, and the Department has approved the transfer pursuant to Rule 62-210.300(7), F.A.C.; and
 3. The new permittee has notified the Department of the effective date of sale or legal transfer.
 - (e) Changes listed at 40 CFR 72.83(a)(1), (2), (6), (9) and (10), adopted and incorporated by reference at Rule 62-204.800, F.A.C., and changes made pursuant to Rules 62-214.340(1) and (2), F.A.C., to Title V sources subject to emissions limitations or reductions pursuant to 42 USC ss. 7651-7651o;
 - (f) Changes listed at 40 CFR 72.83(a)(11) and (12), adopted and incorporated by reference at Rule 62-204.800, F.A.C., to Title V sources subject to emissions limitations or reductions pursuant to 42 USC ss. 7651-7651o, provided the notification is accompanied by a copy of any EPA determination concerning the similarity of the change to those listed at Rule 62-210.360(1)(e), F.A.C.; and,
 - (g) Any other similar minor administrative change at the source.
- (2) Upon receipt of any such notification the Department shall within 60 days correct the permit and provide a corrected copy to the owner.
- (3) After first notifying the owner, the Department shall correct any permit in which it discovers errors of the types listed at Rules 62-210.360(1)(a) and (b), F.A.C., and provide a corrected copy to the owner.
- (4) For Title V source permits, other than general permits, a copy of the corrected permit shall be provided to EPA and any approved local air program in the county where the facility or any part of the facility is located.
- (5) The Department shall incorporate requirements resulting from issuance of a new or revised construction permit into an existing Title V source permit, if the construction permit or permit revision incorporates requirements of federally enforceable preconstruction review, and if the applicant requests at the time of application that all of the requirements of Rule 62-213.430(1), F.A.C., be complied with in conjunction with the processing of the construction permit application.

[Rule 62-210.360, F.A.C.]

24. Reports

- (3) Annual Operating Report for Air Pollutant Emitting Facility.
 - (a) The Annual Operating Report for Air Pollutant Emitting Facility (DEP Form No. 62210.900(5)) shall be completed each year.
 - (c) The annual operating report shall be submitted to the appropriate Department District or Department approved local air pollution control program office by March 1 of the following year unless otherwise indicated by permit condition or Department request.

[Rule 62-210.370(3), F.A.C.]

25. Circumvention. No person shall circumvent any air pollution control device, or allow the emission of air pollutants without the applicable air pollution control device operating properly.

[Rule 62-210.650, F.A.C.]

26. Forms and Instructions. The forms used by the Department in the stationary source control program are adopted and incorporated by reference in this section. The forms are listed by rule number, which is also the form number, with the subject, title and effective date. Forms 62-210.900(1),(3),(4) and (5), F.A.C., including instructions, are available from the Department as hard-copy documents or executable files on computer diskettes. Copies of forms (hardcopy or diskette) may be obtained by writing to the Department of Environmental Protection, Division of Air Resource Management, 2600 Blair Stone Road, Tallahassee, Florida 32399-2400. Notwithstanding the requirement of Rule 62-4.050(2), F.A.C., to file application forms in quadruplicate, if an air permit application is submitted using the Department's electronic application form, only one copy of the diskette and signature pages is required to be submitted.

(1) Application for Air Permit - Title V Source, Form and Instructions (Effective 02/11/1999).

(a) Acid Rain Part (Phase II), Form and Instructions (Effective 04/16/2001).

1. Repowering Extension Plan, Form and Instructions (Effective 07/01/1995).

2. New Unit Exemption, Form and Instructions (Effective 04/16/2001).

3. Retired Unit Exemption, Form and Instructions (Effective 04/16/2001).

4. Phase II NOx Compliance Plan, Form and Instructions (Effective 01/06/1998).

5. Phase II NOx Averaging Plan, Form (Effective 01/06/1998).

(b) Reserved.

(5) Annual Operating Report for Air Pollutant Emitting Facility, Form and Instructions (Effective 02/11/1999).

(7) Application for Transfer of Air Permit - Title V and Non-Title V Source, (Effective 04/16/2001).

[Rule 62-210.900, F.A.C.]

Chapter 62-213, F.A.C.

27. Annual Emissions Fee. Each Title V source permitted to operate in Florida must pay between January 15 and March 1 of each year, upon written notice from the Department, an annual emissions fee in an amount determined as set forth in Rule 62-213.205(1), F.A.C.

[Rules 62-213.205 and 62-213.900(1), F.A.C.]

28. Annual Emissions Fee. Failure to pay timely any required annual emissions fee, penalty, or interest constitutes grounds for permit revocation pursuant to Rule 62-4.100, F.A.C.

[Rule 62-213.205(1)(g), F.A.C.]

29. Annual Emissions Fee. Any documentation of actual hours of operation, actual material or heat input, actual production amount, or actual emissions used to calculate the annual emissions fee shall be retained by the owner for a minimum of five (5) years and shall be made available to the Department upon request.

[Rule 62-213.205(1)(i), F.A.C.]

30. Annual Emissions Fee. A completed DEP Form 62-213.900(1), F.A.C., "Major Air Pollution Source Annual Emissions Fee Form", must be submitted by the responsible official with the annual emissions fee.

[Rule 62-213.205(1)(j), F.A.C.]

31. Air Operation Permit Fees. No permit application processing fee, renewal fee, modification fee or amendment fee is required for an operation permit for a Title V source.

[Rule 62-213.205(4), F.A.C.]

32. Permits and Permit Revisions Required. All Title V sources are subject to the permit requirements of Chapter 62-213, F.A.C.

(1) No Title V source may operate except in compliance with Chapter 62-213, F.A.C.

(2) Except as provided in Rule 62-213.410, F.A.C., no source with a permit issued under the provisions of this chapter shall make any changes in its operation without first applying for and receiving a permit revision if the change meets any of the following:

(a) Constitutes a modification;

(b) Violates any applicable requirement;

(c) Exceeds the allowable emissions of any air pollutant from any unit within the source;

(d) Contravenes any permit term or condition for monitoring, testing, recordkeeping, reporting or of a compliance certification requirement;

(e) Requires a case-by-case determination of an emission limitation or other standard or a source specific determination of ambient impacts, or a visibility or increment analysis under the provisions of Chapters 62-212 or 62-296, F.A.C.;

(f) Violates a permit term or condition which the source has assumed for which there is no corresponding underlying applicable requirement to which the source would otherwise be subject;

(g) Results in the trading of emissions among units within a source except as specifically authorized pursuant to Rule 62-213.415, F.A.C.;

APPENDIX TV-4, TITLE V CONDITIONS (version dated 02/12/02) (continued)

- (h) Results in the change of location of any relocatable facility identified as a Title V source pursuant to paragraph (a)(e), (g) or (h) of the definition of "major source of air pollution" at Rule 62210.200, F.A.C.;
- (i) Constitutes a change at an Acid Rain Source under the provisions of 40 CFR 72.81(a)(1),(2),or (3),(b)(1) or (b)(3), hereby incorporated by reference;
- (j) Constitutes a change in a repowering plan, nitrogen oxides averaging plan, or nitrogen oxides compliance deadline extension at an Acid Rain Source;
- (k) Is a request for industrial-utility unit exemption pursuant to Rule 62-214.340, F.A.C.

[Rules 62-213.400(1) & (2), F.A.C.]

33. Changes Without Permit Revision Title V sources having a valid permit issued pursuant to Chapter 62-213, F.A.C., may make the following changes without permit revision, provided that sources shall maintain source logs or records to verify periods of operation in each alternative method of operation:

- (1) Permitted sources may change among those alternative methods of operation allowed by the source's permit as provided by the terms of the permit;
- (2) Permitted sources may implement the terms or conditions of a new or revised construction permit if;
 - (a) The application for construction permit complied with the requirements of Rule 62-213.420(3) and (4), F.A.C.;
 - (b) The terms or conditions were subject to federally enforceable preconstruction review pursuant to Chapter 62212, F.A.C.; and,
 - (c) The new or revised construction permit was issued after the Department and the applicant complied with all the requirements of Rule 62-213.430(1), F.A.C.;
- (3) A permitted source may implement operating changes, as defined in Rule 62210.200, F.A.C., after the source submits any forms required by any applicable requirement and provides the Department and EPA with at least 7 days written notice prior to implementation. The source and the Department shall attach each notice to the relevant permit;
 - (a) The written notice shall include the date on which the change will occur and a description of the change within the permitted source, the pollutants emitted and any change in emissions, and any term or condition becoming applicable or no longer applicable as a result of the change;
 - (b) The permit shield described in Rule 62-213.460, F.A.C., shall not apply to such changes;
- (4) Permitted sources may implement changes involving modes of operation only in accordance with Rule 62213.415, F.A.C.

[Rule 62-213.410, F.A.C.]

34. Immediate Implementation Pending Revision Process

- (1) Those permitted Title V sources making any change that constitutes a modification pursuant to the definition of modification at Rule 62-210.200, F.A.C., but which would not constitute a modification pursuant to 42 USC 7412(a) or to 40 CFR 52.01, 60.2, or 61.15, adopted and incorporated by reference at Rule 62-204.800, F.A.C., may implement such change prior to final issuance of a permit revision in accordance with this section, provided the change:
 - (a) Does not violate any applicable requirement;
 - (b) Does not contravene any permit term or condition for monitoring, testing, recordkeeping or reporting, or any compliance certification requirement;
 - (c) Does not require or change a case-by-case determination of an emission limitation or other standard, or a source-specific determination of ambient impacts, or a visibility or increment analysis under the provisions of Chapter 62212 or 62-296, F.A.C.;
 - (d) Does not seek to establish or change a permit term or condition for which there is no corresponding underlying applicable requirement and which the source has assumed to avoid an applicable requirement to which the source would otherwise be subject including any federally enforceable emissions cap or federally enforceable alternative emissions limit.
- (2) A Title V source may immediately implement such changes after they have been incorporated into the terms and conditions of a new or revised construction permit issued pursuant to Chapter 62-212, F.A.C., and after the source provides to EPA, the Department, each affected state and any approved local air program having geographic jurisdiction over the source, a copy of the source's application for operation permit revision. The Title V source may conform its application for construction permit to include all information required by Rule 62-213.420, F.A.C., in lieu of submitting separate application forms.

(3) The Department shall process the application for operation permit revision in accordance with the provisions of Chapter 62213, F.A.C., except that the Department shall issue a draft permit revision or a determination to deny the revision within 60 days of receipt of a complete application for operation permit revision or, if the Title V source has submitted a construction permit application conforming to the requirements of Rule 62-213.420, F.A.C., the Department shall issue a draft permit or a determination to deny the revision at the same time the Department issues its determination on issuance or denial of the construction permit application. The Department shall not take final action until all the requirements of Rules 62213.430(1)(a), (c), (d), and (e), F.A.C., have been complied with.

(4) Pending final action on the operation permit revision application, the source shall implement the changes in accordance with the terms and conditions of the source's new or revised construction permit.

(5) The permit shield described in Rule 62-213.460, F.A.C., shall not apply to such changes until after the Department takes final action to issue the operation permit revision.

(6) If the Department denies the source's application for operation permit revision, the source shall cease implementation of the proposed changes.

[Rule 62-213.412, F.A.C.]

35. Permit Applications.

(1) Duty to Apply. For each Title V source, the owner or operator shall submit a timely and complete permit application in compliance with the requirements of Rules 62-213.420, F.A.C., and Rules 62-4.050(1) through (3), F.A.C.

(a) Timely Application.

3. For purposes of permit renewal, a timely application is one that is submitted in accordance with Rule 62-4.090, F.A.C.

(b) Complete Application.

1. Any applicant for a Title V permit, permit revision or permit renewal must submit an application on DEP Form No. 62-210.900(1), which must include all the information specified by Rule 62-213.420(3), F.A.C., except that an application for permit revision must contain only that information related to the proposed change. The applicant shall include information concerning fugitive emissions and stack emissions in the application. Each application for permit, permit revision or permit renewal shall be certified by a responsible official in accordance with Rule 62213.420(4), F.A.C.

2. For those applicants submitting initial permit applications pursuant to Rule 62-213.420(1)(a)1., F.A.C., a complete application shall be an application that substantially addresses all the information required by the application form number 62-210.900(1), and such applications shall be deemed complete within sixty days of receipt of a signed and certified application unless the Department notifies the applicant of incompleteness within that time. For all other applicants, the applications shall be deemed complete sixty days after receipt, unless the Department, within sixty days after receipt of a signed application for permit, permit revision or permit renewal, requests additional documentation or information needed to process the application. An applicant making timely and complete application for permit or timely application for permit renewal as described by Rule 62-4.090(1), F.A.C., shall continue to operate the source under the authority and provisions of any existing valid permit or Florida Electrical Power Plant Siting Certification, and in accordance with applicable requirements of the Acid Rain Program, until the conclusion of proceedings associated with its permit application or until the new permit becomes effective, whichever is later, provided the applicant complies with all the provisions of Rules 62-213.420(1)(b)3. and 4. F.A.C. Failure of the Department to request additional information within sixty days of receipt of a properly signed application shall not impair the Department's ability to request additional information pursuant to Rules 62-213.420(1)(b)3. and 4., F.A.C.

3. For those permit applications submitted pursuant to the provisions of Rule 62213.420(1)(a)1., F.A.C., the Department shall notify the applicant if the Department becomes aware at any time during processing of the application that the application contains incorrect or incomplete information. The applicant shall submit the corrected or supplementary information to the Department within ninety days unless the applicant has requested and been granted additional time to submit the information. Failure of an applicant to submit corrected or supplementary information requested by the Department within ninety days or such additional time as requested and granted shall render the application incomplete.

4. For all applications other than those addressed at Rule 62-213.420(1)(b)3., F.A.C., should the Department become aware, during processing of any application that the application contains incorrect information, or should the Department become aware, as a result of comment from an affected State, an approved local air program, EPA, or the public that additional information is needed to evaluate the application, the Department shall notify the applicant within 30 days. When an applicant becomes aware that an application contains incorrect or incomplete information, the applicant shall submit the corrected or supplementary information to the Department. If the Department notifies an applicant that corrected or supplementary information is necessary to process the permit, and requests a response, the applicant shall provide the information to the Department within ninety days of the Department request unless the applicant has requested

APPENDIX TV-4, TITLE V CONDITIONS (version dated 02/12/02) (continued)

and been granted additional time to submit the information or, the applicant shall, within ninety days, submit a written request that the Department process the application without the information. Failure of an applicant to submit corrected or supplementary information requested by the Department within ninety days, or such additional time as requested and granted, or to demand in writing within ninety days that the application be processed without the information shall render the application incomplete. Nothing in this section shall limit any other remedies available to the Department.

[Rules 62-213.420(1)(a)3. and 62-213.420(1)(b)1., 2., 3. & 4., F.A.C.]

36. Confidential Information Whenever an applicant submits information under a claim of confidentiality pursuant to Section 403.111, F.S., the applicant shall also submit a copy of all such information and claim directly to EPA. (also, see Condition No. 50.)
[Rule 62-213.420(2), F.A.C.]

37. Standard Application Form and Required Information Applications shall be submitted under Chapter 62-213, F.A.C., on forms provided by the Department and adopted by reference in Rule 62-210.900(1), F.A.C. The information as described in Rule 62-210.900(1), F.A.C., shall be included for the Title V source and each emissions unit. An application must include information sufficient to determine all applicable requirements for the Title V source and each emissions unit and to evaluate a fee amount pursuant to Rule 62-213.205, F.A.C.
[Rule 62-213.420(3), F.A.C.]

38. a. Permit Renewal and Expiration Permits being renewed are subject to the same requirements that apply to permit issuance at the time of application for renewal. Permit renewal applications shall contain that information identified in Rules 62-210.900(1) and 62-213.420(3), F.A.C. Unless a Title V source submits a timely application for permit renewal in accordance with the requirements of Rule 62-4.090(1), F.A.C., the existing permit shall expire and the source's right to operate shall terminate. No Title V permit will be issued for a new term except through the renewal process.

b. Permit Revision Procedures Permit revisions shall meet all requirements of Chapter 62-213, F.A.C., including those for content of applications, public participation, review by approved local programs and affected states, and review by EPA, as they apply to permit issuance and permit renewal, except that permit revisions for those activities implemented pursuant to Rule 62-213.412, F.A.C., need not meet the requirements of Rule 62-213.430(1)(b), F.A.C. The Department shall require permit revision in accordance with the provisions of Rule 62-4.080, F.A.C., and 40 CFR 70.7(f), whenever any source becomes subject to any condition listed at 40 CFR 70.7(f)(1), hereby adopted and incorporated by reference. The below requirements from 40 CFR 70.7(f) are adopted and incorporated by reference in Rule 62-213.430(4), F.A.C.:

o 40 CFR 70.7(f): Reopening for Cause (also, see Condition No. 4.)

(1) This section contains provisions from 40 CFR 70.7(f) that specify the conditions under which a Title V permit shall be reopened prior to the expiration of the permit. A Title V permit shall be reopened and revised under any of the following circumstances:

(i) Additional applicable requirements under the Act become applicable to a major Part 70 source with a remaining permit term of 3 or more years. Such a reopening shall be completed not later than 18 months after promulgation of the applicable requirement. No such reopening is required if the effective date of the requirement is later than the date on which the permit is due to expire, unless the original permit or any of its terms and conditions has been extended pursuant to 40 CFR 70.4(b)(10)(i) or (ii).

(ii) Additional requirements (including excess emissions requirements) become applicable to an affected source under the acid rain program. Upon approved by the Administrator, excess emissions offset plans shall be deemed to be incorporated into the permit.

(iii) The permitting authority or EPA determines that the permit contains a material mistake or that inaccurate statements were made in establishing the emissions standards or other terms or conditions of the permit.

(iv) The Administrator or the permitting authority determines that the permit must be revised or revoked to assure compliance with the applicable requirements.

(2) Proceedings to reopen and issue a permit shall follow the same procedures as apply to initial permit issuance and shall affect only those parts of the permit for which cause to reopen exists. Such reopening shall be made as expeditiously as practicable.

(3) Reopenings under 40 CFR 70.7(f)(1) shall not be initiated before a notice of such intent is provided to the Part 70 source by the permitting authority at least 30 days in advance of the date that the permit is to be reopened, except that the permitting authority may provide a shorter time period in the case of an emergency.

[Rules 62-213.430(3) & (4), F.A.C.; and, 40 CFR 70.7(f)]

39. Insignificant Emissions Units or Pollutant-Emitting Activities.

APPENDIX TV-4, TITLE V CONDITIONS (version dated 02/12/02) (continued)

(a) All requests for determination of insignificant emissions units or activities made pursuant to Rule 62-213.420(3)(m), F.A.C., shall be processed in conjunction with the permit, permit renewal or permit revision application submitted pursuant to Chapter 62213, F.A.C. Insignificant emissions units or activities shall be approved by the Department consistent with the provisions of Rule 62-4.040(1)(b), F.A.C. Emissions units or activities which are added to a Title V source after issuance of a permit under Chapter 62-213, F.A.C., shall be incorporated into the permit at its next renewal, provided such emissions units or activities have been exempted from the requirement to obtain an air construction permit and also qualify as insignificant pursuant to Rule 62-213.430(6), F.A.C.

(b) An emissions unit or activity shall be considered insignificant if all of the following criteria are met:

1. Such unit or activity would be subject to no unit-specific applicable requirement;
2. Such unit or activity, in combination with other units or activities proposed as insignificant, would not cause the facility to exceed any major source threshold(s) as defined in Rule 62-213.420(3)(c)1., F.A.C., unless it is acknowledged in the permit application that such units or activities would cause the facility to exceed such threshold(s);
3. Such unit or activity would not emit or have the potential to emit:
 - a. 500 pounds per year or more of lead and lead compounds expressed as lead;
 - b. 1,000 pounds per year or more of any hazardous air pollutant;
 - c. 2,500 pounds per year or more of total hazardous air pollutants; or
 - d. 5.0 tons per year or more of any other regulated pollutant.

[Rule 62-213.430(6), F.A.C.]

40. Permit Duration. Permits for sources subject to the Federal Acid Rain Program shall be issued for terms of five years, provided that the initial Acid Rain Part may be issued for a term less than five years where necessary to coordinate the term of such part with the term of a Title V permit to be issued to the source. Operation permits for Title V sources may not be extended as provided in Rule 62-4.080(3), F.A.C., if such extension will result in a permit term greater than five years.

[Rule 62-213.440(1)(a), F.A.C.]

41. Monitoring Information. All records of monitoring information shall specify the date, place, and time of sampling or measurement and the operating conditions at the time of sampling or measurement, the date(s) analyses were performed, the company or entity that performed the analyses, the analytical techniques or methods used, and the results of such analyses.

[Rule 62-213.440(1)(b)2.a., F.A.C.]

42. Retention of Records. Retention of records of all monitoring data and support information shall be for a period of at least 5 years from the date of the monitoring sample, measurement, report, or application. Support information includes all calibration and maintenance records and all original strip-chart recordings for continuous monitoring instrumentation, and copies of all reports required by the permit.

[Rule 62-213.440(1)(b)2.b., F.A.C.]

43. Monitoring Reports. The permittee shall submit reports of any required monitoring at least every six (6) months. All instances of deviations from permit requirements must be clearly identified in such reports.

[Rule 62-213.440(1)(b)3.a., F.A.C.]

44. Deviation from Permit Requirements Reports. The permittee shall report in accordance with the requirements of Rules 62-210.700(6) and 62-4.130, F.A.C., deviations from permit requirements, including those attributable to upset conditions as defined in the permit. Reports shall include the probable cause of such deviations, and any corrective actions or preventive measures taken.

[Rule 62-213.440(1)(b)3.b., F.A.C.]

45. Reports. All reports shall be accompanied by a certification by a responsible official, pursuant to Rule 62-213.420(4), F.A.C.

[Rule 62-213.440(1)(b)3.c., F.A.C.]

APPENDIX TV-4, TITLE V CONDITIONS (version dated 02/12/02) (continued)

46. If any portion of the final permit is invalidated, the remainder of the permit shall remain in effect.
[Rule 62-213.440(1)(d)1., F.A.C.]
47. It shall not be a defense for a permittee in an enforcement action that maintaining compliance with any permit condition would necessitate halting of or reduction of the source activity.
[Rule 62-213.440(1)(d)3., F.A.C.]
48. Any Title V source shall comply with all the terms and conditions of the existing permit until the Department has taken final action on any permit renewal or any requested permit revision, except as provided at Rule 62-213.412(2), F.A.C.
[Rule 62-213.440(1)(d)4., F.A.C.]
49. A situation arising from sudden and unforeseeable events beyond the control of the source which causes an exceedance of a technology-based emissions limitation because of unavoidable increases in emissions attributable to the situation and which requires immediate corrective action to restore normal operation, shall be an affirmative defense to an enforcement action in accordance with the provisions and requirements of 40 CFR 70.6(g)(2) and (3), hereby adopted and incorporated by reference.
[Rule 62-213.440(1)(d)5., F.A.C.]
50. Confidentiality Claims. Any permittee may claim confidentiality of any data or other information by complying with Rule 62-213.420(2), F.A.C. (also, see Condition No. 36.).
[Rule 62-213.440(1)(d)6., F.A.C.]
51. Statement of Compliance. (a)2. The permittee shall submit a Statement of Compliance with all terms and conditions of the permit using DEP Form No. 62-213.900(7). Such statements shall be accompanied by a certification in accordance with Rule 62-213.420(4), F.A.C. Such statement shall be submitted (postmarked) to the Department and EPA:
a. Annually, within 60 days after the end of each calendar year during which the Title V permit was effective, or more frequently if specified by Rule 62-213.440(2), F.A.C., or by any other applicable requirement; and
b. Within 60 days after submittal of a written agreement for transfer of responsibility as required pursuant to 40 CFR 70.7(d)(1)(iv), adopted and incorporated by reference at Rule 62-204.800, F.A.C., or within 60 days after permanent shutdown of a facility permitted under Chapter 62-213, F.A.C.; provided that, in either such case, the reporting period shall be the portion of the calendar year the permit was effective up to the date of transfer of responsibility or permanent facility shutdown, as applicable.
3. The statement of compliance status shall include all the provisions of 40 CFR 70.6(c)(5)(iii), incorporated by reference at Rule 62-204.800, F.A.C.
(b) The responsible official may treat compliance with all other applicable requirements as a surrogate for compliance with Rule 62-296.320(2), Objectionable Odor Prohibited.
[Rules 62-213.440(3)(a)2. & 3. and (b), F.A.C.]
52. Permit Shield. Except as provided in Chapter 62-213, F.A.C., compliance with the terms and conditions of a permit issued pursuant to Chapter 62-213, F.A.C., shall, as of the effective date of the permit, be deemed compliance with any applicable requirements in effect, provided that the source included such applicable requirements in the permit application. Nothing in Rule 62-213.460, F.A.C., or in any permit shall alter or affect the ability of EPA or the Department to deal with an emergency, the liability of an owner or operator of a source for any violation of applicable requirements prior to or at the time of permit issuance, or the requirements of the Federal Acid Rain Program.
[Rule 62-213.460, F.A.C.]
53. Forms and Instructions. The forms used by the Department in the Title V source operation program are adopted and incorporated by reference in Rule 62-213.900, F.A.C. The form is listed by rule number, which is also the form number, and with the subject, title, and effective date. Copies of forms may be obtained by writing to the Department of Environmental Protection, Division of Air Resources Management, 2600 Blair Stone Road, Tallahassee, Florida 32399-2400, or by contacting the appropriate permitting authority.
(1) Major Air Pollution Source Annual Emissions Fee Form. (Effective 01/03/2001)
(7) Statement of Compliance Form. (Effective 01/03/2001)
[Rule 62-213.900, F.A.C.: Forms (1) and (7)]

Chapter 62-256, F.A.C.

54. **Not federally enforceable. Open Burning.** This permit does not authorize any open burning nor does it constitute any waiver of the requirements of Chapter 62-256, F.A.C. Source shall comply with Chapter 62-256, F.A.C., for any open burning at the source. [Chapter 62-256, F.A.C.]

Chapter 62-281, F.A.C.

55. **Refrigerant Requirements.** Any facility having refrigeration equipment, including air conditioning equipment, which uses a Class I or II substance (listed at 40 CFR 82, Subpart A, Appendices A and B), and any facility which maintains, services, or repairs motor vehicles using a Class I or Class II substance as refrigerant must comply with all requirements of 40 CFR 82, Subparts B and F, and with Rule 62-281.100, F.A.C. Those requirements include the following restrictions:

- (1) Any facility having any refrigeration equipment normally containing 50 (fifty) pounds of refrigerant, or more, must keep servicing records documenting the date and type of all service and the quantity of any refrigerant added pursuant to 40 CFR 82.166;
 - (2) No person repairing or servicing a motor vehicle may perform any service on a motor vehicle air conditioner (MVAC) involving the refrigerant for such air conditioner unless the person has been properly trained and certified as provided at 40 CFR 82.34 and 40 CFR 82.40, and properly uses equipment approved pursuant to 40 CFR 82.36 and 40 CFR 82.38, and complies with 40 CFR 82.42;
 - (3) No person may sell or distribute, or offer for sale or distribution, any substance listed as a Class I or Class II substance at 40 CFR 82, Subpart A, Appendices A and B, except in compliance with Rule 62-281.100, F.A.C., and 40 CFR 82.34(b), 40 CFR 82.42, and/or 40 CFR 82.166;
 - (4) No person maintaining, servicing, repairing, or disposing of appliances may knowingly vent or otherwise release into the atmosphere any Class I or Class II substance used as a refrigerant in such equipment and no other person may open appliances (except MVACs as defined at 40 CFR 82.152) for service, maintenance or repair unless the person has been properly trained and certified pursuant to 40 CFR 82.161 and unless the person uses equipment certified for that type of appliance pursuant to 40 CFR 82.158 and unless the person observes the practices set forth at 40 CFR 82.156 and 40 CFR 82.166;
 - (5) No person may dispose of appliances (except small appliances, as defined at 40 CFR 82.152) without using equipment certified for that type of appliance pursuant to 40 CFR 82.158 and without observing the practices set forth at 40 CFR 82.156 and 40 CFR 82.166;
 - (6) No person may recover refrigerant from small appliances, MVACs and MVAGlike appliances (as defined at 40 CFR 82.152), except in compliance with the requirements of 40 CFR 82, Subpart F.
- [40 CFR 82; and, Chapter 62-281, F.A.C. (Chapter 62-281, F.A.C., is not federally enforceable)]

Chapter 62-296, F.A.C.

56. **Industrial, Commercial, and Municipal Open Burning Prohibited** Open burning in connection with industrial, commercial, or municipal operations is prohibited, except when:

- (a) Open burning is determined by the Department to be the only feasible method of operation and is authorized by an air permit issued pursuant to Chapter 62-210 or 62-213, F.A.C.; or,
- (b) An emergency exists which requires immediate action to protect human health and safety; or,
- (c) A county or municipality would use a portable air curtain incinerator to burn yard trash generated by a hurricane, tornado, fire or other disaster and the air curtain incinerator would otherwise be operated in accordance with the permitting exemption criteria of Rule 62-210.300(3), F.A.C.

[Rule 62-296.320(3), F.A.C.]

57. **Unconfined Emissions of Particulate Matter.**

(4)(c)1. No person shall cause, let, permit, suffer or allow the emissions of unconfined particulate matter from any activity, including vehicular movement; transportation of materials; construction; alteration; demolition or wrecking; or industrially related activities such as loading, unloading, storing or handling; without taking reasonable precautions to prevent such emissions.

3. Reasonable precautions include the following:

- a. Paving and maintenance of roads, parking areas and yards.
- b. Application of water or chemicals to control emissions from such activities as demolition of buildings, grading roads, construction, and land clearing.
- c. Application of asphalt, water, oil, chemicals or other dust suppressants to unpaved roads, yards, open stock piles and similar activities.

APPENDIX TV-4, TITLE V CONDITIONS (version dated 02/12/02) (continued)

- d. Removal of particulate matter from roads and other paved areas under the control of the owner or operator of the facility to prevent reentrainment, and from buildings or work areas to prevent particulate from becoming airborne.
- e. Landscaping or planting of vegetation.
- f. Use of hoods, fans, filters, and similar equipment to contain, capture and/or vent particulate matter.
- g. Confining abrasive blasting where possible.
- h. Enclosure or covering of conveyor systems.

4. In determining what constitutes reasonable precautions for a particular facility, the Department shall consider the cost of the control technique or work practice, the environmental impacts of the technique or practice, and the degree of reduction of emissions expected from a particular technique or practice.

[Rules 62-296.320(4)(c)1., 3., & 4. F.A.C.]

[electronic file name: tv-4.doc]

APPENDIX SS-1, STACK SAMPLING FACILITIES (version dated 10/07/96)

Stack Sampling Facilities Provided by the Owner of an Emissions Unit. This section describes the minimum requirements for stack sampling facilities that are necessary to sample point emissions units. Sampling facilities include sampling ports, work platforms, access to work platforms, electrical power, and sampling equipment support. Emissions units must provide these facilities at their expense. All stack sampling facilities must meet any Occupational Safety and Health Administration (OSHA) Safety and Health Standards described in 29 CFR Part 1910, Subparts D and E.

(a) Permanent Test Facilities. The owner or operator of an emissions unit for which a compliance test, other than a visible emissions test, is required on at least an annual basis, shall install and maintain permanent stack sampling facilities.

(b) Temporary Test Facilities. The owner or operator of an emissions unit that is not required to conduct a compliance test on at least an annual basis may use permanent or temporary stack sampling facilities. If the owner chooses to use temporary sampling facilities on an emissions unit, and the Department elects to test the unit, such temporary facilities shall be installed on the emissions unit within 5 days of a request by the Department and remain on the emissions unit until the test is completed.

(c) Sampling Ports.

1. All sampling ports shall have a minimum inside diameter of 3 inches.

2. The ports shall be capable of being sealed when not in use.

3. The sampling ports shall be located in the stack at least 2 stack diameters or equivalent diameters downstream and at least 0.5 stack diameter or equivalent diameter upstream from any fan, bend, constriction or other flow disturbance.

4. For emissions units for which a complete application to construct has been filed prior to December 1, 1980, at least two sampling ports, 90 degrees apart, shall be installed at each sampling location on all circular stacks that have an outside diameter of 15 feet or less. For stacks with a larger diameter, four sampling ports, each 90 degrees apart, shall be installed. For emissions units for which a complete application to construct is filed on or after December 1, 1980, at least two sampling ports, 90 degrees apart, shall be installed at each sampling location on all circular stacks that have an outside diameter of 10 feet or less. For stacks with larger diameters, four sampling ports, each 90 degrees apart, shall be installed. On horizontal circular ducts, the ports shall be located so that the probe can enter the stack vertically, horizontally or at a 45 degree angle.

5. On rectangular ducts, the cross sectional area shall be divided into the number of equal areas in accordance with EPA Method 1. Sampling ports shall be provided which allow access to each sampling point. The ports shall be located so that the probe can be inserted perpendicular to the gas flow.

(d) Work Platforms.

1. Minimum size of the working platform shall be 24 square feet in area. Platforms shall be at least 3 feet wide.

2. On circular stacks with 2 sampling ports, the platform shall extend at least 110 degrees around the stack.

3. On circular stacks with more than two sampling ports, the work platform shall extend 360 degrees around the stack.

4. All platforms shall be equipped with an adequate safety rail (ropes are not acceptable), toeboard, and hinged floor-opening cover if ladder access is used to reach the platform. The safety rail directly in line with the sampling ports shall be removable so that no obstruction exists in an area 14 inches below each sample port and 6 inches on either side of the sampling port.

(e) Access to Work Platform.

APPENDIX SS-1, STACK SAMPLING FACILITIES (version dated 10/07/96)
(continued)

1. Ladders to the work platform exceeding 15 feet in length shall have safety cages or fall arresters with a minimum of 3 compatible safety belts available for use by sampling personnel.

2. Walkways over free-fall areas shall be equipped with safety rails and toeboards.

(f) Electrical Power.

1. A minimum of two 120-volt AC, 20-amp outlets shall be provided at the sampling platform within 20 feet of each sampling port.

2. If extension cords are used to provide the electrical power, they shall be kept on the plant's property and be available immediately upon request by sampling personnel.

(g) Sampling Equipment Support.

1. A three-quarter inch eyebolt and an angle bracket shall be attached directly above each port on vertical stacks and above each row of sampling ports on the sides of horizontal ducts.

a. The bracket shall be a standard 3 inch x 3 inch x one-quarter inch equal-legs bracket which is 1 and one-half inches wide. A hole that is one-half inch in diameter shall be drilled through the exact center of the horizontal portion of the bracket. The horizontal portion of the bracket shall be located 14 inches above the centerline of the sampling port.

b. A three-eighth inch bolt which protrudes 2 inches from the stack may be substituted for the required bracket. The bolt shall be located 15 and one-half inches above the centerline of the sampling port.

c. The three-quarter inch eyebolt shall be capable of supporting a 500 pound working load. For stacks that are less than 12 feet in diameter, the eyebolt shall be located 48 inches above the horizontal portion of the angle bracket. For stacks that are greater than or equal to 12 feet in diameter, the eyebolt shall be located 60 inches above the horizontal portion of the angle bracket. If the eyebolt is more than 120 inches above the platform, a length of chain shall be attached to it to bring the free end of the chain to within safe reach from the platform.

2. A complete monorail or dualrail arrangement may be substituted for the eyebolt and bracket.

3. When the sample ports are located in the top of a horizontal duct, a frame shall be provided above the port to allow the sample probe to be secured during the test.

[Rule 62-297.310(6), F.A.C.]

TABLE 297.310-1 CALIBRATION SCHEDULE
(version dated 10/07/96)

[Note: This table is referenced in Rule 62-297.310, F.A.C.]

ITEM	MINIMUM CALIBRATION FREQUENCY	REFERENCE INSTRUMENT	TOLERANCE
Liquid in glass thermometer	Annually	ASTM Hg in glass ref. thermometer or equivalent, or thermometric points	+/-2%
Bimetallic thermometer	Quarterly	Calib. liq. in glass thermometer	5 degrees F
Thermocouple	Annually	ASTM Hg in glass ref. thermometer, NBS calibrated reference and potentiometer	5 degrees F
Barometer	Monthly	Hg barometer or NOAA station	+/-1% scale
Pitot Tube	When required or when damaged	By construction or measurements in wind tunnel D greater than 16" and standard pitot tube	See EPA Method 2, Fig. 2-2 & 2-3
Probe Nozzles	Before each test or when nicked, dented, or corroded	Micrometer	+/-0.001" mean of at least three readings Max. deviation between readings .004"
Dry Gas Meter and Orifice Meter	1. Full Scale: When received, When 5% change observed, Annually 2. One Point: Semiannually 3. Check after each test series	Spirometer or calibrated wet test or dry gas test meter	2%
		Comparison check	5%

[electronic file name: 297310-1.doc]

FIGURE 1--SUMMARY REPORT--GASEOUS AND OPACITY EXCESS EMISSION AND MONITORING SYSTEM PERFORMANCE

[Note: This form is referenced in 40 CFR 60.7, Subpart A-General Provisions]

Pollutant (*Circle One*): SO₂ NO_x TRS H₂S CO Opacity

Reporting period dates: From _____ to _____

Company: _____

Emission Limitation: _____

Address: _____

Monitor Manufacturer: _____

Model No.: _____

Date of Latest CMS Certification or Audit: _____

Process Unit(s) Description: _____

Total source operating time in reporting period ¹: _____

Emission data summary ¹	CMS performance summary ¹
1. Duration of excess emissions in reporting period due to:	1. CMS downtime in reporting period due to:
a. Startup/shutdown	a. Monitor equipment malfunctions
b. Control equipment problems	b. Non-Monitor equipment malfunctions
c. Process problems	c. Quality assurance calibration
d. Other known causes	d. Other known causes
e. Unknown causes	e. Unknown causes
2. Total duration of excess emissions	2. Total CMS Downtime
3. Total duration of excess emissions x (100) / [Total source operating time] % ²	3. [Total CMS Downtime] x (100) / [Total source operating time] % ²

¹ For opacity, record all times in minutes. For gases, record all times in hours.

² For the reporting period: If the total duration of excess emissions is 1 percent or greater of the total operating time or the total CMS downtime is 5 percent or greater of the total operating time, both the summary report form and the excess emission report described in 40 CFR 60.7(c) shall be submitted.

Note: On a separate page, describe any changes since last quarter in CMS, process or controls.

I certify that the information contained in this report is true, accurate, and complete

Name: _____

Signature: _____ Date: _____

Title: _____

DOCUMENT III.I.6

PROCEDURES FOR STARTUP AND SHUTDOWN

PROCEDURES FOR STARTUP AND SHUTDOWN UNITS 1 - 4

Procedures for startup and shutdown of Units 1 through 4 are as follows:

A. STARTUP

1. Boilers are purged to expel all combustible gases.
2. Ignitors are placed in service to establish an oil fire.
3. Once the air leaving the air preheater reaches 180° F, a centrally located fuel pulverizer is activated.
4. Fuel feeders and ignitors are rotated in and out of service to establish an even fire.
5. As soon as fuel fire is established, electrostatic precipitator rectifiers are added as needed to control PM emissions.
6. Following boiler stabilization at minimum load, the oil ignitors are removed and the electrostatic precipitator is placed in full service.
7. Excess emissions during startup are minimized by the following activities:
 - Opacity is continuously monitored;
 - Ignitor burner tips are checked on a regular basis to ensure the ignitors remain lit and have even oil flow;
 - An adequate supply of combustion air is maintained;
 - Combustion air is manually and continuously controlled to maintain even combustion; and
 - Precipitators are placed in service prior to load stabilization.

B. SHUTDOWN

1. After the decision for boiler shutdown is made, load and steam header pressure are reduced.
2. Ignitors are placed in service as permissives for fuel feed removal.
3. Steam turbine is "punched out" when all fuel feeders are out of service and load and steam header pressure are approximately 5 MW and 500 lbs, respectively.
4. Exhaust fans are used to expedite boiler cooling.

**PROCEDURES FOR STARTUP AND SHUTDOWN
UNITS 1 - 4 (continued)**

5. Excess emissions during shutdown are minimized by the following activities:
- Opacity is continuously monitored;
 - Precipitators are removed from service only if precipitator maintenance is required; and
 - Air flow, dampers, etc., are manually adjusted.

Unit 4 FGD System

A. STARTUP

Startup of the FGD system begins with starting up the makeup water system to provide water to the pump seals and the tower demister spray headers. The next system placed in service is the limestone reagent feed system, which supplies limestone slurry to the towers for sulfur dioxide (SO₂) removal. Once an oil fired is established in the boiler, the tower absorber and quencher pumps are placed in service. Prior to the burning of coal, two towers are placed in service to scrub the flue gas. The other tower(s) are placed in service as the load increases. The gypsum handling system is started when the gypsum slurry tanks level increases due the production of gypsum in the towers from the interaction of SO₂ and calcium carbonate (limestone).

B. SHUTDOWN

Shutdown of the FGD system is less complicated than startup and begins with the removal of unneeded tower(s) as load decreases. When the unit is off-line, all towers can be removed from service and the makeup water, limestone reagent feed system, and gypsum handling systems are shutdown.

DOCUMENT III.I.7

OPERATION AND MAINTENANCE PLAN

E.U.1., UNIT NO. 1—SOLID FUEL-FIRED STEAM GENERATOR
OPERATION AND MAINTENANCE FOR PARTICULATE CONTROL

A. Process System Performance Parameters:

1. Design fuel consumption rate at maximum continuous rating: 183.5 tons fuel/hour at 11,000 Btu/lb
2. Operating pressure: 2,400 psi
3. Operating temperature: 1,000 °F
4. Maximum design steam capacity: 3,000,000 lbs/hr

B. Particulate Control Equipment Data:

1. Control equipment designator: electrostatic precipitator
2. Electrostatic precipitator manufacturer: Joy Western
3. Design flow rate: 1,408,000 ACFM
4. Primary voltage: 400 volts
5. Primary current: 245 amps
6. Secondary voltage: 55 kilovolts
7. Secondary current: 1,250 milliamps
8. Design efficiency: 99.7 percent
9. Pressure drop: <1.0 inches H₂O (average)
10. Rapper frequency: 1/1.5 min. - 1/4.0 min. (average)
11. Rapper duration: impact
12. Gas temperature: 330± 55°F (average)

- C. The following observations, checks, and operations apply to this source and shall be conducted on the schedule specified:

Continuously Monitored and Recorded

Visible emissions (continuous opacity monitor [COM])

Steam pressure

Steam temperature

Steam flow

Daily Recorded and Inspected

Electrostatic Precipitator

Primary current

Secondary voltage

Secondary current

Monthly Recorded and Inspected

Fuel input (recorded)

Inspect insulator compartment heaters/blowers. Service as needed.

Observe operation of all rapper and transformer/rectifier controls. Service as needed.

- D. Records of inspections, maintenance, and performance parameters shall be retained for a minimum of 2 years and shall be made available to the Florida Department of Environmental Protection or the Environmental Protection Commission of Hillsborough County upon request.

E.U.2., UNIT NO. 2—SOLID FUEL-FIRED STEAM GENERATOR
OPERATION AND MAINTENANCE FOR PARTICULATE CONTROL

A. Process System Performance Parameters:

1. Design fuel consumption rate at maximum continuous rating: 182.1 tons fuel/hour at 11,000 Btu/lb
2. Operating pressure: 2,400 psi
3. Operating temperature: 1,000 °F
4. Maximum design steam capacity: 3,000,000 lbs/hr.

B. Particulate Control Equipment Data:

1. Control equipment designator: electrostatic precipitator
2. Electrostatic precipitator manufacturer: Joy Western
3. Design flow rate: 1,312,000 ACFM
4. Primary voltage: 400 volts
5. Primary current: 257 amps
6. Secondary voltage: 45 kilovolts
7. Secondary current: 1,600 milliamps
8. Design efficiency: 99.7 percent
9. Pressure drop: < 1.0 inches H₂O (average)
10. Rapper frequency: 1/1.5 min. - 1/4.0 min. (average)
11. Rapper duration: impact
12. Gas temperature: 330± 55°F (average)

- C. The following observations, checks, and operations apply to this source and shall be conducted on the schedule specified:

Continuously Monitored and Recorded

Visible emissions (COM)

Steam pressure

Steam temperature

Steam flow

Daily Recorded and Inspected

Electrostatic Precipitator

Primary current

Secondary voltage

Secondary current

Monthly Recorded or Inspection/Maintenance

Fuel input (recorded)

Inspect insulator compartment heaters/blowers. Service as needed.

Observe operation of all rapper and transformer/rectifier controls. Service as needed.

- D. Records of inspections, maintenance, and performance parameters shall be retained for a minimum of 2 years and shall be made available to the Florida Department of Environmental Protection or the Environmental Protection Commission of Hillsborough County upon request.

E.U.3., UNIT NO. 3—SOLID FUEL-FIRED STEAM GENERATOR
OPERATION AND MAINTENANCE FOR PARTICULATE CONTROL

A. Process System Performance Parameters:

1. Design fuel consumption rate at maximum continuous rating: 190.3 tons fuel/hour at 11,000 Btu/lb.
2. Operating pressure: 2,250 psi.
3. Operating temperature: 1,000 °F.
4. Maximum design steam capacity: 3,100,000 lbs/hr.

B. Particulate Control Equipment Data:

1. Control equipment designator: electrostatic precipitator
2. Electrostatic precipitator manufacturer: Research Cottrell
3. Design flow rate: 1,420,000 ACFM
4. Primary voltage: 400 volts
5. Primary current: 320 amps
6. Secondary voltage: 45 kilovolts
7. Secondary current: 2,000 milliamps
8. Design efficiency: 99.7 percent
9. Pressure drop: <1.0 inches H₂O (average)
10. Rapper frequency: 1/1.5 min. - 1/4.0 min. (average)
11. Rapper duration: impact
12. Gas temperature: 330± 55°F (average)

C. The following observations, checks, and operations apply to this source and shall be conducted on the schedule specified:

Continuously Monitored and Recorded

Visible emissions (COM)

Steam pressure

Steam temperature

Steam flow

Daily Recorded and Inspected

Electrostatic Precipitator

Primary current

Secondary voltage

Secondary current

Monthly Recorded or Inspection/Maintenance

Fuel input (recorded)

Inspect insulator compartment heaters/blowers. Service as needed.

Observe operation of all rapper and transformer/rectifier controls. Service as needed.

- D. Records of inspections, maintenance, and performance parameters shall be retained for a minimum of 2 years and shall be made available to the Florida Department of Environmental Protection or the Environmental Protection Commission of Hillsborough County upon request.

Subpart A—General Provisions

§ 60.1 Applicability.

(a) Except as provided in subparts B and C, the provisions of this part apply to the owner or operator of any stationary source which contains an affected facility, the construction or modification of which is commenced after the date of publication in this part of any standard (or, if earlier, the date of publication of any proposed standard) applicable to that facility.

(b) Any new or revised standard of performance promulgated pursuant to section 111(b) of the Act shall apply to the owner or operator of any stationary source which contains an affected facility, the construction or modification of which is commenced after the date of publication in this part of such new or revised standard (or, if earlier, the date of publication of any proposed standard) applicable to that facility.

(c) In addition to complying with the provisions of this part, the owner or operator of an affected facility may be required to obtain an operating permit issued to stationary sources by an authorized State air pollution control agency or by the Administrator of the U.S. Environmental Protection Agency (EPA) pursuant to Title V of the Clean Air Act (Act) as amended November 15, 1990 (42 U.S.C. 7661). For more information about obtaining an operating permit see part 70 of this chapter.

(d) *Site-specific standard for Merck & Co., Inc.'s Stonewall Plant in Elkton, Virginia.* (1) This paragraph applies only to the pharmaceutical manufacturing facility, commonly referred to as the Stonewall Plant, located at Route 340 South, in Elkton, Virginia ("site").

(2) Except for compliance with 40 CFR 60.49b(u), the site shall have the option of either complying directly with the requirements of this part, or reducing the site-wide emissions caps in accordance with the procedures set forth in a permit issued pursuant to 40 CFR 52.2454. If the site chooses the option of reducing the site-wide emissions caps in accordance with the procedures set forth in such permit, the requirements of such permit shall apply in lieu of the otherwise applicable requirements of this part.

(3) Notwithstanding the provisions of paragraph (d)(2) of this section, for any provisions of this part except for Subpart Kb, the owner/operator of the site shall comply with the applicable provisions of this part if the Administrator determines that compliance with the provisions of this part is necessary for achieving the objectives of the regulation and the Administrator notifies the site in accordance with the provisions of the permit issued pursuant to 40 CFR 52.2454.

[40 FR 53346, Nov. 17, 1975, as amended at 55 FR 51382, Dec. 13, 1990; 59 FR 12427, Mar. 16, 1994; 62 FR 52641, Oct. 8, 1997]

§ 60.2 Definitions.

The terms used in this part are defined in the Act or in this section as follows:

Act means the Clean Air Act (42 U.S.C. 7401 *et seq.*)

Administrator means the Administrator of the Environmental Protection Agency or his authorized representative.

Affected facility means, with reference to a stationary source, any apparatus to which a standard is applicable.

Alternative method means any method of sampling and analyzing for an air pollutant which is not a reference or equivalent method but which has been demonstrated to the Administrator's satisfaction to, in specific cases, produce results adequate for his determination of compliance.

Approved permit program means a State permit program approved by the Administrator as meeting the requirements of part 70 of this chapter or a Federal permit program established in this chapter pursuant to Title V of the Act (42 U.S.C. 7661).

Capital expenditure means an expenditure for a physical or operational change to an existing facility which exceeds the product of the applicable "annual asset guideline repair allowance percentage" specified in the latest edition of Internal Revenue Service (IRS) Publication 534 and the existing facility's basis, as defined by section 1012 of the Internal Revenue Code. However, the total expenditure for a physical or operational change to an existing facility must not be reduced by any "excluded additions" as defined

in IRS Publication 534, as would be done for tax purposes.

Clean coal technology demonstration project means a project using funds appropriated under the heading 'Department of Energy-Clean Coal Technology', up to a total amount of \$2,500,000,000 for commercial demonstrations of clean coal technology, or similar projects funded through appropriations for the Environmental Protection Agency.

Commenced means, with respect to the definition of *new source* in section 111(a)(2) of the Act, that an owner or operator has undertaken a continuous program of construction or modification or that an owner or operator has entered into a contractual obligation to undertake and complete, within a reasonable time, a continuous program of construction or modification.

Construction means fabrication, erection, or installation of an affected facility.

Continuous monitoring system means the total equipment, required under the emission monitoring sections in applicable subparts, used to sample and condition (if applicable), to analyze, and to provide a permanent record of emissions or process parameters.

Electric utility steam generating unit means any steam electric generating unit that is constructed for the purpose of supplying more than one-third of its potential electric output capacity and more than 25 MW electrical output to any utility power distribution system for sale. Any steam supplied to a steam distribution system for the purpose of providing steam to a steam-electric generator that would produce electrical energy for sale is also considered in determining the electrical energy output capacity of the affected facility.

Equivalent method means any method of sampling and analyzing for an air pollutant which has been demonstrated to the Administrator's satisfaction to have a consistent and quantitatively known relationship to the reference method, under specified conditions.

Excess Emissions and Monitoring Systems Performance Report is a report that must be submitted periodically by a source in order to provide data on its compliance with stated emission limits

and operating parameters, and on the performance of its monitoring systems.

Existing facility means, with reference to a stationary source, any apparatus of the type for which a standard is promulgated in this part, and the construction or modification of which was commenced before the date of proposal of that standard; or any apparatus which could be altered in such a way as to be of that type.

Isokinetic sampling means sampling in which the linear velocity of the gas entering the sampling nozzle is equal to that of the undisturbed gas stream at the sample point.

Issuance of a part 70 permit will occur, if the State is the permitting authority, in accordance with the requirements of part 70 of this chapter and the applicable, approved State permit program. When the EPA is the permitting authority, issuance of a Title V permit occurs immediately after the EPA takes final action on the final permit.

Malfunction means any sudden, infrequent, and not reasonably preventable failure of air pollution control equipment, process equipment, or a process to operate in a normal or usual manner. Failures that are caused in part by poor maintenance or careless operation are not malfunctions.

Modification means any physical change in, or change in the method of operation of, an existing facility which increases the amount of any air pollutant (to which a standard applies) emitted into the atmosphere by that facility or which results in the emission of any air pollutant (to which a standard applies) into the atmosphere not previously emitted.

Monitoring device means the total equipment, required under the monitoring of operations sections in applicable subparts, used to measure and record (if applicable) process parameters.

Nitrogen oxides means all oxides of nitrogen except nitrous oxide, as measured by test methods set forth in this part.

One-hour period means any 60-minute period commencing on the hour.

Opacity means the degree to which emissions reduce the transmission of

light and obscure the view of an object in the background.

Owner or operator means any person who owns, leases, operates, controls, or supervises an affected facility or a stationary source of which an affected facility is a part.

Part 70 permit means any permit issued, renewed, or revised pursuant to part 70 of this chapter.

Particulate matter means any finely divided solid or liquid material, other than uncombined water, as measured by the reference methods specified under each applicable subpart, or an equivalent or alternative method.

Permit program means a comprehensive State operating permit system established pursuant to title V of the Act (42 U.S.C. 7661) and regulations codified in part 70 of this chapter and applicable State regulations, or a comprehensive Federal operating permit system established pursuant to title V of the Act and regulations codified in this chapter.

Permitting authority means:

(1) The State air pollution control agency, local agency, other State agency, or other agency authorized by the Administrator to carry out a permit program under part 70 of this chapter; or

(2) The Administrator, in the case of EPA-implemented permit programs under title V of the Act (42 U.S.C. 7661).

Proportional sampling means sampling at a rate that produces a constant ratio of sampling rate to stack gas flow rate.

Reactivation of a very clean coal-fired electric utility steam generating unit means any physical change or change in the method of operation associated with the commencement of commercial operations by a coal-fired utility unit after a period of discontinued operation where the unit:

(1) Has not been in operation for the two-year period prior to the enactment of the Clean Air Act Amendments of 1990, and the emissions from such unit continue to be carried in the permitting authority's emissions inventory at the time of enactment;

(2) Was equipped prior to shut-down with a continuous system of emissions control that achieves a removal efficiency for sulfur dioxide of no less than

85 percent and a removal efficiency for particulates of no less than 98 percent;

(3) Is equipped with low-NO_x burners prior to the time of commencement of operations following reactivation; and

(4) Is otherwise in compliance with the requirements of the Clean Air Act.

Reference method means any method of sampling and analyzing for an air pollutant as specified in the applicable subpart.

Repowering means replacement of an existing coal-fired boiler with one of the following clean coal technologies: atmospheric or pressurized fluidized bed combustion, integrated gasification combined cycle, magnetohydrodynamics, direct and indirect coal-fired turbines, integrated gasification fuel cells, or as determined by the Administrator, in consultation with the Secretary of Energy, a derivative of one or more of these technologies, and any other technology capable of controlling multiple combustion emissions simultaneously with improved boiler or generation efficiency and with significantly greater waste reduction relative to the performance of technology in widespread commercial use as of November 15, 1990. Repowering shall also include any oil and/or gas-fired unit which has been awarded clean coal technology demonstration funding as of January 1, 1991, by the Department of Energy.

Run means the net period of time during which an emission sample is collected. Unless otherwise specified, a run may be either intermittent or continuous within the limits of good engineering practice.

Shutdown means the cessation of operation of an affected facility for any purpose.

Six-minute period means any one of the 10 equal parts of a one-hour period.

Standard means a standard of performance proposed or promulgated under this part.

Standard conditions means a temperature of 293 K (68F) and a pressure of 101.3 kilopascals (29.92 in Hg).

Startup means the setting in operation of an affected facility for any purpose.

State means all non-Federal authorities, including local agencies, interstate associations, and State-wide programs, that have delegated authority to implement: (1) The provisions of this part; and/or (2) the permit program established under part 70 of this chapter. The term State shall have its conventional meaning where clear from the context.

Stationary source means any building, structure, facility, or installation which emits or may emit any air pollutant.

Title V permit means any permit issued, renewed, or revised pursuant to Federal or State regulations established to implement title V of the Act (42 U.S.C. 7661). A title V permit issued by a State permitting authority is called a part 70 permit in this part.

Volatile Organic Compound means any organic compound which participates in atmospheric photochemical reactions; or which is measured by a reference method, an equivalent method, an alternative method, or which is determined by procedures specified under any subpart.

[44 FR 55173, Sept. 25, 1979, as amended at 45 FR 5617, Jan. 23, 1980; 45 FR 85415, Dec. 24, 1980; 54 FR 6662, Feb. 14, 1989; 55 FR 51382, Dec. 13, 1990; 57 FR 32338, July 21, 1992; 59 FR 12427, Mar. 16, 1994]

§ 60.3 Units and abbreviations.

Used in this part are abbreviations and symbols of units of measure. These are defined as follows:

(a) System International (SI) units of measure:

A—ampere
g—gram
Hz—hertz
J—joule
K—degree Kelvin
kg—kilogram
m—meter
m³—cubic meter
mg—milligram—10⁻³ gram
mm—millimeter—10⁻³ meter
Mg—megagram—10⁶ gram
mol—mole
N—newton
ng—nanogram—10⁻⁹ gram
nm—nanometer—10⁻⁹ meter
Pa—pascal
s—second
V—volt
W—watt
Ω—ohm

μg—microgram—10⁻⁶ gram

(b) Other units of measure:

Btu—British thermal unit
°C—degree Celsius (centigrade)
cal—calorie
cfm—cubic feet per minute
cu ft—cubic feet
dcf—dry cubic feet
dcm—dry cubic meter
dscf—dry cubic feet at standard conditions
dscm—dry cubic meter at standard conditions
eq—equivalent
°F—degree Fahrenheit
ft—feet
gal—gallon
gr—grain
g—gram
g—eq—gram equivalent
hr—hour
in—inch
k—1,000
l—liter
lpm—liter per minute
lb—pound
meq—milliequivalent
min—minute
ml—milliliter
mol. wt.—molecular weight
ppb—parts per billion
ppm—parts per million
psia—pounds per square inch absolute
psig—pounds per square inch gage
°R—degree Rankine
scf—cubic feet at standard conditions
scfh—cubic feet per hour at standard conditions
scm—cubic meter at standard conditions
sec—second
sq ft—square feet
std—at standard conditions

(c) Chemical nomenclature:

CdS—cadmium sulfide
CO—carbon monoxide
CO₂—carbon dioxide
HCl—hydrochloric acid
Hg—mercury
H₂O—water
H₂S—hydrogen sulfide
H₂SO₄—sulfuric acid
N₂—nitrogen
NO—nitric oxide
NO₂—nitrogen dioxide
NO_x—nitrogen oxides
O₂—oxygen
SO₂—sulfur dioxide
SO₃—sulfur trioxide
SO_x—sulfur oxides

(d) Miscellaneous:

A.S.T.M.—American Society for Testing and Materials

[42 FR 37000, July 19, 1977; 42 FR 38178, July 27, 1977]

Environmental Protection Agency, EPA

§ 60.4

§ 60.4 Address.

(a) All requests, reports, applications, submittals, and other communications to the Administrator pursuant to this part shall be submitted in duplicate to the appropriate Regional Office of the U.S. Environmental Protection Agency to the attention of the Director of the Division indicated in the following list of EPA Regional Offices.

Region I (Connecticut, Maine, Massachusetts, New Hampshire, Rhode Island, Vermont), Director, Air Management Division, U.S. Environmental Protection Agency, John F. Kennedy Federal Building, Boston, MA 02203.

Region II (New Jersey, New York, Puerto Rico, Virgin Islands), Director, Air and Waste Management Division, U.S. Environmental Protection Agency, Federal Office Building, 26 Federal Plaza (Foley Square), New York, NY 10278.

Region III (Delaware, District of Columbia, Maryland, Pennsylvania, Virginia, West Virginia), Director, Air and Waste Management Division, U.S. Environmental Protection Agency, Curtis Building, Sixth and Walnut Streets, Philadelphia, PA 19106.

Region IV (Alabama, Florida, Georgia, Kentucky, Mississippi, North Carolina, South Carolina, Tennessee), Director, Air and Waste Management Division, U.S. Environmental Protection Agency, 345 Courtland Street, NE., Atlanta, GA 30365.

Region V (Illinois, Indiana, Michigan, Minnesota, Ohio, Wisconsin), Director, Air and Radiation Division, U.S. Environmental Protection Agency, 77 West Jackson Boulevard, Chicago, IL 60604-3590.

Region VI (Arkansas, Louisiana, New Mexico, Oklahoma, Texas), Director, Air, Pesticides, and Toxics Division, U.S. Environmental Protection Agency, 1445 Ross Avenue, Dallas, TX 75202.

Region VII (Iowa, Kansas, Missouri, Nebraska), Director, Air and Toxics Division, U.S. Environmental Protection Agency, 726 Minnesota Avenue, Kansas City, KS 66101.

Region VIII (Colorado, Montana, North Dakota, South Dakota, Utah, Wyoming), Director, Air and Waste Management Division, U.S. Environmental Protection Agency, 1860 Lincoln Street, Denver, CO 80295.

Region IX (American Samoa, Arizona, California, Guam, Hawaii, Nevada), Director, Air and Waste Management Division, U.S. Environmental Protection Agency, 215 Fremont Street, San Francisco, CA 94105.

Region X (Alaska, Oregon, Idaho, Washington), Director, Air and Waste Management Division, U.S. Environmental Protection Agency, 1200 Sixth Avenue, Seattle, WA 98101.

(b) Section 111(c) directs the Administrator to delegate to each State, when appropriate, the authority to implement and enforce standards of performance for new stationary sources located in such State. All information required to be submitted to EPA under paragraph (a) of this section, must also be submitted to the appropriate State Agency of any State to which this authority has been delegated (provided, that each specific delegation may except sources from a certain Federal or State reporting requirement). The appropriate mailing address for those States whose delegation request has been approved is as follows:

(A) [Reserved]

(B) State of Alabama, Air Pollution Control Division, Air Pollution Control Commission, 645 S. McDonough Street, Montgomery, AL 36104.

(C) State of Alaska, Department of Environmental Conservation, Pouch O, Juneau, AK 99811.

(D) Arizona:

Arizona Department of Health Services, 1740 West Adams Street, Phoenix, AZ 85007.

Maricopa County Department of Health Services, Bureau of Air Pollution Control, 1825 East Roosevelt Street, Phoenix, AZ 85006.

Pima County Health Department, Air Quality Control District, 151 West Congress, Tucson, AZ 85701.

Pima County Air Pollution Control District, 151 West Congress Street, Tucson, AZ 85701.

(1) The following table lists the specific source and pollutant categories that have been delegated to the air pollution control agencies in Arizona. A star (*) is used to indicate each category that has been delegated.

§ 60.4

40 CFR Ch. I (7-1-99 Edition)

EC01JN92.000

EC01JN92.001

(E) State of Arkansas: Chief, Division of Air Pollution Control, Arkansas Department of Pollution Control and Ecology, 8001 National Drive, P.O. Box 9583, Little Rock, AR 72209.

(F) California:

Amador County Air Pollution Control District, P.O. Box 430, 810 Court Street, Jackson, CA 95642

Bay Area Air Pollution Control District, 939 Ellis Street, San Francisco, CA 94109.

Butte County Air Pollution Control District, P.O. Box 1229, 316 Nelson Avenue, Oroville, CA 95965

Calaveras County Air Pollution Control District, Government Center, El Dorado Road, San Andreas, CA 95249

Colusa County Air Pollution Control District, 751 Fremont Street, Colusa, CA 95952

El Dorado Air Pollution Control District, 330 Fair Lane, Placerville, CA 95667

Fresno County Air Pollution Control District, 1221 Fulton Mall, Fresno, CA 93721

Glenn County Air Pollution Control District, P.O. Box 351, 720 North Colusa Street, Willows, CA 95988

Great Basin Unified Air Pollution Control District, 157 Short Street, Suite 6, Bishop, CA 93514

Imperial County Air Pollution Control District, County Services Building, 939 West Main Street, El Centro, CA 92243

Kern County Air Pollution Control District, 1601 H Street, Suite 250, Bakersfield, CA 93301

Kings County Air Pollution Control District, 330 Campus Drive, Hanford, CA 93230

Lake County Air Pollution Control District, 255 North Forbes Street, Lakeport, CA 95453

Lassen County Air Pollution Control District, 175 Russell Avenue, Susanville, CA 96130

Madera County Air Pollution Control District, 135 W. Yosemite Avenue, Madera, CA 93637.

Mariposa County Air Pollution Control District, Box 5, Mariposa, CA 95338

Mendocino County Air Pollution Control District, County Courthouse, Ukiah, CA 95482.

Merced County Air Pollution Control District, P.O. Box 471, 240 East 15th Street, Merced, CA 95340

Modoc County Air Pollution Control District, 202 West 4th Street, Alturas, CA 96101

Monterey Bay Unified Air Pollution Control, 1164 Monroe Street, Suite 10, Salinas, CA 93906

Nevada County Air Pollution Control District, H.E.W. Complex, Nevada City, CA 95959

North Coast Unified Air Quality Management District, 5630 South Broadway, Eureka, CA 95501

Northern Sonoma County Air Pollution Control District, 134 "A" Avenue, Auburn, CA 95448

Placer County Air Pollution Control District, 11491 "B" Avenue, Auburn, CA 95603

Plumas County Air Pollution Control District, P.O. Box 480, Quincy, CA 95971

Sacramento County Air Pollution Control District, 3701 Branch Center Road, Sacramento, CA 95827.

§ 60.4

San Bernardino County Air Pollution Control District, 15579-8th, Victorville, CA 92392
San Diego County Air Pollution Control District, 9150 Chesapeake Drive, San Diego, CA 92123.
San Joaquin County Air Pollution Control District, 1601 E. Hazelton Street (P.O. Box 2009) Stockton, CA 95201.
San Luis Obispo County Air Pollution Control District, P.O. Box 637, San Luis Obispo, CA 93406
Santa Barbara County Air Pollution Control District, 315 Camino del Rimedio, Santa Barbara, CA 93110
Shasta County Air Pollution Control District, 2650 Hospital Lane, Redding, CA 96001
Sierra County Air Pollution Control District, P.O. Box 286, Downieville, CA 95936
Siskiyou County Air Pollution Control District, 525 South Foothill Drive, Yreka, CA 96097
South Coast Air Quality Management District, 9150 Flair Drive, El Monte, CA 91731
Stanislaus County Air Pollution Control District, 1030 Scenic Drive, Modesto, CA 95350

40 CFR Ch. I (7-1-99 Edition)

Sutter County Air Pollution Control District, Sutter County Office Building, 142 Garden Highway, Yuba City, CA 95991
Tehama County Air Pollution Control District, P.O. Box 38, 1760 Walnut Street, Red Bluff, CA 96080
Tulare County Air Pollution Control District, County Civic Center, Visalia, CA 93277
Tuolumne County Air Pollution Control District, 9 North Washington Street, Sonora, CA 95370
Ventura County Air Pollution Control District, 800 South Victoria Avenue, Ventura, CA 93009
Yolo-Solano Air Pollution Control District, P.O. Box 1006, 323 First Street, #5, Woodland, CA 95695

(1) The following table lists the specific source and pollutant categories that have been delegated to the air pollution control agencies in California. A star (*) is used to indicate each category that has been delegated.

Environmental Protection Agency, EPA

§ 60.4

EC01JN92.002

EC01JN92.003

(G) State of Colorado, Department of Health, Air Pollution Control Division, 4210 East 11th Avenue, Denver, CO 80220.

EDITORIAL NOTE: For a table listing Region VIII's NSPS delegation status, see paragraph (c) of this section.

(H) State of Connecticut, Bureau of Air Management, Department of Environmental Protection, State Office Building, 165 Capitol Avenue, Hartford, CT 06106.

(I) State of Delaware, Delaware Department of Natural Resources and Environmental Control, 89 Kings Highway, P.O. Box 1401, Dover, DE 19901

(J) District of Columbia, Department of Consumer and Regulatory Affairs, 5000 Overlook Avenue SW., Washington DC 20032.

(K) Bureau of Air Quality Management, Department of Environmental Regulation, Twin Towers Office Building, 2600 Blair Stone Road, Tallahassee, FL 32301.

(L) State of Georgia, Environmental Protection Division, Department of Natural Resources, 270 Washington Street, SW., Atlanta, GA 30334.

(M) Hawaii Department of Health, 1250 Punchbowl Street, Honolulu, HI 96813

Environmental Protection Agency, EPA

§ 60.4

Hawaii Department of Health (mailing address), Post Office Box 3378, Honolulu, HI 96801

(N) State of Idaho, Department of Health and Welfare, Statehouse, Boise, ID 83701.

(O) State of Illinois, Bureau of Air, Division of Air Pollution Control, Illinois Environmental Protection Agency, 2200 Churchill Road, Springfield, IL 62794-9276.

(P) State of Indiana, Indiana Department of Environmental Management, 100 North Senate Avenue, P.O. Box 6015, Indianapolis, Indiana 46206-6015.

(Q) State of Iowa: Iowa Department of Natural Resources, Environmental Protection Division, Henry A. Wallace Building, 900 East Grand, Des Moines, IO 50319.

(R) State of Kansas: Kansas Department of Health and Environment, Bureau of Air Quality and Radiation Control, Forbes Field, Topeka, KS 66620.

(S) Division of Air Pollution Control, Department for Natural Resources and Environmental Protection, U.S. 127, Frankfort, KY 40601.

(T) State of Louisiana: Program Administrator, Air Quality Division, Louisiana Department of Environmental Quality, P.O. Box 44096, Baton Rouge, LA 70804.

(U) State of Maine, Bureau of Air Quality Control, Department of Environmental Protection, State House, Station No. 17, Augusta, ME 04333.

(V) State of Maryland: Bureau of Air Quality and Noise Control, Maryland State Department of Health and Mental Hygiene, 201 West Preston Street, Baltimore, MD 21201.

(W) Commonwealth of Massachusetts, Division of Air Quality Control, Department of Environmental Protection, One Winter Street, 7th floor, Boston, MA 02108.

(X) State of Michigan, Air Quality Division, Michigan Department of Environ-

mental Quality, P.O. Box 30260, Lansing, Michigan 48909.

(Y) Minnesota Pollution Control Agency, Division of Air Quality, 520 Lafayette Road, St. Paul, MN 55155.

(Z) Bureau of Pollution Control, Department of Natural Resources, P.O. Box 10385, Jackson, MS 39209.

(AA) State of Missouri: Missouri Department of Natural Resources, Division of Environmental Quality, P.O. Box 176, Jefferson City, MO 65102.

(BB) State of Montana, Department of Health and Environmental Services, Air Quality Bureau, Cogswell Building, Helena, MT 59601.

EDITORIAL NOTE: For a table listing Region VIII's NSPS delegation status, see paragraph (c) of this section.

(CC) State of Nebraska, Nebraska Department of Environmental Control, P.O. Box 94877, State House Station, Lincoln, NE 68509.

Lincoln-Lancaster County Health Department, Division of Environmental Health, 2200 St. Marys Avenue, Lincoln, NE 68502

(DD) Nevada:

Nevada Department of Conservation and Natural Resources, Division of Environmental Protection, 201 South Fall Street, Carson City, NV 89710.

Clark County County District Health Department, Air Pollution Control Division, 625 Shadow Lane, Las Vegas, NV 89106.

Washoe County District Health Department, Division of Environmental Protection, 10 Kirman Avenue, Reno, NV 89502.

(1) The following table lists the specific source and pollutant categories that have been delegated to the air pollution control agencies in Nevada. A star (*) is used to indicate each category that has been delegated.

§ 60.4

40 CFR Ch. I (7-1-99 Edition)

EC01JN92.004

EC01JN92.005

(EE) State of New Hampshire, Air Resources Division, Department of Environmental Services, 64 North Main Street, Caller Box 2033, Concord, NH 03302-2033.

(FF) State of New Jersey: New Jersey Department of Environmental Protection, Division of Environmental Quality, Enforcement

Element, John Fitch Plaza, CN-027, Trenton, NJ 08625.

(1) The following table lists the specific source and pollutant categories that have been delegated to the states in Region II. The (X) symbol is used to indicate each category that has been delegated.

	Subpart	State			
		New Jersey	New York	Puerto Rico	Virgin Islands
D	Fossil-Fuel Fired Steam Generators for Which Construction Commenced After August 17, 1971 (Steam Generators and Lignite Fired Steam Generators).	X	X	X	X
Da	Electric Utility Steam Generating Units for Which Construction Commenced After September 18, 1978.	X		X	
Db	Industrial-Commercial-Institutional Steam Generating Units	X	X	X	X
E	Incinerators	X	X	X	X
F	Portland Cement Plants	X	X	X	X
G	Nitric Acid Plants	X	X	X	X
H	Sulfuric Acid Plants	X	X	X	X
I	Asphalt Concrete Plants	X	X	X	X
J	Petroleum Refineries—(All Categories)	X	X	X	X
K	Storage Vessels for Petroleum Liquids Constructed After June 11, 1973, and prior to May 19, 1978.	X	X	X	X
Ka	Storage Vessels for Petroleum Liquids Constructed After May 18, 1978.	X	X	X	
L	Secondary Lead Smelters	X	X	X	X
M	Secondary Brass and Bronze Ingot Production Plants	X	X	X	X
N	Iron and Steel Plants	X	X	X	X
O	Sewage Treatment Plants	X	X	X	X
P	Primary Copper Smelters	X	X	X	X
Q	Primary Zinc Smelters	X	X	X	X
R	Primary Lead Smelters	X	X	X	X

	Subpart	State			
		New Jersey	New York	Puerto Rico	Virgin Islands
S	Primary Aluminum Reduction Plants	X	X	X	X
T	Phosphate Fertilizer Industry: Wet Process Phosphoric Acid Plants.	X	X	X	X
U	Phosphate Fertilizer Industry: Superphosphoric Acid Plants	X	X	X	X
V	Phosphate Fertilizer Industry: Diammonium Phosphate Plants	X	X	X	X
W	Phosphate Fertilizer Industry: Triple Superphosphate Plants	X	X	X	X
X	Phosphate Fertilizer Industry: Granular Triple Superphosphate	X	X	X	X
Y	Coal Preparation Plants	X	X	X	X
Z	Ferrous Production Facilities	X	X	X	X
AA	Steel Plants: Electric Arc Furnaces	X	X	X	X
AAa	Electric Arc Furnaces and Argon-Oxygen Decarburization Vessels in Steel Plants.	X	X	X	
BB	Kraft Pulp Mills	X	X	X	
CC	Glass Manufacturing Plants	X	X	X	
DD	Grain Elevators	X	X	X	
EE	Surface Coating of Metal Furniture	X	X	X	
GG	Stationary Gas Turbines	X	X	X	
HH	Lime Plants	X	X	X	
KK	Lead Acid Battery Manufacturing Plants	X	X	X	
LL	Metallic Mineral Processing Plants	X	X	X	
MM	Automobile and Light-Duty Truck Surface Coating Operations ..	X	X	X	
NN	Phosphate Rock Plants	X	X	X	
PP	Ammonium Sulfate Manufacturing Plants	X	X	X	
QQ	Graphic Art Industry Publication Rotogravure Printing	X	X	X	X
RR	Pressure Sensitive Tape and Label Surface Coating Operations.	X	X	X	
SS	Industrial Surface Coating: Large Appliances	X	X	X	
TT	Metal Coil Surface Coating	X	X	X	
UU	Asphalt Processing and Asphalt Roofing Manufacture	X	X	X	
VV	Equipment Leaks of Volatile Organic Compounds in Synthetic Organic Chemical Manufacturing Industry.	X	X	X	
WW	Beverage Can Surface Coating Industry	X	X	X	
XX	Bulk Gasoline Terminals	X	X	X	
FFF	Flexible Vinyl and Urethane Coating and Printing	X	X	X	
GGG	Equipment Leaks of VOC in Petroleum Refineries	X	X	X	
HHH	Synthetic Fiber Production Facilities	X	X	X	
JJJ	Petroleum Dry Cleaners	X	X	X	
KKK	Equipment Leaks of VOC from Onshore Natural Gas Processing Plants.	X	X	X	
LLL	Onshore Natural Gas Processing Plants; SO ₂ Emissions	X	X	X	
OOO	Nonmetallic Mineral Processing Plants	X	X	X	
PPP	Wool Fiberglass Insulation Manufacturing Plants	X	X	X	

(GG) State of New Mexico: Director, New Mexico Environmental Improvement Division, Health and Environment Department, 1190 St. Francis Drive, Santa Fe, NM 87503.

(i) The City of Albuquerque and Bernalillo County: Director, The Albuquerque Environmental Health Department, The City of Albuquerque, P.O. Box 1293, Albuquerque, NM 87103.

(HH) New York: New York State Department of Environmental Conservation, 50 Wolf Road Albany, New York 12233, attention: Division of Air Resources.

(II) North Carolina Environmental Management Commission, Department of Natural and Economic Resources, Division of Environmental Management, P.O. Box 27687, Raleigh, NC 27611. Attention: Air Quality Section.

(JJ) State of North Dakota, State Department of Health and Consolidated Laboratories, Division of Environmental Engineering, State Capitol, Bismarck, ND 58505.

EDITORIAL NOTE: For a table listing Region VIII's NSPS delegation status, see paragraph (c) of this section.

(KK) State of Ohio:

(i) Medina, Summit and Portage Counties: Director, Akron Regional Air Quality Management District, 177 South Broadway, Akron, OH 44308.

(ii) Stark County: Air Pollution Control Division, 420 Market Avenue North, Canton, Ohio 44702-3335.

(iii) Butler, Clermont, Hamilton, and Warren Counties: Air Program Manager, Hamilton County Department of Environmental Services, 1632 Central Parkway, Cincinnati, Ohio 45210.

(iv) Cuyahoga County: Commissioner, Department of Public Health & Welfare, Division of Air Pollution Control, 1925 Saint Clair, Cleveland, Ohio 44114.

(v) Belmont, Carroll, Columbiana, Harrison, Jefferson, and Monroe Counties: Director, North Ohio Valley Air Authority

Environmental Protection Agency, EPA

§ 60.4

(NOVAA), 814 Adams Street, Steubenville, OH 43952.

(vi) Clark, Darke, Greene, Miami, Montgomery, and Preble Counties: Director, Regional Air Pollution Control Agency (RAPCA) 451 West Third Street, Dayton, Ohio 45402.

(vii) Lucas County and the City of Rossford (in Wood County): Director, Toledo Environmental Services Agency, 26 Main Street, Toledo, OH 43605.

(viii) Adams, Brown, Lawrence, and Scioto Counties: Engineer-Director, Air Division, Portsmouth City Health Department, 740 Second Street, Portsmouth, OH 45662.

(ix) Allen, Ashland, Auglaize, Crawford, Defiance, Erie, Fulton, Hancock, Hardin, Henry, Huron, Marion, Mercer, Ottawa, Paulding, Putnam, Richland, Sandusky, Seneca, Van Wert, Williams, Wood (except City of Rossford), and Wyandot Counties: Ohio Environmental Protection Agency, Northwest District Office, Air Pollution Control, 347 Dunbridge Rd., Bowling Green, Ohio 43402.

(x) Ashtabula, Holmes, Lorain, and Wayne Counties: Ohio Environmental Protection Agency, Northeast District Office, Air Pollution Unit, 2110 East Aurora Road, Twinsburg, OH 44087.

(xi) Athens, Coshocton, Gallia, Guernsey, Hocking, Jackson, Meigs, Morgan, Muskingum, Noble, Perry, Pike, Ross, Tuscarawas, Vinton, and Washington Counties: Ohio Environmental Protection Agency, Southeast District Office, Air Pollution Unit, 2195 Front Street, Logan, OH 43138.

(xii) Champaign, Clinton, Highland, Logan, and Shelby Counties: Ohio Environmental Protection Agency, Southwest District Office, Air Pollution Unit, 401 East Fifth Street, Dayton, Ohio 45402-2911.

(xiii) Delaware, Fairfield, Fayette, Franklin, Knox, Licking, Madison, Morrow, Pickaway, and Union Counties: Ohio Environmental Protection Agency, Central District Office, Air Pollution Control, 3232 Alum Creek Drive, Columbus, Ohio, 43207-3417.

(xiv) Geauga and Lake Counties: Lake County General Health District, Air Pollution Control, 105 Main Street, Painesville, OH 44077.

(xv) Mahoning and Trumbull Counties: Mahoning-Trumbull Air Pollution Control Agency, 9 West Front Street, Youngstown, OH 44503.

(LL) State of Oklahoma, Oklahoma State Department of Health, Air Quality Service, P.O. Box 53551, Oklahoma City, OK 73152.

(i) Oklahoma City and County: Director, Oklahoma City-County Health Department, 921 Northeast 23rd Street, Oklahoma City, OK 73105.

(ii) Tulsa County: Tulsa City-County Health Department, 4616 East Fifteenth Street, Tulsa, OK 74112.

(MM) State of Oregon, Department of Environmental Quality, Yeon Building, 522 S.W. Fifth, Portland, OR 97204.

(i)-(viii) [Reserved]

(ix) Lane Regional Air Pollution Authority, 225 North Fifth, Suite 501, Springfield, OR 97477.

(NN) (a) City of Philadelphia: Philadelphia Department of Public Health, Air Management Services, 500 S. Broad Street, Philadelphia, PA 19146.

(b) Commonwealth of Pennsylvania: Department of Environmental Resources, Post Office Box 2063, Harrisburg, PA 17120.

(c) Allegheny County: Allegheny County Health Department, Bureau of Air Pollution Control, 301 Thirty-ninth Street, Pittsburgh, PA 15201.

(OO) State of Rhode Island, Division of Air and Hazardous Materials, Department of Environmental Management, 291 Promenade Street, Providence, RI 02908.

(PP) State of South Carolina, Office of Environmental Quality Control, Department of Health and Environmental Control, 2600 Bull Street, Columbia, SC 29201.

(QQ) State of South Dakota, Department of Water and Natural Resources, Office of Air Quality and Solid Waste, Joe Foss Building, 523 East Capitol, Pierre, SD 57501-3181.

EDITORIAL NOTE: For a table listing Region VIII's NSPS delegation status, see paragraph (c) of this section.

(RR) Division of Air Pollution Control, Tennessee Department of Public Health, 256 Capitol Hill Building, Nashville, TN 37219.

Knox County Department of Air Pollution, City/County Building, Room L222, 400 Main Avenue, Knoxville, TN 37902.

Air Pollution Control Bureau, Metropolitan Health Department, 311 23rd Avenue North, Nashville, TN 37203.

(SS) State of Texas, Texas Air Control Board, 6330 Highway 290 East, Austin, TX 78723.

(TT) State of Utah, Department of Health, Bureau of Air Quality, 288 North 1460 West, P.O. Box 16690, Salt Lake City, UT 84113-0690.

EDITORIAL NOTE: For a table listing Region VIII's NSPS delegation status, see paragraph (c) of this section.

(UU) State of Vermont, Air Pollution Control Division, Agency of Natural Resources, Building 3 South, 103 South Main Street, Waterbury, VT 05676.

(VV) Commonwealth of Virginia, Virginia State Air Pollution Control Board, Room 1106, Ninth Street Office Building, Richmond, VA 23219.

(WW)(i) Washington: Washington Department of Ecology, Post Office Box 47600, Olympia, WA 98504.

(ii) Benton-Franklin Counties Clean Air Authority (BFCCAA), 650 George Washington Way, Richland, WA 99352.

§ 60.4

40 CFR Ch. I (7-1-99 Edition)

(iii) Northwest Air Pollution Authority (NWAPA), 302 Pine Street, #207, Mt. Vernon, WA 98273-3852.

(iv) Olympic Air Pollution Control Authority (OAPCA), 909 Sleater-Kinney Rd. SE - Suite I, Lacey, WA 98503.

(v) Puget Sound Air Pollution Control Authority (PSAPCA), 110 Union Street, Suite 500, Seattle, WA 98101.

(vi) Southwest Air Pollution Control Authority (SWAPCA), 1308 N.E. 134th Street, Suite D, Vancouver, WA 98685-2747.

(vii) Spokane County Air Pollution Control Authority (SCAPCA), West 1101 College Avenue, Health Building, Room 403, Spokane, WA 99201.

(viii) [Reserved]

(ix) The following is a table indicating the delegation status of the New Source Performance Standards for the State of Washington.

DELEGATION OF AUTHORITY—NEW SOURCE PERFORMANCE STANDARDS STATE OF WASHINGTON

Subpart	Description	WDOE ¹	BFCCAA ²	NWAPCA ³	OAPCA ⁴	PSAPCA ⁵	SWAPCA ⁶	SCAPCA ⁷
A	General Provisions	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93
D	Fossil-Fuel-Fired Steam Generators	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93
Da	Electric Utility Steam Generating Units	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93
Db	Industrial-Commercial-Institutional Steam Generating Units	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93
Dc	Small Industrial-Commercial-Institutional Steam Generating Units	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93
E	Incinerators	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93
Ea	Municipal Waste Combustion	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93
F	Portland Cement Plants	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93
G	Nitric Acid Plants	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93
H	Sulfuric Acid Plants	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93
I	Asphalt Concrete Plants	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93
J	Petroleum Refineries	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93
K	Petroleum Liquid Storage Vessels 6/11/73-5/19/78	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93
Ka	Petroleum Liquid Storage Vessels After 5/18/78-7/23/84	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93
Kb	Volatile Organic Liquid Storage Vessels After 7/23/84	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93
L	Secondary Lead Smelters	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93
M	Brass & Bronze Ingot Production Plants	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93
N	Iron & Steel Plants: BOPF Particulate	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93
Na	Iron & Steel Plants: BOPF, Hot Metal & Skimming Stations	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93
O	Sewage Treatment Plants	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93
P	Primary Copper Smelters	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93
Q	Primary Zinc Smelters	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93
R	Primary Lead Smelters	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93
S	Primary Aluminum Reduction Plants	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93
T	Wet Process Phosphoric Acid Plants	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93
U	Superphosphoric Acid Plants	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93
V	Diammonium Phosphate Plants	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93
W	Triple Superphosphate Plants	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93
X	Granular Triple Superphosphate Storage Facilities	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93
Y	Coal Preparation Plants	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93
Z	Ferroalloy Production Facilities	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93
AA	Steel Plant Electric Arc Furnaces 10/21/74-8/17/83	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93
AAa	Steel Plant Electric Arc Furnaces & Argon-Oxygen Decarburization Vessels after 8/7/83.	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93
BB	Kraft Pulp Mills	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93
CC	Glass Manufacturing Plants	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93
DD	Grain Elevators	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93
EE	Surface Coating of Metal Furniture	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93
GG	Stationary Gas Turbines	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93
HH	Lime Manufacturing Plants	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93
KK	Lead-Acid Battery Manufacturing Plant	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93
LL	Metallic Mineral Processing Plants	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93
MM	Automobile & Light Duty Truck Surface Coating Operations	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93
NN	Phosphate Rock Plants	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93
PP	Ammonium Sulfate Manufacture	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93
QQ	Graphic Arts Industry: Publication Rotogravure Printing	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93

Environmental Protection Agency, EPA

§ 60.4

DELEGATION OF AUTHORITY—NEW SOURCE PERFORMANCE STANDARDS STATE OF WASHINGTON—Continued

Subpart	Description	WDOE ¹	BFCCAA ²	NWAPCA ³	OAPCA ⁴	PSAPCA ⁵	SWAPCA ⁶	SCAPCA ⁷
RR	Pressure Sensitive Tape & Label Surface Coating Operations	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93
SS	Industrial Surface Coating: Large Appliances	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93
TT	Metal Coil Surface Coating	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93
UU	Asphalt Processing & Asphalt Roofing Manufacturer	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93
VV	SOCMI Equipment Leaks (VOC)	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93
WW	Beverage Can Surface Coating Operations	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93
XX	Bulk Gasoline Terminals	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93
AAA	Residential Wood Heaters	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93
BBB	Rubber Tire Manufacturing	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93
DDD	Polymer Manufacturing Industry (VOC)	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93
FFF	Flexible Vinyl and Urethane Coating and Printing	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93
GGG	Equipment Leaks of VOC in Petroleum Refineries	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93
HHH	Synthetic Fiber Production Facilities	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93
III	VOC Emissions from SOCMI Air Oxidation Unit Processes	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93
JJJ	Petroleum Dry Cleaners	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93
KKK	VOC Emissions from Onshore Natural Gas Production	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93
LLL	Onshore Natural Gas Production (SO ₂)	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93
NNN	VOC Emissions from SOCMI Distillation Facilities	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93
OOO	Nonmetallic Mineral Processing Plants	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93
PPP	Wool Fiberglass Insulation Manufacturing Plants	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93
QQQ	VOC Emissions from Petroleum Refinery Wastewater Systems	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93
SSS	Magnetic Tape Coating Facilities	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93
TTT	Surface Coating of Plastic Parts for Business Machines	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93
UUU	Calciners & Dryers in Mineral Industries	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93
VVV	Polymeric Coating of Support Substrates Facilities	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93	01/01/93

¹ WDOE—State of Washington Department of Ecology.
² BFCCAA—Benton Franklin Counties Clean Air Authority.
³ NWAPCA—Northwest Air Pollution Control Authority.
⁴ OAPCA—Olympic Air Pollution Control Authority.
⁵ PSAPCA—Puget Sound Air Pollution Control Agency.
⁶ SWAPCA—Southwest Air Pollution Control Authority.
⁷ SCAPCA—Spokane County Air Pollution Control Authority.

§ 60.4

40 CFR Ch. I (7-1-99 Edition)

Environmental Protection Agency, EPA

§ 60.4

(XX) State of West Virginia: Air Pollution Control Commission, 1558 Washington Street East, Charleston, WV 25311.

(YY) Wisconsin—Wisconsin Department of Natural Resources, P.O. Box 7921, Madison, WI 53707.

(ZZ) State of Wyoming, Department of Environmental Quality, Air Quality Division, Herschler Building, 122 West 25th Street, Cheyenne, WY 82002.

EDITORIAL NOTE: For a table listing Region VIII's NSPS delegation status, see paragraph (c) of this section.

(AAA) Territory of Guam: Guam Environmental Protection Agency, Post Office Box 2999, Agana, Guam 96910.

(I) The following table lists the specific source and pollutant categories that have been delegated to the air pollution control agency in Guam. A star (*) is used to indicate each category that has been delegated.

§ 60.4

40 CFR Ch. I (7-1-99 Edition)

EC01JN92.006

EC01JN92.007

(BBB) Commonwealth of Puerto Rico: Commonwealth of Puerto Rico Environmental Quality Board, P.O. Box 11488, Santurce, PR 00910, Attention: Air Quality Area Director (see table under § 60.4(b)(FF)(1)).

(CCC) U.S. Virgin Islands: U.S. Virgin Islands Department of Conservation and Cultural Affairs, P.O. Box 578, Charlotte Amalie, St. Thomas, VI 00801.

(c) The following is a table indicating the delegation status of New Source Performance Standards for Region VIII.

DELEGATION STATUS OF NEW SOURCE PERFORMANCE STANDARDS
[(NSPS) for Region VIII]

Subpart	CO	MT ¹	ND	SD ¹	UT ¹	WY
A—General Provisions	()	()	()	()	()	()
D—Fossil Fuel Fired Steam Generators	()	()	()	()	()	()
Da—Electric Utility Steam Generators	()	()	()	()	()	()
Dc—Industrial-Commercial—Institutional Steam Generators	()	()	()	()	()	()
Dc—Industrial-Commercial—Institutional Steam Generators	()	()	()	()	()	()
E—Incinerators	()	()	()	()	()	()
Ea—Municipal Waste Combustors	()	()	()	()	()	()
F—Portland Cement Plants	()	()	()	()	()	()
G—Nitric Acid Plants	()	()	()	()	()	()
H—Sulfuric Acid Plants	()	()	()	()	()	()
I—Asphalt Concrete Plants	()	()	()	()	()	()
J—Petroleum Refineries	()	()	()	()	()	()
K—Petroleum Storage Vessels (after 6/11/73 & prior to 5/19/78)	()	()	()	()	()	()
Ka—Petroleum Storage Vessels (after 5/18/78 & prior to 7/23/84)	()	()	()	()	()	()
Kb—Petroleum Storage Vessels (after 7/23/84)	()	()	()	()	()	()
L—Secondary Lead Smelters	()	()	()	()	()	()
M—Secondary Brass & Bronze Production Plants	()	()	()	()	()	()
N—Primary Emissions from Basic Oxygen Process Furnaces (after 6/11/73)	()	()	()	()	()	()
Na—Secondary Emissions from Basic Oxygen Process Furnaces (after 1/20/83)	()	()	()	()	()	()
O—Sewage Treatment Plants	()	()	()	()	()	()
P—Primary Copper Smelters	()	()	()	()	()	()

DELEGATION STATUS OF NEW SOURCE PERFORMANCE STANDARDS—Continued
 [(NSPS) for Region VIII]

Subpart	CO	MT ¹	ND	SD ¹	UT ¹	WY
Q—Primary Zinc Smelters	()	()	()		()	()
R—Primary Lead Smelters	()	()	()		()	()
S—Primary Aluminum Reduction Plants	()	()	()		()	()
T—Phosphate Fertilizer Industry: Wet Process Phosphoric Plants	()	()	()		()	()
U—Phosphate Fertilizer Industry: Superphosphoric Acid Plants	()	()	()		()	()
V—Phosphate Fertilizer Industry: Diammonium Phosphate Plants	()	()	()		()	()
W—Phosphate Fertilizer Industry: Triple Superphosphate Plants	()	()	()		()	()
X—Phosphate Fertilizer Industry: Granular Triple Superphosphate Storage Facilities	()	()	()		()	()
Y—Coal Preparation Plants	()	()	()	()	()	()
Z—Ferroalloy Production Facilities	()	()	()		()	()
AA—Steel Plants: Electric Arc Furnaces (10/21/74-8/17/83)	()	()	()		()	()
AAa—Steel Plants: Electric Arc Furnaces and Argon-Oxygen Decarburization Vessels (after 8/7/83)	()	()	()		()	()
BB—Kraft Pulp Mills	()	()	()		()	()
CC—Glass Manufacturing Plants	()	()	()		()	()
DD—Grain Elevator	()	()	()	()	()	()
EE—Surface Coating of Metal Furniture	()	()	()		()	()
GG—Stationary Gas Turbines	()	()	()	()	()	()
HH—Lime Manufacturing Plants	()	()	()	()	()	()
KK—Lead-Acid Battery Manufacturing Plants	()	()	()		()	()
LL—Metallic Mineral Processing Plants	()	()	()	()	()	()
MM—Automobile & Light Duty Truck Surface Coating Operations	()	()	()		()	()
NN—Phosphate Rock Plants	()	()	()		()	()
PP—Ammonium Sulfate Manufacturing	()	()	()		()	()
QQ—Graphic Arts Industry: Publication Rotogravure Printing	()	()	()	()	()	()
RR—Pressure Sensitive Tape & Label Surface Coating	()	()	()	()	()	()
SS—Industrial Surface Coating: Large Applications	()	()	()		()	()
TT—Metal Coil Surface Coating	()	()	()		()	()
UU—Asphalt Processing & Asphalt Roofing Manufacturing	()	()	()		()	()
VV—Synthetic Organic Chemicals Manufacturing: Equipment Leaks of VOC	()	()	()	()	()	()
WW—Beverage Can Surface Coating Industry	()	()	()		()	()
XX—Bulk Gasoline Terminals	()	()	()	()	()	()
AAA—Residential Wood Heaters	()	()	()	()	()	()
BBB—Rubber Tires	()	()	()		()	()
DDD—VOC Emissions from Polymer Manufacturing Industry	()	()	()		()	()
FFF—Flexible Vinyl & Urethane Coating & Printing	()	()	()		()	()
GGG—Equipment Leaks of VOC in Petroleum Refineries	()	()	()		()	()
HHH—Synthetic Fiber Production	()	()	()		()	()
III—VOC Emissions from the Synthetic Organic Chemical Manufacturing Industry Air Oxidation Unit Processes		()	()		()	()
JJJ—Petroleum Dry Cleaners	()	()	()	()	()	()
KKK—Equipment Leaks of VOC from Onshore Natural Gas Processing Plants	()	()	()		()	()
LLL—Onshore Natural Gas Processing: SO ₂ Emissions	()	()	()		()	()
NNN—VOC Emissions from the Synthetic Organic Chemical Manufacturing Industry Distillation Operations	()	()	()	()	()	()
OOO—Nonmetallic Mineral Processing Plants	()	()	()	()	()	()
PPP—Wool Fiberglass Insulation Manufacturing Plants	()	()	()		()	()
QQQ—VOC Emissions from Petroleum Refinery Wastewater Systems	()	()	()		()	()
RRR—VOC Emissions from Synthetic Organic Chemical Manufacturing Industry (SOCMI) Reactor Processes	()	()	()		()	()
SSS—Magnetic Tape Industry	()	()	()	()	()	()

DELEGATION STATUS OF NEW SOURCE PERFORMANCE STANDARDS—Continued
 ((NSPS) for Region VIII)

Subpart	CO	MT ¹	ND	SD ¹	UT ¹	WY
TTT—Plastic Parts for Business Machine Coatings	(*)	(*)	(*)		(*)	(*)
UUU—Calciners and Dryers in Mineral Industries	(*)		(*)		(*)	
VVV—Polymeric Coating of Supporting Substrates	(*)	(*)	(*)		(*)	(*)
WWW—Municipal Solid Waste Landfills			(*)		(*)	

(*) Indicates approval of state regulation.

¹ Indicates approval of New Source Performance Standards as part of the State Implementation Plan (SIP).

[40 FR 18169, Apr. 25, 1975]

EDITORIAL NOTE: For FEDERAL REGISTER citations affecting §60.4 see the List of CFR Sections Affected appearing in the Finding Aids section of this volume.

§ 60.5 Determination of construction or modification.

(a) When requested to do so by an owner or operator, the Administrator will make a determination of whether action taken or intended to be taken by such owner or operator constitutes construction (including reconstruction) or modification or the commencement thereof within the meaning of this part.

(b) The Administrator will respond to any request for a determination under paragraph (a) of this section within 30 days of receipt of such request.

[40 FR 58418, Dec. 16, 1975]

§ 60.6 Review of plans.

(a) When requested to do so by an owner or operator, the Administrator will review plans for construction or modification for the purpose of providing technical advice to the owner or operator.

(b)(1) A separate request shall be submitted for each construction or modification project.

(2) Each request shall identify the location of such project, and be accompanied by technical information describing the proposed nature, size, design, and method of operation of each affected facility involved in such project, including information on any equipment to be used for measurement or control of emissions.

(c) Neither a request for plans review nor advice furnished by the Administrator in response to such request shall (1) relieve an owner or operator of legal

responsibility for compliance with any provision of this part or of any applicable State or local requirement, or (2) prevent the Administrator from implementing or enforcing any provision of this part or taking any other action authorized by the Act.

[36 FR 24877, Dec. 23, 1971, as amended at 39 FR 9314, Mar. 8, 1974]

§ 60.7 Notification and record keeping.

(a) Any owner or operator subject to the provisions of this part shall furnish the Administrator written notification or, if acceptable to both the Administrator and the owner or operator of a source, electronic notification, as follows:

(1) A notification of the date construction (or reconstruction, as defined under §60.15) of an affected facility is commenced postmarked no later than 30 days after such date. This requirement shall not apply in the case of mass-produced facilities which are purchased in completed form.

(2) [Reserved]

(3) A notification of the actual date of initial startup of an affected facility postmarked within 15 days after such date.

(4) A notification of any physical or operational change to an existing facility which may increase the emission rate of any air pollutant to which a standard applies, unless that change is specifically exempted under an applicable subpart or in §60.14(e). This notice shall be postmarked 60 days or as soon as practicable before the change is

commenced and shall include information describing the precise nature of the change, present and proposed emission control systems, productive capacity of the facility before and after the change, and the expected completion date of the change. The Administrator may request additional relevant information subsequent to this notice.

(5) A notification of the date upon which demonstration of the continuous monitoring system performance commences in accordance with §60.13(c). Notification shall be postmarked not less than 30 days prior to such date.

(6) A notification of the anticipated date for conducting the opacity observations required by §60.11(e)(1) of this part. The notification shall also include, if appropriate, a request for the Administrator to provide a visible emissions reader during a performance test. The notification shall be postmarked not less than 30 days prior to such date.

(7) A notification that continuous opacity monitoring system data results will be used to determine compliance with the applicable opacity standard during a performance test required by §60.8 in lieu of Method 9 observation data as allowed by §60.11(e)(5) of this part. This notification shall be postmarked not less than 30 days prior to the date of the performance test.

(b) Any owner or operator subject to the provisions of this part shall maintain records of the occurrence and duration of any startup, shutdown, or malfunction in the operation of an affected facility; any malfunction of the air pollution control equipment; or any periods during which a continuous monitoring system or monitoring device is inoperative.

(c) Each owner or operator required to install a continuous monitoring device shall submit excess emissions and monitoring systems performance report (excess emissions are defined in applicable subparts) and/or summary report form (see paragraph (d) of this section) to the Administrator semi-annually, except when: more frequent reporting is specifically required by an applicable subpart; or the Administrator, on a case-by-case basis, determines that more frequent reporting is necessary to accurately assess the

compliance status of the source. All reports shall be postmarked by the 30th day following the end of each six-month period. Written reports of excess emissions shall include the following information:

(1) The magnitude of excess emissions computed in accordance with §60.13(h), any conversion factor(s) used, and the date and time of commencement and completion of each time period of excess emissions. The process operating time during the reporting period.

(2) Specific identification of each period of excess emissions that occurs during startups, shutdowns, and malfunctions of the affected facility. The nature and cause of any malfunction (if known), the corrective action taken or preventative measures adopted.

(3) The date and time identifying each period during which the continuous monitoring system was inoperative except for zero and span checks and the nature of the system repairs or adjustments.

(4) When no excess emissions have occurred or the continuous monitoring system(s) have not been inoperative, repaired, or adjusted, such information shall be stated in the report.

(d) The summary report form shall contain the information and be in the format shown in figure 1 unless otherwise specified by the Administrator. One summary report form shall be submitted for each pollutant monitored at each affected facility.

(1) If the total duration of excess emissions for the reporting period is less than 1 percent of the total operating time for the reporting period and CMS downtime for the reporting period is less than 5 percent of the total operating time for the reporting period, only the summary report form shall be submitted and the excess emission report described in §60.7(c) need not be submitted unless requested by the Administrator.

(2) If the total duration of excess emissions for the reporting period is 1 percent or greater of the total operating time for the reporting period or the total CMS downtime for the reporting period is 5 percent or greater of the total operating time for the reporting period, the summary report form and

Environmental Protection Agency, EPA

§ 60.7

the excess emission report described in § 60.7(c) shall both be submitted.

Reporting period dates: From _____ to _____

FIGURE 1—SUMMARY REPORT—GASEOUS AND OPACITY EXCESS EMISSION AND MONITORING SYSTEM PERFORMANCE

Company: _____
 Emission Limitation _____
 Address: _____
 Monitor Manufacturer and Model No. _____
 Date of Latest CMS Certification or Audit _____
 Process Unit(s) Description: _____
 Total source operating time in reporting period¹ _____

Pollutant (Circle One—SO₂/NO_x/TRS/H₂S/CO/Opacity)

Emission data summary ¹	CMS performance summary ¹
1. Duration of excess emissions in reporting period due to: a. Startup/shutdown b. Control equipment problems c. Process problems d. Other known causes e. Unknown causes	1. CMS downtime in reporting period due to: a. Monitor equipment malfunctions b. Non-Monitor equipment malfunctions c. Quality assurance calibration d. Other known causes e. Unknown causes
2. Total duration of excess emission	2. Total CMS Downtime
3. Total duration of excess emissions × (100) [Total source operating time]. % ²	3. [Total CMS Downtime] × (100) [Total source operating time]. % ²

¹ For opacity, record all times in minutes. For gases, record all times in hours.
² For the reporting period: If the total duration of excess emissions is 1 percent or greater of the total operating time or the total CMS downtime is 5 percent or greater of the total operating time, both the summary report form and the excess emission report described in § 60.7(c) shall be submitted.

On a separate page, describe any changes since last quarter in CMS, process or controls. I certify that the information contained in this report is true, accurate, and complete.

this subpart and the applicable standard; and

Name _____
 Signature _____
 Title _____
 Date _____

(iii) The Administrator does not object to a reduced frequency of reporting for the affected facility, as provided in paragraph (e)(2) of this section.

(e)(1) Notwithstanding the frequency of reporting requirements specified in paragraph (c) of this section, an owner or operator who is required by an applicable subpart to submit excess emissions and monitoring systems performance reports (and summary reports) on a quarterly (or more frequent) basis may reduce the frequency of reporting for that standard to semiannual if the following conditions are met:

(2) The frequency of reporting of excess emissions and monitoring systems performance (and summary) reports may be reduced only after the owner or operator notifies the Administrator in writing of his or her intention to make such a change and the Administrator does not object to the intended change. In deciding whether to approve a reduced frequency of reporting, the Administrator may review information concerning the source's entire previous performance history during the required recordkeeping period prior to the intended change, including performance test results, monitoring data, and evaluations of an owner or operator's conformance with operation and maintenance requirements. Such information may be used by the Administrator to make a judgment about the source's potential for noncompliance in the future. If the Administrator disapproves the owner or operator's request to reduce the frequency of reporting, the Administrator will notify the owner or operator in writing within 45 days after receiving notice of the

(i) For 1 full year (e.g., 4 quarterly or 12 monthly reporting periods) the affected facility's excess emissions and monitoring systems reports submitted to comply with a standard under this part continually demonstrate that the facility is in compliance with the applicable standard;

(ii) The owner or operator continues to comply with all recordkeeping and monitoring requirements specified in

owner or operator's intention. The notification from the Administrator to the owner or operator will specify the grounds on which the disapproval is based. In the absence of a notice of disapproval within 45 days, approval is automatically granted.

(3) As soon as monitoring data indicate that the affected facility is not in compliance with any emission limitation or operating parameter specified in the applicable standard, the frequency of reporting shall revert to the frequency specified in the applicable standard, and the owner or operator shall submit an excess emissions and monitoring systems performance report (and summary report, if required) at the next appropriate reporting period following the noncomplying event. After demonstrating compliance with the applicable standard for another full year, the owner or operator may again request approval from the Administrator to reduce the frequency of reporting for that standard as provided for in paragraphs (e)(1) and (e)(2) of this section.

(f) Any owner or operator subject to the provisions of this part shall maintain a file of all measurements, including continuous monitoring system, monitoring device, and performance testing measurements; all continuous monitoring system performance evaluations; all continuous monitoring system or monitoring device calibration checks; adjustments and maintenance performed on these systems or devices; and all other information required by this part recorded in a permanent form suitable for inspection. The file shall be retained for at least two years following the date of such measurements, maintenance, reports, and records, except as follows:

(1) This paragraph applies to owners or operators required to install a continuous emissions monitoring system (CEMS) where the CEMS installed is automated, and where the calculated data averages do not exclude periods of CEMS breakdown or malfunction. An automated CEMS records and reduces the measured data to the form of the pollutant emission standard through the use of a computerized data acquisition system. In lieu of maintaining a file of all CEMS subhourly measure-

ments as required under paragraph (f) of this section, the owner or operator shall retain the most recent consecutive three averaging periods of subhourly measurements and a file that contains a hard copy of the data acquisition system algorithm used to reduce the measured data into the reportable form of the standard.

(2) This paragraph applies to owners or operators required to install a CEMS where the measured data is manually reduced to obtain the reportable form of the standard, and where the calculated data averages do not exclude periods of CEMS breakdown or malfunction. In lieu of maintaining a file of all CEMS subhourly measurements as required under paragraph (f) of this section, the owner or operator shall retain all subhourly measurements for the most recent reporting period. The subhourly measurements shall be retained for 120 days from the date of the most recent summary or excess emission report submitted to the Administrator.

(3) The Administrator or delegated authority, upon notification to the source, may require the owner or operator to maintain all measurements as required by paragraph (f) of this section, if the Administrator or the delegated authority determines these records are required to more accurately assess the compliance status of the affected source.

(g) If notification substantially similar to that in paragraph (a) of this section is required by any other State or local agency, sending the Administrator a copy of that notification will satisfy the requirements of paragraph (a) of this section.

(h) Individual subparts of this part may include specific provisions which clarify or make inapplicable the provisions set forth in this section.

[36 FR 24877, Dec. 28, 1971, as amended at 40 FR 46254, Oct. 6, 1975; 40 FR 58418, Dec. 16, 1975; 45 FR 5617, Jan. 23, 1980; 48 FR 48335, Oct. 18, 1983; 50 FR 53113, Dec. 27, 1985; 52 FR 9781, Mar. 26, 1987; 55 FR 51382, Dec. 13, 1990; 59 FR 12428, Mar. 16, 1994; 59 FR 47265, Sep. 15, 1994; 64 FR 7463, Feb. 12, 1999]

§ 60.8 Performance tests.

(a) Within 60 days after achieving the maximum production rate at which the

affected facility will be operated, but not later than 180 days after initial startup of such facility and at such other times as may be required by the Administrator under section 114 of the Act, the owner or operator of such facility shall conduct performance test(s) and furnish the Administrator a written report of the results of such performance test(s).

(b) Performance tests shall be conducted and data reduced in accordance with the test methods and procedures contained in each applicable subpart unless the Administrator (1) specifies or approves, in specific cases, the use of a reference method with minor changes in methodology, (2) approves the use of an equivalent method, (3) approves the use of an alternative method the results of which he has determined to be adequate for indicating whether a specific source is in compliance, (4) waives the requirement for performance tests because the owner or operator of a source has demonstrated by other means to the Administrator's satisfaction that the affected facility is in compliance with the standard, or (5) approves shorter sampling times and smaller sample volumes when necessitated by process variables or other factors. Nothing in this paragraph shall be construed to abrogate the Administrator's authority to require testing under section 114 of the Act.

(c) Performance tests shall be conducted under such conditions as the Administrator shall specify to the plant operator based on representative performance of the affected facility. The owner or operator shall make available to the Administrator such records as may be necessary to determine the conditions of the performance tests. Operations during periods of startup, shutdown, and malfunction shall not constitute representative conditions for the purpose of a performance test nor shall emissions in excess of the level of the applicable emission limit during periods of startup, shutdown, and malfunction be considered a violation of the applicable emission limit unless otherwise specified in the applicable standard.

(d) The owner or operator of an affected facility shall provide the Administrator at least 30 days prior notice of

any performance test, except as specified under other subparts, to afford the Administrator the opportunity to have an observer present. If after 30 days notice for an initially scheduled performance test, there is a delay (due to operational problems, etc.) in conducting the scheduled performance test, the owner or operator of an affected facility shall notify the Administrator (or delegated State or local agency) as soon as possible of any delay in the original test date, either by providing at least 7 days prior notice of the rescheduled date of the performance test, or by arranging a rescheduled date with the Administrator (or delegated State or local agency) by mutual agreement.

(e) The owner or operator of an affected facility shall provide, or cause to be provided, performance testing facilities as follows:

(1) Sampling ports adequate for test methods applicable to such facility. This includes (i) constructing the air pollution control system such that volumetric flow rates and pollutant emission rates can be accurately determined by applicable test methods and procedures and (ii) providing a stack or duct free of cyclonic flow during performance tests, as demonstrated by applicable test methods and procedures.

(2) Safe sampling platform(s).

(3) Safe access to sampling platform(s).

(4) Utilities for sampling and testing equipment.

(f) Unless otherwise specified in the applicable subpart, each performance test shall consist of three separate runs using the applicable test method. Each run shall be conducted for the time and under the conditions specified in the applicable standard. For the purpose of determining compliance with an applicable standard, the arithmetic means of results of the three runs shall apply. In the event that a sample is accidentally lost or conditions occur in which one of the three runs must be discontinued because of forced shutdown, failure of an irreplaceable portion of the sample train, extreme meteorological conditions, or other circumstances, beyond the owner or operator's control, compliance may, upon the Administrator's approval, be determined using the

§ 60.9

40 CFR Ch. I (7-1-99 Edition)

arithmetic mean of the results of the two other runs.

[36 FR 24877, Dec. 23, 1971, as amended at 39 FR 9314, Mar. 8, 1974; 42 FR 57126, Nov. 1, 1977; 44 FR 33612, June 11, 1979; 54 FR 6662, Feb. 14, 1989; 54 FR 21344, May 17, 1989; 64 FR 7463, Feb. 12, 1999]

§ 60.9 Availability of information.

The availability to the public of information provided to, or otherwise obtained by, the Administrator under this part shall be governed by part 2 of this chapter. (Information submitted voluntarily to the Administrator for the purposes of §§ 60.5 and 60.6 is governed by §§ 2.201 through 2.213 of this chapter and not by § 2.301 of this chapter.)

§ 60.10 State authority.

The provisions of this part shall not be construed in any manner to preclude any State or political subdivision thereof from:

(a) Adopting and enforcing any emission standard or limitation applicable to an affected facility, provided that such emission standard or limitation is not less stringent than the standard applicable to such facility.

(b) Requiring the owner or operator of an affected facility to obtain permits, licenses, or approvals prior to initiating construction, modification, or operation of such facility.

§ 60.11 Compliance with standards and maintenance requirements.

(a) Compliance with standards in this part, other than opacity standards, shall be determined in accordance with performance tests established by § 60.8, unless otherwise specified in the applicable standard.

(b) Compliance with opacity standards in this part shall be determined by conducting observations in accordance with Reference Method 9 in appendix A of this part, any alternative method that is approved by the Administrator, or as provided in paragraph (e)(5) of this section. For purposes of determining initial compliance, the minimum total time of observations shall be 3 hours (30 6-minute averages) for the performance test or other set of observations (meaning those fugitive-

type emission sources subject only to an opacity standard).

(c) The opacity standards set forth in this part shall apply at all times except during periods of startup, shutdown, malfunction, and as otherwise provided in the applicable standard.

(d) At all times, including periods of startup, shutdown, and malfunction, owners and operators shall, to the extent practicable, maintain and operate any affected facility including associated air pollution control equipment in a manner consistent with good air pollution control practice for minimizing emissions. Determination of whether acceptable operating and maintenance procedures are being used will be based on information available to the Administrator which may include, but is not limited to, monitoring results, opacity observations, review of operating and maintenance procedures, and inspection of the source.

(e)(1) For the purpose of demonstrating initial compliance, opacity observations shall be conducted concurrently with the initial performance test required in § 60.8 unless one of the following conditions apply. If no performance test under § 60.8 is required, then opacity observations shall be conducted within 60 days after achieving the maximum production rate at which the affected facility will be operated but no later than 180 days after initial startup of the facility. If visibility or other conditions prevent the opacity observations from being conducted concurrently with the initial performance test required under § 60.8, the source owner or operator shall reschedule the opacity observations as soon after the initial performance test as possible, but not later than 30 days thereafter, and shall advise the Administrator of the rescheduled date. In these cases, the 30-day prior notification to the Administrator required in § 60.7(a)(6) shall be waived. The rescheduled opacity observations shall be conducted (to the extent possible) under the same operating conditions that existed during the initial performance test conducted under § 60.8. The visible emissions observer shall determine whether visibility or other conditions prevent the opacity observations from

being made concurrently with the initial performance test in accordance with procedures contained in Reference Method 9 of appendix B of this part. Opacity readings of portions of plumes which contain condensed, uncombined water vapor shall not be used for purposes of determining compliance with opacity standards. The owner or operator of an affected facility shall make available, upon request by the Administrator, such records as may be necessary to determine the conditions under which the visual observations were made and shall provide evidence indicating proof of current visible observer emission certification. Except as provided in paragraph (e)(5) of this section, the results of continuous monitoring by transmissometer which indicate that the opacity at the time visual observations were made was not in excess of the standard are probative but not conclusive evidence of the actual opacity of an emission, provided that the source shall meet the burden of proving that the instrument used meets (at the time of the alleged violation) Performance Specification 1 in appendix B of this part, has been properly maintained and (at the time of the alleged violation) that the resulting data have not been altered in any way.

(2) Except as provided in paragraph (e)(3) of this section, the owner or operator of an affected facility to which an opacity standard in this part applies shall conduct opacity observations in accordance with paragraph (b) of this section, shall record the opacity of emissions, and shall report to the Administrator the opacity results along with the results of the initial performance test required under §60.8. The inability of an owner or operator to secure a visible emissions observer shall not be considered a reason for not conducting the opacity observations concurrent with the initial performance test.

(3) The owner or operator of an affected facility to which an opacity standard in this part applies may request the Administrator to determine and to record the opacity of emissions from the affected facility during the initial performance test and at such times as may be required. The owner or operator of the affected facility shall

report the opacity results. Any request to the Administrator to determine and to record the opacity of emissions from an affected facility shall be included in the notification required in §60.7(a)(6). If, for some reason, the Administrator cannot determine and record the opacity of emissions from the affected facility during the performance test, then the provisions of paragraph (e)(1) of this section shall apply.

(4) An owner or operator of an affected facility using a continuous opacity monitor (transmissometer) shall record the monitoring data produced during the initial performance test required by §60.8 and shall furnish the Administrator a written report of the monitoring results along with Method 9 and §60.8 performance test results.

(5) An owner or operator of an affected facility subject to an opacity standard may submit, for compliance purposes, continuous opacity monitoring system (COMS) data results produced during any performance test required under §60.8 in lieu of Method 9 observation data. If an owner or operator elects to submit COMS data for compliance with the opacity standard, he shall notify the Administrator of that decision, in writing, at least 30 days before any performance test required under §60.8 is conducted. Once the owner or operator of an affected facility has notified the Administrator to that effect, the COMS data results will be used to determine opacity compliance during subsequent tests required under §60.8 until the owner or operator notifies the Administrator, in writing, to the contrary. For the purpose of determining compliance with the opacity standard during a performance test required under §60.8 using COMS data, the minimum total time of COMS data collection shall be averages of all 6-minute continuous periods within the duration of the mass emission performance test. Results of the COMS opacity determinations shall be submitted along with the results of the performance test required under §60.8. The owner or operator of an affected facility using a COMS for compliance purposes is responsible for demonstrating that the COMS meets the requirements specified in §60.13(c) of this part, that

the COMS has been properly maintained and operated, and that the resulting data have not been altered in any way. If COMS data results are submitted for compliance with the opacity standard for a period of time during which Method 9 data indicates non-compliance, the Method 9 data will be used to determine opacity compliance.

(6) Upon receipt from an owner or operator of the written reports of the results of the performance tests required by §60.8, the opacity observation results and observer certification required by §60.11(e)(1), and the COMS results, if applicable, the Administrator will make a finding concerning compliance with opacity and other applicable standards. If COMS data results are used to comply with an opacity standard, only those results are required to be submitted along with the performance test results required by §60.8. If the Administrator finds that an affected facility is in compliance with all applicable standards for which performance tests are conducted in accordance with §60.8 of this part but during the time such performance tests are being conducted fails to meet any applicable opacity standard, he shall notify the owner or operator and advise him that he may petition the Administrator within 10 days of receipt of notification to make appropriate adjustment to the opacity standard for the affected facility.

(7) The Administrator will grant such a petition upon a demonstration by the owner or operator that the affected facility and associated air pollution control equipment was operated and maintained in a manner to minimize the opacity of emissions during the performance tests; that the performance tests were performed under the conditions established by the Administrator; and that the affected facility and associated air pollution control equipment were incapable of being adjusted or operated to meet the applicable opacity standard.

(8) The Administrator will establish an opacity standard for the affected facility meeting the above requirements at a level at which the source will be able, as indicated by the performance and opacity tests, to meet the opacity standard at all times during which the

source is meeting the mass or concentration emission standard. The Administrator will promulgate the new opacity standard in the FEDERAL REGISTER.

(f) Special provisions set forth under an applicable subpart shall supersede any conflicting provisions in paragraphs (a) through (e) of this section.

(g) For the purpose of submitting compliance certifications or establishing whether or not a person has violated or is in violation of any standard in this part, nothing in this part shall preclude the use, including the exclusive use, of any credible evidence or information, relevant to whether a source would have been in compliance with applicable requirements if the appropriate performance or compliance test or procedure had been performed.

[38 FR 28565, Oct. 15, 1973, as amended at 39 FR 39873, Nov. 12, 1974; 43 FR 8800, Mar. 3, 1978; 45 FR 23379, Apr. 4, 1980; 48 FR 48335, Oct. 18, 1983; 50 FR 53113, Dec. 27, 1985; 51 FR 1790, Jan. 15, 1986; 52 FR 9781, Mar. 26, 1987; 62 FR 8328, Feb. 24, 1997]

§60.12 Circumvention.

No owner or operator subject to the provisions of this part shall build, erect, install, or use any article, machine, equipment or process, the use of which conceals an emission which would otherwise constitute a violation of an applicable standard. Such concealment includes, but is not limited to, the use of gaseous diluents to achieve compliance with an opacity standard or with a standard which is based on the concentration of a pollutant in the gases discharged to the atmosphere.

[39 FR 9314, Mar. 8, 1974]

§60.13 Monitoring requirements.

(a) For the purposes of this section, all continuous monitoring systems required under applicable subparts shall be subject to the provisions of this section upon promulgation of performance specifications for continuous monitoring systems under appendix B to this part and, if the continuous monitoring system is used to demonstrate compliance with emission limits on a continuous basis, appendix F to this part, unless otherwise specified in an

applicable subpart or by the Administrator. Appendix F is applicable December 4, 1987.

(b) All continuous monitoring systems and monitoring devices shall be installed and operational prior to conducting performance tests under §60.8. Verification of operational status shall, as a minimum, include completion of the manufacturer's written requirements or recommendations for installation, operation, and calibration of the device.

(c) If the owner or operator of an affected facility elects to submit continuous opacity monitoring system (COMS) data for compliance with the opacity standard as provided under §60.11(e)(5), he shall conduct a performance evaluation of the COMS as specified in Performance Specification 1, appendix B, of this part before the performance test required under §60.8 is conducted. Otherwise, the owner or operator of an affected facility shall conduct a performance evaluation of the COMS or continuous emission monitoring system (CEMS) during any performance test required under §60.8 or within 30 days thereafter in accordance with the applicable performance specification in appendix B of this part. The owner or operator of an affected facility shall conduct COMS or CEMS performance evaluations at such other times as may be required by the Administrator under section 114 of the Act.

(1) The owner or operator of an affected facility using a COMS to determine opacity compliance during any performance test required under §60.8 and as described in §60.11(e)(5) shall furnish the Administrator two or, upon request, more copies of a written report of the results of the COMS performance evaluation described in paragraph (c) of this section at least 10 days before the performance test required under §60.8 is conducted.

(2) Except as provided in paragraph (c)(1) of this section, the owner or operator of an affected facility shall furnish the Administrator within 60 days of completion two or, upon request, more copies of a written report of the results of the performance evaluation.

(d)(1) Owners and operators of all continuous emission monitoring sys-

tems installed in accordance with the provisions of this part shall check the zero (or low-level value between 0 and 20 percent of span value) and span (50 to 100 percent of span value) calibration drifts at least once daily in accordance with a written procedure. The zero and span shall, as a minimum, be adjusted whenever the 24-hour zero drift or 24-hour span drift exceeds two times the limits of the applicable performance specifications in appendix B. The system must allow the amount of excess zero and span drift measured at the 24-hour interval checks to be recorded and quantified, whenever specified. For continuous monitoring systems measuring opacity of emissions, the optical surfaces exposed to the effluent gases shall be cleaned prior to performing the zero and span drift adjustments except that for systems using automatic zero adjustments. The optical surfaces shall be cleaned when the cumulative automatic zero compensation exceeds 4 percent opacity.

(2) Unless otherwise approved by the Administrator, the following procedures shall be followed for continuous monitoring systems measuring opacity of emissions. Minimum procedures shall include a method for producing a simulated zero opacity condition and an upscale (span) opacity condition using a certified neutral density filter or other related technique to produce a known obscuration of the light beam. Such procedures shall provide a system check of the analyzer internal optical surfaces and all electronic circuitry including the lamp and photodetector assembly.

(e) Except for system breakdowns, repairs, calibration checks, and zero and span adjustments required under paragraph (d) of this section, all continuous monitoring systems shall be in continuous operation and shall meet minimum frequency of operation requirements as follows:

(1) All continuous monitoring systems referenced by paragraph (c) of this section for measuring opacity of emissions shall complete a minimum of one cycle of sampling and analyzing for each successive 10-second period and one cycle of data recording for each successive 6-minute period.

(2) All continuous monitoring systems referenced by paragraph (c) of this section for measuring emissions, except opacity, shall complete a minimum of one cycle of operation (sampling, analyzing, and data recording) for each successive 15-minute period.

(f) All continuous monitoring systems or monitoring devices shall be installed such that representative measurements of emissions or process parameters from the affected facility are obtained. Additional procedures for location of continuous monitoring systems contained in the applicable Performance Specifications of appendix B of this part shall be used.

(g) When the effluents from a single affected facility or two or more affected facilities subject to the same emission standards are combined before being released to the atmosphere, the owner or operator may install applicable continuous monitoring systems on each effluent or on the combined effluent. When the affected facilities are not subject to the same emission standards, separate continuous monitoring systems shall be installed on each effluent. When the effluent from one affected facility is released to the atmosphere through more than one point, the owner or operator shall install an applicable continuous monitoring system on each separate effluent unless the installation of fewer systems is approved by the Administrator. When more than one continuous monitoring system is used to measure the emissions from one affected facility (e.g., multiple breechings, multiple outlets), the owner or operator shall report the results as required from each continuous monitoring system.

(h) Owners or operators of all continuous monitoring systems for measurement of opacity shall reduce all data to 6-minute averages and for continuous monitoring systems other than opacity to 1-hour averages for time periods as defined in §60.2. Six-minute opacity averages shall be calculated from 36 or more data points equally spaced over each 6-minute period. For continuous monitoring systems other than opacity, 1-hour averages shall be computed from four or more data points equally spaced over each 1-hour period. Data recorded during periods of continuous

system breakdown, repair, calibration checks, and zero and span adjustments shall not be included in the data averages computed under this paragraph. For owners and operators complying with the requirements in §60.7(f) (1) or (2), data averages must include any data recorded during periods of monitor breakdown or malfunction. An arithmetic or integrated average of all data may be used. The data may be recorded in reduced or nonreduced form (e.g., ppm pollutant and percent O₂ or ng/J of pollutant). All excess emissions shall be converted into units of the standard using the applicable conversion procedures specified in subparts. After conversion into units of the standard, the data may be rounded to the same number of significant digits as used in the applicable subparts to specify the emission limit (e.g., rounded to the nearest 1 percent opacity).

(i) After receipt and consideration of written application, the Administrator may approve alternatives to any monitoring procedures or requirements of this part including, but not limited to the following:

(1) Alternative monitoring requirements when installation of a continuous monitoring system or monitoring device specified by this part would not provide accurate measurements due to liquid water or other interferences caused by substances with the effluent gases.

(2) Alternative monitoring requirements when the affected facility is infrequently operated.

(3) Alternative monitoring requirements to accommodate continuous monitoring systems that require additional measurements to correct for stack moisture conditions.

(4) Alternative locations for installing continuous monitoring systems or monitoring devices when the owner or operator can demonstrate that installation at alternate locations will enable accurate and representative measurements.

(5) Alternative methods of converting pollutant concentration measurements to units of the standards.

(6) Alternative procedures for performing daily checks of zero and span drift that do not involve use of span gases or test cells.

(7) Alternatives to the A.S.T.M. test methods or sampling procedures specified by any subpart.

(8) Alternative continuous monitoring systems that do not meet the design or performance requirements in Performance Specification 1, appendix B, but adequately demonstrate a definite and consistent relationship between its measurements and the measurements of opacity by a system complying with the requirements in Performance Specification 1. The Administrator may require that such demonstration be performed for each affected facility.

(9) Alternative monitoring requirements when the effluent from a single affected facility or the combined effluent from two or more affected facilities are released to the atmosphere through more than one point.

(j) An alternative to the relative accuracy test specified in Performance Specification 2 of appendix B may be requested as follows:

(1) An alternative to the reference method tests for determining relative accuracy is available for sources with emission rates demonstrated to be less than 50 percent of the applicable standard. A source owner or operator may petition the Administrator to waive the relative accuracy test in section 7 of Performance Specification 2 and substitute the procedures in section 10 if the results of a performance test conducted according to the requirements in § 60.8 of this subpart or other tests performed following the criteria in § 60.8 demonstrate that the emission rate of the pollutant of interest in the units of the applicable standard is less than 50 percent of the applicable standard. For sources subject to standards expressed as control efficiency levels, a source owner or operator may petition the Administrator to waive the relative accuracy test and substitute the procedures in section 10 of Performance Specification 2 if the control device exhaust emission rate is less than 50 percent of the level needed to meet the control efficiency requirement. The alternative procedures do not apply if the continuous emission monitoring system is used to determine compliance continuously with the applicable standard. The petition to waive the rel-

ative accuracy test shall include a detailed description of the procedures to be applied. Included shall be location and procedure for conducting the alternative, the concentration or response levels of the alternative RA materials, and the other equipment checks included in the alternative procedure. The Administrator will review the petition for completeness and applicability. The determination to grant a waiver will depend on the intended use of the CEMS data (e.g., data collection purposes other than NSPS) and may require specifications more stringent than in Performance Specification 2 (e.g., the applicable emission limit is more stringent than NSPS).

(2) The waiver of a CEMS relative accuracy test will be reviewed and may be rescinded at such time following successful completion of the alternative RA procedure that the CEMS data indicate the source emissions approaching the level of the applicable standard. The criterion for reviewing the waiver is the collection of CEMS data showing that emissions have exceeded 70 percent of the applicable standard for seven, consecutive, averaging periods as specified by the applicable regulation(s). For sources subject to standards expressed as control efficiency levels, the criterion for reviewing the waiver is the collection of CEMS data showing that exhaust emissions have exceeded 70 percent of the level needed to meet the control efficiency requirement for seven, consecutive, averaging periods as specified by the applicable regulation(s) [e.g., § 60.45(g) (2) and (3), § 60.73(e), and § 60.84(e)]. It is the responsibility of the source operator to maintain records and determine the level of emissions relative to the criterion on the waiver of relative accuracy testing. If this criterion is exceeded, the owner or operator must notify the Administrator within 10 days of such occurrence and include a description of the nature and cause of the increasing emissions. The Administrator will review the notification and may rescind the waiver and require the owner or operator to conduct a relative accuracy test of the

CEMS as specified in section 7 of Performance Specification 2.

[40 FR 46255, Oct. 6, 1975; 40 FR 59205, Dec. 22, 1975, as amended at 41 FR 35185, Aug. 20, 1976; 48 FR 13326, Mar. 30, 1983; 48 FR 23610, May 25, 1983; 48 FR 32986, July 20, 1983; 52 FR 9782, Mar. 26, 1987; 52 FR 17555, May 11, 1987; 52 FR 21007, June 4, 1987; 64 FR 7463, Feb. 12, 1999]

§ 60.14 Modification.

(a) Except as provided under paragraphs (e) and (f) of this section, any physical or operational change to an existing facility which results in an increase in the emission rate to the atmosphere of any pollutant to which a standard applies shall be considered a modification within the meaning of section 111 of the Act. Upon modification, an existing facility shall become an affected facility for each pollutant to which a standard applies and for which there is an increase in the emission rate to the atmosphere.

(b) Emission rate shall be expressed as kg/hr of any pollutant discharged into the atmosphere for which a standard is applicable. The Administrator shall use the following to determine emission rate:

(1) Emission factors as specified in the latest issue of "Compilation of Air Pollutant Emission Factors," EPA Publication No. AP-42, or other emission factors determined by the Administrator to be superior to AP-42 emission factors, in cases where utilization of emission factors demonstrate that the emission level resulting from the physical or operational change will either clearly increase or clearly not increase.

(2) Material balances, continuous monitor data, or manual emission tests in cases where utilization of emission factors as referenced in paragraph (b)(1) of this section does not demonstrate to the Administrator's satisfaction whether the emission level resulting from the physical or operational change will either clearly increase or clearly not increase, or where an owner or operator demonstrates to the Administrator's satisfaction that there are reasonable grounds to dispute the result obtained by the Administrator utilizing emission factors as referenced in paragraph (b)(1) of this section. When the emission rate is based

on results from manual emission tests or continuous monitoring systems, the procedures specified in appendix C of this part shall be used to determine whether an increase in emission rate has occurred. Tests shall be conducted under such conditions as the Administrator shall specify to the owner or operator based on representative performance of the facility. At least three valid test runs must be conducted before and at least three after the physical or operational change. All operating parameters which may affect emissions must be held constant to the maximum feasible degree for all test runs.

(c) The addition of an affected facility to a stationary source as an expansion to that source or as a replacement for an existing facility shall not by itself bring within the applicability of this part any other facility within that source.

(d) [Reserved]

(e) The following shall not, by themselves, be considered modifications under this part:

(1) Maintenance, repair, and replacement which the Administrator determines to be routine for a source category, subject to the provisions of paragraph (c) of this section and § 60.15.

(2) An increase in production rate of an existing facility, if that increase can be accomplished without a capital expenditure on that facility.

(3) An increase in the hours of operation.

(4) Use of an alternative fuel or raw material if, prior to the date any standard under this part becomes applicable to that source type, as provided by § 60.1, the existing facility was designed to accommodate that alternative use. A facility shall be considered to be designed to accommodate an alternative fuel or raw material if that use could be accomplished under the facility's construction specifications as amended prior to the change. Conversion to coal required for energy considerations, as specified in section 111(a)(8) of the Act, shall not be considered a modification.

(5) The addition or use of any system or device whose primary function is the reduction of air pollutants, except

when an emission control system is removed or is replaced by a system which the Administrator determines to be less environmentally beneficial.

(6) The relocation or change in ownership of an existing facility.

(f) Special provisions set forth under an applicable subpart of this part shall supersede any conflicting provisions of this section.

(g) Within 180 days of the completion of any physical or operational change subject to the control measures specified in paragraph (a) of this section, compliance with all applicable standards must be achieved.

(h) No physical change, or change in the method of operation, at an existing electric utility steam generating unit shall be treated as a modification for the purposes of this section provided that such change does not increase the maximum hourly emissions of any pollutant regulated under this section above the maximum hourly emissions achievable at that unit during the 5 years prior to the change.

(i) Repowering projects that are awarded funding from the Department of Energy as permanent clean coal technology demonstration projects (or similar projects funded by EPA) are exempt from the requirements of this section provided that such change does not increase the maximum hourly emissions of any pollutant regulated under this section above the maximum hourly emissions achievable at that unit during the five years prior to the change.

(j)(1) Repowering projects that qualify for an extension under section 409(b) of the Clean Air Act are exempt from the requirements of this section, provided that such change does not increase the actual hourly emissions of any pollutant regulated under this section above the actual hourly emissions achievable at that unit during the 5 years prior to the change.

(2) This exemption shall not apply to any new unit that:

(i) Is designated as a replacement for an existing unit;

(ii) Qualifies under section 409(b) of the Clean Air Act for an extension of an emission limitation compliance date under section 405 of the Clean Air Act; and

(iii) Is located at a different site than the existing unit.

(k) The installation, operation, cessation, or removal of a temporary clean coal technology demonstration project is exempt from the requirements of this section. A *temporary clean coal control technology demonstration project*, for the purposes of this section is a clean coal technology demonstration project that is operated for a period of 5 years or less, and which complies with the State implementation plan for the State in which the project is located and other requirements necessary to attain and maintain the national ambient air quality standards during the project and after it is terminated.

(l) The reactivation of a very clean coal-fired electric utility steam generating unit is exempt from the requirements of this section.

[40 FR 58419, Dec. 16, 1975, amended at 43 FR 34347, Aug. 3, 1978; 45 FR 5617, Jan. 23, 1980; 57 FR 32339, July 21, 1992]

§ 60.15 Reconstruction.

(a) An existing facility, upon reconstruction, becomes an affected facility, irrespective of any change in emission rate.

(b) "Reconstruction" means the replacement of components of an existing facility to such an extent that:

(1) The fixed capital cost of the new components exceeds 50 percent of the fixed capital cost that would be required to construct a comparable entirely new facility, and

(2) It is technologically and economically feasible to meet the applicable standards set forth in this part.

(c) "Fixed capital cost" means the capital needed to provide all the depreciable components.

(d) If an owner or operator of an existing facility proposes to replace components, and the fixed capital cost of the new components exceeds 50 percent of the fixed capital cost that would be required to construct a comparable entirely new facility, he shall notify the Administrator of the proposed replacements. The notice must be postmarked 60 days (or as soon as practicable) before construction of the replacements is commenced and must include the following information:

§ 60.16

40 CFR Ch. I (7-1-99 Edition)

(1) Name and address of the owner or operator.

(2) The location of the existing facility.

(3) A brief description of the existing facility and the components which are to be replaced.

(4) A description of the existing air pollution control equipment and the proposed air pollution control equipment.

(5) An estimate of the fixed capital cost of the replacements and of constructing a comparable entirely new facility.

(6) The estimated life of the existing facility after the replacements.

(7) A discussion of any economic or technical limitations the facility may have in complying with the applicable standards of performance after the proposed replacements.

(e) The Administrator will determine, within 30 days of the receipt of the notice required by paragraph (d) of this section and any additional information he may reasonably require, whether the proposed replacement constitutes reconstruction.

(f) The Administrator's determination under paragraph (e) shall be based on:

(1) The fixed capital cost of the replacements in comparison to the fixed capital cost that would be required to construct a comparable entirely new facility;

(2) The estimated life of the facility after the replacements compared to the life of a comparable entirely new facility;

(3) The extent to which the components being replaced cause or contribute to the emissions from the facility; and

(4) Any economic or technical limitations on compliance with applicable standards of performance which are inherent in the proposed replacements.

(g) Individual subparts of this part may include specific provisions which refine and delimit the concept of reconstruction set forth in this section.

[40 FR 58420, Dec. 16, 1975]

§ 60.16 Priority list.

PRIORITIZED MAJOR SOURCE CATEGORIES

Priority Number ¹	Source Category
1.	Synthetic Organic Chemical Manufacturing Industry (SOCMI) and Volatile Organic Liquid Storage Vessels and Handling Equipment (a) SOCMI unit processes (b) Volatile organic liquid (VOL) storage vessels and handling equipment (c) SOCMI fugitive sources (d) SOCMI secondary sources
2.	Industrial Surface Coating: Cans
3.	Petroleum Refineries: Fugitive Sources
4.	Industrial Surface Coating: Paper
5.	Dry Cleaning (a) Perchloroethylene (b) Petroleum solvent
6.	Graphic Arts
7.	Polymers and Resins: Acrylic Resins
8.	Mineral Wool (Deleted)
9.	Stationary Internal Combustion Engines
10.	Industrial Surface Coating: Fabric
11.	Industrial-Commercial-Institutional Steam Generating Units.
12.	Incineration: Non-Municipal (Deleted)
13.	Non-Metallic Mineral Processing
14.	Metallic Mineral Processing
15.	Secondary Copper (Deleted)
16.	Phosphate Rock Preparation
17.	Foundries: Steel and Gray Iron
18.	Polymers and Resins: Polyethylene
19.	Charcoal Production
20.	Synthetic Rubber (a) Tire manufacture (b) SBR production
21.	Vegetable Oil
22.	Industrial Surface Coating: Metal Coil
23.	Petroleum Transportation and Marketing
24.	By-Product Coke Ovens
25.	Synthetic Fibers
26.	Plywood Manufacture
27.	Industrial Surface Coating: Automobiles
28.	Industrial Surface Coating: Large Appliances
29.	Crude Oil and Natural Gas Production
30.	Secondary Aluminum
31.	Potash (Deleted)
32.	Lightweight Aggregate Industry: Clay, Shale, and Slate ²
33.	Glass
34.	Gypsum
35.	Sodium Carbonate
36.	Secondary Zinc (Deleted)
37.	Polymers and Resins: Phenolic
38.	Polymers and Resins: Urea-Melamine
39.	Ammonia (Deleted)
40.	Polymers and Resins: Polystyrene
41.	Polymers and Resins: ABS-SAN Resins
42.	Fiberglass
43.	Polymers and Resins: Polypropylene
44.	Textile Processing
45.	Asphalt Processing and Asphalt Roofing Manufacture
46.	Brick and Related Clay Products
47.	Ceramic Clay Manufacturing (Deleted)
48.	Ammonium Nitrate Fertilizer
49.	Castable Refractories (Deleted)
50.	Borax and Boric Acid (Deleted)
51.	Polymers and Resins: Polyester Resins
52.	Ammonium Sulfate

PRIORITIZED MAJOR SOURCE CATEGORIES—
Continued

Pri- ority Num- ber ¹	Source Category
53.	Starch
54.	Perlite
55.	Phosphoric Acid: Thermal Process (Deleted)
56.	Uranium Refining
57.	Animal Feed Dechlorination (Deleted)
58.	Urea (for fertilizer and polymers)
59.	Detergent (Deleted)
<i>Other Source Categories</i>	
Lead acid battery manufacture ³	
Organic solvent cleaning ³	
Industrial surface coating: metal furniture ³	
Stationary gas turbines ⁴	
Municipal solid waste landfills ⁴	

¹ Low numbers have highest priority, e.g., No. 1 is high priority, No. 59 is low priority.

² Formerly titled "Sintering: Clay and Fly Ash".

³ Minor source category, but included on list since an NSPS is being developed for that source category.

⁴ Not prioritized, since an NSPS for this major source category has already been promulgated.

[47 FR 951, Jan. 8, 1982, as amended at 47 FR 31876, July 23, 1982; 51 FR 42796, Nov. 25, 1986; 52 FR 11428, Apr. 8, 1987; 61 FR 9919, Mar. 12, 1996]

§ 60.17 Incorporations by reference.

The materials listed below are incorporated by reference in the corresponding sections noted. These incorporations by reference were approved by the Director of the Federal Register on the date listed. These materials are incorporated as they exist on the date of the approval, and a notice of any change in these materials will be published in the FEDERAL REGISTER. The materials are available for purchase at the corresponding address noted below, and all are available for inspection at the Office of the Federal Register, 800 North Capitol Street, NW., suite 700, Washington, DC and at the Library (MD-35), U.S. EPA, Research Triangle Park, NC.

(a) The following materials are available for purchase from at least one of the following addresses: American Society for Testing and Materials (ASTM), 1916 Race Street, Philadelphia, Pennsylvania 19103; or the University Microfilms International, 300 North Zeeb Road, Ann Arbor, MI 48106.

(1) ASTM D388-77, Standard Specification for Classification of Coals by Rank, incorporation by reference (IBR) approved for §§ 60.41(f); 60.45(f)(4)(i), (ii), (vi); 60.41a; 60.41b; 60.41c; 60.25(b), (c).

(2) ASTM D3178-73, Standard Test Methods for Carbon and Hydrogen in the Analysis Sample of Coal and Coke, IBR approved January 27, 1983 for § 60.45(f)(5)(i).

(3) ASTM D3176-74, Standard Method for Ultimate Analysis of Coal and Coke, IBR approved January 27, 1983, for § 60.45(f)(5)(i); appendix A to part 60, Method 19.

(4) ASTM D1137-53 (Reapproved 1975), Standard Method for Analysis of Natural Gases and Related Types of Gaseous Mixtures by the Mass Spectrometer, IBR approved January 27, 1983 for § 60.45(f)(5)(i).

(5) ASTM D1945-64 (Reapproved 1976), Standard Method for Analysis of Natural Gas by Gas Chromatography, IBR approved January 27, 1983 for § 60.45(f)(5)(i).

(6) ASTM D1946-77, Standard Method for Analysis of Reformed Gas by Gas Chromatography, IBR approved for §§ 60.45(f)(5)(i), 60.18(c)(3)(i), 60.18(f), 60.614(d)(2)(ii), 60.614(d)(4), 60.664(d)(2)(ii), 60.664(d)(4), 60.564(f), 60.704(d)(2)(ii) and 60.704(d)(4).

(7) ASTM D2015-77, Standard Test Method for Gross Calorific Value of Solid Fuel by the Adiabatic Bomb Calorimeter, IBR approved January 27, 1983 for § 60.45(f)(5)(ii); § 60.46(g); appendix A to part 60, Method 19.

(8) ASTM D1826-77, Standard Test Method for Calorific Value of Gases in Natural Gas Range by Continuous Recording Calorimeter, IBR approved January 27, 1983, for §§ 60.45(f)(5)(ii); 60.46(g); 60.296(f); appendix A to part 60, Method 19.

(9) ASTM D240-76, Standard Test Method for Heat of Combustion of Liquid Hydrocarbon Fuels by Bomb Calorimeter, IBR approved January 27, 1983, for § 60.46(g); 60.296(f); appendix A to part 60, Method 19.

(10) ASTM D396-78, Standard Specification for Fuel Oils, IBR approved for §§ 60.40b; 60.41b; 60.41c; 60.111(b); 60.111a(b).

(11) ASTM D2880-78, Standard Specification for Gas Turbine Fuel Oils, IBR approved January 27, 1983 for §§ 60.111(b), 60.111a(b), 60.335(b)(2).

(12) ASTM D975-78, Standard Specification for Diesel Fuel Oils, IBR approved January 27, 1983 for §§ 60.111(b), 60.111a(b).

(13) ASTM D323-82, Test Method for Vapor Pressure of Petroleum Products (Reid Method), IBR approved April 8, 1987 for §§ 60.111(i), 60.111a(g), 60.111b(g), and 60.116b(f)(2)(ii).

(14) ASTM A99-76, Standard Specification for Ferromanganese, IBR approved January 27, 1983 for § 60.261.

(15) ASTM A483-64 (Reapproved 1974), Standard Specification for Silicomanganese, IBR approved January 27, 1983 for § 60.261.

(16) ASTM A101-73, Standard Specification for Ferrochromium, IBR approved January 27, 1983 for § 60.261.

(17) ASTM A100-69 (Reapproved 1974), Standard Specification for Ferrosilicon, IBR approved January 27, 1983 for § 60.261.

(18) ASTM A482-76, Standard Specification for Ferrochromesilicon, IBR approved January 27, 1983 for § 60.261.

(19) ASTM A495-76, Standard Specification for Calcium-Silicon and Calcium Manganese-Silicon, IBR approved January 27, 1983 for § 60.261.

(20) ASTM D 1072-80, Standard Method for Total Sulfur in Fuel Gases, IBR approved July 31, 1984 for § 60.335(b)(2).

(21) ASTM D2986-71 (Reapproved 1978), Standard Method for Evaluation of Air, Assay Media by the Monodisperse DOP (Diocetyl Phthalate) Smoke Test, IBR approved January 27, 1983 for appendix A to part 60, Method 5, par. 3.1.1; Method 12, par. 4.1.1; Method 17, par. 3.1.1.

(22) ASTM D 1193-77, Standard Specification for Reagent Water, for appendix A to part 60, Method 6, par. 3.1.1; Method 7, par. 3.2.2; Method 7C, par. 3.1.1; Method 7D, par. 3.1.1; Method 8, par. 3.1.3; Method 12, par. 4.1.3; Method 25D, par. 3.2.2.4; Method 26A, par. 3.1.1; Method 29, pars. 4.2.2., 4.4.2., and 4.5.6.; Method 14A, par. 7.1.

(23) [Reserved]

(24) ASTM D2234-76, Standard Methods for Collection of a Gross Sample of Coal, IBR approved January 27, 1983, for appendix A to part 60, Method 19.

(25) ASTM D3173-73, Standard Test Method for Moisture in the Analysis Sample of Coal and Coke, IBR approved January 27, 1983, for appendix A to part 60, Method 19.

(26) ASTM D3177-75, Standard Test Methods for Total Sulfur in the Analysis Sample of Coal and Coke, IBR approved January 27, 1983, for appendix A to part 60, Method 19.

(27) ASTM D2013-72, Standard Method of Preparing Coal Samples for Analysis, IBR approved January 27, 1983, for appendix A to part 60, Method 19.

(28) ASTM D270-65 (Reapproved 1975), Standard Method of Sampling Petroleum and Petroleum Products, IBR approved January 27, 1983, for appendix A to part 60, Method 19.

(29) ASTM D737-85, Standard Test Method for Air Permeability of Textile Fabrics, IBR approved January 27, 1983 for § 61.23(a).

(30) ASTM D1475-60 (Reapproved 1980), Standard Test Method for Density of Paint, Varnish, Lacquer, and Related Products, IBR approved January 27, 1983 for § 60.435(d)(1), appendix A to part 60, Method 24, par. 2.1, and Method 24A, par. 2.2.

(31) ASTM D2369-81, Standard Test Method for Volatile Content of Coatings, IBR approved January 27, 1983 for appendix A to part 60, Method 24.

(32) ASTM D3792-79, Standard Method for Water Content of Water-Reducible Paints by Direct Injection Into a Gas Chromatograph, IBR approved January 27, 1983 for appendix A to part 60, Method 24, par. 2.3.

(33) ASTM D4017-81, Standard Test Method for Water in Paints and Paint Materials by

the Karl Fischer Titration Method, IBR approved January 27, 1983 for appendix A to part 60, Method 24, par. 2.4.

(34) ASTM E169-63 (Reapproved 1977), General Techniques of Ultraviolet Quantitative Analysis, IBR approved for § 60.485(d), § 60.593(b), and § 60.632(f).

(35) ASTM E168-67 (Reapproved 1977), General Techniques of Infrared Quantitative Analysis, IBR approved for § 60.485(d), § 60.593(b), and § 60.632(f).

(36) ASTM E260-73, General Gas Chromatography Procedures, IBR approved for § 60.485(d), § 60.593(b), and § 60.632(f).

(37) ASTM D2879-83, Test Method for Vapor Pressure—Temperature Relationship and Initial Decomposition Temperature of Liquids by Isoteniscope, IBR approved April 8, 1987 for §§ 60.485(e), 60.111b(f)(3), 60.116b(e)(3)(ii), and 60.116b(f)(2)(i).

(38) ASTM D2382-76, Heat of Combustion of Hydrocarbon Fuels by Bomb Calorimeter [High-Precision Method], IBR approved for §§ 60.18(f), 60.485(g), 60.614(d)(4), 60.664(d)(4), and 60.564(f), and 60.704(d)(4).

(39) ASTM D2504-67 (Reapproved 1977), Non-condensable Gases in C₃ and Lighter Hydrocarbon Products by Gas Chromatography, IBR approved for § 60.485(g).

(40) ASTM D86-78, Distillation of Petroleum Products, IBR approved for § 60.593(d), § 60.633(h), and § 60.562-2(d).

(41) [Reserved]

(42) ASTM D 3031-81, Standard Test Method for Total Sulfur in Natural Gas by Hydrogenation, IBR approved July 31, 1984 for § 60.335(b)(2).

(43) ASTM D 4084-82, Standard Method for Analysis of Hydrogen Sulfide in Gaseous Fuels (Lead Acetate Reaction Rate Method), IBR approved July 31, 1984 for § 60.335(b)(2).

(44) ASTM D 3246-81, Standard Method for Sulfur in Petroleum Gas by Oxidative Microcoulometry, IBR approved July 31, 1984 for § 60.335(b)(2).

(45) ASTM D2584-68, Standard Test Method for Ignition Loss of Cured Reinforced Resins, IBR approved February 25, 1985 for § 60.685(e).

(46) ASTM D3431-80, Standard Test Method for Trace Nitrogen in Liquid Petroleum Hydrocarbons (Microcoulometric Method), IBR approved November 25, 1986, for appendix A to part 60, Method 19.

(47) ASTM D129-64 (reapproved 1978), Standard Test Method for Sulfur in Petroleum Products (General Bomb Method), IBR approved for appendix A to part 60, Method 19.

(48) ASTM D1552-83, Standard Test Method for Sulfur in Petroleum Products (High Temperature Method), IBR approved for appendix A to part 60, Method 19.

(49) ASTM D1835-86, Standard Specification for Liquefied Petroleum (LP) Gases, to be approved for § 60.41b.

(50) ASTM D1835-86, Standard Specification for Liquefied Petroleum (LP) Gases, IBR approved for §§ 60.41b; 60.41c.

(51) ASTM D4057-81, Standard Practice for Manual Sampling of Petroleum and Petroleum Products, IBR approved for appendix A to part 60, Method 19.

(52) ASTM D4239-85, Standard Test Methods for Sulfur in the Analysis Sample of Coal and Coke Using High Temperature Tube Furnace Combustion Methods, IBR approved for appendix A to part 60, Method 19.

(53) ASTM D2016-74 (Reapproved 1983), Standard Test Methods for Moisture Content of Wood * * * for appendix A, Method 28.

(54) ASTM D4442-84, Standard Test Methods for Direct Moisture Content Measurement in Wood and Wood-base Materials * * * for appendix A, Method 28.

(55) [Reserved]

(56) ASTM D129-64 (Reapproved 1978), Standard Test Method for Sulfur in Petroleum Products (General Bomb Method), IBR approved August 17, 1989, for § 60.106(j)(2).

(57) ASTM D1552-83, Standard Test Method for Sulfur in Petroleum Products (High-Temperature Method), IBR approved August 17, 1989, for § 60.106(j)(2).

(58) ASTM D2622-87, Standard Test Method for Sulfur in Petroleum Products by X-Ray Spectrometry, IBR approved August 17, 1989, for § 60.106(j)(2).

(59) ASTM D1266-87, Standard Test Method for Sulfur in Petroleum Products (Lamp Method), IBR approved August 17, 1989, for § 60.106(j)(2).

(60) ASTM D2908-74, Standard Practice for Measuring Volatile Organic Matter in Water by Aqueous-Injection Gas Chromatography, IBR approved for § 60.564(j).

(61) ASTM D3370-76, Standard Practices for Sampling Water, IBR approved for § 60.564(j).

(62) ASTM D4457-85 Test Method for Determination of Dichloromethane and 1,1,1-Trichloroethane in Paints and Coatings by Direct Injection into a Gas Chromatograph, IBR approved for appendix A, Method 24.

(63) ASTM D 5403-93 Standard Test Methods for Volatile Content of Radiation Curable Materials. IBR approved September 11, 1995 for Method 24 of Appendix A.

(b) The following material is available for purchase from the Association of Official Analytical Chemists, 1111 North 19th Street, Suite 210, Arlington, VA 22209.

(1) AOAC Method 9, Official Methods of Analysis of the Association of Official Analytical Chemists, 11th edition, 1970, pp. 11-12, IBR approved January 27, 1983 for §§ 60.204(d)(2), 60.214(d)(2), 60.224(d)(2), 60.234(d)(2).

(c) The following material is available for purchase from the American

Petroleum Institute, 1220 L Street NW., Washington, DC 20005.

(1) API Publication 2517, Evaporation Loss from External Floating Roof Tanks, Second Edition, February 1980, IBR approved January 27, 1983, for §§ 60.111(i), 60.111a(f), 60.111a(f)(1) and 60.116b(e)(2)(i).

(d) The following material is available for purchase from the Technical Association of the Pulp and Paper Industry (TAPPI), Dunwoody Park, Atlanta, GA 30341.

(1) TAPPI Method T624 os-68, IBR approved January 27, 1983 for § 60.285(d)(4).

(e) The following material is available for purchase from the Water Pollution Control Federation (WPCF), 2626 Pennsylvania Avenue NW., Washington, DC 20037.

(1) Method 209A, Total Residue Dried at 103-105 ° C, in Standard Methods for the Examination of Water and Wastewater; 15th Edition, 1980, IBR approved February 25, 1985 for § 60.683(b).

(f) The following material is available for purchase from the following address: Underwriter's Laboratories, Inc. (UL), 333 Pfingsten Road, Northbrook, IL 60062.

(1) UL 103, Sixth Edition revised as of September 3, 1986, Standard for Chimneys, Factory-built, Residential Type and Building Heating Appliance.

(g) The following material is available for purchase from the following address: West Coast Lumber Inspection Bureau, 6980 SW. Barnes Road, Portland, OR 97223.

(1) West Coast Lumber Standard Grading Rules No. 16, pages 5-21 and 90 and 91, September 3, 1970, revised 1984.

(h) The following material is available for purchase from the American Society of Mechanical Engineers (ASME), 345 East 47th Street, New York, NY 10017.

(1) ASME QRO-1-1994, Standard for the Qualification and Certification of Resource Recovery Facility Operators, IBR approved for §§ 60.56a, 60.54b(a), and 60.54b(b).

(2) ASME PTC 4.1-1964 (Reaffirmed 1991), Power Test Codes: Test Code for Steam Generating Units (with 1968 and 1969 Addenda), IBR approved for §§ 60.46b, 60.58a(h)(6)(ii), and 60.58b(i)(6)(ii).

(3) ASME Interim Supplement 19.5 on Instruments and Apparatus: Application, Part

§ 60.18

II of Fluid Meters, 6th Edition (1971), IBR approved for §§ 60.58a(h)(6)(ii) and 60.58b(i)(6)(ii).

(i) Test Methods for Evaluating Solid Waste, Physical/Chemical Methods," EPA Publication SW-846 Third Edition (November 1986), as amended by Updates I (July, 1992), II (September 1994), IIA (August, 1993), and IIB (January, 1995). Test Method are incorporated by reference for appendix A to part 60, Method 29, pars. 2.2.1; 2.3.1; 2.5; 3.3.12.1; 3.3.12.2; 3.3.13; 3.3.14; 5.4.3; 6.2; 6.3; 7.2.1; 7.2.3; and Table 29-2. The Third Edition of SW-846 and Updates I, II, IIA, and IIB (document number 955-001-00000-1) are available from the Superintendent of Documents, U.S. Government Printing Office, Washington, DC 20402, (202) 512-1800. Copies may be obtained from the Library of the U.S. Environmental Protection Agency, 401 M Street, SW., Washington, DC 20460.

(j) Standard Methods for the Examination of Water and Wastewater, 16th edition, 1985. Method 303F Determination of Mercury by the Cold Vapor Technique. This document may be obtained from the American Public Health Association, 1015 18th Street, NW., Washington, DC 20036, and is incorporated by reference for Method 29, pars 5.4.3; 6.3; and 7.2.3 of appendix A to part 60.

(k) This material is available for purchase from the American Hospital Association (AHA) Service, Inc., Post Office Box 92683, Chicago, Illinois 60675-2683. You may inspect a copy at EPA's Air and Radiation Docket and Information Center (Docket A-91-61, Item IV-J-124), Room M-1500, 401 M Street SW., Washington, DC.

(l) An Ounce of Prevention: Waste Reduction Strategies for Health Care Facilities. American Society for Health Care Environmental Services of the American Hospital Association. Chicago, Illinois, 1993. AHA Catalog No. 057007. ISBN 0-87258-673-5. IBR approved for § 60.35e and § 60.55c.

(m) This material is available for purchase from the National Technical Information Services, 5285 Port Royal Road, Springfield, Virginia 22161. You may inspect a copy at EPA's Air and Radiation Docket and Information Center (Docket A-91-61, Item IV-J-125), Room M-1500, 401 M Street SW., Washington, DC.

40 CFR Ch. I (7-1-99 Edition)

(n) OMB Bulletin No. 93-17: Revised Statistical Definitions for Metropolitan Areas. Office of Management and Budget, June 30, 1993. NTIS No. PB 93-192-664. IBR approved for § 60.31e.

[48 FR 3735, Jan. 27, 1983]

EDITORIAL NOTE: For FEDERAL REGISTER citations affecting § 60.17, see the List of CFR Sections Affected in the Finding Aids section of this volume.

§ 60.18 General control device requirements.

(a) *Introduction.* This section contains requirements for control devices used to comply with applicable subparts of parts 60 and 61. The requirements are placed here for administrative convenience and only apply to facilities covered by subparts referring to this section.

(b) *Flares.* Paragraphs (c) through (f) apply to flares.

(c)(1) Flares shall be designed for and operated with no visible emissions as determined by the methods specified in paragraph (f), except for periods not to exceed a total of 5 minutes during any 2 consecutive hours.

(2) Flares shall be operated with a flame present at all times, as determined by the methods specified in paragraph (f).

(3) An owner/operator has the choice of adhering to either the heat content specifications in paragraph (c)(3)(ii) of this section and the maximum tip velocity specifications in paragraph (c)(4) of this section, or adhering to the requirements in paragraph (c)(3)(i) of this section.

(i)(A) Flares shall be used that have a diameter of 3 inches or greater, are nonassisted, have a hydrogen content of 8.0 percent (by volume), or greater, and are designed for and operated with an exit velocity less than 37.2 m/sec (122 ft/sec) and less than the velocity, V_{max} , as determined by the following equation:

$$V_{max} = (X_{H_2} - K_1) * K_2$$

Where:

V_{max} = Maximum permitted velocity, m/sec.

K_1 = Constant, 6.0 volume-percent hydrogen.

K_2 = Constant, 3.9(m/sec)/volume-percent hydrogen.

X_{H_2} = The volume-percent of hydrogen, on a wet basis, as calculated by using the American Society for Testing and Materials (ASTM) Method D1946-77. (Incorporated by reference as specified in §60.17).

(B) The actual exit velocity of a flare shall be determined by the method specified in paragraph (f)(4) of this section.

(ii) Flares shall be used only with the net heating value of the gas being combusted being 11.2 MJ/scm (300 Btu/scf) or greater if the flare is steam-assisted or air-assisted; or with the net heating value of the gas being combusted being 7.45 MJ/scm (200 Btu/scf) or greater if the flare is nonassisted. The net heating value of the gas being combusted shall be determined by the methods specified in paragraph (f)(3) of this section.

(4)(i) Steam-assisted and nonassisted flares shall be designed for and operated with an exit velocity, as determined by the methods specified in paragraph (f)(4) of this section, less than 18.3 m/sec (60 ft/sec), except as provided in paragraphs (c)(4) (ii) and (iii) of this section.

(ii) Steam-assisted and nonassisted flares designed for and operated with an exit velocity, as determined by the methods specified in paragraph (f)(4), equal to or greater than 18.3 m/sec (60 ft/sec) but less than 122 m/sec (400 ft/sec) are allowed if the net heating value of the gas being combusted is greater than 37.3 MJ/scm (1,000 Btu/scf).

(iii) Steam-assisted and nonassisted flares designed for and operated with an exit velocity, as determined by the methods specified in paragraph (f)(4), less than the velocity, V_{max} , as determined by the method specified in paragraph (f)(5), and less than 122 m/sec (400 ft/sec) are allowed.

(5) Air-assisted flares shall be designed and operated with an exit velocity less than the velocity, V_{max} , as determined by the method specified in paragraph (f)(6).

(6) Flares used to comply with this section shall be steam-assisted, air-assisted, or nonassisted.

(d) Owners or operators of flares used to comply with the provisions of this subpart shall monitor these control devices to ensure that they are operated and maintained in conformance with their designs. Applicable subparts will provide provisions stating how owners or operators of flares shall monitor these control devices.

(e) Flares used to comply with provisions of this subpart shall be operated at all times when emissions may be vented to them.

(f)(1) Reference Method 22 shall be used to determine the compliance of flares with the visible emission provisions of this subpart. The observation period is 2 hours and shall be used according to Method 22.

(2) The presence of a flare pilot flame shall be monitored using a thermocouple or any other equivalent device to detect the presence of a flame.

(3) The net heating value of the gas being combusted in a flare shall be calculated using the following equation:

EC01JN92.008

where:

H_T = Net heating value of the sample, MJ/scm; where the net enthalpy per mole of offgas is based on combustion at 25 °C and 760 mm Hg, but the standard temperature for determining the volume corresponding to one mole is 20 °C;

EC01JN92.009

C_i =Concentration of sample component i in ppm on a wet basis, as measured for organics by Reference Method 18 and measured for hydrogen and carbon monoxide by ASTM D1946-77 (Incorporated by reference as specified in § 60.17); and

H_i =Net heat of combustion of sample component i , kcal/g mole at 25 °C and 760 mm Hg. The heats of combustion may be determined using ASTM D2382-76 (incorporated by reference as specified in § 60.17) if published values are not available or cannot be calculated.

(4) The actual exit velocity of a flare shall be determined by dividing the volumetric flowrate (in units of standard temperature and pressure), as determined by Reference Methods 2, 2A, 2C, or 2D as appropriate; by the unobstructed (free) cross sectional area of the flare tip.

(5) The maximum permitted velocity, V_{max} , for flares complying with paragraph (c)(4)(iii) shall be determined by the following equation.

$$\text{Log}_{10}(V_{max})=(H_T+28.8)/31.7$$

V_{max} =Maximum permitted velocity, M/sec
28.8=Constant

31.7=Constant

H_T =The net heating value as determined in paragraph (f)(3).

(6) The maximum permitted velocity, V_{max} , for air-assisted flares shall be determined by the following equation.

$$V_{max}=8.706+0.7084(H_T)$$

V_{max} =Maximum permitted velocity, m/sec

8.706=Constant

0.7084=Constant

H_T =The net heating value as determined in paragraph (f)(3).

[51 FR 2701, Jan. 21, 1986, as amended at 63 FR 24444, May 4, 1998]

§ 60.19 General notification and reporting requirements.

(a) For the purposes of this part, time periods specified in days shall be measured in calendar days, even if the word "calendar" is absent, unless otherwise specified in an applicable requirement.

(b) For the purposes of this part, if an explicit postmark deadline is not specified in an applicable requirement for the submittal of a notification, application, report, or other written communication to the Administrator, the owner or operator shall postmark the submittal on or before the number of days specified in the applicable re-

quirement. For example, if a notification must be submitted 15 days before a particular event is scheduled to take place, the notification shall be postmarked on or before 15 days preceding the event; likewise, if a notification must be submitted 15 days after a particular event takes place, the notification shall be delivered or postmarked on or before 15 days following the end of the event. The use of reliable non-Government mail carriers that provide indications of verifiable delivery of information required to be submitted to the Administrator, similar to the postmark provided by the U.S. Postal Service, or alternative means of delivery, including the use of electronic media, agreed to by the permitting authority, is acceptable.

(c) Notwithstanding time periods or postmark deadlines specified in this part for the submittal of information to the Administrator by an owner or operator, or the review of such information by the Administrator, such time periods or deadlines may be changed by mutual agreement between the owner or operator and the Administrator. Procedures governing the implementation of this provision are specified in paragraph (f) of this section.

(d) If an owner or operator of an affected facility in a State with delegated authority is required to submit periodic reports under this part to the State, and if the State has an established timeline for the submission of periodic reports that is consistent with the reporting frequency(ies) specified for such facility under this part, the owner or operator may change the dates by which periodic reports under this part shall be submitted (without changing the frequency of reporting) to be consistent with the State's schedule by mutual agreement between the owner or operator and the State. The allowance in the previous sentence applies in each State beginning 1 year after the affected facility is required to be in compliance with the applicable subpart in this part. Procedures governing the implementation of this provision are specified in paragraph (f) of this section.

(e) If an owner or operator supervises one or more stationary sources affected

by standards set under this part and standards set under part 61, part 63, or both such parts of this chapter, he/she may arrange by mutual agreement between the owner or operator and the Administrator (or the State with an approved permit program) a common schedule on which periodic reports required by each applicable standard shall be submitted throughout the year. The allowance in the previous sentence applies in each State beginning 1 year after the stationary source is required to be in compliance with the applicable subpart in this part, or 1 year after the stationary source is required to be in compliance with the applicable 40 CFR part 61 or part 63 of this chapter standard, whichever is latest. Procedures governing the implementation of this provision are specified in paragraph (f) of this section.

(f)(1)(i) Until an adjustment of a time period or postmark deadline has been approved by the Administrator under paragraphs (f)(2) and (f)(3) of this section, the owner or operator of an affected facility remains strictly subject to the requirements of this part.

(ii) An owner or operator shall request the adjustment provided for in paragraphs (f)(2) and (f)(3) of this section each time he or she wishes to change an applicable time period or postmark deadline specified in this part.

(2) Notwithstanding time periods or postmark deadlines specified in this

part for the submittal of information to the Administrator by an owner or operator, or the review of such information by the Administrator, such time periods or deadlines may be changed by mutual agreement between the owner or operator and the Administrator. An owner or operator who wishes to request a change in a time period or postmark deadline for a particular requirement shall request the adjustment in writing as soon as practicable before the subject activity is required to take place. The owner or operator shall include in the request whatever information he or she considers useful to convince the Administrator that an adjustment is warranted.

(3) If, in the Administrator's judgment, an owner or operator's request for an adjustment to a particular time period or postmark deadline is warranted, the Administrator will approve the adjustment. The Administrator will notify the owner or operator in writing of approval or disapproval of the request for an adjustment within 15 calendar days of receiving sufficient information to evaluate the request.

(4) If the Administrator is unable to meet a specified deadline, he or she will notify the owner or operator of any significant delay and inform the owner or operator of the amended schedule.

[59 FR 12428, Mar. 16, 1994, as amended at 64 FR 7463, Feb. 12, 1998]

40 CFR 63 Subpart A - General Provisions modified for Subpart II

{Permitting note: Last Edited January 5, 1998

SOURCE: 40 CFR 63 (7-1-96 Edition) and Federal Register revision dated 12-17-96.}

§ 63.1 Applicability.

(a) *General.*

(1) Terms used throughout this part are defined in § 63.2 or in the Clean Air Act (Act) as amended in 1990, except that individual subparts of this part may include specific definitions in addition to or that supersede definitions in § 63.2.

(2) This part contains national emission standards for hazardous air pollutants (NESHAP) established pursuant to section 112 of the Act as amended November 15, 1990. These standards regulate specific categories of stationary sources that emit (or have the potential to emit) one or more hazardous air pollutants listed in this part pursuant to section 112(b) of the Act. This section explains the applicability of such standards to sources affected by them. The standards in this part are independent of NESHAP contained in 40 CFR part 61. The NESHAP in part 61 promulgated by signature of the Administrator before November 15, 1990 (i.e., the date of enactment of the Clean Air Act Amendments of 1990) remain in effect until they are amended, if appropriate, and added to this part.

(3) No emission standard or other requirement established under this part shall be interpreted, construed, or applied to diminish or replace the requirements of a more stringent emission limitation or other applicable requirement established by the Administrator pursuant to other authority of the Act (including those requirements in part 60 of this chapter), or a standard issued under State authority.

(4) Subpart II clarifies the applicability of each paragraph in subpart A to sources subject to subpart II.

The provisions of this subpart (i.e., subpart A of this part) apply to owners or operators who are subject to subsequent subparts of this part, except when otherwise specified in a particular subpart or in a relevant standard. The general provisions in subpart A eliminate the repetition of requirements applicable to all owners or operators affected by this part. The general provisions in subpart A do not apply to regulations developed pursuant to section 112(r) of the amended Act, unless otherwise specified in those regulations.

(5) [Reserved]

(6) To obtain the most current list of categories of sources to be regulated under section 112 of the Act, or to obtain the most recent regulation promulgation schedule established pursuant to section 112(e) of the Act, contact the Office of the Director, Emission Standards Division, Office of Air Quality Planning and Standards, U.S. EPA (MD-13), Research Triangle Park, North Carolina 27711.

(7) Subpart D of this part contains regulations that address procedures for an owner or operator to obtain an extension of compliance with a relevant standard through an early reduction of emissions of hazardous air pollutants pursuant to section 112(i)(5) of the Act.

(8) Discusses State programs.

(9) [Reserved]

(10) For the purposes of this part, time periods specified in days shall be measured in calendar days, even if the word "calendar" is absent, unless otherwise specified in an applicable requirement.

(11) For the purposes of this part, if an explicit postmark deadline is not specified in an applicable requirement for the submittal of a notification, application, test plan, report, or other written communication to the Administrator, the owner or operator shall postmark the submittal on or before the number of days specified in the applicable requirement. For example, if a

notification must be submitted 15 days before a particular event is scheduled to take place, the notification shall be postmarked on or before 15 days preceding the event; likewise, if a notification must be submitted 15 days after a particular event takes place, the notification shall be postmarked on or before 15 days following the end of the event. The use of reliable non-Government mail carriers that provide indications of verifiable delivery of information required to be submitted to the Administrator, similar to the postmark provided by the U.S. Postal Service, or alternative means of delivery agreed to by the permitting authority, is acceptable.

(12) Notwithstanding time periods or postmark deadlines specified in this part for the submittal of information to the Administrator by an owner or operator, or the review of such information by the Administrator, such time periods or deadlines may be changed by mutual agreement between the owner or operator and the Administrator. Procedures governing the implementation of this provision are specified in § 63.9(i).

(13) Special provisions set forth under an applicable subpart of this part or in a relevant standard established under this part shall supersede any conflicting provisions of this subpart.

(14) Any standards, limitations, prohibitions, or other federally enforceable requirements established pursuant to procedural regulations in this part [including, but not limited to, equivalent emission limitations established pursuant to section 112(g) of the Act] shall have the force and effect of requirements promulgated in this part and shall be subject to the provisions of this subpart, except when explicitly specified otherwise.

(b) Initial applicability determination for this part.

(1) 40 CFR 63.781 specifies applicability in more detail.

The provisions of this part apply to the owner or operator of any stationary source that -

(i) Emits or has the potential to emit any hazardous air pollutant listed in or pursuant to section 112(b) of the Act; and

(ii) Is subject to any standard, limitation, prohibition, or other federally enforceable requirement established pursuant to this part.

(2) In addition to complying with the provisions of this part, the owner or operator of any such source may be required to obtain an operating permit issued to stationary sources by an authorized State air pollution control agency or by the Administrator of the U.S. Environmental Protection Agency (EPA) pursuant to title V of the Act (42 U.S.C. 7661). For more information about obtaining an operating permit, see part 70 of this chapter.

(3) An owner or operator of a stationary source that emits (or has the potential to emit, without considering controls) one or more hazardous air pollutants who determines that the source is not subject to a relevant standard or other requirement established under this part, shall keep a record of the applicability determination as specified in § 63.10(b)(3) of this subpart.

(c) Applicability of this part after a relevant standard has been set under this part.

(1) If a relevant standard has been established under this part, the owner or operator of an affected source shall comply with the provisions of this subpart and the provisions of that standard, except as specified otherwise in this subpart or that standard.

(2) If a relevant standard has been established under this part, the owner or operator of an affected source may be required to obtain a title V permit from the permitting authority in the State in which the source is located. Emission standards promulgated in this part for area sources will specify whether -

(i) States will have the option to exclude area sources affected by that standard from the requirement to obtain a title V permit (i.e., the standard will exempt the category of area sources altogether from the permitting requirement);

(ii) States will have the option to defer permitting of area sources in that category until the Administrator takes rulemaking action to determine applicability of the permitting requirements; or

(iii) Area sources affected by that emission standard are immediately subject to the requirement to apply for and obtain a title V permit in all States. If a standard fails to specify what the permitting requirements will be for area sources affected by that standard, then area sources that are subject to the standard will be subject to the requirement to obtain a title V permit without deferral. If the owner or operator is required to obtain a title V permit, he or she shall apply for such permit in accordance with part 70 of this chapter and applicable State regulations, or in accordance with the regulations contained in this chapter to implement the Federal title V permit program (42 U.S.C. 7661), whichever regulations are applicable.

(3) [Reserved]

(4) If the owner or operator of an existing source obtains an extension of compliance for such source in accordance with the provisions of subpart D of this part, the owner or operator shall

comply with all requirements of this subpart except those requirements that are specifically overridden in the extension of compliance for that source.

(5) If an area source that otherwise would be subject to an emission standard or other requirement established under this part if it were a major source subsequently increases its emissions of hazardous air pollutants (or its potential to emit hazardous air pollutants) such that the source is a major source that is subject to the emission standard or other requirement, such source also shall be subject to the notification requirements of this subpart.

(d) [Reserved]

(e) *Applicability of permit program before a relevant standard has been set under this part.* After the effective date of an approved permit program in the State in which a stationary source is (or would be) located, the owner or operator of such source may be required to obtain a title V permit from the permitting authority in that State (or revise such a permit if one has already been issued to the source) before a relevant standard is established under this part. If the owner or operator is required to obtain (or revise) a title V permit, he/she shall apply to obtain (or revise) such permit in accordance with the regulations contained in part 70 of this chapter and applicable State regulations, or the regulations codified in this chapter to implement the Federal title V permit program (42 U.S.C. 7661), whichever regulations are applicable.

§ 63.2 Definitions.

Additional terms are defined in 40 CFR 63.782; when overlap between subparts A and II occurs, subpart II takes precedence.

The terms used in this part are defined in the Act or in this section as follows:

Act means the Clean Air Act (42 U.S.C. 7401 et seq., as amended by Pub. L. 101-549, 104 Stat. 2399).

Actual emissions is defined in subpart D of this part for the purpose of granting a compliance extension for an early reduction of hazardous air pollutants.

Administrator means the Administrator of the United States Environmental Protection Agency or his or her authorized representative (e.g., a State that has been delegated the authority to implement the provisions of this part).

Affected source, for the purposes of this part, means the stationary source, the group of stationary sources, or the portion of a stationary source that is regulated by a relevant standard or other requirement established pursuant to section 112 of the Act. Each relevant standard will define the "affected source" for the purposes of that standard. The term "affected source," as used in this part, is separate and distinct from any other use of that term in EPA regulations such

as those implementing title IV of the Act. Sources regulated under part 60 or part 61 of this chapter are not affected sources for the purposes of part 63.

Alternative emission limitation means conditions established pursuant to sections 112(i)(5) or 112(i)(6) of the Act by the Administrator or by a State with an approved permit program.

Alternative emission standard means an alternative means of emission limitation that, after notice and opportunity for public comment, has been demonstrated by an owner or operator to the Administrator's satisfaction to achieve a reduction in emissions of any air pollutant at least equivalent to the reduction in emissions of such pollutant achieved under a relevant design, equipment, work practice, or operational emission standard, or combination thereof, established under this part pursuant to section 112(h) of the Act.

Alternative test method means any method of sampling and analyzing for an air pollutant that is not a test method in this chapter and that has been demonstrated to the Administrator's satisfaction, using Method 301 in Appendix A of this part, to produce results adequate for the Administrator's determination that it may be used in place of a test method specified in this part.

Approved permit program means a State permit program approved by the Administrator as meeting the requirements of part 70 of this chapter or a Federal permit program established in this chapter pursuant to title V of the Act (42 U.S.C. 7661).

Area source means any stationary source of hazardous air pollutants that is not a major source as defined in this part.

Commenced means, with respect to construction or reconstruction of a stationary source, that an owner or operator has undertaken a continuous program of construction or reconstruction or that an owner or operator has entered into a contractual obligation to undertake and complete, within a reasonable time, a continuous program of construction or reconstruction.

Compliance date means the date by which an affected source is required to be in compliance with a relevant standard, limitation, prohibition, or any federally enforceable requirement established by the Administrator (or a State with an approved permit program) pursuant to section 112 of the Act.

Compliance plan means a plan that contains all of the following:

- (1) A description of the compliance status of the affected source with respect to all applicable requirements established under this part;
- (2) A description as follows:
 - (i) For applicable requirements for which the source is in compliance, a statement that the source will continue to comply with such requirements;
 - (ii) For applicable requirements that the source is required to comply with by a future date, a statement that the source will meet such requirements on a timely basis;
 - (iii) For applicable requirements for which the source is not in compliance, a narrative description of how the source will achieve compliance with such requirements on a timely basis;
- (3) A compliance schedule, as defined in this section; and
- (4) A schedule for the submission of certified progress reports no less frequently than every 6 months for affected sources required to have a schedule of compliance to remedy a violation.

Compliance schedule means:

- (1) In the case of an affected source that is in compliance with all applicable requirements established under this part, a statement that the source will continue to comply with such requirements; or
- (2) In the case of an affected source that is required to comply with applicable requirements by a future date, a statement that the source will meet such requirements on a timely basis and, if required by an applicable requirement, a detailed schedule of the dates by which each step toward compliance will be reached; or

(3) In the case of an affected source not in compliance with all applicable requirements established under this part, a schedule of remedial measures, including an enforceable sequence of actions or operations with milestones and a schedule for the submission of certified progress reports, where applicable, leading to compliance with a relevant standard, limitation, prohibition, or any federally enforceable requirement established pursuant to section 112 of the Act for which the affected source is not in compliance. This compliance schedule shall resemble and be at least as stringent as that contained in any judicial consent decree or administrative order to which the source is subject. Any such schedule of compliance shall be supplemental to, and shall not sanction non-compliance with, the applicable requirements on which it is based.

Construction means the on-site fabrication, erection, or installation of an affected source.

Continuous emission monitoring system (CEMS) means the total equipment that may be required to meet the data acquisition and availability requirements of this part, used to sample, condition (if applicable), analyze, and provide a record of emissions.

Continuous monitoring system (CMS) is a comprehensive term that may include, but is not limited to, continuous emission monitoring systems, continuous opacity monitoring systems, continuous parameter monitoring systems, or other manual or automatic monitoring that is used for demonstrating compliance with an applicable regulation on a continuous basis as defined by the regulation.

Continuous opacity monitoring system (COMS) means a continuous monitoring system that measures the opacity of emissions.

Continuous parameter monitoring system means the total equipment that may be required to meet the data acquisition and availability requirements of this part, used to sample, condition (if applicable), analyze, and provide a record of process or control system parameters.

Effective date means:

(1) With regard to an emission standard established under this part, the date of promulgation in the FEDERAL REGISTER of such standard; or

(2) With regard to an alternative emission limitation or equivalent emission limitation determined by the Administrator (or a State with an approved permit program), the date that the alternative emission limitation or equivalent emission limitation becomes effective according to the provisions of this part. The effective date of a permit program established under title V of the Act (42 U.S.C. 7661) is determined according to the regulations in this chapter establishing such programs.

Emission standard means a national standard, limitation, prohibition, or other regulation promulgated in a subpart of this part pursuant to sections 112(d), 112(h), or 112(f) of the Act.

Emissions averaging is a way to comply with the emission limitations specified in a relevant standard, whereby an affected source, if allowed under a subpart of this part, may create emission credits by reducing emissions from specific points to a level below that required by the relevant standard, and those credits are used to offset emissions from points that are not controlled to the level required by the relevant standard.

EPA means the United States Environmental Protection Agency.

Equivalent emission limitation means the maximum achievable control technology emission limitation (MACT emission limitation) for hazardous air pollutants that the Administrator (or a State with an approved permit program) determines on a case-by-case basis, pursuant to section 112(g) or section 112(j) of the Act, to be equivalent to the emission standard that would apply to an affected source if such standard had been promulgated by the Administrator under this part pursuant to section 112(d) or section 112(h) of the Act.

Excess emissions and continuous monitoring system performance report is a report that must be submitted periodically by an affected source in order to provide data on its compliance

with relevant emission limits, operating parameters, and the performance of its continuous parameter monitoring systems.

Existing source means any affected source that is not a new source.

Federally enforceable means all limitations and conditions that are enforceable by the Administrator and citizens under the Act or that are enforceable under other statutes administered by the Administrator. Examples of federally enforceable limitations and conditions include, but are not limited to:

(1) Emission standards, alternative emission standards, alternative emission limitations, and equivalent emission limitations established pursuant to section 112 of the Act as amended in 1990;

(2) New source performance standards established pursuant to section 111 of the Act, and emission standards established pursuant to section 112 of the Act before it was amended in 1990;

(3) All terms and conditions in a title V permit, including any provisions that limit a source's potential to emit, unless expressly designated as not federally enforceable;

(4) Limitations and conditions that are part of an approved State Implementation Plan (SIP) or a Federal Implementation Plan (FIP);

(5) Limitations and conditions that are part of a Federal construction permit issued under 40 CFR 52.21 or any construction permit issued under regulations approved by the EPA in accordance with 40 CFR part 51;

(6) Limitations and conditions that are part of an operating permit issued pursuant to a program approved by the EPA into a SIP as meeting the EPA's minimum criteria for Federal enforceability, including adequate notice and opportunity for EPA and public comment prior to issuance of the final permit and practicable enforceability;

(7) Limitations and conditions in a State rule or program that has been approved by the EPA under subpart E of this part for the purposes of implementing and enforcing section 112; and

(8) Individual consent agreements that the EPA has legal authority to create.

Fixed capital cost means the capital needed to provide all the depreciable components of an existing source.

Fugitive emissions means those emissions from a stationary source that could not reasonably pass through a stack, chimney, vent, or other functionally equivalent opening. Under section 112 of the Act, all fugitive emissions are to be considered in determining whether a stationary source is a major source.

Hazardous air pollutant means any air pollutant listed in or pursuant to section 112(b) of the Act.

Issuance of a part 70 permit will occur, if the State is the permitting authority, in accordance with the requirements of part 70 of this chapter and the applicable, approved State permit program. When the EPA is the permitting authority, issuance of a title V permit occurs immediately after the EPA takes final action on the final permit.

Lesser quantity means a quantity of a hazardous air pollutant that is or may be emitted by a stationary source that the Administrator establishes in order to define a major source under an applicable subpart of this part.

Major source means any stationary source or group of stationary sources located within a contiguous area and under common control that emits or has the potential to emit considering controls, in the aggregate, 10 tons per year or more of any hazardous air pollutant or 25 tons per year or more of any combination of hazardous air pollutants, unless the Administrator establishes a lesser quantity, or in the case of radionuclides, different criteria from those specified in this sentence.

Malfunction means any sudden, infrequent, and not reasonably preventable failure of air pollution control equipment, process equipment, or a process to operate in a normal or usual manner. Failures that are caused in part by poor maintenance or careless operation are not malfunctions.

New source means any affected source the construction or reconstruction of which is commenced after the Administrator first proposes a relevant emission standard under this part.

One-hour period, unless otherwise defined in an applicable subpart, means any 60-minute period commencing on the hour.

Opacity means the degree to which emissions reduce the transmission of light and obscure the view of an object in the background. For continuous opacity monitoring systems, opacity means the fraction of incident light that is attenuated by an optical medium.

Owner or operator means any person who owns, leases, operates, controls, or supervises a stationary source.

Part 70 permit means any permit issued, renewed, or revised pursuant to part 70 of this chapter.

Performance audit means a procedure to analyze blind samples, the content of which is known by the Administrator, simultaneously with the analysis of performance test samples in order to provide a measure of test data quality.

Performance evaluation means the conduct of relative accuracy testing, calibration error testing, and other measurements used in validating the continuous monitoring system data.

Performance test means the collection of data resulting from the execution of a test method (usually three emission test runs) used to demonstrate compliance with a relevant emission standard as specified in the performance test section of the relevant standard.

Permit modification means a change to a title V permit as defined in regulations codified in this chapter to implement title V of the Act (42 U.S.C. 7661).

Permit program means a comprehensive State operating permit system established pursuant to title V of the Act (42 U.S.C. 7661) and regulations codified in part 70 of this chapter and applicable State regulations, or a comprehensive Federal operating permit system established pursuant to title V of the Act and regulations codified in this chapter.

Permit revision means any permit modification or administrative permit amendment to a title V permit as defined in regulations codified in this chapter to implement title V of the Act (42 U.S.C. 7661).

Permitting authority means:

(1) The State air pollution control agency, local agency, other State agency, or other agency authorized by the Administrator to carry out a permit program under part 70 of this chapter; or

(2) The Administrator, in the case of EPA-implemented permit programs under title V of the Act (42 U.S.C. 7661).

Potential to emit means the maximum capacity of a stationary source to emit a pollutant under its physical and operational design. Any physical or operational limitation on the capacity of the stationary source to emit a pollutant, including air pollution control equipment and restrictions on hours of operation or on the type or amount of material combusted, stored, or processed, shall be treated as part of its design if the limitation or the effect it would have on emissions is federally enforceable.

Reconstruction means the replacement of components of an affected or a previously unaffected stationary source to such an extent that:

(1) The fixed capital cost of the new components exceeds 50 percent of the fixed capital cost that would be required to construct a comparable new source; and

(2) It is technologically and economically feasible for the reconstructed source to meet the relevant standard(s) established by the Administrator (or a State) pursuant to section 112 of the Act. Upon reconstruction, an affected source, or a stationary source that becomes an affected source, is subject to relevant standards for new sources, including compliance dates, irrespective of any change in emissions of hazardous air pollutants from that source.

Regulation promulgation schedule means the schedule for the promulgation of emission standards under this part, established by the Administrator pursuant to section 112(e) of the Act and published in the FEDERAL REGISTER.

Relevant standard means:

- (1) An emission standard;
- (2) An alternative emission standard;
- (3) An alternative emission limitation; or

(4) An equivalent emission limitation established pursuant to section 112 of the Act that applies to the stationary source, the group of stationary sources, or the portion of a stationary source regulated by such standard or limitation. A relevant standard may include or consist of a design, equipment, work practice, or operational requirement, or other measure, process, method, system, or technique (including prohibition of emissions) that the Administrator (or a State) establishes for new or existing sources to which such standard or limitation applies. Every relevant standard established pursuant to section 112 of the Act includes subpart A of this part and all applicable appendices of this part or of other parts of this chapter that are referenced in that standard.

Responsible official means one of the following:

(1) For a corporation: A president, secretary, treasurer, or vice president of the corporation in charge of a principal business function, or any other person who performs similar policy or decision-making functions for the corporation, or a duly authorized representative of such person if

the representative is responsible for the overall operation of one or more manufacturing, production, or operating facilities and either:

(i) The facilities employ more than 250 persons or have gross annual sales or expenditures exceeding \$25 million (in second quarter 1980 dollars); or

(ii) The delegation of authority to such representative is approved in advance by the Administrator.

(2) For a partnership or sole proprietorship: a general partner or the proprietor, respectively.

(3) For a municipality, State, Federal, or other public agency: either a principal executive officer or ranking elected official. For the purposes of this part, a principal executive officer of a Federal agency includes the chief executive officer having responsibility for the overall operations of a principal geographic unit of the agency (e.g., a Regional Administrator of the EPA).

(4) For affected sources (as defined in this part) applying for or subject to a title V permit: "responsible official" shall have the same meaning as defined in part 70 or Federal title V regulations in this chapter (42 U.S.C. 7661), whichever is applicable.

Run means one of a series of emission or other measurements needed to determine emissions for a representative operating period or cycle as specified in this part.

Shutdown means the cessation of operation of an affected source for any purpose.

Six-minute period means, with respect to opacity determinations, any one of the 10 equal parts of a 1-hour period.

Standard conditions means a temperature of 293 °K (68° F) and a pressure of 101.3 kilopascals (29.92 in. Hg).

Startup means the setting in operation of an affected source for any purpose.

State means all non-Federal authorities, including local agencies, interstate associations, and State-wide programs, that have delegated authority to implement:

(1) The provisions of this part and/or

(2) the permit program established under part 70 of this chapter. The term State shall have its conventional meaning where clear from the context.

Stationary source means any building, structure, facility, or installation which emits or may emit any air pollutant.

Test method means the validated procedure for sampling, preparing, and analyzing for an air pollutant specified in a relevant standard as the performance test procedure. The test method may include methods described in an appendix of this chapter, test methods incorporated by reference in this part, or methods validated for an application through procedures in Method 301 of appendix A of this part.

Title V permit means any permit issued, renewed, or revised pursuant to Federal or State regulations established to implement title V of the Act (42 U.S.C. 7661). A title V permit issued by a State permitting authority is called a part 70 permit in this part.

Visible emission means the observation of an emission of opacity or optical density above the threshold of vision.

§ 63.3 [Reserved]

§ 63.4 Prohibited activities and circumvention.

(a) *Prohibited activities.*

(1) No owner or operator subject to the provisions of this part shall operate any affected source in violation of the requirements of this part except under-

- (i) An extension of compliance granted by the Administrator under this part; or
- (ii) An extension of compliance granted under this part by a State with an approved permit program; or
- (iii) An exemption from compliance granted by the President under section 112(i)(4) of the Act.

(2) No owner or operator subject to the provisions of this part shall fail to keep records, notify, report, or revise reports as required under this part.

(3) After the effective date of an approved permit program in a State, no owner or operator of an affected source in that State who is required under this part to obtain a title V permit shall operate such source except in compliance with the provisions of this part and the applicable requirements of the permit program in that State.

(4) [Reserved]

(5) An owner or operator of an affected source who is subject to an emission standard promulgated under this part shall comply with the requirements of that standard by the date(s) established in the applicable subpart(s) of this part (including this subpart) regardless of whether -

- (i) A title V permit has been issued to that source; or
- (ii) If a title V permit has been issued to that source, whether such permit has been revised or modified to incorporate the emission standard.

(b) *Circumvention.* No owner or operator subject to the provisions of this part shall build, erect, install, or use any article, machine, equipment, or process to conceal an emission that would otherwise constitute noncompliance with a relevant standard. Such concealment includes, but is not limited to

- (1) The use of diluents to achieve compliance with a relevant standard based on the concentration of a pollutant in the effluent discharged to the atmosphere;
- (2) The use of gaseous diluents to achieve compliance with a relevant standard for visible emissions; and
- (3) The fragmentation of an operation such that the operation avoids regulation by a relevant standard.

(c) *Severability.* Notwithstanding any requirement incorporated into a title V permit obtained by an owner or operator subject to the provisions of this part, the provisions of this part are federally enforceable.

§ 63.5 Construction and reconstruction.

(a) *Applicability.*

(1) This section implements the preconstruction review requirements of section 112(i)(1) for sources subject to a relevant emission standard that has been promulgated in this part. In addition, this section includes other requirements for constructed and reconstructed stationary sources that are or become subject to a relevant promulgated emission standard.

(2) After the effective date of a relevant standard promulgated under this part, the requirements in this section apply to owners or operators who construct a new source or reconstruct a source after the proposal date of that standard. New or reconstructed sources that start up before the standard's effective date are not subject to the preconstruction review requirements specified in paragraphs (b)(3), (d), and (e) of this section.

(b) *Requirements for existing, newly constructed, and reconstructed sources.*

(1) Upon construction an affected source is subject to relevant standards for new sources, including compliance dates. Upon reconstruction, an affected source is subject to relevant standards for new sources, including compliance dates, irrespective of any change in emissions of hazardous air pollutants from that source.

(2) [Reserved]

(3) After the effective date of any relevant standard promulgated by the Administrator under this part, whether or not an approved permit program is effective in the State in which an affected source is (or would be) located, no person may construct a new major affected source or reconstruct a major affected source subject to such standard, or reconstruct a major source such that the source becomes a major affected source subject to the standard, without obtaining written approval, in advance, from the Administrator in accordance with the procedures specified in paragraphs (d) and (e) of this section.

(4) After the effective date of any relevant standard promulgated by the Administrator under this part, whether or not an approved permit program is effective in the State in which an affected source is (or would be) located, no person may construct a new affected source or reconstruct an affected source subject to such standard, or reconstruct a source such that the source becomes an affected source subject to the standard, without notifying the Administrator of the intended construction or reconstruction. The notification shall be submitted in accordance with the procedures in § 63.9(b) and shall include all the information required for an application for approval of construction or reconstruction as specified in paragraph (d) of this section. For major sources, the application for approval of construction or reconstruction may be used to fulfill the notification requirements of this paragraph.

(5) After the effective date of any relevant standard promulgated by the Administrator under this part, whether or not an approved permit program is effective in the State in which an affected source is located, no person may operate such source without complying with the provisions of this subpart and the relevant standard unless that person has received an extension of compliance or an exemption from compliance under § 63.6(i) or § 63.6(j) of this subpart.

(6) After the effective date of any relevant standard promulgated by the Administrator under this part, whether or not an approved permit program is effective in the State in which an affected source is located, equipment added (or a process change) to an affected source that is within the scope of the definition of affected source under the relevant standard shall be

considered part of the affected source and subject to all provisions of the relevant standard established for that affected source. If a new affected source is added to the facility, the new affected source shall be subject to all the provisions of the relevant standard that are established for new sources including compliance dates.

(c) [Reserved]

(d) *Application for approval of construction or reconstruction.*

Except information on control devices and control efficiencies should not be included in the application unless an add-on control system is or will be used to comply with subpart II in accordance with 40 CFR 63.783(c).

The provisions of this paragraph implement section 112(i)(1) of the Act.

(1) *General application requirements.*

(i) An owner or operator who is subject to the requirements of paragraph (b)(3) of this section shall submit to the Administrator an application for approval of the construction of a new major affected source, the reconstruction of a major affected source, or the reconstruction of a major source such that the source becomes a major affected source subject to the standard. The application shall be submitted as soon as practicable before the construction or reconstruction is planned to commence (but no sooner than the effective date of the relevant standard) if the construction or reconstruction commences after the effective date of a relevant standard promulgated in this part. The application shall be submitted as soon as practicable before startup but no later than 60 days after the effective date of a relevant standard promulgated in this part if the construction or reconstruction had commenced and initial startup had not occurred before the standard's effective date. The application for approval of construction or reconstruction may be used to fulfill the initial notification requirements of § 63.9(b)(5) of this subpart. The owner or operator may submit the application for approval well in advance of the date construction or reconstruction is planned to commence in order to ensure a timely review by the Administrator and that the planned commencement date will not be delayed.

(ii) A separate application shall be submitted for each construction or reconstruction. Each application for approval of construction or reconstruction shall include at a minimum:

- (A) The applicant's name and address;
- (B) A notification of intention to construct a new major affected source or make any physical or operational change to a major affected source that may meet or has been determined to meet the criteria for a reconstruction, as defined in § 63.2;
- (C) The address (i.e., physical location) or proposed address of the source;
- (D) An identification of the relevant standard that is the basis of the application;
- (E) The expected commencement date of the construction or reconstruction;
- (F) The expected completion date of the construction or reconstruction;
- (G) The anticipated date of (initial) startup of the source;
- (H) The type and quantity of hazardous air pollutants emitted by the source, reported in units and averaging times and in accordance with the test methods specified in the relevant standard, or if actual emissions data are not yet available, an estimate of the type and quantity of hazardous air pollutants expected to be emitted by the source reported in units and averaging times specified in the relevant standard. The owner or operator may submit percent reduction information if a relevant standard is established in terms of percent reduction. However, operating parameters, such as flow rate, shall be included in the submission to the extent that they demonstrate performance and compliance; and

(I) [Reserved]

(J) Other information as specified in paragraphs (d)(2) and (d)(3) of this section.

(iii) An owner or operator who submits estimates or preliminary information in place of the actual emissions data and analysis required in paragraphs (d)(1)(ii)(H) and (d)(2) of this section shall submit the actual, measured emissions data and other correct information as soon as available but no later than with the notification of compliance status required in § 63.9(h) (see § 63.9(h)(5)).

(2) *Application for approval of construction.* Each application for approval of construction shall include, in addition to the information required in paragraph (d)(1)(ii) of this section, technical information describing the proposed nature, size, design, operating design capacity, and method of operation of the source, including an identification of each point of emission for each hazardous air pollutant that is emitted (or could be emitted) and a description of the planned air pollution control system (equipment or method) for each emission point. The description of the equipment to be used for the control of emissions shall include each control device for each hazardous air pollutant and the estimated control efficiency (percent) for each control device. The description of the method to be used for the control of emissions shall include an estimated control efficiency (percent) for that method. Such technical information shall include calculations of emission estimates in sufficient detail to permit assessment of the validity of the calculations. An owner or operator who submits approximations of control efficiencies under this subparagraph shall submit the actual control efficiencies as specified in paragraph (d)(1)(iii) of this section.

(3) *Application for approval of reconstruction.* Each application for approval of reconstruction shall include, in addition to the information required in paragraph (d)(1)(ii) of this section -

(i) A brief description of the affected source and the components that are to be replaced;

(ii) A description of present and proposed emission control systems (i.e., equipment or methods). The description of the equipment to be used for the control of emissions shall include each control device for each hazardous air pollutant and the estimated control efficiency (percent) for each control device. The description of the method to be used for the control of emissions shall include an estimated control efficiency (percent) for that method. Such technical information shall include calculations of emission estimates in sufficient detail to permit assessment of the validity of the calculations;

(iii) An estimate of the fixed capital cost of the replacements and of constructing a comparable entirely new source;

(iv) The estimated life of the affected source after the replacements; and

(v) A discussion of any economic or technical limitations the source may have in complying with relevant standards or other requirements after the proposed replacements. The discussion shall be sufficiently detailed to demonstrate to the Administrator's satisfaction that the technical or economic limitations affect the source's ability to comply with the relevant standard and how they do so.

(vi) If in the application for approval of reconstruction the owner or operator designates the affected source as a reconstructed source and declares that there are no economic or technical limitations to prevent the source from complying with all relevant standards or other requirements, the owner or operator need not submit the information required in subparagraphs (d)(3) (iii) through (v) of this section, above.

(4) *Additional information.* The Administrator may request additional relevant information after the submittal of an application for approval of construction or reconstruction.

(e) Approval of construction or reconstruction.

(1) (i) If the Administrator determines that, if properly constructed, or reconstructed, and operated, a new or existing source for which an application under paragraph (d) of this section was submitted will not cause emissions in violation of the relevant standard(s) and any other federally enforceable requirements, the Administrator will approve the construction or reconstruction.

(ii) In addition, in the case of reconstruction, the Administrator's determination under this paragraph will be based on:

(A) The fixed capital cost of the replacements in comparison to the fixed capital cost that would be required to construct a comparable entirely new source;

(B) The estimated life of the source after the re-placements compared to the life of a comparable entirely new source;

(C) The extent to which the components being replaced cause or contribute to the emissions from the source; and

(D) Any economic or technical limitations on compliance with relevant standards that are inherent in the proposed replacements.

(2) (i) The Administrator will notify the owner or operator in writing of approval or intention to deny approval of construction or reconstruction within 60 calendar days after receipt of sufficient information to evaluate an application submitted under paragraph (d) of this section. The 60-day approval or denial period will begin after the owner or operator has been notified in writing that his/her application is complete. The Administrator will notify the owner or operator in writing of the status of his/her application, that is, whether the application contains sufficient information to make a determination, within 30 calendar days after receipt of the original application and within 30 calendar days after receipt of any supplementary information that is submitted.

(ii) When notifying the owner or operator that his/her application is not complete, the Administrator will specify the information needed to complete the application and provide notice of opportunity for the applicant to present, in writing, within 30 calendar days after he/she is notified of the incomplete application, additional information or arguments to the Administrator to enable further action on the application.

(3) Before denying any application for approval of construction or reconstruction, the Administrator will notify the applicant of the Administrator's intention to issue the denial together with -

(i) Notice of the information and findings on which the intended denial is based; and

(ii) Notice of opportunity for the applicant to present, in writing, within 30 calendar days after he/she is notified of the intended denial, additional information or arguments to the Administrator to enable further action on the application.

(4) A final determination to deny any application for approval will be in writing and will specify the grounds on which the denial is based. The final determination will be made within 60 calendar days of presentation of additional information or arguments (if the application is complete), or within 60 calendar days after the final date specified for presentation if no presentation is made.

(5) Neither the submission of an application for approval nor the Administrator's approval of construction or reconstruction shall -

(i) Relieve an owner or operator of legal responsibility for compliance with any applicable provisions of this part or with any other applicable Federal, State, or local requirement; or

(ii) Prevent the Administrator from implementing or enforcing this part or taking any other action under the Act.

(f) Approval of construction or reconstruction based on prior State preconstruction review.

(1) The Administrator may approve an application for construction or reconstruction specified in paragraphs (b)(3) and (d) of this section if the owner or operator of a new or reconstructed source who is subject to such requirement demonstrates to the Administrator's satisfaction that the following conditions have been (or will be) met:

(i) The owner or operator of the new or reconstructed source has undergone a preconstruction review and approval process in the State in which the source is (or would be) located before the promulgation date of the relevant standard and has received a federally enforceable construction permit that contains a finding that the source will meet the relevant emission standard as proposed, if the source is properly built and operated;

(ii) In making its finding, the State has considered factors substantially equivalent to those specified in paragraph (e)(1) of this section; and either

(iii) The promulgated standard is no more stringent than the proposed standard in any relevant aspect that would affect the Administrator's decision to approve or disapprove an application for approval of construction or reconstruction under this section; or

(iv) The promulgated standard is more stringent than the proposed standard but the owner or operator will comply with the standard as proposed during the 3-year period immediately following the effective date of the standard as allowed for in § 63.6(b)(3) of this subpart.

(2) The owner or operator shall submit to the Administrator the request for approval of construction or reconstruction under this paragraph no later than the application deadline specified in paragraph (d)(1) of this section (see also § 63.9(b)(2) of this subpart). The owner or operator shall include in the request information sufficient for the Administrator's determination. The Administrator will evaluate the owner or operator's request in accordance with the procedures specified in paragraph (e) of this section. The Administrator may request additional relevant information after the submittal of a request for approval of construction or reconstruction under this paragraph.

§ 63.6 Compliance with standards and maintenance requirements.

(a) Applicability.

(1) The requirements in this section apply to owners or operators of affected sources for which any relevant standard has been established pursuant to section 112 of the Act unless -

(i) The Administrator (or a State with an approved permit program) has granted an extension of compliance consistent with paragraph (i) of this section; or

(ii) The President has granted an exemption from compliance with any relevant standard in accordance with section 112(i)(4) of the Act.

(2) If an area source that otherwise would be subject to an emission standard or other requirement established under this part if it were a major source subsequently increases its emissions of hazardous air pollutants (or its potential to emit hazardous air pollutants) such that the source is a major source, such source shall be subject to the relevant emission standard or other requirement.

(b) Compliance dates for new and reconstructed sources.

(1) Except as specified in paragraphs (b)(3) and (b)(4) of this section, the owner or operator of a new or reconstructed source that has an initial startup before the effective date of a relevant standard established under this part pursuant to section 112(d), 112(f), or 112(h) of the Act shall comply with such standard not later than the standard's effective date.

(2) Except as specified in paragraphs (b)(3) and (b)(4) of this section, the owner or operator of a new or reconstructed source that has an initial startup after the effective date of a relevant standard established under this part pursuant to section 112(d), 112(f), or 112(h) of the Act shall comply with such standard upon startup of the source.

(3) The owner or operator of an affected source for which construction or reconstruction is commenced after the proposal date of a relevant standard established under this part pursuant to section 112(d), 112(f), or 112(h) of the Act but before the effective date (that is, promulgation) of such standard shall comply with the relevant emission standard not later than the date 3 years after the effective date if:

(i) The promulgated standard (that is, the relevant standard) is more stringent than the proposed standard; and

(ii) The owner or operator complies with the standard as proposed during the 3-year period immediately after the effective date.

(4) The owner or operator of an affected source for which construction or reconstruction is commenced after the proposal date of a relevant standard established pursuant to section 112(d) of the Act but before the proposal date of a relevant standard established pursuant to section 112(f)

shall comply with the emission standard under section 112(f) not later than the date 10 years after the date construction or reconstruction is commenced, except that, if the section 112(f) standard is promulgated more than 10 years after construction or reconstruction is commenced, the owner or operator shall comply with the standard as provided in paragraphs (b)(1) and (b)(2) of this section.

(5) The owner or operator of a new source that is subject to the compliance requirements of paragraph (b)(3) or paragraph (b)(4) of this section shall notify the Administrator in accordance with § 63.9(d) of this subpart.

(6) [Reserved]

(7) After the effective date of an emission standard promulgated under this part, the owner or operator of an unaffected new area source (i.e., an area source for which construction or reconstruction was commenced after the proposal date of the standard) that increases its emissions of (or its potential to emit) hazardous air pollutants such that the source becomes a major source that is subject to the emission standard, shall comply with the relevant emission standard immediately upon becoming a major source. This compliance date shall apply to new area sources that become affected major sources regardless of whether the new area source previously was affected by that standard. The new affected major source shall comply with all requirements of that standard that affect new sources.

(c) Compliance dates for existing sources.

Except 40 CFR 63.784(a) specifies the compliance date for existing affected sources.

(1) After the effective date of a relevant standard established under this part pursuant to section 112(d) or 112(h) of the Act, the owner or operator of an existing source shall comply with such standard by the compliance date established by the Administrator in the applicable subpart(s) of this part. Except as otherwise provided for in section 112 of the Act, in no case will the compliance date established for an existing source in an applicable subpart of this part exceed 3 years after the effective date of such standard.

(2) After the effective date of a relevant standard established under this part pursuant to section 112(f) of the Act, the owner or operator of an existing source shall comply with such standard not later than 90 days after the standard's effective date unless the Administrator has granted an extension to the source under paragraph (i)(4)(ii) of this section.

~~(3)-(4)~~ [Reserved]

(5) After the effective date of an emission standard promulgated under this part, the owner or operator of an unaffected existing area source that increases its emissions of (or its potential to emit) hazardous air pollutants such that the source becomes a major source that is subject to the emission standard shall comply by the date specified in the standard for existing area sources that become major sources. If no such compliance date is specified in the standard.

the source shall have a period of time to comply with the relevant emission standard that is equivalent to the compliance period specified in that standard for other existing sources. This compliance period shall apply to existing area sources that become affected major sources regardless of whether the existing area source previously was affected by that standard. Notwithstanding the previous two sentences, however, if the existing area source becomes a major source by the addition of a new affected source or by reconstructing, the portion of the existing facility that is a new affected source or a reconstructed source shall comply with all requirements of that standard that affect new sources, including the compliance date for new sources.

(d) [Reserved]

(e) Operation and maintenance requirements.

If an alternative means of limiting emissions (e.g., an add-on control system) is used to comply with subpart II in accordance with 40 CFR 63.783(c), then these paragraphs do apply.

(1) (i) At all times, including periods of startup, shutdown, and malfunction, owners or operators shall operate and maintain any affected source, including associated air pollution control equipment, in a manner consistent with good air pollution control practices for minimizing emissions at least to the levels required by all relevant standards.

(ii) Malfunctions shall be corrected as soon as practicable after their occurrence in accordance with the startup, shutdown, and malfunction plan required in paragraph (e)(3) of this section.

(iii) Operation and maintenance requirements established pursuant to section 112 of the Act are enforceable independent of emissions limitations or other requirements in relevant standards.

(2) Determination of whether acceptable operation and maintenance procedures are being used will be based on information available to the Administrator which may include, but is not limited to, monitoring results, review of operation and maintenance procedures (including the startup, shutdown, and malfunction plan required in paragraph (e)(3) of this section), review of operation and maintenance records, and inspection of the source.

(3) Startup, shutdown, and malfunction plan.

(i) The owner or operator of an affected source shall develop and implement a written startup, shutdown, and malfunction plan that describes, in detail, procedures for operating and maintaining the source during periods of startup, shutdown, and malfunction and a program of corrective action for malfunctioning process and air pollution control equipment used to comply with the relevant standard. As required under § 63.8(c)(1)(i), the plan shall identify all routine or otherwise predictable CMS malfunctions. This plan shall be developed by the owner or operator by the source's compliance date for that relevant standard. The plan shall be incorporated by reference into the source's title V permit. The purpose of the startup, shutdown, and malfunction plan is to -

(A) Ensure that, at all times, owners or operators operate and maintain affected sources, including associated air pollution control equipment, in a manner consistent with good air pollution control practices for minimizing emissions at least to the levels required by all relevant standards;

(B) Ensure that owners or operators are prepared to correct malfunctions as soon as practicable after their occurrence in order to minimize excess emissions of hazardous air pollutants; and

(C) Reduce the reporting burden associated with periods of startup, shutdown, and malfunction (including corrective action taken to restore malfunctioning process and air pollution control equipment to its normal or usual manner of operation).

(ii) During periods of startup, shutdown, and malfunction, the owner or operator of an affected source shall operate and maintain such source (including associated air pollution control equipment) in accordance with the procedures specified in the startup, shutdown, and malfunction plan developed under paragraph (e)(3)(i) of this section.

(iii) When actions taken by the owner or operator during a startup, shutdown, or malfunction (including actions taken to correct a malfunction) are consistent with the procedures specified in the affected source's startup, shutdown, and malfunction plan, the owner or operator shall keep records for that event that demonstrate that the procedures specified in the plan were followed. These records may take the form of a "checklist," or other effective form of recordkeeping, that confirms conformance with the startup, shutdown, and malfunction plan for that event. In addition, the owner or operator shall keep records of these events as specified in § 63.10(b) (and elsewhere in this part), including records of the occurrence and duration of each startup, shutdown, or malfunction of operation and each malfunction of the air pollution control equipment. Furthermore, the owner or operator shall confirm that actions taken during the relevant reporting period during periods of startup, shutdown, and malfunction were consistent with the affected source's startup, shutdown and malfunction plan in the semiannual (or more frequent) startup, shutdown, and malfunction report required in § 63.10(d)(5).

(iv) If an action taken by the owner or operator during a startup, shutdown, or malfunction (including an action taken to correct a malfunction) is not consistent with the procedures specified in the affected source's startup, shutdown, and malfunction plan, the owner or operator shall record the actions taken for that event and shall report such actions within 2 working days after commencing actions inconsistent with the plan, followed by a letter within 7 working days after the end of the event, in accordance with § 63.10(d)(5) (unless the owner or operator makes alternative reporting arrangements, in advance, with the Administrator (see § 63.10(d)(5)(ii))).

(v) The owner or operator shall keep the written startup, shutdown, and malfunction plan on record after it is developed to be made available for inspection, upon request, by the Administrator for the life of the affected source or until the affected source is no longer subject to the provisions of this part. In addition, if the startup, shutdown, and malfunction plan is revised, the owner or operator shall keep previous (i.e., superseded) versions of the startup, shutdown, and malfunction plan on record, to be made available for inspection, upon request, by the Administrator, for a period of 5 years after each revision to the plan.

(vi) To satisfy the requirements of this section to develop a startup, shutdown, and malfunction plan, the owner or operator may use the affected source's standard operating procedures (SOP) manual, or an Occupational Safety and Health Administration (OSHA) or other plan, provided the alternative plans meet all the requirements of this section and are made available for inspection when requested by the Administrator.

(vii) Based on the results of a determination made under paragraph (e)(2) of this section, the Administrator may require that an owner or operator of an affected source make changes to the startup, shutdown, and malfunction plan for that source. The Administrator may require reasonable revisions to a startup, shutdown, and malfunction plan, if the Administrator finds that the plan:

(A) Does not address a startup, shutdown, or malfunction event that has occurred;

(B) Fails to provide for the operation of the source (including associated air pollution control equipment) during a startup, shutdown, or malfunction event in a manner consistent with good air pollution control practices for minimizing emissions at least to the levels required by all relevant standards; or

(C) Does not provide adequate procedures for correcting malfunctioning process and/or air pollution control equipment as quickly as practicable.

(viii) If the startup, shutdown, and malfunction plan fails to address or inadequately addresses an event that meets the characteristics of a malfunction but was not included in the startup, shutdown, and malfunction plan at the time the owner or operator developed the plan, the owner or operator shall revise the startup, shutdown, and malfunction plan within 45 days after the event to include detailed procedures for operating and maintaining the source during similar malfunction events and a program of corrective action for similar malfunctions of process or air pollution control equipment.

(f) *Compliance with nonopacity emission standards -*

If an alternative means of limiting emissions (e.g., an add-on control system) is used to comply with subpart II in accordance with 40 CFR 63.783(c), then these paragraphs do apply.

(1) *Applicability.* The nonopacity emission standards set forth in this part shall apply at all times except during periods of startup, shutdown, and malfunction, and as otherwise specified in an applicable subpart.

(2) *Methods for determining compliance.*

(i) The Administrator will determine compliance with nonopacity emission standards in this part based on the results of performance tests conducted according to the procedures in § 63.7, unless otherwise specified in an applicable subpart of this part.

(ii) The Administrator will determine compliance with nonopacity emission standards in this part by evaluation of an owner or operator's conformance with operation and maintenance requirements, including the evaluation of monitoring data, as specified in § 63.6(e) and applicable subparts of this part.

(iii) If an affected source conducts performance testing at startup to obtain an operating permit in the State in which the source is located, the results of such testing may be used to demonstrate compliance with a relevant standard if -

(A) The performance test was conducted within a reasonable amount of time before an initial performance test is required to be conducted under the relevant standard;

(B) The performance test was conducted under representative operating conditions for the source;

(C) The performance test was conducted and the resulting data were reduced using EPA-approved test methods and procedures, as specified in § 63.7(e) of this subpart; and

(D) The performance test was appropriately quality-assured, as specified in § 63.7(c) of this subpart.

(iv) The Administrator will determine compliance with design, equipment, work practice, or operational emission standards in this part by review of records, inspection of the source, and other procedures specified in applicable subparts of this part.

(v) The Administrator will determine compliance with design, equipment, work practice, or operational emission standards in this part by evaluation of an owner or operator's conformance with operation and maintenance requirements, as specified in paragraph (e) of this section and applicable subparts of this part.

(3) *Finding of compliance.* The Administrator will make a finding concerning an affected source's compliance with a nonopacity emission standard, as specified in paragraphs (f)(1) and (f)(2) of this section, upon obtaining all the compliance information required by the relevant standard (including the written reports of performance test results, monitoring results, and other information, if applicable) and any information available to the Administrator needed to determine whether proper operation and maintenance practices are being used.

(g) *Use of an alternative nonopacity emission standard.*

40 CFR 63.783(c) specifies procedures for application and approval of alternative means of limiting emissions.

(1) If, in the Administrator's judgment, an owner or operator of an affected source has established that an alternative means of emission limitation will achieve a reduction in emissions of

a hazardous air pollutant from an affected source at least equivalent to the reduction in emissions of that pollutant from that source achieved under any design, equipment, work practice, or operational emission standard, or combination thereof, established under this part pursuant to section 112(h) of the Act, the Administrator will publish in the FEDERAL REGISTER a notice permitting the use of the alternative emission standard for purposes of compliance with the promulgated standard. Any FEDERAL REGISTER notice under this paragraph shall be published only after the public is notified and given the opportunity to comment. Such notice will restrict the permission to the stationary source(s) or category(ies) of sources from which the alternative emission standard will achieve equivalent emission reductions. The Administrator will condition permission in such notice on requirements to assure the proper operation and maintenance of equipment and practices required for compliance with the alternative emission standard and other requirements, including appropriate quality assurance and quality control requirements, that are deemed necessary.

(2) An owner or operator requesting permission under this paragraph shall, unless otherwise specified in an applicable subpart, submit a proposed test plan or the results of testing and monitoring in accordance with § 63.7 and § 63.8, a description of the procedures followed in testing or monitoring, and a description of pertinent conditions during testing or monitoring. Any testing or monitoring conducted to request permission to use an alternative nonopacity emission standard shall be appropriately quality assured and quality controlled, as specified in § 63.7 and § 63.8.

(3) The Administrator may establish general procedures in an applicable subpart that accomplish the requirements of paragraphs (g)(1) and (g)(2) of this section.

(h) *Compliance with opacity and visible emission standards -*

Subpart II does not contain any opacity or visible emission standards.

(i) *Extension of compliance with emission standards.*

(1) Until an extension of compliance has been granted by the Administrator (or a State with an approved permit program) under this paragraph, the owner or operator of an affected source subject to the requirements of this section shall comply with all applicable requirements of this part.

(2) *Extension of compliance for early reductions and other reductions*

(i) *Early reductions.* Pursuant to section 112(i)(5) of the Act, if the owner or operator of an existing source demonstrates that the source has achieved a reduction in emissions of hazardous air pollutants in accordance with the provisions of subpart D of this part, the Administrator (or the State with an approved permit program) will grant the owner or operator an extension of compliance with specific requirements of this part, as specified in subpart D.

(ii) *Other reductions.* Pursuant to section 112(i)(6) of the Act, if the owner or operator of an existing source has installed best available control technology (BACT) (as defined in section 169(3) of the Act) or technology required to meet a lowest achievable emission rate (LAER) (as defined in section 171 of the Act) prior to the promulgation of an emission standard in this part applicable to such source and the same pollutant (or stream of pollutants) controlled pursuant to the BACT or LAER installation, the Administrator will grant the owner or operator an

extension of compliance with such emission standard that will apply until the date 5 years after the date on which such installation was achieved, as determined by the Administrator.

(3) *Request for extension of compliance.* Paragraphs (i)(4) through (i)(7) of this section concern requests for an extension of compliance with a relevant standard under this part (except requests for an extension of compliance under paragraph (i)(2)(i) of this section will be handled through procedures specified in subpart D of this part).

(4) (i) (A) The owner or operator of an existing source who is unable to comply with a relevant standard established under this part pursuant to section 112(d) of the Act may request that the Administrator (or a State, when the State has an approved part 70 permit program and the source is required to obtain a part 70 permit under that program, or a State, when the State has been delegated the authority to implement and enforce the emission standard for that source) grant an extension allowing the source up to 1 additional year to comply with the standard, if such additional period is necessary for the installation of controls. An additional extension of up to 3 years may be added for mining waste operations, if the 1-year extension of compliance is insufficient to dry and cover mining waste in order to reduce emissions of any hazardous air pollutant. The owner or operator of an affected source who has requested an extension of compliance under this paragraph and who is otherwise required to obtain a title V permit shall apply for such permit or apply to have the source's title V permit revised to incorporate the conditions of the extension of compliance. The conditions of an extension of compliance granted under this paragraph will be incorporated into the affected source's title V permit according to the provisions of part 70 or Federal title V regulations in this chapter (42 U.S.C. 7661), whichever are applicable.

(B) Any request under this paragraph for an extension of compliance with a relevant standard shall be submitted in writing to the appropriate authority not later than 12 months before the affected source's compliance date (as specified in paragraphs (b) and (c) of this section) for sources that are not including emission points in an emissions average, or not later than 18 months before the affected source's compliance date (as specified in paragraphs (b) and (c) of this section) for sources that are including emission points in an emissions average. Emission standards established under this part may specify alternative dates for the submittal of requests for an extension of compliance if alternatives are appropriate for the source categories affected by those standards, e.g., a compliance date specified by the standard is less than 12 (or 18) months after the standard's effective date.

(ii) The owner or operator of an existing source unable to comply with a relevant standard established under this part pursuant to section 112(f) of the Act may request that the Administrator grant an extension allowing the source up to 2 years after the standard's effective date to comply with the standard. The Administrator may grant such an extension if he/she finds that such additional period is necessary for the installation of controls and that steps will be taken during the period of the extension to assure that the health of persons will be protected from imminent endangerment. Any request for an extension of compliance with a relevant standard under this paragraph shall be submitted in writing to the Administrator not later than 15 calendar days after the effective date of the relevant standard.

(5) The owner or operator of an existing source that has installed BACT or technology required to meet LAER [as specified in paragraph (i)(2)(ii) of this section] prior to the promulgation of a relevant emission standard in this part may request that the Administrator grant an extension allowing the source 5 years from the date on which such installation was achieved, as determined by the Administrator, to comply with the standard. Any request for an extension of compliance with a relevant standard under this paragraph shall be submitted in writing to the Administrator not later than 120 days after the promulgation date of the standard. The Administrator may grant such an extension if he or she finds that the installation of BACT or technology to meet LAER controls the same pollutant (or stream of pollutants) that would be controlled at that source by the relevant emission standard.

(6) (i) The request for a compliance extension under paragraph (i)(4) of this section shall include the following information:

(A) A description of the controls to be installed to comply with the standard;

(B) A compliance schedule, including the date by which each step toward compliance will be reached. At a minimum, the list of dates shall include:

(1) The date by which contracts for emission control systems or process changes for emission control will be awarded, or the date by which orders will be issued for the purchase of component parts to accomplish emission control or process changes;

(2) The date by which on-site construction, installation of emission control equipment, or a process change is to be initiated;

(3) The date by which on-site construction, installation of emission control equipment, or a process change is to be completed; and

(4) The date by which final compliance is to be achieved;

(C) A description of interim emission control steps that will be taken during the extension period, including milestones to assure proper operation and maintenance of emission control and process equipment; and

(D) Whether the owner or operator is also requesting an extension of other applicable requirements (e.g., performance testing requirements).

(ii) The request for a compliance extension under paragraph (i)(5) of this section shall include all information needed to demonstrate to the Administrator's satisfaction that the installation of BACT or technology to meet LAER controls the same pollutant (or stream of pollutants) that would be controlled at that source by the relevant emission standard.

(7) Advice on requesting an extension of compliance may be obtained from the Administrator (or the State with an approved permit program).

(8) *Approval of request for extension of compliance.* Paragraphs (i)(9) through (i)(14) of this section concern approval of an extension of compliance requested under paragraphs (i)(4) through (i)(6) of this section.

(9) Based on the information provided in any request made under paragraphs (i)(4) through (i)(6) of this section, or other information, the Administrator (or the State with an approved permit program) may grant an extension of compliance with an emission standard, as specified in paragraphs (i)(4) and (i)(5) of this section.

(10) The extension will be in writing and will -

(i) Identify each affected source covered by the extension;

(ii) Specify the termination date of the extension;

(iii) Specify the dates by which steps toward compliance are to be taken, if appropriate;

(iv) Specify other applicable requirements to which the compliance extension applies (e.g., performance tests); and

(v) (A) Under paragraph (i)(4), specify any additional conditions that the Administrator (or the State) deems necessary to assure installation of the necessary controls and protection of the health of persons during the extension period; or

(B) Under paragraph (i)(5), specify any additional conditions that the Administrator deems necessary to assure the proper operation and maintenance of the installed controls during the extension period.

(11) The owner or operator of an existing source that has been granted an extension of compliance under paragraph (i)(10) of this section may be required to submit to the Administrator (or the State with an approved permit program) progress reports indicating whether the steps toward compliance outlined in the compliance schedule have been reached. The contents of the progress reports and the dates by which they shall be submitted will be specified in the written extension of compliance granted under paragraph (i)(10) of this section.

(12) (i) The Administrator (or the State with an approved permit program) will notify the owner or operator in writing of approval or intention to deny approval of a request for an extension of compliance within 30 calendar days after receipt of sufficient information to evaluate a request submitted under paragraph (i)(4)(i) or (i)(5) of this section. The 30-day approval or denial period will begin after the owner or operator has been notified in writing that his/her application is complete. The Administrator (or the State) will notify the owner or operator in writing of the status of his/her application, that is, whether the application contains sufficient information to make a determination, within 30 calendar days after receipt of the original application and within 30 calendar days after receipt of any supplementary information that is submitted.

(ii) When notifying the owner or operator that his/her application is not complete, the Administrator will specify the information needed to complete the application and provide notice of opportunity for the applicant to present, in writing, within 30 calendar days after he/she is notified of the incomplete application, additional information or arguments to the Administrator to enable further action on the application.

(iii) Before denying any request for an extension of compliance, the Administrator (or the State with an approved permit program) will notify the owner or operator in writing of the Administrator's (or the State's) intention to issue the denial, together with -

(A) Notice of the information and findings on which the intended denial is based; and

(B) Notice of opportunity for the owner or operator to present in writing, within 15 calendar days after he/she is notified of the intended denial, additional information or arguments to the Administrator (or the State) before further action on the request.

(iv) The Administrator's final determination to deny any request for an extension will be in writing and will set forth the specific grounds on which the denial is based. The final determination will be made within 30 calendar days after presentation of additional information or argument (if the application is complete), or within 30 calendar days after the final date specified for the presentation if no presentation is made.

(13) (i) The Administrator will notify the owner or operator in writing of approval or intention to deny approval of a request for an extension of compliance within 30 calendar days after receipt of sufficient information to evaluate a request submitted under paragraph (i)(4)(ii) of this section. The 30-day approval or denial period will begin after the owner or operator has been notified in writing that his/her application is complete. The Administrator (or the State) will notify the owner or operator in writing of the status of his/her application, that is, whether the application contains sufficient information to make a determination, within 15 calendar days after receipt of the original application and within 15 calendar days after receipt of any supplementary information that is submitted.

(ii) When notifying the owner or operator that his/her application is not complete, the Administrator will specify the information needed to complete the application and provide notice of opportunity for the applicant to present, in writing, within 15 calendar days after he/she is notified of the incomplete application, additional information or arguments to the Administrator to enable further action on the application.

(iii) Before denying any request for an extension of compliance, the Administrator will notify the owner or operator in writing of the Administrator's intention to issue the denial, together with -

(A) Notice of the information and findings on which the intended denial is based; and

(B) Notice of opportunity for the owner or operator to present in writing, within 15 calendar days after he/she is notified of the intended denial, additional information or arguments to the Administrator before further action on the request.

(iv) A final determination to deny any request for an extension will be in writing and will set forth the specific grounds on which the denial is based. The final determination will be made within 30 calendar days after presentation of additional information or argument (if the application is complete), or within 30 calendar days after the final date specified for the presentation if no presentation is made.

(14) The Administrator (or the State with an approved permit program) may terminate an extension of compliance at an earlier date than specified if any specification under paragraphs (i)(10)(iii) or (i)(10)(iv) of this section is not met.

(15) [Reserved]

(16) The granting of an extension under this section shall not abrogate the Administrator's authority under section 114 of the Act.

(j) *Exemption from compliance with emission standards.* The President may exempt any stationary source from compliance with any relevant standard established pursuant to section 112 of the Act for a period of not more than 2 years if the President determines that the technology to implement such standard is not available and that it is in the national security interests of the United States to do so. An exemption under this paragraph may be extended for 1 or more additional periods, each period not to exceed 2 years.

§ 63.7 Performance testing requirements.

If an alternative means of limiting emissions (e.g., an add-on control system) is used to comply with subpart II in accordance with 40 CFR 63.783(c), then this section does apply.

(a) *Applicability and performance test dates.*

(1) Unless otherwise specified, this section applies to the owner or operator of an affected source required to do performance testing, or another form of compliance demonstration, under a relevant standard.

(2) If required to do performance testing by a relevant standard, and unless a waiver of performance testing is obtained under this section or the conditions of paragraph (c)(3)(ii)(B) of this section apply, the owner or operator of the affected source shall perform such tests as follows

(i) Within 180 days after the effective date of a relevant standard for a new source that has an initial startup date before the effective date; or

(ii) Within 180 days after initial startup for a new source that has an initial startup date after the effective date of a relevant standard; or

(iii) Within 180 days after the compliance date specified in an applicable subpart of this part for an existing source subject to an emission standard established pursuant to section 112(d) of the Act, or within 180 days after startup of an existing source if the source begins operation after the effective date of the relevant emission standard; or

(iv) Within 180 days after the compliance date for an existing source subject to an emission standard established pursuant to section 112(f) of the Act; or

(v) Within 180 days after the termination date of the source's extension of compliance for an existing source that obtains an extension of compliance under § 63.6(i); or

(vi) Within 180 days after the compliance date for a new source, subject to an emission standard established pursuant to section 112(f) of the Act, for which construction or reconstruction is commenced after the proposal date of a relevant standard established pursuant to section 112(d) of the Act but before the proposal date of the relevant standard established pursuant to section 112(f) [see § 63.6(b)(4)]; or

(vii) [Reserved]; or (viii) [Reserved]; or

(ix) When an emission standard promulgated under this part is more stringent than the standard proposed (see § 63.6(b)(3)), the owner or operator of a new or reconstructed source subject to that standard for which construction or reconstruction is commenced between

the proposal and promulgation dates of the standard shall comply with performance testing requirements within 180 days after the standard's effective date, or within 180 days after startup of the source, whichever is later. If the promulgated standard is more stringent than the proposed standard, the owner or operator may choose to demonstrate compliance with either the proposed or the promulgated standard. If the owner or operator chooses to comply with the proposed standard initially, the owner or operator shall conduct a second performance test within 3 years and 180 days after the effective date of the standard, or after startup of the source, whichever is later, to demonstrate compliance with the promulgated standard.

(3) The Administrator may require an owner or operator to conduct performance tests at the affected source at any other time when the action is authorized by section 114 of the Act.

(b) Notification of performance test.

(1) The owner or operator of an affected source shall notify the Administrator in writing of his or her intention to conduct a performance test at least 60 calendar days before the performance test is scheduled to begin to allow the Administrator, upon request, to review and approve the site-specific test plan required under paragraph (c) of this section and to have an observer present during the test. Observation of the performance test by the Administrator is optional.

(2) In the event the owner or operator is unable to conduct the performance test on the date specified in the notification requirement specified in paragraph (b)(1) of this section, due to unforeseeable circumstances beyond his or her control, the owner or operator shall notify the Administrator within 5 days prior to the scheduled performance test date and specify the date when the performance test is rescheduled. This notification of delay in conducting the performance test shall not relieve the owner or operator of legal responsibility for compliance with any other applicable provisions of this part or with any other applicable Federal, State, or local requirement, nor will it prevent the Administrator from implementing or enforcing this part or taking any other action under the Act.

(c) Quality assurance program.

(1) The results of the quality assurance program required in this paragraph will be considered by the Administrator when he/she determines the validity of a performance test.

(2) (i) *Submission of site-specific test plan.* Before conducting a required performance test, the owner or operator of an affected source shall develop and, if requested by the Administrator, shall submit a site-specific test plan to the Administrator for approval. The test plan shall include a test program summary, the test schedule, data quality objectives, and both an internal and external quality assurance (QA) program. Data quality objectives are the pretest expectations of precision, accuracy, and completeness of data.

(ii) The internal QA program shall include, at a minimum, the activities planned by routine operators and analysts to provide an assessment of test data precision; an example of internal QA is the sampling and analysis of replicate samples.

(iii) The external QA program shall include, at a minimum, application of plans for a test method performance audit (PA) during the performance test. The PA's consist of blind audit samples provided by the Administrator and analyzed during the performance test in order to provide a measure of test data bias. The external QA program may also include systems audits that include the opportunity for on-site evaluation by the Administrator of instrument calibration, data validation, sample logging, and documentation of quality control data and field maintenance activities.

(iv) The owner or operator of an affected source shall submit the site-specific test plan to the Administrator upon the Administrator's request at least 60 calendar days before the performance test is scheduled to take place, that is, simultaneously with the notification of

intention to conduct a performance test required under paragraph (b) of this section, or on a mutually agreed upon date.

(v) The Administrator may request additional relevant information after the submittal of a site-specific test plan.

(3) *Approval of site-specific test plan.*

(i) The Administrator will notify the owner or operator of approval or intention to deny approval of the site-specific test plan (if review of the site-specific test plan is requested) within 30 calendar days after receipt of the original plan and within 30 calendar days after receipt of any supplementary information that is submitted under paragraph (c)(3)(i)(B) of this section. Before disapproving any site-specific test plan, the Administrator will notify the applicant of the Administrator's intention to disapprove the plan together with -

(A) Notice of the information and findings on which the intended disapproval is based; and

(B) Notice of opportunity for the owner or operator to present, within 30 calendar days after he/she is notified of the intended disapproval, additional information to the Administrator before final action on the plan.

(ii) In the event that the Administrator fails to approve or disapprove the site-specific test plan within the time period specified in paragraph (c)(3)(i) of this section, the following conditions shall apply:

(A) If the owner or operator intends to demonstrate compliance using the test method(s) specified in the relevant standard, the owner or operator shall conduct the performance test within the time specified in this section using the specified method(s);

(B) If the owner or operator intends to demonstrate compliance by using an alternative to any test method specified in the relevant standard, the owner or operator shall refrain from conducting the performance test until the Administrator approves the use of the alternative method when the Administrator approves the site-specific test plan (if review of the site-specific test plan is requested) or until after the alternative method is approved (see paragraph (f) of this section). If the Administrator does not approve the site-specific test plan (if review is requested) or the use of the alternative method within 30 days before the test is scheduled to begin, the performance test dates specified in paragraph (a) of this section may be extended such that the owner or operator shall conduct the performance test within 60 calendar days after the Administrator approves the site-specific test plan or after use of the alternative method is approved. Notwithstanding the requirements in the preceding two sentences, the owner or operator may proceed to conduct the performance test as required in this section (without the Administrator's prior approval of the site-specific test plan) if he/she subsequently chooses to use the specified testing and monitoring methods instead of an alternative.

(iii) Neither the submission of a site-specific test plan for approval, nor the Administrator's approval or disapproval of a plan, nor the Administrator's failure to approve or disapprove a plan in a timely manner shall -

(A) Relieve an owner or operator of legal responsibility for compliance with any applicable provisions of this part or with any other applicable Federal, State, or local requirement; or

(B) Prevent the Administrator from implementing or enforcing this part or taking any other action under the Act.

(4) (i) *Performance test method audit program.* The owner or operator shall analyze performance audit (PA) samples during each performance test. The owner or operator shall request performance audit materials 45 days prior to the test date. Cylinder audit gases may be obtained by contacting the Cylinder Audit Coordinator, Quality Assurance Division (MD-77B), Atmospheric Research and Exposure Assessment Laboratory (AREAL), U.S. EPA, Research Triangle Park, North Carolina 27711. All other audit materials may be obtained by contacting the

Source Test Audit Coordinator, Quality Assurance Division (MD-77B), AREAL, U.S. EPA, Research Triangle Park, North Carolina 27711.

(ii) The Administrator will have sole discretion to require any subsequent remedial actions of the owner or operator based on the PA results.

(iii) If the Administrator fails to provide required PA materials to an owner or operator of an affected source in time to analyze the PA samples during a performance test, the requirement to conduct a PA under this paragraph shall be waived for such source for that performance test. Waiver under this paragraph of the requirement to conduct a PA for a particular performance test does not constitute a waiver of the requirement to conduct a PA for future required performance tests.

(d) *Performance testing facilities.* If required to do performance testing, the owner or operator of each new source and, at the request of the Administrator, the owner or operator of each existing source, shall provide performance testing facilities as follows:

(1) Sampling ports adequate for test methods applicable to such source. This includes:

(i) Constructing the air pollution control system such that volumetric flow rates and pollutant emission rates can be accurately determined by applicable test methods and procedures; and

(ii) Providing a stack or duct free of cyclonic flow during performance tests, as demonstrated by applicable test methods and procedures;

(2) Safe sampling platform(s);

(3) Safe access to sampling platform(s);

(4) Utilities for sampling and testing equipment; and

(5) Any other facilities that the Administrator deems necessary for safe and adequate testing of a source.

(e) *Conduct of performance tests.*

(1) Performance tests shall be conducted under such conditions as the Administrator specifies to the owner or operator based on representative performance (i.e., performance based on normal operating conditions) of the affected source. Operations during periods of startup, shutdown, and malfunction shall not constitute representative conditions for the purpose of a performance test, nor shall emissions in excess of the level of the relevant standard during periods of startup, shutdown, and malfunction be considered a violation of the relevant standard unless otherwise specified in the relevant standard or a determination of noncompliance is made under § 63.6(e). Upon request, the owner or operator shall make available to the Administrator such records as may be necessary to determine the conditions of performance tests.

(2) Performance tests shall be conducted and data shall be reduced in accordance with the test methods and procedures set forth in this section, in each relevant standard, and, if required, in applicable appendices of parts 51, 60, 61, and 63 of this chapter unless the Administrator -

(i) Specifies or approves, in specific cases, the use of a test method with minor changes in methodology; or

(ii) Approves the use of an alternative test method, the results of which the Administrator has determined to be adequate for indicating whether a specific affected source is in compliance; or

(iii) Approves shorter sampling times and smaller sample volumes when necessitated by process variables or other factors; or

(iv) Waives the requirement for performance tests because the owner or operator of an affected source has demonstrated by other means to the Administrator's satisfaction that the affected source is in compliance with the relevant standard.

(3) Unless otherwise specified in a relevant standard or test method, each performance test

shall consist of three separate runs using the applicable test method. Each run shall be conducted for the time and under the conditions specified in the relevant standard. For the purpose of determining compliance with a relevant standard, the arithmetic mean of the results of the three runs shall apply. Upon receiving approval from the Administrator, results of a test run may be replaced with results of an additional test run in the event that

- (i) A sample is accidentally lost after the testing team leaves the site; or
 - (ii) Conditions occur in which one of the three runs must be discontinued because of forced shutdown; or
 - (iii) Extreme meteorological conditions occur; or
 - (iv) Other circumstances occur that are beyond the owner or operator's control.
- (4) Nothing in paragraphs (e)(1) through (e)(3) of this section shall be construed to abrogate the Administrator's authority to require testing under section 114 of the Act.

(f) Use of an alternative test method -

(1) *General.* Until permission to use an alternative test method has been granted by the Administrator under this paragraph, the owner or operator of an affected source remains subject to the requirements of this section and the relevant standard.

(2) The owner or operator of an affected source required to do performance testing by a relevant standard may use an alternative test method from that specified in the standard provided that the owner or operator -

(i) Notifies the Administrator of his or her intention to use an alternative test method not later than with the submittal of the site-specific test plan (if requested by the Administrator) or at least 60 days before the performance test is scheduled to begin if a site-specific test plan is not submitted;

(ii) Uses Method 301 in appendix A of this part to validate the alternative test method; and

(iii) Submits the results of the Method 301 validation process along with the notification of intention and the justification for not using the specified test method. The owner or operator may submit the information required in this paragraph well in advance of the deadline specified in paragraph (f)(2)(i) of this section to ensure a timely review by the Administrator in order to meet the performance test date specified in this section or the relevant standard.

(3) The Administrator will determine whether the owner or operator's validation of the proposed alternative test method is adequate when the Administrator approves or disapproves the site-specific test plan required under paragraph (c) of this section. If the Administrator finds reasonable grounds to dispute the results obtained by the Method 301 validation process, the Administrator may require the use of a test method specified in a relevant standard.

(4) If the Administrator finds reasonable grounds to dispute the results obtained by an alternative test method for the purposes of demonstrating compliance with a relevant standard, the Administrator may require the use of a test method specified in a relevant standard.

(5) If the owner or operator uses an alternative test method for an affected source during a required performance test, the owner or operator of such source shall continue to use the alternative test method for subsequent performance tests at that affected source until he or she receives approval from the Administrator to use another test method as allowed under § 63.7(f).

(6) Neither the validation and approval process nor the failure to validate an alternative test method shall abrogate the owner or operator's responsibility to comply with the requirements of this part.

(g) Data analysis, recordkeeping, and reporting.

(1) Unless otherwise specified in a relevant standard or test method, or as otherwise approved by the Administrator in writing, results of a performance test shall include the analysis of samples, determination of emissions, and raw data. A performance test is "completed" when

field sample collection is terminated. The owner or operator of an affected source shall report the results of the performance test to the Administrator before the, close of business on the 60th day following the completion of the performance test, unless specified otherwise in a relevant standard or as approved otherwise in writing by the Administrator (see § 63.9(i)). The results of the performance test shall be submitted as part of the notification of compliance status required under § 63.9(h). Before a title V permit has been issued to the owner or operator of an affected source, the owner or operator shall send the results of the performance test to the Administrator. After a title V permit has been issued to the owner or operator of an affected source, the owner or operator shall send the results of the performance test to the appropriate permitting authority.

(2) [Reserved]

(3) For a minimum of 5 years after a performance test is conducted, the owner or operator shall retain and make available, upon request, for inspection by the Administrator the records or results of such performance test and other data needed to determine emissions from an affected source.

(h) *Waiver of performance tests.*

(1) Until a waiver of a performance testing requirement has been granted by the Administrator under this paragraph, the owner or operator of an affected source remains subject to the requirements of this section.

(2) Individual performance tests may be waived upon written application to the Administrator if, in the Administrator's judgment, the source is meeting the relevant standard(s) on a continuous basis, or the source is being operated under an extension of compliance, or the owner or operator has requested an extension of compliance and the Administrator is still considering that request.

(3) Request to waive a performance test.

(i) If a request is made for an extension of compliance under § 63.6(i), the application for a waiver of an initial performance test shall accompany the information required for the request for an extension of compliance. If no extension of compliance is requested or if the owner or operator has requested an extension of compliance and the Administrator is still considering that request, the application for a waiver of an initial performance test shall be submitted at least 60 days before the performance test if the site-specific test plan under paragraph (c) of this section is not submitted.

(ii) If an application for a waiver of a subsequent performance test is made, the application may accompany any required compliance progress report, compliance status report, or excess emissions and continuous monitoring system performance report [such as those required under § 63.6(I), § 63.9(h), and § 63.10(e) or specified in a relevant standard or in the source's title V permit], but it shall be submitted at least 60 days before the performance test if the site-specific test plan required under paragraph (c) of this section is not submitted.

(iii) Any application for a waiver of a performance test shall include information justifying the owner or operator's request for a waiver, such as the technical or economic infeasibility, or the impracticality, of the affected source performing the required test.

(4) Approval of request to waive performance test. The Administrator will approve or deny a request for a waiver of a performance test made under paragraph (h)(3) of this section when he/she -

(i) Approves or denies an extension of compliance under § 63.6(i)(8); or

(ii) Approves or disapproves a site-specific test plan under § 63.7(c)(3); or

(iii) Makes a determination of compliance following the submission of a required compliance status report or excess emissions and continuous monitoring systems performance report; or

(iv) Makes a determination of suitable progress towards compliance following the submission of a compliance progress report, whichever is applicable.

(5) Approval of any waiver granted under this section shall not abrogate the Administrator's authority under the Act or in any way prohibit the Administrator from later canceling the waiver. The cancellation will be made only after notice is given to the owner or operator of the affected source.

§ 63.8 Monitoring requirements.

If an alternative means of limiting emissions (e.g., an add-on control system) is used to comply with subpart II in accordance with 40 CFR 63.783(c), then this section does apply.

(a) Applicability.

(1) (i) Unless otherwise specified in a relevant standard, this section applies to the owner or operator of an affected source required to do monitoring under that standard.

(ii) Relevant standards established under this part will specify monitoring systems, methods, or procedures, monitoring frequency, and other pertinent requirements for source(s) regulated by those standards. This section specifies general monitoring requirements such as those governing the conduct of monitoring and requests to use alternative monitoring methods. In addition, this section specifies detailed requirements that apply to affected sources required to use continuous monitoring systems (CMS) under a relevant standard.

(2) For the purposes of this part, all CMS required under relevant standards shall be subject to the provisions of this section upon promulgation of performance specifications for CMS as specified in the relevant standard or otherwise by the Administrator.

(3) [Reserved]

(4) Additional monitoring requirements for control devices used to comply with provisions in relevant standards of this part are specified in § 63.11.

(b) Conduct of monitoring.

(1) Monitoring shall be conducted as set forth in this section and the relevant standard(s) unless the Administrator -

(i) Specifies or approves the use of minor changes in methodology for the specified monitoring requirements and procedures; or

(ii) Approves the use of alternatives to any monitoring requirements or procedures.

(iii) Owners or operators with flares subject to § 63.11(b) are not subject to the requirements of this section unless otherwise specified in the relevant standard.

(2) (i) When the effluents from a single affected source, or from two or more affected sources, are combined before being released to the atmosphere, the owner or operator shall install an applicable CMS on each effluent.

(ii) If the relevant standard is a mass emission standard and the effluent from one affected source is released to the atmosphere through more than one point, the owner or operator shall install an applicable CMS at each emission point unless the installation of fewer systems is -

(A) Approved by the Administrator; or

(B) Provided for in a relevant standard (e.g., instead of requiring that a CMS be installed at each emission point before the effluents from those points are channeled to a common control device, the standard specifies that only one CMS is required to be installed at the vent of the control device).

(3) When more than one CMS is used to measure the emissions from one affected source (e.g., multiple breechings, multiple outlets), the owner or operator shall report the results as

required for each CMS. However, when one CMS is used as a backup to another CMS, the owner or operator shall report the results from the CMS used to meet the monitoring requirements of this part. If both such CMS are used during a particular reporting period to meet the monitoring requirements of this part, then the owner or operator shall report the results from each CMS for the relevant compliance period.

(c) Operation and maintenance of continuous monitoring systems.

(1) The owner or operator of an affected source shall maintain and operate each CMS as specified in this section, or in a relevant standard, and in a manner consistent with good air pollution control practices.

(i) The owner or operator of an affected source shall ensure the immediate repair or replacement of CMS parts to correct "routine" or otherwise predictable CMS malfunctions as defined in the source's startup, shutdown, and malfunction plan required by § 63.6(e)(3). The owner or operator shall keep the necessary parts for routine repairs of the affected equipment readily available. If the plan is followed and the CMS repaired immediately, this action shall be reported in the semiannual startup, shutdown, and malfunction report required under § 63.10(d)(5)(i).

(ii) For those malfunctions or other events that affect the CMS and are not addressed by the startup, shutdown, and malfunction plan, the owner or operator shall report actions that are not consistent with the startup, shutdown, and malfunction plan within 24 hours after commencing actions inconsistent with the plan. The owner or operator shall send a followup report within 2 weeks after commencing actions inconsistent with the plan that either certifies that corrections have been made or includes a corrective action plan and schedule. The owner or operator shall provide proof that repair parts have been ordered or any other records that would indicate that the delay in making repairs is beyond his or her control.

(iii) The Administrator's determination of whether acceptable operation and maintenance procedures are being used will be based on information that may include, but is not limited to, review of operation and maintenance procedures, operation and maintenance records, manufacturing recommendations and specifications, and inspection of the CMS. Operation and maintenance procedures written by the CMS manufacturer and other guidance also can be used to maintain and operate each CMS.

(2) All CMS shall be installed such that representative measurements of emissions or process parameters from the affected source are obtained. In addition, CEMS shall be located according to procedures contained in the applicable performance specification(s).

(3) All CMS shall be installed, operational, and the data verified as specified in the relevant standard either prior to or in conjunction with conducting performance tests under § 63.7. Verification of operational status shall, at a minimum, include completion of the manufacturer's written specifications or recommendations for installation, operation, and calibration of the system.

(4) Except for system breakdowns, out-of-control periods, repairs, maintenance periods, calibration checks, and zero (low-level) and high-level calibration drift adjustments, all CMS, including COMS and CEMS, shall be in continuous operation and shall meet minimum frequency of operation requirements as follows:

(i) All COMS shall complete a minimum of one cycle of sampling and analyzing for each successive 10-second period and one cycle of data recording for each successive 6-minute period.

(ii) All CEMS for measuring emissions other than opacity shall complete a minimum of one cycle of operation (sampling, analyzing, and data recording) for each successive 15-minute period.

(5) Unless otherwise approved by the Administrator, minimum procedures for COMS shall include a method for producing a simulated zero opacity condition and an upscale (high-

level) opacity condition using a certified neutral density filter or other related technique to produce a known obscuration of the light beam. Such procedures shall provide a system check of all the analyzer's internal optical surfaces and all electronic circuitry, including the lamp and photodetector assembly normally used in the measurement of opacity.

(6) The owner or operator of a CMS installed in accordance with the provisions of this part and the applicable CMS performance specification(s) shall check the zero (low-level) and high-level calibration drifts at least once daily in accordance with the written procedure specified in the performance evaluation plan developed under paragraphs (e)(3)(i) and (e)(3)(ii) of this section. The zero (low-level) and high-level calibration drifts shall be adjusted, at a minimum, whenever the 24-hour zero (low-level) drift exceeds two times the limits of the applicable performance specification(s) specified in the relevant standard. The system must allow the amount of excess zero (low-level) and high-level drift measured at the 24-hour interval checks to be recorded and quantified, whenever specified. For COMS, all optical and instrumental surfaces exposed to the effluent gases shall be cleaned prior to performing the zero (low-level) and high-level drift adjustments; the optical surfaces and instrumental surfaces shall be cleaned when the cumulative automatic zero compensation, if applicable, exceeds 4 percent opacity.

(7) (i) A CMS is out of control if -

(A) The zero (low-level), mid-level (if applicable), or high-level calibration drift (CD) exceeds two times the applicable CD specification in the applicable performance specification or in the relevant standard; or

(B) The CMS fails a performance test audit (e.g., cylinder gas audit), relative accuracy audit, relative accuracy test audit, or linearity test audit; or

(C) The COMS CD exceeds two times the limit in the applicable performance specification in the relevant standard.

(ii) When the CMS is out of control, the owner or operator of the affected source shall take the necessary corrective action and shall repeat all necessary tests which indicate that the system is out of control. The owner or operator shall take corrective action and conduct retesting until the performance requirements are below the applicable limits. The beginning of the out-of-control period is the hour the owner or operator conducts a performance check (e.g., calibration drift) that indicates an exceedance of the performance requirements established under this part. The end of the out-of-control period is the hour following the completion of corrective action and successful demonstration that the system is within the allowable limits. During the period the CMS is out of control, recorded data shall not be used in data averages and calculations, or to meet any data availability requirement established under this part.

(8) The owner or operator of a CMS that is out of control as defined in paragraph (c)(7) of this section shall submit all information concerning out-of-control periods, including start and end

dates and hours and descriptions of corrective actions taken, in the excess emissions and continuous monitoring system performance report required in § 63.10(e)(3).

(d) *Quality control program.*

(1) The results of the quality control program required in this paragraph will be considered by the Administrator when he/she determines the validity of monitoring data.

(2) The owner or operator of an affected source that is required to use a CMS and is subject to the monitoring requirements of this section and a relevant standard shall develop and implement a CMS quality control program. As part of the quality control program, the owner or operator shall develop and submit to the Administrator for approval upon request a site-specific performance evaluation test plan for the CMS performance evaluation required in paragraph (e)(3)(i) of this section, according to the procedures specified in paragraph (e). In addition, each

quality control program shall include, at a minimum, a written protocol that describes procedures for each of the following operations:

- (i) Initial and any subsequent calibration of the CMS;
- (ii) Determination and adjustment of the calibration drift of the CMS;
- (iii) Preventive maintenance of the CMS, including spare parts inventory;
- (iv) Data recording, calculations, and reporting;
- (v) Accuracy audit procedures, including sampling and analysis methods; and
- (vi) Program of corrective action for a malfunctioning CMS.

(3) The owner or operator shall keep these written procedures on record for the life of the affected source or until the affected source is no longer subject to the provisions of this part, to be made available for inspection, upon request, by the Administrator. If the performance evaluation plan is revised, the owner or operator shall keep previous (i.e., superseded) versions of the performance evaluation plan on record to be made available for inspection, upon request, by the Administrator, for a period of 5 years after each revision to the plan. Where relevant, e.g., program of corrective action for a malfunctioning CMS, these written procedures may be incorporated as part of the affected source's startup, shutdown, and malfunction plan to avoid duplication of planning and recordkeeping efforts.

(e) Performance evaluation of continuous monitoring systems -

(1) *General.* When required by a relevant standard, and at any other time the Administrator may require under section 114 of the Act, the owner or operator of an affected source being monitored shall conduct a performance evaluation of the CMS. Such performance evaluation shall be conducted according to the applicable specifications and procedures described in this section or in the relevant standard.

(2) *Notification of performance evaluation.* The owner or operator shall notify the Administrator in writing of the date of the performance evaluation simultaneously with the notification of the performance test date required under § 63.7(b) or at least 60 days prior to the date the performance evaluation is scheduled to begin if no performance test is required.

(3) (i) *Submission of site-specific performance evaluation test plan.* Before conducting a required CMS performance evaluation, the owner or operator of an affected source shall develop and submit a site-specific performance evaluation test plan to the Administrator for approval upon request. The performance evaluation test plan shall include the evaluation program objectives, an evaluation program summary, the performance evaluation schedule, data quality objectives, and both an internal and external QA program. Data quality objectives are the pre-evaluation expectations of precision, accuracy, and completeness of data.

(ii) The internal QA program shall include, at a minimum, the activities planned by routine operators and analysts to provide an assessment of CMS performance. The external QA program shall include, at a minimum, systems audits that include the opportunity for on-site evaluation by the Administrator of instrument calibration, data validation, sample logging, and documentation of quality control data and field maintenance activities.

(iii) The owner or operator of an affected source shall submit the site-specific performance evaluation test plan to the Administrator (if requested) at least 60 days before the performance test or performance evaluation is scheduled to begin, or on a mutually agreed upon date, and review and approval of the performance evaluation test plan by the Administrator will occur with the review and approval of the site-specific test plan (if review of the site-specific test plan is requested).

(iv) The Administrator may request additional relevant information after the submittal of a site-specific performance evaluation test plan.

(v) In the event that the Administrator fails to approve or disapprove the site-specific performance evaluation test plan within the time period specified in § 63.7(c)(3), the following conditions shall apply:

(A) If the owner or operator intends to demonstrate compliance using the monitoring method(s) specified in the relevant standard, the owner or operator shall conduct the performance evaluation within the time specified in this subpart using the specified method(s);

(B) If the owner or operator intends to demonstrate compliance by using an alternative to a monitoring method specified in the relevant standard, the owner or operator shall refrain from conducting the performance evaluation until the Administrator approves the use of the alternative method. If the Administrator does not approve the use of the alternative method within 30 days before the performance evaluation is scheduled to begin, the performance evaluation deadlines specified in paragraph (e)(4) of this section may be extended such that the owner or operator shall conduct the performance evaluation within 60 calendar days after the Administrator approves the use of the alternative method. Notwithstanding the requirements in the preceding two sentences, the owner or operator may proceed to conduct the performance evaluation as required in this section (without the Administrator's prior approval of the site-specific performance evaluation test plan) if he/she subsequently chooses to use the specified monitoring method(s) instead of an alternative.

(vi) Neither the submission of a site-specific performance evaluation test plan for approval, nor the Administrator's approval or disapproval of a plan, nor the Administrator's failure to approve or disapprove a plan in a timely manner shall -

(A) Relieve an owner or operator of legal responsibility for compliance with any applicable provisions of this part or with any other applicable Federal, State, or local requirement; or

(B) Prevent the Administrator from implementing or enforcing this part or taking any other action under the Act.

(4) *Conduct of performance evaluation and performance evaluation dates.* The owner or operator of an affected source shall conduct a performance evaluation of a required CMS during any performance test required under § 63.7 in accordance with the applicable performance specification as specified in the relevant standard. Notwithstanding the requirement in the previous sentence, if the owner or operator of an affected source elects to submit COMS data for compliance with a relevant opacity emission standard as provided under § 63.6(h)(7), he/she shall conduct a performance evaluation of the COMS as specified in the relevant standard, before the performance test required under § 63.7 is conducted in time to submit the results of the performance evaluation as specified in paragraph (e)(5)(ii) of this section. If a performance test is not required, or the requirement for a performance test has been waived under § 63.7(h), the owner or operator of an affected source shall conduct the performance evaluation not later than 180 days after the appropriate compliance date for the affected source, as specified in § 63.7(a), or as otherwise specified in the relevant standard.

(5) *Reporting performance evaluation results.*

(i) The owner or operator shall furnish the Administrator a copy of a written report of the results of the performance evaluation simultaneously with the results of the performance test required under § 63.7 or within 60 days of completion of the performance evaluation if no test is required, unless otherwise specified in a relevant standard. The Administrator may request that the owner or operator submit the raw data from a performance evaluation in the report of the performance evaluation results.

(ii) The owner or operator of an affected source using a COMS to determine opacity compliance during any performance test required under § 63.7 and described in § 63.6(d)(6) shall furnish the Administrator two or, upon request, three copies of a written report of the results of the COMS performance evaluation under this paragraph. The copies shall be provided at least 15 calendar days before the performance test required under § 63.7 is conducted.

(f) *Use of an alternative monitoring method -*

(1) *General.* Until permission to use an alternative monitoring method has been granted by the Administrator under this paragraph, the owner or operator of an affected source remains subject to the requirements of this section and the relevant standard.

(2) After receipt and consideration of written application, the Administrator may approve alternatives to any monitoring methods or procedures of this part including, but not limited to, the following:

(i) Alternative monitoring requirements when installation of a CMS specified by a relevant standard would not provide accurate measurements due to liquid water or other interferences caused by substances within the effluent gases;

(ii) Alternative monitoring requirements when the affected source is infrequently operated;

(iii) Alternative monitoring requirements to accommodate CEMS that require additional measurements to correct for stack moisture conditions;

(iv) Alternative locations for installing CMS when the owner or operator can demonstrate that installation at alternate locations will enable accurate and representative measurements;

(v) Alternate methods for converting pollutant concentration measurements to units of the relevant standard;

(vi) Alternate procedures for performing daily checks of zero (low-level) and high-level drift that do not involve use of high-level gases or test cells;

(vii) Alternatives to the American Society for Testing and Materials (ASTM) test methods or sampling procedures specified by any relevant standard;

(viii) Alternative CMS that do not meet the design or performance requirements in this part, but adequately demonstrate a definite and consistent relationship between their measurements and the measurements of opacity by a system complying with the requirements as specified in the relevant standard. The Administrator may require that such demonstration be performed for each affected source; or

(ix) Alternative monitoring requirements when the effluent from a single affected source or the combined effluent from two or more affected sources is released to the atmosphere through more than one point.

(3) If the Administrator finds reasonable grounds to dispute the results obtained by an alternative monitoring method, requirement, or procedure, the Administrator may require the use of a method, requirement, or procedure specified in this section or in the relevant standard. If the results of the specified and alternative method, requirement, or procedure do not agree, the results obtained by the specified method, requirement, or procedure shall prevail.

(4) (i) Request to use alternative monitoring method. An owner or operator who wishes to use an alternative monitoring method shall submit an application to the Administrator as described in paragraph (f)(4)(ii) of this section, below. The application may be submitted at any time provided that the monitoring method is not used to demonstrate compliance with a relevant standard or other requirement. If the alternative monitoring method is to be used to demonstrate compliance with a relevant standard, the application shall be submitted not later than with the site-specific test plan required in § 63.7(c) (if requested) or with the site-specific performance evaluation plan (if requested) or at least 60 days before the performance evaluation is scheduled to begin.

(ii) The application shall contain a description of the proposed alternative monitoring system and a performance evaluation test plan, if required, as specified in paragraph (e)(3) of this section. In addition, the application shall include information justifying the owner or operator's request for an alternative monitoring method, such as the technical or economic infeasibility, or the impracticality, of the affected source using the required method.

(iii) The owner or operator may submit the information required in this paragraph well in advance of the submittal dates specified in paragraph (f)(4)(i) above to ensure a timely

review by the Administrator in order to meet the compliance demonstration date specified in this section or the relevant standard.

(5) Approval of request to use alternative monitoring method.

(i) The Administrator will notify the owner or operator of approval or intention to deny approval of the request to use an alternative monitoring method within 30 calendar days after

receipt of the original request and within 30 calendar days after receipt of any supplementary information that is submitted. Before disapproving any request to use an alternative monitoring method, the Administrator will notify the applicant of the Administrator's intention to disapprove the request together with -

(A) Notice of the information and findings on which the intended disapproval is based; and

(B) Notice of opportunity for the owner or operator to present additional information to the Administrator before final action on the request. At the time the Administrator notifies the applicant of his or her intention to disapprove the request, the Administrator will specify how much time the owner or operator will have after being notified of the intended disapproval to submit the additional information.

(ii) The Administrator may establish general procedures and criteria in a relevant standard to accomplish the requirements of paragraph (f)(5)(i) of this section.

(iii) If the Administrator approves the use of an alternative monitoring method for an affected source under paragraph (f)(5)(i) of this section, the owner or operator of such source shall continue to use the alternative monitoring method until he or she receives approval from the Administrator to use another monitoring method as allowed by § 63.8(f).

(6) Alternative to the relative accuracy test. An alternative to the relative accuracy test for CEMS specified in a relevant standard may be requested as follows:

(i) *Criteria for approval of alternative procedures.* An alternative to the test method for determining relative accuracy is available for affected sources with emission rates demonstrated to be less than 50 percent of the relevant standard. The owner or operator of an affected source may petition the Administrator under paragraph (f)(6)(ii) of this section to substitute the relative accuracy test in section 7 of Performance Specification 2 with the procedures in section 10 if the results of a performance test conducted according to the requirements in § 63.7, or other tests performed following the criteria in § 63.7, demonstrate that the emission rate of the pollutant of interest in the units of the relevant standard is less than 50 percent of the relevant standard. For affected sources subject to emission limitations expressed as control efficiency

levels, the owner or operator may petition the Administrator to substitute the relative accuracy test with the procedures in section 10 of Performance Specification 2 if the control device exhaust emission rate is less than 50 percent of the level needed to meet the control efficiency requirement.

The alternative procedures do not apply if the CEMS is used continuously to determine compliance with the relevant standard.

(ii) *Petition to use alternative to relative accuracy test.* The petition to use an alternative to the relative accuracy test shall include a detailed description of the procedures to be applied, the location and the procedure for conducting the alternative, the concentration or response levels of the alternative relative accuracy materials, and the other equipment checks included in the alternative procedure(s). The Administrator will review the petition for completeness and applicability. The Administrator's determination to approve an alternative will depend on the intended use of the CEMS data and may require specifications more stringent than in Performance Specification 2.

(iii) *Rescission of approval to use alternative to relative accuracy test.* The Administrator will review the permission to use an alternative to the CEMS relative accuracy test

and may rescind such permission if the CEMS data from a successful completion of the alternative relative accuracy procedure indicate that the affected source's emissions are approaching the level of the relevant standard. The criterion for reviewing the permission is that the collection of CEMS data shows that emissions have exceeded 70 percent of the relevant standard for any averaging period, as specified in the relevant standard. For affected sources subject to emission limitations expressed as control efficiency levels, the criterion for reviewing the permission is that the collection of CEMS data shows that exhaust emissions have exceeded 70 percent of the level needed to meet the control efficiency requirement for any averaging period, as specified in the relevant standard. The owner or operator of the affected source shall maintain records and determine the level of emissions relative to the criterion for permission to use an alternative for relative accuracy testing. If this criterion is exceeded, the owner or operator shall notify the Administrator within 10 days of such occurrence and include a description of the nature and cause of the increased emissions. The Administrator will review the notification and may rescind permission to use an alternative and require the owner or operator to conduct a relative accuracy test of the CEMS as specified in section 7 of Performance Specification 2.

(g) Reduction of monitoring data.

(1) The owner or operator of each CMS shall reduce the monitoring data as specified in this paragraph. In addition, each relevant standard may contain additional requirements for reducing monitoring data. When additional requirements are specified in a relevant standard, the standard will identify any unnecessary or duplicated requirements in this paragraph that the owner or operator need not comply with.

(2) The owner or operator of each COMS shall reduce all data to 6-minute averages calculated from 36 or more data points equally spaced over each 6-minute period. Data from CEMS for measurement other than opacity, unless otherwise specified in the relevant standard, shall be reduced to 1-hour averages computed from four or more data points equally spaced over each 1-hour period, except during periods when calibration, quality assurance, or maintenance activities pursuant to provisions of this part are being performed. During these periods, a valid hourly average shall consist of at least two data points with each representing a 15-minute period. Alternatively, an arithmetic or integrated 1-hour average of CEMS data may be used. Time periods for averaging are defined in § 63.2.

(3) The data may be recorded in reduced or nonreduced form (e.g., ppm pollutant and percent O₂ or ng/J of pollutant).

(4) All emission data shall be converted into units of the relevant standard for reporting purposes using the conversion procedures specified in that standard. After conversion into units of the relevant standard, the data may be rounded to the same number of significant digits as used in that standard to specify the emission limit (e.g., rounded to the nearest 1 percent opacity).

(5) Monitoring data recorded during periods of unavoidable CMS breakdowns, out-of-control periods, repairs, maintenance periods, calibration checks, and zero (low-level) and high-level adjustments shall not be included in any data average computed under this part.

§ 63.9 Notification requirements.

For 63.9(a) through (d): 40 CFR 63.787(a) extends the initial notification deadline to 180 days. 40 CFR 63.787(b) requires an implementation plan to be submitted with the initial notification.

(a) Applicability and general information.

(1) The requirements in this section apply to owners and operators of affected sources that are subject to the provisions of this part, unless specified otherwise in a relevant standard.

(2) For affected sources that have been granted an extension of compliance under subpart D of this part, the requirements of this section do not apply to those sources while they are operating under such compliance extensions.

(3) If any State requires a notice that contains all the information required in a notification listed in this section, the owner or operator may send the Administrator a copy of the notice sent to the State to satisfy the requirements of this section for that notification.

(4) (i) Before a State has been delegated the authority to implement and enforce notification requirements established under this part, the owner or operator of an affected source in such State subject to such requirements shall submit notifications to the appropriate Regional Office of the EPA (to the attention of the Director of the Division indicated in the list of the EPA Regional Offices in § 63.13).

(ii) After a State has been delegated the authority to implement and enforce notification requirements established under this part, the owner or operator of an affected source in such State subject to such requirements shall submit notifications to the delegated State authority (which may be the same as the permitting authority). In addition, if the delegated (permitting) authority is the State, the owner or operator shall send a copy of each notification submitted to the State to the appropriate Regional Office of the EPA, as specified in paragraph (a)(4)(i) of this section. The Regional Office may waive this requirement for any notifications at its discretion.

(b) Initial notifications.

(1) (i) The requirements of this paragraph apply to the owner or operator of an affected source when such source becomes subject to a relevant standard.

(ii) If an area source that otherwise would be subject to an emission standard or other requirement established under this part if it were a major source subsequently increases its emissions of hazardous air pollutants (or its potential to emit hazardous air pollutants) such that the source is a major source that is subject to the emission standard or other requirement, such source shall be subject to the notification requirements of this section.

(iii) Affected sources that are required under this paragraph to submit an initial notification may use the application for approval of construction or reconstruction under § 63.5(d) of this subpart, if relevant, to fulfill the initial notification requirements of this paragraph.

(2) The owner or operator of an affected source that has an initial startup before the effective date of a relevant standard under this part shall notify the Administrator in writing that the source is subject to the relevant standard. The notification, which shall be submitted not later than 120 calendar days after the effective date of the relevant standard (or within 120 calendar days after the source becomes subject to the relevant standard), shall provide the following information:

(i) The name and address of the owner or operator;

(ii) The address (i.e., physical location) of the affected source;

(iii) An identification of the relevant standard, or other requirement, that is the basis of the notification and the source's compliance date;

(iv) A brief description of the nature, size, design, and method of operation of the source, including its operating design capacity and an identification of each point of emission for each hazardous air pollutant, or if a definitive identification is not yet possible, a preliminary identification of each point of emission for each hazardous air pollutant; and

(v) A statement of whether the affected source is a major source or an area source.

(3) The owner or operator of a new or reconstructed affected source, or a source that has been reconstructed such that it is an affected source, that has an initial startup after the effective date of a relevant standard under this part and for which an application for approval of construction or reconstruction is not required under § 63.5(d), shall notify the Administrator in

writing that the source is subject to the relevant standard no later than 120 days after initial startup. The notification shall provide all the information required in paragraphs (b)(2)(i) through (b)(2)(v) of this section, delivered or postmarked with the notification required in paragraph (b)(5).

(4) The owner or operator of a new or reconstructed major affected source that has an initial startup after the effective date of a relevant standard under this part and for which an application for approval of construction or reconstruction is required under § 63.5(d) shall provide the following information in writing to the Administrator:

(i) A notification of intention to construct a new major affected source, reconstruct a major affected source, or reconstruct a major source such that the source becomes a major affected source with the application for approval of construction or reconstruction as specified in § 63.5(d)(1)(i);

(ii) A notification of the date when construction or reconstruction was commenced, submitted simultaneously with the application for approval of construction or reconstruction, if construction or reconstruction was commenced before the effective date of the relevant standard;

(iii) A notification of the date when construction or reconstruction was commenced, delivered or postmarked not later than 30 days after such date, if construction or reconstruction was commenced after the effective date of the relevant standard;

(iv) A notification of the anticipated date of startup of the source, delivered or postmarked not more than 60 days nor less than 30 days before such date; and

(v) A notification of the actual date of startup of the source, delivered or postmarked within 15 calendar days after that date.

(5) After the effective date of any relevant standard established by the Administrator under this part, whether or not an approved permit program is effective in the State in which an affected source is (or would be) located, an owner or operator who intends to construct a new affected source or reconstruct an affected source subject to such standard, or reconstruct a source such that it becomes an affected source subject to such standard, shall notify the Administrator, in writing, of the intended construction or reconstruction. The notification shall be submitted as soon as practicable before the construction or reconstruction is planned to commence (but no sooner than the effective date of the relevant standard) if the construction or reconstruction commences after the effective date of a relevant standard promulgated in this part. The notification shall be submitted as soon as practicable before startup but no later than 60 days after the effective date of a relevant standard promulgated in this part if the construction or reconstruction had commenced and initial startup had not occurred before the standard's effective date. The notification shall include all the information required for an application for approval of construction or reconstruction as specified in § 63.5(d). For major sources, the application for approval of construction or reconstruction may be used to fulfill the requirements of this paragraph.

(c) *Request for extension of compliance.* If the owner or operator of an affected source cannot comply with a relevant standard by the applicable compliance date for that source, or if the owner or operator has installed BACT or technology to meet LAER consistent with § 63.6(i)(5) of this subpart, he/she may submit to the Administrator (or the State with an approved permit program) a request for an extension of compliance as specified in § 63.6(i)(4) through § 63.6(i)(6).

(d) *Notification that source is subject to special compliance requirements.* An owner or operator of a new source that is subject to special compliance requirements as specified in § 63.6(b)(3) and

§ 63.6(b)(4) shall notify the Administrator of his/her compliance obligations not later than the notification dates established in paragraph (b) of this section for new sources that are not subject to the special provisions.

(e) Notification of performance test.

If an alternative means of limiting emissions (e.g., an add-on control system) is used to comply with subpart II in accordance with 40 CFR 63.783(c), then this paragraph does apply.

The owner or operator of an affected source shall notify the Administrator in writing of his or her intention to conduct a performance test at least 60 calendar days before the performance test is scheduled to begin to allow the Administrator to review and approve the site-specific test plan required under § 63.7(c), if requested by the Administrator, and to have an observer present during the test.

(f) Notification of opacity and visible emission observations.

Subpart II does not contain any opacity or visible emission standards.

(g) Additional notification requirements for sources with continuous monitoring systems.

If an alternative means of limiting emissions (e.g., an add-on control system) is used to comply with subpart II in accordance with 40 CFR 63.783(c) then these paragraphs do apply.

The owner or operator of an affected source required to use a CMS by a relevant standard shall furnish the Administrator written notification as follows:

(1) A notification of the date the CMS performance evaluation under § 63.8(e) is scheduled to begin, submitted simultaneously with the notification of the performance test date required under § 63.7(b). If no performance test is required, or if the requirement to conduct a performance test has been waived for an affected source under § 63.7(h), the owner or operator shall notify the Administrator in writing of the date of the performance evaluation at least 60 calendar days before the evaluation is scheduled to begin;

(2) A notification that COMS data results will be used to determine compliance with the applicable opacity emission standard during a performance test required by § 63.7 in lieu of Method 9 or other opacity emissions test method data, as allowed by § 63.6(h)(7)(ii), if compliance with an opacity emission standard is required for the source by a relevant standard. The notification shall be submitted at least 60 calendar days before the performance test is scheduled to begin; and

(3) A notification that the criterion necessary to continue use of an alternative to relative accuracy testing, as provided by § 63.8(f)(6), has been exceeded. The notification shall be delivered or postmarked not later than 10 days after the occurrence of such exceedance, and it shall include a description of the nature and cause of the increased emissions.

(h) Notification of compliance status.

If an alternative means of limiting emissions (e.g., an add-on control system) is used to comply with subpart II in accordance with 40 CFR 63.783(c) then these paragraphs do apply.

(1) The requirements of paragraphs (h)(2) through (h)(4) of this section apply when an affected source becomes subject to a relevant standard.

(2) (i) Before a title V permit has been issued to the owner or operator of an affected source, and each time a notification of compliance status is required under this part, the owner or operator of such source shall submit to the Administrator a notification of compliance status,

signed by the responsible official who shall certify its accuracy, attesting to whether the source has complied with the relevant standard. The notification shall list -

- (A) The methods that were used to determine compliance;
- (B) The results of any performance tests, opacity or visible emission observations, continuous monitoring system (CMS) performance evaluations, and/or other monitoring procedures or methods that were conducted;
- (C) The methods that will be used for determining continuing compliance, including a description of monitoring and reporting requirements and test methods;
- (D) The type and quantity of hazardous air pollutants emitted by the source (or surrogate pollutants if specified in the relevant standard), reported in units and averaging times and in accordance with the test methods specified in the relevant standard;
- (E) An analysis demonstrating whether the affected source is a major source or an area source (using the emissions data generated for this notification);
- (F) A description of the air pollution control equipment (or method) for each emission point, including each control device (or method) for each hazardous air pollutant and the control efficiency (percent) for each control device (or method); and
- (G) A statement by the owner or operator of the affected existing, new, or reconstructed source as to whether the source has complied with the relevant standard or other requirements.

(ii) The notification shall be sent before the close of business on the 60th day following the completion of the relevant compliance demonstration activity specified in the relevant standard (unless a different reporting period is specified in a relevant standard, in which case the letter shall be sent before the close of business on the day the report of the relevant testing or monitoring results is required to be delivered or postmarked). For example, the notification shall be sent before close of business on the 60th (or other required) day following completion of the initial performance test and again before the close of business on the 60th (or other required) day following the completion of any subsequent required performance test. If no performance test is required but opacity or visible emission observations are required to demonstrate compliance with an opacity or visible emission standard under this part, the notification of compliance status shall be sent before close of business on the 30th day following the completion of opacity or visible emission observations.

(3) After a title V permit has been issued to the owner or operator of an affected source, the owner or operator of such source shall comply with all requirements for compliance status reports contained in the source's title V permit, including reports required under this part. After a title V permit has been issued to the owner or operator of an affected source, and each time a notification of compliance status is required under this part, the owner or operator of such source shall submit the notification of compliance status to the appropriate permitting authority following completion of the relevant compliance demonstration activity specified in the relevant standard.

(4) [Reserved]

(5) If an owner or operator of an affected source submits estimates or preliminary information in the application for approval of construction or reconstruction required in § 63.5(d) in place of the actual emissions data or control efficiencies required in paragraphs (d)(1)(ii)(H) and (d)(2) of § 63.5, the owner or operator shall submit the actual emissions data and other correct information as soon as available but no later than with the initial notification of compliance status required in this section.

(6) Advice on a notification of compliance status may be obtained from the Administrator.

(i) *Adjustment to time periods or postmark deadlines for submittal and review of required communications.*

(1) (i) Until an adjustment of a time period or postmark deadline has been approved by the Administrator under paragraphs (i)(2) and (i)(3) of this section, the owner or operator of an affected source remains strictly subject to the requirements of this part.

(ii) An owner or operator shall request the adjustment provided for in paragraphs (i)(2) and (i)(3) of this section each time he or she wishes to change an applicable time period or postmark deadline specified in this part.

(2) Notwithstanding time periods or postmark deadlines specified in this part for the submittal of information to the Administrator by an owner or operator, or the review of such information by the Administrator, such time periods or deadlines may be changed by mutual agreement between the owner or operator and the Administrator. An owner or operator who wishes to request a change in a time period or postmark deadline for a particular requirement shall request the adjustment in writing as soon as practicable before the subject activity is required to take place. The owner or operator shall include in the request whatever information he or she considers useful to convince the Administrator that an adjustment is warranted.

(3) If, in the Administrator's judgment, an owner or operator's request for an adjustment to a particular time period or postmark deadline is warranted, the Administrator will approve the adjustment. The Administrator will notify the owner or operator in writing of approval or disapproval of the request for an adjustment within 15 calendar days of receiving sufficient information to evaluate the request.

(4) If the Administrator is unable to meet a specified deadline, he or she will notify the owner or operator of any significant delay and inform the owner or operator of the amended schedule.

(j) *Change in information already provided.* Any change in the information already provided under this section shall be provided to the Administrator in writing within 15 calendar days after the change.

§ 63.10 Recordkeeping and reporting requirements.

(a) *Applicability and general information.*

40 CFR 63.788(b)-(c) list additional recordkeeping and reporting requirements.

(1) The requirements of this section apply to owners or operators of affected sources who are subject to the provisions of this part, unless specified otherwise in a relevant standard.

(2) For affected sources that have been granted an extension of compliance under subpart D of this part, the requirements of this section do not apply to those sources while they are operating under such compliance extensions.

(3) If any State requires a report that contains all the information required in a report listed in this section, an owner or operator may send the Administrator a copy of the report sent to the State to satisfy the requirements of this section for that report.

(4) (i) Before a State has been delegated the authority to implement and enforce recordkeeping and reporting requirements established under this part, the owner or operator of an affected source in such State subject to such requirements shall submit reports to the appropriate Regional Office of the EPA (to the attention of the Director of the Division indicated in the list of the EPA Regional Offices in § 63.13).

(ii) After a State has been delegated the authority to implement and enforce recordkeeping and reporting requirements established under this part, the owner or operator of an affected source in such State subject to such requirements shall submit reports to the delegated State authority (which may be the same as the permitting authority). In addition, if the delegated (permitting) authority is the State, the owner or operator shall send a copy of each report submitted to the State to the appropriate Regional Office of the EPA, as specified in paragraph

(a)(4)(i) of this section. The Regional Office may waive this requirement for any reports at its discretion.

(5) If an owner or operator of an affected source in a State with delegated authority is required to submit periodic reports under this part to the State, and if the State has an established timeline for the submission of periodic reports that is consistent with the reporting frequency(ies) specified for such source under this part, the owner or operator may change the dates by which periodic reports under this part shall be submitted (without changing the frequency of reporting) to be consistent with the State's schedule by mutual agreement between the owner or operator and the State. For each relevant standard established pursuant to section 112 of the Act, the allowance in the previous sentence applies in each State beginning 1 year after the affected source's compliance date for that standard. Procedures governing the implementation of this provision are specified in § 63.9(i).

(6) If an owner or operator supervises one or more stationary sources affected by more than one standard established pursuant to section 112 of the Act, he/she may arrange by mutual agreement between the owner or operator and the Administrator (or the State permitting authority) a common schedule on which periodic reports required for each source shall be submitted throughout the year. The allowance in the previous sentence applies in each State beginning 1 year after the latest compliance date for any relevant standard established pursuant to section 112 of the Act for any such affected source(s). Procedures governing the implementation of this provision are specified in § 63.9(i).

(7) If an owner or operator supervises one or more stationary sources affected by standards established pursuant to section 112 of the Act (as amended November 15, 1990) and standards set under part 60, part 61, or both such parts of this chapter, he/she may arrange by mutual agreement between the owner or operator and the Administrator (or the State permitting authority) a common schedule on which periodic reports required by each relevant (i.e., applicable) standard shall be submitted throughout the year. The allowance in the previous sentence applies in each State beginning 1 year after the stationary source is required to be in compliance with the relevant section 112 standard, or 1 year after the stationary source is required to be in compliance with the applicable part 60 or part 61 standard, whichever is latest. Procedures governing the implementation of this provision are specified in § 63.9(i).

(b) General recordkeeping requirements.

40 CFR 63.788(b)-(c) list additional recordkeeping and reporting requirements.

(1) The owner or operator of an affected source subject to the provisions of this part shall maintain files of all information (including all reports and notifications) required by this part recorded in a form suitable and readily available for expeditious inspection and review. The files shall be retained for at least 5 years following the date of each occurrence, measurement, maintenance, corrective action, report, or record. At a minimum, the most recent 2 years of data shall be retained on site. The remaining 3 years of data may be retained off site. Such files may be maintained on microfilm, on a computer, on computer floppy disks, on magnetic tape disks, or on microfiche.

(2) The owner or operator of an affected source subject to the provisions of this part shall maintain relevant records for such source of -

- (i) The occurrence and duration of each startup, shutdown, or malfunction of operation (i.e., process equipment);
- (ii) The occurrence and duration of each malfunction of the air pollution control equipment;
- (iii) All maintenance performed on the air pollution control equipment;

(iv) Actions taken during periods of startup, shutdown, and malfunction (including corrective actions to restore malfunctioning process and air pollution control equipment to its normal or usual manner of operation) when such actions are different from the procedures specified in the affected source's startup, shutdown, and malfunction plan (see § 63.6(e)(3));

(v) All information necessary to demonstrate conformance with the affected source's startup, shutdown, and malfunction plan (see § 63.6(e)(3)) when all actions taken during periods of startup, shutdown, and malfunction (including corrective actions to restore malfunctioning process and air pollution control equipment to its normal or usual manner of operation) are consistent with the procedures specified in such plan. (The information needed to demonstrate conformance with the startup, shutdown, and malfunction plan may be recorded using a "checklist," or some other effective form of recordkeeping, in order to minimize the recordkeeping burden for conforming events);

(vi) Each period during which a CMS is malfunctioning or inoperative (including out-of-control periods);

(vii) All required measurements needed to demonstrate compliance with a relevant standard (including, but not limited to, 15-minute averages of CMS data, raw performance testing measurements, and raw performance evaluation measurements, that support data that the source is required to re-report);

(viii) All results of performance tests, CMS performance evaluations, and opacity and visible emission observations;

(ix) All measurements as may be necessary to determine the conditions of performance tests and performance evaluations;

(x) All CMS calibration checks;

(xi) All adjustments and maintenance performed on CMS;

(xii) Any information demonstrating whether a source is meeting the requirements for a waiver of recordkeeping or reporting requirements under this part, if the source has been granted a waiver under paragraph (f) of this section;

(xiii) All emission levels relative to the criterion for obtaining permission to use an alternative to the relative accuracy test, if the source has been granted such permission under § 63.8(f)(6); and

(xiv) All documentation supporting initial notifications and notifications of compliance status under § 63.9.

(3) Recordkeeping requirement for applicability determinations. If an owner or operator determines that his or her stationary source that emits (or has the potential to emit, without considering controls) one or more hazardous air pollutants is not subject to a relevant standard or other requirement established under this part, the owner or operator shall keep a record of the applicability determination on site at the source for a period of 5 years after the determination, or until the source changes its operations to become an affected source, whichever comes first. The record of the applicability determination shall include an analysis (or other information) that demonstrates why the owner or operator believes the source is unaffected (e.g., because the source is an area source). The analysis (or other information) shall be sufficiently detailed to allow the Administrator to make a finding about the source's applicability status with regard to the relevant standard or other requirement. If relevant, the analysis shall be performed in accordance with

requirements established in subparts of this part for this purpose for particular categories of stationary sources. If relevant, the analysis should be performed in accordance with EPA guidance materials published to assist sources in making applicability determinations under section 112, if any.

(c) *Additional recordkeeping requirements for sources with continuous monitoring systems.*

If an alternative means of limiting emissions (e.g., an add-on control system) is used to comply with subpart II in accordance with 40 CFR 63.783(c), then this paragraph does apply.

In addition to complying with the requirements specified in paragraphs (b)(1) and (b)(2) of this section, the owner or operator of an affected source required to install a CMS by a relevant standard shall maintain records for such source of -

- (1) All required CMS measurements (including monitoring data recorded during unavoidable CMS breakdowns and out-of-control periods);
- (2)-(4) [Reserved]
- (5) The date and time identifying each period during which the CMS was inoperative except for zero (low-level) and high-level checks;
- (6) The date and time identifying each period during which the CMS was out of control, as defined in § 63.8(c)(7);
- (7) The specific identification (i.e., the date and time of commencement and completion) of each period of excess emissions and parameter monitoring exceedances, as defined in the relevant standard(s), that occurs during startups, shutdowns, and malfunctions of the affected source;
- (8) The specific identification (i.e., the date and time of commencement and completion) of each time period of excess emissions and parameter monitoring exceedances, as defined in the relevant standard(s), that occurs during periods other than startups, shutdowns, and malfunctions of the affected source;
- (9) [Reserved]
- (10) The nature and cause of any malfunction (if known);
- (11) The corrective action taken or preventive measures adopted;
- (12) The nature of the repairs or adjustments to the CMS that was inoperative or out of control;
- (13) The total process operating time during the reporting period; and
- (14) All procedures that are part of a quality control program developed and implemented for CMS under § 63.8(d).

(15) In order to satisfy the requirements of paragraphs (c)(10) through (c)(12) of this section and to avoid duplicative recordkeeping efforts, the owner or operator may use the affected source's startup, shutdown, and malfunction plan or records kept to satisfy the recordkeeping requirements of the startup, shutdown, and malfunction plan specified in § 63.6(e), provided that such plan and records adequately address the requirements of paragraphs (c)(10) through (c)(12).

(d) General reporting requirements.

(1) Notwithstanding the requirements in this paragraph or paragraph (e) of this section, the owner or operator of an affected source subject to reporting requirements under this part shall submit reports to the Administrator in accordance with the reporting requirements in the relevant standard(s).

(2) *Reporting results of performance tests.* Before a title V permit has been issued to the owner or operator of an affected source, the owner or operator shall report the results of any performance test under § 63.7 to the Administrator. After a title V permit has been issued to the owner or operator of an affected source, the owner or operator shall report the results of a required performance test to the appropriate permitting authority. The owner or operator of an affected source shall report the results of the performance test to the Administrator (or the State with an approved permit program) before the close of business on the 60th day following the completion of the performance test, unless specified otherwise in a relevant standard or as approved otherwise in writing by the Administrator. The results of the performance test shall be submitted as part of the notification of compliance status required under § 63.9(h).

(3) *Reporting results of opacity or visible emission observations.* The owner or operator of an affected source required to conduct opacity or visible emission observations by a relevant standard shall report the opacity or visible emission results (produced using Test Method 9 or Test Method 22, or an alternative to these test methods) along with the results of the performance test required under § 63.7. If no performance test is required, or if visibility or other conditions prevent the opacity or visible emission observations from being conducted concurrently with the performance test required under § 63.7, the owner or operator shall report the opacity or visible emission results before the close of business on the 30th day following the completion of the opacity or visible emission observations.

(4) *Progress reports.* The owner or operator of an affected source who is required to submit progress reports as a condition of receiving an extension of compliance under § 63.6(i) shall submit such reports to the Administrator (or the State with an approved permit program) by the dates specified in the written extension of compliance.

(5) (i) *Periodic startup, shutdown, and malfunction reports.* If actions taken by an owner or operator during a startup, shutdown, or malfunction of an affected source (including actions taken to correct a malfunction) are consistent with the procedures specified in the source's startup, shutdown, and malfunction plan [see § 63.6(e)(3)], the owner or operator shall state such information in a startup, shutdown, and malfunction report. Reports shall only be required if a startup, shutdown, or malfunction occurred during the reporting period. The startup, shutdown, and malfunction report shall consist of a letter, containing the name, title, and signature of the owner or operator or other responsible official who is certifying its accuracy, that shall be submitted to the Administrator semi-annually (or on a more frequent basis if specified otherwise in a relevant standard or as established otherwise by the permitting authority in the source's title V permit). The startup, shutdown, and malfunction report shall be delivered or postmarked by the 30th day following the end of each calendar half (or other calendar reporting period, as appropriate). If the owner or operator is required to submit excess emissions and continuous monitoring system performance (or other periodic) reports under this part, the startup, shutdown, and malfunction reports required under this paragraph may be submitted simultaneously with the excess emissions and continuous monitoring system performance (or other) reports. If startup, shutdown, and malfunction reports are submitted with excess emissions and continuous monitoring system performance (or other periodic) reports, and the owner or operator receives approval to reduce the frequency of reporting for the latter under paragraph (e) of this section, the frequency of reporting for the startup, shutdown, and malfunction reports also may be reduced if the Administrator does not object to the intended change. The procedures to implement the allowance in the preceding sentence shall be the same as the procedures specified in paragraph (e)(3) of this section.

(ii) *Immediate startup, shutdown, and malfunction reports.* Notwithstanding the allowance to reduce the frequency of reporting for periodic startup, shutdown, and malfunction reports under paragraph (d)(5)(i) of this section, any time an action taken by an owner or operator during a startup, shutdown, or malfunction (including actions taken to correct a malfunction) is not consistent with the procedures specified in the affected source's startup, shutdown, and malfunction plan, the owner or operator shall report the actions taken for that event within 2 working days after commencing actions inconsistent with the plan followed by a letter within 7 working days after the end of the event. The immediate report required under this paragraph shall consist of a telephone call (or facsimile (FAX) transmission) to the Administrator within 2 working days after commencing actions inconsistent with the plan, and it shall be followed by a letter, delivered or postmarked within 7 working days after the end of the event, that contains the name, title, and signature of the owner or operator or other responsible official who is certifying its accuracy, explaining the circumstances of the event, the reasons for not following the startup, shutdown, and malfunction plan, and whether any excess emissions and/or parameter monitoring exceedances are believed to have occurred. Notwithstanding the requirements of the previous

sentence, after the effective date of an approved permit program in the State in which an affected source is located, the owner or operator may make alternative reporting arrangements, in advance, with the permitting authority in that State. Procedures governing the arrangement of alternative reporting requirements under this paragraph are specified in § 63.9(i).

(e) Additional reporting requirements for sources with continuous monitoring systems -
If an alternative means of limiting emissions (e.g., an add-on control system) is used to comply with subpart II in accordance with 40 CFR 63.783(c), then this paragraph does apply.

(1) *General.* When more than one CEMS is used to measure the emissions from one affected source (e.g., multiple breechings, multiple outlets), the owner or operator shall report the results as required for each CEMS.

(2) Reporting results of continuous monitoring system performance evaluations.

(i) The owner or operator of an affected source required to install a CMS by a relevant standard shall furnish the Administrator a copy of a written report of the results of the CMS performance evaluation, as required under § 63.8(e), simultaneously with the results of the performance test required under § 63.7, unless otherwise specified in the relevant standard.

(ii) The owner or operator of an affected source using a COMS to determine opacity compliance during any performance test required under § 63.7 and described in § 63.6(d)(6) shall furnish the Administrator two or, upon request, three copies of a written report of the results of the COMS performance evaluation conducted under § 63.8(e). The copies shall be furnished at least 15 calendar days before the performance test required under § 63.7 is conducted.

(3) *Excess emissions and continuous monitoring system performance report and summary report.*

(i) Excess emissions and parameter monitoring exceedances are defined in relevant standards. The owner or operator of an affected source required to install a CMS by a relevant standard shall submit an excess emissions and continuous monitoring system performance report and/or a summary report to the Administrator semiannually, except when -

(A) More frequent reporting is specifically required by a relevant standard;

(B) The Administrator determines on a case-by-case basis that more frequent reporting is necessary to accurately assess the compliance status of the source; or

(C) The CMS data are to be used directly for compliance determination and the source experienced excess emissions, in which case quarterly reports shall be submitted. Once a source reports excess emissions, the source shall follow a quarterly reporting format until a request to reduce reporting frequency under paragraph (e)(3)(ii) of this section is approved.

(ii) Request to reduce frequency of excess emissions and continuous monitoring system performance reports. Notwithstanding the frequency of reporting requirements specified in paragraph (e)(3)(i) of this section, an owner or operator who is required by a relevant standard to submit excess emissions and continuous monitoring system performance (and summary) reports on a quarterly (or more frequent) basis may reduce the frequency of reporting for that standard to semiannual if the following conditions are met:

(A) For 1 full year (e.g., 4 quarterly or 12 monthly reporting periods) the affected source's excess emissions and continuous monitoring system performance reports continually demonstrate that the source is in compliance with the relevant standard;

(B) The owner or operator continues to comply with all recordkeeping and monitoring requirements specified in this subpart and the relevant standard; and

(C) The Administrator does not object to a reduced frequency of reporting for the affected source, as provided in paragraph (e)(3)(iii) of this section.

(iii) The frequency of reporting of excess emissions and continuous monitoring system performance (and summary) reports required to comply with a relevant standard may be reduced only after the owner or operator notifies the Administrator in writing of his or her intention to make such a change and the Administrator does not object to the intended change. In deciding whether to approve a reduced frequency of reporting, the Administrator may review information concerning the source's entire previous performance history during the 5-year recordkeeping period prior to the intended change, including performance test results, monitoring data, and evaluations of an owner or operator's conformance with operation and maintenance requirements. Such information may be used by the Administrator to make a judgment about the source's potential for noncompliance in the future. If the Administrator disapproves the owner or operator's request to reduce the frequency of reporting, the Administrator will notify the owner or operator in writing within 45 days after receiving notice of the owner or operator's intention. The notification from the Administrator to the owner or operator will specify the grounds on which the disapproval is based. In the absence of a notice of disapproval within 45 days, approval is automatically granted.

(iv) As soon as CMS data indicate that the source is not in compliance with any emission limitation or operating parameter specified in the relevant standard, the frequency of reporting shall revert to the frequency specified in the relevant standard, and the owner or operator shall submit an excess emissions and continuous monitoring system performance (and summary) report for the noncomplying emission points at the next appropriate reporting period following the noncomplying event. After demonstrating ongoing compliance with the relevant standard for another full year, the owner or operator may again request approval from the Administrator to reduce the frequency of reporting for that standard, as provided for in paragraphs (e)(3)(ii) and (e)(3)(iii) of this section.

(v) *Content and submittal dates for excess emissions and monitoring system performance reports.* All excess emissions and monitoring system performance reports and all summary reports, if required, shall be delivered or postmarked by the 30th day following the end of each calendar half or quarter, as appropriate. Written reports of excess emissions or exceedances of process or control system parameters shall include all the information required in paragraphs (c)(5) through (c)(13) of this section, in § 63.8(c)(7) and § 63.8(c)(8), and in the relevant standard, and they shall contain the name, title, and signature of the responsible official who is certifying the accuracy of the report. When no excess emissions or exceedances of a parameter have occurred, or a CMS has not been inoperative, out of control, repaired, or adjusted, such information shall be stated in the report.

(vi) *Summary report.* As required under paragraphs (e)(3)(vii) and (e)(3)(viii) of this section, one summary report shall be submitted for the hazardous air pollutants monitored at each affected source (unless the relevant standard specifies that more than one summary report is required, e.g., one summary report for each hazardous air pollutant monitored). The summary report shall be entitled "Summary Report - Gaseous and Opacity Excess Emission and Continuous Monitoring System Performance" and shall contain the following information:

- (A) The company name and address of the affected source;
- (B) An identification of each hazardous air pollutant monitored at the affected source;
- (C) The beginning and ending dates of the reporting period;
- (D) A brief description of the process units;
- (E) The emission and operating parameter limitations specified in the relevant standard(s);
- (F) The monitoring equipment manufacturer(s) and model number(s);
- (G) The date of the latest CMS certification or audit;

(H) The total operating time of the affected source during the reporting period;

(I) An emission data summary (or similar summary if the owner or operator monitors control system parameters), including the total duration of excess emissions during the reporting period (recorded in minutes for opacity and hours for gases), the total duration of excess emissions expressed as a percent of the total source operating time during that reporting period, and a breakdown of the total duration of excess emissions during the reporting period into those that are due to startup/shutdown, control equipment problems, process problems, other known causes, and other unknown causes;

(J) A CMS performance summary (or similar summary if the owner or operator monitors control system parameters), including the total CMS downtime during the reporting period (recorded in minutes for opacity and hours for gases), the total duration of CMS downtime expressed as a percent of the total source operating time during that reporting period, and a breakdown of the total CMS downtime during the reporting period into periods that are due to monitoring equipment malfunctions, nonmonitoring equipment malfunctions, quality assurance/quality control calibrations, other known causes, and other unknown causes;

(K) A description of any changes in CMS, processes, or controls since the last reporting period;

(L) The name, title, and signature of the responsible official who is certifying the accuracy of the report; and

(M) The date of the report.

(vii) If the total duration of excess emissions or process or control system parameter exceedances for the reporting period is less than 1 percent of the total operating time for the reporting period, and CMS downtime for the reporting period is less than 5 percent of the total operating time for the reporting period, only the summary report shall be submitted, and the full excess emissions and continuous monitoring system performance report need not be submitted unless required by the Administrator.

(viii) If the total duration of excess emissions or process or control system parameter exceedances for the reporting period is 1 percent or greater of the total operating time for the reporting period, or the total CMS downtime for the reporting period is 5 percent or greater of the total operating time for the reporting period, both the summary report and the excess emissions and continuous monitoring system performance report shall be submitted.

(4) Reporting continuous opacity monitoring system data produced during a performance test. The owner or operator of an affected source required to use a COMS shall record the monitoring data produced during a performance test required under § 63.7 and shall furnish the Administrator a written report of the monitoring results. The report of COMS data shall be submitted simultaneously with the report of the performance test results required in paragraph (d)(2) of this section.

(f) *Waiver of recordkeeping or reporting requirements.*

(1) Until a waiver of a recordkeeping or reporting requirement has been granted by the Administrator under this paragraph, the owner or operator of an affected source remains subject to the requirements of this section.

(2) Recordkeeping or reporting requirements may be waived upon written application to the Administrator if, in the Administrator's judgment, the affected source is achieving the relevant standard(s), or the source is operating under an extension of compliance, or the owner or operator has requested an extension of compliance and the Administrator is still considering that request.

(3) If an application for a waiver of record-keeping or reporting is made, the application shall accompany the request for an extension of compliance under § 63.6(i), any required compliance progress report or compliance status report required under this part (such as under § 63.6(i) and § 63.9(h)) or in the source's title V permit, or an excess emissions and continuous monitoring system performance report required under paragraph (e) of this section, whichever is applicable. The application shall include whatever information the owner or operator considers useful to convince the Administrator that a waiver of recordkeeping or reporting is warranted.

(4) The Administrator will approve or deny a request for a waiver of recordkeeping or reporting requirements under this paragraph when he/she -

(i) Approves or denies an extension of compliance; or

(ii) Makes a determination of compliance following the submission of a required compliance status report or excess emissions and continuous monitoring systems performance report; or

(iii) Makes a determination of suitable progress towards compliance following the submission of a compliance progress report, whichever is applicable.

(5) A waiver of any recordkeeping or reporting requirement granted under this paragraph may be conditioned on other recordkeeping or reporting requirements deemed necessary by the Administrator.

(6) Approval of any waiver granted under this section shall not abrogate the Administrator's authority under the Act or in any way prohibit the Administrator from later canceling the waiver. The cancellation will be made only after notice is given to the owner or operator of the affected source.

§ 63.11 Control device requirements.

If an alternative means of limiting emissions (e.g., an add-on control system) is used to comply with subpart II in accordance with 40 CFR 63.783(c), then this section does apply.

(a) *Applicability.* This section contains requirements for control devices used to comply with provisions in relevant standards. These requirements apply only to affected sources covered by relevant standards referring directly or indirectly to this section.

(b) *Flares.*

(1) Owners or operators using flares to comply with the provisions of this part shall monitor these control devices to assure that they are operated and maintained in conformance with their designs. Applicable subparts will provide provisions stating how owners or operators using flares shall monitor these control devices.

(2) Flares shall be steam-assisted, air-assisted, or non-assisted.

(3) Flares shall be operated at all times when emissions may be vented to them.

(4) Flares shall be designed for and operated with no visible emissions, except for periods not to exceed a total of 5 minutes during any 2 consecutive hours. Test Method 22 in appendix A of part 60 of this chapter shall be used to determine the compliance of flares with the visible emission provisions of this part. The observation period is 2 hours and shall be used according to Method 22.

(5) Flares shall be operated with a flame present at all times. The presence of a flare pilot flame shall be monitored using a thermocouple or any other equivalent device to detect the presence of a flame.

(6) Flares shall be used only with the net heating value of the gas being combusted at 11.2 MJ/scm (300 Btu/scf) or greater if the flare is steam-assisted or air-assisted; or with the net heating value of the gas being combusted at 7.45 MJ/scm (200 Btu/scf) or greater if the flare is non-assisted. The net heating value of the gas being combusted in a flare shall be calculated using the following equation:

$$H_T = K \sum_{i=1}^n C_i H_i$$

Where:

H_T = Net heating value of the sample, MJ/scm; where the net enthalpy per mole of offgas is based on combustion at 25 °C and 760 mm Hg, but the standard temperature for determining the volume corresponding to one mole is 20 °C.

K = Constant = 1.740×10^{-7} (1/ppmv)(g-mole/scm)(MJ/kcal); where the standard temperature for (g-mole/scm) is 20 °C.

C_i = Concentration of sample component i in ppmv on a wet basis, as measured for organics by Test Method 18 and measured for hydrogen and carbon monoxide by American Society for Testing and Materials (ASTM) D1946-77b (incorporated by reference as specified in § 63.14).

H_i = Net heat of combustion of sample component i , kcal/g-mole at 25 °C and 760 mm Hg. The heats of combustion may be determined using ASTM D2382-76 (incorporated by reference as specified in § 63.14) if published values are not available or cannot be calculated.

n = Number of sample components.

(7) (i) Steam-assisted and nonassisted flares shall be designed for and operated with an exit velocity less than 18.3 m/sec (60 ft/sec), except as provided in paragraphs (b)(7)(ii) and (b)(7)(iii) of this section. The actual exit velocity of a flare shall be determined by dividing by the volumetric flow rate of gas being combusted (in units of emission standard temperature and pressure), as determined by Test Method 2, 2A, 2C, or 2D in appendix A to 40 CFR part 60 of this chapter, as appropriate, by the unobstructed (free) cross-sectional area of the flare tip.

(ii) Steam-assisted and nonassisted flares designed for and operated with an exit velocity, as determined by the method specified in paragraph (b)(7)(i) of this section, equal to or greater than 18.3 m/sec (60 ft/sec) but less than 122 m/sec (400 ft/sec), are allowed if the net heating value of the gas being combusted is greater than 37.3 MJ/scm (1,000 Btu/scf).

(iii) Steam-assisted and nonassisted flares designed for and operated with an exit velocity, as determined by the method specified in paragraph (b)(7)(i) of this section, less than the velocity V_{max} , as determined by the method specified in this paragraph, but less than 122 m/sec (400 ft/sec) are allowed. The maximum permitted velocity, V_{max} , for flares complying with this paragraph shall be determined by the following equation:

$$\text{Log}_{10}(V_{max}) = (H_T + 28.8) / 31.7$$

Where:

V_{max} = Maximum permitted velocity, m/sec.

28.8 = Constant.

31.7 = Constant.

H_T = The net heating value as determined in paragraph (b)(6) of this section.

(8) Air-assisted flares shall be designed and operated with an exit velocity less than the velocity V_{\max} . The maximum permitted velocity, V_{\max} , for air-assisted flares shall be determined by the following equation:

$$V_{\max} = 8.706 + 0.7084(H_T)$$

Where:

V_{\max} = Maximum permitted velocity, m/sec.

8.706 = Constant.

0.7084 = Constant.

H_T = The net heating value as determined in paragraph (b)(6) of this section.

§ 63.12 State authority and delegations.

(a) The provisions of this part shall not be construed in any manner to preclude any State or political subdivision thereof from -

(1) Adopting and enforcing any standard, limitation, prohibition, or other regulation applicable to an affected source subject to the requirements of this part, provided that such standard, limitation, prohibition, or regulation is not less stringent than any requirement applicable to such source established under this part;

(2) Requiring the owner or operator of an affected source to obtain permits, licenses, or approvals prior to initiating construction, reconstruction, modification, or operation of such source; or

(3) Requiring emission reductions in excess of those specified in subpart D of this part as a condition for granting the extension of compliance authorized by section 112(i)(5) of the Act.

(b) (1) Section 112(l) of the Act directs the Administrator to delegate to each State, when appropriate, the authority to implement and enforce standards and other requirements pursuant to section 112 for stationary sources located in that State. Because of the unique nature of radioactive material, delegation of authority to implement and enforce standards that control radionuclides may require separate approval.

(2) Subpart E of this part establishes procedures consistent with section 112(l) for the approval of State rules or programs to implement and enforce applicable Federal rules promulgated under the authority of section 112. Subpart E also establishes procedures for the review and withdrawal of section 112 implementation and enforcement authorities granted through a section 112(l) approval.

(c) All information required to be submitted to the EPA under this part also shall be submitted to the appropriate State agency of any State to which authority has been delegated under section 112(l) of the Act, provided that each specific delegation may exempt sources from a certain Federal or State reporting requirement. The Administrator may permit all or some of the information to be submitted to the appropriate State agency only, instead of to the EPA and the State agency.

§ 63.13 [Reserved]

§ 63.14 Incorporations by reference.

(a) The materials listed in this section are incorporated by reference in the corresponding sections

noted. These incorporations by reference were approved by the Director of the Federal Register in accordance with 5 U.S.C. 552(a) and 1 CFR part 51. These materials are incorporated as they exist on the date of the approval, and notice of any change in these materials will be published in the FEDERAL REGISTER. The materials are available for purchase at the corresponding addresses noted below, and all are available for inspection at the Office of the Federal Register, 800 North Capitol Street, NW, suite 700, Washington, DC, at the Air and Radiation Docket and Information Center, U.S. EPA, 401 M Street, SW., Washington, DC, and at the EPA Library (MD-35), U.S. EPA, Research Triangle Park, North Carolina.

(b) The materials listed below are available for purchase from at least one of the following addresses: American Society for Testing and Materials (ASTM), 1916 Race Street, Philadelphia, Pennsylvania 19103; or University Microfilms International, 300 North Zeeb Road, Ann Arbor, Michigan 48106.

(1) ASTM D1946-77, Standard Method for Analysis of Reformed Gas by Gas Chromatography, IBR approved for § 63.11(b)(6).

(2) ASTM D2382-76, Heat of Combustion of Hydrocarbon Fuels by Bomb Calorimeter (High-Precision Method), IBR approved for § 63.11(b)(6).

(3) ASTM D2879-83, Standard Test Method for Vapor Pressure—Temperature Relationship and Initial Decomposition Temperature of Liquids by Isoteniscope, IBR approved for § 63.111 of subpart G of this part.

(4) ASTM D 3695-88, Standard Test Method for Volatile Alcohols in Water by Direct Aqueous-Injection Gas Chromatography, IBR approved for § 63.365(e)(1) of subpart O of this part.

(5) ASTM D 1193-77, Standard Specification for Reagent Water, IBR approved for Method 306, section 4.1.1 and section 4.4.2, of appendix A to part 63.

(6) ASTM D 1331-89, Standard Test Methods for Surface and Interfacial Tension of Solutions of Surface Active Agents, IBR approved for Method 306B, section 2.2, section 3.1, and section 4.2, of appendix A to part 63.

(7) ASTM E 260-91, Standard Practice for Packed Column Gas Chromatography, IBR approved for § 63.750(b)(2) of subpart GG of this part.

(8) ASTM D523-89, Standard Test Method for Specular Gloss, IBR approved for § 63.782.

(9) ASTM D1475-90, Standard Test Method for Density of Paint, Varnish, Lacquer, and Related Products, IBR approved for § 63.788 appendix A.

(10) ASTM D2369-93, Standard Test Method for Volatile Content of Coatings, IBR approved for § 63.788 appendix A.

(11) ASTM D3912-80, Standard Test Method for Chemical Resistance of Coatings Used in Light-Water Nuclear Power Plants, IBR approved for § 63.782.

(12) ASTM D4017-90, Standard Test Method for Water and Paints and Paint Materials by Karl Fischer Method, IBR approved for § 63.788 appendix A.

(13) ASTM D4082-89, Standard Test Method for Effects of Gamma Radiation on Coatings for Use in Light-Water Nuclear Power Plants, IBR approved for § 63.782.

(14) ASTM D4256-89 [reapproved 1994], Standard Test Method for Determination of the Decontaminability of Coatings Used in Light-Water Nuclear Power Plants, IBR approved for § 63.782.

(15) ASTM D3792-91, Standard Test Method for Water Content of Water-Reducible Paints by Direct Injection into a Gas Chromatograph, IBR approved for § 63.788 appendix A.

(16) ASTM D3257-93, Standard Test Methods for Aromatics in Mineral Spirits by Gas Chromatography, IBR approved for § 63.786(b).

(17) ASTM E260–91, Standard Practice for Packed Column Gas Chromatography, IBR approved for § 63.786(b).

(18) ASTM E180–93, Standard Practice for Determining the Precision of ASTM Methods for Analysis and Testing of Industrial Chemicals, IBR approved for § 63.786(b).

(c) – (d) [Reserved]

§ 63.15 Availability of information and confidentiality.

(a) Availability of information.

(1) With the exception of information protected through part 2 of this chapter, all reports, records, and other information collected by the Administrator under this part are available to the public. In addition, a copy of each permit application, compliance plan (including the schedule of compliance), notification of compliance status, excess emissions and continuous monitoring systems performance report, and title V permit is available to the public, consistent with protections recognized in section 503(e) of the Act.

(2) The availability to the public of information provided to or otherwise obtained by the Administrator under this part shall be governed by part 2 of this chapter.

(b) Confidentiality.

(1) If an owner or operator is required to submit information entitled to protection from disclosure under section 114(c) of the Act, the owner or operator may submit such information separately. The requirements of section 114(c) shall apply to such information.

(2) The contents of a title V permit shall not be entitled to protection under section 114(c) of the Act; however, information submitted as part of an application for a title V permit may be entitled to protection from disclosure.

40 CFR 63 Subpart II – § 63.782 Definitions

Terms used in this subpart are defined in the Clean Air Act (CAA), in subpart A of part 63, or in this section as follows:

Add-on control system means an air pollution control device such as a carbon absorber or incinerator that reduces pollution in an air stream by destruction or removal prior to discharge to the atmosphere.

Affected source means any shipbuilding or ship repair facility having surface coating operations with a minimum 1,000 liters (L) (264 gallons [gal]) annual marine coating usage that is subject to this subpart.

Air flask specialty coating means any special composition coating applied to interior surfaces of high pressure breathing air flasks to provide corrosion resistance and that is certified safe for use with breathing air supplies.

Antenna specialty coating means any coating applied to equipment through which electromagnetic signals must pass for reception or transmission.

Antifoulant specialty coating means any coating that is applied to the underwater portion of a vessel to prevent or reduce the attachment of biological organisms and that is registered with the EPA as a pesticide under the Federal Insecticide, Fungicide, and Rodenticide Act.

As applied means the condition of a coating at the time of application to the substrate, including any thinning solvent.

As supplied means the condition of a coating before any thinning, as sold and delivered by the coating manufacturer to the user.

Batch means the product of an individual production run of a coating manufacturer's process. A batch may vary in composition from other batches of the same product.

Bitumens mean black or brown materials that are soluble in carbon disulfide and consist mainly of hydrocarbons.

Bituminous resin coating means any coating that incorporates bitumens as a principal component and is formulated primarily to be applied to a substrate or surface to resist ultraviolet radiation and/or water.

Certify means, in reference to the volatile organic compounds (VOC) content or volatile organic hazardous air pollutants (VOHAP) content of a coating, to attest to the VOC content as determined through analysis by Method 24 of appendix A to 40 CFR part 60 or through use of forms and procedures outlined in appendix A of this subpart, or to attest to the VOHAP content as determined through an Administrator-approved test method. In the case of conflicting results, Method 24 of Appendix A to 40 CFR part 60 shall take precedence over the forms and procedures outlined in appendix A to this subpart for the options in which VOC is used as a surrogate for VOHAP.

Coating means any material that can be applied as a thin layer to a substrate and which cures to form a continuous solid film.

Cold-weather time period means any time during which the ambient temperature is below 4.5°C (40°F) and coating is to be applied.

Container of coating means the container from which the coating is applied, including but not limited to a bucket or pot.

Cure volatiles means reaction products which are emitted during the chemical reaction which takes place in some coating films at the cure temperature. These emissions are other than those from the solvents in the coating and may, in some cases, comprise a significant portion of total VOC and/or VOHAP emissions.

Epoxy means any thermoset coating formed by reaction of an epoxy resin (i.e., a resin containing a reactive epoxide with a curing agent).

Exempt compounds means specified organic compounds that are not considered VOC due to negligible photochemical reactivity. Exempt compounds are specified in 40 CFR 51.100(s).

Facility means all contiguous or adjoining property that is under common ownership or control.

including properties that are separated only by a road or other public right-of-way.

General use coating means any coating that is not a specialty coating.

Hazardous air pollutants (HAP) means any air pollutant listed in or pursuant to section 112(b) of the CAA.

Heat resistant specialty coating means any coating that during normal use must withstand a temperature of at least 204°C (400°F).

High-gloss specialty coating means any coating that achieves at least 85 percent reflectance on a 60 degree meter when tested by ASTM Method D523 (incorporation by reference - see § 63.14).

High-temperature specialty coating means any coating that during normal use must withstand a temperature of at least 426°C (800°F).

Inorganic zinc (high-build) specialty coating means a coating that contains 960 grams per liter (8 pounds per gallon) or more elemental zinc incorporated into an inorganic silicate binder that is applied to steel to provide galvanic corrosion resistance. (These coatings are typically applied at more than 2 mil dry film thickness.)

Major source means any source that emits or has the potential to emit, in the aggregate, 9.1 megagrams per year (10 tons per year) or more of any HAP or 22.7 megagrams per year (25 tons per year) or more of any combination of HAP.

Maximum allowable thinning ratio means the maximum volume of thinner that can be added per volume of coating without violating the standards of § 63.783(a), as determined using Equation 1 of this subpart.

Military exterior specialty coating or Chemical Agent Resistant Coatings (“CARC”) means any exterior topcoat applied to military or U.S. Coast Guard vessels that are subject to specific chemical, biological, and radiological washdown requirements.

Mist specialty coating means any low viscosity, thin film, epoxy coating applied to an inorganic zinc primer that penetrates the porous zinc primer and allows the occluded air to escape through the paint film prior to curing.

Navigational aids specialty coating means any coating applied to Coast Guard buoys or other Coast Guard waterway markers when they are recoated aboard ship at their usage site and immediately returned to the water.

Nonskid specialty coating means any coating applied to the horizontal surfaces of a marine vessel for the specific purpose of providing slip resistance for personnel, vehicles, or aircraft.

Nonvolatiles (or volume solids) means substances that do not evaporate readily. This term refers to the film-forming material of a coating.

Normally closed means a container or piping system is closed unless an operator is actively engaged in adding or removing material.

Nuclear specialty coating means any protective coating used to seal porous surfaces such as steel (or concrete) that otherwise would be subject to intrusion by radioactive materials. These coatings must be resistant to long-term (service life) cumulative radiation exposure (ASTM D4082-89 [incorporation by reference - see § 63.14]), relatively easy to decontaminate (ASTM D4256-89 [reapproved 1994] [incorporation by reference - see § 63.14]), and resistant to various chemicals to which the coatings are likely to be exposed (ASTM D3912-80 [incorporation by reference - see § 63.14]). [For nuclear coatings, see the general protective requirements outlined by the U.S. Nuclear Regulatory Commission in a report entitled “U.S. Atomic Energy Commission Regulatory Guide 1.54” dated June 1973, available through the Government Printing Office at (202) 512-2249 as document number A74062-00001.]

Operating parameter value means a minimum or maximum value established for a control device or process parameter that, if achieved by itself or in combination with one or more other operating parameter values, determines that an owner or operator has complied with an applicable emission limitation or standard.

Organic zinc specialty coating means any coating derived from zinc dust incorporated into an organic binder that contains more than 960 grams of elemental zinc per liter (8 pounds per gallon) of coating, as applied, and that is used for the expressed purpose of corrosion protection.

Pleasure craft means any marine or fresh-water vessel used by individuals for noncommercial, nonmilitary, and recreational purposes that is less than 20 meters in length. A vessel rented exclusively to or chartered by individuals for such purposes shall be considered a pleasure craft.

Pretreatment wash primer specialty coating means any coating that contains a minimum of 0.5 percent acid, by mass, and is applied only to bare metal to etch the surface and enhance adhesion of subsequent coatings.

Repair and maintenance of thermoplastic coating of commercial vessels (specialty coating) means any vinyl, chlorinated rubber, or bituminous resin coating that is applied over the same type of existing coating to perform the partial recoating of any in-use commercial vessel. (This definition does not include coal tar epoxy coatings, which are considered "general use" coatings.)

Rubber camouflage specialty coating means any specially formulated epoxy coating used as a camouflage topcoat for exterior submarine hulls and sonar domes.

Sealant for thermal spray aluminum means any epoxy coating applied to thermal spray aluminum surfaces at a maximum thickness of 1 dry mil.

Ship means any marine or fresh-water vessel used for military or commercial operations, including self-propelled vessels, those propelled by other craft (barges), and navigational aids (buoys). This definition includes, but is not limited to, all military and Coast Guard vessels, commercial cargo and passenger (cruise) ships, ferries, barges, tankers, container ships, patrol and pilot boats, and dredges. For purposes of this subpart, pleasure crafts and offshore oil and gas drilling platforms are not considered ships.

Shipbuilding and ship repair operations means any building, repair, repainting, converting, or alteration of ships.

Special marking specialty coating means any coating that is used for safety or identification applications, such as markings on flight decks and ships' numbers.

Specialty coating means any coating that is manufactured and used for one of the specialized applications described within this list of definitions.

Specialty interior coating means any coating used on interior surfaces aboard U.S. military vessels pursuant to a coating specification that requires the coating to meet specified fire retardant and low toxicity requirements, in addition to the other applicable military physical and performance requirements.

Tack specialty coating means any thin film epoxy coating applied at a maximum thickness of 2 dry mils to prepare an epoxy coating that has dried beyond the time limit specified by the manufacturer for the application of the next coat.

Thinner means a liquid that is used to reduce the viscosity of a coating and that evaporates before or during the cure of a film.

Thinning ratio means the volumetric ratio of thinner to coating, as supplied.

Thinning solvent: see Thinner.


Undersea weapons systems specialty coating means any coating applied to any component of a weapons system intended to be launched or fired from under the sea.

Volatile organic compounds (VOC) is as defined in § 51.100(s) of this chapter.

Volatile organic hazardous air pollutants (VOHAP) means any compound listed in or pursuant to section 112(b) of the CAA that contains carbon, excluding metallic carbides and carbonates. This definition includes VOC listed as HAP and exempt compounds listed as HAP.

Weld-through preconstruction primer (specialty coating) means a coating that provides corrosion protection for steel during inventory, is typically applied at less than 1 mil dry film thickness, does not require removal prior to welding, is temperature resistant (burn back from a weld is less than 1.25 centimeters [0.5 inch]), and does not normally require removal before applying film-building coatings, including inorganic zinc high-build coatings. When constructing new vessels, there may be a need to remove areas of weld-through preconstruction primer due to surface damage or contamination prior to application of film-building coatings.

40 CFR 63 Subpart II - Figure 1. Flow diagram of compliance procedures

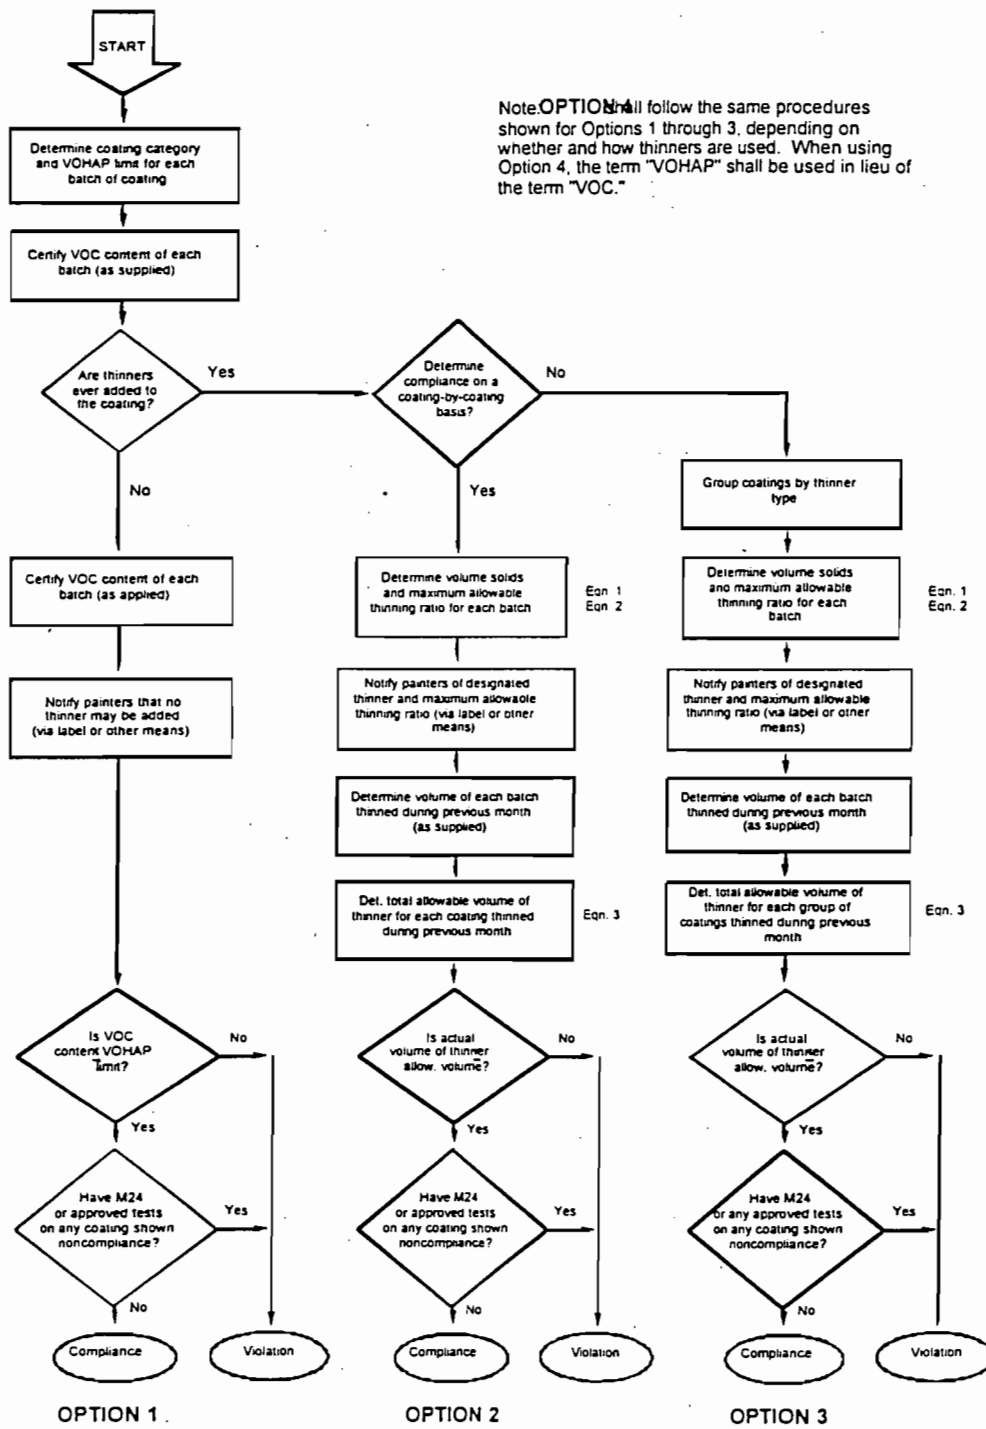

**40 CFR 63 Subpart II - TABLE 2
VOLATILE ORGANIC HAP (VOHAP) LIMITS FOR MARINE COATINGS**

Coating Category	VOHAP limits ^{a,b,c}		
	grams/liter coating (minus water and exempt compounds)	grams/liter solids ^d	
		t ≥ 4.5°C	t < 4.5°C ^e
General use	340	571	728
Specialty	--	--	--
Air flask	340	571	728
Antenna	530	1,439	--
Antifoulant	400	765	971
Heat resistant	420	841	1,069
High-gloss	420	841	1,069
High-temperature	500	1,237	1,597
Inorganic zinc high-build	340	571	728
Military exterior	340	571	728
Mist	610	2,235	--
Navigational aids	550	1,597	--
Nonskid	340	571	728
Nuclear	420	841	1,069
Organic zinc	360	630	802
Pretreatment wash primer	780	11,095	--
Repair and maint. of thermoplastics	550	1,597	--
Rubber camouflage	340	571	728
Sealant for thermal spray aluminum	610	2,235	--
Special marking	490	1,178	--
Specialty interior	340	571	728
Tack coat	610	2,235	--
Undersea weapons systems	340	571	728
Weld-through precon. primer	650	2,885	--

^aThe limits are expressed in two sets of equivalent units. Either set of limits may be used for the compliance procedure described in 40 CFR 63.785(c)(1), but only the limits expressed in units of g/L solids (nonvolatiles) shall be used for the compliance procedures described 40 CFR 63.785(c)(2)-(4).

^bVOC (including exempt compounds listed as HAP) shall be used as a surrogate for VOHAP for those compliance procedures described in 40 CFR 63.785(c)(1)-(3).

^cTo convert from g/L to lb/gal, multiply by (3.785 L/gal)/(1/453.6 lb/g) or 1/120. For compliance purposes, metric units define the standards.

^dVOHAP limits expressed in units of mass of VOHAP per volume of solids were derived from the VOHAP limits expressed in units of mass of VOHAP per volume of coating assuming the coatings contain no water or exempt compounds and that the volumes of all components within a coating are additive.

^eThese limits apply during cold-weather time periods, as defined in 40 CFR 63.782. Cold-weather allowances are not given to coatings in categories that permit less than 40 percent volume solids (nonvolatiles). Such coatings are subject to the same limits regardless of weather conditions.

**TABLE 3 TO SUBPART II OF PART 63
SUMMARY OF RECORDKEEPING AND REPORTING REQUIREMENTS^{a,b,c}**

Requirement	All Opts.		Option 1		Option 2		Option 3	
	Rec	Rep	Rec	Rep	Rec	Rep	Rec	Rep
Notification (40 CFR 63.9(a)-(d))	X	X						
Implementation plan (40 CFR 63.787(b)) ^d	X	X						
Volume of coating applied at unaffected major sources (40 CFR 63.781(b))	X							
Volume of each low-usage-exempt coating applied at affected sources (40 CFR 63.781(c))	X	X						
ID of the coatings used, their appropriate coating categories, and the applicable VOHAP limit	X	X						
Determination of whether containers meet the standards described in 40 CFR 63.783(b)(2)	X	X						
Results of M-24 or other approved tests	X	X						
Certification of the as-supplied VOC content of each batch	X							
Certification of the as-applied VOC content of each batch			X					
Volume of each coating applied			X	X				
Density of each thinner and volume fraction of solids in each batch					X		X	
Maximum allowable thinning ratio(s) for each batch					X	X	X	X
Volume used of each batch, as supplied					X	X	X	X
Total allowable volume of thinner					X	X	X	X
Actual volume of thinner used					X	X	X	X
Identification of each group of coatings and designated thinners							X	X

^aAffected sources that comply with the cold-weather limits must record and report additional information, as specified in 40 CFR 63.788(b)(3)(ii)(C), (iii)(C), and (iv)(D).

^bAffected sources that detect a violation must record and report additional information, as specified in 40 CFR 63.788(b)(4).

^cOPTION 4: the recordkeeping and reporting requirements of Option 4 are identical to those of Options 1, 2, or 3, depending on whether and how thinners are used. However, when using Option 4, the term "VOHAP" shall be used in lieu of the term "VOC," and the owner or operator shall record and report the Permitting authority-approved VOHAP test method or certification procedure.

^dMajor sources that intend to become area sources by the compliance date may, in lieu of submitting an implementation plan, choose to submit a statement of intent as specified in 40 CFR 63.787(b)(4).

40 CFR 63 SUBPART II - APPENDIX A
VOC DATA SHEET:¹

PROPERTIES OF THE COATING "AS SUPPLIED" BY THE MANUFACTURER²

Coating Manufacturer:

Coating Identification: _____ Batch
Identification: _____

Supplied To:

Properties of the coating as supplied¹ to the customer:

- A. Coating Density: $(D_c)_s$ _____ g/L
[] ASTM D1475-90* [] Other³
- B. Total Volatiles: $(m_v)_s$ _____ Mass Percent
[] ASTM D2369-93* [] Other³
- C. Water Content: 1. $(m_w)_s$ _____ Mass Percent
[] ASTM D3792-91* [] ASTM D4017-90* [] Other³
2. $(v_w)_s$ _____ Volume Percent
[] Calculated [] Other³
- D. Organic Volatiles: $(m_o)_s$ _____ Mass Percent
- E. Nonvolatiles: $(v_n)_s$ _____ Volume Percent
[] Calculated [] Other³
- F. VOC Content (VOC)_s: 1. _____ g/L solids (nonvolatiles)
2. _____ g/L coating (less water and exempt compounds)
- G. Thinner Density: D_{th} _____ g/L
ASTM _____ [] Other³

Remarks: (use reverse side)

Signed _____ Date:


*Incorporation by reference--see 40 CFR 63.14.

¹Adapted from EPA-340/1-86-016 (July 1986), p. II-2.

²The subscript "s" denotes each value is for the coating "as supplied" by the manufacturer.

³Explain the other method used under "Remarks."

Maximum allowable thinning rates as a function of as-supplied VOC content and thinner density. a,b

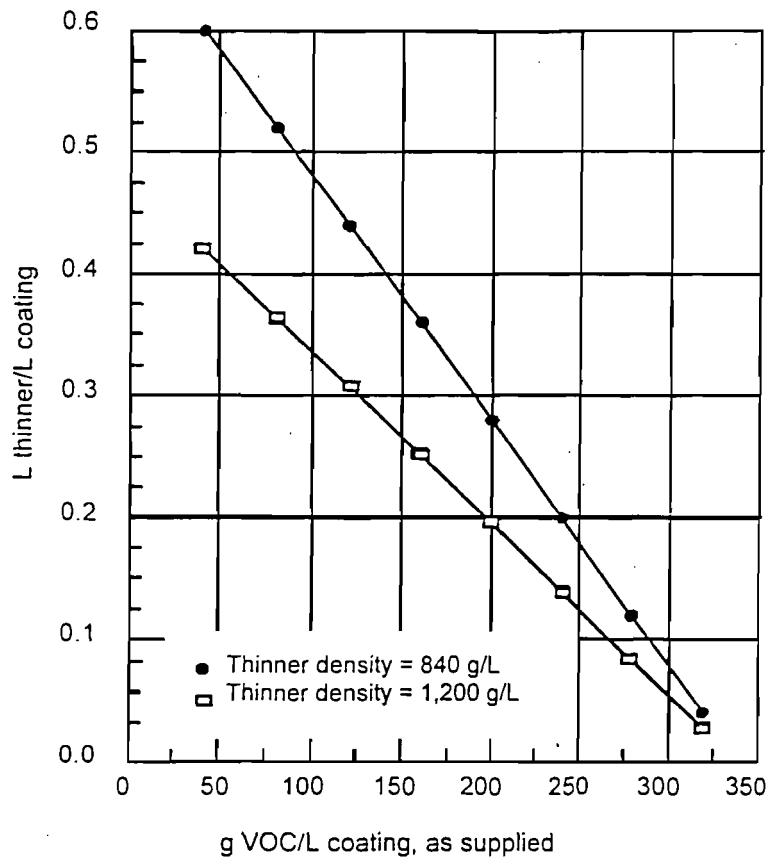

^a These graphs represent maximum allowable thinning ratios for general use coatings without water or exempt compounds.
^b The average density of the volatiles in the coating was assumed = 840 g solvent/L solvent.

Acid Rain Part Application

For more information, see instructions and refer to 40 CFR 72.30 and 72.31 and Chapter 62-214, F.A.C.

This submission is: New Revised

STEP 1

Identify the source by plant name, State, and ORIS code

Plant Name	Big Bend Station	State	FL	ORIS Code	0645
------------	------------------	-------	----	-----------	------

STEP 2

Enter the unit ID# for every Acid Rain unit at the Acid Rain source in column "a." For new units, enter the requested information in columns "c" and "d."

a Unit ID#	b Unit will hold allowances in accordance with 40 CFR 72.9(c)(1)	c New Units Commence Operation Date	d New Units Monitor Certification Deadline
BB01	Yes		
BB02	Yes		
BB03	Yes		
BB04	Yes		
	Yes		
	Yes		
	Yes		
	Yes		
	Yes		
	Yes		
	Yes		
	Yes		

Big Bend Station

Plant Name (from Step 1)

STEP 3
Read the standard requirementsAcid Rain Part Requirements

- (1) The designated representative of each Acid Rain source and each Acid Rain unit at the source shall:
 - (i) Submit a complete Acid Rain part application (including a compliance plan) under 40 CFR part 72 and Rules 62-214.320 and 330, F.A.C. in accordance with the deadlines specified in Rules 62-214.320, F.A.C.; and
 - (ii) Submit in a timely manner any supplemental information that the Department determines is necessary in order to review an Acid Rain part application and issue or deny an Acid Rain part.
- (2) The owners and operators of each Acid Rain source and each Acid Rain unit at the source shall:
 - (i) Operate the unit in compliance with a complete Acid Rain part application or a superseding Acid Rain part issued by the Department; and
 - (ii) Have an Acid Rain Part.

Monitoring Requirements

- (1) The owners and operators and, to the extent applicable, designated representative of each Acid Rain source and each Acid Rain unit at the source shall comply with the monitoring requirements as provided in 40 CFR part 75, and Rule 62-214.420, F.A.C.
- (2) The emissions measurements recorded and reported in accordance with 40 CFR part 75 shall be used to determine compliance by the unit with the Acid Rain emissions limitations and emissions reduction requirements for sulfur dioxide and nitrogen oxides under the Acid Rain Program.
- (3) The requirements of 40 CFR part 75 shall not affect the responsibility of the owners and operators to monitor emissions of other pollutants or other emissions characteristics at the unit under other applicable requirements of the Act and other provisions of the operating permit for the source.

Sulfur Dioxide Requirements

- (1) The owners and operators of each source and each Acid Rain unit at the source shall:
 - (i) Hold allowances, as of the allowance transfer deadline, in the unit's compliance subaccount (after deductions under 40 CFR 73.34(c)), or in the compliance subaccount of another Acid Rain unit at the same source to the extent provided in 40 CFR 73.35(b)(3), not less than the total annual emissions of sulfur dioxide for the previous calendar year from the unit; and
 - (ii) Comply with the applicable Acid Rain emissions limitations for sulfur dioxide.
- (2) Each ton of sulfur dioxide emitted in excess of the Acid Rain emissions limitations for sulfur dioxide shall constitute a separate violation of the Act.
- (3) An Acid Rain unit shall be subject to the requirements under paragraph (1) of the sulfur dioxide requirements as follows:
 - (i) Starting January 1, 2000, an Acid Rain unit under 40 CFR 72.8(a)(2); or
 - (ii) Starting on the later of January 1, 2000 or the deadline for monitor certification under 40 CFR part 75, an Acid Rain unit under 40 CFR 72.6(a)(3).
- (4) Allowances shall be held in, deducted from, or transferred among Allowance Tracking System accounts in accordance with the Acid Rain Program.
- (5) An allowance shall not be deducted in order to comply with the requirements under paragraph (1) of the sulfur dioxide requirements prior to the calendar year for which the allowance was allocated.
- (6) An allowance allocated by the Administrator under the Acid Rain Program is a limited authorization to emit sulfur dioxide in accordance with the Acid Rain Program. No provision of the Acid Rain Program, the Acid Rain part application, the Acid Rain part, or an exemption under 40 CFR 72.7 or 72.8 and no provision of law shall be construed to limit the authority of the United States to terminate or limit such authorization.
- (7) An allowance allocated by the Administrator under the Acid Rain Program does not constitute a property right.

Nitrogen Oxides Requirements The owners and operators of the source and each Acid Rain unit at the source shall comply with the applicable Acid Rain emissions limitation for nitrogen oxides.

Excess Emissions Requirements

- (1) The designated representative of an Acid Rain unit that has excess emissions in any calendar year shall submit a proposed offset plan, as required under 40 CFR part 77.
- (2) The owners and operators of an Acid Rain unit that has excess emissions in any calendar year shall:
 - (i) Pay without demand the penalty required, and pay upon demand the interest on that penalty, as required by 40 CFR part 77; and
 - (ii) Comply with the terms of an approved offset plan, as required by 40 CFR part 77.

Recordkeeping and Reporting Requirements

- (1) Unless otherwise provided, the owners and operators of the source and each Acid Rain unit at the source shall keep on site at the source each of the following documents for a period of 5 years from the date the document is created. This period may be extended for cause, at any time prior to the end of 5 years, in writing by the EPA or the Department:
 - (i) The certificate of representation for the designated representative for the source and each Acid Rain unit at the source and all documents that demonstrate the truth of the statements in the certificate of representation, in accordance with Rule 62-214.350, F.A.C.; provided that the certificate and documents shall be retained on-site at the source beyond such 5-year period until such documents are superseded because of the submission of a new certificate of representation changing the designated representative;
 - (ii) All emissions monitoring information, in accordance with 40 CFR part 75, provided that to the extent that 40 CFR part 75 provides for a 3-year period for recordkeeping, the 3-year period shall apply;
 - (iii) Copies of all reports, compliance certifications, and other submissions and all records made or required under the Acid Rain Program; and,

Big Bend Station

Plant Name (from Step 1)

STEP 3,
Cont'd.

Recordkeeping and Reporting Requirements (cont)

- (iv) Copies of all documents used to complete an Acid Rain part application and any other submission under the Acid Rain Program or to demonstrate compliance with the requirements of the Acid Rain Program.
- (2) The designated representative of an Acid Rain source and each Acid Rain unit at the source shall submit the reports and compliance certifications required under the Acid Rain Program, including those under 40 CFR part 72 subpart I and 40 CFR part 75.

Liability

- (1) Any person who knowingly violates any requirement or prohibition of the Acid Rain Program, a complete Acid Rain part application, an Acid Rain part, or an exemption under 40 CFR 72.7 or 72.8, including any requirement for the payment of any penalty owed to the United States, shall be subject to enforcement pursuant to section 113(c) of the Act.
- (2) Any person who knowingly makes a false, material statement in any record, submission, or report under the Acid Rain Program shall be subject to criminal enforcement pursuant to section 113(c) of the Act and 18 U.S.C. 1001.
- (3) No permit revision shall excuse any violation of the requirements of the Acid Rain Program that occurs prior to the date that the revision takes effect.
- (4) Each Acid Rain source and each Acid Rain unit shall meet the requirements of the Acid Rain Program.
- (5) Any provision of the Acid Rain Program that applies to an Acid Rain source (including a provision applicable to the designated representative of an Acid Rain source) shall also apply to the owners and operators of such source and of the Acid Rain units at the source.
- (6) Any provision of the Acid Rain Program that applies to an Acid Rain unit (including a provision applicable to the designated representative of an Acid Rain unit) shall also apply to the owners and operators of such unit. Except as provided under 40 CFR 72.44 (Phase II repowering extension plans) and 40 CFR 76.11 (NO_x averaging plans), and except with regard to the requirements applicable to units with a common stack under 40 CFR part 75 (including 40 CFR 75.16, 75.17, and 75.18), the owners and operators and the designated representative of one Acid Rain unit shall not be liable for any violation by any other Acid Rain unit of which they are not owners or operators or the designated representative and that is located at a source of which they are not owners or operators or the designated representative.
- (7) Each violation of a provision of 40 CFR parts 72, 73, 75, 76, 77, and 78 by an Acid Rain source or Acid Rain unit, or by an owner or operator or designated representative of such source or unit, shall be a separate violation of the Act.

Effect on Other Authorities

No provision of the Acid Rain Program, an Acid Rain part application, an Acid Rain part, or an exemption under 40 CFR 72.7 or 72.8 shall be construed as:


- (1) Except as expressly provided in title IV of the Act, exempting or excluding the owners and operators and, to the extent applicable, the designated representative of an Acid Rain source or Acid Rain unit from compliance with any other provision of the Act, including the provisions of title I of the Act relating to applicable National Ambient Air Quality Standards or State Implementation Plans;
- (2) Limiting the number of allowances a unit can hold; provided, that the number of allowances held by the unit shall not affect the source's obligation to comply with any other provisions of the Act;
- (3) Requiring a change of any kind in any State law regulating electric utility rates and charges, affecting any State law regarding such State regulation, or limiting such State regulation, including any prudence review requirements under such State law;
- (4) Modifying the Federal Power Act or affecting the authority of the Federal Energy Regulatory Commission under the Federal Power Act; or
- (5) Interfering with or impairing any program for competitive bidding for power supply in a State in which such program is established.

Certification

STEP 4

Read the certification statement, sign, and date

I am authorized to make this submission on behalf of the owners and operators of the Acid Rain source or Acid Rain units for which the submission is made. I certify under penalty of law that I have personally examined, and am familiar with, the statements and information submitted in this document and all its attachments. Based on my inquiry of those individuals with primary responsibility for obtaining the information, I certify that the statements and information are to the best of my knowledge and belief true, accurate, and complete. I am aware that there are significant penalties for submitting false statements and information or omitting required statements and information, including the possibility of fine or imprisonment.

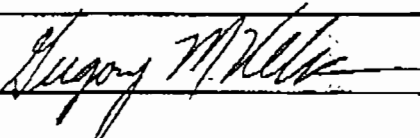Name	Gregory M. Nelson	
Signature		Date 6/7/04

IN THE CIRCUIT COURT OF THE THIRTEENTH JUDICIAL CIRCUIT
IN AND FOR HILLSBOROUGH COUNTY, FLORIDA

STATE OF FLORIDA DEPARTMENT
OF ENVIRONMENTAL PROTECTION,

Plaintiff,

vs.

CASE NO.:

TAMPA ELECTRIC COMPANY,

Defendant.

_____ /

CONSENT FINAL JUDGMENT

I. INTRODUCTION AND PURPOSE

A. This Consent Final Judgment is entered into between Plaintiff, State of Florida, Department of Environmental Protection (the "DEP"), and Defendant, Tampa Electric Company ("TAMPA ELECTRIC COMPANY"), to reach a settlement of certain matters at issue between them. The Consent Final Judgment provides for the implementation of certain actions, the investigation and implementation of certain pollution prevention technology, and the contribution of funds to assist the DEP in its Bay Regional Air Chemistry Experiment program relating to nitrogen deposition in Tampa Bay.

B. "Consent Final Judgment" means this Consent Final Judgment, including any future modifications, and any reports, plans, specifications and schedules required by the Consent Final Judgment which, upon the approval of each by the DEP, shall be deemed incorporated into and become an enforceable part of this Consent Final Judgment as though each was originally set forth herein.

II. JURISDICTION

A. The DEP is the administrative agency of the State of Florida having the power and duty to protect Florida's air and water resources, and to administer and enforce the provisions of Chapter 403, Florida Statutes, and the rules promulgated thereunder, Florida Administrative Code ("F.A.C.") Title 62 including the rules which Florida has the responsibility to administer and enforce under the federally approved Florida State Implementation Plan (SIP) and the separate Environmental Protection Agency delegation of PSD authority.

B. This Court has jurisdiction over the subject matter herein and over the Parties hereto pursuant to Chapter 403, Florida Statutes.

C. This Court retains jurisdiction over both the subject matter of this Consent Final Judgment and the Parties during the performance of its terms to enforce compliance therewith, if necessary.

III. PARTIES BOUND

This Consent Final Judgment shall apply to and be binding upon the DEP and TAMPA ELECTRIC COMPANY, (hereinafter individually defined as a "Party" or together defined as "Parties") and their successors and assigns. Each person signing this Consent Final Judgment certifies that he or she is authorized to execute the Consent Final Judgment and to legally bind to it the party on whose behalf he or she signs the Consent Final Judgment.

IV. STATEMENT OF FACTS

A. TAMPA ELECTRIC COMPANY owns and is an operator of the Big Bend coal fired electric generation plant in Hillsborough County. Big Bend generates

electricity from four steam generating boilers which are designated as Big Bend Unit 1, Big Bend Unit 2, Big Bend Unit 3, and Big Bend Unit 4. TAMPA ELECTRIC COMPANY also owns and is an operator of the Gannon coal fired electric generation plant in Hillsborough County. Gannon generates electricity from six steam generating boilers which are designated as Gannon Unit 1, Gannon Unit 2, Gannon Unit 3, Gannon Unit 4, Gannon Unit 5, and Gannon Unit 6.

B. The DEP has alleged that Tampa Electric Company undertook a number of activities at the Gannon and Big Bend Generating Stations without appropriate regulatory review and permits, in violation of Chapter 403, Florida Statutes, and applicable provisions of the federally approved SIP. These activities include, but are not limited to, the following:

1. TAMPA ELECTRIC COMPANY modified, and thereafter operated, its electric generating units at Big Bend and Gannon, which are coal fired electricity generating power plants in Hillsborough County, Florida, without first obtaining appropriate permits authorizing this construction and without installing the best control technology (BACT) to control emissions of nitrogen oxides, sulfur dioxide, and particulate matter, as required by Florida law.

2. As a result of TAMPA ELECTRIC COMPANY's operation of the power plants, these unlawful modifications and the absence of appropriate controls, sulfur dioxide, nitrogen oxides, and particulate matter have been, and still are being, released into the atmosphere aggravating air pollution locally and downwind from these plants.

3. At various times, TAMPA ELECTRIC COMPANY commenced construction of modifications at Big Bend. These modifications included, but are not

limited to: (1) replacement of steam drum internals in Big Bend Units 1 and 2 in 1994 and 1991, respectively; (2) replacement of the waterwall in Big Bend Unit 2 in 1994, and (3) replacement of the high temperature reheater in Big Bend Unit 2 in 1994.

4. Such modifications by TAMPA ELECTRIC COMPANY were done without obtaining a permit from the DEP and without applying BACT for nitrogen oxide, sulfur dioxide and particulate matter as required by Chapter 403, Florida Statutes.

5. At various times, TAMPA ELECTRIC COMPANY commenced construction of modifications to Gannon. These modifications included, but were not limited to: (1) replacement of the furnace floor in Gannon Unit 3 with a new design in 1996; and, (2) replacement of the cyclone in Gannon Unit 4 in 1994.

6. Such modifications by TAMPA ELECTRIC COMPANY were done without obtaining a permit from the DEP and without applying BACT for nitrogen oxide, sulfur dioxide and particulate matter as required by Chapter 403, Florida Statutes.

C. Tampa Electric Company has agreed to the entry of the Consent Final Judgment and has agreed to implement the requirements of the Consent Final Judgment without an admission of liability and in recognition of the benefits of resolving litigation and elimination of such related expenses as settlement of the claims set forth in the Complaint, which Tampa Electric Company believes to be disputed claims. Tampa Electric Company neither admits nor denies the facts set forth in the Complaint and in Section IV.B. of this Consent Final Judgment.

V. REQUIREMENTS OF THE CONSENT FINAL JUDGMENT

A. TAMPA ELECTRIC COMPANY shall shut down coal-fired Units 1, 2, and 6 at Gannon Station and repower Units 3, 4, & 5 for gas to be phased-in between

January 1, 2003 and December 31, 2004. The repowered Units shall meet BACT for nitrogen oxide applicable to combined cycle gas turbines with an emission rate of 3.5 ppm. This requirement shall be included as a permit condition issued through the normal process.

B. TAMPA ELECTRIC COMPANY shall evaluate using "zero-ammonia" nitrogen oxide control technology at its Gannon facility. If, by May, 2000, such technology is found by the DEP to be commercially viable, TAMPA ELECTRIC COMPANY shall install such technology on one of the units it intends to repower so long as the incremental capital cost differential above the cost of Selective Catalytic Reduction (SCR) does not exceed \$8 million and TAMPA ELECTRIC COMPANY obtains acceptable performance guarantees and remedies from the manufacturer of the technology. The installation shall be performed as part of the repowering process and shall be completed no later than December 31, 2004. In the event that the DEP does not find that the technology is commercially viable, then by December 31, 2004, TAMPA ELECTRIC COMPANY shall spend up to \$8 million to demonstrate alternative commercially viable nitrogen oxide reduction technologies for natural gas-fired or coal-fired generating facilities as determined by the DEP and TAMPA ELECTRIC COMPANY.

C. At Big Bend Station, the new scrubber serving Units 1&2 is currently going through performance testing and is scheduled for commercial operation on or about January 1, 2000. It has a guaranteed removal efficiency of 93% but is the first Unit with a large, high velocity tower serving approximately 800 mega watts TAMPA ELECTRIC COMPANY shall use reasonable commercial efforts to optimize the removal efficiency

to achieve a 95% removal efficiency by May 1, 2002 if such rate is not achieved by commercial operation.

D. TAMPA ELECTRIC COMPANY shall maximize scrubber utilization on all four boilers at Big Bend. The DEP recognizes the need for shut down for operational reasons.

E. TAMPA ELECTRIC COMPANY shall add nitrogen oxide controls, repower or shut down Units 1 through 3 at Big Bend Station by May 2010 and at Unit 4 at Big Bend Station by May 2007. If SCRs or similar nitrogen oxide controls are installed, BACT for nitrogen oxide will be .10 lbs./mmBTU on Unit 4 and .15 lbs./mmBTU on Units 1, 2, and 3.

F. TAMPA ELECTRIC COMPANY shall undertake a performance optimization study and a BACT analysis of its electrostatic precipitators and make reasonable upgrades to the electrostatic precipitators at Big Bend Station by May 1, 2003, if the study indicates that reasonable upgrades are necessary to obtain performance optimization.

G. TAMPA ELECTRIC COMPANY shall report to DEP on the technical feasibility of installing a particulate matter continuous emissions monitor on one stack at Big Bend March 1, 2002. If the DEP determines by May 31, 2002 that installation to be technically feasible, TAMPA ELECTRIC COMPANY shall install a particulate matter continuous emissions monitor on one stack at Big Bend station no later than May 1, 2003. Such monitor shall be installed solely for demonstration and informational purposes.

H. TAMPA ELECTRIC COMPANY shall be entitled to retain all sulfur dioxide reduction credits as currently authorized by law and freely trade them as allowed by the acid rain program. These credits were an integral part of the economics of the repowering project. If a credit trading program is developed by state or federal law for nitrogen oxide, TAMPA ELECTRIC COMPANY shall bank such credits obtained from the reductions achieved through the implementation of this Consent Final Judgment, but such credits shall not be eligible for sale to third parties but shall be held for TAMPA ELECTRIC COMPANY's (or any affiliate's) own account.

I. TAMPA ELECTRIC COMPANY shall agree to cooperate with the DEP on its Bay Regional Air Chemistry Experiment BRACE program relating to nitrogen deposition in Tampa Bay, including allowing necessary stack testing access to the DEP, and contributing \$2 million dollars to the Hillsborough Environmental Protection Commission (EPC) for use in the BRACE program, in lieu of civil penalties. The DEP will enter into an agreement with EPC to ensure that the funds are spent on the BRACE program. TAMPA ELECTRIC COMPANY shall make the first payment to EPC in the amount of \$500,000 by July 1, 2000, and shall pay \$500,000 each six months thereafter until the full \$2 million dollars has been paid.

J. TAMPA ELECTRIC COMPANY shall collaborate with the DEP to develop and implement State tax policy aimed at emissions reductions and such other supplemental environmental programs which are agreed to by TAMPA ELECTRIC COMPANY and the DEP.

K. TAMPA ELECTRIC COMPANY shall be entitled to relief from the time requirements of this Consent Final Judgment in the event of a force majeure that

includes, among other things, delays in regulatory approvals, construction, labor, material or equipment delays, natural gas and gas transportation availability delays, acts of God or other similar events that are beyond the control of the company and not resulting from its own actions, for the length of time necessarily imposed by the delay.

L. TAMPA ELECTRIC COMPANY shall be released from civil liability for all past New Source Review (NSR) related acts and State Implementation Plan (SIP) violations associated with the Prevention of Significant Deterioration (PSD), New Source Performance Standards (NSPS) and NSR related matters set forth herein and in the Complaint.

M. TAMPA ELECTRIC COMPANY shall also be protected from triggering NSR requirements with respect to repairs, maintenance and physical or operation changes during the term of the Consent Final Judgment which term shall remain effective until the actions required hereunder have been implemented.

N. The DEP shall cooperate with TAMPA ELECTRIC COMPANY and the United States Environmental Protection Agency in an effort to clarify the NSR regulations for repairs, maintenance, physical and operation changes in the future.

O. TAMPA ELECTRIC COMPANY's obligation to implement the emissions reductions and other requirements set forth herein will be conditioned on the receipt of necessary federal, state and local environmental permits, and acceptable regulatory treatment, including cost recovery by the Florida Public Service Commission.

P. DEP will defend the terms of this Consent Final Judgment in any action to which it is a party.

VI. MISCELLANEOUS

A. This Consent Final Judgment embodies the entire agreement and understanding of the Parties and supersedes any and all prior agreements, drafts, arrangements, conversations, negotiations or understandings relating to matters provided for in the Consent Final Judgment.

B. This Consent Final Judgment may be executed in one or more counterparts, each of which will be deemed an original, but all of which together will constitute one and the same instrument.

C. Each provision of the Consent Final Judgment shall be interpreted in such a manner as to be effective and valid under applicable law, but if any provision of the Consent Final Judgment shall be prohibited or invalid under applicable law, such provision shall be ineffective to the extent of such prohibition or invalidity, without invalidating the remainder of such provision or the remaining provisions of the Consent Final Judgment.

D. This Consent Final Judgment is not, and shall not be construed to be, a permit issued pursuant to any federal, State or local law, rule or regulation.

E. If, for any reason, the Court should decline to enter this Consent Final Judgment in the form in which it is lodged, the Consent Final Judgment as lodged is voidable, at the sole discretion of either Party. The Parties agree that because the claims of the DEP contained herein were disputed as to validity and amount, none of the terms of the lodged but voided Consent Final Judgment may be used as evidence in any litigation for any purpose, except with the written consent of TAMPA ELECTRIC COMPANY.

F. Except as provided for herein, there shall be no modifications or amendments of this Consent Final Judgment without written agreement of the Parties to this Consent Final Judgment and approval by the Court.

VII. FINAL JUDGMENT/RETENTION OF JURISDICTION

This Consent Final Judgment constitutes a final judgment in this action. This Court will retain jurisdiction for the purpose of enabling the Parties to apply to the Court at any time for such further order, direction or relief as may be necessary or appropriate for the construction or modification of this Consent Final Judgment, or to effectuate or enforce compliance with its terms, or to resolve disputes.

DONE AND ORDERED IN CHAMBERS this ___ day of _____, 1999.

ORIGINAL SIGNED

DEC 16 1999

ROBERT H. BONANNO
CIRCUIT JUDGE

Circuit Judge

FLORIDA DEPARTMENT OF ENVIRONMENTAL PROTECTION

By: *David B. Shuck*
Secretary of the Florida Department of Environmental Protection

Date: *December 6, 1999*

TAMPA ELECTRIC COMPANY

By: *J.B. Ramil*
John B. Ramil
President

Date: *DECEMBER 6, 1999*

Florida Department of Environmental Protection

Phase II NO_x Compliance Plan

For more information, see instructions and refer to 40 CFR 76.9

This submission is:

New Revised

Page **1** of **3**

STEP 1 Indicate plant name, state, and ORIS code from NADB, if applicable.	Big Bend Station Plant Name	FL State	0645 ORIS Code
STEP 2	Identify each affected Group 1 and Group 2 boiler using the boiler ID# from NADB, if applicable. Indicate boiler types: "CB" for cell burner, "CY" for cyclone, "DBW" for dry bottom wall-fired, "T" for tangentially fired, "V" for vertically fired, and "WB" for wet bottom. Indicate the compliance option selected for each unit.		

ID#	ID#	ID#	ID#	ID#	ID#
BB01	BB02	BB03	BB04		
Type	Type	Type	Type	Type	Type
WB	WB	WB	T		

- | | | | | | | |
|---|-------------------------------------|-------------------------------------|-------------------------------------|-------------------------------------|--------------------------|--------------------------|
| (a) Standard annual average emission limitation of 0.50 lb/mmBtu (for Phase I dry bottom wall-fired boilers) | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| (b) Standard annual average emission limitation of 0.45 lb/mmBtu (for Phase I tangentially fired boilers) | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| (c) EPA-approved early election plan under 40 CFR 76.8 through 12/31/07 (also indicate above emission limit specified in plan) | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| (d) Standard annual average emission limitation of 0.46 lb/mmBtu (for Phase II dry bottom wall-fired boilers) | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| (e) Standard annual average emission limitation of 0.40 lb/mmBtu (for Phase II tangentially fired boilers) | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| (f) Standard annual average emission limitation of 0.68 lb/mmBtu (for cell burner boilers) | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| (g) Standard annual average emission limitation of 0.86 lb/mmBtu (for cyclone boilers) | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| (h) Standard annual average emission limitation of 0.80 lb/mmBtu (for vertically fired boilers) | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| (i) Standard annual average emission limitation of 0.84 lb/mmBtu (for wet bottom boilers) | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| (j) NO _x Averaging Plan (Include NO _x Averaging form) | <input checked="" type="checkbox"/> | <input checked="" type="checkbox"/> | <input checked="" type="checkbox"/> | <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| (k) Common stack pursuant to 40 CFR 75.17(a)(2)(i)(A) (check the standard emission limitation box above for most stringent limitation applicable to any unit utilizing stack) | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |

Big Bend Station
 Plant Name (from Step 1)

STEP 2, cont'd.

ID#	ID#	ID#	ID#	ID#	ID#
BB01	BB02	BB03	BB04		
Type WB	Type WB	Type WB	Type T	Type	Type

(l) Common stack pursuant to 40 CFR 75.17(a)(2)(i)(B) with NO_x Averaging (check the NO_x Averaging Plan box and include NO_x Averaging Form)

(m) EPA-approved common stack apportionment method pursuant to 40 CFR 75.17 (a)(2)(i)(C), (a)(2)(iii)(B), or (b)(2)

(n) AEL (include Phase II AEL Demonstration Period, Final AEL Petition, or AEL Renewal form as appropriate)

(o) Petition for AEL demonstration period or final AEL under review by U.S. EPA or demonstration period ongoing

(p) Repowering extension plan approved or under review

STEP 3
 Read the standard requirements and certification, enter the name of the designated representative, sign and date.

Standard Requirements:

General. This source is subject to the standard requirements in 40 CFR 72.9 (consistent with 40 CFR 76.8(e)(1)(i)). These requirements are listed in this source's Acid Rain Part of its Title V permit.

Special Provisions for Early Election Units

Nitrogen Oxides. A unit that is governed by an approved early election plan shall be subject to an emissions limitation for NO_x as provided under 40 CFR 76.8(a)(2) except as provided under 40 CFR 76.8(e)(3)(iii).

Liability. The owners and operators of a unit governed by an approved early election plan shall be liable for any violation of the plan or 40 CFR 76.8 at that unit. The owners and operators shall be liable, beginning January 1, 2000, for fulfilling the obligations specified in 40 CFR Part 77.


Termination. An approved early election plan shall be in effect only until the earlier of January 1, 2008, or January 1 of the calendar year for which a termination of the plan takes effect. If the designated representative of the unit under an approved early election plan fails to demonstrate compliance with the applicable emissions limitation under 40 CFR 76.5 for any year during the period beginning January 1 of the first year the early election takes effect and ending December 31, 2007, the permitting authority will terminate the plan. The termination will take effect beginning January 1 of the year after the year for which there is a failure to demonstrate compliance, and the designated representative may not submit a new early election plan. The designated representative of the unit under an approved early election plan may terminate the plan any year prior to 2008 but may not submit a new early election plan. In order to terminate the plan, the designated representative must submit a notice under 40 CFR 72.40(d) by January 1 of the year for which the termination is to take effect. If an early election plan is terminated any year prior to 2000, the unit shall meet, beginning January 1, 2000, the applicable emissions limitation for NO_x for Phase II units with Group 1 boilers under 40 CFR 76.7. If an early election plan is terminated on or after 2000, the unit shall meet, beginning on the effective date of the termination, the applicable emissions limitation for NO_x for Phase II units with Group 1 boilers under 40 CFR 76.7.

BEST AVAILABLE COPY

Certification

STEP 3, cont'd.

I am authorized to make this submission on behalf of the owners and operators of the affected source or affected units for which the submission is made. I certify under penalty of law that I have personally examined, and am familiar with, the statements and information submitted in this document and all its attachments. Based on my inquiry of those individuals with primary responsibility for obtaining the information, I certify that the statements and information are to the best of my knowledge and belief true, accurate, and complete. I am aware that there are significant penalties for submitting false statements and information or omitting required statements and information, including the possibility of fine or imprisonment.

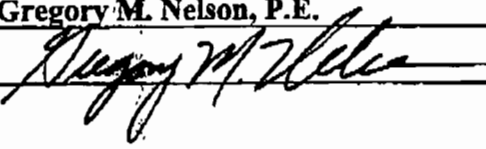Name Gregory M. Nelson, P.E.	
Signature 	Date 9/27/04

Florida Department of Environmental Protection

Phase II NO_x Averaging Plan

For more information, see instructions for DEP Form No. 62-210.900(1)(a)4. and refer to 40 CFR 76.11

This submission is: New Revised

STEP 1

Identify the units participating in this averaging plan by plant name, state, and boiler ID# from NADB. In column (a), fill in each unit's applicable emission limitation from 40 CFR 76.5, 76.6, or 76.7. In column (b), assign an alternative contemporaneous annual emissions limitation in lb/mmBtu to each unit. In column (c), assign an annual heat input limitation in mmBtu to each unit. Continue to page 3 if necessary.

Plant Name	State	ID#	(a) Emission Limitation	(b) Alt. Contemp. Emission Limitation	(c) Annual Heat Input Limit
Big Bend Station	FL	BB01	0.84	0.74	35,364,120
Big Bend Station	FL	BB02	0.84	0.74	35,004,960
Big Bend Station	FL	BB03	0.84	0.53	36,047,400
Big Bend Station	FL	BB04	0.45	0.44	37,930,800

STEP 2

Use the formula to enter the Btu-weighted annual emission rate averaged over the units if they are operated in accordance with the proposed averaging plan and the Btu-weighted annual average emission rate for the same units if they are operated in compliance with 40 CFR 76.5, 76.6, or 76.7. The former must be less than or equal to the latter.

Btu-weighted annual emission rate averaged over the units if they are operated in accordance with the proposed averaging plan

Btu-weighted annual average emission rate for same units operated in compliance with 40 CFR 76.5, 76.6 or 76.7

0.61

0.74

≤

≤

Where,

$$R_{Li} =$$

Alternative contemporaneous annual emission limitation for unit i, in lb/mmBtu, as specified in column

(b) of Step 1;

R_{Li} = Applicable emission limitation for unit i, in lb/mmBtu, as specified in column (a) of Step 1;

H_{Li} = Annual heat input for unit i, in mmBtu, as specified in column (c) of Step 1;

n = Number of units in the averaging plan

Plant Name (from Step 1)	Big Bend Station
--------------------------	-------------------------

STEP 3

Mark one of the two options and enter dates.

This plan is effective for calendar year _____ through calendar year _____ unless notification to terminate the plan is given.

Treat this plan as identical plans, each effective for one calendar year for the following calendar years: 2004, 2005, 2006, 2007 and 2008 unless notification to terminate one or more of these plans is given.

STEP 4

Read the special provisions and certification, enter the name of the designated representative, and sign and date.

Special Provisions

Emission Limitations

Each affected unit in an approved averaging plan is in compliance with the Acid Rain emission limitation for NO_x under the plan only if the following requirements are met:

- (i) For each unit, the unit's actual annual average emission rate for the calendar year, in lb/mmBtu, is less than or equal to its alternative contemporaneous annual emission limitation in the averaging plan, and
 - (a) For each unit with an alternative contemporaneous emission limitation less stringent than the applicable emission limitation in 40 CFR 76.5, 76.6, or 76.7, the actual annual heat input for the calendar year does not exceed the annual heat input limit in the averaging plan,
 - (b) For each unit with an alternative contemporaneous emission limitation more stringent than the applicable emission limitation in 40 CFR 76.5, 76.6, or 76.7, the actual annual heat input for the calendar year is not less than the annual heat input limit in the averaging plan, or
- (ii) If one or more of the units does not meet the requirements of (i), the designated representative shall demonstrate, in accordance with 40 CFR 76.11(d)(1)(ii)(A) and (B), that the actual Btu-weighted annual average emission rate for the units in the plan is less than or equal to the Btu-weighted annual average rate for the same units had they each been operated, during the same period of time, in compliance with the applicable emission limitations in 40 CFR 76.5, 76.6, or 76.7.
- (iii) If there is a successful group showing of compliance under 40 CFR 76.11(d)(1)(ii)(A) and (B) for a calendar year, then all units in the averaging plan shall be deemed to be in compliance for that year with their alternative contemporaneous emission limitations and annual heat input limits under (i).

Liability


The owners and operators of a unit governed by an approved averaging plan shall be liable for any violation of the plan or this section at that unit or any other unit in the plan, including liability for fulfilling the obligations specified in part 77 of this chapter and sections 113 and 411 of the Act.

Termination

The designated representative may submit a notification to terminate an approved averaging plan, in accordance with 40 CFR 72.40(d), no later than October 1 of the calendar year for which the plan is to be terminated.

Certification

I am authorized to make this submission on behalf of the owners and operators of the affected source or affected units for which the submission is made. I certify under penalty of law that I have personally examined, and am familiar with, the statements and information submitted in this document and all its attachments. Based on my inquiry of those individuals with primary responsibility for obtaining the information, I certify that the statements and information are to the best of my knowledge and belief true, accurate, and complete. I am aware that there are significant penalties for submitting false statements and information or omitting required statements and information, including the possibility of fine or imprisonment.

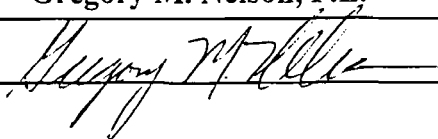Name	Gregory M. Nelson, P.E.	
Signature		Date <u>6/7/09</u>

Plant Name (from Step 1)

STEP 1

Continue the identification of units from Step 1, page 1, here.

Plant Name	State	ID#	(a) Emission Limitation	(b) Alt. Contemp. Emission Limitation	(c) Annual Heat Input Limit

Plant Name (from Step 1)

STEP 1

Continue the identification of units from Step 1, page 1, here.

Plant Name	State	ID#	(a) Emission Limitation	(b) Alt. Contemp. Emission Limitation	(c) Annual Heat Input Limit

UNITED STATES DISTRICT COURT
MIDDLE DISTRICT OF FLORIDA

UNITED STATES OF AMERICA,)
)
Plaintiff,)
)
v.)
)
)
TAMPA ELECTRIC COMPANY,)
)
Defendant.)
_____)

CIVIL ACTION NO. 99-2524
CIV-T-23F

CONSENT DECREE

WHEREAS, Plaintiff, the United States of America ("Plaintiff" or "the United States"), on behalf of the United States Environmental Protection Agency ("EPA") filed a Complaint on November 3, 1999, alleging that Defendant, Tampa Electric Company ("Tampa Electric") commenced construction of major modifications of major emitting facilities in violation of the Prevention of Significant Deterioration ("PSD") requirements at Part C of the Clean Air Act ("Act"), 42 U.S.C. §§ 7470-7492;

WHEREAS, EPA issued a Notice of Violation with respect to such allegations to Tampa Electric on November 3, 1999 (the "NOV");

WHEREAS, the parties recognize, and the Court by entering this Consent Decree finds, that this Consent Decree has been negotiated in good faith and at arm's length; that

the parties have voluntarily agreed to this Consent Decree; that implementation of this Consent Decree will avoid prolonged and complicated litigation between the parties; and that this Consent Decree is fair, reasonable, consistent with the goals of the Act, and in the public interest;

WHEREAS, the United States alleges that the Complaint states a claim upon which relief can be granted against Tampa Electric under Sections 113 and 167 of the Act, 42 U.S.C. §§ 7413 and 7477, and 28 U.S.C. § 1355;

WHEREAS, Tampa Electric has not answered or otherwise responded to the Complaint in light of the settlement memorialized in this Consent Decree;

WHEREAS, Tampa Electric has denied and continues to deny the violations alleged in the NOV and the Complaint; maintains that it has been and remains in compliance with the Clean Air Act and is not liable for civil penalties or injunctive relief; and states that it is agreeing to the obligations imposed by this Consent Decree solely to avoid the costs and uncertainties of litigation and to improve the environment in and around the Tampa Bay area of Florida;

WHEREAS, Tampa Electric is the first electric utility of those against which the United States brought enforcement actions in November, 1999, to come forward and invest time and effort sufficient to develop a settlement with the United States;

WHEREAS, Tampa Electric's decision to Re-Power some of its coal-fired electric generating Units with natural gas will significantly reduce emissions of both regulated and unregulated pollutants below levels that would have been achieved merely by

installing appropriate pollution control technologies on Tampa Electric's existing coal-fired electric generating Units;

WHEREAS, prior to the filing of the Complaint or issuance of the Notice of Violation in this matter, Tampa Electric already had placed in service or installed both scrubbers and electrostatic precipitators that serve all existing coal-fired electric generating Units at the company's Big Bend electric generating plant;

WHEREAS, the United States recognizes that a BACT Analysis conducted under existing procedures most likely would not find it cost effective to replace Tampa Electric's existing control equipment at Big Bend for particulate matter, in light of the design and performance of that equipment;

WHEREAS, Tampa Electric and the United States have crafted this Consent Decree to take into account physical and operational constraints resulting from the unique, Riley Stoker wet bottom, turbo-fired boiler technology now in operation at Big Bend, which could limit the efficiency of nitrogen oxides emissions controls installed for those boilers;

WHEREAS, Tampa Electric regularly combusts coal with a sulphur content of five or six pounds per mMBTU heat input;

WHEREAS, Tampa Electric is a mid-sized electric utility and is smaller on a financial basis than some of the other electric utilities against which the United States brought similar enforcement actions in November 1999;

WHEREAS, Tampa Electric owns and operates fewer coal-fired electric

generating plants than some of the other electric utilities against which the United States brought similar enforcement actions in November 1999;

WHEREAS, the two Tampa Electric plants addressed by this enforcement action constitute over ninety percent of the entire base load generating capacity of Tampa Electric;

WHEREAS, the United States and Tampa Electric have agreed that settlement of this action is in the best interest of the parties and in the public interest, and that entry of this Consent Decree without further litigation is the most appropriate means of resolving this matter; and

WHEREAS, the United States and Tampa Electric have consented to entry of this Consent Decree without trial of any issue;

NOW, THEREFORE, without any admission of fact or law, and without any admission of the violations alleged in the Complaint or NOV, it is hereby ORDERED AND DECREED as follows:

I. JURISDICTION AND VENUE

1. This Court has jurisdiction over the subject matter herein and over the parties consenting hereto pursuant to 28 U.S.C. § 1345 and pursuant to Sections 113 and 167 of the Act, 42 U.S.C. §§ 7413 and 7477. Venue is proper under Section 113(b) of the Act, 42 U.S.C. § 7413(b), and under 28 U.S.C. § 1391(b) and (c).

Solely for the purposes of this Consent Decree and the underlying Complaint, Tampa Electric waives all objections and defenses that it may have to the claims set forth in the Complaint, the jurisdiction of the Court or to venue in this District. Tampa Electric shall not challenge the terms of this Consent Decree or this Court's jurisdiction to enter and enforce this Consent Decree. Except as expressly provided for herein, this Consent Decree shall not create any rights in any party other than the United States and Tampa Electric. Tampa Electric consents to entry of this Consent Decree without further notice.

II. APPLICABILITY

2. The provisions of this Consent Decree shall apply to and be binding upon the United States and upon Tampa Electric, its successors and assigns, and Tampa Electric's officers, employees and agents solely in their capacities as such. If Tampa Electric proposes to sell or transfer any of its real property or operations subject to this Consent Decree, it shall advise the purchaser or transferee in writing of the existence of this Consent Decree, and shall send a copy of such written notification by certified mail, return receipt requested, to EPA sixty (60) days before such sale or transfer. Tampa Electric shall not be relieved of its responsibility to comply with all requirements of this Consent Decree unless the purchaser or transferee assumes responsibility for full performance of Tampa Electric's responsibilities under this Consent Decree, including liabilities for

nonperformance. Tampa Electric shall not purchase or otherwise acquire capacity and/or energy from a third party in lieu of obtaining it from Gannon or Big Bend unless the seller or provider agrees that the facilities providing such capacity and/or energy will meet the emission control requirements set forth in this Consent Decree or equivalent requirements approved in advance by the United States.

3. Tampa Electric shall provide a copy of this Consent Decree to all vendors, suppliers, consultants, contractors, agents, and any other company or other organization performing any of the work described in Sections IV or VII of this Consent Decree. Notwithstanding any retention of contractors, subcontractors or agents to perform any work required under this Consent Decree, Tampa Electric shall be responsible for ensuring that all work is performed in accordance with the requirements of this Consent Decree. In any action to enforce this Consent Decree, Tampa Electric shall not assert as a defense the failure of its employees, servants, agents, or contractors to take actions necessary to comply with this Consent Decree, unless Tampa Electric establishes that such failure resulted from a Force Majeure event as defined in this Consent Decree.

III. DEFINITIONS

4. "Alternative Coal" shall mean coal with a sulphur content of no more than 2.2 lb/mmBTU, on an as determined basis.

5. "BACT Analysis" shall mean the technical study, analysis, review, and selection of recommendations typically performed in connection with an application for a PSD permit. Except as otherwise provided in this Consent Decree, such study, analysis, review, and selection of recommendations shall be carried out in conformance with applicable federal and state regulations and guidance describing the process and analysis for determining Best Available Control Technology (BACT).
6. "Big Bend" shall mean the electric generating plant, presently coal-fired, owned and operated by Tampa Electric and located in Hillsborough County, Florida, which presently includes four steam generating boilers and associated and ancillary systems and equipment, known as Big Bend Units 1, 2, 3, and 4.
7. "Consent Decree" shall mean this Consent Decree and the Appendix thereto.
8. "Emission Rate" shall mean the average number of pounds of pollutant emitted per million BTU of heat input ("lb/mmBTU") or the average concentration of a pollutant in parts per million by volume ("ppm"), as dictated by the unit of measure specified for the rate in question, where:

1

2 in the case of a coal-fired, steam electric generating unit, such rates shall be calculated as a 30 day rolling average. A 30 day rolling average for an Emission Rate expressed as lb/mmBTU shall be determined by calculating the emission rate for a given operating day, and then arithmetically averaging the emission rates for

the previous 29 operating days with that date. A new 30 day rolling average shall be calculated for each new operating day;

A in the case of a gas-fired, electric generating unit, such rates shall be calculated as a 24-hour rolling average, excluding periods of start up, shutdown, and malfunction as provided by applicable Florida regulations at the time the Emission Rate is calculated. A rolling average for Emission Rates expressed as ppm shall be determined on a given day by summing hourly emission rates for the immediately preceding 24-hour period and dividing by 24;

A the reference methods for determining Emission Rates for SO₂ and NO_x shall be those specified in 40 C.F.R. Part 75, Appendix F. The reference methods for determining Emission Rates for PM shall be those specified in 40 C.F.R. Part 60, Appendix A, Method 5, Method 5B, or Method 17; and

A nothing in this Consent Decree is intended to nor shall alter applicable law concerning the use of data, for any purpose under the Clean Air Act, generated by methods other than the reference methods specified herein.

9. "EPA" shall mean the United States Environmental Protection Agency.

10. "Gannon" shall mean the electric generating plant, presently coal-fired, owned and operated by Tampa Electric, located in Hillsborough County, Florida, which presently includes six steam generating boilers and associated and ancillary systems and equipment, known as Gannon Units 1, 2, 3, 4, 5, and 6. Tampa Electric intends to rename Gannon "Bayside Power Station" upon completion of

the Re-Powering required under this Consent Decree.

11. "lb/mmBTU" shall mean pounds per million British Thermal Units of heat input.
12. "NOx" shall mean oxides of nitrogen.
13. "NOV" shall mean the Notice of Violation issued by EPA to Tampa Electric dated November 3, 1999.
14. "PM" shall mean total particulate matter, and the reference method for measuring PM shall be that specified in the definition of Emission Rate in this Consent Decree.
15. "ppm" shall mean parts per million by dry volume, corrected to 15% O₂.
16. "Project Dollars" shall mean Tampa Electric's expenditures and payments incurred or made in carrying out the dollar-limited projects identified in Paragraph 35 of Section IV of this Consent Decree (Early Reductions of NO_x from Big Bend Units 1 through 3) and in Section VII of this Consent Decree (NO_x Reduction Projects and Mitigation Projects), to the extent that such expenditures or payments both: (A) comply with the Project Dollar and other requirements set by this Consent Decree for such expenditures and payments in Section VII and in Paragraph 35 of Section IV of this Consent Decree, and (B) constitute either Tampa Electric's properly documented external costs for contractors, vendors, as well as equipment, or its internal costs consisting of employee time, travel, and other out-of-pocket expenses specifically attributable to these particular projects.
17. "PSD" shall mean Prevention of Significant Deterioration within the meaning of

Part C of the Clean Air Act, 42 U.S.C. §§ 7470, et seq.

18. "Re-Power" shall mean the removal or permanent disabling of devices, systems, equipment, and ancillary or supporting systems at a Gannon or Big Bend Unit such that the Unit cannot be fired with coal, and the installation of all devices, systems, equipment, and ancillary or supporting systems needed to fire such Unit with natural gas under the limits set in this Consent Decree (or with No. 2 fuel oil, as a back up fuel only, and under the limits specified by this Consent Decree) plus installation of the control technology and compliance with the Emission Rates called for under this Consent Decree.
19. "Reserve / Standby" shall mean those devices, systems, equipment, and ancillary or supporting systems that: (1) are not used as part of the Units that must be Re-Powered under Paragraph 26, (2) are not in operation subsequent to the Re-Powering required under Paragraph 26, (3) are maintained and held by Tampa Electric for system reliability purposes, and (4) may be restarted only by Re-Powering.
20. "SCR" shall mean Selective Catalytic Reduction.
21. "Shutdown" shall mean the permanent disabling of a coal-fired boiler such that it cannot burn any fuel nor produce any steam for electricity production, other than through Re-Powering.
22. "SO₂" shall mean sulphur dioxide.
23. "Title V Permit" shall mean the permit required under Subchapter V of the Clean

Air Act, 42 U.S.C. § 7661, et seq.

24. "Total Baseline Emissions" shall mean calendar year 1998 emissions of NO_x, SO₂, and PM comprised of the following amounts for each pollutant:
- A. for Gannon: 30,763 tons of NO_x, 64,620 tons of SO₂, and 1,914 tons of PM; and
 - A.
 - B. for Big Bend: 36,077 tons of NO_x, 107,334 tons of SO₂, and 3,002 tons of PM.
25. "Unit" shall mean for the purpose of this Consent Decree a generator, the steam turbine that drives the generator, the boiler that produces the steam for the steam turbine, the equipment necessary to operate the generator, turbine and boiler, and all ancillary equipment, including pollution control equipment or systems necessary for the production of electricity. An electric generating plant may be comprised of one or more Units.

IV. EMISSIONS REDUCTIONS AND CONTROLS – GANNON AND BIG

BEND

A. GANNON

26. Consent Decree-Required Re-Powering of Gannon. Tampa Electric shall Re-Power Units at Gannon with a coal-fired generating capacity of no less than 550 MW ("Megawatt"), as follows.

A. On or before May 1, 2003, Tampa Electric shall Re-Power Units with a coal-fired generating capacity of no less than 200 MW. On or before December 31, 2004, Tampa Electric shall Re-Power additional Units with a coal-fired generating capacity equal to or greater than the difference between 550 MW of coal-fired generating capacity and the MW value of coal-fired generating capacity that Tampa Electric Re-Powered in complying with the first sentence of this Subparagraph A.

A. All Re-Powering required by this Paragraph shall include installation and operation of SCR, other pollution control technology approved in advance and in writing by EPA, or any innovative technology demonstration project approved pursuant to Paragraph, 52.C to control Unit emissions. Each Re-Powered Unit shall, in conformance with the definition of Re-Power, use natural gas as its primary fuel and shall meet an Emission Rate for NO_x of no greater than 3.5 ppm.

A. A Unit Re-Powered under this or any other provision of this Consent Decree may be fired with No. 2 fuel oil if and only if: (1) the Unit cannot be fired with natural gas; (2) the Unit has not yet been fired with No. 2 fuel oil as a back up fuel for more than 875 full load equivalent hours in the calendar year in which Tampa Electric wishes to fire the Unit with such oil; (3) the oil to be used in firing the Unit has a sulphur content of less than 0.05 percent (by weight); (4) Tampa Electric uses all emission control equipment for that Unit when it is fired with such oil to the maximum extent possible; and (5) Tampa Electric complies with all applicable permit conditions, including emission rates for firing with No. 2 fuel oil, as set forth in applicable preconstruction and operating permits.

A. Tampa Electric shall timely apply for a preconstruction permit under Rule 62-212, F.A.C., prior to commencing such Re-Powering. In applying for such permit Tampa Electric shall seek, as part of the permit, provisions requiring installation of SCR or other EPA-approved control technology and a NO_x Emission Rate no greater than 3.5 ppm.

27. Schedule for Shutdown of Units. Tampa Electric shall Shutdown and cease any and all operation of all six (6) Gannon coal-fired boilers with a combined coal-fired capacity of not less than 1194 MW on or before December 31, 2004. Notwithstanding the requirements of this Paragraph, Tampa Electric may retain any Unit Shutdown pursuant to this Paragraph on Reserve / Standby, unless such Unit is to be, or has been, Re-Powered under Paragraph 26, above. If Tampa Electric later decides to restart any Shutdown Unit retained on Reserve / Standby, then prior to such re-start, Tampa Electric shall timely apply for a PSD permit for the Unit(s) to be Re-Powered, and Tampa Electric shall abide by the permit issued as a result of that application, including installation of BACT and its corresponding Emission Rate, as determined at the time of the restart. Tampa Electric shall operate the Re-Powered Unit to meet the NO_x Emission Rate established in the PSD Permit or an Emission Rate for NO_x of 3.5 ppm, whichever is more stringent. Tampa Electric shall provide a copy of any permit application(s), proposed permit(s), and permit(s) to the United States as specified in Paragraph 82 (Notice). For any Unit Shutdown and placed on Reserve / Standby under this Paragraph, and notwithstanding the definition of Re-Power in

this Consent Decree, Tampa Electric also may elect to fuel such a Unit with a gaseous fuel other than or in addition to natural gas, if and only if Tampa Electric: applies for and secures a PSD permit before using such fuel in any such Unit, complies with all requirements issued in such a permit, and complies with all other requirements of this Consent Decree applicable to Re-Powering.

28. Permanent Bar on Combustion of Coal. Commencing on January 1, 2005, Tampa Electric shall not combust coal in the operation of any Unit at Gannon.

B. BIG BEND

29. Initial Reduction and Control of SO₂ Emissions from Big Bend Units 1 and 2 .
Commencing upon the later of the date of entry of this Consent Decree or September 1, 2000, and except as provided in this Paragraph, Tampa Electric shall operate the existing scrubber that treats emissions of SO₂ from Big Bend Units 1 and 2 at all times that either Unit 1 or 2 is in operation. Tampa Electric shall operate the scrubber so that at least 95% of all the SO₂ contained in the flue gas entering the scrubber is removed. Notwithstanding the requirement to operate the scrubber at all times Unit 1 or 2 is operating, the following operating conditions shall apply:

A.

- B. Tampa Electric may operate Units 1 and/or 2 during outages of the scrubber serving Units 1 and 2, but only so long as Tampa Electric:

(1) in calendar year 2000, does not operate Unit 1 and/or 2, or any combination of the two of them, on more than sixty (60) calendar days, or any part thereof (providing that when both Units 1 and 2 operate on the same calendar day, such operation shall count as two days of the sixty (60) day limit), and in calendar years 2001 - 2009, does not operate Unit 1 and/or 2, or any combination of the two of them, on more than forty-five (45) calendar days, or any part thereof, in any calendar year (providing that when both Units 1 and 2 operate on the same calendar day, such operation shall count as two days of the forty-five (45) day limit) ; or

A.

B. must operate Unit 1 and/or 2 in any calendar year from 2000 through 2009 either to avoid interruption of electric service to its customers under interruptible service tariffs, or to respond to a system-wide or state-wide emergency as declared by the Governor of Florida under Section 366.055, F.S. (requiring availability of reserves), or under Section 377.703, F.S.

D. (energy policy contingency plan), or under Section 252.36, F.S. (Emergency management powers of the Governor), in which Tampa Electric must generate power from Unit 1 and/or 2 to meet such emergency.

1.

2. Whenever Tampa Electric operates Units 1 and/or 2 without all emissions from such Unit(s) being treated by the scrubber, Tampa Electric shall: (1) combust only Alternative Coal at the Unit(s) operating during the outage (except for coal already bunkered in the hopper(s) for Units 1 or 2 at the time the outage commences); (2) use all existing electric generating capacity at Big Bend and Gannon that is served by fully operational pollution control equipment before operating Big Bend Units 1 and/or 2; and (3) continue to control SO₂ emissions from Big Bend Units 1 and/or 2 as required by Paragraph 31 (Optimizing Availability of Scrubbers Serving Big Bend Units 1, 2, and 3).

A. In calendar years 2010 through 2012, Tampa Electric may operate Units 1 and/or 2 during outages of the scrubber serving Units 1 and 2, but only so long as Tampa Electric complies with the requirements of Subparagraphs A and B, above, and uses only coal with a sulphur content of 1.2 lb/mmBTU, or less, in place of Alternative Coal.

A. If Tampa Electric Re-Powers Big Bend Unit 1 or 2, or replaces the scrubber or provides additional scrubbing capacity to comply with Paragraph 40, then upon such compliance the provisions of Subparagraphs 29.A, 29.B, and 29.C shall not apply to the affected Unit.

30. Initial Reduction and Control of SO₂ Emissions from Big Bend Unit 3.

Commencing upon entry of the Consent Decree, and except as provided in this Paragraph, Tampa Electric shall operate the existing scrubber that treats emissions of SO₂ from Big Bend Units 3 and 4 at all times that Unit 3 is in operation. When Big Bend Units 3 and 4 are both operating, Tampa Electric shall operate the scrubber so that at least 93% of all the SO₂ contained in the flue gas entering the scrubber is removed. When Big Bend Unit 3 alone is operating, until May 1, 2002, Tampa Electric shall operate the scrubber so that at least 93% of all SO₂ contained in the flue gas entering the scrubber is removed or the Emission Rate for SO₂ for Unit 3 does not exceed 0.35 lb/mmBTU. When Unit 3 alone is operating, from May 1, 2002 until January 1, 2010, Tampa Electric shall operate the scrubber so that at least 95% of the SO₂ contained in the flue gas entering the scrubber is removed or the Emission Rate for SO₂ does not exceed 0.30 lb/mmBTU. Notwithstanding the requirement to operate the scrubber at all times Unit 3 is operating, and providing Tampa Electric is otherwise in compliance with this Consent Decree, the following operating conditions shall apply:

A.

B. In any calendar year from 2000 through 2009, Tampa Electric may operate Unit 3 in the case of outages of the scrubber serving Unit 3, but only so long as Tampa Electric:

(1) does not operate Unit 3 during outages on more than thirty (30)

calendar days, or any part thereof, in any calendar year; or

A.

B. must operate Unit 3 either: to avoid interruption of electric service to its customers under interruptible service tariffs, or to respond to a system-wide or state-wide emergency as declared by the Governor of Florida under Section 366.055, F.S. (requiring availability of reserves), or under Section 377.703, F.S. (energy policy contingency plan), or under Section 252.36, F.S. (Emergency management powers of the Governor), in which Tampa Electric must generate power from Unit 3 to meet such emergency.

C.

1.

2.

Whenever Tampa Electric operates Unit 3 without treating all emissions from that Unit with the scrubber, Tampa Electric shall: (1) combust only Alternative Coal at Unit 3 during the outage (except for coal already bunkered in the hopper(s) for Unit 3 at the time the outage commences); (2) use all existing electric generating capacity at Big Bend and Gannon that is served by fully operational pollution control equipment before operating Big Bend Unit 3; and (3) continue to control SO₂ emissions from Big Bend Unit 3 as required by Paragraph 31 (Optimizing Availability of Scrubbers Serving Big Bend Units, 1, 2, and 3).

A.

If Tampa Electric Re-Powers Big Bend Unit 3, or replaces the scrubber or provides additional scrubbing capacity to comply with Paragraph 40, then upon

compliance with Paragraph 40 the provisions of Subparagraphs 30.A and 30.B shall not apply to Unit 3.

- A.
- B. Nothing in this Consent Decree shall alter requirements of the New Source Performance Standards (NSPS), 40 C.F.R. Part 60 Subpart Da, that apply to operation of the scrubber serving Unit 4.

31. Optimizing Availability of Scrubbers Serving Big Bend Units 1, 2, and 3.

Tampa Electric shall maximize the availability of the scrubbers to treat the emissions of Big Bend Units 1, 2, and 3, as follows:

- A. As soon as possible after entry of this Consent Decree, Tampa Electric shall submit to EPA for review and approval a plan addressing all operation and maintenance changes to be made that would maximize the availability of the existing scrubbers treating emissions of SO₂ from Big Bend Units 1 and 2, and from Unit 3. In order to improve operations and maintenance practices as soon as possible, Tampa Electric may submit the plan in two phases.

(1) Each phase of the plan proposed by Tampa Electric shall include a schedule pursuant to which Tampa Electric will implement measures relating to operation and maintenance of the scrubbers called for by that phase of the plan, within sixty days of its approval by EPA. Tampa Electric shall implement each phase of the plan as approved by EPA.

Such plan may be modified from time to time with prior written approval of EPA.

(2) The proposed plan shall include operation and maintenance activities that will minimize instances during which SO₂ emissions are not scrubbed, including but not limited to improvements in the flexibility of scheduling maintenance on the scrubbers, increases in the stock of spare parts kept on hand to repair the scrubbers, a commitment to use of overtime labor to perform work necessary to minimize periods when the scrubbers are not functioning, and use of all existing capacity at Big Bend and Gannon Units that are served by available, operational pollution control equipment to minimize pollutant emissions while meeting power needs.

(3) If Tampa Electric elects to submit the plan to EPA in two phases, the first phase to be submitted shall address, at a minimum, use of overtime hours to accomplish repairs and maintenance of the scrubber and increasing the stock of scrubber spare parts that Tampa Electric shall keep at Big Bend to speed future maintenance and repairs. If Tampa Electric elects to submit the plan in two phases, EPA shall complete review of the first phase within fifteen business days of receipt. For the second phase of the plan or submission of the plan in its entirety, EPA shall complete review of such plan or phase thereof within 60 days of receipt. Within sixty days after EPA's approval of the plan or any phase of the plan,

Tampa Electric shall complete implementation of that plan or phase and continue operation under it subject only to the terms of this Consent Decree.

32. PM Emission Minimization and Monitoring at Big Bend.

- A. Within twelve months after entry of this Consent Decree, Tampa Electric shall complete an optimization study which shall recommend the best operational practices to minimize emissions from each Electrostatic Precipitator (ESP) and shall deliver the completed study to EPA for review and approval. Tampa Electric shall implement these recommendations within sixty days after EPA has approved them and shall operate each ESP in conformance with the study and its recommendations until otherwise specified under this Consent Decree.
- B. Within twelve months after entry of this Consent Decree, Tampa Electric shall complete a BACT Analysis for upgrading each existing ESP now located at Big Bend and shall deliver the Analysis to EPA for review and approval. Notwithstanding the definition of BACT Analysis in this Consent Decree, Tampa Electric need not consider in this BACT Analysis the replacement of any existing ESP with a new ESP, scrubber, or baghouse, or the installation of a supplemental pollution control device of similar cost to a replacement ESP, scrubber, or baghouse. Tampa Electric shall simultaneously deliver to EPA all documents that support the BACT

Analysis or that were considered in preparing the Analysis. Tampa Electric shall retain a qualified contractor to assist in the performance and completion of the BACT Analysis. On or before May 1, 2004, after EPA approval of the recommendation(s) made by the BACT Analysis, Tampa Electric shall complete installation of all equipment called for in the recommendation(s) of the Analysis and thereafter shall operate each ESP in conformance with the recommendation(s), including compliance with the Emission Rate(s) specified by the recommendation(s).

- C. Within six months after Tampa Electric completes installation of the equipment called for by the BACT Analysis, as approved by EPA, Tampa Electric shall revise the previous optimization study and shall recommend the best operational practices to minimize emissions from each ESP, taking into account the recommendations from the BACT Analysis required by this Paragraph, and shall deliver the completed study to EPA for review and approval. Commencing no later than 180 days after EPA approves the study and its recommendation(s), Tampa Electric shall operate each ESP in conformance with the study's recommendation.
- D. Tampa Electric shall include the recommended operational practices for each ESP and the recommendations from the BACT Analysis in Tampa Electric's Title V Permit application and all other relevant applications for operating or construction permits.

- E. Installation and Operation of a PM Monitor. On or before March 1, 2002, Defendant shall install, calibrate, and commence continuous operation of a continuous particulate matter emissions monitor (PM CEM) in the duct at Big Bend that services Unit 4. Data from the PM CEM shall be used by Tampa Electric, at a minimum, to monitor progress in reducing PM emissions.
- F. "Continuous operation" of the PM CEM shall mean operation at all times that Unit 4 operates, except for periods of malfunction of the PM CEM or routine maintenance performed on the PM CEM. If after Tampa Electric operates this PM CEM for at least two years, and if the parties then agree that it is infeasible to sustain continuous operation of the PM CEM, Tampa Electric shall submit an alternative PM monitoring plan for review and approval by EPA. The plan shall include an explanation of the basis for stopping operation of the PM CEM and a proposal for an alternative monitoring protocol. Until EPA approves such plan, Tampa Electric shall continue to operate the PM CEM.
- G. Installation and Operation of Second PM Monitor. If Tampa Electric advises EPA, pursuant to Paragraph 36, that it has elected to continue to combust coal at Big Bend Units 1, 2, or 3, and Tampa Electric has not ceased operating the first PM CEM as described in Subparagraph F, above, then Tampa Electric shall install, calibrate, and commence

continuous operation of a PM CEM on a second duct at Big Bend on or before May 1, 2007. The requirement to operate a PM CEM under any provision of this Paragraph shall terminate if and when the Unit monitored by the PM CEM is Re-Powered.

H. Testing and Reporting Requirement. Prior to installation of the PM CEM on each duct, Tampa Electric shall conduct a stack test on each stack at Big Bend on at least an annual basis and report its results to EPA as part of the quarterly report under Section V. The stack test requirement in this Subparagraph may be satisfied by Tampa Electric's annual stack tests conducted as required by its permit from the State of Florida. Following installation of each PM CEM, Defendant shall include in its quarterly reports to EPA pursuant to Section V all data recorded by the PM CEM, in electronic format, if available.

I. Nothing in this Consent Decree is intended to nor shall alter applicable law concerning the use of data, for any purpose under the Clean Air Act, generated by the PM CEMs.

33. Election for Big Bend Unit 4: Shutdown, Re-Power, or Continued Combustion of Coal. Tampa Electric shall advise EPA in writing, on or before May 1, 2005, whether Big Bend Unit 4 will be Shutdown, will be Re-Powered, or will continue to be fired by coal.

34. Reduction of NO_x at Big Bend Unit 4 after 2005 Election. Based on Tampa Electric's election in Paragraph 33, Tampa Electric shall take one of the following actions:

7.

8. If Tampa Electric elects to continue firing Unit 4 with coal, on or before June 1, 2007, Tampa Electric shall install and commence operation of SCR, or other technology if approved in writing by EPA in advance, sufficient to limit the coal-fired Emission Rate of NO_x from Unit 4 to no more than 0.10 lb/mmBTU. Thereafter, Tampa Electric shall continue operation of SCR or other EPA approved control technology, and Tampa Electric shall continue to meet an Emission Rate for NO_x from Unit 4 no greater than 0.10 lb/mmBTU; or

A. If Tampa Electric elects to Re-Power Unit 4, Tampa Electric shall not combust coal at Unit 4 on or after June 1, 2007. Tampa Electric shall timely apply for a preconstruction permit under Rule 62-212, F.A.C., prior to commencing construction of the Re-Powering of Unit 4. In applying for such permit, Tampa Electric shall seek, as part of the permit, provisions requiring installation of SCR or other EPA approved control technology and a NO_x Emission Rate no greater than 3.5 ppm. Tampa Electric shall operate the Re-Powered Unit 4 to meet an Emission Rate for NO_x of no greater than 3.5 ppm or the rate established in the preconstruction permit, whichever is more stringent; or

A. If Tampa Electric elects to Shutdown Big Bend Unit 4, Tampa Electric

shall complete Shutdown of Big Bend Unit 4 on or before June 1, 2007.

Notwithstanding the requirements of this Subparagraph, Tampa Electric may retain this Unit, after it is Shutdown pursuant to this Subparagraph, on Reserve / Standby. If Tampa Electric later decides to restart Unit 4 then, prior to such restart, Tampa Electric shall timely apply for a PSD permit, and Tampa Electric shall abide by the permit issued as a result of that application, including installation of BACT and its corresponding Emission Rate, as determined at the time of the restart. Tampa Electric shall operate the Re-Powered Unit 4 to meet an Emission Rate for NO_x of no greater than 3.5 ppm or the Emission Rate established in the PSD permit, whichever is more stringent. Tampa Electric shall provide a copy of any permit application(s), proposed permit(s), and permit(s) to the United States as specified in Paragraph 82 (Notice). Upon Shutdown of a Unit under this Subparagraph, Tampa Electric may never again use coal to fire that Unit.

A. Notwithstanding the provisions of Subparagraphs B and C above or the definition of Re-Power in this Consent Decree, Tampa Electric may also elect to fuel Big Bend Unit 4 with a gaseous fuel other than or in addition to natural gas, if and only if Tampa Electric applies for and secures a PSD permit before using such fuel in this Unit, complies with all requirements issued in such a permit, and complies with all requirements of this Consent Decree applicable to Re-Powering.

35. Early Reductions of NO_x from Big Bend Units 1 through 3: On or before

December 31, 2001, Tampa Electric shall submit to EPA for review and comment a plan to reduce NO_x emissions from Big Bend Units 1, 2 and 3, through the expenditure of up to \$3 million Project Dollars on combustion optimization using commercially available methods, techniques, systems, or equipment, or combinations thereof. Subject only to the financial limit stated in the previous sentence, for Units 1 and 2 the goal of the combustion optimization shall be to reduce the NO_x Emission Rate by at least 30% when compared against the NO_x Emissions Rate for these Units during calendar year 1998, which the United States and Tampa Electric agree was 0.86 lb/mmBTU. For Unit 3 the goal of the combustion optimization shall be to reduce the NO_x Emissions Rate by at least 15% when compared against the NO_x Emission Rate for this Unit during calendar year 1998, which the United States and Tampa Electric agree was 0.57 lb/mmBTU. If the financial limit in this Paragraph precludes designing and installing combustion controls that will meet the percentage reduction goals for the NO_x Emission Rates specified in this Paragraph for all three Units, then Tampa Electric's plan shall first maximize the Emission Rate reductions at Units 1 and 2 and then at Unit 3. Unless the United States has sought dispute resolution on Tampa Electric's plan on or before May 30, 2002, Tampa Electric shall implement all aspects of its plan at Big Bend Units 1, 2, and 3 on or before December 31, 2002. On or before April 1, 2003, Tampa Electric shall submit to EPA a report that documents the date(s) of complete implementation of the plan,

the results obtained from implementing the plan, including the emission reductions or benefits achieved, and the Project Dollars expended by Tampa Electric in implementing the plan.

36. Election for Big Bend Units 1 through 3: Shutdown, Re-Power, or Continued Combustion of Coal. Tampa Electric shall advise EPA in writing, on or before May 1, 2007, whether Big Bend Units 1, 2, or 3, or any combination of them, will be Shutdown, will be Re-Powered, or will continue to be fired by coal.

37. Further NO_x Reduction Requirements if Big Bend Units 1, 2, and/or 3 Remain Coal-fired. If Tampa Electric advises EPA in writing, pursuant to Paragraph 36, above, that Tampa Electric will continue to combust coal at Units 1, 2, and/or 3, then:

A. Subject only to Subparagraphs B and D, Tampa Electric shall timely solicit contract proposals to acquire, install, and operate SCR, or other technology if approved in writing by EPA in advance, sufficient to limit the Emission Rate of NO_x to no more than 0.10 lb/mmBTU at each Unit that will combust coal. Tampa Electric shall install and operate such equipment on all Units that will continue to combust coal and shall achieve an Emission Rate of NO_x on each such Unit no less stringent than 0.10 lb/mmBTU.

A. Notwithstanding Subparagraph A, Tampa Electric shall not be required to install SCR to limit the Emission Rate of NO_x at Units 1, 2 and/or 3 to 0.10 lb/mmBTU if the "installation cost ceiling" contained in this Paragraph will be exceeded by such installation. If Tampa Electric decides to continue burning coal at Units 1, 2 and 3, the

installation cost ceiling for SCR at Units 1, 2, and 3 shall be three times the cost of installing SCR at Big Bend Unit 4 plus forty-five (45%) percent of the cost of installing SCR at Big Bend 4. If Tampa Electric decides to continue burning coal at only two Units at Big Bend, the installation cost ceiling for SCR at those two Units shall be two times the cost of installing SCR at Big Bend 4 plus forty-five (45) percent of the cost of installing SCR at Big Bend Unit 4. If Tampa Electric decides to continue burning coal at only one Unit at Big Bend, the installation cost ceiling for SCR at that Unit shall be the cost of installing SCR at Big Bend 4 plus forty five (45) percent.

A. If, based on the contract proposals obtained under Subparagraph A, Tampa Electric determines that the projected cost of proposed control equipment satisfying a 0.10 lb/mmBTU Emission Rate will not exceed the "installation cost ceiling," Tampa Electric shall install and operate such equipment on all Units that will continue to combust coal and shall achieve a NO_x Emission Rate on each Unit no less stringent than 0.10 lb/mmBTU. If, based on the contract proposals, Tampa Electric determines that the projected cost will exceed the installation cost ceiling, Tampa Electric shall so advise EPA and shall provide EPA with the basis for Tampa Electric's determination, including all documentation sufficient to replicate and evaluate Tampa Electric's cost projections.

A. Unless EPA contests Tampa Electric's determination that the installation cost ceiling will be exceeded by installing control equipment to reduce NO_x emissions to 0.10

lb/mmBTU or less, Tampa Electric shall install, at each Unit that will continue to combust coal, the NO_x control technology designed to achieve the lowest Emission Rate that can be attained within the "installation cost ceiling." Notwithstanding any provision of this Consent Decree, including the "installation cost ceiling," Tampa Electric shall install NO_x control technology that is designed to achieve an Emission Rate no less stringent than 0.15 lb/mmBTU. Each Unit combusting coal and its NO_x controls shall meet the Emission Rate for which they are designed.

A. Tampa Electric shall acquire, install, commence operating emission control equipment, and meet the applicable Emission Rate for NO_x at each of the Units to remain coal-fired, as follows: (1) for the first of the Units to remain coal-fired, or if only one Unit is to be coal-fired, on or before May 1, 2008; (2) for the second Unit, if there is one, on or before May 1, 2009; (3) for the third Unit, if there is one, on or before May 1, 2010.

38. Tampa Electric's NO_x Reduction Requirements if Tampa Electric Re-Powers Units 1, 2, and/or 3. If, by May 1, 2007, Tampa Electric advises EPA that Tampa Electric has elected to Re-Power one or more of Units 1, 2, and 3 at Big Bend, then Tampa Electric shall complete all steps necessary to accomplish such Re-Powering in a time frame to commence operation of the Re-Powered Unit(s) no later than May 1, 2010. Any Unit(s) to be replaced by a Re-Powered Unit may continue to operate until the earlier of six months after the date the Re-Powered

Unit begins commercial operation on December 31, 2010. Tampa Electric shall timely apply for a preconstruction permit under Rule 62-212, F.A.C., prior to commencing construction of any Re-Powered Unit at Big Bend. In applying for such permit Tampa Electric shall seek, as part of the permit, provisions requiring installation of SCR or other EPA approved control technology and a NO_x Emission Rate no greater than 3.5 ppm. Tampa Electric shall operate any Unit Re-Powered under this Paragraph to meet an Emission Rate for NO_x of no greater than 3.5 ppm or the rate established in the preconstruction permit, whichever is more stringent. Notwithstanding the provisions of this Paragraph or the definition of Re-Power in this Consent Decree, Tampa Electric may also elect to fuel Units 1, 2, or 3 with a gaseous fuel other than or in addition to natural gas, if and only if Tampa Electric applies for and secures a PSD permit before using such fuel in any of these Units, complies with all requirements issued in such a permit, and complies with all requirements of this Consent Decree applicable to Re-Powering.

39. Requirements Applicable to Big Bend Units 1, 2, and/or 3 if Shutdown. If Tampa Electric elects to Shutdown one or more of Units 1, 2, and 3, Tampa Electric shall complete Shutdown of the first such Unit on or before May 1, 2008; of the second Unit, if applicable, on or before May 1, 2009, and of the third Unit, if applicable, on or before May 1, 2010. Notwithstanding the requirements of this Paragraph, Tampa Electric may retain any Unit Shutdown pursuant to this Paragraph on

Reserve / Standby. If Tampa Electric later decides to restart such Unit retained on Reserve / Standby by Re-Powering it then, prior to such restart, Tampa Electric shall timely apply for a PSD permit for the Unit(s) to be Re-Powered, and Tampa Electric shall abide by the permit issued as result of that application, including installation of BACT and its corresponding Emission Rate determined at the time of the restart. Tampa Electric shall operate each Unit Re-Powered under this Paragraph to meet an Emission Rate for NO_x of no greater than 3.5 ppm or the Emission Rate established in the PSD permit, whichever is more stringent. Tampa Electric shall provide a copy of any permit application(s), proposed permit(s), and permit(s) to the United States as specified in Paragraph 82 (Notice). Upon Shutdown of a Unit under this Paragraph, Tampa Electric may never again use coal to fire that Unit. For any Unit Shutdown and placed on Reserve / Standby under this Paragraph, and notwithstanding the definition of Re-Power in this Consent Decree, Tampa Electric also may elect to fuel such a Unit with a gaseous fuel other than or in addition to natural gas, if and only if Tampa Electric: applies for and secures a PSD permit before using such fuel in any of such Unit, complies with all requirements issued in such a permit, and complies with all requirements of this Consent Decree applicable to Re-Powering.

40. Further SO₂ Reduction Requirements if Big Bend Units 1, 2, or 3 Remains Coal-fired. If Tampa Electric elects under Paragraph 36 to continue combusting coal at Units 1, 2, and/or 3, Tampa Electric shall meet the following requirements.

A. Removal Efficiency or Emission Rate. Commencing on dates set forth in Subparagraph C and continuing thereafter, Tampa Electric shall operate coal-fired Units and the scrubbers that serve those Units so that emissions from the Units shall meet at least one of the following limits:

- (1) the scrubber shall remove at least 95% of the SO₂ in the flue gas that entered the scrubber; or
- (2) the Emission Rate for SO₂ from each Unit does not exceed 0.25 lb/mmBTU.

A. Availability Criteria. Commencing on the deadlines set in this Paragraph and continuing thereafter, Tampa Electric shall not allow emissions of SO₂ from Big Bend Units 1, 2, or 3 without scrubbing the flue gas from those Units and using other equipment designed to control SO₂ emissions. Notwithstanding the preceding sentence, to the extent that the Clean Air Act New Source Performance Standards identify circumstances during which Bend Unit 4 may operate without its scrubber, this Consent Decree shall allow Big Bend Units 1, 2, and/or 3 to operate when those same circumstances are present at Big Bend Units 1, 2, and/or 3.

A. Deadlines. Big Bend Unit 3 and the scrubber(s) serving it shall be subject to the requirements of this Paragraph beginning January 1, 2010 and continuing thereafter. Until January 1, 2010, Tampa Electric shall control SO₂ emissions from Unit 3 as required by Paragraphs 30 and 31. Big Bend Units 1 and 2 and the scrubber(s) serving them shall

be subject to the requirements of this Paragraph beginning January 1, 2013 and continuing thereafter. Until January 1, 2013, Tampa Electric shall control SO₂ emissions from Units 1 and 2 as required by Paragraphs 29 and 31.

- A. Nothing in this Consent Decree shall alter requirements of NSPS, 40 C.F.R. Part 60 Subpart Da, that apply to operation of Unit 4 and the scrubber serving it.

C. BIG BEND AND GANNON -- PERMITS AND RESOLUTION OF CLAIMS

41. Timely Application for Permits. Except as otherwise stated in this Consent Decree, in any instance where otherwise applicable law or this Consent Decree requires Tampa Electric to secure a permit to authorize constructing or operating any device under this Consent Decree, Tampa Electric shall make such application in a timely manner. Such applications shall be completed and submitted to the appropriate authorities to allow sufficient time for all legally required processing and review of the permit request. Failure to comply with this provision shall bar any use by Tampa Electric of the Force Majeure provisions of this Consent Decree.

42. Title V Permits.

A.

- B. On or before January 1, 2004, Tampa Electric shall apply for a Title V Permit(s), or for an amendment to an existing Title V Permit(s), to include all performance,

operational, maintenance, and control technology requirements established by or determined under this Consent Decree for Gannon, including but not limited to Emission Rates, removal efficiencies, limits on fuel use (including those imposed on Re-Powered or Shutdown Units), and operation and maintenance optimization requirements.

A. On or before January 1, 2009, Tampa Electric shall apply for a Title V Permit(s), or for an amendment to an existing Title V Permit(s), to include all performance, operational, maintenance, and control technology requirements established by or determined under this Consent Decree for Big Bend, including but not limited to Emission Rates, removal efficiencies, limits on fuel use (including those imposed on Re-Powered or Shutdown Units), and operation and maintenance optimization requirements.

A. Except as this Consent Decree expressly requires otherwise, this Consent Decree shall not be construed to require Tampa Electric to apply for or obtain a permit pursuant to the Prevention of Significant Deterioration requirements of the Clean Air Act for any work performed by Tampa Electric within the scope of the Resolution of Claims provisions of Paragraphs 43 and 44, below.

43. Resolution of Past Claims - This Consent Decree resolves all of Plaintiff's civil claims for liability arising from violations of either: (1) the Prevention of Significant Deterioration or Non-Attainment provisions of Parts C and D of the Clean Air Act, 42 U.S.C. § 7401, et seq at Units at Big Bend or Gannon, or (2) 40 C.F.R. Section 60.14 at Units at Big Bend or Gannon, that :

A.

B. are alleged in the Complaint filed November 3, 1999, or in the NOV issued on that date;

A. could have been alleged by the United States in the Complaint filed November 3, 1999, or in the NOV issued on that date; or

A. have arisen from Tampa Electric's actions that occurred between November 3, 1999 and the date on which this Consent Decree is entered by the Court.

44. Resolution of Future Claims - Covenant not to Sue. The United States covenants not to sue Tampa Electric for civil claims arising from the Prevention of Significant Deterioration or Non-Attainment provisions of Parts C and D of the Clean Air Act, 42 U.S.C. § 7401 et seq., at Big Bend or Gannon Units and that are based on failure to obtain PSD or nonattainment New Source Review (NSR) permits for:

A. work that this Consent Decree expressly directs Tampa Electric to undertake; or

A. physical changes or changes in the method of operation of Big Bend or Gannon Units not required by this Consent Decree, if and only if:

A.

B. such change is commenced after Tampa Electric is implementing the plan, or the first phase of the plan if applicable, approved by EPA under Paragraph 31 (Optimizing Availability of Scrubbers),

1. such change is commenced, within the meaning of 40 C.F.R. Section 52.21(b)(9),

during the time this Consent Decree applies to the Unit at which this change has been made ;

- (3) Tampa Electric is otherwise in compliance with this Consent Decree;
- (4) hourly Emission Rates of NO_x, SO₂, or PM at the changed Unit(s) do not exceed their respective hourly Emission Rates prior to the change, as measured by 40 C.F.R. § 60.14(h); and
- (5) in any calendar year following the change, emissions of no pollutant within the scope of Total Baseline Emissions exceed the emissions of that pollutant in the Total Baseline Emissions.

45. Separate Limitation on Resolution of Claims. Notwithstanding the provisions of Section XIII (“Termination”), the provisions of Paragraph 44 (“Resolution of Future Claims - Covenant Not to Sue”) shall terminate at Gannon and Big Bend, as follows. On December 31, 2006, the provisions of Paragraph 44 shall terminate and be of no further effect as to physical changes or changes in the method of operation at Gannon. On December 31, 2012, the provisions of Paragraph 44 shall terminate and be of no further effect as to physical changes or changes in the method of operation at Big Bend. If Tampa Electric Re-Powers any Unit at Big Bend under the terms provided by this Consent Decree, then for each such Unit the provisions of Paragraph 44 shall terminate two years after each such Unit is Re-Powered or on December 31, 2012, whichever is earlier.

46. Exclusion of Certain Emission Allowances. For any and all actions taken by Tampa Electric pursuant to the terms of this Consent Decree, including but not limited to upgrading of ESPs and scrubbers, installation of NO_x controls, Re-Powering, and Shutdown, Tampa Electric shall not use or sell any resulting NO_x or SO₂ emission allowances or credits in any emission trading or marketing program of any kind; provided, however, that:

A. SO₂ credits allocated to Tampa Electric by the Administrator of EPA under the Act, due to the Re-Powering or Shutdown of Gannon, may be retained by Tampa Electric during the year in which they are allocated, but only for Tampa Electric's own use in meeting any acid rain requirement imposed under the Act. For any such allowances not used by Tampa Electric for this purpose by June 30 of the following calendar year, Tampa Electric shall not use, sell, trade, or otherwise transfer these allowances for its benefit or the benefit of a third party unless such a transfer would result in the retiring of such allowances without their ever being used.

A. If Tampa Electric decides to Re-Power any Unit at Big Bend, then Tampa Electric shall be entitled to retain for any purpose under law the difference between the emission allowances that would have resulted from installing BACT-level NO_x and SO₂ controls at the existing coal-fired Unit and the emission allowances that result from Re-Powering that Unit. Before Tampa Electric uses any allowances within the scope of this Subparagraph, Tampa Electric shall submit the calculation of the net emission allowances for approval by the United States.

A. Nothing in this Consent Decree shall preclude Tampa Electric from using or selling emission allowances arising from Tampa Electric's activities occurring prior to December 31, 1999, or Tampa Electric's activities after that date that are not related to actions required of Tampa Electric under this Consent Decree. The United States and Tampa Electric agree that the operation of the SO₂ scrubber serving Big Bend Units 1 and 2 meets the requirements of this Subparagraph, and that emission allowances resulting from the operation of this scrubber shall not be treated as an activity related to or required under this Consent Decree.

V. REPORTING AND RECORD KEEPING

47. Beginning at the end of the first calendar quarter after entry of this Consent Decree, and in addition to any other express reporting requirement in this Consent Decree, Tampa Electric shall submit to EPA a quarterly report, consistent with the form attached to this Consent Decree as the Appendix, within thirty (30) days after the end of each calendar quarter until this Consent Decree is terminated.
48. Tampa Electric's report shall be signed by Tampa Electric's Vice President, Environmental and Fuels, or, in his or her absence, Vice President, Energy Supply, or higher ranking official, and shall contain the following certification:

I certify under penalty of law that this information was prepared under my direction or supervision in accordance with a system designed to assure that qualified personnel properly gather and evaluate the information submitted. Based on my directions and my inquiry of the person(s) who manage the system, or the person(s) directly responsible for gathering the information, the information submitted is, to the best of my knowledge and belief, true, accurate, and complete. I understand that there are significant penalties for making misrepresentations to

or misleading the United States.

VI. CIVIL PENALTY

49. Within thirty (30) calendar days of entry of this Consent Decree, Tampa Electric shall pay to the United States a civil penalty in the amount of \$3.5 million. The civil penalty shall be paid by Electronic Funds Transfer ("EFT") to the United States Department of Justice, in accordance with current EFT procedures, referencing the USAO File Number and DOJ Case Number 90-5-2-1-06932 and the civil action case name and case number of this action. The costs of such EFT shall be Tampa Electric's responsibility. Payment shall be made in accordance with instructions provided by the Financial Litigation Unit of the U.S. Attorney's Office for the Middle District of Florida. Any funds received after 11:00 a.m. (EST) shall be credited on the next business day. Tampa Electric shall provide notice of payment, referencing the USAO File Number, DOJ Case Number 90-5-2-1-06932, and the civil action case name and case number, to the Department of Justice and to EPA, as provided in Paragraph 82 (Notice). Failure to timely pay the civil penalty shall subject Tampa Electric to interest accruing from the date payment is due until the date payment is made at the rate prescribed by 28 U.S.C. § 1961, and shall render Tampa Electric liable for all charges, costs, fees, and penalties established by law for the benefit of a creditor or of the United States in securing payment.

VII. NO_x REDUCTION PROJECTS AND MITIGATION PROJECTS

50. Tampa Electric shall submit plans for and shall implement the NO_x Reduction and Other Mitigation Projects (referred to together as "Projects") described in this Section, and in Paragraph 35 of this Consent Decree, in compliance with the schedules and terms of this Consent Decree. In performing these Projects, Tampa Electric shall spend no less than \$10 million in Project Dollars, in total, unless the Additional NO_x Reduction Project(s) selected under Paragraph 52.C is estimated to cost more than \$5 million; in which case Tampa Electric shall spend no less than \$10 million but no more than \$11 million in Project Dollars, in total. Tampa Electric shall expend the full amount of the Project Dollars required by this Paragraph on or before May 1, 2010. Tampa Electric shall maintain for review by EPA, upon its request, all documents identifying Project Dollars spent by Tampa Electric.
51. All plans and reports prepared by Tampa Electric pursuant to the requirements of Paragraph 35 and this Section of the Consent Decree shall be publicly available without charge.
52. Tampa Electric shall submit the required plans for and complete the following Projects:
- (1)
 - (2) Early NO_x reductions through combustion optimization as described in Paragraph 35 of this Consent Decree.

(A) Performance of Air Chemistry Work in Tampa Bay Estuary. Tampa

Electric shall expend no more than \$2 million Project Dollars in conducting or financing stack tests, emissions estimation, ambient air monitoring, data acquisition and analysis, and any combination thereof that: (1) is not otherwise required by law, (2) will provide data or analysis that is not already available, (3) will complement work carried out by other persons examining the air chemistry of Tampa Bay Estuary, and (4) will help close gaps in current understanding of air chemistry in the Tampa Bay Estuary. Tampa Electric shall either conduct this work itself, fund other persons already conducting such work on a non-profit basis, or both. For work Tampa Electric intends to conduct itself, the company shall describe the proposed work and a schedule for completion to EPA, in writing, at least 90 days prior to the date on which Tampa Electric intends to start such work, including an explanation of why the proposed work meets all the requirements of this Subparagraph. Unless EPA objects to the proposed work on the grounds it does not comply with the requirements of this Subparagraph, Tampa Electric shall undertake and complete the work according to the proposed schedule. If Tampa Electric elects to spend some or all of the \$2 million Project Dollars to finance work to be performed by other persons or organizations, the company shall provide to EPA for review and approval a plan that describes the work to be performed, the persons or organizations conducting the work, the schedule for its completion, the schedule for Tampa Electric's payments, and an explanation of why the proposed payment(s) meets all the requirements of this Subparagraph. The plan shall be provided to EPA at least 90 days prior to the date on

which Tampa Electric will begin transferring the money to finance such work.

All payments to persons or organizations under such a plan shall be completed by Tampa Electric no later than June 30, 2002. Before Tampa Electric makes such payments for the benefit of any person or organization carrying out work under this Paragraph, Tampa Electric shall secure a written, signed commitment from such person to provide Tampa Electric and EPA with the results of the work.

C. Additional NO_x Reductions Project(s).

(1) General Requirement. Tampa Electric shall expend the remainder of the Project Dollars required under this Consent Decree to: (i) demonstrate innovative NO_x control technologies on any of its Units or boilers at Gannon or Big Bend not Shutdown or on Reserve / Standby; and/or (ii) reduce the NO_x Emission Rate for any Big Bend coal-combusting Unit below the lowest rate otherwise applicable to it under this Consent Decree.

(1) For any Project(s) at Gannon. If Tampa Electric elects to undertake a project on an eligible Gannon Unit(s) to demonstrate any innovative NO_x control technology, within six months after entry of this Consent Decree Tampa Electric shall submit a plan to EPA, for review and approval, which sets forth: (a) the NO_x demonstration or innovative control technology projects being proposed; (b) the anticipated cost of the projects; (c) the reduction in NO_x or other environmental benefits anticipated to result from the project, and (d) a schedule for implementation of the project providing for

commencement and completion in accordance with the requirements of this Subparagraph. . EPA shall complete its review of this plan within 60 days after receipt. If such project is approved, Tampa Electric shall complete installation of the technology no later than December 31, 2004 as part of the Re-Powering of such Units; provided, however, that nothing in this Paragraph alters Tampa Electric's obligation under Paragraph 26 of this Consent Decree.

(1) For any Project(s) at Big Bend. At least three (3) years prior to the date on which the expenditure of any Project Dollars is to commence on Big Bend under this Subparagraph C, Tampa Electric shall submit a plan to EPA for review and approval which sets forth: (a) the NO_x demonstration or innovative control technology projects being proposed; (b) the anticipated cost of the projects; (c) the reduction in NO_x or other environmental benefits anticipated to result from the project, and (d) a schedule for implementation of the project providing for commencement and completion in accordance with the requirements of this Subparagraph. If EPA approves the projects contained in the plan, Tampa Electric shall implement the project(s). Projects that would demonstrate innovative NO_x control technology or reduce the NO_x Emission Rate for any Big Bend coal-fired or Re-Powered Unit shall be operating and achieving reductions or demonstrating the performance of the innovative technology, as applicable, not later than May 1, 2010.

(1) Follow-up Report(s). Within sixty (60) days following the implementation of each EPA-approved project, Tampa Electric shall submit to EPA a report that documents the date that all aspects of the project were implemented, Tampa Electric's results in implementing the project, including the emission reductions or other environmental benefits achieved, and the Project Dollars expended by Tampa Electric in implementing the project.

VIII. STIPULATED PENALTIES

53. For purposes of this Consent Decree, within thirty days after written demand from the United States, and subject to the provisions of Sections X (Force Majeure) and XI (Dispute Resolution), Tampa Electric shall pay the following stipulated penalties to the United States for each failure by Tampa Electric to comply with the terms of this Consent Decree.

A. For failure to pay timely the civil penalty as specified in Section VI of this Consent Decree, \$10,000 per day.

A. For all violations of a 24 hour Emission Rate – (1) Less than 5% in excess of limit: \$4,000 per day, per violation; (2) more than 5% but less than 10% in excess of limit: \$9,000 per day per violation; (3) equal to or greater than 10% in excess of limit: \$27,500 per day, per violation

A. For all violations of 30-day rolling average Emission Rates – (1) Less

than 5% in excess of limit: \$150 per day per violation; (2) more than 5% but less than 10% in excess of limit: \$300 per day per violation; (3) equal to or greater than 10% in excess of limit: \$800 per day per violation. Violation of an Emission Rate that is based on a 30 day rolling average is a violation on every day of the 30 day period on which the average is based . Where a violation of a 30 day rolling monthly average Emission Rate (for the same pollutant and from the same source) recurs within periods less than 30 days, Tampa Electric shall not pay a daily stipulated penalty for any day of the recurrence for which a stipulated penalty has already been paid.

A. For all violations of a 95% removal efficiency requirement – (1) For removal efficiency less than 95% but greater than or equal to 94%, \$4,000 per day, per violation; (2) for removal efficiency less than 94% but greater than or equal to 91%, \$9,000 per day, per violation; (3) for removal efficiency less than 91%, \$27,500 per day, per violation. For all violations of a 93% removal efficiency requirement – (1) For removal efficiency less than 93% but greater than or equal to 92%, \$4,000 per day, per violation; (2) for removal efficiency less than 92% but greater than or equal to 90%, \$9,000 per day, per violation; (3) for removal efficiency less than 90%, \$27,500 per day, per violation;

A. Violation of deadlines for Shutdown of boilers or Units or megawatt capacity — \$27,500 per day, per violation.

A. Failure to apply for the permits required by Paragraphs 26, 27, 34, 38, and

42 — \$1,000 per day, per violation.

A. Failure to implement the recommendations of the PM BACT Analysis or the PM optimization study by May 1, 2004 — \$5,000 per day, per violation for first 30 days; \$15,000 per day, per violation, for next 30 days; \$27,500 per day, per violation, thereafter.

A. Failure to commence combustion optimization at Big Bend Units 1, 2, or 3 on or before May 30, 2003 as required by Paragraph 35, \$10,000 per day, per violation.

A. Failure to operate the scrubbers at Big Bend Units 1, 2, or 3 on any day except as permitted by Paragraphs 29, 30, or 31, \$27,500 per day, per violation.

A. Failure to submit quarterly progress and monitoring report — \$100 per day, per violation, for first ten days late, and \$500 per day for each day thereafter.

A. Failure to complete timely any action or payment required by or established under Subparagraph 52(B) (Performance of Air Chemistry Work in Tampa Bay Estuary), \$5,000 per day, per violation

A. Failure to perform NO_x reduction or demonstration project(s), by the deadline(s) established in Subparagraph 52.C (Additional NO_x Reductions Project(s)), \$10,000 per day, per violation;

A. For failure to spend at least the number of Project Dollars required by this Consent Decree by date specified in Paragraph 50, \$5,000 per day, per violation;

A. Violation of any Consent Decree prohibition on use of allowances as provided in Paragraph 46 — three times the market value of the improperly used

allowance as measured at the time of the improper use.

54. Should Tampa Electric dispute its obligation to pay part or all of a stipulated penalty demanded by the United States, it may avoid the imposition of a separate stipulated penalty for the failure to pay the disputed penalty by depositing the disputed amount in a commercial escrow account pending resolution of the matter and by invoking the Dispute Resolution provisions of this Consent Decree within the time provided in this Section VIII of the Consent Decree for payment of the disputed penalty. If the dispute is thereafter resolved in Tampa Electric's favor, the escrowed amount plus accrued interest shall be returned to Tampa Electric. If the dispute is resolved in favor of the United States, it shall be entitled to the escrowed amount determined to be due by the Court, plus accrued interest. The balance in the escrow account, if any, shall be returned to Tampa Electric.
55. The United States reserves the right to pursue any other remedies to which it is entitled, including, but not limited to, a new civil enforcement action and additional injunctive relief for Tampa Electric's violations of this Consent Decree. If the United States elects to seek civil or contempt penalties after having collected stipulated penalties for the same violation, any further penalty awarded shall be reduced by the amount of the stipulated penalty timely paid or escrowed by Tampa Electric. Tampa Electric shall not be required to remit any stipulated penalty to the United States that is disputed in compliance with Part XI of this Consent Decree until the dispute is resolved in favor of the United

States. However, nothing in this Paragraph shall be construed to cease the accrual of the stipulated penalties until the dispute is resolved.

IX. RIGHT OF ENTRY

56. Any authorized representative of EPA or an appropriate state agency, including independent contractors, upon presentation of credentials, shall have a right of entry upon the premises of Tampa Electric's plants identified herein at any reasonable time for the purpose of monitoring compliance with the provisions of this Consent Decree, including inspecting plant equipment and inspecting and copying all records maintained by Tampa Electric required by this Consent Decree. Tampa Electric shall retain such records for a period of twelve (12) years from the date of entry of this Consent Decree. Nothing in this Consent Decree shall limit the authority of EPA to conduct tests and inspections at Tampa Electric's facilities under Section 114 of the Act, 42 U.S.C. § 7414.

X. FORCE MAJEURE

57. If any event occurs which causes or may cause a delay in complying with any provision of this Consent Decree, Tampa Electric shall notify the United States in writing as soon as practicable, but in no event later than seven (7) business days following the date Tampa Electric first knew, or within ten (10) business days following the date Tampa Electric should have known by the exercise of due

diligence, that the event caused or may cause such delay. In this notice Tampa Electric shall reference this Paragraph of this Consent Decree and describe the anticipated length of time the delay may persist, the cause or causes of the delay, the measures taken or to be taken by Tampa Electric to prevent or minimize the delay, and the schedule by which those measures will be implemented. Tampa Electric shall adopt all reasonable measures to avoid or minimize such delays.

58. Failure by Tampa Electric to comply with the notice requirements of Paragraph 57 shall render this Section X voidable by the United States as to the specific event for which Tampa Electric has failed to comply with such notice requirement. If voided, the provisions of this Section shall have no effect as to the particular event involved.

59. The United States shall notify Tampa Electric in writing regarding Tampa Electric's claim of a delay in performance within (15) fifteen business days of receipt of the Force Majeure notice provided under Paragraph 57. If the United States agrees that the delay in performance has been or will be caused by circumstances beyond the control of Tampa Electric, including any entity controlled by Tampa Electric, and that Tampa Electric could not have prevented the delay through the exercise of due diligence, the parties shall stipulate to an extension of the required deadline(s) for all requirement(s) affected by the delay for a period equivalent to the delay actually caused by such circumstances. Such stipulation shall be filed as a modification to this Consent Decree in order to be

effective. Tampa Electric shall not be liable for stipulated penalties for the period of any such delay.

60. If the United States does not accept Tampa Electric's claim of a delay in performance, to avoid the imposition of stipulated penalties Tampa Electric must submit the matter to this Court for resolution by filing a petition for determination. Once Tampa Electric has submitted the matter, the United States shall have fifteen business days to file its response. If Tampa Electric submits the matter to this Court for resolution, and the Court determines that the delay in performance has been or will be caused by circumstances beyond the control of Tampa Electric, including any entity controlled by Tampa Electric, and that Tampa Electric could not have prevented the delay by the exercise of due diligence, Tampa Electric shall be excused as to that event(s) and delay (including stipulated penalties otherwise applicable), but only for the period of time equivalent to the delay caused by such circumstances.
61. Tampa Electric shall bear the burden of proving that any delay in performance of any requirement of this Consent Decree was caused by or will be caused by circumstances beyond its control, including any entity controlled by it, and that Tampa Electric could not have prevented the delay by the exercise of due diligence. Tampa Electric shall also bear the burden of proving the duration and extent of any delay(s) attributable to such circumstances. An extension of one compliance date based on a particular event may, but will not necessarily, result in

an extension of a subsequent compliance date.

62. Unanticipated or increased costs or expenses associated with the performance of Tampa Electric's obligations under this Consent Decree shall not constitute circumstances beyond the control of Tampa Electric or serve as a basis for an extension of time under this Section. However, failure of a permitting authority to issue a necessary permit in a timely fashion may constitute a Force Majeure event where the failure of the permitting authority to act is beyond the control of Tampa Electric and Tampa Electric has taken all steps available to it to obtain the necessary permit, including, but not limited to, submitting a complete permit application, responding to requests for additional information by the permitting authority in a timely fashion, accepting lawful permit terms and conditions, and prosecuting appeals of any allegedly unlawful terms and conditions imposed by the permitting authority in an expeditious fashion.
63. The parties agree that, depending upon the circumstances related to an event and Tampa Electric's response to such circumstances, the kinds of events listed below could also qualify as Force Majeure events within the meaning of this Section X of the Consent Decree: Construction, labor, or equipment delays; natural gas and gas transportation availability delays; acts of God; and the failure of an innovative technology approved under Paragraph 26.B and 52.C.
64. Notwithstanding any other provision of this Consent Decree, this Court shall not draw any inferences nor establish any presumptions adverse to either party as a

result of Tampa Electric delivering a notice pursuant to this Section or the parties' inability to reach agreement on a dispute under this Part.

65. As part of the resolution of any matter submitted to this Court under this Section, the parties by agreement, or this Court by order, may in appropriate circumstances extend or modify the schedule for completion of work under this Consent Decree to account for the delay in the work that occurred as a result of any delay agreed to by the United States or approved by this Court. Tampa Electric shall be liable for stipulated penalties for its failure thereafter to complete the work in accordance with the extended or modified schedule.

XI. DISPUTE RESOLUTION

66. The dispute resolution procedure provided by this Section XI shall be available to resolve all disputes arising under this Consent Decree, except as provided in Section X regarding Force Majeure, or in this Section XI, provided that the party making such application has made a good faith attempt to resolve the matter with the other party.
67. The dispute resolution procedure required herein shall be invoked by one party to this Consent Decree giving written notice to another advising of a dispute pursuant to this Section XI. The notice shall describe the nature of the dispute and shall state the noticing party's position with regard to such dispute. The party receiving such a notice shall acknowledge receipt of the notice, and the parties

shall expeditiously schedule a meeting to discuss the dispute informally not later than fourteen (14) days following receipt of such notice.

68. Disputes submitted to dispute resolution under this Section shall, in the first instance, be the subject of informal negotiations between the parties. Such period of informal negotiations shall not extend beyond thirty (30) calendar days from the date of the first meeting between representatives of the United States and Tampa Electric unless the parties' representatives agree to shorten or extend this period.
69. If the parties are unable to reach agreement during the informal negotiation period, the United States shall provide Tampa Electric with a written summary of its position regarding the dispute. The written position provided by the United States shall be considered binding unless, within thirty (30) calendar days thereafter, Tampa Electric files with this Court a petition which describes the nature of the dispute and seeks resolution. The United States may respond to the petition within forty-five (45) calendar days of filing.
70. Where the nature of the dispute is such that a more timely resolution of the issue is required, the time periods set out in this Section may be shortened upon motion of one of the parties to the dispute.
71. This Court shall not draw any inferences nor establish any presumptions adverse to either party as a result of invocation of this Section or the parties' inability to reach agreement.

72. As part of the resolution of any dispute under this Section, in appropriate circumstances the parties may agree, or this Court may order, an extension or modification of the schedule for completion of work under this Consent Decree to account for the delay that occurred as a result of dispute resolution. Tampa Electric shall be liable for stipulated penalties for its failure thereafter to complete the work in accordance with the extended or modified schedule.
73. The Court shall decide all disputes pursuant to applicable principles of law for resolving such disputes; provided, however, that the United States and Tampa Electric reserve their rights to argue for what the applicable standard of law should be for resolving any particular dispute. Notwithstanding the preceding sentence of this Paragraph, as to disputes arising under Paragraph 32, the Court shall sustain the position of the United States as to the BACT Analysis recommendations and the optimization study measures that should be installed and implemented, unless Tampa Electric demonstrates that the position of the United States is arbitrary or capricious.

XII. GENERAL PROVISIONS

74. Effect of Settlement. This Consent Decree is not a permit; compliance with its terms does not guarantee compliance with all applicable Federal, State or Local laws or regulations.
75. Satisfaction of all of the requirements of this Consent Decree constitutes full

settlement of and shall resolve and release Tampa Electric from all civil liability of Tampa Electric to the United States for the claims referred to in Paragraphs 43 and 44 of this Consent Decree. This Consent Decree does not apply to any claim(s) of alleged criminal liability, which are reserved.

76. In any subsequent administrative or judicial action initiated by the United States for injunctive relief or civil penalties relating to the facilities covered by this Consent Decree, Tampa Electric shall not assert any defense or claim based upon principles of waiver, res judicata, collateral estoppel, issue preclusion, claim splitting, or other defense based upon any contention that the claims raised by the United States in the subsequent proceeding were brought, or should have been brought, in the instant case; provided, however, that nothing in this Paragraph is intended to affect the enforceability of the Resolution of Claims provisions of Paragraphs 43 and 44 of this Consent Decree..
77. Other Laws. Except as specifically provided by this Consent Decree, nothing in this Consent Decree shall relieve Tampa Electric of its obligation to comply with all applicable Federal, State and Local laws and regulations. Subject to Paragraph 43 and 44, nothing contained in this Consent Decree shall be construed to prevent or limit the United States' rights to obtain penalties or injunctive relief under the Clean Air Act or other federal, state or local statutes or regulations.
78. Third Parties. This Consent Decree does not limit, enlarge or affect the rights of any party to this Consent Decree as against any third parties.

79. Costs. Each party to this action shall bear its own costs and attorneys' fees.
80. Public Documents. All information and documents submitted by Tampa Electric to the United States pursuant to this Consent Decree shall be subject to public inspection, unless subject to legal privileges or protection or identified and supported as business confidential by Tampa Electric in accordance with 40 C.F.R. Part 2.
81. Public Comments. The parties agree and acknowledge that final approval by the United States and entry of this Consent Decree is subject to the requirements of 28 C.F.R. § 50.7, which provides for notice of the lodging of this Consent Decree in the Federal Register, an opportunity for public comment, and the right of the United States to withdraw or withhold consent if the comments disclose facts or considerations which indicate that the Consent Decree is inappropriate, improper, or inadequate.
82. Notice. Unless otherwise provided herein, notifications to or communications with the United States or Tampa Electric shall be deemed submitted on the date they are postmarked and sent either by overnight mail, return receipt requested, or by certified or registered mail, return receipt requested. Except as otherwise provided herein, when written notification to or communication with the United States, EPA, or Tampa Electric is required by the terms of this Consent Decree, it shall be addressed as follows:

As to the United States of America:

For U.S. DOJ –

Chief
Environmental Enforcement Section
Environment and Natural Resources Division
U.S. Department of Justice
P.O. Box 7611, Ben Franklin Station
Washington, D.C. 20044-7611
DJ# 90-5-2-1-06932

Whitney L. Schmidt
Coordinator, Affirmative Civil Enforcement Program
Office of the United States Attorney
Middle District of Florida
400 N. Tampa Street
Tampa, FL 33602

For U.S. EPA -

Director, Air Enforcement Division
Office of Enforcement and Compliance Assurance
U.S. Environmental Protection Agency
Ariel Rios Building [2242A]
1200 Pennsylvania Avenue, N.W.
Washington, DC 20460

and

Regional Administrator
U.S. EPA Region IV
61 Forsyth Street, S.E.
Atlanta, GA 30303

As to Tampa Electric:

Sheila M. McDevitt
General Counsel
Tampa Electric Company
P.O. Box 111
Tampa, FL 333601-0111

83. Any party may change either the notice recipient or the address for providing notices to it by serving all other parties with a notice setting forth such new notice recipient or address.
84. Modification. Except as otherwise allowed by law, there shall be no modification of this Consent Decree without written approval by the United States and Tampa Electric, and approval of such modification by the Court.
85. Continuing Jurisdiction. The Court shall retain jurisdiction of this case after entry of this Consent Decree to enforce compliance with the terms and conditions of this Consent Decree and to take any action necessary or appropriate for its interpretation, construction, execution, or modification. During the term of this Consent Decree, any party may apply to the Court for any relief necessary to construe or effectuate this Consent Decree.
86. Complete Agreement. This Consent Decree constitutes the final, complete and exclusive agreement and understanding among the parties with respect to the settlement embodied in this Consent Decree. The parties acknowledge that there are no representations, agreements or understandings relating to the settlement other than those expressly contained in this Consent Decree. An Appendix is attached to and incorporated into this Consent Decree by this reference.

XIII. TERMINATION

87. Except as provided in Paragraphs 43, 44, and 45 (involving resolution of claims),

this Consent Decree shall be subject to termination upon motion by either party after Tampa Electric satisfies all requirements of this Consent Decree, including payment of all stipulated penalties that may be due, installation of control technology systems as specified herein, the receipt of all permits specified herein, securing valid Title V Permits for Gannon and Big Bend that incorporate all emission and fuel limits from this Consent Decree as well as all operational limits established under this Consent Decree, and the submission of all final reports indicating satisfaction of the requirements for implementation of all acts called for under Part VII of this Consent Decree.

88. If Tampa Electric believes it has achieved compliance with the requirements of this Consent Decree, then Tampa Electric shall so certify to the United States. Unless the United States objects in writing with specific reasons within 60 days of receipt of Tampa Electric's certification, the Court shall order that this Consent Decree be terminated on Tampa Electric's motion. If the United States objects to Tampa Electric's certification, then the matter shall be submitted to the Court for resolution under Section XI of this Consent Decree. In such case, Tampa Electric shall bear the burden of proving that this Consent Decree should be terminated.


SO ORDERED, THIS _____ DAY OF _____ 2000.

UNITED STATES DISTRICT JUDGE

Signature Page for Consent Decree in United States v. Tampa Electric Company,
Civ. No. 99-2524 CIV-T-23F



Steve A. Herman
Assistant Administrator for Enforcement
U.S. Environmental Protection Agency
Washington, D.C.




Bruce Buckheit
Director

Gregory Jaffe
Senior Enforcement Counsel

Air Enforcement Division
Office of Enforcement and Compliance Assurance
U.S. Environmental Protection Agency
Washington, D.C.

BEST AVAILABLE COPY


Signature Page for Consent Decree in United States v. Tampa Electric Company,
Civ. No. 99-2524 CIV-T-23F

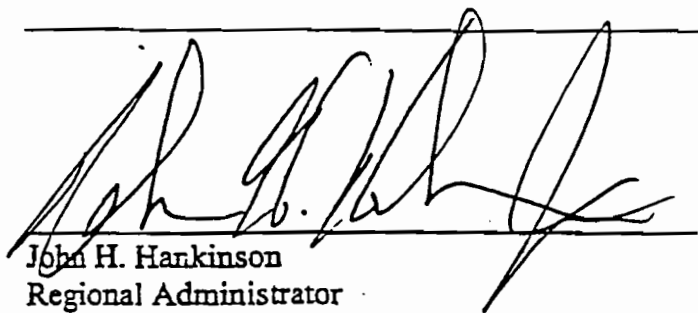

John H. Harkinson
Regional Administrator
U.S. Environmental Protection Agency (Region IV)
Atlanta, Georgia


THROUGH ITS UNDERSIGNED REPRESENTATIVES, THE UNITED STATES AGREES
AND CONSENTS TO ENTRY OF THE FOREGOING CONSENT DECREE:

FOR PLAINTIFF
UNITED STATES OF AMERICA:




Lois J. Schiffer
Assistant Attorney General
Environment and Natural Resources
Division
United States Department of Justice

Date: 2/28/00



W. Benjamin Fisherow
Assistant Chief
Thomas A. Mariani, Jr.
Jon A. Mueller
Senior Attorneys
Environmental Enforcement Section
United States Department of Justice
P.O. Box 7611
Washington, D.C. 20044
(202) 514-4620


Donna A. Bucella
United States Attorney for the
Middle District of Florida

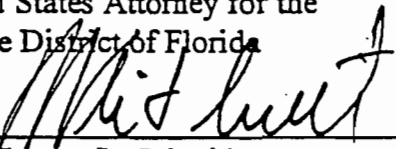By: 

Whitney L. Schmidt
Affirmative Civil Enforcement Coordinator
Assistant United States Attorney
United States Attorney's Office
Middle District of Florida
Florida Bar No. 0337129
Tampa, Florida 33602
(813) 274-6000
(813) 274-6198 (facsimile)


THROUGH ITS UNDERSIGNED REPRESENTATIVES, TAMPA ELECTRIC COMPANY
AGREES AND CONSENTS TO ENTRY OF THE FOREGOING CONSENT DECREE

FOR TAMPA ELECTRIC COMPANY

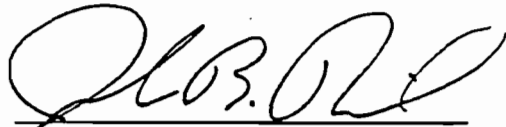

Date: 2/29/00

John B. Ramil
President
Tampa Electric Company



Sheila M. McDevitt
General Counsel
Tampa Electric Company

Tampa Electric Company



Big Bend Station Unit 3
Corrective Action Plan
EPC Case No. 00-1223CCG0039

November 12, 2001



1.0	SUMMARY.....	1
2.0	INTRODUCTION.....	2
3.0	CORRECTIVE ACTION PLAN.....	3
3.1	PROCEDURE REVIEW & UPDATE.....	3
3.2	EMISSION DATA ANALYSIS.....	3
3.3	OPERATIONAL ENHANCEMENTS.....	4
4.0	CONCLUSION.....	5



1.0 Summary

From December 23, 2000 through December 31, 2000, Tampa Electric Company's (TEC's) Big Bend Station Unit 3 exceeded its 30-day rolling average (Nitrogen Oxides) NO_x emission limit of 0.70 pounds per million BTU (lb/MMBtu), as described in Specific Condition No. A10 of Title V permit number 0570039-002-AV. TEC notified the Environmental Protection Commission of Hillsborough County (EPC) on December 29, 2000 of this occurrence. A follow-up letter was sent to the EPC on January 5, 2001, describing the event. On January 26, 2001, TEC received a warning notice from EPC, which requested a more detailed description of the events that caused the emissions violation. TEC responded with a letter dated February 5, 2001, that summarized the incident. On May 9, 2001, TEC received a Notice of Intent to Initiate Enforcement from EPC and on October 15, 2001 TEC executed Consent Order, EPC Case No. 00-1223CCG0039 with the EPC. Pursuant to the requirements set forth in the Consent Order, TEC agreed to pay a fine in the amount of \$16,875.00 and submit a Corrective Action Plan (CAP) for the aforementioned NO_x exceedance. TEC understands that with the submittal of this document, the Consent Order condition requiring the development and submittal of a CAP will be satisfied.



2.0 Introduction

Big Bend Unit 3 is a fossil fuel fired steam boiler generating unit rated at 4,115 MMBtu/hour with an electrical generating capacity of 445 MW. It is a "wet" bottom utility boiler manufactured by Riley Stoker Corporation. This unit may be fired on coal, a coal/residual fuel blend containing a maximum of 5.0% residual fuel by weight, a coal/petroleum coke blend consisting of a maximum of 20.0% petroleum coke by weight, or a coal/residual fuel/petcoke blend containing a maximum of 5.0% residual fuel and a maximum of 20.0% petcoke, by weight. Operation of this unit may include diverting all of the flue gas into the existing Big Bend Unit No. 4 flue gas desulfurization (FGD) system for sulfur dioxide emissions control. Sulfur dioxide emissions that are generated and not diverted through the Unit No. 4 FGD system are uncontrolled. However, Consent Decree number 99-2524 CIV-T-23F limits this method of operation to no more than 30 days per year. Particulate matter emissions generated during the operation of the unit are controlled by a dry electrostatic precipitator (ESP) manufactured by Research-Cottrell, Inc.

The facility is currently permitted under the Title V program administered by the Florida Department of Environmental Protection (FDEP), Permit No. 0570037-002-AV. Specific Condition No. A.10 of the current Title V Permit limits the NO_x emissions to 0.70 lb/MMBtu heat input based on a 30 day rolling average.

Paragraph 5 of Consent Order, EPC Case No. 00-1223CCG0039 executed on October 15, 2001 between EPC and TEC requires TEC to develop, implement, and submit a CAP to prevent future NO_x emissions exceedances from Big Bend Unit 3. Pursuant to the requirements and intent of the Consent Order, TEC has developed a CAP, which is discussed in the following section.



3.0 Corrective Action Plan

Development of this CAP was initiated immediately after the Big Bend Unit 3 NO_x exceedance was discovered, and initial corrective actions were implemented. Big Bend also developed long-term solutions and continues to evaluate additional measures to ensure compliance with the NO_x limitations. Below is a description of each implemented action to support immediate and continued reduction of NO_x emissions.

3.1. Procedure Review & Update

Procedure Review - Immediately following the event, TEC provided refresher training regarding procedures for all operators to ensure they understand their environmental role within TEC. In addition, Big Bend Station personnel were clearly assigned responsibility to track and monitor NO_x levels.

Control Room Display and Placard Installation - At the time of the event, the NO_x emission rate was already displayed on the screen in the control room. However, to heighten awareness, a warning placard was installed in the control room. This display is now monitored 24 hours a day by the control room operators. Additionally, an alarm has been installed in the control room to alert the operators when the instantaneous NO_x emission levels reach 0.7 lb/MMBtu. This provides the operations personnel time to adjust operating parameters to lower NO_x before reaching a 30-day average exceedance.

3.2. Emission Data Analysis

Daily Summary - Prior to this event, TEC had established a report, which calculates the average NO_x emission rate on a daily basis. This data is obtained directly from the Continuous Emissions Monitoring system (CEMs). TEC also created a spreadsheet which tracks these daily averages and provides a weighted 30-day rolling average NO_x emission limit. Since this event, the plant has assigned specific personnel and back-ups to maintain and check this information.

Trending - To avoid future events, an interactive spreadsheet program was developed and implemented to calculate the average NO_x emission rate on a monthly basis, using actual and forecast data inputs. This interactive program can be used to trend and predict NO_x emission levels resulting from continued operations of the unit. Based on event warning criteria and the daily summaries, when the unit reaches or approaches an instantaneous NO_x emission level of 0.7 lb/MMBtu operational adjustments can be made to maintain compliance. This program can also be used to predict what impact forecast load profiles can have on the 30-day rolling average NO_x emission limit and allow adjustments to be made in advance to ensure compliance.



3.3. Operational Enhancements

Slag Removal – As a corrective action to this event, TEC has implemented more selective and frequent slag removal to reduce NO_x emissions formation from the unit. NO_x formation and the boiler thermal performance are directly effected by the operation of a unit's sootblowers. During normal operations, excessive slag can build up in the radiant section of the boiler and reduce the heat flux in that area. This results in higher peak flame temperatures, which is directly related to the amount of thermal NO_x generated. The current control philosophy uses sequential based schemes whose frequency is dictated by the control room operator. Careful and selective sootblowing of the furnace optimizes heat transfer to the various sections to achieve maximum boiler efficiency. This produces lower peak flame temperatures, which results in reduced NO_x formation.



4.0 Conclusion

TEC has taken great strides to prevent NO_x emissions exceedances for Big Bend Station's Unit 3 and has been extremely successful thus far. Through the immediate corrective actions taken by plant personnel, NO_x emissions from Unit 3 were returned to below permitted levels in a short period of time after the exceedance was discovered. In addition, Unit 3 has continued to operate in compliance with permitted NO_x emissions since the original exceedance.

TEC is evaluating further NO_x reductions from Big Bend Unit 3 through the implementation of the Early NO_x Reduction Program as required by the Consent Decree entered into between the United States of America and TEC on October 4, 2000. Specifically, paragraph 35 of the document requires that TEC spend up to \$3 million with the goal of reducing NO_x emissions from Units 1 and 2 by 30% below 1998 levels and from Unit 3 by 15% below 1998 levels. TEC and U.S. Environmental Protection Agency (EPA) agree that in 1998, the NO_x emission rate from Unit 3 was 0.57 lb/MMBtu. Thus far, TEC has installed low NO_x burners on Unit 1, a neural network on Unit 2, and is evaluating options for Unit 3. No later than January 1, 2002, TEC will submit a report to EPA detailing its plans for achieving early NO_x reductions from Unit 3. No later than December 31, 2002, the Unit 3 NO_x reduction strategy identified in the above report should be implemented.

Appendix A-1, Abbreviations, Acronyms, Citations, and Identification Numbers (version dated 02/05/97)

Abbreviations and Acronyms:

°F: Degrees Fahrenheit
BACT: Best Available Control Technology
CFR: Code of Federal Regulations
DEP: State of Florida, Department of Environmental Protection
DARM: Division of Air Resource Management
EPA: United States Environmental Protection Agency
F.A.C.: Florida Administrative Code
F.S.: Florida Statute
ISO: International Standards Organization
LAT: Latitude
LONG: Longitude
MMBtu: million British thermal units
MW: Megawatt
ORIS: Office of Regulatory Information Systems
SOA: Specific Operating Agreement
UTM: Universal Transverse Mercator

Citations:

The following examples illustrate the methods used in this permit to abbreviate and cite the references of rules, regulations, guidance memorandums, permit numbers, and ID numbers.

Code of Federal Regulations:

Example: [40 CFR 60.334]

Where:	40	reference to	Title 40
	CFR	reference to	Code of Federal Regulations
	60	reference to	Part 60
	60.334	reference to	Regulation 60.334

Florida Administrative Code (F.A.C.) Rules:

Example: [Rule 62-213, F.A.C.]

Where:	62	reference to	Title 62
	62-213	reference to	Chapter 62-213
	62-213.205	reference to	Rule 62-213.205, F.A.C.

ISO: International Standards Organization refers to those conditions at 288 degrees K, 60 percent relative humidity, and 101.3 kilopascals pressure.

**Appendix A-1, Abbreviations, Acronyms, Citations, and Identification Numbers
(version dated 02/05/97) (continued)**

Identification Numbers:

Facility Identification (ID) Number:

Example: Facility ID No.: 1050221

Where:

105 = 3-digit number code identifying the facility is located in Polk County
0221 = 4-digit number assigned by state database.

Permit Numbers:

Example: 1050221-002-AV, or
1050221-001-AC

Where:

AC = Air Construction Permit
AV = Air Operation Permit (Title V Source)
105 = 3-digit number code identifying the facility is located in Polk County
0221 = 4-digit number assigned by permit tracking database
001 or 002 = 3-digit sequential project number assigned by permit tracking database

Example: PSD-FL-185
PA95-01
AC53-208321

Where:

PSD = Prevention of Significant Deterioration Permit
PA = Power Plant Siting Act Permit
AC = old Air Construction Permit numbering

Appendix H-1: Permit History

**Tampa Electric Company
Big Bend Station**

**DRAFT Title V Operation Permit Revision No.: 0570039-017-AV
Facility ID No.: 0570039**

E.U. ID No.	Description	Permit No.	Effective Date	Expiration Date	Project Type
003	Unit No. 3 Steam Generator – Removed the sulfur content limit of the petroleum coke fired and revised the vanadium content limit in the petroleum coke ash.	AO-29-179911	09-07-2000	12-31-01	State AO permit revision
004	Unit No. 4 Steam Generator – Removed the sulfur content limit of the petroleum coke fired and revised the vanadium content limit in the petroleum coke ash.	0570039-008-AC	12-29-00	01-01-01	PSD Construction: minor modification
001 - 036	All emission units	0570039-002-AV	01-01-01	12-31-04	Title V: Initial
004	Unit No. 4 Steam Generator – Revised the revision to the vanadium content limit.	0570039-009-AC	05-07-01	05-07-06	PSD Construction: minor modification
001 - 036	All emissions units	0570039-010-AV	07-24-01	12-31-04	Title V: Revision
001 - 004, 037 - 038	Allowed the storage, transfer and firing of Polk Power Station coal residual	0570039-012-AC	10-04-01	12-31-03	PSD Construction: minor modification
001 - 038	All emissions units	0570039-013-AV	04-06-04	12-31-04	Title V: Revision
001 - 004	Steam Generator units NOx Pollution Control Projects	0570039-014-AC	Pending		PSD Construction: minor modification
001 - 039	Most emissions units - Clarifications and deletion of redundant conditions All emissions units - Renewal	0570039-017-AV	Pending		Title V: Revision/Renewal
001 - 039	Most emission units - Clarifications and deletion of redundant conditions	0570039-016-AC	Pending		PSD Construction: minor modification

APPENDIX CAM - Compliance Assurance Monitoring Requirements

Pursuant to Rule 62-213.440(1)(b)1.a., F.A.C., the CAM plans that are included in this appendix contain the monitoring requirements necessary to satisfy 40 CFR 64. Conditions 1. – 17. are generic conditions applicable to all emissions units that are subject to the CAM requirements. Specific requirements related to each emissions unit are contained in the attached tables, as submitted by the applicant and approved by the Department.

40 CFR 64.6 Approval of Monitoring.

1. The attached CAM plan(s), as submitted by the applicant, is/are approved for the purposes of satisfying the requirements of 40 CFR 64.3.
[40 CFR 64.6(a)]
2. The attached CAM plan(s) include the following information:
 - (i) The indicator(s) to be monitored (such as temperature, pressure drop, emissions, or similar parameter);
 - (ii) The means or device to be used to measure the indicator(s) (such as temperature measurement device, visual observation, or CEMS); and
 - (iii) The performance requirements established to satisfy 40 CFR 64.3(b) or (d), as applicable.[40 CFR 64.6(c)(1)]
3. The attached CAM plan(s) describe the means by which the owner or operator will define an exceedance of the permitted limits or an excursion from the stated indicator ranges and averaging periods for purposes of responding to (see **CAM Conditions 5. - 9.**) and reporting exceedances or excursions (see **CAM Conditions 10. – 14.**).
[40 CFR 64.6(c)(2)]
4. The permittee is required to conduct the monitoring specified in the attached CAM plan(s) and shall fulfill the obligations specified in the conditions below (see **CAM Conditions 5. - 17.**).
[40 CFR 64.6(c)(3)]

40 CFR 64.7 Operation of Approved Monitoring.

5. Commencement of operation. The owner or operator shall conduct the monitoring required under this appendix upon the effective date of this Title V permit.
[40 CFR 64.7(a)]
6. Proper maintenance. At all times, the owner or operator shall maintain the monitoring, including but not limited to, maintaining necessary parts for routine repairs of the monitoring equipment.
[40 CFR 64.7(b)]
7. Continued operation. Except for, as applicable, monitoring malfunctions, associated repairs, and required quality assurance or control activities (including, as applicable, calibration checks and required zero and span adjustments), the owner or operator shall conduct all monitoring in continuous operation (or shall collect data at all required intervals) at all times that the pollutant-specific emissions unit is operating. Data recorded during monitoring malfunctions, associated repairs, and required quality assurance or control activities shall not be used for purposes of this part, including data averages and calculations, or fulfilling a minimum data availability requirement, if applicable. The owner or operator shall use all the data collected during all other periods in assessing the operation of the control device and associated control system. A monitoring malfunction is any sudden, infrequent, not reasonably preventable failure of the monitoring to provide valid data. Monitoring failures that are caused in part by poor maintenance or careless operation are not malfunctions.
[40 CFR 64.7(c)]

8. Response to excursions or exceedances.

- a. Upon detecting an excursion or exceedance, the owner or operator shall restore operation of the pollutant-specific emissions unit (including the control device and associated capture system) to its normal or usual manner of operation as expeditiously as practicable in accordance with good air pollution control practices for minimizing emissions. The response shall include minimizing the period of any startup, shutdown or malfunction and taking any necessary corrective actions to restore normal operation and prevent the likely recurrence of the cause of an excursion or exceedance (other than those caused by excused startup or shutdown conditions, if allowed by this permit). Such actions may include initial inspection and evaluation, recording that operations returned to normal without operator action (such as through response by a computerized distribution control system), or any necessary follow-up actions to return operation to within the indicator range, designated condition, or below the applicable emission limitation or standard, as applicable.
- b. Determination of whether the owner or operator has used acceptable procedures in response to an excursion or exceedance will be based on information available, which may include but is not limited to, monitoring results, review of operation and maintenance procedures and records, and inspection of the control device, associated capture system, and the process.

[40 CFR 64.7(d)(1) & (2)]

9. Documentation of need for improved monitoring. If the owner or operator identifies a failure to achieve compliance with an emission limitation or standard for which the approved monitoring did not provide an indication of an excursion or exceedance while providing valid data, or the results of compliance or performance testing document a need to modify the existing indicator ranges or designated conditions, the owner or operator shall promptly notify the permitting authority and, if necessary, submit a proposed modification to the Title V permit to address the necessary monitoring changes. Such a modification may include, but is not limited to, reestablishing indicator ranges or designated conditions, modifying the frequency of conducting monitoring and collecting data, or the monitoring of additional parameters.

[40 CFR 64.7(e)]

40 CFR 64.8 Quality Improvement Plan (QIP) Requirements.

10. Based on the results of a determination made under **CAM Condition a.**, above, the permitting authority may require the owner or operator to develop and implement a QIP. Consistent with **CAM Condition 4.**, an accumulation of exceedances or excursions exceeding 5 percent duration of a pollutant-specific emissions unit's operating time for a reporting period, may require the implementation of a QIP. The threshold may be set at a higher or lower percent or may rely on other criteria for purposes of indicating whether a pollutant-specific emissions unit is being maintained and operated in a manner consistent with good air pollution control practices.

[40 CFR 64.8(a)]

11. Elements of a QIP:

- a. The owner or operator shall maintain a written QIP, if required, and have it available for inspection.
- b. The plan initially shall include procedures for evaluating the control performance problems and, based on the results of the evaluation procedures, the owner or operator shall modify the plan to include procedures for conducting one or more of the following actions, as appropriate:
 - (i) Improved preventive maintenance practices.
 - (ii) Process operation changes.
 - (iii) Appropriate improvements to control methods.
 - (iv) Other steps appropriate to correct control performance.
 - (v) More frequent or improved monitoring (only in conjunction with one or more steps under **CAM Condition 11.b(i)** through **(iv)**, above).

[40 CFR 64.8(b)]

12. If a QIP is required, the owner or operator shall develop and implement a QIP as expeditiously as practicable and shall notify the permitting authority if the period for completing the improvements contained in the QIP exceeds 180 days from the date on which the need to implement the QIP was determined.

[40 CFR 64.8(c)]

13. Following implementation of a QIP, upon any subsequent determination pursuant to **CAM Condition b.**, the permitting authority may require that an owner or operator make reasonable changes to the QIP if the QIP is found to have:
- Failed to address the cause of the control device performance problems; or
 - Failed to provide adequate procedures for correcting control device performance problems as expeditiously as practicable in accordance with good air pollution control practices for minimizing emissions.

[40 CFR 64.8(d)]

14. Implementation of a QIP shall not excuse the owner or operator of a source from compliance with any existing emission limitation or standard, or any existing monitoring, testing, reporting or recordkeeping requirement that may apply under federal, state, or local law, or any other applicable requirements under the Act.

[40 CFR 64.8(e)]

40 CFR 64.9 Reporting And Recordkeeping Requirements.

15. General reporting requirements.

- On and after the date specified in **CAM Condition 5.** by which the owner or operator must use monitoring that meets the requirements of this appendix, the owner or operator shall submit monitoring reports semi-annually to the permitting authority in accordance with Rule 62-213.440(1)(b)3.a., F.A.C.
- A report for monitoring under this part shall include, at a minimum, the information required under Rule 62-213.440(1)(b)3.a., F.A.C., and the following information, as applicable:
 - Summary information on the number, duration and cause (including unknown cause, if applicable) of excursions or exceedances, as applicable, and the corrective actions taken;
 - Summary information on the number, duration and cause (including unknown cause, if applicable) for monitor downtime incidents (other than downtime associated with zero and span or other daily calibration checks, if applicable); and
 - A description of the actions taken to implement a QIP during the reporting period as specified in **CAM Conditions 10. through 14.** Upon completion of a QIP, the owner or operator shall include in the next summary report documentation that the implementation of the plan has been completed and reduced the likelihood of similar levels of excursions or exceedances occurring.

[40 CFR 64.9(a)]

16. General recordkeeping requirements.

- The owner or operator shall comply with the recordkeeping requirements specified in Rule 62-213.440(1)(b)2., F.A.C. The owner or operator shall maintain records of monitoring data, monitor performance data, corrective actions taken, any written quality improvement plan required pursuant to **CAM Conditions 10. through 14.** and any activities undertaken to implement a quality improvement plan, and other supporting information required to be maintained under this part (such as data used to document the adequacy of monitoring, or records of monitoring maintenance or corrective actions).
- Instead of paper records, the owner or operator may maintain records on alternative media, such as microfilm, computer files, magnetic tape disks, or microfiche, provided that the use of such alternative media allows for expeditious inspection and review, and does not conflict with other applicable recordkeeping requirements.

[40 CFR 64.9(b)]

40 CFR 64.10 Savings Provisions.

17. It should be noted that nothing in this appendix shall:

- Excuse the owner or operator of a source from compliance with any existing emission limitation or standard, or any existing monitoring, testing, reporting or recordkeeping requirement that may apply under federal, state, or local law, or any other applicable requirements under the Act. The requirements of this appendix shall not be used to justify the approval of monitoring less stringent than the monitoring which is required under separate legal authority and are not intended to establish minimum requirements for the purpose of determining the monitoring to be imposed under separate authority under the Act, including monitoring in permits issued pursuant to title I of the Act. The purpose of this part is to require,

as part of the issuance of a permit under Title V of the Act, improved or new monitoring at those emissions units where monitoring requirements do not exist or are inadequate to meet the requirements of this part.

- b. Restrict or abrogate the authority of the Administrator or the permitting authority to impose additional or more stringent monitoring, recordkeeping, testing, or reporting requirements on any owner or operator of a source under any provision of the Act, including but not limited to sections 114(a)(1) and 504(b), or state law, as applicable.
- c. Restrict or abrogate the authority of the Administrator or permitting authority to take any enforcement action under the Act for any violation of an applicable requirement or of any person to take action under section 304 of the Act.

[40 CFR 64.10]

Emissions Units 001, 002, 003 & 004

Steam Generating Units Nos. 1-4 PM Emissions Controlled By ESPs Monitoring Approach

Indicator No. 1	
I. Indicator	Opacity.
II. Measurement Approach	The use of a 40 CFR 75 certified continuous opacity monitoring system (COMS) and data acquisition handling system (DAHS).
III. Indicator Range	An excursion is defined as any 3-hour average visible emission that exceeds 12 percent opacity, excluding periods of startup, shutdown and malfunction pursuant to Rule 62-210.700, F.A.C.
IV. Performance Criteria	
a. Data Representativeness	The COMS locations meet the specifications of 40 CFR 75 and 40 CFR 60, Appendix B.
b. Verification of Operational Status	N/A
c. QA/QC Practices and Criteria	The COMS are operated and maintained in accordance with Appendix B to Part 75, Quality Assurance and Quality Control Procedures.
d. Monitoring Frequency	Continuous
e. Data Collection Procedures	Automated data acquisition system (DAHS)
f. Averaging Period	3-hour average

Ranges for Indicator — Opacity

Emission Unit/Control Device	Indicator Range (% opacity) Maximum
Unit 1—ESP	12
Unit 2—ESP	12
Unit 3—ESP	12
Unit 4—ESP	12