



April 17, 2014

Jeffery F. Koerner, Program Administrator
Florida Department of Environmental Protection
Division of Air Resource Management
Office of Air Permitting and Compliance
2600 Blair Stone Road, M.S. 5505
Tallahassee, Florida 32399-2400

Via E-Mail Notification
Jeff.Koerner@dep.state.fl.us

**RE: Tampa Electric Company - Big Bend Station
Request for Information Response No. 2
J3 Conveyor System, Unit 3 Furnace & ESP Enhancements,
and Permit Cleanup Modifications
Proposed Permit Nos. 0570039-066-AC/0570039-067-AV
Facility ID No. 0570039**

Dear Mr. Koerner:

Tampa Electric Company ("TEC") submitted a permit application, dated September 13, 2013, to Florida Department of Environmental Protection ("Department"). On September 25, 2013, TEC and Department met to discuss the air permit application and the proposed revisions. The Department indicated concerns with some of the proposed revisions. On October 7, 2013, TEC submitted a follow-up response clarifying and justifying the potential issues discussed with the Department. On November 1, 2013 the Department issued a request for additional information ("RAI"). On November 26, 2013, TEC submitted a follow-up response to the Department.

On December 3, 2013, the Department and TEC conducted another meeting to discuss the RAI response. On December 12, 2013, the Department issued another RAI ("RAI No.2") based on additional questions raised during the meeting. TEC's responses to RAI No.2 are discussed below.

FDEP Comment 1

*Determination of Heat Input: **Conditions A.54. and B.54.** require that composite fuel samples be collected by on-site personnel in accordance with ASTM standards to determine heat input. The application requests that the required fuel sample be collected according to Tampa Electric Company's (TEC) industry standard practices. Please provide documentation of TEC industry standard practices, typically accepted ASTM standards and explain why an alternative method is needed.*

TEC Response 1

Coal Sampling Procedure



April 17, 2014

Jeffery F. Koerner, Program Administrator
Florida Department of Environmental Protection
Division of Air Resource Management
Office of Air Permitting and Compliance
2600 Blair Stone Road, M.S. 5505
Tallahassee, Florida 32399-2400

Via E-Mail Notification
Jeff.Koerner@dep.state.fl.us

**RE: Tampa Electric Company - Big Bend Station
Request for Information Response No. 2
J3 Conveyor System, Unit 3 Furnace & ESP Enhancements,
and Permit Cleanup Modifications
Proposed Permit Nos. 0570039-066-AC/0570039-067-AV
Facility ID No. 0570039**

Dear Mr. Koerner:

Tampa Electric Company ("TEC") submitted a permit application, dated September 13, 2013, to Florida Department of Environmental Protection ("Department"). On September 25, 2013, TEC and Department met to discuss the air permit application and the proposed revisions. The Department indicated concerns with some of the proposed revisions. On October 7, 2013, TEC submitted a follow-up response clarifying and justifying the potential issues discussed with the Department. On November 1, 2013 the Department issued a request for additional information ("RAI"). On November 26, 2013, TEC submitted a follow-up response to the Department.

On December 3, 2013, the Department and TEC conducted another meeting to discuss the RAI response. On December 12, 2013, the Department issued another RAI ("RAI No.2") based on additional questions raised during the meeting. TEC's responses to RAI No.2 are discussed below.

FDEP Comment 1

*Determination of Heat Input: **Conditions A.54. and B.54.** require that composite fuel samples be collected by on-site personnel in accordance with ASTM standards to determine heat input. The application requests that the required fuel sample be collected according to Tampa Electric Company's (TEC) industry standard practices. Please provide documentation of TEC industry standard practices, typically accepted ASTM standards and explain why an alternative method is needed.*

TEC Response 1

Coal Sampling Procedure

The current sampling procedure involves collecting a coal sample every 5 minutes during the bunkering process. A sample volume of approximately 5 gallons is collected during each daily bunkering event. The sample is placed in a pulverizer and ground to 8 mesh and then placed in a coal riffler to thoroughly mix and reduce the sample size to approximately 3,000 grams. The sample is then placed in a secondary pulverizer and ground to 60 mesh, then passed through a secondary riffler to thoroughly mix and then take a 100 gram aliquot. The procedure is repeated for each daily sample throughout the week for a total of seven (7) daily composite samples. The weekly sampling starts at 1500 hours Sunday and ends at 1500 hours on the following Sunday.

TEC's laboratory, a NELAP certified laboratory, prepares the weekly composite samples for analysis. The weekly composite sample is prepared from the 7 daily composite samples based on the daily mass fraction of the coal burned during the week. For example, if all daily amounts were equally burned during the week, then equal portions, or 15 grams from each of 7 daily composite samples, are used to make up the 105 grams weekly composite sample. The laboratory analyses are performed on the weekly composite sample to determine the residual moisture, total moisture, heat content, sulfur content and trace metals. The weekly heat input analysis is applied to the daily amount of coal burned to determine each unit's daily heat input.

The same procedure is repeated to determine the monthly heat input. The monthly composite sample is prepared from the 4 weekly composite samples based on the weekly mass contribution of coal burned during the month. The heat input analysis is applied to the monthly coal burned to determine the monthly heat input. This data represents the official heat input that is submitted to the Florida Public Service Commission (FPSC).

TEC and ASTM Gross Coal Sampling Procedures

The coal processing rates and composite analytical data are used to report the monthly heat input. The monthly heat input and gross power generation data are used to calculate the gross unit heat rates of each boiler. The heat input data, unit heat rate data and other process data are recorded in the Generation, Fuel and Performance (GFP) Report. The heat input during stack testing is calculated as the product of the 3-month average heat rate (Btu/kWh) and gross power output (MW) during the test.

The sample frequency and sizes of the TEC and ASTM gross sampling procedures were evaluated. The evaluation shows both methods have similar sampling techniques, but the frequency and sample size varied appreciably. On average, approximately 1,800 tons is bunkered to each unit on a daily basis. At a sample rate of every 5 minutes, approximately 15 samples are collected during the daily bunking process. This is equivalent to 3 lbs per sample or total daily sample of 45 lbs. If the ASTM Method 2234 protocol is applied to the TEC process, a minimum of 20 samples and 6 lbs. per sample would be required during the same daily bunker process. This is equivalent to a total daily sample of 120 lbs. Although the frequency and sample size varied, TEC's current sampling procedure is reasonably consistent with the ASTM method. A summary of the method variations is shown in Table 1.

Table 1. Comparison of the TEC and ASTM Gross Coal Sampling Procedures

Description	Fuel Sampling Procedure	
	TEC	ASTM 2234
Sampling Time	Every 5 minutes	Not Specified
Lot Size Criteria	Not Specified	$\leq 1,000$ tons $> 1,000$ tons 1,000 ton increments or total tons combined
Gross Sample Criteria	Not Specified	$\leq 1,000$ tons 15 samples $> 1,000$ tons 15 samples per 1,000 ton or No. Samples = $15 * (\text{Lot Size} / 1,000)^{0.5}$
Sample Size Criteria	Not Specified	6 lbs.
No. Gross Samples (Lot Size 1,800 tons)	15 samples	20 samples
Sample Size (Lot Size 1,800 tons)	≈ 3.5 lbs./sample	6 lbs./sample
Total Sample Size (Lot Size 1,800 tons)	≈ 50 lbs.	120 lbs.

Evaluation of the Monthly Input Data

ASME Standard PTC-4.1 Power Test Code for Steam Generating Units (boiler efficiency method) was used to evaluate the monthly heat input in the GFP Report. This standard is considered the most accurate methodology to calculate the gross heat input on electric steam generating units. ASME Standard PTC-4.1 was used to calculate monthly heat input rates to compare the TEC's monthly heat input rates. A statistical analysis was also conducted to evaluate variance of the both methods.

The evaluation shows the monthly heat input compares favorably with the boiler efficiency method. The data showed the monthly average and the standard deviation were in good agreement with each other. The monthly heat input showed an average of $2,111,233 \pm 632,047$ mmBtu. The boiler efficiency method showed an average of $2,032,812 \pm 669,160$ mmBtu. On average, both methods were within approximately 4% of each other.

A t-test statistical analysis was also conducted to determine the relative variance between the monthly heat input and boiler efficiency method. The results show TEC's monthly heat input and the boiler efficiency calculated heat input are statistically equivalent at the 95% confidence interval ($t > t'$). The analysis indicates that the variance of the frequency and sample size are not statistically significant. Therefore, the data shows that the current sampling protocol is an accurate means to monitor the heat input and provides reasonable assurance pursuant to Chapter 62-4.070 F.A.C. A summary of the data and statistical analysis are included in Attachment 1.

FDEP Comment 2

***VE Testing:** The application requests that the testing requirements for EU Nos. 008, 009, 012 – 017, 020 - 023, 029, 030, 033, 034 and 037 - 039 be revised to not require a visible emissions (VE) test annually and/or prior to renewal if the emissions unit operated for less than 400 hours during the previous calendar year. Pursuant to Rule 62-296.711, F.A.C. (Materials Handling, Sizing, Screening, Crushing and Grinding Operations), the annual VE test is allowed in lieu of performing a particulate matter (PM) stack test. Please provide the following information to determine if these emission units are subject to the PM RACT rule:*

- a. Please identify the emission units that TEC believes meet the PM RACT rule exemption pursuant to Rule 62-296.700(1)(b)(2)(f)., F.A.C.*
- b. Diagrams were submitted with TEC response to the initial RAI. Please provide the following information needed to fully understand the process:*
 - (1) Emission units that are associated with the diagrams, engineering drawings or pictures;*
 - (2) PM control devices, enclosed conveyors and drop points, vents and/or emission points;*
 - (3) Designs, descriptions, photos, etc. can also be provided in order to determine if the enclosures contain vents or are completely enclosed with no emission points; and*
 - (4) Please identify if any of the currently regulated storage silos or bins have a storage capacity of less than 50 cubic yards.*

TEC Response 2a

Table 2 summarizes the visible emission summary and PM RACT Applicability. EU-010, EU-047 and EU-020 operate in enclosed buildings or totally enclosed conveyors and transfer points. These activities are not considered air emission sources with these engineering controls. EU-011 is an unconfined activity that consists of movable transfer points during unloading, which is specifically exempt pursuant to Rules 62-296.700(2)(d) and 62-296.700(2)(f) F.A.C. EU-025 and EU-026 are unconfined emissions sources that are exempt pursuant to Rule 62-296.700(2)(d) F.A.C. The remaining emission units with vents from rotoclones and baghouses are subject to the PM RACT requirements.

Table 2. VE Test Summary and PM RACT Applicability

EU	Brief Description	VE Test Point	PM RACT Applicability
<i>Solid Fuel Yard</i>			
-010	Solid Fuel Yard Fugitive Emissions	5 confined sources	Exempt, Totally Enclosed
-029	Fuel Blending Bin Cyclone Collectors (FH-032 to FH-035)	4 rotoclones	Not Exempt
-030	Fuel Mill Cyclone Collectors (FH-048 and FH-049)	2 rotoclones	Not Exempt
-047	Railcar Unloading and Conveying System	Unloading Blg Vent	Exempt, Enclosed Building
<i>Coal Bunkers with Roto-Clones</i>			
-015	Unit No. 1 Coal Bunker with Roto-Clone	Unit 1 rotoclone	Not Exempt
-016	Unit No. 2 Coal Bunker with Roto-Clone	Unit 2 rotoclone	Not Exempt
-017	Unit No. 3 Coal Bunker with Roto-Clone	Unit 3 rotoclone	Not Exempt

-039	Unit No. 4 Coal Bunker with Roto-Clone	Unit 4 rotocloner	Not Exempt
<i>Flyash Handling and Storage - Silo Nos. 1 & 2</i>			
-008	Fly Ash Silo No. 1 Baghouse	Baghouse vent	Not Exempt
-009	Fly Ash Silo No. 2 Baghouse	Baghouse vent	Not Exempt
-026	Fly Ash Handling and Storage Fugitive Emissions		Exempt, unconfined emissions
<i>Flyash Handling and Storage - Silo No. 3</i>			
-014	Fly Ash Silo No. 3 Baghouse	Baghouse vent	Not Exempt
<i>Limestone Handling and Storage</i>			
-011	Truck Limestone Unloading Receiving Hopper	Unloading	Exempt, unconfined emissions/moving drop point
-012	Limestone Silo A with 2 Baghouses	2 Baghouse vents	Not Exempt
-013	Limestone Silo B with 2 Baghouses	2 Baghouse vents	Not Exempt
-023	Limestone Handling LB to Conveyor LC with Baghouse	Baghouse vent	Not Exempt
-023	Limestone Handling LD to Conveyor LE with Baghouse	Baghouse vent	Not Exempt
-025	Limestone Storage and Handling Fugitive Emissions		Exempt, unconfined emissions
<i>Limestone Handling for FGD System for Units 1 & 2</i>			
-020	Drops from Limestone Conveyors LE, LF and LG and Silo C	3 Drop points	Exempt, Totally Enclosed
-021	Silo C with one Baghouse	Baghouse vent	Not Exempt
<i>Wastewater Treatment Plant</i>			
-022	Lime Silo for Wastewater Treatment Plant with one Baghouse	Baghouse vent	Not Exempt
<i>Abrasive Blasting</i>			
-033	Abrasive Blast Booth with Baghouse	Baghouse vent	Activity discontinued
-034	Abrasive Blast Media Storage with Baghouse	Baghouse vent	Activity discontinued
<i>Coal Residual Storage and Transfer from the Polk Power Station</i>			
-037	Coal Residual Storage Facility	Loading	Exempt, Enclosed Building
-038	Coal Residual Transfer System	Loading	Exempt, Enclosed Conveyor

TEC Response 2b,1-4

All of the conveyors throughout Big Bend Station are enclosed. The transfer towers and drop points at all conveyors are totally enclosed. The exemptions are conveyors F and P in the coal yard area. These belt conveyors are not enclosed because these conveyors feed the stacker/reclaimer units. Photographs and process flow diagrams of these emissions units in the coal yard, railcar unloading and limestone conveying systems are shown in Attachment 2.

Coal Yard Conveyance System

Coal is unloaded from barges at TEC's dock area. The Dravo or PECO clam shell is used to unload the coal from each barge. The coal is transferred from the dock area to the coal yard

through conveyors D and E. Coal is transferred to the north side of the coal yard using conveyors Z and P and the north stacker/reclaimer or transferred to the south side of the coal yard using conveyor F and the south stacker/reclaimer. Coal is transferred to each unit bunker and fuel blending system using conveyor J, Q, T, W and L. Process flow diagrams of the Coal Yard Conveyance System are shown in Attachment 2.

Railcar Unloading System

Coal is unloaded into hoppers in the rail house building where it is treated with a water/chemical surfactant mixture. The coal is conveyed through a series of conveyors (C10, C-11, C-12, C-13, C-14, C15, and C-16) to the coal yard. Coal is conveyed into the coal yard through transfer structures TS15 and TS16 and existing conveyors P and F. Process flow diagrams of the railcar unloading system are shown in Attachment 2.

Fuel Bunkers and Blending Bins

The facility contains four (4) rotoclones (EU-015, EU -016, EU-017, and EU 039) are located in the common headspace of the coal bunker building, which is totally enclosed. The facility also contains four (4) rotoclones in the fuel bunkering building (FH-032 through FH-035) that share a common headspace. In all cases, the purpose of the rotoclones is to maintain a safe working environment inside the building enclosure and not intended as an air pollutant control device. Process flow diagrams of the Fuel Bunkers and Blending Bins are shown in Attachment 2.

Limestone Handling System

Limestone is received by truck and conveyed to the limestone storage building. From the storage building, the limestone is reclaimed and conveyed to the limestone silos A, B and/or C. Particulate matter emissions generated by the transfer of limestone from handling conveyors LB to LC at transfer tower LL1 are controlled by a baghouse. Particulate matter emissions generated by the transfer of limestone from handling conveyors LD to LE are controlled by a baghouse at transfer tower LL2. Particulate matter emissions from transfer points in conveyors LE, LF and LG and the silo C belt feeder are controlled by a baghouse. Particulate matter emissions from displaced air in silo C are also controlled by an additional baghouse. All conveyors LB, LC, LD, LE, LF and LG are enclosed. The transfer points at conveyors LB and LC and at conveyors LE, LF and LG are totally enclosed. Process flow diagrams of the Limestone Handling System are shown in Attachment 2.

FDEP Comment 3

SO₂ SIP Limits and Quarterly Report: *As discussed, Rule 62-213.440(1), F.A.C. provides an option for the applicant to propose new single allowable emissions limit that ensures compliance with each of the separate multiple applicable SO₂ emission limits. If TEC would like to pursue this option, please provide the appropriate data supporting the proposed new SO₂ emission limit as well as a compliance method determination.*

TEC Response 3

The purpose of this request is to reduce the substantial reporting burden with regard to data that are based on obsolete requirements and are no longer of environmental benefit. The SO₂ limits in Condition A.19 were evaluated during the period 2009 to 2013. The data shows the averages

were well below the 6.5 lb/mmBtu, 31.5 tons per hour and the daily 25 tons per hour SO₂ thresholds. The data revealed the peak maximum emission rates were well below the SO₂ emission thresholds. The data also showed the 0.25 lb/mmBtu limit on a 30 day rolling average is a more stringent standard than the SO₂ thresholds in Condition A.19 due to the stricter limit (0.25 lb/mmBtu) that has been imposed. Furthermore, each unit is fully scrubbed and cannot bypass at this time. Typically, the targeted fuel into each boiler is maintained around 4.7 lb/mmBtu SO₂. Therefore, TEC believes utilizing the 0.25 lb/mmBtu, 30 day rolling average provides reasonable assurance of meeting criteria pursuant to Rule 62-213.440(1) F.A.C. A summary of the historical emission rates is shown in Table 3. The SO₂ data and supporting calculations are included in Attachment 3.

Table 3. Evaluation of the Condition A.19 SIP Thresholds.

Parameters Condition A.19, SO ₂ SIP limits	Unit 1	Unit 2	Unit 3
2 hr limit, 6.5 lb mmBtu - Units 1, 2 or 3 (peak)	0.17 (2.6)	0.16 (2.6)	0.13 (1.84)
3 hr limit, 31.5 tph – Units 1 to 3 (peak)	1.5 (9.2)		
24 hr limit, 25 tph – Units 1 to 3 (peak)	0.70(1.8)		
24 hr limit, 16.5 tph - Units 1 & 2/8.5 tph – Unit 3 (peak)	0.50 (1.40)	0.50 (1.40)	0.27 (0.77)
0.25 lb mmBtu 30 day average – Units 1, 2, or 3 (peak)	0.17 (0.24)	0.17 (0.24)	0.13 (0.21)

FDEP Comment 4

Abrasive Blasting Operations: Baghouses associated with the blasting booth and storage area identified in the Title V air operation permit existed in 2003 according to Hillsborough County Environmental Protection Commission site inspection report. Please provide documentation (e.g., pictures, work orders, etc.) that show the baghouses were removed and/or complete enclosure of the work activity.

TEC Response 4

Former Abrasive Blasting operation (EU-033 and EU-034)

Subsection J, Abrasive Blasting (EU-033 and EU-034) in permit 0570039-061-AV specifies the particulate matter emissions from the abrasive blast booth are controlled by a Torit Model No. DFT 4-16 pulse jet baghouse with an inlet flow rate of 7,500 acfm. The permit also indicates the abrasive blast media storage are controlled by a pulse jet baghouse with an inlet air flow rate of 800 acfm.

On February 28, 2003, the Environmental Protection Commission (EPC) conducted an onsite inspection of the abrasive blasting facility. In an inspection report, dated April 27, 2003, the EPC reported a Torit Model No. DFT 4-16 with an inlet flow rate of 7,500 acfm is used to control particulate emissions from the abrasive blast booth. PM emissions from the abrasive blast media storage were controlled by a pulse jet baghouse with an inlet airflow rate of 800 dscfm. The report also indicated all operations at EU-033 and EU-034 ceased operation after January 1, 2001.

On December 18, 2013, a field site visit of the abrasive blasting facility was conducted. The site visit revealed the abrasive blasting facility (EU-033 and EU-034) was dismantled and no longer

in operation. The abrasive blasting equipment and former baghouse were not observed on-site. The former facility buildings are currently utilized for miscellaneous storage at this time.

Based on discussions with Big Bend staff, the abrasive blasting operation was operated by GC Services Inc. The facility terminated operation after 2000 and the equipment was dismantled and removed. Therefore, since emission units are no longer in operation, TEC requests the removal of the subsection J, including regulated emission units EU-033 and EU-034, from the current Title V. Photographs of the former buildings are included in Attachment 4.

Existing Abrasive Blasting Operation

TEC's contractor currently operates an abrasive blasting booth and storage area to prepare miscellaneous surfaces for painting and coating applications. This facility consists of a metal building enclosure with two large drapes on the both sides and a material storage area. This facility does not contain a baghouse to control fugitive emission in the enclosure. The metal enclosure serves to contain the fugitive emissions to the blasting area. During the field visit no baghouses were observed to be associated with this process. An electric driven compressor and air receiving system were observed on-site. The diesel compressor indicated in Subsection J was not observed onsite.

The metal enclosure contains vents near the roof of the building (see photographs). The vent is located toward the roof area and constructed of a mesh screen and louvers. The vent is shown as a natural draft or passive vent to release heat from the enclosure. This vent is not considered a source of emissions like a large vent or a force draft type equipped with a fan. TEC believes this vent is not a source of emissions.

The current abrasive blasting activity is not subject to the PM RACT Rule. This activity does not meet the applicable requirements of Rules 62-296.701 through 62-296.712, F.A.C., or Rules 62-296.401 through 62-296.415, F.A.C. This activity is considered an unconfined emission unit pursuant to Rule 62-210 (316) F.A.C. As such, the emission unit is exempt from the PM RACT Rule pursuant Rule 62-296.700(2)(d) F.A.C. and Chapter 1-3.52, Rules of the Environmental Protection Commission (EPC) of Hillsborough County. Furthermore, this activity is not subject to any "unit specific requirement," but is subject to the general opacity requirement of Rule 62-296.320(4) (b)1. F.A.C.

TEC performed a series of emission calculations to estimate PM, PM₁₀ and PM_{2.5} emissions from the abrasive blasting activity. AP-42 procedure, Chapter 13.2.6 Abrasive Blasting, was used to estimate the fugitive air emissions for this activity. Tables 4 and 5 show the PM and HAP emissions for the abrasive blasting activity. The calculations show the total PM emissions rate is below the 5 tons/yr threshold. The calculations also show the PM₁₀ and PM_{2.5} emissions are substantially below the significant emission thresholds. Table 5 also shows the total HAPs, individual HAP and lead emissions are also below the 500 lb/yr for lead, 1,000 lb/hr for single HAP, and 2,500 lb/yr for total HAPS. As a result, TEC believes this activity qualifies as an insignificant emission activity pursuant to Rule 62-213.430(6), F.A.C. A summary of the emission calculations and MSDS are shown in Attachment 4.

Table 4 – Summary of Proposed PM Emissions.

Description	Total PM ¹ Emissions	PM ₁₀ Emissions	PM _{2.5} Emissions
Abrasive Blasting (tons/yr) (maximum 120,000 tons blast material)	1.6	0.78	0.078

Table 5 – Summary of Proposed HAP Emissions.

Pollutant	Limit	Emissions (tons/yr)
Lead Emissions (<500 lbs/yr)	500	0.0
Single HAP Emissions (<1000 lbs/yr)	1,000	1.6
Total Combined HAP Emissions (<2,500 lbs/yr)	2,500	1.6

FDEP Comment 5

*Nitrogen Oxides (NO_x) Emission Limits: The application requests removal of NO_x emission limits in **Condition O.8.** for SCCT 4A and 4B (EU 041 and EU 042). Air Construction Permit No. 0570039-040-AC established these limits at TEC's request for purposes of escaping Prevention of Significant Deterioration (PSD) new source review requirements. However, the requested changes would not significantly affect the PSD analysis submitted at the time of the original application. As such, the Department will consider revising the original construction permit to reflect the NO_x emissions limitations established in 40 CFR 60, Subpart KKKK. Please provide the mass emissions rates (lb/hour and tons/year) for these units that are equivalent to the NSPS concentration limits.*

TEC Response 5

TEC is requesting a revision to the existing NO_x limit when firing on ultra-low sulfur diesel (ULSD). The current permit specifies a NO_x limitation of 42 ppmvd NO_x @15% O₂. This limit was based on a vendor guarantee, which was considered typical for most combustion turbines firing on ULSD. However, the simple-cycle combustion turbines (SCCTs) were not subject to BACT requirements due the NO_x emission PSD netting credits from the previous combustion turbines CT-1, CT-2, and CT-3. The NO_x limit should be revised to the NSPS limit of 74 ppmdv NO_x @15% O₂ to reconcile this permitting oversight. Furthermore, the SCCTs are not being physically modified and therefore this permit modification will not result in an increase in actual emissions.

The previous application permitted the SCCTs to fire both natural gas and ULSD. The units are permitted to operate up to 3,000 hours on natural gas and 500 hours on ULSD. The potential to emit emissions for both simple-cycle combustion turbines (SCCT) were calculated at 122.4 NO_x tons/yr in the original application. The baseline actual NO_x emissions for period June 2000 – May 2002 was 545.2 NO_x tons/yr. This resulted in a net of credit of -422.7 NO_x tons/yr.

The PSD application was recalculated using the NSPS NO_x limit of 74 ppmvd NO_x @15% O₂. The units were calculated to operate up to 3,000 hours on natural gas and 500 hours on ULSD. The potential to emit emissions for both SCCT were calculated at 141.2 NO_x tons/yr. The

¹ Based on the PM emission factor at 5 mph

baseline actual NOx emissions for period June 2000 – May 2002 remained at 545.2 NOx tons/yr. The recalculated net of credit of -404.0 NOx tons/yr. This results in a net increase in 19.5 tons/yr NOx emissions., which is well below the significant emission thresholds for NOx. A summary of the revised emissions are shown in Tables 6 - 8. A summary of the NOx emission rate calculations are shown in Attachment 5.

Table 6. Revised NOx Mass Emissions Rates.

Source	Case	No CTs	Annual Operations	NOx Emission Rates	
				(lb/hr)	(tpy)
Unit 4	4-gas	2	3,000	64	96
Unit 4	4-oil	2	500	180.8	45.2
		Totals	3,500	N/A	141.2

Table 7. Revised PSD Applicability Analysis.

Pollutant	Previous Potential to Emit Emissions (tpy)	Revised Potential to Emit Emissions (tpy)	Net Change in Emissions (tpy)	PSD Significant Emission Rate (tpy)	PSD Applicability
NOx	121.7	141.2	19.5	40	No

Table 8. Revised NOx Netting Analysis

Pollutant	Baseline Actual Emissions (tpy)	Potential to Emit Emissions (tpy)	Net Change in Emissions (tpy)	PSD Significant Emission Rate (tpy)	PSD Applicability
NOx	545.2	141.2	-404.0	40	No

FDEP Comment 6

*Solid Fuel Yard Permitted Capacity: **Condition R.1.** limits the maximum unloading/transfer rate from the rail car unloading operation to 4,000 tons/hour on a 24-hour rolling average. Additional changes requested in the TEC response to the initial RAI included removing the 24-hour rolling average. The request appears to make this condition more restrictive. Please confirm this is an accurate description of the request.*

TEC Response 6

Condition R.1 currently limits the maximum unloading/transfer rate from the railcar unloading operation to 4,000 tons/hour on a 24-hour rolling average. The total amount of coal unloaded (tons) during each unloading event is recorded. TEC requests to revise the condition to reflect a unloading rate on a “daily average” rather than a “24-hour rolling average.” The condition should be revised as follows:

Essential Potential to Emit (PTE) Parameters

Mr. Jeffery F. Koerner
April 17, 2014
Page 11 of 11

R. 1 Permitted Capacity. The maximum unloading rate is 4,000 tons per hour (**24-hour rolling average**). The maximum annual transfer for the railcar unloading operations is 8,000,000 tons per year. [Rule 62-210.200(PTE), F.A.C. and Permit No. 0570039-066-AC-0570039-041-AC]

Please review technical justifications and contact me at (813) 228-4232, if you have any questions.

Sincerely,

A handwritten signature in black ink, appearing to read "Robert Velasco". The signature is fluid and cursive, with the first name "Robert" and last name "Velasco" clearly distinguishable.

Robert A. Velasco, P.E., BCEE, QEP
Air Programs
Environmental, Health & Safety
Tampa Electric Company

EHS/iyw/RAV228 J3 BB3 ESP permit cleanup RAI No.2 ltr

cc. Tammy.McWade@dep.state.fl.us

ATTACHMENT 1
Data and Statistical Analysis

Test Statistical Comparion fo the Boil Efficiency Method and Fuel Monitoring

Emission Unit		Boiler Efficiency Method (BE)		GFP
Average		2,023,812		2,111,233
Stand Deviation		669,160		632,047
Sample Variance (S ²)		447,774,767,678		399,482,994,380
Jan-10	BB 1		BB 1	
Feb-10	BB 1		BB 1	
Mar-10	BB 1	237,384	BB 1	504,306
Apr-10	BB 1	1,635,958	BB 1	1,840,022
May-10	BB 1	2,156,474	BB 1	2,452,259
Jun-10	BB 1	1,888,175	BB 1	2,061,061
Jul-10	BB 1	2,485,708	BB 1	2,686,180
Aug-10	BB 1	2,374,306	BB 1	2,508,425
Sep-10	BB 1	1,089,466	BB 1	1,209,073
Oct-10	BB 1	1,843,993	BB 1	2,046,815
Nov-10	BB 1	2,354,993	BB 1	2,575,066
Dec-10	BB 1	2,105,969	BB 1	2,356,547
Jan-10	BB 2	1,311,153	BB 2	1,447,900
Feb-10	BB 2	889,334	BB 2	994,709
Mar-10	BB 2	2,120,819	BB 2	2,384,875
Apr-10	BB 2	1,359,052	BB 2	1,548,893
May-10	BB 2	1,522,685	BB 2	1,680,276
Jun-10	BB 2	2,397,794	BB 2	2,648,181
Jul-10	BB 2	2,220,650	BB 2	2,394,039
Aug-10	BB 2	1,886,267	BB 2	2,123,642
Sep-10	BB 2	1,292,311	BB 2	1,465,243
Oct-10	BB 2	1,174,459	BB 2	1,314,703
Nov-10	BB 2	1,480,295	BB 2	1,672,741
Dec-10	BB 2	2,428,748	BB 2	2,686,487
Jan-10	BB 3	1,051,588	BB 3	1,004,193
Feb-10	BB 3	2,309,186	BB 3	2,370,455
Mar-10	BB 3	2,111,835	BB 3	2,145,202
Apr-10	BB 3	2,606,687	BB 3	2,595,952
May-10	BB 3	2,757,653	BB 3	2,761,394
Jun-10	BB 3	2,643,928	BB 3	2,688,847
Jul-10	BB 3	2,485,896	BB 3	2,508,947
Aug-10	BB 3	2,340,294	BB 3	2,327,323
Sep-10	BB 3	2,794,248	BB 3	2,640,673
Oct-10	BB 3	565,042	BB 3	543,853
Nov-10	BB 3	1,718,687	BB 3	1,801,165
Dec-10	BB 3	2,337,015	BB 3	2,358,749
Jan-10	BB 4	3,066,963	BB 4	3,071,575
Feb-10	BB 4	2,732,959	BB 4	2,735,484
Mar-10	BB 4	2,245,862	BB 4	2,213,558
Apr-10	BB 4		BB 4	
May-10	BB 4		BB 4	
Jun-10	BB 4	1,412,185	BB 4	1,409,924

Test Statistical Comparion fo the Boil Efficiency Method and Fuel Monitoring


Emission Unit		Boiler Efficiency Method (BE)		GFP
Average		2,023,812		2,111,233
Stand Deviation		669,160		632,047
Sample Variance (S ²)		447,774,767,678		399,482,994,380
Jul-10	BB 4	2,675,734	BB 4	2,509,697
Aug-10	BB 4	2,195,997	BB 4	2,104,679
Sep-10	BB 4	2,364,125	BB 4	2,389,332
Oct-10	BB 4	3,105,102	BB 4	2,927,917
Nov-10	BB 4	2,837,909	BB 4	2,751,047
Dec-10	BB 4	2,432,840	BB 4	2,432,840
<i>n</i>		44		44
Pooled Estimate (Sp)	Test Statistic (t)	t'	Degrees of Freedom	Are these distributions different? (t>t')?
650868	0.630	1.68	86	NO

ATTACHMENT 2
Site Photographs
Process Flow Diagrams

Response to question 2 - Bunkering Rotoclones



Response to question 2- Fuel Blending Bins Rotoclones

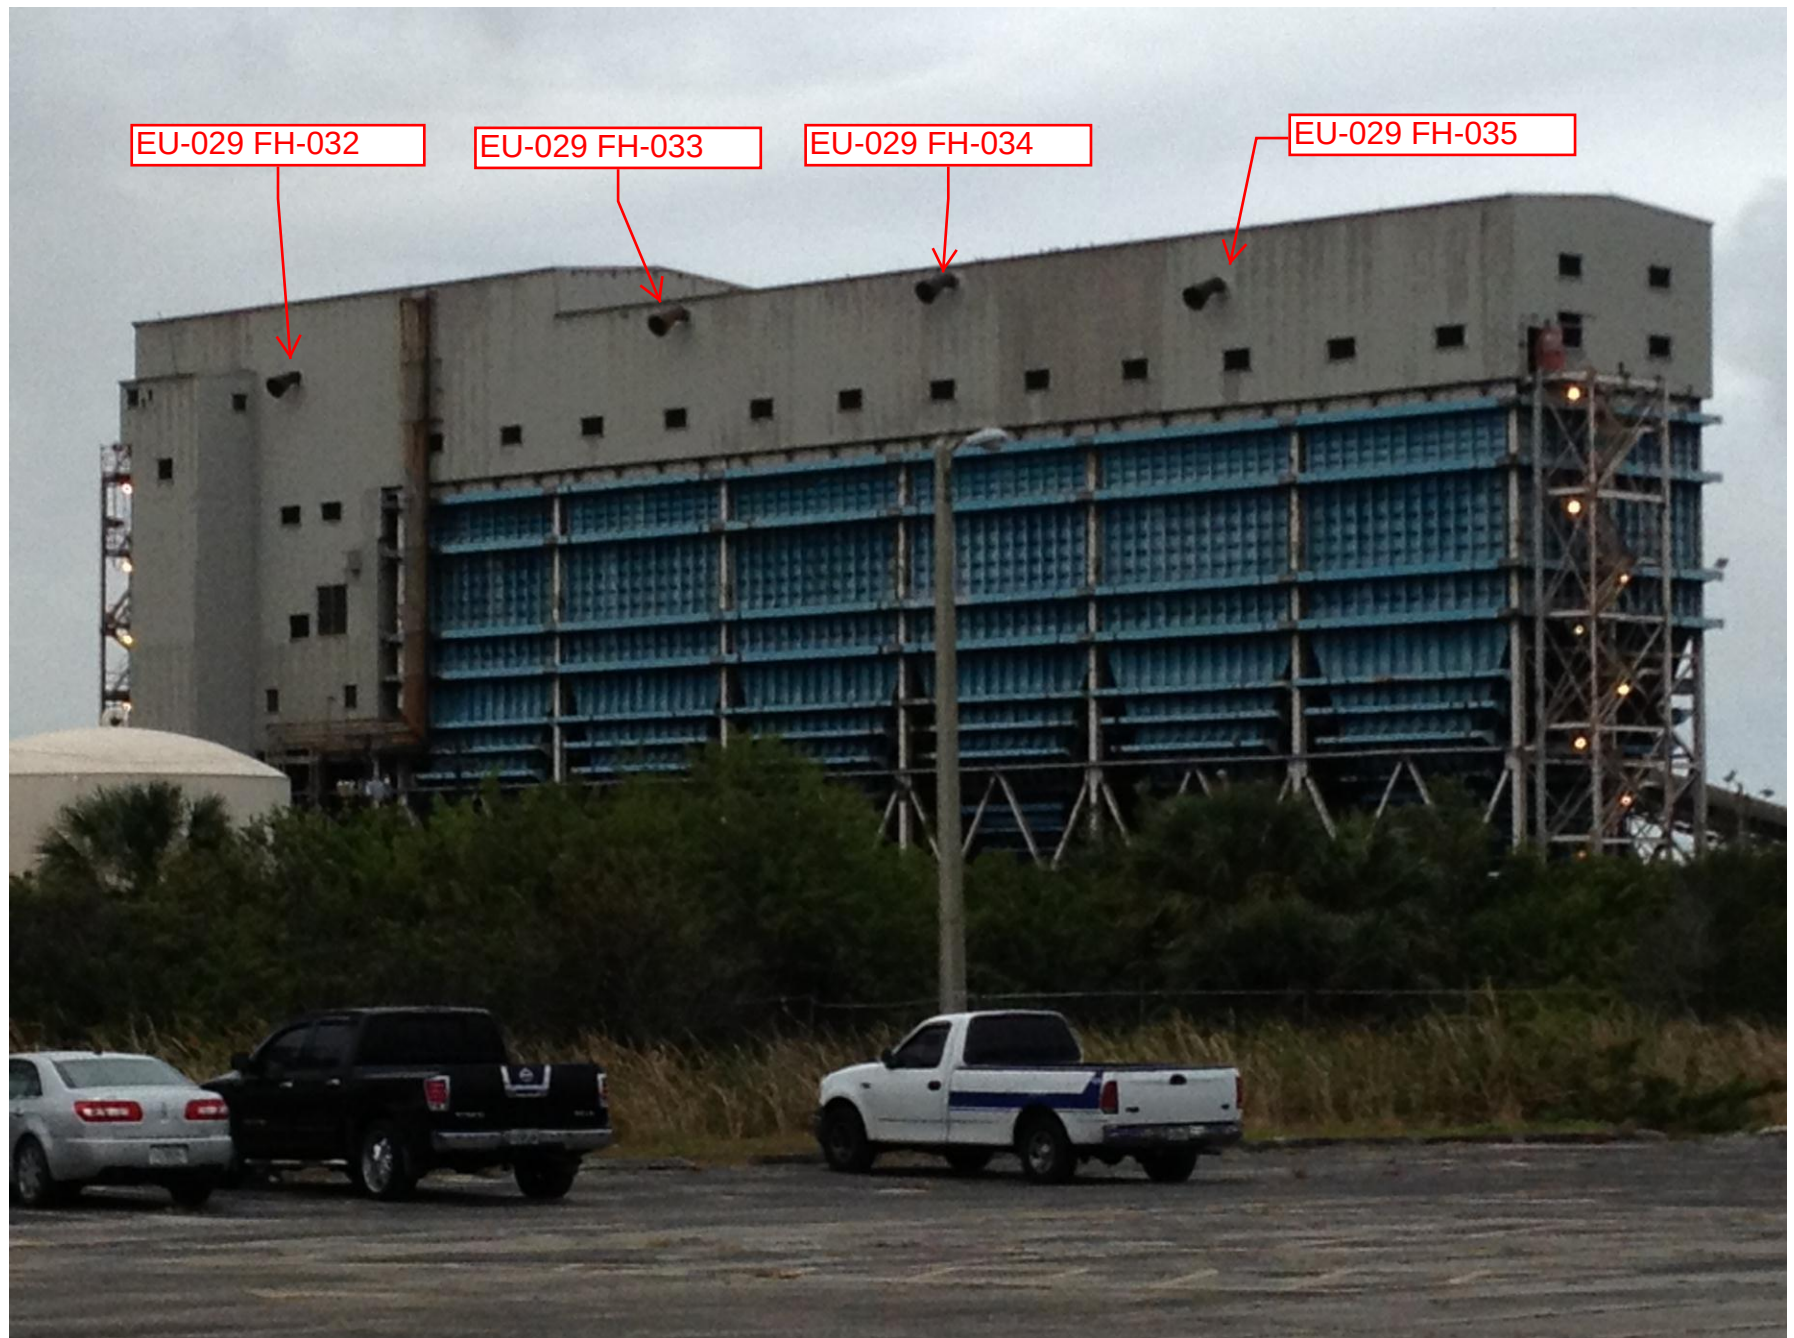







Response to question 2 - P conveyor (uncovered)(EU-010: FH-022)



Response to question 2 - T conveyors (covered) typ E J Q W L Q
conveyors (EU-010)






Response to question 2 - Rail Unloading conveyor C12 typ C10 C11
C14 C15 C16 (EU-047)







Response to question 2 - Transfer LL1 with Baghouse
(EU-023)

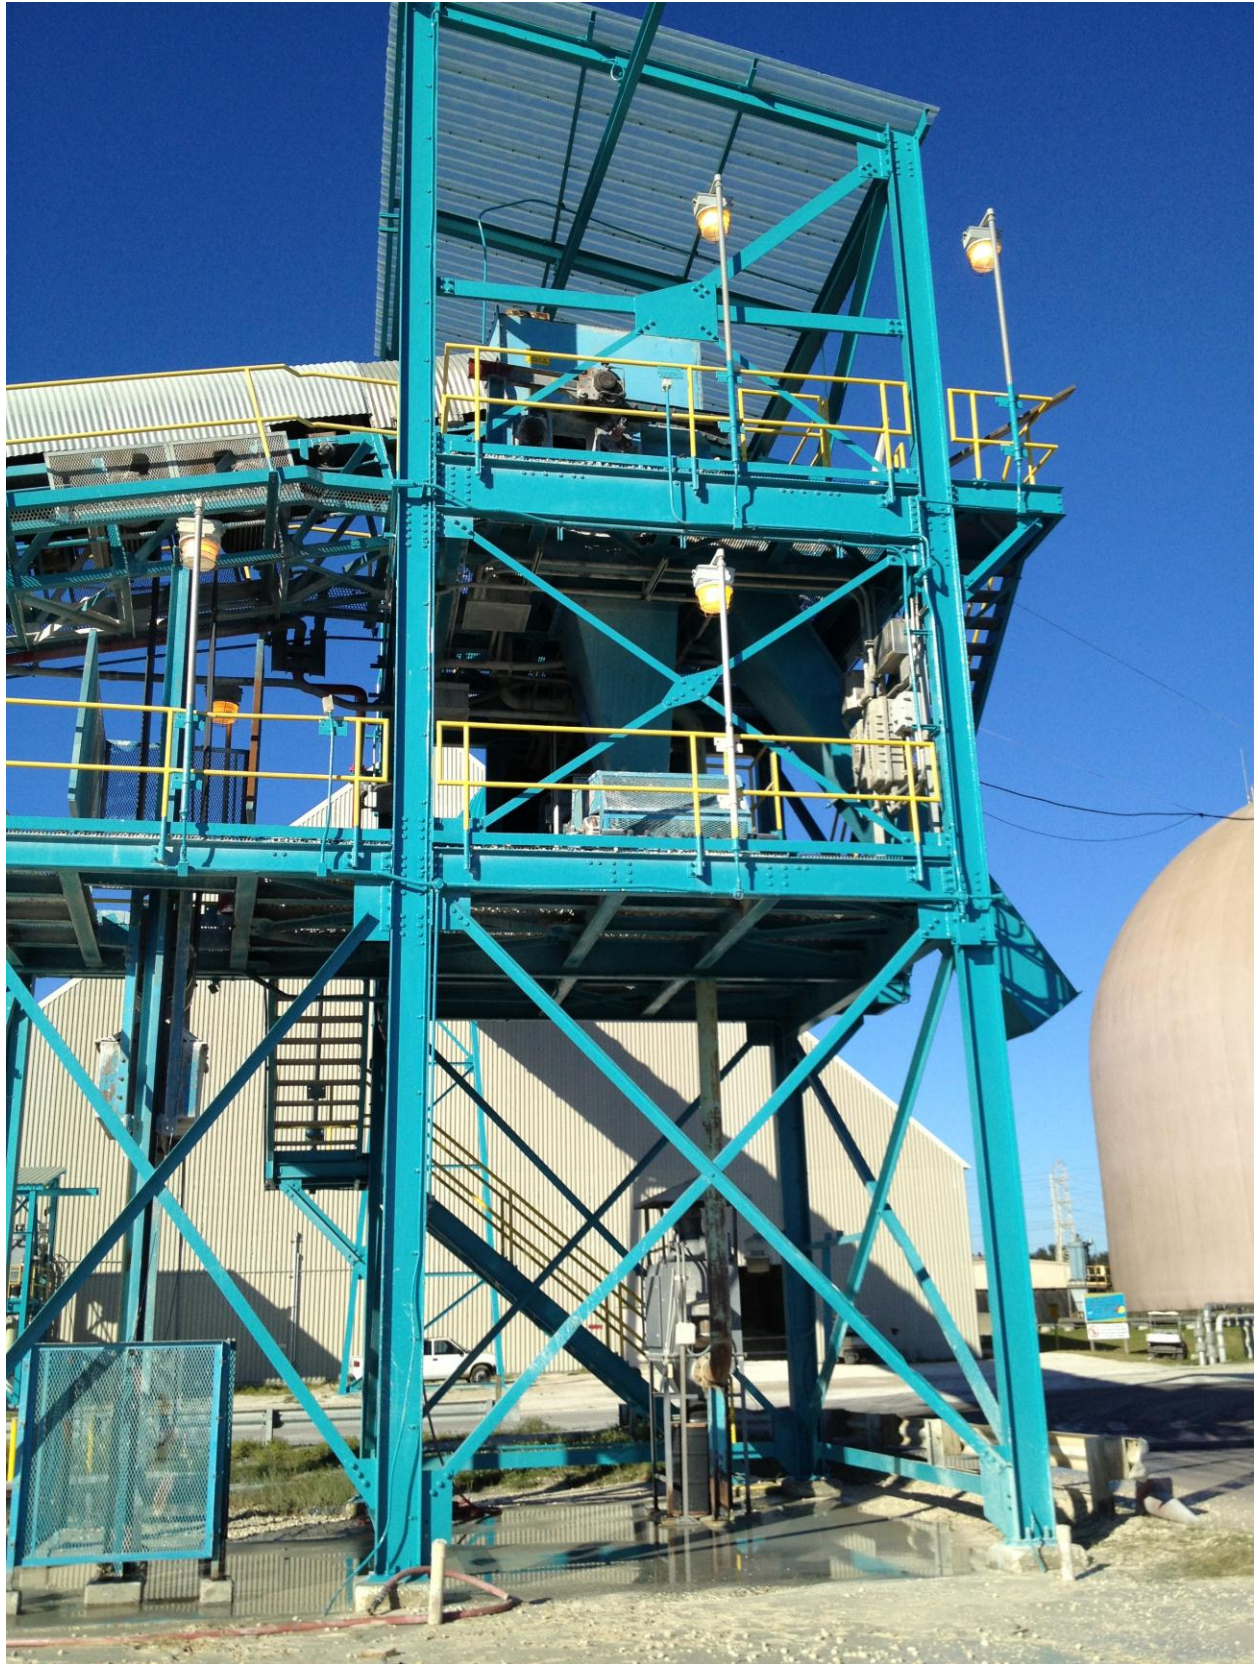




Response to question 2 - LE LF LG conveyor with
Baghouses (EU-012, EU-013, EU-020, EU-021)



Response to question 2 - Rail Unloading Transfer TS 11 typ TS 10 12 13
14 15 16 (EU-047)




BIG BEND CONVEYOR SYSTEMS

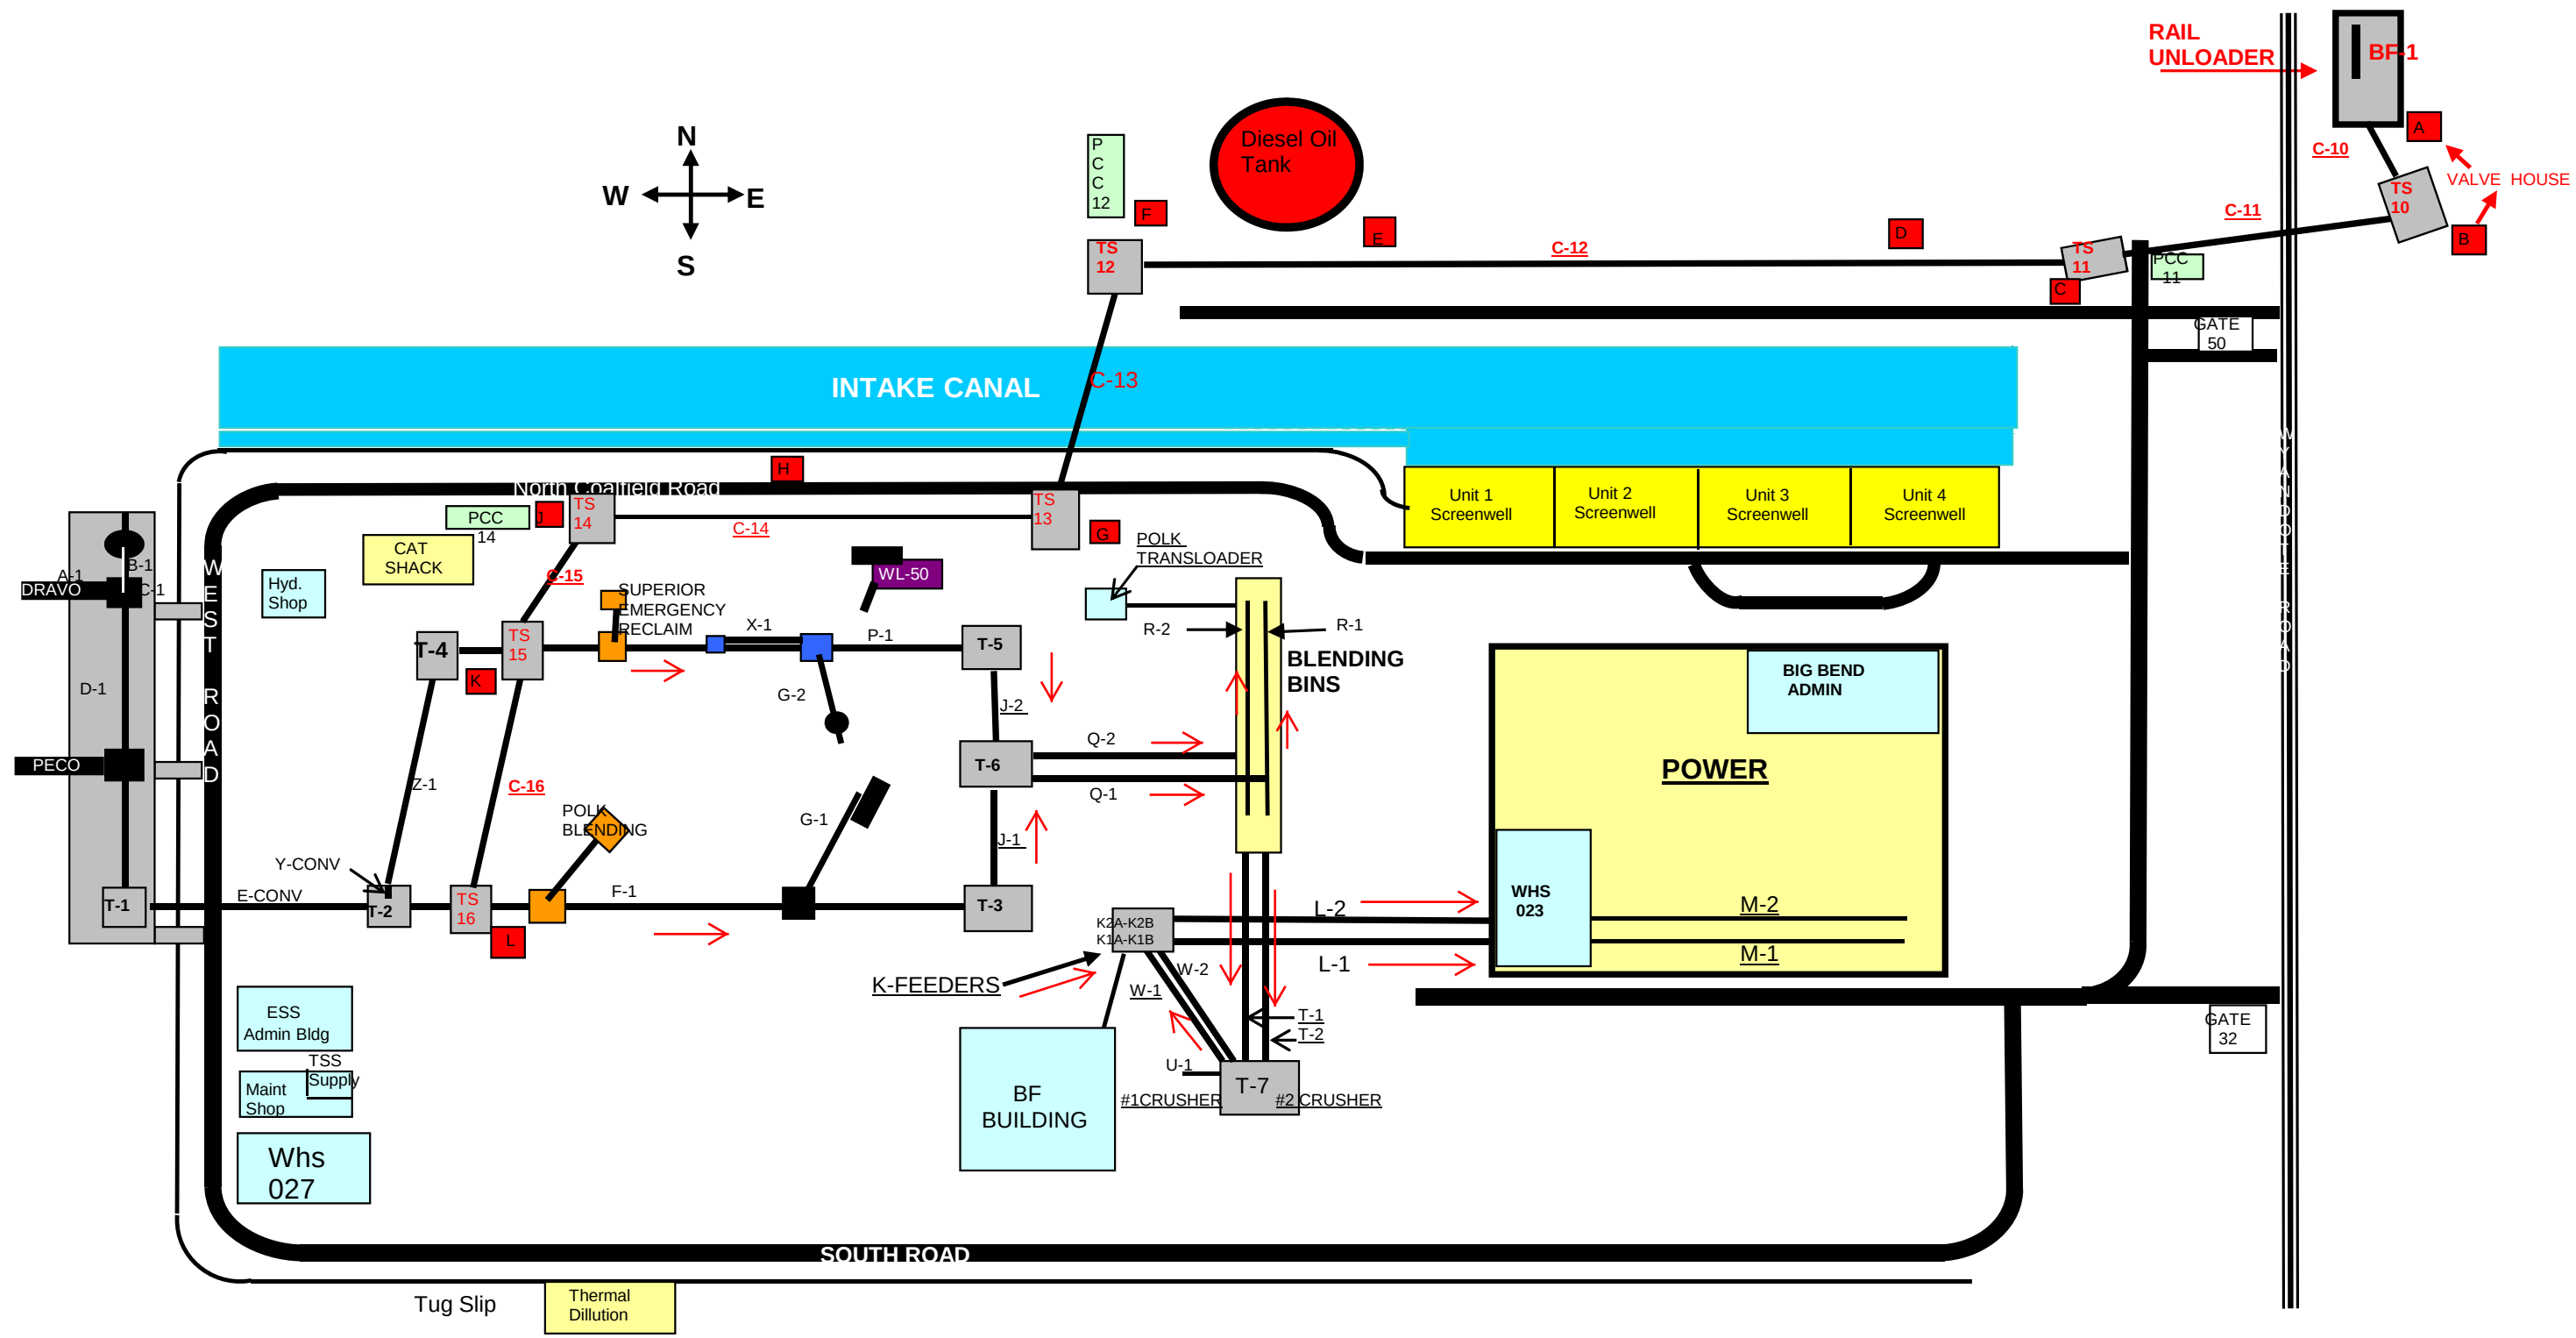

- Enclosed
- Totally Enclosed
- Open - Fugitive

- EU-047 Railcar Unloading and Conveying System
- RC-1 Train Car Drop Unloading to Belt Feeder BF-1
 - RC-2 Transfer from BF-1 to Conveyor C-10
 - RC-3 Conveyor C-10 to Conveyor C-11
 - RC-4 Conveyor C-11 to Conveyor C-12
 - RC-5 Conveyor C-12 to Conveyor C-13
 - RC-6 Conveyor C-13 to Conveyor C-14
 - RC-7 Conveyor C-14 to Conveyor C-15
 - RC-8 Conveyor C-15 to Conveyor C-16 or Conveyor P
 - RC-9 Conveyor C-16 Drop to Conveyor F

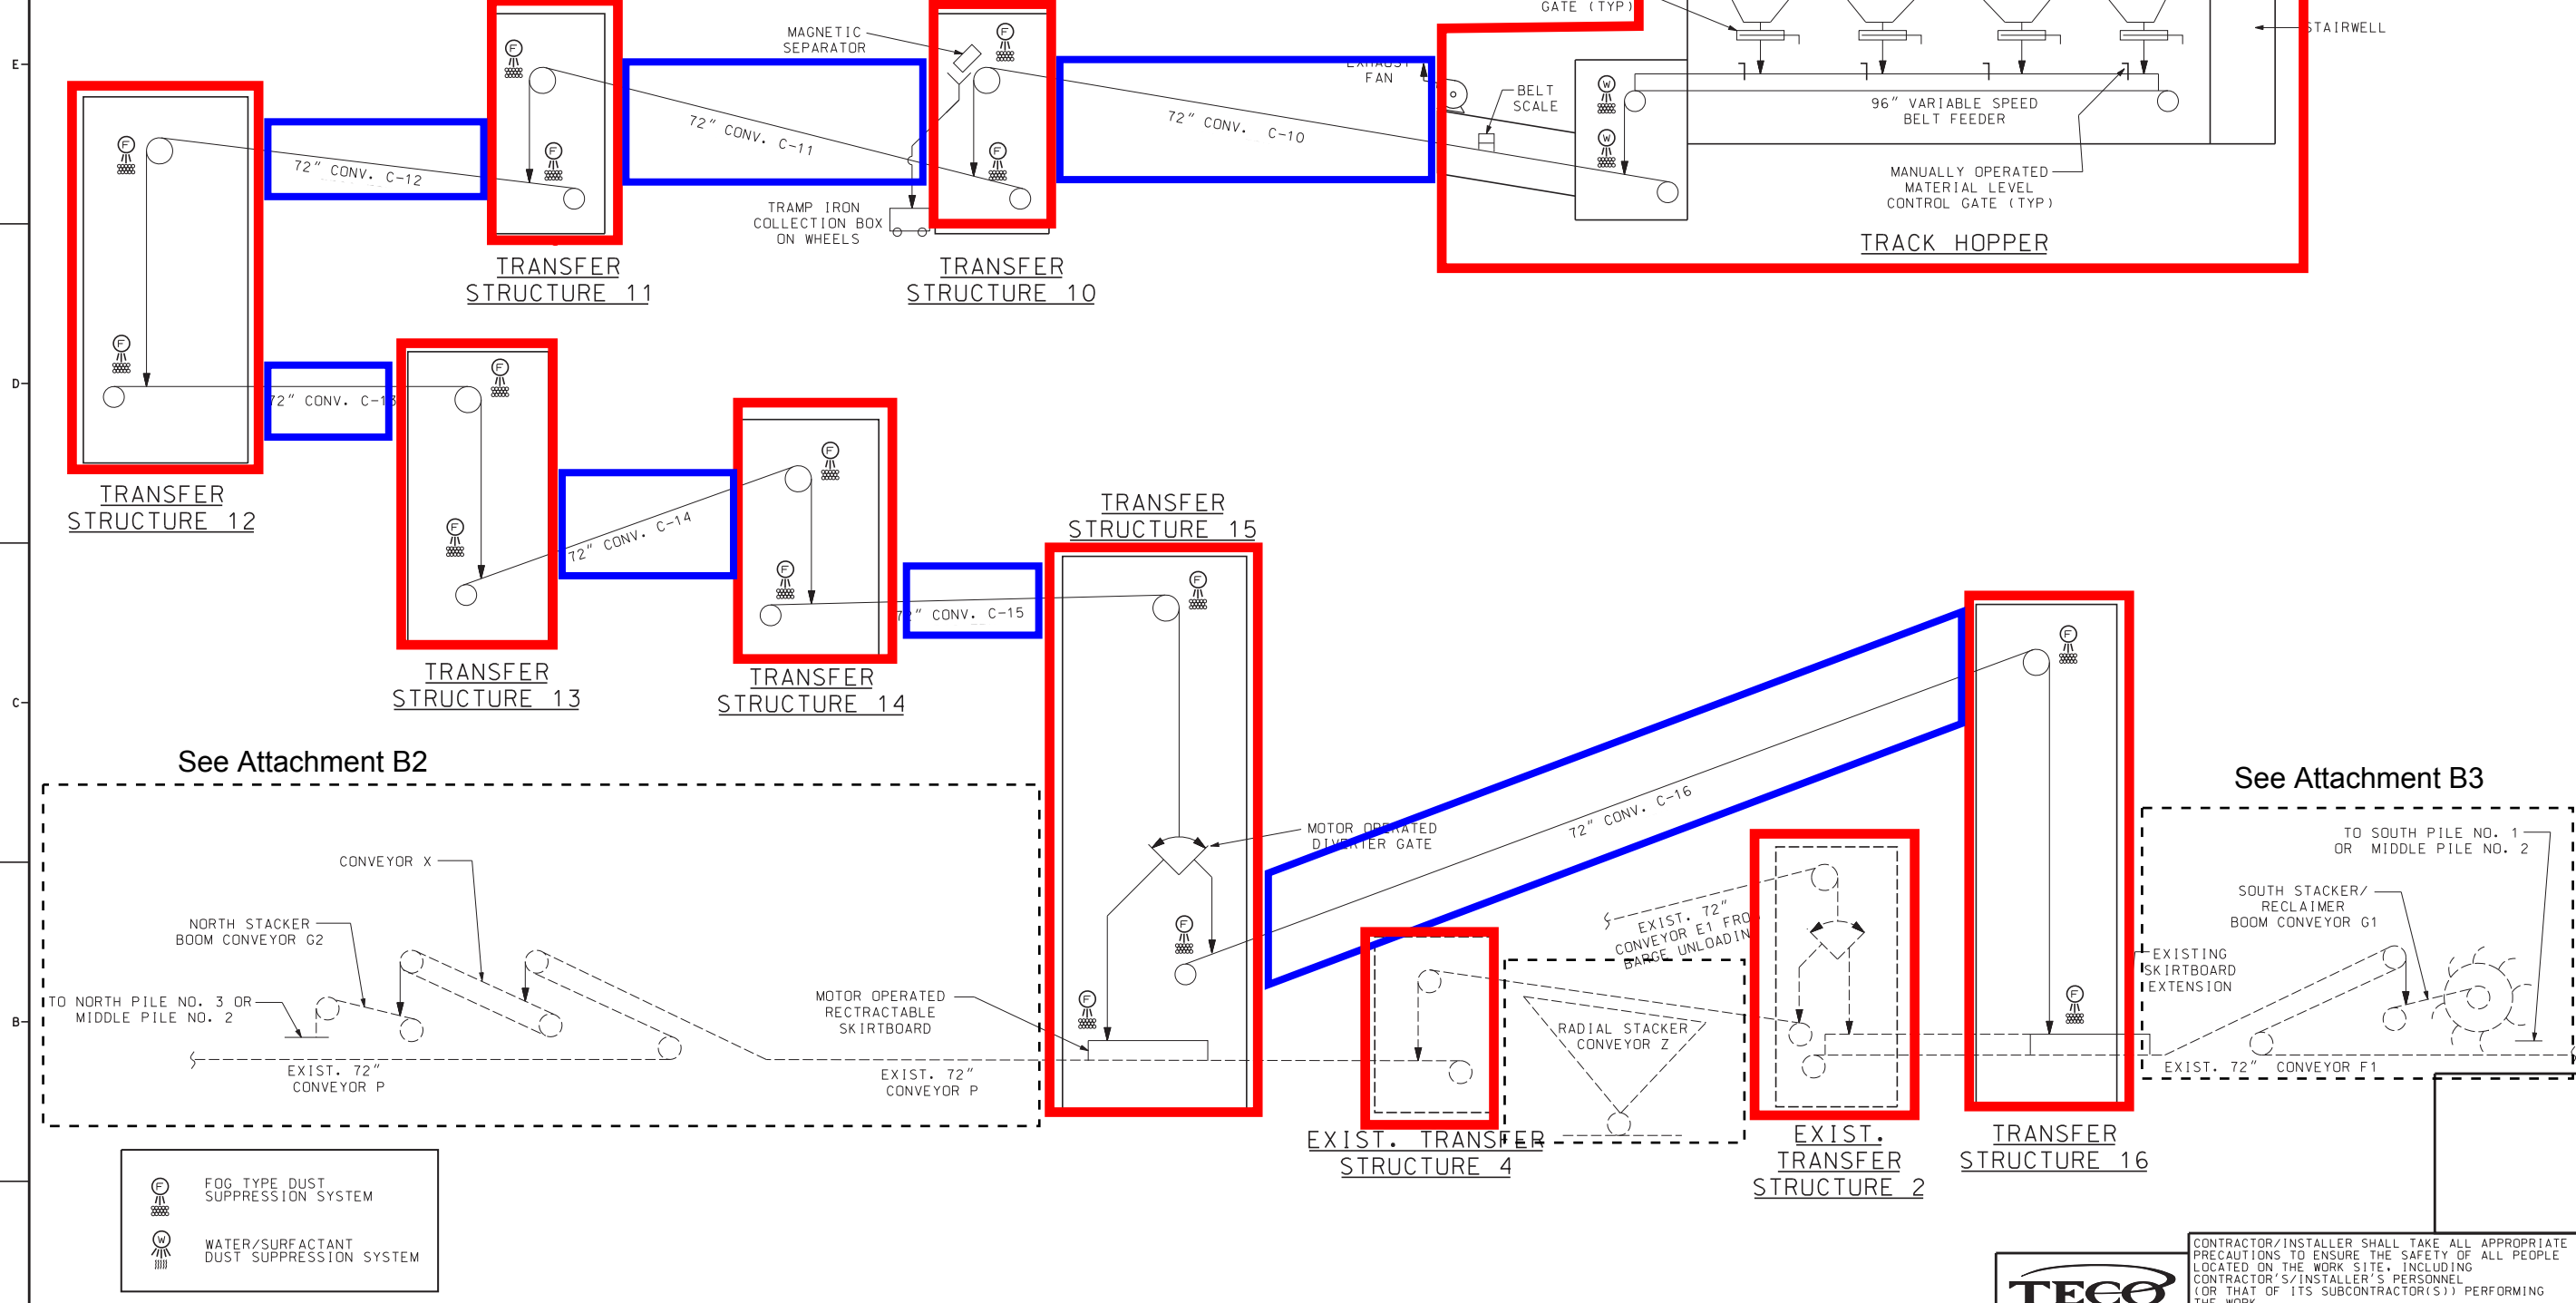

See Attachment B2

See Attachment B3

- FOG TYPE DUST SUPPRESSION SYSTEM
- WATER/SURFACTANT DUST SUPPRESSION SYSTEM

NOTE:-
1. MAXIMUM CONVEYING CAPACITY 4400 TPH
AT 650 FPM BELT SPEED.

DRAWING RELEASE RECORD						PURPOSE
REV	DATE	REL'D	PREPARED	REVIEWED	APPROVED	
A	07-15-2008		D. SCHRADER	B. SHAH		FOR REFERENCE
B	08-20-2008		D. AMIN	B. SHAH		ISSUED WITH RAIL UNLOADING SYSTEM CONCEPTUAL CONTROL SEQUENCE

TECO
TAMPA ELECTRIC

CONTRACTOR/INSTALLER SHALL TAKE ALL APPROPRIATE PRECAUTIONS TO ENSURE THE SAFETY OF ALL PEOPLE LOCATED ON THE WORK SITE, INCLUDING CONTRACTOR'S/INSTALLER'S PERSONNEL (OR THAT OF ITS SUBCONTRACTOR(S)) PERFORMING THE WORK.
FILE I.D.: BIG-CHS-SK10.DGN

SCALE
NONE

PROJECT NUMBER
12312-001

FLOW DIAGRAM
BOTTOM DUMP RAIL CAR
UNLOADING AND COAL
CONVEYING SYSTEM

BIG BEND POWER STATION
TAMPA ELECTRIC CO


Sargent & Lundy

55 E. MONROE STREET
CHICAGO, ILL. 60601-5780
CERTIFICATION OF AUTHORIZATION NO. 6938


DRAWING NO
SK-10

REV
B


EU-010: Barge Unloading Operations
FH-002, FH-003, FH-004, FH-005, FH-006

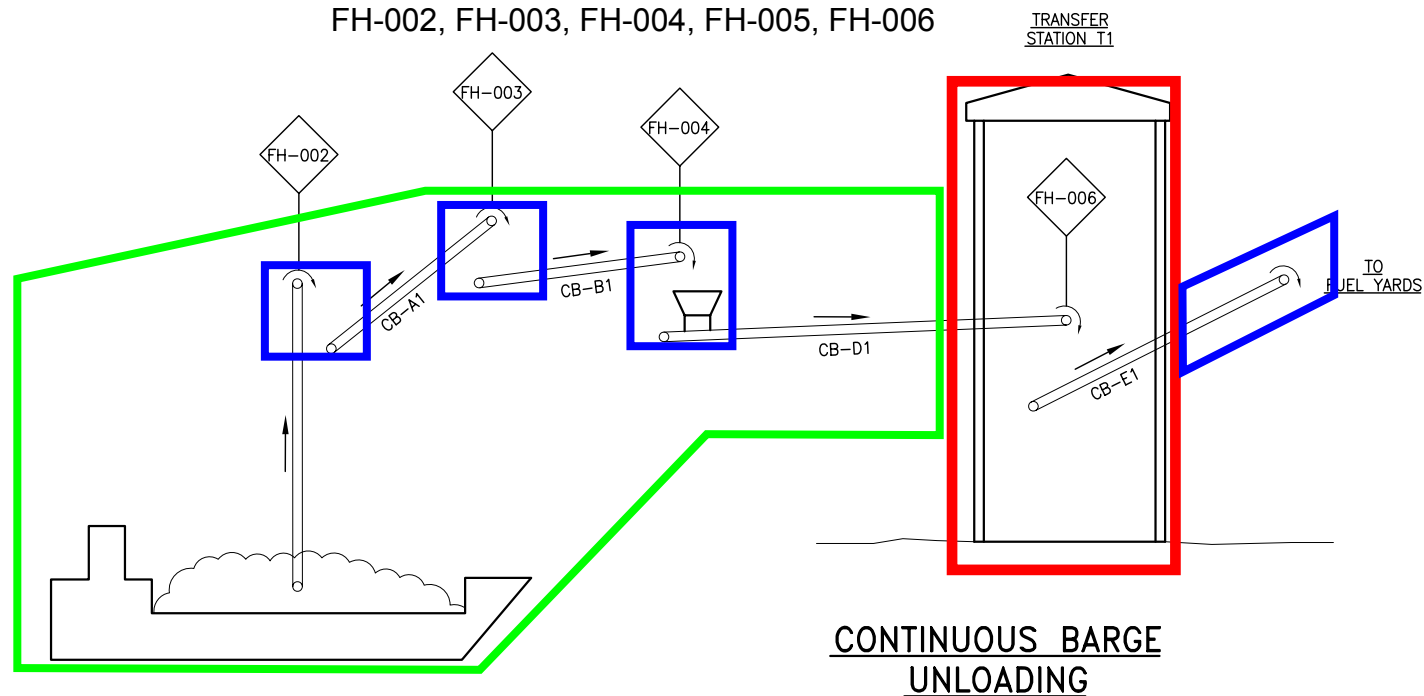


EU-010: Barge Unloading Operations
FH-001, FH-005, FH-006

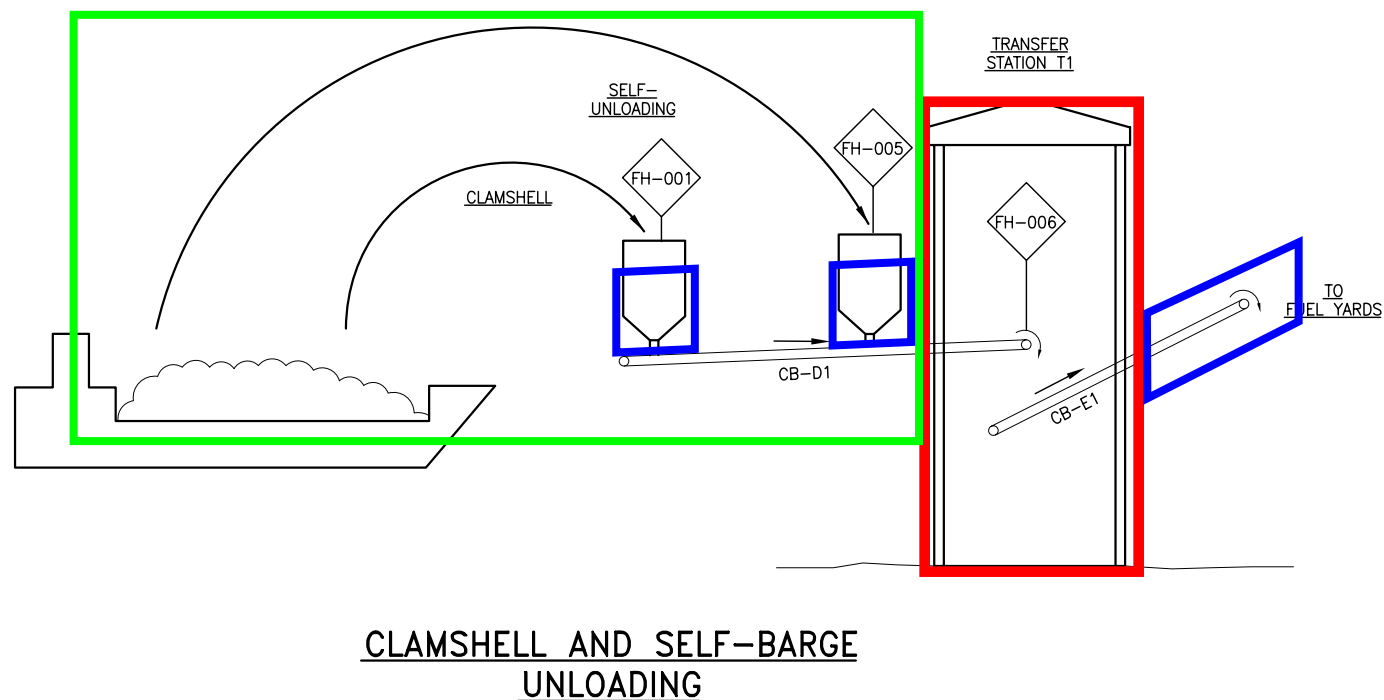

EU-010: Coal Conveying Operations
FH-007, FH-008a, FH-008b, FH-009, FH-010

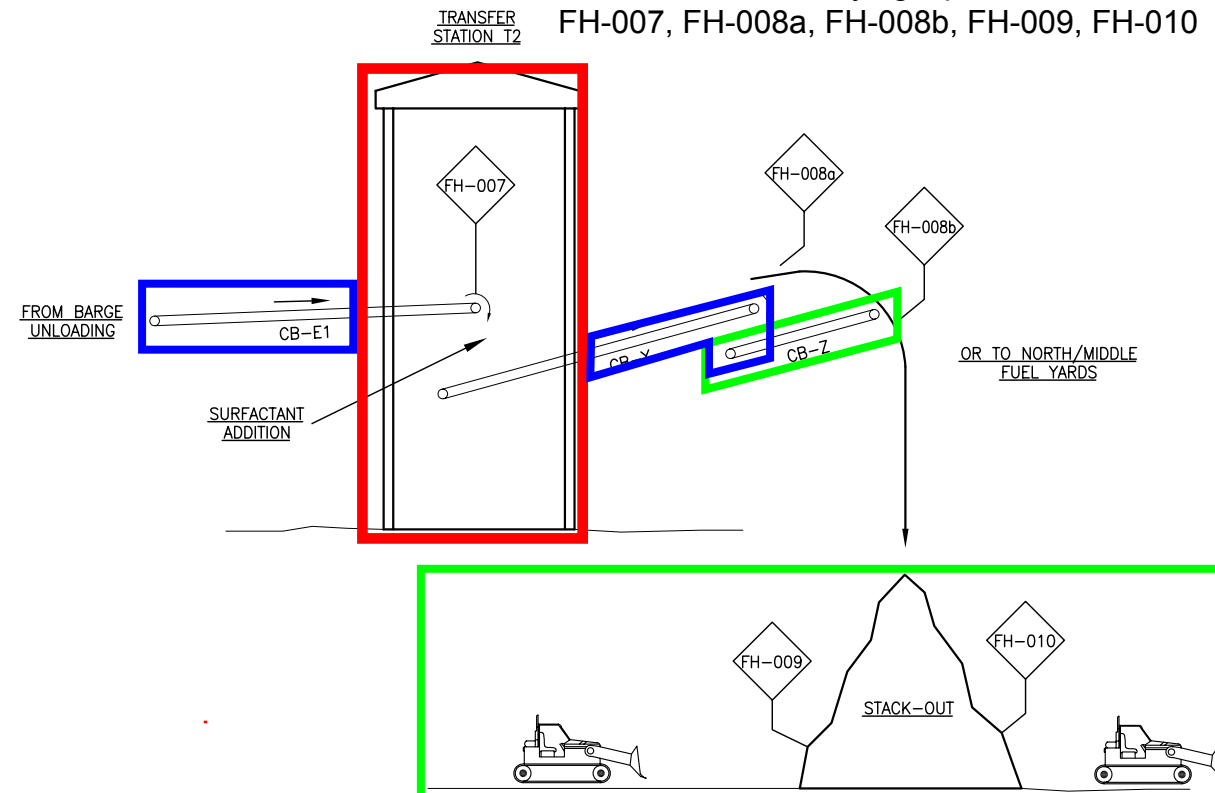

EU-010: Coal Conveying Operations
FH-011a, FH-011b, FH-011c

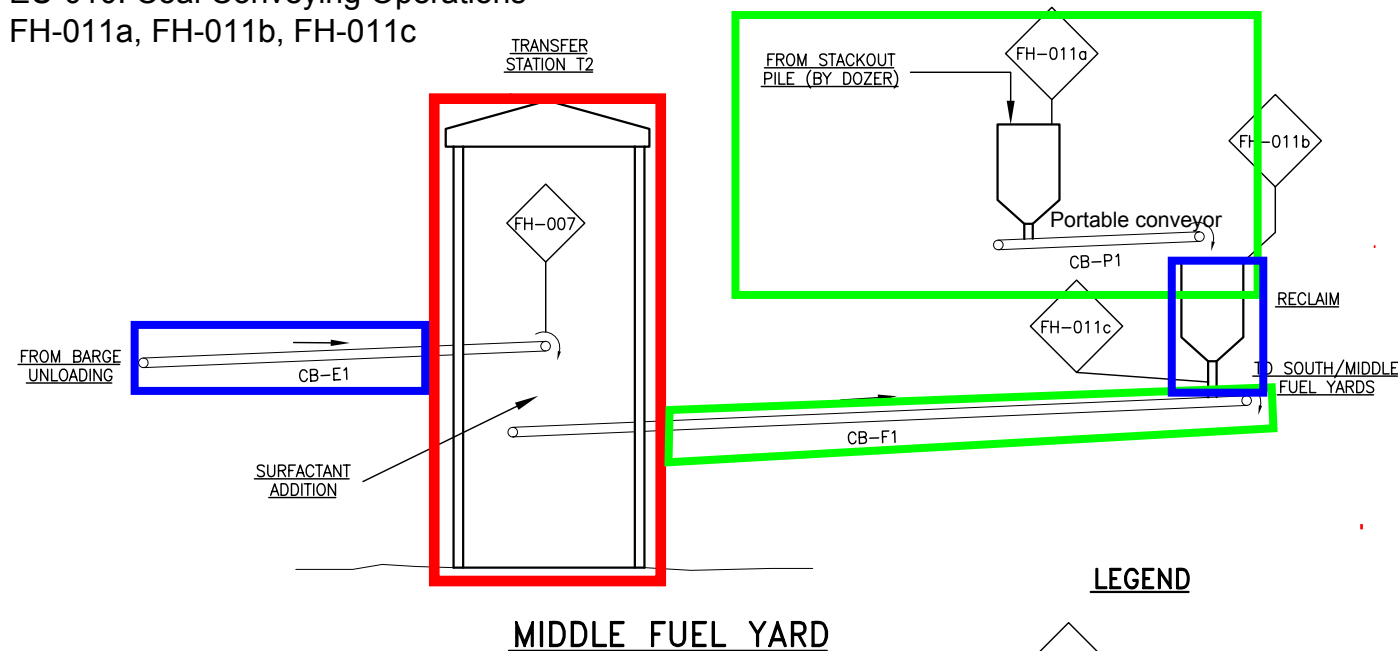

LEGEND

FH-006 TRANSFER POINT


ATTACHMENT B1.

FUEL HANDLING PROCESS FLOW SCHEMATIC, BARGE UNLOADING AND MIDDLE FUEL YARD

Sources: TEC, 2008; ECT, 2008.

TECO
TAMPA ELECTRIC

EU-010: Coal Conveying Operations
 FH-012, FH-013, FH-014, FH-015, FH-016, FH-017, FH-018, FH-019, FH-020,
 FH-021, FH-028, FH-067, FH-068

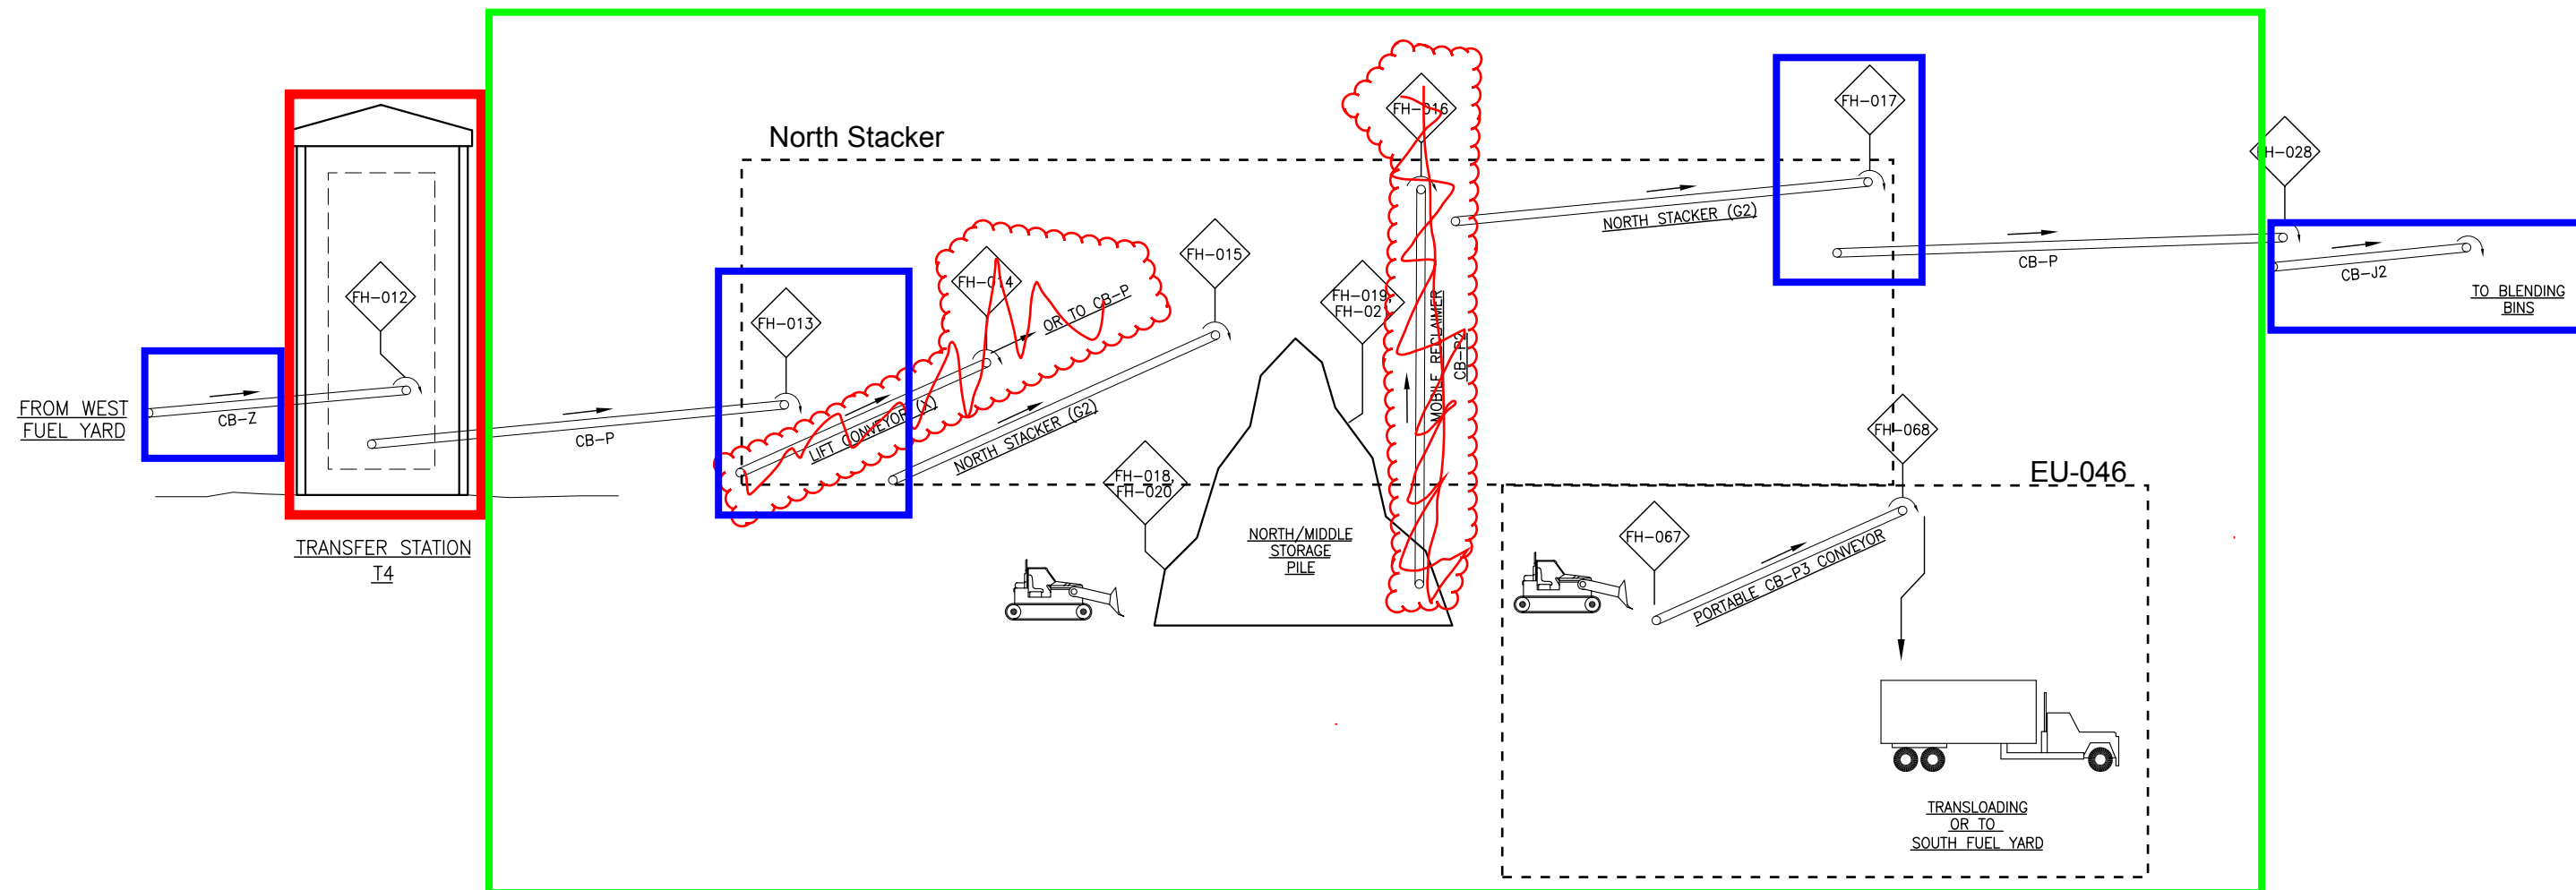

LEGEND

 TRANSFER POINT


ATTACHMENT B2.

FUEL HANDLING PROCESS FLOW DIAGRAM NORTH/MIDDLE FUEL YARD

Sources: TEC, 2008; ECT, 2008.

TECO
 TAMPA ELECTRIC

EU-010: Coal Conveying Operations
 FH-020, FH-021, FH-022, FH-023, FH-024, FH-025, FH-026, FH-027, FH-030,
 FH-074, FH-075

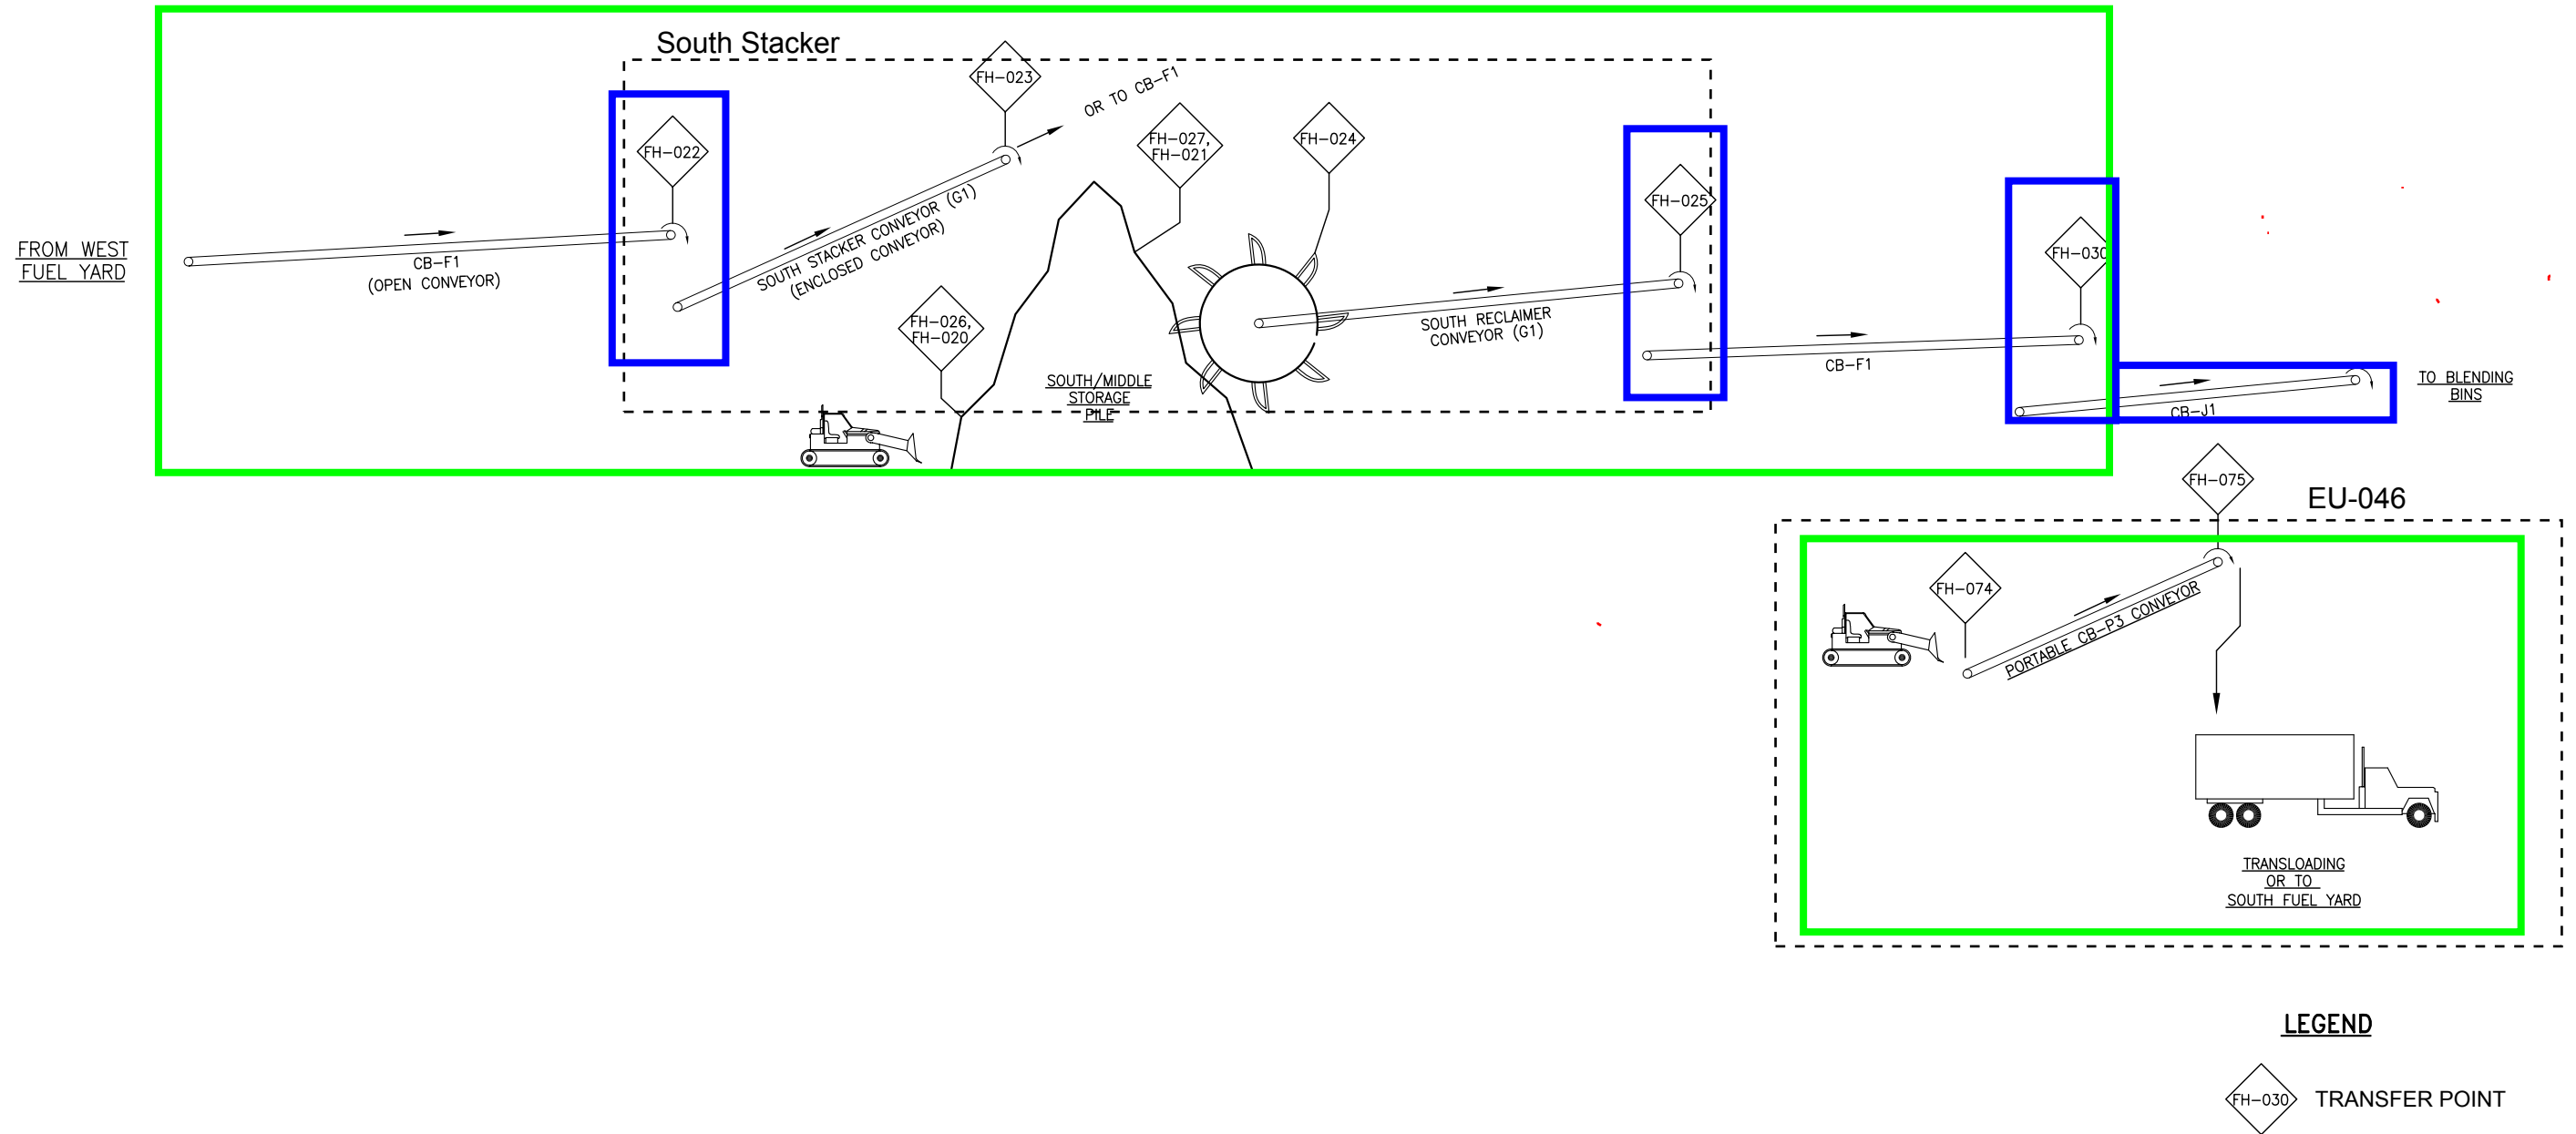


ATTACHMENT B3.

FUEL HANDLING PROCESS FLOW DIAGRAM, SOUTH/MIDDLE FUEL YARD

Sources: TEC, 2008; ECT, 2008.

TECO
 TAMPA ELECTRIC

EU-010: Coal Conveying Operations
FH-029, FH-031, FH-036 to FH-047, FH-069, FH-072, FH-073

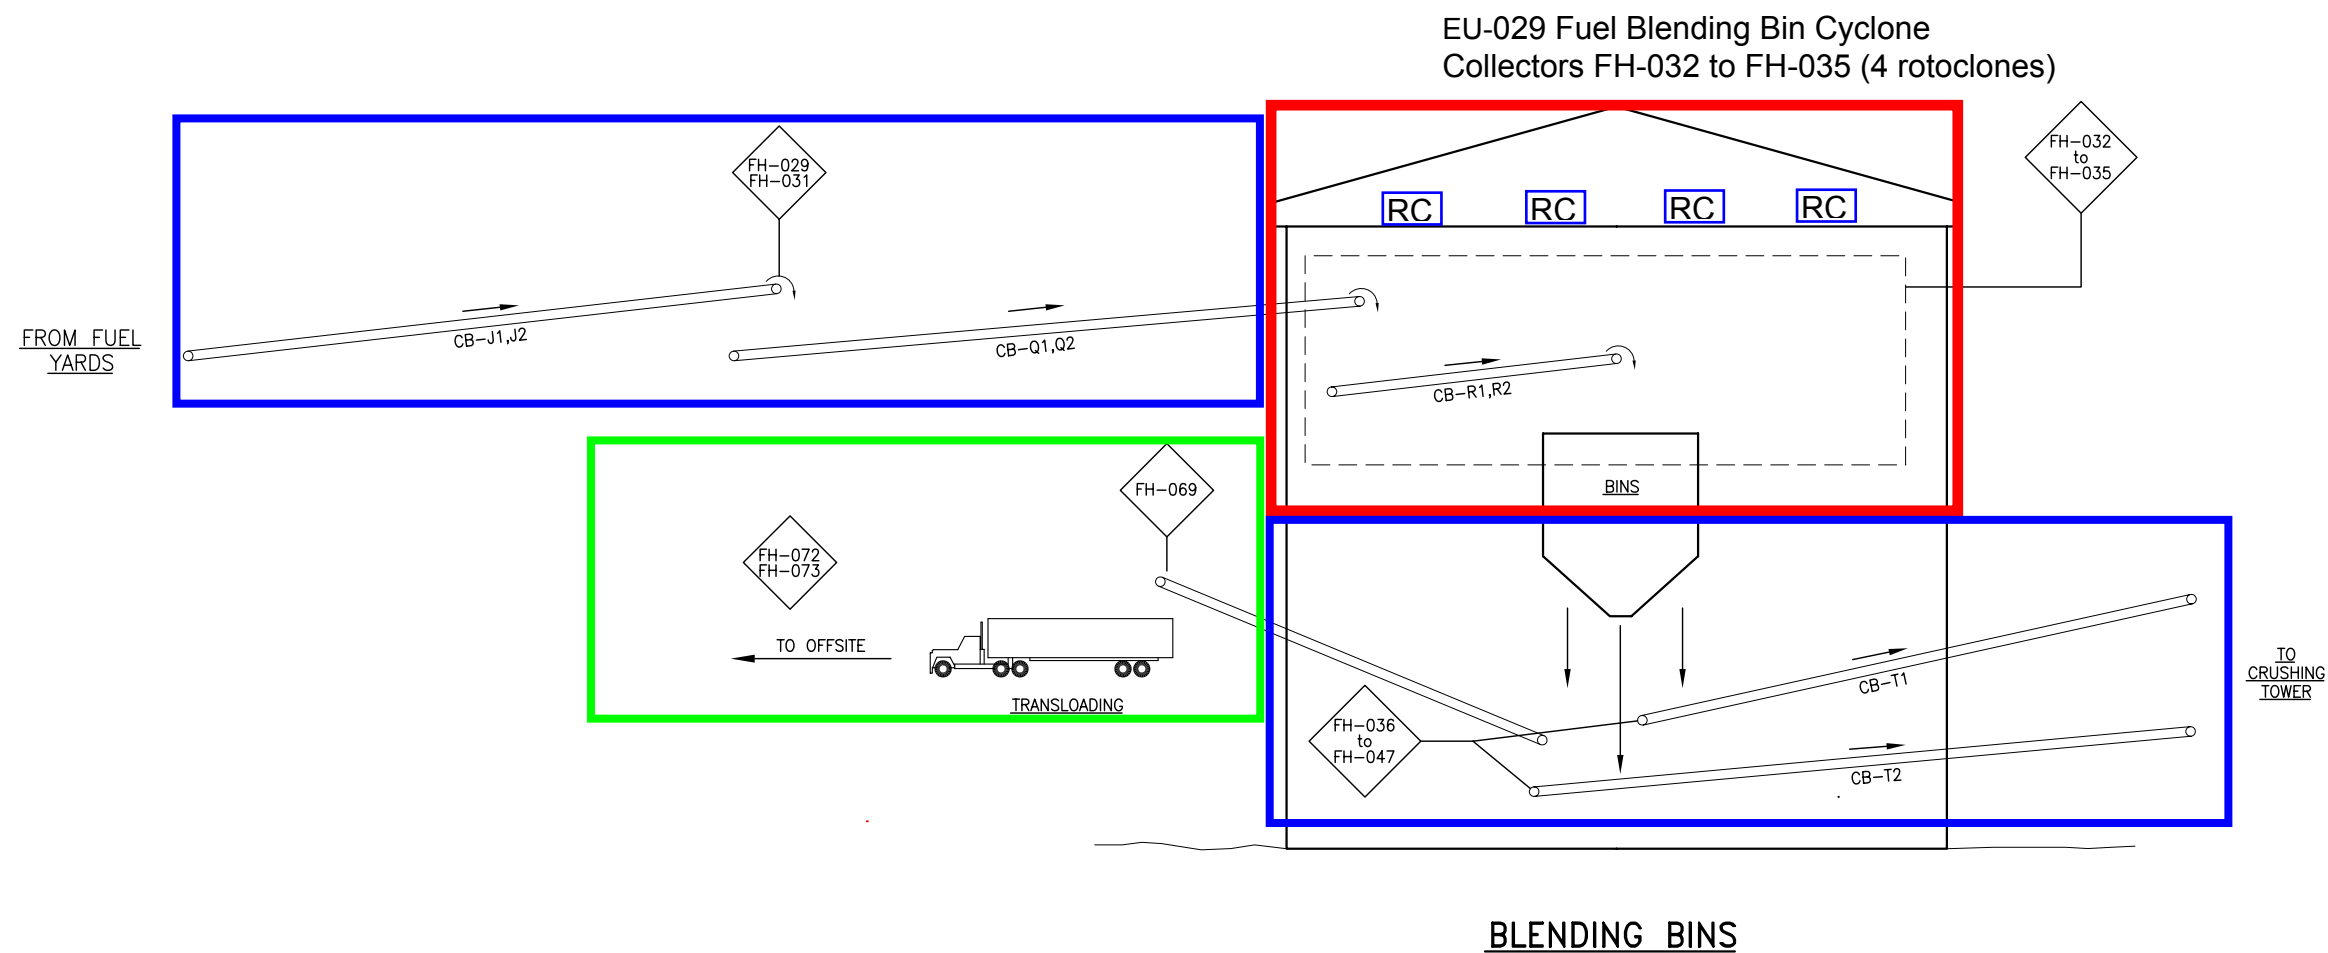

LEGEND



ATTACHMENT B4.

FUEL HANDLING PROCESS FLOW DIAGRAM, BLENDING BINS


Sources: TEC, 2008; ECT, 2008.

TECO
TAMPA ELECTRIC

EU-010: Coal Conveying Operations
 FH-050, FH-051, FH-052, FH-053, FH-054, FH-055, FH-056, FH-057,
 FH-058, FH-059 to FH-062, FH-076, FH-077, FH-078

EU-030 Fuel Mill Cyclone Collectors
 FH-048 and FH-049 (2 rotoclones)

EU-037/EU-038

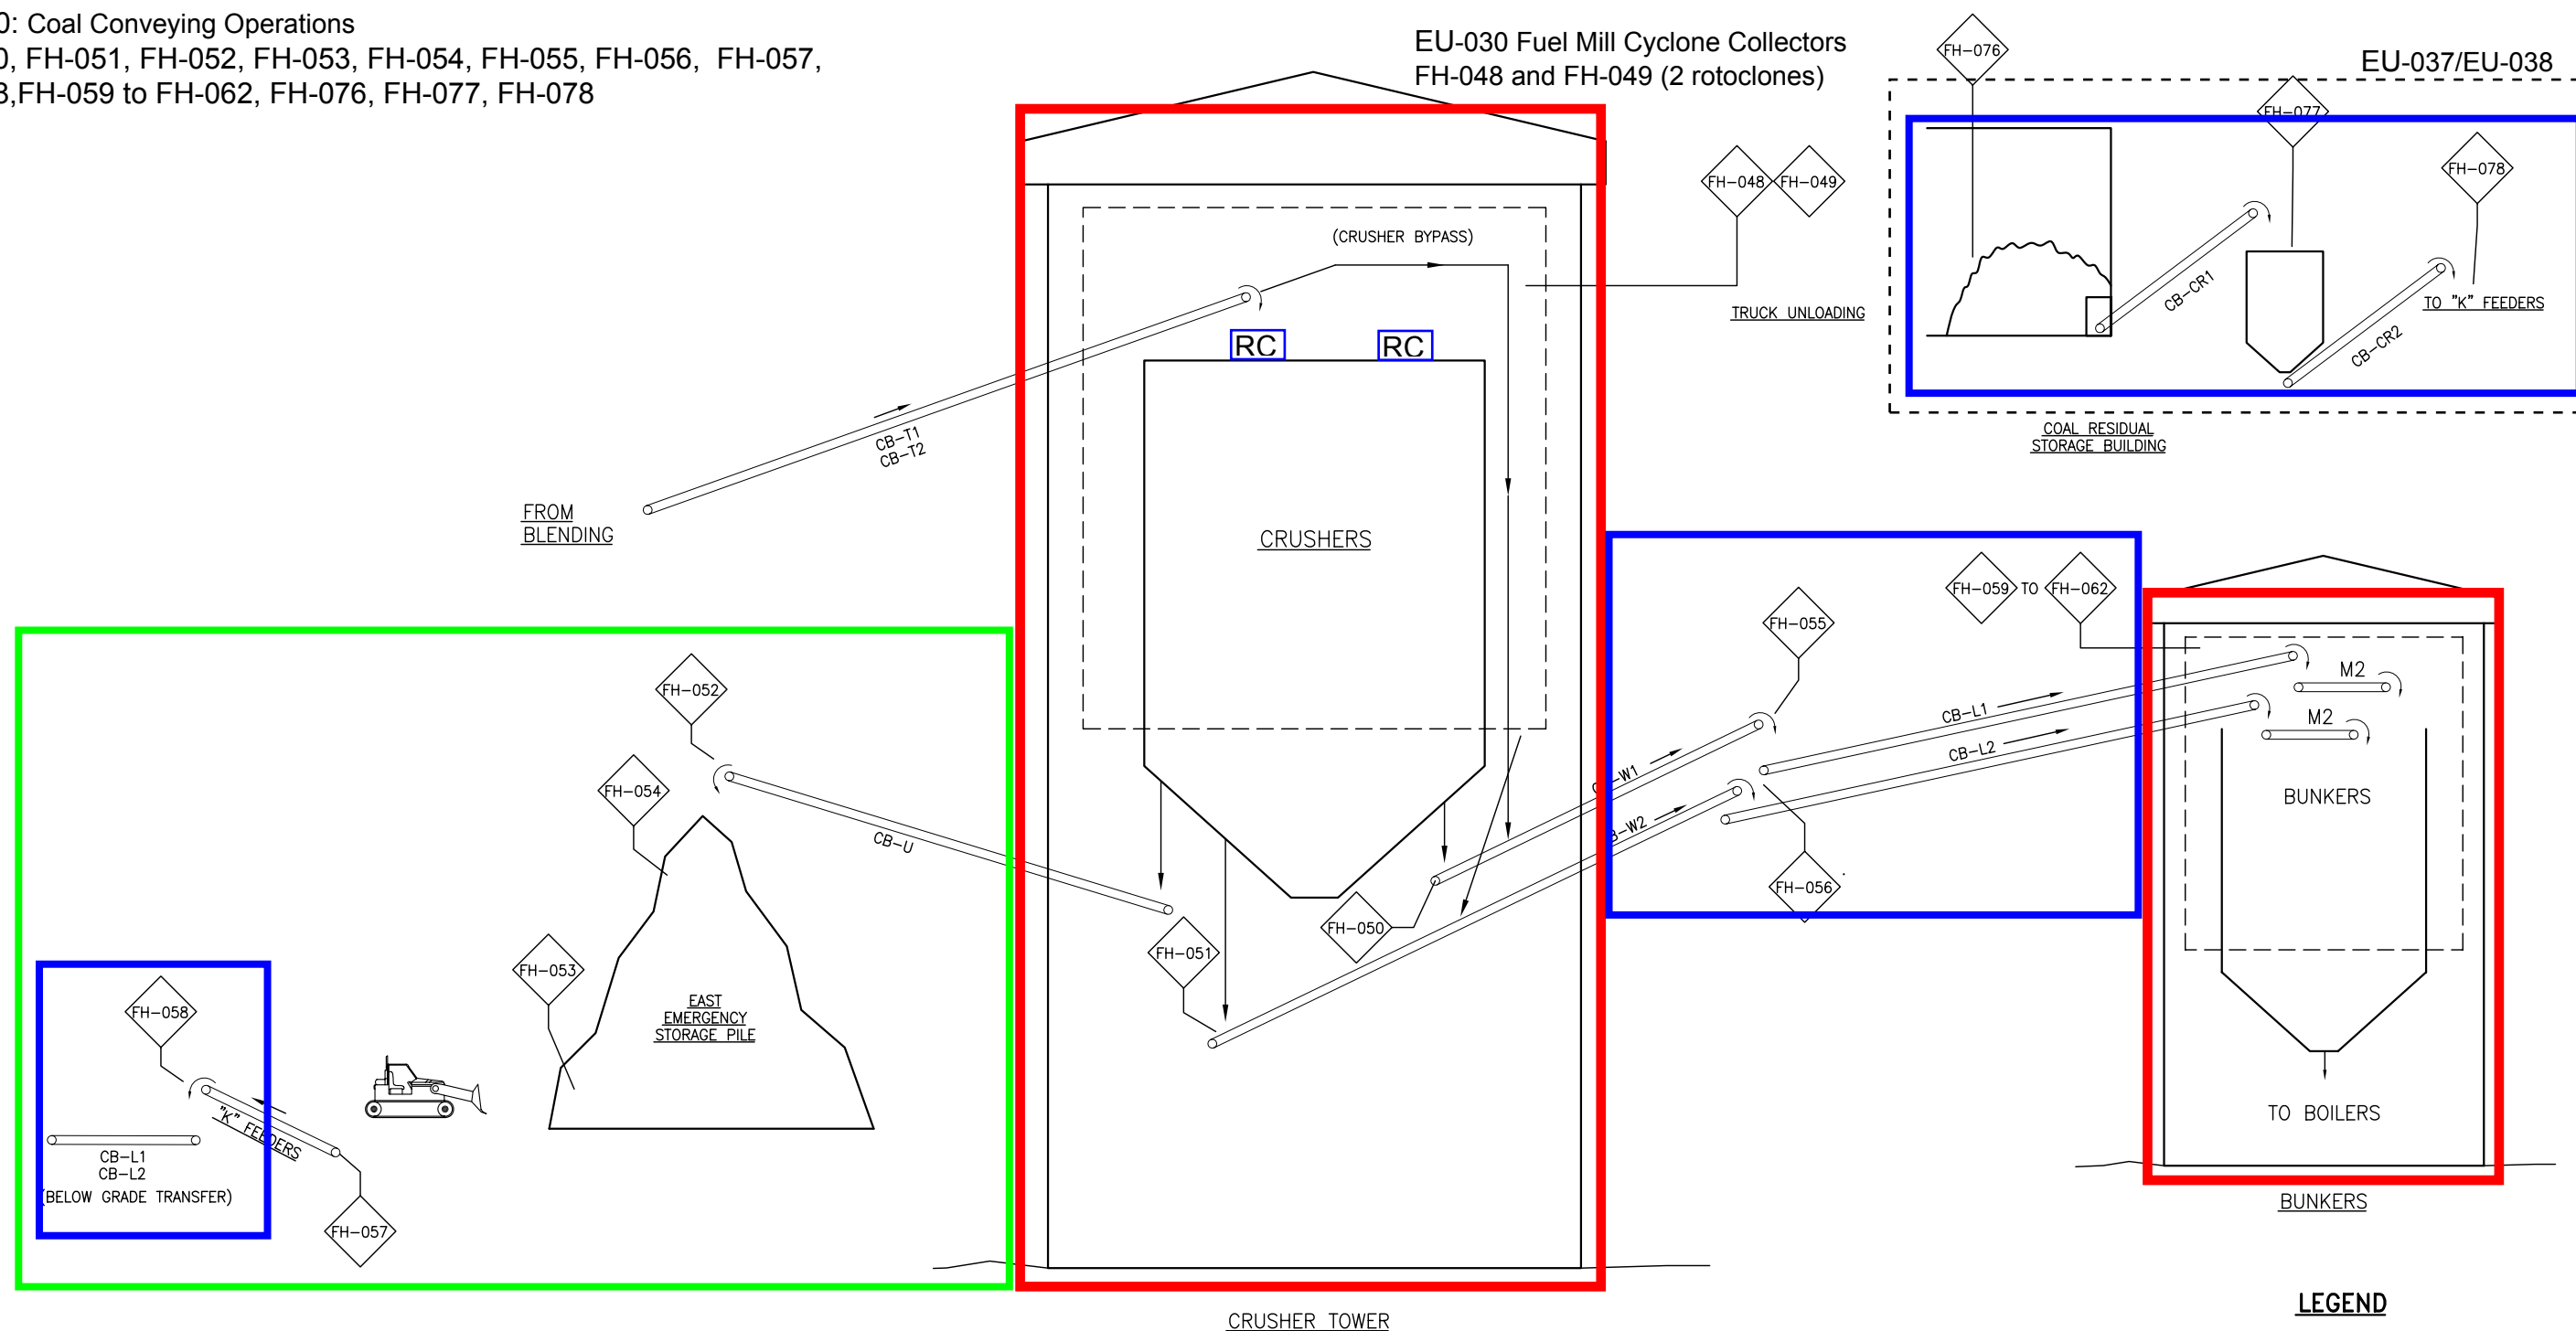

ATTACHMENT B5.

FUEL HANDLING PROCESS FLOW DIAGRAM, CRUSHER TOWER, BUNKERS, AND COAL RESIDUAL

Sources: TEC, 2008; ECT, 2008.

TECO
 TAMPA ELECTRIC

Limestone Handling and Storage

EU-011 Truck Limestone Unloading Receiving Hopper (LSH-001)

EU-012 Limestone Silo A with 2 Baghouses



EU-013 Limestone Silo B with 2 Baghouses

EU-023 Limestone Conveyor LB to Conveyor LC with Baghouse (LSH-002)

EU-023 Limestone Conveyor LD to Conveyor LE with Baghouse (LSH-003)

EU-020 Limestone Conveyors LE, LF and LG and Silo C with Baghouse

EU-021 Silo C with one Baghouse

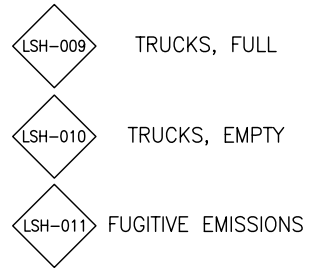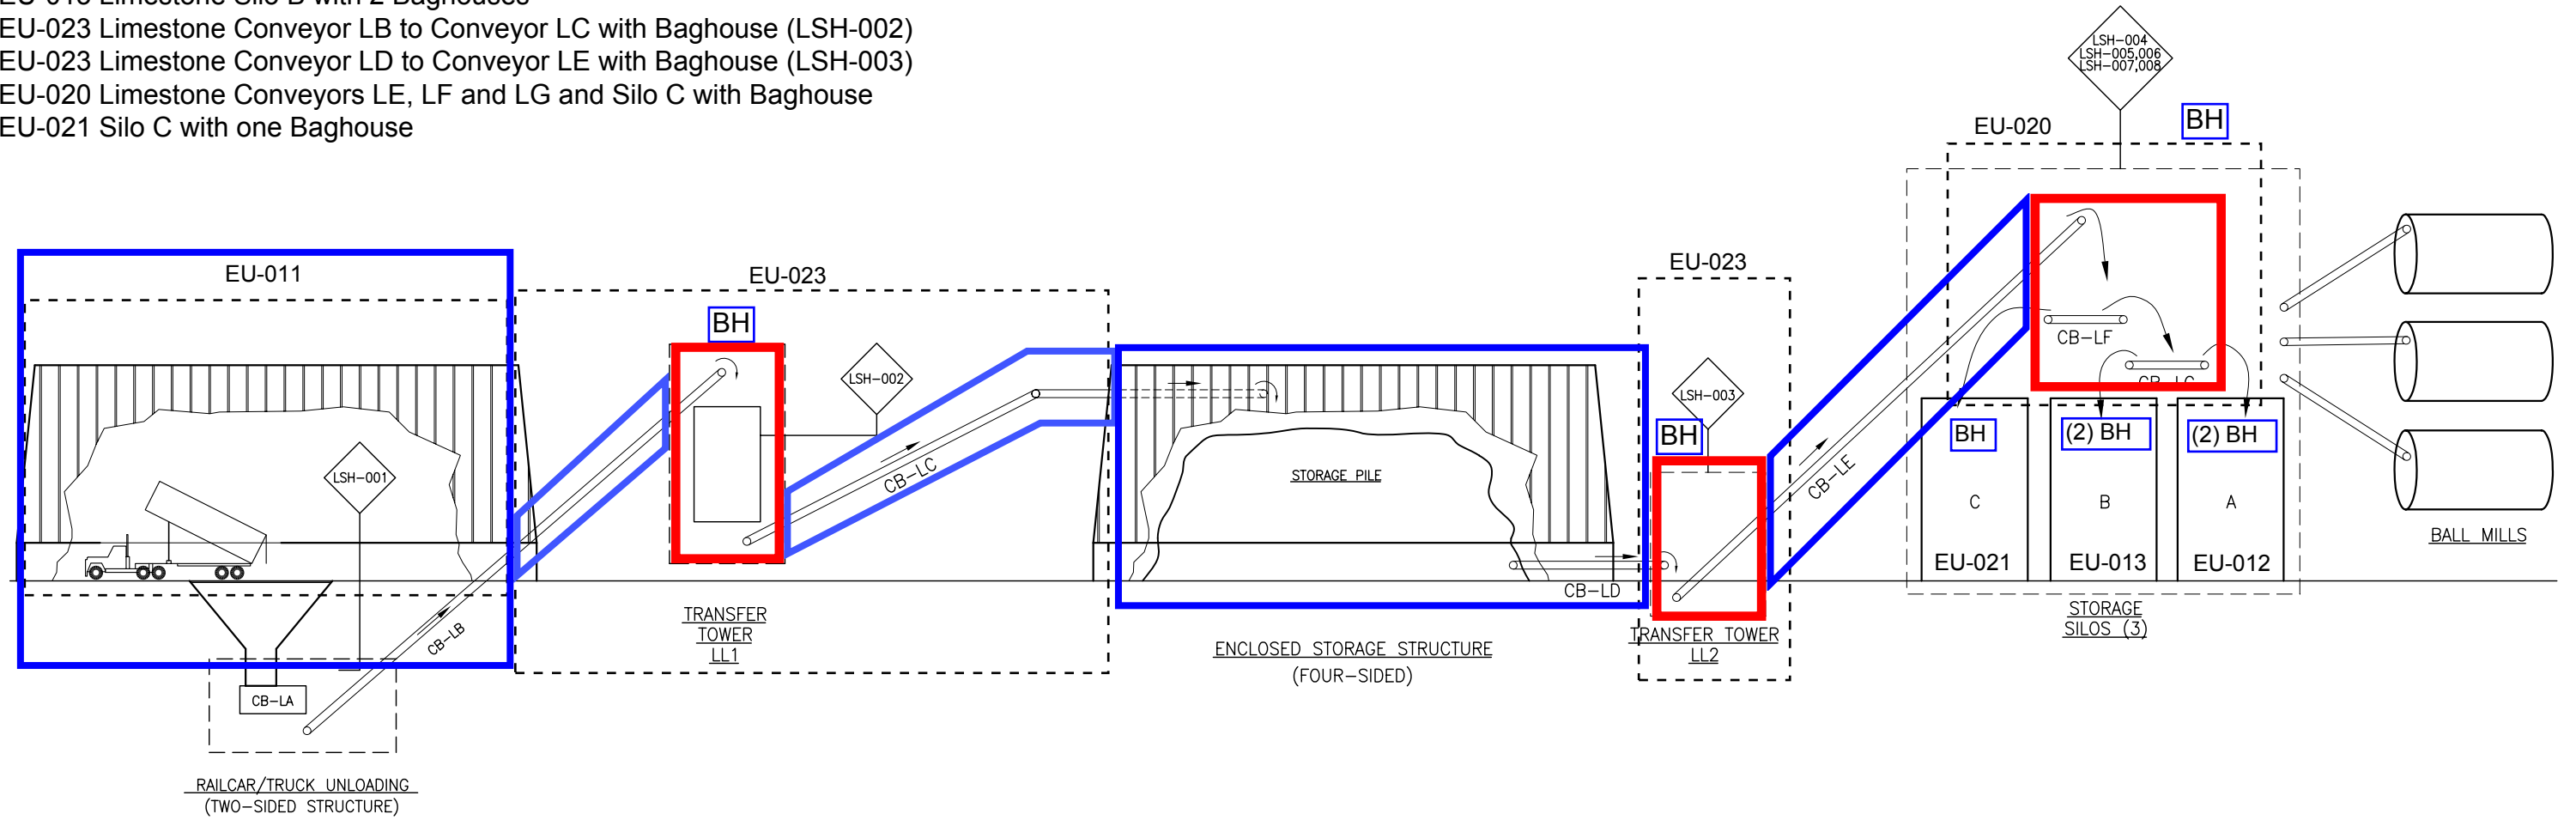

BH = baghouse

LEGEND



ATTACHMENT B9.

LIMESTONE HANDLING PROCESS FLOW DIAGRAM

Sources: TEC, 2008; ECT, 200\8.

TECO
TAMPA ELECTRIC

ATTACHMENT 3
SO₂ Reporting Data

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
1/1/09 1:00 AM	0.09	0.00	0.14
1/1/09 3:00 AM	0.09	0.00	0.15
1/1/09 5:00 AM	0.08	0.00	0.13
1/1/09 7:00 AM	0.09	0.00	0.10
1/1/09 9:00 AM	0.11	0.00	0.11
1/1/09 11:00 AM	0.12	0.00	0.11
1/1/09 1:00 PM	0.12	0.00	0.10
1/1/09 3:00 PM	0.12	0.00	0.10
1/1/09 5:00 PM	0.12	0.00	0.10
1/1/09 7:00 PM	0.11	0.00	0.10
1/1/09 9:00 PM	0.11	0.00	0.10
1/1/09 11:00 PM	0.11	0.00	0.09
1/2/09 1:00 AM	0.11	0.00	0.07
1/2/09 3:00 AM	0.10	0.00	0.06
1/2/09 5:00 AM	0.10	0.00	0.07
1/2/09 7:00 AM	0.11	0.00	0.08
1/2/09 9:00 AM	0.12	0.00	0.08
1/2/09 11:00 AM	0.11	0.00	0.07
1/2/09 1:00 PM	0.11	0.00	0.07
1/2/09 3:00 PM	0.10	0.00	0.06
1/2/09 5:00 PM	0.10	0.00	0.07
1/2/09 7:00 PM	0.10	0.00	0.07
1/2/09 9:00 PM	0.10	0.00	0.07
1/2/09 11:00 PM	0.10	0.00	0.07
1/3/09 1:00 AM	0.07	0.00	0.07
1/3/09 3:00 AM	0.06	0.00	0.06
1/3/09 5:00 AM	0.05	0.00	0.06
1/3/09 7:00 AM	0.07	0.00	0.07
1/3/09 9:00 AM	0.10	0.00	0.07
1/3/09 11:00 AM	0.09	0.00	0.07
1/3/09 1:00 PM	0.09	0.00	0.06
1/3/09 3:00 PM	0.09	0.00	0.07
1/3/09 5:00 PM	0.09	0.00	0.07
1/3/09 7:00 PM	0.09	0.00	0.07
1/3/09 9:00 PM	0.08	0.00	0.07
1/3/09 11:00 PM	0.08	0.00	0.07
1/4/09 1:00 AM	0.08	0.00	0.06
1/4/09 3:00 AM	0.08	0.00	0.05
1/4/09 5:00 AM	0.08	0.00	0.05
1/4/09 7:00 AM	0.08	0.00	0.05
1/4/09 9:00 AM	0.10	0.00	0.05
1/4/09 11:00 AM	0.09	0.00	0.06
1/4/09 1:00 PM	0.09	0.00	0.06
1/4/09 3:00 PM	0.09	0.00	0.06
1/4/09 5:00 PM	0.09	0.00	0.06
1/4/09 7:00 PM	0.09	0.00	0.06
1/4/09 9:00 PM	0.09	0.00	0.06
1/4/09 11:00 PM	0.09	0.00	0.06
1/5/09 1:00 AM	0.09	0.00	0.07
1/5/09 3:00 AM	0.08	0.00	0.07
1/5/09 5:00 AM	0.08	0.00	0.06
1/5/09 7:00 AM	0.08	0.00	0.07
1/5/09 9:00 AM	0.10	0.00	0.07

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
1/5/09 11:00 AM	0.10	0.00	0.06
1/5/09 1:00 PM	0.14	0.00	0.06
1/5/09 3:00 PM	0.09	0.00	0.07
1/5/09 5:00 PM	0.10	0.00	0.08
1/5/09 7:00 PM	0.09	0.00	0.07
1/5/09 9:00 PM	0.09	0.00	0.07
1/5/09 11:00 PM	0.09	0.00	0.07
1/6/09 1:00 AM	0.09	0.00	0.07
1/6/09 3:00 AM	0.09	0.00	0.08
1/6/09 5:00 AM	0.09	0.00	0.08
1/6/09 7:00 AM	0.09	0.00	0.08
1/6/09 9:00 AM	0.10	0.00	0.08
1/6/09 11:00 AM	0.09	0.00	0.08
1/6/09 1:00 PM	0.09	0.00	0.07
1/6/09 3:00 PM	0.09	0.00	0.06
1/6/09 5:00 PM	0.09	0.00	0.06
1/6/09 7:00 PM	0.09	0.00	0.07
1/6/09 9:00 PM	0.09	0.00	0.08
1/6/09 11:00 PM	0.09	0.00	0.06
1/7/09 1:00 AM	0.09	0.00	0.05
1/7/09 3:00 AM	0.09	0.00	0.05
1/7/09 5:00 AM	0.09	0.00	0.05
1/7/09 7:00 AM	0.09	0.00	0.10
1/7/09 9:00 AM	0.10	0.00	0.10
1/7/09 11:00 AM	0.09	0.00	0.11
1/7/09 1:00 PM	0.09	0.00	0.12
1/7/09 3:00 PM	0.09	0.00	0.14
1/7/09 5:00 PM	0.08	0.00	0.18
1/7/09 7:00 PM	0.08	0.00	0.14
1/7/09 9:00 PM	0.08	0.00	0.16
1/7/09 11:00 PM	0.08	0.00	0.19
1/8/09 1:00 AM	0.08	0.00	0.21
1/8/09 3:00 AM	0.08	0.00	0.23
1/8/09 5:00 AM	0.09	0.00	0.25
1/8/09 7:00 AM	0.09	0.00	0.24
1/8/09 9:00 AM	0.10	0.00	0.25
1/8/09 11:00 AM	0.09	0.00	0.24
1/8/09 1:00 PM	0.09	0.00	0.26
1/8/09 3:00 PM	0.09	0.00	0.22
1/8/09 5:00 PM	0.09	0.00	0.20
1/8/09 7:00 PM	0.09	0.00	0.20
1/8/09 9:00 PM	0.09	0.00	0.22
1/8/09 11:00 PM	0.08	0.00	0.19
1/9/09 1:00 AM	0.07	0.00	0.19
1/9/09 3:00 AM	0.07	0.00	0.18
1/9/09 5:00 AM	0.07	0.00	0.16
1/9/09 7:00 AM	0.08	0.00	0.14
1/9/09 9:00 AM	0.09	0.00	0.14
1/9/09 11:00 AM	0.09	0.00	0.13
1/9/09 1:00 PM	0.09	0.00	0.12
1/9/09 3:00 PM	0.09	0.00	0.12
1/9/09 5:00 PM	0.09	0.00	0.11
1/9/09 7:00 PM	0.09	0.00	0.10

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
1/9/09 9:00 PM	0.10	0.00	0.10
1/9/09 11:00 PM	0.10	0.00	0.11
1/10/09 1:00 AM	0.09	0.00	0.10
1/10/09 3:00 AM	0.07	0.00	0.10
1/10/09 5:00 AM	0.08	0.00	0.10
1/10/09 7:00 AM	0.08	0.00	0.11
1/10/09 9:00 AM	0.11	0.00	0.11
1/10/09 11:00 AM	0.08	0.00	0.14
1/10/09 1:00 PM	0.00	0.00	0.17
1/10/09 3:00 PM	0.00	0.00	0.13
1/10/09 5:00 PM	0.00	0.00	0.12
1/10/09 7:00 PM	0.00	0.00	0.11
1/10/09 9:00 PM	0.03	0.00	0.10
1/10/09 11:00 PM	0.06	0.00	0.09
1/11/09 1:00 AM	0.10	0.00	0.09
1/11/09 3:00 AM	0.10	0.00	0.08
1/11/09 5:00 AM	0.10	0.00	0.07
1/11/09 7:00 AM	0.10	0.00	0.07
1/11/09 9:00 AM	0.12	0.00	0.07
1/11/09 11:00 AM	0.16	0.00	0.07
1/11/09 1:00 PM	0.09	0.00	0.07
1/11/09 3:00 PM	0.10	0.10	0.07
1/11/09 5:00 PM	0.10	0.10	0.07
1/11/09 7:00 PM	0.10	0.10	0.08
1/11/09 9:00 PM	0.10	0.10	0.08
1/11/09 11:00 PM	0.08	0.00	0.05
1/12/09 1:00 AM	0.09	0.00	0.06
1/12/09 3:00 AM	0.08	0.00	0.06
1/12/09 5:00 AM	0.09	0.00	0.07
1/12/09 7:00 AM	0.18	0.00	0.10
1/12/09 9:00 AM	0.24	0.00	0.15
1/12/09 11:00 AM	0.24	0.00	0.08
1/12/09 1:00 PM	0.25	0.00	0.12
1/12/09 3:00 PM	0.16	0.00	0.11
1/12/09 5:00 PM	0.12	0.00	0.08
1/12/09 7:00 PM	0.12	0.00	0.06
1/12/09 9:00 PM	0.12	0.00	0.05
1/12/09 11:00 PM	0.11	0.00	0.05
1/13/09 1:00 AM	0.11	0.00	0.05
1/13/09 3:00 AM	0.11	0.00	0.04
1/13/09 5:00 AM	0.11	0.00	0.05
1/13/09 7:00 AM	0.12	0.00	0.05
1/13/09 9:00 AM	0.12	0.00	0.08
1/13/09 11:00 AM	0.12	0.00	0.09
1/13/09 1:00 PM	0.11	0.00	0.11
1/13/09 3:00 PM	0.11	0.00	0.09
1/13/09 5:00 PM	0.11	0.00	0.08
1/13/09 7:00 PM	0.11	0.00	0.09
1/13/09 9:00 PM	0.12	0.00	0.07
1/13/09 11:00 PM	0.12	0.00	0.08
1/14/09 1:00 AM	0.11	0.00	0.10
1/14/09 3:00 AM	0.11	0.00	0.11
1/14/09 5:00 AM	0.11	0.00	0.11

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
1/14/09 7:00 AM	0.11	0.00	0.11
1/14/09 9:00 AM	0.12	0.00	0.12
1/14/09 11:00 AM	0.11	0.00	0.14
1/14/09 1:00 PM	0.10	0.00	0.12
1/14/09 3:00 PM	0.10	0.00	0.00
1/14/09 5:00 PM	0.10	0.00	0.00
1/14/09 7:00 PM	0.10	0.00	0.06
1/14/09 9:00 PM	0.10	0.00	0.04
1/14/09 11:00 PM	0.10	0.00	0.09
1/15/09 1:00 AM	0.10	0.00	0.00
1/15/09 3:00 AM	0.09	0.00	0.00
1/15/09 5:00 AM	0.09	0.00	0.00
1/15/09 7:00 AM	0.09	0.00	0.01
1/15/09 9:00 AM	0.10	0.00	0.10
1/15/09 11:00 AM	0.09	0.00	0.13
1/15/09 1:00 PM	0.09	0.00	0.12
1/15/09 3:00 PM	0.09	0.00	0.11
1/15/09 5:00 PM	0.09	0.00	0.09
1/15/09 7:00 PM	0.09	0.00	0.08
1/15/09 9:00 PM	0.09	0.00	0.08
1/15/09 11:00 PM	0.09	0.00	0.07
1/16/09 1:00 AM	0.10	0.00	0.07
1/16/09 3:00 AM	0.09	0.00	0.07
1/16/09 5:00 AM	0.09	0.00	0.07
1/16/09 7:00 AM	0.08	0.00	0.07
1/16/09 9:00 AM	0.08	0.00	0.07
1/16/09 11:00 AM	0.08	0.00	0.07
1/16/09 1:00 PM	0.08	0.00	0.08
1/16/09 3:00 PM	0.07	0.00	0.07
1/16/09 5:00 PM	0.07	0.00	0.08
1/16/09 7:00 PM	0.08	0.00	0.09
1/16/09 9:00 PM	0.08	0.00	0.08
1/16/09 11:00 PM	0.07	0.00	0.08
1/17/09 1:00 AM	0.07	0.00	0.08
1/17/09 3:00 AM	0.07	0.00	0.08
1/17/09 5:00 AM	0.07	0.00	0.08
1/17/09 7:00 AM	0.07	0.00	0.08
1/17/09 9:00 AM	0.07	0.00	0.09
1/17/09 11:00 AM	0.07	0.00	0.09
1/17/09 1:00 PM	0.07	0.00	0.10
1/17/09 3:00 PM	0.07	0.00	0.09
1/17/09 5:00 PM	0.07	0.00	0.09
1/17/09 7:00 PM	0.07	0.00	0.11
1/17/09 9:00 PM	0.07	0.00	0.12
1/17/09 11:00 PM	0.07	0.00	0.12
1/18/09 1:00 AM	0.07	0.00	0.12
1/18/09 3:00 AM	0.07	0.00	0.13
1/18/09 5:00 AM	0.07	0.00	0.14
1/18/09 7:00 AM	0.07	0.00	0.13
1/18/09 9:00 AM	0.08	0.00	0.14
1/18/09 11:00 AM	0.08	0.00	0.16
1/18/09 1:00 PM	0.08	0.00	0.14
1/18/09 3:00 PM	0.08	0.00	0.15

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
1/18/09 5:00 PM	0.08	0.00	0.33
1/18/09 7:00 PM	0.08	0.00	0.33
1/18/09 9:00 PM	0.09	0.00	0.16
1/18/09 11:00 PM	0.09	0.00	0.17
1/19/09 1:00 AM	0.09	0.00	0.17
1/19/09 3:00 AM	0.08	0.00	0.17
1/19/09 5:00 AM	0.07	0.00	0.12
1/19/09 7:00 AM	0.00	0.00	0.08
1/19/09 9:00 AM	0.00	0.00	0.08
1/19/09 11:00 AM	0.00	0.00	0.01
1/19/09 1:00 PM	0.00	0.00	0.00
1/19/09 3:00 PM	0.00	0.00	0.00
1/19/09 5:00 PM	0.00	0.00	0.00
1/19/09 7:00 PM	0.00	0.00	0.00
1/19/09 9:00 PM	0.00	0.00	0.00
1/19/09 11:00 PM	0.00	0.00	0.00
1/20/09 1:00 AM	0.00	0.00	0.00
1/20/09 3:00 AM	0.00	0.00	0.00
1/20/09 5:00 AM	0.00	0.00	0.00
1/20/09 7:00 AM	0.00	0.00	0.00
1/20/09 9:00 AM	0.00	0.00	0.00
1/20/09 11:00 AM	0.00	0.00	0.00
1/20/09 1:00 PM	0.00	0.00	0.00
1/20/09 3:00 PM	0.00	0.00	0.00
1/20/09 5:00 PM	0.00	0.00	0.00
1/20/09 7:00 PM	0.00	0.00	0.00
1/20/09 9:00 PM	0.00	0.00	0.00
1/20/09 11:00 PM	0.03	0.00	0.00
1/21/09 1:00 AM	0.10	0.00	0.00
1/21/09 3:00 AM	0.14	0.00	0.00
1/21/09 5:00 AM	0.14	0.00	0.00
1/21/09 7:00 AM	0.14	0.00	0.00
1/21/09 9:00 AM	0.13	0.00	0.00
1/21/09 11:00 AM	0.00	0.00	0.00
1/21/09 1:00 PM	0.00	0.00	0.00
1/21/09 3:00 PM	0.02	0.00	0.00
1/21/09 5:00 PM	0.09	0.00	0.00
1/21/09 7:00 PM	0.00	0.00	0.00
1/21/09 9:00 PM	0.00	0.00	0.00
1/21/09 11:00 PM	0.07	0.00	0.00
1/22/09 1:00 AM	0.18	0.00	0.00
1/22/09 3:00 AM	0.29	0.00	0.00
1/22/09 5:00 AM	0.28	0.00	0.02
1/22/09 7:00 AM	0.25	0.00	0.19
1/22/09 9:00 AM	0.26	0.00	0.26
1/22/09 11:00 AM	0.24	0.00	0.19
1/22/09 1:00 PM	0.24	0.00	0.21
1/22/09 3:00 PM	0.24	0.00	0.20
1/22/09 5:00 PM	0.24	0.00	0.19
1/22/09 7:00 PM	0.24	0.00	0.17
1/22/09 9:00 PM	0.22	0.00	0.16
1/22/09 11:00 PM	0.23	0.00	0.16
1/23/09 1:00 AM	0.23	0.00	0.15

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
1/23/09 3:00 AM	0.24	0.00	0.13
1/23/09 5:00 AM	0.23	0.00	0.11
1/23/09 7:00 AM	0.24	0.00	0.11
1/23/09 9:00 AM	0.24	0.00	0.11
1/23/09 11:00 AM	0.23	0.00	0.10
1/23/09 1:00 PM	0.23	0.00	0.09
1/23/09 3:00 PM	0.24	0.00	0.12
1/23/09 5:00 PM	0.25	0.00	0.13
1/23/09 7:00 PM	0.24	0.00	0.14
1/23/09 9:00 PM	0.23	0.00	0.13
1/23/09 11:00 PM	0.23	0.00	0.13
1/24/09 1:00 AM	0.21	0.00	0.16
1/24/09 3:00 AM	0.21	0.00	0.16
1/24/09 5:00 AM	0.20	0.00	0.14
1/24/09 7:00 AM	0.25	0.00	0.16
1/24/09 9:00 AM	0.24	0.00	0.16
1/24/09 11:00 AM	0.24	0.00	0.13
1/24/09 1:00 PM	0.24	0.00	0.13
1/24/09 3:00 PM	0.24	0.00	0.12
1/24/09 5:00 PM	0.25	0.00	0.13
1/24/09 7:00 PM	0.24	0.00	0.13
1/24/09 9:00 PM	0.23	0.00	0.13
1/24/09 11:00 PM	0.21	0.00	0.15
1/25/09 1:00 AM	0.19	0.00	0.13
1/25/09 3:00 AM	0.18	0.00	0.14
1/25/09 5:00 AM	0.18	0.00	0.15
1/25/09 7:00 AM	0.22	0.00	0.15
1/25/09 9:00 AM	0.23	0.00	0.15
1/25/09 11:00 AM	0.23	0.00	0.15
1/25/09 1:00 PM	0.23	0.00	0.14
1/25/09 3:00 PM	0.22	0.00	0.10
1/25/09 5:00 PM	0.22	0.00	0.11
1/25/09 7:00 PM	0.23	0.00	0.15
1/25/09 9:00 PM	0.22	0.00	0.17
1/25/09 11:00 PM	0.22	0.00	0.15
1/26/09 1:00 AM	0.21	0.00	0.16
1/26/09 3:00 AM	0.21	0.00	0.12
1/26/09 5:00 AM	0.22	0.00	0.15
1/26/09 7:00 AM	0.21	0.00	0.19
1/26/09 9:00 AM	0.22	0.00	0.18
1/26/09 11:00 AM	0.21	0.00	0.34
1/26/09 1:00 PM	0.22	0.00	0.13
1/26/09 3:00 PM	0.25	0.00	0.15
1/26/09 5:00 PM	0.27	0.00	0.13
1/26/09 7:00 PM	0.25	0.00	0.13
1/26/09 9:00 PM	0.23	0.00	0.13
1/26/09 11:00 PM	0.25	0.00	0.14
1/27/09 1:00 AM	0.27	0.00	0.15
1/27/09 3:00 AM	0.27	0.00	0.11
1/27/09 5:00 AM	0.27	0.00	0.11
1/27/09 7:00 AM	0.27	0.00	0.11
1/27/09 9:00 AM	0.26	0.00	0.11
1/27/09 11:00 AM	0.24	0.00	0.10

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
1/27/09 1:00 PM	0.24	0.00	0.10
1/27/09 3:00 PM	0.24	0.00	0.10
1/27/09 5:00 PM	0.24	0.00	0.10
1/27/09 7:00 PM	0.23	0.00	0.11
1/27/09 9:00 PM	0.23	0.00	0.10
1/27/09 11:00 PM	0.21	0.00	0.11
1/28/09 1:00 AM	0.20	0.00	0.09
1/28/09 3:00 AM	0.20	0.00	0.08
1/28/09 5:00 AM	0.20	0.00	0.10
1/28/09 7:00 AM	0.21	0.00	0.13
1/28/09 9:00 AM	0.22	0.00	0.16
1/28/09 11:00 AM	0.21	0.00	0.14
1/28/09 1:00 PM	0.21	0.00	0.12
1/28/09 3:00 PM	0.21	0.00	0.13
1/28/09 5:00 PM	0.21	0.00	0.13
1/28/09 7:00 PM	0.21	0.00	0.14
1/28/09 9:00 PM	0.21	0.00	0.14
1/28/09 11:00 PM	0.20	0.00	0.09
1/29/09 1:00 AM	0.18	0.00	0.05
1/29/09 3:00 AM	0.19	0.00	0.05
1/29/09 5:00 AM	0.19	0.00	0.05
1/29/09 7:00 AM	0.24	0.00	0.05
1/29/09 9:00 AM	0.18	0.00	0.08
1/29/09 11:00 AM	0.17	0.00	0.12
1/29/09 1:00 PM	0.19	0.00	0.13
1/29/09 3:00 PM	0.18	0.00	0.15
1/29/09 5:00 PM	0.19	0.00	0.15
1/29/09 7:00 PM	0.17	0.00	0.15
1/29/09 9:00 PM	0.17	0.00	0.14
1/29/09 11:00 PM	0.16	0.00	0.13
1/30/09 1:00 AM	0.14	0.00	0.09
1/30/09 3:00 AM	0.12	0.00	0.07
1/30/09 5:00 AM	0.13	0.00	0.07
1/30/09 7:00 AM	0.16	0.00	0.10
1/30/09 9:00 AM	0.18	0.00	0.10
1/30/09 11:00 AM	0.16	0.00	0.09
1/30/09 1:00 PM	0.15	0.00	0.09
1/30/09 3:00 PM	0.15	0.00	0.08
1/30/09 5:00 PM	0.15	0.00	0.08
1/30/09 7:00 PM	0.16	0.00	0.08
1/30/09 9:00 PM	0.16	0.00	0.08
1/30/09 11:00 PM	0.17	0.00	0.08
1/31/09 1:00 AM	0.16	0.00	0.08
1/31/09 3:00 AM	0.16	0.00	0.08
1/31/09 5:00 AM	0.16	0.00	0.08
1/31/09 7:00 AM	0.17	0.00	0.08
1/31/09 9:00 AM	0.17	0.00	0.08
1/31/09 11:00 AM	0.17	0.00	0.08
1/31/09 1:00 PM	0.17	0.00	0.08
1/31/09 3:00 PM	0.40	0.00	0.09
1/31/09 5:00 PM	0.23	0.00	0.10
1/31/09 7:00 PM	0.14	0.00	0.09
1/31/09 9:00 PM	0.16	0.00	0.10

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
1/31/09 11:00 PM	0.17	0.00	0.11
2/1/09 1:00 AM	0.18	0.00	0.11
2/1/09 3:00 AM	0.17	0.00	0.12
2/1/09 5:00 AM	0.18	0.00	0.11
2/1/09 7:00 AM	0.18	0.00	0.12
2/1/09 9:00 AM	0.18	0.00	0.11
2/1/09 11:00 AM	0.17	0.00	0.11
2/1/09 1:00 PM	0.17	0.00	0.12
2/1/09 3:00 PM	0.17	0.00	0.12
2/1/09 5:00 PM	0.17	0.00	0.11
2/1/09 7:00 PM	0.17	0.00	0.11
2/1/09 9:00 PM	0.17	0.00	0.11
2/1/09 11:00 PM	0.17	0.00	0.11
2/2/09 1:00 AM	0.17	0.00	0.12
2/2/09 3:00 AM	0.18	0.00	0.12
2/2/09 5:00 AM	0.18	0.00	0.13
2/2/09 7:00 AM	0.18	0.00	0.13
2/2/09 9:00 AM	0.16	0.00	0.13
2/2/09 11:00 AM	0.15	0.00	0.13
2/2/09 1:00 PM	0.15	0.00	0.14
2/2/09 3:00 PM	0.18	0.00	0.14
2/2/09 5:00 PM	0.19	0.00	0.13
2/2/09 7:00 PM	0.19	0.00	0.13
2/2/09 9:00 PM	0.18	0.00	0.12
2/2/09 11:00 PM	0.18	0.00	0.12
2/3/09 1:00 AM	0.17	0.00	0.13
2/3/09 3:00 AM	0.17	0.00	0.13
2/3/09 5:00 AM	0.18	0.00	0.13
2/3/09 7:00 AM	0.18	0.00	0.12
2/3/09 9:00 AM	0.18	0.00	0.10
2/3/09 11:00 AM	0.18	0.00	0.06
2/3/09 1:00 PM	0.17	0.00	0.06
2/3/09 3:00 PM	0.17	0.00	0.05
2/3/09 5:00 PM	0.18	0.00	0.04
2/3/09 7:00 PM	0.18	0.00	0.06
2/3/09 9:00 PM	0.18	0.00	0.10
2/3/09 11:00 PM	0.17	0.00	0.10
2/4/09 1:00 AM	0.17	0.00	0.11
2/4/09 3:00 AM	0.17	0.00	0.11
2/4/09 5:00 AM	0.18	0.00	0.11
2/4/09 7:00 AM	0.18	0.00	0.11
2/4/09 9:00 AM	0.20	0.00	0.12
2/4/09 11:00 AM	0.20	0.00	0.11
2/4/09 1:00 PM	0.22	0.00	0.11
2/4/09 3:00 PM	0.22	0.00	0.12
2/4/09 5:00 PM	0.21	0.00	0.11
2/4/09 7:00 PM	0.21	0.00	0.10
2/4/09 9:00 PM	0.22	0.00	0.12
2/4/09 11:00 PM	0.21	0.00	0.12
2/5/09 1:00 AM	0.20	0.00	0.11
2/5/09 3:00 AM	0.21	0.00	0.11
2/5/09 5:00 AM	0.21	0.00	0.11
2/5/09 7:00 AM	0.21	0.00	0.13

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
2/5/09 9:00 AM	0.21	0.00	0.16
2/5/09 11:00 AM	0.20	0.00	0.16
2/5/09 1:00 PM	0.20	0.00	0.17
2/5/09 3:00 PM	0.19	0.00	0.12
2/5/09 5:00 PM	0.19	0.00	0.11
2/5/09 7:00 PM	0.19	0.00	0.12
2/5/09 9:00 PM	0.19	0.00	0.12
2/5/09 11:00 PM	0.19	0.00	0.12
2/6/09 1:00 AM	0.19	0.00	0.11
2/6/09 3:00 AM	0.19	0.00	0.12
2/6/09 5:00 AM	0.20	0.00	0.12
2/6/09 7:00 AM	0.20	0.00	0.11
2/6/09 9:00 AM	0.18	0.00	0.11
2/6/09 11:00 AM	0.18	0.00	0.08
2/6/09 1:00 PM	0.18	0.00	0.05
2/6/09 3:00 PM	0.18	0.00	0.05
2/6/09 5:00 PM	0.18	0.00	0.06
2/6/09 7:00 PM	0.17	0.00	0.09
2/6/09 9:00 PM	0.18	0.00	0.10
2/6/09 11:00 PM	0.19	0.00	0.10
2/7/09 1:00 AM	0.19	0.00	0.10
2/7/09 3:00 AM	0.19	0.00	0.11
2/7/09 5:00 AM	0.20	0.00	0.10
2/7/09 7:00 AM	0.20	0.00	0.11
2/7/09 9:00 AM	0.20	0.00	0.12
2/7/09 11:00 AM	0.20	0.00	0.11
2/7/09 1:00 PM	0.19	0.00	0.11
2/7/09 3:00 PM	0.20	0.00	0.12
2/7/09 5:00 PM	0.27	0.00	0.11
2/7/09 7:00 PM	0.30	0.00	0.11
2/7/09 9:00 PM	0.26	0.00	0.11
2/7/09 11:00 PM	0.26	0.00	0.12
2/8/09 1:00 AM	0.26	0.00	0.12
2/8/09 3:00 AM	0.26	0.00	0.13
2/8/09 5:00 AM	0.26	0.00	0.13
2/8/09 7:00 AM	0.27	0.00	0.14
2/8/09 9:00 AM	0.29	0.00	0.14
2/8/09 11:00 AM	0.27	0.00	0.13
2/8/09 1:00 PM	0.27	0.00	0.12
2/8/09 3:00 PM	0.27	0.00	0.12
2/8/09 5:00 PM	0.27	0.00	0.12
2/8/09 7:00 PM	0.28	0.00	0.12
2/8/09 9:00 PM	0.20	0.00	0.12
2/8/09 11:00 PM	0.10	0.00	0.11
2/9/09 1:00 AM	0.00	0.00	0.11
2/9/09 3:00 AM	0.00	0.00	0.11
2/9/09 5:00 AM	0.00	0.00	0.11
2/9/09 7:00 AM	0.00	0.00	0.11
2/9/09 9:00 AM	0.00	0.00	0.10
2/9/09 11:00 AM	0.00	0.00	0.10
2/9/09 1:00 PM	0.00	0.00	0.11
2/9/09 3:00 PM	0.00	0.00	0.10
2/9/09 5:00 PM	0.00	0.00	0.10

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
2/9/09 7:00 PM	0.00	0.00	0.10
2/9/09 9:00 PM	0.00	0.00	0.10
2/9/09 11:00 PM	0.00	0.00	0.10
2/10/09 1:00 AM	0.00	0.00	0.91
2/10/09 3:00 AM	0.00	0.00	0.09
2/10/09 5:00 AM	0.00	0.00	0.09
2/10/09 7:00 AM	0.00	0.00	0.10
2/10/09 9:00 AM	0.00	0.00	0.09
2/10/09 11:00 AM	0.00	0.00	0.09
2/10/09 1:00 PM	0.00	0.00	0.09
2/10/09 3:00 PM	0.00	0.00	0.09
2/10/09 5:00 PM	0.00	0.00	0.09
2/10/09 7:00 PM	0.00	0.00	0.11
2/10/09 9:00 PM	0.00	0.00	0.09
2/10/09 11:00 PM	0.00	0.00	0.08
2/11/09 1:00 AM	0.00	0.00	0.08
2/11/09 3:00 AM	0.00	0.00	0.08
2/11/09 5:00 AM	0.00	0.00	0.08
2/11/09 7:00 AM	0.00	0.00	0.08
2/11/09 9:00 AM	0.00	0.00	0.09
2/11/09 11:00 AM	0.00	0.00	0.10
2/11/09 1:00 PM	0.00	0.00	0.09
2/11/09 3:00 PM	0.00	0.00	0.09
2/11/09 5:00 PM	0.00	0.00	0.09
2/11/09 7:00 PM	0.00	0.00	0.09
2/11/09 9:00 PM	0.00	0.00	0.09
2/11/09 11:00 PM	0.00	0.00	0.09
2/12/09 1:00 AM	0.00	0.00	0.09
2/12/09 3:00 AM	0.00	0.00	0.09
2/12/09 5:00 AM	0.00	0.00	0.08
2/12/09 7:00 AM	0.00	0.00	0.08
2/12/09 9:00 AM	0.00	0.00	0.09
2/12/09 11:00 AM	0.00	0.00	0.12
2/12/09 1:00 PM	0.00	0.00	0.09
2/12/09 3:00 PM	0.00	0.00	0.09
2/12/09 5:00 PM	0.00	0.00	0.09
2/12/09 7:00 PM	0.00	0.00	0.10
2/12/09 9:00 PM	0.00	0.00	0.11
2/12/09 11:00 PM	0.00	0.00	0.12
2/13/09 1:00 AM	0.00	0.00	0.12
2/13/09 3:00 AM	0.00	0.00	0.12
2/13/09 5:00 AM	0.00	0.00	0.12
2/13/09 7:00 AM	0.00	0.00	0.13
2/13/09 9:00 AM	0.00	0.00	0.11
2/13/09 11:00 AM	0.00	0.00	0.09
2/13/09 1:00 PM	0.00	0.00	0.10
2/13/09 3:00 PM	0.00	0.00	0.11
2/13/09 5:00 PM	0.00	0.00	0.12
2/13/09 7:00 PM	0.00	0.00	0.12
2/13/09 9:00 PM	0.00	0.00	0.13
2/13/09 11:00 PM	0.00	0.00	0.12
2/14/09 1:00 AM	0.00	0.00	0.12
2/14/09 3:00 AM	0.00	0.00	0.12

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
2/14/09 5:00 AM	0.00	0.00	0.13
2/14/09 7:00 AM	0.00	0.00	0.13
2/14/09 9:00 AM	0.00	0.00	0.13
2/14/09 11:00 AM	0.00	0.00	0.13
2/14/09 1:00 PM	0.00	0.00	0.13
2/14/09 3:00 PM	0.00	0.00	0.13
2/14/09 5:00 PM	0.00	0.00	0.14
2/14/09 7:00 PM	0.00	0.00	0.14
2/14/09 9:00 PM	0.00	0.00	0.14
2/14/09 11:00 PM	0.00	0.00	0.15
2/15/09 1:00 AM	0.00	0.00	0.15
2/15/09 3:00 AM	0.00	0.00	0.16
2/15/09 5:00 AM	0.00	0.00	0.16
2/15/09 7:00 AM	0.00	0.00	0.16
2/15/09 9:00 AM	0.00	0.00	0.16
2/15/09 11:00 AM	0.00	0.00	0.17
2/15/09 1:00 PM	0.00	0.00	0.17
2/15/09 3:00 PM	0.00	0.00	0.17
2/15/09 5:00 PM	0.00	0.00	0.17
2/15/09 7:00 PM	0.00	0.00	0.17
2/15/09 9:00 PM	0.00	0.00	0.17
2/15/09 11:00 PM	0.00	0.00	0.18
2/16/09 1:00 AM	0.00	0.00	0.17
2/16/09 3:00 AM	0.00	0.00	0.17
2/16/09 5:00 AM	0.00	0.00	0.17
2/16/09 7:00 AM	0.00	0.00	0.17
2/16/09 9:00 AM	0.00	0.00	0.15
2/16/09 11:00 AM	0.00	0.00	0.15
2/16/09 1:00 PM	0.00	0.00	0.21
2/16/09 3:00 PM	0.00	0.00	0.15
2/16/09 5:00 PM	0.00	0.00	0.09
2/16/09 7:00 PM	0.00	0.00	0.14
2/16/09 9:00 PM	0.00	0.00	0.07
2/16/09 11:00 PM	0.00	0.00	0.07
2/17/09 1:00 AM	0.00	0.00	0.08
2/17/09 3:00 AM	0.24	0.00	0.08
2/17/09 5:00 AM	0.24	0.00	0.09
2/17/09 7:00 AM	0.24	0.00	0.09
2/17/09 9:00 AM	0.25	0.00	0.11
2/17/09 11:00 AM	0.23	0.00	0.11
2/17/09 1:00 PM	0.22	0.00	0.11
2/17/09 3:00 PM	0.22	0.00	0.54
2/17/09 5:00 PM	0.21	0.00	0.13
2/17/09 7:00 PM	0.20	0.00	0.14
2/17/09 9:00 PM	0.19	0.00	0.12
2/17/09 11:00 PM	0.19	0.00	0.11
2/18/09 1:00 AM	0.18	0.00	0.12
2/18/09 3:00 AM	0.17	0.00	0.12
2/18/09 5:00 AM	0.18	0.00	0.12
2/18/09 7:00 AM	0.17	0.00	0.13
2/18/09 9:00 AM	0.18	0.00	0.12
2/18/09 11:00 AM	0.18	0.00	0.12
2/18/09 1:00 PM	0.18	0.00	0.12

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
2/18/09 3:00 PM	0.18	0.00	0.12
2/18/09 5:00 PM	0.18	0.00	0.12
2/18/09 7:00 PM	0.18	0.00	0.16
2/18/09 9:00 PM	0.18	0.00	0.16
2/18/09 11:00 PM	0.17	0.00	0.11
2/19/09 1:00 AM	0.17	0.00	0.08
2/19/09 3:00 AM	0.17	0.00	0.06
2/19/09 5:00 AM	0.17	0.00	0.05
2/19/09 7:00 AM	0.17	0.00	0.09
2/19/09 9:00 AM	0.18	0.00	0.12
2/19/09 11:00 AM	0.17	0.00	0.16
2/19/09 1:00 PM	0.17	0.00	0.16
2/19/09 3:00 PM	0.17	0.00	0.17
2/19/09 5:00 PM	0.16	0.00	0.15
2/19/09 7:00 PM	0.16	0.00	0.15
2/19/09 9:00 PM	0.16	0.00	0.16
2/19/09 11:00 PM	0.16	0.00	0.15
2/20/09 1:00 AM	0.16	0.00	0.15
2/20/09 3:00 AM	0.16	0.00	0.14
2/20/09 5:00 AM	0.15	0.00	0.15
2/20/09 7:00 AM	0.16	0.00	0.16
2/20/09 9:00 AM	0.17	0.00	0.15
2/20/09 11:00 AM	0.16	0.00	0.15
2/20/09 1:00 PM	0.16	0.00	0.16
2/20/09 3:00 PM	0.16	0.00	0.15
2/20/09 5:00 PM	0.16	0.00	0.14
2/20/09 7:00 PM	0.16	0.00	0.03
2/20/09 9:00 PM	0.15	0.00	0.00
2/20/09 11:00 PM	0.15	0.00	0.00
2/21/09 1:00 AM	0.15	0.00	0.00
2/21/09 3:00 AM	0.15	0.00	0.00
2/21/09 5:00 AM	0.15	0.00	0.00
2/21/09 7:00 AM	0.15	0.00	0.00
2/21/09 9:00 AM	0.16	0.00	0.00
2/21/09 11:00 AM	0.15	0.00	0.00
2/21/09 1:00 PM	0.15	0.00	0.00
2/21/09 3:00 PM	0.15	0.00	0.00
2/21/09 5:00 PM	0.15	0.00	0.00
2/21/09 7:00 PM	0.15	0.00	0.00
2/21/09 9:00 PM	0.15	0.00	0.00
2/21/09 11:00 PM	0.15	0.00	0.00
2/22/09 1:00 AM	0.15	0.00	0.00
2/22/09 3:00 AM	0.15	0.00	0.00
2/22/09 5:00 AM	0.15	0.00	0.02
2/22/09 7:00 AM	0.15	0.00	0.04
2/22/09 9:00 AM	0.16	0.00	0.06
2/22/09 11:00 AM	0.15	0.00	0.07
2/22/09 1:00 PM	0.15	0.00	0.07
2/22/09 3:00 PM	0.15	0.00	0.09
2/22/09 5:00 PM	0.15	0.00	0.09
2/22/09 7:00 PM	0.15	0.00	0.07
2/22/09 9:00 PM	0.15	0.00	0.07
2/22/09 11:00 PM	0.09	0.00	0.08

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
2/23/09 1:00 AM	0.08	0.00	0.08
2/23/09 3:00 AM	0.07	0.00	0.09
2/23/09 5:00 AM	0.12	0.00	0.08
2/23/09 7:00 AM	0.14	0.00	0.09
2/23/09 9:00 AM	0.14	0.00	0.09
2/23/09 11:00 AM	0.14	0.00	0.08
2/23/09 1:00 PM	0.14	0.00	0.08
2/23/09 3:00 PM	0.14	0.00	0.08
2/23/09 5:00 PM	0.14	0.00	0.09
2/23/09 7:00 PM	0.14	0.00	0.09
2/23/09 9:00 PM	0.14	0.00	0.09
2/23/09 11:00 PM	0.13	0.00	0.10
2/24/09 1:00 AM	0.14	0.00	0.09
2/24/09 3:00 AM	0.14	0.00	0.09
2/24/09 5:00 AM	0.13	0.00	0.09
2/24/09 7:00 AM	0.13	0.00	0.10
2/24/09 9:00 AM	0.13	0.00	0.10
2/24/09 11:00 AM	0.12	0.00	0.09
2/24/09 1:00 PM	0.16	0.00	0.09
2/24/09 3:00 PM	0.18	0.00	0.08
2/24/09 5:00 PM	0.14	0.00	0.09
2/24/09 7:00 PM	0.12	0.00	0.09
2/24/09 9:00 PM	0.12	0.00	0.09
2/24/09 11:00 PM	0.10	0.00	0.09
2/25/09 1:00 AM	0.09	0.00	0.07
2/25/09 3:00 AM	0.10	0.00	0.06
2/25/09 5:00 AM	0.10	0.00	0.06
2/25/09 7:00 AM	0.12	0.00	0.10
2/25/09 9:00 AM	0.13	0.00	0.10
2/25/09 11:00 AM	0.12	0.00	0.10
2/25/09 1:00 PM	0.12	0.00	0.10
2/25/09 3:00 PM	0.12	0.00	0.10
2/25/09 5:00 PM	0.12	0.00	0.10
2/25/09 7:00 PM	0.12	0.00	0.09
2/25/09 9:00 PM	0.11	0.00	0.10
2/25/09 11:00 PM	0.11	0.00	0.07
2/26/09 1:00 AM	0.11	0.00	0.06
2/26/09 3:00 AM	0.11	0.00	0.07
2/26/09 5:00 AM	0.11	0.00	0.09
2/26/09 7:00 AM	0.11	0.00	0.12
2/26/09 9:00 AM	0.11	0.00	0.10
2/26/09 11:00 AM	0.11	0.00	0.10
2/26/09 1:00 PM	0.11	0.00	0.10
2/26/09 3:00 PM	0.11	0.00	0.10
2/26/09 5:00 PM	0.11	0.00	0.11
2/26/09 7:00 PM	0.10	0.00	0.14
2/26/09 9:00 PM	0.10	0.00	0.16
2/26/09 11:00 PM	0.10	0.00	0.16
2/27/09 1:00 AM	0.10	0.00	0.15
2/27/09 3:00 AM	0.09	0.00	0.14
2/27/09 5:00 AM	0.10	0.00	0.16
2/27/09 7:00 AM	0.10	0.00	0.13
2/27/09 9:00 AM	0.11	0.00	0.14

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
2/27/09 11:00 AM	0.10	0.00	0.16
2/27/09 1:00 PM	0.10	0.00	0.15
2/27/09 3:00 PM	0.10	0.00	0.15
2/27/09 5:00 PM	0.10	0.00	0.16
2/27/09 7:00 PM	0.10	0.00	0.17
2/27/09 9:00 PM	0.10	0.00	0.17
2/27/09 11:00 PM	0.10	0.00	0.18
2/28/09 1:00 AM	0.10	0.00	0.16
2/28/09 3:00 AM	0.10	0.00	0.16
2/28/09 5:00 AM	0.11	0.00	0.18
2/28/09 7:00 AM	0.11	0.00	0.18
2/28/09 9:00 AM	0.11	0.00	0.17
2/28/09 11:00 AM	0.00	0.00	0.18
2/28/09 1:00 PM	0.00	0.00	0.19
2/28/09 3:00 PM	0.00	0.00	0.19
2/28/09 5:00 PM	0.00	0.00	0.19
2/28/09 7:00 PM	0.00	0.00	0.19
2/28/09 9:00 PM	0.06	0.00	0.21
2/28/09 11:00 PM	0.12	0.00	0.21
3/1/09 1:00 AM	0.13	0.00	0.15
3/1/09 3:00 AM	0.12	0.00	0.14
3/1/09 5:00 AM	0.12	0.00	0.14
3/1/09 7:00 AM	0.11	0.00	0.07
3/1/09 9:00 AM	0.12	0.00	0.09
3/1/09 11:00 AM	0.11	0.00	0.09
3/1/09 1:00 PM	0.11	0.00	0.08
3/1/09 3:00 PM	0.10	0.00	0.07
3/1/09 5:00 PM	0.10	0.00	0.07
3/1/09 7:00 PM	0.11	0.00	0.08
3/1/09 9:00 PM	0.11	0.00	0.08
3/1/09 11:00 PM	0.10	0.00	0.08
3/2/09 1:00 AM	0.12	0.00	0.09
3/2/09 3:00 AM	0.10	0.00	0.09
3/2/09 5:00 AM	0.10	0.00	0.08
3/2/09 7:00 AM	0.10	0.00	0.09
3/2/09 9:00 AM	0.11	0.00	0.12
3/2/09 11:00 AM	0.10	0.00	0.11
3/2/09 1:00 PM	0.10	0.00	0.08
3/2/09 3:00 PM	0.10	0.00	0.08
3/2/09 5:00 PM	0.10	0.00	0.07
3/2/09 7:00 PM	0.10	0.00	0.08
3/2/09 9:00 PM	0.09	0.00	0.09
3/2/09 11:00 PM	0.10	0.00	0.09
3/3/09 1:00 AM	0.10	0.00	0.09
3/3/09 3:00 AM	0.10	0.00	0.09
3/3/09 5:00 AM	0.10	0.00	0.10
3/3/09 7:00 AM	0.10	0.00	0.10
3/3/09 9:00 AM	0.10	0.00	0.10
3/3/09 11:00 AM	0.10	0.00	0.09
3/3/09 1:00 PM	0.09	0.00	0.09
3/3/09 3:00 PM	0.09	0.00	0.09
3/3/09 5:00 PM	0.09	0.00	0.10
3/3/09 7:00 PM	0.10	0.00	0.10

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
3/3/09 9:00 PM	0.10	0.00	0.11
3/3/09 11:00 PM	0.10	0.00	0.11
3/4/09 1:00 AM	0.10	0.00	0.12
3/4/09 3:00 AM	0.10	0.00	0.12
3/4/09 5:00 AM	0.10	0.00	0.12
3/4/09 7:00 AM	0.11	0.00	0.13
3/4/09 9:00 AM	0.11	0.00	0.13
3/4/09 11:00 AM	0.11	0.00	0.13
3/4/09 1:00 PM	0.11	0.00	0.14
3/4/09 3:00 PM	0.10	0.00	0.14
3/4/09 5:00 PM	0.10	0.00	0.13
3/4/09 7:00 PM	0.10	0.00	0.13
3/4/09 9:00 PM	0.10	0.00	0.13
3/4/09 11:00 PM	0.10	0.00	0.13
3/5/09 1:00 AM	0.13	0.00	0.14
3/5/09 3:00 AM	0.10	0.00	0.14
3/5/09 5:00 AM	0.09	0.00	0.13
3/5/09 7:00 AM	0.10	0.00	0.12
3/5/09 9:00 AM	0.10	0.00	0.10
3/5/09 11:00 AM	0.11	0.00	0.10
3/5/09 1:00 PM	0.19	0.00	0.09
3/5/09 3:00 PM	0.10	0.00	0.10
3/5/09 5:00 PM	0.08	0.00	0.10
3/5/09 7:00 PM	0.08	0.00	0.09
3/5/09 9:00 PM	0.07	0.00	0.07
3/5/09 11:00 PM	0.07	0.00	0.05
3/6/09 1:00 AM	0.08	0.00	0.03
3/6/09 3:00 AM	0.07	0.00	0.03
3/6/09 5:00 AM	0.08	0.00	0.04
3/6/09 7:00 AM	0.07	0.00	0.04
3/6/09 9:00 AM	0.09	0.00	0.06
3/6/09 11:00 AM	0.08	0.00	0.06
3/6/09 1:00 PM	0.08	0.00	0.06
3/6/09 3:00 PM	0.09	0.00	0.10
3/6/09 5:00 PM	0.08	0.00	0.12
3/6/09 7:00 PM	0.08	0.00	0.12
3/6/09 9:00 PM	0.08	0.00	0.11
3/6/09 11:00 PM	0.07	0.00	0.10
3/7/09 1:00 AM	0.07	0.00	0.08
3/7/09 3:00 AM	0.07	0.00	0.07
3/7/09 5:00 AM	0.07	0.00	0.07
3/7/09 7:00 AM	0.07	0.00	0.05
3/7/09 9:00 AM	0.08	0.00	0.05
3/7/09 11:00 AM	0.08	0.00	0.06
3/7/09 1:00 PM	0.07	0.00	0.06
3/7/09 3:00 PM	0.07	0.00	0.05
3/7/09 5:00 PM	0.07	0.00	0.05
3/7/09 7:00 PM	0.07	0.00	0.06
3/7/09 9:00 PM	0.07	0.00	0.06
3/7/09 11:00 PM	0.07	0.00	0.06
3/8/09 1:00 AM	0.07	0.00	0.06
3/8/09 3:00 AM	0.07	0.00	0.06
3/8/09 5:00 AM	0.07	0.00	0.05

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
3/8/09 7:00 AM	0.07	0.00	0.06
3/8/09 9:00 AM	0.08	0.00	0.07
3/8/09 11:00 AM	0.07	0.00	0.07
3/8/09 1:00 PM	0.07	0.00	0.07
3/8/09 3:00 PM	0.07	0.00	0.07
3/8/09 5:00 PM	0.07	0.00	0.07
3/8/09 7:00 PM	0.07	0.00	0.07
3/8/09 9:00 PM	0.07	0.00	0.07
3/8/09 11:00 PM	0.07	0.00	0.07
3/9/09 1:00 AM	0.07	0.00	0.08
3/9/09 3:00 AM	0.07	0.00	0.08
3/9/09 5:00 AM	0.07	0.00	0.08
3/9/09 7:00 AM	0.07	0.00	0.09
3/9/09 9:00 AM	0.07	0.00	0.10
3/9/09 11:00 AM	0.07	0.00	0.11
3/9/09 1:00 PM	0.09	0.00	0.10
3/9/09 3:00 PM	0.18	0.00	0.11
3/9/09 5:00 PM	0.16	0.00	0.11
3/9/09 7:00 PM	0.17	0.00	0.12
3/9/09 9:00 PM	0.17	0.00	0.11
3/9/09 11:00 PM	0.16	0.00	0.14
3/10/09 1:00 AM	0.06	0.00	0.15
3/10/09 3:00 AM	0.06	0.00	0.11
3/10/09 5:00 AM	0.06	0.00	0.11
3/10/09 7:00 AM	0.07	0.00	0.12
3/10/09 9:00 AM	0.08	0.00	0.12
3/10/09 11:00 AM	0.07	0.00	0.11
3/10/09 1:00 PM	0.06	0.00	0.11
3/10/09 3:00 PM	0.06	0.00	0.11
3/10/09 5:00 PM	0.06	0.00	0.09
3/10/09 7:00 PM	0.06	0.00	0.09
3/10/09 9:00 PM	0.04	0.00	0.08
3/10/09 11:00 PM	0.04	0.00	0.08
3/11/09 1:00 AM	0.00	0.00	0.09
3/11/09 3:00 AM	0.00	0.00	0.09
3/11/09 5:00 AM	0.00	0.00	0.09
3/11/09 7:00 AM	0.00	0.00	0.10
3/11/09 9:00 AM	0.00	0.00	0.10
3/11/09 11:00 AM	0.00	0.00	0.10
3/11/09 1:00 PM	0.00	0.00	0.06
3/11/09 3:00 PM	0.00	0.00	0.11
3/11/09 5:00 PM	0.00	0.00	0.12
3/11/09 7:00 PM	0.00	0.00	0.11
3/11/09 9:00 PM	0.00	0.00	0.09
3/11/09 11:00 PM	0.00	0.00	0.08
3/12/09 1:00 AM	0.00	0.00	0.06
3/12/09 3:00 AM	0.00	0.00	0.06
3/12/09 5:00 AM	0.00	0.00	0.10
3/12/09 7:00 AM	0.00	0.00	0.11
3/12/09 9:00 AM	0.00	0.00	0.09
3/12/09 11:00 AM	0.00	0.00	0.09
3/12/09 1:00 PM	0.00	0.00	0.09
3/12/09 3:00 PM	0.00	0.00	0.09

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
3/12/09 5:00 PM	0.00	0.00	0.09
3/12/09 7:00 PM	0.00	0.00	0.10
3/12/09 9:00 PM	0.00	0.00	0.10
3/12/09 11:00 PM	0.00	0.00	0.08
3/13/09 1:00 AM	0.00	0.00	0.05
3/13/09 3:00 AM	0.00	0.00	0.09
3/13/09 5:00 AM	0.00	0.00	0.08
3/13/09 7:00 AM	0.00	0.00	0.09
3/13/09 9:00 AM	0.00	0.00	0.09
3/13/09 11:00 AM	0.00	0.00	0.09
3/13/09 1:00 PM	0.00	0.00	0.09
3/13/09 3:00 PM	0.00	0.00	0.09
3/13/09 5:00 PM	0.00	0.00	0.08
3/13/09 7:00 PM	0.00	0.00	0.07
3/13/09 9:00 PM	0.00	0.00	0.07
3/13/09 11:00 PM	0.00	0.00	0.07
3/14/09 1:00 AM	0.00	0.00	0.07
3/14/09 3:00 AM	0.00	0.00	0.07
3/14/09 5:00 AM	0.00	0.00	0.07
3/14/09 7:00 AM	0.00	0.00	0.07
3/14/09 9:00 AM	0.00	0.00	0.07
3/14/09 11:00 AM	0.00	0.00	0.07
3/14/09 1:00 PM	0.00	0.00	0.07
3/14/09 3:00 PM	0.00	0.00	0.07
3/14/09 5:00 PM	0.00	0.00	0.07
3/14/09 7:00 PM	0.00	0.00	0.08
3/14/09 9:00 PM	0.00	0.00	0.08
3/14/09 11:00 PM	0.00	0.00	0.08
3/15/09 1:00 AM	0.00	0.00	0.08
3/15/09 3:00 AM	0.00	0.00	0.08
3/15/09 5:00 AM	0.00	0.00	0.08
3/15/09 7:00 AM	0.00	0.00	0.08
3/15/09 9:00 AM	0.00	0.00	0.08
3/15/09 11:00 AM	0.00	0.00	0.08
3/15/09 1:00 PM	0.00	0.00	0.08
3/15/09 3:00 PM	0.00	0.00	0.08
3/15/09 5:00 PM	0.00	0.00	0.08
3/15/09 7:00 PM	0.00	0.00	0.08
3/15/09 9:00 PM	0.00	0.00	0.07
3/15/09 11:00 PM	0.00	0.00	0.07
3/16/09 1:00 AM	0.00	0.00	0.06
3/16/09 3:00 AM	0.00	0.00	0.06
3/16/09 5:00 AM	0.00	0.00	0.06
3/16/09 7:00 AM	0.00	0.00	0.07
3/16/09 9:00 AM	0.00	0.00	0.07
3/16/09 11:00 AM	0.00	0.00	0.07
3/16/09 1:00 PM	0.00	0.00	0.07
3/16/09 3:00 PM	0.00	0.00	0.10
3/16/09 5:00 PM	0.00	0.00	0.14
3/16/09 7:00 PM	0.00	0.00	0.23
3/16/09 9:00 PM	0.00	0.00	0.15
3/16/09 11:00 PM	0.00	0.00	0.21
3/17/09 1:00 AM	0.00	0.00	0.18

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
3/17/09 3:00 AM	0.00	0.00	0.17
3/17/09 5:00 AM	0.00	0.00	0.15
3/17/09 7:00 AM	0.00	0.00	0.06
3/17/09 9:00 AM	0.00	0.00	0.07
3/17/09 11:00 AM	0.00	0.00	0.06
3/17/09 1:00 PM	0.00	0.00	0.06
3/17/09 3:00 PM	0.00	0.00	0.06
3/17/09 5:00 PM	0.00	0.00	0.06
3/17/09 7:00 PM	0.00	0.00	0.06
3/17/09 9:00 PM	0.00	0.00	0.06
3/17/09 11:00 PM	0.00	0.00	0.06
3/18/09 1:00 AM	0.00	0.00	0.06
3/18/09 3:00 AM	0.00	0.00	0.06
3/18/09 5:00 AM	0.00	0.00	0.06
3/18/09 7:00 AM	0.00	0.00	0.07
3/18/09 9:00 AM	0.00	0.00	0.06
3/18/09 11:00 AM	0.00	0.00	0.06
3/18/09 1:00 PM	0.00	0.00	0.06
3/18/09 3:00 PM	0.00	0.00	0.06
3/18/09 5:00 PM	0.00	0.00	0.06
3/18/09 7:00 PM	0.00	0.00	0.06
3/18/09 9:00 PM	0.00	0.00	0.06
3/18/09 11:00 PM	0.00	0.00	0.06
3/19/09 1:00 AM	0.00	0.00	0.05
3/19/09 3:00 AM	0.00	0.00	0.06
3/19/09 5:00 AM	0.00	0.00	0.05
3/19/09 7:00 AM	0.00	0.00	0.06
3/19/09 9:00 AM	0.00	0.00	0.04
3/19/09 11:00 AM	0.00	0.00	0.08
3/19/09 1:00 PM	0.00	0.00	0.09
3/19/09 3:00 PM	0.00	0.00	0.05
3/19/09 5:00 PM	0.00	0.00	0.05
3/19/09 7:00 PM	0.00	0.00	0.05
3/19/09 9:00 PM	0.00	0.00	0.04
3/19/09 11:00 PM	0.00	0.00	0.04
3/20/09 1:00 AM	0.00	0.00	0.05
3/20/09 3:00 AM	0.00	0.00	0.05
3/20/09 5:00 AM	0.00	0.00	0.05
3/20/09 7:00 AM	0.00	0.00	0.05
3/20/09 9:00 AM	0.00	0.00	0.05
3/20/09 11:00 AM	0.00	0.00	0.05
3/20/09 1:00 PM	0.00	0.00	0.05
3/20/09 3:00 PM	0.00	0.00	0.03
3/20/09 5:00 PM	0.00	0.00	0.03
3/20/09 7:00 PM	0.00	0.00	0.03
3/20/09 9:00 PM	0.00	0.00	0.03
3/20/09 11:00 PM	0.00	0.00	0.03
3/21/09 1:00 AM	0.00	0.00	0.03
3/21/09 3:00 AM	0.00	0.00	0.03
3/21/09 5:00 AM	0.00	0.00	0.04
3/21/09 7:00 AM	0.00	0.00	0.04
3/21/09 9:00 AM	0.00	0.00	0.04
3/21/09 11:00 AM	0.00	0.00	0.04

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
3/21/09 1:00 PM	0.00	0.00	0.04
3/21/09 3:00 PM	0.00	0.00	0.04
3/21/09 5:00 PM	0.00	0.00	0.04
3/21/09 7:00 PM	0.00	0.00	0.05
3/21/09 9:00 PM	0.00	0.00	0.05
3/21/09 11:00 PM	0.00	0.00	0.06
3/22/09 1:00 AM	0.00	0.00	0.06
3/22/09 3:00 AM	0.00	0.00	0.06
3/22/09 5:00 AM	0.00	0.00	0.06
3/22/09 7:00 AM	0.00	0.00	0.06
3/22/09 9:00 AM	0.00	0.00	0.06
3/22/09 11:00 AM	0.00	0.00	0.06
3/22/09 1:00 PM	0.00	0.00	0.06
3/22/09 3:00 PM	0.00	0.00	0.08
3/22/09 5:00 PM	0.00	0.00	0.07
3/22/09 7:00 PM	0.00	0.00	0.06
3/22/09 9:00 PM	0.00	0.00	0.06
3/22/09 11:00 PM	0.00	0.00	0.07
3/23/09 1:00 AM	0.00	0.00	0.22
3/23/09 3:00 AM	0.00	0.00	0.08
3/23/09 5:00 AM	0.00	0.00	0.07
3/23/09 7:00 AM	0.00	0.00	0.08
3/23/09 9:00 AM	0.00	0.00	0.08
3/23/09 11:00 AM	0.00	0.00	0.09
3/23/09 1:00 PM	0.00	0.00	0.09
3/23/09 3:00 PM	0.00	0.00	0.09
3/23/09 5:00 PM	0.00	0.00	0.09
3/23/09 7:00 PM	0.00	0.00	0.10
3/23/09 9:00 PM	0.07	0.00	0.10
3/23/09 11:00 PM	0.30	0.00	0.09
3/24/09 1:00 AM	0.26	0.00	0.10
3/24/09 3:00 AM	0.31	0.00	0.10
3/24/09 5:00 AM	0.35	0.00	0.11
3/24/09 7:00 AM	0.27	0.00	0.11
3/24/09 9:00 AM	0.16	0.00	0.12
3/24/09 11:00 AM	0.20	0.00	0.12
3/24/09 1:00 PM	0.19	0.00	0.12
3/24/09 3:00 PM	0.00	0.00	0.12
3/24/09 5:00 PM	0.00	0.00	0.12
3/24/09 7:00 PM	0.00	0.00	0.75
3/24/09 9:00 PM	0.00	0.00	0.12
3/24/09 11:00 PM	0.00	0.00	0.11
3/25/09 1:00 AM	0.00	0.00	0.11
3/25/09 3:00 AM	0.09	0.00	0.11
3/25/09 5:00 AM	0.13	0.00	0.11
3/25/09 7:00 AM	0.12	0.00	0.12
3/25/09 9:00 AM	0.11	0.00	0.11
3/25/09 11:00 AM	0.10	0.00	0.12
3/25/09 1:00 PM	0.10	0.00	0.12
3/25/09 3:00 PM	0.10	0.00	0.12
3/25/09 5:00 PM	0.10	0.00	0.13
3/25/09 7:00 PM	0.10	0.00	0.13
3/25/09 9:00 PM	0.10	0.00	0.13

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
3/25/09 11:00 PM	0.10	0.00	0.10
3/26/09 1:00 AM	0.09	0.00	0.04
3/26/09 3:00 AM	0.09	0.00	0.04
3/26/09 5:00 AM	0.11	0.00	0.05
3/26/09 7:00 AM	0.15	0.00	0.10
3/26/09 9:00 AM	0.12	0.00	0.06
3/26/09 11:00 AM	0.12	0.00	0.06
3/26/09 1:00 PM	0.12	0.00	0.07
3/26/09 3:00 PM	0.14	0.00	0.07
3/26/09 5:00 PM	0.14	0.00	0.07
3/26/09 7:00 PM	0.13	0.00	0.08
3/26/09 9:00 PM	0.14	0.00	0.12
3/26/09 11:00 PM	0.14	0.00	0.12
3/27/09 1:00 AM	0.14	0.00	0.26
3/27/09 3:00 AM	0.16	0.00	0.11
3/27/09 5:00 AM	0.16	0.00	0.12
3/27/09 7:00 AM	0.06	0.00	0.11
3/27/09 9:00 AM	0.06	0.00	0.12
3/27/09 11:00 AM	0.12	0.00	0.11
3/27/09 1:00 PM	0.13	0.00	0.11
3/27/09 3:00 PM	0.14	0.00	0.10
3/27/09 5:00 PM	0.13	0.00	0.11
3/27/09 7:00 PM	0.15	0.00	0.10
3/27/09 9:00 PM	0.14	0.00	0.09
3/27/09 11:00 PM	0.19	0.00	0.08
3/28/09 1:00 AM	0.20	0.00	0.08
3/28/09 3:00 AM	0.13	0.00	0.08
3/28/09 5:00 AM	0.15	0.00	0.08
3/28/09 7:00 AM	0.14	0.00	0.07
3/28/09 9:00 AM	0.15	0.00	0.07
3/28/09 11:00 AM	0.14	0.00	0.08
3/28/09 1:00 PM	0.13	0.00	0.08
3/28/09 3:00 PM	0.13	0.00	0.08
3/28/09 5:00 PM	0.13	0.00	0.08
3/28/09 7:00 PM	0.14	0.00	0.07
3/28/09 9:00 PM	0.14	0.00	0.07
3/28/09 11:00 PM	0.14	0.00	0.07
3/29/09 1:00 AM	0.14	0.00	0.06
3/29/09 3:00 AM	0.13	0.00	0.05
3/29/09 5:00 AM	0.16	0.00	0.04
3/29/09 7:00 AM	0.14	0.00	0.06
3/29/09 9:00 AM	0.13	0.00	0.07
3/29/09 11:00 AM	0.08	0.00	0.06
3/29/09 1:00 PM	0.07	0.00	0.06
3/29/09 3:00 PM	0.10	0.00	0.06
3/29/09 5:00 PM	0.12	0.00	0.06
3/29/09 7:00 PM	0.14	0.00	0.06
3/29/09 9:00 PM	0.15	0.00	0.04
3/29/09 11:00 PM	0.15	0.00	0.03
3/20/09 1:00 AM	0.14	0.00	0.03
3/30/09 3:00 AM	0.14	0.00	0.03
3/30/09 5:00 AM	0.16	0.00	0.05
3/30/09 7:00 AM	0.15	0.00	0.07

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
3/30/09 9:00 AM	0.15	0.00	0.07
3/30/09 11:00 AM	0.16	0.00	0.07
3/30/09 1:00 PM	0.16	0.00	0.06
3/30/09 3:00 PM	0.18	0.00	0.06
3/30/09 5:00 PM	0.19	0.00	0.05
3/30/09 7:00 PM	0.23	0.00	0.05
3/30/09 9:00 PM	0.21	0.00	0.05
3/30/09 11:00 PM	0.19	0.00	0.05
3/31/09 1:00 AM	0.16	0.00	0.05
3/31/09 3:00 AM	0.17	0.00	0.05
3/31/09 5:00 AM	0.20	0.00	0.05
3/31/09 7:00 AM	0.17	0.00	0.06
3/31/09 9:00 AM	0.18	0.00	0.06
3/31/09 11:00 AM	0.17	0.00	0.06
3/31/09 1:00 PM	0.14	0.00	0.06
3/31/09 3:00 PM	0.12	0.00	0.06
3/31/09 5:00 PM	0.15	0.00	0.06
3/31/09 7:00 PM	0.16	0.00	0.06
3/31/09 9:00 PM	0.18	0.00	0.06
3/31/09 11:00 PM	0.21	0.00	0.06
4/1/09 1:00 AM	0.17	0.00	0.06
4/1/09 3:00 AM	0.21	0.00	0.06
4/1/09 5:00 AM	0.22	0.00	0.07
4/1/09 7:00 AM	0.21	0.00	0.07
4/1/09 9:00 AM	0.21	0.00	0.07
4/1/09 11:00 AM	0.19	0.00	0.08
4/1/09 1:00 PM	0.20	0.00	0.09
4/1/09 3:00 PM	0.18	0.00	0.07
4/1/09 5:00 PM	0.17	0.00	0.07
4/1/09 7:00 PM	0.00	0.00	0.07
4/1/09 9:00 PM	0.00	0.00	0.06
4/1/09 11:00 PM	0.00	0.00	0.07
4/2/09 1:00 AM	0.00	0.00	0.07
4/2/09 3:00 AM	0.00	0.00	0.07
4/2/09 5:00 AM	0.00	0.00	0.08
4/2/09 7:00 AM	0.00	0.00	0.08
4/2/09 9:00 AM	0.00	0.00	0.08
4/2/09 11:00 AM	0.00	0.00	0.08
4/2/09 1:00 PM	0.00	0.00	0.09
4/2/09 3:00 PM	0.00	0.00	0.08
4/2/09 5:00 PM	0.00	0.00	0.08
4/2/09 7:00 PM	0.07	0.00	0.08
4/2/09 9:00 PM	0.04	0.00	0.08
4/2/09 11:00 PM	0.10	0.00	0.09
4/3/09 1:00 AM	0.11	0.00	0.09
4/3/09 3:00 AM	0.19	0.00	0.09
4/3/09 5:00 AM	0.24	0.00	0.09
4/3/09 7:00 AM	0.24	0.00	0.09
4/3/09 9:00 AM	0.22	0.00	0.09
4/3/09 11:00 AM	0.22	0.00	0.08
4/3/09 1:00 PM	0.23	0.00	0.08
4/3/09 3:00 PM	0.23	0.00	0.08
4/3/09 5:00 PM	0.23	0.00	0.08

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
4/3/09 7:00 PM	0.21	0.00	0.09
4/3/09 9:00 PM	0.21	0.00	0.07
4/3/09 11:00 PM	0.20	0.00	0.04
4/4/09 1:00 AM	0.19	0.00	0.04
4/4/09 3:00 AM	0.18	0.00	0.05
4/4/09 5:00 AM	0.19	0.00	0.05
4/4/09 7:00 AM	0.18	0.00	0.08
4/4/09 9:00 AM	0.17	0.00	0.12
4/4/09 11:00 AM	0.17	0.00	0.12
4/4/09 1:00 PM	0.17	0.00	0.11
4/4/09 3:00 PM	0.17	0.00	0.11
4/4/09 5:00 PM	0.17	0.00	0.11
4/4/09 7:00 PM	0.19	0.00	0.11
4/4/09 9:00 PM	0.19	0.00	0.11
4/4/09 11:00 PM	0.17	0.00	0.11
4/5/09 1:00 AM	0.17	0.00	0.11
4/5/09 3:00 AM	0.17	0.00	0.11
4/5/09 5:00 AM	0.23	0.00	0.11
4/5/09 7:00 AM	0.16	0.00	0.10
4/5/09 9:00 AM	0.18	0.00	0.10
4/5/09 11:00 AM	0.17	0.00	0.10
4/5/09 1:00 PM	0.16	0.00	0.10
4/5/09 3:00 PM	0.15	0.00	0.09
4/5/09 5:00 PM	0.16	0.00	0.08
4/5/09 7:00 PM	0.16	0.00	0.07
4/5/09 9:00 PM	0.16	0.00	0.06
4/5/09 11:00 PM	0.16	0.00	0.06
4/6/09 1:00 AM	0.16	0.00	0.06
4/6/09 3:00 AM	0.16	0.00	0.07
4/6/09 5:00 AM	0.17	0.00	0.07
4/6/09 7:00 AM	0.16	0.00	0.08
4/6/09 9:00 AM	0.16	0.00	0.09
4/6/09 11:00 AM	0.16	0.00	0.09
4/6/09 1:00 PM	0.16	0.00	0.09
4/6/09 3:00 PM	0.16	0.00	0.08
4/6/09 5:00 PM	0.14	0.00	0.08
4/6/09 7:00 PM	0.15	0.00	0.08
4/6/09 9:00 PM	0.16	0.00	0.09
4/6/09 11:00 PM	0.16	0.00	0.09
4/7/09 1:00 AM	0.16	0.00	0.09
4/7/09 3:00 AM	0.15	0.00	0.09
4/7/09 5:00 AM	0.16	0.00	0.09
4/7/09 7:00 AM	0.15	0.00	0.10
4/7/09 9:00 AM	0.15	0.00	0.10
4/7/09 11:00 AM	0.15	0.00	0.10
4/7/09 1:00 PM	0.14	0.00	0.10
4/7/09 3:00 PM	0.15	0.00	0.10
4/7/09 5:00 PM	0.14	0.00	0.10
4/7/09 7:00 PM	0.15	0.00	0.10
4/7/09 9:00 PM	0.14	0.00	0.10
4/7/09 11:00 PM	0.11	0.00	0.11
4/8/09 1:00 AM	0.12	0.00	0.11
4/8/09 3:00 AM	0.11	0.00	0.11

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
4/8/09 5:00 AM	0.16	0.00	0.11
4/8/09 7:00 AM	0.14	0.00	0.12
4/8/09 9:00 AM	0.16	0.00	0.12
4/8/09 11:00 AM	0.14	0.00	0.12
4/8/09 1:00 PM	0.14	0.00	0.12
4/8/09 3:00 PM	0.15	0.00	0.12
4/8/09 5:00 PM	0.14	0.00	0.12
4/8/09 7:00 PM	0.14	0.00	0.12
4/8/09 9:00 PM	0.14	0.00	0.12
4/8/09 11:00 PM	0.14	0.00	0.12
4/9/09 1:00 AM	0.14	0.00	0.12
4/9/09 3:00 AM	0.14	0.00	0.12
4/9/09 5:00 AM	0.16	0.00	0.12
4/9/09 7:00 AM	0.15	0.00	0.13
4/9/09 9:00 AM	0.14	0.00	0.13
4/9/09 11:00 AM	0.14	0.00	0.11
4/9/09 1:00 PM	0.16	0.00	0.11
4/9/09 3:00 PM	0.15	0.00	0.11
4/9/09 5:00 PM	0.15	0.00	0.12
4/9/09 7:00 PM	0.16	0.00	0.12
4/9/09 9:00 PM	0.16	0.00	0.20
4/9/09 11:00 PM	0.16	0.00	0.20
4/10/09 1:00 AM	0.16	0.00	0.09
4/10/09 3:00 AM	0.13	0.00	0.06
4/10/09 5:00 AM	0.16	0.00	0.08
4/10/09 7:00 AM	0.13	0.00	0.10
4/10/09 9:00 AM	0.12	0.00	0.10
4/10/09 11:00 AM	0.12	0.00	0.10
4/10/09 1:00 PM	0.12	0.00	0.10
4/10/09 3:00 PM	0.14	0.00	0.10
4/10/09 5:00 PM	0.14	0.00	0.10
4/10/09 7:00 PM	0.17	0.00	0.09
4/10/09 9:00 PM	0.18	0.00	0.09
4/10/09 11:00 PM	0.18	0.00	0.09
4/11/09 1:00 AM	0.18	0.00	0.07
4/11/09 3:00 AM	0.16	0.00	0.07
4/11/09 5:00 AM	0.19	0.00	0.07
4/11/09 7:00 AM	0.16	0.00	0.07
4/11/09 9:00 AM	0.16	0.00	0.11
4/11/09 11:00 AM	0.19	0.00	0.11
4/11/09 1:00 PM	0.19	0.00	0.12
4/11/09 3:00 PM	0.19	0.19	0.12
4/11/09 5:00 PM	0.20	0.20	0.13
4/11/09 7:00 PM	0.20	0.20	0.12
4/11/09 9:00 PM	0.22	0.22	0.11
4/11/09 11:00 PM	0.17	0.00	0.07
4/12/09 1:00 AM	0.13	0.00	0.06
4/12/09 3:00 AM	0.13	0.00	0.06
4/12/09 5:00 AM	0.15	0.00	0.06
4/12/09 7:00 AM	0.12	0.00	0.06
4/12/09 9:00 AM	0.13	0.00	0.07
4/12/09 11:00 AM	0.14	0.00	0.09
4/12/09 1:00 PM	0.14	0.00	0.80

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
4/12/09 3:00 PM	0.13	0.00	0.16
4/12/09 5:00 PM	0.13	0.00	0.17
4/12/09 7:00 PM	0.17	0.00	0.17
4/12/09 9:00 PM	0.16	0.00	0.15
4/12/09 11:00 PM	0.13	0.00	0.15
4/13/09 1:00 AM	0.15	0.00	0.12
4/13/09 3:00 AM	0.16	0.00	0.09
4/13/09 5:00 AM	0.18	0.00	0.13
4/13/09 7:00 AM	0.17	0.00	0.14
4/13/09 9:00 AM	0.21	0.00	0.14
4/13/09 11:00 AM	0.20	0.00	0.16
4/13/09 1:00 PM	0.19	0.00	0.14
4/13/09 3:00 PM	0.19	0.00	0.14
4/13/09 5:00 PM	0.20	0.00	0.15
4/13/09 7:00 PM	0.21	0.00	0.13
4/13/09 9:00 PM	0.22	0.00	0.15
4/13/09 11:00 PM	0.22	0.00	0.17
4/14/09 1:00 AM	0.20	0.00	0.16
4/14/09 3:00 AM	0.20	0.00	0.12
4/14/09 5:00 AM	0.22	0.00	0.20
4/14/09 7:00 AM	0.24	0.00	0.17
4/14/09 9:00 AM	0.24	0.00	0.20
4/14/09 11:00 AM	0.22	0.22	0.20
4/14/09 1:00 PM	0.21	0.21	0.17
4/14/09 3:00 PM	0.20	0.20	0.07
4/14/09 5:00 PM	0.00	0.00	0.08
4/14/09 7:00 PM	0.09	0.09	0.08
4/14/09 9:00 PM	0.07	0.07	0.07
4/14/09 11:00 PM	0.09	0.09	0.07
4/15/09 1:00 AM	0.14	0.14	0.07
4/15/09 3:00 AM	0.16	0.16	0.06
4/15/09 5:00 AM	0.24	0.24	0.13
4/15/09 7:00 AM	0.22	0.22	0.22
4/15/09 9:00 AM	0.22	0.22	0.22
4/15/09 11:00 AM	0.26	0.26	0.22
4/15/09 1:00 PM	0.27	0.27	0.17
4/15/09 3:00 PM	0.26	0.26	0.17
4/15/09 5:00 PM	0.15	0.15	0.16
4/15/09 7:00 PM	0.13	0.13	0.14
4/15/09 9:00 PM	0.13	0.13	0.12
4/15/09 11:00 PM	0.13	0.13	0.11
4/16/09 1:00 AM	0.12	0.12	0.06
4/16/09 3:00 AM	0.12	0.12	0.05
4/16/09 5:00 AM	0.13	0.13	0.08
4/16/09 7:00 AM	0.15	0.15	0.08
4/16/09 9:00 AM	0.15	0.15	0.07
4/16/09 11:00 AM	0.11	0.11	0.13
4/16/09 1:00 PM	0.10	0.10	0.11
4/16/09 3:00 PM	0.07	0.07	0.13
4/16/09 5:00 PM	0.12	0.12	0.12
4/16/09 7:00 PM	0.12	0.12	0.11
4/16/09 9:00 PM	0.11	0.11	0.12
4/16/09 11:00 PM	0.13	0.13	0.10

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
4/17/09 1:00 AM	0.21	0.21	0.06
4/17/09 3:00 AM	0.22	0.22	0.05
4/17/09 5:00 AM	0.19	0.19	0.11
4/17/09 7:00 AM	0.20	0.20	0.13
4/17/09 9:00 AM	0.18	0.18	0.14
4/17/09 11:00 AM	0.18	0.18	0.12
4/17/09 1:00 PM	0.18	0.18	0.13
4/17/09 3:00 PM	0.18	0.18	0.11
4/17/09 5:00 PM	0.18	0.18	0.11
4/17/09 7:00 PM	0.00	0.00	0.10
4/17/09 9:00 PM	0.00	0.00	0.10
4/17/09 11:00 PM	0.00	0.00	0.10
4/18/09 1:00 AM	0.00	0.00	0.08
4/18/09 3:00 AM	0.00	0.00	0.08
4/18/09 5:00 AM	0.00	0.00	0.10
4/18/09 7:00 AM	0.00	0.00	0.08
4/18/09 9:00 AM	0.00	0.00	0.09
4/18/09 11:00 AM	0.00	0.00	0.08
4/18/09 1:00 PM	0.00	0.00	0.10
4/18/09 3:00 PM	0.00	0.00	0.12
4/18/09 5:00 PM	0.00	0.00	0.11
4/18/09 7:00 PM	0.00	0.00	0.10
4/18/09 9:00 PM	0.00	0.00	0.10
4/18/09 11:00 PM	0.00	0.00	0.10
4/19/09 1:00 AM	0.00	0.00	0.09
4/19/09 3:00 AM	0.00	0.00	0.08
4/19/09 5:00 AM	0.00	0.00	0.07
4/19/09 7:00 AM	0.00	0.00	0.08
4/19/09 9:00 AM	0.00	0.00	0.09
4/19/09 11:00 AM	0.00	0.00	0.09
4/19/09 1:00 PM	0.00	0.00	0.09
4/19/09 3:00 PM	0.00	0.00	0.10
4/19/09 5:00 PM	0.00	0.00	0.10
4/19/09 7:00 PM	0.00	0.00	0.09
4/19/09 9:00 PM	0.00	0.00	0.08
4/19/09 11:00 PM	0.00	0.00	0.08
4/20/09 1:00 AM	0.00	0.00	0.08
4/20/09 3:00 AM	0.00	0.00	0.08
4/20/09 5:00 AM	0.00	0.00	0.08
4/20/09 7:00 AM	0.00	0.00	0.08
4/20/09 9:00 AM	0.00	0.00	0.08
4/20/09 11:00 AM	0.00	0.00	0.09
4/20/09 1:00 PM	0.00	0.10	0.11
4/20/09 3:00 PM	0.00	0.10	0.12
4/20/09 5:00 PM	0.00	0.10	0.11
4/20/09 7:00 PM	0.00	0.10	0.11
4/20/09 9:00 PM	0.00	0.12	0.11
4/20/09 11:00 PM	0.00	0.12	0.11
4/21/09 1:00 AM	0.00	0.12	0.11
4/21/09 3:00 AM	0.00	0.12	0.11
4/21/09 5:00 AM	0.00	0.12	0.11
4/21/09 7:00 AM	0.00	0.13	0.09
4/21/09 9:00 AM	0.00	0.10	0.09

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
4/21/09 11:00 AM	0.00	0.10	0.09
4/21/09 1:00 PM	0.07	0.07	0.09
4/21/09 3:00 PM	0.00	0.08	0.10
4/21/09 5:00 PM	0.00	0.08	0.08
4/21/09 7:00 PM	0.08	0.08	0.07
4/21/09 9:00 PM	0.08	0.08	0.09
4/21/09 11:00 PM	0.06	0.06	0.08
4/22/09 1:00 AM	0.00	0.00	0.10
4/22/09 3:00 AM	0.03	0.03	0.11
4/22/09 5:00 AM	0.09	0.09	0.10
4/22/09 7:00 AM	0.13	0.13	0.07
4/22/09 9:00 AM	0.12	0.12	0.09
4/22/09 11:00 AM	0.11	0.11	0.09
4/22/09 1:00 PM	0.11	0.11	0.09
4/22/09 3:00 PM	0.13	0.13	0.10
4/22/09 5:00 PM	0.13	0.13	0.09
4/22/09 7:00 PM	0.10	0.10	0.11
4/22/09 9:00 PM	0.00	0.00	0.12
4/22/09 11:00 PM	0.00	0.00	0.13
4/23/09 1:00 AM	0.00	0.00	0.14
4/23/09 3:00 AM	0.01	0.01	0.19
4/23/09 5:00 AM	0.01	0.01	0.22
4/23/09 7:00 AM	0.13	0.13	0.21
4/23/09 9:00 AM	0.02	0.02	0.22
4/23/09 11:00 AM	0.01	0.01	0.21
4/23/09 1:00 PM	0.04	0.04	0.21
4/23/09 3:00 PM	0.05	0.05	0.27
4/23/09 5:00 PM	0.06	0.06	0.22
4/23/09 7:00 PM	0.07	0.07	0.15
4/23/09 9:00 PM	0.06	0.06	0.15
4/23/09 11:00 PM	0.00	0.00	0.15
4/24/09 1:00 AM	0.00	0.00	0.14
4/24/09 3:00 AM	0.00	0.00	0.15
4/24/09 5:00 AM	0.00	0.00	0.13
4/24/09 7:00 AM	0.00	0.00	0.11
4/24/09 9:00 AM	0.00	0.00	0.12
4/24/09 11:00 AM	0.00	0.00	0.12
4/24/09 1:00 PM	0.00	0.00	0.13
4/24/09 3:00 PM	0.00	0.00	0.16
4/24/09 5:00 PM	0.00	0.00	0.16
4/24/09 7:00 PM	0.00	0.00	0.18
4/24/09 9:00 PM	0.00	0.00	0.19
4/24/09 11:00 PM	0.00	0.00	0.19
4/25/09 1:00 AM	0.00	0.00	0.19
4/25/09 3:00 AM	0.00	0.00	0.22
4/25/09 5:00 AM	0.00	0.00	0.20
4/25/09 7:00 AM	0.00	0.00	0.17
4/25/09 9:00 AM	0.00	0.00	0.14
4/25/09 11:00 AM	0.00	0.00	0.15
4/25/09 1:00 PM	0.00	0.00	0.14
4/25/09 3:00 PM	0.00	0.00	0.14
4/25/09 5:00 PM	0.00	0.00	0.15
4/25/09 7:00 PM	0.00	0.00	0.15

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
4/25/09 9:00 PM	0.00	0.00	0.14
4/25/09 11:00 PM	0.00	0.00	0.14
4/26/09 1:00 AM	0.00	0.00	0.14
4/26/09 3:00 AM	0.00	0.00	0.15
4/26/09 5:00 AM	0.01	0.01	0.15
4/26/09 7:00 AM	0.12	0.12	0.14
4/26/09 9:00 AM	0.03	0.03	0.13
4/26/09 11:00 AM	0.02	0.02	0.14
4/26/09 1:00 PM	0.02	0.02	0.14
4/26/09 3:00 PM	0.10	0.10	0.15
4/26/09 5:00 PM	0.14	0.14	0.17
4/26/09 7:00 PM	0.13	0.13	0.17
4/26/09 9:00 PM	0.13	0.13	0.15
4/26/09 11:00 PM	0.12	0.12	0.14
4/27/09 1:00 AM	0.12	0.12	0.14
4/27/09 3:00 AM	0.12	0.12	0.14
4/27/09 5:00 AM	0.12	0.12	0.13
4/27/09 7:00 AM	0.13	0.13	0.13
4/27/09 9:00 AM	0.12	0.12	0.12
4/27/09 11:00 AM	0.12	0.12	0.14
4/27/09 1:00 PM	0.11	0.11	0.15
4/27/09 3:00 PM	0.11	0.11	0.15
4/27/09 5:00 PM	0.11	0.11	0.14
4/27/09 7:00 PM	0.10	0.10	0.12
4/27/09 9:00 PM	0.10	0.10	0.11
4/27/09 11:00 PM	0.10	0.10	0.10
4/28/09 1:00 AM	0.10	0.10	0.10
4/28/09 3:00 AM	0.09	0.09	0.10
4/28/09 5:00 AM	0.10	0.10	0.10
4/28/09 7:00 AM	0.11	0.11	0.10
4/28/09 9:00 AM	0.09	0.09	0.10
4/28/09 11:00 AM	0.09	0.09	0.10
4/28/09 1:00 PM	0.09	0.09	0.10
4/28/09 3:00 PM	0.09	0.09	0.10
4/28/09 5:00 PM	0.09	0.09	0.10
4/28/09 7:00 PM	0.09	0.09	0.12
4/28/09 9:00 PM	0.09	0.09	0.13
4/28/09 11:00 PM	0.09	0.09	0.14
4/29/09 1:00 AM	0.10	0.10	0.14
4/29/09 3:00 AM	0.10	0.10	0.15
4/29/09 5:00 AM	0.09	0.09	0.15
4/29/09 7:00 AM	0.11	0.11	0.15
4/29/09 9:00 AM	0.10	0.10	0.14
4/29/09 11:00 AM	0.10	0.10	0.16
4/29/09 1:00 PM	0.10	0.10	0.22
4/29/09 3:00 PM	0.10	0.10	0.12
4/29/09 5:00 PM	0.09	0.09	0.11
4/29/09 7:00 PM	0.09	0.09	0.03
4/29/09 9:00 PM	0.10	0.10	0.01
4/29/09 11:00 PM	0.10	0.10	0.00
4/30/09 1:00 AM	0.09	0.09	0.00
4/30/09 3:00 AM	0.09	0.09	0.00
4/30/09 5:00 AM	0.09	0.09	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
4/30/09 7:00 AM	0.11	0.11	0.00
4/30/09 9:00 AM	0.09	0.09	0.00
4/30/09 11:00 AM	0.10	0.10	0.00
4/30/09 1:00 PM	0.11	0.11	0.00
4/30/09 3:00 PM	0.19	0.19	0.00
4/30/09 5:00 PM	0.18	0.18	0.00
4/30/09 7:00 PM	0.18	0.18	0.00
4/30/09 9:00 PM	0.18	0.18	0.00
4/30/09 11:00 PM	0.19	0.19	0.00
5/1/09 1:00 AM	0.18	0.18	0.00
5/1/09 3:00 AM	0.18	0.18	0.00
5/1/09 5:00 AM	0.17	0.17	0.00
5/1/09 7:00 AM	0.19	0.19	0.00
5/1/09 9:00 AM	0.21	0.21	0.00
5/1/09 11:00 AM	0.21	0.21	0.00
5/1/09 1:00 PM	0.17	0.17	0.00
5/1/09 3:00 PM	0.11	0.11	0.00
5/1/09 5:00 PM	0.11	0.11	0.00
5/1/09 7:00 PM	0.12	0.12	0.00
5/1/09 9:00 PM	0.11	0.11	0.00
5/1/09 11:00 PM	0.10	0.10	0.00
5/2/09 1:00 AM	0.10	0.10	0.00
5/2/09 3:00 AM	0.09	0.09	0.00
5/2/09 5:00 AM	0.09	0.09	0.00
5/2/09 7:00 AM	0.11	0.11	0.00
5/2/09 9:00 AM	0.10	0.10	0.00
5/2/09 11:00 AM	0.12	0.12	0.00
5/2/09 1:00 PM	0.11	0.11	0.00
5/2/09 3:00 PM	0.11	0.11	0.00
5/2/09 5:00 PM	0.10	0.10	0.00
5/2/09 7:00 PM	0.09	0.09	0.00
5/2/09 9:00 PM	0.10	0.10	0.00
5/2/09 11:00 PM	0.11	0.11	0.00
5/3/09 1:00 AM	0.11	0.11	0.00
5/3/09 3:00 AM	0.11	0.11	0.00
5/3/09 5:00 AM	0.11	0.11	0.00
5/3/09 7:00 AM	0.13	0.13	0.00
5/3/09 9:00 AM	0.11	0.11	0.00
5/3/09 11:00 AM	0.11	0.11	0.00
5/3/09 1:00 PM	0.10	0.10	0.00
5/3/09 3:00 PM	0.10	0.10	0.00
5/3/09 5:00 PM	0.09	0.09	0.00
5/3/09 7:00 PM	0.10	0.10	0.00
5/3/09 9:00 PM	0.11	0.11	0.00
5/3/09 11:00 PM	0.11	0.11	0.00
5/4/09 1:00 AM	0.10	0.10	0.00
5/4/09 3:00 AM	0.10	0.10	0.00
5/4/09 5:00 AM	0.11	0.11	0.00
5/4/09 7:00 AM	0.13	0.13	0.00
5/4/09 9:00 AM	0.11	0.11	0.00
5/4/09 11:00 AM	0.10	0.10	0.00
5/4/09 1:00 PM	0.10	0.10	0.00
5/4/09 3:00 PM	0.09	0.09	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
5/4/09 5:00 PM	0.09	0.09	0.00
5/4/09 7:00 PM	0.09	0.09	0.00
5/4/09 9:00 PM	0.09	0.09	0.00
5/4/09 11:00 PM	0.09	0.09	0.00
5/5/09 1:00 AM	0.09	0.09	0.00
5/5/09 3:00 AM	0.09	0.09	0.00
5/5/09 5:00 AM	0.10	0.10	0.00
5/5/09 7:00 AM	0.11	0.11	0.00
5/5/09 9:00 AM	0.09	0.09	0.00
5/5/09 11:00 AM	0.09	0.09	0.00
5/5/09 1:00 PM	0.09	0.09	0.00
5/5/09 3:00 PM	0.08	0.08	0.00
5/5/09 5:00 PM	0.08	0.08	0.00
5/5/09 7:00 PM	0.08	0.08	0.00
5/5/09 9:00 PM	0.09	0.09	0.00
5/5/09 11:00 PM	0.09	0.09	0.00
5/6/09 1:00 AM	0.09	0.09	0.00
5/6/09 3:00 AM	0.08	0.08	0.00
5/6/09 5:00 AM	0.08	0.08	0.00
5/6/09 7:00 AM	0.10	0.10	0.00
5/6/09 9:00 AM	0.09	0.09	0.00
5/6/09 11:00 AM	0.08	0.08	0.00
5/6/09 1:00 PM	0.08	0.08	0.00
5/6/09 3:00 PM	0.08	0.08	0.00
5/6/09 5:00 PM	0.08	0.08	0.00
5/6/09 7:00 PM	0.08	0.08	0.00
5/6/09 9:00 PM	0.08	0.08	0.00
5/6/09 11:00 PM	0.08	0.08	0.00
5/7/09 1:00 AM	0.08	0.08	0.00
5/7/09 3:00 AM	0.08	0.08	0.00
5/7/09 5:00 AM	0.08	0.08	0.00
5/7/09 7:00 AM	0.10	0.10	0.00
5/7/09 9:00 AM	0.08	0.08	0.00
5/7/09 11:00 AM	0.08	0.08	0.00
5/7/09 1:00 PM	0.08	0.08	0.00
5/7/09 3:00 PM	0.08	0.08	0.00
5/7/09 5:00 PM	0.08	0.08	0.00
5/7/09 7:00 PM	0.08	0.08	0.00
5/7/09 9:00 PM	0.08	0.08	0.00
5/7/09 11:00 PM	0.08	0.08	0.00
5/8/09 1:00 AM	0.08	0.08	0.00
5/8/09 3:00 AM	0.08	0.08	0.00
5/8/09 5:00 AM	0.07	0.07	0.00
5/8/09 7:00 AM	0.15	0.15	0.00
5/8/09 9:00 AM	0.07	0.07	0.00
5/8/09 11:00 AM	0.08	0.08	0.00
5/8/09 1:00 PM	0.12	0.12	0.00
5/8/09 3:00 PM	0.06	0.06	0.00
5/8/09 5:00 PM	0.06	0.06	0.00
5/8/09 7:00 PM	0.06	0.06	0.00
5/8/09 9:00 PM	0.06	0.06	0.00
5/8/09 11:00 PM	0.06	0.06	0.00
5/9/09 1:00 AM	0.06	0.06	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
5/9/09 3:00 AM	0.06	0.06	0.00
5/9/09 5:00 AM	0.06	0.06	0.00
5/9/09 7:00 AM	0.08	0.08	0.00
5/9/09 9:00 AM	0.12	0.12	0.00
5/9/09 11:00 AM	0.08	0.08	0.00
5/9/09 1:00 PM	0.08	0.08	0.00
5/9/09 3:00 PM	0.08	0.08	0.00
5/9/09 5:00 PM	0.08	0.08	0.00
5/9/09 7:00 PM	0.08	0.08	0.00
5/9/09 9:00 PM	0.08	0.08	0.00
5/9/09 11:00 PM	0.08	0.08	0.00
5/10/09 1:00 AM	0.08	0.08	0.00
5/10/09 3:00 AM	0.08	0.08	0.00
5/10/09 5:00 AM	0.08	0.08	0.00
5/10/09 7:00 AM	0.10	0.10	0.00
5/10/09 9:00 AM	0.08	0.08	0.00
5/10/09 11:00 AM	0.08	0.08	0.00
5/10/09 1:00 PM	0.08	0.08	0.00
5/10/09 3:00 PM	0.08	0.08	0.00
5/10/09 5:00 PM	0.08	0.08	0.02
5/10/09 7:00 PM	0.08	0.08	0.04
5/10/09 9:00 PM	0.08	0.08	0.10
5/10/09 11:00 PM	0.07	0.07	0.11
5/11/09 1:00 AM	0.08	0.08	0.07
5/11/09 3:00 AM	0.08	0.08	0.04
5/11/09 5:00 AM	0.08	0.08	0.05
5/11/09 7:00 AM	0.09	0.09	0.04
5/11/09 9:00 AM	0.08	0.08	0.04
5/11/09 11:00 AM	0.08	0.08	0.05
5/11/09 1:00 PM	0.07	0.07	0.05
5/11/09 3:00 PM	0.07	0.07	0.05
5/11/09 5:00 PM	0.07	0.07	0.05
5/11/09 7:00 PM	0.07	0.07	0.05
5/11/09 9:00 PM	0.08	0.08	0.05
5/11/09 11:00 PM	0.08	0.08	0.05
5/12/09 1:00 AM	0.08	0.08	0.05
5/12/09 3:00 AM	0.07	0.07	0.05
5/12/09 5:00 AM	0.08	0.08	0.05
5/12/09 7:00 AM	0.09	0.09	0.07
5/12/09 9:00 AM	0.07	0.07	0.05
5/12/09 11:00 AM	0.07	0.07	0.05
5/12/09 1:00 PM	0.07	0.07	0.05
5/12/09 3:00 PM	0.07	0.07	0.06
5/12/09 5:00 PM	0.07	0.07	0.06
5/12/09 7:00 PM	0.07	0.07	0.07
5/12/09 9:00 PM	0.07	0.07	0.06
5/12/09 11:00 PM	0.07	0.07	0.06
5/13/09 1:00 AM	0.07	0.07	0.07
5/13/09 3:00 AM	0.07	0.07	0.06
5/13/09 5:00 AM	0.08	0.08	0.07
5/13/09 7:00 AM	0.09	0.09	0.06
5/13/09 9:00 AM	0.08	0.08	0.06
5/13/09 11:00 AM	0.10	0.10	0.05

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
5/13/09 1:00 PM	0.10	0.10	0.06
5/13/09 3:00 PM	0.10	0.10	0.07
5/13/09 5:00 PM	0.10	0.10	0.06
5/13/09 7:00 PM	0.10	0.10	0.07
5/13/09 9:00 PM	0.10	0.10	0.06
5/13/09 11:00 PM	0.10	0.10	0.07
5/14/09 1:00 AM	0.10	0.10	0.07
5/14/09 3:00 AM	0.10	0.10	0.07
5/14/09 5:00 AM	0.10	0.10	0.08
5/14/09 7:00 AM	0.10	0.10	0.10
5/14/09 9:00 AM	0.09	0.09	0.10
5/14/09 11:00 AM	0.09	0.09	0.12
5/14/09 1:00 PM	0.09	0.09	0.12
5/14/09 3:00 PM	0.09	0.09	0.11
5/14/09 5:00 PM	0.09	0.09	0.12
5/14/09 7:00 PM	0.09	0.09	0.13
5/14/09 9:00 PM	0.08	0.08	0.12
5/14/09 11:00 PM	0.08	0.08	0.11
5/15/09 1:00 AM	0.07	0.07	0.11
5/15/09 3:00 AM	0.07	0.07	0.10
5/15/09 5:00 AM	0.08	0.08	0.09
5/15/09 7:00 AM	0.10	0.10	0.08
5/15/09 9:00 AM	0.09	0.09	0.09
5/15/09 11:00 AM	1.43	1.43	0.10
5/15/09 1:00 PM	0.25	0.25	0.10
5/15/09 3:00 PM	0.25	0.25	0.10
5/15/09 5:00 PM	0.10	0.10	0.09
5/15/09 7:00 PM	0.09	0.09	0.08
5/15/09 9:00 PM	0.09	0.09	0.08
5/15/09 11:00 PM	0.09	0.09	0.08
5/16/09 1:00 AM	0.09	0.09	0.08
5/16/09 3:00 AM	0.09	0.09	0.08
5/16/09 5:00 AM	0.09	0.09	0.08
5/16/09 7:00 AM	0.10	0.10	0.09
5/16/09 9:00 AM	0.09	0.09	0.11
5/16/09 11:00 AM	0.09	0.09	0.06
5/16/09 1:00 PM	0.09	0.09	0.05
5/16/09 3:00 PM	0.10	0.10	0.05
5/16/09 5:00 PM	0.09	0.09	0.08
5/16/09 7:00 PM	0.09	0.09	0.10
5/16/09 9:00 PM	0.09	0.09	0.11
5/16/09 11:00 PM	0.08	0.08	0.10
5/17/09 1:00 AM	0.08	0.08	0.10
5/17/09 3:00 AM	0.08	0.08	0.10
5/17/09 5:00 AM	0.08	0.08	0.10
5/17/09 7:00 AM	0.10	0.10	0.10
5/17/09 9:00 AM	0.09	0.09	0.11
5/17/09 11:00 AM	0.09	0.09	0.11
5/17/09 1:00 PM	0.09	0.09	0.10
5/17/09 3:00 PM	0.09	0.09	0.11
5/17/09 5:00 PM	0.09	0.09	0.11
5/17/09 7:00 PM	0.09	0.09	0.11
5/17/09 9:00 PM	0.09	0.09	0.11

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
5/17/09 11:00 PM	0.09	0.09	0.11
5/18/09 1:00 AM	0.09	0.09	0.11
5/18/09 3:00 AM	0.10	0.10	0.11
5/18/09 5:00 AM	0.09	0.09	0.11
5/18/09 7:00 AM	0.11	0.11	0.12
5/18/09 9:00 AM	0.10	0.10	0.12
5/18/09 11:00 AM	0.09	0.09	0.12
5/18/09 1:00 PM	0.09	0.09	0.12
5/18/09 3:00 PM	0.09	0.09	0.12
5/18/09 5:00 PM	0.09	0.09	0.11
5/18/09 7:00 PM	0.09	0.09	0.11
5/18/09 9:00 PM	0.10	0.10	0.11
5/18/09 11:00 PM	0.10	0.10	0.11
5/19/09 1:00 AM	0.10	0.10	0.10
5/19/09 3:00 AM	0.09	0.09	0.08
5/19/09 5:00 AM	0.10	0.10	0.10
5/19/09 7:00 AM	0.11	0.11	0.12
5/19/09 9:00 AM	0.10	0.10	0.11
5/19/09 11:00 AM	0.09	0.09	0.11
5/19/09 1:00 PM	0.10	0.10	0.11
5/19/09 3:00 PM	0.10	0.10	0.12
5/19/09 5:00 PM	0.10	0.10	0.12
5/19/09 7:00 PM	0.09	0.09	0.12
5/19/09 9:00 PM	0.09	0.09	0.13
5/19/09 11:00 PM	0.09	0.09	0.12
5/20/09 1:00 AM	0.09	0.09	0.12
5/20/09 3:00 AM	0.09	0.09	0.11
5/20/09 5:00 AM	0.09	0.09	0.11
5/20/09 7:00 AM	0.10	0.10	0.12
5/20/09 9:00 AM	0.09	0.09	0.11
5/20/09 11:00 AM	0.09	0.09	0.11
5/20/09 1:00 PM	0.09	0.09	0.09
5/20/09 3:00 PM	0.09	0.09	0.09
5/20/09 5:00 PM	0.09	0.09	0.12
5/20/09 7:00 PM	0.09	0.09	0.11
5/20/09 9:00 PM	0.09	0.09	0.12
5/20/09 11:00 PM	0.09	0.09	0.12
5/21/09 1:00 AM	0.08	0.08	0.12
5/21/09 3:00 AM	0.08	0.08	0.12
5/21/09 5:00 AM	0.08	0.08	0.12
5/21/09 7:00 AM	0.10	0.10	0.12
5/21/09 9:00 AM	0.08	0.08	0.13
5/21/09 11:00 AM	0.09	0.09	0.15
5/21/09 1:00 PM	0.08	0.08	0.15
5/21/09 3:00 PM	0.09	0.09	0.16
5/21/09 5:00 PM	0.08	0.08	0.15
5/21/09 7:00 PM	0.08	0.08	0.14
5/21/09 9:00 PM	0.08	0.08	0.14
5/21/09 11:00 PM	0.08	0.08	0.14
5/22/09 1:00 AM	0.08	0.08	0.15
5/22/09 3:00 AM	0.08	0.08	0.14
5/22/09 5:00 AM	0.08	0.08	0.13
5/22/09 7:00 AM	0.10	0.10	0.11

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
5/22/09 9:00 AM	0.09	0.09	0.11
5/22/09 11:00 AM	0.08	0.08	0.10
5/22/09 1:00 PM	0.09	0.09	0.09
5/22/09 3:00 PM	0.08	0.08	0.10
5/22/09 5:00 PM	0.09	0.09	0.09
5/22/09 7:00 PM	0.08	0.08	0.09
5/22/09 9:00 PM	0.08	0.08	0.09
5/22/09 11:00 PM	0.08	0.08	0.09
5/23/09 1:00 AM	0.08	0.08	0.09
5/23/09 3:00 AM	0.08	0.08	0.10
5/23/09 5:00 AM	0.08	0.08	0.10
5/23/09 7:00 AM	0.09	0.09	0.10
5/23/09 9:00 AM	0.08	0.08	0.11
5/23/09 11:00 AM	0.08	0.08	0.12
5/23/09 1:00 PM	0.09	0.09	0.14
5/23/09 3:00 PM	0.08	0.08	0.15
5/23/09 5:00 PM	0.05	0.05	0.14
5/23/09 7:00 PM	0.00	0.00	0.15
5/23/09 9:00 PM	0.00	0.00	0.16
5/23/09 11:00 PM	0.00	0.00	0.15
5/24/09 1:00 AM	0.00	0.00	0.16
5/24/09 3:00 AM	0.00	0.00	0.09
5/24/09 5:00 AM	0.00	0.00	0.13
5/24/09 7:00 AM	0.00	0.00	0.14
5/24/09 9:00 AM	0.00	0.00	0.14
5/24/09 11:00 AM	0.00	0.00	0.15
5/24/09 1:00 PM	0.00	0.00	0.16
5/24/09 3:00 PM	0.00	0.00	0.15
5/24/09 5:00 PM	0.00	0.00	0.15
5/24/09 7:00 PM	0.00	0.00	0.14
5/24/09 9:00 PM	0.00	0.00	0.15
5/24/09 11:00 PM	0.00	0.00	0.15
5/25/09 1:00 AM	0.00	0.00	0.16
5/25/09 3:00 AM	0.00	0.00	0.17
5/25/09 5:00 AM	0.00	0.00	0.16
5/25/09 7:00 AM	0.00	0.00	0.16
5/25/09 9:00 AM	0.00	0.00	0.15
5/25/09 11:00 AM	0.00	0.00	0.13
5/25/09 1:00 PM	0.00	0.00	0.13
5/25/09 3:00 PM	0.00	0.00	0.13
5/25/09 5:00 PM	0.00	0.00	0.12
5/25/09 7:00 PM	0.00	0.00	0.12
5/25/09 9:00 PM	0.00	0.00	0.12
5/25/09 11:00 PM	0.00	0.00	0.12
5/26/09 1:00 AM	0.00	0.00	0.12
5/26/09 3:00 AM	0.00	0.00	0.12
5/26/09 5:00 AM	0.00	0.00	0.12
5/26/09 7:00 AM	0.00	0.00	0.13
5/26/09 9:00 AM	0.00	0.00	0.13
5/26/09 11:00 AM	0.01	0.01	0.15
5/26/09 1:00 PM	0.21	0.21	0.15
5/26/09 3:00 PM	0.08	0.08	0.18
5/26/09 5:00 PM	0.15	0.15	0.16

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
5/26/09 7:00 PM	0.19	0.19	0.18
5/26/09 9:00 PM	0.18	0.18	0.21
5/26/09 11:00 PM	0.18	0.18	0.17
5/27/09 1:00 AM	0.18	0.18	0.18
5/27/09 3:00 AM	0.18	0.18	0.20
5/27/09 5:00 AM	0.18	0.18	0.23
5/27/09 7:00 AM	0.17	0.17	0.22
5/27/09 9:00 AM	0.13	0.13	0.22
5/27/09 11:00 AM	0.15	0.15	0.22
5/27/09 1:00 PM	0.18	0.18	0.22
5/27/09 3:00 PM	0.15	0.15	0.22
5/27/09 5:00 PM	0.16	0.16	0.22
5/27/09 7:00 PM	0.17	0.17	0.22
5/27/09 9:00 PM	0.18	0.18	0.23
5/27/09 11:00 PM	0.16	0.16	0.19
5/28/09 1:00 AM	0.15	0.15	0.22
5/28/09 3:00 AM	0.15	0.15	0.20
5/28/09 5:00 AM	0.14	0.14	0.25
5/28/09 7:00 AM	0.16	0.16	0.25
5/28/09 9:00 AM	0.14	0.14	0.25
5/28/09 11:00 AM	0.13	0.13	0.24
5/28/09 1:00 PM	0.12	0.12	0.20
5/28/09 3:00 PM	0.11	0.11	0.14
5/28/09 5:00 PM	0.09	0.09	0.14
5/28/09 7:00 PM	0.12	0.12	0.21
5/28/09 9:00 PM	0.14	0.14	0.21
5/28/09 11:00 PM	0.14	0.14	0.22
5/29/09 1:00 AM	0.15	0.15	0.20
5/29/09 3:00 AM	0.13	0.13	0.19
5/29/09 5:00 AM	0.13	0.13	0.19
5/29/09 7:00 AM	0.15	0.15	0.16
5/29/09 9:00 AM	0.13	0.13	0.18
5/29/09 11:00 AM	0.13	0.13	0.21
5/29/09 1:00 PM	0.14	0.14	0.17
5/29/09 3:00 PM	0.16	0.16	0.41
5/29/09 5:00 PM	0.13	0.13	0.24
5/29/09 7:00 PM	0.13	0.13	0.24
5/29/09 9:00 PM	0.11	0.11	0.23
5/29/09 11:00 PM	0.11	0.11	0.22
5/30/09 1:00 AM	0.13	0.13	0.25
5/30/09 3:00 AM	0.12	0.12	0.24
5/30/09 5:00 AM	0.12	0.12	0.25
5/30/09 7:00 AM	0.14	0.14	0.30
5/30/09 9:00 AM	0.13	0.13	0.28
5/30/09 11:00 AM	0.13	0.13	0.21
5/30/09 1:00 PM	0.14	0.14	0.22
5/30/09 3:00 PM	0.14	0.14	0.22
5/30/09 5:00 PM	0.13	0.13	0.20
5/30/09 7:00 PM	0.12	0.12	0.18
5/30/09 9:00 PM	0.11	0.11	0.17
5/30/09 11:00 PM	0.11	0.11	0.15
5/31/09 1:00 AM	0.11	0.11	0.14
5/31/09 3:00 AM	0.12	0.12	0.14

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
5/31/09 5:00 AM	0.11	0.11	0.14
5/31/09 7:00 AM	0.14	0.14	0.12
5/31/09 9:00 AM	0.14	0.14	0.11
5/31/09 11:00 AM	0.15	0.15	0.13
5/31/09 1:00 PM	0.14	0.14	0.15
5/31/09 3:00 PM	0.12	0.12	0.14
5/31/09 5:00 PM	0.11	0.11	0.14
5/31/09 7:00 PM	0.12	0.12	0.15
5/31/09 9:00 PM	0.12	0.12	0.13
5/31/09 11:00 PM	0.11	0.11	0.14
6/1/09 1:00 AM	0.11	0.11	0.13
6/1/09 3:00 AM	0.11	0.11	0.13
6/1/09 5:00 AM	0.11	0.11	0.13
6/1/09 7:00 AM	0.12	0.12	0.14
6/1/09 9:00 AM	0.12	0.12	0.17
6/1/09 11:00 AM	0.12	0.12	0.15
6/1/09 1:00 PM	0.11	0.11	0.15
6/1/09 3:00 PM	0.10	0.10	0.17
6/1/09 5:00 PM	0.08	0.08	0.18
6/1/09 7:00 PM	0.10	0.10	0.18
6/1/09 9:00 PM	0.09	0.09	0.18
6/1/09 11:00 PM	0.10	0.10	0.18
6/2/09 1:00 AM	0.20	0.20	0.18
6/2/09 3:00 AM	0.22	0.22	0.19
6/2/09 5:00 AM	0.23	0.23	0.19
6/2/09 7:00 AM	0.16	0.16	0.19
6/2/09 9:00 AM	0.08	0.08	0.20
6/2/09 11:00 AM	0.07	0.07	0.21
6/2/09 1:00 PM	0.10	0.10	0.20
6/2/09 3:00 PM	0.14	0.14	0.22
6/2/09 5:00 PM	0.19	0.19	0.20
6/2/09 7:00 PM	0.17	0.17	0.20
6/2/09 9:00 PM	0.18	0.18	0.16
6/2/09 11:00 PM	0.17	0.17	0.10
6/3/09 1:00 AM	0.17	0.17	0.11
6/3/09 3:00 AM	0.19	0.19	0.11
6/3/09 5:00 AM	0.19	0.19	0.15
6/3/09 7:00 AM	0.20	0.20	0.22
6/3/09 9:00 AM	0.16	0.16	0.24
6/3/09 11:00 AM	0.15	0.15	0.18
6/3/09 1:00 PM	0.15	0.15	0.16
6/3/09 3:00 PM	0.18	0.18	0.16
6/3/09 5:00 PM	0.16	0.16	0.15
6/3/09 7:00 PM	0.16	0.16	0.14
6/3/09 9:00 PM	0.16	0.16	0.15
6/3/09 11:00 PM	0.17	0.17	0.09
6/4/09 1:00 AM	0.19	0.19	0.09
6/4/09 3:00 AM	0.18	0.18	0.10
6/4/09 5:00 AM	0.17	0.17	0.09
6/4/09 7:00 AM	0.18	0.18	0.16
6/4/09 9:00 AM	0.19	0.19	0.25
6/4/09 11:00 AM	0.19	0.19	0.23
6/4/09 1:00 PM	0.20	0.20	0.23

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
6/4/09 3:00 PM	0.18	0.18	0.22
6/4/09 5:00 PM	0.17	0.17	0.21
6/4/09 7:00 PM	0.16	0.16	0.19
6/4/09 9:00 PM	0.17	0.17	0.16
6/4/09 11:00 PM	0.17	0.17	0.17
6/5/09 1:00 AM	0.21	0.21	0.21
6/5/09 3:00 AM	0.19	0.19	0.19
6/5/09 5:00 AM	0.19	0.19	0.17
6/5/09 7:00 AM	0.19	0.19	0.20
6/5/09 9:00 AM	0.19	0.19	0.18
6/5/09 11:00 AM	0.19	0.19	0.17
6/5/09 1:00 PM	0.18	0.18	0.18
6/5/09 3:00 PM	0.16	0.16	0.18
6/5/09 5:00 PM	0.11	0.11	0.17
6/5/09 7:00 PM	0.16	0.16	0.27
6/5/09 9:00 PM	0.16	0.16	0.17
6/5/09 11:00 PM	0.16	0.16	0.19
6/6/09 1:00 AM	0.15	0.15	0.20
6/6/09 3:00 AM	0.15	0.15	0.19
6/6/09 5:00 AM	0.15	0.15	0.20
6/6/09 7:00 AM	0.17	0.17	0.22
6/6/09 9:00 AM	0.16	0.16	0.23
6/6/09 11:00 AM	0.17	0.17	0.39
6/6/09 1:00 PM	0.16	0.16	0.18
6/6/09 3:00 PM	0.16	0.16	0.16
6/6/09 5:00 PM	0.15	0.15	0.16
6/6/09 7:00 PM	0.15	0.15	0.13
6/6/09 9:00 PM	0.16	0.16	0.13
6/6/09 11:00 PM	0.15	0.15	0.13
6/7/09 1:00 AM	0.15	0.15	0.13
6/7/09 3:00 AM	0.16	0.16	0.12
6/7/09 5:00 AM	0.17	0.17	0.13
6/7/09 7:00 AM	0.19	0.19	0.14
6/7/09 9:00 AM	0.17	0.17	0.14
6/7/09 11:00 AM	0.17	0.17	0.13
6/7/09 1:00 PM	0.15	0.15	0.12
6/7/09 3:00 PM	0.13	0.13	0.12
6/7/09 5:00 PM	0.12	0.12	0.12
6/7/09 7:00 PM	0.12	0.12	0.11
6/7/09 9:00 PM	0.10	0.10	0.12
6/7/09 11:00 PM	0.08	0.08	0.12
6/8/09 1:00 AM	0.06	0.06	0.12
6/8/09 3:00 AM	0.06	0.06	0.12
6/8/09 5:00 AM	0.06	0.06	0.13
6/8/09 7:00 AM	0.10	0.10	0.13
6/8/09 9:00 AM	0.08	0.08	0.13
6/8/09 11:00 AM	0.08	0.08	0.13
6/8/09 1:00 PM	0.08	0.08	0.13
6/8/09 3:00 PM	0.08	0.08	0.13
6/8/09 5:00 PM	0.08	0.08	0.12
6/8/09 7:00 PM	0.08	0.08	0.14
6/8/09 9:00 PM	0.08	0.08	0.13
6/8/09 11:00 PM	0.08	0.08	0.12

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
6/9/09 1:00 AM	0.08	0.08	0.12
6/9/09 3:00 AM	0.08	0.08	0.12
6/9/09 5:00 AM	0.08	0.08	0.13
6/9/09 7:00 AM	0.10	0.10	0.12
6/9/09 9:00 AM	0.09	0.09	0.12
6/9/09 11:00 AM	0.09	0.09	0.12
6/9/09 1:00 PM	0.09	0.09	0.14
6/9/09 3:00 PM	0.09	0.09	0.15
6/9/09 5:00 PM	0.09	0.09	0.16
6/9/09 7:00 PM	0.09	0.09	0.15
6/9/09 9:00 PM	0.09	0.09	0.15
6/9/09 11:00 PM	0.09	0.09	0.15
6/10/09 1:00 AM	0.09	0.09	0.15
6/10/09 3:00 AM	0.09	0.09	0.16
6/10/09 5:00 AM	0.09	0.09	0.18
6/10/09 7:00 AM	0.13	0.13	0.21
6/10/09 9:00 AM	0.17	0.17	0.24
6/10/09 11:00 AM	0.17	0.17	0.20
6/10/09 1:00 PM	0.23	0.23	0.19
6/10/09 3:00 PM	0.22	0.22	0.18
6/10/09 5:00 PM	0.16	0.16	0.19
6/10/09 7:00 PM	0.16	0.16	0.20
6/10/09 9:00 PM	0.16	0.16	0.16
6/10/09 11:00 PM	0.15	0.15	0.16
6/11/09 1:00 AM	0.10	0.10	0.13
6/11/09 3:00 AM	0.10	0.10	0.10
6/11/09 5:00 AM	0.09	0.09	0.13
6/11/09 7:00 AM	0.18	0.18	0.13
6/11/09 9:00 AM	0.25	0.25	0.13
6/11/09 11:00 AM	0.18	0.18	0.14
6/11/09 1:00 PM	0.15	0.15	0.14
6/11/09 3:00 PM	0.15	0.15	0.15
6/11/09 5:00 PM	0.15	0.15	0.15
6/11/09 7:00 PM	0.15	0.15	0.14
6/11/09 9:00 PM	0.16	0.16	0.10
6/11/09 11:00 PM	0.16	0.16	0.02
6/12/09 1:00 AM	0.16	0.16	0.00
6/12/09 3:00 AM	0.15	0.15	0.00
6/12/09 5:00 AM	0.15	0.15	0.00
6/12/09 7:00 AM	0.15	0.15	0.00
6/12/09 9:00 AM	0.15	0.15	0.00
6/12/09 11:00 AM	0.15	0.15	0.00
6/12/09 1:00 PM	0.15	0.15	0.00
6/12/09 3:00 PM	0.15	0.15	0.00
6/12/09 5:00 PM	0.15	0.15	0.00
6/12/09 7:00 PM	0.15	0.15	0.00
6/12/09 9:00 PM	0.15	0.15	0.00
6/12/09 11:00 PM	0.16	0.16	0.00
6/13/09 1:00 AM	0.16	0.16	0.00
6/13/09 3:00 AM	0.16	0.16	0.00
6/13/09 5:00 AM	0.17	0.17	0.00
6/13/09 7:00 AM	0.16	0.16	0.00
6/13/09 9:00 AM	0.17	0.17	0.02

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
6/13/09 11:00 AM	0.17	0.17	0.10
6/13/09 1:00 PM	0.16	0.16	0.28
6/13/09 3:00 PM	0.17	0.17	0.22
6/13/09 5:00 PM	0.17	0.17	0.16
6/13/09 7:00 PM	0.16	0.16	0.11
6/13/09 9:00 PM	0.16	0.16	0.10
6/13/09 11:00 PM	0.16	0.16	0.09
6/14/09 1:00 AM	0.18	0.18	0.10
6/14/09 3:00 AM	0.16	0.16	0.09
6/14/09 5:00 AM	0.16	0.16	0.06
6/14/09 7:00 AM	0.17	0.17	0.05
6/14/09 9:00 AM	0.17	0.17	0.05
6/14/09 11:00 AM	0.17	0.17	0.05
6/14/09 1:00 PM	0.16	0.16	0.07
6/14/09 3:00 PM	0.18	0.18	0.08
6/14/09 5:00 PM	0.18	0.18	0.09
6/14/09 7:00 PM	0.17	0.17	0.08
6/14/09 9:00 PM	0.17	0.17	0.08
6/14/09 11:00 PM	0.17	0.17	0.05
6/15/09 1:00 AM	0.18	0.18	0.05
6/15/09 3:00 AM	0.19	0.19	0.05
6/15/09 5:00 AM	0.19	0.19	0.05
6/15/09 7:00 AM	0.19	0.19	0.05
6/15/09 9:00 AM	0.20	0.20	0.05
6/15/09 11:00 AM	0.20	0.20	0.05
6/15/09 1:00 PM	0.19	0.19	0.05
6/15/09 3:00 PM	0.19	0.19	0.05
6/15/09 5:00 PM	0.17	0.17	0.07
6/15/09 7:00 PM	0.14	0.14	0.09
6/15/09 9:00 PM	0.08	0.08	0.09
6/15/09 11:00 PM	0.09	0.09	0.09
6/16/09 1:00 AM	0.10	0.10	0.09
6/16/09 3:00 AM	0.12	0.12	0.09
6/16/09 5:00 AM	0.14	0.14	0.09
6/16/09 7:00 AM	0.16	0.16	0.08
6/16/09 9:00 AM	0.16	0.16	0.09
6/16/09 11:00 AM	0.16	0.16	0.08
6/16/09 1:00 PM	0.16	0.16	0.08
6/16/09 3:00 PM	0.15	0.15	0.09
6/16/09 5:00 PM	0.14	0.14	0.09
6/16/09 7:00 PM	0.14	0.14	0.09
6/16/09 9:00 PM	0.10	0.10	0.10
6/16/09 11:00 PM	0.10	0.10	0.23
6/17/09 1:00 AM	0.08	0.08	0.28
6/17/09 3:00 AM	0.08	0.08	0.20
6/17/09 5:00 AM	0.08	0.08	0.14
6/17/09 7:00 AM	0.09	0.09	0.14
6/17/09 9:00 AM	0.10	0.10	0.10
6/17/09 11:00 AM	0.10	0.10	0.13
6/17/09 1:00 PM	0.10	0.10	0.13
6/17/09 3:00 PM	0.19	0.19	0.13
6/17/09 5:00 PM	0.15	0.15	0.13
6/17/09 7:00 PM	0.14	0.14	0.14

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
6/17/09 9:00 PM	0.14	0.14	0.18
6/17/09 11:00 PM	0.11	0.11	0.05
6/18/09 1:00 AM	0.11	0.11	0.00
6/18/09 3:00 AM	0.11	0.11	0.00
6/18/09 5:00 AM	0.13	0.13	0.00
6/18/09 7:00 AM	0.16	0.16	0.00
6/18/09 9:00 AM	0.18	0.18	0.00
6/18/09 11:00 AM	0.18	0.18	0.00
6/18/09 1:00 PM	0.17	0.17	0.00
6/18/09 3:00 PM	0.18	0.18	0.00
6/18/09 5:00 PM	0.09	0.09	0.00
6/18/09 7:00 PM	0.09	0.09	0.00
6/18/09 9:00 PM	0.09	0.09	0.00
6/18/09 11:00 PM	0.10	0.10	0.00
6/19/09 1:00 AM	0.11	0.11	0.00
6/19/09 3:00 AM	0.10	0.10	0.00
6/19/09 5:00 AM	0.10	0.10	0.00
6/19/09 7:00 AM	0.09	0.09	0.00
6/19/09 9:00 AM	0.11	0.11	0.00
6/19/09 11:00 AM	0.10	0.10	0.00
6/19/09 1:00 PM	0.10	0.10	0.00
6/19/09 3:00 PM	0.10	0.10	0.00
6/19/09 5:00 PM	0.09	0.09	0.00
6/19/09 7:00 PM	0.09	0.09	0.00
6/19/09 9:00 PM	0.10	0.10	0.00
6/19/09 11:00 PM	0.10	0.10	0.00
6/20/09 1:00 AM	0.10	0.10	0.00
6/20/09 3:00 AM	0.10	0.10	0.00
6/20/09 5:00 AM	0.10	0.10	0.00
6/20/09 7:00 AM	0.10	0.10	0.00
6/20/09 9:00 AM	0.11	0.11	0.00
6/20/09 11:00 AM	0.10	0.10	0.00
6/20/09 1:00 PM	0.11	0.11	0.00
6/20/09 3:00 PM	0.13	0.13	0.00
6/20/09 5:00 PM	0.10	0.10	0.00
6/20/09 7:00 PM	0.10	0.10	0.00
6/20/09 9:00 PM	0.10	0.10	0.00
6/20/09 11:00 PM	0.10	0.10	0.00
6/21/09 1:00 AM	0.10	0.10	0.00
6/21/09 3:00 AM	0.10	0.10	0.00
6/21/09 5:00 AM	0.10	0.10	0.00
6/21/09 7:00 AM	0.11	0.11	0.00
6/21/09 9:00 AM	0.11	0.11	0.00
6/21/09 11:00 AM	0.11	0.11	0.00
6/21/09 1:00 PM	0.14	0.14	0.00
6/21/09 3:00 PM	0.18	0.18	0.00
6/21/09 5:00 PM	0.11	0.11	0.00
6/21/09 7:00 PM	0.11	0.11	0.00
6/21/09 9:00 PM	0.11	0.11	0.00
6/21/09 11:00 PM	0.11	0.11	0.00
6/22/09 1:00 AM	0.11	0.11	0.00
6/22/09 3:00 AM	0.11	0.11	0.00
6/22/09 5:00 AM	0.11	0.11	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
6/22/09 7:00 AM	0.11	0.11	0.00
6/22/09 9:00 AM	0.00	0.00	0.00
6/22/09 11:00 AM	0.00	0.00	0.00
6/22/09 1:00 PM	0.00	0.00	0.00
6/22/09 3:00 PM	0.00	0.00	0.00
6/22/09 5:00 PM	0.00	0.00	0.00
6/22/09 7:00 PM	0.00	0.00	0.00
6/22/09 9:00 PM	0.00	0.00	0.00
6/22/09 11:00 PM	0.00	0.00	0.00
6/23/09 1:00 AM	0.00	0.00	0.00
6/23/09 3:00 AM	0.00	0.00	0.00
6/23/09 5:00 AM	0.00	0.00	0.00
6/23/09 7:00 AM	0.00	0.00	0.00
6/23/09 9:00 AM	0.07	0.07	0.00
6/23/09 11:00 AM	0.19	0.19	0.00
6/23/09 1:00 PM	0.24	0.24	0.00
6/23/09 3:00 PM	0.28	0.28	0.00
6/23/09 5:00 PM	0.24	0.24	0.00
6/23/09 7:00 PM	0.24	0.24	0.00
6/23/09 9:00 PM	0.24	0.24	0.00
6/23/09 11:00 PM	0.24	0.24	0.00
6/24/09 1:00 AM	0.24	0.24	0.00
6/24/09 3:00 AM	0.24	0.24	0.00
6/24/09 5:00 AM	0.24	0.24	0.00
6/24/09 7:00 AM	0.23	0.23	0.00
6/24/09 9:00 AM	0.23	0.23	0.00
6/24/09 11:00 AM	0.20	0.20	0.00
6/24/09 1:00 PM	0.12	0.12	0.00
6/24/09 3:00 PM	0.12	0.12	0.00
6/24/09 5:00 PM	0.12	0.12	0.00
6/24/09 7:00 PM	0.12	0.12	0.00
6/24/09 9:00 PM	0.12	0.12	0.00
6/24/09 11:00 PM	0.10	0.10	0.00
6/25/09 1:00 AM	0.11	0.11	0.00
6/25/09 3:00 AM	0.10	0.10	0.00
6/25/09 5:00 AM	0.11	0.11	0.00
6/25/09 7:00 AM	0.11	0.11	0.00
6/25/09 9:00 AM	0.12	0.12	0.00
6/25/09 11:00 AM	0.12	0.12	0.00
6/25/09 1:00 PM	0.13	0.13	0.00
6/25/09 3:00 PM	0.12	0.12	0.00
6/25/09 5:00 PM	0.12	0.12	0.00
6/25/09 7:00 PM	0.12	0.12	0.00
6/25/09 9:00 PM	0.12	0.12	0.00
6/25/09 11:00 PM	0.12	0.12	0.00
6/26/09 1:00 AM	0.12	0.12	0.00
6/26/09 3:00 AM	0.12	0.12	0.00
6/26/09 5:00 AM	0.12	0.12	0.00
6/26/09 7:00 AM	0.12	0.12	0.00
6/26/09 9:00 AM	0.11	0.11	0.00
6/26/09 11:00 AM	0.11	0.11	0.00
6/26/09 1:00 PM	0.11	0.11	0.00
6/26/09 3:00 PM	0.11	0.11	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
6/26/09 5:00 PM	0.11	0.11	0.00
6/26/09 7:00 PM	0.11	0.11	0.00
6/26/09 9:00 PM	0.12	0.12	0.00
6/26/09 11:00 PM	0.12	0.12	0.00
6/27/09 1:00 AM	0.11	0.11	0.00
6/27/09 3:00 AM	0.11	0.11	0.00
6/27/09 5:00 AM	0.12	0.12	0.00
6/27/09 7:00 AM	0.11	0.11	0.00
6/27/09 9:00 AM	0.12	0.12	0.00
6/27/09 11:00 AM	0.12	0.12	0.00
6/27/09 1:00 PM	0.12	0.12	0.00
6/27/09 3:00 PM	0.12	0.12	0.00
6/27/09 5:00 PM	0.11	0.11	0.00
6/27/09 7:00 PM	0.11	0.11	0.00
6/27/09 9:00 PM	0.11	0.11	0.00
6/27/09 11:00 PM	0.11	0.11	0.00
6/28/09 1:00 AM	0.11	0.11	0.00
6/28/09 3:00 AM	0.11	0.11	0.00
6/28/09 5:00 AM	0.11	0.11	0.00
6/28/09 7:00 AM	0.11	0.11	0.00
6/28/09 9:00 AM	0.12	0.12	0.02
6/28/09 11:00 AM	0.12	0.12	0.15
6/28/09 1:00 PM	0.11	0.11	0.10
6/28/09 3:00 PM	0.11	0.11	0.20
6/28/09 5:00 PM	0.11	0.11	0.25
6/28/09 7:00 PM	0.11	0.11	0.25
6/28/09 9:00 PM	0.11	0.11	0.21
6/28/09 11:00 PM	0.11	0.11	0.13
6/29/09 1:00 AM	0.10	0.10	0.11
6/29/09 3:00 AM	0.11	0.11	0.13
6/29/09 5:00 AM	0.11	0.11	0.15
6/29/09 7:00 AM	0.11	0.11	0.13
6/29/09 9:00 AM	0.11	0.11	0.13
6/29/09 11:00 AM	0.11	0.11	0.12
6/29/09 1:00 PM	0.11	0.11	0.13
6/29/09 3:00 PM	0.11	0.11	0.13
6/29/09 5:00 PM	0.10	0.10	0.12
6/29/09 7:00 PM	0.10	0.10	0.12
6/29/09 9:00 PM	0.10	0.10	0.12
6/29/09 11:00 PM	0.10	0.10	0.11
6/30/09 1:00 AM	0.10	0.10	0.11
6/30/09 3:00 AM	0.10	0.10	0.11
6/30/09 5:00 AM	0.09	0.09	0.11
6/30/09 7:00 AM	0.10	0.10	0.11
6/30/09 9:00 AM	0.10	0.10	0.12
6/30/09 11:00 AM	0.10	0.10	0.12
6/30/09 1:00 PM	0.10	0.10	0.11
6/30/09 3:00 PM	0.19	0.19	0.10
6/30/09 5:00 PM	0.00	0.00	0.10
6/30/09 7:00 PM	0.00	0.00	0.10
6/30/09 9:00 PM	0.00	0.00	0.10
6/30/09 11:00 PM	0.00	0.00	0.09
7/1/09 1:00 AM	0.00	0.00	0.09

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
7/1/09 3:00 AM	0.00	0.00	0.09
7/1/09 5:00 AM	0.00	0.00	0.09
7/1/09 7:00 AM	0.00	0.00	0.11
7/1/09 9:00 AM	0.00	0.00	0.12
7/1/09 11:00 AM	0.00	0.00	0.12
7/1/09 1:00 PM	0.00	0.00	0.13
7/1/09 3:00 PM	0.00	0.00	0.13
7/1/09 5:00 PM	0.00	0.00	0.13
7/1/09 7:00 PM	0.00	0.00	0.13
7/1/09 9:00 PM	0.00	0.00	0.13
7/1/09 11:00 PM	0.00	0.00	0.13
7/2/09 1:00 AM	0.00	0.00	0.12
7/2/09 3:00 AM	0.00	0.00	0.11
7/2/09 5:00 AM	0.00	0.00	0.12
7/2/09 7:00 AM	0.00	0.00	0.13
7/2/09 9:00 AM	0.00	0.00	0.14
7/2/09 11:00 AM	0.00	0.00	0.17
7/2/09 1:00 PM	0.00	0.00	0.18
7/2/09 3:00 PM	0.00	0.00	0.17
7/2/09 5:00 PM	0.00	0.00	0.21
7/2/09 7:00 PM	0.00	0.00	0.23
7/2/09 9:00 PM	0.00	0.00	0.26
7/2/09 11:00 PM	0.00	0.00	0.22
7/3/09 1:00 AM	0.00	0.00	0.23
7/3/09 3:00 AM	0.00	0.00	0.21
7/3/09 5:00 AM	0.00	0.00	0.21
7/3/09 7:00 AM	0.00	0.00	0.25
7/3/09 9:00 AM	0.00	0.00	0.39
7/3/09 11:00 AM	0.00	0.00	0.34
7/3/09 1:00 PM	0.00	0.00	0.22
7/3/09 3:00 PM	0.00	0.00	0.36
7/3/09 5:00 PM	0.00	0.00	0.27
7/3/09 7:00 PM	0.00	0.00	0.26
7/3/09 9:00 PM	0.00	0.00	0.18
7/3/09 11:00 PM	0.00	0.00	0.15
7/4/09 1:00 AM	0.00	0.00	0.16
7/4/09 3:00 AM	0.00	0.00	0.18
7/4/09 5:00 AM	0.00	0.00	0.20
7/4/09 7:00 AM	0.00	0.00	0.22
7/4/09 9:00 AM	0.00	0.00	0.21
7/4/09 11:00 AM	0.00	0.00	0.18
7/4/09 1:00 PM	0.00	0.00	0.18
7/4/09 3:00 PM	0.00	0.00	0.19
7/4/09 5:00 PM	0.00	0.00	0.16
7/4/09 7:00 PM	0.00	0.00	0.15
7/4/09 9:00 PM	0.00	0.00	0.15
7/4/09 11:00 PM	0.00	0.00	0.13
7/5/09 1:00 AM	0.00	0.00	0.14
7/5/09 3:00 AM	0.00	0.00	0.14
7/5/09 5:00 AM	0.01	0.01	0.12
7/5/09 7:00 AM	0.01	0.01	0.12
7/5/09 9:00 AM	0.03	0.03	0.12
7/5/09 11:00 AM	0.03	0.03	0.12

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
7/5/09 1:00 PM	0.04	0.04	0.13
7/5/09 3:00 PM	0.04	0.04	0.13
7/5/09 5:00 PM	0.03	0.03	0.14
7/5/09 7:00 PM	0.03	0.03	0.16
7/5/09 9:00 PM	0.03	0.03	0.16
7/5/09 11:00 PM	0.03	0.03	0.16
7/6/09 1:00 AM	0.03	0.03	0.19
7/6/09 3:00 AM	0.03	0.03	0.21
7/6/09 5:00 AM	0.03	0.03	0.12
7/6/09 7:00 AM	0.04	0.04	0.09
7/6/09 9:00 AM	0.05	0.05	0.07
7/6/09 11:00 AM	0.05	0.05	0.06
7/6/09 1:00 PM	0.05	0.05	0.09
7/6/09 3:00 PM	0.05	0.05	0.16
7/6/09 5:00 PM	0.04	0.04	0.19
7/6/09 7:00 PM	0.04	0.04	0.19
7/6/09 9:00 PM	0.04	0.04	0.18
7/6/09 11:00 PM	0.05	0.05	0.16
7/7/09 1:00 AM	0.04	0.04	0.15
7/7/09 3:00 AM	0.05	0.05	0.14
7/7/09 5:00 AM	0.05	0.05	0.16
7/7/09 7:00 AM	0.05	0.05	0.19
7/7/09 9:00 AM	0.06	0.06	0.17
7/7/09 11:00 AM	0.06	0.06	0.16
7/7/09 1:00 PM	0.06	0.06	0.14
7/7/09 3:00 PM	0.06	0.06	0.14
7/7/09 5:00 PM	0.05	0.05	0.13
7/7/09 7:00 PM	0.04	0.04	0.13
7/7/09 9:00 PM	0.04	0.04	0.13
7/7/09 11:00 PM	0.05	0.05	0.09
7/8/09 1:00 AM	0.05	0.05	0.08
7/8/09 3:00 AM	0.05	0.05	0.08
7/8/09 5:00 AM	0.06	0.06	0.08
7/8/09 7:00 AM	0.06	0.06	0.11
7/8/09 9:00 AM	0.07	0.07	0.14
7/8/09 11:00 AM	0.07	0.07	0.13
7/8/09 1:00 PM	0.08	0.08	0.15
7/8/09 3:00 PM	0.09	0.09	0.14
7/8/09 5:00 PM	0.08	0.08	0.12
7/8/09 7:00 PM	0.09	0.09	0.12
7/8/09 9:00 PM	0.09	0.09	0.14
7/8/09 11:00 PM	0.09	0.09	0.17
7/9/09 1:00 AM	0.09	0.09	0.15
7/9/09 3:00 AM	0.08	0.08	0.11
7/9/09 5:00 AM	0.09	0.09	0.14
7/9/09 7:00 AM	0.10	0.10	0.15
7/9/09 9:00 AM	0.11	0.11	0.16
7/9/09 11:00 AM	0.11	0.11	0.17
7/9/09 1:00 PM	0.10	0.10	0.16
7/9/09 3:00 PM	0.10	0.10	0.14
7/9/09 5:00 PM	0.09	0.09	0.16
7/9/09 7:00 PM	0.10	0.10	0.14
7/9/09 9:00 PM	0.09	0.09	0.13

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
7/9/09 11:00 PM	0.09	0.09	0.23
7/10/09 1:00 AM	0.09	0.09	0.18
7/10/09 3:00 AM	0.09	0.09	0.20
7/10/09 5:00 AM	0.09	0.09	0.23
7/10/09 7:00 AM	0.09	0.09	0.26
7/10/09 9:00 AM	0.11	0.11	0.27
7/10/09 11:00 AM	0.18	0.18	0.32
7/10/09 1:00 PM	0.19	0.19	0.32
7/10/09 3:00 PM	0.10	0.10	0.20
7/10/09 5:00 PM	0.10	0.10	0.22
7/10/09 7:00 PM	0.09	0.09	0.19
7/10/09 9:00 PM	0.09	0.09	0.20
7/10/09 11:00 PM	0.09	0.09	0.19
7/11/09 1:00 AM	0.09	0.09	0.19
7/11/09 3:00 AM	0.09	0.09	0.18
7/11/09 5:00 AM	0.09	0.09	0.18
7/11/09 7:00 AM	0.09	0.09	0.19
7/11/09 9:00 AM	0.10	0.10	0.16
7/11/09 11:00 AM	0.10	0.10	0.18
7/11/09 1:00 PM	0.11	0.11	0.18
7/11/09 3:00 PM	0.11	0.11	0.20
7/11/09 5:00 PM	0.10	0.10	0.21
7/11/09 7:00 PM	0.10	0.10	0.79
7/11/09 9:00 PM	0.10	0.10	0.96
7/11/09 11:00 PM	0.08	0.08	0.10
7/12/09 1:00 AM	0.08	0.08	0.27
7/12/09 3:00 AM	0.08	0.08	0.19
7/12/09 5:00 AM	0.08	0.08	0.17
7/12/09 7:00 AM	0.10	0.10	0.17
7/12/09 9:00 AM	0.11	0.11	0.17
7/12/09 11:00 AM	0.11	0.11	0.19
7/12/09 1:00 PM	0.10	0.10	0.17
7/12/09 3:00 PM	0.10	0.10	0.17
7/12/09 5:00 PM	0.10	0.10	0.18
7/12/09 7:00 PM	0.10	0.10	0.16
7/12/09 9:00 PM	0.10	0.10	0.17
7/12/09 11:00 PM	0.10	0.10	0.22
7/13/09 1:00 AM	0.10	0.10	0.17
7/13/09 3:00 AM	0.10	0.10	0.17
7/13/09 5:00 AM	0.10	0.10	0.17
7/13/09 7:00 AM	0.10	0.10	0.18
7/13/09 9:00 AM	0.10	0.10	0.25
7/13/09 11:00 AM	0.10	0.10	0.17
7/13/09 1:00 PM	0.10	0.10	0.20
7/13/09 3:00 PM	0.10	0.10	0.17
7/13/09 5:00 PM	0.10	0.10	0.16
7/13/09 7:00 PM	0.09	0.09	0.17
7/13/09 9:00 PM	0.09	0.09	0.17
7/13/09 11:00 PM	0.09	0.09	0.18
7/14/09 1:00 AM	0.09	0.09	0.19
7/14/09 3:00 AM	0.09	0.09	0.18
7/14/09 5:00 AM	0.08	0.08	0.18
7/14/09 7:00 AM	0.15	0.15	0.18

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
7/14/09 9:00 AM	0.23	0.23	0.19
7/14/09 11:00 AM	0.23	0.23	0.20
7/14/09 1:00 PM	0.23	0.23	0.22
7/14/09 3:00 PM	0.22	0.22	0.21
7/14/09 5:00 PM	0.21	0.21	0.19
7/14/09 7:00 PM	0.21	0.21	0.20
7/14/09 9:00 PM	0.21	0.21	0.19
7/14/09 11:00 PM	0.20	0.20	0.19
7/15/09 1:00 AM	0.21	0.21	0.17
7/15/09 3:00 AM	0.20	0.20	0.18
7/15/09 5:00 AM	0.20	0.20	0.18
7/15/09 7:00 AM	0.21	0.21	0.18
7/15/09 9:00 AM	0.18	0.18	0.23
7/15/09 11:00 AM	0.13	0.13	0.21
7/15/09 1:00 PM	0.12	0.12	0.21
7/15/09 3:00 PM	0.07	0.07	0.20
7/15/09 5:00 PM	0.06	0.06	0.20
7/15/09 7:00 PM	0.07	0.07	0.20
7/15/09 9:00 PM	0.07	0.07	0.18
7/15/09 11:00 PM	0.07	0.07	0.22
7/16/09 1:00 AM	0.07	0.07	0.24
7/16/09 3:00 AM	0.07	0.07	0.19
7/16/09 5:00 AM	0.07	0.07	0.17
7/16/09 7:00 AM	0.10	0.10	0.18
7/16/09 9:00 AM	0.25	0.25	0.16
7/16/09 11:00 AM	0.22	0.22	0.15
7/16/09 1:00 PM	0.20	0.20	0.15
7/16/09 3:00 PM	0.22	0.22	0.16
7/16/09 5:00 PM	0.22	0.22	0.26
7/16/09 7:00 PM	0.23	0.23	0.25
7/16/09 9:00 PM	0.23	0.23	0.28
7/16/09 11:00 PM	0.23	0.23	0.34
7/17/09 1:00 AM	0.23	0.23	0.34
7/17/09 3:00 AM	0.24	0.24	0.36
7/17/09 5:00 AM	0.24	0.24	0.37
7/17/09 7:00 AM	0.15	0.15	0.49
7/17/09 9:00 AM	0.09	0.09	0.45
7/17/09 11:00 AM	0.10	0.10	0.40
7/17/09 1:00 PM	0.10	0.10	0.24
7/17/09 3:00 PM	0.10	0.10	0.25
7/17/09 5:00 PM	0.10	0.10	0.15
7/17/09 7:00 PM	0.10	0.10	0.22
7/17/09 9:00 PM	0.10	0.10	0.19
7/17/09 11:00 PM	0.10	0.10	0.16
7/18/09 1:00 AM	0.14	0.14	0.15
7/18/09 3:00 AM	0.10	0.10	0.13
7/18/09 5:00 AM	0.10	0.10	0.11
7/18/09 7:00 AM	0.10	0.10	0.13
7/18/09 9:00 AM	0.11	0.11	0.13
7/18/09 11:00 AM	0.16	0.16	0.18
7/18/09 1:00 PM	0.12	0.12	0.25
7/18/09 3:00 PM	0.12	0.12	0.22
7/18/09 5:00 PM	0.11	0.11	0.20

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
7/18/09 7:00 PM	0.11	0.11	0.17
7/18/09 9:00 PM	0.11	0.11	0.18
7/18/09 11:00 PM	0.00	0.00	0.16
7/19/09 1:00 AM	0.00	0.00	0.18
7/19/09 3:00 AM	0.00	0.00	0.17
7/19/09 5:00 AM	0.00	0.00	0.16
7/19/09 7:00 AM	0.00	0.00	0.16
7/19/09 9:00 AM	0.00	0.00	0.18
7/19/09 11:00 AM	0.00	0.00	0.16
7/19/09 1:00 PM	0.00	0.00	0.13
7/19/09 3:00 PM	0.00	0.00	0.12
7/19/09 5:00 PM	0.00	0.00	0.12
7/19/09 7:00 PM	0.00	0.00	0.11
7/19/09 9:00 PM	0.00	0.00	0.10
7/19/09 11:00 PM	0.00	0.00	0.10
7/20/09 1:00 AM	0.00	0.00	0.10
7/20/09 3:00 AM	0.00	0.00	0.10
7/20/09 5:00 AM	0.00	0.00	0.10
7/20/09 7:00 AM	0.00	0.00	0.10
7/20/09 9:00 AM	0.00	0.00	0.09
7/20/09 11:00 AM	0.00	0.00	0.10
7/20/09 1:00 PM	0.00	0.00	0.10
7/20/09 3:00 PM	0.00	0.00	0.11
7/20/09 5:00 PM	0.00	0.00	0.12
7/20/09 7:00 PM	0.00	0.00	0.12
7/20/09 9:00 PM	0.00	0.00	0.12
7/20/09 11:00 PM	0.00	0.00	0.09
7/21/09 1:00 AM	0.00	0.00	0.08
7/21/09 3:00 AM	0.00	0.00	0.08
7/21/09 5:00 AM	0.00	0.00	0.07
7/21/09 7:00 AM	0.00	0.00	0.08
7/21/09 9:00 AM	0.00	0.00	0.11
7/21/09 11:00 AM	0.00	0.00	0.12
7/21/09 1:00 PM	0.00	0.00	0.13
7/21/09 3:00 PM	0.00	0.00	0.14
7/21/09 5:00 PM	0.00	0.00	0.13
7/21/09 7:00 PM	0.00	0.00	0.14
7/21/09 9:00 PM	0.00	0.00	0.12
7/21/09 11:00 PM	0.00	0.00	0.15
7/22/09 1:00 AM	0.00	0.00	0.15
7/22/09 3:00 AM	0.00	0.00	0.14
7/22/09 5:00 AM	0.00	0.00	0.14
7/22/09 7:00 AM	0.00	0.00	0.16
7/22/09 9:00 AM	0.00	0.00	0.16
7/22/09 11:00 AM	0.00	0.00	0.18
7/22/09 1:00 PM	0.00	0.00	0.20
7/22/09 3:00 PM	0.00	0.00	0.25
7/22/09 5:00 PM	0.00	0.00	0.23
7/22/09 7:00 PM	0.00	0.00	0.15
7/22/09 9:00 PM	0.00	0.00	0.16
7/22/09 11:00 PM	0.00	0.00	0.16
7/23/09 1:00 AM	0.00	0.00	0.16
7/23/09 3:00 AM	0.00	0.00	0.17

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
7/23/09 5:00 AM	0.00	0.00	0.16
7/23/09 7:00 AM	0.00	0.00	0.17
7/23/09 9:00 AM	0.00	0.00	0.20
7/23/09 11:00 AM	0.00	0.00	0.22
7/23/09 1:00 PM	0.00	0.00	0.22
7/23/09 3:00 PM	0.00	0.00	0.23
7/23/09 5:00 PM	0.00	0.00	0.22
7/23/09 7:00 PM	0.00	0.00	0.20
7/23/09 9:00 PM	0.00	0.00	0.20
7/23/09 11:00 PM	0.00	0.00	0.17
7/24/09 1:00 AM	0.00	0.00	0.14
7/24/09 3:00 AM	0.00	0.00	0.12
7/24/09 5:00 AM	0.00	0.00	0.15
7/24/09 7:00 AM	0.00	0.00	0.17
7/24/09 9:00 AM	0.01	0.01	0.17
7/24/09 11:00 AM	0.03	0.03	0.18
7/24/09 1:00 PM	0.04	0.04	0.19
7/24/09 3:00 PM	0.07	0.07	0.19
7/24/09 5:00 PM	0.10	0.10	0.19
7/24/09 7:00 PM	0.14	0.14	0.17
7/24/09 9:00 PM	0.20	0.20	0.15
7/24/09 11:00 PM	0.26	0.26	0.15
7/25/09 1:00 AM	0.26	0.26	0.22
7/25/09 3:00 AM	0.25	0.25	0.16
7/25/09 5:00 AM	0.25	0.25	0.14
7/25/09 7:00 AM	0.22	0.22	0.17
7/25/09 9:00 AM	0.12	0.12	0.15
7/25/09 11:00 AM	0.13	0.13	0.15
7/25/09 1:00 PM	0.12	0.12	0.14
7/25/09 3:00 PM	0.12	0.12	0.13
7/25/09 5:00 PM	0.12	0.12	0.12
7/25/09 7:00 PM	0.11	0.11	0.11
7/25/09 9:00 PM	0.11	0.11	0.11
7/25/09 11:00 PM	0.11	0.11	0.11
7/26/09 1:00 AM	0.11	0.11	0.10
7/26/09 3:00 AM	0.11	0.11	0.11
7/26/09 5:00 AM	0.11	0.11	0.11
7/26/09 7:00 AM	0.11	0.11	0.11
7/26/09 9:00 AM	0.11	0.11	0.10
7/26/09 11:00 AM	0.11	0.11	0.10
7/26/09 1:00 PM	0.11	0.11	0.12
7/26/09 3:00 PM	0.11	0.11	0.16
7/26/09 5:00 PM	0.10	0.10	0.08
7/26/09 7:00 PM	0.10	0.10	0.00
7/26/09 9:00 PM	0.10	0.10	0.00
7/26/09 11:00 PM	0.09	0.09	0.00
7/27/09 1:00 AM	0.09	0.09	0.00
7/27/09 3:00 AM	0.10	0.10	0.00
7/27/09 5:00 AM	0.10	0.10	0.00
7/27/09 7:00 AM	0.10	0.10	0.00
7/27/09 9:00 AM	0.10	0.10	0.00
7/27/09 11:00 AM	0.10	0.10	0.00
7/27/09 1:00 PM	0.11	0.11	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
7/27/09 3:00 PM	0.10	0.10	0.00
7/27/09 5:00 PM	0.10	0.10	0.00
7/27/09 7:00 PM	0.10	0.10	0.00
7/27/09 9:00 PM	0.09	0.09	0.00
7/27/09 11:00 PM	0.10	0.10	0.00
7/28/09 1:00 AM	0.09	0.09	0.00
7/28/09 3:00 AM	0.09	0.09	0.00
7/28/09 5:00 AM	0.09	0.09	0.00
7/28/09 7:00 AM	0.07	0.07	0.01
7/28/09 9:00 AM	0.07	0.07	0.00
7/28/09 11:00 AM	0.10	0.10	0.00
7/28/09 1:00 PM	0.16	0.16	0.00
7/28/09 3:00 PM	0.15	0.15	0.01
7/28/09 5:00 PM	0.15	0.15	0.02
7/28/09 7:00 PM	0.15	0.15	0.05
7/28/09 9:00 PM	0.10	0.10	0.07
7/28/09 11:00 PM	0.07	0.07	0.07
7/29/09 1:00 AM	0.07	0.07	0.08
7/29/09 3:00 AM	0.07	0.07	0.08
7/29/09 5:00 AM	0.07	0.07	0.08
7/29/09 7:00 AM	0.07	0.07	0.08
7/29/09 9:00 AM	0.08	0.08	0.08
7/29/09 11:00 AM	0.10	0.10	0.08
7/29/09 1:00 PM	0.15	0.15	0.09
7/29/09 3:00 PM	0.15	0.15	0.08
7/29/09 5:00 PM	0.14	0.14	0.08
7/29/09 7:00 PM	0.13	0.13	0.08
7/29/09 9:00 PM	0.13	0.13	0.08
7/29/09 11:00 PM	0.13	0.13	0.08
7/30/09 1:00 AM	0.12	0.12	0.09
7/30/09 3:00 AM	0.11	0.11	0.09
7/30/09 5:00 AM	0.12	0.12	0.09
7/30/09 7:00 AM	0.14	0.14	0.09
7/30/09 9:00 AM	0.16	0.16	0.09
7/30/09 11:00 AM	0.16	0.16	0.08
7/30/09 1:00 PM	0.16	0.16	0.08
7/30/09 3:00 PM	0.15	0.15	0.08
7/30/09 5:00 PM	0.15	0.15	0.08
7/30/09 7:00 PM	0.15	0.15	0.08
7/30/09 9:00 PM	0.15	0.15	0.08
7/30/09 11:00 PM	0.16	0.16	0.09
7/31/09 1:00 AM	0.15	0.15	0.09
7/31/09 3:00 AM	0.16	0.16	0.09
7/31/09 5:00 AM	0.16	0.16	0.09
7/31/09 7:00 AM	0.16	0.16	0.09
7/31/09 9:00 AM	0.17	0.17	0.09
7/31/09 11:00 AM	0.18	0.18	0.09
7/31/09 1:00 PM	0.18	0.18	0.09
7/31/09 3:00 PM	0.20	0.20	0.09
7/31/09 5:00 PM	0.20	0.20	0.09
7/31/09 7:00 PM	0.20	0.20	0.08
7/31/09 9:00 PM	0.18	0.18	0.09
7/31/09 11:00 PM	0.18	0.18	0.09

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
8/1/09 1:00 AM	0.17	0.17	0.09
8/1/09 3:00 AM	0.18	0.18	0.09
8/1/09 5:00 AM	0.18	0.18	0.09
8/1/09 7:00 AM	0.17	0.17	0.09
8/1/09 9:00 AM	0.17	0.17	0.08
8/1/09 11:00 AM	0.18	0.18	0.08
8/1/09 1:00 PM	0.18	0.18	0.08
8/1/09 3:00 PM	0.20	0.20	0.09
8/1/09 5:00 PM	0.18	0.18	0.10
8/1/09 7:00 PM	0.17	0.17	0.10
8/1/09 9:00 PM	0.19	0.19	0.10
8/1/09 11:00 PM	0.19	0.19	0.09
8/2/09 1:00 AM	0.21	0.21	0.09
8/2/09 3:00 AM	0.20	0.20	0.08
8/2/09 5:00 AM	0.20	0.20	0.09
8/2/09 7:00 AM	0.21	0.21	0.09
8/2/09 9:00 AM	0.21	0.21	0.09
8/2/09 11:00 AM	0.21	0.21	0.15
8/2/09 1:00 PM	0.21	0.21	0.15
8/2/09 3:00 PM	0.22	0.22	0.16
8/2/09 5:00 PM	0.22	0.22	0.16
8/2/09 7:00 PM	0.22	0.22	0.16
8/2/09 9:00 PM	0.22	0.22	0.15
8/2/09 11:00 PM	0.22	0.22	0.15
8/3/09 1:00 AM	0.23	0.23	0.16
8/3/09 3:00 AM	0.22	0.22	0.16
8/3/09 5:00 AM	0.22	0.22	0.16
8/3/09 7:00 AM	0.23	0.23	0.18
8/3/09 9:00 AM	0.23	0.23	0.23
8/3/09 11:00 AM	0.23	0.23	0.23
8/3/09 1:00 PM	0.24	0.24	0.24
8/3/09 3:00 PM	0.21	0.21	0.21
8/3/09 5:00 PM	0.13	0.13	0.21
8/3/09 7:00 PM	0.13	0.13	0.22
8/3/09 9:00 PM	0.12	0.12	0.21
8/3/09 11:00 PM	0.10	0.10	0.23
8/4/09 1:00 AM	0.10	0.10	0.25
8/4/09 3:00 AM	0.09	0.09	0.24
8/4/09 5:00 AM	0.09	0.09	0.30
8/4/09 7:00 AM	0.09	0.09	0.25
8/4/09 9:00 AM	0.11	0.11	0.24
8/4/09 11:00 AM	0.12	0.12	0.21
8/4/09 1:00 PM	0.12	0.12	0.21
8/4/09 3:00 PM	0.13	0.13	0.21
8/4/09 5:00 PM	0.12	0.12	0.20
8/4/09 7:00 PM	0.22	0.22	0.22
8/4/09 9:00 PM	0.23	0.23	0.26
8/4/09 11:00 PM	0.13	0.13	0.22
8/5/09 1:00 AM	0.12	0.12	0.25
8/5/09 3:00 AM	0.13	0.13	0.22
8/5/09 5:00 AM	0.12	0.12	0.33
8/5/09 7:00 AM	0.12	0.12	0.28
8/5/09 9:00 AM	0.13	0.13	0.27

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
8/5/09 11:00 AM	0.14	0.14	0.31
8/5/09 1:00 PM	0.14	0.14	0.30
8/5/09 3:00 PM	0.13	0.13	0.29
8/5/09 5:00 PM	0.14	0.14	0.25
8/5/09 7:00 PM	0.13	0.13	0.27
8/5/09 9:00 PM	0.12	0.12	0.27
8/5/09 11:00 PM	0.12	0.12	0.15
8/6/09 1:00 AM	0.14	0.14	0.14
8/6/09 3:00 AM	0.14	0.14	0.19
8/6/09 5:00 AM	0.13	0.13	0.22
8/6/09 7:00 AM	0.13	0.13	0.22
8/6/09 9:00 AM	0.14	0.14	0.24
8/6/09 11:00 AM	0.14	0.14	0.34
8/6/09 1:00 PM	0.14	0.14	0.21
8/6/09 3:00 PM	0.14	0.14	0.19
8/6/09 5:00 PM	0.13	0.13	0.16
8/6/09 7:00 PM	0.13	0.13	0.15
8/6/09 9:00 PM	0.12	0.12	0.16
8/6/09 11:00 PM	0.12	0.12	0.16
8/7/09 1:00 AM	0.13	0.13	0.15
8/7/09 3:00 AM	0.13	0.13	0.14
8/7/09 5:00 AM	0.13	0.13	0.12
8/7/09 7:00 AM	0.14	0.14	0.06
8/7/09 9:00 AM	0.15	0.15	0.00
8/7/09 11:00 AM	0.11	0.11	0.00
8/7/09 1:00 PM	0.00	0.00	0.00
8/7/09 3:00 PM	0.00	0.00	0.00
8/7/09 5:00 PM	0.09	0.09	0.00
8/7/09 7:00 PM	0.10	0.10	0.00
8/7/09 9:00 PM	0.10	0.10	0.00
8/7/09 11:00 PM	0.09	0.09	0.00
8/8/09 1:00 AM	0.09	0.09	0.00
8/8/09 3:00 AM	0.09	0.09	0.00
8/8/09 5:00 AM	0.09	0.09	0.00
8/8/09 7:00 AM	0.10	0.10	0.00
8/8/09 9:00 AM	0.11	0.11	0.00
8/8/09 11:00 AM	0.10	0.10	0.00
8/8/09 1:00 PM	0.19	0.19	0.00
8/8/09 3:00 PM	0.16	0.16	0.00
8/8/09 5:00 PM	0.11	0.11	0.00
8/8/09 7:00 PM	0.11	0.11	0.00
8/8/09 9:00 PM	0.11	0.11	0.00
8/8/09 11:00 PM	0.11	0.11	0.00
8/9/09 1:00 AM	0.11	0.11	0.00
8/9/09 3:00 AM	0.11	0.11	0.00
8/9/09 5:00 AM	0.11	0.11	0.00
8/9/09 7:00 AM	0.11	0.11	0.00
8/9/09 9:00 AM	0.11	0.11	0.00
8/9/09 11:00 AM	0.12	0.12	0.00
8/9/09 1:00 PM	0.14	0.14	0.00
8/9/09 3:00 PM	0.11	0.11	0.00
8/9/09 5:00 PM	0.14	0.14	0.00
8/9/09 7:00 PM	0.14	0.14	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
8/9/09 9:00 PM	0.12	0.12	0.00
8/9/09 11:00 PM	0.11	0.11	0.13
8/10/09 1:00 AM	0.10	0.10	0.17
8/10/09 3:00 AM	0.10	0.10	0.17
8/10/09 5:00 AM	0.11	0.11	0.17
8/10/09 7:00 AM	0.12	0.12	0.19
8/10/09 9:00 AM	0.12	0.12	0.24
8/10/09 11:00 AM	0.11	0.11	0.26
8/10/09 1:00 PM	0.11	0.11	0.22
8/10/09 3:00 PM	0.14	0.14	0.16
8/10/09 5:00 PM	0.16	0.16	0.15
8/10/09 7:00 PM	0.10	0.10	0.18
8/10/09 9:00 PM	0.10	0.10	0.12
8/10/09 11:00 PM	0.11	0.11	0.10
8/11/09 1:00 AM	0.11	0.11	0.09
8/11/09 3:00 AM	0.11	0.11	0.09
8/11/09 5:00 AM	0.11	0.11	0.08
8/11/09 7:00 AM	0.11	0.11	0.09
8/11/09 9:00 AM	0.12	0.12	0.09
8/11/09 11:00 AM	0.12	0.12	0.09
8/11/09 1:00 PM	0.12	0.12	0.09
8/11/09 3:00 PM	0.16	0.16	0.09
8/11/09 5:00 PM	0.15	0.15	0.10
8/11/09 7:00 PM	0.12	0.12	0.10
8/11/09 9:00 PM	0.12	0.12	0.09
8/11/09 11:00 PM	0.12	0.12	0.10
8/12/09 1:00 AM	0.12	0.12	0.11
8/12/09 3:00 AM	0.12	0.12	0.11
8/12/09 5:00 AM	0.12	0.12	0.11
8/12/09 7:00 AM	0.12	0.12	0.10
8/12/09 9:00 AM	0.12	0.12	0.09
8/12/09 11:00 AM	0.12	0.12	0.10
8/12/09 1:00 PM	0.12	0.12	0.10
8/12/09 3:00 PM	0.12	0.12	0.09
8/12/09 5:00 PM	0.12	0.12	0.09
8/12/09 7:00 PM	0.11	0.11	0.10
8/12/09 9:00 PM	0.11	0.11	0.10
8/12/09 11:00 PM	0.11	0.11	0.10
8/13/09 1:00 AM	0.11	0.11	0.10
8/13/09 3:00 AM	0.11	0.11	0.10
8/13/09 5:00 AM	0.10	0.10	0.10
8/13/09 7:00 AM	0.10	0.10	0.09
8/13/09 9:00 AM	0.10	0.10	0.09
8/13/09 11:00 AM	0.10	0.10	0.08
8/13/09 1:00 PM	0.10	0.10	0.08
8/13/09 3:00 PM	0.10	0.10	0.09
8/13/09 5:00 PM	0.11	0.11	0.09
8/13/09 7:00 PM	0.11	0.11	0.09
8/13/09 9:00 PM	0.11	0.11	0.10
8/13/09 11:00 PM	0.10	0.10	0.10
8/14/09 1:00 AM	0.10	0.10	0.10
8/14/09 3:00 AM	0.10	0.10	0.10
8/14/09 5:00 AM	0.10	0.10	0.10

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
8/14/09 7:00 AM	0.10	0.10	0.11
8/14/09 9:00 AM	0.11	0.11	0.08
8/14/09 11:00 AM	0.12	0.12	0.06
8/14/09 1:00 PM	0.11	0.11	0.09
8/14/09 3:00 PM	0.12	0.12	0.09
8/14/09 5:00 PM	0.12	0.12	0.09
8/14/09 7:00 PM	0.12	0.12	0.09
8/14/09 9:00 PM	0.05	0.05	0.09
8/14/09 11:00 PM	0.09	0.09	0.08
8/15/09 1:00 AM	0.10	0.10	0.09
8/15/09 3:00 AM	0.13	0.13	0.09
8/15/09 5:00 AM	0.10	0.10	0.09
8/15/09 7:00 AM	0.11	0.11	0.09
8/15/09 9:00 AM	0.12	0.12	0.09
8/15/09 11:00 AM	0.16	0.16	0.10
8/15/09 1:00 PM	0.15	0.15	0.09
8/15/09 3:00 PM	0.15	0.15	0.09
8/15/09 5:00 PM	0.13	0.13	0.09
8/15/09 7:00 PM	0.10	0.10	0.09
8/15/09 9:00 PM	0.10	0.10	0.09
8/15/09 11:00 PM	0.10	0.10	0.09
8/16/09 1:00 AM	0.13	0.13	0.09
8/16/09 3:00 AM	0.14	0.14	0.10
8/16/09 5:00 AM	0.14	0.14	0.10
8/16/09 7:00 AM	0.14	0.14	0.10
8/16/09 9:00 AM	0.14	0.14	0.10
8/16/09 11:00 AM	0.14	0.14	0.10
8/16/09 1:00 PM	0.13	0.13	0.10
8/16/09 3:00 PM	0.12	0.12	0.10
8/16/09 5:00 PM	0.12	0.12	0.10
8/16/09 7:00 PM	0.11	0.11	0.11
8/16/09 9:00 PM	0.11	0.11	0.13
8/16/09 11:00 PM	0.11	0.11	0.12
8/17/09 1:00 AM	0.11	0.11	0.11
8/17/09 3:00 AM	0.12	0.12	0.11
8/17/09 5:00 AM	0.12	0.12	0.11
8/17/09 7:00 AM	0.12	0.12	0.11
8/17/09 9:00 AM	0.13	0.13	0.07
8/17/09 11:00 AM	0.17	0.17	0.06
8/17/09 1:00 PM	0.17	0.17	0.07
8/17/09 3:00 PM	0.13	0.13	0.10
8/17/09 5:00 PM	0.12	0.12	0.09
8/17/09 7:00 PM	0.12	0.12	0.09
8/17/09 9:00 PM	0.12	0.12	0.09
8/17/09 11:00 PM	0.11	0.11	0.10
8/18/09 1:00 AM	0.11	0.11	0.10
8/18/09 3:00 AM	0.10	0.10	0.10
8/18/09 5:00 AM	0.10	0.10	0.10
8/18/09 7:00 AM	0.08	0.08	0.10
8/18/09 9:00 AM	0.09	0.09	0.09
8/18/09 11:00 AM	0.11	0.11	0.00
8/18/09 1:00 PM	0.12	0.12	0.00
8/18/09 3:00 PM	0.10	0.10	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
8/18/09 5:00 PM	0.10	0.10	0.00
8/18/09 7:00 PM	0.09	0.09	0.00
8/18/09 9:00 PM	0.09	0.09	0.00
8/18/09 11:00 PM	0.09	0.09	0.00
8/19/09 1:00 AM	0.09	0.09	0.00
8/19/09 3:00 AM	0.09	0.09	0.00
8/19/09 5:00 AM	0.09	0.09	0.01
8/19/09 7:00 AM	0.08	0.08	0.05
8/19/09 9:00 AM	0.09	0.09	0.07
8/19/09 11:00 AM	0.11	0.11	0.08
8/19/09 1:00 PM	0.15	0.15	0.09
8/19/09 3:00 PM	0.12	0.12	0.16
8/19/09 5:00 PM	0.10	0.10	0.16
8/19/09 7:00 PM	0.07	0.07	0.15
8/19/09 9:00 PM	0.07	0.07	0.12
8/19/09 11:00 PM	0.07	0.07	0.12
8/20/09 1:00 AM	0.07	0.07	0.12
8/20/09 3:00 AM	0.06	0.06	0.13
8/20/09 5:00 AM	0.06	0.06	0.13
8/20/09 7:00 AM	0.05	0.05	0.14
8/20/09 9:00 AM	0.05	0.05	0.16
8/20/09 11:00 AM	0.08	0.08	0.19
8/20/09 1:00 PM	0.08	0.08	0.25
8/20/09 3:00 PM	0.10	0.10	0.25
8/20/09 5:00 PM	0.11	0.11	0.28
8/20/09 7:00 PM	0.13	0.13	0.26
8/20/09 9:00 PM	0.18	0.18	0.22
8/20/09 11:00 PM	0.20	0.20	0.21
8/21/09 1:00 AM	0.21	0.21	0.17
8/21/09 3:00 AM	0.21	0.21	0.19
8/21/09 5:00 AM	0.21	0.21	0.19
8/21/09 7:00 AM	0.22	0.22	0.19
8/21/09 9:00 AM	0.23	0.23	0.19
8/21/09 11:00 AM	0.25	0.25	0.20
8/21/09 1:00 PM	0.28	0.28	0.18
8/21/09 3:00 PM	0.25	0.25	0.17
8/21/09 5:00 PM	0.22	0.22	0.16
8/21/09 7:00 PM	0.21	0.21	0.16
8/21/09 9:00 PM	0.22	0.22	0.15
8/21/09 11:00 PM	0.22	0.22	0.15
8/22/09 1:00 AM	0.22	0.22	0.16
8/22/09 3:00 AM	0.23	0.23	0.15
8/22/09 5:00 AM	0.22	0.22	0.15
8/22/09 7:00 AM	0.24	0.24	0.16
8/22/09 9:00 AM	0.25	0.25	0.15
8/22/09 11:00 AM	0.22	0.22	0.15
8/22/09 1:00 PM	0.21	0.21	0.15
8/22/09 3:00 PM	0.26	0.26	0.14
8/22/09 5:00 PM	0.21	0.21	0.14
8/22/09 7:00 PM	0.23	0.23	0.15
8/22/09 9:00 PM	0.23	0.23	0.14
8/22/09 11:00 PM	0.25	0.25	0.13
8/23/09 1:00 AM	0.25	0.25	0.14

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
8/23/09 3:00 AM	0.20	0.20	0.14
8/23/09 5:00 AM	0.25	0.25	0.13
8/23/09 7:00 AM	0.23	0.23	0.13
8/23/09 9:00 AM	0.25	0.25	0.13
8/23/09 11:00 AM	0.25	0.25	0.13
8/23/09 1:00 PM	0.19	0.19	0.13
8/23/09 3:00 PM	0.18	0.18	0.12
8/23/09 5:00 PM	0.18	0.18	0.12
8/23/09 7:00 PM	0.18	0.18	0.12
8/23/09 9:00 PM	0.18	0.18	0.11
8/23/09 11:00 PM	0.17	0.17	0.12
8/24/09 1:00 AM	0.21	0.21	0.12
8/24/09 3:00 AM	0.21	0.21	0.11
8/24/09 5:00 AM	0.20	0.20	0.11
8/24/09 7:00 AM	0.19	0.19	0.11
8/24/09 9:00 AM	0.19	0.19	0.11
8/24/09 11:00 AM	0.21	0.21	0.11
8/24/09 1:00 PM	0.20	0.20	0.12
8/24/09 3:00 PM	0.19	0.19	0.12
8/24/09 5:00 PM	0.21	0.21	0.11
8/24/09 7:00 PM	0.24	0.24	0.12
8/24/09 9:00 PM	0.20	0.20	0.15
8/24/09 11:00 PM	0.13	0.13	0.11
8/25/09 1:00 AM	0.13	0.13	0.11
8/25/09 3:00 AM	0.15	0.15	0.10
8/25/09 5:00 AM	0.14	0.14	0.12
8/25/09 7:00 AM	0.15	0.15	0.12
8/25/09 9:00 AM	0.16	0.16	0.12
8/25/09 11:00 AM	0.16	0.16	0.11
8/25/09 1:00 PM	0.16	0.16	0.14
8/25/09 3:00 PM	0.15	0.15	0.16
8/25/09 5:00 PM	0.15	0.15	0.15
8/25/09 7:00 PM	0.15	0.15	0.12
8/25/09 9:00 PM	0.14	0.14	0.12
8/25/09 11:00 PM	0.14	0.14	0.13
8/26/09 1:00 AM	0.14	0.14	0.14
8/26/09 3:00 AM	0.15	0.15	0.15
8/26/09 5:00 AM	0.15	0.15	0.15
8/26/09 7:00 AM	0.14	0.14	0.21
8/26/09 9:00 AM	0.15	0.15	0.21
8/26/09 11:00 AM	0.15	0.15	0.21
8/26/09 1:00 PM	0.14	0.14	0.20
8/26/09 3:00 PM	0.14	0.14	0.20
8/26/09 5:00 PM	0.16	0.16	0.17
8/26/09 7:00 PM	0.14	0.14	0.17
8/26/09 9:00 PM	0.13	0.13	0.16
8/26/09 11:00 PM	0.12	0.12	0.16
8/27/09 1:00 AM	0.12	0.12	0.16
8/27/09 3:00 AM	0.11	0.11	0.14
8/27/09 5:00 AM	0.12	0.12	0.15
8/27/09 7:00 AM	0.14	0.14	0.20
8/27/09 9:00 AM	0.18	0.18	0.22
8/27/09 11:00 AM	0.22	0.22	0.25

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
8/27/09 1:00 PM	0.20	0.20	0.39
8/27/09 3:00 PM	0.29	0.29	0.24
8/27/09 5:00 PM	0.24	0.24	0.16
8/27/09 7:00 PM	0.24	0.24	0.23
8/27/09 9:00 PM	0.24	0.24	0.27
8/27/09 11:00 PM	0.25	0.25	0.28
8/28/09 1:00 AM	0.18	0.18	0.15
8/28/09 3:00 AM	0.15	0.15	0.17
8/28/09 5:00 AM	0.18	0.18	0.19
8/28/09 7:00 AM	0.25	0.25	0.28
8/28/09 9:00 AM	0.24	0.24	0.31
8/28/09 11:00 AM	0.24	0.24	0.34
8/28/09 1:00 PM	0.24	0.24	0.24
8/28/09 3:00 PM	0.23	0.23	0.25
8/28/09 5:00 PM	0.23	0.23	0.27
8/28/09 7:00 PM	0.21	0.21	0.33
8/28/09 9:00 PM	0.19	0.19	0.30
8/28/09 11:00 PM	0.16	0.16	0.29
8/29/09 1:00 AM	0.12	0.12	0.22
8/29/09 3:00 AM	0.10	0.10	0.11
8/29/09 5:00 AM	0.10	0.10	0.11
8/29/09 7:00 AM	0.14	0.14	0.10
8/29/09 9:00 AM	0.19	0.19	0.18
8/29/09 11:00 AM	0.17	0.17	0.17
8/29/09 1:00 PM	0.17	0.17	0.21
8/29/09 3:00 PM	0.17	0.17	0.20
8/29/09 5:00 PM	0.17	0.17	0.23
8/29/09 7:00 PM	0.16	0.16	0.22
8/29/09 9:00 PM	0.10	0.10	0.21
8/29/09 11:00 PM	0.10	0.10	0.18
8/30/09 1:00 AM	0.10	0.10	0.20
8/30/09 3:00 AM	0.09	0.09	0.16
8/30/09 5:00 AM	0.09	0.09	0.14
8/30/09 7:00 AM	0.10	0.10	0.12
8/30/09 9:00 AM	0.11	0.11	0.13
8/30/09 11:00 AM	0.16	0.16	0.11
8/30/09 1:00 PM	0.18	0.18	0.14
8/30/09 3:00 PM	0.20	0.20	0.20
8/30/09 5:00 PM	0.20	0.20	0.22
8/30/09 7:00 PM	0.19	0.19	0.27
8/30/09 9:00 PM	0.20	0.20	0.25
8/30/09 11:00 PM	0.21	0.21	0.20
8/31/09 1:00 AM	0.17	0.17	0.15
8/31/09 3:00 AM	0.16	0.16	0.15
8/31/09 5:00 AM	0.19	0.19	0.17
8/31/09 7:00 AM	0.25	0.25	0.19
8/31/09 9:00 AM	0.24	0.24	0.19
8/31/09 11:00 AM	0.23	0.23	0.16
8/31/09 1:00 PM	0.21	0.21	0.15
8/31/09 3:00 PM	0.23	0.23	0.16
8/31/09 5:00 PM	0.27	0.27	0.15
8/31/09 7:00 PM	0.24	0.24	0.14
8/31/09 9:00 PM	0.24	0.24	0.13

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
8/31/09 11:00 PM	0.27	0.27	0.13
9/1/09 1:00 AM	0.21	0.21	0.16
9/1/09 3:00 AM	0.20	0.20	0.11
9/1/09 5:00 AM	0.22	0.22	0.20
9/1/09 7:00 AM	0.24	0.24	0.12
9/1/09 9:00 AM	0.23	0.23	0.12
9/1/09 11:00 AM	0.24	0.24	0.12
9/1/09 1:00 PM	0.24	0.24	0.11
9/1/09 3:00 PM	0.24	0.24	0.11
9/1/09 5:00 PM	0.25	0.25	0.11
9/1/09 7:00 PM	0.24	0.24	0.10
9/1/09 9:00 PM	0.23	0.23	0.10
9/1/09 11:00 PM	0.22	0.22	0.09
9/2/09 1:00 AM	0.23	0.23	0.00
9/2/09 3:00 AM	0.23	0.23	0.00
9/2/09 5:00 AM	0.23	0.23	0.00
9/2/09 7:00 AM	0.23	0.23	0.00
9/2/09 9:00 AM	0.20	0.20	0.01
9/2/09 11:00 AM	0.20	0.20	0.05
9/2/09 1:00 PM	0.23	0.23	0.10
9/2/09 3:00 PM	0.23	0.23	0.11
9/2/09 5:00 PM	0.23	0.23	0.10
9/2/09 7:00 PM	0.23	0.23	0.10
9/2/09 9:00 PM	0.23	0.23	0.09
9/2/09 11:00 PM	0.23	0.23	0.09
9/3/09 1:00 AM	0.23	0.23	0.08
9/3/09 3:00 AM	0.22	0.22	0.08
9/3/09 5:00 AM	0.22	0.22	0.09
9/3/09 7:00 AM	0.18	0.18	0.09
9/3/09 9:00 AM	0.22	0.22	0.08
9/3/09 11:00 AM	0.19	0.19	0.08
9/3/09 1:00 PM	0.19	0.19	0.08
9/3/09 3:00 PM	0.22	0.22	0.08
9/3/09 5:00 PM	0.25	0.25	0.09
9/3/09 7:00 PM	0.23	0.23	0.08
9/3/09 9:00 PM	0.23	0.23	0.09
9/3/09 11:00 PM	0.23	0.23	0.08
9/4/09 1:00 AM	0.21	0.21	0.07
9/4/09 3:00 AM	0.17	0.17	0.07
9/4/09 5:00 AM	0.21	0.21	0.08
9/4/09 7:00 AM	0.22	0.22	0.08
9/4/09 9:00 AM	0.22	0.22	0.08
9/4/09 11:00 AM	0.20	0.20	0.09
9/4/09 1:00 PM	0.20	0.20	0.08
9/4/09 3:00 PM	0.19	0.19	0.08
9/4/09 5:00 PM	0.18	0.18	0.08
9/4/09 7:00 PM	0.18	0.18	0.08
9/4/09 9:00 PM	0.20	0.20	0.08
9/4/09 11:00 PM	0.18	0.18	0.09
9/5/09 1:00 AM	0.19	0.19	0.08
9/5/09 3:00 AM	0.19	0.19	0.07
9/5/09 5:00 AM	0.20	0.20	0.07
9/5/09 7:00 AM	0.19	0.19	0.08

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
9/5/09 9:00 AM	0.17	0.17	0.09
9/5/09 11:00 AM	0.17	0.17	0.09
9/5/09 1:00 PM	0.17	0.17	0.08
9/5/09 3:00 PM	0.20	0.20	0.08
9/5/09 5:00 PM	0.20	0.20	0.08
9/5/09 7:00 PM	0.20	0.20	0.08
9/5/09 9:00 PM	0.19	0.19	0.09
9/5/09 11:00 PM	0.17	0.17	0.09
9/6/09 1:00 AM	0.16	0.16	0.09
9/6/09 3:00 AM	0.14	0.14	0.09
9/6/09 5:00 AM	0.15	0.15	0.08
9/6/09 7:00 AM	0.17	0.17	0.09
9/6/09 9:00 AM	0.15	0.15	0.09
9/6/09 11:00 AM	0.16	0.16	0.11
9/6/09 1:00 PM	0.16	0.16	0.13
9/6/09 3:00 PM	0.18	0.18	0.13
9/6/09 5:00 PM	0.22	0.22	0.15
9/6/09 7:00 PM	0.23	0.23	0.13
9/6/09 9:00 PM	0.23	0.23	0.13
9/6/09 11:00 PM	0.23	0.23	0.14
9/7/09 1:00 AM	0.23	0.23	0.15
9/7/09 3:00 AM	0.20	0.20	0.16
9/7/09 5:00 AM	0.22	0.22	0.16
9/7/09 7:00 AM	0.23	0.23	0.18
9/7/09 9:00 AM	0.22	0.22	0.19
9/7/09 11:00 AM	0.22	0.22	0.19
9/7/09 1:00 PM	0.23	0.23	0.19
9/7/09 3:00 PM	0.23	0.23	0.18
9/7/09 5:00 PM	0.23	0.23	0.20
9/7/09 7:00 PM	0.25	0.25	0.19
9/7/09 9:00 PM	0.23	0.23	0.17
9/7/09 11:00 PM	0.20	0.20	0.16
9/8/09 1:00 AM	0.15	0.15	0.17
9/8/09 3:00 AM	0.16	0.16	0.16
9/8/09 5:00 AM	0.17	0.17	0.15
9/8/09 7:00 AM	0.23	0.23	0.15
9/8/09 9:00 AM	0.24	0.24	0.13
9/8/09 11:00 AM	0.24	0.24	0.13
9/8/09 1:00 PM	0.23	0.23	0.13
9/8/09 3:00 PM	0.24	0.24	0.12
9/8/09 5:00 PM	0.25	0.25	0.11
9/8/09 7:00 PM	0.20	0.20	0.10
9/8/09 9:00 PM	0.15	0.15	0.10
9/8/09 11:00 PM	0.00	0.00	0.09
9/9/09 1:00 AM	0.00	0.00	0.10
9/9/09 3:00 AM	0.00	0.00	0.10
9/9/09 5:00 AM	0.00	0.00	0.10
9/9/09 7:00 AM	0.00	0.00	0.10
9/9/09 9:00 AM	0.00	0.00	0.09
9/9/09 11:00 AM	0.00	0.11	0.09
9/9/09 1:00 PM	0.00	0.13	0.09
9/9/09 3:00 PM	0.00	0.17	0.08
9/9/09 5:00 PM	0.00	0.18	0.08

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
9/9/09 7:00 PM	0.00	0.14	0.08
9/9/09 9:00 PM	0.00	0.14	0.09
9/9/09 11:00 PM	0.14	0.14	0.09
9/10/09 1:00 AM	0.14	0.14	0.08
9/10/09 3:00 AM	0.14	0.14	0.07
9/10/09 5:00 AM	0.14	0.14	0.09
9/10/09 7:00 AM	0.13	0.13	0.10
9/10/09 9:00 AM	0.12	0.12	0.09
9/10/09 11:00 AM	0.13	0.13	0.09
9/10/09 1:00 PM	0.11	0.11	0.08
9/10/09 3:00 PM	0.15	0.15	0.09
9/10/09 5:00 PM	0.15	0.15	0.09
9/10/09 7:00 PM	0.16	0.16	0.09
9/10/09 9:00 PM	0.16	0.16	0.08
9/10/09 11:00 PM	0.17	0.17	0.09
9/11/09 1:00 AM	0.17	0.17	0.08
9/11/09 3:00 AM	0.15	0.15	0.07
9/11/09 5:00 AM	0.15	0.15	0.08
9/11/09 7:00 AM	0.16	0.16	0.09
9/11/09 9:00 AM	0.20	0.20	0.08
9/11/09 11:00 AM	0.18	0.18	0.08
9/11/09 1:00 PM	0.18	0.18	0.08
9/11/09 3:00 PM	0.19	0.19	0.08
9/11/09 5:00 PM	0.20	0.20	0.09
9/11/09 7:00 PM	0.19	0.19	0.09
9/11/09 9:00 PM	0.19	0.19	0.09
9/11/09 11:00 PM	0.21	0.21	0.08
9/12/09 1:00 AM	0.29	0.29	0.08
9/12/09 3:00 AM	0.23	0.23	0.09
9/12/09 5:00 AM	0.20	0.20	0.08
9/12/09 7:00 AM	0.23	0.23	0.09
9/12/09 9:00 AM	0.23	0.23	0.09
9/12/09 11:00 AM	0.23	0.23	0.09
9/12/09 1:00 PM	0.22	0.22	0.09
9/12/09 3:00 PM	0.22	0.22	0.09
9/12/09 5:00 PM	0.23	0.23	0.08
9/12/09 7:00 PM	0.22	0.22	0.09
9/12/09 9:00 PM	0.21	0.21	0.06
9/12/09 11:00 PM	0.23	0.23	0.05
9/13/09 1:00 AM	0.22	0.22	0.05
9/13/09 3:00 AM	0.22	0.22	0.05
9/13/09 5:00 AM	0.22	0.22	0.05
9/13/09 7:00 AM	0.22	0.22	0.09
9/13/09 9:00 AM	0.23	0.23	0.11
9/13/09 11:00 AM	0.23	0.23	0.11
9/13/09 1:00 PM	0.23	0.23	0.10
9/13/09 3:00 PM	0.22	0.22	0.10
9/13/09 5:00 PM	0.22	0.22	0.10
9/13/09 7:00 PM	0.23	0.23	0.11
9/13/09 9:00 PM	0.22	0.22	0.10
9/13/09 11:00 PM	0.15	0.15	0.07
9/14/09 1:00 AM	0.14	0.14	0.05
9/14/09 3:00 AM	0.14	0.14	0.05

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
9/14/09 5:00 AM	0.15	0.15	0.06
9/14/09 7:00 AM	0.15	0.15	0.12
9/14/09 9:00 AM	0.23	0.23	0.12
9/14/09 11:00 AM	0.27	0.27	0.11
9/14/09 1:00 PM	0.25	0.25	0.11
9/14/09 3:00 PM	0.25	0.25	0.11
9/14/09 5:00 PM	0.25	0.25	0.11
9/14/09 7:00 PM	0.23	0.23	0.12
9/14/09 9:00 PM	0.15	0.15	0.11
9/14/09 11:00 PM	0.17	0.17	0.08
9/15/09 1:00 AM	0.17	0.17	0.13
9/15/09 3:00 AM	0.16	0.16	0.06
9/15/09 5:00 AM	0.16	0.16	0.06
9/15/09 7:00 AM	0.18	0.18	0.08
9/15/09 9:00 AM	0.25	0.25	0.11
9/15/09 11:00 AM	0.24	0.24	0.12
9/15/09 1:00 PM	0.23	0.23	0.12
9/15/09 3:00 PM	0.24	0.24	0.12
9/15/09 5:00 PM	0.23	0.23	0.12
9/15/09 7:00 PM	0.23	0.23	0.13
9/15/09 9:00 PM	0.22	0.22	0.13
9/15/09 11:00 PM	0.21	0.21	0.10
9/16/09 1:00 AM	0.00	0.00	0.10
9/16/09 3:00 AM	0.00	0.00	0.10
9/16/09 5:00 AM	0.00	0.00	0.10
9/16/09 7:00 AM	0.00	0.00	0.10
9/16/09 9:00 AM	0.00	0.00	0.14
9/16/09 11:00 AM	0.00	0.00	0.10
9/16/09 1:00 PM	0.23	0.23	0.12
9/16/09 3:00 PM	0.23	0.23	0.12
9/16/09 5:00 PM	0.23	0.23	0.13
9/16/09 7:00 PM	0.23	0.23	0.11
9/16/09 9:00 PM	0.23	0.23	0.03
9/16/09 11:00 PM	0.23	0.23	0.04
9/17/09 1:00 AM	0.00	0.23	0.06
9/17/09 3:00 AM	0.00	0.23	0.10
9/17/09 5:00 AM	0.00	0.23	0.14
9/17/09 7:00 AM	0.00	0.23	0.15
9/17/09 9:00 AM	0.00	0.23	0.16
9/17/09 11:00 AM	0.00	0.23	0.16
9/17/09 1:00 PM	0.00	0.23	0.16
9/17/09 3:00 PM	0.00	0.23	0.15
9/17/09 5:00 PM	0.00	0.23	0.15
9/17/09 7:00 PM	0.00	0.23	0.14
9/17/09 9:00 PM	0.00	0.23	0.14
9/17/09 11:00 PM	0.00	0.23	0.13
9/18/09 1:00 AM	0.00	0.23	0.13
9/18/09 3:00 AM	0.00	0.23	0.13
9/18/09 5:00 AM	0.00	0.23	0.13
9/18/09 7:00 AM	0.00	0.18	0.12
9/18/09 9:00 AM	0.00	0.13	0.11
9/18/09 11:00 AM	0.00	0.14	0.11
9/18/09 1:00 PM	0.00	0.14	0.10

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
9/18/09 3:00 PM	0.00	0.13	0.11
9/18/09 5:00 PM	0.00	0.13	0.10
9/18/09 7:00 PM	0.00	0.13	0.11
9/18/09 9:00 PM	0.11	0.11	0.11
9/18/09 11:00 PM	0.08	0.08	0.11
9/19/09 1:00 AM	0.08	0.08	0.12
9/19/09 3:00 AM	0.08	0.08	0.12
9/19/09 5:00 AM	0.09	0.09	0.13
9/19/09 7:00 AM	0.10	0.10	0.13
9/19/09 9:00 AM	0.11	0.11	0.13
9/19/09 11:00 AM	0.14	0.14	0.13
9/19/09 1:00 PM	0.23	0.23	0.13
9/19/09 3:00 PM	0.25	0.25	0.14
9/19/09 5:00 PM	0.24	0.24	0.15
9/19/09 7:00 PM	0.23	0.23	0.16
9/19/09 9:00 PM	0.21	0.21	0.16
9/19/09 11:00 PM	0.16	0.16	0.18
9/20/09 1:00 AM	0.14	0.14	0.17
9/20/09 3:00 AM	0.12	0.12	0.18
9/20/09 5:00 AM	0.11	0.11	0.18
9/20/09 7:00 AM	0.11	0.11	0.18
9/20/09 9:00 AM	0.11	0.11	0.18
9/20/09 11:00 AM	0.14	0.14	0.17
9/20/09 1:00 PM	0.22	0.22	0.17
9/20/09 3:00 PM	0.22	0.22	0.18
9/20/09 5:00 PM	0.21	0.21	0.18
9/20/09 7:00 PM	0.21	0.21	0.17
9/20/09 9:00 PM	0.23	0.23	0.17
9/20/09 11:00 PM	0.25	0.25	0.16
9/21/09 1:00 AM	0.25	0.25	0.13
9/21/09 3:00 AM	0.18	0.18	0.10
9/21/09 5:00 AM	0.22	0.22	0.12
9/21/09 7:00 AM	0.27	0.27	0.19
9/21/09 9:00 AM	0.25	0.25	0.21
9/21/09 11:00 AM	0.24	0.24	0.20
9/21/09 1:00 PM	0.25	0.25	0.18
9/21/09 3:00 PM	0.24	0.24	0.19
9/21/09 5:00 PM	0.23	0.23	0.18
9/21/09 7:00 PM	0.24	0.24	0.16
9/21/09 9:00 PM	0.16	0.16	0.16
9/21/09 11:00 PM	0.12	0.12	0.17
9/22/09 1:00 AM	0.12	0.12	0.18
9/22/09 3:00 AM	0.14	0.14	0.15
9/22/09 5:00 AM	0.15	0.15	0.24
9/22/09 7:00 AM	0.24	0.24	0.25
9/22/09 9:00 AM	0.26	0.26	0.29
9/22/09 11:00 AM	0.24	0.24	0.28
9/22/09 1:00 PM	0.25	0.25	0.26
9/22/09 3:00 PM	0.25	0.25	0.21
9/22/09 5:00 PM	0.24	0.24	0.26
9/22/09 7:00 PM	0.24	0.24	0.28
9/22/09 9:00 PM	0.23	0.23	0.25
9/22/09 11:00 PM	0.21	0.21	0.24

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
9/23/09 1:00 AM	0.22	0.22	0.24
9/23/09 3:00 AM	0.21	0.21	0.25
9/23/09 5:00 AM	0.22	0.22	0.25
9/23/09 7:00 AM	0.28	0.28	0.26
9/23/09 9:00 AM	0.25	0.25	0.25
9/23/09 11:00 AM	0.25	0.25	0.24
9/23/09 1:00 PM	0.23	0.23	0.23
9/23/09 3:00 PM	0.22	0.22	0.24
9/23/09 5:00 PM	0.27	0.27	0.26
9/23/09 7:00 PM	0.24	0.24	0.27
9/23/09 9:00 PM	0.16	0.16	0.28
9/23/09 11:00 PM	0.10	0.10	0.26
9/24/09 1:00 AM	0.11	0.11	0.26
9/24/09 3:00 AM	0.11	0.11	0.28
9/24/09 5:00 AM	0.09	0.09	0.26
9/24/09 7:00 AM	0.00	0.09	0.27
9/24/09 9:00 AM	0.00	0.09	0.28
9/24/09 11:00 AM	0.00	0.10	0.31
9/24/09 1:00 PM	0.00	0.13	0.26
9/24/09 3:00 PM	0.00	0.13	0.25
9/24/09 5:00 PM	0.00	0.13	0.26
9/24/09 7:00 PM	0.00	0.13	0.25
9/24/09 9:00 PM	0.00	0.13	0.25
9/24/09 11:00 PM	0.00	0.13	0.26
9/25/09 1:00 AM	0.00	0.11	0.27
9/25/09 3:00 AM	0.00	0.12	0.27
9/25/09 5:00 AM	0.00	0.14	0.32
9/25/09 7:00 AM	0.00	0.14	0.35
9/25/09 9:00 AM	0.00	0.14	0.36
9/25/09 11:00 AM	0.00	0.12	0.25
9/25/09 1:00 PM	0.00	0.13	0.27
9/25/09 3:00 PM	0.00	0.13	0.27
9/25/09 5:00 PM	0.00	0.13	0.29
9/25/09 7:00 PM	0.00	0.13	0.29
9/25/09 9:00 PM	0.00	0.10	0.30
9/25/09 11:00 PM	0.00	0.13	0.31
9/26/09 1:00 AM	0.00	0.13	0.32
9/26/09 3:00 AM	0.00	0.13	0.33
9/26/09 5:00 AM	0.00	0.13	0.33
9/26/09 7:00 AM	0.00	0.13	0.31
9/26/09 9:00 AM	0.00	0.13	0.32
9/26/09 11:00 AM	0.00	0.12	0.30
9/26/09 1:00 PM	0.00	0.12	0.30
9/26/09 3:00 PM	0.12	0.12	0.34
9/26/09 5:00 PM	0.00	0.12	0.36
9/26/09 7:00 PM	0.13	0.13	0.33
9/26/09 9:00 PM	0.11	0.11	0.33
9/26/09 11:00 PM	0.11	0.11	0.33
9/27/09 1:00 AM	0.10	0.10	0.39
9/27/09 3:00 AM	0.10	0.10	0.44
9/27/09 5:00 AM	0.09	0.09	0.43
9/27/09 7:00 AM	0.10	0.10	0.46
9/27/09 9:00 AM	0.16	0.16	0.44

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
9/27/09 11:00 AM	0.19	0.19	0.30
9/27/09 1:00 PM	0.17	0.17	0.34
9/27/09 3:00 PM	0.19	0.19	0.61
9/27/09 5:00 PM	0.18	0.18	0.50
9/27/09 7:00 PM	0.21	0.21	0.44
9/27/09 9:00 PM	0.18	0.18	0.39
9/27/09 11:00 PM	0.20	0.20	0.16
9/28/09 1:00 AM	0.18	0.18	0.09
9/28/09 3:00 AM	0.21	0.21	0.00
9/28/09 5:00 AM	0.21	0.21	0.00
9/28/09 7:00 AM	0.19	0.19	0.00
9/28/09 9:00 AM	0.22	0.22	0.00
9/28/09 11:00 AM	0.22	0.22	0.00
9/28/09 1:00 PM	0.21	0.21	0.00
9/28/09 3:00 PM	0.22	0.22	0.00
9/28/09 5:00 PM	0.21	0.21	0.00
9/28/09 7:00 PM	0.21	0.21	0.00
9/28/09 9:00 PM	0.22	0.22	0.00
9/28/09 11:00 PM	0.22	0.22	0.00
9/29/09 1:00 AM	0.25	0.25	0.00
9/29/09 3:00 AM	0.24	0.24	0.00
9/29/09 5:00 AM	0.24	0.24	0.00
9/29/09 7:00 AM	0.27	0.27	0.00
9/29/09 9:00 AM	0.27	0.27	0.00
9/29/09 11:00 AM	0.27	0.27	0.00
9/29/09 1:00 PM	0.27	0.27	0.00
9/29/09 3:00 PM	0.28	0.28	0.00
9/29/09 5:00 PM	0.29	0.29	0.00
9/29/09 7:00 PM	0.27	0.27	0.00
9/29/09 9:00 PM	0.26	0.26	0.00
9/29/09 11:00 PM	0.21	0.21	0.00
9/30/09 1:00 AM	0.21	0.21	0.00
9/30/09 3:00 AM	0.22	0.22	0.00
9/30/09 5:00 AM	0.22	0.22	0.00
9/30/09 7:00 AM	0.25	0.25	0.00
9/30/09 9:00 AM	0.35	0.35	0.00
9/30/09 11:00 AM	0.26	0.26	0.00
9/30/09 1:00 PM	0.26	0.26	0.00
9/30/09 3:00 PM	0.27	0.27	0.00
9/30/09 5:00 PM	0.25	0.25	0.00
9/30/09 7:00 PM	0.24	0.24	0.00
9/30/09 9:00 PM	0.23	0.23	0.00
9/30/09 11:00 PM	0.24	0.24	0.00
10/1/09 1:00 AM	0.23	0.23	0.00
10/1/09 3:00 AM	0.28	0.28	0.00
10/1/09 5:00 AM	0.29	0.29	0.00
10/1/09 7:00 AM	0.31	0.31	0.00
10/1/09 9:00 AM	0.27	0.27	0.00
10/1/09 11:00 AM	0.25	0.25	0.00
10/1/09 1:00 PM	0.21	0.21	0.00
10/1/09 3:00 PM	0.23	0.23	0.00
10/1/09 5:00 PM	0.24	0.24	0.00
10/1/09 7:00 PM	0.24	0.24	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
10/1/09 9:00 PM	0.23	0.23	0.00
10/1/09 11:00 PM	0.23	0.23	0.00
10/2/09 1:00 AM	0.24	0.24	0.00
10/2/09 3:00 AM	0.25	0.25	0.00
10/2/09 5:00 AM	0.29	0.29	0.00
10/2/09 7:00 AM	0.27	0.27	0.00
10/2/09 9:00 AM	0.27	0.27	0.00
10/2/09 11:00 AM	0.28	0.28	0.00
10/2/09 1:00 PM	0.27	0.27	0.00
10/2/09 3:00 PM	0.26	0.26	0.00
10/2/09 5:00 PM	0.25	0.25	0.00
10/2/09 7:00 PM	0.26	0.26	0.00
10/2/09 9:00 PM	0.28	0.28	0.00
10/2/09 11:00 PM	0.25	0.25	0.00
10/3/09 1:00 AM	0.26	0.26	0.00
10/3/09 3:00 AM	0.26	0.26	0.00
10/3/09 5:00 AM	0.25	0.25	0.00
10/3/09 7:00 AM	0.25	0.25	0.00
10/3/09 9:00 AM	0.23	0.23	0.00
10/3/09 11:00 AM	0.23	0.23	0.00
10/3/09 1:00 PM	0.21	0.21	0.00
10/3/09 3:00 PM	0.20	0.20	0.00
10/3/09 5:00 PM	0.18	0.18	0.00
10/3/09 7:00 PM	0.20	0.20	0.00
10/3/09 9:00 PM	0.20	0.20	0.00
10/3/09 11:00 PM	0.19	0.19	0.00
10/4/09 1:00 AM	0.19	0.19	0.00
10/4/09 3:00 AM	0.21	0.21	0.00
10/4/09 5:00 AM	0.19	0.19	0.00
10/4/09 7:00 AM	0.19	0.19	0.00
10/4/09 9:00 AM	0.23	0.23	0.00
10/4/09 11:00 AM	0.23	0.23	0.00
10/4/09 1:00 PM	0.23	0.23	0.00
10/4/09 3:00 PM	0.21	0.21	0.00
10/4/09 5:00 PM	0.21	0.21	0.00
10/4/09 7:00 PM	0.18	0.18	0.00
10/4/09 9:00 PM	0.21	0.21	0.00
10/4/09 11:00 PM	0.18	0.18	0.00
10/5/09 1:00 AM	0.17	0.17	0.00
10/5/09 3:00 AM	0.21	0.21	0.00
10/5/09 5:00 AM	0.19	0.19	0.00
10/5/09 7:00 AM	0.17	0.17	0.00
10/5/09 9:00 AM	0.17	0.17	0.00
10/5/09 11:00 AM	0.16	0.16	0.00
10/5/09 1:00 PM	0.16	0.16	0.00
10/5/09 3:00 PM	0.15	0.15	0.00
10/5/09 5:00 PM	0.16	0.16	0.00
10/5/09 7:00 PM	0.17	0.17	0.00
10/5/09 9:00 PM	0.15	0.15	0.00
10/5/09 11:00 PM	0.14	0.14	0.00
10/6/09 1:00 AM	0.18	0.18	0.00
10/6/09 3:00 AM	0.19	0.19	0.00
10/6/09 5:00 AM	0.18	0.18	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
10/6/09 7:00 AM	0.18	0.18	0.01
10/6/09 9:00 AM	0.16	0.16	0.00
10/6/09 11:00 AM	0.17	0.17	0.00
10/6/09 1:00 PM	0.18	0.18	0.00
10/6/09 3:00 PM	0.19	0.19	0.00
10/6/09 5:00 PM	0.19	0.19	0.00
10/6/09 7:00 PM	0.18	0.18	0.08
10/6/09 9:00 PM	0.18	0.18	0.19
10/6/09 11:00 PM	0.17	0.17	0.25
10/7/09 1:00 AM	0.18	0.18	0.31
10/7/09 3:00 AM	0.18	0.18	0.22
10/7/09 5:00 AM	0.18	0.18	0.22
10/7/09 7:00 AM	0.24	0.24	0.19
10/7/09 9:00 AM	0.22	0.22	0.20
10/7/09 11:00 AM	0.17	0.17	0.29
10/7/09 1:00 PM	0.18	0.18	0.15
10/7/09 3:00 PM	0.15	0.15	0.12
10/7/09 5:00 PM	0.16	0.16	0.07
10/7/09 7:00 PM	0.16	0.16	0.08
10/7/09 9:00 PM	0.17	0.17	0.08
10/7/09 11:00 PM	0.17	0.17	0.02
10/8/09 1:00 AM	0.16	0.16	0.07
10/8/09 3:00 AM	0.17	0.17	0.22
10/8/09 5:00 AM	0.18	0.18	0.16
10/8/09 7:00 AM	0.18	0.18	0.21
10/8/09 9:00 AM	0.14	0.14	0.20
10/8/09 11:00 AM	0.16	0.16	0.19
10/8/09 1:00 PM	0.16	0.16	0.09
10/8/09 3:00 PM	0.17	0.17	0.08
10/8/09 5:00 PM	0.18	0.18	0.08
10/8/09 7:00 PM	0.18	0.18	0.09
10/8/09 9:00 PM	0.18	0.18	0.08
10/8/09 11:00 PM	0.18	0.18	0.08
10/9/09 1:00 AM	0.19	0.19	0.08
10/9/09 3:00 AM	0.18	0.18	0.08
10/9/09 5:00 AM	0.18	0.18	0.08
10/9/09 7:00 AM	0.17	0.17	0.08
10/9/09 9:00 AM	0.16	0.16	0.10
10/9/09 11:00 AM	0.16	0.16	0.14
10/9/09 1:00 PM	0.16	0.16	0.12
10/9/09 3:00 PM	0.15	0.15	0.13
10/9/09 5:00 PM	0.16	0.16	0.12
10/9/09 7:00 PM	0.15	0.15	0.13
10/9/09 9:00 PM	0.15	0.15	0.12
10/9/09 11:00 PM	0.15	0.15	0.11
10/10/09 1:00 AM	0.16	0.16	0.12
10/10/09 3:00 AM	0.15	0.15	0.12
10/10/09 5:00 AM	0.15	0.15	0.11
10/10/09 7:00 AM	0.16	0.16	0.11
10/10/09 9:00 AM	0.16	0.16	0.08
10/10/09 11:00 AM	0.15	0.15	0.09
10/10/09 1:00 PM	0.16	0.16	0.09
10/10/09 3:00 PM	0.16	0.16	0.12

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
10/10/09 5:00 PM	0.15	0.15	0.13
10/10/09 7:00 PM	0.15	0.15	0.13
10/10/09 9:00 PM	0.15	0.15	0.10
10/10/09 11:00 PM	0.14	0.14	0.08
10/11/09 1:00 AM	0.14	0.14	0.07
10/11/09 3:00 AM	0.14	0.14	0.07
10/11/09 5:00 AM	0.14	0.14	0.07
10/11/09 7:00 AM	0.14	0.14	0.10
10/11/09 9:00 AM	0.14	0.14	0.17
10/11/09 11:00 AM	0.15	0.15	0.15
10/11/09 1:00 PM	0.15	0.15	0.15
10/11/09 3:00 PM	0.15	0.15	0.14
10/11/09 5:00 PM	0.15	0.15	0.14
10/11/09 7:00 PM	0.15	0.15	0.15
10/11/09 9:00 PM	0.15	0.15	0.15
10/11/09 11:00 PM	0.16	0.16	0.16
10/12/09 1:00 AM	0.16	0.16	0.15
10/12/09 3:00 AM	0.16	0.16	0.17
10/12/09 5:00 AM	0.16	0.16	0.17
10/12/09 7:00 AM	0.17	0.17	0.15
10/12/09 9:00 AM	0.17	0.17	0.15
10/12/09 11:00 AM	0.18	0.18	0.17
10/12/09 1:00 PM	0.18	0.18	0.17
10/12/09 3:00 PM	0.17	0.17	0.16
10/12/09 5:00 PM	0.17	0.17	0.16
10/12/09 7:00 PM	0.17	0.17	0.16
10/12/09 9:00 PM	0.17	0.17	0.14
10/12/09 11:00 PM	0.17	0.17	0.10
10/13/09 1:00 AM	0.17	0.17	0.10
10/13/09 3:00 AM	0.17	0.17	0.09
10/13/09 5:00 AM	0.17	0.17	0.10
10/13/09 7:00 AM	0.18	0.18	0.10
10/13/09 9:00 AM	0.18	0.18	0.11
10/13/09 11:00 AM	0.19	0.19	0.11
10/13/09 1:00 PM	0.20	0.20	0.11
10/13/09 3:00 PM	0.18	0.18	0.11
10/13/09 5:00 PM	0.18	0.18	0.12
10/13/09 7:00 PM	0.18	0.18	0.12
10/13/09 9:00 PM	0.18	0.18	0.12
10/13/09 11:00 PM	0.18	0.18	0.11
10/14/09 1:00 AM	0.14	0.14	0.12
10/14/09 3:00 AM	0.14	0.14	0.13
10/14/09 5:00 AM	0.15	0.15	0.12
10/14/09 7:00 AM	0.16	0.16	0.12
10/14/09 9:00 AM	0.21	0.21	0.15
10/14/09 11:00 AM	0.21	0.21	0.15
10/14/09 1:00 PM	0.22	0.22	0.22
10/14/09 3:00 PM	0.21	0.21	0.25
10/14/09 5:00 PM	0.21	0.21	0.27
10/14/09 7:00 PM	0.21	0.21	0.25
10/14/09 9:00 PM	0.20	0.20	0.25
10/14/09 11:00 PM	0.21	0.21	0.27
10/15/09 1:00 AM	0.21	0.21	0.31

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
10/15/09 3:00 AM	0.19	0.19	0.24
10/15/09 5:00 AM	0.21	0.21	0.32
10/15/09 7:00 AM	0.22	0.22	0.23
10/15/09 9:00 AM	0.14	0.14	0.18
10/15/09 11:00 AM	0.18	0.18	0.17
10/15/09 1:00 PM	0.31	0.31	0.15
10/15/09 3:00 PM	0.18	0.18	0.15
10/15/09 5:00 PM	0.18	0.18	0.15
10/15/09 7:00 PM	0.18	0.18	0.16
10/15/09 9:00 PM	0.18	0.18	0.15
10/15/09 11:00 PM	0.19	0.19	0.15
10/16/09 1:00 AM	0.18	0.18	0.15
10/16/09 3:00 AM	0.18	0.18	0.12
10/16/09 5:00 AM	0.18	0.18	0.17
10/16/09 7:00 AM	0.19	0.19	0.15
10/16/09 9:00 AM	0.18	0.18	0.15
10/16/09 11:00 AM	0.17	0.17	0.19
10/16/09 1:00 PM	0.18	0.18	0.18
10/16/09 3:00 PM	0.18	0.18	0.17
10/16/09 5:00 PM	0.18	0.18	0.19
10/16/09 7:00 PM	0.18	0.18	0.21
10/16/09 9:00 PM	0.14	0.14	0.20
10/16/09 11:00 PM	0.05	0.05	0.18
10/17/09 1:00 AM	0.00	0.00	0.17
10/17/09 3:00 AM	0.00	0.00	0.17
10/17/09 5:00 AM	0.00	0.00	0.17
10/17/09 7:00 AM	0.09	0.09	0.18
10/17/09 9:00 AM	0.00	0.00	0.18
10/17/09 11:00 AM	0.00	0.00	0.19
10/17/09 1:00 PM	0.00	0.00	0.20
10/17/09 3:00 PM	0.00	0.00	0.19
10/17/09 5:00 PM	0.00	0.00	0.19
10/17/09 7:00 PM	0.00	0.00	0.18
10/17/09 9:00 PM	0.00	0.00	0.18
10/17/09 11:00 PM	0.00	0.00	0.17
10/18/09 1:00 AM	0.00	0.00	0.17
10/18/09 3:00 AM	0.00	0.00	0.17
10/18/09 5:00 AM	0.00	0.00	0.16
10/18/09 7:00 AM	0.00	0.62	0.16
10/18/09 9:00 AM	0.00	0.00	0.15
10/18/09 11:00 AM	0.00	0.00	0.15
10/18/09 1:00 PM	0.00	0.00	0.14
10/18/09 3:00 PM	0.00	0.00	0.14
10/18/09 5:00 PM	0.00	0.00	0.14
10/18/09 7:00 PM	0.00	0.00	0.13
10/18/09 9:00 PM	0.00	0.00	0.13
10/18/09 11:00 PM	0.00	0.00	0.13
10/19/09 1:00 AM	0.00	0.00	0.13
10/19/09 3:00 AM	0.00	0.00	0.13
10/19/09 5:00 AM	0.00	0.00	0.14
10/19/09 7:00 AM	0.00	0.10	0.14
10/19/09 9:00 AM	0.00	0.00	0.14
10/19/09 11:00 AM	0.00	0.00	0.13

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
10/19/09 1:00 PM	0.00	0.00	0.13
10/19/09 3:00 PM	0.00	0.00	0.13
10/19/09 5:00 PM	0.00	0.00	0.13
10/19/09 7:00 PM	0.00	0.00	0.13
10/19/09 9:00 PM	0.00	0.00	0.13
10/19/09 11:00 PM	0.00	0.00	0.13
10/20/09 1:00 AM	0.00	0.00	0.13
10/20/09 3:00 AM	0.00	0.00	0.13
10/20/09 5:00 AM	0.00	0.00	0.12
10/20/09 7:00 AM	0.01	0.01	0.12
10/20/09 9:00 AM	0.00	0.00	0.12
10/20/09 11:00 AM	0.04	0.04	0.11
10/20/09 1:00 PM	0.08	0.08	0.11
10/20/09 3:00 PM	0.17	0.17	0.12
10/20/09 5:00 PM	0.20	0.20	0.12
10/20/09 7:00 PM	0.30	0.30	0.12
10/20/09 9:00 PM	0.28	0.28	0.12
10/20/09 11:00 PM	0.25	0.25	0.10
10/21/09 1:00 AM	0.26	0.26	0.10
10/21/09 3:00 AM	0.24	0.24	0.10
10/21/09 5:00 AM	0.24	0.24	0.12
10/21/09 7:00 AM	0.24	0.24	0.12
10/21/09 9:00 AM	0.24	0.24	0.11
10/21/09 11:00 AM	0.23	0.23	0.13
10/21/09 1:00 PM	0.22	0.22	0.13
10/21/09 3:00 PM	0.19	0.19	0.14
10/21/09 5:00 PM	0.19	0.19	0.13
10/21/09 7:00 PM	0.19	0.19	0.13
10/21/09 9:00 PM	0.19	0.19	0.13
10/21/09 11:00 PM	0.17	0.17	0.13
10/22/09 1:00 AM	0.13	0.13	0.13
10/22/09 3:00 AM	0.14	0.14	0.13
10/22/09 5:00 AM	0.17	0.17	0.13
10/22/09 7:00 AM	0.22	0.22	0.13
10/22/09 9:00 AM	0.17	0.17	0.13
10/22/09 11:00 AM	0.16	0.16	0.14
10/22/09 1:00 PM	0.20	0.20	0.14
10/22/09 3:00 PM	0.21	0.21	0.13
10/22/09 5:00 PM	0.19	0.19	0.15
10/22/09 7:00 PM	0.25	0.25	0.16
10/22/09 9:00 PM	0.22	0.22	0.16
10/22/09 11:00 PM	0.21	0.21	0.17
10/23/09 1:00 AM	0.21	0.21	0.18
10/23/09 3:00 AM	0.20	0.20	0.19
10/23/09 5:00 AM	0.21	0.21	0.21
10/23/09 7:00 AM	0.21	0.21	0.23
10/23/09 9:00 AM	0.16	0.16	0.21
10/23/09 11:00 AM	0.17	0.17	0.23
10/23/09 1:00 PM	0.17	0.17	0.25
10/23/09 3:00 PM	0.23	0.23	0.19
10/23/09 5:00 PM	0.20	0.20	0.20
10/23/09 7:00 PM	0.20	0.20	0.19
10/23/09 9:00 PM	0.22	0.22	0.18

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
10/23/09 11:00 PM	0.18	0.18	0.19
10/24/09 1:00 AM	0.21	0.21	0.13
10/24/09 3:00 AM	0.26	0.26	0.13
10/24/09 5:00 AM	0.26	0.26	0.12
10/24/09 7:00 AM	0.28	0.28	0.15
10/24/09 9:00 AM	0.27	0.27	0.14
10/24/09 11:00 AM	0.27	0.27	0.13
10/24/09 1:00 PM	0.27	0.27	0.12
10/24/09 3:00 PM	0.28	0.28	0.13
10/24/09 5:00 PM	0.22	0.22	0.13
10/24/09 7:00 PM	0.25	0.25	0.13
10/24/09 9:00 PM	0.24	0.24	0.12
10/24/09 11:00 PM	0.22	0.22	0.12
10/25/09 1:00 AM	0.18	0.18	0.12
10/25/09 3:00 AM	0.15	0.15	0.10
10/25/09 5:00 AM	0.14	0.14	0.10
10/25/09 7:00 AM	0.18	0.18	0.11
10/25/09 9:00 AM	0.24	0.24	0.11
10/25/09 11:00 AM	0.25	0.25	0.11
10/25/09 1:00 PM	0.24	0.24	0.11
10/25/09 3:00 PM	0.23	0.23	0.11
10/25/09 5:00 PM	0.22	0.22	0.11
10/25/09 7:00 PM	0.21	0.21	0.11
10/25/09 9:00 PM	0.21	0.21	0.09
10/25/09 11:00 PM	0.19	0.19	0.06
10/26/09 1:00 AM	0.16	0.16	0.04
10/26/09 3:00 AM	0.16	0.16	0.04
10/26/09 5:00 AM	0.16	0.16	0.06
10/26/09 7:00 AM	0.15	0.15	0.09
10/26/09 9:00 AM	0.14	0.14	0.09
10/26/09 11:00 AM	0.14	0.14	0.10
10/26/09 1:00 PM	0.16	0.16	0.11
10/26/09 3:00 PM	0.24	0.24	0.11
10/26/09 5:00 PM	0.25	0.25	0.11
10/26/09 7:00 PM	0.24	0.24	0.11
10/26/09 9:00 PM	0.24	0.24	0.10
10/26/09 11:00 PM	0.28	0.28	0.11
10/27/09 1:00 AM	0.30	0.30	0.11
10/27/09 3:00 AM	0.40	0.40	0.11
10/27/09 5:00 AM	0.45	0.45	0.11
10/27/09 7:00 AM	0.31	0.31	0.10
10/27/09 9:00 AM	0.26	0.26	0.10
10/27/09 11:00 AM	0.23	0.23	0.10
10/27/09 1:00 PM	0.22	0.22	0.10
10/27/09 3:00 PM	0.22	0.22	0.10
10/27/09 5:00 PM	0.21	0.21	0.09
10/27/09 7:00 PM	0.21	0.21	0.10
10/27/09 9:00 PM	0.18	0.18	0.10
10/27/09 11:00 PM	0.14	0.14	0.08
10/28/09 1:00 AM	0.11	0.11	0.08
10/28/09 3:00 AM	0.11	0.11	0.08
10/28/09 5:00 AM	0.13	0.13	0.08
10/28/09 7:00 AM	0.17	0.17	0.09

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
10/28/09 9:00 AM	0.20	0.20	0.10
10/28/09 11:00 AM	0.17	0.17	0.09
10/28/09 1:00 PM	0.15	0.15	0.10
10/28/09 3:00 PM	0.14	0.14	0.10
10/28/09 5:00 PM	0.15	0.15	0.10
10/28/09 7:00 PM	0.12	0.12	0.09
10/28/09 9:00 PM	0.13	0.13	0.10
10/28/09 11:00 PM	0.10	0.10	0.10
10/29/09 1:00 AM	0.09	0.09	0.10
10/29/09 3:00 AM	0.10	0.10	0.11
10/29/09 5:00 AM	0.11	0.11	0.11
10/29/09 7:00 AM	0.11	0.11	0.06
10/29/09 9:00 AM	0.11	0.11	0.01
10/29/09 11:00 AM	0.12	0.12	0.00
10/29/09 1:00 PM	0.12	0.12	0.00
10/29/09 3:00 PM	0.12	0.12	0.00
10/29/09 5:00 PM	0.12	0.12	0.00
10/29/09 7:00 PM	0.12	0.12	0.00
10/29/09 9:00 PM	0.11	0.11	0.00
10/29/09 11:00 PM	0.11	0.11	0.00
10/30/09 1:00 AM	0.11	0.11	0.00
10/30/09 3:00 AM	0.11	0.11	0.00
10/30/09 5:00 AM	0.11	0.11	0.00
10/30/09 7:00 AM	0.14	0.14	0.00
10/30/09 9:00 AM	0.13	0.13	0.00
10/30/09 11:00 AM	0.13	0.13	0.00
10/30/09 1:00 PM	0.13	0.13	0.00
10/30/09 3:00 PM	0.12	0.12	0.00
10/30/09 5:00 PM	0.11	0.11	0.00
10/30/09 7:00 PM	0.12	0.12	0.00
10/30/09 9:00 PM	0.10	0.10	0.00
10/30/09 11:00 PM	0.11	0.11	0.00
10/31/09 1:00 AM	0.11	0.11	0.00
10/31/09 3:00 AM	0.13	0.13	0.00
10/31/09 5:00 AM	0.16	0.16	0.00
10/31/09 7:00 AM	0.15	0.15	0.00
10/31/09 9:00 AM	0.14	0.14	0.00
10/31/09 11:00 AM	0.10	0.10	0.00
10/31/09 1:00 PM	0.11	0.11	0.00
10/31/09 3:00 PM	0.13	0.13	0.00
10/31/09 5:00 PM	0.12	0.12	0.00
10/31/09 7:00 PM	0.13	0.13	0.00
10/31/09 9:00 PM	0.12	0.12	0.00
10/31/09 11:00 PM	0.10	0.10	0.00
11/1/09 1:00 AM	0.12	0.12	0.00
11/1/09 3:00 AM	0.11	0.11	0.00
11/1/09 5:00 AM	0.12	0.12	0.00
11/1/09 7:00 AM	0.10	0.10	0.00
11/1/09 9:00 AM	0.15	0.15	0.00
11/1/09 11:00 AM	0.17	0.17	0.00
11/1/09 1:00 PM	0.18	0.18	0.00
11/1/09 3:00 PM	0.16	0.16	0.00
11/1/09 5:00 PM	0.14	0.14	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
11/1/09 7:00 PM	0.15	0.15	0.00
11/1/09 9:00 PM	0.16	0.16	0.00
11/1/09 11:00 PM	0.15	0.15	0.00
11/2/09 1:00 AM	0.14	0.14	0.00
11/2/09 3:00 AM	0.14	0.14	0.00
11/2/09 5:00 AM	0.14	0.14	0.00
11/2/09 7:00 AM	0.14	0.14	0.00
11/2/09 9:00 AM	0.14	0.14	0.00
11/2/09 11:00 AM	0.16	0.16	0.00
11/2/09 1:00 PM	0.16	0.16	0.00
11/2/09 3:00 PM	0.16	0.16	0.00
11/2/09 5:00 PM	0.15	0.15	0.00
11/2/09 7:00 PM	0.14	0.14	0.00
11/2/09 9:00 PM	0.14	0.14	0.00
11/2/09 11:00 PM	0.15	0.15	0.00
11/3/09 1:00 AM	0.14	0.14	0.00
11/3/09 3:00 AM	0.14	0.14	0.00
11/3/09 5:00 AM	0.14	0.14	0.00
11/3/09 7:00 AM	0.15	0.15	0.00
11/3/09 9:00 AM	0.16	0.16	0.00
11/3/09 11:00 AM	0.17	0.17	0.00
11/3/09 1:00 PM	0.18	0.18	0.00
11/3/09 3:00 PM	0.18	0.18	0.00
11/3/09 5:00 PM	0.18	0.18	0.00
11/3/09 7:00 PM	0.18	0.18	0.00
11/3/09 9:00 PM	0.18	0.18	0.00
11/3/09 11:00 PM	0.18	0.18	0.00
11/4/09 1:00 AM	0.16	0.16	0.00
11/4/09 3:00 AM	0.17	0.17	0.00
11/4/09 5:00 AM	0.19	0.19	0.00
11/4/09 7:00 AM	0.19	0.19	0.00
11/4/09 9:00 AM	0.19	0.19	0.00
11/4/09 11:00 AM	0.20	0.20	0.00
11/4/09 1:00 PM	0.19	0.19	0.00
11/4/09 3:00 PM	0.19	0.19	0.00
11/4/09 5:00 PM	0.18	0.18	0.00
11/4/09 7:00 PM	0.17	0.17	0.00
11/4/09 9:00 PM	0.18	0.18	0.00
11/4/09 11:00 PM	0.18	0.18	0.00
11/5/09 1:00 AM	0.18	0.18	0.00
11/5/09 3:00 AM	0.18	0.18	0.00
11/5/09 5:00 AM	0.17	0.17	0.00
11/5/09 7:00 AM	0.19	0.19	0.00
11/5/09 9:00 AM	0.19	0.19	0.00
11/5/09 11:00 AM	0.18	0.18	0.00
11/5/09 1:00 PM	0.18	0.18	0.00
11/5/09 3:00 PM	0.18	0.18	0.00
11/5/09 5:00 PM	0.18	0.18	0.00
11/5/09 7:00 PM	0.18	0.18	0.00
11/5/09 9:00 PM	0.18	0.18	0.00
11/5/09 11:00 PM	0.14	0.14	0.00
11/6/09 1:00 AM	0.13	0.13	0.00
11/6/09 3:00 AM	0.13	0.13	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
11/6/09 5:00 AM	0.13	0.13	0.00
11/6/09 7:00 AM	0.13	0.13	0.01
11/6/09 9:00 AM	0.18	0.18	0.00
11/6/09 11:00 AM	0.19	0.19	0.00
11/6/09 1:00 PM	0.19	0.19	0.00
11/6/09 3:00 PM	0.19	0.19	0.02
11/6/09 5:00 PM	0.19	0.19	0.08
11/6/09 7:00 PM	0.18	0.18	0.06
11/6/09 9:00 PM	0.18	0.18	0.07
11/6/09 11:00 PM	0.18	0.18	0.06
11/7/09 1:00 AM	0.13	0.13	0.06
11/7/09 3:00 AM	0.11	0.11	0.06
11/7/09 5:00 AM	0.11	0.11	0.04
11/7/09 7:00 AM	0.11	0.11	0.04
11/7/09 9:00 AM	0.16	0.16	0.07
11/7/09 11:00 AM	0.13	0.13	0.07
11/7/09 1:00 PM	0.13	0.13	0.07
11/7/09 3:00 PM	0.12	0.12	0.07
11/7/09 5:00 PM	0.16	0.16	0.07
11/7/09 7:00 PM	0.16	0.16	0.07
11/7/09 9:00 PM	0.07	0.07	0.07
11/7/09 11:00 PM	0.06	0.06	0.08
11/8/09 1:00 AM	0.10	0.10	0.07
11/8/09 3:00 AM	0.11	0.11	0.06
11/8/09 5:00 AM	0.10	0.10	0.06
11/8/09 7:00 AM	0.11	0.11	0.06
11/8/09 9:00 AM	0.16	0.16	0.08
11/8/09 11:00 AM	0.10	0.10	0.08
11/8/09 1:00 PM	0.05	0.05	0.09
11/8/09 3:00 PM	0.05	0.05	0.09
11/8/09 5:00 PM	0.06	0.06	0.08
11/8/09 7:00 PM	0.10	0.10	0.08
11/8/09 9:00 PM	0.10	0.10	0.08
11/8/09 11:00 PM	0.09	0.09	0.08
11/9/09 1:00 AM	0.09	0.09	0.07
11/9/09 3:00 AM	0.08	0.08	0.05
11/9/09 5:00 AM	0.09	0.09	0.06
11/9/09 7:00 AM	0.14	0.14	0.11
11/9/09 9:00 AM	0.04	0.04	0.13
11/9/09 11:00 AM	0.03	0.03	0.12
11/9/09 1:00 PM	0.11	0.11	0.11
11/9/09 3:00 PM	0.11	0.11	0.11
11/9/09 5:00 PM	0.11	0.11	0.11
11/9/09 7:00 PM	0.11	0.11	0.10
11/9/09 9:00 PM	0.11	0.11	0.09
11/9/09 11:00 PM	0.11	0.11	0.09
11/10/09 1:00 AM	0.10	0.10	0.09
11/10/09 3:00 AM	0.10	0.10	0.08
11/10/09 5:00 AM	0.10	0.10	0.08
11/10/09 7:00 AM	0.10	0.10	0.08
11/10/09 9:00 AM	0.10	0.10	0.09
11/10/09 11:00 AM	0.12	0.12	0.09
11/10/09 1:00 PM	0.06	0.06	0.11

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
11/10/09 3:00 PM	0.03	0.03	0.08
11/10/09 5:00 PM	0.04	0.04	0.08
11/10/09 7:00 PM	0.03	0.03	0.08
11/10/09 9:00 PM	0.03	0.03	0.08
11/10/09 11:00 PM	0.03	0.03	0.06
11/11/09 1:00 AM	0.02	0.02	0.05
11/11/09 3:00 AM	0.02	0.02	0.05
11/11/09 5:00 AM	0.02	0.02	0.05
11/11/09 7:00 AM	0.04	0.04	0.07
11/11/09 9:00 AM	0.02	0.02	0.08
11/11/09 11:00 AM	0.02	0.02	0.08
11/11/09 1:00 PM	0.02	0.02	0.08
11/11/09 3:00 PM	0.02	0.02	0.09
11/11/09 5:00 PM	0.02	0.02	0.09
11/11/09 7:00 PM	0.02	0.02	0.09
11/11/09 9:00 PM	0.05	0.05	0.09
11/11/09 11:00 PM	0.05	0.05	0.07
11/12/09 1:00 AM	0.05	0.05	0.07
11/12/09 3:00 AM	0.01	0.01	0.06
11/12/09 5:00 AM	0.01	0.01	0.09
11/12/09 7:00 AM	0.02	0.02	0.15
11/12/09 9:00 AM	0.00	0.04	0.10
11/12/09 11:00 AM	0.00	0.03	0.13
11/12/09 1:00 PM	0.00	0.03	0.14
11/12/09 3:00 PM	0.00	0.03	0.15
11/12/09 5:00 PM	0.00	0.03	0.14
11/12/09 7:00 PM	0.03	0.03	0.15
11/12/09 9:00 PM	0.03	0.03	0.15
11/12/09 11:00 PM	0.03	0.03	0.16
11/13/09 1:00 AM	0.03	0.03	0.16
11/13/09 3:00 AM	0.04	0.04	0.13
11/13/09 5:00 AM	0.05	0.05	0.13
11/13/09 7:00 AM	0.07	0.07	0.18
11/13/09 9:00 AM	0.08	0.08	0.16
11/13/09 11:00 AM	0.06	0.06	0.18
11/13/09 1:00 PM	0.07	0.07	0.12
11/13/09 3:00 PM	0.07	0.07	0.10
11/13/09 5:00 PM	0.07	0.07	0.10
11/13/09 7:00 PM	0.07	0.07	0.10
11/13/09 9:00 PM	0.07	0.07	0.10
11/13/09 11:00 PM	0.07	0.07	0.10
11/14/09 1:00 AM	0.07	0.07	0.10
11/14/09 3:00 AM	0.07	0.07	0.09
11/14/09 5:00 AM	0.06	0.06	0.09
11/14/09 7:00 AM	0.08	0.08	0.12
11/14/09 9:00 AM	0.08	0.08	0.12
11/14/09 11:00 AM	0.07	0.07	0.13
11/14/09 1:00 PM	0.07	0.07	0.14
11/14/09 3:00 PM	0.05	0.05	0.14
11/14/09 5:00 PM	0.05	0.05	0.14
11/14/09 7:00 PM	0.06	0.06	0.11
11/14/09 9:00 PM	0.05	0.05	0.13
11/14/09 11:00 PM	0.00	0.03	0.10

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
11/15/09 1:00 AM	0.03	0.03	0.09
11/15/09 3:00 AM	0.03	0.03	0.09
11/15/09 5:00 AM	0.03	0.03	0.08
11/15/09 7:00 AM	0.05	0.05	0.08
11/15/09 9:00 AM	0.05	0.05	0.07
11/15/09 11:00 AM	0.04	0.04	0.07
11/15/09 1:00 PM	0.03	0.03	0.07
11/15/09 3:00 PM	0.02	0.02	0.07
11/15/09 5:00 PM	0.02	0.02	0.06
11/15/09 7:00 PM	0.02	0.02	0.06
11/15/09 9:00 PM	0.00	0.04	0.07
11/15/09 11:00 PM	0.04	0.04	0.07
11/16/09 1:00 AM	0.04	0.04	0.07
11/16/09 3:00 AM	0.03	0.03	0.06
11/16/09 5:00 AM	0.04	0.04	0.06
11/16/09 7:00 AM	0.07	0.07	0.06
11/16/09 9:00 AM	0.04	0.04	0.06
11/16/09 11:00 AM	0.03	0.03	0.06
11/16/09 1:00 PM	0.04	0.04	0.06
11/16/09 3:00 PM	0.04	0.04	0.07
11/16/09 5:00 PM	0.03	0.03	0.07
11/16/09 7:00 PM	0.03	0.03	0.07
11/16/09 9:00 PM	0.03	0.03	0.07
11/16/09 11:00 PM	0.03	0.03	0.06
11/17/09 1:00 AM	0.03	0.03	0.04
11/17/09 3:00 AM	0.02	0.02	0.04
11/17/09 5:00 AM	0.02	0.02	0.04
11/17/09 7:00 AM	0.05	0.05	0.06
11/17/09 9:00 AM	0.05	0.05	0.08
11/17/09 11:00 AM	0.03	0.03	0.09
11/17/09 1:00 PM	0.02	0.02	0.09
11/17/09 3:00 PM	0.02	0.02	0.08
11/17/09 5:00 PM	0.03	0.03	0.09
11/17/09 7:00 PM	0.02	0.02	0.09
11/17/09 9:00 PM	0.02	0.02	0.09
11/17/09 11:00 PM	0.02	0.02	0.08
11/18/09 1:00 AM	0.03	0.03	0.05
11/18/09 3:00 AM	0.03	0.03	0.04
11/18/09 5:00 AM	0.03	0.03	0.04
11/18/09 7:00 AM	0.04	0.04	0.07
11/18/09 9:00 AM	0.04	0.04	0.08
11/18/09 11:00 AM	0.03	0.03	0.09
11/18/09 1:00 PM	0.03	0.03	0.09
11/18/09 3:00 PM	0.02	0.02	0.11
11/18/09 5:00 PM	0.02	0.02	0.12
11/18/09 7:00 PM	0.02	0.02	0.11
11/18/09 9:00 PM	0.02	0.02	0.12
11/18/09 11:00 PM	0.02	0.02	0.11
11/19/09 1:00 AM	0.02	0.02	0.09
11/19/09 3:00 AM	0.02	0.02	0.09
11/19/09 5:00 AM	0.02	0.02	0.09
11/19/09 7:00 AM	0.04	0.04	0.10
11/19/09 9:00 AM	0.03	0.03	0.11

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
11/19/09 11:00 AM	0.02	0.02	0.13
11/19/09 1:00 PM	0.02	0.02	0.12
11/19/09 3:00 PM	0.02	0.02	0.13
11/19/09 5:00 PM	0.02	0.02	0.14
11/19/09 7:00 PM	0.02	0.02	0.14
11/19/09 9:00 PM	0.02	0.02	0.14
11/19/09 11:00 PM	0.02	0.02	0.13
11/20/09 1:00 AM	0.02	0.02	0.07
11/20/09 3:00 AM	0.02	0.02	0.06
11/20/09 5:00 AM	0.02	0.02	0.06
11/20/09 7:00 AM	0.03	0.03	0.08
11/20/09 9:00 AM	0.03	0.03	0.12
11/20/09 11:00 AM	0.02	0.02	0.09
11/20/09 1:00 PM	0.05	0.05	0.09
11/20/09 3:00 PM	0.03	0.03	0.09
11/20/09 5:00 PM	0.02	0.02	0.12
11/20/09 7:00 PM	0.02	0.02	0.12
11/20/09 9:00 PM	0.02	0.02	0.12
11/20/09 11:00 PM	0.02	0.02	0.12
11/21/09 1:00 AM	0.02	0.02	0.09
11/21/09 3:00 AM	0.02	0.02	0.08
11/21/09 5:00 AM	0.02	0.02	0.08
11/21/09 7:00 AM	0.04	0.04	0.11
11/21/09 9:00 AM	0.04	0.04	0.11
11/21/09 11:00 AM	0.03	0.03	0.11
11/21/09 1:00 PM	0.03	0.03	0.10
11/21/09 3:00 PM	0.03	0.03	0.11
11/21/09 5:00 PM	0.03	0.03	0.11
11/21/09 7:00 PM	0.03	0.03	0.11
11/21/09 9:00 PM	0.03	0.03	0.11
11/21/09 11:00 PM	0.03	0.03	0.11
11/22/09 1:00 AM	0.03	0.03	0.06
11/22/09 3:00 AM	0.02	0.02	0.04
11/22/09 5:00 AM	0.02	0.02	0.04
11/22/09 7:00 AM	0.05	0.05	0.04
11/22/09 9:00 AM	0.04	0.04	0.05
11/22/09 11:00 AM	0.03	0.03	0.06
11/22/09 1:00 PM	0.03	0.03	0.05
11/22/09 3:00 PM	0.03	0.03	0.05
11/22/09 5:00 PM	0.03	0.03	0.06
11/22/09 7:00 PM	0.03	0.03	0.06
11/22/09 9:00 PM	0.03	0.03	0.06
11/22/09 11:00 PM	0.03	0.03	0.06
11/23/09 1:00 AM	0.02	0.02	0.08
11/23/09 3:00 AM	0.01	0.01	0.11
11/23/09 5:00 AM	0.01	0.01	0.10
11/23/09 7:00 AM	0.03	0.03	0.09
11/23/09 9:00 AM	0.03	0.03	0.09
11/23/09 11:00 AM	0.03	0.03	0.09
11/23/09 1:00 PM	0.02	0.02	0.09
11/23/09 3:00 PM	0.02	0.02	0.10
11/23/09 5:00 PM	0.02	0.02	0.10
11/23/09 7:00 PM	0.02	0.02	0.09

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
11/23/09 9:00 PM	0.01	0.01	0.08
11/23/09 11:00 PM	0.01	0.01	0.06
11/24/09 1:00 AM	0.01	0.01	0.04
11/24/09 3:00 AM	0.00	0.01	0.04
11/24/09 5:00 AM	0.00	0.01	0.04
11/24/09 7:00 AM	0.00	0.03	0.06
11/24/09 9:00 AM	0.00	0.02	0.10
11/24/09 11:00 AM	0.00	0.01	0.13
11/24/09 1:00 PM	0.00	0.01	0.13
11/24/09 3:00 PM	0.00	0.01	0.12
11/24/09 5:00 PM	0.00	0.01	0.11
11/24/09 7:00 PM	0.00	0.01	0.11
11/24/09 9:00 PM	0.00	0.01	0.14
11/24/09 11:00 PM	0.00	0.01	0.09
11/25/09 1:00 AM	0.00	0.01	0.07
11/25/09 3:00 AM	0.00	0.01	0.06
11/25/09 5:00 AM	0.00	0.01	0.07
11/25/09 7:00 AM	0.00	0.03	0.09
11/25/09 9:00 AM	0.00	0.02	0.09
11/25/09 11:00 AM	0.00	0.03	0.09
11/25/09 1:00 PM	0.00	0.02	0.10
11/25/09 3:00 PM	0.00	0.02	0.10
11/25/09 5:00 PM	0.00	0.02	0.10
11/25/09 7:00 PM	0.00	0.02	0.10
11/25/09 9:00 PM	0.00	0.02	0.11
11/25/09 11:00 PM	0.00	0.02	0.11
11/26/09 1:00 AM	0.00	0.02	0.10
11/26/09 3:00 AM	0.00	0.02	0.09
11/26/09 5:00 AM	0.00	0.02	0.09
11/26/09 7:00 AM	0.00	0.04	0.10
11/26/09 9:00 AM	0.00	0.02	0.11
11/26/09 11:00 AM	0.00	0.02	0.11
11/26/09 1:00 PM	0.00	0.02	0.11
11/26/09 3:00 PM	0.00	0.02	0.12
11/26/09 5:00 PM	0.00	0.02	0.12
11/26/09 7:00 PM	0.00	0.02	0.12
11/26/09 9:00 PM	0.00	0.02	0.12
11/26/09 11:00 PM	0.00	0.01	0.12
11/27/09 1:00 AM	0.00	0.01	0.12
11/27/09 3:00 AM	0.00	0.01	0.13
11/27/09 5:00 AM	0.00	0.01	0.12
11/27/09 7:00 AM	0.00	0.03	0.12
11/27/09 9:00 AM	0.00	0.02	0.12
11/27/09 11:00 AM	0.00	0.01	0.11
11/27/09 1:00 PM	0.00	0.01	0.11
11/27/09 3:00 PM	0.00	0.01	0.11
11/27/09 5:00 PM	0.00	0.01	0.10
11/27/09 7:00 PM	0.00	0.01	0.10
11/27/09 9:00 PM	0.00	0.01	0.10
11/27/09 11:00 PM	0.00	0.01	0.10
11/28/09 1:00 AM	0.00	0.01	0.12
11/28/09 3:00 AM	0.00	0.01	0.13
11/28/09 5:00 AM	0.00	0.01	0.10

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
11/28/09 7:00 AM	0.00	0.04	0.11
11/28/09 9:00 AM	0.00	0.02	0.11
11/28/09 11:00 AM	0.00	0.01	0.11
11/28/09 1:00 PM	0.00	0.01	0.11
11/28/09 3:00 PM	0.00	0.01	0.11
11/28/09 5:00 PM	0.00	0.01	0.12
11/28/09 7:00 PM	0.00	0.01	0.11
11/28/09 9:00 PM	0.00	0.01	0.12
11/28/09 11:00 PM	0.00	0.01	0.11
11/29/09 1:00 AM	0.00	0.01	0.11
11/29/09 3:00 AM	0.00	0.01	0.11
11/29/09 5:00 AM	0.00	0.01	0.11
11/29/09 7:00 AM	0.00	0.04	0.24
11/29/09 9:00 AM	0.00	0.03	0.12
11/29/09 11:00 AM	0.00	0.02	0.10
11/29/09 1:00 PM	0.00	0.02	0.10
11/29/09 3:00 PM	0.00	0.02	0.11
11/29/09 5:00 PM	0.00	0.02	0.11
11/29/09 7:00 PM	0.00	0.02	0.10
11/29/09 9:00 PM	0.00	0.02	0.10
11/29/09 11:00 PM	0.00	0.02	0.10
11/30/09 1:00 AM	0.00	0.02	0.13
11/30/09 3:00 AM	0.00	0.02	0.11
11/30/09 5:00 AM	0.00	0.02	0.12
11/30/09 7:00 AM	0.00	0.05	0.13
11/30/09 9:00 AM	0.00	0.03	0.14
11/30/09 11:00 AM	0.00	0.02	0.15
11/30/09 1:00 PM	0.00	0.02	0.14
11/30/09 3:00 PM	0.00	0.02	0.14
11/30/09 5:00 PM	0.00	0.02	0.13
11/30/09 7:00 PM	0.00	0.02	0.12
11/30/09 9:00 PM	0.00	0.02	0.11
11/30/09 11:00 PM	0.00	0.02	0.08
12/1/09 1:00 AM	0.00	0.02	0.07
12/1/09 3:00 AM	0.00	0.02	0.07
12/1/09 5:00 AM	0.00	0.02	0.07
12/1/09 7:00 AM	0.00	0.04	0.08
12/1/09 9:00 AM	0.00	0.03	0.11
12/1/09 11:00 AM	0.00	0.02	0.12
12/1/09 1:00 PM	0.00	0.02	0.12
12/1/09 3:00 PM	0.00	0.02	0.12
12/1/09 5:00 PM	0.00	0.02	0.12
12/1/09 7:00 PM	0.00	0.02	0.13
12/1/09 9:00 PM	0.00	0.02	0.12
12/1/09 11:00 PM	0.00	0.02	0.12
12/2/09 1:00 AM	0.00	0.02	0.09
12/2/09 3:00 AM	0.00	0.02	0.08
12/2/09 5:00 AM	0.00	0.02	0.09
12/2/09 7:00 AM	0.00	0.04	0.12
12/2/09 9:00 AM	0.00	0.03	0.11
12/2/09 11:00 AM	0.00	0.02	0.12
12/2/09 1:00 PM	0.00	0.02	0.14
12/2/09 3:00 PM	0.00	0.02	0.15

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
12/2/09 5:00 PM	0.00	0.02	0.16
12/2/09 7:00 PM	0.00	0.01	0.16
12/2/09 9:00 PM	0.00	0.01	0.16
12/2/09 11:00 PM	0.00	0.02	0.16
12/3/09 1:00 AM	0.00	0.01	0.15
12/3/09 3:00 AM	0.00	0.02	0.16
12/3/09 5:00 AM	0.00	0.01	0.16
12/3/09 7:00 AM	0.00	0.06	0.17
12/3/09 9:00 AM	0.00	0.03	0.17
12/3/09 11:00 AM	0.00	0.02	0.19
12/3/09 1:00 PM	0.00	0.02	0.21
12/3/09 3:00 PM	0.00	0.02	0.21
12/3/09 5:00 PM	0.00	0.02	0.21
12/3/09 7:00 PM	0.00	0.02	0.20
12/3/09 9:00 PM	0.00	0.01	0.20
12/3/09 11:00 PM	0.00	0.01	0.19
12/4/09 1:00 AM	0.00	0.02	0.14
12/4/09 3:00 AM	0.00	0.02	0.13
12/4/09 5:00 AM	0.00	0.01	0.14
12/4/09 7:00 AM	0.00	0.05	0.20
12/4/09 9:00 AM	0.00	0.03	0.18
12/4/09 11:00 AM	0.00	0.02	0.28
12/4/09 1:00 PM	0.00	0.01	0.18
12/4/09 3:00 PM	0.00	0.02	0.18
12/4/09 5:00 PM	0.00	0.02	0.19
12/4/09 7:00 PM	0.00	0.02	0.18
12/4/09 9:00 PM	0.00	0.02	0.18
12/4/09 11:00 PM	0.00	0.02	0.19
12/5/09 1:00 AM	0.00	0.01	0.18
12/5/09 3:00 AM	0.00	0.01	0.18
12/5/09 5:00 AM	0.00	0.01	0.19
12/5/09 7:00 AM	0.00	0.05	0.22
12/5/09 9:00 AM	0.00	0.03	0.25
12/5/09 11:00 AM	0.00	0.02	0.26
12/5/09 1:00 PM	0.00	0.02	0.25
12/5/09 3:00 PM	0.00	0.02	0.22
12/5/09 5:00 PM	0.00	0.02	0.35
12/5/09 7:00 PM	0.00	0.02	0.35
12/5/09 9:00 PM	0.00	0.02	0.63
12/5/09 11:00 PM	0.00	0.02	0.18
12/6/09 1:00 AM	0.00	0.02	0.18
12/6/09 3:00 AM	0.00	0.02	0.18
12/6/09 5:00 AM	0.00	0.02	0.19
12/6/09 7:00 AM	0.00	0.04	0.19
12/6/09 9:00 AM	0.00	0.03	0.18
12/6/09 11:00 AM	0.00	0.02	0.18
12/6/09 1:00 PM	0.00	0.02	0.18
12/6/09 3:00 PM	0.00	0.02	0.19
12/6/09 5:00 PM	0.00	0.02	0.20
12/6/09 7:00 PM	0.00	0.02	0.24
12/6/09 9:00 PM	0.00	0.02	0.24
12/6/09 11:00 PM	0.00	0.02	0.24
12/7/09 1:00 AM	0.00	0.02	0.27

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
12/7/09 3:00 AM	0.00	0.02	0.21
12/7/09 5:00 AM	0.00	0.02	0.22
12/7/09 7:00 AM	0.00	0.04	0.23
12/7/09 9:00 AM	0.00	0.03	0.22
12/7/09 11:00 AM	0.00	0.02	0.24
12/7/09 1:00 PM	0.00	0.02	0.23
12/7/09 3:00 PM	0.00	0.02	0.22
12/7/09 5:00 PM	0.00	0.02	0.21
12/7/09 7:00 PM	0.00	0.02	0.20
12/7/09 9:00 PM	0.00	0.02	0.20
12/7/09 11:00 PM	0.00	0.03	0.19
12/8/09 1:00 AM	0.00	0.02	0.19
12/8/09 3:00 AM	0.00	0.02	0.15
12/8/09 5:00 AM	0.00	0.02	0.16
12/8/09 7:00 AM	0.00	0.05	0.20
12/8/09 9:00 AM	0.00	0.04	0.23
12/8/09 11:00 AM	0.00	0.03	0.23
12/8/09 1:00 PM	0.00	0.03	0.24
12/8/09 3:00 PM	0.00	0.03	0.24
12/8/09 5:00 PM	0.00	0.02	0.23
12/8/09 7:00 PM	0.00	0.02	0.18
12/8/09 9:00 PM	0.00	0.02	0.14
12/8/09 11:00 PM	0.00	0.03	0.10
12/9/09 1:00 AM	0.00	0.02	0.12
12/9/09 3:00 AM	0.00	0.02	0.12
12/9/09 5:00 AM	0.00	0.02	0.14
12/9/09 7:00 AM	0.00	0.05	0.14
12/9/09 9:00 AM	0.00	0.07	0.14
12/9/09 11:00 AM	0.00	0.05	0.14
12/9/09 1:00 PM	0.00	0.03	0.14
12/9/09 3:00 PM	0.00	0.03	0.14
12/9/09 5:00 PM	0.00	0.03	0.15
12/9/09 7:00 PM	0.00	0.03	0.16
12/9/09 9:00 PM	0.00	0.03	0.16
12/9/09 11:00 PM	0.00	0.03	0.15
12/10/09 1:00 AM	0.00	0.02	0.15
12/10/09 3:00 AM	0.00	0.02	0.16
12/10/09 5:00 AM	0.00	0.02	0.15
12/10/09 7:00 AM	0.00	0.05	0.16
12/10/09 9:00 AM	0.00	0.05	0.17
12/10/09 11:00 AM	0.00	0.03	0.17
12/10/09 1:00 PM	0.00	0.03	0.17
12/10/09 3:00 PM	0.00	0.03	0.18
12/10/09 5:00 PM	0.00	0.03	0.18
12/10/09 7:00 PM	0.00	0.03	0.17
12/10/09 9:00 PM	0.00	0.03	0.17
12/10/09 11:00 PM	0.00	0.04	0.17
12/11/09 1:00 AM	0.00	0.04	0.16
12/11/09 3:00 AM	0.00	0.03	0.17
12/11/09 5:00 AM	0.00	0.03	0.18
12/11/09 7:00 AM	0.00	0.05	0.18
12/11/09 9:00 AM	0.00	0.05	0.19
12/11/09 11:00 AM	0.00	0.03	0.18

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
12/11/09 1:00 PM	0.00	0.03	0.19
12/11/09 3:00 PM	0.00	0.03	0.17
12/11/09 5:00 PM	0.00	0.03	0.11
12/11/09 7:00 PM	0.00	0.03	0.11
12/11/09 9:00 PM	0.00	0.03	0.11
12/11/09 11:00 PM	0.00	0.03	0.10
12/12/09 1:00 AM	0.00	0.03	0.11
12/12/09 3:00 AM	0.00	0.03	0.10
12/12/09 5:00 AM	0.00	0.03	0.09
12/12/09 7:00 AM	0.00	0.05	0.12
12/12/09 9:00 AM	0.00	0.05	0.16
12/12/09 11:00 AM	0.00	0.03	0.15
12/12/09 1:00 PM	0.00	0.03	0.16
12/12/09 3:00 PM	0.00	0.03	0.16
12/12/09 5:00 PM	0.00	0.03	0.16
12/12/09 7:00 PM	0.00	0.03	0.15
12/12/09 9:00 PM	0.00	0.02	0.15
12/12/09 11:00 PM	0.00	0.02	0.14
12/13/09 1:00 AM	0.00	0.01	0.14
12/13/09 3:00 AM	0.00	0.02	0.15
12/13/09 5:00 AM	0.00	0.01	0.14
12/13/09 7:00 AM	0.00	0.04	0.13
12/13/09 9:00 AM	0.00	0.03	0.12
12/13/09 11:00 AM	0.00	0.01	0.13
12/13/09 1:00 PM	0.00	0.01	0.13
12/13/09 3:00 PM	0.00	0.01	0.13
12/13/09 5:00 PM	0.00	0.01	0.13
12/13/09 7:00 PM	0.00	0.01	0.13
12/13/09 9:00 PM	0.00	0.01	0.13
12/13/09 11:00 PM	0.00	0.01	0.12
12/14/09 1:00 AM	0.00	0.01	0.11
12/14/09 3:00 AM	0.00	0.01	0.12
12/14/09 5:00 AM	0.00	0.01	0.12
12/14/09 7:00 AM	0.00	0.04	0.12
12/14/09 9:00 AM	0.00	0.03	0.13
12/14/09 11:00 AM	0.00	0.02	0.12
12/14/09 1:00 PM	0.00	0.03	0.12
12/14/09 3:00 PM	0.00	0.07	0.13
12/14/09 5:00 PM	0.00	0.08	0.13
12/14/09 7:00 PM	0.00	0.07	0.13
12/14/09 9:00 PM	0.00	0.07	0.12
12/14/09 11:00 PM	0.00	0.06	0.12
12/15/09 1:00 AM	0.00	0.06	0.11
12/15/09 3:00 AM	0.00	0.06	0.11
12/15/09 5:00 AM	0.00	0.06	0.11
12/15/09 7:00 AM	0.00	0.07	0.11
12/15/09 9:00 AM	0.00	0.06	0.11
12/15/09 11:00 AM	0.00	0.07	0.12
12/15/09 1:00 PM	0.00	0.07	0.12
12/15/09 3:00 PM	0.00	0.07	0.12
12/15/09 5:00 PM	0.00	0.06	0.11
12/15/09 7:00 PM	0.00	0.06	0.10
12/15/09 9:00 PM	0.00	0.06	0.10

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
12/15/09 11:00 PM	0.00	0.06	0.10
12/16/09 1:00 AM	0.00	0.06	0.10
12/16/09 3:00 AM	0.00	0.05	0.11
12/16/09 5:00 AM	0.00	0.05	0.11
12/16/09 7:00 AM	0.00	0.07	0.11
12/16/09 9:00 AM	0.00	0.06	0.12
12/16/09 11:00 AM	0.00	0.06	0.10
12/16/09 1:00 PM	0.00	0.06	0.09
12/16/09 3:00 PM	0.00	0.06	0.10
12/16/09 5:00 PM	0.00	0.06	0.10
12/16/09 7:00 PM	0.00	0.07	0.10
12/16/09 9:00 PM	0.00	0.06	0.10
12/16/09 11:00 PM	0.00	0.06	0.09
12/17/09 1:00 AM	0.00	0.06	0.13
12/17/09 3:00 AM	0.00	0.07	0.14
12/17/09 5:00 AM	0.00	0.08	0.10
12/17/09 7:00 AM	0.00	0.09	0.10
12/17/09 9:00 AM	0.00	0.18	0.13
12/17/09 11:00 AM	0.00	0.24	0.15
12/17/09 1:00 PM	0.00	0.24	0.16
12/17/09 3:00 PM	0.00	0.24	0.15
12/17/09 5:00 PM	0.00	0.24	0.16
12/17/09 7:00 PM	0.00	0.24	0.16
12/17/09 9:00 PM	0.00	0.25	0.16
12/17/09 11:00 PM	0.00	0.25	0.16
12/18/09 1:00 AM	0.00	0.23	0.27
12/18/09 3:00 AM	0.00	0.22	0.25
12/18/09 5:00 AM	0.00	0.23	0.23
12/18/09 7:00 AM	0.00	0.25	0.22
12/18/09 9:00 AM	0.00	0.24	0.17
12/18/09 11:00 AM	0.00	0.01	0.15
12/18/09 1:00 PM	0.00	0.00	0.15
12/18/09 3:00 PM	0.00	0.05	0.15
12/18/09 5:00 PM	0.00	0.18	0.15
12/18/09 7:00 PM	0.00	0.20	0.15
12/18/09 9:00 PM	0.00	0.21	0.15
12/18/09 11:00 PM	0.00	0.20	0.15
12/19/09 1:00 AM	0.00	0.09	0.14
12/19/09 3:00 AM	0.00	0.00	0.14
12/19/09 5:00 AM	0.00	0.00	0.15
12/19/09 7:00 AM	0.00	0.00	0.16
12/19/09 9:00 AM	0.00	0.00	0.15
12/19/09 11:00 AM	0.00	0.00	0.14
12/19/09 1:00 PM	0.00	0.00	0.13
12/19/09 3:00 PM	0.00	0.00	0.13
12/19/09 5:00 PM	0.00	0.00	0.13
12/19/09 7:00 PM	0.00	0.00	0.14
12/19/09 9:00 PM	0.00	0.00	0.15
12/19/09 11:00 PM	0.00	0.00	0.16
12/20/09 1:00 AM	0.00	0.00	0.16
12/20/09 3:00 AM	0.00	0.00	0.16
12/20/09 5:00 AM	0.00	0.00	0.16
12/20/09 7:00 AM	0.00	0.08	0.16

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
12/20/09 9:00 AM	0.00	0.15	0.16
12/20/09 11:00 AM	0.00	0.26	0.16
12/20/09 1:00 PM	0.00	0.26	0.16
12/20/09 3:00 PM	0.00	0.25	0.16
12/20/09 5:00 PM	0.00	0.24	0.17
12/20/09 7:00 PM	0.00	0.24	0.17
12/20/09 9:00 PM	0.00	0.24	0.16
12/20/09 11:00 PM	0.00	0.24	0.16
12/21/09 1:00 AM	0.00	0.25	0.15
12/21/09 3:00 AM	0.00	0.25	0.15
12/21/09 5:00 AM	0.00	0.26	0.15
12/21/09 7:00 AM	0.00	0.24	0.16
12/21/09 9:00 AM	0.00	0.10	0.14
12/21/09 11:00 AM	0.00	0.10	0.14
12/21/09 1:00 PM	0.00	0.10	0.13
12/21/09 3:00 PM	0.00	0.10	0.12
12/21/09 5:00 PM	0.00	0.10	0.12
12/21/09 7:00 PM	0.00	0.09	0.11
12/21/09 9:00 PM	0.00	0.10	0.11
12/21/09 11:00 PM	0.00	0.10	0.11
12/22/09 1:00 AM	0.00	0.10	0.11
12/22/09 3:00 AM	0.00	0.10	0.11
12/22/09 5:00 AM	0.00	0.10	0.11
12/22/09 7:00 AM	0.00	0.11	0.11
12/22/09 9:00 AM	0.00	0.10	0.11
12/22/09 11:00 AM	0.00	0.11	0.11
12/22/09 1:00 PM	0.00	0.11	0.10
12/22/09 3:00 PM	0.00	0.10	0.10
12/22/09 5:00 PM	0.00	0.10	0.10
12/22/09 7:00 PM	0.00	0.10	0.11
12/22/09 9:00 PM	0.00	0.10	0.11
12/22/09 11:00 PM	0.00	0.10	0.11
12/23/09 1:00 AM	0.00	0.06	0.11
12/23/09 3:00 AM	0.00	0.06	0.11
12/23/09 5:00 AM	0.00	0.08	0.11
12/23/09 7:00 AM	0.00	0.10	0.11
12/23/09 9:00 AM	0.00	0.10	0.11
12/23/09 11:00 AM	0.00	0.10	0.10
12/23/09 1:00 PM	0.00	0.09	0.11
12/23/09 3:00 PM	0.00	0.09	0.11
12/23/09 5:00 PM	0.00	0.10	0.11
12/23/09 7:00 PM	0.00	0.09	0.11
12/23/09 9:00 PM	0.00	0.10	0.11
12/23/09 11:00 PM	0.00	0.09	0.11
12/24/09 1:00 AM	0.00	0.08	0.10
12/24/09 3:00 AM	0.00	0.06	0.08
12/24/09 5:00 AM	0.00	0.03	0.09
12/24/09 7:00 AM	0.00	0.02	0.09
12/24/09 9:00 AM	0.00	0.02	0.11
12/24/09 11:00 AM	0.00	0.02	0.16
12/24/09 1:00 PM	0.00	0.01	0.16
12/24/09 3:00 PM	0.00	0.00	0.16
12/24/09 5:00 PM	0.00	0.01	0.13

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
12/24/09 7:00 PM	0.00	0.01	0.09
12/24/09 9:00 PM	0.00	0.00	0.09
12/24/09 11:00 PM	0.00	0.00	0.10
12/25/09 1:00 AM	0.00	0.00	0.15
12/25/09 3:00 AM	0.00	0.00	0.19
12/25/09 5:00 AM	0.00	0.00	0.20
12/25/09 7:00 AM	0.00	0.00	0.22
12/25/09 9:00 AM	0.00	0.03	0.22
12/25/09 11:00 AM	0.00	0.06	0.18
12/25/09 1:00 PM	0.00	0.06	0.16
12/25/09 3:00 PM	0.00	0.06	0.13
12/25/09 5:00 PM	0.00	0.05	0.13
12/25/09 7:00 PM	0.00	0.04	0.13
12/25/09 9:00 PM	0.00	0.05	0.11
12/25/09 11:00 PM	0.00	0.05	0.09
12/26/09 1:00 AM	0.00	0.06	0.09
12/26/09 3:00 AM	0.00	0.06	0.08
12/26/09 5:00 AM	0.00	0.07	0.00
12/26/09 7:00 AM	0.00	0.07	0.00
12/26/09 9:00 AM	0.00	0.06	0.00
12/26/09 11:00 AM	0.00	0.07	0.00
12/26/09 1:00 PM	0.00	0.06	0.00
12/26/09 3:00 PM	0.00	0.05	0.00
12/26/09 5:00 PM	0.00	0.06	0.00
12/26/09 7:00 PM	0.00	0.06	0.00
12/26/09 9:00 PM	0.00	0.06	0.00
12/26/09 11:00 PM	0.00	0.06	0.00
12/27/09 1:00 AM	0.00	0.07	0.00
12/27/09 3:00 AM	0.00	0.07	0.00
12/27/09 5:00 AM	0.00	0.06	0.00
12/27/09 7:00 AM	0.00	0.07	0.00
12/27/09 9:00 AM	0.00	0.07	0.00
12/27/09 11:00 AM	0.00	0.07	0.00
12/27/09 1:00 PM	0.00	0.07	0.00
12/27/09 3:00 PM	0.00	0.07	0.00
12/27/09 5:00 PM	0.00	0.07	0.00
12/27/09 7:00 PM	0.00	0.07	0.00
12/27/09 9:00 PM	0.00	0.07	0.00
12/27/09 11:00 PM	0.00	0.07	0.00
12/28/09 1:00 AM	0.00	0.06	0.00
12/28/09 3:00 AM	0.00	0.07	0.00
12/28/09 5:00 AM	0.00	0.07	0.00
12/28/09 7:00 AM	0.00	0.08	0.00
12/28/09 9:00 AM	0.00	0.06	0.00
12/28/09 11:00 AM	0.00	0.07	0.00
12/28/09 1:00 PM	0.00	0.09	0.00
12/28/09 3:00 PM	0.00	0.08	0.00
12/28/09 5:00 PM	0.00	0.08	0.00
12/28/09 7:00 PM	0.00	0.09	0.00
12/28/09 9:00 PM	0.00	0.08	0.00
12/28/09 11:00 PM	0.00	0.09	0.00
12/29/09 1:00 AM	0.00	0.10	0.00
12/29/09 3:00 AM	0.00	0.14	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
12/29/09 5:00 AM	0.00	0.07	0.00
12/29/09 7:00 AM	0.00	0.08	0.00
12/29/09 9:00 AM	0.00	0.07	0.00
12/29/09 11:00 AM	0.00	0.07	0.00
12/29/09 1:00 PM	0.00	0.07	0.00
12/29/09 3:00 PM	0.00	0.07	0.00
12/29/09 5:00 PM	0.00	0.07	0.00
12/29/09 7:00 PM	0.00	0.07	0.00
12/29/09 9:00 PM	0.00	0.08	0.00
12/29/09 11:00 PM	0.00	0.09	0.00
12/30/09 1:00 AM	0.00	0.09	0.00
12/30/09 3:00 AM	0.00	0.09	0.00
12/30/09 5:00 AM	0.00	0.10	0.00
12/30/09 7:00 AM	0.00	0.12	0.00
12/30/09 9:00 AM	0.00	0.11	0.00
12/30/09 11:00 AM	0.00	0.12	0.00
12/30/09 1:00 PM	0.00	0.12	0.00
12/30/09 3:00 PM	0.00	0.12	0.00
12/30/09 5:00 PM	0.00	0.12	0.00
12/30/09 7:00 PM	0.00	0.12	0.00
12/30/09 9:00 PM	0.00	0.11	0.00
12/30/09 11:00 PM	0.00	0.11	0.00
12/31/09 1:00 AM	0.00	0.11	0.00
12/31/09 3:00 AM	0.00	0.11	0.00
12/31/09 5:00 AM	0.00	0.10	0.00
12/31/09 7:00 AM	0.00	0.10	0.00
12/31/09 9:00 AM	0.00	0.12	0.00
12/31/09 11:00 AM	0.00	0.12	0.00
12/31/09 1:00 PM	0.00	0.12	0.00
12/31/09 3:00 PM	0.00	0.12	0.00
12/31/09 5:00 PM	0.00	0.12	0.00
12/31/09 7:00 PM	0.00	0.12	0.00
12/31/09 9:00 PM	0.00	0.12	0.00
12/31/09 11:00 PM	0.00	0.12	0.00
1/1/10 1:00 AM	0.00	0.12	0.00
1/1/10 3:00 AM	0.00	0.12	0.00
1/1/10 5:00 AM	0.00	0.12	0.00
1/1/10 7:00 AM	0.00	0.12	0.00
1/1/10 9:00 AM	0.00	0.12	0.00
1/1/10 11:00 AM	0.00	0.12	0.00
1/1/10 1:00 PM	0.00	0.12	0.00
1/1/10 3:00 PM	0.00	0.13	0.00
1/1/10 5:00 PM	0.00	0.12	0.00
1/1/10 7:00 PM	0.00	0.12	0.00
1/1/10 9:00 PM	0.00	0.12	0.00
1/1/10 11:00 PM	0.00	0.12	0.00
1/2/10 1:00 AM	0.00	0.12	0.00
1/2/10 3:00 AM	0.00	0.12	0.00
1/2/10 5:00 AM	0.00	0.12	0.00
1/2/10 7:00 AM	0.00	0.13	0.00
1/2/10 9:00 AM	0.00	0.13	0.00
1/2/10 11:00 AM	0.00	0.12	0.00
1/2/10 1:00 PM	0.00	0.12	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
1/2/10 3:00 PM	0.00	0.12	0.00
1/2/10 5:00 PM	0.00	0.12	0.00
1/2/10 7:00 PM	0.00	0.12	0.00
1/2/10 9:00 PM	0.00	0.12	0.00
1/2/10 11:00 PM	0.00	0.12	0.00
1/3/10 1:00 AM	0.00	0.11	0.00
1/3/10 3:00 AM	0.00	0.11	0.00
1/3/10 5:00 AM	0.00	0.12	0.00
1/3/10 7:00 AM	0.00	0.13	0.00
1/3/10 9:00 AM	0.00	0.12	0.00
1/3/10 11:00 AM	0.00	0.12	0.00
1/3/10 1:00 PM	0.00	0.12	0.00
1/3/10 3:00 PM	0.00	0.12	0.00
1/3/10 5:00 PM	0.00	0.11	0.00
1/3/10 7:00 PM	0.00	0.07	0.00
1/3/10 9:00 PM	0.00	0.13	0.00
1/3/10 11:00 PM	0.00	0.12	0.00
1/4/10 1:00 AM	0.00	0.12	0.00
1/4/10 3:00 AM	0.00	0.11	0.00
1/4/10 5:00 AM	0.00	0.11	0.00
1/4/10 7:00 AM	0.00	0.13	0.00
1/4/10 9:00 AM	0.00	0.12	0.00
1/4/10 11:00 AM	0.00	0.12	0.00
1/4/10 1:00 PM	0.00	0.12	0.00
1/4/10 3:00 PM	0.00	0.12	0.00
1/4/10 5:00 PM	0.00	0.12	0.00
1/4/10 7:00 PM	0.00	0.12	0.00
1/4/10 9:00 PM	0.00	0.11	0.00
1/4/10 11:00 PM	0.00	0.11	0.00
1/5/10 1:00 AM	0.00	0.11	0.00
1/5/10 3:00 AM	0.00	0.11	0.00
1/5/10 5:00 AM	0.00	0.12	0.00
1/5/10 7:00 AM	0.00	0.13	0.00
1/5/10 9:00 AM	0.00	0.12	0.00
1/5/10 11:00 AM	0.00	0.12	0.00
1/5/10 1:00 PM	0.00	0.12	0.00
1/5/10 3:00 PM	0.00	0.12	0.00
1/5/10 5:00 PM	0.00	0.12	0.00
1/5/10 7:00 PM	0.00	0.12	0.00
1/5/10 9:00 PM	0.00	0.20	0.00
1/5/10 11:00 PM	0.00	0.12	0.00
1/6/10 1:00 AM	0.00	0.12	0.00
1/6/10 3:00 AM	0.00	0.12	0.00
1/6/10 5:00 AM	0.00	0.12	0.00
1/6/10 7:00 AM	0.00	0.13	0.00
1/6/10 9:00 AM	0.00	0.12	0.00
1/6/10 11:00 AM	0.00	0.12	0.00
1/6/10 1:00 PM	0.00	0.11	0.00
1/6/10 3:00 PM	0.00	0.11	0.00
1/6/10 5:00 PM	0.00	0.12	0.00
1/6/10 7:00 PM	0.00	0.11	0.00
1/6/10 9:00 PM	0.00	0.18	0.00
1/6/10 11:00 PM	0.00	0.13	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
1/7/10 1:00 AM	0.00	0.11	0.00
1/7/10 3:00 AM	0.00	0.12	0.00
1/7/10 5:00 AM	0.00	0.16	0.00
1/7/10 7:00 AM	0.00	0.11	0.00
1/7/10 9:00 AM	0.00	0.10	0.00
1/7/10 11:00 AM	0.00	0.14	0.00
1/7/10 1:00 PM	0.00	0.20	0.00
1/7/10 3:00 PM	0.00	0.18	0.00
1/7/10 5:00 PM	0.00	0.10	0.00
1/7/10 7:00 PM	0.00	0.10	0.00
1/7/10 9:00 PM	0.00	0.10	0.00
1/7/10 11:00 PM	0.00	0.10	0.00
1/8/10 1:00 AM	0.00	0.09	0.00
1/8/10 3:00 AM	0.00	0.09	0.00
1/8/10 5:00 AM	0.00	0.09	0.00
1/8/10 7:00 AM	0.00	0.10	0.00
1/8/10 9:00 AM	0.00	0.08	0.00
1/8/10 11:00 AM	0.00	0.08	0.00
1/8/10 1:00 PM	0.00	0.08	0.00
1/8/10 3:00 PM	0.00	0.08	0.00
1/8/10 5:00 PM	0.00	0.09	0.00
1/8/10 7:00 PM	0.00	0.10	0.00
1/8/10 9:00 PM	0.00	0.10	0.00
1/8/10 11:00 PM	0.00	0.10	0.00
1/9/10 1:00 AM	0.00	0.10	0.00
1/9/10 3:00 AM	0.00	0.10	0.00
1/9/10 5:00 AM	0.00	0.10	0.00
1/9/10 7:00 AM	0.00	0.11	0.00
1/9/10 9:00 AM	0.00	0.10	0.00
1/9/10 11:00 AM	0.00	0.11	0.00
1/9/10 1:00 PM	0.00	0.11	0.00
1/9/10 3:00 PM	0.00	0.10	0.00
1/9/10 5:00 PM	0.00	0.11	0.00
1/9/10 7:00 PM	0.00	0.10	0.00
1/9/10 9:00 PM	0.00	0.10	0.00
1/9/10 11:00 PM	0.00	0.10	0.00
1/10/10 1:00 AM	0.00	0.10	0.00
1/10/10 3:00 AM	0.00	0.10	0.00
1/10/10 5:00 AM	0.00	0.09	0.00
1/10/10 7:00 AM	0.00	0.10	0.00
1/10/10 9:00 AM	0.00	0.09	0.00
1/10/10 11:00 AM	0.00	0.09	0.00
1/10/10 1:00 PM	0.00	0.10	0.00
1/10/10 3:00 PM	0.00	0.10	0.00
1/10/10 5:00 PM	0.00	0.10	0.00
1/10/10 7:00 PM	0.00	0.10	0.00
1/10/10 9:00 PM	0.00	0.10	0.00
1/10/10 11:00 PM	0.00	0.09	0.00
1/11/10 1:00 AM	0.00	0.09	0.00
1/11/10 3:00 AM	0.00	0.10	0.00
1/11/10 5:00 AM	0.00	0.09	0.00
1/11/10 7:00 AM	0.00	0.10	0.00
1/11/10 9:00 AM	0.00	0.09	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
1/11/10 11:00 AM	0.00	0.09	0.00
1/11/10 1:00 PM	0.00	0.09	0.00
1/11/10 3:00 PM	0.00	0.10	0.00
1/11/10 5:00 PM	0.00	0.22	0.00
1/11/10 7:00 PM	0.00	0.22	0.00
1/11/10 9:00 PM	0.00	0.23	0.00
1/11/10 11:00 PM	0.00	0.23	0.00
1/12/10 1:00 AM	0.00	0.22	0.00
1/12/10 3:00 AM	0.00	0.22	0.00
1/12/10 5:00 AM	0.00	0.23	0.00
1/12/10 7:00 AM	0.00	0.23	0.00
1/12/10 9:00 AM	0.00	0.22	0.00
1/12/10 11:00 AM	0.00	0.21	0.00
1/12/10 1:00 PM	0.00	0.21	0.00
1/12/10 3:00 PM	0.00	0.20	0.00
1/12/10 5:00 PM	0.00	0.20	0.00
1/12/10 7:00 PM	0.00	0.20	0.00
1/12/10 9:00 PM	0.00	0.19	0.00
1/12/10 11:00 PM	0.00	0.19	0.00
1/13/10 1:00 AM	0.00	0.19	0.00
1/13/10 3:00 AM	0.00	0.20	0.00
1/13/10 5:00 AM	0.00	0.19	0.00
1/13/10 7:00 AM	0.00	0.20	0.00
1/13/10 9:00 AM	0.00	0.19	0.00
1/13/10 11:00 AM	0.00	0.20	0.00
1/13/10 1:00 PM	0.00	0.19	0.00
1/13/10 3:00 PM	0.00	0.20	0.00
1/13/10 5:00 PM	0.00	0.20	0.00
1/13/10 7:00 PM	0.00	0.21	0.00
1/13/10 9:00 PM	0.00	0.21	0.00
1/13/10 11:00 PM	0.00	0.21	0.00
1/14/10 1:00 AM	0.00	0.20	0.00
1/14/10 3:00 AM	0.00	0.20	0.00
1/14/10 5:00 AM	0.00	0.20	0.00
1/14/10 7:00 AM	0.00	0.21	0.00
1/14/10 9:00 AM	0.00	0.18	0.00
1/14/10 11:00 AM	0.00	0.19	0.00
1/14/10 1:00 PM	0.00	0.19	0.00
1/14/10 3:00 PM	0.00	0.18	0.00
1/14/10 5:00 PM	0.00	0.20	0.00
1/14/10 7:00 PM	0.00	0.20	0.00
1/14/10 9:00 PM	0.00	0.20	0.00
1/14/10 11:00 PM	0.00	0.20	0.00
1/15/10 1:00 AM	0.00	0.19	0.00
1/15/10 3:00 AM	0.00	0.20	0.00
1/15/10 5:00 AM	0.00	0.21	0.00
1/15/10 7:00 AM	0.00	0.23	0.00
1/15/10 9:00 AM	0.00	0.24	0.00
1/15/10 11:00 AM	0.00	0.23	0.00
1/15/10 1:00 PM	0.00	0.23	0.00
1/15/10 3:00 PM	0.00	0.23	0.00
1/15/10 5:00 PM	0.00	0.23	0.00
1/15/10 7:00 PM	0.00	0.23	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
1/15/10 9:00 PM	0.00	0.23	0.00
1/15/10 11:00 PM	0.00	0.24	0.00
1/16/10 1:00 AM	0.00	0.24	0.00
1/16/10 3:00 AM	0.00	0.24	0.00
1/16/10 5:00 AM	0.00	0.24	0.00
1/16/10 7:00 AM	0.00	0.25	0.00
1/16/10 9:00 AM	0.00	0.24	0.00
1/16/10 11:00 AM	0.00	0.23	0.00
1/16/10 1:00 PM	0.00	0.23	0.00
1/16/10 3:00 PM	0.00	0.23	0.00
1/16/10 5:00 PM	0.00	0.21	0.00
1/16/10 7:00 PM	0.00	0.13	0.00
1/16/10 9:00 PM	0.00	0.14	0.00
1/16/10 11:00 PM	0.00	0.14	0.00
1/17/10 1:00 AM	0.00	0.14	0.00
1/17/10 3:00 AM	0.00	0.14	0.00
1/17/10 5:00 AM	0.00	0.23	0.00
1/17/10 7:00 AM	0.00	0.25	0.00
1/17/10 9:00 AM	0.00	0.23	0.00
1/17/10 11:00 AM	0.00	0.23	0.00
1/17/10 1:00 PM	0.00	0.23	0.00
1/17/10 3:00 PM	0.00	0.23	0.00
1/17/10 5:00 PM	0.00	0.23	0.00
1/17/10 7:00 PM	0.00	0.23	0.00
1/17/10 9:00 PM	0.00	0.22	0.00
1/17/10 11:00 PM	0.00	0.22	0.00
1/18/10 1:00 AM	0.00	0.21	0.00
1/18/10 3:00 AM	0.00	0.21	0.00
1/18/10 5:00 AM	0.00	0.21	0.00
1/18/10 7:00 AM	0.00	0.23	0.00
1/18/10 9:00 AM	0.00	0.20	0.00
1/18/10 11:00 AM	0.00	0.21	0.00
1/18/10 1:00 PM	0.00	0.21	0.00
1/18/10 3:00 PM	0.00	0.22	0.00
1/18/10 5:00 PM	0.00	0.22	0.00
1/18/10 7:00 PM	0.00	0.22	0.00
1/18/10 9:00 PM	0.00	0.22	0.00
1/18/10 11:00 PM	0.00	0.22	0.00
1/19/10 1:00 AM	0.00	0.22	0.00
1/19/10 3:00 AM	0.00	0.21	0.00
1/19/10 5:00 AM	0.00	0.21	0.00
1/19/10 7:00 AM	0.00	0.22	0.00
1/19/10 9:00 AM	0.00	0.21	0.00
1/19/10 11:00 AM	0.00	0.21	0.00
1/19/10 1:00 PM	0.00	0.20	0.01
1/19/10 3:00 PM	0.00	0.20	0.04
1/19/10 5:00 PM	0.00	0.20	0.04
1/19/10 7:00 PM	0.00	0.20	0.04
1/19/10 9:00 PM	0.00	0.20	0.04
1/19/10 11:00 PM	0.00	0.20	0.04
1/20/10 1:00 AM	0.00	0.19	0.04
1/20/10 3:00 AM	0.00	0.20	0.04
1/20/10 5:00 AM	0.00	0.19	0.06

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
1/20/10 7:00 AM	0.00	0.19	0.08
1/20/10 9:00 AM	0.00	0.18	0.08
1/20/10 11:00 AM	0.00	0.20	0.06
1/20/10 1:00 PM	0.00	0.21	0.06
1/20/10 3:00 PM	0.00	0.23	0.06
1/20/10 5:00 PM	0.00	0.24	0.06
1/20/10 7:00 PM	0.00	0.20	0.07
1/20/10 9:00 PM	0.00	0.21	0.06
1/20/10 11:00 PM	0.00	0.17	0.06
1/21/10 1:00 AM	0.00	0.12	0.07
1/21/10 3:00 AM	0.00	0.10	0.08
1/21/10 5:00 AM	0.00	0.00	0.07
1/21/10 7:00 AM	0.00	0.05	0.08
1/21/10 9:00 AM	0.00	0.00	0.09
1/21/10 11:00 AM	0.00	0.00	0.09
1/21/10 1:00 PM	0.00	0.00	0.10
1/21/10 3:00 PM	0.00	0.00	0.10
1/21/10 5:00 PM	0.00	0.00	0.11
1/21/10 7:00 PM	0.00	0.00	0.22
1/21/10 9:00 PM	0.00	0.00	0.13
1/21/10 11:00 PM	0.00	0.00	0.22
1/22/10 1:00 AM	0.00	0.00	0.15
1/22/10 3:00 AM	0.00	0.00	0.14
1/22/10 5:00 AM	0.00	0.00	0.21
1/22/10 7:00 AM	0.00	0.00	0.27
1/22/10 9:00 AM	0.00	0.00	0.24
1/22/10 11:00 AM	0.00	0.00	0.20
1/22/10 1:00 PM	0.00	0.00	0.18
1/22/10 3:00 PM	0.00	0.00	0.17
1/22/10 5:00 PM	0.00	0.00	0.10
1/22/10 7:00 PM	0.00	0.00	0.06
1/22/10 9:00 PM	0.00	0.00	0.06
1/22/10 11:00 PM	0.00	0.00	0.06
1/23/10 1:00 AM	0.00	0.00	0.05
1/23/10 3:00 AM	0.00	0.00	0.05
1/23/10 5:00 AM	0.00	0.00	0.05
1/23/10 7:00 AM	0.00	0.00	0.06
1/23/10 9:00 AM	0.00	0.00	0.06
1/23/10 11:00 AM	0.00	0.00	0.06
1/23/10 1:00 PM	0.00	0.00	0.06
1/23/10 3:00 PM	0.00	0.00	0.06
1/23/10 5:00 PM	0.00	0.00	0.06
1/23/10 7:00 PM	0.00	0.00	0.06
1/23/10 9:00 PM	0.00	0.00	0.06
1/23/10 11:00 PM	0.00	0.00	0.06
1/24/10 1:00 AM	0.00	0.00	0.06
1/24/10 3:00 AM	0.00	0.00	0.06
1/24/10 5:00 AM	0.00	0.00	0.06
1/24/10 7:00 AM	0.00	0.00	0.07
1/24/10 9:00 AM	0.00	0.00	0.08
1/24/10 11:00 AM	0.00	0.00	0.06
1/24/10 1:00 PM	0.00	0.00	0.06
1/24/10 3:00 PM	0.00	0.00	0.06

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
1/24/10 5:00 PM	0.00	0.00	0.06
1/24/10 7:00 PM	0.00	0.00	0.07
1/24/10 9:00 PM	0.00	0.00	0.06
1/24/10 11:00 PM	0.00	0.00	0.06
1/25/10 1:00 AM	0.00	0.00	0.05
1/25/10 3:00 AM	0.00	0.00	0.06
1/25/10 5:00 AM	0.00	0.00	0.06
1/25/10 7:00 AM	0.00	0.00	0.06
1/25/10 9:00 AM	0.00	0.00	0.06
1/25/10 11:00 AM	0.00	0.00	0.06
1/25/10 1:00 PM	0.00	0.00	0.07
1/25/10 3:00 PM	0.00	0.00	0.07
1/25/10 5:00 PM	0.00	0.00	0.07
1/25/10 7:00 PM	0.00	0.00	0.07
1/25/10 9:00 PM	0.00	0.00	0.07
1/25/10 11:00 PM	0.00	0.00	0.07
1/26/10 1:00 AM	0.00	0.00	0.07
1/26/10 3:00 AM	0.00	0.00	0.06
1/26/10 5:00 AM	0.00	0.00	0.07
1/26/10 7:00 AM	0.00	0.00	0.08
1/26/10 9:00 AM	0.00	0.00	0.07
1/26/10 11:00 AM	0.00	0.00	0.06
1/26/10 1:00 PM	0.00	0.00	0.07
1/26/10 3:00 PM	0.00	0.00	0.07
1/26/10 5:00 PM	0.00	0.00	0.07
1/26/10 7:00 PM	0.00	0.00	0.06
1/26/10 9:00 PM	0.00	0.00	0.06
1/26/10 11:00 PM	0.00	0.00	0.06
1/27/10 1:00 AM	0.00	0.00	0.06
1/27/10 3:00 AM	0.00	0.00	0.06
1/27/10 5:00 AM	0.00	0.00	0.07
1/27/10 7:00 AM	0.00	0.00	0.07
1/27/10 9:00 AM	0.00	0.00	0.08
1/27/10 11:00 AM	0.00	0.00	0.06
1/27/10 1:00 PM	0.00	0.00	0.07
1/27/10 3:00 PM	0.00	0.00	0.08
1/27/10 5:00 PM	0.00	0.00	0.06
1/27/10 7:00 PM	0.00	0.00	0.05
1/27/10 9:00 PM	0.00	0.00	0.05
1/27/10 11:00 PM	0.00	0.00	0.05
1/28/10 1:00 AM	0.00	0.00	0.05
1/28/10 3:00 AM	0.00	0.00	0.05
1/28/10 5:00 AM	0.00	0.00	0.07
1/28/10 7:00 AM	0.00	0.00	0.08
1/28/10 9:00 AM	0.00	0.00	0.07
1/28/10 11:00 AM	0.00	0.00	0.07
1/28/10 1:00 PM	0.00	0.00	0.07
1/28/10 3:00 PM	0.00	0.00	0.07
1/28/10 5:00 PM	0.00	0.00	0.07
1/28/10 7:00 PM	0.00	0.00	0.08
1/28/10 9:00 PM	0.00	0.00	0.07
1/28/10 11:00 PM	0.00	0.00	0.07
1/29/10 1:00 AM	0.00	0.00	0.07

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
1/29/10 3:00 AM	0.00	0.00	0.08
1/29/10 5:00 AM	0.00	0.00	0.08
1/29/10 7:00 AM	0.00	0.00	0.07
1/29/10 9:00 AM	0.00	0.00	0.08
1/29/10 11:00 AM	0.00	0.00	0.14
1/29/10 1:00 PM	0.00	0.00	0.19
1/29/10 3:00 PM	0.00	0.00	0.20
1/29/10 5:00 PM	0.00	0.00	0.10
1/29/10 7:00 PM	0.00	0.00	0.09
1/29/10 9:00 PM	0.00	0.00	0.09
1/29/10 11:00 PM	0.00	0.00	0.09
1/30/10 1:00 AM	0.00	0.00	0.07
1/30/10 3:00 AM	0.00	0.00	0.08
1/30/10 5:00 AM	0.00	0.00	0.08
1/30/10 7:00 AM	0.00	0.00	0.07
1/30/10 9:00 AM	0.00	0.00	0.07
1/30/10 11:00 AM	0.00	0.00	0.07
1/30/10 1:00 PM	0.00	0.00	0.07
1/30/10 3:00 PM	0.00	0.00	0.07
1/30/10 5:00 PM	0.00	0.00	0.07
1/30/10 7:00 PM	0.00	0.00	0.07
1/30/10 9:00 PM	0.00	0.00	0.06
1/30/10 11:00 PM	0.00	0.00	0.06
1/31/10 1:00 AM	0.00	0.00	0.06
1/31/10 3:00 AM	0.00	0.00	0.06
1/31/10 5:00 AM	0.00	0.00	0.07
1/31/10 7:00 AM	0.00	0.00	0.07
1/31/10 9:00 AM	0.00	0.00	0.09
1/31/10 11:00 AM	0.00	0.00	0.09
1/31/10 1:00 PM	0.00	0.00	0.07
1/31/10 3:00 PM	0.00	0.00	0.08
1/31/10 5:00 PM	0.00	0.00	0.06
1/31/10 7:00 PM	0.00	0.00	0.06
1/31/10 9:00 PM	0.00	0.00	0.07
1/31/10 11:00 PM	0.00	0.00	0.06
2/1/10 1:00 AM	0.00	0.00	0.05
2/1/10 3:00 AM	0.00	0.00	0.05
2/1/10 5:00 AM	0.00	0.00	0.05
2/1/10 7:00 AM	0.00	0.00	0.07
2/1/10 9:00 AM	0.00	0.00	0.05
2/1/10 11:00 AM	0.00	0.00	0.05
2/1/10 1:00 PM	0.00	0.00	0.06
2/1/10 3:00 PM	0.00	0.00	0.07
2/1/10 5:00 PM	0.00	0.00	0.07
2/1/10 7:00 PM	0.00	0.00	0.06
2/1/10 9:00 PM	0.00	0.00	0.06
2/1/10 11:00 PM	0.00	0.00	0.05
2/2/10 1:00 AM	0.00	0.00	0.05
2/2/10 3:00 AM	0.00	0.00	0.05
2/2/10 5:00 AM	0.00	0.00	0.05
2/2/10 7:00 AM	0.00	0.00	0.05
2/2/10 9:00 AM	0.00	0.00	0.06
2/2/10 11:00 AM	0.00	0.00	0.06

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
2/2/10 1:00 PM	0.00	0.00	0.05
2/2/10 3:00 PM	0.00	0.00	0.05
2/2/10 5:00 PM	0.00	0.00	0.05
2/2/10 7:00 PM	0.00	0.00	0.06
2/2/10 9:00 PM	0.00	0.00	0.05
2/2/10 11:00 PM	0.00	0.00	0.07
2/3/10 1:00 AM	0.00	0.00	0.07
2/3/10 3:00 AM	0.00	0.00	0.07
2/3/10 5:00 AM	0.00	0.00	0.08
2/3/10 7:00 AM	0.00	0.00	0.07
2/3/10 9:00 AM	0.00	0.00	0.07
2/3/10 11:00 AM	0.00	0.00	0.07
2/3/10 1:00 PM	0.00	0.00	0.08
2/3/10 3:00 PM	0.00	0.00	0.08
2/3/10 5:00 PM	0.00	0.00	0.07
2/3/10 7:00 PM	0.00	0.00	0.07
2/3/10 9:00 PM	0.00	0.00	0.07
2/3/10 11:00 PM	0.00	0.00	0.07
2/4/10 1:00 AM	0.00	0.00	0.08
2/4/10 3:00 AM	0.00	0.00	0.08
2/4/10 5:00 AM	0.00	0.00	0.08
2/4/10 7:00 AM	0.00	0.00	0.08
2/4/10 9:00 AM	0.00	0.00	0.08
2/4/10 11:00 AM	0.00	0.00	0.07
2/4/10 1:00 PM	0.00	0.00	0.07
2/4/10 3:00 PM	0.00	0.00	0.07
2/4/10 5:00 PM	0.00	0.00	0.07
2/4/10 7:00 PM	0.00	0.00	0.07
2/4/10 9:00 PM	0.00	0.00	0.07
2/4/10 11:00 PM	0.00	0.00	0.05
2/5/10 1:00 AM	0.00	0.00	0.05
2/5/10 3:00 AM	0.00	0.00	0.05
2/5/10 5:00 AM	0.00	0.00	0.06
2/5/10 7:00 AM	0.00	0.00	0.07
2/5/10 9:00 AM	0.00	0.00	0.07
2/5/10 11:00 AM	0.00	0.00	0.07
2/5/10 1:00 PM	0.00	0.00	0.06
2/5/10 3:00 PM	0.00	0.00	0.06
2/5/10 5:00 PM	0.00	0.00	0.06
2/5/10 7:00 PM	0.00	0.00	0.06
2/5/10 9:00 PM	0.00	0.00	0.06
2/5/10 11:00 PM	0.00	0.00	0.06
2/6/10 1:00 AM	0.00	0.00	0.05
2/6/10 3:00 AM	0.00	0.00	0.06
2/6/10 5:00 AM	0.00	0.00	0.06
2/6/10 7:00 AM	0.00	0.00	0.07
2/6/10 9:00 AM	0.00	0.00	0.06
2/6/10 11:00 AM	0.00	0.00	0.07
2/6/10 1:00 PM	0.00	0.00	0.06
2/6/10 3:00 PM	0.00	0.00	0.06
2/6/10 5:00 PM	0.00	0.00	0.06
2/6/10 7:00 PM	0.00	0.00	0.06
2/6/10 9:00 PM	0.00	0.00	0.06

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
2/6/10 11:00 PM	0.00	0.00	0.07
2/7/10 1:00 AM	0.00	0.00	0.07
2/7/10 3:00 AM	0.00	0.00	0.07
2/7/10 5:00 AM	0.00	0.00	0.07
2/7/10 7:00 AM	0.00	0.00	0.08
2/7/10 9:00 AM	0.00	0.00	0.07
2/7/10 11:00 AM	0.00	0.00	0.07
2/7/10 1:00 PM	0.00	0.00	0.07
2/7/10 3:00 PM	0.00	0.00	0.06
2/7/10 5:00 PM	0.00	0.00	0.06
2/7/10 7:00 PM	0.00	0.00	0.07
2/7/10 9:00 PM	0.00	0.00	0.07
2/7/10 11:00 PM	0.00	0.00	0.07
2/8/10 1:00 AM	0.00	0.00	0.08
2/8/10 3:00 AM	0.00	0.00	0.07
2/8/10 5:00 AM	0.00	0.00	0.08
2/8/10 7:00 AM	0.00	0.00	0.08
2/8/10 9:00 AM	0.00	0.00	0.08
2/8/10 11:00 AM	0.00	0.00	0.07
2/8/10 1:00 PM	0.00	0.00	0.07
2/8/10 3:00 PM	0.00	0.00	0.06
2/8/10 5:00 PM	0.00	0.00	0.06
2/8/10 7:00 PM	0.00	0.00	0.06
2/8/10 9:00 PM	0.00	0.00	0.07
2/8/10 11:00 PM	0.00	0.00	0.07
2/9/10 1:00 AM	0.00	0.00	0.07
2/9/10 3:00 AM	0.00	0.00	0.07
2/9/10 5:00 AM	0.00	0.00	0.07
2/9/10 7:00 AM	0.00	0.00	0.07
2/9/10 9:00 AM	0.00	0.00	0.07
2/9/10 11:00 AM	0.00	0.00	0.07
2/9/10 1:00 PM	0.00	0.00	0.06
2/9/10 3:00 PM	0.00	0.00	0.06
2/9/10 5:00 PM	0.00	0.15	0.07
2/9/10 7:00 PM	0.00	0.17	0.07
2/9/10 9:00 PM	0.00	0.17	0.06
2/9/10 11:00 PM	0.00	0.17	0.07
2/10/10 1:00 AM	0.00	0.17	0.06
2/10/10 3:00 AM	0.00	0.17	0.06
2/10/10 5:00 AM	0.00	0.17	0.06
2/10/10 7:00 AM	0.00	0.18	0.06
2/10/10 9:00 AM	0.00	0.03	0.06
2/10/10 11:00 AM	0.00	0.01	0.06
2/10/10 1:00 PM	0.00	0.00	0.06
2/10/10 3:00 PM	0.00	0.00	0.06
2/10/10 5:00 PM	0.00	0.05	0.06
2/10/10 7:00 PM	0.00	0.15	0.06
2/10/10 9:00 PM	0.00	0.23	0.07
2/10/10 11:00 PM	0.00	0.25	0.07
2/11/10 1:00 AM	0.00	0.24	0.06
2/11/10 3:00 AM	0.00	0.24	0.08
2/11/10 5:00 AM	0.00	0.23	0.07
2/11/10 7:00 AM	0.00	0.22	0.07

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
2/11/10 9:00 AM	0.00	0.19	0.07
2/11/10 11:00 AM	0.00	0.17	0.07
2/11/10 1:00 PM	0.00	0.19	0.07
2/11/10 3:00 PM	0.00	0.19	0.07
2/11/10 5:00 PM	0.00	0.19	0.07
2/11/10 7:00 PM	0.00	0.18	0.07
2/11/10 9:00 PM	0.00	0.18	0.06
2/11/10 11:00 PM	0.00	0.19	0.06
2/12/10 1:00 AM	0.00	0.20	0.07
2/12/10 3:00 AM	0.00	0.21	0.07
2/12/10 5:00 AM	0.00	0.21	0.07
2/12/10 7:00 AM	0.00	0.21	0.07
2/12/10 9:00 AM	0.00	0.20	0.07
2/12/10 11:00 AM	0.00	0.19	0.07
2/12/10 1:00 PM	0.00	0.19	0.06
2/12/10 3:00 PM	0.00	0.18	0.06
2/12/10 5:00 PM	0.00	0.17	0.07
2/12/10 7:00 PM	0.00	0.19	0.06
2/12/10 9:00 PM	0.00	0.18	0.06
2/12/10 11:00 PM	0.00	0.18	0.06
2/13/10 1:00 AM	0.00	0.18	0.06
2/13/10 3:00 AM	0.00	0.18	0.06
2/13/10 5:00 AM	0.00	0.17	0.06
2/13/10 7:00 AM	0.00	0.17	0.07
2/13/10 9:00 AM	0.00	0.18	0.07
2/13/10 11:00 AM	0.00	0.17	0.08
2/13/10 1:00 PM	0.00	0.17	0.08
2/13/10 3:00 PM	0.00	0.17	0.07
2/13/10 5:00 PM	0.00	0.17	0.07
2/13/10 7:00 PM	0.00	0.16	0.07
2/13/10 9:00 PM	0.00	0.16	0.08
2/13/10 11:00 PM	0.00	0.16	0.07
2/14/10 1:00 AM	0.00	0.16	0.08
2/14/10 3:00 AM	0.00	0.16	0.08
2/14/10 5:00 AM	0.00	0.15	0.08
2/14/10 7:00 AM	0.00	0.16	0.09
2/14/10 9:00 AM	0.00	0.16	0.09
2/14/10 11:00 AM	0.00	0.16	0.09
2/14/10 1:00 PM	0.00	0.17	0.09
2/14/10 3:00 PM	0.00	0.17	0.08
2/14/10 5:00 PM	0.00	0.17	0.08
2/14/10 7:00 PM	0.00	0.17	0.08
2/14/10 9:00 PM	0.00	0.17	0.09
2/14/10 11:00 PM	0.00	0.17	0.09
2/15/10 1:00 AM	0.00	0.18	0.09
2/15/10 3:00 AM	0.00	0.18	0.10
2/15/10 5:00 AM	0.00	0.18	0.09
2/15/10 7:00 AM	0.00	0.18	0.09
2/15/10 9:00 AM	0.00	0.18	0.11
2/15/10 11:00 AM	0.00	0.19	0.12
2/15/10 1:00 PM	0.00	0.19	0.12
2/15/10 3:00 PM	0.00	0.19	0.11
2/15/10 5:00 PM	0.00	0.18	0.10

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
2/15/10 7:00 PM	0.00	0.18	0.09
2/15/10 9:00 PM	0.00	0.17	0.09
2/15/10 11:00 PM	0.00	0.17	0.09
2/16/10 1:00 AM	0.00	0.16	0.09
2/16/10 3:00 AM	0.00	0.16	0.09
2/16/10 5:00 AM	0.00	0.15	0.09
2/16/10 7:00 AM	0.00	0.17	0.09
2/16/10 9:00 AM	0.00	0.16	0.09
2/16/10 11:00 AM	0.00	0.15	0.09
2/16/10 1:00 PM	0.00	0.16	0.08
2/16/10 3:00 PM	0.00	0.16	0.08
2/16/10 5:00 PM	0.00	0.16	0.08
2/16/10 7:00 PM	0.00	0.15	0.08
2/16/10 9:00 PM	0.00	0.16	0.08
2/16/10 11:00 PM	0.00	0.16	0.08
2/17/10 1:00 AM	0.00	0.16	0.08
2/17/10 3:00 AM	0.00	0.16	0.09
2/17/10 5:00 AM	0.00	0.16	0.08
2/17/10 7:00 AM	0.00	0.17	0.08
2/17/10 9:00 AM	0.00	0.16	0.07
2/17/10 11:00 AM	0.00	0.16	0.07
2/17/10 1:00 PM	0.00	0.17	0.07
2/17/10 3:00 PM	0.00	0.16	0.07
2/17/10 5:00 PM	0.00	0.16	0.07
2/17/10 7:00 PM	0.00	0.16	0.07
2/17/10 9:00 PM	0.00	0.15	0.07
2/17/10 11:00 PM	0.00	0.15	0.08
2/18/10 1:00 AM	0.00	0.15	0.08
2/18/10 3:00 AM	0.00	0.15	0.08
2/18/10 5:00 AM	0.00	0.15	0.08
2/18/10 7:00 AM	0.00	0.16	0.08
2/18/10 9:00 AM	0.00	0.15	0.06
2/18/10 11:00 AM	0.00	0.15	0.09
2/18/10 1:00 PM	0.00	0.16	0.22
2/18/10 3:00 PM	0.00	0.16	0.13
2/18/10 5:00 PM	0.00	0.16	0.12
2/18/10 7:00 PM	0.00	0.16	0.08
2/18/10 9:00 PM	0.00	0.16	0.09
2/18/10 11:00 PM	0.00	0.16	0.08
2/19/10 1:00 AM	0.00	0.16	0.08
2/19/10 3:00 AM	0.00	0.16	0.08
2/19/10 5:00 AM	0.00	0.16	0.08
2/19/10 7:00 AM	0.00	0.17	0.09
2/19/10 9:00 AM	0.00	0.17	0.08
2/19/10 11:00 AM	0.00	0.17	0.08
2/19/10 1:00 PM	0.00	0.17	0.08
2/19/10 3:00 PM	0.00	0.16	0.07
2/19/10 5:00 PM	0.00	0.19	0.06
2/19/10 7:00 PM	0.00	0.15	0.07
2/19/10 9:00 PM	0.00	0.15	0.06
2/19/10 11:00 PM	0.00	0.15	0.06
2/20/10 1:00 AM	0.00	0.00	0.08
2/20/10 3:00 AM	0.00	0.04	0.08

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
2/20/10 5:00 AM	0.00	0.11	0.08
2/20/10 7:00 AM	0.00	0.14	0.09
2/20/10 9:00 AM	0.00	0.15	0.14
2/20/10 11:00 AM	0.00	0.15	0.18
2/20/10 1:00 PM	0.00	0.17	0.20
2/20/10 3:00 PM	0.00	0.24	0.09
2/20/10 5:00 PM	0.00	0.20	0.09
2/20/10 7:00 PM	0.00	0.17	0.09
2/20/10 9:00 PM	0.00	0.17	0.09
2/20/10 11:00 PM	0.00	0.17	0.08
2/21/10 1:00 AM	0.00	0.17	0.05
2/21/10 3:00 AM	0.00	0.16	0.05
2/21/10 5:00 AM	0.00	0.17	0.05
2/21/10 7:00 AM	0.00	0.17	0.05
2/21/10 9:00 AM	0.00	0.16	0.04
2/21/10 11:00 AM	0.00	0.08	0.05
2/21/10 1:00 PM	0.00	0.01	0.04
2/21/10 3:00 PM	0.00	0.00	0.05
2/21/10 5:00 PM	0.00	0.00	0.05
2/21/10 7:00 PM	0.00	0.00	0.05
2/21/10 9:00 PM	0.00	0.00	0.10
2/21/10 11:00 PM	0.00	0.00	0.10
2/22/10 1:00 AM	0.00	0.00	0.10
2/22/10 3:00 AM	0.00	0.00	0.10
2/22/10 5:00 AM	0.00	0.00	0.10
2/22/10 7:00 AM	0.00	0.00	0.09
2/22/10 9:00 AM	0.00	0.00	0.08
2/22/10 11:00 AM	0.00	0.00	0.18
2/22/10 1:00 PM	0.00	0.00	0.18
2/22/10 3:00 PM	0.00	0.00	0.19
2/22/10 5:00 PM	0.00	0.00	0.19
2/22/10 7:00 PM	0.00	0.00	0.18
2/22/10 9:00 PM	0.00	0.00	0.19
2/22/10 11:00 PM	0.00	0.00	0.18
2/23/10 1:00 AM	0.00	0.00	0.17
2/23/10 3:00 AM	0.00	0.00	0.18
2/23/10 5:00 AM	0.00	0.00	0.18
2/23/10 7:00 AM	0.00	0.00	0.17
2/23/10 9:00 AM	0.00	0.00	0.18
2/23/10 11:00 AM	0.00	0.00	0.18
2/23/10 1:00 PM	0.00	0.00	0.16
2/23/10 3:00 PM	0.00	0.00	0.17
2/23/10 5:00 PM	0.00	0.00	0.17
2/23/10 7:00 PM	0.00	0.00	0.17
2/23/10 9:00 PM	0.00	0.00	0.17
2/23/10 11:00 PM	0.00	0.00	0.17
2/24/10 1:00 AM	0.00	0.00	0.16
2/24/10 3:00 AM	0.00	0.00	0.16
2/24/10 5:00 AM	0.00	0.00	0.16
2/24/10 7:00 AM	0.00	0.00	0.16
2/24/10 9:00 AM	0.00	0.00	0.16
2/24/10 11:00 AM	0.00	0.00	0.16
2/24/10 1:00 PM	0.00	0.00	0.17

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
2/24/10 3:00 PM	0.00	0.00	0.17
2/24/10 5:00 PM	0.00	0.00	0.16
2/24/10 7:00 PM	0.00	0.00	0.16
2/24/10 9:00 PM	0.00	0.00	0.15
2/24/10 11:00 PM	0.00	0.00	0.15
2/25/10 1:00 AM	0.00	0.00	0.15
2/25/10 3:00 AM	0.00	0.00	0.15
2/25/10 5:00 AM	0.00	0.00	0.15
2/25/10 7:00 AM	0.00	0.00	0.16
2/25/10 9:00 AM	0.00	0.00	0.16
2/25/10 11:00 AM	0.00	0.00	0.16
2/25/10 1:00 PM	0.00	0.00	0.16
2/25/10 3:00 PM	0.00	0.00	0.16
2/25/10 5:00 PM	0.00	0.00	0.16
2/25/10 7:00 PM	0.00	0.00	0.17
2/25/10 9:00 PM	0.00	0.00	0.17
2/25/10 11:00 PM	0.00	0.00	0.17
2/26/10 1:00 AM	0.00	0.00	0.17
2/26/10 3:00 AM	0.00	0.00	0.18
2/26/10 5:00 AM	0.00	0.00	0.19
2/26/10 7:00 AM	0.00	0.00	0.17
2/26/10 9:00 AM	0.00	0.00	0.16
2/26/10 11:00 AM	0.00	0.00	0.16
2/26/10 1:00 PM	0.00	0.00	0.16
2/26/10 3:00 PM	0.00	0.00	0.16
2/26/10 5:00 PM	0.00	0.00	0.16
2/26/10 7:00 PM	0.00	0.00	0.16
2/26/10 9:00 PM	0.00	0.00	0.12
2/26/10 11:00 PM	0.00	0.00	0.11
2/27/10 1:00 AM	0.00	0.00	0.11
2/27/10 3:00 AM	0.00	0.00	0.11
2/27/10 5:00 AM	0.00	0.00	0.12
2/27/10 7:00 AM	0.00	0.00	0.11
2/27/10 9:00 AM	0.00	0.00	0.09
2/27/10 11:00 AM	0.00	0.00	0.11
2/27/10 1:00 PM	0.00	0.00	0.09
2/27/10 3:00 PM	0.00	0.00	0.08
2/27/10 5:00 PM	0.00	0.00	0.14
2/27/10 7:00 PM	0.00	0.00	0.15
2/27/10 9:00 PM	0.00	0.00	0.16
2/27/10 11:00 PM	0.00	0.00	0.15
2/28/10 1:00 AM	0.00	0.00	0.15
2/28/10 3:00 AM	0.00	0.00	0.15
2/28/10 5:00 AM	0.00	0.00	0.14
2/28/10 7:00 AM	0.00	0.00	0.14
2/28/10 9:00 AM	0.00	0.00	0.15
2/28/10 11:00 AM	0.00	0.00	0.44
2/28/10 1:00 PM	0.00	0.00	0.16
2/28/10 3:00 PM	0.00	0.00	0.16
2/28/10 5:00 PM	0.00	0.00	0.15
2/28/10 7:00 PM	0.00	0.00	0.16
2/28/10 9:00 PM	0.00	0.00	0.17
2/28/10 11:00 PM	0.00	0.00	0.17

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
3/1/10 1:00 AM	0.00	0.00	0.17
3/1/10 3:00 AM	0.00	0.00	0.17
3/1/10 5:00 AM	0.00	0.00	0.17
3/1/10 7:00 AM	0.00	0.00	0.17
3/1/10 9:00 AM	0.00	0.00	0.17
3/1/10 11:00 AM	0.00	0.00	0.17
3/1/10 1:00 PM	0.00	0.00	0.16
3/1/10 3:00 PM	0.00	0.00	0.16
3/1/10 5:00 PM	0.00	0.00	0.16
3/1/10 7:00 PM	0.00	0.00	0.16
3/1/10 9:00 PM	0.00	0.00	0.16
3/1/10 11:00 PM	0.00	0.00	0.16
3/2/10 1:00 AM	0.00	0.00	0.16
3/2/10 3:00 AM	0.00	0.00	0.16
3/2/10 5:00 AM	0.00	0.00	0.15
3/2/10 7:00 AM	0.00	0.00	0.16
3/2/10 9:00 AM	0.00	0.00	0.13
3/2/10 11:00 AM	0.00	0.00	0.11
3/2/10 1:00 PM	0.00	0.00	0.17
3/2/10 3:00 PM	0.00	0.00	0.15
3/2/10 5:00 PM	0.00	0.00	0.15
3/2/10 7:00 PM	0.00	0.00	0.15
3/2/10 9:00 PM	0.00	0.00	0.15
3/2/10 11:00 PM	0.00	0.00	0.15
3/3/10 1:00 AM	0.00	0.00	0.15
3/3/10 3:00 AM	0.00	0.00	0.15
3/3/10 5:00 AM	0.00	0.00	0.15
3/3/10 7:00 AM	0.00	0.00	0.15
3/3/10 9:00 AM	0.00	0.00	0.14
3/3/10 11:00 AM	0.00	0.00	0.15
3/3/10 1:00 PM	0.00	0.00	0.14
3/3/10 3:00 PM	0.00	0.00	0.13
3/3/10 5:00 PM	0.00	0.00	0.14
3/3/10 7:00 PM	0.00	0.00	0.13
3/3/10 9:00 PM	0.00	0.00	0.11
3/3/10 11:00 PM	0.00	0.00	0.12
3/4/10 1:00 AM	0.00	0.03	0.14
3/4/10 3:00 AM	0.00	0.07	0.14
3/4/10 5:00 AM	0.00	0.22	0.15
3/4/10 7:00 AM	0.00	0.35	0.14
3/4/10 9:00 AM	0.00	0.32	0.14
3/4/10 11:00 AM	0.00	0.00	0.14
3/4/10 1:00 PM	0.00	0.00	0.14
3/4/10 3:00 PM	0.00	0.00	0.14
3/4/10 5:00 PM	0.00	0.00	0.14
3/4/10 7:00 PM	0.00	0.00	0.14
3/4/10 9:00 PM	0.00	0.00	0.14
3/4/10 11:00 PM	0.00	0.00	0.14
3/5/10 1:00 AM	0.00	0.00	0.14
3/5/10 3:00 AM	0.00	0.00	0.14
3/5/10 5:00 AM	0.00	0.00	0.13
3/5/10 7:00 AM	0.00	0.00	0.14
3/5/10 9:00 AM	0.00	0.00	0.14

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
3/5/10 11:00 AM	0.00	0.00	0.14
3/5/10 1:00 PM	0.00	0.00	0.14
3/5/10 3:00 PM	0.00	0.00	0.14
3/5/10 5:00 PM	0.00	1.70	0.15
3/5/10 7:00 PM	0.00	1.50	0.14
3/5/10 9:00 PM	0.00	0.77	0.14
3/5/10 11:00 PM	0.00	0.24	0.13
3/6/10 1:00 AM	0.00	0.27	0.09
3/6/10 3:00 AM	0.00	0.17	0.10
3/6/10 5:00 AM	0.00	0.14	0.09
3/6/10 7:00 AM	0.00	0.14	0.09
3/6/10 9:00 AM	0.00	0.14	0.10
3/6/10 11:00 AM	0.00	0.14	0.10
3/6/10 1:00 PM	0.00	0.13	0.11
3/6/10 3:00 PM	0.00	0.12	0.13
3/6/10 5:00 PM	0.00	0.12	0.13
3/6/10 7:00 PM	0.00	0.11	0.14
3/6/10 9:00 PM	0.00	0.16	0.12
3/6/10 11:00 PM	0.00	0.14	0.14
3/7/10 1:00 AM	0.00	0.13	0.15
3/7/10 3:00 AM	0.00	0.12	0.14
3/7/10 5:00 AM	0.00	0.12	0.14
3/7/10 7:00 AM	0.00	0.13	0.15
3/7/10 9:00 AM	0.00	0.13	0.14
3/7/10 11:00 AM	0.00	0.13	0.14
3/7/10 1:00 PM	0.00	0.39	0.14
3/7/10 3:00 PM	0.00	0.12	0.01
3/7/10 5:00 PM	0.00	0.13	0.00
3/7/10 7:00 PM	0.00	0.13	0.00
3/7/10 9:00 PM	0.00	0.13	0.15
3/7/10 11:00 PM	0.00	0.12	0.15
3/8/10 1:00 AM	0.00	0.12	0.15
3/8/10 3:00 AM	0.00	0.13	0.15
3/8/10 5:00 AM	0.00	0.13	0.15
3/8/10 7:00 AM	0.00	0.13	0.15
3/8/10 9:00 AM	0.00	0.13	0.09
3/8/10 11:00 AM	0.00	0.13	0.00
3/8/10 1:00 PM	0.00	0.13	0.00
3/8/10 3:00 PM	0.00	0.10	0.00
3/8/10 5:00 PM	0.00	0.11	0.00
3/8/10 7:00 PM	0.00	0.12	0.00
3/8/10 9:00 PM	0.00	0.13	0.00
3/8/10 11:00 PM	0.00	0.14	0.00
3/9/10 1:00 AM	0.00	0.13	0.00
3/9/10 3:00 AM	0.00	0.13	0.00
3/9/10 5:00 AM	0.00	0.13	0.00
3/9/10 7:00 AM	0.00	0.15	0.00
3/9/10 9:00 AM	0.00	0.16	0.00
3/9/10 11:00 AM	0.00	0.30	0.00
3/9/10 1:00 PM	0.00	0.19	0.00
3/9/10 3:00 PM	0.00	0.17	0.00
3/9/10 5:00 PM	0.00	0.16	0.00
3/9/10 7:00 PM	0.00	0.17	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
3/9/10 9:00 PM	0.00	0.16	0.00
3/9/10 11:00 PM	0.00	0.15	0.00
3/10/10 1:00 AM	0.00	0.15	0.00
3/10/10 3:00 AM	0.00	0.12	0.00
3/10/10 5:00 AM	0.00	0.13	0.00
3/10/10 7:00 AM	0.00	0.16	0.00
3/10/10 9:00 AM	0.00	0.17	0.00
3/10/10 11:00 AM	0.00	0.17	0.00
3/10/10 1:00 PM	0.00	0.17	0.00
3/10/10 3:00 PM	0.00	0.17	0.00
3/10/10 5:00 PM	0.00	0.17	0.00
3/10/10 7:00 PM	0.00	0.16	0.00
3/10/10 9:00 PM	0.00	0.17	0.00
3/10/10 11:00 PM	0.00	0.17	0.00
3/11/10 1:00 AM	0.00	0.17	0.00
3/11/10 3:00 AM	0.00	0.15	0.00
3/11/10 5:00 AM	0.00	0.15	0.00
3/11/10 7:00 AM	0.00	0.18	0.00
3/11/10 9:00 AM	0.00	0.17	0.00
3/11/10 11:00 AM	0.00	0.17	0.00
3/11/10 1:00 PM	0.00	0.18	0.00
3/11/10 3:00 PM	0.00	0.19	0.00
3/11/10 5:00 PM	0.00	0.20	0.00
3/11/10 7:00 PM	0.00	0.22	0.00
3/11/10 9:00 PM	0.00	0.22	0.00
3/11/10 11:00 PM	0.00	0.14	0.00
3/12/10 1:00 AM	0.00	0.14	0.00
3/12/10 3:00 AM	0.00	0.14	0.00
3/12/10 5:00 AM	0.00	0.14	0.00
3/12/10 7:00 AM	0.00	0.14	0.00
3/12/10 9:00 AM	0.00	0.14	0.00
3/12/10 11:00 AM	0.00	0.13	0.00
3/12/10 1:00 PM	0.00	0.12	0.00
3/12/10 3:00 PM	0.00	0.13	0.00
3/12/10 5:00 PM	0.00	0.14	0.00
3/12/10 7:00 PM	0.00	0.26	0.00
3/12/10 9:00 PM	0.00	0.25	0.00
3/12/10 11:00 PM	0.00	0.23	0.00
3/13/10 1:00 AM	0.00	0.21	0.00
3/13/10 3:00 AM	0.00	0.21	0.00
3/13/10 5:00 AM	0.00	0.20	0.00
3/13/10 7:00 AM	0.00	0.19	0.00
3/13/10 9:00 AM	0.00	0.19	0.00
3/13/10 11:00 AM	0.00	0.19	0.00
3/13/10 1:00 PM	0.00	0.18	0.00
3/13/10 3:00 PM	0.00	0.19	0.00
3/13/10 5:00 PM	0.00	0.19	0.00
3/13/10 7:00 PM	0.00	0.19	0.00
3/13/10 9:00 PM	0.00	0.19	0.00
3/13/10 11:00 PM	0.00	0.19	0.00
3/14/10 1:00 AM	0.00	0.19	0.00
3/14/10 3:00 AM	0.00	0.19	0.00
3/14/10 5:00 AM	0.00	0.20	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
3/14/10 7:00 AM	0.00	0.19	0.00
3/14/10 9:00 AM	0.00	0.19	0.00
3/14/10 11:00 AM	0.00	0.18	0.00
3/14/10 1:00 PM	0.00	0.17	0.00
3/14/10 3:00 PM	0.00	0.17	0.00
3/14/10 5:00 PM	0.00	0.16	0.45
3/14/10 7:00 PM	0.00	0.16	0.21
3/14/10 9:00 PM	0.00	0.16	0.18
3/14/10 11:00 PM	0.00	0.15	0.13
3/15/10 1:00 AM	0.00	0.10	0.14
3/15/10 3:00 AM	0.00	0.09	0.14
3/15/10 5:00 AM	0.00	0.16	0.14
3/15/10 7:00 AM	0.00	0.16	0.17
3/15/10 9:00 AM	0.00	0.16	0.17
3/15/10 11:00 AM	0.00	0.14	0.14
3/15/10 1:00 PM	0.00	0.07	0.11
3/15/10 3:00 PM	0.00	0.09	0.11
3/15/10 5:00 PM	0.00	0.12	0.11
3/15/10 7:00 PM	0.00	0.13	0.11
3/15/10 9:00 PM	0.00	0.15	0.11
3/15/10 11:00 PM	0.00	0.15	0.11
3/16/10 1:00 AM	0.00	0.15	0.10
3/16/10 3:00 AM	0.00	0.13	0.10
3/16/10 5:00 AM	0.00	0.15	0.12
3/16/10 7:00 AM	0.00	0.15	0.08
3/16/10 9:00 AM	0.00	0.11	0.08
3/16/10 11:00 AM	0.00	0.10	0.08
3/16/10 1:00 PM	0.00	0.11	0.08
3/16/10 3:00 PM	0.00	0.12	0.08
3/16/10 5:00 PM	0.00	0.13	0.08
3/16/10 7:00 PM	0.00	0.17	0.08
3/16/10 9:00 PM	0.00	0.19	0.09
3/16/10 11:00 PM	0.00	0.17	0.08
3/17/10 1:00 AM	0.00	0.10	0.06
3/17/10 3:00 AM	0.00	0.11	0.05
3/17/10 5:00 AM	0.00	0.14	0.07
3/17/10 7:00 AM	0.00	0.15	0.09
3/17/10 9:00 AM	0.20	0.20	0.09
3/17/10 11:00 AM	0.25	0.25	0.09
3/17/10 1:00 PM	0.46	0.46	0.09
3/17/10 3:00 PM	0.30	0.30	0.09
3/17/10 5:00 PM	0.16	0.16	0.09
3/17/10 7:00 PM	0.16	0.16	0.09
3/17/10 9:00 PM	0.16	0.16	0.09
3/17/10 11:00 PM	0.16	0.16	0.07
3/18/10 1:00 AM	0.13	0.13	0.06
3/18/10 3:00 AM	0.11	0.11	0.04
3/18/10 5:00 AM	0.14	0.14	0.08
3/18/10 7:00 AM	0.14	0.14	0.10
3/18/10 9:00 AM	0.00	0.13	0.09
3/18/10 11:00 AM	0.00	0.13	0.09
3/18/10 1:00 PM	0.00	0.12	0.10
3/18/10 3:00 PM	0.00	0.12	0.10

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
3/18/10 5:00 PM	0.00	0.13	0.10
3/18/10 7:00 PM	0.00	0.16	0.10
3/18/10 9:00 PM	0.00	0.18	0.10
3/18/10 11:00 PM	0.00	0.17	0.10
3/19/10 1:00 AM	0.00	0.15	0.09
3/19/10 3:00 AM	0.00	0.13	0.09
3/19/10 5:00 AM	0.00	0.13	0.08
3/19/10 7:00 AM	0.00	0.13	0.09
3/19/10 9:00 AM	0.11	0.11	0.08
3/19/10 11:00 AM	0.09	0.09	0.08
3/19/10 1:00 PM	0.09	0.09	0.08
3/19/10 3:00 PM	0.08	0.08	0.08
3/19/10 5:00 PM	0.07	0.07	0.08
3/19/10 7:00 PM	0.08	0.08	0.07
3/19/10 9:00 PM	0.10	0.10	0.08
3/19/10 11:00 PM	0.09	0.09	0.08
3/20/10 1:00 AM	0.09	0.09	0.08
3/20/10 3:00 AM	0.09	0.09	0.06
3/20/10 5:00 AM	0.08	0.08	0.08
3/20/10 7:00 AM	0.10	0.10	0.08
3/20/10 9:00 AM	0.11	0.11	0.08
3/20/10 11:00 AM	0.13	0.13	0.08
3/20/10 1:00 PM	0.12	0.12	0.08
3/20/10 3:00 PM	0.10	0.10	0.08
3/20/10 5:00 PM	0.10	0.10	0.08
3/20/10 7:00 PM	0.10	0.10	0.05
3/20/10 9:00 PM	0.10	0.10	0.05
3/20/10 11:00 PM	0.09	0.09	0.05
3/21/10 1:00 AM	0.10	0.10	0.05
3/21/10 3:00 AM	0.10	0.10	0.05
3/21/10 5:00 AM	0.10	0.10	0.05
3/21/10 7:00 AM	0.09	0.09	0.08
3/21/10 9:00 AM	0.09	0.09	0.08
3/21/10 11:00 AM	0.09	0.09	0.09
3/21/10 1:00 PM	0.09	0.09	0.09
3/21/10 3:00 PM	0.10	0.10	0.08
3/21/10 5:00 PM	0.14	0.14	0.08
3/21/10 7:00 PM	0.11	0.11	0.08
3/21/10 9:00 PM	0.09	0.09	0.08
3/21/10 11:00 PM	0.08	0.08	0.08
3/22/10 1:00 AM	0.06	0.06	0.07
3/22/10 3:00 AM	0.06	0.06	0.07
3/22/10 5:00 AM	0.07	0.07	0.07
3/22/10 7:00 AM	0.08	0.08	0.08
3/22/10 9:00 AM	0.07	0.07	0.08
3/22/10 11:00 AM	0.10	0.10	0.09
3/22/10 1:00 PM	0.15	0.15	0.08
3/22/10 3:00 PM	0.15	0.15	0.07
3/22/10 5:00 PM	0.15	0.15	0.08
3/22/10 7:00 PM	0.20	0.20	0.08
3/22/10 9:00 PM	0.19	0.19	0.08
3/22/10 11:00 PM	0.16	0.16	0.06
3/23/10 1:00 AM	0.15	0.15	0.04

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
3/23/10 3:00 AM	0.16	0.16	0.03
3/23/10 5:00 AM	0.16	0.16	0.06
3/23/10 7:00 AM	0.18	0.18	0.07
3/23/10 9:00 AM	0.18	0.18	0.08
3/23/10 11:00 AM	0.18	0.18	0.08
3/23/10 1:00 PM	0.19	0.19	0.08
3/23/10 3:00 PM	0.20	0.20	0.08
3/23/10 5:00 PM	0.24	0.24	0.09
3/23/10 7:00 PM	0.22	0.22	0.09
3/23/10 9:00 PM	0.22	0.22	0.10
3/23/10 11:00 PM	0.20	0.20	0.08
3/24/10 1:00 AM	0.17	0.17	0.07
3/24/10 3:00 AM	0.17	0.17	0.07
3/24/10 5:00 AM	0.20	0.20	0.10
3/24/10 7:00 AM	0.23	0.23	0.10
3/24/10 9:00 AM	0.24	0.24	0.10
3/24/10 11:00 AM	0.23	0.23	0.10
3/24/10 1:00 PM	0.26	0.26	0.10
3/24/10 3:00 PM	0.26	0.26	0.09
3/24/10 5:00 PM	0.22	0.22	0.08
3/24/10 7:00 PM	0.20	0.20	0.08
3/24/10 9:00 PM	0.19	0.19	0.07
3/24/10 11:00 PM	0.17	0.17	0.07
3/25/10 1:00 AM	0.10	0.10	0.07
3/25/10 3:00 AM	0.09	0.09	0.07
3/25/10 5:00 AM	0.10	0.10	0.09
3/25/10 7:00 AM	0.20	0.20	0.10
3/25/10 9:00 AM	0.36	0.36	0.09
3/25/10 11:00 AM	0.50	0.50	0.10
3/25/10 1:00 PM	0.63	0.63	0.08
3/25/10 3:00 PM	0.23	0.23	0.08
3/25/10 5:00 PM	0.14	0.14	0.09
3/25/10 7:00 PM	0.15	0.15	0.09
3/25/10 9:00 PM	0.20	0.20	0.09
3/25/10 11:00 PM	0.20	0.20	0.06
3/26/10 1:00 AM	0.15	0.15	0.04
3/26/10 3:00 AM	0.14	0.14	0.04
3/26/10 5:00 AM	0.18	0.18	0.08
3/26/10 7:00 AM	0.23	0.23	0.11
3/26/10 9:00 AM	0.22	0.22	0.10
3/26/10 11:00 AM	0.22	0.22	0.10
3/26/10 1:00 PM	0.20	0.20	0.10
3/26/10 3:00 PM	0.18	0.18	0.09
3/26/10 5:00 PM	0.16	0.16	0.09
3/26/10 7:00 PM	0.19	0.19	0.09
3/26/10 9:00 PM	0.20	0.20	0.09
3/26/10 11:00 PM	0.18	0.18	0.10
3/27/10 1:00 AM	0.19	0.19	0.08
3/27/10 3:00 AM	0.19	0.19	0.08
3/27/10 5:00 AM	0.18	0.18	0.09
3/27/10 7:00 AM	0.19	0.19	0.10
3/27/10 9:00 AM	0.18	0.18	0.10
3/27/10 11:00 AM	0.17	0.17	0.09

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
3/27/10 1:00 PM	0.17	0.17	0.09
3/27/10 3:00 PM	0.17	0.17	0.09
3/27/10 5:00 PM	0.17	0.17	0.10
3/27/10 7:00 PM	0.17	0.17	0.08
3/27/10 9:00 PM	0.18	0.18	0.09
3/27/10 11:00 PM	0.19	0.19	0.09
3/28/10 1:00 AM	0.17	0.17	0.08
3/28/10 3:00 AM	0.16	0.16	0.06
3/28/10 5:00 AM	0.17	0.17	0.07
3/28/10 7:00 AM	0.19	0.19	0.08
3/28/10 9:00 AM	0.21	0.21	0.08
3/28/10 11:00 AM	0.09	0.09	0.08
3/28/10 1:00 PM	0.09	0.09	0.09
3/28/10 3:00 PM	0.09	0.09	0.09
3/28/10 5:00 PM	0.09	0.09	0.09
3/28/10 7:00 PM	0.10	0.10	0.08
3/28/10 9:00 PM	0.11	0.11	0.09
3/28/10 11:00 PM	0.11	0.11	0.10
3/29/10 1:00 AM	0.10	0.10	0.10
3/29/10 3:00 AM	0.09	0.09	0.10
3/29/10 5:00 AM	0.09	0.09	0.08
3/29/10 7:00 AM	0.09	0.09	0.09
3/29/10 9:00 AM	0.08	0.08	0.09
3/29/10 11:00 AM	0.09	0.09	0.09
3/29/10 1:00 PM	0.09	0.09	0.10
3/29/10 3:00 PM	0.10	0.10	0.09
3/29/10 5:00 PM	0.10	0.10	0.09
3/29/10 7:00 PM	0.10	0.10	0.09
3/29/10 9:00 PM	0.10	0.10	0.09
3/29/10 11:00 PM	0.11	0.11	0.08
3/20/10 1:00 AM	0.11	0.11	0.08
3/30/10 3:00 AM	0.11	0.11	0.08
3/30/10 5:00 AM	0.12	0.12	0.08
3/30/10 7:00 AM	1.83	1.83	0.08
3/30/10 9:00 AM	0.10	0.10	0.08
3/30/10 11:00 AM	0.11	0.11	0.08
3/30/10 1:00 PM	0.12	0.12	0.08
3/30/10 3:00 PM	0.11	0.11	0.09
3/30/10 5:00 PM	0.12	0.12	0.10
3/30/10 7:00 PM	0.13	0.13	0.09
3/30/10 9:00 PM	0.14	0.14	0.09
3/30/10 11:00 PM	0.13	0.13	0.09
3/31/10 1:00 AM	0.10	0.10	0.08
3/31/10 3:00 AM	0.10	0.10	0.08
3/31/10 5:00 AM	0.12	0.12	0.08
3/31/10 7:00 AM	0.16	0.16	0.08
3/31/10 9:00 AM	0.15	0.15	0.08
3/31/10 11:00 AM	0.16	0.16	0.08
3/31/10 1:00 PM	0.16	0.16	0.08
3/31/10 3:00 PM	0.16	0.16	0.08
3/31/10 5:00 PM	0.17	0.17	0.08
3/31/10 7:00 PM	0.23	0.23	0.08
3/31/10 9:00 PM	0.23	0.23	0.08

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
3/31/10 11:00 PM	0.00	0.00	0.07
4/1/10 1:00 AM	0.00	0.00	0.07
4/1/10 3:00 AM	0.00	0.00	0.07
4/1/10 5:00 AM	0.00	0.00	0.07
4/1/10 7:00 AM	0.00	0.00	0.07
4/1/10 9:00 AM	0.00	0.00	0.07
4/1/10 11:00 AM	0.00	0.00	0.06
4/1/10 1:00 PM	0.00	0.00	0.06
4/1/10 3:00 PM	0.00	0.00	0.06
4/1/10 5:00 PM	0.00	0.00	0.06
4/1/10 7:00 PM	0.00	0.00	0.06
4/1/10 9:00 PM	0.00	0.00	0.24
4/1/10 11:00 PM	0.00	0.00	0.07
4/2/10 1:00 AM	0.00	0.00	0.08
4/2/10 3:00 AM	0.00	0.00	0.08
4/2/10 5:00 AM	0.00	0.00	0.08
4/2/10 7:00 AM	0.00	0.00	0.09
4/2/10 9:00 AM	0.00	0.00	0.08
4/2/10 11:00 AM	0.00	0.00	0.07
4/2/10 1:00 PM	0.00	0.00	0.07
4/2/10 3:00 PM	0.00	0.00	0.07
4/2/10 5:00 PM	0.00	0.00	0.07
4/2/10 7:00 PM	0.00	0.00	0.07
4/2/10 9:00 PM	0.00	0.00	0.08
4/2/10 11:00 PM	0.00	0.00	0.08
4/3/10 1:00 AM	0.00	0.00	0.08
4/3/10 3:00 AM	0.00	0.00	0.08
4/3/10 5:00 AM	0.00	0.00	0.08
4/3/10 7:00 AM	0.00	0.00	0.08
4/3/10 9:00 AM	0.02	0.02	0.07
4/3/10 11:00 AM	0.04	0.04	0.07
4/3/10 1:00 PM	0.08	0.08	0.08
4/3/10 3:00 PM	0.09	0.09	0.09
4/3/10 5:00 PM	0.13	0.13	0.09
4/3/10 7:00 PM	0.13	0.13	0.08
4/3/10 9:00 PM	0.12	0.12	0.07
4/3/10 11:00 PM	0.12	0.12	0.06
4/4/10 1:00 AM	0.12	0.12	0.06
4/4/10 3:00 AM	0.12	0.12	0.06
4/4/10 5:00 AM	0.12	0.12	0.06
4/4/10 7:00 AM	0.16	0.16	0.07
4/4/10 9:00 AM	0.20	0.20	0.07
4/4/10 11:00 AM	0.23	0.23	0.07
4/4/10 1:00 PM	0.20	0.20	0.07
4/4/10 3:00 PM	0.17	0.17	0.07
4/4/10 5:00 PM	0.18	0.18	0.08
4/4/10 7:00 PM	0.17	0.17	0.07
4/4/10 9:00 PM	0.20	0.20	0.07
4/4/10 11:00 PM	0.24	0.24	0.07
4/5/10 1:00 AM	0.21	0.21	0.07
4/5/10 3:00 AM	0.17	0.17	0.07
4/5/10 5:00 AM	0.20	0.20	0.08
4/5/10 7:00 AM	0.23	0.23	0.08

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
4/5/10 9:00 AM	0.21	0.21	0.08
4/5/10 11:00 AM	0.21	0.21	0.08
4/5/10 1:00 PM	0.13	0.13	0.09
4/5/10 3:00 PM	0.06	0.06	0.08
4/5/10 5:00 PM	0.13	0.13	0.08
4/5/10 7:00 PM	0.13	0.13	0.08
4/5/10 9:00 PM	0.13	0.13	0.08
4/5/10 11:00 PM	0.10	0.10	0.08
4/6/10 1:00 AM	0.08	0.08	0.08
4/6/10 3:00 AM	0.10	0.10	0.08
4/6/10 5:00 AM	0.13	0.13	0.08
4/6/10 7:00 AM	0.16	0.16	0.08
4/6/10 9:00 AM	0.19	0.19	0.07
4/6/10 11:00 AM	0.21	0.21	0.07
4/6/10 1:00 PM	0.23	0.23	0.08
4/6/10 3:00 PM	0.23	0.23	0.08
4/6/10 5:00 PM	0.23	0.23	0.08
4/6/10 7:00 PM	0.24	0.24	0.08
4/6/10 9:00 PM	0.25	0.25	0.08
4/6/10 11:00 PM	0.24	0.24	0.07
4/7/10 1:00 AM	0.20	0.20	0.04
4/7/10 3:00 AM	0.17	0.17	0.03
4/7/10 5:00 AM	0.21	0.21	0.05
4/7/10 7:00 AM	0.22	0.22	0.05
4/7/10 9:00 AM	0.22	0.22	0.07
4/7/10 11:00 AM	0.23	0.23	0.06
4/7/10 1:00 PM	0.23	0.23	0.07
4/7/10 3:00 PM	0.23	0.23	0.07
4/7/10 5:00 PM	0.23	0.23	0.07
4/7/10 7:00 PM	0.23	0.23	0.07
4/7/10 9:00 PM	0.24	0.24	0.07
4/7/10 11:00 PM	0.23	0.23	0.07
4/8/10 1:00 AM	0.23	0.23	0.06
4/8/10 3:00 AM	0.19	0.19	0.05
4/8/10 5:00 AM	0.21	0.21	0.07
4/8/10 7:00 AM	0.20	0.20	0.08
4/8/10 9:00 AM	0.19	0.19	0.07
4/8/10 11:00 AM	0.23	0.23	0.06
4/8/10 1:00 PM	0.22	0.22	0.06
4/8/10 3:00 PM	0.23	0.23	0.06
4/8/10 5:00 PM	0.23	0.23	0.05
4/8/10 7:00 PM	0.22	0.22	0.06
4/8/10 9:00 PM	0.22	0.22	0.06
4/8/10 11:00 PM	0.21	0.21	0.06
4/9/10 1:00 AM	0.20	0.20	0.07
4/9/10 3:00 AM	0.19	0.19	0.07
4/9/10 5:00 AM	0.23	0.23	0.07
4/9/10 7:00 AM	0.24	0.24	0.07
4/9/10 9:00 AM	0.24	0.24	0.07
4/9/10 11:00 AM	0.23	0.23	0.06
4/9/10 1:00 PM	0.23	0.23	0.06
4/9/10 3:00 PM	0.22	0.22	0.05
4/9/10 5:00 PM	0.22	0.22	0.05

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
4/9/10 7:00 PM	0.22	0.22	0.07
4/9/10 9:00 PM	0.22	0.22	0.07
4/9/10 11:00 PM	0.20	0.20	0.07
4/10/10 1:00 AM	0.18	0.18	0.05
4/10/10 3:00 AM	0.19	0.19	0.05
4/10/10 5:00 AM	0.18	0.18	0.06
4/10/10 7:00 AM	0.19	0.19	0.07
4/10/10 9:00 AM	0.17	0.17	0.07
4/10/10 11:00 AM	0.18	0.18	0.07
4/10/10 1:00 PM	0.19	0.19	0.06
4/10/10 3:00 PM	0.20	0.20	0.06
4/10/10 5:00 PM	0.23	0.23	0.06
4/10/10 7:00 PM	0.22	0.22	0.06
4/10/10 9:00 PM	0.20	0.20	0.07
4/10/10 11:00 PM	0.21	0.21	0.07
4/11/10 1:00 AM	0.21	0.21	0.07
4/11/10 3:00 AM	0.21	0.21	0.08
4/11/10 5:00 AM	0.22	0.22	0.07
4/11/10 7:00 AM	0.24	0.24	0.07
4/11/10 9:00 AM	0.24	0.24	0.07
4/11/10 11:00 AM	0.19	0.19	0.07
4/11/10 1:00 PM	0.19	0.19	0.06
4/11/10 3:00 PM	0.19	0.19	0.06
4/11/10 5:00 PM	0.19	0.19	0.06
4/11/10 7:00 PM	0.19	0.19	0.07
4/11/10 9:00 PM	0.21	0.21	0.07
4/11/10 11:00 PM	0.22	0.22	0.19
4/12/10 1:00 AM	0.20	0.20	0.05
4/12/10 3:00 AM	0.19	0.19	0.06
4/12/10 5:00 AM	0.20	0.20	0.07
4/12/10 7:00 AM	0.22	0.22	0.10
4/12/10 9:00 AM	0.20	0.20	0.06
4/12/10 11:00 AM	0.20	0.20	0.06
4/12/10 1:00 PM	0.18	0.18	0.06
4/12/10 3:00 PM	0.18	0.18	0.06
4/12/10 5:00 PM	0.19	0.19	0.05
4/12/10 7:00 PM	0.18	0.18	0.06
4/12/10 9:00 PM	0.19	0.19	0.07
4/12/10 11:00 PM	0.20	0.20	0.07
4/13/10 1:00 AM	0.19	0.19	0.07
4/13/10 3:00 AM	0.18	0.18	0.06
4/13/10 5:00 AM	0.21	0.21	0.07
4/13/10 7:00 AM	0.26	0.26	0.07
4/13/10 9:00 AM	0.22	0.22	0.07
4/13/10 11:00 AM	0.22	0.22	0.07
4/13/10 1:00 PM	0.23	0.23	0.07
4/13/10 3:00 PM	0.22	0.22	0.07
4/13/10 5:00 PM	0.18	0.18	0.07
4/13/10 7:00 PM	0.15	0.15	0.07
4/13/10 9:00 PM	0.13	0.13	0.08
4/13/10 11:00 PM	0.07	0.07	0.08
4/14/10 1:00 AM	0.06	0.06	0.07
4/14/10 3:00 AM	0.06	0.06	0.07

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
4/14/10 5:00 AM	0.06	0.06	0.08
4/14/10 7:00 AM	0.08	0.08	0.08
4/14/10 9:00 AM	0.14	0.14	0.11
4/14/10 11:00 AM	0.13	0.13	0.08
4/14/10 1:00 PM	0.13	0.13	0.08
4/14/10 3:00 PM	0.13	0.13	0.08
4/14/10 5:00 PM	0.14	0.14	0.08
4/14/10 7:00 PM	0.14	0.14	0.08
4/14/10 9:00 PM	0.13	0.13	0.08
4/14/10 11:00 PM	0.14	0.14	0.08
4/15/10 1:00 AM	0.14	0.14	0.09
4/15/10 3:00 AM	0.14	0.14	0.09
4/15/10 5:00 AM	0.15	0.15	0.08
4/15/10 7:00 AM	0.17	0.17	0.08
4/15/10 9:00 AM	0.18	0.18	0.08
4/15/10 11:00 AM	0.18	0.18	0.08
4/15/10 1:00 PM	0.18	0.18	0.08
4/15/10 3:00 PM	0.15	0.15	0.08
4/15/10 5:00 PM	0.05	0.05	0.08
4/15/10 7:00 PM	0.00	0.00	0.07
4/15/10 9:00 PM	0.00	0.00	0.07
4/15/10 11:00 PM	0.00	0.00	0.07
4/16/10 1:00 AM	0.00	0.00	0.07
4/16/10 3:00 AM	0.00	0.00	0.07
4/16/10 5:00 AM	0.00	0.00	0.07
4/16/10 7:00 AM	0.00	0.00	0.07
4/16/10 9:00 AM	0.00	0.00	0.07
4/16/10 11:00 AM	0.00	0.00	0.07
4/16/10 1:00 PM	0.00	0.00	0.07
4/16/10 3:00 PM	0.00	0.00	0.07
4/16/10 5:00 PM	0.00	0.00	0.07
4/16/10 7:00 PM	0.00	0.00	0.06
4/16/10 9:00 PM	0.00	0.00	0.07
4/16/10 11:00 PM	0.00	0.00	0.07
4/17/10 1:00 AM	0.00	0.00	0.07
4/17/10 3:00 AM	0.00	0.00	0.07
4/17/10 5:00 AM	0.00	0.00	0.07
4/17/10 7:00 AM	0.00	0.00	0.08
4/17/10 9:00 AM	0.00	0.00	0.07
4/17/10 11:00 AM	0.00	0.00	0.06
4/17/10 1:00 PM	0.00	0.00	0.06
4/17/10 3:00 PM	0.00	0.00	0.06
4/17/10 5:00 PM	0.00	0.00	0.07
4/17/10 7:00 PM	0.00	0.00	0.08
4/17/10 9:00 PM	0.00	0.00	0.08
4/17/10 11:00 PM	0.00	0.00	0.08
4/18/10 1:00 AM	0.09	0.09	0.08
4/18/10 3:00 AM	0.16	0.16	0.08
4/18/10 5:00 AM	0.16	0.16	0.08
4/18/10 7:00 AM	0.17	0.17	0.08
4/18/10 9:00 AM	0.17	0.17	0.09
4/18/10 11:00 AM	0.18	0.18	0.09
4/18/10 1:00 PM	0.18	0.18	0.08

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
4/18/10 3:00 PM	0.17	0.17	0.12
4/18/10 5:00 PM	0.18	0.18	0.12
4/18/10 7:00 PM	0.19	0.19	0.16
4/18/10 9:00 PM	0.40	0.40	0.19
4/18/10 11:00 PM	1.63	1.63	0.14
4/19/10 1:00 AM	0.20	0.20	0.09
4/19/10 3:00 AM	0.19	0.19	0.10
4/19/10 5:00 AM	0.19	0.19	0.11
4/19/10 7:00 AM	0.19	0.19	0.12
4/19/10 9:00 AM	0.19	0.19	0.12
4/19/10 11:00 AM	0.19	0.19	0.13
4/19/10 1:00 PM	0.20	0.20	0.14
4/19/10 3:00 PM	0.20	0.20	0.13
4/19/10 5:00 PM	0.21	0.21	0.14
4/19/10 7:00 PM	0.21	0.21	0.14
4/19/10 9:00 PM	0.21	0.21	0.14
4/19/10 11:00 PM	0.22	0.22	0.15
4/20/10 1:00 AM	0.21	0.21	0.15
4/20/10 3:00 AM	0.21	0.21	0.15
4/20/10 5:00 AM	0.21	0.21	0.15
4/20/10 7:00 AM	0.22	0.22	0.09
4/20/10 9:00 AM	0.21	0.21	0.08
4/20/10 11:00 AM	0.21	0.21	0.08
4/20/10 1:00 PM	0.21	0.21	0.08
4/20/10 3:00 PM	0.20	0.20	0.08
4/20/10 5:00 PM	0.21	0.21	0.08
4/20/10 7:00 PM	0.00	0.00	0.09
4/20/10 9:00 PM	0.00	0.00	0.09
4/20/10 11:00 PM	0.00	0.00	0.09
4/21/10 1:00 AM	0.16	0.16	0.09
4/21/10 3:00 AM	0.09	0.09	0.09
4/21/10 5:00 AM	0.11	0.11	0.10
4/21/10 7:00 AM	0.10	0.10	0.11
4/21/10 9:00 AM	0.11	0.11	0.11
4/21/10 11:00 AM	0.20	0.20	0.11
4/21/10 1:00 PM	0.23	0.23	0.11
4/21/10 3:00 PM	0.21	0.21	0.12
4/21/10 5:00 PM	0.20	0.20	0.12
4/21/10 7:00 PM	0.19	0.19	0.12
4/21/10 9:00 PM	0.18	0.18	0.08
4/21/10 11:00 PM	0.19	0.19	0.06
4/22/10 1:00 AM	0.18	0.18	0.06
4/22/10 3:00 AM	0.17	0.17	0.06
4/22/10 5:00 AM	0.18	0.18	0.06
4/22/10 7:00 AM	0.17	0.17	0.06
4/22/10 9:00 AM	0.17	0.17	0.09
4/22/10 11:00 AM	0.18	0.18	0.10
4/22/10 1:00 PM	0.17	0.17	0.11
4/22/10 3:00 PM	0.17	0.17	0.11
4/22/10 5:00 PM	0.17	0.17	0.10
4/22/10 7:00 PM	0.18	0.18	0.10
4/22/10 9:00 PM	0.18	0.18	0.09
4/22/10 11:00 PM	0.17	0.17	0.04

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
4/23/10 1:00 AM	0.16	0.16	0.04
4/23/10 3:00 AM	0.15	0.15	0.04
4/23/10 5:00 AM	0.15	0.15	0.04
4/23/10 7:00 AM	0.14	0.14	0.08
4/23/10 9:00 AM	0.14	0.14	0.10
4/23/10 11:00 AM	0.13	0.13	0.10
4/23/10 1:00 PM	0.13	0.13	0.09
4/23/10 3:00 PM	0.13	0.13	0.10
4/23/10 5:00 PM	0.14	0.14	0.10
4/23/10 7:00 PM	0.13	0.13	0.09
4/23/10 9:00 PM	0.12	0.12	0.10
4/23/10 11:00 PM	0.12	0.12	0.05
4/24/10 1:00 AM	0.12	0.12	0.06
4/24/10 3:00 AM	0.13	0.13	0.07
4/24/10 5:00 AM	0.15	0.15	0.07
4/24/10 7:00 AM	0.17	0.17	0.06
4/24/10 9:00 AM	0.21	0.21	0.07
4/24/10 11:00 AM	0.18	0.18	0.08
4/24/10 1:00 PM	0.21	0.21	0.14
4/24/10 3:00 PM	0.21	0.21	0.15
4/24/10 5:00 PM	0.22	0.22	0.15
4/24/10 7:00 PM	0.23	0.23	0.15
4/24/10 9:00 PM	0.24	0.24	0.15
4/24/10 11:00 PM	0.23	0.23	0.13
4/25/10 1:00 AM	0.22	0.22	0.06
4/25/10 3:00 AM	0.22	0.22	0.06
4/25/10 5:00 AM	0.21	0.21	0.06
4/25/10 7:00 AM	0.23	0.23	0.07
4/25/10 9:00 AM	0.20	0.20	0.15
4/25/10 11:00 AM	0.20	0.20	0.17
4/25/10 1:00 PM	0.19	0.19	0.17
4/25/10 3:00 PM	0.19	0.19	0.17
4/25/10 5:00 PM	0.20	0.20	0.16
4/25/10 7:00 PM	0.20	0.20	0.15
4/25/10 9:00 PM	0.20	0.20	0.14
4/25/10 11:00 PM	0.21	0.21	0.13
4/26/10 1:00 AM	0.20	0.20	0.12
4/26/10 3:00 AM	0.21	0.21	0.09
4/26/10 5:00 AM	0.22	0.22	0.13
4/26/10 7:00 AM	0.22	0.22	0.13
4/26/10 9:00 AM	0.21	0.21	0.13
4/26/10 11:00 AM	0.16	0.16	0.12
4/26/10 1:00 PM	0.10	0.10	0.12
4/26/10 3:00 PM	0.19	0.19	0.12
4/26/10 5:00 PM	0.20	0.20	0.11
4/26/10 7:00 PM	0.19	0.19	0.12
4/26/10 9:00 PM	0.22	0.22	0.15
4/26/10 11:00 PM	0.10	0.10	0.11
4/27/10 1:00 AM	0.13	0.13	0.12
4/27/10 3:00 AM	0.12	0.12	0.12
4/27/10 5:00 AM	0.19	0.19	0.14
4/27/10 7:00 AM	0.22	0.22	0.20
4/27/10 9:00 AM	0.18	0.18	0.19

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
4/27/10 11:00 AM	0.12	0.12	0.20
4/27/10 1:00 PM	0.06	0.06	0.20
4/27/10 3:00 PM	0.05	0.05	0.19
4/27/10 5:00 PM	0.11	0.11	0.19
4/27/10 7:00 PM	0.16	0.16	0.17
4/27/10 9:00 PM	0.16	0.16	0.15
4/27/10 11:00 PM	0.15	0.15	0.10
4/28/10 1:00 AM	0.11	0.11	0.11
4/28/10 3:00 AM	0.11	0.11	0.12
4/28/10 5:00 AM	0.13	0.13	0.12
4/28/10 7:00 AM	0.16	0.16	0.11
4/28/10 9:00 AM	0.18	0.18	0.11
4/28/10 11:00 AM	0.17	0.17	0.11
4/28/10 1:00 PM	0.17	0.17	0.09
4/28/10 3:00 PM	0.18	0.18	0.10
4/28/10 5:00 PM	0.17	0.17	0.13
4/28/10 7:00 PM	0.17	0.17	0.13
4/28/10 9:00 PM	0.16	0.16	0.15
4/28/10 11:00 PM	0.15	0.15	0.15
4/29/10 1:00 AM	0.18	0.18	0.13
4/29/10 3:00 AM	0.18	0.18	0.11
4/29/10 5:00 AM	0.19	0.19	0.16
4/29/10 7:00 AM	0.21	0.21	0.16
4/29/10 9:00 AM	0.18	0.18	0.15
4/29/10 11:00 AM	0.20	0.20	0.15
4/29/10 1:00 PM	0.20	0.20	0.15
4/29/10 3:00 PM	0.20	0.20	0.14
4/29/10 5:00 PM	0.20	0.20	0.14
4/29/10 7:00 PM	0.20	0.20	0.14
4/29/10 9:00 PM	0.20	0.20	0.14
4/29/10 11:00 PM	0.21	0.21	0.13
4/30/10 1:00 AM	0.20	0.20	0.10
4/30/10 3:00 AM	0.20	0.20	0.10
4/30/10 5:00 AM	0.21	0.21	0.12
4/30/10 7:00 AM	0.22	0.22	0.15
4/30/10 9:00 AM	0.23	0.23	0.15
4/30/10 11:00 AM	0.21	0.21	0.15
4/30/10 1:00 PM	0.18	0.18	0.16
4/30/10 3:00 PM	0.17	0.17	0.15
4/30/10 5:00 PM	0.17	0.17	0.14
4/30/10 7:00 PM	0.16	0.16	0.13
4/30/10 9:00 PM	0.16	0.16	0.13
4/30/10 11:00 PM	0.16	0.16	0.14
5/1/10 1:00 AM	0.16	0.16	0.13
5/1/10 3:00 AM	0.16	0.16	0.10
5/1/10 5:00 AM	0.16	0.16	0.11
5/1/10 7:00 AM	0.18	0.18	0.14
5/1/10 9:00 AM	0.21	0.21	0.13
5/1/10 11:00 AM	0.23	0.23	0.13
5/1/10 1:00 PM	0.22	0.22	0.12
5/1/10 3:00 PM	0.22	0.22	0.12
5/1/10 5:00 PM	0.22	0.22	0.12
5/1/10 7:00 PM	0.21	0.21	0.12

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
5/1/10 9:00 PM	0.21	0.21	0.12
5/1/10 11:00 PM	0.21	0.21	0.12
5/2/10 1:00 AM	0.21	0.21	0.12
5/2/10 3:00 AM	0.21	0.21	0.12
5/2/10 5:00 AM	0.18	0.18	0.12
5/2/10 7:00 AM	0.13	0.13	0.11
5/2/10 9:00 AM	0.14	0.14	0.12
5/2/10 11:00 AM	0.14	0.14	0.11
5/2/10 1:00 PM	0.13	0.13	0.11
5/2/10 3:00 PM	0.15	0.15	0.11
5/2/10 5:00 PM	0.16	0.16	0.12
5/2/10 7:00 PM	0.16	0.16	0.12
5/2/10 9:00 PM	0.10	0.10	0.11
5/2/10 11:00 PM	0.16	0.16	0.11
5/3/10 1:00 AM	0.16	0.16	0.11
5/3/10 3:00 AM	0.16	0.16	0.11
5/3/10 5:00 AM	0.17	0.17	0.11
5/3/10 7:00 AM	0.18	0.18	0.11
5/3/10 9:00 AM	0.17	0.17	0.11
5/3/10 11:00 AM	0.17	0.17	0.11
5/3/10 1:00 PM	0.16	0.16	0.11
5/3/10 3:00 PM	0.16	0.16	0.12
5/3/10 5:00 PM	0.16	0.16	0.08
5/3/10 7:00 PM	0.16	0.16	0.08
5/3/10 9:00 PM	0.16	0.16	0.09
5/3/10 11:00 PM	0.16	0.16	0.09
5/4/10 1:00 AM	0.17	0.17	0.09
5/4/10 3:00 AM	0.16	0.16	0.09
5/4/10 5:00 AM	0.17	0.17	0.08
5/4/10 7:00 AM	0.22	0.22	0.08
5/4/10 9:00 AM	0.21	0.21	0.08
5/4/10 11:00 AM	0.20	0.20	0.07
5/4/10 1:00 PM	0.20	0.20	0.07
5/4/10 3:00 PM	0.24	0.24	0.07
5/4/10 5:00 PM	0.21	0.21	0.06
5/4/10 7:00 PM	0.28	0.28	0.06
5/4/10 9:00 PM	0.23	0.23	0.06
5/4/10 11:00 PM	0.19	0.19	0.06
5/5/10 1:00 AM	0.19	0.19	0.06
5/5/10 3:00 AM	0.20	0.20	0.06
5/5/10 5:00 AM	0.21	0.21	0.06
5/5/10 7:00 AM	0.29	0.29	0.06
5/5/10 9:00 AM	0.28	0.28	0.06
5/5/10 11:00 AM	0.26	0.26	0.05
5/5/10 1:00 PM	0.19	0.19	0.05
5/5/10 3:00 PM	0.21	0.21	0.06
5/5/10 5:00 PM	0.14	0.14	0.05
5/5/10 7:00 PM	0.14	0.14	0.04
5/5/10 9:00 PM	0.12	0.12	0.05
5/5/10 11:00 PM	0.13	0.13	0.05
5/6/10 1:00 AM	0.12	0.12	0.06
5/6/10 3:00 AM	0.12	0.12	0.06
5/6/10 5:00 AM	0.11	0.11	0.06

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
5/6/10 7:00 AM	0.11	0.11	0.06
5/6/10 9:00 AM	0.10	0.10	0.07
5/6/10 11:00 AM	0.12	0.12	0.07
5/6/10 1:00 PM	0.18	0.18	0.08
5/6/10 3:00 PM	0.18	0.18	0.08
5/6/10 5:00 PM	0.18	0.18	0.07
5/6/10 7:00 PM	0.19	0.19	0.07
5/6/10 9:00 PM	0.19	0.19	0.06
5/6/10 11:00 PM	0.19	0.19	0.04
5/7/10 1:00 AM	0.19	0.19	0.04
5/7/10 3:00 AM	0.19	0.19	0.04
5/7/10 5:00 AM	0.19	0.19	0.07
5/7/10 7:00 AM	0.19	0.19	0.07
5/7/10 9:00 AM	0.19	0.19	0.07
5/7/10 11:00 AM	0.20	0.20	0.07
5/7/10 1:00 PM	0.20	0.20	0.07
5/7/10 3:00 PM	0.20	0.20	0.07
5/7/10 5:00 PM	0.21	0.21	0.07
5/7/10 7:00 PM	0.20	0.20	0.05
5/7/10 9:00 PM	0.20	0.20	0.05
5/7/10 11:00 PM	0.14	0.14	0.05
5/8/10 1:00 AM	0.13	0.13	0.05
5/8/10 3:00 AM	0.12	0.12	0.05
5/8/10 5:00 AM	0.14	0.14	0.05
5/8/10 7:00 AM	0.19	0.19	0.06
5/8/10 9:00 AM	0.16	0.16	0.06
5/8/10 11:00 AM	0.16	0.16	0.06
5/8/10 1:00 PM	0.15	0.15	0.06
5/8/10 3:00 PM	0.19	0.19	0.06
5/8/10 5:00 PM	0.18	0.18	0.06
5/8/10 7:00 PM	0.19	0.19	0.06
5/8/10 9:00 PM	0.18	0.18	0.07
5/8/10 11:00 PM	0.16	0.16	0.06
5/9/10 1:00 AM	0.14	0.14	0.05
5/9/10 3:00 AM	0.13	0.13	0.06
5/9/10 5:00 AM	0.13	0.13	0.06
5/9/10 7:00 AM	0.18	0.18	0.06
5/9/10 9:00 AM	0.18	0.18	0.06
5/9/10 11:00 AM	0.18	0.18	0.06
5/9/10 1:00 PM	0.18	0.18	0.06
5/9/10 3:00 PM	0.18	0.18	0.06
5/9/10 5:00 PM	0.18	0.18	0.06
5/9/10 7:00 PM	0.17	0.17	0.06
5/9/10 9:00 PM	0.16	0.16	0.06
5/9/10 11:00 PM	0.14	0.14	0.06
5/10/10 1:00 AM	0.12	0.12	0.05
5/10/10 3:00 AM	0.12	0.12	0.04
5/10/10 5:00 AM	0.14	0.14	0.05
5/10/10 7:00 AM	0.15	0.15	0.07
5/10/10 9:00 AM	0.15	0.15	0.06
5/10/10 11:00 AM	0.17	0.17	0.07
5/10/10 1:00 PM	0.18	0.18	0.07
5/10/10 3:00 PM	0.17	0.17	0.07

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
5/10/10 5:00 PM	0.17	0.17	0.07
5/10/10 7:00 PM	0.17	0.17	0.08
5/10/10 9:00 PM	0.17	0.17	0.08
5/10/10 11:00 PM	0.17	0.17	0.08
5/11/10 1:00 AM	0.17	0.17	0.08
5/11/10 3:00 AM	0.14	0.14	0.08
5/11/10 5:00 AM	0.17	0.17	0.08
5/11/10 7:00 AM	0.18	0.18	0.08
5/11/10 9:00 AM	0.19	0.19	0.07
5/11/10 11:00 AM	0.19	0.19	0.07
5/11/10 1:00 PM	0.20	0.20	0.07
5/11/10 3:00 PM	0.20	0.20	0.07
5/11/10 5:00 PM	0.20	0.20	0.07
5/11/10 7:00 PM	0.20	0.20	0.07
5/11/10 9:00 PM	0.19	0.19	0.08
5/11/10 11:00 PM	0.17	0.17	0.08
5/12/10 1:00 AM	0.17	0.17	0.08
5/12/10 3:00 AM	0.15	0.15	0.08
5/12/10 5:00 AM	0.11	0.11	0.08
5/12/10 7:00 AM	0.11	0.11	0.08
5/12/10 9:00 AM	0.11	0.11	0.08
5/12/10 11:00 AM	0.11	0.11	0.08
5/12/10 1:00 PM	0.12	0.12	0.08
5/12/10 3:00 PM	0.13	0.13	0.08
5/12/10 5:00 PM	0.13	0.13	0.08
5/12/10 7:00 PM	0.13	0.13	0.08
5/12/10 9:00 PM	0.11	0.11	0.08
5/12/10 11:00 PM	0.10	0.10	0.06
5/13/10 1:00 AM	0.10	0.10	0.05
5/13/10 3:00 AM	0.10	0.10	0.05
5/13/10 5:00 AM	0.10	0.10	0.06
5/13/10 7:00 AM	0.11	0.11	0.09
5/13/10 9:00 AM	0.10	0.10	0.09
5/13/10 11:00 AM	0.09	0.09	0.09
5/13/10 1:00 PM	0.10	0.10	0.09
5/13/10 3:00 PM	0.15	0.15	0.09
5/13/10 5:00 PM	0.10	0.10	0.09
5/13/10 7:00 PM	0.09	0.09	0.09
5/13/10 9:00 PM	0.10	0.10	0.10
5/13/10 11:00 PM	0.10	0.10	0.07
5/14/10 1:00 AM	0.10	0.10	0.05
5/14/10 3:00 AM	0.10	0.10	0.05
5/14/10 5:00 AM	0.10	0.10	0.06
5/14/10 7:00 AM	0.09	0.09	0.11
5/14/10 9:00 AM	0.10	0.10	0.10
5/14/10 11:00 AM	0.09	0.09	0.11
5/14/10 1:00 PM	0.09	0.09	0.12
5/14/10 3:00 PM	0.09	0.09	0.10
5/14/10 5:00 PM	0.10	0.10	0.10
5/14/10 7:00 PM	0.09	0.09	0.11
5/14/10 9:00 PM	0.09	0.09	0.11
5/14/10 11:00 PM	0.09	0.09	0.11
5/15/10 1:00 AM	0.09	0.09	0.11

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
5/15/10 3:00 AM	0.10	0.10	0.11
5/15/10 5:00 AM	0.10	0.10	0.11
5/15/10 7:00 AM	0.10	0.10	0.11
5/15/10 9:00 AM	0.10	0.10	0.11
5/15/10 11:00 AM	0.10	0.10	0.11
5/15/10 1:00 PM	0.09	0.09	0.11
5/15/10 3:00 PM	0.09	0.09	0.11
5/15/10 5:00 PM	0.10	0.10	0.11
5/15/10 7:00 PM	0.10	0.10	0.11
5/15/10 9:00 PM	0.10	0.10	0.10
5/15/10 11:00 PM	0.10	0.10	0.10
5/16/10 1:00 AM	0.10	0.10	0.09
5/16/10 3:00 AM	0.10	0.10	0.09
5/16/10 5:00 AM	0.10	0.10	0.09
5/16/10 7:00 AM	0.10	0.10	0.10
5/16/10 9:00 AM	0.09	0.09	0.09
5/16/10 11:00 AM	0.09	0.09	0.09
5/16/10 1:00 PM	0.09	0.09	0.10
5/16/10 3:00 PM	0.08	0.08	0.10
5/16/10 5:00 PM	0.09	0.09	0.10
5/16/10 7:00 PM	0.13	0.13	0.10
5/16/10 9:00 PM	0.21	0.21	0.09
5/16/10 11:00 PM	0.15	0.15	0.09
5/17/10 1:00 AM	0.11	0.11	0.09
5/17/10 3:00 AM	0.20	0.20	0.09
5/17/10 5:00 AM	0.18	0.18	0.09
5/17/10 7:00 AM	0.22	0.22	0.09
5/17/10 9:00 AM	0.19	0.19	0.09
5/17/10 11:00 AM	0.16	0.16	0.10
5/17/10 1:00 PM	0.15	0.15	0.08
5/17/10 3:00 PM	0.14	0.14	0.08
5/17/10 5:00 PM	0.18	0.18	0.08
5/17/10 7:00 PM	0.20	0.20	0.08
5/17/10 9:00 PM	0.19	0.19	0.08
5/17/10 11:00 PM	0.18	0.18	0.08
5/18/10 1:00 AM	0.18	0.18	0.08
5/18/10 3:00 AM	0.19	0.19	0.08
5/18/10 5:00 AM	0.20	0.20	0.08
5/18/10 7:00 AM	0.19	0.19	0.08
5/18/10 9:00 AM	0.19	0.19	0.07
5/18/10 11:00 AM	0.20	0.20	0.08
5/18/10 1:00 PM	0.20	0.20	0.08
5/18/10 3:00 PM	0.20	0.20	0.08
5/18/10 5:00 PM	0.20	0.20	0.08
5/18/10 7:00 PM	0.18	0.18	0.07
5/18/10 9:00 PM	0.19	0.19	0.06
5/18/10 11:00 PM	0.19	0.19	0.06
5/19/10 1:00 AM	0.16	0.16	0.12
5/19/10 3:00 AM	0.14	0.14	0.13
5/19/10 5:00 AM	0.18	0.18	0.12
5/19/10 7:00 AM	0.19	0.19	0.13
5/19/10 9:00 AM	0.19	0.19	0.13
5/19/10 11:00 AM	0.18	0.18	0.16

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
5/19/10 1:00 PM	0.19	0.19	0.25
5/19/10 3:00 PM	0.17	0.17	0.12
5/19/10 5:00 PM	0.18	0.18	0.16
5/19/10 7:00 PM	0.20	0.20	0.15
5/19/10 9:00 PM	0.19	0.19	0.08
5/19/10 11:00 PM	0.20	0.20	0.17
5/20/10 1:00 AM	0.20	0.20	0.23
5/20/10 3:00 AM	0.18	0.18	0.24
5/20/10 5:00 AM	0.21	0.21	0.18
5/20/10 7:00 AM	0.21	0.21	0.19
5/20/10 9:00 AM	0.19	0.19	0.10
5/20/10 11:00 AM	0.19	0.19	0.09
5/20/10 1:00 PM	0.18	0.18	0.09
5/20/10 3:00 PM	0.18	0.18	0.09
5/20/10 5:00 PM	0.21	0.21	0.10
5/20/10 7:00 PM	0.22	0.22	0.10
5/20/10 9:00 PM	0.21	0.21	0.10
5/20/10 11:00 PM	0.21	0.21	0.12
5/21/10 1:00 AM	0.19	0.19	0.10
5/21/10 3:00 AM	0.17	0.17	0.09
5/21/10 5:00 AM	0.20	0.20	0.09
5/21/10 7:00 AM	0.21	0.21	0.09
5/21/10 9:00 AM	0.20	0.20	0.09
5/21/10 11:00 AM	0.21	0.21	0.08
5/21/10 1:00 PM	0.20	0.20	0.07
5/21/10 3:00 PM	0.20	0.20	0.07
5/21/10 5:00 PM	0.20	0.20	0.07
5/21/10 7:00 PM	0.23	0.23	0.07
5/21/10 9:00 PM	0.21	0.21	0.07
5/21/10 11:00 PM	0.20	0.20	0.07
5/22/10 1:00 AM	0.19	0.19	0.06
5/22/10 3:00 AM	0.16	0.16	0.06
5/22/10 5:00 AM	0.18	0.18	0.06
5/22/10 7:00 AM	0.18	0.18	0.07
5/22/10 9:00 AM	0.21	0.21	0.08
5/22/10 11:00 AM	0.20	0.20	0.08
5/22/10 1:00 PM	0.19	0.19	0.08
5/22/10 3:00 PM	0.20	0.20	0.08
5/22/10 5:00 PM	0.20	0.20	0.08
5/22/10 7:00 PM	0.19	0.19	0.08
5/22/10 9:00 PM	0.18	0.18	0.06
5/22/10 11:00 PM	0.18	0.18	0.02
5/23/10 1:00 AM	0.16	0.00	0.02
5/23/10 3:00 AM	0.19	0.00	0.03
5/23/10 5:00 AM	0.17	0.00	0.02
5/23/10 7:00 AM	0.18	0.00	0.05
5/23/10 9:00 AM	0.19	0.00	0.06
5/23/10 11:00 AM	0.17	0.00	0.06
5/23/10 1:00 PM	0.16	0.00	0.06
5/23/10 3:00 PM	0.17	0.00	0.06
5/23/10 5:00 PM	0.19	0.00	0.06
5/23/10 7:00 PM	0.15	0.00	0.06
5/23/10 9:00 PM	0.15	0.00	0.06

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
5/23/10 11:00 PM	0.20	0.00	0.06
5/24/10 1:00 AM	0.14	0.00	0.06
5/24/10 3:00 AM	0.15	0.00	0.06
5/24/10 5:00 AM	0.14	0.00	0.07
5/24/10 7:00 AM	0.19	0.00	0.07
5/24/10 9:00 AM	0.16	0.00	0.06
5/24/10 11:00 AM	0.16	0.00	0.06
5/24/10 1:00 PM	0.18	0.00	0.06
5/24/10 3:00 PM	0.16	0.00	0.06
5/24/10 5:00 PM	0.13	0.00	0.06
5/24/10 7:00 PM	0.11	0.00	0.06
5/24/10 9:00 PM	0.11	0.00	0.06
5/24/10 11:00 PM	0.10	0.00	0.06
5/25/10 1:00 AM	0.11	0.00	0.06
5/25/10 3:00 AM	0.11	0.00	0.06
5/25/10 5:00 AM	0.10	0.00	0.06
5/25/10 7:00 AM	0.10	0.00	0.06
5/25/10 9:00 AM	0.11	0.00	0.06
5/25/10 11:00 AM	0.11	0.00	0.06
5/25/10 1:00 PM	0.09	0.00	0.06
5/25/10 3:00 PM	0.08	0.00	0.06
5/25/10 5:00 PM	0.08	0.00	0.06
5/25/10 7:00 PM	0.09	0.00	0.06
5/25/10 9:00 PM	0.10	0.00	0.06
5/25/10 11:00 PM	0.09	0.00	0.06
5/26/10 1:00 AM	0.11	0.00	0.06
5/26/10 3:00 AM	0.11	0.00	0.06
5/26/10 5:00 AM	0.09	0.00	0.06
5/26/10 7:00 AM	0.09	0.00	0.06
5/26/10 9:00 AM	0.09	0.00	0.06
5/26/10 11:00 AM	0.12	0.00	0.06
5/26/10 1:00 PM	0.10	0.00	0.05
5/26/10 3:00 PM	0.10	0.00	0.06
5/26/10 5:00 PM	0.10	0.00	0.06
5/26/10 7:00 PM	0.08	0.00	0.06
5/26/10 9:00 PM	0.09	0.00	0.06
5/26/10 11:00 PM	0.09	0.00	0.06
5/27/10 1:00 AM	0.08	0.00	0.07
5/27/10 3:00 AM	0.09	0.00	0.07
5/27/10 5:00 AM	0.08	0.00	0.07
5/27/10 7:00 AM	0.08	0.00	0.07
5/27/10 9:00 AM	0.08	0.00	0.07
5/27/10 11:00 AM	0.08	0.00	0.07
5/27/10 1:00 PM	0.08	0.00	0.07
5/27/10 3:00 PM	0.08	0.00	0.07
5/27/10 5:00 PM	0.08	0.00	0.07
5/27/10 7:00 PM	0.07	0.00	0.07
5/27/10 9:00 PM	0.08	0.00	0.07
5/27/10 11:00 PM	0.07	0.00	0.07
5/28/10 1:00 AM	0.07	0.00	0.07
5/28/10 3:00 AM	0.07	0.00	0.07
5/28/10 5:00 AM	0.07	0.00	0.07
5/28/10 7:00 AM	0.07	0.00	0.07

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
5/28/10 9:00 AM	0.07	0.00	0.07
5/28/10 11:00 AM	0.07	0.00	0.07
5/28/10 1:00 PM	0.07	0.00	0.07
5/28/10 3:00 PM	0.07	0.00	0.08
5/28/10 5:00 PM	0.07	0.00	0.06
5/28/10 7:00 PM	0.07	0.00	0.07
5/28/10 9:00 PM	0.07	0.00	0.08
5/28/10 11:00 PM	0.07	0.00	0.07
5/29/10 1:00 AM	0.06	0.00	0.08
5/29/10 3:00 AM	0.06	0.00	0.08
5/29/10 5:00 AM	0.07	0.00	0.08
5/29/10 7:00 AM	0.07	0.00	0.09
5/29/10 9:00 AM	0.07	0.00	0.09
5/29/10 11:00 AM	0.07	0.00	0.11
5/29/10 1:00 PM	0.07	0.00	0.12
5/29/10 3:00 PM	0.07	0.00	0.13
5/29/10 5:00 PM	0.07	0.00	0.12
5/29/10 7:00 PM	0.07	0.00	0.11
5/29/10 9:00 PM	0.06	0.00	0.11
5/29/10 11:00 PM	0.06	0.00	0.11
5/30/10 1:00 AM	0.06	0.00	0.11
5/30/10 3:00 AM	0.06	0.00	0.11
5/30/10 5:00 AM	0.07	0.00	0.11
5/30/10 7:00 AM	0.07	0.00	0.11
5/30/10 9:00 AM	0.07	0.00	0.11
5/30/10 11:00 AM	0.07	0.00	0.11
5/30/10 1:00 PM	0.07	0.00	0.10
5/30/10 3:00 PM	0.07	0.00	0.11
5/30/10 5:00 PM	0.07	0.00	0.11
5/30/10 7:00 PM	0.07	0.00	0.10
5/30/10 9:00 PM	0.07	0.00	0.07
5/30/10 11:00 PM	0.07	0.00	0.09
5/31/10 1:00 AM	0.07	0.00	0.10
5/31/10 3:00 AM	0.07	0.00	0.12
5/31/10 5:00 AM	0.08	0.00	0.12
5/31/10 7:00 AM	0.07	0.00	0.11
5/31/10 9:00 AM	0.07	0.00	0.12
5/31/10 11:00 AM	0.07	0.00	0.12
5/31/10 1:00 PM	0.07	0.00	0.12
5/31/10 3:00 PM	0.08	0.00	0.12
5/31/10 5:00 PM	0.07	0.00	0.12
5/31/10 7:00 PM	0.08	0.00	0.12
5/31/10 9:00 PM	0.07	0.00	0.12
5/31/10 11:00 PM	0.08	0.00	0.11
6/1/10 1:00 AM	0.07	0.00	0.11
6/1/10 3:00 AM	0.07	0.00	0.11
6/1/10 5:00 AM	0.09	0.00	0.10
6/1/10 7:00 AM	0.15	0.00	0.10
6/1/10 9:00 AM	0.15	0.00	0.10
6/1/10 11:00 AM	0.20	0.00	0.07
6/1/10 1:00 PM	0.21	0.00	0.06
6/1/10 3:00 PM	0.22	0.00	0.06
6/1/10 5:00 PM	0.19	0.00	0.06

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
6/1/10 7:00 PM	0.19	0.00	0.06
6/1/10 9:00 PM	0.18	0.00	0.06
6/1/10 11:00 PM	0.18	0.00	0.06
6/2/10 1:00 AM	0.18	0.18	0.06
6/2/10 3:00 AM	0.18	0.18	0.06
6/2/10 5:00 AM	0.17	0.17	0.05
6/2/10 7:00 AM	0.17	0.17	0.06
6/2/10 9:00 AM	0.17	0.17	0.06
6/2/10 11:00 AM	0.17	0.00	0.06
6/2/10 1:00 PM	0.18	0.00	0.06
6/2/10 3:00 PM	0.23	0.00	0.07
6/2/10 5:00 PM	0.23	0.00	0.11
6/2/10 7:00 PM	0.24	0.00	0.07
6/2/10 9:00 PM	0.23	0.00	0.07
6/2/10 11:00 PM	0.22	0.00	0.04
6/3/10 1:00 AM	0.22	0.00	0.04
6/3/10 3:00 AM	0.22	0.00	0.04
6/3/10 5:00 AM	0.22	0.00	0.04
6/3/10 7:00 AM	0.22	0.00	0.07
6/3/10 9:00 AM	0.20	0.00	0.08
6/3/10 11:00 AM	0.19	0.00	0.09
6/3/10 1:00 PM	0.19	0.00	0.08
6/3/10 3:00 PM	0.20	0.00	0.08
6/3/10 5:00 PM	0.20	0.20	0.08
6/3/10 7:00 PM	0.20	0.20	0.08
6/3/10 9:00 PM	0.18	0.18	0.08
6/3/10 11:00 PM	0.18	0.18	0.08
6/4/10 1:00 AM	0.18	0.18	0.08
6/4/10 3:00 AM	0.19	0.19	0.08
6/4/10 5:00 AM	0.18	0.18	0.07
6/4/10 7:00 AM	0.18	0.18	0.07
6/4/10 9:00 AM	0.20	0.20	0.07
6/4/10 11:00 AM	0.20	0.20	0.07
6/4/10 1:00 PM	0.20	0.20	0.08
6/4/10 3:00 PM	0.21	0.21	0.08
6/4/10 5:00 PM	0.21	0.21	0.07
6/4/10 7:00 PM	0.21	0.21	0.07
6/4/10 9:00 PM	0.20	0.20	0.07
6/4/10 11:00 PM	0.20	0.20	0.07
6/5/10 1:00 AM	0.19	0.19	0.13
6/5/10 3:00 AM	0.20	0.20	0.12
6/5/10 5:00 AM	0.21	0.21	0.07
6/5/10 7:00 AM	0.22	0.22	0.08
6/5/10 9:00 AM	0.20	0.20	0.08
6/5/10 11:00 AM	0.21	0.21	0.08
6/5/10 1:00 PM	0.21	0.21	0.09
6/5/10 3:00 PM	0.22	0.22	0.09
6/5/10 5:00 PM	0.22	0.22	0.09
6/5/10 7:00 PM	0.21	0.21	0.09
6/5/10 9:00 PM	0.22	0.22	0.08
6/5/10 11:00 PM	0.22	0.22	0.08
6/6/10 1:00 AM	0.17	0.17	0.07
6/6/10 3:00 AM	0.09	0.09	0.07

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
6/6/10 5:00 AM	0.12	0.12	0.07
6/6/10 7:00 AM	0.15	0.15	0.07
6/6/10 9:00 AM	0.22	0.22	0.07
6/6/10 11:00 AM	0.22	0.22	0.08
6/6/10 1:00 PM	0.22	0.22	0.07
6/6/10 3:00 PM	0.22	0.22	0.06
6/6/10 5:00 PM	0.22	0.22	0.06
6/6/10 7:00 PM	0.22	0.22	0.06
6/6/10 9:00 PM	0.21	0.21	0.06
6/6/10 11:00 PM	0.22	0.22	0.06
6/7/10 1:00 AM	0.22	0.22	0.06
6/7/10 3:00 AM	0.22	0.22	0.06
6/7/10 5:00 AM	0.22	0.22	0.06
6/7/10 7:00 AM	0.23	0.23	0.06
6/7/10 9:00 AM	0.22	0.22	0.06
6/7/10 11:00 AM	0.22	0.22	0.06
6/7/10 1:00 PM	0.20	0.20	0.06
6/7/10 3:00 PM	0.20	0.20	0.07
6/7/10 5:00 PM	0.21	0.21	0.07
6/7/10 7:00 PM	0.21	0.21	0.07
6/7/10 9:00 PM	0.21	0.21	0.07
6/7/10 11:00 PM	0.21	0.21	0.07
6/8/10 1:00 AM	0.21	0.21	0.06
6/8/10 3:00 AM	0.21	0.21	0.05
6/8/10 5:00 AM	0.21	0.21	0.06
6/8/10 7:00 AM	0.23	0.23	0.06
6/8/10 9:00 AM	0.23	0.23	0.06
6/8/10 11:00 AM	0.25	0.25	0.07
6/8/10 1:00 PM	0.23	0.23	0.06
6/8/10 3:00 PM	0.24	0.24	0.07
6/8/10 5:00 PM	0.25	0.25	0.07
6/8/10 7:00 PM	0.23	0.23	0.07
6/8/10 9:00 PM	0.22	0.22	0.07
6/8/10 11:00 PM	0.23	0.23	0.07
6/9/10 1:00 AM	0.22	0.22	0.07
6/9/10 3:00 AM	0.22	0.22	0.07
6/9/10 5:00 AM	0.22	0.22	0.06
6/9/10 7:00 AM	0.20	0.20	0.06
6/9/10 9:00 AM	0.10	0.10	0.65
6/9/10 11:00 AM	0.10	0.10	0.55
6/9/10 1:00 PM	0.09	0.09	0.10
6/9/10 3:00 PM	0.10	0.10	0.08
6/9/10 5:00 PM	0.10	0.10	0.09
6/9/10 7:00 PM	0.10	0.10	0.09
6/9/10 9:00 PM	0.06	0.06	0.09
6/9/10 11:00 PM	0.08	0.08	0.08
6/10/10 1:00 AM	0.10	0.10	0.08
6/10/10 3:00 AM	0.10	0.10	0.08
6/10/10 5:00 AM	0.10	0.10	0.08
6/10/10 7:00 AM	0.11	0.11	0.08
6/10/10 9:00 AM	0.10	0.10	0.08
6/10/10 11:00 AM	0.10	0.10	0.08
6/10/10 1:00 PM	0.11	0.11	0.09

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
6/10/10 3:00 PM	0.11	0.11	0.09
6/10/10 5:00 PM	0.12	0.12	0.09
6/10/10 7:00 PM	0.12	0.12	0.08
6/10/10 9:00 PM	0.13	0.13	0.07
6/10/10 11:00 PM	0.13	0.13	0.07
6/11/10 1:00 AM	0.14	0.14	0.06
6/11/10 3:00 AM	0.14	0.14	0.06
6/11/10 5:00 AM	0.15	0.15	0.05
6/11/10 7:00 AM	0.14	0.14	0.08
6/11/10 9:00 AM	0.13	0.13	0.09
6/11/10 11:00 AM	0.12	0.12	0.08
6/11/10 1:00 PM	0.12	0.12	0.08
6/11/10 3:00 PM	0.11	0.11	0.08
6/11/10 5:00 PM	0.11	0.11	0.08
6/11/10 7:00 PM	0.11	0.11	0.08
6/11/10 9:00 PM	0.11	0.11	0.07
6/11/10 11:00 PM	0.11	0.11	0.07
6/12/10 1:00 AM	0.11	0.11	0.07
6/12/10 3:00 AM	0.11	0.11	0.07
6/12/10 5:00 AM	0.11	0.11	0.07
6/12/10 7:00 AM	0.11	0.11	0.07
6/12/10 9:00 AM	0.11	0.11	0.06
6/12/10 11:00 AM	0.10	0.10	0.07
6/12/10 1:00 PM	0.10	0.10	0.07
6/12/10 3:00 PM	0.10	0.10	0.07
6/12/10 5:00 PM	0.10	0.10	0.07
6/12/10 7:00 PM	0.10	0.10	0.08
6/12/10 9:00 PM	0.10	0.10	0.08
6/12/10 11:00 PM	0.10	0.10	0.09
6/13/10 1:00 AM	0.10	0.10	0.10
6/13/10 3:00 AM	0.09	0.09	0.09
6/13/10 5:00 AM	0.10	0.10	0.09
6/13/10 7:00 AM	0.10	0.10	0.09
6/13/10 9:00 AM	0.10	0.10	0.08
6/13/10 11:00 AM	0.10	0.10	0.09
6/13/10 1:00 PM	0.10	0.10	0.10
6/13/10 3:00 PM	0.10	0.10	0.10
6/13/10 5:00 PM	0.10	0.10	0.11
6/13/10 7:00 PM	0.10	0.10	0.12
6/13/10 9:00 PM	0.10	0.10	0.15
6/13/10 11:00 PM	0.10	0.10	0.12
6/14/10 1:00 AM	0.10	0.10	0.18
6/14/10 3:00 AM	0.10	0.10	0.19
6/14/10 5:00 AM	0.10	0.10	0.21
6/14/10 7:00 AM	0.10	0.10	0.23
6/14/10 9:00 AM	0.10	0.10	0.25
6/14/10 11:00 AM	0.09	0.09	0.27
6/14/10 1:00 PM	0.20	0.20	0.27
6/14/10 3:00 PM	0.10	0.10	0.29
6/14/10 5:00 PM	0.10	0.10	0.24
6/14/10 7:00 PM	0.10	0.10	0.14
6/14/10 9:00 PM	0.09	0.09	0.13
6/14/10 11:00 PM	0.10	0.10	0.11

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
6/15/10 1:00 AM	0.13	0.13	0.09
6/15/10 3:00 AM	0.14	0.14	0.09
6/15/10 5:00 AM	0.13	0.13	0.08
6/15/10 7:00 AM	0.14	0.14	0.08
6/15/10 9:00 AM	0.14	0.14	0.08
6/15/10 11:00 AM	0.16	0.16	0.08
6/15/10 1:00 PM	0.17	0.17	0.07
6/15/10 3:00 PM	0.18	0.18	0.07
6/15/10 5:00 PM	0.16	0.16	0.07
6/15/10 7:00 PM	0.13	0.13	0.07
6/15/10 9:00 PM	0.16	0.16	0.06
6/15/10 11:00 PM	0.16	0.16	0.06
6/16/10 1:00 AM	0.16	0.16	0.06
6/16/10 3:00 AM	0.16	0.16	0.06
6/16/10 5:00 AM	0.15	0.15	0.06
6/16/10 7:00 AM	0.18	0.18	0.06
6/16/10 9:00 AM	0.20	0.20	0.06
6/16/10 11:00 AM	0.19	0.19	0.07
6/16/10 1:00 PM	0.15	0.15	0.07
6/16/10 3:00 PM	0.17	0.17	0.07
6/16/10 5:00 PM	0.20	0.20	0.06
6/16/10 7:00 PM	0.19	0.19	0.05
6/16/10 9:00 PM	0.19	0.19	0.05
6/16/10 11:00 PM	0.15	0.15	0.05
6/17/10 1:00 AM	0.19	0.19	0.05
6/17/10 3:00 AM	0.18	0.18	0.05
6/17/10 5:00 AM	0.18	0.18	0.05
6/17/10 7:00 AM	0.15	0.15	0.05
6/17/10 9:00 AM	0.17	0.17	0.06
6/17/10 11:00 AM	0.18	0.18	0.06
6/17/10 1:00 PM	0.18	0.18	0.05
6/17/10 3:00 PM	0.19	0.19	0.05
6/17/10 5:00 PM	0.19	0.19	0.05
6/17/10 7:00 PM	0.18	0.18	0.06
6/17/10 9:00 PM	0.17	0.17	0.06
6/17/10 11:00 PM	0.15	0.15	0.06
6/18/10 1:00 AM	0.17	0.17	0.06
6/18/10 3:00 AM	0.16	0.16	0.06
6/18/10 5:00 AM	0.14	0.14	0.04
6/18/10 7:00 AM	0.18	0.18	0.07
6/18/10 9:00 AM	0.20	0.20	0.07
6/18/10 11:00 AM	0.22	0.22	0.06
6/18/10 1:00 PM	0.21	0.21	0.06
6/18/10 3:00 PM	0.21	0.21	0.06
6/18/10 5:00 PM	0.21	0.21	0.06
6/18/10 7:00 PM	0.20	0.20	0.06
6/18/10 9:00 PM	0.20	0.20	0.06
6/18/10 11:00 PM	0.21	0.21	0.07
6/19/10 1:00 AM	0.22	0.22	0.06
6/19/10 3:00 AM	0.22	0.22	0.07
6/19/10 5:00 AM	0.22	0.22	0.07
6/19/10 7:00 AM	0.23	0.23	0.07
6/19/10 9:00 AM	0.22	0.22	0.08

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
6/19/10 11:00 AM	0.22	0.22	0.07
6/19/10 1:00 PM	0.21	0.21	0.07
6/19/10 3:00 PM	0.21	0.21	0.07
6/19/10 5:00 PM	0.21	0.21	0.08
6/19/10 7:00 PM	0.22	0.22	0.08
6/19/10 9:00 PM	0.21	0.21	0.08
6/19/10 11:00 PM	0.21	0.21	0.08
6/20/10 1:00 AM	0.22	0.22	0.09
6/20/10 3:00 AM	0.21	0.21	0.09
6/20/10 5:00 AM	0.21	0.21	0.09
6/20/10 7:00 AM	0.22	0.22	0.10
6/20/10 9:00 AM	0.21	0.21	0.09
6/20/10 11:00 AM	0.21	0.21	0.10
6/20/10 1:00 PM	0.21	0.21	0.09
6/20/10 3:00 PM	0.20	0.20	0.10
6/20/10 5:00 PM	0.21	0.21	0.11
6/20/10 7:00 PM	0.20	0.20	0.12
6/20/10 9:00 PM	0.20	0.20	0.11
6/20/10 11:00 PM	0.20	0.20	0.04
6/21/10 1:00 AM	0.20	0.20	0.04
6/21/10 3:00 AM	0.24	0.24	0.05
6/21/10 5:00 AM	0.25	0.25	0.08
6/21/10 7:00 AM	0.26	0.26	0.12
6/21/10 9:00 AM	0.27	0.27	0.12
6/21/10 11:00 AM	0.27	0.27	0.11
6/21/10 1:00 PM	0.23	0.23	0.10
6/21/10 3:00 PM	0.22	0.22	0.11
6/21/10 5:00 PM	0.22	0.22	0.13
6/21/10 7:00 PM	0.22	0.22	0.11
6/21/10 9:00 PM	0.22	0.22	0.10
6/21/10 11:00 PM	0.22	0.22	0.03
6/22/10 1:00 AM	0.22	0.22	0.03
6/22/10 3:00 AM	0.22	0.22	0.03
6/22/10 5:00 AM	0.21	0.21	0.04
6/22/10 7:00 AM	0.21	0.21	0.03
6/22/10 9:00 AM	0.21	0.21	0.03
6/22/10 11:00 AM	0.20	0.20	0.03
6/22/10 1:00 PM	0.20	0.20	0.02
6/22/10 3:00 PM	0.21	0.21	0.06
6/22/10 5:00 PM	0.20	0.20	0.07
6/22/10 7:00 PM	0.21	0.21	0.06
6/22/10 9:00 PM	0.21	0.21	0.06
6/22/10 11:00 PM	0.20	0.20	0.03
6/23/10 1:00 AM	0.20	0.20	0.03
6/23/10 3:00 AM	0.20	0.20	0.03
6/23/10 5:00 AM	0.19	0.19	0.03
6/23/10 7:00 AM	0.20	0.20	0.06
6/23/10 9:00 AM	0.19	0.19	0.06
6/23/10 11:00 AM	0.18	0.18	0.06
6/23/10 1:00 PM	0.17	0.17	0.06
6/23/10 3:00 PM	0.18	0.18	0.07
6/23/10 5:00 PM	0.18	0.18	0.07
6/23/10 7:00 PM	0.18	0.18	0.05

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
6/23/10 9:00 PM	0.17	0.17	0.04
6/23/10 11:00 PM	0.15	0.15	0.05
6/24/10 1:00 AM	0.12	0.12	0.07
6/24/10 3:00 AM	0.12	0.12	0.06
6/24/10 5:00 AM	0.12	0.12	0.07
6/24/10 7:00 AM	0.13	0.13	0.09
6/24/10 9:00 AM	0.12	0.12	0.08
6/24/10 11:00 AM	0.12	0.12	0.09
6/24/10 1:00 PM	0.12	0.12	0.09
6/24/10 3:00 PM	0.12	0.12	0.42
6/24/10 5:00 PM	0.12	0.12	0.12
6/24/10 7:00 PM	0.12	0.12	0.11
6/24/10 9:00 PM	0.17	0.17	0.11
6/24/10 11:00 PM	0.18	0.18	0.11
6/25/10 1:00 AM	0.17	0.17	0.10
6/25/10 3:00 AM	0.17	0.17	0.09
6/25/10 5:00 AM	0.17	0.17	0.12
6/25/10 7:00 AM	0.17	0.17	0.14
6/25/10 9:00 AM	0.17	0.17	0.14
6/25/10 11:00 AM	0.17	0.17	0.15
6/25/10 1:00 PM	0.17	0.17	0.16
6/25/10 3:00 PM	0.17	0.17	0.18
6/25/10 5:00 PM	0.17	0.17	0.19
6/25/10 7:00 PM	0.17	0.17	0.20
6/25/10 9:00 PM	0.17	0.17	0.20
6/25/10 11:00 PM	0.17	0.17	0.20
6/26/10 1:00 AM	0.17	0.17	0.23
6/26/10 3:00 AM	0.17	0.17	0.24
6/26/10 5:00 AM	0.17	0.17	0.23
6/26/10 7:00 AM	0.18	0.18	0.20
6/26/10 9:00 AM	0.18	0.18	0.18
6/26/10 11:00 AM	0.18	0.18	0.18
6/26/10 1:00 PM	0.17	0.17	0.23
6/26/10 3:00 PM	0.17	0.17	0.74
6/26/10 5:00 PM	0.17	0.17	0.08
6/26/10 7:00 PM	0.17	0.17	0.10
6/26/10 9:00 PM	0.17	0.17	0.12
6/26/10 11:00 PM	0.16	0.16	0.15
6/27/10 1:00 AM	0.16	0.16	0.13
6/27/10 3:00 AM	0.17	0.17	0.10
6/27/10 5:00 AM	0.17	0.17	0.09
6/27/10 7:00 AM	0.18	0.18	0.08
6/27/10 9:00 AM	0.17	0.17	0.08
6/27/10 11:00 AM	0.17	0.17	0.08
6/27/10 1:00 PM	0.16	0.16	0.09
6/27/10 3:00 PM	0.15	0.15	0.08
6/27/10 5:00 PM	0.16	0.16	0.07
6/27/10 7:00 PM	0.16	0.16	0.07
6/27/10 9:00 PM	0.16	0.16	0.07
6/27/10 11:00 PM	0.16	0.16	0.04
6/28/10 1:00 AM	0.16	0.16	0.05
6/28/10 3:00 AM	0.16	0.16	0.05
6/28/10 5:00 AM	0.16	0.16	0.05

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
6/28/10 7:00 AM	0.17	0.17	0.03
6/28/10 9:00 AM	0.16	0.16	0.06
6/28/10 11:00 AM	0.16	0.16	0.06
6/28/10 1:00 PM	0.16	0.16	0.07
6/28/10 3:00 PM	0.17	0.17	0.07
6/28/10 5:00 PM	0.17	0.17	0.07
6/28/10 7:00 PM	0.16	0.16	0.07
6/28/10 9:00 PM	0.17	0.17	0.06
6/28/10 11:00 PM	0.17	0.17	0.04
6/29/10 1:00 AM	0.17	0.17	0.05
6/29/10 3:00 AM	0.17	0.17	0.05
6/29/10 5:00 AM	0.17	0.17	0.06
6/29/10 7:00 AM	0.17	0.17	0.09
6/29/10 9:00 AM	0.17	0.17	0.08
6/29/10 11:00 AM	0.17	0.17	0.08
6/29/10 1:00 PM	0.17	0.17	0.07
6/29/10 3:00 PM	0.17	0.17	0.07
6/29/10 5:00 PM	0.17	0.17	0.06
6/29/10 7:00 PM	0.17	0.17	0.07
6/29/10 9:00 PM	0.15	0.15	0.06
6/29/10 11:00 PM	0.09	0.09	0.06
6/30/10 1:00 AM	0.10	0.10	0.06
6/30/10 3:00 AM	0.11	0.11	0.06
6/30/10 5:00 AM	0.12	0.12	0.07
6/30/10 7:00 AM	0.11	0.11	0.07
6/30/10 9:00 AM	0.10	0.10	0.13
6/30/10 11:00 AM	0.07	0.07	0.17
6/30/10 1:00 PM	0.06	0.06	0.18
6/30/10 3:00 PM	0.06	0.06	0.19
6/30/10 5:00 PM	0.07	0.07	0.18
6/30/10 7:00 PM	0.06	0.06	0.19
6/30/10 9:00 PM	0.06	0.06	0.20
6/30/10 11:00 PM	0.06	0.06	0.22
7/1/10 1:00 AM	0.06	0.06	0.23
7/1/10 3:00 AM	0.07	0.07	0.21
7/1/10 5:00 AM	0.06	0.06	0.22
7/1/10 7:00 AM	0.06	0.06	0.22
7/1/10 9:00 AM	0.06	0.06	0.22
7/1/10 11:00 AM	0.06	0.06	0.21
7/1/10 1:00 PM	0.06	0.06	0.16
7/1/10 3:00 PM	0.06	0.06	0.11
7/1/10 5:00 PM	0.06	0.06	0.12
7/1/10 7:00 PM	0.07	0.07	0.11
7/1/10 9:00 PM	0.09	0.09	0.08
7/1/10 11:00 PM	0.08	0.08	0.09
7/2/10 1:00 AM	0.08	0.08	0.10
7/2/10 3:00 AM	0.08	0.08	0.10
7/2/10 5:00 AM	0.10	0.10	0.09
7/2/10 7:00 AM	0.14	0.14	0.10
7/2/10 9:00 AM	0.15	0.15	0.13
7/2/10 11:00 AM	0.15	0.15	0.13
7/2/10 1:00 PM	0.15	0.15	0.16
7/2/10 3:00 PM	0.16	0.16	0.14

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
7/2/10 5:00 PM	0.19	0.19	0.11
7/2/10 7:00 PM	0.18	0.18	0.11
7/2/10 9:00 PM	0.17	0.17	0.10
7/2/10 11:00 PM	0.18	0.18	0.05
7/3/10 1:00 AM	0.16	0.16	0.05
7/3/10 3:00 AM	0.13	0.13	0.05
7/3/10 5:00 AM	0.13	0.13	0.06
7/3/10 7:00 AM	0.13	0.13	0.07
7/3/10 9:00 AM	0.20	0.20	0.15
7/3/10 11:00 AM	0.20	0.20	0.12
7/3/10 1:00 PM	0.21	0.21	0.13
7/3/10 3:00 PM	0.21	0.21	0.14
7/3/10 5:00 PM	0.21	0.21	0.12
7/3/10 7:00 PM	0.21	0.21	0.12
7/3/10 9:00 PM	0.21	0.21	0.11
7/3/10 11:00 PM	0.16	0.16	0.10
7/4/10 1:00 AM	0.13	0.13	0.10
7/4/10 3:00 AM	0.10	0.10	0.06
7/4/10 5:00 AM	0.10	0.10	0.05
7/4/10 7:00 AM	0.10	0.10	0.06
7/4/10 9:00 AM	0.13	0.13	0.09
7/4/10 11:00 AM	0.19	0.19	0.08
7/4/10 1:00 PM	0.20	0.20	0.08
7/4/10 3:00 PM	0.21	0.21	0.09
7/4/10 5:00 PM	0.21	0.21	0.10
7/4/10 7:00 PM	0.21	0.21	0.10
7/4/10 9:00 PM	0.19	0.19	0.09
7/4/10 11:00 PM	0.18	0.18	0.06
7/5/10 1:00 AM	0.15	0.15	0.05
7/5/10 3:00 AM	0.15	0.15	0.05
7/5/10 5:00 AM	0.14	0.14	0.05
7/5/10 7:00 AM	0.22	0.22	0.09
7/5/10 9:00 AM	0.21	0.21	0.07
7/5/10 11:00 AM	0.21	0.21	0.07
7/5/10 1:00 PM	0.21	0.21	0.07
7/5/10 3:00 PM	0.20	0.20	0.07
7/5/10 5:00 PM	0.20	0.20	0.07
7/5/10 7:00 PM	0.20	0.20	0.07
7/5/10 9:00 PM	0.26	0.26	0.08
7/5/10 11:00 PM	0.19	0.19	0.08
7/6/10 1:00 AM	0.16	0.16	0.08
7/6/10 3:00 AM	0.14	0.14	0.08
7/6/10 5:00 AM	0.19	0.19	0.08
7/6/10 7:00 AM	0.22	0.22	0.09
7/6/10 9:00 AM	0.22	0.22	0.09
7/6/10 11:00 AM	0.22	0.22	0.08
7/6/10 1:00 PM	0.22	0.22	0.16
7/6/10 3:00 PM	0.22	0.22	0.12
7/6/10 5:00 PM	0.21	0.21	0.10
7/6/10 7:00 PM	0.21	0.21	0.09
7/6/10 9:00 PM	0.20	0.20	0.10
7/6/10 11:00 PM	0.19	0.19	0.10
7/7/10 1:00 AM	0.19	0.19	0.10

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
7/7/10 3:00 AM	0.15	0.15	0.10
7/7/10 5:00 AM	0.11	0.11	0.06
7/7/10 7:00 AM	0.10	0.10	0.06
7/7/10 9:00 AM	0.09	0.09	0.06
7/7/10 11:00 AM	0.08	0.08	0.06
7/7/10 1:00 PM	0.06	0.06	0.05
7/7/10 3:00 PM	0.06	0.06	0.04
7/7/10 5:00 PM	0.07	0.07	0.05
7/7/10 7:00 PM	0.07	0.07	0.06
7/7/10 9:00 PM	0.09	0.09	0.07
7/7/10 11:00 PM	0.10	0.10	0.06
7/8/10 1:00 AM	0.11	0.11	0.06
7/8/10 3:00 AM	0.11	0.11	0.06
7/8/10 5:00 AM	0.13	0.13	0.06
7/8/10 7:00 AM	0.16	0.16	0.06
7/8/10 9:00 AM	0.15	0.15	0.06
7/8/10 11:00 AM	0.15	0.15	0.05
7/8/10 1:00 PM	0.15	0.15	0.05
7/8/10 3:00 PM	0.15	0.15	0.04
7/8/10 5:00 PM	0.15	0.15	0.04
7/8/10 7:00 PM	0.15	0.15	0.04
7/8/10 9:00 PM	0.15	0.15	0.04
7/8/10 11:00 PM	0.16	0.16	0.04
7/9/10 1:00 AM	0.16	0.16	0.04
7/9/10 3:00 AM	0.16	0.16	0.04
7/9/10 5:00 AM	0.16	0.16	0.04
7/9/10 7:00 AM	0.17	0.17	0.04
7/9/10 9:00 AM	0.18	0.18	0.04
7/9/10 11:00 AM	0.18	0.18	0.04
7/9/10 1:00 PM	0.16	0.16	0.04
7/9/10 3:00 PM	0.16	0.16	0.04
7/9/10 5:00 PM	0.16	0.16	0.05
7/9/10 7:00 PM	0.16	0.16	0.05
7/9/10 9:00 PM	0.19	0.19	0.04
7/9/10 11:00 PM	0.22	0.22	0.05
7/10/10 1:00 AM	0.24	0.24	0.05
7/10/10 3:00 AM	0.25	0.25	0.05
7/10/10 5:00 AM	0.24	0.24	0.05
7/10/10 7:00 AM	0.25	0.25	0.05
7/10/10 9:00 AM	0.25	0.25	0.05
7/10/10 11:00 AM	0.24	0.24	0.05
7/10/10 1:00 PM	0.24	0.24	0.05
7/10/10 3:00 PM	0.23	0.23	0.05
7/10/10 5:00 PM	0.23	0.23	0.05
7/10/10 7:00 PM	0.22	0.22	0.05
7/10/10 9:00 PM	0.22	0.22	0.05
7/10/10 11:00 PM	0.22	0.22	0.05
7/11/10 1:00 AM	0.22	0.22	0.05
7/11/10 3:00 AM	0.21	0.21	0.05
7/11/10 5:00 AM	0.19	0.19	0.05
7/11/10 7:00 AM	0.21	0.21	0.05
7/11/10 9:00 AM	0.22	0.22	0.05
7/11/10 11:00 AM	0.22	0.22	0.06

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
7/11/10 1:00 PM	0.22	0.22	0.06
7/11/10 3:00 PM	0.21	0.21	0.06
7/11/10 5:00 PM	0.20	0.20	0.07
7/11/10 7:00 PM	0.20	0.20	0.06
7/11/10 9:00 PM	0.16	0.16	0.07
7/11/10 11:00 PM	0.21	0.21	0.07
7/12/10 1:00 AM	0.18	0.18	0.07
7/12/10 3:00 AM	0.14	0.14	0.07
7/12/10 5:00 AM	0.19	0.19	0.07
7/12/10 7:00 AM	0.21	0.21	0.07
7/12/10 9:00 AM	0.21	0.21	0.07
7/12/10 11:00 AM	0.21	0.21	0.06
7/12/10 1:00 PM	0.22	0.22	0.08
7/12/10 3:00 PM	0.22	0.22	0.08
7/12/10 5:00 PM	0.21	0.21	0.08
7/12/10 7:00 PM	0.21	0.21	0.07
7/12/10 9:00 PM	0.21	0.21	0.07
7/12/10 11:00 PM	0.17	0.17	0.07
7/13/10 1:00 AM	0.13	0.13	0.07
7/13/10 3:00 AM	0.13	0.13	0.08
7/13/10 5:00 AM	0.16	0.16	0.09
7/13/10 7:00 AM	0.20	0.20	0.07
7/13/10 9:00 AM	0.20	0.20	0.07
7/13/10 11:00 AM	0.20	0.20	0.08
7/13/10 1:00 PM	0.19	0.19	0.08
7/13/10 3:00 PM	0.19	0.19	0.08
7/13/10 5:00 PM	0.19	0.19	0.09
7/13/10 7:00 PM	0.19	0.19	0.09
7/13/10 9:00 PM	0.18	0.18	0.11
7/13/10 11:00 PM	0.18	0.18	0.14
7/14/10 1:00 AM	0.13	0.13	0.15
7/14/10 3:00 AM	0.10	0.10	0.17
7/14/10 5:00 AM	0.15	0.15	0.12
7/14/10 7:00 AM	0.19	0.19	0.11
7/14/10 9:00 AM	0.19	0.19	0.12
7/14/10 11:00 AM	0.19	0.19	0.11
7/14/10 1:00 PM	0.20	0.20	0.13
7/14/10 3:00 PM	0.20	0.20	0.15
7/14/10 5:00 PM	0.20	0.20	0.14
7/14/10 7:00 PM	0.20	0.20	0.19
7/14/10 9:00 PM	0.19	0.19	0.18
7/14/10 11:00 PM	0.19	0.19	0.17
7/15/10 1:00 AM	0.18	0.18	0.14
7/15/10 3:00 AM	0.12	0.12	0.12
7/15/10 5:00 AM	0.16	0.16	0.12
7/15/10 7:00 AM	0.19	0.19	0.11
7/15/10 9:00 AM	0.20	0.20	0.11
7/15/10 11:00 AM	0.21	0.21	0.10
7/15/10 1:00 PM	0.21	0.21	0.10
7/15/10 3:00 PM	0.21	0.21	0.08
7/15/10 5:00 PM	0.21	0.21	0.08
7/15/10 7:00 PM	0.21	0.21	0.07
7/15/10 9:00 PM	0.21	0.21	0.07

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
7/15/10 11:00 PM	0.18	0.18	0.06
7/16/10 1:00 AM	0.14	0.14	0.05
7/16/10 3:00 AM	0.14	0.14	0.05
7/16/10 5:00 AM	0.22	0.22	0.07
7/16/10 7:00 AM	0.22	0.22	0.07
7/16/10 9:00 AM	0.22	0.22	0.07
7/16/10 11:00 AM	0.22	0.22	0.07
7/16/10 1:00 PM	0.21	0.21	0.07
7/16/10 3:00 PM	0.22	0.22	0.08
7/16/10 5:00 PM	0.21	0.21	0.08
7/16/10 7:00 PM	0.22	0.22	0.11
7/16/10 9:00 PM	0.22	0.22	0.09
7/16/10 11:00 PM	0.22	0.22	0.05
7/17/10 1:00 AM	0.21	0.21	0.05
7/17/10 3:00 AM	0.20	0.20	0.04
7/17/10 5:00 AM	0.20	0.20	0.04
7/17/10 7:00 AM	0.21	0.21	0.05
7/17/10 9:00 AM	0.20	0.20	0.07
7/17/10 11:00 AM	0.21	0.21	0.11
7/17/10 1:00 PM	0.20	0.20	0.07
7/17/10 3:00 PM	0.20	0.20	0.12
7/17/10 5:00 PM	0.20	0.20	0.17
7/17/10 7:00 PM	0.20	0.20	0.17
7/17/10 9:00 PM	0.20	0.20	0.16
7/17/10 11:00 PM	0.21	0.21	0.08
7/18/10 1:00 AM	0.21	0.21	0.08
7/18/10 3:00 AM	0.19	0.19	0.07
7/18/10 5:00 AM	0.15	0.15	0.05
7/18/10 7:00 AM	0.17	0.17	0.05
7/18/10 9:00 AM	0.22	0.22	0.06
7/18/10 11:00 AM	0.21	0.21	0.07
7/18/10 1:00 PM	0.21	0.21	0.06
7/18/10 3:00 PM	0.21	0.21	0.05
7/18/10 5:00 PM	0.21	0.21	0.05
7/18/10 7:00 PM	0.20	0.20	0.05
7/18/10 9:00 PM	0.20	0.20	0.06
7/18/10 11:00 PM	0.20	0.20	0.04
7/19/10 1:00 AM	0.20	0.20	0.01
7/19/10 3:00 AM	0.20	0.20	0.02
7/19/10 5:00 AM	0.21	0.21	0.02
7/19/10 7:00 AM	0.21	0.21	0.02
7/19/10 9:00 AM	0.22	0.22	0.03
7/19/10 11:00 AM	0.21	0.21	0.04
7/19/10 1:00 PM	0.21	0.21	0.04
7/19/10 3:00 PM	0.21	0.21	0.01
7/19/10 5:00 PM	0.21	0.21	0.01
7/19/10 7:00 PM	0.21	0.21	0.01
7/19/10 9:00 PM	0.21	0.21	0.01
7/19/10 11:00 PM	0.20	0.20	0.01
7/20/10 1:00 AM	0.20	0.20	0.03
7/20/10 3:00 AM	0.19	0.19	0.03
7/20/10 5:00 AM	0.19	0.19	0.04
7/20/10 7:00 AM	0.20	0.20	0.06

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
7/20/10 9:00 AM	0.19	0.19	0.06
7/20/10 11:00 AM	0.19	0.19	0.06
7/20/10 1:00 PM	0.18	0.18	0.09
7/20/10 3:00 PM	0.18	0.18	0.08
7/20/10 5:00 PM	0.18	0.18	0.07
7/20/10 7:00 PM	0.18	0.18	0.07
7/20/10 9:00 PM	0.17	0.17	0.06
7/20/10 11:00 PM	0.15	0.15	0.06
7/21/10 1:00 AM	0.10	0.10	0.06
7/21/10 3:00 AM	0.10	0.10	0.13
7/21/10 5:00 AM	0.08	0.08	0.17
7/21/10 7:00 AM	0.10	0.10	0.17
7/21/10 9:00 AM	0.10	0.10	0.16
7/21/10 11:00 AM	0.17	0.17	0.17
7/21/10 1:00 PM	0.18	0.18	0.17
7/21/10 3:00 PM	0.17	0.17	0.18
7/21/10 5:00 PM	0.17	0.17	0.19
7/21/10 7:00 PM	0.16	0.16	0.18
7/21/10 9:00 PM	0.15	0.15	0.19
7/21/10 11:00 PM	0.20	0.20	0.19
7/22/10 1:00 AM	0.21	0.21	0.20
7/22/10 3:00 AM	0.11	0.11	0.20
7/22/10 5:00 AM	0.12	0.12	0.21
7/22/10 7:00 AM	0.12	0.12	0.22
7/22/10 9:00 AM	0.12	0.12	0.22
7/22/10 11:00 AM	0.09	0.09	0.24
7/22/10 1:00 PM	0.09	0.09	0.13
7/22/10 3:00 PM	0.08	0.08	0.07
7/22/10 5:00 PM	0.10	0.10	0.07
7/22/10 7:00 PM	0.15	0.15	0.08
7/22/10 9:00 PM	0.15	0.15	0.06
7/22/10 11:00 PM	0.08	0.08	0.07
7/23/10 1:00 AM	0.08	0.08	0.07
7/23/10 3:00 AM	0.08	0.08	0.07
7/23/10 5:00 AM	0.13	0.13	0.08
7/23/10 7:00 AM	0.18	0.18	0.08
7/23/10 9:00 AM	0.19	0.19	0.08
7/23/10 11:00 AM	0.19	0.19	0.07
7/23/10 1:00 PM	0.19	0.19	0.06
7/23/10 3:00 PM	0.19	0.19	0.05
7/23/10 5:00 PM	0.19	0.19	0.05
7/23/10 7:00 PM	0.19	0.19	0.05
7/23/10 9:00 PM	0.19	0.19	0.06
7/23/10 11:00 PM	0.19	0.19	0.06
7/24/10 1:00 AM	0.19	0.19	0.06
7/24/10 3:00 AM	0.19	0.19	0.06
7/24/10 5:00 AM	0.19	0.19	0.06
7/24/10 7:00 AM	0.19	0.19	0.05
7/24/10 9:00 AM	0.18	0.18	0.05
7/24/10 11:00 AM	0.18	0.18	0.06
7/24/10 1:00 PM	0.18	0.18	0.06
7/24/10 3:00 PM	0.17	0.17	0.06
7/24/10 5:00 PM	0.18	0.18	0.05

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
7/24/10 7:00 PM	0.18	0.18	0.06
7/24/10 9:00 PM	0.18	0.18	0.05
7/24/10 11:00 PM	0.18	0.18	0.03
7/25/10 1:00 AM	0.18	0.18	0.03
7/25/10 3:00 AM	0.16	0.16	0.03
7/25/10 5:00 AM	0.15	0.15	0.03
7/25/10 7:00 AM	0.15	0.15	0.03
7/25/10 9:00 AM	0.19	0.19	0.05
7/25/10 11:00 AM	0.18	0.18	0.06
7/25/10 1:00 PM	0.18	0.18	0.07
7/25/10 3:00 PM	0.18	0.18	0.07
7/25/10 5:00 PM	0.19	0.19	0.07
7/25/10 7:00 PM	0.19	0.19	0.07
7/25/10 9:00 PM	0.18	0.18	0.06
7/25/10 11:00 PM	0.18	0.18	0.03
7/26/10 1:00 AM	0.18	0.18	0.03
7/26/10 3:00 AM	0.18	0.18	0.03
7/26/10 5:00 AM	0.19	0.19	0.03
7/26/10 7:00 AM	0.18	0.18	0.05
7/26/10 9:00 AM	0.18	0.18	0.05
7/26/10 11:00 AM	0.18	0.18	0.06
7/26/10 1:00 PM	0.18	0.18	0.06
7/26/10 3:00 PM	0.18	0.18	0.06
7/26/10 5:00 PM	0.18	0.18	0.05
7/26/10 7:00 PM	0.18	0.18	0.05
7/26/10 9:00 PM	0.17	0.17	0.05
7/26/10 11:00 PM	0.10	0.10	0.05
7/27/10 1:00 AM	0.10	0.10	0.05
7/27/10 3:00 AM	0.10	0.10	0.05
7/27/10 5:00 AM	0.10	0.10	0.05
7/27/10 7:00 AM	0.14	0.14	0.06
7/27/10 9:00 AM	0.16	0.16	0.08
7/27/10 11:00 AM	0.17	0.17	0.07
7/27/10 1:00 PM	0.17	0.17	0.07
7/27/10 3:00 PM	0.17	0.17	0.07
7/27/10 5:00 PM	0.17	0.17	0.07
7/27/10 7:00 PM	0.17	0.17	0.07
7/27/10 9:00 PM	0.17	0.17	0.06
7/27/10 11:00 PM	0.17	0.17	0.03
7/28/10 1:00 AM	0.17	0.17	0.03
7/28/10 3:00 AM	0.17	0.17	0.03
7/28/10 5:00 AM	0.18	0.18	0.03
7/28/10 7:00 AM	0.18	0.18	0.06
7/28/10 9:00 AM	0.18	0.18	0.06
7/28/10 11:00 AM	0.17	0.17	0.06
7/28/10 1:00 PM	0.17	0.17	0.07
7/28/10 3:00 PM	0.17	0.17	0.07
7/28/10 5:00 PM	0.18	0.18	0.07
7/28/10 7:00 PM	0.18	0.18	0.06
7/28/10 9:00 PM	0.17	0.17	0.06
7/28/10 11:00 PM	0.12	0.12	0.06
7/29/10 1:00 AM	0.13	0.13	0.06
7/29/10 3:00 AM	0.13	0.13	0.06

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
7/29/10 5:00 AM	0.15	0.15	0.06
7/29/10 7:00 AM	0.17	0.17	0.07
7/29/10 9:00 AM	0.22	0.22	0.07
7/29/10 11:00 AM	0.21	0.21	0.08
7/29/10 1:00 PM	0.21	0.21	0.11
7/29/10 3:00 PM	0.21	0.21	0.16
7/29/10 5:00 PM	0.22	0.22	0.10
7/29/10 7:00 PM	0.19	0.19	0.07
7/29/10 9:00 PM	0.19	0.19	0.07
7/29/10 11:00 PM	0.19	0.19	0.06
7/30/10 1:00 AM	0.20	0.20	0.04
7/30/10 3:00 AM	0.20	0.20	0.03
7/30/10 5:00 AM	0.20	0.20	0.04
7/30/10 7:00 AM	0.20	0.20	0.04
7/30/10 9:00 AM	0.19	0.19	0.04
7/30/10 11:00 AM	0.20	0.20	0.05
7/30/10 1:00 PM	0.20	0.20	0.04
7/30/10 3:00 PM	0.20	0.20	0.03
7/30/10 5:00 PM	0.20	0.20	0.03
7/30/10 7:00 PM	0.22	0.22	0.03
7/30/10 9:00 PM	0.27	0.27	0.03
7/30/10 11:00 PM	0.24	0.24	0.03
7/31/10 1:00 AM	0.20	0.20	0.03
7/31/10 3:00 AM	0.18	0.18	0.03
7/31/10 5:00 AM	0.20	0.20	0.03
7/31/10 7:00 AM	0.22	0.22	0.03
7/31/10 9:00 AM	0.21	0.21	0.04
7/31/10 11:00 AM	0.21	0.21	0.04
7/31/10 1:00 PM	0.21	0.21	0.03
7/31/10 3:00 PM	0.21	0.21	0.03
7/31/10 5:00 PM	0.20	0.20	0.03
7/31/10 7:00 PM	0.20	0.20	0.03
7/31/10 9:00 PM	0.20	0.20	0.04
7/31/10 11:00 PM	0.21	0.21	0.06
8/1/10 1:00 AM	0.21	0.21	0.14
8/1/10 3:00 AM	0.21	0.21	0.04
8/1/10 5:00 AM	0.21	0.21	0.03
8/1/10 7:00 AM	0.20	0.20	0.03
8/1/10 9:00 AM	0.21	0.21	0.03
8/1/10 11:00 AM	0.21	0.21	0.04
8/1/10 1:00 PM	0.20	0.20	0.03
8/1/10 3:00 PM	0.20	0.20	0.03
8/1/10 5:00 PM	0.21	0.21	0.05
8/1/10 7:00 PM	0.21	0.21	0.18
8/1/10 9:00 PM	0.21	0.21	0.04
8/1/10 11:00 PM	0.21	0.21	0.03
8/2/10 1:00 AM	0.21	0.21	0.04
8/2/10 3:00 AM	0.22	0.22	0.04
8/2/10 5:00 AM	0.21	0.21	0.04
8/2/10 7:00 AM	0.22	0.22	0.04
8/2/10 9:00 AM	0.21	0.21	0.04
8/2/10 11:00 AM	0.22	0.22	0.03
8/2/10 1:00 PM	0.22	0.22	0.03

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
8/2/10 3:00 PM	0.22	0.22	0.03
8/2/10 5:00 PM	0.22	0.22	0.03
8/2/10 7:00 PM	0.22	0.22	0.03
8/2/10 9:00 PM	0.22	0.22	0.03
8/2/10 11:00 PM	0.22	0.22	0.00
8/3/10 1:00 AM	0.21	0.21	0.00
8/3/10 3:00 AM	0.21	0.21	0.00
8/3/10 5:00 AM	0.21	0.21	0.00
8/3/10 7:00 AM	0.20	0.20	0.00
8/3/10 9:00 AM	0.20	0.20	0.00
8/3/10 11:00 AM	0.20	0.20	0.00
8/3/10 1:00 PM	0.20	0.20	0.00
8/3/10 3:00 PM	0.21	0.21	0.00
8/3/10 5:00 PM	0.21	0.21	0.00
8/3/10 7:00 PM	0.21	0.21	0.00
8/3/10 9:00 PM	0.20	0.20	0.00
8/3/10 11:00 PM	0.14	0.14	0.00
8/4/10 1:00 AM	0.13	0.13	0.00
8/4/10 3:00 AM	0.13	0.13	0.00
8/4/10 5:00 AM	0.17	0.17	0.00
8/4/10 7:00 AM	0.22	0.22	0.00
8/4/10 9:00 AM	0.21	0.21	0.00
8/4/10 11:00 AM	0.21	0.21	0.00
8/4/10 1:00 PM	0.21	0.21	0.00
8/4/10 3:00 PM	0.20	0.20	0.00
8/4/10 5:00 PM	0.20	0.20	0.00
8/4/10 7:00 PM	0.21	0.21	0.00
8/4/10 9:00 PM	0.21	0.21	0.00
8/4/10 11:00 PM	0.21	0.21	0.00
8/5/10 1:00 AM	0.20	0.20	0.00
8/5/10 3:00 AM	0.20	0.20	0.00
8/5/10 5:00 AM	0.20	0.20	0.00
8/5/10 7:00 AM	0.20	0.20	0.00
8/5/10 9:00 AM	0.21	0.21	0.00
8/5/10 11:00 AM	0.21	0.21	0.00
8/5/10 1:00 PM	0.21	0.21	0.00
8/5/10 3:00 PM	0.21	0.21	0.00
8/5/10 5:00 PM	0.21	0.21	0.00
8/5/10 7:00 PM	0.21	0.21	0.00
8/5/10 9:00 PM	0.21	0.21	0.00
8/5/10 11:00 PM	0.21	0.21	0.00
8/6/10 1:00 AM	0.21	0.21	0.00
8/6/10 3:00 AM	0.20	0.20	0.00
8/6/10 5:00 AM	0.21	0.21	0.00
8/6/10 7:00 AM	0.21	0.21	0.00
8/6/10 9:00 AM	0.21	0.21	0.00
8/6/10 11:00 AM	0.21	0.21	0.00
8/6/10 1:00 PM	0.20	0.20	0.00
8/6/10 3:00 PM	0.20	0.20	0.00
8/6/10 5:00 PM	0.20	0.20	0.00
8/6/10 7:00 PM	0.20	0.20	0.00
8/6/10 9:00 PM	0.20	0.20	0.00
8/6/10 11:00 PM	0.20	0.20	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
8/7/10 1:00 AM	0.21	0.21	0.00
8/7/10 3:00 AM	0.20	0.20	0.00
8/7/10 5:00 AM	0.20	0.20	0.00
8/7/10 7:00 AM	0.20	0.20	0.00
8/7/10 9:00 AM	0.21	0.21	0.01
8/7/10 11:00 AM	0.21	0.21	0.03
8/7/10 1:00 PM	0.20	0.20	0.07
8/7/10 3:00 PM	0.20	0.20	0.12
8/7/10 5:00 PM	0.20	0.20	0.13
8/7/10 7:00 PM	0.20	0.20	0.12
8/7/10 9:00 PM	0.20	0.20	0.20
8/7/10 11:00 PM	0.20	0.20	0.20
8/8/10 1:00 AM	0.21	0.21	0.16
8/8/10 3:00 AM	0.21	0.21	0.20
8/8/10 5:00 AM	0.20	0.20	0.21
8/8/10 7:00 AM	0.21	0.21	0.20
8/8/10 9:00 AM	0.21	0.21	0.15
8/8/10 11:00 AM	0.20	0.20	0.17
8/8/10 1:00 PM	0.20	0.20	0.12
8/8/10 3:00 PM	0.20	0.20	0.09
8/8/10 5:00 PM	0.20	0.20	0.08
8/8/10 7:00 PM	0.22	0.22	0.07
8/8/10 9:00 PM	0.21	0.21	0.07
8/8/10 11:00 PM	0.21	0.21	0.08
8/9/10 1:00 AM	0.26	0.26	0.08
8/9/10 3:00 AM	0.20	0.20	0.07
8/9/10 5:00 AM	0.20	0.20	0.07
8/9/10 7:00 AM	0.20	0.20	0.07
8/9/10 9:00 AM	0.20	0.20	0.06
8/9/10 11:00 AM	0.21	0.21	0.06
8/9/10 1:00 PM	0.21	0.21	0.06
8/9/10 3:00 PM	0.21	0.21	0.06
8/9/10 5:00 PM	0.21	0.21	0.06
8/9/10 7:00 PM	0.20	0.20	0.05
8/9/10 9:00 PM	0.20	0.20	0.05
8/9/10 11:00 PM	0.20	0.20	0.06
8/10/10 1:00 AM	0.20	0.20	0.06
8/10/10 3:00 AM	0.20	0.20	0.06
8/10/10 5:00 AM	0.20	0.20	0.06
8/10/10 7:00 AM	0.20	0.20	0.06
8/10/10 9:00 AM	0.21	0.21	0.06
8/10/10 11:00 AM	0.21	0.21	0.06
8/10/10 1:00 PM	0.21	0.21	0.06
8/10/10 3:00 PM	0.21	0.21	0.06
8/10/10 5:00 PM	0.21	0.21	0.06
8/10/10 7:00 PM	0.21	0.21	0.06
8/10/10 9:00 PM	0.21	0.21	0.07
8/10/10 11:00 PM	0.20	0.20	0.08
8/11/10 1:00 AM	0.21	0.21	0.08
8/11/10 3:00 AM	0.21	0.21	0.08
8/11/10 5:00 AM	0.21	0.21	0.08
8/11/10 7:00 AM	0.22	0.22	0.09
8/11/10 9:00 AM	0.22	0.22	0.10

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
8/11/10 11:00 AM	0.21	0.21	0.11
8/11/10 1:00 PM	0.21	0.21	0.13
8/11/10 3:00 PM	0.20	0.20	0.13
8/11/10 5:00 PM	0.21	0.21	0.11
8/11/10 7:00 PM	0.21	0.21	0.07
8/11/10 9:00 PM	0.20	0.20	0.07
8/11/10 11:00 PM	0.20	0.20	0.08
8/12/10 1:00 AM	0.20	0.20	0.10
8/12/10 3:00 AM	0.20	0.20	0.12
8/12/10 5:00 AM	0.20	0.20	0.12
8/12/10 7:00 AM	0.20	0.20	0.11
8/12/10 9:00 AM	0.21	0.21	0.12
8/12/10 11:00 AM	0.21	0.21	0.14
8/12/10 1:00 PM	0.21	0.21	0.15
8/12/10 3:00 PM	0.21	0.21	0.21
8/12/10 5:00 PM	0.21	0.21	0.20
8/12/10 7:00 PM	0.21	0.21	0.18
8/12/10 9:00 PM	0.21	0.21	0.15
8/12/10 11:00 PM	0.20	0.20	0.15
8/13/10 1:00 AM	0.20	0.20	0.16
8/13/10 3:00 AM	0.13	0.13	0.17
8/13/10 5:00 AM	0.12	0.12	0.17
8/13/10 7:00 AM	0.13	0.13	0.16
8/13/10 9:00 AM	0.15	0.15	0.16
8/13/10 11:00 AM	0.19	0.19	0.17
8/13/10 1:00 PM	0.20	0.20	0.20
8/13/10 3:00 PM	0.19	0.19	0.18
8/13/10 5:00 PM	0.19	0.19	0.18
8/13/10 7:00 PM	0.20	0.20	0.20
8/13/10 9:00 PM	0.20	0.20	0.16
8/13/10 11:00 PM	0.19	0.19	0.13
8/14/10 1:00 AM	0.19	0.19	0.07
8/14/10 3:00 AM	0.19	0.19	0.09
8/14/10 5:00 AM	0.19	0.19	0.12
8/14/10 7:00 AM	0.20	0.20	0.13
8/14/10 9:00 AM	0.20	0.20	0.16
8/14/10 11:00 AM	0.20	0.20	0.20
8/14/10 1:00 PM	0.19	0.19	0.20
8/14/10 3:00 PM	0.20	0.20	0.18
8/14/10 5:00 PM	0.20	0.20	0.17
8/14/10 7:00 PM	0.19	0.19	0.16
8/14/10 9:00 PM	0.20	0.20	0.16
8/14/10 11:00 PM	0.20	0.20	0.14
8/15/10 1:00 AM	0.21	0.21	0.12
8/15/10 3:00 AM	0.22	0.22	0.13
8/15/10 5:00 AM	0.23	0.23	0.15
8/15/10 7:00 AM	0.24	0.24	0.16
8/15/10 9:00 AM	0.23	0.23	0.16
8/15/10 11:00 AM	0.23	0.23	0.17
8/15/10 1:00 PM	0.22	0.22	0.17
8/15/10 3:00 PM	0.23	0.23	0.18
8/15/10 5:00 PM	0.22	0.22	0.19
8/15/10 7:00 PM	0.22	0.22	0.17

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
8/15/10 9:00 PM	0.23	0.23	0.06
8/15/10 11:00 PM	0.23	0.23	0.05
8/16/10 1:00 AM	0.23	0.23	0.05
8/16/10 3:00 AM	0.23	0.23	0.05
8/16/10 5:00 AM	0.24	0.24	0.06
8/16/10 7:00 AM	0.24	0.24	0.08
8/16/10 9:00 AM	0.24	0.24	0.08
8/16/10 11:00 AM	0.25	0.25	0.09
8/16/10 1:00 PM	0.27	0.27	0.09
8/16/10 3:00 PM	0.27	0.27	0.09
8/16/10 5:00 PM	0.25	0.25	0.08
8/16/10 7:00 PM	0.25	0.25	0.07
8/16/10 9:00 PM	0.25	0.25	0.05
8/16/10 11:00 PM	0.24	0.24	0.03
8/17/10 1:00 AM	0.24	0.24	0.03
8/17/10 3:00 AM	0.23	0.23	0.03
8/17/10 5:00 AM	0.23	0.23	0.03
8/17/10 7:00 AM	0.23	0.23	0.07
8/17/10 9:00 AM	0.22	0.22	0.10
8/17/10 11:00 AM	0.22	0.22	0.10
8/17/10 1:00 PM	0.23	0.23	0.11
8/17/10 3:00 PM	0.22	0.22	0.13
8/17/10 5:00 PM	0.22	0.22	0.10
8/17/10 7:00 PM	0.22	0.22	0.10
8/17/10 9:00 PM	0.23	0.23	0.10
8/17/10 11:00 PM	0.19	0.19	0.08
8/18/10 1:00 AM	0.18	0.18	0.04
8/18/10 3:00 AM	0.17	0.17	0.03
8/18/10 5:00 AM	0.18	0.18	0.03
8/18/10 7:00 AM	0.19	0.19	0.06
8/18/10 9:00 AM	0.25	0.25	0.14
8/18/10 11:00 AM	0.25	0.25	0.15
8/18/10 1:00 PM	0.25	0.25	0.11
8/18/10 3:00 PM	0.24	0.24	0.11
8/18/10 5:00 PM	0.24	0.24	0.11
8/18/10 7:00 PM	0.22	0.22	0.12
8/18/10 9:00 PM	0.22	0.22	0.13
8/18/10 11:00 PM	0.15	0.15	0.10
8/19/10 1:00 AM	0.14	0.14	0.04
8/19/10 3:00 AM	0.14	0.14	0.05
8/19/10 5:00 AM	0.14	0.14	0.07
8/19/10 7:00 AM	0.21	0.21	0.12
8/19/10 9:00 AM	0.22	0.22	0.11
8/19/10 11:00 AM	0.22	0.22	0.11
8/19/10 1:00 PM	0.21	0.21	0.13
8/19/10 3:00 PM	0.21	0.21	0.13
8/19/10 5:00 PM	0.20	0.20	0.13
8/19/10 7:00 PM	0.19	0.19	0.12
8/19/10 9:00 PM	0.19	0.19	0.10
8/19/10 11:00 PM	0.20	0.20	0.05
8/20/10 1:00 AM	0.21	0.21	0.05
8/20/10 3:00 AM	0.21	0.21	0.05
8/20/10 5:00 AM	0.20	0.20	0.08

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
8/20/10 7:00 AM	0.21	0.21	0.19
8/20/10 9:00 AM	0.15	0.15	0.25
8/20/10 11:00 AM	0.08	0.08	0.23
8/20/10 1:00 PM	0.06	0.06	0.23
8/20/10 3:00 PM	0.07	0.07	0.23
8/20/10 5:00 PM	0.07	0.07	0.25
8/20/10 7:00 PM	0.07	0.07	0.21
8/20/10 9:00 PM	0.07	0.07	0.09
8/20/10 11:00 PM	0.08	0.08	0.07
8/21/10 1:00 AM	0.08	0.08	0.08
8/21/10 3:00 AM	0.08	0.08	0.08
8/21/10 5:00 AM	0.08	0.08	0.08
8/21/10 7:00 AM	0.09	0.09	0.09
8/21/10 9:00 AM	0.08	0.08	0.09
8/21/10 11:00 AM	0.08	0.08	0.10
8/21/10 1:00 PM	0.08	0.08	0.10
8/21/10 3:00 PM	0.08	0.08	0.09
8/21/10 5:00 PM	0.07	0.07	0.09
8/21/10 7:00 PM	0.07	0.07	0.10
8/21/10 9:00 PM	0.07	0.07	0.10
8/21/10 11:00 PM	0.08	0.08	0.10
8/22/10 1:00 AM	0.11	0.00	0.10
8/22/10 3:00 AM	0.13	0.00	0.08
8/22/10 5:00 AM	0.13	0.00	0.06
8/22/10 7:00 AM	0.13	0.00	0.07
8/22/10 9:00 AM	0.20	0.00	0.09
8/22/10 11:00 AM	0.20	0.00	0.10
8/22/10 1:00 PM	0.22	0.00	0.11
8/22/10 3:00 PM	0.22	0.00	0.12
8/22/10 5:00 PM	0.22	0.00	0.12
8/22/10 7:00 PM	0.21	0.00	0.10
8/22/10 9:00 PM	0.21	0.00	0.07
8/22/10 11:00 PM	0.21	0.00	0.08
8/23/10 1:00 AM	0.22	0.00	0.10
8/23/10 3:00 AM	0.22	0.00	0.10
8/23/10 5:00 AM	0.21	0.00	0.14
8/23/10 7:00 AM	0.21	0.00	0.15
8/23/10 9:00 AM	0.21	0.00	0.11
8/23/10 11:00 AM	0.23	0.00	0.09
8/23/10 1:00 PM	0.23	0.00	0.08
8/23/10 3:00 PM	0.23	0.00	0.09
8/23/10 5:00 PM	0.23	0.00	0.08
8/23/10 7:00 PM	0.23	0.00	0.08
8/23/10 9:00 PM	0.20	0.00	0.07
8/23/10 11:00 PM	0.14	0.00	0.07
8/24/10 1:00 AM	0.13	0.00	0.07
8/24/10 3:00 AM	0.14	0.00	0.91
8/24/10 5:00 AM	0.18	0.00	0.07
8/24/10 7:00 AM	0.22	0.00	0.07
8/24/10 9:00 AM	0.22	0.00	0.08
8/24/10 11:00 AM	0.25	0.00	0.08
8/24/10 1:00 PM	0.26	0.00	0.07
8/24/10 3:00 PM	0.24	0.00	0.07

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
8/24/10 5:00 PM	0.24	0.00	0.07
8/24/10 7:00 PM	0.24	0.00	0.07
8/24/10 9:00 PM	0.22	0.00	0.07
8/24/10 11:00 PM	0.08	0.00	0.07
8/25/10 1:00 AM	0.07	0.00	0.07
8/25/10 3:00 AM	0.08	0.00	0.07
8/25/10 5:00 AM	0.08	0.00	0.09
8/25/10 7:00 AM	0.07	0.00	0.08
8/25/10 9:00 AM	0.09	0.00	0.08
8/25/10 11:00 AM	0.10	0.00	0.08
8/25/10 1:00 PM	0.11	0.00	0.08
8/25/10 3:00 PM	0.10	0.00	0.08
8/25/10 5:00 PM	0.10	0.00	0.08
8/25/10 7:00 PM	0.09	0.00	0.08
8/25/10 9:00 PM	0.07	0.00	0.08
8/25/10 11:00 PM	0.07	0.00	0.08
8/26/10 1:00 AM	0.07	0.00	0.08
8/26/10 3:00 AM	0.07	0.00	0.08
8/26/10 5:00 AM	0.09	0.00	0.08
8/26/10 7:00 AM	0.12	0.00	0.08
8/26/10 9:00 AM	0.15	0.00	0.08
8/26/10 11:00 AM	0.21	0.00	0.08
8/26/10 1:00 PM	0.22	0.00	0.08
8/26/10 3:00 PM	0.21	0.00	0.08
8/26/10 5:00 PM	0.21	0.00	0.10
8/26/10 7:00 PM	0.21	0.00	0.09
8/26/10 9:00 PM	0.15	0.00	0.09
8/26/10 11:00 PM	0.17	0.00	0.08
8/27/10 1:00 AM	0.19	0.00	0.08
8/27/10 3:00 AM	0.18	0.00	0.08
8/27/10 5:00 AM	0.18	0.00	0.08
8/27/10 7:00 AM	0.18	0.00	0.08
8/27/10 9:00 AM	0.20	0.00	0.08
8/27/10 11:00 AM	0.19	0.00	0.07
8/27/10 1:00 PM	0.16	0.00	0.07
8/27/10 3:00 PM	0.16	0.00	0.07
8/27/10 5:00 PM	0.18	0.00	0.07
8/27/10 7:00 PM	0.16	0.00	0.07
8/27/10 9:00 PM	0.13	0.00	0.07
8/27/10 11:00 PM	0.13	0.00	0.07
8/28/10 1:00 AM	0.13	0.00	0.05
8/28/10 3:00 AM	0.11	0.00	0.05
8/28/10 5:00 AM	0.11	0.00	0.05
8/28/10 7:00 AM	0.11	0.00	0.05
8/28/10 9:00 AM	0.12	0.00	0.07
8/28/10 11:00 AM	0.14	0.00	0.08
8/28/10 1:00 PM	0.14	0.00	0.08
8/28/10 3:00 PM	0.14	0.00	0.08
8/28/10 5:00 PM	0.13	0.00	0.08
8/28/10 7:00 PM	0.14	0.00	0.08
8/28/10 9:00 PM	0.14	0.00	0.08
8/28/10 11:00 PM	0.14	0.00	0.08
8/29/10 1:00 AM	0.14	0.00	0.08

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
8/29/10 3:00 AM	0.14	0.00	0.08
8/29/10 5:00 AM	0.14	0.00	0.08
8/29/10 7:00 AM	0.14	0.00	0.08
8/29/10 9:00 AM	0.14	0.00	0.08
8/29/10 11:00 AM	0.14	0.00	0.08
8/29/10 1:00 PM	0.14	0.00	0.08
8/29/10 3:00 PM	0.14	0.00	0.08
8/29/10 5:00 PM	0.13	0.00	0.09
8/29/10 7:00 PM	0.14	0.00	0.10
8/29/10 9:00 PM	0.14	0.00	0.10
8/29/10 11:00 PM	0.14	0.00	0.09
8/30/10 1:00 AM	0.14	0.00	0.10
8/30/10 3:00 AM	0.14	0.00	0.10
8/30/10 5:00 AM	0.14	0.00	0.10
8/30/10 7:00 AM	0.14	0.00	0.10
8/30/10 9:00 AM	0.15	0.00	0.10
8/30/10 11:00 AM	0.15	0.00	0.09
8/30/10 1:00 PM	0.15	0.00	0.09
8/30/10 3:00 PM	0.15	0.00	0.10
8/30/10 5:00 PM	0.15	0.00	0.10
8/30/10 7:00 PM	0.14	0.00	0.10
8/30/10 9:00 PM	0.14	0.00	0.09
8/30/10 11:00 PM	0.14	0.00	0.09
8/31/10 1:00 AM	0.14	0.00	0.09
8/31/10 3:00 AM	0.14	0.00	0.09
8/31/10 5:00 AM	0.14	0.00	0.09
8/31/10 7:00 AM	0.14	0.00	0.09
8/31/10 9:00 AM	0.14	0.00	0.09
8/31/10 11:00 AM	0.14	0.00	0.07
8/31/10 1:00 PM	0.14	0.00	0.07
8/31/10 3:00 PM	0.15	0.00	0.06
8/31/10 5:00 PM	0.15	0.00	0.06
8/31/10 7:00 PM	0.15	0.00	0.06
8/31/10 9:00 PM	0.15	0.00	0.06
8/31/10 11:00 PM	0.14	0.00	0.06
9/1/10 1:00 AM	0.11	0.11	0.06
9/1/10 3:00 AM	0.11	0.11	0.06
9/1/10 5:00 AM	0.14	0.14	0.06
9/1/10 7:00 AM	0.28	0.28	0.06
9/1/10 9:00 AM	0.26	0.26	0.06
9/1/10 11:00 AM	0.25	0.00	0.06
9/1/10 1:00 PM	0.24	0.00	0.06
9/1/10 3:00 PM	0.14	0.00	0.06
9/1/10 5:00 PM	0.14	0.00	0.05
9/1/10 7:00 PM	0.14	0.00	0.06
9/1/10 9:00 PM	0.13	0.00	0.06
9/1/10 11:00 PM	0.12	0.00	0.05
9/2/10 1:00 AM	0.11	0.00	0.04
9/2/10 3:00 AM	0.12	0.00	0.04
9/2/10 5:00 AM	0.13	0.00	0.05
9/2/10 7:00 AM	0.13	0.00	0.06
9/2/10 9:00 AM	0.13	0.00	0.06
9/2/10 11:00 AM	0.13	0.00	0.06

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
9/2/10 1:00 PM	0.13	0.00	0.06
9/2/10 3:00 PM	0.12	0.00	0.06
9/2/10 5:00 PM	0.12	0.12	0.06
9/2/10 7:00 PM	0.13	0.13	0.06
9/2/10 9:00 PM	0.14	0.14	0.06
9/2/10 11:00 PM	0.14	0.14	0.06
9/3/10 1:00 AM	0.14	0.14	0.06
9/3/10 3:00 AM	0.13	0.13	0.06
9/3/10 5:00 AM	0.11	0.11	0.06
9/3/10 7:00 AM	0.10	0.10	0.10
9/3/10 9:00 AM	0.12	0.12	0.14
9/3/10 11:00 AM	0.11	0.11	0.11
9/3/10 1:00 PM	0.11	0.11	0.09
9/3/10 3:00 PM	0.11	0.11	0.05
9/3/10 5:00 PM	0.10	0.10	0.05
9/3/10 7:00 PM	0.11	0.11	0.06
9/3/10 9:00 PM	0.11	0.11	0.05
9/3/10 11:00 PM	0.11	0.11	0.04
9/4/10 1:00 AM	0.11	0.11	0.06
9/4/10 3:00 AM	0.10	0.10	0.09
9/4/10 5:00 AM	0.10	0.10	0.09
9/4/10 7:00 AM	0.10	0.10	0.10
9/4/10 9:00 AM	0.10	0.10	0.14
9/4/10 11:00 AM	0.10	0.10	0.14
9/4/10 1:00 PM	0.10	0.10	0.13
9/4/10 3:00 PM	0.10	0.10	0.13
9/4/10 5:00 PM	0.16	0.16	0.14
9/4/10 7:00 PM	0.16	0.16	0.15
9/4/10 9:00 PM	0.15	0.15	0.15
9/4/10 11:00 PM	0.16	0.16	0.10
9/5/10 1:00 AM	0.16	0.16	0.10
9/5/10 3:00 AM	0.16	0.16	0.10
9/5/10 5:00 AM	0.16	0.16	0.10
9/5/10 7:00 AM	0.16	0.16	0.11
9/5/10 9:00 AM	0.12	0.12	0.16
9/5/10 11:00 AM	0.12	0.12	0.17
9/5/10 1:00 PM	0.12	0.12	0.16
9/5/10 3:00 PM	0.11	0.11	0.16
9/5/10 5:00 PM	0.11	0.11	0.16
9/5/10 7:00 PM	0.11	0.11	0.17
9/5/10 9:00 PM	0.11	0.11	0.13
9/5/10 11:00 PM	0.12	0.12	0.11
9/6/10 1:00 AM	0.11	0.11	0.11
9/6/10 3:00 AM	0.12	0.12	0.11
9/6/10 5:00 AM	0.12	0.12	0.12
9/6/10 7:00 AM	0.12	0.12	0.17
9/6/10 9:00 AM	0.12	0.12	0.17
9/6/10 11:00 AM	0.12	0.12	0.17
9/6/10 1:00 PM	0.12	0.12	0.17
9/6/10 3:00 PM	0.12	0.12	0.17
9/6/10 5:00 PM	0.11	0.11	0.13
9/6/10 7:00 PM	0.12	0.12	0.12
9/6/10 9:00 PM	0.12	0.12	0.12

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
9/6/10 11:00 PM	0.10	0.10	0.13
9/7/10 1:00 AM	0.10	0.10	0.14
9/7/10 3:00 AM	0.10	0.10	0.14
9/7/10 5:00 AM	0.12	0.12	0.14
9/7/10 7:00 AM	0.11	0.11	0.15
9/7/10 9:00 AM	0.12	0.12	0.14
9/7/10 11:00 AM	0.12	0.12	0.07
9/7/10 1:00 PM	0.12	0.12	0.11
9/7/10 3:00 PM	0.12	0.12	0.18
9/7/10 5:00 PM	0.12	0.12	0.18
9/7/10 7:00 PM	0.12	0.12	0.18
9/7/10 9:00 PM	0.12	0.12	0.18
9/7/10 11:00 PM	0.12	0.12	0.18
9/8/10 1:00 AM	0.12	0.12	0.20
9/8/10 3:00 AM	0.12	0.12	0.21
9/8/10 5:00 AM	0.12	0.12	0.21
9/8/10 7:00 AM	0.12	0.12	0.22
9/8/10 9:00 AM	0.12	0.12	0.22
9/8/10 11:00 AM	0.12	0.12	0.23
9/8/10 1:00 PM	0.11	0.11	0.23
9/8/10 3:00 PM	0.11	0.11	0.21
9/8/10 5:00 PM	0.11	0.11	0.21
9/8/10 7:00 PM	0.12	0.12	0.21
9/8/10 9:00 PM	0.12	0.12	0.21
9/8/10 11:00 PM	0.12	0.12	0.20
9/9/10 1:00 AM	0.11	0.11	0.19
9/9/10 3:00 AM	0.11	0.11	0.19
9/9/10 5:00 AM	0.11	0.11	0.18
9/9/10 7:00 AM	0.11	0.11	0.19
9/9/10 9:00 AM	0.12	0.12	0.20
9/9/10 11:00 AM	0.14	0.14	0.20
9/9/10 1:00 PM	0.12	0.12	0.24
9/9/10 3:00 PM	0.11	0.11	0.18
9/9/10 5:00 PM	0.11	0.11	0.18
9/9/10 7:00 PM	0.11	0.11	0.16
9/9/10 9:00 PM	0.11	0.11	0.15
9/9/10 11:00 PM	0.12	0.12	0.15
9/10/10 1:00 AM	0.12	0.12	0.14
9/10/10 3:00 AM	0.12	0.12	0.13
9/10/10 5:00 AM	0.12	0.12	0.13
9/10/10 7:00 AM	0.12	0.12	0.12
9/10/10 9:00 AM	0.12	0.12	0.12
9/10/10 11:00 AM	0.12	0.12	0.12
9/10/10 1:00 PM	0.16	0.16	0.11
9/10/10 3:00 PM	0.24	0.24	0.12
9/10/10 5:00 PM	0.24	0.24	0.12
9/10/10 7:00 PM	0.24	0.24	0.12
9/10/10 9:00 PM	0.24	0.24	0.12
9/10/10 11:00 PM	0.23	0.23	0.12
9/11/10 1:00 AM	0.22	0.22	0.10
9/11/10 3:00 AM	0.21	0.21	0.10
9/11/10 5:00 AM	0.21	0.21	0.10
9/11/10 7:00 AM	0.22	0.22	0.14

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
9/11/10 9:00 AM	0.22	0.22	0.16
9/11/10 11:00 AM	0.21	0.21	0.16
9/11/10 1:00 PM	0.20	0.20	0.16
9/11/10 3:00 PM	0.21	0.21	0.16
9/11/10 5:00 PM	0.21	0.21	0.14
9/11/10 7:00 PM	0.22	0.22	0.13
9/11/10 9:00 PM	0.22	0.22	0.13
9/11/10 11:00 PM	0.23	0.23	0.13
9/12/10 1:00 AM	0.29	0.29	0.13
9/12/10 3:00 AM	0.30	0.30	0.13
9/12/10 5:00 AM	0.30	0.30	0.13
9/12/10 7:00 AM	0.26	0.26	0.13
9/12/10 9:00 AM	0.27	0.27	0.13
9/12/10 11:00 AM	0.29	0.29	0.13
9/12/10 1:00 PM	0.30	0.30	0.13
9/12/10 3:00 PM	0.27	0.27	0.13
9/12/10 5:00 PM	0.33	0.33	0.13
9/12/10 7:00 PM	0.29	0.29	0.14
9/12/10 9:00 PM	0.32	0.32	0.15
9/12/10 11:00 PM	0.34	0.34	0.16
9/13/10 1:00 AM	0.33	0.33	0.15
9/13/10 3:00 AM	0.33	0.33	0.14
9/13/10 5:00 AM	0.32	0.32	0.14
9/13/10 7:00 AM	0.33	0.33	0.14
9/13/10 9:00 AM	0.31	0.31	0.13
9/13/10 11:00 AM	0.28	0.28	0.14
9/13/10 1:00 PM	0.24	0.24	0.13
9/13/10 3:00 PM	0.18	0.18	0.12
9/13/10 5:00 PM	0.17	0.17	0.14
9/13/10 7:00 PM	0.15	0.15	0.14
9/13/10 9:00 PM	0.17	0.17	0.14
9/13/10 11:00 PM	0.09	0.09	0.13
9/14/10 1:00 AM	0.08	0.08	0.13
9/14/10 3:00 AM	0.09	0.09	0.13
9/14/10 5:00 AM	0.09	0.09	0.13
9/14/10 7:00 AM	0.09	0.09	0.14
9/14/10 9:00 AM	0.12	0.12	0.14
9/14/10 11:00 AM	0.10	0.10	0.15
9/14/10 1:00 PM	0.09	0.09	0.14
9/14/10 3:00 PM	0.07	0.07	0.14
9/14/10 5:00 PM	0.05	0.05	0.13
9/14/10 7:00 PM	0.03	0.03	0.13
9/14/10 9:00 PM	0.09	0.09	0.13
9/14/10 11:00 PM	0.10	0.10	0.13
9/15/10 1:00 AM	0.09	0.09	0.12
9/15/10 3:00 AM	0.08	0.08	0.12
9/15/10 5:00 AM	0.08	0.08	0.12
9/15/10 7:00 AM	0.08	0.08	0.12
9/15/10 9:00 AM	0.09	0.09	0.12
9/15/10 11:00 AM	0.10	0.10	0.12
9/15/10 1:00 PM	0.10	0.10	0.13
9/15/10 3:00 PM	0.11	0.11	0.13
9/15/10 5:00 PM	0.11	0.11	0.12

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
9/15/10 7:00 PM	0.10	0.10	0.12
9/15/10 9:00 PM	0.11	0.11	0.12
9/15/10 11:00 PM	0.11	0.11	0.12
9/16/10 1:00 AM	0.12	0.12	0.13
9/16/10 3:00 AM	0.11	0.11	0.12
9/16/10 5:00 AM	0.11	0.11	0.13
9/16/10 7:00 AM	0.11	0.11	0.14
9/16/10 9:00 AM	0.11	0.11	0.14
9/16/10 11:00 AM	0.11	0.11	0.14
9/16/10 1:00 PM	0.10	0.10	0.14
9/16/10 3:00 PM	0.11	0.11	0.15
9/16/10 5:00 PM	0.10	0.10	0.16
9/16/10 7:00 PM	0.10	0.10	0.18
9/16/10 9:00 PM	0.11	0.11	0.18
9/16/10 11:00 PM	0.11	0.11	0.18
9/17/10 1:00 AM	0.11	0.11	0.17
9/17/10 3:00 AM	0.11	0.11	0.16
9/17/10 5:00 AM	0.11	0.11	0.15
9/17/10 7:00 AM	0.11	0.11	0.15
9/17/10 9:00 AM	0.11	0.11	0.15
9/17/10 11:00 AM	0.11	0.11	0.14
9/17/10 1:00 PM	0.10	0.10	0.15
9/17/10 3:00 PM	0.10	0.10	0.15
9/17/10 5:00 PM	0.11	0.11	0.15
9/17/10 7:00 PM	0.12	0.12	0.14
9/17/10 9:00 PM	0.12	0.12	0.14
9/17/10 11:00 PM	0.12	0.12	0.14
9/18/10 1:00 AM	0.12	0.12	0.14
9/18/10 3:00 AM	0.11	0.11	0.13
9/18/10 5:00 AM	0.11	0.11	0.13
9/18/10 7:00 AM	0.12	0.12	0.14
9/18/10 9:00 AM	0.11	0.11	0.14
9/18/10 11:00 AM	0.12	0.12	0.14
9/18/10 1:00 PM	0.11	0.11	0.14
9/18/10 3:00 PM	0.11	0.11	0.14
9/18/10 5:00 PM	0.11	0.11	0.15
9/18/10 7:00 PM	0.12	0.12	0.16
9/18/10 9:00 PM	0.12	0.12	0.17
9/18/10 11:00 PM	0.12	0.12	0.17
9/19/10 1:00 AM	0.12	0.12	0.17
9/19/10 3:00 AM	0.11	0.11	0.17
9/19/10 5:00 AM	0.12	0.12	0.17
9/19/10 7:00 AM	0.12	0.12	0.19
9/19/10 9:00 AM	0.12	0.12	0.20
9/19/10 11:00 AM	0.12	0.12	0.20
9/19/10 1:00 PM	0.12	0.12	0.21
9/19/10 3:00 PM	0.11	0.11	0.21
9/19/10 5:00 PM	0.12	0.12	0.24
9/19/10 7:00 PM	0.12	0.12	0.55
9/19/10 9:00 PM	0.12	0.12	0.16
9/19/10 11:00 PM	0.11	0.11	0.17
9/20/10 1:00 AM	0.13	0.13	0.20
9/20/10 3:00 AM	0.14	0.14	0.21

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
9/20/10 5:00 AM	0.13	0.13	0.20
9/20/10 7:00 AM	0.13	0.13	0.20
9/20/10 9:00 AM	0.14	0.14	0.19
9/20/10 11:00 AM	0.13	0.13	0.18
9/20/10 1:00 PM	0.13	0.13	0.17
9/20/10 3:00 PM	0.13	0.13	0.19
9/20/10 5:00 PM	0.13	0.13	0.17
9/20/10 7:00 PM	0.03	0.03	0.17
9/20/10 9:00 PM	0.03	0.03	0.17
9/20/10 11:00 PM	0.03	0.03	0.16
9/21/10 1:00 AM	0.03	0.03	0.16
9/21/10 3:00 AM	0.03	0.03	0.15
9/21/10 5:00 AM	0.03	0.03	0.15
9/21/10 7:00 AM	0.03	0.03	0.15
9/21/10 9:00 AM	0.03	0.03	0.21
9/21/10 11:00 AM	0.13	0.13	0.14
9/21/10 1:00 PM	0.12	0.12	0.14
9/21/10 3:00 PM	0.12	0.12	0.13
9/21/10 5:00 PM	0.13	0.13	0.12
9/21/10 7:00 PM	0.13	0.13	0.12
9/21/10 9:00 PM	0.13	0.13	0.13
9/21/10 11:00 PM	0.13	0.13	0.12
9/22/10 1:00 AM	0.13	0.13	0.12
9/22/10 3:00 AM	0.13	0.13	0.12
9/22/10 5:00 AM	0.13	0.13	0.12
9/22/10 7:00 AM	0.13	0.13	0.12
9/22/10 9:00 AM	0.13	0.13	0.25
9/22/10 11:00 AM	0.13	0.13	0.12
9/22/10 1:00 PM	0.12	0.12	0.13
9/22/10 3:00 PM	0.12	0.12	0.13
9/22/10 5:00 PM	0.13	0.13	0.13
9/22/10 7:00 PM	0.13	0.13	0.13
9/22/10 9:00 PM	0.12	0.12	0.13
9/22/10 11:00 PM	0.12	0.12	0.13
9/23/10 1:00 AM	0.12	0.12	0.13
9/23/10 3:00 AM	0.10	0.10	0.13
9/23/10 5:00 AM	0.11	0.11	0.13
9/23/10 7:00 AM	0.13	0.13	0.13
9/23/10 9:00 AM	0.12	0.12	0.14
9/23/10 11:00 AM	0.11	0.11	0.14
9/23/10 1:00 PM	0.11	0.11	0.14
9/23/10 3:00 PM	0.11	0.11	0.14
9/23/10 5:00 PM	0.12	0.12	0.14
9/23/10 7:00 PM	0.14	0.14	0.14
9/23/10 9:00 PM	0.14	0.14	0.14
9/23/10 11:00 PM	0.14	0.14	0.14
9/24/10 1:00 AM	0.14	0.14	0.13
9/24/10 3:00 AM	0.13	0.13	0.14
9/24/10 5:00 AM	0.13	0.13	0.13
9/24/10 7:00 AM	0.13	0.13	0.12
9/24/10 9:00 AM	0.14	0.14	0.13
9/24/10 11:00 AM	0.13	0.13	0.14
9/24/10 1:00 PM	0.13	0.13	0.12

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
9/24/10 3:00 PM	0.13	0.13	0.12
9/24/10 5:00 PM	0.13	0.13	0.13
9/24/10 7:00 PM	0.13	0.13	0.12
9/24/10 9:00 PM	0.13	0.13	0.12
9/24/10 11:00 PM	0.13	0.13	0.12
9/25/10 1:00 AM	0.13	0.13	0.12
9/25/10 3:00 AM	0.13	0.13	0.12
9/25/10 5:00 AM	0.13	0.13	0.12
9/25/10 7:00 AM	0.13	0.13	0.12
9/25/10 9:00 AM	0.13	0.13	0.13
9/25/10 11:00 AM	0.12	0.12	0.13
9/25/10 1:00 PM	0.12	0.12	0.13
9/25/10 3:00 PM	0.12	0.12	0.13
9/25/10 5:00 PM	0.12	0.12	0.14
9/25/10 7:00 PM	0.12	0.12	0.14
9/25/10 9:00 PM	0.12	0.12	0.14
9/25/10 11:00 PM	0.13	0.13	0.14
9/26/10 1:00 AM	0.13	0.13	0.14
9/26/10 3:00 AM	0.13	0.13	0.12
9/26/10 5:00 AM	0.13	0.13	0.12
9/26/10 7:00 AM	0.13	0.13	0.16
9/26/10 9:00 AM	0.13	0.13	0.16
9/26/10 11:00 AM	0.12	0.12	0.14
9/26/10 1:00 PM	0.11	0.11	0.17
9/26/10 3:00 PM	0.11	0.11	0.17
9/26/10 5:00 PM	0.11	0.11	0.16
9/26/10 7:00 PM	0.12	0.12	0.14
9/26/10 9:00 PM	0.12	0.12	0.15
9/26/10 11:00 PM	0.12	0.12	0.15
9/27/10 1:00 AM	0.12	0.12	0.14
9/27/10 3:00 AM	0.12	0.12	0.15
9/27/10 5:00 AM	0.13	0.13	0.14
9/27/10 7:00 AM	0.13	0.13	0.15
9/27/10 9:00 AM	0.13	0.13	0.15
9/27/10 11:00 AM	0.12	0.12	0.15
9/27/10 1:00 PM	0.10	0.10	0.15
9/27/10 3:00 PM	0.10	0.10	0.15
9/27/10 5:00 PM	0.10	0.10	0.14
9/27/10 7:00 PM	0.11	0.11	0.14
9/27/10 9:00 PM	0.09	0.09	0.14
9/27/10 11:00 PM	0.04	0.04	0.14
9/28/10 1:00 AM	0.00	0.00	0.14
9/28/10 3:00 AM	0.00	0.00	0.14
9/28/10 5:00 AM	0.00	0.00	0.14
9/28/10 7:00 AM	0.00	0.00	0.14
9/28/10 9:00 AM	0.00	0.00	0.14
9/28/10 11:00 AM	0.00	0.00	0.13
9/28/10 1:00 PM	0.00	0.00	0.14
9/28/10 3:00 PM	0.00	0.00	0.15
9/28/10 5:00 PM	0.00	0.00	0.14
9/28/10 7:00 PM	0.00	0.00	0.14
9/28/10 9:00 PM	0.00	0.00	0.15
9/28/10 11:00 PM	0.00	0.00	0.15

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
9/29/10 1:00 AM	0.00	0.00	0.16
9/29/10 3:00 AM	0.00	0.00	0.16
9/29/10 5:00 AM	0.00	0.00	0.15
9/29/10 7:00 AM	0.00	0.00	0.16
9/29/10 9:00 AM	0.00	0.00	0.18
9/29/10 11:00 AM	0.00	0.00	0.19
9/29/10 1:00 PM	0.00	0.00	0.20
9/29/10 3:00 PM	0.00	0.00	0.16
9/29/10 5:00 PM	0.00	0.00	0.19
9/29/10 7:00 PM	0.00	0.00	0.18
9/29/10 9:00 PM	0.00	0.00	0.19
9/29/10 11:00 PM	0.00	0.00	0.19
9/30/10 1:00 AM	0.00	0.00	0.19
9/30/10 3:00 AM	0.00	0.00	0.19
9/30/10 5:00 AM	0.00	0.00	0.18
9/30/10 7:00 AM	0.00	0.00	0.20
9/30/10 9:00 AM	0.00	0.00	0.21
9/30/10 11:00 AM	0.00	0.00	0.20
9/30/10 1:00 PM	0.00	0.00	0.19
9/30/10 3:00 PM	0.00	0.00	0.18
9/30/10 5:00 PM	0.00	0.00	0.17
9/30/10 7:00 PM	0.00	0.00	0.17
9/30/10 9:00 PM	0.00	0.00	0.19
9/30/10 11:00 PM	0.00	0.00	0.18
10/1/10 1:00 AM	0.00	0.00	0.18
10/1/10 3:00 AM	0.00	0.00	0.19
10/1/10 5:00 AM	0.00	0.00	0.19
10/1/10 7:00 AM	0.00	0.00	0.20
10/1/10 9:00 AM	0.00	0.00	0.19
10/1/10 11:00 AM	0.00	0.00	0.18
10/1/10 1:00 PM	0.00	0.00	0.18
10/1/10 3:00 PM	0.00	0.00	0.19
10/1/10 5:00 PM	0.00	0.00	0.18
10/1/10 7:00 PM	0.00	0.00	0.18
10/1/10 9:00 PM	0.00	0.00	0.18
10/1/10 11:00 PM	0.00	0.00	0.18
10/2/10 1:00 AM	0.00	0.00	0.18
10/2/10 3:00 AM	0.00	0.00	0.19
10/2/10 5:00 AM	0.00	0.00	0.20
10/2/10 7:00 AM	0.00	0.00	0.20
10/2/10 9:00 AM	0.00	0.00	0.20
10/2/10 11:00 AM	0.00	0.00	0.21
10/2/10 1:00 PM	0.00	0.00	0.23
10/2/10 3:00 PM	0.00	0.00	0.23
10/2/10 5:00 PM	0.00	0.00	0.21
10/2/10 7:00 PM	0.00	0.00	0.14
10/2/10 9:00 PM	0.00	0.00	0.14
10/2/10 11:00 PM	0.00	0.00	0.14
10/3/10 1:00 AM	0.00	0.00	0.15
10/3/10 3:00 AM	0.00	0.00	0.15
10/3/10 5:00 AM	0.00	0.00	0.16
10/3/10 7:00 AM	0.00	0.00	0.15
10/3/10 9:00 AM	0.00	0.00	0.14

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
10/3/10 11:00 AM	0.00	0.00	0.14
10/3/10 1:00 PM	0.00	0.00	0.14
10/3/10 3:00 PM	0.00	0.00	0.15
10/3/10 5:00 PM	0.11	0.11	0.16
10/3/10 7:00 PM	0.23	0.23	0.17
10/3/10 9:00 PM	0.35	0.35	0.17
10/3/10 11:00 PM	0.42	0.42	0.18
10/4/10 1:00 AM	0.42	0.42	0.15
10/4/10 3:00 AM	0.39	0.39	0.15
10/4/10 5:00 AM	0.39	0.39	0.17
10/4/10 7:00 AM	0.38	0.38	0.17
10/4/10 9:00 AM	0.36	0.36	0.18
10/4/10 11:00 AM	0.36	0.36	0.19
10/4/10 1:00 PM	0.34	0.34	0.18
10/4/10 3:00 PM	0.29	0.29	0.19
10/4/10 5:00 PM	0.13	0.13	0.19
10/4/10 7:00 PM	0.14	0.14	0.19
10/4/10 9:00 PM	0.15	0.15	0.19
10/4/10 11:00 PM	0.15	0.15	0.13
10/5/10 1:00 AM	0.12	0.12	0.12
10/5/10 3:00 AM	0.12	0.12	0.13
10/5/10 5:00 AM	0.12	0.12	0.14
10/5/10 7:00 AM	0.15	0.15	0.16
10/5/10 9:00 AM	0.16	0.16	0.15
10/5/10 11:00 AM	0.15	0.15	0.15
10/5/10 1:00 PM	0.15	0.15	0.16
10/5/10 3:00 PM	0.14	0.14	0.16
10/5/10 5:00 PM	0.14	0.14	0.15
10/5/10 7:00 PM	0.15	0.15	0.15
10/5/10 9:00 PM	0.15	0.15	0.15
10/5/10 11:00 PM	0.07	0.07	0.15
10/6/10 1:00 AM	0.06	0.06	0.15
10/6/10 3:00 AM	0.06	0.06	0.15
10/6/10 5:00 AM	0.06	0.06	0.15
10/6/10 7:00 AM	0.12	0.12	0.15
10/6/10 9:00 AM	0.15	0.15	0.15
10/6/10 11:00 AM	0.15	0.15	0.15
10/6/10 1:00 PM	0.13	0.13	0.15
10/6/10 3:00 PM	0.13	0.13	0.16
10/6/10 5:00 PM	0.18	0.18	0.16
10/6/10 7:00 PM	0.27	0.27	0.15
10/6/10 9:00 PM	0.29	0.29	0.15
10/6/10 11:00 PM	0.23	0.23	0.14
10/7/10 1:00 AM	0.19	0.19	0.06
10/7/10 3:00 AM	0.22	0.22	0.00
10/7/10 5:00 AM	0.25	0.25	0.00
10/7/10 7:00 AM	0.31	0.31	0.00
10/7/10 9:00 AM	0.24	0.24	0.00
10/7/10 11:00 AM	0.23	0.23	0.00
10/7/10 1:00 PM	0.24	0.24	0.00
10/7/10 3:00 PM	0.24	0.24	0.00
10/7/10 5:00 PM	0.20	0.20	0.00
10/7/10 7:00 PM	0.18	0.18	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
10/7/10 9:00 PM	0.15	0.15	0.00
10/7/10 11:00 PM	0.10	0.10	0.00
10/8/10 1:00 AM	0.09	0.09	0.00
10/8/10 3:00 AM	0.12	0.12	0.00
10/8/10 5:00 AM	0.11	0.11	0.00
10/8/10 7:00 AM	0.12	0.12	0.00
10/8/10 9:00 AM	0.12	0.12	0.00
10/8/10 11:00 AM	0.11	0.11	0.00
10/8/10 1:00 PM	0.12	0.12	0.00
10/8/10 3:00 PM	0.12	0.12	0.00
10/8/10 5:00 PM	0.14	0.14	0.00
10/8/10 7:00 PM	0.14	0.14	0.00
10/8/10 9:00 PM	0.21	0.21	0.00
10/8/10 11:00 PM	0.26	0.26	0.00
10/9/10 1:00 AM	0.23	0.23	0.00
10/9/10 3:00 AM	0.21	0.21	0.00
10/9/10 5:00 AM	0.17	0.17	0.00
10/9/10 7:00 AM	0.20	0.20	0.00
10/9/10 9:00 AM	0.21	0.21	0.00
10/9/10 11:00 AM	0.16	0.16	0.00
10/9/10 1:00 PM	0.08	0.08	0.00
10/9/10 3:00 PM	0.10	0.10	0.00
10/9/10 5:00 PM	0.25	0.25	0.00
10/9/10 7:00 PM	0.22	0.22	0.00
10/9/10 9:00 PM	0.23	0.23	0.00
10/9/10 11:00 PM	0.22	0.22	0.00
10/10/10 1:00 AM	0.24	0.24	0.00
10/10/10 3:00 AM	0.23	0.23	0.00
10/10/10 5:00 AM	0.23	0.23	0.00
10/10/10 7:00 AM	0.24	0.24	0.00
10/10/10 9:00 AM	0.24	0.24	0.00
10/10/10 11:00 AM	0.22	0.22	0.00
10/10/10 1:00 PM	0.21	0.21	0.00
10/10/10 3:00 PM	0.22	0.22	0.00
10/10/10 5:00 PM	0.21	0.21	0.00
10/10/10 7:00 PM	0.21	0.21	0.00
10/10/10 9:00 PM	0.22	0.22	0.00
10/10/10 11:00 PM	0.23	0.23	0.00
10/11/10 1:00 AM	0.25	0.25	0.00
10/11/10 3:00 AM	0.26	0.26	0.00
10/11/10 5:00 AM	0.26	0.26	0.00
10/11/10 7:00 AM	0.26	0.26	0.00
10/11/10 9:00 AM	0.20	0.20	0.00
10/11/10 11:00 AM	0.09	0.09	0.00
10/11/10 1:00 PM	0.23	0.23	0.00
10/11/10 3:00 PM	0.25	0.25	0.00
10/11/10 5:00 PM	0.16	0.16	0.00
10/11/10 7:00 PM	0.21	0.21	0.00
10/11/10 9:00 PM	0.20	0.20	0.00
10/11/10 11:00 PM	0.17	0.17	0.00
10/12/10 1:00 AM	0.15	0.15	0.00
10/12/10 3:00 AM	0.15	0.15	0.00
10/12/10 5:00 AM	0.18	0.18	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
10/12/10 7:00 AM	0.21	0.21	0.00
10/12/10 9:00 AM	0.10	0.10	0.00
10/12/10 11:00 AM	0.12	0.12	0.00
10/12/10 1:00 PM	0.07	0.07	0.00
10/12/10 3:00 PM	0.05	0.05	0.00
10/12/10 5:00 PM	0.05	0.05	0.00
10/12/10 7:00 PM	0.06	0.06	0.00
10/12/10 9:00 PM	0.08	0.08	0.00
10/12/10 11:00 PM	0.12	0.12	0.00
10/13/10 1:00 AM	0.13	0.13	0.00
10/13/10 3:00 AM	0.13	0.13	0.00
10/13/10 5:00 AM	0.18	0.18	0.00
10/13/10 7:00 AM	0.18	0.18	0.00
10/13/10 9:00 AM	0.06	0.06	0.00
10/13/10 11:00 AM	0.06	0.06	0.00
10/13/10 1:00 PM	0.06	0.06	0.00
10/13/10 3:00 PM	0.06	0.06	0.00
10/13/10 5:00 PM	0.05	0.05	0.00
10/13/10 7:00 PM	0.05	0.05	0.00
10/13/10 9:00 PM	0.07	0.07	0.00
10/13/10 11:00 PM	0.13	0.13	0.00
10/14/10 1:00 AM	0.11	0.11	0.00
10/14/10 3:00 AM	0.10	0.10	0.00
10/14/10 5:00 AM	0.14	0.14	0.00
10/14/10 7:00 AM	0.04	0.04	0.00
10/14/10 9:00 AM	0.04	0.04	0.00
10/14/10 11:00 AM	0.04	0.04	0.00
10/14/10 1:00 PM	0.04	0.04	0.00
10/14/10 3:00 PM	0.04	0.04	0.00
10/14/10 5:00 PM	0.04	0.04	0.00
10/14/10 7:00 PM	0.05	0.05	0.00
10/14/10 9:00 PM	0.06	0.06	0.00
10/14/10 11:00 PM	0.16	0.16	0.00
10/15/10 1:00 AM	0.17	0.17	0.00
10/15/10 3:00 AM	0.18	0.18	0.00
10/15/10 5:00 AM	0.18	0.18	0.00
10/15/10 7:00 AM	0.10	0.10	0.00
10/15/10 9:00 AM	0.09	0.09	0.00
10/15/10 11:00 AM	0.09	0.09	0.00
10/15/10 1:00 PM	0.08	0.08	0.00
10/15/10 3:00 PM	0.09	0.09	0.00
10/15/10 5:00 PM	0.14	0.14	0.00
10/15/10 7:00 PM	0.10	0.10	0.00
10/15/10 9:00 PM	0.05	0.05	0.00
10/15/10 11:00 PM	0.10	0.10	0.00
10/16/10 1:00 AM	0.11	0.11	0.00
10/16/10 3:00 AM	0.11	0.11	0.00
10/16/10 5:00 AM	0.12	0.12	0.00
10/16/10 7:00 AM	0.14	0.14	0.00
10/16/10 9:00 AM	0.17	0.17	0.00
10/16/10 11:00 AM	0.18	0.18	0.00
10/16/10 1:00 PM	0.18	0.18	0.00
10/16/10 3:00 PM	0.08	0.08	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
10/16/10 5:00 PM	0.06	0.06	0.00
10/16/10 7:00 PM	0.12	0.12	0.00
10/16/10 9:00 PM	0.13	0.13	0.00
10/16/10 11:00 PM	0.16	0.16	0.00
10/17/10 1:00 AM	0.18	0.18	0.00
10/17/10 3:00 AM	0.18	0.18	0.00
10/17/10 5:00 AM	0.19	0.19	0.00
10/17/10 7:00 AM	0.21	0.21	0.00
10/17/10 9:00 AM	0.21	0.21	0.00
10/17/10 11:00 AM	0.06	0.06	0.00
10/17/10 1:00 PM	0.06	0.06	0.00
10/17/10 3:00 PM	0.06	0.06	0.00
10/17/10 5:00 PM	0.07	0.07	0.00
10/17/10 7:00 PM	0.07	0.07	0.00
10/17/10 9:00 PM	0.10	0.10	0.00
10/17/10 11:00 PM	0.20	0.20	0.00
10/18/10 1:00 AM	0.12	0.12	0.00
10/18/10 3:00 AM	0.13	0.13	0.00
10/18/10 5:00 AM	0.17	0.17	0.00
10/18/10 7:00 AM	0.08	0.08	0.00
10/18/10 9:00 AM	0.08	0.08	0.00
10/18/10 11:00 AM	0.08	0.08	0.00
10/18/10 1:00 PM	0.08	0.08	0.00
10/18/10 3:00 PM	0.07	0.07	0.00
10/18/10 5:00 PM	0.08	0.08	0.00
10/18/10 7:00 PM	0.09	0.09	0.00
10/18/10 9:00 PM	0.09	0.09	0.00
10/18/10 11:00 PM	0.18	0.18	0.00
10/19/10 1:00 AM	0.17	0.17	0.00
10/19/10 3:00 AM	0.18	0.18	0.00
10/19/10 5:00 AM	0.16	0.16	0.00
10/19/10 7:00 AM	0.08	0.08	0.00
10/19/10 9:00 AM	0.05	0.05	0.00
10/19/10 11:00 AM	0.07	0.07	0.00
10/19/10 1:00 PM	0.07	0.07	0.00
10/19/10 3:00 PM	0.07	0.07	0.00
10/19/10 5:00 PM	0.06	0.06	0.00
10/19/10 7:00 PM	0.06	0.06	0.00
10/19/10 9:00 PM	0.10	0.10	0.00
10/19/10 11:00 PM	0.17	0.17	0.00
10/20/10 1:00 AM	0.19	0.19	0.00
10/20/10 3:00 AM	0.17	0.17	0.00
10/20/10 5:00 AM	0.16	0.16	0.00
10/20/10 7:00 AM	0.16	0.16	0.00
10/20/10 9:00 AM	0.15	0.15	0.00
10/20/10 11:00 AM	0.17	0.17	0.00
10/20/10 1:00 PM	0.16	0.16	0.00
10/20/10 3:00 PM	0.16	0.16	0.00
10/20/10 5:00 PM	0.16	0.16	0.00
10/20/10 7:00 PM	0.17	0.17	0.00
10/20/10 9:00 PM	0.18	0.18	0.00
10/20/10 11:00 PM	0.18	0.18	0.00
10/21/10 1:00 AM	0.18	0.18	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
10/21/10 3:00 AM	0.18	0.18	0.00
10/21/10 5:00 AM	0.18	0.18	0.00
10/21/10 7:00 AM	0.17	0.17	0.00
10/21/10 9:00 AM	0.17	0.17	0.00
10/21/10 11:00 AM	0.16	0.16	0.00
10/21/10 1:00 PM	0.16	0.16	0.00
10/21/10 3:00 PM	0.16	0.16	0.00
10/21/10 5:00 PM	0.17	0.17	0.00
10/21/10 7:00 PM	0.16	0.16	0.00
10/21/10 9:00 PM	0.15	0.15	0.00
10/21/10 11:00 PM	0.15	0.15	0.00
10/22/10 1:00 AM	0.15	0.15	0.00
10/22/10 3:00 AM	0.16	0.16	0.00
10/22/10 5:00 AM	0.15	0.15	0.00
10/22/10 7:00 AM	0.15	0.15	0.00
10/22/10 9:00 AM	0.15	0.15	0.00
10/22/10 11:00 AM	0.14	0.14	0.00
10/22/10 1:00 PM	0.14	0.14	0.00
10/22/10 3:00 PM	0.14	0.14	0.00
10/22/10 5:00 PM	0.14	0.14	0.00
10/22/10 7:00 PM	0.14	0.14	0.00
10/22/10 9:00 PM	0.15	0.15	0.00
10/22/10 11:00 PM	0.14	0.14	0.00
10/23/10 1:00 AM	0.15	0.15	0.00
10/23/10 3:00 AM	0.14	0.14	0.00
10/23/10 5:00 AM	0.14	0.14	0.00
10/23/10 7:00 AM	0.15	0.15	0.00
10/23/10 9:00 AM	0.15	0.15	0.00
10/23/10 11:00 AM	0.14	0.14	0.00
10/23/10 1:00 PM	0.14	0.14	0.00
10/23/10 3:00 PM	0.14	0.14	0.00
10/23/10 5:00 PM	0.15	0.15	0.00
10/23/10 7:00 PM	0.15	0.15	0.00
10/23/10 9:00 PM	0.16	0.16	0.00
10/23/10 11:00 PM	0.16	0.16	0.00
10/24/10 1:00 AM	0.15	0.15	0.00
10/24/10 3:00 AM	0.14	0.14	0.00
10/24/10 5:00 AM	0.14	0.14	0.00
10/24/10 7:00 AM	0.16	0.16	0.00
10/24/10 9:00 AM	0.16	0.16	0.00
10/24/10 11:00 AM	0.15	0.15	0.00
10/24/10 1:00 PM	0.14	0.14	0.00
10/24/10 3:00 PM	0.14	0.14	0.00
10/24/10 5:00 PM	0.15	0.15	0.00
10/24/10 7:00 PM	0.18	0.18	0.00
10/24/10 9:00 PM	0.18	0.18	0.00
10/24/10 11:00 PM	0.18	0.18	0.00
10/25/10 1:00 AM	0.19	0.19	0.00
10/25/10 3:00 AM	0.19	0.19	0.00
10/25/10 5:00 AM	0.19	0.19	0.00
10/25/10 7:00 AM	0.18	0.18	0.00
10/25/10 9:00 AM	0.17	0.17	0.00
10/25/10 11:00 AM	0.16	0.16	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
10/25/10 1:00 PM	0.16	0.16	0.00
10/25/10 3:00 PM	0.18	0.18	0.00
10/25/10 5:00 PM	0.19	0.19	0.00
10/25/10 7:00 PM	0.20	0.20	0.00
10/25/10 9:00 PM	0.19	0.19	0.00
10/25/10 11:00 PM	0.19	0.19	0.00
10/26/10 1:00 AM	0.19	0.19	0.00
10/26/10 3:00 AM	0.18	0.18	0.00
10/26/10 5:00 AM	0.17	0.17	0.00
10/26/10 7:00 AM	0.18	0.18	0.00
10/26/10 9:00 AM	0.18	0.18	0.00
10/26/10 11:00 AM	0.17	0.17	0.00
10/26/10 1:00 PM	0.17	0.17	0.00
10/26/10 3:00 PM	0.17	0.17	0.00
10/26/10 5:00 PM	0.17	0.17	0.00
10/26/10 7:00 PM	0.17	0.17	0.00
10/26/10 9:00 PM	0.16	0.16	0.00
10/26/10 11:00 PM	0.15	0.15	0.00
10/27/10 1:00 AM	0.16	0.16	0.00
10/27/10 3:00 AM	0.16	0.16	0.00
10/27/10 5:00 AM	0.16	0.16	0.00
10/27/10 7:00 AM	0.16	0.16	0.00
10/27/10 9:00 AM	0.15	0.15	0.00
10/27/10 11:00 AM	0.15	0.15	0.00
10/27/10 1:00 PM	0.15	0.15	0.00
10/27/10 3:00 PM	0.16	0.16	0.00
10/27/10 5:00 PM	0.16	0.16	0.00
10/27/10 7:00 PM	0.16	0.16	0.00
10/27/10 9:00 PM	0.16	0.16	0.00
10/27/10 11:00 PM	0.17	0.17	0.00
10/28/10 1:00 AM	0.16	0.16	0.00
10/28/10 3:00 AM	0.16	0.16	0.00
10/28/10 5:00 AM	0.16	0.16	0.00
10/28/10 7:00 AM	0.17	0.17	0.00
10/28/10 9:00 AM	0.18	0.18	0.00
10/28/10 11:00 AM	0.19	0.19	0.00
10/28/10 1:00 PM	0.18	0.18	0.00
10/28/10 3:00 PM	0.17	0.17	0.00
10/28/10 5:00 PM	0.18	0.18	0.00
10/28/10 7:00 PM	0.18	0.18	0.00
10/28/10 9:00 PM	0.19	0.19	0.00
10/28/10 11:00 PM	0.18	0.18	0.00
10/29/10 1:00 AM	0.18	0.18	0.00
10/29/10 3:00 AM	0.18	0.18	0.00
10/29/10 5:00 AM	0.19	0.19	0.00
10/29/10 7:00 AM	0.19	0.19	0.00
10/29/10 9:00 AM	0.18	0.18	0.00
10/29/10 11:00 AM	0.18	0.18	0.00
10/29/10 1:00 PM	0.17	0.17	0.00
10/29/10 3:00 PM	0.18	0.18	0.00
10/29/10 5:00 PM	0.17	0.17	0.00
10/29/10 7:00 PM	0.18	0.18	0.00
10/29/10 9:00 PM	0.18	0.18	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
10/29/10 11:00 PM	0.18	0.18	0.00
10/30/10 1:00 AM	0.18	0.18	0.00
10/30/10 3:00 AM	0.19	0.19	0.00
10/30/10 5:00 AM	0.20	0.20	0.00
10/30/10 7:00 AM	0.20	0.20	0.00
10/30/10 9:00 AM	0.18	0.18	0.00
10/30/10 11:00 AM	0.00	0.00	0.00
10/30/10 1:00 PM	0.06	0.06	0.00
10/30/10 3:00 PM	0.09	0.09	0.00
10/30/10 5:00 PM	0.00	0.00	0.00
10/30/10 7:00 PM	0.00	0.00	0.00
10/30/10 9:00 PM	0.04	0.04	0.00
10/30/10 11:00 PM	0.11	0.11	0.00
10/31/10 1:00 AM	0.16	0.16	0.00
10/31/10 3:00 AM	0.18	0.18	0.00
10/31/10 5:00 AM	0.18	0.18	0.00
10/31/10 7:00 AM	0.19	0.19	0.00
10/31/10 9:00 AM	0.21	0.21	0.00
10/31/10 11:00 AM	0.19	0.19	0.00
10/31/10 1:00 PM	0.20	0.20	0.00
10/31/10 3:00 PM	0.22	0.22	0.00
10/31/10 5:00 PM	0.21	0.21	0.00
10/31/10 7:00 PM	0.20	0.20	0.00
10/31/10 9:00 PM	0.20	0.20	0.00
10/31/10 11:00 PM	0.23	0.23	0.00
11/1/10 1:00 AM	0.31	0.31	0.00
11/1/10 3:00 AM	0.30	0.30	0.00
11/1/10 5:00 AM	0.28	0.28	0.00
11/1/10 7:00 AM	0.26	0.26	0.00
11/1/10 9:00 AM	0.32	0.32	0.00
11/1/10 11:00 AM	0.32	0.32	0.00
11/1/10 1:00 PM	0.36	0.36	0.00
11/1/10 3:00 PM	0.21	0.21	0.00
11/1/10 5:00 PM	0.17	0.17	0.00
11/1/10 7:00 PM	0.16	0.16	0.00
11/1/10 9:00 PM	0.16	0.16	0.00
11/1/10 11:00 PM	0.21	0.21	0.00
11/2/10 1:00 AM	0.26	0.26	0.00
11/2/10 3:00 AM	0.20	0.20	0.00
11/2/10 5:00 AM	0.21	0.21	0.00
11/2/10 7:00 AM	0.14	0.14	0.00
11/2/10 9:00 AM	0.14	0.14	0.00
11/2/10 11:00 AM	0.14	0.14	0.00
11/2/10 1:00 PM	0.14	0.14	0.00
11/2/10 3:00 PM	0.12	0.12	0.00
11/2/10 5:00 PM	0.11	0.11	0.00
11/2/10 7:00 PM	0.10	0.10	0.00
11/2/10 9:00 PM	0.10	0.10	0.00
11/2/10 11:00 PM	0.18	0.18	0.00
11/3/10 1:00 AM	0.19	0.19	0.00
11/3/10 3:00 AM	0.19	0.19	0.00
11/3/10 5:00 AM	0.19	0.19	0.00
11/3/10 7:00 AM	0.09	0.09	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
11/3/10 9:00 AM	0.10	0.10	0.00
11/3/10 11:00 AM	0.09	0.09	0.00
11/3/10 1:00 PM	0.09	0.09	0.00
11/3/10 3:00 PM	0.15	0.15	0.20
11/3/10 5:00 PM	0.12	0.12	0.05
11/3/10 7:00 PM	0.11	0.11	0.04
11/3/10 9:00 PM	0.11	0.11	0.03
11/3/10 11:00 PM	0.12	0.12	0.03
11/4/10 1:00 AM	0.31	0.31	0.03
11/4/10 3:00 AM	0.29	0.29	0.03
11/4/10 5:00 AM	0.15	0.15	0.03
11/4/10 7:00 AM	0.12	0.12	0.03
11/4/10 9:00 AM	0.13	0.13	0.04
11/4/10 11:00 AM	0.13	0.13	0.03
11/4/10 1:00 PM	0.13	0.13	0.03
11/4/10 3:00 PM	0.12	0.12	0.01
11/4/10 5:00 PM	0.12	0.12	0.00
11/4/10 7:00 PM	0.13	0.13	0.00
11/4/10 9:00 PM	0.20	0.20	0.00
11/4/10 11:00 PM	0.22	0.22	0.00
11/5/10 1:00 AM	0.20	0.20	0.00
11/5/10 3:00 AM	0.23	0.23	0.00
11/5/10 5:00 AM	0.30	0.30	0.00
11/5/10 7:00 AM	0.13	0.13	0.00
11/5/10 9:00 AM	0.14	0.14	0.00
11/5/10 11:00 AM	0.13	0.13	0.00
11/5/10 1:00 PM	0.13	0.13	0.00
11/5/10 3:00 PM	0.12	0.12	0.00
11/5/10 5:00 PM	0.13	0.13	0.00
11/5/10 7:00 PM	0.14	0.14	0.00
11/5/10 9:00 PM	0.20	0.20	0.00
11/5/10 11:00 PM	0.29	0.29	0.00
11/6/10 1:00 AM	0.20	0.20	0.00
11/6/10 3:00 AM	0.20	0.20	0.00
11/6/10 5:00 AM	0.27	0.27	0.00
11/6/10 7:00 AM	0.30	0.30	0.00
11/6/10 9:00 AM	0.16	0.16	0.00
11/6/10 11:00 AM	0.13	0.13	0.00
11/6/10 1:00 PM	0.13	0.13	0.00
11/6/10 3:00 PM	0.12	0.12	0.00
11/6/10 5:00 PM	0.12	0.12	0.00
11/6/10 7:00 PM	0.12	0.12	0.00
11/6/10 9:00 PM	0.12	0.12	0.00
11/6/10 11:00 PM	0.12	0.12	0.00
11/7/10 1:00 AM	0.24	0.24	0.00
11/7/10 3:00 AM	0.28	0.28	0.00
11/7/10 5:00 AM	0.12	0.12	0.01
11/7/10 7:00 AM	0.07	0.07	0.02
11/7/10 9:00 AM	0.06	0.06	0.04
11/7/10 11:00 AM	0.06	0.06	0.17
11/7/10 1:00 PM	0.06	0.06	0.30
11/7/10 3:00 PM	0.06	0.06	0.19
11/7/10 5:00 PM	0.07	0.07	0.07

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
11/7/10 7:00 PM	0.08	0.08	0.04
11/7/10 9:00 PM	0.21	0.21	0.04
11/7/10 11:00 PM	0.20	0.20	0.04
11/8/10 1:00 AM	0.14	0.14	0.04
11/8/10 3:00 AM	0.14	0.14	0.03
11/8/10 5:00 AM	0.21	0.21	0.11
11/8/10 7:00 AM	0.12	0.12	0.04
11/8/10 9:00 AM	0.09	0.09	0.03
11/8/10 11:00 AM	0.24	0.24	0.04
11/8/10 1:00 PM	0.22	0.22	0.03
11/8/10 3:00 PM	0.23	0.23	0.04
11/8/10 5:00 PM	0.24	0.24	0.04
11/8/10 7:00 PM	0.23	0.23	0.04
11/8/10 9:00 PM	0.22	0.22	0.04
11/8/10 11:00 PM	0.20	0.20	0.04
11/9/10 1:00 AM	0.17	0.17	0.04
11/9/10 3:00 AM	0.16	0.16	0.03
11/9/10 5:00 AM	0.17	0.17	0.04
11/9/10 7:00 AM	0.20	0.20	0.05
11/9/10 9:00 AM	0.15	0.15	0.04
11/9/10 11:00 AM	0.08	0.08	0.04
11/9/10 1:00 PM	0.08	0.08	0.05
11/9/10 3:00 PM	0.08	0.08	0.05
11/9/10 5:00 PM	0.08	0.08	0.05
11/9/10 7:00 PM	0.09	0.09	0.04
11/9/10 9:00 PM	0.08	0.08	0.29
11/9/10 11:00 PM	0.15	0.15	0.03
11/10/10 1:00 AM	0.15	0.15	0.03
11/10/10 3:00 AM	0.15	0.15	0.03
11/10/10 5:00 AM	0.22	0.22	0.05
11/10/10 7:00 AM	0.09	0.09	0.06
11/10/10 9:00 AM	0.07	0.07	0.07
11/10/10 11:00 AM	0.07	0.07	0.06
11/10/10 1:00 PM	0.13	0.13	0.06
11/10/10 3:00 PM	0.18	0.18	0.06
11/10/10 5:00 PM	0.24	0.24	0.07
11/10/10 7:00 PM	0.24	0.24	0.07
11/10/10 9:00 PM	0.21	0.21	0.07
11/10/10 11:00 PM	0.20	0.20	0.04
11/11/10 1:00 AM	0.20	0.20	0.04
11/11/10 3:00 AM	0.20	0.20	0.04
11/11/10 5:00 AM	0.13	0.13	0.05
11/11/10 7:00 AM	0.15	0.15	0.06
11/11/10 9:00 AM	0.15	0.15	0.15
11/11/10 11:00 AM	0.16	0.16	0.16
11/11/10 1:00 PM	0.17	0.17	0.16
11/11/10 3:00 PM	0.17	0.17	0.16
11/11/10 5:00 PM	0.17	0.17	0.15
11/11/10 7:00 PM	0.18	0.18	0.15
11/11/10 9:00 PM	0.18	0.18	0.16
11/11/10 11:00 PM	0.19	0.19	0.17
11/12/10 1:00 AM	0.17	0.17	0.17
11/12/10 3:00 AM	0.15	0.15	0.19

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
11/12/10 5:00 AM	0.17	0.17	0.18
11/12/10 7:00 AM	0.20	0.20	0.20
11/12/10 9:00 AM	0.20	0.20	0.22
11/12/10 11:00 AM	0.20	0.20	0.23
11/12/10 1:00 PM	0.20	0.20	0.25
11/12/10 3:00 PM	0.20	0.20	0.26
11/12/10 5:00 PM	0.21	0.21	0.24
11/12/10 7:00 PM	0.20	0.20	0.24
11/12/10 9:00 PM	0.20	0.20	0.23
11/12/10 11:00 PM	0.21	0.21	0.17
11/13/10 1:00 AM	0.21	0.21	0.09
11/13/10 3:00 AM	0.21	0.21	0.09
11/13/10 5:00 AM	0.21	0.21	0.09
11/13/10 7:00 AM	0.20	0.20	0.11
11/13/10 9:00 AM	0.20	0.20	0.12
11/13/10 11:00 AM	0.20	0.20	0.12
11/13/10 1:00 PM	0.20	0.20	0.13
11/13/10 3:00 PM	0.21	0.21	0.13
11/13/10 5:00 PM	0.21	0.21	0.14
11/13/10 7:00 PM	0.22	0.22	0.14
11/13/10 9:00 PM	0.21	0.21	0.23
11/13/10 11:00 PM	0.21	0.21	0.23
11/14/10 1:00 AM	0.21	0.21	0.22
11/14/10 3:00 AM	0.18	0.18	0.16
11/14/10 5:00 AM	0.18	0.18	0.16
11/14/10 7:00 AM	0.17	0.17	0.23
11/14/10 9:00 AM	0.20	0.20	0.21
11/14/10 11:00 AM	0.19	0.19	0.21
11/14/10 1:00 PM	0.20	0.20	0.21
11/14/10 3:00 PM	0.22	0.22	0.20
11/14/10 5:00 PM	0.22	0.22	0.20
11/14/10 7:00 PM	0.22	0.22	0.20
11/14/10 9:00 PM	0.21	0.21	0.20
11/14/10 11:00 PM	0.18	0.18	0.19
11/15/10 1:00 AM	0.16	0.16	0.19
11/15/10 3:00 AM	0.16	0.16	0.20
11/15/10 5:00 AM	0.16	0.16	0.18
11/15/10 7:00 AM	0.17	0.17	0.17
11/15/10 9:00 AM	0.17	0.17	0.17
11/15/10 11:00 AM	0.21	0.21	0.17
11/15/10 1:00 PM	0.20	0.20	0.17
11/15/10 3:00 PM	0.21	0.21	0.18
11/15/10 5:00 PM	0.22	0.22	0.18
11/15/10 7:00 PM	0.22	0.22	0.18
11/15/10 9:00 PM	0.21	0.21	0.18
11/15/10 11:00 PM	0.21	0.21	0.17
11/16/10 1:00 AM	0.18	0.18	0.09
11/16/10 3:00 AM	0.18	0.18	0.10
11/16/10 5:00 AM	0.18	0.18	0.16
11/16/10 7:00 AM	0.21	0.21	0.19
11/16/10 9:00 AM	0.21	0.21	0.17
11/16/10 11:00 AM	0.20	0.20	0.24
11/16/10 1:00 PM	0.19	0.19	0.23

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
11/16/10 3:00 PM	0.21	0.21	0.19
11/16/10 5:00 PM	0.22	0.22	0.17
11/16/10 7:00 PM	0.22	0.22	0.11
11/16/10 9:00 PM	0.21	0.21	0.09
11/16/10 11:00 PM	0.20	0.20	0.06
11/17/10 1:00 AM	0.18	0.18	0.03
11/17/10 3:00 AM	0.17	0.17	0.03
11/17/10 5:00 AM	0.18	0.18	0.03
11/17/10 7:00 AM	0.20	0.20	0.07
11/17/10 9:00 AM	0.20	0.20	0.00
11/17/10 11:00 AM	0.20	0.20	0.00
11/17/10 1:00 PM	0.20	0.20	0.00
11/17/10 3:00 PM	0.20	0.20	0.00
11/17/10 5:00 PM	0.20	0.20	0.00
11/17/10 7:00 PM	0.21	0.21	0.00
11/17/10 9:00 PM	0.23	0.23	0.00
11/17/10 11:00 PM	0.23	0.23	0.03
11/18/10 1:00 AM	0.21	0.21	0.10
11/18/10 3:00 AM	0.18	0.18	0.15
11/18/10 5:00 AM	0.18	0.18	0.16
11/18/10 7:00 AM	0.24	0.24	0.17
11/18/10 9:00 AM	0.24	0.24	0.17
11/18/10 11:00 AM	0.23	0.23	0.18
11/18/10 1:00 PM	0.25	0.25	0.20
11/18/10 3:00 PM	0.25	0.25	0.19
11/18/10 5:00 PM	0.23	0.23	0.18
11/18/10 7:00 PM	0.22	0.22	0.21
11/18/10 9:00 PM	0.22	0.22	0.23
11/18/10 11:00 PM	0.22	0.22	0.13
11/19/10 1:00 AM	0.22	0.22	0.08
11/19/10 3:00 AM	0.22	0.22	0.11
11/19/10 5:00 AM	0.21	0.21	0.24
11/19/10 7:00 AM	0.22	0.22	0.09
11/19/10 9:00 AM	0.22	0.22	0.23
11/19/10 11:00 AM	0.21	0.21	0.31
11/19/10 1:00 PM	0.20	0.20	0.17
11/19/10 3:00 PM	0.20	0.20	0.16
11/19/10 5:00 PM	0.22	0.22	0.14
11/19/10 7:00 PM	0.22	0.22	0.12
11/19/10 9:00 PM	0.24	0.24	0.11
11/19/10 11:00 PM	0.25	0.25	0.08
11/20/10 1:00 AM	0.25	0.25	0.07
11/20/10 3:00 AM	0.25	0.25	0.07
11/20/10 5:00 AM	0.25	0.25	0.07
11/20/10 7:00 AM	0.24	0.24	0.06
11/20/10 9:00 AM	0.23	0.23	0.19
11/20/10 11:00 AM	0.23	0.23	0.19
11/20/10 1:00 PM	0.24	0.24	0.17
11/20/10 3:00 PM	0.25	0.25	0.18
11/20/10 5:00 PM	0.24	0.24	0.15
11/20/10 7:00 PM	0.26	0.26	0.12
11/20/10 9:00 PM	0.25	0.25	0.14
11/20/10 11:00 PM	0.25	0.25	0.18

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
11/21/10 1:00 AM	0.23	0.23	0.08
11/21/10 3:00 AM	0.19	0.19	0.05
11/21/10 5:00 AM	0.16	0.16	0.09
11/21/10 7:00 AM	0.16	0.16	0.13
11/21/10 9:00 AM	0.24	0.24	0.15
11/21/10 11:00 AM	0.27	0.27	0.17
11/21/10 1:00 PM	0.12	0.12	0.17
11/21/10 3:00 PM	0.11	0.11	0.16
11/21/10 5:00 PM	0.11	0.11	0.17
11/21/10 7:00 PM	0.11	0.11	0.15
11/21/10 9:00 PM	0.13	0.13	0.15
11/21/10 11:00 PM	0.24	0.24	0.14
11/22/10 1:00 AM	0.20	0.00	0.08
11/22/10 3:00 AM	0.20	0.00	0.03
11/22/10 5:00 AM	0.26	0.00	0.02
11/22/10 7:00 AM	0.13	0.00	0.04
11/22/10 9:00 AM	0.10	0.00	0.09
11/22/10 11:00 AM	0.17	0.00	0.12
11/22/10 1:00 PM	0.23	0.00	0.15
11/22/10 3:00 PM	0.12	0.00	0.14
11/22/10 5:00 PM	0.09	0.00	0.14
11/22/10 7:00 PM	0.09	0.00	0.14
11/22/10 9:00 PM	0.08	0.00	0.12
11/22/10 11:00 PM	0.20	0.00	0.11
11/23/10 1:00 AM	0.19	0.00	0.08
11/23/10 3:00 AM	0.21	0.00	0.04
11/23/10 5:00 AM	0.21	0.00	0.04
11/23/10 7:00 AM	0.31	0.00	0.05
11/23/10 9:00 AM	0.16	0.00	0.05
11/23/10 11:00 AM	0.09	0.00	0.12
11/23/10 1:00 PM	0.09	0.00	0.14
11/23/10 3:00 PM	0.08	0.00	0.16
11/23/10 5:00 PM	0.08	0.00	0.10
11/23/10 7:00 PM	0.08	0.00	0.16
11/23/10 9:00 PM	0.08	0.00	0.15
11/23/10 11:00 PM	0.14	0.00	0.13
11/24/10 1:00 AM	0.24	0.00	0.04
11/24/10 3:00 AM	0.24	0.00	0.02
11/24/10 5:00 AM	0.24	0.00	0.03
11/24/10 7:00 AM	0.24	0.00	0.07
11/24/10 9:00 AM	0.26	0.00	0.13
11/24/10 11:00 AM	0.16	0.00	0.17
11/24/10 1:00 PM	0.13	0.00	0.18
11/24/10 3:00 PM	0.14	0.00	0.19
11/24/10 5:00 PM	0.15	0.00	0.23
11/24/10 7:00 PM	0.20	0.00	0.23
11/24/10 9:00 PM	0.16	0.00	0.22
11/24/10 11:00 PM	0.16	0.00	0.22
11/25/10 1:00 AM	0.20	0.00	0.20
11/25/10 3:00 AM	0.23	0.00	0.20
11/25/10 5:00 AM	0.23	0.00	0.10
11/25/10 7:00 AM	0.22	0.00	0.08
11/25/10 9:00 AM	0.20	0.00	0.19

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
11/25/10 11:00 AM	0.09	0.00	0.22
11/25/10 1:00 PM	0.10	0.00	0.22
11/25/10 3:00 PM	0.24	0.00	0.22
11/25/10 5:00 PM	0.15	0.00	0.23
11/25/10 7:00 PM	0.12	0.00	0.22
11/25/10 9:00 PM	0.24	0.00	0.25
11/25/10 11:00 PM	0.20	0.00	0.16
11/26/10 1:00 AM	0.18	0.00	0.03
11/26/10 3:00 AM	0.19	0.00	0.03
11/26/10 5:00 AM	0.19	0.00	0.04
11/26/10 7:00 AM	0.19	0.00	0.19
11/26/10 9:00 AM	0.25	0.00	0.26
11/26/10 11:00 AM	0.11	0.00	0.27
11/26/10 1:00 PM	0.08	0.00	0.42
11/26/10 3:00 PM	0.22	0.00	0.27
11/26/10 5:00 PM	0.24	0.00	0.11
11/26/10 7:00 PM	0.12	0.00	0.09
11/26/10 9:00 PM	0.15	0.00	0.10
11/26/10 11:00 PM	0.18	0.00	0.10
11/27/10 1:00 AM	0.19	0.00	0.06
11/27/10 3:00 AM	0.20	0.00	0.07
11/27/10 5:00 AM	0.20	0.00	0.08
11/27/10 7:00 AM	0.20	0.00	0.09
11/27/10 9:00 AM	0.25	0.00	0.10
11/27/10 11:00 AM	0.17	0.00	0.12
11/27/10 1:00 PM	0.21	0.00	0.13
11/27/10 3:00 PM	0.22	0.00	0.14
11/27/10 5:00 PM	0.21	0.00	0.13
11/27/10 7:00 PM	0.16	0.00	0.12
11/27/10 9:00 PM	0.17	0.00	0.13
11/27/10 11:00 PM	0.17	0.00	0.12
11/28/10 1:00 AM	0.18	0.00	0.10
11/28/10 3:00 AM	0.20	0.00	0.04
11/28/10 5:00 AM	0.20	0.00	0.05
11/28/10 7:00 AM	0.20	0.00	0.05
11/28/10 9:00 AM	0.17	0.00	0.11
11/28/10 11:00 AM	0.19	0.00	0.29
11/28/10 1:00 PM	0.17	0.00	0.26
11/28/10 3:00 PM	0.16	0.00	0.26
11/28/10 5:00 PM	0.20	0.00	0.22
11/28/10 7:00 PM	0.24	0.00	0.16
11/28/10 9:00 PM	0.24	0.00	0.00
11/28/10 11:00 PM	0.19	0.00	0.00
11/29/10 1:00 AM	0.20	0.00	0.00
11/29/10 3:00 AM	0.20	0.00	0.00
11/29/10 5:00 AM	0.20	0.00	0.00
11/29/10 7:00 AM	0.22	0.00	0.00
11/29/10 9:00 AM	0.25	0.00	0.00
11/29/10 11:00 AM	0.27	0.00	0.00
11/29/10 1:00 PM	0.24	0.00	0.00
11/29/10 3:00 PM	0.24	0.00	0.00
11/29/10 5:00 PM	0.23	0.00	0.00
11/29/10 7:00 PM	0.24	0.00	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
11/29/10 9:00 PM	0.25	0.00	0.00
11/29/10 11:00 PM	0.25	0.00	0.00
11/30/10 1:00 AM	0.24	0.00	0.00
11/30/10 3:00 AM	0.20	0.00	0.00
11/30/10 5:00 AM	0.23	0.00	0.00
11/30/10 7:00 AM	0.25	0.00	0.00
11/30/10 9:00 AM	0.26	0.00	0.00
11/30/10 11:00 AM	0.27	0.00	0.00
11/30/10 1:00 PM	0.26	0.00	0.00
11/30/10 3:00 PM	0.26	0.00	0.00
11/30/10 5:00 PM	0.24	0.00	0.00
11/30/10 7:00 PM	0.25	0.00	0.00
11/30/10 9:00 PM	0.25	0.00	0.00
11/30/10 11:00 PM	0.24	0.00	0.00
12/1/10 1:00 AM	0.23	0.00	0.00
12/1/10 3:00 AM	0.21	0.00	0.00
12/1/10 5:00 AM	0.20	0.00	0.00
12/1/10 7:00 AM	0.27	0.00	0.00
12/1/10 9:00 AM	0.26	0.00	0.00
12/1/10 11:00 AM	0.25	0.00	0.00
12/1/10 1:00 PM	0.25	0.00	0.00
12/1/10 3:00 PM	0.25	0.00	0.00
12/1/10 5:00 PM	0.25	0.00	0.00
12/1/10 7:00 PM	0.27	0.00	0.00
12/1/10 9:00 PM	0.27	0.00	0.00
12/1/10 11:00 PM	0.21	0.00	0.00
12/2/10 1:00 AM	0.21	0.21	0.00
12/2/10 3:00 AM	0.21	0.21	0.00
12/2/10 5:00 AM	0.25	0.25	0.00
12/2/10 7:00 AM	0.28	0.28	0.00
12/2/10 9:00 AM	0.26	0.26	0.00
12/2/10 11:00 AM	0.25	0.00	0.00
12/2/10 1:00 PM	0.25	0.00	0.00
12/2/10 3:00 PM	0.25	0.00	0.00
12/2/10 5:00 PM	0.25	0.00	0.00
12/2/10 7:00 PM	0.25	0.00	0.00
12/2/10 9:00 PM	0.25	0.00	0.00
12/2/10 11:00 PM	0.23	0.00	0.00
12/3/10 1:00 AM	0.23	0.00	0.00
12/3/10 3:00 AM	0.24	0.00	0.00
12/3/10 5:00 AM	0.24	0.00	0.00
12/3/10 7:00 AM	0.24	0.00	0.00
12/3/10 9:00 AM	0.23	0.00	0.00
12/3/10 11:00 AM	0.22	0.00	0.00
12/3/10 1:00 PM	0.23	0.00	0.00
12/3/10 3:00 PM	0.23	0.00	0.00
12/3/10 5:00 PM	0.22	0.22	0.01
12/3/10 7:00 PM	0.21	0.21	0.07
12/3/10 9:00 PM	0.16	0.16	0.04
12/3/10 11:00 PM	0.07	0.07	0.05
12/4/10 1:00 AM	0.07	0.07	0.05
12/4/10 3:00 AM	0.07	0.07	0.05
12/4/10 5:00 AM	0.08	0.08	0.05

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
12/4/10 7:00 AM	0.07	0.07	0.05
12/4/10 9:00 AM	0.07	0.07	0.04
12/4/10 11:00 AM	0.18	0.18	0.04
12/4/10 1:00 PM	0.23	0.23	0.04
12/4/10 3:00 PM	0.23	0.23	0.06
12/4/10 5:00 PM	0.23	0.23	0.11
12/4/10 7:00 PM	0.24	0.24	0.13
12/4/10 9:00 PM	0.23	0.23	0.16
12/4/10 11:00 PM	0.17	0.17	0.25
12/5/10 1:00 AM	0.14	0.14	0.29
12/5/10 3:00 AM	0.13	0.13	0.12
12/5/10 5:00 AM	0.13	0.13	0.12
12/5/10 7:00 AM	0.21	0.21	0.12
12/5/10 9:00 AM	0.22	0.22	0.18
12/5/10 11:00 AM	0.22	0.22	0.15
12/5/10 1:00 PM	0.22	0.22	0.16
12/5/10 3:00 PM	0.21	0.21	0.17
12/5/10 5:00 PM	0.22	0.22	0.16
12/5/10 7:00 PM	0.10	0.10	0.20
12/5/10 9:00 PM	0.07	0.07	0.22
12/5/10 11:00 PM	0.22	0.22	0.19
12/6/10 1:00 AM	0.23	0.23	0.19
12/6/10 3:00 AM	0.22	0.22	0.19
12/6/10 5:00 AM	0.20	0.20	0.18
12/6/10 7:00 AM	0.07	0.07	0.18
12/6/10 9:00 AM	0.09	0.09	0.19
12/6/10 11:00 AM	0.09	0.09	0.20
12/6/10 1:00 PM	0.13	0.13	0.20
12/6/10 3:00 PM	0.23	0.23	0.20
12/6/10 5:00 PM	0.13	0.13	0.17
12/6/10 7:00 PM	0.08	0.08	0.20
12/6/10 9:00 PM	0.08	0.08	0.22
12/6/10 11:00 PM	0.08	0.08	0.23
12/7/10 1:00 AM	0.09	0.09	0.22
12/7/10 3:00 AM	0.09	0.09	0.18
12/7/10 5:00 AM	0.09	0.09	0.16
12/7/10 7:00 AM	0.09	0.09	0.18
12/7/10 9:00 AM	0.11	0.11	0.19
12/7/10 11:00 AM	0.10	0.10	0.20
12/7/10 1:00 PM	0.10	0.10	0.20
12/7/10 3:00 PM	0.09	0.09	0.20
12/7/10 5:00 PM	0.09	0.09	0.20
12/7/10 7:00 PM	0.10	0.10	0.19
12/7/10 9:00 PM	0.10	0.10	0.16
12/7/10 11:00 PM	0.10	0.10	0.17
12/8/10 1:00 AM	0.11	0.11	0.16
12/8/10 3:00 AM	0.11	0.11	0.17
12/8/10 5:00 AM	0.12	0.12	0.14
12/8/10 7:00 AM	0.12	0.12	0.16
12/8/10 9:00 AM	0.18	0.18	0.19
12/8/10 11:00 AM	0.17	0.17	0.24
12/8/10 1:00 PM	0.20	0.20	0.18
12/8/10 3:00 PM	0.24	0.24	0.17

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
12/8/10 5:00 PM	0.13	0.13	0.18
12/8/10 7:00 PM	0.10	0.10	0.18
12/8/10 9:00 PM	0.08	0.08	0.18
12/8/10 11:00 PM	0.17	0.17	0.17
12/9/10 1:00 AM	0.18	0.18	0.13
12/9/10 3:00 AM	0.18	0.18	0.13
12/9/10 5:00 AM	0.19	0.19	0.16
12/9/10 7:00 AM	0.18	0.18	0.16
12/9/10 9:00 AM	0.18	0.18	0.16
12/9/10 11:00 AM	0.18	0.18	0.15
12/9/10 1:00 PM	0.18	0.18	0.15
12/9/10 3:00 PM	0.18	0.18	0.15
12/9/10 5:00 PM	0.18	0.18	0.15
12/9/10 7:00 PM	0.16	0.16	0.15
12/9/10 9:00 PM	0.17	0.17	0.13
12/9/10 11:00 PM	0.20	0.20	0.17
12/10/10 1:00 AM	0.21	0.21	0.15
12/10/10 3:00 AM	0.22	0.22	0.15
12/10/10 5:00 AM	0.22	0.22	0.16
12/10/10 7:00 AM	0.23	0.23	0.16
12/10/10 9:00 AM	0.20	0.20	0.19
12/10/10 11:00 AM	0.14	0.14	0.18
12/10/10 1:00 PM	0.17	0.17	0.15
12/10/10 3:00 PM	0.23	0.23	0.04
12/10/10 5:00 PM	0.23	0.23	0.04
12/10/10 7:00 PM	0.12	0.12	0.04
12/10/10 9:00 PM	0.13	0.13	0.05
12/10/10 11:00 PM	0.11	0.11	0.08
12/11/10 1:00 AM	0.17	0.17	0.08
12/11/10 3:00 AM	0.22	0.22	0.08
12/11/10 5:00 AM	0.23	0.23	0.08
12/11/10 7:00 AM	0.14	0.14	0.08
12/11/10 9:00 AM	0.10	0.10	0.09
12/11/10 11:00 AM	0.10	0.10	0.08
12/11/10 1:00 PM	0.09	0.09	0.08
12/11/10 3:00 PM	0.17	0.17	0.08
12/11/10 5:00 PM	0.21	0.21	0.08
12/11/10 7:00 PM	0.20	0.20	0.09
12/11/10 9:00 PM	0.17	0.17	0.09
12/11/10 11:00 PM	0.18	0.18	0.09
12/12/10 1:00 AM	0.21	0.21	0.08
12/12/10 3:00 AM	0.21	0.21	0.08
12/12/10 5:00 AM	0.21	0.21	0.09
12/12/10 7:00 AM	0.11	0.11	0.13
12/12/10 9:00 AM	0.16	0.16	0.13
12/12/10 11:00 AM	0.17	0.17	0.14
12/12/10 1:00 PM	0.19	0.19	0.15
12/12/10 3:00 PM	0.15	0.15	0.15
12/12/10 5:00 PM	0.07	0.07	0.16
12/12/10 7:00 PM	0.08	0.08	0.16
12/12/10 9:00 PM	0.10	0.10	0.17
12/12/10 11:00 PM	0.14	0.14	0.17
12/13/10 1:00 AM	0.10	0.10	0.12

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
12/13/10 3:00 AM	0.19	0.19	0.12
12/13/10 5:00 AM	0.11	0.11	0.14
12/13/10 7:00 AM	0.09	0.09	0.14
12/13/10 9:00 AM	0.11	0.11	0.15
12/13/10 11:00 AM	0.12	0.12	0.14
12/13/10 1:00 PM	0.13	0.13	0.14
12/13/10 3:00 PM	0.12	0.12	0.14
12/13/10 5:00 PM	0.15	0.15	0.15
12/13/10 7:00 PM	0.17	0.17	0.15
12/13/10 9:00 PM	0.22	0.22	0.14
12/13/10 11:00 PM	0.19	0.19	0.14
12/14/10 1:00 AM	0.21	0.21	0.14
12/14/10 3:00 AM	0.22	0.22	0.14
12/14/10 5:00 AM	0.19	0.19	0.14
12/14/10 7:00 AM	0.15	0.15	0.14
12/14/10 9:00 AM	0.14	0.14	0.14
12/14/10 11:00 AM	0.13	0.13	0.15
12/14/10 1:00 PM	0.15	0.15	0.14
12/14/10 3:00 PM	0.18	0.18	0.14
12/14/10 5:00 PM	0.17	0.17	0.15
12/14/10 7:00 PM	0.12	0.12	0.14
12/14/10 9:00 PM	0.17	0.17	0.14
12/14/10 11:00 PM	0.21	0.21	0.13
12/15/10 1:00 AM	0.21	0.21	0.13
12/15/10 3:00 AM	0.22	0.22	0.13
12/15/10 5:00 AM	0.21	0.21	0.13
12/15/10 7:00 AM	0.20	0.20	0.14
12/15/10 9:00 AM	0.22	0.22	0.14
12/15/10 11:00 AM	0.24	0.24	0.14
12/15/10 1:00 PM	0.25	0.25	0.14
12/15/10 3:00 PM	0.24	0.24	0.13
12/15/10 5:00 PM	0.26	0.26	0.14
12/15/10 7:00 PM	0.26	0.26	0.16
12/15/10 9:00 PM	0.26	0.26	0.15
12/15/10 11:00 PM	0.26	0.26	0.15
12/16/10 1:00 AM	0.27	0.27	0.15
12/16/10 3:00 AM	0.26	0.26	0.16
12/16/10 5:00 AM	0.24	0.24	0.16
12/16/10 7:00 AM	0.23	0.23	0.15
12/16/10 9:00 AM	0.22	0.22	0.12
12/16/10 11:00 AM	0.22	0.22	0.11
12/16/10 1:00 PM	0.22	0.22	0.10
12/16/10 3:00 PM	0.21	0.21	0.11
12/16/10 5:00 PM	0.21	0.21	0.14
12/16/10 7:00 PM	0.21	0.21	0.16
12/16/10 9:00 PM	0.21	0.21	0.16
12/16/10 11:00 PM	0.20	0.20	0.10
12/17/10 1:00 AM	0.21	0.21	0.05
12/17/10 3:00 AM	0.20	0.20	0.06
12/17/10 5:00 AM	0.19	0.19	0.06
12/17/10 7:00 AM	0.18	0.18	0.08
12/17/10 9:00 AM	0.17	0.17	0.00
12/17/10 11:00 AM	0.00	0.00	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
12/17/10 1:00 PM	0.00	0.00	0.00
12/17/10 3:00 PM	0.00	0.00	0.00
12/17/10 5:00 PM	0.06	0.06	0.00
12/17/10 7:00 PM	0.07	0.07	0.01
12/17/10 9:00 PM	0.12	0.12	0.08
12/17/10 11:00 PM	0.12	0.12	0.17
12/18/10 1:00 AM	0.11	0.11	0.17
12/18/10 3:00 AM	0.10	0.10	0.16
12/18/10 5:00 AM	0.09	0.09	0.16
12/18/10 7:00 AM	0.10	0.10	0.19
12/18/10 9:00 AM	0.11	0.11	0.15
12/18/10 11:00 AM	0.10	0.10	0.13
12/18/10 1:00 PM	0.10	0.10	0.12
12/18/10 3:00 PM	0.11	0.11	0.12
12/18/10 5:00 PM	0.12	0.12	0.12
12/18/10 7:00 PM	0.12	0.12	0.12
12/18/10 9:00 PM	0.12	0.12	0.11
12/18/10 11:00 PM	0.10	0.10	0.10
12/19/10 1:00 AM	0.10	0.10	0.10
12/19/10 3:00 AM	0.10	0.10	0.09
12/19/10 5:00 AM	0.10	0.10	0.09
12/19/10 7:00 AM	0.10	0.10	0.09
12/19/10 9:00 AM	0.11	0.11	0.09
12/19/10 11:00 AM	0.13	0.13	0.10
12/19/10 1:00 PM	0.16	0.16	0.10
12/19/10 3:00 PM	0.18	0.18	0.11
12/19/10 5:00 PM	0.11	0.11	0.10
12/19/10 7:00 PM	0.06	0.06	0.10
12/19/10 9:00 PM	0.06	0.06	0.11
12/19/10 11:00 PM	0.06	0.06	0.11
12/20/10 1:00 AM	0.17	0.17	0.10
12/20/10 3:00 AM	0.21	0.21	0.10
12/20/10 5:00 AM	0.11	0.11	0.13
12/20/10 7:00 AM	0.07	0.07	0.13
12/20/10 9:00 AM	0.08	0.08	0.13
12/20/10 11:00 AM	0.07	0.07	0.12
12/20/10 1:00 PM	0.06	0.06	0.12
12/20/10 3:00 PM	0.07	0.07	0.12
12/20/10 5:00 PM	0.08	0.08	0.12
12/20/10 7:00 PM	0.10	0.10	0.11
12/20/10 9:00 PM	0.18	0.18	0.11
12/20/10 11:00 PM	0.20	0.20	0.10
12/21/10 1:00 AM	0.06	0.06	0.11
12/21/10 3:00 AM	0.06	0.06	0.10
12/21/10 5:00 AM	0.06	0.06	0.10
12/21/10 7:00 AM	0.06	0.06	0.09
12/21/10 9:00 AM	0.17	0.17	0.07
12/21/10 11:00 AM	0.18	0.18	0.08
12/21/10 1:00 PM	0.17	0.17	0.09
12/21/10 3:00 PM	0.17	0.17	0.08
12/21/10 5:00 PM	0.30	0.30	0.08
12/21/10 7:00 PM	0.93	0.93	0.09
12/21/10 9:00 PM	0.15	0.15	0.10

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
12/21/10 11:00 PM	0.15	0.15	0.08
12/22/10 1:00 AM	0.15	0.15	0.05
12/22/10 3:00 AM	0.15	0.15	0.05
12/22/10 5:00 AM	0.15	0.15	0.15
12/22/10 7:00 AM	0.16	0.16	0.16
12/22/10 9:00 AM	0.16	0.16	0.15
12/22/10 11:00 AM	0.16	0.16	0.15
12/22/10 1:00 PM	0.17	0.17	0.14
12/22/10 3:00 PM	0.18	0.18	0.14
12/22/10 5:00 PM	0.18	0.18	0.14
12/22/10 7:00 PM	0.19	0.19	0.14
12/22/10 9:00 PM	0.18	0.18	0.06
12/22/10 11:00 PM	0.18	0.18	0.03
12/23/10 1:00 AM	0.18	0.18	0.03
12/23/10 3:00 AM	0.18	0.18	0.03
12/23/10 5:00 AM	0.20	0.20	0.05
12/23/10 7:00 AM	0.21	0.21	0.20
12/23/10 9:00 AM	0.22	0.22	0.21
12/23/10 11:00 AM	0.19	0.19	0.22
12/23/10 1:00 PM	0.18	0.18	0.20
12/23/10 3:00 PM	0.17	0.17	0.13
12/23/10 5:00 PM	0.17	0.17	0.13
12/23/10 7:00 PM	0.17	0.17	0.13
12/23/10 9:00 PM	0.18	0.18	0.13
12/23/10 11:00 PM	0.23	0.23	0.08
12/24/10 1:00 AM	0.22	0.22	0.04
12/24/10 3:00 AM	0.22	0.22	0.05
12/24/10 5:00 AM	0.22	0.22	0.06
12/24/10 7:00 AM	0.22	0.22	0.19
12/24/10 9:00 AM	0.22	0.22	0.16
12/24/10 11:00 AM	0.22	0.22	0.15
12/24/10 1:00 PM	0.24	0.24	0.15
12/24/10 3:00 PM	0.25	0.25	0.13
12/24/10 5:00 PM	0.25	0.25	0.10
12/24/10 7:00 PM	0.28	0.28	0.07
12/24/10 9:00 PM	0.28	0.28	0.07
12/24/10 11:00 PM	0.27	0.27	0.07
12/25/10 1:00 AM	0.22	0.22	0.03
12/25/10 3:00 AM	0.25	0.25	0.04
12/25/10 5:00 AM	0.29	0.29	0.10
12/25/10 7:00 AM	0.28	0.28	0.19
12/25/10 9:00 AM	0.20	0.20	0.16
12/25/10 11:00 AM	0.08	0.08	0.13
12/25/10 1:00 PM	0.15	0.15	0.13
12/25/10 3:00 PM	0.27	0.27	0.11
12/25/10 5:00 PM	0.26	0.26	0.10
12/25/10 7:00 PM	0.27	0.27	0.08
12/25/10 9:00 PM	0.28	0.28	0.03
12/25/10 11:00 PM	0.23	0.23	0.03
12/26/10 1:00 AM	0.20	0.20	0.03
12/26/10 3:00 AM	0.20	0.20	0.03
12/26/10 5:00 AM	0.19	0.19	0.04
12/26/10 7:00 AM	0.19	0.19	0.05

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
12/26/10 9:00 AM	0.16	0.16	0.19
12/26/10 11:00 AM	0.11	0.11	0.19
12/26/10 1:00 PM	0.20	0.20	0.16
12/26/10 3:00 PM	0.16	0.16	0.14
12/26/10 5:00 PM	0.13	0.13	0.13
12/26/10 7:00 PM	0.14	0.14	0.16
12/26/10 9:00 PM	0.14	0.14	0.15
12/26/10 11:00 PM	0.14	0.14	0.14
12/27/10 1:00 AM	0.15	0.15	0.14
12/27/10 3:00 AM	0.16	0.16	0.14
12/27/10 5:00 AM	0.18	0.18	0.14
12/27/10 7:00 AM	0.24	0.24	0.13
12/27/10 9:00 AM	0.24	0.24	0.14
12/27/10 11:00 AM	0.22	0.22	0.14
12/27/10 1:00 PM	0.17	0.17	0.14
12/27/10 3:00 PM	0.16	0.16	0.14
12/27/10 5:00 PM	0.17	0.17	0.13
12/27/10 7:00 PM	0.17	0.17	0.12
12/27/10 9:00 PM	0.18	0.18	0.14
12/27/10 11:00 PM	0.17	0.17	0.14
12/28/10 1:00 AM	0.17	0.17	0.14
12/28/10 3:00 AM	0.18	0.18	0.14
12/28/10 5:00 AM	0.19	0.19	0.13
12/28/10 7:00 AM	0.21	0.21	0.14
12/28/10 9:00 AM	0.17	0.17	0.13
12/28/10 11:00 AM	0.18	0.18	0.12
12/28/10 1:00 PM	0.16	0.16	0.13
12/28/10 3:00 PM	0.15	0.15	0.10
12/28/10 5:00 PM	0.19	0.19	0.10
12/28/10 7:00 PM	0.30	0.30	0.11
12/28/10 9:00 PM	0.29	0.29	0.11
12/28/10 11:00 PM	0.21	0.21	0.12
12/29/10 1:00 AM	0.24	0.24	0.13
12/29/10 3:00 AM	0.20	0.20	0.13
12/29/10 5:00 AM	0.29	0.29	0.15
12/29/10 7:00 AM	0.27	0.27	0.14
12/29/10 9:00 AM	0.26	0.26	0.13
12/29/10 11:00 AM	0.24	0.24	0.11
12/29/10 1:00 PM	0.26	0.26	0.10
12/29/10 3:00 PM	0.18	0.18	0.08
12/29/10 5:00 PM	0.23	0.23	0.10
12/29/10 7:00 PM	0.24	0.24	0.08
12/29/10 9:00 PM	0.25	0.25	0.05
12/29/10 11:00 PM	0.25	0.25	0.05
12/30/10 1:00 AM	0.24	0.24	0.06
12/30/10 3:00 AM	0.24	0.24	0.06
12/30/10 5:00 AM	0.20	0.20	0.06
12/30/10 7:00 AM	0.09	0.09	0.06
12/30/10 9:00 AM	0.09	0.09	0.07
12/30/10 11:00 AM	0.12	0.12	0.09
12/30/10 1:00 PM	0.22	0.22	0.17
12/30/10 3:00 PM	0.22	0.22	0.13
12/30/10 5:00 PM	0.22	0.22	0.12

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
12/30/10 7:00 PM	0.22	0.22	0.11
12/30/10 9:00 PM	0.25	0.25	0.11
12/30/10 11:00 PM	0.26	0.26	0.08
12/31/10 1:00 AM	0.26	0.26	0.03
12/31/10 3:00 AM	0.26	0.26	0.03
12/31/10 5:00 AM	0.27	0.27	0.04
12/31/10 7:00 AM	0.28	0.28	0.19
12/31/10 9:00 AM	0.24	0.24	0.19
12/31/10 11:00 AM	0.20	0.20	0.19
12/31/10 1:00 PM	0.19	0.19	0.19
12/31/10 3:00 PM	0.19	0.19	0.18
12/31/10 5:00 PM	0.21	0.21	0.18
12/31/10 7:00 PM	0.21	0.21	0.17
12/31/10 9:00 PM	0.23	0.23	0.11
12/31/10 11:00 PM	0.21	0.21	0.04
1/1/11 1:00 AM	0.21	0.21	0.04
1/1/11 3:00 AM	0.19	0.19	0.04
1/1/11 5:00 AM	0.17	0.17	0.04
1/1/11 7:00 AM	0.16	0.16	0.05
1/1/11 9:00 AM	0.17	0.17	0.05
1/1/11 11:00 AM	0.18	0.18	0.18
1/1/11 1:00 PM	0.18	0.18	0.23
1/1/11 3:00 PM	0.18	0.18	0.20
1/1/11 5:00 PM	0.18	0.18	0.19
1/1/11 7:00 PM	0.18	0.18	0.17
1/1/11 9:00 PM	0.18	0.18	0.17
1/1/11 11:00 PM	0.20	0.20	0.13
1/2/11 1:00 AM	0.18	0.18	0.04
1/2/11 3:00 AM	0.14	0.14	0.03
1/2/11 5:00 AM	0.15	0.15	0.03
1/2/11 7:00 AM	0.18	0.18	0.03
1/2/11 9:00 AM	0.20	0.20	0.15
1/2/11 11:00 AM	0.21	0.21	0.17
1/2/11 1:00 PM	0.20	0.20	0.16
1/2/11 3:00 PM	0.20	0.20	0.15
1/2/11 5:00 PM	0.21	0.21	0.14
1/2/11 7:00 PM	0.21	0.21	0.13
1/2/11 9:00 PM	0.20	0.20	0.10
1/2/11 11:00 PM	0.21	0.21	0.03
1/3/11 1:00 AM	0.20	0.20	0.03
1/3/11 3:00 AM	0.17	0.17	0.03
1/3/11 5:00 AM	0.18	0.18	0.05
1/3/11 7:00 AM	0.18	0.18	0.20
1/3/11 9:00 AM	0.19	0.19	0.18
1/3/11 11:00 AM	0.22	0.22	0.17
1/3/11 1:00 PM	0.23	0.23	0.17
1/3/11 3:00 PM	0.23	0.23	0.16
1/3/11 5:00 PM	0.23	0.23	0.16
1/3/11 7:00 PM	0.23	0.23	0.15
1/3/11 9:00 PM	0.23	0.23	0.14
1/3/11 11:00 PM	0.24	0.24	0.13
1/4/11 1:00 AM	0.23	0.23	0.04
1/4/11 3:00 AM	0.24	0.24	0.03

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
1/4/11 5:00 AM	0.23	0.23	0.06
1/4/11 7:00 AM	0.23	0.23	0.18
1/4/11 9:00 AM	0.23	0.23	0.22
1/4/11 11:00 AM	0.22	0.22	0.20
1/4/11 1:00 PM	0.22	0.22	0.19
1/4/11 3:00 PM	0.22	0.22	0.18
1/4/11 5:00 PM	0.21	0.21	0.17
1/4/11 7:00 PM	0.20	0.20	0.17
1/4/11 9:00 PM	0.20	0.20	0.15
1/4/11 11:00 PM	0.18	0.18	0.05
1/5/11 1:00 AM	0.18	0.18	0.03
1/5/11 3:00 AM	0.21	0.21	0.04
1/5/11 5:00 AM	0.26	0.26	0.04
1/5/11 7:00 AM	0.27	0.27	0.05
1/5/11 9:00 AM	0.24	0.24	0.17
1/5/11 11:00 AM	0.23	0.23	0.20
1/5/11 1:00 PM	0.13	0.13	0.18
1/5/11 3:00 PM	0.07	0.07	0.18
1/5/11 5:00 PM	0.08	0.08	0.19
1/5/11 7:00 PM	0.10	0.10	0.21
1/5/11 9:00 PM	0.11	0.11	0.13
1/5/11 11:00 PM	0.12	0.12	0.05
1/6/11 1:00 AM	0.24	0.24	0.05
1/6/11 3:00 AM	0.21	0.21	0.05
1/6/11 5:00 AM	0.20	0.20	0.06
1/6/11 7:00 AM	0.23	0.23	0.10
1/6/11 9:00 AM	0.15	0.15	0.30
1/6/11 11:00 AM	0.09	0.09	0.24
1/6/11 1:00 PM	0.05	0.05	0.19
1/6/11 3:00 PM	0.17	0.17	0.17
1/6/11 5:00 PM	0.23	0.23	0.18
1/6/11 7:00 PM	0.22	0.22	0.17
1/6/11 9:00 PM	0.22	0.22	0.16
1/6/11 11:00 PM	0.21	0.21	0.08
1/7/11 1:00 AM	0.21	0.21	0.04
1/7/11 3:00 AM	0.21	0.21	0.04
1/7/11 5:00 AM	0.19	0.19	0.05
1/7/11 7:00 AM	0.17	0.17	0.22
1/7/11 9:00 AM	0.21	0.21	0.21
1/7/11 11:00 AM	0.20	0.20	0.17
1/7/11 1:00 PM	0.21	0.21	0.16
1/7/11 3:00 PM	0.21	0.21	0.16
1/7/11 5:00 PM	0.21	0.21	0.15
1/7/11 7:00 PM	0.20	0.20	0.14
1/7/11 9:00 PM	0.15	0.15	0.12
1/7/11 11:00 PM	0.09	0.09	0.09
1/8/11 1:00 AM	0.23	0.23	0.04
1/8/11 3:00 AM	0.23	0.23	0.03
1/8/11 5:00 AM	0.22	0.22	0.04
1/8/11 7:00 AM	0.13	0.13	0.10
1/8/11 9:00 AM	0.08	0.08	0.12
1/8/11 11:00 AM	0.08	0.08	0.10
1/8/11 1:00 PM	0.17	0.17	0.16

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
1/8/11 3:00 PM	0.24	0.24	0.12
1/8/11 5:00 PM	0.24	0.24	0.12
1/8/11 7:00 PM	0.11	0.11	0.16
1/8/11 9:00 PM	0.12	0.12	0.12
1/8/11 11:00 PM	0.12	0.12	0.09
1/9/11 1:00 AM	0.25	0.25	0.05
1/9/11 3:00 AM	0.27	0.27	0.06
1/9/11 5:00 AM	0.27	0.27	0.07
1/9/11 7:00 AM	0.22	0.22	0.14
1/9/11 9:00 AM	0.25	0.25	0.15
1/9/11 11:00 AM	0.24	0.24	0.14
1/9/11 1:00 PM	0.22	0.22	0.11
1/9/11 3:00 PM	0.23	0.23	0.05
1/9/11 5:00 PM	0.23	0.23	0.04
1/9/11 7:00 PM	0.12	0.12	0.05
1/9/11 9:00 PM	0.09	0.09	0.13
1/9/11 11:00 PM	0.21	0.21	0.22
1/10/11 1:00 AM	0.21	0.21	0.11
1/10/11 3:00 AM	0.19	0.19	0.09
1/10/11 5:00 AM	0.22	0.22	0.10
1/10/11 7:00 AM	0.16	0.16	0.10
1/10/11 9:00 AM	0.21	0.21	0.10
1/10/11 11:00 AM	0.22	0.22	0.10
1/10/11 1:00 PM	0.19	0.19	0.10
1/10/11 3:00 PM	0.16	0.16	0.10
1/10/11 5:00 PM	0.27	0.27	0.10
1/10/11 7:00 PM	0.21	0.21	0.11
1/10/11 9:00 PM	0.23	0.23	0.10
1/10/11 11:00 PM	0.20	0.20	0.10
1/11/11 1:00 AM	0.15	0.15	0.07
1/11/11 3:00 AM	0.16	0.16	0.05
1/11/11 5:00 AM	0.17	0.17	0.07
1/11/11 7:00 AM	0.22	0.22	0.10
1/11/11 9:00 AM	0.23	0.23	0.08
1/11/11 11:00 AM	0.23	0.23	0.07
1/11/11 1:00 PM	0.21	0.21	0.08
1/11/11 3:00 PM	0.21	0.21	0.08
1/11/11 5:00 PM	0.21	0.21	0.07
1/11/11 7:00 PM	0.22	0.22	0.09
1/11/11 9:00 PM	0.22	0.22	0.09
1/11/11 11:00 PM	0.23	0.23	0.09
1/12/11 1:00 AM	0.21	0.21	0.10
1/12/11 3:00 AM	0.19	0.19	0.10
1/12/11 5:00 AM	0.21	0.21	0.10
1/12/11 7:00 AM	0.23	0.23	0.11
1/12/11 9:00 AM	0.22	0.22	0.11
1/12/11 11:00 AM	0.23	0.23	0.11
1/12/11 1:00 PM	0.24	0.24	0.10
1/12/11 3:00 PM	0.25	0.25	0.10
1/12/11 5:00 PM	0.22	0.22	0.10
1/12/11 7:00 PM	0.22	0.22	0.10
1/12/11 9:00 PM	0.20	0.20	0.10
1/12/11 11:00 PM	0.20	0.20	0.03

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
1/13/11 1:00 AM	0.20	0.20	0.03
1/13/11 3:00 AM	0.20	0.20	0.06
1/13/11 5:00 AM	0.20	0.20	0.12
1/13/11 7:00 AM	0.21	0.21	0.16
1/13/11 9:00 AM	0.20	0.20	0.15
1/13/11 11:00 AM	0.21	0.21	0.11
1/13/11 1:00 PM	0.20	0.20	0.08
1/13/11 3:00 PM	0.17	0.17	0.10
1/13/11 5:00 PM	0.19	0.19	0.10
1/13/11 7:00 PM	0.21	0.21	0.10
1/13/11 9:00 PM	0.22	0.22	0.11
1/13/11 11:00 PM	0.22	0.22	0.11
1/14/11 1:00 AM	0.22	0.22	0.11
1/14/11 3:00 AM	0.23	0.23	0.11
1/14/11 5:00 AM	0.22	0.22	0.22
1/14/11 7:00 AM	0.22	0.22	0.15
1/14/11 9:00 AM	0.22	0.22	0.14
1/14/11 11:00 AM	0.21	0.21	0.14
1/14/11 1:00 PM	0.21	0.21	0.14
1/14/11 3:00 PM	0.18	0.18	0.13
1/14/11 5:00 PM	0.19	0.19	0.14
1/14/11 7:00 PM	0.20	0.20	0.12
1/14/11 9:00 PM	0.20	0.20	0.11
1/14/11 11:00 PM	0.21	0.21	0.08
1/15/11 1:00 AM	0.21	0.21	0.04
1/15/11 3:00 AM	0.21	0.21	0.05
1/15/11 5:00 AM	0.22	0.22	0.05
1/15/11 7:00 AM	0.22	0.22	0.17
1/15/11 9:00 AM	0.22	0.22	0.15
1/15/11 11:00 AM	0.21	0.21	0.08
1/15/11 1:00 PM	0.21	0.21	0.06
1/15/11 3:00 PM	0.22	0.22	0.08
1/15/11 5:00 PM	0.23	0.23	0.18
1/15/11 7:00 PM	0.23	0.23	0.26
1/15/11 9:00 PM	0.23	0.23	0.27
1/15/11 11:00 PM	0.24	0.24	0.26
1/16/11 1:00 AM	0.26	0.26	0.22
1/16/11 3:00 AM	0.27	0.27	0.16
1/16/11 5:00 AM	0.27	0.27	0.15
1/16/11 7:00 AM	0.27	0.27	0.14
1/16/11 9:00 AM	0.25	0.25	0.14
1/16/11 11:00 AM	0.25	0.25	0.15
1/16/11 1:00 PM	0.23	0.23	0.13
1/16/11 3:00 PM	0.22	0.22	0.11
1/16/11 5:00 PM	0.22	0.22	0.11
1/16/11 7:00 PM	0.22	0.22	0.11
1/16/11 9:00 PM	0.23	0.23	0.05
1/16/11 11:00 PM	0.24	0.24	0.05
1/17/11 1:00 AM	0.24	0.24	0.06
1/17/11 3:00 AM	0.24	0.24	0.07
1/17/11 5:00 AM	0.23	0.23	0.09
1/17/11 7:00 AM	0.22	0.22	0.23
1/17/11 9:00 AM	0.19	0.19	0.19

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
1/17/11 11:00 AM	0.18	0.18	0.15
1/17/11 1:00 PM	0.19	0.19	0.15
1/17/11 3:00 PM	0.22	0.22	0.12
1/17/11 5:00 PM	0.15	0.15	0.11
1/17/11 7:00 PM	0.11	0.11	0.10
1/17/11 9:00 PM	0.10	0.10	0.09
1/17/11 11:00 PM	0.11	0.11	0.04
1/18/11 1:00 AM	0.13	0.13	0.03
1/18/11 3:00 AM	0.13	0.13	0.03
1/18/11 5:00 AM	0.14	0.14	0.05
1/18/11 7:00 AM	0.17	0.17	0.11
1/18/11 9:00 AM	0.22	0.22	0.11
1/18/11 11:00 AM	0.21	0.21	0.11
1/18/11 1:00 PM	0.21	0.21	0.10
1/18/11 3:00 PM	0.22	0.22	0.10
1/18/11 5:00 PM	0.23	0.23	0.10
1/18/11 7:00 PM	0.22	0.22	0.09
1/18/11 9:00 PM	0.23	0.23	0.10
1/18/11 11:00 PM	0.23	0.23	0.05
1/19/11 1:00 AM	0.24	0.24	0.05
1/19/11 3:00 AM	0.24	0.24	0.05
1/19/11 5:00 AM	0.22	0.22	0.06
1/19/11 7:00 AM	0.22	0.22	0.16
1/19/11 9:00 AM	0.21	0.21	0.14
1/19/11 11:00 AM	0.22	0.22	0.07
1/19/11 1:00 PM	0.22	0.22	0.11
1/19/11 3:00 PM	0.23	0.23	0.11
1/19/11 5:00 PM	0.22	0.22	0.12
1/19/11 7:00 PM	0.21	0.21	0.21
1/19/11 9:00 PM	0.20	0.20	0.14
1/19/11 11:00 PM	0.20	0.20	0.12
1/20/11 1:00 AM	0.20	0.20	0.07
1/20/11 3:00 AM	0.20	0.20	0.09
1/20/11 5:00 AM	0.19	0.19	0.11
1/20/11 7:00 AM	0.19	0.19	0.19
1/20/11 9:00 AM	0.20	0.20	0.20
1/20/11 11:00 AM	0.21	0.21	0.18
1/20/11 1:00 PM	0.21	0.21	0.18
1/20/11 3:00 PM	0.21	0.21	0.19
1/20/11 5:00 PM	0.13	0.13	0.17
1/20/11 7:00 PM	0.14	0.14	0.17
1/20/11 9:00 PM	0.14	0.14	0.17
1/20/11 11:00 PM	0.14	0.14	0.14
1/21/11 1:00 AM	0.10	0.10	0.07
1/21/11 3:00 AM	0.10	0.10	0.07
1/21/11 5:00 AM	0.13	0.13	0.10
1/21/11 7:00 AM	0.15	0.15	0.11
1/21/11 9:00 AM	0.15	0.15	0.11
1/21/11 11:00 AM	0.14	0.14	0.15
1/21/11 1:00 PM	0.14	0.14	0.16
1/21/11 3:00 PM	0.14	0.14	0.16
1/21/11 5:00 PM	0.13	0.13	0.17
1/21/11 7:00 PM	0.13	0.13	0.16

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
1/21/11 9:00 PM	0.13	0.13	0.16
1/21/11 11:00 PM	0.14	0.14	0.14
1/22/11 1:00 AM	0.13	0.13	0.10
1/22/11 3:00 AM	0.10	0.10	0.10
1/22/11 5:00 AM	0.10	0.10	0.11
1/22/11 7:00 AM	0.10	0.10	0.20
1/22/11 9:00 AM	0.14	0.14	0.25
1/22/11 11:00 AM	0.14	0.14	0.24
1/22/11 1:00 PM	0.18	0.18	0.15
1/22/11 3:00 PM	0.20	0.20	0.16
1/22/11 5:00 PM	0.21	0.21	0.13
1/22/11 7:00 PM	0.13	0.13	0.12
1/22/11 9:00 PM	0.21	0.21	0.13
1/22/11 11:00 PM	0.11	0.11	0.02
1/23/11 1:00 AM	0.12	0.12	0.00
1/23/11 3:00 AM	0.11	0.11	0.00
1/23/11 5:00 AM	0.12	0.12	0.00
1/23/11 7:00 AM	0.12	0.12	0.00
1/23/11 9:00 AM	0.12	0.12	0.00
1/23/11 11:00 AM	0.15	0.15	0.00
1/23/11 1:00 PM	0.15	0.15	0.00
1/23/11 3:00 PM	0.14	0.14	0.00
1/23/11 5:00 PM	0.13	0.13	0.00
1/23/11 7:00 PM	0.10	0.10	0.00
1/23/11 9:00 PM	0.10	0.10	0.00
1/23/11 11:00 PM	0.08	0.08	0.00
1/24/11 1:00 AM	0.10	0.10	0.00
1/24/11 3:00 AM	0.11	0.11	0.00
1/24/11 5:00 AM	0.07	0.07	0.00
1/24/11 7:00 AM	0.06	0.06	0.00
1/24/11 9:00 AM	0.06	0.06	0.00
1/24/11 11:00 AM	0.07	0.07	0.00
1/24/11 1:00 PM	0.08	0.08	0.00
1/24/11 3:00 PM	0.08	0.08	0.00
1/24/11 5:00 PM	0.07	0.07	0.00
1/24/11 7:00 PM	0.04	0.04	0.00
1/24/11 9:00 PM	0.06	0.06	0.00
1/24/11 11:00 PM	0.06	0.06	0.00
1/25/11 1:00 AM	0.16	0.16	0.00
1/25/11 3:00 AM	0.16	0.16	0.00
1/25/11 5:00 AM	0.15	0.15	0.00
1/25/11 7:00 AM	0.19	0.19	0.00
1/25/11 9:00 AM	0.15	0.15	0.00
1/25/11 11:00 AM	0.12	0.12	0.00
1/25/11 1:00 PM	0.07	0.07	0.00
1/25/11 3:00 PM	0.08	0.08	0.00
1/25/11 5:00 PM	0.05	0.05	0.00
1/25/11 7:00 PM	0.02	0.02	0.00
1/25/11 9:00 PM	0.02	0.02	0.00
1/25/11 11:00 PM	0.06	0.06	0.00
1/26/11 1:00 AM	0.09	0.09	0.00
1/26/11 3:00 AM	0.09	0.09	0.00
1/26/11 5:00 AM	0.08	0.08	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
1/26/11 7:00 AM	0.09	0.09	0.00
1/26/11 9:00 AM	0.09	0.09	0.00
1/26/11 11:00 AM	0.10	0.10	0.00
1/26/11 1:00 PM	0.10	0.10	0.00
1/26/11 3:00 PM	0.10	0.10	0.00
1/26/11 5:00 PM	0.09	0.09	0.00
1/26/11 7:00 PM	0.09	0.09	0.00
1/26/11 9:00 PM	0.09	0.09	0.00
1/26/11 11:00 PM	0.09	0.09	0.00
1/27/11 1:00 AM	0.09	0.09	0.00
1/27/11 3:00 AM	0.09	0.09	0.00
1/27/11 5:00 AM	0.09	0.09	0.00
1/27/11 7:00 AM	0.09	0.09	0.00
1/27/11 9:00 AM	0.09	0.09	0.00
1/27/11 11:00 AM	0.13	0.13	0.00
1/27/11 1:00 PM	0.09	0.09	0.00
1/27/11 3:00 PM	0.09	0.09	0.00
1/27/11 5:00 PM	0.09	0.09	0.00
1/27/11 7:00 PM	0.09	0.09	0.02
1/27/11 9:00 PM	0.09	0.09	0.15
1/27/11 11:00 PM	0.08	0.08	0.39
1/28/11 1:00 AM	0.08	0.08	0.12
1/28/11 3:00 AM	0.08	0.08	0.14
1/28/11 5:00 AM	0.09	0.09	0.14
1/28/11 7:00 AM	0.09	0.09	0.16
1/28/11 9:00 AM	0.10	0.10	0.16
1/28/11 11:00 AM	0.11	0.11	0.15
1/28/11 1:00 PM	0.10	0.10	0.14
1/28/11 3:00 PM	0.10	0.10	0.13
1/28/11 5:00 PM	0.11	0.11	0.12
1/28/11 7:00 PM	0.11	0.11	0.12
1/28/11 9:00 PM	0.10	0.10	0.13
1/28/11 11:00 PM	0.09	0.09	0.14
1/29/11 1:00 AM	0.09	0.09	0.14
1/29/11 3:00 AM	0.08	0.08	0.13
1/29/11 5:00 AM	0.09	0.09	0.14
1/29/11 7:00 AM	0.09	0.09	0.13
1/29/11 9:00 AM	0.09	0.09	0.13
1/29/11 11:00 AM	0.09	0.09	0.12
1/29/11 1:00 PM	0.09	0.09	0.11
1/29/11 3:00 PM	0.09	0.09	0.06
1/29/11 5:00 PM	0.10	0.10	0.04
1/29/11 7:00 PM	0.11	0.11	0.05
1/29/11 9:00 PM	0.11	0.11	0.09
1/29/11 11:00 PM	0.11	0.11	0.11
1/30/11 1:00 AM	0.12	0.12	0.12
1/30/11 3:00 AM	0.11	0.11	0.12
1/30/11 5:00 AM	0.10	0.10	0.12
1/30/11 7:00 AM	0.11	0.11	0.12
1/30/11 9:00 AM	0.10	0.10	0.14
1/30/11 11:00 AM	0.11	0.11	0.13
1/30/11 1:00 PM	0.11	0.11	0.13
1/30/11 3:00 PM	0.11	0.11	0.13

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
1/30/11 5:00 PM	0.11	0.11	0.13
1/30/11 7:00 PM	0.11	0.11	0.13
1/30/11 9:00 PM	0.11	0.11	0.12
1/30/11 11:00 PM	0.11	0.11	0.11
1/31/11 1:00 AM	0.11	0.11	0.12
1/31/11 3:00 AM	0.11	0.11	0.13
1/31/11 5:00 AM	0.11	0.11	0.13
1/31/11 7:00 AM	0.12	0.12	0.14
1/31/11 9:00 AM	0.14	0.14	0.13
1/31/11 11:00 AM	0.13	0.13	0.13
1/31/11 1:00 PM	0.12	0.12	0.14
1/31/11 3:00 PM	0.13	0.13	0.14
1/31/11 5:00 PM	0.19	0.19	0.16
1/31/11 7:00 PM	0.17	0.17	0.16
1/31/11 9:00 PM	0.16	0.16	0.16
1/31/11 11:00 PM	0.12	0.12	0.15
2/1/11 1:00 AM	0.09	0.09	0.15
2/1/11 3:00 AM	0.09	0.09	0.15
2/1/11 5:00 AM	0.10	0.10	0.13
2/1/11 7:00 AM	0.14	0.14	0.13
2/1/11 9:00 AM	0.16	0.16	0.13
2/1/11 11:00 AM	0.14	0.14	0.16
2/1/11 1:00 PM	0.12	0.12	0.17
2/1/11 3:00 PM	0.11	0.11	0.16
2/1/11 5:00 PM	0.12	0.12	0.16
2/1/11 7:00 PM	0.12	0.12	0.15
2/1/11 9:00 PM	0.13	0.13	0.13
2/1/11 11:00 PM	0.14	0.14	0.12
2/2/11 1:00 AM	0.14	0.14	0.05
2/2/11 3:00 AM	0.12	0.12	0.06
2/2/11 5:00 AM	0.14	0.14	0.07
2/2/11 7:00 AM	0.25	0.25	0.08
2/2/11 9:00 AM	0.23	0.23	0.07
2/2/11 11:00 AM	0.25	0.25	0.07
2/2/11 1:00 PM	0.21	0.21	0.07
2/2/11 3:00 PM	0.23	0.23	0.07
2/2/11 5:00 PM	0.18	0.18	0.08
2/2/11 7:00 PM	0.19	0.19	0.09
2/2/11 9:00 PM	0.16	0.16	0.08
2/2/11 11:00 PM	0.12	0.12	0.08
2/3/11 1:00 AM	0.12	0.12	0.08
2/3/11 3:00 AM	0.12	0.12	0.09
2/3/11 5:00 AM	0.13	0.13	0.13
2/3/11 7:00 AM	0.13	0.13	0.20
2/3/11 9:00 AM	0.15	0.15	0.21
2/3/11 11:00 AM	0.22	0.22	0.20
2/3/11 1:00 PM	0.26	0.26	0.20
2/3/11 3:00 PM	0.24	0.24	0.19
2/3/11 5:00 PM	0.16	0.16	0.20
2/3/11 7:00 PM	0.18	0.18	0.20
2/3/11 9:00 PM	0.21	0.21	0.19
2/3/11 11:00 PM	0.12	0.12	0.19
2/4/11 1:00 AM	0.10	0.10	0.20

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
2/4/11 3:00 AM	0.09	0.09	0.19
2/4/11 5:00 AM	0.10	0.10	0.19
2/4/11 7:00 AM	0.10	0.10	0.19
2/4/11 9:00 AM	0.11	0.11	0.18
2/4/11 11:00 AM	0.20	0.20	0.20
2/4/11 1:00 PM	0.24	0.24	0.19
2/4/11 3:00 PM	2.56	2.56	0.20
2/4/11 5:00 PM	0.24	0.24	0.21
2/4/11 7:00 PM	0.24	0.24	0.20
2/4/11 9:00 PM	0.22	0.22	0.19
2/4/11 11:00 PM	0.17	0.17	0.10
2/5/11 1:00 AM	0.11	0.11	0.09
2/5/11 3:00 AM	0.11	0.11	0.09
2/5/11 5:00 AM	0.11	0.11	0.09
2/5/11 7:00 AM	0.11	0.11	0.11
2/5/11 9:00 AM	0.12	0.12	0.16
2/5/11 11:00 AM	0.22	0.22	0.16
2/5/11 1:00 PM	0.23	0.23	0.15
2/5/11 3:00 PM	0.24	0.24	0.15
2/5/11 5:00 PM	0.24	0.24	0.15
2/5/11 7:00 PM	0.23	0.23	0.15
2/5/11 9:00 PM	0.20	0.20	0.15
2/5/11 11:00 PM	0.13	0.13	0.15
2/6/11 1:00 AM	0.13	0.13	0.12
2/6/11 3:00 AM	0.13	0.13	0.11
2/6/11 5:00 AM	0.13	0.13	0.11
2/6/11 7:00 AM	0.14	0.14	0.12
2/6/11 9:00 AM	0.17	0.17	0.15
2/6/11 11:00 AM	0.15	0.15	0.15
2/6/11 1:00 PM	0.12	0.12	0.15
2/6/11 3:00 PM	0.14	0.14	0.15
2/6/11 5:00 PM	0.17	0.17	0.15
2/6/11 7:00 PM	0.28	0.28	0.14
2/6/11 9:00 PM	0.27	0.27	0.14
2/6/11 11:00 PM	0.27	0.27	0.14
2/7/11 1:00 AM	0.19	0.19	0.11
2/7/11 3:00 AM	0.14	0.14	0.11
2/7/11 5:00 AM	0.14	0.14	0.14
2/7/11 7:00 AM	0.24	0.24	0.14
2/7/11 9:00 AM	0.23	0.23	0.15
2/7/11 11:00 AM	0.10	0.10	0.15
2/7/11 1:00 PM	0.07	0.07	0.15
2/7/11 3:00 PM	0.06	0.06	0.15
2/7/11 5:00 PM	0.08	0.08	0.15
2/7/11 7:00 PM	0.13	0.13	0.16
2/7/11 9:00 PM	0.14	0.14	0.16
2/7/11 11:00 PM	0.12	0.12	0.16
2/8/11 1:00 AM	0.13	0.13	0.17
2/8/11 3:00 AM	0.13	0.13	0.18
2/8/11 5:00 AM	0.13	0.13	0.18
2/8/11 7:00 AM	0.12	0.12	0.18
2/8/11 9:00 AM	0.13	0.13	0.18
2/8/11 11:00 AM	0.12	0.12	0.18

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
2/8/11 1:00 PM	0.12	0.12	0.17
2/8/11 3:00 PM	0.12	0.12	0.18
2/8/11 5:00 PM	0.12	0.12	0.18
2/8/11 7:00 PM	0.13	0.13	0.17
2/8/11 9:00 PM	0.13	0.13	0.16
2/8/11 11:00 PM	0.13	0.13	0.16
2/9/11 1:00 AM	0.11	0.11	0.19
2/9/11 3:00 AM	0.11	0.11	0.18
2/9/11 5:00 AM	0.12	0.12	0.18
2/9/11 7:00 AM	0.11	0.11	0.19
2/9/11 9:00 AM	0.12	0.12	0.19
2/9/11 11:00 AM	0.13	0.13	0.19
2/9/11 1:00 PM	0.12	0.12	0.20
2/9/11 3:00 PM	0.12	0.12	0.84
2/9/11 5:00 PM	0.11	0.11	0.17
2/9/11 7:00 PM	0.12	0.12	0.17
2/9/11 9:00 PM	0.11	0.11	0.18
2/9/11 11:00 PM	0.11	0.11	0.17
2/10/11 1:00 AM	0.10	0.10	0.17
2/10/11 3:00 AM	0.11	0.11	0.17
2/10/11 5:00 AM	0.11	0.11	0.18
2/10/11 7:00 AM	0.13	0.13	0.18
2/10/11 9:00 AM	0.14	0.14	0.18
2/10/11 11:00 AM	0.13	0.13	0.19
2/10/11 1:00 PM	0.13	0.13	0.19
2/10/11 3:00 PM	0.13	0.13	0.19
2/10/11 5:00 PM	0.13	0.13	0.20
2/10/11 7:00 PM	0.13	0.13	0.20
2/10/11 9:00 PM	0.13	0.13	0.18
2/10/11 11:00 PM	0.12	0.12	0.17
2/11/11 1:00 AM	0.12	0.12	0.15
2/11/11 3:00 AM	0.13	0.13	0.14
2/11/11 5:00 AM	0.14	0.14	0.20
2/11/11 7:00 AM	0.14	0.14	0.19
2/11/11 9:00 AM	0.12	0.12	0.19
2/11/11 11:00 AM	0.13	0.13	0.19
2/11/11 1:00 PM	0.14	0.14	0.16
2/11/11 3:00 PM	0.15	0.15	0.15
2/11/11 5:00 PM	0.15	0.15	0.17
2/11/11 7:00 PM	0.13	0.13	0.17
2/11/11 9:00 PM	0.14	0.14	0.16
2/11/11 11:00 PM	0.16	0.16	0.11
2/12/11 1:00 AM	0.16	0.16	0.14
2/12/11 3:00 AM	0.17	0.17	0.04
2/12/11 5:00 AM	0.18	0.18	0.05
2/12/11 7:00 AM	0.17	0.17	0.27
2/12/11 9:00 AM	0.16	0.16	0.18
2/12/11 11:00 AM	0.17	0.17	0.21
2/12/11 1:00 PM	0.18	0.18	0.17
2/12/11 3:00 PM	0.18	0.18	0.20
2/12/11 5:00 PM	0.19	0.19	0.19
2/12/11 7:00 PM	0.18	0.18	0.18
2/12/11 9:00 PM	0.19	0.19	0.19

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
2/12/11 11:00 PM	0.19	0.19	0.18
2/13/11 1:00 AM	0.18	0.18	0.18
2/13/11 3:00 AM	0.18	0.18	0.18
2/13/11 5:00 AM	0.17	0.17	0.18
2/13/11 7:00 AM	0.18	0.18	0.19
2/13/11 9:00 AM	0.17	0.17	0.18
2/13/11 11:00 AM	0.15	0.15	0.19
2/13/11 1:00 PM	0.14	0.14	0.19
2/13/11 3:00 PM	0.14	0.14	0.19
2/13/11 5:00 PM	0.14	0.14	0.19
2/13/11 7:00 PM	0.15	0.15	0.19
2/13/11 9:00 PM	0.14	0.14	0.19
2/13/11 11:00 PM	0.12	0.12	0.20
2/14/11 1:00 AM	0.12	0.12	0.20
2/14/11 3:00 AM	0.12	0.12	0.20
2/14/11 5:00 AM	0.13	0.13	0.20
2/14/11 7:00 AM	0.16	0.16	0.20
2/14/11 9:00 AM	0.25	0.25	0.19
2/14/11 11:00 AM	0.23	0.23	0.19
2/14/11 1:00 PM	0.22	0.22	0.19
2/14/11 3:00 PM	0.23	0.23	0.19
2/14/11 5:00 PM	0.23	0.23	0.19
2/14/11 7:00 PM	0.22	0.22	0.19
2/14/11 9:00 PM	0.22	0.22	0.20
2/14/11 11:00 PM	0.22	0.22	0.21
2/15/11 1:00 AM	0.22	0.22	0.20
2/15/11 3:00 AM	0.22	0.22	0.21
2/15/11 5:00 AM	0.23	0.23	0.20
2/15/11 7:00 AM	0.23	0.23	0.21
2/15/11 9:00 AM	0.22	0.22	0.21
2/15/11 11:00 AM	0.21	0.21	0.23
2/15/11 1:00 PM	0.21	0.21	0.23
2/15/11 3:00 PM	0.21	0.21	0.22
2/15/11 5:00 PM	0.22	0.22	0.23
2/15/11 7:00 PM	0.22	0.22	0.22
2/15/11 9:00 PM	0.22	0.22	0.22
2/15/11 11:00 PM	0.22	0.22	0.21
2/16/11 1:00 AM	0.22	0.22	0.19
2/16/11 3:00 AM	0.22	0.22	0.19
2/16/11 5:00 AM	0.21	0.21	0.22
2/16/11 7:00 AM	0.22	0.22	0.23
2/16/11 9:00 AM	0.21	0.21	0.22
2/16/11 11:00 AM	0.21	0.21	0.23
2/16/11 1:00 PM	0.22	0.22	0.24
2/16/11 3:00 PM	0.22	0.22	0.22
2/16/11 5:00 PM	0.22	0.22	0.14
2/16/11 7:00 PM	0.21	0.21	0.13
2/16/11 9:00 PM	0.21	0.21	0.14
2/16/11 11:00 PM	0.22	0.22	0.16
2/17/11 1:00 AM	0.24	0.24	0.23
2/17/11 3:00 AM	0.24	0.24	0.20
2/17/11 5:00 AM	0.22	0.22	0.17
2/17/11 7:00 AM	0.22	0.22	0.25

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
2/17/11 9:00 AM	0.22	0.22	0.24
2/17/11 11:00 AM	0.21	0.21	0.22
2/17/11 1:00 PM	0.21	0.21	0.20
2/17/11 3:00 PM	0.21	0.21	0.22
2/17/11 5:00 PM	0.22	0.22	0.23
2/17/11 7:00 PM	0.23	0.23	0.23
2/17/11 9:00 PM	0.23	0.23	0.24
2/17/11 11:00 PM	0.23	0.23	0.20
2/18/11 1:00 AM	0.25	0.25	0.15
2/18/11 3:00 AM	0.23	0.23	0.15
2/18/11 5:00 AM	0.25	0.25	0.23
2/18/11 7:00 AM	0.22	0.22	0.25
2/18/11 9:00 AM	0.20	0.20	0.27
2/18/11 11:00 AM	0.20	0.20	0.30
2/18/11 1:00 PM	0.21	0.21	0.20
2/18/11 3:00 PM	0.21	0.21	0.21
2/18/11 5:00 PM	0.13	0.13	0.21
2/18/11 7:00 PM	0.09	0.09	0.20
2/18/11 9:00 PM	0.00	0.00	0.18
2/18/11 11:00 PM	0.00	0.00	0.19
2/19/11 1:00 AM	0.00	0.00	0.14
2/19/11 3:00 AM	0.00	0.00	0.15
2/19/11 5:00 AM	0.00	0.00	0.19
2/19/11 7:00 AM	0.00	0.00	0.18
2/19/11 9:00 AM	0.00	0.00	0.19
2/19/11 11:00 AM	0.00	0.00	0.18
2/19/11 1:00 PM	0.00	0.00	0.18
2/19/11 3:00 PM	0.00	0.00	0.18
2/19/11 5:00 PM	0.00	0.00	0.17
2/19/11 7:00 PM	0.00	0.00	0.16
2/19/11 9:00 PM	0.00	0.00	0.15
2/19/11 11:00 PM	0.00	0.00	0.14
2/20/11 1:00 AM	0.00	0.00	0.14
2/20/11 3:00 AM	0.00	0.00	0.11
2/20/11 5:00 AM	0.00	0.00	0.12
2/20/11 7:00 AM	0.00	0.00	0.14
2/20/11 9:00 AM	0.00	0.00	0.14
2/20/11 11:00 AM	0.00	0.00	0.15
2/20/11 1:00 PM	0.00	0.00	0.16
2/20/11 3:00 PM	0.00	0.00	0.17
2/20/11 5:00 PM	0.00	0.00	0.16
2/20/11 7:00 PM	0.00	0.00	0.16
2/20/11 9:00 PM	0.00	0.00	0.16
2/20/11 11:00 PM	0.00	0.00	0.14
2/21/11 1:00 AM	0.00	0.00	0.10
2/21/11 3:00 AM	0.00	0.00	0.10
2/21/11 5:00 AM	0.00	0.00	0.13
2/21/11 7:00 AM	0.00	0.00	0.15
2/21/11 9:00 AM	0.00	0.00	0.14
2/21/11 11:00 AM	0.00	0.00	0.14
2/21/11 1:00 PM	0.00	0.00	0.14
2/21/11 3:00 PM	0.00	0.00	0.15
2/21/11 5:00 PM	0.00	0.00	0.15

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
2/21/11 7:00 PM	0.00	0.00	0.15
2/21/11 9:00 PM	0.00	0.00	0.15
2/21/11 11:00 PM	0.00	0.00	0.15
2/22/11 1:00 AM	0.00	0.00	0.15
2/22/11 3:00 AM	0.00	0.00	0.16
2/22/11 5:00 AM	0.00	0.00	0.16
2/22/11 7:00 AM	0.00	0.00	0.17
2/22/11 9:00 AM	0.00	0.00	0.17
2/22/11 11:00 AM	0.00	0.00	0.18
2/22/11 1:00 PM	0.00	0.00	0.18
2/22/11 3:00 PM	0.00	0.00	0.19
2/22/11 5:00 PM	0.00	0.00	0.19
2/22/11 7:00 PM	0.00	0.00	0.20
2/22/11 9:00 PM	0.00	0.00	0.20
2/22/11 11:00 PM	0.00	0.00	0.20
2/23/11 1:00 AM	0.00	0.00	0.20
2/23/11 3:00 AM	0.00	0.00	0.21
2/23/11 5:00 AM	0.00	0.00	0.22
2/23/11 7:00 AM	0.00	0.00	0.22
2/23/11 9:00 AM	0.00	0.00	0.19
2/23/11 11:00 AM	0.00	0.00	0.17
2/23/11 1:00 PM	0.00	0.00	0.18
2/23/11 3:00 PM	0.00	0.00	0.18
2/23/11 5:00 PM	0.00	0.00	0.18
2/23/11 7:00 PM	0.00	0.00	0.19
2/23/11 9:00 PM	0.00	0.00	0.19
2/23/11 11:00 PM	0.00	0.00	0.19
2/24/11 1:00 AM	0.00	0.00	0.19
2/24/11 3:00 AM	0.00	0.00	0.19
2/24/11 5:00 AM	0.00	0.00	0.18
2/24/11 7:00 AM	0.00	0.00	0.21
2/24/11 9:00 AM	0.00	0.00	0.21
2/24/11 11:00 AM	0.00	0.00	0.22
2/24/11 1:00 PM	0.00	0.00	0.22
2/24/11 3:00 PM	0.00	0.00	0.18
2/24/11 5:00 PM	0.00	0.00	0.22
2/24/11 7:00 PM	0.00	0.00	0.22
2/24/11 9:00 PM	0.00	0.00	0.22
2/24/11 11:00 PM	0.00	0.00	0.23
2/25/11 1:00 AM	0.00	0.00	0.24
2/25/11 3:00 AM	0.00	0.00	0.20
2/25/11 5:00 AM	0.00	0.00	0.25
2/25/11 7:00 AM	0.00	0.00	0.26
2/25/11 9:00 AM	0.00	0.00	0.25
2/25/11 11:00 AM	0.00	0.00	0.27
2/25/11 1:00 PM	0.00	0.00	0.28
2/25/11 3:00 PM	0.00	0.00	0.29
2/25/11 5:00 PM	0.00	0.00	0.28
2/25/11 7:00 PM	0.00	0.00	0.17
2/25/11 9:00 PM	0.00	0.00	0.11
2/25/11 11:00 PM	0.00	0.00	0.11
2/26/11 1:00 AM	0.00	0.00	0.12
2/26/11 3:00 AM	0.00	0.00	0.12

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
2/26/11 5:00 AM	0.00	0.00	0.12
2/26/11 7:00 AM	0.00	0.00	0.12
2/26/11 9:00 AM	0.00	0.00	0.12
2/26/11 11:00 AM	0.00	0.00	0.12
2/26/11 1:00 PM	0.00	0.00	0.12
2/26/11 3:00 PM	0.00	0.00	0.13
2/26/11 5:00 PM	0.00	0.00	0.13
2/26/11 7:00 PM	0.00	0.00	0.14
2/26/11 9:00 PM	0.00	0.00	0.14
2/26/11 11:00 PM	0.00	0.00	0.14
2/27/11 1:00 AM	0.00	0.00	0.14
2/27/11 3:00 AM	0.00	0.00	0.14
2/27/11 5:00 AM	0.00	0.00	0.12
2/27/11 7:00 AM	0.00	0.00	0.14
2/27/11 9:00 AM	0.00	0.00	0.18
2/27/11 11:00 AM	0.00	0.00	0.28
2/27/11 1:00 PM	0.00	0.00	0.26
2/27/11 3:00 PM	0.00	0.00	0.23
2/27/11 5:00 PM	0.00	0.00	0.22
2/27/11 7:00 PM	0.00	0.00	0.23
2/27/11 9:00 PM	0.00	0.00	0.24
2/27/11 11:00 PM	0.00	0.00	0.22
2/28/11 1:00 AM	0.00	0.00	0.22
2/28/11 3:00 AM	0.00	0.00	0.23
2/28/11 5:00 AM	0.00	0.00	0.23
2/28/11 7:00 AM	0.00	0.00	0.21
2/28/11 9:00 AM	0.00	0.00	0.18
2/28/11 11:00 AM	0.00	0.00	0.21
2/28/11 1:00 PM	0.00	0.00	0.23
2/28/11 3:00 PM	0.00	0.00	0.25
2/28/11 5:00 PM	0.00	0.00	0.23
2/28/11 7:00 PM	0.00	0.00	0.25
2/28/11 9:00 PM	0.00	0.00	0.22
2/28/11 11:00 PM	0.00	0.00	0.19
3/1/11 1:00 AM	0.00	0.00	0.19
3/1/11 3:00 AM	0.00	0.00	0.19
3/1/11 5:00 AM	0.00	0.00	0.21
3/1/11 7:00 AM	0.00	0.00	0.23
3/1/11 9:00 AM	0.00	0.00	0.25
3/1/11 11:00 AM	0.00	0.00	0.26
3/1/11 1:00 PM	0.00	0.00	0.25
3/1/11 3:00 PM	0.00	0.00	0.23
3/1/11 5:00 PM	0.00	0.00	0.24
3/1/11 7:00 PM	0.00	0.00	0.26
3/1/11 9:00 PM	0.00	0.00	0.19
3/1/11 11:00 PM	0.00	0.00	0.13
3/2/11 1:00 AM	0.00	0.00	0.21
3/2/11 3:00 AM	0.00	0.00	0.21
3/2/11 5:00 AM	0.00	0.00	0.20
3/2/11 7:00 AM	0.00	0.00	0.28
3/2/11 9:00 AM	0.00	0.00	0.26
3/2/11 11:00 AM	0.00	0.00	0.21
3/2/11 1:00 PM	0.00	0.00	0.28

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
3/2/11 3:00 PM	0.00	0.00	0.18
3/2/11 5:00 PM	0.00	0.00	0.33
3/2/11 7:00 PM	0.00	0.00	0.28
3/2/11 9:00 PM	0.00	0.00	0.23
3/2/11 11:00 PM	0.00	0.00	0.23
3/3/11 1:00 AM	0.00	0.00	0.23
3/3/11 3:00 AM	0.00	0.00	0.24
3/3/11 5:00 AM	0.00	0.00	0.25
3/3/11 7:00 AM	0.00	0.00	0.26
3/3/11 9:00 AM	0.00	0.00	0.27
3/3/11 11:00 AM	0.00	0.00	0.27
3/3/11 1:00 PM	0.00	0.00	0.27
3/3/11 3:00 PM	0.00	0.00	0.27
3/3/11 5:00 PM	0.00	0.00	0.28
3/3/11 7:00 PM	0.00	0.00	0.28
3/3/11 9:00 PM	0.00	0.00	0.28
3/3/11 11:00 PM	0.00	0.00	0.26
3/4/11 1:00 AM	0.00	0.00	0.22
3/4/11 3:00 AM	0.00	0.00	0.23
3/4/11 5:00 AM	0.00	0.00	0.23
3/4/11 7:00 AM	0.09	0.09	0.25
3/4/11 9:00 AM	0.04	0.04	0.24
3/4/11 11:00 AM	0.26	0.00	0.22
3/4/11 1:00 PM	0.02	0.00	0.27
3/4/11 3:00 PM	0.05	0.00	0.25
3/4/11 5:00 PM	0.06	0.00	0.24
3/4/11 7:00 PM	0.13	0.00	0.23
3/4/11 9:00 PM	0.23	0.00	0.21
3/4/11 11:00 PM	0.35	0.00	0.18
3/5/11 1:00 AM	0.28	0.00	0.15
3/5/11 3:00 AM	0.25	0.00	0.14
3/5/11 5:00 AM	0.25	0.00	0.13
3/5/11 7:00 AM	0.24	0.00	0.17
3/5/11 9:00 AM	0.26	0.00	0.21
3/5/11 11:00 AM	0.29	0.00	0.22
3/5/11 1:00 PM	0.30	0.00	0.22
3/5/11 3:00 PM	0.29	0.00	0.22
3/5/11 5:00 PM	0.10	0.10	0.22
3/5/11 7:00 PM	0.16	0.16	0.22
3/5/11 9:00 PM	0.22	0.22	0.22
3/5/11 11:00 PM	0.25	0.25	0.24
3/6/11 1:00 AM	0.25	0.25	0.25
3/6/11 3:00 AM	0.20	0.20	0.20
3/6/11 5:00 AM	0.24	0.24	0.05
3/6/11 7:00 AM	0.24	0.24	0.00
3/6/11 9:00 AM	0.22	0.22	0.00
3/6/11 11:00 AM	0.19	0.19	0.00
3/6/11 1:00 PM	0.17	0.17	0.00
3/6/11 3:00 PM	0.17	0.17	0.00
3/6/11 5:00 PM	0.19	0.19	0.00
3/6/11 7:00 PM	0.18	0.18	0.00
3/6/11 9:00 PM	0.18	0.18	0.00
3/6/11 11:00 PM	0.18	0.18	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
3/7/11 1:00 AM	0.17	0.17	0.00
3/7/11 3:00 AM	0.18	0.18	0.00
3/7/11 5:00 AM	0.18	0.18	0.00
3/7/11 7:00 AM	0.18	0.18	0.00
3/7/11 9:00 AM	0.17	0.17	0.00
3/7/11 11:00 AM	0.19	0.19	0.00
3/7/11 1:00 PM	0.19	0.19	0.00
3/7/11 3:00 PM	0.19	0.19	0.00
3/7/11 5:00 PM	0.18	0.18	0.00
3/7/11 7:00 PM	0.17	0.17	0.00
3/7/11 9:00 PM	0.16	0.16	0.00
3/7/11 11:00 PM	0.16	0.16	0.00
3/8/11 1:00 AM	0.15	0.15	0.00
3/8/11 3:00 AM	0.15	0.15	0.00
3/8/11 5:00 AM	0.14	0.14	0.00
3/8/11 7:00 AM	0.14	0.14	0.00
3/8/11 9:00 AM	0.15	0.15	0.00
3/8/11 11:00 AM	0.16	0.16	0.00
3/8/11 1:00 PM	0.15	0.15	0.00
3/8/11 3:00 PM	0.13	0.13	0.00
3/8/11 5:00 PM	0.10	0.10	0.00
3/8/11 7:00 PM	0.09	0.09	0.00
3/8/11 9:00 PM	0.08	0.08	0.00
3/8/11 11:00 PM	0.08	0.08	0.00
3/9/11 1:00 AM	0.07	0.07	0.00
3/9/11 3:00 AM	0.08	0.08	0.00
3/9/11 5:00 AM	0.09	0.09	0.00
3/9/11 7:00 AM	0.12	0.12	0.00
3/9/11 9:00 AM	0.12	0.12	0.00
3/9/11 11:00 AM	0.11	0.11	0.00
3/9/11 1:00 PM	0.12	0.12	0.00
3/9/11 3:00 PM	0.12	0.12	0.00
3/9/11 5:00 PM	0.13	0.13	0.00
3/9/11 7:00 PM	0.13	0.13	0.00
3/9/11 9:00 PM	0.00	0.00	0.00
3/9/11 11:00 PM	0.00	0.00	0.00
3/10/11 1:00 AM	0.00	0.00	0.00
3/10/11 3:00 AM	0.00	0.00	0.00
3/10/11 5:00 AM	0.00	0.00	0.00
3/10/11 7:00 AM	0.00	0.00	0.00
3/10/11 9:00 AM	0.00	0.00	0.00
3/10/11 11:00 AM	0.00	0.00	0.00
3/10/11 1:00 PM	0.00	0.00	0.00
3/10/11 3:00 PM	0.00	0.00	0.00
3/10/11 5:00 PM	0.00	0.00	0.00
3/10/11 7:00 PM	0.00	0.00	0.00
3/10/11 9:00 PM	0.00	0.00	0.00
3/10/11 11:00 PM	0.00	0.00	0.00
3/11/11 1:00 AM	0.00	0.00	0.00
3/11/11 3:00 AM	0.00	0.00	0.00
3/11/11 5:00 AM	0.00	0.00	0.00
3/11/11 7:00 AM	0.00	0.00	0.00
3/11/11 9:00 AM	0.00	0.00	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
3/11/11 11:00 AM	0.00	0.00	0.00
3/11/11 1:00 PM	0.00	0.00	0.00
3/11/11 3:00 PM	0.00	0.00	0.00
3/11/11 5:00 PM	0.00	0.00	0.00
3/11/11 7:00 PM	0.00	0.00	0.00
3/11/11 9:00 PM	0.00	0.00	0.00
3/11/11 11:00 PM	0.00	0.00	0.00
3/12/11 1:00 AM	0.00	0.00	0.00
3/12/11 3:00 AM	0.00	0.00	0.00
3/12/11 5:00 AM	0.00	0.00	0.00
3/12/11 7:00 AM	0.00	0.00	0.00
3/12/11 9:00 AM	0.00	0.00	0.00
3/12/11 11:00 AM	0.00	0.00	0.00
3/12/11 1:00 PM	0.00	0.00	0.00
3/12/11 3:00 PM	0.00	0.00	0.00
3/12/11 5:00 PM	0.00	0.00	0.00
3/12/11 7:00 PM	0.00	0.00	0.00
3/12/11 9:00 PM	0.00	0.00	0.00
3/12/11 11:00 PM	0.00	0.00	0.00
3/13/11 1:00 AM	0.00	0.00	0.00
3/13/11 3:00 AM	0.00	0.00	0.00
3/13/11 5:00 AM	0.00	0.00	0.00
3/13/11 7:00 AM	0.00	0.00	0.00
3/13/11 9:00 AM	0.00	0.00	0.00
3/13/11 11:00 AM	0.00	0.00	0.00
3/13/11 1:00 PM	0.00	0.00	0.00
3/13/11 3:00 PM	0.00	0.00	0.00
3/13/11 5:00 PM	0.00	0.00	0.00
3/13/11 7:00 PM	0.00	0.00	0.00
3/13/11 9:00 PM	0.00	0.00	0.00
3/13/11 11:00 PM	0.00	0.00	0.00
3/14/11 1:00 AM	0.00	0.00	0.00
3/14/11 3:00 AM	0.00	0.00	0.00
3/14/11 5:00 AM	0.00	0.00	0.00
3/14/11 7:00 AM	0.00	0.00	0.00
3/14/11 9:00 AM	0.00	0.00	0.00
3/14/11 11:00 AM	0.00	0.00	0.00
3/14/11 1:00 PM	0.00	0.00	0.00
3/14/11 3:00 PM	0.00	0.00	0.00
3/14/11 5:00 PM	0.00	0.00	0.00
3/14/11 7:00 PM	0.00	0.00	0.00
3/14/11 9:00 PM	0.00	0.00	0.00
3/14/11 11:00 PM	0.00	0.00	0.00
3/15/11 1:00 AM	0.00	0.00	0.00
3/15/11 3:00 AM	0.00	0.00	0.00
3/15/11 5:00 AM	0.00	0.00	0.00
3/15/11 7:00 AM	0.00	0.00	0.00
3/15/11 9:00 AM	0.00	0.00	0.00
3/15/11 11:00 AM	0.00	0.00	0.00
3/15/11 1:00 PM	0.00	0.00	0.00
3/15/11 3:00 PM	0.01	0.01	0.00
3/15/11 5:00 PM	0.09	0.09	0.00
3/15/11 7:00 PM	0.16	0.16	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
3/15/11 9:00 PM	0.15	0.15	0.00
3/15/11 11:00 PM	0.07	0.07	0.00
3/16/11 1:00 AM	0.00	0.00	0.00
3/16/11 3:00 AM	0.00	0.00	0.00
3/16/11 5:00 AM	0.00	0.00	0.00
3/16/11 7:00 AM	0.07	0.07	0.00
3/16/11 9:00 AM	0.13	0.13	0.00
3/16/11 11:00 AM	0.12	0.12	0.00
3/16/11 1:00 PM	0.12	0.12	0.00
3/16/11 3:00 PM	0.13	0.13	0.00
3/16/11 5:00 PM	0.13	0.13	0.00
3/16/11 7:00 PM	0.12	0.12	0.00
3/16/11 9:00 PM	0.12	0.12	0.00
3/16/11 11:00 PM	0.13	0.13	0.00
3/17/11 1:00 AM	0.14	0.14	0.00
3/17/11 3:00 AM	0.14	0.14	0.00
3/17/11 5:00 AM	0.16	0.16	0.00
3/17/11 7:00 AM	0.16	0.16	0.00
3/17/11 9:00 AM	0.20	0.20	0.00
3/17/11 11:00 AM	0.18	0.18	0.00
3/17/11 1:00 PM	0.17	0.17	0.00
3/17/11 3:00 PM	0.21	0.21	0.00
3/17/11 5:00 PM	0.22	0.22	0.00
3/17/11 7:00 PM	0.22	0.22	0.00
3/17/11 9:00 PM	0.21	0.21	0.00
3/17/11 11:00 PM	0.21	0.21	0.00
3/18/11 1:00 AM	0.23	0.23	0.00
3/18/11 3:00 AM	0.24	0.24	0.00
3/18/11 5:00 AM	0.23	0.23	0.00
3/18/11 7:00 AM	0.38	0.38	0.00
3/18/11 9:00 AM	0.36	0.36	0.00
3/18/11 11:00 AM	0.30	0.30	0.00
3/18/11 1:00 PM	0.30	0.30	0.00
3/18/11 3:00 PM	0.24	0.24	0.00
3/18/11 5:00 PM	0.07	0.07	0.00
3/18/11 7:00 PM	0.10	0.10	0.00
3/18/11 9:00 PM	0.13	0.13	0.00
3/18/11 11:00 PM	0.13	0.13	0.00
3/19/11 1:00 AM	0.14	0.14	0.00
3/19/11 3:00 AM	0.13	0.13	0.00
3/19/11 5:00 AM	0.12	0.12	0.10
3/19/11 7:00 AM	0.11	0.11	0.26
3/19/11 9:00 AM	0.11	0.11	0.13
3/19/11 11:00 AM	0.16	0.16	0.22
3/19/11 1:00 PM	0.18	0.18	0.17
3/19/11 3:00 PM	0.19	0.19	0.14
3/19/11 5:00 PM	0.20	0.20	0.12
3/19/11 7:00 PM	0.21	0.21	0.13
3/19/11 9:00 PM	0.20	0.20	0.10
3/19/11 11:00 PM	0.19	0.19	0.09
3/20/11 1:00 AM	0.18	0.18	0.05
3/20/11 3:00 AM	0.18	0.18	0.04
3/20/11 5:00 AM	0.17	0.17	0.06

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
3/20/11 7:00 AM	0.18	0.18	0.11
3/20/11 9:00 AM	0.25	0.25	0.12
3/20/11 11:00 AM	0.23	0.23	0.12
3/20/11 1:00 PM	0.21	0.21	0.13
3/20/11 3:00 PM	0.25	0.25	0.12
3/20/11 5:00 PM	0.24	0.24	0.11
3/20/11 7:00 PM	0.18	0.18	0.10
3/20/11 9:00 PM	0.12	0.12	0.10
3/20/11 11:00 PM	0.13	0.13	0.07
3/21/11 1:00 AM	0.16	0.16	0.06
3/21/11 3:00 AM	0.17	0.17	0.06
3/21/11 5:00 AM	0.18	0.18	0.10
3/21/11 7:00 AM	0.29	0.29	0.12
3/21/11 9:00 AM	0.37	0.37	0.14
3/21/11 11:00 AM	0.31	0.31	0.13
3/21/11 1:00 PM	0.26	0.26	0.13
3/21/11 3:00 PM	0.26	0.26	0.13
3/21/11 5:00 PM	0.20	0.20	0.13
3/21/11 7:00 PM	0.20	0.20	0.13
3/21/11 9:00 PM	0.19	0.19	0.12
3/21/11 11:00 PM	0.11	0.11	0.11
3/22/11 1:00 AM	0.09	0.09	0.09
3/22/11 3:00 AM	0.10	0.10	0.06
3/22/11 5:00 AM	0.12	0.12	0.06
3/22/11 7:00 AM	0.20	0.20	0.12
3/22/11 9:00 AM	0.09	0.09	0.16
3/22/11 11:00 AM	0.07	0.07	0.17
3/22/11 1:00 PM	0.06	0.06	0.18
3/22/11 3:00 PM	0.06	0.06	0.19
3/22/11 5:00 PM	0.06	0.06	0.18
3/22/11 7:00 PM	0.11	0.11	0.19
3/22/11 9:00 PM	0.11	0.11	0.18
3/22/11 11:00 PM	0.10	0.10	0.17
3/23/11 1:00 AM	0.10	0.10	0.16
3/23/11 3:00 AM	0.08	0.08	0.17
3/23/11 5:00 AM	0.09	0.09	0.18
3/23/11 7:00 AM	0.11	0.11	0.17
3/23/11 9:00 AM	0.09	0.09	0.18
3/23/11 11:00 AM	0.09	0.09	0.22
3/23/11 1:00 PM	0.09	0.09	0.20
3/23/11 3:00 PM	0.10	0.10	0.20
3/23/11 5:00 PM	0.16	0.16	0.18
3/23/11 7:00 PM	0.17	0.17	0.21
3/23/11 9:00 PM	0.18	0.18	0.12
3/23/11 11:00 PM	0.18	0.18	0.05
3/24/11 1:00 AM	0.19	0.19	0.05
3/24/11 3:00 AM	0.17	0.17	0.06
3/24/11 5:00 AM	0.16	0.16	0.21
3/24/11 7:00 AM	0.16	0.16	0.33
3/24/11 9:00 AM	0.17	0.17	0.19
3/24/11 11:00 AM	0.19	0.19	0.16
3/24/11 1:00 PM	0.16	0.16	0.15
3/24/11 3:00 PM	0.17	0.17	0.16

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
3/24/11 5:00 PM	0.18	0.18	0.16
3/24/11 7:00 PM	0.18	0.18	0.18
3/24/11 9:00 PM	0.19	0.19	0.18
3/24/11 11:00 PM	0.20	0.20	0.07
3/25/11 1:00 AM	0.20	0.20	0.07
3/25/11 3:00 AM	0.19	0.19	0.08
3/25/11 5:00 AM	0.20	0.20	0.08
3/25/11 7:00 AM	0.21	0.21	0.23
3/25/11 9:00 AM	0.21	0.21	0.21
3/25/11 11:00 AM	0.21	0.21	0.22
3/25/11 1:00 PM	0.22	0.22	0.23
3/25/11 3:00 PM	0.24	0.24	0.20
3/25/11 5:00 PM	0.23	0.23	0.18
3/25/11 7:00 PM	0.22	0.22	0.18
3/25/11 9:00 PM	0.22	0.22	0.17
3/25/11 11:00 PM	0.22	0.22	0.15
3/26/11 1:00 AM	0.21	0.21	0.16
3/26/11 3:00 AM	0.18	0.18	0.15
3/26/11 5:00 AM	0.19	0.19	0.13
3/26/11 7:00 AM	0.23	0.23	0.16
3/26/11 9:00 AM	0.22	0.22	0.19
3/26/11 11:00 AM	0.21	0.21	0.22
3/26/11 1:00 PM	0.21	0.21	0.19
3/26/11 3:00 PM	0.19	0.19	0.18
3/26/11 5:00 PM	0.08	0.08	0.14
3/26/11 7:00 PM	0.18	0.18	0.14
3/26/11 9:00 PM	0.20	0.20	0.13
3/26/11 11:00 PM	0.18	0.18	0.14
3/27/11 1:00 AM	0.20	0.20	0.07
3/27/11 3:00 AM	0.19	0.19	0.00
3/27/11 5:00 AM	0.18	0.18	0.00
3/27/11 7:00 AM	0.18	0.18	0.00
3/27/11 9:00 AM	0.17	0.17	0.00
3/27/11 11:00 AM	0.18	0.18	0.00
3/27/11 1:00 PM	0.18	0.18	0.00
3/27/11 3:00 PM	0.18	0.18	0.00
3/27/11 5:00 PM	0.16	0.16	0.00
3/27/11 7:00 PM	0.15	0.15	0.00
3/27/11 9:00 PM	0.16	0.16	0.00
3/27/11 11:00 PM	0.16	0.16	0.00
3/28/11 1:00 AM	0.15	0.15	0.00
3/28/11 3:00 AM	0.11	0.11	0.00
3/28/11 5:00 AM	0.17	0.17	0.00
3/28/11 7:00 AM	0.15	0.15	0.00
3/28/11 9:00 AM	0.16	0.16	0.00
3/28/11 11:00 AM	0.16	0.16	0.00
3/28/11 1:00 PM	0.16	0.16	0.00
3/28/11 3:00 PM	0.16	0.16	0.00
3/28/11 5:00 PM	0.16	0.16	0.00
3/28/11 7:00 PM	0.16	0.16	0.00
3/28/11 9:00 PM	0.17	0.17	0.00
3/28/11 11:00 PM	0.16	0.16	0.00
3/29/11 1:00 AM	0.17	0.17	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
3/29/11 3:00 AM	0.17	0.17	0.00
3/29/11 5:00 AM	0.15	0.15	0.00
3/29/11 7:00 AM	0.06	0.06	0.00
3/29/11 9:00 AM	0.06	0.06	0.00
3/29/11 11:00 AM	0.06	0.06	0.00
3/29/11 1:00 PM	0.05	0.05	0.00
3/29/11 3:00 PM	0.05	0.05	0.00
3/29/11 5:00 PM	0.05	0.05	0.00
3/29/11 7:00 PM	0.05	0.05	0.00
3/29/11 9:00 PM	0.14	0.14	0.00
3/29/11 11:00 PM	0.16	0.16	0.00
3/30/11 1:00 AM	0.16	0.16	0.00
3/30/11 3:00 AM	0.16	0.16	0.00
3/30/11 5:00 AM	0.10	0.10	0.00
3/30/11 7:00 AM	0.12	0.12	0.00
3/30/11 9:00 AM	0.08	0.08	0.00
3/30/11 11:00 AM	0.08	0.08	0.00
3/30/11 1:00 PM	0.09	0.09	0.00
3/30/11 3:00 PM	0.09	0.09	0.00
3/30/11 5:00 PM	0.10	0.10	0.00
3/30/11 7:00 PM	0.16	0.16	0.00
3/30/11 9:00 PM	0.19	0.19	0.00
3/30/11 11:00 PM	0.20	0.20	0.08
3/31/11 1:00 AM	0.19	0.19	0.20
3/31/11 3:00 AM	0.22	0.22	0.11
3/31/11 5:00 AM	0.22	0.22	0.18
3/31/11 7:00 AM	0.23	0.23	0.16
3/31/11 9:00 AM	0.22	0.22	0.18
3/31/11 11:00 AM	0.22	0.22	0.18
3/31/11 1:00 PM	0.19	0.19	0.13
3/31/11 3:00 PM	0.20	0.20	0.18
3/31/11 5:00 PM	0.21	0.21	0.17
3/31/11 7:00 PM	0.21	0.21	0.17
3/31/11 9:00 PM	0.21	0.21	0.16
3/31/11 11:00 PM	0.21	0.21	0.12
4/1/11 1:00 AM	0.21	0.21	0.13
4/1/11 3:00 AM	0.19	0.19	0.12
4/1/11 5:00 AM	0.21	0.21	0.10
4/1/11 7:00 AM	0.22	0.22	0.08
4/1/11 9:00 AM	0.21	0.21	0.10
4/1/11 11:00 AM	0.20	0.20	0.12
4/1/11 1:00 PM	0.17	0.17	0.09
4/1/11 3:00 PM	0.16	0.16	0.12
4/1/11 5:00 PM	0.16	0.16	0.12
4/1/11 7:00 PM	0.19	0.19	0.11
4/1/11 9:00 PM	0.18	0.18	0.11
4/1/11 11:00 PM	0.19	0.19	0.08
4/2/11 1:00 AM	0.18	0.18	0.11
4/2/11 3:00 AM	0.18	0.18	0.10
4/2/11 5:00 AM	0.19	0.19	0.08
4/2/11 7:00 AM	0.18	0.18	0.11
4/2/11 9:00 AM	0.17	0.17	0.10
4/2/11 11:00 AM	0.15	0.15	0.09

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
4/2/11 1:00 PM	0.13	0.13	0.10
4/2/11 3:00 PM	0.10	0.10	0.09
4/2/11 5:00 PM	0.12	0.12	0.09
4/2/11 7:00 PM	0.16	0.16	0.09
4/2/11 9:00 PM	0.19	0.19	0.08
4/2/11 11:00 PM	0.15	0.15	0.08
4/3/11 1:00 AM	0.12	0.12	0.12
4/3/11 3:00 AM	0.10	0.10	0.11
4/3/11 5:00 AM	0.11	0.11	0.11
4/3/11 7:00 AM	0.13	0.13	0.11
4/3/11 9:00 AM	0.15	0.15	0.11
4/3/11 11:00 AM	0.16	0.16	0.11
4/3/11 1:00 PM	0.15	0.15	0.10
4/3/11 3:00 PM	0.18	0.18	0.10
4/3/11 5:00 PM	0.16	0.16	0.10
4/3/11 7:00 PM	0.17	0.17	0.11
4/3/11 9:00 PM	0.17	0.17	0.11
4/3/11 11:00 PM	0.17	0.17	0.11
4/4/11 1:00 AM	0.20	0.20	0.10
4/4/11 3:00 AM	0.19	0.19	0.11
4/4/11 5:00 AM	0.19	0.19	0.11
4/4/11 7:00 AM	0.20	0.20	0.11
4/4/11 9:00 AM	0.18	0.18	0.11
4/4/11 11:00 AM	0.18	0.18	0.11
4/4/11 1:00 PM	0.19	0.19	0.11
4/4/11 3:00 PM	0.16	0.16	0.11
4/4/11 5:00 PM	0.14	0.14	0.12
4/4/11 7:00 PM	0.14	0.14	0.12
4/4/11 9:00 PM	0.15	0.15	0.12
4/4/11 11:00 PM	0.19	0.19	0.12
4/5/11 1:00 AM	0.17	0.17	0.12
4/5/11 3:00 AM	0.16	0.16	0.13
4/5/11 5:00 AM	0.14	0.14	0.14
4/5/11 7:00 AM	0.17	0.17	0.13
4/5/11 9:00 AM	0.09	0.09	0.14
4/5/11 11:00 AM	0.08	0.08	0.14
4/5/11 1:00 PM	0.12	0.12	0.16
4/5/11 3:00 PM	0.19	0.19	0.17
4/5/11 5:00 PM	0.18	0.18	0.18
4/5/11 7:00 PM	0.17	0.17	0.16
4/5/11 9:00 PM	0.17	0.17	0.16
4/5/11 11:00 PM	0.11	0.11	0.12
4/6/11 1:00 AM	0.11	0.11	0.10
4/6/11 3:00 AM	0.11	0.11	0.12
4/6/11 5:00 AM	0.14	0.14	0.19
4/6/11 7:00 AM	0.19	0.19	0.21
4/6/11 9:00 AM	0.19	0.19	0.19
4/6/11 11:00 AM	0.19	0.19	0.21
4/6/11 1:00 PM	0.18	0.18	0.20
4/6/11 3:00 PM	0.18	0.18	0.19
4/6/11 5:00 PM	0.18	0.18	0.17
4/6/11 7:00 PM	0.18	0.18	0.16
4/6/11 9:00 PM	0.19	0.19	0.16

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
4/6/11 11:00 PM	0.15	0.15	0.17
4/7/11 1:00 AM	0.13	0.13	0.17
4/7/11 3:00 AM	0.11	0.11	0.16
4/7/11 5:00 AM	0.17	0.17	0.16
4/7/11 7:00 AM	0.22	0.22	0.17
4/7/11 9:00 AM	0.23	0.23	0.19
4/7/11 11:00 AM	0.24	0.24	0.17
4/7/11 1:00 PM	0.22	0.22	0.16
4/7/11 3:00 PM	0.21	0.21	0.16
4/7/11 5:00 PM	0.20	0.20	0.12
4/7/11 7:00 PM	0.21	0.21	0.01
4/7/11 9:00 PM	0.22	0.22	0.00
4/7/11 11:00 PM	0.21	0.21	0.00
4/8/11 1:00 AM	0.20	0.20	0.00
4/8/11 3:00 AM	0.21	0.21	0.00
4/8/11 5:00 AM	0.20	0.20	0.00
4/8/11 7:00 AM	0.20	0.20	0.00
4/8/11 9:00 AM	0.07	0.07	0.00
4/8/11 11:00 AM	0.06	0.06	0.00
4/8/11 1:00 PM	0.07	0.07	0.00
4/8/11 3:00 PM	0.07	0.07	0.00
4/8/11 5:00 PM	0.06	0.06	0.00
4/8/11 7:00 PM	0.06	0.06	0.00
4/8/11 9:00 PM	0.07	0.07	0.00
4/8/11 11:00 PM	0.07	0.07	0.00
4/9/11 1:00 AM	0.07	0.07	0.00
4/9/11 3:00 AM	0.14	0.14	0.00
4/9/11 5:00 AM	0.22	0.22	0.00
4/9/11 7:00 AM	0.22	0.22	0.00
4/9/11 9:00 AM	0.21	0.21	0.00
4/9/11 11:00 AM	0.21	0.21	0.00
4/9/11 1:00 PM	0.20	0.20	0.00
4/9/11 3:00 PM	0.21	0.21	0.00
4/9/11 5:00 PM	0.21	0.21	0.00
4/9/11 7:00 PM	0.22	0.22	0.00
4/9/11 9:00 PM	0.23	0.23	0.00
4/9/11 11:00 PM	0.23	0.23	0.00
4/10/11 1:00 AM	0.24	0.24	0.00
4/10/11 3:00 AM	0.23	0.23	0.00
4/10/11 5:00 AM	0.22	0.22	0.00
4/10/11 7:00 AM	0.25	0.25	0.00
4/10/11 9:00 AM	0.24	0.24	0.00
4/10/11 11:00 AM	0.28	0.28	0.00
4/10/11 1:00 PM	0.22	0.22	0.00
4/10/11 3:00 PM	0.24	0.24	0.00
4/10/11 5:00 PM	0.24	0.24	0.00
4/10/11 7:00 PM	0.24	0.24	0.00
4/10/11 9:00 PM	0.22	0.22	0.00
4/10/11 11:00 PM	0.21	0.21	0.00
4/11/11 1:00 AM	0.20	0.20	0.00
4/11/11 3:00 AM	0.22	0.22	0.00
4/11/11 5:00 AM	0.23	0.23	0.07
4/11/11 7:00 AM	0.22	0.22	0.31

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
4/11/11 9:00 AM	0.18	0.18	0.13
4/11/11 11:00 AM	0.07	0.07	0.17
4/11/11 1:00 PM	0.06	0.06	0.18
4/11/11 3:00 PM	0.07	0.07	0.09
4/11/11 5:00 PM	0.07	0.07	0.10
4/11/11 7:00 PM	0.07	0.07	0.11
4/11/11 9:00 PM	0.08	0.08	0.11
4/11/11 11:00 PM	0.17	0.17	0.12
4/12/11 1:00 AM	0.24	0.24	0.11
4/12/11 3:00 AM	0.23	0.23	0.10
4/12/11 5:00 AM	0.23	0.23	0.16
4/12/11 7:00 AM	0.21	0.21	0.11
4/12/11 9:00 AM	0.07	0.07	0.12
4/12/11 11:00 AM	0.06	0.06	0.24
4/12/11 1:00 PM	0.07	0.07	0.12
4/12/11 3:00 PM	0.07	0.07	0.13
4/12/11 5:00 PM	0.06	0.06	0.14
4/12/11 7:00 PM	0.07	0.07	0.14
4/12/11 9:00 PM	0.12	0.12	0.14
4/12/11 11:00 PM	0.20	0.20	0.13
4/13/11 1:00 AM	0.20	0.20	0.13
4/13/11 3:00 AM	0.14	0.14	0.13
4/13/11 5:00 AM	0.18	0.18	0.13
4/13/11 7:00 AM	0.18	0.18	0.12
4/13/11 9:00 AM	0.19	0.19	0.11
4/13/11 11:00 AM	0.17	0.17	0.11
4/13/11 1:00 PM	0.17	0.17	0.11
4/13/11 3:00 PM	0.16	0.16	0.11
4/13/11 5:00 PM	0.16	0.16	0.12
4/13/11 7:00 PM	0.16	0.16	0.12
4/13/11 9:00 PM	0.17	0.17	0.11
4/13/11 11:00 PM	0.14	0.14	0.11
4/14/11 1:00 AM	0.10	0.10	0.11
4/14/11 3:00 AM	0.10	0.10	0.11
4/14/11 5:00 AM	0.11	0.11	0.11
4/14/11 7:00 AM	0.11	0.11	0.11
4/14/11 9:00 AM	0.13	0.13	0.11
4/14/11 11:00 AM	0.14	0.14	0.10
4/14/11 1:00 PM	0.13	0.13	0.13
4/14/11 3:00 PM	0.15	0.15	0.12
4/14/11 5:00 PM	0.10	0.10	0.11
4/14/11 7:00 PM	0.10	0.10	0.10
4/14/11 9:00 PM	0.11	0.11	0.11
4/14/11 11:00 PM	0.10	0.10	0.11
4/15/11 1:00 AM	0.11	0.11	0.11
4/15/11 3:00 AM	0.10	0.10	0.11
4/15/11 5:00 AM	0.11	0.11	0.11
4/15/11 7:00 AM	0.11	0.11	0.12
4/15/11 9:00 AM	0.11	0.11	0.13
4/15/11 11:00 AM	0.14	0.14	0.15
4/15/11 1:00 PM	0.10	0.10	0.15
4/15/11 3:00 PM	0.05	0.05	0.14
4/15/11 5:00 PM	0.05	0.05	0.14

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
4/15/11 7:00 PM	0.05	0.05	0.14
4/15/11 9:00 PM	0.06	0.06	0.15
4/15/11 11:00 PM	0.13	0.13	0.15
4/16/11 1:00 AM	0.19	0.19	0.16
4/16/11 3:00 AM	0.19	0.19	0.16
4/16/11 5:00 AM	0.21	0.21	0.16
4/16/11 7:00 AM	0.21	0.21	0.16
4/16/11 9:00 AM	0.21	0.21	0.16
4/16/11 11:00 AM	0.21	0.21	0.17
4/16/11 1:00 PM	0.22	0.22	0.20
4/16/11 3:00 PM	0.22	0.22	0.19
4/16/11 5:00 PM	0.23	0.23	0.21
4/16/11 7:00 PM	0.24	0.24	0.20
4/16/11 9:00 PM	0.24	0.24	0.20
4/16/11 11:00 PM	0.23	0.23	0.19
4/17/11 1:00 AM	0.23	0.23	0.17
4/17/11 3:00 AM	0.25	0.25	0.13
4/17/11 5:00 AM	0.26	0.26	0.13
4/17/11 7:00 AM	0.23	0.23	0.14
4/17/11 9:00 AM	0.25	0.25	0.19
4/17/11 11:00 AM	0.26	0.26	0.19
4/17/11 1:00 PM	0.23	0.23	0.19
4/17/11 3:00 PM	0.23	0.23	0.19
4/17/11 5:00 PM	0.22	0.22	0.19
4/17/11 7:00 PM	0.20	0.20	0.18
4/17/11 9:00 PM	0.20	0.20	0.18
4/17/11 11:00 PM	0.17	0.17	0.19
4/18/11 1:00 AM	0.13	0.13	0.18
4/18/11 3:00 AM	0.12	0.12	0.18
4/18/11 5:00 AM	0.13	0.13	0.18
4/18/11 7:00 AM	0.25	0.25	0.17
4/18/11 9:00 AM	0.22	0.22	0.16
4/18/11 11:00 AM	0.20	0.20	0.17
4/18/11 1:00 PM	0.20	0.20	0.20
4/18/11 3:00 PM	0.19	0.19	0.22
4/18/11 5:00 PM	0.08	0.08	0.21
4/18/11 7:00 PM	0.08	0.08	0.19
4/18/11 9:00 PM	0.13	0.13	0.19
4/18/11 11:00 PM	0.14	0.14	0.18
4/19/11 1:00 AM	0.13	0.13	0.19
4/19/11 3:00 AM	0.14	0.14	0.19
4/19/11 5:00 AM	0.15	0.15	0.19
4/19/11 7:00 AM	0.22	0.22	0.19
4/19/11 9:00 AM	0.21	0.21	0.20
4/19/11 11:00 AM	0.21	0.21	0.23
4/19/11 1:00 PM	0.21	0.21	0.25
4/19/11 3:00 PM	0.20	0.20	0.25
4/19/11 5:00 PM	0.20	0.20	0.24
4/19/11 7:00 PM	0.19	0.19	0.19
4/19/11 9:00 PM	0.19	0.19	0.18
4/19/11 11:00 PM	0.11	0.11	0.18
4/20/11 1:00 AM	0.11	0.11	0.18
4/20/11 3:00 AM	0.11	0.11	0.18

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
4/20/11 5:00 AM	0.14	0.14	0.18
4/20/11 7:00 AM	0.19	0.19	0.19
4/20/11 9:00 AM	0.18	0.18	0.16
4/20/11 11:00 AM	0.17	0.17	0.19
4/20/11 1:00 PM	0.18	0.18	0.17
4/20/11 3:00 PM	0.20	0.20	0.18
4/20/11 5:00 PM	0.21	0.21	0.21
4/20/11 7:00 PM	0.22	0.22	0.22
4/20/11 9:00 PM	0.22	0.22	0.22
4/20/11 11:00 PM	0.23	0.23	0.19
4/21/11 1:00 AM	0.18	0.18	0.16
4/21/11 3:00 AM	0.16	0.16	0.19
4/21/11 5:00 AM	0.20	0.20	0.15
4/21/11 7:00 AM	0.26	0.26	0.13
4/21/11 9:00 AM	0.21	0.21	0.08
4/21/11 11:00 AM	0.20	0.20	0.11
4/21/11 1:00 PM	0.19	0.19	0.22
4/21/11 3:00 PM	0.18	0.18	0.15
4/21/11 5:00 PM	0.18	0.18	0.08
4/21/11 7:00 PM	0.17	0.17	0.16
4/21/11 9:00 PM	0.15	0.15	0.16
4/21/11 11:00 PM	0.10	0.10	0.22
4/22/11 1:00 AM	0.12	0.12	0.11
4/22/11 3:00 AM	0.12	0.12	0.06
4/22/11 5:00 AM	0.17	0.17	0.06
4/22/11 7:00 AM	0.27	0.27	0.07
4/22/11 9:00 AM	0.23	0.23	0.08
4/22/11 11:00 AM	0.15	0.15	0.17
4/22/11 1:00 PM	0.14	0.14	0.17
4/22/11 3:00 PM	0.14	0.14	0.12
4/22/11 5:00 PM	0.13	0.13	0.13
4/22/11 7:00 PM	0.14	0.14	0.12
4/22/11 9:00 PM	0.14	0.14	0.12
4/22/11 11:00 PM	0.11	0.11	0.11
4/23/11 1:00 AM	0.09	0.09	0.10
4/23/11 3:00 AM	0.10	0.10	0.09
4/23/11 5:00 AM	0.09	0.09	0.08
4/23/11 7:00 AM	0.11	0.11	0.09
4/23/11 9:00 AM	0.16	0.16	0.10
4/23/11 11:00 AM	0.15	0.15	0.11
4/23/11 1:00 PM	0.13	0.13	0.11
4/23/11 3:00 PM	0.13	0.13	0.11
4/23/11 5:00 PM	0.14	0.14	0.12
4/23/11 7:00 PM	0.17	0.17	0.12
4/23/11 9:00 PM	0.19	0.19	0.12
4/23/11 11:00 PM	0.20	0.20	0.12
4/24/11 1:00 AM	0.21	0.21	0.12
4/24/11 3:00 AM	0.19	0.19	0.13
4/24/11 5:00 AM	0.17	0.17	0.13
4/24/11 7:00 AM	0.20	0.20	0.14
4/24/11 9:00 AM	0.22	0.22	0.14
4/24/11 11:00 AM	0.21	0.21	0.15
4/24/11 1:00 PM	0.20	0.20	0.15

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
4/24/11 3:00 PM	0.23	0.23	0.15
4/24/11 5:00 PM	0.23	0.23	0.15
4/24/11 7:00 PM	0.23	0.23	0.15
4/24/11 9:00 PM	0.21	0.21	0.15
4/24/11 11:00 PM	0.20	0.20	0.15
4/25/11 1:00 AM	0.12	0.12	0.15
4/25/11 3:00 AM	0.12	0.12	0.15
4/25/11 5:00 AM	0.19	0.19	0.15
4/25/11 7:00 AM	0.24	0.24	0.15
4/25/11 9:00 AM	0.22	0.22	0.15
4/25/11 11:00 AM	0.22	0.22	0.16
4/25/11 1:00 PM	0.19	0.19	0.16
4/25/11 3:00 PM	0.19	0.19	0.17
4/25/11 5:00 PM	0.19	0.19	0.18
4/25/11 7:00 PM	0.22	0.22	0.17
4/25/11 9:00 PM	0.23	0.23	0.17
4/25/11 11:00 PM	0.23	0.23	0.11
4/26/11 1:00 AM	0.20	0.20	0.10
4/26/11 3:00 AM	0.15	0.15	0.10
4/26/11 5:00 AM	0.21	0.21	0.10
4/26/11 7:00 AM	0.25	0.25	0.16
4/26/11 9:00 AM	0.24	0.24	0.17
4/26/11 11:00 AM	0.22	0.22	0.18
4/26/11 1:00 PM	0.22	0.22	0.18
4/26/11 3:00 PM	0.23	0.23	0.18
4/26/11 5:00 PM	0.25	0.25	0.18
4/26/11 7:00 PM	0.25	0.25	0.18
4/26/11 9:00 PM	0.25	0.25	0.18
4/26/11 11:00 PM	0.18	0.18	0.18
4/27/11 1:00 AM	0.19	0.19	0.18
4/27/11 3:00 AM	0.20	0.20	0.17
4/27/11 5:00 AM	0.22	0.22	0.17
4/27/11 7:00 AM	0.23	0.23	0.17
4/27/11 9:00 AM	0.18	0.18	0.17
4/27/11 11:00 AM	0.61	0.61	0.17
4/27/11 1:00 PM	0.29	0.29	0.16
4/27/11 3:00 PM	0.26	0.26	0.16
4/27/11 5:00 PM	0.26	0.26	0.17
4/27/11 7:00 PM	0.22	0.22	0.16
4/27/11 9:00 PM	0.23	0.23	0.16
4/27/11 11:00 PM	0.15	0.15	0.16
4/28/11 1:00 AM	0.13	0.13	0.17
4/28/11 3:00 AM	0.22	0.22	0.16
4/28/11 5:00 AM	0.23	0.23	0.16
4/28/11 7:00 AM	0.21	0.21	0.17
4/28/11 9:00 AM	0.21	0.21	0.17
4/28/11 11:00 AM	0.27	0.27	0.18
4/28/11 1:00 PM	0.22	0.22	0.20
4/28/11 3:00 PM	0.21	0.21	0.22
4/28/11 5:00 PM	0.20	0.20	0.21
4/28/11 7:00 PM	0.20	0.20	0.26
4/28/11 9:00 PM	0.20	0.20	0.25
4/28/11 11:00 PM	0.21	0.21	0.19

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
4/29/11 1:00 AM	0.21	0.21	0.18
4/29/11 3:00 AM	0.21	0.21	0.18
4/29/11 5:00 AM	0.21	0.21	0.17
4/29/11 7:00 AM	0.23	0.23	0.17
4/29/11 9:00 AM	0.21	0.21	0.17
4/29/11 11:00 AM	0.20	0.20	0.17
4/29/11 1:00 PM	0.21	0.21	0.18
4/29/11 3:00 PM	0.20	0.20	0.18
4/29/11 5:00 PM	0.20	0.20	0.19
4/29/11 7:00 PM	0.16	0.16	0.19
4/29/11 9:00 PM	0.17	0.17	0.19
4/29/11 11:00 PM	0.18	0.18	0.19
4/30/11 1:00 AM	0.20	0.20	0.16
4/30/11 3:00 AM	0.11	0.11	0.20
4/30/11 5:00 AM	0.11	0.11	0.20
4/30/11 7:00 AM	0.16	0.16	0.20
4/30/11 9:00 AM	0.19	0.19	0.20
4/30/11 11:00 AM	0.19	0.19	0.20
4/30/11 1:00 PM	0.22	0.22	0.21
4/30/11 3:00 PM	0.21	0.21	0.21
4/30/11 5:00 PM	0.20	0.20	0.23
4/30/11 7:00 PM	0.20	0.20	0.24
4/30/11 9:00 PM	0.21	0.21	0.22
4/30/11 11:00 PM	0.21	0.21	0.22
5/1/11 1:00 AM	0.19	0.19	0.20
5/1/11 3:00 AM	0.19	0.19	0.19
5/1/11 5:00 AM	0.20	0.20	0.18
5/1/11 7:00 AM	0.20	0.20	0.18
5/1/11 9:00 AM	0.21	0.21	0.17
5/1/11 11:00 AM	0.18	0.18	0.17
5/1/11 1:00 PM	0.17	0.17	0.17
5/1/11 3:00 PM	0.19	0.19	0.17
5/1/11 5:00 PM	0.21	0.21	0.16
5/1/11 7:00 PM	0.20	0.20	0.16
5/1/11 9:00 PM	0.21	0.21	0.15
5/1/11 11:00 PM	0.21	0.21	0.15
5/2/11 1:00 AM	0.22	0.22	0.15
5/2/11 3:00 AM	0.14	0.14	0.14
5/2/11 5:00 AM	0.16	0.16	0.14
5/2/11 7:00 AM	0.24	0.24	0.15
5/2/11 9:00 AM	0.23	0.23	0.15
5/2/11 11:00 AM	0.20	0.20	0.15
5/2/11 1:00 PM	0.21	0.21	0.16
5/2/11 3:00 PM	0.21	0.21	0.16
5/2/11 5:00 PM	0.20	0.20	0.16
5/2/11 7:00 PM	0.22	0.22	0.16
5/2/11 9:00 PM	0.20	0.20	0.15
5/2/11 11:00 PM	0.20	0.20	0.15
5/3/11 1:00 AM	0.20	0.20	0.15
5/3/11 3:00 AM	0.22	0.22	0.16
5/3/11 5:00 AM	0.21	0.21	0.17
5/3/11 7:00 AM	0.19	0.19	0.15
5/3/11 9:00 AM	0.22	0.22	0.18

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
5/3/11 11:00 AM	0.21	0.21	0.19
5/3/11 1:00 PM	0.22	0.22	0.18
5/3/11 3:00 PM	0.22	0.22	0.19
5/3/11 5:00 PM	0.23	0.23	0.17
5/3/11 7:00 PM	0.22	0.22	0.17
5/3/11 9:00 PM	0.22	0.22	0.17
5/3/11 11:00 PM	0.23	0.23	0.17
5/4/11 1:00 AM	0.23	0.23	0.17
5/4/11 3:00 AM	0.25	0.25	0.17
5/4/11 5:00 AM	0.23	0.23	0.17
5/4/11 7:00 AM	0.23	0.23	0.17
5/4/11 9:00 AM	0.24	0.24	0.16
5/4/11 11:00 AM	0.21	0.21	0.16
5/4/11 1:00 PM	0.21	0.21	0.16
5/4/11 3:00 PM	0.20	0.20	0.18
5/4/11 5:00 PM	0.22	0.22	0.19
5/4/11 7:00 PM	0.22	0.22	0.19
5/4/11 9:00 PM	0.23	0.23	0.17
5/4/11 11:00 PM	0.23	0.23	0.10
5/5/11 1:00 AM	0.14	0.14	0.11
5/5/11 3:00 AM	0.11	0.11	0.11
5/5/11 5:00 AM	0.12	0.12	0.12
5/5/11 7:00 AM	0.22	0.22	0.20
5/5/11 9:00 AM	0.20	0.20	0.19
5/5/11 11:00 AM	0.20	0.20	0.18
5/5/11 1:00 PM	0.20	0.20	0.18
5/5/11 3:00 PM	0.22	0.22	0.18
5/5/11 5:00 PM	0.23	0.23	0.18
5/5/11 7:00 PM	0.23	0.23	0.18
5/5/11 9:00 PM	0.24	0.24	0.18
5/5/11 11:00 PM	0.23	0.23	0.18
5/6/11 1:00 AM	0.12	0.12	0.17
5/6/11 3:00 AM	0.13	0.13	0.12
5/6/11 5:00 AM	0.20	0.20	0.11
5/6/11 7:00 AM	0.27	0.27	0.10
5/6/11 9:00 AM	0.22	0.22	0.08
5/6/11 11:00 AM	0.20	0.20	0.08
5/6/11 1:00 PM	0.19	0.19	0.10
5/6/11 3:00 PM	0.19	0.19	0.13
5/6/11 5:00 PM	0.18	0.18	0.13
5/6/11 7:00 PM	0.19	0.19	0.13
5/6/11 9:00 PM	0.19	0.19	0.13
5/6/11 11:00 PM	0.19	0.19	0.13
5/7/11 1:00 AM	0.16	0.16	0.11
5/7/11 3:00 AM	0.10	0.10	0.11
5/7/11 5:00 AM	0.13	0.13	0.14
5/7/11 7:00 AM	0.13	0.13	0.15
5/7/11 9:00 AM	0.26	0.26	0.14
5/7/11 11:00 AM	0.19	0.19	0.15
5/7/11 1:00 PM	0.18	0.18	0.15
5/7/11 3:00 PM	0.18	0.18	0.16
5/7/11 5:00 PM	0.19	0.19	0.17
5/7/11 7:00 PM	0.19	0.19	0.16

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
5/7/11 9:00 PM	0.19	0.19	0.16
5/7/11 11:00 PM	0.11	0.11	0.16
5/8/11 1:00 AM	0.10	0.10	0.17
5/8/11 3:00 AM	0.10	0.10	0.17
5/8/11 5:00 AM	0.10	0.10	0.18
5/8/11 7:00 AM	0.14	0.14	0.18
5/8/11 9:00 AM	0.21	0.21	0.18
5/8/11 11:00 AM	0.21	0.21	0.17
5/8/11 1:00 PM	0.21	0.21	0.17
5/8/11 3:00 PM	0.21	0.21	0.17
5/8/11 5:00 PM	0.21	0.21	0.16
5/8/11 7:00 PM	0.19	0.19	0.09
5/8/11 9:00 PM	0.19	0.19	0.08
5/8/11 11:00 PM	0.19	0.19	0.08
5/9/11 1:00 AM	0.19	0.19	0.08
5/9/11 3:00 AM	0.20	0.20	0.08
5/9/11 5:00 AM	0.18	0.18	0.08
5/9/11 7:00 AM	0.18	0.18	0.09
5/9/11 9:00 AM	0.18	0.18	0.09
5/9/11 11:00 AM	0.19	0.19	0.09
5/9/11 1:00 PM	0.19	0.19	0.09
5/9/11 3:00 PM	0.19	0.19	0.09
5/9/11 5:00 PM	0.18	0.18	0.09
5/9/11 7:00 PM	0.19	0.19	0.09
5/9/11 9:00 PM	0.20	0.20	0.10
5/9/11 11:00 PM	0.21	0.21	0.10
5/10/11 1:00 AM	0.21	0.21	0.10
5/10/11 3:00 AM	0.21	0.21	0.10
5/10/11 5:00 AM	0.21	0.21	0.10
5/10/11 7:00 AM	0.21	0.21	0.10
5/10/11 9:00 AM	0.20	0.20	0.10
5/10/11 11:00 AM	0.20	0.20	0.10
5/10/11 1:00 PM	0.19	0.19	0.11
5/10/11 3:00 PM	0.19	0.19	0.11
5/10/11 5:00 PM	0.18	0.18	0.11
5/10/11 7:00 PM	0.19	0.19	0.11
5/10/11 9:00 PM	0.19	0.19	0.11
5/10/11 11:00 PM	0.16	0.16	0.11
5/11/11 1:00 AM	0.10	0.10	0.11
5/11/11 3:00 AM	0.10	0.10	0.11
5/11/11 5:00 AM	0.10	0.10	0.11
5/11/11 7:00 AM	0.20	0.20	0.12
5/11/11 9:00 AM	0.19	0.19	0.12
5/11/11 11:00 AM	0.18	0.18	0.12
5/11/11 1:00 PM	0.18	0.18	0.12
5/11/11 3:00 PM	0.18	0.18	0.11
5/11/11 5:00 PM	0.17	0.17	0.11
5/11/11 7:00 PM	0.18	0.18	0.11
5/11/11 9:00 PM	0.17	0.17	0.11
5/11/11 11:00 PM	0.15	0.15	0.12
5/12/11 1:00 AM	0.10	0.10	0.11
5/12/11 3:00 AM	0.11	0.11	0.11
5/12/11 5:00 AM	0.14	0.14	0.12

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
5/12/11 7:00 AM	0.15	0.15	0.12
5/12/11 9:00 AM	0.16	0.16	0.13
5/12/11 11:00 AM	0.15	0.15	0.14
5/12/11 1:00 PM	0.15	0.15	0.15
5/12/11 3:00 PM	0.16	0.16	0.12
5/12/11 5:00 PM	0.15	0.15	0.16
5/12/11 7:00 PM	0.07	0.07	0.16
5/12/11 9:00 PM	0.11	0.00	0.14
5/12/11 11:00 PM	0.11	0.00	0.14
5/13/11 1:00 AM	0.11	0.00	0.14
5/13/11 3:00 AM	0.12	0.00	0.13
5/13/11 5:00 AM	0.12	0.00	0.13
5/13/11 7:00 AM	0.11	0.00	0.13
5/13/11 9:00 AM	0.10	0.00	0.14
5/13/11 11:00 AM	0.06	0.00	0.14
5/13/11 1:00 PM	0.06	0.00	0.14
5/13/11 3:00 PM	0.06	0.00	0.14
5/13/11 5:00 PM	0.06	0.00	0.13
5/13/11 7:00 PM	0.06	0.00	0.12
5/13/11 9:00 PM	0.07	0.00	0.12
5/13/11 11:00 PM	0.07	0.00	0.11
5/14/11 1:00 AM	0.07	0.00	0.10
5/14/11 3:00 AM	0.07	0.00	0.11
5/14/11 5:00 AM	0.07	0.00	0.11
5/14/11 7:00 AM	0.08	0.00	0.11
5/14/11 9:00 AM	0.09	0.00	0.11
5/14/11 11:00 AM	0.08	0.00	0.11
5/14/11 1:00 PM	0.08	0.00	0.11
5/14/11 3:00 PM	0.07	0.00	0.11
5/14/11 5:00 PM	0.08	0.00	0.12
5/14/11 7:00 PM	0.08	0.00	0.11
5/14/11 9:00 PM	0.07	0.00	0.12
5/14/11 11:00 PM	0.07	0.00	0.11
5/15/11 1:00 AM	0.07	0.00	0.11
5/15/11 3:00 AM	0.07	0.00	0.11
5/15/11 5:00 AM	0.07	0.00	0.11
5/15/11 7:00 AM	0.08	0.00	0.11
5/15/11 9:00 AM	0.08	0.00	0.15
5/15/11 11:00 AM	0.08	0.00	0.12
5/15/11 1:00 PM	0.07	0.00	0.12
5/15/11 3:00 PM	0.07	0.00	0.12
5/15/11 5:00 PM	0.08	0.00	0.12
5/15/11 7:00 PM	0.08	0.00	0.12
5/15/11 9:00 PM	0.08	0.00	0.13
5/15/11 11:00 PM	0.08	0.00	0.13
5/16/11 1:00 AM	0.08	0.00	0.13
5/16/11 3:00 AM	0.08	0.00	0.14
5/16/11 5:00 AM	0.08	0.00	0.14
5/16/11 7:00 AM	0.08	0.00	0.14
5/16/11 9:00 AM	0.05	0.00	0.13
5/16/11 11:00 AM	0.00	0.00	0.14
5/16/11 1:00 PM	0.00	0.00	0.14
5/16/11 3:00 PM	0.00	0.00	0.13

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
5/16/11 5:00 PM	0.00	0.00	0.13
5/16/11 7:00 PM	0.00	0.00	0.15
5/16/11 9:00 PM	0.00	0.00	0.17
5/16/11 11:00 PM	0.00	0.00	0.10
5/17/11 1:00 AM	0.00	0.00	0.07
5/17/11 3:00 AM	0.00	0.00	0.08
5/17/11 5:00 AM	0.00	0.00	0.11
5/17/11 7:00 AM	0.00	0.00	0.17
5/17/11 9:00 AM	0.00	0.00	0.18
5/17/11 11:00 AM	0.00	0.00	0.17
5/17/11 1:00 PM	0.00	0.00	0.17
5/17/11 3:00 PM	0.00	0.00	0.16
5/17/11 5:00 PM	0.00	0.00	0.16
5/17/11 7:00 PM	0.00	0.00	0.15
5/17/11 9:00 PM	0.00	0.00	0.15
5/17/11 11:00 PM	0.00	0.00	0.15
5/18/11 1:00 AM	0.00	0.00	0.13
5/18/11 3:00 AM	0.00	0.00	0.14
5/18/11 5:00 AM	0.00	0.00	0.14
5/18/11 7:00 AM	0.00	0.00	0.14
5/18/11 9:00 AM	0.00	0.00	0.15
5/18/11 11:00 AM	0.00	0.00	0.14
5/18/11 1:00 PM	0.00	0.00	0.15
5/18/11 3:00 PM	0.00	0.00	0.16
5/18/11 5:00 PM	0.00	0.00	0.16
5/18/11 7:00 PM	0.00	0.00	0.13
5/18/11 9:00 PM	0.00	0.00	0.13
5/18/11 11:00 PM	0.00	0.00	0.12
5/19/11 1:00 AM	0.00	0.00	0.13
5/19/11 3:00 AM	0.00	0.00	0.13
5/19/11 5:00 AM	0.00	0.00	0.14
5/19/11 7:00 AM	0.00	0.00	0.16
5/19/11 9:00 AM	0.00	0.00	0.15
5/19/11 11:00 AM	0.00	0.00	0.13
5/19/11 1:00 PM	0.00	0.00	0.12
5/19/11 3:00 PM	0.00	0.00	0.12
5/19/11 5:00 PM	0.00	0.00	0.12
5/19/11 7:00 PM	0.00	0.00	0.11
5/19/11 9:00 PM	0.00	0.04	0.11
5/19/11 11:00 PM	0.00	0.08	0.11
5/20/11 1:00 AM	0.00	0.10	0.12
5/20/11 3:00 AM	0.10	0.10	0.13
5/20/11 5:00 AM	0.11	0.11	0.13
5/20/11 7:00 AM	0.15	0.15	0.11
5/20/11 9:00 AM	0.17	0.17	0.13
5/20/11 11:00 AM	0.15	0.15	0.11
5/20/11 1:00 PM	0.16	0.16	0.13
5/20/11 3:00 PM	0.21	0.21	0.14
5/20/11 5:00 PM	0.23	0.23	0.15
5/20/11 7:00 PM	0.24	0.24	0.15
5/20/11 9:00 PM	0.21	0.21	0.15
5/20/11 11:00 PM	0.18	0.18	0.15
5/21/11 1:00 AM	0.12	0.12	0.14

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
5/21/11 3:00 AM	0.20	0.20	0.14
5/21/11 5:00 AM	0.20	0.20	0.13
5/21/11 7:00 AM	0.09	0.09	0.13
5/21/11 9:00 AM	0.06	0.06	0.13
5/21/11 11:00 AM	0.05	0.05	0.13
5/21/11 1:00 PM	0.05	0.05	0.12
5/21/11 3:00 PM	0.05	0.05	0.12
5/21/11 5:00 PM	0.05	0.05	0.12
5/21/11 7:00 PM	0.05	0.05	0.12
5/21/11 9:00 PM	0.06	0.06	0.12
5/21/11 11:00 PM	0.06	0.06	0.09
5/22/11 1:00 AM	0.06	0.06	0.05
5/22/11 3:00 AM	0.06	0.06	0.05
5/22/11 5:00 AM	0.11	0.11	0.06
5/22/11 7:00 AM	0.17	0.17	0.05
5/22/11 9:00 AM	0.05	0.05	0.07
5/22/11 11:00 AM	0.06	0.06	0.14
5/22/11 1:00 PM	0.05	0.05	0.17
5/22/11 3:00 PM	0.05	0.05	0.18
5/22/11 5:00 PM	0.04	0.04	0.20
5/22/11 7:00 PM	0.04	0.04	0.22
5/22/11 9:00 PM	0.05	0.05	0.24
5/22/11 11:00 PM	0.05	0.05	0.20
5/23/11 1:00 AM	0.05	0.00	0.16
5/23/11 3:00 AM	0.05	0.00	0.12
5/23/11 5:00 AM	0.05	0.00	0.16
5/23/11 7:00 AM	0.05	0.00	0.19
5/23/11 9:00 AM	0.06	0.00	0.18
5/23/11 11:00 AM	0.05	0.00	0.19
5/23/11 1:00 PM	0.05	0.00	0.20
5/23/11 3:00 PM	0.08	0.00	0.19
5/23/11 5:00 PM	0.20	0.00	0.18
5/23/11 7:00 PM	0.21	0.00	0.19
5/23/11 9:00 PM	0.13	0.00	0.22
5/23/11 11:00 PM	0.23	0.00	0.19
5/24/11 1:00 AM	0.24	0.00	0.19
5/24/11 3:00 AM	0.16	0.00	0.16
5/24/11 5:00 AM	0.18	0.00	0.18
5/24/11 7:00 AM	0.09	0.00	0.21
5/24/11 9:00 AM	0.06	0.00	0.23
5/24/11 11:00 AM	0.06	0.00	0.23
5/24/11 1:00 PM	0.06	0.00	0.25
5/24/11 3:00 PM	0.05	0.00	0.21
5/24/11 5:00 PM	0.05	0.00	0.18
5/24/11 7:00 PM	0.06	0.00	0.18
5/24/11 9:00 PM	0.06	0.00	0.15
5/24/11 11:00 PM	0.16	0.00	0.09
5/25/11 1:00 AM	0.20	0.00	0.10
5/25/11 3:00 AM	0.19	0.00	0.10
5/25/11 5:00 AM	0.22	0.00	0.16
5/25/11 7:00 AM	0.24	0.00	0.16
5/25/11 9:00 AM	0.22	0.00	0.15
5/25/11 11:00 AM	0.08	0.00	0.16

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
5/25/11 1:00 PM	0.08	0.00	0.15
5/25/11 3:00 PM	0.08	0.00	0.16
5/25/11 5:00 PM	0.13	0.00	0.17
5/25/11 7:00 PM	0.22	0.00	0.17
5/25/11 9:00 PM	0.22	0.00	0.18
5/25/11 11:00 PM	0.22	0.00	0.17
5/26/11 1:00 AM	0.22	0.00	0.17
5/26/11 3:00 AM	0.22	0.00	0.17
5/26/11 5:00 AM	0.23	0.00	0.16
5/26/11 7:00 AM	0.23	0.00	0.19
5/26/11 9:00 AM	0.22	0.00	0.20
5/26/11 11:00 AM	0.21	0.00	0.18
5/26/11 1:00 PM	0.24	0.00	0.25
5/26/11 3:00 PM	0.23	0.00	0.26
5/26/11 5:00 PM	0.20	0.00	0.21
5/26/11 7:00 PM	0.19	0.00	0.21
5/26/11 9:00 PM	0.20	0.00	0.20
5/26/11 11:00 PM	0.20	0.00	0.19
5/27/11 1:00 AM	0.21	0.00	0.19
5/27/11 3:00 AM	0.15	0.00	0.20
5/27/11 5:00 AM	0.21	0.00	0.20
5/27/11 7:00 AM	0.25	0.00	0.21
5/27/11 9:00 AM	0.24	0.00	0.22
5/27/11 11:00 AM	0.24	0.00	0.23
5/27/11 1:00 PM	0.22	0.00	0.22
5/27/11 3:00 PM	0.22	0.00	0.21
5/27/11 5:00 PM	0.19	0.00	0.19
5/27/11 7:00 PM	0.21	0.00	0.18
5/27/11 9:00 PM	0.22	0.00	0.19
5/27/11 11:00 PM	0.22	0.00	0.12
5/28/11 1:00 AM	0.22	0.00	0.04
5/28/11 3:00 AM	0.21	0.00	0.04
5/28/11 5:00 AM	0.23	0.00	0.05
5/28/11 7:00 AM	0.24	0.00	0.05
5/28/11 9:00 AM	0.22	0.00	0.04
5/28/11 11:00 AM	0.16	0.00	0.05
5/28/11 1:00 PM	0.06	0.00	0.14
5/28/11 3:00 PM	0.05	0.00	0.19
5/28/11 5:00 PM	0.05	0.00	0.12
5/28/11 7:00 PM	0.06	0.00	0.13
5/28/11 9:00 PM	0.06	0.00	0.14
5/28/11 11:00 PM	0.06	0.00	0.15
5/29/11 1:00 AM	0.07	0.00	0.15
5/29/11 3:00 AM	0.13	0.00	0.16
5/29/11 5:00 AM	0.21	0.00	0.18
5/29/11 7:00 AM	0.21	0.00	0.22
5/29/11 9:00 AM	0.23	0.00	0.21
5/29/11 11:00 AM	0.21	0.00	0.20
5/29/11 1:00 PM	0.20	0.00	0.22
5/29/11 3:00 PM	0.20	0.00	0.23
5/29/11 5:00 PM	0.18	0.00	0.26
5/29/11 7:00 PM	0.21	0.00	0.20
5/29/11 9:00 PM	0.23	0.00	0.15

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
5/29/11 11:00 PM	0.23	0.00	0.14
5/30/11 1:00 AM	0.22	0.00	0.13
5/30/11 3:00 AM	0.22	0.00	0.06
5/30/11 5:00 AM	0.23	0.00	0.00
5/30/11 7:00 AM	0.24	0.00	0.00
5/30/11 9:00 AM	0.24	0.00	0.00
5/30/11 11:00 AM	0.23	0.00	0.00
5/30/11 1:00 PM	0.22	0.00	0.00
5/30/11 3:00 PM	0.22	0.00	0.00
5/30/11 5:00 PM	0.21	0.00	0.00
5/30/11 7:00 PM	0.21	0.00	0.00
5/30/11 9:00 PM	0.24	0.00	0.00
5/30/11 11:00 PM	0.21	0.00	0.00
5/31/11 1:00 AM	0.20	0.00	0.00
5/31/11 3:00 AM	0.20	0.00	0.00
5/31/11 5:00 AM	0.21	0.00	0.00
5/31/11 7:00 AM	0.25	0.00	0.00
5/31/11 9:00 AM	0.22	0.00	0.00
5/31/11 11:00 AM	0.16	0.00	0.00
5/31/11 1:00 PM	0.19	0.00	0.00
5/31/11 3:00 PM	0.18	0.00	0.00
5/31/11 5:00 PM	0.95	0.00	0.00
5/31/11 7:00 PM	0.07	0.00	0.00
5/31/11 9:00 PM	0.09	0.00	0.00
5/31/11 11:00 PM	0.16	0.00	0.00
6/1/11 1:00 AM	0.13	0.00	0.00
6/1/11 3:00 AM	0.10	0.00	0.00
6/1/11 5:00 AM	0.19	0.00	0.00
6/1/11 7:00 AM	0.19	0.00	0.00
6/1/11 9:00 AM	0.06	0.00	0.00
6/1/11 11:00 AM	0.15	0.00	0.00
6/1/11 1:00 PM	0.23	0.00	0.00
6/1/11 3:00 PM	0.23	0.00	0.00
6/1/11 5:00 PM	0.26	0.00	0.00
6/1/11 7:00 PM	0.23	0.00	0.00
6/1/11 9:00 PM	0.23	0.00	0.00
6/1/11 11:00 PM	0.15	0.00	0.00
6/2/11 1:00 AM	0.06	0.06	0.00
6/2/11 3:00 AM	0.18	0.18	0.00
6/2/11 5:00 AM	0.12	0.12	0.00
6/2/11 7:00 AM	0.14	0.14	0.00
6/2/11 9:00 AM	0.20	0.20	0.00
6/2/11 11:00 AM	0.12	0.00	0.00
6/2/11 1:00 PM	0.19	0.00	0.00
6/2/11 3:00 PM	0.19	0.00	0.00
6/2/11 5:00 PM	0.19	0.00	0.00
6/2/11 7:00 PM	0.20	0.00	0.00
6/2/11 9:00 PM	0.11	0.00	0.00
6/2/11 11:00 PM	0.17	0.00	0.00
6/3/11 1:00 AM	0.26	0.00	0.00
6/3/11 3:00 AM	0.21	0.00	0.00
6/3/11 5:00 AM	0.13	0.00	0.00
6/3/11 7:00 AM	0.14	0.00	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
6/3/11 9:00 AM	0.13	0.00	0.00
6/3/11 11:00 AM	0.16	0.00	0.00
6/3/11 1:00 PM	0.23	0.00	0.00
6/3/11 3:00 PM	0.22	0.00	0.00
6/3/11 5:00 PM	0.22	0.22	0.00
6/3/11 7:00 PM	0.21	0.21	0.00
6/3/11 9:00 PM	0.22	0.22	0.00
6/3/11 11:00 PM	0.21	0.21	0.00
6/4/11 1:00 AM	0.17	0.17	0.11
6/4/11 3:00 AM	0.17	0.17	0.11
6/4/11 5:00 AM	0.16	0.16	0.11
6/4/11 7:00 AM	0.20	0.20	0.16
6/4/11 9:00 AM	0.22	0.22	0.18
6/4/11 11:00 AM	0.23	0.23	0.18
6/4/11 1:00 PM	0.21	0.21	0.26
6/4/11 3:00 PM	0.22	0.22	0.26
6/4/11 5:00 PM	0.22	0.22	0.24
6/4/11 7:00 PM	0.23	0.23	0.24
6/4/11 9:00 PM	0.28	0.28	0.30
6/4/11 11:00 PM	0.28	0.28	0.24
6/5/11 1:00 AM	0.23	0.23	0.17
6/5/11 3:00 AM	0.21	0.21	0.13
6/5/11 5:00 AM	0.15	0.15	0.11
6/5/11 7:00 AM	0.16	0.16	0.11
6/5/11 9:00 AM	0.23	0.23	0.17
6/5/11 11:00 AM	0.22	0.22	0.14
6/5/11 1:00 PM	0.23	0.23	0.14
6/5/11 3:00 PM	0.21	0.21	0.12
6/5/11 5:00 PM	0.22	0.22	0.13
6/5/11 7:00 PM	0.24	0.24	0.14
6/5/11 9:00 PM	0.24	0.24	0.13
6/5/11 11:00 PM	0.22	0.22	0.12
6/6/11 1:00 AM	0.24	0.24	0.09
6/6/11 3:00 AM	0.23	0.23	0.07
6/6/11 5:00 AM	0.23	0.23	0.09
6/6/11 7:00 AM	0.25	0.25	0.12
6/6/11 9:00 AM	0.22	0.22	0.12
6/6/11 11:00 AM	0.20	0.20	0.12
6/6/11 1:00 PM	0.19	0.19	0.13
6/6/11 3:00 PM	0.18	0.18	0.13
6/6/11 5:00 PM	0.17	0.17	0.13
6/6/11 7:00 PM	0.17	0.17	0.13
6/6/11 9:00 PM	0.18	0.18	0.12
6/6/11 11:00 PM	0.13	0.13	0.12
6/7/11 1:00 AM	0.18	0.18	0.11
6/7/11 3:00 AM	0.11	0.11	0.11
6/7/11 5:00 AM	0.15	0.15	0.10
6/7/11 7:00 AM	0.08	0.08	0.11
6/7/11 9:00 AM	0.05	0.05	0.11
6/7/11 11:00 AM	0.05	0.05	0.11
6/7/11 1:00 PM	0.06	0.06	0.11
6/7/11 3:00 PM	0.12	0.12	0.09
6/7/11 5:00 PM	0.15	0.15	0.08

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
6/7/11 7:00 PM	0.15	0.15	0.11
6/7/11 9:00 PM	0.06	0.06	0.07
6/7/11 11:00 PM	0.06	0.06	0.00
6/8/11 1:00 AM	0.10	0.10	0.00
6/8/11 3:00 AM	0.10	0.10	0.00
6/8/11 5:00 AM	0.17	0.17	0.00
6/8/11 7:00 AM	0.14	0.14	0.00
6/8/11 9:00 AM	0.11	0.11	0.00
6/8/11 11:00 AM	0.13	0.13	0.00
6/8/11 1:00 PM	0.13	0.13	0.00
6/8/11 3:00 PM	0.05	0.05	0.00
6/8/11 5:00 PM	0.06	0.06	0.00
6/8/11 7:00 PM	0.05	0.05	0.00
6/8/11 9:00 PM	0.05	0.05	0.00
6/8/11 11:00 PM	0.07	0.07	0.00
6/9/11 1:00 AM	0.11	0.11	0.00
6/9/11 3:00 AM	0.09	0.09	0.00
6/9/11 5:00 AM	0.16	0.16	0.00
6/9/11 7:00 AM	0.13	0.13	0.00
6/9/11 9:00 AM	0.13	0.13	0.00
6/9/11 11:00 AM	0.06	0.06	0.00
6/9/11 1:00 PM	0.13	0.13	0.00
6/9/11 3:00 PM	0.13	0.13	0.00
6/9/11 5:00 PM	0.09	0.09	0.00
6/9/11 7:00 PM	0.06	0.06	0.00
6/9/11 9:00 PM	0.08	0.08	0.00
6/9/11 11:00 PM	0.10	0.10	0.00
6/10/11 1:00 AM	0.07	0.07	0.00
6/10/11 3:00 AM	0.15	0.15	0.00
6/10/11 5:00 AM	0.20	0.20	0.00
6/10/11 7:00 AM	0.19	0.19	0.00
6/10/11 9:00 AM	0.17	0.17	0.00
6/10/11 11:00 AM	0.16	0.16	0.00
6/10/11 1:00 PM	0.18	0.18	0.00
6/10/11 3:00 PM	0.18	0.18	0.00
6/10/11 5:00 PM	0.17	0.17	0.00
6/10/11 7:00 PM	0.18	0.18	0.00
6/10/11 9:00 PM	0.18	0.18	0.00
6/10/11 11:00 PM	0.20	0.20	0.00
6/11/11 1:00 AM	0.20	0.20	0.00
6/11/11 3:00 AM	0.21	0.21	0.00
6/11/11 5:00 AM	0.23	0.23	0.00
6/11/11 7:00 AM	0.22	0.22	0.00
6/11/11 9:00 AM	0.21	0.21	0.00
6/11/11 11:00 AM	0.24	0.24	0.00
6/11/11 1:00 PM	0.16	0.16	0.00
6/11/11 3:00 PM	0.19	0.19	0.00
6/11/11 5:00 PM	0.11	0.11	0.00
6/11/11 7:00 PM	0.08	0.08	0.00
6/11/11 9:00 PM	0.09	0.09	0.00
6/11/11 11:00 PM	0.17	0.17	0.00
6/12/11 1:00 AM	0.21	0.21	0.00
6/12/11 3:00 AM	0.25	0.25	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
6/12/11 5:00 AM	0.24	0.24	0.00
6/12/11 7:00 AM	0.22	0.22	0.00
6/12/11 9:00 AM	0.13	0.13	0.00
6/12/11 11:00 AM	0.08	0.08	0.00
6/12/11 1:00 PM	0.07	0.07	0.00
6/12/11 3:00 PM	0.12	0.12	0.00
6/12/11 5:00 PM	0.20	0.20	0.00
6/12/11 7:00 PM	0.20	0.20	0.00
6/12/11 9:00 PM	0.22	0.22	0.00
6/12/11 11:00 PM	0.23	0.23	0.00
6/13/11 1:00 AM	0.27	0.27	0.00
6/13/11 3:00 AM	0.24	0.24	0.00
6/13/11 5:00 AM	0.19	0.19	0.00
6/13/11 7:00 AM	0.24	0.24	0.00
6/13/11 9:00 AM	0.20	0.20	0.00
6/13/11 11:00 AM	0.15	0.15	0.00
6/13/11 1:00 PM	0.12	0.12	0.00
6/13/11 3:00 PM	0.18	0.18	0.00
6/13/11 5:00 PM	0.17	0.17	0.00
6/13/11 7:00 PM	0.21	0.21	0.00
6/13/11 9:00 PM	0.22	0.22	0.00
6/13/11 11:00 PM	0.23	0.23	0.00
6/14/11 1:00 AM	0.17	0.17	0.00
6/14/11 3:00 AM	0.18	0.18	0.00
6/14/11 5:00 AM	0.29	0.29	0.00
6/14/11 7:00 AM	0.24	0.24	0.00
6/14/11 9:00 AM	0.22	0.22	0.00
6/14/11 11:00 AM	0.22	0.22	0.00
6/14/11 1:00 PM	0.24	0.24	0.01
6/14/11 3:00 PM	0.22	0.22	0.08
6/14/11 5:00 PM	0.22	0.22	0.31
6/14/11 7:00 PM	0.22	0.22	0.31
6/14/11 9:00 PM	0.19	0.19	0.26
6/14/11 11:00 PM	0.19	0.19	0.20
6/15/11 1:00 AM	0.20	0.20	0.15
6/15/11 3:00 AM	0.19	0.19	0.13
6/15/11 5:00 AM	0.20	0.20	0.12
6/15/11 7:00 AM	0.20	0.20	0.13
6/15/11 9:00 AM	0.20	0.20	0.13
6/15/11 11:00 AM	0.19	0.19	0.14
6/15/11 1:00 PM	0.19	0.19	0.15
6/15/11 3:00 PM	0.20	0.20	0.15
6/15/11 5:00 PM	0.19	0.19	0.10
6/15/11 7:00 PM	0.20	0.20	0.08
6/15/11 9:00 PM	0.20	0.20	0.13
6/15/11 11:00 PM	0.20	0.20	0.16
6/16/11 1:00 AM	0.15	0.15	0.16
6/16/11 3:00 AM	0.13	0.13	0.14
6/16/11 5:00 AM	0.14	0.14	0.14
6/16/11 7:00 AM	0.16	0.16	0.20
6/16/11 9:00 AM	0.08	0.08	0.24
6/16/11 11:00 AM	0.10	0.10	0.35
6/16/11 1:00 PM	0.09	0.09	0.35

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
6/16/11 3:00 PM	0.13	0.13	0.34
6/16/11 5:00 PM	0.14	0.14	0.23
6/16/11 7:00 PM	0.17	0.17	0.23
6/16/11 9:00 PM	0.19	0.19	0.21
6/16/11 11:00 PM	0.20	0.20	0.21
6/17/11 1:00 AM	0.22	0.22	0.21
6/17/11 3:00 AM	0.23	0.23	0.19
6/17/11 5:00 AM	0.17	0.17	0.16
6/17/11 7:00 AM	0.15	0.15	0.16
6/17/11 9:00 AM	0.14	0.14	0.13
6/17/11 11:00 AM	0.14	0.14	0.08
6/17/11 1:00 PM	0.13	0.13	0.08
6/17/11 3:00 PM	0.13	0.13	0.07
6/17/11 5:00 PM	0.13	0.13	0.06
6/17/11 7:00 PM	0.16	0.16	0.06
6/17/11 9:00 PM	0.19	0.19	0.06
6/17/11 11:00 PM	0.16	0.16	0.06
6/18/11 1:00 AM	0.12	0.12	0.06
6/18/11 3:00 AM	0.12	0.12	0.06
6/18/11 5:00 AM	0.13	0.13	0.06
6/18/11 7:00 AM	0.14	0.14	0.06
6/18/11 9:00 AM	0.21	0.21	0.06
6/18/11 11:00 AM	0.20	0.20	0.06
6/18/11 1:00 PM	0.19	0.19	0.06
6/18/11 3:00 PM	0.19	0.19	0.06
6/18/11 5:00 PM	0.15	0.15	0.06
6/18/11 7:00 PM	0.18	0.18	0.06
6/18/11 9:00 PM	0.20	0.20	0.06
6/18/11 11:00 PM	0.17	0.17	0.02
6/19/11 1:00 AM	0.16	0.16	0.02
6/19/11 3:00 AM	0.14	0.14	0.02
6/19/11 5:00 AM	0.10	0.10	0.03
6/19/11 7:00 AM	0.17	0.17	0.03
6/19/11 9:00 AM	0.17	0.17	0.03
6/19/11 11:00 AM	0.15	0.15	0.03
6/19/11 1:00 PM	0.07	0.07	0.03
6/19/11 3:00 PM	0.16	0.16	0.03
6/19/11 5:00 PM	0.18	0.18	0.03
6/19/11 7:00 PM	0.13	0.13	0.02
6/19/11 9:00 PM	0.08	0.08	0.03
6/19/11 11:00 PM	0.07	0.07	0.03
6/20/11 1:00 AM	0.11	0.11	0.09
6/20/11 3:00 AM	0.08	0.08	0.09
6/20/11 5:00 AM	0.07	0.07	0.09
6/20/11 7:00 AM	0.12	0.12	0.08
6/20/11 9:00 AM	0.07	0.07	0.08
6/20/11 11:00 AM	0.08	0.08	0.07
6/20/11 1:00 PM	0.09	0.09	0.07
6/20/11 3:00 PM	0.08	0.08	0.07
6/20/11 5:00 PM	0.20	0.20	0.07
6/20/11 7:00 PM	0.16	0.16	0.07
6/20/11 9:00 PM	0.19	0.19	0.06
6/20/11 11:00 PM	0.13	0.13	0.07

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
6/21/11 1:00 AM	0.12	0.12	0.07
6/21/11 3:00 AM	0.12	0.12	0.07
6/21/11 5:00 AM	0.12	0.12	0.07
6/21/11 7:00 AM	0.20	0.20	0.07
6/21/11 9:00 AM	0.20	0.20	0.07
6/21/11 11:00 AM	0.19	0.19	0.07
6/21/11 1:00 PM	0.17	0.17	0.08
6/21/11 3:00 PM	0.16	0.16	0.08
6/21/11 5:00 PM	0.14	0.14	0.08
6/21/11 7:00 PM	0.15	0.15	0.08
6/21/11 9:00 PM	0.09	0.09	0.09
6/21/11 11:00 PM	0.10	0.10	0.09
6/22/11 1:00 AM	0.12	0.12	0.09
6/22/11 3:00 AM	0.12	0.12	0.09
6/22/11 5:00 AM	0.12	0.12	0.10
6/22/11 7:00 AM	0.19	0.19	0.11
6/22/11 9:00 AM	0.17	0.17	0.11
6/22/11 11:00 AM	0.18	0.18	0.12
6/22/11 1:00 PM	0.20	0.20	0.12
6/22/11 3:00 PM	0.20	0.20	0.12
6/22/11 5:00 PM	0.20	0.20	0.13
6/22/11 7:00 PM	0.16	0.16	0.13
6/22/11 9:00 PM	0.12	0.12	0.13
6/22/11 11:00 PM	0.14	0.14	0.14
6/23/11 1:00 AM	0.15	0.15	0.14
6/23/11 3:00 AM	0.17	0.17	0.15
6/23/11 5:00 AM	0.12	0.12	0.15
6/23/11 7:00 AM	0.16	0.16	0.16
6/23/11 9:00 AM	0.19	0.19	0.15
6/23/11 11:00 AM	0.19	0.19	0.17
6/23/11 1:00 PM	0.19	0.19	0.17
6/23/11 3:00 PM	0.19	0.19	0.17
6/23/11 5:00 PM	0.19	0.19	0.17
6/23/11 7:00 PM	0.20	0.20	0.16
6/23/11 9:00 PM	0.21	0.21	0.16
6/23/11 11:00 PM	0.17	0.17	0.16
6/24/11 1:00 AM	0.18	0.18	0.17
6/24/11 3:00 AM	0.20	0.20	0.17
6/24/11 5:00 AM	0.18	0.18	0.16
6/24/11 7:00 AM	0.17	0.17	0.17
6/24/11 9:00 AM	0.17	0.17	0.17
6/24/11 11:00 AM	0.16	0.16	0.18
6/24/11 1:00 PM	0.17	0.17	0.18
6/24/11 3:00 PM	0.17	0.17	0.17
6/24/11 5:00 PM	0.16	0.16	0.16
6/24/11 7:00 PM	0.18	0.18	0.17
6/24/11 9:00 PM	0.20	0.20	0.16
6/24/11 11:00 PM	0.25	0.25	0.04
6/25/11 1:00 AM	0.28	0.28	0.03
6/25/11 3:00 AM	0.22	0.22	0.04
6/25/11 5:00 AM	0.21	0.21	0.03
6/25/11 7:00 AM	0.21	0.21	0.04
6/25/11 9:00 AM	0.16	0.16	0.15

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
6/25/11 11:00 AM	0.19	0.19	0.23
6/25/11 1:00 PM	0.20	0.20	0.22
6/25/11 3:00 PM	0.16	0.16	0.20
6/25/11 5:00 PM	0.09	0.09	0.18
6/25/11 7:00 PM	0.08	0.08	0.17
6/25/11 9:00 PM	0.08	0.08	0.16
6/25/11 11:00 PM	0.20	0.20	0.04
6/26/11 1:00 AM	0.24	0.24	0.04
6/26/11 3:00 AM	0.22	0.22	0.04
6/26/11 5:00 AM	0.22	0.22	0.05
6/26/11 7:00 AM	0.20	0.20	0.06
6/26/11 9:00 AM	0.20	0.20	0.19
6/26/11 11:00 AM	0.21	0.21	0.21
6/26/11 1:00 PM	0.19	0.19	0.20
6/26/11 3:00 PM	0.07	0.07	0.18
6/26/11 5:00 PM	0.06	0.06	0.16
6/26/11 7:00 PM	0.07	0.07	0.16
6/26/11 9:00 PM	0.08	0.08	0.14
6/26/11 11:00 PM	0.16	0.16	0.12
6/27/11 1:00 AM	0.18	0.18	0.10
6/27/11 3:00 AM	0.14	0.14	0.09
6/27/11 5:00 AM	0.16	0.16	0.09
6/27/11 7:00 AM	0.20	0.20	0.13
6/27/11 9:00 AM	0.12	0.12	0.13
6/27/11 11:00 AM	0.09	0.09	0.13
6/27/11 1:00 PM	0.08	0.08	0.12
6/27/11 3:00 PM	0.08	0.08	0.11
6/27/11 5:00 PM	0.13	0.13	0.11
6/27/11 7:00 PM	0.23	0.23	0.11
6/27/11 9:00 PM	0.23	0.23	0.10
6/27/11 11:00 PM	0.21	0.21	0.10
6/28/11 1:00 AM	0.14	0.14	0.10
6/28/11 3:00 AM	0.14	0.14	0.10
6/28/11 5:00 AM	0.15	0.15	0.10
6/28/11 7:00 AM	0.22	0.22	0.11
6/28/11 9:00 AM	0.21	0.21	0.11
6/28/11 11:00 AM	0.21	0.21	0.11
6/28/11 1:00 PM	0.21	0.21	0.11
6/28/11 3:00 PM	0.21	0.21	0.11
6/28/11 5:00 PM	0.21	0.21	0.10
6/28/11 7:00 PM	0.22	0.22	0.09
6/28/11 9:00 PM	0.21	0.21	0.09
6/28/11 11:00 PM	0.14	0.14	0.09
6/29/11 1:00 AM	0.14	0.14	0.09
6/29/11 3:00 AM	0.16	0.16	0.10
6/29/11 5:00 AM	0.17	0.17	0.10
6/29/11 7:00 AM	0.17	0.17	0.11
6/29/11 9:00 AM	0.16	0.16	0.11
6/29/11 11:00 AM	0.21	0.21	0.10
6/29/11 1:00 PM	0.20	0.20	0.10
6/29/11 3:00 PM	0.23	0.23	0.11
6/29/11 5:00 PM	0.22	0.22	0.12
6/29/11 7:00 PM	0.22	0.22	0.11

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
6/29/11 9:00 PM	0.22	0.22	0.11
6/29/11 11:00 PM	0.14	0.14	0.11
6/30/11 1:00 AM	0.13	0.13	0.10
6/30/11 3:00 AM	0.14	0.14	0.10
6/30/11 5:00 AM	0.15	0.15	0.11
6/30/11 7:00 AM	0.22	0.22	0.10
6/30/11 9:00 AM	0.20	0.20	0.10
6/30/11 11:00 AM	0.12	0.12	0.12
6/30/11 1:00 PM	0.16	0.00	0.13
6/30/11 3:00 PM	0.15	0.00	0.14
6/30/11 5:00 PM	0.15	0.00	0.13
6/30/11 7:00 PM	0.17	0.00	0.28
6/30/11 9:00 PM	0.10	0.00	0.12
6/30/11 11:00 PM	0.10	0.00	0.11
7/1/11 1:00 AM	0.11	0.00	0.10
7/1/11 3:00 AM	0.11	0.00	0.10
7/1/11 5:00 AM	0.11	0.00	0.10
7/1/11 7:00 AM	0.12	0.00	0.10
7/1/11 9:00 AM	0.12	0.00	0.09
7/1/11 11:00 AM	0.12	0.00	0.09
7/1/11 1:00 PM	0.12	0.00	0.08
7/1/11 3:00 PM	0.12	0.00	0.08
7/1/11 5:00 PM	0.12	0.00	0.08
7/1/11 7:00 PM	0.13	0.00	0.08
7/1/11 9:00 PM	0.12	0.00	0.08
7/1/11 11:00 PM	0.13	0.00	0.06
7/2/11 1:00 AM	0.13	0.00	0.04
7/2/11 3:00 AM	0.13	0.00	0.05
7/2/11 5:00 AM	0.12	0.00	0.07
7/2/11 7:00 AM	0.13	0.00	0.08
7/2/11 9:00 AM	0.14	0.00	0.08
7/2/11 11:00 AM	0.13	0.00	0.09
7/2/11 1:00 PM	0.14	0.00	0.09
7/2/11 3:00 PM	0.13	0.00	0.09
7/2/11 5:00 PM	0.13	0.00	0.09
7/2/11 7:00 PM	0.13	0.00	0.08
7/2/11 9:00 PM	0.12	0.00	0.08
7/2/11 11:00 PM	0.13	0.00	0.08
7/3/11 1:00 AM	0.12	0.00	0.08
7/3/11 3:00 AM	0.12	0.00	0.08
7/3/11 5:00 AM	0.11	0.00	0.06
7/3/11 7:00 AM	0.11	0.00	0.07
7/3/11 9:00 AM	0.12	0.00	0.09
7/3/11 11:00 AM	0.11	0.00	0.09
7/3/11 1:00 PM	0.11	0.00	0.09
7/3/11 3:00 PM	0.11	0.00	0.09
7/3/11 5:00 PM	0.11	0.00	0.09
7/3/11 7:00 PM	0.11	0.00	0.09
7/3/11 9:00 PM	0.11	0.00	0.08
7/3/11 11:00 PM	0.11	0.00	0.09
7/4/11 1:00 AM	0.10	0.00	0.09
7/4/11 3:00 AM	0.10	0.00	0.09
7/4/11 5:00 AM	0.12	0.00	0.09

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
7/4/11 7:00 AM	0.11	0.00	0.09
7/4/11 9:00 AM	0.11	0.00	0.09
7/4/11 11:00 AM	0.11	0.00	0.10
7/4/11 1:00 PM	0.11	0.00	0.10
7/4/11 3:00 PM	0.11	0.00	0.11
7/4/11 5:00 PM	0.11	0.00	0.11
7/4/11 7:00 PM	0.11	0.00	0.11
7/4/11 9:00 PM	0.11	0.00	0.11
7/4/11 11:00 PM	0.12	0.00	0.12
7/5/11 1:00 AM	0.11	0.00	0.12
7/5/11 3:00 AM	0.11	0.00	0.11
7/5/11 5:00 AM	0.11	0.00	0.12
7/5/11 7:00 AM	0.11	0.00	0.12
7/5/11 9:00 AM	0.11	0.00	0.13
7/5/11 11:00 AM	0.11	0.00	0.14
7/5/11 1:00 PM	0.12	0.00	0.14
7/5/11 3:00 PM	0.12	0.00	0.15
7/5/11 5:00 PM	0.12	0.00	0.15
7/5/11 7:00 PM	0.12	0.00	0.15
7/5/11 9:00 PM	0.12	0.00	0.15
7/5/11 11:00 PM	0.12	0.00	0.15
7/6/11 1:00 AM	0.09	0.00	0.14
7/6/11 3:00 AM	0.07	0.00	0.15
7/6/11 5:00 AM	0.08	0.00	0.15
7/6/11 7:00 AM	0.11	0.00	0.15
7/6/11 9:00 AM	0.13	0.00	0.12
7/6/11 11:00 AM	0.11	0.00	0.07
7/6/11 1:00 PM	0.11	0.00	0.07
7/6/11 3:00 PM	0.11	0.00	0.03
7/6/11 5:00 PM	0.11	0.00	0.02
7/6/11 7:00 PM	0.11	0.00	0.02
7/6/11 9:00 PM	0.12	0.00	0.00
7/6/11 11:00 PM	0.12	0.00	0.00
7/7/11 1:00 AM	0.12	0.00	0.00
7/7/11 3:00 AM	0.11	0.00	0.00
7/7/11 5:00 AM	0.11	0.00	0.00
7/7/11 7:00 AM	0.15	0.00	0.00
7/7/11 9:00 AM	0.18	0.00	0.00
7/7/11 11:00 AM	0.20	0.00	0.00
7/7/11 1:00 PM	0.22	0.22	0.00
7/7/11 3:00 PM	0.12	0.12	0.00
7/7/11 5:00 PM	0.13	0.13	0.00
7/7/11 7:00 PM	0.13	0.13	0.00
7/7/11 9:00 PM	0.12	0.12	0.00
7/7/11 11:00 PM	0.10	0.10	0.00
7/8/11 1:00 AM	0.10	0.10	0.00
7/8/11 3:00 AM	0.11	0.11	0.00
7/8/11 5:00 AM	0.11	0.11	0.00
7/8/11 7:00 AM	0.11	0.11	0.00
7/8/11 9:00 AM	0.11	0.11	0.00
7/8/11 11:00 AM	0.17	0.17	0.00
7/8/11 1:00 PM	0.22	0.22	0.00
7/8/11 3:00 PM	0.22	0.22	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
7/8/11 5:00 PM	0.21	0.21	0.00
7/8/11 7:00 PM	0.21	0.21	0.00
7/8/11 9:00 PM	0.10	0.10	0.00
7/8/11 11:00 PM	0.12	0.12	0.00
7/9/11 1:00 AM	0.10	0.10	0.00
7/9/11 3:00 AM	0.14	0.14	0.00
7/9/11 5:00 AM	0.22	0.22	0.00
7/9/11 7:00 AM	0.22	0.22	0.00
7/9/11 9:00 AM	0.21	0.21	0.00
7/9/11 11:00 AM	0.19	0.19	0.00
7/9/11 1:00 PM	0.20	0.20	0.00
7/9/11 3:00 PM	0.20	0.20	0.00
7/9/11 5:00 PM	0.21	0.21	0.00
7/9/11 7:00 PM	0.17	0.17	0.00
7/9/11 9:00 PM	0.13	0.13	0.00
7/9/11 11:00 PM	0.09	0.09	0.00
7/10/11 1:00 AM	0.09	0.09	0.00
7/10/11 3:00 AM	0.11	0.11	0.00
7/10/11 5:00 AM	0.09	0.09	0.00
7/10/11 7:00 AM	0.10	0.10	0.00
7/10/11 9:00 AM	0.15	0.15	0.00
7/10/11 11:00 AM	0.12	0.12	0.00
7/10/11 1:00 PM	0.06	0.06	0.00
7/10/11 3:00 PM	0.06	0.06	0.00
7/10/11 5:00 PM	0.12	0.12	0.00
7/10/11 7:00 PM	0.13	0.13	0.00
7/10/11 9:00 PM	0.13	0.13	0.00
7/10/11 11:00 PM	0.12	0.12	0.00
7/11/11 1:00 AM	0.09	0.09	0.00
7/11/11 3:00 AM	0.09	0.09	0.00
7/11/11 5:00 AM	0.09	0.09	0.00
7/11/11 7:00 AM	0.15	0.15	0.00
7/11/11 9:00 AM	0.20	0.20	0.00
7/11/11 11:00 AM	0.22	0.22	0.00
7/11/11 1:00 PM	0.19	0.19	0.20
7/11/11 3:00 PM	0.19	0.19	0.70
7/11/11 5:00 PM	0.18	0.18	0.36
7/11/11 7:00 PM	0.18	0.18	0.10
7/11/11 9:00 PM	0.18	0.18	0.07
7/11/11 11:00 PM	0.10	0.10	0.07
7/12/11 1:00 AM	0.11	0.11	0.06
7/12/11 3:00 AM	0.12	0.12	0.06
7/12/11 5:00 AM	0.18	0.18	0.06
7/12/11 7:00 AM	0.20	0.20	0.60
7/12/11 9:00 AM	0.20	0.20	1.84
7/12/11 11:00 AM	0.18	0.18	0.03
7/12/11 1:00 PM	0.17	0.17	0.06
7/12/11 3:00 PM	0.19	0.19	0.07
7/12/11 5:00 PM	0.18	0.18	0.09
7/12/11 7:00 PM	0.18	0.18	0.10
7/12/11 9:00 PM	0.16	0.16	0.13
7/12/11 11:00 PM	0.10	0.10	0.11
7/13/11 1:00 AM	0.11	0.11	0.08

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
7/13/11 3:00 AM	0.11	0.11	0.06
7/13/11 5:00 AM	0.12	0.12	0.06
7/13/11 7:00 AM	0.15	0.15	0.11
7/13/11 9:00 AM	0.08	0.08	0.14
7/13/11 11:00 AM	0.08	0.08	0.14
7/13/11 1:00 PM	0.18	0.18	0.18
7/13/11 3:00 PM	0.19	0.19	0.13
7/13/11 5:00 PM	0.18	0.18	0.12
7/13/11 7:00 PM	0.19	0.19	0.13
7/13/11 9:00 PM	0.19	0.19	0.12
7/13/11 11:00 PM	0.15	0.15	0.10
7/14/11 1:00 AM	0.13	0.13	0.10
7/14/11 3:00 AM	0.13	0.13	0.09
7/14/11 5:00 AM	0.13	0.13	0.09
7/14/11 7:00 AM	0.20	0.20	0.10
7/14/11 9:00 AM	0.15	0.15	0.09
7/14/11 11:00 AM	0.08	0.08	0.09
7/14/11 1:00 PM	0.08	0.08	0.09
7/14/11 3:00 PM	0.08	0.08	0.07
7/14/11 5:00 PM	0.21	0.21	0.06
7/14/11 7:00 PM	0.21	0.21	0.07
7/14/11 9:00 PM	0.20	0.20	0.08
7/14/11 11:00 PM	0.20	0.20	0.08
7/15/11 1:00 AM	0.20	0.20	0.08
7/15/11 3:00 AM	0.21	0.21	0.08
7/15/11 5:00 AM	0.22	0.22	0.09
7/15/11 7:00 AM	0.21	0.21	0.11
7/15/11 9:00 AM	0.11	0.11	0.10
7/15/11 11:00 AM	0.12	0.12	0.09
7/15/11 1:00 PM	0.16	0.16	0.07
7/15/11 3:00 PM	0.20	0.20	0.07
7/15/11 5:00 PM	0.20	0.20	0.05
7/15/11 7:00 PM	0.18	0.18	0.06
7/15/11 9:00 PM	0.12	0.12	0.06
7/15/11 11:00 PM	0.11	0.11	0.06
7/16/11 1:00 AM	0.11	0.11	0.06
7/16/11 3:00 AM	0.17	0.00	0.09
7/16/11 5:00 AM	0.18	0.00	0.07
7/16/11 7:00 AM	0.17	0.00	0.07
7/16/11 9:00 AM	0.18	0.00	0.18
7/16/11 11:00 AM	0.11	0.00	0.24
7/16/11 1:00 PM	0.10	0.00	0.16
7/16/11 3:00 PM	0.09	0.00	0.18
7/16/11 5:00 PM	0.09	0.00	0.16
7/16/11 7:00 PM	0.09	0.00	0.23
7/16/11 9:00 PM	0.10	0.00	0.16
7/16/11 11:00 PM	0.09	0.00	0.08
7/17/11 1:00 AM	0.09	0.00	0.01
7/17/11 3:00 AM	0.09	0.00	0.00
7/17/11 5:00 AM	0.10	0.00	0.00
7/17/11 7:00 AM	0.10	0.00	0.00
7/17/11 9:00 AM	0.10	0.00	0.00
7/17/11 11:00 AM	0.09	0.00	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
7/17/11 1:00 PM	0.09	0.00	0.00
7/17/11 3:00 PM	0.09	0.00	0.00
7/17/11 5:00 PM	0.09	0.00	0.00
7/17/11 7:00 PM	0.09	0.00	0.00
7/17/11 9:00 PM	0.09	0.00	0.00
7/17/11 11:00 PM	0.09	0.00	0.00
7/18/11 1:00 AM	0.09	0.00	0.00
7/18/11 3:00 AM	0.09	0.00	0.00
7/18/11 5:00 AM	0.09	0.00	0.00
7/18/11 7:00 AM	0.10	0.00	0.00
7/18/11 9:00 AM	0.09	0.00	0.00
7/18/11 11:00 AM	0.09	0.00	0.00
7/18/11 1:00 PM	0.09	0.00	0.00
7/18/11 3:00 PM	0.09	0.00	0.00
7/18/11 5:00 PM	0.08	0.00	0.00
7/18/11 7:00 PM	0.08	0.00	0.00
7/18/11 9:00 PM	0.09	0.09	0.00
7/18/11 11:00 PM	0.08	0.08	0.00
7/19/11 1:00 AM	0.08	0.08	0.00
7/19/11 3:00 AM	0.08	0.08	0.00
7/19/11 5:00 AM	0.12	0.00	0.00
7/19/11 7:00 AM	0.10	0.00	0.00
7/19/11 9:00 AM	0.08	0.08	0.00
7/19/11 11:00 AM	0.08	0.08	0.00
7/19/11 1:00 PM	0.08	0.08	0.00
7/19/11 3:00 PM	0.10	0.10	0.00
7/19/11 5:00 PM	0.13	0.13	0.00
7/19/11 7:00 PM	0.19	0.19	0.00
7/19/11 9:00 PM	0.15	0.15	0.00
7/19/11 11:00 PM	0.20	0.20	0.00
7/20/11 1:00 AM	0.22	0.22	0.00
7/20/11 3:00 AM	0.11	0.11	0.00
7/20/11 5:00 AM	0.11	0.11	0.00
7/20/11 7:00 AM	0.17	0.17	0.00
7/20/11 9:00 AM	0.19	0.19	0.00
7/20/11 11:00 AM	0.16	0.16	0.00
7/20/11 1:00 PM	0.16	0.16	0.00
7/20/11 3:00 PM	0.17	0.17	0.00
7/20/11 5:00 PM	0.16	0.16	0.00
7/20/11 7:00 PM	0.15	0.15	0.00
7/20/11 9:00 PM	0.17	0.17	0.00
7/20/11 11:00 PM	0.13	0.13	0.00
7/21/11 1:00 AM	0.11	0.11	0.00
7/21/11 3:00 AM	0.11	0.11	0.00
7/21/11 5:00 AM	0.14	0.14	0.00
7/21/11 7:00 AM	0.18	0.18	0.00
7/21/11 9:00 AM	0.17	0.17	0.00
7/21/11 11:00 AM	0.17	0.17	0.00
7/21/11 1:00 PM	0.16	0.16	0.00
7/21/11 3:00 PM	0.11	0.11	0.00
7/21/11 5:00 PM	0.05	0.05	0.00
7/21/11 7:00 PM	0.06	0.06	0.00
7/21/11 9:00 PM	0.11	0.11	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
7/21/11 11:00 PM	0.12	0.12	0.00
7/22/11 1:00 AM	0.12	0.12	0.00
7/22/11 3:00 AM	0.13	0.13	0.00
7/22/11 5:00 AM	0.13	0.13	0.00
7/22/11 7:00 AM	0.20	0.20	0.00
7/22/11 9:00 AM	0.22	0.22	0.00
7/22/11 11:00 AM	0.17	0.17	0.00
7/22/11 1:00 PM	0.19	0.19	0.00
7/22/11 3:00 PM	0.19	0.19	0.00
7/22/11 5:00 PM	0.18	0.18	0.00
7/22/11 7:00 PM	0.19	0.19	0.00
7/22/11 9:00 PM	0.21	0.21	0.00
7/22/11 11:00 PM	0.22	0.22	0.00
7/23/11 1:00 AM	0.23	0.23	0.00
7/23/11 3:00 AM	0.18	0.18	0.00
7/23/11 5:00 AM	0.13	0.13	0.00
7/23/11 7:00 AM	0.15	0.15	0.00
7/23/11 9:00 AM	0.20	0.20	0.00
7/23/11 11:00 AM	0.21	0.21	0.00
7/23/11 1:00 PM	0.14	0.14	0.00
7/23/11 3:00 PM	0.17	0.17	0.09
7/23/11 5:00 PM	0.19	0.19	0.38
7/23/11 7:00 PM	0.20	0.20	0.20
7/23/11 9:00 PM	0.18	0.18	0.13
7/23/11 11:00 PM	0.19	0.19	0.12
7/24/11 1:00 AM	0.17	0.17	0.12
7/24/11 3:00 AM	0.15	0.15	0.08
7/24/11 5:00 AM	0.13	0.13	0.08
7/24/11 7:00 AM	0.15	0.15	0.10
7/24/11 9:00 AM	0.15	0.15	0.14
7/24/11 11:00 AM	0.11	0.11	0.14
7/24/11 1:00 PM	0.16	0.16	0.15
7/24/11 3:00 PM	0.16	0.16	0.14
7/24/11 5:00 PM	0.17	0.17	0.13
7/24/11 7:00 PM	0.18	0.18	0.12
7/24/11 9:00 PM	0.15	0.15	0.12
7/24/11 11:00 PM	0.15	0.15	0.07
7/25/11 1:00 AM	0.14	0.14	0.06
7/25/11 3:00 AM	0.14	0.14	0.06
7/25/11 5:00 AM	0.15	0.15	0.09
7/25/11 7:00 AM	0.17	0.17	0.10
7/25/11 9:00 AM	0.07	0.07	0.10
7/25/11 11:00 AM	0.06	0.06	0.11
7/25/11 1:00 PM	0.06	0.06	0.11
7/25/11 3:00 PM	0.06	0.06	0.10
7/25/11 5:00 PM	0.18	0.18	0.07
7/25/11 7:00 PM	0.09	0.09	0.08
7/25/11 9:00 PM	0.07	0.07	0.09
7/25/11 11:00 PM	0.12	0.12	0.10
7/26/11 1:00 AM	0.13	0.13	0.11
7/26/11 3:00 AM	0.14	0.14	0.11
7/26/11 5:00 AM	0.15	0.15	0.10
7/26/11 7:00 AM	0.20	0.20	0.10

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
7/26/11 9:00 AM	0.09	0.09	0.10
7/26/11 11:00 AM	0.06	0.06	0.09
7/26/11 1:00 PM	0.06	0.06	0.10
7/26/11 3:00 PM	0.06	0.06	0.10
7/26/11 5:00 PM	0.06	0.06	0.10
7/26/11 7:00 PM	0.06	0.06	0.09
7/26/11 9:00 PM	0.06	0.06	0.09
7/26/11 11:00 PM	0.13	0.13	0.09
7/27/11 1:00 AM	0.12	0.12	0.10
7/27/11 3:00 AM	0.11	0.11	0.10
7/27/11 5:00 AM	0.14	0.14	0.11
7/27/11 7:00 AM	0.15	0.15	0.14
7/27/11 9:00 AM	0.08	0.08	0.13
7/27/11 11:00 AM	0.05	0.05	0.14
7/27/11 1:00 PM	0.05	0.05	0.15
7/27/11 3:00 PM	0.06	0.06	0.16
7/27/11 5:00 PM	0.06	0.06	0.15
7/27/11 7:00 PM	0.06	0.06	0.18
7/27/11 9:00 PM	0.06	0.06	0.14
7/27/11 11:00 PM	0.11	0.11	0.10
7/28/11 1:00 AM	0.12	0.12	0.09
7/28/11 3:00 AM	0.11	0.11	0.19
7/28/11 5:00 AM	0.15	0.15	0.08
7/28/11 7:00 AM	0.15	0.15	0.14
7/28/11 9:00 AM	0.06	0.06	0.25
7/28/11 11:00 AM	0.06	0.06	0.18
7/28/11 1:00 PM	0.06	0.06	0.18
7/28/11 3:00 PM	0.06	0.06	0.17
7/28/11 5:00 PM	0.06	0.06	0.31
7/28/11 7:00 PM	0.06	0.06	0.20
7/28/11 9:00 PM	0.07	0.07	0.23
7/28/11 11:00 PM	0.07	0.07	0.06
7/29/11 1:00 AM	0.07	0.07	0.10
7/29/11 3:00 AM	0.07	0.07	0.09
7/29/11 5:00 AM	0.15	0.15	0.07
7/29/11 7:00 AM	0.09	0.09	0.13
7/29/11 9:00 AM	0.06	0.06	0.15
7/29/11 11:00 AM	0.06	0.06	0.14
7/29/11 1:00 PM	0.06	0.06	0.13
7/29/11 3:00 PM	0.07	0.07	0.13
7/29/11 5:00 PM	0.13	0.13	0.12
7/29/11 7:00 PM	0.18	0.18	0.12
7/29/11 9:00 PM	0.16	0.16	0.12
7/29/11 11:00 PM	0.10	0.10	0.11
7/30/11 1:00 AM	0.12	0.12	0.13
7/30/11 3:00 AM	0.22	0.22	1.06
7/30/11 5:00 AM	0.23	0.23	0.17
7/30/11 7:00 AM	0.18	0.18	0.11
7/30/11 9:00 AM	0.13	0.13	0.29
7/30/11 11:00 AM	0.12	0.12	0.10
7/30/11 1:00 PM	0.12	0.12	0.10
7/30/11 3:00 PM	0.11	0.11	0.10
7/30/11 5:00 PM	0.11	0.11	0.10

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
7/30/11 7:00 PM	0.12	0.12	0.06
7/30/11 9:00 PM	0.12	0.12	0.06
7/30/11 11:00 PM	0.12	0.12	0.06
7/31/11 1:00 AM	0.12	0.12	0.06
7/31/11 3:00 AM	0.13	0.13	0.06
7/31/11 5:00 AM	0.12	0.12	0.08
7/31/11 7:00 AM	0.13	0.13	0.10
7/31/11 9:00 AM	0.14	0.14	0.11
7/31/11 11:00 AM	0.10	0.10	0.10
7/31/11 1:00 PM	0.07	0.07	0.11
7/31/11 3:00 PM	0.08	0.08	0.16
7/31/11 5:00 PM	0.16	0.16	0.15
7/31/11 7:00 PM	0.20	0.20	0.12
7/31/11 9:00 PM	0.22	0.22	0.11
7/31/11 11:00 PM	0.19	0.19	0.11
8/1/11 1:00 AM	0.14	0.00	0.24
8/1/11 3:00 AM	0.11	0.00	0.24
8/1/11 5:00 AM	0.12	0.00	0.17
8/1/11 7:00 AM	0.15	0.00	0.16
8/1/11 9:00 AM	0.14	0.00	0.16
8/1/11 11:00 AM	0.12	0.00	0.16
8/1/11 1:00 PM	0.06	0.00	0.16
8/1/11 3:00 PM	0.06	0.00	0.17
8/1/11 5:00 PM	0.07	0.00	0.16
8/1/11 7:00 PM	0.20	0.00	0.16
8/1/11 9:00 PM	0.21	0.00	0.16
8/1/11 11:00 PM	0.21	0.00	0.15
8/2/11 1:00 AM	0.20	0.00	0.15
8/2/11 3:00 AM	0.20	0.00	0.20
8/2/11 5:00 AM	0.19	0.00	0.14
8/2/11 7:00 AM	0.25	0.00	0.15
8/2/11 9:00 AM	0.30	0.00	0.16
8/2/11 11:00 AM	0.21	0.00	0.16
8/2/11 1:00 PM	0.20	0.00	0.18
8/2/11 3:00 PM	0.19	0.00	0.17
8/2/11 5:00 PM	0.21	0.00	0.16
8/2/11 7:00 PM	0.21	0.00	0.16
8/2/11 9:00 PM	0.21	0.00	0.16
8/2/11 11:00 PM	0.21	0.00	0.17
8/3/11 1:00 AM	0.21	0.00	0.17
8/3/11 3:00 AM	0.20	0.00	0.16
8/3/11 5:00 AM	0.19	0.00	0.18
8/3/11 7:00 AM	0.21	0.00	0.15
8/3/11 9:00 AM	0.21	0.00	0.15
8/3/11 11:00 AM	0.11	0.00	0.17
8/3/11 1:00 PM	0.09	0.00	0.17
8/3/11 3:00 PM	0.09	0.00	0.18
8/3/11 5:00 PM	0.09	0.00	0.23
8/3/11 7:00 PM	0.09	0.00	0.17
8/3/11 9:00 PM	0.09	0.00	0.17
8/3/11 11:00 PM	0.09	0.00	0.18
8/4/11 1:00 AM	0.09	0.00	0.20
8/4/11 3:00 AM	0.09	0.00	0.23

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
8/4/11 5:00 AM	0.09	0.00	0.17
8/4/11 7:00 AM	0.09	0.00	0.41
8/4/11 9:00 AM	0.09	0.00	0.33
8/4/11 11:00 AM	0.09	0.00	0.19
8/4/11 1:00 PM	0.10	0.00	0.22
8/4/11 3:00 PM	0.09	0.00	0.19
8/4/11 5:00 PM	0.09	0.00	0.19
8/4/11 7:00 PM	0.10	0.00	0.19
8/4/11 9:00 PM	0.09	0.00	0.19
8/4/11 11:00 PM	0.08	0.00	0.18
8/5/11 1:00 AM	0.08	0.00	0.18
8/5/11 3:00 AM	0.09	0.00	0.18
8/5/11 5:00 AM	0.10	0.00	0.17
8/5/11 7:00 AM	0.12	0.00	0.18
8/5/11 9:00 AM	0.15	0.00	0.18
8/5/11 11:00 AM	0.16	0.16	0.18
8/5/11 1:00 PM	0.15	0.15	0.19
8/5/11 3:00 PM	0.19	0.19	0.20
8/5/11 5:00 PM	0.18	0.18	0.20
8/5/11 7:00 PM	0.00	0.02	0.20
8/5/11 9:00 PM	0.00	0.06	0.20
8/5/11 11:00 PM	0.00	0.10	0.20
8/6/11 1:00 AM	0.00	0.11	0.20
8/6/11 3:00 AM	0.00	0.13	0.20
8/6/11 5:00 AM	0.00	0.14	0.20
8/6/11 7:00 AM	0.00	0.18	0.20
8/6/11 9:00 AM	0.00	0.19	0.20
8/6/11 11:00 AM	0.00	0.20	0.21
8/6/11 1:00 PM	0.17	0.17	0.21
8/6/11 3:00 PM	0.17	0.17	0.21
8/6/11 5:00 PM	0.17	0.17	0.21
8/6/11 7:00 PM	0.17	0.17	0.22
8/6/11 9:00 PM	0.17	0.17	0.21
8/6/11 11:00 PM	0.20	0.20	0.21
8/7/11 1:00 AM	0.22	0.22	0.15
8/7/11 3:00 AM	0.25	0.25	0.09
8/7/11 5:00 AM	0.27	0.27	0.09
8/7/11 7:00 AM	0.30	0.30	0.12
8/7/11 9:00 AM	0.31	0.31	0.23
8/7/11 11:00 AM	0.27	0.27	0.18
8/7/11 1:00 PM	0.26	0.26	0.15
8/7/11 3:00 PM	0.26	0.26	0.13
8/7/11 5:00 PM	0.25	0.25	0.09
8/7/11 7:00 PM	0.24	0.24	0.09
8/7/11 9:00 PM	0.23	0.23	0.10
8/7/11 11:00 PM	0.21	0.21	0.13
8/8/11 1:00 AM	0.20	0.20	0.13
8/8/11 3:00 AM	0.19	0.19	0.12
8/8/11 5:00 AM	0.20	0.20	0.14
8/8/11 7:00 AM	0.22	0.22	0.17
8/8/11 9:00 AM	0.22	0.22	0.11
8/8/11 11:00 AM	0.22	0.22	0.10
8/8/11 1:00 PM	0.22	0.22	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
8/8/11 3:00 PM	0.23	0.23	0.02
8/8/11 5:00 PM	0.22	0.22	0.09
8/8/11 7:00 PM	0.23	0.23	0.12
8/8/11 9:00 PM	0.24	0.24	0.13
8/8/11 11:00 PM	0.22	0.22	0.13
8/9/11 1:00 AM	0.20	0.20	0.13
8/9/11 3:00 AM	0.20	0.20	0.13
8/9/11 5:00 AM	0.20	0.20	0.12
8/9/11 7:00 AM	0.22	0.22	0.12
8/9/11 9:00 AM	0.23	0.23	0.12
8/9/11 11:00 AM	0.25	0.25	0.12
8/9/11 1:00 PM	0.24	0.24	0.13
8/9/11 3:00 PM	0.21	0.21	0.20
8/9/11 5:00 PM	0.20	0.20	0.22
8/9/11 7:00 PM	0.21	0.21	0.20
8/9/11 9:00 PM	0.20	0.20	0.18
8/9/11 11:00 PM	0.15	0.15	0.17
8/10/11 1:00 AM	0.16	0.16	0.09
8/10/11 3:00 AM	0.16	0.16	0.07
8/10/11 5:00 AM	0.14	0.14	0.11
8/10/11 7:00 AM	0.22	0.22	0.15
8/10/11 9:00 AM	0.23	0.23	0.15
8/10/11 11:00 AM	0.22	0.22	0.17
8/10/11 1:00 PM	0.20	0.20	0.19
8/10/11 3:00 PM	0.16	0.16	0.20
8/10/11 5:00 PM	0.17	0.17	0.22
8/10/11 7:00 PM	0.22	0.22	0.26
8/10/11 9:00 PM	0.23	0.23	0.19
8/10/11 11:00 PM	0.15	0.15	0.16
8/11/11 1:00 AM	0.12	0.12	0.16
8/11/11 3:00 AM	0.13	0.13	0.16
8/11/11 5:00 AM	0.14	0.14	0.16
8/11/11 7:00 AM	0.13	0.13	0.14
8/11/11 9:00 AM	0.13	0.13	0.14
8/11/11 11:00 AM	0.19	0.19	0.15
8/11/11 1:00 PM	0.18	0.18	0.17
8/11/11 3:00 PM	0.14	0.14	0.17
8/11/11 5:00 PM	0.14	0.00	0.18
8/11/11 7:00 PM	0.14	0.00	0.19
8/11/11 9:00 PM	0.14	0.00	0.12
8/11/11 11:00 PM	0.17	0.00	0.06
8/12/11 1:00 AM	0.17	0.00	0.06
8/12/11 3:00 AM	0.15	0.00	0.11
8/12/11 5:00 AM	0.15	0.00	0.07
8/12/11 7:00 AM	0.17	0.00	0.24
8/12/11 9:00 AM	0.12	0.00	0.27
8/12/11 11:00 AM	0.12	0.00	0.27
8/12/11 1:00 PM	0.12	0.00	0.24
8/12/11 3:00 PM	0.12	0.00	0.24
8/12/11 5:00 PM	0.11	0.00	0.24
8/12/11 7:00 PM	0.10	0.00	0.23
8/12/11 9:00 PM	0.09	0.00	0.22
8/12/11 11:00 PM	0.10	0.00	0.22

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
8/13/11 1:00 AM	0.10	0.00	0.21
8/13/11 3:00 AM	0.10	0.00	0.20
8/13/11 5:00 AM	0.09	0.00	0.21
8/13/11 7:00 AM	0.10	0.00	0.20
8/13/11 9:00 AM	0.11	0.00	0.21
8/13/11 11:00 AM	0.11	0.00	0.21
8/13/11 1:00 PM	0.11	0.00	0.21
8/13/11 3:00 PM	0.11	0.00	0.20
8/13/11 5:00 PM	0.12	0.00	0.23
8/13/11 7:00 PM	0.11	0.00	0.24
8/13/11 9:00 PM	0.10	0.00	0.21
8/13/11 11:00 PM	0.10	0.00	0.10
8/14/11 1:00 AM	0.10	0.00	0.20
8/14/11 3:00 AM	0.10	0.00	0.20
8/14/11 5:00 AM	0.10	0.00	0.21
8/14/11 7:00 AM	0.10	0.00	0.12
8/14/11 9:00 AM	0.00	0.00	0.06
8/14/11 11:00 AM	0.00	0.00	0.06
8/14/11 1:00 PM	0.00	0.00	0.06
8/14/11 3:00 PM	0.00	0.00	0.06
8/14/11 5:00 PM	0.01	0.00	0.06
8/14/11 7:00 PM	0.05	0.00	0.06
8/14/11 9:00 PM	0.07	0.00	0.17
8/14/11 11:00 PM	0.08	0.00	0.25
8/15/11 1:00 AM	0.08	0.00	0.21
8/15/11 3:00 AM	0.08	0.00	0.20
8/15/11 5:00 AM	0.08	0.00	0.19
8/15/11 7:00 AM	0.08	0.00	0.19
8/15/11 9:00 AM	0.08	0.00	0.20
8/15/11 11:00 AM	0.09	0.00	0.22
8/15/11 1:00 PM	0.09	0.00	0.22
8/15/11 3:00 PM	0.09	0.00	0.24
8/15/11 5:00 PM	0.08	0.00	0.20
8/15/11 7:00 PM	0.08	0.00	0.19
8/15/11 9:00 PM	0.08	0.00	0.21
8/15/11 11:00 PM	0.08	0.00	0.22
8/16/11 1:00 AM	0.08	0.00	0.20
8/16/11 3:00 AM	0.07	0.00	0.13
8/16/11 5:00 AM	0.08	0.00	0.17
8/16/11 7:00 AM	0.08	0.00	0.21
8/16/11 9:00 AM	0.10	0.10	0.22
8/16/11 11:00 AM	0.10	0.10	0.25
8/16/11 1:00 PM	0.10	0.10	0.28
8/16/11 3:00 PM	0.10	0.10	0.23
8/16/11 5:00 PM	0.09	0.09	0.19
8/16/11 7:00 PM	0.09	0.09	0.18
8/16/11 9:00 PM	0.11	0.11	0.18
8/16/11 11:00 PM	0.15	0.15	0.18
8/17/11 1:00 AM	0.16	0.16	0.18
8/17/11 3:00 AM	0.16	0.16	0.18
8/17/11 5:00 AM	0.18	0.18	0.18
8/17/11 7:00 AM	0.17	0.17	0.20
8/17/11 9:00 AM	0.16	0.16	0.20

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
8/17/11 11:00 AM	0.18	0.18	0.21
8/17/11 1:00 PM	0.19	0.19	0.20
8/17/11 3:00 PM	0.20	0.20	0.16
8/17/11 5:00 PM	0.20	0.20	0.13
8/17/11 7:00 PM	0.21	0.21	0.11
8/17/11 9:00 PM	0.20	0.20	0.12
8/17/11 11:00 PM	0.19	0.19	0.13
8/18/11 1:00 AM	0.15	0.15	0.13
8/18/11 3:00 AM	0.14	0.14	0.14
8/18/11 5:00 AM	0.18	0.18	0.17
8/18/11 7:00 AM	0.19	0.19	0.21
8/18/11 9:00 AM	0.12	0.12	0.20
8/18/11 11:00 AM	0.07	0.07	0.18
8/18/11 1:00 PM	0.07	0.07	0.18
8/18/11 3:00 PM	0.08	0.08	0.17
8/18/11 5:00 PM	0.08	0.08	0.15
8/18/11 7:00 PM	0.08	0.08	0.15
8/18/11 9:00 PM	0.08	0.08	0.15
8/18/11 11:00 PM	0.12	0.12	0.14
8/19/11 1:00 AM	0.21	0.21	0.10
8/19/11 3:00 AM	0.21	0.21	0.10
8/19/11 5:00 AM	0.21	0.21	0.10
8/19/11 7:00 AM	0.07	0.07	0.11
8/19/11 9:00 AM	0.07	0.07	0.14
8/19/11 11:00 AM	0.08	0.08	0.14
8/19/11 1:00 PM	0.08	0.08	0.14
8/19/11 3:00 PM	0.08	0.08	0.13
8/19/11 5:00 PM	0.09	0.09	0.13
8/19/11 7:00 PM	0.09	0.09	0.12
8/19/11 9:00 PM	0.14	0.14	0.12
8/19/11 11:00 PM	0.09	0.09	0.06
8/20/11 1:00 AM	0.14	0.14	0.05
8/20/11 3:00 AM	0.23	0.23	0.06
8/20/11 5:00 AM	0.24	0.24	0.06
8/20/11 7:00 AM	0.20	0.20	0.11
8/20/11 9:00 AM	0.10	0.10	0.14
8/20/11 11:00 AM	0.10	0.10	0.13
8/20/11 1:00 PM	0.10	0.10	0.13
8/20/11 3:00 PM	0.10	0.10	0.12
8/20/11 5:00 PM	0.17	0.17	0.12
8/20/11 7:00 PM	0.10	0.10	0.12
8/20/11 9:00 PM	0.10	0.10	0.10
8/20/11 11:00 PM	0.10	0.10	0.05
8/21/11 1:00 AM	0.10	0.10	0.06
8/21/11 3:00 AM	0.22	0.22	0.06
8/21/11 5:00 AM	0.22	0.22	0.04
8/21/11 7:00 AM	0.24	0.24	0.05
8/21/11 9:00 AM	0.11	0.11	0.14
8/21/11 11:00 AM	0.12	0.12	0.14
8/21/11 1:00 PM	0.14	0.14	0.16
8/21/11 3:00 PM	0.16	0.16	0.15
8/21/11 5:00 PM	0.12	0.12	0.14
8/21/11 7:00 PM	0.12	0.12	0.12

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
8/21/11 9:00 PM	0.12	0.12	0.13
8/21/11 11:00 PM	0.12	0.12	0.12
8/22/11 1:00 AM	0.16	0.00	0.09
8/22/11 3:00 AM	0.20	0.00	0.09
8/22/11 5:00 AM	0.27	0.00	0.11
8/22/11 7:00 AM	0.12	0.00	0.13
8/22/11 9:00 AM	0.08	0.00	0.14
8/22/11 11:00 AM	0.08	0.00	0.14
8/22/11 1:00 PM	0.08	0.00	0.15
8/22/11 3:00 PM	0.08	0.00	0.15
8/22/11 5:00 PM	0.09	0.00	0.14
8/22/11 7:00 PM	0.18	0.00	0.14
8/22/11 9:00 PM	0.19	0.00	0.14
8/22/11 11:00 PM	0.17	0.00	0.14
8/23/11 1:00 AM	0.13	0.00	0.14
8/23/11 3:00 AM	0.18	0.00	0.13
8/23/11 5:00 AM	0.24	0.00	0.15
8/23/11 7:00 AM	0.22	0.00	0.15
8/23/11 9:00 AM	0.22	0.00	0.16
8/23/11 11:00 AM	0.21	0.00	0.16
8/23/11 1:00 PM	0.22	0.00	0.14
8/23/11 3:00 PM	0.23	0.00	0.11
8/23/11 5:00 PM	0.23	0.00	0.14
8/23/11 7:00 PM	0.18	0.00	0.06
8/23/11 9:00 PM	0.14	0.00	0.03
8/23/11 11:00 PM	0.17	0.00	0.00
8/24/11 1:00 AM	0.14	0.00	0.00
8/24/11 3:00 AM	0.14	0.00	0.00
8/24/11 5:00 AM	0.19	0.00	0.00
8/24/11 7:00 AM	0.22	0.00	0.00
8/24/11 9:00 AM	0.20	0.00	0.00
8/24/11 11:00 AM	0.19	0.00	0.00
8/24/11 1:00 PM	0.18	0.00	0.00
8/24/11 3:00 PM	0.17	0.00	0.00
8/24/11 5:00 PM	0.15	0.00	0.00
8/24/11 7:00 PM	0.08	0.00	0.00
8/24/11 9:00 PM	0.08	0.00	0.00
8/24/11 11:00 PM	0.07	0.00	0.00
8/25/11 1:00 AM	0.09	0.00	0.00
8/25/11 3:00 AM	0.14	0.00	0.00
8/25/11 5:00 AM	0.07	0.00	0.00
8/25/11 7:00 AM	0.07	0.00	0.00
8/25/11 9:00 AM	0.07	0.00	0.00
8/25/11 11:00 AM	0.07	0.00	0.00
8/25/11 1:00 PM	0.07	0.00	0.00
8/25/11 3:00 PM	0.07	0.00	0.00
8/25/11 5:00 PM	0.08	0.00	0.00
8/25/11 7:00 PM	0.08	0.00	0.00
8/25/11 9:00 PM	0.10	0.00	0.00
8/25/11 11:00 PM	0.13	0.00	0.34
8/26/11 1:00 AM	0.14	0.00	0.41
8/26/11 3:00 AM	0.19	0.00	0.41
8/26/11 5:00 AM	0.21	0.00	0.41

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
8/26/11 7:00 AM	0.21	0.00	0.40
8/26/11 9:00 AM	0.18	0.00	0.32
8/26/11 11:00 AM	0.15	0.00	0.26
8/26/11 1:00 PM	0.11	0.00	0.18
8/26/11 3:00 PM	0.15	0.00	0.18
8/26/11 5:00 PM	0.21	0.00	0.17
8/26/11 7:00 PM	0.20	0.00	0.16
8/26/11 9:00 PM	0.11	0.00	0.16
8/26/11 11:00 PM	0.16	0.00	0.16
8/27/11 1:00 AM	0.14	0.00	0.16
8/27/11 3:00 AM	0.14	0.00	0.16
8/27/11 5:00 AM	0.15	0.00	0.16
8/27/11 7:00 AM	0.18	0.00	0.18
8/27/11 9:00 AM	0.22	0.00	0.17
8/27/11 11:00 AM	0.22	0.00	0.18
8/27/11 1:00 PM	0.13	0.00	0.17
8/27/11 3:00 PM	0.11	0.00	0.17
8/27/11 5:00 PM	0.21	0.00	0.17
8/27/11 7:00 PM	0.24	0.00	0.15
8/27/11 9:00 PM	0.23	0.00	0.15
8/27/11 11:00 PM	0.21	0.00	0.15
8/28/11 1:00 AM	0.21	0.00	0.15
8/28/11 3:00 AM	0.24	0.00	0.14
8/28/11 5:00 AM	0.24	0.00	0.13
8/28/11 7:00 AM	0.22	0.00	0.12
8/28/11 9:00 AM	0.23	0.00	0.12
8/28/11 11:00 AM	0.21	0.00	0.11
8/28/11 1:00 PM	0.14	0.00	0.14
8/28/11 3:00 PM	0.10	0.00	0.18
8/28/11 5:00 PM	0.19	0.00	0.19
8/28/11 7:00 PM	0.24	0.00	0.19
8/28/11 9:00 PM	0.24	0.00	0.18
8/28/11 11:00 PM	0.22	0.00	0.16
8/29/11 1:00 AM	0.24	0.00	0.10
8/29/11 3:00 AM	0.20	0.00	0.10
8/29/11 5:00 AM	0.23	0.00	0.17
8/29/11 7:00 AM	0.23	0.00	0.17
8/29/11 9:00 AM	0.13	0.00	0.15
8/29/11 11:00 AM	0.10	0.00	0.14
8/29/11 1:00 PM	0.12	0.00	0.15
8/29/11 3:00 PM	0.13	0.00	0.14
8/29/11 5:00 PM	0.20	0.00	0.14
8/29/11 7:00 PM	0.21	0.00	0.15
8/29/11 9:00 PM	0.11	0.00	0.15
8/29/11 11:00 PM	0.24	0.00	0.15
8/30/11 1:00 AM	0.17	0.00	0.16
8/30/11 3:00 AM	0.17	0.00	0.16
8/30/11 5:00 AM	0.18	0.00	0.16
8/30/11 7:00 AM	0.18	0.00	0.17
8/30/11 9:00 AM	0.20	0.00	0.16
8/30/11 11:00 AM	0.17	0.00	0.16
8/30/11 1:00 PM	0.16	0.00	0.18
8/30/11 3:00 PM	0.19	0.00	0.19

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
8/30/11 5:00 PM	0.11	0.00	0.18
8/30/11 7:00 PM	0.10	0.00	0.17
8/30/11 9:00 PM	0.09	0.00	0.22
8/30/11 11:00 PM	0.08	0.00	0.25
8/31/11 1:00 AM	0.12	0.00	0.18
8/31/11 3:00 AM	0.19	0.00	0.12
8/31/11 5:00 AM	0.21	0.00	0.13
8/31/11 7:00 AM	0.16	0.00	0.20
8/31/11 9:00 AM	0.13	0.00	0.24
8/31/11 11:00 AM	0.13	0.00	0.12
8/31/11 1:00 PM	0.14	0.00	0.11
8/31/11 3:00 PM	0.15	0.00	0.11
8/31/11 5:00 PM	0.14	0.00	0.12
8/31/11 7:00 PM	0.17	0.00	0.11
8/31/11 9:00 PM	0.17	0.00	0.11
8/31/11 11:00 PM	0.16	0.00	0.12
9/1/11 1:00 AM	0.15	0.15	0.12
9/1/11 3:00 AM	0.13	0.13	0.11
9/1/11 5:00 AM	0.16	0.16	0.14
9/1/11 7:00 AM	0.18	0.18	0.17
9/1/11 9:00 AM	0.20	0.20	0.18
9/1/11 11:00 AM	0.20	0.00	0.19
9/1/11 1:00 PM	0.19	0.00	0.18
9/1/11 3:00 PM	0.18	0.00	0.19
9/1/11 5:00 PM	0.19	0.00	0.15
9/1/11 7:00 PM	0.19	0.00	0.09
9/1/11 9:00 PM	0.18	0.00	0.00
9/1/11 11:00 PM	0.20	0.00	0.00
9/2/11 1:00 AM	0.19	0.00	0.00
9/2/11 3:00 AM	0.18	0.00	0.00
9/2/11 5:00 AM	0.20	0.00	0.00
9/2/11 7:00 AM	0.21	0.00	0.00
9/2/11 9:00 AM	0.20	0.00	0.00
9/2/11 11:00 AM	0.20	0.00	0.00
9/2/11 1:00 PM	0.22	0.00	0.00
9/2/11 3:00 PM	0.18	0.00	0.00
9/2/11 5:00 PM	0.19	0.19	0.00
9/2/11 7:00 PM	0.20	0.20	0.00
9/2/11 9:00 PM	0.22	0.22	0.00
9/2/11 11:00 PM	0.22	0.22	0.00
9/3/11 1:00 AM	0.22	0.22	0.00
9/3/11 3:00 AM	0.21	0.21	0.00
9/3/11 5:00 AM	0.19	0.19	0.00
9/3/11 7:00 AM	0.23	0.23	0.00
9/3/11 9:00 AM	0.23	0.23	0.00
9/3/11 11:00 AM	0.21	0.21	0.00
9/3/11 1:00 PM	0.21	0.21	0.00
9/3/11 3:00 PM	0.21	0.21	0.00
9/3/11 5:00 PM	0.23	0.23	0.00
9/3/11 7:00 PM	0.23	0.23	0.00
9/3/11 9:00 PM	0.23	0.23	0.00
9/3/11 11:00 PM	0.23	0.23	0.00
9/4/11 1:00 AM	0.25	0.25	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
9/4/11 3:00 AM	0.25	0.25	0.00
9/4/11 5:00 AM	0.22	0.22	0.00
9/4/11 7:00 AM	0.19	0.19	0.09
9/4/11 9:00 AM	0.20	0.20	0.11
9/4/11 11:00 AM	0.21	0.21	0.21
9/4/11 1:00 PM	0.21	0.21	0.35
9/4/11 3:00 PM	0.21	0.21	0.14
9/4/11 5:00 PM	0.20	0.20	0.17
9/4/11 7:00 PM	0.22	0.22	0.29
9/4/11 9:00 PM	0.22	0.22	0.18
9/4/11 11:00 PM	0.22	0.22	0.16
9/5/11 1:00 AM	0.22	0.22	0.16
9/5/11 3:00 AM	0.24	0.24	0.15
9/5/11 5:00 AM	0.22	0.22	0.19
9/5/11 7:00 AM	0.22	0.22	0.21
9/5/11 9:00 AM	0.21	0.21	0.20
9/5/11 11:00 AM	0.18	0.18	0.20
9/5/11 1:00 PM	0.17	0.17	0.21
9/5/11 3:00 PM	0.17	0.17	0.17
9/5/11 5:00 PM	0.19	0.19	0.17
9/5/11 7:00 PM	0.17	0.17	0.17
9/5/11 9:00 PM	0.19	0.19	0.20
9/5/11 11:00 PM	0.20	0.20	0.16
9/6/11 1:00 AM	0.20	0.20	0.13
9/6/11 3:00 AM	0.20	0.20	0.14
9/6/11 5:00 AM	0.20	0.20	0.15
9/6/11 7:00 AM	0.19	0.19	0.15
9/6/11 9:00 AM	0.18	0.18	0.14
9/6/11 11:00 AM	0.20	0.20	0.15
9/6/11 1:00 PM	0.16	0.16	0.18
9/6/11 3:00 PM	0.06	0.06	0.17
9/6/11 5:00 PM	0.18	0.18	0.16
9/6/11 7:00 PM	0.22	0.22	0.15
9/6/11 9:00 PM	0.24	0.24	0.15
9/6/11 11:00 PM	0.19	0.19	0.15
9/7/11 1:00 AM	0.16	0.16	0.15
9/7/11 3:00 AM	0.18	0.18	0.30
9/7/11 5:00 AM	0.16	0.16	0.28
9/7/11 7:00 AM	0.18	0.18	0.32
9/7/11 9:00 AM	0.19	0.19	0.31
9/7/11 11:00 AM	0.17	0.17	0.31
9/7/11 1:00 PM	0.17	0.17	0.40
9/7/11 3:00 PM	0.18	0.18	0.28
9/7/11 5:00 PM	0.17	0.17	0.16
9/7/11 7:00 PM	0.17	0.17	0.19
9/7/11 9:00 PM	0.16	0.16	0.20
9/7/11 11:00 PM	0.16	0.16	0.07
9/8/11 1:00 AM	0.12	0.12	0.08
9/8/11 3:00 AM	0.14	0.14	0.08
9/8/11 5:00 AM	0.18	0.18	0.09
9/8/11 7:00 AM	0.17	0.17	0.10
9/8/11 9:00 AM	0.16	0.16	0.10
9/8/11 11:00 AM	0.17	0.17	0.22

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
9/8/11 1:00 PM	0.21	0.21	0.24
9/8/11 3:00 PM	0.18	0.18	0.23
9/8/11 5:00 PM	0.17	0.17	0.23
9/8/11 7:00 PM	0.13	0.13	0.21
9/8/11 9:00 PM	0.15	0.15	0.20
9/8/11 11:00 PM	0.13	0.13	0.11
9/9/11 1:00 AM	0.12	0.12	0.21
9/9/11 3:00 AM	0.15	0.15	0.17
9/9/11 5:00 AM	0.14	0.14	0.15
9/9/11 7:00 AM	0.14	0.14	0.21
9/9/11 9:00 AM	0.13	0.13	0.18
9/9/11 11:00 AM	0.13	0.13	0.21
9/9/11 1:00 PM	0.14	0.14	0.19
9/9/11 3:00 PM	0.11	0.11	0.16
9/9/11 5:00 PM	0.15	0.15	0.14
9/9/11 7:00 PM	0.15	0.15	0.13
9/9/11 9:00 PM	0.17	0.17	0.12
9/9/11 11:00 PM	0.13	0.13	0.11
9/10/11 1:00 AM	0.12	0.12	0.09
9/10/11 3:00 AM	0.13	0.13	0.09
9/10/11 5:00 AM	0.14	0.14	0.10
9/10/11 7:00 AM	0.14	0.14	0.10
9/10/11 9:00 AM	0.13	0.13	0.09
9/10/11 11:00 AM	0.13	0.13	0.08
9/10/11 1:00 PM	0.15	0.15	0.08
9/10/11 3:00 PM	0.16	0.16	0.08
9/10/11 5:00 PM	0.17	0.17	0.08
9/10/11 7:00 PM	0.15	0.15	0.08
9/10/11 9:00 PM	0.17	0.17	0.08
9/10/11 11:00 PM	0.15	0.15	0.08
9/11/11 1:00 AM	0.16	0.16	0.04
9/11/11 3:00 AM	0.17	0.17	0.04
9/11/11 5:00 AM	0.18	0.18	0.05
9/11/11 7:00 AM	0.18	0.18	0.07
9/11/11 9:00 AM	0.18	0.18	0.10
9/11/11 11:00 AM	0.15	0.15	0.10
9/11/11 1:00 PM	0.17	0.17	0.10
9/11/11 3:00 PM	0.18	0.18	0.10
9/11/11 5:00 PM	0.17	0.17	0.09
9/11/11 7:00 PM	0.19	0.19	0.09
9/11/11 9:00 PM	0.18	0.18	0.09
9/11/11 11:00 PM	0.19	0.19	0.09
9/12/11 1:00 AM	0.17	0.17	0.09
9/12/11 3:00 AM	0.18	0.18	0.08
9/12/11 5:00 AM	0.18	0.18	0.10
9/12/11 7:00 AM	0.18	0.18	0.08
9/12/11 9:00 AM	0.20	0.20	0.08
9/12/11 11:00 AM	0.15	0.15	0.08
9/12/11 1:00 PM	0.18	0.18	0.08
9/12/11 3:00 PM	0.19	0.19	0.09
9/12/11 5:00 PM	0.19	0.19	0.09
9/12/11 7:00 PM	0.19	0.19	0.09
9/12/11 9:00 PM	0.19	0.19	0.09

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
9/12/11 11:00 PM	0.18	0.18	0.11
9/13/11 1:00 AM	0.18	0.18	0.05
9/13/11 3:00 AM	0.17	0.17	0.05
9/13/11 5:00 AM	0.17	0.17	0.06
9/13/11 7:00 AM	0.20	0.20	0.06
9/13/11 9:00 AM	0.18	0.18	0.07
9/13/11 11:00 AM	0.17	0.17	0.07
9/13/11 1:00 PM	0.16	0.16	0.60
9/13/11 3:00 PM	0.16	0.16	0.32
9/13/11 5:00 PM	0.18	0.18	0.11
9/13/11 7:00 PM	0.18	0.18	0.17
9/13/11 9:00 PM	0.16	0.16	0.15
9/13/11 11:00 PM	0.14	0.14	0.13
9/14/11 1:00 AM	0.14	0.14	0.13
9/14/11 3:00 AM	0.16	0.16	0.12
9/14/11 5:00 AM	0.16	0.16	0.12
9/14/11 7:00 AM	0.18	0.18	0.18
9/14/11 9:00 AM	0.18	0.18	0.26
9/14/11 11:00 AM	0.19	0.19	0.21
9/14/11 1:00 PM	0.21	0.21	0.10
9/14/11 3:00 PM	0.19	0.19	0.10
9/14/11 5:00 PM	0.21	0.21	0.09
9/14/11 7:00 PM	0.19	0.19	0.09
9/14/11 9:00 PM	0.20	0.20	0.09
9/14/11 11:00 PM	0.17	0.17	0.09
9/15/11 1:00 AM	0.13	0.13	0.09
9/15/11 3:00 AM	0.16	0.16	0.09
9/15/11 5:00 AM	0.15	0.15	0.09
9/15/11 7:00 AM	0.17	0.17	0.10
9/15/11 9:00 AM	0.19	0.19	0.10
9/15/11 11:00 AM	0.18	0.18	0.10
9/15/11 1:00 PM	0.18	0.18	0.10
9/15/11 3:00 PM	0.16	0.16	0.18
9/15/11 5:00 PM	0.17	0.17	0.27
9/15/11 7:00 PM	0.18	0.18	0.13
9/15/11 9:00 PM	0.17	0.17	0.12
9/15/11 11:00 PM	0.18	0.18	0.16
9/16/11 1:00 AM	0.06	0.06	0.19
9/16/11 3:00 AM	0.06	0.06	0.19
9/16/11 5:00 AM	0.05	0.05	0.17
9/16/11 7:00 AM	0.15	0.15	0.11
9/16/11 9:00 AM	0.18	0.18	0.12
9/16/11 11:00 AM	0.16	0.16	0.12
9/16/11 1:00 PM	0.19	0.19	0.12
9/16/11 3:00 PM	0.18	0.18	0.13
9/16/11 5:00 PM	0.18	0.18	0.13
9/16/11 7:00 PM	0.19	0.19	0.13
9/16/11 9:00 PM	0.19	0.19	0.09
9/16/11 11:00 PM	0.18	0.18	0.03
9/17/11 1:00 AM	0.18	0.18	0.00
9/17/11 3:00 AM	0.18	0.18	0.00
9/17/11 5:00 AM	0.18	0.18	0.04
9/17/11 7:00 AM	0.18	0.18	0.07

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
9/17/11 9:00 AM	0.17	0.17	0.23
9/17/11 11:00 AM	0.18	0.18	0.23
9/17/11 1:00 PM	0.18	0.18	0.23
9/17/11 3:00 PM	0.19	0.19	0.22
9/17/11 5:00 PM	0.18	0.18	0.18
9/17/11 7:00 PM	0.18	0.18	0.17
9/17/11 9:00 PM	0.19	0.19	0.16
9/17/11 11:00 PM	0.20	0.20	0.16
9/18/11 1:00 AM	0.21	0.21	0.17
9/18/11 3:00 AM	0.20	0.20	0.17
9/18/11 5:00 AM	0.20	0.20	0.13
9/18/11 7:00 AM	0.19	0.19	0.04
9/18/11 9:00 AM	0.20	0.20	0.04
9/18/11 11:00 AM	0.19	0.19	0.04
9/18/11 1:00 PM	0.22	0.22	0.04
9/18/11 3:00 PM	0.23	0.23	0.05
9/18/11 5:00 PM	0.23	0.23	0.05
9/18/11 7:00 PM	0.11	0.11	0.06
9/18/11 9:00 PM	0.08	0.08	0.08
9/18/11 11:00 PM	0.09	0.09	0.23
9/19/11 1:00 AM	0.10	0.10	0.13
9/19/11 3:00 AM	0.10	0.10	0.12
9/19/11 5:00 AM	0.10	0.10	0.11
9/19/11 7:00 AM	0.10	0.10	0.10
9/19/11 9:00 AM	0.09	0.09	0.10
9/19/11 11:00 AM	0.09	0.09	0.09
9/19/11 1:00 PM	0.09	0.09	0.09
9/19/11 3:00 PM	0.08	0.08	0.09
9/19/11 5:00 PM	0.08	0.08	0.08
9/19/11 7:00 PM	0.08	0.08	0.08
9/19/11 9:00 PM	0.07	0.07	0.08
9/19/11 11:00 PM	0.08	0.08	0.08
9/20/11 1:00 AM	0.07	0.07	0.09
9/20/11 3:00 AM	0.07	0.07	0.09
9/20/11 5:00 AM	0.07	0.07	0.10
9/20/11 7:00 AM	0.07	0.07	0.10
9/20/11 9:00 AM	0.07	0.07	0.10
9/20/11 11:00 AM	0.07	0.07	0.11
9/20/11 1:00 PM	0.07	0.07	0.11
9/20/11 3:00 PM	0.07	0.07	0.11
9/20/11 5:00 PM	0.08	0.08	0.12
9/20/11 7:00 PM	0.08	0.08	0.13
9/20/11 9:00 PM	0.08	0.08	0.13
9/20/11 11:00 PM	0.08	0.08	0.14
9/21/11 1:00 AM	0.12	0.12	0.15
9/21/11 3:00 AM	0.20	0.20	0.16
9/21/11 5:00 AM	0.09	0.09	0.16
9/21/11 7:00 AM	0.08	0.08	0.17
9/21/11 9:00 AM	0.09	0.09	0.18
9/21/11 11:00 AM	0.09	0.09	0.18
9/21/11 1:00 PM	0.08	0.08	0.17
9/21/11 3:00 PM	0.08	0.08	0.15
9/21/11 5:00 PM	0.24	0.24	0.15

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
9/21/11 7:00 PM	0.23	0.23	0.15
9/21/11 9:00 PM	0.22	0.22	0.16
9/21/11 11:00 PM	0.23	0.23	0.16
9/22/11 1:00 AM	0.09	0.09	0.17
9/22/11 3:00 AM	0.09	0.09	0.19
9/22/11 5:00 AM	0.09	0.09	0.22
9/22/11 7:00 AM	0.08	0.08	0.19
9/22/11 9:00 AM	0.09	0.09	0.16
9/22/11 11:00 AM	0.10	0.10	0.16
9/22/11 1:00 PM	0.10	0.10	0.16
9/22/11 3:00 PM	0.11	0.11	0.16
9/22/11 5:00 PM	0.11	0.11	0.17
9/22/11 7:00 PM	0.11	0.11	0.18
9/22/11 9:00 PM	0.10	0.10	0.19
9/22/11 11:00 PM	0.11	0.11	0.19
9/23/11 1:00 AM	0.19	0.19	0.19
9/23/11 3:00 AM	0.20	0.20	0.20
9/23/11 5:00 AM	0.11	0.11	0.09
9/23/11 7:00 AM	0.09	0.09	0.06
9/23/11 9:00 AM	0.21	0.21	0.06
9/23/11 11:00 AM	0.13	0.13	0.06
9/23/11 1:00 PM	0.19	0.19	0.07
9/23/11 3:00 PM	0.21	0.21	0.08
9/23/11 5:00 PM	0.21	0.21	0.09
9/23/11 7:00 PM	0.24	0.24	0.10
9/23/11 9:00 PM	0.25	0.25	0.10
9/23/11 11:00 PM	0.13	0.13	0.11
9/24/11 1:00 AM	0.25	0.25	0.09
9/24/11 3:00 AM	0.29	0.29	0.12
9/24/11 5:00 AM	0.19	0.19	0.12
9/24/11 7:00 AM	0.17	0.17	0.13
9/24/11 9:00 AM	0.18	0.18	0.12
9/24/11 11:00 AM	0.10	0.10	0.08
9/24/11 1:00 PM	0.19	0.19	0.12
9/24/11 3:00 PM	0.19	0.19	0.14
9/24/11 5:00 PM	0.17	0.17	0.18
9/24/11 7:00 PM	0.19	0.19	0.17
9/24/11 9:00 PM	0.20	0.20	0.17
9/24/11 11:00 PM	0.20	0.20	0.18
9/25/11 1:00 AM	0.18	0.18	0.18
9/25/11 3:00 AM	0.15	0.15	0.19
9/25/11 5:00 AM	0.19	0.19	0.20
9/25/11 7:00 AM	0.18	0.18	0.21
9/25/11 9:00 AM	0.21	0.21	0.21
9/25/11 11:00 AM	0.16	0.16	0.20
9/25/11 1:00 PM	0.16	0.16	0.19
9/25/11 3:00 PM	0.18	0.18	0.20
9/25/11 5:00 PM	0.16	0.16	0.20
9/25/11 7:00 PM	0.15	0.15	0.19
9/25/11 9:00 PM	0.15	0.15	0.19
9/25/11 11:00 PM	0.10	0.10	0.19
9/26/11 1:00 AM	0.18	0.18	0.19
9/26/11 3:00 AM	0.15	0.15	0.13

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
9/26/11 5:00 AM	0.18	0.18	0.19
9/26/11 7:00 AM	0.18	0.18	0.22
9/26/11 9:00 AM	0.17	0.17	0.22
9/26/11 11:00 AM	0.17	0.17	0.22
9/26/11 1:00 PM	0.17	0.17	0.22
9/26/11 3:00 PM	0.15	0.15	0.22
9/26/11 5:00 PM	0.15	0.15	0.20
9/26/11 7:00 PM	0.17	0.17	0.19
9/26/11 9:00 PM	0.16	0.16	0.16
9/26/11 11:00 PM	0.15	0.15	0.17
9/27/11 1:00 AM	0.16	0.16	0.17
9/27/11 3:00 AM	0.14	0.14	0.11
9/27/11 5:00 AM	0.16	0.16	0.18
9/27/11 7:00 AM	0.17	0.17	0.19
9/27/11 9:00 AM	0.16	0.16	0.13
9/27/11 11:00 AM	0.16	0.16	0.11
9/27/11 1:00 PM	0.15	0.15	0.11
9/27/11 3:00 PM	0.14	0.14	0.10
9/27/11 5:00 PM	0.14	0.14	0.06
9/27/11 7:00 PM	0.14	0.14	0.06
9/27/11 9:00 PM	0.16	0.16	0.05
9/27/11 11:00 PM	0.17	0.17	0.03
9/28/11 1:00 AM	0.14	0.14	0.03
9/28/11 3:00 AM	0.15	0.15	0.03
9/28/11 5:00 AM	0.17	0.17	0.05
9/28/11 7:00 AM	0.16	0.16	0.08
9/28/11 9:00 AM	0.16	0.16	0.08
9/28/11 11:00 AM	0.14	0.14	0.08
9/28/11 1:00 PM	0.14	0.14	0.07
9/28/11 3:00 PM	0.15	0.15	0.08
9/28/11 5:00 PM	0.13	0.13	0.08
9/28/11 7:00 PM	0.13	0.13	0.11
9/28/11 9:00 PM	0.15	0.15	0.11
9/28/11 11:00 PM	0.14	0.14	0.11
9/29/11 1:00 AM	0.12	0.12	0.11
9/29/11 3:00 AM	0.11	0.11	0.10
9/29/11 5:00 AM	0.13	0.13	0.12
9/29/11 7:00 AM	0.14	0.14	0.15
9/29/11 9:00 AM	0.14	0.14	0.13
9/29/11 11:00 AM	0.14	0.14	0.12
9/29/11 1:00 PM	0.13	0.13	0.11
9/29/11 3:00 PM	0.14	0.14	0.11
9/29/11 5:00 PM	0.12	0.12	0.11
9/29/11 7:00 PM	0.12	0.12	0.11
9/29/11 9:00 PM	0.13	0.13	0.11
9/29/11 11:00 PM	0.12	0.12	0.11
9/30/11 1:00 AM	0.12	0.12	0.11
9/30/11 3:00 AM	0.14	0.14	0.10
9/30/11 5:00 AM	0.13	0.13	0.10
9/30/11 7:00 AM	0.13	0.13	1.24
9/30/11 9:00 AM	0.13	0.13	0.73
9/30/11 11:00 AM	0.15	0.15	0.09
9/30/11 1:00 PM	0.14	0.14	0.09

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
9/30/11 3:00 PM	0.12	0.12	0.10
9/30/11 5:00 PM	0.09	0.09	0.10
9/30/11 7:00 PM	0.07	0.07	0.09
9/30/11 9:00 PM	0.07	0.07	0.09
9/30/11 11:00 PM	0.08	0.00	0.09
10/1/11 1:00 AM	0.11	0.00	0.09
10/1/11 3:00 AM	0.12	0.00	0.09
10/1/11 5:00 AM	0.14	0.00	0.09
10/1/11 7:00 AM	0.11	0.00	0.09
10/1/11 9:00 AM	0.07	0.00	0.09
10/1/11 11:00 AM	0.07	0.00	0.09
10/1/11 1:00 PM	0.07	0.00	0.07
10/1/11 3:00 PM	0.07	0.00	0.02
10/1/11 5:00 PM	0.07	0.00	0.00
10/1/11 7:00 PM	0.08	0.00	0.00
10/1/11 9:00 PM	0.08	0.00	0.00
10/1/11 11:00 PM	0.08	0.00	0.00
10/2/11 1:00 AM	0.08	0.00	0.00
10/2/11 3:00 AM	0.08	0.00	0.00
10/2/11 5:00 AM	0.08	0.00	0.00
10/2/11 7:00 AM	0.07	0.00	0.00
10/2/11 9:00 AM	0.07	0.00	0.00
10/2/11 11:00 AM	0.08	0.00	0.00
10/2/11 1:00 PM	0.08	0.00	0.00
10/2/11 3:00 PM	0.08	0.00	0.00
10/2/11 5:00 PM	0.08	0.00	0.00
10/2/11 7:00 PM	0.07	0.00	0.00
10/2/11 9:00 PM	0.08	0.00	0.00
10/2/11 11:00 PM	0.08	0.00	0.00
10/3/11 1:00 AM	0.08	0.00	0.00
10/3/11 3:00 AM	0.08	0.00	0.00
10/3/11 5:00 AM	0.08	0.00	0.00
10/3/11 7:00 AM	0.08	0.00	0.00
10/3/11 9:00 AM	0.08	0.00	0.00
10/3/11 11:00 AM	0.08	0.00	0.00
10/3/11 1:00 PM	0.09	0.00	0.00
10/3/11 3:00 PM	0.09	0.00	0.00
10/3/11 5:00 PM	0.09	0.00	0.00
10/3/11 7:00 PM	0.09	0.00	0.00
10/3/11 9:00 PM	0.09	0.00	0.00
10/3/11 11:00 PM	0.09	0.00	0.00
10/4/11 1:00 AM	0.09	0.00	0.57
10/4/11 3:00 AM	0.09	0.00	0.36
10/4/11 5:00 AM	0.09	0.00	0.32
10/4/11 7:00 AM	0.09	0.00	0.53
10/4/11 9:00 AM	0.09	0.00	0.21
10/4/11 11:00 AM	0.09	0.00	0.16
10/4/11 1:00 PM	0.09	0.00	0.15
10/4/11 3:00 PM	0.10	0.00	0.14
10/4/11 5:00 PM	0.10	0.00	0.12
10/4/11 7:00 PM	0.10	0.00	0.11
10/4/11 9:00 PM	0.10	0.00	0.12
10/4/11 11:00 PM	0.10	0.00	0.13

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
10/5/11 1:00 AM	0.11	0.00	0.10
10/5/11 3:00 AM	0.11	0.00	0.06
10/5/11 5:00 AM	0.11	0.00	0.07
10/5/11 7:00 AM	0.11	0.00	0.10
10/5/11 9:00 AM	0.11	0.00	0.14
10/5/11 11:00 AM	0.10	0.00	0.18
10/5/11 1:00 PM	0.10	0.00	0.19
10/5/11 3:00 PM	0.10	0.00	0.20
10/5/11 5:00 PM	0.10	0.00	0.18
10/5/11 7:00 PM	0.10	0.00	0.16
10/5/11 9:00 PM	0.11	0.00	0.12
10/5/11 11:00 PM	0.10	0.00	0.05
10/6/11 1:00 AM	0.10	0.00	0.07
10/6/11 3:00 AM	0.10	0.00	0.07
10/6/11 5:00 AM	0.10	0.00	0.08
10/6/11 7:00 AM	0.10	0.00	0.16
10/6/11 9:00 AM	0.09	0.00	0.16
10/6/11 11:00 AM	0.09	0.00	0.17
10/6/11 1:00 PM	0.09	0.00	0.16
10/6/11 3:00 PM	0.09	0.00	0.15
10/6/11 5:00 PM	0.09	0.00	0.14
10/6/11 7:00 PM	0.09	0.00	0.13
10/6/11 9:00 PM	0.09	0.00	0.13
10/6/11 11:00 PM	0.08	0.00	0.16
10/7/11 1:00 AM	0.08	0.00	0.13
10/7/11 3:00 AM	0.08	0.00	0.10
10/7/11 5:00 AM	0.08	0.00	0.13
10/7/11 7:00 AM	0.08	0.00	0.14
10/7/11 9:00 AM	0.08	0.00	0.13
10/7/11 11:00 AM	0.08	0.00	0.14
10/7/11 1:00 PM	0.08	0.00	0.14
10/7/11 3:00 PM	0.08	0.00	0.14
10/7/11 5:00 PM	0.07	0.00	0.13
10/7/11 7:00 PM	0.06	0.00	0.13
10/7/11 9:00 PM	0.05	0.00	0.12
10/7/11 11:00 PM	0.05	0.00	0.11
10/8/11 1:00 AM	0.04	0.00	0.11
10/8/11 3:00 AM	0.00	0.00	0.11
10/8/11 5:00 AM	0.00	0.00	0.11
10/8/11 7:00 AM	0.00	0.00	0.10
10/8/11 9:00 AM	0.00	0.00	0.10
10/8/11 11:00 AM	0.00	0.00	0.10
10/8/11 1:00 PM	0.00	0.00	0.10
10/8/11 3:00 PM	0.00	0.00	0.10
10/8/11 5:00 PM	0.00	0.00	0.09
10/8/11 7:00 PM	0.00	0.00	0.08
10/8/11 9:00 PM	0.00	0.00	0.08
10/8/11 11:00 PM	0.00	0.00	0.06
10/9/11 1:00 AM	0.00	0.00	0.07
10/9/11 3:00 AM	0.00	0.00	0.01
10/9/11 5:00 AM	0.00	0.00	0.00
10/9/11 7:00 AM	0.00	0.00	0.00
10/9/11 9:00 AM	0.00	0.00	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
10/9/11 11:00 AM	0.00	0.00	0.00
10/9/11 1:00 PM	0.00	0.00	0.00
10/9/11 3:00 PM	0.00	0.00	0.00
10/9/11 5:00 PM	0.00	0.00	0.00
10/9/11 7:00 PM	0.00	0.00	0.00
10/9/11 9:00 PM	0.00	0.00	0.00
10/9/11 11:00 PM	0.00	0.00	0.00
10/10/11 1:00 AM	0.00	0.00	0.00
10/10/11 3:00 AM	0.00	0.00	0.00
10/10/11 5:00 AM	0.00	0.00	0.00
10/10/11 7:00 AM	0.00	0.00	0.00
10/10/11 9:00 AM	0.00	0.00	0.00
10/10/11 11:00 AM	0.00	0.00	0.00
10/10/11 1:00 PM	0.00	0.00	0.00
10/10/11 3:00 PM	0.00	0.00	0.00
10/10/11 5:00 PM	0.00	0.00	0.00
10/10/11 7:00 PM	0.00	0.00	0.00
10/10/11 9:00 PM	0.00	0.00	0.00
10/10/11 11:00 PM	0.00	0.00	0.00
10/11/11 1:00 AM	0.00	0.00	0.03
10/11/11 3:00 AM	0.00	0.00	0.09
10/11/11 5:00 AM	0.00	0.00	0.16
10/11/11 7:00 AM	0.00	0.00	0.32
10/11/11 9:00 AM	0.00	0.00	0.28
10/11/11 11:00 AM	0.00	0.00	0.17
10/11/11 1:00 PM	0.00	0.00	0.16
10/11/11 3:00 PM	0.00	0.00	0.14
10/11/11 5:00 PM	0.00	0.00	0.13
10/11/11 7:00 PM	0.00	0.00	0.13
10/11/11 9:00 PM	0.00	0.00	0.14
10/11/11 11:00 PM	0.00	0.00	0.13
10/12/11 1:00 AM	0.00	0.00	0.05
10/12/11 3:00 AM	0.00	0.00	0.05
10/12/11 5:00 AM	0.00	0.00	0.06
10/12/11 7:00 AM	0.00	0.00	0.06
10/12/11 9:00 AM	0.00	0.00	0.07
10/12/11 11:00 AM	0.00	0.00	0.07
10/12/11 1:00 PM	0.00	0.00	0.08
10/12/11 3:00 PM	0.00	0.00	0.08
10/12/11 5:00 PM	0.00	0.00	0.05
10/12/11 7:00 PM	0.00	0.00	0.09
10/12/11 9:00 PM	0.00	0.00	0.09
10/12/11 11:00 PM	0.00	0.00	0.18
10/13/11 1:00 AM	0.00	0.00	0.25
10/13/11 3:00 AM	0.00	0.00	0.18
10/13/11 5:00 AM	0.00	0.00	0.19
10/13/11 7:00 AM	0.00	0.00	0.19
10/13/11 9:00 AM	0.00	0.00	0.17
10/13/11 11:00 AM	0.00	0.00	0.17
10/13/11 1:00 PM	0.00	0.00	0.18
10/13/11 3:00 PM	0.00	0.00	0.18
10/13/11 5:00 PM	0.00	0.00	0.18
10/13/11 7:00 PM	0.00	0.00	0.18

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
10/13/11 9:00 PM	0.00	0.00	0.18
10/13/11 11:00 PM	0.00	0.00	0.18
10/14/11 1:00 AM	0.00	0.00	0.18
10/14/11 3:00 AM	0.00	0.00	0.17
10/14/11 5:00 AM	0.00	0.00	0.18
10/14/11 7:00 AM	0.00	0.00	0.18
10/14/11 9:00 AM	0.00	0.00	0.18
10/14/11 11:00 AM	0.00	0.00	0.20
10/14/11 1:00 PM	0.00	0.00	0.22
10/14/11 3:00 PM	0.00	0.00	0.23
10/14/11 5:00 PM	0.00	0.00	0.23
10/14/11 7:00 PM	0.00	0.00	0.22
10/14/11 9:00 PM	0.00	0.00	0.23
10/14/11 11:00 PM	0.00	0.00	0.25
10/15/11 1:00 AM	0.00	0.00	0.26
10/15/11 3:00 AM	0.00	0.00	0.27
10/15/11 5:00 AM	0.00	0.00	0.24
10/15/11 7:00 AM	0.00	0.00	0.17
10/15/11 9:00 AM	0.00	0.00	0.19
10/15/11 11:00 AM	0.00	0.00	0.20
10/15/11 1:00 PM	0.00	0.00	0.20
10/15/11 3:00 PM	0.00	0.00	0.17
10/15/11 5:00 PM	0.01	0.00	0.13
10/15/11 7:00 PM	0.04	0.00	0.15
10/15/11 9:00 PM	0.07	0.00	0.06
10/15/11 11:00 PM	0.08	0.00	0.03
10/16/11 1:00 AM	0.09	0.00	0.03
10/16/11 3:00 AM	0.10	0.00	0.04
10/16/11 5:00 AM	0.11	0.00	0.04
10/16/11 7:00 AM	0.15	0.00	0.04
10/16/11 9:00 AM	0.17	0.00	0.04
10/16/11 11:00 AM	0.17	0.00	0.16
10/16/11 1:00 PM	0.17	0.00	0.16
10/16/11 3:00 PM	0.15	0.00	0.16
10/16/11 5:00 PM	0.14	0.00	0.13
10/16/11 7:00 PM	0.10	0.00	0.12
10/16/11 9:00 PM	0.09	0.00	0.12
10/16/11 11:00 PM	0.13	0.00	0.12
10/17/11 1:00 AM	0.12	0.00	0.12
10/17/11 3:00 AM	0.10	0.00	0.12
10/17/11 5:00 AM	0.10	0.00	0.12
10/17/11 7:00 AM	0.12	0.00	0.13
10/17/11 9:00 AM	0.12	0.00	0.13
10/17/11 11:00 AM	0.11	0.00	0.13
10/17/11 1:00 PM	0.11	0.00	0.14
10/17/11 3:00 PM	0.10	0.00	0.14
10/17/11 5:00 PM	0.10	0.00	0.14
10/17/11 7:00 PM	0.10	0.00	0.13
10/17/11 9:00 PM	0.11	0.00	0.12
10/17/11 11:00 PM	0.10	0.00	0.09
10/18/11 1:00 AM	0.10	0.00	0.09
10/18/11 3:00 AM	0.10	0.00	0.08
10/18/11 5:00 AM	0.10	0.00	0.08

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
10/18/11 7:00 AM	0.10	0.00	0.08
10/18/11 9:00 AM	0.10	0.00	0.12
10/18/11 11:00 AM	0.10	0.00	0.30
10/18/11 1:00 PM	0.10	0.00	0.24
10/18/11 3:00 PM	0.11	0.00	0.18
10/18/11 5:00 PM	0.10	0.00	0.18
10/18/11 7:00 PM	0.11	0.00	0.16
10/18/11 9:00 PM	0.11	0.00	0.14
10/18/11 11:00 PM	0.09	0.00	0.13
10/19/11 1:00 AM	0.06	0.00	0.15
10/19/11 3:00 AM	0.07	0.00	0.13
10/19/11 5:00 AM	0.07	0.00	0.12
10/19/11 7:00 AM	0.07	0.00	0.12
10/19/11 9:00 AM	0.07	0.00	0.15
10/19/11 11:00 AM	0.07	0.00	0.15
10/19/11 1:00 PM	0.08	0.00	0.13
10/19/11 3:00 PM	0.08	0.00	0.11
10/19/11 5:00 PM	0.08	0.00	0.11
10/19/11 7:00 PM	0.09	0.00	0.10
10/19/11 9:00 PM	0.10	0.00	0.11
10/19/11 11:00 PM	0.08	0.00	0.11
10/20/11 1:00 AM	0.07	0.00	0.11
10/20/11 3:00 AM	0.07	0.00	0.11
10/20/11 5:00 AM	0.09	0.00	0.10
10/20/11 7:00 AM	0.10	0.00	0.10
10/20/11 9:00 AM	0.10	0.00	0.11
10/20/11 11:00 AM	0.10	0.00	0.11
10/20/11 1:00 PM	0.09	0.00	0.12
10/20/11 3:00 PM	0.09	0.00	0.13
10/20/11 5:00 PM	0.09	0.00	0.12
10/20/11 7:00 PM	0.09	0.00	0.13
10/20/11 9:00 PM	0.10	0.00	0.14
10/20/11 11:00 PM	0.10	0.00	0.13
10/21/11 1:00 AM	0.08	0.00	0.13
10/21/11 3:00 AM	0.09	0.00	0.13
10/21/11 5:00 AM	0.10	0.00	0.14
10/21/11 7:00 AM	0.12	0.00	0.10
10/21/11 9:00 AM	0.12	0.00	0.01
10/21/11 11:00 AM	0.12	0.00	0.00
10/21/11 1:00 PM	0.13	0.00	0.00
10/21/11 3:00 PM	0.12	0.00	0.00
10/21/11 5:00 PM	0.12	0.00	0.00
10/21/11 7:00 PM	0.12	0.00	0.00
10/21/11 9:00 PM	0.13	0.00	0.00
10/21/11 11:00 PM	0.13	0.00	0.00
10/22/11 1:00 AM	0.13	0.00	0.00
10/22/11 3:00 AM	0.13	0.00	0.00
10/22/11 5:00 AM	0.12	0.00	0.00
10/22/11 7:00 AM	0.11	0.00	0.00
10/22/11 9:00 AM	0.12	0.00	0.00
10/22/11 11:00 AM	0.13	0.00	0.00
10/22/11 1:00 PM	0.14	0.00	0.00
10/22/11 3:00 PM	0.15	0.00	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
10/22/11 5:00 PM	0.14	0.00	0.00
10/22/11 7:00 PM	0.14	0.00	0.00
10/22/11 9:00 PM	0.14	0.00	0.00
10/22/11 11:00 PM	0.14	0.00	0.00
10/23/11 1:00 AM	0.14	0.00	0.00
10/23/11 3:00 AM	0.14	0.00	0.00
10/23/11 5:00 AM	0.13	0.00	0.00
10/23/11 7:00 AM	0.13	0.00	0.00
10/23/11 9:00 AM	0.13	0.00	0.00
10/23/11 11:00 AM	0.14	0.00	0.00
10/23/11 1:00 PM	0.15	0.00	0.00
10/23/11 3:00 PM	0.14	0.00	0.00
10/23/11 5:00 PM	0.15	0.00	0.00
10/23/11 7:00 PM	0.15	0.00	0.00
10/23/11 9:00 PM	0.17	0.00	0.00
10/23/11 11:00 PM	0.14	0.00	0.00
10/24/11 1:00 AM	0.13	0.00	0.00
10/24/11 3:00 AM	0.14	0.00	0.00
10/24/11 5:00 AM	0.18	0.00	0.00
10/24/11 7:00 AM	0.21	0.00	0.00
10/24/11 9:00 AM	0.22	0.00	0.00
10/24/11 11:00 AM	0.22	0.00	0.00
10/24/11 1:00 PM	0.23	0.00	0.00
10/24/11 3:00 PM	0.23	0.00	0.00
10/24/11 5:00 PM	0.22	0.00	0.00
10/24/11 7:00 PM	0.22	0.00	0.00
10/24/11 9:00 PM	0.23	0.00	0.00
10/24/11 11:00 PM	0.24	0.00	0.00
10/25/11 1:00 AM	0.23	0.00	0.00
10/25/11 3:00 AM	0.23	0.00	0.00
10/25/11 5:00 AM	0.23	0.00	0.00
10/25/11 7:00 AM	0.23	0.00	0.00
10/25/11 9:00 AM	0.24	0.00	0.00
10/25/11 11:00 AM	0.25	0.00	0.00
10/25/11 1:00 PM	0.23	0.00	0.00
10/25/11 3:00 PM	0.21	0.00	0.00
10/25/11 5:00 PM	0.21	0.00	0.00
10/25/11 7:00 PM	0.21	0.00	0.00
10/25/11 9:00 PM	0.22	0.00	0.00
10/25/11 11:00 PM	0.22	0.00	0.00
10/26/11 1:00 AM	0.23	0.00	0.00
10/26/11 3:00 AM	0.23	0.00	0.00
10/26/11 5:00 AM	0.23	0.00	0.00
10/26/11 7:00 AM	0.25	0.00	0.00
10/26/11 9:00 AM	0.25	0.00	0.00
10/26/11 11:00 AM	0.24	0.00	0.00
10/26/11 1:00 PM	0.22	0.00	0.00
10/26/11 3:00 PM	0.23	0.00	0.00
10/26/11 5:00 PM	0.24	0.00	0.00
10/26/11 7:00 PM	0.27	0.00	0.00
10/26/11 9:00 PM	0.28	0.00	0.00
10/26/11 11:00 PM	0.27	0.00	0.00
10/27/11 1:00 AM	0.26	0.00	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
10/27/11 3:00 AM	0.23	0.00	0.00
10/27/11 5:00 AM	0.21	0.00	0.00
10/27/11 7:00 AM	0.20	0.00	0.00
10/27/11 9:00 AM	0.26	0.00	0.00
10/27/11 11:00 AM	0.24	0.00	0.00
10/27/11 1:00 PM	0.23	0.00	0.00
10/27/11 3:00 PM	0.22	0.00	0.00
10/27/11 5:00 PM	0.20	0.00	0.00
10/27/11 7:00 PM	0.19	0.00	0.00
10/27/11 9:00 PM	0.21	0.00	0.00
10/27/11 11:00 PM	0.21	0.00	0.00
10/28/11 1:00 AM	0.19	0.00	0.00
10/28/11 3:00 AM	0.20	0.00	0.00
10/28/11 5:00 AM	0.22	0.00	0.00
10/28/11 7:00 AM	0.24	0.00	0.00
10/28/11 9:00 AM	0.22	0.00	0.00
10/28/11 11:00 AM	0.19	0.00	0.00
10/28/11 1:00 PM	0.20	0.00	0.00
10/28/11 3:00 PM	0.20	0.00	0.00
10/28/11 5:00 PM	0.17	0.00	0.00
10/28/11 7:00 PM	0.18	0.00	0.00
10/28/11 9:00 PM	0.21	0.00	0.00
10/28/11 11:00 PM	0.20	0.00	0.00
10/29/11 1:00 AM	0.41	0.00	0.00
10/29/11 3:00 AM	2.46	0.00	0.00
10/29/11 5:00 AM	0.00	0.00	0.00
10/29/11 7:00 AM	0.00	0.00	0.00
10/29/11 9:00 AM	0.00	0.00	0.00
10/29/11 11:00 AM	0.16	0.00	0.00
10/29/11 1:00 PM	0.17	0.00	0.00
10/29/11 3:00 PM	0.14	0.00	0.00
10/29/11 5:00 PM	0.15	0.00	0.00
10/29/11 7:00 PM	0.16	0.00	0.00
10/29/11 9:00 PM	0.19	0.00	0.00
10/29/11 11:00 PM	0.20	0.00	0.00
10/30/11 1:00 AM	0.19	0.00	0.00
10/30/11 3:00 AM	0.20	0.00	0.00
10/30/11 5:00 AM	0.20	0.00	0.00
10/30/11 7:00 AM	0.19	0.00	0.00
10/30/11 9:00 AM	0.20	0.00	0.00
10/30/11 11:00 AM	0.19	0.00	0.00
10/30/11 1:00 PM	0.19	0.00	0.00
10/30/11 3:00 PM	0.19	0.00	0.00
10/30/11 5:00 PM	0.21	0.00	0.00
10/30/11 7:00 PM	0.23	0.00	0.00
10/30/11 9:00 PM	0.23	0.00	0.00
10/30/11 11:00 PM	0.24	0.00	0.00
10/31/11 1:00 AM	0.23	0.00	0.00
10/31/11 3:00 AM	0.25	0.00	0.00
10/31/11 5:00 AM	0.24	0.00	0.00
10/31/11 7:00 AM	0.23	0.00	0.00
10/31/11 9:00 AM	0.25	0.00	0.00
10/31/11 11:00 AM	0.24	0.00	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
10/31/11 1:00 PM	0.25	0.00	0.00
10/31/11 3:00 PM	0.27	0.00	0.00
10/31/11 5:00 PM	0.27	0.00	0.00
10/31/11 7:00 PM	0.23	0.00	0.00
10/31/11 9:00 PM	0.23	0.00	0.00
10/31/11 11:00 PM	0.22	0.00	0.00
11/1/11 1:00 AM	0.21	0.00	0.00
11/1/11 3:00 AM	0.19	0.00	0.00
11/1/11 5:00 AM	0.18	0.00	0.00
11/1/11 7:00 AM	0.17	0.00	0.00
11/1/11 9:00 AM	0.17	0.00	0.00
11/1/11 11:00 AM	0.17	0.00	0.00
11/1/11 1:00 PM	0.18	0.00	0.00
11/1/11 3:00 PM	0.18	0.00	0.00
11/1/11 5:00 PM	0.18	0.00	0.00
11/1/11 7:00 PM	0.16	0.00	0.00
11/1/11 9:00 PM	0.15	0.00	0.00
11/1/11 11:00 PM	0.17	0.00	0.00
11/2/11 1:00 AM	0.17	0.00	0.00
11/2/11 3:00 AM	0.17	0.00	0.00
11/2/11 5:00 AM	0.17	0.00	0.00
11/2/11 7:00 AM	0.18	0.00	0.00
11/2/11 9:00 AM	0.20	0.00	0.00
11/2/11 11:00 AM	0.19	0.00	0.00
11/2/11 1:00 PM	0.17	0.00	0.00
11/2/11 3:00 PM	0.15	0.00	0.00
11/2/11 5:00 PM	0.16	0.00	0.00
11/2/11 7:00 PM	0.17	0.00	0.00
11/2/11 9:00 PM	0.17	0.00	0.00
11/2/11 11:00 PM	0.17	0.00	0.00
11/3/11 1:00 AM	0.17	0.00	0.00
11/3/11 3:00 AM	0.17	0.00	0.00
11/3/11 5:00 AM	0.17	0.00	0.00
11/3/11 7:00 AM	0.17	0.00	0.00
11/3/11 9:00 AM	0.19	0.00	0.00
11/3/11 11:00 AM	0.18	0.00	0.00
11/3/11 1:00 PM	0.18	0.00	0.00
11/3/11 3:00 PM	0.18	0.00	0.00
11/3/11 5:00 PM	0.17	0.00	0.00
11/3/11 7:00 PM	0.17	0.00	0.00
11/3/11 9:00 PM	0.17	0.00	0.00
11/3/11 11:00 PM	0.19	0.00	0.00
11/4/11 1:00 AM	0.19	0.00	0.00
11/4/11 3:00 AM	0.18	0.00	0.00
11/4/11 5:00 AM	0.18	0.00	0.00
11/4/11 7:00 AM	0.19	0.00	0.00
11/4/11 9:00 AM	0.21	0.00	0.00
11/4/11 11:00 AM	0.21	0.00	0.00
11/4/11 1:00 PM	0.20	0.00	0.00
11/4/11 3:00 PM	0.21	0.00	0.00
11/4/11 5:00 PM	0.21	0.00	0.00
11/4/11 7:00 PM	0.21	0.00	0.00
11/4/11 9:00 PM	0.22	0.00	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
11/4/11 11:00 PM	0.21	0.00	0.00
11/5/11 1:00 AM	0.22	0.00	0.00
11/5/11 3:00 AM	0.19	0.00	0.00
11/5/11 5:00 AM	0.21	0.00	0.00
11/5/11 7:00 AM	0.22	0.00	0.00
11/5/11 9:00 AM	0.22	0.00	0.00
11/5/11 11:00 AM	0.22	0.00	0.00
11/5/11 1:00 PM	0.23	0.00	0.00
11/5/11 3:00 PM	0.24	0.00	0.00
11/5/11 5:00 PM	0.24	0.00	0.00
11/5/11 7:00 PM	0.24	0.00	0.00
11/5/11 9:00 PM	0.23	0.00	0.00
11/5/11 11:00 PM	0.24	0.00	0.00
11/6/11 1:00 AM	0.24	0.00	0.00
11/6/11 3:00 AM	0.24	0.00	0.00
11/6/11 5:00 AM	0.24	0.00	0.00
11/6/11 7:00 AM	0.23	0.00	0.00
11/6/11 9:00 AM	0.25	0.00	0.00
11/6/11 11:00 AM	0.25	0.00	0.00
11/6/11 1:00 PM	0.25	0.00	0.00
11/6/11 3:00 PM	0.26	0.00	0.00
11/6/11 5:00 PM	0.27	0.00	0.00
11/6/11 7:00 PM	0.34	0.00	0.00
11/6/11 9:00 PM	0.28	0.00	0.00
11/6/11 11:00 PM	0.29	0.00	0.00
11/7/11 1:00 AM	0.27	0.00	0.00
11/7/11 3:00 AM	0.25	0.00	0.00
11/7/11 5:00 AM	0.25	0.00	0.00
11/7/11 7:00 AM	0.27	0.00	0.00
11/7/11 9:00 AM	0.28	0.00	0.00
11/7/11 11:00 AM	0.30	0.00	0.00
11/7/11 1:00 PM	0.29	0.00	0.00
11/7/11 3:00 PM	0.33	0.00	0.00
11/7/11 5:00 PM	0.28	0.00	0.00
11/7/11 7:00 PM	0.25	0.00	0.00
11/7/11 9:00 PM	0.20	0.00	0.00
11/7/11 11:00 PM	0.09	0.00	0.00
11/8/11 1:00 AM	0.00	0.00	0.00
11/8/11 3:00 AM	0.00	0.00	0.00
11/8/11 5:00 AM	0.00	0.00	0.00
11/8/11 7:00 AM	0.00	0.00	0.00
11/8/11 9:00 AM	0.00	0.00	0.00
11/8/11 11:00 AM	0.00	0.00	0.00
11/8/11 1:00 PM	0.00	0.00	0.00
11/8/11 3:00 PM	0.00	0.00	0.00
11/8/11 5:00 PM	0.00	0.00	0.00
11/8/11 7:00 PM	0.00	0.00	0.02
11/8/11 9:00 PM	0.00	0.00	0.13
11/8/11 11:00 PM	0.00	0.00	0.28
11/9/11 1:00 AM	0.00	0.00	0.37
11/9/11 3:00 AM	0.00	0.00	0.16
11/9/11 5:00 AM	0.00	0.00	0.16
11/9/11 7:00 AM	0.00	0.00	0.04

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
11/9/11 9:00 AM	0.00	0.00	0.00
11/9/11 11:00 AM	0.00	0.00	0.00
11/9/11 1:00 PM	0.00	0.00	0.00
11/9/11 3:00 PM	0.00	0.00	0.00
11/9/11 5:00 PM	0.00	0.00	0.00
11/9/11 7:00 PM	0.00	0.00	0.00
11/9/11 9:00 PM	0.00	0.00	0.04
11/9/11 11:00 PM	0.00	0.00	0.09
11/10/11 1:00 AM	0.00	0.00	0.12
11/10/11 3:00 AM	0.00	0.00	0.10
11/10/11 5:00 AM	0.00	0.00	0.19
11/10/11 7:00 AM	0.00	0.00	0.16
11/10/11 9:00 AM	0.00	0.00	0.17
11/10/11 11:00 AM	0.00	0.00	0.18
11/10/11 1:00 PM	0.00	0.00	0.19
11/10/11 3:00 PM	0.00	0.00	0.16
11/10/11 5:00 PM	0.00	0.00	0.16
11/10/11 7:00 PM	0.06	0.00	0.17
11/10/11 9:00 PM	0.18	0.00	0.17
11/10/11 11:00 PM	0.23	0.00	0.17
11/11/11 1:00 AM	0.22	0.00	0.16
11/11/11 3:00 AM	0.22	0.00	0.14
11/11/11 5:00 AM	0.23	0.00	0.16
11/11/11 7:00 AM	0.23	0.00	0.18
11/11/11 9:00 AM	0.22	0.00	0.14
11/11/11 11:00 AM	0.22	0.00	0.12
11/11/11 1:00 PM	0.20	0.00	0.09
11/11/11 3:00 PM	0.20	0.00	0.08
11/11/11 5:00 PM	0.21	0.00	0.08
11/11/11 7:00 PM	0.20	0.00	0.07
11/11/11 9:00 PM	0.17	0.00	0.07
11/11/11 11:00 PM	0.16	0.00	0.05
11/12/11 1:00 AM	0.16	0.00	0.04
11/12/11 3:00 AM	0.16	0.00	0.04
11/12/11 5:00 AM	0.15	0.00	0.04
11/12/11 7:00 AM	0.16	0.00	0.05
11/12/11 9:00 AM	0.16	0.00	0.05
11/12/11 11:00 AM	0.15	0.00	0.05
11/12/11 1:00 PM	0.14	0.00	0.05
11/12/11 3:00 PM	0.18	0.00	0.05
11/12/11 5:00 PM	0.19	0.00	0.05
11/12/11 7:00 PM	0.18	0.00	0.05
11/12/11 9:00 PM	0.18	0.00	0.05
11/12/11 11:00 PM	0.18	0.00	0.06
11/13/11 1:00 AM	0.19	0.00	0.06
11/13/11 3:00 AM	0.19	0.00	0.06
11/13/11 5:00 AM	0.21	0.00	0.07
11/13/11 7:00 AM	0.21	0.00	0.08
11/13/11 9:00 AM	0.20	0.00	0.08
11/13/11 11:00 AM	0.22	0.00	0.08
11/13/11 1:00 PM	0.21	0.00	0.09
11/13/11 3:00 PM	0.18	0.00	0.09
11/13/11 5:00 PM	0.21	0.00	0.10

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
11/13/11 7:00 PM	0.22	0.00	0.10
11/13/11 9:00 PM	0.23	0.00	0.10
11/13/11 11:00 PM	0.23	0.00	0.11
11/14/11 1:00 AM	0.21	0.00	0.09
11/14/11 3:00 AM	0.20	0.00	0.09
11/14/11 5:00 AM	0.23	0.00	0.10
11/14/11 7:00 AM	0.23	0.00	0.11
11/14/11 9:00 AM	0.25	0.00	0.10
11/14/11 11:00 AM	0.25	0.00	0.09
11/14/11 1:00 PM	0.25	0.00	0.09
11/14/11 3:00 PM	0.25	0.00	0.08
11/14/11 5:00 PM	0.23	0.00	0.08
11/14/11 7:00 PM	0.27	0.00	0.08
11/14/11 9:00 PM	0.28	0.00	0.08
11/14/11 11:00 PM	0.24	0.00	0.07
11/15/11 1:00 AM	0.21	0.00	0.08
11/15/11 3:00 AM	0.21	0.00	0.08
11/15/11 5:00 AM	0.23	0.00	0.08
11/15/11 7:00 AM	0.25	0.00	0.07
11/15/11 9:00 AM	0.25	0.00	0.08
11/15/11 11:00 AM	0.25	0.00	0.08
11/15/11 1:00 PM	0.25	0.00	0.08
11/15/11 3:00 PM	0.29	0.00	0.08
11/15/11 5:00 PM	0.27	0.00	0.08
11/15/11 7:00 PM	0.26	0.00	0.08
11/15/11 9:00 PM	0.26	0.00	0.08
11/15/11 11:00 PM	0.28	0.00	0.08
11/16/11 1:00 AM	0.26	0.00	0.08
11/16/11 3:00 AM	0.22	0.00	0.08
11/16/11 5:00 AM	0.30	0.00	0.08
11/16/11 7:00 AM	0.34	0.00	0.08
11/16/11 9:00 AM	0.32	0.00	0.08
11/16/11 11:00 AM	0.31	0.00	0.07
11/16/11 1:00 PM	0.33	0.00	0.08
11/16/11 3:00 PM	0.38	0.00	0.08
11/16/11 5:00 PM	0.32	0.00	0.08
11/16/11 7:00 PM	0.28	0.00	0.08
11/16/11 9:00 PM	0.27	0.00	0.08
11/16/11 11:00 PM	0.23	0.00	0.06
11/17/11 1:00 AM	0.25	0.00	0.05
11/17/11 3:00 AM	0.25	0.00	0.05
11/17/11 5:00 AM	0.22	0.00	0.05
11/17/11 7:00 AM	0.24	0.00	0.05
11/17/11 9:00 AM	0.24	0.00	0.08
11/17/11 11:00 AM	0.23	0.00	0.09
11/17/11 1:00 PM	0.22	0.00	0.08
11/17/11 3:00 PM	0.22	0.00	0.07
11/17/11 5:00 PM	0.21	0.00	0.07
11/17/11 7:00 PM	0.19	0.00	0.07
11/17/11 9:00 PM	0.20	0.00	0.07
11/17/11 11:00 PM	0.19	0.00	0.07
11/18/11 1:00 AM	0.18	0.00	0.06
11/18/11 3:00 AM	0.18	0.00	0.05

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
11/18/11 5:00 AM	0.18	0.00	0.05
11/18/11 7:00 AM	0.18	0.00	0.08
11/18/11 9:00 AM	0.19	0.00	0.08
11/18/11 11:00 AM	0.19	0.00	0.08
11/18/11 1:00 PM	0.18	0.00	0.08
11/18/11 3:00 PM	0.17	0.00	0.07
11/18/11 5:00 PM	0.16	0.00	0.07
11/18/11 7:00 PM	0.15	0.00	0.07
11/18/11 9:00 PM	0.14	0.00	0.07
11/18/11 11:00 PM	0.14	0.00	0.07
11/19/11 1:00 AM	0.14	0.00	0.07
11/19/11 3:00 AM	0.14	0.00	0.07
11/19/11 5:00 AM	0.13	0.00	0.08
11/19/11 7:00 AM	0.13	0.00	0.08
11/19/11 9:00 AM	0.12	0.00	0.08
11/19/11 11:00 AM	0.12	0.00	0.08
11/19/11 1:00 PM	0.12	0.00	0.08
11/19/11 3:00 PM	0.11	0.00	0.09
11/19/11 5:00 PM	0.11	0.00	0.09
11/19/11 7:00 PM	0.11	0.00	0.09
11/19/11 9:00 PM	0.11	0.00	0.09
11/19/11 11:00 PM	0.10	0.00	0.07
11/20/11 1:00 AM	0.10	0.00	0.08
11/20/11 3:00 AM	0.10	0.00	0.08
11/20/11 5:00 AM	0.09	0.00	0.07
11/20/11 7:00 AM	0.10	0.00	0.07
11/20/11 9:00 AM	0.11	0.00	0.09
11/20/11 11:00 AM	0.11	0.00	0.09
11/20/11 1:00 PM	0.10	0.00	0.10
11/20/11 3:00 PM	0.10	0.00	0.09
11/20/11 5:00 PM	0.10	0.00	0.10
11/20/11 7:00 PM	0.10	0.00	0.10
11/20/11 9:00 PM	0.10	0.00	0.10
11/20/11 11:00 PM	0.10	0.00	0.10
11/21/11 1:00 AM	0.09	0.00	0.10
11/21/11 3:00 AM	0.09	0.00	0.10
11/21/11 5:00 AM	0.10	0.00	0.10
11/21/11 7:00 AM	0.10	0.00	0.10
11/21/11 9:00 AM	0.10	0.00	0.10
11/21/11 11:00 AM	0.10	0.00	0.10
11/21/11 1:00 PM	0.10	0.00	0.09
11/21/11 3:00 PM	0.10	0.00	0.02
11/21/11 5:00 PM	0.11	0.00	0.10
11/21/11 7:00 PM	0.11	0.00	0.13
11/21/11 9:00 PM	0.11	0.00	0.12
11/21/11 11:00 PM	0.10	0.00	0.13
11/22/11 1:00 AM	0.11	0.00	0.13
11/22/11 3:00 AM	0.10	0.00	0.12
11/22/11 5:00 AM	0.10	0.00	0.13
11/22/11 7:00 AM	0.11	0.00	0.13
11/22/11 9:00 AM	0.11	0.00	0.12
11/22/11 11:00 AM	0.11	0.00	0.12
11/22/11 1:00 PM	0.11	0.00	0.12

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
11/22/11 3:00 PM	0.11	0.00	0.12
11/22/11 5:00 PM	0.11	0.00	0.12
11/22/11 7:00 PM	0.11	0.00	0.12
11/22/11 9:00 PM	0.11	0.00	0.11
11/22/11 11:00 PM	0.11	0.00	0.11
11/23/11 1:00 AM	0.10	0.00	0.11
11/23/11 3:00 AM	0.07	0.00	0.11
11/23/11 5:00 AM	0.08	0.00	0.11
11/23/11 7:00 AM	0.08	0.00	0.12
11/23/11 9:00 AM	0.11	0.00	0.13
11/23/11 11:00 AM	0.11	0.00	0.13
11/23/11 1:00 PM	0.11	0.00	0.12
11/23/11 3:00 PM	0.10	0.00	0.12
11/23/11 5:00 PM	0.10	0.00	0.12
11/23/11 7:00 PM	0.10	0.00	0.11
11/23/11 9:00 PM	0.11	0.00	0.11
11/23/11 11:00 PM	0.10	0.00	0.13
11/24/11 1:00 AM	0.09	0.00	0.13
11/24/11 3:00 AM	0.08	0.00	0.05
11/24/11 5:00 AM	0.08	0.00	0.06
11/24/11 7:00 AM	0.09	0.00	0.06
11/24/11 9:00 AM	0.09	0.00	0.07
11/24/11 11:00 AM	0.10	0.00	0.13
11/24/11 1:00 PM	0.10	0.00	0.13
11/24/11 3:00 PM	0.09	0.00	0.12
11/24/11 5:00 PM	0.10	0.00	0.10
11/24/11 7:00 PM	0.09	0.00	0.09
11/24/11 9:00 PM	0.10	0.00	0.09
11/24/11 11:00 PM	0.10	0.00	0.09
11/25/11 1:00 AM	0.09	0.00	0.07
11/25/11 3:00 AM	0.10	0.00	0.07
11/25/11 5:00 AM	0.10	0.00	0.08
11/25/11 7:00 AM	0.10	0.00	0.08
11/25/11 9:00 AM	0.10	0.00	0.14
11/25/11 11:00 AM	0.10	0.00	0.17
11/25/11 1:00 PM	0.09	0.00	0.15
11/25/11 3:00 PM	0.08	0.00	0.15
11/25/11 5:00 PM	0.09	0.00	0.14
11/25/11 7:00 PM	0.09	0.00	0.14
11/25/11 9:00 PM	0.09	0.00	0.14
11/25/11 11:00 PM	0.09	0.00	0.14
11/26/11 1:00 AM	0.09	0.00	0.08
11/26/11 3:00 AM	0.09	0.00	0.08
11/26/11 5:00 AM	0.09	0.00	0.08
11/26/11 7:00 AM	0.10	0.00	0.11
11/26/11 9:00 AM	0.11	0.00	0.17
11/26/11 11:00 AM	0.10	0.00	0.17
11/26/11 1:00 PM	0.10	0.00	0.18
11/26/11 3:00 PM	0.10	0.00	0.18
11/26/11 5:00 PM	0.11	0.00	0.18
11/26/11 7:00 PM	0.11	0.00	0.18
11/26/11 9:00 PM	0.11	0.00	0.18
11/26/11 11:00 PM	0.11	0.00	0.17

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
11/27/11 1:00 AM	0.11	0.00	0.17
11/27/11 3:00 AM	0.10	0.00	0.16
11/27/11 5:00 AM	0.11	0.00	0.16
11/27/11 7:00 AM	0.11	0.00	0.12
11/27/11 9:00 AM	0.11	0.00	0.13
11/27/11 11:00 AM	0.11	0.00	0.15
11/27/11 1:00 PM	0.10	0.00	0.17
11/27/11 3:00 PM	0.09	0.00	0.17
11/27/11 5:00 PM	0.08	0.00	0.17
11/27/11 7:00 PM	0.10	0.00	0.17
11/27/11 9:00 PM	0.10	0.00	0.17
11/27/11 11:00 PM	0.10	0.00	0.18
11/28/11 1:00 AM	0.10	0.00	0.13
11/28/11 3:00 AM	0.09	0.00	0.11
11/28/11 5:00 AM	0.09	0.00	0.12
11/28/11 7:00 AM	0.11	0.00	0.18
11/28/11 9:00 AM	0.11	0.00	0.12
11/28/11 11:00 AM	0.11	0.00	0.08
11/28/11 1:00 PM	0.11	0.00	0.08
11/28/11 3:00 PM	0.11	0.00	0.09
11/28/11 5:00 PM	0.09	0.00	0.09
11/28/11 7:00 PM	0.08	0.00	0.09
11/28/11 9:00 PM	0.08	0.00	0.09
11/28/11 11:00 PM	0.08	0.00	0.09
11/29/11 1:00 AM	0.08	0.00	0.08
11/29/11 3:00 AM	0.08	0.00	0.06
11/29/11 5:00 AM	0.08	0.00	0.07
11/29/11 7:00 AM	0.09	0.00	0.10
11/29/11 9:00 AM	0.10	0.00	0.09
11/29/11 11:00 AM	0.10	0.00	0.11
11/29/11 1:00 PM	0.10	0.00	0.11
11/29/11 3:00 PM	0.10	0.00	0.10
11/29/11 5:00 PM	0.09	0.00	0.11
11/29/11 7:00 PM	0.09	0.00	0.10
11/29/11 9:00 PM	0.10	0.00	0.11
11/29/11 11:00 PM	0.10	0.00	0.12
11/30/11 1:00 AM	0.10	0.00	0.13
11/30/11 3:00 AM	0.11	0.00	0.13
11/30/11 5:00 AM	0.10	0.00	0.14
11/30/11 7:00 AM	0.10	0.00	0.12
11/30/11 9:00 AM	0.10	0.00	0.12
11/30/11 11:00 AM	0.09	0.00	0.12
11/30/11 1:00 PM	0.09	0.00	0.12
11/30/11 3:00 PM	0.09	0.00	0.13
11/30/11 5:00 PM	0.09	0.00	0.13
11/30/11 7:00 PM	0.10	0.00	0.13
11/30/11 9:00 PM	0.09	0.00	0.13
11/30/11 11:00 PM	0.10	0.00	0.13
12/1/11 1:00 AM	0.11	0.00	0.13
12/1/11 3:00 AM	0.10	0.00	0.14
12/1/11 5:00 AM	0.10	0.00	0.14
12/1/11 7:00 AM	0.10	0.00	0.14
12/1/11 9:00 AM	0.10	0.00	0.14

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
12/1/11 11:00 AM	0.09	0.00	0.12
12/1/11 1:00 PM	0.08	0.00	0.00
12/1/11 3:00 PM	0.09	0.00	0.00
12/1/11 5:00 PM	0.09	0.00	0.00
12/1/11 7:00 PM	0.09	0.00	0.00
12/1/11 9:00 PM	0.09	0.00	0.00
12/1/11 11:00 PM	0.09	0.00	0.00
12/2/11 1:00 AM	0.10	0.00	0.00
12/2/11 3:00 AM	0.09	0.00	0.00
12/2/11 5:00 AM	0.08	0.08	0.00
12/2/11 7:00 AM	0.08	0.08	0.00
12/2/11 9:00 AM	0.08	0.08	0.00
12/2/11 11:00 AM	0.09	0.00	0.00
12/2/11 1:00 PM	0.09	0.00	0.00
12/2/11 3:00 PM	0.09	0.00	0.00
12/2/11 5:00 PM	0.09	0.00	0.00
12/2/11 7:00 PM	0.09	0.00	0.00
12/2/11 9:00 PM	0.08	0.00	0.00
12/2/11 11:00 PM	0.08	0.00	0.02
12/3/11 1:00 AM	0.08	0.00	0.02
12/3/11 3:00 AM	0.09	0.00	0.05
12/3/11 5:00 AM	0.08	0.00	0.06
12/3/11 7:00 AM	0.08	0.00	0.09
12/3/11 9:00 AM	0.10	0.00	0.10
12/3/11 11:00 AM	0.10	0.00	0.13
12/3/11 1:00 PM	0.12	0.00	0.18
12/3/11 3:00 PM	0.14	0.00	0.28
12/3/11 5:00 PM	0.15	0.15	0.27
12/3/11 7:00 PM	0.18	0.18	0.22
12/3/11 9:00 PM	0.16	0.16	0.18
12/3/11 11:00 PM	0.09	0.09	0.16
12/4/11 1:00 AM	0.08	0.08	0.15
12/4/11 3:00 AM	0.08	0.08	0.09
12/4/11 5:00 AM	0.08	0.08	0.09
12/4/11 7:00 AM	0.08	0.08	0.12
12/4/11 9:00 AM	0.08	0.08	0.12
12/4/11 11:00 AM	0.10	0.10	0.11
12/4/11 1:00 PM	0.18	0.18	0.10
12/4/11 3:00 PM	0.20	0.20	0.10
12/4/11 5:00 PM	0.17	0.17	0.09
12/4/11 7:00 PM	0.19	0.19	0.09
12/4/11 9:00 PM	0.17	0.17	0.09
12/4/11 11:00 PM	0.10	0.10	0.09
12/5/11 1:00 AM	0.08	0.08	0.08
12/5/11 3:00 AM	0.08	0.08	0.06
12/5/11 5:00 AM	0.10	0.10	0.06
12/5/11 7:00 AM	0.19	0.19	0.08
12/5/11 9:00 AM	0.16	0.16	0.08
12/5/11 11:00 AM	0.21	0.21	0.09
12/5/11 1:00 PM	0.22	0.22	0.10
12/5/11 3:00 PM	0.21	0.21	0.10
12/5/11 5:00 PM	0.22	0.22	0.10
12/5/11 7:00 PM	0.17	0.17	0.09

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
12/5/11 9:00 PM	0.21	0.21	0.09
12/5/11 11:00 PM	0.15	0.15	0.09
12/6/11 1:00 AM	0.11	0.11	0.06
12/6/11 3:00 AM	0.10	0.10	0.06
12/6/11 5:00 AM	0.10	0.10	0.06
12/6/11 7:00 AM	0.17	0.17	0.09
12/6/11 9:00 AM	0.17	0.17	0.09
12/6/11 11:00 AM	0.14	0.14	0.08
12/6/11 1:00 PM	0.10	0.10	0.09
12/6/11 3:00 PM	0.17	0.17	0.07
12/6/11 5:00 PM	0.18	0.18	0.08
12/6/11 7:00 PM	0.18	0.18	0.07
12/6/11 9:00 PM	0.20	0.20	0.07
12/6/11 11:00 PM	0.20	0.20	0.08
12/7/11 1:00 AM	0.15	0.15	0.08
12/7/11 3:00 AM	0.09	0.09	0.08
12/7/11 5:00 AM	0.12	0.12	0.08
12/7/11 7:00 AM	0.19	0.19	0.08
12/7/11 9:00 AM	0.18	0.18	0.07
12/7/11 11:00 AM	0.20	0.20	0.08
12/7/11 1:00 PM	0.17	0.17	0.10
12/7/11 3:00 PM	0.20	0.20	0.10
12/7/11 5:00 PM	0.18	0.18	0.09
12/7/11 7:00 PM	0.16	0.16	0.10
12/7/11 9:00 PM	0.14	0.14	0.09
12/7/11 11:00 PM	0.17	0.17	0.09
12/8/11 1:00 AM	0.12	0.12	0.08
12/8/11 3:00 AM	0.13	0.13	0.08
12/8/11 5:00 AM	0.16	0.16	0.08
12/8/11 7:00 AM	0.17	0.17	0.08
12/8/11 9:00 AM	0.14	0.14	0.07
12/8/11 11:00 AM	0.15	0.15	0.07
12/8/11 1:00 PM	0.14	0.14	0.07
12/8/11 3:00 PM	0.12	0.12	0.07
12/8/11 5:00 PM	0.13	0.13	0.08
12/8/11 7:00 PM	0.13	0.13	0.07
12/8/11 9:00 PM	0.12	0.12	0.07
12/8/11 11:00 PM	0.13	0.13	0.08
12/9/11 1:00 AM	0.13	0.13	0.08
12/9/11 3:00 AM	0.12	0.12	0.07
12/9/11 5:00 AM	0.12	0.12	0.08
12/9/11 7:00 AM	0.14	0.14	0.09
12/9/11 9:00 AM	0.14	0.14	0.08
12/9/11 11:00 AM	0.14	0.14	0.11
12/9/11 1:00 PM	0.14	0.14	0.10
12/9/11 3:00 PM	0.15	0.15	0.10
12/9/11 5:00 PM	0.15	0.15	0.10
12/9/11 7:00 PM	0.18	0.18	0.10
12/9/11 9:00 PM	0.20	0.20	0.10
12/9/11 11:00 PM	0.22	0.22	0.10
12/10/11 1:00 AM	0.17	0.17	0.07
12/10/11 3:00 AM	0.15	0.15	0.06
12/10/11 5:00 AM	0.14	0.14	0.06

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
12/10/11 7:00 AM	0.16	0.16	0.09
12/10/11 9:00 AM	0.17	0.17	0.11
12/10/11 11:00 AM	0.19	0.19	0.12
12/10/11 1:00 PM	0.20	0.20	0.13
12/10/11 3:00 PM	0.18	0.18	0.13
12/10/11 5:00 PM	0.18	0.18	0.11
12/10/11 7:00 PM	0.17	0.17	0.11
12/10/11 9:00 PM	0.17	0.17	0.11
12/10/11 11:00 PM	0.18	0.18	0.10
12/11/11 1:00 AM	0.18	0.18	0.07
12/11/11 3:00 AM	0.16	0.16	0.07
12/11/11 5:00 AM	0.16	0.16	0.08
12/11/11 7:00 AM	0.18	0.18	0.11
12/11/11 9:00 AM	0.19	0.19	0.14
12/11/11 11:00 AM	0.20	0.20	0.13
12/11/11 1:00 PM	0.18	0.18	0.09
12/11/11 3:00 PM	0.16	0.16	0.09
12/11/11 5:00 PM	0.17	0.17	0.13
12/11/11 7:00 PM	0.17	0.17	0.14
12/11/11 9:00 PM	0.18	0.18	0.13
12/11/11 11:00 PM	0.17	0.17	0.11
12/12/11 1:00 AM	0.16	0.16	0.03
12/12/11 3:00 AM	0.16	0.16	0.04
12/12/11 5:00 AM	0.15	0.15	0.04
12/12/11 7:00 AM	0.17	0.17	0.06
12/12/11 9:00 AM	0.18	0.18	0.13
12/12/11 11:00 AM	0.18	0.18	0.20
12/12/11 1:00 PM	0.15	0.15	0.19
12/12/11 3:00 PM	0.15	0.15	0.14
12/12/11 5:00 PM	0.18	0.18	0.12
12/12/11 7:00 PM	0.18	0.18	0.12
12/12/11 9:00 PM	0.19	0.19	0.07
12/12/11 11:00 PM	0.18	0.18	0.00
12/13/11 1:00 AM	0.14	0.14	0.00
12/13/11 3:00 AM	0.13	0.13	0.00
12/13/11 5:00 AM	0.14	0.14	0.00
12/13/11 7:00 AM	0.16	0.16	0.00
12/13/11 9:00 AM	0.17	0.17	0.00
12/13/11 11:00 AM	0.19	0.19	0.00
12/13/11 1:00 PM	0.21	0.21	0.00
12/13/11 3:00 PM	0.21	0.21	0.00
12/13/11 5:00 PM	0.21	0.21	0.00
12/13/11 7:00 PM	0.20	0.20	0.00
12/13/11 9:00 PM	0.19	0.19	0.00
12/13/11 11:00 PM	0.20	0.20	0.00
12/14/11 1:00 AM	0.17	0.17	0.00
12/14/11 3:00 AM	0.16	0.16	0.00
12/14/11 5:00 AM	0.19	0.19	0.00
12/14/11 7:00 AM	0.19	0.19	0.00
12/14/11 9:00 AM	0.21	0.21	0.00
12/14/11 11:00 AM	0.22	0.22	0.00
12/14/11 1:00 PM	0.20	0.20	0.00
12/14/11 3:00 PM	0.17	0.17	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
12/14/11 5:00 PM	0.16	0.16	0.00
12/14/11 7:00 PM	0.15	0.15	0.00
12/14/11 9:00 PM	0.16	0.16	0.00
12/14/11 11:00 PM	0.17	0.17	0.00
12/15/11 1:00 AM	0.17	0.17	0.00
12/15/11 3:00 AM	0.16	0.16	0.00
12/15/11 5:00 AM	0.17	0.17	0.00
12/15/11 7:00 AM	0.21	0.21	0.00
12/15/11 9:00 AM	0.20	0.20	0.00
12/15/11 11:00 AM	0.20	0.20	0.00
12/15/11 1:00 PM	0.18	0.18	0.00
12/15/11 3:00 PM	0.16	0.16	0.00
12/15/11 5:00 PM	0.14	0.14	0.00
12/15/11 7:00 PM	0.15	0.15	0.00
12/15/11 9:00 PM	0.17	0.17	0.00
12/15/11 11:00 PM	0.23	0.23	0.00
12/16/11 1:00 AM	0.23	0.23	0.00
12/16/11 3:00 AM	0.18	0.18	0.00
12/16/11 5:00 AM	0.19	0.19	0.00
12/16/11 7:00 AM	0.22	0.22	0.02
12/16/11 9:00 AM	0.21	0.21	0.13
12/16/11 11:00 AM	0.19	0.19	0.19
12/16/11 1:00 PM	0.20	0.20	0.25
12/16/11 3:00 PM	0.22	0.22	0.41
12/16/11 5:00 PM	0.21	0.21	0.31
12/16/11 7:00 PM	0.20	0.20	0.25
12/16/11 9:00 PM	0.21	0.21	0.24
12/16/11 11:00 PM	0.20	0.20	0.23
12/17/11 1:00 AM	0.19	0.19	0.14
12/17/11 3:00 AM	0.18	0.18	0.13
12/17/11 5:00 AM	0.17	0.17	0.18
12/17/11 7:00 AM	0.21	0.21	0.22
12/17/11 9:00 AM	0.21	0.21	0.29
12/17/11 11:00 AM	0.20	0.20	0.25
12/17/11 1:00 PM	0.18	0.18	0.22
12/17/11 3:00 PM	0.19	0.19	0.22
12/17/11 5:00 PM	0.20	0.20	0.23
12/17/11 7:00 PM	0.19	0.19	0.24
12/17/11 9:00 PM	0.17	0.17	0.20
12/17/11 11:00 PM	0.17	0.17	0.13
12/18/11 1:00 AM	0.17	0.17	0.14
12/18/11 3:00 AM	0.18	0.18	0.14
12/18/11 5:00 AM	0.18	0.18	0.13
12/18/11 7:00 AM	0.22	0.22	0.14
12/18/11 9:00 AM	0.20	0.20	0.16
12/18/11 11:00 AM	0.19	0.19	0.16
12/18/11 1:00 PM	0.17	0.17	0.16
12/18/11 3:00 PM	0.18	0.18	0.16
12/18/11 5:00 PM	0.21	0.21	0.15
12/18/11 7:00 PM	0.22	0.22	0.14
12/18/11 9:00 PM	0.21	0.21	0.15
12/18/11 11:00 PM	0.21	0.21	0.16
12/19/11 1:00 AM	0.19	0.19	0.16

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
12/19/11 3:00 AM	0.21	0.21	0.16
12/19/11 5:00 AM	0.22	0.22	0.16
12/19/11 7:00 AM	0.24	0.24	0.16
12/19/11 9:00 AM	0.19	0.19	0.13
12/19/11 11:00 AM	0.20	0.20	0.10
12/19/11 1:00 PM	0.20	0.20	0.10
12/19/11 3:00 PM	0.20	0.20	0.09
12/19/11 5:00 PM	0.18	0.18	0.07
12/19/11 7:00 PM	0.20	0.20	0.06
12/19/11 9:00 PM	0.20	0.20	0.06
12/19/11 11:00 PM	0.18	0.18	0.05
12/20/11 1:00 AM	0.15	0.15	0.04
12/20/11 3:00 AM	0.12	0.12	0.04
12/20/11 5:00 AM	0.14	0.14	0.04
12/20/11 7:00 AM	0.23	0.23	0.09
12/20/11 9:00 AM	0.21	0.21	0.11
12/20/11 11:00 AM	0.21	0.21	0.11
12/20/11 1:00 PM	0.20	0.20	0.11
12/20/11 3:00 PM	0.21	0.21	0.10
12/20/11 5:00 PM	0.21	0.21	0.10
12/20/11 7:00 PM	0.21	0.21	0.10
12/20/11 9:00 PM	0.20	0.20	0.02
12/20/11 11:00 PM	0.19	0.19	0.00
12/21/11 1:00 AM	0.16	0.16	0.00
12/21/11 3:00 AM	0.15	0.15	0.00
12/21/11 5:00 AM	0.14	0.14	0.00
12/21/11 7:00 AM	0.18	0.18	0.00
12/21/11 9:00 AM	0.20	0.20	0.00
12/21/11 11:00 AM	0.18	0.18	0.00
12/21/11 1:00 PM	0.18	0.18	0.00
12/21/11 3:00 PM	0.17	0.17	0.00
12/21/11 5:00 PM	0.19	0.19	0.00
12/21/11 7:00 PM	0.20	0.20	0.00
12/21/11 9:00 PM	0.21	0.21	0.00
12/21/11 11:00 PM	0.19	0.19	0.00
12/22/11 1:00 AM	0.18	0.18	0.00
12/22/11 3:00 AM	0.17	0.17	0.00
12/22/11 5:00 AM	0.16	0.16	0.00
12/22/11 7:00 AM	0.19	0.19	0.00
12/22/11 9:00 AM	0.15	0.15	0.00
12/22/11 11:00 AM	0.17	0.17	0.00
12/22/11 1:00 PM	0.13	0.13	0.00
12/22/11 3:00 PM	0.13	0.13	0.00
12/22/11 5:00 PM	0.13	0.13	0.00
12/22/11 7:00 PM	0.14	0.14	0.00
12/22/11 9:00 PM	0.16	0.16	0.00
12/22/11 11:00 PM	0.15	0.15	0.00
12/23/11 1:00 AM	0.14	0.14	0.00
12/23/11 3:00 AM	0.14	0.14	0.00
12/23/11 5:00 AM	0.14	0.14	0.00
12/23/11 7:00 AM	0.15	0.15	0.00
12/23/11 9:00 AM	0.16	0.16	0.00
12/23/11 11:00 AM	0.14	0.14	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
12/23/11 1:00 PM	0.13	0.13	0.00
12/23/11 3:00 PM	0.14	0.14	0.00
12/23/11 5:00 PM	0.14	0.14	0.00
12/23/11 7:00 PM	0.15	0.15	0.00
12/23/11 9:00 PM	0.15	0.15	0.00
12/23/11 11:00 PM	0.14	0.14	0.00
12/24/11 1:00 AM	0.15	0.15	0.00
12/24/11 3:00 AM	0.15	0.15	0.00
12/24/11 5:00 AM	0.15	0.15	0.00
12/24/11 7:00 AM	0.16	0.16	0.00
12/24/11 9:00 AM	0.16	0.16	0.00
12/24/11 11:00 AM	0.16	0.16	0.00
12/24/11 1:00 PM	0.14	0.14	0.00
12/24/11 3:00 PM	0.15	0.15	0.00
12/24/11 5:00 PM	0.16	0.16	0.00
12/24/11 7:00 PM	0.15	0.15	0.00
12/24/11 9:00 PM	0.15	0.15	0.00
12/24/11 11:00 PM	0.14	0.14	0.00
12/25/11 1:00 AM	0.13	0.13	0.00
12/25/11 3:00 AM	0.16	0.16	0.00
12/25/11 5:00 AM	0.17	0.17	0.00
12/25/11 7:00 AM	0.16	0.16	0.00
12/25/11 9:00 AM	0.16	0.16	0.00
12/25/11 11:00 AM	0.15	0.15	0.00
12/25/11 1:00 PM	0.14	0.14	0.00
12/25/11 3:00 PM	0.15	0.15	0.00
12/25/11 5:00 PM	0.15	0.15	0.00
12/25/11 7:00 PM	0.15	0.15	0.00
12/25/11 9:00 PM	0.16	0.16	0.00
12/25/11 11:00 PM	0.17	0.17	0.00
12/26/11 1:00 AM	0.14	0.14	0.00
12/26/11 3:00 AM	0.15	0.15	0.00
12/26/11 5:00 AM	0.15	0.15	0.00
12/26/11 7:00 AM	0.17	0.17	0.00
12/26/11 9:00 AM	0.16	0.16	0.00
12/26/11 11:00 AM	0.16	0.16	0.00
12/26/11 1:00 PM	0.16	0.16	0.00
12/26/11 3:00 PM	0.16	0.16	0.00
12/26/11 5:00 PM	0.18	0.18	0.00
12/26/11 7:00 PM	0.17	0.17	0.00
12/26/11 9:00 PM	0.17	0.17	0.00
12/26/11 11:00 PM	0.16	0.16	0.00
12/27/11 1:00 AM	0.14	0.14	0.00
12/27/11 3:00 AM	0.13	0.13	0.00
12/27/11 5:00 AM	0.14	0.14	0.00
12/27/11 7:00 AM	0.14	0.14	0.00
12/27/11 9:00 AM	0.15	0.15	0.00
12/27/11 11:00 AM	0.15	0.15	0.00
12/27/11 1:00 PM	0.15	0.15	0.00
12/27/11 3:00 PM	0.15	0.15	0.00
12/27/11 5:00 PM	0.16	0.16	0.00
12/27/11 7:00 PM	0.14	0.14	0.00
12/27/11 9:00 PM	0.12	0.12	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
12/27/11 11:00 PM	0.11	0.11	0.00
12/28/11 1:00 AM	0.09	0.00	0.00
12/28/11 3:00 AM	0.08	0.00	0.00
12/28/11 5:00 AM	0.11	0.00	0.00
12/28/11 7:00 AM	0.13	0.00	0.04
12/28/11 9:00 AM	0.14	0.00	0.34
12/28/11 11:00 AM	0.12	0.00	0.27
12/28/11 1:00 PM	0.11	0.00	0.25
12/28/11 3:00 PM	0.12	0.00	0.22
12/28/11 5:00 PM	0.12	0.00	0.32
12/28/11 7:00 PM	0.11	0.00	0.33
12/28/11 9:00 PM	0.11	0.00	0.22
12/28/11 11:00 PM	0.10	0.00	0.16
12/29/11 1:00 AM	0.06	0.00	0.14
12/29/11 3:00 AM	0.08	0.00	0.12
12/29/11 5:00 AM	0.11	0.00	0.11
12/29/11 7:00 AM	0.12	0.00	0.09
12/29/11 9:00 AM	0.11	0.00	0.10
12/29/11 11:00 AM	0.11	0.00	0.10
12/29/11 1:00 PM	0.11	0.00	0.08
12/29/11 3:00 PM	0.11	0.00	0.08
12/29/11 5:00 PM	0.12	0.00	0.06
12/29/11 7:00 PM	0.12	0.00	0.08
12/29/11 9:00 PM	0.11	0.00	0.06
12/29/11 11:00 PM	0.10	0.00	0.08
12/30/11 1:00 AM	0.10	0.00	0.06
12/30/11 3:00 AM	0.09	0.00	0.06
12/30/11 5:00 AM	0.10	0.00	0.06
12/30/11 7:00 AM	0.10	0.00	0.08
12/30/11 9:00 AM	0.08	0.00	0.08
12/30/11 11:00 AM	0.09	0.00	0.08
12/30/11 1:00 PM	0.09	0.00	0.11
12/30/11 3:00 PM	0.09	0.00	0.07
12/30/11 5:00 PM	0.09	0.00	0.07
12/30/11 7:00 PM	0.10	0.00	0.06
12/30/11 9:00 PM	0.11	0.00	0.06
12/30/11 11:00 PM	0.11	0.00	0.04
12/31/11 1:00 AM	0.10	0.00	0.05
12/31/11 3:00 AM	0.09	0.00	0.03
12/31/11 5:00 AM	0.09	0.00	0.03
12/31/11 7:00 AM	0.10	0.00	0.03
12/31/11 9:00 AM	0.11	0.00	0.05
12/31/11 11:00 AM	0.10	0.00	0.05
12/31/11 1:00 PM	0.10	0.00	0.05
12/31/11 3:00 PM	0.10	0.00	0.05
12/31/11 5:00 PM	0.10	0.00	0.05
12/31/11 7:00 PM	0.10	0.10	0.06
12/31/11 9:00 PM	0.10	0.10	0.05
12/31/11 11:00 PM	0.10	0.10	0.02
1/1/12 1:00 AM	0.10	0.00	0.02
1/1/12 3:00 AM	0.09	0.00	0.02
1/1/12 5:00 AM	0.09	0.00	0.02
1/1/12 7:00 AM	0.09	0.00	0.02

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
1/1/12 9:00 AM	0.09	0.09	0.03
1/1/12 11:00 AM	0.10	0.10	0.03
1/1/12 1:00 PM	0.10	0.10	0.03
1/1/12 3:00 PM	0.11	0.11	0.03
1/1/12 5:00 PM	0.11	0.11	0.04
1/1/12 7:00 PM	0.20	0.20	0.11
1/1/12 9:00 PM	0.21	0.21	0.08
1/1/12 11:00 PM	0.16	0.16	0.06
1/2/12 1:00 AM	0.11	0.11	0.04
1/2/12 3:00 AM	0.08	0.08	0.05
1/2/12 5:00 AM	0.09	0.09	0.05
1/2/12 7:00 AM	0.10	0.10	0.08
1/2/12 9:00 AM	0.10	0.10	0.08
1/2/12 11:00 AM	0.12	0.12	0.09
1/2/12 1:00 PM	0.16	0.16	0.08
1/2/12 3:00 PM	0.15	0.15	0.08
1/2/12 5:00 PM	0.16	0.16	0.09
1/2/12 7:00 PM	0.20	0.20	0.10
1/2/12 9:00 PM	0.22	0.22	0.07
1/2/12 11:00 PM	0.19	0.19	0.11
1/3/12 1:00 AM	0.11	0.11	0.07
1/3/12 3:00 AM	0.11	0.11	0.04
1/3/12 5:00 AM	0.11	0.11	0.07
1/3/12 7:00 AM	0.21	0.21	0.14
1/3/12 9:00 AM	0.20	0.20	0.14
1/3/12 11:00 AM	0.18	0.18	0.10
1/3/12 1:00 PM	0.23	0.23	0.09
1/3/12 3:00 PM	0.13	0.13	0.08
1/3/12 5:00 PM	0.12	0.12	0.07
1/3/12 7:00 PM	0.19	0.19	0.08
1/3/12 9:00 PM	0.22	0.22	0.08
1/3/12 11:00 PM	0.18	0.18	0.07
1/4/12 1:00 AM	0.11	0.11	0.07
1/4/12 3:00 AM	0.11	0.11	0.08
1/4/12 5:00 AM	0.11	0.11	0.07
1/4/12 7:00 AM	0.15	0.15	0.06
1/4/12 9:00 AM	0.19	0.19	0.06
1/4/12 11:00 AM	0.22	0.22	0.06
1/4/12 1:00 PM	0.20	0.20	0.05
1/4/12 3:00 PM	0.11	0.11	0.04
1/4/12 5:00 PM	0.11	0.11	0.04
1/4/12 7:00 PM	0.11	0.11	0.06
1/4/12 9:00 PM	0.10	0.10	0.06
1/4/12 11:00 PM	0.08	0.08	0.06
1/5/12 1:00 AM	0.08	0.08	0.06
1/5/12 3:00 AM	0.08	0.08	0.06
1/5/12 5:00 AM	0.11	0.11	0.06
1/5/12 7:00 AM	0.08	0.08	0.06
1/5/12 9:00 AM	0.00	0.09	0.06
1/5/12 11:00 AM	0.00	0.06	0.05
1/5/12 1:00 PM	0.00	0.07	0.06
1/5/12 3:00 PM	0.00	0.07	0.05
1/5/12 5:00 PM	0.00	0.07	0.05

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
1/5/12 7:00 PM	0.00	0.07	0.05
1/5/12 9:00 PM	0.00	0.07	0.05
1/5/12 11:00 PM	0.00	0.08	0.05
1/6/12 1:00 AM	0.00	0.10	0.05
1/6/12 3:00 AM	0.00	0.10	0.05
1/6/12 5:00 AM	0.00	0.09	0.05
1/6/12 7:00 AM	0.00	0.10	0.06
1/6/12 9:00 AM	0.00	0.10	0.06
1/6/12 11:00 AM	0.00	0.10	0.05
1/6/12 1:00 PM	0.00	0.09	0.06
1/6/12 3:00 PM	0.00	0.10	0.06
1/6/12 5:00 PM	0.00	0.09	0.05
1/6/12 7:00 PM	0.00	0.09	0.06
1/6/12 9:00 PM	0.00	0.10	0.05
1/6/12 11:00 PM	0.00	0.09	0.00
1/7/12 1:00 AM	0.00	0.09	0.00
1/7/12 3:00 AM	0.00	0.10	0.00
1/7/12 5:00 AM	0.00	0.09	0.00
1/7/12 7:00 AM	0.00	0.10	0.00
1/7/12 9:00 AM	0.00	0.10	0.00
1/7/12 11:00 AM	0.00	0.10	0.00
1/7/12 1:00 PM	0.00	0.11	0.00
1/7/12 3:00 PM	0.00	0.10	0.00
1/7/12 5:00 PM	0.00	0.10	0.00
1/7/12 7:00 PM	0.00	0.10	0.00
1/7/12 9:00 PM	0.00	0.10	0.00
1/7/12 11:00 PM	0.00	0.10	0.00
1/8/12 1:00 AM	0.00	0.10	0.00
1/8/12 3:00 AM	0.00	0.10	0.00
1/8/12 5:00 AM	0.00	0.10	0.00
1/8/12 7:00 AM	0.00	0.10	0.00
1/8/12 9:00 AM	0.00	0.10	0.00
1/8/12 11:00 AM	0.00	0.10	0.00
1/8/12 1:00 PM	0.00	0.10	0.00
1/8/12 3:00 PM	0.00	0.10	0.00
1/8/12 5:00 PM	0.00	0.10	0.00
1/8/12 7:00 PM	0.00	0.10	0.00
1/8/12 9:00 PM	0.00	0.10	0.00
1/8/12 11:00 PM	0.00	0.10	0.00
1/9/12 1:00 AM	0.00	0.11	0.00
1/9/12 3:00 AM	0.00	0.10	0.00
1/9/12 5:00 AM	0.00	0.10	0.00
1/9/12 7:00 AM	0.00	0.10	0.00
1/9/12 9:00 AM	0.00	0.10	0.00
1/9/12 11:00 AM	0.00	0.10	0.00
1/9/12 1:00 PM	0.00	0.10	0.00
1/9/12 3:00 PM	0.00	0.10	0.00
1/9/12 5:00 PM	0.00	0.10	0.00
1/9/12 7:00 PM	0.00	0.10	0.00
1/9/12 9:00 PM	0.00	0.10	0.00
1/9/12 11:00 PM	0.00	0.09	0.00
1/10/12 1:00 AM	0.00	0.06	0.00
1/10/12 3:00 AM	0.00	0.06	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
1/10/12 5:00 AM	0.00	0.06	0.00
1/10/12 7:00 AM	0.00	0.10	0.00
1/10/12 9:00 AM	0.00	0.09	0.00
1/10/12 11:00 AM	0.00	0.09	0.00
1/10/12 1:00 PM	0.00	0.10	0.00
1/10/12 3:00 PM	0.00	0.10	0.00
1/10/12 5:00 PM	0.00	0.09	0.00
1/10/12 7:00 PM	0.00	0.09	0.00
1/10/12 9:00 PM	0.00	0.09	0.00
1/10/12 11:00 PM	0.00	0.07	0.00
1/11/12 1:00 AM	0.00	0.07	0.00
1/11/12 3:00 AM	0.00	0.07	0.00
1/11/12 5:00 AM	0.00	0.07	0.00
1/11/12 7:00 AM	0.00	0.10	0.00
1/11/12 9:00 AM	0.00	0.10	0.00
1/11/12 11:00 AM	0.00	0.10	0.00
1/11/12 1:00 PM	0.00	0.11	0.00
1/11/12 3:00 PM	0.00	0.11	0.00
1/11/12 5:00 PM	0.00	0.11	0.00
1/11/12 7:00 PM	0.00	0.12	0.00
1/11/12 9:00 PM	0.00	0.12	0.00
1/11/12 11:00 PM	0.00	0.13	0.00
1/12/12 1:00 AM	0.00	0.13	0.00
1/12/12 3:00 AM	0.00	0.14	0.00
1/12/12 5:00 AM	0.00	0.14	0.00
1/12/12 7:00 AM	0.00	0.15	0.00
1/12/12 9:00 AM	0.00	0.15	0.00
1/12/12 11:00 AM	0.00	0.15	0.00
1/12/12 1:00 PM	0.00	0.14	0.03
1/12/12 3:00 PM	0.00	0.14	0.00
1/12/12 5:00 PM	0.00	0.14	0.17
1/12/12 7:00 PM	0.00	0.13	0.17
1/12/12 9:00 PM	0.00	0.15	0.13
1/12/12 11:00 PM	0.00	0.16	0.13
1/13/12 1:00 AM	0.00	0.05	0.13
1/13/12 3:00 AM	0.00	0.05	0.13
1/13/12 5:00 AM	0.00	0.06	0.13
1/13/12 7:00 AM	0.00	0.06	0.09
1/13/12 9:00 AM	0.00	0.15	0.09
1/13/12 11:00 AM	0.00	0.12	0.09
1/13/12 1:00 PM	0.00	0.13	0.09
1/13/12 3:00 PM	0.00	0.14	0.09
1/13/12 5:00 PM	0.00	0.14	0.09
1/13/12 7:00 PM	0.00	0.15	0.09
1/13/12 9:00 PM	0.00	0.15	0.08
1/13/12 11:00 PM	0.00	0.16	0.08
1/14/12 1:00 AM	0.00	0.17	0.08
1/14/12 3:00 AM	0.00	0.15	0.06
1/14/12 5:00 AM	0.00	0.15	0.06
1/14/12 7:00 AM	0.00	0.17	0.08
1/14/12 9:00 AM	0.00	0.20	0.10
1/14/12 11:00 AM	0.19	0.19	0.10
1/14/12 1:00 PM	0.20	0.20	0.10

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
1/14/12 3:00 PM	0.23	0.23	0.09
1/14/12 5:00 PM	0.29	0.29	0.09
1/14/12 7:00 PM	0.28	0.28	0.09
1/14/12 9:00 PM	0.26	0.26	0.10
1/14/12 11:00 PM	0.23	0.23	0.10
1/15/12 1:00 AM	0.18	0.18	0.10
1/15/12 3:00 AM	0.16	0.16	0.10
1/15/12 5:00 AM	0.17	0.17	0.09
1/15/12 7:00 AM	0.09	0.09	0.09
1/15/12 9:00 AM	0.09	0.09	0.09
1/15/12 11:00 AM	0.08	0.08	0.10
1/15/12 1:00 PM	0.08	0.08	0.10
1/15/12 3:00 PM	0.08	0.08	0.10
1/15/12 5:00 PM	0.08	0.08	0.09
1/15/12 7:00 PM	0.08	0.08	0.10
1/15/12 9:00 PM	0.12	0.12	0.10
1/15/12 11:00 PM	0.16	0.16	0.10
1/16/12 1:00 AM	0.14	0.14	0.09
1/16/12 3:00 AM	0.15	0.15	0.09
1/16/12 5:00 AM	0.18	0.18	0.09
1/16/12 7:00 AM	0.20	0.20	0.09
1/16/12 9:00 AM	0.08	0.08	0.10
1/16/12 11:00 AM	0.09	0.09	0.09
1/16/12 1:00 PM	0.09	0.09	0.10
1/16/12 3:00 PM	0.21	0.21	0.11
1/16/12 5:00 PM	0.25	0.25	0.11
1/16/12 7:00 PM	0.24	0.24	0.11
1/16/12 9:00 PM	0.10	0.10	0.11
1/16/12 11:00 PM	0.14	0.14	0.11
1/17/12 1:00 AM	0.18	0.18	0.08
1/17/12 3:00 AM	0.19	0.19	0.08
1/17/12 5:00 AM	0.24	0.24	0.11
1/17/12 7:00 AM	0.28	0.28	0.12
1/17/12 9:00 AM	0.23	0.23	0.07
1/17/12 11:00 AM	0.24	0.24	0.11
1/17/12 1:00 PM	0.23	0.23	0.13
1/17/12 3:00 PM	0.18	0.18	0.13
1/17/12 5:00 PM	0.08	0.08	0.13
1/17/12 7:00 PM	0.08	0.08	0.13
1/17/12 9:00 PM	0.08	0.08	0.14
1/17/12 11:00 PM	0.17	0.17	0.15
1/18/12 1:00 AM	0.14	0.14	0.10
1/18/12 3:00 AM	0.15	0.15	0.10
1/18/12 5:00 AM	0.19	0.19	0.13
1/18/12 7:00 AM	0.26	0.26	0.19
1/18/12 9:00 AM	0.27	0.27	0.18
1/18/12 11:00 AM	0.27	0.27	0.18
1/18/12 1:00 PM	0.15	0.15	0.17
1/18/12 3:00 PM	0.26	0.26	0.16
1/18/12 5:00 PM	0.14	0.14	0.00
1/18/12 7:00 PM	0.10	0.10	0.00
1/18/12 9:00 PM	0.09	0.09	0.15
1/18/12 11:00 PM	0.18	0.18	0.16

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
1/19/12 1:00 AM	0.15	0.15	0.15
1/19/12 3:00 AM	0.14	0.14	0.15
1/19/12 5:00 AM	0.20	0.20	0.14
1/19/12 7:00 AM	0.18	0.18	0.14
1/19/12 9:00 AM	0.18	0.18	0.14
1/19/12 11:00 AM	0.08	0.08	0.14
1/19/12 1:00 PM	0.07	0.07	0.14
1/19/12 3:00 PM	0.15	0.15	0.14
1/19/12 5:00 PM	0.08	0.08	0.14
1/19/12 7:00 PM	0.08	0.08	0.14
1/19/12 9:00 PM	0.08	0.08	0.13
1/19/12 11:00 PM	0.11	0.11	0.14
1/20/12 1:00 AM	0.13	0.13	0.14
1/20/12 3:00 AM	0.14	0.14	0.13
1/20/12 5:00 AM	0.15	0.15	0.13
1/20/12 7:00 AM	0.21	0.21	0.13
1/20/12 9:00 AM	0.22	0.22	0.13
1/20/12 11:00 AM	0.21	0.21	0.12
1/20/12 1:00 PM	0.09	0.09	0.11
1/20/12 3:00 PM	0.08	0.08	0.11
1/20/12 5:00 PM	0.09	0.09	0.11
1/20/12 7:00 PM	0.10	0.10	0.11
1/20/12 9:00 PM	0.10	0.10	0.11
1/20/12 11:00 PM	0.15	0.15	0.10
1/21/12 1:00 AM	0.18	0.18	0.07
1/21/12 3:00 AM	0.17	0.17	0.07
1/21/12 5:00 AM	0.18	0.18	0.09
1/21/12 7:00 AM	0.21	0.21	0.14
1/21/12 9:00 AM	0.19	0.19	0.14
1/21/12 11:00 AM	0.27	0.27	0.15
1/21/12 1:00 PM	0.26	0.26	0.14
1/21/12 3:00 PM	0.26	0.26	0.14
1/21/12 5:00 PM	0.24	0.24	0.13
1/21/12 7:00 PM	0.26	0.26	0.13
1/21/12 9:00 PM	0.25	0.25	0.07
1/21/12 11:00 PM	0.27	0.27	0.04
1/22/12 1:00 AM	0.24	0.24	0.04
1/22/12 3:00 AM	0.22	0.22	0.04
1/22/12 5:00 AM	0.26	0.26	0.05
1/22/12 7:00 AM	0.24	0.24	0.10
1/22/12 9:00 AM	0.26	0.26	0.10
1/22/12 11:00 AM	0.25	0.25	0.10
1/22/12 1:00 PM	0.26	0.26	0.10
1/22/12 3:00 PM	0.26	0.26	0.11
1/22/12 5:00 PM	0.24	0.24	0.15
1/22/12 7:00 PM	0.25	0.25	0.14
1/22/12 9:00 PM	0.27	0.27	0.14
1/22/12 11:00 PM	0.26	0.26	0.13
1/23/12 1:00 AM	0.24	0.24	0.13
1/23/12 3:00 AM	0.16	0.16	0.12
1/23/12 5:00 AM	0.18	0.18	0.11
1/23/12 7:00 AM	0.13	0.13	0.12
1/23/12 9:00 AM	0.24	0.24	0.12

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
1/23/12 11:00 AM	0.15	0.15	0.13
1/23/12 1:00 PM	0.20	0.20	0.12
1/23/12 3:00 PM	0.21	0.21	0.12
1/23/12 5:00 PM	0.22	0.22	0.11
1/23/12 7:00 PM	0.23	0.23	0.11
1/23/12 9:00 PM	0.22	0.22	0.10
1/23/12 11:00 PM	0.21	0.21	0.10
1/24/12 1:00 AM	0.23	0.23	0.10
1/24/12 3:00 AM	0.18	0.18	0.07
1/24/12 5:00 AM	0.21	0.21	0.08
1/24/12 7:00 AM	0.21	0.21	0.10
1/24/12 9:00 AM	0.20	0.20	0.07
1/24/12 11:00 AM	0.17	0.17	0.10
1/24/12 1:00 PM	0.06	0.06	0.10
1/24/12 3:00 PM	0.06	0.06	0.10
1/24/12 5:00 PM	0.10	0.10	0.08
1/24/12 7:00 PM	0.22	0.22	0.09
1/24/12 9:00 PM	0.22	0.22	0.08
1/24/12 11:00 PM	0.14	0.14	0.07
1/25/12 1:00 AM	0.11	0.11	0.07
1/25/12 3:00 AM	0.10	0.10	0.06
1/25/12 5:00 AM	0.10	0.10	0.06
1/25/12 7:00 AM	0.14	0.14	0.07
1/25/12 9:00 AM	0.19	0.19	0.07
1/25/12 11:00 AM	0.20	0.20	0.08
1/25/12 1:00 PM	0.21	0.21	0.08
1/25/12 3:00 PM	0.20	0.20	0.06
1/25/12 5:00 PM	0.19	0.19	0.06
1/25/12 7:00 PM	0.18	0.18	0.07
1/25/12 9:00 PM	0.19	0.19	0.06
1/25/12 11:00 PM	0.12	0.12	0.06
1/26/12 1:00 AM	0.11	0.11	0.06
1/26/12 3:00 AM	0.14	0.14	0.06
1/26/12 5:00 AM	0.14	0.14	0.06
1/26/12 7:00 AM	0.13	0.13	0.09
1/26/12 9:00 AM	0.05	0.05	0.06
1/26/12 11:00 AM	0.05	0.05	0.11
1/26/12 1:00 PM	0.05	0.05	0.11
1/26/12 3:00 PM	0.07	0.07	0.10
1/26/12 5:00 PM	0.20	0.20	0.10
1/26/12 7:00 PM	0.22	0.22	0.09
1/26/12 9:00 PM	0.21	0.21	0.09
1/26/12 11:00 PM	0.15	0.15	0.08
1/27/12 1:00 AM	0.11	0.11	0.05
1/27/12 3:00 AM	0.10	0.10	0.06
1/27/12 5:00 AM	0.10	0.10	0.07
1/27/12 7:00 AM	0.14	0.14	0.09
1/27/12 9:00 AM	0.19	0.19	0.09
1/27/12 11:00 AM	0.18	0.18	0.11
1/27/12 1:00 PM	0.18	0.18	0.11
1/27/12 3:00 PM	0.19	0.19	0.10
1/27/12 5:00 PM	0.26	0.26	0.10
1/27/12 7:00 PM	0.25	0.25	0.09

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
1/27/12 9:00 PM	0.23	0.23	0.09
1/27/12 11:00 PM	0.22	0.22	0.07
1/28/12 1:00 AM	0.10	0.10	0.05
1/28/12 3:00 AM	0.06	0.06	0.05
1/28/12 5:00 AM	0.05	0.05	0.05
1/28/12 7:00 AM	0.06	0.06	0.07
1/28/12 9:00 AM	0.06	0.06	0.09
1/28/12 11:00 AM	0.10	0.10	0.10
1/28/12 1:00 PM	0.21	0.21	0.09
1/28/12 3:00 PM	0.20	0.20	0.08
1/28/12 5:00 PM	0.18	0.18	0.08
1/28/12 7:00 PM	0.17	0.17	0.08
1/28/12 9:00 PM	0.05	0.05	0.08
1/28/12 11:00 PM	0.16	0.16	0.08
1/29/12 1:00 AM	0.10	0.10	0.05
1/29/12 3:00 AM	0.11	0.11	0.04
1/29/12 5:00 AM	0.09	0.09	0.05
1/29/12 7:00 AM	0.13	0.13	0.05
1/29/12 9:00 AM	0.17	0.17	0.11
1/29/12 11:00 AM	0.16	0.16	0.11
1/29/12 1:00 PM	0.15	0.15	0.11
1/29/12 3:00 PM	0.15	0.15	0.11
1/29/12 5:00 PM	0.15	0.15	0.10
1/29/12 7:00 PM	0.16	0.16	0.10
1/29/12 9:00 PM	0.18	0.18	0.09
1/29/12 11:00 PM	0.17	0.17	0.07
1/30/12 1:00 AM	0.13	0.13	0.05
1/30/12 3:00 AM	0.15	0.15	0.05
1/30/12 5:00 AM	0.14	0.14	0.08
1/30/12 7:00 AM	0.17	0.17	0.10
1/30/12 9:00 AM	0.17	0.17	0.09
1/30/12 11:00 AM	0.16	0.16	0.09
1/30/12 1:00 PM	0.16	0.16	0.09
1/30/12 3:00 PM	0.15	0.15	0.09
1/30/12 5:00 PM	0.15	0.15	0.09
1/30/12 7:00 PM	0.12	0.12	0.08
1/30/12 9:00 PM	0.19	0.19	0.08
1/30/12 11:00 PM	0.13	0.13	0.07
1/31/12 1:00 AM	0.10	0.10	0.05
1/31/12 3:00 AM	0.10	0.10	0.05
1/31/12 5:00 AM	0.18	0.18	0.05
1/31/12 7:00 AM	0.22	0.22	0.08
1/31/12 9:00 AM	0.21	0.21	0.08
1/31/12 11:00 AM	0.22	0.22	0.08
1/31/12 1:00 PM	0.14	0.14	0.06
1/31/12 3:00 PM	0.04	0.04	0.09
1/31/12 5:00 PM	0.05	0.05	0.09
1/31/12 7:00 PM	0.17	0.17	0.09
1/31/12 9:00 PM	0.16	0.16	0.09
1/31/12 11:00 PM	0.14	0.14	0.07
2/1/12 1:00 AM	0.09	0.09	0.03
2/1/12 3:00 AM	0.08	0.08	0.03
2/1/12 5:00 AM	0.08	0.08	0.03

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
2/1/12 7:00 AM	0.08	0.08	0.03
2/1/12 9:00 AM	0.12	0.12	0.03
2/1/12 11:00 AM	0.09	0.09	0.03
2/1/12 1:00 PM	0.08	0.08	0.05
2/1/12 3:00 PM	0.10	0.10	0.06
2/1/12 5:00 PM	0.11	0.11	0.13
2/1/12 7:00 PM	0.14	0.14	0.12
2/1/12 9:00 PM	0.12	0.12	0.10
2/1/12 11:00 PM	0.08	0.08	0.05
2/2/12 1:00 AM	0.10	0.10	0.05
2/2/12 3:00 AM	0.10	0.10	0.05
2/2/12 5:00 AM	0.13	0.13	0.05
2/2/12 7:00 AM	0.20	0.20	0.10
2/2/12 9:00 AM	0.21	0.21	0.11
2/2/12 11:00 AM	0.21	0.21	0.11
2/2/12 1:00 PM	0.20	0.20	0.10
2/2/12 3:00 PM	0.20	0.20	0.10
2/2/12 5:00 PM	0.20	0.20	0.10
2/2/12 7:00 PM	0.21	0.21	0.09
2/2/12 9:00 PM	0.21	0.21	0.09
2/2/12 11:00 PM	0.22	0.22	0.05
2/3/12 1:00 AM	0.18	0.18	0.03
2/3/12 3:00 AM	0.13	0.13	0.04
2/3/12 5:00 AM	0.16	0.16	0.04
2/3/12 7:00 AM	0.23	0.23	0.05
2/3/12 9:00 AM	0.23	0.23	0.11
2/3/12 11:00 AM	0.21	0.21	0.11
2/3/12 1:00 PM	0.20	0.20	0.11
2/3/12 3:00 PM	0.20	0.20	0.11
2/3/12 5:00 PM	0.20	0.20	0.10
2/3/12 7:00 PM	0.20	0.20	0.10
2/3/12 9:00 PM	0.14	0.14	0.09
2/3/12 11:00 PM	0.11	0.11	0.08
2/4/12 1:00 AM	0.13	0.13	0.03
2/4/12 3:00 AM	0.12	0.12	0.04
2/4/12 5:00 AM	0.12	0.12	0.04
2/4/12 7:00 AM	0.15	0.15	0.04
2/4/12 9:00 AM	0.21	0.21	0.06
2/4/12 11:00 AM	0.23	0.23	0.13
2/4/12 1:00 PM	0.25	0.25	0.12
2/4/12 3:00 PM	0.24	0.24	0.12
2/4/12 5:00 PM	0.23	0.23	0.11
2/4/12 7:00 PM	0.20	0.20	0.10
2/4/12 9:00 PM	0.20	0.20	0.10
2/4/12 11:00 PM	0.12	0.12	0.09
2/5/12 1:00 AM	0.14	0.14	0.09
2/5/12 3:00 AM	0.14	0.14	0.09
2/5/12 5:00 AM	0.15	0.15	0.09
2/5/12 7:00 AM	0.15	0.15	0.09
2/5/12 9:00 AM	0.15	0.15	0.09
2/5/12 11:00 AM	0.20	0.20	0.09
2/5/12 1:00 PM	0.18	0.18	0.09
2/5/12 3:00 PM	0.19	0.19	0.09

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
2/5/12 5:00 PM	0.21	0.21	0.09
2/5/12 7:00 PM	0.21	0.21	0.09
2/5/12 9:00 PM	0.21	0.21	0.09
2/5/12 11:00 PM	0.16	0.16	0.09
2/6/12 1:00 AM	0.11	0.11	0.06
2/6/12 3:00 AM	0.11	0.11	0.06
2/6/12 5:00 AM	0.12	0.12	0.07
2/6/12 7:00 AM	0.18	0.18	0.11
2/6/12 9:00 AM	0.19	0.19	0.12
2/6/12 11:00 AM	0.17	0.17	0.11
2/6/12 1:00 PM	0.19	0.19	0.11
2/6/12 3:00 PM	0.20	0.20	0.11
2/6/12 5:00 PM	0.17	0.17	0.11
2/6/12 7:00 PM	0.15	0.15	0.10
2/6/12 9:00 PM	0.20	0.20	0.10
2/6/12 11:00 PM	0.15	0.15	0.10
2/7/12 1:00 AM	0.13	0.13	0.10
2/7/12 3:00 AM	0.12	0.12	0.10
2/7/12 5:00 AM	0.12	0.12	0.10
2/7/12 7:00 AM	0.21	0.21	0.10
2/7/12 9:00 AM	0.25	0.25	0.10
2/7/12 11:00 AM	0.25	0.25	0.75
2/7/12 1:00 PM	0.25	0.25	0.12
2/7/12 3:00 PM	0.25	0.25	0.16
2/7/12 5:00 PM	0.24	0.24	0.19
2/7/12 7:00 PM	0.19	0.19	0.17
2/7/12 9:00 PM	0.22	0.22	0.12
2/7/12 11:00 PM	0.19	0.19	0.10
2/8/12 1:00 AM	0.11	0.11	0.09
2/8/12 3:00 AM	0.11	0.11	0.08
2/8/12 5:00 AM	0.12	0.12	0.10
2/8/12 7:00 AM	0.15	0.15	0.12
2/8/12 9:00 AM	0.17	0.17	0.12
2/8/12 11:00 AM	0.20	0.20	0.11
2/8/12 1:00 PM	0.19	0.19	0.12
2/8/12 3:00 PM	0.21	0.21	0.12
2/8/12 5:00 PM	0.19	0.19	0.11
2/8/12 7:00 PM	0.18	0.18	0.10
2/8/12 9:00 PM	0.19	0.19	0.11
2/8/12 11:00 PM	0.10	0.10	0.11
2/9/12 1:00 AM	0.10	0.10	0.07
2/9/12 3:00 AM	0.09	0.09	0.06
2/9/12 5:00 AM	0.11	0.11	0.10
2/9/12 7:00 AM	0.14	0.14	0.12
2/9/12 9:00 AM	0.15	0.15	0.12
2/9/12 11:00 AM	0.20	0.20	0.12
2/9/12 1:00 PM	0.19	0.19	0.11
2/9/12 3:00 PM	0.18	0.18	0.11
2/9/12 5:00 PM	0.20	0.20	0.11
2/9/12 7:00 PM	0.24	0.24	0.11
2/9/12 9:00 PM	0.17	0.17	0.11
2/9/12 11:00 PM	0.15	0.15	0.10
2/10/12 1:00 AM	0.10	0.10	0.10

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
2/10/12 3:00 AM	0.12	0.12	0.09
2/10/12 5:00 AM	0.13	0.13	0.11
2/10/12 7:00 AM	0.17	0.17	0.12
2/10/12 9:00 AM	0.17	0.17	0.12
2/10/12 11:00 AM	0.16	0.16	0.11
2/10/12 1:00 PM	0.22	0.22	0.11
2/10/12 3:00 PM	0.22	0.22	0.11
2/10/12 5:00 PM	0.22	0.22	0.11
2/10/12 7:00 PM	0.21	0.21	0.11
2/10/12 9:00 PM	0.23	0.23	0.11
2/10/12 11:00 PM	0.18	0.18	0.11
2/11/12 1:00 AM	0.18	0.18	0.09
2/11/12 3:00 AM	0.16	0.16	0.08
2/11/12 5:00 AM	0.17	0.17	0.11
2/11/12 7:00 AM	0.19	0.19	0.13
2/11/12 9:00 AM	0.24	0.24	0.13
2/11/12 11:00 AM	0.26	0.26	0.12
2/11/12 1:00 PM	0.23	0.23	0.13
2/11/12 3:00 PM	0.21	0.21	0.13
2/11/12 5:00 PM	0.18	0.18	0.13
2/11/12 7:00 PM	0.18	0.18	0.12
2/11/12 9:00 PM	0.19	0.19	0.13
2/11/12 11:00 PM	0.17	0.17	0.13
2/12/12 1:00 AM	0.19	0.19	0.13
2/12/12 3:00 AM	0.19	0.19	0.13
2/12/12 5:00 AM	0.21	0.21	0.14
2/12/12 7:00 AM	0.21	0.21	0.14
2/12/12 9:00 AM	0.20	0.20	0.14
2/12/12 11:00 AM	0.23	0.23	0.14
2/12/12 1:00 PM	0.20	0.20	0.13
2/12/12 3:00 PM	0.16	0.16	0.12
2/12/12 5:00 PM	0.16	0.16	0.11
2/12/12 7:00 PM	0.16	0.16	0.11
2/12/12 9:00 PM	0.15	0.15	0.11
2/12/12 11:00 PM	0.16	0.16	0.11
2/13/12 1:00 AM	0.16	0.16	0.11
2/13/12 3:00 AM	0.16	0.16	0.12
2/13/12 5:00 AM	0.15	0.15	0.11
2/13/12 7:00 AM	0.16	0.16	0.11
2/13/12 9:00 AM	0.14	0.14	0.11
2/13/12 11:00 AM	0.16	0.16	0.10
2/13/12 1:00 PM	0.19	0.19	0.10
2/13/12 3:00 PM	0.17	0.17	0.10
2/13/12 5:00 PM	0.13	0.13	0.07
2/13/12 7:00 PM	0.13	0.13	0.06
2/13/12 9:00 PM	0.16	0.16	0.09
2/13/12 11:00 PM	0.17	0.17	0.10
2/14/12 1:00 AM	0.18	0.18	0.10
2/14/12 3:00 AM	0.14	0.14	0.10
2/14/12 5:00 AM	0.16	0.16	0.10
2/14/12 7:00 AM	0.15	0.15	0.10
2/14/12 9:00 AM	0.14	0.14	0.10
2/14/12 11:00 AM	0.13	0.13	0.10

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
2/14/12 1:00 PM	0.12	0.12	0.09
2/14/12 3:00 PM	0.11	0.11	0.09
2/14/12 5:00 PM	0.12	0.12	0.09
2/14/12 7:00 PM	0.18	0.18	0.09
2/14/12 9:00 PM	0.21	0.21	0.09
2/14/12 11:00 PM	0.20	0.20	0.09
2/15/12 1:00 AM	0.14	0.14	0.09
2/15/12 3:00 AM	0.14	0.14	0.09
2/15/12 5:00 AM	0.14	0.14	0.09
2/15/12 7:00 AM	0.16	0.16	0.10
2/15/12 9:00 AM	0.18	0.18	0.09
2/15/12 11:00 AM	0.15	0.15	0.10
2/15/12 1:00 PM	0.17	0.17	0.10
2/15/12 3:00 PM	0.19	0.19	0.09
2/15/12 5:00 PM	0.20	0.20	0.08
2/15/12 7:00 PM	0.17	0.17	0.07
2/15/12 9:00 PM	0.20	0.20	0.06
2/15/12 11:00 PM	0.22	0.22	0.05
2/16/12 1:00 AM	0.17	0.17	0.04
2/16/12 3:00 AM	0.13	0.13	0.04
2/16/12 5:00 AM	0.14	0.14	0.04
2/16/12 7:00 AM	0.17	0.17	0.05
2/16/12 9:00 AM	0.16	0.16	0.05
2/16/12 11:00 AM	0.21	0.21	0.05
2/16/12 1:00 PM	0.17	0.17	0.04
2/16/12 3:00 PM	0.11	0.11	0.04
2/16/12 5:00 PM	0.12	0.12	0.05
2/16/12 7:00 PM	0.07	0.07	0.04
2/16/12 9:00 PM	0.06	0.06	0.04
2/16/12 11:00 PM	0.11	0.11	0.02
2/17/12 1:00 AM	0.12	0.12	0.02
2/17/12 3:00 AM	0.14	0.14	0.02
2/17/12 5:00 AM	0.15	0.15	0.02
2/17/12 7:00 AM	0.22	0.22	0.03
2/17/12 9:00 AM	0.23	0.23	0.04
2/17/12 11:00 AM	0.24	0.24	0.04
2/17/12 1:00 PM	0.18	0.18	0.04
2/17/12 3:00 PM	0.07	0.07	0.04
2/17/12 5:00 PM	0.13	0.13	0.04
2/17/12 7:00 PM	0.18	0.18	0.04
2/17/12 9:00 PM	0.13	0.13	0.05
2/17/12 11:00 PM	0.14	0.14	0.03
2/18/12 1:00 AM	0.17	0.17	0.02
2/18/12 3:00 AM	0.14	0.14	0.02
2/18/12 5:00 AM	0.17	0.17	0.02
2/18/12 7:00 AM	0.22	0.22	0.03
2/18/12 9:00 AM	0.23	0.23	0.02
2/18/12 11:00 AM	0.19	0.19	0.02
2/18/12 1:00 PM	0.12	0.12	0.05
2/18/12 3:00 PM	0.19	0.19	0.05
2/18/12 5:00 PM	0.19	0.19	0.05
2/18/12 7:00 PM	0.16	0.16	0.05
2/18/12 9:00 PM	0.12	0.12	0.05

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
2/18/12 11:00 PM	0.06	0.06	0.02
2/19/12 1:00 AM	0.06	0.06	0.02
2/19/12 3:00 AM	0.12	0.12	0.02
2/19/12 5:00 AM	0.11	0.11	0.02
2/19/12 7:00 AM	0.15	0.15	0.02
2/19/12 9:00 AM	0.20	0.20	0.02
2/19/12 11:00 AM	0.19	0.19	0.03
2/19/12 1:00 PM	0.18	0.18	0.05
2/19/12 3:00 PM	0.10	0.10	0.05
2/19/12 5:00 PM	0.17	0.17	0.05
2/19/12 7:00 PM	0.17	0.17	0.05
2/19/12 9:00 PM	0.15	0.15	0.05
2/19/12 11:00 PM	0.15	0.15	0.03
2/20/12 1:00 AM	0.15	0.15	0.02
2/20/12 3:00 AM	0.13	0.13	0.02
2/20/12 5:00 AM	0.18	0.18	0.02
2/20/12 7:00 AM	0.18	0.18	0.03
2/20/12 9:00 AM	0.07	0.07	0.03
2/20/12 11:00 AM	0.06	0.06	0.03
2/20/12 1:00 PM	0.06	0.06	0.03
2/20/12 3:00 PM	0.06	0.06	0.03
2/20/12 5:00 PM	0.13	0.13	0.03
2/20/12 7:00 PM	0.14	0.14	0.03
2/20/12 9:00 PM	0.14	0.14	0.03
2/20/12 11:00 PM	0.14	0.14	0.03
2/21/12 1:00 AM	0.14	0.14	0.02
2/21/12 3:00 AM	0.14	0.14	0.02
2/21/12 5:00 AM	0.14	0.14	0.03
2/21/12 7:00 AM	0.15	0.15	0.04
2/21/12 9:00 AM	0.06	0.06	0.04
2/21/12 11:00 AM	0.13	0.13	0.04
2/21/12 1:00 PM	0.17	0.17	0.05
2/21/12 3:00 PM	0.12	0.12	0.05
2/21/12 5:00 PM	0.14	0.14	0.05
2/21/12 7:00 PM	0.17	0.17	0.05
2/21/12 9:00 PM	0.15	0.15	0.06
2/21/12 11:00 PM	0.14	0.14	0.06
2/22/12 1:00 AM	0.11	0.00	0.06
2/22/12 3:00 AM	0.10	0.00	0.06
2/22/12 5:00 AM	0.14	0.00	0.06
2/22/12 7:00 AM	0.16	0.00	0.07
2/22/12 9:00 AM	0.09	0.00	0.07
2/22/12 11:00 AM	0.19	0.00	0.07
2/22/12 1:00 PM	0.22	0.00	0.07
2/22/12 3:00 PM	0.11	0.00	0.08
2/22/12 5:00 PM	0.12	0.00	0.09
2/22/12 7:00 PM	0.17	0.00	0.09
2/22/12 9:00 PM	0.17	0.00	0.09
2/22/12 11:00 PM	0.16	0.00	0.09
2/23/12 1:00 AM	0.13	0.00	0.09
2/23/12 3:00 AM	0.15	0.00	0.09
2/23/12 5:00 AM	0.15	0.00	0.39
2/23/12 7:00 AM	0.23	0.00	0.10

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
2/23/12 9:00 AM	0.19	0.00	0.10
2/23/12 11:00 AM	0.14	0.00	0.10
2/23/12 1:00 PM	0.08	0.00	0.10
2/23/12 3:00 PM	0.06	0.00	0.10
2/23/12 5:00 PM	0.10	0.00	0.09
2/23/12 7:00 PM	0.14	0.00	0.09
2/23/12 9:00 PM	0.09	0.00	0.09
2/23/12 11:00 PM	0.09	0.00	0.08
2/24/12 1:00 AM	0.19	0.00	0.08
2/24/12 3:00 AM	0.17	0.00	0.08
2/24/12 5:00 AM	0.17	0.00	0.08
2/24/12 7:00 AM	0.21	0.00	0.08
2/24/12 9:00 AM	0.12	0.00	0.09
2/24/12 11:00 AM	0.05	0.00	0.09
2/24/12 1:00 PM	0.08	0.00	0.08
2/24/12 3:00 PM	0.19	0.00	0.10
2/24/12 5:00 PM	0.09	0.00	0.14
2/24/12 7:00 PM	0.06	0.00	0.09
2/24/12 9:00 PM	0.06	0.00	0.05
2/24/12 11:00 PM	0.17	0.00	0.05
2/25/12 1:00 AM	0.12	0.00	0.05
2/25/12 3:00 AM	0.13	0.00	0.04
2/25/12 5:00 AM	0.14	0.00	0.05
2/25/12 7:00 AM	0.15	0.00	0.06
2/25/12 9:00 AM	0.16	0.00	0.06
2/25/12 11:00 AM	0.19	0.00	0.06
2/25/12 1:00 PM	0.20	0.00	0.06
2/25/12 3:00 PM	0.18	0.00	0.06
2/25/12 5:00 PM	0.19	0.00	0.06
2/25/12 7:00 PM	0.21	0.00	0.06
2/25/12 9:00 PM	0.23	0.00	0.05
2/25/12 11:00 PM	0.19	0.00	0.03
2/26/12 1:00 AM	0.14	0.00	0.01
2/26/12 3:00 AM	0.12	0.00	0.02
2/26/12 5:00 AM	0.13	0.00	0.02
2/26/12 7:00 AM	0.16	0.00	0.00
2/26/12 9:00 AM	0.17	0.00	0.01
2/26/12 11:00 AM	0.18	0.00	0.03
2/26/12 1:00 PM	0.13	0.00	0.04
2/26/12 3:00 PM	0.13	0.00	0.04
2/26/12 5:00 PM	0.15	0.00	0.04
2/26/12 7:00 PM	0.20	0.00	0.03
2/26/12 9:00 PM	0.13	0.00	0.03
2/26/12 11:00 PM	0.16	0.00	0.03
2/27/12 1:00 AM	0.15	0.00	0.03
2/27/12 3:00 AM	0.18	0.00	0.03
2/27/12 5:00 AM	0.16	0.00	0.03
2/27/12 7:00 AM	0.17	0.00	0.03
2/27/12 9:00 AM	0.18	0.00	0.04
2/27/12 11:00 AM	0.17	0.00	0.09
2/27/12 1:00 PM	0.17	0.00	0.11
2/27/12 3:00 PM	0.17	0.00	0.09
2/27/12 5:00 PM	0.18	0.00	0.08

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
2/27/12 7:00 PM	0.21	0.00	0.08
2/27/12 9:00 PM	0.27	0.00	0.08
2/27/12 11:00 PM	0.17	0.00	0.07
2/28/12 1:00 AM	0.16	0.00	0.02
2/28/12 3:00 AM	0.13	0.00	0.02
2/28/12 5:00 AM	0.17	0.00	0.02
2/28/12 7:00 AM	0.19	0.00	0.02
2/28/12 9:00 AM	0.18	0.00	0.02
2/28/12 11:00 AM	0.19	0.00	0.03
2/28/12 1:00 PM	0.12	0.00	0.09
2/28/12 3:00 PM	0.13	0.00	0.07
2/28/12 5:00 PM	0.16	0.00	0.08
2/28/12 7:00 PM	0.15	0.00	0.08
2/28/12 9:00 PM	0.19	0.00	0.08
2/28/12 11:00 PM	0.18	0.00	0.07
2/29/12 1:00 AM	0.12	0.00	0.06
2/29/12 3:00 AM	0.10	0.00	0.05
2/29/12 5:00 AM	0.10	0.00	0.05
2/29/12 7:00 AM	0.18	0.00	0.05
2/29/12 9:00 AM	0.17	0.00	0.06
2/29/12 11:00 AM	0.13	0.00	0.08
2/29/12 1:00 PM	0.18	0.00	0.08
2/29/12 3:00 PM	0.17	0.00	0.07
2/29/12 5:00 PM	0.20	0.00	0.08
2/29/12 7:00 PM	0.20	0.00	0.09
2/29/12 9:00 PM	0.18	0.00	0.08
2/29/12 11:00 PM	0.16	0.00	0.08
3/1/12 1:00 AM	0.19	0.00	0.07
3/1/12 3:00 AM	0.14	0.00	0.04
3/1/12 5:00 AM	0.17	0.00	0.05
3/1/12 7:00 AM	0.20	0.00	0.08
3/1/12 9:00 AM	0.21	0.00	0.10
3/1/12 11:00 AM	0.23	0.00	0.09
3/1/12 1:00 PM	0.21	0.00	0.08
3/1/12 3:00 PM	0.17	0.00	0.08
3/1/12 5:00 PM	0.19	0.00	0.08
3/1/12 7:00 PM	0.20	0.00	0.09
3/1/12 9:00 PM	0.20	0.00	0.09
3/1/12 11:00 PM	0.16	0.00	0.08
3/2/12 1:00 AM	0.19	0.00	0.05
3/2/12 3:00 AM	0.16	0.00	0.04
3/2/12 5:00 AM	0.15	0.00	0.06
3/2/12 7:00 AM	0.16	0.00	0.08
3/2/12 9:00 AM	0.15	0.00	0.08
3/2/12 11:00 AM	0.13	0.00	0.08
3/2/12 1:00 PM	0.14	0.00	0.08
3/2/12 3:00 PM	0.13	0.00	0.08
3/2/12 5:00 PM	0.10	0.00	0.08
3/2/12 7:00 PM	0.14	0.00	0.09
3/2/12 9:00 PM	0.12	0.00	0.15
3/2/12 11:00 PM	0.14	0.00	0.09
3/3/12 1:00 AM	0.16	0.16	0.00
3/3/12 3:00 AM	0.16	0.16	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
3/3/12 5:00 AM	0.14	0.14	0.00
3/3/12 7:00 AM	0.13	0.13	0.00
3/3/12 9:00 AM	0.14	0.14	0.00
3/3/12 11:00 AM	0.12	0.00	0.00
3/3/12 1:00 PM	0.10	0.00	0.00
3/3/12 3:00 PM	0.11	0.00	0.00
3/3/12 5:00 PM	0.13	0.00	0.00
3/3/12 7:00 PM	0.13	0.00	0.00
3/3/12 9:00 PM	0.14	0.00	0.00
3/3/12 11:00 PM	0.14	0.00	0.00
3/4/12 1:00 AM	0.11	0.00	0.00
3/4/12 3:00 AM	0.14	0.00	0.00
3/4/12 5:00 AM	0.13	0.00	0.00
3/4/12 7:00 AM	0.16	0.00	0.00
3/4/12 9:00 AM	0.18	0.00	0.00
3/4/12 11:00 AM	0.19	0.00	0.00
3/4/12 1:00 PM	0.17	0.00	0.00
3/4/12 3:00 PM	0.19	0.00	0.00
3/4/12 5:00 PM	0.20	0.20	0.00
3/4/12 7:00 PM	0.22	0.22	0.00
3/4/12 9:00 PM	0.22	0.22	0.00
3/4/12 11:00 PM	0.20	0.20	0.00
3/5/12 1:00 AM	0.15	0.15	0.00
3/5/12 3:00 AM	0.15	0.15	0.00
3/5/12 5:00 AM	0.22	0.22	0.00
3/5/12 7:00 AM	0.21	0.21	0.00
3/5/12 9:00 AM	0.22	0.22	0.00
3/5/12 11:00 AM	0.21	0.21	0.00
3/5/12 1:00 PM	0.17	0.17	0.00
3/5/12 3:00 PM	0.15	0.15	0.00
3/5/12 5:00 PM	0.19	0.19	0.00
3/5/12 7:00 PM	0.18	0.18	0.00
3/5/12 9:00 PM	0.19	0.19	0.00
3/5/12 11:00 PM	0.21	0.21	0.00
3/6/12 1:00 AM	0.17	0.17	0.00
3/6/12 3:00 AM	0.18	0.18	0.00
3/6/12 5:00 AM	0.18	0.18	0.00
3/6/12 7:00 AM	0.15	0.15	0.00
3/6/12 9:00 AM	0.15	0.15	0.00
3/6/12 11:00 AM	0.14	0.14	0.00
3/6/12 1:00 PM	0.14	0.14	0.00
3/6/12 3:00 PM	0.15	0.15	0.00
3/6/12 5:00 PM	0.16	0.16	0.00
3/6/12 7:00 PM	0.15	0.15	0.00
3/6/12 9:00 PM	0.15	0.15	0.00
3/6/12 11:00 PM	0.17	0.17	0.00
3/7/12 1:00 AM	0.15	0.15	0.00
3/7/12 3:00 AM	0.14	0.14	0.00
3/7/12 5:00 AM	0.14	0.14	0.00
3/7/12 7:00 AM	0.18	0.18	0.00
3/7/12 9:00 AM	0.18	0.18	0.00
3/7/12 11:00 AM	0.17	0.17	0.00
3/7/12 1:00 PM	0.15	0.15	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
3/7/12 3:00 PM	0.14	0.14	0.00
3/7/12 5:00 PM	0.15	0.15	0.00
3/7/12 7:00 PM	0.16	0.16	0.00
3/7/12 9:00 PM	0.16	0.16	0.00
3/7/12 11:00 PM	0.15	0.15	0.00
3/8/12 1:00 AM	0.14	0.14	0.00
3/8/12 3:00 AM	0.15	0.15	0.00
3/8/12 5:00 AM	0.15	0.15	0.00
3/8/12 7:00 AM	0.15	0.15	0.00
3/8/12 9:00 AM	0.15	0.15	0.00
3/8/12 11:00 AM	0.13	0.13	0.00
3/8/12 1:00 PM	0.11	0.11	0.00
3/8/12 3:00 PM	0.12	0.12	0.00
3/8/12 5:00 PM	0.12	0.12	0.00
3/8/12 7:00 PM	0.13	0.13	0.00
3/8/12 9:00 PM	0.15	0.15	0.00
3/8/12 11:00 PM	0.16	0.16	0.00
3/9/12 1:00 AM	0.16	0.16	0.00
3/9/12 3:00 AM	0.15	0.15	0.00
3/9/12 5:00 AM	0.17	0.17	0.00
3/9/12 7:00 AM	0.15	0.15	0.00
3/9/12 9:00 AM	0.16	0.16	0.00
3/9/12 11:00 AM	0.15	0.15	0.00
3/9/12 1:00 PM	0.13	0.13	0.00
3/9/12 3:00 PM	0.14	0.14	0.00
3/9/12 5:00 PM	0.12	0.12	0.00
3/9/12 7:00 PM	0.13	0.13	0.00
3/9/12 9:00 PM	0.15	0.15	0.00
3/9/12 11:00 PM	0.16	0.16	0.00
3/10/12 1:00 AM	0.13	0.13	0.00
3/10/12 3:00 AM	0.12	0.12	0.00
3/10/12 5:00 AM	0.15	0.15	0.00
3/10/12 7:00 AM	0.16	0.16	0.00
3/10/12 9:00 AM	0.16	0.16	0.00
3/10/12 11:00 AM	0.15	0.15	0.00
3/10/12 1:00 PM	0.12	0.12	0.00
3/10/12 3:00 PM	0.10	0.10	0.00
3/10/12 5:00 PM	0.12	0.12	0.00
3/10/12 7:00 PM	0.14	0.14	0.00
3/10/12 9:00 PM	0.12	0.12	0.00
3/10/12 11:00 PM	0.13	0.13	0.00
3/11/12 1:00 AM	0.13	0.13	0.00
3/11/12 3:00 AM	0.16	0.16	0.00
3/11/12 5:00 AM	0.12	0.12	0.00
3/11/12 7:00 AM	0.12	0.12	0.00
3/11/12 9:00 AM	0.15	0.15	0.00
3/11/12 11:00 AM	0.13	0.13	0.00
3/11/12 1:00 PM	0.13	0.13	0.00
3/11/12 3:00 PM	0.11	0.11	0.00
3/11/12 5:00 PM	0.16	0.16	0.00
3/11/12 7:00 PM	0.17	0.17	0.00
3/11/12 9:00 PM	0.17	0.17	0.00
3/11/12 11:00 PM	0.19	0.19	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
3/12/12 1:00 AM	0.18	0.18	0.00
3/12/12 3:00 AM	0.16	0.16	0.00
3/12/12 5:00 AM	0.16	0.16	0.00
3/12/12 7:00 AM	0.18	0.18	0.00
3/12/12 9:00 AM	0.20	0.20	0.00
3/12/12 11:00 AM	0.16	0.16	0.00
3/12/12 1:00 PM	0.19	0.19	0.00
3/12/12 3:00 PM	0.16	0.16	0.00
3/12/12 5:00 PM	0.17	0.17	0.00
3/12/12 7:00 PM	0.17	0.17	0.00
3/12/12 9:00 PM	0.17	0.17	0.00
3/12/12 11:00 PM	0.21	0.21	0.00
3/13/12 1:00 AM	0.22	0.22	0.00
3/13/12 3:00 AM	0.22	0.22	0.00
3/13/12 5:00 AM	0.19	0.19	0.00
3/13/12 7:00 AM	0.23	0.23	0.00
3/13/12 9:00 AM	0.23	0.23	0.00
3/13/12 11:00 AM	0.22	0.22	0.05
3/13/12 1:00 PM	0.19	0.19	0.09
3/13/12 3:00 PM	0.20	0.20	0.18
3/13/12 5:00 PM	0.19	0.19	0.11
3/13/12 7:00 PM	0.18	0.18	0.11
3/13/12 9:00 PM	0.20	0.20	0.11
3/13/12 11:00 PM	0.19	0.19	0.11
3/14/12 1:00 AM	0.15	0.15	0.11
3/14/12 3:00 AM	0.14	0.14	0.11
3/14/12 5:00 AM	0.20	0.20	0.11
3/14/12 7:00 AM	0.24	0.24	0.08
3/14/12 9:00 AM	0.21	0.21	0.07
3/14/12 11:00 AM	0.16	0.16	0.07
3/14/12 1:00 PM	0.08	0.08	0.07
3/14/12 3:00 PM	0.14	0.14	0.08
3/14/12 5:00 PM	0.16	0.16	0.08
3/14/12 7:00 PM	0.17	0.17	0.07
3/14/12 9:00 PM	0.20	0.20	0.08
3/14/12 11:00 PM	0.20	0.20	0.08
3/15/12 1:00 AM	0.19	0.19	0.06
3/15/12 3:00 AM	0.19	0.19	0.06
3/15/12 5:00 AM	0.20	0.20	0.06
3/15/12 7:00 AM	0.23	0.23	0.06
3/15/12 9:00 AM	0.21	0.21	0.09
3/15/12 11:00 AM	0.22	0.22	0.09
3/15/12 1:00 PM	0.14	0.14	0.10
3/15/12 3:00 PM	0.15	0.15	0.10
3/15/12 5:00 PM	0.19	0.19	0.10
3/15/12 7:00 PM	0.19	0.19	0.10
3/15/12 9:00 PM	0.19	0.19	0.09
3/15/12 11:00 PM	0.20	0.20	0.08
3/16/12 1:00 AM	0.19	0.19	0.08
3/16/12 3:00 AM	0.18	0.18	0.07
3/16/12 5:00 AM	0.18	0.18	0.06
3/16/12 7:00 AM	0.20	0.20	0.10
3/16/12 9:00 AM	0.25	0.25	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
3/16/12 11:00 AM	0.22	0.22	0.05
3/16/12 1:00 PM	0.17	0.17	0.09
3/16/12 3:00 PM	0.17	0.17	0.10
3/16/12 5:00 PM	0.17	0.17	0.10
3/16/12 7:00 PM	0.19	0.19	0.09
3/16/12 9:00 PM	0.22	0.22	0.09
3/16/12 11:00 PM	0.17	0.17	0.09
3/17/12 1:00 AM	0.15	0.15	0.08
3/17/12 3:00 AM	0.15	0.15	0.07
3/17/12 5:00 AM	0.15	0.15	0.07
3/17/12 7:00 AM	0.18	0.18	0.07
3/17/12 9:00 AM	0.25	0.25	0.10
3/17/12 11:00 AM	0.23	0.23	0.10
3/17/12 1:00 PM	0.21	0.21	0.10
3/17/12 3:00 PM	0.21	0.21	0.09
3/17/12 5:00 PM	0.22	0.22	0.10
3/17/12 7:00 PM	0.21	0.21	0.10
3/17/12 9:00 PM	0.19	0.19	0.10
3/17/12 11:00 PM	0.15	0.15	0.11
3/18/12 1:00 AM	0.16	0.16	0.15
3/18/12 3:00 AM	0.16	0.16	0.10
3/18/12 5:00 AM	0.15	0.15	0.10
3/18/12 7:00 AM	0.16	0.16	0.09
3/18/12 9:00 AM	0.21	0.21	0.15
3/18/12 11:00 AM	0.19	0.19	0.17
3/18/12 1:00 PM	0.20	0.20	0.16
3/18/12 3:00 PM	0.19	0.19	0.15
3/18/12 5:00 PM	0.24	0.24	0.14
3/18/12 7:00 PM	0.24	0.24	0.13
3/18/12 9:00 PM	0.28	0.28	0.12
3/18/12 11:00 PM	0.23	0.23	0.12
3/19/12 1:00 AM	0.16	0.16	0.07
3/19/12 3:00 AM	0.16	0.16	0.07
3/19/12 5:00 AM	0.23	0.23	0.10
3/19/12 7:00 AM	0.28	0.28	0.19
3/19/12 9:00 AM	0.25	0.25	0.20
3/19/12 11:00 AM	0.24	0.24	0.18
3/19/12 1:00 PM	0.23	0.23	0.18
3/19/12 3:00 PM	0.22	0.22	0.19
3/19/12 5:00 PM	0.24	0.24	0.18
3/19/12 7:00 PM	0.24	0.24	0.18
3/19/12 9:00 PM	0.23	0.23	0.17
3/19/12 11:00 PM	0.23	0.23	0.11
3/20/12 1:00 AM	0.18	0.18	0.09
3/20/12 3:00 AM	0.16	0.16	0.09
3/20/12 5:00 AM	0.18	0.18	0.13
3/20/12 7:00 AM	0.19	0.19	0.24
3/20/12 9:00 AM	0.18	0.18	0.22
3/20/12 11:00 AM	0.21	0.21	0.18
3/20/12 1:00 PM	0.19	0.19	0.18
3/20/12 3:00 PM	0.22	0.22	0.20
3/20/12 5:00 PM	0.24	0.24	0.21
3/20/12 7:00 PM	0.25	0.25	0.21

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
3/20/12 9:00 PM	0.26	0.26	0.20
3/20/12 11:00 PM	0.17	0.17	0.19
3/21/12 1:00 AM	0.13	0.13	0.16
3/21/12 3:00 AM	0.15	0.15	0.13
3/21/12 5:00 AM	0.15	0.15	0.16
3/21/12 7:00 AM	0.28	0.28	0.18
3/21/12 9:00 AM	0.26	0.26	0.18
3/21/12 11:00 AM	0.23	0.23	0.19
3/21/12 1:00 PM	0.22	0.22	0.19
3/21/12 3:00 PM	0.22	0.22	0.19
3/21/12 5:00 PM	0.24	0.24	0.20
3/21/12 7:00 PM	0.26	0.26	0.21
3/21/12 9:00 PM	0.25	0.25	0.19
3/21/12 11:00 PM	0.23	0.23	0.09
3/22/12 1:00 AM	0.24	0.24	0.07
3/22/12 3:00 AM	0.16	0.16	0.08
3/22/12 5:00 AM	0.23	0.23	0.09
3/22/12 7:00 AM	0.19	0.19	0.15
3/22/12 9:00 AM	0.18	0.18	0.16
3/22/12 11:00 AM	0.15	0.15	0.21
3/22/12 1:00 PM	0.16	0.16	0.15
3/22/12 3:00 PM	0.16	0.16	0.10
3/22/12 5:00 PM	0.16	0.16	0.10
3/22/12 7:00 PM	0.16	0.16	0.08
3/22/12 9:00 PM	0.15	0.15	0.08
3/22/12 11:00 PM	0.11	0.11	0.08
3/23/12 1:00 AM	0.11	0.11	0.08
3/23/12 3:00 AM	0.10	0.10	0.10
3/23/12 5:00 AM	0.12	0.12	0.09
3/23/12 7:00 AM	0.17	0.17	0.10
3/23/12 9:00 AM	0.16	0.16	0.09
3/23/12 11:00 AM	0.16	0.16	0.09
3/23/12 1:00 PM	0.16	0.16	0.09
3/23/12 3:00 PM	0.17	0.17	0.08
3/23/12 5:00 PM	0.17	0.17	0.08
3/23/12 7:00 PM	0.20	0.20	0.08
3/23/12 9:00 PM	0.13	0.13	0.07
3/23/12 11:00 PM	0.11	0.00	0.07
3/24/12 1:00 AM	0.16	0.00	0.06
3/24/12 3:00 AM	0.14	0.00	0.07
3/24/12 5:00 AM	0.13	0.00	0.08
3/24/12 7:00 AM	0.20	0.00	0.08
3/24/12 9:00 AM	0.22	0.00	0.08
3/24/12 11:00 AM	0.22	0.00	0.08
3/24/12 1:00 PM	0.21	0.00	0.08
3/24/12 3:00 PM	0.22	0.00	0.08
3/24/12 5:00 PM	0.21	0.00	0.07
3/24/12 7:00 PM	0.13	0.00	0.08
3/24/12 9:00 PM	0.10	0.00	0.08
3/24/12 11:00 PM	0.10	0.00	0.08
3/25/12 1:00 AM	0.09	0.00	0.08
3/25/12 3:00 AM	0.10	0.00	0.09
3/25/12 5:00 AM	0.09	0.00	0.08

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
3/25/12 7:00 AM	0.09	0.00	0.08
3/25/12 9:00 AM	0.10	0.00	0.07
3/25/12 11:00 AM	0.10	0.00	0.07
3/25/12 1:00 PM	0.10	0.00	0.06
3/25/12 3:00 PM	0.10	0.00	0.07
3/25/12 5:00 PM	0.11	0.00	0.07
3/25/12 7:00 PM	0.11	0.00	0.08
3/25/12 9:00 PM	0.10	0.00	0.07
3/25/12 11:00 PM	0.10	0.00	0.05
3/26/12 1:00 AM	0.10	0.00	0.05
3/26/12 3:00 AM	0.10	0.00	0.05
3/26/12 5:00 AM	0.10	0.00	0.07
3/26/12 7:00 AM	0.11	0.00	0.11
3/26/12 9:00 AM	0.10	0.00	0.11
3/26/12 11:00 AM	0.10	0.00	0.11
3/26/12 1:00 PM	0.10	0.00	0.10
3/26/12 3:00 PM	0.10	0.00	0.10
3/26/12 5:00 PM	0.10	0.00	0.09
3/26/12 7:00 PM	0.10	0.00	0.09
3/26/12 9:00 PM	0.10	0.00	0.09
3/26/12 11:00 PM	0.10	0.00	0.06
3/27/12 1:00 AM	0.10	0.00	0.06
3/27/12 3:00 AM	0.10	0.00	0.06
3/27/12 5:00 AM	0.10	0.00	0.06
3/27/12 7:00 AM	0.11	0.00	0.07
3/27/12 9:00 AM	0.10	0.00	0.13
3/27/12 11:00 AM	0.11	0.00	0.13
3/27/12 1:00 PM	0.10	0.00	0.12
3/27/12 3:00 PM	0.10	0.00	0.12
3/27/12 5:00 PM	0.09	0.00	0.14
3/27/12 7:00 PM	0.11	0.00	0.15
3/27/12 9:00 PM	0.10	0.00	0.14
3/27/12 11:00 PM	0.10	0.00	0.12
3/28/12 1:00 AM	0.10	0.00	0.08
3/28/12 3:00 AM	0.09	0.00	0.08
3/28/12 5:00 AM	0.12	0.00	0.11
3/28/12 7:00 AM	0.12	0.00	0.13
3/28/12 9:00 AM	0.11	0.00	0.12
3/28/12 11:00 AM	0.10	0.00	0.10
3/28/12 1:00 PM	0.09	0.00	0.13
3/28/12 3:00 PM	0.12	0.12	0.10
3/28/12 5:00 PM	0.19	0.19	0.10
3/28/12 7:00 PM	0.25	0.25	0.10
3/28/12 9:00 PM	0.24	0.24	0.10
3/28/12 11:00 PM	0.16	0.16	0.10
3/29/12 1:00 AM	0.14	0.14	0.10
3/29/12 3:00 AM	0.13	0.13	0.10
3/29/12 5:00 AM	0.15	0.15	0.10
3/29/12 7:00 AM	0.27	0.27	0.10
3/29/12 9:00 AM	0.23	0.23	0.12
3/29/12 11:00 AM	0.25	0.25	0.11
3/29/12 1:00 PM	0.26	0.26	0.10
3/29/12 3:00 PM	0.22	0.22	0.10

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
3/29/12 5:00 PM	0.23	0.23	0.09
3/29/12 7:00 PM	0.23	0.23	0.09
3/29/12 9:00 PM	0.23	0.23	0.09
3/29/12 11:00 PM	0.23	0.23	0.06
3/30/12 1:00 AM	0.23	0.23	0.04
3/30/12 3:00 AM	0.21	0.21	0.04
3/30/12 5:00 AM	0.23	0.23	0.06
3/30/12 7:00 AM	0.23	0.23	0.09
3/30/12 9:00 AM	0.23	0.23	0.09
3/30/12 11:00 AM	0.20	0.20	0.10
3/30/12 1:00 PM	0.19	0.19	0.10
3/30/12 3:00 PM	0.20	0.20	0.09
3/30/12 5:00 PM	0.18	0.18	0.09
3/30/12 7:00 PM	0.20	0.20	0.09
3/30/12 9:00 PM	0.22	0.22	0.09
3/30/12 11:00 PM	0.21	0.21	0.09
3/31/12 1:00 AM	0.23	0.23	0.07
3/31/12 3:00 AM	0.25	0.25	0.07
3/31/12 5:00 AM	0.24	0.24	0.07
3/31/12 7:00 AM	0.15	0.15	0.09
3/31/12 9:00 AM	0.09	0.09	0.09
3/31/12 11:00 AM	0.22	0.22	0.09
3/31/12 1:00 PM	0.10	0.10	0.09
3/31/12 3:00 PM	0.25	0.25	0.09
3/31/12 5:00 PM	0.22	0.22	0.09
3/31/12 7:00 PM	0.24	0.24	0.09
3/31/12 9:00 PM	0.24	0.24	0.08
3/31/12 11:00 PM	0.22	0.22	0.05
4/1/12 1:00 AM	0.22	0.22	0.00
4/1/12 3:00 AM	0.23	0.23	0.00
4/1/12 5:00 AM	0.22	0.22	0.00
4/1/12 7:00 AM	0.20	0.20	0.00
4/1/12 9:00 AM	0.20	0.20	0.00
4/1/12 11:00 AM	0.19	0.19	0.00
4/1/12 1:00 PM	0.19	0.19	0.00
4/1/12 3:00 PM	0.19	0.19	0.00
4/1/12 5:00 PM	0.18	0.18	0.00
4/1/12 7:00 PM	0.20	0.20	0.00
4/1/12 9:00 PM	0.22	0.22	0.00
4/1/12 11:00 PM	0.20	0.20	0.00
4/2/12 1:00 AM	0.20	0.20	0.00
4/2/12 3:00 AM	0.19	0.19	0.00
4/2/12 5:00 AM	0.00	0.05	0.00
4/2/12 7:00 AM	0.00	0.03	0.00
4/2/12 9:00 AM	0.00	0.02	0.00
4/2/12 11:00 AM	0.00	0.03	0.00
4/2/12 1:00 PM	0.00	0.02	0.00
4/2/12 3:00 PM	0.00	0.02	0.00
4/2/12 5:00 PM	0.00	0.02	0.00
4/2/12 7:00 PM	0.00	0.02	0.00
4/2/12 9:00 PM	0.00	0.03	0.00
4/2/12 11:00 PM	0.00	0.03	0.00
4/3/12 1:00 AM	0.00	0.03	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
4/3/12 3:00 AM	0.00	0.03	0.00
4/3/12 5:00 AM	0.00	0.03	0.00
4/3/12 7:00 AM	0.00	0.03	0.00
4/3/12 9:00 AM	0.00	0.05	0.03
4/3/12 11:00 AM	0.00	0.10	0.16
4/3/12 1:00 PM	0.00	0.10	0.21
4/3/12 3:00 PM	0.00	0.10	0.24
4/3/12 5:00 PM	0.00	0.10	0.17
4/3/12 7:00 PM	0.00	0.11	0.14
4/3/12 9:00 PM	0.00	0.12	0.14
4/3/12 11:00 PM	0.00	0.12	0.14
4/4/12 1:00 AM	0.00	0.09	0.14
4/4/12 3:00 AM	0.00	0.10	0.14
4/4/12 5:00 AM	0.00	0.14	0.14
4/4/12 7:00 AM	0.00	0.14	0.08
4/4/12 9:00 AM	0.00	0.13	0.08
4/4/12 11:00 AM	0.00	0.11	0.08
4/4/12 1:00 PM	0.00	0.12	0.08
4/4/12 3:00 PM	0.00	0.12	0.08
4/4/12 5:00 PM	0.00	0.12	0.09
4/4/12 7:00 PM	0.00	0.12	0.10
4/4/12 9:00 PM	0.00	0.13	0.09
4/4/12 11:00 PM	0.00	0.14	0.09
4/5/12 1:00 AM	0.00	0.15	0.08
4/5/12 3:00 AM	0.00	0.14	0.08
4/5/12 5:00 AM	0.00	0.14	0.08
4/5/12 7:00 AM	0.00	0.14	0.08
4/5/12 9:00 AM	0.00	0.14	0.09
4/5/12 11:00 AM	0.00	0.11	0.08
4/5/12 1:00 PM	0.00	0.10	0.08
4/5/12 3:00 PM	0.00	0.11	0.07
4/5/12 5:00 PM	0.00	0.13	0.08
4/5/12 7:00 PM	0.00	0.13	0.08
4/5/12 9:00 PM	0.00	0.14	0.08
4/5/12 11:00 PM	0.00	0.14	0.08
4/6/12 1:00 AM	0.00	0.13	0.08
4/6/12 3:00 AM	0.00	0.14	0.08
4/6/12 5:00 AM	0.00	0.14	0.08
4/6/12 7:00 AM	0.00	0.14	0.09
4/6/12 9:00 AM	0.00	0.14	0.09
4/6/12 11:00 AM	0.00	0.13	0.09
4/6/12 1:00 PM	0.00	0.13	0.10
4/6/12 3:00 PM	0.00	0.13	0.10
4/6/12 5:00 PM	0.00	0.13	0.10
4/6/12 7:00 PM	0.00	0.13	0.11
4/6/12 9:00 PM	0.00	0.13	0.11
4/6/12 11:00 PM	0.00	0.13	0.11
4/7/12 1:00 AM	0.00	0.13	0.09
4/7/12 3:00 AM	0.00	0.13	0.00
4/7/12 5:00 AM	0.00	0.12	0.00
4/7/12 7:00 AM	0.00	0.12	0.00
4/7/12 9:00 AM	0.00	0.12	0.02
4/7/12 11:00 AM	0.00	0.12	0.10

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
4/7/12 1:00 PM	0.00	0.12	0.14
4/7/12 3:00 PM	0.00	0.12	0.13
4/7/12 5:00 PM	0.00	0.11	0.13
4/7/12 7:00 PM	0.00	0.12	0.12
4/7/12 9:00 PM	0.00	0.12	0.21
4/7/12 11:00 PM	0.00	0.11	0.12
4/8/12 1:00 AM	0.00	0.11	0.09
4/8/12 3:00 AM	0.00	0.10	0.08
4/8/12 5:00 AM	0.00	0.10	0.08
4/8/12 7:00 AM	0.00	0.11	0.12
4/8/12 9:00 AM	0.00	0.12	0.13
4/8/12 11:00 AM	0.00	0.12	0.13
4/8/12 1:00 PM	0.00	0.12	0.12
4/8/12 3:00 PM	0.00	0.11	0.12
4/8/12 5:00 PM	0.00	0.11	0.12
4/8/12 7:00 PM	0.00	0.11	0.13
4/8/12 9:00 PM	0.00	0.11	0.12
4/8/12 11:00 PM	0.00	0.11	0.10
4/9/12 1:00 AM	0.00	0.10	0.07
4/9/12 3:00 AM	0.00	0.10	0.07
4/9/12 5:00 AM	0.00	0.11	0.10
4/9/12 7:00 AM	0.00	0.11	0.12
4/9/12 9:00 AM	0.00	0.11	0.12
4/9/12 11:00 AM	0.00	0.11	0.12
4/9/12 1:00 PM	0.00	0.11	0.12
4/9/12 3:00 PM	0.00	0.11	0.11
4/9/12 5:00 PM	0.00	0.11	0.11
4/9/12 7:00 PM	0.00	0.11	0.10
4/9/12 9:00 PM	0.00	0.10	0.10
4/9/12 11:00 PM	0.00	0.09	0.10
4/10/12 1:00 AM	0.00	0.06	0.09
4/10/12 3:00 AM	0.00	0.06	0.09
4/10/12 5:00 AM	0.00	0.10	0.09
4/10/12 7:00 AM	0.00	0.11	0.09
4/10/12 9:00 AM	0.00	0.11	0.11
4/10/12 11:00 AM	0.00	0.11	0.10
4/10/12 1:00 PM	0.00	0.11	0.11
4/10/12 3:00 PM	0.00	0.11	0.11
4/10/12 5:00 PM	0.00	0.11	0.12
4/10/12 7:00 PM	0.00	0.11	0.12
4/10/12 9:00 PM	0.00	0.11	0.11
4/10/12 11:00 PM	0.00	0.11	0.05
4/11/12 1:00 AM	0.00	0.11	0.03
4/11/12 3:00 AM	0.00	0.12	0.00
4/11/12 5:00 AM	0.00	0.11	0.00
4/11/12 7:00 AM	0.00	0.11	0.00
4/11/12 9:00 AM	0.00	0.11	0.00
4/11/12 11:00 AM	0.00	0.11	0.00
4/11/12 1:00 PM	0.00	0.11	0.00
4/11/12 3:00 PM	0.00	0.11	0.00
4/11/12 5:00 PM	0.00	0.11	0.00
4/11/12 7:00 PM	0.00	0.11	0.00
4/11/12 9:00 PM	0.00	0.10	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
4/11/12 11:00 PM	0.00	0.10	0.00
4/12/12 1:00 AM	0.00	0.11	0.00
4/12/12 3:00 AM	0.00	0.10	0.00
4/12/12 5:00 AM	0.00	0.10	0.00
4/12/12 7:00 AM	0.00	0.11	0.00
4/12/12 9:00 AM	0.00	0.10	0.00
4/12/12 11:00 AM	0.00	0.10	0.00
4/12/12 1:00 PM	0.00	0.11	0.00
4/12/12 3:00 PM	0.00	0.10	0.00
4/12/12 5:00 PM	0.00	0.11	0.00
4/12/12 7:00 PM	0.00	0.10	0.00
4/12/12 9:00 PM	0.00	0.10	0.00
4/12/12 11:00 PM	0.00	0.10	0.00
4/13/12 1:00 AM	0.00	0.10	0.00
4/13/12 3:00 AM	0.00	0.09	0.00
4/13/12 5:00 AM	0.00	0.10	0.00
4/13/12 7:00 AM	0.00	0.09	0.00
4/13/12 9:00 AM	0.00	0.08	0.04
4/13/12 11:00 AM	0.00	0.09	0.09
4/13/12 1:00 PM	0.00	0.10	0.14
4/13/12 3:00 PM	0.00	0.11	0.13
4/13/12 5:00 PM	0.00	0.16	0.11
4/13/12 7:00 PM	0.00	0.17	0.11
4/13/12 9:00 PM	0.00	0.12	0.11
4/13/12 11:00 PM	0.00	0.10	0.11
4/14/12 1:00 AM	0.00	0.08	0.11
4/14/12 3:00 AM	0.00	0.09	0.11
4/14/12 5:00 AM	0.00	0.09	0.00
4/14/12 7:00 AM	0.00	0.09	0.00
4/14/12 9:00 AM	0.00	0.09	0.00
4/14/12 11:00 AM	0.00	0.09	0.00
4/14/12 1:00 PM	0.00	0.09	0.00
4/14/12 3:00 PM	0.00	0.09	0.00
4/14/12 5:00 PM	0.00	0.10	0.00
4/14/12 7:00 PM	0.00	0.10	0.00
4/14/12 9:00 PM	0.00	0.10	0.11
4/14/12 11:00 PM	0.00	0.10	0.11
4/15/12 1:00 AM	0.00	0.10	0.11
4/15/12 3:00 AM	0.00	0.10	0.11
4/15/12 5:00 AM	0.00	0.09	0.11
4/15/12 7:00 AM	0.00	0.09	0.10
4/15/12 9:00 AM	0.00	0.10	0.12
4/15/12 11:00 AM	0.00	0.16	0.12
4/15/12 1:00 PM	0.00	0.25	0.13
4/15/12 3:00 PM	0.00	0.26	0.14
4/15/12 5:00 PM	0.00	0.17	0.14
4/15/12 7:00 PM	0.00	0.12	0.14
4/15/12 9:00 PM	0.00	0.10	0.14
4/15/12 11:00 PM	0.00	0.04	0.14
4/16/12 1:00 AM	0.00	0.00	0.14
4/16/12 3:00 AM	0.00	0.00	0.14
4/16/12 5:00 AM	0.00	0.00	0.11
4/16/12 7:00 AM	0.00	0.00	0.12

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
4/16/12 9:00 AM	0.00	0.00	0.13
4/16/12 11:00 AM	0.00	0.00	0.13
4/16/12 1:00 PM	0.00	0.00	0.14
4/16/12 3:00 PM	0.00	0.00	0.14
4/16/12 5:00 PM	0.00	0.00	0.14
4/16/12 7:00 PM	0.00	0.00	0.13
4/16/12 9:00 PM	0.00	0.00	0.13
4/16/12 11:00 PM	0.00	0.00	0.13
4/17/12 1:00 AM	0.00	0.00	0.13
4/17/12 3:00 AM	0.00	0.00	0.13
4/17/12 5:00 AM	0.00	0.00	0.13
4/17/12 7:00 AM	0.00	0.00	0.13
4/17/12 9:00 AM	0.00	0.00	0.11
4/17/12 11:00 AM	0.00	0.00	0.11
4/17/12 1:00 PM	0.00	0.00	0.11
4/17/12 3:00 PM	0.00	0.00	0.11
4/17/12 5:00 PM	0.00	0.00	0.11
4/17/12 7:00 PM	0.00	0.00	0.10
4/17/12 9:00 PM	0.00	0.00	0.10
4/17/12 11:00 PM	0.00	0.00	0.09
4/18/12 1:00 AM	0.00	0.00	0.08
4/18/12 3:00 AM	0.00	0.00	0.09
4/18/12 5:00 AM	0.00	0.00	0.10
4/18/12 7:00 AM	0.00	0.00	0.10
4/18/12 9:00 AM	0.00	0.00	0.10
4/18/12 11:00 AM	0.00	0.00	0.11
4/18/12 1:00 PM	0.00	0.00	0.11
4/18/12 3:00 PM	0.00	0.00	0.12
4/18/12 5:00 PM	0.00	0.00	0.26
4/18/12 7:00 PM	0.00	0.00	0.14
4/18/12 9:00 PM	0.00	0.00	0.13
4/18/12 11:00 PM	0.00	0.00	0.13
4/19/12 1:00 AM	0.00	0.00	0.13
4/19/12 3:00 AM	0.00	0.00	0.13
4/19/12 5:00 AM	0.00	0.00	0.14
4/19/12 7:00 AM	0.00	0.00	0.14
4/19/12 9:00 AM	0.00	0.00	0.23
4/19/12 11:00 AM	0.00	0.00	0.19
4/19/12 1:00 PM	0.00	0.00	0.16
4/19/12 3:00 PM	0.00	0.00	0.17
4/19/12 5:00 PM	0.00	0.00	0.18
4/19/12 7:00 PM	0.00	0.00	0.19
4/19/12 9:00 PM	0.00	0.00	0.20
4/19/12 11:00 PM	0.00	0.00	0.21
4/20/12 1:00 AM	0.00	0.00	0.22
4/20/12 3:00 AM	0.00	0.00	0.23
4/20/12 5:00 AM	0.00	0.00	0.23
4/20/12 7:00 AM	0.00	0.00	0.23
4/20/12 9:00 AM	0.00	0.00	0.24
4/20/12 11:00 AM	0.00	0.00	0.24
4/20/12 1:00 PM	0.00	0.00	0.25
4/20/12 3:00 PM	0.00	0.00	0.26
4/20/12 5:00 PM	0.00	0.00	0.22

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
4/20/12 7:00 PM	0.00	0.00	0.20
4/20/12 9:00 PM	0.00	0.00	0.21
4/20/12 11:00 PM	0.00	0.00	0.19
4/21/12 1:00 AM	0.00	0.00	0.22
4/21/12 3:00 AM	0.00	0.00	0.20
4/21/12 5:00 AM	0.00	0.00	0.21
4/21/12 7:00 AM	0.00	0.00	0.22
4/21/12 9:00 AM	0.00	0.00	0.22
4/21/12 11:00 AM	0.00	0.00	0.23
4/21/12 1:00 PM	0.00	0.00	0.22
4/21/12 3:00 PM	0.00	0.00	0.23
4/21/12 5:00 PM	0.00	0.00	0.23
4/21/12 7:00 PM	0.00	0.00	0.24
4/21/12 9:00 PM	0.00	0.00	0.24
4/21/12 11:00 PM	0.00	0.00	0.22
4/22/12 1:00 AM	0.00	0.00	0.06
4/22/12 3:00 AM	0.00	0.00	0.00
4/22/12 5:00 AM	0.00	0.00	0.00
4/22/12 7:00 AM	0.00	0.00	0.00
4/22/12 9:00 AM	0.00	0.00	0.00
4/22/12 11:00 AM	0.00	0.00	0.00
4/22/12 1:00 PM	0.00	0.00	0.00
4/22/12 3:00 PM	0.00	0.00	0.00
4/22/12 5:00 PM	0.00	0.00	0.00
4/22/12 7:00 PM	0.00	0.00	0.00
4/22/12 9:00 PM	0.00	0.00	0.00
4/22/12 11:00 PM	0.00	0.00	0.00
4/23/12 1:00 AM	0.00	0.00	0.00
4/23/12 3:00 AM	0.00	0.00	0.00
4/23/12 5:00 AM	0.00	0.00	0.00
4/23/12 7:00 AM	0.00	0.00	0.00
4/23/12 9:00 AM	0.00	0.00	0.00
4/23/12 11:00 AM	0.00	0.00	0.00
4/23/12 1:00 PM	0.00	0.00	0.00
4/23/12 3:00 PM	0.00	0.00	0.00
4/23/12 5:00 PM	0.00	0.00	0.00
4/23/12 7:00 PM	0.00	0.00	0.00
4/23/12 9:00 PM	0.00	0.00	0.00
4/23/12 11:00 PM	0.00	0.00	0.00
4/24/12 1:00 AM	0.00	0.00	0.00
4/24/12 3:00 AM	0.00	0.00	0.00
4/24/12 5:00 AM	0.00	0.00	0.00
4/24/12 7:00 AM	0.00	0.00	0.00
4/24/12 9:00 AM	0.00	0.00	0.00
4/24/12 11:00 AM	0.00	0.00	0.00
4/24/12 1:00 PM	0.00	0.00	0.00
4/24/12 3:00 PM	0.00	0.00	0.00
4/24/12 5:00 PM	0.00	0.00	0.00
4/24/12 7:00 PM	0.00	0.00	0.00
4/24/12 9:00 PM	0.00	0.00	0.00
4/24/12 11:00 PM	0.00	0.00	0.03
4/25/12 1:00 AM	0.00	0.00	0.12
4/25/12 3:00 AM	0.00	0.00	0.19

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
4/25/12 5:00 AM	0.00	0.00	0.19
4/25/12 7:00 AM	0.00	0.00	0.25
4/25/12 9:00 AM	0.00	0.00	0.11
4/25/12 11:00 AM	0.00	0.00	0.12
4/25/12 1:00 PM	0.00	0.00	0.12
4/25/12 3:00 PM	0.00	0.00	0.13
4/25/12 5:00 PM	0.00	0.00	0.16
4/25/12 7:00 PM	0.00	0.00	0.18
4/25/12 9:00 PM	0.00	0.00	0.19
4/25/12 11:00 PM	0.00	0.00	0.20
4/26/12 1:00 AM	0.00	0.00	0.20
4/26/12 3:00 AM	0.00	0.00	0.20
4/26/12 5:00 AM	0.00	0.00	0.21
4/26/12 7:00 AM	0.00	0.00	0.23
4/26/12 9:00 AM	0.00	0.00	0.24
4/26/12 11:00 AM	0.00	0.00	0.25
4/26/12 1:00 PM	0.00	0.00	0.26
4/26/12 3:00 PM	0.00	0.00	0.26
4/26/12 5:00 PM	0.00	0.00	0.23
4/26/12 7:00 PM	0.00	0.00	0.23
4/26/12 9:00 PM	0.00	0.00	0.24
4/26/12 11:00 PM	0.00	0.00	0.24
4/27/12 1:00 AM	0.00	0.00	0.24
4/27/12 3:00 AM	0.00	0.00	0.25
4/27/12 5:00 AM	0.00	0.00	0.29
4/27/12 7:00 AM	0.00	0.00	0.13
4/27/12 9:00 AM	0.00	0.00	0.09
4/27/12 11:00 AM	0.00	0.00	0.10
4/27/12 1:00 PM	0.00	0.00	0.10
4/27/12 3:00 PM	0.00	0.00	0.11
4/27/12 5:00 PM	0.00	0.00	0.12
4/27/12 7:00 PM	0.00	0.00	0.13
4/27/12 9:00 PM	0.00	0.00	0.15
4/27/12 11:00 PM	0.00	0.00	0.16
4/28/12 1:00 AM	0.00	0.00	0.18
4/28/12 3:00 AM	0.00	0.00	0.18
4/28/12 5:00 AM	0.00	0.00	0.20
4/28/12 7:00 AM	0.00	0.00	0.22
4/28/12 9:00 AM	0.00	0.00	0.22
4/28/12 11:00 AM	0.00	0.00	0.21
4/28/12 1:00 PM	0.00	0.00	0.19
4/28/12 3:00 PM	0.00	0.00	0.23
4/28/12 5:00 PM	0.00	0.00	0.24
4/28/12 7:00 PM	0.00	0.00	0.26
4/28/12 9:00 PM	0.00	0.00	0.15
4/28/12 11:00 PM	0.00	0.00	0.16
4/29/12 1:00 AM	0.00	0.00	0.19
4/29/12 3:00 AM	0.00	0.00	0.21
4/29/12 5:00 AM	0.00	0.00	0.21
4/29/12 7:00 AM	0.00	0.00	0.22
4/29/12 9:00 AM	0.00	0.00	0.25
4/29/12 11:00 AM	0.00	0.00	0.25
4/29/12 1:00 PM	0.00	0.00	0.24

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
4/29/12 3:00 PM	0.00	0.00	0.11
4/29/12 5:00 PM	0.00	0.00	0.07
4/29/12 7:00 PM	0.00	0.00	0.08
4/29/12 9:00 PM	0.00	0.00	0.13
4/29/12 11:00 PM	0.00	0.00	0.15
4/30/12 1:00 AM	0.00	0.00	0.18
4/30/12 3:00 AM	0.00	0.00	0.18
4/30/12 5:00 AM	0.00	0.00	0.20
4/30/12 7:00 AM	0.00	0.00	0.22
4/30/12 9:00 AM	0.00	0.00	0.04
4/30/12 11:00 AM	0.00	0.00	0.00
4/30/12 1:00 PM	0.00	0.00	0.00
4/30/12 3:00 PM	0.00	0.00	0.00
4/30/12 5:00 PM	0.00	0.00	0.00
4/30/12 7:00 PM	0.00	0.04	0.00
4/30/12 9:00 PM	0.00	0.05	0.00
4/30/12 11:00 PM	0.00	0.08	0.00
5/1/12 1:00 AM	0.00	0.18	0.00
5/1/12 3:00 AM	0.00	0.24	0.00
5/1/12 5:00 AM	0.00	0.26	0.00
5/1/12 7:00 AM	0.00	0.27	0.00
5/1/12 9:00 AM	0.00	0.31	0.00
5/1/12 11:00 AM	0.00	0.30	0.00
5/1/12 1:00 PM	0.00	0.29	0.00
5/1/12 3:00 PM	0.00	0.24	0.00
5/1/12 5:00 PM	0.00	0.19	0.00
5/1/12 7:00 PM	0.00	0.19	0.00
5/1/12 9:00 PM	0.00	0.16	0.00
5/1/12 11:00 PM	0.00	0.06	0.00
5/2/12 1:00 AM	0.00	0.05	0.10
5/2/12 3:00 AM	0.00	0.06	0.14
5/2/12 5:00 AM	0.00	0.06	0.14
5/2/12 7:00 AM	0.00	0.19	0.26
5/2/12 9:00 AM	0.00	0.26	0.36
5/2/12 11:00 AM	0.00	0.27	0.04
5/2/12 1:00 PM	0.00	0.26	0.00
5/2/12 3:00 PM	0.00	0.22	0.02
5/2/12 5:00 PM	0.00	0.21	0.09
5/2/12 7:00 PM	0.00	0.21	0.18
5/2/12 9:00 PM	0.00	0.22	0.17
5/2/12 11:00 PM	0.00	0.16	0.16
5/3/12 1:00 AM	0.00	0.17	0.10
5/3/12 3:00 AM	0.00	0.17	0.09
5/3/12 5:00 AM	0.00	0.16	0.11
5/3/12 7:00 AM	0.00	0.16	0.17
5/3/12 9:00 AM	0.00	0.15	0.15
5/3/12 11:00 AM	0.00	0.18	0.14
5/3/12 1:00 PM	0.00	0.18	0.14
5/3/12 3:00 PM	0.00	0.19	0.14
5/3/12 5:00 PM	0.00	0.22	0.14
5/3/12 7:00 PM	0.00	0.24	0.14
5/3/12 9:00 PM	0.00	0.21	0.14
5/3/12 11:00 PM	0.00	0.11	0.14

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
5/4/12 1:00 AM	0.00	0.00	0.14
5/4/12 3:00 AM	0.00	0.00	0.14
5/4/12 5:00 AM	0.00	0.00	0.13
5/4/12 7:00 AM	0.00	0.00	0.13
5/4/12 9:00 AM	0.00	0.00	0.13
5/4/12 11:00 AM	0.00	0.09	0.13
5/4/12 1:00 PM	0.00	0.24	0.13
5/4/12 3:00 PM	0.00	0.25	0.13
5/4/12 5:00 PM	0.00	0.24	0.12
5/4/12 7:00 PM	0.00	0.23	0.13
5/4/12 9:00 PM	0.00	0.24	0.14
5/4/12 11:00 PM	0.00	0.24	0.14
5/5/12 1:00 AM	0.00	0.24	0.14
5/5/12 3:00 AM	0.00	0.24	0.15
5/5/12 5:00 AM	0.00	0.24	0.15
5/5/12 7:00 AM	0.00	0.24	0.17
5/5/12 9:00 AM	0.00	0.26	0.18
5/5/12 11:00 AM	0.00	0.28	0.19
5/5/12 1:00 PM	0.00	0.28	0.20
5/5/12 3:00 PM	0.00	0.32	0.21
5/5/12 5:00 PM	0.00	0.31	0.21
5/5/12 7:00 PM	0.00	0.26	0.23
5/5/12 9:00 PM	0.00	0.19	0.25
5/5/12 11:00 PM	0.00	0.20	0.27
5/6/12 1:00 AM	0.00	0.21	0.27
5/6/12 3:00 AM	0.00	0.22	0.27
5/6/12 5:00 AM	0.00	0.22	0.23
5/6/12 7:00 AM	0.00	0.23	0.09
5/6/12 9:00 AM	0.00	0.23	0.09
5/6/12 11:00 AM	0.00	0.23	0.10
5/6/12 1:00 PM	0.00	0.23	0.11
5/6/12 3:00 PM	0.00	0.23	0.13
5/6/12 5:00 PM	0.00	0.24	0.14
5/6/12 7:00 PM	0.00	0.23	0.15
5/6/12 9:00 PM	0.00	0.22	0.17
5/6/12 11:00 PM	0.00	0.20	0.18
5/7/12 1:00 AM	0.00	0.20	0.20
5/7/12 3:00 AM	0.00	0.22	0.21
5/7/12 5:00 AM	0.00	0.22	0.23
5/7/12 7:00 AM	0.00	0.21	0.23
5/7/12 9:00 AM	0.00	0.21	0.24
5/7/12 11:00 AM	0.00	0.19	0.24
5/7/12 1:00 PM	0.00	0.19	0.26
5/7/12 3:00 PM	0.00	0.18	0.27
5/7/12 5:00 PM	0.00	0.17	0.27
5/7/12 7:00 PM	0.00	0.17	0.26
5/7/12 9:00 PM	0.00	0.17	0.24
5/7/12 11:00 PM	0.00	0.15	0.24
5/8/12 1:00 AM	0.00	0.15	0.15
5/8/12 3:00 AM	0.00	0.13	0.15
5/8/12 5:00 AM	0.00	0.13	0.20
5/8/12 7:00 AM	0.00	0.15	0.20
5/8/12 9:00 AM	0.00	0.15	0.17

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
5/8/12 11:00 AM	0.00	0.16	0.15
5/8/12 1:00 PM	0.00	0.17	0.14
5/8/12 3:00 PM	0.00	0.16	0.14
5/8/12 5:00 PM	0.00	0.15	0.13
5/8/12 7:00 PM	0.00	0.15	0.12
5/8/12 9:00 PM	0.00	0.14	0.12
5/8/12 11:00 PM	0.00	0.12	0.12
5/9/12 1:00 AM	0.00	0.08	0.12
5/9/12 3:00 AM	0.00	0.08	0.11
5/9/12 5:00 AM	0.00	0.13	0.11
5/9/12 7:00 AM	0.00	0.14	0.10
5/9/12 9:00 AM	0.00	0.14	0.11
5/9/12 11:00 AM	0.00	0.13	0.11
5/9/12 1:00 PM	0.00	0.12	0.10
5/9/12 3:00 PM	0.00	0.12	0.10
5/9/12 5:00 PM	0.00	0.11	0.11
5/9/12 7:00 PM	0.00	0.11	0.10
5/9/12 9:00 PM	0.00	0.12	0.10
5/9/12 11:00 PM	0.00	0.11	0.10
5/10/12 1:00 AM	0.00	0.11	0.09
5/10/12 3:00 AM	0.00	0.10	0.09
5/10/12 5:00 AM	0.00	0.10	0.10
5/10/12 7:00 AM	0.00	0.10	0.10
5/10/12 9:00 AM	0.00	0.10	0.09
5/10/12 11:00 AM	0.00	0.10	0.09
5/10/12 1:00 PM	0.00	0.10	0.10
5/10/12 3:00 PM	0.00	0.09	0.10
5/10/12 5:00 PM	0.00	0.09	0.09
5/10/12 7:00 PM	0.00	0.09	0.09
5/10/12 9:00 PM	0.00	0.10	0.09
5/10/12 11:00 PM	0.00	0.07	0.10
5/11/12 1:00 AM	0.00	0.07	0.10
5/11/12 3:00 AM	0.00	0.06	0.11
5/11/12 5:00 AM	0.00	0.06	0.11
5/11/12 7:00 AM	0.00	0.09	0.11
5/11/12 9:00 AM	0.00	0.08	0.11
5/11/12 11:00 AM	0.00	0.08	0.10
5/11/12 1:00 PM	0.00	0.08	0.09
5/11/12 3:00 PM	0.00	0.07	0.09
5/11/12 5:00 PM	0.00	0.08	0.09
5/11/12 7:00 PM	0.00	0.08	0.09
5/11/12 9:00 PM	0.00	0.08	0.09
5/11/12 11:00 PM	0.00	0.08	0.10
5/12/12 1:00 AM	0.00	0.08	0.07
5/12/12 3:00 AM	0.00	0.07	0.10
5/12/12 5:00 AM	0.00	0.07	0.10
5/12/12 7:00 AM	0.00	0.08	0.10
5/12/12 9:00 AM	0.00	0.08	0.10
5/12/12 11:00 AM	0.00	0.09	0.10
5/12/12 1:00 PM	0.00	0.10	0.10
5/12/12 3:00 PM	0.00	0.10	0.09
5/12/12 5:00 PM	0.00	0.10	0.10
5/12/12 7:00 PM	0.00	0.11	0.10

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
5/12/12 9:00 PM	0.00	0.11	0.10
5/12/12 11:00 PM	0.00	0.11	0.09
5/13/12 1:00 AM	0.00	0.11	0.10
5/13/12 3:00 AM	0.00	0.10	0.10
5/13/12 5:00 AM	0.00	0.10	0.10
5/13/12 7:00 AM	0.00	0.11	0.09
5/13/12 9:00 AM	0.00	0.11	0.10
5/13/12 11:00 AM	0.00	0.10	0.09
5/13/12 1:00 PM	0.00	0.10	0.09
5/13/12 3:00 PM	0.00	0.11	0.09
5/13/12 5:00 PM	0.00	0.11	0.09
5/13/12 7:00 PM	0.00	0.11	0.09
5/13/12 9:00 PM	0.00	0.11	0.09
5/13/12 11:00 PM	0.00	0.11	0.09
5/14/12 1:00 AM	0.00	0.06	0.08
5/14/12 3:00 AM	0.00	0.07	0.06
5/14/12 5:00 AM	0.00	0.10	0.05
5/14/12 7:00 AM	0.00	0.12	0.05
5/14/12 9:00 AM	0.00	0.12	0.05
5/14/12 11:00 AM	0.00	0.12	0.05
5/14/12 1:00 PM	0.00	0.11	0.05
5/14/12 3:00 PM	0.00	0.12	0.06
5/14/12 5:00 PM	0.00	0.11	0.06
5/14/12 7:00 PM	0.00	0.11	0.06
5/14/12 9:00 PM	0.00	0.10	0.06
5/14/12 11:00 PM	0.00	0.11	0.04
5/15/12 1:00 AM	0.00	0.10	0.04
5/15/12 3:00 AM	0.00	0.10	0.04
5/15/12 5:00 AM	0.00	0.09	0.08
5/15/12 7:00 AM	0.00	0.09	0.09
5/15/12 9:00 AM	0.00	0.10	0.09
5/15/12 11:00 AM	0.00	0.10	0.09
5/15/12 1:00 PM	0.00	0.10	0.09
5/15/12 3:00 PM	0.00	0.08	0.09
5/15/12 5:00 PM	0.00	0.08	0.09
5/15/12 7:00 PM	0.00	0.09	0.10
5/15/12 9:00 PM	0.00	0.11	0.10
5/15/12 11:00 PM	0.00	0.08	0.10
5/16/12 1:00 AM	0.00	0.06	0.10
5/16/12 3:00 AM	0.00	0.06	0.10
5/16/12 5:00 AM	0.00	0.08	0.10
5/16/12 7:00 AM	0.00	0.10	0.11
5/16/12 9:00 AM	0.00	0.10	0.11
5/16/12 11:00 AM	0.00	0.10	0.11
5/16/12 1:00 PM	0.00	0.10	0.10
5/16/12 3:00 PM	0.00	0.10	0.11
5/16/12 5:00 PM	0.00	0.09	0.11
5/16/12 7:00 PM	0.00	0.10	0.12
5/16/12 9:00 PM	0.00	0.10	0.10
5/16/12 11:00 PM	0.00	0.10	0.05
5/17/12 1:00 AM	0.00	0.10	0.05
5/17/12 3:00 AM	0.00	0.11	0.05
5/17/12 5:00 AM	0.00	0.11	0.06

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
5/17/12 7:00 AM	0.00	0.11	0.06
5/17/12 9:00 AM	0.00	0.13	0.11
5/17/12 11:00 AM	0.00	0.14	0.24
5/17/12 1:00 PM	0.00	0.12	0.24
5/17/12 3:00 PM	0.00	0.11	0.22
5/17/12 5:00 PM	0.00	0.12	0.21
5/17/12 7:00 PM	0.00	0.12	0.22
5/17/12 9:00 PM	0.00	0.11	0.23
5/17/12 11:00 PM	0.00	0.08	0.22
5/18/12 1:00 AM	0.00	0.09	0.22
5/18/12 3:00 AM	0.00	0.09	0.23
5/18/12 5:00 AM	0.00	0.10	0.23
5/18/12 7:00 AM	0.00	0.11	0.22
5/18/12 9:00 AM	0.00	0.11	0.24
5/18/12 11:00 AM	0.00	0.12	0.21
5/18/12 1:00 PM	0.00	0.12	0.20
5/18/12 3:00 PM	0.00	0.12	0.18
5/18/12 5:00 PM	0.00	0.13	0.16
5/18/12 7:00 PM	0.00	0.13	0.16
5/18/12 9:00 PM	0.00	0.13	0.15
5/18/12 11:00 PM	0.00	0.13	0.12
5/19/12 1:00 AM	0.00	0.13	0.08
5/19/12 3:00 AM	0.00	0.13	0.08
5/19/12 5:00 AM	0.00	0.13	0.08
5/19/12 7:00 AM	0.00	0.13	0.12
5/19/12 9:00 AM	0.00	0.14	0.14
5/19/12 11:00 AM	0.00	0.14	0.14
5/19/12 1:00 PM	0.00	0.14	0.14
5/19/12 3:00 PM	0.00	0.15	0.14
5/19/12 5:00 PM	0.00	0.14	0.13
5/19/12 7:00 PM	0.00	0.13	0.13
5/19/12 9:00 PM	0.00	0.12	0.13
5/19/12 11:00 PM	0.00	0.12	0.13
5/20/12 1:00 AM	0.00	0.07	0.13
5/20/12 3:00 AM	0.00	0.06	0.13
5/20/12 5:00 AM	0.00	0.05	0.10
5/20/12 7:00 AM	0.00	0.06	0.12
5/20/12 9:00 AM	0.00	0.10	0.12
5/20/12 11:00 AM	0.00	0.10	0.12
5/20/12 1:00 PM	0.00	0.10	0.12
5/20/12 3:00 PM	0.00	0.10	0.12
5/20/12 5:00 PM	0.00	0.10	0.12
5/20/12 7:00 PM	0.00	0.10	0.12
5/20/12 9:00 PM	0.00	0.09	0.11
5/20/12 11:00 PM	0.00	0.10	0.11
5/21/12 1:00 AM	0.00	0.10	0.09
5/21/12 3:00 AM	0.00	0.09	0.09
5/21/12 5:00 AM	0.00	0.10	0.12
5/21/12 7:00 AM	0.00	0.10	0.10
5/21/12 9:00 AM	0.00	0.10	0.07
5/21/12 11:00 AM	0.00	0.11	0.07
5/21/12 1:00 PM	0.00	0.10	0.07
5/21/12 3:00 PM	0.00	0.11	0.07

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
5/21/12 5:00 PM	0.00	0.11	0.07
5/21/12 7:00 PM	0.00	0.10	0.08
5/21/12 9:00 PM	0.00	0.09	0.09
5/21/12 11:00 PM	0.00	0.07	0.08
5/22/12 1:00 AM	0.00	0.06	0.08
5/22/12 3:00 AM	0.00	0.06	0.09
5/22/12 5:00 AM	0.00	0.07	0.10
5/22/12 7:00 AM	0.00	0.10	0.09
5/22/12 9:00 AM	0.00	0.10	0.09
5/22/12 11:00 AM	0.00	0.09	0.09
5/22/12 1:00 PM	0.00	0.09	0.09
5/22/12 3:00 PM	0.00	0.09	0.09
5/22/12 5:00 PM	0.00	0.09	0.09
5/22/12 7:00 PM	0.00	0.10	0.09
5/22/12 9:00 PM	0.00	0.10	0.09
5/22/12 11:00 PM	0.00	0.08	0.10
5/23/12 1:00 AM	0.00	0.00	0.09
5/23/12 3:00 AM	0.00	0.00	0.09
5/23/12 5:00 AM	0.00	0.00	0.10
5/23/12 7:00 AM	0.00	0.00	0.10
5/23/12 9:00 AM	0.00	0.00	0.11
5/23/12 11:00 AM	0.00	0.00	0.11
5/23/12 1:00 PM	0.00	0.00	0.10
5/23/12 3:00 PM	0.00	0.00	0.10
5/23/12 5:00 PM	0.00	0.00	0.11
5/23/12 7:00 PM	0.00	0.00	0.11
5/23/12 9:00 PM	0.00	0.00	0.13
5/23/12 11:00 PM	0.00	0.00	0.09
5/24/12 1:00 AM	0.00	0.00	0.07
5/24/12 3:00 AM	0.00	0.00	0.00
5/24/12 5:00 AM	0.00	0.00	0.00
5/24/12 7:00 AM	0.00	0.00	0.00
5/24/12 9:00 AM	0.00	0.00	0.00
5/24/12 11:00 AM	0.00	0.00	0.00
5/24/12 1:00 PM	0.00	0.00	0.00
5/24/12 3:00 PM	0.00	0.00	0.00
5/24/12 5:00 PM	0.00	0.00	0.00
5/24/12 7:00 PM	0.00	0.00	0.00
5/24/12 9:00 PM	0.00	0.00	0.00
5/24/12 11:00 PM	0.00	0.00	0.00
5/25/12 1:00 AM	0.00	0.00	0.00
5/25/12 3:00 AM	0.00	0.00	0.00
5/25/12 5:00 AM	0.00	0.00	0.00
5/25/12 7:00 AM	0.00	0.00	0.00
5/25/12 9:00 AM	0.00	0.00	0.00
5/25/12 11:00 AM	0.00	0.00	0.00
5/25/12 1:00 PM	0.00	0.00	0.00
5/25/12 3:00 PM	0.00	0.00	0.00
5/25/12 5:00 PM	0.00	0.00	0.00
5/25/12 7:00 PM	0.00	0.00	0.00
5/25/12 9:00 PM	0.00	0.00	0.00
5/25/12 11:00 PM	0.00	0.00	0.00
5/26/12 1:00 AM	0.00	0.00	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
5/26/12 3:00 AM	0.00	0.00	0.00
5/26/12 5:00 AM	0.00	0.00	0.00
5/26/12 7:00 AM	0.00	0.00	0.00
5/26/12 9:00 AM	0.00	0.00	0.00
5/26/12 11:00 AM	0.00	0.00	0.00
5/26/12 1:00 PM	0.00	0.00	0.00
5/26/12 3:00 PM	0.00	0.00	0.00
5/26/12 5:00 PM	0.00	0.00	0.00
5/26/12 7:00 PM	0.00	0.00	0.00
5/26/12 9:00 PM	0.00	0.00	0.00
5/26/12 11:00 PM	0.00	0.00	0.00
5/27/12 1:00 AM	0.00	0.00	0.00
5/27/12 3:00 AM	0.00	0.00	0.00
5/27/12 5:00 AM	0.00	0.00	0.00
5/27/12 7:00 AM	0.00	0.00	0.00
5/27/12 9:00 AM	0.00	0.00	0.00
5/27/12 11:00 AM	0.00	0.00	0.00
5/27/12 1:00 PM	0.00	0.00	0.00
5/27/12 3:00 PM	0.00	0.00	0.00
5/27/12 5:00 PM	0.00	0.00	0.00
5/27/12 7:00 PM	0.00	0.00	0.41
5/27/12 9:00 PM	0.00	0.00	0.31
5/27/12 11:00 PM	0.00	0.00	0.44
5/28/12 1:00 AM	0.00	0.00	0.31
5/28/12 3:00 AM	0.00	0.00	0.22
5/28/12 5:00 AM	0.00	0.00	0.18
5/28/12 7:00 AM	0.00	0.00	0.14
5/28/12 9:00 AM	0.00	0.00	0.19
5/28/12 11:00 AM	0.00	0.00	0.19
5/28/12 1:00 PM	0.00	0.00	0.17
5/28/12 3:00 PM	0.00	0.00	0.15
5/28/12 5:00 PM	0.00	0.00	0.15
5/28/12 7:00 PM	0.00	0.00	0.14
5/28/12 9:00 PM	0.00	0.00	0.14
5/28/12 11:00 PM	0.00	0.00	0.14
5/29/12 1:00 AM	0.00	0.00	0.14
5/29/12 3:00 AM	0.00	0.00	0.15
5/29/12 5:00 AM	0.00	0.00	0.17
5/29/12 7:00 AM	0.00	0.00	0.18
5/29/12 9:00 AM	0.00	0.00	0.15
5/29/12 11:00 AM	0.00	0.00	0.16
5/29/12 1:00 PM	0.00	0.00	0.17
5/29/12 3:00 PM	0.00	0.00	0.19
5/29/12 5:00 PM	0.00	0.00	0.18
5/29/12 7:00 PM	0.00	0.00	0.20
5/29/12 9:00 PM	0.00	0.00	0.26
5/29/12 11:00 PM	0.00	0.00	0.17
5/30/12 1:00 AM	0.00	0.00	0.17
5/30/12 3:00 AM	0.00	0.00	0.16
5/30/12 5:00 AM	0.00	0.00	0.16
5/30/12 7:00 AM	0.00	0.00	0.14
5/30/12 9:00 AM	0.00	0.00	0.22
5/30/12 11:00 AM	0.12	0.00	0.14

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
5/30/12 1:00 PM	0.12	0.00	0.13
5/30/12 3:00 PM	0.02	0.00	0.18
5/30/12 5:00 PM	0.04	0.00	0.12
5/30/12 7:00 PM	0.09	0.00	0.13
5/30/12 9:00 PM	0.11	0.00	0.17
5/30/12 11:00 PM	0.12	0.00	0.13
5/31/12 1:00 AM	0.11	0.00	0.12
5/31/12 3:00 AM	0.12	0.00	0.09
5/31/12 5:00 AM	0.12	0.00	0.10
5/31/12 7:00 AM	0.12	0.00	0.08
5/31/12 9:00 AM	0.13	0.00	0.08
5/31/12 11:00 AM	0.12	0.00	0.08
5/31/12 1:00 PM	0.12	0.00	0.07
5/31/12 3:00 PM	0.15	0.00	0.07
5/31/12 5:00 PM	0.00	0.00	0.07
5/31/12 7:00 PM	0.14	0.00	0.07
5/31/12 9:00 PM	0.23	0.00	0.06
5/31/12 11:00 PM	0.18	0.00	0.07
6/1/12 1:00 AM	0.17	0.00	0.09
6/1/12 3:00 AM	0.22	0.00	0.08
6/1/12 5:00 AM	0.22	0.00	0.08
6/1/12 7:00 AM	0.15	0.00	0.08
6/1/12 9:00 AM	0.16	0.00	0.07
6/1/12 11:00 AM	0.16	0.00	0.07
6/1/12 1:00 PM	0.15	0.00	0.07
6/1/12 3:00 PM	0.25	0.00	0.07
6/1/12 5:00 PM	0.26	0.00	0.08
6/1/12 7:00 PM	0.27	0.00	0.09
6/1/12 9:00 PM	0.24	0.00	0.06
6/1/12 11:00 PM	0.24	0.00	0.05
6/2/12 1:00 AM	0.21	0.21	0.05
6/2/12 3:00 AM	0.15	0.15	0.07
6/2/12 5:00 AM	0.12	0.12	0.11
6/2/12 7:00 AM	0.14	0.14	0.14
6/2/12 9:00 AM	0.14	0.14	0.15
6/2/12 11:00 AM	0.14	0.00	0.09
6/2/12 1:00 PM	0.13	0.00	0.08
6/2/12 3:00 PM	0.12	0.00	0.07
6/2/12 5:00 PM	0.20	0.00	0.07
6/2/12 7:00 PM	0.24	0.00	0.07
6/2/12 9:00 PM	0.23	0.00	0.09
6/2/12 11:00 PM	0.23	0.00	0.07
6/3/12 1:00 AM	0.24	0.00	0.07
6/3/12 3:00 AM	0.24	0.00	0.08
6/3/12 5:00 AM	0.14	0.00	0.10
6/3/12 7:00 AM	0.17	0.00	0.13
6/3/12 9:00 AM	0.22	0.00	0.07
6/3/12 11:00 AM	0.21	0.00	0.10
6/3/12 1:00 PM	0.19	0.00	0.09
6/3/12 3:00 PM	0.19	0.00	0.11
6/3/12 5:00 PM	0.20	0.20	0.10
6/3/12 7:00 PM	0.20	0.20	0.09
6/3/12 9:00 PM	0.19	0.19	0.08

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
6/3/12 11:00 PM	0.19	0.19	0.09
6/4/12 1:00 AM	0.20	0.20	0.09
6/4/12 3:00 AM	0.14	0.14	0.09
6/4/12 5:00 AM	0.18	0.18	0.09
6/4/12 7:00 AM	0.19	0.19	0.09
6/4/12 9:00 AM	0.22	0.22	0.09
6/4/12 11:00 AM	0.22	0.22	0.08
6/4/12 1:00 PM	0.20	0.20	0.09
6/4/12 3:00 PM	0.23	0.23	0.10
6/4/12 5:00 PM	0.25	0.25	0.09
6/4/12 7:00 PM	0.26	0.26	0.08
6/4/12 9:00 PM	0.28	0.28	0.08
6/4/12 11:00 PM	0.30	0.30	0.05
6/5/12 1:00 AM	0.31	0.31	0.02
6/5/12 3:00 AM	0.29	0.29	0.02
6/5/12 5:00 AM	0.27	0.27	0.03
6/5/12 7:00 AM	0.27	0.27	0.04
6/5/12 9:00 AM	0.27	0.27	0.11
6/5/12 11:00 AM	0.26	0.26	0.11
6/5/12 1:00 PM	0.23	0.23	0.09
6/5/12 3:00 PM	0.19	0.19	0.09
6/5/12 5:00 PM	0.14	0.14	0.09
6/5/12 7:00 PM	0.08	0.08	0.08
6/5/12 9:00 PM	0.00	0.05	0.09
6/5/12 11:00 PM	0.00	0.08	0.09
6/6/12 1:00 AM	0.00	0.23	0.08
6/6/12 3:00 AM	0.00	0.22	0.08
6/6/12 5:00 AM	0.00	0.13	0.08
6/6/12 7:00 AM	0.00	0.14	0.00
6/6/12 9:00 AM	0.00	0.13	0.00
6/6/12 11:00 AM	0.00	0.13	0.00
6/6/12 1:00 PM	0.00	0.12	0.00
6/6/12 3:00 PM	0.00	0.12	0.00
6/6/12 5:00 PM	0.00	0.13	0.00
6/6/12 7:00 PM	0.15	0.15	0.00
6/6/12 9:00 PM	0.21	0.21	0.00
6/6/12 11:00 PM	0.24	0.24	0.00
6/7/12 1:00 AM	0.24	0.24	0.00
6/7/12 3:00 AM	0.25	0.25	0.00
6/7/12 5:00 AM	0.29	0.29	0.00
6/7/12 7:00 AM	0.20	0.20	0.00
6/7/12 9:00 AM	0.00	0.11	0.00
6/7/12 11:00 AM	0.00	0.10	0.00
6/7/12 1:00 PM	0.00	0.10	0.00
6/7/12 3:00 PM	0.00	0.10	0.00
6/7/12 5:00 PM	0.00	0.11	0.00
6/7/12 7:00 PM	0.00	0.10	0.00
6/7/12 9:00 PM	0.00	0.10	0.00
6/7/12 11:00 PM	0.00	0.12	0.00
6/8/12 1:00 AM	0.00	0.12	0.00
6/8/12 3:00 AM	0.00	0.12	0.00
6/8/12 5:00 AM	0.00	0.18	0.00
6/8/12 7:00 AM	0.00	0.15	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
6/8/12 9:00 AM	0.00	0.10	0.00
6/8/12 11:00 AM	0.00	0.08	0.00
6/8/12 1:00 PM	0.00	0.08	0.00
6/8/12 3:00 PM	0.00	0.08	0.00
6/8/12 5:00 PM	0.00	0.08	0.00
6/8/12 7:00 PM	0.00	0.08	0.00
6/8/12 9:00 PM	0.00	0.08	0.00
6/8/12 11:00 PM	0.00	0.07	0.00
6/9/12 1:00 AM	0.00	0.08	0.00
6/9/12 3:00 AM	0.00	0.08	0.00
6/9/12 5:00 AM	0.00	0.08	0.00
6/9/12 7:00 AM	0.00	0.08	0.00
6/9/12 9:00 AM	0.00	0.08	0.00
6/9/12 11:00 AM	0.00	0.08	0.00
6/9/12 1:00 PM	0.00	0.08	0.00
6/9/12 3:00 PM	0.00	0.09	0.00
6/9/12 5:00 PM	0.00	0.09	0.00
6/9/12 7:00 PM	0.00	0.09	0.00
6/9/12 9:00 PM	0.00	0.08	0.00
6/9/12 11:00 PM	0.00	0.08	0.00
6/10/12 1:00 AM	0.00	0.08	0.00
6/10/12 3:00 AM	0.00	0.08	0.00
6/10/12 5:00 AM	0.00	0.08	0.00
6/10/12 7:00 AM	0.00	0.09	0.00
6/10/12 9:00 AM	0.00	0.09	0.00
6/10/12 11:00 AM	0.00	0.09	0.00
6/10/12 1:00 PM	0.00	0.08	0.00
6/10/12 3:00 PM	0.00	0.08	0.00
6/10/12 5:00 PM	0.00	0.08	0.00
6/10/12 7:00 PM	0.00	0.08	0.00
6/10/12 9:00 PM	0.00	0.08	0.00
6/10/12 11:00 PM	0.00	0.08	0.00
6/11/12 1:00 AM	0.00	0.09	0.00
6/11/12 3:00 AM	0.00	0.09	0.25
6/11/12 5:00 AM	0.00	0.09	0.25
6/11/12 7:00 AM	0.00	0.10	0.20
6/11/12 9:00 AM	0.00	0.09	0.28
6/11/12 11:00 AM	0.00	0.09	0.21
6/11/12 1:00 PM	0.00	0.09	0.07
6/11/12 3:00 PM	0.00	0.09	0.04
6/11/12 5:00 PM	0.00	0.09	0.04
6/11/12 7:00 PM	0.00	0.09	0.04
6/11/12 9:00 PM	0.00	0.10	0.06
6/11/12 11:00 PM	0.00	0.09	0.00
6/12/12 1:00 AM	0.00	0.09	0.00
6/12/12 3:00 AM	0.00	0.10	0.00
6/12/12 5:00 AM	0.00	0.09	0.00
6/12/12 7:00 AM	0.00	0.09	0.00
6/12/12 9:00 AM	0.00	0.09	0.00
6/12/12 11:00 AM	0.00	0.09	0.00
6/12/12 1:00 PM	0.00	0.09	0.00
6/12/12 3:00 PM	0.00	0.09	0.00
6/12/12 5:00 PM	0.00	0.09	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
6/12/12 7:00 PM	0.00	0.09	0.00
6/12/12 9:00 PM	0.00	0.09	0.00
6/12/12 11:00 PM	0.00	0.09	0.00
6/13/12 1:00 AM	0.00	0.09	0.00
6/13/12 3:00 AM	0.00	0.09	0.74
6/13/12 5:00 AM	0.00	0.09	0.09
6/13/12 7:00 AM	0.00	0.09	0.14
6/13/12 9:00 AM	0.00	0.09	0.13
6/13/12 11:00 AM	0.00	0.09	0.12
6/13/12 1:00 PM	0.00	0.09	0.11
6/13/12 3:00 PM	0.00	0.09	0.12
6/13/12 5:00 PM	0.00	0.09	0.12
6/13/12 7:00 PM	0.00	0.09	0.12
6/13/12 9:00 PM	0.00	0.10	0.13
6/13/12 11:00 PM	0.00	0.08	0.13
6/14/12 1:00 AM	0.00	0.08	0.12
6/14/12 3:00 AM	0.00	0.07	0.13
6/14/12 5:00 AM	0.00	0.08	0.13
6/14/12 7:00 AM	0.00	0.10	0.14
6/14/12 9:00 AM	0.00	0.10	0.14
6/14/12 11:00 AM	0.00	0.11	0.14
6/14/12 1:00 PM	0.00	0.11	0.15
6/14/12 3:00 PM	0.00	0.11	0.15
6/14/12 5:00 PM	0.00	0.10	0.15
6/14/12 7:00 PM	0.00	0.11	0.15
6/14/12 9:00 PM	0.00	0.00	0.15
6/14/12 11:00 PM	0.00	0.00	0.14
6/15/12 1:00 AM	0.00	0.00	0.15
6/15/12 3:00 AM	0.00	0.00	0.16
6/15/12 5:00 AM	0.00	0.00	0.16
6/15/12 7:00 AM	0.00	0.00	0.17
6/15/12 9:00 AM	0.00	0.00	0.18
6/15/12 11:00 AM	0.00	0.00	0.18
6/15/12 1:00 PM	0.00	0.00	0.21
6/15/12 3:00 PM	0.00	0.00	0.14
6/15/12 5:00 PM	0.00	0.00	0.12
6/15/12 7:00 PM	0.00	0.00	0.20
6/15/12 9:00 PM	0.00	0.02	0.07
6/15/12 11:00 PM	0.00	0.08	0.05
6/16/12 1:00 AM	0.00	0.08	0.05
6/16/12 3:00 AM	0.00	0.08	0.06
6/16/12 5:00 AM	0.00	0.08	0.12
6/16/12 7:00 AM	0.00	0.09	0.21
6/16/12 9:00 AM	0.00	0.14	0.21
6/16/12 11:00 AM	0.00	0.14	0.19
6/16/12 1:00 PM	0.00	0.13	0.18
6/16/12 3:00 PM	0.00	0.13	0.18
6/16/12 5:00 PM	0.00	0.13	0.07
6/16/12 7:00 PM	0.00	0.14	0.02
6/16/12 9:00 PM	0.00	0.14	0.00
6/16/12 11:00 PM	0.00	0.14	0.00
6/17/12 1:00 AM	0.00	0.13	0.00
6/17/12 3:00 AM	0.00	0.13	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
6/17/12 5:00 AM	0.00	0.13	0.00
6/17/12 7:00 AM	0.00	0.14	0.00
6/17/12 9:00 AM	0.00	0.15	0.00
6/17/12 11:00 AM	0.00	0.16	0.00
6/17/12 1:00 PM	0.00	0.16	0.00
6/17/12 3:00 PM	0.00	0.16	0.00
6/17/12 5:00 PM	0.00	0.16	0.00
6/17/12 7:00 PM	0.00	0.15	0.00
6/17/12 9:00 PM	0.00	0.13	0.00
6/17/12 11:00 PM	0.00	0.13	0.00
6/18/12 1:00 AM	0.00	0.13	0.00
6/18/12 3:00 AM	0.00	0.12	0.00
6/18/12 5:00 AM	0.00	0.12	0.00
6/18/12 7:00 AM	0.00	0.12	0.26
6/18/12 9:00 AM	0.00	0.12	0.62
6/18/12 11:00 AM	0.00	0.13	0.38
6/18/12 1:00 PM	0.00	0.13	0.25
6/18/12 3:00 PM	0.00	0.13	0.20
6/18/12 5:00 PM	0.00	0.14	0.19
6/18/12 7:00 PM	0.00	0.14	0.00
6/18/12 9:00 PM	0.00	0.15	0.00
6/18/12 11:00 PM	0.00	0.15	0.00
6/19/12 1:00 AM	0.00	0.14	0.00
6/19/12 3:00 AM	0.00	0.15	0.00
6/19/12 5:00 AM	0.00	0.15	0.00
6/19/12 7:00 AM	0.00	0.16	0.00
6/19/12 9:00 AM	0.00	0.15	0.00
6/19/12 11:00 AM	0.00	0.14	0.00
6/19/12 1:00 PM	0.00	0.14	0.00
6/19/12 3:00 PM	0.00	0.14	0.00
6/19/12 5:00 PM	0.00	0.15	0.00
6/19/12 7:00 PM	0.00	0.15	0.00
6/19/12 9:00 PM	0.00	0.15	0.00
6/19/12 11:00 PM	0.00	0.15	0.00
6/20/12 1:00 AM	0.00	0.15	0.00
6/20/12 3:00 AM	0.00	0.15	0.00
6/20/12 5:00 AM	0.00	0.15	0.00
6/20/12 7:00 AM	0.00	0.15	0.00
6/20/12 9:00 AM	0.00	0.15	0.00
6/20/12 11:00 AM	0.00	0.15	0.00
6/20/12 1:00 PM	0.00	0.14	0.00
6/20/12 3:00 PM	0.00	0.14	0.00
6/20/12 5:00 PM	0.00	0.15	0.00
6/20/12 7:00 PM	0.00	0.14	0.00
6/20/12 9:00 PM	0.00	0.14	0.00
6/20/12 11:00 PM	0.00	0.14	0.00
6/21/12 1:00 AM	0.00	0.23	0.00
6/21/12 3:00 AM	0.00	0.21	0.00
6/21/12 5:00 AM	0.00	0.21	0.00
6/21/12 7:00 AM	0.00	0.19	0.00
6/21/12 9:00 AM	0.00	0.19	0.00
6/21/12 11:00 AM	0.00	0.16	0.00
6/21/12 1:00 PM	0.15	0.15	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
6/21/12 3:00 PM	0.25	0.25	0.00
6/21/12 5:00 PM	0.27	0.27	0.00
6/21/12 7:00 PM	0.23	0.23	0.00
6/21/12 9:00 PM	0.23	0.23	0.00
6/21/12 11:00 PM	0.22	0.22	0.00
6/22/12 1:00 AM	0.21	0.21	0.00
6/22/12 3:00 AM	0.18	0.18	0.00
6/22/12 5:00 AM	0.21	0.21	0.00
6/22/12 7:00 AM	0.24	0.24	0.00
6/22/12 9:00 AM	0.23	0.23	0.00
6/22/12 11:00 AM	0.23	0.23	0.00
6/22/12 1:00 PM	0.22	0.22	0.00
6/22/12 3:00 PM	0.24	0.24	0.00
6/22/12 5:00 PM	0.24	0.24	0.00
6/22/12 7:00 PM	0.22	0.22	0.00
6/22/12 9:00 PM	0.23	0.23	0.00
6/22/12 11:00 PM	0.10	0.10	0.00
6/23/12 1:00 AM	0.08	0.08	0.00
6/23/12 3:00 AM	0.09	0.09	0.00
6/23/12 5:00 AM	0.10	0.10	0.00
6/23/12 7:00 AM	0.20	0.20	0.00
6/23/12 9:00 AM	0.19	0.19	0.00
6/23/12 11:00 AM	0.21	0.21	0.00
6/23/12 1:00 PM	0.24	0.24	0.00
6/23/12 3:00 PM	0.24	0.24	0.00
6/23/12 5:00 PM	0.22	0.22	0.00
6/23/12 7:00 PM	0.23	0.23	0.00
6/23/12 9:00 PM	0.24	0.24	0.00
6/23/12 11:00 PM	0.25	0.25	0.00
6/24/12 1:00 AM	0.24	0.24	0.00
6/24/12 3:00 AM	0.26	0.26	0.00
6/24/12 5:00 AM	0.24	0.24	0.00
6/24/12 7:00 AM	0.24	0.24	0.00
6/24/12 9:00 AM	0.24	0.24	0.00
6/24/12 11:00 AM	0.24	0.24	0.00
6/24/12 1:00 PM	0.24	0.24	0.00
6/24/12 3:00 PM	0.23	0.23	0.00
6/24/12 5:00 PM	0.25	0.25	0.00
6/24/12 7:00 PM	0.24	0.24	0.00
6/24/12 9:00 PM	0.24	0.24	0.00
6/24/12 11:00 PM	0.24	0.24	0.00
6/25/12 1:00 AM	0.23	0.23	0.19
6/25/12 3:00 AM	0.25	0.25	0.19
6/25/12 5:00 AM	0.22	0.22	0.19
6/25/12 7:00 AM	0.19	0.19	0.24
6/25/12 9:00 AM	0.18	0.18	0.16
6/25/12 11:00 AM	0.17	0.17	0.15
6/25/12 1:00 PM	0.18	0.18	0.12
6/25/12 3:00 PM	0.18	0.18	0.11
6/25/12 5:00 PM	0.18	0.18	0.09
6/25/12 7:00 PM	0.18	0.18	0.08
6/25/12 9:00 PM	0.20	0.20	0.08
6/25/12 11:00 PM	0.13	0.13	0.06

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
6/26/12 1:00 AM	0.10	0.10	0.04
6/26/12 3:00 AM	0.10	0.10	0.03
6/26/12 5:00 AM	0.12	0.12	0.05
6/26/12 7:00 AM	0.14	0.14	0.03
6/26/12 9:00 AM	0.13	0.13	0.03
6/26/12 11:00 AM	0.15	0.15	0.04
6/26/12 1:00 PM	0.16	0.16	0.04
6/26/12 3:00 PM	0.21	0.21	0.04
6/26/12 5:00 PM	0.23	0.23	0.04
6/26/12 7:00 PM	0.20	0.20	0.03
6/26/12 9:00 PM	0.20	0.20	0.01
6/26/12 11:00 PM	0.22	0.22	0.02
6/27/12 1:00 AM	0.24	0.24	0.03
6/27/12 3:00 AM	0.22	0.22	0.03
6/27/12 5:00 AM	0.25	0.25	0.03
6/27/12 7:00 AM	0.23	0.23	0.03
6/27/12 9:00 AM	0.23	0.23	0.04
6/27/12 11:00 AM	0.23	0.23	0.04
6/27/12 1:00 PM	0.24	0.24	0.04
6/27/12 3:00 PM	0.26	0.26	0.04
6/27/12 5:00 PM	0.25	0.25	0.04
6/27/12 7:00 PM	0.23	0.23	0.04
6/27/12 9:00 PM	0.22	0.22	0.04
6/27/12 11:00 PM	0.20	0.20	0.04
6/28/12 1:00 AM	0.24	0.24	0.04
6/28/12 3:00 AM	0.22	0.22	0.04
6/28/12 5:00 AM	0.23	0.23	0.05
6/28/12 7:00 AM	0.24	0.24	0.05
6/28/12 9:00 AM	0.22	0.22	0.05
6/28/12 11:00 AM	0.24	0.24	0.05
6/28/12 1:00 PM	0.24	0.24	0.05
6/28/12 3:00 PM	0.26	0.26	0.05
6/28/12 5:00 PM	0.25	0.25	0.04
6/28/12 7:00 PM	0.23	0.23	0.04
6/28/12 9:00 PM	0.23	0.23	0.04
6/28/12 11:00 PM	0.23	0.23	0.04
6/29/12 1:00 AM	0.23	0.23	0.04
6/29/12 3:00 AM	0.20	0.20	0.04
6/29/12 5:00 AM	0.27	0.27	0.05
6/29/12 7:00 AM	0.29	0.29	0.04
6/29/12 9:00 AM	0.26	0.26	0.03
6/29/12 11:00 AM	0.25	0.25	0.04
6/29/12 1:00 PM	0.22	0.22	0.04
6/29/12 3:00 PM	0.19	0.19	0.03
6/29/12 5:00 PM	0.19	0.19	0.04
6/29/12 7:00 PM	0.21	0.21	0.03
6/29/12 9:00 PM	0.21	0.21	0.03
6/29/12 11:00 PM	0.22	0.22	0.03
6/30/12 1:00 AM	0.18	0.18	0.03
6/30/12 3:00 AM	0.21	0.21	0.03
6/30/12 5:00 AM	0.21	0.21	0.03
6/30/12 7:00 AM	0.21	0.21	0.03
6/30/12 9:00 AM	0.20	0.20	0.02

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
6/30/12 11:00 AM	0.18	0.18	0.02
6/30/12 1:00 PM	0.20	0.20	0.02
6/30/12 3:00 PM	0.20	0.20	0.02
6/30/12 5:00 PM	0.18	0.18	0.02
6/30/12 7:00 PM	0.19	0.19	0.02
6/30/12 9:00 PM	0.18	0.18	0.02
6/30/12 11:00 PM	0.15	0.15	0.02
7/1/12 1:00 AM	0.15	0.15	0.02
7/1/12 3:00 AM	0.15	0.15	0.02
7/1/12 5:00 AM	0.18	0.18	0.02
7/1/12 7:00 AM	0.23	0.23	0.02
7/1/12 9:00 AM	0.22	0.22	0.02
7/1/12 11:00 AM	0.22	0.22	0.02
7/1/12 1:00 PM	0.20	0.20	0.02
7/1/12 3:00 PM	0.18	0.18	0.02
7/1/12 5:00 PM	0.20	0.20	0.02
7/1/12 7:00 PM	0.20	0.20	0.02
7/1/12 9:00 PM	0.23	0.23	0.00
7/1/12 11:00 PM	0.23	0.23	0.00
7/2/12 1:00 AM	0.23	0.23	0.00
7/2/12 3:00 AM	0.26	0.26	0.00
7/2/12 5:00 AM	0.23	0.23	0.00
7/2/12 7:00 AM	0.24	0.24	0.00
7/2/12 9:00 AM	0.24	0.24	0.00
7/2/12 11:00 AM	0.25	0.25	0.00
7/2/12 1:00 PM	0.22	0.22	0.00
7/2/12 3:00 PM	0.21	0.21	0.00
7/2/12 5:00 PM	0.21	0.21	0.00
7/2/12 7:00 PM	0.21	0.21	0.00
7/2/12 9:00 PM	0.21	0.21	0.00
7/2/12 11:00 PM	0.20	0.20	0.00
7/3/12 1:00 AM	0.20	0.20	0.00
7/3/12 3:00 AM	0.20	0.20	0.00
7/3/12 5:00 AM	0.19	0.19	0.00
7/3/12 7:00 AM	0.20	0.20	0.00
7/3/12 9:00 AM	0.19	0.19	0.00
7/3/12 11:00 AM	0.18	0.18	0.00
7/3/12 1:00 PM	0.18	0.18	0.00
7/3/12 3:00 PM	0.18	0.18	0.00
7/3/12 5:00 PM	0.18	0.18	0.00
7/3/12 7:00 PM	0.19	0.19	0.00
7/3/12 9:00 PM	0.19	0.19	0.00
7/3/12 11:00 PM	0.19	0.19	0.00
7/4/12 1:00 AM	0.10	0.10	0.00
7/4/12 3:00 AM	0.19	0.19	0.00
7/4/12 5:00 AM	0.20	0.20	0.00
7/4/12 7:00 AM	0.23	0.23	0.00
7/4/12 9:00 AM	0.21	0.21	0.00
7/4/12 11:00 AM	0.19	0.19	0.00
7/4/12 1:00 PM	0.08	0.08	0.00
7/4/12 3:00 PM	0.08	0.08	0.00
7/4/12 5:00 PM	0.06	0.06	0.00
7/4/12 7:00 PM	0.09	0.09	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
7/4/12 9:00 PM	0.21	0.21	0.00
7/4/12 11:00 PM	0.23	0.23	0.00
7/5/12 1:00 AM	0.23	0.23	0.00
7/5/12 3:00 AM	0.22	0.22	0.00
7/5/12 5:00 AM	0.22	0.22	0.00
7/5/12 7:00 AM	0.22	0.22	0.00
7/5/12 9:00 AM	0.21	0.21	0.00
7/5/12 11:00 AM	0.20	0.20	0.00
7/5/12 1:00 PM	0.19	0.19	0.00
7/5/12 3:00 PM	0.16	0.16	0.00
7/5/12 5:00 PM	0.15	0.15	0.00
7/5/12 7:00 PM	0.16	0.16	0.00
7/5/12 9:00 PM	0.14	0.14	0.00
7/5/12 11:00 PM	0.14	0.14	0.00
7/6/12 1:00 AM	0.14	0.14	0.00
7/6/12 3:00 AM	0.12	0.12	0.00
7/6/12 5:00 AM	0.13	0.13	0.00
7/6/12 7:00 AM	0.13	0.13	0.00
7/6/12 9:00 AM	0.15	0.15	0.00
7/6/12 11:00 AM	0.15	0.15	0.00
7/6/12 1:00 PM	0.18	0.18	0.00
7/6/12 3:00 PM	0.20	0.20	0.00
7/6/12 5:00 PM	0.20	0.20	0.00
7/6/12 7:00 PM	0.20	0.20	0.00
7/6/12 9:00 PM	0.20	0.20	0.00
7/6/12 11:00 PM	0.20	0.20	0.00
7/7/12 1:00 AM	0.19	0.19	0.00
7/7/12 3:00 AM	0.16	0.16	0.00
7/7/12 5:00 AM	0.22	0.22	0.00
7/7/12 7:00 AM	0.23	0.23	0.00
7/7/12 9:00 AM	0.22	0.22	0.00
7/7/12 11:00 AM	0.22	0.22	0.00
7/7/12 1:00 PM	0.22	0.22	0.00
7/7/12 3:00 PM	0.25	0.25	0.00
7/7/12 5:00 PM	0.28	0.28	0.00
7/7/12 7:00 PM	0.23	0.23	0.00
7/7/12 9:00 PM	0.22	0.22	0.00
7/7/12 11:00 PM	0.23	0.23	0.00
7/8/12 1:00 AM	0.23	0.23	0.00
7/8/12 3:00 AM	0.23	0.23	0.00
7/8/12 5:00 AM	0.23	0.23	0.00
7/8/12 7:00 AM	0.24	0.24	0.00
7/8/12 9:00 AM	0.22	0.22	0.00
7/8/12 11:00 AM	0.22	0.22	0.00
7/8/12 1:00 PM	0.22	0.22	0.00
7/8/12 3:00 PM	0.21	0.21	0.00
7/8/12 5:00 PM	0.22	0.22	0.00
7/8/12 7:00 PM	0.23	0.23	0.00
7/8/12 9:00 PM	0.22	0.22	0.00
7/8/12 11:00 PM	0.22	0.22	0.00
7/9/12 1:00 AM	0.21	0.21	0.00
7/9/12 3:00 AM	0.20	0.20	0.00
7/9/12 5:00 AM	0.20	0.20	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
7/9/12 7:00 AM	0.20	0.20	0.00
7/9/12 9:00 AM	0.20	0.20	0.00
7/9/12 11:00 AM	0.18	0.18	0.00
7/9/12 1:00 PM	0.19	0.19	0.00
7/9/12 3:00 PM	0.19	0.19	0.00
7/9/12 5:00 PM	0.19	0.19	0.00
7/9/12 7:00 PM	0.19	0.19	0.00
7/9/12 9:00 PM	0.19	0.19	0.00
7/9/12 11:00 PM	0.20	0.20	0.00
7/10/12 1:00 AM	0.21	0.21	0.00
7/10/12 3:00 AM	0.20	0.20	0.00
7/10/12 5:00 AM	0.21	0.21	0.00
7/10/12 7:00 AM	0.21	0.21	0.00
7/10/12 9:00 AM	0.20	0.20	0.00
7/10/12 11:00 AM	0.19	0.19	0.00
7/10/12 1:00 PM	0.20	0.20	0.00
7/10/12 3:00 PM	0.21	0.21	0.00
7/10/12 5:00 PM	0.21	0.21	0.00
7/10/12 7:00 PM	0.20	0.20	0.00
7/10/12 9:00 PM	0.23	0.23	0.00
7/10/12 11:00 PM	0.22	0.22	0.00
7/11/12 1:00 AM	0.22	0.22	0.00
7/11/12 3:00 AM	0.22	0.22	0.00
7/11/12 5:00 AM	0.22	0.22	0.00
7/11/12 7:00 AM	0.22	0.22	0.00
7/11/12 9:00 AM	0.20	0.20	0.00
7/11/12 11:00 AM	0.20	0.20	0.00
7/11/12 1:00 PM	0.19	0.19	0.00
7/11/12 3:00 PM	0.17	0.17	0.00
7/11/12 5:00 PM	0.22	0.22	0.00
7/11/12 7:00 PM	0.22	0.22	0.00
7/11/12 9:00 PM	0.21	0.21	0.00
7/11/12 11:00 PM	0.21	0.21	0.00
7/12/12 1:00 AM	0.10	0.10	0.00
7/12/12 3:00 AM	0.09	0.09	0.00
7/12/12 5:00 AM	0.16	0.16	0.00
7/12/12 7:00 AM	0.22	0.22	0.00
7/12/12 9:00 AM	0.21	0.21	0.00
7/12/12 11:00 AM	0.21	0.21	0.00
7/12/12 1:00 PM	0.20	0.20	0.00
7/12/12 3:00 PM	0.21	0.21	0.00
7/12/12 5:00 PM	0.21	0.21	0.00
7/12/12 7:00 PM	0.22	0.22	0.00
7/12/12 9:00 PM	0.20	0.20	0.00
7/12/12 11:00 PM	0.09	0.09	0.00
7/13/12 1:00 AM	0.08	0.08	0.00
7/13/12 3:00 AM	0.08	0.08	0.00
7/13/12 5:00 AM	0.13	0.13	0.00
7/13/12 7:00 AM	0.21	0.21	0.00
7/13/12 9:00 AM	0.20	0.20	0.00
7/13/12 11:00 AM	0.19	0.19	0.00
7/13/12 1:00 PM	0.18	0.18	0.00
7/13/12 3:00 PM	0.17	0.17	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
7/13/12 5:00 PM	0.18	0.18	0.00
7/13/12 7:00 PM	0.19	0.19	0.00
7/13/12 9:00 PM	0.19	0.19	0.06
7/13/12 11:00 PM	0.19	0.19	0.07
7/14/12 1:00 AM	0.18	0.18	0.05
7/14/12 3:00 AM	0.18	0.18	0.06
7/14/12 5:00 AM	0.22	0.22	0.07
7/14/12 7:00 AM	0.22	0.22	0.09
7/14/12 9:00 AM	0.23	0.23	0.08
7/14/12 11:00 AM	0.22	0.22	0.07
7/14/12 1:00 PM	0.21	0.21	0.07
7/14/12 3:00 PM	0.21	0.21	0.07
7/14/12 5:00 PM	0.21	0.21	0.06
7/14/12 7:00 PM	0.21	0.21	0.06
7/14/12 9:00 PM	0.23	0.23	0.06
7/14/12 11:00 PM	0.20	0.20	0.06
7/15/12 1:00 AM	0.21	0.21	0.06
7/15/12 3:00 AM	0.20	0.20	0.06
7/15/12 5:00 AM	0.21	0.21	0.06
7/15/12 7:00 AM	0.21	0.21	0.06
7/15/12 9:00 AM	0.20	0.20	0.06
7/15/12 11:00 AM	0.19	0.19	0.05
7/15/12 1:00 PM	0.21	0.21	0.05
7/15/12 3:00 PM	0.20	0.20	0.05
7/15/12 5:00 PM	0.20	0.20	0.05
7/15/12 7:00 PM	0.21	0.21	0.05
7/15/12 9:00 PM	0.22	0.22	0.05
7/15/12 11:00 PM	0.21	0.21	0.05
7/16/12 1:00 AM	0.15	0.15	0.05
7/16/12 3:00 AM	0.09	0.09	0.05
7/16/12 5:00 AM	0.15	0.15	0.05
7/16/12 7:00 AM	0.23	0.23	0.05
7/16/12 9:00 AM	0.23	0.23	0.05
7/16/12 11:00 AM	0.24	0.24	0.05
7/16/12 1:00 PM	0.24	0.24	0.05
7/16/12 3:00 PM	0.23	0.23	0.05
7/16/12 5:00 PM	0.23	0.23	0.05
7/16/12 7:00 PM	0.23	0.23	0.05
7/16/12 9:00 PM	0.23	0.23	0.05
7/16/12 11:00 PM	0.16	0.16	0.04
7/17/12 1:00 AM	0.13	0.13	0.04
7/17/12 3:00 AM	0.13	0.13	0.04
7/17/12 5:00 AM	0.22	0.22	0.04
7/17/12 7:00 AM	0.25	0.25	0.04
7/17/12 9:00 AM	0.23	0.23	0.04
7/17/12 11:00 AM	0.23	0.23	0.04
7/17/12 1:00 PM	0.23	0.23	0.04
7/17/12 3:00 PM	0.23	0.23	0.04
7/17/12 5:00 PM	0.23	0.23	0.04
7/17/12 7:00 PM	0.23	0.23	0.04
7/17/12 9:00 PM	0.24	0.24	0.04
7/17/12 11:00 PM	0.23	0.23	0.07
7/18/12 1:00 AM	0.11	0.11	0.06

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
7/18/12 3:00 AM	0.09	0.09	0.05
7/18/12 5:00 AM	0.08	0.08	0.05
7/18/12 7:00 AM	0.09	0.09	0.05
7/18/12 9:00 AM	0.09	0.09	0.05
7/18/12 11:00 AM	0.15	0.15	0.05
7/18/12 1:00 PM	0.12	0.12	0.05
7/18/12 3:00 PM	0.23	0.23	0.05
7/18/12 5:00 PM	0.23	0.23	0.05
7/18/12 7:00 PM	0.23	0.23	0.05
7/18/12 9:00 PM	0.23	0.23	0.05
7/18/12 11:00 PM	0.23	0.23	0.05
7/19/12 1:00 AM	0.23	0.23	0.04
7/19/12 3:00 AM	0.09	0.09	0.04
7/19/12 5:00 AM	0.09	0.09	0.04
7/19/12 7:00 AM	0.09	0.09	0.04
7/19/12 9:00 AM	0.08	0.08	0.04
7/19/12 11:00 AM	0.10	0.10	0.04
7/19/12 1:00 PM	0.10	0.10	0.05
7/19/12 3:00 PM	0.10	0.10	0.05
7/19/12 5:00 PM	0.08	0.08	0.05
7/19/12 7:00 PM	0.10	0.10	0.05
7/19/12 9:00 PM	0.10	0.10	0.05
7/19/12 11:00 PM	0.12	0.12	0.05
7/20/12 1:00 AM	0.10	0.10	0.05
7/20/12 3:00 AM	0.09	0.09	0.05
7/20/12 5:00 AM	0.09	0.09	0.05
7/20/12 7:00 AM	0.09	0.09	0.05
7/20/12 9:00 AM	0.07	0.07	0.05
7/20/12 11:00 AM	0.08	0.08	0.05
7/20/12 1:00 PM	0.08	0.08	0.05
7/20/12 3:00 PM	0.08	0.08	0.05
7/20/12 5:00 PM	0.08	0.08	0.05
7/20/12 7:00 PM	0.07	0.07	0.05
7/20/12 9:00 PM	0.07	0.07	0.04
7/20/12 11:00 PM	0.07	0.07	0.04
7/21/12 1:00 AM	0.07	0.07	0.04
7/21/12 3:00 AM	0.07	0.07	0.04
7/21/12 5:00 AM	0.07	0.07	0.04
7/21/12 7:00 AM	0.06	0.06	0.04
7/21/12 9:00 AM	0.07	0.07	0.04
7/21/12 11:00 AM	0.07	0.07	0.04
7/21/12 1:00 PM	0.07	0.07	0.04
7/21/12 3:00 PM	0.07	0.07	0.04
7/21/12 5:00 PM	0.07	0.07	0.04
7/21/12 7:00 PM	0.06	0.06	0.05
7/21/12 9:00 PM	0.06	0.06	0.05
7/21/12 11:00 PM	0.06	0.06	0.04
7/22/12 1:00 AM	0.06	0.06	0.04
7/22/12 3:00 AM	0.06	0.06	0.04
7/22/12 5:00 AM	0.06	0.06	0.04
7/22/12 7:00 AM	0.06	0.06	0.04
7/22/12 9:00 AM	0.06	0.06	0.04
7/22/12 11:00 AM	0.06	0.06	0.04

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
7/22/12 1:00 PM	0.06	0.06	0.03
7/22/12 3:00 PM	0.06	0.06	0.03
7/22/12 5:00 PM	0.06	0.06	0.04
7/22/12 7:00 PM	0.06	0.06	0.04
7/22/12 9:00 PM	0.06	0.06	0.04
7/22/12 11:00 PM	0.06	0.06	0.03
7/23/12 1:00 AM	0.06	0.06	0.02
7/23/12 3:00 AM	0.05	0.05	0.02
7/23/12 5:00 AM	0.06	0.06	0.03
7/23/12 7:00 AM	0.07	0.07	0.04
7/23/12 9:00 AM	0.07	0.07	0.04
7/23/12 11:00 AM	0.08	0.08	0.04
7/23/12 1:00 PM	0.09	0.09	0.05
7/23/12 3:00 PM	0.08	0.08	0.07
7/23/12 5:00 PM	0.08	0.08	0.07
7/23/12 7:00 PM	0.09	0.09	0.05
7/23/12 9:00 PM	0.08	0.08	0.05
7/23/12 11:00 PM	0.10	0.10	0.03
7/24/12 1:00 AM	0.10	0.10	0.03
7/24/12 3:00 AM	0.10	0.10	0.03
7/24/12 5:00 AM	0.10	0.10	0.05
7/24/12 7:00 AM	0.18	0.18	0.06
7/24/12 9:00 AM	0.23	0.23	0.06
7/24/12 11:00 AM	0.22	0.22	0.06
7/24/12 1:00 PM	0.22	0.22	0.06
7/24/12 3:00 PM	0.22	0.22	0.17
7/24/12 5:00 PM	0.23	0.23	0.17
7/24/12 7:00 PM	0.23	0.23	0.19
7/24/12 9:00 PM	0.23	0.23	0.08
7/24/12 11:00 PM	0.25	0.25	0.06
7/25/12 1:00 AM	0.10	0.10	0.06
7/25/12 3:00 AM	0.13	0.13	0.06
7/25/12 5:00 AM	0.13	0.13	0.06
7/25/12 7:00 AM	0.27	0.27	0.06
7/25/12 9:00 AM	0.25	0.25	0.06
7/25/12 11:00 AM	0.21	0.21	0.06
7/25/12 1:00 PM	0.18	0.18	0.06
7/25/12 3:00 PM	0.21	0.21	0.06
7/25/12 5:00 PM	0.24	0.24	0.07
7/25/12 7:00 PM	0.22	0.22	0.07
7/25/12 9:00 PM	0.23	0.23	0.07
7/25/12 11:00 PM	0.07	0.07	0.08
7/26/12 1:00 AM	0.10	0.10	0.08
7/26/12 3:00 AM	0.21	0.21	0.09
7/26/12 5:00 AM	0.22	0.22	0.10
7/26/12 7:00 AM	0.20	0.20	0.10
7/26/12 9:00 AM	0.18	0.18	0.10
7/26/12 11:00 AM	0.17	0.17	0.10
7/26/12 1:00 PM	0.20	0.20	0.10
7/26/12 3:00 PM	0.23	0.23	0.10
7/26/12 5:00 PM	0.22	0.22	0.11
7/26/12 7:00 PM	0.20	0.20	0.11
7/26/12 9:00 PM	0.23	0.23	0.11

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
7/26/12 11:00 PM	0.21	0.21	0.11
7/27/12 1:00 AM	0.17	0.17	0.10
7/27/12 3:00 AM	0.19	0.19	0.10
7/27/12 5:00 AM	0.20	0.20	0.10
7/27/12 7:00 AM	0.13	0.13	0.10
7/27/12 9:00 AM	0.13	0.13	0.10
7/27/12 11:00 AM	0.19	0.19	0.11
7/27/12 1:00 PM	0.13	0.13	0.13
7/27/12 3:00 PM	0.07	0.07	0.10
7/27/12 5:00 PM	0.07	0.07	0.10
7/27/12 7:00 PM	0.07	0.07	0.11
7/27/12 9:00 PM	0.07	0.07	0.11
7/27/12 11:00 PM	0.08	0.08	0.11
7/28/12 1:00 AM	0.10	0.10	0.08
7/28/12 3:00 AM	0.27	0.27	0.11
7/28/12 5:00 AM	0.27	0.27	0.11
7/28/12 7:00 AM	0.19	0.19	0.11
7/28/12 9:00 AM	0.19	0.19	0.11
7/28/12 11:00 AM	0.13	0.13	0.11
7/28/12 1:00 PM	0.18	0.18	0.11
7/28/12 3:00 PM	0.07	0.07	0.11
7/28/12 5:00 PM	0.16	0.16	0.11
7/28/12 7:00 PM	0.25	0.25	0.10
7/28/12 9:00 PM	0.21	0.21	0.10
7/28/12 11:00 PM	0.22	0.22	0.10
7/29/12 1:00 AM	0.22	0.22	0.10
7/29/12 3:00 AM	0.22	0.22	0.10
7/29/12 5:00 AM	0.22	0.22	0.10
7/29/12 7:00 AM	0.15	0.15	0.10
7/29/12 9:00 AM	0.19	0.19	0.09
7/29/12 11:00 AM	0.18	0.18	0.09
7/29/12 1:00 PM	0.19	0.19	0.09
7/29/12 3:00 PM	0.17	0.17	0.09
7/29/12 5:00 PM	0.20	0.20	0.09
7/29/12 7:00 PM	0.20	0.20	0.09
7/29/12 9:00 PM	0.19	0.19	0.09
7/29/12 11:00 PM	0.14	0.14	0.09
7/30/12 1:00 AM	0.23	0.23	0.09
7/30/12 3:00 AM	0.08	0.08	0.09
7/30/12 5:00 AM	0.05	0.05	0.09
7/30/12 7:00 AM	0.21	0.21	0.09
7/30/12 9:00 AM	0.24	0.24	0.08
7/30/12 11:00 AM	0.20	0.20	0.07
7/30/12 1:00 PM	0.11	0.11	0.06
7/30/12 3:00 PM	0.04	0.04	0.06
7/30/12 5:00 PM	0.10	0.10	0.05
7/30/12 7:00 PM	0.16	0.16	0.05
7/30/12 9:00 PM	0.17	0.17	0.05
7/30/12 11:00 PM	0.18	0.18	0.04
7/31/12 1:00 AM	0.17	0.17	0.04
7/31/12 3:00 AM	0.18	0.18	0.05
7/31/12 5:00 AM	0.20	0.20	0.05
7/31/12 7:00 AM	0.15	0.15	0.05

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
7/31/12 9:00 AM	0.15	0.15	0.05
7/31/12 11:00 AM	0.15	0.15	0.05
7/31/12 1:00 PM	0.14	0.14	0.05
7/31/12 3:00 PM	0.14	0.14	0.05
7/31/12 5:00 PM	0.15	0.15	0.06
7/31/12 7:00 PM	0.15	0.15	0.06
7/31/12 9:00 PM	0.15	0.15	0.06
7/31/12 11:00 PM	0.15	0.15	0.06
8/1/12 1:00 AM	0.14	0.14	0.06
8/1/12 3:00 AM	0.15	0.15	0.06
8/1/12 5:00 AM	0.15	0.15	0.06
8/1/12 7:00 AM	0.14	0.14	0.06
8/1/12 9:00 AM	0.15	0.15	0.07
8/1/12 11:00 AM	0.16	0.16	0.07
8/1/12 1:00 PM	0.15	0.15	0.07
8/1/12 3:00 PM	0.14	0.14	0.07
8/1/12 5:00 PM	0.14	0.14	0.07
8/1/12 7:00 PM	0.16	0.16	0.07
8/1/12 9:00 PM	0.17	0.17	0.07
8/1/12 11:00 PM	0.16	0.16	0.07
8/2/12 1:00 AM	0.15	0.15	0.07
8/2/12 3:00 AM	0.14	0.14	0.08
8/2/12 5:00 AM	0.13	0.13	0.08
8/2/12 7:00 AM	0.13	0.13	0.08
8/2/12 9:00 AM	0.14	0.14	0.08
8/2/12 11:00 AM	0.14	0.14	0.08
8/2/12 1:00 PM	0.14	0.14	0.08
8/2/12 3:00 PM	0.13	0.13	0.08
8/2/12 5:00 PM	0.12	0.12	0.09
8/2/12 7:00 PM	0.13	0.13	0.09
8/2/12 9:00 PM	0.14	0.14	0.09
8/2/12 11:00 PM	0.14	0.14	0.11
8/3/12 1:00 AM	0.11	0.11	0.20
8/3/12 3:00 AM	0.09	0.09	0.19
8/3/12 5:00 AM	0.14	0.14	0.19
8/3/12 7:00 AM	0.15	0.15	0.20
8/3/12 9:00 AM	0.15	0.15	0.20
8/3/12 11:00 AM	0.17	0.17	0.12
8/3/12 1:00 PM	0.16	0.16	0.08
8/3/12 3:00 PM	0.16	0.16	0.08
8/3/12 5:00 PM	0.16	0.16	0.07
8/3/12 7:00 PM	0.16	0.16	0.07
8/3/12 9:00 PM	0.15	0.15	0.07
8/3/12 11:00 PM	0.14	0.14	0.07
8/4/12 1:00 AM	0.17	0.17	0.07
8/4/12 3:00 AM	0.17	0.17	0.08
8/4/12 5:00 AM	0.16	0.16	0.08
8/4/12 7:00 AM	0.15	0.15	0.09
8/4/12 9:00 AM	0.15	0.15	0.10
8/4/12 11:00 AM	0.15	0.15	0.10
8/4/12 1:00 PM	0.15	0.15	0.10
8/4/12 3:00 PM	0.14	0.14	0.10
8/4/12 5:00 PM	0.14	0.14	0.10

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
8/4/12 7:00 PM	0.16	0.16	0.10
8/4/12 9:00 PM	0.16	0.16	0.10
8/4/12 11:00 PM	0.16	0.16	0.10
8/5/12 1:00 AM	0.17	0.17	0.11
8/5/12 3:00 AM	0.17	0.17	0.11
8/5/12 5:00 AM	0.16	0.16	0.11
8/5/12 7:00 AM	0.16	0.16	0.11
8/5/12 9:00 AM	0.16	0.16	0.12
8/5/12 11:00 AM	0.16	0.16	0.13
8/5/12 1:00 PM	0.17	0.17	0.13
8/5/12 3:00 PM	0.18	0.18	0.13
8/5/12 5:00 PM	0.25	0.25	0.13
8/5/12 7:00 PM	0.26	0.26	0.14
8/5/12 9:00 PM	0.24	0.24	0.13
8/5/12 11:00 PM	0.09	0.09	0.15
8/6/12 1:00 AM	0.12	0.12	0.15
8/6/12 3:00 AM	0.31	0.31	0.15
8/6/12 5:00 AM	0.29	0.29	0.15
8/6/12 7:00 AM	0.27	0.27	0.15
8/6/12 9:00 AM	0.23	0.23	0.16
8/6/12 11:00 AM	0.18	0.18	0.15
8/6/12 1:00 PM	0.08	0.08	0.16
8/6/12 3:00 PM	0.08	0.08	0.15
8/6/12 5:00 PM	0.10	0.10	0.15
8/6/12 7:00 PM	0.10	0.10	0.15
8/6/12 9:00 PM	0.12	0.12	0.16
8/6/12 11:00 PM	0.23	0.23	0.16
8/7/12 1:00 AM	0.26	0.26	0.16
8/7/12 3:00 AM	0.20	0.20	0.15
8/7/12 5:00 AM	0.30	0.30	0.20
8/7/12 7:00 AM	0.31	0.31	0.19
8/7/12 9:00 AM	0.26	0.26	0.18
8/7/12 11:00 AM	0.22	0.22	0.24
8/7/12 1:00 PM	0.10	0.10	0.27
8/7/12 3:00 PM	0.06	0.06	0.22
8/7/12 5:00 PM	0.06	0.06	0.22
8/7/12 7:00 PM	0.06	0.06	0.21
8/7/12 9:00 PM	0.08	0.08	0.20
8/7/12 11:00 PM	0.18	0.18	0.19
8/8/12 1:00 AM	0.29	0.29	0.18
8/8/12 3:00 AM	0.21	0.21	0.17
8/8/12 5:00 AM	0.34	0.34	0.17
8/8/12 7:00 AM	0.37	0.37	0.15
8/8/12 9:00 AM	0.29	0.29	0.14
8/8/12 11:00 AM	0.27	0.27	0.15
8/8/12 1:00 PM	0.23	0.23	0.15
8/8/12 3:00 PM	0.22	0.22	0.13
8/8/12 5:00 PM	0.24	0.24	0.06
8/8/12 7:00 PM	0.21	0.21	0.06
8/8/12 9:00 PM	0.14	0.14	0.06
8/8/12 11:00 PM	0.17	0.17	0.06
8/9/12 1:00 AM	0.20	0.20	0.05
8/9/12 3:00 AM	0.21	0.21	0.05

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
8/9/12 5:00 AM	0.21	0.21	0.05
8/9/12 7:00 AM	0.26	0.26	0.04
8/9/12 9:00 AM	0.20	0.20	0.04
8/9/12 11:00 AM	0.21	0.21	0.04
8/9/12 1:00 PM	0.19	0.19	0.05
8/9/12 3:00 PM	0.19	0.19	0.05
8/9/12 5:00 PM	0.20	0.20	0.05
8/9/12 7:00 PM	0.20	0.20	0.04
8/9/12 9:00 PM	0.22	0.22	0.04
8/9/12 11:00 PM	0.24	0.24	0.04
8/10/12 1:00 AM	0.25	0.25	0.04
8/10/12 3:00 AM	0.25	0.25	0.04
8/10/12 5:00 AM	0.24	0.24	0.04
8/10/12 7:00 AM	0.24	0.24	0.04
8/10/12 9:00 AM	0.19	0.19	0.05
8/10/12 11:00 AM	0.16	0.16	0.10
8/10/12 1:00 PM	0.06	0.06	0.06
8/10/12 3:00 PM	0.06	0.06	0.05
8/10/12 5:00 PM	0.06	0.06	0.05
8/10/12 7:00 PM	0.14	0.14	0.05
8/10/12 9:00 PM	0.18	0.18	0.04
8/10/12 11:00 PM	0.23	0.23	0.05
8/11/12 1:00 AM	0.25	0.25	0.06
8/11/12 3:00 AM	0.23	0.23	0.06
8/11/12 5:00 AM	0.23	0.23	0.06
8/11/12 7:00 AM	0.22	0.22	0.08
8/11/12 9:00 AM	0.19	0.19	0.08
8/11/12 11:00 AM	0.23	0.23	0.06
8/11/12 1:00 PM	0.18	0.18	0.05
8/11/12 3:00 PM	0.19	0.19	0.06
8/11/12 5:00 PM	0.19	0.19	0.06
8/11/12 7:00 PM	0.18	0.18	0.08
8/11/12 9:00 PM	0.21	0.21	0.08
8/11/12 11:00 PM	0.17	0.17	0.08
8/12/12 1:00 AM	0.13	0.13	0.08
8/12/12 3:00 AM	0.14	0.14	0.08
8/12/12 5:00 AM	0.22	0.22	0.08
8/12/12 7:00 AM	0.23	0.23	0.08
8/12/12 9:00 AM	0.21	0.21	0.10
8/12/12 11:00 AM	0.19	0.19	0.10
8/12/12 1:00 PM	0.19	0.19	0.10
8/12/12 3:00 PM	0.20	0.20	0.10
8/12/12 5:00 PM	0.21	0.21	0.10
8/12/12 7:00 PM	0.21	0.21	0.09
8/12/12 9:00 PM	0.26	0.26	0.08
8/12/12 11:00 PM	0.26	0.26	0.08
8/13/12 1:00 AM	0.25	0.25	0.08
8/13/12 3:00 AM	0.23	0.23	0.08
8/13/12 5:00 AM	0.22	0.22	0.08
8/13/12 7:00 AM	0.19	0.19	0.11
8/13/12 9:00 AM	0.20	0.20	0.10
8/13/12 11:00 AM	0.19	0.19	0.10
8/13/12 1:00 PM	0.20	0.20	0.10

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
8/13/12 3:00 PM	0.20	0.20	0.10
8/13/12 5:00 PM	0.20	0.20	0.09
8/13/12 7:00 PM	0.22	0.22	0.09
8/13/12 9:00 PM	0.24	0.24	0.09
8/13/12 11:00 PM	0.25	0.25	0.09
8/14/12 1:00 AM	0.24	0.24	0.09
8/14/12 3:00 AM	0.24	0.24	0.09
8/14/12 5:00 AM	0.23	0.23	0.09
8/14/12 7:00 AM	0.19	0.19	0.09
8/14/12 9:00 AM	0.12	0.12	0.09
8/14/12 11:00 AM	0.16	0.16	0.13
8/14/12 1:00 PM	0.14	0.14	0.00
8/14/12 3:00 PM	0.17	0.17	0.00
8/14/12 5:00 PM	0.17	0.17	0.00
8/14/12 7:00 PM	0.12	0.12	0.00
8/14/12 9:00 PM	0.08	0.08	0.00
8/14/12 11:00 PM	0.13	0.13	0.00
8/15/12 1:00 AM	0.23	0.23	0.00
8/15/12 3:00 AM	0.24	0.24	0.00
8/15/12 5:00 AM	0.24	0.24	0.00
8/15/12 7:00 AM	0.23	0.23	0.00
8/15/12 9:00 AM	0.15	0.15	0.00
8/15/12 11:00 AM	0.06	0.06	0.00
8/15/12 1:00 PM	0.21	0.21	0.00
8/15/12 3:00 PM	0.20	0.20	0.00
8/15/12 5:00 PM	0.20	0.20	0.00
8/15/12 7:00 PM	0.20	0.20	0.00
8/15/12 9:00 PM	0.21	0.21	0.00
8/15/12 11:00 PM	0.25	0.25	0.00
8/16/12 1:00 AM	0.24	0.24	0.00
8/16/12 3:00 AM	0.25	0.25	0.00
8/16/12 5:00 AM	0.23	0.23	0.00
8/16/12 7:00 AM	0.24	0.24	0.00
8/16/12 9:00 AM	0.24	0.24	0.00
8/16/12 11:00 AM	0.24	0.24	0.00
8/16/12 1:00 PM	0.22	0.22	0.00
8/16/12 3:00 PM	0.22	0.22	0.00
8/16/12 5:00 PM	0.22	0.22	0.00
8/16/12 7:00 PM	0.22	0.22	0.00
8/16/12 9:00 PM	0.22	0.22	0.00
8/16/12 11:00 PM	0.26	0.26	0.00
8/17/12 1:00 AM	0.25	0.25	0.00
8/17/12 3:00 AM	0.25	0.25	0.00
8/17/12 5:00 AM	0.12	0.12	0.00
8/17/12 7:00 AM	0.21	0.21	0.00
8/17/12 9:00 AM	0.21	0.21	0.00
8/17/12 11:00 AM	0.11	0.11	0.00
8/17/12 1:00 PM	0.12	0.12	0.00
8/17/12 3:00 PM	0.16	0.16	0.00
8/17/12 5:00 PM	0.20	0.20	0.00
8/17/12 7:00 PM	0.22	0.22	0.00
8/17/12 9:00 PM	0.22	0.22	0.00
8/17/12 11:00 PM	0.23	0.23	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
8/18/12 1:00 AM	0.24	0.24	0.00
8/18/12 3:00 AM	0.24	0.24	0.00
8/18/12 5:00 AM	0.23	0.23	0.00
8/18/12 7:00 AM	0.21	0.21	0.00
8/18/12 9:00 AM	0.24	0.24	0.00
8/18/12 11:00 AM	0.22	0.22	0.00
8/18/12 1:00 PM	0.20	0.20	0.00
8/18/12 3:00 PM	0.18	0.18	0.23
8/18/12 5:00 PM	0.10	0.10	0.15
8/18/12 7:00 PM	0.08	0.08	0.26
8/18/12 9:00 PM	0.13	0.13	0.25
8/18/12 11:00 PM	0.13	0.13	0.14
8/19/12 1:00 AM	0.13	0.13	0.14
8/19/12 3:00 AM	0.13	0.13	0.14
8/19/12 5:00 AM	0.11	0.11	0.14
8/19/12 7:00 AM	0.15	0.15	0.06
8/19/12 9:00 AM	0.20	0.20	0.06
8/19/12 11:00 AM	0.19	0.19	0.05
8/19/12 1:00 PM	0.13	0.13	0.05
8/19/12 3:00 PM	0.13	0.13	0.05
8/19/12 5:00 PM	0.14	0.14	0.05
8/19/12 7:00 PM	0.13	0.13	0.05
8/19/12 9:00 PM	0.13	0.13	0.05
8/19/12 11:00 PM	0.11	0.11	0.05
8/20/12 1:00 AM	0.11	0.11	0.05
8/20/12 3:00 AM	0.12	0.12	0.05
8/20/12 5:00 AM	0.13	0.13	0.06
8/20/12 7:00 AM	0.13	0.13	0.06
8/20/12 9:00 AM	0.14	0.14	0.07
8/20/12 11:00 AM	0.14	0.14	0.07
8/20/12 1:00 PM	0.14	0.14	0.08
8/20/12 3:00 PM	0.15	0.15	0.08
8/20/12 5:00 PM	0.15	0.15	0.09
8/20/12 7:00 PM	0.15	0.15	0.09
8/20/12 9:00 PM	0.13	0.13	0.09
8/20/12 11:00 PM	0.13	0.13	0.10
8/21/12 1:00 AM	0.13	0.13	0.10
8/21/12 3:00 AM	0.13	0.13	0.11
8/21/12 5:00 AM	0.14	0.14	0.11
8/21/12 7:00 AM	0.14	0.14	0.11
8/21/12 9:00 AM	0.14	0.14	0.12
8/21/12 11:00 AM	0.13	0.13	0.12
8/21/12 1:00 PM	0.13	0.13	0.11
8/21/12 3:00 PM	0.14	0.14	0.13
8/21/12 5:00 PM	0.14	0.14	0.14
8/21/12 7:00 PM	0.14	0.14	0.14
8/21/12 9:00 PM	0.13	0.13	0.14
8/21/12 11:00 PM	0.13	0.13	0.14
8/22/12 1:00 AM	0.13	0.00	0.18
8/22/12 3:00 AM	0.13	0.00	0.23
8/22/12 5:00 AM	0.13	0.00	0.18
8/22/12 7:00 AM	0.14	0.00	0.18
8/22/12 9:00 AM	0.13	0.00	0.18

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
8/22/12 11:00 AM	0.13	0.00	0.11
8/22/12 1:00 PM	0.13	0.00	0.12
8/22/12 3:00 PM	0.15	0.00	0.13
8/22/12 5:00 PM	0.14	0.00	0.13
8/22/12 7:00 PM	0.13	0.00	0.14
8/22/12 9:00 PM	0.13	0.00	0.14
8/22/12 11:00 PM	0.13	0.00	0.09
8/23/12 1:00 AM	0.13	0.00	0.05
8/23/12 3:00 AM	0.12	0.00	0.05
8/23/12 5:00 AM	0.12	0.00	0.13
8/23/12 7:00 AM	0.13	0.00	0.18
8/23/12 9:00 AM	0.13	0.00	0.17
8/23/12 11:00 AM	0.12	0.00	0.16
8/23/12 1:00 PM	0.13	0.00	0.15
8/23/12 3:00 PM	0.14	0.00	0.15
8/23/12 5:00 PM	0.13	0.00	0.15
8/23/12 7:00 PM	0.13	0.00	0.15
8/23/12 9:00 PM	0.12	0.00	0.15
8/23/12 11:00 PM	0.10	0.00	0.15
8/24/12 1:00 AM	0.14	0.00	0.15
8/24/12 3:00 AM	0.14	0.00	0.15
8/24/12 5:00 AM	0.14	0.00	0.15
8/24/12 7:00 AM	0.14	0.00	0.16
8/24/12 9:00 AM	0.14	0.00	0.15
8/24/12 11:00 AM	0.14	0.00	0.15
8/24/12 1:00 PM	0.14	0.00	0.15
8/24/12 3:00 PM	0.13	0.00	0.15
8/24/12 5:00 PM	0.13	0.00	0.15
8/24/12 7:00 PM	0.13	0.00	0.15
8/24/12 9:00 PM	0.14	0.00	0.15
8/24/12 11:00 PM	0.14	0.00	0.15
8/25/12 1:00 AM	0.14	0.00	0.16
8/25/12 3:00 AM	0.14	0.00	0.16
8/25/12 5:00 AM	0.14	0.00	0.16
8/25/12 7:00 AM	0.14	0.00	0.16
8/25/12 9:00 AM	0.15	0.00	0.16
8/25/12 11:00 AM	0.15	0.00	0.17
8/25/12 1:00 PM	0.22	0.00	0.16
8/25/12 3:00 PM	0.27	0.00	0.16
8/25/12 5:00 PM	0.30	0.00	0.16
8/25/12 7:00 PM	0.32	0.00	0.16
8/25/12 9:00 PM	0.28	0.00	0.15
8/25/12 11:00 PM	0.27	0.00	0.15
8/26/12 1:00 AM	0.23	0.00	0.13
8/26/12 3:00 AM	0.17	0.00	0.12
8/26/12 5:00 AM	0.17	0.00	0.12
8/26/12 7:00 AM	0.24	0.00	0.13
8/26/12 9:00 AM	0.28	0.00	0.15
8/26/12 11:00 AM	0.31	0.00	0.14
8/26/12 1:00 PM	0.28	0.00	0.14
8/26/12 3:00 PM	0.23	0.00	0.14
8/26/12 5:00 PM	0.18	0.00	0.14
8/26/12 7:00 PM	0.19	0.00	0.14

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
8/26/12 9:00 PM	0.18	0.00	0.13
8/26/12 11:00 PM	0.23	0.00	0.13
8/27/12 1:00 AM	0.24	0.00	0.12
8/27/12 3:00 AM	0.25	0.00	0.11
8/27/12 5:00 AM	0.22	0.00	0.12
8/27/12 7:00 AM	0.20	0.00	0.12
8/27/12 9:00 AM	0.21	0.00	0.12
8/27/12 11:00 AM	0.22	0.00	0.12
8/27/12 1:00 PM	0.21	0.00	0.11
8/27/12 3:00 PM	0.21	0.00	0.11
8/27/12 5:00 PM	0.23	0.00	0.11
8/27/12 7:00 PM	0.32	0.00	0.11
8/27/12 9:00 PM	0.23	0.00	0.11
8/27/12 11:00 PM	0.26	0.00	0.10
8/28/12 1:00 AM	0.26	0.00	0.10
8/28/12 3:00 AM	0.28	0.00	0.11
8/28/12 5:00 AM	0.24	0.00	0.11
8/28/12 7:00 AM	0.25	0.00	0.11
8/28/12 9:00 AM	0.28	0.00	0.11
8/28/12 11:00 AM	0.24	0.00	0.11
8/28/12 1:00 PM	0.21	0.00	0.11
8/28/12 3:00 PM	0.21	0.00	0.11
8/28/12 5:00 PM	0.22	0.00	0.10
8/28/12 7:00 PM	0.21	0.00	0.10
8/28/12 9:00 PM	0.24	0.00	0.10
8/28/12 11:00 PM	0.21	0.00	0.10
8/29/12 1:00 AM	0.22	0.00	0.10
8/29/12 3:00 AM	0.15	0.00	0.10
8/29/12 5:00 AM	0.17	0.00	0.10
8/29/12 7:00 AM	0.24	0.00	0.10
8/29/12 9:00 AM	0.16	0.00	0.10
8/29/12 11:00 AM	0.15	0.00	0.10
8/29/12 1:00 PM	0.24	0.00	0.10
8/29/12 3:00 PM	0.24	0.00	0.10
8/29/12 5:00 PM	0.24	0.00	0.10
8/29/12 7:00 PM	0.26	0.00	0.10
8/29/12 9:00 PM	0.29	0.00	0.10
8/29/12 11:00 PM	0.24	0.00	0.10
8/30/12 1:00 AM	0.23	0.00	0.10
8/30/12 3:00 AM	0.24	0.00	0.10
8/30/12 5:00 AM	0.26	0.00	0.10
8/30/12 7:00 AM	0.24	0.00	0.11
8/30/12 9:00 AM	0.24	0.00	0.11
8/30/12 11:00 AM	0.28	0.00	0.12
8/30/12 1:00 PM	0.17	0.00	0.13
8/30/12 3:00 PM	0.18	0.00	0.11
8/30/12 5:00 PM	0.20	0.00	0.10
8/30/12 7:00 PM	0.20	0.00	0.11
8/30/12 9:00 PM	0.21	0.00	0.11
8/30/12 11:00 PM	0.20	0.00	0.11
8/31/12 1:00 AM	0.20	0.00	0.11
8/31/12 3:00 AM	0.15	0.00	0.11
8/31/12 5:00 AM	0.20	0.00	0.11

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
8/31/12 7:00 AM	0.20	0.00	0.11
8/31/12 9:00 AM	0.20	0.00	0.11
8/31/12 11:00 AM	0.23	0.00	0.11
8/31/12 1:00 PM	0.23	0.00	0.11
8/31/12 3:00 PM	0.23	0.00	0.11
8/31/12 5:00 PM	0.23	0.00	0.11
8/31/12 7:00 PM	0.20	0.00	0.11
8/31/12 9:00 PM	0.21	0.00	0.11
8/31/12 11:00 PM	0.21	0.00	0.10
9/1/12 1:00 AM	0.22	0.22	0.11
9/1/12 3:00 AM	0.25	0.25	0.12
9/1/12 5:00 AM	0.25	0.25	0.12
9/1/12 7:00 AM	0.24	0.24	0.12
9/1/12 9:00 AM	0.09	0.09	0.12
9/1/12 11:00 AM	0.06	0.00	0.12
9/1/12 1:00 PM	0.06	0.00	0.11
9/1/12 3:00 PM	0.06	0.00	0.11
9/1/12 5:00 PM	0.23	0.00	0.12
9/1/12 7:00 PM	0.23	0.00	0.11
9/1/12 9:00 PM	0.24	0.00	0.12
9/1/12 11:00 PM	0.23	0.00	0.12
9/2/12 1:00 AM	0.17	0.00	0.12
9/2/12 3:00 AM	0.26	0.00	0.12
9/2/12 5:00 AM	0.27	0.00	0.13
9/2/12 7:00 AM	0.27	0.00	0.13
9/2/12 9:00 AM	0.23	0.00	0.13
9/2/12 11:00 AM	0.23	0.00	0.13
9/2/12 1:00 PM	0.24	0.00	0.13
9/2/12 3:00 PM	0.21	0.00	0.13
9/2/12 5:00 PM	0.21	0.21	0.13
9/2/12 7:00 PM	0.23	0.23	0.14
9/2/12 9:00 PM	0.23	0.23	0.13
9/2/12 11:00 PM	0.26	0.26	0.13
9/3/12 1:00 AM	0.26	0.26	0.13
9/3/12 3:00 AM	0.18	0.18	0.14
9/3/12 5:00 AM	0.15	0.15	0.13
9/3/12 7:00 AM	0.19	0.19	0.14
9/3/12 9:00 AM	0.25	0.25	0.13
9/3/12 11:00 AM	0.22	0.22	0.14
9/3/12 1:00 PM	0.22	0.22	0.13
9/3/12 3:00 PM	0.19	0.19	0.13
9/3/12 5:00 PM	0.19	0.19	0.13
9/3/12 7:00 PM	0.20	0.20	0.14
9/3/12 9:00 PM	0.20	0.20	0.14
9/3/12 11:00 PM	0.21	0.21	0.14
9/4/12 1:00 AM	0.25	0.25	0.14
9/4/12 3:00 AM	0.24	0.24	0.13
9/4/12 5:00 AM	0.23	0.23	0.13
9/4/12 7:00 AM	0.22	0.22	0.13
9/4/12 9:00 AM	0.17	0.17	0.13
9/4/12 11:00 AM	0.10	0.10	0.13
9/4/12 1:00 PM	0.10	0.10	0.13
9/4/12 3:00 PM	0.09	0.09	0.13

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
9/4/12 5:00 PM	0.06	0.06	0.13
9/4/12 7:00 PM	0.07	0.07	0.13
9/4/12 9:00 PM	0.08	0.08	0.13
9/4/12 11:00 PM	0.09	0.09	0.13
9/5/12 1:00 AM	0.08	0.08	0.13
9/5/12 3:00 AM	0.08	0.08	0.12
9/5/12 5:00 AM	0.10	0.10	0.12
9/5/12 7:00 AM	0.11	0.11	0.12
9/5/12 9:00 AM	0.10	0.10	0.11
9/5/12 11:00 AM	0.11	0.11	0.11
9/5/12 1:00 PM	0.10	0.10	0.11
9/5/12 3:00 PM	0.11	0.11	0.10
9/5/12 5:00 PM	0.11	0.11	0.10
9/5/12 7:00 PM	0.10	0.10	0.10
9/5/12 9:00 PM	0.10	0.10	0.10
9/5/12 11:00 PM	0.09	0.09	0.10
9/6/12 1:00 AM	0.10	0.10	0.10
9/6/12 3:00 AM	0.10	0.10	0.14
9/6/12 5:00 AM	0.09	0.09	0.19
9/6/12 7:00 AM	0.10	0.10	0.19
9/6/12 9:00 AM	0.10	0.10	0.20
9/6/12 11:00 AM	0.10	0.10	0.22
9/6/12 1:00 PM	0.10	0.10	0.18
9/6/12 3:00 PM	0.10	0.10	0.11
9/6/12 5:00 PM	0.10	0.10	0.11
9/6/12 7:00 PM	0.10	0.10	0.11
9/6/12 9:00 PM	0.10	0.10	0.11
9/6/12 11:00 PM	0.10	0.10	0.12
9/7/12 1:00 AM	0.09	0.09	0.12
9/7/12 3:00 AM	0.09	0.09	0.13
9/7/12 5:00 AM	0.08	0.08	0.13
9/7/12 7:00 AM	0.09	0.09	0.14
9/7/12 9:00 AM	0.08	0.08	0.14
9/7/12 11:00 AM	0.08	0.08	0.15
9/7/12 1:00 PM	0.08	0.08	0.16
9/7/12 3:00 PM	0.08	0.08	0.15
9/7/12 5:00 PM	0.08	0.08	0.15
9/7/12 7:00 PM	0.09	0.09	0.13
9/7/12 9:00 PM	0.09	0.09	0.12
9/7/12 11:00 PM	0.09	0.09	0.11
9/8/12 1:00 AM	0.09	0.09	0.11
9/8/12 3:00 AM	0.09	0.09	0.11
9/8/12 5:00 AM	0.09	0.09	0.11
9/8/12 7:00 AM	0.09	0.09	0.11
9/8/12 9:00 AM	0.10	0.10	0.11
9/8/12 11:00 AM	0.11	0.11	0.11
9/8/12 1:00 PM	0.10	0.10	0.10
9/8/12 3:00 PM	0.10	0.10	0.11
9/8/12 5:00 PM	0.11	0.11	0.11
9/8/12 7:00 PM	0.14	0.14	0.11
9/8/12 9:00 PM	0.25	0.25	0.11
9/8/12 11:00 PM	0.26	0.26	0.11
9/9/12 1:00 AM	0.25	0.25	0.11

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
9/9/12 3:00 AM	0.23	0.23	0.11
9/9/12 5:00 AM	0.25	0.25	0.11
9/9/12 7:00 AM	0.22	0.22	0.11
9/9/12 9:00 AM	0.21	0.21	0.11
9/9/12 11:00 AM	0.21	0.21	0.11
9/9/12 1:00 PM	0.21	0.21	0.12
9/9/12 3:00 PM	0.20	0.20	0.12
9/9/12 5:00 PM	0.21	0.21	0.12
9/9/12 7:00 PM	0.22	0.22	0.12
9/9/12 9:00 PM	0.24	0.24	0.13
9/9/12 11:00 PM	0.23	0.23	0.13
9/10/12 1:00 AM	0.22	0.22	0.13
9/10/12 3:00 AM	0.22	0.22	0.13
9/10/12 5:00 AM	0.22	0.22	0.13
9/10/12 7:00 AM	0.22	0.22	0.13
9/10/12 9:00 AM	0.22	0.22	0.12
9/10/12 11:00 AM	0.23	0.23	0.12
9/10/12 1:00 PM	0.21	0.21	0.12
9/10/12 3:00 PM	0.23	0.23	0.12
9/10/12 5:00 PM	0.25	0.25	0.12
9/10/12 7:00 PM	0.25	0.25	0.12
9/10/12 9:00 PM	0.22	0.22	0.12
9/10/12 11:00 PM	0.11	0.11	0.13
9/11/12 1:00 AM	0.09	0.09	0.13
9/11/12 3:00 AM	0.13	0.13	0.14
9/11/12 5:00 AM	0.24	0.24	0.14
9/11/12 7:00 AM	0.24	0.24	0.14
9/11/12 9:00 AM	0.15	0.15	0.14
9/11/12 11:00 AM	0.06	0.06	0.14
9/11/12 1:00 PM	0.06	0.06	0.14
9/11/12 3:00 PM	0.06	0.06	0.14
9/11/12 5:00 PM	0.06	0.06	0.14
9/11/12 7:00 PM	0.08	0.08	0.14
9/11/12 9:00 PM	0.11	0.11	0.14
9/11/12 11:00 PM	0.25	0.25	0.13
9/12/12 1:00 AM	0.22	0.22	0.13
9/12/12 3:00 AM	0.23	0.23	0.12
9/12/12 5:00 AM	0.24	0.24	0.13
9/12/12 7:00 AM	0.22	0.22	0.13
9/12/12 9:00 AM	0.17	0.17	0.13
9/12/12 11:00 AM	0.17	0.17	0.13
9/12/12 1:00 PM	0.18	0.18	0.13
9/12/12 3:00 PM	0.22	0.22	0.13
9/12/12 5:00 PM	0.14	0.14	0.13
9/12/12 7:00 PM	0.08	0.08	0.12
9/12/12 9:00 PM	0.19	0.19	0.14
9/12/12 11:00 PM	0.11	0.11	0.14
9/13/12 1:00 AM	0.30	0.30	0.15
9/13/12 3:00 AM	0.26	0.26	0.16
9/13/12 5:00 AM	0.27	0.27	0.16
9/13/12 7:00 AM	0.26	0.26	0.18
9/13/12 9:00 AM	0.24	0.24	0.49
9/13/12 11:00 AM	0.23	0.23	0.49

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
9/13/12 1:00 PM	0.23	0.23	0.49
9/13/12 3:00 PM	0.23	0.23	0.47
9/13/12 5:00 PM	0.24	0.24	0.35
9/13/12 7:00 PM	0.23	0.23	0.18
9/13/12 9:00 PM	0.18	0.18	0.15
9/13/12 11:00 PM	0.17	0.17	0.15
9/14/12 1:00 AM	0.18	0.18	0.15
9/14/12 3:00 AM	0.20	0.20	0.15
9/14/12 5:00 AM	0.21	0.21	0.13
9/14/12 7:00 AM	0.22	0.22	0.14
9/14/12 9:00 AM	0.22	0.22	0.14
9/14/12 11:00 AM	0.18	0.18	0.14
9/14/12 1:00 PM	0.21	0.21	0.14
9/14/12 3:00 PM	0.24	0.24	0.14
9/14/12 5:00 PM	0.24	0.24	0.14
9/14/12 7:00 PM	0.23	0.23	0.13
9/14/12 9:00 PM	0.08	0.08	0.13
9/14/12 11:00 PM	0.09	0.09	0.14
9/15/12 1:00 AM	0.09	0.09	0.10
9/15/12 3:00 AM	0.08	0.08	0.13
9/15/12 5:00 AM	0.10	0.10	0.13
9/15/12 7:00 AM	0.10	0.10	0.12
9/15/12 9:00 AM	0.11	0.11	0.12
9/15/12 11:00 AM	0.11	0.11	0.12
9/15/12 1:00 PM	0.10	0.10	0.13
9/15/12 3:00 PM	0.10	0.10	0.14
9/15/12 5:00 PM	0.11	0.11	0.14
9/15/12 7:00 PM	0.10	0.10	0.14
9/15/12 9:00 PM	0.12	0.12	0.15
9/15/12 11:00 PM	0.11	0.11	0.16
9/16/12 1:00 AM	0.11	0.11	0.16
9/16/12 3:00 AM	0.10	0.10	0.16
9/16/12 5:00 AM	0.11	0.11	0.16
9/16/12 7:00 AM	0.11	0.11	0.16
9/16/12 9:00 AM	0.12	0.12	0.15
9/16/12 11:00 AM	0.12	0.12	0.16
9/16/12 1:00 PM	0.11	0.11	0.15
9/16/12 3:00 PM	0.12	0.12	0.15
9/16/12 5:00 PM	0.11	0.11	0.15
9/16/12 7:00 PM	0.12	0.12	0.16
9/16/12 9:00 PM	0.13	0.13	0.16
9/16/12 11:00 PM	0.12	0.12	0.16
9/17/12 1:00 AM	0.13	0.13	0.26
9/17/12 3:00 AM	0.13	0.13	0.21
9/17/12 5:00 AM	0.12	0.12	0.18
9/17/12 7:00 AM	0.14	0.14	0.31
9/17/12 9:00 AM	0.14	0.14	0.17
9/17/12 11:00 AM	0.12	0.12	0.17
9/17/12 1:00 PM	0.13	0.13	0.16
9/17/12 3:00 PM	0.15	0.15	0.17
9/17/12 5:00 PM	0.13	0.13	0.18
9/17/12 7:00 PM	0.13	0.13	0.17
9/17/12 9:00 PM	0.13	0.13	0.16

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
9/17/12 11:00 PM	0.12	0.12	0.16
9/18/12 1:00 AM	0.17	0.17	0.16
9/18/12 3:00 AM	0.25	0.25	0.17
9/18/12 5:00 AM	0.28	0.28	0.16
9/18/12 7:00 AM	0.27	0.27	0.16
9/18/12 9:00 AM	0.27	0.27	0.15
9/18/12 11:00 AM	0.23	0.23	0.15
9/18/12 1:00 PM	0.27	0.27	0.15
9/18/12 3:00 PM	0.27	0.27	0.15
9/18/12 5:00 PM	0.26	0.26	0.13
9/18/12 7:00 PM	0.24	0.24	0.13
9/18/12 9:00 PM	0.22	0.22	0.12
9/18/12 11:00 PM	0.22	0.22	0.03
9/19/12 1:00 AM	0.23	0.23	0.02
9/19/12 3:00 AM	0.23	0.23	0.02
9/19/12 5:00 AM	0.20	0.20	0.02
9/19/12 7:00 AM	0.22	0.22	0.02
9/19/12 9:00 AM	0.22	0.22	0.02
9/19/12 11:00 AM	0.22	0.22	0.02
9/19/12 1:00 PM	0.18	0.18	0.02
9/19/12 3:00 PM	0.08	0.08	0.02
9/19/12 5:00 PM	0.08	0.08	0.02
9/19/12 7:00 PM	0.10	0.10	0.14
9/19/12 9:00 PM	0.20	0.20	0.20
9/19/12 11:00 PM	0.22	0.22	0.10
9/20/12 1:00 AM	0.23	0.23	0.11
9/20/12 3:00 AM	0.23	0.23	0.11
9/20/12 5:00 AM	0.25	0.25	0.12
9/20/12 7:00 AM	0.22	0.22	0.12
9/20/12 9:00 AM	0.23	0.23	0.11
9/20/12 11:00 AM	0.27	0.27	0.12
9/20/12 1:00 PM	0.26	0.26	0.17
9/20/12 3:00 PM	0.26	0.26	0.24
9/20/12 5:00 PM	0.24	0.24	0.17
9/20/12 7:00 PM	0.12	0.12	0.15
9/20/12 9:00 PM	0.10	0.10	0.12
9/20/12 11:00 PM	0.27	0.27	0.11
9/21/12 1:00 AM	0.24	0.24	0.10
9/21/12 3:00 AM	0.27	0.27	0.09
9/21/12 5:00 AM	0.23	0.23	0.09
9/21/12 7:00 AM	0.25	0.25	0.09
9/21/12 9:00 AM	0.24	0.24	0.09
9/21/12 11:00 AM	0.20	0.20	0.10
9/21/12 1:00 PM	0.12	0.12	0.11
9/21/12 3:00 PM	0.11	0.11	0.12
9/21/12 5:00 PM	0.21	0.21	0.12
9/21/12 7:00 PM	0.22	0.22	0.14
9/21/12 9:00 PM	0.22	0.22	0.13
9/21/12 11:00 PM	0.20	0.20	0.13
9/22/12 1:00 AM	0.15	0.15	0.18
9/22/12 3:00 AM	0.17	0.17	0.18
9/22/12 5:00 AM	0.19	0.19	0.22
9/22/12 7:00 AM	0.25	0.25	0.26

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
9/22/12 9:00 AM	0.21	0.21	0.15
9/22/12 11:00 AM	0.10	0.10	0.19
9/22/12 1:00 PM	0.16	0.16	0.18
9/22/12 3:00 PM	0.12	0.12	0.18
9/22/12 5:00 PM	0.13	0.13	0.17
9/22/12 7:00 PM	0.19	0.19	0.17
9/22/12 9:00 PM	0.17	0.17	0.16
9/22/12 11:00 PM	0.17	0.17	0.10
9/23/12 1:00 AM	0.13	0.13	0.08
9/23/12 3:00 AM	0.10	0.10	0.08
9/23/12 5:00 AM	0.14	0.14	0.07
9/23/12 7:00 AM	0.13	0.13	0.12
9/23/12 9:00 AM	0.13	0.13	0.14
9/23/12 11:00 AM	0.12	0.12	0.14
9/23/12 1:00 PM	0.11	0.11	0.14
9/23/12 3:00 PM	0.11	0.11	0.18
9/23/12 5:00 PM	0.10	0.10	0.14
9/23/12 7:00 PM	0.11	0.11	0.13
9/23/12 9:00 PM	0.10	0.10	0.09
9/23/12 11:00 PM	0.10	0.10	0.07
9/24/12 1:00 AM	0.11	0.11	0.07
9/24/12 3:00 AM	0.20	0.20	0.07
9/24/12 5:00 AM	0.21	0.21	0.07
9/24/12 7:00 AM	0.14	0.14	0.13
9/24/12 9:00 AM	0.08	0.08	0.13
9/24/12 11:00 AM	0.16	0.16	0.12
9/24/12 1:00 PM	0.09	0.09	0.12
9/24/12 3:00 PM	0.02	0.02	0.12
9/24/12 5:00 PM	0.02	0.02	0.12
9/24/12 7:00 PM	0.09	0.09	0.12
9/24/12 9:00 PM	0.04	0.04	0.13
9/24/12 11:00 PM	0.15	0.15	0.12
9/25/12 1:00 AM	0.15	0.15	0.13
9/25/12 3:00 AM	0.09	0.09	0.12
9/25/12 5:00 AM	0.09	0.09	0.12
9/25/12 7:00 AM	0.10	0.10	0.12
9/25/12 9:00 AM	0.09	0.09	0.12
9/25/12 11:00 AM	0.10	0.10	0.12
9/25/12 1:00 PM	0.09	0.09	0.12
9/25/12 3:00 PM	0.09	0.09	0.16
9/25/12 5:00 PM	0.09	0.09	0.14
9/25/12 7:00 PM	0.08	0.08	0.14
9/25/12 9:00 PM	0.09	0.09	0.14
9/25/12 11:00 PM	0.09	0.09	0.15
9/26/12 1:00 AM	0.08	0.08	0.15
9/26/12 3:00 AM	0.08	0.08	0.16
9/26/12 5:00 AM	0.09	0.09	0.16
9/26/12 7:00 AM	0.10	0.10	0.15
9/26/12 9:00 AM	0.10	0.10	0.17
9/26/12 11:00 AM	0.11	0.11	0.26
9/26/12 1:00 PM	0.11	0.11	0.19
9/26/12 3:00 PM	0.10	0.10	0.19
9/26/12 5:00 PM	0.09	0.09	0.18

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
9/26/12 7:00 PM	0.10	0.10	0.17
9/26/12 9:00 PM	0.11	0.11	0.16
9/26/12 11:00 PM	0.11	0.11	0.12
9/27/12 1:00 AM	0.11	0.11	0.13
9/27/12 3:00 AM	0.11	0.11	0.14
9/27/12 5:00 AM	0.11	0.11	0.14
9/27/12 7:00 AM	0.12	0.12	0.19
9/27/12 9:00 AM	0.12	0.12	0.09
9/27/12 11:00 AM	0.12	0.12	0.10
9/27/12 1:00 PM	0.12	0.12	0.12
9/27/12 3:00 PM	0.12	0.12	0.15
9/27/12 5:00 PM	0.11	0.11	0.26
9/27/12 7:00 PM	0.11	0.11	0.23
9/27/12 9:00 PM	0.10	0.10	0.21
9/27/12 11:00 PM	0.10	0.10	0.19
9/28/12 1:00 AM	0.10	0.10	0.22
9/28/12 3:00 AM	0.11	0.11	0.20
9/28/12 5:00 AM	0.11	0.11	0.21
9/28/12 7:00 AM	0.12	0.12	0.26
9/28/12 9:00 AM	0.12	0.12	0.30
9/28/12 11:00 AM	0.12	0.12	0.28
9/28/12 1:00 PM	0.12	0.12	0.22
9/28/12 3:00 PM	0.11	0.11	0.17
9/28/12 5:00 PM	0.11	0.11	0.18
9/28/12 7:00 PM	0.12	0.12	0.18
9/28/12 9:00 PM	0.12	0.12	0.17
9/28/12 11:00 PM	0.13	0.13	0.17
9/29/12 1:00 AM	0.12	0.12	0.17
9/29/12 3:00 AM	0.12	0.12	0.16
9/29/12 5:00 AM	0.12	0.12	0.18
9/29/12 7:00 AM	0.13	0.13	0.19
9/29/12 9:00 AM	0.13	0.13	0.19
9/29/12 11:00 AM	0.13	0.13	0.19
9/29/12 1:00 PM	0.13	0.13	0.20
9/29/12 3:00 PM	0.13	0.13	0.20
9/29/12 5:00 PM	0.12	0.12	0.21
9/29/12 7:00 PM	0.14	0.14	0.21
9/29/12 9:00 PM	0.13	0.13	0.27
9/29/12 11:00 PM	0.13	0.13	0.24
9/30/12 1:00 AM	0.14	0.14	0.15
9/30/12 3:00 AM	0.14	0.14	0.16
9/30/12 5:00 AM	0.13	0.13	0.18
9/30/12 7:00 AM	0.12	0.12	0.20
9/30/12 9:00 AM	0.13	0.13	0.21
9/30/12 11:00 AM	0.12	0.12	0.22
9/30/12 1:00 PM	0.12	0.12	0.23
9/30/12 3:00 PM	0.12	0.12	0.24
9/30/12 5:00 PM	0.15	0.15	0.23
9/30/12 7:00 PM	0.24	0.24	0.22
9/30/12 9:00 PM	0.23	0.23	0.00
9/30/12 11:00 PM	0.25	0.25	0.21
10/1/12 1:00 AM	0.24	0.00	0.21
10/1/12 3:00 AM	0.22	0.00	0.22

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
10/1/12 5:00 AM	0.22	0.00	0.22
10/1/12 7:00 AM	0.22	0.00	0.23
10/1/12 9:00 AM	0.21	0.00	0.22
10/1/12 11:00 AM	0.20	0.00	0.22
10/1/12 1:00 PM	0.20	0.00	0.21
10/1/12 3:00 PM	0.20	0.00	0.19
10/1/12 5:00 PM	0.19	0.19	0.20
10/1/12 7:00 PM	0.22	0.22	0.20
10/1/12 9:00 PM	0.27	0.27	0.20
10/1/12 11:00 PM	0.23	0.23	0.20
10/2/12 1:00 AM	0.23	0.23	0.19
10/2/12 3:00 AM	0.24	0.24	0.19
10/2/12 5:00 AM	0.27	0.27	0.20
10/2/12 7:00 AM	0.31	0.31	0.20
10/2/12 9:00 AM	0.30	0.30	0.20
10/2/12 11:00 AM	0.27	0.27	0.20
10/2/12 1:00 PM	0.26	0.26	0.14
10/2/12 3:00 PM	0.27	0.27	0.12
10/2/12 5:00 PM	0.24	0.24	0.13
10/2/12 7:00 PM	0.22	0.22	0.12
10/2/12 9:00 PM	0.26	0.26	0.12
10/2/12 11:00 PM	0.28	0.28	0.12
10/3/12 1:00 AM	0.24	0.24	0.11
10/3/12 3:00 AM	0.22	0.22	0.12
10/3/12 5:00 AM	0.11	0.11	0.13
10/3/12 7:00 AM	0.05	0.05	0.10
10/3/12 9:00 AM	0.06	0.06	0.10
10/3/12 11:00 AM	0.07	0.07	0.10
10/3/12 1:00 PM	0.06	0.06	0.10
10/3/12 3:00 PM	0.07	0.07	0.10
10/3/12 5:00 PM	0.06	0.06	0.11
10/3/12 7:00 PM	0.06	0.06	0.11
10/3/12 9:00 PM	0.07	0.07	0.11
10/3/12 11:00 PM	0.06	0.06	0.13
10/4/12 1:00 AM	0.20	0.20	0.14
10/4/12 3:00 AM	0.25	0.25	0.15
10/4/12 5:00 AM	0.28	0.28	0.17
10/4/12 7:00 AM	0.07	0.07	0.18
10/4/12 9:00 AM	0.09	0.09	0.19
10/4/12 11:00 AM	0.09	0.09	0.20
10/4/12 1:00 PM	0.09	0.09	0.26
10/4/12 3:00 PM	0.09	0.09	0.22
10/4/12 5:00 PM	0.09	0.09	0.23
10/4/12 7:00 PM	0.09	0.09	0.26
10/4/12 9:00 PM	0.09	0.09	0.24
10/4/12 11:00 PM	0.09	0.09	0.23
10/5/12 1:00 AM	0.29	0.29	0.24
10/5/12 3:00 AM	0.31	0.31	0.25
10/5/12 5:00 AM	0.33	0.33	0.24
10/5/12 7:00 AM	0.23	0.23	0.22
10/5/12 9:00 AM	0.14	0.14	0.22
10/5/12 11:00 AM	0.13	0.13	0.22
10/5/12 1:00 PM	0.11	0.11	0.19

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
10/5/12 3:00 PM	0.11	0.11	0.14
10/5/12 5:00 PM	0.11	0.11	0.14
10/5/12 7:00 PM	0.10	0.10	0.13
10/5/12 9:00 PM	0.10	0.10	0.12
10/5/12 11:00 PM	0.10	0.10	0.11
10/6/12 1:00 AM	0.10	0.10	0.09
10/6/12 3:00 AM	0.10	0.10	0.07
10/6/12 5:00 AM	0.11	0.11	0.07
10/6/12 7:00 AM	0.12	0.12	0.10
10/6/12 9:00 AM	0.13	0.13	0.10
10/6/12 11:00 AM	0.13	0.13	0.10
10/6/12 1:00 PM	0.13	0.13	0.10
10/6/12 3:00 PM	0.12	0.12	0.11
10/6/12 5:00 PM	0.13	0.13	0.11
10/6/12 7:00 PM	0.13	0.13	0.11
10/6/12 9:00 PM	0.11	0.11	0.09
10/6/12 11:00 PM	0.11	0.11	0.01
10/7/12 1:00 AM	0.11	0.11	0.00
10/7/12 3:00 AM	0.12	0.12	0.00
10/7/12 5:00 AM	0.13	0.13	0.00
10/7/12 7:00 AM	0.13	0.13	0.00
10/7/12 9:00 AM	0.12	0.12	0.00
10/7/12 11:00 AM	0.13	0.13	0.00
10/7/12 1:00 PM	0.15	0.15	0.00
10/7/12 3:00 PM	0.14	0.14	0.00
10/7/12 5:00 PM	0.14	0.14	0.00
10/7/12 7:00 PM	0.14	0.14	0.00
10/7/12 9:00 PM	0.14	0.14	0.00
10/7/12 11:00 PM	0.14	0.14	0.00
10/8/12 1:00 AM	0.13	0.13	0.00
10/8/12 3:00 AM	0.12	0.12	0.00
10/8/12 5:00 AM	0.11	0.11	0.00
10/8/12 7:00 AM	0.22	0.22	0.00
10/8/12 9:00 AM	0.36	0.36	0.00
10/8/12 11:00 AM	0.31	0.31	0.00
10/8/12 1:00 PM	0.30	0.30	0.00
10/8/12 3:00 PM	0.26	0.26	0.00
10/8/12 5:00 PM	0.26	0.26	0.00
10/8/12 7:00 PM	0.26	0.26	0.00
10/8/12 9:00 PM	0.25	0.25	0.00
10/8/12 11:00 PM	0.24	0.24	0.00
10/9/12 1:00 AM	0.25	0.25	0.00
10/9/12 3:00 AM	0.26	0.26	0.00
10/9/12 5:00 AM	0.27	0.27	0.00
10/9/12 7:00 AM	0.28	0.28	0.05
10/9/12 9:00 AM	0.28	0.28	0.09
10/9/12 11:00 AM	0.17	0.17	0.15
10/9/12 1:00 PM	0.06	0.06	0.16
10/9/12 3:00 PM	0.07	0.07	0.18
10/9/12 5:00 PM	0.07	0.07	0.15
10/9/12 7:00 PM	0.11	0.11	0.15
10/9/12 9:00 PM	0.07	0.07	0.15
10/9/12 11:00 PM	0.07	0.07	0.15

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
10/10/12 1:00 AM	0.07	0.07	0.15
10/10/12 3:00 AM	0.07	0.07	0.15
10/10/12 5:00 AM	0.07	0.07	0.15
10/10/12 7:00 AM	0.07	0.07	0.10
10/10/12 9:00 AM	0.06	0.06	0.10
10/10/12 11:00 AM	0.06	0.06	0.09
10/10/12 1:00 PM	0.06	0.06	0.09
10/10/12 3:00 PM	0.05	0.05	0.09
10/10/12 5:00 PM	0.05	0.05	0.09
10/10/12 7:00 PM	0.06	0.06	0.09
10/10/12 9:00 PM	0.88	0.88	0.09
10/10/12 11:00 PM	1.28	1.28	0.09
10/11/12 1:00 AM	0.30	0.30	0.09
10/11/12 3:00 AM	0.15	0.15	0.09
10/11/12 5:00 AM	0.19	0.19	0.09
10/11/12 7:00 AM	0.08	0.08	0.09
10/11/12 9:00 AM	0.08	0.08	0.10
10/11/12 11:00 AM	0.08	0.08	0.07
10/11/12 1:00 PM	0.07	0.07	0.07
10/11/12 3:00 PM	0.07	0.07	0.07
10/11/12 5:00 PM	0.08	0.08	0.07
10/11/12 7:00 PM	0.08	0.08	0.08
10/11/12 9:00 PM	0.08	0.08	0.08
10/11/12 11:00 PM	0.09	0.09	0.08
10/12/12 1:00 AM	0.10	0.10	0.09
10/12/12 3:00 AM	0.20	0.20	0.11
10/12/12 5:00 AM	0.19	0.19	0.09
10/12/12 7:00 AM	0.07	0.07	0.09
10/12/12 9:00 AM	0.15	0.15	0.09
10/12/12 11:00 AM	0.07	0.07	0.09
10/12/12 1:00 PM	0.06	0.06	0.08
10/12/12 3:00 PM	0.06	0.06	0.09
10/12/12 5:00 PM	0.05	0.05	0.08
10/12/12 7:00 PM	0.12	0.12	0.08
10/12/12 9:00 PM	0.06	0.06	0.04
10/12/12 11:00 PM	0.06	0.06	0.04
10/13/12 1:00 AM	0.06	0.06	0.04
10/13/12 3:00 AM	0.26	0.26	0.04
10/13/12 5:00 AM	0.28	0.28	0.04
10/13/12 7:00 AM	0.27	0.27	0.05
10/13/12 9:00 AM	0.24	0.24	0.05
10/13/12 11:00 AM	0.22	0.22	0.06
10/13/12 1:00 PM	0.16	0.16	0.05
10/13/12 3:00 PM	0.06	0.06	0.05
10/13/12 5:00 PM	0.06	0.06	0.05
10/13/12 7:00 PM	0.06	0.06	0.05
10/13/12 9:00 PM	0.07	0.07	0.06
10/13/12 11:00 PM	0.29	0.29	0.06
10/14/12 1:00 AM	0.28	0.28	0.06
10/14/12 3:00 AM	0.26	0.26	0.06
10/14/12 5:00 AM	0.22	0.22	0.06
10/14/12 7:00 AM	0.25	0.25	0.07
10/14/12 9:00 AM	0.16	0.16	0.08

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
10/14/12 11:00 AM	0.07	0.07	0.08
10/14/12 1:00 PM	0.06	0.06	0.07
10/14/12 3:00 PM	0.06	0.06	0.12
10/14/12 5:00 PM	0.06	0.06	0.14
10/14/12 7:00 PM	0.06	0.06	0.13
10/14/12 9:00 PM	0.06	0.06	0.13
10/14/12 11:00 PM	0.21	0.21	0.13
10/15/12 1:00 AM	0.22	0.22	0.10
10/15/12 3:00 AM	0.20	0.20	0.10
10/15/12 5:00 AM	0.15	0.15	0.11
10/15/12 7:00 AM	0.06	0.06	0.13
10/15/12 9:00 AM	0.06	0.06	0.12
10/15/12 11:00 AM	0.06	0.06	0.11
10/15/12 1:00 PM	0.06	0.06	0.12
10/15/12 3:00 PM	0.06	0.06	0.11
10/15/12 5:00 PM	0.06	0.06	0.55
10/15/12 7:00 PM	0.06	0.06	0.12
10/15/12 9:00 PM	0.06	0.06	0.09
10/15/12 11:00 PM	0.06	0.06	0.08
10/16/12 1:00 AM	0.21	0.21	0.05
10/16/12 3:00 AM	0.21	0.21	0.06
10/16/12 5:00 AM	0.18	0.18	0.06
10/16/12 7:00 AM	0.05	0.05	0.14
10/16/12 9:00 AM	0.05	0.05	0.18
10/16/12 11:00 AM	0.06	0.06	0.33
10/16/12 1:00 PM	0.06	0.06	0.06
10/16/12 3:00 PM	0.05	0.05	0.06
10/16/12 5:00 PM	0.05	0.05	0.04
10/16/12 7:00 PM	0.05	0.05	0.04
10/16/12 9:00 PM	0.15	0.15	0.04
10/16/12 11:00 PM	0.20	0.20	0.04
10/17/12 1:00 AM	0.12	0.12	0.04
10/17/12 3:00 AM	0.14	0.14	0.04
10/17/12 5:00 AM	0.23	0.23	0.04
10/17/12 7:00 AM	0.18	0.18	0.05
10/17/12 9:00 AM	0.07	0.07	0.05
10/17/12 11:00 AM	0.07	0.07	0.05
10/17/12 1:00 PM	0.07	0.07	0.06
10/17/12 3:00 PM	0.06	0.06	0.07
10/17/12 5:00 PM	0.06	0.06	0.07
10/17/12 7:00 PM	0.06	0.06	0.07
10/17/12 9:00 PM	0.07	0.07	0.08
10/17/12 11:00 PM	0.17	0.17	0.07
10/18/12 1:00 AM	0.13	0.13	0.06
10/18/12 3:00 AM	0.12	0.12	0.04
10/18/12 5:00 AM	0.23	0.23	0.04
10/18/12 7:00 AM	0.22	0.22	0.10
10/18/12 9:00 AM	0.06	0.06	0.10
10/18/12 11:00 AM	0.06	0.06	0.10
10/18/12 1:00 PM	0.06	0.06	0.09
10/18/12 3:00 PM	0.06	0.06	0.09
10/18/12 5:00 PM	0.06	0.06	0.10
10/18/12 7:00 PM	0.06	0.06	0.10

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
10/18/12 9:00 PM	0.06	0.06	0.10
10/18/12 11:00 PM	0.24	0.24	0.10
10/19/12 1:00 AM	0.16	0.16	0.09
10/19/12 3:00 AM	0.15	0.15	0.06
10/19/12 5:00 AM	0.24	0.24	0.10
10/19/12 7:00 AM	0.19	0.19	0.10
10/19/12 9:00 AM	0.06	0.06	0.14
10/19/12 11:00 AM	0.05	0.05	0.14
10/19/12 1:00 PM	0.06	0.06	0.14
10/19/12 3:00 PM	0.05	0.05	0.15
10/19/12 5:00 PM	0.05	0.05	0.15
10/19/12 7:00 PM	0.06	0.06	0.14
10/19/12 9:00 PM	0.06	0.06	0.13
10/19/12 11:00 PM	0.06	0.06	0.13
10/20/12 1:00 AM	0.19	0.19	0.07
10/20/12 3:00 AM	0.21	0.21	0.09
10/20/12 5:00 AM	0.21	0.21	0.09
10/20/12 7:00 AM	0.17	0.17	0.09
10/20/12 9:00 AM	0.08	0.08	0.12
10/20/12 11:00 AM	0.08	0.08	0.17
10/20/12 1:00 PM	0.07	0.07	0.17
10/20/12 3:00 PM	0.07	0.07	0.16
10/20/12 5:00 PM	0.07	0.07	0.15
10/20/12 7:00 PM	0.07	0.07	0.15
10/20/12 9:00 PM	0.14	0.14	0.15
10/20/12 11:00 PM	0.20	0.20	0.12
10/21/12 1:00 AM	0.14	0.14	0.11
10/21/12 3:00 AM	0.10	0.10	0.11
10/21/12 5:00 AM	0.10	0.10	0.11
10/21/12 7:00 AM	0.11	0.11	0.07
10/21/12 9:00 AM	0.19	0.19	0.07
10/21/12 11:00 AM	0.06	0.06	0.06
10/21/12 1:00 PM	0.06	0.06	0.12
10/21/12 3:00 PM	0.06	0.06	0.15
10/21/12 5:00 PM	0.06	0.06	0.15
10/21/12 7:00 PM	0.06	0.06	0.15
10/21/12 9:00 PM	0.17	0.17	0.15
10/21/12 11:00 PM	0.17	0.17	0.12
10/22/12 1:00 AM	0.12	0.12	0.10
10/22/12 3:00 AM	0.12	0.12	0.10
10/22/12 5:00 AM	0.12	0.12	0.14
10/22/12 7:00 AM	0.21	0.21	0.18
10/22/12 9:00 AM	0.23	0.23	0.19
10/22/12 11:00 AM	0.08	0.08	0.21
10/22/12 1:00 PM	0.07	0.07	0.21
10/22/12 3:00 PM	0.07	0.07	0.19
10/22/12 5:00 PM	0.08	0.08	0.19
10/22/12 7:00 PM	0.09	0.09	0.18
10/22/12 9:00 PM	0.09	0.09	0.18
10/22/12 11:00 PM	0.26	0.26	0.18
10/23/12 1:00 AM	0.11	0.11	0.15
10/23/12 3:00 AM	0.11	0.11	0.11
10/23/12 5:00 AM	0.15	0.15	0.16

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
10/23/12 7:00 AM	0.31	0.31	0.18
10/23/12 9:00 AM	0.30	0.30	0.16
10/23/12 11:00 AM	0.16	0.16	0.17
10/23/12 1:00 PM	0.07	0.07	0.17
10/23/12 3:00 PM	0.07	0.07	0.18
10/23/12 5:00 PM	0.07	0.07	0.18
10/23/12 7:00 PM	0.07	0.07	0.18
10/23/12 9:00 PM	0.07	0.07	0.18
10/23/12 11:00 PM	0.17	0.17	0.13
10/24/12 1:00 AM	0.14	0.14	0.20
10/24/12 3:00 AM	0.10	0.10	0.15
10/24/12 5:00 AM	0.20	0.20	0.12
10/24/12 7:00 AM	0.32	0.32	0.19
10/24/12 9:00 AM	0.16	0.16	0.18
10/24/12 11:00 AM	0.08	0.08	0.18
10/24/12 1:00 PM	0.08	0.08	0.18
10/24/12 3:00 PM	0.08	0.08	0.17
10/24/12 5:00 PM	0.09	0.09	0.17
10/24/12 7:00 PM	0.09	0.09	0.18
10/24/12 9:00 PM	0.09	0.09	0.14
10/24/12 11:00 PM	0.08	0.08	0.02
10/25/12 1:00 AM	0.24	0.24	0.02
10/25/12 3:00 AM	0.24	0.24	0.02
10/25/12 5:00 AM	0.27	0.27	0.04
10/25/12 7:00 AM	0.28	0.28	0.20
10/25/12 9:00 AM	0.13	0.00	0.20
10/25/12 11:00 AM	0.05	0.00	0.20
10/25/12 1:00 PM	0.05	0.00	0.21
10/25/12 3:00 PM	0.04	0.00	0.21
10/25/12 5:00 PM	0.17	0.00	0.20
10/25/12 7:00 PM	0.15	0.15	0.20
10/25/12 9:00 PM	0.15	0.15	0.21
10/25/12 11:00 PM	0.17	0.17	0.21
10/26/12 1:00 AM	0.15	0.15	0.19
10/26/12 3:00 AM	0.23	0.23	0.15
10/26/12 5:00 AM	0.26	0.26	0.20
10/26/12 7:00 AM	0.10	0.10	0.21
10/26/12 9:00 AM	0.10	0.10	0.21
10/26/12 11:00 AM	0.09	0.09	0.21
10/26/12 1:00 PM	0.08	0.08	0.21
10/26/12 3:00 PM	0.10	0.10	0.20
10/26/12 5:00 PM	0.09	0.09	0.20
10/26/12 7:00 PM	0.09	0.09	0.19
10/26/12 9:00 PM	0.09	0.09	0.19
10/26/12 11:00 PM	0.09	0.09	0.17
10/27/12 1:00 AM	0.28	0.28	0.18
10/27/12 3:00 AM	0.31	0.31	0.18
10/27/12 5:00 AM	0.26	0.26	0.18
10/27/12 7:00 AM	0.30	0.30	0.20
10/27/12 9:00 AM	0.13	0.13	0.20
10/27/12 11:00 AM	0.08	0.08	0.20
10/27/12 1:00 PM	0.09	0.09	0.21
10/27/12 3:00 PM	0.09	0.09	0.21

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
10/27/12 5:00 PM	0.10	0.10	0.20
10/27/12 7:00 PM	0.10	0.10	0.19
10/27/12 9:00 PM	0.10	0.10	0.19
10/27/12 11:00 PM	0.29	0.29	0.13
10/28/12 1:00 AM	0.18	0.18	0.12
10/28/12 3:00 AM	0.13	0.13	0.12
10/28/12 5:00 AM	0.14	0.14	0.12
10/28/12 7:00 AM	0.26	0.26	0.12
10/28/12 9:00 AM	0.23	0.23	0.18
10/28/12 11:00 AM	0.11	0.11	0.19
10/28/12 1:00 PM	0.10	0.10	0.19
10/28/12 3:00 PM	0.10	0.10	0.19
10/28/12 5:00 PM	0.10	0.10	0.19
10/28/12 7:00 PM	0.10	0.10	0.19
10/28/12 9:00 PM	0.09	0.09	0.18
10/28/12 11:00 PM	0.23	0.23	0.17
10/29/12 1:00 AM	0.12	0.12	0.16
10/29/12 3:00 AM	0.10	0.10	0.13
10/29/12 5:00 AM	0.29	0.29	0.16
10/29/12 7:00 AM	0.14	0.14	0.19
10/29/12 9:00 AM	0.29	0.29	0.19
10/29/12 11:00 AM	0.22	0.22	0.19
10/29/12 1:00 PM	0.22	0.22	0.19
10/29/12 3:00 PM	0.16	0.16	0.19
10/29/12 5:00 PM	0.08	0.08	0.19
10/29/12 7:00 PM	0.08	0.08	0.19
10/29/12 9:00 PM	0.13	0.13	0.18
10/29/12 11:00 PM	0.09	0.09	0.14
10/30/12 1:00 AM	0.08	0.08	0.12
10/30/12 3:00 AM	0.08	0.08	0.13
10/30/12 5:00 AM	0.19	0.19	0.16
10/30/12 7:00 AM	0.16	0.16	0.18
10/30/12 9:00 AM	0.26	0.26	0.17
10/30/12 11:00 AM	0.29	0.29	0.18
10/30/12 1:00 PM	0.27	0.27	0.18
10/30/12 3:00 PM	0.26	0.26	0.19
10/30/12 5:00 PM	0.08	0.08	0.19
10/30/12 7:00 PM	0.07	0.07	0.18
10/30/12 9:00 PM	0.07	0.07	0.19
10/30/12 11:00 PM	0.09	0.09	0.18
10/31/12 1:00 AM	0.23	0.23	0.18
10/31/12 3:00 AM	0.24	0.24	0.18
10/31/12 5:00 AM	0.24	0.24	0.18
10/31/12 7:00 AM	0.24	0.24	0.17
10/31/12 9:00 AM	0.25	0.25	0.18
10/31/12 11:00 AM	0.27	0.27	0.18
10/31/12 1:00 PM	0.28	0.28	0.18
10/31/12 3:00 PM	0.24	0.24	0.18
10/31/12 5:00 PM	0.23	0.23	0.20
10/31/12 7:00 PM	0.23	0.23	0.21
10/31/12 9:00 PM	0.25	0.25	0.22
10/31/12 11:00 PM	0.26	0.26	0.21
11/1/12 1:00 AM	0.27	0.27	0.21

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
11/1/12 3:00 AM	0.19	0.19	0.24
11/1/12 5:00 AM	0.18	0.18	0.24
11/1/12 7:00 AM	0.18	0.18	0.24
11/1/12 9:00 AM	0.22	0.22	0.18
11/1/12 11:00 AM	0.28	0.28	0.26
11/1/12 1:00 PM	0.24	0.24	0.25
11/1/12 3:00 PM	0.21	0.21	0.16
11/1/12 5:00 PM	0.20	0.20	0.15
11/1/12 7:00 PM	0.19	0.00	0.15
11/1/12 9:00 PM	0.17	0.00	0.14
11/1/12 11:00 PM	0.19	0.00	0.15
11/2/12 1:00 AM	0.20	0.00	0.15
11/2/12 3:00 AM	0.21	0.00	0.15
11/2/12 5:00 AM	0.18	0.00	0.14
11/2/12 7:00 AM	0.16	0.00	0.15
11/2/12 9:00 AM	0.11	0.00	0.14
11/2/12 11:00 AM	0.11	0.00	0.13
11/2/12 1:00 PM	0.11	0.00	0.12
11/2/12 3:00 PM	0.12	0.00	0.12
11/2/12 5:00 PM	0.12	0.00	0.11
11/2/12 7:00 PM	0.12	0.00	0.11
11/2/12 9:00 PM	0.10	0.00	0.10
11/2/12 11:00 PM	0.08	0.00	0.10
11/3/12 1:00 AM	0.08	0.00	0.06
11/3/12 3:00 AM	0.08	0.00	0.07
11/3/12 5:00 AM	0.09	0.00	0.08
11/3/12 7:00 AM	0.11	0.00	0.10
11/3/12 9:00 AM	0.12	0.00	0.10
11/3/12 11:00 AM	0.11	0.00	0.10
11/3/12 1:00 PM	0.11	0.00	0.09
11/3/12 3:00 PM	0.12	0.00	0.09
11/3/12 5:00 PM	0.11	0.00	0.09
11/3/12 7:00 PM	0.11	0.00	0.09
11/3/12 9:00 PM	0.11	0.00	0.08
11/3/12 11:00 PM	0.11	0.00	0.08
11/4/12 1:00 AM	0.12	0.00	0.08
11/4/12 3:00 AM	0.12	0.00	0.09
11/4/12 5:00 AM	0.11	0.00	0.09
11/4/12 7:00 AM	0.09	0.00	0.09
11/4/12 9:00 AM	0.09	0.00	0.09
11/4/12 11:00 AM	0.09	0.00	0.09
11/4/12 1:00 PM	0.11	0.00	0.09
11/4/12 3:00 PM	0.11	0.00	0.08
11/4/12 5:00 PM	0.11	0.00	0.08
11/4/12 7:00 PM	0.12	0.00	0.08
11/4/12 9:00 PM	0.13	0.00	0.08
11/4/12 11:00 PM	0.12	0.00	0.08
11/5/12 1:00 AM	0.12	0.00	0.07
11/5/12 3:00 AM	0.10	0.00	0.08
11/5/12 5:00 AM	0.00	0.00	0.08
11/5/12 7:00 AM	0.00	0.00	0.08
11/5/12 9:00 AM	0.00	0.00	0.08
11/5/12 11:00 AM	0.01	0.00	0.11

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
11/5/12 1:00 PM	0.00	0.00	0.13
11/5/12 3:00 PM	0.01	0.00	0.12
11/5/12 5:00 PM	0.07	0.00	0.13
11/5/12 7:00 PM	0.10	0.00	0.13
11/5/12 9:00 PM	0.10	0.00	0.13
11/5/12 11:00 PM	0.14	0.00	0.12
11/6/12 1:00 AM	0.17	0.00	0.12
11/6/12 3:00 AM	0.16	0.16	0.12
11/6/12 5:00 AM	0.16	0.16	0.12
11/6/12 7:00 AM	0.15	0.15	0.13
11/6/12 9:00 AM	0.15	0.15	0.14
11/6/12 11:00 AM	0.15	0.15	0.15
11/6/12 1:00 PM	0.27	0.27	0.16
11/6/12 3:00 PM	0.24	0.24	0.17
11/6/12 5:00 PM	0.25	0.25	0.16
11/6/12 7:00 PM	0.22	0.22	0.16
11/6/12 9:00 PM	0.15	0.15	0.16
11/6/12 11:00 PM	0.06	0.06	0.14
11/7/12 1:00 AM	0.20	0.20	0.10
11/7/12 3:00 AM	0.22	0.22	0.10
11/7/12 5:00 AM	0.24	0.24	0.10
11/7/12 7:00 AM	0.09	0.09	0.16
11/7/12 9:00 AM	0.08	0.08	0.16
11/7/12 11:00 AM	0.12	0.12	0.16
11/7/12 1:00 PM	0.15	0.15	0.18
11/7/12 3:00 PM	0.14	0.14	0.19
11/7/12 5:00 PM	0.12	0.12	0.21
11/7/12 7:00 PM	0.12	0.12	0.16
11/7/12 9:00 PM	0.11	0.11	0.17
11/7/12 11:00 PM	0.25	0.25	0.19
11/8/12 1:00 AM	0.23	0.23	0.16
11/8/12 3:00 AM	0.24	0.24	0.11
11/8/12 5:00 AM	0.25	0.25	0.11
11/8/12 7:00 AM	0.15	0.15	0.16
11/8/12 9:00 AM	0.09	0.09	0.18
11/8/12 11:00 AM	0.11	0.11	0.19
11/8/12 1:00 PM	0.10	0.10	0.19
11/8/12 3:00 PM	0.10	0.10	0.20
11/8/12 5:00 PM	0.09	0.09	0.18
11/8/12 7:00 PM	0.08	0.08	0.20
11/8/12 9:00 PM	0.16	0.16	0.22
11/8/12 11:00 PM	0.21	0.21	0.17
11/9/12 1:00 AM	0.20	0.20	0.15
11/9/12 3:00 AM	0.21	0.21	0.15
11/9/12 5:00 AM	0.25	0.25	0.16
11/9/12 7:00 AM	0.13	0.13	0.26
11/9/12 9:00 AM	0.09	0.09	0.26
11/9/12 11:00 AM	0.19	0.19	0.23
11/9/12 1:00 PM	0.06	0.06	0.00
11/9/12 3:00 PM	0.15	0.15	0.12
11/9/12 5:00 PM	0.23	0.23	0.19
11/9/12 7:00 PM	0.10	0.10	0.23
11/9/12 9:00 PM	0.13	0.13	0.15

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
11/9/12 11:00 PM	0.11	0.11	0.18
11/10/12 1:00 AM	0.79	0.79	0.17
11/10/12 3:00 AM	0.47	0.47	0.13
11/10/12 5:00 AM	0.23	0.23	0.14
11/10/12 7:00 AM	0.27	0.27	0.27
11/10/12 9:00 AM	0.16	0.16	0.24
11/10/12 11:00 AM	0.08	0.08	0.21
11/10/12 1:00 PM	0.08	0.08	0.21
11/10/12 3:00 PM	0.07	0.07	0.20
11/10/12 5:00 PM	0.07	0.07	0.20
11/10/12 7:00 PM	0.10	0.10	0.22
11/10/12 9:00 PM	0.27	0.27	0.21
11/10/12 11:00 PM	0.22	0.22	0.14
11/11/12 1:00 AM	0.18	0.18	0.16
11/11/12 3:00 AM	0.11	0.00	0.24
11/11/12 5:00 AM	0.11	0.00	0.18
11/11/12 7:00 AM	0.15	0.00	0.19
11/11/12 9:00 AM	0.12	0.00	0.16
11/11/12 11:00 AM	0.08	0.00	0.16
11/11/12 1:00 PM	0.14	0.00	0.15
11/11/12 3:00 PM	0.12	0.00	0.13
11/11/12 5:00 PM	0.10	0.00	0.12
11/11/12 7:00 PM	0.12	0.12	0.12
11/11/12 9:00 PM	0.11	0.11	0.12
11/11/12 11:00 PM	0.11	0.11	0.11
11/12/12 1:00 AM	0.09	0.09	0.08
11/12/12 3:00 AM	0.11	0.11	0.08
11/12/12 5:00 AM	0.14	0.14	0.09
11/12/12 7:00 AM	0.24	0.24	0.11
11/12/12 9:00 AM	0.21	0.21	0.11
11/12/12 11:00 AM	0.16	0.16	0.11
11/12/12 1:00 PM	0.08	0.08	0.11
11/12/12 3:00 PM	0.08	0.08	0.11
11/12/12 5:00 PM	0.08	0.08	0.11
11/12/12 7:00 PM	0.07	0.07	0.11
11/12/12 9:00 PM	0.10	0.10	0.11
11/12/12 11:00 PM	0.24	0.24	0.11
11/13/12 1:00 AM	0.20	0.20	0.08
11/13/12 3:00 AM	0.15	0.15	0.08
11/13/12 5:00 AM	0.13	0.13	0.08
11/13/12 7:00 AM	0.24	0.24	0.11
11/13/12 9:00 AM	0.14	0.14	0.12
11/13/12 11:00 AM	0.07	0.07	0.13
11/13/12 1:00 PM	0.08	0.08	0.13
11/13/12 3:00 PM	0.07	0.07	0.13
11/13/12 5:00 PM	0.07	0.07	0.13
11/13/12 7:00 PM	0.06	0.06	0.13
11/13/12 9:00 PM	0.07	0.07	0.14
11/13/12 11:00 PM	0.16	0.16	0.14
11/14/12 1:00 AM	0.14	0.14	0.11
11/14/12 3:00 AM	0.12	0.12	0.10
11/14/12 5:00 AM	0.17	0.17	0.10
11/14/12 7:00 AM	0.24	0.24	0.14

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
11/14/12 9:00 AM	0.25	0.25	0.13
11/14/12 11:00 AM	0.14	0.14	0.14
11/14/12 1:00 PM	0.08	0.08	0.14
11/14/12 3:00 PM	0.08	0.08	0.13
11/14/12 5:00 PM	0.00	0.03	0.13
11/14/12 7:00 PM	0.00	0.03	0.13
11/14/12 9:00 PM	0.00	0.03	0.13
11/14/12 11:00 PM	0.00	0.04	0.12
11/15/12 1:00 AM	0.00	0.12	0.12
11/15/12 3:00 AM	0.00	0.08	0.11
11/15/12 5:00 AM	0.00	0.11	0.11
11/15/12 7:00 AM	0.00	0.12	0.12
11/15/12 9:00 AM	0.00	0.12	0.11
11/15/12 11:00 AM	0.00	0.11	0.12
11/15/12 1:00 PM	0.00	0.12	0.11
11/15/12 3:00 PM	0.00	0.13	0.12
11/15/12 5:00 PM	0.00	0.15	0.12
11/15/12 7:00 PM	0.00	0.14	0.12
11/15/12 9:00 PM	0.00	0.13	0.11
11/15/12 11:00 PM	0.00	0.11	0.12
11/16/12 1:00 AM	0.00	0.07	0.12
11/16/12 3:00 AM	0.00	0.07	0.12
11/16/12 5:00 AM	0.00	0.10	0.12
11/16/12 7:00 AM	0.00	0.14	0.12
11/16/12 9:00 AM	0.00	0.14	0.12
11/16/12 11:00 AM	0.00	0.14	0.13
11/16/12 1:00 PM	0.00	0.14	0.13
11/16/12 3:00 PM	0.00	0.14	0.14
11/16/12 5:00 PM	0.00	0.14	0.14
11/16/12 7:00 PM	0.00	0.14	0.14
11/16/12 9:00 PM	0.00	0.14	0.14
11/16/12 11:00 PM	0.00	0.13	0.14
11/17/12 1:00 AM	0.00	0.12	0.10
11/17/12 3:00 AM	0.00	0.10	0.09
11/17/12 5:00 AM	0.00	0.10	0.10
11/17/12 7:00 AM	0.00	0.12	0.15
11/17/12 9:00 AM	0.00	0.13	0.15
11/17/12 11:00 AM	0.00	0.13	0.15
11/17/12 1:00 PM	0.00	0.13	0.16
11/17/12 3:00 PM	0.00	0.13	0.15
11/17/12 5:00 PM	0.00	0.13	0.02
11/17/12 7:00 PM	0.00	0.14	0.02
11/17/12 9:00 PM	0.00	0.14	0.02
11/17/12 11:00 PM	0.00	0.14	0.03
11/18/12 1:00 AM	0.00	0.14	0.13
11/18/12 3:00 AM	0.17	0.17	0.16
11/18/12 5:00 AM	0.20	0.20	0.16
11/18/12 7:00 AM	0.18	0.18	0.16
11/18/12 9:00 AM	0.21	0.21	0.18
11/18/12 11:00 AM	0.18	0.18	0.18
11/18/12 1:00 PM	0.26	0.26	0.18
11/18/12 3:00 PM	0.26	0.26	0.16
11/18/12 5:00 PM	0.27	0.27	0.03

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
11/18/12 7:00 PM	0.13	0.13	0.03
11/18/12 9:00 PM	0.13	0.13	0.10
11/18/12 11:00 PM	0.23	0.23	0.14
11/19/12 1:00 AM	0.13	0.13	0.14
11/19/12 3:00 AM	0.10	0.10	0.14
11/19/12 5:00 AM	0.13	0.13	0.15
11/19/12 7:00 AM	0.25	0.25	0.17
11/19/12 9:00 AM	0.23	0.23	0.21
11/19/12 11:00 AM	0.09	0.09	0.20
11/19/12 1:00 PM	0.09	0.09	0.19
11/19/12 3:00 PM	0.09	0.09	0.20
11/19/12 5:00 PM	0.09	0.09	0.22
11/19/12 7:00 PM	0.08	0.08	0.23
11/19/12 9:00 PM	0.08	0.08	0.32
11/19/12 11:00 PM	0.26	0.26	0.30
11/20/12 1:00 AM	0.24	0.24	0.29
11/20/12 3:00 AM	0.16	0.16	0.26
11/20/12 5:00 AM	0.15	0.15	0.30
11/20/12 7:00 AM	0.23	0.23	0.23
11/20/12 9:00 AM	0.10	0.10	0.20
11/20/12 11:00 AM	0.19	0.19	0.20
11/20/12 1:00 PM	0.19	0.19	0.21
11/20/12 3:00 PM	0.10	0.10	0.22
11/20/12 5:00 PM	0.10	0.10	0.19
11/20/12 7:00 PM	0.11	0.11	0.19
11/20/12 9:00 PM	0.10	0.10	0.26
11/20/12 11:00 PM	0.10	0.10	0.00
11/21/12 1:00 AM	0.26	0.26	0.00
11/21/12 3:00 AM	0.14	0.14	0.00
11/21/12 5:00 AM	0.25	0.25	0.00
11/21/12 7:00 AM	0.09	0.09	0.00
11/21/12 9:00 AM	0.08	0.08	0.00
11/21/12 11:00 AM	0.09	0.09	0.00
11/21/12 1:00 PM	0.11	0.11	0.00
11/21/12 3:00 PM	0.15	0.15	0.00
11/21/12 5:00 PM	0.00	0.04	0.00
11/21/12 7:00 PM	0.00	0.04	0.00
11/21/12 9:00 PM	0.00	0.04	0.00
11/21/12 11:00 PM	0.00	0.04	0.00
11/22/12 1:00 AM	0.00	0.00	0.00
11/22/12 3:00 AM	0.00	0.00	0.00
11/22/12 5:00 AM	0.00	0.00	0.00
11/22/12 7:00 AM	0.00	0.00	0.00
11/22/12 9:00 AM	0.00	0.00	0.00
11/22/12 11:00 AM	0.00	0.00	0.00
11/22/12 1:00 PM	0.00	0.00	0.00
11/22/12 3:00 PM	0.00	0.00	0.00
11/22/12 5:00 PM	0.00	0.00	0.00
11/22/12 7:00 PM	0.00	0.00	0.00
11/22/12 9:00 PM	0.00	0.00	0.00
11/22/12 11:00 PM	0.00	0.00	0.00
11/23/12 1:00 AM	0.00	0.00	0.00
11/23/12 3:00 AM	0.00	0.00	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
11/23/12 5:00 AM	0.00	0.00	0.00
11/23/12 7:00 AM	0.00	0.00	0.00
11/23/12 9:00 AM	0.00	0.00	0.00
11/23/12 11:00 AM	0.00	0.00	0.00
11/23/12 1:00 PM	0.00	0.00	0.00
11/23/12 3:00 PM	0.00	0.00	0.00
11/23/12 5:00 PM	0.00	0.00	0.00
11/23/12 7:00 PM	0.00	0.00	0.00
11/23/12 9:00 PM	0.00	0.00	0.00
11/23/12 11:00 PM	0.00	0.00	0.00
11/24/12 1:00 AM	0.00	0.00	0.19
11/24/12 3:00 AM	0.00	0.00	0.19
11/24/12 5:00 AM	0.00	0.00	0.19
11/24/12 7:00 AM	0.00	0.00	0.21
11/24/12 9:00 AM	0.00	0.00	0.19
11/24/12 11:00 AM	0.00	0.00	0.17
11/24/12 1:00 PM	0.00	0.00	0.16
11/24/12 3:00 PM	0.00	0.00	0.15
11/24/12 5:00 PM	0.00	0.00	0.14
11/24/12 7:00 PM	0.00	0.00	0.13
11/24/12 9:00 PM	0.00	0.00	0.13
11/24/12 11:00 PM	0.00	0.00	0.12
11/25/12 1:00 AM	0.00	0.00	0.13
11/25/12 3:00 AM	0.00	0.00	0.13
11/25/12 5:00 AM	0.00	0.00	0.13
11/25/12 7:00 AM	0.00	0.00	0.14
11/25/12 9:00 AM	0.00	0.00	0.13
11/25/12 11:00 AM	0.00	0.00	0.13
11/25/12 1:00 PM	0.00	0.00	0.14
11/25/12 3:00 PM	0.00	0.00	0.13
11/25/12 5:00 PM	0.00	0.00	0.13
11/25/12 7:00 PM	0.00	0.00	0.13
11/25/12 9:00 PM	0.00	0.00	0.13
11/25/12 11:00 PM	0.00	0.00	0.13
11/26/12 1:00 AM	0.00	0.00	0.13
11/26/12 3:00 AM	0.00	0.00	0.14
11/26/12 5:00 AM	0.00	0.00	0.14
11/26/12 7:00 AM	0.00	0.00	0.14
11/26/12 9:00 AM	0.00	0.00	0.13
11/26/12 11:00 AM	0.00	0.00	0.15
11/26/12 1:00 PM	0.00	0.00	0.15
11/26/12 3:00 PM	0.00	0.00	0.18
11/26/12 5:00 PM	0.00	0.00	0.18
11/26/12 7:00 PM	0.00	0.00	0.18
11/26/12 9:00 PM	0.00	0.00	0.18
11/26/12 11:00 PM	0.00	0.00	0.18
11/27/12 1:00 AM	0.00	0.00	0.19
11/27/12 3:00 AM	0.00	0.00	0.19
11/27/12 5:00 AM	0.00	0.00	0.19
11/27/12 7:00 AM	0.00	0.00	0.18
11/27/12 9:00 AM	0.00	0.00	0.15
11/27/12 11:00 AM	0.00	0.00	0.19
11/27/12 1:00 PM	0.00	0.00	0.21

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
11/27/12 3:00 PM	0.00	0.00	0.22
11/27/12 5:00 PM	0.00	0.00	0.22
11/27/12 7:00 PM	0.00	0.00	0.21
11/27/12 9:00 PM	0.00	0.00	0.20
11/27/12 11:00 PM	0.00	0.00	0.20
11/28/12 1:00 AM	0.00	0.00	0.17
11/28/12 3:00 AM	0.00	0.00	0.14
11/28/12 5:00 AM	0.00	0.00	0.14
11/28/12 7:00 AM	0.00	0.00	0.19
11/28/12 9:00 AM	0.00	0.00	0.19
11/28/12 11:00 AM	0.00	0.00	0.18
11/28/12 1:00 PM	0.00	0.00	0.18
11/28/12 3:00 PM	0.00	0.00	0.17
11/28/12 5:00 PM	0.22	0.00	0.17
11/28/12 7:00 PM	0.20	0.00	0.17
11/28/12 9:00 PM	0.18	0.00	0.16
11/28/12 11:00 PM	0.18	0.00	0.16
11/29/12 1:00 AM	0.19	0.00	0.17
11/29/12 3:00 AM	0.28	0.00	0.17
11/29/12 5:00 AM	0.34	0.00	0.15
11/29/12 7:00 AM	0.31	0.00	0.19
11/29/12 9:00 AM	0.17	0.00	0.18
11/29/12 11:00 AM	0.13	0.00	0.18
11/29/12 1:00 PM	0.13	0.00	0.17
11/29/12 3:00 PM	0.13	0.00	0.16
11/29/12 5:00 PM	0.13	0.00	0.17
11/29/12 7:00 PM	0.13	0.00	0.17
11/29/12 9:00 PM	0.12	0.00	0.16
11/29/12 11:00 PM	0.12	0.00	0.14
11/30/12 1:00 AM	0.29	0.00	0.09
11/30/12 3:00 AM	0.28	0.00	0.10
11/30/12 5:00 AM	0.27	0.00	0.12
11/30/12 7:00 AM	0.14	0.00	0.18
11/30/12 9:00 AM	0.24	0.00	0.18
11/30/12 11:00 AM	0.14	0.00	0.18
11/30/12 1:00 PM	0.08	0.00	0.17
11/30/12 3:00 PM	0.08	0.00	0.15
11/30/12 5:00 PM	0.08	0.00	0.15
11/30/12 7:00 PM	0.08	0.00	0.15
11/30/12 9:00 PM	0.08	0.00	0.13
11/30/12 11:00 PM	0.07	0.00	0.10
12/1/12 1:00 AM	0.21	0.00	0.10
12/1/12 3:00 AM	0.25	0.00	0.09
12/1/12 5:00 AM	0.25	0.00	0.10
12/1/12 7:00 AM	0.20	0.00	0.10
12/1/12 9:00 AM	0.06	0.00	0.07
12/1/12 11:00 AM	0.06	0.00	0.04
12/1/12 1:00 PM	0.06	0.00	0.07
12/1/12 3:00 PM	0.06	0.00	0.09
12/1/12 5:00 PM	0.06	0.00	0.09
12/1/12 7:00 PM	0.06	0.00	0.09
12/1/12 9:00 PM	0.05	0.00	0.14
12/1/12 11:00 PM	0.05	0.00	0.16

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
12/2/12 1:00 AM	0.15	0.15	0.14
12/2/12 3:00 AM	0.23	0.23	0.07
12/2/12 5:00 AM	0.22	0.22	0.07
12/2/12 7:00 AM	0.22	0.22	0.08
12/2/12 9:00 AM	0.09	0.09	0.13
12/2/12 11:00 AM	0.05	0.00	0.14
12/2/12 1:00 PM	0.05	0.00	0.12
12/2/12 3:00 PM	0.05	0.00	0.12
12/2/12 5:00 PM	0.05	0.00	0.12
12/2/12 7:00 PM	0.05	0.00	0.11
12/2/12 9:00 PM	0.04	0.00	0.12
12/2/12 11:00 PM	0.16	0.00	0.12
12/3/12 1:00 AM	0.16	0.00	0.09
12/3/12 3:00 AM	0.10	0.00	0.08
12/3/12 5:00 AM	0.15	0.00	0.10
12/3/12 7:00 AM	0.10	0.00	0.14
12/3/12 9:00 AM	0.05	0.00	0.13
12/3/12 11:00 AM	0.05	0.00	0.13
12/3/12 1:00 PM	0.05	0.00	0.13
12/3/12 3:00 PM	0.05	0.00	0.13
12/3/12 5:00 PM	0.05	0.05	0.13
12/3/12 7:00 PM	0.05	0.05	0.13
12/3/12 9:00 PM	0.05	0.05	0.14
12/3/12 11:00 PM	0.05	0.05	0.13
12/4/12 1:00 AM	0.06	0.06	0.13
12/4/12 3:00 AM	0.21	0.21	0.11
12/4/12 5:00 AM	0.15	0.15	0.11
12/4/12 7:00 AM	0.05	0.05	0.12
12/4/12 9:00 AM	0.04	0.04	0.12
12/4/12 11:00 AM	0.05	0.05	0.11
12/4/12 1:00 PM	0.05	0.05	0.12
12/4/12 3:00 PM	0.04	0.04	0.11
12/4/12 5:00 PM	0.05	0.05	0.11
12/4/12 7:00 PM	0.05	0.05	0.12
12/4/12 9:00 PM	0.04	0.04	0.15
12/4/12 11:00 PM	0.04	0.04	0.23
12/5/12 1:00 AM	0.16	0.16	0.22
12/5/12 3:00 AM	0.14	0.14	0.21
12/5/12 5:00 AM	0.00	0.04	0.10
12/5/12 7:00 AM	0.00	0.03	0.10
12/5/12 9:00 AM	0.00	0.02	0.11
12/5/12 11:00 AM	0.00	0.02	0.11
12/5/12 1:00 PM	0.00	0.06	0.11
12/5/12 3:00 PM	0.00	0.08	0.11
12/5/12 5:00 PM	0.00	0.08	0.11
12/5/12 7:00 PM	0.00	0.07	0.11
12/5/12 9:00 PM	0.00	0.07	0.10
12/5/12 11:00 PM	0.00	0.08	0.10
12/6/12 1:00 AM	0.00	0.07	0.10
12/6/12 3:00 AM	0.00	0.07	0.08
12/6/12 5:00 AM	0.00	0.07	0.12
12/6/12 7:00 AM	0.00	0.08	0.12
12/6/12 9:00 AM	0.00	0.09	0.11

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
12/6/12 11:00 AM	0.00	0.09	0.10
12/6/12 1:00 PM	0.00	0.09	0.12
12/6/12 3:00 PM	0.00	0.09	0.12
12/6/12 5:00 PM	0.00	0.10	0.12
12/6/12 7:00 PM	0.00	0.09	0.12
12/6/12 9:00 PM	0.00	0.09	0.16
12/6/12 11:00 PM	0.00	0.09	0.19
12/7/12 1:00 AM	0.00	0.10	0.18
12/7/12 3:00 AM	0.00	0.09	0.17
12/7/12 5:00 AM	0.00	0.10	0.12
12/7/12 7:00 AM	0.00	0.11	0.12
12/7/12 9:00 AM	0.00	0.11	0.12
12/7/12 11:00 AM	0.00	0.11	0.12
12/7/12 1:00 PM	0.00	0.09	0.12
12/7/12 3:00 PM	0.00	0.11	0.12
12/7/12 5:00 PM	0.00	0.11	0.12
12/7/12 7:00 PM	0.00	0.11	0.12
12/7/12 9:00 PM	0.00	0.11	0.12
12/7/12 11:00 PM	0.00	0.11	0.12
12/8/12 1:00 AM	0.00	0.11	0.12
12/8/12 3:00 AM	0.00	0.12	0.13
12/8/12 5:00 AM	0.00	0.11	0.13
12/8/12 7:00 AM	0.00	0.12	0.14
12/8/12 9:00 AM	0.00	0.11	0.14
12/8/12 11:00 AM	0.00	0.11	0.13
12/8/12 1:00 PM	0.00	0.12	0.13
12/8/12 3:00 PM	0.00	0.13	0.13
12/8/12 5:00 PM	0.00	0.13	0.13
12/8/12 7:00 PM	0.00	0.13	0.13
12/8/12 9:00 PM	0.00	0.13	0.13
12/8/12 11:00 PM	0.00	0.13	0.13
12/9/12 1:00 AM	0.00	0.12	0.11
12/9/12 3:00 AM	0.00	0.12	0.09
12/9/12 5:00 AM	0.00	0.14	0.09
12/9/12 7:00 AM	0.00	0.14	0.11
12/9/12 9:00 AM	0.00	0.14	0.14
12/9/12 11:00 AM	0.00	0.14	0.15
12/9/12 1:00 PM	0.00	0.14	0.15
12/9/12 3:00 PM	0.00	0.14	0.15
12/9/12 5:00 PM	0.00	0.15	0.14
12/9/12 7:00 PM	0.00	0.15	0.14
12/9/12 9:00 PM	0.00	0.15	0.14
12/9/12 11:00 PM	0.00	0.15	0.14
12/10/12 1:00 AM	0.00	0.15	0.14
12/10/12 3:00 AM	0.00	0.16	0.12
12/10/12 5:00 AM	0.00	0.16	0.12
12/10/12 7:00 AM	0.00	0.17	0.15
12/10/12 9:00 AM	0.00	0.17	0.15
12/10/12 11:00 AM	0.00	0.17	0.16
12/10/12 1:00 PM	0.00	0.18	0.16
12/10/12 3:00 PM	0.00	0.18	0.16
12/10/12 5:00 PM	0.18	0.18	0.16
12/10/12 7:00 PM	0.16	0.16	0.16

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
12/10/12 9:00 PM	0.14	0.14	0.16
12/10/12 11:00 PM	0.16	0.16	0.15
12/11/12 1:00 AM	0.14	0.14	0.13
12/11/12 3:00 AM	0.25	0.25	0.09
12/11/12 5:00 AM	0.27	0.27	0.14
12/11/12 7:00 AM	0.15	0.15	0.16
12/11/12 9:00 AM	0.10	0.10	0.15
12/11/12 11:00 AM	0.10	0.10	0.15
12/11/12 1:00 PM	0.10	0.10	0.15
12/11/12 3:00 PM	0.10	0.10	0.16
12/11/12 5:00 PM	0.11	0.11	0.17
12/11/12 7:00 PM	0.11	0.11	0.17
12/11/12 9:00 PM	0.11	0.11	0.17
12/11/12 11:00 PM	0.12	0.12	0.17
12/12/12 1:00 AM	0.28	0.28	0.14
12/12/12 3:00 AM	0.28	0.28	0.10
12/12/12 5:00 AM	0.22	0.22	0.10
12/12/12 7:00 AM	0.10	0.10	0.18
12/12/12 9:00 AM	0.10	0.10	0.15
12/12/12 11:00 AM	0.10	0.10	0.15
12/12/12 1:00 PM	0.10	0.10	0.14
12/12/12 3:00 PM	0.10	0.10	0.13
12/12/12 5:00 PM	0.10	0.10	0.14
12/12/12 7:00 PM	0.10	0.10	0.14
12/12/12 9:00 PM	0.10	0.10	0.15
12/12/12 11:00 PM	0.10	0.10	0.15
12/13/12 1:00 AM	0.26	0.26	0.14
12/13/12 3:00 AM	0.26	0.26	0.13
12/13/12 5:00 AM	0.30	0.30	0.13
12/13/12 7:00 AM	0.16	0.16	0.14
12/13/12 9:00 AM	0.12	0.12	0.14
12/13/12 11:00 AM	0.10	0.10	0.22
12/13/12 1:00 PM	0.30	0.30	0.24
12/13/12 3:00 PM	0.29	0.29	0.20
12/13/12 5:00 PM	0.15	0.15	0.18
12/13/12 7:00 PM	0.15	0.15	0.18
12/13/12 9:00 PM	0.16	0.16	0.18
12/13/12 11:00 PM	0.18	0.18	0.18
12/14/12 1:00 AM	0.25	0.25	0.19
12/14/12 3:00 AM	0.37	0.37	0.19
12/14/12 5:00 AM	0.28	0.28	0.19
12/14/12 7:00 AM	0.19	0.19	0.19
12/14/12 9:00 AM	0.16	0.16	0.19
12/14/12 11:00 AM	0.15	0.15	0.19
12/14/12 1:00 PM	0.16	0.16	0.20
12/14/12 3:00 PM	0.16	0.16	0.20
12/14/12 5:00 PM	0.17	0.17	0.21
12/14/12 7:00 PM	0.17	0.17	0.21
12/14/12 9:00 PM	0.18	0.18	0.21
12/14/12 11:00 PM	0.17	0.17	0.21
12/15/12 1:00 AM	0.16	0.16	0.19
12/15/12 3:00 AM	0.14	0.14	0.13
12/15/12 5:00 AM	0.15	0.15	0.14

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
12/15/12 7:00 AM	0.19	0.19	0.24
12/15/12 9:00 AM	0.18	0.18	0.22
12/15/12 11:00 AM	0.18	0.18	0.25
12/15/12 1:00 PM	0.18	0.18	0.21
12/15/12 3:00 PM	0.18	0.18	0.18
12/15/12 5:00 PM	0.18	0.18	0.17
12/15/12 7:00 PM	0.18	0.18	0.16
12/15/12 9:00 PM	0.17	0.17	0.16
12/15/12 11:00 PM	0.18	0.18	0.14
12/16/12 1:00 AM	0.16	0.16	0.13
12/16/12 3:00 AM	0.32	0.32	0.09
12/16/12 5:00 AM	0.37	0.37	0.08
12/16/12 7:00 AM	0.36	0.36	1.29
12/16/12 9:00 AM	0.18	0.18	0.12
12/16/12 11:00 AM	0.17	0.17	0.21
12/16/12 1:00 PM	0.18	0.18	0.20
12/16/12 3:00 PM	0.20	0.20	0.20
12/16/12 5:00 PM	0.21	0.21	0.20
12/16/12 7:00 PM	0.23	0.23	0.20
12/16/12 9:00 PM	0.23	0.23	0.20
12/16/12 11:00 PM	0.23	0.23	0.20
12/17/12 1:00 AM	0.41	0.41	0.13
12/17/12 3:00 AM	0.38	0.38	0.11
12/17/12 5:00 AM	0.32	0.32	0.15
12/17/12 7:00 AM	0.13	0.13	0.20
12/17/12 9:00 AM	0.13	0.13	0.19
12/17/12 11:00 AM	0.14	0.14	0.19
12/17/12 1:00 PM	0.15	0.15	0.18
12/17/12 3:00 PM	0.15	0.15	0.19
12/17/12 5:00 PM	0.14	0.14	0.19
12/17/12 7:00 PM	0.14	0.14	0.19
12/17/12 9:00 PM	0.15	0.15	0.19
12/17/12 11:00 PM	0.16	0.16	0.19
12/18/12 1:00 AM	0.16	0.16	0.18
12/18/12 3:00 AM	0.36	0.36	0.12
12/18/12 5:00 AM	0.26	0.26	0.16
12/18/12 7:00 AM	0.16	0.16	0.21
12/18/12 9:00 AM	0.14	0.14	0.21
12/18/12 11:00 AM	0.13	0.13	0.21
12/18/12 1:00 PM	0.13	0.13	0.20
12/18/12 3:00 PM	0.12	0.12	0.19
12/18/12 5:00 PM	0.12	0.12	0.19
12/18/12 7:00 PM	0.11	0.11	0.21
12/18/12 9:00 PM	0.11	0.11	0.24
12/18/12 11:00 PM	0.13	0.13	0.49
12/19/12 1:00 AM	0.22	0.22	0.31
12/19/12 3:00 AM	0.26	0.26	0.16
12/19/12 5:00 AM	0.29	0.29	0.14
12/19/12 7:00 AM	0.17	0.17	0.13
12/19/12 9:00 AM	0.07	0.07	0.13
12/19/12 11:00 AM	0.05	0.00	0.12
12/19/12 1:00 PM	0.22	0.00	0.11
12/19/12 3:00 PM	0.25	0.00	0.11

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
12/19/12 5:00 PM	0.26	0.00	0.11
12/19/12 7:00 PM	0.27	0.00	0.11
12/19/12 9:00 PM	0.26	0.00	0.12
12/19/12 11:00 PM	0.25	0.00	0.12
12/20/12 1:00 AM	0.27	0.00	0.12
12/20/12 3:00 AM	0.27	0.00	0.14
12/20/12 5:00 AM	0.27	0.00	0.16
12/20/12 7:00 AM	0.25	0.00	0.16
12/20/12 9:00 AM	0.18	0.00	0.16
12/20/12 11:00 AM	0.16	0.00	0.15
12/20/12 1:00 PM	0.17	0.00	0.15
12/20/12 3:00 PM	0.17	0.00	0.15
12/20/12 5:00 PM	0.22	0.00	0.18
12/20/12 7:00 PM	0.24	0.00	0.16
12/20/12 9:00 PM	0.24	0.00	0.15
12/20/12 11:00 PM	0.22	0.00	0.13
12/21/12 1:00 AM	0.19	0.00	0.12
12/21/12 3:00 AM	0.12	0.00	0.11
12/21/12 5:00 AM	0.11	0.00	0.11
12/21/12 7:00 AM	0.19	0.00	0.11
12/21/12 9:00 AM	0.20	0.00	0.11
12/21/12 11:00 AM	0.18	0.00	0.12
12/21/12 1:00 PM	0.13	0.00	0.12
12/21/12 3:00 PM	0.12	0.00	0.12
12/21/12 5:00 PM	0.12	0.00	0.24
12/21/12 7:00 PM	0.12	0.00	0.13
12/21/12 9:00 PM	0.13	0.00	0.13
12/21/12 11:00 PM	0.13	0.00	0.13
12/22/12 1:00 AM	0.13	0.00	0.13
12/22/12 3:00 AM	0.13	0.00	0.14
12/22/12 5:00 AM	0.13	0.00	0.14
12/22/12 7:00 AM	0.13	0.00	0.14
12/22/12 9:00 AM	0.13	0.00	0.15
12/22/12 11:00 AM	0.12	0.00	0.16
12/22/12 1:00 PM	0.12	0.00	0.16
12/22/12 3:00 PM	0.12	0.00	0.16
12/22/12 5:00 PM	0.12	0.00	0.17
12/22/12 7:00 PM	0.12	0.00	0.17
12/22/12 9:00 PM	0.12	0.00	0.18
12/22/12 11:00 PM	0.12	0.00	0.17
12/23/12 1:00 AM	0.12	0.00	0.16
12/23/12 3:00 AM	0.13	0.00	0.12
12/23/12 5:00 AM	0.12	0.00	0.11
12/23/12 7:00 AM	0.12	0.00	0.11
12/23/12 9:00 AM	0.12	0.00	0.11
12/23/12 11:00 AM	0.11	0.00	0.12
12/23/12 1:00 PM	0.11	0.00	0.12
12/23/12 3:00 PM	0.11	0.00	0.13
12/23/12 5:00 PM	0.11	0.00	0.15
12/23/12 7:00 PM	0.11	0.00	0.16
12/23/12 9:00 PM	0.10	0.00	0.16
12/23/12 11:00 PM	0.10	0.00	0.18
12/24/12 1:00 AM	0.10	0.00	0.17

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
12/24/12 3:00 AM	0.10	0.00	0.13
12/24/12 5:00 AM	0.10	0.00	0.14
12/24/12 7:00 AM	0.11	0.00	0.16
12/24/12 9:00 AM	0.12	0.00	0.20
12/24/12 11:00 AM	0.11	0.00	0.21
12/24/12 1:00 PM	0.11	0.00	0.21
12/24/12 3:00 PM	0.11	0.00	0.21
12/24/12 5:00 PM	0.11	0.00	0.19
12/24/12 7:00 PM	0.11	0.00	0.19
12/24/12 9:00 PM	0.11	0.00	0.19
12/24/12 11:00 PM	0.11	0.00	0.19
12/25/12 1:00 AM	0.13	0.00	0.18
12/25/12 3:00 AM	0.14	0.00	0.16
12/25/12 5:00 AM	0.15	0.00	0.16
12/25/12 7:00 AM	0.14	0.00	0.16
12/25/12 9:00 AM	0.14	0.00	0.18
12/25/12 11:00 AM	0.12	0.00	0.18
12/25/12 1:00 PM	0.12	0.00	0.18
12/25/12 3:00 PM	0.12	0.00	0.18
12/25/12 5:00 PM	0.12	0.00	0.19
12/25/12 7:00 PM	0.13	0.00	0.18
12/25/12 9:00 PM	0.13	0.00	0.17
12/25/12 11:00 PM	0.12	0.00	0.18
12/26/12 1:00 AM	0.09	0.00	0.17
12/26/12 3:00 AM	0.09	0.00	0.14
12/26/12 5:00 AM	0.10	0.00	0.14
12/26/12 7:00 AM	0.09	0.00	0.14
12/26/12 9:00 AM	0.12	0.00	0.21
12/26/12 11:00 AM	0.14	0.00	0.22
12/26/12 1:00 PM	0.13	0.00	0.21
12/26/12 3:00 PM	0.13	0.00	0.21
12/26/12 5:00 PM	0.13	0.00	0.20
12/26/12 7:00 PM	0.14	0.00	0.20
12/26/12 9:00 PM	0.14	0.00	0.20
12/26/12 11:00 PM	0.13	0.00	0.43
12/27/12 1:00 AM	0.13	0.00	0.30
12/27/12 3:00 AM	0.12	0.00	0.18
12/27/12 5:00 AM	0.12	0.00	0.14
12/27/12 7:00 AM	0.12	0.00	0.15
12/27/12 9:00 AM	0.14	0.00	0.15
12/27/12 11:00 AM	0.13	0.00	0.14
12/27/12 1:00 PM	0.13	0.00	0.14
12/27/12 3:00 PM	0.12	0.00	0.12
12/27/12 5:00 PM	0.13	0.00	0.12
12/27/12 7:00 PM	0.13	0.00	0.12
12/27/12 9:00 PM	0.13	0.00	0.13
12/27/12 11:00 PM	0.14	0.00	0.13
12/28/12 1:00 AM	0.13	0.00	0.13
12/28/12 3:00 AM	0.13	0.00	0.13
12/28/12 5:00 AM	0.14	0.00	0.14
12/28/12 7:00 AM	0.16	0.00	0.14
12/28/12 9:00 AM	0.17	0.00	0.14
12/28/12 11:00 AM	0.15	0.00	0.14

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
12/28/12 1:00 PM	0.15	0.00	0.15
12/28/12 3:00 PM	0.15	0.00	0.15
12/28/12 5:00 PM	0.16	0.00	0.14
12/28/12 7:00 PM	0.12	0.00	0.14
12/28/12 9:00 PM	0.13	0.00	0.14
12/28/12 11:00 PM	0.12	0.00	0.14
12/29/12 1:00 AM	0.13	0.00	0.09
12/29/12 3:00 AM	0.13	0.00	0.09
12/29/12 5:00 AM	0.14	0.00	0.10
12/29/12 7:00 AM	0.14	0.00	0.14
12/29/12 9:00 AM	0.13	0.00	0.17
12/29/12 11:00 AM	0.14	0.00	0.17
12/29/12 1:00 PM	0.14	0.00	0.17
12/29/12 3:00 PM	0.13	0.00	0.17
12/29/12 5:00 PM	0.14	0.00	0.17
12/29/12 7:00 PM	0.14	0.00	0.17
12/29/12 9:00 PM	0.15	0.00	0.16
12/29/12 11:00 PM	0.15	0.00	0.17
12/30/12 1:00 AM	0.15	0.00	0.18
12/30/12 3:00 AM	0.15	0.00	0.19
12/30/12 5:00 AM	0.15	0.00	0.19
12/30/12 7:00 AM	0.14	0.00	0.20
12/30/12 9:00 AM	0.12	0.00	0.20
12/30/12 11:00 AM	0.13	0.00	0.20
12/30/12 1:00 PM	0.14	0.00	0.20
12/30/12 3:00 PM	0.13	0.00	0.19
12/30/12 5:00 PM	0.14	0.00	0.21
12/30/12 7:00 PM	0.14	0.00	0.21
12/30/12 9:00 PM	0.14	0.00	0.21
12/30/12 11:00 PM	0.13	0.00	0.22
12/31/12 1:00 AM	0.13	0.00	0.22
12/31/12 3:00 AM	0.13	0.00	0.23
12/31/12 5:00 AM	0.14	0.00	0.25
12/31/12 7:00 AM	0.15	0.00	0.26
12/31/12 9:00 AM	0.15	0.00	0.26
12/31/12 11:00 AM	0.11	0.00	0.25
12/31/12 1:00 PM	0.13	0.00	0.22
12/31/12 3:00 PM	0.31	0.00	0.22
12/31/12 5:00 PM	0.14	0.00	0.22
12/31/12 7:00 PM	0.15	0.00	0.19
12/31/12 9:00 PM	0.15	0.00	0.00
12/31/12 11:00 PM	0.15	0.00	0.20
1/1/13 1:00 AM	0.15	0.00	0.21
1/1/13 3:00 AM	0.13	0.00	0.22
1/1/13 5:00 AM	0.13	0.00	0.22
1/1/13 7:00 AM	0.14	0.00	0.24
1/1/13 9:00 AM	0.14	0.00	0.25
1/1/13 11:00 AM	0.13	0.00	0.24
1/1/13 1:00 PM	0.13	0.00	0.25
1/1/13 3:00 PM	0.13	0.00	0.26
1/1/13 5:00 PM	0.13	0.00	0.24
1/1/13 7:00 PM	0.13	0.00	0.21
1/1/13 9:00 PM	0.13	0.00	0.23

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
1/1/13 11:00 PM	0.14	0.00	0.24
1/2/13 1:00 AM	0.13	0.00	0.21
1/2/13 3:00 AM	0.13	0.00	0.21
1/2/13 5:00 AM	0.13	0.00	0.21
1/2/13 7:00 AM	0.15	0.00	0.24
1/2/13 9:00 AM	0.15	0.00	0.23
1/2/13 11:00 AM	0.15	0.00	0.24
1/2/13 1:00 PM	0.14	0.00	0.23
1/2/13 3:00 PM	0.15	0.00	0.23
1/2/13 5:00 PM	0.15	0.00	0.23
1/2/13 7:00 PM	0.15	0.00	0.22
1/2/13 9:00 PM	0.15	0.00	0.21
1/2/13 11:00 PM	0.15	0.00	0.26
1/3/13 1:00 AM	0.11	0.00	0.33
1/3/13 3:00 AM	0.09	0.00	0.34
1/3/13 5:00 AM	0.10	0.00	0.26
1/3/13 7:00 AM	0.15	0.00	0.23
1/3/13 9:00 AM	0.17	0.00	0.23
1/3/13 11:00 AM	0.15	0.00	0.22
1/3/13 1:00 PM	0.16	0.00	0.23
1/3/13 3:00 PM	0.16	0.00	0.23
1/3/13 5:00 PM	0.16	0.00	0.21
1/3/13 7:00 PM	0.16	0.00	0.20
1/3/13 9:00 PM	0.16	0.00	0.19
1/3/13 11:00 PM	0.16	0.00	0.20
1/4/13 1:00 AM	0.15	0.00	0.20
1/4/13 3:00 AM	0.15	0.00	0.22
1/4/13 5:00 AM	0.16	0.00	0.22
1/4/13 7:00 AM	0.16	0.00	0.22
1/4/13 9:00 AM	0.16	0.00	0.22
1/4/13 11:00 AM	0.17	0.00	0.15
1/4/13 1:00 PM	0.16	0.00	0.12
1/4/13 3:00 PM	0.17	0.00	0.16
1/4/13 5:00 PM	0.17	0.00	0.20
1/4/13 7:00 PM	0.17	0.00	0.22
1/4/13 9:00 PM	0.17	0.00	0.23
1/4/13 11:00 PM	0.16	0.00	0.23
1/5/13 1:00 AM	0.15	0.00	0.18
1/5/13 3:00 AM	0.15	0.00	0.13
1/5/13 5:00 AM	0.15	0.00	0.15
1/5/13 7:00 AM	0.15	0.00	0.23
1/5/13 9:00 AM	0.15	0.00	0.23
1/5/13 11:00 AM	0.16	0.00	0.23
1/5/13 1:00 PM	0.16	0.00	0.21
1/5/13 3:00 PM	0.15	0.00	0.21
1/5/13 5:00 PM	0.15	0.00	0.21
1/5/13 7:00 PM	0.15	0.00	0.21
1/5/13 9:00 PM	0.15	0.00	0.21
1/5/13 11:00 PM	0.14	0.00	0.20
1/6/13 1:00 AM	0.14	0.00	0.20
1/6/13 3:00 AM	0.01	0.00	0.20
1/6/13 5:00 AM	0.00	0.00	0.20
1/6/13 7:00 AM	0.00	0.00	0.21

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
1/6/13 9:00 AM	0.00	0.00	0.21
1/6/13 11:00 AM	0.00	0.00	0.21
1/6/13 1:00 PM	0.00	0.00	0.20
1/6/13 3:00 PM	0.00	0.00	0.21
1/6/13 5:00 PM	0.00	0.00	0.20
1/6/13 7:00 PM	0.00	0.00	0.20
1/6/13 9:00 PM	0.00	0.00	0.21
1/6/13 11:00 PM	0.00	0.00	0.21
1/7/13 1:00 AM	0.00	0.00	0.22
1/7/13 3:00 AM	0.00	0.00	0.22
1/7/13 5:00 AM	0.00	0.00	0.22
1/7/13 7:00 AM	0.00	0.00	0.22
1/7/13 9:00 AM	0.00	0.00	0.23
1/7/13 11:00 AM	0.00	0.00	0.22
1/7/13 1:00 PM	0.00	0.00	0.22
1/7/13 3:00 PM	0.00	0.00	0.22
1/7/13 5:00 PM	0.00	0.00	0.22
1/7/13 7:00 PM	0.00	0.00	0.22
1/7/13 9:00 PM	0.00	0.00	0.21
1/7/13 11:00 PM	0.00	0.00	0.22
1/8/13 1:00 AM	0.00	0.00	0.22
1/8/13 3:00 AM	0.00	0.00	0.22
1/8/13 5:00 AM	0.00	0.00	0.21
1/8/13 7:00 AM	0.03	0.00	0.22
1/8/13 9:00 AM	0.00	0.00	0.28
1/8/13 11:00 AM	0.00	0.00	0.36
1/8/13 1:00 PM	0.01	0.00	0.44
1/8/13 3:00 PM	0.00	0.00	0.22
1/8/13 5:00 PM	0.00	0.00	0.20
1/8/13 7:00 PM	0.00	0.00	0.21
1/8/13 9:00 PM	0.00	0.00	0.21
1/8/13 11:00 PM	0.00	0.00	0.21
1/9/13 1:00 AM	0.00	0.00	0.22
1/9/13 3:00 AM	0.00	0.00	0.23
1/9/13 5:00 AM	0.00	0.00	0.14
1/9/13 7:00 AM	0.00	0.00	0.18
1/9/13 9:00 AM	0.00	0.00	0.18
1/9/13 11:00 AM	0.00	0.00	0.20
1/9/13 1:00 PM	0.00	0.00	0.20
1/9/13 3:00 PM	0.00	0.00	0.20
1/9/13 5:00 PM	0.00	0.00	0.21
1/9/13 7:00 PM	0.00	0.00	0.21
1/9/13 9:00 PM	0.00	0.00	0.24
1/9/13 11:00 PM	0.00	0.00	0.20
1/10/13 1:00 AM	0.00	0.00	0.23
1/10/13 3:00 AM	0.00	0.00	0.24
1/10/13 5:00 AM	0.00	0.00	0.23
1/10/13 7:00 AM	0.00	0.00	0.24
1/10/13 9:00 AM	0.00	0.00	0.25
1/10/13 11:00 AM	0.00	0.00	0.23
1/10/13 1:00 PM	0.00	0.00	0.19
1/10/13 3:00 PM	0.00	0.00	0.22
1/10/13 5:00 PM	0.00	0.02	0.20

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
1/10/13 7:00 PM	0.00	0.00	0.23
1/10/13 9:00 PM	0.00	0.00	0.24
1/10/13 11:00 PM	0.00	0.00	0.25
1/11/13 1:00 AM	0.00	0.00	0.24
1/11/13 3:00 AM	0.00	0.00	0.23
1/11/13 5:00 AM	0.00	0.00	0.20
1/11/13 7:00 AM	0.00	0.00	0.25
1/11/13 9:00 AM	0.00	0.01	0.22
1/11/13 11:00 AM	0.00	0.05	0.24
1/11/13 1:00 PM	0.00	0.13	0.25
1/11/13 3:00 PM	0.00	0.22	0.24
1/11/13 5:00 PM	0.00	0.22	0.24
1/11/13 7:00 PM	0.00	0.20	0.23
1/11/13 9:00 PM	0.00	0.21	0.25
1/11/13 11:00 PM	0.00	0.21	0.24
1/12/13 1:00 AM	0.00	0.19	0.24
1/12/13 3:00 AM	0.00	0.19	0.24
1/12/13 5:00 AM	0.00	0.19	0.22
1/12/13 7:00 AM	0.00	0.19	0.21
1/12/13 9:00 AM	0.00	0.18	0.20
1/12/13 11:00 AM	0.00	0.17	0.19
1/12/13 1:00 PM	0.00	0.17	0.18
1/12/13 3:00 PM	0.00	0.16	0.17
1/12/13 5:00 PM	0.00	0.16	0.17
1/12/13 7:00 PM	0.00	0.15	0.18
1/12/13 9:00 PM	0.00	0.16	0.18
1/12/13 11:00 PM	0.00	0.14	0.18
1/13/13 1:00 AM	0.00	0.13	0.19
1/13/13 3:00 AM	0.00	0.13	0.20
1/13/13 5:00 AM	0.00	0.14	0.20
1/13/13 7:00 AM	0.00	0.16	0.21
1/13/13 9:00 AM	0.00	0.17	0.22
1/13/13 11:00 AM	0.00	0.17	0.23
1/13/13 1:00 PM	0.00	0.18	0.23
1/13/13 3:00 PM	0.00	0.18	0.23
1/13/13 5:00 PM	0.00	0.18	0.23
1/13/13 7:00 PM	0.00	0.18	0.22
1/13/13 9:00 PM	0.00	0.17	0.23
1/13/13 11:00 PM	0.00	0.16	0.23
1/14/13 1:00 AM	0.00	0.16	0.24
1/14/13 3:00 AM	0.00	0.16	0.23
1/14/13 5:00 AM	0.00	0.16	0.24
1/14/13 7:00 AM	0.00	0.16	0.22
1/14/13 9:00 AM	0.00	0.18	0.22
1/14/13 11:00 AM	0.00	0.21	0.16
1/14/13 1:00 PM	0.00	0.21	0.06
1/14/13 3:00 PM	0.00	0.22	0.06
1/14/13 5:00 PM	0.00	0.22	0.05
1/14/13 7:00 PM	0.00	0.21	0.11
1/14/13 9:00 PM	0.00	0.18	0.19
1/14/13 11:00 PM	0.00	0.18	0.38
1/15/13 1:00 AM	0.00	0.14	0.42
1/15/13 3:00 AM	0.00	0.12	0.37

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
1/15/13 5:00 AM	0.00	0.12	0.24
1/15/13 7:00 AM	0.00	0.13	0.19
1/15/13 9:00 AM	0.00	0.15	0.18
1/15/13 11:00 AM	0.00	0.17	0.21
1/15/13 1:00 PM	0.00	0.19	0.21
1/15/13 3:00 PM	0.00	0.16	0.21
1/15/13 5:00 PM	0.00	0.16	0.24
1/15/13 7:00 PM	0.00	0.19	0.24
1/15/13 9:00 PM	0.00	0.17	0.23
1/15/13 11:00 PM	0.00	0.17	0.25
1/16/13 1:00 AM	0.00	0.15	0.23
1/16/13 3:00 AM	0.00	0.15	0.21
1/16/13 5:00 AM	0.00	0.17	0.23
1/16/13 7:00 AM	0.00	0.18	0.26
1/16/13 9:00 AM	0.00	0.18	0.21
1/16/13 11:00 AM	0.00	0.18	0.21
1/16/13 1:00 PM	0.00	0.19	0.21
1/16/13 3:00 PM	0.00	0.19	0.15
1/16/13 5:00 PM	0.00	0.17	0.14
1/16/13 7:00 PM	0.00	0.17	0.13
1/16/13 9:00 PM	0.00	0.17	0.13
1/16/13 11:00 PM	0.00	0.15	0.13
1/17/13 1:00 AM	0.00	0.16	0.12
1/17/13 3:00 AM	0.00	0.15	0.11
1/17/13 5:00 AM	0.00	0.16	0.13
1/17/13 7:00 AM	0.00	0.19	0.15
1/17/13 9:00 AM	0.00	0.18	0.15
1/17/13 11:00 AM	0.00	0.18	0.14
1/17/13 1:00 PM	0.00	0.19	0.14
1/17/13 3:00 PM	0.00	0.19	0.15
1/17/13 5:00 PM	0.00	0.18	0.14
1/17/13 7:00 PM	0.00	0.17	0.13
1/17/13 9:00 PM	0.00	0.18	0.13
1/17/13 11:00 PM	0.00	0.17	0.14
1/18/13 1:00 AM	0.00	0.18	0.13
1/18/13 3:00 AM	0.00	0.18	0.13
1/18/13 5:00 AM	0.00	0.19	0.12
1/18/13 7:00 AM	0.00	0.18	0.12
1/18/13 9:00 AM	0.00	0.16	0.15
1/18/13 11:00 AM	0.00	0.15	0.18
1/18/13 1:00 PM	0.00	0.15	0.20
1/18/13 3:00 PM	0.00	0.15	0.22
1/18/13 5:00 PM	0.00	0.16	0.24
1/18/13 7:00 PM	0.00	0.16	0.24
1/18/13 9:00 PM	0.00	0.15	0.25
1/18/13 11:00 PM	0.00	0.13	0.25
1/19/13 1:00 AM	0.00	0.11	0.22
1/19/13 3:00 AM	0.00	0.11	0.23
1/19/13 5:00 AM	0.00	0.14	0.24
1/19/13 7:00 AM	0.00	0.14	0.25
1/19/13 9:00 AM	0.00	0.15	0.25
1/19/13 11:00 AM	0.00	0.16	0.25
1/19/13 1:00 PM	0.00	0.17	0.23

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
1/19/13 3:00 PM	0.00	0.17	0.24
1/19/13 5:00 PM	0.00	0.17	0.21
1/19/13 7:00 PM	0.00	0.17	0.23
1/19/13 9:00 PM	0.00	0.17	0.24
1/19/13 11:00 PM	0.00	0.17	0.24
1/20/13 1:00 AM	0.00	0.17	0.24
1/20/13 3:00 AM	0.00	0.18	0.22
1/20/13 5:00 AM	0.00	0.18	0.21
1/20/13 7:00 AM	0.00	0.19	0.24
1/20/13 9:00 AM	0.00	0.20	0.25
1/20/13 11:00 AM	0.00	0.19	0.26
1/20/13 1:00 PM	0.00	0.18	0.25
1/20/13 3:00 PM	0.00	0.18	0.25
1/20/13 5:00 PM	0.00	0.20	0.23
1/20/13 7:00 PM	0.00	0.17	0.22
1/20/13 9:00 PM	0.00	0.17	0.22
1/20/13 11:00 PM	0.00	0.17	0.23
1/21/13 1:00 AM	0.00	0.16	0.22
1/21/13 3:00 AM	0.00	0.17	0.24
1/21/13 5:00 AM	0.00	0.19	0.24
1/21/13 7:00 AM	0.00	0.20	0.25
1/21/13 9:00 AM	0.00	0.17	0.22
1/21/13 11:00 AM	0.00	0.20	0.25
1/21/13 1:00 PM	0.00	0.19	0.26
1/21/13 3:00 PM	0.00	0.19	0.28
1/21/13 5:00 PM	0.00	0.20	0.24
1/21/13 7:00 PM	0.00	0.19	0.22
1/21/13 9:00 PM	0.00	0.20	0.22
1/21/13 11:00 PM	0.00	0.20	0.23
1/22/13 1:00 AM	0.00	0.21	0.24
1/22/13 3:00 AM	0.00	0.20	0.23
1/22/13 5:00 AM	0.00	0.20	0.23
1/22/13 7:00 AM	0.00	0.18	0.27
1/22/13 9:00 AM	0.00	0.17	0.27
1/22/13 11:00 AM	0.00	0.17	0.26
1/22/13 1:00 PM	0.00	0.19	0.24
1/22/13 3:00 PM	0.00	0.20	0.23
1/22/13 5:00 PM	0.00	0.22	0.25
1/22/13 7:00 PM	0.00	0.22	0.26
1/22/13 9:00 PM	0.00	0.15	0.26
1/22/13 11:00 PM	0.00	0.02	0.24
1/23/13 1:00 AM	0.00	0.00	0.25
1/23/13 3:00 AM	0.00	0.00	0.27
1/23/13 5:00 AM	0.00	0.00	0.28
1/23/13 7:00 AM	0.00	0.00	0.29
1/23/13 9:00 AM	0.00	0.00	0.21
1/23/13 11:00 AM	0.00	0.00	0.15
1/23/13 1:00 PM	0.00	0.00	0.17
1/23/13 3:00 PM	0.00	0.00	0.19
1/23/13 5:00 PM	0.00	0.00	0.21
1/23/13 7:00 PM	0.00	0.00	0.22
1/23/13 9:00 PM	0.00	0.00	0.21
1/23/13 11:00 PM	0.00	0.00	0.24

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
1/24/13 1:00 AM	0.00	0.00	0.27
1/24/13 3:00 AM	0.00	0.00	0.27
1/24/13 5:00 AM	0.00	0.00	0.21
1/24/13 7:00 AM	0.00	0.00	0.12
1/24/13 9:00 AM	0.00	0.00	0.15
1/24/13 11:00 AM	0.00	0.00	0.17
1/24/13 1:00 PM	0.00	0.00	0.18
1/24/13 3:00 PM	0.00	0.00	0.19
1/24/13 5:00 PM	0.00	0.00	0.18
1/24/13 7:00 PM	0.00	0.00	0.18
1/24/13 9:00 PM	0.00	0.00	0.20
1/24/13 11:00 PM	0.00	0.00	0.18
1/25/13 1:00 AM	0.00	0.00	0.16
1/25/13 3:00 AM	0.00	0.00	0.21
1/25/13 5:00 AM	0.00	0.00	0.21
1/25/13 7:00 AM	0.00	0.00	0.17
1/25/13 9:00 AM	0.00	0.00	0.17
1/25/13 11:00 AM	0.00	0.00	0.17
1/25/13 1:00 PM	0.00	0.00	0.18
1/25/13 3:00 PM	0.00	0.00	0.19
1/25/13 5:00 PM	0.00	0.00	0.15
1/25/13 7:00 PM	0.00	0.00	0.15
1/25/13 9:00 PM	0.00	0.00	0.14
1/25/13 11:00 PM	0.00	0.00	0.12
1/26/13 1:00 AM	0.00	0.00	0.12
1/26/13 3:00 AM	0.00	0.00	0.11
1/26/13 5:00 AM	0.00	0.00	0.11
1/26/13 7:00 AM	0.00	0.00	0.11
1/26/13 9:00 AM	0.00	0.00	0.10
1/26/13 11:00 AM	0.00	0.00	0.10
1/26/13 1:00 PM	0.00	0.00	0.10
1/26/13 3:00 PM	0.00	0.00	0.11
1/26/13 5:00 PM	0.00	0.00	0.12
1/26/13 7:00 PM	0.00	0.00	0.11
1/26/13 9:00 PM	0.00	0.00	0.12
1/26/13 11:00 PM	0.00	0.00	0.12
1/27/13 1:00 AM	0.00	0.00	0.14
1/27/13 3:00 AM	0.00	0.00	0.15
1/27/13 5:00 AM	0.00	0.00	0.16
1/27/13 7:00 AM	0.00	0.00	0.17
1/27/13 9:00 AM	0.00	0.00	0.20
1/27/13 11:00 AM	0.00	0.00	0.20
1/27/13 1:00 PM	0.00	0.00	0.18
1/27/13 3:00 PM	0.00	0.00	0.18
1/27/13 5:00 PM	0.00	0.00	0.18
1/27/13 7:00 PM	0.00	0.00	0.19
1/27/13 9:00 PM	0.00	0.00	0.19
1/27/13 11:00 PM	0.00	0.00	0.19
1/28/13 1:00 AM	0.00	0.00	0.19
1/28/13 3:00 AM	0.00	0.00	0.19
1/28/13 5:00 AM	0.00	0.00	0.18
1/28/13 7:00 AM	0.00	0.00	0.20
1/28/13 9:00 AM	0.00	0.00	0.22

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
1/28/13 11:00 AM	0.00	0.00	0.22
1/28/13 1:00 PM	0.00	0.00	0.23
1/28/13 3:00 PM	0.00	0.00	0.21
1/28/13 5:00 PM	0.00	0.00	0.21
1/28/13 7:00 PM	0.00	0.00	0.22
1/28/13 9:00 PM	0.00	0.00	0.23
1/28/13 11:00 PM	0.00	0.00	0.24
1/29/13 1:00 AM	0.00	0.00	0.21
1/29/13 3:00 AM	0.00	0.00	0.20
1/29/13 5:00 AM	0.00	0.00	0.21
1/29/13 7:00 AM	0.00	0.00	0.22
1/29/13 9:00 AM	0.00	0.00	0.24
1/29/13 11:00 AM	0.00	0.00	0.24
1/29/13 1:00 PM	0.00	0.00	0.19
1/29/13 3:00 PM	0.00	0.00	0.18
1/29/13 5:00 PM	0.00	0.00	0.20
1/29/13 7:00 PM	0.00	0.00	0.22
1/29/13 9:00 PM	0.00	0.00	0.23
1/29/13 11:00 PM	0.00	0.00	0.23
1/30/13 1:00 AM	0.00	0.00	0.22
1/30/13 3:00 AM	0.00	0.00	0.23
1/30/13 5:00 AM	0.00	0.00	0.23
1/30/13 7:00 AM	0.00	0.00	0.24
1/30/13 9:00 AM	0.00	0.00	0.23
1/30/13 11:00 AM	0.00	0.00	0.24
1/30/13 1:00 PM	0.00	0.00	0.22
1/30/13 3:00 PM	0.00	0.00	0.24
1/30/13 5:00 PM	0.00	0.00	0.25
1/30/13 7:00 PM	0.00	0.00	0.23
1/30/13 9:00 PM	0.00	0.00	0.18
1/30/13 11:00 PM	0.00	0.00	0.23
1/31/13 1:00 AM	0.00	0.00	0.30
1/31/13 3:00 AM	0.00	0.00	0.30
1/31/13 5:00 AM	0.00	0.00	0.30
1/31/13 7:00 AM	0.00	0.00	0.31
1/31/13 9:00 AM	0.00	0.00	0.32
1/31/13 11:00 AM	0.00	0.00	0.36
1/31/13 1:00 PM	0.00	0.00	0.33
1/31/13 3:00 PM	0.00	0.00	0.24
1/31/13 5:00 PM	0.00	0.00	0.22
1/31/13 7:00 PM	0.00	0.00	0.22
1/31/13 9:00 PM	0.00	0.00	0.22
1/31/13 11:00 PM	0.00	0.00	0.22
2/1/13 1:00 AM	0.00	0.00	0.22
2/1/13 3:00 AM	0.00	0.00	0.22
2/1/13 5:00 AM	0.00	0.00	0.19
2/1/13 7:00 AM	0.00	0.00	0.17
2/1/13 9:00 AM	0.00	0.00	0.07
2/1/13 11:00 AM	0.00	0.00	0.09
2/1/13 1:00 PM	0.00	0.00	0.12
2/1/13 3:00 PM	0.00	0.00	0.15
2/1/13 5:00 PM	0.00	0.00	0.16
2/1/13 7:00 PM	0.00	0.00	0.16

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
2/1/13 9:00 PM	0.00	0.00	0.17
2/1/13 11:00 PM	0.00	0.00	0.17
2/2/13 1:00 AM	0.00	0.00	0.17
2/2/13 3:00 AM	0.00	0.00	0.17
2/2/13 5:00 AM	0.00	0.00	0.17
2/2/13 7:00 AM	0.00	0.00	0.16
2/2/13 9:00 AM	0.00	0.00	0.16
2/2/13 11:00 AM	0.00	0.00	0.16
2/2/13 1:00 PM	0.00	0.00	0.15
2/2/13 3:00 PM	0.00	0.00	0.15
2/2/13 5:00 PM	0.00	0.00	0.15
2/2/13 7:00 PM	0.00	0.00	0.16
2/2/13 9:00 PM	0.00	0.00	0.16
2/2/13 11:00 PM	0.00	0.00	0.16
2/3/13 1:00 AM	0.00	0.00	0.17
2/3/13 3:00 AM	0.00	0.00	0.17
2/3/13 5:00 AM	0.00	0.00	0.17
2/3/13 7:00 AM	0.00	0.00	0.17
2/3/13 9:00 AM	0.00	0.00	0.17
2/3/13 11:00 AM	0.00	0.00	0.16
2/3/13 1:00 PM	0.00	0.00	0.16
2/3/13 3:00 PM	0.00	0.00	0.16
2/3/13 5:00 PM	0.00	0.00	0.16
2/3/13 7:00 PM	0.00	0.00	0.15
2/3/13 9:00 PM	0.00	0.00	0.16
2/3/13 11:00 PM	0.00	0.00	0.16
2/4/13 1:00 AM	0.00	0.00	0.16
2/4/13 3:00 AM	0.00	0.00	0.16
2/4/13 5:00 AM	0.00	0.00	0.17
2/4/13 7:00 AM	0.00	0.00	0.15
2/4/13 9:00 AM	0.00	0.00	0.07
2/4/13 11:00 AM	0.00	0.00	0.07
2/4/13 1:00 PM	0.00	0.00	0.08
2/4/13 3:00 PM	0.00	0.00	0.07
2/4/13 5:00 PM	0.00	0.00	0.07
2/4/13 7:00 PM	0.00	0.00	0.08
2/4/13 9:00 PM	0.00	0.00	0.08
2/4/13 11:00 PM	0.00	0.00	0.08
2/5/13 1:00 AM	0.00	0.00	0.09
2/5/13 3:00 AM	0.00	0.00	0.09
2/5/13 5:00 AM	0.00	0.00	0.11
2/5/13 7:00 AM	0.00	0.00	0.13
2/5/13 9:00 AM	0.00	0.00	0.26
2/5/13 11:00 AM	0.00	0.00	0.21
2/5/13 1:00 PM	0.00	0.00	0.14
2/5/13 3:00 PM	0.00	0.00	0.09
2/5/13 5:00 PM	0.00	0.00	0.10
2/5/13 7:00 PM	0.00	0.00	0.12
2/5/13 9:00 PM	0.00	0.00	0.12
2/5/13 11:00 PM	0.00	0.00	0.12
2/6/13 1:00 AM	0.00	0.00	0.14
2/6/13 3:00 AM	0.00	0.00	0.14
2/6/13 5:00 AM	0.00	0.00	0.14

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
2/6/13 7:00 AM	0.00	0.00	0.12
2/6/13 9:00 AM	0.00	0.00	0.11
2/6/13 11:00 AM	0.00	0.00	0.11
2/6/13 1:00 PM	0.00	0.00	0.10
2/6/13 3:00 PM	0.00	0.00	0.11
2/6/13 5:00 PM	0.00	0.00	0.11
2/6/13 7:00 PM	0.00	0.00	0.12
2/6/13 9:00 PM	0.00	0.00	0.11
2/6/13 11:00 PM	0.00	0.00	0.12
2/7/13 1:00 AM	0.00	0.00	0.12
2/7/13 3:00 AM	0.00	0.00	0.11
2/7/13 5:00 AM	0.00	0.00	0.26
2/7/13 7:00 AM	0.00	0.00	0.21
2/7/13 9:00 AM	0.00	0.00	0.20
2/7/13 11:00 AM	0.00	0.00	0.21
2/7/13 1:00 PM	0.00	0.00	0.19
2/7/13 3:00 PM	0.00	0.00	0.10
2/7/13 5:00 PM	0.00	0.00	0.09
2/7/13 7:00 PM	0.00	0.00	0.10
2/7/13 9:00 PM	0.00	0.00	0.11
2/7/13 11:00 PM	0.00	0.00	0.12
2/8/13 1:00 AM	0.00	0.00	0.13
2/8/13 3:00 AM	0.00	0.00	0.13
2/8/13 5:00 AM	0.00	0.00	0.13
2/8/13 7:00 AM	0.00	0.00	0.13
2/8/13 9:00 AM	0.00	0.00	0.13
2/8/13 11:00 AM	0.00	0.00	0.13
2/8/13 1:00 PM	0.00	0.00	0.13
2/8/13 3:00 PM	0.00	0.00	0.14
2/8/13 5:00 PM	0.00	0.00	0.13
2/8/13 7:00 PM	0.00	0.00	0.13
2/8/13 9:00 PM	0.00	0.00	0.14
2/8/13 11:00 PM	0.00	0.00	0.14
2/9/13 1:00 AM	0.00	0.00	0.14
2/9/13 3:00 AM	0.00	0.00	0.14
2/9/13 5:00 AM	0.00	0.02	0.15
2/9/13 7:00 AM	0.00	0.02	0.14
2/9/13 9:00 AM	0.00	0.00	0.13
2/9/13 11:00 AM	0.00	0.00	0.12
2/9/13 1:00 PM	0.00	0.00	0.12
2/9/13 3:00 PM	0.00	0.00	0.12
2/9/13 5:00 PM	0.00	0.00	0.12
2/9/13 7:00 PM	0.00	0.00	0.12
2/9/13 9:00 PM	0.00	0.00	0.11
2/9/13 11:00 PM	0.00	0.25	0.11
2/10/13 1:00 AM	0.00	0.42	0.12
2/10/13 3:00 AM	0.00	0.21	0.12
2/10/13 5:00 AM	0.00	0.19	0.13
2/10/13 7:00 AM	0.00	0.25	0.13
2/10/13 9:00 AM	0.00	0.21	0.13
2/10/13 11:00 AM	0.00	0.05	0.12
2/10/13 1:00 PM	0.00	0.04	0.11
2/10/13 3:00 PM	0.00	0.14	0.11

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
2/10/13 5:00 PM	0.00	0.21	0.11
2/10/13 7:00 PM	0.00	0.21	0.11
2/10/13 9:00 PM	0.00	0.10	0.12
2/10/13 11:00 PM	0.00	0.00	0.12
2/11/13 1:00 AM	0.00	0.00	0.12
2/11/13 3:00 AM	0.00	0.00	0.12
2/11/13 5:00 AM	0.00	0.00	0.12
2/11/13 7:00 AM	0.00	0.00	0.13
2/11/13 9:00 AM	0.00	0.01	0.13
2/11/13 11:00 AM	0.00	0.01	0.13
2/11/13 1:00 PM	0.00	0.09	0.13
2/11/13 3:00 PM	0.00	0.24	0.12
2/11/13 5:00 PM	0.00	0.20	0.11
2/11/13 7:00 PM	0.00	0.19	0.12
2/11/13 9:00 PM	0.00	0.19	0.12
2/11/13 11:00 PM	0.00	0.18	0.12
2/12/13 1:00 AM	0.00	0.19	0.11
2/12/13 3:00 AM	0.00	0.20	0.11
2/12/13 5:00 AM	0.00	0.19	0.11
2/12/13 7:00 AM	0.00	0.20	0.09
2/12/13 9:00 AM	0.00	0.20	0.09
2/12/13 11:00 AM	0.00	0.20	0.09
2/12/13 1:00 PM	0.00	0.23	0.09
2/12/13 3:00 PM	0.00	0.22	0.10
2/12/13 5:00 PM	0.00	0.22	0.11
2/12/13 7:00 PM	0.00	0.25	0.12
2/12/13 9:00 PM	0.00	0.25	0.13
2/12/13 11:00 PM	0.00	0.26	0.14
2/13/13 1:00 AM	0.00	0.26	0.25
2/13/13 3:00 AM	0.00	0.29	0.26
2/13/13 5:00 AM	0.00	0.31	0.26
2/13/13 7:00 AM	0.00	0.33	0.28
2/13/13 9:00 AM	0.00	0.35	0.29
2/13/13 11:00 AM	0.00	0.43	0.34
2/13/13 1:00 PM	0.00	0.46	0.35
2/13/13 3:00 PM	0.00	0.52	0.36
2/13/13 5:00 PM	0.00	0.50	0.35
2/13/13 7:00 PM	0.00	0.60	0.36
2/13/13 9:00 PM	0.00	0.56	0.18
2/13/13 11:00 PM	0.00	0.51	0.07
2/14/13 1:00 AM	0.00	0.57	0.07
2/14/13 3:00 AM	0.00	0.63	0.07
2/14/13 5:00 AM	0.00	0.66	0.08
2/14/13 7:00 AM	0.00	0.66	0.09
2/14/13 9:00 AM	0.00	0.58	0.09
2/14/13 11:00 AM	0.00	0.41	0.11
2/14/13 1:00 PM	0.00	0.41	0.15
2/14/13 3:00 PM	0.00	0.38	0.21
2/14/13 5:00 PM	0.00	0.44	0.25
2/14/13 7:00 PM	0.00	0.50	0.20
2/14/13 9:00 PM	0.00	0.54	0.15
2/14/13 11:00 PM	0.00	0.54	0.19
2/15/13 1:00 AM	0.00	0.54	0.20

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
2/15/13 3:00 AM	0.00	0.54	0.19
2/15/13 5:00 AM	0.00	0.50	0.22
2/15/13 7:00 AM	0.00	0.50	0.29
2/15/13 9:00 AM	0.00	0.46	0.32
2/15/13 11:00 AM	0.00	0.44	0.18
2/15/13 1:00 PM	0.00	0.45	0.13
2/15/13 3:00 PM	0.00	0.29	0.11
2/15/13 5:00 PM	0.00	0.30	0.09
2/15/13 7:00 PM	0.00	0.25	0.10
2/15/13 9:00 PM	0.00	0.25	0.14
2/15/13 11:00 PM	0.00	0.23	0.14
2/16/13 1:00 AM	0.00	0.23	0.14
2/16/13 3:00 AM	0.00	0.23	0.13
2/16/13 5:00 AM	0.00	0.24	0.10
2/16/13 7:00 AM	0.00	0.28	0.09
2/16/13 9:00 AM	0.00	0.30	0.09
2/16/13 11:00 AM	0.00	0.27	0.10
2/16/13 1:00 PM	0.00	0.27	0.11
2/16/13 3:00 PM	0.00	0.28	0.12
2/16/13 5:00 PM	0.00	0.26	0.10
2/16/13 7:00 PM	0.00	0.23	0.09
2/16/13 9:00 PM	0.00	0.23	0.08
2/16/13 11:00 PM	0.00	0.25	0.08
2/17/13 1:00 AM	0.00	0.25	0.08
2/17/13 3:00 AM	0.00	0.26	0.08
2/17/13 5:00 AM	0.00	0.26	0.08
2/17/13 7:00 AM	0.00	0.16	0.09
2/17/13 9:00 AM	0.00	0.21	0.10
2/17/13 11:00 AM	0.00	0.18	0.11
2/17/13 1:00 PM	0.00	0.17	0.12
2/17/13 3:00 PM	0.00	0.16	0.14
2/17/13 5:00 PM	0.00	0.16	0.14
2/17/13 7:00 PM	0.00	0.14	0.15
2/17/13 9:00 PM	0.00	0.13	0.15
2/17/13 11:00 PM	0.00	0.20	0.15
2/18/13 1:00 AM	0.00	0.20	0.15
2/18/13 3:00 AM	0.00	0.19	0.14
2/18/13 5:00 AM	0.00	0.21	0.15
2/18/13 7:00 AM	0.00	0.22	0.15
2/18/13 9:00 AM	0.00	0.21	0.15
2/18/13 11:00 AM	0.00	0.21	0.15
2/18/13 1:00 PM	0.00	0.23	0.15
2/18/13 3:00 PM	0.00	0.19	0.14
2/18/13 5:00 PM	0.00	0.22	0.14
2/18/13 7:00 PM	0.00	0.23	0.15
2/18/13 9:00 PM	0.00	0.23	0.13
2/18/13 11:00 PM	0.00	0.24	0.13
2/19/13 1:00 AM	0.00	0.24	0.12
2/19/13 3:00 AM	0.00	0.22	0.12
2/19/13 5:00 AM	0.00	0.23	0.12
2/19/13 7:00 AM	0.00	0.23	0.12
2/19/13 9:00 AM	0.00	0.23	0.11
2/19/13 11:00 AM	0.00	0.13	0.12

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
2/19/13 1:00 PM	0.00	0.00	0.12
2/19/13 3:00 PM	0.00	0.00	0.14
2/19/13 5:00 PM	0.00	0.00	0.15
2/19/13 7:00 PM	0.00	0.00	0.16
2/19/13 9:00 PM	0.00	0.00	0.18
2/19/13 11:00 PM	0.00	0.00	0.20
2/20/13 1:00 AM	0.00	0.07	0.21
2/20/13 3:00 AM	0.00	0.09	0.22
2/20/13 5:00 AM	0.00	0.10	0.24
2/20/13 7:00 AM	0.00	0.11	0.24
2/20/13 9:00 AM	0.00	0.11	0.20
2/20/13 11:00 AM	0.00	0.13	0.17
2/20/13 1:00 PM	0.00	0.12	0.17
2/20/13 3:00 PM	0.00	0.13	0.17
2/20/13 5:00 PM	0.00	0.15	0.20
2/20/13 7:00 PM	0.00	0.17	0.22
2/20/13 9:00 PM	0.00	0.21	0.24
2/20/13 11:00 PM	0.00	0.25	0.25
2/21/13 1:00 AM	0.00	0.27	0.27
2/21/13 3:00 AM	0.00	0.30	0.27
2/21/13 5:00 AM	0.00	0.28	0.22
2/21/13 7:00 AM	0.00	0.27	0.18
2/21/13 9:00 AM	0.00	0.21	0.15
2/21/13 11:00 AM	0.00	0.21	0.13
2/21/13 1:00 PM	0.00	0.17	0.13
2/21/13 3:00 PM	0.00	0.17	0.12
2/21/13 5:00 PM	0.00	0.19	0.11
2/21/13 7:00 PM	0.18	0.18	0.09
2/21/13 9:00 PM	0.18	0.18	0.09
2/21/13 11:00 PM	0.17	0.17	0.06
2/22/13 1:00 AM	0.18	0.00	0.06
2/22/13 3:00 AM	0.19	0.00	0.06
2/22/13 5:00 AM	0.20	0.00	0.06
2/22/13 7:00 AM	0.19	0.00	0.08
2/22/13 9:00 AM	0.20	0.00	0.08
2/22/13 11:00 AM	0.14	0.00	0.09
2/22/13 1:00 PM	0.18	0.00	0.08
2/22/13 3:00 PM	0.22	0.00	0.09
2/22/13 5:00 PM	0.17	0.00	0.10
2/22/13 7:00 PM	0.22	0.00	0.11
2/22/13 9:00 PM	0.22	0.00	0.12
2/22/13 11:00 PM	0.23	0.00	0.13
2/23/13 1:00 AM	0.24	0.00	0.13
2/23/13 3:00 AM	0.22	0.00	0.13
2/23/13 5:00 AM	0.22	0.00	0.13
2/23/13 7:00 AM	0.22	0.00	0.14
2/23/13 9:00 AM	0.19	0.00	0.15
2/23/13 11:00 AM	0.15	0.00	0.16
2/23/13 1:00 PM	0.21	0.00	0.17
2/23/13 3:00 PM	0.22	0.00	0.16
2/23/13 5:00 PM	0.24	0.00	0.17
2/23/13 7:00 PM	0.26	0.00	0.17
2/23/13 9:00 PM	0.27	0.00	0.18

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
2/23/13 11:00 PM	0.27	0.00	0.19
2/24/13 1:00 AM	0.24	0.00	0.19
2/24/13 3:00 AM	0.22	0.00	0.19
2/24/13 5:00 AM	0.23	0.00	0.17
2/24/13 7:00 AM	0.23	0.00	0.18
2/24/13 9:00 AM	0.23	0.00	0.17
2/24/13 11:00 AM	0.24	0.00	0.18
2/24/13 1:00 PM	0.26	0.00	0.18
2/24/13 3:00 PM	0.27	0.00	0.19
2/24/13 5:00 PM	0.27	0.00	0.19
2/24/13 7:00 PM	0.26	0.00	0.20
2/24/13 9:00 PM	0.26	0.00	0.21
2/24/13 11:00 PM	0.26	0.00	0.21
2/25/13 1:00 AM	0.25	0.00	0.21
2/25/13 3:00 AM	0.25	0.00	0.22
2/25/13 5:00 AM	0.23	0.00	0.21
2/25/13 7:00 AM	0.24	0.00	0.21
2/25/13 9:00 AM	0.26	0.00	0.21
2/25/13 11:00 AM	0.26	0.00	0.21
2/25/13 1:00 PM	0.26	0.00	0.19
2/25/13 3:00 PM	0.27	0.00	0.18
2/25/13 5:00 PM	0.25	0.00	0.18
2/25/13 7:00 PM	0.24	0.00	0.17
2/25/13 9:00 PM	0.23	0.00	0.17
2/25/13 11:00 PM	0.23	0.00	0.17
2/26/13 1:00 AM	0.23	0.00	0.18
2/26/13 3:00 AM	0.22	0.00	0.18
2/26/13 5:00 AM	0.23	0.00	0.18
2/26/13 7:00 AM	0.24	0.00	0.19
2/26/13 9:00 AM	0.23	0.00	0.19
2/26/13 11:00 AM	0.24	0.00	0.19
2/26/13 1:00 PM	0.24	0.00	0.19
2/26/13 3:00 PM	0.24	0.00	0.19
2/26/13 5:00 PM	0.25	0.00	0.20
2/26/13 7:00 PM	0.23	0.00	0.17
2/26/13 9:00 PM	0.25	0.00	0.17
2/26/13 11:00 PM	0.27	0.00	0.18
2/27/13 1:00 AM	0.23	0.00	0.17
2/27/13 3:00 AM	0.23	0.00	0.15
2/27/13 5:00 AM	0.21	0.00	0.13
2/27/13 7:00 AM	0.22	0.00	0.13
2/27/13 9:00 AM	0.20	0.00	0.14
2/27/13 11:00 AM	0.19	0.00	0.13
2/27/13 1:00 PM	0.19	0.00	0.11
2/27/13 3:00 PM	0.19	0.00	0.09
2/27/13 5:00 PM	0.20	0.00	0.08
2/27/13 7:00 PM	0.20	0.00	0.08
2/27/13 9:00 PM	0.21	0.00	0.08
2/27/13 11:00 PM	0.21	0.00	0.08
2/28/13 1:00 AM	0.20	0.00	0.09
2/28/13 3:00 AM	0.18	0.00	0.09
2/28/13 5:00 AM	0.19	0.00	0.09
2/28/13 7:00 AM	0.19	0.00	0.11

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
2/28/13 9:00 AM	0.19	0.00	0.10
2/28/13 11:00 AM	0.22	0.00	0.10
2/28/13 1:00 PM	0.22	0.00	0.10
2/28/13 3:00 PM	0.32	0.00	0.09
2/28/13 5:00 PM	0.28	0.00	0.09
2/28/13 7:00 PM	0.29	0.00	0.09
2/28/13 9:00 PM	0.23	0.00	0.08
2/28/13 11:00 PM	0.23	0.00	0.08
3/1/13 1:00 AM	0.24	0.00	0.08
3/1/13 3:00 AM	0.22	0.00	0.08
3/1/13 5:00 AM	0.23	0.00	0.09
3/1/13 7:00 AM	0.23	0.00	0.17
3/1/13 9:00 AM	0.24	0.00	0.27
3/1/13 11:00 AM	0.22	0.00	0.24
3/1/13 1:00 PM	0.23	0.00	0.08
3/1/13 3:00 PM	0.25	0.00	0.08
3/1/13 5:00 PM	0.24	0.00	0.04
3/1/13 7:00 PM	0.21	0.00	0.00
3/1/13 9:00 PM	0.20	0.00	0.00
3/1/13 11:00 PM	0.22	0.00	0.00
3/2/13 1:00 AM	0.22	0.00	0.00
3/2/13 3:00 AM	0.22	0.00	0.00
3/2/13 5:00 AM	0.22	0.00	0.00
3/2/13 7:00 AM	0.24	0.00	0.00
3/2/13 9:00 AM	0.22	0.00	0.00
3/2/13 11:00 AM	0.24	0.00	0.00
3/2/13 1:00 PM	0.22	0.00	0.00
3/2/13 3:00 PM	0.25	0.00	0.00
3/2/13 5:00 PM	0.25	0.00	0.00
3/2/13 7:00 PM	0.23	0.00	0.00
3/2/13 9:00 PM	0.21	0.00	0.00
3/2/13 11:00 PM	0.23	0.00	0.00
3/3/13 1:00 AM	0.21	0.00	0.00
3/3/13 3:00 AM	0.21	0.00	0.00
3/3/13 5:00 AM	0.21	0.00	0.00
3/3/13 7:00 AM	0.18	0.00	0.00
3/3/13 9:00 AM	0.16	0.00	0.00
3/3/13 11:00 AM	0.19	0.00	0.00
3/3/13 1:00 PM	0.18	0.00	0.00
3/3/13 3:00 PM	0.18	0.00	0.00
3/3/13 5:00 PM	0.19	0.00	0.00
3/3/13 7:00 PM	0.19	0.00	0.00
3/3/13 9:00 PM	0.20	0.00	0.00
3/3/13 11:00 PM	0.20	0.00	0.00
3/4/13 1:00 AM	0.20	0.20	0.00
3/4/13 3:00 AM	0.20	0.20	0.00
3/4/13 5:00 AM	0.20	0.20	0.00
3/4/13 7:00 AM	0.19	0.19	0.00
3/4/13 9:00 AM	0.18	0.18	0.00
3/4/13 11:00 AM	0.19	0.00	0.00
3/4/13 1:00 PM	0.20	0.00	0.00
3/4/13 3:00 PM	0.19	0.00	0.00
3/4/13 5:00 PM	0.19	0.00	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
3/4/13 7:00 PM	0.21	0.00	0.00
3/4/13 9:00 PM	0.20	0.00	0.00
3/4/13 11:00 PM	0.21	0.00	0.00
3/5/13 1:00 AM	0.26	0.00	0.00
3/5/13 3:00 AM	0.24	0.00	0.00
3/5/13 5:00 AM	0.22	0.00	0.00
3/5/13 7:00 AM	0.20	0.00	0.00
3/5/13 9:00 AM	0.20	0.00	0.00
3/5/13 11:00 AM	0.21	0.00	0.00
3/5/13 1:00 PM	0.23	0.00	0.00
3/5/13 3:00 PM	0.23	0.00	0.00
3/5/13 5:00 PM	0.25	0.25	0.00
3/5/13 7:00 PM	0.24	0.24	0.00
3/5/13 9:00 PM	0.26	0.26	0.00
3/5/13 11:00 PM	0.21	0.21	0.00
3/6/13 1:00 AM	0.14	0.14	0.00
3/6/13 3:00 AM	0.14	0.14	0.00
3/6/13 5:00 AM	0.17	0.17	0.00
3/6/13 7:00 AM	0.23	0.23	0.00
3/6/13 9:00 AM	0.24	0.24	0.00
3/6/13 11:00 AM	0.23	0.23	0.00
3/6/13 1:00 PM	0.22	0.22	0.00
3/6/13 3:00 PM	0.23	0.23	0.00
3/6/13 5:00 PM	0.24	0.24	0.00
3/6/13 7:00 PM	0.24	0.24	0.00
3/6/13 9:00 PM	0.23	0.23	0.00
3/6/13 11:00 PM	0.23	0.23	0.00
3/7/13 1:00 AM	0.23	0.23	0.00
3/7/13 3:00 AM	0.23	0.23	0.00
3/7/13 5:00 AM	0.23	0.23	0.00
3/7/13 7:00 AM	0.23	0.23	0.00
3/7/13 9:00 AM	0.22	0.22	0.00
3/7/13 11:00 AM	0.22	0.22	0.00
3/7/13 1:00 PM	0.22	0.22	0.00
3/7/13 3:00 PM	0.21	0.21	0.00
3/7/13 5:00 PM	0.24	0.24	0.00
3/7/13 7:00 PM	0.26	0.26	0.00
3/7/13 9:00 PM	0.24	0.24	0.00
3/7/13 11:00 PM	0.24	0.24	0.00
3/8/13 1:00 AM	0.23	0.23	0.00
3/8/13 3:00 AM	0.24	0.24	0.00
3/8/13 5:00 AM	0.24	0.24	0.00
3/8/13 7:00 AM	0.24	0.24	0.00
3/8/13 9:00 AM	0.22	0.22	0.00
3/8/13 11:00 AM	0.22	0.22	0.00
3/8/13 1:00 PM	0.21	0.21	0.00
3/8/13 3:00 PM	0.24	0.24	0.00
3/8/13 5:00 PM	0.22	0.22	0.00
3/8/13 7:00 PM	0.21	0.21	0.00
3/8/13 9:00 PM	0.21	0.21	0.00
3/8/13 11:00 PM	0.19	0.19	0.00
3/9/13 1:00 AM	0.16	0.16	0.00
3/9/13 3:00 AM	0.16	0.16	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
3/9/13 5:00 AM	0.15	0.15	0.00
3/9/13 7:00 AM	0.17	0.17	0.00
3/9/13 9:00 AM	0.20	0.20	0.00
3/9/13 11:00 AM	0.21	0.21	0.00
3/9/13 1:00 PM	0.21	0.21	0.00
3/9/13 3:00 PM	0.21	0.21	0.00
3/9/13 5:00 PM	0.22	0.22	0.00
3/9/13 7:00 PM	0.22	0.22	0.00
3/9/13 9:00 PM	0.21	0.21	0.00
3/9/13 11:00 PM	0.18	0.18	0.00
3/10/13 1:00 AM	0.16	0.16	0.00
3/10/13 3:00 AM	0.15	0.15	0.00
3/10/13 5:00 AM	0.15	0.15	0.00
3/10/13 7:00 AM	0.15	0.15	0.00
3/10/13 9:00 AM	0.16	0.16	0.00
3/10/13 11:00 AM	0.18	0.18	0.00
3/10/13 1:00 PM	0.18	0.18	0.00
3/10/13 3:00 PM	0.18	0.18	0.00
3/10/13 5:00 PM	0.22	0.22	0.00
3/10/13 7:00 PM	0.22	0.22	0.00
3/10/13 9:00 PM	0.21	0.21	0.00
3/10/13 11:00 PM	0.23	0.23	0.00
3/11/13 1:00 AM	0.19	0.19	0.00
3/11/13 3:00 AM	0.18	0.18	0.00
3/11/13 5:00 AM	0.23	0.23	0.00
3/11/13 7:00 AM	0.23	0.23	0.00
3/11/13 9:00 AM	0.23	0.23	0.00
3/11/13 11:00 AM	0.22	0.22	0.00
3/11/13 1:00 PM	0.24	0.24	0.00
3/11/13 3:00 PM	0.24	0.24	0.00
3/11/13 5:00 PM	0.23	0.23	0.00
3/11/13 7:00 PM	0.23	0.23	0.00
3/11/13 9:00 PM	0.22	0.22	0.00
3/11/13 11:00 PM	0.16	0.16	0.00
3/12/13 1:00 AM	0.16	0.16	0.00
3/12/13 3:00 AM	0.16	0.16	0.00
3/12/13 5:00 AM	0.17	0.17	0.00
3/12/13 7:00 AM	0.23	0.23	0.00
3/12/13 9:00 AM	0.23	0.23	0.00
3/12/13 11:00 AM	0.24	0.24	0.00
3/12/13 1:00 PM	0.24	0.24	0.00
3/12/13 3:00 PM	0.23	0.23	0.00
3/12/13 5:00 PM	0.22	0.22	0.00
3/12/13 7:00 PM	0.21	0.21	0.00
3/12/13 9:00 PM	0.20	0.20	0.00
3/12/13 11:00 PM	0.20	0.20	0.00
3/13/13 1:00 AM	0.17	0.17	0.00
3/13/13 3:00 AM	0.17	0.17	0.00
3/13/13 5:00 AM	0.19	0.19	0.00
3/13/13 7:00 AM	0.22	0.22	0.00
3/13/13 9:00 AM	0.21	0.21	0.00
3/13/13 11:00 AM	0.21	0.21	0.00
3/13/13 1:00 PM	0.22	0.22	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
3/13/13 3:00 PM	0.24	0.24	0.00
3/13/13 5:00 PM	0.21	0.21	0.00
3/13/13 7:00 PM	0.21	0.21	0.00
3/13/13 9:00 PM	0.17	0.17	0.00
3/13/13 11:00 PM	0.12	0.12	0.00
3/14/13 1:00 AM	0.09	0.09	0.00
3/14/13 3:00 AM	0.00	0.07	0.00
3/14/13 5:00 AM	0.00	0.09	0.00
3/14/13 7:00 AM	0.00	0.07	0.00
3/14/13 9:00 AM	0.00	0.08	0.00
3/14/13 11:00 AM	0.00	0.10	0.00
3/14/13 1:00 PM	0.00	0.08	0.00
3/14/13 3:00 PM	0.00	0.08	0.00
3/14/13 5:00 PM	0.00	0.08	0.00
3/14/13 7:00 PM	0.00	0.08	0.00
3/14/13 9:00 PM	0.00	0.08	0.00
3/14/13 11:00 PM	0.00	0.09	0.00
3/15/13 1:00 AM	0.00	0.09	0.00
3/15/13 3:00 AM	0.00	0.09	0.00
3/15/13 5:00 AM	0.00	0.09	0.00
3/15/13 7:00 AM	0.00	0.10	0.00
3/15/13 9:00 AM	0.00	0.09	0.00
3/15/13 11:00 AM	0.00	0.08	0.00
3/15/13 1:00 PM	0.00	0.08	0.00
3/15/13 3:00 PM	0.00	0.08	0.00
3/15/13 5:00 PM	0.00	0.08	0.00
3/15/13 7:00 PM	0.00	0.08	0.00
3/15/13 9:00 PM	0.00	0.08	0.00
3/15/13 11:00 PM	0.00	0.08	0.00
3/16/13 1:00 AM	0.00	0.08	0.00
3/16/13 3:00 AM	0.00	0.08	0.00
3/16/13 5:00 AM	0.00	0.08	0.00
3/16/13 7:00 AM	0.00	0.09	0.00
3/16/13 9:00 AM	0.00	0.09	0.00
3/16/13 11:00 AM	0.00	0.09	0.00
3/16/13 1:00 PM	0.00	0.08	0.00
3/16/13 3:00 PM	0.00	0.08	0.00
3/16/13 5:00 PM	0.00	0.08	0.00
3/16/13 7:00 PM	0.00	0.09	0.00
3/16/13 9:00 PM	0.00	0.09	0.00
3/16/13 11:00 PM	0.11	0.11	0.00
3/17/13 1:00 AM	0.11	0.11	0.00
3/17/13 3:00 AM	0.10	0.10	0.00
3/17/13 5:00 AM	0.11	0.11	0.00
3/17/13 7:00 AM	0.11	0.11	0.00
3/17/13 9:00 AM	0.14	0.14	0.00
3/17/13 11:00 AM	0.20	0.20	0.00
3/17/13 1:00 PM	0.21	0.21	0.00
3/17/13 3:00 PM	0.24	0.24	0.00
3/17/13 5:00 PM	0.23	0.23	0.00
3/17/13 7:00 PM	0.23	0.23	0.00
3/17/13 9:00 PM	0.23	0.23	0.00
3/17/13 11:00 PM	0.18	0.18	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
3/18/13 1:00 AM	0.17	0.17	0.00
3/18/13 3:00 AM	0.17	0.17	0.00
3/18/13 5:00 AM	0.24	0.24	0.00
3/18/13 7:00 AM	0.24	0.24	0.00
3/18/13 9:00 AM	0.23	0.23	0.00
3/18/13 11:00 AM	0.21	0.21	0.00
3/18/13 1:00 PM	0.23	0.23	0.00
3/18/13 3:00 PM	0.25	0.25	0.00
3/18/13 5:00 PM	0.25	0.25	0.00
3/18/13 7:00 PM	0.24	0.24	0.00
3/18/13 9:00 PM	0.23	0.23	0.00
3/18/13 11:00 PM	0.23	0.23	0.00
3/19/13 1:00 AM	0.20	0.20	0.00
3/19/13 3:00 AM	0.20	0.20	0.00
3/19/13 5:00 AM	0.24	0.24	0.00
3/19/13 7:00 AM	0.25	0.25	0.00
3/19/13 9:00 AM	0.25	0.25	0.00
3/19/13 11:00 AM	0.25	0.25	0.00
3/19/13 1:00 PM	0.28	0.28	0.00
3/19/13 3:00 PM	0.27	0.27	0.00
3/19/13 5:00 PM	0.25	0.25	0.00
3/19/13 7:00 PM	0.26	0.26	0.00
3/19/13 9:00 PM	0.23	0.23	0.00
3/19/13 11:00 PM	0.18	0.18	0.00
3/20/13 1:00 AM	0.18	0.18	0.00
3/20/13 3:00 AM	0.17	0.17	0.00
3/20/13 5:00 AM	0.20	0.20	0.00
3/20/13 7:00 AM	0.25	0.25	0.00
3/20/13 9:00 AM	0.25	0.25	0.00
3/20/13 11:00 AM	0.25	0.25	0.00
3/20/13 1:00 PM	0.24	0.24	0.00
3/20/13 3:00 PM	0.24	0.24	0.00
3/20/13 5:00 PM	0.23	0.23	0.00
3/20/13 7:00 PM	0.23	0.23	0.00
3/20/13 9:00 PM	0.24	0.24	0.00
3/20/13 11:00 PM	0.18	0.18	0.00
3/21/13 1:00 AM	0.18	0.18	0.00
3/21/13 3:00 AM	0.18	0.18	0.00
3/21/13 5:00 AM	0.21	0.21	0.00
3/21/13 7:00 AM	0.27	0.27	0.00
3/21/13 9:00 AM	0.27	0.27	0.00
3/21/13 11:00 AM	0.21	0.21	0.00
3/21/13 1:00 PM	0.20	0.20	0.00
3/21/13 3:00 PM	0.20	0.20	0.00
3/21/13 5:00 PM	0.20	0.20	0.00
3/21/13 7:00 PM	0.20	0.20	0.00
3/21/13 9:00 PM	0.20	0.20	0.00
3/21/13 11:00 PM	0.21	0.21	0.00
3/22/13 1:00 AM	0.20	0.20	0.00
3/22/13 3:00 AM	0.20	0.20	0.00
3/22/13 5:00 AM	0.21	0.21	0.00
3/22/13 7:00 AM	0.21	0.21	0.00
3/22/13 9:00 AM	0.21	0.21	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
3/22/13 11:00 AM	0.21	0.21	0.00
3/22/13 1:00 PM	0.20	0.20	0.00
3/22/13 3:00 PM	0.21	0.21	0.00
3/22/13 5:00 PM	0.21	0.21	0.00
3/22/13 7:00 PM	0.21	0.21	0.00
3/22/13 9:00 PM	0.20	0.20	0.00
3/22/13 11:00 PM	0.16	0.16	0.00
3/23/13 1:00 AM	0.17	0.17	0.00
3/23/13 3:00 AM	0.16	0.16	0.00
3/23/13 5:00 AM	0.17	0.17	0.00
3/23/13 7:00 AM	0.20	0.20	0.00
3/23/13 9:00 AM	0.22	0.22	0.00
3/23/13 11:00 AM	0.21	0.21	0.00
3/23/13 1:00 PM	0.21	0.21	0.00
3/23/13 3:00 PM	0.22	0.22	0.00
3/23/13 5:00 PM	0.22	0.22	0.00
3/23/13 7:00 PM	0.22	0.22	0.00
3/23/13 9:00 PM	0.21	0.21	0.00
3/23/13 11:00 PM	0.17	0.17	0.00
3/24/13 1:00 AM	0.16	0.16	0.00
3/24/13 3:00 AM	0.16	0.16	0.00
3/24/13 5:00 AM	0.16	0.16	0.00
3/24/13 7:00 AM	0.20	0.20	0.00
3/24/13 9:00 AM	0.23	0.23	0.00
3/24/13 11:00 AM	0.24	0.24	0.00
3/24/13 1:00 PM	0.21	0.21	0.00
3/24/13 3:00 PM	0.22	0.22	0.00
3/24/13 5:00 PM	0.23	0.23	0.00
3/24/13 7:00 PM	0.23	0.23	0.00
3/24/13 9:00 PM	0.24	0.24	0.00
3/24/13 11:00 PM	0.23	0.23	0.00
3/25/13 1:00 AM	0.22	0.22	0.00
3/25/13 3:00 AM	0.24	0.24	0.00
3/25/13 5:00 AM	0.24	0.24	0.00
3/25/13 7:00 AM	0.22	0.22	0.00
3/25/13 9:00 AM	0.27	0.27	0.00
3/25/13 11:00 AM	0.23	0.23	0.00
3/25/13 1:00 PM	0.23	0.23	0.00
3/25/13 3:00 PM	0.22	0.22	0.00
3/25/13 5:00 PM	0.22	0.22	0.00
3/25/13 7:00 PM	0.22	0.22	0.00
3/25/13 9:00 PM	0.23	0.23	0.00
3/25/13 11:00 PM	0.22	0.22	0.00
3/26/13 1:00 AM	0.20	0.20	0.00
3/26/13 3:00 AM	0.20	0.20	0.00
3/26/13 5:00 AM	0.23	0.23	0.00
3/26/13 7:00 AM	0.23	0.23	0.00
3/26/13 9:00 AM	0.25	0.25	0.00
3/26/13 11:00 AM	0.23	0.23	0.00
3/26/13 1:00 PM	0.23	0.23	0.00
3/26/13 3:00 PM	0.23	0.23	0.00
3/26/13 5:00 PM	0.24	0.24	0.00
3/26/13 7:00 PM	0.24	0.24	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
3/26/13 9:00 PM	0.24	0.24	0.00
3/26/13 11:00 PM	0.24	0.24	0.00
3/27/13 1:00 AM	0.23	0.23	0.00
3/27/13 3:00 AM	0.24	0.24	0.00
3/27/13 5:00 AM	0.23	0.23	0.00
3/27/13 7:00 AM	0.23	0.23	0.00
3/27/13 9:00 AM	0.24	0.24	0.00
3/27/13 11:00 AM	0.25	0.25	0.00
3/27/13 1:00 PM	0.24	0.24	0.00
3/27/13 3:00 PM	0.23	0.23	0.00
3/27/13 5:00 PM	0.23	0.23	0.00
3/27/13 7:00 PM	0.22	0.22	0.00
3/27/13 9:00 PM	0.20	0.20	0.00
3/27/13 11:00 PM	0.19	0.19	0.00
3/28/13 1:00 AM	0.17	0.17	0.00
3/28/13 3:00 AM	0.19	0.19	0.00
3/28/13 5:00 AM	0.20	0.20	0.00
3/28/13 7:00 AM	0.20	0.20	0.00
3/28/13 9:00 AM	0.21	0.21	0.00
3/28/13 11:00 AM	0.21	0.21	0.00
3/28/13 1:00 PM	0.20	0.20	0.00
3/28/13 3:00 PM	0.20	0.20	0.00
3/28/13 5:00 PM	0.20	0.20	0.00
3/28/13 7:00 PM	0.20	0.20	0.00
3/28/13 9:00 PM	0.21	0.21	0.00
3/28/13 11:00 PM	0.17	0.17	0.00
3/29/13 1:00 AM	0.19	0.19	0.00
3/29/13 3:00 AM	0.18	0.18	0.00
3/29/13 5:00 AM	0.23	0.23	0.00
3/29/13 7:00 AM	0.23	0.23	0.00
3/29/13 9:00 AM	0.20	0.20	0.00
3/29/13 11:00 AM	0.20	0.20	0.00
3/29/13 1:00 PM	0.20	0.20	0.00
3/29/13 3:00 PM	0.23	0.23	0.00
3/29/13 5:00 PM	0.22	0.22	0.00
3/29/13 7:00 PM	0.23	0.23	0.00
3/29/13 9:00 PM	0.24	0.24	0.00
3/29/13 11:00 PM	0.18	0.18	0.00
3/30/13 1:00 AM	0.20	0.20	0.00
3/30/13 3:00 AM	0.22	0.22	0.00
3/30/13 5:00 AM	0.18	0.18	0.00
3/30/13 7:00 AM	0.24	0.24	0.00
3/30/13 9:00 AM	0.23	0.23	0.00
3/30/13 11:00 AM	0.23	0.23	0.00
3/30/13 1:00 PM	0.25	0.25	0.00
3/30/13 3:00 PM	0.21	0.21	0.00
3/30/13 5:00 PM	0.22	0.22	0.00
3/30/13 7:00 PM	0.25	0.25	0.00
3/30/13 9:00 PM	0.21	0.21	0.00
3/30/13 11:00 PM	0.17	0.17	0.00
3/31/13 1:00 AM	0.18	0.18	0.00
3/31/13 3:00 AM	0.16	0.16	0.00
3/31/13 5:00 AM	0.17	0.17	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
3/31/13 7:00 AM	0.18	0.18	0.00
3/31/13 9:00 AM	0.20	0.20	0.00
3/31/13 11:00 AM	0.20	0.20	0.00
3/31/13 1:00 PM	0.20	0.20	0.00
3/31/13 3:00 PM	0.20	0.20	0.00
3/31/13 5:00 PM	0.21	0.21	0.00
3/31/13 7:00 PM	0.21	0.21	0.00
3/31/13 9:00 PM	0.20	0.20	0.00
3/31/13 11:00 PM	0.17	0.17	0.00
4/1/13 1:00 AM	0.19	0.19	0.00
4/1/13 3:00 AM	0.20	0.20	0.00
4/1/13 5:00 AM	0.18	0.18	0.00
4/1/13 7:00 AM	0.18	0.18	0.00
4/1/13 9:00 AM	0.17	0.17	0.00
4/1/13 11:00 AM	0.17	0.17	0.00
4/1/13 1:00 PM	0.18	0.18	0.00
4/1/13 3:00 PM	0.19	0.19	0.00
4/1/13 5:00 PM	0.19	0.19	0.00
4/1/13 7:00 PM	0.19	0.19	0.00
4/1/13 9:00 PM	0.18	0.18	0.00
4/1/13 11:00 PM	0.18	0.18	0.00
4/2/13 1:00 AM	0.25	0.25	0.00
4/2/13 3:00 AM	0.24	0.24	0.00
4/2/13 5:00 AM	0.21	0.21	0.00
4/2/13 7:00 AM	0.21	0.21	0.00
4/2/13 9:00 AM	0.24	0.24	0.00
4/2/13 11:00 AM	0.19	0.19	0.00
4/2/13 1:00 PM	0.23	0.23	0.00
4/2/13 3:00 PM	0.22	0.22	0.00
4/2/13 5:00 PM	0.21	0.21	0.00
4/2/13 7:00 PM	0.23	0.23	0.00
4/2/13 9:00 PM	0.22	0.22	0.00
4/2/13 11:00 PM	0.21	0.21	0.00
4/3/13 1:00 AM	0.24	0.24	0.00
4/3/13 3:00 AM	0.22	0.22	0.00
4/3/13 5:00 AM	0.23	0.23	0.00
4/3/13 7:00 AM	0.24	0.24	0.00
4/3/13 9:00 AM	0.21	0.21	0.00
4/3/13 11:00 AM	0.22	0.22	0.00
4/3/13 1:00 PM	0.23	0.23	0.00
4/3/13 3:00 PM	0.22	0.22	0.00
4/3/13 5:00 PM	0.22	0.22	0.00
4/3/13 7:00 PM	0.25	0.25	0.00
4/3/13 9:00 PM	0.25	0.25	0.00
4/3/13 11:00 PM	0.23	0.23	0.00
4/4/13 1:00 AM	0.22	0.22	0.00
4/4/13 3:00 AM	0.21	0.21	0.00
4/4/13 5:00 AM	0.23	0.23	0.00
4/4/13 7:00 AM	0.23	0.23	0.00
4/4/13 9:00 AM	0.22	0.22	0.00
4/4/13 11:00 AM	0.24	0.24	0.00
4/4/13 1:00 PM	0.25	0.25	0.00
4/4/13 3:00 PM	0.23	0.23	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
4/4/13 5:00 PM	0.22	0.22	0.00
4/4/13 7:00 PM	0.23	0.23	0.00
4/4/13 9:00 PM	0.23	0.23	0.00
4/4/13 11:00 PM	0.22	0.22	0.00
4/5/13 1:00 AM	0.20	0.20	0.00
4/5/13 3:00 AM	0.20	0.20	0.00
4/5/13 5:00 AM	0.23	0.23	0.00
4/5/13 7:00 AM	0.22	0.22	0.00
4/5/13 9:00 AM	0.22	0.22	0.00
4/5/13 11:00 AM	0.22	0.22	0.00
4/5/13 1:00 PM	0.22	0.22	0.00
4/5/13 3:00 PM	0.22	0.22	0.00
4/5/13 5:00 PM	0.23	0.23	0.00
4/5/13 7:00 PM	0.23	0.23	0.00
4/5/13 9:00 PM	0.23	0.23	0.00
4/5/13 11:00 PM	0.23	0.23	0.00
4/6/13 1:00 AM	0.26	0.26	0.00
4/6/13 3:00 AM	0.23	0.23	0.00
4/6/13 5:00 AM	0.24	0.24	0.00
4/6/13 7:00 AM	0.24	0.24	0.00
4/6/13 9:00 AM	0.22	0.22	0.00
4/6/13 11:00 AM	0.23	0.23	0.00
4/6/13 1:00 PM	0.22	0.22	0.00
4/6/13 3:00 PM	0.22	0.22	0.00
4/6/13 5:00 PM	0.22	0.22	0.00
4/6/13 7:00 PM	0.24	0.24	0.00
4/6/13 9:00 PM	0.22	0.22	0.00
4/6/13 11:00 PM	0.22	0.22	0.00
4/7/13 1:00 AM	0.22	0.22	0.00
4/7/13 3:00 AM	0.24	0.24	0.00
4/7/13 5:00 AM	0.26	0.26	0.00
4/7/13 7:00 AM	0.25	0.25	0.00
4/7/13 9:00 AM	0.21	0.21	0.00
4/7/13 11:00 AM	0.21	0.21	0.00
4/7/13 1:00 PM	0.21	0.21	0.00
4/7/13 3:00 PM	0.20	0.20	0.00
4/7/13 5:00 PM	0.21	0.21	0.00
4/7/13 7:00 PM	0.22	0.22	0.00
4/7/13 9:00 PM	0.22	0.22	0.00
4/7/13 11:00 PM	0.22	0.22	0.00
4/8/13 1:00 AM	0.20	0.20	0.00
4/8/13 3:00 AM	0.21	0.21	0.00
4/8/13 5:00 AM	0.23	0.23	0.00
4/8/13 7:00 AM	0.22	0.22	0.00
4/8/13 9:00 AM	0.21	0.21	0.00
4/8/13 11:00 AM	0.21	0.21	0.00
4/8/13 1:00 PM	0.22	0.22	0.00
4/8/13 3:00 PM	0.22	0.22	0.00
4/8/13 5:00 PM	0.22	0.22	0.00
4/8/13 7:00 PM	0.23	0.23	0.00
4/8/13 9:00 PM	0.24	0.24	0.00
4/8/13 11:00 PM	0.22	0.22	0.00
4/9/13 1:00 AM	0.21	0.21	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
4/9/13 3:00 AM	0.20	0.20	0.00
4/9/13 5:00 AM	0.23	0.23	0.00
4/9/13 7:00 AM	0.24	0.24	0.00
4/9/13 9:00 AM	0.23	0.23	0.00
4/9/13 11:00 AM	0.22	0.22	0.00
4/9/13 1:00 PM	0.23	0.23	0.00
4/9/13 3:00 PM	0.23	0.23	0.00
4/9/13 5:00 PM	0.22	0.22	0.00
4/9/13 7:00 PM	0.22	0.22	0.00
4/9/13 9:00 PM	0.21	0.21	0.00
4/9/13 11:00 PM	0.20	0.20	0.00
4/10/13 1:00 AM	0.20	0.20	0.00
4/10/13 3:00 AM	0.20	0.20	0.00
4/10/13 5:00 AM	0.22	0.22	0.00
4/10/13 7:00 AM	0.23	0.23	0.00
4/10/13 9:00 AM	0.23	0.23	0.00
4/10/13 11:00 AM	0.23	0.23	0.00
4/10/13 1:00 PM	0.24	0.24	0.00
4/10/13 3:00 PM	0.26	0.26	0.00
4/10/13 5:00 PM	0.25	0.25	0.00
4/10/13 7:00 PM	0.24	0.24	0.00
4/10/13 9:00 PM	0.23	0.23	0.00
4/10/13 11:00 PM	0.23	0.23	0.00
4/11/13 1:00 AM	0.24	0.24	0.00
4/11/13 3:00 AM	0.24	0.24	0.00
4/11/13 5:00 AM	0.23	0.23	0.00
4/11/13 7:00 AM	0.23	0.23	0.00
4/11/13 9:00 AM	0.22	0.22	0.00
4/11/13 11:00 AM	0.21	0.21	0.00
4/11/13 1:00 PM	0.21	0.21	0.00
4/11/13 3:00 PM	0.21	0.21	0.00
4/11/13 5:00 PM	0.20	0.20	0.00
4/11/13 7:00 PM	0.19	0.19	0.00
4/11/13 9:00 PM	0.19	0.19	0.00
4/11/13 11:00 PM	0.19	0.19	0.00
4/12/13 1:00 AM	0.20	0.20	0.00
4/12/13 3:00 AM	0.20	0.20	0.00
4/12/13 5:00 AM	0.20	0.20	0.00
4/12/13 7:00 AM	0.20	0.20	0.00
4/12/13 9:00 AM	0.19	0.19	0.00
4/12/13 11:00 AM	0.20	0.20	0.00
4/12/13 1:00 PM	0.19	0.19	0.00
4/12/13 3:00 PM	0.19	0.19	0.00
4/12/13 5:00 PM	0.20	0.20	0.00
4/12/13 7:00 PM	0.20	0.20	0.00
4/12/13 9:00 PM	0.21	0.21	0.00
4/12/13 11:00 PM	0.20	0.20	0.00
4/13/13 1:00 AM	0.20	0.20	0.00
4/13/13 3:00 AM	0.20	0.20	0.00
4/13/13 5:00 AM	0.20	0.20	0.00
4/13/13 7:00 AM	0.21	0.21	0.00
4/13/13 9:00 AM	0.21	0.21	0.00
4/13/13 11:00 AM	0.21	0.21	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
4/13/13 1:00 PM	0.22	0.22	0.00
4/13/13 3:00 PM	0.19	0.19	0.00
4/13/13 5:00 PM	0.20	0.20	0.00
4/13/13 7:00 PM	0.19	0.19	0.00
4/13/13 9:00 PM	0.18	0.18	0.00
4/13/13 11:00 PM	0.22	0.22	0.00
4/14/13 1:00 AM	0.19	0.19	0.00
4/14/13 3:00 AM	0.20	0.20	0.00
4/14/13 5:00 AM	0.22	0.22	0.00
4/14/13 7:00 AM	0.22	0.22	0.00
4/14/13 9:00 AM	0.23	0.23	0.00
4/14/13 11:00 AM	0.23	0.23	0.00
4/14/13 1:00 PM	0.23	0.23	0.00
4/14/13 3:00 PM	0.24	0.24	0.00
4/14/13 5:00 PM	0.25	0.25	0.00
4/14/13 7:00 PM	0.24	0.24	0.00
4/14/13 9:00 PM	0.25	0.25	0.00
4/14/13 11:00 PM	0.24	0.24	0.00
4/15/13 1:00 AM	0.24	0.24	0.00
4/15/13 3:00 AM	0.25	0.25	0.00
4/15/13 5:00 AM	0.20	0.20	0.00
4/15/13 7:00 AM	0.21	0.21	0.00
4/15/13 9:00 AM	0.24	0.24	0.00
4/15/13 11:00 AM	0.25	0.25	0.00
4/15/13 1:00 PM	0.24	0.24	0.00
4/15/13 3:00 PM	0.24	0.24	0.00
4/15/13 5:00 PM	0.21	0.21	0.00
4/15/13 7:00 PM	0.21	0.21	0.00
4/15/13 9:00 PM	0.21	0.21	0.00
4/15/13 11:00 PM	0.21	0.21	0.00
4/16/13 1:00 AM	0.22	0.22	0.00
4/16/13 3:00 AM	0.23	0.23	0.00
4/16/13 5:00 AM	0.23	0.23	0.00
4/16/13 7:00 AM	0.24	0.24	0.00
4/16/13 9:00 AM	0.23	0.23	0.00
4/16/13 11:00 AM	0.24	0.24	0.00
4/16/13 1:00 PM	0.24	0.24	0.00
4/16/13 3:00 PM	0.25	0.25	0.00
4/16/13 5:00 PM	0.24	0.24	0.00
4/16/13 7:00 PM	0.24	0.24	0.00
4/16/13 9:00 PM	0.25	0.25	0.00
4/16/13 11:00 PM	0.26	0.26	0.00
4/17/13 1:00 AM	0.25	0.25	0.00
4/17/13 3:00 AM	0.26	0.26	0.00
4/17/13 5:00 AM	0.26	0.26	0.00
4/17/13 7:00 AM	0.25	0.25	0.00
4/17/13 9:00 AM	0.24	0.24	0.00
4/17/13 11:00 AM	0.24	0.24	0.00
4/17/13 1:00 PM	0.24	0.24	0.00
4/17/13 3:00 PM	0.24	0.24	0.00
4/17/13 5:00 PM	0.26	0.26	0.00
4/17/13 7:00 PM	0.23	0.23	0.00
4/17/13 9:00 PM	0.24	0.24	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
4/17/13 11:00 PM	0.24	0.24	0.00
4/18/13 1:00 AM	0.24	0.24	0.00
4/18/13 3:00 AM	0.24	0.24	0.00
4/18/13 5:00 AM	0.25	0.25	0.00
4/18/13 7:00 AM	0.28	0.28	0.00
4/18/13 9:00 AM	0.32	0.32	0.00
4/18/13 11:00 AM	0.32	0.32	0.00
4/18/13 1:00 PM	0.29	0.29	0.00
4/18/13 3:00 PM	0.29	0.29	0.00
4/18/13 5:00 PM	0.29	0.29	0.00
4/18/13 7:00 PM	0.25	0.25	0.00
4/18/13 9:00 PM	0.28	0.28	0.00
4/18/13 11:00 PM	0.28	0.28	0.00
4/19/13 1:00 AM	0.27	0.27	0.00
4/19/13 3:00 AM	0.28	0.28	0.00
4/19/13 5:00 AM	0.28	0.28	0.00
4/19/13 7:00 AM	0.28	0.28	0.00
4/19/13 9:00 AM	0.28	0.28	0.00
4/19/13 11:00 AM	0.32	0.32	0.00
4/19/13 1:00 PM	0.29	0.29	0.00
4/19/13 3:00 PM	0.25	0.25	0.00
4/19/13 5:00 PM	0.28	0.28	0.00
4/19/13 7:00 PM	0.25	0.25	0.00
4/19/13 9:00 PM	0.24	0.24	0.00
4/19/13 11:00 PM	0.23	0.23	0.00
4/20/13 1:00 AM	0.24	0.24	0.00
4/20/13 3:00 AM	0.23	0.23	0.00
4/20/13 5:00 AM	0.24	0.24	0.00
4/20/13 7:00 AM	0.25	0.25	0.00
4/20/13 9:00 AM	0.24	0.24	0.00
4/20/13 11:00 AM	0.24	0.24	0.00
4/20/13 1:00 PM	0.25	0.25	0.00
4/20/13 3:00 PM	0.25	0.25	0.00
4/20/13 5:00 PM	0.24	0.24	0.00
4/20/13 7:00 PM	0.25	0.25	0.00
4/20/13 9:00 PM	0.26	0.26	0.00
4/20/13 11:00 PM	0.25	0.25	0.00
4/21/13 1:00 AM	0.25	0.25	0.00
4/21/13 3:00 AM	0.25	0.25	0.00
4/21/13 5:00 AM	0.26	0.26	0.00
4/21/13 7:00 AM	0.25	0.25	0.00
4/21/13 9:00 AM	0.25	0.25	0.00
4/21/13 11:00 AM	0.24	0.24	0.00
4/21/13 1:00 PM	0.24	0.24	0.00
4/21/13 3:00 PM	0.23	0.23	0.00
4/21/13 5:00 PM	0.23	0.23	0.00
4/21/13 7:00 PM	0.22	0.22	0.00
4/21/13 9:00 PM	0.22	0.22	0.00
4/21/13 11:00 PM	0.23	0.23	0.00
4/22/13 1:00 AM	0.24	0.24	0.00
4/22/13 3:00 AM	0.23	0.23	0.00
4/22/13 5:00 AM	0.23	0.23	0.00
4/22/13 7:00 AM	0.24	0.24	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
4/22/13 9:00 AM	0.22	0.22	0.00
4/22/13 11:00 AM	0.21	0.21	0.00
4/22/13 1:00 PM	0.16	0.16	0.00
4/22/13 3:00 PM	0.18	0.18	0.00
4/22/13 5:00 PM	0.17	0.17	0.00
4/22/13 7:00 PM	0.19	0.19	0.00
4/22/13 9:00 PM	0.17	0.17	0.00
4/22/13 11:00 PM	0.11	0.11	0.00
4/23/13 1:00 AM	0.13	0.13	0.00
4/23/13 3:00 AM	0.14	0.00	0.00
4/23/13 5:00 AM	0.11	0.00	0.00
4/23/13 7:00 AM	0.13	0.00	0.00
4/23/13 9:00 AM	0.15	0.00	0.00
4/23/13 11:00 AM	0.10	0.00	0.00
4/23/13 1:00 PM	0.11	0.00	0.00
4/23/13 3:00 PM	0.12	0.00	0.00
4/23/13 5:00 PM	0.11	0.00	0.00
4/23/13 7:00 PM	0.11	0.00	0.00
4/23/13 9:00 PM	0.16	0.00	0.00
4/23/13 11:00 PM	0.08	0.00	0.00
4/24/13 1:00 AM	0.08	0.00	0.00
4/24/13 3:00 AM	0.08	0.00	0.00
4/24/13 5:00 AM	0.08	0.00	0.00
4/24/13 7:00 AM	0.08	0.00	0.00
4/24/13 9:00 AM	0.09	0.00	0.00
4/24/13 11:00 AM	0.09	0.00	0.00
4/24/13 1:00 PM	0.08	0.00	0.00
4/24/13 3:00 PM	0.09	0.00	0.00
4/24/13 5:00 PM	0.08	0.00	0.00
4/24/13 7:00 PM	0.08	0.00	0.00
4/24/13 9:00 PM	0.09	0.00	0.00
4/24/13 11:00 PM	0.09	0.00	0.00
4/25/13 1:00 AM	0.07	0.00	0.00
4/25/13 3:00 AM	0.07	0.00	0.00
4/25/13 5:00 AM	0.09	0.00	0.00
4/25/13 7:00 AM	0.09	0.00	0.00
4/25/13 9:00 AM	0.10	0.00	0.00
4/25/13 11:00 AM	0.10	0.00	0.00
4/25/13 1:00 PM	0.09	0.00	0.00
4/25/13 3:00 PM	0.10	0.00	0.00
4/25/13 5:00 PM	0.09	0.00	0.00
4/25/13 7:00 PM	0.10	0.00	0.00
4/25/13 9:00 PM	0.09	0.00	0.00
4/25/13 11:00 PM	0.09	0.00	0.00
4/26/13 1:00 AM	0.09	0.00	0.00
4/26/13 3:00 AM	0.09	0.00	0.00
4/26/13 5:00 AM	0.09	0.00	0.00
4/26/13 7:00 AM	0.09	0.00	0.00
4/26/13 9:00 AM	0.08	0.00	0.00
4/26/13 11:00 AM	0.08	0.00	0.00
4/26/13 1:00 PM	0.09	0.00	0.00
4/26/13 3:00 PM	0.09	0.00	0.00
4/26/13 5:00 PM	0.09	0.00	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
4/26/13 7:00 PM	0.09	0.00	0.00
4/26/13 9:00 PM	0.10	0.00	0.00
4/26/13 11:00 PM	0.09	0.00	0.00
4/27/13 1:00 AM	0.09	0.00	0.00
4/27/13 3:00 AM	0.09	0.00	0.00
4/27/13 5:00 AM	0.09	0.00	0.00
4/27/13 7:00 AM	0.09	0.00	0.00
4/27/13 9:00 AM	0.09	0.00	0.00
4/27/13 11:00 AM	0.09	0.00	0.00
4/27/13 1:00 PM	0.09	0.00	0.00
4/27/13 3:00 PM	0.09	0.00	0.00
4/27/13 5:00 PM	0.09	0.00	0.00
4/27/13 7:00 PM	0.10	0.00	0.00
4/27/13 9:00 PM	0.10	0.00	0.00
4/27/13 11:00 PM	0.10	0.00	0.00
4/28/13 1:00 AM	0.05	0.00	0.00
4/28/13 3:00 AM	0.00	0.00	0.00
4/28/13 5:00 AM	0.00	0.00	0.00
4/28/13 7:00 AM	0.00	0.00	0.00
4/28/13 9:00 AM	0.00	0.00	0.00
4/28/13 11:00 AM	0.00	0.00	0.00
4/28/13 1:00 PM	0.00	0.06	0.00
4/28/13 3:00 PM	0.00	0.01	0.00
4/28/13 5:00 PM	0.00	0.00	0.00
4/28/13 7:00 PM	0.00	0.00	0.00
4/28/13 9:00 PM	0.00	0.00	0.00
4/28/13 11:00 PM	0.00	0.00	0.00
4/29/13 1:00 AM	0.00	0.01	0.00
4/29/13 3:00 AM	0.00	0.03	0.00
4/29/13 5:00 AM	0.00	0.05	0.00
4/29/13 7:00 AM	0.00	0.08	0.00
4/29/13 9:00 AM	0.00	0.09	0.00
4/29/13 11:00 AM	0.00	0.09	0.00
4/29/13 1:00 PM	0.00	0.08	0.00
4/29/13 3:00 PM	0.00	0.09	0.00
4/29/13 5:00 PM	0.00	0.09	0.00
4/29/13 7:00 PM	0.00	0.11	0.00
4/29/13 9:00 PM	0.00	0.12	0.00
4/29/13 11:00 PM	0.00	0.12	0.00
4/30/13 1:00 AM	0.00	0.12	0.00
4/30/13 3:00 AM	0.00	0.11	0.00
4/30/13 5:00 AM	0.00	0.12	0.00
4/30/13 7:00 AM	0.12	0.12	0.00
4/30/13 9:00 AM	0.12	0.12	0.00
4/30/13 11:00 AM	0.11	0.11	0.00
4/30/13 1:00 PM	0.11	0.11	0.00
4/30/13 3:00 PM	0.15	0.15	0.00
4/30/13 5:00 PM	0.14	0.14	0.00
4/30/13 7:00 PM	0.11	0.11	0.00
4/30/13 9:00 PM	0.11	0.11	0.00
4/30/13 11:00 PM	0.11	0.11	0.00
5/1/13 1:00 AM	0.16	0.16	0.00
5/1/13 3:00 AM	0.18	0.18	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
5/1/13 5:00 AM	0.19	0.19	0.00
5/1/13 7:00 AM	0.24	0.24	0.00
5/1/13 9:00 AM	0.22	0.22	0.00
5/1/13 11:00 AM	0.00	0.13	0.00
5/1/13 1:00 PM	0.00	0.11	0.00
5/1/13 3:00 PM	0.00	0.11	0.00
5/1/13 5:00 PM	0.00	0.11	0.00
5/1/13 7:00 PM	0.00	0.10	0.00
5/1/13 9:00 PM	0.00	0.08	0.00
5/1/13 11:00 PM	0.00	0.08	0.00
5/2/13 1:00 AM	0.00	0.08	0.00
5/2/13 3:00 AM	0.00	0.09	0.00
5/2/13 5:00 AM	0.00	0.09	0.00
5/2/13 7:00 AM	0.00	0.11	0.00
5/2/13 9:00 AM	0.00	0.12	0.00
5/2/13 11:00 AM	0.00	0.12	0.00
5/2/13 1:00 PM	0.00	0.12	0.00
5/2/13 3:00 PM	0.00	0.12	0.00
5/2/13 5:00 PM	0.00	0.11	0.00
5/2/13 7:00 PM	0.00	0.12	0.00
5/2/13 9:00 PM	0.11	0.11	0.00
5/2/13 11:00 PM	0.11	0.11	0.00
5/3/13 1:00 AM	0.10	0.10	0.00
5/3/13 3:00 AM	0.15	0.15	0.00
5/3/13 5:00 AM	0.19	0.19	0.00
5/3/13 7:00 AM	0.20	0.20	0.00
5/3/13 9:00 AM	0.25	0.25	0.00
5/3/13 11:00 AM	0.30	0.30	0.00
5/3/13 1:00 PM	0.27	0.27	0.00
5/3/13 3:00 PM	0.25	0.25	0.00
5/3/13 5:00 PM	0.23	0.23	0.00
5/3/13 7:00 PM	0.24	0.24	0.00
5/3/13 9:00 PM	0.23	0.23	0.00
5/3/13 11:00 PM	0.18	0.18	0.00
5/4/13 1:00 AM	0.16	0.16	0.00
5/4/13 3:00 AM	0.18	0.18	0.00
5/4/13 5:00 AM	0.22	0.22	0.00
5/4/13 7:00 AM	0.25	0.25	0.00
5/4/13 9:00 AM	0.23	0.23	0.00
5/4/13 11:00 AM	0.22	0.22	0.00
5/4/13 1:00 PM	0.21	0.21	0.00
5/4/13 3:00 PM	0.22	0.22	0.00
5/4/13 5:00 PM	0.21	0.21	0.00
5/4/13 7:00 PM	0.22	0.22	0.00
5/4/13 9:00 PM	0.22	0.22	0.00
5/4/13 11:00 PM	0.23	0.23	0.00
5/5/13 1:00 AM	0.23	0.23	0.00
5/5/13 3:00 AM	0.22	0.22	0.00
5/5/13 5:00 AM	0.21	0.21	0.00
5/5/13 7:00 AM	0.20	0.20	0.00
5/5/13 9:00 AM	0.23	0.23	0.00
5/5/13 11:00 AM	0.22	0.22	0.00
5/5/13 1:00 PM	0.21	0.21	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
5/5/13 3:00 PM	0.22	0.22	0.00
5/5/13 5:00 PM	0.22	0.22	0.00
5/5/13 7:00 PM	0.22	0.22	0.00
5/5/13 9:00 PM	0.22	0.22	0.00
5/5/13 11:00 PM	0.19	0.19	0.00
5/6/13 1:00 AM	0.12	0.12	0.00
5/6/13 3:00 AM	0.17	0.17	0.00
5/6/13 5:00 AM	0.22	0.22	0.00
5/6/13 7:00 AM	0.23	0.23	0.00
5/6/13 9:00 AM	0.21	0.21	0.00
5/6/13 11:00 AM	0.21	0.21	0.00
5/6/13 1:00 PM	0.21	0.21	0.00
5/6/13 3:00 PM	0.22	0.22	0.00
5/6/13 5:00 PM	0.23	0.23	0.00
5/6/13 7:00 PM	0.22	0.22	0.00
5/6/13 9:00 PM	0.22	0.22	0.00
5/6/13 11:00 PM	0.21	0.21	0.00
5/7/13 1:00 AM	0.17	0.17	0.00
5/7/13 3:00 AM	0.15	0.15	0.00
5/7/13 5:00 AM	0.17	0.17	0.00
5/7/13 7:00 AM	0.21	0.21	0.00
5/7/13 9:00 AM	0.21	0.21	0.00
5/7/13 11:00 AM	0.22	0.22	0.00
5/7/13 1:00 PM	0.23	0.23	0.00
5/7/13 3:00 PM	0.23	0.23	0.00
5/7/13 5:00 PM	0.22	0.22	0.00
5/7/13 7:00 PM	0.21	0.21	0.00
5/7/13 9:00 PM	0.21	0.21	0.00
5/7/13 11:00 PM	0.21	0.21	0.00
5/8/13 1:00 AM	0.18	0.18	0.00
5/8/13 3:00 AM	0.18	0.18	0.00
5/8/13 5:00 AM	0.18	0.18	0.00
5/8/13 7:00 AM	0.00	0.09	0.00
5/8/13 9:00 AM	0.09	0.09	0.00
5/8/13 11:00 AM	0.08	0.08	0.00
5/8/13 1:00 PM	0.00	0.09	0.00
5/8/13 3:00 PM	0.00	0.08	0.00
5/8/13 5:00 PM	0.00	0.08	0.00
5/8/13 7:00 PM	0.00	0.08	0.00
5/8/13 9:00 PM	0.00	0.08	0.00
5/8/13 11:00 PM	0.00	0.08	0.00
5/9/13 1:00 AM	0.00	0.07	0.00
5/9/13 3:00 AM	0.00	0.09	0.00
5/9/13 5:00 AM	0.00	0.09	0.00
5/9/13 7:00 AM	0.00	0.10	0.00
5/9/13 9:00 AM	0.09	0.09	0.00
5/9/13 11:00 AM	0.09	0.09	0.00
5/9/13 1:00 PM	0.09	0.09	0.00
5/9/13 3:00 PM	0.10	0.10	0.00
5/9/13 5:00 PM	0.16	0.16	0.00
5/9/13 7:00 PM	0.18	0.18	0.00
5/9/13 9:00 PM	0.22	0.22	0.00
5/9/13 11:00 PM	0.24	0.24	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
5/10/13 1:00 AM	0.21	0.21	0.00
5/10/13 3:00 AM	0.20	0.20	0.00
5/10/13 5:00 AM	0.22	0.22	0.00
5/10/13 7:00 AM	0.23	0.23	0.00
5/10/13 9:00 AM	0.23	0.23	0.00
5/10/13 11:00 AM	0.23	0.23	0.00
5/10/13 1:00 PM	0.23	0.23	0.00
5/10/13 3:00 PM	0.23	0.23	0.00
5/10/13 5:00 PM	0.23	0.23	0.00
5/10/13 7:00 PM	0.23	0.23	0.00
5/10/13 9:00 PM	0.21	0.21	0.00
5/10/13 11:00 PM	0.22	0.22	0.00
5/11/13 1:00 AM	0.22	0.22	0.00
5/11/13 3:00 AM	0.23	0.23	0.00
5/11/13 5:00 AM	0.21	0.21	0.00
5/11/13 7:00 AM	0.21	0.21	0.00
5/11/13 9:00 AM	0.21	0.21	0.00
5/11/13 11:00 AM	0.21	0.21	0.00
5/11/13 1:00 PM	0.21	0.21	0.00
5/11/13 3:00 PM	0.21	0.21	0.00
5/11/13 5:00 PM	0.21	0.21	0.00
5/11/13 7:00 PM	0.21	0.21	0.00
5/11/13 9:00 PM	0.21	0.21	0.00
5/11/13 11:00 PM	0.20	0.20	0.00
5/12/13 1:00 AM	0.21	0.21	0.00
5/12/13 3:00 AM	0.20	0.20	0.00
5/12/13 5:00 AM	0.20	0.20	0.00
5/12/13 7:00 AM	0.20	0.20	0.00
5/12/13 9:00 AM	0.21	0.21	0.00
5/12/13 11:00 AM	0.21	0.21	0.00
5/12/13 1:00 PM	0.21	0.21	0.00
5/12/13 3:00 PM	0.21	0.21	0.00
5/12/13 5:00 PM	0.21	0.21	0.00
5/12/13 7:00 PM	0.21	0.21	0.00
5/12/13 9:00 PM	0.21	0.21	0.00
5/12/13 11:00 PM	0.21	0.21	0.00
5/13/13 1:00 AM	0.21	0.21	0.00
5/13/13 3:00 AM	0.22	0.22	0.00
5/13/13 5:00 AM	0.21	0.21	0.00
5/13/13 7:00 AM	0.19	0.19	0.00
5/13/13 9:00 AM	0.19	0.19	0.00
5/13/13 11:00 AM	0.19	0.19	0.00
5/13/13 1:00 PM	0.18	0.18	0.00
5/13/13 3:00 PM	0.18	0.18	0.00
5/13/13 5:00 PM	0.19	0.19	0.00
5/13/13 7:00 PM	0.19	0.19	0.00
5/13/13 9:00 PM	0.18	0.18	0.00
5/13/13 11:00 PM	0.19	0.19	0.00
5/14/13 1:00 AM	0.16	0.16	0.00
5/14/13 3:00 AM	0.16	0.16	0.00
5/14/13 5:00 AM	0.19	0.19	0.00
5/14/13 7:00 AM	0.19	0.19	0.00
5/14/13 9:00 AM	0.20	0.20	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
5/14/13 11:00 AM	0.20	0.20	0.00
5/14/13 1:00 PM	0.22	0.22	0.00
5/14/13 3:00 PM	0.21	0.21	0.00
5/14/13 5:00 PM	0.21	0.21	0.00
5/14/13 7:00 PM	0.21	0.21	0.00
5/14/13 9:00 PM	0.20	0.20	0.00
5/14/13 11:00 PM	0.15	0.15	0.00
5/15/13 1:00 AM	0.16	0.16	0.00
5/15/13 3:00 AM	0.15	0.15	0.00
5/15/13 5:00 AM	0.15	0.15	0.00
5/15/13 7:00 AM	0.19	0.19	0.00
5/15/13 9:00 AM	0.23	0.23	0.00
5/15/13 11:00 AM	0.23	0.23	0.00
5/15/13 1:00 PM	0.23	0.23	0.00
5/15/13 3:00 PM	0.23	0.23	0.00
5/15/13 5:00 PM	0.22	0.22	0.00
5/15/13 7:00 PM	0.21	0.21	0.00
5/15/13 9:00 PM	0.19	0.19	0.00
5/15/13 11:00 PM	0.15	0.15	0.00
5/16/13 1:00 AM	0.15	0.15	0.00
5/16/13 3:00 AM	0.15	0.15	0.00
5/16/13 5:00 AM	0.18	0.18	0.00
5/16/13 7:00 AM	0.21	0.21	0.00
5/16/13 9:00 AM	0.22	0.22	0.00
5/16/13 11:00 AM	0.17	0.17	0.00
5/16/13 1:00 PM	0.12	0.12	0.00
5/16/13 3:00 PM	0.00	0.10	0.00
5/16/13 5:00 PM	0.00	0.10	0.00
5/16/13 7:00 PM	0.09	0.09	0.00
5/16/13 9:00 PM	0.08	0.08	0.00
5/16/13 11:00 PM	0.10	0.10	0.00
5/17/13 1:00 AM	0.18	0.18	0.00
5/17/13 3:00 AM	0.17	0.17	0.00
5/17/13 5:00 AM	0.18	0.18	0.00
5/17/13 7:00 AM	0.24	0.24	0.00
5/17/13 9:00 AM	0.25	0.25	0.00
5/17/13 11:00 AM	0.24	0.24	0.00
5/17/13 1:00 PM	0.23	0.23	0.00
5/17/13 3:00 PM	0.24	0.24	0.00
5/17/13 5:00 PM	0.25	0.25	0.00
5/17/13 7:00 PM	0.25	0.25	0.00
5/17/13 9:00 PM	0.22	0.22	0.00
5/17/13 11:00 PM	0.22	0.22	0.00
5/18/13 1:00 AM	0.20	0.20	0.00
5/18/13 3:00 AM	0.21	0.21	0.00
5/18/13 5:00 AM	0.21	0.21	0.00
5/18/13 7:00 AM	0.26	0.26	0.00
5/18/13 9:00 AM	0.24	0.24	0.00
5/18/13 11:00 AM	0.24	0.24	0.00
5/18/13 1:00 PM	0.23	0.23	0.00
5/18/13 3:00 PM	0.23	0.23	0.00
5/18/13 5:00 PM	0.23	0.23	0.00
5/18/13 7:00 PM	0.22	0.22	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
5/18/13 9:00 PM	0.23	0.23	0.00
5/18/13 11:00 PM	0.23	0.23	0.00
5/19/13 1:00 AM	0.23	0.23	0.00
5/19/13 3:00 AM	0.23	0.23	0.00
5/19/13 5:00 AM	0.23	0.23	0.00
5/19/13 7:00 AM	0.24	0.24	0.00
5/19/13 9:00 AM	0.24	0.24	0.00
5/19/13 11:00 AM	0.24	0.24	0.00
5/19/13 1:00 PM	0.24	0.24	0.00
5/19/13 3:00 PM	0.24	0.24	0.00
5/19/13 5:00 PM	0.23	0.23	0.00
5/19/13 7:00 PM	0.23	0.23	0.00
5/19/13 9:00 PM	0.24	0.24	0.00
5/19/13 11:00 PM	0.25	0.25	0.00
5/20/13 1:00 AM	0.24	0.24	0.00
5/20/13 3:00 AM	0.25	0.25	0.00
5/20/13 5:00 AM	0.24	0.24	0.00
5/20/13 7:00 AM	0.24	0.24	0.00
5/20/13 9:00 AM	0.24	0.24	0.00
5/20/13 11:00 AM	0.24	0.24	0.00
5/20/13 1:00 PM	0.25	0.25	0.00
5/20/13 3:00 PM	0.24	0.24	0.00
5/20/13 5:00 PM	0.23	0.23	0.00
5/20/13 7:00 PM	0.24	0.24	0.00
5/20/13 9:00 PM	0.23	0.23	0.00
5/20/13 11:00 PM	0.24	0.24	0.00
5/21/13 1:00 AM	0.23	0.23	0.00
5/21/13 3:00 AM	0.24	0.24	0.00
5/21/13 5:00 AM	0.23	0.23	0.00
5/21/13 7:00 AM	0.23	0.23	0.00
5/21/13 9:00 AM	0.23	0.23	0.00
5/21/13 11:00 AM	0.23	0.23	0.00
5/21/13 1:00 PM	0.23	0.23	0.00
5/21/13 3:00 PM	0.23	0.23	0.06
5/21/13 5:00 PM	0.23	0.23	0.04
5/21/13 7:00 PM	0.23	0.23	0.02
5/21/13 9:00 PM	0.23	0.23	0.02
5/21/13 11:00 PM	0.23	0.23	0.08
5/22/13 1:00 AM	0.22	0.22	0.12
5/22/13 3:00 AM	0.19	0.19	0.12
5/22/13 5:00 AM	0.23	0.23	0.12
5/22/13 7:00 AM	0.25	0.25	0.12
5/22/13 9:00 AM	0.23	0.23	0.12
5/22/13 11:00 AM	0.24	0.24	0.12
5/22/13 1:00 PM	0.24	0.24	0.11
5/22/13 3:00 PM	0.24	0.24	0.15
5/22/13 5:00 PM	0.24	0.24	0.21
5/22/13 7:00 PM	0.25	0.25	0.20
5/22/13 9:00 PM	0.25	0.25	0.21
5/22/13 11:00 PM	0.25	0.25	0.13
5/23/13 1:00 AM	0.19	0.00	0.12
5/23/13 3:00 AM	0.16	0.00	0.14
5/23/13 5:00 AM	0.20	0.00	0.16

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
5/23/13 7:00 AM	0.24	0.00	0.19
5/23/13 9:00 AM	0.24	0.00	0.19
5/23/13 11:00 AM	0.24	0.00	0.20
5/23/13 1:00 PM	0.24	0.00	0.19
5/23/13 3:00 PM	0.25	0.00	0.19
5/23/13 5:00 PM	0.25	0.00	0.19
5/23/13 7:00 PM	0.23	0.00	0.19
5/23/13 9:00 PM	0.23	0.00	0.19
5/23/13 11:00 PM	0.23	0.00	0.19
5/24/13 1:00 AM	0.22	0.00	0.20
5/24/13 3:00 AM	0.21	0.00	0.21
5/24/13 5:00 AM	0.23	0.00	0.20
5/24/13 7:00 AM	0.24	0.00	0.20
5/24/13 9:00 AM	0.24	0.00	0.20
5/24/13 11:00 AM	0.25	0.00	0.21
5/24/13 1:00 PM	0.23	0.00	0.22
5/24/13 3:00 PM	0.19	0.00	0.22
5/24/13 5:00 PM	0.21	0.00	0.23
5/24/13 7:00 PM	0.21	0.00	0.22
5/24/13 9:00 PM	0.22	0.00	0.23
5/24/13 11:00 PM	0.23	0.00	0.23
5/25/13 1:00 AM	0.23	0.00	0.18
5/25/13 3:00 AM	0.20	0.00	0.14
5/25/13 5:00 AM	0.19	0.00	0.17
5/25/13 7:00 AM	0.20	0.00	0.19
5/25/13 9:00 AM	0.21	0.00	0.23
5/25/13 11:00 AM	0.22	0.00	0.22
5/25/13 1:00 PM	0.21	0.00	0.20
5/25/13 3:00 PM	0.21	0.00	0.19
5/25/13 5:00 PM	0.22	0.00	0.21
5/25/13 7:00 PM	0.21	0.00	0.21
5/25/13 9:00 PM	0.20	0.00	0.21
5/25/13 11:00 PM	0.20	0.00	0.20
5/26/13 1:00 AM	0.20	0.00	0.19
5/26/13 3:00 AM	0.20	0.00	0.13
5/26/13 5:00 AM	0.21	0.00	0.09
5/26/13 7:00 AM	0.23	0.00	0.09
5/26/13 9:00 AM	0.23	0.00	0.20
5/26/13 11:00 AM	0.23	0.00	0.20
5/26/13 1:00 PM	0.23	0.00	0.22
5/26/13 3:00 PM	0.23	0.00	0.22
5/26/13 5:00 PM	0.23	0.00	0.21
5/26/13 7:00 PM	0.23	0.00	0.23
5/26/13 9:00 PM	0.22	0.00	0.16
5/26/13 11:00 PM	0.22	0.00	0.10
5/27/13 1:00 AM	0.21	0.00	0.19
5/27/13 3:00 AM	0.19	0.00	0.19
5/27/13 5:00 AM	0.19	0.00	0.17
5/27/13 7:00 AM	0.21	0.00	0.09
5/27/13 9:00 AM	0.24	0.00	0.10
5/27/13 11:00 AM	0.20	0.00	0.00
5/27/13 1:00 PM	0.20	0.00	0.02
5/27/13 3:00 PM	0.20	0.00	0.11

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
5/27/13 5:00 PM	0.19	0.00	0.32
5/27/13 7:00 PM	0.19	0.00	0.25
5/27/13 9:00 PM	0.19	0.00	0.22
5/27/13 11:00 PM	0.19	0.00	0.20
5/28/13 1:00 AM	0.16	0.00	0.13
5/28/13 3:00 AM	0.17	0.00	0.12
5/28/13 5:00 AM	0.17	0.00	0.13
5/28/13 7:00 AM	0.18	0.00	0.19
5/28/13 9:00 AM	0.20	0.00	0.18
5/28/13 11:00 AM	0.22	0.00	0.18
5/28/13 1:00 PM	0.22	0.00	0.18
5/28/13 3:00 PM	0.21	0.00	0.17
5/28/13 5:00 PM	0.20	0.00	0.18
5/28/13 7:00 PM	0.20	0.00	0.18
5/28/13 9:00 PM	0.20	0.00	0.18
5/28/13 11:00 PM	0.19	0.00	0.18
5/29/13 1:00 AM	0.20	0.00	0.19
5/29/13 3:00 AM	0.20	0.00	0.19
5/29/13 5:00 AM	0.20	0.00	0.19
5/29/13 7:00 AM	0.20	0.00	0.18
5/29/13 9:00 AM	0.21	0.00	0.17
5/29/13 11:00 AM	0.22	0.00	0.15
5/29/13 1:00 PM	0.22	0.00	0.16
5/29/13 3:00 PM	0.23	0.00	0.14
5/29/13 5:00 PM	0.22	0.00	0.14
5/29/13 7:00 PM	0.18	0.00	0.14
5/29/13 9:00 PM	0.19	0.00	0.13
5/29/13 11:00 PM	0.18	0.00	0.15
5/30/13 1:00 AM	0.22	0.00	0.14
5/30/13 3:00 AM	0.22	0.00	0.14
5/30/13 5:00 AM	0.22	0.00	0.13
5/30/13 7:00 AM	0.24	0.00	0.18
5/30/13 9:00 AM	0.24	0.00	0.12
5/30/13 11:00 AM	0.24	0.00	0.13
5/30/13 1:00 PM	0.23	0.00	0.16
5/30/13 3:00 PM	0.24	0.00	0.18
5/30/13 5:00 PM	0.23	0.00	0.18
5/30/13 7:00 PM	0.22	0.00	0.20
5/30/13 9:00 PM	0.22	0.00	0.21
5/30/13 11:00 PM	0.21	0.00	0.21
5/31/13 1:00 AM	0.19	0.00	0.22
5/31/13 3:00 AM	0.20	0.00	0.23
5/31/13 5:00 AM	0.20	0.00	0.22
5/31/13 7:00 AM	0.25	0.00	0.21
5/31/13 9:00 AM	0.24	0.00	0.20
5/31/13 11:00 AM	0.22	0.00	0.18
5/31/13 1:00 PM	0.20	0.00	0.17
5/31/13 3:00 PM	0.19	0.00	0.16
5/31/13 5:00 PM	0.18	0.00	0.15
5/31/13 7:00 PM	0.18	0.00	0.15
5/31/13 9:00 PM	0.18	0.00	0.14
5/31/13 11:00 PM	0.17	0.00	0.14
6/1/13 1:00 AM	0.16	0.00	0.14

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
6/1/13 3:00 AM	0.16	0.00	0.14
6/1/13 5:00 AM	0.16	0.00	0.15
6/1/13 7:00 AM	0.16	0.00	0.14
6/1/13 9:00 AM	0.16	0.00	0.14
6/1/13 11:00 AM	0.16	0.00	0.15
6/1/13 1:00 PM	0.18	0.00	0.15
6/1/13 3:00 PM	0.17	0.00	0.14
6/1/13 5:00 PM	0.16	0.00	0.14
6/1/13 7:00 PM	0.15	0.00	0.15
6/1/13 9:00 PM	0.14	0.00	0.15
6/1/13 11:00 PM	0.15	0.00	0.15
6/2/13 1:00 AM	0.15	0.15	0.15
6/2/13 3:00 AM	0.16	0.16	0.15
6/2/13 5:00 AM	0.16	0.16	0.15
6/2/13 7:00 AM	0.18	0.18	0.12
6/2/13 9:00 AM	0.19	0.19	0.14
6/2/13 11:00 AM	0.19	0.00	0.14
6/2/13 1:00 PM	0.18	0.00	0.14
6/2/13 3:00 PM	0.18	0.00	0.15
6/2/13 5:00 PM	0.18	0.00	0.15
6/2/13 7:00 PM	0.18	0.00	0.15
6/2/13 9:00 PM	0.17	0.00	0.15
6/3/13 11:00 PM	0.17	0.00	0.15
6/3/13 1:00 AM	0.16	0.00	0.16
6/3/13 3:00 AM	0.17	0.00	0.16
6/3/13 5:00 AM	0.18	0.00	0.15
6/3/13 7:00 AM	0.18	0.00	0.16
6/3/13 9:00 AM	0.18	0.00	0.16
6/3/13 11:00 AM	0.18	0.00	0.16
6/3/13 1:00 PM	0.19	0.00	0.16
6/3/13 3:00 PM	0.19	0.00	0.15
6/3/13 5:00 PM	0.19	0.19	0.16
6/3/13 7:00 PM	0.18	0.18	0.17
6/3/13 9:00 PM	0.18	0.18	0.17
6/3/13 11:00 PM	0.18	0.18	0.17
6/4/13 1:00 AM	0.18	0.18	0.17
6/4/13 3:00 AM	0.18	0.18	0.18
6/4/13 5:00 AM	0.17	0.17	0.20
6/4/13 7:00 AM	0.18	0.18	0.22
6/4/13 9:00 AM	0.18	0.18	0.22
6/4/13 11:00 AM	0.19	0.19	0.20
6/4/13 1:00 PM	0.21	0.21	0.25
6/4/13 3:00 PM	0.20	0.20	0.21
6/4/13 5:00 PM	0.20	0.20	0.18
6/4/13 7:00 PM	0.22	0.22	0.18
6/4/13 9:00 PM	0.21	0.21	0.18
6/4/13 11:00 PM	0.20	0.20	0.18
6/5/13 1:00 AM	0.21	0.21	0.17
6/5/13 3:00 AM	0.20	0.20	0.20
6/5/13 5:00 AM	0.21	0.21	0.19
6/5/13 7:00 AM	0.22	0.22	0.26
6/5/13 9:00 AM	0.21	0.21	0.46
6/5/13 11:00 AM	0.20	0.20	0.23

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
6/5/13 1:00 PM	0.20	0.20	0.22
6/5/13 3:00 PM	0.20	0.20	0.23
6/5/13 5:00 PM	0.20	0.20	0.17
6/5/13 7:00 PM	0.20	0.20	0.16
6/5/13 9:00 PM	0.20	0.20	0.16
6/5/13 11:00 PM	0.21	0.21	0.15
6/6/13 1:00 AM	0.19	0.19	0.15
6/6/13 3:00 AM	0.19	0.19	0.15
6/6/13 5:00 AM	0.19	0.19	0.16
6/6/13 7:00 AM	0.19	0.19	0.20
6/6/13 9:00 AM	0.19	0.19	0.20
6/6/13 11:00 AM	0.18	0.18	0.19
6/6/13 1:00 PM	0.19	0.19	0.18
6/6/13 3:00 PM	0.19	0.19	0.18
6/6/13 5:00 PM	0.20	0.20	0.18
6/6/13 7:00 PM	0.21	0.21	0.24
6/6/13 9:00 PM	0.21	0.21	0.19
6/6/13 11:00 PM	0.20	0.20	0.17
6/7/13 1:00 AM	0.20	0.20	0.17
6/7/13 3:00 AM	0.17	0.17	0.18
6/7/13 5:00 AM	0.22	0.22	0.18
6/7/13 7:00 AM	0.21	0.21	0.17
6/7/13 9:00 AM	0.21	0.21	0.22
6/7/13 11:00 AM	0.20	0.20	0.23
6/7/13 1:00 PM	0.20	0.20	0.24
6/7/13 3:00 PM	0.20	0.20	0.31
6/7/13 5:00 PM	0.20	0.20	0.26
6/7/13 7:00 PM	0.20	0.20	0.25
6/7/13 9:00 PM	0.20	0.20	0.22
6/7/13 11:00 PM	0.19	0.19	0.21
6/8/13 1:00 AM	0.19	0.19	0.21
6/8/13 3:00 AM	0.19	0.19	0.20
6/8/13 5:00 AM	0.19	0.19	0.23
6/8/13 7:00 AM	0.19	0.19	0.19
6/8/13 9:00 AM	0.19	0.19	0.06
6/8/13 11:00 AM	0.19	0.19	0.07
6/8/13 1:00 PM	0.18	0.18	0.07
6/8/13 3:00 PM	0.18	0.18	0.08
6/8/13 5:00 PM	0.17	0.17	0.18
6/8/13 7:00 PM	0.17	0.17	0.23
6/8/13 9:00 PM	0.18	0.18	0.27
6/8/13 11:00 PM	0.18	0.18	0.25
6/9/13 1:00 AM	0.15	0.15	0.25
6/9/13 3:00 AM	0.16	0.16	0.22
6/9/13 5:00 AM	0.17	0.17	0.20
6/9/13 7:00 AM	0.20	0.20	0.21
6/9/13 9:00 AM	0.20	0.20	0.24
6/9/13 11:00 AM	0.19	0.19	0.00
6/9/13 1:00 PM	0.21	0.21	0.00
6/9/13 3:00 PM	0.20	0.20	0.00
6/9/13 5:00 PM	0.19	0.19	0.02
6/9/13 7:00 PM	0.19	0.19	0.07
6/9/13 9:00 PM	0.19	0.19	0.11

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
6/9/13 11:00 PM	0.19	0.19	0.07
6/10/13 1:00 AM	0.18	0.18	0.07
6/10/13 3:00 AM	0.18	0.18	0.07
6/10/13 5:00 AM	0.18	0.18	0.07
6/10/13 7:00 AM	0.18	0.18	0.08
6/10/13 9:00 AM	0.19	0.19	0.08
6/10/13 11:00 AM	0.21	0.21	0.09
6/10/13 1:00 PM	0.20	0.20	0.09
6/10/13 3:00 PM	0.20	0.20	0.08
6/10/13 5:00 PM	0.19	0.19	0.09
6/10/13 7:00 PM	0.18	0.18	0.11
6/10/13 9:00 PM	0.19	0.19	0.35
6/10/13 11:00 PM	0.18	0.18	0.36
6/11/13 1:00 AM	0.17	0.17	0.27
6/11/13 3:00 AM	0.18	0.18	0.24
6/11/13 5:00 AM	0.18	0.18	0.29
6/11/13 7:00 AM	0.18	0.18	0.25
6/11/13 9:00 AM	0.18	0.18	0.19
6/11/13 11:00 AM	0.19	0.19	0.24
6/11/13 1:00 PM	0.19	0.19	0.23
6/11/13 3:00 PM	0.18	0.18	0.21
6/11/13 5:00 PM	0.18	0.18	0.20
6/11/13 7:00 PM	0.17	0.17	0.19
6/11/13 9:00 PM	0.18	0.18	0.19
6/11/13 11:00 PM	0.16	0.16	0.19
6/12/13 1:00 AM	0.15	0.15	0.19
6/12/13 3:00 AM	0.17	0.17	0.18
6/12/13 5:00 AM	0.16	0.16	0.19
6/12/13 7:00 AM	0.18	0.18	0.17
6/12/13 9:00 AM	0.20	0.20	0.17
6/12/13 11:00 AM	0.20	0.20	0.17
6/12/13 1:00 PM	0.20	0.20	0.17
6/12/13 3:00 PM	0.18	0.18	0.18
6/12/13 5:00 PM	0.20	0.20	0.19
6/12/13 7:00 PM	0.21	0.21	0.17
6/12/13 9:00 PM	0.18	0.18	0.18
6/12/13 11:00 PM	0.14	0.14	0.18
6/13/13 1:00 AM	0.17	0.17	0.18
6/13/13 3:00 AM	0.19	0.19	0.19
6/13/13 5:00 AM	0.20	0.20	0.18
6/13/13 7:00 AM	0.22	0.22	0.19
6/13/13 9:00 AM	0.21	0.21	0.20
6/13/13 11:00 AM	0.20	0.20	0.20
6/13/13 1:00 PM	0.21	0.21	0.22
6/13/13 3:00 PM	0.21	0.21	0.22
6/13/13 5:00 PM	0.21	0.21	0.22
6/13/13 7:00 PM	0.21	0.21	0.22
6/13/13 9:00 PM	0.22	0.22	0.22
6/13/13 11:00 PM	0.21	0.21	0.22
6/14/13 1:00 AM	0.21	0.21	0.21
6/14/13 3:00 AM	0.21	0.21	0.21
6/14/13 5:00 AM	0.21	0.21	0.21
6/14/13 7:00 AM	0.20	0.20	0.16

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
6/14/13 9:00 AM	0.20	0.20	0.17
6/14/13 11:00 AM	0.20	0.20	0.15
6/14/13 1:00 PM	0.20	0.20	0.13
6/14/13 3:00 PM	0.20	0.20	0.07
6/14/13 5:00 PM	0.20	0.20	0.05
6/14/13 7:00 PM	0.20	0.20	0.01
6/14/13 9:00 PM	0.20	0.20	0.02
6/14/13 11:00 PM	0.20	0.20	0.00
6/15/13 1:00 AM	0.20	0.20	0.00
6/15/13 3:00 AM	0.19	0.19	0.00
6/15/13 5:00 AM	0.18	0.18	0.00
6/15/13 7:00 AM	0.18	0.18	0.00
6/15/13 9:00 AM	0.18	0.18	0.00
6/15/13 11:00 AM	0.18	0.18	0.00
6/15/13 1:00 PM	0.18	0.18	0.00
6/15/13 3:00 PM	0.18	0.18	0.00
6/15/13 5:00 PM	0.18	0.18	0.00
6/15/13 7:00 PM	0.16	0.16	0.00
6/15/13 9:00 PM	0.17	0.17	0.00
6/15/13 11:00 PM	0.17	0.17	0.00
6/16/13 1:00 AM	0.16	0.16	0.00
6/16/13 3:00 AM	0.16	0.16	0.00
6/16/13 5:00 AM	0.16	0.16	0.00
6/16/13 7:00 AM	0.16	0.16	0.00
6/16/13 9:00 AM	0.17	0.17	0.00
6/16/13 11:00 AM	0.17	0.17	0.00
6/16/13 1:00 PM	0.16	0.16	0.00
6/16/13 3:00 PM	0.16	0.16	0.00
6/16/13 5:00 PM	0.13	0.13	0.00
6/16/13 7:00 PM	0.09	0.09	0.00
6/16/13 9:00 PM	0.10	0.10	0.00
6/16/13 11:00 PM	0.00	0.08	0.00
6/17/13 1:00 AM	0.00	0.08	0.00
6/17/13 3:00 AM	0.00	0.08	0.00
6/17/13 5:00 AM	0.00	0.10	0.00
6/17/13 7:00 AM	0.00	0.13	0.00
6/17/13 9:00 AM	0.00	0.07	0.00
6/17/13 11:00 AM	0.00	0.07	0.00
6/17/13 1:00 PM	0.00	0.08	0.00
6/17/13 3:00 PM	0.00	0.08	0.00
6/17/13 5:00 PM	0.00	0.08	0.00
6/17/13 7:00 PM	0.00	0.07	0.00
6/17/13 9:00 PM	0.00	0.07	0.00
6/17/13 11:00 PM	0.00	0.07	0.00
6/18/13 1:00 AM	0.00	0.07	0.00
6/18/13 3:00 AM	0.00	0.07	0.03
6/18/13 5:00 AM	0.00	0.07	0.07
6/18/13 7:00 AM	0.00	0.08	0.17
6/18/13 9:00 AM	0.00	0.07	0.21
6/18/13 11:00 AM	0.00	0.08	0.22
6/18/13 1:00 PM	0.00	0.07	0.22
6/18/13 3:00 PM	0.00	0.07	0.22
6/18/13 5:00 PM	0.00	0.06	0.21

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
6/18/13 7:00 PM	0.00	0.07	0.22
6/18/13 9:00 PM	0.00	0.08	0.22
6/18/13 11:00 PM	0.00	0.06	0.22
6/19/13 1:00 AM	0.00	0.05	0.23
6/19/13 3:00 AM	0.00	0.05	0.22
6/19/13 5:00 AM	0.00	0.07	0.21
6/19/13 7:00 AM	0.00	0.07	0.22
6/19/13 9:00 AM	0.00	0.08	0.26
6/19/13 11:00 AM	0.00	0.08	0.27
6/19/13 1:00 PM	0.00	0.08	0.27
6/19/13 3:00 PM	0.00	0.08	0.23
6/19/13 5:00 PM	0.00	0.08	0.22
6/19/13 7:00 PM	0.00	0.07	0.22
6/19/13 9:00 PM	0.00	0.07	0.20
6/19/13 11:00 PM	0.00	0.07	0.19
6/20/13 1:00 AM	0.00	0.06	0.19
6/20/13 3:00 AM	0.00	0.06	0.19
6/20/13 5:00 AM	0.00	0.07	0.20
6/20/13 7:00 AM	0.00	0.08	0.21
6/20/13 9:00 AM	0.00	0.08	0.21
6/20/13 11:00 AM	0.00	0.07	0.21
6/20/13 1:00 PM	0.00	0.07	0.22
6/20/13 3:00 PM	0.00	0.08	0.23
6/20/13 5:00 PM	0.00	0.07	0.24
6/20/13 7:00 PM	0.00	0.07	0.21
6/20/13 9:00 PM	0.00	0.07	0.22
6/20/13 11:00 PM	0.00	0.07	0.23
6/21/13 1:00 AM	0.10	0.10	0.24
6/21/13 3:00 AM	0.13	0.13	0.19
6/21/13 5:00 AM	0.09	0.09	0.18
6/21/13 7:00 AM	0.00	0.09	0.19
6/21/13 9:00 AM	0.00	0.10	0.17
6/21/13 11:00 AM	0.00	0.11	0.17
6/21/13 1:00 PM	0.13	0.13	0.17
6/21/13 3:00 PM	0.13	0.13	0.17
6/21/13 5:00 PM	0.12	0.12	0.17
6/21/13 7:00 PM	0.11	0.11	0.17
6/21/13 9:00 PM	0.15	0.15	0.18
6/21/13 11:00 PM	0.16	0.16	0.18
6/22/13 1:00 AM	0.16	0.16	0.17
6/22/13 3:00 AM	0.15	0.15	0.13
6/22/13 5:00 AM	0.18	0.18	0.14
6/22/13 7:00 AM	0.20	0.20	0.20
6/22/13 9:00 AM	0.24	0.24	0.20
6/22/13 11:00 AM	0.25	0.25	0.19
6/22/13 1:00 PM	0.24	0.24	0.19
6/22/13 3:00 PM	0.23	0.23	0.19
6/22/13 5:00 PM	0.18	0.18	0.19
6/22/13 7:00 PM	0.16	0.16	0.19
6/22/13 9:00 PM	0.18	0.18	0.19
6/22/13 11:00 PM	0.17	0.17	0.18
6/23/13 1:00 AM	0.18	0.18	0.19
6/23/13 3:00 AM	0.18	0.18	0.20

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
6/23/13 5:00 AM	0.19	0.19	0.21
6/23/13 7:00 AM	0.20	0.20	0.21
6/23/13 9:00 AM	0.21	0.21	0.22
6/23/13 11:00 AM	0.21	0.21	0.22
6/23/13 1:00 PM	0.22	0.22	0.21
6/23/13 3:00 PM	0.21	0.21	0.22
6/23/13 5:00 PM	0.20	0.20	0.22
6/23/13 7:00 PM	0.19	0.19	0.22
6/23/13 9:00 PM	0.18	0.18	0.21
6/23/13 11:00 PM	0.19	0.19	0.21
6/24/13 1:00 AM	0.16	0.16	0.21
6/24/13 3:00 AM	0.15	0.15	0.21
6/24/13 5:00 AM	0.17	0.17	0.21
6/24/13 7:00 AM	0.18	0.18	0.20
6/24/13 9:00 AM	0.17	0.17	0.20
6/24/13 11:00 AM	0.17	0.17	0.21
6/24/13 1:00 PM	0.16	0.16	0.21
6/24/13 3:00 PM	0.17	0.17	0.20
6/24/13 5:00 PM	0.18	0.18	0.20
6/24/13 7:00 PM	0.19	0.19	0.22
6/24/13 9:00 PM	0.21	0.21	0.21
6/24/13 11:00 PM	0.20	0.20	0.21
6/25/13 1:00 AM	0.21	0.21	0.21
6/25/13 3:00 AM	0.19	0.19	0.22
6/25/13 5:00 AM	0.17	0.17	0.21
6/25/13 7:00 AM	0.19	0.19	0.21
6/25/13 9:00 AM	0.20	0.20	0.21
6/25/13 11:00 AM	0.20	0.20	0.09
6/25/13 1:00 PM	0.21	0.21	0.08
6/25/13 3:00 PM	0.19	0.19	0.07
6/25/13 5:00 PM	0.20	0.20	0.08
6/25/13 7:00 PM	0.21	0.21	0.13
6/25/13 9:00 PM	0.22	0.22	0.20
6/25/13 11:00 PM	0.20	0.20	0.21
6/26/13 1:00 AM	0.19	0.19	0.21
6/26/13 3:00 AM	0.16	0.16	0.20
6/26/13 5:00 AM	0.19	0.19	0.21
6/26/13 7:00 AM	0.18	0.18	0.22
6/26/13 9:00 AM	0.18	0.18	0.25
6/26/13 11:00 AM	0.18	0.18	0.25
6/26/13 1:00 PM	0.19	0.19	0.22
6/26/13 3:00 PM	0.18	0.18	0.23
6/26/13 5:00 PM	0.19	0.19	0.21
6/26/13 7:00 PM	0.18	0.18	0.05
6/26/13 9:00 PM	0.19	0.19	0.05
6/26/13 11:00 PM	0.17	0.17	0.07
6/27/13 1:00 AM	0.16	0.16	0.05
6/27/13 3:00 AM	0.16	0.16	0.05
6/27/13 5:00 AM	0.17	0.17	0.06
6/27/13 7:00 AM	0.16	0.16	0.14
6/27/13 9:00 AM	0.18	0.18	0.23
6/27/13 11:00 AM	0.18	0.18	0.25
6/27/13 1:00 PM	0.19	0.19	0.25

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
6/27/13 3:00 PM	0.19	0.19	0.25
6/27/13 5:00 PM	0.16	0.16	0.24
6/27/13 7:00 PM	0.23	0.23	0.25
6/27/13 9:00 PM	0.29	0.29	0.16
6/27/13 11:00 PM	0.24	0.24	0.05
6/28/13 1:00 AM	0.24	0.24	0.04
6/28/13 3:00 AM	0.24	0.24	0.04
6/28/13 5:00 AM	0.22	0.22	0.07
6/28/13 7:00 AM	0.21	0.21	0.09
6/28/13 9:00 AM	0.22	0.22	0.07
6/28/13 11:00 AM	0.22	0.22	0.07
6/28/13 1:00 PM	0.22	0.22	0.08
6/28/13 3:00 PM	0.22	0.22	0.25
6/28/13 5:00 PM	0.22	0.22	0.28
6/28/13 7:00 PM	0.23	0.23	0.27
6/28/13 9:00 PM	0.23	0.23	0.17
6/28/13 11:00 PM	0.31	0.31	0.14
6/29/13 1:00 AM	0.26	0.26	0.11
6/29/13 3:00 AM	0.24	0.24	0.12
6/29/13 5:00 AM	0.25	0.25	0.16
6/29/13 7:00 AM	0.23	0.23	0.26
6/29/13 9:00 AM	0.24	0.24	0.25
6/29/13 11:00 AM	0.27	0.27	0.24
6/29/13 1:00 PM	0.23	0.23	0.24
6/29/13 3:00 PM	0.31	0.31	0.24
6/29/13 5:00 PM	0.24	0.24	0.20
6/29/13 7:00 PM	0.20	0.20	0.21
6/29/13 9:00 PM	0.21	0.21	0.21
6/29/13 11:00 PM	0.25	0.25	0.09
6/30/13 1:00 AM	0.23	0.23	0.06
6/30/13 3:00 AM	0.24	0.24	0.06
6/30/13 5:00 AM	0.25	0.25	0.06
6/30/13 7:00 AM	0.21	0.21	0.06
6/30/13 9:00 AM	0.28	0.28	0.10
6/30/13 11:00 AM	0.24	0.24	0.19
6/30/13 1:00 PM	0.21	0.21	0.19
6/30/13 3:00 PM	0.22	0.22	0.19
6/30/13 5:00 PM	0.26	0.26	0.19
6/30/13 7:00 PM	0.23	0.23	0.19
6/30/13 9:00 PM	0.27	0.27	0.19
6/30/13 11:00 PM	0.20	0.20	0.19
7/1/13 1:00 AM	0.18	0.18	0.09
7/1/13 3:00 AM	0.20	0.20	0.08
7/1/13 5:00 AM	0.20	0.20	0.12
7/1/13 7:00 AM	0.23	0.23	0.20
7/1/13 9:00 AM	0.22	0.22	0.20
7/1/13 11:00 AM	0.19	0.19	0.20
7/1/13 1:00 PM	0.19	0.19	0.23
7/1/13 3:00 PM	0.17	0.17	0.25
7/1/13 5:00 PM	0.19	0.19	0.26
7/1/13 7:00 PM	0.18	0.18	0.25
7/1/13 9:00 PM	0.19	0.19	0.23
7/1/13 11:00 PM	0.18	0.18	0.17

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
7/2/13 1:00 AM	0.19	0.19	0.10
7/2/13 3:00 AM	0.19	0.19	0.08
7/2/13 5:00 AM	0.22	0.22	0.08
7/2/13 7:00 AM	0.23	0.23	0.11
7/2/13 9:00 AM	0.21	0.21	0.22
7/2/13 11:00 AM	0.22	0.22	0.26
7/2/13 1:00 PM	0.22	0.22	0.26
7/2/13 3:00 PM	0.20	0.20	0.26
7/2/13 5:00 PM	0.19	0.19	0.24
7/2/13 7:00 PM	0.21	0.21	0.25
7/2/13 9:00 PM	0.21	0.21	0.24
7/2/13 11:00 PM	0.21	0.21	0.24
7/3/13 1:00 AM	0.19	0.19	0.14
7/3/13 3:00 AM	0.16	0.16	0.12
7/3/13 5:00 AM	0.19	0.19	0.15
7/3/13 7:00 AM	0.22	0.22	0.22
7/3/13 9:00 AM	0.23	0.23	0.21
7/3/13 11:00 AM	0.22	0.22	0.21
7/3/13 1:00 PM	0.20	0.20	0.22
7/3/13 3:00 PM	0.19	0.19	0.21
7/3/13 5:00 PM	0.21	0.21	0.20
7/3/13 7:00 PM	0.20	0.20	0.20
7/3/13 9:00 PM	0.21	0.21	0.20
7/3/13 11:00 PM	0.18	0.18	0.20
7/4/13 1:00 AM	0.16	0.16	0.17
7/4/13 3:00 AM	0.16	0.16	0.08
7/4/13 5:00 AM	0.16	0.16	0.08
7/4/13 7:00 AM	0.19	0.19	0.09
7/4/13 9:00 AM	0.23	0.23	0.18
7/4/13 11:00 AM	0.20	0.20	0.17
7/4/13 1:00 PM	0.21	0.21	0.20
7/4/13 3:00 PM	0.21	0.21	0.20
7/4/13 5:00 PM	0.21	0.21	0.18
7/4/13 7:00 PM	0.21	0.21	0.19
7/4/13 9:00 PM	0.22	0.22	0.18
7/4/13 11:00 PM	0.21	0.21	0.13
7/5/13 1:00 AM	0.18	0.18	0.08
7/5/13 3:00 AM	0.17	0.17	0.08
7/5/13 5:00 AM	0.20	0.20	0.08
7/5/13 7:00 AM	0.25	0.25	0.09
7/5/13 9:00 AM	0.19	0.19	0.20
7/5/13 11:00 AM	0.19	0.19	0.21
7/5/13 1:00 PM	0.19	0.19	0.20
7/5/13 3:00 PM	0.17	0.17	0.18
7/5/13 5:00 PM	0.17	0.17	0.19
7/5/13 7:00 PM	0.18	0.18	0.20
7/5/13 9:00 PM	0.19	0.19	0.19
7/5/13 11:00 PM	0.17	0.17	0.13
7/6/13 1:00 AM	0.15	0.15	0.10
7/6/13 3:00 AM	0.15	0.15	0.07
7/6/13 5:00 AM	0.15	0.15	0.07
7/6/13 7:00 AM	0.20	0.20	0.12
7/6/13 9:00 AM	0.22	0.22	0.20

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
7/6/13 11:00 AM	0.20	0.20	0.19
7/6/13 1:00 PM	0.21	0.21	0.19
7/6/13 3:00 PM	0.21	0.21	0.19
7/6/13 5:00 PM	0.20	0.20	0.18
7/6/13 7:00 PM	0.19	0.19	0.20
7/6/13 9:00 PM	0.18	0.18	0.19
7/6/13 11:00 PM	0.17	0.17	0.19
7/7/13 1:00 AM	0.20	0.20	0.10
7/7/13 3:00 AM	0.20	0.20	0.09
7/7/13 5:00 AM	0.20	0.20	0.09
7/7/13 7:00 AM	0.20	0.20	0.12
7/7/13 9:00 AM	0.18	0.18	0.20
7/7/13 11:00 AM	0.17	0.17	0.21
7/7/13 1:00 PM	0.17	0.17	0.20
7/7/13 3:00 PM	0.18	0.18	0.20
7/7/13 5:00 PM	0.17	0.17	0.20
7/7/13 7:00 PM	0.17	0.17	0.20
7/7/13 9:00 PM	0.17	0.17	0.20
7/7/13 11:00 PM	0.17	0.17	0.20
7/8/13 1:00 AM	0.17	0.17	0.20
7/8/13 3:00 AM	0.17	0.17	0.20
7/8/13 5:00 AM	0.17	0.17	0.21
7/8/13 7:00 AM	0.18	0.18	0.21
7/8/13 9:00 AM	0.19	0.19	0.22
7/8/13 11:00 AM	0.19	0.19	0.24
7/8/13 1:00 PM	0.21	0.21	0.22
7/8/13 3:00 PM	0.22	0.22	0.23
7/8/13 5:00 PM	0.21	0.21	0.25
7/8/13 7:00 PM	0.21	0.21	0.25
7/8/13 9:00 PM	0.20	0.20	0.23
7/8/13 11:00 PM	0.21	0.21	0.23
7/9/13 1:00 AM	0.23	0.23	0.23
7/9/13 3:00 AM	0.23	0.23	0.24
7/9/13 5:00 AM	0.23	0.23	0.24
7/9/13 7:00 AM	0.19	0.19	0.24
7/9/13 9:00 AM	0.24	0.24	0.23
7/9/13 11:00 AM	0.22	0.22	0.21
7/9/13 1:00 PM	0.20	0.20	0.22
7/9/13 3:00 PM	0.20	0.20	0.22
7/9/13 5:00 PM	0.21	0.21	0.23
7/9/13 7:00 PM	0.19	0.19	0.23
7/9/13 9:00 PM	0.21	0.21	0.22
7/9/13 11:00 PM	0.22	0.22	0.22
7/10/13 1:00 AM	0.22	0.22	0.21
7/10/13 3:00 AM	0.20	0.20	0.10
7/10/13 5:00 AM	0.21	0.21	0.10
7/10/13 7:00 AM	0.17	0.17	0.21
7/10/13 9:00 AM	0.19	0.19	0.22
7/10/13 11:00 AM	0.19	0.19	0.22
7/10/13 1:00 PM	0.20	0.20	0.22
7/10/13 3:00 PM	0.19	0.19	0.22
7/10/13 5:00 PM	0.18	0.18	0.22
7/10/13 7:00 PM	0.18	0.18	0.21

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
7/10/13 9:00 PM	0.18	0.18	0.23
7/10/13 11:00 PM	0.18	0.18	0.22
7/11/13 1:00 AM	0.17	0.17	0.20
7/11/13 3:00 AM	0.17	0.17	0.13
7/11/13 5:00 AM	0.17	0.17	0.14
7/11/13 7:00 AM	0.15	0.15	0.23
7/11/13 9:00 AM	0.18	0.18	0.23
7/11/13 11:00 AM	0.18	0.18	0.23
7/11/13 1:00 PM	0.17	0.17	0.23
7/11/13 3:00 PM	0.18	0.18	0.23
7/11/13 5:00 PM	0.18	0.18	0.22
7/11/13 7:00 PM	0.18	0.18	0.23
7/11/13 9:00 PM	0.20	0.20	0.10
7/11/13 11:00 PM	0.21	0.21	0.06
7/12/13 1:00 AM	0.22	0.22	0.06
7/12/13 3:00 AM	0.21	0.21	0.04
7/12/13 5:00 AM	0.22	0.22	0.05
7/12/13 7:00 AM	0.20	0.20	0.09
7/12/13 9:00 AM	0.20	0.20	0.22
7/12/13 11:00 AM	0.19	0.19	0.23
7/12/13 1:00 PM	0.20	0.20	0.23
7/12/13 3:00 PM	0.19	0.19	0.25
7/12/13 5:00 PM	0.19	0.19	0.25
7/12/13 7:00 PM	0.18	0.18	0.24
7/12/13 9:00 PM	0.18	0.18	0.14
7/12/13 11:00 PM	0.18	0.18	0.04
7/13/13 1:00 AM	0.18	0.18	0.04
7/13/13 3:00 AM	0.17	0.17	0.04
7/13/13 5:00 AM	0.18	0.18	0.04
7/13/13 7:00 AM	0.19	0.19	0.05
7/13/13 9:00 AM	0.19	0.19	0.05
7/13/13 11:00 AM	0.20	0.20	0.05
7/13/13 1:00 PM	0.18	0.18	0.04
7/13/13 3:00 PM	0.19	0.19	0.05
7/13/13 5:00 PM	0.20	0.20	0.05
7/13/13 7:00 PM	0.21	0.21	0.05
7/13/13 9:00 PM	0.21	0.21	0.05
7/13/13 11:00 PM	0.21	0.21	0.04
7/14/13 1:00 AM	0.20	0.20	0.05
7/14/13 3:00 AM	0.21	0.21	0.05
7/14/13 5:00 AM	0.19	0.19	0.04
7/14/13 7:00 AM	0.20	0.20	0.05
7/14/13 9:00 AM	0.21	0.21	0.05
7/14/13 11:00 AM	0.22	0.22	0.05
7/14/13 1:00 PM	0.21	0.21	0.05
7/14/13 3:00 PM	0.21	0.21	0.04
7/14/13 5:00 PM	0.20	0.20	0.04
7/14/13 7:00 PM	0.21	0.21	0.04
7/14/13 9:00 PM	0.22	0.22	0.04
7/14/13 11:00 PM	0.22	0.22	0.04
7/15/13 1:00 AM	0.22	0.22	0.04
7/15/13 3:00 AM	0.23	0.23	0.03
7/15/13 5:00 AM	0.23	0.23	0.03

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
7/15/13 7:00 AM	0.23	0.23	0.05
7/15/13 9:00 AM	0.22	0.22	0.05
7/15/13 11:00 AM	0.20	0.20	0.05
7/15/13 1:00 PM	0.20	0.20	0.05
7/15/13 3:00 PM	0.21	0.21	0.05
7/15/13 5:00 PM	0.22	0.22	0.04
7/15/13 7:00 PM	0.20	0.20	0.04
7/15/13 9:00 PM	0.21	0.21	0.04
7/15/13 11:00 PM	0.19	0.19	0.04
7/16/13 1:00 AM	0.17	0.17	0.04
7/16/13 3:00 AM	0.17	0.17	0.04
7/16/13 5:00 AM	0.19	0.19	0.04
7/16/13 7:00 AM	0.20	0.20	0.05
7/16/13 9:00 AM	0.21	0.21	0.04
7/16/13 11:00 AM	0.21	0.21	0.04
7/16/13 1:00 PM	0.20	0.20	0.04
7/16/13 3:00 PM	0.18	0.18	0.04
7/16/13 5:00 PM	0.18	0.18	0.04
7/16/13 7:00 PM	0.19	0.19	0.04
7/16/13 9:00 PM	0.19	0.19	0.04
7/16/13 11:00 PM	0.17	0.17	0.04
7/17/13 1:00 AM	0.11	0.11	0.04
7/17/13 3:00 AM	0.12	0.12	0.04
7/17/13 5:00 AM	0.18	0.18	0.04
7/17/13 7:00 AM	0.20	0.20	0.04
7/17/13 9:00 AM	0.20	0.20	0.04
7/17/13 11:00 AM	0.21	0.21	0.04
7/17/13 1:00 PM	0.20	0.20	0.04
7/17/13 3:00 PM	0.19	0.19	0.04
7/17/13 5:00 PM	0.19	0.19	0.05
7/17/13 7:00 PM	0.19	0.19	0.05
7/17/13 9:00 PM	0.20	0.20	0.06
7/17/13 11:00 PM	0.19	0.19	0.06
7/18/13 1:00 AM	0.16	0.16	0.06
7/18/13 3:00 AM	0.16	0.16	0.06
7/18/13 5:00 AM	0.20	0.20	0.06
7/18/13 7:00 AM	0.22	0.22	0.07
7/18/13 9:00 AM	0.21	0.21	0.07
7/18/13 11:00 AM	0.20	0.20	0.08
7/18/13 1:00 PM	0.19	0.19	0.09
7/18/13 3:00 PM	0.19	0.19	0.09
7/18/13 5:00 PM	0.20	0.20	0.10
7/18/13 7:00 PM	0.20	0.20	0.12
7/18/13 9:00 PM	0.17	0.17	0.12
7/18/13 11:00 PM	0.15	0.15	0.12
7/19/13 1:00 AM	0.09	0.09	0.11
7/19/13 3:00 AM	0.12	0.12	0.10
7/19/13 5:00 AM	0.08	0.08	0.09
7/19/13 7:00 AM	0.16	0.16	0.08
7/19/13 9:00 AM	0.20	0.20	0.08
7/19/13 11:00 AM	0.21	0.21	0.07
7/19/13 1:00 PM	0.20	0.20	0.07
7/19/13 3:00 PM	0.22	0.22	0.07

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
7/19/13 5:00 PM	0.22	0.22	0.07
7/19/13 7:00 PM	0.23	0.23	0.09
7/19/13 9:00 PM	0.23	0.23	0.06
7/19/13 11:00 PM	0.22	0.22	0.06
7/20/13 1:00 AM	0.19	0.19	0.05
7/20/13 3:00 AM	0.19	0.19	0.04
7/20/13 5:00 AM	0.20	0.20	0.04
7/20/13 7:00 AM	0.20	0.20	0.08
7/20/13 9:00 AM	0.22	0.22	0.26
7/20/13 11:00 AM	0.22	0.22	0.21
7/20/13 1:00 PM	0.22	0.22	0.20
7/20/13 3:00 PM	0.23	0.23	0.20
7/20/13 5:00 PM	0.22	0.22	0.18
7/20/13 7:00 PM	0.22	0.22	0.18
7/20/13 9:00 PM	0.22	0.22	0.17
7/20/13 11:00 PM	0.21	0.21	0.16
7/21/13 1:00 AM	0.17	0.17	0.08
7/21/13 3:00 AM	0.17	0.17	0.06
7/21/13 5:00 AM	0.19	0.19	0.06
7/21/13 7:00 AM	0.20	0.20	0.06
7/21/13 9:00 AM	0.23	0.23	0.13
7/21/13 11:00 AM	0.22	0.22	0.17
7/21/13 1:00 PM	0.22	0.22	0.16
7/21/13 3:00 PM	0.21	0.21	0.16
7/21/13 5:00 PM	0.20	0.20	0.15
7/21/13 7:00 PM	0.20	0.20	0.15
7/21/13 9:00 PM	0.20	0.20	0.15
7/21/13 11:00 PM	0.15	0.15	0.15
7/22/13 1:00 AM	0.14	0.14	0.14
7/22/13 3:00 AM	0.14	0.14	0.14
7/22/13 5:00 AM	0.17	0.17	0.14
7/22/13 7:00 AM	0.20	0.20	0.14
7/22/13 9:00 AM	0.21	0.21	0.14
7/22/13 11:00 AM	0.20	0.20	0.13
7/22/13 1:00 PM	0.20	0.20	0.14
7/22/13 3:00 PM	0.19	0.19	0.14
7/22/13 5:00 PM	0.18	0.18	0.14
7/22/13 7:00 PM	0.19	0.19	0.14
7/22/13 9:00 PM	0.18	0.18	0.15
7/22/13 11:00 PM	0.16	0.16	0.14
7/23/13 1:00 AM	0.13	0.13	0.15
7/23/13 3:00 AM	0.10	0.10	0.15
7/23/13 5:00 AM	0.12	0.12	0.14
7/23/13 7:00 AM	0.15	0.15	0.15
7/23/13 9:00 AM	0.15	0.15	0.15
7/23/13 11:00 AM	0.14	0.14	0.15
7/23/13 1:00 PM	0.00	0.08	0.15
7/23/13 3:00 PM	0.00	0.07	0.14
7/23/13 5:00 PM	0.00	0.06	0.13
7/23/13 7:00 PM	0.00	0.08	0.14
7/23/13 9:00 PM	0.00	0.08	0.14
7/23/13 11:00 PM	0.00	0.09	0.13
7/24/13 1:00 AM	0.08	0.08	0.13

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
7/24/13 3:00 AM	0.08	0.08	0.13
7/24/13 5:00 AM	0.07	0.07	0.13
7/24/13 7:00 AM	0.00	0.08	0.12
7/24/13 9:00 AM	0.08	0.08	0.13
7/24/13 11:00 AM	0.08	0.08	0.13
7/24/13 1:00 PM	0.11	0.11	0.13
7/24/13 3:00 PM	0.14	0.14	0.13
7/24/13 5:00 PM	0.16	0.16	0.14
7/24/13 7:00 PM	0.16	0.16	0.14
7/24/13 9:00 PM	0.15	0.15	0.14
7/24/13 11:00 PM	0.12	0.12	0.15
7/25/13 1:00 AM	0.16	0.16	0.15
7/25/13 3:00 AM	0.16	0.16	0.15
7/25/13 5:00 AM	0.15	0.15	0.15
7/25/13 7:00 AM	0.15	0.15	0.15
7/25/13 9:00 AM	0.15	0.15	0.15
7/25/13 11:00 AM	0.15	0.15	0.13
7/25/13 1:00 PM	0.15	0.15	0.11
7/25/13 3:00 PM	0.14	0.14	0.13
7/25/13 5:00 PM	0.15	0.15	0.15
7/25/13 7:00 PM	0.15	0.15	0.15
7/25/13 9:00 PM	0.14	0.14	0.15
7/25/13 11:00 PM	0.14	0.14	0.14
7/26/13 1:00 AM	0.12	0.12	0.15
7/26/13 3:00 AM	0.15	0.15	0.09
7/26/13 5:00 AM	0.14	0.14	0.05
7/26/13 7:00 AM	0.14	0.14	0.03
7/26/13 9:00 AM	0.15	0.15	0.06
7/26/13 11:00 AM	0.14	0.14	0.12
7/26/13 1:00 PM	0.14	0.14	0.16
7/26/13 3:00 PM	0.14	0.14	0.16
7/26/13 5:00 PM	0.14	0.14	0.09
7/26/13 7:00 PM	0.14	0.14	0.04
7/26/13 9:00 PM	0.14	0.14	0.06
7/26/13 11:00 PM	0.14	0.14	0.12
7/27/13 1:00 AM	0.14	0.14	0.14
7/27/13 3:00 AM	0.14	0.14	0.13
7/27/13 5:00 AM	0.14	0.14	0.14
7/27/13 7:00 AM	0.14	0.14	0.15
7/27/13 9:00 AM	0.14	0.14	0.15
7/27/13 11:00 AM	0.14	0.14	0.15
7/27/13 1:00 PM	0.14	0.14	0.14
7/27/13 3:00 PM	0.14	0.14	0.15
7/27/13 5:00 PM	0.14	0.14	0.14
7/27/13 7:00 PM	0.14	0.14	0.14
7/27/13 9:00 PM	0.13	0.13	0.13
7/27/13 11:00 PM	0.11	0.11	0.13
7/28/13 1:00 AM	0.12	0.12	0.13
7/28/13 3:00 AM	0.12	0.12	0.13
7/28/13 5:00 AM	0.12	0.12	0.13
7/28/13 7:00 AM	0.13	0.13	0.09
7/28/13 9:00 AM	0.13	0.13	0.14
7/28/13 11:00 AM	0.14	0.14	0.14

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
7/28/13 1:00 PM	0.15	0.15	0.14
7/28/13 3:00 PM	0.16	0.16	0.13
7/28/13 5:00 PM	0.15	0.15	0.14
7/28/13 7:00 PM	0.15	0.15	0.12
7/28/13 9:00 PM	0.16	0.16	0.10
7/28/13 11:00 PM	0.15	0.15	0.04
7/29/13 1:00 AM	0.12	0.12	0.04
7/29/13 3:00 AM	0.12	0.12	0.04
7/29/13 5:00 AM	0.14	0.14	0.04
7/29/13 7:00 AM	0.16	0.16	0.05
7/29/13 9:00 AM	0.16	0.16	0.15
7/29/13 11:00 AM	0.16	0.16	0.17
7/29/13 1:00 PM	0.16	0.16	0.16
7/29/13 3:00 PM	0.16	0.16	0.16
7/29/13 5:00 PM	0.16	0.16	0.15
7/29/13 7:00 PM	0.17	0.17	0.15
7/29/13 9:00 PM	0.17	0.17	0.14
7/29/13 11:00 PM	0.17	0.17	0.16
7/30/13 1:00 AM	0.14	0.14	0.21
7/30/13 3:00 AM	0.14	0.14	0.14
7/30/13 5:00 AM	0.16	0.16	0.12
7/30/13 7:00 AM	0.17	0.17	0.14
7/30/13 9:00 AM	0.17	0.17	0.15
7/30/13 11:00 AM	0.18	0.18	0.14
7/30/13 1:00 PM	0.18	0.18	0.15
7/30/13 3:00 PM	0.19	0.19	0.16
7/30/13 5:00 PM	0.18	0.18	0.16
7/30/13 7:00 PM	0.18	0.18	0.16
7/30/13 9:00 PM	0.18	0.18	0.16
7/30/13 11:00 PM	0.18	0.18	0.16
7/31/13 1:00 AM	0.15	0.15	0.17
7/31/13 3:00 AM	0.13	0.13	0.17
7/31/13 5:00 AM	0.14	0.14	0.16
7/31/13 7:00 AM	0.16	0.16	0.21
7/31/13 9:00 AM	0.16	0.16	0.17
7/31/13 11:00 AM	0.17	0.17	0.18
7/31/13 1:00 PM	0.19	0.19	0.18
7/31/13 3:00 PM	0.20	0.20	0.21
7/31/13 5:00 PM	0.20	0.20	0.21
7/31/13 7:00 PM	0.16	0.16	0.22
7/31/13 9:00 PM	0.15	0.15	0.23
7/31/13 11:00 PM	0.15	0.15	0.24
8/1/13 1:00 AM	0.16	0.16	0.23
8/1/13 3:00 AM	0.16	0.16	0.22
8/1/13 5:00 AM	0.17	0.17	0.23
8/1/13 7:00 AM	0.19	0.19	0.24
8/1/13 9:00 AM	0.20	0.20	0.23
8/1/13 11:00 AM	0.20	0.20	0.25
8/1/13 1:00 PM	0.21	0.21	0.27
8/1/13 3:00 PM	0.20	0.20	0.26
8/1/13 5:00 PM	0.20	0.20	0.23
8/1/13 7:00 PM	0.20	0.20	0.15
8/1/13 9:00 PM	0.21	0.21	0.15

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
8/1/13 11:00 PM	0.22	0.22	0.06
8/2/13 1:00 AM	0.19	0.19	0.05
8/2/13 3:00 AM	0.19	0.19	0.05
8/2/13 5:00 AM	0.19	0.19	0.05
8/2/13 7:00 AM	0.22	0.22	0.15
8/2/13 9:00 AM	0.23	0.23	0.23
8/2/13 11:00 AM	0.22	0.22	0.22
8/2/13 1:00 PM	0.22	0.22	0.22
8/2/13 3:00 PM	0.23	0.23	0.22
8/2/13 5:00 PM	0.24	0.24	0.22
8/2/13 7:00 PM	0.23	0.23	0.23
8/2/13 9:00 PM	0.23	0.23	0.22
8/2/13 11:00 PM	0.23	0.23	0.11
8/3/13 1:00 AM	0.24	0.24	0.09
8/3/13 3:00 AM	0.21	0.21	0.08
8/3/13 5:00 AM	0.20	0.20	0.08
8/3/13 7:00 AM	0.21	0.21	0.22
8/3/13 9:00 AM	0.18	0.18	0.21
8/3/13 11:00 AM	0.16	0.16	0.21
8/3/13 1:00 PM	0.18	0.18	0.20
8/3/13 3:00 PM	0.21	0.21	0.21
8/3/13 5:00 PM	0.21	0.21	0.21
8/3/13 7:00 PM	0.23	0.23	0.21
8/3/13 9:00 PM	0.24	0.24	0.17
8/3/13 11:00 PM	0.23	0.23	0.03
8/4/13 1:00 AM	0.23	0.23	0.03
8/4/13 3:00 AM	0.23	0.23	0.04
8/4/13 5:00 AM	0.21	0.21	0.04
8/4/13 7:00 AM	0.21	0.21	0.08
8/4/13 9:00 AM	0.23	0.23	0.25
8/4/13 11:00 AM	0.23	0.23	0.22
8/4/13 1:00 PM	0.22	0.22	0.13
8/4/13 3:00 PM	0.22	0.22	0.13
8/4/13 5:00 PM	0.24	0.24	0.17
8/4/13 7:00 PM	0.24	0.24	0.20
8/4/13 9:00 PM	0.24	0.24	0.18
8/4/13 11:00 PM	0.22	0.22	0.16
8/5/13 1:00 AM	0.21	0.21	0.07
8/5/13 3:00 AM	0.18	0.18	0.07
8/5/13 5:00 AM	0.19	0.19	0.11
8/5/13 7:00 AM	0.21	0.21	0.16
8/5/13 9:00 AM	0.22	0.22	0.16
8/5/13 11:00 AM	0.23	0.23	0.15
8/5/13 1:00 PM	0.21	0.21	0.16
8/5/13 3:00 PM	0.20	0.20	0.13
8/5/13 5:00 PM	0.20	0.20	0.11
8/5/13 7:00 PM	0.19	0.19	0.10
8/5/13 9:00 PM	0.18	0.18	0.10
8/5/13 11:00 PM	0.19	0.19	0.10
8/6/13 1:00 AM	0.14	0.14	0.11
8/6/13 3:00 AM	0.12	0.12	0.11
8/6/13 5:00 AM	0.15	0.00	0.13
8/6/13 7:00 AM	0.17	0.00	0.16

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
8/6/13 9:00 AM	0.16	0.00	0.17
8/6/13 11:00 AM	0.18	0.00	0.17
8/6/13 1:00 PM	0.18	0.00	0.18
8/6/13 3:00 PM	0.16	0.00	0.18
8/6/13 5:00 PM	0.16	0.00	0.19
8/6/13 7:00 PM	0.16	0.00	0.18
8/6/13 9:00 PM	0.17	0.00	0.19
8/6/13 11:00 PM	0.15	0.00	0.19
8/7/13 1:00 AM	0.13	0.00	0.20
8/7/13 3:00 AM	0.06	0.00	0.19
8/7/13 5:00 AM	0.09	0.00	0.20
8/7/13 7:00 AM	0.12	0.00	0.20
8/7/13 9:00 AM	0.12	0.00	0.21
8/7/13 11:00 AM	0.11	0.00	0.21
8/7/13 1:00 PM	0.11	0.00	0.21
8/7/13 3:00 PM	0.10	0.00	0.21
8/7/13 5:00 PM	0.10	0.00	0.22
8/7/13 7:00 PM	0.10	0.00	0.22
8/7/13 9:00 PM	0.11	0.00	0.21
8/7/13 11:00 PM	0.10	0.00	0.21
8/8/13 1:00 AM	0.10	0.00	0.22
8/8/13 3:00 AM	0.08	0.00	0.18
8/8/13 5:00 AM	0.09	0.00	0.22
8/8/13 7:00 AM	0.09	0.00	0.25
8/8/13 9:00 AM	0.10	0.00	0.23
8/8/13 11:00 AM	0.10	0.00	0.22
8/8/13 1:00 PM	0.10	0.00	0.22
8/8/13 3:00 PM	0.10	0.00	0.20
8/8/13 5:00 PM	0.10	0.00	0.19
8/8/13 7:00 PM	0.11	0.00	0.18
8/8/13 9:00 PM	0.11	0.00	0.18
8/8/13 11:00 PM	0.10	0.00	0.18
8/9/13 1:00 AM	0.10	0.00	0.18
8/9/13 3:00 AM	0.11	0.00	0.17
8/9/13 5:00 AM	0.11	0.00	0.17
8/9/13 7:00 AM	0.11	0.00	1.47
8/9/13 9:00 AM	0.11	0.00	0.21
8/9/13 11:00 AM	0.10	0.00	0.17
8/9/13 1:00 PM	0.10	0.00	0.19
8/9/13 3:00 PM	0.10	0.00	0.18
8/9/13 5:00 PM	0.09	0.00	0.18
8/9/13 7:00 PM	0.10	0.00	0.18
8/9/13 9:00 PM	0.11	0.00	0.18
8/9/13 11:00 PM	0.10	0.00	0.16
8/10/13 1:00 AM	0.10	0.00	0.07
8/10/13 3:00 AM	0.09	0.00	0.08
8/10/13 5:00 AM	0.08	0.00	0.08
8/10/13 7:00 AM	0.09	0.00	0.12
8/10/13 9:00 AM	0.11	0.00	0.20
8/10/13 11:00 AM	0.10	0.00	0.22
8/10/13 1:00 PM	0.11	0.00	0.20
8/10/13 3:00 PM	0.10	0.00	0.21
8/10/13 5:00 PM	0.10	0.00	0.20

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
8/10/13 7:00 PM	0.10	0.00	0.21
8/10/13 9:00 PM	0.10	0.00	0.21
8/10/13 11:00 PM	0.10	0.00	0.21
8/11/13 1:00 AM	0.10	0.00	0.21
8/11/13 3:00 AM	0.10	0.00	0.21
8/11/13 5:00 AM	0.09	0.00	0.22
8/11/13 7:00 AM	0.10	0.00	0.22
8/11/13 9:00 AM	0.10	0.00	0.23
8/11/13 11:00 AM	0.09	0.00	0.23
8/11/13 1:00 PM	0.09	0.00	0.23
8/11/13 3:00 PM	0.09	0.00	0.24
8/11/13 5:00 PM	0.09	0.00	0.24
8/11/13 7:00 PM	0.09	0.00	0.23
8/11/13 9:00 PM	0.09	0.00	0.24
8/11/13 11:00 PM	0.09	0.00	0.19
8/12/13 1:00 AM	0.08	0.00	0.11
8/12/13 3:00 AM	0.08	0.00	0.11
8/12/13 5:00 AM	0.09	0.00	0.23
8/12/13 7:00 AM	0.09	0.00	0.25
8/12/13 9:00 AM	0.09	0.00	0.24
8/12/13 11:00 AM	0.10	0.00	0.26
8/12/13 1:00 PM	0.11	0.00	0.27
8/12/13 3:00 PM	0.10	0.00	0.26
8/12/13 5:00 PM	0.10	0.00	0.26
8/12/13 7:00 PM	0.11	0.00	0.26
8/12/13 9:00 PM	0.11	0.00	0.25
8/12/13 11:00 PM	0.11	0.00	0.25
8/13/13 1:00 AM	0.11	0.00	0.24
8/13/13 3:00 AM	0.11	0.00	0.24
8/13/13 5:00 AM	0.11	0.00	0.24
8/13/13 7:00 AM	0.11	0.00	0.22
8/13/13 9:00 AM	0.12	0.00	0.22
8/13/13 11:00 AM	0.12	0.00	0.23
8/13/13 1:00 PM	0.11	0.00	0.23
8/13/13 3:00 PM	0.10	0.00	0.22
8/13/13 5:00 PM	0.09	0.00	0.23
8/13/13 7:00 PM	0.09	0.00	0.23
8/13/13 9:00 PM	0.08	0.00	0.22
8/13/13 11:00 PM	0.09	0.00	0.22
8/14/13 1:00 AM	0.09	0.00	0.21
8/14/13 3:00 AM	0.09	0.00	0.22
8/14/13 5:00 AM	0.09	0.00	0.22
8/14/13 7:00 AM	0.09	0.00	0.22
8/14/13 9:00 AM	0.08	0.00	0.21
8/14/13 11:00 AM	0.07	0.00	0.21
8/14/13 1:00 PM	0.08	0.00	0.20
8/14/13 3:00 PM	0.09	0.00	0.21
8/14/13 5:00 PM	0.10	0.00	0.20
8/14/13 7:00 PM	0.11	0.00	0.20
8/14/13 9:00 PM	0.12	0.00	0.20
8/14/13 11:00 PM	0.07	0.00	0.20
8/15/13 1:00 AM	0.06	0.00	0.19
8/15/13 3:00 AM	0.06	0.00	0.19

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
8/15/13 5:00 AM	0.06	0.00	0.18
8/15/13 7:00 AM	0.10	0.00	0.19
8/15/13 9:00 AM	0.10	0.00	0.19
8/15/13 11:00 AM	0.10	0.00	0.19
8/15/13 1:00 PM	0.12	0.00	0.19
8/15/13 3:00 PM	0.12	0.00	0.18
8/15/13 5:00 PM	0.12	0.00	0.18
8/15/13 7:00 PM	0.12	0.00	0.19
8/15/13 9:00 PM	0.12	0.00	0.19
8/15/13 11:00 PM	0.12	0.12	0.19
8/16/13 1:00 AM	0.11	0.11	0.19
8/16/13 3:00 AM	0.11	0.11	0.19
8/16/13 5:00 AM	0.11	0.11	0.20
8/16/13 7:00 AM	0.10	0.10	0.20
8/16/13 9:00 AM	0.10	0.10	0.20
8/16/13 11:00 AM	0.10	0.10	0.20
8/16/13 1:00 PM	0.22	0.22	0.21
8/16/13 3:00 PM	0.23	0.23	0.21
8/16/13 5:00 PM	0.22	0.22	0.21
8/16/13 7:00 PM	0.23	0.23	0.20
8/16/13 9:00 PM	0.25	0.25	0.20
8/16/13 11:00 PM	0.24	0.24	0.05
8/17/13 1:00 AM	0.21	0.21	0.03
8/17/13 3:00 AM	0.23	0.23	0.04
8/17/13 5:00 AM	0.23	0.23	0.05
8/17/13 7:00 AM	0.24	0.24	0.19
8/17/13 9:00 AM	0.26	0.26	0.25
8/17/13 11:00 AM	0.26	0.26	0.24
8/17/13 1:00 PM	0.25	0.25	0.24
8/17/13 3:00 PM	0.25	0.25	0.23
8/17/13 5:00 PM	0.25	0.25	0.22
8/17/13 7:00 PM	0.16	0.16	0.22
8/17/13 9:00 PM	0.17	0.17	0.22
8/17/13 11:00 PM	0.16	0.16	0.21
8/18/13 1:00 AM	0.16	0.16	0.22
8/18/13 3:00 AM	0.16	0.16	0.22
8/18/13 5:00 AM	0.17	0.17	0.22
8/18/13 7:00 AM	0.16	0.16	0.22
8/18/13 9:00 AM	0.20	0.20	0.22
8/18/13 11:00 AM	0.20	0.20	0.22
8/18/13 1:00 PM	0.20	0.20	0.23
8/18/13 3:00 PM	0.19	0.19	0.22
8/18/13 5:00 PM	0.19	0.19	0.22
8/18/13 7:00 PM	0.18	0.18	0.21
8/18/13 9:00 PM	0.18	0.18	0.21
8/18/13 11:00 PM	0.16	0.16	0.19
8/19/13 1:00 AM	0.16	0.16	0.10
8/19/13 3:00 AM	0.16	0.16	0.08
8/19/13 5:00 AM	0.17	0.17	0.09
8/19/13 7:00 AM	0.19	0.19	0.18
8/19/13 9:00 AM	0.21	0.21	0.15
8/19/13 11:00 AM	0.21	0.21	0.17
8/19/13 1:00 PM	0.21	0.21	0.17

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
8/19/13 3:00 PM	0.20	0.20	0.18
8/19/13 5:00 PM	0.20	0.20	0.19
8/19/13 7:00 PM	0.20	0.20	0.17
8/19/13 9:00 PM	0.16	0.16	0.18
8/19/13 11:00 PM	0.17	0.17	0.19
8/20/13 1:00 AM	0.17	0.17	0.10
8/20/13 3:00 AM	0.17	0.17	0.08
8/20/13 5:00 AM	0.17	0.17	0.09
8/20/13 7:00 AM	0.18	0.18	0.23
8/20/13 9:00 AM	0.20	0.20	0.21
8/20/13 11:00 AM	0.20	0.20	0.22
8/20/13 1:00 PM	0.21	0.21	0.25
8/20/13 3:00 PM	0.21	0.21	0.22
8/20/13 5:00 PM	0.21	0.21	0.21
8/20/13 7:00 PM	0.23	0.23	0.21
8/20/13 9:00 PM	0.22	0.22	0.20
8/20/13 11:00 PM	0.19	0.19	0.20
8/21/13 1:00 AM	0.18	0.18	0.16
8/21/13 3:00 AM	0.18	0.18	0.13
8/21/13 5:00 AM	0.20	0.20	0.17
8/21/13 7:00 AM	0.24	0.24	0.22
8/21/13 9:00 AM	0.23	0.23	0.23
8/21/13 11:00 AM	0.23	0.23	0.21
8/21/13 1:00 PM	0.24	0.24	0.20
8/21/13 3:00 PM	0.24	0.24	0.20
8/21/13 5:00 PM	0.24	0.24	0.20
8/21/13 7:00 PM	0.24	0.24	0.21
8/21/13 9:00 PM	0.24	0.24	0.16
8/21/13 11:00 PM	0.24	0.24	0.06
8/22/13 1:00 AM	0.20	0.20	0.06
8/22/13 3:00 AM	0.20	0.20	0.10
8/22/13 5:00 AM	0.22	0.22	0.12
8/22/13 7:00 AM	0.25	0.25	0.28
8/22/13 9:00 AM	0.23	0.23	0.23
8/22/13 11:00 AM	0.24	0.24	0.21
8/22/13 1:00 PM	0.24	0.24	0.23
8/22/13 3:00 PM	0.23	0.23	0.23
8/22/13 5:00 PM	0.24	0.24	0.23
8/22/13 7:00 PM	0.25	0.25	0.22
8/22/13 9:00 PM	0.23	0.23	0.22
8/22/13 11:00 PM	0.22	0.22	0.21
8/23/13 1:00 AM	0.19	0.19	0.14
8/23/13 3:00 AM	0.18	0.18	0.11
8/23/13 5:00 AM	0.23	0.23	0.13
8/23/13 7:00 AM	0.26	0.26	0.24
8/23/13 9:00 AM	0.24	0.24	0.23
8/23/13 11:00 AM	0.24	0.24	0.23
8/23/13 1:00 PM	0.20	0.20	0.22
8/23/13 3:00 PM	0.21	0.21	0.22
8/23/13 5:00 PM	0.22	0.22	0.21
8/23/13 7:00 PM	0.22	0.22	0.21
8/23/13 9:00 PM	0.21	0.21	0.21
8/23/13 11:00 PM	0.20	0.20	0.18

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
8/24/13 1:00 AM	0.21	0.21	0.13
8/24/13 3:00 AM	0.18	0.18	0.10
8/24/13 5:00 AM	0.15	0.15	0.10
8/24/13 7:00 AM	0.18	0.18	0.17
8/24/13 9:00 AM	0.24	0.24	0.21
8/24/13 11:00 AM	0.24	0.24	0.21
8/24/13 1:00 PM	0.24	0.24	0.21
8/24/13 3:00 PM	0.26	0.26	0.21
8/24/13 5:00 PM	0.25	0.25	0.13
8/24/13 7:00 PM	0.23	0.23	0.00
8/24/13 9:00 PM	0.23	0.23	0.00
8/24/13 11:00 PM	0.25	0.25	0.00
8/25/13 1:00 AM	0.24	0.24	0.00
8/25/13 3:00 AM	0.24	0.24	0.00
8/25/13 5:00 AM	0.24	0.24	0.00
8/25/13 7:00 AM	0.25	0.25	0.00
8/25/13 9:00 AM	0.24	0.24	0.00
8/25/13 11:00 AM	0.25	0.25	0.00
8/25/13 1:00 PM	0.29	0.29	0.00
8/25/13 3:00 PM	0.24	0.24	0.06
8/25/13 5:00 PM	0.22	0.22	0.15
8/25/13 7:00 PM	0.23	0.23	0.23
8/25/13 9:00 PM	0.23	0.23	0.23
8/25/13 11:00 PM	0.21	0.21	0.19
8/26/13 1:00 AM	0.19	0.19	0.12
8/26/13 3:00 AM	0.19	0.19	0.11
8/26/13 5:00 AM	0.22	0.22	0.18
8/26/13 7:00 AM	0.22	0.22	0.21
8/26/13 9:00 AM	0.20	0.20	0.21
8/26/13 11:00 AM	0.21	0.21	0.21
8/26/13 1:00 PM	0.24	0.24	0.21
8/26/13 3:00 PM	0.20	0.20	0.21
8/26/13 5:00 PM	0.21	0.21	0.22
8/26/13 7:00 PM	0.22	0.22	0.22
8/26/13 9:00 PM	0.19	0.19	0.22
8/26/13 11:00 PM	0.16	0.16	0.21
8/27/13 1:00 AM	0.15	0.15	0.14
8/27/13 3:00 AM	0.15	0.15	0.13
8/27/13 5:00 AM	0.16	0.16	0.16
8/27/13 7:00 AM	0.24	0.24	0.22
8/27/13 9:00 AM	0.23	0.23	0.22
8/27/13 11:00 AM	0.22	0.22	0.21
8/27/13 1:00 PM	0.22	0.22	0.21
8/27/13 3:00 PM	0.23	0.23	0.21
8/27/13 5:00 PM	0.22	0.22	0.21
8/27/13 7:00 PM	0.23	0.23	0.21
8/27/13 9:00 PM	0.23	0.23	0.19
8/27/13 11:00 PM	0.19	0.19	0.08
8/28/13 1:00 AM	0.18	0.18	0.03
8/28/13 3:00 AM	0.18	0.18	0.03
8/28/13 5:00 AM	0.18	0.18	0.04
8/28/13 7:00 AM	0.20	0.20	0.23
8/28/13 9:00 AM	0.22	0.22	0.22

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
8/28/13 11:00 AM	0.23	0.23	0.22
8/28/13 1:00 PM	0.23	0.23	0.22
8/28/13 3:00 PM	0.22	0.22	0.21
8/28/13 5:00 PM	0.22	0.22	0.21
8/28/13 7:00 PM	0.19	0.19	0.21
8/28/13 9:00 PM	0.19	0.19	0.21
8/28/13 11:00 PM	0.19	0.19	0.18
8/29/13 1:00 AM	0.17	0.17	0.17
8/29/13 3:00 AM	0.17	0.17	0.12
8/29/13 5:00 AM	0.20	0.20	0.15
8/29/13 7:00 AM	0.20	0.20	0.18
8/29/13 9:00 AM	0.20	0.20	0.18
8/29/13 11:00 AM	0.20	0.20	0.18
8/29/13 1:00 PM	0.20	0.20	0.18
8/29/13 3:00 PM	0.19	0.19	0.18
8/29/13 5:00 PM	0.20	0.20	0.18
8/29/13 7:00 PM	0.19	0.19	0.18
8/29/13 9:00 PM	0.20	0.20	0.18
8/29/13 11:00 PM	0.20	0.20	0.18
8/30/13 1:00 AM	0.20	0.20	0.17
8/30/13 3:00 AM	0.20	0.20	0.18
8/30/13 5:00 AM	0.20	0.20	0.18
8/30/13 7:00 AM	0.21	0.21	0.19
8/30/13 9:00 AM	0.21	0.21	0.19
8/30/13 11:00 AM	0.21	0.21	0.20
8/30/13 1:00 PM	0.20	0.20	0.20
8/30/13 3:00 PM	0.20	0.20	0.21
8/30/13 5:00 PM	0.19	0.19	0.24
8/30/13 7:00 PM	0.20	0.20	0.20
8/30/13 9:00 PM	0.19	0.19	0.09
8/30/13 11:00 PM	0.18	0.18	0.09
8/31/13 1:00 AM	0.16	0.16	0.10
8/31/13 3:00 AM	0.15	0.15	0.10
8/31/13 5:00 AM	0.16	0.16	0.10
8/31/13 7:00 AM	0.18	0.18	0.10
8/31/13 9:00 AM	0.19	0.19	0.10
8/31/13 11:00 AM	0.20	0.20	0.10
8/31/13 1:00 PM	0.22	0.22	0.10
8/31/13 3:00 PM	0.21	0.21	0.10
8/31/13 5:00 PM	0.21	0.21	0.10
8/31/13 7:00 PM	0.25	0.25	0.10
8/31/13 9:00 PM	0.24	0.24	0.10
8/31/13 11:00 PM	0.24	0.24	0.10
9/1/13 1:00 AM	0.25	0.25	0.08
9/1/13 3:00 AM	0.22	0.22	0.06
9/1/13 5:00 AM	0.22	0.22	0.07
9/1/13 7:00 AM	0.22	0.22	0.10
9/1/13 9:00 AM	0.23	0.23	0.09
9/1/13 11:00 AM	0.23	0.23	0.10
9/1/13 1:00 PM	0.23	0.23	0.09
9/1/13 3:00 PM	0.22	0.22	0.10
9/1/13 5:00 PM	0.23	0.23	0.10
9/1/13 7:00 PM	0.27	0.27	0.10

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
9/1/13 9:00 PM	0.21	0.21	0.09
9/1/13 11:00 PM	0.21	0.21	0.05
9/2/13 1:00 AM	0.21	0.21	0.04
9/2/13 3:00 AM	0.21	0.21	0.04
9/2/13 5:00 AM	0.21	0.21	0.04
9/2/13 7:00 AM	0.22	0.22	0.06
9/2/13 9:00 AM	0.23	0.23	0.10
9/2/13 11:00 AM	0.24	0.24	0.11
9/2/13 1:00 PM	0.24	0.24	0.10
9/2/13 3:00 PM	0.24	0.24	0.10
9/2/13 5:00 PM	0.24	0.24	0.10
9/2/13 7:00 PM	0.23	0.23	0.10
9/2/13 9:00 PM	0.22	0.22	0.10
9/2/13 11:00 PM	0.23	0.23	0.08
9/3/13 1:00 AM	0.23	0.23	0.06
9/3/13 3:00 AM	0.22	0.22	0.06
9/3/13 5:00 AM	0.22	0.22	0.09
9/3/13 7:00 AM	0.21	0.21	0.10
9/3/13 9:00 AM	0.20	0.20	0.09
9/3/13 11:00 AM	0.19	0.19	0.09
9/3/13 1:00 PM	0.20	0.20	0.09
9/3/13 3:00 PM	0.22	0.22	0.08
9/3/13 5:00 PM	0.20	0.20	0.07
9/3/13 7:00 PM	0.20	0.20	0.07
9/3/13 9:00 PM	0.22	0.22	0.07
9/3/13 11:00 PM	0.19	0.19	0.07
9/4/13 1:00 AM	0.15	0.15	0.08
9/4/13 3:00 AM	0.15	0.15	0.08
9/4/13 5:00 AM	0.19	0.19	0.08
9/4/13 7:00 AM	0.21	0.21	0.08
9/4/13 9:00 AM	0.22	0.22	0.09
9/4/13 11:00 AM	0.22	0.22	0.09
9/4/13 1:00 PM	0.22	0.22	0.09
9/4/13 3:00 PM	0.22	0.22	0.10
9/4/13 5:00 PM	0.21	0.21	0.10
9/4/13 7:00 PM	0.20	0.20	0.09
9/4/13 9:00 PM	0.20	0.20	0.09
9/4/13 11:00 PM	0.20	0.20	0.09
9/5/13 1:00 AM	0.21	0.21	0.09
9/5/13 3:00 AM	0.23	0.23	0.09
9/5/13 5:00 AM	0.22	0.22	0.09
9/5/13 7:00 AM	0.21	0.21	0.10
9/5/13 9:00 AM	0.21	0.21	0.09
9/5/13 11:00 AM	0.21	0.21	0.09
9/5/13 1:00 PM	0.20	0.20	0.10
9/5/13 3:00 PM	0.20	0.20	0.10
9/5/13 5:00 PM	0.19	0.19	0.10
9/5/13 7:00 PM	0.19	0.19	0.11
9/5/13 9:00 PM	0.19	0.19	0.11
9/5/13 11:00 PM	0.21	0.21	0.12
9/6/13 1:00 AM	0.19	0.19	0.12
9/6/13 3:00 AM	0.19	0.19	0.13
9/6/13 5:00 AM	0.19	0.19	0.13

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
9/6/13 7:00 AM	0.19	0.19	0.14
9/6/13 9:00 AM	0.19	0.19	0.13
9/6/13 11:00 AM	0.19	0.19	0.12
9/6/13 1:00 PM	0.19	0.19	0.12
9/6/13 3:00 PM	0.18	0.18	0.12
9/6/13 5:00 PM	0.18	0.18	0.13
9/6/13 7:00 PM	0.17	0.17	0.12
9/6/13 9:00 PM	0.19	0.19	0.11
9/6/13 11:00 PM	0.18	0.18	0.10
9/7/13 1:00 AM	0.18	0.18	0.10
9/7/13 3:00 AM	0.18	0.18	0.09
9/7/13 5:00 AM	0.19	0.19	0.09
9/7/13 7:00 AM	0.19	0.19	0.09
9/7/13 9:00 AM	0.20	0.20	0.09
9/7/13 11:00 AM	0.20	0.20	0.09
9/7/13 1:00 PM	0.20	0.20	0.09
9/7/13 3:00 PM	0.20	0.20	0.12
9/7/13 5:00 PM	0.20	0.20	0.12
9/7/13 7:00 PM	0.19	0.19	0.11
9/7/13 9:00 PM	0.19	0.19	0.11
9/7/13 11:00 PM	0.19	0.19	0.10
9/8/13 1:00 AM	0.19	0.19	0.10
9/8/13 3:00 AM	0.20	0.20	0.11
9/8/13 5:00 AM	0.21	0.21	0.11
9/8/13 7:00 AM	0.21	0.21	0.12
9/8/13 9:00 AM	0.22	0.22	0.13
9/8/13 11:00 AM	0.22	0.22	0.14
9/8/13 1:00 PM	0.23	0.23	0.14
9/8/13 3:00 PM	0.22	0.22	0.15
9/8/13 5:00 PM	0.25	0.25	0.16
9/8/13 7:00 PM	0.23	0.23	0.16
9/8/13 9:00 PM	0.22	0.22	0.16
9/8/13 11:00 PM	0.23	0.23	0.17
9/9/13 1:00 AM	0.22	0.22	0.17
9/9/13 3:00 AM	0.22	0.22	0.17
9/9/13 5:00 AM	0.22	0.22	0.17
9/9/13 7:00 AM	0.21	0.21	0.17
9/9/13 9:00 AM	0.21	0.21	0.17
9/9/13 11:00 AM	0.20	0.20	0.17
9/9/13 1:00 PM	0.21	0.21	0.17
9/9/13 3:00 PM	0.21	0.21	0.17
9/9/13 5:00 PM	0.20	0.20	0.28
9/9/13 7:00 PM	0.19	0.19	0.21
9/9/13 9:00 PM	0.19	0.19	0.21
9/9/13 11:00 PM	0.16	0.16	0.20
9/10/13 1:00 AM	0.16	0.16	0.16
9/10/13 3:00 AM	0.16	0.16	0.17
9/10/13 5:00 AM	0.19	0.19	0.18
9/10/13 7:00 AM	0.20	0.20	0.20
9/10/13 9:00 AM	0.20	0.20	0.25
9/10/13 11:00 AM	0.21	0.21	0.22
9/10/13 1:00 PM	0.21	0.21	0.22
9/10/13 3:00 PM	0.21	0.21	0.21

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
9/10/13 5:00 PM	0.20	0.20	0.17
9/10/13 7:00 PM	0.20	0.20	0.05
9/10/13 9:00 PM	0.21	0.21	0.02
9/10/13 11:00 PM	0.19	0.19	0.00
9/11/13 1:00 AM	0.18	0.18	0.00
9/11/13 3:00 AM	0.18	0.18	0.00
9/11/13 5:00 AM	0.19	0.19	0.00
9/11/13 7:00 AM	0.23	0.23	0.00
9/11/13 9:00 AM	0.21	0.21	0.00
9/11/13 11:00 AM	0.22	0.22	0.00
9/11/13 1:00 PM	0.22	0.22	0.00
9/11/13 3:00 PM	0.22	0.22	0.00
9/11/13 5:00 PM	0.22	0.22	0.00
9/11/13 7:00 PM	0.21	0.21	0.00
9/11/13 9:00 PM	0.22	0.22	0.00
9/11/13 11:00 PM	0.21	0.21	0.00
9/12/13 1:00 AM	0.18	0.18	0.00
9/12/13 3:00 AM	0.18	0.18	0.00
9/12/13 5:00 AM	0.19	0.19	0.05
9/12/13 7:00 AM	0.22	0.22	0.12
9/12/13 9:00 AM	0.22	0.22	0.26
9/12/13 11:00 AM	0.22	0.22	0.25
9/12/13 1:00 PM	0.22	0.22	0.17
9/12/13 3:00 PM	0.21	0.21	0.14
9/12/13 5:00 PM	0.20	0.20	0.12
9/12/13 7:00 PM	0.21	0.21	0.11
9/12/13 9:00 PM	0.21	0.21	0.10
9/12/13 11:00 PM	0.17	0.17	0.08
9/13/13 1:00 AM	0.13	0.13	0.07
9/13/13 3:00 AM	0.12	0.12	0.07
9/13/13 5:00 AM	0.14	0.14	0.09
9/13/13 7:00 AM	0.18	0.18	0.11
9/13/13 9:00 AM	0.20	0.20	0.11
9/13/13 11:00 AM	0.20	0.20	0.11
9/13/13 1:00 PM	0.20	0.20	0.12
9/13/13 3:00 PM	0.19	0.19	0.12
9/13/13 5:00 PM	0.19	0.19	0.12
9/13/13 7:00 PM	0.18	0.18	0.13
9/13/13 9:00 PM	0.18	0.18	0.12
9/13/13 11:00 PM	0.15	0.15	0.03
9/14/13 1:00 AM	0.15	0.15	0.03
9/14/13 3:00 AM	0.14	0.14	0.03
9/14/13 5:00 AM	0.14	0.14	0.03
9/14/13 7:00 AM	0.16	0.16	0.07
9/14/13 9:00 AM	0.17	0.17	0.19
9/14/13 11:00 AM	0.18	0.18	0.20
9/14/13 1:00 PM	0.17	0.17	0.20
9/14/13 3:00 PM	0.18	0.18	0.18
9/14/13 5:00 PM	0.19	0.19	0.18
9/14/13 7:00 PM	0.21	0.21	0.19
9/14/13 9:00 PM	0.18	0.18	0.18
9/14/13 11:00 PM	0.15	0.15	0.17
9/15/13 1:00 AM	0.15	0.15	0.09

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
9/15/13 3:00 AM	0.16	0.16	0.10
9/15/13 5:00 AM	0.15	0.15	0.12
9/15/13 7:00 AM	0.19	0.19	0.15
9/15/13 9:00 AM	0.19	0.19	0.18
9/15/13 11:00 AM	0.19	0.19	0.18
9/15/13 1:00 PM	0.19	0.19	0.17
9/15/13 3:00 PM	0.19	0.19	0.18
9/15/13 5:00 PM	0.16	0.16	0.18
9/15/13 7:00 PM	0.20	0.20	0.18
9/15/13 9:00 PM	0.22	0.22	0.18
9/15/13 11:00 PM	0.18	0.18	0.17
9/16/13 1:00 AM	0.14	0.14	0.11
9/16/13 3:00 AM	0.12	0.12	0.10
9/16/13 5:00 AM	0.18	0.18	0.12
9/16/13 7:00 AM	0.21	0.21	0.20
9/16/13 9:00 AM	0.19	0.19	0.20
9/16/13 11:00 AM	0.18	0.18	0.20
9/16/13 1:00 PM	0.17	0.17	0.19
9/16/13 3:00 PM	0.19	0.19	0.19
9/16/13 5:00 PM	0.19	0.19	0.19
9/16/13 7:00 PM	0.20	0.20	0.19
9/16/13 9:00 PM	0.20	0.20	0.07
9/16/13 11:00 PM	0.21	0.21	0.02
9/17/13 1:00 AM	0.15	0.15	0.03
9/17/13 3:00 AM	0.15	0.15	0.04
9/17/13 5:00 AM	0.20	0.20	0.12
9/17/13 7:00 AM	0.22	0.22	0.30
9/17/13 9:00 AM	0.21	0.21	0.23
9/17/13 11:00 AM	0.20	0.20	0.23
9/17/13 1:00 PM	0.20	0.20	0.23
9/17/13 3:00 PM	0.19	0.19	0.23
9/17/13 5:00 PM	0.18	0.18	0.21
9/17/13 7:00 PM	0.18	0.18	0.19
9/17/13 9:00 PM	0.16	0.16	0.22
9/17/13 11:00 PM	0.15	0.15	0.23
9/18/13 1:00 AM	0.14	0.14	0.17
9/18/13 3:00 AM	0.13	0.13	0.12
9/18/13 5:00 AM	0.12	0.12	0.15
9/18/13 7:00 AM	0.10	0.10	0.18
9/18/13 9:00 AM	0.11	0.11	0.19
9/18/13 11:00 AM	0.14	0.14	0.20
9/18/13 1:00 PM	0.17	0.17	0.20
9/18/13 3:00 PM	0.19	0.19	0.19
9/18/13 5:00 PM	0.19	0.19	0.19
9/18/13 7:00 PM	0.19	0.19	0.19
9/18/13 9:00 PM	0.16	0.16	0.19
9/18/13 11:00 PM	0.16	0.16	0.18
9/19/13 1:00 AM	0.15	0.15	0.15
9/19/13 3:00 AM	0.13	0.13	0.15
9/19/13 5:00 AM	0.17	0.17	0.15
9/19/13 7:00 AM	0.18	0.18	0.19
9/19/13 9:00 AM	0.12	0.12	0.21
9/19/13 11:00 AM	0.17	0.17	0.20

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
9/19/13 1:00 PM	0.24	0.24	0.19
9/19/13 3:00 PM	0.21	0.21	0.19
9/19/13 5:00 PM	0.20	0.20	0.19
9/19/13 7:00 PM	0.20	0.20	0.19
9/19/13 9:00 PM	0.18	0.18	0.18
9/19/13 11:00 PM	0.15	0.15	0.17
9/20/13 1:00 AM	0.14	0.14	0.12
9/20/13 3:00 AM	0.14	0.14	0.12
9/20/13 5:00 AM	0.16	0.16	0.14
9/20/13 7:00 AM	0.14	0.14	0.19
9/20/13 9:00 AM	0.12	0.12	0.18
9/20/13 11:00 AM	0.12	0.12	0.18
9/20/13 1:00 PM	0.12	0.12	0.18
9/20/13 3:00 PM	0.13	0.13	0.17
9/20/13 5:00 PM	0.13	0.13	0.16
9/20/13 7:00 PM	0.15	0.15	0.15
9/20/13 9:00 PM	0.18	0.18	0.13
9/20/13 11:00 PM	0.19	0.19	0.06
9/21/13 1:00 AM	0.16	0.16	0.05
9/21/13 3:00 AM	0.16	0.16	0.05
9/21/13 5:00 AM	0.16	0.16	0.05
9/21/13 7:00 AM	0.17	0.17	0.06
9/21/13 9:00 AM	0.12	0.12	0.17
9/21/13 11:00 AM	0.12	0.12	0.20
9/21/13 1:00 PM	0.13	0.13	0.20
9/21/13 3:00 PM	0.12	0.12	0.20
9/21/13 5:00 PM	0.14	0.14	0.20
9/21/13 7:00 PM	0.13	0.13	0.19
9/21/13 9:00 PM	0.00	0.09	0.20
9/21/13 11:00 PM	0.00	0.11	0.20
9/22/13 1:00 AM	0.10	0.10	0.19
9/22/13 3:00 AM	0.09	0.09	0.19
9/22/13 5:00 AM	0.10	0.10	0.18
9/22/13 7:00 AM	0.11	0.11	0.18
9/22/13 9:00 AM	0.11	0.11	0.19
9/22/13 11:00 AM	0.15	0.15	0.17
9/22/13 1:00 PM	0.17	0.17	0.17
9/22/13 3:00 PM	0.21	0.21	0.19
9/22/13 5:00 PM	0.21	0.21	0.18
9/22/13 7:00 PM	0.20	0.20	0.18
9/22/13 9:00 PM	0.19	0.19	0.17
9/22/13 11:00 PM	0.19	0.19	0.17
9/23/13 1:00 AM	0.16	0.16	0.17
9/23/13 3:00 AM	0.15	0.15	0.10
9/23/13 5:00 AM	0.19	0.19	0.13
9/23/13 7:00 AM	0.20	0.20	0.17
9/23/13 9:00 AM	0.20	0.20	0.17
9/23/13 11:00 AM	0.19	0.19	0.16
9/23/13 1:00 PM	0.19	0.19	0.17
9/23/13 3:00 PM	0.20	0.20	0.16
9/23/13 5:00 PM	0.20	0.20	0.17
9/23/13 7:00 PM	0.19	0.19	0.16
9/23/13 9:00 PM	0.18	0.18	0.16

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
9/23/13 11:00 PM	0.16	0.16	0.15
9/24/13 1:00 AM	0.15	0.15	0.13
9/24/13 3:00 AM	0.13	0.13	0.13
9/24/13 5:00 AM	0.16	0.16	0.14
9/24/13 7:00 AM	0.19	0.19	0.16
9/24/13 9:00 AM	0.21	0.21	0.15
9/24/13 11:00 AM	0.21	0.21	0.15
9/24/13 1:00 PM	0.21	0.21	0.15
9/24/13 3:00 PM	0.22	0.22	0.15
9/24/13 5:00 PM	0.22	0.22	0.15
9/24/13 7:00 PM	0.21	0.21	0.15
9/24/13 9:00 PM	0.13	0.13	0.15
9/24/13 11:00 PM	0.11	0.11	0.14
9/25/13 1:00 AM	0.13	0.13	0.08
9/25/13 3:00 AM	0.13	0.13	0.08
9/25/13 5:00 AM	0.14	0.14	0.13
9/25/13 7:00 AM	0.22	0.22	0.18
9/25/13 9:00 AM	0.22	0.22	0.17
9/25/13 11:00 AM	0.23	0.23	0.16
9/25/13 1:00 PM	0.22	0.22	0.17
9/25/13 3:00 PM	0.24	0.24	0.17
9/25/13 5:00 PM	0.22	0.22	0.17
9/25/13 7:00 PM	0.19	0.19	0.17
9/25/13 9:00 PM	0.19	0.19	0.13
9/25/13 11:00 PM	0.17	0.17	0.02
9/26/13 1:00 AM	0.15	0.15	0.02
9/26/13 3:00 AM	0.15	0.15	0.01
9/26/13 5:00 AM	0.16	0.16	0.02
9/26/13 7:00 AM	0.18	0.18	0.02
9/26/13 9:00 AM	0.17	0.17	0.00
9/26/13 11:00 AM	0.19	0.19	0.00
9/26/13 1:00 PM	0.20	0.20	0.00
9/26/13 3:00 PM	0.18	0.18	0.00
9/26/13 5:00 PM	0.16	0.16	0.00
9/26/13 7:00 PM	0.16	0.16	0.00
9/26/13 9:00 PM	0.17	0.17	0.00
9/26/13 11:00 PM	0.18	0.18	0.00
9/27/13 1:00 AM	0.17	0.17	0.00
9/27/13 3:00 AM	0.16	0.16	0.00
9/27/13 5:00 AM	0.16	0.16	0.00
9/27/13 7:00 AM	0.15	0.15	0.00
9/27/13 9:00 AM	0.16	0.16	0.00
9/27/13 11:00 AM	0.17	0.17	0.00
9/27/13 1:00 PM	0.18	0.18	0.00
9/27/13 3:00 PM	0.18	0.18	0.00
9/27/13 5:00 PM	0.18	0.18	0.00
9/27/13 7:00 PM	0.18	0.18	0.00
9/27/13 9:00 PM	0.17	0.17	0.00
9/27/13 11:00 PM	0.16	0.16	0.00
9/28/13 1:00 AM	0.17	0.17	0.00
9/28/13 3:00 AM	0.15	0.15	0.00
9/28/13 5:00 AM	0.14	0.14	0.04
9/28/13 7:00 AM	0.16	0.16	0.08

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
9/28/13 9:00 AM	0.19	0.19	0.24
9/28/13 11:00 AM	0.19	0.19	0.24
9/28/13 1:00 PM	0.20	0.20	0.23
9/28/13 3:00 PM	0.18	0.18	0.21
9/28/13 5:00 PM	0.19	0.19	0.20
9/28/13 7:00 PM	0.18	0.18	0.19
9/28/13 9:00 PM	0.17	0.17	0.18
9/28/13 11:00 PM	0.17	0.17	0.17
9/29/13 1:00 AM	0.16	0.16	0.14
9/29/13 3:00 AM	0.14	0.14	0.08
9/29/13 5:00 AM	0.14	0.14	0.08
9/29/13 7:00 AM	0.14	0.14	0.08
9/29/13 9:00 AM	0.18	0.18	0.14
9/29/13 11:00 AM	0.19	0.19	0.19
9/29/13 1:00 PM	0.19	0.19	0.21
9/29/13 3:00 PM	0.19	0.19	0.20
9/29/13 5:00 PM	0.19	0.19	0.19
9/29/13 7:00 PM	0.19	0.19	0.19
9/29/13 9:00 PM	0.19	0.19	0.19
9/29/13 11:00 PM	0.14	0.14	0.15
9/30/13 1:00 AM	0.12	0.12	0.07
9/30/13 3:00 AM	0.14	0.14	0.06
9/30/13 5:00 AM	0.15	0.15	0.09
9/30/13 7:00 AM	0.18	0.18	0.17
9/30/13 9:00 AM	0.18	0.18	0.17
9/30/13 11:00 AM	0.19	0.19	0.17
9/30/13 1:00 PM	0.20	0.20	0.18
9/30/13 3:00 PM	0.22	0.22	0.18
9/30/13 5:00 PM	0.21	0.21	0.17
9/30/13 7:00 PM	0.20	0.20	0.17
9/30/13 9:00 PM	0.19	0.19	0.17
9/30/13 11:00 PM	0.18	0.18	0.17
10/1/13 1:00 AM	0.16	0.16	0.12
10/1/13 3:00 AM	0.15	0.15	0.09
10/1/13 5:00 AM	0.17	0.17	0.15
10/1/13 7:00 AM	0.18	0.18	0.16
10/1/13 9:00 AM	0.19	0.19	0.16
10/1/13 11:00 AM	0.19	0.19	0.17
10/1/13 1:00 PM	0.19	0.19	0.17
10/1/13 3:00 PM	0.19	0.19	0.19
10/1/13 5:00 PM	0.19	0.19	0.17
10/1/13 7:00 PM	0.20	0.20	0.17
10/1/13 9:00 PM	0.19	0.19	0.17
10/1/13 11:00 PM	0.19	0.19	0.17
10/2/13 1:00 AM	0.17	0.17	0.16
10/2/13 3:00 AM	0.13	0.13	0.13
10/2/13 5:00 AM	0.15	0.15	0.13
10/2/13 7:00 AM	0.19	0.19	0.13
10/2/13 9:00 AM	0.16	0.16	0.16
10/2/13 11:00 AM	0.17	0.17	0.17
10/2/13 1:00 PM	0.17	0.17	0.17
10/2/13 3:00 PM	0.17	0.17	0.17
10/2/13 5:00 PM	0.18	0.18	0.17

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
10/2/13 7:00 PM	0.20	0.20	0.17
10/2/13 9:00 PM	0.19	0.19	0.17
10/2/13 11:00 PM	0.20	0.20	0.17
10/3/13 1:00 AM	0.14	0.14	0.17
10/3/13 3:00 AM	0.13	0.13	0.17
10/3/13 5:00 AM	0.15	0.15	0.17
10/3/13 7:00 AM	0.18	0.18	0.17
10/3/13 9:00 AM	0.19	0.19	0.17
10/3/13 11:00 AM	0.19	0.19	0.17
10/3/13 1:00 PM	0.18	0.18	0.17
10/3/13 3:00 PM	0.19	0.19	0.17
10/3/13 5:00 PM	0.18	0.18	0.17
10/3/13 7:00 PM	0.18	0.18	0.17
10/3/13 9:00 PM	0.18	0.18	0.17
10/3/13 11:00 PM	0.18	0.18	0.17
10/4/13 1:00 AM	0.16	0.16	0.17
10/4/13 3:00 AM	0.15	0.15	0.17
10/4/13 5:00 AM	0.18	0.18	0.17
10/4/13 7:00 AM	0.22	0.22	0.17
10/4/13 9:00 AM	0.22	0.22	0.17
10/4/13 11:00 AM	0.21	0.21	0.17
10/4/13 1:00 PM	0.21	0.21	0.18
10/4/13 3:00 PM	0.21	0.21	0.17
10/4/13 5:00 PM	0.20	0.20	0.17
10/4/13 7:00 PM	0.20	0.20	0.17
10/4/13 9:00 PM	0.20	0.20	0.17
10/4/13 11:00 PM	0.20	0.20	0.09
10/5/13 1:00 AM	0.17	0.17	0.03
10/5/13 3:00 AM	0.16	0.16	0.03
10/5/13 5:00 AM	0.16	0.16	0.03
10/5/13 7:00 AM	0.18	0.18	0.11
10/5/13 9:00 AM	0.20	0.20	0.19
10/5/13 11:00 AM	0.20	0.20	0.19
10/5/13 1:00 PM	0.19	0.19	0.19
10/5/13 3:00 PM	0.19	0.19	0.19
10/5/13 5:00 PM	0.20	0.20	0.19
10/5/13 7:00 PM	0.20	0.20	0.20
10/5/13 9:00 PM	0.20	0.20	0.21
10/5/13 11:00 PM	0.20	0.20	0.19
10/6/13 1:00 AM	0.16	0.16	0.09
10/6/13 3:00 AM	0.16	0.16	0.09
10/6/13 5:00 AM	0.15	0.15	0.10
10/6/13 7:00 AM	0.16	0.16	0.10
10/6/13 9:00 AM	0.21	0.21	0.24
10/6/13 11:00 AM	0.20	0.20	0.23
10/6/13 1:00 PM	0.22	0.22	0.23
10/6/13 3:00 PM	0.20	0.20	0.24
10/6/13 5:00 PM	0.19	0.19	0.24
10/6/13 7:00 PM	0.18	0.18	0.23
10/6/13 9:00 PM	0.18	0.18	0.23
10/6/13 11:00 PM	0.17	0.17	0.22
10/7/13 1:00 AM	0.15	0.15	0.17
10/7/13 3:00 AM	0.15	0.15	0.18

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
10/7/13 5:00 AM	0.18	0.18	0.23
10/7/13 7:00 AM	0.17	0.17	0.23
10/7/13 9:00 AM	0.17	0.17	0.23
10/7/13 11:00 AM	0.16	0.16	0.22
10/7/13 1:00 PM	0.19	0.19	0.22
10/7/13 3:00 PM	0.17	0.17	0.23
10/7/13 5:00 PM	0.18	0.18	0.23
10/7/13 7:00 PM	0.17	0.17	0.22
10/7/13 9:00 PM	0.18	0.18	0.22
10/7/13 11:00 PM	0.18	0.18	0.22
10/8/13 1:00 AM	0.17	0.17	0.22
10/8/13 3:00 AM	0.17	0.17	0.22
10/8/13 5:00 AM	0.18	0.18	0.21
10/8/13 7:00 AM	0.18	0.18	0.21
10/8/13 9:00 AM	0.18	0.18	0.21
10/8/13 11:00 AM	0.18	0.18	0.20
10/8/13 1:00 PM	0.18	0.18	0.20
10/8/13 3:00 PM	0.18	0.18	0.21
10/8/13 5:00 PM	0.18	0.18	0.22
10/8/13 7:00 PM	0.18	0.18	0.22
10/8/13 9:00 PM	0.18	0.18	0.18
10/8/13 11:00 PM	0.17	0.17	0.07
10/9/13 1:00 AM	0.15	0.15	0.07
10/9/13 3:00 AM	0.14	0.14	0.07
10/9/13 5:00 AM	0.17	0.17	0.14
10/9/13 7:00 AM	0.17	0.17	0.25
10/9/13 9:00 AM	0.17	0.17	0.21
10/9/13 11:00 AM	0.17	0.17	0.23
10/9/13 1:00 PM	0.17	0.17	0.24
10/9/13 3:00 PM	0.17	0.17	0.26
10/9/13 5:00 PM	0.18	0.18	0.27
10/9/13 7:00 PM	0.17	0.17	0.20
10/9/13 9:00 PM	0.16	0.16	0.20
10/9/13 11:00 PM	0.13	0.13	0.24
10/10/13 1:00 AM	0.10	0.10	0.15
10/10/13 3:00 AM	0.10	0.10	0.08
10/10/13 5:00 AM	0.16	0.16	0.08
10/10/13 7:00 AM	0.15	0.15	0.13
10/10/13 9:00 AM	0.17	0.17	0.22
10/10/13 11:00 AM	0.19	0.19	0.26
10/10/13 1:00 PM	0.19	0.19	0.23
10/10/13 3:00 PM	0.18	0.18	0.24
10/10/13 5:00 PM	0.18	0.18	0.25
10/10/13 7:00 PM	0.18	0.18	0.24
10/10/13 9:00 PM	0.17	0.17	0.20
10/10/13 11:00 PM	0.16	0.16	0.07
10/11/13 1:00 AM	0.17	0.17	0.07
10/11/13 3:00 AM	0.17	0.17	0.07
10/11/13 5:00 AM	0.17	0.17	0.07
10/11/13 7:00 AM	0.17	0.17	0.10
10/11/13 9:00 AM	0.19	0.19	0.26
10/11/13 11:00 AM	0.19	0.19	0.21
10/11/13 1:00 PM	0.19	0.19	0.24

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
10/11/13 3:00 PM	0.19	0.19	0.22
10/11/13 5:00 PM	0.19	0.19	0.21
10/11/13 7:00 PM	0.18	0.18	0.22
10/11/13 9:00 PM	0.18	0.18	0.14
10/11/13 11:00 PM	0.16	0.16	0.05
10/12/13 1:00 AM	0.17	0.17	0.04
10/12/13 3:00 AM	0.15	0.15	0.03
10/12/13 5:00 AM	0.16	0.16	0.04
10/12/13 7:00 AM	0.17	0.17	0.18
10/12/13 9:00 AM	0.20	0.20	0.23
10/12/13 11:00 AM	0.19	0.19	0.23
10/12/13 1:00 PM	0.20	0.20	0.22
10/12/13 3:00 PM	0.19	0.19	0.21
10/12/13 5:00 PM	0.17	0.17	0.21
10/12/13 7:00 PM	0.14	0.14	0.20
10/12/13 9:00 PM	0.11	0.11	0.22
10/12/13 11:00 PM	0.00	0.07	0.19
10/13/13 1:00 AM	0.00	0.07	0.15
10/13/13 3:00 AM	0.00	0.07	0.12
10/13/13 5:00 AM	0.00	0.07	0.10
10/13/13 7:00 AM	0.00	0.08	0.10
10/13/13 9:00 AM	0.00	0.09	0.23
10/13/13 11:00 AM	0.00	0.09	0.21
10/13/13 1:00 PM	0.00	0.10	0.21
10/13/13 3:00 PM	0.00	0.14	0.23
10/13/13 5:00 PM	0.00	0.11	0.23
10/13/13 7:00 PM	0.00	0.11	0.20
10/13/13 9:00 PM	0.00	0.16	0.09
10/13/13 11:00 PM	0.00	0.12	0.19
10/14/13 1:00 AM	0.00	0.09	0.17
10/14/13 3:00 AM	0.00	0.08	0.14
10/14/13 5:00 AM	0.00	0.10	0.16
10/14/13 7:00 AM	0.00	0.11	0.22
10/14/13 9:00 AM	0.00	0.11	0.23
10/14/13 11:00 AM	0.00	0.10	0.23
10/14/13 1:00 PM	0.00	0.11	0.21
10/14/13 3:00 PM	0.00	0.10	0.21
10/14/13 5:00 PM	0.00	0.10	0.21
10/14/13 7:00 PM	0.00	0.10	0.21
10/14/13 9:00 PM	0.00	0.10	0.22
10/14/13 11:00 PM	0.00	0.10	0.22
10/15/13 1:00 AM	0.00	0.09	0.21
10/15/13 3:00 AM	0.00	0.09	0.22
10/15/13 5:00 AM	0.00	0.09	0.22
10/15/13 7:00 AM	0.00	0.10	0.21
10/15/13 9:00 AM	0.00	0.10	0.21
10/15/13 11:00 AM	0.00	0.10	0.21
10/15/13 1:00 PM	0.00	0.10	0.23
10/15/13 3:00 PM	0.00	0.09	0.22
10/15/13 5:00 PM	0.00	0.09	0.20
10/15/13 7:00 PM	0.00	0.09	0.20
10/15/13 9:00 PM	0.00	0.09	0.20
10/15/13 11:00 PM	0.00	0.08	0.20

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
10/16/13 1:00 AM	0.00	0.08	0.20
10/16/13 3:00 AM	0.00	0.08	0.20
10/16/13 5:00 AM	0.00	0.09	0.21
10/16/13 7:00 AM	0.00	0.11	0.20
10/16/13 9:00 AM	0.00	0.08	0.20
10/16/13 11:00 AM	0.00	0.08	0.21
10/16/13 1:00 PM	0.00	0.08	0.20
10/16/13 3:00 PM	0.00	0.07	0.23
10/16/13 5:00 PM	0.00	0.07	0.22
10/16/13 7:00 PM	0.00	0.07	0.22
10/16/13 9:00 PM	0.00	0.07	0.20
10/16/13 11:00 PM	0.00	0.08	0.18
10/17/13 1:00 AM	0.00	0.07	0.09
10/17/13 3:00 AM	0.00	0.07	0.09
10/17/13 5:00 AM	0.00	0.07	0.16
10/17/13 7:00 AM	0.00	0.12	0.20
10/17/13 9:00 AM	0.00	0.15	0.19
10/17/13 11:00 AM	0.00	0.16	0.28
10/17/13 1:00 PM	0.00	0.16	0.50
10/17/13 3:00 PM	0.00	0.17	0.21
10/17/13 5:00 PM	0.00	0.18	0.21
10/17/13 7:00 PM	0.00	0.18	0.19
10/17/13 9:00 PM	0.00	0.12	0.13
10/17/13 11:00 PM	0.00	0.06	0.18
10/18/13 1:00 AM	0.00	0.00	0.20
10/18/13 3:00 AM	0.00	0.00	0.19
10/18/13 5:00 AM	0.00	0.00	0.20
10/18/13 7:00 AM	0.00	0.00	0.20
10/18/13 9:00 AM	0.00	0.00	0.20
10/18/13 11:00 AM	0.00	0.00	0.20
10/18/13 1:00 PM	0.00	0.00	0.20
10/18/13 3:00 PM	0.00	0.00	0.20
10/18/13 5:00 PM	0.00	0.00	0.19
10/18/13 7:00 PM	0.00	0.00	0.19
10/18/13 9:00 PM	0.00	0.00	0.19
10/18/13 11:00 PM	0.00	0.00	0.19
10/19/13 1:00 AM	0.00	0.00	0.19
10/19/13 3:00 AM	0.00	0.00	0.19
10/19/13 5:00 AM	0.00	0.00	0.20
10/19/13 7:00 AM	0.00	0.00	0.21
10/19/13 9:00 AM	0.00	0.00	0.22
10/19/13 11:00 AM	0.00	0.00	0.22
10/19/13 1:00 PM	0.00	0.00	0.22
10/19/13 3:00 PM	0.00	0.00	0.22
10/19/13 5:00 PM	0.00	0.00	0.22
10/19/13 7:00 PM	0.02	0.00	0.24
10/19/13 9:00 PM	0.00	0.00	0.24
10/19/13 11:00 PM	0.00	0.00	0.24
10/20/13 1:00 AM	0.00	0.00	0.23
10/20/13 3:00 AM	0.00	0.00	0.24
10/20/13 5:00 AM	0.01	0.00	0.24
10/20/13 7:00 AM	0.01	0.00	0.22
10/20/13 9:00 AM	0.01	0.00	0.22

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
10/20/13 11:00 AM	0.03	0.00	0.22
10/20/13 1:00 PM	0.11	0.00	0.22
10/20/13 3:00 PM	0.15	0.00	0.22
10/20/13 5:00 PM	0.15	0.00	0.22
10/20/13 7:00 PM	0.14	0.00	0.22
10/20/13 9:00 PM	0.22	0.00	0.21
10/20/13 11:00 PM	0.22	0.00	0.21
10/21/13 1:00 AM	0.23	0.00	0.20
10/21/13 3:00 AM	0.22	0.00	0.19
10/21/13 5:00 AM	0.22	0.00	0.20
10/21/13 7:00 AM	0.21	0.00	0.20
10/21/13 9:00 AM	0.21	0.00	0.20
10/21/13 11:00 AM	0.20	0.00	0.21
10/21/13 1:00 PM	0.20	0.00	0.20
10/21/13 3:00 PM	0.19	0.00	0.20
10/21/13 5:00 PM	0.19	0.00	0.20
10/21/13 7:00 PM	0.23	0.23	0.20
10/21/13 9:00 PM	0.25	0.25	0.20
10/21/13 11:00 PM	0.22	0.22	0.20
10/22/13 1:00 AM	0.10	0.10	0.19
10/22/13 3:00 AM	0.13	0.13	0.19
10/22/13 5:00 AM	0.20	0.20	0.18
10/22/13 7:00 AM	0.21	0.21	0.21
10/22/13 9:00 AM	0.22	0.22	0.27
10/22/13 11:00 AM	0.22	0.22	0.21
10/22/13 1:00 PM	0.24	0.24	0.20
10/22/13 3:00 PM	0.25	0.25	0.21
10/22/13 5:00 PM	0.22	0.22	0.21
10/22/13 7:00 PM	0.23	0.23	0.21
10/22/13 9:00 PM	0.24	0.24	0.18
10/22/13 11:00 PM	0.23	0.23	0.05
10/23/13 1:00 AM	0.19	0.19	0.05
10/23/13 3:00 AM	0.20	0.20	0.05
10/23/13 5:00 AM	0.24	0.24	0.13
10/23/13 7:00 AM	0.25	0.25	0.21
10/23/13 9:00 AM	0.26	0.26	0.20
10/23/13 11:00 AM	0.27	0.27	0.22
10/23/13 1:00 PM	0.25	0.25	0.23
10/23/13 3:00 PM	0.25	0.25	0.17
10/23/13 5:00 PM	0.27	0.27	0.03
10/23/13 7:00 PM	0.26	0.26	0.00
10/23/13 9:00 PM	0.24	0.24	0.00
10/23/13 11:00 PM	0.20	0.20	0.00
10/24/13 1:00 AM	0.11	0.11	0.00
10/24/13 3:00 AM	0.12	0.12	0.00
10/24/13 5:00 AM	0.24	0.24	0.00
10/24/13 7:00 AM	0.29	0.29	0.00
10/24/13 9:00 AM	0.26	0.26	0.00
10/24/13 11:00 AM	0.25	0.25	0.00
10/24/13 1:00 PM	0.26	0.26	0.00
10/24/13 3:00 PM	0.26	0.26	0.00
10/24/13 5:00 PM	0.26	0.26	0.00
10/24/13 7:00 PM	0.30	0.30	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
10/24/13 9:00 PM	0.28	0.28	0.00
10/24/13 11:00 PM	0.24	0.24	0.00
10/25/13 1:00 AM	0.23	0.23	0.00
10/25/13 3:00 AM	0.21	0.21	0.00
10/25/13 5:00 AM	0.23	0.23	0.00
10/25/13 7:00 AM	0.29	0.29	0.00
10/25/13 9:00 AM	0.29	0.29	0.00
10/25/13 11:00 AM	0.26	0.26	0.00
10/25/13 1:00 PM	0.25	0.25	0.00
10/25/13 3:00 PM	0.26	0.26	0.00
10/25/13 5:00 PM	0.27	0.27	0.00
10/25/13 7:00 PM	0.26	0.26	0.00
10/25/13 9:00 PM	0.26	0.26	0.00
10/25/13 11:00 PM	0.29	0.29	0.00
10/26/13 1:00 AM	0.27	0.27	0.00
10/26/13 3:00 AM	0.26	0.26	0.00
10/26/13 5:00 AM	0.27	0.27	0.00
10/26/13 7:00 AM	0.28	0.28	0.00
10/26/13 9:00 AM	0.27	0.27	0.00
10/26/13 11:00 AM	0.23	0.23	0.00
10/26/13 1:00 PM	0.24	0.24	0.00
10/26/13 3:00 PM	0.22	0.22	0.00
10/26/13 5:00 PM	0.21	0.21	0.00
10/26/13 7:00 PM	0.20	0.20	0.00
10/26/13 9:00 PM	0.20	0.20	0.00
10/26/13 11:00 PM	0.20	0.20	0.00
10/27/13 1:00 AM	0.20	0.20	0.00
10/27/13 3:00 AM	0.21	0.21	0.00
10/27/13 5:00 AM	0.22	0.22	0.00
10/27/13 7:00 AM	0.23	0.23	0.00
10/27/13 9:00 AM	0.24	0.24	0.00
10/27/13 11:00 AM	0.22	0.22	0.00
10/27/13 1:00 PM	0.24	0.24	0.00
10/27/13 3:00 PM	0.23	0.23	0.00
10/27/13 5:00 PM	0.23	0.23	0.00
10/27/13 7:00 PM	0.23	0.23	0.00
10/27/13 9:00 PM	0.21	0.21	0.00
10/27/13 11:00 PM	0.22	0.22	0.00
10/28/13 1:00 AM	0.18	0.18	0.00
10/28/13 3:00 AM	0.18	0.18	0.00
10/28/13 5:00 AM	0.25	0.25	0.00
10/28/13 7:00 AM	0.29	0.29	0.00
10/28/13 9:00 AM	0.25	0.25	0.00
10/28/13 11:00 AM	0.24	0.24	0.00
10/28/13 1:00 PM	0.22	0.22	0.00
10/28/13 3:00 PM	0.25	0.25	0.00
10/28/13 5:00 PM	0.23	0.23	0.00
10/28/13 7:00 PM	0.24	0.24	0.00
10/28/13 9:00 PM	0.23	0.23	0.00
10/28/13 11:00 PM	0.20	0.20	0.00
10/29/13 1:00 AM	0.18	0.18	0.00
10/29/13 3:00 AM	0.18	0.18	0.00
10/29/13 5:00 AM	0.23	0.23	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
10/29/13 7:00 AM	0.26	0.26	0.00
10/29/13 9:00 AM	0.26	0.26	0.00
10/29/13 11:00 AM	0.25	0.25	0.00
10/29/13 1:00 PM	0.26	0.26	0.00
10/29/13 3:00 PM	0.26	0.26	0.00
10/29/13 5:00 PM	0.25	0.25	0.00
10/29/13 7:00 PM	0.24	0.24	0.00
10/29/13 9:00 PM	0.22	0.22	0.00
10/29/13 11:00 PM	0.17	0.17	0.00
10/30/13 1:00 AM	0.16	0.16	0.00
10/30/13 3:00 AM	0.14	0.14	0.00
10/30/13 5:00 AM	0.17	0.17	0.00
10/30/13 7:00 AM	0.22	0.22	0.00
10/30/13 9:00 AM	0.23	0.23	0.00
10/30/13 11:00 AM	0.23	0.23	0.00
10/30/13 1:00 PM	0.25	0.25	0.00
10/30/13 3:00 PM	0.26	0.26	0.00
10/30/13 5:00 PM	0.24	0.24	0.00
10/30/13 7:00 PM	0.24	0.24	0.00
10/30/13 9:00 PM	0.24	0.24	0.00
10/30/13 11:00 PM	0.20	0.20	0.00
10/31/13 1:00 AM	0.17	0.17	0.00
10/31/13 3:00 AM	0.17	0.17	0.00
10/31/13 5:00 AM	0.20	0.20	0.00
10/31/13 7:00 AM	0.24	0.24	0.00
10/31/13 9:00 AM	0.23	0.23	0.00
10/31/13 11:00 AM	0.24	0.24	0.00
10/31/13 1:00 PM	0.25	0.25	0.00
10/31/13 3:00 PM	0.24	0.24	0.00
10/31/13 5:00 PM	0.24	0.24	0.00
10/31/13 7:00 PM	0.24	0.24	0.00
10/31/13 9:00 PM	0.24	0.24	0.00
10/31/13 11:00 PM	0.24	0.24	0.00
11/1/13 1:00 AM	0.23	0.23	0.00
11/1/13 3:00 AM	0.23	0.23	0.00
11/1/13 5:00 AM	0.22	0.22	0.00
11/1/13 7:00 AM	0.21	0.21	0.00
11/1/13 9:00 AM	0.22	0.22	0.00
11/1/13 11:00 AM	0.22	0.22	0.00
11/1/13 1:00 PM	0.23	0.23	0.00
11/1/13 3:00 PM	0.23	0.23	0.00
11/1/13 5:00 PM	0.24	0.24	0.00
11/1/13 7:00 PM	0.23	0.23	0.00
11/1/13 9:00 PM	0.24	0.24	0.00
11/1/13 11:00 PM	0.24	0.24	0.00
11/2/13 1:00 AM	0.25	0.25	0.00
11/2/13 3:00 AM	0.24	0.24	0.00
11/2/13 5:00 AM	0.24	0.24	0.00
11/2/13 7:00 AM	0.24	0.24	0.00
11/2/13 9:00 AM	0.23	0.23	0.00
11/2/13 11:00 AM	0.23	0.23	0.00
11/2/13 1:00 PM	0.25	0.25	0.00
11/2/13 3:00 PM	0.25	0.25	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
11/2/13 5:00 PM	0.24	0.24	0.00
11/2/13 7:00 PM	0.23	0.23	0.00
11/2/13 9:00 PM	0.23	0.23	0.00
11/2/13 11:00 PM	0.19	0.19	0.00
11/3/13 1:00 AM	0.20	0.20	0.00
11/3/13 3:00 AM	0.21	0.21	0.00
11/3/13 5:00 AM	0.21	0.21	0.00
11/3/13 7:00 AM	0.20	0.20	0.00
11/3/13 9:00 AM	0.25	0.25	0.00
11/3/13 11:00 AM	0.26	0.26	0.00
11/3/13 1:00 PM	0.25	0.25	0.00
11/3/13 3:00 PM	0.24	0.24	0.00
11/3/13 5:00 PM	0.23	0.23	0.00
11/3/13 7:00 PM	0.23	0.23	0.00
11/3/13 9:00 PM	0.23	0.23	0.00
11/3/13 11:00 PM	0.21	0.21	0.00
11/4/13 1:00 AM	0.18	0.18	0.00
11/4/13 3:00 AM	0.20	0.20	0.00
11/4/13 5:00 AM	0.24	0.24	0.00
11/4/13 7:00 AM	0.29	0.29	0.00
11/4/13 9:00 AM	0.40	0.40	0.00
11/4/13 11:00 AM	0.34	0.34	0.00
11/4/13 1:00 PM	0.30	0.30	0.00
11/4/13 3:00 PM	0.27	0.27	0.00
11/4/13 5:00 PM	0.26	0.26	0.00
11/4/13 7:00 PM	0.24	0.24	0.00
11/4/13 9:00 PM	0.22	0.22	0.00
11/4/13 11:00 PM	0.22	0.22	0.00
11/5/13 1:00 AM	0.22	0.22	0.00
11/5/13 3:00 AM	0.22	0.22	0.00
11/5/13 5:00 AM	0.21	0.21	0.01
11/5/13 7:00 AM	0.21	0.21	0.00
11/5/13 9:00 AM	0.25	0.25	0.00
11/5/13 11:00 AM	0.25	0.25	0.00
11/5/13 1:00 PM	0.25	0.25	0.00
11/5/13 3:00 PM	0.25	0.25	0.00
11/5/13 5:00 PM	0.24	0.24	0.00
11/5/13 7:00 PM	0.24	0.24	0.00
11/5/13 9:00 PM	0.23	0.23	0.03
11/5/13 11:00 PM	0.23	0.23	0.13
11/6/13 1:00 AM	0.20	0.20	0.18
11/6/13 3:00 AM	0.20	0.20	0.12
11/6/13 5:00 AM	0.21	0.21	0.12
11/6/13 7:00 AM	0.27	0.27	0.12
11/6/13 9:00 AM	0.27	0.27	0.07
11/6/13 11:00 AM	0.28	0.28	0.18
11/6/13 1:00 PM	0.28	0.28	0.23
11/6/13 3:00 PM	0.29	0.29	0.21
11/6/13 5:00 PM	0.27	0.27	0.21
11/6/13 7:00 PM	0.24	0.24	0.21
11/6/13 9:00 PM	0.21	0.21	0.20
11/6/13 11:00 PM	0.17	0.17	0.20
11/7/13 1:00 AM	0.11	0.11	0.11

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
11/7/13 3:00 AM	0.12	0.12	0.12
11/7/13 5:00 AM	0.18	0.00	0.15
11/7/13 7:00 AM	0.22	0.00	0.19
11/7/13 9:00 AM	0.21	0.00	0.19
11/7/13 11:00 AM	0.22	0.00	0.19
11/7/13 1:00 PM	0.22	0.00	0.59
11/7/13 3:00 PM	0.21	0.00	0.17
11/7/13 5:00 PM	0.21	0.00	0.17
11/7/13 7:00 PM	0.19	0.00	0.16
11/7/13 9:00 PM	0.20	0.00	0.16
11/7/13 11:00 PM	0.20	0.00	0.16
11/8/13 1:00 AM	0.16	0.00	0.16
11/8/13 3:00 AM	0.10	0.00	0.16
11/8/13 5:00 AM	0.09	0.00	0.16
11/8/13 7:00 AM	0.10	0.00	0.16
11/8/13 9:00 AM	0.10	0.00	0.15
11/8/13 11:00 AM	0.10	0.00	0.15
11/8/13 1:00 PM	0.10	0.00	0.15
11/8/13 3:00 PM	0.10	0.00	0.15
11/8/13 5:00 PM	0.09	0.00	0.14
11/8/13 7:00 PM	0.09	0.00	0.13
11/8/13 9:00 PM	0.09	0.00	0.14
11/8/13 11:00 PM	0.09	0.00	0.15
11/9/13 1:00 AM	0.09	0.00	0.15
11/9/13 3:00 AM	0.09	0.00	0.14
11/9/13 5:00 AM	0.08	0.00	0.14
11/9/13 7:00 AM	0.09	0.00	0.16
11/9/13 9:00 AM	0.09	0.00	0.16
11/9/13 11:00 AM	0.09	0.00	0.16
11/9/13 1:00 PM	0.09	0.00	0.17
11/9/13 3:00 PM	0.09	0.00	0.16
11/9/13 5:00 PM	0.09	0.00	0.16
11/9/13 7:00 PM	0.08	0.00	0.16
11/9/13 9:00 PM	0.04	0.00	0.17
11/9/13 11:00 PM	0.00	0.00	0.17
11/10/13 1:00 AM	0.00	0.00	0.17
11/10/13 3:00 AM	0.00	0.00	0.17
11/10/13 5:00 AM	0.00	0.00	0.17
11/10/13 7:00 AM	0.00	0.00	0.17
11/10/13 9:00 AM	0.00	0.00	0.17
11/10/13 11:00 AM	0.01	0.00	0.16
11/10/13 1:00 PM	0.08	0.00	0.16
11/10/13 3:00 PM	0.01	0.00	0.16
11/10/13 5:00 PM	0.03	0.00	0.17
11/10/13 7:00 PM	0.06	0.00	0.16
11/10/13 9:00 PM	0.07	0.00	0.17
11/10/13 11:00 PM	0.08	0.00	0.17
11/11/13 1:00 AM	0.07	0.00	0.17
11/11/13 3:00 AM	0.08	0.00	0.17
11/11/13 5:00 AM	0.07	0.00	0.17
11/11/13 7:00 AM	0.08	0.08	0.17
11/11/13 9:00 AM	0.09	0.09	0.18
11/11/13 11:00 AM	0.09	0.09	0.18

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
11/11/13 1:00 PM	0.10	0.10	0.18
11/11/13 3:00 PM	0.09	0.09	0.18
11/11/13 5:00 PM	0.10	0.10	0.18
11/11/13 7:00 PM	0.18	0.18	0.18
11/11/13 9:00 PM	0.22	0.22	0.17
11/11/13 11:00 PM	0.24	0.24	0.17
11/12/13 1:00 AM	0.21	0.21	0.12
11/12/13 3:00 AM	0.19	0.19	0.13
11/12/13 5:00 AM	0.12	0.12	0.18
11/12/13 7:00 AM	0.13	0.13	0.18
11/12/13 9:00 AM	0.15	0.15	0.19
11/12/13 11:00 AM	0.22	0.00	0.18
11/12/13 1:00 PM	0.24	0.00	0.18
11/12/13 3:00 PM	0.21	0.00	0.17
11/12/13 5:00 PM	0.19	0.00	0.18
11/12/13 7:00 PM	0.19	0.00	0.17
11/12/13 9:00 PM	0.18	0.00	0.17
11/12/13 11:00 PM	0.09	0.00	0.17
11/13/13 1:00 AM	0.10	0.00	0.17
11/13/13 3:00 AM	0.09	0.00	0.11
11/13/13 5:00 AM	0.09	0.00	0.11
11/13/13 7:00 AM	0.09	0.00	0.18
11/13/13 9:00 AM	0.08	0.00	0.19
11/13/13 11:00 AM	0.10	0.00	0.19
11/13/13 1:00 PM	0.14	0.00	0.19
11/13/13 3:00 PM	0.16	0.00	0.19
11/13/13 5:00 PM	0.11	0.00	0.19
11/13/13 7:00 PM	0.09	0.00	0.27
11/13/13 9:00 PM	0.08	0.00	0.66
11/13/13 11:00 PM	0.09	0.00	0.68
11/14/13 1:00 AM	0.08	0.00	0.31
11/14/13 3:00 AM	0.07	0.00	0.26
11/14/13 5:00 AM	0.07	0.00	0.21
11/14/13 7:00 AM	0.08	0.00	0.21
11/14/13 9:00 AM	0.10	0.00	0.22
11/14/13 11:00 AM	0.09	0.00	0.22
11/14/13 1:00 PM	0.11	0.00	0.21
11/14/13 3:00 PM	0.11	0.00	0.21
11/14/13 5:00 PM	0.12	0.00	0.21
11/14/13 7:00 PM	0.12	0.00	0.21
11/14/13 9:00 PM	0.11	0.00	0.21
11/14/13 11:00 PM	0.10	0.00	0.21
11/15/13 1:00 AM	0.09	0.00	0.11
11/15/13 3:00 AM	0.10	0.00	0.04
11/15/13 5:00 AM	0.10	0.00	0.04
11/15/13 7:00 AM	0.12	0.00	0.21
11/15/13 9:00 AM	0.12	0.00	0.24
11/15/13 11:00 AM	0.11	0.00	0.25
11/15/13 1:00 PM	0.12	0.00	0.23
11/15/13 3:00 PM	0.12	0.00	0.24
11/15/13 5:00 PM	0.11	0.00	0.25
11/15/13 7:00 PM	0.11	0.00	0.25
11/15/13 9:00 PM	0.12	0.00	0.26

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
11/15/13 11:00 PM	0.10	0.00	0.21
11/16/13 1:00 AM	0.09	0.00	0.13
11/16/13 3:00 AM	0.09	0.00	0.08
11/16/13 5:00 AM	0.08	0.00	0.07
11/16/13 7:00 AM	0.10	0.00	0.07
11/16/13 9:00 AM	0.13	0.00	0.23
11/16/13 11:00 AM	0.14	0.00	0.26
11/16/13 1:00 PM	0.15	0.00	0.24
11/16/13 3:00 PM	0.15	0.00	0.25
11/16/13 5:00 PM	0.14	0.00	0.25
11/16/13 7:00 PM	0.13	0.00	0.25
11/16/13 9:00 PM	0.14	0.00	0.25
11/16/13 11:00 PM	0.14	0.00	0.23
11/17/13 1:00 AM	0.10	0.00	0.16
11/17/13 3:00 AM	0.08	0.00	0.13
11/17/13 5:00 AM	0.08	0.00	0.12
11/17/13 7:00 AM	0.10	0.00	0.14
11/17/13 9:00 AM	0.14	0.00	0.26
11/17/13 11:00 AM	0.15	0.00	0.25
11/17/13 1:00 PM	0.14	0.00	0.25
11/17/13 3:00 PM	0.15	0.00	0.25
11/17/13 5:00 PM	0.15	0.00	0.24
11/17/13 7:00 PM	0.15	0.00	0.23
11/17/13 9:00 PM	0.14	0.00	0.23
11/17/13 11:00 PM	0.14	0.00	0.23
11/18/13 1:00 AM	0.17	0.17	0.23
11/18/13 3:00 AM	0.16	0.00	0.23
11/18/13 5:00 AM	0.18	0.00	0.22
11/18/13 7:00 AM	0.18	0.18	0.21
11/18/13 9:00 AM	0.19	0.19	0.20
11/18/13 11:00 AM	0.22	0.22	0.19
11/18/13 1:00 PM	0.20	0.20	0.19
11/18/13 3:00 PM	0.22	0.22	0.18
11/18/13 5:00 PM	0.20	0.20	0.19
11/18/13 7:00 PM	0.20	0.20	0.19
11/18/13 9:00 PM	0.28	0.28	0.18
11/18/13 11:00 PM	0.31	0.31	0.18
11/19/13 1:00 AM	0.27	0.27	0.18
11/19/13 3:00 AM	0.27	0.27	0.18
11/19/13 5:00 AM	0.23	0.23	0.17
11/19/13 7:00 AM	0.27	0.27	0.17
11/19/13 9:00 AM	0.29	0.29	0.17
11/19/13 11:00 AM	0.26	0.26	0.16
11/19/13 1:00 PM	0.26	0.26	0.16
11/19/13 3:00 PM	0.24	0.24	0.17
11/19/13 5:00 PM	0.23	0.23	0.16
11/19/13 7:00 PM	0.20	0.20	0.16
11/19/13 9:00 PM	0.21	0.21	0.17
11/19/13 11:00 PM	0.22	0.22	0.15
11/20/13 1:00 AM	0.21	0.21	0.05
11/20/13 3:00 AM	0.20	0.20	0.04
11/20/13 5:00 AM	0.21	0.21	0.10
11/20/13 7:00 AM	0.23	0.23	0.18

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
11/20/13 9:00 AM	0.21	0.21	0.19
11/20/13 11:00 AM	0.23	0.23	0.19
11/20/13 1:00 PM	0.23	0.23	0.19
11/20/13 3:00 PM	0.23	0.23	0.19
11/20/13 5:00 PM	0.22	0.22	0.19
11/20/13 7:00 PM	0.21	0.21	0.15
11/20/13 9:00 PM	0.22	0.22	0.07
11/20/13 11:00 PM	0.24	0.24	0.14
11/21/13 1:00 AM	0.20	0.20	0.19
11/21/13 3:00 AM	0.20	0.20	0.13
11/21/13 5:00 AM	0.20	0.20	0.13
11/21/13 7:00 AM	0.22	0.22	0.19
11/21/13 9:00 AM	0.19	0.19	0.19
11/21/13 11:00 AM	0.21	0.21	0.19
11/21/13 1:00 PM	0.22	0.22	0.19
11/21/13 3:00 PM	0.19	0.19	0.21
11/21/13 5:00 PM	0.19	0.19	0.20
11/21/13 7:00 PM	0.16	0.16	0.19
11/21/13 9:00 PM	0.15	0.15	0.19
11/21/13 11:00 PM	0.11	0.11	0.18
11/22/13 1:00 AM	0.11	0.11	0.18
11/22/13 3:00 AM	0.00	0.09	0.18
11/22/13 5:00 AM	0.00	0.09	0.18
11/22/13 7:00 AM	0.00	0.12	0.18
11/22/13 9:00 AM	0.00	0.12	0.18
11/22/13 11:00 AM	0.00	0.11	0.18
11/22/13 1:00 PM	0.00	0.12	0.17
11/22/13 3:00 PM	0.00	0.12	0.18
11/22/13 5:00 PM	0.00	0.14	0.18
11/22/13 7:00 PM	0.00	0.14	0.18
11/22/13 9:00 PM	0.00	0.14	0.18
11/22/13 11:00 PM	0.00	0.14	0.24
11/23/13 1:00 AM	0.00	0.14	0.25
11/23/13 3:00 AM	0.00	0.11	0.27
11/23/13 5:00 AM	0.00	0.10	0.18
11/23/13 7:00 AM	0.00	0.10	0.18
11/23/13 9:00 AM	0.00	0.09	0.18
11/23/13 11:00 AM	0.00	0.09	0.19
11/23/13 1:00 PM	0.00	0.08	0.19
11/23/13 3:00 PM	0.00	0.09	0.19
11/23/13 5:00 PM	0.00	0.09	0.22
11/23/13 7:00 PM	0.00	0.10	0.20
11/23/13 9:00 PM	0.00	0.03	0.19
11/23/13 11:00 PM	0.00	0.01	0.19
11/24/13 1:00 AM	0.00	0.00	0.19
11/24/13 3:00 AM	0.00	0.00	0.19
11/24/13 5:00 AM	0.00	0.00	0.19
11/24/13 7:00 AM	0.00	0.00	0.19
11/24/13 9:00 AM	0.00	0.00	0.19
11/24/13 11:00 AM	0.00	0.00	0.20
11/24/13 1:00 PM	0.00	0.00	0.22
11/24/13 3:00 PM	0.00	0.00	0.24
11/24/13 5:00 PM	0.00	0.00	0.27

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
11/24/13 7:00 PM	0.00	0.00	0.26
11/24/13 9:00 PM	0.00	0.00	0.25
11/24/13 11:00 PM	0.00	0.00	0.25
11/25/13 1:00 AM	0.00	0.00	0.24
11/25/13 3:00 AM	0.00	0.11	0.25
11/25/13 5:00 AM	0.00	0.01	0.26
11/25/13 7:00 AM	0.00	0.06	0.27
11/25/13 9:00 AM	0.00	0.02	0.27
11/25/13 11:00 AM	0.00	0.03	0.26
11/25/13 1:00 PM	0.00	0.05	0.21
11/25/13 3:00 PM	0.00	0.09	0.20
11/25/13 5:00 PM	0.00	0.10	0.19
11/25/13 7:00 PM	0.00	0.10	0.19
11/25/13 9:00 PM	0.00	0.10	0.19
11/25/13 11:00 PM	0.00	0.10	0.19
11/26/13 1:00 AM	0.00	0.11	0.19
11/26/13 3:00 AM	0.00	0.11	0.18
11/26/13 5:00 AM	0.00	0.12	0.17
11/26/13 7:00 AM	0.00	0.13	0.21
11/26/13 9:00 AM	0.00	0.12	0.29
11/26/13 11:00 AM	0.00	0.10	0.25
11/26/13 1:00 PM	0.00	0.11	0.21
11/26/13 3:00 PM	0.00	0.11	0.19
11/26/13 5:00 PM	0.00	0.11	0.20
11/26/13 7:00 PM	0.00	0.11	0.20
11/26/13 9:00 PM	0.00	0.11	0.19
11/26/13 11:00 PM	0.00	0.12	0.19
11/27/13 1:00 AM	0.00	0.11	0.20
11/27/13 3:00 AM	0.00	0.09	0.20
11/27/13 5:00 AM	0.00	0.11	0.19
11/27/13 7:00 AM	0.00	0.13	0.19
11/27/13 9:00 AM	0.00	0.11	0.18
11/27/13 11:00 AM	0.00	0.11	0.18
11/27/13 1:00 PM	0.16	0.16	0.19
11/27/13 3:00 PM	0.17	0.17	0.20
11/27/13 5:00 PM	0.15	0.15	0.19
11/27/13 7:00 PM	0.17	0.17	0.19
11/27/13 9:00 PM	0.17	0.17	0.24
11/27/13 11:00 PM	0.18	0.18	0.33
11/28/13 1:00 AM	0.18	0.18	0.21
11/28/13 3:00 AM	0.21	0.21	0.16
11/28/13 5:00 AM	0.27	0.27	0.34
11/28/13 7:00 AM	0.23	0.23	0.23
11/28/13 9:00 AM	0.21	0.21	0.21
11/28/13 11:00 AM	0.20	0.20	0.20
11/28/13 1:00 PM	0.23	0.23	0.19
11/28/13 3:00 PM	0.18	0.18	0.14
11/28/13 5:00 PM	0.17	0.17	0.12
11/28/13 7:00 PM	0.16	0.16	0.13
11/28/13 9:00 PM	0.13	0.13	0.11
11/28/13 11:00 PM	0.17	0.17	0.11
11/29/13 1:00 AM	0.19	0.19	0.11
11/29/13 3:00 AM	0.16	0.16	0.11

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
11/29/13 5:00 AM	0.16	0.16	0.11
11/29/13 7:00 AM	0.20	0.20	0.11
11/29/13 9:00 AM	0.22	0.22	0.14
11/29/13 11:00 AM	0.24	0.24	0.16
11/29/13 1:00 PM	0.21	0.21	0.14
11/29/13 3:00 PM	0.20	0.20	0.14
11/29/13 5:00 PM	0.19	0.19	0.14
11/29/13 7:00 PM	0.20	0.20	0.16
11/29/13 9:00 PM	0.19	0.19	0.12
11/29/13 11:00 PM	0.20	0.20	0.08
11/30/13 1:00 AM	0.17	0.17	0.06
11/30/13 3:00 AM	0.16	0.16	0.07
11/30/13 5:00 AM	0.17	0.17	0.07
11/30/13 7:00 AM	0.22	0.22	0.10
11/30/13 9:00 AM	0.26	0.26	0.18
11/30/13 11:00 AM	0.26	0.26	0.22
11/30/13 1:00 PM	0.22	0.22	0.27
11/30/13 3:00 PM	0.24	0.24	0.17
11/30/13 5:00 PM	0.24	0.24	0.16
11/30/13 7:00 PM	0.25	0.25	0.14
11/30/13 9:00 PM	0.23	0.23	0.07
11/30/13 11:00 PM	0.20	0.20	0.08
12/1/13 1:00 AM	0.20	0.20	0.07
12/1/13 3:00 AM	0.20	0.20	0.07
12/1/13 5:00 AM	0.20	0.20	0.08
12/1/13 7:00 AM	0.23	0.23	0.08
12/1/13 9:00 AM	0.22	0.22	0.09
12/1/13 11:00 AM	0.24	0.24	0.30
12/1/13 1:00 PM	0.23	0.23	0.27
12/1/13 3:00 PM	0.23	0.23	0.26
12/1/13 5:00 PM	0.23	0.23	0.25
12/1/13 7:00 PM	0.23	0.23	0.24
12/1/13 9:00 PM	0.24	0.24	0.24
12/1/13 11:00 PM	0.22	0.22	0.14
12/2/13 1:00 AM	0.23	0.23	0.06
12/2/13 3:00 AM	0.22	0.22	0.05
12/2/13 5:00 AM	0.22	0.22	0.06
12/2/13 7:00 AM	0.28	0.28	0.32
12/2/13 9:00 AM	0.31	0.31	0.37
12/2/13 11:00 AM	0.28	0.28	0.25
12/2/13 1:00 PM	0.30	0.30	0.21
12/2/13 3:00 PM	0.24	0.24	0.22
12/2/13 5:00 PM	0.25	0.25	0.22
12/2/13 7:00 PM	0.27	0.27	0.22
12/2/13 9:00 PM	0.25	0.25	0.22
12/2/13 11:00 PM	0.22	0.22	0.07
12/3/13 1:00 AM	0.22	0.22	0.05
12/3/13 3:00 AM	0.23	0.23	0.05
12/3/13 5:00 AM	0.21	0.21	0.05
12/3/13 7:00 AM	0.24	0.24	0.12
12/3/13 9:00 AM	0.22	0.22	0.19
12/3/13 11:00 AM	0.23	0.23	0.29
12/3/13 1:00 PM	0.26	0.26	0.24

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
12/3/13 3:00 PM	0.24	0.24	0.23
12/3/13 5:00 PM	0.26	0.26	0.23
12/3/13 7:00 PM	0.27	0.27	0.22
12/3/13 9:00 PM	0.24	0.24	0.22
12/3/13 11:00 PM	0.24	0.24	0.16
12/4/13 1:00 AM	0.20	0.20	0.06
12/4/13 3:00 AM	0.19	0.19	0.06
12/4/13 5:00 AM	0.20	0.20	0.07
12/4/13 7:00 AM	0.32	0.32	0.08
12/4/13 9:00 AM	0.27	0.27	0.19
12/4/13 11:00 AM	0.24	0.24	0.25
12/4/13 1:00 PM	0.25	0.25	0.24
12/4/13 3:00 PM	0.25	0.25	0.23
12/4/13 5:00 PM	0.24	0.24	0.23
12/4/13 7:00 PM	0.24	0.24	0.23
12/4/13 9:00 PM	0.22	0.22	0.22
12/4/13 11:00 PM	0.17	0.17	0.20
12/5/13 1:00 AM	0.18	0.18	0.10
12/5/13 3:00 AM	0.18	0.18	0.09
12/5/13 5:00 AM	0.17	0.17	0.13
12/5/13 7:00 AM	0.24	0.24	0.23
12/5/13 9:00 AM	0.22	0.22	0.29
12/5/13 11:00 AM	0.26	0.26	0.28
12/5/13 1:00 PM	0.25	0.25	0.28
12/5/13 3:00 PM	0.23	0.23	0.27
12/5/13 5:00 PM	0.25	0.25	0.26
12/5/13 7:00 PM	0.23	0.23	0.22
12/5/13 9:00 PM	0.25	0.25	0.22
12/5/13 11:00 PM	0.22	0.22	0.22
12/6/13 1:00 AM	0.21	0.21	0.16
12/6/13 3:00 AM	0.20	0.20	0.16
12/6/13 5:00 AM	0.18	0.18	0.17
12/6/13 7:00 AM	0.24	0.24	0.25
12/6/13 9:00 AM	0.23	0.23	0.24
12/6/13 11:00 AM	0.23	0.23	0.25
12/6/13 1:00 PM	0.24	0.24	0.23
12/6/13 3:00 PM	0.21	0.21	0.23
12/6/13 5:00 PM	0.19	0.19	0.23
12/6/13 7:00 PM	0.27	0.27	0.23
12/6/13 9:00 PM	0.30	0.30	0.24
12/6/13 11:00 PM	0.24	0.24	0.23
12/7/13 1:00 AM	0.24	0.24	0.15
12/7/13 3:00 AM	0.25	0.25	0.12
12/7/13 5:00 AM	0.26	0.26	0.14
12/7/13 7:00 AM	0.28	0.28	0.29
12/7/13 9:00 AM	0.30	0.30	0.25
12/7/13 11:00 AM	0.27	0.27	0.23
12/7/13 1:00 PM	0.33	0.33	0.22
12/7/13 3:00 PM	0.28	0.28	0.22
12/7/13 5:00 PM	0.26	0.26	0.24
12/7/13 7:00 PM	0.26	0.26	0.24
12/7/13 9:00 PM	0.25	0.25	0.23
12/7/13 11:00 PM	0.26	0.26	0.20

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
12/8/13 1:00 AM	0.27	0.27	0.11
12/8/13 3:00 AM	0.23	0.23	0.09
12/8/13 5:00 AM	0.25	0.25	0.08
12/8/13 7:00 AM	0.29	0.29	0.08
12/8/13 9:00 AM	0.38	0.38	0.14
12/8/13 11:00 AM	0.35	0.35	0.25
12/8/13 1:00 PM	0.27	0.27	0.24
12/8/13 3:00 PM	0.21	0.21	0.24
12/8/13 5:00 PM	0.21	0.21	0.23
12/8/13 7:00 PM	0.21	0.21	0.23
12/8/13 9:00 PM	0.22	0.22	0.22
12/8/13 11:00 PM	0.23	0.23	0.21
12/9/13 1:00 AM	0.22	0.22	0.18
12/9/13 3:00 AM	0.17	0.17	0.15
12/9/13 5:00 AM	0.20	0.20	0.18
12/9/13 7:00 AM	0.23	0.23	0.21
12/9/13 9:00 AM	0.25	0.25	0.21
12/9/13 11:00 AM	0.25	0.25	0.21
12/9/13 1:00 PM	0.25	0.25	0.21
12/9/13 3:00 PM	0.31	0.31	0.22
12/9/13 5:00 PM	0.31	0.31	0.23
12/9/13 7:00 PM	0.26	0.26	0.22
12/9/13 9:00 PM	0.24	0.24	0.21
12/9/13 11:00 PM	0.23	0.23	0.20
12/10/13 1:00 AM	0.23	0.23	0.17
12/10/13 3:00 AM	0.20	0.20	0.11
12/10/13 5:00 AM	0.22	0.22	0.15
12/10/13 7:00 AM	0.25	0.25	0.20
12/10/13 9:00 AM	0.24	0.24	0.22
12/10/13 11:00 AM	0.27	0.27	0.22
12/10/13 1:00 PM	0.27	0.27	0.23
12/10/13 3:00 PM	0.27	0.27	0.23
12/10/13 5:00 PM	0.23	0.23	0.24
12/10/13 7:00 PM	0.23	0.00	0.22
12/10/13 9:00 PM	0.23	0.00	0.22
12/10/13 11:00 PM	0.22	0.00	0.21
12/11/13 1:00 AM	0.22	0.00	0.22
12/11/13 3:00 AM	0.23	0.00	0.23
12/11/13 5:00 AM	0.26	0.00	0.24
12/11/13 7:00 AM	0.29	0.00	0.24
12/11/13 9:00 AM	0.27	0.00	0.24
12/11/13 11:00 AM	0.25	0.00	0.24
12/11/13 1:00 PM	0.24	0.00	0.25
12/11/13 3:00 PM	0.25	0.00	0.24
12/11/13 5:00 PM	0.25	0.00	0.25
12/11/13 7:00 PM	0.29	0.00	0.26
12/11/13 9:00 PM	0.33	0.00	0.25
12/11/13 11:00 PM	0.30	0.00	0.25
12/12/13 1:00 AM	0.32	0.00	0.25
12/12/13 3:00 AM	0.32	0.00	0.25
12/12/13 5:00 AM	0.34	0.00	0.24
12/12/13 7:00 AM	0.25	0.00	0.24
12/12/13 9:00 AM	0.16	0.00	0.25

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
12/12/13 11:00 AM	0.19	0.00	0.25
12/12/13 1:00 PM	0.23	0.00	0.21
12/12/13 3:00 PM	0.19	0.00	0.20
12/12/13 5:00 PM	0.19	0.00	0.19
12/12/13 7:00 PM	0.17	0.00	0.19
12/12/13 9:00 PM	0.14	0.00	0.21
12/12/13 11:00 PM	0.05	0.00	0.22
12/13/13 1:00 AM	0.00	0.00	0.15
12/13/13 3:00 AM	0.00	0.00	0.11
12/13/13 5:00 AM	0.00	0.00	0.16
12/13/13 7:00 AM	0.00	0.00	0.24
12/13/13 9:00 AM	0.00	0.00	0.24
12/13/13 11:00 AM	0.00	0.00	0.23
12/13/13 1:00 PM	0.00	0.00	0.23
12/13/13 3:00 PM	0.00	0.00	0.22
12/13/13 5:00 PM	0.00	0.00	0.23
12/13/13 7:00 PM	0.00	0.00	0.22
12/13/13 9:00 PM	0.00	0.00	0.23
12/13/13 11:00 PM	0.00	0.00	0.24
12/14/13 1:00 AM	0.00	0.00	0.24
12/14/13 3:00 AM	0.00	0.00	0.24
12/14/13 5:00 AM	0.00	0.00	0.24
12/14/13 7:00 AM	0.00	0.00	0.24
12/14/13 9:00 AM	0.00	0.00	0.24
12/14/13 11:00 AM	0.00	0.22	0.23
12/14/13 1:00 PM	0.00	0.01	0.23
12/14/13 3:00 PM	0.00	0.00	0.23
12/14/13 5:00 PM	0.00	0.03	0.23
12/14/13 7:00 PM	0.09	0.09	0.23
12/14/13 9:00 PM	0.15	0.15	0.23
12/14/13 11:00 PM	0.15	0.15	0.24
12/15/13 1:00 AM	0.35	0.35	0.25
12/15/13 3:00 AM	0.24	0.24	0.22
12/15/13 5:00 AM	0.15	0.15	0.18
12/15/13 7:00 AM	0.16	0.16	0.20
12/15/13 9:00 AM	0.17	0.17	0.24
12/15/13 11:00 AM	0.19	0.19	0.24
12/15/13 1:00 PM	0.19	0.19	0.23
12/15/13 3:00 PM	0.24	0.24	0.22
12/15/13 5:00 PM	0.18	0.18	0.22
12/15/13 7:00 PM	0.19	0.19	0.22
12/15/13 9:00 PM	0.24	0.24	0.22
12/15/13 11:00 PM	0.23	0.23	0.15
12/16/13 1:00 AM	0.21	0.21	0.12
12/16/13 3:00 AM	0.21	0.21	0.09
12/16/13 5:00 AM	0.20	0.20	0.10
12/16/13 7:00 AM	0.21	0.21	0.22
12/16/13 9:00 AM	0.14	0.14	0.10
12/16/13 11:00 AM	0.22	0.22	0.05
12/16/13 1:00 PM	0.26	0.00	0.20
12/16/13 3:00 PM	0.21	0.00	0.18
12/16/13 5:00 PM	0.20	0.00	0.19
12/16/13 7:00 PM	0.21	0.00	0.18

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
12/16/13 9:00 PM	0.21	0.00	0.17
12/16/13 11:00 PM	0.21	0.00	0.16
12/17/13 1:00 AM	0.21	0.00	0.16
12/17/13 3:00 AM	0.17	0.00	0.16
12/17/13 5:00 AM	0.12	0.00	0.17
12/17/13 7:00 AM	0.13	0.00	0.17
12/17/13 9:00 AM	0.14	0.00	0.08
12/17/13 11:00 AM	0.15	0.00	0.03
12/17/13 1:00 PM	0.17	0.00	0.02
12/17/13 3:00 PM	0.16	0.00	0.03
12/17/13 5:00 PM	0.18	0.00	0.20
12/17/13 7:00 PM	0.18	0.00	0.20
12/17/13 9:00 PM	0.17	0.00	0.19
12/17/13 11:00 PM	0.18	0.00	0.19
12/18/13 1:00 AM	0.17	0.17	0.19
12/18/13 3:00 AM	0.17	0.17	0.18
12/18/13 5:00 AM	0.16	0.16	0.18
12/18/13 7:00 AM	0.20	0.20	0.17
12/18/13 9:00 AM	0.20	0.20	0.17
12/18/13 11:00 AM	0.24	0.24	0.15
12/18/13 1:00 PM	0.27	0.27	0.18
12/18/13 3:00 PM	0.28	0.28	0.18
12/18/13 5:00 PM	0.29	0.29	0.19
12/18/13 7:00 PM	0.25	0.25	0.12
12/18/13 9:00 PM	0.26	0.26	0.10
12/18/13 11:00 PM	0.23	0.23	0.16
12/19/13 1:00 AM	0.22	0.22	0.17
12/19/13 3:00 AM	0.22	0.22	0.18
12/19/13 5:00 AM	0.22	0.22	0.18
12/19/13 7:00 AM	0.25	0.25	0.20
12/19/13 9:00 AM	0.27	0.27	0.22
12/19/13 11:00 AM	0.29	0.29	0.23
12/19/13 1:00 PM	0.25	0.25	0.22
12/19/13 3:00 PM	0.29	0.29	0.21
12/19/13 5:00 PM	0.27	0.27	0.21
12/19/13 7:00 PM	0.28	0.28	0.21
12/19/13 9:00 PM	0.24	0.24	0.21
12/19/13 11:00 PM	0.27	0.27	0.21
12/20/13 1:00 AM	0.26	0.26	0.15
12/20/13 3:00 AM	0.24	0.24	0.14
12/20/13 5:00 AM	0.22	0.22	0.20
12/20/13 7:00 AM	0.25	0.25	0.22
12/20/13 9:00 AM	0.21	0.21	0.22
12/20/13 11:00 AM	0.23	0.23	0.23
12/20/13 1:00 PM	0.26	0.26	0.23
12/20/13 3:00 PM	0.26	0.26	0.23
12/20/13 5:00 PM	0.27	0.27	0.23
12/20/13 7:00 PM	0.24	0.24	0.21
12/20/13 9:00 PM	0.29	0.29	0.22
12/20/13 11:00 PM	0.29	0.29	0.24
12/21/13 1:00 AM	0.25	0.25	0.25
12/21/13 3:00 AM	0.28	0.00	0.18
12/21/13 5:00 AM	0.28	0.00	0.20

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
12/21/13 7:00 AM	0.28	0.00	0.24
12/21/13 9:00 AM	0.31	0.00	0.36
12/21/13 11:00 AM	0.27	0.00	0.35
12/21/13 1:00 PM	0.27	0.00	0.28
12/21/13 3:00 PM	0.24	0.00	0.25
12/21/13 5:00 PM	0.20	0.00	0.24
12/21/13 7:00 PM	0.21	0.00	0.24
12/21/13 9:00 PM	0.20	0.00	0.24
12/21/13 11:00 PM	0.21	0.00	0.24
12/22/13 1:00 AM	0.18	0.00	0.22
12/22/13 3:00 AM	0.19	0.00	0.11
12/22/13 5:00 AM	0.19	0.00	0.11
12/22/13 7:00 AM	0.25	0.00	0.19
12/22/13 9:00 AM	0.27	0.00	0.28
12/22/13 11:00 AM	0.25	0.00	0.28
12/22/13 1:00 PM	0.22	0.00	0.27
12/22/13 3:00 PM	0.25	0.00	0.26
12/22/13 5:00 PM	0.24	0.00	0.26
12/22/13 7:00 PM	0.23	0.00	0.26
12/22/13 9:00 PM	0.26	0.00	0.27
12/22/13 11:00 PM	0.27	0.00	0.27
12/23/13 1:00 AM	0.26	0.00	0.28
12/23/13 3:00 AM	0.29	0.00	0.26
12/23/13 5:00 AM	0.25	0.00	0.21
12/23/13 7:00 AM	0.31	0.00	0.21
12/23/13 9:00 AM	0.38	0.00	0.23
12/23/13 11:00 AM	0.30	0.00	0.23
12/23/13 1:00 PM	0.27	0.00	0.22
12/23/13 3:00 PM	0.30	0.00	0.22
12/23/13 5:00 PM	0.35	0.00	0.22
12/23/13 7:00 PM	0.32	0.00	0.23
12/23/13 9:00 PM	0.19	0.00	0.24
12/23/13 11:00 PM	0.00	0.00	0.24
12/24/13 1:00 AM	0.00	0.00	0.23
12/24/13 3:00 AM	0.00	0.00	0.18
12/24/13 5:00 AM	0.00	0.00	0.15
12/24/13 7:00 AM	0.00	0.00	0.18
12/24/13 9:00 AM	0.00	0.00	0.21
12/24/13 11:00 AM	0.00	0.00	0.22
12/24/13 1:00 PM	0.00	0.00	0.23
12/24/13 3:00 PM	0.00	0.00	0.22
12/24/13 5:00 PM	0.00	0.00	0.23
12/24/13 7:00 PM	0.00	0.00	0.22
12/24/13 9:00 PM	0.00	0.00	0.22
12/24/13 11:00 PM	0.00	0.00	0.22
12/25/13 1:00 AM	0.00	0.00	0.20
12/25/13 3:00 AM	0.00	0.00	0.12
12/25/13 5:00 AM	0.00	0.00	0.12
12/25/13 7:00 AM	0.00	0.00	0.17
12/25/13 9:00 AM	0.00	0.00	0.22
12/25/13 11:00 AM	0.00	0.00	0.22
12/25/13 1:00 PM	0.00	0.00	0.22
12/25/13 3:00 PM	0.00	0.00	0.22

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
12/25/13 5:00 PM	0.00	0.00	0.22
12/25/13 7:00 PM	0.00	0.00	0.23
12/25/13 9:00 PM	0.00	0.14	0.22
12/25/13 11:00 PM	0.00	0.01	0.22
12/26/13 1:00 AM	0.00	0.00	0.22
12/26/13 3:00 AM	0.00	0.06	0.14
12/26/13 5:00 AM	0.00	0.06	0.10
12/26/13 7:00 AM	0.00	0.06	0.10
12/26/13 9:00 AM	0.00	0.06	0.19
12/26/13 11:00 AM	0.00	0.08	0.21
12/26/13 1:00 PM	0.00	0.15	0.21
12/26/13 3:00 PM	0.00	0.21	0.21
12/26/13 5:00 PM	0.00	0.26	0.21
12/26/13 7:00 PM	0.00	0.27	0.21
12/26/13 9:00 PM	0.00	0.26	0.21
12/26/13 11:00 PM	0.00	0.26	0.22
12/27/13 1:00 AM	0.00	0.24	0.19
12/27/13 3:00 AM	0.00	0.21	0.11
12/27/13 5:00 AM	0.00	0.21	0.09
12/27/13 7:00 AM	0.00	0.19	0.22
12/27/13 9:00 AM	0.00	0.17	0.22
12/27/13 11:00 AM	0.00	0.17	0.21
12/27/13 1:00 PM	0.00	0.14	0.22
12/27/13 3:00 PM	0.00	0.13	0.21
12/27/13 5:00 PM	0.00	0.11	0.20
12/27/13 7:00 PM	0.00	0.10	0.22
12/27/13 9:00 PM	0.00	0.10	0.22
12/27/13 11:00 PM	0.00	0.09	0.21
12/28/13 1:00 AM	0.00	0.10	0.21
12/28/13 3:00 AM	0.00	0.10	0.20
12/28/13 5:00 AM	0.00	0.12	0.16
12/28/13 7:00 AM	0.00	0.13	0.14
12/28/13 9:00 AM	0.18	0.18	0.12
12/28/13 11:00 AM	0.18	0.18	0.11
12/28/13 1:00 PM	0.18	0.18	0.06
12/28/13 3:00 PM	0.17	0.17	0.06
12/28/13 5:00 PM	0.15	0.15	0.06
12/28/13 7:00 PM	0.15	0.15	0.07
12/28/13 9:00 PM	0.22	0.22	0.07
12/28/13 11:00 PM	0.22	0.22	0.08
12/29/13 1:00 AM	0.23	0.23	0.08
12/29/13 3:00 AM	0.18	0.18	0.09
12/29/13 5:00 AM	0.18	0.18	0.11
12/29/13 7:00 AM	0.22	0.22	0.12
12/29/13 9:00 AM	0.26	0.26	0.10
12/29/13 11:00 AM	0.23	0.23	0.11
12/29/13 1:00 PM	0.21	0.21	0.02
12/29/13 3:00 PM	0.21	0.21	0.00
12/29/13 5:00 PM	0.19	0.19	0.00
12/29/13 7:00 PM	0.20	0.20	0.00
12/29/13 9:00 PM	0.20	0.20	0.00
12/29/13 11:00 PM	0.19	0.19	0.00
12/30/13 1:00 AM	0.19	0.19	0.00

Date	Unit 1 SO2 2hr lb/mmBtuAvg	Unit 2 SO2 2hr lb/mmBtuAvg	Unit 3 SO2 2hr lb/mmBtuAvg
12/30/13 3:00 AM	0.18	0.18	0.00
12/30/13 5:00 AM	0.19	0.19	0.00
12/30/13 7:00 AM	0.21	0.21	0.00
12/30/13 9:00 AM	0.19	0.19	0.00
12/30/13 11:00 AM	0.19	0.19	0.00
12/30/13 1:00 PM	0.22	0.22	0.00
12/30/13 3:00 PM	0.24	0.24	0.00
12/30/13 5:00 PM	0.20	0.20	0.00
12/30/13 7:00 PM	0.19	0.19	0.00
12/30/13 9:00 PM	0.19	0.19	0.00
12/30/13 11:00 PM	0.19	0.19	0.00
12/31/13 1:00 AM	0.19	0.19	0.00
12/31/13 3:00 AM	0.19	0.19	0.00
12/31/13 5:00 AM	0.17	0.17	0.00
12/31/13 7:00 AM	0.18	0.18	0.15
12/31/13 9:00 AM	0.18	0.18	0.29
12/31/13 11:00 AM	0.18	0.18	0.44
12/31/13 1:00 PM	0.18	0.18	0.26
12/31/13 3:00 PM	0.18	0.18	0.24
12/31/13 5:00 PM	0.19	0.19	0.22
12/31/13 7:00 PM	0.18	0.18	0.21
12/31/13 9:00 PM	0.18	0.18	0.20
12/31/13 11:00 PM	0.19	0.19	0.17
Average	0.17	0.16	0.13
Unit (Peak)	2.56	2.56	1.84
Limit	6.50	6.50	6.50

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
1/1/09 2:00 AM	0.13	0.35	0.47
1/1/09 5:00 AM	0.13	0.33	0.46
1/1/09 8:00 AM	0.14	0.24	0.38
1/1/09 11:00 AM	0.27	0.26	0.53
1/1/09 2:00 PM	0.27	0.24	0.52
1/1/09 5:00 PM	0.27	0.25	0.51
1/1/09 8:00 PM	0.26	0.23	0.49
1/1/09 11:00 PM	0.25	0.22	0.47
1/2/09 2:00 AM	0.21	0.14	0.35
1/2/09 5:00 AM	0.20	0.16	0.35
1/2/09 8:00 AM	0.25	0.19	0.44
1/2/09 11:00 AM	0.26	0.17	0.44
1/2/09 2:00 PM	0.24	0.15	0.39
1/2/09 5:00 PM	0.23	0.15	0.38
1/2/09 8:00 PM	0.24	0.16	0.40
1/2/09 11:00 PM	0.22	0.17	0.39
1/3/09 2:00 AM	0.10	0.16	0.26
1/3/09 5:00 AM	0.07	0.13	0.20
1/3/09 8:00 AM	0.14	0.17	0.31
1/3/09 11:00 AM	0.21	0.17	0.38
1/3/09 2:00 PM	0.21	0.15	0.36
1/3/09 5:00 PM	0.20	0.15	0.36
1/3/09 8:00 PM	0.20	0.15	0.35
1/3/09 11:00 PM	0.19	0.15	0.34
1/4/09 2:00 AM	0.14	0.12	0.26
1/4/09 5:00 AM	0.14	0.10	0.24
1/4/09 8:00 AM	0.16	0.10	0.26
1/4/09 11:00 AM	0.21	0.12	0.33
1/4/09 2:00 PM	0.21	0.13	0.35
1/4/09 5:00 PM	0.21	0.13	0.34
1/4/09 8:00 PM	0.21	0.12	0.33
1/4/09 11:00 PM	0.20	0.13	0.34
1/5/09 2:00 AM	0.19	0.15	0.34
1/5/09 5:00 AM	0.17	0.13	0.30
1/5/09 8:00 AM	0.19	0.15	0.34
1/5/09 11:00 AM	0.21	0.13	0.34
1/5/09 2:00 PM	0.28	0.13	0.41
1/5/09 5:00 PM	0.22	0.16	0.38
1/5/09 8:00 PM	0.21	0.16	0.37
1/5/09 11:00 PM	0.20	0.15	0.36
1/6/09 2:00 AM	0.21	0.16	0.38
1/6/09 5:00 AM	0.21	0.17	0.38
1/6/09 8:00 AM	0.21	0.18	0.39
1/6/09 11:00 AM	0.21	0.17	0.37
1/6/09 2:00 PM	0.20	0.14	0.34
1/6/09 5:00 PM	0.20	0.14	0.34
1/6/09 8:00 PM	0.20	0.18	0.38
1/6/09 11:00 PM	0.20	0.13	0.33
1/7/09 2:00 AM	0.20	0.08	0.29
1/7/09 5:00 AM	0.21	0.09	0.29
1/7/09 8:00 AM	0.21	0.23	0.44
1/7/09 11:00 AM	0.21	0.26	0.47
1/7/09 2:00 PM	0.20	0.28	0.49
1/7/09 5:00 PM	0.19	0.42	0.61

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
1/7/09 8:00 PM	0.19	0.35	0.54
1/7/09 11:00 PM	0.19	0.45	0.64
1/8/09 2:00 AM	0.19	0.52	0.71
1/8/09 5:00 AM	0.20	0.58	0.78
1/8/09 8:00 AM	0.20	0.57	0.78
1/8/09 11:00 AM	0.21	0.60	0.81
1/8/09 2:00 PM	0.20	0.60	0.81
1/8/09 5:00 PM	0.20	0.49	0.69
1/8/09 8:00 PM	0.20	0.49	0.69
1/8/09 11:00 PM	0.15	0.48	0.63
1/9/09 2:00 AM	0.10	0.45	0.56
1/9/09 5:00 AM	0.11	0.39	0.49
1/9/09 8:00 AM	0.19	0.35	0.54
1/9/09 11:00 AM	0.20	0.32	0.52
1/9/09 2:00 PM	0.20	0.30	0.51
1/9/09 5:00 PM	0.21	0.28	0.49
1/9/09 8:00 PM	0.22	0.25	0.48
1/9/09 11:00 PM	0.23	0.26	0.49
1/10/09 2:00 AM	0.14	0.25	0.39
1/10/09 5:00 AM	0.11	0.25	0.36
1/10/09 8:00 AM	0.14	0.26	0.40
1/10/09 11:00 AM	0.14	0.31	0.45
1/10/09 2:00 PM	0.00	0.39	0.39
1/10/09 5:00 PM	0.00	0.28	0.28
1/10/09 8:00 PM	0.00	0.27	0.27
1/10/09 11:00 PM	0.05	0.21	0.26
1/11/09 2:00 AM	0.20	0.19	0.39
1/11/09 5:00 AM	0.23	0.14	0.37
1/11/09 8:00 AM	0.22	0.13	0.36
1/11/09 11:00 AM	0.35	0.13	0.48
1/11/09 2:00 PM	0.21	0.12	0.34
1/11/09 5:00 PM	0.22	0.13	0.35
1/11/09 8:00 PM	0.24	0.14	0.38
1/11/09 11:00 PM	0.17	0.10	0.27
1/12/09 2:00 AM	0.13	0.09	0.22
1/12/09 5:00 AM	0.15	0.09	0.25
1/12/09 8:00 AM	0.45	0.23	0.69
1/12/09 11:00 AM	0.55	0.18	0.73
1/12/09 2:00 PM	0.54	0.27	0.81
1/12/09 5:00 PM	0.27	0.19	0.46
1/12/09 8:00 PM	0.26	0.14	0.40
1/12/09 11:00 PM	0.25	0.10	0.35
1/13/09 2:00 AM	0.21	0.10	0.31
1/13/09 5:00 AM	0.20	0.10	0.30
1/13/09 8:00 AM	0.26	0.12	0.39
1/13/09 11:00 AM	0.26	0.20	0.46
1/13/09 2:00 PM	0.23	0.25	0.48
1/13/09 5:00 PM	0.22	0.18	0.40
1/13/09 8:00 PM	0.26	0.19	0.46
1/13/09 11:00 PM	0.27	0.18	0.45
1/14/09 2:00 AM	0.26	0.24	0.49
1/14/09 5:00 AM	0.26	0.25	0.51
1/14/09 8:00 AM	0.26	0.25	0.51
1/14/09 11:00 AM	0.26	0.31	0.57

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
1/14/09 2:00 PM	0.24	0.06	0.29
1/14/09 5:00 PM	0.23	0.00	0.23
1/14/09 8:00 PM	0.23	0.01	0.24
1/14/09 11:00 PM	0.23	0.13	0.36
1/15/09 2:00 AM	0.23	0.00	0.23
1/15/09 5:00 AM	0.22	0.00	0.22
1/15/09 8:00 AM	0.22	0.05	0.26
1/15/09 11:00 AM	0.21	0.30	0.51
1/15/09 2:00 PM	0.21	0.28	0.49
1/15/09 5:00 PM	0.21	0.22	0.43
1/15/09 8:00 PM	0.21	0.19	0.40
1/15/09 11:00 PM	0.22	0.17	0.39
1/16/09 2:00 AM	0.22	0.17	0.38
1/16/09 5:00 AM	0.21	0.17	0.37
1/16/09 8:00 AM	0.20	0.17	0.37
1/16/09 11:00 AM	0.18	0.17	0.35
1/16/09 2:00 PM	0.18	0.18	0.35
1/16/09 5:00 PM	0.14	0.18	0.31
1/16/09 8:00 PM	0.18	0.21	0.39
1/16/09 11:00 PM	0.17	0.19	0.36
1/17/09 2:00 AM	0.17	0.18	0.35
1/17/09 5:00 AM	0.17	0.19	0.36
1/17/09 8:00 AM	0.17	0.20	0.37
1/17/09 11:00 AM	0.17	0.22	0.38
1/17/09 2:00 PM	0.16	0.24	0.40
1/17/09 5:00 PM	0.15	0.20	0.36
1/17/09 8:00 PM	0.16	0.27	0.43
1/17/09 11:00 PM	0.16	0.27	0.43
1/18/09 2:00 AM	0.16	0.30	0.46
1/18/09 5:00 AM	0.16	0.32	0.48
1/18/09 8:00 AM	0.17	0.31	0.47
1/18/09 11:00 AM	0.17	0.35	0.52
1/18/09 2:00 PM	0.18	0.33	0.51
1/18/09 5:00 PM	0.19	0.62	0.81
1/18/09 8:00 PM	0.19	0.63	0.82
1/18/09 11:00 PM	0.20	0.39	0.59
1/19/09 2:00 AM	0.20	0.38	0.58
1/19/09 5:00 AM	0.10	0.28	0.38
1/19/09 8:00 AM	0.00	0.13	0.13
1/19/09 11:00 AM	0.00	0.03	0.03
1/19/09 2:00 PM	0.00	0.00	0.00
1/19/09 5:00 PM	0.00	0.00	0.00
1/19/09 8:00 PM	0.00	0.00	0.00
1/19/09 11:00 PM	0.00	0.00	0.00
1/20/09 2:00 AM	0.00	0.00	0.00
1/20/09 5:00 AM	0.00	0.00	0.00
1/20/09 8:00 AM	0.00	0.00	0.00
1/20/09 11:00 AM	0.00	0.00	0.00
1/20/09 2:00 PM	0.00	0.00	0.00
1/20/09 5:00 PM	0.00	0.00	0.00
1/20/09 8:00 PM	0.00	0.00	0.00
1/20/09 11:00 PM	0.01	0.00	0.01
1/21/09 2:00 AM	0.19	0.00	0.19
1/21/09 5:00 AM	0.30	0.00	0.30

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
1/21/09 8:00 AM	0.30	0.00	0.30
1/21/09 11:00 AM	0.03	0.00	0.03
1/21/09 2:00 PM	0.00	0.00	0.00
1/21/09 5:00 PM	0.07	0.00	0.07
1/21/09 8:00 PM	0.00	0.00	0.00
1/21/09 11:00 PM	0.02	0.00	0.02
1/22/09 2:00 AM	0.32	0.00	0.32
1/22/09 5:00 AM	0.61	0.00	0.62
1/22/09 8:00 AM	0.58	0.32	0.90
1/22/09 11:00 AM	0.56	0.34	0.89
1/22/09 2:00 PM	0.54	0.37	0.92
1/22/09 5:00 PM	0.54	0.33	0.88
1/22/09 8:00 PM	0.54	0.30	0.83
1/22/09 11:00 PM	0.53	0.27	0.80
1/23/09 2:00 AM	0.54	0.25	0.79
1/23/09 5:00 AM	0.54	0.21	0.75
1/23/09 8:00 AM	0.55	0.19	0.74
1/23/09 11:00 AM	0.52	0.17	0.69
1/23/09 2:00 PM	0.53	0.17	0.70
1/23/09 5:00 PM	0.53	0.31	0.85
1/23/09 8:00 PM	0.54	0.34	0.88
1/23/09 11:00 PM	0.45	0.31	0.77
1/24/09 2:00 AM	0.32	0.39	0.71
1/24/09 5:00 AM	0.32	0.36	0.68
1/24/09 8:00 AM	0.53	0.36	0.89
1/24/09 11:00 AM	0.53	0.36	0.89
1/24/09 2:00 PM	0.50	0.29	0.79
1/24/09 5:00 PM	0.46	0.30	0.76
1/24/09 8:00 PM	0.54	0.30	0.84
1/24/09 11:00 PM	0.37	0.34	0.71
1/25/09 2:00 AM	0.27	0.32	0.58
1/25/09 5:00 AM	0.24	0.36	0.60
1/25/09 8:00 AM	0.44	0.36	0.80
1/25/09 11:00 AM	0.51	0.35	0.87
1/25/09 2:00 PM	0.48	0.29	0.77
1/25/09 5:00 PM	0.51	0.22	0.74
1/25/09 8:00 PM	0.52	0.37	0.90
1/25/09 11:00 PM	0.50	0.37	0.87
1/26/09 2:00 AM	0.49	0.35	0.83
1/26/09 5:00 AM	0.50	0.32	0.82
1/26/09 8:00 AM	0.49	0.44	0.93
1/26/09 11:00 AM	0.47	0.69	1.16
1/26/09 2:00 PM	0.50	0.33	0.84
1/26/09 5:00 PM	0.60	0.31	0.91
1/26/09 8:00 PM	0.56	0.30	0.86
1/26/09 11:00 PM	0.56	0.32	0.88
1/27/09 2:00 AM	0.62	0.33	0.95
1/27/09 5:00 AM	0.51	0.23	0.74
1/27/09 8:00 AM	0.59	0.27	0.85
1/27/09 11:00 AM	0.54	0.23	0.77
1/27/09 2:00 PM	0.53	0.24	0.77
1/27/09 5:00 PM	0.54	0.24	0.78
1/27/09 8:00 PM	0.52	0.25	0.76
1/27/09 11:00 PM	0.47	0.25	0.73

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
1/28/09 2:00 AM	0.36	0.19	0.54
1/28/09 5:00 AM	0.38	0.21	0.59
1/28/09 8:00 AM	0.49	0.34	0.82
1/28/09 11:00 AM	0.48	0.35	0.83
1/28/09 2:00 PM	0.47	0.29	0.76
1/28/09 5:00 PM	0.47	0.31	0.77
1/28/09 8:00 PM	0.48	0.32	0.80
1/28/09 11:00 PM	0.47	0.22	0.68
1/29/09 2:00 AM	0.34	0.07	0.41
1/29/09 5:00 AM	0.33	0.08	0.41
1/29/09 8:00 AM	0.50	0.09	0.59
1/29/09 11:00 AM	0.39	0.26	0.65
1/29/09 2:00 PM	0.42	0.31	0.73
1/29/09 5:00 PM	0.42	0.34	0.77
1/29/09 8:00 PM	0.40	0.33	0.73
1/29/09 11:00 PM	0.32	0.30	0.63
1/30/09 2:00 AM	0.19	0.18	0.37
1/30/09 5:00 AM	0.17	0.14	0.31
1/30/09 8:00 AM	0.33	0.22	0.56
1/30/09 11:00 AM	0.39	0.21	0.60
1/30/09 2:00 PM	0.36	0.20	0.56
1/30/09 5:00 PM	0.37	0.18	0.55
1/30/09 8:00 PM	0.38	0.18	0.55
1/30/09 11:00 PM	0.39	0.18	0.57
1/31/09 2:00 AM	0.33	0.18	0.51
1/31/09 5:00 AM	0.32	0.18	0.51
1/31/09 8:00 AM	0.39	0.19	0.58
1/31/09 11:00 AM	0.39	0.18	0.57
1/31/09 2:00 PM	0.58	0.19	0.77
1/31/09 5:00 PM	0.69	0.23	0.92
1/31/09 8:00 PM	0.26	0.23	0.49
1/31/09 11:00 PM	0.40	0.25	0.65
2/1/09 2:00 AM	0.42	0.27	0.69
2/1/09 5:00 AM	0.41	0.27	0.68
2/1/09 8:00 AM	0.42	0.27	0.69
2/1/09 11:00 AM	0.40	0.27	0.67
2/1/09 2:00 PM	0.41	0.28	0.69
2/1/09 5:00 PM	0.41	0.26	0.67
2/1/09 8:00 PM	0.40	0.25	0.65
2/1/09 11:00 PM	0.41	0.26	0.66
2/2/09 2:00 AM	0.41	0.27	0.69
2/2/09 5:00 AM	0.43	0.29	0.72
2/2/09 8:00 AM	0.42	0.30	0.72
2/2/09 11:00 AM	0.31	0.29	0.60
2/2/09 2:00 PM	0.33	0.31	0.64
2/2/09 5:00 PM	0.47	0.30	0.78
2/2/09 8:00 PM	0.45	0.29	0.75
2/2/09 11:00 PM	0.44	0.28	0.72
2/3/09 2:00 AM	0.42	0.30	0.72
2/3/09 5:00 AM	0.43	0.29	0.72
2/3/09 8:00 AM	0.44	0.28	0.71
2/3/09 11:00 AM	0.44	0.11	0.55
2/3/09 2:00 PM	0.41	0.10	0.51
2/3/09 5:00 PM	0.44	0.05	0.49

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
2/3/09 8:00 PM	0.45	0.14	0.59
2/3/09 11:00 PM	0.44	0.26	0.69
2/4/09 2:00 AM	0.43	0.25	0.68
2/4/09 5:00 AM	0.44	0.25	0.69
2/4/09 8:00 AM	0.47	0.29	0.76
2/4/09 11:00 AM	0.50	0.24	0.74
2/4/09 2:00 PM	0.55	0.27	0.82
2/4/09 5:00 PM	0.53	0.26	0.79
2/4/09 8:00 PM	0.53	0.27	0.79
2/4/09 11:00 PM	0.53	0.29	0.82
2/5/09 2:00 AM	0.51	0.26	0.77
2/5/09 5:00 AM	0.51	0.27	0.78
2/5/09 8:00 AM	0.51	0.34	0.86
2/5/09 11:00 AM	0.50	0.40	0.90
2/5/09 2:00 PM	0.49	0.37	0.85
2/5/09 5:00 PM	0.45	0.26	0.70
2/5/09 8:00 PM	0.47	0.29	0.76
2/5/09 11:00 PM	0.48	0.28	0.76
2/6/09 2:00 AM	0.47	0.27	0.74
2/6/09 5:00 AM	0.49	0.28	0.78
2/6/09 8:00 AM	0.47	0.27	0.74
2/6/09 11:00 AM	0.44	0.20	0.63
2/6/09 2:00 PM	0.43	0.10	0.53
2/6/09 5:00 PM	0.44	0.10	0.54
2/6/09 8:00 PM	0.43	0.21	0.64
2/6/09 11:00 PM	0.46	0.24	0.70
2/7/09 2:00 AM	0.46	0.24	0.70
2/7/09 5:00 AM	0.47	0.24	0.71
2/7/09 8:00 AM	0.47	0.26	0.73
2/7/09 11:00 AM	0.47	0.26	0.73
2/7/09 2:00 PM	0.46	0.27	0.73
2/7/09 5:00 PM	0.61	0.26	0.87
2/7/09 8:00 PM	0.68	0.25	0.93
2/7/09 11:00 PM	0.62	0.28	0.90
2/8/09 2:00 AM	0.60	0.28	0.88
2/8/09 5:00 AM	0.61	0.30	0.91
2/8/09 8:00 AM	0.64	0.32	0.96
2/8/09 11:00 AM	0.64	0.30	0.94
2/8/09 2:00 PM	0.65	0.28	0.93
2/8/09 5:00 PM	0.65	0.27	0.92
2/8/09 8:00 PM	0.61	0.26	0.87
2/8/09 11:00 PM	0.14	0.26	0.40
2/9/09 2:00 AM	0.00	0.25	0.25
2/9/09 5:00 AM	0.00	0.24	0.24
2/9/09 8:00 AM	0.00	0.24	0.24
2/9/09 11:00 AM	0.00	0.22	0.22
2/9/09 2:00 PM	0.00	0.24	0.24
2/9/09 5:00 PM	0.00	0.22	0.22
2/9/09 8:00 PM	0.00	0.22	0.22
2/9/09 11:00 PM	0.00	0.22	0.22
2/10/09 2:00 AM	0.00	1.43	1.43
2/10/09 5:00 AM	0.00	0.21	0.21
2/10/09 8:00 AM	0.00	0.23	0.23
2/10/09 11:00 AM	0.00	0.21	0.21

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
2/10/09 2:00 PM	0.00	0.21	0.21
2/10/09 5:00 PM	0.00	0.21	0.21
2/10/09 8:00 PM	0.00	0.24	0.24
2/10/09 11:00 PM	0.00	0.20	0.20
2/11/09 2:00 AM	0.00	0.18	0.18
2/11/09 5:00 AM	0.00	0.19	0.19
2/11/09 8:00 AM	0.00	0.19	0.19
2/11/09 11:00 AM	0.00	0.22	0.22
2/11/09 2:00 PM	0.00	0.20	0.20
2/11/09 5:00 PM	0.00	0.20	0.20
2/11/09 8:00 PM	0.00	0.21	0.21
2/11/09 11:00 PM	0.00	0.21	0.21
2/12/09 2:00 AM	0.00	0.21	0.21
2/12/09 5:00 AM	0.00	0.20	0.20
2/12/09 8:00 AM	0.00	0.20	0.20
2/12/09 11:00 AM	0.00	0.26	0.26
2/12/09 2:00 PM	0.00	0.21	0.21
2/12/09 5:00 PM	0.00	0.21	0.21
2/12/09 8:00 PM	0.00	0.24	0.24
2/12/09 11:00 PM	0.00	0.27	0.27
2/13/09 2:00 AM	0.00	0.28	0.28
2/13/09 5:00 AM	0.00	0.28	0.28
2/13/09 8:00 AM	0.00	0.30	0.30
2/13/09 11:00 AM	0.00	0.22	0.22
2/13/09 2:00 PM	0.00	0.24	0.24
2/13/09 5:00 PM	0.00	0.26	0.26
2/13/09 8:00 PM	0.00	0.29	0.29
2/13/09 11:00 PM	0.00	0.29	0.29
2/14/09 2:00 AM	0.00	0.29	0.29
2/14/09 5:00 AM	0.00	0.31	0.31
2/14/09 8:00 AM	0.00	0.30	0.30
2/14/09 11:00 AM	0.00	0.31	0.31
2/14/09 2:00 PM	0.00	0.31	0.31
2/14/09 5:00 PM	0.00	0.31	0.31
2/14/09 8:00 PM	0.00	0.32	0.32
2/14/09 11:00 PM	0.00	0.34	0.34
2/15/09 2:00 AM	0.00	0.36	0.36
2/15/09 5:00 AM	0.00	0.37	0.37
2/15/09 8:00 AM	0.00	0.37	0.37
2/15/09 11:00 AM	0.00	0.39	0.39
2/15/09 2:00 PM	0.00	0.39	0.39
2/15/09 5:00 PM	0.00	0.40	0.40
2/15/09 8:00 PM	0.00	0.40	0.40
2/15/09 11:00 PM	0.00	0.42	0.42
2/16/09 2:00 AM	0.00	0.40	0.40
2/16/09 5:00 AM	0.00	0.40	0.40
2/16/09 8:00 AM	0.00	0.38	0.38
2/16/09 11:00 AM	0.00	0.36	0.36
2/16/09 2:00 PM	0.00	0.47	0.47
2/16/09 5:00 PM	0.00	0.25	0.25
2/16/09 8:00 PM	0.00	0.28	0.28
2/16/09 11:00 PM	0.00	0.18	0.18
2/17/09 2:00 AM	0.00	0.19	0.19
2/17/09 5:00 AM	0.30	0.21	0.51

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
2/17/09 8:00 AM	0.39	0.24	0.63
2/17/09 11:00 AM	0.55	0.25	0.81
2/17/09 2:00 PM	0.53	0.92	1.44
2/17/09 5:00 PM	0.52	0.30	0.82
2/17/09 8:00 PM	0.49	0.31	0.79
2/17/09 11:00 PM	0.45	0.26	0.72
2/18/09 2:00 AM	0.44	0.28	0.72
2/18/09 5:00 AM	0.43	0.28	0.71
2/18/09 8:00 AM	0.41	0.30	0.71
2/18/09 11:00 AM	0.43	0.27	0.70
2/18/09 2:00 PM	0.44	0.28	0.72
2/18/09 5:00 PM	0.43	0.29	0.72
2/18/09 8:00 PM	0.44	0.38	0.82
2/18/09 11:00 PM	0.43	0.26	0.69
2/19/09 2:00 AM	0.41	0.12	0.52
2/19/09 5:00 AM	0.41	0.09	0.49
2/19/09 8:00 AM	0.41	0.20	0.60
2/19/09 11:00 AM	0.41	0.35	0.76
2/19/09 2:00 PM	0.42	0.39	0.81
2/19/09 5:00 PM	0.40	0.35	0.75
2/19/09 8:00 PM	0.38	0.35	0.74
2/19/09 11:00 PM	0.38	0.36	0.74
2/20/09 2:00 AM	0.38	0.34	0.72
2/20/09 5:00 AM	0.38	0.34	0.72
2/20/09 8:00 AM	0.39	0.38	0.77
2/20/09 11:00 AM	0.39	0.35	0.74
2/20/09 2:00 PM	0.38	0.37	0.75
2/20/09 5:00 PM	0.38	0.31	0.69
2/20/09 8:00 PM	0.38	0.01	0.38
2/20/09 11:00 PM	0.37	0.00	0.37
2/21/09 2:00 AM	0.37	0.00	0.37
2/21/09 5:00 AM	0.36	0.00	0.36
2/21/09 8:00 AM	0.37	0.00	0.37
2/21/09 11:00 AM	0.37	0.00	0.37
2/21/09 2:00 PM	0.37	0.00	0.37
2/21/09 5:00 PM	0.37	0.00	0.37
2/21/09 8:00 PM	0.36	0.00	0.36
2/21/09 11:00 PM	0.36	0.00	0.36
2/22/09 2:00 AM	0.36	0.00	0.36
2/22/09 5:00 AM	0.36	0.01	0.37
2/22/09 8:00 AM	0.36	0.08	0.44
2/22/09 11:00 AM	0.37	0.15	0.52
2/22/09 2:00 PM	0.37	0.18	0.54
2/22/09 5:00 PM	0.37	0.19	0.56
2/22/09 8:00 PM	0.37	0.16	0.53
2/22/09 11:00 PM	0.25	0.19	0.44
2/23/09 2:00 AM	0.16	0.19	0.35
2/23/09 5:00 AM	0.24	0.20	0.44
2/23/09 8:00 AM	0.34	0.21	0.55
2/23/09 11:00 AM	0.33	0.20	0.54
2/23/09 2:00 PM	0.33	0.19	0.53
2/23/09 5:00 PM	0.33	0.21	0.54
2/23/09 8:00 PM	0.33	0.21	0.54
2/23/09 11:00 PM	0.33	0.22	0.55

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
2/24/09 2:00 AM	0.33	0.22	0.55
2/24/09 5:00 AM	0.32	0.22	0.54
2/24/09 8:00 AM	0.30	0.23	0.53
2/24/09 11:00 AM	0.29	0.22	0.51
2/24/09 2:00 PM	0.38	0.21	0.58
2/24/09 5:00 PM	0.38	0.21	0.59
2/24/09 8:00 PM	0.27	0.22	0.50
2/24/09 11:00 PM	0.22	0.23	0.45
2/25/09 2:00 AM	0.19	0.12	0.32
2/25/09 5:00 AM	0.20	0.11	0.31
2/25/09 8:00 AM	0.28	0.25	0.53
2/25/09 11:00 AM	0.28	0.25	0.53
2/25/09 2:00 PM	0.28	0.24	0.52
2/25/09 5:00 PM	0.30	0.19	0.49
2/25/09 8:00 PM	0.28	0.23	0.50
2/25/09 11:00 PM	0.26	0.17	0.44
2/26/09 2:00 AM	0.26	0.12	0.38
2/26/09 5:00 AM	0.29	0.17	0.46
2/26/09 8:00 AM	0.35	0.27	0.62
2/26/09 11:00 AM	0.35	0.24	0.58
2/26/09 2:00 PM	0.34	0.24	0.59
2/26/09 5:00 PM	0.35	0.25	0.60
2/26/09 8:00 PM	0.34	0.36	0.69
2/26/09 11:00 PM	0.33	0.35	0.69
2/27/09 2:00 AM	0.31	0.35	0.66
2/27/09 5:00 AM	0.22	0.37	0.59
2/27/09 8:00 AM	0.33	0.29	0.62
2/27/09 11:00 AM	0.33	0.34	0.67
2/27/09 2:00 PM	0.33	0.32	0.66
2/27/09 5:00 PM	0.33	0.34	0.67
2/27/09 8:00 PM	0.32	0.36	0.68
2/27/09 11:00 PM	0.32	0.39	0.71
2/28/09 2:00 AM	0.33	0.35	0.68
2/28/09 5:00 AM	0.34	0.38	0.72
2/28/09 8:00 AM	0.34	0.38	0.72
2/28/09 11:00 AM	0.00	0.38	0.38
2/28/09 2:00 PM	0.00	0.39	0.39
2/28/09 5:00 PM	0.00	0.42	0.42
2/28/09 8:00 PM	0.01	0.43	0.44
2/28/09 11:00 PM	0.27	0.46	0.73
3/1/09 2:00 AM	0.40	0.25	0.65
3/1/09 5:00 AM	0.33	0.24	0.57
3/1/09 8:00 AM	0.34	0.15	0.50
3/1/09 11:00 AM	0.38	0.19	0.57
3/1/09 2:00 PM	0.36	0.16	0.53
3/1/09 5:00 PM	0.35	0.16	0.50
3/1/09 8:00 PM	0.36	0.17	0.52
3/1/09 11:00 PM	0.35	0.18	0.53
3/2/09 2:00 AM	0.39	0.20	0.58
3/2/09 5:00 AM	0.34	0.19	0.52
3/2/09 8:00 AM	0.34	0.21	0.55
3/2/09 11:00 AM	0.34	0.26	0.59
3/2/09 2:00 PM	0.33	0.19	0.53
3/2/09 5:00 PM	0.32	0.16	0.48

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
3/2/09 8:00 PM	0.31	0.19	0.50
3/2/09 11:00 PM	0.31	0.19	0.51
3/3/09 2:00 AM	0.32	0.20	0.52
3/3/09 5:00 AM	0.32	0.21	0.53
3/3/09 8:00 AM	0.32	0.22	0.54
3/3/09 11:00 AM	0.32	0.21	0.53
3/3/09 2:00 PM	0.30	0.21	0.50
3/3/09 5:00 PM	0.31	0.21	0.52
3/3/09 8:00 PM	0.32	0.23	0.54
3/3/09 11:00 PM	0.32	0.25	0.56
3/4/09 2:00 AM	0.34	0.26	0.60
3/4/09 5:00 AM	0.35	0.27	0.62
3/4/09 8:00 AM	0.36	0.32	0.69
3/4/09 11:00 AM	0.36	0.32	0.68
3/4/09 2:00 PM	0.33	0.34	0.67
3/4/09 5:00 PM	0.32	0.32	0.63
3/4/09 8:00 PM	0.32	0.32	0.64
3/4/09 11:00 PM	0.31	0.31	0.62
3/5/09 2:00 AM	0.39	0.35	0.74
3/5/09 5:00 AM	0.30	0.32	0.62
3/5/09 8:00 AM	0.32	0.28	0.59
3/5/09 11:00 AM	0.32	0.24	0.56
3/5/09 2:00 PM	0.52	0.23	0.75
3/5/09 5:00 PM	0.23	0.24	0.48
3/5/09 8:00 PM	0.25	0.19	0.44
3/5/09 11:00 PM	0.24	0.11	0.35
3/6/09 2:00 AM	0.25	0.04	0.29
3/6/09 5:00 AM	0.25	0.05	0.30
3/6/09 8:00 AM	0.25	0.07	0.32
3/6/09 11:00 AM	0.20	0.10	0.29
3/6/09 2:00 PM	0.14	0.10	0.25
3/6/09 5:00 PM	0.20	0.29	0.48
3/6/09 8:00 PM	0.26	0.28	0.54
3/6/09 11:00 PM	0.25	0.24	0.49
3/7/09 2:00 AM	0.24	0.19	0.43
3/7/09 5:00 AM	0.24	0.15	0.39
3/7/09 8:00 AM	0.24	0.12	0.35
3/7/09 11:00 AM	0.24	0.13	0.37
3/7/09 2:00 PM	0.21	0.13	0.35
3/7/09 5:00 PM	0.21	0.13	0.34
3/7/09 8:00 PM	0.25	0.14	0.38
3/7/09 11:00 PM	0.22	0.14	0.37
3/8/09 2:00 AM	0.20	0.14	0.35
3/8/09 5:00 AM	0.16	0.12	0.28
3/8/09 8:00 AM	0.23	0.16	0.39
3/8/09 11:00 AM	0.22	0.17	0.38
3/8/09 2:00 PM	0.21	0.17	0.38
3/8/09 5:00 PM	0.21	0.17	0.38
3/8/09 8:00 PM	0.17	0.17	0.35
3/8/09 11:00 PM	0.16	0.17	0.33
3/9/09 2:00 AM	0.16	0.18	0.34
3/9/09 5:00 AM	0.16	0.20	0.35
3/9/09 8:00 AM	0.16	0.23	0.39
3/9/09 11:00 AM	0.16	0.25	0.41

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
3/9/09 2:00 PM	0.23	0.25	0.48
3/9/09 5:00 PM	0.26	0.26	0.52
3/9/09 8:00 PM	0.39	0.29	0.67
3/9/09 11:00 PM	0.37	0.31	0.68
3/10/09 2:00 AM	0.13	0.31	0.44
3/10/09 5:00 AM	0.13	0.23	0.36
3/10/09 8:00 AM	0.17	0.28	0.45
3/10/09 11:00 AM	0.13	0.27	0.40
3/10/09 2:00 PM	0.08	0.27	0.35
3/10/09 5:00 PM	0.11	0.23	0.34
3/10/09 8:00 PM	0.10	0.21	0.32
3/10/09 11:00 PM	0.03	0.19	0.22
3/11/09 2:00 AM	0.00	0.20	0.20
3/11/09 5:00 AM	0.00	0.21	0.21
3/11/09 8:00 AM	0.00	0.22	0.22
3/11/09 11:00 AM	0.00	0.24	0.24
3/11/09 2:00 PM	0.00	0.15	0.15
3/11/09 5:00 PM	0.00	0.27	0.27
3/11/09 8:00 PM	0.00	0.24	0.24
3/11/09 11:00 PM	0.00	0.19	0.19
3/12/09 2:00 AM	0.00	0.12	0.12
3/12/09 5:00 AM	0.00	0.20	0.20
3/12/09 8:00 AM	0.00	0.25	0.25
3/12/09 11:00 AM	0.00	0.22	0.22
3/12/09 2:00 PM	0.00	0.21	0.21
3/12/09 5:00 PM	0.00	0.21	0.21
3/12/09 8:00 PM	0.00	0.24	0.24
3/12/09 11:00 PM	0.00	0.20	0.20
3/13/09 2:00 AM	0.00	0.13	0.13
3/13/09 5:00 AM	0.00	0.20	0.20
3/13/09 8:00 AM	0.00	0.21	0.21
3/13/09 11:00 AM	0.00	0.21	0.21
3/13/09 2:00 PM	0.00	0.21	0.21
3/13/09 5:00 PM	0.00	0.19	0.19
3/13/09 8:00 PM	0.00	0.17	0.17
3/13/09 11:00 PM	0.00	0.17	0.17
3/14/09 2:00 AM	0.00	0.16	0.16
3/14/09 5:00 AM	0.00	0.16	0.16
3/14/09 8:00 AM	0.00	0.17	0.17
3/14/09 11:00 AM	0.00	0.17	0.17
3/14/09 2:00 PM	0.00	0.17	0.17
3/14/09 5:00 PM	0.00	0.17	0.17
3/14/09 8:00 PM	0.00	0.18	0.18
3/14/09 11:00 PM	0.00	0.18	0.18
3/15/09 2:00 AM	0.00	0.20	0.20
3/15/09 5:00 AM	0.00	0.19	0.19
3/15/09 8:00 AM	0.00	0.19	0.19
3/15/09 11:00 AM	0.00	0.19	0.19
3/15/09 2:00 PM	0.00	0.19	0.19
3/15/09 5:00 PM	0.00	0.19	0.19
3/15/09 8:00 PM	0.00	0.17	0.17
3/15/09 11:00 PM	0.00	0.16	0.16
3/16/09 2:00 AM	0.00	0.15	0.15
3/16/09 5:00 AM	0.00	0.15	0.15

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
3/16/09 8:00 AM	0.00	0.17	0.17
3/16/09 11:00 AM	0.00	0.17	0.17
3/16/09 2:00 PM	0.00	0.18	0.18
3/16/09 5:00 PM	0.00	0.31	0.31
3/16/09 8:00 PM	0.00	0.48	0.48
3/16/09 11:00 PM	0.00	0.45	0.45
3/17/09 2:00 AM	0.00	0.43	0.43
3/17/09 5:00 AM	0.00	0.36	0.36
3/17/09 8:00 AM	0.00	0.15	0.15
3/17/09 11:00 AM	0.00	0.15	0.15
3/17/09 2:00 PM	0.00	0.14	0.14
3/17/09 5:00 PM	0.00	0.14	0.14
3/17/09 8:00 PM	0.00	0.13	0.13
3/17/09 11:00 PM	0.00	0.14	0.14
3/18/09 2:00 AM	0.00	0.14	0.14
3/18/09 5:00 AM	0.00	0.14	0.14
3/18/09 8:00 AM	0.00	0.15	0.15
3/18/09 11:00 AM	0.00	0.15	0.15
3/18/09 2:00 PM	0.00	0.14	0.14
3/18/09 5:00 PM	0.00	0.14	0.14
3/18/09 8:00 PM	0.00	0.14	0.14
3/18/09 11:00 PM	0.00	0.13	0.13
3/19/09 2:00 AM	0.00	0.11	0.11
3/19/09 5:00 AM	0.00	0.13	0.13
3/19/09 8:00 AM	0.00	0.12	0.12
3/19/09 11:00 AM	0.00	0.16	0.16
3/19/09 2:00 PM	0.00	0.19	0.19
3/19/09 5:00 PM	0.00	0.11	0.11
3/19/09 8:00 PM	0.00	0.11	0.11
3/19/09 11:00 PM	0.00	0.10	0.10
3/20/09 2:00 AM	0.00	0.11	0.11
3/20/09 5:00 AM	0.00	0.12	0.12
3/20/09 8:00 AM	0.00	0.13	0.13
3/20/09 11:00 AM	0.00	0.13	0.13
3/20/09 2:00 PM	0.00	0.08	0.08
3/20/09 5:00 PM	0.00	0.06	0.06
3/20/09 8:00 PM	0.00	0.05	0.05
3/20/09 11:00 PM	0.00	0.06	0.06
3/21/09 2:00 AM	0.00	0.06	0.06
3/21/09 5:00 AM	0.00	0.06	0.06
3/21/09 8:00 AM	0.00	0.07	0.07
3/21/09 11:00 AM	0.00	0.07	0.07
3/21/09 2:00 PM	0.00	0.07	0.07
3/21/09 5:00 PM	0.00	0.07	0.07
3/21/09 8:00 PM	0.00	0.09	0.09
3/21/09 11:00 PM	0.00	0.10	0.10
3/22/09 2:00 AM	0.00	0.10	0.10
3/22/09 5:00 AM	0.00	0.11	0.11
3/22/09 8:00 AM	0.00	0.11	0.11
3/22/09 11:00 AM	0.00	0.11	0.11
3/22/09 2:00 PM	0.00	0.13	0.13
3/22/09 5:00 PM	0.00	0.18	0.18
3/22/09 8:00 PM	0.00	0.15	0.15
3/22/09 11:00 PM	0.00	0.16	0.16

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
3/23/09 2:00 AM	0.00	0.40	0.40
3/23/09 5:00 AM	0.00	0.19	0.19
3/23/09 8:00 AM	0.00	0.18	0.18
3/23/09 11:00 AM	0.00	0.20	0.20
3/23/09 2:00 PM	0.00	0.21	0.21
3/23/09 5:00 PM	0.00	0.22	0.22
3/23/09 8:00 PM	0.00	0.24	0.24
3/23/09 11:00 PM	0.28	0.22	0.51
3/24/09 2:00 AM	0.54	0.23	0.78
3/24/09 5:00 AM	0.99	0.25	1.24
3/24/09 8:00 AM	0.58	0.27	0.85
3/24/09 11:00 AM	0.33	0.28	0.61
3/24/09 2:00 PM	0.22	0.28	0.50
3/24/09 5:00 PM	0.00	0.29	0.29
3/24/09 8:00 PM	0.00	1.26	1.26
3/24/09 11:00 PM	0.00	0.27	0.27
3/25/09 2:00 AM	0.02	0.27	0.29
3/25/09 5:00 AM	0.21	0.27	0.48
3/25/09 8:00 AM	0.21	0.28	0.49
3/25/09 11:00 AM	0.14	0.28	0.42
3/25/09 2:00 PM	0.11	0.28	0.40
3/25/09 5:00 PM	0.12	0.30	0.42
3/25/09 8:00 PM	0.19	0.30	0.50
3/25/09 11:00 PM	0.15	0.23	0.39
3/26/09 2:00 AM	0.08	0.06	0.14
3/26/09 5:00 AM	0.10	0.07	0.17
3/26/09 8:00 AM	0.23	0.19	0.41
3/26/09 11:00 AM	0.27	0.11	0.38
3/26/09 2:00 PM	0.28	0.12	0.40
3/26/09 5:00 PM	0.30	0.12	0.42
3/26/09 8:00 PM	0.30	0.20	0.50
3/26/09 11:00 PM	0.31	0.29	0.60
3/27/09 2:00 AM	0.30	0.51	0.81
3/27/09 5:00 AM	0.20	0.27	0.47
3/27/09 8:00 AM	0.08	0.28	0.35
3/27/09 11:00 AM	0.25	0.27	0.53
3/27/09 2:00 PM	0.42	0.25	0.68
3/27/09 5:00 PM	0.29	0.25	0.54
3/27/09 8:00 PM	0.30	0.23	0.53
3/27/09 11:00 PM	0.27	0.19	0.46
3/28/09 2:00 AM	0.32	0.18	0.50
3/28/09 5:00 AM	0.44	0.18	0.62
3/28/09 8:00 AM	0.46	0.17	0.64
3/28/09 11:00 AM	0.45	0.18	0.64
3/28/09 2:00 PM	0.42	0.19	0.61
3/28/09 5:00 PM	0.43	0.18	0.61
3/28/09 8:00 PM	0.46	0.17	0.63
3/28/09 11:00 PM	0.39	0.16	0.55
3/29/09 2:00 AM	0.30	0.13	0.43
3/29/09 5:00 AM	0.32	0.08	0.39
3/29/09 8:00 AM	0.31	0.13	0.44
3/29/09 11:00 AM	0.18	0.15	0.32
3/29/09 2:00 PM	0.10	0.12	0.22
3/29/09 5:00 PM	0.25	0.12	0.37

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
3/29/09 8:00 PM	0.43	0.11	0.54
3/29/09 11:00 PM	0.59	0.03	0.62
3/30/09 2:00 AM	0.62	0.03	0.65
3/30/09 5:00 AM	0.63	0.07	0.70
3/30/09 8:00 AM	0.63	0.15	0.79
3/30/09 11:00 AM	0.57	0.15	0.72
3/30/09 2:00 PM	0.53	0.13	0.66
3/30/09 5:00 PM	0.78	0.12	0.90
3/30/09 8:00 PM	0.94	0.12	1.06
3/30/09 11:00 PM	0.81	0.12	0.93
3/31/09 2:00 AM	0.70	0.11	0.81
3/31/09 5:00 AM	0.63	0.10	0.74
3/31/09 8:00 AM	0.47	0.13	0.60
3/31/09 11:00 AM	0.50	0.13	0.62
3/31/09 2:00 PM	0.41	0.13	0.54
3/31/09 5:00 PM	0.73	0.13	0.86
3/31/09 8:00 PM	0.84	0.14	0.97
3/31/09 11:00 PM	1.05	0.14	1.19
4/1/09 2:00 AM	0.39	0.14	0.53
4/1/09 5:00 AM	0.87	0.15	1.02
4/1/09 8:00 AM	0.89	0.15	1.04
4/1/09 11:00 AM	0.81	0.16	0.97
4/1/09 2:00 PM	0.80	0.18	0.98
4/1/09 5:00 PM	0.57	0.16	0.73
4/1/09 8:00 PM	0.00	0.14	0.14
4/1/09 11:00 PM	0.00	0.15	0.15
4/2/09 2:00 AM	0.00	0.15	0.15
4/2/09 5:00 AM	0.00	0.17	0.17
4/2/09 8:00 AM	0.00	0.17	0.17
4/2/09 11:00 AM	0.00	0.18	0.18
4/2/09 2:00 PM	0.00	0.20	0.20
4/2/09 5:00 PM	0.00	0.17	0.17
4/2/09 8:00 PM	0.01	0.18	0.18
4/2/09 11:00 PM	0.07	0.19	0.26
4/3/09 2:00 AM	0.22	0.20	0.42
4/3/09 5:00 AM	0.76	0.20	0.96
4/3/09 8:00 AM	1.01	0.19	1.20
4/3/09 11:00 AM	0.94	0.19	1.13
4/3/09 2:00 PM	0.98	0.19	1.16
4/3/09 5:00 PM	0.95	0.19	1.14
4/3/09 8:00 PM	0.89	0.19	1.08
4/3/09 11:00 PM	0.73	0.06	0.78
4/4/09 2:00 AM	0.60	0.06	0.66
4/4/09 5:00 AM	0.56	0.08	0.64
4/4/09 8:00 AM	0.55	0.19	0.74
4/4/09 11:00 AM	0.54	0.27	0.81
4/4/09 2:00 PM	0.52	0.26	0.78
4/4/09 5:00 PM	0.53	0.25	0.78
4/4/09 8:00 PM	0.59	0.25	0.84
4/4/09 11:00 PM	0.34	0.26	0.59
4/5/09 2:00 AM	0.36	0.26	0.62
4/5/09 5:00 AM	0.36	0.26	0.61
4/5/09 8:00 AM	0.32	0.24	0.55
4/5/09 11:00 AM	0.34	0.22	0.57

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
4/5/09 2:00 PM	0.33	0.21	0.55
4/5/09 5:00 PM	0.34	0.18	0.52
4/5/09 8:00 PM	0.34	0.16	0.50
4/5/09 11:00 PM	0.33	0.14	0.47
4/6/09 2:00 AM	0.34	0.14	0.48
4/6/09 5:00 AM	0.35	0.16	0.51
4/6/09 8:00 AM	0.34	0.19	0.53
4/6/09 11:00 AM	0.35	0.20	0.56
4/6/09 2:00 PM	0.34	0.19	0.53
4/6/09 5:00 PM	0.41	0.18	0.59
4/6/09 8:00 PM	0.47	0.20	0.67
4/6/09 11:00 PM	0.34	0.20	0.54
4/7/09 2:00 AM	0.38	0.21	0.60
4/7/09 5:00 AM	0.50	0.22	0.71
4/7/09 8:00 AM	0.47	0.24	0.72
4/7/09 11:00 AM	0.46	0.23	0.69
4/7/09 2:00 PM	0.41	0.23	0.64
4/7/09 5:00 PM	0.30	0.24	0.54
4/7/09 8:00 PM	0.33	0.24	0.57
4/7/09 11:00 PM	0.25	0.25	0.50
4/8/09 2:00 AM	0.12	0.26	0.38
4/8/09 5:00 AM	0.26	0.27	0.53
4/8/09 8:00 AM	0.32	0.29	0.60
4/8/09 11:00 AM	0.32	0.29	0.61
4/8/09 2:00 PM	0.30	0.29	0.59
4/8/09 5:00 PM	0.30	0.29	0.59
4/8/09 8:00 PM	0.29	0.29	0.58
4/8/09 11:00 PM	0.30	0.29	0.59
4/9/09 2:00 AM	0.30	0.29	0.59
4/9/09 5:00 AM	0.32	0.29	0.61
4/9/09 8:00 AM	0.31	0.29	0.60
4/9/09 11:00 AM	0.30	0.26	0.56
4/9/09 2:00 PM	0.43	0.24	0.67
4/9/09 5:00 PM	0.38	0.25	0.63
4/9/09 8:00 PM	0.42	0.31	0.73
4/9/09 11:00 PM	0.41	0.48	0.89
4/10/09 2:00 AM	0.48	0.16	0.64
4/10/09 5:00 AM	0.45	0.15	0.60
4/10/09 8:00 AM	0.26	0.22	0.48
4/10/09 11:00 AM	0.26	0.21	0.47
4/10/09 2:00 PM	0.30	0.22	0.52
4/10/09 5:00 PM	0.36	0.22	0.58
4/10/09 8:00 PM	0.45	0.20	0.65
4/10/09 11:00 PM	0.46	0.21	0.67
4/11/09 2:00 AM	0.44	0.13	0.57
4/11/09 5:00 AM	0.44	0.13	0.57
4/11/09 8:00 AM	0.41	0.17	0.58
4/11/09 11:00 AM	0.47	0.25	0.72
4/11/09 2:00 PM	0.48	0.27	0.75
4/11/09 5:00 PM	0.48	0.28	0.76
4/11/09 8:00 PM	0.53	0.27	0.80
4/11/09 11:00 PM	0.46	0.17	0.63
4/12/09 2:00 AM	0.35	0.10	0.45
4/12/09 5:00 AM	0.55	0.10	0.65

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
4/12/09 8:00 AM	0.33	0.12	0.45
4/12/09 11:00 AM	0.28	0.15	0.43
4/12/09 2:00 PM	0.27	1.24	1.50
4/12/09 5:00 PM	0.29	0.39	0.67
4/12/09 8:00 PM	0.45	0.36	0.80
4/12/09 11:00 PM	0.28	0.33	0.61
4/13/09 2:00 AM	0.40	0.22	0.62
4/13/09 5:00 AM	0.44	0.25	0.69
4/13/09 8:00 AM	0.58	0.30	0.87
4/13/09 11:00 AM	0.55	0.34	0.89
4/13/09 2:00 PM	0.50	0.32	0.82
4/13/09 5:00 PM	0.60	0.31	0.92
4/13/09 8:00 PM	0.64	0.30	0.94
4/13/09 11:00 PM	0.67	0.35	1.03
4/14/09 2:00 AM	1.13	0.30	1.43
4/14/09 5:00 AM	1.16	0.37	1.53
4/14/09 8:00 AM	0.75	0.41	1.16
4/14/09 11:00 AM	0.70	0.43	1.12
4/14/09 2:00 PM	0.63	0.25	0.88
4/14/09 5:00 PM	0.00	0.12	0.12
4/14/09 8:00 PM	0.05	0.11	0.17
4/14/09 11:00 PM	0.09	0.10	0.19
4/15/09 2:00 AM	0.48	0.09	0.57
4/15/09 5:00 AM	0.83	0.18	1.01
4/15/09 8:00 AM	0.88	0.50	1.39
4/15/09 11:00 AM	1.03	0.49	1.52
4/15/09 2:00 PM	1.14	0.38	1.53
4/15/09 5:00 PM	0.61	0.36	0.97
4/15/09 8:00 PM	0.30	0.30	0.60
4/15/09 11:00 PM	0.50	0.24	0.74
4/16/09 2:00 AM	0.46	0.08	0.53
4/16/09 5:00 AM	0.52	0.12	0.65
4/16/09 8:00 AM	0.58	0.15	0.73
4/16/09 11:00 AM	0.35	0.23	0.58
4/16/09 2:00 PM	0.08	0.26	0.34
4/16/09 5:00 PM	0.09	0.27	0.37
4/16/09 8:00 PM	0.11	0.25	0.36
4/16/09 11:00 PM	0.13	0.24	0.37
4/17/09 2:00 AM	0.37	0.08	0.45
4/17/09 5:00 AM	0.34	0.19	0.53
4/17/09 8:00 AM	0.33	0.30	0.64
4/17/09 11:00 AM	0.21	0.28	0.49
4/17/09 2:00 PM	0.21	0.28	0.49
4/17/09 5:00 PM	0.20	0.25	0.45
4/17/09 8:00 PM	0.00	0.22	0.22
4/17/09 11:00 PM	0.00	0.21	0.21
4/18/09 2:00 AM	0.00	0.16	0.16
4/18/09 5:00 AM	0.00	0.21	0.21
4/18/09 8:00 AM	0.00	0.17	0.17
4/18/09 11:00 AM	0.00	0.18	0.18
4/18/09 2:00 PM	0.00	0.23	0.23
4/18/09 5:00 PM	0.00	0.25	0.25
4/18/09 8:00 PM	0.00	0.23	0.23
4/18/09 11:00 PM	0.00	0.21	0.21

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
4/19/09 2:00 AM	0.00	0.20	0.20
4/19/09 5:00 AM	0.00	0.15	0.15
4/19/09 8:00 AM	0.00	0.18	0.18
4/19/09 11:00 AM	0.00	0.19	0.19
4/19/09 2:00 PM	0.00	0.21	0.21
4/19/09 5:00 PM	0.00	0.20	0.20
4/19/09 8:00 PM	0.00	0.18	0.18
4/19/09 11:00 PM	0.00	0.17	0.17
4/20/09 2:00 AM	0.00	0.17	0.17
4/20/09 5:00 AM	0.00	0.17	0.17
4/20/09 8:00 AM	0.00	0.16	0.16
4/20/09 11:00 AM	0.00	0.18	0.18
4/20/09 2:00 PM	0.41	0.24	0.65
4/20/09 5:00 PM	0.34	0.24	0.59
4/20/09 8:00 PM	0.36	0.23	0.59
4/20/09 11:00 PM	0.35	0.24	0.59
4/21/09 2:00 AM	0.35	0.23	0.58
4/21/09 5:00 AM	0.49	0.24	0.73
4/21/09 8:00 AM	0.47	0.20	0.67
4/21/09 11:00 AM	0.38	0.20	0.58
4/21/09 2:00 PM	0.12	0.21	0.33
4/21/09 5:00 PM	0.17	0.19	0.36
4/21/09 8:00 PM	0.15	0.17	0.32
4/21/09 11:00 PM	0.09	0.20	0.29
4/22/09 2:00 AM	0.00	0.23	0.23
4/22/09 5:00 AM	0.17	0.23	0.40
4/22/09 8:00 AM	0.31	0.17	0.48
4/22/09 11:00 AM	0.17	0.20	0.36
4/22/09 2:00 PM	0.40	0.20	0.60
4/22/09 5:00 PM	0.42	0.21	0.63
4/22/09 8:00 PM	0.16	0.24	0.41
4/22/09 11:00 PM	0.00	0.28	0.28
4/23/09 2:00 AM	0.00	0.33	0.33
4/23/09 5:00 AM	0.00	0.49	0.49
4/23/09 8:00 AM	0.02	0.47	0.49
4/23/09 11:00 AM	0.00	0.48	0.48
4/23/09 2:00 PM	0.01	0.51	0.52
4/23/09 5:00 PM	0.05	0.52	0.57
4/23/09 8:00 PM	0.07	0.33	0.39
4/23/09 11:00 PM	0.00	0.33	0.33
4/24/09 2:00 AM	0.00	0.32	0.32
4/24/09 5:00 AM	0.00	0.32	0.32
4/24/09 8:00 AM	0.00	0.25	0.25
4/24/09 11:00 AM	0.00	0.26	0.26
4/24/09 2:00 PM	0.00	0.30	0.30
4/24/09 5:00 PM	0.00	0.35	0.35
4/24/09 8:00 PM	0.00	0.39	0.39
4/24/09 11:00 PM	0.00	0.42	0.42
4/25/09 2:00 AM	0.00	0.44	0.44
4/25/09 5:00 AM	0.00	0.45	0.45
4/25/09 8:00 AM	0.00	0.36	0.36
4/25/09 11:00 AM	0.00	0.31	0.31
4/25/09 2:00 PM	0.00	0.31	0.31
4/25/09 5:00 PM	0.00	0.32	0.32

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
4/25/09 8:00 PM	0.00	0.32	0.32
4/25/09 11:00 PM	0.00	0.31	0.31
4/26/09 2:00 AM	0.00	0.30	0.30
4/26/09 5:00 AM	0.00	0.32	0.33
4/26/09 8:00 AM	0.02	0.30	0.32
4/26/09 11:00 AM	0.00	0.29	0.30
4/26/09 2:00 PM	0.03	0.30	0.33
4/26/09 5:00 PM	0.21	0.36	0.57
4/26/09 8:00 PM	0.22	0.35	0.57
4/26/09 11:00 PM	0.20	0.30	0.50
4/27/09 2:00 AM	0.19	0.31	0.50
4/27/09 5:00 AM	0.20	0.29	0.49
4/27/09 8:00 AM	0.20	0.27	0.48
4/27/09 11:00 AM	0.19	0.29	0.48
4/27/09 2:00 PM	0.18	0.32	0.51
4/27/09 5:00 PM	0.17	0.30	0.47
4/27/09 8:00 PM	0.17	0.26	0.43
4/27/09 11:00 PM	0.16	0.22	0.38
4/28/09 2:00 AM	0.15	0.21	0.37
4/28/09 5:00 AM	0.15	0.22	0.37
4/28/09 8:00 AM	0.17	0.21	0.38
4/28/09 11:00 AM	0.15	0.21	0.36
4/28/09 2:00 PM	0.15	0.21	0.37
4/28/09 5:00 PM	0.15	0.21	0.36
4/28/09 8:00 PM	0.15	0.25	0.41
4/28/09 11:00 PM	0.15	0.30	0.45
4/29/09 2:00 AM	0.16	0.30	0.46
4/29/09 5:00 AM	0.16	0.32	0.47
4/29/09 8:00 AM	0.17	0.31	0.48
4/29/09 11:00 AM	0.16	0.33	0.49
4/29/09 2:00 PM	0.15	0.41	0.56
4/29/09 5:00 PM	0.10	0.22	0.33
4/29/09 8:00 PM	0.11	0.02	0.13
4/29/09 11:00 PM	0.11	0.00	0.11
4/30/09 2:00 AM	0.11	0.00	0.11
4/30/09 5:00 AM	0.11	0.00	0.11
4/30/09 8:00 AM	0.12	0.00	0.12
4/30/09 11:00 AM	0.21	0.00	0.21
4/30/09 2:00 PM	0.44	0.00	0.44
4/30/09 5:00 PM	0.70	0.00	0.70
4/30/09 8:00 PM	0.67	0.00	0.67
4/30/09 11:00 PM	0.72	0.00	0.72
5/1/09 2:00 AM	0.70	0.00	0.70
5/1/09 5:00 AM	0.64	0.00	0.64
5/1/09 8:00 AM	0.74	0.00	0.74
5/1/09 11:00 AM	0.95	0.00	0.95
5/1/09 2:00 PM	0.31	0.00	0.31
5/1/09 5:00 PM	0.14	0.00	0.14
5/1/09 8:00 PM	0.11	0.00	0.11
5/1/09 11:00 PM	0.09	0.00	0.09
5/2/09 2:00 AM	0.09	0.00	0.09
5/2/09 5:00 AM	0.09	0.00	0.09
5/2/09 8:00 AM	0.11	0.00	0.11
5/2/09 11:00 AM	0.10	0.00	0.10

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
5/2/09 2:00 PM	0.09	0.00	0.09
5/2/09 5:00 PM	0.08	0.00	0.08
5/2/09 8:00 PM	0.07	0.00	0.07
5/2/09 11:00 PM	0.08	0.00	0.08
5/3/09 2:00 AM	0.08	0.00	0.08
5/3/09 5:00 AM	0.09	0.00	0.09
5/3/09 8:00 AM	0.10	0.00	0.10
5/3/09 11:00 AM	0.08	0.00	0.08
5/3/09 2:00 PM	0.08	0.00	0.08
5/3/09 5:00 PM	0.07	0.00	0.07
5/3/09 8:00 PM	0.08	0.00	0.08
5/3/09 11:00 PM	0.08	0.00	0.08
5/4/09 2:00 AM	0.07	0.00	0.07
5/4/09 5:00 AM	0.09	0.00	0.09
5/4/09 8:00 AM	0.10	0.00	0.10
5/4/09 11:00 AM	0.08	0.00	0.08
5/4/09 2:00 PM	0.08	0.00	0.08
5/4/09 5:00 PM	0.07	0.00	0.07
5/4/09 8:00 PM	0.07	0.00	0.07
5/4/09 11:00 PM	0.07	0.00	0.07
5/5/09 2:00 AM	0.07	0.00	0.07
5/5/09 5:00 AM	0.09	0.00	0.09
5/5/09 8:00 AM	0.45	0.00	0.45
5/5/09 11:00 AM	0.15	0.00	0.15
5/5/09 2:00 PM	0.14	0.00	0.14
5/5/09 5:00 PM	0.13	0.00	0.13
5/5/09 8:00 PM	0.14	0.00	0.14
5/5/09 11:00 PM	0.14	0.00	0.14
5/6/09 2:00 AM	0.14	0.00	0.14
5/6/09 5:00 AM	0.14	0.00	0.14
5/6/09 8:00 AM	0.15	0.00	0.15
5/6/09 11:00 AM	0.14	0.00	0.14
5/6/09 2:00 PM	0.13	0.00	0.13
5/6/09 5:00 PM	0.13	0.00	0.13
5/6/09 8:00 PM	0.14	0.00	0.14
5/6/09 11:00 PM	0.13	0.00	0.13
5/7/09 2:00 AM	0.13	0.00	0.13
5/7/09 5:00 AM	0.14	0.00	0.14
5/7/09 8:00 AM	0.15	0.00	0.15
5/7/09 11:00 AM	0.13	0.00	0.13
5/7/09 2:00 PM	0.13	0.00	0.13
5/7/09 5:00 PM	0.13	0.00	0.13
5/7/09 8:00 PM	0.13	0.00	0.13
5/7/09 11:00 PM	0.13	0.00	0.13
5/8/09 2:00 AM	0.13	0.00	0.13
5/8/09 5:00 AM	0.12	0.00	0.12
5/8/09 8:00 AM	0.19	0.00	0.19
5/8/09 11:00 AM	0.09	0.00	0.09
5/8/09 2:00 PM	0.16	0.00	0.16
5/8/09 5:00 PM	0.09	0.00	0.09
5/8/09 8:00 PM	0.09	0.00	0.09
5/8/09 11:00 PM	0.09	0.00	0.09
5/9/09 2:00 AM	0.09	0.00	0.09
5/9/09 5:00 AM	0.09	0.00	0.09

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
5/9/09 8:00 AM	0.14	0.00	0.14
5/9/09 11:00 AM	0.15	0.00	0.15
5/9/09 2:00 PM	0.13	0.00	0.13
5/9/09 5:00 PM	0.12	0.00	0.12
5/9/09 8:00 PM	0.13	0.00	0.13
5/9/09 11:00 PM	0.13	0.00	0.13
5/10/09 2:00 AM	0.12	0.00	0.12
5/10/09 5:00 AM	0.13	0.00	0.13
5/10/09 8:00 AM	0.14	0.00	0.14
5/10/09 11:00 AM	0.13	0.00	0.13
5/10/09 2:00 PM	0.12	0.00	0.12
5/10/09 5:00 PM	0.12	0.00	0.13
5/10/09 8:00 PM	0.12	0.06	0.18
5/10/09 11:00 PM	0.12	0.15	0.27
5/11/09 2:00 AM	0.12	0.09	0.21
5/11/09 5:00 AM	0.13	0.07	0.19
5/11/09 8:00 AM	0.13	0.07	0.21
5/11/09 11:00 AM	0.12	0.08	0.20
5/11/09 2:00 PM	0.12	0.09	0.21
5/11/09 5:00 PM	0.18	0.09	0.27
5/11/09 8:00 PM	0.32	0.10	0.42
5/11/09 11:00 PM	0.32	0.10	0.41
5/12/09 2:00 AM	0.32	0.09	0.42
5/12/09 5:00 AM	0.32	0.10	0.42
5/12/09 8:00 AM	0.35	0.13	0.48
5/12/09 11:00 AM	0.29	0.10	0.39
5/12/09 2:00 PM	0.30	0.10	0.40
5/12/09 5:00 PM	0.29	0.11	0.40
5/12/09 8:00 PM	0.29	0.12	0.41
5/12/09 11:00 PM	0.30	0.12	0.41
5/13/09 2:00 AM	0.31	0.12	0.44
5/13/09 5:00 AM	0.33	0.12	0.45
5/13/09 8:00 AM	0.37	0.11	0.48
5/13/09 11:00 AM	0.38	0.10	0.48
5/13/09 2:00 PM	0.39	0.12	0.51
5/13/09 5:00 PM	0.39	0.12	0.51
5/13/09 8:00 PM	0.39	0.12	0.51
5/13/09 11:00 PM	0.39	0.13	0.52
5/14/09 2:00 AM	0.39	0.13	0.52
5/14/09 5:00 AM	0.39	0.15	0.54
5/14/09 8:00 AM	0.39	0.23	0.62
5/14/09 11:00 AM	0.37	0.26	0.63
5/14/09 2:00 PM	0.37	0.28	0.65
5/14/09 5:00 PM	0.37	0.24	0.61
5/14/09 8:00 PM	0.35	0.29	0.64
5/14/09 11:00 PM	0.30	0.25	0.55
5/15/09 2:00 AM	0.28	0.24	0.52
5/15/09 5:00 AM	0.31	0.20	0.51
5/15/09 8:00 AM	0.37	0.18	0.55
5/15/09 11:00 AM	3.79	0.20	3.99
5/15/09 2:00 PM	1.02	0.20	1.22
5/15/09 5:00 PM	0.52	0.20	0.72
5/15/09 8:00 PM	0.35	0.18	0.53
5/15/09 11:00 PM	0.34	0.18	0.52

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
5/16/09 2:00 AM	0.34	0.17	0.51
5/16/09 5:00 AM	0.34	0.18	0.52
5/16/09 8:00 AM	0.39	0.18	0.56
5/16/09 11:00 AM	0.34	0.14	0.48
5/16/09 2:00 PM	0.38	0.09	0.47
5/16/09 5:00 PM	0.34	0.15	0.48
5/16/09 8:00 PM	0.34	0.21	0.55
5/16/09 11:00 PM	0.34	0.21	0.55
5/17/09 2:00 AM	0.33	0.21	0.53
5/17/09 5:00 AM	0.33	0.22	0.55
5/17/09 8:00 AM	0.37	0.22	0.59
5/17/09 11:00 AM	0.35	0.23	0.58
5/17/09 2:00 PM	0.35	0.22	0.57
5/17/09 5:00 PM	0.33	0.23	0.56
5/17/09 8:00 PM	0.36	0.23	0.59
5/17/09 11:00 PM	0.36	0.23	0.59
5/18/09 2:00 AM	0.38	0.23	0.61
5/18/09 5:00 AM	0.37	0.24	0.61
5/18/09 8:00 AM	0.40	0.27	0.67
5/18/09 11:00 AM	0.39	0.27	0.66
5/18/09 2:00 PM	0.38	0.26	0.65
5/18/09 5:00 PM	0.38	0.26	0.63
5/18/09 8:00 PM	0.38	0.25	0.63
5/18/09 11:00 PM	0.38	0.25	0.63
5/19/09 2:00 AM	0.39	0.18	0.57
5/19/09 5:00 AM	0.39	0.17	0.56
5/19/09 8:00 AM	0.42	0.26	0.68
5/19/09 11:00 AM	0.38	0.24	0.62
5/19/09 2:00 PM	0.40	0.24	0.64
5/19/09 5:00 PM	0.39	0.25	0.64
5/19/09 8:00 PM	0.38	0.26	0.64
5/19/09 11:00 PM	0.36	0.26	0.63
5/20/09 2:00 AM	0.35	0.24	0.60
5/20/09 5:00 AM	0.35	0.23	0.58
5/20/09 8:00 AM	0.37	0.24	0.61
5/20/09 11:00 AM	0.36	0.23	0.59
5/20/09 2:00 PM	0.36	0.16	0.52
5/20/09 5:00 PM	0.34	0.22	0.57
5/20/09 8:00 PM	0.34	0.24	0.59
5/20/09 11:00 PM	0.34	0.25	0.59
5/21/09 2:00 AM	0.32	0.25	0.57
5/21/09 5:00 AM	0.32	0.24	0.56
5/21/09 8:00 AM	0.35	0.26	0.61
5/21/09 11:00 AM	0.33	0.29	0.63
5/21/09 2:00 PM	0.33	0.31	0.64
5/21/09 5:00 PM	0.28	0.31	0.59
5/21/09 8:00 PM	0.33	0.30	0.62
5/21/09 11:00 PM	0.31	0.29	0.60
5/22/09 2:00 AM	0.32	0.29	0.61
5/22/09 5:00 AM	0.33	0.27	0.60
5/22/09 8:00 AM	0.37	0.22	0.59
5/22/09 11:00 AM	0.34	0.21	0.55
5/22/09 2:00 PM	0.33	0.19	0.53
5/22/09 5:00 PM	0.22	0.20	0.41

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
5/22/09 8:00 PM	0.31	0.19	0.50
5/22/09 11:00 PM	0.30	0.18	0.49
5/23/09 2:00 AM	0.30	0.19	0.49
5/23/09 5:00 AM	0.30	0.20	0.51
5/23/09 8:00 AM	0.34	0.21	0.55
5/23/09 11:00 AM	0.31	0.23	0.55
5/23/09 2:00 PM	0.33	0.30	0.63
5/23/09 5:00 PM	0.11	0.30	0.40
5/23/09 8:00 PM	0.00	0.32	0.32
5/23/09 11:00 PM	0.00	0.32	0.32
5/24/09 2:00 AM	0.00	0.27	0.27
5/24/09 5:00 AM	0.00	0.24	0.24
5/24/09 8:00 AM	0.00	0.29	0.29
5/24/09 11:00 AM	0.00	0.29	0.29
5/24/09 2:00 PM	0.00	0.32	0.32
5/24/09 5:00 PM	0.00	0.31	0.31
5/24/09 8:00 PM	0.00	0.29	0.29
5/24/09 11:00 PM	0.00	0.31	0.31
5/25/09 2:00 AM	0.00	0.33	0.33
5/25/09 5:00 AM	0.00	0.34	0.34
5/25/09 8:00 AM	0.00	0.33	0.33
5/25/09 11:00 AM	0.00	0.28	0.28
5/25/09 2:00 PM	0.00	0.27	0.27
5/25/09 5:00 PM	0.00	0.26	0.26
5/25/09 8:00 PM	0.00	0.25	0.25
5/25/09 11:00 PM	0.00	0.25	0.25
5/26/09 2:00 AM	0.00	0.24	0.24
5/26/09 5:00 AM	0.00	0.25	0.25
5/26/09 8:00 AM	0.00	0.26	0.26
5/26/09 11:00 AM	0.00	0.31	0.31
5/26/09 2:00 PM	0.26	0.35	0.61
5/26/09 5:00 PM	0.33	0.35	0.68
5/26/09 8:00 PM	0.50	0.40	0.91
5/26/09 11:00 PM	0.49	0.40	0.89
5/27/09 2:00 AM	0.49	0.40	0.89
5/27/09 5:00 AM	0.49	0.47	0.96
5/27/09 8:00 AM	0.44	0.48	0.92
5/27/09 11:00 AM	0.40	0.47	0.87
5/27/09 2:00 PM	0.52	0.47	1.00
5/27/09 5:00 PM	0.46	0.49	0.95
5/27/09 8:00 PM	0.55	0.47	1.02
5/27/09 11:00 PM	0.53	0.46	1.00
5/28/09 2:00 AM	0.49	0.47	0.96
5/28/09 5:00 AM	0.46	0.51	0.98
5/28/09 8:00 AM	0.48	0.53	1.02
5/28/09 11:00 AM	0.42	0.55	0.97
5/28/09 2:00 PM	0.36	0.42	0.78
5/28/09 5:00 PM	0.27	0.30	0.58
5/28/09 8:00 PM	0.41	0.46	0.87
5/28/09 11:00 PM	0.43	0.48	0.92
5/29/09 2:00 AM	0.45	0.44	0.89
5/29/09 5:00 AM	0.40	0.41	0.81
5/29/09 8:00 AM	0.46	0.37	0.83
5/29/09 11:00 AM	0.41	0.45	0.86

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
5/29/09 2:00 PM	0.44	0.51	0.94
5/29/09 5:00 PM	0.45	0.70	1.15
5/29/09 8:00 PM	0.39	0.54	0.93
5/29/09 11:00 PM	0.34	0.49	0.83
5/30/09 2:00 AM	0.41	0.57	0.97
5/30/09 5:00 AM	0.40	0.53	0.93
5/30/09 8:00 AM	0.43	0.65	1.08
5/30/09 11:00 AM	0.40	0.52	0.92
5/30/09 2:00 PM	0.43	0.47	0.90
5/30/09 5:00 PM	0.39	0.48	0.87
5/30/09 8:00 PM	0.37	0.40	0.77
5/30/09 11:00 PM	0.35	0.35	0.70
5/31/09 2:00 AM	0.36	0.31	0.67
5/31/09 5:00 AM	0.37	0.32	0.69
5/31/09 8:00 AM	0.44	0.25	0.69
5/31/09 11:00 AM	0.47	0.28	0.74
5/31/09 2:00 PM	0.44	0.34	0.78
5/31/09 5:00 PM	0.36	0.30	0.66
5/31/09 8:00 PM	0.40	0.32	0.72
5/31/09 11:00 PM	0.35	0.31	0.66
6/1/09 2:00 AM	0.37	0.30	0.66
6/1/09 5:00 AM	0.36	0.30	0.66
6/1/09 8:00 AM	0.39	0.33	0.71
6/1/09 11:00 AM	0.38	0.35	0.73
6/1/09 2:00 PM	0.34	0.35	0.69
6/1/09 5:00 PM	0.27	0.40	0.66
6/1/09 8:00 PM	0.22	0.41	0.62
6/1/09 11:00 PM	0.27	0.41	0.68
6/2/09 2:00 AM	0.56	0.42	0.98
6/2/09 5:00 AM	0.44	0.42	0.86
6/2/09 8:00 AM	0.09	0.43	0.52
6/2/09 11:00 AM	0.12	0.47	0.59
6/2/09 2:00 PM	0.27	0.45	0.73
6/2/09 5:00 PM	0.60	0.46	1.06
6/2/09 8:00 PM	0.60	0.45	1.05
6/2/09 11:00 PM	0.61	0.19	0.79
6/3/09 2:00 AM	0.64	0.18	0.83
6/3/09 5:00 AM	0.72	0.25	0.97
6/3/09 8:00 AM	0.60	0.52	1.12
6/3/09 11:00 AM	0.39	0.47	0.86
6/3/09 2:00 PM	0.57	0.36	0.93
6/3/09 5:00 PM	0.62	0.34	0.95
6/3/09 8:00 PM	0.59	0.33	0.92
6/3/09 11:00 PM	0.62	0.22	0.84
6/4/09 2:00 AM	0.71	0.16	0.87
6/4/09 5:00 AM	0.66	0.16	0.82
6/4/09 8:00 AM	0.69	0.39	1.08
6/4/09 11:00 AM	0.70	0.56	1.27
6/4/09 2:00 PM	0.72	0.51	1.22
6/4/09 5:00 PM	0.63	0.48	1.10
6/4/09 8:00 PM	0.59	0.40	0.99
6/4/09 11:00 PM	0.63	0.35	0.98
6/5/09 2:00 AM	0.77	0.45	1.22
6/5/09 5:00 AM	0.71	0.39	1.10

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
6/5/09 8:00 AM	0.71	0.42	1.13
6/5/09 11:00 AM	0.72	0.41	1.13
6/5/09 2:00 PM	0.65	0.42	1.07
6/5/09 5:00 PM	0.44	0.39	0.83
6/5/09 8:00 PM	0.57	0.52	1.09
6/5/09 11:00 PM	0.58	0.42	1.00
6/6/09 2:00 AM	0.56	0.44	1.00
6/6/09 5:00 AM	0.57	0.42	0.99
6/6/09 8:00 AM	0.62	0.50	1.12
6/6/09 11:00 AM	0.63	0.75	1.39
6/6/09 2:00 PM	0.61	0.38	1.00
6/6/09 5:00 PM	0.57	0.35	0.93
6/6/09 8:00 PM	0.57	0.29	0.87
6/6/09 11:00 PM	0.58	0.30	0.88
6/7/09 2:00 AM	0.58	0.27	0.85
6/7/09 5:00 AM	0.64	0.27	0.92
6/7/09 8:00 AM	0.68	0.31	0.99
6/7/09 11:00 AM	0.64	0.30	0.94
6/7/09 2:00 PM	0.56	0.27	0.83
6/7/09 5:00 PM	0.46	0.26	0.73
6/7/09 8:00 PM	0.42	0.25	0.68
6/7/09 11:00 PM	0.24	0.28	0.52
6/8/09 2:00 AM	0.09	0.27	0.36
6/8/09 5:00 AM	0.09	0.29	0.38
6/8/09 8:00 AM	0.22	0.29	0.51
6/8/09 11:00 AM	0.29	0.29	0.58
6/8/09 2:00 PM	0.29	0.30	0.59
6/8/09 5:00 PM	0.26	0.28	0.54
6/8/09 8:00 PM	0.26	0.31	0.57
6/8/09 11:00 PM	0.26	0.28	0.55
6/9/09 2:00 AM	0.26	0.27	0.53
6/9/09 5:00 AM	0.26	0.29	0.55
6/9/09 8:00 AM	0.31	0.28	0.59
6/9/09 11:00 AM	0.34	0.27	0.61
6/9/09 2:00 PM	0.35	0.33	0.68
6/9/09 5:00 PM	0.34	0.36	0.70
6/9/09 8:00 PM	0.36	0.33	0.69
6/9/09 11:00 PM	0.35	0.35	0.70
6/10/09 2:00 AM	0.35	0.34	0.69
6/10/09 5:00 AM	0.35	0.39	0.75
6/10/09 8:00 AM	0.56	0.51	1.07
6/10/09 11:00 AM	0.69	0.47	1.17
6/10/09 2:00 PM	0.95	0.42	1.37
6/10/09 5:00 PM	0.66	0.43	1.09
6/10/09 8:00 PM	0.65	0.43	1.07
6/10/09 11:00 PM	0.58	0.37	0.96
6/11/09 2:00 AM	0.26	0.24	0.50
6/11/09 5:00 AM	0.27	0.30	0.56
6/11/09 8:00 AM	0.93	0.30	1.23
6/11/09 11:00 AM	0.66	0.31	0.97
6/11/09 2:00 PM	0.59	0.32	0.92
6/11/09 5:00 PM	0.58	0.35	0.93
6/11/09 8:00 PM	0.60	0.30	0.90
6/11/09 11:00 PM	0.62	0.05	0.67

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
6/12/09 2:00 AM	0.62	0.00	0.62
6/12/09 5:00 AM	0.60	0.00	0.60
6/12/09 8:00 AM	0.60	0.00	0.60
6/12/09 11:00 AM	0.58	0.00	0.58
6/12/09 2:00 PM	0.60	0.00	0.60
6/12/09 5:00 PM	0.57	0.00	0.57
6/12/09 8:00 PM	0.58	0.00	0.58
6/12/09 11:00 PM	0.61	0.00	0.61
6/13/09 2:00 AM	0.64	0.00	0.64
6/13/09 5:00 AM	0.66	0.00	0.66
6/13/09 8:00 AM	0.63	0.00	0.64
6/13/09 11:00 AM	0.66	0.11	0.77
6/13/09 2:00 PM	0.65	0.57	1.22
6/13/09 5:00 PM	0.64	0.41	1.05
6/13/09 8:00 PM	0.66	0.24	0.90
6/13/09 11:00 PM	0.65	0.21	0.86
6/14/09 2:00 AM	0.68	0.24	0.92
6/14/09 5:00 AM	0.64	0.15	0.79
6/14/09 8:00 AM	0.66	0.09	0.75
6/14/09 11:00 AM	0.68	0.09	0.76
6/14/09 2:00 PM	0.65	0.16	0.81
6/14/09 5:00 PM	0.44	0.20	0.64
6/14/09 8:00 PM	0.43	0.19	0.62
6/14/09 11:00 PM	0.42	0.12	0.53
6/15/09 2:00 AM	0.46	0.08	0.54
6/15/09 5:00 AM	0.46	0.08	0.55
6/15/09 8:00 AM	0.49	0.09	0.57
6/15/09 11:00 AM	0.54	0.09	0.63
6/15/09 2:00 PM	0.53	0.09	0.63
6/15/09 5:00 PM	0.50	0.12	0.62
6/15/09 8:00 PM	0.33	0.21	0.54
6/15/09 11:00 PM	0.28	0.22	0.50
6/16/09 2:00 AM	0.40	0.21	0.61
6/16/09 5:00 AM	0.50	0.20	0.69
6/16/09 8:00 AM	0.60	0.19	0.79
6/16/09 11:00 AM	0.60	0.19	0.79
6/16/09 2:00 PM	0.58	0.19	0.77
6/16/09 5:00 PM	0.50	0.21	0.70
6/16/09 8:00 PM	0.47	0.21	0.68
6/16/09 11:00 PM	0.36	0.43	0.79
6/17/09 2:00 AM	0.22	0.58	0.80
6/17/09 5:00 AM	0.22	0.35	0.57
6/17/09 8:00 AM	0.27	0.26	0.53
6/17/09 11:00 AM	0.27	0.28	0.55
6/17/09 2:00 PM	0.47	0.29	0.76
6/17/09 5:00 PM	0.55	0.30	0.85
6/17/09 8:00 PM	0.50	0.35	0.85
6/17/09 11:00 PM	0.43	0.08	0.51
6/18/09 2:00 AM	0.39	0.00	0.39
6/18/09 5:00 AM	0.45	0.00	0.45
6/18/09 8:00 AM	0.61	0.00	0.61
6/18/09 11:00 AM	0.66	0.00	0.66
6/18/09 2:00 PM	0.60	0.00	0.60
6/18/09 5:00 PM	0.38	0.00	0.38

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
6/18/09 8:00 PM	0.26	0.00	0.26
6/18/09 11:00 PM	0.36	0.00	0.36
6/19/09 2:00 AM	0.38	0.00	0.38
6/19/09 5:00 AM	0.29	0.00	0.29
6/19/09 8:00 AM	0.21	0.00	0.21
6/19/09 11:00 AM	0.23	0.00	0.23
6/19/09 2:00 PM	0.22	0.00	0.22
6/19/09 5:00 PM	0.36	0.00	0.36
6/19/09 8:00 PM	0.38	0.00	0.38
6/19/09 11:00 PM	0.39	0.00	0.39
6/20/09 2:00 AM	0.40	0.00	0.40
6/20/09 5:00 AM	0.40	0.00	0.40
6/20/09 8:00 AM	0.41	0.00	0.41
6/20/09 11:00 AM	0.41	0.00	0.41
6/20/09 2:00 PM	0.43	0.00	0.43
6/20/09 5:00 PM	0.47	0.00	0.47
6/20/09 8:00 PM	0.42	0.00	0.42
6/20/09 11:00 PM	0.42	0.00	0.42
6/21/09 2:00 AM	0.41	0.00	0.41
6/21/09 5:00 AM	0.41	0.00	0.41
6/21/09 8:00 AM	0.43	0.00	0.43
6/21/09 11:00 AM	0.45	0.00	0.45
6/21/09 2:00 PM	0.54	0.00	0.54
6/21/09 5:00 PM	0.58	0.00	0.58
6/21/09 8:00 PM	0.44	0.00	0.44
6/21/09 11:00 PM	0.46	0.00	0.46
6/22/09 2:00 AM	0.46	0.00	0.46
6/22/09 5:00 AM	0.45	0.00	0.45
6/22/09 8:00 AM	0.14	0.00	0.14
6/22/09 11:00 AM	0.00	0.00	0.00
6/22/09 2:00 PM	0.00	0.00	0.00
6/22/09 5:00 PM	0.00	0.00	0.00
6/22/09 8:00 PM	0.00	0.00	0.00
6/22/09 11:00 PM	0.00	0.00	0.00
6/23/09 2:00 AM	0.00	0.00	0.00
6/23/09 5:00 AM	0.00	0.00	0.00
6/23/09 8:00 AM	0.00	0.00	0.00
6/23/09 11:00 AM	0.44	0.00	0.44
6/23/09 2:00 PM	1.15	0.00	1.15
6/23/09 5:00 PM	1.05	0.00	1.05
6/23/09 8:00 PM	0.99	0.00	0.99
6/23/09 11:00 PM	0.99	0.00	0.99
6/24/09 2:00 AM	0.99	0.00	0.99
6/24/09 5:00 AM	0.99	0.00	0.99
6/24/09 8:00 AM	0.97	0.00	0.97
6/24/09 11:00 AM	0.85	0.00	0.85
6/24/09 2:00 PM	0.50	0.00	0.50
6/24/09 5:00 PM	0.48	0.00	0.48
6/24/09 8:00 PM	0.47	0.00	0.47
6/24/09 11:00 PM	0.44	0.00	0.44
6/25/09 2:00 AM	0.44	0.00	0.44
6/25/09 5:00 AM	0.42	0.00	0.42
6/25/09 8:00 AM	0.47	0.00	0.47
6/25/09 11:00 AM	0.50	0.00	0.50

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
6/25/09 2:00 PM	0.51	0.00	0.51
6/25/09 5:00 PM	0.48	0.00	0.48
6/25/09 8:00 PM	0.50	0.00	0.50
6/25/09 11:00 PM	0.49	0.00	0.49
6/26/09 2:00 AM	0.49	0.00	0.49
6/26/09 5:00 AM	0.49	0.00	0.49
6/26/09 8:00 AM	0.49	0.00	0.49
6/26/09 11:00 AM	0.51	0.00	0.51
6/26/09 2:00 PM	0.50	0.00	0.50
6/26/09 5:00 PM	0.47	0.00	0.47
6/26/09 8:00 PM	0.48	0.00	0.48
6/26/09 11:00 PM	0.50	0.00	0.50
6/27/09 2:00 AM	0.48	0.00	0.48
6/27/09 5:00 AM	0.51	0.00	0.51
6/27/09 8:00 AM	0.49	0.00	0.49
6/27/09 11:00 AM	0.49	0.00	0.49
6/27/09 2:00 PM	0.50	0.00	0.50
6/27/09 5:00 PM	0.47	0.00	0.47
6/27/09 8:00 PM	0.46	0.00	0.46
6/27/09 11:00 PM	0.47	0.00	0.47
6/28/09 2:00 AM	0.48	0.00	0.48
6/28/09 5:00 AM	0.48	0.00	0.48
6/28/09 8:00 AM	0.48	0.00	0.48
6/28/09 11:00 AM	0.49	0.04	0.53
6/28/09 2:00 PM	0.47	0.16	0.64
6/28/09 5:00 PM	0.44	0.52	0.96
6/28/09 8:00 PM	0.45	0.55	1.00
6/28/09 11:00 PM	0.45	0.32	0.77
6/29/09 2:00 AM	0.45	0.27	0.72
6/29/09 5:00 AM	0.44	0.31	0.76
6/29/09 8:00 AM	0.45	0.29	0.74
6/29/09 11:00 AM	0.44	0.28	0.72
6/29/09 2:00 PM	0.44	0.29	0.73
6/29/09 5:00 PM	0.41	0.27	0.68
6/29/09 8:00 PM	0.41	0.26	0.67
6/29/09 11:00 PM	0.42	0.26	0.68
6/30/09 2:00 AM	0.41	0.25	0.66
6/30/09 5:00 AM	0.40	0.24	0.64
6/30/09 8:00 AM	0.40	0.26	0.66
6/30/09 11:00 AM	0.41	0.27	0.68
6/30/09 2:00 PM	0.28	0.24	0.52
6/30/09 5:00 PM	0.00	0.22	0.22
6/30/09 8:00 PM	0.00	0.21	0.21
6/30/09 11:00 PM	0.00	0.21	0.21
7/1/09 2:00 AM	0.00	0.20	0.20
7/1/09 5:00 AM	0.00	0.20	0.20
7/1/09 8:00 AM	0.00	0.25	0.25
7/1/09 11:00 AM	0.00	0.28	0.28
7/1/09 2:00 PM	0.00	0.28	0.28
7/1/09 5:00 PM	0.00	0.28	0.28
7/1/09 8:00 PM	0.00	0.28	0.28
7/1/09 11:00 PM	0.00	0.28	0.28
7/2/09 2:00 AM	0.00	0.24	0.24
7/2/09 5:00 AM	0.00	0.25	0.25

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
7/2/09 8:00 AM	0.00	0.29	0.29
7/2/09 11:00 AM	0.00	0.33	0.33
7/2/09 2:00 PM	0.00	0.37	0.37
7/2/09 5:00 PM	0.00	0.42	0.42
7/2/09 8:00 PM	0.00	0.55	0.55
7/2/09 11:00 PM	0.00	0.36	0.36
7/3/09 2:00 AM	0.00	0.32	0.32
7/3/09 5:00 AM	0.00	0.30	0.30
7/3/09 8:00 AM	0.00	0.57	0.57
7/3/09 11:00 AM	0.00	0.83	0.83
7/3/09 2:00 PM	0.00	0.57	0.57
7/3/09 5:00 PM	0.00	0.70	0.70
7/3/09 8:00 PM	0.00	0.53	0.53
7/3/09 11:00 PM	0.00	0.37	0.37
7/4/09 2:00 AM	0.00	0.38	0.38
7/4/09 5:00 AM	0.00	0.44	0.44
7/4/09 8:00 AM	0.00	0.48	0.48
7/4/09 11:00 AM	0.00	0.42	0.42
7/4/09 2:00 PM	0.00	0.40	0.40
7/4/09 5:00 PM	0.00	0.37	0.37
7/4/09 8:00 PM	0.00	0.32	0.32
7/4/09 11:00 PM	0.00	0.30	0.30
7/5/09 2:00 AM	0.00	0.31	0.31
7/5/09 5:00 AM	0.00	0.28	0.28
7/5/09 8:00 AM	0.01	0.27	0.28
7/5/09 11:00 AM	0.01	0.26	0.28
7/5/09 2:00 PM	0.05	0.28	0.34
7/5/09 5:00 PM	0.04	0.31	0.35
7/5/09 8:00 PM	0.04	0.35	0.39
7/5/09 11:00 PM	0.05	0.35	0.40
7/6/09 2:00 AM	0.04	0.43	0.46
7/6/09 5:00 AM	0.04	0.25	0.29
7/6/09 8:00 AM	0.10	0.12	0.22
7/6/09 11:00 AM	0.11	0.08	0.19
7/6/09 2:00 PM	0.11	0.20	0.31
7/6/09 5:00 PM	0.09	0.38	0.48
7/6/09 8:00 PM	0.09	0.40	0.49
7/6/09 11:00 PM	0.13	0.35	0.48
7/7/09 2:00 AM	0.11	0.31	0.42
7/7/09 5:00 AM	0.12	0.33	0.46
7/7/09 8:00 AM	0.14	0.41	0.54
7/7/09 11:00 AM	0.14	0.36	0.51
7/7/09 2:00 PM	0.14	0.31	0.45
7/7/09 5:00 PM	0.12	0.29	0.40
7/7/09 8:00 PM	0.10	0.29	0.39
7/7/09 11:00 PM	0.14	0.15	0.29
7/8/09 2:00 AM	0.16	0.13	0.29
7/8/09 5:00 AM	0.18	0.12	0.30
7/8/09 8:00 AM	0.23	0.25	0.48
7/8/09 11:00 AM	0.26	0.29	0.55
7/8/09 2:00 PM	0.29	0.33	0.62
7/8/09 5:00 PM	0.31	0.27	0.59
7/8/09 8:00 PM	0.35	0.28	0.64
7/8/09 11:00 PM	0.35	0.36	0.72

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
7/9/09 2:00 AM	0.35	0.29	0.64
7/9/09 5:00 AM	0.36	0.28	0.64
7/9/09 8:00 AM	0.45	0.35	0.80
7/9/09 11:00 AM	0.49	0.37	0.86
7/9/09 2:00 PM	0.39	0.35	0.74
7/9/09 5:00 PM	0.36	0.34	0.71
7/9/09 8:00 PM	0.37	0.31	0.68
7/9/09 11:00 PM	0.36	0.44	0.80
7/10/09 2:00 AM	0.35	0.35	0.70
7/10/09 5:00 AM	0.36	0.51	0.87
7/10/09 8:00 AM	0.41	0.59	1.00
7/10/09 11:00 AM	0.61	0.69	1.30
7/10/09 2:00 PM	0.63	0.63	1.26
7/10/09 5:00 PM	0.41	0.49	0.89
7/10/09 8:00 PM	0.38	0.45	0.83
7/10/09 11:00 PM	0.35	0.44	0.79
7/11/09 2:00 AM	0.36	0.42	0.78
7/11/09 5:00 AM	0.35	0.41	0.77
7/11/09 8:00 AM	0.37	0.40	0.78
7/11/09 11:00 AM	0.42	0.39	0.82
7/11/09 2:00 PM	0.43	0.43	0.87
7/11/09 5:00 PM	0.40	0.47	0.88
7/11/09 8:00 PM	0.43	2.06	2.50
7/11/09 11:00 PM	0.36	0.15	0.52
7/12/09 2:00 AM	0.33	0.56	0.89
7/12/09 5:00 AM	0.35	0.40	0.75
7/12/09 8:00 AM	0.43	0.40	0.82
7/12/09 11:00 AM	0.46	0.41	0.88
7/12/09 2:00 PM	0.45	0.40	0.85
7/12/09 5:00 PM	0.43	0.39	0.82
7/12/09 8:00 PM	0.45	0.38	0.83
7/12/09 11:00 PM	0.45	0.48	0.92
7/13/09 2:00 AM	0.42	0.40	0.82
7/13/09 5:00 AM	0.42	0.39	0.81
7/13/09 8:00 AM	0.42	0.49	0.91
7/13/09 11:00 AM	0.43	0.43	0.85
7/13/09 2:00 PM	0.42	0.44	0.86
7/13/09 5:00 PM	0.40	0.37	0.77
7/13/09 8:00 PM	0.39	0.38	0.76
7/13/09 11:00 PM	0.37	0.40	0.78
7/14/09 2:00 AM	0.36	0.42	0.79
7/14/09 5:00 AM	0.35	0.40	0.75
7/14/09 8:00 AM	0.72	0.42	1.14
7/14/09 11:00 AM	0.95	0.45	1.40
7/14/09 2:00 PM	0.92	0.51	1.43
7/14/09 5:00 PM	0.82	0.44	1.26
7/14/09 8:00 PM	0.83	0.45	1.28
7/14/09 11:00 PM	0.85	0.44	1.28
7/15/09 2:00 AM	0.85	0.40	1.25
7/15/09 5:00 AM	0.84	0.41	1.25
7/15/09 8:00 AM	0.86	0.44	1.29
7/15/09 11:00 AM	0.56	0.52	1.07
7/15/09 2:00 PM	0.43	0.49	0.92
7/15/09 5:00 PM	0.27	0.46	0.73

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
7/15/09 8:00 PM	0.28	0.44	0.72
7/15/09 11:00 PM	0.29	0.49	0.78
7/16/09 2:00 AM	0.28	0.51	0.79
7/16/09 5:00 AM	0.29	0.40	0.69
7/16/09 8:00 AM	0.64	0.38	1.02
7/16/09 11:00 AM	0.94	0.30	1.25
7/16/09 2:00 PM	0.89	0.28	1.17
7/16/09 5:00 PM	0.97	0.52	1.49
7/16/09 8:00 PM	1.02	0.60	1.62
7/16/09 11:00 PM	1.03	0.74	1.77
7/17/09 2:00 AM	1.02	0.79	1.81
7/17/09 5:00 AM	1.04	0.87	1.91
7/17/09 8:00 AM	0.56	1.20	1.76
7/17/09 11:00 AM	0.43	0.87	1.30
7/17/09 2:00 PM	0.42	0.60	1.02
7/17/09 5:00 PM	0.43	0.38	0.80
7/17/09 8:00 PM	0.43	0.51	0.93
7/17/09 11:00 PM	0.43	0.39	0.82
7/18/09 2:00 AM	0.57	0.34	0.91
7/18/09 5:00 AM	0.45	0.26	0.71
7/18/09 8:00 AM	0.44	0.30	0.74
7/18/09 11:00 AM	0.63	0.37	1.00
7/18/09 2:00 PM	0.50	0.57	1.07
7/18/09 5:00 PM	0.48	0.45	0.93
7/18/09 8:00 PM	0.46	0.34	0.80
7/18/09 11:00 PM	0.05	0.35	0.40
7/19/09 2:00 AM	0.00	0.37	0.37
7/19/09 5:00 AM	0.00	0.31	0.31
7/19/09 8:00 AM	0.00	0.33	0.33
7/19/09 11:00 AM	0.00	0.35	0.35
7/19/09 2:00 PM	0.00	0.26	0.26
7/19/09 5:00 PM	0.00	0.25	0.25
7/19/09 8:00 PM	0.00	0.22	0.22
7/19/09 11:00 PM	0.00	0.22	0.22
7/20/09 2:00 AM	0.00	0.21	0.21
7/20/09 5:00 AM	0.00	0.20	0.20
7/20/09 8:00 AM	0.00	0.20	0.20
7/20/09 11:00 AM	0.00	0.20	0.20
7/20/09 2:00 PM	0.00	0.21	0.21
7/20/09 5:00 PM	0.00	0.24	0.24
7/20/09 8:00 PM	0.00	0.24	0.24
7/20/09 11:00 PM	0.00	0.16	0.16
7/21/09 2:00 AM	0.00	0.14	0.14
7/21/09 5:00 AM	0.00	0.12	0.12
7/21/09 8:00 AM	0.00	0.19	0.19
7/21/09 11:00 AM	0.00	0.25	0.25
7/21/09 2:00 PM	0.00	0.29	0.29
7/21/09 5:00 PM	0.00	0.30	0.30
7/21/09 8:00 PM	0.00	0.29	0.29
7/21/09 11:00 PM	0.00	0.30	0.30
7/22/09 2:00 AM	0.00	0.32	0.32
7/22/09 5:00 AM	0.00	0.32	0.32
7/22/09 8:00 AM	0.00	0.35	0.35
7/22/09 11:00 AM	0.00	0.39	0.39

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
7/22/09 2:00 PM	0.00	0.47	0.47
7/22/09 5:00 PM	0.00	0.53	0.53
7/22/09 8:00 PM	0.00	0.34	0.34
7/22/09 11:00 PM	0.00	0.35	0.35
7/23/09 2:00 AM	0.00	0.36	0.36
7/23/09 5:00 AM	0.00	0.38	0.38
7/23/09 8:00 AM	0.00	0.40	0.40
7/23/09 11:00 AM	0.00	0.47	0.47
7/23/09 2:00 PM	0.00	0.50	0.50
7/23/09 5:00 PM	0.00	0.49	0.49
7/23/09 8:00 PM	0.00	0.45	0.45
7/23/09 11:00 PM	0.00	0.39	0.39
7/24/09 2:00 AM	0.00	0.25	0.25
7/24/09 5:00 AM	0.00	0.28	0.28
7/24/09 8:00 AM	0.00	0.37	0.37
7/24/09 11:00 AM	0.01	0.39	0.40
7/24/09 2:00 PM	0.01	0.40	0.41
7/24/09 5:00 PM	0.21	0.42	0.63
7/24/09 8:00 PM	0.54	0.36	0.90
7/24/09 11:00 PM	1.08	0.33	1.41
7/25/09 2:00 AM	1.13	0.46	1.59
7/25/09 5:00 AM	1.09	0.30	1.39
7/25/09 8:00 AM	0.79	0.36	1.15
7/25/09 11:00 AM	0.56	0.33	0.89
7/25/09 2:00 PM	0.54	0.31	0.85
7/25/09 5:00 PM	0.51	0.27	0.78
7/25/09 8:00 PM	0.46	0.24	0.70
7/25/09 11:00 PM	0.48	0.23	0.71
7/26/09 2:00 AM	0.48	0.23	0.71
7/26/09 5:00 AM	0.47	0.25	0.72
7/26/09 8:00 AM	0.47	0.23	0.70
7/26/09 11:00 AM	0.50	0.22	0.71
7/26/09 2:00 PM	0.47	0.31	0.78
7/26/09 5:00 PM	0.44	0.10	0.55
7/26/09 8:00 PM	0.42	0.00	0.42
7/26/09 11:00 PM	0.41	0.00	0.41
7/27/09 2:00 AM	0.42	0.00	0.42
7/27/09 5:00 AM	0.42	0.00	0.42
7/27/09 8:00 AM	0.41	0.00	0.41
7/27/09 11:00 AM	0.45	0.00	0.45
7/27/09 2:00 PM	0.45	0.00	0.45
7/27/09 5:00 PM	0.41	0.00	0.41
7/27/09 8:00 PM	0.40	0.00	0.40
7/27/09 11:00 PM	0.41	0.00	0.41
7/28/09 2:00 AM	0.39	0.00	0.39
7/28/09 5:00 AM	0.39	0.00	0.39
7/28/09 8:00 AM	0.28	0.00	0.28
7/28/09 11:00 AM	0.36	0.00	0.36
7/28/09 2:00 PM	0.63	0.00	0.63
7/28/09 5:00 PM	0.60	0.01	0.61
7/28/09 8:00 PM	0.57	0.08	0.65
7/28/09 11:00 PM	0.29	0.12	0.41
7/29/09 2:00 AM	0.29	0.13	0.41
7/29/09 5:00 AM	0.29	0.13	0.42

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
7/29/09 8:00 AM	0.30	0.13	0.43
7/29/09 11:00 AM	0.43	0.14	0.57
7/29/09 2:00 PM	0.64	0.15	0.79
7/29/09 5:00 PM	0.43	0.15	0.58
7/29/09 8:00 PM	0.40	0.15	0.55
7/29/09 11:00 PM	0.40	0.15	0.54
7/30/09 2:00 AM	0.31	0.16	0.47
7/30/09 5:00 AM	0.34	0.16	0.49
7/30/09 8:00 AM	0.62	0.16	0.78
7/30/09 11:00 AM	0.69	0.14	0.83
7/30/09 2:00 PM	0.68	0.15	0.82
7/30/09 5:00 PM	0.66	0.15	0.80
7/30/09 8:00 PM	0.64	0.14	0.79
7/30/09 11:00 PM	0.67	0.15	0.82
7/31/09 2:00 AM	0.66	0.16	0.82
7/31/09 5:00 AM	0.69	0.17	0.85
7/31/09 8:00 AM	0.70	0.17	0.87
7/31/09 11:00 AM	0.72	0.15	0.88
7/31/09 2:00 PM	0.74	0.16	0.91
7/31/09 5:00 PM	0.84	0.16	1.00
7/31/09 8:00 PM	0.82	0.15	0.98
7/31/09 11:00 PM	0.77	0.16	0.93
8/1/09 2:00 AM	0.75	0.16	0.90
8/1/09 5:00 AM	0.77	0.15	0.92
8/1/09 8:00 AM	0.70	0.15	0.85
8/1/09 11:00 AM	0.73	0.14	0.87
8/1/09 2:00 PM	0.77	0.15	0.92
8/1/09 5:00 PM	0.78	0.17	0.95
8/1/09 8:00 PM	0.77	0.18	0.95
8/1/09 11:00 PM	0.85	0.17	1.02
8/2/09 2:00 AM	0.88	0.14	1.03
8/2/09 5:00 AM	0.87	0.14	1.01
8/2/09 8:00 AM	0.85	0.16	1.01
8/2/09 11:00 AM	0.87	0.28	1.14
8/2/09 2:00 PM	0.88	0.34	1.22
8/2/09 5:00 PM	0.89	0.37	1.26
8/2/09 8:00 PM	0.92	0.35	1.28
8/2/09 11:00 PM	0.93	0.32	1.25
8/3/09 2:00 AM	0.93	0.34	1.27
8/3/09 5:00 AM	0.91	0.37	1.28
8/3/09 8:00 AM	0.94	0.43	1.37
8/3/09 11:00 AM	0.99	0.51	1.50
8/3/09 2:00 PM	1.01	0.51	1.53
8/3/09 5:00 PM	0.62	0.47	1.09
8/3/09 8:00 PM	0.55	0.47	1.02
8/3/09 11:00 PM	0.41	0.51	0.92
8/4/09 2:00 AM	0.37	0.55	0.92
8/4/09 5:00 AM	0.36	0.61	0.97
8/4/09 8:00 AM	0.36	0.54	0.90
8/4/09 11:00 AM	0.52	0.48	1.00
8/4/09 2:00 PM	0.53	0.47	1.00
8/4/09 5:00 PM	0.52	0.44	0.96
8/4/09 8:00 PM	0.91	0.51	1.42
8/4/09 11:00 PM	0.66	0.52	1.18

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
8/5/09 2:00 AM	0.51	0.55	1.06
8/5/09 5:00 AM	0.51	0.64	1.15
8/5/09 8:00 AM	0.50	0.62	1.13
8/5/09 11:00 AM	0.56	0.63	1.19
8/5/09 2:00 PM	0.55	0.67	1.22
8/5/09 5:00 PM	0.52	0.55	1.07
8/5/09 8:00 PM	0.45	0.62	1.07
8/5/09 11:00 PM	0.38	0.27	0.65
8/6/09 2:00 AM	0.56	0.24	0.80
8/6/09 5:00 AM	0.52	0.33	0.85
8/6/09 8:00 AM	0.52	0.39	0.91
8/6/09 11:00 AM	0.57	0.60	1.17
8/6/09 2:00 PM	0.56	0.43	0.99
8/6/09 5:00 PM	0.54	0.36	0.91
8/6/09 8:00 PM	0.53	0.33	0.86
8/6/09 11:00 PM	0.52	0.33	0.85
8/7/09 2:00 AM	0.53	0.30	0.83
8/7/09 5:00 AM	0.56	0.26	0.82
8/7/09 8:00 AM	0.57	0.04	0.60
8/7/09 11:00 AM	0.47	0.00	0.47
8/7/09 2:00 PM	0.00	0.00	0.00
8/7/09 5:00 PM	0.23	0.00	0.23
8/7/09 8:00 PM	0.36	0.00	0.36
8/7/09 11:00 PM	0.35	0.00	0.35
8/8/09 2:00 AM	0.34	0.00	0.34
8/8/09 5:00 AM	0.34	0.00	0.34
8/8/09 8:00 AM	0.38	0.00	0.38
8/8/09 11:00 AM	0.39	0.00	0.39
8/8/09 2:00 PM	0.60	0.00	0.60
8/8/09 5:00 PM	0.29	0.00	0.29
8/8/09 8:00 PM	0.26	0.00	0.26
8/8/09 11:00 PM	0.28	0.00	0.28
8/9/09 2:00 AM	0.28	0.00	0.28
8/9/09 5:00 AM	0.27	0.00	0.27
8/9/09 8:00 AM	0.28	0.00	0.28
8/9/09 11:00 AM	0.31	0.00	0.31
8/9/09 2:00 PM	0.33	0.00	0.33
8/9/09 5:00 PM	0.31	0.00	0.31
8/9/09 8:00 PM	0.32	0.00	0.32
8/9/09 11:00 PM	0.27	0.03	0.30
8/10/09 2:00 AM	0.26	0.09	0.35
8/10/09 5:00 AM	0.28	0.14	0.43
8/10/09 8:00 AM	0.35	0.38	0.72
8/10/09 11:00 AM	0.36	0.56	0.92
8/10/09 2:00 PM	0.34	0.45	0.79
8/10/09 5:00 PM	0.51	0.33	0.84
8/10/09 8:00 PM	0.32	0.36	0.69
8/10/09 11:00 PM	0.32	0.23	0.55
8/11/09 2:00 AM	0.32	0.21	0.53
8/11/09 5:00 AM	0.33	0.18	0.51
8/11/09 8:00 AM	0.34	0.19	0.53
8/11/09 11:00 AM	0.36	0.19	0.55
8/11/09 2:00 PM	0.36	0.19	0.55
8/11/09 5:00 PM	0.50	0.21	0.71

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
8/11/09 8:00 PM	0.35	0.22	0.57
8/11/09 11:00 PM	0.36	0.21	0.57
8/12/09 2:00 AM	0.36	0.24	0.60
8/12/09 5:00 AM	0.37	0.24	0.61
8/12/09 8:00 AM	0.37	0.22	0.59
8/12/09 11:00 AM	0.39	0.21	0.60
8/12/09 2:00 PM	0.39	0.21	0.60
8/12/09 5:00 PM	0.36	0.20	0.56
8/12/09 8:00 PM	0.35	0.22	0.57
8/12/09 11:00 PM	0.35	0.21	0.56
8/13/09 2:00 AM	0.35	0.23	0.58
8/13/09 5:00 AM	0.33	0.21	0.53
8/13/09 8:00 AM	0.32	0.20	0.52
8/13/09 11:00 AM	0.33	0.18	0.51
8/13/09 2:00 PM	0.32	0.18	0.50
8/13/09 5:00 PM	0.33	0.20	0.52
8/13/09 8:00 PM	0.32	0.21	0.53
8/13/09 11:00 PM	0.27	0.22	0.49
8/14/09 2:00 AM	0.25	0.22	0.47
8/14/09 5:00 AM	0.25	0.22	0.46
8/14/09 8:00 AM	0.25	0.22	0.47
8/14/09 11:00 AM	0.32	0.11	0.43
8/14/09 2:00 PM	0.29	0.19	0.48
8/14/09 5:00 PM	0.37	0.19	0.57
8/14/09 8:00 PM	0.26	0.19	0.45
8/14/09 11:00 PM	0.19	0.18	0.38
8/15/09 2:00 AM	0.24	0.19	0.43
8/15/09 5:00 AM	0.23	0.19	0.42
8/15/09 8:00 AM	0.37	0.20	0.57
8/15/09 11:00 AM	0.58	0.20	0.78
8/15/09 2:00 PM	0.63	0.20	0.84
8/15/09 5:00 PM	0.53	0.20	0.73
8/15/09 8:00 PM	0.40	0.20	0.60
8/15/09 11:00 PM	0.38	0.20	0.58
8/16/09 2:00 AM	0.53	0.21	0.74
8/16/09 5:00 AM	0.56	0.21	0.78
8/16/09 8:00 AM	0.56	0.21	0.77
8/16/09 11:00 AM	0.56	0.21	0.78
8/16/09 2:00 PM	0.50	0.22	0.72
8/16/09 5:00 PM	0.47	0.22	0.70
8/16/09 8:00 PM	0.46	0.25	0.71
8/16/09 11:00 PM	0.46	0.27	0.73
8/17/09 2:00 AM	0.45	0.24	0.70
8/17/09 5:00 AM	0.47	0.24	0.71
8/17/09 8:00 AM	0.47	0.19	0.66
8/17/09 11:00 AM	0.61	0.10	0.71
8/17/09 2:00 PM	0.60	0.16	0.77
8/17/09 5:00 PM	0.50	0.21	0.70
8/17/09 8:00 PM	0.47	0.20	0.67
8/17/09 11:00 PM	0.46	0.21	0.68
8/18/09 2:00 AM	0.43	0.22	0.65
8/18/09 5:00 AM	0.38	0.21	0.59
8/18/09 8:00 AM	0.30	0.21	0.51
8/18/09 11:00 AM	0.37	0.00	0.37

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
8/18/09 2:00 PM	0.43	0.00	0.43
8/18/09 5:00 PM	0.37	0.00	0.37
8/18/09 8:00 PM	0.36	0.00	0.36
8/18/09 11:00 PM	0.35	0.00	0.35
8/19/09 2:00 AM	0.33	0.00	0.33
8/19/09 5:00 AM	0.31	0.00	0.32
8/19/09 8:00 AM	0.31	0.07	0.38
8/19/09 11:00 AM	0.39	0.12	0.51
8/19/09 2:00 PM	0.49	0.20	0.69
8/19/09 5:00 PM	0.41	0.35	0.76
8/19/09 8:00 PM	0.26	0.30	0.56
8/19/09 11:00 PM	0.21	0.27	0.47
8/20/09 2:00 AM	0.13	0.27	0.40
8/20/09 5:00 AM	0.11	0.28	0.39
8/20/09 8:00 AM	0.06	0.32	0.38
8/20/09 11:00 AM	0.09	0.40	0.49
8/20/09 2:00 PM	0.14	0.56	0.69
8/20/09 5:00 PM	0.24	0.58	0.82
8/20/09 8:00 PM	0.47	0.54	1.01
8/20/09 11:00 PM	0.76	0.46	1.22
8/21/09 2:00 AM	0.84	0.34	1.17
8/21/09 5:00 AM	0.83	0.44	1.27
8/21/09 8:00 AM	0.84	0.42	1.26
8/21/09 11:00 AM	0.94	0.42	1.36
8/21/09 2:00 PM	1.02	0.39	1.41
8/21/09 5:00 PM	0.88	0.36	1.24
8/21/09 8:00 PM	0.78	0.34	1.12
8/21/09 11:00 PM	0.82	0.32	1.14
8/22/09 2:00 AM	0.82	0.35	1.17
8/22/09 5:00 AM	0.84	0.33	1.16
8/22/09 8:00 AM	0.89	0.34	1.24
8/22/09 11:00 AM	0.88	0.32	1.20
8/22/09 2:00 PM	0.85	0.32	1.17
8/22/09 5:00 PM	0.84	0.31	1.15
8/22/09 8:00 PM	0.87	0.32	1.19
8/22/09 11:00 PM	0.91	0.29	1.20
8/23/09 2:00 AM	0.91	0.30	1.21
8/23/09 5:00 AM	0.89	0.29	1.17
8/23/09 8:00 AM	0.98	0.28	1.26
8/23/09 11:00 AM	0.89	0.28	1.17
8/23/09 2:00 PM	0.73	0.28	1.00
8/23/09 5:00 PM	0.70	0.26	0.96
8/23/09 8:00 PM	0.71	0.26	0.97
8/23/09 11:00 PM	0.69	0.25	0.95
8/24/09 2:00 AM	0.81	0.25	1.07
8/24/09 5:00 AM	0.81	0.24	1.05
8/24/09 8:00 AM	0.73	0.24	0.97
8/24/09 11:00 AM	0.82	0.24	1.06
8/24/09 2:00 PM	0.73	0.26	0.99
8/24/09 5:00 PM	0.77	0.25	1.02
8/24/09 8:00 PM	0.88	0.27	1.15
8/24/09 11:00 PM	0.39	0.28	0.67
8/25/09 2:00 AM	0.28	0.23	0.51
8/25/09 5:00 AM	0.29	0.24	0.54

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
8/25/09 8:00 AM	0.38	0.27	0.65
8/25/09 11:00 AM	0.47	0.26	0.73
8/25/09 2:00 PM	0.47	0.31	0.78
8/25/09 5:00 PM	0.43	0.34	0.77
8/25/09 8:00 PM	0.43	0.26	0.69
8/25/09 11:00 PM	0.42	0.27	0.70
8/26/09 2:00 AM	0.42	0.31	0.73
8/26/09 5:00 AM	0.43	0.33	0.76
8/26/09 8:00 AM	0.43	0.45	0.88
8/26/09 11:00 AM	0.45	0.47	0.91
8/26/09 2:00 PM	0.45	0.44	0.89
8/26/09 5:00 PM	0.41	0.40	0.81
8/26/09 8:00 PM	0.41	0.37	0.78
8/26/09 11:00 PM	0.44	0.35	0.79
8/27/09 2:00 AM	0.43	0.32	0.75
8/27/09 5:00 AM	0.41	0.27	0.68
8/27/09 8:00 AM	0.55	0.45	1.00
8/27/09 11:00 AM	0.78	0.53	1.31
8/27/09 2:00 PM	0.80	0.78	1.58
8/27/09 5:00 PM	1.02	0.37	1.39
8/27/09 8:00 PM	0.89	0.52	1.41
8/27/09 11:00 PM	0.91	0.61	1.52
8/28/09 2:00 AM	0.65	0.30	0.95
8/28/09 5:00 AM	0.65	0.34	0.99
8/28/09 8:00 AM	0.90	0.60	1.51
8/28/09 11:00 AM	0.88	0.75	1.63
8/28/09 2:00 PM	0.82	0.54	1.36
8/28/09 5:00 PM	0.77	0.56	1.33
8/28/09 8:00 PM	0.71	0.70	1.41
8/28/09 11:00 PM	0.59	0.66	1.24
8/29/09 2:00 AM	0.34	0.36	0.70
8/29/09 5:00 AM	0.27	0.21	0.48
8/29/09 8:00 AM	0.52	0.25	0.76
8/29/09 11:00 AM	0.60	0.40	1.00
8/29/09 2:00 PM	0.59	0.45	1.04
8/29/09 5:00 PM	0.58	0.48	1.06
8/29/09 8:00 PM	0.47	0.47	0.94
8/29/09 11:00 PM	0.30	0.29	0.59
8/30/09 2:00 AM	0.29	0.31	0.60
8/30/09 5:00 AM	0.28	0.22	0.50
8/30/09 8:00 AM	0.31	0.19	0.50
8/30/09 11:00 AM	0.49	0.18	0.67
8/30/09 2:00 PM	0.65	0.34	0.99
8/30/09 5:00 PM	0.66	0.49	1.15
8/30/09 8:00 PM	0.68	0.59	1.27
8/30/09 11:00 PM	0.73	0.49	1.22
8/31/09 2:00 AM	0.53	0.29	0.83
8/31/09 5:00 AM	0.60	0.33	0.93
8/31/09 8:00 AM	0.88	0.44	1.31
8/31/09 11:00 AM	0.95	0.37	1.33
8/31/09 2:00 PM	0.89	0.34	1.23
8/31/09 5:00 PM	1.09	0.34	1.43
8/31/09 8:00 PM	0.99	0.31	1.30
8/31/09 11:00 PM	1.11	0.30	1.41

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
9/1/09 2:00 AM	0.80	0.31	1.11
9/1/09 5:00 AM	0.90	0.35	1.26
9/1/09 8:00 AM	1.01	0.26	1.27
9/1/09 11:00 AM	0.97	0.27	1.23
9/1/09 2:00 PM	1.01	0.25	1.26
9/1/09 5:00 PM	1.03	0.24	1.27
9/1/09 8:00 PM	0.98	0.22	1.21
9/1/09 11:00 PM	0.93	0.21	1.14
9/2/09 2:00 AM	0.96	0.00	0.96
9/2/09 5:00 AM	0.97	0.00	0.97
9/2/09 8:00 AM	0.96	0.00	0.96
9/2/09 11:00 AM	0.75	0.04	0.79
9/2/09 2:00 PM	0.98	0.21	1.19
9/2/09 5:00 PM	0.97	0.22	1.19
9/2/09 8:00 PM	0.96	0.22	1.18
9/2/09 11:00 PM	0.99	0.20	1.18
9/3/09 2:00 AM	0.95	0.15	1.11
9/3/09 5:00 AM	0.91	0.18	1.09
9/3/09 8:00 AM	0.64	0.20	0.84
9/3/09 11:00 AM	0.74	0.18	0.92
9/3/09 2:00 PM	0.71	0.17	0.88
9/3/09 5:00 PM	0.98	0.19	1.18
9/3/09 8:00 PM	0.96	0.19	1.15
9/3/09 11:00 PM	0.98	0.19	1.17
9/4/09 2:00 AM	0.79	0.15	0.94
9/4/09 5:00 AM	0.78	0.16	0.94
9/4/09 8:00 AM	0.93	0.18	1.11
9/4/09 11:00 AM	0.86	0.19	1.05
9/4/09 2:00 PM	0.83	0.18	1.00
9/4/09 5:00 PM	0.79	0.18	0.97
9/4/09 8:00 PM	0.81	0.18	0.99
9/4/09 11:00 PM	0.76	0.19	0.95
9/5/09 2:00 AM	0.63	0.16	0.79
9/5/09 5:00 AM	0.65	0.14	0.79
9/5/09 8:00 AM	0.67	0.17	0.84
9/5/09 11:00 AM	0.63	0.19	0.82
9/5/09 2:00 PM	0.66	0.19	0.85
9/5/09 5:00 PM	0.87	0.19	1.06
9/5/09 8:00 PM	0.82	0.19	1.01
9/5/09 11:00 PM	0.57	0.19	0.76
9/6/09 2:00 AM	0.49	0.20	0.69
9/6/09 5:00 AM	0.44	0.17	0.61
9/6/09 8:00 AM	0.52	0.18	0.70
9/6/09 11:00 AM	0.50	0.21	0.71
9/6/09 2:00 PM	0.55	0.29	0.84
9/6/09 5:00 PM	0.86	0.32	1.18
9/6/09 8:00 PM	0.96	0.29	1.25
9/6/09 11:00 PM	1.00	0.31	1.31
9/7/09 2:00 AM	0.88	0.35	1.23
9/7/09 5:00 AM	0.85	0.35	1.20
9/7/09 8:00 AM	0.95	0.41	1.36
9/7/09 11:00 AM	0.94	0.41	1.35
9/7/09 2:00 PM	0.95	0.41	1.36
9/7/09 5:00 PM	0.95	0.42	1.37

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
9/7/09 8:00 PM	1.03	0.41	1.43
9/7/09 11:00 PM	0.84	0.36	1.20
9/8/09 2:00 AM	0.54	0.36	0.90
9/8/09 5:00 AM	0.59	0.35	0.94
9/8/09 8:00 AM	0.99	0.31	1.30
9/8/09 11:00 AM	1.01	0.28	1.29
9/8/09 2:00 PM	0.99	0.27	1.27
9/8/09 5:00 PM	1.05	0.26	1.31
9/8/09 8:00 PM	0.57	0.23	0.80
9/8/09 11:00 PM	0.00	0.21	0.21
9/9/09 2:00 AM	0.00	0.21	0.21
9/9/09 5:00 AM	0.00	0.22	0.22
9/9/09 8:00 AM	0.00	0.21	0.21
9/9/09 11:00 AM	0.16	0.20	0.35
9/9/09 2:00 PM	0.29	0.19	0.48
9/9/09 5:00 PM	0.40	0.18	0.58
9/9/09 8:00 PM	0.53	0.18	0.72
9/9/09 11:00 PM	0.53	0.19	0.72
9/10/09 2:00 AM	0.53	0.15	0.68
9/10/09 5:00 AM	0.53	0.18	0.71
9/10/09 8:00 AM	0.39	0.21	0.60
9/10/09 11:00 AM	0.28	0.19	0.47
9/10/09 2:00 PM	0.26	0.19	0.45
9/10/09 5:00 PM	0.33	0.20	0.53
9/10/09 8:00 PM	0.37	0.19	0.56
9/10/09 11:00 PM	0.42	0.19	0.61
9/11/09 2:00 AM	0.45	0.17	0.62
9/11/09 5:00 AM	0.40	0.16	0.56
9/11/09 8:00 AM	0.52	0.19	0.71
9/11/09 11:00 AM	0.59	0.18	0.77
9/11/09 2:00 PM	0.59	0.18	0.77
9/11/09 5:00 PM	0.63	0.19	0.81
9/11/09 8:00 PM	0.64	0.19	0.83
9/11/09 11:00 PM	0.69	0.19	0.87
9/12/09 2:00 AM	1.13	0.19	1.32
9/12/09 5:00 AM	0.76	0.19	0.95
9/12/09 8:00 AM	0.98	0.19	1.17
9/12/09 11:00 AM	0.97	0.20	1.18
9/12/09 2:00 PM	0.94	0.19	1.13
9/12/09 5:00 PM	0.98	0.18	1.16
9/12/09 8:00 PM	0.90	0.17	1.07
9/12/09 11:00 PM	0.89	0.05	0.94
9/13/09 2:00 AM	0.87	0.06	0.93
9/13/09 5:00 AM	0.88	0.07	0.95
9/13/09 8:00 AM	0.90	0.20	1.10
9/13/09 11:00 AM	0.99	0.24	1.22
9/13/09 2:00 PM	0.96	0.22	1.18
9/13/09 5:00 PM	0.93	0.22	1.15
9/13/09 8:00 PM	0.97	0.23	1.20
9/13/09 11:00 PM	0.66	0.15	0.80
9/14/09 2:00 AM	0.46	0.07	0.54
9/14/09 5:00 AM	0.48	0.09	0.56
9/14/09 8:00 AM	0.66	0.27	0.93
9/14/09 11:00 AM	1.10	0.25	1.36

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
9/14/09 2:00 PM	1.06	0.24	1.30
9/14/09 5:00 PM	1.05	0.25	1.30
9/14/09 8:00 PM	0.78	0.26	1.04
9/14/09 11:00 PM	0.55	0.13	0.68
9/15/09 2:00 AM	0.53	0.15	0.68
9/15/09 5:00 AM	0.52	0.08	0.60
9/15/09 8:00 AM	0.78	0.18	0.96
9/15/09 11:00 AM	0.99	0.26	1.25
9/15/09 2:00 PM	0.96	0.27	1.23
9/15/09 5:00 PM	1.00	0.27	1.27
9/15/09 8:00 PM	0.95	0.29	1.24
9/15/09 11:00 PM	0.57	0.22	0.79
9/16/09 2:00 AM	0.00	0.18	0.18
9/16/09 5:00 AM	0.00	0.18	0.18
9/16/09 8:00 AM	0.00	0.22	0.22
9/16/09 11:00 AM	0.00	0.25	0.25
9/16/09 2:00 PM	0.95	0.26	1.21
9/16/09 5:00 PM	0.96	0.28	1.24
9/16/09 8:00 PM	1.00	0.15	1.15
9/16/09 11:00 PM	1.08	0.03	1.11
9/17/09 2:00 AM	1.08	0.09	1.17
9/17/09 5:00 AM	1.08	0.28	1.37
9/17/09 8:00 AM	0.90	0.33	1.23
9/17/09 11:00 AM	0.50	0.35	0.86
9/17/09 2:00 PM	0.51	0.35	0.87
9/17/09 5:00 PM	0.52	0.33	0.85
9/17/09 8:00 PM	0.52	0.31	0.84
9/17/09 11:00 PM	0.43	0.28	0.71
9/18/09 2:00 AM	0.42	0.28	0.69
9/18/09 5:00 AM	0.45	0.27	0.72
9/18/09 8:00 AM	0.36	0.26	0.62
9/18/09 11:00 AM	0.29	0.24	0.53
9/18/09 2:00 PM	0.29	0.23	0.52
9/18/09 5:00 PM	0.28	0.22	0.50
9/18/09 8:00 PM	0.28	0.23	0.51
9/18/09 11:00 PM	0.14	0.25	0.39
9/19/09 2:00 AM	0.10	0.25	0.36
9/19/09 5:00 AM	0.12	0.27	0.39
9/19/09 8:00 AM	0.16	0.28	0.44
9/19/09 11:00 AM	0.32	0.28	0.60
9/19/09 2:00 PM	0.75	0.30	1.05
9/19/09 5:00 PM	0.83	0.31	1.14
9/19/09 8:00 PM	0.79	0.35	1.14
9/19/09 11:00 PM	0.55	0.37	0.92
9/20/09 2:00 AM	0.28	0.38	0.66
9/20/09 5:00 AM	0.23	0.39	0.63
9/20/09 8:00 AM	0.23	0.40	0.64
9/20/09 11:00 AM	0.34	0.37	0.71
9/20/09 2:00 PM	0.75	0.37	1.12
9/20/09 5:00 PM	0.72	0.39	1.11
9/20/09 8:00 PM	0.80	0.37	1.18
9/20/09 11:00 PM	1.05	0.36	1.41
9/21/09 2:00 AM	0.95	0.20	1.15
9/21/09 5:00 AM	0.84	0.19	1.03

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
9/21/09 8:00 AM	1.12	0.44	1.56
9/21/09 11:00 AM	1.03	0.46	1.49
9/21/09 2:00 PM	1.05	0.40	1.44
9/21/09 5:00 PM	0.93	0.40	1.33
9/21/09 8:00 PM	0.86	0.36	1.22
9/21/09 11:00 PM	0.36	0.36	0.72
9/22/09 2:00 AM	0.35	0.38	0.73
9/22/09 5:00 AM	0.42	0.38	0.79
9/22/09 8:00 AM	1.05	0.41	1.46
9/22/09 11:00 AM	1.04	0.55	1.59
9/22/09 2:00 PM	1.05	0.48	1.53
9/22/09 5:00 PM	1.04	0.50	1.53
9/22/09 8:00 PM	1.04	0.55	1.59
9/22/09 11:00 PM	0.74	0.49	1.23
9/23/09 2:00 AM	0.72	0.48	1.20
9/23/09 5:00 AM	0.77	0.50	1.27
9/23/09 8:00 AM	1.14	0.52	1.66
9/23/09 11:00 AM	1.06	0.48	1.55
9/23/09 2:00 PM	0.89	0.48	1.37
9/23/09 5:00 PM	1.08	0.51	1.59
9/23/09 8:00 PM	0.80	0.54	1.34
9/23/09 11:00 PM	0.16	0.53	0.70
9/24/09 2:00 AM	0.13	0.53	0.67
9/24/09 5:00 AM	0.13	0.54	0.67
9/24/09 8:00 AM	0.13	0.55	0.68
9/24/09 11:00 AM	0.16	0.59	0.76
9/24/09 2:00 PM	0.28	0.42	0.71
9/24/09 5:00 PM	0.29	0.42	0.70
9/24/09 8:00 PM	0.30	0.40	0.70
9/24/09 11:00 PM	0.30	0.42	0.72
9/25/09 2:00 AM	0.26	0.44	0.70
9/25/09 5:00 AM	0.32	0.55	0.86
9/25/09 8:00 AM	0.32	0.72	1.05
9/25/09 11:00 AM	0.29	0.56	0.84
9/25/09 2:00 PM	0.27	0.54	0.81
9/25/09 5:00 PM	0.28	0.56	0.83
9/25/09 8:00 PM	0.25	0.58	0.83
9/25/09 11:00 PM	0.26	0.62	0.87
9/26/09 2:00 AM	0.29	0.64	0.94
9/26/09 5:00 AM	0.29	0.65	0.94
9/26/09 8:00 AM	0.28	0.64	0.92
9/26/09 11:00 AM	0.27	0.61	0.88
9/26/09 2:00 PM	0.24	0.62	0.86
9/26/09 5:00 PM	0.24	0.71	0.95
9/26/09 8:00 PM	0.25	0.65	0.90
9/26/09 11:00 PM	0.23	0.66	0.89
9/27/09 2:00 AM	0.21	0.82	1.03
9/27/09 5:00 AM	0.21	0.86	1.07
9/27/09 8:00 AM	0.29	0.90	1.18
9/27/09 11:00 AM	0.70	0.65	1.35
9/27/09 2:00 PM	0.68	0.78	1.46
9/27/09 5:00 PM	0.74	1.08	1.82
9/27/09 8:00 PM	0.82	0.82	1.64
9/27/09 11:00 PM	0.74	0.29	1.04

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
9/28/09 2:00 AM	0.73	0.02	0.75
9/28/09 5:00 AM	0.86	0.00	0.86
9/28/09 8:00 AM	0.79	0.00	0.79
9/28/09 11:00 AM	0.90	0.00	0.90
9/28/09 2:00 PM	0.86	0.00	0.86
9/28/09 5:00 PM	0.83	0.00	0.83
9/28/09 8:00 PM	0.85	0.00	0.85
9/28/09 11:00 PM	0.87	0.00	0.87
9/29/09 2:00 AM	0.97	0.00	0.97
9/29/09 5:00 AM	0.97	0.00	0.97
9/29/09 8:00 AM	1.05	0.00	1.05
9/29/09 11:00 AM	1.03	0.00	1.03
9/29/09 2:00 PM	1.03	0.00	1.03
9/29/09 5:00 PM	1.10	0.00	1.10
9/29/09 8:00 PM	1.05	0.00	1.05
9/29/09 11:00 PM	0.68	0.00	0.68
9/30/09 2:00 AM	0.65	0.00	0.65
9/30/09 5:00 AM	0.64	0.00	0.64
9/30/09 8:00 AM	0.97	0.00	0.97
9/30/09 11:00 AM	1.09	0.00	1.09
9/30/09 2:00 PM	0.99	0.00	0.99
9/30/09 5:00 PM	1.02	0.00	1.02
9/30/09 8:00 PM	0.92	0.00	0.92
9/30/09 11:00 PM	0.90	0.00	0.90
10/1/09 2:00 AM	0.92	0.00	0.92
10/1/09 5:00 AM	1.07	0.00	1.07
10/1/09 8:00 AM	1.08	0.00	1.08
10/1/09 11:00 AM	0.94	0.00	0.94
10/1/09 2:00 PM	0.83	0.00	0.83
10/1/09 5:00 PM	0.88	0.00	0.88
10/1/09 8:00 PM	0.88	0.00	0.88
10/1/09 11:00 PM	0.87	0.00	0.87
10/2/09 2:00 AM	0.89	0.00	0.89
10/2/09 5:00 AM	1.04	0.00	1.04
10/2/09 8:00 AM	1.00	0.00	1.00
10/2/09 11:00 AM	1.02	0.00	1.02
10/2/09 2:00 PM	0.97	0.00	0.97
10/2/09 5:00 PM	0.90	0.00	0.90
10/2/09 8:00 PM	0.95	0.00	0.95
10/2/09 11:00 PM	0.92	0.00	0.92
10/3/09 2:00 AM	0.92	0.00	0.92
10/3/09 5:00 AM	0.89	0.00	0.89
10/3/09 8:00 AM	0.86	0.00	0.86
10/3/09 11:00 AM	0.79	0.00	0.79
10/3/09 2:00 PM	0.74	0.00	0.74
10/3/09 5:00 PM	0.67	0.00	0.67
10/3/09 8:00 PM	0.72	0.00	0.72
10/3/09 11:00 PM	0.68	0.00	0.68
10/4/09 2:00 AM	0.68	0.00	0.68
10/4/09 5:00 AM	0.71	0.00	0.71
10/4/09 8:00 AM	0.73	0.00	0.73
10/4/09 11:00 AM	0.79	0.00	0.79
10/4/09 2:00 PM	0.78	0.00	0.78
10/4/09 5:00 PM	0.73	0.00	0.73

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
10/4/09 8:00 PM	0.68	0.00	0.68
10/4/09 11:00 PM	0.67	0.00	0.67
10/5/09 2:00 AM	0.64	0.00	0.64
10/5/09 5:00 AM	0.70	0.00	0.70
10/5/09 8:00 AM	0.62	0.00	0.62
10/5/09 11:00 AM	0.62	0.00	0.62
10/5/09 2:00 PM	0.59	0.00	0.59
10/5/09 5:00 PM	0.56	0.00	0.56
10/5/09 8:00 PM	0.61	0.00	0.61
10/5/09 11:00 PM	0.53	0.00	0.53
10/6/09 2:00 AM	0.63	0.00	0.63
10/6/09 5:00 AM	0.65	0.00	0.65
10/6/09 8:00 AM	0.62	0.00	0.62
10/6/09 11:00 AM	0.60	0.00	0.60
10/6/09 2:00 PM	0.64	0.00	0.64
10/6/09 5:00 PM	0.66	0.00	0.66
10/6/09 8:00 PM	0.64	0.05	0.69
10/6/09 11:00 PM	0.63	0.30	0.92
10/7/09 2:00 AM	0.65	0.32	0.97
10/7/09 5:00 AM	0.64	0.25	0.89
10/7/09 8:00 AM	0.92	0.21	1.13
10/7/09 11:00 AM	0.57	0.30	0.87
10/7/09 2:00 PM	0.60	0.07	0.67
10/7/09 5:00 PM	0.55	0.10	0.65
10/7/09 8:00 PM	0.57	0.09	0.66
10/7/09 11:00 PM	0.61	0.03	0.64
10/8/09 2:00 AM	0.59	0.14	0.72
10/8/09 5:00 AM	0.62	0.23	0.86
10/8/09 8:00 AM	0.61	0.31	0.92
10/8/09 11:00 AM	0.52	0.36	0.88
10/8/09 2:00 PM	0.57	0.16	0.73
10/8/09 5:00 PM	0.61	0.13	0.75
10/8/09 8:00 PM	0.63	0.16	0.79
10/8/09 11:00 PM	0.65	0.14	0.79
10/9/09 2:00 AM	0.65	0.14	0.78
10/9/09 5:00 AM	0.64	0.14	0.78
10/9/09 8:00 AM	0.59	0.14	0.73
10/9/09 11:00 AM	0.55	0.25	0.80
10/9/09 2:00 PM	0.53	0.24	0.77
10/9/09 5:00 PM	0.54	0.24	0.78
10/9/09 8:00 PM	0.51	0.26	0.77
10/9/09 11:00 PM	0.52	0.20	0.72
10/10/09 2:00 AM	0.54	0.24	0.78
10/10/09 5:00 AM	0.52	0.23	0.75
10/10/09 8:00 AM	0.56	0.18	0.73
10/10/09 11:00 AM	0.53	0.14	0.68
10/10/09 2:00 PM	0.54	0.16	0.71
10/10/09 5:00 PM	0.54	0.26	0.80
10/10/09 8:00 PM	0.52	0.24	0.76
10/10/09 11:00 PM	0.50	0.11	0.61
10/11/09 2:00 AM	0.50	0.10	0.60
10/11/09 5:00 AM	0.48	0.10	0.58
10/11/09 8:00 AM	0.48	0.24	0.72
10/11/09 11:00 AM	0.52	0.38	0.90

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
10/11/09 2:00 PM	0.53	0.33	0.86
10/11/09 5:00 PM	0.52	0.33	0.85
10/11/09 8:00 PM	0.53	0.35	0.88
10/11/09 11:00 PM	0.55	0.36	0.91
10/12/09 2:00 AM	0.55	0.36	0.91
10/12/09 5:00 AM	0.56	0.39	0.95
10/12/09 8:00 AM	0.58	0.34	0.92
10/12/09 11:00 AM	0.62	0.37	0.99
10/12/09 2:00 PM	0.61	0.38	0.99
10/12/09 5:00 PM	0.59	0.35	0.94
10/12/09 8:00 PM	0.61	0.36	0.96
10/12/09 11:00 PM	0.59	0.18	0.77
10/13/09 2:00 AM	0.58	0.15	0.73
10/13/09 5:00 AM	0.59	0.16	0.76
10/13/09 8:00 AM	0.63	0.17	0.81
10/13/09 11:00 AM	0.64	0.18	0.82
10/13/09 2:00 PM	0.64	0.18	0.82
10/13/09 5:00 PM	0.59	0.19	0.78
10/13/09 8:00 PM	0.59	0.19	0.78
10/13/09 11:00 PM	0.58	0.19	0.78
10/14/09 2:00 AM	0.36	0.20	0.56
10/14/09 5:00 AM	0.35	0.20	0.55
10/14/09 8:00 AM	0.50	0.20	0.70
10/14/09 11:00 AM	0.70	0.30	1.00
10/14/09 2:00 PM	0.71	0.50	1.21
10/14/09 5:00 PM	0.71	0.60	1.31
10/14/09 8:00 PM	0.69	0.56	1.25
10/14/09 11:00 PM	0.68	0.60	1.27
10/15/09 2:00 AM	0.66	0.61	1.28
10/15/09 5:00 AM	0.65	0.64	1.29
10/15/09 8:00 AM	0.64	0.47	1.11
10/15/09 11:00 AM	0.56	0.39	0.95
10/15/09 2:00 PM	0.88	0.34	1.22
10/15/09 5:00 PM	0.59	0.34	0.93
10/15/09 8:00 PM	0.59	0.36	0.95
10/15/09 11:00 PM	0.59	0.34	0.93
10/16/09 2:00 AM	0.58	0.31	0.89
10/16/09 5:00 AM	0.58	0.31	0.89
10/16/09 8:00 AM	0.59	0.29	0.88
10/16/09 11:00 AM	0.71	0.40	1.11
10/16/09 2:00 PM	0.74	0.40	1.13
10/16/09 5:00 PM	0.60	0.42	1.02
10/16/09 8:00 PM	0.53	0.48	1.00
10/16/09 11:00 PM	0.07	0.41	0.48
10/17/09 2:00 AM	0.00	0.37	0.37
10/17/09 5:00 AM	0.00	0.39	0.39
10/17/09 8:00 AM	0.00	0.41	0.42
10/17/09 11:00 AM	0.00	0.42	0.42
10/17/09 2:00 PM	0.00	0.45	0.45
10/17/09 5:00 PM	0.00	0.42	0.42
10/17/09 8:00 PM	0.00	0.39	0.39
10/17/09 11:00 PM	0.00	0.39	0.39
10/18/09 2:00 AM	0.00	0.39	0.39
10/18/09 5:00 AM	0.00	0.37	0.37

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
10/18/09 8:00 AM	0.00	0.34	0.34
10/18/09 11:00 AM	0.00	0.33	0.33
10/18/09 2:00 PM	0.00	0.32	0.32
10/18/09 5:00 PM	0.00	0.32	0.32
10/18/09 8:00 PM	0.00	0.31	0.31
10/18/09 11:00 PM	0.00	0.30	0.30
10/19/09 2:00 AM	0.00	0.29	0.29
10/19/09 5:00 AM	0.00	0.31	0.31
10/19/09 8:00 AM	0.00	0.31	0.31
10/19/09 11:00 AM	0.00	0.30	0.30
10/19/09 2:00 PM	0.00	0.30	0.30
10/19/09 5:00 PM	0.00	0.31	0.31
10/19/09 8:00 PM	0.00	0.30	0.30
10/19/09 11:00 PM	0.00	0.29	0.29
10/20/09 2:00 AM	0.00	0.29	0.29
10/20/09 5:00 AM	0.00	0.29	0.29
10/20/09 8:00 AM	0.00	0.27	0.27
10/20/09 11:00 AM	0.02	0.27	0.29
10/20/09 2:00 PM	0.18	0.26	0.44
10/20/09 5:00 PM	0.49	0.27	0.76
10/20/09 8:00 PM	1.16	0.27	1.43
10/20/09 11:00 PM	1.05	0.24	1.29
10/21/09 2:00 AM	1.08	0.23	1.31
10/21/09 5:00 AM	0.99	0.27	1.26
10/21/09 8:00 AM	0.99	0.25	1.24
10/21/09 11:00 AM	0.98	0.28	1.26
10/21/09 2:00 PM	0.93	0.31	1.24
10/21/09 5:00 PM	0.78	0.31	1.09
10/21/09 8:00 PM	0.78	0.30	1.08
10/21/09 11:00 PM	0.70	0.30	1.00
10/22/09 2:00 AM	0.42	0.29	0.71
10/22/09 5:00 AM	0.59	0.29	0.88
10/22/09 8:00 AM	0.91	0.29	1.20
10/22/09 11:00 AM	0.68	0.31	0.99
10/22/09 2:00 PM	0.83	0.30	1.13
10/22/09 5:00 PM	0.79	0.32	1.11
10/22/09 8:00 PM	0.99	0.35	1.34
10/22/09 11:00 PM	0.73	0.37	1.10
10/23/09 2:00 AM	0.75	0.41	1.16
10/23/09 5:00 AM	0.74	0.45	1.20
10/23/09 8:00 AM	0.77	0.51	1.28
10/23/09 11:00 AM	0.64	0.49	1.13
10/23/09 2:00 PM	0.77	0.50	1.27
10/23/09 5:00 PM	0.81	0.46	1.27
10/23/09 8:00 PM	0.81	0.42	1.23
10/23/09 11:00 PM	0.80	0.42	1.22
10/24/09 2:00 AM	0.93	0.26	1.19
10/24/09 5:00 AM	1.02	0.25	1.27
10/24/09 8:00 AM	1.10	0.32	1.42
10/24/09 11:00 AM	1.05	0.30	1.35
10/24/09 2:00 PM	1.10	0.27	1.37
10/24/09 5:00 PM	0.93	0.28	1.22
10/24/09 8:00 PM	0.98	0.28	1.26
10/24/09 11:00 PM	0.86	0.28	1.13

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
10/25/09 2:00 AM	0.59	0.26	0.85
10/25/09 5:00 AM	0.44	0.20	0.64
10/25/09 8:00 AM	0.77	0.24	1.01
10/25/09 11:00 AM	0.98	0.25	1.23
10/25/09 2:00 PM	0.96	0.26	1.22
10/25/09 5:00 PM	0.89	0.25	1.14
10/25/09 8:00 PM	0.85	0.24	1.10
10/25/09 11:00 PM	0.77	0.12	0.89
10/26/09 2:00 AM	0.56	0.06	0.61
10/26/09 5:00 AM	0.58	0.08	0.66
10/26/09 8:00 AM	0.58	0.21	0.79
10/26/09 11:00 AM	0.53	0.22	0.75
10/26/09 2:00 PM	0.74	0.25	0.99
10/26/09 5:00 PM	0.94	0.24	1.19
10/26/09 8:00 PM	0.93	0.25	1.19
10/26/09 11:00 PM	0.90	0.25	1.15
10/27/09 2:00 AM	0.77	0.25	1.02
10/27/09 5:00 AM	0.78	0.25	1.03
10/27/09 8:00 AM	0.91	0.23	1.14
10/27/09 11:00 AM	0.90	0.22	1.13
10/27/09 2:00 PM	0.86	0.22	1.08
10/27/09 5:00 PM	0.85	0.22	1.07
10/27/09 8:00 PM	0.84	0.23	1.06
10/27/09 11:00 PM	0.55	0.18	0.73
10/28/09 2:00 AM	0.42	0.16	0.59
10/28/09 5:00 AM	0.48	0.16	0.65
10/28/09 8:00 AM	0.69	0.21	0.90
10/28/09 11:00 AM	0.76	0.20	0.96
10/28/09 2:00 PM	0.60	0.21	0.82
10/28/09 5:00 PM	0.59	0.22	0.81
10/28/09 8:00 PM	0.52	0.21	0.73
10/28/09 11:00 PM	0.40	0.23	0.63
10/29/09 2:00 AM	0.27	0.23	0.50
10/29/09 5:00 AM	0.35	0.24	0.59
10/29/09 8:00 AM	0.35	0.05	0.41
10/29/09 11:00 AM	0.38	0.00	0.38
10/29/09 2:00 PM	0.39	0.00	0.39
10/29/09 5:00 PM	0.39	0.00	0.39
10/29/09 8:00 PM	0.39	0.00	0.39
10/29/09 11:00 PM	0.39	0.00	0.39
10/30/09 2:00 AM	0.37	0.00	0.37
10/30/09 5:00 AM	0.38	0.00	0.38
10/30/09 8:00 AM	0.54	0.00	0.54
10/30/09 11:00 AM	0.54	0.00	0.54
10/30/09 2:00 PM	0.49	0.00	0.49
10/30/09 5:00 PM	0.45	0.00	0.45
10/30/09 8:00 PM	0.47	0.00	0.47
10/30/09 11:00 PM	0.46	0.00	0.46
10/31/09 2:00 AM	0.50	0.00	0.50
10/31/09 5:00 AM	0.59	0.00	0.59
10/31/09 8:00 AM	0.62	0.00	0.62
10/31/09 11:00 AM	0.39	0.00	0.39
10/31/09 2:00 PM	0.45	0.00	0.45
10/31/09 5:00 PM	0.50	0.00	0.50

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
10/31/09 8:00 PM	0.54	0.00	0.54
10/31/09 11:00 PM	0.43	0.00	0.43
11/1/09 2:00 AM	0.47	0.00	0.47
11/1/09 5:00 AM	0.51	0.00	0.51
11/1/09 8:00 AM	0.45	0.00	0.45
11/1/09 11:00 AM	0.62	0.00	0.62
11/1/09 2:00 PM	0.63	0.00	0.63
11/1/09 5:00 PM	0.48	0.00	0.48
11/1/09 8:00 PM	0.51	0.00	0.51
11/1/09 11:00 PM	0.52	0.00	0.52
11/2/09 2:00 AM	0.49	0.00	0.49
11/2/09 5:00 AM	0.50	0.00	0.50
11/2/09 8:00 AM	0.49	0.00	0.49
11/2/09 11:00 AM	0.53	0.00	0.53
11/2/09 2:00 PM	0.53	0.00	0.53
11/2/09 5:00 PM	0.49	0.00	0.49
11/2/09 8:00 PM	0.46	0.00	0.46
11/2/09 11:00 PM	0.48	0.00	0.48
11/3/09 2:00 AM	0.46	0.00	0.46
11/3/09 5:00 AM	0.48	0.00	0.48
11/3/09 8:00 AM	0.50	0.00	0.50
11/3/09 11:00 AM	0.56	0.00	0.56
11/3/09 2:00 PM	0.60	0.00	0.60
11/3/09 5:00 PM	0.60	0.00	0.60
11/3/09 8:00 PM	0.60	0.00	0.60
11/3/09 11:00 PM	0.62	0.00	0.62
11/4/09 2:00 AM	0.46	0.00	0.46
11/4/09 5:00 AM	0.63	0.00	0.63
11/4/09 8:00 AM	0.64	0.00	0.64
11/4/09 11:00 AM	0.66	0.00	0.66
11/4/09 2:00 PM	0.64	0.00	0.64
11/4/09 5:00 PM	0.64	0.00	0.64
11/4/09 8:00 PM	0.60	0.00	0.60
11/4/09 11:00 PM	0.60	0.00	0.60
11/5/09 2:00 AM	0.63	0.00	0.63
11/5/09 5:00 AM	0.61	0.00	0.61
11/5/09 8:00 AM	0.66	0.00	0.66
11/5/09 11:00 AM	0.62	0.00	0.62
11/5/09 2:00 PM	0.60	0.00	0.60
11/5/09 5:00 PM	0.61	0.00	0.61
11/5/09 8:00 PM	0.61	0.00	0.61
11/5/09 11:00 PM	0.48	0.00	0.48
11/6/09 2:00 AM	0.37	0.00	0.37
11/6/09 5:00 AM	0.36	0.00	0.36
11/6/09 8:00 AM	0.42	0.00	0.42
11/6/09 11:00 AM	0.64	0.00	0.64
11/6/09 2:00 PM	0.63	0.00	0.63
11/6/09 5:00 PM	0.63	0.06	0.70
11/6/09 8:00 PM	0.62	0.12	0.73
11/6/09 11:00 PM	0.61	0.12	0.74
11/7/09 2:00 AM	0.33	0.10	0.43
11/7/09 5:00 AM	0.26	0.06	0.32
11/7/09 8:00 AM	0.29	0.09	0.38
11/7/09 11:00 AM	0.48	0.16	0.64

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
11/7/09 2:00 PM	0.42	0.15	0.57
11/7/09 5:00 PM	0.48	0.16	0.64
11/7/09 8:00 PM	0.33	0.16	0.49
11/7/09 11:00 PM	0.10	0.17	0.26
11/8/09 2:00 AM	0.23	0.12	0.35
11/8/09 5:00 AM	0.24	0.09	0.34
11/8/09 8:00 AM	0.33	0.12	0.45
11/8/09 11:00 AM	0.39	0.18	0.56
11/8/09 2:00 PM	0.16	0.19	0.35
11/8/09 5:00 PM	0.21	0.17	0.38
11/8/09 8:00 PM	0.29	0.15	0.44
11/8/09 11:00 PM	0.21	0.15	0.36
11/9/09 2:00 AM	0.20	0.10	0.30
11/9/09 5:00 AM	0.22	0.07	0.29
11/9/09 8:00 AM	0.34	0.23	0.57
11/9/09 11:00 AM	0.11	0.27	0.37
11/9/09 2:00 PM	0.30	0.23	0.53
11/9/09 5:00 PM	0.30	0.23	0.53
11/9/09 8:00 PM	0.29	0.21	0.50
11/9/09 11:00 PM	0.28	0.20	0.48
11/10/09 2:00 AM	0.28	0.18	0.46
11/10/09 5:00 AM	0.27	0.17	0.44
11/10/09 8:00 AM	0.26	0.18	0.44
11/10/09 11:00 AM	0.36	0.21	0.57
11/10/09 2:00 PM	0.20	0.22	0.43
11/10/09 5:00 PM	0.14	0.18	0.32
11/10/09 8:00 PM	0.13	0.18	0.31
11/10/09 11:00 PM	0.13	0.14	0.26
11/11/09 2:00 AM	0.10	0.09	0.19
11/11/09 5:00 AM	0.09	0.08	0.17
11/11/09 8:00 AM	0.15	0.15	0.30
11/11/09 11:00 AM	0.08	0.17	0.25
11/11/09 2:00 PM	0.06	0.19	0.25
11/11/09 5:00 PM	0.06	0.19	0.25
11/11/09 8:00 PM	0.08	0.19	0.27
11/11/09 11:00 PM	0.11	0.15	0.26
11/12/09 2:00 AM	0.09	0.10	0.19
11/12/09 5:00 AM	0.01	0.11	0.12
11/12/09 8:00 AM	0.07	0.22	0.28
11/12/09 11:00 AM	0.05	0.25	0.30
11/12/09 2:00 PM	0.04	0.32	0.37
11/12/09 5:00 PM	0.04	0.31	0.35
11/12/09 8:00 PM	0.05	0.32	0.37
11/12/09 11:00 PM	0.05	0.35	0.40
11/13/09 2:00 AM	0.04	0.34	0.38
11/13/09 5:00 AM	0.09	0.22	0.31
11/13/09 8:00 AM	0.19	0.39	0.59
11/13/09 11:00 AM	0.18	0.36	0.54
11/13/09 2:00 PM	0.17	0.17	0.35
11/13/09 5:00 PM	0.18	0.15	0.32
11/13/09 8:00 PM	0.18	0.15	0.33
11/13/09 11:00 PM	0.19	0.16	0.35
11/14/09 2:00 AM	0.19	0.15	0.34
11/14/09 5:00 AM	0.17	0.11	0.28

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
11/14/09 8:00 AM	0.21	0.18	0.39
11/14/09 11:00 AM	0.20	0.19	0.39
11/14/09 2:00 PM	0.19	0.21	0.40
11/14/09 5:00 PM	0.13	0.20	0.34
11/14/09 8:00 PM	0.17	0.21	0.38
11/14/09 11:00 PM	0.06	0.25	0.31
11/15/09 2:00 AM	0.04	0.20	0.25
11/15/09 5:00 AM	0.04	0.17	0.21
11/15/09 8:00 AM	0.07	0.16	0.23
11/15/09 11:00 AM	0.05	0.15	0.21
11/15/09 2:00 PM	0.03	0.14	0.17
11/15/09 5:00 PM	0.02	0.14	0.16
11/15/09 8:00 PM	0.03	0.14	0.17
11/15/09 11:00 PM	0.05	0.15	0.20
11/16/09 2:00 AM	0.05	0.14	0.19
11/16/09 5:00 AM	0.05	0.12	0.17
11/16/09 8:00 AM	0.12	0.13	0.25
11/16/09 11:00 AM	0.09	0.11	0.19
11/16/09 2:00 PM	0.12	0.11	0.24
11/16/09 5:00 PM	0.12	0.15	0.27
11/16/09 8:00 PM	0.10	0.15	0.25
11/16/09 11:00 PM	0.09	0.12	0.22
11/17/09 2:00 AM	0.08	0.05	0.13
11/17/09 5:00 AM	0.06	0.05	0.12
11/17/09 8:00 AM	0.12	0.13	0.24
11/17/09 11:00 AM	0.08	0.18	0.26
11/17/09 2:00 PM	0.06	0.18	0.24
11/17/09 5:00 PM	0.08	0.19	0.26
11/17/09 8:00 PM	0.08	0.20	0.27
11/17/09 11:00 PM	0.06	0.18	0.24
11/18/09 2:00 AM	0.08	0.06	0.14
11/18/09 5:00 AM	0.07	0.05	0.12
11/18/09 8:00 AM	0.10	0.16	0.26
11/18/09 11:00 AM	0.09	0.18	0.27
11/18/09 2:00 PM	0.08	0.21	0.29
11/18/09 5:00 PM	0.08	0.25	0.33
11/18/09 8:00 PM	0.07	0.24	0.32
11/18/09 11:00 PM	0.06	0.24	0.30
11/19/09 2:00 AM	0.06	0.17	0.22
11/19/09 5:00 AM	0.06	0.16	0.22
11/19/09 8:00 AM	0.13	0.21	0.34
11/19/09 11:00 AM	0.08	0.27	0.35
11/19/09 2:00 PM	0.07	0.27	0.35
11/19/09 5:00 PM	0.07	0.30	0.37
11/19/09 8:00 PM	0.07	0.30	0.37
11/19/09 11:00 PM	0.07	0.29	0.36
11/20/09 2:00 AM	0.06	0.09	0.15
11/20/09 5:00 AM	0.06	0.07	0.13
11/20/09 8:00 AM	0.11	0.18	0.29
11/20/09 11:00 AM	0.08	0.21	0.28
11/20/09 2:00 PM	0.12	0.17	0.28
11/20/09 5:00 PM	0.08	0.23	0.31
11/20/09 8:00 PM	0.08	0.26	0.34
11/20/09 11:00 PM	0.07	0.27	0.34

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
11/21/09 2:00 AM	0.07	0.16	0.23
11/21/09 5:00 AM	0.07	0.13	0.20
11/21/09 8:00 AM	0.12	0.22	0.35
11/21/09 11:00 AM	0.10	0.23	0.32
11/21/09 2:00 PM	0.09	0.23	0.32
11/21/09 5:00 PM	0.09	0.23	0.32
11/21/09 8:00 PM	0.08	0.24	0.32
11/21/09 11:00 PM	0.08	0.23	0.31
11/22/09 2:00 AM	0.08	0.07	0.16
11/22/09 5:00 AM	0.08	0.05	0.13
11/22/09 8:00 AM	0.13	0.05	0.18
11/22/09 11:00 AM	0.09	0.08	0.18
11/22/09 2:00 PM	0.09	0.08	0.17
11/22/09 5:00 PM	0.09	0.08	0.17
11/22/09 8:00 PM	0.09	0.08	0.18
11/22/09 11:00 PM	0.08	0.09	0.17
11/23/09 2:00 AM	0.05	0.19	0.24
11/23/09 5:00 AM	0.03	0.22	0.25
11/23/09 8:00 AM	0.08	0.19	0.28
11/23/09 11:00 AM	0.10	0.19	0.29
11/23/09 2:00 PM	0.07	0.21	0.28
11/23/09 5:00 PM	0.06	0.21	0.27
11/23/09 8:00 PM	0.04	0.19	0.22
11/23/09 11:00 PM	0.03	0.12	0.14
11/24/09 2:00 AM	0.02	0.06	0.08
11/24/09 5:00 AM	0.02	0.05	0.07
11/24/09 8:00 AM	0.05	0.13	0.19
11/24/09 11:00 AM	0.03	0.26	0.29
11/24/09 2:00 PM	0.02	0.27	0.29
11/24/09 5:00 PM	0.03	0.24	0.26
11/24/09 8:00 PM	0.02	0.24	0.27
11/24/09 11:00 PM	0.02	0.20	0.23
11/25/09 2:00 AM	0.02	0.10	0.12
11/25/09 5:00 AM	0.02	0.10	0.12
11/25/09 8:00 AM	0.06	0.19	0.25
11/25/09 11:00 AM	0.06	0.19	0.25
11/25/09 2:00 PM	0.04	0.20	0.25
11/25/09 5:00 PM	0.04	0.20	0.24
11/25/09 8:00 PM	0.04	0.21	0.25
11/25/09 11:00 PM	0.04	0.22	0.26
11/26/09 2:00 AM	0.03	0.20	0.24
11/26/09 5:00 AM	0.03	0.16	0.19
11/26/09 8:00 AM	0.07	0.20	0.27
11/26/09 11:00 AM	0.05	0.23	0.27
11/26/09 2:00 PM	0.04	0.23	0.28
11/26/09 5:00 PM	0.04	0.25	0.29
11/26/09 8:00 PM	0.04	0.25	0.29
11/26/09 11:00 PM	0.02	0.25	0.28
11/27/09 2:00 AM	0.01	0.26	0.27
11/27/09 5:00 AM	0.01	0.26	0.27
11/27/09 8:00 AM	0.04	0.26	0.30
11/27/09 11:00 AM	0.02	0.25	0.27
11/27/09 2:00 PM	0.02	0.23	0.25
11/27/09 5:00 PM	0.02	0.22	0.24

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
11/27/09 8:00 PM	0.02	0.21	0.23
11/27/09 11:00 PM	0.02	0.21	0.23
11/28/09 2:00 AM	0.02	0.22	0.24
11/28/09 5:00 AM	0.02	0.21	0.23
11/28/09 8:00 AM	0.06	0.23	0.29
11/28/09 11:00 AM	0.02	0.24	0.26
11/28/09 2:00 PM	0.02	0.24	0.26
11/28/09 5:00 PM	0.02	0.25	0.26
11/28/09 8:00 PM	0.02	0.25	0.26
11/28/09 11:00 PM	0.02	0.24	0.26
11/29/09 2:00 AM	0.02	0.24	0.26
11/29/09 5:00 AM	0.02	0.24	0.26
11/29/09 8:00 AM	0.08	0.42	0.50
11/29/09 11:00 AM	0.08	0.22	0.30
11/29/09 2:00 PM	0.05	0.19	0.24
11/29/09 5:00 PM	0.04	0.20	0.25
11/29/09 8:00 PM	0.04	0.19	0.23
11/29/09 11:00 PM	0.04	0.19	0.24
11/30/09 2:00 AM	0.04	0.25	0.29
11/30/09 5:00 AM	0.04	0.23	0.27
11/30/09 8:00 AM	0.10	0.28	0.38
11/30/09 11:00 AM	0.05	0.31	0.36
11/30/09 2:00 PM	0.05	0.30	0.34
11/30/09 5:00 PM	0.04	0.28	0.32
11/30/09 8:00 PM	0.05	0.24	0.29
11/30/09 11:00 PM	0.04	0.17	0.22
12/1/09 2:00 AM	0.04	0.11	0.15
12/1/09 5:00 AM	0.04	0.09	0.13
12/1/09 8:00 AM	0.08	0.18	0.26
12/1/09 11:00 AM	0.05	0.24	0.29
12/1/09 2:00 PM	0.05	0.25	0.30
12/1/09 5:00 PM	0.04	0.26	0.30
12/1/09 8:00 PM	0.04	0.27	0.31
12/1/09 11:00 PM	0.04	0.25	0.29
12/2/09 2:00 AM	0.04	0.14	0.18
12/2/09 5:00 AM	0.04	0.14	0.18
12/2/09 8:00 AM	0.09	0.25	0.33
12/2/09 11:00 AM	0.05	0.26	0.31
12/2/09 2:00 PM	0.05	0.30	0.35
12/2/09 5:00 PM	0.03	0.34	0.37
12/2/09 8:00 PM	0.02	0.35	0.37
12/2/09 11:00 PM	0.02	0.35	0.37
12/3/09 2:00 AM	0.02	0.34	0.36
12/3/09 5:00 AM	0.02	0.35	0.37
12/3/09 8:00 AM	0.07	0.37	0.44
12/3/09 11:00 AM	0.03	0.40	0.43
12/3/09 2:00 PM	0.03	0.46	0.49
12/3/09 5:00 PM	0.02	0.46	0.49
12/3/09 8:00 PM	0.02	0.44	0.46
12/3/09 11:00 PM	0.02	0.41	0.43
12/4/09 2:00 AM	0.02	0.23	0.25
12/4/09 5:00 AM	0.02	0.23	0.26
12/4/09 8:00 AM	0.06	0.43	0.49
12/4/09 11:00 AM	0.03	0.52	0.55

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
12/4/09 2:00 PM	0.02	0.38	0.41
12/4/09 5:00 PM	0.02	0.41	0.43
12/4/09 8:00 PM	0.03	0.39	0.41
12/4/09 11:00 PM	0.03	0.40	0.43
12/5/09 2:00 AM	0.02	0.39	0.42
12/5/09 5:00 AM	0.02	0.39	0.41
12/5/09 8:00 AM	0.07	0.50	0.57
12/5/09 11:00 AM	0.03	0.55	0.58
12/5/09 2:00 PM	0.03	0.51	0.53
12/5/09 5:00 PM	0.02	0.66	0.68
12/5/09 8:00 PM	0.02	0.59	0.62
12/5/09 11:00 PM	0.02	0.96	0.99
12/6/09 2:00 AM	0.02	0.39	0.41
12/6/09 5:00 AM	0.02	0.41	0.44
12/6/09 8:00 AM	0.06	0.39	0.45
12/6/09 11:00 AM	0.03	0.39	0.42
12/6/09 2:00 PM	0.03	0.39	0.42
12/6/09 5:00 PM	0.03	0.43	0.46
12/6/09 8:00 PM	0.03	0.51	0.53
12/6/09 11:00 PM	0.03	0.51	0.54
12/7/09 2:00 AM	0.02	0.53	0.55
12/7/09 5:00 AM	0.02	0.44	0.46
12/7/09 8:00 AM	0.06	0.49	0.56
12/7/09 11:00 AM	0.03	0.52	0.55
12/7/09 2:00 PM	0.03	0.49	0.52
12/7/09 5:00 PM	0.02	0.46	0.48
12/7/09 8:00 PM	0.04	0.43	0.47
12/7/09 11:00 PM	0.05	0.43	0.48
12/8/09 2:00 AM	0.05	0.32	0.37
12/8/09 5:00 AM	0.05	0.29	0.33
12/8/09 8:00 AM	0.10	0.45	0.55
12/8/09 11:00 AM	0.06	0.51	0.57
12/8/09 2:00 PM	0.09	0.51	0.60
12/8/09 5:00 PM	0.05	0.52	0.57
12/8/09 8:00 PM	0.05	0.36	0.41
12/8/09 11:00 PM	0.05	0.17	0.23
12/9/09 2:00 AM	0.05	0.25	0.30
12/9/09 5:00 AM	0.05	0.29	0.34
12/9/09 8:00 AM	0.13	0.30	0.43
12/9/09 11:00 AM	0.12	0.27	0.39
12/9/09 2:00 PM	0.07	0.21	0.27
12/9/09 5:00 PM	0.06	0.32	0.38
12/9/09 8:00 PM	0.06	0.35	0.41
12/9/09 11:00 PM	0.06	0.35	0.41
12/10/09 2:00 AM	0.04	0.35	0.38
12/10/09 5:00 AM	0.04	0.35	0.38
12/10/09 8:00 AM	0.11	0.36	0.47
12/10/09 11:00 AM	0.08	0.39	0.47
12/10/09 2:00 PM	0.07	0.39	0.47
12/10/09 5:00 PM	0.05	0.40	0.45
12/10/09 8:00 PM	0.07	0.39	0.46
12/10/09 11:00 PM	0.08	0.39	0.47
12/11/09 2:00 AM	0.08	0.35	0.42
12/11/09 5:00 AM	0.07	0.41	0.49

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
12/11/09 8:00 AM	0.12	0.42	0.53
12/11/09 11:00 AM	0.08	0.41	0.49
12/11/09 2:00 PM	0.07	0.42	0.49
12/11/09 5:00 PM	0.07	0.22	0.29
12/11/09 8:00 PM	0.07	0.18	0.25
12/11/09 11:00 PM	0.06	0.17	0.23
12/12/09 2:00 AM	0.06	0.17	0.23
12/12/09 5:00 AM	0.06	0.13	0.19
12/12/09 8:00 AM	0.10	0.25	0.35
12/12/09 11:00 AM	0.08	0.34	0.42
12/12/09 2:00 PM	0.07	0.36	0.43
12/12/09 5:00 PM	0.07	0.35	0.42
12/12/09 8:00 PM	0.05	0.33	0.38
12/12/09 11:00 PM	0.04	0.31	0.34
12/13/09 2:00 AM	0.02	0.31	0.32
12/13/09 5:00 AM	0.02	0.31	0.33
12/13/09 8:00 AM	0.04	0.28	0.32
12/13/09 11:00 AM	0.02	0.01	0.03
12/13/09 2:00 PM	0.02	0.18	0.20
12/13/09 5:00 PM	0.02	0.29	0.31
12/13/09 8:00 PM	0.02	0.27	0.28
12/13/09 11:00 PM	0.02	0.26	0.28
12/14/09 2:00 AM	0.02	0.24	0.26
12/14/09 5:00 AM	0.02	0.24	0.26
12/14/09 8:00 AM	0.05	0.25	0.30
12/14/09 11:00 AM	0.02	0.26	0.28
12/14/09 2:00 PM	0.05	0.26	0.31
12/14/09 5:00 PM	0.10	0.26	0.37
12/14/09 8:00 PM	0.09	0.26	0.35
12/14/09 11:00 PM	0.08	0.25	0.33
12/15/09 2:00 AM	0.08	0.23	0.31
12/15/09 5:00 AM	0.08	0.23	0.31
12/15/09 8:00 AM	0.08	0.23	0.31
12/15/09 11:00 AM	0.09	0.23	0.32
12/15/09 2:00 PM	0.10	0.24	0.34
12/15/09 5:00 PM	0.09	0.23	0.31
12/15/09 8:00 PM	0.09	0.21	0.30
12/15/09 11:00 PM	0.09	0.20	0.30
12/16/09 2:00 AM	0.07	0.21	0.28
12/16/09 5:00 AM	0.06	0.22	0.28
12/16/09 8:00 AM	0.10	0.24	0.34
12/16/09 11:00 AM	0.09	0.21	0.30
12/16/09 2:00 PM	0.09	0.20	0.29
12/16/09 5:00 PM	0.09	0.20	0.29
12/16/09 8:00 PM	0.10	0.20	0.30
12/16/09 11:00 PM	0.09	0.20	0.28
12/17/09 2:00 AM	0.11	0.26	0.37
12/17/09 5:00 AM	0.14	0.23	0.37
12/17/09 8:00 AM	0.24	0.21	0.45
12/17/09 11:00 AM	0.46	0.31	0.77
12/17/09 2:00 PM	0.52	0.32	0.83
12/17/09 5:00 PM	0.51	0.32	0.83
12/17/09 8:00 PM	0.52	0.33	0.85
12/17/09 11:00 PM	0.52	0.33	0.85

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
12/18/09 2:00 AM	0.41	0.54	0.96
12/18/09 5:00 AM	0.40	0.49	0.89
12/18/09 8:00 AM	0.51	0.43	0.94
12/18/09 11:00 AM	0.17	0.31	0.48
12/18/09 2:00 PM	0.00	0.31	0.31
12/18/09 5:00 PM	0.15	0.31	0.46
12/18/09 8:00 PM	0.29	0.30	0.60
12/18/09 11:00 PM	0.29	0.30	0.59
12/19/09 2:00 AM	0.03	0.28	0.31
12/19/09 5:00 AM	0.00	0.31	0.31
12/19/09 8:00 AM	0.00	0.33	0.33
12/19/09 11:00 AM	0.00	0.31	0.31
12/19/09 2:00 PM	0.00	0.28	0.28
12/19/09 5:00 PM	0.00	0.28	0.28
12/19/09 8:00 PM	0.00	0.31	0.31
12/19/09 11:00 PM	0.00	0.33	0.33
12/20/09 2:00 AM	0.00	0.34	0.34
12/20/09 5:00 AM	0.00	0.34	0.34
12/20/09 8:00 AM	0.09	0.34	0.43
12/20/09 11:00 AM	0.35	0.35	0.69
12/20/09 2:00 PM	0.55	0.35	0.90
12/20/09 5:00 PM	0.50	0.36	0.86
12/20/09 8:00 PM	0.49	0.37	0.86
12/20/09 11:00 PM	0.49	0.34	0.83
12/21/09 2:00 AM	0.50	0.29	0.79
12/21/09 5:00 AM	0.52	0.34	0.86
12/21/09 8:00 AM	0.39	0.34	0.73
12/21/09 11:00 AM	0.21	0.30	0.51
12/21/09 2:00 PM	0.21	0.28	0.49
12/21/09 5:00 PM	0.19	0.26	0.45
12/21/09 8:00 PM	0.19	0.24	0.43
12/21/09 11:00 PM	0.20	0.24	0.45
12/22/09 2:00 AM	0.21	0.24	0.44
12/22/09 5:00 AM	0.21	0.23	0.44
12/22/09 8:00 AM	0.21	0.25	0.46
12/22/09 11:00 AM	0.22	0.25	0.47
12/22/09 2:00 PM	0.21	0.23	0.44
12/22/09 5:00 PM	0.20	0.21	0.42
12/22/09 8:00 PM	0.20	0.23	0.44
12/22/09 11:00 PM	0.20	0.24	0.44
12/23/09 2:00 AM	0.07	0.23	0.31
12/23/09 5:00 AM	0.11	0.24	0.34
12/23/09 8:00 AM	0.19	0.24	0.43
12/23/09 11:00 AM	0.19	0.22	0.41
12/23/09 2:00 PM	0.19	0.23	0.42
12/23/09 5:00 PM	0.18	0.23	0.42
12/23/09 8:00 PM	0.19	0.24	0.43
12/23/09 11:00 PM	0.18	0.23	0.40
12/24/09 2:00 AM	0.14	0.16	0.30
12/24/09 5:00 AM	0.04	0.12	0.16
12/24/09 8:00 AM	0.02	0.13	0.15
12/24/09 11:00 AM	0.01	0.30	0.32
12/24/09 2:00 PM	0.01	0.34	0.35
12/24/09 5:00 PM	0.01	0.27	0.27

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
12/24/09 8:00 PM	0.00	0.12	0.12
12/24/09 11:00 PM	0.00	0.13	0.13
12/25/09 2:00 AM	0.00	0.28	0.28
12/25/09 5:00 AM	0.00	0.40	0.40
12/25/09 8:00 AM	0.00	0.44	0.44
12/25/09 11:00 AM	0.04	0.37	0.42
12/25/09 2:00 PM	0.04	0.29	0.33
12/25/09 5:00 PM	0.04	0.23	0.27
12/25/09 8:00 PM	0.03	0.23	0.26
12/25/09 11:00 PM	0.03	0.12	0.16
12/26/09 2:00 AM	0.04	0.10	0.14
12/26/09 5:00 AM	0.06	0.00	0.06
12/26/09 8:00 AM	0.04	0.00	0.04
12/26/09 11:00 AM	0.06	0.00	0.06
12/26/09 2:00 PM	0.04	0.00	0.04
12/26/09 5:00 PM	0.04	0.00	0.04
12/26/09 8:00 PM	0.05	0.00	0.05
12/26/09 11:00 PM	0.04	0.00	0.04
12/27/09 2:00 AM	0.06	0.00	0.06
12/27/09 5:00 AM	0.05	0.00	0.05
12/27/09 8:00 AM	0.05	0.00	0.05
12/27/09 11:00 AM	0.05	0.00	0.05
12/27/09 2:00 PM	0.06	0.00	0.06
12/27/09 5:00 PM	0.06	0.00	0.06
12/27/09 8:00 PM	0.06	0.00	0.06
12/27/09 11:00 PM	0.06	0.00	0.06
12/28/09 2:00 AM	0.05	0.00	0.05
12/28/09 5:00 AM	0.06	0.00	0.06
12/28/09 8:00 AM	0.06	0.00	0.06
12/28/09 11:00 AM	0.05	0.00	0.05
12/28/09 2:00 PM	0.06	0.00	0.06
12/28/09 5:00 PM	0.06	0.00	0.06
12/28/09 8:00 PM	0.06	0.00	0.06
12/28/09 11:00 PM	0.07	0.00	0.07
12/29/09 2:00 AM	0.13	0.00	0.13
12/29/09 5:00 AM	0.12	0.00	0.12
12/29/09 8:00 AM	0.12	0.00	0.12
12/29/09 11:00 AM	0.11	0.00	0.11
12/29/09 2:00 PM	0.11	0.00	0.11
12/29/09 5:00 PM	0.11	0.00	0.11
12/29/09 8:00 PM	0.11	0.00	0.11
12/29/09 11:00 PM	0.14	0.00	0.14
12/30/09 2:00 AM	0.15	0.00	0.15
12/30/09 5:00 AM	0.16	0.00	0.16
12/30/09 8:00 AM	0.21	0.00	0.21
12/30/09 11:00 AM	0.21	0.00	0.21
12/30/09 2:00 PM	0.21	0.00	0.21
12/30/09 5:00 PM	0.22	0.00	0.22
12/30/09 8:00 PM	0.22	0.00	0.22
12/30/09 11:00 PM	0.21	0.00	0.21
12/31/09 2:00 AM	0.21	0.00	0.21
12/31/09 5:00 AM	0.15	0.00	0.15
12/31/09 8:00 AM	0.18	0.00	0.18
12/31/09 11:00 AM	0.23	0.00	0.23

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
12/31/09 2:00 PM	0.23	0.00	0.23
12/31/09 5:00 PM	0.22	0.00	0.22
12/31/09 8:00 PM	0.23	0.00	0.23
12/31/09 11:00 PM	0.23	0.00	0.23
1/1/10 2:00 AM	0.23	0.00	0.23
1/1/10 5:00 AM	0.23	0.00	0.23
1/1/10 8:00 AM	0.23	0.00	0.23
1/1/10 11:00 AM	0.23	0.00	0.23
1/1/10 2:00 PM	0.23	0.00	0.23
1/1/10 5:00 PM	0.24	0.00	0.24
1/1/10 8:00 PM	0.23	0.00	0.23
1/1/10 11:00 PM	0.23	0.00	0.23
1/2/10 2:00 AM	0.24	0.00	0.24
1/2/10 5:00 AM	0.24	0.00	0.24
1/2/10 8:00 AM	0.26	0.00	0.26
1/2/10 11:00 AM	0.24	0.00	0.24
1/2/10 2:00 PM	0.23	0.00	0.23
1/2/10 5:00 PM	0.24	0.00	0.24
1/2/10 8:00 PM	0.23	0.00	0.23
1/2/10 11:00 PM	0.23	0.00	0.23
1/3/10 2:00 AM	0.22	0.00	0.22
1/3/10 5:00 AM	0.23	0.00	0.23
1/3/10 8:00 AM	0.25	0.00	0.25
1/3/10 11:00 AM	0.24	0.00	0.24
1/3/10 2:00 PM	0.24	0.00	0.24
1/3/10 5:00 PM	0.21	0.00	0.21
1/3/10 8:00 PM	0.14	0.00	0.14
1/3/10 11:00 PM	0.24	0.00	0.24
1/4/10 2:00 AM	0.23	0.00	0.23
1/4/10 5:00 AM	0.22	0.00	0.22
1/4/10 8:00 AM	0.24	0.00	0.24
1/4/10 11:00 AM	0.24	0.00	0.24
1/4/10 2:00 PM	0.23	0.00	0.23
1/4/10 5:00 PM	0.23	0.00	0.23
1/4/10 8:00 PM	0.23	0.00	0.23
1/4/10 11:00 PM	0.22	0.00	0.22
1/5/10 2:00 AM	0.22	0.00	0.22
1/5/10 5:00 AM	0.22	0.00	0.22
1/5/10 8:00 AM	0.24	0.00	0.24
1/5/10 11:00 AM	0.22	0.00	0.22
1/5/10 2:00 PM	0.22	0.00	0.22
1/5/10 5:00 PM	0.22	0.00	0.22
1/5/10 8:00 PM	0.26	0.00	0.26
1/5/10 11:00 PM	0.30	0.00	0.30
1/6/10 2:00 AM	0.23	0.00	0.23
1/6/10 5:00 AM	0.23	0.00	0.23
1/6/10 8:00 AM	0.24	0.00	0.24
1/6/10 11:00 AM	0.23	0.00	0.23
1/6/10 2:00 PM	0.22	0.00	0.22
1/6/10 5:00 PM	0.23	0.00	0.23
1/6/10 8:00 PM	0.23	0.00	0.23
1/6/10 11:00 PM	0.31	0.00	0.31
1/7/10 2:00 AM	0.22	0.00	0.22
1/7/10 5:00 AM	0.29	0.00	0.29

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
1/7/10 8:00 AM	0.21	0.00	0.21
1/7/10 11:00 AM	0.24	0.00	0.24
1/7/10 2:00 PM	0.39	0.00	0.39
1/7/10 5:00 PM	0.24	0.00	0.24
1/7/10 8:00 PM	0.20	0.00	0.20
1/7/10 11:00 PM	0.18	0.00	0.18
1/8/10 2:00 AM	0.14	0.00	0.14
1/8/10 5:00 AM	0.16	0.00	0.16
1/8/10 8:00 AM	0.17	0.00	0.17
1/8/10 11:00 AM	0.11	0.00	0.11
1/8/10 2:00 PM	0.11	0.00	0.11
1/8/10 5:00 PM	0.15	0.00	0.15
1/8/10 8:00 PM	0.18	0.00	0.18
1/8/10 11:00 PM	0.19	0.00	0.19
1/9/10 2:00 AM	0.20	0.00	0.20
1/9/10 5:00 AM	0.20	0.00	0.20
1/9/10 8:00 AM	0.21	0.00	0.21
1/9/10 11:00 AM	0.20	0.00	0.20
1/9/10 2:00 PM	0.21	0.00	0.21
1/9/10 5:00 PM	0.20	0.00	0.20
1/9/10 8:00 PM	0.20	0.00	0.20
1/9/10 11:00 PM	0.19	0.00	0.19
1/10/10 2:00 AM	0.18	0.00	0.18
1/10/10 5:00 AM	0.18	0.00	0.18
1/10/10 8:00 AM	0.19	0.00	0.19
1/10/10 11:00 AM	0.18	0.00	0.18
1/10/10 2:00 PM	0.18	0.00	0.18
1/10/10 5:00 PM	0.19	0.00	0.19
1/10/10 8:00 PM	0.19	0.00	0.19
1/10/10 11:00 PM	0.18	0.00	0.18
1/11/10 2:00 AM	0.18	0.00	0.18
1/11/10 5:00 AM	0.18	0.00	0.18
1/11/10 8:00 AM	0.19	0.00	0.19
1/11/10 11:00 AM	0.18	0.00	0.18
1/11/10 2:00 PM	0.18	0.00	0.18
1/11/10 5:00 PM	0.36	0.00	0.36
1/11/10 8:00 PM	0.44	0.00	0.44
1/11/10 11:00 PM	0.45	0.00	0.45
1/12/10 2:00 AM	0.44	0.00	0.44
1/12/10 5:00 AM	0.44	0.00	0.44
1/12/10 8:00 AM	0.44	0.00	0.44
1/12/10 11:00 AM	0.39	0.00	0.39
1/12/10 2:00 PM	0.38	0.00	0.38
1/12/10 5:00 PM	0.37	0.00	0.37
1/12/10 8:00 PM	0.37	0.00	0.37
1/12/10 11:00 PM	0.36	0.00	0.36
1/13/10 2:00 AM	0.36	0.00	0.36
1/13/10 5:00 AM	0.36	0.00	0.36
1/13/10 8:00 AM	0.37	0.00	0.37
1/13/10 11:00 AM	0.36	0.00	0.36
1/13/10 2:00 PM	0.36	0.00	0.36
1/13/10 5:00 PM	0.37	0.00	0.37
1/13/10 8:00 PM	0.38	0.00	0.38
1/13/10 11:00 PM	0.39	0.00	0.39

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
1/14/10 2:00 AM	0.37	0.00	0.37
1/14/10 5:00 AM	0.37	0.00	0.37
1/14/10 8:00 AM	0.37	0.00	0.37
1/14/10 11:00 AM	0.23	0.00	0.23
1/14/10 2:00 PM	0.21	0.00	0.21
1/14/10 5:00 PM	0.27	0.00	0.27
1/14/10 8:00 PM	0.27	0.00	0.27
1/14/10 11:00 PM	0.26	0.00	0.26
1/15/10 2:00 AM	0.26	0.00	0.26
1/15/10 5:00 AM	0.27	0.00	0.27
1/15/10 8:00 AM	0.33	0.00	0.33
1/15/10 11:00 AM	0.36	0.00	0.36
1/15/10 2:00 PM	0.35	0.00	0.35
1/15/10 5:00 PM	0.36	0.00	0.36
1/15/10 8:00 PM	0.36	0.00	0.36
1/15/10 11:00 PM	0.37	0.00	0.37
1/16/10 2:00 AM	0.38	0.00	0.38
1/16/10 5:00 AM	0.37	0.00	0.37
1/16/10 8:00 AM	0.38	0.00	0.38
1/16/10 11:00 AM	0.36	0.00	0.36
1/16/10 2:00 PM	0.36	0.00	0.36
1/16/10 5:00 PM	0.31	0.00	0.31
1/16/10 8:00 PM	0.11	0.00	0.11
1/16/10 11:00 PM	0.12	0.00	0.12
1/17/10 2:00 AM	0.12	0.00	0.12
1/17/10 5:00 AM	0.25	0.00	0.25
1/17/10 8:00 AM	0.38	0.00	0.38
1/17/10 11:00 AM	0.36	0.00	0.36
1/17/10 2:00 PM	0.36	0.00	0.36
1/17/10 5:00 PM	0.36	0.00	0.36
1/17/10 8:00 PM	0.36	0.00	0.36
1/17/10 11:00 PM	0.35	0.00	0.35
1/18/10 2:00 AM	0.29	0.00	0.29
1/18/10 5:00 AM	0.29	0.00	0.29
1/18/10 8:00 AM	0.32	0.00	0.32
1/18/10 11:00 AM	0.30	0.00	0.30
1/18/10 2:00 PM	0.31	0.00	0.31
1/18/10 5:00 PM	0.32	0.00	0.32
1/18/10 8:00 PM	0.32	0.00	0.32
1/18/10 11:00 PM	0.31	0.00	0.31
1/19/10 2:00 AM	0.31	0.00	0.31
1/19/10 5:00 AM	0.30	0.00	0.30
1/19/10 8:00 AM	0.30	0.00	0.30
1/19/10 11:00 AM	0.29	0.00	0.29
1/19/10 2:00 PM	0.28	0.01	0.30
1/19/10 5:00 PM	0.29	0.03	0.32
1/19/10 8:00 PM	0.28	0.04	0.32
1/19/10 11:00 PM	0.28	0.04	0.33
1/20/10 2:00 AM	0.28	0.05	0.32
1/20/10 5:00 AM	0.28	0.06	0.34
1/20/10 8:00 AM	0.26	0.17	0.43
1/20/10 11:00 AM	0.26	0.12	0.39
1/20/10 2:00 PM	0.29	0.12	0.41
1/20/10 5:00 PM	0.31	0.12	0.43

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
1/20/10 8:00 PM	0.23	0.14	0.37
1/20/10 11:00 PM	0.21	0.13	0.34
1/21/10 2:00 AM	0.09	0.13	0.22
1/21/10 5:00 AM	0.00	0.14	0.14
1/21/10 8:00 AM	0.00	0.17	0.18
1/21/10 11:00 AM	0.00	0.19	0.19
1/21/10 2:00 PM	0.00	0.21	0.21
1/21/10 5:00 PM	0.00	0.21	0.21
1/21/10 8:00 PM	0.00	0.39	0.39
1/21/10 11:00 PM	0.00	0.31	0.31
1/22/10 2:00 AM	0.00	0.16	0.16
1/22/10 5:00 AM	0.00	0.29	0.29
1/22/10 8:00 AM	0.00	0.52	0.52
1/22/10 11:00 AM	0.00	0.44	0.44
1/22/10 2:00 PM	0.00	0.36	0.36
1/22/10 5:00 PM	0.00	0.25	0.25
1/22/10 8:00 PM	0.00	0.12	0.12
1/22/10 11:00 PM	0.00	0.12	0.12
1/23/10 2:00 AM	0.00	0.09	0.09
1/23/10 5:00 AM	0.00	0.10	0.10
1/23/10 8:00 AM	0.00	0.11	0.11
1/23/10 11:00 AM	0.00	0.12	0.12
1/23/10 2:00 PM	0.00	0.12	0.12
1/23/10 5:00 PM	0.00	0.12	0.12
1/23/10 8:00 PM	0.00	0.12	0.12
1/23/10 11:00 PM	0.00	0.12	0.12
1/24/10 2:00 AM	0.00	0.12	0.12
1/24/10 5:00 AM	0.00	0.12	0.12
1/24/10 8:00 AM	0.00	0.15	0.15
1/24/10 11:00 AM	0.00	0.14	0.14
1/24/10 2:00 PM	0.00	0.13	0.13
1/24/10 5:00 PM	0.00	0.12	0.12
1/24/10 8:00 PM	0.00	0.13	0.13
1/24/10 11:00 PM	0.00	0.11	0.11
1/25/10 2:00 AM	0.00	0.11	0.11
1/25/10 5:00 AM	0.00	0.12	0.12
1/25/10 8:00 AM	0.00	0.13	0.13
1/25/10 11:00 AM	0.00	0.13	0.13
1/25/10 2:00 PM	0.00	0.13	0.13
1/25/10 5:00 PM	0.00	0.14	0.14
1/25/10 8:00 PM	0.00	0.14	0.14
1/25/10 11:00 PM	0.00	0.14	0.14
1/26/10 2:00 AM	0.00	0.13	0.13
1/26/10 5:00 AM	0.00	0.13	0.13
1/26/10 8:00 AM	0.00	0.16	0.16
1/26/10 11:00 AM	0.00	0.14	0.14
1/26/10 2:00 PM	0.00	0.15	0.15
1/26/10 5:00 PM	0.00	0.14	0.14
1/26/10 8:00 PM	0.00	0.13	0.13
1/26/10 11:00 PM	0.00	0.13	0.13
1/27/10 2:00 AM	0.00	0.12	0.12
1/27/10 5:00 AM	0.00	0.13	0.13
1/27/10 8:00 AM	0.00	0.17	0.17
1/27/10 11:00 AM	0.00	0.14	0.14

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
1/27/10 2:00 PM	0.00	0.16	0.16
1/27/10 5:00 PM	0.00	0.14	0.14
1/27/10 8:00 PM	0.00	0.08	0.08
1/27/10 11:00 PM	0.00	0.09	0.09
1/28/10 2:00 AM	0.00	0.09	0.09
1/28/10 5:00 AM	0.00	0.13	0.13
1/28/10 8:00 AM	0.00	0.17	0.17
1/28/10 11:00 AM	0.00	0.15	0.15
1/28/10 2:00 PM	0.00	0.15	0.15
1/28/10 5:00 PM	0.00	0.15	0.15
1/28/10 8:00 PM	0.00	0.15	0.15
1/28/10 11:00 PM	0.00	0.14	0.14
1/29/10 2:00 AM	0.00	0.14	0.14
1/29/10 5:00 AM	0.00	0.15	0.15
1/29/10 8:00 AM	0.00	0.15	0.15
1/29/10 11:00 AM	0.00	0.24	0.24
1/29/10 2:00 PM	0.00	0.39	0.39
1/29/10 5:00 PM	0.00	0.27	0.27
1/29/10 8:00 PM	0.00	0.18	0.18
1/29/10 11:00 PM	0.00	0.18	0.18
1/30/10 2:00 AM	0.00	0.13	0.13
1/30/10 5:00 AM	0.00	0.14	0.14
1/30/10 8:00 AM	0.00	0.14	0.14
1/30/10 11:00 AM	0.00	0.13	0.13
1/30/10 2:00 PM	0.00	0.13	0.13
1/30/10 5:00 PM	0.00	0.14	0.14
1/30/10 8:00 PM	0.00	0.13	0.13
1/30/10 11:00 PM	0.00	0.12	0.12
1/31/10 2:00 AM	0.00	0.11	0.11
1/31/10 5:00 AM	0.00	0.12	0.12
1/31/10 8:00 AM	0.00	0.16	0.16
1/31/10 11:00 AM	0.00	0.20	0.20
1/31/10 2:00 PM	0.00	0.15	0.15
1/31/10 5:00 PM	0.00	0.15	0.15
1/31/10 8:00 PM	0.00	0.14	0.14
1/31/10 11:00 PM	0.00	0.13	0.13
2/1/10 2:00 AM	0.00	0.10	0.10
2/1/10 5:00 AM	0.00	0.10	0.10
2/1/10 8:00 AM	0.00	0.14	0.14
2/1/10 11:00 AM	0.00	0.11	0.11
2/1/10 2:00 PM	0.00	0.14	0.14
2/1/10 5:00 PM	0.00	0.14	0.14
2/1/10 8:00 PM	0.00	0.13	0.13
2/1/10 11:00 PM	0.00	0.10	0.10
2/2/10 2:00 AM	0.00	0.10	0.10
2/2/10 5:00 AM	0.00	0.10	0.10
2/2/10 8:00 AM	0.00	0.11	0.11
2/2/10 11:00 AM	0.00	0.11	0.11
2/2/10 2:00 PM	0.00	0.10	0.10
2/2/10 5:00 PM	0.00	0.10	0.10
2/2/10 8:00 PM	0.00	0.11	0.11
2/2/10 11:00 PM	0.00	0.07	0.07
2/3/10 2:00 AM	0.00	0.08	0.08
2/3/10 5:00 AM	0.00	0.10	0.10

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
2/3/10 8:00 AM	0.00	0.13	0.13
2/3/10 11:00 AM	0.00	0.15	0.15
2/3/10 2:00 PM	0.00	0.15	0.15
2/3/10 5:00 PM	0.00	0.15	0.15
2/3/10 8:00 PM	0.00	0.14	0.14
2/3/10 11:00 PM	0.00	0.14	0.14
2/4/10 2:00 AM	0.00	0.15	0.15
2/4/10 5:00 AM	0.00	0.15	0.15
2/4/10 8:00 AM	0.00	0.15	0.15
2/4/10 11:00 AM	0.00	0.14	0.14
2/4/10 2:00 PM	0.00	0.13	0.13
2/4/10 5:00 PM	0.00	0.13	0.13
2/4/10 8:00 PM	0.00	0.13	0.13
2/4/10 11:00 PM	0.00	0.10	0.10
2/5/10 2:00 AM	0.00	0.06	0.06
2/5/10 5:00 AM	0.00	0.09	0.09
2/5/10 8:00 AM	0.00	0.14	0.14
2/5/10 11:00 AM	0.00	0.12	0.12
2/5/10 2:00 PM	0.00	0.12	0.12
2/5/10 5:00 PM	0.00	0.12	0.12
2/5/10 8:00 PM	0.00	0.12	0.12
2/5/10 11:00 PM	0.00	0.11	0.11
2/6/10 2:00 AM	0.00	0.10	0.10
2/6/10 5:00 AM	0.00	0.12	0.12
2/6/10 8:00 AM	0.00	0.12	0.12
2/6/10 11:00 AM	0.00	0.12	0.12
2/6/10 2:00 PM	0.00	0.12	0.12
2/6/10 5:00 PM	0.00	0.12	0.12
2/6/10 8:00 PM	0.00	0.12	0.12
2/6/10 11:00 PM	0.00	0.13	0.13
2/7/10 2:00 AM	0.00	0.13	0.13
2/7/10 5:00 AM	0.00	0.13	0.13
2/7/10 8:00 AM	0.00	0.15	0.15
2/7/10 11:00 AM	0.00	0.13	0.13
2/7/10 2:00 PM	0.00	0.13	0.13
2/7/10 5:00 PM	0.00	0.12	0.12
2/7/10 8:00 PM	0.00	0.13	0.13
2/7/10 11:00 PM	0.00	0.14	0.14
2/8/10 2:00 AM	0.00	0.14	0.14
2/8/10 5:00 AM	0.00	0.14	0.14
2/8/10 8:00 AM	0.00	0.15	0.15
2/8/10 11:00 AM	0.00	0.14	0.14
2/8/10 2:00 PM	0.00	0.12	0.12
2/8/10 5:00 PM	0.00	0.12	0.12
2/8/10 8:00 PM	0.00	0.12	0.12
2/8/10 11:00 PM	0.00	0.13	0.13
2/9/10 2:00 AM	0.00	0.14	0.14
2/9/10 5:00 AM	0.00	0.13	0.13
2/9/10 8:00 AM	0.00	0.14	0.14
2/9/10 11:00 AM	0.00	0.13	0.13
2/9/10 2:00 PM	0.00	0.12	0.12
2/9/10 5:00 PM	0.03	0.13	0.17
2/9/10 8:00 PM	0.10	0.14	0.24
2/9/10 11:00 PM	0.10	0.13	0.23

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
2/10/10 2:00 AM	0.10	0.11	0.22
2/10/10 5:00 AM	0.12	0.12	0.24
2/10/10 8:00 AM	0.11	0.13	0.24
2/10/10 11:00 AM	0.00	0.12	0.12
2/10/10 2:00 PM	0.00	0.13	0.13
2/10/10 5:00 PM	0.02	0.13	0.15
2/10/10 8:00 PM	0.23	0.13	0.37
2/10/10 11:00 PM	0.42	0.13	0.56
2/11/10 2:00 AM	0.54	0.13	0.67
2/11/10 5:00 AM	0.54	0.15	0.69
2/11/10 8:00 AM	0.48	0.14	0.62
2/11/10 11:00 AM	0.41	0.16	0.57
2/11/10 2:00 PM	0.46	0.15	0.61
2/11/10 5:00 PM	0.43	0.15	0.59
2/11/10 8:00 PM	0.42	0.14	0.56
2/11/10 11:00 PM	0.44	0.14	0.58
2/12/10 2:00 AM	0.48	0.14	0.62
2/12/10 5:00 AM	0.48	0.14	0.62
2/12/10 8:00 AM	0.48	0.15	0.63
2/12/10 11:00 AM	0.45	0.14	0.59
2/12/10 2:00 PM	0.43	0.13	0.56
2/12/10 5:00 PM	0.39	0.14	0.53
2/12/10 8:00 PM	0.42	0.12	0.55
2/12/10 11:00 PM	0.42	0.12	0.54
2/13/10 2:00 AM	0.41	0.12	0.53
2/13/10 5:00 AM	0.40	0.13	0.53
2/13/10 8:00 AM	0.42	0.15	0.57
2/13/10 11:00 AM	0.42	0.17	0.58
2/13/10 2:00 PM	0.41	0.16	0.57
2/13/10 5:00 PM	0.40	0.14	0.54
2/13/10 8:00 PM	0.38	0.15	0.53
2/13/10 11:00 PM	0.38	0.16	0.54
2/14/10 2:00 AM	0.38	0.17	0.54
2/14/10 5:00 AM	0.37	0.17	0.54
2/14/10 8:00 AM	0.38	0.19	0.57
2/14/10 11:00 AM	0.37	0.19	0.56
2/14/10 2:00 PM	0.40	0.19	0.59
2/14/10 5:00 PM	0.40	0.17	0.57
2/14/10 8:00 PM	0.41	0.17	0.58
2/14/10 11:00 PM	0.42	0.19	0.61
2/15/10 2:00 AM	0.43	0.20	0.63
2/15/10 5:00 AM	0.43	0.20	0.63
2/15/10 8:00 AM	0.43	0.21	0.64
2/15/10 11:00 AM	0.43	0.25	0.68
2/15/10 2:00 PM	0.44	0.24	0.68
2/15/10 5:00 PM	0.43	0.21	0.65
2/15/10 8:00 PM	0.42	0.20	0.62
2/15/10 11:00 PM	0.40	0.19	0.59
2/16/10 2:00 AM	0.38	0.20	0.58
2/16/10 5:00 AM	0.37	0.19	0.56
2/16/10 8:00 AM	0.40	0.19	0.59
2/16/10 11:00 AM	0.37	0.19	0.56
2/16/10 2:00 PM	0.38	0.18	0.56
2/16/10 5:00 PM	0.37	0.18	0.55

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
2/16/10 8:00 PM	0.38	0.17	0.54
2/16/10 11:00 PM	0.38	0.16	0.54
2/17/10 2:00 AM	0.38	0.19	0.56
2/17/10 5:00 AM	0.39	0.17	0.56
2/17/10 8:00 AM	0.40	0.16	0.56
2/17/10 11:00 AM	0.39	0.15	0.54
2/17/10 2:00 PM	0.40	0.15	0.54
2/17/10 5:00 PM	0.39	0.15	0.54
2/17/10 8:00 PM	0.38	0.15	0.54
2/17/10 11:00 PM	0.37	0.16	0.53
2/18/10 2:00 AM	0.37	0.17	0.54
2/18/10 5:00 AM	0.37	0.17	0.54
2/18/10 8:00 AM	0.38	0.16	0.54
2/18/10 11:00 AM	0.38	0.09	0.47
2/18/10 2:00 PM	0.38	0.24	0.62
2/18/10 5:00 PM	0.39	0.28	0.67
2/18/10 8:00 PM	0.40	0.18	0.58
2/18/10 11:00 PM	0.40	0.18	0.58
2/19/10 2:00 AM	0.40	0.18	0.58
2/19/10 5:00 AM	0.40	0.18	0.58
2/19/10 8:00 AM	0.43	0.19	0.61
2/19/10 11:00 AM	0.41	0.18	0.59
2/19/10 2:00 PM	0.40	0.16	0.56
2/19/10 5:00 PM	0.44	0.14	0.58
2/19/10 8:00 PM	0.37	0.14	0.51
2/19/10 11:00 PM	0.23	0.12	0.35
2/20/10 2:00 AM	0.00	0.17	0.17
2/20/10 5:00 AM	0.14	0.18	0.32
2/20/10 8:00 AM	0.26	0.20	0.45
2/20/10 11:00 AM	0.26	0.39	0.66
2/20/10 2:00 PM	0.42	0.36	0.78
2/20/10 5:00 PM	0.42	0.18	0.61
2/20/10 8:00 PM	0.36	0.19	0.55
2/20/10 11:00 PM	0.35	0.17	0.52
2/21/10 2:00 AM	0.35	0.08	0.43
2/21/10 5:00 AM	0.36	0.08	0.44
2/21/10 8:00 AM	0.38	0.07	0.45
2/21/10 11:00 AM	0.14	0.08	0.22
2/21/10 2:00 PM	0.00	0.07	0.07
2/21/10 5:00 PM	0.00	0.07	0.07
2/21/10 8:00 PM	0.00	0.12	0.12
2/21/10 11:00 PM	0.00	0.22	0.22
2/22/10 2:00 AM	0.00	0.21	0.21
2/22/10 5:00 AM	0.00	0.22	0.22
2/22/10 8:00 AM	0.00	0.18	0.18
2/22/10 11:00 AM	0.00	0.31	0.31
2/22/10 2:00 PM	0.00	0.39	0.39
2/22/10 5:00 PM	0.00	0.41	0.41
2/22/10 8:00 PM	0.00	0.41	0.41
2/22/10 11:00 PM	0.00	0.40	0.40
2/23/10 2:00 AM	0.00	0.39	0.39
2/23/10 5:00 AM	0.00	0.39	0.39
2/23/10 8:00 AM	0.00	0.37	0.37
2/23/10 11:00 AM	0.00	0.39	0.39

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
2/23/10 2:00 PM	0.00	0.37	0.37
2/23/10 5:00 PM	0.00	0.37	0.37
2/23/10 8:00 PM	0.00	0.37	0.37
2/23/10 11:00 PM	0.00	0.37	0.37
2/24/10 2:00 AM	0.00	0.35	0.35
2/24/10 5:00 AM	0.00	0.35	0.35
2/24/10 8:00 AM	0.00	0.35	0.35
2/24/10 11:00 AM	0.00	0.35	0.35
2/24/10 2:00 PM	0.00	0.37	0.37
2/24/10 5:00 PM	0.00	0.36	0.36
2/24/10 8:00 PM	0.00	0.34	0.34
2/24/10 11:00 PM	0.00	0.34	0.34
2/25/10 2:00 AM	0.00	0.32	0.32
2/25/10 5:00 AM	0.00	0.33	0.33
2/25/10 8:00 AM	0.00	0.34	0.34
2/25/10 11:00 AM	0.00	0.35	0.35
2/25/10 2:00 PM	0.00	0.35	0.35
2/25/10 5:00 PM	0.00	0.35	0.35
2/25/10 8:00 PM	0.00	0.36	0.36
2/25/10 11:00 PM	0.00	0.37	0.37
2/26/10 2:00 AM	0.00	0.39	0.39
2/26/10 5:00 AM	0.00	0.42	0.42
2/26/10 8:00 AM	0.00	0.38	0.38
2/26/10 11:00 AM	0.00	0.36	0.36
2/26/10 2:00 PM	0.00	0.35	0.35
2/26/10 5:00 PM	0.00	0.36	0.36
2/26/10 8:00 PM	0.00	0.31	0.31
2/26/10 11:00 PM	0.00	0.17	0.17
2/27/10 2:00 AM	0.00	0.17	0.17
2/27/10 5:00 AM	0.00	0.18	0.18
2/27/10 8:00 AM	0.00	0.16	0.16
2/27/10 11:00 AM	0.00	0.16	0.16
2/27/10 2:00 PM	0.00	0.12	0.12
2/27/10 5:00 PM	0.00	0.24	0.24
2/27/10 8:00 PM	0.00	0.33	0.33
2/27/10 11:00 PM	0.00	0.34	0.34
2/28/10 2:00 AM	0.00	0.33	0.33
2/28/10 5:00 AM	0.00	0.31	0.31
2/28/10 8:00 AM	0.00	0.32	0.32
2/28/10 11:00 AM	0.00	0.76	0.76
2/28/10 2:00 PM	0.00	0.36	0.36
2/28/10 5:00 PM	0.00	0.34	0.34
2/28/10 8:00 PM	0.00	0.36	0.36
2/28/10 11:00 PM	0.00	0.39	0.39
3/1/10 2:00 AM	0.00	0.39	0.39
3/1/10 5:00 AM	0.00	0.37	0.37
3/1/10 8:00 AM	0.00	0.38	0.38
3/1/10 11:00 AM	0.00	0.38	0.38
3/1/10 2:00 PM	0.00	0.37	0.37
3/1/10 5:00 PM	0.00	0.36	0.36
3/1/10 8:00 PM	0.00	0.35	0.35
3/1/10 11:00 PM	0.00	0.35	0.35
3/2/10 2:00 AM	0.00	0.34	0.34
3/2/10 5:00 AM	0.00	0.33	0.33

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
3/2/10 8:00 AM	0.00	0.33	0.33
3/2/10 11:00 AM	0.00	0.16	0.16
3/2/10 2:00 PM	0.00	0.35	0.35
3/2/10 5:00 PM	0.00	0.32	0.32
3/2/10 8:00 PM	0.00	0.33	0.33
3/2/10 11:00 PM	0.00	0.35	0.35
3/3/10 2:00 AM	0.00	0.35	0.35
3/3/10 5:00 AM	0.00	0.34	0.34
3/3/10 8:00 AM	0.00	0.33	0.33
3/3/10 11:00 AM	0.00	0.33	0.33
3/3/10 2:00 PM	0.00	0.31	0.31
3/3/10 5:00 PM	0.00	0.30	0.30
3/3/10 8:00 PM	0.00	0.27	0.27
3/3/10 11:00 PM	0.00	0.26	0.26
3/4/10 2:00 AM	0.02	0.30	0.32
3/4/10 5:00 AM	0.34	0.31	0.66
3/4/10 8:00 AM	0.63	0.31	0.94
3/4/10 11:00 AM	0.02	0.31	0.34
3/4/10 2:00 PM	0.00	0.32	0.32
3/4/10 5:00 PM	0.00	0.31	0.31
3/4/10 8:00 PM	0.00	0.31	0.31
3/4/10 11:00 PM	0.00	0.31	0.31
3/5/10 2:00 AM	0.00	0.32	0.32
3/5/10 5:00 AM	0.00	0.29	0.29
3/5/10 8:00 AM	0.00	0.30	0.30
3/5/10 11:00 AM	0.00	0.31	0.31
3/5/10 2:00 PM	0.00	0.31	0.31
3/5/10 5:00 PM	0.07	0.33	0.39
3/5/10 8:00 PM	0.21	0.31	0.52
3/5/10 11:00 PM	0.29	0.27	0.56
3/6/10 2:00 AM	0.69	0.14	0.83
3/6/10 5:00 AM	0.26	0.15	0.41
3/6/10 8:00 AM	0.25	0.15	0.39
3/6/10 11:00 AM	0.24	0.17	0.41
3/6/10 2:00 PM	0.22	0.22	0.44
3/6/10 5:00 PM	0.20	0.25	0.45
3/6/10 8:00 PM	0.26	0.26	0.52
3/6/10 11:00 PM	0.36	0.25	0.61
3/7/10 2:00 AM	0.31	0.32	0.62
3/7/10 5:00 AM	0.26	0.30	0.55
3/7/10 8:00 AM	0.32	0.31	0.64
3/7/10 11:00 AM	0.31	0.29	0.60
3/7/10 2:00 PM	0.70	0.12	0.83
3/7/10 5:00 PM	0.31	0.00	0.31
3/7/10 8:00 PM	0.31	0.01	0.32
3/7/10 11:00 PM	0.29	0.28	0.57
3/8/10 2:00 AM	0.29	0.44	0.73
3/8/10 5:00 AM	0.32	0.45	0.77
3/8/10 8:00 AM	0.31	0.31	0.62
3/8/10 11:00 AM	0.30	0.02	0.31
3/8/10 2:00 PM	0.27	0.00	0.27
3/8/10 5:00 PM	0.24	0.00	0.24
3/8/10 8:00 PM	0.29	0.00	0.29
3/8/10 11:00 PM	0.32	0.00	0.32

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
3/9/10 2:00 AM	0.32	0.00	0.32
3/9/10 5:00 AM	0.32	0.00	0.32
3/9/10 8:00 AM	0.36	0.00	0.36
3/9/10 11:00 AM	0.59	0.00	0.59
3/9/10 2:00 PM	0.44	0.00	0.44
3/9/10 5:00 PM	0.37	0.00	0.37
3/9/10 8:00 PM	0.38	0.00	0.38
3/9/10 11:00 PM	0.37	0.00	0.37
3/10/10 2:00 AM	0.32	0.00	0.32
3/10/10 5:00 AM	0.27	0.00	0.27
3/10/10 8:00 AM	0.38	0.00	0.38
3/10/10 11:00 AM	0.39	0.00	0.39
3/10/10 2:00 PM	0.39	0.00	0.39
3/10/10 5:00 PM	0.38	0.00	0.38
3/10/10 8:00 PM	0.38	0.00	0.38
3/10/10 11:00 PM	0.40	0.00	0.40
3/11/10 2:00 AM	0.37	0.00	0.37
3/11/10 5:00 AM	0.32	0.00	0.32
3/11/10 8:00 AM	0.41	0.00	0.41
3/11/10 11:00 AM	0.39	0.00	0.39
3/11/10 2:00 PM	0.41	0.00	0.41
3/11/10 5:00 PM	0.44	0.00	0.44
3/11/10 8:00 PM	0.49	0.00	0.49
3/11/10 11:00 PM	0.31	0.00	0.31
3/12/10 2:00 AM	0.21	0.00	0.21
3/12/10 5:00 AM	0.21	0.00	0.21
3/12/10 8:00 AM	0.22	0.00	0.22
3/12/10 11:00 AM	0.20	0.00	0.20
3/12/10 2:00 PM	0.19	0.00	0.19
3/12/10 5:00 PM	0.22	0.00	0.22
3/12/10 8:00 PM	0.57	0.00	0.57
3/12/10 11:00 PM	0.53	0.00	0.53
3/13/10 2:00 AM	0.47	0.00	0.47
3/13/10 5:00 AM	0.46	0.00	0.46
3/13/10 8:00 AM	0.45	0.00	0.45
3/13/10 11:00 AM	0.43	0.00	0.43
3/13/10 2:00 PM	0.41	0.00	0.41
3/13/10 5:00 PM	0.43	0.00	0.43
3/13/10 8:00 PM	0.43	0.00	0.43
3/13/10 11:00 PM	0.43	0.00	0.43
3/14/10 2:00 AM	0.44	0.00	0.44
3/14/10 5:00 AM	0.46	0.00	0.46
3/14/10 8:00 AM	0.45	0.00	0.45
3/14/10 11:00 AM	0.42	0.00	0.42
3/14/10 2:00 PM	0.40	0.00	0.40
3/14/10 5:00 PM	0.39	0.13	0.52
3/14/10 8:00 PM	0.37	0.19	0.56
3/14/10 11:00 PM	0.36	0.22	0.58
3/15/10 2:00 AM	0.17	0.23	0.40
3/15/10 5:00 AM	0.29	0.26	0.55
3/15/10 8:00 AM	0.39	0.36	0.75
3/15/10 11:00 AM	0.34	0.32	0.66
3/15/10 2:00 PM	0.16	0.23	0.39
3/15/10 5:00 PM	0.26	0.24	0.50

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
3/15/10 8:00 PM	0.32	0.24	0.56
3/15/10 11:00 PM	0.36	0.22	0.58
3/16/10 2:00 AM	0.29	0.19	0.48
3/16/10 5:00 AM	0.32	0.32	0.64
3/16/10 8:00 AM	0.30	0.25	0.54
3/16/10 11:00 AM	0.16	0.24	0.40
3/16/10 2:00 PM	0.19	0.23	0.42
3/16/10 5:00 PM	0.23	0.25	0.47
3/16/10 8:00 PM	0.38	0.25	0.63
3/16/10 11:00 PM	0.38	0.25	0.63
3/17/10 2:00 AM	0.16	0.17	0.33
3/17/10 5:00 AM	0.26	0.18	0.44
3/17/10 8:00 AM	0.37	0.27	0.65
3/17/10 11:00 AM	0.59	0.27	0.85
3/17/10 2:00 PM	1.05	0.26	1.31
3/17/10 5:00 PM	0.42	0.25	0.67
3/17/10 8:00 PM	0.36	0.27	0.63
3/17/10 11:00 PM	0.37	0.19	0.56
3/18/10 2:00 AM	0.27	0.10	0.37
3/18/10 5:00 AM	0.29	0.13	0.42
3/18/10 8:00 AM	0.33	0.21	0.55
3/18/10 11:00 AM	0.30	0.20	0.50
3/18/10 2:00 PM	0.27	0.22	0.49
3/18/10 5:00 PM	0.32	0.21	0.53
3/18/10 8:00 PM	0.45	0.22	0.67
3/18/10 11:00 PM	0.47	0.21	0.69
3/19/10 2:00 AM	0.41	0.20	0.61
3/19/10 5:00 AM	0.35	0.19	0.54
3/19/10 8:00 AM	0.34	0.19	0.53
3/19/10 11:00 AM	0.27	0.18	0.44
3/19/10 2:00 PM	0.21	0.19	0.40
3/19/10 5:00 PM	0.16	0.22	0.39
3/19/10 8:00 PM	0.25	0.20	0.45
3/19/10 11:00 PM	0.28	0.23	0.51
3/20/10 2:00 AM	0.27	0.20	0.47
3/20/10 5:00 AM	0.25	0.22	0.47
3/20/10 8:00 AM	0.30	0.24	0.54
3/20/10 11:00 AM	0.37	0.23	0.59
3/20/10 2:00 PM	0.33	0.24	0.57
3/20/10 5:00 PM	0.29	0.22	0.51
3/20/10 8:00 PM	0.30	0.12	0.42
3/20/10 11:00 PM	0.29	0.12	0.41
3/21/10 2:00 AM	0.29	0.11	0.40
3/21/10 5:00 AM	0.27	0.11	0.38
3/21/10 8:00 AM	0.27	0.24	0.51
3/21/10 11:00 AM	0.27	0.25	0.53
3/21/10 2:00 PM	0.26	0.25	0.51
3/21/10 5:00 PM	0.39	0.24	0.63
3/21/10 8:00 PM	0.31	0.24	0.55
3/21/10 11:00 PM	0.19	0.23	0.42
3/22/10 2:00 AM	0.11	0.19	0.30
3/22/10 5:00 AM	0.14	0.20	0.35
3/22/10 8:00 AM	0.16	0.22	0.38
3/22/10 11:00 AM	0.20	0.24	0.45

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
3/22/10 2:00 PM	0.40	0.23	0.62
3/22/10 5:00 PM	0.41	0.22	0.63
3/22/10 8:00 PM	0.66	0.22	0.88
3/22/10 11:00 PM	0.53	0.17	0.70
3/23/10 2:00 AM	0.45	0.08	0.53
3/23/10 5:00 AM	0.48	0.12	0.60
3/23/10 8:00 AM	0.62	0.20	0.82
3/23/10 11:00 AM	0.65	0.23	0.88
3/23/10 2:00 PM	0.67	0.20	0.87
3/23/10 5:00 PM	0.79	0.23	1.01
3/23/10 8:00 PM	0.76	0.26	1.02
3/23/10 11:00 PM	0.65	0.24	0.89
3/24/10 2:00 AM	0.50	0.18	0.68
3/24/10 5:00 AM	0.62	0.26	0.88
3/24/10 8:00 AM	0.82	0.26	1.08
3/24/10 11:00 AM	0.81	0.27	1.08
3/24/10 2:00 PM	0.91	0.27	1.18
3/24/10 5:00 PM	0.80	0.22	1.02
3/24/10 8:00 PM	0.67	0.23	0.90
3/24/10 11:00 PM	0.60	0.17	0.76
3/25/10 2:00 AM	0.24	0.16	0.40
3/25/10 5:00 AM	0.26	0.21	0.47
3/25/10 8:00 AM	0.85	0.29	1.14
3/25/10 11:00 AM	1.70	0.28	1.98
3/25/10 2:00 PM	1.74	0.22	1.97
3/25/10 5:00 PM	0.53	0.24	0.78
3/25/10 8:00 PM	0.54	0.25	0.78
3/25/10 11:00 PM	0.65	0.17	0.82
3/26/10 2:00 AM	0.42	0.09	0.51
3/26/10 5:00 AM	0.57	0.17	0.73
3/26/10 8:00 AM	0.92	0.31	1.23
3/26/10 11:00 AM	0.89	0.30	1.19
3/26/10 2:00 PM	0.83	0.28	1.11
3/26/10 5:00 PM	0.67	0.27	0.95
3/26/10 8:00 PM	0.77	0.27	1.04
3/26/10 11:00 PM	0.75	0.29	1.03
3/27/10 2:00 AM	0.76	0.21	0.96
3/27/10 5:00 AM	0.76	0.24	1.00
3/27/10 8:00 AM	0.74	0.29	1.03
3/27/10 11:00 AM	0.69	0.27	0.96
3/27/10 2:00 PM	0.66	0.26	0.92
3/27/10 5:00 PM	0.67	0.28	0.95
3/27/10 8:00 PM	0.67	0.25	0.92
3/27/10 11:00 PM	0.75	0.26	1.01
3/28/10 2:00 AM	0.61	0.21	0.82
3/28/10 5:00 AM	0.60	0.17	0.77
3/28/10 8:00 AM	0.77	0.25	1.02
3/28/10 11:00 AM	0.37	0.24	0.61
3/28/10 2:00 PM	0.20	0.25	0.45
3/28/10 5:00 PM	0.20	0.27	0.47
3/28/10 8:00 PM	0.23	0.25	0.48
3/28/10 11:00 PM	0.23	0.28	0.50
3/29/10 2:00 AM	0.22	0.29	0.50
3/29/10 5:00 AM	0.21	0.26	0.47

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
3/29/10 8:00 AM	0.19	0.27	0.46
3/29/10 11:00 AM	0.19	0.25	0.44
3/29/10 2:00 PM	0.22	0.25	0.47
3/29/10 5:00 PM	0.24	0.21	0.44
3/29/10 8:00 PM	0.25	0.20	0.44
3/29/10 11:00 PM	0.26	0.18	0.44
3/30/10 2:00 AM	0.27	0.17	0.44
3/30/10 5:00 AM	0.28	0.17	0.45
3/30/10 8:00 AM	3.23	0.16	3.39
3/30/10 11:00 AM	0.26	0.16	0.42
3/30/10 2:00 PM	0.27	0.18	0.45
3/30/10 5:00 PM	0.27	0.22	0.49
3/30/10 8:00 PM	0.30	0.21	0.51
3/30/10 11:00 PM	0.29	0.21	0.49
3/31/10 2:00 AM	0.13	0.19	0.32
3/31/10 5:00 AM	0.19	0.20	0.39
3/31/10 8:00 AM	0.37	0.19	0.56
3/31/10 11:00 AM	0.37	0.18	0.55
3/31/10 2:00 PM	0.37	0.17	0.54
3/31/10 5:00 PM	0.38	0.16	0.54
3/31/10 8:00 PM	0.48	0.16	0.64
3/31/10 11:00 PM	0.07	0.16	0.23
4/1/10 2:00 AM	0.00	0.13	0.13
4/1/10 5:00 AM	0.00	0.13	0.13
4/1/10 8:00 AM	0.00	0.14	0.14
4/1/10 11:00 AM	0.00	0.14	0.14
4/1/10 2:00 PM	0.00	0.09	0.09
4/1/10 5:00 PM	0.00	0.05	0.05
4/1/10 8:00 PM	0.00	0.04	0.04
4/1/10 11:00 PM	0.00	0.07	0.07
4/2/10 2:00 AM	0.00	0.06	0.06
4/2/10 5:00 AM	0.00	0.09	0.09
4/2/10 8:00 AM	0.00	0.15	0.15
4/2/10 11:00 AM	0.00	0.16	0.16
4/2/10 2:00 PM	0.00	0.16	0.16
4/2/10 5:00 PM	0.00	0.16	0.16
4/2/10 8:00 PM	0.00	0.16	0.16
4/2/10 11:00 PM	0.00	0.17	0.17
4/3/10 2:00 AM	0.00	0.18	0.18
4/3/10 5:00 AM	0.00	0.17	0.17
4/3/10 8:00 AM	0.00	0.17	0.17
4/3/10 11:00 AM	0.02	0.16	0.18
4/3/10 2:00 PM	0.08	0.18	0.26
4/3/10 5:00 PM	0.14	0.20	0.34
4/3/10 8:00 PM	0.14	0.18	0.33
4/3/10 11:00 PM	0.14	0.15	0.29
4/4/10 2:00 AM	0.18	0.14	0.32
4/4/10 5:00 AM	0.17	0.24	0.42
4/4/10 8:00 AM	0.41	0.20	0.60
4/4/10 11:00 AM	0.65	0.16	0.81
4/4/10 2:00 PM	0.55	0.15	0.70
4/4/10 5:00 PM	0.47	0.14	0.61
4/4/10 8:00 PM	0.46	0.13	0.59
4/4/10 11:00 PM	0.84	0.14	0.98

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
4/5/10 2:00 AM	0.63	0.15	0.77
4/5/10 5:00 AM	0.59	0.15	0.74
4/5/10 8:00 AM	0.82	0.15	0.97
4/5/10 11:00 AM	0.73	0.16	0.88
4/5/10 2:00 PM	0.29	0.18	0.46
4/5/10 5:00 PM	0.24	0.17	0.41
4/5/10 8:00 PM	0.29	0.19	0.49
4/5/10 11:00 PM	0.22	0.17	0.39
4/6/10 2:00 AM	0.17	0.16	0.33
4/6/10 5:00 AM	0.27	0.16	0.42
4/6/10 8:00 AM	0.56	0.15	0.70
4/6/10 11:00 AM	0.82	0.14	0.96
4/6/10 2:00 PM	0.98	0.16	1.15
4/6/10 5:00 PM	1.02	0.15	1.17
4/6/10 8:00 PM	1.09	0.15	1.24
4/6/10 11:00 PM	1.09	0.15	1.24
4/7/10 2:00 AM	0.70	0.05	0.75
4/7/10 5:00 AM	0.72	0.06	0.78
4/7/10 8:00 AM	0.92	0.11	1.02
4/7/10 11:00 AM	0.99	0.13	1.12
4/7/10 2:00 PM	1.07	0.17	1.24
4/7/10 5:00 PM	1.04	0.16	1.21
4/7/10 8:00 PM	1.05	0.18	1.23
4/7/10 11:00 PM	1.02	0.18	1.20
4/8/10 2:00 AM	0.80	0.09	0.90
4/8/10 5:00 AM	0.77	0.11	0.88
4/8/10 8:00 AM	1.01	0.15	1.16
4/8/10 11:00 AM	0.98	0.13	1.11
4/8/10 2:00 PM	1.01	0.11	1.12
4/8/10 5:00 PM	1.03	0.11	1.14
4/8/10 8:00 PM	1.00	0.11	1.11
4/8/10 11:00 PM	0.96	0.13	1.09
4/9/10 2:00 AM	0.77	0.14	0.91
4/9/10 5:00 AM	0.88	0.14	1.02
4/9/10 8:00 AM	1.09	0.14	1.23
4/9/10 11:00 AM	1.03	0.13	1.16
4/9/10 2:00 PM	1.01	0.11	1.12
4/9/10 5:00 PM	1.01	0.11	1.12
4/9/10 8:00 PM	1.00	0.15	1.15
4/9/10 11:00 PM	0.86	0.16	1.02
4/10/10 2:00 AM	0.57	0.08	0.66
4/10/10 5:00 AM	0.58	0.09	0.67
4/10/10 8:00 AM	0.63	0.14	0.77
4/10/10 11:00 AM	0.60	0.13	0.73
4/10/10 2:00 PM	0.70	0.12	0.82
4/10/10 5:00 PM	0.97	0.12	1.09
4/10/10 8:00 PM	0.97	0.12	1.09
4/10/10 11:00 PM	0.77	0.13	0.90
4/11/10 2:00 AM	0.76	0.14	0.90
4/11/10 5:00 AM	0.77	0.13	0.90
4/11/10 8:00 AM	0.99	0.14	1.13
4/11/10 11:00 AM	0.77	0.13	0.91
4/11/10 2:00 PM	0.72	0.11	0.83
4/11/10 5:00 PM	0.70	0.12	0.82

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
4/11/10 8:00 PM	0.77	0.13	0.90
4/11/10 11:00 PM	0.91	0.15	1.06
4/12/10 2:00 AM	0.75	0.05	0.80
4/12/10 5:00 AM	0.78	0.06	0.84
4/12/10 8:00 AM	0.95	0.15	1.10
4/12/10 11:00 AM	0.86	0.11	0.98
4/12/10 2:00 PM	0.82	0.12	0.93
4/12/10 5:00 PM	0.83	0.11	0.94
4/12/10 8:00 PM	0.83	0.12	0.95
4/12/10 11:00 PM	0.83	0.14	0.97
4/13/10 2:00 AM	0.57	0.11	0.68
4/13/10 5:00 AM	0.63	0.11	0.74
4/13/10 8:00 AM	1.10	0.14	1.25
4/13/10 11:00 AM	0.99	0.14	1.13
4/13/10 2:00 PM	1.02	0.14	1.16
4/13/10 5:00 PM	0.59	0.13	0.73
4/13/10 8:00 PM	0.35	0.14	0.49
4/13/10 11:00 PM	0.19	0.15	0.34
4/14/10 2:00 AM	0.08	0.14	0.22
4/14/10 5:00 AM	0.10	0.15	0.24
4/14/10 8:00 AM	0.20	0.17	0.36
4/14/10 11:00 AM	0.30	0.18	0.48
4/14/10 2:00 PM	0.30	0.15	0.45
4/14/10 5:00 PM	0.31	0.15	0.46
4/14/10 8:00 PM	0.31	0.15	0.47
4/14/10 11:00 PM	0.32	0.16	0.47
4/15/10 2:00 AM	0.33	0.17	0.49
4/15/10 5:00 AM	0.34	0.16	0.51
4/15/10 8:00 AM	0.41	0.16	0.57
4/15/10 11:00 AM	0.42	0.16	0.58
4/15/10 2:00 PM	0.39	0.15	0.55
4/15/10 5:00 PM	0.06	0.15	0.21
4/15/10 8:00 PM	0.00	0.14	0.14
4/15/10 11:00 PM	0.00	0.14	0.14
4/16/10 2:00 AM	0.00	0.14	0.14
4/16/10 5:00 AM	0.00	0.14	0.14
4/16/10 8:00 AM	0.00	0.14	0.14
4/16/10 11:00 AM	0.00	0.14	0.14
4/16/10 2:00 PM	0.00	0.13	0.13
4/16/10 5:00 PM	0.00	0.13	0.13
4/16/10 8:00 PM	0.00	0.13	0.13
4/16/10 11:00 PM	0.00	0.13	0.13
4/17/10 2:00 AM	0.00	0.14	0.14
4/17/10 5:00 AM	0.00	0.14	0.14
4/17/10 8:00 AM	0.00	0.14	0.14
4/17/10 11:00 AM	0.00	0.12	0.12
4/17/10 2:00 PM	0.00	0.12	0.12
4/17/10 5:00 PM	0.00	0.13	0.13
4/17/10 8:00 PM	0.00	0.15	0.15
4/17/10 11:00 PM	0.00	0.15	0.15
4/18/10 2:00 AM	0.17	0.15	0.32
4/18/10 5:00 AM	0.38	0.14	0.52
4/18/10 8:00 AM	0.39	0.16	0.55
4/18/10 11:00 AM	0.39	0.16	0.56

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
4/18/10 2:00 PM	0.40	0.09	0.49
4/18/10 5:00 PM	0.40	0.13	0.53
4/18/10 8:00 PM	0.43	0.32	0.76
4/18/10 11:00 PM	2.96	0.29	3.25
4/19/10 2:00 AM	0.44	0.18	0.62
4/19/10 5:00 AM	0.43	0.21	0.64
4/19/10 8:00 AM	0.44	0.23	0.67
4/19/10 11:00 AM	0.42	0.24	0.67
4/19/10 2:00 PM	0.44	0.26	0.70
4/19/10 5:00 PM	0.47	0.26	0.74
4/19/10 8:00 PM	0.49	0.27	0.76
4/19/10 11:00 PM	0.50	0.29	0.79
4/20/10 2:00 AM	0.49	0.28	0.77
4/20/10 5:00 AM	0.49	0.28	0.77
4/20/10 8:00 AM	0.50	0.16	0.66
4/20/10 11:00 AM	0.48	0.15	0.63
4/20/10 2:00 PM	0.46	0.15	0.61
4/20/10 5:00 PM	0.41	0.16	0.57
4/20/10 8:00 PM	0.00	0.17	0.17
4/20/10 11:00 PM	0.00	0.18	0.18
4/21/10 2:00 AM	0.08	0.18	0.26
4/21/10 5:00 AM	0.09	0.18	0.27
4/21/10 8:00 AM	0.08	0.20	0.29
4/21/10 11:00 AM	0.26	0.21	0.47
4/21/10 2:00 PM	0.49	0.22	0.71
4/21/10 5:00 PM	0.47	0.24	0.71
4/21/10 8:00 PM	0.44	0.20	0.63
4/21/10 11:00 PM	0.44	0.09	0.53
4/22/10 2:00 AM	0.41	0.08	0.49
4/22/10 5:00 AM	0.41	0.09	0.50
4/22/10 8:00 AM	0.40	0.09	0.49
4/22/10 11:00 AM	0.40	0.20	0.60
4/22/10 2:00 PM	0.37	0.21	0.59
4/22/10 5:00 PM	0.38	0.20	0.58
4/22/10 8:00 PM	0.39	0.21	0.60
4/22/10 11:00 PM	0.38	0.06	0.44
4/23/10 2:00 AM	0.37	0.04	0.41
4/23/10 5:00 AM	0.35	0.05	0.40
4/23/10 8:00 AM	0.32	0.16	0.48
4/23/10 11:00 AM	0.29	0.19	0.48
4/23/10 2:00 PM	0.27	0.18	0.46
4/23/10 5:00 PM	0.31	0.20	0.50
4/23/10 8:00 PM	0.30	0.19	0.49
4/23/10 11:00 PM	0.29	0.09	0.38
4/24/10 2:00 AM	0.29	0.07	0.36
4/24/10 5:00 AM	0.42	0.08	0.50
4/24/10 8:00 AM	0.62	0.06	0.68
4/24/10 11:00 AM	0.81	0.11	0.93
4/24/10 2:00 PM	0.94	0.28	1.22
4/24/10 5:00 PM	0.95	0.29	1.24
4/24/10 8:00 PM	1.06	0.29	1.35
4/24/10 11:00 PM	1.05	0.26	1.31
4/25/10 2:00 AM	1.00	0.07	1.07
4/25/10 5:00 AM	0.96	0.06	1.02

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
4/25/10 8:00 AM	0.94	0.13	1.07
4/25/10 11:00 AM	0.90	0.33	1.22
4/25/10 2:00 PM	0.84	0.33	1.17
4/25/10 5:00 PM	0.89	0.32	1.21
4/25/10 8:00 PM	0.87	0.29	1.16
4/25/10 11:00 PM	0.88	0.26	1.14
4/26/10 2:00 AM	0.81	0.19	1.01
4/26/10 5:00 AM	0.87	0.21	1.09
4/26/10 8:00 AM	0.95	0.25	1.20
4/26/10 11:00 AM	0.80	0.24	1.04
4/26/10 2:00 PM	0.59	0.23	0.82
4/26/10 5:00 PM	0.86	0.22	1.08
4/26/10 8:00 PM	0.88	0.24	1.12
4/26/10 11:00 PM	0.47	0.25	0.72
4/27/10 2:00 AM	0.38	0.20	0.59
4/27/10 5:00 AM	0.61	0.22	0.83
4/27/10 8:00 AM	0.94	0.38	1.32
4/27/10 11:00 AM	0.63	0.38	1.01
4/27/10 2:00 PM	0.25	0.38	0.63
4/27/10 5:00 PM	0.41	0.37	0.77
4/27/10 8:00 PM	0.71	0.32	1.02
4/27/10 11:00 PM	0.69	0.17	0.86
4/28/10 2:00 AM	0.38	0.15	0.53
4/28/10 5:00 AM	0.47	0.17	0.64
4/28/10 8:00 AM	0.75	0.15	0.90
4/28/10 11:00 AM	0.78	0.15	0.93
4/28/10 2:00 PM	0.79	0.13	0.92
4/28/10 5:00 PM	0.79	0.23	1.02
4/28/10 8:00 PM	0.78	0.26	1.04
4/28/10 11:00 PM	0.66	0.29	0.95
4/29/10 2:00 AM	0.48	0.22	0.71
4/29/10 5:00 AM	0.56	0.25	0.81
4/29/10 8:00 AM	0.72	0.30	1.02
4/29/10 11:00 AM	0.73	0.29	1.02
4/29/10 2:00 PM	0.72	0.29	1.01
4/29/10 5:00 PM	0.71	0.28	0.99
4/29/10 8:00 PM	0.73	0.27	1.00
4/29/10 11:00 PM	0.74	0.23	0.97
4/30/10 2:00 AM	0.73	0.14	0.87
4/30/10 5:00 AM	0.76	0.17	0.93
4/30/10 8:00 AM	0.82	0.27	1.09
4/30/10 11:00 AM	0.72	0.28	1.00
4/30/10 2:00 PM	0.39	0.29	0.69
4/30/10 5:00 PM	0.37	0.27	0.65
4/30/10 8:00 PM	0.37	0.26	0.63
4/30/10 11:00 PM	0.37	0.26	0.63
5/1/10 2:00 AM	0.37	0.23	0.60
5/1/10 5:00 AM	0.38	0.17	0.55
5/1/10 8:00 AM	0.62	0.26	0.88
5/1/10 11:00 AM	0.80	0.25	1.05
5/1/10 2:00 PM	0.80	0.24	1.03
5/1/10 5:00 PM	0.79	0.23	1.02
5/1/10 8:00 PM	0.77	0.23	0.99
5/1/10 11:00 PM	0.75	0.23	0.98

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
5/2/10 2:00 AM	0.76	0.23	0.99
5/2/10 5:00 AM	0.63	0.23	0.86
5/2/10 8:00 AM	0.30	0.22	0.51
5/2/10 11:00 AM	0.31	0.22	0.52
5/2/10 2:00 PM	0.34	0.22	0.56
5/2/10 5:00 PM	0.49	0.23	0.72
5/2/10 8:00 PM	0.42	0.23	0.65
5/2/10 11:00 PM	0.54	0.23	0.77
5/3/10 2:00 AM	0.62	0.21	0.84
5/3/10 5:00 AM	0.64	0.22	0.86
5/3/10 8:00 AM	0.69	0.22	0.92
5/3/10 11:00 AM	0.66	0.20	0.86
5/3/10 2:00 PM	0.64	0.21	0.86
5/3/10 5:00 PM	0.61	0.19	0.80
5/3/10 8:00 PM	0.63	0.14	0.76
5/3/10 11:00 PM	0.62	0.14	0.75
5/4/10 2:00 AM	0.66	0.17	0.83
5/4/10 5:00 AM	0.65	0.16	0.81
5/4/10 8:00 AM	0.90	0.15	1.05
5/4/10 11:00 AM	0.75	0.14	0.90
5/4/10 2:00 PM	0.87	0.13	1.00
5/4/10 5:00 PM	0.84	0.13	0.97
5/4/10 8:00 PM	1.06	0.12	1.18
5/4/10 11:00 PM	0.67	0.12	0.79
5/5/10 2:00 AM	0.67	0.12	0.79
5/5/10 5:00 AM	0.83	0.12	0.95
5/5/10 8:00 AM	1.15	0.11	1.27
5/5/10 11:00 AM	1.08	0.11	1.19
5/5/10 2:00 PM	0.79	0.11	0.90
5/5/10 5:00 PM	0.58	0.10	0.68
5/5/10 8:00 PM	0.43	0.09	0.52
5/5/10 11:00 PM	0.39	0.10	0.49
5/6/10 2:00 AM	0.38	0.11	0.49
5/6/10 5:00 AM	0.34	0.12	0.45
5/6/10 8:00 AM	0.31	0.13	0.44
5/6/10 11:00 AM	0.33	0.14	0.48
5/6/10 2:00 PM	0.73	0.15	0.88
5/6/10 5:00 PM	0.71	0.14	0.85
5/6/10 8:00 PM	0.74	0.14	0.89
5/6/10 11:00 PM	0.77	0.06	0.82
5/7/10 2:00 AM	0.75	0.05	0.80
5/7/10 5:00 AM	0.73	0.11	0.84
5/7/10 8:00 AM	0.74	0.14	0.88
5/7/10 11:00 AM	0.75	0.13	0.88
5/7/10 2:00 PM	0.76	0.19	0.95
5/7/10 5:00 PM	0.80	0.24	1.04
5/7/10 8:00 PM	0.79	0.18	0.97
5/7/10 11:00 PM	0.57	0.17	0.74
5/8/10 2:00 AM	0.46	0.17	0.63
5/8/10 5:00 AM	0.48	0.19	0.67
5/8/10 8:00 AM	0.66	0.20	0.86
5/8/10 11:00 AM	0.62	0.22	0.83
5/8/10 2:00 PM	0.63	0.21	0.83
5/8/10 5:00 PM	0.81	0.21	1.02

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
5/8/10 8:00 PM	0.81	0.22	1.03
5/8/10 11:00 PM	0.69	0.21	0.90
5/9/10 2:00 AM	0.50	0.18	0.67
5/9/10 5:00 AM	0.48	0.21	0.69
5/9/10 8:00 AM	0.77	0.20	0.97
5/9/10 11:00 AM	0.81	0.20	1.01
5/9/10 2:00 PM	0.78	0.19	0.97
5/9/10 5:00 PM	0.76	0.19	0.95
5/9/10 8:00 PM	0.73	0.18	0.91
5/9/10 11:00 PM	0.58	0.19	0.77
5/10/10 2:00 AM	0.44	0.14	0.57
5/10/10 5:00 AM	0.52	0.14	0.66
5/10/10 8:00 AM	0.67	0.20	0.87
5/10/10 11:00 AM	0.73	0.24	0.97
5/10/10 2:00 PM	0.76	0.23	0.99
5/10/10 5:00 PM	0.72	0.25	0.97
5/10/10 8:00 PM	0.72	0.27	0.99
5/10/10 11:00 PM	0.73	0.28	1.01
5/11/10 2:00 AM	0.61	0.26	0.87
5/11/10 5:00 AM	0.62	0.25	0.88
5/11/10 8:00 AM	0.81	0.25	1.07
5/11/10 11:00 AM	0.83	0.24	1.07
5/11/10 2:00 PM	0.84	0.15	0.99
5/11/10 5:00 PM	0.78	0.15	0.92
5/11/10 8:00 PM	0.74	0.16	0.90
5/11/10 11:00 PM	0.65	0.17	0.82
5/12/10 2:00 AM	0.64	0.16	0.80
5/12/10 5:00 AM	0.36	0.17	0.53
5/12/10 8:00 AM	0.19	0.17	0.36
5/12/10 11:00 AM	0.17	0.17	0.34
5/12/10 2:00 PM	0.22	0.17	0.39
5/12/10 5:00 PM	0.26	0.18	0.44
5/12/10 8:00 PM	0.26	0.18	0.44
5/12/10 11:00 PM	0.21	0.15	0.35
5/13/10 2:00 AM	0.22	0.08	0.29
5/13/10 5:00 AM	0.22	0.10	0.32
5/13/10 8:00 AM	0.23	0.20	0.43
5/13/10 11:00 AM	0.21	0.19	0.40
5/13/10 2:00 PM	0.22	0.19	0.41
5/13/10 5:00 PM	0.29	0.20	0.49
5/13/10 8:00 PM	0.20	0.21	0.41
5/13/10 11:00 PM	0.21	0.16	0.37
5/14/10 2:00 AM	0.22	0.08	0.30
5/14/10 5:00 AM	0.22	0.10	0.32
5/14/10 8:00 AM	0.20	0.24	0.44
5/14/10 11:00 AM	0.20	0.24	0.43
5/14/10 2:00 PM	0.19	0.25	0.44
5/14/10 5:00 PM	0.19	0.23	0.42
5/14/10 8:00 PM	0.20	0.24	0.44
5/14/10 11:00 PM	0.20	0.25	0.45
5/15/10 2:00 AM	0.20	0.25	0.44
5/15/10 5:00 AM	0.20	0.25	0.44
5/15/10 8:00 AM	0.21	0.24	0.45
5/15/10 11:00 AM	0.20	0.24	0.45

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
5/15/10 2:00 PM	0.19	0.25	0.43
5/15/10 5:00 PM	0.20	0.25	0.45
5/15/10 8:00 PM	0.22	0.24	0.46
5/15/10 11:00 PM	0.21	0.22	0.43
5/16/10 2:00 AM	0.21	0.21	0.42
5/16/10 5:00 AM	0.21	0.21	0.42
5/16/10 8:00 AM	0.22	0.21	0.43
5/16/10 11:00 AM	0.20	0.21	0.41
5/16/10 2:00 PM	0.19	0.21	0.40
5/16/10 5:00 PM	0.20	0.21	0.42
5/16/10 8:00 PM	0.49	0.22	0.71
5/16/10 11:00 PM	0.72	0.20	0.92
5/17/10 2:00 AM	0.58	0.19	0.77
5/17/10 5:00 AM	0.76	0.19	0.95
5/17/10 8:00 AM	0.88	0.19	1.07
5/17/10 11:00 AM	0.74	0.21	0.96
5/17/10 2:00 PM	0.66	0.18	0.84
5/17/10 5:00 PM	0.69	0.18	0.87
5/17/10 8:00 PM	0.83	0.18	1.01
5/17/10 11:00 PM	0.79	0.17	0.97
5/18/10 2:00 AM	0.79	0.17	0.96
5/18/10 5:00 AM	0.86	0.17	1.03
5/18/10 8:00 AM	0.85	0.16	1.01
5/18/10 11:00 AM	0.85	0.17	1.03
5/18/10 2:00 PM	0.88	0.18	1.05
5/18/10 5:00 PM	0.83	0.17	1.00
5/18/10 8:00 PM	0.80	0.16	0.96
5/18/10 11:00 PM	0.82	0.07	0.89
5/19/10 2:00 AM	0.50	0.15	0.65
5/19/10 5:00 AM	0.56	0.14	0.70
5/19/10 8:00 AM	0.82	0.15	0.97
5/19/10 11:00 AM	0.76	0.18	0.94
5/19/10 2:00 PM	0.78	0.33	1.11
5/19/10 5:00 PM	0.75	0.33	1.08
5/19/10 8:00 PM	0.85	0.28	1.13
5/19/10 11:00 PM	0.88	0.16	1.04
5/20/10 2:00 AM	0.84	0.31	1.15
5/20/10 5:00 AM	0.87	0.29	1.15
5/20/10 8:00 AM	0.91	0.36	1.27
5/20/10 11:00 AM	0.80	0.20	1.00
5/20/10 2:00 PM	0.77	0.21	0.98
5/20/10 5:00 PM	0.82	0.21	1.03
5/20/10 8:00 PM	0.91	0.23	1.14
5/20/10 11:00 PM	0.94	0.25	1.19
5/21/10 2:00 AM	0.71	0.21	0.92
5/21/10 5:00 AM	0.70	0.20	0.90
5/21/10 8:00 AM	0.85	0.21	1.05
5/21/10 11:00 AM	0.86	0.18	1.03
5/21/10 2:00 PM	0.85	0.16	1.01
5/21/10 5:00 PM	0.83	0.15	0.99
5/21/10 8:00 PM	0.92	0.15	1.07
5/21/10 11:00 PM	0.84	0.16	1.00
5/22/10 2:00 AM	0.73	0.11	0.84
5/22/10 5:00 AM	0.68	0.12	0.80

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
5/22/10 8:00 AM	0.77	0.16	0.93
5/22/10 11:00 AM	0.84	0.18	1.03
5/22/10 2:00 PM	0.80	0.18	0.98
5/22/10 5:00 PM	0.80	0.17	0.98
5/22/10 8:00 PM	0.76	0.16	0.93
5/22/10 11:00 PM	0.73	0.06	0.79
5/23/10 2:00 AM	0.68	0.03	0.71
5/23/10 5:00 AM	0.71	0.03	0.74
5/23/10 8:00 AM	0.72	0.12	0.84
5/23/10 11:00 AM	0.72	0.13	0.85
5/23/10 2:00 PM	0.66	0.13	0.78
5/23/10 5:00 PM	0.74	0.12	0.86
5/23/10 8:00 PM	0.58	0.13	0.71
5/23/10 11:00 PM	0.74	0.13	0.88
5/24/10 2:00 AM	0.59	0.14	0.73
5/24/10 5:00 AM	0.58	0.15	0.73
5/24/10 8:00 AM	0.76	0.14	0.90
5/24/10 11:00 AM	0.64	0.14	0.78
5/24/10 2:00 PM	0.63	0.14	0.76
5/24/10 5:00 PM	0.32	0.14	0.47
5/24/10 8:00 PM	0.21	0.14	0.35
5/24/10 11:00 PM	0.19	0.14	0.33
5/25/10 2:00 AM	0.20	0.14	0.34
5/25/10 5:00 AM	0.19	0.14	0.33
5/25/10 8:00 AM	0.20	0.13	0.33
5/25/10 11:00 AM	0.20	0.13	0.32
5/25/10 2:00 PM	0.15	0.12	0.28
5/25/10 5:00 PM	0.14	0.13	0.28
5/25/10 8:00 PM	0.17	0.13	0.29
5/25/10 11:00 PM	0.17	0.13	0.30
5/26/10 2:00 AM	0.21	0.12	0.33
5/26/10 5:00 AM	0.17	0.12	0.30
5/26/10 8:00 AM	0.17	0.13	0.30
5/26/10 11:00 AM	0.20	0.14	0.34
5/26/10 2:00 PM	0.19	0.12	0.31
5/26/10 5:00 PM	0.19	0.13	0.31
5/26/10 8:00 PM	0.16	0.13	0.29
5/26/10 11:00 PM	0.16	0.14	0.30
5/27/10 2:00 AM	0.16	0.15	0.30
5/27/10 5:00 AM	0.15	0.15	0.30
5/27/10 8:00 AM	0.16	0.15	0.30
5/27/10 11:00 AM	0.15	0.15	0.30
5/27/10 2:00 PM	0.15	0.15	0.30
5/27/10 5:00 PM	0.14	0.15	0.29
5/27/10 8:00 PM	0.13	0.16	0.29
5/27/10 11:00 PM	0.14	0.15	0.29
5/28/10 2:00 AM	0.13	0.15	0.28
5/28/10 5:00 AM	0.13	0.15	0.28
5/28/10 8:00 AM	0.14	0.16	0.29
5/28/10 11:00 AM	0.13	0.15	0.28
5/28/10 2:00 PM	0.13	0.17	0.30
5/28/10 5:00 PM	0.13	0.14	0.27
5/28/10 8:00 PM	0.13	0.16	0.29
5/28/10 11:00 PM	0.12	0.17	0.29

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
5/29/10 2:00 AM	0.12	0.17	0.29
5/29/10 5:00 AM	0.12	0.18	0.29
5/29/10 8:00 AM	0.12	0.20	0.32
5/29/10 11:00 AM	0.11	0.22	0.34
5/29/10 2:00 PM	0.11	0.27	0.38
5/29/10 5:00 PM	0.11	0.27	0.39
5/29/10 8:00 PM	0.11	0.25	0.36
5/29/10 11:00 PM	0.11	0.25	0.36
5/30/10 2:00 AM	0.11	0.24	0.35
5/30/10 5:00 AM	0.11	0.23	0.35
5/30/10 8:00 AM	0.11	0.24	0.35
5/30/10 11:00 AM	0.11	0.24	0.35
5/30/10 2:00 PM	0.11	0.23	0.35
5/30/10 5:00 PM	0.11	0.24	0.35
5/30/10 8:00 PM	0.11	0.21	0.32
5/30/10 11:00 PM	0.11	0.18	0.30
5/31/10 2:00 AM	0.12	0.24	0.36
5/31/10 5:00 AM	0.14	0.26	0.40
5/31/10 8:00 AM	0.12	0.26	0.38
5/31/10 11:00 AM	0.12	0.26	0.38
5/31/10 2:00 PM	0.13	0.27	0.40
5/31/10 5:00 PM	0.14	0.27	0.41
5/31/10 8:00 PM	0.14	0.27	0.41
5/31/10 11:00 PM	0.15	0.26	0.41
6/1/10 2:00 AM	0.14	0.25	0.39
6/1/10 5:00 AM	0.19	0.22	0.41
6/1/10 8:00 AM	0.47	0.21	0.69
6/1/10 11:00 AM	0.66	0.18	0.83
6/1/10 2:00 PM	0.82	0.14	0.97
6/1/10 5:00 PM	0.74	0.14	0.88
6/1/10 8:00 PM	0.67	0.13	0.80
6/1/10 11:00 PM	0.65	0.13	0.78
6/2/10 2:00 AM	0.64	0.13	0.76
6/2/10 5:00 AM	0.63	0.12	0.75
6/2/10 8:00 AM	0.60	0.13	0.73
6/2/10 11:00 AM	0.59	0.14	0.73
6/2/10 2:00 PM	0.72	0.15	0.87
6/2/10 5:00 PM	0.22	0.22	0.44
6/2/10 8:00 PM	0.68	0.15	0.83
6/2/10 11:00 PM	0.89	0.10	0.99
6/3/10 2:00 AM	0.87	0.06	0.94
6/3/10 5:00 AM	0.88	0.06	0.94
6/3/10 8:00 AM	0.82	0.17	0.99
6/3/10 11:00 AM	0.75	0.20	0.95
6/3/10 2:00 PM	0.76	0.19	0.95
6/3/10 5:00 PM	0.79	0.18	0.97
6/3/10 8:00 PM	0.76	0.18	0.94
6/3/10 11:00 PM	0.68	0.18	0.86
6/4/10 2:00 AM	0.70	0.17	0.87
6/4/10 5:00 AM	0.71	0.16	0.87
6/4/10 8:00 AM	0.72	0.15	0.87
6/4/10 11:00 AM	0.80	0.16	0.95
6/4/10 2:00 PM	0.81	0.17	0.98
6/4/10 5:00 PM	0.82	0.17	0.99

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
6/4/10 8:00 PM	0.83	0.17	1.00
6/4/10 11:00 PM	0.81	0.16	0.97
6/5/10 2:00 AM	0.80	0.29	1.09
6/5/10 5:00 AM	0.81	0.19	1.01
6/5/10 8:00 AM	0.85	0.18	1.03
6/5/10 11:00 AM	0.80	0.19	0.99
6/5/10 2:00 PM	0.85	0.19	1.05
6/5/10 5:00 PM	0.87	0.20	1.07
6/5/10 8:00 PM	0.87	0.19	1.06
6/5/10 11:00 PM	0.89	0.17	1.06
6/6/10 2:00 AM	0.39	0.16	0.55
6/6/10 5:00 AM	0.34	0.15	0.49
6/6/10 8:00 AM	0.69	0.16	0.85
6/6/10 11:00 AM	0.90	0.18	1.07
6/6/10 2:00 PM	0.89	0.16	1.05
6/6/10 5:00 PM	0.88	0.14	1.02
6/6/10 8:00 PM	0.85	0.13	0.98
6/6/10 11:00 PM	0.87	0.13	1.00
6/7/10 2:00 AM	0.89	0.13	1.02
6/7/10 5:00 AM	0.89	0.13	1.02
6/7/10 8:00 AM	0.91	0.13	1.05
6/7/10 11:00 AM	0.87	0.13	1.00
6/7/10 2:00 PM	0.87	0.15	1.02
6/7/10 5:00 PM	0.86	0.16	1.02
6/7/10 8:00 PM	0.85	0.15	1.00
6/7/10 11:00 PM	0.86	0.15	1.02
6/8/10 2:00 AM	0.84	0.14	0.98
6/8/10 5:00 AM	0.87	0.12	0.99
6/8/10 8:00 AM	0.94	0.13	1.08
6/8/10 11:00 AM	1.03	0.15	1.18
6/8/10 2:00 PM	0.97	0.15	1.12
6/8/10 5:00 PM	1.06	0.15	1.21
6/8/10 8:00 PM	0.95	0.16	1.11
6/8/10 11:00 PM	0.93	0.17	1.09
6/9/10 2:00 AM	0.92	0.16	1.08
6/9/10 5:00 AM	0.90	0.13	1.04
6/9/10 8:00 AM	0.56	0.15	0.71
6/9/10 11:00 AM	0.24	1.74	1.98
6/9/10 2:00 PM	0.18	0.22	0.40
6/9/10 5:00 PM	0.20	0.20	0.40
6/9/10 8:00 PM	0.17	0.20	0.37
6/9/10 11:00 PM	0.14	0.18	0.33
6/10/10 2:00 AM	0.19	0.18	0.37
6/10/10 5:00 AM	0.20	0.17	0.37
6/10/10 8:00 AM	0.20	0.17	0.37
6/10/10 11:00 AM	0.19	0.18	0.37
6/10/10 2:00 PM	0.22	0.20	0.42
6/10/10 5:00 PM	0.23	0.20	0.42
6/10/10 8:00 PM	0.24	0.17	0.41
6/10/10 11:00 PM	0.24	0.16	0.40
6/11/10 2:00 AM	0.24	0.13	0.38
6/11/10 5:00 AM	0.25	0.12	0.37
6/11/10 8:00 AM	0.26	0.18	0.44
6/11/10 11:00 AM	0.27	0.18	0.45

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
6/11/10 2:00 PM	0.25	0.18	0.44
6/11/10 5:00 PM	0.26	0.18	0.44
6/11/10 8:00 PM	0.26	0.17	0.44
6/11/10 11:00 PM	0.25	0.17	0.42
6/12/10 2:00 AM	0.24	0.16	0.40
6/12/10 5:00 AM	0.22	0.15	0.37
6/12/10 8:00 AM	0.21	0.16	0.37
6/12/10 11:00 AM	0.21	0.15	0.36
6/12/10 2:00 PM	0.22	0.15	0.37
6/12/10 5:00 PM	0.22	0.16	0.38
6/12/10 8:00 PM	0.20	0.18	0.38
6/12/10 11:00 PM	0.20	0.19	0.39
6/13/10 2:00 AM	0.18	0.22	0.40
6/13/10 5:00 AM	0.19	0.20	0.39
6/13/10 8:00 AM	0.20	0.19	0.39
6/13/10 11:00 AM	0.21	0.18	0.39
6/13/10 2:00 PM	0.21	0.22	0.42
6/13/10 5:00 PM	0.21	0.24	0.45
6/13/10 8:00 PM	0.22	0.29	0.51
6/13/10 11:00 PM	0.22	0.28	0.51
6/14/10 2:00 AM	0.23	0.41	0.64
6/14/10 5:00 AM	0.23	0.46	0.69
6/14/10 8:00 AM	0.23	0.53	0.76
6/14/10 11:00 AM	0.22	0.61	0.82
6/14/10 2:00 PM	0.38	0.62	1.00
6/14/10 5:00 PM	0.22	0.59	0.81
6/14/10 8:00 PM	0.22	0.31	0.53
6/14/10 11:00 PM	0.22	0.27	0.50
6/15/10 2:00 AM	0.30	0.20	0.51
6/15/10 5:00 AM	0.31	0.19	0.51
6/15/10 8:00 AM	0.32	0.18	0.50
6/15/10 11:00 AM	0.38	0.17	0.55
6/15/10 2:00 PM	0.57	0.17	0.74
6/15/10 5:00 PM	0.60	0.16	0.75
6/15/10 8:00 PM	0.38	0.15	0.53
6/15/10 11:00 PM	0.60	0.14	0.74
6/16/10 2:00 AM	0.74	0.13	0.87
6/16/10 5:00 AM	0.63	0.14	0.76
6/16/10 8:00 AM	0.81	0.14	0.96
6/16/10 11:00 AM	0.88	0.15	1.03
6/16/10 2:00 PM	0.69	0.15	0.84
6/16/10 5:00 PM	0.86	0.14	1.00
6/16/10 8:00 PM	0.85	0.12	0.97
6/16/10 11:00 PM	0.72	0.10	0.82
6/17/10 2:00 AM	0.82	0.12	0.94
6/17/10 5:00 AM	0.77	0.12	0.89
6/17/10 8:00 AM	0.55	0.12	0.67
6/17/10 11:00 AM	0.80	0.13	0.93
6/17/10 2:00 PM	0.82	0.12	0.95
6/17/10 5:00 PM	0.84	0.12	0.95
6/17/10 8:00 PM	0.81	0.13	0.94
6/17/10 11:00 PM	0.72	0.15	0.87
6/18/10 2:00 AM	0.76	0.14	0.90
6/18/10 5:00 AM	0.53	0.09	0.62

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
6/18/10 8:00 AM	0.83	0.15	0.98
6/18/10 11:00 AM	0.96	0.14	1.10
6/18/10 2:00 PM	0.95	0.14	1.09
6/18/10 5:00 PM	0.89	0.14	1.03
6/18/10 8:00 PM	0.91	0.14	1.05
6/18/10 11:00 PM	0.92	0.15	1.07
6/19/10 2:00 AM	0.97	0.15	1.12
6/19/10 5:00 AM	0.92	0.15	1.06
6/19/10 8:00 AM	1.01	0.16	1.17
6/19/10 11:00 AM	0.96	0.17	1.13
6/19/10 2:00 PM	0.95	0.15	1.09
6/19/10 5:00 PM	0.96	0.17	1.13
6/19/10 8:00 PM	0.96	0.17	1.13
6/19/10 11:00 PM	0.95	0.18	1.13
6/20/10 2:00 AM	0.94	0.19	1.13
6/20/10 5:00 AM	0.89	0.20	1.09
6/20/10 8:00 AM	0.94	0.21	1.15
6/20/10 11:00 AM	0.95	0.22	1.17
6/20/10 2:00 PM	0.93	0.21	1.14
6/20/10 5:00 PM	0.91	0.24	1.16
6/20/10 8:00 PM	0.90	0.26	1.16
6/20/10 11:00 PM	0.87	0.10	0.97
6/21/10 2:00 AM	0.90	0.05	0.95
6/21/10 5:00 AM	1.07	0.11	1.18
6/21/10 8:00 AM	1.07	0.25	1.33
6/21/10 11:00 AM	1.10	0.25	1.35
6/21/10 2:00 PM	0.96	0.22	1.18
6/21/10 5:00 PM	0.98	0.27	1.25
6/21/10 8:00 PM	0.96	0.24	1.20
6/21/10 11:00 PM	0.96	0.09	1.05
6/22/10 2:00 AM	0.95	0.03	0.99
6/22/10 5:00 AM	0.92	0.05	0.97
6/22/10 8:00 AM	0.90	0.04	0.94
6/22/10 11:00 AM	0.89	0.03	0.93
6/22/10 2:00 PM	0.90	0.04	0.94
6/22/10 5:00 PM	0.90	0.13	1.03
6/22/10 8:00 PM	0.91	0.12	1.03
6/22/10 11:00 PM	0.90	0.07	0.97
6/23/10 2:00 AM	0.89	0.03	0.92
6/23/10 5:00 AM	0.86	0.04	0.90
6/23/10 8:00 AM	0.85	0.11	0.96
6/23/10 11:00 AM	0.79	0.12	0.91
6/23/10 2:00 PM	0.74	0.13	0.88
6/23/10 5:00 PM	0.81	0.15	0.96
6/23/10 8:00 PM	0.78	0.07	0.86
6/23/10 11:00 PM	0.64	0.09	0.73
6/24/10 2:00 AM	0.43	0.13	0.56
6/24/10 5:00 AM	0.46	0.13	0.59
6/24/10 8:00 AM	0.47	0.19	0.66
6/24/10 11:00 AM	0.45	0.19	0.64
6/24/10 2:00 PM	0.44	0.21	0.64
6/24/10 5:00 PM	0.43	0.73	1.16
6/24/10 8:00 PM	0.55	0.25	0.79
6/24/10 11:00 PM	0.78	0.25	1.04

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
6/25/10 2:00 AM	0.77	0.21	0.98
6/25/10 5:00 AM	0.76	0.23	0.99
6/25/10 8:00 AM	0.75	0.31	1.06
6/25/10 11:00 AM	0.75	0.33	1.09
6/25/10 2:00 PM	0.75	0.36	1.10
6/25/10 5:00 PM	0.76	0.43	1.19
6/25/10 8:00 PM	0.77	0.44	1.21
6/25/10 11:00 PM	0.77	0.45	1.22
6/26/10 2:00 AM	0.77	0.52	1.29
6/26/10 5:00 AM	0.76	0.51	1.27
6/26/10 8:00 AM	0.80	0.43	1.23
6/26/10 11:00 AM	0.79	0.40	1.19
6/26/10 2:00 PM	0.78	1.16	1.94
6/26/10 5:00 PM	0.77	0.29	1.06
6/26/10 8:00 PM	0.75	0.17	0.92
6/26/10 11:00 PM	0.74	0.32	1.07
6/27/10 2:00 AM	0.74	0.28	1.02
6/27/10 5:00 AM	0.74	0.21	0.94
6/27/10 8:00 AM	0.79	0.18	0.97
6/27/10 11:00 AM	0.74	0.19	0.93
6/27/10 2:00 PM	0.70	0.19	0.90
6/27/10 5:00 PM	0.71	0.18	0.88
6/27/10 8:00 PM	0.70	0.16	0.86
6/27/10 11:00 PM	0.73	0.10	0.82
6/28/10 2:00 AM	0.71	0.08	0.79
6/28/10 5:00 AM	0.71	0.06	0.77
6/28/10 8:00 AM	0.75	0.03	0.78
6/28/10 11:00 AM	0.68	0.13	0.81
6/28/10 2:00 PM	0.72	0.17	0.89
6/28/10 5:00 PM	0.74	0.14	0.87
6/28/10 8:00 PM	0.73	0.16	0.89
6/28/10 11:00 PM	0.75	0.08	0.83
6/29/10 2:00 AM	0.74	0.08	0.82
6/29/10 5:00 AM	0.72	0.11	0.82
6/29/10 8:00 AM	0.74	0.19	0.93
6/29/10 11:00 AM	0.74	0.17	0.92
6/29/10 2:00 PM	0.75	0.16	0.91
6/29/10 5:00 PM	0.75	0.15	0.90
6/29/10 8:00 PM	0.73	0.15	0.88
6/29/10 11:00 PM	0.38	0.13	0.51
6/30/10 2:00 AM	0.23	0.13	0.36
6/30/10 5:00 AM	0.25	0.15	0.40
6/30/10 8:00 AM	0.23	0.17	0.40
6/30/10 11:00 AM	0.18	0.37	0.55
6/30/10 2:00 PM	0.13	0.39	0.53
6/30/10 5:00 PM	0.14	0.41	0.55
6/30/10 8:00 PM	0.14	0.43	0.57
6/30/10 11:00 PM	0.14	0.47	0.61
7/1/10 2:00 AM	0.12	0.49	0.61
7/1/10 5:00 AM	0.12	0.48	0.60
7/1/10 8:00 AM	0.14	0.48	0.62
7/1/10 11:00 AM	0.13	0.48	0.61
7/1/10 2:00 PM	0.13	0.32	0.45
7/1/10 5:00 PM	0.13	0.26	0.39

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
7/1/10 8:00 PM	0.21	0.23	0.44
7/1/10 11:00 PM	0.21	0.20	0.40
7/2/10 2:00 AM	0.23	0.22	0.45
7/2/10 5:00 AM	0.29	0.21	0.50
7/2/10 8:00 AM	0.55	0.24	0.79
7/2/10 11:00 AM	0.57	0.28	0.85
7/2/10 2:00 PM	0.58	0.35	0.93
7/2/10 5:00 PM	0.75	0.27	1.02
7/2/10 8:00 PM	0.78	0.25	1.03
7/2/10 11:00 PM	0.79	0.10	0.89
7/3/10 2:00 AM	0.58	0.07	0.65
7/3/10 5:00 AM	0.45	0.09	0.55
7/3/10 8:00 AM	0.62	0.21	0.83
7/3/10 11:00 AM	0.90	0.28	1.18
7/3/10 2:00 PM	0.93	0.31	1.24
7/3/10 5:00 PM	0.95	0.27	1.22
7/3/10 8:00 PM	0.91	0.27	1.18
7/3/10 11:00 PM	0.70	0.23	0.93
7/4/10 2:00 AM	0.39	0.19	0.58
7/4/10 5:00 AM	0.29	0.10	0.39
7/4/10 8:00 AM	0.32	0.15	0.47
7/4/10 11:00 AM	0.73	0.19	0.92
7/4/10 2:00 PM	0.90	0.19	1.10
7/4/10 5:00 PM	0.92	0.21	1.13
7/4/10 8:00 PM	0.87	0.21	1.09
7/4/10 11:00 PM	0.72	0.14	0.86
7/5/10 2:00 AM	0.54	0.09	0.62
7/5/10 5:00 AM	0.50	0.08	0.58
7/5/10 8:00 AM	0.95	0.19	1.14
7/5/10 11:00 AM	0.93	0.16	1.10
7/5/10 2:00 PM	0.91	0.16	1.07
7/5/10 5:00 PM	0.87	0.16	1.03
7/5/10 8:00 PM	0.95	0.17	1.12
7/5/10 11:00 PM	0.97	0.17	1.14
7/6/10 2:00 AM	0.60	0.18	0.78
7/6/10 5:00 AM	0.67	0.18	0.85
7/6/10 8:00 AM	0.93	0.19	1.13
7/6/10 11:00 AM	0.93	0.19	1.12
7/6/10 2:00 PM	0.94	0.34	1.27
7/6/10 5:00 PM	0.88	0.21	1.10
7/6/10 8:00 PM	0.86	0.20	1.06
7/6/10 11:00 PM	0.76	0.22	0.99
7/7/10 2:00 AM	0.72	0.22	0.94
7/7/10 5:00 AM	0.35	0.15	0.50
7/7/10 8:00 AM	0.27	0.11	0.38
7/7/10 11:00 AM	0.17	0.11	0.28
7/7/10 2:00 PM	0.09	0.08	0.17
7/7/10 5:00 PM	0.13	0.08	0.21
7/7/10 8:00 PM	0.20	0.11	0.31
7/7/10 11:00 PM	0.30	0.11	0.41
7/8/10 2:00 AM	0.35	0.11	0.46
7/8/10 5:00 AM	0.40	0.10	0.50
7/8/10 8:00 AM	0.54	0.10	0.64
7/8/10 11:00 AM	0.52	0.09	0.61

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
7/8/10 2:00 PM	0.51	0.08	0.59
7/8/10 5:00 PM	0.51	0.07	0.59
7/8/10 8:00 PM	0.51	0.08	0.59
7/8/10 11:00 PM	0.55	0.06	0.61
7/9/10 2:00 AM	0.57	0.06	0.63
7/9/10 5:00 AM	0.60	0.07	0.67
7/9/10 8:00 AM	0.64	0.07	0.71
7/9/10 11:00 AM	0.68	0.07	0.75
7/9/10 2:00 PM	0.59	0.07	0.66
7/9/10 5:00 PM	0.59	0.08	0.67
7/9/10 8:00 PM	0.61	0.08	0.69
7/9/10 11:00 PM	0.91	0.08	0.99
7/10/10 2:00 AM	1.06	0.08	1.14
7/10/10 5:00 AM	1.07	0.08	1.15
7/10/10 8:00 AM	1.09	0.08	1.17
7/10/10 11:00 AM	1.06	0.08	1.15
7/10/10 2:00 PM	1.05	0.09	1.14
7/10/10 5:00 PM	1.01	0.09	1.10
7/10/10 8:00 PM	0.99	0.09	1.08
7/10/10 11:00 PM	0.96	0.09	1.06
7/11/10 2:00 AM	0.97	0.09	1.06
7/11/10 5:00 AM	0.80	0.09	0.89
7/11/10 8:00 AM	0.90	0.09	0.99
7/11/10 11:00 AM	0.97	0.10	1.07
7/11/10 2:00 PM	0.98	0.11	1.08
7/11/10 5:00 PM	0.92	0.12	1.04
7/11/10 8:00 PM	0.76	0.12	0.88
7/11/10 11:00 PM	0.84	0.14	0.97
7/12/10 2:00 AM	0.64	0.14	0.77
7/12/10 5:00 AM	0.68	0.13	0.81
7/12/10 8:00 AM	0.89	0.14	1.03
7/12/10 11:00 AM	0.91	0.13	1.04
7/12/10 2:00 PM	0.93	0.16	1.08
7/12/10 5:00 PM	0.89	0.15	1.05
7/12/10 8:00 PM	0.89	0.14	1.03
7/12/10 11:00 PM	0.73	0.14	0.87
7/13/10 2:00 AM	0.47	0.15	0.61
7/13/10 5:00 AM	0.56	0.18	0.73
7/13/10 8:00 AM	0.85	0.14	0.99
7/13/10 11:00 AM	0.82	0.16	0.97
7/13/10 2:00 PM	0.81	0.16	0.97
7/13/10 5:00 PM	0.79	0.17	0.96
7/13/10 8:00 PM	0.77	0.19	0.96
7/13/10 11:00 PM	0.76	0.26	1.02
7/14/10 2:00 AM	0.43	0.31	0.74
7/14/10 5:00 AM	0.53	0.24	0.77
7/14/10 8:00 AM	0.82	0.22	1.05
7/14/10 11:00 AM	0.81	0.23	1.04
7/14/10 2:00 PM	0.84	0.26	1.10
7/14/10 5:00 PM	0.83	0.29	1.12
7/14/10 8:00 PM	0.82	0.37	1.20
7/14/10 11:00 PM	0.80	0.34	1.15
7/15/10 2:00 AM	0.61	0.27	0.88
7/15/10 5:00 AM	0.56	0.23	0.79

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
7/15/10 8:00 AM	0.76	0.22	0.98
7/15/10 11:00 AM	0.87	0.20	1.06
7/15/10 2:00 PM	0.86	0.18	1.04
7/15/10 5:00 PM	0.84	0.15	0.99
7/15/10 8:00 PM	0.84	0.13	0.98
7/15/10 11:00 PM	0.75	0.12	0.87
7/16/10 2:00 AM	0.46	0.09	0.54
7/16/10 5:00 AM	0.74	0.12	0.86
7/16/10 8:00 AM	0.88	0.13	1.01
7/16/10 11:00 AM	0.88	0.15	1.03
7/16/10 2:00 PM	0.88	0.15	1.03
7/16/10 5:00 PM	0.89	0.17	1.06
7/16/10 8:00 PM	0.90	0.25	1.16
7/16/10 11:00 PM	0.92	0.09	1.01
7/17/10 2:00 AM	0.87	0.08	0.95
7/17/10 5:00 AM	0.80	0.06	0.86
7/17/10 8:00 AM	0.86	0.10	0.96
7/17/10 11:00 AM	0.85	0.22	1.06
7/17/10 2:00 PM	0.84	0.16	1.00
7/17/10 5:00 PM	0.84	0.36	1.20
7/17/10 8:00 PM	0.84	0.40	1.24
7/17/10 11:00 PM	0.86	0.20	1.06
7/18/10 2:00 AM	0.87	0.15	1.02
7/18/10 5:00 AM	0.55	0.10	0.65
7/18/10 8:00 AM	0.72	0.11	0.83
7/18/10 11:00 AM	0.88	0.14	1.02
7/18/10 2:00 PM	0.88	0.12	1.01
7/18/10 5:00 PM	0.88	0.11	0.99
7/18/10 8:00 PM	0.87	0.11	0.98
7/18/10 11:00 PM	0.87	0.10	0.96
7/19/10 2:00 AM	0.86	0.01	0.87
7/19/10 5:00 AM	0.86	0.02	0.88
7/19/10 8:00 AM	0.89	0.02	0.91
7/19/10 11:00 AM	0.90	0.05	0.94
7/19/10 2:00 PM	0.91	0.03	0.94
7/19/10 5:00 PM	0.89	0.01	0.91
7/19/10 8:00 PM	0.87	0.01	0.88
7/19/10 11:00 PM	0.86	0.01	0.88
7/20/10 2:00 AM	0.82	0.05	0.86
7/20/10 5:00 AM	0.79	0.07	0.85
7/20/10 8:00 AM	0.80	0.13	0.93
7/20/10 11:00 AM	0.78	0.14	0.93
7/20/10 2:00 PM	0.76	0.20	0.96
7/20/10 5:00 PM	0.74	0.16	0.90
7/20/10 8:00 PM	0.74	0.15	0.88
7/20/10 11:00 PM	0.61	0.14	0.75
7/21/10 2:00 AM	0.33	0.17	0.50
7/21/10 5:00 AM	0.27	0.36	0.63
7/21/10 8:00 AM	0.34	0.37	0.71
7/21/10 11:00 AM	0.55	0.38	0.93
7/21/10 2:00 PM	0.72	0.40	1.11
7/21/10 5:00 PM	0.68	0.41	1.09
7/21/10 8:00 PM	0.65	0.40	1.05
7/21/10 11:00 PM	0.61	0.43	1.04

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
7/22/10 2:00 AM	0.60	0.43	1.04
7/22/10 5:00 AM	0.40	0.46	0.86
7/22/10 8:00 AM	0.41	0.46	0.87
7/22/10 11:00 AM	0.34	0.52	0.87
7/22/10 2:00 PM	0.29	0.24	0.54
7/22/10 5:00 PM	0.33	0.16	0.49
7/22/10 8:00 PM	0.62	0.16	0.78
7/22/10 11:00 PM	0.38	0.16	0.54
7/23/10 2:00 AM	0.22	0.16	0.38
7/23/10 5:00 AM	0.36	0.17	0.52
7/23/10 8:00 AM	0.74	0.17	0.91
7/23/10 11:00 AM	0.77	0.16	0.92
7/23/10 2:00 PM	0.78	0.13	0.91
7/23/10 5:00 PM	0.79	0.11	0.90
7/23/10 8:00 PM	0.80	0.12	0.92
7/23/10 11:00 PM	0.79	0.13	0.91
7/24/10 2:00 AM	0.79	0.12	0.91
7/24/10 5:00 AM	0.79	0.12	0.91
7/24/10 8:00 AM	0.79	0.12	0.91
7/24/10 11:00 AM	0.77	0.13	0.90
7/24/10 2:00 PM	0.75	0.13	0.88
7/24/10 5:00 PM	0.76	0.12	0.88
7/24/10 8:00 PM	0.28	0.12	0.40
7/24/10 11:00 PM	0.74	0.07	0.81
7/25/10 2:00 AM	0.72	0.04	0.76
7/25/10 5:00 AM	0.57	0.04	0.61
7/25/10 8:00 AM	0.63	0.06	0.69
7/25/10 11:00 AM	0.74	0.13	0.87
7/25/10 2:00 PM	0.74	0.15	0.89
7/25/10 5:00 PM	0.74	0.16	0.90
7/25/10 8:00 PM	0.74	0.15	0.89
7/25/10 11:00 PM	0.72	0.07	0.79
7/26/10 2:00 AM	0.71	0.05	0.76
7/26/10 5:00 AM	0.74	0.05	0.79
7/26/10 8:00 AM	0.76	0.11	0.86
7/26/10 11:00 AM	0.74	0.13	0.87
7/26/10 2:00 PM	0.74	0.14	0.88
7/26/10 5:00 PM	0.74	0.12	0.86
7/26/10 8:00 PM	0.75	0.11	0.87
7/26/10 11:00 PM	0.42	0.12	0.54
7/27/10 2:00 AM	0.32	0.12	0.44
7/27/10 5:00 AM	0.32	0.11	0.44
7/27/10 8:00 AM	0.54	0.14	0.69
7/27/10 11:00 AM	0.68	0.16	0.84
7/27/10 2:00 PM	0.69	0.15	0.84
7/27/10 5:00 PM	0.67	0.16	0.84
7/27/10 8:00 PM	0.67	0.15	0.82
7/27/10 11:00 PM	0.68	0.06	0.74
7/28/10 2:00 AM	0.69	0.05	0.74
7/28/10 5:00 AM	0.71	0.06	0.77
7/28/10 8:00 AM	0.74	0.13	0.87
7/28/10 11:00 AM	0.73	0.14	0.87
7/28/10 2:00 PM	0.71	0.15	0.86
7/28/10 5:00 PM	0.72	0.16	0.88

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
7/28/10 8:00 PM	0.73	0.14	0.87
7/28/10 11:00 PM	0.47	0.14	0.60
7/29/10 2:00 AM	0.44	0.14	0.58
7/29/10 5:00 AM	0.48	0.14	0.62
7/29/10 8:00 AM	0.71	0.15	0.86
7/29/10 11:00 AM	0.90	0.17	1.07
7/29/10 2:00 PM	0.89	0.28	1.17
7/29/10 5:00 PM	0.90	0.27	1.17
7/29/10 8:00 PM	0.82	0.16	0.98
7/29/10 11:00 PM	0.82	0.14	0.95
7/30/10 2:00 AM	0.83	0.08	0.91
7/30/10 5:00 AM	0.84	0.08	0.92
7/30/10 8:00 AM	0.84	0.10	0.94
7/30/10 11:00 AM	0.83	0.11	0.94
7/30/10 2:00 PM	0.84	0.08	0.92
7/30/10 5:00 PM	0.85	0.07	0.92
7/30/10 8:00 PM	1.01	0.07	1.08
7/30/10 11:00 PM	1.04	0.07	1.11
7/31/10 2:00 AM	0.80	0.07	0.87
7/31/10 5:00 AM	0.83	0.07	0.90
7/31/10 8:00 AM	0.89	0.08	0.97
7/31/10 11:00 AM	0.87	0.08	0.95
7/31/10 2:00 PM	0.85	0.07	0.93
7/31/10 5:00 PM	0.85	0.07	0.92
7/31/10 8:00 PM	0.84	0.06	0.90
7/31/10 11:00 PM	0.86	0.11	0.96
8/1/10 2:00 AM	0.87	0.17	1.04
8/1/10 5:00 AM	0.84	0.03	0.88
8/1/10 8:00 AM	0.84	0.03	0.87
8/1/10 11:00 AM	0.83	0.04	0.87
8/1/10 2:00 PM	0.82	0.04	0.86
8/1/10 5:00 PM	0.83	0.05	0.88
8/1/10 8:00 PM	0.83	0.20	1.03
8/1/10 11:00 PM	0.85	0.06	0.92
8/2/10 2:00 AM	0.86	0.08	0.94
8/2/10 5:00 AM	0.86	0.09	0.95
8/2/10 8:00 AM	0.88	0.10	0.98
8/2/10 11:00 AM	0.87	0.05	0.92
8/2/10 2:00 PM	0.89	0.05	0.94
8/2/10 5:00 PM	0.90	0.06	0.96
8/2/10 8:00 PM	0.89	0.05	0.95
8/2/10 11:00 PM	0.90	0.00	0.90
8/3/10 2:00 AM	0.84	0.00	0.84
8/3/10 5:00 AM	0.82	0.00	0.82
8/3/10 8:00 AM	0.82	0.00	0.82
8/3/10 11:00 AM	0.81	0.00	0.81
8/3/10 2:00 PM	0.82	0.00	0.82
8/3/10 5:00 PM	0.83	0.00	0.83
8/3/10 8:00 PM	0.79	0.00	0.79
8/3/10 11:00 PM	0.57	0.00	0.57
8/4/10 2:00 AM	0.39	0.00	0.39
8/4/10 5:00 AM	0.52	0.00	0.52
8/4/10 8:00 AM	0.89	0.00	0.89
8/4/10 11:00 AM	0.88	0.00	0.88

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
8/4/10 2:00 PM	0.88	0.00	0.88
8/4/10 5:00 PM	0.84	0.00	0.84
8/4/10 8:00 PM	0.87	0.00	0.87
8/4/10 11:00 PM	0.88	0.00	0.88
8/5/10 2:00 AM	0.85	0.00	0.85
8/5/10 5:00 AM	0.85	0.00	0.85
8/5/10 8:00 AM	0.85	0.00	0.85
8/5/10 11:00 AM	0.89	0.00	0.89
8/5/10 2:00 PM	0.89	0.00	0.89
8/5/10 5:00 PM	0.88	0.00	0.88
8/5/10 8:00 PM	0.89	0.00	0.89
8/5/10 11:00 PM	0.90	0.00	0.90
8/6/10 2:00 AM	0.88	0.00	0.88
8/6/10 5:00 AM	0.87	0.00	0.87
8/6/10 8:00 AM	0.88	0.00	0.88
8/6/10 11:00 AM	0.88	0.00	0.88
8/6/10 2:00 PM	0.85	0.00	0.85
8/6/10 5:00 PM	0.85	0.00	0.85
8/6/10 8:00 PM	0.85	0.00	0.85
8/6/10 11:00 PM	0.85	0.00	0.85
8/7/10 2:00 AM	0.86	0.00	0.86
8/7/10 5:00 AM	0.86	0.00	0.86
8/7/10 8:00 AM	0.87	0.00	0.87
8/7/10 11:00 AM	0.87	0.02	0.89
8/7/10 2:00 PM	0.87	0.14	1.01
8/7/10 5:00 PM	0.86	0.25	1.11
8/7/10 8:00 PM	0.86	0.28	1.14
8/7/10 11:00 PM	0.87	0.47	1.34
8/8/10 2:00 AM	0.88	0.40	1.28
8/8/10 5:00 AM	0.86	0.47	1.33
8/8/10 8:00 AM	0.87	0.42	1.29
8/8/10 11:00 AM	0.87	0.38	1.24
8/8/10 2:00 PM	0.84	0.25	1.10
8/8/10 5:00 PM	0.83	0.19	1.02
8/8/10 8:00 PM	0.91	0.16	1.08
8/8/10 11:00 PM	0.90	0.17	1.07
8/9/10 2:00 AM	1.00	0.18	1.18
8/9/10 5:00 AM	0.82	0.16	0.98
8/9/10 8:00 AM	0.84	0.14	0.99
8/9/10 11:00 AM	0.84	0.13	0.97
8/9/10 2:00 PM	0.87	0.13	1.00
8/9/10 5:00 PM	0.85	0.13	0.98
8/9/10 8:00 PM	0.84	0.12	0.96
8/9/10 11:00 PM	0.85	0.12	0.97
8/10/10 2:00 AM	0.83	0.13	0.97
8/10/10 5:00 AM	0.83	0.14	0.97
8/10/10 8:00 AM	0.84	0.13	0.98
8/10/10 11:00 AM	0.89	0.13	1.02
8/10/10 2:00 PM	0.86	0.13	0.99
8/10/10 5:00 PM	0.86	0.13	0.99
8/10/10 8:00 PM	0.85	0.14	0.99
8/10/10 11:00 PM	0.84	0.16	1.00
8/11/10 2:00 AM	0.86	0.18	1.03
8/11/10 5:00 AM	0.86	0.19	1.05

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
8/11/10 8:00 AM	0.88	0.21	1.10
8/11/10 11:00 AM	0.86	0.24	1.10
8/11/10 2:00 PM	0.83	0.30	1.14
8/11/10 5:00 PM	0.84	0.25	1.09
8/11/10 8:00 PM	0.85	0.16	1.01
8/11/10 11:00 PM	0.82	0.17	0.99
8/12/10 2:00 AM	0.80	0.23	1.04
8/12/10 5:00 AM	0.81	0.28	1.09
8/12/10 8:00 AM	0.84	0.25	1.09
8/12/10 11:00 AM	0.86	0.30	1.16
8/12/10 2:00 PM	0.87	0.37	1.23
8/12/10 5:00 PM	0.87	0.48	1.35
8/12/10 8:00 PM	0.87	0.39	1.26
8/12/10 11:00 PM	0.85	0.34	1.19
8/13/10 2:00 AM	0.73	0.36	1.09
8/13/10 5:00 AM	0.42	0.38	0.80
8/13/10 8:00 AM	0.45	0.36	0.82
8/13/10 11:00 AM	0.71	0.38	1.10
8/13/10 2:00 PM	0.82	0.45	1.27
8/13/10 5:00 PM	0.82	0.41	1.22
8/13/10 8:00 PM	0.84	0.44	1.28
8/13/10 11:00 PM	0.81	0.31	1.13
8/14/10 2:00 AM	0.82	0.14	0.96
8/14/10 5:00 AM	0.82	0.26	1.08
8/14/10 8:00 AM	0.84	0.31	1.15
8/14/10 11:00 AM	0.83	0.45	1.27
8/14/10 2:00 PM	0.83	0.45	1.27
8/14/10 5:00 PM	0.83	0.38	1.21
8/14/10 8:00 PM	0.84	0.38	1.22
8/14/10 11:00 PM	0.87	0.33	1.20
8/15/10 2:00 AM	0.93	0.28	1.21
8/15/10 5:00 AM	0.96	0.33	1.29
8/15/10 8:00 AM	1.01	0.35	1.36
8/15/10 11:00 AM	0.98	0.39	1.37
8/15/10 2:00 PM	0.97	0.40	1.36
8/15/10 5:00 PM	0.98	0.43	1.41
8/15/10 8:00 PM	0.97	0.30	1.27
8/15/10 11:00 PM	0.98	0.09	1.08
8/16/10 2:00 AM	0.98	0.09	1.08
8/16/10 5:00 AM	1.01	0.12	1.14
8/16/10 8:00 AM	1.04	0.17	1.21
8/16/10 11:00 AM	1.05	0.18	1.23
8/16/10 2:00 PM	1.12	0.20	1.31
8/16/10 5:00 PM	1.08	0.18	1.27
8/16/10 8:00 PM	1.06	0.15	1.21
8/16/10 11:00 PM	1.03	0.05	1.08
8/17/10 2:00 AM	0.99	0.04	1.03
8/17/10 5:00 AM	0.98	0.04	1.01
8/17/10 8:00 AM	0.96	0.18	1.13
8/17/10 11:00 AM	0.93	0.22	1.16
8/17/10 2:00 PM	0.94	0.27	1.21
8/17/10 5:00 PM	0.92	0.26	1.18
8/17/10 8:00 PM	0.94	0.23	1.17
8/17/10 11:00 PM	0.81	0.19	1.00

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
8/18/10 2:00 AM	0.61	0.05	0.67
8/18/10 5:00 AM	0.61	0.05	0.66
8/18/10 8:00 AM	0.81	0.18	0.99
8/18/10 11:00 AM	1.05	0.34	1.39
8/18/10 2:00 PM	1.04	0.25	1.28
8/18/10 5:00 PM	1.00	0.26	1.26
8/18/10 8:00 PM	0.93	0.28	1.21
8/18/10 11:00 PM	0.69	0.24	0.93
8/19/10 2:00 AM	0.47	0.07	0.53
8/19/10 5:00 AM	0.47	0.11	0.58
8/19/10 8:00 AM	0.88	0.26	1.14
8/19/10 11:00 AM	0.91	0.25	1.16
8/19/10 2:00 PM	0.90	0.28	1.18
8/19/10 5:00 PM	0.85	0.29	1.14
8/19/10 8:00 PM	0.77	0.26	1.03
8/19/10 11:00 PM	0.84	0.13	0.97
8/20/10 2:00 AM	0.90	0.08	0.98
8/20/10 5:00 AM	0.86	0.14	1.00
8/20/10 8:00 AM	0.86	0.50	1.36
8/20/10 11:00 AM	0.15	0.52	0.67
8/20/10 2:00 PM	0.13	0.51	0.64
8/20/10 5:00 PM	0.14	0.55	0.69
8/20/10 8:00 PM	0.14	0.39	0.53
8/20/10 11:00 PM	0.16	0.17	0.33
8/21/10 2:00 AM	0.16	0.17	0.33
8/21/10 5:00 AM	0.17	0.18	0.35
8/21/10 8:00 AM	0.17	0.19	0.37
8/21/10 11:00 AM	0.16	0.21	0.37
8/21/10 2:00 PM	0.16	0.22	0.37
8/21/10 5:00 PM	0.15	0.21	0.36
8/21/10 8:00 PM	0.15	0.23	0.38
8/21/10 11:00 PM	0.18	0.23	0.40
8/22/10 2:00 AM	0.35	0.21	0.56
8/22/10 5:00 AM	0.42	0.13	0.55
8/22/10 8:00 AM	0.57	0.16	0.73
8/22/10 11:00 AM	0.89	0.22	1.11
8/22/10 2:00 PM	0.98	0.25	1.23
8/22/10 5:00 PM	0.96	0.26	1.23
8/22/10 8:00 PM	0.91	0.20	1.11
8/22/10 11:00 PM	0.94	0.15	1.09
8/23/10 2:00 AM	0.95	0.18	1.13
8/23/10 5:00 AM	0.93	0.30	1.22
8/23/10 8:00 AM	0.91	0.32	1.24
8/23/10 11:00 AM	0.95	0.20	1.16
8/23/10 2:00 PM	1.01	0.18	1.19
8/23/10 5:00 PM	0.98	0.19	1.17
8/23/10 8:00 PM	0.97	0.16	1.13
8/23/10 11:00 PM	0.59	0.15	0.74
8/24/10 2:00 AM	0.48	0.73	1.21
8/24/10 5:00 AM	0.63	0.83	1.45
8/24/10 8:00 AM	0.97	0.17	1.13
8/24/10 11:00 AM	1.02	0.16	1.18
8/24/10 2:00 PM	1.06	0.15	1.21
8/24/10 5:00 PM	0.97	0.16	1.14

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
8/24/10 8:00 PM	0.97	0.17	1.14
8/24/10 11:00 PM	0.39	0.14	0.53
8/25/10 2:00 AM	0.13	0.16	0.29
8/25/10 5:00 AM	0.15	0.19	0.34
8/25/10 8:00 AM	0.16	0.18	0.34
8/25/10 11:00 AM	0.19	0.18	0.37
8/25/10 2:00 PM	0.21	0.19	0.39
8/25/10 5:00 PM	0.19	0.18	0.36
8/25/10 8:00 PM	0.16	0.17	0.34
8/25/10 11:00 PM	0.14	0.18	0.32
8/26/10 2:00 AM	0.14	0.18	0.32
8/26/10 5:00 AM	0.25	0.17	0.43
8/26/10 8:00 AM	0.40	0.18	0.58
8/26/10 11:00 AM	0.80	0.18	0.97
8/26/10 2:00 PM	0.90	0.18	1.08
8/26/10 5:00 PM	0.81	0.20	1.01
8/26/10 8:00 PM	0.74	0.21	0.95
8/26/10 11:00 PM	0.41	0.19	0.60
8/27/10 2:00 AM	0.41	0.19	0.60
8/27/10 5:00 AM	0.40	0.18	0.58
8/27/10 8:00 AM	0.42	0.17	0.59
8/27/10 11:00 AM	0.42	0.17	0.59
8/27/10 2:00 PM	0.33	0.16	0.50
8/27/10 5:00 PM	0.39	0.15	0.53
8/27/10 8:00 PM	0.33	0.16	0.48
8/27/10 11:00 PM	0.28	0.16	0.44
8/28/10 2:00 AM	0.27	0.10	0.37
8/28/10 5:00 AM	0.23	0.10	0.33
8/28/10 8:00 AM	0.24	0.12	0.36
8/28/10 11:00 AM	0.30	0.18	0.47
8/28/10 2:00 PM	0.30	0.18	0.48
8/28/10 5:00 PM	0.29	0.18	0.48
8/28/10 8:00 PM	0.30	0.17	0.47
8/28/10 11:00 PM	0.30	0.18	0.48
8/29/10 2:00 AM	0.31	0.18	0.48
8/29/10 5:00 AM	0.31	0.17	0.48
8/29/10 8:00 AM	0.30	0.17	0.47
8/29/10 11:00 AM	0.30	0.18	0.48
8/29/10 2:00 PM	0.30	0.18	0.48
8/29/10 5:00 PM	0.30	0.20	0.49
8/29/10 8:00 PM	0.30	0.22	0.52
8/29/10 11:00 PM	0.30	0.21	0.51
8/30/10 2:00 AM	0.30	0.22	0.52
8/30/10 5:00 AM	0.30	0.22	0.52
8/30/10 8:00 AM	0.31	0.22	0.53
8/30/10 11:00 AM	0.32	0.21	0.53
8/30/10 2:00 PM	0.32	0.21	0.53
8/30/10 5:00 PM	0.32	0.22	0.53
8/30/10 8:00 PM	0.31	0.21	0.52
8/30/10 11:00 PM	0.31	0.20	0.51
8/31/10 2:00 AM	0.30	0.20	0.51
8/31/10 5:00 AM	0.30	0.20	0.50
8/31/10 8:00 AM	0.29	0.20	0.49
8/31/10 11:00 AM	0.31	0.17	0.48

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
8/31/10 2:00 PM	0.31	0.15	0.46
8/31/10 5:00 PM	0.33	0.14	0.47
8/31/10 8:00 PM	0.33	0.14	0.47
8/31/10 11:00 PM	0.30	0.14	0.44
9/1/10 2:00 AM	0.15	0.13	0.28
9/1/10 5:00 AM	0.21	0.13	0.34
9/1/10 8:00 AM	0.54	0.13	0.67
9/1/10 11:00 AM	0.55	0.13	0.68
9/1/10 2:00 PM	0.46	0.13	0.58
9/1/10 5:00 PM	0.31	0.12	0.43
9/1/10 8:00 PM	0.29	0.12	0.42
9/1/10 11:00 PM	0.27	0.12	0.39
9/2/10 2:00 AM	0.25	0.08	0.33
9/2/10 5:00 AM	0.28	0.10	0.38
9/2/10 8:00 AM	0.29	0.13	0.42
9/2/10 11:00 AM	0.29	0.13	0.42
9/2/10 2:00 PM	0.29	0.14	0.43
9/2/10 5:00 PM	0.28	0.14	0.42
9/2/10 8:00 PM	0.30	0.13	0.44
9/2/10 11:00 PM	0.32	0.13	0.44
9/3/10 2:00 AM	0.31	0.13	0.44
9/3/10 5:00 AM	0.26	0.13	0.39
9/3/10 8:00 AM	0.25	0.26	0.51
9/3/10 11:00 AM	0.27	0.26	0.53
9/3/10 2:00 PM	0.27	0.18	0.45
9/3/10 5:00 PM	0.25	0.11	0.36
9/3/10 8:00 PM	0.26	0.12	0.39
9/3/10 11:00 PM	0.25	0.07	0.32
9/4/10 2:00 AM	0.24	0.13	0.36
9/4/10 5:00 AM	0.23	0.17	0.40
9/4/10 8:00 AM	0.23	0.23	0.46
9/4/10 11:00 AM	0.24	0.31	0.55
9/4/10 2:00 PM	0.23	0.30	0.53
9/4/10 5:00 PM	0.33	0.31	0.64
9/4/10 8:00 PM	0.37	0.34	0.71
9/4/10 11:00 PM	0.36	0.23	0.59
9/5/10 2:00 AM	0.37	0.17	0.54
9/5/10 5:00 AM	0.37	0.17	0.55
9/5/10 8:00 AM	0.36	0.25	0.61
9/5/10 11:00 AM	0.27	0.38	0.65
9/5/10 2:00 PM	0.27	0.37	0.64
9/5/10 5:00 PM	0.26	0.38	0.64
9/5/10 8:00 PM	0.26	0.36	0.61
9/5/10 11:00 PM	0.26	0.19	0.46
9/6/10 2:00 AM	0.26	0.19	0.45
9/6/10 5:00 AM	0.27	0.21	0.47
9/6/10 8:00 AM	0.26	0.37	0.63
9/6/10 11:00 AM	0.27	0.37	0.65
9/6/10 2:00 PM	0.27	0.40	0.67
9/6/10 5:00 PM	0.26	0.32	0.57
9/6/10 8:00 PM	0.26	0.28	0.54
9/6/10 11:00 PM	0.19	0.29	0.48
9/7/10 2:00 AM	0.14	0.31	0.46
9/7/10 5:00 AM	0.21	0.31	0.52

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
9/7/10 8:00 AM	0.25	0.34	0.59
9/7/10 11:00 AM	0.26	0.20	0.46
9/7/10 2:00 PM	0.26	0.30	0.56
9/7/10 5:00 PM	0.26	0.40	0.66
9/7/10 8:00 PM	0.26	0.41	0.67
9/7/10 11:00 PM	0.27	0.42	0.69
9/8/10 2:00 AM	0.26	0.46	0.73
9/8/10 5:00 AM	0.26	0.48	0.74
9/8/10 8:00 AM	0.26	0.50	0.77
9/8/10 11:00 AM	0.26	0.51	0.77
9/8/10 2:00 PM	0.25	0.51	0.75
9/8/10 5:00 PM	0.25	0.48	0.73
9/8/10 8:00 PM	0.27	0.48	0.74
9/8/10 11:00 PM	0.26	0.46	0.72
9/9/10 2:00 AM	0.25	0.43	0.68
9/9/10 5:00 AM	0.25	0.41	0.66
9/9/10 8:00 AM	0.25	0.42	0.67
9/9/10 11:00 AM	0.29	0.45	0.74
9/9/10 2:00 PM	0.26	0.49	0.75
9/9/10 5:00 PM	0.25	0.40	0.65
9/9/10 8:00 PM	0.25	0.36	0.62
9/9/10 11:00 PM	0.26	0.32	0.58
9/10/10 2:00 AM	0.26	0.30	0.57
9/10/10 5:00 AM	0.27	0.28	0.55
9/10/10 8:00 AM	0.27	0.26	0.53
9/10/10 11:00 AM	0.27	0.26	0.53
9/10/10 2:00 PM	0.42	0.25	0.67
9/10/10 5:00 PM	0.53	0.27	0.80
9/10/10 8:00 PM	0.54	0.28	0.81
9/10/10 11:00 PM	0.52	0.27	0.79
9/11/10 2:00 AM	0.48	0.19	0.67
9/11/10 5:00 AM	0.48	0.20	0.68
9/11/10 8:00 AM	0.50	0.33	0.83
9/11/10 11:00 AM	0.47	0.35	0.82
9/11/10 2:00 PM	0.44	0.36	0.80
9/11/10 5:00 PM	0.46	0.33	0.79
9/11/10 8:00 PM	0.50	0.30	0.80
9/11/10 11:00 PM	0.60	0.29	0.89
9/12/10 2:00 AM	0.93	0.29	1.22
9/12/10 5:00 AM	1.00	0.29	1.29
9/12/10 8:00 AM	0.88	0.28	1.16
9/12/10 11:00 AM	0.93	0.30	1.23
9/12/10 2:00 PM	1.11	0.30	1.41
9/12/10 5:00 PM	1.22	0.29	1.51
9/12/10 8:00 PM	1.19	0.31	1.51
9/12/10 11:00 PM	1.42	0.36	1.78
9/13/10 2:00 AM	1.36	0.34	1.70
9/13/10 5:00 AM	1.33	0.30	1.63
9/13/10 8:00 AM	1.29	0.30	1.59
9/13/10 11:00 AM	1.08	0.31	1.39
9/13/10 2:00 PM	0.80	0.29	1.10
9/13/10 5:00 PM	0.67	0.30	0.97
9/13/10 8:00 PM	0.66	0.31	0.97
9/13/10 11:00 PM	0.35	0.30	0.64

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
9/14/10 2:00 AM	0.20	0.29	0.50
9/14/10 5:00 AM	0.23	0.29	0.52
9/14/10 8:00 AM	0.25	0.30	0.55
9/14/10 11:00 AM	0.24	0.32	0.55
9/14/10 2:00 PM	0.20	0.31	0.51
9/14/10 5:00 PM	0.12	0.30	0.42
9/14/10 8:00 PM	0.12	0.28	0.40
9/14/10 11:00 PM	0.23	0.28	0.51
9/15/10 2:00 AM	0.13	0.26	0.40
9/15/10 5:00 AM	0.13	0.26	0.39
9/15/10 8:00 AM	0.19	0.26	0.46
9/15/10 11:00 AM	0.23	0.27	0.49
9/15/10 2:00 PM	0.25	0.28	0.53
9/15/10 5:00 PM	0.27	0.27	0.54
9/15/10 8:00 PM	0.24	0.27	0.51
9/15/10 11:00 PM	0.27	0.27	0.54
9/16/10 2:00 AM	0.27	0.29	0.56
9/16/10 5:00 AM	0.27	0.23	0.50
9/16/10 8:00 AM	0.27	0.31	0.58
9/16/10 11:00 AM	0.25	0.30	0.55
9/16/10 2:00 PM	0.24	0.31	0.55
9/16/10 5:00 PM	0.23	0.34	0.57
9/16/10 8:00 PM	0.23	0.38	0.62
9/16/10 11:00 PM	0.25	0.39	0.64
9/17/10 2:00 AM	0.26	0.36	0.62
9/17/10 5:00 AM	0.25	0.33	0.58
9/17/10 8:00 AM	0.26	0.32	0.58
9/17/10 11:00 AM	0.25	0.31	0.57
9/17/10 2:00 PM	0.23	0.33	0.56
9/17/10 5:00 PM	0.24	0.32	0.56
9/17/10 8:00 PM	0.27	0.31	0.58
9/17/10 11:00 PM	0.28	0.31	0.59
9/18/10 2:00 AM	0.27	0.30	0.57
9/18/10 5:00 AM	0.26	0.28	0.54
9/18/10 8:00 AM	0.26	0.30	0.56
9/18/10 11:00 AM	0.26	0.30	0.56
9/18/10 2:00 PM	0.26	0.31	0.57
9/18/10 5:00 PM	0.25	0.32	0.57
9/18/10 8:00 PM	0.26	0.34	0.61
9/18/10 11:00 PM	0.27	0.37	0.64
9/19/10 2:00 AM	0.25	0.36	0.61
9/19/10 5:00 AM	0.26	0.37	0.63
9/19/10 8:00 AM	0.27	0.42	0.69
9/19/10 11:00 AM	0.26	0.44	0.70
9/19/10 2:00 PM	0.26	0.46	0.72
9/19/10 5:00 PM	0.26	0.49	0.76
9/19/10 8:00 PM	0.27	0.95	1.22
9/19/10 11:00 PM	0.26	0.33	0.59
9/20/10 2:00 AM	0.31	0.44	0.76
9/20/10 5:00 AM	0.32	0.45	0.77
9/20/10 8:00 AM	0.32	0.44	0.76
9/20/10 11:00 AM	0.32	0.40	0.72
9/20/10 2:00 PM	0.32	0.39	0.71
9/20/10 5:00 PM	0.30	0.40	0.71

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
9/20/10 8:00 PM	0.07	0.38	0.44
9/20/10 11:00 PM	0.07	0.36	0.43
9/21/10 2:00 AM	0.07	0.34	0.41
9/21/10 5:00 AM	0.07	0.33	0.40
9/21/10 8:00 AM	0.06	0.43	0.50
9/21/10 11:00 AM	0.23	0.30	0.53
9/21/10 2:00 PM	0.28	0.31	0.58
9/21/10 5:00 PM	0.28	0.26	0.54
9/21/10 8:00 PM	0.29	0.28	0.57
9/21/10 11:00 PM	0.30	0.27	0.57
9/22/10 2:00 AM	0.29	0.26	0.55
9/22/10 5:00 AM	0.29	0.26	0.55
9/22/10 8:00 AM	0.30	0.46	0.76
9/22/10 11:00 AM	0.29	0.28	0.57
9/22/10 2:00 PM	0.27	0.29	0.57
9/22/10 5:00 PM	0.29	0.28	0.57
9/22/10 8:00 PM	0.29	0.28	0.57
9/22/10 11:00 PM	0.28	0.28	0.57
9/23/10 2:00 AM	0.23	0.28	0.52
9/23/10 5:00 AM	0.18	0.28	0.46
9/23/10 8:00 AM	0.29	0.30	0.59
9/23/10 11:00 AM	0.26	0.31	0.58
9/23/10 2:00 PM	0.26	0.32	0.58
9/23/10 5:00 PM	0.27	0.32	0.59
9/23/10 8:00 PM	0.31	0.31	0.63
9/23/10 11:00 PM	0.32	0.32	0.64
9/24/10 2:00 AM	0.31	0.30	0.61
9/24/10 5:00 AM	0.30	0.30	0.60
9/24/10 8:00 AM	0.31	0.28	0.58
9/24/10 11:00 AM	0.31	0.30	0.61
9/24/10 2:00 PM	0.29	0.27	0.56
9/24/10 5:00 PM	0.31	0.28	0.59
9/24/10 8:00 PM	0.30	0.28	0.58
9/24/10 11:00 PM	0.29	0.27	0.56
9/25/10 2:00 AM	0.29	0.28	0.57
9/25/10 5:00 AM	0.29	0.27	0.56
9/25/10 8:00 AM	0.30	0.28	0.58
9/25/10 11:00 AM	0.28	0.28	0.56
9/25/10 2:00 PM	0.28	0.29	0.57
9/25/10 5:00 PM	0.28	0.31	0.59
9/25/10 8:00 PM	0.27	0.31	0.59
9/25/10 11:00 PM	0.29	0.31	0.60
9/26/10 2:00 AM	0.30	0.29	0.58
9/26/10 5:00 AM	0.29	0.22	0.52
9/26/10 8:00 AM	0.29	0.35	0.64
9/26/10 11:00 AM	0.27	0.27	0.54
9/26/10 2:00 PM	0.24	0.39	0.63
9/26/10 5:00 PM	0.25	0.37	0.62
9/26/10 8:00 PM	0.27	0.33	0.60
9/26/10 11:00 PM	0.28	0.34	0.62
9/27/10 2:00 AM	0.29	0.33	0.62
9/27/10 5:00 AM	0.30	0.33	0.63
9/27/10 8:00 AM	0.30	0.35	0.65
9/27/10 11:00 AM	0.28	0.33	0.62

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
9/27/10 2:00 PM	0.23	0.34	0.57
9/27/10 5:00 PM	0.22	0.32	0.55
9/27/10 8:00 PM	0.21	0.31	0.53
9/27/10 11:00 PM	0.03	0.31	0.34
9/28/10 2:00 AM	0.00	0.33	0.33
9/28/10 5:00 AM	0.00	0.31	0.31
9/28/10 8:00 AM	0.00	0.32	0.32
9/28/10 11:00 AM	0.00	0.30	0.30
9/28/10 2:00 PM	0.00	0.33	0.33
9/28/10 5:00 PM	0.00	0.32	0.32
9/28/10 8:00 PM	0.00	0.32	0.32
9/28/10 11:00 PM	0.00	0.33	0.33
9/29/10 2:00 AM	0.00	0.36	0.36
9/29/10 5:00 AM	0.00	0.34	0.34
9/29/10 8:00 AM	0.00	0.37	0.37
9/29/10 11:00 AM	0.00	0.42	0.42
9/29/10 2:00 PM	0.00	0.42	0.42
9/29/10 5:00 PM	0.00	0.41	0.41
9/29/10 8:00 PM	0.00	0.41	0.41
9/29/10 11:00 PM	0.00	0.42	0.42
9/30/10 2:00 AM	0.00	0.42	0.42
9/30/10 5:00 AM	0.00	0.41	0.41
9/30/10 8:00 AM	0.00	0.46	0.46
9/30/10 11:00 AM	0.00	0.45	0.45
9/30/10 2:00 PM	0.00	0.41	0.41
9/30/10 5:00 PM	0.00	0.39	0.39
9/30/10 8:00 PM	0.00	0.40	0.40
9/30/10 11:00 PM	0.00	0.40	0.40
10/1/10 2:00 AM	0.00	0.40	0.40
10/1/10 5:00 AM	0.00	0.43	0.43
10/1/10 8:00 AM	0.00	0.44	0.44
10/1/10 11:00 AM	0.00	0.41	0.41
10/1/10 2:00 PM	0.00	0.41	0.41
10/1/10 5:00 PM	0.00	0.41	0.41
10/1/10 8:00 PM	0.00	0.39	0.39
10/1/10 11:00 PM	0.00	0.41	0.41
10/2/10 2:00 AM	0.00	0.41	0.41
10/2/10 5:00 AM	0.00	0.44	0.44
10/2/10 8:00 AM	0.00	0.44	0.44
10/2/10 11:00 AM	0.00	0.45	0.45
10/2/10 2:00 PM	0.00	0.51	0.51
10/2/10 5:00 PM	0.00	0.48	0.48
10/2/10 8:00 PM	0.00	0.32	0.32
10/2/10 11:00 PM	0.00	0.32	0.32
10/3/10 2:00 AM	0.00	0.34	0.34
10/3/10 5:00 AM	0.00	0.35	0.35
10/3/10 8:00 AM	0.00	0.34	0.34
10/3/10 11:00 AM	0.00	0.31	0.31
10/3/10 2:00 PM	0.00	0.32	0.32
10/3/10 5:00 PM	0.03	0.36	0.39
10/3/10 8:00 PM	0.33	0.37	0.70
10/3/10 11:00 PM	0.66	0.39	1.05
10/4/10 2:00 AM	0.66	0.30	0.97
10/4/10 5:00 AM	0.64	0.33	0.97

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
10/4/10 8:00 AM	0.77	0.40	1.17
10/4/10 11:00 AM	0.74	0.43	1.17
10/4/10 2:00 PM	0.70	0.42	1.12
10/4/10 5:00 PM	0.35	0.43	0.77
10/4/10 8:00 PM	0.28	0.42	0.70
10/4/10 11:00 PM	0.30	0.34	0.63
10/5/10 2:00 AM	0.15	0.25	0.40
10/5/10 5:00 AM	0.16	0.28	0.44
10/5/10 8:00 AM	0.30	0.36	0.66
10/5/10 11:00 AM	0.31	0.34	0.65
10/5/10 2:00 PM	0.30	0.36	0.66
10/5/10 5:00 PM	0.29	0.35	0.64
10/5/10 8:00 PM	0.32	0.34	0.66
10/5/10 11:00 PM	0.17	0.34	0.51
10/6/10 2:00 AM	0.08	0.34	0.41
10/6/10 5:00 AM	0.09	0.34	0.43
10/6/10 8:00 AM	0.27	0.33	0.60
10/6/10 11:00 AM	0.32	0.34	0.66
10/6/10 2:00 PM	0.28	0.34	0.62
10/6/10 5:00 PM	0.46	0.31	0.77
10/6/10 8:00 PM	0.97	0.32	1.29
10/6/10 11:00 PM	0.84	0.28	1.12
10/7/10 2:00 AM	0.57	0.03	0.60
10/7/10 5:00 AM	0.89	0.00	0.89
10/7/10 8:00 AM	1.13	0.00	1.13
10/7/10 11:00 AM	0.95	0.00	0.95
10/7/10 2:00 PM	0.97	0.00	0.97
10/7/10 5:00 PM	0.92	0.00	0.92
10/7/10 8:00 PM	0.68	0.00	0.68
10/7/10 11:00 PM	0.25	0.00	0.25
10/8/10 2:00 AM	0.20	0.00	0.20
10/8/10 5:00 AM	0.24	0.00	0.24
10/8/10 8:00 AM	0.24	0.00	0.24
10/8/10 11:00 AM	0.22	0.00	0.22
10/8/10 2:00 PM	0.25	0.00	0.25
10/8/10 5:00 PM	0.29	0.00	0.29
10/8/10 8:00 PM	0.39	0.00	0.39
10/8/10 11:00 PM	0.80	0.00	0.80
10/9/10 2:00 AM	0.73	0.00	0.73
10/9/10 5:00 AM	0.59	0.00	0.59
10/9/10 8:00 AM	0.78	0.00	0.78
10/9/10 11:00 AM	0.77	0.00	0.77
10/9/10 2:00 PM	0.38	0.00	0.38
10/9/10 5:00 PM	0.89	0.00	0.89
10/9/10 8:00 PM	0.98	0.00	0.98
10/9/10 11:00 PM	0.98	0.00	0.98
10/10/10 2:00 AM	0.96	0.00	0.96
10/10/10 5:00 AM	0.86	0.00	0.86
10/10/10 8:00 AM	0.95	0.00	0.95
10/10/10 11:00 AM	0.98	0.00	0.98
10/10/10 2:00 PM	0.94	0.00	0.94
10/10/10 5:00 PM	0.94	0.00	0.94
10/10/10 8:00 PM	0.96	0.00	0.96
10/10/10 11:00 PM	1.02	0.00	1.02

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
10/11/10 2:00 AM	0.98	0.00	0.98
10/11/10 5:00 AM	1.08	0.00	1.08
10/11/10 8:00 AM	1.15	0.00	1.15
10/11/10 11:00 AM	0.44	0.00	0.44
10/11/10 2:00 PM	1.04	0.00	1.04
10/11/10 5:00 PM	0.81	0.00	0.81
10/11/10 8:00 PM	0.91	0.00	0.91
10/11/10 11:00 PM	0.70	0.00	0.70
10/12/10 2:00 AM	0.57	0.00	0.57
10/12/10 5:00 AM	0.68	0.00	0.68
10/12/10 8:00 AM	0.74	0.00	0.74
10/12/10 11:00 AM	0.48	0.00	0.48
10/12/10 2:00 PM	0.27	0.00	0.27
10/12/10 5:00 PM	0.22	0.00	0.22
10/12/10 8:00 PM	0.25	0.00	0.25
10/12/10 11:00 PM	0.43	0.00	0.43
10/13/10 2:00 AM	0.45	0.00	0.45
10/13/10 5:00 AM	0.59	0.00	0.59
10/13/10 8:00 AM	0.56	0.00	0.56
10/13/10 11:00 AM	0.25	0.00	0.25
10/13/10 2:00 PM	0.25	0.00	0.25
10/13/10 5:00 PM	0.21	0.00	0.21
10/13/10 8:00 PM	0.20	0.00	0.20
10/13/10 11:00 PM	0.45	0.00	0.45
10/14/10 2:00 AM	0.37	0.00	0.37
10/14/10 5:00 AM	0.47	0.00	0.47
10/14/10 8:00 AM	0.18	0.00	0.18
10/14/10 11:00 AM	0.17	0.00	0.17
10/14/10 2:00 PM	0.17	0.00	0.17
10/14/10 5:00 PM	0.20	0.00	0.20
10/14/10 8:00 PM	0.21	0.00	0.21
10/14/10 11:00 PM	0.52	0.00	0.52
10/15/10 2:00 AM	0.66	0.00	0.66
10/15/10 5:00 AM	0.69	0.00	0.69
10/15/10 8:00 AM	0.33	0.00	0.33
10/15/10 11:00 AM	0.21	0.00	0.21
10/15/10 2:00 PM	0.20	0.00	0.20
10/15/10 5:00 PM	0.46	0.00	0.46
10/15/10 8:00 PM	0.37	0.00	0.37
10/15/10 11:00 PM	0.36	0.00	0.36
10/16/10 2:00 AM	0.36	0.00	0.36
10/16/10 5:00 AM	0.36	0.00	0.36
10/16/10 8:00 AM	0.57	0.00	0.57
10/16/10 11:00 AM	0.68	0.00	0.68
10/16/10 2:00 PM	0.63	0.00	0.63
10/16/10 5:00 PM	0.27	0.00	0.27
10/16/10 8:00 PM	0.28	0.00	0.28
10/16/10 11:00 PM	0.49	0.00	0.49
10/17/10 2:00 AM	0.67	0.00	0.67
10/17/10 5:00 AM	0.63	0.00	0.63
10/17/10 8:00 AM	0.86	0.00	0.86
10/17/10 11:00 AM	0.47	0.00	0.47
10/17/10 2:00 PM	0.29	0.00	0.29
10/17/10 5:00 PM	0.32	0.00	0.32

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
10/17/10 8:00 PM	0.35	0.00	0.35
10/17/10 11:00 PM	0.70	0.00	0.70
10/18/10 2:00 AM	0.38	0.00	0.38
10/18/10 5:00 AM	0.53	0.00	0.53
10/18/10 8:00 AM	0.37	0.00	0.37
10/18/10 11:00 AM	0.36	0.00	0.36
10/18/10 2:00 PM	0.36	0.00	0.36
10/18/10 5:00 PM	0.36	0.00	0.36
10/18/10 8:00 PM	0.41	0.00	0.41
10/18/10 11:00 PM	0.62	0.00	0.62
10/19/10 2:00 AM	0.57	0.00	0.57
10/19/10 5:00 AM	0.61	0.00	0.61
10/19/10 8:00 AM	0.17	0.00	0.17
10/19/10 11:00 AM	0.14	0.00	0.14
10/19/10 2:00 PM	0.16	0.00	0.16
10/19/10 5:00 PM	0.14	0.00	0.14
10/19/10 8:00 PM	0.14	0.00	0.14
10/19/10 11:00 PM	0.37	0.00	0.37
10/20/10 2:00 AM	0.42	0.00	0.42
10/20/10 5:00 AM	0.37	0.00	0.37
10/20/10 8:00 AM	0.35	0.00	0.35
10/20/10 11:00 AM	0.38	0.00	0.38
10/20/10 2:00 PM	0.38	0.00	0.38
10/20/10 5:00 PM	0.37	0.00	0.37
10/20/10 8:00 PM	0.40	0.00	0.40
10/20/10 11:00 PM	0.41	0.00	0.41
10/21/10 2:00 AM	0.41	0.00	0.41
10/21/10 5:00 AM	0.40	0.00	0.40
10/21/10 8:00 AM	0.39	0.00	0.39
10/21/10 11:00 AM	0.37	0.00	0.37
10/21/10 2:00 PM	0.37	0.00	0.37
10/21/10 5:00 PM	0.39	0.00	0.39
10/21/10 8:00 PM	0.36	0.00	0.36
10/21/10 11:00 PM	0.34	0.00	0.34
10/22/10 2:00 AM	0.35	0.00	0.35
10/22/10 5:00 AM	0.36	0.00	0.36
10/22/10 8:00 AM	0.34	0.00	0.34
10/22/10 11:00 AM	0.33	0.00	0.33
10/22/10 2:00 PM	0.32	0.00	0.32
10/22/10 5:00 PM	0.32	0.00	0.32
10/22/10 8:00 PM	0.31	0.00	0.31
10/22/10 11:00 PM	0.32	0.00	0.32
10/23/10 2:00 AM	0.32	0.00	0.32
10/23/10 5:00 AM	0.31	0.00	0.31
10/23/10 8:00 AM	0.34	0.00	0.34
10/23/10 11:00 AM	0.32	0.00	0.32
10/23/10 2:00 PM	0.32	0.00	0.32
10/23/10 5:00 PM	0.33	0.00	0.33
10/23/10 8:00 PM	0.34	0.00	0.34
10/23/10 11:00 PM	0.36	0.00	0.36
10/24/10 2:00 AM	0.26	0.00	0.26
10/24/10 5:00 AM	0.24	0.00	0.24
10/24/10 8:00 AM	0.35	0.00	0.35
10/24/10 11:00 AM	0.35	0.00	0.35

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
10/24/10 2:00 PM	0.31	0.00	0.31
10/24/10 5:00 PM	0.33	0.00	0.33
10/24/10 8:00 PM	0.40	0.00	0.40
10/24/10 11:00 PM	0.41	0.00	0.41
10/25/10 2:00 AM	0.43	0.00	0.43
10/25/10 5:00 AM	0.42	0.00	0.42
10/25/10 8:00 AM	0.39	0.00	0.39
10/25/10 11:00 AM	0.37	0.00	0.37
10/25/10 2:00 PM	0.37	0.00	0.37
10/25/10 5:00 PM	0.42	0.00	0.42
10/25/10 8:00 PM	0.44	0.00	0.44
10/25/10 11:00 PM	0.43	0.00	0.43
10/26/10 2:00 AM	0.41	0.00	0.41
10/26/10 5:00 AM	0.40	0.00	0.40
10/26/10 8:00 AM	0.40	0.00	0.40
10/26/10 11:00 AM	0.40	0.00	0.40
10/26/10 2:00 PM	0.39	0.00	0.39
10/26/10 5:00 PM	0.38	0.00	0.38
10/26/10 8:00 PM	0.38	0.00	0.38
10/26/10 11:00 PM	0.35	0.00	0.35
10/27/10 2:00 AM	0.35	0.00	0.35
10/27/10 5:00 AM	0.36	0.00	0.36
10/27/10 8:00 AM	0.35	0.00	0.35
10/27/10 11:00 AM	0.35	0.00	0.35
10/27/10 2:00 PM	0.35	0.00	0.35
10/27/10 5:00 PM	0.36	0.00	0.36
10/27/10 8:00 PM	0.36	0.00	0.36
10/27/10 11:00 PM	0.38	0.00	0.38
10/28/10 2:00 AM	0.37	0.00	0.37
10/28/10 5:00 AM	0.37	0.00	0.37
10/28/10 8:00 AM	0.39	0.00	0.39
10/28/10 11:00 AM	0.42	0.00	0.42
10/28/10 2:00 PM	0.42	0.00	0.42
10/28/10 5:00 PM	0.40	0.00	0.40
10/28/10 8:00 PM	0.42	0.00	0.42
10/28/10 11:00 PM	0.42	0.00	0.42
10/29/10 2:00 AM	0.41	0.00	0.41
10/29/10 5:00 AM	0.42	0.00	0.42
10/29/10 8:00 AM	0.42	0.00	0.42
10/29/10 11:00 AM	0.41	0.00	0.41
10/29/10 2:00 PM	0.39	0.00	0.39
10/29/10 5:00 PM	0.40	0.00	0.40
10/29/10 8:00 PM	0.41	0.00	0.41
10/29/10 11:00 PM	0.41	0.00	0.41
10/30/10 2:00 AM	0.42	0.00	0.42
10/30/10 5:00 AM	0.46	0.00	0.46
10/30/10 8:00 AM	0.43	0.00	0.43
10/30/10 11:00 AM	0.00	0.00	0.00
10/30/10 2:00 PM	0.07	0.00	0.07
10/30/10 5:00 PM	0.03	0.00	0.03
10/30/10 8:00 PM	0.01	0.00	0.01
10/30/10 11:00 PM	0.11	0.00	0.11
10/31/10 2:00 AM	0.29	0.00	0.29
10/31/10 5:00 AM	0.34	0.00	0.34

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
10/31/10 8:00 AM	0.40	0.00	0.40
10/31/10 11:00 AM	0.43	0.00	0.43
10/31/10 2:00 PM	0.44	0.00	0.44
10/31/10 5:00 PM	0.49	0.00	0.49
10/31/10 8:00 PM	0.46	0.00	0.46
10/31/10 11:00 PM	0.60	0.00	0.60
11/1/10 2:00 AM	0.99	0.00	0.99
11/1/10 5:00 AM	0.97	0.00	0.97
11/1/10 8:00 AM	0.98	0.00	0.98
11/1/10 11:00 AM	1.11	0.00	1.11
11/1/10 2:00 PM	1.19	0.00	1.19
11/1/10 5:00 PM	0.80	0.00	0.80
11/1/10 8:00 PM	0.74	0.00	0.74
11/1/10 11:00 PM	0.85	0.00	0.85
11/2/10 2:00 AM	0.86	0.00	0.86
11/2/10 5:00 AM	0.79	0.00	0.79
11/2/10 8:00 AM	0.66	0.00	0.66
11/2/10 11:00 AM	0.63	0.00	0.63
11/2/10 2:00 PM	0.65	0.00	0.65
11/2/10 5:00 PM	0.49	0.00	0.49
11/2/10 8:00 PM	0.47	0.00	0.47
11/2/10 11:00 PM	0.69	0.00	0.69
11/3/10 2:00 AM	0.67	0.00	0.67
11/3/10 5:00 AM	0.72	0.00	0.72
11/3/10 8:00 AM	0.44	0.00	0.44
11/3/10 11:00 AM	0.42	0.00	0.42
11/3/10 2:00 PM	0.41	0.07	0.48
11/3/10 5:00 PM	0.65	0.08	0.73
11/3/10 8:00 PM	0.50	0.04	0.54
11/3/10 11:00 PM	0.53	0.03	0.57
11/4/10 2:00 AM	1.27	0.03	1.31
11/4/10 5:00 AM	0.81	0.03	0.85
11/4/10 8:00 AM	0.54	0.05	0.59
11/4/10 11:00 AM	0.58	0.06	0.64
11/4/10 2:00 PM	0.57	0.03	0.59
11/4/10 5:00 PM	0.56	0.00	0.56
11/4/10 8:00 PM	0.58	0.00	0.58
11/4/10 11:00 PM	0.86	0.00	0.86
11/5/10 2:00 AM	0.55	0.00	0.55
11/5/10 5:00 AM	0.93	0.00	0.93
11/5/10 8:00 AM	0.62	0.00	0.62
11/5/10 11:00 AM	0.61	0.00	0.61
11/5/10 2:00 PM	0.57	0.00	0.57
11/5/10 5:00 PM	0.58	0.00	0.58
11/5/10 8:00 PM	0.64	0.00	0.64
11/5/10 11:00 PM	1.06	0.00	1.06
11/6/10 2:00 AM	0.63	0.00	0.63
11/6/10 5:00 AM	0.86	0.00	0.86
11/6/10 8:00 AM	1.02	0.00	1.02
11/6/10 11:00 AM	0.62	0.00	0.62
11/6/10 2:00 PM	0.59	0.00	0.59
11/6/10 5:00 PM	0.54	0.00	0.54
11/6/10 8:00 PM	0.53	0.00	0.53
11/6/10 11:00 PM	0.55	0.00	0.55

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
11/7/10 2:00 AM	1.09	0.00	1.09
11/7/10 5:00 AM	0.71	0.00	0.71
11/7/10 8:00 AM	0.30	0.01	0.32
11/7/10 11:00 AM	0.29	0.15	0.44
11/7/10 2:00 PM	0.26	0.47	0.73
11/7/10 5:00 PM	0.30	0.13	0.44
11/7/10 8:00 PM	0.47	0.06	0.53
11/7/10 11:00 PM	0.81	0.08	0.89
11/8/10 2:00 AM	0.44	0.06	0.50
11/8/10 5:00 AM	0.59	0.15	0.75
11/8/10 8:00 AM	0.50	0.07	0.57
11/8/10 11:00 AM	0.77	0.07	0.84
11/8/10 2:00 PM	0.87	0.07	0.94
11/8/10 5:00 PM	0.91	0.08	0.99
11/8/10 8:00 PM	0.95	0.09	1.03
11/8/10 11:00 PM	0.67	0.08	0.75
11/9/10 2:00 AM	0.46	0.06	0.53
11/9/10 5:00 AM	0.50	0.07	0.57
11/9/10 8:00 AM	0.77	0.09	0.86
11/9/10 11:00 AM	0.33	0.08	0.41
11/9/10 2:00 PM	0.33	0.09	0.42
11/9/10 5:00 PM	0.34	0.09	0.43
11/9/10 8:00 PM	0.38	0.36	0.74
11/9/10 11:00 PM	0.53	0.05	0.58
11/10/10 2:00 AM	0.45	0.05	0.51
11/10/10 5:00 AM	0.68	0.09	0.77
11/10/10 8:00 AM	0.36	0.12	0.48
11/10/10 11:00 AM	0.30	0.14	0.44
11/10/10 2:00 PM	0.57	0.13	0.70
11/10/10 5:00 PM	0.46	0.14	0.60
11/10/10 8:00 PM	0.50	0.15	0.65
11/10/10 11:00 PM	0.44	0.10	0.54
11/11/10 2:00 AM	0.41	0.06	0.48
11/11/10 5:00 AM	0.31	0.07	0.38
11/11/10 8:00 AM	0.33	0.17	0.50
11/11/10 11:00 AM	0.34	0.34	0.68
11/11/10 2:00 PM	0.36	0.33	0.69
11/11/10 5:00 PM	0.38	0.32	0.69
11/11/10 8:00 PM	0.40	0.33	0.73
11/11/10 11:00 PM	0.41	0.35	0.76
11/12/10 2:00 AM	0.31	0.38	0.70
11/12/10 5:00 AM	0.30	0.39	0.69
11/12/10 8:00 AM	0.43	0.44	0.87
11/12/10 11:00 AM	0.43	0.48	0.92
11/12/10 2:00 PM	0.43	0.52	0.95
11/12/10 5:00 PM	0.44	0.52	0.96
11/12/10 8:00 PM	0.43	0.49	0.92
11/12/10 11:00 PM	0.45	0.37	0.81
11/13/10 2:00 AM	0.46	0.13	0.59
11/13/10 5:00 AM	0.47	0.14	0.60
11/13/10 8:00 AM	0.44	0.19	0.64
11/13/10 11:00 AM	0.43	0.19	0.62
11/13/10 2:00 PM	0.45	0.21	0.66
11/13/10 5:00 PM	0.46	0.22	0.67

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
11/13/10 8:00 PM	0.48	0.24	0.71
11/13/10 11:00 PM	0.47	0.55	1.01
11/14/10 2:00 AM	0.44	0.43	0.87
11/14/10 5:00 AM	0.35	0.30	0.65
11/14/10 8:00 AM	0.38	0.49	0.87
11/14/10 11:00 AM	0.39	0.45	0.84
11/14/10 2:00 PM	0.46	0.44	0.90
11/14/10 5:00 PM	0.48	0.43	0.91
11/14/10 8:00 PM	0.48	0.42	0.90
11/14/10 11:00 PM	0.38	0.41	0.78
11/15/10 2:00 AM	0.23	0.40	0.63
11/15/10 5:00 AM	0.23	0.41	0.64
11/15/10 8:00 AM	0.30	0.37	0.67
11/15/10 11:00 AM	0.42	0.36	0.78
11/15/10 2:00 PM	0.44	0.37	0.81
11/15/10 5:00 PM	0.47	0.37	0.84
11/15/10 8:00 PM	0.48	0.38	0.85
11/15/10 11:00 PM	0.44	0.36	0.80
11/16/10 2:00 AM	0.30	0.16	0.46
11/16/10 5:00 AM	0.30	0.26	0.56
11/16/10 8:00 AM	0.45	0.39	0.84
11/16/10 11:00 AM	0.43	0.47	0.90
11/16/10 2:00 PM	0.44	0.45	0.89
11/16/10 5:00 PM	0.47	0.37	0.84
11/16/10 8:00 PM	0.48	0.22	0.71
11/16/10 11:00 PM	0.47	0.13	0.60
11/17/10 2:00 AM	0.38	0.05	0.43
11/17/10 5:00 AM	0.37	0.05	0.41
11/17/10 8:00 AM	0.45	0.10	0.55
11/17/10 11:00 AM	0.45	0.00	0.45
11/17/10 2:00 PM	0.45	0.00	0.45
11/17/10 5:00 PM	0.45	0.00	0.45
11/17/10 8:00 PM	0.49	0.00	0.49
11/17/10 11:00 PM	0.53	0.03	0.55
11/18/10 2:00 AM	0.38	0.23	0.61
11/18/10 5:00 AM	0.30	0.33	0.64
11/18/10 8:00 AM	0.54	0.35	0.89
11/18/10 11:00 AM	0.53	0.38	0.91
11/18/10 2:00 PM	0.55	0.42	0.97
11/18/10 5:00 PM	0.53	0.38	0.92
11/18/10 8:00 PM	0.49	0.46	0.96
11/18/10 11:00 PM	0.49	0.32	0.81
11/19/10 2:00 AM	0.49	0.12	0.61
11/19/10 5:00 AM	0.48	0.30	0.79
11/19/10 8:00 AM	0.50	0.13	0.63
11/19/10 11:00 AM	0.47	0.50	0.97
11/19/10 2:00 PM	0.44	0.25	0.69
11/19/10 5:00 PM	0.48	0.23	0.71
11/19/10 8:00 PM	0.51	0.19	0.70
11/19/10 11:00 PM	0.57	0.13	0.70
11/20/10 2:00 AM	0.59	0.11	0.70
11/20/10 5:00 AM	0.59	0.10	0.69
11/20/10 8:00 AM	0.57	0.17	0.73
11/20/10 11:00 AM	0.59	0.42	1.01

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
11/20/10 2:00 PM	0.79	0.35	1.14
11/20/10 5:00 PM	0.90	0.34	1.23
11/20/10 8:00 PM	0.92	0.26	1.17
11/20/10 11:00 PM	0.92	0.35	1.27
11/21/10 2:00 AM	0.65	0.14	0.79
11/21/10 5:00 AM	0.38	0.14	0.51
11/21/10 8:00 AM	0.47	0.27	0.74
11/21/10 11:00 AM	0.88	0.35	1.23
11/21/10 2:00 PM	0.51	0.35	0.85
11/21/10 5:00 PM	0.48	0.34	0.82
11/21/10 8:00 PM	0.50	0.31	0.81
11/21/10 11:00 PM	0.74	0.30	1.04
11/22/10 2:00 AM	0.64	0.12	0.76
11/22/10 5:00 AM	0.84	0.03	0.86
11/22/10 8:00 AM	0.55	0.11	0.66
11/22/10 11:00 AM	0.64	0.23	0.87
11/22/10 2:00 PM	0.85	0.30	1.15
11/22/10 5:00 PM	0.39	0.30	0.69
11/22/10 8:00 PM	0.38	0.28	0.66
11/22/10 11:00 PM	0.61	0.24	0.84
11/23/10 2:00 AM	0.60	0.12	0.72
11/23/10 5:00 AM	0.59	0.07	0.66
11/23/10 8:00 AM	1.07	0.08	1.14
11/23/10 11:00 AM	0.42	0.20	0.62
11/23/10 2:00 PM	0.39	0.31	0.69
11/23/10 5:00 PM	0.36	0.24	0.61
11/23/10 8:00 PM	0.34	0.33	0.67
11/23/10 11:00 PM	0.52	0.28	0.80
11/24/10 2:00 AM	0.91	0.04	0.95
11/24/10 5:00 AM	0.91	0.03	0.95
11/24/10 8:00 AM	0.93	0.16	1.09
11/24/10 11:00 AM	0.81	0.33	1.15
11/24/10 2:00 PM	0.62	0.38	1.01
11/24/10 5:00 PM	0.63	0.46	1.09
11/24/10 8:00 PM	0.79	0.45	1.24
11/24/10 11:00 PM	0.73	0.47	1.20
11/25/10 2:00 AM	0.71	0.43	1.14
11/25/10 5:00 AM	0.69	0.20	0.90
11/25/10 8:00 AM	0.81	0.15	0.95
11/25/10 11:00 AM	0.47	0.48	0.95
11/25/10 2:00 PM	0.63	0.45	1.08
11/25/10 5:00 PM	0.76	0.47	1.23
11/25/10 8:00 PM	0.68	0.46	1.14
11/25/10 11:00 PM	0.79	0.35	1.14
11/26/10 2:00 AM	0.53	0.04	0.56
11/26/10 5:00 AM	0.54	0.04	0.58
11/26/10 8:00 AM	0.59	0.44	1.03
11/26/10 11:00 AM	0.66	0.56	1.22
11/26/10 2:00 PM	0.51	0.78	1.28
11/26/10 5:00 PM	0.98	0.33	1.31
11/26/10 8:00 PM	0.50	0.20	0.70
11/26/10 11:00 PM	0.70	0.21	0.91
11/27/10 2:00 AM	0.54	0.11	0.65
11/27/10 5:00 AM	0.56	0.13	0.68

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
11/27/10 8:00 AM	0.71	0.15	0.87
11/27/10 11:00 AM	0.82	0.21	1.03
11/27/10 2:00 PM	0.95	0.28	1.23
11/27/10 5:00 PM	0.92	0.28	1.20
11/27/10 8:00 PM	0.59	0.27	0.86
11/27/10 11:00 PM	0.59	0.25	0.84
11/28/10 2:00 AM	0.57	0.14	0.71
11/28/10 5:00 AM	0.60	0.05	0.65
11/28/10 8:00 AM	0.58	0.07	0.65
11/28/10 11:00 AM	0.64	0.52	1.16
11/28/10 2:00 PM	0.57	0.56	1.13
11/28/10 5:00 PM	0.68	0.50	1.18
11/28/10 8:00 PM	0.88	0.13	1.02
11/28/10 11:00 PM	0.70	0.00	0.70
11/29/10 2:00 AM	0.58	0.00	0.58
11/29/10 5:00 AM	0.57	0.00	0.57
11/29/10 8:00 AM	0.69	0.00	0.69
11/29/10 11:00 AM	0.91	0.00	0.91
11/29/10 2:00 PM	0.93	0.00	0.93
11/29/10 5:00 PM	0.89	0.00	0.89
11/29/10 8:00 PM	0.91	0.00	0.91
11/29/10 11:00 PM	0.95	0.00	0.95
11/30/10 2:00 AM	0.84	0.00	0.84
11/30/10 5:00 AM	0.80	0.00	0.80
11/30/10 8:00 AM	0.97	0.00	0.97
11/30/10 11:00 AM	1.00	0.00	1.00
11/30/10 2:00 PM	0.99	0.00	0.99
11/30/10 5:00 PM	0.93	0.00	0.93
11/30/10 8:00 PM	0.96	0.00	0.96
11/30/10 11:00 PM	0.93	0.00	0.93
12/1/10 2:00 AM	0.78	0.00	0.78
12/1/10 5:00 AM	0.69	0.00	0.69
12/1/10 8:00 AM	1.04	0.00	1.04
12/1/10 11:00 AM	1.00	0.00	1.00
12/1/10 2:00 PM	0.98	0.00	0.98
12/1/10 5:00 PM	0.99	0.00	0.99
12/1/10 8:00 PM	1.06	0.00	1.06
12/1/10 11:00 PM	0.86	0.00	0.86
12/2/10 2:00 AM	0.74	0.00	0.74
12/2/10 5:00 AM	0.90	0.00	0.90
12/2/10 8:00 AM	1.11	0.00	1.11
12/2/10 11:00 AM	1.02	0.00	1.02
12/2/10 2:00 PM	0.97	0.00	0.97
12/2/10 5:00 PM	1.00	0.00	1.00
12/2/10 8:00 PM	1.00	0.00	1.00
12/2/10 11:00 PM	0.95	0.00	0.95
012/03/2010 2:00:00 AM	0.93	0.00	0.93
12/3/10 5:00 AM	0.98	0.00	0.98
12/3/10 8:00 AM	0.95	0.00	0.95
12/3/10 11:00 AM	0.90	0.00	0.90
12/3/10 2:00 PM	0.89	0.00	0.89
12/3/10 5:00 PM	0.88	0.00	0.88
12/3/10 8:00 PM	0.85	0.07	0.91
12/3/10 11:00 PM	0.38	0.07	0.45

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
12/4/10 2:00 AM	0.34	0.08	0.43
12/4/10 5:00 AM	0.34	0.08	0.42
12/4/10 8:00 AM	0.33	0.08	0.41
12/4/10 11:00 AM	0.59	0.07	0.66
12/4/10 2:00 PM	0.89	0.07	0.96
12/4/10 5:00 PM	0.88	0.19	1.08
12/4/10 8:00 PM	0.90	0.30	1.20
12/4/10 11:00 PM	0.66	0.46	1.12
12/5/10 2:00 AM	0.40	0.49	0.89
12/5/10 5:00 AM	0.38	0.25	0.63
12/5/10 8:00 AM	0.70	0.28	0.98
12/5/10 11:00 AM	0.87	0.33	1.20
12/5/10 2:00 PM	0.91	0.34	1.25
12/5/10 5:00 PM	0.90	0.33	1.24
12/5/10 8:00 PM	0.41	0.42	0.83
12/5/10 11:00 PM	0.69	0.42	1.11
12/6/10 2:00 AM	0.88	0.39	1.27
12/6/10 5:00 AM	0.81	0.39	1.20
12/6/10 8:00 AM	0.34	0.39	0.73
12/6/10 11:00 AM	0.43	0.41	0.84
12/6/10 2:00 PM	0.72	0.42	1.14
12/6/10 5:00 PM	0.73	0.36	1.09
12/6/10 8:00 PM	0.38	0.43	0.80
12/6/10 11:00 PM	0.37	0.48	0.85
12/7/10 2:00 AM	0.39	0.44	0.83
12/7/10 5:00 AM	0.41	0.36	0.78
12/7/10 8:00 AM	0.42	0.39	0.81
12/7/10 11:00 AM	0.47	0.42	0.89
12/7/10 2:00 PM	0.44	0.42	0.86
12/7/10 5:00 PM	0.42	0.41	0.83
12/7/10 8:00 PM	0.43	0.39	0.81
12/7/10 11:00 PM	0.46	0.35	0.81
12/8/10 2:00 AM	0.49	0.34	0.83
12/8/10 5:00 AM	0.54	0.33	0.87
12/8/10 8:00 AM	0.58	0.37	0.94
12/8/10 11:00 AM	0.82	0.49	1.30
12/8/10 2:00 PM	0.85	0.37	1.22
12/8/10 5:00 PM	0.81	0.39	1.20
12/8/10 8:00 PM	0.42	0.39	0.80
12/8/10 11:00 PM	0.54	0.36	0.90
12/9/10 2:00 AM	0.62	0.25	0.87
12/9/10 5:00 AM	0.63	0.34	0.97
12/9/10 8:00 AM	0.64	0.34	0.99
12/9/10 11:00 AM	0.63	0.33	0.96
12/9/10 2:00 PM	0.62	0.31	0.93
12/9/10 5:00 PM	0.62	0.32	0.95
12/9/10 8:00 PM	0.60	0.28	0.88
12/9/10 11:00 PM	0.86	0.32	1.18
12/10/10 2:00 AM	0.84	0.31	1.15
12/10/10 5:00 AM	0.88	0.35	1.23
12/10/10 8:00 AM	1.01	0.36	1.37
12/10/10 11:00 AM	0.65	0.40	1.05
12/10/10 2:00 PM	0.81	0.23	1.04
12/10/10 5:00 PM	0.98	0.06	1.04

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
12/10/10 8:00 PM	0.53	0.06	0.59
12/10/10 11:00 PM	0.55	0.15	0.70
12/11/10 2:00 AM	0.78	0.17	0.95
12/11/10 5:00 AM	0.93	0.18	1.11
12/11/10 8:00 AM	0.57	0.18	0.75
12/11/10 11:00 AM	0.43	0.18	0.61
12/11/10 2:00 PM	0.48	0.17	0.65
12/11/10 5:00 PM	0.88	0.18	1.06
12/11/10 8:00 PM	0.83	0.20	1.03
12/11/10 11:00 PM	0.74	0.20	0.95
12/12/10 2:00 AM	0.87	0.18	1.05
12/12/10 5:00 AM	0.85	0.21	1.06
12/12/10 8:00 AM	0.53	0.30	0.83
12/12/10 11:00 AM	0.70	0.30	1.01
12/12/10 2:00 PM	0.79	0.33	1.12
12/12/10 5:00 PM	0.36	0.35	0.71
12/12/10 8:00 PM	0.37	0.38	0.74
12/12/10 11:00 PM	0.55	0.39	0.94
12/13/10 2:00 AM	0.54	0.24	0.78
12/13/10 5:00 AM	0.60	0.27	0.88
12/13/10 8:00 AM	0.41	0.33	0.74
12/13/10 11:00 AM	0.54	0.33	0.87
12/13/10 2:00 PM	0.55	0.33	0.87
12/13/10 5:00 PM	0.65	0.33	0.98
12/13/10 8:00 PM	0.84	0.32	1.16
12/13/10 11:00 PM	0.91	0.32	1.23
12/14/10 2:00 AM	0.95	0.32	1.26
12/14/10 5:00 AM	0.91	0.32	1.24
12/14/10 8:00 AM	0.65	0.33	0.98
12/14/10 11:00 AM	0.59	0.33	0.93
12/14/10 2:00 PM	0.69	0.31	1.01
12/14/10 5:00 PM	0.80	0.33	1.13
12/14/10 8:00 PM	0.64	0.31	0.95
12/14/10 11:00 PM	0.85	0.29	1.15
12/15/10 2:00 AM	0.89	0.30	1.18
12/15/10 5:00 AM	0.92	0.30	1.22
12/15/10 8:00 AM	0.90	0.32	1.22
12/15/10 11:00 AM	1.05	0.31	1.36
12/15/10 2:00 PM	1.09	0.33	1.43
12/15/10 5:00 PM	1.00	0.27	1.27
12/15/10 8:00 PM	1.13	0.35	1.48
12/15/10 11:00 PM	1.13	0.35	1.48
12/16/10 2:00 AM	1.17	0.35	1.52
12/16/10 5:00 AM	1.07	0.36	1.43
12/16/10 8:00 AM	0.98	0.33	1.31
12/16/10 11:00 AM	0.94	0.24	1.18
12/16/10 2:00 PM	0.93	0.23	1.17
12/16/10 5:00 PM	0.89	0.29	1.18
12/16/10 8:00 PM	0.91	0.35	1.26
12/16/10 11:00 PM	0.89	0.23	1.12
12/17/10 2:00 AM	0.88	0.08	0.96
12/17/10 5:00 AM	0.84	0.09	0.93
12/17/10 8:00 AM	0.58	0.08	0.66
12/17/10 11:00 AM	0.07	0.00	0.07

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
12/17/10 2:00 PM	0.00	0.00	0.00
12/17/10 5:00 PM	0.04	0.00	0.04
12/17/10 8:00 PM	0.14	0.02	0.16
12/17/10 11:00 PM	0.27	0.28	0.56
12/18/10 2:00 AM	0.22	0.35	0.56
12/18/10 5:00 AM	0.19	0.33	0.52
12/18/10 8:00 AM	0.22	0.41	0.63
12/18/10 11:00 AM	0.23	0.30	0.53
12/18/10 2:00 PM	0.23	0.26	0.49
12/18/10 5:00 PM	0.23	0.26	0.49
12/18/10 8:00 PM	0.28	0.24	0.52
12/18/10 11:00 PM	0.25	0.21	0.46
12/19/10 2:00 AM	0.23	0.20	0.43
12/19/10 5:00 AM	0.23	0.20	0.43
12/19/10 8:00 AM	0.24	0.19	0.44
12/19/10 11:00 AM	0.38	0.21	0.59
12/19/10 2:00 PM	0.59	0.22	0.81
12/19/10 5:00 PM	0.56	0.23	0.80
12/19/10 8:00 PM	0.27	0.23	0.50
12/19/10 11:00 PM	0.28	0.26	0.54
12/20/10 2:00 AM	0.75	0.22	0.97
12/20/10 5:00 AM	0.61	0.28	0.88
12/20/10 8:00 AM	0.31	0.30	0.61
12/20/10 11:00 AM	0.32	0.28	0.59
12/20/10 2:00 PM	0.29	0.27	0.56
12/20/10 5:00 PM	0.33	0.27	0.60
12/20/10 8:00 PM	0.46	0.25	0.71
12/20/10 11:00 PM	0.71	0.24	0.94
12/21/10 2:00 AM	0.13	0.24	0.38
12/21/10 5:00 AM	0.14	0.22	0.36
12/21/10 8:00 AM	0.23	0.19	0.42
12/21/10 11:00 AM	0.40	0.16	0.56
12/21/10 2:00 PM	0.39	0.17	0.57
12/21/10 5:00 PM	0.57	0.17	0.74
12/21/10 8:00 PM	1.52	0.18	1.70
12/21/10 11:00 PM	0.33	0.16	0.49
12/22/10 2:00 AM	0.34	0.07	0.41
12/22/10 5:00 AM	0.35	0.24	0.59
12/22/10 8:00 AM	0.36	0.38	0.74
12/22/10 11:00 AM	0.36	0.34	0.70
12/22/10 2:00 PM	0.36	0.32	0.69
12/22/10 5:00 PM	0.38	0.31	0.69
12/22/10 8:00 PM	0.39	0.26	0.65
12/22/10 11:00 PM	0.37	0.04	0.41
12/23/10 2:00 AM	0.36	0.05	0.40
12/23/10 5:00 AM	0.37	0.07	0.45
12/23/10 8:00 AM	0.41	0.48	0.89
12/23/10 11:00 AM	0.42	0.51	0.94
12/23/10 2:00 PM	0.38	0.42	0.79
12/23/10 5:00 PM	0.36	0.28	0.64
12/23/10 8:00 PM	0.37	0.28	0.64
12/23/10 11:00 PM	0.46	0.18	0.64
12/24/10 2:00 AM	0.49	0.07	0.56
12/24/10 5:00 AM	0.49	0.09	0.58

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
12/24/10 8:00 AM	0.48	0.44	0.92
12/24/10 11:00 AM	0.59	0.39	0.98
12/24/10 2:00 PM	0.87	0.36	1.23
12/24/10 5:00 PM	0.89	0.25	1.15
12/24/10 8:00 PM	1.05	0.15	1.20
12/24/10 11:00 PM	1.09	0.14	1.23
12/25/10 2:00 AM	0.74	0.05	0.80
12/25/10 5:00 AM	1.17	0.15	1.32
12/25/10 8:00 AM	1.13	0.45	1.57
12/25/10 11:00 AM	0.43	0.32	0.75
12/25/10 2:00 PM	0.81	0.29	1.10
12/25/10 5:00 PM	0.97	0.23	1.20
12/25/10 8:00 PM	1.04	0.13	1.17
12/25/10 11:00 PM	0.91	0.05	0.96
12/26/10 2:00 AM	0.53	0.05	0.58
12/26/10 5:00 AM	0.53	0.05	0.58
12/26/10 8:00 AM	0.69	0.20	0.90
12/26/10 11:00 AM	0.51	0.47	0.98
12/26/10 2:00 PM	0.91	0.38	1.29
12/26/10 5:00 PM	0.54	0.32	0.86
12/26/10 8:00 PM	0.61	0.39	1.00
12/26/10 11:00 PM	0.65	0.37	1.02
12/27/10 2:00 AM	0.69	0.36	1.05
12/27/10 5:00 AM	0.79	0.36	1.15
12/27/10 8:00 AM	0.98	0.35	1.33
12/27/10 11:00 AM	1.12	0.35	1.47
12/27/10 2:00 PM	0.72	0.35	1.07
12/27/10 5:00 PM	0.73	0.33	1.06
12/27/10 8:00 PM	0.74	0.32	1.06
12/27/10 11:00 PM	0.76	0.35	1.11
12/28/10 2:00 AM	0.78	0.35	1.13
12/28/10 5:00 AM	0.81	0.32	1.13
12/28/10 8:00 AM	0.88	0.34	1.22
12/28/10 11:00 AM	0.79	0.29	1.08
12/28/10 2:00 PM	0.70	0.29	0.98
12/28/10 5:00 PM	0.79	0.25	1.04
12/28/10 8:00 PM	1.33	0.27	1.60
12/28/10 11:00 PM	1.08	0.30	1.38
12/29/10 2:00 AM	1.10	0.32	1.42
12/29/10 5:00 AM	1.10	0.37	1.46
12/29/10 8:00 AM	1.17	0.36	1.53
12/29/10 11:00 AM	1.03	0.30	1.34
12/29/10 2:00 PM	1.15	0.23	1.38
12/29/10 5:00 PM	0.80	0.23	1.03
12/29/10 8:00 PM	0.94	0.16	1.09
12/29/10 11:00 PM	0.94	0.11	1.05
12/30/10 2:00 AM	0.92	0.11	1.04
12/30/10 5:00 AM	0.87	0.12	1.00
12/30/10 8:00 AM	0.40	0.13	0.53
12/30/10 11:00 AM	0.47	0.18	0.65
12/30/10 2:00 PM	0.94	0.39	1.33
12/30/10 5:00 PM	0.93	0.27	1.20
12/30/10 8:00 PM	0.97	0.26	1.23
12/30/10 11:00 PM	1.08	0.20	1.28

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
12/31/10 2:00 AM	1.09	0.05	1.14
12/31/10 5:00 AM	1.11	0.06	1.17
12/31/10 8:00 AM	1.13	0.45	1.59
12/31/10 11:00 AM	0.85	0.47	1.32
12/31/10 2:00 PM	0.80	0.46	1.26
12/31/10 5:00 PM	0.84	0.44	1.28
12/31/10 8:00 PM	0.93	0.39	1.33
12/31/10 11:00 PM	0.87	0.08	0.95
1/1/11 2:00 AM	0.84	0.06	0.90
1/1/11 5:00 AM	0.68	0.07	0.74
1/1/11 8:00 AM	0.60	0.08	0.68
1/1/11 11:00 AM	0.70	0.28	0.98
1/1/11 2:00 PM	0.74	0.54	1.28
1/1/11 5:00 PM	0.73	0.48	1.22
1/1/11 8:00 PM	0.75	0.43	1.18
1/1/11 11:00 PM	0.81	0.33	1.14
1/2/11 2:00 AM	0.64	0.05	0.69
1/2/11 5:00 AM	0.52	0.05	0.57
1/2/11 8:00 AM	0.72	0.06	0.79
1/2/11 11:00 AM	0.84	0.45	1.30
1/2/11 2:00 PM	0.86	0.40	1.26
1/2/11 5:00 PM	0.86	0.35	1.21
1/2/11 8:00 PM	0.87	0.32	1.19
1/2/11 11:00 PM	0.85	0.07	0.93
1/3/11 2:00 AM	0.70	0.05	0.75
1/3/11 5:00 AM	0.61	0.07	0.68
1/3/11 8:00 AM	0.63	0.46	1.10
1/3/11 11:00 AM	0.75	0.44	1.18
1/3/11 2:00 PM	0.95	0.41	1.36
1/3/11 5:00 PM	0.96	0.38	1.34
1/3/11 8:00 PM	0.98	0.36	1.34
1/3/11 11:00 PM	0.99	0.32	1.31
1/4/11 2:00 AM	0.99	0.06	1.05
1/4/11 5:00 AM	0.98	0.09	1.06
1/4/11 8:00 AM	0.96	0.47	1.43
1/4/11 11:00 AM	0.92	0.50	1.43
1/4/11 2:00 PM	0.94	0.47	1.41
1/4/11 5:00 PM	0.94	0.43	1.36
1/4/11 8:00 PM	0.73	0.38	1.11
1/4/11 11:00 PM	0.66	0.17	0.82
1/5/11 2:00 AM	0.57	0.04	0.61
1/5/11 5:00 AM	0.80	0.05	0.86
1/5/11 8:00 AM	1.05	0.13	1.18
1/5/11 11:00 AM	0.94	0.51	1.45
1/5/11 2:00 PM	0.50	0.46	0.96
1/5/11 5:00 PM	0.36	0.47	0.84
1/5/11 8:00 PM	0.46	0.51	0.97
1/5/11 11:00 PM	0.53	0.09	0.62
1/6/11 2:00 AM	0.87	0.08	0.95
1/6/11 5:00 AM	0.71	0.09	0.80
1/6/11 8:00 AM	0.98	0.37	1.35
1/6/11 11:00 AM	0.44	0.65	1.09
1/6/11 2:00 PM	0.37	0.45	0.82
1/6/11 5:00 PM	0.98	0.44	1.41

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
1/6/11 8:00 PM	0.99	0.41	1.40
1/6/11 11:00 PM	0.96	0.23	1.18
1/7/11 2:00 AM	0.95	0.05	1.00
1/7/11 5:00 AM	0.87	0.07	0.94
1/7/11 8:00 AM	0.81	0.54	1.35
1/7/11 11:00 AM	0.91	0.45	1.36
1/7/11 2:00 PM	0.89	0.40	1.29
1/7/11 5:00 PM	0.89	0.36	1.25
1/7/11 8:00 PM	0.87	0.33	1.20
1/7/11 11:00 PM	0.41	0.21	0.62
1/8/11 2:00 AM	0.96	0.05	1.01
1/8/11 5:00 AM	0.92	0.05	0.96
1/8/11 8:00 AM	0.49	0.23	0.72
1/8/11 11:00 AM	0.38	0.18	0.56
1/8/11 2:00 PM	0.84	0.35	1.19
1/8/11 5:00 PM	1.05	0.26	1.31
1/8/11 8:00 PM	0.51	0.34	0.85
1/8/11 11:00 PM	0.55	0.20	0.75
1/9/11 2:00 AM	1.08	0.08	1.16
1/9/11 5:00 AM	1.13	0.14	1.27
1/9/11 8:00 AM	1.04	0.34	1.38
1/9/11 11:00 AM	1.10	0.36	1.45
1/9/11 2:00 PM	0.95	0.20	1.15
1/9/11 5:00 PM	0.93	0.07	1.00
1/9/11 8:00 PM	0.48	0.10	0.58
1/9/11 11:00 PM	0.72	0.51	1.22
1/10/11 2:00 AM	0.69	0.24	0.93
1/10/11 5:00 AM	0.70	0.21	0.91
1/10/11 8:00 AM	0.74	0.23	0.98
1/10/11 11:00 AM	1.02	0.26	1.28
1/10/11 2:00 PM	0.74	0.24	0.98
1/10/11 5:00 PM	0.98	0.24	1.22
1/10/11 8:00 PM	0.86	0.25	1.11
1/10/11 11:00 PM	0.83	0.25	1.08
1/11/11 2:00 AM	0.46	0.14	0.60
1/11/11 5:00 AM	0.52	0.12	0.64
1/11/11 8:00 AM	0.93	0.22	1.15
1/11/11 11:00 AM	0.95	0.14	1.09
1/11/11 2:00 PM	0.89	0.17	1.05
1/11/11 5:00 PM	0.85	0.15	1.01
1/11/11 8:00 PM	0.93	0.18	1.10
1/11/11 11:00 PM	0.96	0.18	1.14
1/12/11 2:00 AM	0.81	0.21	1.02
1/12/11 5:00 AM	0.86	0.22	1.08
1/12/11 8:00 AM	0.97	0.28	1.25
1/12/11 11:00 AM	0.98	0.27	1.25
1/12/11 2:00 PM	1.04	0.25	1.30
1/12/11 5:00 PM	0.98	0.25	1.23
1/12/11 8:00 PM	0.92	0.25	1.16
1/12/11 11:00 PM	0.85	0.10	0.96
1/13/11 2:00 AM	0.86	0.05	0.91
1/13/11 5:00 AM	0.87	0.25	1.12
1/13/11 8:00 AM	0.88	0.41	1.29
1/13/11 11:00 AM	0.89	0.27	1.16

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
1/13/11 2:00 PM	0.80	0.16	0.96
1/13/11 5:00 PM	0.79	0.19	0.99
1/13/11 8:00 PM	0.91	0.20	1.11
1/13/11 11:00 PM	0.94	0.22	1.16
1/14/11 2:00 AM	0.96	0.21	1.17
1/14/11 5:00 AM	0.98	0.42	1.40
1/14/11 8:00 AM	0.95	0.38	1.32
1/14/11 11:00 AM	0.87	0.34	1.21
1/14/11 2:00 PM	0.78	0.32	1.10
1/14/11 5:00 PM	0.76	0.31	1.06
1/14/11 8:00 PM	0.85	0.25	1.11
1/14/11 11:00 PM	0.88	0.17	1.05
1/15/11 2:00 AM	0.89	0.07	0.96
1/15/11 5:00 AM	0.93	0.08	1.01
1/15/11 8:00 AM	0.96	0.39	1.34
1/15/11 11:00 AM	0.91	0.18	1.09
1/15/11 2:00 PM	0.88	0.09	0.98
1/15/11 5:00 PM	0.95	0.33	1.28
1/15/11 8:00 PM	0.97	0.63	1.60
1/15/11 11:00 PM	1.00	0.64	1.64
1/16/11 2:00 AM	1.09	0.47	1.56
1/16/11 5:00 AM	1.14	0.36	1.51
1/16/11 8:00 AM	1.13	0.33	1.45
1/16/11 11:00 AM	1.04	0.34	1.37
1/16/11 2:00 PM	0.95	0.28	1.24
1/16/11 5:00 PM	0.90	0.24	1.14
1/16/11 8:00 PM	0.96	0.18	1.14
1/16/11 11:00 PM	0.99	0.08	1.07
1/17/11 2:00 AM	1.02	0.10	1.12
1/17/11 5:00 AM	0.98	0.14	1.12
1/17/11 8:00 AM	0.90	0.52	1.42
1/17/11 11:00 AM	0.74	0.38	1.13
1/17/11 2:00 PM	0.86	0.33	1.20
1/17/11 5:00 PM	0.53	0.26	0.79
1/17/11 8:00 PM	0.24	0.23	0.47
1/17/11 11:00 PM	0.24	0.12	0.36
1/18/11 2:00 AM	0.27	0.05	0.32
1/18/11 5:00 AM	0.34	0.07	0.41
1/18/11 8:00 AM	0.44	0.26	0.70
1/18/11 11:00 AM	0.50	0.25	0.74
1/18/11 2:00 PM	0.48	0.23	0.71
1/18/11 5:00 PM	0.54	0.23	0.77
1/18/11 8:00 PM	0.51	0.22	0.72
1/18/11 11:00 PM	0.54	0.14	0.68
1/19/11 2:00 AM	0.49	0.09	0.58
1/19/11 5:00 AM	0.46	0.10	0.56
1/19/11 8:00 AM	0.47	0.35	0.82
1/19/11 11:00 AM	0.48	0.18	0.66
1/19/11 2:00 PM	0.52	0.22	0.74
1/19/11 5:00 PM	0.52	0.26	0.78
1/19/11 8:00 PM	0.49	0.40	0.89
1/19/11 11:00 PM	0.46	0.27	0.73
1/20/11 2:00 AM	0.46	0.13	0.59
1/20/11 5:00 AM	0.45	0.18	0.63

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
1/20/11 8:00 AM	0.45	0.41	0.86
1/20/11 11:00 AM	0.47	0.41	0.88
1/20/11 2:00 PM	0.46	0.38	0.84
1/20/11 5:00 PM	0.35	0.39	0.75
1/20/11 8:00 PM	0.31	0.38	0.69
1/20/11 11:00 PM	0.30	0.32	0.63
1/21/11 2:00 AM	0.18	0.11	0.29
1/21/11 5:00 AM	0.21	0.14	0.35
1/21/11 8:00 AM	0.32	0.22	0.54
1/21/11 11:00 AM	0.32	0.30	0.62
1/21/11 2:00 PM	0.31	0.33	0.65
1/21/11 5:00 PM	0.30	0.28	0.58
1/21/11 8:00 PM	0.29	0.27	0.56
1/21/11 11:00 PM	0.30	0.25	0.56
1/22/11 2:00 AM	0.25	0.14	0.39
1/22/11 5:00 AM	0.20	0.15	0.35
1/22/11 8:00 AM	0.25	0.38	0.63
1/22/11 11:00 AM	0.36	0.44	0.80
1/22/11 2:00 PM	0.64	0.29	0.93
1/22/11 5:00 PM	0.85	0.21	1.06
1/22/11 8:00 PM	0.69	0.17	0.86
1/22/11 11:00 PM	0.60	0.06	0.66
1/23/11 2:00 AM	0.55	0.00	0.55
1/23/11 5:00 AM	0.53	0.00	0.53
1/23/11 8:00 AM	0.57	0.00	0.57
1/23/11 11:00 AM	0.66	0.00	0.66
1/23/11 2:00 PM	0.66	0.00	0.66
1/23/11 5:00 PM	0.62	0.00	0.62
1/23/11 8:00 PM	0.46	0.00	0.46
1/23/11 11:00 PM	0.41	0.00	0.41
1/24/11 2:00 AM	0.51	0.00	0.51
1/24/11 5:00 AM	0.32	0.00	0.32
1/24/11 8:00 AM	0.28	0.00	0.28
1/24/11 11:00 AM	0.31	0.00	0.31
1/24/11 2:00 PM	0.36	0.00	0.36
1/24/11 5:00 PM	0.31	0.00	0.31
1/24/11 8:00 PM	0.21	0.00	0.21
1/24/11 11:00 PM	0.27	0.00	0.27
1/25/11 2:00 AM	0.62	0.00	0.62
1/25/11 5:00 AM	0.51	0.00	0.51
1/25/11 8:00 AM	0.67	0.00	0.67
1/25/11 11:00 AM	0.41	0.00	0.41
1/25/11 2:00 PM	0.14	0.00	0.14
1/25/11 5:00 PM	0.16	0.00	0.16
1/25/11 8:00 PM	0.05	0.00	0.05
1/25/11 11:00 PM	0.11	0.00	0.11
1/26/11 2:00 AM	0.20	0.00	0.20
1/26/11 5:00 AM	0.19	0.00	0.19
1/26/11 8:00 AM	0.20	0.00	0.20
1/26/11 11:00 AM	0.22	0.00	0.22
1/26/11 2:00 PM	0.22	0.00	0.22
1/26/11 5:00 PM	0.21	0.00	0.21
1/26/11 8:00 PM	0.21	0.00	0.21
1/26/11 11:00 PM	0.21	0.00	0.21

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
1/27/11 2:00 AM	0.22	0.00	0.22
1/27/11 5:00 AM	0.22	0.00	0.22
1/27/11 8:00 AM	0.22	0.00	0.22
1/27/11 11:00 AM	0.27	0.00	0.27
1/27/11 2:00 PM	0.22	0.00	0.22
1/27/11 5:00 PM	0.21	0.00	0.21
1/27/11 8:00 PM	0.22	0.01	0.23
1/27/11 11:00 PM	0.17	0.61	0.78
1/28/11 2:00 AM	0.15	0.26	0.40
1/28/11 5:00 AM	0.18	0.30	0.48
1/28/11 8:00 AM	0.21	0.32	0.54
1/28/11 11:00 AM	0.24	0.32	0.56
1/28/11 2:00 PM	0.20	0.27	0.47
1/28/11 5:00 PM	0.24	0.25	0.48
1/28/11 8:00 PM	0.25	0.24	0.49
1/28/11 11:00 PM	0.21	0.27	0.48
1/29/11 2:00 AM	0.15	0.26	0.41
1/29/11 5:00 AM	0.18	0.27	0.45
1/29/11 8:00 AM	0.20	0.29	0.49
1/29/11 11:00 AM	0.19	0.25	0.44
1/29/11 2:00 PM	0.21	0.18	0.39
1/29/11 5:00 PM	0.23	0.05	0.28
1/29/11 8:00 PM	0.23	0.09	0.32
1/29/11 11:00 PM	0.25	0.22	0.47
1/30/11 2:00 AM	0.25	0.23	0.48
1/30/11 5:00 AM	0.17	0.24	0.41
1/30/11 8:00 AM	0.20	0.26	0.46
1/30/11 11:00 AM	0.16	0.26	0.42
1/30/11 2:00 PM	0.17	0.26	0.43
1/30/11 5:00 PM	0.17	0.27	0.44
1/30/11 8:00 PM	0.17	0.26	0.44
1/30/11 11:00 PM	0.17	0.22	0.38
1/31/11 2:00 AM	0.16	0.23	0.39
1/31/11 5:00 AM	0.17	0.24	0.41
1/31/11 8:00 AM	0.28	0.26	0.54
1/31/11 11:00 AM	0.29	0.25	0.55
1/31/11 2:00 PM	0.28	0.26	0.54
1/31/11 5:00 PM	0.37	0.30	0.67
1/31/11 8:00 PM	0.38	0.31	0.69
1/31/11 11:00 PM	0.25	0.30	0.55
2/1/11 2:00 AM	0.11	0.29	0.40
2/1/11 5:00 AM	0.13	0.26	0.39
2/1/11 8:00 AM	0.30	0.25	0.55
2/1/11 11:00 AM	0.32	0.29	0.61
2/1/11 2:00 PM	0.27	0.32	0.58
2/1/11 5:00 PM	0.27	0.31	0.58
2/1/11 8:00 PM	0.32	0.29	0.61
2/1/11 11:00 PM	0.45	0.24	0.69
2/2/11 2:00 AM	0.43	0.05	0.48
2/2/11 5:00 AM	0.41	0.02	0.42
2/2/11 8:00 AM	1.04	0.11	1.15
2/2/11 11:00 AM	1.04	0.14	1.18
2/2/11 2:00 PM	0.94	0.13	1.07
2/2/11 5:00 PM	0.82	0.16	0.98

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
2/2/11 8:00 PM	0.78	0.18	0.96
2/2/11 11:00 PM	0.44	0.16	0.60
2/3/11 2:00 AM	0.38	0.17	0.55
2/3/11 5:00 AM	0.38	0.23	0.60
2/3/11 8:00 AM	0.48	0.39	0.87
2/3/11 11:00 AM	0.80	0.40	1.19
2/3/11 2:00 PM	1.13	0.39	1.52
2/3/11 5:00 PM	0.76	0.39	1.15
2/3/11 8:00 PM	0.78	0.39	1.16
2/3/11 11:00 PM	0.58	0.38	0.95
2/4/11 2:00 AM	0.23	0.38	0.61
2/4/11 5:00 AM	0.24	0.39	0.62
2/4/11 8:00 AM	0.29	0.37	0.66
2/4/11 11:00 AM	0.66	0.38	1.04
2/4/11 2:00 PM	4.27	0.38	4.65
2/4/11 5:00 PM	3.56	0.40	3.96
2/4/11 8:00 PM	1.06	0.39	1.45
2/4/11 11:00 PM	0.80	0.20	1.00
2/5/11 2:00 AM	0.36	0.11	0.47
2/5/11 5:00 AM	0.33	0.11	0.44
2/5/11 8:00 AM	0.35	0.22	0.57
2/5/11 11:00 AM	0.81	0.30	1.11
2/5/11 2:00 PM	1.08	0.29	1.38
2/5/11 5:00 PM	1.13	0.29	1.42
2/5/11 8:00 PM	1.07	0.29	1.36
2/5/11 11:00 PM	0.46	0.30	0.76
2/6/11 2:00 AM	0.40	0.20	0.61
2/6/11 5:00 AM	0.39	0.18	0.57
2/6/11 8:00 AM	0.49	0.21	0.70
2/6/11 11:00 AM	0.61	0.31	0.91
2/6/11 2:00 PM	0.52	0.31	0.83
2/6/11 5:00 PM	0.68	0.30	0.97
2/6/11 8:00 PM	1.29	0.27	1.56
2/6/11 11:00 PM	1.25	0.27	1.52
2/7/11 2:00 AM	0.74	0.19	0.93
2/7/11 5:00 AM	0.56	0.25	0.81
2/7/11 8:00 AM	1.08	0.26	1.35
2/7/11 11:00 AM	0.55	0.28	0.84
2/7/11 2:00 PM	0.15	0.30	0.45
2/7/11 5:00 PM	0.17	0.30	0.46
2/7/11 8:00 PM	0.30	0.31	0.62
2/7/11 11:00 PM	0.31	0.33	0.64
2/8/11 2:00 AM	0.31	0.35	0.66
2/8/11 5:00 AM	0.31	0.37	0.68
2/8/11 8:00 AM	0.30	0.39	0.69
2/8/11 11:00 AM	0.29	0.38	0.67
2/8/11 2:00 PM	0.27	0.37	0.64
2/8/11 5:00 PM	0.27	0.37	0.64
2/8/11 8:00 PM	0.30	0.36	0.66
2/8/11 11:00 PM	0.31	0.35	0.67
2/9/11 2:00 AM	0.26	0.41	0.67
2/9/11 5:00 AM	0.27	0.40	0.66
2/9/11 8:00 AM	0.26	0.41	0.67
2/9/11 11:00 AM	0.29	0.41	0.70

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
2/9/11 2:00 PM	0.27	1.03	1.30
2/9/11 5:00 PM	0.26	0.62	0.88
2/9/11 8:00 PM	0.26	0.36	0.62
2/9/11 11:00 PM	0.22	0.35	0.57
2/10/11 2:00 AM	0.14	0.34	0.48
2/10/11 5:00 AM	0.15	0.36	0.51
2/10/11 8:00 AM	0.27	0.37	0.64
2/10/11 11:00 AM	0.30	0.38	0.68
2/10/11 2:00 PM	0.29	0.40	0.69
2/10/11 5:00 PM	0.30	0.39	0.69
2/10/11 8:00 PM	0.31	0.39	0.69
2/10/11 11:00 PM	0.27	0.32	0.59
2/11/11 2:00 AM	0.24	0.24	0.47
2/11/11 5:00 AM	0.27	0.36	0.62
2/11/11 8:00 AM	0.29	0.40	0.69
2/11/11 11:00 AM	0.28	0.40	0.68
2/11/11 2:00 PM	0.33	0.32	0.65
2/11/11 5:00 PM	0.34	0.35	0.69
2/11/11 8:00 PM	0.31	0.36	0.67
2/11/11 11:00 PM	0.35	0.21	0.56
2/12/11 2:00 AM	0.36	0.06	0.42
2/12/11 5:00 AM	0.38	0.04	0.42
2/12/11 8:00 AM	0.38	0.29	0.67
2/12/11 11:00 AM	0.38	0.43	0.81
2/12/11 2:00 PM	0.41	0.39	0.80
2/12/11 5:00 PM	0.42	0.42	0.84
2/12/11 8:00 PM	0.41	0.41	0.82
2/12/11 11:00 PM	0.43	0.40	0.84
2/13/11 2:00 AM	0.42	0.40	0.81
2/13/11 5:00 AM	0.40	0.40	0.80
2/13/11 8:00 AM	0.40	0.40	0.80
2/13/11 11:00 AM	0.27	0.40	0.67
2/13/11 2:00 PM	0.18	0.41	0.59
2/13/11 5:00 PM	0.18	0.42	0.60
2/13/11 8:00 PM	0.19	0.42	0.61
2/13/11 11:00 PM	0.17	0.43	0.61
2/14/11 2:00 AM	0.16	0.44	0.61
2/14/11 5:00 AM	0.17	0.44	0.61
2/14/11 8:00 AM	0.38	0.42	0.80
2/14/11 11:00 AM	0.51	0.41	0.92
2/14/11 2:00 PM	0.50	0.42	0.92
2/14/11 5:00 PM	0.50	0.42	0.92
2/14/11 8:00 PM	0.50	0.43	0.93
2/14/11 11:00 PM	0.49	0.44	0.93
2/15/11 2:00 AM	0.50	0.45	0.94
2/15/11 5:00 AM	0.51	0.45	0.96
2/15/11 8:00 AM	0.50	0.46	0.96
2/15/11 11:00 AM	0.47	0.49	0.96
2/15/11 2:00 PM	0.48	0.49	0.97
2/15/11 5:00 PM	0.47	0.47	0.93
2/15/11 8:00 PM	0.49	0.49	0.98
2/15/11 11:00 PM	0.50	0.45	0.95
2/16/11 2:00 AM	0.48	0.38	0.86
2/16/11 5:00 AM	0.47	0.45	0.92

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
2/16/11 8:00 AM	0.50	0.50	0.99
2/16/11 11:00 AM	0.44	0.50	0.94
2/16/11 2:00 PM	0.45	0.50	0.94
2/16/11 5:00 PM	0.46	0.30	0.77
2/16/11 8:00 PM	0.49	0.19	0.68
2/16/11 11:00 PM	0.49	0.20	0.69
2/17/11 2:00 AM	0.46	0.25	0.71
2/17/11 5:00 AM	0.46	0.20	0.66
2/17/11 8:00 AM	0.50	0.54	1.03
2/17/11 11:00 AM	0.48	0.49	0.97
2/17/11 2:00 PM	0.45	0.43	0.88
2/17/11 5:00 PM	0.47	0.48	0.95
2/17/11 8:00 PM	0.51	0.49	1.00
2/17/11 11:00 PM	0.51	0.44	0.95
2/18/11 2:00 AM	0.37	0.26	0.63
2/18/11 5:00 AM	0.34	0.41	0.74
2/18/11 8:00 AM	0.48	0.55	1.03
2/18/11 11:00 AM	0.44	0.61	1.05
2/18/11 2:00 PM	0.45	0.42	0.87
2/18/11 5:00 PM	0.22	0.42	0.64
2/18/11 8:00 PM	0.04	0.40	0.44
2/18/11 11:00 PM	0.00	0.39	0.39
2/19/11 2:00 AM	0.00	0.26	0.26
2/19/11 5:00 AM	0.00	0.39	0.39
2/19/11 8:00 AM	0.00	0.40	0.40
2/19/11 11:00 AM	0.00	0.40	0.40
2/19/11 2:00 PM	0.00	0.37	0.37
2/19/11 5:00 PM	0.00	0.35	0.35
2/19/11 8:00 PM	0.00	0.33	0.33
2/19/11 11:00 PM	0.00	0.30	0.30
2/20/11 2:00 AM	0.00	0.28	0.28
2/20/11 5:00 AM	0.00	0.23	0.23
2/20/11 8:00 AM	0.00	0.30	0.30
2/20/11 11:00 AM	0.00	0.31	0.31
2/20/11 2:00 PM	0.00	0.33	0.33
2/20/11 5:00 PM	0.00	0.33	0.33
2/20/11 8:00 PM	0.00	0.32	0.32
2/20/11 11:00 PM	0.00	0.29	0.29
2/21/11 2:00 AM	0.00	0.16	0.16
2/21/11 5:00 AM	0.00	0.24	0.24
2/21/11 8:00 AM	0.00	0.32	0.32
2/21/11 11:00 AM	0.00	0.29	0.29
2/21/11 2:00 PM	0.00	0.29	0.29
2/21/11 5:00 PM	0.00	0.30	0.30
2/21/11 8:00 PM	0.00	0.30	0.30
2/21/11 11:00 PM	0.00	0.32	0.32
2/22/11 2:00 AM	0.00	0.32	0.32
2/22/11 5:00 AM	0.00	0.35	0.35
2/22/11 8:00 AM	0.00	0.36	0.36
2/22/11 11:00 AM	0.00	0.37	0.37
2/22/11 2:00 PM	0.00	0.37	0.37
2/22/11 5:00 PM	0.00	0.39	0.39
2/22/11 8:00 PM	0.00	0.41	0.41
2/22/11 11:00 PM	0.00	0.41	0.41

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
2/23/11 2:00 AM	0.00	0.43	0.43
2/23/11 5:00 AM	0.00	0.45	0.45
2/23/11 8:00 AM	0.00	0.47	0.47
2/23/11 11:00 AM	0.00	0.35	0.35
2/23/11 2:00 PM	0.00	0.36	0.36
2/23/11 5:00 PM	0.00	0.36	0.36
2/23/11 8:00 PM	0.00	0.38	0.38
2/23/11 11:00 PM	0.00	0.39	0.39
2/24/11 2:00 AM	0.00	0.40	0.40
2/24/11 5:00 AM	0.00	0.37	0.37
2/24/11 8:00 AM	0.00	0.45	0.45
2/24/11 11:00 AM	0.00	0.46	0.46
2/24/11 2:00 PM	0.00	0.38	0.38
2/24/11 5:00 PM	0.00	0.42	0.42
2/24/11 8:00 PM	0.00	0.45	0.45
2/24/11 11:00 PM	0.00	0.46	0.46
2/25/11 2:00 AM	0.00	0.46	0.46
2/25/11 5:00 AM	0.00	0.47	0.47
2/25/11 8:00 AM	0.00	0.55	0.55
2/25/11 11:00 AM	0.00	0.54	0.54
2/25/11 2:00 PM	0.00	0.57	0.57
2/25/11 5:00 PM	0.00	0.56	0.56
2/25/11 8:00 PM	0.00	0.32	0.32
2/25/11 11:00 PM	0.00	0.21	0.21
2/26/11 2:00 AM	0.00	0.26	0.26
2/26/11 5:00 AM	0.00	0.25	0.25
2/26/11 8:00 AM	0.00	0.26	0.26
2/26/11 11:00 AM	0.00	0.25	0.25
2/26/11 2:00 PM	0.00	0.25	0.25
2/26/11 5:00 PM	0.00	0.27	0.27
2/26/11 8:00 PM	0.00	0.27	0.27
2/26/11 11:00 PM	0.00	0.28	0.28
2/27/11 2:00 AM	0.00	0.30	0.30
2/27/11 5:00 AM	0.00	0.24	0.24
2/27/11 8:00 AM	0.00	0.32	0.32
2/27/11 11:00 AM	0.00	0.52	0.52
2/27/11 2:00 PM	0.00	0.49	0.49
2/27/11 5:00 PM	0.00	0.43	0.43
2/27/11 8:00 PM	0.00	0.45	0.45
2/27/11 11:00 PM	0.00	0.42	0.42
2/28/11 2:00 AM	0.00	0.48	0.48
2/28/11 5:00 AM	0.00	0.51	0.51
2/28/11 8:00 AM	0.00	0.45	0.45
2/28/11 11:00 AM	0.00	0.44	0.44
2/28/11 2:00 PM	0.00	0.50	0.50
2/28/11 5:00 PM	0.00	0.51	0.51
2/28/11 8:00 PM	0.00	0.53	0.53
2/28/11 11:00 PM	0.00	0.43	0.43
3/1/11 2:00 AM	0.00	0.42	0.42
3/1/11 5:00 AM	0.00	0.44	0.44
3/1/11 8:00 AM	0.00	0.52	0.52
3/1/11 11:00 AM	0.00	0.56	0.56
3/1/11 2:00 PM	0.00	0.53	0.53
3/1/11 5:00 PM	0.00	0.53	0.53

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
3/1/11 8:00 PM	0.00	0.55	0.55
3/1/11 11:00 PM	0.00	0.20	0.20
3/2/11 2:00 AM	0.00	0.24	0.24
3/2/11 5:00 AM	0.00	0.24	0.24
3/2/11 8:00 AM	0.00	0.45	0.45
3/2/11 11:00 AM	0.00	0.24	0.24
3/2/11 2:00 PM	0.00	0.32	0.32
3/2/11 5:00 PM	0.00	0.59	0.59
3/2/11 8:00 PM	0.00	0.57	0.57
3/2/11 11:00 PM	0.00	0.51	0.51
3/3/11 2:00 AM	0.00	0.52	0.52
3/3/11 5:00 AM	0.00	0.53	0.53
3/3/11 8:00 AM	0.00	0.58	0.58
3/3/11 11:00 AM	0.00	0.58	0.58
3/3/11 2:00 PM	0.00	0.57	0.57
3/3/11 5:00 PM	0.00	0.60	0.60
3/3/11 8:00 PM	0.00	0.60	0.60
3/3/11 11:00 PM	0.00	0.57	0.57
3/4/11 2:00 AM	0.00	0.48	0.48
3/4/11 5:00 AM	0.00	0.50	0.50
3/4/11 8:00 AM	0.00	0.54	0.55
3/4/11 11:00 AM	0.02	0.48	0.50
3/4/11 2:00 PM	0.00	0.59	0.59
3/4/11 5:00 PM	0.05	0.52	0.57
3/4/11 8:00 PM	0.18	0.49	0.67
3/4/11 11:00 PM	0.44	0.39	0.83
3/5/11 2:00 AM	0.34	0.28	0.63
3/5/11 5:00 AM	0.29	0.26	0.54
3/5/11 8:00 AM	0.29	0.37	0.66
3/5/11 11:00 AM	0.46	0.48	0.94
3/5/11 2:00 PM	0.57	0.47	1.04
3/5/11 5:00 PM	0.14	0.48	0.63
3/5/11 8:00 PM	0.20	0.47	0.67
3/5/11 11:00 PM	0.49	0.51	1.00
3/6/11 2:00 AM	0.41	0.52	0.94
3/6/11 5:00 AM	0.34	0.05	0.39
3/6/11 8:00 AM	0.50	0.00	0.50
3/6/11 11:00 AM	0.42	0.00	0.42
3/6/11 2:00 PM	0.36	0.00	0.36
3/6/11 5:00 PM	0.38	0.00	0.38
3/6/11 8:00 PM	0.39	0.00	0.39
3/6/11 11:00 PM	0.38	0.00	0.38
3/7/11 2:00 AM	0.34	0.00	0.34
3/7/11 5:00 AM	0.35	0.00	0.35
3/7/11 8:00 AM	0.37	0.00	0.37
3/7/11 11:00 AM	0.38	0.00	0.38
3/7/11 2:00 PM	0.40	0.00	0.40
3/7/11 5:00 PM	0.38	0.00	0.38
3/7/11 8:00 PM	0.36	0.00	0.36
3/7/11 11:00 PM	0.34	0.00	0.34
3/8/11 2:00 AM	0.32	0.00	0.32
3/8/11 5:00 AM	0.31	0.00	0.31
3/8/11 8:00 AM	0.31	0.00	0.31
3/8/11 11:00 AM	0.32	0.00	0.32

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
3/8/11 2:00 PM	0.29	0.00	0.29
3/8/11 5:00 PM	0.21	0.00	0.21
3/8/11 8:00 PM	0.16	0.00	0.16
3/8/11 11:00 PM	0.15	0.00	0.15
3/9/11 2:00 AM	0.08	0.00	0.08
3/9/11 5:00 AM	0.09	0.00	0.09
3/9/11 8:00 AM	0.16	0.00	0.16
3/9/11 11:00 AM	0.15	0.00	0.15
3/9/11 2:00 PM	0.23	0.00	0.23
3/9/11 5:00 PM	0.24	0.00	0.24
3/9/11 8:00 PM	0.16	0.00	0.16
3/9/11 11:00 PM	0.00	0.00	0.00
3/10/11 2:00 AM	0.00	0.00	0.00
3/10/11 5:00 AM	0.00	0.00	0.00
3/10/11 8:00 AM	0.00	0.00	0.00
3/10/11 11:00 AM	0.00	0.00	0.00
3/10/11 2:00 PM	0.00	0.00	0.00
3/10/11 5:00 PM	0.00	0.00	0.00
3/10/11 8:00 PM	0.00	0.00	0.00
3/10/11 11:00 PM	0.00	0.00	0.00
3/11/11 2:00 AM	0.00	0.00	0.00
3/11/11 5:00 AM	0.00	0.00	0.00
3/11/11 8:00 AM	0.00	0.00	0.00
3/11/11 11:00 AM	0.00	0.00	0.00
3/11/11 2:00 PM	0.00	0.00	0.00
3/11/11 5:00 PM	0.00	0.00	0.00
3/11/11 8:00 PM	0.00	0.00	0.00
3/11/11 11:00 PM	0.00	0.00	0.00
3/12/11 2:00 AM	0.00	0.00	0.00
3/12/11 5:00 AM	0.00	0.00	0.00
3/12/11 8:00 AM	0.00	0.00	0.00
3/12/11 11:00 AM	0.00	0.00	0.00
3/12/11 2:00 PM	0.00	0.00	0.00
3/12/11 5:00 PM	0.00	0.00	0.00
3/12/11 8:00 PM	0.00	0.00	0.00
3/12/11 11:00 PM	0.00	0.00	0.00
3/13/11 2:00 AM	0.00	0.00	0.00
3/13/11 5:00 AM	0.00	0.00	0.00
3/13/11 8:00 AM	0.00	0.00	0.00
3/13/11 11:00 AM	0.00	0.00	0.00
3/13/11 2:00 PM	0.00	0.00	0.00
3/13/11 5:00 PM	0.00	0.00	0.00
3/13/11 8:00 PM	0.00	0.00	0.00
3/13/11 11:00 PM	0.00	0.00	0.00
3/14/11 2:00 AM	0.00	0.00	0.00
3/14/11 5:00 AM	0.00	0.00	0.00
3/14/11 8:00 AM	0.00	0.00	0.00
3/14/11 11:00 AM	0.00	0.00	0.00
3/14/11 2:00 PM	0.00	0.00	0.00
3/14/11 5:00 PM	0.00	0.00	0.00
3/14/11 8:00 PM	0.00	0.00	0.00
3/14/11 11:00 PM	0.00	0.00	0.00
3/15/11 2:00 AM	0.00	0.00	0.00
3/15/11 5:00 AM	0.00	0.00	0.00

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
3/15/11 8:00 AM	0.00	0.00	0.00
3/15/11 11:00 AM	0.00	0.00	0.00
3/15/11 2:00 PM	0.00	0.00	0.00
3/15/11 5:00 PM	0.05	0.00	0.05
3/15/11 8:00 PM	0.21	0.00	0.21
3/15/11 11:00 PM	0.12	0.00	0.12
3/16/11 2:00 AM	0.00	0.00	0.00
3/16/11 5:00 AM	0.00	0.00	0.00
3/16/11 8:00 AM	0.19	0.00	0.19
3/16/11 11:00 AM	0.24	0.00	0.24
3/16/11 2:00 PM	0.26	0.00	0.26
3/16/11 5:00 PM	0.28	0.00	0.28
3/16/11 8:00 PM	0.26	0.00	0.26
3/16/11 11:00 PM	0.28	0.00	0.28
3/17/11 2:00 AM	0.30	0.00	0.30
3/17/11 5:00 AM	0.35	0.00	0.35
3/17/11 8:00 AM	0.47	0.00	0.47
3/17/11 11:00 AM	0.57	0.00	0.57
3/17/11 2:00 PM	0.64	0.00	0.64
3/17/11 5:00 PM	0.78	0.00	0.78
3/17/11 8:00 PM	0.79	0.00	0.79
3/17/11 11:00 PM	0.73	0.00	0.73
3/18/11 2:00 AM	0.73	0.00	0.73
3/18/11 5:00 AM	0.73	0.00	0.73
3/18/11 8:00 AM	1.59	0.00	1.59
3/18/11 11:00 AM	1.33	0.00	1.33
3/18/11 2:00 PM	1.21	0.00	1.21
3/18/11 5:00 PM	0.29	0.00	0.29
3/18/11 8:00 PM	0.22	0.00	0.22
3/18/11 11:00 PM	0.27	0.00	0.27
3/19/11 2:00 AM	0.30	0.00	0.30
3/19/11 5:00 AM	0.27	0.05	0.32
3/19/11 8:00 AM	0.25	0.31	0.56
3/19/11 11:00 AM	0.41	0.44	0.84
3/19/11 2:00 PM	0.71	0.32	1.02
3/19/11 5:00 PM	0.76	0.24	1.00
3/19/11 8:00 PM	0.78	0.23	1.01
3/19/11 11:00 PM	0.74	0.17	0.91
3/20/11 2:00 AM	0.62	0.06	0.67
3/20/11 5:00 AM	0.54	0.07	0.61
3/20/11 8:00 AM	0.80	0.22	1.02
3/20/11 11:00 AM	1.03	0.20	1.23
3/20/11 2:00 PM	0.94	0.25	1.18
3/20/11 5:00 PM	1.04	0.22	1.26
3/20/11 8:00 PM	0.65	0.20	0.84
3/20/11 11:00 PM	0.51	0.15	0.66
3/21/11 2:00 AM	0.45	0.09	0.54
3/21/11 5:00 AM	0.56	0.16	0.71
3/21/11 8:00 AM	1.34	0.24	1.59
3/21/11 11:00 AM	1.38	0.26	1.64
3/21/11 2:00 PM	1.13	0.25	1.38
3/21/11 5:00 PM	0.95	0.26	1.21
3/21/11 8:00 PM	0.90	0.26	1.16
3/21/11 11:00 PM	0.38	0.20	0.59

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
3/22/11 2:00 AM	0.23	0.13	0.36
3/22/11 5:00 AM	0.36	0.08	0.44
3/22/11 8:00 AM	0.72	0.27	0.99
3/22/11 11:00 AM	0.29	0.33	0.63
3/22/11 2:00 PM	0.24	0.36	0.61
3/22/11 5:00 PM	0.26	0.37	0.63
3/22/11 8:00 PM	0.36	0.38	0.74
3/22/11 11:00 PM	0.22	0.34	0.56
3/23/11 2:00 AM	0.17	0.33	0.50
3/23/11 5:00 AM	0.18	0.36	0.54
3/23/11 8:00 AM	0.33	0.36	0.69
3/23/11 11:00 AM	0.34	0.42	0.76
3/23/11 2:00 PM	0.39	0.41	0.79
3/23/11 5:00 PM	0.57	0.38	0.95
3/23/11 8:00 PM	0.71	0.39	1.10
3/23/11 11:00 PM	0.74	0.06	0.80
3/24/11 2:00 AM	0.75	0.06	0.81
3/24/11 5:00 AM	0.69	0.26	0.95
3/24/11 8:00 AM	0.68	0.60	1.28
3/24/11 11:00 AM	0.77	0.32	1.09
3/24/11 2:00 PM	0.69	0.31	0.99
3/24/11 5:00 PM	0.72	0.33	1.05
3/24/11 8:00 PM	0.76	0.37	1.14
3/24/11 11:00 PM	0.81	0.20	1.01
3/25/11 2:00 AM	0.80	0.10	0.91
3/25/11 5:00 AM	0.82	0.12	0.94
3/25/11 8:00 AM	0.87	0.47	1.34
3/25/11 11:00 AM	0.88	0.43	1.31
3/25/11 2:00 PM	0.95	0.47	1.42
3/25/11 5:00 PM	0.97	0.38	1.34
3/25/11 8:00 PM	0.90	0.39	1.29
3/25/11 11:00 PM	0.90	0.27	1.17
3/26/11 2:00 AM	0.84	0.32	1.16
3/26/11 5:00 AM	0.71	0.25	0.96
3/26/11 8:00 AM	0.92	0.33	1.25
3/26/11 11:00 AM	0.88	0.44	1.32
3/26/11 2:00 PM	0.86	0.38	1.24
3/26/11 5:00 PM	0.47	0.32	0.78
3/26/11 8:00 PM	0.79	0.27	1.06
3/26/11 11:00 PM	0.73	0.28	1.01
3/27/11 2:00 AM	0.82	0.05	0.87
3/27/11 5:00 AM	0.75	0.00	0.75
3/27/11 8:00 AM	0.71	0.00	0.71
3/27/11 11:00 AM	0.72	0.00	0.72
3/27/11 2:00 PM	0.75	0.00	0.75
3/27/11 5:00 PM	0.68	0.00	0.68
3/27/11 8:00 PM	0.63	0.00	0.63
3/27/11 11:00 PM	0.65	0.00	0.65
3/28/11 2:00 AM	0.49	0.00	0.49
3/28/11 5:00 AM	0.67	0.00	0.67
3/28/11 8:00 AM	0.63	0.00	0.63
3/28/11 11:00 AM	0.68	0.00	0.68
3/28/11 2:00 PM	0.66	0.00	0.66
3/28/11 5:00 PM	0.66	0.00	0.66

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
3/28/11 8:00 PM	0.64	0.00	0.64
3/28/11 11:00 PM	0.62	0.00	0.62
3/29/11 2:00 AM	0.61	0.00	0.61
3/29/11 5:00 AM	0.61	0.00	0.61
3/29/11 8:00 AM	0.24	0.00	0.24
3/29/11 11:00 AM	0.25	0.00	0.25
3/29/11 2:00 PM	0.21	0.00	0.21
3/29/11 5:00 PM	0.20	0.00	0.20
3/29/11 8:00 PM	0.30	0.00	0.30
3/29/11 11:00 PM	0.67	0.00	0.67
3/30/11 2:00 AM	0.57	0.00	0.57
3/30/11 5:00 AM	0.37	0.00	0.37
3/30/11 8:00 AM	0.33	0.00	0.33
3/30/11 11:00 AM	0.25	0.00	0.25
3/30/11 2:00 PM	0.30	0.00	0.30
3/30/11 5:00 PM	0.33	0.00	0.33
3/30/11 8:00 PM	0.63	0.00	0.63
3/30/11 11:00 PM	0.72	0.04	0.76
3/31/11 2:00 AM	0.72	0.20	0.92
3/31/11 5:00 AM	0.80	0.30	1.10
3/31/11 8:00 AM	0.83	0.29	1.13
3/31/11 11:00 AM	0.79	0.34	1.13
3/31/11 2:00 PM	0.59	0.26	0.84
3/31/11 5:00 PM	0.83	0.32	1.15
3/31/11 8:00 PM	0.78	0.33	1.11
3/31/11 11:00 PM	0.81	0.24	1.05
4/1/11 2:00 AM	0.79	0.26	1.05
4/1/11 5:00 AM	0.70	0.19	0.89
4/1/11 8:00 AM	0.76	0.14	0.90
4/1/11 11:00 AM	0.75	0.20	0.95
4/1/11 2:00 PM	0.67	0.18	0.85
4/1/11 5:00 PM	0.67	0.23	0.90
4/1/11 8:00 PM	0.72	0.22	0.94
4/1/11 11:00 PM	0.76	0.16	0.93
4/2/11 2:00 AM	0.73	0.18	0.91
4/2/11 5:00 AM	0.77	0.15	0.91
4/2/11 8:00 AM	0.73	0.22	0.95
4/2/11 11:00 AM	0.64	0.19	0.83
4/2/11 2:00 PM	0.55	0.20	0.75
4/2/11 5:00 PM	0.40	0.19	0.59
4/2/11 8:00 PM	0.64	0.18	0.82
4/2/11 11:00 PM	0.54	0.16	0.70
4/3/11 2:00 AM	0.38	0.24	0.62
4/3/11 5:00 AM	0.33	0.23	0.56
4/3/11 8:00 AM	0.47	0.23	0.70
4/3/11 11:00 AM	0.67	0.23	0.89
4/3/11 2:00 PM	0.65	0.20	0.86
4/3/11 5:00 PM	0.68	0.21	0.90
4/3/11 8:00 PM	0.67	0.23	0.90
4/3/11 11:00 PM	0.68	0.22	0.90
4/4/11 2:00 AM	0.80	0.20	1.01
4/4/11 5:00 AM	0.78	0.23	1.01
4/4/11 8:00 AM	0.80	0.22	1.02
4/4/11 11:00 AM	0.68	0.23	0.91

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
4/4/11 2:00 PM	0.71	0.23	0.94
4/4/11 5:00 PM	0.57	0.24	0.81
4/4/11 8:00 PM	0.58	0.25	0.83
4/4/11 11:00 PM	0.65	0.25	0.90
4/5/11 2:00 AM	0.55	0.26	0.81
4/5/11 5:00 AM	0.50	0.28	0.78
4/5/11 8:00 AM	0.54	0.28	0.82
4/5/11 11:00 AM	0.18	0.29	0.47
4/5/11 2:00 PM	0.49	0.34	0.83
4/5/11 5:00 PM	0.72	0.37	1.10
4/5/11 8:00 PM	0.70	0.33	1.03
4/5/11 11:00 PM	0.44	0.26	0.70
4/6/11 2:00 AM	0.29	0.15	0.45
4/6/11 5:00 AM	0.41	0.38	0.80
4/6/11 8:00 AM	0.77	0.45	1.22
4/6/11 11:00 AM	0.75	0.46	1.22
4/6/11 2:00 PM	0.73	0.46	1.19
4/6/11 5:00 PM	0.76	0.37	1.13
4/6/11 8:00 PM	0.79	0.34	1.13
4/6/11 11:00 PM	0.63	0.34	0.97
4/7/11 2:00 AM	0.38	0.33	0.72
4/7/11 5:00 AM	0.50	0.33	0.84
4/7/11 8:00 AM	0.90	0.36	1.26
4/7/11 11:00 AM	0.99	0.38	1.37
4/7/11 2:00 PM	0.93	0.34	1.26
4/7/11 5:00 PM	0.85	0.25	1.09
4/7/11 8:00 PM	0.91	0.00	0.92
4/7/11 11:00 PM	0.89	0.00	0.89
4/8/11 2:00 AM	0.75	0.00	0.75
4/8/11 5:00 AM	0.79	0.00	0.79
4/8/11 8:00 AM	0.68	0.00	0.68
4/8/11 11:00 AM	0.26	0.00	0.26
4/8/11 2:00 PM	0.30	0.00	0.30
4/8/11 5:00 PM	0.27	0.00	0.27
4/8/11 8:00 PM	0.27	0.00	0.27
4/8/11 11:00 PM	0.28	0.00	0.28
4/9/11 2:00 AM	0.30	0.00	0.30
4/9/11 5:00 AM	0.83	0.00	0.83
4/9/11 8:00 AM	0.94	0.00	0.94
4/9/11 11:00 AM	0.90	0.00	0.90
4/9/11 2:00 PM	0.88	0.00	0.88
4/9/11 5:00 PM	0.88	0.00	0.88
4/9/11 8:00 PM	0.93	0.00	0.93
4/9/11 11:00 PM	0.98	0.00	0.98
4/10/11 2:00 AM	0.99	0.00	0.99
4/10/11 5:00 AM	0.85	0.00	0.85
4/10/11 8:00 AM	0.96	0.00	0.96
4/10/11 11:00 AM	1.16	0.00	1.16
4/10/11 2:00 PM	0.96	0.00	0.96
4/10/11 5:00 PM	1.02	0.00	1.02
4/10/11 8:00 PM	1.00	0.00	1.00
4/10/11 11:00 PM	0.87	0.00	0.87
4/11/11 2:00 AM	0.77	0.00	0.77
4/11/11 5:00 AM	0.88	0.04	0.91

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
4/11/11 8:00 AM	0.86	0.34	1.20
4/11/11 11:00 AM	0.46	0.31	0.76
4/11/11 2:00 PM	0.25	0.31	0.56
4/11/11 5:00 PM	0.29	0.19	0.49
4/11/11 8:00 PM	0.31	0.22	0.53
4/11/11 11:00 PM	0.55	0.25	0.80
4/12/11 2:00 AM	0.86	0.22	1.08
4/12/11 5:00 AM	0.81	0.29	1.11
4/12/11 8:00 AM	0.68	0.24	0.91
4/12/11 11:00 AM	0.27	0.42	0.69
4/12/11 2:00 PM	0.29	0.24	0.54
4/12/11 5:00 PM	0.28	0.28	0.56
4/12/11 8:00 PM	0.28	0.30	0.58
4/12/11 11:00 PM	0.74	0.27	1.01
4/13/11 2:00 AM	0.69	0.27	0.96
4/13/11 5:00 AM	0.60	0.26	0.86
4/13/11 8:00 AM	0.79	0.24	1.03
4/13/11 11:00 AM	0.76	0.23	0.99
4/13/11 2:00 PM	0.72	0.22	0.95
4/13/11 5:00 PM	0.68	0.24	0.92
4/13/11 8:00 PM	0.71	0.24	0.95
4/13/11 11:00 PM	0.56	0.23	0.79
4/14/11 2:00 AM	0.31	0.23	0.54
4/14/11 5:00 AM	0.36	0.24	0.60
4/14/11 8:00 AM	0.41	0.22	0.63
4/14/11 11:00 AM	0.49	0.22	0.71
4/14/11 2:00 PM	0.44	0.27	0.71
4/14/11 5:00 PM	0.47	0.24	0.71
4/14/11 8:00 PM	0.37	0.21	0.58
4/14/11 11:00 PM	0.36	0.22	0.59
4/15/11 2:00 AM	0.35	0.23	0.57
4/15/11 5:00 AM	0.34	0.22	0.56
4/15/11 8:00 AM	0.39	0.26	0.65
4/15/11 11:00 AM	0.50	0.32	0.82
4/15/11 2:00 PM	0.37	0.31	0.68
4/15/11 5:00 PM	0.22	0.29	0.52
4/15/11 8:00 PM	0.24	0.30	0.54
4/15/11 11:00 PM	0.47	0.32	0.79
4/16/11 2:00 AM	0.80	0.33	1.14
4/16/11 5:00 AM	0.86	0.33	1.19
4/16/11 8:00 AM	0.89	0.33	1.22
4/16/11 11:00 AM	0.91	0.35	1.25
4/16/11 2:00 PM	0.93	0.41	1.34
4/16/11 5:00 PM	0.96	0.42	1.38
4/16/11 8:00 PM	1.02	0.42	1.44
4/16/11 11:00 PM	0.99	0.41	1.40
4/17/11 2:00 AM	0.98	0.29	1.27
4/17/11 5:00 AM	0.99	0.23	1.21
4/17/11 8:00 AM	0.95	0.30	1.25
4/17/11 11:00 AM	1.09	0.40	1.49
4/17/11 2:00 PM	0.97	0.40	1.36
4/17/11 5:00 PM	0.92	0.40	1.32
4/17/11 8:00 PM	0.86	0.38	1.25
4/17/11 11:00 PM	0.67	0.39	1.06

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
4/18/11 2:00 AM	0.39	0.38	0.76
4/18/11 5:00 AM	0.40	0.36	0.77
4/18/11 8:00 AM	0.97	0.35	1.32
4/18/11 11:00 AM	0.89	0.35	1.24
4/18/11 2:00 PM	0.87	0.41	1.29
4/18/11 5:00 PM	0.47	0.45	0.92
4/18/11 8:00 PM	0.35	0.41	0.76
4/18/11 11:00 PM	0.54	0.38	0.92
4/19/11 2:00 AM	0.38	0.39	0.77
4/19/11 5:00 AM	0.45	0.40	0.84
4/19/11 8:00 AM	0.92	0.39	1.31
4/19/11 11:00 AM	0.88	0.46	1.35
4/19/11 2:00 PM	0.88	0.55	1.42
4/19/11 5:00 PM	0.85	0.52	1.38
4/19/11 8:00 PM	0.81	0.38	1.20
4/19/11 11:00 PM	0.47	0.37	0.85
4/20/11 2:00 AM	0.35	0.37	0.72
4/20/11 5:00 AM	0.46	0.37	0.83
4/20/11 8:00 AM	0.82	0.36	1.18
4/20/11 11:00 AM	0.72	0.38	1.09
4/20/11 2:00 PM	0.78	0.35	1.13
4/20/11 5:00 PM	0.88	0.43	1.30
4/20/11 8:00 PM	0.92	0.46	1.38
4/20/11 11:00 PM	0.95	0.42	1.37
4/21/11 2:00 AM	0.60	0.33	0.94
4/21/11 5:00 AM	0.67	0.30	0.97
4/21/11 8:00 AM	1.01	0.23	1.24
4/21/11 11:00 AM	0.84	0.21	1.04
4/21/11 2:00 PM	0.78	0.42	1.19
4/21/11 5:00 PM	0.74	0.14	0.88
4/21/11 8:00 PM	0.68	0.26	0.94
4/21/11 11:00 PM	0.37	0.39	0.75
4/22/11 2:00 AM	0.38	0.18	0.56
4/22/11 5:00 AM	0.53	0.13	0.66
4/22/11 8:00 AM	1.08	0.14	1.21
4/22/11 11:00 AM	0.70	0.29	0.99
4/22/11 2:00 PM	0.57	0.31	0.89
4/22/11 5:00 PM	0.55	0.26	0.81
4/22/11 8:00 PM	0.57	0.26	0.83
4/22/11 11:00 PM	0.45	0.23	0.68
4/23/11 2:00 AM	0.30	0.20	0.49
4/23/11 5:00 AM	0.33	0.15	0.48
4/23/11 8:00 AM	0.49	0.19	0.68
4/23/11 11:00 AM	0.59	0.21	0.81
4/23/11 2:00 PM	0.51	0.22	0.73
4/23/11 5:00 PM	0.53	0.24	0.77
4/23/11 8:00 PM	0.73	0.25	0.98
4/23/11 11:00 PM	0.80	0.24	1.03
4/24/11 2:00 AM	0.76	0.23	1.00
4/24/11 5:00 AM	0.66	0.26	0.92
4/24/11 8:00 AM	0.82	0.28	1.10
4/24/11 11:00 AM	0.86	0.29	1.15
4/24/11 2:00 PM	0.86	0.30	1.15
4/24/11 5:00 PM	0.93	0.30	1.23

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
4/24/11 8:00 PM	0.92	0.29	1.22
4/24/11 11:00 PM	0.76	0.29	1.05
4/25/11 2:00 AM	0.39	0.29	0.68
4/25/11 5:00 AM	0.60	0.30	0.89
4/25/11 8:00 AM	0.95	0.30	1.25
4/25/11 11:00 AM	0.90	0.31	1.21
4/25/11 2:00 PM	0.78	0.32	1.10
4/25/11 5:00 PM	0.78	0.37	1.15
4/25/11 8:00 PM	0.89	0.35	1.24
4/25/11 11:00 PM	0.93	0.23	1.16
4/26/11 2:00 AM	0.64	0.16	0.80
4/26/11 5:00 AM	0.67	0.17	0.84
4/26/11 8:00 AM	1.00	0.33	1.33
4/26/11 11:00 AM	0.91	0.35	1.27
4/26/11 2:00 PM	0.89	0.36	1.26
4/26/11 5:00 PM	0.96	0.36	1.32
4/26/11 8:00 PM	1.00	0.36	1.36
4/26/11 11:00 PM	0.72	0.36	1.08
4/27/11 2:00 AM	0.65	0.35	1.00
4/27/11 5:00 AM	0.75	0.35	1.10
4/27/11 8:00 AM	0.88	0.34	1.23
4/27/11 11:00 AM	1.91	0.34	2.24
4/27/11 2:00 PM	1.12	0.31	1.43
4/27/11 5:00 PM	1.00	0.33	1.33
4/27/11 8:00 PM	0.81	0.32	1.13
4/27/11 11:00 PM	0.60	0.32	0.92
4/28/11 2:00 AM	0.50	0.34	0.84
4/28/11 5:00 AM	0.92	0.34	1.26
4/28/11 8:00 AM	0.88	0.34	1.23
4/28/11 11:00 AM	1.03	0.36	1.39
4/28/11 2:00 PM	0.91	0.42	1.33
4/28/11 5:00 PM	0.83	0.46	1.29
4/28/11 8:00 PM	0.82	0.55	1.37
4/28/11 11:00 PM	0.85	0.44	1.29
4/29/11 2:00 AM	0.87	0.37	1.24
4/29/11 5:00 AM	0.87	0.36	1.23
4/29/11 8:00 AM	0.91	0.36	1.27
4/29/11 11:00 AM	0.83	0.36	1.19
4/29/11 2:00 PM	0.85	0.36	1.21
4/29/11 5:00 PM	0.82	0.39	1.21
4/29/11 8:00 PM	0.69	0.40	1.09
4/29/11 11:00 PM	0.72	0.39	1.11
4/30/11 2:00 AM	0.65	0.34	0.99
4/30/11 5:00 AM	0.38	0.41	0.79
4/30/11 8:00 AM	0.66	0.41	1.07
4/30/11 11:00 AM	0.81	0.41	1.22
4/30/11 2:00 PM	0.91	0.44	1.35
4/30/11 5:00 PM	0.81	0.45	1.26
4/30/11 8:00 PM	0.82	0.48	1.30
4/30/11 11:00 PM	0.84	0.45	1.28
5/1/11 2:00 AM	0.79	0.40	1.19
5/1/11 5:00 AM	0.77	0.38	1.15
5/1/11 8:00 AM	0.81	0.36	1.17
5/1/11 11:00 AM	0.77	0.34	1.11

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
5/1/11 2:00 PM	0.72	0.34	1.06
5/1/11 5:00 PM	0.84	0.34	1.17
5/1/11 8:00 PM	0.82	0.33	1.14
5/1/11 11:00 PM	0.86	0.30	1.17
5/2/11 2:00 AM	0.73	0.29	1.02
5/2/11 5:00 AM	0.51	0.27	0.78
5/2/11 8:00 AM	0.93	0.31	1.23
5/2/11 11:00 AM	0.81	0.31	1.12
5/2/11 2:00 PM	0.86	0.32	1.18
5/2/11 5:00 PM	0.81	0.32	1.13
5/2/11 8:00 PM	0.85	0.31	1.16
5/2/11 11:00 PM	0.80	0.31	1.11
5/3/11 2:00 AM	0.81	0.31	1.12
5/3/11 5:00 AM	0.82	0.34	1.16
5/3/11 8:00 AM	0.81	0.31	1.12
5/3/11 11:00 AM	0.86	0.39	1.25
5/3/11 2:00 PM	0.87	0.37	1.24
5/3/11 5:00 PM	0.90	0.35	1.24
5/3/11 8:00 PM	0.86	0.34	1.20
5/3/11 11:00 PM	0.90	0.34	1.24
5/4/11 2:00 AM	0.96	0.34	1.30
5/4/11 5:00 AM	0.94	0.34	1.29
5/4/11 8:00 AM	0.95	0.34	1.29
5/4/11 11:00 AM	0.88	0.33	1.21
5/4/11 2:00 PM	0.83	0.34	1.17
5/4/11 5:00 PM	0.85	0.38	1.23
5/4/11 8:00 PM	0.88	0.39	1.27
5/4/11 11:00 PM	0.91	0.19	1.11
5/5/11 2:00 AM	0.44	0.16	0.60
5/5/11 5:00 AM	0.39	0.19	0.57
5/5/11 8:00 AM	0.84	0.41	1.25
5/5/11 11:00 AM	0.82	0.38	1.20
5/5/11 2:00 PM	0.85	0.37	1.21
5/5/11 5:00 PM	0.91	0.36	1.27
5/5/11 8:00 PM	0.92	0.37	1.29
5/5/11 11:00 PM	0.92	0.36	1.28
5/6/11 2:00 AM	0.38	0.32	0.70
5/6/11 5:00 AM	0.61	0.17	0.78
5/6/11 8:00 AM	1.03	0.14	1.18
5/6/11 11:00 AM	0.85	0.13	0.97
5/6/11 2:00 PM	0.79	0.22	1.01
5/6/11 5:00 PM	0.75	0.28	1.02
5/6/11 8:00 PM	0.77	0.26	1.03
5/6/11 11:00 PM	0.74	0.27	1.01
5/7/11 2:00 AM	0.48	0.19	0.67
5/7/11 5:00 AM	0.40	0.27	0.67
5/7/11 8:00 AM	0.64	0.30	0.94
5/7/11 11:00 AM	0.74	0.31	1.04
5/7/11 2:00 PM	0.70	0.32	1.02
5/7/11 5:00 PM	0.76	0.34	1.10
5/7/11 8:00 PM	0.77	0.32	1.08
5/7/11 11:00 PM	0.53	0.32	0.85
5/8/11 2:00 AM	0.35	0.34	0.69
5/8/11 5:00 AM	0.36	0.36	0.73

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
5/8/11 8:00 AM	0.63	0.38	1.01
5/8/11 11:00 AM	0.85	0.36	1.21
5/8/11 2:00 PM	0.84	0.34	1.18
5/8/11 5:00 PM	0.85	0.35	1.19
5/8/11 8:00 PM	0.80	0.18	0.98
5/8/11 11:00 PM	0.73	0.15	0.88
5/9/11 2:00 AM	0.75	0.16	0.91
5/9/11 5:00 AM	0.75	0.17	0.92
5/9/11 8:00 AM	0.76	0.18	0.93
5/9/11 11:00 AM	0.76	0.19	0.95
5/9/11 2:00 PM	0.77	0.18	0.95
5/9/11 5:00 PM	0.75	0.19	0.94
5/9/11 8:00 PM	0.80	0.19	0.99
5/9/11 11:00 PM	0.83	0.20	1.02
5/10/11 2:00 AM	0.85	0.20	1.05
5/10/11 5:00 AM	0.85	0.21	1.06
5/10/11 8:00 AM	0.84	0.21	1.06
5/10/11 11:00 AM	0.82	0.21	1.03
5/10/11 2:00 PM	0.78	0.22	0.99
5/10/11 5:00 PM	0.74	0.22	0.97
5/10/11 8:00 PM	0.77	0.22	0.99
5/10/11 11:00 PM	0.68	0.22	0.90
5/11/11 2:00 AM	0.33	0.22	0.56
5/11/11 5:00 AM	0.35	0.23	0.57
5/11/11 8:00 AM	0.79	0.24	1.03
5/11/11 11:00 AM	0.74	0.25	0.99
5/11/11 2:00 PM	0.74	0.24	0.98
5/11/11 5:00 PM	0.69	0.22	0.91
5/11/11 8:00 PM	0.72	0.23	0.95
5/11/11 11:00 PM	0.63	0.24	0.87
5/12/11 2:00 AM	0.34	0.23	0.57
5/12/11 5:00 AM	0.47	0.25	0.71
5/12/11 8:00 AM	0.64	0.27	0.90
5/12/11 11:00 AM	0.64	0.28	0.93
5/12/11 2:00 PM	0.63	0.28	0.92
5/12/11 5:00 PM	0.61	0.33	0.95
5/12/11 8:00 PM	0.20	0.32	0.51
5/12/11 11:00 PM	0.23	0.28	0.51
5/13/11 2:00 AM	0.23	0.28	0.51
5/13/11 5:00 AM	0.23	0.28	0.51
5/13/11 8:00 AM	0.22	0.28	0.50
5/13/11 11:00 AM	0.14	0.29	0.43
5/13/11 2:00 PM	0.12	0.29	0.41
5/13/11 5:00 PM	0.13	0.28	0.40
5/13/11 8:00 PM	0.13	0.25	0.39
5/13/11 11:00 PM	0.15	0.23	0.38
5/14/11 2:00 AM	0.15	0.21	0.36
5/14/11 5:00 AM	0.15	0.23	0.38
5/14/11 8:00 AM	0.16	0.23	0.40
5/14/11 11:00 AM	0.18	0.23	0.41
5/14/11 2:00 PM	0.16	0.23	0.39
5/14/11 5:00 PM	0.15	0.24	0.39
5/14/11 8:00 PM	0.15	0.25	0.39
5/14/11 11:00 PM	0.15	0.24	0.39

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
5/15/11 2:00 AM	0.14	0.23	0.38
5/15/11 5:00 AM	0.14	0.24	0.38
5/15/11 8:00 AM	0.15	0.24	0.39
5/15/11 11:00 AM	0.15	0.29	0.44
5/15/11 2:00 PM	0.15	0.25	0.39
5/15/11 5:00 PM	0.15	0.25	0.40
5/15/11 8:00 PM	0.15	0.26	0.42
5/15/11 11:00 PM	0.15	0.28	0.43
5/16/11 2:00 AM	0.16	0.28	0.44
5/16/11 5:00 AM	0.16	0.29	0.45
5/16/11 8:00 AM	0.13	0.29	0.42
5/16/11 11:00 AM	0.01	0.29	0.29
5/16/11 2:00 PM	0.00	0.29	0.29
5/16/11 5:00 PM	0.00	0.29	0.29
5/16/11 8:00 PM	0.00	0.33	0.33
5/16/11 11:00 PM	0.00	0.21	0.21
5/17/11 2:00 AM	0.00	0.09	0.09
5/17/11 5:00 AM	0.00	0.16	0.16
5/17/11 8:00 AM	0.00	0.37	0.37
5/17/11 11:00 AM	0.00	0.37	0.37
5/17/11 2:00 PM	0.00	0.35	0.35
5/17/11 5:00 PM	0.00	0.33	0.33
5/17/11 8:00 PM	0.00	0.33	0.33
5/17/11 11:00 PM	0.00	0.32	0.32
5/18/11 2:00 AM	0.00	0.25	0.25
5/18/11 5:00 AM	0.00	0.30	0.30
5/18/11 8:00 AM	0.00	0.31	0.31
5/18/11 11:00 AM	0.00	0.33	0.33
5/18/11 2:00 PM	0.00	0.33	0.33
5/18/11 5:00 PM	0.00	0.34	0.34
5/18/11 8:00 PM	0.00	0.28	0.28
5/18/11 11:00 PM	0.00	0.27	0.27
5/19/11 2:00 AM	0.00	0.28	0.28
5/19/11 5:00 AM	0.00	0.29	0.29
5/19/11 8:00 AM	0.00	0.33	0.33
5/19/11 11:00 AM	0.00	0.29	0.29
5/19/11 2:00 PM	0.00	0.25	0.25
5/19/11 5:00 PM	0.00	0.24	0.24
5/19/11 8:00 PM	0.01	0.23	0.24
5/19/11 11:00 PM	0.13	0.23	0.35
5/20/11 2:00 AM	0.17	0.26	0.43
5/20/11 5:00 AM	0.19	0.28	0.46
5/20/11 8:00 AM	0.34	0.25	0.58
5/20/11 11:00 AM	0.37	0.25	0.61
5/20/11 2:00 PM	0.51	0.27	0.78
5/20/11 5:00 PM	0.91	0.30	1.21
5/20/11 8:00 PM	0.98	0.30	1.29
5/20/11 11:00 PM	0.66	0.31	0.97
5/21/11 2:00 AM	0.42	0.29	0.72
5/21/11 5:00 AM	0.75	0.28	1.02
5/21/11 8:00 AM	0.34	0.27	0.61
5/21/11 11:00 AM	0.23	0.27	0.50
5/21/11 2:00 PM	0.22	0.26	0.48
5/21/11 5:00 PM	0.21	0.25	0.46

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
5/21/11 8:00 PM	0.23	0.25	0.48
5/21/11 11:00 PM	0.25	0.17	0.42
5/22/11 2:00 AM	0.24	0.05	0.29
5/22/11 5:00 AM	0.38	0.05	0.43
5/22/11 8:00 AM	0.54	0.07	0.62
5/22/11 11:00 AM	0.24	0.22	0.45
5/22/11 2:00 PM	0.22	0.36	0.58
5/22/11 5:00 PM	0.18	0.41	0.59
5/22/11 8:00 PM	0.19	0.46	0.65
5/22/11 11:00 PM	0.20	0.46	0.66
5/23/11 2:00 AM	0.21	0.28	0.49
5/23/11 5:00 AM	0.22	0.29	0.51
5/23/11 8:00 AM	0.23	0.38	0.61
5/23/11 11:00 AM	0.22	0.39	0.61
5/23/11 2:00 PM	0.24	0.41	0.65
5/23/11 5:00 PM	0.73	0.37	1.10
5/23/11 8:00 PM	0.90	0.42	1.32
5/23/11 11:00 PM	0.76	0.41	1.17
5/24/11 2:00 AM	0.92	0.37	1.29
5/24/11 5:00 AM	0.71	0.34	1.05
5/24/11 8:00 AM	0.35	0.45	0.80
5/24/11 11:00 AM	0.25	0.49	0.74
5/24/11 2:00 PM	0.24	0.52	0.76
5/24/11 5:00 PM	0.23	0.38	0.61
5/24/11 8:00 PM	0.24	0.36	0.60
5/24/11 11:00 PM	0.55	0.20	0.75
5/25/11 2:00 AM	0.74	0.17	0.91
5/25/11 5:00 AM	0.78	0.28	1.07
5/25/11 8:00 AM	0.96	0.34	1.29
5/25/11 11:00 AM	0.53	0.32	0.85
5/25/11 2:00 PM	0.35	0.31	0.66
5/25/11 5:00 PM	0.49	0.36	0.85
5/25/11 8:00 PM	0.93	0.37	1.30
5/25/11 11:00 PM	0.89	0.37	1.25
5/26/11 2:00 AM	0.80	0.36	1.16
5/26/11 5:00 AM	0.81	0.35	1.16
5/26/11 8:00 AM	0.80	0.48	1.28
5/26/11 11:00 AM	0.78	0.33	1.11
5/26/11 2:00 PM	0.99	0.53	1.52
5/26/11 5:00 PM	0.87	0.49	1.36
5/26/11 8:00 PM	0.82	0.43	1.25
5/26/11 11:00 PM	0.86	0.42	1.28
5/27/11 2:00 AM	0.70	0.41	1.12
5/27/11 5:00 AM	0.81	0.41	1.22
5/27/11 8:00 AM	1.06	0.45	1.52
5/27/11 11:00 AM	1.01	0.49	1.50
5/27/11 2:00 PM	0.94	0.46	1.40
5/27/11 5:00 PM	0.85	0.41	1.26
5/27/11 8:00 PM	0.92	0.39	1.30
5/27/11 11:00 PM	0.92	0.25	1.18
5/28/11 2:00 AM	0.95	0.05	0.99
5/28/11 5:00 AM	0.94	0.05	0.99
5/28/11 8:00 AM	1.01	0.05	1.06
5/28/11 11:00 AM	0.76	0.05	0.81

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
5/28/11 2:00 PM	0.25	0.33	0.58
5/28/11 5:00 PM	0.21	0.23	0.44
5/28/11 8:00 PM	0.25	0.28	0.53
5/28/11 11:00 PM	0.27	0.31	0.57
5/29/11 2:00 AM	0.28	0.32	0.60
5/29/11 5:00 AM	0.80	0.36	1.16
5/29/11 8:00 AM	0.89	0.46	1.35
5/29/11 11:00 AM	0.89	0.43	1.32
5/29/11 2:00 PM	0.87	0.45	1.33
5/29/11 5:00 PM	0.80	0.51	1.31
5/29/11 8:00 PM	0.93	0.38	1.31
5/29/11 11:00 PM	1.00	0.29	1.29
5/30/11 2:00 AM	0.93	0.23	1.15
5/30/11 5:00 AM	0.97	0.01	0.98
5/30/11 8:00 AM	1.01	0.00	1.01
5/30/11 11:00 AM	0.99	0.00	0.99
5/30/11 2:00 PM	0.95	0.00	0.95
5/30/11 5:00 PM	0.89	0.00	0.89
5/30/11 8:00 PM	0.93	0.00	0.93
5/30/11 11:00 PM	0.94	0.00	0.94
5/31/11 2:00 AM	0.84	0.00	0.84
5/31/11 5:00 AM	0.89	0.00	0.89
5/31/11 8:00 AM	1.03	0.00	1.03
5/31/11 11:00 AM	0.75	0.00	0.75
5/31/11 2:00 PM	0.79	0.00	0.79
5/31/11 5:00 PM	2.95	0.00	2.95
5/31/11 8:00 PM	0.27	0.00	0.27
5/31/11 11:00 PM	0.64	0.00	0.64
8/1/11 2:00 AM	0.46	0.00	0.46
6/1/11 5:00 AM	0.72	0.00	0.72
6/1/11 8:00 AM	0.63	0.00	0.63
6/1/11 11:00 AM	0.51	0.00	0.51
6/1/11 2:00 PM	0.95	0.00	0.95
6/1/11 5:00 PM	1.08	0.00	1.08
6/1/11 8:00 PM	1.02	0.00	1.02
6/1/11 11:00 PM	0.74	0.00	0.74
6/2/11 2:00 AM	0.43	0.00	0.43
6/2/11 5:00 AM	0.62	0.00	0.62
6/2/11 8:00 AM	0.68	0.00	0.68
6/2/11 11:00 AM	0.63	0.00	0.63
6/2/11 2:00 PM	0.82	0.00	0.82
6/2/11 5:00 PM	0.81	0.00	0.81
6/2/11 8:00 PM	0.78	0.00	0.78
6/2/11 11:00 PM	0.59	0.00	0.59
6/3/11 2:00 AM	1.07	0.00	1.07
6/3/11 5:00 AM	0.39	0.00	0.39
6/3/11 8:00 AM	0.29	0.00	0.29
6/3/11 11:00 AM	0.46	0.00	0.46
6/3/11 2:00 PM	0.93	0.00	0.93
6/3/11 5:00 PM	0.93	0.00	0.93
6/3/11 8:00 PM	0.93	0.00	0.93
6/3/11 11:00 PM	0.81	0.00	0.81
6/4/11 2:00 AM	0.59	0.07	0.66
6/4/11 5:00 AM	0.50	0.09	0.59

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
6/4/11 8:00 AM	0.78	0.27	1.06
6/4/11 11:00 AM	0.99	0.31	1.30
6/4/11 2:00 PM	0.87	0.54	1.40
6/4/11 5:00 PM	0.97	0.53	1.50
6/4/11 8:00 PM	1.04	0.56	1.60
6/4/11 11:00 PM	1.21	0.54	1.75
6/5/11 2:00 AM	0.93	0.32	1.25
6/5/11 5:00 AM	0.58	0.21	0.80
6/5/11 8:00 AM	0.74	0.25	0.99
6/5/11 11:00 AM	0.95	0.31	1.27
6/5/11 2:00 PM	0.94	0.28	1.22
6/5/11 5:00 PM	0.92	0.27	1.20
6/5/11 8:00 PM	0.99	0.29	1.28
6/5/11 11:00 PM	0.96	0.25	1.21
6/6/11 2:00 AM	0.89	0.16	1.05
6/6/11 5:00 AM	0.92	0.15	1.07
6/6/11 8:00 AM	0.99	0.25	1.25
6/6/11 11:00 AM	0.86	0.25	1.11
6/6/11 2:00 PM	0.79	0.28	1.07
6/6/11 5:00 PM	0.75	0.27	1.02
6/6/11 8:00 PM	0.72	0.27	0.99
6/6/11 11:00 PM	0.61	0.25	0.86
6/7/11 2:00 AM	0.57	0.24	0.82
6/7/11 5:00 AM	0.50	0.22	0.72
6/7/11 8:00 AM	0.29	0.23	0.52
6/7/11 11:00 AM	0.21	0.24	0.45
6/7/11 2:00 PM	0.30	0.22	0.52
6/7/11 5:00 PM	0.61	0.18	0.79
6/7/11 8:00 PM	0.49	0.21	0.70
6/7/11 11:00 PM	0.23	0.00	0.24
6/8/11 2:00 AM	0.35	0.00	0.35
6/8/11 5:00 AM	0.53	0.00	0.53
6/8/11 8:00 AM	0.59	0.00	0.59
6/8/11 11:00 AM	0.46	0.00	0.46
6/8/11 2:00 PM	0.44	0.00	0.44
6/8/11 5:00 PM	0.25	0.00	0.25
6/8/11 8:00 PM	0.21	0.00	0.21
6/8/11 11:00 PM	0.27	0.00	0.27
6/9/11 2:00 AM	0.36	0.00	0.36
6/9/11 5:00 AM	0.49	0.00	0.49
6/9/11 8:00 AM	0.56	0.00	0.56
6/9/11 11:00 AM	0.36	0.00	0.36
6/9/11 2:00 PM	0.56	0.00	0.56
6/9/11 5:00 PM	0.43	0.00	0.43
6/9/11 8:00 PM	0.26	0.00	0.26
6/9/11 11:00 PM	0.42	0.00	0.42
6/10/11 2:00 AM	0.32	0.00	0.32
6/10/11 5:00 AM	0.79	0.00	0.79
6/10/11 8:00 AM	0.80	0.00	0.80
6/10/11 11:00 AM	0.68	0.00	0.68
6/10/11 2:00 PM	0.75	0.00	0.75
6/10/11 5:00 PM	0.74	0.00	0.74
6/10/11 8:00 PM	0.76	0.00	0.76
6/10/11 11:00 PM	0.82	0.00	0.82

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
6/11/11 2:00 AM	0.86	0.00	0.86
6/11/11 5:00 AM	0.90	0.00	0.90
6/11/11 8:00 AM	0.90	0.00	0.90
6/11/11 11:00 AM	0.98	0.00	0.98
6/11/11 2:00 PM	0.72	0.00	0.72
6/11/11 5:00 PM	0.58	0.00	0.58
6/11/11 8:00 PM	0.34	0.00	0.34
6/11/11 11:00 PM	0.61	0.00	0.61
6/12/11 2:00 AM	0.91	0.00	0.91
6/12/11 5:00 AM	0.96	0.00	0.96
6/12/11 8:00 AM	0.83	0.00	0.83
6/12/11 11:00 AM	0.34	0.00	0.34
6/12/11 2:00 PM	0.30	0.00	0.30
6/12/11 5:00 PM	0.80	0.00	0.80
6/12/11 8:00 PM	0.88	0.00	0.88
6/12/11 11:00 PM	0.96	0.00	0.96
6/13/11 2:00 AM	0.97	0.00	0.97
6/13/11 5:00 AM	0.82	0.00	0.82
6/13/11 8:00 AM	1.00	0.00	1.00
6/13/11 11:00 AM	0.68	0.00	0.68
6/13/11 2:00 PM	0.60	0.00	0.60
6/13/11 5:00 PM	0.76	0.00	0.76
6/13/11 8:00 PM	0.90	0.00	0.90
6/13/11 11:00 PM	0.89	0.00	0.89
6/14/11 2:00 AM	0.58	0.00	0.58
6/14/11 5:00 AM	0.86	0.00	0.86
6/14/11 8:00 AM	0.95	0.00	0.95
6/14/11 11:00 AM	0.92	0.00	0.92
6/14/11 2:00 PM	0.86	0.02	0.88
6/14/11 5:00 PM	0.92	0.40	1.31
6/14/11 8:00 PM	0.90	0.60	1.50
6/14/11 11:00 PM	0.83	0.46	1.29
6/15/11 2:00 AM	0.84	0.30	1.15
6/15/11 5:00 AM	0.84	0.26	1.09
6/15/11 8:00 AM	0.87	0.26	1.13
6/15/11 11:00 AM	0.81	0.29	1.10
6/15/11 2:00 PM	0.82	0.32	1.13
6/15/11 5:00 PM	0.78	0.22	1.00
6/15/11 8:00 PM	0.83	0.17	1.00
6/15/11 11:00 PM	0.83	0.33	1.16
6/16/11 2:00 AM	0.47	0.32	0.78
6/16/11 5:00 AM	0.44	0.27	0.71
6/16/11 8:00 AM	0.58	0.45	1.03
6/16/11 11:00 AM	0.39	0.68	1.07
6/16/11 2:00 PM	0.43	0.78	1.21
6/16/11 5:00 PM	0.61	0.54	1.15
6/16/11 8:00 PM	0.75	0.48	1.23
6/16/11 11:00 PM	0.79	0.44	1.24
6/17/11 2:00 AM	0.83	0.43	1.26
6/17/11 5:00 AM	0.74	0.35	1.09
6/17/11 8:00 AM	0.63	0.33	0.95
6/17/11 11:00 AM	0.61	0.20	0.80
6/17/11 2:00 PM	0.57	0.16	0.73
6/17/11 5:00 PM	0.55	0.14	0.69

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
6/17/11 8:00 PM	0.72	0.13	0.85
6/17/11 11:00 PM	0.64	0.13	0.77
6/18/11 2:00 AM	0.39	0.14	0.53
6/18/11 5:00 AM	0.41	0.13	0.54
6/18/11 8:00 AM	0.60	0.13	0.73
6/18/11 11:00 AM	0.83	0.14	0.96
6/18/11 2:00 PM	0.82	0.13	0.95
6/18/11 5:00 PM	0.71	0.14	0.84
6/18/11 8:00 PM	0.81	0.14	0.95
6/18/11 11:00 PM	0.76	0.06	0.82
6/19/11 2:00 AM	0.62	0.02	0.64
6/19/11 5:00 AM	0.51	0.03	0.54
6/19/11 8:00 AM	0.71	0.04	0.76
6/19/11 11:00 AM	0.68	0.04	0.73
6/19/11 2:00 PM	0.38	0.04	0.42
6/19/11 5:00 PM	0.75	0.04	0.79
6/19/11 8:00 PM	0.50	0.04	0.54
6/19/11 11:00 PM	0.29	0.05	0.34
6/20/11 2:00 AM	0.42	0.20	0.62
6/20/11 5:00 AM	0.31	0.19	0.49
6/20/11 8:00 AM	0.44	0.17	0.61
6/20/11 11:00 AM	0.32	0.16	0.48
6/20/11 2:00 PM	0.36	0.15	0.51
6/20/11 5:00 PM	0.66	0.15	0.80
6/20/11 8:00 PM	0.69	0.14	0.83
6/20/11 11:00 PM	0.50	0.15	0.65
6/21/11 2:00 AM	0.37	0.15	0.52
6/21/11 5:00 AM	0.38	0.15	0.54
6/21/11 8:00 AM	0.76	0.15	0.91
6/21/11 11:00 AM	0.82	0.15	0.98
6/21/11 2:00 PM	0.70	0.17	0.87
6/21/11 5:00 PM	0.62	0.17	0.79
6/21/11 8:00 PM	0.49	0.18	0.67
6/21/11 11:00 PM	0.39	0.20	0.60
6/22/11 2:00 AM	0.37	0.20	0.58
6/22/11 5:00 AM	0.38	0.22	0.59
6/22/11 8:00 AM	0.74	0.23	0.97
6/22/11 11:00 AM	0.72	0.25	0.97
6/22/11 2:00 PM	0.78	0.26	1.05
6/22/11 5:00 PM	0.77	0.28	1.05
6/22/11 8:00 PM	0.55	0.29	0.84
6/22/11 11:00 PM	0.50	0.29	0.79
6/23/11 2:00 AM	0.49	0.31	0.81
6/23/11 5:00 AM	0.44	0.33	0.77
6/23/11 8:00 AM	0.64	0.34	0.98
6/23/11 11:00 AM	0.76	0.35	1.11
6/23/11 2:00 PM	0.77	0.37	1.14
6/23/11 5:00 PM	0.78	0.36	1.14
6/23/11 8:00 PM	0.85	0.35	1.20
6/23/11 11:00 PM	0.65	0.34	0.99
6/24/11 2:00 AM	0.60	0.36	0.97
6/24/11 5:00 AM	0.54	0.36	0.90
6/24/11 8:00 AM	0.55	0.37	0.92
6/24/11 11:00 AM	0.53	0.40	0.93

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
6/24/11 2:00 PM	0.56	0.39	0.95
6/24/11 5:00 PM	0.52	0.36	0.89
6/24/11 8:00 PM	0.58	0.37	0.95
6/24/11 11:00 PM	0.77	0.14	0.91
6/25/11 2:00 AM	1.01	0.04	1.05
6/25/11 5:00 AM	0.80	0.04	0.85
6/25/11 8:00 AM	0.85	0.08	0.93
6/25/11 11:00 AM	0.69	0.46	1.16
6/25/11 2:00 PM	0.84	0.46	1.30
6/25/11 5:00 PM	0.43	0.40	0.83
6/25/11 8:00 PM	0.35	0.36	0.70
6/25/11 11:00 PM	0.67	0.13	0.80
6/26/11 2:00 AM	0.98	0.06	1.04
6/26/11 5:00 AM	0.92	0.06	0.98
6/26/11 8:00 AM	0.84	0.15	1.00
6/26/11 11:00 AM	0.83	0.42	1.26
6/26/11 2:00 PM	0.62	0.38	1.00
6/26/11 5:00 PM	0.26	0.36	0.62
6/26/11 8:00 PM	0.31	0.32	0.63
6/26/11 11:00 PM	0.54	0.26	0.80
6/27/11 2:00 AM	0.57	0.19	0.76
6/27/11 5:00 AM	0.54	0.17	0.71
6/27/11 8:00 AM	0.78	0.29	1.07
6/27/11 11:00 AM	0.38	0.28	0.66
6/27/11 2:00 PM	0.35	0.24	0.60
6/27/11 5:00 PM	0.49	0.24	0.73
6/27/11 8:00 PM	0.97	0.21	1.19
6/27/11 11:00 PM	0.91	0.19	1.10
6/28/11 2:00 AM	0.49	0.22	0.70
6/28/11 5:00 AM	0.51	0.22	0.73
6/28/11 8:00 AM	0.90	0.22	1.12
6/28/11 11:00 AM	0.87	0.21	1.08
6/28/11 2:00 PM	0.86	0.21	1.08
6/28/11 5:00 PM	0.89	0.23	1.11
6/28/11 8:00 PM	0.93	0.19	1.12
6/28/11 11:00 PM	0.58	0.18	0.76
6/29/11 2:00 AM	0.44	0.19	0.64
6/29/11 5:00 AM	0.48	0.21	0.69
6/29/11 8:00 AM	0.57	0.23	0.80
6/29/11 11:00 AM	0.79	0.21	1.00
6/29/11 2:00 PM	0.86	0.22	1.08
6/29/11 5:00 PM	0.96	0.24	1.20
6/29/11 8:00 PM	0.96	0.24	1.20
6/29/11 11:00 PM	0.56	0.23	0.80
6/30/11 2:00 AM	0.33	0.21	0.53
6/30/11 5:00 AM	0.38	0.22	0.60
6/30/11 8:00 AM	0.86	0.20	1.05
6/30/11 11:00 AM	0.31	0.24	0.55
6/30/11 2:00 PM	0.32	0.27	0.59
6/30/11 5:00 PM	0.31	0.28	0.59
6/30/11 8:00 PM	0.31	0.48	0.78
6/30/11 11:00 PM	0.21	0.23	0.45
7/1/11 2:00 AM	0.21	0.22	0.43
7/1/11 5:00 AM	0.21	0.21	0.42

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
7/1/11 8:00 AM	0.25	0.20	0.45
7/1/11 11:00 AM	0.25	0.19	0.44
7/1/11 2:00 PM	0.25	0.16	0.41
7/1/11 5:00 PM	0.25	0.17	0.42
7/1/11 8:00 PM	0.26	0.16	0.42
7/1/11 11:00 PM	0.27	0.12	0.39
7/2/11 2:00 AM	0.27	0.08	0.35
7/2/11 5:00 AM	0.23	0.12	0.35
7/2/11 8:00 AM	0.27	0.17	0.44
7/2/11 11:00 AM	0.27	0.18	0.44
7/2/11 2:00 PM	0.26	0.18	0.44
7/2/11 5:00 PM	0.25	0.18	0.43
7/2/11 8:00 PM	0.24	0.18	0.42
7/2/11 11:00 PM	0.25	0.17	0.42
7/3/11 2:00 AM	0.24	0.17	0.41
7/3/11 5:00 AM	0.21	0.12	0.33
7/3/11 8:00 AM	0.22	0.16	0.38
7/3/11 11:00 AM	0.22	0.19	0.41
7/3/11 2:00 PM	0.22	0.19	0.41
7/3/11 5:00 PM	0.22	0.19	0.41
7/3/11 8:00 PM	0.22	0.18	0.41
7/3/11 11:00 PM	0.23	0.18	0.41
7/4/11 2:00 AM	0.16	0.19	0.35
7/4/11 5:00 AM	0.22	0.18	0.40
7/4/11 8:00 AM	0.23	0.19	0.42
7/4/11 11:00 AM	0.23	0.20	0.44
7/4/11 2:00 PM	0.23	0.22	0.45
7/4/11 5:00 PM	0.23	0.24	0.47
7/4/11 8:00 PM	0.23	0.24	0.47
7/4/11 11:00 PM	0.24	0.24	0.49
7/5/11 2:00 AM	0.24	0.24	0.48
7/5/11 5:00 AM	0.24	0.25	0.49
7/5/11 8:00 AM	0.24	0.26	0.50
7/5/11 11:00 AM	0.24	0.29	0.53
7/5/11 2:00 PM	0.25	0.30	0.55
7/5/11 5:00 PM	0.25	0.32	0.57
7/5/11 8:00 PM	0.25	0.33	0.58
7/5/11 11:00 PM	0.25	0.32	0.56
7/6/11 2:00 AM	0.12	0.31	0.43
7/6/11 5:00 AM	0.11	0.32	0.42
7/6/11 8:00 AM	0.24	0.32	0.55
7/6/11 11:00 AM	0.26	0.13	0.39
7/6/11 2:00 PM	0.24	0.10	0.34
7/6/11 5:00 PM	0.24	0.03	0.27
7/6/11 8:00 PM	0.24	0.02	0.26
7/6/11 11:00 PM	0.25	0.00	0.25
7/7/11 2:00 AM	0.25	0.00	0.25
7/7/11 5:00 AM	0.25	0.00	0.25
7/7/11 8:00 AM	0.35	0.00	0.35
7/7/11 11:00 AM	0.42	0.00	0.42
7/7/11 2:00 PM	0.40	0.00	0.40
7/7/11 5:00 PM	0.28	0.00	0.28
7/7/11 8:00 PM	0.28	0.00	0.28
7/7/11 11:00 PM	0.24	0.00	0.24

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
7/8/11 2:00 AM	0.24	0.00	0.24
7/8/11 5:00 AM	0.24	0.00	0.24
7/8/11 8:00 AM	0.24	0.00	0.24
7/8/11 11:00 AM	0.45	0.00	0.45
7/8/11 2:00 PM	0.85	0.00	0.85
7/8/11 5:00 PM	0.87	0.00	0.87
7/8/11 8:00 PM	0.69	0.00	0.69
7/8/11 11:00 PM	0.50	0.00	0.50
7/9/11 2:00 AM	0.38	0.00	0.38
7/9/11 5:00 AM	0.84	0.00	0.84
7/9/11 8:00 AM	0.88	0.00	0.88
7/9/11 11:00 AM	0.84	0.00	0.84
7/9/11 2:00 PM	0.81	0.00	0.81
7/9/11 5:00 PM	0.86	0.00	0.86
7/9/11 8:00 PM	0.66	0.00	0.66
7/9/11 11:00 PM	0.33	0.00	0.33
7/10/11 2:00 AM	0.33	0.00	0.33
7/10/11 5:00 AM	0.30	0.00	0.30
7/10/11 8:00 AM	0.43	0.00	0.43
7/10/11 11:00 AM	0.56	0.00	0.56
7/10/11 2:00 PM	0.26	0.00	0.26
7/10/11 5:00 PM	0.41	0.00	0.41
7/10/11 8:00 PM	0.53	0.00	0.53
7/10/11 11:00 PM	0.45	0.00	0.45
7/11/11 2:00 AM	0.25	0.00	0.25
7/11/11 5:00 AM	0.25	0.00	0.25
7/11/11 8:00 AM	0.56	0.00	0.56
7/11/11 11:00 AM	0.90	0.00	0.90
7/11/11 2:00 PM	0.79	0.50	1.29
7/11/11 5:00 PM	0.76	1.06	1.82
7/11/11 8:00 PM	0.74	0.19	0.93
7/11/11 11:00 PM	0.43	0.14	0.57
7/12/11 2:00 AM	0.36	0.13	0.48
7/12/11 5:00 AM	0.55	0.13	0.68
7/12/11 8:00 AM	0.75	2.44	3.18
7/12/11 11:00 AM	0.75	0.48	1.23
7/12/11 2:00 PM	0.72	0.14	0.86
7/12/11 5:00 PM	0.78	0.18	0.96
7/12/11 8:00 PM	0.75	0.22	0.97
7/12/11 11:00 PM	0.37	0.26	0.64
7/13/11 2:00 AM	0.35	0.14	0.49
7/13/11 5:00 AM	0.36	0.12	0.48
7/13/11 8:00 AM	0.52	0.25	0.78
7/13/11 11:00 AM	0.31	0.30	0.62
7/13/11 2:00 PM	0.77	0.36	1.13
7/13/11 5:00 PM	0.76	0.27	1.04
7/13/11 8:00 PM	0.80	0.28	1.09
7/13/11 11:00 PM	0.58	0.23	0.81
7/14/11 2:00 AM	0.40	0.20	0.61
7/14/11 5:00 AM	0.42	0.20	0.62
7/14/11 8:00 AM	0.81	0.20	1.02
7/14/11 11:00 AM	0.34	0.19	0.53
7/14/11 2:00 PM	0.32	0.18	0.50
7/14/11 5:00 PM	0.67	0.12	0.79

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
7/14/11 8:00 PM	0.87	0.16	1.02
7/14/11 11:00 PM	0.82	0.17	0.99
7/15/11 2:00 AM	0.83	0.17	1.00
7/15/11 5:00 AM	0.85	0.18	1.03
7/15/11 8:00 AM	0.79	0.23	1.02
7/15/11 11:00 AM	0.38	0.20	0.58
7/15/11 2:00 PM	0.55	0.14	0.69
7/15/11 5:00 PM	0.71	0.11	0.82
7/15/11 8:00 PM	0.48	0.10	0.57
7/15/11 11:00 PM	0.24	0.10	0.34
7/16/11 2:00 AM	0.26	0.11	0.37
7/16/11 5:00 AM	0.37	0.14	0.51
7/16/11 8:00 AM	0.36	0.18	0.54
7/16/11 11:00 AM	0.28	0.37	0.65
7/16/11 2:00 PM	0.20	0.29	0.49
7/16/11 5:00 PM	0.19	0.28	0.47
7/16/11 8:00 PM	0.20	0.35	0.56
7/16/11 11:00 PM	0.20	0.15	0.35
7/17/11 2:00 AM	0.20	0.00	0.20
7/17/11 5:00 AM	0.20	0.00	0.20
7/17/11 8:00 AM	0.21	0.00	0.21
7/17/11 11:00 AM	0.20	0.00	0.20
7/17/11 2:00 PM	0.17	0.00	0.17
7/17/11 5:00 PM	0.17	0.00	0.17
7/17/11 8:00 PM	0.19	0.00	0.19
7/17/11 11:00 PM	0.20	0.00	0.20
7/18/11 2:00 AM	0.20	0.00	0.20
7/18/11 5:00 AM	0.20	0.00	0.20
7/18/11 8:00 AM	0.20	0.00	0.20
7/18/11 11:00 AM	0.20	0.00	0.20
7/18/11 2:00 PM	0.19	0.00	0.19
7/18/11 5:00 PM	0.18	0.00	0.18
7/18/11 8:00 PM	0.18	0.00	0.18
7/18/11 11:00 PM	0.18	0.00	0.18
7/19/11 2:00 AM	0.17	0.00	0.17
7/19/11 5:00 AM	0.22	0.00	0.22
7/19/11 8:00 AM	0.20	0.00	0.20
7/19/11 11:00 AM	0.17	0.00	0.17
7/19/11 2:00 PM	0.21	0.00	0.21
7/19/11 5:00 PM	0.42	0.00	0.42
7/19/11 8:00 PM	0.73	0.00	0.73
7/19/11 11:00 PM	0.56	0.00	0.56
7/20/11 2:00 AM	0.59	0.00	0.59
7/20/11 5:00 AM	0.34	0.00	0.34
7/20/11 8:00 AM	0.67	0.00	0.67
7/20/11 11:00 AM	0.72	0.00	0.72
7/20/11 2:00 PM	0.67	0.00	0.67
7/20/11 5:00 PM	0.70	0.00	0.70
7/20/11 8:00 PM	0.67	0.00	0.67
7/20/11 11:00 PM	0.53	0.00	0.53
7/21/11 2:00 AM	0.35	0.00	0.35
7/21/11 5:00 AM	0.45	0.00	0.45
7/21/11 8:00 AM	0.72	0.00	0.72
7/21/11 11:00 AM	0.71	0.00	0.71

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
7/21/11 2:00 PM	0.68	0.00	0.68
7/21/11 5:00 PM	0.25	0.00	0.25
7/21/11 8:00 PM	0.30	0.00	0.30
7/21/11 11:00 PM	0.39	0.00	0.39
7/22/11 2:00 AM	0.40	0.00	0.40
7/22/11 5:00 AM	0.46	0.00	0.46
7/22/11 8:00 AM	0.81	0.00	0.81
7/22/11 11:00 AM	0.77	0.00	0.77
7/22/11 2:00 PM	0.82	0.00	0.82
7/22/11 5:00 PM	0.78	0.00	0.78
7/22/11 8:00 PM	0.82	0.00	0.82
7/22/11 11:00 PM	0.91	0.00	0.91
7/23/11 2:00 AM	0.90	0.00	0.90
7/23/11 5:00 AM	0.50	0.00	0.50
7/23/11 8:00 AM	0.64	0.00	0.64
7/23/11 11:00 AM	0.93	0.00	0.93
7/23/11 2:00 PM	0.64	0.01	0.65
7/23/11 5:00 PM	0.76	0.44	1.21
7/23/11 8:00 PM	0.85	0.37	1.22
7/23/11 11:00 PM	0.77	0.26	1.03
7/24/11 2:00 AM	0.69	0.22	0.91
7/24/11 5:00 AM	0.47	0.16	0.63
7/24/11 8:00 AM	0.59	0.24	0.82
7/24/11 11:00 AM	0.54	0.31	0.85
7/24/11 2:00 PM	0.67	0.33	1.00
7/24/11 5:00 PM	0.73	0.29	1.01
7/24/11 8:00 PM	0.74	0.28	1.02
7/24/11 11:00 PM	0.54	0.18	0.71
7/25/11 2:00 AM	0.47	0.11	0.58
7/25/11 5:00 AM	0.50	0.17	0.67
7/25/11 8:00 AM	0.57	0.23	0.80
7/25/11 11:00 AM	0.28	0.25	0.53
7/25/11 2:00 PM	0.28	0.24	0.52
7/25/11 5:00 PM	0.60	0.18	0.77
7/25/11 8:00 PM	0.34	0.18	0.52
7/25/11 11:00 PM	0.37	0.21	0.58
7/26/11 2:00 AM	0.45	0.25	0.70
7/26/11 5:00 AM	0.47	0.22	0.70
7/26/11 8:00 AM	0.74	0.22	0.95
7/26/11 11:00 AM	0.27	0.21	0.49
7/26/11 2:00 PM	0.25	0.22	0.48
7/26/11 5:00 PM	0.25	0.22	0.47
7/26/11 8:00 PM	0.25	0.21	0.46
7/26/11 11:00 PM	0.37	0.21	0.57
7/27/11 2:00 AM	0.36	0.23	0.59
7/27/11 5:00 AM	0.41	0.24	0.65
7/27/11 8:00 AM	0.53	0.31	0.85
7/27/11 11:00 AM	0.24	0.29	0.53
7/27/11 2:00 PM	0.23	0.34	0.57
7/27/11 5:00 PM	0.26	0.34	0.60
7/27/11 8:00 PM	0.25	0.37	0.62
7/27/11 11:00 PM	0.38	0.20	0.58
7/28/11 2:00 AM	0.33	0.13	0.46
7/28/11 5:00 AM	0.48	0.22	0.70

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
7/28/11 8:00 AM	0.49	0.34	0.82
7/28/11 11:00 AM	0.24	0.44	0.68
7/28/11 2:00 PM	0.23	0.39	0.62
7/28/11 5:00 PM	0.24	0.58	0.83
7/28/11 8:00 PM	0.28	0.51	0.79
7/28/11 11:00 PM	0.32	0.17	0.49
7/29/11 2:00 AM	0.27	0.11	0.39
7/29/11 5:00 AM	0.51	0.11	0.62
7/29/11 8:00 AM	0.34	0.29	0.62
7/29/11 11:00 AM	0.25	0.31	0.56
7/29/11 2:00 PM	0.24	0.29	0.53
7/29/11 5:00 PM	0.40	0.27	0.67
7/29/11 8:00 PM	0.72	0.27	1.00
7/29/11 11:00 PM	0.43	0.24	0.68
7/30/11 2:00 AM	0.56	0.77	1.33
7/30/11 5:00 AM	0.78	1.24	2.02
7/30/11 8:00 AM	0.63	0.29	0.92
7/30/11 11:00 AM	0.52	0.45	0.96
7/30/11 2:00 PM	0.49	0.23	0.72
7/30/11 5:00 PM	0.46	0.22	0.68
7/30/11 8:00 PM	0.51	0.11	0.62
7/30/11 11:00 PM	0.48	0.11	0.59
7/31/11 2:00 AM	0.50	0.11	0.61
7/31/11 5:00 AM	0.52	0.14	0.66
7/31/11 8:00 AM	0.56	0.23	0.78
7/31/11 11:00 AM	0.45	0.23	0.68
7/31/11 2:00 PM	0.29	0.29	0.58
7/31/11 5:00 PM	0.58	0.34	0.92
7/31/11 8:00 PM	0.85	0.18	1.04
7/31/11 11:00 PM	0.63	0.16	0.79
8/1/11 2:00 AM	0.25	0.59	0.84
8/1/11 5:00 AM	0.24	0.37	0.61
8/1/11 8:00 AM	0.31	0.35	0.66
8/1/11 11:00 AM	0.27	0.35	0.62
8/1/11 2:00 PM	0.13	0.36	0.49
8/1/11 5:00 PM	0.14	0.37	0.51
8/1/11 8:00 PM	0.44	0.36	0.80
8/1/11 11:00 PM	0.44	0.33	0.77
8/2/11 2:00 AM	0.42	0.35	0.78
8/2/11 5:00 AM	0.40	0.37	0.77
8/2/11 8:00 AM	0.62	0.33	0.95
8/2/11 11:00 AM	0.45	0.35	0.80
8/2/11 2:00 PM	0.41	0.39	0.80
8/2/11 5:00 PM	0.41	0.35	0.76
8/2/11 8:00 PM	0.45	0.35	0.79
8/2/11 11:00 PM	0.43	0.36	0.79
8/3/11 2:00 AM	0.42	0.37	0.79
8/3/11 5:00 AM	0.40	0.38	0.78
8/3/11 8:00 AM	0.44	0.33	0.77
8/3/11 11:00 AM	0.30	0.37	0.66
8/3/11 2:00 PM	0.20	0.37	0.57
8/3/11 5:00 PM	0.18	0.47	0.65
8/3/11 8:00 PM	0.18	0.38	0.56
8/3/11 11:00 PM	0.19	0.39	0.58

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
8/4/11 2:00 AM	0.18	0.51	0.69
8/4/11 5:00 AM	0.18	0.38	0.56
8/4/11 8:00 AM	0.18	0.74	0.92
8/4/11 11:00 AM	0.18	0.64	0.82
8/4/11 2:00 PM	0.20	0.47	0.66
8/4/11 5:00 PM	0.19	0.43	0.62
8/4/11 8:00 PM	0.20	0.44	0.64
8/4/11 11:00 PM	0.13	0.42	0.55
8/5/11 2:00 AM	0.10	0.42	0.53
8/5/11 5:00 AM	0.14	0.38	0.52
8/5/11 8:00 AM	0.26	0.40	0.66
8/5/11 11:00 AM	0.32	0.41	0.74
8/5/11 2:00 PM	0.35	0.44	0.79
8/5/11 5:00 PM	0.40	0.45	0.84
8/5/11 8:00 PM	0.02	0.46	0.47
8/5/11 11:00 PM	0.10	0.45	0.55
8/6/11 2:00 AM	0.13	0.46	0.59
8/6/11 5:00 AM	0.17	0.45	0.61
8/6/11 8:00 AM	0.37	0.45	0.83
8/6/11 11:00 AM	0.41	0.47	0.88
8/6/11 2:00 PM	0.37	0.49	0.86
8/6/11 5:00 PM	0.37	0.48	0.85
8/6/11 8:00 PM	0.39	0.49	0.88
8/6/11 11:00 PM	0.48	0.50	0.98
8/7/11 2:00 AM	0.78	0.26	1.03
8/7/11 5:00 AM	1.00	0.16	1.16
8/7/11 8:00 AM	1.22	0.34	1.56
8/7/11 11:00 AM	1.15	0.43	1.58
8/7/11 2:00 PM	1.05	0.32	1.37
8/7/11 5:00 PM	1.01	0.21	1.22
8/7/11 8:00 PM	0.97	0.18	1.15
8/7/11 11:00 PM	0.85	0.27	1.12
8/8/11 2:00 AM	0.67	0.27	0.94
8/8/11 5:00 AM	0.64	0.29	0.93
8/8/11 8:00 AM	0.78	0.34	1.12
8/8/11 11:00 AM	0.84	0.14	0.98
8/8/11 2:00 PM	0.92	0.00	0.92
8/8/11 5:00 PM	0.87	0.14	1.01
8/8/11 8:00 PM	0.90	0.26	1.15
8/8/11 11:00 PM	0.83	0.27	1.11
8/9/11 2:00 AM	0.67	0.27	0.94
8/9/11 5:00 AM	0.69	0.25	0.94
8/9/11 8:00 AM	0.89	0.25	1.14
8/9/11 11:00 AM	0.93	0.25	1.18
8/9/11 2:00 PM	0.92	0.31	1.23
8/9/11 5:00 PM	0.81	0.51	1.32
8/9/11 8:00 PM	0.83	0.44	1.27
8/9/11 11:00 PM	0.59	0.39	0.98
8/10/11 2:00 AM	0.51	0.17	0.69
8/10/11 5:00 AM	0.47	0.20	0.67
8/10/11 8:00 AM	0.90	0.34	1.24
8/10/11 11:00 AM	0.91	0.37	1.28
8/10/11 2:00 PM	0.72	0.44	1.16
8/10/11 5:00 PM	0.70	0.47	1.18

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
8/10/11 8:00 PM	0.94	0.54	1.48
8/10/11 11:00 PM	0.62	0.37	0.99
8/11/11 2:00 AM	0.37	0.36	0.73
8/11/11 5:00 AM	0.41	0.36	0.77
8/11/11 8:00 AM	0.39	0.32	0.70
8/11/11 11:00 AM	0.56	0.33	0.89
8/11/11 2:00 PM	0.41	0.38	0.79
8/11/11 5:00 PM	0.28	0.40	0.67
8/11/11 8:00 PM	0.26	0.37	0.64
8/11/11 11:00 PM	0.31	0.09	0.40
8/12/11 2:00 AM	0.31	0.07	0.38
8/12/11 5:00 AM	0.28	0.13	0.41
8/12/11 8:00 AM	0.29	0.58	0.87
8/12/11 11:00 AM	0.27	0.61	0.87
8/12/11 2:00 PM	0.24	0.56	0.81
8/12/11 5:00 PM	0.23	0.55	0.78
8/12/11 8:00 PM	0.19	0.52	0.71
8/12/11 11:00 PM	0.20	0.51	0.70
8/13/11 2:00 AM	0.20	0.48	0.67
8/13/11 5:00 AM	0.20	0.47	0.67
8/13/11 8:00 AM	0.22	0.46	0.67
8/13/11 11:00 AM	0.23	0.49	0.72
8/13/11 2:00 PM	0.23	0.47	0.70
8/13/11 5:00 PM	0.24	0.51	0.75
8/13/11 8:00 PM	0.22	0.55	0.77
8/13/11 11:00 PM	0.20	0.25	0.45
8/14/11 2:00 AM	0.20	0.46	0.66
8/14/11 5:00 AM	0.20	0.46	0.66
8/14/11 8:00 AM	0.13	0.19	0.32
8/14/11 11:00 AM	0.00	0.10	0.10
8/14/11 2:00 PM	0.00	0.10	0.10
8/14/11 5:00 PM	0.00	0.10	0.10
8/14/11 8:00 PM	0.05	0.12	0.18
8/14/11 11:00 PM	0.13	0.57	0.70
8/15/11 2:00 AM	0.17	0.48	0.65
8/15/11 5:00 AM	0.16	0.45	0.61
8/15/11 8:00 AM	0.16	0.43	0.60
8/15/11 11:00 AM	0.17	0.50	0.67
8/15/11 2:00 PM	0.18	0.52	0.71
8/15/11 5:00 PM	0.18	0.48	0.66
8/15/11 8:00 PM	0.17	0.45	0.62
8/15/11 11:00 PM	0.15	0.49	0.65
8/16/11 2:00 AM	0.15	0.41	0.56
8/16/11 5:00 AM	0.15	0.35	0.50
8/16/11 8:00 AM	0.18	0.49	0.67
8/16/11 11:00 AM	0.21	0.55	0.77
8/16/11 2:00 PM	0.22	0.64	0.86
8/16/11 5:00 PM	0.19	0.42	0.60
8/16/11 8:00 PM	0.23	0.42	0.65
8/16/11 11:00 PM	0.43	0.42	0.85
8/17/11 2:00 AM	0.50	0.42	0.93
8/17/11 5:00 AM	0.64	0.41	1.05
8/17/11 8:00 AM	0.68	0.45	1.13
8/17/11 11:00 AM	0.68	0.48	1.16

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
8/17/11 2:00 PM	0.77	0.43	1.21
8/17/11 5:00 PM	0.83	0.30	1.14
8/17/11 8:00 PM	0.80	0.23	1.03
8/17/11 11:00 PM	0.70	0.26	0.96
8/18/11 2:00 AM	0.33	0.27	0.60
8/18/11 5:00 AM	0.54	0.33	0.87
8/18/11 8:00 AM	0.70	0.47	1.17
8/18/11 11:00 AM	0.29	0.43	0.72
8/18/11 2:00 PM	0.30	0.40	0.71
8/18/11 5:00 PM	0.32	0.35	0.68
8/18/11 8:00 PM	0.34	0.34	0.68
8/18/11 11:00 PM	0.44	0.32	0.76
8/19/11 2:00 AM	0.77	0.20	0.97
8/19/11 5:00 AM	0.74	0.21	0.95
8/19/11 8:00 AM	0.31	0.26	0.57
8/19/11 11:00 AM	0.31	0.32	0.63
8/19/11 2:00 PM	0.34	0.30	0.65
8/19/11 5:00 PM	0.35	0.29	0.64
8/19/11 8:00 PM	0.54	0.29	0.83
8/19/11 11:00 PM	0.37	0.16	0.53
8/20/11 2:00 AM	0.67	0.09	0.76
8/20/11 5:00 AM	0.85	0.10	0.95
8/20/11 8:00 AM	0.67	0.26	0.94
8/20/11 11:00 AM	0.41	0.31	0.72
8/20/11 2:00 PM	0.43	0.29	0.72
8/20/11 5:00 PM	0.62	0.28	0.89
8/20/11 8:00 PM	0.43	0.25	0.69
8/20/11 11:00 PM	0.42	0.14	0.56
8/21/11 2:00 AM	0.53	0.10	0.63
8/21/11 5:00 AM	0.88	0.07	0.95
8/21/11 8:00 AM	0.78	0.15	0.92
8/21/11 11:00 AM	0.50	0.33	0.84
8/21/11 2:00 PM	0.70	0.35	1.05
8/21/11 5:00 PM	0.47	0.32	0.80
8/21/11 8:00 PM	0.51	0.29	0.80
8/21/11 11:00 PM	0.50	0.28	0.79
8/22/11 2:00 AM	0.70	0.17	0.87
8/22/11 5:00 AM	1.00	0.22	1.23
8/22/11 8:00 AM	0.46	0.31	0.77
8/22/11 11:00 AM	0.33	0.33	0.66
8/22/11 2:00 PM	0.33	0.35	0.68
8/22/11 5:00 PM	0.37	0.32	0.70
8/22/11 8:00 PM	0.64	0.32	0.96
8/22/11 11:00 PM	0.86	0.33	1.19
8/23/11 2:00 AM	0.61	0.32	0.93
8/23/11 5:00 AM	0.90	0.32	1.22
8/23/11 8:00 AM	0.92	0.36	1.28
8/23/11 11:00 AM	0.88	0.37	1.26
8/23/11 2:00 PM	0.91	0.30	1.21
8/23/11 5:00 PM	0.96	0.30	1.26
8/23/11 8:00 PM	0.63	0.08	0.71
8/23/11 11:00 PM	0.70	0.00	0.70
8/24/11 2:00 AM	0.46	0.00	0.46
8/24/11 5:00 AM	0.64	0.00	0.64

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
8/24/11 8:00 AM	0.88	0.00	0.88
8/24/11 11:00 AM	0.80	0.00	0.80
8/24/11 2:00 PM	0.73	0.00	0.73
8/24/11 5:00 PM	0.66	0.00	0.66
8/24/11 8:00 PM	0.33	0.00	0.33
8/24/11 11:00 PM	0.31	0.00	0.31
8/25/11 2:00 AM	0.35	0.00	0.35
8/25/11 5:00 AM	0.42	0.00	0.42
8/25/11 8:00 AM	0.31	0.00	0.31
8/25/11 11:00 AM	0.27	0.00	0.27
8/25/11 2:00 PM	0.29	0.00	0.29
8/25/11 5:00 PM	0.30	0.00	0.30
8/25/11 8:00 PM	0.34	0.00	0.34
8/25/11 11:00 PM	0.43	0.09	0.52
8/26/11 2:00 AM	0.54	0.34	0.88
8/26/11 5:00 AM	0.75	0.47	1.22
8/26/11 8:00 AM	0.83	0.85	1.68
8/26/11 11:00 AM	0.58	0.62	1.20
8/26/11 2:00 PM	0.29	0.40	0.69
8/26/11 5:00 PM	0.74	0.39	1.13
8/26/11 8:00 PM	0.64	0.37	1.01
8/26/11 11:00 PM	0.50	0.37	0.87
8/27/11 2:00 AM	0.38	0.37	0.75
8/27/11 5:00 AM	0.41	0.36	0.77
8/27/11 8:00 AM	0.72	0.40	1.13
8/27/11 11:00 AM	0.92	0.41	1.33
8/27/11 2:00 PM	0.48	0.39	0.88
8/27/11 5:00 PM	0.67	0.39	1.06
8/27/11 8:00 PM	0.89	0.33	1.23
8/27/11 11:00 PM	0.81	0.34	1.15
8/28/11 2:00 AM	0.81	0.33	1.14
8/28/11 5:00 AM	0.90	0.30	1.20
8/28/11 8:00 AM	0.85	0.27	1.12
8/28/11 11:00 AM	0.85	0.26	1.11
8/28/11 2:00 PM	0.52	0.35	0.87
8/28/11 5:00 PM	0.62	0.44	1.06
8/28/11 8:00 PM	0.95	0.43	1.38
8/28/11 11:00 PM	0.90	0.38	1.28
8/29/11 2:00 AM	0.89	0.20	1.09
8/29/11 5:00 AM	0.86	0.32	1.18
8/29/11 8:00 AM	0.87	0.37	1.24
8/29/11 11:00 AM	0.39	0.33	0.72
8/29/11 2:00 PM	0.33	0.33	0.66
8/29/11 5:00 PM	0.60	0.33	0.93
8/29/11 8:00 PM	0.70	0.34	1.04
8/29/11 11:00 PM	0.72	0.34	1.06
8/30/11 2:00 AM	0.45	0.36	0.81
8/30/11 5:00 AM	0.47	0.37	0.85
8/30/11 8:00 AM	0.63	0.38	1.02
8/30/11 11:00 AM	0.59	0.37	0.96
8/30/11 2:00 PM	0.54	0.42	0.96
8/30/11 5:00 PM	0.56	0.42	0.98
8/30/11 8:00 PM	0.39	0.42	0.81
8/30/11 11:00 PM	0.34	0.54	0.88

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
8/31/11 2:00 AM	0.55	0.35	0.90
8/31/11 5:00 AM	0.79	0.26	1.05
8/31/11 8:00 AM	0.62	0.52	1.15
8/31/11 11:00 AM	0.54	0.33	0.87
8/31/11 2:00 PM	0.60	0.26	0.86
8/31/11 5:00 PM	0.59	0.27	0.86
8/31/11 8:00 PM	0.69	0.26	0.95
8/31/11 11:00 PM	0.62	0.27	0.90
9/1/11 2:00 AM	0.45	0.26	0.71
9/1/11 5:00 AM	0.53	0.29	0.82
9/1/11 8:00 AM	0.78	0.39	1.16
9/1/11 11:00 AM	0.81	0.42	1.23
9/1/11 2:00 PM	0.76	0.42	1.18
9/1/11 5:00 PM	0.76	0.36	1.12
9/1/11 8:00 PM	0.75	0.11	0.86
9/1/11 11:00 PM	0.77	0.00	0.77
9/2/11 2:00 AM	0.74	0.00	0.74
9/2/11 5:00 AM	0.74	0.00	0.74
9/2/11 8:00 AM	0.85	0.00	0.85
9/2/11 11:00 AM	0.80	0.00	0.80
9/2/11 2:00 PM	0.83	0.00	0.83
9/2/11 5:00 PM	0.74	0.00	0.74
9/2/11 8:00 PM	0.83	0.00	0.83
9/2/11 11:00 PM	0.87	0.00	0.87
9/3/11 2:00 AM	0.86	0.00	0.86
9/3/11 5:00 AM	0.75	0.00	0.75
9/3/11 8:00 AM	0.89	0.00	0.89
9/3/11 11:00 AM	0.87	0.00	0.87
9/3/11 2:00 PM	0.83	0.00	0.83
9/3/11 5:00 PM	0.90	0.00	0.90
9/3/11 8:00 PM	0.88	0.00	0.88
9/3/11 11:00 PM	0.90	0.00	0.90
9/4/11 2:00 AM	0.99	0.00	0.99
9/4/11 5:00 AM	0.86	0.00	0.86
9/4/11 8:00 AM	0.72	0.13	0.85
9/4/11 11:00 AM	0.81	0.31	1.12
9/4/11 2:00 PM	0.82	0.49	1.30
9/4/11 5:00 PM	0.81	0.30	1.10
9/4/11 8:00 PM	0.86	0.59	1.46
9/4/11 11:00 PM	0.87	0.38	1.25
9/5/11 2:00 AM	0.90	0.35	1.25
9/5/11 5:00 AM	0.90	0.41	1.31
9/5/11 8:00 AM	0.88	0.48	1.36
9/5/11 11:00 AM	0.72	0.44	1.16
9/5/11 2:00 PM	0.67	0.46	1.12
9/5/11 5:00 PM	0.73	0.39	1.13
9/5/11 8:00 PM	0.70	0.42	1.11
9/5/11 11:00 PM	0.78	0.40	1.18
9/6/11 2:00 AM	0.80	0.30	1.11
9/6/11 5:00 AM	0.79	0.35	1.14
9/6/11 8:00 AM	0.75	0.35	1.10
9/6/11 11:00 AM	0.77	0.35	1.12
9/6/11 2:00 PM	0.51	0.42	0.93
9/6/11 5:00 PM	0.56	0.36	0.92

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
9/6/11 8:00 PM	0.89	0.34	1.23
9/6/11 11:00 PM	0.79	0.34	1.14
9/7/11 2:00 AM	0.56	0.42	0.98
9/7/11 5:00 AM	0.60	0.71	1.31
9/7/11 8:00 AM	0.74	0.72	1.46
9/7/11 11:00 AM	0.72	0.73	1.45
9/7/11 2:00 PM	0.70	0.89	1.59
9/7/11 5:00 PM	0.68	0.41	1.08
9/7/11 8:00 PM	0.66	0.43	1.09
9/7/11 11:00 PM	0.64	0.22	0.86
9/8/11 2:00 AM	0.39	0.13	0.52
9/8/11 5:00 AM	0.61	0.14	0.75
9/8/11 8:00 AM	0.66	0.17	0.83
9/8/11 11:00 AM	0.60	0.35	0.95
9/8/11 2:00 PM	0.66	0.52	1.18
9/8/11 5:00 PM	0.59	0.53	1.12
9/8/11 8:00 PM	0.50	0.47	0.97
9/8/11 11:00 PM	0.48	0.24	0.72
9/9/11 2:00 AM	0.46	0.22	0.69
9/9/11 5:00 AM	0.50	0.15	0.65
9/9/11 8:00 AM	0.50	0.30	0.80
9/9/11 11:00 AM	0.45	0.50	0.96
9/9/11 2:00 PM	0.44	0.42	0.86
9/9/11 5:00 PM	0.45	0.34	0.80
9/9/11 8:00 PM	0.56	0.29	0.85
9/9/11 11:00 PM	0.48	0.26	0.74
9/10/11 2:00 AM	0.37	0.21	0.58
9/10/11 5:00 AM	0.43	0.22	0.65
9/10/11 8:00 AM	0.42	0.23	0.65
9/10/11 11:00 AM	0.42	0.20	0.62
9/10/11 2:00 PM	0.49	0.18	0.67
9/10/11 5:00 PM	0.55	0.18	0.73
9/10/11 8:00 PM	0.54	0.18	0.72
9/10/11 11:00 PM	0.52	0.18	0.70
9/11/11 2:00 AM	0.55	0.07	0.62
9/11/11 5:00 AM	0.62	0.08	0.70
9/11/11 8:00 AM	0.66	0.17	0.83
9/11/11 11:00 AM	0.59	0.24	0.83
9/11/11 2:00 PM	0.68	0.23	0.91
9/11/11 5:00 PM	0.69	0.22	0.91
9/11/11 8:00 PM	0.74	0.22	0.95
9/11/11 11:00 PM	0.72	0.21	0.93
9/12/11 2:00 AM	0.68	0.20	0.88
9/12/11 5:00 AM	0.69	0.20	0.89
9/12/11 8:00 AM	0.71	0.19	0.90
9/12/11 11:00 AM	0.63	0.19	0.82
9/12/11 2:00 PM	0.71	0.20	0.91
9/12/11 5:00 PM	0.75	0.21	0.96
9/12/11 8:00 PM	0.74	0.21	0.95
9/12/11 11:00 PM	0.72	0.18	0.89
9/13/11 2:00 AM	0.69	0.06	0.75
9/13/11 5:00 AM	0.66	0.07	0.73
9/13/11 8:00 AM	0.77	0.08	0.85
9/13/11 11:00 AM	0.69	0.09	0.79

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
9/13/11 2:00 PM	0.60	0.81	1.41
9/13/11 5:00 PM	0.71	0.41	1.12
9/13/11 8:00 PM	0.69	0.39	1.08
9/13/11 11:00 PM	0.51	0.32	0.83
9/14/11 2:00 AM	0.49	0.29	0.78
9/14/11 5:00 AM	0.53	0.28	0.81
9/14/11 8:00 AM	0.69	0.50	1.19
9/14/11 11:00 AM	0.76	0.51	1.27
9/14/11 2:00 PM	0.81	0.25	1.06
9/14/11 5:00 PM	0.81	0.21	1.02
9/14/11 8:00 PM	0.78	0.21	0.99
9/14/11 11:00 PM	0.70	0.21	0.91
9/15/11 2:00 AM	0.43	0.22	0.65
9/15/11 5:00 AM	0.54	0.22	0.76
9/15/11 8:00 AM	0.71	0.24	0.94
9/15/11 11:00 AM	0.72	0.24	0.96
9/15/11 2:00 PM	0.68	0.26	0.93
9/15/11 5:00 PM	0.67	0.63	1.31
9/15/11 8:00 PM	0.72	0.29	1.02
9/15/11 11:00 PM	0.69	0.34	1.03
9/16/11 2:00 AM	0.23	0.46	0.69
9/16/11 5:00 AM	0.22	0.43	0.64
9/16/11 8:00 AM	0.63	0.27	0.91
9/16/11 11:00 AM	0.68	0.29	0.96
9/16/11 2:00 PM	0.75	0.30	1.05
9/16/11 5:00 PM	0.73	0.31	1.04
9/16/11 8:00 PM	0.76	0.29	1.04
9/16/11 11:00 PM	0.75	0.05	0.80
9/17/11 2:00 AM	0.72	0.00	0.72
9/17/11 5:00 AM	0.71	0.04	0.75
9/17/11 8:00 AM	0.72	0.23	0.94
9/17/11 11:00 AM	0.72	0.57	1.29
9/17/11 2:00 PM	0.76	0.54	1.30
9/17/11 5:00 PM	0.75	0.46	1.21
9/17/11 8:00 PM	0.75	0.40	1.15
9/17/11 11:00 PM	0.80	0.40	1.20
9/18/11 2:00 AM	0.82	0.40	1.22
9/18/11 5:00 AM	0.79	0.31	1.10
9/18/11 8:00 AM	0.78	0.05	0.83
9/18/11 11:00 AM	0.78	0.06	0.84
9/18/11 2:00 PM	0.89	0.06	0.96
9/18/11 5:00 PM	0.91	0.07	0.98
9/18/11 8:00 PM	0.39	0.08	0.47
9/18/11 11:00 PM	0.35	0.39	0.74
9/19/11 2:00 AM	0.40	0.29	0.69
9/19/11 5:00 AM	0.39	0.26	0.65
9/19/11 8:00 AM	0.38	0.24	0.62
9/19/11 11:00 AM	0.37	0.22	0.59
9/19/11 2:00 PM	0.35	0.21	0.56
9/19/11 5:00 PM	0.32	0.20	0.52
9/19/11 8:00 PM	0.30	0.19	0.50
9/19/11 11:00 PM	0.30	0.20	0.50
9/20/11 2:00 AM	0.29	0.21	0.50
9/20/11 5:00 AM	0.28	0.23	0.51

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
9/20/11 8:00 AM	0.27	0.23	0.50
9/20/11 11:00 AM	0.27	0.25	0.52
9/20/11 2:00 PM	0.28	0.25	0.54
9/20/11 5:00 PM	0.32	0.27	0.59
9/20/11 8:00 PM	0.31	0.30	0.61
9/20/11 11:00 PM	0.31	0.32	0.63
9/21/11 2:00 AM	0.52	0.35	0.87
9/21/11 5:00 AM	0.52	0.38	0.89
9/21/11 8:00 AM	0.33	0.40	0.73
9/21/11 11:00 AM	0.35	0.42	0.77
9/21/11 2:00 PM	0.32	0.39	0.71
9/21/11 5:00 PM	0.76	0.34	1.10
9/21/11 8:00 PM	0.92	0.35	1.27
9/21/11 11:00 PM	0.92	0.37	1.30
9/22/11 2:00 AM	0.36	0.40	0.76
9/22/11 5:00 AM	0.35	0.50	0.85
9/22/11 8:00 AM	0.33	0.42	0.75
9/22/11 11:00 AM	0.38	0.36	0.74
9/22/11 2:00 PM	0.41	0.37	0.77
9/22/11 5:00 PM	0.44	0.39	0.83
9/22/11 8:00 PM	0.42	0.43	0.85
9/22/11 11:00 PM	0.43	0.44	0.87
9/23/11 2:00 AM	0.60	0.44	1.04
9/23/11 5:00 AM	0.54	0.28	0.82
9/23/11 8:00 AM	0.53	0.13	0.66
9/23/11 11:00 AM	0.58	0.14	0.72
9/23/11 2:00 PM	0.78	0.16	0.94
9/23/11 5:00 PM	0.83	0.19	1.02
9/23/11 8:00 PM	0.96	0.23	1.19
9/23/11 11:00 PM	0.65	0.25	0.90
9/24/11 2:00 AM	1.03	0.22	1.25
9/24/11 5:00 AM	0.89	0.28	1.17
9/24/11 8:00 AM	0.70	0.30	0.99
9/24/11 11:00 AM	0.47	0.17	0.64
9/24/11 2:00 PM	0.78	0.27	1.05
9/24/11 5:00 PM	0.67	0.39	1.06
9/24/11 8:00 PM	0.74	0.39	1.12
9/24/11 11:00 PM	0.80	0.40	1.20
9/25/11 2:00 AM	0.64	0.42	1.06
9/25/11 5:00 AM	0.73	0.47	1.20
9/25/11 8:00 AM	0.75	0.49	1.24
9/25/11 11:00 AM	0.68	0.48	1.16
9/25/11 2:00 PM	0.69	0.46	1.15
9/25/11 5:00 PM	0.61	0.45	1.07
9/25/11 8:00 PM	0.62	0.44	1.05
9/25/11 11:00 PM	0.45	0.44	0.89
9/26/11 2:00 AM	0.62	0.38	1.00
9/26/11 5:00 AM	0.61	0.37	0.98
9/26/11 8:00 AM	0.63	0.51	1.14
9/26/11 11:00 AM	0.59	0.49	1.08
9/26/11 2:00 PM	0.56	0.50	1.06
9/26/11 5:00 PM	0.50	0.47	0.97
9/26/11 8:00 PM	0.57	0.39	0.97
9/26/11 11:00 PM	0.52	0.38	0.89

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
9/27/11 2:00 AM	0.51	0.33	0.83
9/27/11 5:00 AM	0.51	0.33	0.84
9/27/11 8:00 AM	0.57	0.39	0.96
9/27/11 11:00 AM	0.55	0.26	0.81
9/27/11 2:00 PM	0.48	0.25	0.73
9/27/11 5:00 PM	0.44	0.14	0.58
9/27/11 8:00 PM	0.49	0.13	0.61
9/27/11 11:00 PM	0.61	0.05	0.66
9/28/11 2:00 AM	0.45	0.05	0.49
9/28/11 5:00 AM	0.54	0.09	0.63
9/28/11 8:00 AM	0.53	0.18	0.71
9/28/11 11:00 AM	0.49	0.18	0.67
9/28/11 2:00 PM	0.48	0.17	0.65
9/28/11 5:00 PM	0.48	0.18	0.66
9/28/11 8:00 PM	0.48	0.25	0.74
9/28/11 11:00 PM	0.50	0.25	0.74
9/29/11 2:00 AM	0.39	0.26	0.65
9/29/11 5:00 AM	0.41	0.25	0.66
9/29/11 8:00 AM	0.51	0.33	0.84
9/29/11 11:00 AM	0.51	0.28	0.79
9/29/11 2:00 PM	0.50	0.26	0.76
9/29/11 5:00 PM	0.44	0.26	0.70
9/29/11 8:00 PM	0.44	0.25	0.70
9/29/11 11:00 PM	0.45	0.26	0.71
9/30/11 2:00 AM	0.48	0.26	0.74
9/30/11 5:00 AM	0.46	0.22	0.68
9/30/11 8:00 AM	0.47	2.98	3.46
9/30/11 11:00 AM	0.54	0.27	0.81
9/30/11 2:00 PM	0.48	0.22	0.71
9/30/11 5:00 PM	0.28	0.24	0.52
9/30/11 8:00 PM	0.12	0.22	0.34
9/30/11 11:00 PM	0.13	0.21	0.34
10/1/11 2:00 AM	0.20	0.21	0.41
10/1/11 5:00 AM	0.22	0.22	0.43
10/1/11 8:00 AM	0.16	0.21	0.37
10/1/11 11:00 AM	0.12	0.21	0.33
10/1/11 2:00 PM	0.12	0.11	0.23
10/1/11 5:00 PM	0.13	0.00	0.13
10/1/11 8:00 PM	0.13	0.00	0.13
10/1/11 11:00 PM	0.14	0.00	0.14
10/2/11 2:00 AM	0.14	0.00	0.14
10/2/11 5:00 AM	0.13	0.00	0.13
10/2/11 8:00 AM	0.13	0.00	0.13
10/2/11 11:00 AM	0.13	0.00	0.13
10/2/11 2:00 PM	0.14	0.00	0.14
10/2/11 5:00 PM	0.13	0.00	0.13
10/2/11 8:00 PM	0.13	0.00	0.13
10/2/11 11:00 PM	0.13	0.00	0.13
10/3/11 2:00 AM	0.14	0.00	0.14
10/3/11 5:00 AM	0.14	0.00	0.14
10/3/11 8:00 AM	0.14	0.00	0.14
10/3/11 11:00 AM	0.14	0.00	0.14
10/3/11 2:00 PM	0.15	0.00	0.15
10/3/11 5:00 PM	0.15	0.00	0.15

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
10/3/11 8:00 PM	0.16	0.00	0.16
10/3/11 11:00 PM	0.16	0.00	0.16
10/4/11 2:00 AM	0.15	0.28	0.44
10/4/11 5:00 AM	0.16	0.66	0.82
10/4/11 8:00 AM	0.15	1.02	1.18
10/4/11 11:00 AM	0.16	0.39	0.55
10/4/11 2:00 PM	0.16	0.34	0.50
10/4/11 5:00 PM	0.18	0.29	0.46
10/4/11 8:00 PM	0.18	0.27	0.45
10/4/11 11:00 PM	0.18	0.29	0.47
10/5/11 2:00 AM	0.19	0.19	0.37
10/5/11 5:00 AM	0.19	0.12	0.32
10/5/11 8:00 AM	0.20	0.23	0.42
10/5/11 11:00 AM	0.19	0.40	0.58
10/5/11 2:00 PM	0.18	0.46	0.64
10/5/11 5:00 PM	0.18	0.45	0.63
10/5/11 8:00 PM	0.18	0.36	0.54
10/5/11 11:00 PM	0.18	0.10	0.29
10/6/11 2:00 AM	0.17	0.08	0.26
10/6/11 5:00 AM	0.18	0.09	0.27
10/6/11 8:00 AM	0.17	0.36	0.53
10/6/11 11:00 AM	0.16	0.38	0.55
10/6/11 2:00 PM	0.16	0.37	0.53
10/6/11 5:00 PM	0.16	0.34	0.50
10/6/11 8:00 PM	0.16	0.30	0.45
10/6/11 11:00 PM	0.15	0.34	0.49
10/7/11 2:00 AM	0.15	0.26	0.41
10/7/11 5:00 AM	0.15	0.27	0.41
10/7/11 8:00 AM	0.14	0.31	0.45
10/7/11 11:00 AM	0.14	0.32	0.46
10/7/11 2:00 PM	0.13	0.33	0.46
10/7/11 5:00 PM	0.12	0.31	0.43
10/7/11 8:00 PM	0.09	0.29	0.38
10/7/11 11:00 PM	0.08	0.25	0.33
10/8/11 2:00 AM	0.01	0.26	0.27
10/8/11 5:00 AM	0.00	0.24	0.24
10/8/11 8:00 AM	0.00	0.23	0.23
10/8/11 11:00 AM	0.00	0.22	0.22
10/8/11 2:00 PM	0.00	0.22	0.22
10/8/11 5:00 PM	0.00	0.20	0.20
10/8/11 8:00 PM	0.00	0.19	0.19
10/8/11 11:00 PM	0.00	0.15	0.15
10/9/11 2:00 AM	0.00	0.10	0.10
10/9/11 5:00 AM	0.00	0.00	0.00
10/9/11 8:00 AM	0.00	0.00	0.00
10/9/11 11:00 AM	0.00	0.00	0.00
10/9/11 2:00 PM	0.00	0.00	0.00
10/9/11 5:00 PM	0.00	0.00	0.00
10/9/11 8:00 PM	0.00	0.00	0.00
10/9/11 11:00 PM	0.00	0.00	0.00
10/10/11 2:00 AM	0.00	0.00	0.00
10/10/11 5:00 AM	0.00	0.00	0.00
10/10/11 8:00 AM	0.00	0.00	0.00
10/10/11 11:00 AM	0.00	0.00	0.00

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
10/10/11 2:00 PM	0.00	0.00	0.00
10/10/11 5:00 PM	0.00	0.00	0.00
10/10/11 8:00 PM	0.00	0.00	0.00
10/10/11 11:00 PM	0.00	0.00	0.00
10/11/11 2:00 AM	0.00	0.03	0.03
10/11/11 5:00 AM	0.00	0.18	0.18
10/11/11 8:00 AM	0.00	0.69	0.69
10/11/11 11:00 AM	0.00	0.42	0.42
10/11/11 2:00 PM	0.00	0.35	0.35
10/11/11 5:00 PM	0.00	0.31	0.31
10/11/11 8:00 PM	0.00	0.30	0.30
10/11/11 11:00 PM	0.00	0.30	0.30
10/12/11 2:00 AM	0.00	0.09	0.09
10/12/11 5:00 AM	0.00	0.09	0.09
10/12/11 8:00 AM	0.00	0.10	0.10
10/12/11 11:00 AM	0.00	0.12	0.12
10/12/11 2:00 PM	0.00	0.14	0.14
10/12/11 5:00 PM	0.00	0.08	0.08
10/12/11 8:00 PM	0.00	0.15	0.15
10/12/11 11:00 PM	0.00	0.29	0.29
10/13/11 2:00 AM	0.00	0.53	0.53
10/13/11 5:00 AM	0.00	0.46	0.46
10/13/11 8:00 AM	0.00	0.43	0.43
10/13/11 11:00 AM	0.00	0.40	0.40
10/13/11 2:00 PM	0.00	0.42	0.42
10/13/11 5:00 PM	0.00	0.42	0.42
10/13/11 8:00 PM	0.00	0.41	0.41
10/13/11 11:00 PM	0.00	0.42	0.42
10/14/11 2:00 AM	0.00	0.41	0.41
10/14/11 5:00 AM	0.00	0.41	0.41
10/14/11 8:00 AM	0.00	0.42	0.42
10/14/11 11:00 AM	0.00	0.46	0.46
10/14/11 2:00 PM	0.00	0.52	0.52
10/14/11 5:00 PM	0.00	0.54	0.54
10/14/11 8:00 PM	0.00	0.51	0.51
10/14/11 11:00 PM	0.00	0.57	0.57
10/15/11 2:00 AM	0.00	0.61	0.61
10/15/11 5:00 AM	0.00	0.59	0.59
10/15/11 8:00 AM	0.00	0.41	0.41
10/15/11 11:00 AM	0.00	0.46	0.46
10/15/11 2:00 PM	0.00	0.45	0.45
10/15/11 5:00 PM	0.00	0.33	0.34
10/15/11 8:00 PM	0.05	0.29	0.34
10/15/11 11:00 PM	0.09	0.04	0.13
10/16/11 2:00 AM	0.11	0.05	0.16
10/16/11 5:00 AM	0.13	0.06	0.19
10/16/11 8:00 AM	0.27	0.06	0.33
10/16/11 11:00 AM	0.34	0.26	0.60
10/16/11 2:00 PM	0.33	0.38	0.71
10/16/11 5:00 PM	0.28	0.33	0.62
10/16/11 8:00 PM	0.13	0.28	0.41
10/16/11 11:00 PM	0.22	0.27	0.49
10/17/11 2:00 AM	0.21	0.28	0.50
10/17/11 5:00 AM	0.15	0.29	0.44

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
10/17/11 8:00 AM	0.24	0.29	0.53
10/17/11 11:00 AM	0.23	0.30	0.53
10/17/11 2:00 PM	0.22	0.32	0.54
10/17/11 5:00 PM	0.21	0.33	0.54
10/17/11 8:00 PM	0.21	0.30	0.51
10/17/11 11:00 PM	0.22	0.14	0.36
10/18/11 2:00 AM	0.21	0.11	0.31
10/18/11 5:00 AM	0.21	0.10	0.31
10/18/11 8:00 AM	0.21	0.12	0.33
10/18/11 11:00 AM	0.21	0.49	0.70
10/18/11 2:00 PM	0.22	0.51	0.73
10/18/11 5:00 PM	0.21	0.40	0.61
10/18/11 8:00 PM	0.22	0.35	0.57
10/18/11 11:00 PM	0.17	0.31	0.48
10/19/11 2:00 AM	0.07	0.33	0.39
10/19/11 5:00 AM	0.09	0.28	0.36
10/19/11 8:00 AM	0.10	0.29	0.40
10/19/11 11:00 AM	0.10	0.34	0.44
10/19/11 2:00 PM	0.11	0.29	0.39
10/19/11 5:00 PM	0.12	0.25	0.36
10/19/11 8:00 PM	0.13	0.24	0.37
10/19/11 11:00 PM	0.11	0.26	0.37
10/20/11 2:00 AM	0.07	0.26	0.33
10/20/11 5:00 AM	0.09	0.24	0.33
10/20/11 8:00 AM	0.14	0.24	0.38
10/20/11 11:00 AM	0.15	0.26	0.40
10/20/11 2:00 PM	0.14	0.29	0.43
10/20/11 5:00 PM	0.13	0.29	0.42
10/20/11 8:00 PM	0.14	0.31	0.44
10/20/11 11:00 PM	0.14	0.31	0.45
10/21/11 2:00 AM	0.09	0.30	0.40
10/21/11 5:00 AM	0.12	0.31	0.43
10/21/11 8:00 AM	0.18	0.14	0.32
10/21/11 11:00 AM	0.18	0.00	0.18
10/21/11 2:00 PM	0.19	0.00	0.19
10/21/11 5:00 PM	0.18	0.00	0.18
10/21/11 8:00 PM	0.18	0.00	0.18
10/21/11 11:00 PM	0.19	0.00	0.19
10/22/11 2:00 AM	0.19	0.00	0.19
10/22/11 5:00 AM	0.18	0.00	0.18
10/22/11 8:00 AM	0.17	0.00	0.17
10/22/11 11:00 AM	0.18	0.00	0.18
10/22/11 2:00 PM	0.22	0.00	0.22
10/22/11 5:00 PM	0.21	0.00	0.21
10/22/11 8:00 PM	0.20	0.00	0.20
10/22/11 11:00 PM	0.20	0.00	0.20
10/23/11 2:00 AM	0.21	0.00	0.21
10/23/11 5:00 AM	0.20	0.00	0.20
10/23/11 8:00 AM	0.20	0.00	0.20
10/23/11 11:00 AM	0.20	0.00	0.20
10/23/11 2:00 PM	0.22	0.00	0.22
10/23/11 5:00 PM	0.22	0.00	0.22
10/23/11 8:00 PM	0.23	0.00	0.23
10/23/11 11:00 PM	0.20	0.00	0.20

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
10/24/11 2:00 AM	0.15	0.00	0.15
10/24/11 5:00 AM	0.21	0.00	0.21
10/24/11 8:00 AM	0.32	0.00	0.32
10/24/11 11:00 AM	0.32	0.00	0.32
10/24/11 2:00 PM	0.34	0.00	0.34
10/24/11 5:00 PM	0.33	0.00	0.33
10/24/11 8:00 PM	0.34	0.00	0.34
10/24/11 11:00 PM	0.35	0.00	0.35
10/25/11 2:00 AM	0.34	0.00	0.34
10/25/11 5:00 AM	0.34	0.00	0.34
10/25/11 8:00 AM	0.35	0.00	0.35
10/25/11 11:00 AM	0.37	0.00	0.37
10/25/11 2:00 PM	0.32	0.00	0.32
10/25/11 5:00 PM	0.30	0.00	0.30
10/25/11 8:00 PM	0.30	0.00	0.30
10/25/11 11:00 PM	0.31	0.00	0.31
10/26/11 2:00 AM	0.32	0.00	0.32
10/26/11 5:00 AM	0.31	0.00	0.31
10/26/11 8:00 AM	0.35	0.00	0.35
10/26/11 11:00 AM	0.34	0.00	0.34
10/26/11 2:00 PM	0.32	0.00	0.32
10/26/11 5:00 PM	0.34	0.00	0.34
10/26/11 8:00 PM	0.52	0.00	0.52
10/26/11 11:00 PM	0.51	0.00	0.51
10/27/11 2:00 AM	0.47	0.00	0.47
10/27/11 5:00 AM	0.39	0.00	0.39
10/27/11 8:00 AM	0.36	0.00	0.36
10/27/11 11:00 AM	0.46	0.00	0.46
10/27/11 2:00 PM	0.42	0.00	0.42
10/27/11 5:00 PM	0.36	0.00	0.36
10/27/11 8:00 PM	0.36	0.00	0.36
10/27/11 11:00 PM	0.38	0.00	0.38
10/28/11 2:00 AM	0.33	0.00	0.33
10/28/11 5:00 AM	0.37	0.00	0.37
10/28/11 8:00 AM	0.44	0.00	0.44
10/28/11 11:00 AM	0.35	0.00	0.35
10/28/11 2:00 PM	0.37	0.00	0.37
10/28/11 5:00 PM	0.33	0.00	0.33
10/28/11 8:00 PM	0.35	0.00	0.35
10/28/11 11:00 PM	0.26	0.00	0.26
10/29/11 2:00 AM	0.15	0.00	0.15
10/29/11 5:00 AM	0.01	0.00	0.01
10/29/11 8:00 AM	0.00	0.00	0.00
10/29/11 11:00 AM	0.11	0.00	0.11
10/29/11 2:00 PM	0.30	0.00	0.30
10/29/11 5:00 PM	0.27	0.00	0.27
10/29/11 8:00 PM	0.31	0.00	0.31
10/29/11 11:00 PM	0.37	0.00	0.37
10/30/11 2:00 AM	0.36	0.00	0.36
10/30/11 5:00 AM	0.38	0.00	0.38
10/30/11 8:00 AM	0.37	0.00	0.37
10/30/11 11:00 AM	0.37	0.00	0.37
10/30/11 2:00 PM	0.36	0.00	0.36
10/30/11 5:00 PM	0.39	0.00	0.39

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
10/30/11 8:00 PM	0.43	0.00	0.43
10/30/11 11:00 PM	0.45	0.00	0.45
10/31/11 2:00 AM	0.45	0.00	0.45
10/31/11 5:00 AM	0.46	0.00	0.46
10/31/11 8:00 AM	0.44	0.00	0.44
10/31/11 11:00 AM	0.47	0.00	0.47
10/31/11 2:00 PM	0.50	0.00	0.50
10/31/11 5:00 PM	0.53	0.00	0.53
10/31/11 8:00 PM	0.45	0.00	0.45
10/31/11 11:00 PM	0.44	0.00	0.44
11/1/11 2:00 AM	0.41	0.00	0.41
11/1/11 5:00 AM	0.36	0.00	0.36
11/1/11 8:00 AM	0.35	0.00	0.35
11/1/11 11:00 AM	0.35	0.00	0.35
11/1/11 2:00 PM	0.36	0.00	0.36
11/1/11 5:00 PM	0.36	0.00	0.36
11/1/11 8:00 PM	0.30	0.00	0.30
11/1/11 11:00 PM	0.32	0.00	0.32
11/2/11 2:00 AM	0.33	0.00	0.33
11/2/11 5:00 AM	0.33	0.00	0.33
11/2/11 8:00 AM	0.36	0.00	0.36
11/2/11 11:00 AM	0.39	0.00	0.39
11/2/11 2:00 PM	0.32	0.00	0.32
11/2/11 5:00 PM	0.31	0.00	0.31
11/2/11 8:00 PM	0.32	0.00	0.32
11/2/11 11:00 PM	0.33	0.00	0.33
11/3/11 2:00 AM	0.32	0.00	0.32
11/3/11 5:00 AM	0.32	0.00	0.32
11/3/11 8:00 AM	0.34	0.00	0.34
11/3/11 11:00 AM	0.36	0.00	0.36
11/3/11 2:00 PM	0.34	0.00	0.34
11/3/11 5:00 PM	0.34	0.00	0.34
11/3/11 8:00 PM	0.32	0.00	0.32
11/3/11 11:00 PM	0.35	0.00	0.35
11/4/11 2:00 AM	0.36	0.00	0.36
11/4/11 5:00 AM	0.34	0.00	0.34
11/4/11 8:00 AM	0.38	0.00	0.38
11/4/11 11:00 AM	0.40	0.00	0.40
11/4/11 2:00 PM	0.39	0.00	0.39
11/4/11 5:00 PM	0.40	0.00	0.40
11/4/11 8:00 PM	0.41	0.00	0.41
11/4/11 11:00 PM	0.41	0.00	0.41
11/5/11 2:00 AM	0.36	0.00	0.36
11/5/11 5:00 AM	0.36	0.00	0.36
11/5/11 8:00 AM	0.42	0.00	0.42
11/5/11 11:00 AM	0.41	0.00	0.41
11/5/11 2:00 PM	0.44	0.00	0.44
11/5/11 5:00 PM	0.46	0.00	0.46
11/5/11 8:00 PM	0.44	0.00	0.44
11/5/11 11:00 PM	0.45	0.00	0.45
11/6/11 2:00 AM	0.45	0.00	0.45
11/6/11 5:00 AM	0.44	0.00	0.44
11/6/11 8:00 AM	0.45	0.00	0.45
11/6/11 11:00 AM	0.47	0.00	0.47

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
11/6/11 2:00 PM	0.48	0.00	0.48
11/6/11 5:00 PM	0.50	0.00	0.50
11/6/11 8:00 PM	0.61	0.00	0.61
11/6/11 11:00 PM	0.54	0.00	0.54
11/7/11 2:00 AM	0.49	0.00	0.49
11/7/11 5:00 AM	0.47	0.00	0.47
11/7/11 8:00 AM	0.51	0.00	0.51
11/7/11 11:00 AM	0.56	0.00	0.56
11/7/11 2:00 PM	0.56	0.00	0.56
11/7/11 5:00 PM	0.53	0.00	0.53
11/7/11 8:00 PM	0.41	0.00	0.41
11/7/11 11:00 PM	0.08	0.00	0.08
11/8/11 2:00 AM	0.00	0.00	0.00
11/8/11 5:00 AM	0.00	0.00	0.00
11/8/11 8:00 AM	0.00	0.00	0.00
11/8/11 11:00 AM	0.00	0.00	0.00
11/8/11 2:00 PM	0.00	0.00	0.00
11/8/11 5:00 PM	0.00	0.00	0.00
11/8/11 8:00 PM	0.00	0.02	0.02
11/8/11 11:00 PM	0.00	0.39	0.39
11/9/11 2:00 AM	0.00	0.69	0.69
11/9/11 5:00 AM	0.00	0.22	0.22
11/9/11 8:00 AM	0.00	0.04	0.04
11/9/11 11:00 AM	0.00	0.00	0.00
11/9/11 2:00 PM	0.00	0.00	0.00
11/9/11 5:00 PM	0.00	0.00	0.00
11/9/11 8:00 PM	0.00	0.00	0.00
11/9/11 11:00 PM	0.00	0.12	0.12
11/10/11 2:00 AM	0.00	0.18	0.18
11/10/11 5:00 AM	0.00	0.37	0.37
11/10/11 8:00 AM	0.00	0.38	0.38
11/10/11 11:00 AM	0.00	0.41	0.41
11/10/11 2:00 PM	0.00	0.44	0.44
11/10/11 5:00 PM	0.00	0.38	0.38
11/10/11 8:00 PM	0.10	0.41	0.50
11/10/11 11:00 PM	0.35	0.40	0.76
11/11/11 2:00 AM	0.36	0.35	0.71
11/11/11 5:00 AM	0.38	0.35	0.73
11/11/11 8:00 AM	0.47	0.40	0.87
11/11/11 11:00 AM	0.44	0.29	0.73
11/11/11 2:00 PM	0.41	0.21	0.61
11/11/11 5:00 PM	0.43	0.18	0.61
11/11/11 8:00 PM	0.40	0.16	0.55
11/11/11 11:00 PM	0.33	0.14	0.47
11/12/11 2:00 AM	0.33	0.09	0.42
11/12/11 5:00 AM	0.32	0.09	0.41
11/12/11 8:00 AM	0.33	0.12	0.45
11/12/11 11:00 AM	0.32	0.13	0.44
11/12/11 2:00 PM	0.31	0.12	0.43
11/12/11 5:00 PM	0.39	0.11	0.51
11/12/11 8:00 PM	0.38	0.12	0.50
11/12/11 11:00 PM	0.36	0.13	0.49
11/13/11 2:00 AM	0.38	0.14	0.52
11/13/11 5:00 AM	0.42	0.16	0.58

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
11/13/11 8:00 AM	0.43	0.18	0.60
11/13/11 11:00 AM	0.43	0.19	0.62
11/13/11 2:00 PM	0.42	0.20	0.62
11/13/11 5:00 PM	0.39	0.21	0.61
11/13/11 8:00 PM	0.42	0.23	0.65
11/13/11 11:00 PM	0.45	0.24	0.69
11/14/11 2:00 AM	0.35	0.20	0.56
11/14/11 5:00 AM	0.37	0.21	0.58
11/14/11 8:00 AM	0.47	0.25	0.73
11/14/11 11:00 AM	0.50	0.21	0.71
11/14/11 2:00 PM	0.49	0.20	0.69
11/14/11 5:00 PM	0.48	0.18	0.66
11/14/11 8:00 PM	0.54	0.18	0.72
11/14/11 11:00 PM	0.48	0.17	0.64
11/15/11 2:00 AM	0.28	0.17	0.46
11/15/11 5:00 AM	0.31	0.17	0.48
11/15/11 8:00 AM	0.36	0.17	0.53
11/15/11 11:00 AM	0.35	0.17	0.53
11/15/11 2:00 PM	0.47	0.18	0.64
11/15/11 5:00 PM	0.55	0.18	0.73
11/15/11 8:00 PM	0.53	0.18	0.70
11/15/11 11:00 PM	0.53	0.18	0.71
11/16/11 2:00 AM	0.38	0.19	0.56
11/16/11 5:00 AM	0.41	0.18	0.59
11/16/11 8:00 AM	0.65	0.18	0.83
11/16/11 11:00 AM	0.59	0.17	0.76
11/16/11 2:00 PM	0.66	0.18	0.84
11/16/11 5:00 PM	0.65	0.18	0.83
11/16/11 8:00 PM	0.52	0.18	0.70
11/16/11 11:00 PM	0.46	0.14	0.59
11/17/11 2:00 AM	0.47	0.08	0.56
11/17/11 5:00 AM	0.42	0.08	0.50
11/17/11 8:00 AM	0.45	0.12	0.58
11/17/11 11:00 AM	0.43	0.20	0.63
11/17/11 2:00 PM	0.41	0.17	0.58
11/17/11 5:00 PM	0.39	0.16	0.55
11/17/11 8:00 PM	0.36	0.15	0.51
11/17/11 11:00 PM	0.35	0.16	0.50
11/18/11 2:00 AM	0.31	0.12	0.42
11/18/11 5:00 AM	0.31	0.10	0.41
11/18/11 8:00 AM	0.36	0.18	0.54
11/18/11 11:00 AM	0.37	0.17	0.54
11/18/11 2:00 PM	0.34	0.17	0.51
11/18/11 5:00 PM	0.32	0.16	0.48
11/18/11 8:00 PM	0.29	0.16	0.45
11/18/11 11:00 PM	0.27	0.16	0.44
11/19/11 2:00 AM	0.26	0.16	0.43
11/19/11 5:00 AM	0.24	0.17	0.42
11/19/11 8:00 AM	0.24	0.17	0.42
11/19/11 11:00 AM	0.22	0.18	0.41
11/19/11 2:00 PM	0.21	0.19	0.41
11/19/11 5:00 PM	0.20	0.20	0.40
11/19/11 8:00 PM	0.19	0.19	0.39
11/19/11 11:00 PM	0.19	0.16	0.35

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
11/20/11 2:00 AM	0.17	0.18	0.35
11/20/11 5:00 AM	0.14	0.17	0.31
11/20/11 8:00 AM	0.16	0.17	0.33
11/20/11 11:00 AM	0.21	0.21	0.42
11/20/11 2:00 PM	0.20	0.22	0.41
11/20/11 5:00 PM	0.19	0.22	0.41
11/20/11 8:00 PM	0.19	0.23	0.42
11/20/11 11:00 PM	0.18	0.23	0.41
11/21/11 2:00 AM	0.15	0.22	0.37
11/21/11 5:00 AM	0.16	0.23	0.39
11/21/11 8:00 AM	0.19	0.22	0.41
11/21/11 11:00 AM	0.19	0.23	0.42
11/21/11 2:00 PM	0.19	0.07	0.25
11/21/11 5:00 PM	0.20	0.16	0.36
11/21/11 8:00 PM	0.19	0.29	0.48
11/21/11 11:00 PM	0.19	0.29	0.48
11/22/11 2:00 AM	0.18	0.29	0.47
11/22/11 5:00 AM	0.16	0.29	0.45
11/22/11 8:00 AM	0.21	0.29	0.50
11/22/11 11:00 AM	0.21	0.28	0.49
11/22/11 2:00 PM	0.20	0.27	0.48
11/22/11 5:00 PM	0.21	0.27	0.48
11/22/11 8:00 PM	0.21	0.26	0.47
11/22/11 11:00 PM	0.21	0.26	0.47
11/23/11 2:00 AM	0.14	0.25	0.39
11/23/11 5:00 AM	0.10	0.25	0.35
11/23/11 8:00 AM	0.15	0.27	0.42
11/23/11 11:00 AM	0.21	0.30	0.51
11/23/11 2:00 PM	0.19	0.27	0.46
11/23/11 5:00 PM	0.19	0.27	0.46
11/23/11 8:00 PM	0.19	0.25	0.44
11/23/11 11:00 PM	0.20	0.28	0.47
11/24/11 2:00 AM	0.15	0.21	0.36
11/24/11 5:00 AM	0.13	0.10	0.23
11/24/11 8:00 AM	0.13	0.11	0.24
11/24/11 11:00 AM	0.19	0.24	0.43
11/24/11 2:00 PM	0.18	0.29	0.47
11/24/11 5:00 PM	0.19	0.24	0.43
11/24/11 8:00 PM	0.17	0.19	0.36
11/24/11 11:00 PM	0.18	0.19	0.37
11/25/11 2:00 AM	0.15	0.13	0.28
11/25/11 5:00 AM	0.16	0.14	0.30
11/25/11 8:00 AM	0.18	0.16	0.34
11/25/11 11:00 AM	0.19	0.40	0.59
11/25/11 2:00 PM	0.17	0.35	0.51
11/25/11 5:00 PM	0.16	0.33	0.49
11/25/11 8:00 PM	0.17	0.33	0.50
11/25/11 11:00 PM	0.17	0.32	0.48
11/26/11 2:00 AM	0.14	0.16	0.29
11/26/11 5:00 AM	0.13	0.15	0.27
11/26/11 8:00 AM	0.18	0.27	0.45
11/26/11 11:00 AM	0.19	0.41	0.60
11/26/11 2:00 PM	0.18	0.41	0.59
11/26/11 5:00 PM	0.20	0.41	0.61

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
11/26/11 8:00 PM	0.20	0.41	0.60
11/26/11 11:00 PM	0.20	0.40	0.60
11/27/11 2:00 AM	0.19	0.39	0.58
11/27/11 5:00 AM	0.19	0.36	0.55
11/27/11 8:00 AM	0.20	0.26	0.46
11/27/11 11:00 AM	0.20	0.30	0.51
11/27/11 2:00 PM	0.16	0.37	0.54
11/27/11 5:00 PM	0.05	0.38	0.43
11/27/11 8:00 PM	0.07	0.39	0.45
11/27/11 11:00 PM	0.20	0.39	0.59
11/28/11 2:00 AM	0.15	0.24	0.40
11/28/11 5:00 AM	0.14	0.22	0.36
11/28/11 8:00 AM	0.20	0.39	0.59
11/28/11 11:00 AM	0.21	0.19	0.39
11/28/11 2:00 PM	0.21	0.19	0.40
11/28/11 5:00 PM	0.16	0.20	0.35
11/28/11 8:00 PM	0.11	0.21	0.31
11/28/11 11:00 PM	0.11	0.21	0.32
11/29/11 2:00 AM	0.11	0.14	0.25
11/29/11 5:00 AM	0.10	0.13	0.23
11/29/11 8:00 AM	0.17	0.22	0.39
11/29/11 11:00 AM	0.19	0.23	0.42
11/29/11 2:00 PM	0.18	0.23	0.41
11/29/11 5:00 PM	0.18	0.25	0.42
11/29/11 8:00 PM	0.19	0.24	0.42
11/29/11 11:00 PM	0.18	0.26	0.44
11/30/11 2:00 AM	0.20	0.29	0.49
11/30/11 5:00 AM	0.19	0.31	0.51
11/30/11 8:00 AM	0.19	0.27	0.47
11/30/11 11:00 AM	0.18	0.28	0.46
11/30/11 2:00 PM	0.17	0.29	0.46
11/30/11 5:00 PM	0.18	0.28	0.47
11/30/11 8:00 PM	0.19	0.29	0.48
11/30/11 11:00 PM	0.19	0.31	0.49
12/1/11 2:00 AM	0.20	0.31	0.51
12/1/11 5:00 AM	0.19	0.32	0.51
12/1/11 8:00 AM	0.20	0.33	0.52
12/1/11 11:00 AM	0.18	0.19	0.37
12/1/11 2:00 PM	0.18	0.00	0.18
12/1/11 5:00 PM	0.18	0.00	0.18
12/1/11 8:00 PM	0.18	0.00	0.18
12/1/11 11:00 PM	0.17	0.00	0.17
12/2/11 2:00 AM	0.18	0.00	0.18
12/2/11 5:00 AM	0.17	0.00	0.17
12/2/11 8:00 AM	0.17	0.00	0.17
12/2/11 11:00 AM	0.20	0.00	0.20
12/2/11 2:00 PM	0.23	0.00	0.23
12/2/11 5:00 PM	0.23	0.00	0.23
12/2/11 8:00 PM	0.22	0.00	0.22
12/2/11 11:00 PM	0.20	0.01	0.21
12/3/11 2:00 AM	0.20	0.04	0.24
12/3/11 5:00 AM	0.19	0.07	0.26
12/3/11 8:00 AM	0.21	0.15	0.37
12/3/11 11:00 AM	0.28	0.20	0.48

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
12/3/11 2:00 PM	0.38	0.43	0.81
12/3/11 5:00 PM	0.42	0.61	1.03
12/3/11 8:00 PM	0.54	0.49	1.03
12/3/11 11:00 PM	0.31	0.38	0.69
12/4/11 2:00 AM	0.17	0.29	0.46
12/4/11 5:00 AM	0.17	0.19	0.36
12/4/11 8:00 AM	0.17	0.27	0.44
12/4/11 11:00 AM	0.24	0.25	0.48
12/4/11 2:00 PM	0.55	0.23	0.78
12/4/11 5:00 PM	0.53	0.21	0.74
12/4/11 8:00 PM	0.57	0.21	0.77
12/4/11 11:00 PM	0.36	0.20	0.55
12/5/11 2:00 AM	0.18	0.18	0.36
12/5/11 5:00 AM	0.22	0.11	0.33
12/5/11 8:00 AM	0.56	0.19	0.75
12/5/11 11:00 AM	0.59	0.21	0.80
12/5/11 2:00 PM	0.65	0.22	0.87
12/5/11 5:00 PM	0.66	0.22	0.88
12/5/11 8:00 PM	0.54	0.21	0.75
12/5/11 11:00 PM	0.49	0.19	0.68
12/6/11 2:00 AM	0.27	0.11	0.38
12/6/11 5:00 AM	0.26	0.10	0.36
12/6/11 8:00 AM	0.50	0.20	0.70
12/6/11 11:00 AM	0.42	0.18	0.60
12/6/11 2:00 PM	0.37	0.18	0.55
12/6/11 5:00 PM	0.61	0.16	0.77
12/6/11 8:00 PM	0.63	0.15	0.78
12/6/11 11:00 PM	0.68	0.16	0.84
12/7/11 2:00 AM	0.31	0.16	0.47
12/7/11 5:00 AM	0.26	0.16	0.41
12/7/11 8:00 AM	0.59	0.16	0.75
12/7/11 11:00 AM	0.56	0.17	0.73
12/7/11 2:00 PM	0.57	0.22	0.78
12/7/11 5:00 PM	0.56	0.20	0.77
12/7/11 8:00 PM	0.48	0.21	0.69
12/7/11 11:00 PM	0.57	0.20	0.77
12/8/11 2:00 AM	0.37	0.18	0.55
12/8/11 5:00 AM	0.44	0.19	0.62
12/8/11 8:00 AM	0.53	0.16	0.69
12/8/11 11:00 AM	0.50	0.15	0.64
12/8/11 2:00 PM	0.45	0.14	0.59
12/8/11 5:00 PM	0.42	0.18	0.61
12/8/11 8:00 PM	0.43	0.14	0.57
12/8/11 11:00 PM	0.42	0.15	0.57
12/9/11 2:00 AM	0.44	0.15	0.59
12/9/11 5:00 AM	0.38	0.16	0.54
12/9/11 8:00 AM	0.49	0.18	0.68
12/9/11 11:00 AM	0.46	0.23	0.68
12/9/11 2:00 PM	0.49	0.23	0.72
12/9/11 5:00 PM	0.51	0.21	0.73
12/9/11 8:00 PM	0.60	0.23	0.83
12/9/11 11:00 PM	0.72	0.22	0.94
12/10/11 2:00 AM	0.48	0.12	0.60
12/10/11 5:00 AM	0.40	0.11	0.51

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
12/10/11 8:00 AM	0.47	0.18	0.65
12/10/11 11:00 AM	0.63	0.26	0.89
12/10/11 2:00 PM	0.61	0.28	0.89
12/10/11 5:00 PM	0.60	0.24	0.84
12/10/11 8:00 PM	0.54	0.24	0.78
12/10/11 11:00 PM	0.58	0.21	0.79
12/11/11 2:00 AM	0.52	0.13	0.65
12/11/11 5:00 AM	0.43	0.14	0.57
12/11/11 8:00 AM	0.49	0.25	0.74
12/11/11 11:00 AM	0.66	0.30	0.97
12/11/11 2:00 PM	0.57	0.19	0.76
12/11/11 5:00 PM	0.53	0.25	0.78
12/11/11 8:00 PM	0.58	0.31	0.89
12/11/11 11:00 PM	0.55	0.24	0.79
12/12/11 2:00 AM	0.44	0.05	0.49
12/12/11 5:00 AM	0.41	0.06	0.47
12/12/11 8:00 AM	0.56	0.14	0.70
12/12/11 11:00 AM	0.62	0.40	1.01
12/12/11 2:00 PM	0.49	0.41	0.90
12/12/11 5:00 PM	0.57	0.25	0.82
12/12/11 8:00 PM	0.61	0.22	0.84
12/12/11 11:00 PM	0.59	0.01	0.60
12/13/11 2:00 AM	0.35	0.00	0.35
12/13/11 5:00 AM	0.37	0.00	0.37
12/13/11 8:00 AM	0.54	0.00	0.54
12/13/11 11:00 AM	0.65	0.00	0.65
12/13/11 2:00 PM	0.73	0.00	0.73
12/13/11 5:00 PM	0.73	0.00	0.73
12/13/11 8:00 PM	0.69	0.00	0.69
12/13/11 11:00 PM	0.69	0.00	0.69
12/14/11 2:00 AM	0.51	0.00	0.51
12/14/11 5:00 AM	0.52	0.00	0.52
12/14/11 8:00 AM	0.66	0.00	0.66
12/14/11 11:00 AM	0.75	0.00	0.75
12/14/11 2:00 PM	0.64	0.00	0.64
12/14/11 5:00 PM	0.58	0.00	0.58
12/14/11 8:00 PM	0.55	0.00	0.55
12/14/11 11:00 PM	0.58	0.00	0.58
12/15/11 2:00 AM	0.50	0.00	0.50
12/15/11 5:00 AM	0.50	0.00	0.50
12/15/11 8:00 AM	0.72	0.00	0.72
12/15/11 11:00 AM	0.70	0.00	0.70
12/15/11 2:00 PM	0.63	0.00	0.63
12/15/11 5:00 PM	0.49	0.00	0.49
12/15/11 8:00 PM	0.53	0.00	0.53
12/15/11 11:00 PM	0.74	0.00	0.74
12/16/11 2:00 AM	0.69	0.00	0.69
12/16/11 5:00 AM	0.61	0.00	0.61
12/16/11 8:00 AM	0.73	0.05	0.78
12/16/11 11:00 AM	0.66	0.28	0.94
12/16/11 2:00 PM	0.71	0.66	1.37
12/16/11 5:00 PM	0.73	0.75	1.47
12/16/11 8:00 PM	0.69	0.55	1.24
12/16/11 11:00 PM	0.68	0.53	1.21

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
12/17/11 2:00 AM	0.59	0.25	0.84
12/17/11 5:00 AM	0.53	0.32	0.85
12/17/11 8:00 AM	0.70	0.46	1.17
12/17/11 11:00 AM	0.68	0.63	1.30
12/17/11 2:00 PM	0.61	0.49	1.10
12/17/11 5:00 PM	0.64	0.52	1.15
12/17/11 8:00 PM	0.61	0.54	1.15
12/17/11 11:00 PM	0.57	0.31	0.89
12/18/11 2:00 AM	0.54	0.31	0.85
12/18/11 5:00 AM	0.55	0.29	0.84
12/18/11 8:00 AM	0.71	0.32	1.03
12/18/11 11:00 AM	0.67	0.37	1.03
12/18/11 2:00 PM	0.58	0.36	0.94
12/18/11 5:00 PM	0.69	0.35	1.04
12/18/11 8:00 PM	0.72	0.33	1.05
12/18/11 11:00 PM	0.70	0.36	1.06
12/19/11 2:00 AM	0.61	0.36	0.97
12/19/11 5:00 AM	0.74	0.36	1.10
12/19/11 8:00 AM	0.75	0.36	1.11
12/19/11 11:00 AM	0.64	0.24	0.88
12/19/11 2:00 PM	0.66	0.22	0.88
12/19/11 5:00 PM	0.61	0.16	0.76
12/19/11 8:00 PM	0.67	0.11	0.78
12/19/11 11:00 PM	0.59	0.11	0.70
12/20/11 2:00 AM	0.35	0.07	0.42
12/20/11 5:00 AM	0.32	0.07	0.39
12/20/11 8:00 AM	0.75	0.20	0.95
12/20/11 11:00 AM	0.70	0.24	0.94
12/20/11 2:00 PM	0.67	0.23	0.90
12/20/11 5:00 PM	0.69	0.22	0.91
12/20/11 8:00 PM	0.68	0.15	0.83
12/20/11 11:00 PM	0.62	0.00	0.62
12/21/11 2:00 AM	0.43	0.00	0.43
12/21/11 5:00 AM	0.41	0.00	0.41
12/21/11 8:00 AM	0.61	0.00	0.61
12/21/11 11:00 AM	0.64	0.00	0.64
12/21/11 2:00 PM	0.59	0.00	0.59
12/21/11 5:00 PM	0.63	0.00	0.63
12/21/11 8:00 PM	0.68	0.00	0.68
12/21/11 11:00 PM	0.64	0.00	0.64
12/22/11 2:00 AM	0.57	0.00	0.57
12/22/11 5:00 AM	0.52	0.00	0.52
12/22/11 8:00 AM	0.58	0.00	0.58
12/22/11 11:00 AM	0.53	0.00	0.53
12/22/11 2:00 PM	0.43	0.00	0.43
12/22/11 5:00 PM	0.44	0.00	0.44
12/22/11 8:00 PM	0.49	0.00	0.49
12/22/11 11:00 PM	0.50	0.00	0.50
12/23/11 2:00 AM	0.46	0.00	0.46
12/23/11 5:00 AM	0.45	0.00	0.45
12/23/11 8:00 AM	0.47	0.00	0.47
12/23/11 11:00 AM	0.48	0.00	0.48
12/23/11 2:00 PM	0.44	0.00	0.44
12/23/11 5:00 PM	0.45	0.00	0.45

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
12/23/11 8:00 PM	0.48	0.00	0.48
12/23/11 11:00 PM	0.48	0.00	0.48
12/24/11 2:00 AM	0.45	0.00	0.45
12/24/11 5:00 AM	0.40	0.00	0.40
12/24/11 8:00 AM	0.47	0.00	0.47
12/24/11 11:00 AM	0.52	0.00	0.52
12/24/11 2:00 PM	0.48	0.00	0.48
12/24/11 5:00 PM	0.52	0.00	0.52
12/24/11 8:00 PM	0.52	0.00	0.52
12/24/11 11:00 PM	0.48	0.00	0.48
12/25/11 2:00 AM	0.43	0.00	0.43
12/25/11 5:00 AM	0.45	0.00	0.45
12/25/11 8:00 AM	0.45	0.00	0.45
12/25/11 11:00 AM	0.51	0.00	0.51
12/25/11 2:00 PM	0.48	0.00	0.48
12/25/11 5:00 PM	0.50	0.00	0.50
12/25/11 8:00 PM	0.50	0.00	0.50
12/25/11 11:00 PM	0.55	0.00	0.55
12/26/11 2:00 AM	0.38	0.00	0.38
12/26/11 5:00 AM	0.39	0.00	0.39
12/26/11 8:00 AM	0.52	0.00	0.52
12/26/11 11:00 AM	0.51	0.00	0.51
12/26/11 2:00 PM	0.51	0.00	0.51
12/26/11 5:00 PM	0.59	0.00	0.59
12/26/11 8:00 PM	0.56	0.00	0.56
12/26/11 11:00 PM	0.53	0.00	0.53
12/27/11 2:00 AM	0.42	0.00	0.42
12/27/11 5:00 AM	0.39	0.00	0.39
12/27/11 8:00 AM	0.44	0.00	0.44
12/27/11 11:00 AM	0.49	0.00	0.49
12/27/11 2:00 PM	0.49	0.00	0.49
12/27/11 5:00 PM	0.51	0.00	0.51
12/27/11 8:00 PM	0.41	0.00	0.41
12/27/11 11:00 PM	0.22	0.00	0.22
12/28/11 2:00 AM	0.14	0.00	0.14
12/28/11 5:00 AM	0.16	0.00	0.16
12/28/11 8:00 AM	0.24	0.13	0.37
12/28/11 11:00 AM	0.23	0.38	0.61
12/28/11 2:00 PM	0.21	0.38	0.59
12/28/11 5:00 PM	0.22	0.52	0.74
12/28/11 8:00 PM	0.19	0.70	0.90
12/28/11 11:00 PM	0.18	0.40	0.58
12/29/11 2:00 AM	0.07	0.31	0.38
12/29/11 5:00 AM	0.16	0.26	0.42
12/29/11 8:00 AM	0.21	0.18	0.39
12/29/11 11:00 AM	0.22	0.23	0.45
12/29/11 2:00 PM	0.21	0.16	0.37
12/29/11 5:00 PM	0.22	0.13	0.35
12/29/11 8:00 PM	0.22	0.15	0.37
12/29/11 11:00 PM	0.19	0.16	0.35
12/30/11 2:00 AM	0.16	0.12	0.28
12/30/11 5:00 AM	0.16	0.12	0.28
12/30/11 8:00 AM	0.17	0.19	0.35
12/30/11 11:00 AM	0.12	0.19	0.31

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
12/30/11 2:00 PM	0.13	0.22	0.35
12/30/11 5:00 PM	0.13	0.16	0.29
12/30/11 8:00 PM	0.19	0.13	0.32
12/30/11 11:00 PM	0.20	0.10	0.30
12/31/11 2:00 AM	0.15	0.10	0.25
12/31/11 5:00 AM	0.14	0.06	0.20
12/31/11 8:00 AM	0.19	0.07	0.26
12/31/11 11:00 AM	0.19	0.11	0.30
12/31/11 2:00 PM	0.18	0.10	0.29
12/31/11 5:00 PM	0.18	0.11	0.29
12/31/11 8:00 PM	0.18	0.13	0.31
12/31/11 11:00 PM	0.19	0.06	0.25
1/1/12 2:00 AM	0.18	0.03	0.21
1/1/12 5:00 AM	0.16	0.04	0.20
1/1/12 8:00 AM	0.17	0.04	0.21
1/1/12 11:00 AM	0.26	0.04	0.30
1/1/12 2:00 PM	0.29	0.04	0.34
1/1/12 5:00 PM	0.32	0.05	0.37
1/1/12 8:00 PM	0.77	0.23	1.00
1/1/12 11:00 PM	0.62	0.11	0.73
1/2/12 2:00 AM	0.28	0.08	0.36
1/2/12 5:00 AM	0.20	0.08	0.29
1/2/12 8:00 AM	0.31	0.15	0.46
1/2/12 11:00 AM	0.38	0.18	0.56
1/2/12 2:00 PM	0.55	0.15	0.70
1/2/12 5:00 PM	0.57	0.17	0.74
1/2/12 8:00 PM	0.80	0.19	0.99
1/2/12 11:00 PM	0.76	0.20	0.97
1/3/12 2:00 AM	0.33	0.12	0.44
1/3/12 5:00 AM	0.35	0.12	0.47
1/3/12 8:00 AM	0.80	0.33	1.13
1/3/12 11:00 AM	0.73	0.26	1.00
1/3/12 2:00 PM	0.76	0.20	0.96
1/3/12 5:00 PM	0.43	0.17	0.61
1/3/12 8:00 PM	0.79	0.19	0.98
1/3/12 11:00 PM	0.72	0.18	0.90
1/4/12 2:00 AM	0.35	0.18	0.53
1/4/12 5:00 AM	0.35	0.17	0.51
1/4/12 8:00 AM	0.66	0.15	0.81
1/4/12 11:00 AM	0.82	0.14	0.96
1/4/12 2:00 PM	0.65	0.09	0.74
1/4/12 5:00 PM	0.32	0.08	0.40
1/4/12 8:00 PM	0.34	0.14	0.49
1/4/12 11:00 PM	0.23	0.15	0.38
1/5/12 2:00 AM	0.19	0.15	0.33
1/5/12 5:00 AM	0.30	0.15	0.45
1/5/12 8:00 AM	0.17	0.15	0.32
1/5/12 11:00 AM	0.10	0.13	0.23
1/5/12 2:00 PM	0.10	0.13	0.23
1/5/12 5:00 PM	0.09	0.13	0.22
1/5/12 8:00 PM	0.10	0.13	0.23
1/5/12 11:00 PM	0.13	0.13	0.26
1/6/12 2:00 AM	0.21	0.13	0.33
1/6/12 5:00 AM	0.20	0.12	0.32

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
1/6/12 8:00 AM	0.21	0.13	0.34
1/6/12 11:00 AM	0.21	0.13	0.33
1/6/12 2:00 PM	0.20	0.13	0.33
1/6/12 5:00 PM	0.20	0.13	0.33
1/6/12 8:00 PM	0.20	0.13	0.33
1/6/12 11:00 PM	0.20	0.02	0.22
1/7/12 2:00 AM	0.20	0.00	0.20
1/7/12 5:00 AM	0.20	0.00	0.20
1/7/12 8:00 AM	0.21	0.00	0.21
1/7/12 11:00 AM	0.21	0.00	0.21
1/7/12 2:00 PM	0.23	0.00	0.23
1/7/12 5:00 PM	0.22	0.00	0.22
1/7/12 8:00 PM	0.21	0.00	0.21
1/7/12 11:00 PM	0.21	0.00	0.21
1/8/12 2:00 AM	0.20	0.00	0.20
1/8/12 5:00 AM	0.20	0.00	0.20
1/8/12 8:00 AM	0.22	0.00	0.22
1/8/12 11:00 AM	0.22	0.00	0.22
1/8/12 2:00 PM	0.21	0.00	0.21
1/8/12 5:00 PM	0.21	0.00	0.21
1/8/12 8:00 PM	0.21	0.00	0.21
1/8/12 11:00 PM	0.22	0.00	0.22
1/9/12 2:00 AM	0.22	0.00	0.22
1/9/12 5:00 AM	0.20	0.00	0.20
1/9/12 8:00 AM	0.21	0.00	0.21
1/9/12 11:00 AM	0.21	0.00	0.21
1/9/12 2:00 PM	0.21	0.00	0.21
1/9/12 5:00 PM	0.21	0.00	0.21
1/9/12 8:00 PM	0.20	0.00	0.20
1/9/12 11:00 PM	0.18	0.00	0.18
1/10/12 2:00 AM	0.07	0.00	0.07
1/10/12 5:00 AM	0.07	0.00	0.07
1/10/12 8:00 AM	0.19	0.00	0.19
1/10/12 11:00 AM	0.20	0.00	0.20
1/10/12 2:00 PM	0.21	0.00	0.21
1/10/12 5:00 PM	0.20	0.00	0.20
1/10/12 8:00 PM	0.19	0.00	0.19
1/10/12 11:00 PM	0.11	0.00	0.11
1/11/12 2:00 AM	0.07	0.00	0.07
1/11/12 5:00 AM	0.08	0.00	0.08
1/11/12 8:00 AM	0.20	0.00	0.20
1/11/12 11:00 AM	0.21	0.00	0.21
1/11/12 2:00 PM	0.22	0.00	0.22
1/11/12 5:00 PM	0.22	0.00	0.22
1/11/12 8:00 PM	0.24	0.00	0.24
1/11/12 11:00 PM	0.27	0.00	0.27
1/12/12 2:00 AM	0.27	0.00	0.27
1/12/12 5:00 AM	0.28	0.00	0.28
1/12/12 8:00 AM	0.30	0.00	0.30
1/12/12 11:00 AM	0.30	0.00	0.30
1/12/12 2:00 PM	0.30	0.01	0.31
1/12/12 5:00 PM	0.29	0.16	0.45
1/12/12 8:00 PM	0.28	0.31	0.59
1/12/12 11:00 PM	0.32	0.29	0.61

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
1/13/12 2:00 AM	0.10	0.29	0.39
1/13/12 5:00 AM	0.11	0.29	0.40
1/13/12 8:00 AM	0.19	0.20	0.40
1/13/12 11:00 AM	0.28	0.20	0.47
1/13/12 2:00 PM	0.28	0.20	0.48
1/13/12 5:00 PM	0.30	0.19	0.49
1/13/12 8:00 PM	0.31	0.18	0.49
1/13/12 11:00 PM	0.33	0.18	0.51
1/14/12 2:00 AM	0.37	0.16	0.52
1/14/12 5:00 AM	0.29	0.11	0.40
1/14/12 8:00 AM	0.37	0.19	0.56
1/14/12 11:00 AM	0.45	0.22	0.67
1/14/12 2:00 PM	0.59	0.20	0.79
1/14/12 5:00 PM	0.95	0.18	1.13
1/14/12 8:00 PM	1.07	0.20	1.28
1/14/12 11:00 PM	1.02	0.22	1.23
1/15/12 2:00 AM	0.60	0.22	0.81
1/15/12 5:00 AM	0.66	0.21	0.87
1/15/12 8:00 AM	0.38	0.21	0.59
1/15/12 11:00 AM	0.37	0.21	0.58
1/15/12 2:00 PM	0.35	0.21	0.56
1/15/12 5:00 PM	0.35	0.20	0.55
1/15/12 8:00 PM	0.35	0.22	0.56
1/15/12 11:00 PM	0.62	0.21	0.83
1/16/12 2:00 AM	0.48	0.21	0.68
1/16/12 5:00 AM	0.60	0.20	0.80
1/16/12 8:00 AM	0.71	0.21	0.91
1/16/12 11:00 AM	0.36	0.20	0.57
1/16/12 2:00 PM	0.53	0.22	0.74
1/16/12 5:00 PM	1.04	0.24	1.28
1/16/12 8:00 PM	0.86	0.24	1.11
1/16/12 11:00 PM	0.49	0.23	0.73
1/17/12 2:00 AM	0.65	0.14	0.79
1/17/12 5:00 AM	0.86	0.20	1.06
1/17/12 8:00 AM	1.09	0.23	1.32
1/17/12 11:00 AM	1.06	0.19	1.24
1/17/12 2:00 PM	0.94	0.27	1.21
1/17/12 5:00 PM	0.40	0.27	0.68
1/17/12 8:00 PM	0.34	0.28	0.61
1/17/12 11:00 PM	0.51	0.29	0.81
1/18/12 2:00 AM	0.43	0.18	0.61
1/18/12 5:00 AM	0.60	0.21	0.81
1/18/12 8:00 AM	1.09	0.34	1.42
1/18/12 11:00 AM	1.14	0.28	1.42
1/18/12 2:00 PM	0.75	0.18	0.93
1/18/12 5:00 PM	0.78	0.00	0.78
1/18/12 8:00 PM	0.40	0.00	0.40
1/18/12 11:00 PM	0.55	0.35	0.90
1/19/12 2:00 AM	0.45	0.33	0.78
1/19/12 5:00 AM	0.61	0.32	0.93
1/19/12 8:00 AM	0.75	0.32	1.07
1/19/12 11:00 AM	0.44	0.32	0.76
1/19/12 2:00 PM	0.50	0.31	0.81
1/19/12 5:00 PM	0.35	0.31	0.66

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
1/19/12 8:00 PM	0.32	0.30	0.62
1/19/12 11:00 PM	0.39	0.30	0.70
1/20/12 2:00 AM	0.45	0.31	0.76
1/20/12 5:00 AM	0.51	0.29	0.80
1/20/12 8:00 AM	0.85	0.29	1.15
1/20/12 11:00 AM	0.90	0.27	1.17
1/20/12 2:00 PM	0.37	0.24	0.61
1/20/12 5:00 PM	0.35	0.24	0.59
1/20/12 8:00 PM	0.41	0.24	0.65
1/20/12 11:00 PM	0.51	0.22	0.73
1/21/12 2:00 AM	0.60	0.13	0.73
1/21/12 5:00 AM	0.58	0.17	0.75
1/21/12 8:00 AM	0.70	0.30	1.00
1/21/12 11:00 AM	0.96	0.32	1.28
1/21/12 2:00 PM	1.10	0.32	1.41
1/21/12 5:00 PM	1.03	0.30	1.33
1/21/12 8:00 PM	1.06	0.26	1.32
1/21/12 11:00 PM	1.08	0.05	1.13
1/22/12 2:00 AM	0.99	0.05	1.05
1/22/12 5:00 AM	0.95	0.07	1.01
1/22/12 8:00 AM	1.01	0.18	1.19
1/22/12 11:00 AM	1.06	0.19	1.24
1/22/12 2:00 PM	1.11	0.19	1.31
1/22/12 5:00 PM	1.03	0.30	1.33
1/22/12 8:00 PM	1.09	0.31	1.40
1/22/12 11:00 PM	1.09	0.30	1.39
1/23/12 2:00 AM	0.81	0.27	1.08
1/23/12 5:00 AM	0.61	0.26	0.87
1/23/12 8:00 AM	0.71	0.26	0.97
1/23/12 11:00 AM	0.76	0.29	1.05
1/23/12 2:00 PM	0.86	0.26	1.12
1/23/12 5:00 PM	0.91	0.25	1.16
1/23/12 8:00 PM	0.94	0.23	1.16
1/23/12 11:00 PM	0.89	0.22	1.12
1/24/12 2:00 AM	0.82	0.20	1.02
1/24/12 5:00 AM	0.76	0.15	0.90
1/24/12 8:00 AM	0.87	0.19	1.06
1/24/12 11:00 AM	0.75	0.19	0.94
1/24/12 2:00 PM	0.24	0.21	0.46
1/24/12 5:00 PM	0.36	0.19	0.55
1/24/12 8:00 PM	0.85	0.18	1.04
1/24/12 11:00 PM	0.61	0.15	0.76
1/25/12 2:00 AM	0.32	0.12	0.44
1/25/12 5:00 AM	0.31	0.11	0.42
1/25/12 8:00 AM	0.58	0.12	0.70
1/25/12 11:00 AM	0.80	0.16	0.96
1/25/12 2:00 PM	0.83	0.14	0.97
1/25/12 5:00 PM	0.76	0.11	0.87
1/25/12 8:00 PM	0.75	0.12	0.87
1/25/12 11:00 PM	0.54	0.11	0.65
1/26/12 2:00 AM	0.37	0.12	0.49
1/26/12 5:00 AM	0.44	0.11	0.55
1/26/12 8:00 AM	0.43	0.16	0.59
1/26/12 11:00 AM	0.22	0.19	0.41

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
1/26/12 2:00 PM	0.21	0.23	0.44
1/26/12 5:00 PM	0.67	0.21	0.89
1/26/12 8:00 PM	0.88	0.21	1.09
1/26/12 11:00 PM	0.66	0.18	0.84
1/27/12 2:00 AM	0.34	0.10	0.44
1/27/12 5:00 AM	0.32	0.13	0.45
1/27/12 8:00 AM	0.55	0.18	0.73
1/27/12 11:00 AM	0.72	0.24	0.96
1/27/12 2:00 PM	0.70	0.23	0.93
1/27/12 5:00 PM	0.90	0.21	1.11
1/27/12 8:00 PM	0.92	0.21	1.13
1/27/12 11:00 PM	0.84	0.16	1.00
1/28/12 2:00 AM	0.34	0.08	0.42
1/28/12 5:00 AM	0.23	0.10	0.32
1/28/12 8:00 AM	0.24	0.15	0.39
1/28/12 11:00 AM	0.37	0.23	0.60
1/28/12 2:00 PM	0.80	0.18	0.98
1/28/12 5:00 PM	0.72	0.16	0.89
1/28/12 8:00 PM	0.55	0.17	0.73
1/28/12 11:00 PM	0.47	0.17	0.64
1/29/12 2:00 AM	0.32	0.09	0.41
1/29/12 5:00 AM	0.31	0.08	0.39
1/29/12 8:00 AM	0.58	0.13	0.71
1/29/12 11:00 AM	0.70	0.26	0.95
1/29/12 2:00 PM	0.63	0.24	0.87
1/29/12 5:00 PM	0.64	0.24	0.87
1/29/12 8:00 PM	0.71	0.21	0.92
1/29/12 11:00 PM	0.70	0.17	0.86
1/30/12 2:00 AM	0.45	0.10	0.56
1/30/12 5:00 AM	0.50	0.14	0.64
1/30/12 8:00 AM	0.69	0.22	0.91
1/30/12 11:00 AM	0.69	0.21	0.91
1/30/12 2:00 PM	0.62	0.20	0.83
1/30/12 5:00 PM	0.65	0.19	0.84
1/30/12 8:00 PM	0.61	0.19	0.79
1/30/12 11:00 PM	0.54	0.17	0.70
1/31/12 2:00 AM	0.35	0.10	0.45
1/31/12 5:00 AM	0.55	0.09	0.64
1/31/12 8:00 AM	0.93	0.18	1.11
1/31/12 11:00 AM	0.94	0.16	1.10
1/31/12 2:00 PM	0.45	0.15	0.59
1/31/12 5:00 PM	0.20	0.19	0.39
1/31/12 8:00 PM	0.66	0.19	0.85
1/31/12 11:00 PM	0.54	0.17	0.71
2/1/12 2:00 AM	0.25	0.05	0.30
2/1/12 5:00 AM	0.24	0.05	0.28
2/1/12 8:00 AM	0.28	0.05	0.33
2/1/12 11:00 AM	0.29	0.05	0.34
2/1/12 2:00 PM	0.29	0.08	0.38
2/1/12 5:00 PM	0.36	0.23	0.59
2/1/12 8:00 PM	0.63	0.25	0.88
2/1/12 11:00 PM	0.27	0.13	0.40
2/2/12 2:00 AM	0.32	0.09	0.40
2/2/12 5:00 AM	0.37	0.09	0.47

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
2/2/12 8:00 AM	0.83	0.22	1.05
2/2/12 11:00 AM	0.87	0.23	1.10
2/2/12 2:00 PM	0.81	0.22	1.04
2/2/12 5:00 PM	0.83	0.21	1.05
2/2/12 8:00 PM	0.84	0.20	1.04
2/2/12 11:00 PM	0.89	0.13	1.01
2/3/12 2:00 AM	0.62	0.05	0.68
2/3/12 5:00 AM	0.54	0.06	0.60
2/3/12 8:00 AM	0.96	0.13	1.09
2/3/12 11:00 AM	0.87	0.25	1.11
2/3/12 2:00 PM	0.81	0.23	1.05
2/3/12 5:00 PM	0.83	0.22	1.05
2/3/12 8:00 PM	0.74	0.21	0.96
2/3/12 11:00 PM	0.41	0.17	0.58
2/4/12 2:00 AM	0.45	0.05	0.50
2/4/12 5:00 AM	0.40	0.06	0.46
2/4/12 8:00 AM	0.64	0.08	0.72
2/4/12 11:00 AM	0.90	0.23	1.13
2/4/12 2:00 PM	0.99	0.26	1.25
2/4/12 5:00 PM	0.92	0.24	1.16
2/4/12 8:00 PM	0.80	0.22	1.01
2/4/12 11:00 PM	0.52	0.20	0.72
2/5/12 2:00 AM	0.41	0.19	0.60
2/5/12 5:00 AM	0.43	0.18	0.62
2/5/12 8:00 AM	0.44	0.19	0.64
2/5/12 11:00 AM	0.74	0.19	0.94
2/5/12 2:00 PM	0.67	0.19	0.87
2/5/12 5:00 PM	0.81	0.19	1.00
2/5/12 8:00 PM	0.81	0.20	1.00
2/5/12 11:00 PM	0.64	0.20	0.84
2/6/12 2:00 AM	0.31	0.11	0.42
2/6/12 5:00 AM	0.34	0.12	0.47
2/6/12 8:00 AM	0.74	0.24	0.98
2/6/12 11:00 AM	0.69	0.25	0.94
2/6/12 2:00 PM	0.76	0.24	1.01
2/6/12 5:00 PM	0.69	0.23	0.93
2/6/12 8:00 PM	0.65	0.23	0.88
2/6/12 11:00 PM	0.58	0.22	0.80
2/7/12 2:00 AM	0.34	0.22	0.56
2/7/12 5:00 AM	0.34	0.22	0.56
2/7/12 8:00 AM	0.84	0.22	1.06
2/7/12 11:00 AM	0.96	1.17	2.13
2/7/12 2:00 PM	0.97	0.29	1.25
2/7/12 5:00 PM	0.98	0.39	1.37
2/7/12 8:00 PM	0.80	0.34	1.15
2/7/12 11:00 PM	0.76	0.23	0.99
2/8/12 2:00 AM	0.32	0.19	0.51
2/8/12 5:00 AM	0.33	0.19	0.52
2/8/12 8:00 AM	0.57	0.27	0.84
2/8/12 11:00 AM	0.74	0.25	0.99
2/8/12 2:00 PM	0.77	0.27	1.04
2/8/12 5:00 PM	0.79	0.24	1.03
2/8/12 8:00 PM	0.73	0.23	0.96
2/8/12 11:00 PM	0.48	0.24	0.72

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
2/9/12 2:00 AM	0.26	0.12	0.38
2/9/12 5:00 AM	0.24	0.19	0.43
2/9/12 8:00 AM	0.48	0.26	0.75
2/9/12 11:00 AM	0.71	0.26	0.97
2/9/12 2:00 PM	0.74	0.25	1.00
2/9/12 5:00 PM	0.74	0.25	0.99
2/9/12 8:00 PM	0.85	0.23	1.09
2/9/12 11:00 PM	0.59	0.23	0.82
2/10/12 2:00 AM	0.31	0.20	0.51
2/10/12 5:00 AM	0.37	0.22	0.59
2/10/12 8:00 AM	0.55	0.26	0.80
2/10/12 11:00 AM	0.54	0.25	0.79
2/10/12 2:00 PM	0.83	0.25	1.08
2/10/12 5:00 PM	0.83	0.24	1.07
2/10/12 8:00 PM	0.84	0.25	1.09
2/10/12 11:00 PM	0.67	0.24	0.91
2/11/12 2:00 AM	0.54	0.16	0.70
2/11/12 5:00 AM	0.53	0.19	0.72
2/11/12 8:00 AM	0.66	0.28	0.94
2/11/12 11:00 AM	0.98	0.27	1.26
2/11/12 2:00 PM	0.85	0.28	1.13
2/11/12 5:00 PM	0.72	0.28	1.00
2/11/12 8:00 PM	0.71	0.28	0.99
2/11/12 11:00 PM	0.67	0.28	0.95
2/12/12 2:00 AM	0.74	0.29	1.03
2/12/12 5:00 AM	0.76	0.30	1.06
2/12/12 8:00 AM	0.80	0.31	1.11
2/12/12 11:00 AM	0.85	0.31	1.17
2/12/12 2:00 PM	0.71	0.29	0.99
2/12/12 5:00 PM	0.63	0.26	0.89
2/12/12 8:00 PM	0.61	0.26	0.86
2/12/12 11:00 PM	0.64	0.25	0.89
2/13/12 2:00 AM	0.60	0.26	0.85
2/13/12 5:00 AM	0.58	0.26	0.84
2/13/12 8:00 AM	0.57	0.26	0.83
2/13/12 11:00 AM	0.58	0.24	0.82
2/13/12 2:00 PM	0.69	0.23	0.92
2/13/12 5:00 PM	0.55	0.18	0.73
2/13/12 8:00 PM	0.53	0.15	0.68
2/13/12 11:00 PM	0.63	0.23	0.86
2/14/12 2:00 AM	0.60	0.21	0.82
2/14/12 5:00 AM	0.60	0.23	0.83
2/14/12 8:00 AM	0.55	0.22	0.78
2/14/12 11:00 AM	0.44	0.22	0.65
2/14/12 2:00 PM	0.34	0.20	0.55
2/14/12 5:00 PM	0.37	0.20	0.57
2/14/12 8:00 PM	0.72	0.20	0.92
2/14/12 11:00 PM	0.75	0.20	0.95
2/15/12 2:00 AM	0.47	0.20	0.67
2/15/12 5:00 AM	0.49	0.20	0.69
2/15/12 8:00 AM	0.64	0.22	0.86
2/15/12 11:00 AM	0.61	0.21	0.82
2/15/12 2:00 PM	0.62	0.22	0.84
2/15/12 5:00 PM	0.77	0.18	0.95

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
2/15/12 8:00 PM	0.63	0.15	0.78
2/15/12 11:00 PM	0.89	0.12	1.01
2/16/12 2:00 AM	0.54	0.08	0.62
2/16/12 5:00 AM	0.43	0.09	0.52
2/16/12 8:00 AM	0.60	0.11	0.71
2/16/12 11:00 AM	0.75	0.11	0.86
2/16/12 2:00 PM	0.55	0.10	0.65
2/16/12 5:00 PM	0.54	0.10	0.64
2/16/12 8:00 PM	0.27	0.10	0.37
2/16/12 11:00 PM	0.39	0.06	0.45
2/17/12 2:00 AM	0.48	0.03	0.51
2/17/12 5:00 AM	0.55	0.03	0.58
2/17/12 8:00 AM	0.94	0.07	1.01
2/17/12 11:00 AM	0.95	0.10	1.05
2/17/12 2:00 PM	0.59	0.09	0.68
2/17/12 5:00 PM	0.48	0.09	0.57
2/17/12 8:00 PM	0.65	0.09	0.74
2/17/12 11:00 PM	0.52	0.07	0.60
2/18/12 2:00 AM	0.58	0.04	0.61
2/18/12 5:00 AM	0.57	0.04	0.61
2/18/12 8:00 AM	0.91	0.04	0.95
2/18/12 11:00 AM	0.83	0.04	0.87
2/18/12 2:00 PM	0.56	0.11	0.66
2/18/12 5:00 PM	0.78	0.11	0.89
2/18/12 8:00 PM	0.68	0.11	0.79
2/18/12 11:00 PM	0.26	0.05	0.30
2/19/12 2:00 AM	0.32	0.03	0.35
2/19/12 5:00 AM	0.42	0.03	0.45
2/19/12 8:00 AM	0.64	0.03	0.67
2/19/12 11:00 AM	0.80	0.05	0.85
2/19/12 2:00 PM	0.57	0.12	0.68
2/19/12 5:00 PM	0.64	0.11	0.75
2/19/12 8:00 PM	0.68	0.11	0.78
2/19/12 11:00 PM	0.59	0.07	0.66
2/20/12 2:00 AM	0.49	0.03	0.52
2/20/12 5:00 AM	0.61	0.03	0.63
2/20/12 8:00 AM	0.59	0.05	0.64
2/20/12 11:00 AM	0.28	0.05	0.33
2/20/12 2:00 PM	0.26	0.05	0.31
2/20/12 5:00 PM	0.44	0.05	0.49
2/20/12 8:00 PM	0.57	0.06	0.62
2/20/12 11:00 PM	0.58	0.05	0.63
2/21/12 2:00 AM	0.57	0.02	0.59
2/21/12 5:00 AM	0.57	0.04	0.60
2/21/12 8:00 AM	0.51	0.07	0.58
2/21/12 11:00 AM	0.42	0.08	0.50
2/21/12 2:00 PM	0.64	0.08	0.72
2/21/12 5:00 PM	0.54	0.08	0.63
2/21/12 8:00 PM	0.65	0.09	0.74
2/21/12 11:00 PM	0.57	0.11	0.67
2/22/12 2:00 AM	0.35	0.11	0.46
2/22/12 5:00 AM	0.42	0.11	0.53
2/22/12 8:00 AM	0.54	0.12	0.66
2/22/12 11:00 AM	0.68	0.12	0.80

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
2/22/12 2:00 PM	0.80	0.12	0.92
2/22/12 5:00 PM	0.41	0.15	0.56
2/22/12 8:00 PM	0.68	0.15	0.83
2/22/12 11:00 PM	0.60	0.15	0.75
2/23/12 2:00 AM	0.41	0.16	0.57
2/23/12 5:00 AM	0.50	0.50	1.00
2/23/12 8:00 AM	0.86	0.14	1.00
2/23/12 11:00 AM	0.59	0.17	0.76
2/23/12 2:00 PM	0.30	0.17	0.47
2/23/12 5:00 PM	0.34	0.17	0.51
2/23/12 8:00 PM	0.47	0.16	0.63
2/23/12 11:00 PM	0.39	0.15	0.55
2/24/12 2:00 AM	0.65	0.15	0.80
2/24/12 5:00 AM	0.62	0.15	0.78
2/24/12 8:00 AM	0.82	0.16	0.97
2/24/12 11:00 AM	0.22	0.16	0.38
2/24/12 2:00 PM	0.47	0.13	0.60
2/24/12 5:00 PM	0.47	0.16	0.64
2/24/12 8:00 PM	0.23	0.11	0.34
2/24/12 11:00 PM	0.52	0.08	0.60
2/25/12 2:00 AM	0.40	0.08	0.48
2/25/12 5:00 AM	0.47	0.08	0.56
2/25/12 8:00 AM	0.54	0.10	0.65
2/25/12 11:00 AM	0.77	0.11	0.88
2/25/12 2:00 PM	0.80	0.11	0.91
2/25/12 5:00 PM	0.79	0.11	0.89
2/25/12 8:00 PM	0.90	0.10	1.00
2/25/12 11:00 PM	0.83	0.06	0.89
2/26/12 2:00 AM	0.54	0.02	0.55
2/26/12 5:00 AM	0.41	0.02	0.43
2/26/12 8:00 AM	0.66	0.00	0.66
2/26/12 11:00 AM	0.76	0.03	0.79
2/26/12 2:00 PM	0.54	0.06	0.60
2/26/12 5:00 PM	0.60	0.05	0.65
2/26/12 8:00 PM	0.77	0.05	0.82
2/26/12 11:00 PM	0.58	0.05	0.63
2/27/12 2:00 AM	0.64	0.05	0.69
2/27/12 5:00 AM	0.66	0.05	0.71
2/27/12 8:00 AM	0.68	0.04	0.72
2/27/12 11:00 AM	0.71	0.12	0.83
2/27/12 2:00 PM	0.66	0.19	0.85
2/27/12 5:00 PM	0.72	0.15	0.86
2/27/12 8:00 PM	0.85	0.15	0.99
2/27/12 11:00 PM	0.79	0.13	0.92
2/28/12 2:00 AM	0.52	0.01	0.53
2/28/12 5:00 AM	0.51	0.02	0.52
2/28/12 8:00 AM	0.64	0.02	0.66
2/28/12 11:00 AM	0.67	0.03	0.70
2/28/12 2:00 PM	0.44	0.14	0.58
2/28/12 5:00 PM	0.53	0.14	0.67
2/28/12 8:00 PM	0.58	0.14	0.71
2/28/12 11:00 PM	0.65	0.13	0.78
2/29/12 2:00 AM	0.29	0.09	0.38
2/29/12 5:00 AM	0.25	0.07	0.32

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
2/29/12 8:00 AM	0.59	0.07	0.66
2/29/12 11:00 AM	0.52	0.14	0.65
2/29/12 2:00 PM	0.60	0.13	0.73
2/29/12 5:00 PM	0.67	0.14	0.81
2/29/12 8:00 PM	0.67	0.15	0.83
2/29/12 11:00 PM	0.59	0.13	0.73
3/1/12 2:00 AM	0.58	0.10	0.68
3/1/12 5:00 AM	0.54	0.07	0.61
3/1/12 8:00 AM	0.74	0.16	0.90
3/1/12 11:00 AM	0.79	0.15	0.95
3/1/12 2:00 PM	0.70	0.15	0.84
3/1/12 5:00 PM	0.70	0.15	0.84
3/1/12 8:00 PM	0.74	0.16	0.90
3/1/12 11:00 PM	0.64	0.15	0.79
3/2/12 2:00 AM	0.68	0.07	0.75
3/2/12 5:00 AM	0.51	0.09	0.59
3/2/12 8:00 AM	0.55	0.15	0.69
3/2/12 11:00 AM	0.49	0.14	0.63
3/2/12 2:00 PM	0.51	0.14	0.65
3/2/12 5:00 PM	0.39	0.14	0.53
3/2/12 8:00 PM	0.53	0.19	0.71
3/2/12 11:00 PM	0.48	0.16	0.64
3/3/12 2:00 AM	0.59	0.00	0.59
3/3/12 5:00 AM	0.51	0.00	0.51
3/3/12 8:00 AM	0.47	0.00	0.47
3/3/12 11:00 AM	0.48	0.00	0.48
3/3/12 2:00 PM	0.36	0.00	0.36
3/3/12 5:00 PM	0.48	0.00	0.48
3/3/12 8:00 PM	0.50	0.00	0.50
3/3/12 11:00 PM	0.50	0.00	0.50
3/4/12 2:00 AM	0.45	0.00	0.45
3/4/12 5:00 AM	0.49	0.00	0.49
3/4/12 8:00 AM	0.55	0.00	0.55
3/4/12 11:00 AM	0.71	0.00	0.71
3/4/12 2:00 PM	0.66	0.00	0.66
3/4/12 5:00 PM	0.75	0.00	0.75
3/4/12 8:00 PM	0.81	0.00	0.81
3/4/12 11:00 PM	0.76	0.00	0.76
3/5/12 2:00 AM	0.45	0.00	0.45
3/5/12 5:00 AM	0.71	0.00	0.71
3/5/12 8:00 AM	0.79	0.00	0.79
3/5/12 11:00 AM	0.82	0.00	0.82
3/5/12 2:00 PM	0.62	0.00	0.62
3/5/12 5:00 PM	0.65	0.00	0.65
3/5/12 8:00 PM	0.66	0.00	0.66
3/5/12 11:00 PM	0.76	0.00	0.76
3/6/12 2:00 AM	0.61	0.00	0.61
3/6/12 5:00 AM	0.67	0.00	0.67
3/6/12 8:00 AM	0.57	0.00	0.57
3/6/12 11:00 AM	0.56	0.00	0.56
3/6/12 2:00 PM	0.54	0.00	0.54
3/6/12 5:00 PM	0.61	0.00	0.61
3/6/12 8:00 PM	0.56	0.00	0.56
3/6/12 11:00 PM	0.55	0.00	0.55

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
3/7/12 2:00 AM	0.41	0.00	0.41
3/7/12 5:00 AM	0.39	0.00	0.39
3/7/12 8:00 AM	0.65	0.00	0.65
3/7/12 11:00 AM	0.61	0.00	0.61
3/7/12 2:00 PM	0.57	0.00	0.57
3/7/12 5:00 PM	0.51	0.00	0.51
3/7/12 8:00 PM	0.60	0.00	0.60
3/7/12 11:00 PM	0.53	0.00	0.53
3/8/12 2:00 AM	0.46	0.00	0.46
3/8/12 5:00 AM	0.46	0.00	0.46
3/8/12 8:00 AM	0.55	0.00	0.55
3/8/12 11:00 AM	0.51	0.00	0.51
3/8/12 2:00 PM	0.42	0.00	0.42
3/8/12 5:00 PM	0.44	0.00	0.44
3/8/12 8:00 PM	0.49	0.00	0.49
3/8/12 11:00 PM	0.57	0.00	0.57
3/9/12 2:00 AM	0.59	0.00	0.59
3/9/12 5:00 AM	0.57	0.00	0.57
3/9/12 8:00 AM	0.60	0.00	0.60
3/9/12 11:00 AM	0.55	0.00	0.55
3/9/12 2:00 PM	0.50	0.00	0.50
3/9/12 5:00 PM	0.44	0.00	0.44
3/9/12 8:00 PM	0.47	0.00	0.47
3/9/12 11:00 PM	0.57	0.00	0.57
3/10/12 2:00 AM	0.43	0.00	0.43
3/10/12 5:00 AM	0.51	0.00	0.51
3/10/12 8:00 AM	0.56	0.00	0.56
3/10/12 11:00 AM	0.54	0.00	0.54
3/10/12 2:00 PM	0.37	0.00	0.37
3/10/12 5:00 PM	0.41	0.00	0.41
3/10/12 8:00 PM	0.42	0.00	0.42
3/10/12 11:00 PM	0.48	0.00	0.48
3/11/12 2:00 AM	0.48	0.00	0.48
3/11/12 5:00 AM	0.46	0.00	0.46
3/11/12 8:00 AM	0.44	0.00	0.44
3/11/12 11:00 AM	0.48	0.00	0.48
3/11/12 2:00 PM	0.42	0.00	0.42
3/11/12 5:00 PM	0.49	0.00	0.49
3/11/12 8:00 PM	0.59	0.00	0.59
3/11/12 11:00 PM	0.57	0.00	0.57
3/12/12 2:00 AM	0.56	0.00	0.56
3/12/12 5:00 AM	0.48	0.00	0.48
3/12/12 8:00 AM	0.61	0.00	0.61
3/12/12 11:00 AM	0.57	0.00	0.57
3/12/12 2:00 PM	0.59	0.00	0.59
3/12/12 5:00 PM	0.54	0.00	0.54
3/12/12 8:00 PM	0.58	0.00	0.58
3/12/12 11:00 PM	0.64	0.00	0.64
3/13/12 2:00 AM	0.72	0.00	0.72
3/13/12 5:00 AM	0.65	0.00	0.65
3/13/12 8:00 AM	0.76	0.00	0.76
3/13/12 11:00 AM	0.73	0.03	0.76
3/13/12 2:00 PM	0.65	0.09	0.74
3/13/12 5:00 PM	0.64	0.18	0.82

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
3/13/12 8:00 PM	0.62	0.18	0.80
3/13/12 11:00 PM	0.62	0.18	0.80
3/14/12 2:00 AM	0.36	0.18	0.54
3/14/12 5:00 AM	0.51	0.16	0.67
3/14/12 8:00 AM	0.78	0.14	0.92
3/14/12 11:00 AM	0.48	0.12	0.61
3/14/12 2:00 PM	0.22	0.13	0.35
3/14/12 5:00 PM	0.51	0.14	0.66
3/14/12 8:00 PM	0.60	0.13	0.73
3/14/12 11:00 PM	0.70	0.14	0.84
3/15/12 2:00 AM	0.59	0.10	0.70
3/15/12 5:00 AM	0.60	0.09	0.69
3/15/12 8:00 AM	0.78	0.11	0.89
3/15/12 11:00 AM	0.81	0.17	0.98
3/15/12 2:00 PM	0.58	0.18	0.75
3/15/12 5:00 PM	0.66	0.17	0.83
3/15/12 8:00 PM	0.75	0.18	0.92
3/15/12 11:00 PM	0.74	0.15	0.89
3/16/12 2:00 AM	0.61	0.12	0.73
3/16/12 5:00 AM	0.58	0.10	0.68
3/16/12 8:00 AM	0.79	0.12	0.91
3/16/12 11:00 AM	0.87	0.02	0.89
3/16/12 2:00 PM	0.68	0.16	0.85
3/16/12 5:00 PM	0.65	0.17	0.83
3/16/12 8:00 PM	0.75	0.16	0.91
3/16/12 11:00 PM	0.64	0.16	0.81
3/17/12 2:00 AM	0.47	0.12	0.59
3/17/12 5:00 AM	0.45	0.11	0.56
3/17/12 8:00 AM	0.73	0.13	0.86
3/17/12 11:00 AM	0.90	0.17	1.08
3/17/12 2:00 PM	0.83	0.17	1.00
3/17/12 5:00 PM	0.84	0.17	1.01
3/17/12 8:00 PM	0.84	0.17	1.01
3/17/12 11:00 PM	0.49	0.21	0.70
3/18/12 2:00 AM	0.50	0.27	0.77
3/18/12 5:00 AM	0.42	0.18	0.60
3/18/12 8:00 AM	0.58	0.18	0.77
3/18/12 11:00 AM	0.71	0.39	1.10
3/18/12 2:00 PM	0.69	0.34	1.03
3/18/12 5:00 PM	0.88	0.31	1.19
3/18/12 8:00 PM	0.98	0.28	1.27
3/18/12 11:00 PM	0.88	0.27	1.14
3/19/12 2:00 AM	0.45	0.12	0.57
3/19/12 5:00 AM	0.69	0.18	0.87
3/19/12 8:00 AM	1.03	0.43	1.46
3/19/12 11:00 AM	0.93	0.41	1.34
3/19/12 2:00 PM	0.87	0.40	1.27
3/19/12 5:00 PM	0.91	0.39	1.30
3/19/12 8:00 PM	0.92	0.39	1.31
3/19/12 11:00 PM	0.89	0.24	1.13
3/20/12 2:00 AM	0.57	0.12	0.69
3/20/12 5:00 AM	0.54	0.17	0.72
3/20/12 8:00 AM	0.58	0.52	1.10
3/20/12 11:00 AM	0.63	0.41	1.04

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
3/20/12 2:00 PM	0.65	0.40	1.06
3/20/12 5:00 PM	0.86	0.44	1.30
3/20/12 8:00 PM	0.92	0.45	1.37
3/20/12 11:00 PM	0.68	0.43	1.11
3/21/12 2:00 AM	0.38	0.29	0.67
3/21/12 5:00 AM	0.43	0.31	0.74
3/21/12 8:00 AM	1.05	0.40	1.45
3/21/12 11:00 AM	0.89	0.41	1.31
3/21/12 2:00 PM	0.84	0.42	1.26
3/21/12 5:00 PM	0.88	0.43	1.31
3/21/12 8:00 PM	0.93	0.45	1.39
3/21/12 11:00 PM	0.90	0.22	1.11
3/22/12 2:00 AM	0.75	0.10	0.85
3/22/12 5:00 AM	0.73	0.11	0.84
3/22/12 8:00 AM	0.68	0.29	0.97
3/22/12 11:00 AM	0.60	0.41	1.01
3/22/12 2:00 PM	0.55	0.29	0.84
3/22/12 5:00 PM	0.61	0.21	0.82
3/22/12 8:00 PM	0.57	0.18	0.75
3/22/12 11:00 PM	0.42	0.17	0.60
3/23/12 2:00 AM	0.30	0.18	0.48
3/23/12 5:00 AM	0.34	0.16	0.50
3/23/12 8:00 AM	0.59	0.21	0.80
3/23/12 11:00 AM	0.58	0.20	0.78
3/23/12 2:00 PM	0.59	0.19	0.78
3/23/12 5:00 PM	0.61	0.17	0.78
3/23/12 8:00 PM	0.63	0.16	0.79
3/23/12 11:00 PM	0.26	0.15	0.41
3/24/12 2:00 AM	0.30	0.12	0.43
3/24/12 5:00 AM	0.22	0.16	0.38
3/24/12 8:00 AM	0.42	0.17	0.59
3/24/12 11:00 AM	0.46	0.17	0.63
3/24/12 2:00 PM	0.44	0.17	0.60
3/24/12 5:00 PM	0.44	0.16	0.60
3/24/12 8:00 PM	0.25	0.16	0.41
3/24/12 11:00 PM	0.20	0.17	0.37
3/25/12 2:00 AM	0.20	0.18	0.38
3/25/12 5:00 AM	0.20	0.18	0.38
3/25/12 8:00 AM	0.20	0.16	0.37
3/25/12 11:00 AM	0.21	0.14	0.35
3/25/12 2:00 PM	0.22	0.14	0.36
3/25/12 5:00 PM	0.23	0.15	0.38
3/25/12 8:00 PM	0.23	0.16	0.39
3/25/12 11:00 PM	0.23	0.10	0.33
3/26/12 2:00 AM	0.20	0.09	0.30
3/26/12 5:00 AM	0.20	0.12	0.32
3/26/12 8:00 AM	0.23	0.23	0.46
3/26/12 11:00 AM	0.23	0.24	0.47
3/26/12 2:00 PM	0.22	0.22	0.44
3/26/12 5:00 PM	0.22	0.21	0.43
3/26/12 8:00 PM	0.22	0.18	0.40
3/26/12 11:00 PM	0.22	0.14	0.36
3/27/12 2:00 AM	0.20	0.10	0.30
3/27/12 5:00 AM	0.19	0.11	0.29

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
3/27/12 8:00 AM	0.23	0.17	0.40
3/27/12 11:00 AM	0.23	0.29	0.52
3/27/12 2:00 PM	0.22	0.24	0.46
3/27/12 5:00 PM	0.21	0.28	0.49
3/27/12 8:00 PM	0.23	0.31	0.54
3/27/12 11:00 PM	0.22	0.25	0.47
3/28/12 2:00 AM	0.20	0.14	0.34
3/28/12 5:00 AM	0.23	0.19	0.42
3/28/12 8:00 AM	0.24	0.26	0.50
3/28/12 11:00 AM	0.22	0.21	0.42
3/28/12 2:00 PM	0.24	0.24	0.48
3/28/12 5:00 PM	0.61	0.19	0.81
3/28/12 8:00 PM	1.03	0.19	1.22
3/28/12 11:00 PM	0.69	0.20	0.88
3/29/12 2:00 AM	0.42	0.20	0.61
3/29/12 5:00 AM	0.44	0.19	0.64
3/29/12 8:00 AM	1.03	0.20	1.23
3/29/12 11:00 AM	0.98	0.26	1.24
3/29/12 2:00 PM	1.04	0.20	1.24
3/29/12 5:00 PM	0.95	0.19	1.14
3/29/12 8:00 PM	0.97	0.17	1.14
3/29/12 11:00 PM	0.96	0.13	1.09
3/30/12 2:00 AM	0.92	0.06	0.98
3/30/12 5:00 AM	0.88	0.08	0.96
3/30/12 8:00 AM	1.00	0.18	1.18
3/30/12 11:00 AM	0.90	0.19	1.09
3/30/12 2:00 PM	0.82	0.19	1.01
3/30/12 5:00 PM	0.80	0.18	0.98
3/30/12 8:00 PM	0.88	0.18	1.06
3/30/12 11:00 PM	0.91	0.17	1.08
3/31/12 2:00 AM	1.00	0.13	1.13
3/31/12 5:00 AM	1.02	0.13	1.15
3/31/12 8:00 AM	0.49	0.18	0.67
3/31/12 11:00 AM	0.78	0.18	0.96
3/31/12 2:00 PM	0.64	0.17	0.82
3/31/12 5:00 PM	0.97	0.17	1.14
3/31/12 8:00 PM	1.01	0.17	1.18
3/31/12 11:00 PM	0.95	0.09	1.04
4/1/12 2:00 AM	0.93	0.00	0.93
4/1/12 5:00 AM	0.94	0.00	0.94
4/1/12 8:00 AM	0.83	0.00	0.83
4/1/12 11:00 AM	0.84	0.00	0.84
4/1/12 2:00 PM	0.80	0.00	0.80
4/1/12 5:00 PM	0.79	0.00	0.79
4/1/12 8:00 PM	0.86	0.00	0.86
4/1/12 11:00 PM	0.87	0.00	0.87
4/2/12 2:00 AM	0.86	0.00	0.86
4/2/12 5:00 AM	0.24	0.00	0.24
4/2/12 8:00 AM	0.06	0.00	0.06
4/2/12 11:00 AM	0.05	0.00	0.05
4/2/12 2:00 PM	0.05	0.00	0.05
4/2/12 5:00 PM	0.05	0.00	0.05
4/2/12 8:00 PM	0.05	0.00	0.05
4/2/12 11:00 PM	0.06	0.00	0.06

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
4/3/12 2:00 AM	0.06	0.00	0.06
4/3/12 5:00 AM	0.06	0.00	0.06
4/3/12 8:00 AM	0.06	0.00	0.06
4/3/12 11:00 AM	0.19	0.15	0.34
4/3/12 2:00 PM	0.21	0.47	0.68
4/3/12 5:00 PM	0.21	0.45	0.66
4/3/12 8:00 PM	0.23	0.32	0.55
4/3/12 11:00 PM	0.25	0.32	0.57
4/4/12 2:00 AM	0.12	0.32	0.44
4/4/12 5:00 AM	0.24	0.32	0.57
4/4/12 8:00 AM	0.30	0.18	0.48
4/4/12 11:00 AM	0.24	0.18	0.41
4/4/12 2:00 PM	0.25	0.18	0.44
4/4/12 5:00 PM	0.24	0.20	0.44
4/4/12 8:00 PM	0.25	0.22	0.47
4/4/12 11:00 PM	0.30	0.20	0.50
4/5/12 2:00 AM	0.30	0.19	0.49
4/5/12 5:00 AM	0.29	0.18	0.47
4/5/12 8:00 AM	0.29	0.20	0.49
4/5/12 11:00 AM	0.25	0.19	0.44
4/5/12 2:00 PM	0.21	0.17	0.38
4/5/12 5:00 PM	0.25	0.17	0.42
4/5/12 8:00 PM	0.28	0.18	0.45
4/5/12 11:00 PM	0.28	0.17	0.46
4/6/12 2:00 AM	0.28	0.17	0.45
4/6/12 5:00 AM	0.28	0.19	0.48
4/6/12 8:00 AM	0.29	0.20	0.49
4/6/12 11:00 AM	0.28	0.21	0.49
4/6/12 2:00 PM	0.27	0.23	0.50
4/6/12 5:00 PM	0.26	0.23	0.50
4/6/12 8:00 PM	0.27	0.25	0.51
4/6/12 11:00 PM	0.27	0.24	0.51
4/7/12 2:00 AM	0.27	0.07	0.34
4/7/12 5:00 AM	0.26	0.00	0.26
4/7/12 8:00 AM	0.26	0.01	0.26
4/7/12 11:00 AM	0.26	0.16	0.41
4/7/12 2:00 PM	0.24	0.31	0.55
4/7/12 5:00 PM	0.24	0.29	0.53
4/7/12 8:00 PM	0.24	0.34	0.58
4/7/12 11:00 PM	0.23	0.34	0.57
4/8/12 2:00 AM	0.19	0.17	0.36
4/8/12 5:00 AM	0.17	0.15	0.32
4/8/12 8:00 AM	0.24	0.28	0.51
4/8/12 11:00 AM	0.25	0.30	0.54
4/8/12 2:00 PM	0.24	0.28	0.52
4/8/12 5:00 PM	0.23	0.28	0.50
4/8/12 8:00 PM	0.22	0.28	0.50
4/8/12 11:00 PM	0.21	0.24	0.45
4/9/12 2:00 AM	0.16	0.14	0.30
4/9/12 5:00 AM	0.19	0.18	0.38
4/9/12 8:00 AM	0.23	0.27	0.50
4/9/12 11:00 AM	0.22	0.28	0.50
4/9/12 2:00 PM	0.22	0.27	0.49
4/9/12 5:00 PM	0.22	0.25	0.47

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
4/9/12 8:00 PM	0.21	0.23	0.44
4/9/12 11:00 PM	0.18	0.24	0.42
4/10/12 2:00 AM	0.08	0.20	0.28
4/10/12 5:00 AM	0.14	0.20	0.34
4/10/12 8:00 AM	0.23	0.23	0.46
4/10/12 11:00 AM	0.22	0.24	0.47
4/10/12 2:00 PM	0.23	0.25	0.48
4/10/12 5:00 PM	0.23	0.27	0.50
4/10/12 8:00 PM	0.23	0.26	0.49
4/10/12 11:00 PM	0.23	0.14	0.37
4/11/12 2:00 AM	0.23	0.01	0.24
4/11/12 5:00 AM	0.23	0.00	0.23
4/11/12 8:00 AM	0.23	0.00	0.23
4/11/12 11:00 AM	0.23	0.00	0.23
4/11/12 2:00 PM	0.23	0.00	0.23
4/11/12 5:00 PM	0.23	0.00	0.23
4/11/12 8:00 PM	0.22	0.00	0.22
4/11/12 11:00 PM	0.21	0.00	0.21
4/12/12 2:00 AM	0.22	0.00	0.22
4/12/12 5:00 AM	0.21	0.00	0.21
4/12/12 8:00 AM	0.22	0.00	0.22
4/12/12 11:00 AM	0.21	0.00	0.21
4/12/12 2:00 PM	0.22	0.00	0.22
4/12/12 5:00 PM	0.21	0.00	0.21
4/12/12 8:00 PM	0.21	0.00	0.21
4/12/12 11:00 PM	0.21	0.00	0.21
4/13/12 2:00 AM	0.20	0.00	0.20
4/13/12 5:00 AM	0.19	0.00	0.19
4/13/12 8:00 AM	0.18	0.00	0.18
4/13/12 11:00 AM	0.17	0.13	0.30
4/13/12 2:00 PM	0.22	0.32	0.53
4/13/12 5:00 PM	0.31	0.26	0.57
4/13/12 8:00 PM	0.32	0.25	0.57
4/13/12 11:00 PM	0.22	0.25	0.47
4/14/12 2:00 AM	0.18	0.21	0.39
4/14/12 5:00 AM	0.19	0.00	0.19
4/14/12 8:00 AM	0.19	0.00	0.19
4/14/12 11:00 AM	0.19	0.00	0.19
4/14/12 2:00 PM	0.18	0.00	0.18
4/14/12 5:00 PM	0.19	0.00	0.19
4/14/12 8:00 PM	0.19	0.00	0.19
4/14/12 11:00 PM	0.21	0.17	0.37
4/15/12 2:00 AM	0.20	0.22	0.42
4/15/12 5:00 AM	0.18	0.23	0.41
4/15/12 8:00 AM	0.19	0.22	0.41
4/15/12 11:00 AM	0.27	0.27	0.54
4/15/12 2:00 PM	0.48	0.30	0.78
4/15/12 5:00 PM	0.41	0.30	0.71
4/15/12 8:00 PM	0.24	0.30	0.54
4/15/12 11:00 PM	0.03	0.31	0.34
4/16/12 2:00 AM	0.00	0.31	0.31
4/16/12 5:00 AM	0.00	0.26	0.26
4/16/12 8:00 AM	0.00	0.28	0.28
4/16/12 11:00 AM	0.00	0.30	0.30

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
4/16/12 2:00 PM	0.00	0.31	0.31
4/16/12 5:00 PM	0.00	0.31	0.31
4/16/12 8:00 PM	0.00	0.30	0.30
4/16/12 11:00 PM	0.00	0.30	0.30
4/17/12 2:00 AM	0.00	0.29	0.29
4/17/12 5:00 AM	0.00	0.29	0.29
4/17/12 8:00 AM	0.00	0.27	0.27
4/17/12 11:00 AM	0.00	0.25	0.25
4/17/12 2:00 PM	0.00	0.25	0.25
4/17/12 5:00 PM	0.00	0.24	0.24
4/17/12 8:00 PM	0.00	0.22	0.22
4/17/12 11:00 PM	0.00	0.22	0.22
4/18/12 2:00 AM	0.00	0.19	0.19
4/18/12 5:00 AM	0.00	0.21	0.21
4/18/12 8:00 AM	0.00	0.23	0.23
4/18/12 11:00 AM	0.00	0.24	0.24
4/18/12 2:00 PM	0.00	0.26	0.26
4/18/12 5:00 PM	0.00	0.48	0.48
4/18/12 8:00 PM	0.00	0.31	0.31
4/18/12 11:00 PM	0.00	0.30	0.30
4/19/12 2:00 AM	0.00	0.30	0.30
4/19/12 5:00 AM	0.00	0.31	0.31
4/19/12 8:00 AM	0.00	0.39	0.39
4/19/12 11:00 AM	0.00	0.44	0.44
4/19/12 2:00 PM	0.00	0.36	0.36
4/19/12 5:00 PM	0.00	0.40	0.40
4/19/12 8:00 PM	0.00	0.44	0.44
4/19/12 11:00 PM	0.00	0.48	0.48
4/20/12 2:00 AM	0.00	0.50	0.50
4/20/12 5:00 AM	0.00	0.52	0.52
4/20/12 8:00 AM	0.00	0.53	0.53
4/20/12 11:00 AM	0.00	0.55	0.55
4/20/12 2:00 PM	0.00	0.57	0.57
4/20/12 5:00 PM	0.00	0.52	0.52
4/20/12 8:00 PM	0.00	0.46	0.46
4/20/12 11:00 PM	0.00	0.42	0.42
4/21/12 2:00 AM	0.00	0.48	0.48
4/21/12 5:00 AM	0.00	0.48	0.48
4/21/12 8:00 AM	0.00	0.49	0.49
4/21/12 11:00 AM	0.00	0.51	0.51
4/21/12 2:00 PM	0.00	0.51	0.51
4/21/12 5:00 PM	0.00	0.52	0.52
4/21/12 8:00 PM	0.00	0.54	0.54
4/21/12 11:00 PM	0.00	0.49	0.49
4/22/12 2:00 AM	0.00	0.04	0.04
4/22/12 5:00 AM	0.00	0.00	0.00
4/22/12 8:00 AM	0.00	0.00	0.00
4/22/12 11:00 AM	0.00	0.00	0.00
4/22/12 2:00 PM	0.00	0.00	0.00
4/22/12 5:00 PM	0.00	0.00	0.00
4/22/12 8:00 PM	0.00	0.00	0.00
4/22/12 11:00 PM	0.00	0.00	0.00
4/23/12 2:00 AM	0.00	0.00	0.00
4/23/12 5:00 AM	0.00	0.00	0.00

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
4/23/12 8:00 AM	0.00	0.00	0.00
4/23/12 11:00 AM	0.00	0.00	0.00
4/23/12 2:00 PM	0.00	0.00	0.00
4/23/12 5:00 PM	0.00	0.00	0.00
4/23/12 8:00 PM	0.00	0.00	0.00
4/23/12 11:00 PM	0.00	0.00	0.00
4/24/12 2:00 AM	0.00	0.00	0.00
4/24/12 5:00 AM	0.00	0.00	0.00
4/24/12 8:00 AM	0.00	0.00	0.00
4/24/12 11:00 AM	0.00	0.00	0.00
4/24/12 2:00 PM	0.00	0.00	0.00
4/24/12 5:00 PM	0.00	0.00	0.00
4/24/12 8:00 PM	0.00	0.00	0.00
4/24/12 11:00 PM	0.00	0.00	0.00
4/25/12 2:00 AM	0.00	0.21	0.21
4/25/12 5:00 AM	0.00	0.36	0.36
4/25/12 8:00 AM	0.00	0.48	0.48
4/25/12 11:00 AM	0.00	0.27	0.27
4/25/12 2:00 PM	0.00	0.29	0.29
4/25/12 5:00 PM	0.00	0.35	0.35
4/25/12 8:00 PM	0.00	0.42	0.42
4/25/12 11:00 PM	0.00	0.45	0.45
4/26/12 2:00 AM	0.00	0.45	0.45
4/26/12 5:00 AM	0.00	0.48	0.48
4/26/12 8:00 AM	0.00	0.53	0.53
4/26/12 11:00 AM	0.00	0.58	0.58
4/26/12 2:00 PM	0.00	0.58	0.58
4/26/12 5:00 PM	0.00	0.56	0.56
4/26/12 8:00 PM	0.00	0.54	0.54
4/26/12 11:00 PM	0.00	0.55	0.55
4/27/12 2:00 AM	0.00	0.56	0.56
4/27/12 5:00 AM	0.00	0.64	0.64
4/27/12 8:00 AM	0.00	0.27	0.27
4/27/12 11:00 AM	0.00	0.22	0.22
4/27/12 2:00 PM	0.00	0.24	0.24
4/27/12 5:00 PM	0.00	0.26	0.26
4/27/12 8:00 PM	0.00	0.31	0.31
4/27/12 11:00 PM	0.00	0.36	0.36
4/28/12 2:00 AM	0.00	0.41	0.41
4/28/12 5:00 AM	0.00	0.44	0.44
4/28/12 8:00 AM	0.00	0.50	0.50
4/28/12 11:00 AM	0.00	0.48	0.48
4/28/12 2:00 PM	0.00	0.47	0.47
4/28/12 5:00 PM	0.00	0.54	0.54
4/28/12 8:00 PM	0.00	0.50	0.50
4/28/12 11:00 PM	0.00	0.36	0.36
4/29/12 2:00 AM	0.00	0.44	0.44
4/29/12 5:00 AM	0.00	0.48	0.48
4/29/12 8:00 AM	0.00	0.53	0.53
4/29/12 11:00 AM	0.00	0.56	0.56
4/29/12 2:00 PM	0.00	0.45	0.45
4/29/12 5:00 PM	0.00	0.16	0.16
4/29/12 8:00 PM	0.00	0.17	0.17
4/29/12 11:00 PM	0.00	0.34	0.34

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
4/30/12 2:00 AM	0.00	0.40	0.40
4/30/12 5:00 AM	0.00	0.44	0.44
4/30/12 8:00 AM	0.00	0.32	0.32
4/30/12 11:00 AM	0.00	0.00	0.00
4/30/12 2:00 PM	0.00	0.00	0.00
4/30/12 5:00 PM	0.00	0.00	0.00
4/30/12 8:00 PM	0.03	0.00	0.03
4/30/12 11:00 PM	0.06	0.00	0.06
5/1/12 2:00 AM	0.27	0.00	0.27
5/1/12 5:00 AM	0.47	0.00	0.47
5/1/12 8:00 AM	0.46	0.00	0.46
5/1/12 11:00 AM	0.46	0.00	0.46
5/1/12 2:00 PM	0.43	0.00	0.43
5/1/12 5:00 PM	0.28	0.00	0.28
5/1/12 8:00 PM	0.27	0.00	0.27
5/1/12 11:00 PM	0.08	0.00	0.08
5/2/12 2:00 AM	0.04	0.10	0.14
5/2/12 5:00 AM	0.05	0.14	0.19
5/2/12 8:00 AM	0.39	0.67	1.06
5/2/12 11:00 AM	0.53	0.20	0.73
5/2/12 2:00 PM	0.51	0.00	0.51
5/2/12 5:00 PM	0.43	0.12	0.55
5/2/12 8:00 PM	0.43	0.40	0.83
5/2/12 11:00 PM	0.37	0.37	0.74
5/3/12 2:00 AM	0.34	0.17	0.51
5/3/12 5:00 AM	0.33	0.20	0.52
5/3/12 8:00 AM	0.27	0.38	0.65
5/3/12 11:00 AM	0.35	0.32	0.68
5/3/12 2:00 PM	0.38	0.31	0.69
5/3/12 5:00 PM	0.42	0.31	0.74
5/3/12 8:00 PM	0.47	0.32	0.79
5/3/12 11:00 PM	0.14	0.32	0.45
5/4/12 2:00 AM	0.00	0.31	0.31
5/4/12 5:00 AM	0.00	0.31	0.31
5/4/12 8:00 AM	0.00	0.30	0.30
5/4/12 11:00 AM	0.05	0.29	0.34
5/4/12 2:00 PM	0.46	0.29	0.75
5/4/12 5:00 PM	0.49	0.28	0.76
5/4/12 8:00 PM	0.49	0.30	0.79
5/4/12 11:00 PM	0.54	0.31	0.85
5/5/12 2:00 AM	0.54	0.32	0.86
5/5/12 5:00 AM	0.54	0.34	0.88
5/5/12 8:00 AM	0.50	0.39	0.89
5/5/12 11:00 AM	0.54	0.42	0.96
5/5/12 2:00 PM	0.59	0.45	1.04
5/5/12 5:00 PM	0.61	0.48	1.09
5/5/12 8:00 PM	0.47	0.53	1.00
5/5/12 11:00 PM	0.40	0.59	0.99
5/6/12 2:00 AM	0.43	0.62	1.04
5/6/12 5:00 AM	0.45	0.54	0.99
5/6/12 8:00 AM	0.46	0.20	0.67
5/6/12 11:00 AM	0.46	0.22	0.69
5/6/12 2:00 PM	0.47	0.26	0.73
5/6/12 5:00 PM	0.48	0.30	0.79

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
5/6/12 8:00 PM	0.47	0.35	0.82
5/6/12 11:00 PM	0.42	0.40	0.82
5/7/12 2:00 AM	0.42	0.45	0.86
5/7/12 5:00 AM	0.44	0.51	0.95
5/7/12 8:00 AM	0.43	0.54	0.97
5/7/12 11:00 AM	0.39	0.55	0.94
5/7/12 2:00 PM	0.36	0.58	0.94
5/7/12 5:00 PM	0.34	0.61	0.95
5/7/12 8:00 PM	0.34	0.58	0.92
5/7/12 11:00 PM	0.31	0.53	0.84
5/8/12 2:00 AM	0.29	0.36	0.64
5/8/12 5:00 AM	0.22	0.37	0.59
5/8/12 8:00 AM	0.26	0.44	0.69
5/8/12 11:00 AM	0.31	0.34	0.65
5/8/12 2:00 PM	0.34	0.32	0.66
5/8/12 5:00 PM	0.31	0.30	0.61
5/8/12 8:00 PM	0.30	0.27	0.57
5/8/12 11:00 PM	0.23	0.26	0.49
5/9/12 2:00 AM	0.10	0.26	0.36
5/9/12 5:00 AM	0.20	0.25	0.45
5/9/12 8:00 AM	0.29	0.23	0.52
5/9/12 11:00 AM	0.28	0.26	0.54
5/9/12 2:00 PM	0.26	0.23	0.49
5/9/12 5:00 PM	0.24	0.25	0.49
5/9/12 8:00 PM	0.24	0.23	0.47
5/9/12 11:00 PM	0.23	0.23	0.46
5/10/12 2:00 AM	0.22	0.21	0.43
5/10/12 5:00 AM	0.21	0.23	0.43
5/10/12 8:00 AM	0.21	0.22	0.43
5/10/12 11:00 AM	0.21	0.21	0.42
5/10/12 2:00 PM	0.19	0.21	0.41
5/10/12 5:00 PM	0.19	0.21	0.40
5/10/12 8:00 PM	0.19	0.20	0.39
5/10/12 11:00 PM	0.13	0.22	0.35
5/11/12 2:00 AM	0.08	0.24	0.32
5/11/12 5:00 AM	0.08	0.25	0.34
5/11/12 8:00 AM	0.18	0.25	0.44
5/11/12 11:00 AM	0.17	0.23	0.40
5/11/12 2:00 PM	0.16	0.20	0.36
5/11/12 5:00 PM	0.16	0.20	0.36
5/11/12 8:00 PM	0.17	0.20	0.36
5/11/12 11:00 PM	0.18	0.23	0.41
5/12/12 2:00 AM	0.15	0.18	0.33
5/12/12 5:00 AM	0.13	0.23	0.36
5/12/12 8:00 AM	0.17	0.22	0.40
5/12/12 11:00 AM	0.18	0.22	0.41
5/12/12 2:00 PM	0.21	0.21	0.42
5/12/12 5:00 PM	0.21	0.21	0.42
5/12/12 8:00 PM	0.22	0.22	0.44
5/12/12 11:00 PM	0.23	0.22	0.45
5/13/12 2:00 AM	0.22	0.22	0.44
5/13/12 5:00 AM	0.21	0.22	0.43
5/13/12 8:00 AM	0.22	0.21	0.43
5/13/12 11:00 AM	0.21	0.21	0.42

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
5/13/12 2:00 PM	0.21	0.20	0.41
5/13/12 5:00 PM	0.23	0.20	0.43
5/13/12 8:00 PM	0.23	0.20	0.43
5/13/12 11:00 PM	0.22	0.20	0.42
5/14/12 2:00 AM	0.08	0.16	0.24
5/14/12 5:00 AM	0.15	0.12	0.27
5/14/12 8:00 AM	0.24	0.10	0.34
5/14/12 11:00 AM	0.24	0.11	0.35
5/14/12 2:00 PM	0.23	0.12	0.34
5/14/12 5:00 PM	0.22	0.13	0.36
5/14/12 8:00 PM	0.21	0.13	0.35
5/14/12 11:00 PM	0.21	0.08	0.30
5/15/12 2:00 AM	0.20	0.06	0.26
5/15/12 5:00 AM	0.18	0.15	0.33
5/15/12 8:00 AM	0.20	0.21	0.41
5/15/12 11:00 AM	0.21	0.21	0.42
5/15/12 2:00 PM	0.19	0.21	0.40
5/15/12 5:00 PM	0.13	0.21	0.34
5/15/12 8:00 PM	0.19	0.22	0.41
5/15/12 11:00 PM	0.15	0.23	0.38
5/16/12 2:00 AM	0.06	0.23	0.29
5/16/12 5:00 AM	0.11	0.23	0.34
5/16/12 8:00 AM	0.20	0.24	0.44
5/16/12 11:00 AM	0.20	0.24	0.44
5/16/12 2:00 PM	0.21	0.24	0.44
5/16/12 5:00 PM	0.19	0.25	0.44
5/16/12 8:00 PM	0.20	0.27	0.47
5/16/12 11:00 PM	0.20	0.10	0.30
5/17/12 2:00 AM	0.21	0.07	0.28
5/17/12 5:00 AM	0.21	0.08	0.29
5/17/12 8:00 AM	0.23	0.09	0.32
5/17/12 11:00 AM	0.27	0.44	0.71
5/17/12 2:00 PM	0.22	0.54	0.76
5/17/12 5:00 PM	0.23	0.47	0.70
5/17/12 8:00 PM	0.23	0.50	0.73
5/17/12 11:00 PM	0.14	0.50	0.64
5/18/12 2:00 AM	0.14	0.50	0.64
5/18/12 5:00 AM	0.15	0.52	0.67
5/18/12 8:00 AM	0.23	0.53	0.76
5/18/12 11:00 AM	0.24	0.49	0.73
5/18/12 2:00 PM	0.24	0.44	0.68
5/18/12 5:00 PM	0.24	0.37	0.61
5/18/12 8:00 PM	0.24	0.35	0.59
5/18/12 11:00 PM	0.24	0.28	0.52
5/19/12 2:00 AM	0.24	0.16	0.40
5/19/12 5:00 AM	0.24	0.16	0.40
5/19/12 8:00 AM	0.26	0.28	0.54
5/19/12 11:00 AM	0.27	0.31	0.58
5/19/12 2:00 PM	0.28	0.32	0.59
5/19/12 5:00 PM	0.28	0.29	0.56
5/19/12 8:00 PM	0.25	0.29	0.54
5/19/12 11:00 PM	0.23	0.31	0.54
5/20/12 2:00 AM	0.07	0.30	0.37
5/20/12 5:00 AM	0.06	0.24	0.30

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
5/20/12 8:00 AM	0.11	0.26	0.37
5/20/12 11:00 AM	0.20	0.28	0.49
5/20/12 2:00 PM	0.19	0.29	0.48
5/20/12 5:00 PM	0.20	0.25	0.45
5/20/12 8:00 PM	0.19	0.26	0.45
5/20/12 11:00 PM	0.19	0.25	0.45
5/21/12 2:00 AM	0.18	0.20	0.38
5/21/12 5:00 AM	0.17	0.24	0.41
5/21/12 8:00 AM	0.21	0.20	0.41
5/21/12 11:00 AM	0.21	0.14	0.36
5/21/12 2:00 PM	0.20	0.16	0.36
5/21/12 5:00 PM	0.22	0.16	0.38
5/21/12 8:00 PM	0.19	0.18	0.37
5/21/12 11:00 PM	0.13	0.18	0.32
5/22/12 2:00 AM	0.08	0.20	0.28
5/22/12 5:00 AM	0.09	0.20	0.30
5/22/12 8:00 AM	0.19	0.21	0.41
5/22/12 11:00 AM	0.18	0.20	0.38
5/22/12 2:00 PM	0.17	0.19	0.37
5/22/12 5:00 PM	0.17	0.21	0.38
5/22/12 8:00 PM	0.18	0.20	0.38
5/22/12 11:00 PM	0.14	0.21	0.35
5/23/12 2:00 AM	0.08	0.20	0.28
5/23/12 5:00 AM	0.08	0.21	0.29
5/23/12 8:00 AM	0.19	0.22	0.41
5/23/12 11:00 AM	0.18	0.26	0.43
5/23/12 2:00 PM	0.17	0.23	0.39
5/23/12 5:00 PM	0.17	0.23	0.41
5/23/12 8:00 PM	0.19	0.26	0.45
5/23/12 11:00 PM	0.17	0.22	0.39
5/24/12 2:00 AM	0.16	0.04	0.21
5/24/12 5:00 AM	0.17	0.00	0.17
5/24/12 8:00 AM	0.19	0.00	0.19
5/24/12 11:00 AM	0.19	0.00	0.19
5/24/12 2:00 PM	0.20	0.00	0.20
5/24/12 5:00 PM	0.21	0.00	0.21
5/24/12 8:00 PM	0.21	0.00	0.21
5/24/12 11:00 PM	0.22	0.00	0.22
5/25/12 2:00 AM	0.22	0.00	0.22
5/25/12 5:00 AM	0.25	0.00	0.25
5/25/12 8:00 AM	0.22	0.00	0.22
5/25/12 11:00 AM	0.19	0.00	0.19
5/25/12 2:00 PM	0.20	0.00	0.20
5/25/12 5:00 PM	0.19	0.00	0.19
5/25/12 8:00 PM	0.21	0.00	0.21
5/25/12 11:00 PM	0.22	0.00	0.22
5/26/12 2:00 AM	0.23	0.00	0.23
5/26/12 5:00 AM	0.23	0.00	0.23
5/26/12 8:00 AM	0.24	0.00	0.24
5/26/12 11:00 AM	0.24	0.00	0.24
5/26/12 2:00 PM	0.25	0.00	0.25
5/26/12 5:00 PM	0.23	0.00	0.23
5/26/12 8:00 PM	0.24	0.00	0.24
5/26/12 11:00 PM	0.24	0.00	0.24

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
5/27/12 2:00 AM	0.25	0.00	0.25
5/27/12 5:00 AM	0.24	0.00	0.24
5/27/12 8:00 AM	0.26	0.00	0.26
5/27/12 11:00 AM	0.27	0.00	0.27
5/27/12 2:00 PM	0.29	0.00	0.29
5/27/12 5:00 PM	0.30	0.00	0.30
5/27/12 8:00 PM	0.30	0.17	0.47
5/27/12 11:00 PM	0.32	0.88	1.20
5/28/12 2:00 AM	0.34	0.63	0.96
5/28/12 5:00 AM	0.34	0.42	0.75
5/28/12 8:00 AM	0.32	0.35	0.68
5/28/12 11:00 AM	0.31	0.41	0.72
5/28/12 2:00 PM	0.32	0.37	0.69
5/28/12 5:00 PM	0.32	0.33	0.66
5/28/12 8:00 PM	0.32	0.31	0.62
5/28/12 11:00 PM	0.32	0.31	0.63
5/29/12 2:00 AM	0.32	0.32	0.64
5/29/12 5:00 AM	0.31	0.36	0.67
5/29/12 8:00 AM	0.39	0.38	0.77
5/29/12 11:00 AM	0.40	0.35	0.75
5/29/12 2:00 PM	0.38	0.38	0.76
5/29/12 5:00 PM	0.34	0.42	0.76
5/29/12 8:00 PM	0.15	0.46	0.60
5/29/12 11:00 PM	0.13	0.49	0.62
5/30/12 2:00 AM	0.30	0.37	0.67
5/30/12 5:00 AM	0.33	0.35	0.68
5/30/12 8:00 AM	0.29	0.43	0.71
5/30/12 11:00 AM	0.29	0.32	0.62
5/30/12 2:00 PM	0.17	0.33	0.50
5/30/12 5:00 PM	0.03	0.32	0.35
5/30/12 8:00 PM	0.22	0.31	0.52
5/30/12 11:00 PM	0.30	0.32	0.62
5/31/12 2:00 AM	0.30	0.25	0.55
5/31/12 5:00 AM	0.35	0.21	0.55
5/31/12 8:00 AM	0.36	0.18	0.54
5/31/12 11:00 AM	0.35	0.18	0.52
5/31/12 2:00 PM	0.36	0.16	0.52
5/31/12 5:00 PM	0.32	0.16	0.47
5/31/12 8:00 PM	0.51	0.16	0.67
5/31/12 11:00 PM	0.74	0.15	0.89
6/1/12 2:00 AM	0.60	0.20	0.80
6/1/12 5:00 AM	0.85	0.17	1.03
6/1/12 8:00 AM	0.55	0.17	0.72
6/1/12 11:00 AM	0.55	0.16	0.71
6/1/12 2:00 PM	0.66	0.16	0.82
6/1/12 5:00 PM	0.96	0.16	1.12
6/1/12 8:00 PM	0.98	0.18	1.16
6/1/12 11:00 PM	0.85	0.09	0.94
6/2/12 2:00 AM	0.73	0.10	0.84
6/2/12 5:00 AM	0.38	0.24	0.61
6/2/12 8:00 AM	0.49	0.29	0.78
6/2/12 11:00 AM	0.51	0.27	0.79
6/2/12 2:00 PM	0.41	0.18	0.59
6/2/12 5:00 PM	0.62	0.15	0.77

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
6/2/12 8:00 PM	0.98	0.16	1.15
6/2/12 11:00 PM	0.82	0.17	0.99
6/3/12 2:00 AM	0.91	0.16	1.07
6/3/12 5:00 AM	0.61	0.20	0.81
6/3/12 8:00 AM	0.67	0.25	0.92
6/3/12 11:00 AM	0.82	0.20	1.02
6/3/12 2:00 PM	0.67	0.23	0.91
6/3/12 5:00 PM	0.74	0.22	0.96
6/3/12 8:00 PM	0.72	0.19	0.91
6/3/12 11:00 PM	0.71	0.19	0.90
6/4/12 2:00 AM	0.67	0.20	0.87
6/4/12 5:00 AM	0.59	0.21	0.79
6/4/12 8:00 AM	0.73	0.20	0.93
6/4/12 11:00 AM	0.84	0.18	1.02
6/4/12 2:00 PM	0.78	0.22	1.00
6/4/12 5:00 PM	0.87	0.20	1.07
6/4/12 8:00 PM	1.01	0.18	1.19
6/4/12 11:00 PM	1.16	0.11	1.27
6/5/12 2:00 AM	1.19	0.02	1.22
6/5/12 5:00 AM	1.08	0.03	1.12
6/5/12 8:00 AM	1.05	0.12	1.17
6/5/12 11:00 AM	1.02	0.24	1.26
6/5/12 2:00 PM	0.85	0.19	1.04
6/5/12 5:00 PM	0.48	0.19	0.68
6/5/12 8:00 PM	0.13	0.19	0.33
6/5/12 11:00 PM	0.11	0.20	0.31
6/6/12 2:00 AM	0.35	0.18	0.54
6/6/12 5:00 AM	0.26	0.19	0.44
6/6/12 8:00 AM	0.26	0.00	0.26
6/6/12 11:00 AM	0.26	0.00	0.26
6/6/12 2:00 PM	0.25	0.00	0.25
6/6/12 5:00 PM	0.25	0.00	0.25
6/6/12 8:00 PM	0.47	0.00	0.47
6/6/12 11:00 PM	0.71	0.00	0.71
6/7/12 2:00 AM	0.87	0.00	0.87
6/7/12 5:00 AM	1.08	0.00	1.08
6/7/12 8:00 AM	0.48	0.00	0.48
6/7/12 11:00 AM	0.19	0.00	0.19
6/7/12 2:00 PM	0.18	0.00	0.18
6/7/12 5:00 PM	0.20	0.00	0.20
6/7/12 8:00 PM	0.19	0.00	0.19
6/7/12 11:00 PM	0.23	0.00	0.23
6/8/12 2:00 AM	0.23	0.00	0.23
6/8/12 5:00 AM	0.31	0.00	0.31
6/8/12 8:00 AM	0.25	0.00	0.25
6/8/12 11:00 AM	0.17	0.00	0.17
6/8/12 2:00 PM	0.15	0.00	0.15
6/8/12 5:00 PM	0.15	0.00	0.15
6/8/12 8:00 PM	0.15	0.00	0.15
6/8/12 11:00 PM	0.14	0.00	0.14
6/9/12 2:00 AM	0.14	0.00	0.14
6/9/12 5:00 AM	0.14	0.00	0.14
6/9/12 8:00 AM	0.15	0.00	0.15
6/9/12 11:00 AM	0.16	0.00	0.16

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
6/9/12 2:00 PM	0.16	0.00	0.16
6/9/12 5:00 PM	0.16	0.00	0.16
6/9/12 8:00 PM	0.16	0.00	0.16
6/9/12 11:00 PM	0.16	0.00	0.16
6/10/12 2:00 AM	0.14	0.00	0.14
6/10/12 5:00 AM	0.15	0.00	0.15
6/10/12 8:00 AM	0.17	0.00	0.17
6/10/12 11:00 AM	0.16	0.00	0.16
6/10/12 2:00 PM	0.15	0.00	0.15
6/10/12 5:00 PM	0.15	0.00	0.15
6/10/12 8:00 PM	0.16	0.00	0.16
6/10/12 11:00 PM	0.16	0.00	0.16
6/11/12 2:00 AM	0.16	0.00	0.16
6/11/12 5:00 AM	0.17	0.13	0.30
6/11/12 8:00 AM	0.18	0.33	0.51
6/11/12 11:00 AM	0.18	0.57	0.75
6/11/12 2:00 PM	0.17	0.12	0.29
6/11/12 5:00 PM	0.16	0.07	0.23
6/11/12 8:00 PM	0.18	0.09	0.27
6/11/12 11:00 PM	0.18	0.03	0.21
6/12/12 2:00 AM	0.18	0.00	0.18
6/12/12 5:00 AM	0.17	0.00	0.17
6/12/12 8:00 AM	0.17	0.00	0.17
6/12/12 11:00 AM	0.18	0.00	0.18
6/12/12 2:00 PM	0.18	0.00	0.18
6/12/12 5:00 PM	0.17	0.00	0.17
6/12/12 8:00 PM	0.17	0.00	0.17
6/12/12 11:00 PM	0.17	0.00	0.17
6/13/12 2:00 AM	0.16	0.33	0.49
6/13/12 5:00 AM	0.16	0.34	0.50
6/13/12 8:00 AM	0.17	0.31	0.48
6/13/12 11:00 AM	0.17	0.28	0.45
6/13/12 2:00 PM	0.19	0.25	0.44
6/13/12 5:00 PM	0.17	0.27	0.44
6/13/12 8:00 PM	0.18	0.28	0.46
6/13/12 11:00 PM	0.13	0.30	0.43
6/14/12 2:00 AM	0.10	0.28	0.38
6/14/12 5:00 AM	0.10	0.30	0.40
6/14/12 8:00 AM	0.19	0.32	0.51
6/14/12 11:00 AM	0.20	0.32	0.53
6/14/12 2:00 PM	0.21	0.34	0.55
6/14/12 5:00 PM	0.20	0.34	0.54
6/14/12 8:00 PM	0.13	0.34	0.47
6/14/12 11:00 PM	0.00	0.33	0.33
6/15/12 2:00 AM	0.00	0.36	0.36
6/15/12 5:00 AM	0.00	0.37	0.37
6/15/12 8:00 AM	0.00	0.40	0.40
6/15/12 11:00 AM	0.00	0.41	0.41
6/15/12 2:00 PM	0.00	0.47	0.47
6/15/12 5:00 PM	0.00	0.21	0.21
6/15/12 8:00 PM	0.00	0.36	0.36
6/15/12 11:00 PM	0.07	0.07	0.14
6/16/12 2:00 AM	0.09	0.09	0.18
6/16/12 5:00 AM	0.09	0.18	0.27

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
6/16/12 8:00 AM	0.14	0.48	0.62
6/16/12 11:00 AM	0.27	0.45	0.72
6/16/12 2:00 PM	0.23	0.42	0.65
6/16/12 5:00 PM	0.26	0.21	0.47
6/16/12 8:00 PM	0.26	0.01	0.26
6/16/12 11:00 PM	0.27	0.00	0.27
6/17/12 2:00 AM	0.24	0.00	0.24
6/17/12 5:00 AM	0.22	0.00	0.22
6/17/12 8:00 AM	0.25	0.00	0.25
6/17/12 11:00 AM	0.31	0.00	0.31
6/17/12 2:00 PM	0.31	0.00	0.31
6/17/12 5:00 PM	0.30	0.00	0.30
6/17/12 8:00 PM	0.27	0.00	0.27
6/17/12 11:00 PM	0.25	0.00	0.25
6/18/12 2:00 AM	0.23	0.00	0.23
6/18/12 5:00 AM	0.24	0.00	0.24
6/18/12 8:00 AM	0.23	0.21	0.44
6/18/12 11:00 AM	0.24	0.54	0.77
6/18/12 2:00 PM	0.25	0.27	0.52
6/18/12 5:00 PM	0.25	0.14	0.39
6/18/12 8:00 PM	0.27	0.00	0.27
6/18/12 11:00 PM	0.27	0.00	0.27
6/19/12 2:00 AM	0.26	0.00	0.26
6/19/12 5:00 AM	0.28	0.00	0.28
6/19/12 8:00 AM	0.29	0.00	0.29
6/19/12 11:00 AM	0.27	0.00	0.27
6/19/12 2:00 PM	0.26	0.00	0.26
6/19/12 5:00 PM	0.28	0.00	0.28
6/19/12 8:00 PM	0.28	0.00	0.28
6/19/12 11:00 PM	0.27	0.00	0.27
6/20/12 2:00 AM	0.28	0.00	0.28
6/20/12 5:00 AM	0.28	0.00	0.28
6/20/12 8:00 AM	0.29	0.00	0.29
6/20/12 11:00 AM	0.28	0.00	0.28
6/20/12 2:00 PM	0.26	0.00	0.26
6/20/12 5:00 PM	0.27	0.00	0.27
6/20/12 8:00 PM	0.27	0.00	0.27
6/20/12 11:00 PM	0.26	0.00	0.26
6/21/12 2:00 AM	0.43	0.00	0.43
6/21/12 5:00 AM	0.41	0.00	0.41
6/21/12 8:00 AM	0.36	0.00	0.36
6/21/12 11:00 AM	0.33	0.00	0.33
6/21/12 2:00 PM	0.45	0.00	0.45
6/21/12 5:00 PM	1.01	0.00	1.01
6/21/12 8:00 PM	0.89	0.00	0.89
6/22/12 11:00 PM	0.86	0.00	0.86
6/22/12 2:00 AM	0.78	0.00	0.78
6/22/12 5:00 AM	0.74	0.00	0.74
6/22/12 8:00 AM	0.90	0.00	0.90
6/22/12 11:00 AM	0.89	0.00	0.89
6/22/12 2:00 PM	0.85	0.00	0.85
6/22/12 5:00 PM	0.92	0.00	0.92
6/22/12 8:00 PM	0.88	0.00	0.88
6/22/12 11:00 PM	0.50	0.00	0.50

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
6/23/12 2:00 AM	0.22	0.00	0.22
6/23/12 5:00 AM	0.29	0.00	0.29
6/23/12 8:00 AM	0.73	0.00	0.73
6/23/12 11:00 AM	0.78	0.00	0.78
6/23/12 2:00 PM	0.92	0.00	0.92
6/23/12 5:00 PM	0.88	0.00	0.88
6/23/12 8:00 PM	0.89	0.00	0.89
6/23/12 11:00 PM	0.90	0.00	0.90
6/24/12 2:00 AM	0.90	0.00	0.90
6/24/12 5:00 AM	0.92	0.00	0.92
6/24/12 8:00 AM	0.93	0.00	0.93
6/24/12 11:00 AM	0.92	0.00	0.92
6/24/12 2:00 PM	0.85	0.00	0.85
6/24/12 5:00 PM	0.90	0.00	0.90
6/24/12 8:00 PM	0.92	0.00	0.92
6/24/12 11:00 PM	0.89	0.00	0.89
6/25/12 2:00 AM	0.85	0.19	1.04
6/25/12 5:00 AM	0.86	0.32	1.18
6/25/12 8:00 AM	0.67	0.46	1.13
6/25/12 11:00 AM	0.66	0.34	1.01
6/25/12 2:00 PM	0.70	0.27	0.97
6/25/12 5:00 PM	0.65	0.21	0.86
6/25/12 8:00 PM	0.67	0.18	0.85
6/25/12 11:00 PM	0.52	0.15	0.67
6/26/12 2:00 AM	0.26	0.08	0.34
6/26/12 5:00 AM	0.31	0.08	0.39
6/26/12 8:00 AM	0.38	0.05	0.43
6/26/12 11:00 AM	0.43	0.08	0.51
6/26/12 2:00 PM	0.58	0.08	0.66
6/26/12 5:00 PM	0.84	0.08	0.93
6/26/12 8:00 PM	0.72	0.03	0.75
6/26/12 11:00 PM	0.80	0.02	0.82
6/27/12 2:00 AM	0.84	0.04	0.89
6/27/12 5:00 AM	0.88	0.05	0.92
6/27/12 8:00 AM	0.79	0.06	0.85
6/27/12 11:00 AM	0.86	0.08	0.94
6/27/12 2:00 PM	0.94	0.08	1.02
6/27/12 5:00 PM	0.96	0.08	1.04
6/27/12 8:00 PM	0.87	0.08	0.95
6/27/12 11:00 PM	0.73	0.08	0.81
6/28/12 2:00 AM	0.88	0.08	0.96
6/28/12 5:00 AM	0.84	0.08	0.92
6/28/12 8:00 AM	0.92	0.11	1.03
6/28/12 11:00 AM	0.93	0.10	1.03
6/28/12 2:00 PM	1.01	0.09	1.10
6/28/12 5:00 PM	1.02	0.09	1.11
6/28/12 8:00 PM	0.94	0.09	1.03
6/28/12 11:00 PM	0.90	0.09	0.98
6/29/12 2:00 AM	0.84	0.09	0.93
6/29/12 5:00 AM	0.91	0.09	1.00
6/29/12 8:00 AM	1.14	0.08	1.22
6/29/12 11:00 AM	0.99	0.06	1.06
6/29/12 2:00 PM	0.84	0.06	0.90
6/29/12 5:00 PM	0.75	0.06	0.81

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
6/29/12 8:00 PM	0.85	0.06	0.91
6/29/12 11:00 PM	0.82	0.06	0.87
6/30/12 2:00 AM	0.74	0.06	0.79
6/30/12 5:00 AM	0.85	0.05	0.90
6/30/12 8:00 AM	0.80	0.05	0.86
6/30/12 11:00 AM	0.74	0.03	0.77
6/30/12 2:00 PM	0.82	0.03	0.84
6/30/12 5:00 PM	0.72	0.03	0.75
6/30/12 8:00 PM	0.76	0.02	0.78
6/30/12 11:00 PM	0.54	0.02	0.56
7/1/12 2:00 AM	0.50	0.02	0.52
7/1/12 5:00 AM	0.59	0.02	0.62
7/1/12 8:00 AM	0.90	0.02	0.92
7/1/12 11:00 AM	0.87	0.02	0.89
7/1/12 2:00 PM	0.79	0.02	0.82
7/1/12 5:00 PM	0.74	0.03	0.77
7/1/12 8:00 PM	0.83	0.02	0.85
7/1/12 11:00 PM	0.92	0.00	0.92
7/2/12 2:00 AM	0.96	0.00	0.96
7/2/12 5:00 AM	0.97	0.00	0.97
7/2/12 8:00 AM	0.96	0.00	0.96
7/2/12 11:00 AM	0.97	0.00	0.97
7/2/12 2:00 PM	0.86	0.00	0.86
7/2/12 5:00 PM	0.83	0.00	0.83
7/2/12 8:00 PM	0.83	0.00	0.83
7/2/12 11:00 PM	0.80	0.00	0.80
7/3/12 2:00 AM	0.80	0.00	0.80
7/3/12 5:00 AM	0.77	0.00	0.77
7/3/12 8:00 AM	0.78	0.00	0.78
7/3/12 11:00 AM	0.73	0.00	0.73
7/3/12 2:00 PM	0.74	0.00	0.74
7/3/12 5:00 PM	0.72	0.00	0.72
7/3/12 8:00 PM	0.76	0.00	0.76
7/3/12 11:00 PM	0.75	0.00	0.75
7/4/12 2:00 AM	0.50	0.00	0.50
7/4/12 5:00 AM	0.81	0.00	0.81
7/4/12 8:00 AM	0.91	0.00	0.91
7/4/12 11:00 AM	0.79	0.00	0.79
7/4/12 2:00 PM	0.26	0.00	0.26
7/4/12 5:00 PM	0.20	0.00	0.20
7/4/12 8:00 PM	0.46	0.00	0.46
7/4/12 11:00 PM	0.89	0.00	0.89
7/5/12 2:00 AM	0.92	0.00	0.92
7/5/12 5:00 AM	0.87	0.00	0.87
7/5/12 8:00 AM	0.86	0.00	0.86
7/5/12 11:00 AM	0.82	0.00	0.82
7/5/12 2:00 PM	0.72	0.00	0.72
7/5/12 5:00 PM	0.59	0.00	0.59
7/5/12 8:00 PM	0.62	0.00	0.62
7/5/12 11:00 PM	0.53	0.00	0.53
7/6/12 2:00 AM	0.51	0.00	0.51
7/6/12 5:00 AM	0.53	0.00	0.53
7/6/12 8:00 AM	0.55	0.00	0.55
7/6/12 11:00 AM	0.60	0.00	0.60

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
7/6/12 2:00 PM	0.73	0.00	0.73
7/6/12 5:00 PM	0.80	0.00	0.80
7/6/12 8:00 PM	0.80	0.00	0.80
7/6/12 11:00 PM	0.79	0.00	0.79
7/7/12 2:00 AM	0.73	0.00	0.73
7/7/12 5:00 AM	0.77	0.00	0.77
7/7/12 8:00 AM	0.90	0.00	0.90
7/7/12 11:00 AM	0.91	0.00	0.91
7/7/12 2:00 PM	0.91	0.00	0.91
7/7/12 5:00 PM	1.14	0.00	1.14
7/7/12 8:00 PM	0.91	0.00	0.91
7/7/12 11:00 PM	0.92	0.00	0.92
7/8/12 2:00 AM	0.89	0.00	0.89
7/8/12 5:00 AM	0.90	0.00	0.90
7/8/12 8:00 AM	0.92	0.00	0.92
7/8/12 11:00 AM	0.89	0.00	0.89
7/8/12 2:00 PM	0.87	0.00	0.87
7/8/12 5:00 PM	0.86	0.00	0.86
7/8/12 8:00 PM	0.91	0.00	0.91
7/8/12 11:00 PM	0.87	0.00	0.87
7/9/12 2:00 AM	0.83	0.00	0.83
7/9/12 5:00 AM	0.79	0.00	0.79
7/9/12 8:00 AM	0.81	0.00	0.81
7/9/12 11:00 AM	0.75	0.00	0.75
7/9/12 2:00 PM	0.74	0.00	0.74
7/9/12 5:00 PM	0.74	0.00	0.74
7/9/12 8:00 PM	0.75	0.00	0.75
7/9/12 11:00 PM	0.78	0.00	0.78
7/10/12 2:00 AM	0.82	0.00	0.82
7/10/12 5:00 AM	0.82	0.00	0.82
7/10/12 8:00 AM	0.82	0.00	0.82
7/10/12 11:00 AM	0.78	0.00	0.78
7/10/12 2:00 PM	0.80	0.00	0.80
7/10/12 5:00 PM	0.85	0.00	0.85
7/10/12 8:00 PM	0.84	0.00	0.84
7/10/12 11:00 PM	0.89	0.00	0.89
7/11/12 2:00 AM	0.89	0.00	0.89
7/11/12 5:00 AM	0.91	0.00	0.91
7/11/12 8:00 AM	0.87	0.00	0.87
7/11/12 11:00 AM	0.81	0.00	0.81
7/11/12 2:00 PM	0.71	0.00	0.71
7/11/12 5:00 PM	0.83	0.00	0.83
7/11/12 8:00 PM	0.84	0.00	0.84
7/11/12 11:00 PM	0.83	0.00	0.83
7/12/12 2:00 AM	0.32	0.00	0.32
7/12/12 5:00 AM	0.48	0.00	0.48
7/12/12 8:00 AM	0.88	0.00	0.88
7/12/12 11:00 AM	0.84	0.00	0.84
7/12/12 2:00 PM	0.83	0.00	0.83
7/12/12 5:00 PM	0.83	0.00	0.83
7/12/12 8:00 PM	0.84	0.00	0.84
7/12/12 11:00 PM	0.43	0.00	0.43
7/13/12 2:00 AM	0.23	0.00	0.23
7/13/12 5:00 AM	0.38	0.00	0.38

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
7/13/12 8:00 AM	0.87	0.00	0.87
7/13/12 11:00 AM	0.82	0.00	0.82
7/13/12 2:00 PM	0.75	0.00	0.75
7/13/12 5:00 PM	0.75	0.00	0.75
7/13/12 8:00 PM	0.82	0.01	0.83
7/13/12 11:00 PM	0.81	0.08	0.89
7/14/12 2:00 AM	0.79	0.07	0.85
7/14/12 5:00 AM	0.88	0.10	0.99
7/14/12 8:00 AM	0.93	0.16	1.10
7/14/12 11:00 AM	0.96	0.14	1.10
7/14/12 2:00 PM	0.89	0.13	1.02
7/14/12 5:00 PM	0.87	0.12	0.99
7/14/12 8:00 PM	0.89	0.12	1.01
7/14/12 11:00 PM	0.87	0.12	0.99
7/15/12 2:00 AM	0.80	0.11	0.92
7/15/12 5:00 AM	0.82	0.11	0.93
7/15/12 8:00 AM	0.85	0.11	0.96
7/15/12 11:00 AM	0.83	0.10	0.94
7/15/12 2:00 PM	0.88	0.10	0.98
7/15/12 5:00 PM	0.84	0.09	0.94
7/15/12 8:00 PM	0.90	0.10	0.99
7/15/12 11:00 PM	0.87	0.09	0.96
7/16/12 2:00 AM	0.46	0.10	0.56
7/16/12 5:00 AM	0.47	0.09	0.56
7/16/12 8:00 AM	0.96	0.09	1.05
7/16/12 11:00 AM	0.99	0.09	1.08
7/16/12 2:00 PM	0.98	0.10	1.08
7/16/12 5:00 PM	0.95	0.10	1.05
7/16/12 8:00 PM	0.95	0.09	1.04
7/16/12 11:00 PM	0.70	0.08	0.78
7/17/12 2:00 AM	0.46	0.08	0.54
7/17/12 5:00 AM	0.72	0.08	0.80
7/17/12 8:00 AM	1.02	0.08	1.10
7/17/12 11:00 AM	0.99	0.08	1.07
7/17/12 2:00 PM	0.99	0.08	1.07
7/17/12 5:00 PM	0.99	0.08	1.07
7/17/12 8:00 PM	1.00	0.08	1.08
7/17/12 11:00 PM	1.00	0.11	1.12
7/18/12 2:00 AM	0.31	0.11	0.42
7/18/12 5:00 AM	0.26	0.10	0.36
7/18/12 8:00 AM	0.29	0.10	0.39
7/18/12 11:00 AM	0.44	0.10	0.54
7/18/12 2:00 PM	0.53	0.09	0.63
7/18/12 5:00 PM	1.02	0.09	1.11
7/18/12 8:00 PM	0.99	0.09	1.08
7/18/12 11:00 PM	0.97	0.09	1.06
7/19/12 2:00 AM	0.66	0.08	0.75
7/19/12 5:00 AM	0.19	0.08	0.27
7/19/12 8:00 AM	0.17	0.08	0.26
7/19/12 11:00 AM	0.18	0.08	0.27
7/19/12 2:00 PM	0.20	0.09	0.29
7/19/12 5:00 PM	0.17	0.09	0.25
7/19/12 8:00 PM	0.20	0.09	0.29
7/19/12 11:00 PM	0.22	0.09	0.31

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
7/20/12 2:00 AM	0.19	0.09	0.28
7/20/12 5:00 AM	0.18	0.10	0.27
7/20/12 8:00 AM	0.16	0.10	0.26
7/20/12 11:00 AM	0.15	0.09	0.24
7/20/12 2:00 PM	0.15	0.09	0.24
7/20/12 5:00 PM	0.15	0.09	0.24
7/20/12 8:00 PM	0.14	0.09	0.23
7/20/12 11:00 PM	0.14	0.08	0.22
7/21/12 2:00 AM	0.14	0.08	0.22
7/21/12 5:00 AM	0.14	0.09	0.22
7/21/12 8:00 AM	0.13	0.08	0.21
7/21/12 11:00 AM	0.14	0.08	0.21
7/21/12 2:00 PM	0.14	0.08	0.22
7/21/12 5:00 PM	0.14	0.08	0.22
7/21/12 8:00 PM	0.13	0.09	0.21
7/21/12 11:00 PM	0.13	0.08	0.20
7/22/12 2:00 AM	0.12	0.07	0.19
7/22/12 5:00 AM	0.12	0.07	0.20
7/22/12 8:00 AM	0.13	0.07	0.20
7/22/12 11:00 AM	0.12	0.07	0.19
7/22/12 2:00 PM	0.12	0.07	0.19
7/22/12 5:00 PM	0.11	0.07	0.18
7/22/12 8:00 PM	0.11	0.07	0.18
7/22/12 11:00 PM	0.11	0.05	0.17
7/23/12 2:00 AM	0.11	0.04	0.14
7/23/12 5:00 AM	0.11	0.05	0.16
7/23/12 8:00 AM	0.14	0.07	0.21
7/23/12 11:00 AM	0.16	0.07	0.23
7/23/12 2:00 PM	0.17	0.10	0.27
7/23/12 5:00 PM	0.19	0.13	0.33
7/23/12 8:00 PM	0.25	0.10	0.35
7/23/12 11:00 PM	0.30	0.05	0.35
7/24/12 2:00 AM	0.35	0.04	0.39
7/24/12 5:00 AM	0.36	0.07	0.43
7/24/12 8:00 AM	0.80	0.12	0.91
7/24/12 11:00 AM	0.92	0.11	1.04
7/24/12 2:00 PM	0.92	0.18	1.10
7/24/12 5:00 PM	0.96	0.33	1.28
7/24/12 8:00 PM	0.91	0.31	1.22
7/24/12 11:00 PM	1.09	0.10	1.19
7/25/12 2:00 AM	0.34	0.12	0.45
7/25/12 5:00 AM	0.49	0.11	0.60
7/25/12 8:00 AM	1.12	0.12	1.24
7/25/12 11:00 AM	0.93	0.11	1.04
7/25/12 2:00 PM	0.78	0.11	0.89
7/25/12 5:00 PM	1.00	0.12	1.12
7/25/12 8:00 PM	0.96	0.13	1.09
7/25/12 11:00 PM	0.51	0.15	0.66
7/26/12 2:00 AM	0.57	0.16	0.74
7/26/12 5:00 AM	0.92	0.18	1.10
7/26/12 8:00 AM	0.84	0.18	1.02
7/26/12 11:00 AM	0.74	0.19	0.93
7/26/12 2:00 PM	0.89	0.19	1.09
7/26/12 5:00 PM	0.93	0.20	1.13

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
7/26/12 8:00 PM	0.88	0.20	1.09
7/26/12 11:00 PM	0.92	0.20	1.12
7/27/12 2:00 AM	0.70	0.19	0.89
7/27/12 5:00 AM	0.76	0.19	0.95
7/27/12 8:00 AM	0.53	0.19	0.71
7/27/12 11:00 AM	0.75	0.20	0.96
7/27/12 2:00 PM	0.46	0.22	0.68
7/27/12 5:00 PM	0.30	0.19	0.48
7/27/12 8:00 PM	0.31	0.20	0.51
7/27/12 11:00 PM	0.33	0.21	0.53
7/28/12 2:00 AM	0.64	0.15	0.79
7/28/12 5:00 AM	1.06	0.21	1.27
7/28/12 8:00 AM	0.74	0.21	0.95
7/28/12 11:00 AM	0.70	0.21	0.92
7/28/12 2:00 PM	0.59	0.21	0.80
7/28/12 5:00 PM	0.54	0.20	0.75
7/28/12 8:00 PM	0.96	0.19	1.16
7/28/12 11:00 PM	0.92	0.19	1.11
7/29/12 2:00 AM	0.91	0.19	1.10
7/29/12 5:00 AM	0.88	0.19	1.07
7/29/12 8:00 AM	0.68	0.19	0.87
7/29/12 11:00 AM	0.75	0.18	0.93
7/29/12 2:00 PM	0.74	0.17	0.91
7/29/12 5:00 PM	0.78	0.17	0.96
7/29/12 8:00 PM	0.73	0.18	0.90
7/29/12 11:00 PM	0.47	0.18	0.65
7/30/12 2:00 AM	0.42	0.17	0.59
7/30/12 5:00 AM	0.10	0.17	0.27
7/30/12 8:00 AM	0.46	0.17	0.63
7/30/12 11:00 AM	0.48	0.15	0.63
7/30/12 2:00 PM	0.19	0.12	0.31
7/30/12 5:00 PM	0.17	0.10	0.28
7/30/12 8:00 PM	0.36	0.09	0.45
7/30/12 11:00 PM	0.39	0.09	0.47
7/31/12 2:00 AM	0.37	0.08	0.45
7/31/12 5:00 AM	0.41	0.09	0.51
7/31/12 8:00 AM	0.33	0.10	0.43
7/31/12 11:00 AM	0.32	0.10	0.43
7/31/12 2:00 PM	0.31	0.10	0.41
7/31/12 5:00 PM	0.32	0.11	0.43
7/31/12 8:00 PM	0.34	0.11	0.45
7/31/12 11:00 PM	0.32	0.11	0.43
8/1/12 2:00 AM	0.31	0.11	0.42
8/1/12 5:00 AM	0.32	0.12	0.43
8/1/12 8:00 AM	0.29	0.12	0.40
8/1/12 11:00 AM	0.33	0.13	0.46
8/1/12 2:00 PM	0.32	0.13	0.45
8/1/12 5:00 PM	0.31	0.13	0.43
8/1/12 8:00 PM	0.35	0.13	0.48
8/1/12 11:00 PM	0.36	0.14	0.50
8/2/12 2:00 AM	0.32	0.14	0.46
8/2/12 5:00 AM	0.28	0.15	0.43
8/2/12 8:00 AM	0.30	0.15	0.45
8/2/12 11:00 AM	0.30	0.15	0.45

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
8/2/12 2:00 PM	0.29	0.15	0.45
8/2/12 5:00 PM	0.27	0.16	0.43
8/2/12 8:00 PM	0.29	0.17	0.46
8/2/12 11:00 PM	0.31	0.20	0.51
8/3/12 2:00 AM	0.14	0.38	0.53
8/3/12 5:00 AM	0.24	0.37	0.61
8/3/12 8:00 AM	0.33	0.37	0.70
8/3/12 11:00 AM	0.36	0.29	0.65
8/3/12 2:00 PM	0.36	0.16	0.51
8/3/12 5:00 PM	0.35	0.14	0.50
8/3/12 8:00 PM	0.34	0.14	0.48
8/3/12 11:00 PM	0.31	0.12	0.43
8/4/12 2:00 AM	0.37	0.13	0.50
8/4/12 5:00 AM	0.35	0.16	0.51
8/4/12 8:00 AM	0.33	0.17	0.49
8/4/12 11:00 AM	0.33	0.18	0.52
8/4/12 2:00 PM	0.32	0.18	0.51
8/4/12 5:00 PM	0.31	0.19	0.50
8/4/12 8:00 PM	0.35	0.19	0.54
8/4/12 11:00 PM	0.36	0.20	0.56
8/5/12 2:00 AM	0.39	0.20	0.59
8/5/12 5:00 AM	0.37	0.20	0.57
8/5/12 8:00 AM	0.37	0.21	0.59
8/5/12 11:00 AM	0.38	0.24	0.63
8/5/12 2:00 PM	0.42	0.24	0.66
8/5/12 5:00 PM	0.72	0.25	0.97
8/5/12 8:00 PM	0.99	0.26	1.25
8/5/12 11:00 PM	0.55	0.28	0.83
8/6/12 2:00 AM	0.75	0.28	1.04
8/6/12 5:00 AM	1.19	0.29	1.48
8/6/12 8:00 AM	1.12	0.28	1.40
8/6/12 11:00 AM	0.85	0.30	1.15
8/6/12 2:00 PM	0.34	0.30	0.64
8/6/12 5:00 PM	0.42	0.29	0.71
8/6/12 8:00 PM	0.46	0.29	0.75
8/6/12 11:00 PM	0.73	0.30	1.03
8/7/12 2:00 AM	0.85	0.29	1.15
8/7/12 5:00 AM	1.01	0.35	1.36
8/7/12 8:00 AM	1.29	0.35	1.64
8/7/12 11:00 AM	0.97	0.41	1.38
8/7/12 2:00 PM	0.38	0.48	0.86
8/7/12 5:00 PM	0.28	0.40	0.68
8/7/12 8:00 PM	0.28	0.39	0.67
8/7/12 11:00 PM	0.56	0.36	0.92
8/8/12 2:00 AM	0.92	0.33	1.25
8/8/12 5:00 AM	1.14	0.31	1.45
8/8/12 8:00 AM	1.54	0.28	1.82
8/8/12 11:00 AM	1.15	0.27	1.42
8/8/12 2:00 PM	0.99	0.27	1.26
8/8/12 5:00 PM	1.01	0.15	1.16
8/8/12 8:00 PM	0.92	0.11	1.03
8/8/12 11:00 PM	0.53	0.10	0.63
8/9/12 2:00 AM	0.68	0.10	0.78
8/9/12 5:00 AM	0.72	0.09	0.82

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
8/9/12 8:00 AM	0.94	0.08	1.03
8/9/12 11:00 AM	0.91	0.08	0.99
8/9/12 2:00 PM	0.84	0.09	0.93
8/9/12 5:00 PM	0.86	0.09	0.94
8/9/12 8:00 PM	0.88	0.08	0.96
8/9/12 11:00 PM	0.89	0.08	0.97
8/10/12 2:00 AM	0.90	0.08	0.98
8/10/12 5:00 AM	0.87	0.08	0.95
8/10/12 8:00 AM	0.91	0.08	0.99
8/10/12 11:00 AM	0.74	0.15	0.89
8/10/12 2:00 PM	0.26	0.10	0.36
8/10/12 5:00 PM	0.25	0.10	0.35
8/10/12 8:00 PM	0.68	0.08	0.76
8/10/12 11:00 PM	0.88	0.09	0.96
8/11/12 2:00 AM	0.90	0.10	1.00
8/11/12 5:00 AM	0.81	0.11	0.92
8/11/12 8:00 AM	0.84	0.16	0.99
8/11/12 11:00 AM	0.92	0.11	1.03
8/11/12 2:00 PM	0.79	0.09	0.88
8/11/12 5:00 PM	0.84	0.10	0.94
8/11/12 8:00 PM	0.84	0.13	0.97
8/11/12 11:00 PM	0.65	0.13	0.78
8/12/12 2:00 AM	0.40	0.13	0.53
8/12/12 5:00 AM	0.64	0.14	0.77
8/12/12 8:00 AM	0.87	0.16	1.02
8/12/12 11:00 AM	0.85	0.19	1.04
8/12/12 2:00 PM	0.84	0.19	1.03
8/12/12 5:00 PM	0.91	0.19	1.09
8/12/12 8:00 PM	0.98	0.17	1.15
8/12/12 11:00 PM	1.04	0.13	1.17
8/13/12 2:00 AM	0.92	0.14	1.06
8/13/12 5:00 AM	0.88	0.15	1.04
8/13/12 8:00 AM	0.84	0.20	1.04
8/13/12 11:00 AM	0.85	0.19	1.05
8/13/12 2:00 PM	0.89	0.18	1.07
8/13/12 5:00 PM	0.87	0.18	1.05
8/13/12 8:00 PM	0.95	0.18	1.12
8/13/12 11:00 PM	0.88	0.17	1.06
8/14/12 2:00 AM	0.86	0.17	1.04
8/14/12 5:00 AM	0.82	0.18	1.00
8/14/12 8:00 AM	0.65	0.17	0.82
8/14/12 11:00 AM	0.71	0.14	0.85
8/14/12 2:00 PM	0.63	0.00	0.63
8/14/12 5:00 PM	0.77	0.00	0.77
8/14/12 8:00 PM	0.49	0.00	0.49
8/14/12 11:00 PM	0.49	0.00	0.49
8/15/12 2:00 AM	0.83	0.00	0.83
8/15/12 5:00 AM	0.89	0.00	0.89
8/15/12 8:00 AM	0.92	0.00	0.92
8/15/12 11:00 AM	0.34	0.00	0.34
8/15/12 2:00 PM	0.87	0.00	0.87
8/15/12 5:00 PM	0.89	0.00	0.89
8/15/12 8:00 PM	0.88	0.00	0.88
8/15/12 11:00 PM	1.01	0.00	1.01

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
8/16/12 2:00 AM	1.04	0.00	1.04
8/16/12 5:00 AM	1.01	0.00	1.01
8/16/12 8:00 AM	1.02	0.00	1.02
8/16/12 11:00 AM	1.04	0.00	1.04
8/16/12 2:00 PM	0.97	0.00	0.97
8/16/12 5:00 PM	0.98	0.00	0.98
8/16/12 8:00 PM	0.98	0.00	0.98
8/16/12 11:00 PM	1.01	0.00	1.01
8/17/12 2:00 AM	1.02	0.00	1.02
8/17/12 5:00 AM	0.67	0.00	0.67
8/17/12 8:00 AM	0.96	0.00	0.96
8/17/12 11:00 AM	0.59	0.00	0.59
8/17/12 2:00 PM	0.63	0.00	0.63
8/17/12 5:00 PM	0.78	0.00	0.78
8/17/12 8:00 PM	0.95	0.00	0.95
8/17/12 11:00 PM	0.97	0.00	0.97
8/18/12 2:00 AM	1.02	0.00	1.02
8/18/12 5:00 AM	1.00	0.00	1.00
8/18/12 8:00 AM	0.95	0.00	0.95
8/18/12 11:00 AM	0.97	0.00	0.97
8/18/12 2:00 PM	0.85	0.05	0.89
8/18/12 5:00 PM	0.32	0.25	0.57
8/18/12 8:00 PM	0.20	0.49	0.69
8/18/12 11:00 PM	0.26	0.31	0.58
8/19/12 2:00 AM	0.25	0.26	0.51
8/19/12 5:00 AM	0.21	0.26	0.47
8/19/12 8:00 AM	0.34	0.12	0.47
8/19/12 11:00 AM	0.41	0.11	0.51
8/19/12 2:00 PM	0.28	0.10	0.38
8/19/12 5:00 PM	0.29	0.09	0.38
8/19/12 8:00 PM	0.29	0.09	0.38
8/19/12 11:00 PM	0.22	0.09	0.31
8/20/12 2:00 AM	0.19	0.10	0.28
8/20/12 5:00 AM	0.26	0.11	0.37
8/20/12 8:00 AM	0.29	0.12	0.41
8/20/12 11:00 AM	0.31	0.13	0.44
8/20/12 2:00 PM	0.31	0.16	0.47
8/20/12 5:00 PM	0.32	0.16	0.49
8/20/12 8:00 PM	0.30	0.17	0.48
8/20/12 11:00 PM	0.28	0.19	0.46
8/21/12 2:00 AM	0.29	0.19	0.48
8/21/12 5:00 AM	0.29	0.21	0.50
8/21/12 8:00 AM	0.30	0.22	0.52
8/21/12 11:00 AM	0.28	0.23	0.51
8/21/12 2:00 PM	0.29	0.23	0.51
8/21/12 5:00 PM	0.30	0.26	0.56
8/21/12 8:00 PM	0.29	0.26	0.56
8/21/12 11:00 PM	0.26	0.26	0.52
8/22/12 2:00 AM	0.28	0.38	0.67
8/22/12 5:00 AM	0.29	0.36	0.65
8/22/12 8:00 AM	0.30	0.35	0.65
8/22/12 11:00 AM	0.28	0.25	0.53
8/22/12 2:00 PM	0.30	0.24	0.54
8/22/12 5:00 PM	0.30	0.25	0.56

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
8/22/12 8:00 PM	0.27	0.27	0.54
8/22/12 11:00 PM	0.27	0.18	0.46
8/23/12 2:00 AM	0.24	0.07	0.31
8/23/12 5:00 AM	0.24	0.16	0.40
8/23/12 8:00 AM	0.28	0.35	0.62
8/23/12 11:00 AM	0.27	0.32	0.59
8/23/12 2:00 PM	0.28	0.29	0.58
8/23/12 5:00 PM	0.28	0.28	0.56
8/23/12 8:00 PM	0.27	0.28	0.55
8/23/12 11:00 PM	0.16	0.28	0.44
8/24/12 2:00 AM	0.29	0.29	0.58
8/24/12 5:00 AM	0.29	0.29	0.59
8/24/12 8:00 AM	0.30	0.29	0.59
8/24/12 11:00 AM	0.31	0.29	0.59
8/24/12 2:00 PM	0.29	0.29	0.58
8/24/12 5:00 PM	0.27	0.28	0.55
8/24/12 8:00 PM	0.27	0.29	0.56
8/24/12 11:00 PM	0.30	0.29	0.58
8/25/12 2:00 AM	0.31	0.30	0.61
8/25/12 5:00 AM	0.30	0.30	0.60
8/25/12 8:00 AM	0.32	0.30	0.62
8/25/12 11:00 AM	0.36	0.31	0.67
8/25/12 2:00 PM	0.78	0.30	1.08
8/25/12 5:00 PM	1.12	0.29	1.41
8/25/12 8:00 PM	1.22	0.29	1.51
8/25/12 11:00 PM	1.05	0.29	1.34
8/26/12 2:00 AM	0.76	0.23	0.99
8/26/12 5:00 AM	0.59	0.21	0.79
8/26/12 8:00 AM	0.99	0.25	1.24
8/26/12 11:00 AM	1.31	0.27	1.58
8/26/12 2:00 PM	1.18	0.27	1.45
8/26/12 5:00 PM	0.79	0.26	1.04
8/26/12 8:00 PM	0.81	0.26	1.07
8/26/12 11:00 PM	0.89	0.25	1.14
8/27/12 2:00 AM	0.93	0.21	1.14
8/27/12 5:00 AM	0.93	0.22	1.14
8/27/12 8:00 AM	0.88	0.23	1.11
8/27/12 11:00 AM	0.93	0.22	1.15
8/27/12 2:00 PM	0.90	0.21	1.11
8/27/12 5:00 PM	0.95	0.21	1.16
8/27/12 8:00 PM	1.25	0.21	1.46
8/27/12 11:00 PM	1.06	0.20	1.26
8/28/12 2:00 AM	1.11	0.20	1.31
8/28/12 5:00 AM	1.03	0.20	1.24
8/28/12 8:00 AM	1.15	0.21	1.36
8/28/12 11:00 AM	1.12	0.20	1.33
8/28/12 2:00 PM	0.93	0.20	1.14
8/28/12 5:00 PM	0.95	0.19	1.14
8/28/12 8:00 PM	0.98	0.19	1.17
8/28/12 11:00 PM	0.82	0.20	1.02
8/29/12 2:00 AM	0.68	0.19	0.87
8/29/12 5:00 AM	0.53	0.19	0.72
8/29/12 8:00 AM	1.07	0.19	1.26
8/29/12 11:00 AM	0.56	0.19	0.76

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
8/29/12 2:00 PM	1.11	0.19	1.30
8/29/12 5:00 PM	1.10	0.19	1.29
8/29/12 8:00 PM	1.24	0.20	1.43
8/29/12 11:00 PM	0.99	0.19	1.19
8/30/12 2:00 AM	0.83	0.19	1.02
8/30/12 5:00 AM	0.95	0.19	1.14
8/30/12 8:00 AM	1.08	0.20	1.28
8/30/12 11:00 AM	1.21	0.23	1.44
8/30/12 2:00 PM	0.82	0.23	1.05
8/30/12 5:00 PM	0.88	0.20	1.08
8/30/12 8:00 PM	0.90	0.20	1.10
8/30/12 11:00 PM	0.80	0.20	1.00
8/31/12 2:00 AM	0.65	0.21	0.86
8/31/12 5:00 AM	0.54	0.21	0.74
8/31/12 8:00 AM	0.65	0.21	0.87
8/31/12 11:00 AM	0.81	0.21	1.02
8/31/12 2:00 PM	1.06	0.21	1.27
8/31/12 5:00 PM	1.05	0.22	1.27
8/31/12 8:00 PM	0.94	0.21	1.15
8/31/12 11:00 PM	0.97	0.18	1.15
9/1/12 2:00 AM	1.01	0.21	1.22
9/1/12 5:00 AM	0.99	0.23	1.22
9/1/12 8:00 AM	0.91	0.24	1.15
9/1/12 11:00 AM	0.26	0.23	0.50
9/1/12 2:00 PM	0.26	0.22	0.47
9/1/12 5:00 PM	0.69	0.22	0.91
9/1/12 8:00 PM	0.94	0.22	1.16
9/1/12 11:00 PM	1.02	0.22	1.24
9/2/12 2:00 AM	0.86	0.23	1.10
9/2/12 5:00 AM	1.07	0.24	1.31
9/2/12 8:00 AM	1.07	0.24	1.31
9/2/12 11:00 AM	1.03	0.24	1.27
9/2/12 2:00 PM	1.01	0.24	1.25
9/2/12 5:00 PM	0.94	0.25	1.19
9/2/12 8:00 PM	1.03	0.26	1.29
9/2/12 11:00 PM	1.05	0.25	1.30
9/3/12 2:00 AM	0.89	0.25	1.15
9/3/12 5:00 AM	0.53	0.26	0.79
9/3/12 8:00 AM	0.78	0.26	1.04
9/3/12 11:00 AM	0.85	0.26	1.11
9/3/12 2:00 PM	0.86	0.25	1.11
9/3/12 5:00 PM	0.86	0.25	1.11
9/3/12 8:00 PM	0.92	0.27	1.18
9/3/12 11:00 PM	0.94	0.26	1.20
9/4/12 2:00 AM	0.98	0.26	1.24
9/4/12 5:00 AM	0.96	0.25	1.21
9/4/12 8:00 AM	0.92	0.26	1.17
9/4/12 11:00 AM	0.22	0.26	0.48
9/4/12 2:00 PM	0.22	0.24	0.46
9/4/12 5:00 PM	0.15	0.24	0.39
9/4/12 8:00 PM	0.15	0.25	0.39
9/4/12 11:00 PM	0.18	0.24	0.42
9/5/12 2:00 AM	0.17	0.24	0.41
9/5/12 5:00 AM	0.21	0.23	0.44

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
9/5/12 8:00 AM	0.24	0.22	0.46
9/5/12 11:00 AM	0.24	0.21	0.45
9/5/12 2:00 PM	0.23	0.20	0.43
9/5/12 5:00 PM	0.23	0.19	0.43
9/5/12 8:00 PM	0.21	0.19	0.40
9/5/12 11:00 PM	0.20	0.19	0.38
9/6/12 2:00 AM	0.20	0.20	0.40
9/6/12 5:00 AM	0.19	0.36	0.55
9/6/12 8:00 AM	0.22	0.37	0.59
9/6/12 11:00 AM	0.22	0.41	0.63
9/6/12 2:00 PM	0.22	0.30	0.52
9/6/12 5:00 PM	0.22	0.20	0.42
9/6/12 8:00 PM	0.22	0.19	0.41
9/6/12 11:00 PM	0.22	0.21	0.43
9/7/12 2:00 AM	0.20	0.22	0.42
9/7/12 5:00 AM	0.18	0.24	0.42
9/7/12 8:00 AM	0.19	0.25	0.44
9/7/12 11:00 AM	0.19	0.27	0.46
9/7/12 2:00 PM	0.18	0.30	0.48
9/7/12 5:00 PM	0.18	0.29	0.47
9/7/12 8:00 PM	0.20	0.24	0.44
9/7/12 11:00 PM	0.20	0.22	0.42
9/8/12 2:00 AM	0.20	0.20	0.40
9/8/12 5:00 AM	0.19	0.21	0.41
9/8/12 8:00 AM	0.21	0.21	0.42
9/8/12 11:00 AM	0.23	0.21	0.44
9/8/12 2:00 PM	0.23	0.20	0.43
9/8/12 5:00 PM	0.24	0.20	0.44
9/8/12 8:00 PM	0.52	0.21	0.73
9/8/12 11:00 PM	1.06	0.20	1.26
9/9/12 2:00 AM	1.04	0.21	1.24
9/9/12 5:00 AM	1.03	0.21	1.25
9/9/12 8:00 AM	0.96	0.22	1.18
9/9/12 11:00 AM	0.93	0.22	1.15
9/9/12 2:00 PM	0.92	0.22	1.15
9/9/12 5:00 PM	0.91	0.24	1.14
9/9/12 8:00 PM	0.97	0.24	1.21
9/9/12 11:00 PM	0.77	0.25	1.02
9/10/12 2:00 AM	0.73	0.25	0.98
9/10/12 5:00 AM	0.74	0.25	0.99
9/10/12 8:00 AM	0.75	0.24	0.99
9/10/12 11:00 AM	0.76	0.24	1.00
9/10/12 2:00 PM	0.72	0.23	0.95
9/10/12 5:00 PM	0.83	0.24	1.06
9/10/12 8:00 PM	0.80	0.24	1.04
9/10/12 11:00 PM	0.45	0.24	0.69
9/11/12 2:00 AM	0.27	0.26	0.53
9/11/12 5:00 AM	0.76	0.27	1.03
9/11/12 8:00 AM	1.04	0.27	1.31
9/11/12 11:00 AM	0.29	0.27	0.56
9/11/12 2:00 PM	0.27	0.27	0.53
9/11/12 5:00 PM	0.27	0.27	0.55
9/11/12 8:00 PM	0.39	0.26	0.66
9/11/12 11:00 PM	0.76	0.25	1.02

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
9/12/12 2:00 AM	0.74	0.24	0.98
9/12/12 5:00 AM	0.87	0.25	1.12
9/12/12 8:00 AM	0.88	0.25	1.13
9/12/12 11:00 AM	0.81	0.25	1.06
9/12/12 2:00 PM	0.87	0.24	1.11
9/12/12 5:00 PM	0.76	0.25	1.01
9/12/12 8:00 PM	0.48	0.25	0.72
9/12/12 11:00 PM	0.67	0.28	0.94
9/13/12 2:00 AM	1.09	0.29	1.38
9/13/12 5:00 AM	1.04	0.30	1.34
9/13/12 8:00 AM	1.16	0.54	1.70
9/13/12 11:00 AM	1.02	0.96	1.98
9/13/12 2:00 PM	1.03	0.94	1.96
9/13/12 5:00 PM	1.07	0.76	1.82
9/13/12 8:00 PM	0.78	0.32	1.10
9/13/12 11:00 PM	0.39	0.28	0.68
9/14/12 2:00 AM	0.41	0.28	0.69
9/14/12 5:00 AM	0.46	0.27	0.73
9/14/12 8:00 AM	0.50	0.26	0.76
9/14/12 11:00 AM	0.43	0.26	0.69
9/14/12 2:00 PM	0.48	0.27	0.75
9/14/12 5:00 PM	0.54	0.26	0.80
9/14/12 8:00 PM	0.40	0.25	0.65
9/14/12 11:00 PM	0.19	0.26	0.46
9/15/12 2:00 AM	0.18	0.20	0.38
9/15/12 5:00 AM	0.19	0.25	0.44
9/15/12 8:00 AM	0.24	0.24	0.47
9/15/12 11:00 AM	0.24	0.24	0.48
9/15/12 2:00 PM	0.22	0.25	0.47
9/15/12 5:00 PM	0.23	0.27	0.50
9/15/12 8:00 PM	0.24	0.28	0.52
9/15/12 11:00 PM	0.25	0.30	0.55
9/16/12 2:00 AM	0.21	0.31	0.53
9/16/12 5:00 AM	0.22	0.31	0.52
9/16/12 8:00 AM	0.25	0.31	0.56
9/16/12 11:00 AM	0.27	0.30	0.57
9/16/12 2:00 PM	0.25	0.29	0.54
9/16/12 5:00 PM	0.25	0.30	0.55
9/16/12 8:00 PM	0.27	0.30	0.57
9/16/12 11:00 PM	0.26	0.31	0.58
9/17/12 2:00 AM	0.29	0.48	0.77
9/17/12 5:00 AM	0.26	0.35	0.61
9/17/12 8:00 AM	0.30	0.51	0.81
9/17/12 11:00 AM	0.28	0.32	0.61
9/17/12 2:00 PM	0.29	0.32	0.62
9/17/12 5:00 PM	0.30	0.33	0.64
9/17/12 8:00 PM	0.30	0.33	0.62
9/17/12 11:00 PM	0.29	0.31	0.60
9/18/12 2:00 AM	0.57	0.32	0.89
9/18/12 5:00 AM	1.03	0.32	1.35
9/18/12 8:00 AM	1.21	0.30	1.51
9/18/12 11:00 AM	1.07	0.28	1.35
9/18/12 2:00 PM	1.07	0.29	1.36
9/18/12 5:00 PM	0.95	0.27	1.22

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
9/18/12 8:00 PM	0.94	0.25	1.18
9/18/12 11:00 PM	0.93	0.09	1.02
9/19/12 2:00 AM	0.79	0.01	0.80
9/19/12 5:00 AM	0.85	0.01	0.87
9/19/12 8:00 AM	0.98	0.01	1.00
9/19/12 11:00 AM	0.97	0.01	0.98
9/19/12 2:00 PM	0.64	0.01	0.66
9/19/12 5:00 PM	0.37	0.02	0.38
9/19/12 8:00 PM	0.53	0.24	0.78
9/19/12 11:00 PM	1.00	0.20	1.20
9/20/12 2:00 AM	1.03	0.15	1.18
9/20/12 5:00 AM	1.04	0.16	1.20
9/20/12 8:00 AM	0.98	0.17	1.15
9/20/12 11:00 AM	1.12	0.16	1.28
9/20/12 2:00 PM	1.13	0.33	1.46
9/20/12 5:00 PM	1.09	0.37	1.46
9/20/12 8:00 PM	0.50	0.27	0.76
9/20/12 11:00 PM	0.94	0.22	1.16
9/21/12 2:00 AM	1.03	0.19	1.22
9/21/12 5:00 AM	1.01	0.17	1.18
9/21/12 8:00 AM	1.14	0.17	1.31
9/21/12 11:00 AM	0.94	0.19	1.13
9/21/12 2:00 PM	0.48	0.21	0.69
9/21/12 5:00 PM	0.86	0.23	1.08
9/21/12 8:00 PM	1.00	0.28	1.28
9/21/12 11:00 PM	0.92	0.20	1.12
9/22/12 2:00 AM	0.58	0.28	0.86
9/22/12 5:00 AM	0.61	0.33	0.94
9/22/12 8:00 AM	0.95	0.34	1.29
9/22/12 11:00 AM	0.44	0.36	0.80
9/22/12 2:00 PM	0.30	0.34	0.63
9/22/12 5:00 PM	0.29	0.33	0.62
9/22/12 8:00 PM	0.37	0.32	0.69
9/22/12 11:00 PM	0.37	0.22	0.59
9/23/12 2:00 AM	0.27	0.12	0.39
9/23/12 5:00 AM	0.28	0.11	0.39
9/23/12 8:00 AM	0.30	0.25	0.55
9/23/12 11:00 AM	0.26	0.27	0.53
9/23/12 2:00 PM	0.25	0.32	0.57
9/23/12 5:00 PM	0.23	0.26	0.49
9/23/12 8:00 PM	0.24	0.23	0.47
9/23/12 11:00 PM	0.23	0.12	0.35
9/24/12 2:00 AM	0.42	0.11	0.54
9/24/12 5:00 AM	0.73	0.12	0.85
9/24/12 8:00 AM	0.53	0.26	0.79
9/24/12 11:00 AM	0.50	0.24	0.75
9/24/12 2:00 PM	0.16	0.24	0.40
9/24/12 5:00 PM	0.04	0.24	0.28
9/24/12 8:00 PM	0.18	0.24	0.42
9/24/12 11:00 PM	0.25	0.24	0.49
9/25/12 2:00 AM	0.29	0.25	0.54
9/25/12 5:00 AM	0.19	0.23	0.42
9/25/12 8:00 AM	0.22	0.23	0.45
9/25/12 11:00 AM	0.21	0.23	0.44

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
9/25/12 2:00 PM	0.21	0.25	0.45
9/25/12 5:00 PM	0.20	0.30	0.50
9/25/12 8:00 PM	0.19	0.28	0.47
9/25/12 11:00 PM	0.21	0.29	0.50
9/26/12 2:00 AM	0.11	0.30	0.41
9/26/12 5:00 AM	0.14	0.30	0.44
9/26/12 8:00 AM	0.22	0.30	0.52
9/26/12 11:00 AM	0.24	0.46	0.70
9/26/12 2:00 PM	0.24	0.37	0.61
9/26/12 5:00 PM	0.21	0.35	0.56
9/26/12 8:00 PM	0.24	0.32	0.56
9/26/12 11:00 PM	0.25	0.24	0.48
9/27/12 2:00 AM	0.25	0.23	0.48
9/27/12 5:00 AM	0.25	0.25	0.50
9/27/12 8:00 AM	0.27	0.27	0.54
9/27/12 11:00 AM	0.28	0.14	0.42
9/27/12 2:00 PM	0.28	0.18	0.46
9/27/12 5:00 PM	0.24	0.42	0.67
9/27/12 8:00 PM	0.24	0.42	0.67
9/27/12 11:00 PM	0.23	0.38	0.61
9/28/12 2:00 AM	0.23	0.41	0.64
9/28/12 5:00 AM	0.26	0.40	0.65
9/28/12 8:00 AM	0.27	0.53	0.79
9/28/12 11:00 AM	0.29	0.56	0.85
9/28/12 2:00 PM	0.27	0.39	0.66
9/28/12 5:00 PM	0.23	0.34	0.56
9/28/12 8:00 PM	0.26	0.34	0.60
9/28/12 11:00 PM	0.28	0.33	0.61
9/29/12 2:00 AM	0.27	0.32	0.58
9/29/12 5:00 AM	0.27	0.33	0.60
9/29/12 8:00 AM	0.28	0.37	0.64
9/29/12 11:00 AM	0.28	0.36	0.64
9/29/12 2:00 PM	0.27	0.38	0.65
9/29/12 5:00 PM	0.26	0.39	0.65
9/29/12 8:00 PM	0.29	0.40	0.69
9/29/12 11:00 PM	0.29	0.50	0.79
9/30/12 2:00 AM	0.30	0.29	0.59
9/30/12 5:00 AM	0.28	0.33	0.61
9/30/12 8:00 AM	0.26	0.38	0.64
9/30/12 11:00 AM	0.26	0.42	0.67
9/30/12 2:00 PM	0.26	0.44	0.70
9/30/12 5:00 PM	0.30	0.44	0.74
9/30/12 8:00 PM	0.51	0.41	0.92
9/30/12 11:00 PM	0.52	0.40	0.92
10/1/12 2:00 AM	0.52	0.41	0.93
10/1/12 5:00 AM	0.50	0.42	0.92
10/1/12 8:00 AM	0.50	0.43	0.93
10/1/12 11:00 AM	0.45	0.42	0.87
10/1/12 2:00 PM	0.46	0.36	0.82
10/1/12 5:00 PM	0.48	0.35	0.83
10/1/12 8:00 PM	0.81	0.36	1.17
10/1/12 11:00 PM	0.84	0.37	1.21
10/2/12 2:00 AM	0.76	0.34	1.11
10/2/12 5:00 AM	0.89	0.36	1.25

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
10/2/12 8:00 AM	1.08	0.37	1.45
10/2/12 11:00 AM	0.93	0.37	1.30
10/2/12 2:00 PM	0.92	0.25	1.16
10/2/12 5:00 PM	1.00	0.23	1.24
10/2/12 8:00 PM	0.99	0.22	1.22
10/2/12 11:00 PM	1.09	0.22	1.31
10/3/12 2:00 AM	0.87	0.21	1.08
10/3/12 5:00 AM	0.58	0.23	0.81
10/3/12 8:00 AM	0.22	0.17	0.39
10/3/12 11:00 AM	0.29	0.18	0.47
10/3/12 2:00 PM	0.28	0.18	0.46
10/3/12 5:00 PM	0.28	0.18	0.46
10/3/12 8:00 PM	0.28	0.18	0.46
10/3/12 11:00 PM	0.28	0.21	0.49
10/4/12 2:00 AM	0.77	0.24	1.01
10/4/12 5:00 AM	1.09	0.28	1.38
10/4/12 8:00 AM	0.34	0.32	0.66
10/4/12 11:00 AM	0.41	0.34	0.75
10/4/12 2:00 PM	0.41	0.41	0.82
10/4/12 5:00 PM	0.41	0.39	0.80
10/4/12 8:00 PM	0.43	0.44	0.87
10/4/12 11:00 PM	0.41	0.40	0.81
10/5/12 2:00 AM	1.03	0.41	1.45
10/5/12 5:00 AM	1.26	0.41	1.67
10/5/12 8:00 AM	0.86	0.38	1.23
10/5/12 11:00 AM	0.65	0.37	1.02
10/5/12 2:00 PM	0.52	0.28	0.80
10/5/12 5:00 PM	0.50	0.23	0.73
10/5/12 8:00 PM	0.45	0.21	0.66
10/5/12 11:00 PM	0.47	0.19	0.66
10/6/12 2:00 AM	0.43	0.13	0.56
10/6/12 5:00 AM	0.46	0.11	0.57
10/6/12 8:00 AM	0.55	0.16	0.71
10/6/12 11:00 AM	0.60	0.17	0.77
10/6/12 2:00 PM	0.57	0.17	0.74
10/6/12 5:00 PM	0.57	0.18	0.75
10/6/12 8:00 PM	0.56	0.18	0.74
10/6/12 11:00 PM	0.47	0.02	0.50
10/7/12 2:00 AM	0.48	0.00	0.48
10/7/12 5:00 AM	0.54	0.00	0.54
10/7/12 8:00 AM	0.55	0.00	0.55
10/7/12 11:00 AM	0.59	0.00	0.59
10/7/12 2:00 PM	0.66	0.00	0.66
10/7/12 5:00 PM	0.62	0.00	0.62
10/7/12 8:00 PM	0.63	0.00	0.63
10/7/12 11:00 PM	0.62	0.00	0.62
10/8/12 2:00 AM	0.57	0.00	0.57
10/8/12 5:00 AM	0.45	0.00	0.45
10/8/12 8:00 AM	1.06	0.00	1.06
10/8/12 11:00 AM	1.22	0.00	1.22
10/8/12 2:00 PM	1.13	0.00	1.13
10/8/12 5:00 PM	1.03	0.00	1.03
10/8/12 8:00 PM	1.02	0.00	1.02
10/8/12 11:00 PM	0.98	0.00	0.98

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
10/9/12 2:00 AM	1.01	0.00	1.01
10/9/12 5:00 AM	1.07	0.00	1.07
10/9/12 8:00 AM	1.14	0.03	1.17
10/9/12 11:00 AM	0.80	0.22	1.02
10/9/12 2:00 PM	0.26	0.29	0.55
10/9/12 5:00 PM	0.29	0.29	0.59
10/9/12 8:00 PM	0.42	0.29	0.71
10/9/12 11:00 PM	0.30	0.28	0.58
10/10/12 2:00 AM	0.30	0.29	0.59
10/10/12 5:00 AM	0.30	0.29	0.58
10/10/12 8:00 AM	0.30	0.19	0.49
10/10/12 11:00 AM	0.27	0.18	0.46
10/10/12 2:00 PM	0.25	0.18	0.43
10/10/12 5:00 PM	0.24	0.18	0.42
10/10/12 8:00 PM	0.28	0.18	0.46
10/10/12 11:00 PM	6.12	0.18	6.30
10/11/12 2:00 AM	0.69	0.18	0.87
10/11/12 5:00 AM	0.63	0.18	0.81
10/11/12 8:00 AM	0.35	0.19	0.53
10/11/12 11:00 AM	0.35	0.14	0.50
10/11/12 2:00 PM	0.32	0.11	0.43
10/11/12 5:00 PM	0.35	0.12	0.46
10/11/12 8:00 PM	0.37	0.13	0.50
10/11/12 11:00 PM	0.40	0.13	0.53
10/12/12 2:00 AM	0.41	0.16	0.57
10/12/12 5:00 AM	1.02	0.16	1.19
10/12/12 8:00 AM	0.35	0.14	0.49
10/12/12 11:00 AM	0.52	0.14	0.66
10/12/12 2:00 PM	0.26	0.14	0.40
10/12/12 5:00 PM	0.25	0.13	0.38
10/12/12 8:00 PM	0.45	0.11	0.56
10/12/12 11:00 PM	0.27	0.06	0.33
10/13/12 2:00 AM	0.55	0.06	0.61
10/13/12 5:00 AM	1.04	0.07	1.11
10/13/12 8:00 AM	1.19	0.07	1.26
10/13/12 11:00 AM	0.98	0.10	1.08
10/13/12 2:00 PM	0.55	0.09	0.64
10/13/12 5:00 PM	0.27	0.08	0.35
10/13/12 8:00 PM	0.27	0.09	0.36
10/13/12 11:00 PM	0.82	0.09	0.92
10/14/12 2:00 AM	1.00	0.09	1.09
10/14/12 5:00 AM	0.73	0.10	0.84
10/14/12 8:00 AM	0.93	0.12	1.05
10/14/12 11:00 AM	0.33	0.12	0.45
10/14/12 2:00 PM	0.29	0.12	0.41
10/14/12 5:00 PM	0.27	0.28	0.55
10/14/12 8:00 PM	0.27	0.27	0.54
10/14/12 11:00 PM	0.58	0.25	0.83
10/15/12 2:00 AM	0.68	0.18	0.86
10/15/12 5:00 AM	0.57	0.20	0.77
10/15/12 8:00 AM	0.27	0.26	0.53
10/15/12 11:00 AM	0.28	0.23	0.50
10/15/12 2:00 PM	0.28	0.23	0.51
10/15/12 5:00 PM	0.27	0.79	1.06

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
10/15/12 8:00 PM	0.26	0.22	0.48
10/15/12 11:00 PM	0.24	0.14	0.38
10/16/12 2:00 AM	0.77	0.08	0.85
10/16/12 5:00 AM	0.73	0.10	0.83
10/16/12 8:00 AM	0.22	0.28	0.50
10/16/12 11:00 AM	0.26	0.57	0.82
10/16/12 2:00 PM	0.25	0.13	0.37
10/16/12 5:00 PM	0.23	0.09	0.32
10/16/12 8:00 PM	0.27	0.07	0.34
10/16/12 11:00 PM	0.67	0.06	0.73
10/17/12 2:00 AM	0.35	0.06	0.41
10/17/12 5:00 AM	0.63	0.07	0.69
10/17/12 8:00 AM	0.58	0.08	0.66
10/17/12 11:00 AM	0.32	0.08	0.40
10/17/12 2:00 PM	0.31	0.09	0.40
10/17/12 5:00 PM	0.26	0.12	0.38
10/17/12 8:00 PM	0.28	0.12	0.40
10/17/12 11:00 PM	0.47	0.12	0.59
10/18/12 2:00 AM	0.35	0.08	0.43
10/18/12 5:00 AM	0.59	0.06	0.65
10/18/12 8:00 AM	0.69	0.17	0.86
10/18/12 11:00 AM	0.26	0.17	0.42
10/18/12 2:00 PM	0.26	0.16	0.41
10/18/12 5:00 PM	0.27	0.15	0.42
10/18/12 8:00 PM	0.27	0.16	0.43
10/18/12 11:00 PM	0.63	0.17	0.79
10/19/12 2:00 AM	0.46	0.12	0.58
10/19/12 5:00 AM	0.68	0.13	0.81
10/19/12 8:00 AM	0.62	0.20	0.81
10/19/12 11:00 AM	0.25	0.26	0.51
10/19/12 2:00 PM	0.25	0.27	0.52
10/19/12 5:00 PM	0.24	0.28	0.52
10/19/12 8:00 PM	0.25	0.26	0.52
10/19/12 11:00 PM	0.23	0.24	0.47
10/20/12 2:00 AM	0.65	0.12	0.77
10/20/12 5:00 AM	0.72	0.15	0.86
10/20/12 8:00 AM	0.59	0.16	0.76
10/20/12 11:00 AM	0.36	0.30	0.66
10/20/12 2:00 PM	0.32	0.31	0.63
10/20/12 5:00 PM	0.30	0.30	0.60
10/20/12 8:00 PM	0.29	0.28	0.58
10/20/12 11:00 PM	0.70	0.23	0.94
10/21/12 2:00 AM	0.33	0.19	0.52
10/21/12 5:00 AM	0.24	0.18	0.43
10/21/12 8:00 AM	0.49	0.11	0.60
10/21/12 11:00 AM	0.40	0.09	0.49
10/21/12 2:00 PM	0.27	0.24	0.51
10/21/12 5:00 PM	0.26	0.29	0.56
10/21/12 8:00 PM	0.36	0.30	0.65
10/21/12 11:00 PM	0.60	0.23	0.83
10/22/12 2:00 AM	0.31	0.16	0.48
10/22/12 5:00 AM	0.31	0.22	0.52
10/22/12 8:00 AM	0.65	0.35	0.99
10/22/12 11:00 AM	0.56	0.40	0.97

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
10/22/12 2:00 PM	0.30	0.39	0.69
10/22/12 5:00 PM	0.35	0.36	0.71
10/22/12 8:00 PM	0.39	0.34	0.73
10/22/12 11:00 PM	0.75	0.35	1.10
10/23/12 2:00 AM	0.29	0.25	0.54
10/23/12 5:00 AM	0.38	0.24	0.62
10/23/12 8:00 AM	1.10	0.34	1.44
10/23/12 11:00 AM	0.86	0.32	1.18
10/23/12 2:00 PM	0.30	0.33	0.63
10/23/12 5:00 PM	0.32	0.34	0.66
10/23/12 8:00 PM	0.32	0.35	0.67
10/23/12 11:00 PM	0.54	0.27	0.80
10/24/12 2:00 AM	0.34	0.32	0.66
10/24/12 5:00 AM	0.49	0.21	0.70
10/24/12 8:00 AM	1.17	0.36	1.53
10/24/12 11:00 AM	0.37	0.34	0.72
10/24/12 2:00 PM	0.36	0.33	0.69
10/24/12 5:00 PM	0.38	0.33	0.71
10/24/12 8:00 PM	0.39	0.34	0.73
10/24/12 11:00 PM	0.37	0.06	0.43
10/25/12 2:00 AM	0.83	0.02	0.85
10/25/12 5:00 AM	0.89	0.03	0.92
10/25/12 8:00 AM	0.58	0.39	0.98
10/25/12 11:00 AM	0.22	0.39	0.62
10/25/12 2:00 PM	0.10	0.40	0.49
10/25/12 5:00 PM	0.26	0.39	0.66
10/25/12 8:00 PM	0.33	0.39	0.72
10/25/12 11:00 PM	0.38	0.40	0.78
10/26/12 2:00 AM	0.43	0.31	0.74
10/26/12 5:00 AM	0.91	0.33	1.24
10/26/12 8:00 AM	0.43	0.42	0.85
10/26/12 11:00 AM	0.41	0.41	0.82
10/26/12 2:00 PM	0.38	0.40	0.78
10/26/12 5:00 PM	0.41	0.38	0.79
10/26/12 8:00 PM	0.40	0.36	0.76
10/26/12 11:00 PM	0.38	0.33	0.71
10/27/12 2:00 AM	1.05	0.34	1.39
10/27/12 5:00 AM	0.93	0.33	1.27
10/27/12 8:00 AM	0.96	0.38	1.34
10/27/12 11:00 AM	0.36	0.38	0.75
10/27/12 2:00 PM	0.38	0.40	0.78
10/27/12 5:00 PM	0.41	0.39	0.80
10/27/12 8:00 PM	0.42	0.37	0.80
10/27/12 11:00 PM	0.88	0.27	1.14
10/28/12 2:00 AM	0.48	0.20	0.68
10/28/12 5:00 AM	0.38	0.20	0.58
10/28/12 8:00 AM	0.98	0.24	1.21
10/28/12 11:00 AM	0.53	0.37	0.90
10/28/12 2:00 PM	0.45	0.36	0.81
10/28/12 5:00 PM	0.43	0.37	0.80
10/28/12 8:00 PM	0.42	0.36	0.79
10/28/12 11:00 PM	0.60	0.33	0.93
10/29/12 2:00 AM	0.29	0.27	0.56
10/29/12 5:00 AM	0.81	0.28	1.08

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
10/29/12 8:00 AM	0.79	0.38	1.17
10/29/12 11:00 AM	1.06	0.38	1.44
10/29/12 2:00 PM	0.96	0.37	1.33
10/29/12 5:00 PM	0.36	0.38	0.74
10/29/12 8:00 PM	0.33	0.36	0.70
10/29/12 11:00 PM	0.39	0.28	0.67
10/30/12 2:00 AM	0.19	0.21	0.41
10/30/12 5:00 AM	0.48	0.26	0.74
10/30/12 8:00 AM	0.81	0.33	1.14
10/30/12 11:00 AM	1.17	0.34	1.51
10/30/12 2:00 PM	1.21	0.35	1.56
10/30/12 5:00 PM	0.58	0.37	0.95
10/30/12 8:00 PM	0.30	0.36	0.66
10/30/12 11:00 PM	0.35	0.36	0.71
10/31/12 2:00 AM	0.86	0.35	1.22
10/31/12 5:00 AM	1.01	0.36	1.36
10/31/12 8:00 AM	1.07	0.35	1.42
10/31/12 11:00 AM	1.12	0.36	1.48
10/31/12 2:00 PM	1.12	0.35	1.47
10/31/12 5:00 PM	0.94	0.39	1.33
10/31/12 8:00 PM	0.95	0.42	1.37
10/31/12 11:00 PM	1.01	0.41	1.42
11/1/12 2:00 AM	0.56	0.43	0.98
11/1/12 5:00 AM	0.37	0.47	0.84
11/1/12 8:00 AM	0.57	0.44	1.02
11/1/12 11:00 AM	0.99	0.42	1.41
11/1/12 2:00 PM	0.87	0.44	1.30
11/1/12 5:00 PM	0.51	0.28	0.79
11/1/12 8:00 PM	0.39	0.29	0.68
11/1/12 11:00 PM	0.40	0.28	0.68
11/2/12 2:00 AM	0.41	0.29	0.70
11/2/12 5:00 AM	0.41	0.28	0.69
11/2/12 8:00 AM	0.31	0.28	0.59
11/2/12 11:00 AM	0.25	0.26	0.51
11/2/12 2:00 PM	0.26	0.23	0.49
11/2/12 5:00 PM	0.27	0.22	0.49
11/2/12 8:00 PM	0.24	0.20	0.44
11/2/12 11:00 PM	0.12	0.20	0.32
11/3/12 2:00 AM	0.12	0.11	0.23
11/3/12 5:00 AM	0.14	0.13	0.27
11/3/12 8:00 AM	0.26	0.20	0.46
11/3/12 11:00 AM	0.25	0.19	0.44
11/3/12 2:00 PM	0.25	0.18	0.43
11/3/12 5:00 PM	0.26	0.17	0.43
11/3/12 8:00 PM	0.25	0.17	0.41
11/3/12 11:00 PM	0.25	0.16	0.42
11/4/12 2:00 AM	0.26	0.16	0.43
11/4/12 5:00 AM	0.24	0.18	0.42
11/4/12 8:00 AM	0.13	0.18	0.31
11/4/12 11:00 AM	0.12	0.17	0.30
11/4/12 2:00 PM	0.23	0.16	0.39
11/4/12 5:00 PM	0.25	0.15	0.40
11/4/12 8:00 PM	0.26	0.15	0.41
11/4/12 11:00 PM	0.28	0.15	0.42

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
11/5/12 2:00 AM	0.25	0.14	0.39
11/5/12 5:00 AM	0.00	0.15	0.15
11/5/12 8:00 AM	0.00	0.15	0.15
11/5/12 11:00 AM	0.00	0.20	0.20
11/5/12 2:00 PM	0.00	0.24	0.24
11/5/12 5:00 PM	0.07	0.24	0.31
11/5/12 8:00 PM	0.22	0.24	0.46
11/5/12 11:00 PM	0.28	0.24	0.52
11/6/12 2:00 AM	0.37	0.24	0.61
11/6/12 5:00 AM	0.37	0.23	0.60
11/6/12 8:00 AM	0.35	0.26	0.61
11/6/12 11:00 AM	0.36	0.28	0.64
11/6/12 2:00 PM	0.97	0.31	1.29
11/6/12 5:00 PM	0.91	0.31	1.23
11/6/12 8:00 PM	0.82	0.30	1.13
11/6/12 11:00 PM	0.33	0.28	0.60
11/7/12 2:00 AM	0.81	0.16	0.97
11/7/12 5:00 AM	0.89	0.17	1.06
11/7/12 8:00 AM	0.39	0.30	0.69
11/7/12 11:00 AM	0.39	0.31	0.70
11/7/12 2:00 PM	0.49	0.35	0.84
11/7/12 5:00 PM	0.55	0.40	0.95
11/7/12 8:00 PM	0.51	0.31	0.81
11/7/12 11:00 PM	0.72	0.36	1.07
11/8/12 2:00 AM	0.74	0.26	1.01
11/8/12 5:00 AM	0.88	0.19	1.07
11/8/12 8:00 AM	0.58	0.31	0.89
11/8/12 11:00 AM	0.48	0.36	0.84
11/8/12 2:00 PM	0.45	0.38	0.83
11/8/12 5:00 PM	0.40	0.36	0.76
11/8/12 8:00 PM	0.36	0.40	0.75
11/8/12 11:00 PM	0.82	0.35	1.17
11/9/12 2:00 AM	0.70	0.26	0.96
11/9/12 5:00 AM	0.92	0.28	1.19
11/9/12 8:00 AM	0.52	0.51	1.03
11/9/12 11:00 AM	0.72	0.31	1.03
11/9/12 2:00 PM	0.28	0.02	0.29
11/9/12 5:00 PM	0.90	0.31	1.21
11/9/12 8:00 PM	0.44	0.40	0.84
11/9/12 11:00 PM	0.25	0.34	0.59
11/10/12 2:00 AM	2.13	0.28	2.41
11/10/12 5:00 AM	0.77	0.24	1.01
11/10/12 8:00 AM	1.03	0.54	1.57
11/10/12 11:00 AM	0.36	0.41	0.77
11/10/12 2:00 PM	0.33	0.41	0.74
11/10/12 5:00 PM	0.30	0.40	0.70
11/10/12 8:00 PM	0.62	0.42	1.04
11/10/12 11:00 PM	0.92	0.30	1.22
11/11/12 2:00 AM	0.42	0.35	0.78
11/11/12 5:00 AM	0.16	0.38	0.54
11/11/12 8:00 AM	0.29	0.35	0.64
11/11/12 11:00 AM	0.19	0.32	0.50
11/11/12 2:00 PM	0.30	0.28	0.58
11/11/12 5:00 PM	0.22	0.24	0.47

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
11/11/12 8:00 PM	0.25	0.24	0.49
11/11/12 11:00 PM	0.24	0.23	0.47
11/12/12 2:00 AM	0.26	0.13	0.39
11/12/12 5:00 AM	0.36	0.15	0.51
11/12/12 8:00 AM	0.74	0.22	0.95
11/12/12 11:00 AM	0.69	0.21	0.90
11/12/12 2:00 PM	0.36	0.21	0.57
11/12/12 5:00 PM	0.33	0.21	0.54
11/12/12 8:00 PM	0.33	0.21	0.54
11/12/12 11:00 PM	0.75	0.21	0.96
11/13/12 2:00 AM	0.57	0.14	0.70
11/13/12 5:00 AM	0.39	0.14	0.53
11/13/12 8:00 AM	0.90	0.21	1.11
11/13/12 11:00 AM	0.32	0.24	0.57
11/13/12 2:00 PM	0.33	0.24	0.57
11/13/12 5:00 PM	0.30	0.25	0.55
11/13/12 8:00 PM	0.28	0.25	0.54
11/13/12 11:00 PM	0.50	0.27	0.77
11/14/12 2:00 AM	0.38	0.18	0.56
11/14/12 5:00 AM	0.45	0.17	0.62
11/14/12 8:00 AM	0.89	0.27	1.15
11/14/12 11:00 AM	0.74	0.27	1.00
11/14/12 2:00 PM	0.29	0.26	0.55
11/14/12 5:00 PM	0.09	0.25	0.34
11/14/12 8:00 PM	0.07	0.25	0.33
11/14/12 11:00 PM	0.09	0.23	0.32
11/15/12 2:00 AM	0.18	0.22	0.40
11/15/12 5:00 AM	0.17	0.22	0.39
11/15/12 8:00 AM	0.26	0.22	0.49
11/15/12 11:00 AM	0.24	0.23	0.47
11/15/12 2:00 PM	0.25	0.23	0.48
11/15/12 5:00 PM	0.31	0.22	0.53
11/15/12 8:00 PM	0.30	0.22	0.52
11/15/12 11:00 PM	0.23	0.23	0.46
11/16/12 2:00 AM	0.08	0.23	0.31
11/16/12 5:00 AM	0.14	0.23	0.37
11/16/12 8:00 AM	0.30	0.23	0.54
11/16/12 11:00 AM	0.30	0.25	0.55
11/16/12 2:00 PM	0.30	0.26	0.56
11/16/12 5:00 PM	0.30	0.27	0.57
11/16/12 8:00 PM	0.30	0.27	0.57
11/16/12 11:00 PM	0.29	0.27	0.56
11/17/12 2:00 AM	0.21	0.17	0.38
11/17/12 5:00 AM	0.16	0.17	0.33
11/17/12 8:00 AM	0.25	0.29	0.54
11/17/12 11:00 AM	0.28	0.30	0.58
11/17/12 2:00 PM	0.29	0.31	0.60
11/17/12 5:00 PM	0.29	0.09	0.38
11/17/12 8:00 PM	0.31	0.01	0.33
11/17/12 11:00 PM	0.30	0.03	0.33
11/18/12 2:00 AM	0.31	0.26	0.57
11/18/12 5:00 AM	0.38	0.30	0.69
11/18/12 8:00 AM	0.42	0.31	0.73
11/18/12 11:00 AM	0.46	0.35	0.81

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
11/18/12 2:00 PM	0.88	0.34	1.22
11/18/12 5:00 PM	0.98	0.11	1.09
11/18/12 8:00 PM	0.51	0.05	0.56
11/18/12 11:00 PM	0.81	0.23	1.04
11/19/12 2:00 AM	0.31	0.24	0.55
11/19/12 5:00 AM	0.33	0.25	0.58
11/19/12 8:00 AM	1.05	0.34	1.39
11/19/12 11:00 AM	0.50	0.39	0.89
11/19/12 2:00 PM	0.38	0.38	0.76
11/19/12 5:00 PM	0.39	0.41	0.80
11/19/12 8:00 PM	0.36	0.44	0.80
11/19/12 11:00 PM	0.79	0.61	1.40
11/20/12 2:00 AM	0.68	0.49	1.17
11/20/12 5:00 AM	0.45	0.50	0.96
11/20/12 8:00 AM	0.75	0.42	1.17
11/20/12 11:00 AM	0.70	0.39	1.08
11/20/12 2:00 PM	0.69	0.41	1.10
11/20/12 5:00 PM	0.42	0.38	0.80
11/20/12 8:00 PM	0.46	0.26	0.72
11/20/12 11:00 PM	0.44	0.11	0.55
11/21/12 2:00 AM	0.82	0.00	0.82
11/21/12 5:00 AM	0.79	0.00	0.79
11/21/12 8:00 AM	0.38	0.00	0.38
11/21/12 11:00 AM	0.38	0.00	0.38
11/21/12 2:00 PM	0.47	0.00	0.47
11/21/12 5:00 PM	0.15	0.00	0.15
11/21/12 8:00 PM	0.08	0.00	0.08
11/21/12 11:00 PM	0.09	0.00	0.09
11/22/12 2:00 AM	0.10	0.00	0.10
11/22/12 5:00 AM	0.25	0.00	0.25
11/22/12 8:00 AM	0.24	0.00	0.24
11/22/12 11:00 AM	0.20	0.00	0.20
11/22/12 2:00 PM	0.21	0.00	0.21
11/22/12 5:00 PM	0.22	0.00	0.22
11/22/12 8:00 PM	0.24	0.00	0.24
11/22/12 11:00 PM	0.27	0.00	0.27
11/23/12 2:00 AM	0.29	0.00	0.29
11/23/12 5:00 AM	0.28	0.00	0.28
11/23/12 8:00 AM	0.29	0.00	0.29
11/23/12 11:00 AM	0.30	0.00	0.30
11/23/12 2:00 PM	0.23	0.00	0.23
11/23/12 5:00 PM	0.24	0.00	0.24
11/23/12 8:00 PM	0.24	0.00	0.24
11/23/12 11:00 PM	0.24	0.00	0.24
11/24/12 2:00 AM	0.24	0.12	0.35
11/24/12 5:00 AM	0.23	0.18	0.41
11/24/12 8:00 AM	0.27	0.40	0.67
11/24/12 11:00 AM	0.28	0.34	0.62
11/24/12 2:00 PM	0.31	0.31	0.61
11/24/12 5:00 PM	0.33	0.28	0.61
11/24/12 8:00 PM	0.35	0.25	0.60
11/24/12 11:00 PM	0.38	0.24	0.62
11/25/12 2:00 AM	0.24	0.25	0.49
11/25/12 5:00 AM	0.18	0.26	0.44

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
11/25/12 8:00 AM	0.21	0.27	0.48
11/25/12 11:00 AM	0.21	0.26	0.47
11/25/12 2:00 PM	0.25	0.27	0.52
11/25/12 5:00 PM	0.40	0.26	0.66
11/25/12 8:00 PM	0.49	0.26	0.75
11/25/12 11:00 PM	0.35	0.26	0.61
11/26/12 2:00 AM	0.35	0.26	0.61
11/26/12 5:00 AM	0.45	0.27	0.72
11/26/12 8:00 AM	0.49	0.27	0.75
11/26/12 11:00 AM	0.39	0.28	0.67
11/26/12 2:00 PM	0.38	0.31	0.70
11/26/12 5:00 PM	0.36	0.35	0.72
11/26/12 8:00 PM	0.39	0.36	0.75
11/26/12 11:00 PM	0.39	0.36	0.74
11/27/12 2:00 AM	0.32	0.38	0.70
11/27/12 5:00 AM	0.38	0.38	0.76
11/27/12 8:00 AM	0.43	0.32	0.75
11/27/12 11:00 AM	0.43	0.35	0.78
11/27/12 2:00 PM	0.42	0.42	0.84
11/27/12 5:00 PM	0.42	0.42	0.84
11/27/12 8:00 PM	0.37	0.40	0.77
11/27/12 11:00 PM	0.23	0.38	0.61
11/28/12 2:00 AM	0.16	0.31	0.48
11/28/12 5:00 AM	0.30	0.23	0.53
11/28/12 8:00 AM	0.35	0.37	0.72
11/28/12 11:00 AM	0.39	0.35	0.74
11/28/12 2:00 PM	0.39	0.34	0.74
11/28/12 5:00 PM	0.45	0.33	0.78
11/28/12 8:00 PM	0.45	0.32	0.78
11/28/12 11:00 PM	0.42	0.31	0.73
11/29/12 2:00 AM	0.49	0.33	0.83
11/29/12 5:00 AM	1.18	0.30	1.48
11/29/12 8:00 AM	1.07	0.36	1.43
11/29/12 11:00 AM	0.59	0.35	0.95
11/29/12 2:00 PM	0.57	0.34	0.91
11/29/12 5:00 PM	0.57	0.30	0.87
11/29/12 8:00 PM	0.56	0.32	0.88
11/29/12 11:00 PM	0.54	0.27	0.81
11/30/12 2:00 AM	1.06	0.15	1.21
11/30/12 5:00 AM	0.97	0.19	1.16
11/30/12 8:00 AM	0.77	0.35	1.12
11/30/12 11:00 AM	0.74	0.34	1.08
11/30/12 2:00 PM	0.36	0.32	0.68
11/30/12 5:00 PM	0.36	0.29	0.65
11/30/12 8:00 PM	0.34	0.29	0.63
11/30/12 11:00 PM	0.33	0.14	0.46
12/1/12 2:00 AM	0.89	0.10	0.99
12/1/12 5:00 AM	0.99	0.10	1.10
12/1/12 8:00 AM	0.66	0.11	0.77
12/1/12 11:00 AM	0.28	0.05	0.33
12/1/12 2:00 PM	0.28	0.12	0.40
12/1/12 5:00 PM	0.26	0.14	0.40
12/1/12 8:00 PM	0.23	0.15	0.39
12/1/12 11:00 PM	0.22	0.33	0.55

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
12/2/12 2:00 AM	0.70	0.21	0.91
12/2/12 5:00 AM	0.80	0.12	0.93
12/2/12 8:00 AM	0.73	0.17	0.89
12/2/12 11:00 AM	0.22	0.26	0.49
12/2/12 2:00 PM	0.22	0.23	0.45
12/2/12 5:00 PM	0.22	0.22	0.44
12/2/12 8:00 PM	0.21	0.22	0.43
12/2/12 11:00 PM	0.45	0.23	0.68
12/3/12 2:00 AM	0.45	0.15	0.60
12/3/12 5:00 AM	0.40	0.17	0.57
12/3/12 8:00 AM	0.37	0.26	0.62
12/3/12 11:00 AM	0.23	0.25	0.49
12/3/12 2:00 PM	0.22	0.25	0.47
12/3/12 5:00 PM	0.23	0.24	0.47
12/3/12 8:00 PM	0.23	0.25	0.48
12/3/12 11:00 PM	0.20	0.26	0.47
12/4/12 2:00 AM	0.44	0.25	0.69
12/4/12 5:00 AM	0.70	0.18	0.88
12/4/12 8:00 AM	0.21	0.22	0.43
12/4/12 11:00 AM	0.21	0.22	0.43
12/4/12 2:00 PM	0.21	0.22	0.43
12/4/12 5:00 PM	0.20	0.22	0.42
12/4/12 8:00 PM	0.20	0.22	0.42
12/4/12 11:00 PM	0.19	0.41	0.60
12/5/12 2:00 AM	0.58	0.41	1.00
12/5/12 5:00 AM	0.13	0.27	0.40
12/5/12 8:00 AM	0.05	0.20	0.25
12/5/12 11:00 AM	0.04	0.21	0.25
12/5/12 2:00 PM	0.13	0.20	0.34
12/5/12 5:00 PM	0.18	0.21	0.39
12/5/12 8:00 PM	0.15	0.21	0.36
12/5/12 11:00 PM	0.16	0.19	0.36
12/6/12 2:00 AM	0.11	0.18	0.29
12/6/12 5:00 AM	0.09	0.20	0.30
12/6/12 8:00 AM	0.18	0.22	0.40
12/6/12 11:00 AM	0.20	0.20	0.40
12/6/12 2:00 PM	0.20	0.22	0.42
12/6/12 5:00 PM	0.22	0.23	0.44
12/6/12 8:00 PM	0.20	0.23	0.43
12/6/12 11:00 PM	0.19	0.36	0.55
12/7/12 2:00 AM	0.20	0.34	0.53
12/7/12 5:00 AM	0.19	0.25	0.44
12/7/12 8:00 AM	0.25	0.23	0.48
12/7/12 11:00 AM	0.24	0.22	0.46
12/7/12 2:00 PM	0.22	0.22	0.44
12/7/12 5:00 PM	0.25	0.22	0.48
12/7/12 8:00 PM	0.25	0.23	0.48
12/7/12 11:00 PM	0.24	0.23	0.47
12/8/12 2:00 AM	0.26	0.24	0.50
12/8/12 5:00 AM	0.25	0.25	0.51
12/8/12 8:00 AM	0.26	0.26	0.52
12/8/12 11:00 AM	0.24	0.25	0.49
12/8/12 2:00 PM	0.26	0.25	0.51
12/8/12 5:00 PM	0.28	0.25	0.53

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
12/8/12 8:00 PM	0.28	0.25	0.53
12/8/12 11:00 PM	0.28	0.25	0.53
12/9/12 2:00 AM	0.26	0.19	0.45
12/9/12 5:00 AM	0.28	0.15	0.43
12/9/12 8:00 AM	0.30	0.23	0.53
12/9/12 11:00 AM	0.30	0.28	0.59
12/9/12 2:00 PM	0.31	0.28	0.59
12/9/12 5:00 PM	0.31	0.27	0.59
12/9/12 8:00 PM	0.32	0.27	0.58
12/9/12 11:00 PM	0.33	0.27	0.60
12/10/12 2:00 AM	0.33	0.26	0.60
12/10/12 5:00 AM	0.35	0.19	0.54
12/10/12 8:00 AM	0.37	0.28	0.65
12/10/12 11:00 AM	0.38	0.29	0.67
12/10/12 2:00 PM	0.38	0.30	0.68
12/10/12 5:00 PM	0.39	0.30	0.69
12/10/12 8:00 PM	0.34	0.30	0.65
12/10/12 11:00 PM	0.35	0.29	0.64
12/11/12 2:00 AM	0.45	0.20	0.65
12/11/12 5:00 AM	0.91	0.23	1.13
12/11/12 8:00 AM	0.56	0.30	0.86
12/11/12 11:00 AM	0.46	0.29	0.75
12/11/12 2:00 PM	0.45	0.29	0.74
12/11/12 5:00 PM	0.47	0.32	0.78
12/11/12 8:00 PM	0.49	0.33	0.82
12/11/12 11:00 PM	0.51	0.33	0.84
12/12/12 2:00 AM	1.08	0.22	1.30
12/12/12 5:00 AM	0.90	0.16	1.07
12/12/12 8:00 AM	0.44	0.33	0.77
12/12/12 11:00 AM	0.44	0.29	0.72
12/12/12 2:00 PM	0.45	0.27	0.72
12/12/12 5:00 PM	0.46	0.27	0.73
12/12/12 8:00 PM	0.46	0.27	0.74
12/12/12 11:00 PM	0.45	0.28	0.73
12/13/12 2:00 AM	0.92	0.26	1.18
12/13/12 5:00 AM	1.04	0.26	1.30
12/13/12 8:00 AM	0.65	0.27	0.92
12/13/12 11:00 AM	0.48	0.38	0.86
12/13/12 2:00 PM	1.12	0.46	1.59
12/13/12 5:00 PM	0.82	0.33	1.15
12/13/12 8:00 PM	0.70	0.35	1.05
12/13/12 11:00 PM	0.78	0.35	1.13
12/14/12 2:00 AM	1.15	0.36	1.51
12/14/12 5:00 AM	1.25	0.37	1.63
12/14/12 8:00 AM	0.81	0.38	1.19
12/14/12 11:00 AM	0.70	0.37	1.07
12/14/12 2:00 PM	0.73	0.39	1.12
12/14/12 5:00 PM	0.77	0.40	1.17
12/14/12 8:00 PM	0.79	0.40	1.19
12/14/12 11:00 PM	0.77	0.40	1.16
12/15/12 2:00 AM	0.70	0.29	0.99
12/15/12 5:00 AM	0.62	0.23	0.85
12/15/12 8:00 AM	0.83	0.32	1.15
12/15/12 11:00 AM	0.79	0.13	0.93

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
12/15/12 2:00 PM	0.79	0.08	0.87
12/15/12 5:00 PM	0.79	0.05	0.84
12/15/12 8:00 PM	0.81	0.04	0.85
12/15/12 11:00 PM	0.78	0.03	0.81
12/16/12 2:00 AM	0.80	0.02	0.83
12/16/12 5:00 AM	1.43	0.01	1.44
12/16/12 8:00 AM	1.20	0.17	1.37
12/16/12 11:00 AM	0.78	0.16	0.94
12/16/12 2:00 PM	0.83	0.39	1.22
12/16/12 5:00 PM	0.92	0.40	1.32
12/16/12 8:00 PM	1.01	0.39	1.39
12/16/12 11:00 PM	1.03	0.39	1.41
12/17/12 2:00 AM	1.57	0.21	1.78
12/17/12 5:00 AM	1.27	0.23	1.50
12/17/12 8:00 AM	0.60	0.38	0.98
12/17/12 11:00 AM	0.60	0.37	0.97
12/17/12 2:00 PM	0.65	0.37	1.02
12/17/12 5:00 PM	0.62	0.37	0.99
12/17/12 8:00 PM	0.64	0.36	1.00
12/17/12 11:00 PM	0.69	0.36	1.05
12/18/12 2:00 AM	0.94	0.29	1.23
12/18/12 5:00 AM	1.18	0.26	1.44
12/18/12 8:00 AM	0.69	0.41	1.10
12/18/12 11:00 AM	0.61	0.42	1.03
12/18/12 2:00 PM	0.56	0.38	0.94
12/18/12 5:00 PM	0.53	0.38	0.91
12/18/12 8:00 PM	0.51	0.41	0.92
12/18/12 11:00 PM	0.53	0.83	1.36
12/19/12 2:00 AM	0.81	0.48	1.29
12/19/12 5:00 AM	1.01	0.31	1.32
12/19/12 8:00 AM	0.58	0.26	0.84
12/19/12 11:00 AM	0.11	0.24	0.35
12/19/12 2:00 PM	0.50	0.22	0.72
12/19/12 5:00 PM	0.57	0.21	0.78
12/19/12 8:00 PM	0.58	0.23	0.81
12/19/12 11:00 PM	0.57	0.24	0.81
12/20/12 2:00 AM	0.60	0.25	0.85
12/20/12 5:00 AM	0.59	0.31	0.90
12/20/12 8:00 AM	0.52	0.30	0.83
12/20/12 11:00 AM	0.34	0.31	0.64
12/20/12 2:00 PM	0.38	0.29	0.67
12/20/12 5:00 PM	0.45	0.34	0.79
12/20/12 8:00 PM	0.52	0.30	0.83
12/20/12 11:00 PM	0.49	0.26	0.75
12/21/12 2:00 AM	0.33	0.23	0.57
12/21/12 5:00 AM	0.20	0.21	0.41
12/21/12 8:00 AM	0.42	0.21	0.63
12/21/12 11:00 AM	0.43	0.23	0.65
12/21/12 2:00 PM	0.28	0.24	0.52
12/21/12 5:00 PM	0.28	0.40	0.67
12/21/12 8:00 PM	0.28	0.25	0.53
12/21/12 11:00 PM	0.28	0.26	0.54
12/22/12 2:00 AM	0.29	0.26	0.55
12/22/12 5:00 AM	0.30	0.27	0.57

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
12/22/12 8:00 AM	0.29	0.28	0.57
12/22/12 11:00 AM	0.28	0.31	0.59
12/22/12 2:00 PM	0.26	0.32	0.58
12/22/12 5:00 PM	0.27	0.34	0.61
12/22/12 8:00 PM	0.28	0.35	0.63
12/22/12 11:00 PM	0.27	0.34	0.61
12/23/12 2:00 AM	0.27	0.29	0.56
12/23/12 5:00 AM	0.28	0.22	0.50
12/23/12 8:00 AM	0.27	0.22	0.49
12/23/12 11:00 AM	0.26	0.24	0.50
12/23/12 2:00 PM	0.25	0.25	0.50
12/23/12 5:00 PM	0.25	0.29	0.54
12/23/12 8:00 PM	0.24	0.32	0.56
12/23/12 11:00 PM	0.22	0.35	0.57
12/24/12 2:00 AM	0.19	0.29	0.48
12/24/12 5:00 AM	0.20	0.24	0.44
12/24/12 8:00 AM	0.26	0.32	0.58
12/24/12 11:00 AM	0.24	0.43	0.67
12/24/12 2:00 PM	0.25	0.41	0.66
12/24/12 5:00 PM	0.25	0.40	0.65
12/24/12 8:00 PM	0.24	0.38	0.62
12/24/12 11:00 PM	0.24	0.37	0.61
12/25/12 2:00 AM	0.29	0.34	0.63
12/25/12 5:00 AM	0.28	0.32	0.60
12/25/12 8:00 AM	0.31	0.33	0.64
12/25/12 11:00 AM	0.28	0.36	0.64
12/25/12 2:00 PM	0.27	0.37	0.64
12/25/12 5:00 PM	0.27	0.36	0.63
12/25/12 8:00 PM	0.28	0.36	0.64
12/25/12 11:00 PM	0.24	0.34	0.58
12/26/12 2:00 AM	0.11	0.30	0.42
12/26/12 5:00 AM	0.12	0.24	0.36
12/26/12 8:00 AM	0.15	0.29	0.44
12/26/12 11:00 AM	0.28	0.43	0.71
12/26/12 2:00 PM	0.28	0.41	0.69
12/26/12 5:00 PM	0.29	0.40	0.69
12/26/12 8:00 PM	0.31	0.38	0.69
12/26/12 11:00 PM	0.29	0.70	0.99
12/27/12 2:00 AM	0.28	0.53	0.81
12/27/12 5:00 AM	0.27	0.27	0.55
12/27/12 8:00 AM	0.29	0.29	0.58
12/27/12 11:00 AM	0.30	0.28	0.58
12/27/12 2:00 PM	0.28	0.26	0.54
12/27/12 5:00 PM	0.28	0.24	0.52
12/27/12 8:00 PM	0.28	0.25	0.53
12/27/12 11:00 PM	0.30	0.27	0.57
12/28/12 2:00 AM	0.28	0.26	0.54
12/28/12 5:00 AM	0.30	0.28	0.58
12/28/12 8:00 AM	0.36	0.27	0.64
12/28/12 11:00 AM	0.35	0.28	0.63
12/28/12 2:00 PM	0.32	0.29	0.61
12/28/12 5:00 PM	0.35	0.28	0.63
12/28/12 8:00 PM	0.27	0.28	0.55
12/28/12 11:00 PM	0.27	0.28	0.55

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
12/29/12 2:00 AM	0.28	0.15	0.43
12/29/12 5:00 AM	0.30	0.15	0.46
12/29/12 8:00 AM	0.30	0.29	0.59
12/29/12 11:00 AM	0.29	0.34	0.64
12/29/12 2:00 PM	0.30	0.33	0.63
12/29/12 5:00 PM	0.30	0.34	0.64
12/29/12 8:00 PM	0.32	0.33	0.65
12/29/12 11:00 PM	0.34	0.33	0.67
12/30/12 2:00 AM	0.34	0.36	0.70
12/30/12 5:00 AM	0.33	0.37	0.71
12/30/12 8:00 AM	0.29	0.40	0.69
12/30/12 11:00 AM	0.28	0.39	0.67
12/30/12 2:00 PM	0.30	0.40	0.70
12/30/12 5:00 PM	0.32	0.41	0.72
12/30/12 8:00 PM	0.31	0.42	0.74
12/30/12 11:00 PM	0.30	0.43	0.73
12/31/12 2:00 AM	0.30	0.44	0.73
12/31/12 5:00 AM	0.31	0.48	0.79
12/31/12 8:00 AM	0.34	0.52	0.86
12/31/12 11:00 AM	0.24	0.50	0.74
12/31/12 2:00 PM	0.34	0.44	0.78
12/31/12 5:00 PM	0.52	0.42	0.94
12/31/12 8:00 PM	0.33	0.39	0.73
12/31/12 11:00 PM	0.33	0.39	0.72
1/1/13 2:00 AM	0.32	0.43	0.75
1/1/13 5:00 AM	0.23	0.44	0.67
1/1/13 8:00 AM	0.32	0.47	0.79
1/1/13 11:00 AM	0.29	0.48	0.77
1/1/13 2:00 PM	0.29	0.49	0.79
1/1/13 5:00 PM	0.29	0.48	0.78
1/1/13 8:00 PM	0.30	0.42	0.72
1/1/13 11:00 PM	0.31	0.47	0.78
1/2/13 2:00 AM	0.26	0.42	0.69
1/2/13 5:00 AM	0.25	0.39	0.65
1/2/13 8:00 AM	0.32	0.47	0.79
1/2/13 11:00 AM	0.32	0.47	0.79
1/2/13 2:00 PM	0.31	0.47	0.78
1/2/13 5:00 PM	0.33	0.45	0.78
1/2/13 8:00 PM	0.32	0.42	0.75
1/2/13 11:00 PM	0.31	0.48	0.79
1/3/13 2:00 AM	0.15	0.66	0.81
1/3/13 5:00 AM	0.13	0.58	0.71
1/3/13 8:00 AM	0.33	0.46	0.79
1/3/13 11:00 AM	0.35	0.44	0.79
1/3/13 2:00 PM	0.35	0.45	0.81
1/3/13 5:00 PM	0.36	0.42	0.78
1/3/13 8:00 PM	0.36	0.40	0.76
1/3/13 11:00 PM	0.36	0.39	0.74
1/4/13 2:00 AM	0.29	0.41	0.71
1/4/13 5:00 AM	0.31	0.43	0.74
1/4/13 8:00 AM	0.37	0.43	0.80
1/4/13 11:00 AM	0.37	0.36	0.73
1/4/13 2:00 PM	0.36	0.26	0.62
1/4/13 5:00 PM	0.39	0.38	0.76

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
1/4/13 8:00 PM	0.37	0.44	0.81
1/4/13 11:00 PM	0.36	0.46	0.82
1/5/13 2:00 AM	0.33	0.30	0.63
1/5/13 5:00 AM	0.33	0.24	0.58
1/5/13 8:00 AM	0.33	0.46	0.79
1/5/13 11:00 AM	0.36	0.46	0.82
1/5/13 2:00 PM	0.35	0.41	0.76
1/5/13 5:00 PM	0.34	0.42	0.76
1/5/13 8:00 PM	0.34	0.41	0.75
1/5/13 11:00 PM	0.33	0.41	0.74
1/6/13 2:00 AM	0.15	0.41	0.56
1/6/13 5:00 AM	0.00	0.41	0.41
1/6/13 8:00 AM	0.00	0.42	0.42
1/6/13 11:00 AM	0.00	0.41	0.41
1/6/13 2:00 PM	0.00	0.41	0.41
1/6/13 5:00 PM	0.00	0.40	0.40
1/6/13 8:00 PM	0.00	0.40	0.40
1/6/13 11:00 PM	0.00	0.42	0.42
1/7/13 2:00 AM	0.00	0.43	0.43
1/7/13 5:00 AM	0.00	0.44	0.44
1/7/13 8:00 AM	0.00	0.44	0.44
1/7/13 11:00 AM	0.00	0.45	0.45
1/7/13 2:00 PM	0.00	0.44	0.44
1/7/13 5:00 PM	0.00	0.43	0.43
1/7/13 8:00 PM	0.00	0.44	0.44
1/7/13 11:00 PM	0.00	0.43	0.43
1/8/13 2:00 AM	0.00	0.43	0.43
1/8/13 5:00 AM	0.00	0.44	0.44
1/8/13 8:00 AM	0.00	0.48	0.48
1/8/13 11:00 AM	0.00	0.67	0.67
1/8/13 2:00 PM	0.00	0.75	0.75
1/8/13 5:00 PM	0.00	0.40	0.40
1/8/13 8:00 PM	0.00	0.43	0.43
1/8/13 11:00 PM	0.00	0.42	0.42
1/9/13 2:00 AM	0.00	0.45	0.45
1/9/13 5:00 AM	0.00	0.33	0.33
1/9/13 8:00 AM	0.00	0.35	0.35
1/9/13 11:00 AM	0.00	0.40	0.40
1/9/13 2:00 PM	0.00	0.40	0.40
1/9/13 5:00 PM	0.00	0.41	0.41
1/9/13 8:00 PM	0.00	0.44	0.44
1/9/13 11:00 PM	0.00	0.42	0.42
1/10/13 2:00 AM	0.00	0.45	0.45
1/10/13 5:00 AM	0.00	0.47	0.47
1/10/13 8:00 AM	0.00	0.47	0.47
1/10/13 11:00 AM	0.00	0.49	0.49
1/10/13 2:00 PM	0.00	0.39	0.39
1/10/13 5:00 PM	0.00	0.41	0.41
1/10/13 8:00 PM	0.00	0.46	0.46
1/10/13 11:00 PM	0.00	0.48	0.48
1/11/13 2:00 AM	0.00	0.46	0.46
1/11/13 5:00 AM	0.00	0.42	0.42
1/11/13 8:00 AM	0.00	0.47	0.47
1/11/13 11:00 AM	0.03	0.46	0.49

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
1/11/13 2:00 PM	0.31	0.49	0.80
1/11/13 5:00 PM	0.45	0.45	0.90
1/11/13 8:00 PM	0.45	0.46	0.91
1/11/13 11:00 PM	0.46	0.47	0.93
1/12/13 2:00 AM	0.35	0.47	0.82
1/12/13 5:00 AM	0.35	0.45	0.80
1/12/13 8:00 AM	0.35	0.40	0.75
1/12/13 11:00 AM	0.36	0.39	0.75
1/12/13 2:00 PM	0.35	0.35	0.70
1/12/13 5:00 PM	0.35	0.33	0.68
1/12/13 8:00 PM	0.34	0.34	0.68
1/12/13 11:00 PM	0.26	0.35	0.60
1/13/13 2:00 AM	0.19	0.36	0.55
1/13/13 5:00 AM	0.24	0.39	0.63
1/13/13 8:00 AM	0.36	0.42	0.78
1/13/13 11:00 AM	0.37	0.44	0.81
1/13/13 2:00 PM	0.39	0.44	0.82
1/13/13 5:00 PM	0.40	0.44	0.84
1/13/13 8:00 PM	0.39	0.44	0.83
1/13/13 11:00 PM	0.36	0.44	0.80
1/14/13 2:00 AM	0.35	0.46	0.81
1/14/13 5:00 AM	0.35	0.46	0.81
1/14/13 8:00 AM	0.36	0.43	0.78
1/14/13 11:00 AM	0.44	0.33	0.77
1/14/13 2:00 PM	0.47	0.06	0.53
1/14/13 5:00 PM	0.49	0.05	0.54
1/14/13 8:00 PM	0.44	0.20	0.64
1/14/13 11:00 PM	0.39	0.59	0.98
1/15/13 2:00 AM	0.27	0.84	1.11
1/15/13 5:00 AM	0.24	0.50	0.73
1/15/13 8:00 AM	0.30	0.36	0.66
1/15/13 11:00 AM	0.37	0.40	0.77
1/15/13 2:00 PM	0.39	0.41	0.79
1/15/13 5:00 PM	0.37	0.43	0.80
1/15/13 8:00 PM	0.40	0.47	0.87
1/15/13 11:00 PM	0.37	0.46	0.83
1/16/13 2:00 AM	0.30	0.41	0.71
1/16/13 5:00 AM	0.33	0.39	0.72
1/16/13 8:00 AM	0.40	0.47	0.86
1/16/13 11:00 AM	0.40	0.42	0.82
1/16/13 2:00 PM	0.43	0.35	0.78
1/16/13 5:00 PM	0.38	0.29	0.67
1/16/13 8:00 PM	0.37	0.26	0.63
1/16/13 11:00 PM	0.35	0.25	0.60
1/17/13 2:00 AM	0.32	0.23	0.54
1/17/13 5:00 AM	0.27	0.21	0.47
1/17/13 8:00 AM	0.41	0.27	0.68
1/17/13 11:00 AM	0.39	0.30	0.69
1/17/13 2:00 PM	0.41	0.28	0.69
1/17/13 5:00 PM	0.40	0.28	0.68
1/17/13 8:00 PM	0.37	0.26	0.63
1/17/13 11:00 PM	0.38	0.27	0.66
1/18/13 2:00 AM	0.39	0.25	0.63
1/18/13 5:00 AM	0.40	0.25	0.65

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
1/18/13 8:00 AM	0.37	0.25	0.63
1/18/13 11:00 AM	0.35	0.34	0.68
1/18/13 2:00 PM	0.34	0.41	0.75
1/18/13 5:00 PM	0.34	0.46	0.80
1/18/13 8:00 PM	0.34	0.48	0.82
1/18/13 11:00 PM	0.27	0.49	0.76
1/19/13 2:00 AM	0.15	0.44	0.59
1/19/13 5:00 AM	0.19	0.48	0.67
1/19/13 8:00 AM	0.32	0.49	0.80
1/19/13 11:00 AM	0.34	0.51	0.84
1/19/13 2:00 PM	0.36	0.46	0.82
1/19/13 5:00 PM	0.37	0.45	0.82
1/19/13 8:00 PM	0.37	0.48	0.85
1/19/13 11:00 PM	0.34	0.46	0.80
1/20/13 2:00 AM	0.36	0.47	0.82
1/20/13 5:00 AM	0.37	0.42	0.79
1/20/13 8:00 AM	0.39	0.48	0.88
1/20/13 11:00 AM	0.41	0.51	0.92
1/20/13 2:00 PM	0.38	0.50	0.88
1/20/13 5:00 PM	0.40	0.47	0.88
1/20/13 8:00 PM	0.36	0.45	0.81
1/20/13 11:00 PM	0.35	0.43	0.79
1/21/13 2:00 AM	0.34	0.44	0.78
1/21/13 5:00 AM	0.37	0.48	0.85
1/21/13 8:00 AM	0.40	0.48	0.88
1/21/13 11:00 AM	0.39	0.47	0.86
1/21/13 2:00 PM	0.39	0.51	0.90
1/21/13 5:00 PM	0.42	0.52	0.94
1/21/13 8:00 PM	0.41	0.45	0.86
1/21/13 11:00 PM	0.41	0.44	0.85
1/22/13 2:00 AM	0.43	0.46	0.89
1/22/13 5:00 AM	0.40	0.46	0.87
1/22/13 8:00 AM	0.36	0.54	0.90
1/22/13 11:00 AM	0.36	0.53	0.88
1/22/13 2:00 PM	0.40	0.49	0.88
1/22/13 5:00 PM	0.44	0.48	0.92
1/22/13 8:00 PM	0.39	0.53	0.92
1/22/13 11:00 PM	0.02	0.49	0.51
1/23/13 2:00 AM	0.00	0.51	0.51
1/23/13 5:00 AM	0.00	0.55	0.55
1/23/13 8:00 AM	0.00	0.56	0.56
1/23/13 11:00 AM	0.00	0.30	0.30
1/23/13 2:00 PM	0.00	0.37	0.37
1/23/13 5:00 PM	0.00	0.39	0.39
1/23/13 8:00 PM	0.00	0.42	0.42
1/23/13 11:00 PM	0.00	0.46	0.46
1/24/13 2:00 AM	0.00	0.57	0.57
1/24/13 5:00 AM	0.00	0.43	0.43
1/24/13 8:00 AM	0.00	0.25	0.25
1/24/13 11:00 AM	0.00	0.33	0.33
1/24/13 2:00 PM	0.00	0.36	0.36
1/24/13 5:00 PM	0.00	0.36	0.36
1/24/13 8:00 PM	0.00	0.35	0.35
1/24/13 11:00 PM	0.00	0.39	0.39

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
1/25/13 2:00 AM	0.00	0.32	0.32
1/25/13 5:00 AM	0.00	0.42	0.42
1/25/13 8:00 AM	0.00	0.33	0.33
1/25/13 11:00 AM	0.00	0.33	0.33
1/25/13 2:00 PM	0.00	0.35	0.35
1/25/13 5:00 PM	0.00	0.33	0.33
1/25/13 8:00 PM	0.00	0.32	0.32
1/25/13 11:00 PM	0.00	0.24	0.24
1/26/13 2:00 AM	0.00	0.23	0.23
1/26/13 5:00 AM	0.00	0.22	0.22
1/26/13 8:00 AM	0.00	0.21	0.21
1/26/13 11:00 AM	0.00	0.21	0.21
1/26/13 2:00 PM	0.00	0.22	0.22
1/26/13 5:00 PM	0.00	0.22	0.22
1/26/13 8:00 PM	0.00	0.20	0.20
1/26/13 11:00 PM	0.00	0.26	0.26
1/27/13 2:00 AM	0.00	0.29	0.29
1/27/13 5:00 AM	0.00	0.31	0.31
1/27/13 8:00 AM	0.00	0.35	0.35
1/27/13 11:00 AM	0.00	0.42	0.42
1/27/13 2:00 PM	0.00	0.36	0.36
1/27/13 5:00 PM	0.00	0.36	0.36
1/27/13 8:00 PM	0.00	0.39	0.39
1/27/13 11:00 PM	0.00	0.36	0.36
1/28/13 2:00 AM	0.00	0.36	0.36
1/28/13 5:00 AM	0.00	0.38	0.38
1/28/13 8:00 AM	0.00	0.42	0.42
1/28/13 11:00 AM	0.00	0.42	0.42
1/28/13 2:00 PM	0.00	0.47	0.47
1/28/13 5:00 PM	0.00	0.39	0.39
1/28/13 8:00 PM	0.00	0.43	0.43
1/28/13 11:00 PM	0.00	0.46	0.46
1/29/13 2:00 AM	0.00	0.40	0.40
1/29/13 5:00 AM	0.00	0.42	0.42
1/29/13 8:00 AM	0.00	0.46	0.46
1/29/13 11:00 AM	0.00	0.44	0.44
1/29/13 2:00 PM	0.00	0.37	0.37
1/29/13 5:00 PM	0.00	0.36	0.36
1/29/13 8:00 PM	0.00	0.42	0.42
1/29/13 11:00 PM	0.00	0.46	0.46
1/30/13 2:00 AM	0.00	0.43	0.43
1/30/13 5:00 AM	0.00	0.46	0.46
1/30/13 8:00 AM	0.00	0.48	0.48
1/30/13 11:00 AM	0.00	0.44	0.44
1/30/13 2:00 PM	0.00	0.44	0.44
1/30/13 5:00 PM	0.00	0.49	0.49
1/30/13 8:00 PM	0.00	0.42	0.42
1/30/13 11:00 PM	0.00	0.43	0.43
1/31/13 2:00 AM	0.00	0.58	0.58
1/31/13 5:00 AM	0.00	0.58	0.58
1/31/13 8:00 AM	0.00	0.61	0.61
1/31/13 11:00 AM	0.00	0.70	0.70
1/31/13 2:00 PM	0.00	0.57	0.57
1/31/13 5:00 PM	0.00	0.38	0.38

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
1/31/13 8:00 PM	0.00	0.37	0.37
1/31/13 11:00 PM	0.00	0.37	0.37
2/1/13 2:00 AM	0.00	0.37	0.37
2/1/13 5:00 AM	0.00	0.34	0.34
2/1/13 8:00 AM	0.00	0.25	0.25
2/1/13 11:00 AM	0.00	0.17	0.17
2/1/13 2:00 PM	0.00	0.26	0.26
2/1/13 5:00 PM	0.00	0.31	0.31
2/1/13 8:00 PM	0.00	0.33	0.33
2/1/13 11:00 PM	0.00	0.33	0.33
2/2/13 2:00 AM	0.00	0.33	0.33
2/2/13 5:00 AM	0.00	0.34	0.34
2/2/13 8:00 AM	0.00	0.32	0.32
2/2/13 11:00 AM	0.00	0.32	0.32
2/2/13 2:00 PM	0.00	0.29	0.29
2/2/13 5:00 PM	0.00	0.31	0.31
2/2/13 8:00 PM	0.00	0.32	0.32
2/2/13 11:00 PM	0.00	0.32	0.32
2/3/13 2:00 AM	0.00	0.33	0.33
2/3/13 5:00 AM	0.00	0.33	0.33
2/3/13 8:00 AM	0.00	0.32	0.32
2/3/13 11:00 AM	0.00	0.33	0.33
2/3/13 2:00 PM	0.00	0.31	0.31
2/3/13 5:00 PM	0.00	0.31	0.31
2/3/13 8:00 PM	0.00	0.31	0.31
2/3/13 11:00 PM	0.00	0.31	0.31
2/4/13 2:00 AM	0.00	0.31	0.31
2/4/13 5:00 AM	0.00	0.33	0.33
2/4/13 8:00 AM	0.00	0.25	0.25
2/4/13 11:00 AM	0.00	0.15	0.15
2/4/13 2:00 PM	0.00	0.15	0.15
2/4/13 5:00 PM	0.00	0.14	0.14
2/4/13 8:00 PM	0.00	0.15	0.15
2/4/13 11:00 PM	0.00	0.15	0.15
2/5/13 2:00 AM	0.00	0.17	0.17
2/5/13 5:00 AM	0.00	0.20	0.20
2/5/13 8:00 AM	0.00	0.31	0.31
2/5/13 11:00 AM	0.00	0.46	0.46
2/5/13 2:00 PM	0.00	0.24	0.24
2/5/13 5:00 PM	0.00	0.18	0.18
2/5/13 8:00 PM	0.00	0.22	0.22
2/5/13 11:00 PM	0.00	0.25	0.25
2/6/13 2:00 AM	0.00	0.29	0.29
2/6/13 5:00 AM	0.00	0.26	0.26
2/6/13 8:00 AM	0.00	0.24	0.24
2/6/13 11:00 AM	0.00	0.22	0.22
2/6/13 2:00 PM	0.00	0.19	0.19
2/6/13 5:00 PM	0.00	0.22	0.22
2/6/13 8:00 PM	0.00	0.24	0.24
2/6/13 11:00 PM	0.00	0.22	0.22
2/7/13 2:00 AM	0.00	0.22	0.22
2/7/13 5:00 AM	0.00	0.41	0.41
2/7/13 8:00 AM	0.00	0.40	0.40
2/7/13 11:00 AM	0.00	0.40	0.40

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
2/7/13 2:00 PM	0.00	0.32	0.32
2/7/13 5:00 PM	0.00	0.18	0.18
2/7/13 8:00 PM	0.00	0.21	0.21
2/7/13 11:00 PM	0.00	0.22	0.22
2/8/13 2:00 AM	0.00	0.24	0.24
2/8/13 5:00 AM	0.00	0.26	0.26
2/8/13 8:00 AM	0.00	0.27	0.27
2/8/13 11:00 AM	0.00	0.24	0.24
2/8/13 2:00 PM	0.00	0.26	0.26
2/8/13 5:00 PM	0.00	0.28	0.28
2/8/13 8:00 PM	0.00	0.27	0.27
2/8/13 11:00 PM	0.00	0.28	0.28
2/9/13 2:00 AM	0.00	0.28	0.28
2/9/13 5:00 AM	0.00	0.29	0.29
2/9/13 8:00 AM	0.00	0.27	0.27
2/9/13 11:00 AM	0.00	0.26	0.26
2/9/13 2:00 PM	0.00	0.24	0.24
2/9/13 5:00 PM	0.00	0.23	0.23
2/9/13 8:00 PM	0.00	0.22	0.22
2/9/13 11:00 PM	0.17	0.23	0.40
2/10/13 2:00 AM	0.43	0.25	0.68
2/10/13 5:00 AM	0.23	0.24	0.47
2/10/13 8:00 AM	0.30	0.25	0.56
2/10/13 11:00 AM	0.04	0.25	0.29
2/10/13 2:00 PM	0.05	0.23	0.28
2/10/13 5:00 PM	0.28	0.21	0.49
2/10/13 8:00 PM	0.24	0.23	0.47
2/10/13 11:00 PM	0.01	0.25	0.26
2/11/13 2:00 AM	0.00	0.23	0.23
2/11/13 5:00 AM	0.00	0.24	0.24
2/11/13 8:00 AM	0.00	0.26	0.26
2/11/13 11:00 AM	0.00	0.25	0.25
2/11/13 2:00 PM	0.21	0.24	0.45
2/11/13 5:00 PM	0.45	0.24	0.69
2/11/13 8:00 PM	0.39	0.24	0.63
2/11/13 11:00 PM	0.38	0.22	0.60
2/12/13 2:00 AM	0.40	0.22	0.61
2/12/13 5:00 AM	0.40	0.21	0.62
2/12/13 8:00 AM	0.41	0.17	0.58
2/12/13 11:00 AM	0.41	0.17	0.58
2/12/13 2:00 PM	0.46	0.18	0.64
2/12/13 5:00 PM	0.45	0.18	0.63
2/12/13 8:00 PM	0.51	0.22	0.73
2/12/13 11:00 PM	0.52	0.26	0.78
2/13/13 2:00 AM	0.51	0.46	0.97
2/13/13 5:00 AM	0.61	0.46	1.07
2/13/13 8:00 AM	0.66	0.50	1.16
2/13/13 11:00 AM	0.85	0.60	1.44
2/13/13 2:00 PM	0.86	0.63	1.49
2/13/13 5:00 PM	1.07	0.64	1.71
2/13/13 8:00 PM	1.24	0.59	1.83
2/13/13 11:00 PM	1.04	0.14	1.18
2/14/13 2:00 AM	1.21	0.13	1.33
2/14/13 5:00 AM	1.34	0.14	1.48

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
2/14/13 8:00 AM	1.28	0.16	1.44
2/14/13 11:00 AM	0.66	0.18	0.84
2/14/13 2:00 PM	0.58	0.30	0.88
2/14/13 5:00 PM	0.62	0.43	1.06
2/14/13 8:00 PM	0.76	0.33	1.09
2/14/13 11:00 PM	0.79	0.33	1.12
2/15/13 2:00 AM	0.80	0.37	1.17
2/15/13 5:00 AM	0.74	0.36	1.10
2/15/13 8:00 AM	0.73	0.54	1.27
2/15/13 11:00 AM	0.64	0.41	1.06
2/15/13 2:00 PM	0.59	0.23	0.82
2/15/13 5:00 PM	0.52	0.16	0.68
2/15/13 8:00 PM	0.41	0.21	0.62
2/15/13 11:00 PM	0.40	0.25	0.65
2/16/13 2:00 AM	0.45	0.25	0.70
2/16/13 5:00 AM	0.49	0.21	0.70
2/16/13 8:00 AM	0.60	0.16	0.76
2/16/13 11:00 AM	0.57	0.18	0.75
2/16/13 2:00 PM	0.56	0.20	0.77
2/16/13 5:00 PM	0.57	0.19	0.76
2/16/13 8:00 PM	0.47	0.16	0.63
2/16/13 11:00 PM	0.49	0.15	0.63
2/17/13 2:00 AM	0.54	0.15	0.69
2/17/13 5:00 AM	0.53	0.15	0.68
2/17/13 8:00 AM	0.24	0.17	0.41
2/17/13 11:00 AM	0.27	0.20	0.48
2/17/13 2:00 PM	0.24	0.24	0.47
2/17/13 5:00 PM	0.23	0.26	0.49
2/17/13 8:00 PM	0.19	0.27	0.46
2/17/13 11:00 PM	0.35	0.27	0.62
2/18/13 2:00 AM	0.44	0.27	0.71
2/18/13 5:00 AM	0.45	0.27	0.72
2/18/13 8:00 AM	0.48	0.27	0.75
2/18/13 11:00 AM	0.47	0.27	0.74
2/18/13 2:00 PM	0.42	0.27	0.69
2/18/13 5:00 PM	0.30	0.26	0.56
2/18/13 8:00 PM	0.32	0.26	0.58
2/18/13 11:00 PM	0.33	0.24	0.57
2/19/13 2:00 AM	0.33	0.22	0.54
2/19/13 5:00 AM	0.33	0.21	0.54
2/19/13 8:00 AM	0.35	0.21	0.56
2/19/13 11:00 AM	0.15	0.21	0.37
2/19/13 2:00 PM	0.00	0.24	0.24
2/19/13 5:00 PM	0.00	0.26	0.26
2/19/13 8:00 PM	0.00	0.30	0.30
2/19/13 11:00 PM	0.00	0.36	0.36
2/20/13 2:00 AM	0.08	0.39	0.47
2/20/13 5:00 AM	0.12	0.43	0.56
2/20/13 8:00 AM	0.16	0.41	0.57
2/20/13 11:00 AM	0.22	0.34	0.56
2/20/13 2:00 PM	0.18	0.31	0.49
2/20/13 5:00 PM	0.21	0.35	0.56
2/20/13 8:00 PM	0.32	0.41	0.74
2/20/13 11:00 PM	0.49	0.46	0.94

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
2/21/13 2:00 AM	0.56	0.49	1.05
2/21/13 5:00 AM	0.60	0.44	1.04
2/21/13 8:00 AM	0.47	0.32	0.79
2/21/13 11:00 AM	0.35	0.25	0.61
2/21/13 2:00 PM	0.28	0.23	0.51
2/21/13 5:00 PM	0.31	0.20	0.51
2/21/13 8:00 PM	0.31	0.17	0.48
2/21/13 11:00 PM	0.30	0.11	0.40
2/22/13 2:00 AM	0.33	0.10	0.42
2/22/13 5:00 AM	0.35	0.09	0.45
2/22/13 8:00 AM	0.37	0.15	0.52
2/22/13 11:00 AM	0.32	0.17	0.49
2/22/13 2:00 PM	0.46	0.16	0.63
2/22/13 5:00 PM	0.41	0.18	0.59
2/22/13 8:00 PM	0.54	0.21	0.75
2/22/13 11:00 PM	0.61	0.24	0.84
2/23/13 2:00 AM	0.60	0.24	0.85
2/23/13 5:00 AM	0.55	0.23	0.78
2/23/13 8:00 AM	0.54	0.27	0.81
2/23/13 11:00 AM	0.33	0.30	0.62
2/23/13 2:00 PM	0.53	0.31	0.84
2/23/13 5:00 PM	0.60	0.31	0.91
2/23/13 8:00 PM	0.64	0.32	0.96
2/23/13 11:00 PM	0.82	0.34	1.16
2/24/13 2:00 AM	0.59	0.35	0.94
2/24/13 5:00 AM	0.59	0.33	0.92
2/24/13 8:00 AM	0.60	0.33	0.93
2/24/13 11:00 AM	0.64	0.33	0.97
2/24/13 2:00 PM	0.69	0.35	1.04
2/24/13 5:00 PM	0.72	0.36	1.09
2/24/13 8:00 PM	0.69	0.37	1.06
2/24/13 11:00 PM	0.64	0.40	1.03
2/25/13 2:00 AM	0.60	0.40	1.00
2/25/13 5:00 AM	0.58	0.40	0.98
2/25/13 8:00 AM	0.59	0.39	0.98
2/25/13 11:00 AM	0.63	0.39	1.02
2/25/13 2:00 PM	0.65	0.34	0.99
2/25/13 5:00 PM	0.60	0.32	0.92
2/25/13 8:00 PM	0.57	0.32	0.89
2/25/13 11:00 PM	0.52	0.31	0.83
2/26/13 2:00 AM	0.53	0.32	0.85
2/26/13 5:00 AM	0.54	0.33	0.87
2/26/13 8:00 AM	0.55	0.34	0.89
2/26/13 11:00 AM	0.55	0.35	0.90
2/26/13 2:00 PM	0.57	0.33	0.90
2/26/13 5:00 PM	0.58	0.35	0.94
2/26/13 8:00 PM	0.56	0.29	0.86
2/26/13 11:00 PM	0.64	0.32	0.95
2/27/13 2:00 AM	0.53	0.29	0.82
2/27/13 5:00 AM	0.53	0.25	0.77
2/27/13 8:00 AM	0.53	0.24	0.77
2/27/13 11:00 AM	0.41	0.25	0.66
2/27/13 2:00 PM	0.42	0.19	0.61
2/27/13 5:00 PM	0.44	0.15	0.59

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
2/27/13 8:00 PM	0.45	0.14	0.59
2/27/13 11:00 PM	0.46	0.15	0.61
2/28/13 2:00 AM	0.44	0.17	0.61
2/28/13 5:00 AM	0.42	0.17	0.58
2/28/13 8:00 AM	0.43	0.20	0.63
2/28/13 11:00 AM	0.48	0.19	0.67
2/28/13 2:00 PM	0.62	0.18	0.81
2/28/13 5:00 PM	1.07	0.17	1.24
2/28/13 8:00 PM	0.82	0.16	0.98
2/28/13 11:00 PM	0.68	0.15	0.84
3/1/13 2:00 AM	0.69	0.15	0.84
3/1/13 5:00 AM	0.65	0.16	0.81
3/1/13 8:00 AM	0.68	0.38	1.07
3/1/13 11:00 AM	0.66	0.44	1.10
3/1/13 2:00 PM	0.65	0.14	0.79
3/1/13 5:00 PM	0.73	0.07	0.80
3/1/13 8:00 PM	0.59	0.00	0.59
3/1/13 11:00 PM	0.62	0.00	0.62
3/2/13 2:00 AM	0.65	0.00	0.65
3/2/13 5:00 AM	0.64	0.00	0.64
3/2/13 8:00 AM	0.68	0.00	0.68
3/2/13 11:00 AM	0.67	0.00	0.67
3/2/13 2:00 PM	0.66	0.00	0.66
3/2/13 5:00 PM	0.73	0.00	0.73
3/2/13 8:00 PM	0.63	0.00	0.63
3/2/13 11:00 PM	0.65	0.00	0.65
3/3/13 2:00 AM	0.62	0.00	0.62
3/3/13 5:00 AM	0.59	0.00	0.59
3/3/13 8:00 AM	0.51	0.00	0.51
3/3/13 11:00 AM	0.53	0.00	0.53
3/3/13 2:00 PM	0.52	0.00	0.52
3/3/13 5:00 PM	0.54	0.00	0.54
3/3/13 8:00 PM	0.57	0.00	0.57
3/3/13 11:00 PM	0.57	0.00	0.57
3/4/13 2:00 AM	0.58	0.00	0.58
3/4/13 5:00 AM	0.58	0.00	0.58
3/4/13 8:00 AM	0.54	0.00	0.54
3/4/13 11:00 AM	0.66	0.00	0.66
3/4/13 2:00 PM	0.72	0.00	0.72
3/4/13 5:00 PM	0.71	0.00	0.71
3/4/13 8:00 PM	0.75	0.00	0.75
3/4/13 11:00 PM	0.78	0.00	0.78
3/5/13 2:00 AM	0.93	0.00	0.93
3/5/13 5:00 AM	0.85	0.00	0.85
3/5/13 8:00 AM	0.72	0.00	0.72
3/5/13 11:00 AM	0.76	0.00	0.76
3/5/13 2:00 PM	0.84	0.00	0.84
3/5/13 5:00 PM	0.89	0.00	0.89
3/5/13 8:00 PM	0.89	0.00	0.89
3/5/13 11:00 PM	0.80	0.00	0.80
3/6/13 2:00 AM	0.35	0.00	0.35
3/6/13 5:00 AM	0.42	0.00	0.42
3/6/13 8:00 AM	0.84	0.00	0.84
3/6/13 11:00 AM	0.85	0.00	0.85

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
3/6/13 2:00 PM	0.83	0.00	0.83
3/6/13 5:00 PM	0.87	0.00	0.87
3/6/13 8:00 PM	0.88	0.00	0.88
3/6/13 11:00 PM	0.86	0.00	0.86
3/7/13 2:00 AM	0.84	0.00	0.84
3/7/13 5:00 AM	0.83	0.00	0.83
3/7/13 8:00 AM	0.85	0.00	0.85
3/7/13 11:00 AM	0.81	0.00	0.81
3/7/13 2:00 PM	0.81	0.00	0.81
3/7/13 5:00 PM	0.88	0.00	0.88
3/7/13 8:00 PM	1.06	0.00	1.06
3/7/13 11:00 PM	1.00	0.00	1.00
3/8/13 2:00 AM	0.97	0.00	0.97
3/8/13 5:00 AM	0.99	0.00	0.99
3/8/13 8:00 AM	0.98	0.00	0.98
3/8/13 11:00 AM	0.94	0.00	0.94
3/8/13 2:00 PM	0.93	0.00	0.93
3/8/13 5:00 PM	0.98	0.00	0.98
3/8/13 8:00 PM	0.90	0.00	0.90
3/8/13 11:00 PM	0.82	0.00	0.82
3/9/13 2:00 AM	0.61	0.00	0.61
3/9/13 5:00 AM	0.60	0.00	0.60
3/9/13 8:00 AM	0.74	0.00	0.74
3/9/13 11:00 AM	0.89	0.00	0.89
3/9/13 2:00 PM	0.91	0.00	0.91
3/9/13 5:00 PM	0.94	0.00	0.94
3/9/13 8:00 PM	0.90	0.00	0.90
3/9/13 11:00 PM	0.78	0.00	0.78
3/10/13 2:00 AM	0.54	0.00	0.54
3/10/13 5:00 AM	0.49	0.00	0.49
3/10/13 8:00 AM	0.58	0.00	0.58
3/10/13 11:00 AM	0.75	0.00	0.75
3/10/13 2:00 PM	0.78	0.00	0.78
3/10/13 5:00 PM	0.90	0.00	0.90
3/10/13 8:00 PM	0.95	0.00	0.95
3/10/13 11:00 PM	0.95	0.00	0.95
3/11/13 2:00 AM	0.71	0.00	0.71
3/11/13 5:00 AM	0.83	0.00	0.83
3/11/13 8:00 AM	0.96	0.00	0.96
3/11/13 11:00 AM	0.96	0.00	0.96
3/11/13 2:00 PM	1.03	0.00	1.03
3/11/13 5:00 PM	0.94	0.00	0.94
3/11/13 8:00 PM	0.98	0.00	0.98
3/11/13 11:00 PM	0.65	0.00	0.65
3/12/13 2:00 AM	0.54	0.00	0.54
3/12/13 5:00 AM	0.58	0.00	0.58
3/12/13 8:00 AM	0.98	0.00	0.98
3/12/13 11:00 AM	1.00	0.00	1.00
3/12/13 2:00 PM	1.00	0.00	1.00
3/12/13 5:00 PM	0.94	0.00	0.94
3/12/13 8:00 PM	0.90	0.00	0.90
3/12/13 11:00 PM	0.85	0.00	0.85
3/13/13 2:00 AM	0.66	0.00	0.66
3/13/13 5:00 AM	0.65	0.00	0.65

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
3/13/13 8:00 AM	0.94	0.00	0.94
3/13/13 11:00 AM	0.89	0.00	0.89
3/13/13 2:00 PM	0.99	0.00	0.99
3/13/13 5:00 PM	0.92	0.00	0.92
3/13/13 8:00 PM	0.85	0.00	0.85
3/13/13 11:00 PM	0.37	0.00	0.37
3/14/13 2:00 AM	0.16	0.00	0.16
3/14/13 5:00 AM	0.18	0.00	0.18
3/14/13 8:00 AM	0.15	0.00	0.15
3/14/13 11:00 AM	0.22	0.00	0.22
3/14/13 2:00 PM	0.17	0.00	0.17
3/14/13 5:00 PM	0.17	0.00	0.17
3/14/13 8:00 PM	0.17	0.00	0.17
3/14/13 11:00 PM	0.19	0.00	0.19
3/15/13 2:00 AM	0.20	0.00	0.20
3/15/13 5:00 AM	0.20	0.00	0.20
3/15/13 8:00 AM	0.20	0.00	0.20
3/15/13 11:00 AM	0.18	0.00	0.18
3/15/13 2:00 PM	0.17	0.00	0.17
3/15/13 5:00 PM	0.17	0.00	0.17
3/15/13 8:00 PM	0.17	0.00	0.17
3/15/13 11:00 PM	0.17	0.00	0.17
3/16/13 2:00 AM	0.15	0.00	0.15
3/16/13 5:00 AM	0.17	0.00	0.17
3/16/13 8:00 AM	0.19	0.00	0.19
3/16/13 11:00 AM	0.18	0.00	0.18
3/16/13 2:00 PM	0.18	0.00	0.18
3/16/13 5:00 PM	0.18	0.00	0.18
3/16/13 8:00 PM	0.18	0.00	0.18
3/16/13 11:00 PM	0.22	0.00	0.22
3/17/13 2:00 AM	0.24	0.00	0.24
3/17/13 5:00 AM	0.23	0.00	0.23
3/17/13 8:00 AM	0.28	0.00	0.28
3/17/13 11:00 AM	0.65	0.00	0.65
3/17/13 2:00 PM	0.95	0.00	0.95
3/17/13 5:00 PM	1.02	0.00	1.02
3/17/13 8:00 PM	0.99	0.00	0.99
3/17/13 11:00 PM	0.78	0.00	0.78
3/18/13 2:00 AM	0.59	0.00	0.59
3/18/13 5:00 AM	0.85	0.00	0.85
3/18/13 8:00 AM	0.98	0.00	0.98
3/18/13 11:00 AM	0.89	0.00	0.89
3/18/13 2:00 PM	0.97	0.00	0.97
3/18/13 5:00 PM	1.10	0.00	1.10
3/18/13 8:00 PM	1.03	0.00	1.03
3/18/13 11:00 PM	1.00	0.00	1.00
3/19/13 2:00 AM	0.76	0.00	0.76
3/19/13 5:00 AM	0.93	0.00	0.93
3/19/13 8:00 AM	1.08	0.00	1.08
3/19/13 11:00 AM	1.09	0.00	1.09
3/19/13 2:00 PM	1.20	0.00	1.20
3/19/13 5:00 PM	1.09	0.00	1.09
3/19/13 8:00 PM	1.10	0.00	1.10
3/19/13 11:00 PM	0.64	0.00	0.64

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
3/20/13 2:00 AM	0.54	0.00	0.54
3/20/13 5:00 AM	0.67	0.00	0.67
3/20/13 8:00 AM	1.07	0.00	1.07
3/20/13 11:00 AM	1.07	0.00	1.07
3/20/13 2:00 PM	1.04	0.00	1.04
3/20/13 5:00 PM	0.98	0.00	0.98
3/20/13 8:00 PM	1.00	0.00	1.00
3/20/13 11:00 PM	0.73	0.00	0.73
3/21/13 2:00 AM	0.57	0.00	0.57
3/21/13 5:00 AM	0.71	0.00	0.71
3/21/13 8:00 AM	1.18	0.00	1.18
3/21/13 11:00 AM	0.99	0.00	0.99
3/21/13 2:00 PM	0.86	0.00	0.86
3/21/13 5:00 PM	0.85	0.00	0.85
3/21/13 8:00 PM	0.88	0.00	0.88
3/21/13 11:00 PM	0.89	0.00	0.89
3/22/13 2:00 AM	0.87	0.00	0.87
3/22/13 5:00 AM	0.88	0.00	0.88
3/22/13 8:00 AM	0.90	0.00	0.90
3/22/13 11:00 AM	0.92	0.00	0.92
3/22/13 2:00 PM	0.88	0.00	0.88
3/22/13 5:00 PM	0.90	0.00	0.90
3/22/13 8:00 PM	0.91	0.00	0.91
3/22/13 11:00 PM	0.61	0.00	0.61
3/23/13 2:00 AM	0.49	0.00	0.49
3/23/13 5:00 AM	0.49	0.00	0.49
3/23/13 8:00 AM	0.80	0.00	0.80
3/23/13 11:00 AM	0.93	0.00	0.93
3/23/13 2:00 PM	0.92	0.00	0.92
3/23/13 5:00 PM	0.94	0.00	0.94
3/23/13 8:00 PM	0.95	0.00	0.95
3/23/13 11:00 PM	0.62	0.00	0.62
3/24/13 2:00 AM	0.55	0.00	0.55
3/24/13 5:00 AM	0.54	0.00	0.54
3/24/13 8:00 AM	0.78	0.00	0.78
3/24/13 11:00 AM	1.00	0.00	1.00
3/24/13 2:00 PM	0.90	0.00	0.90
3/24/13 5:00 PM	0.98	0.00	0.98
3/24/13 8:00 PM	1.01	0.00	1.01
3/24/13 11:00 PM	0.95	0.00	0.95
3/25/13 2:00 AM	0.90	0.00	0.90
3/25/13 5:00 AM	1.02	0.00	1.02
3/25/13 8:00 AM	0.96	0.00	0.96
3/25/13 11:00 AM	1.11	0.00	1.11
3/25/13 2:00 PM	0.96	0.00	0.96
3/25/13 5:00 PM	0.95	0.00	0.95
3/25/13 8:00 PM	0.99	0.00	0.99
3/25/13 11:00 PM	0.96	0.00	0.96
3/26/13 2:00 AM	0.81	0.00	0.81
3/26/13 5:00 AM	0.93	0.00	0.93
3/26/13 8:00 AM	1.05	0.00	1.05
3/26/13 11:00 AM	1.05	0.00	1.05
3/26/13 2:00 PM	1.02	0.00	1.02
3/26/13 5:00 PM	1.03	0.00	1.03

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
3/26/13 8:00 PM	1.05	0.00	1.05
3/26/13 11:00 PM	1.06	0.00	1.06
3/27/13 2:00 AM	1.03	0.00	1.03
3/27/13 5:00 AM	1.04	0.00	1.04
3/27/13 8:00 AM	1.05	0.00	1.05
3/27/13 11:00 AM	1.11	0.00	1.11
3/27/13 2:00 PM	1.05	0.00	1.05
3/27/13 5:00 PM	1.01	0.00	1.01
3/27/13 8:00 PM	0.93	0.00	0.93
3/27/13 11:00 PM	0.85	0.00	0.85
3/28/13 2:00 AM	0.63	0.00	0.63
3/28/13 5:00 AM	0.91	0.00	0.91
3/28/13 8:00 AM	0.91	0.00	0.91
3/28/13 11:00 AM	0.98	0.00	0.98
3/28/13 2:00 PM	0.92	0.00	0.92
3/28/13 5:00 PM	0.88	0.00	0.88
3/28/13 8:00 PM	0.90	0.00	0.90
3/28/13 11:00 PM	0.74	0.00	0.74
3/29/13 2:00 AM	0.64	0.00	0.64
3/29/13 5:00 AM	0.94	0.00	0.94
3/29/13 8:00 AM	0.98	0.00	0.98
3/29/13 11:00 AM	0.90	0.00	0.90
3/29/13 2:00 PM	0.97	0.00	0.97
3/29/13 5:00 PM	0.97	0.00	0.97
3/29/13 8:00 PM	1.02	0.00	1.02
3/29/13 11:00 PM	0.82	0.00	0.82
3/30/13 2:00 AM	0.74	0.00	0.74
3/30/13 5:00 AM	0.71	0.00	0.71
3/30/13 8:00 AM	1.04	0.00	1.04
3/30/13 11:00 AM	1.01	0.00	1.01
3/30/13 2:00 PM	1.03	0.00	1.03
3/30/13 5:00 PM	0.95	0.00	0.95
3/30/13 8:00 PM	1.04	0.00	1.04
3/30/13 11:00 PM	0.79	0.00	0.79
3/31/13 2:00 AM	0.58	0.00	0.58
3/31/13 5:00 AM	0.52	0.00	0.52
3/31/13 8:00 AM	0.68	0.00	0.68
3/31/13 11:00 AM	0.89	0.00	0.89
3/31/13 2:00 PM	0.87	0.00	0.87
3/31/13 5:00 PM	0.90	0.00	0.90
3/31/13 8:00 PM	0.92	0.00	0.92
3/31/13 11:00 PM	0.73	0.00	0.73
4/1/13 2:00 AM	0.67	0.00	0.67
4/1/13 5:00 AM	0.71	0.00	0.71
4/1/13 8:00 AM	0.74	0.00	0.74
4/1/13 11:00 AM	0.72	0.00	0.72
4/1/13 2:00 PM	0.78	0.00	0.78
4/1/13 5:00 PM	0.82	0.00	0.82
4/1/13 8:00 PM	0.80	0.00	0.80
4/1/13 11:00 PM	0.78	0.00	0.78
4/2/13 2:00 AM	0.92	0.00	0.92
4/2/13 5:00 AM	0.83	0.00	0.83
4/2/13 8:00 AM	0.96	0.00	0.96
4/2/13 11:00 AM	0.89	0.00	0.89

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
4/2/13 2:00 PM	0.99	0.00	0.99
4/2/13 5:00 PM	0.94	0.00	0.94
4/2/13 8:00 PM	0.99	0.00	0.99
4/2/13 11:00 PM	0.88	0.00	0.88
4/3/13 2:00 AM	0.77	0.00	0.77
4/3/13 5:00 AM	0.84	0.00	0.84
4/3/13 8:00 AM	1.03	0.00	1.03
4/3/13 11:00 AM	0.94	0.00	0.94
4/3/13 2:00 PM	0.99	0.00	0.99
4/3/13 5:00 PM	0.97	0.00	0.97
4/3/13 8:00 PM	1.10	0.00	1.10
4/3/13 11:00 PM	1.02	0.00	1.02
4/4/13 2:00 AM	0.91	0.00	0.91
4/4/13 5:00 AM	0.93	0.00	0.93
4/4/13 8:00 AM	0.97	0.00	0.97
4/4/13 11:00 AM	1.00	0.00	1.00
4/4/13 2:00 PM	1.06	0.00	1.06
4/4/13 5:00 PM	0.97	0.00	0.97
4/4/13 8:00 PM	1.00	0.00	1.00
4/4/13 11:00 PM	0.87	0.00	0.87
4/5/13 2:00 AM	0.63	0.00	0.63
4/5/13 5:00 AM	0.81	0.00	0.81
4/5/13 8:00 AM	0.95	0.00	0.95
4/5/13 11:00 AM	0.94	0.00	0.94
4/5/13 2:00 PM	0.94	0.00	0.94
4/5/13 5:00 PM	0.97	0.00	0.97
4/5/13 8:00 PM	0.99	0.00	0.99
4/5/13 11:00 PM	0.97	0.00	0.97
4/6/13 2:00 AM	0.89	0.00	0.89
4/6/13 5:00 AM	0.83	0.00	0.83
4/6/13 8:00 AM	0.91	0.00	0.91
4/6/13 11:00 AM	0.99	0.00	0.99
4/6/13 2:00 PM	0.97	0.00	0.97
4/6/13 5:00 PM	0.95	0.00	0.95
4/6/13 8:00 PM	1.01	0.00	1.01
4/6/13 11:00 PM	0.94	0.00	0.94
4/7/13 2:00 AM	0.88	0.00	0.88
4/7/13 5:00 AM	0.89	0.00	0.89
4/7/13 8:00 AM	0.86	0.00	0.86
4/7/13 11:00 AM	0.95	0.00	0.95
4/7/13 2:00 PM	0.90	0.00	0.90
4/7/13 5:00 PM	0.90	0.00	0.90
4/7/13 8:00 PM	0.95	0.00	0.95
4/7/13 11:00 PM	0.93	0.00	0.93
4/8/13 2:00 AM	0.77	0.00	0.77
4/8/13 5:00 AM	0.89	0.00	0.89
4/8/13 8:00 AM	0.96	0.00	0.96
4/8/13 11:00 AM	0.93	0.00	0.93
4/8/13 2:00 PM	0.98	0.00	0.98
4/8/13 5:00 PM	0.96	0.00	0.96
4/8/13 8:00 PM	1.04	0.00	1.04
4/8/13 11:00 PM	0.98	0.00	0.98
4/9/13 2:00 AM	0.88	0.00	0.88
4/9/13 5:00 AM	0.93	0.00	0.93

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
4/9/13 8:00 AM	1.03	0.00	1.03
4/9/13 11:00 AM	0.98	0.00	0.98
4/9/13 2:00 PM	0.99	0.00	0.99
4/9/13 5:00 PM	0.99	0.00	0.99
4/9/13 8:00 PM	0.94	0.00	0.94
4/9/13 11:00 PM	0.85	0.00	0.85
4/10/13 2:00 AM	0.68	0.00	0.68
4/10/13 5:00 AM	0.83	0.00	0.83
4/10/13 8:00 AM	1.00	0.00	1.00
4/10/13 11:00 AM	1.01	0.00	1.01
4/10/13 2:00 PM	1.08	0.00	1.08
4/10/13 5:00 PM	1.08	0.00	1.08
4/10/13 8:00 PM	1.00	0.00	1.00
4/10/13 11:00 PM	0.96	0.00	0.96
4/11/13 2:00 AM	0.88	0.00	0.88
4/11/13 5:00 AM	0.93	0.00	0.93
4/11/13 8:00 AM	0.97	0.00	0.97
4/11/13 11:00 AM	0.91	0.00	0.91
4/11/13 2:00 PM	0.90	0.00	0.90
4/11/13 5:00 PM	0.89	0.00	0.89
4/11/13 8:00 PM	0.83	0.00	0.83
4/11/13 11:00 PM	0.80	0.00	0.80
4/12/13 2:00 AM	0.84	0.00	0.84
4/12/13 5:00 AM	0.85	0.00	0.85
4/12/13 8:00 AM	0.86	0.00	0.86
4/12/13 11:00 AM	0.85	0.00	0.85
4/12/13 2:00 PM	0.83	0.00	0.83
4/12/13 5:00 PM	0.85	0.00	0.85
4/12/13 8:00 PM	0.89	0.00	0.89
4/12/13 11:00 PM	0.88	0.00	0.88
4/13/13 2:00 AM	0.86	0.00	0.86
4/13/13 5:00 AM	0.88	0.00	0.88
4/13/13 8:00 AM	0.89	0.00	0.89
4/13/13 11:00 AM	0.93	0.00	0.93
4/13/13 2:00 PM	0.89	0.00	0.89
4/13/13 5:00 PM	0.83	0.00	0.83
4/13/13 8:00 PM	0.81	0.00	0.81
4/13/13 11:00 PM	0.89	0.00	0.89
4/14/13 2:00 AM	0.83	0.00	0.83
4/14/13 5:00 AM	0.93	0.00	0.93
4/14/13 8:00 AM	0.95	0.00	0.95
4/14/13 11:00 AM	0.98	0.00	0.98
4/14/13 2:00 PM	1.00	0.00	1.00
4/14/13 5:00 PM	1.04	0.00	1.04
4/14/13 8:00 PM	1.06	0.00	1.06
4/14/13 11:00 PM	0.94	0.00	0.94
4/15/13 2:00 AM	0.87	0.00	0.87
4/15/13 5:00 AM	0.82	0.00	0.82
4/15/13 8:00 AM	0.96	0.00	0.96
4/15/13 11:00 AM	1.07	0.00	1.07
4/15/13 2:00 PM	1.09	0.00	1.09
4/15/13 5:00 PM	0.92	0.00	0.92
4/15/13 8:00 PM	0.91	0.00	0.91
4/15/13 11:00 PM	0.91	0.00	0.91

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
4/16/13 2:00 AM	0.95	0.00	0.95
4/16/13 5:00 AM	1.02	0.00	1.02
4/16/13 8:00 AM	1.03	0.00	1.03
4/16/13 11:00 AM	1.02	0.00	1.02
4/16/13 2:00 PM	1.07	0.00	1.07
4/16/13 5:00 PM	1.04	0.00	1.04
4/16/13 8:00 PM	1.06	0.00	1.06
4/16/13 11:00 PM	1.05	0.00	1.05
4/17/13 2:00 AM	0.87	0.00	0.87
4/17/13 5:00 AM	1.04	0.00	1.04
4/17/13 8:00 AM	1.09	0.00	1.09
4/17/13 11:00 AM	1.06	0.00	1.06
4/17/13 2:00 PM	1.03	0.00	1.03
4/17/13 5:00 PM	1.10	0.00	1.10
4/17/13 8:00 PM	1.01	0.00	1.01
4/17/13 11:00 PM	1.06	0.00	1.06
4/18/13 2:00 AM	1.04	0.00	1.04
4/18/13 5:00 AM	1.04	0.00	1.04
4/18/13 8:00 AM	1.27	0.00	1.27
4/18/13 11:00 AM	1.40	0.00	1.40
4/18/13 2:00 PM	1.21	0.00	1.21
4/18/13 5:00 PM	1.30	0.00	1.30
4/18/13 8:00 PM	1.14	0.00	1.14
4/18/13 11:00 PM	1.22	0.00	1.22
4/19/13 2:00 AM	1.17	0.00	1.17
4/19/13 5:00 AM	1.20	0.00	1.20
4/19/13 8:00 AM	1.22	0.00	1.22
4/19/13 11:00 AM	1.33	0.00	1.33
4/19/13 2:00 PM	1.15	0.00	1.15
4/19/13 5:00 PM	1.00	0.00	1.00
4/19/13 8:00 PM	0.83	0.00	0.83
4/19/13 11:00 PM	0.74	0.00	0.74
4/20/13 2:00 AM	0.66	0.00	0.66
4/20/13 5:00 AM	0.66	0.00	0.66
4/20/13 8:00 AM	0.69	0.00	0.69
4/20/13 11:00 AM	0.68	0.00	0.68
4/20/13 2:00 PM	0.69	0.00	0.69
4/20/13 5:00 PM	0.68	0.00	0.68
4/20/13 8:00 PM	0.75	0.00	0.75
4/20/13 11:00 PM	0.76	0.00	0.76
4/21/13 2:00 AM	0.74	0.00	0.74
4/21/13 5:00 AM	0.76	0.00	0.76
4/21/13 8:00 AM	0.74	0.00	0.74
4/21/13 11:00 AM	0.73	0.00	0.73
4/21/13 2:00 PM	0.71	0.00	0.71
4/21/13 5:00 PM	0.69	0.00	0.69
4/21/13 8:00 PM	0.66	0.00	0.66
4/21/13 11:00 PM	0.68	0.00	0.68
4/22/13 2:00 AM	0.70	0.00	0.70
4/22/13 5:00 AM	0.68	0.00	0.68
4/22/13 8:00 AM	0.68	0.00	0.68
4/22/13 11:00 AM	0.63	0.00	0.63
4/22/13 2:00 PM	0.44	0.00	0.44
4/22/13 5:00 PM	0.66	0.00	0.66

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
4/22/13 8:00 PM	0.69	0.00	0.69
4/22/13 11:00 PM	0.31	0.00	0.31
4/23/13 2:00 AM	0.31	0.00	0.31
4/23/13 5:00 AM	0.25	0.00	0.25
4/23/13 8:00 AM	0.31	0.00	0.31
4/23/13 11:00 AM	0.25	0.00	0.25
4/23/13 2:00 PM	0.25	0.00	0.25
4/23/13 5:00 PM	0.24	0.00	0.24
4/23/13 8:00 PM	0.28	0.00	0.28
4/23/13 11:00 PM	0.24	0.00	0.24
4/24/13 2:00 AM	0.18	0.00	0.18
4/24/13 5:00 AM	0.17	0.00	0.17
4/24/13 8:00 AM	0.18	0.00	0.18
4/24/13 11:00 AM	0.18	0.00	0.18
4/24/13 2:00 PM	0.18	0.00	0.18
4/24/13 5:00 PM	0.18	0.00	0.18
4/24/13 8:00 PM	0.19	0.00	0.19
4/24/13 11:00 PM	0.19	0.00	0.19
4/25/13 2:00 AM	0.11	0.00	0.11
4/25/13 5:00 AM	0.18	0.00	0.18
4/25/13 8:00 AM	0.21	0.00	0.21
4/25/13 11:00 AM	0.21	0.00	0.21
4/25/13 2:00 PM	0.21	0.00	0.21
4/25/13 5:00 PM	0.21	0.00	0.21
4/25/13 8:00 PM	0.21	0.00	0.21
4/25/13 11:00 PM	0.20	0.00	0.20
4/26/13 2:00 AM	0.21	0.00	0.21
4/26/13 5:00 AM	0.19	0.00	0.19
4/26/13 8:00 AM	0.19	0.00	0.19
4/26/13 11:00 AM	0.18	0.00	0.18
4/26/13 2:00 PM	0.20	0.00	0.20
4/26/13 5:00 PM	0.20	0.00	0.20
4/26/13 8:00 PM	0.21	0.00	0.21
4/26/13 11:00 PM	0.21	0.00	0.21
4/27/13 2:00 AM	0.20	0.00	0.20
4/27/13 5:00 AM	0.19	0.00	0.19
4/27/13 8:00 AM	0.19	0.00	0.19
4/27/13 11:00 AM	0.20	0.00	0.20
4/27/13 2:00 PM	0.21	0.00	0.21
4/27/13 5:00 PM	0.21	0.00	0.21
4/27/13 8:00 PM	0.21	0.00	0.21
4/27/13 11:00 PM	0.20	0.00	0.20
4/28/13 2:00 AM	0.00	0.00	0.00
4/28/13 5:00 AM	0.00	0.00	0.00
4/28/13 8:00 AM	0.00	0.00	0.00
4/28/13 11:00 AM	0.00	0.00	0.00
4/28/13 2:00 PM	0.00	0.00	0.00
4/28/13 5:00 PM	0.00	0.00	0.00
4/28/13 8:00 PM	0.00	0.00	0.00
4/28/13 11:00 PM	0.00	0.00	0.00
4/29/13 2:00 AM	0.01	0.00	0.01
4/29/13 5:00 AM	0.05	0.00	0.05
4/29/13 8:00 AM	0.17	0.00	0.17
4/29/13 11:00 AM	0.19	0.00	0.19

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
4/29/13 2:00 PM	0.18	0.00	0.18
4/29/13 5:00 PM	0.19	0.00	0.19
4/29/13 8:00 PM	0.24	0.00	0.24
4/29/13 11:00 PM	0.25	0.00	0.25
4/30/13 2:00 AM	0.24	0.00	0.24
4/30/13 5:00 AM	0.25	0.00	0.25
4/30/13 8:00 AM	0.25	0.00	0.25
4/30/13 11:00 AM	0.25	0.00	0.25
4/30/13 2:00 PM	0.28	0.00	0.28
4/30/13 5:00 PM	0.41	0.00	0.41
4/30/13 8:00 PM	0.24	0.00	0.24
4/30/13 11:00 PM	0.24	0.00	0.24
5/1/13 2:00 AM	0.51	0.00	0.51
5/1/13 5:00 AM	0.65	0.00	0.65
5/1/13 8:00 AM	1.02	0.00	1.02
5/1/13 11:00 AM	0.46	0.00	0.46
5/1/13 2:00 PM	0.23	0.00	0.23
5/1/13 5:00 PM	0.21	0.00	0.21
5/1/13 8:00 PM	0.17	0.00	0.17
5/1/13 11:00 PM	0.11	0.00	0.11
5/2/13 2:00 AM	0.11	0.00	0.11
5/2/13 5:00 AM	0.14	0.00	0.14
5/2/13 8:00 AM	0.23	0.00	0.23
5/2/13 11:00 AM	0.24	0.00	0.24
5/2/13 2:00 PM	0.25	0.00	0.25
5/2/13 5:00 PM	0.23	0.00	0.23
5/2/13 8:00 PM	0.24	0.00	0.24
5/2/13 11:00 PM	0.24	0.00	0.24
5/3/13 2:00 AM	0.22	0.00	0.22
5/3/13 5:00 AM	0.57	0.00	0.57
5/3/13 8:00 AM	0.70	0.00	0.70
5/3/13 11:00 AM	1.22	0.00	1.22
5/3/13 2:00 PM	1.14	0.00	1.14
5/3/13 5:00 PM	0.99	0.00	0.99
5/3/13 8:00 PM	0.99	0.00	0.99
5/3/13 11:00 PM	0.71	0.00	0.71
5/4/13 2:00 AM	0.53	0.00	0.53
5/4/13 5:00 AM	0.77	0.00	0.77
5/4/13 8:00 AM	1.07	0.00	1.07
5/4/13 11:00 AM	0.93	0.00	0.93
5/4/13 2:00 PM	0.93	0.00	0.93
5/4/13 5:00 PM	0.92	0.00	0.92
5/4/13 8:00 PM	0.94	0.00	0.94
5/4/13 11:00 PM	1.00	0.00	1.00
5/5/13 2:00 AM	0.96	0.00	0.96
5/5/13 5:00 AM	0.86	0.00	0.86
5/5/13 8:00 AM	0.84	0.00	0.84
5/5/13 11:00 AM	0.95	0.00	0.95
5/5/13 2:00 PM	0.94	0.00	0.94
5/5/13 5:00 PM	0.94	0.00	0.94
5/5/13 8:00 PM	0.95	0.00	0.95
5/5/13 11:00 PM	0.75	0.00	0.75
5/6/13 2:00 AM	0.38	0.00	0.38
5/6/13 5:00 AM	0.76	0.00	0.76

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
5/6/13 8:00 AM	0.98	0.00	0.98
5/6/13 11:00 AM	0.93	0.00	0.93
5/6/13 2:00 PM	0.95	0.00	0.95
5/6/13 5:00 PM	0.99	0.00	0.99
5/6/13 8:00 PM	0.96	0.00	0.96
5/6/13 11:00 PM	0.91	0.00	0.91
5/7/13 2:00 AM	0.59	0.00	0.59
5/7/13 5:00 AM	0.62	0.00	0.62
5/7/13 8:00 AM	0.92	0.00	0.92
5/7/13 11:00 AM	0.98	0.00	0.98
5/7/13 2:00 PM	1.02	0.00	1.02
5/7/13 5:00 PM	1.00	0.00	1.00
5/7/13 8:00 PM	0.91	0.00	0.91
5/7/13 11:00 PM	0.90	0.00	0.90
5/8/13 2:00 AM	0.73	0.00	0.73
5/8/13 5:00 AM	0.68	0.00	0.68
5/8/13 8:00 AM	0.19	0.00	0.19
5/8/13 11:00 AM	0.17	0.00	0.17
5/8/13 2:00 PM	0.18	0.00	0.18
5/8/13 5:00 PM	0.17	0.00	0.17
5/8/13 8:00 PM	0.18	0.00	0.18
5/8/13 11:00 PM	0.16	0.00	0.16
5/9/13 2:00 AM	0.16	0.00	0.16
5/9/13 5:00 AM	0.20	0.00	0.20
5/9/13 8:00 AM	0.21	0.00	0.21
5/9/13 11:00 AM	0.19	0.00	0.19
5/9/13 2:00 PM	0.19	0.00	0.19
5/9/13 5:00 PM	0.48	0.00	0.48
5/9/13 8:00 PM	0.75	0.00	0.75
5/9/13 11:00 PM	1.06	0.00	1.06
5/10/13 2:00 AM	0.88	0.00	0.88
5/10/13 5:00 AM	0.94	0.00	0.94
5/10/13 8:00 AM	1.01	0.00	1.01
5/10/13 11:00 AM	1.03	0.00	1.03
5/10/13 2:00 PM	1.02	0.00	1.02
5/10/13 5:00 PM	1.04	0.00	1.04
5/10/13 8:00 PM	0.99	0.00	0.99
5/10/13 11:00 PM	0.96	0.00	0.96
5/11/13 2:00 AM	0.98	0.00	0.98
5/11/13 5:00 AM	0.94	0.00	0.94
5/11/13 8:00 AM	0.93	0.00	0.93
5/11/13 11:00 AM	0.91	0.00	0.91
5/11/13 2:00 PM	0.93	0.00	0.93
5/11/13 5:00 PM	0.92	0.00	0.92
5/11/13 8:00 PM	0.92	0.00	0.92
5/11/13 11:00 PM	0.89	0.00	0.89
5/12/13 2:00 AM	0.91	0.00	0.91
5/12/13 5:00 AM	0.85	0.00	0.85
5/12/13 8:00 AM	0.91	0.00	0.91
5/12/13 11:00 AM	0.92	0.00	0.92
5/12/13 2:00 PM	0.91	0.00	0.91
5/12/13 5:00 PM	0.92	0.00	0.92
5/12/13 8:00 PM	0.93	0.00	0.93
5/12/13 11:00 PM	0.92	0.00	0.92

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
5/13/13 2:00 AM	0.93	0.00	0.93
5/13/13 5:00 AM	0.93	0.00	0.93
5/13/13 8:00 AM	0.83	0.00	0.83
5/13/13 11:00 AM	0.84	0.00	0.84
5/13/13 2:00 PM	0.79	0.00	0.79
5/13/13 5:00 PM	0.84	0.00	0.84
5/13/13 8:00 PM	0.82	0.00	0.82
5/13/13 11:00 PM	0.83	0.00	0.83
5/14/13 2:00 AM	0.64	0.00	0.64
5/14/13 5:00 AM	0.75	0.00	0.75
5/14/13 8:00 AM	0.87	0.00	0.87
5/14/13 11:00 AM	0.90	0.00	0.90
5/14/13 2:00 PM	0.98	0.00	0.98
5/14/13 5:00 PM	0.94	0.00	0.94
5/14/13 8:00 PM	0.95	0.00	0.95
5/14/13 11:00 PM	0.60	0.00	0.60
5/15/13 2:00 AM	0.56	0.00	0.56
5/15/13 5:00 AM	0.55	0.00	0.55
5/15/13 8:00 AM	0.86	0.00	0.86
5/15/13 11:00 AM	1.03	0.00	1.03
5/15/13 2:00 PM	1.03	0.00	1.03
5/15/13 5:00 PM	0.99	0.00	0.99
5/15/13 8:00 PM	0.93	0.00	0.93
5/15/13 11:00 PM	0.59	0.00	0.59
5/16/13 2:00 AM	0.52	0.00	0.52
5/16/13 5:00 AM	0.65	0.00	0.65
5/16/13 8:00 AM	0.97	0.00	0.97
5/16/13 11:00 AM	0.70	0.00	0.70
5/16/13 2:00 PM	0.27	0.00	0.27
5/16/13 5:00 PM	0.21	0.00	0.21
5/16/13 8:00 PM	0.19	0.00	0.19
5/16/13 11:00 PM	0.22	0.00	0.22
5/17/13 2:00 AM	0.62	0.00	0.62
5/17/13 5:00 AM	0.65	0.00	0.65
5/17/13 8:00 AM	1.08	0.00	1.08
5/17/13 11:00 AM	1.06	0.00	1.06
5/17/13 2:00 PM	1.01	0.00	1.01
5/17/13 5:00 PM	1.08	0.00	1.08
5/17/13 8:00 PM	1.08	0.00	1.08
5/17/13 11:00 PM	0.73	0.00	0.73
5/18/13 2:00 AM	0.72	0.00	0.72
5/18/13 5:00 AM	0.75	0.00	0.75
5/18/13 8:00 AM	1.07	0.00	1.07
5/18/13 11:00 AM	1.03	0.00	1.03
5/18/13 2:00 PM	0.98	0.00	0.98
5/18/13 5:00 PM	1.03	0.00	1.03
5/18/13 8:00 PM	0.98	0.00	0.98
5/18/13 11:00 PM	1.00	0.00	1.00
5/19/13 2:00 AM	0.98	0.00	0.98
5/19/13 5:00 AM	1.00	0.00	1.00
5/19/13 8:00 AM	1.04	0.00	1.04
5/19/13 11:00 AM	1.04	0.00	1.04
5/19/13 2:00 PM	1.03	0.00	1.03
5/19/13 5:00 PM	1.01	0.00	1.01

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
5/19/13 8:00 PM	1.00	0.00	1.00
5/19/13 11:00 PM	1.06	0.00	1.06
5/20/13 2:00 AM	1.06	0.00	1.06
5/20/13 5:00 AM	1.05	0.00	1.05
5/20/13 8:00 AM	1.02	0.00	1.02
5/20/13 11:00 AM	1.04	0.00	1.04
5/20/13 2:00 PM	1.06	0.00	1.06
5/20/13 5:00 PM	0.98	0.00	0.98
5/20/13 8:00 PM	1.02	0.00	1.02
5/20/13 11:00 PM	1.01	0.00	1.01
5/21/13 2:00 AM	1.00	0.00	1.00
5/21/13 5:00 AM	0.97	0.00	0.97
5/21/13 8:00 AM	0.98	0.00	0.98
5/21/13 11:00 AM	0.96	0.00	0.96
5/21/13 2:00 PM	0.96	0.01	0.97
5/21/13 5:00 PM	0.96	0.06	1.02
5/21/13 8:00 PM	0.99	0.02	1.01
5/21/13 11:00 PM	0.98	0.07	1.05
5/22/13 2:00 AM	0.80	0.14	0.94
5/22/13 5:00 AM	0.87	0.15	1.02
5/22/13 8:00 AM	1.04	0.15	1.19
5/22/13 11:00 AM	1.00	0.21	1.22
5/22/13 2:00 PM	1.03	0.19	1.22
5/22/13 5:00 PM	1.04	0.42	1.45
5/22/13 8:00 PM	1.08	0.45	1.53
5/22/13 11:00 PM	1.06	0.33	1.40
5/23/13 2:00 AM	0.65	0.24	0.89
5/23/13 5:00 AM	0.72	0.34	1.06
5/23/13 8:00 AM	1.05	0.42	1.47
5/23/13 11:00 AM	1.03	0.42	1.45
5/23/13 2:00 PM	1.06	0.42	1.47
5/23/13 5:00 PM	1.06	0.41	1.47
5/23/13 8:00 PM	1.00	0.43	1.43
5/23/13 11:00 PM	1.00	0.41	1.41
5/24/13 2:00 AM	0.83	0.45	1.28
5/24/13 5:00 AM	0.95	0.43	1.38
5/24/13 8:00 AM	1.04	0.43	1.48
5/24/13 11:00 AM	1.08	0.46	1.53
5/24/13 2:00 PM	0.92	0.48	1.40
5/24/13 5:00 PM	0.87	0.49	1.36
5/24/13 8:00 PM	0.92	0.50	1.42
5/24/13 11:00 PM	0.97	0.50	1.47
5/25/13 2:00 AM	0.86	0.33	1.19
5/25/13 5:00 AM	0.63	0.33	0.96
5/25/13 8:00 AM	0.77	0.43	1.20
5/25/13 11:00 AM	0.93	0.49	1.42
5/25/13 2:00 PM	0.90	0.44	1.34
5/25/13 5:00 PM	0.92	0.44	1.36
5/25/13 8:00 PM	0.89	0.46	1.35
5/25/13 11:00 PM	0.87	0.44	1.31
5/26/13 2:00 AM	0.76	0.39	1.14
5/26/13 5:00 AM	0.71	0.18	0.88
5/26/13 8:00 AM	0.82	0.26	1.08
5/26/13 11:00 AM	0.98	0.44	1.42

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
5/26/13 2:00 PM	0.98	0.48	1.47
5/26/13 5:00 PM	0.96	0.48	1.44
5/26/13 8:00 PM	0.97	0.48	1.45
5/26/13 11:00 PM	0.94	0.14	1.08
5/27/13 2:00 AM	0.79	0.22	1.01
5/27/13 5:00 AM	0.62	0.20	0.82
5/27/13 8:00 AM	0.78	0.12	0.90
5/27/13 11:00 AM	0.93	0.06	0.99
5/27/13 2:00 PM	0.84	0.05	0.90
5/27/13 5:00 PM	0.83	0.56	1.39
5/27/13 8:00 PM	0.82	0.54	1.36
5/27/13 11:00 PM	0.80	0.45	1.24
5/28/13 2:00 AM	0.59	0.24	0.84
5/28/13 5:00 AM	0.61	0.25	0.86
5/28/13 8:00 AM	0.76	0.41	1.17
5/28/13 11:00 AM	0.91	0.39	1.30
5/28/13 2:00 PM	0.94	0.39	1.33
5/28/13 5:00 PM	0.89	0.38	1.27
5/28/13 8:00 PM	0.85	0.38	1.23
5/28/13 11:00 PM	0.83	0.39	1.22
5/29/13 2:00 AM	0.84	0.40	1.24
5/29/13 5:00 AM	0.83	0.41	1.25
5/29/13 8:00 AM	0.86	0.38	1.24
5/29/13 11:00 AM	0.90	0.32	1.22
5/29/13 2:00 PM	0.93	0.33	1.27
5/29/13 5:00 PM	0.92	0.30	1.22
5/29/13 8:00 PM	0.64	0.29	0.93
5/29/13 11:00 PM	0.64	0.30	0.95
5/30/13 2:00 AM	0.83	0.30	1.13
5/30/13 5:00 AM	0.94	0.28	1.22
5/30/13 8:00 AM	1.01	0.34	1.35
5/30/13 11:00 AM	1.01	0.28	1.29
5/30/13 2:00 PM	1.00	0.35	1.35
5/30/13 5:00 PM	0.97	0.39	1.36
5/30/13 8:00 PM	0.92	0.42	1.35
5/30/13 11:00 PM	0.88	0.45	1.33
5/31/13 2:00 AM	0.62	0.47	1.09
5/31/13 5:00 AM	0.70	0.48	1.17
5/31/13 8:00 AM	1.08	0.45	1.53
5/31/13 11:00 AM	0.96	0.39	1.35
5/31/13 2:00 PM	0.84	0.35	1.20
5/31/13 5:00 PM	0.79	0.32	1.11
5/31/13 8:00 PM	0.77	0.31	1.08
5/31/13 11:00 PM	0.72	0.30	1.03
6/1/13 2:00 AM	0.68	0.31	0.99
6/1/13 5:00 AM	0.68	0.31	0.99
6/1/13 8:00 AM	0.69	0.30	0.99
6/1/13 11:00 AM	0.68	0.31	0.99
6/1/13 2:00 PM	0.75	0.31	1.05
6/1/13 5:00 PM	0.69	0.30	0.99
6/1/13 8:00 PM	0.61	0.32	0.93
6/1/13 11:00 PM	0.60	0.31	0.91
6/2/13 2:00 AM	0.64	0.32	0.95
6/2/13 5:00 AM	0.67	0.32	0.99

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
6/2/13 8:00 AM	0.77	0.26	1.03
6/2/13 11:00 AM	0.80	0.30	1.10
6/2/13 2:00 PM	0.76	0.30	1.07
6/2/13 5:00 PM	0.76	0.32	1.08
6/2/13 8:00 PM	0.74	0.32	1.06
6/2/13 11:00 PM	0.70	0.33	1.03
6/3/13 2:00 AM	0.61	0.36	0.96
6/3/13 5:00 AM	0.68	0.33	1.01
6/3/13 8:00 AM	0.79	0.34	1.13
6/3/13 11:00 AM	0.76	0.34	1.10
6/3/13 2:00 PM	0.79	0.33	1.12
6/3/13 5:00 PM	0.79	0.34	1.13
6/3/13 8:00 PM	0.74	0.36	1.10
6/3/13 11:00 PM	0.76	0.36	1.12
6/4/13 2:00 AM	0.74	0.38	1.12
6/4/13 5:00 AM	0.73	0.42	1.14
6/4/13 8:00 AM	0.75	0.48	1.23
6/4/13 11:00 AM	0.78	0.45	1.23
6/4/13 2:00 PM	0.85	0.52	1.37
6/4/13 5:00 PM	0.85	0.40	1.25
6/4/13 8:00 PM	0.92	0.39	1.31
6/4/13 11:00 PM	0.87	0.38	1.25
6/5/13 2:00 AM	0.86	0.39	1.25
6/5/13 5:00 AM	0.87	0.41	1.27
6/5/13 8:00 AM	0.93	0.77	1.70
6/5/13 11:00 AM	0.87	0.63	1.50
6/5/13 2:00 PM	0.88	0.51	1.39
6/5/13 5:00 PM	0.86	0.41	1.27
6/5/13 8:00 PM	0.86	0.34	1.20
6/5/13 11:00 PM	0.85	0.33	1.18
6/6/13 2:00 AM	0.82	0.31	1.12
6/6/13 5:00 AM	0.76	0.34	1.10
6/6/13 8:00 AM	0.79	0.44	1.23
6/6/13 11:00 AM	0.75	0.40	1.15
6/6/13 2:00 PM	0.78	0.39	1.17
6/6/13 5:00 PM	0.79	0.38	1.18
6/6/13 8:00 PM	0.86	0.48	1.34
6/6/13 11:00 PM	0.81	0.38	1.19
6/7/13 2:00 AM	0.70	0.37	1.06
6/7/13 5:00 AM	0.83	0.40	1.23
6/7/13 8:00 AM	0.91	0.38	1.29
6/7/13 11:00 AM	0.85	0.49	1.34
6/7/13 2:00 PM	0.84	0.55	1.39
6/7/13 5:00 PM	0.88	0.60	1.49
6/7/13 8:00 PM	0.86	0.51	1.37
6/7/13 11:00 PM	0.81	0.45	1.27
7/8/13 2:00 AM	0.79	0.43	1.22
6/8/13 5:00 AM	0.79	0.48	1.26
6/8/13 8:00 AM	0.80	0.27	1.07
6/8/13 11:00 AM	0.81	0.11	0.92
6/8/13 2:00 PM	0.79	0.13	0.91
6/8/13 5:00 PM	0.73	0.29	1.02
6/8/13 8:00 PM	0.75	0.52	1.28
6/8/13 11:00 PM	0.76	0.56	1.33

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
6/9/13 2:00 AM	0.54	0.52	1.06
6/9/13 5:00 AM	0.60	0.44	1.05
6/9/13 8:00 AM	0.85	0.47	1.32
6/9/13 11:00 AM	0.84	0.17	1.01
6/9/13 2:00 PM	0.88	0.00	0.88
6/9/13 5:00 PM	0.83	0.01	0.84
6/9/13 8:00 PM	0.82	0.13	0.95
6/9/13 11:00 PM	0.81	0.13	0.94
6/10/13 2:00 AM	0.77	0.11	0.87
6/10/13 5:00 AM	0.77	0.11	0.89
6/10/13 8:00 AM	0.78	0.12	0.91
6/10/13 11:00 AM	0.89	0.15	1.04
6/10/13 2:00 PM	0.88	0.13	1.01
6/10/13 5:00 PM	0.82	0.14	0.96
6/10/13 8:00 PM	0.82	0.36	1.17
6/10/13 11:00 PM	0.75	0.79	1.54
6/11/13 2:00 AM	0.67	0.56	1.23
6/11/13 5:00 AM	0.76	0.60	1.36
6/11/13 8:00 AM	0.78	0.47	1.24
6/11/13 11:00 AM	0.80	0.51	1.31
6/11/13 2:00 PM	0.78	0.50	1.29
6/11/13 5:00 PM	0.79	0.44	1.23
6/11/13 8:00 PM	0.77	0.42	1.19
6/11/13 11:00 PM	0.70	0.43	1.13
6/12/13 2:00 AM	0.53	0.41	0.94
6/12/13 5:00 AM	0.59	0.42	1.01
6/12/13 8:00 AM	0.84	0.39	1.22
6/12/13 11:00 AM	0.86	0.39	1.25
6/12/13 2:00 PM	0.85	0.39	1.23
6/12/13 5:00 PM	0.81	0.41	1.21
6/12/13 8:00 PM	0.86	0.40	1.26
6/12/13 11:00 PM	0.56	0.41	0.97
6/13/13 2:00 AM	0.61	0.42	1.03
6/13/13 5:00 AM	0.77	0.41	1.18
6/13/13 8:00 AM	0.94	0.43	1.37
6/13/13 11:00 AM	0.88	0.46	1.34
6/13/13 2:00 PM	0.89	0.48	1.37
6/13/13 5:00 PM	0.90	0.50	1.40
6/13/13 8:00 PM	0.93	0.50	1.43
6/13/13 11:00 PM	0.89	0.49	1.38
6/14/13 2:00 AM	0.85	0.47	1.32
6/14/13 5:00 AM	0.86	0.48	1.33
6/14/13 8:00 AM	0.78	0.36	1.14
6/14/13 11:00 AM	0.79	0.34	1.13
6/14/13 2:00 PM	0.80	0.22	1.01
6/14/13 5:00 PM	0.79	0.08	0.87
6/14/13 8:00 PM	0.80	0.01	0.81
6/14/13 11:00 PM	0.79	0.00	0.79
6/15/13 2:00 AM	0.78	0.00	0.78
6/15/13 5:00 AM	0.72	0.00	0.72
6/15/13 8:00 AM	0.70	0.00	0.70
6/15/13 11:00 AM	0.72	0.00	0.72
6/15/13 2:00 PM	0.74	0.00	0.74
6/15/13 5:00 PM	0.71	0.00	0.71

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
6/15/13 8:00 PM	0.67	0.00	0.67
6/15/13 11:00 PM	0.66	0.00	0.66
6/16/13 2:00 AM	0.57	0.00	0.57
6/16/13 5:00 AM	0.57	0.00	0.57
6/16/13 8:00 AM	0.64	0.00	0.64
6/16/13 11:00 AM	0.68	0.00	0.68
6/16/13 2:00 PM	0.55	0.00	0.55
6/16/13 5:00 PM	0.45	0.00	0.45
6/16/13 8:00 PM	0.21	0.00	0.21
6/16/13 11:00 PM	0.17	0.00	0.17
6/17/13 2:00 AM	0.16	0.00	0.16
6/17/13 5:00 AM	0.19	0.00	0.19
6/17/13 8:00 AM	0.24	0.00	0.24
6/17/13 11:00 AM	0.15	0.00	0.15
6/17/13 2:00 PM	0.15	0.00	0.15
6/17/13 5:00 PM	0.15	0.00	0.15
6/17/13 8:00 PM	0.14	0.00	0.14
6/17/13 11:00 PM	0.13	0.00	0.13
6/18/13 2:00 AM	0.13	0.00	0.13
6/18/13 5:00 AM	0.12	0.09	0.20
6/18/13 8:00 AM	0.14	0.38	0.52
6/18/13 11:00 AM	0.15	0.48	0.63
6/18/13 2:00 PM	0.14	0.48	0.63
6/18/13 5:00 PM	0.12	0.49	0.61
6/18/13 8:00 PM	0.14	0.49	0.63
6/18/13 11:00 PM	0.11	0.50	0.61
6/19/13 2:00 AM	0.05	0.51	0.56
6/19/13 5:00 AM	0.12	0.48	0.61
6/19/13 8:00 AM	0.14	0.52	0.66
6/19/13 11:00 AM	0.15	0.63	0.78
6/19/13 2:00 PM	0.15	0.59	0.74
6/19/13 5:00 PM	0.16	0.51	0.67
6/19/13 8:00 PM	0.13	0.49	0.62
6/19/13 11:00 PM	0.13	0.45	0.57
6/20/13 2:00 AM	0.10	0.44	0.55
6/20/13 5:00 AM	0.13	0.47	0.60
6/20/13 8:00 AM	0.16	0.48	0.63
6/20/13 11:00 AM	0.14	0.48	0.62
6/20/13 2:00 PM	0.14	0.50	0.64
6/20/13 5:00 PM	0.14	0.55	0.69
6/20/13 8:00 PM	0.14	0.48	0.62
6/20/13 11:00 PM	0.14	0.53	0.67
6/21/13 2:00 AM	0.21	0.53	0.74
6/21/13 5:00 AM	0.21	0.43	0.64
6/21/13 8:00 AM	0.20	0.43	0.62
6/21/13 11:00 AM	0.22	0.39	0.61
6/21/13 2:00 PM	0.27	0.39	0.65
6/21/13 5:00 PM	0.27	0.40	0.67
6/21/13 8:00 PM	0.28	0.41	0.69
6/21/13 11:00 PM	0.47	0.42	0.88
6/22/13 2:00 AM	0.46	0.37	0.83
6/22/13 5:00 AM	0.53	0.27	0.80
6/22/13 8:00 AM	0.66	0.46	1.12
6/22/13 11:00 AM	1.00	0.44	1.44

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
6/22/13 2:00 PM	0.94	0.43	1.38
6/22/13 5:00 PM	0.78	0.43	1.21
6/22/13 8:00 PM	0.67	0.43	1.10
6/22/13 11:00 PM	0.65	0.43	1.08
6/23/13 2:00 AM	0.71	0.45	1.16
6/23/13 5:00 AM	0.74	0.48	1.22
6/23/13 8:00 AM	0.79	0.48	1.28
6/23/13 11:00 AM	0.88	0.51	1.39
6/23/13 2:00 PM	0.93	0.49	1.42
6/23/13 5:00 PM	0.84	0.50	1.35
6/23/13 8:00 PM	0.81	0.50	1.31
6/23/13 11:00 PM	0.78	0.49	1.26
6/24/13 2:00 AM	0.53	0.48	1.01
6/24/13 5:00 AM	0.53	0.48	1.01
6/24/13 8:00 AM	0.76	0.47	1.22
6/24/13 11:00 AM	0.74	0.47	1.21
6/24/13 2:00 PM	0.72	0.48	1.20
6/24/13 5:00 PM	0.77	0.47	1.24
6/24/13 8:00 PM	0.82	0.50	1.32
6/24/13 11:00 PM	0.82	0.47	1.29
6/25/13 2:00 AM	0.85	0.49	1.34
6/25/13 5:00 AM	0.74	0.47	1.21
6/25/13 8:00 AM	0.83	0.47	1.30
6/25/13 11:00 AM	0.86	0.25	1.11
6/25/13 2:00 PM	0.87	0.12	0.99
6/25/13 5:00 PM	0.84	0.12	0.96
6/25/13 8:00 PM	0.86	0.31	1.17
6/25/13 11:00 PM	0.67	0.46	1.13
6/26/13 2:00 AM	0.60	0.45	1.05
6/26/13 5:00 AM	0.66	0.47	1.13
6/26/13 8:00 AM	0.76	0.52	1.29
6/26/13 11:00 AM	0.77	0.55	1.32
6/26/13 2:00 PM	0.78	0.50	1.28
6/26/13 5:00 PM	0.77	0.47	1.24
6/26/13 8:00 PM	0.76	0.07	0.83
6/26/13 11:00 PM	0.62	0.11	0.73
6/27/13 2:00 AM	0.50	0.08	0.58
6/27/13 5:00 AM	0.53	0.08	0.61
6/27/13 8:00 AM	0.71	0.34	1.05
6/27/13 11:00 AM	0.75	0.56	1.31
6/27/13 2:00 PM	0.83	0.57	1.39
6/27/13 5:00 PM	0.69	0.54	1.23
6/27/13 8:00 PM	1.04	0.53	1.57
6/27/13 11:00 PM	1.07	0.10	1.17
6/28/13 2:00 AM	0.94	0.05	0.99
6/28/13 5:00 AM	0.91	0.10	1.01
6/28/13 8:00 AM	0.89	0.13	1.02
6/28/13 11:00 AM	0.92	0.11	1.03
6/28/13 2:00 PM	0.92	0.26	1.18
6/28/13 5:00 PM	0.93	0.61	1.54
6/28/13 8:00 PM	0.94	0.54	1.47
6/28/13 11:00 PM	1.13	0.29	1.43
6/29/13 2:00 AM	0.99	0.21	1.20
6/29/13 5:00 AM	0.96	0.29	1.25

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
6/29/13 8:00 AM	0.88	0.58	1.47
6/29/13 11:00 AM	1.01	0.56	1.57
6/29/13 2:00 PM	1.02	0.55	1.57
6/29/13 5:00 PM	1.02	0.48	1.50
6/29/13 8:00 PM	0.81	0.47	1.28
6/29/13 11:00 PM	0.92	0.26	1.18
6/30/13 2:00 AM	0.89	0.09	0.98
6/30/13 5:00 AM	0.97	0.09	1.06
6/30/13 8:00 AM	0.94	0.10	1.03
6/30/13 11:00 AM	1.01	0.37	1.38
6/30/13 2:00 PM	0.85	0.43	1.28
6/30/13 5:00 PM	0.97	0.42	1.39
6/30/13 8:00 PM	0.96	0.44	1.40
6/30/13 11:00 PM	0.86	0.44	1.30
7/1/13 2:00 AM	0.70	0.16	0.86
7/1/13 5:00 AM	0.75	0.20	0.96
7/1/13 8:00 AM	0.88	0.46	1.34
7/1/13 11:00 AM	0.83	0.47	1.30
7/1/13 2:00 PM	0.74	0.55	1.28
7/1/13 5:00 PM	0.74	0.59	1.33
7/1/13 8:00 PM	0.73	0.55	1.28
7/1/13 11:00 PM	0.71	0.41	1.12
7/2/13 2:00 AM	0.67	0.17	0.84
7/2/13 5:00 AM	0.73	0.15	0.88
7/2/13 8:00 AM	0.88	0.28	1.17
7/2/13 11:00 AM	0.90	0.58	1.47
7/2/13 2:00 PM	0.92	0.60	1.52
7/2/13 5:00 PM	0.81	0.56	1.37
7/2/13 8:00 PM	0.90	0.56	1.46
7/2/13 11:00 PM	0.71	0.55	1.26
7/3/13 2:00 AM	0.56	0.28	0.84
7/3/13 5:00 AM	0.53	0.28	0.82
7/3/13 8:00 AM	0.73	0.49	1.23
7/3/13 11:00 AM	0.90	0.47	1.37
7/3/13 2:00 PM	0.84	0.49	1.33
7/3/13 5:00 PM	0.82	0.46	1.28
7/3/13 8:00 PM	0.85	0.46	1.31
7/3/13 11:00 PM	0.63	0.45	1.09
7/4/13 2:00 AM	0.45	0.30	0.76
7/4/13 5:00 AM	0.46	0.15	0.61
7/4/13 8:00 AM	0.73	0.22	0.95
7/4/13 11:00 AM	0.89	0.41	1.29
7/4/13 2:00 PM	0.87	0.45	1.32
7/4/13 5:00 PM	0.87	0.42	1.29
7/4/13 8:00 PM	0.86	0.43	1.29
7/4/13 11:00 PM	0.72	0.30	1.02
7/5/13 2:00 AM	0.55	0.15	0.70
7/5/13 5:00 AM	0.58	0.15	0.74
7/5/13 8:00 AM	0.93	0.26	1.19
7/5/13 11:00 AM	0.76	0.48	1.23
7/5/13 2:00 PM	0.79	0.45	1.24
7/5/13 5:00 PM	0.73	0.40	1.13
7/5/13 8:00 PM	0.78	0.44	1.22
7/5/13 11:00 PM	0.70	0.32	1.01

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
7/6/13 2:00 AM	0.43	0.17	0.60
7/6/13 5:00 AM	0.42	0.13	0.55
7/6/13 8:00 AM	0.72	0.33	1.05
7/6/13 11:00 AM	0.86	0.43	1.29
7/6/13 2:00 PM	0.85	0.43	1.29
7/6/13 5:00 PM	0.85	0.42	1.26
7/6/13 8:00 PM	0.77	0.43	1.21
7/6/13 11:00 PM	0.70	0.43	1.14
7/7/13 2:00 AM	0.79	0.18	0.97
7/7/13 5:00 AM	0.71	0.17	0.87
7/7/13 8:00 AM	0.74	0.31	1.05
7/7/13 11:00 AM	0.72	0.46	1.18
7/7/13 2:00 PM	0.75	0.46	1.21
7/7/13 5:00 PM	0.72	0.45	1.16
7/7/13 8:00 PM	0.70	0.45	1.15
7/7/13 11:00 PM	0.73	0.45	1.18
7/8/13 2:00 AM	0.68	0.45	1.13
7/8/13 5:00 AM	0.69	0.46	1.15
7/8/13 8:00 AM	0.78	0.47	1.24
7/8/13 11:00 AM	0.79	0.52	1.31
7/8/13 2:00 PM	0.88	0.49	1.37
7/8/13 5:00 PM	0.90	0.53	1.43
7/8/13 8:00 PM	0.86	0.53	1.39
7/8/13 11:00 PM	0.86	0.52	1.38
7/9/13 2:00 AM	0.82	0.53	1.35
7/9/13 5:00 AM	0.89	0.53	1.42
7/9/13 8:00 AM	0.84	0.54	1.37
7/9/13 11:00 AM	1.00	0.48	1.48
7/9/13 2:00 PM	0.84	0.51	1.34
7/9/13 5:00 PM	0.87	0.51	1.37
7/9/13 8:00 PM	0.81	0.50	1.31
7/9/13 11:00 PM	0.80	0.49	1.29
7/10/13 2:00 AM	0.72	0.38	1.09
7/10/13 5:00 AM	0.67	0.19	0.86
7/10/13 8:00 AM	0.76	0.48	1.24
7/10/13 11:00 AM	0.80	0.49	1.29
7/10/13 2:00 PM	0.83	0.50	1.33
7/10/13 5:00 PM	0.77	0.50	1.27
7/10/13 8:00 PM	0.77	0.48	1.25
7/10/13 11:00 PM	0.75	0.50	1.25
7/11/13 2:00 AM	0.54	0.38	0.92
7/11/13 5:00 AM	0.55	0.28	0.83
7/11/13 8:00 AM	0.64	0.50	1.15
7/11/13 11:00 AM	0.74	0.51	1.26
7/11/13 2:00 PM	0.72	0.52	1.23
7/11/13 5:00 PM	0.74	0.48	1.22
7/11/13 8:00 PM	0.76	0.43	1.19
7/11/13 11:00 PM	0.77	0.10	0.87
7/12/13 2:00 AM	0.78	0.08	0.86
7/12/13 5:00 AM	0.80	0.07	0.86
7/12/13 8:00 AM	0.84	0.24	1.08
7/12/13 11:00 AM	0.83	0.53	1.35
7/12/13 2:00 PM	0.82	0.52	1.35
7/12/13 5:00 PM	0.79	0.56	1.35

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
7/12/13 8:00 PM	0.75	0.50	1.25
7/12/13 11:00 PM	0.73	0.06	0.79
7/13/13 2:00 AM	0.72	0.06	0.78
7/13/13 5:00 AM	0.73	0.06	0.78
7/13/13 8:00 AM	0.79	0.06	0.85
7/13/13 11:00 AM	0.81	0.06	0.87
7/13/13 2:00 PM	0.76	0.06	0.82
7/13/13 5:00 PM	0.81	0.06	0.88
7/13/13 8:00 PM	0.87	0.06	0.93
7/13/13 11:00 PM	0.83	0.06	0.89
7/14/13 2:00 AM	0.77	0.06	0.83
7/14/13 5:00 AM	0.75	0.06	0.81
7/14/13 8:00 AM	0.84	0.06	0.90
7/14/13 11:00 AM	0.89	0.06	0.95
7/14/13 2:00 PM	0.87	0.06	0.93
7/14/13 5:00 PM	0.84	0.06	0.90
7/14/13 8:00 PM	0.89	0.06	0.95
7/14/13 11:00 PM	0.90	0.06	0.96
7/15/13 2:00 AM	0.92	0.05	0.97
7/15/13 5:00 AM	0.89	0.04	0.92
7/15/13 8:00 AM	0.89	0.06	0.95
7/15/13 11:00 AM	0.85	0.06	0.91
7/15/13 2:00 PM	0.83	0.06	0.88
7/15/13 5:00 PM	0.90	0.06	0.97
7/15/13 8:00 PM	0.85	0.06	0.91
7/15/13 11:00 PM	0.79	0.06	0.85
7/16/13 2:00 AM	0.64	0.06	0.69
7/16/13 5:00 AM	0.72	0.05	0.77
7/16/13 8:00 AM	0.84	0.06	0.90
7/16/13 11:00 AM	0.85	0.06	0.91
7/16/13 2:00 PM	0.80	0.06	0.86
7/16/13 5:00 PM	0.74	0.06	0.79
7/16/13 8:00 PM	0.77	0.06	0.83
7/16/13 11:00 PM	0.54	0.06	0.60
7/17/13 2:00 AM	0.28	0.05	0.33
7/17/13 5:00 AM	0.52	0.05	0.57
7/17/13 8:00 AM	0.85	0.05	0.90
7/17/13 11:00 AM	0.85	0.05	0.91
7/17/13 2:00 PM	0.83	0.06	0.89
7/17/13 5:00 PM	0.79	0.06	0.85
7/17/13 8:00 PM	0.80	0.07	0.87
7/17/13 11:00 PM	0.77	0.07	0.85
7/18/13 2:00 AM	0.58	0.08	0.66
7/18/13 5:00 AM	0.74	0.08	0.82
7/18/13 8:00 AM	0.90	0.09	1.00
7/18/13 11:00 AM	0.83	0.10	0.93
7/18/13 2:00 PM	0.78	0.12	0.90
7/18/13 5:00 PM	0.77	0.13	0.90
7/18/13 8:00 PM	0.72	0.16	0.88
7/18/13 11:00 PM	0.43	0.16	0.59
7/19/13 2:00 AM	0.23	0.15	0.38
7/19/13 5:00 AM	0.18	0.13	0.31
7/19/13 8:00 AM	0.56	0.11	0.67
7/19/13 11:00 AM	0.81	0.10	0.91

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
7/19/13 2:00 PM	0.82	0.09	0.91
7/19/13 5:00 PM	0.84	0.10	0.94
7/19/13 8:00 PM	0.89	0.12	1.01
7/19/13 11:00 PM	0.85	0.08	0.92
7/20/13 2:00 AM	0.64	0.06	0.70
7/20/13 5:00 AM	0.61	0.05	0.66
7/20/13 8:00 AM	0.76	0.27	1.03
7/20/13 11:00 AM	0.87	0.52	1.39
7/20/13 2:00 PM	0.87	0.45	1.32
7/20/13 5:00 PM	0.88	0.43	1.31
7/20/13 8:00 PM	0.87	0.40	1.28
7/20/13 11:00 PM	0.85	0.36	1.21
7/21/13 2:00 AM	0.59	0.14	0.73
7/21/13 5:00 AM	0.57	0.11	0.69
7/21/13 8:00 AM	0.75	0.15	0.90
7/21/13 11:00 AM	0.87	0.37	1.24
7/21/13 2:00 PM	0.85	0.37	1.23
7/21/13 5:00 PM	0.80	0.35	1.15
7/21/13 8:00 PM	0.80	0.35	1.15
7/21/13 11:00 PM	0.55	0.34	0.89
7/22/13 2:00 AM	0.46	0.33	0.78
7/22/13 5:00 AM	0.57	0.32	0.89
7/22/13 8:00 AM	0.82	0.33	1.14
7/22/13 11:00 AM	0.82	0.30	1.12
7/22/13 2:00 PM	0.80	0.31	1.11
7/22/13 5:00 PM	0.70	0.33	1.02
7/22/13 8:00 PM	0.73	0.33	1.06
7/22/13 11:00 PM	0.60	0.33	0.93
7/23/13 2:00 AM	0.27	0.33	0.60
7/23/13 5:00 AM	0.29	0.33	0.62
7/23/13 8:00 AM	0.44	0.34	0.78
7/23/13 11:00 AM	0.41	0.33	0.74
7/23/13 2:00 PM	0.15	0.33	0.48
7/23/13 5:00 PM	0.12	0.31	0.43
7/23/13 8:00 PM	0.15	0.31	0.46
7/23/13 11:00 PM	0.16	0.30	0.46
7/24/13 2:00 AM	0.15	0.30	0.45
7/24/13 5:00 AM	0.14	0.30	0.43
7/24/13 8:00 AM	0.15	0.28	0.43
7/24/13 11:00 AM	0.17	0.30	0.46
7/24/13 2:00 PM	0.36	0.31	0.66
7/24/13 5:00 PM	0.57	0.32	0.89
7/24/13 8:00 PM	0.63	0.32	0.95
7/24/13 11:00 PM	0.46	0.33	0.79
7/25/13 2:00 AM	0.51	0.34	0.85
7/25/13 5:00 AM	0.57	0.34	0.90
7/25/13 8:00 AM	0.59	0.34	0.93
7/25/13 11:00 AM	0.58	0.32	0.90
7/25/13 2:00 PM	0.56	0.25	0.81
7/25/13 5:00 PM	0.56	0.34	0.90
7/25/13 8:00 PM	0.57	0.35	0.91
7/25/13 11:00 PM	0.53	0.33	0.86
7/26/13 2:00 AM	0.46	0.30	0.76
7/26/13 5:00 AM	0.53	0.11	0.64

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
7/26/13 8:00 AM	0.58	0.06	0.64
7/26/13 11:00 AM	0.57	0.23	0.80
7/26/13 2:00 PM	0.56	0.38	0.94
7/26/13 5:00 PM	0.54	0.22	0.77
7/26/13 8:00 PM	0.55	0.06	0.61
7/26/13 11:00 PM	0.54	0.21	0.75
7/27/13 2:00 AM	0.54	0.30	0.84
7/27/13 5:00 AM	0.53	0.31	0.84
7/27/13 8:00 AM	0.53	0.34	0.87
7/27/13 11:00 AM	0.54	0.34	0.88
7/27/13 2:00 PM	0.56	0.34	0.89
7/27/13 5:00 PM	0.53	0.33	0.87
7/27/13 8:00 PM	0.54	0.31	0.85
7/27/13 11:00 PM	0.38	0.31	0.69
7/28/13 2:00 AM	0.33	0.31	0.64
7/28/13 5:00 AM	0.34	0.30	0.64
7/28/13 8:00 AM	0.40	0.24	0.64
7/28/13 11:00 AM	0.44	0.33	0.77
7/28/13 2:00 PM	0.61	0.32	0.93
7/28/13 5:00 PM	0.60	0.32	0.92
7/28/13 8:00 PM	0.61	0.28	0.89
7/28/13 11:00 PM	0.59	0.07	0.66
7/29/13 2:00 AM	0.40	0.06	0.46
7/29/13 5:00 AM	0.48	0.06	0.54
7/29/13 8:00 AM	0.66	0.15	0.81
7/29/13 11:00 AM	0.64	0.39	1.03
7/29/13 2:00 PM	0.63	0.37	1.00
7/29/13 5:00 PM	0.61	0.35	0.96
7/29/13 8:00 PM	0.64	0.34	0.98
7/29/13 11:00 PM	0.64	0.35	1.00
7/30/13 2:00 AM	0.52	0.43	0.94
7/30/13 5:00 AM	0.57	0.25	0.82
7/30/13 8:00 AM	0.63	0.34	0.97
7/30/13 11:00 AM	0.66	0.34	1.00
7/30/13 2:00 PM	0.71	0.35	1.05
7/30/13 5:00 PM	0.69	0.37	1.06
7/30/13 8:00 PM	0.67	0.36	1.03
7/30/13 11:00 PM	0.68	0.37	1.04
7/31/13 2:00 AM	0.43	0.39	0.82
7/31/13 5:00 AM	0.42	0.35	0.78
7/31/13 8:00 AM	0.61	0.46	1.07
7/31/13 11:00 AM	0.62	0.40	1.02
7/31/13 2:00 PM	0.74	0.44	1.18
7/31/13 5:00 PM	0.77	0.49	1.26
7/31/13 8:00 PM	0.54	0.52	1.06
7/31/13 11:00 PM	0.49	0.56	1.06
8/1/13 2:00 AM	0.46	0.50	0.96
8/1/13 5:00 AM	0.53	0.50	1.02
8/1/13 8:00 AM	0.76	0.52	1.28
8/1/13 11:00 AM	0.77	0.54	1.31
8/1/13 2:00 PM	0.80	0.61	1.41
8/1/13 5:00 PM	0.78	0.55	1.33
8/1/13 8:00 PM	0.78	0.34	1.13
8/1/13 11:00 PM	0.84	0.17	1.01

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
8/2/13 2:00 AM	0.64	0.07	0.71
8/2/13 5:00 AM	0.66	0.07	0.72
8/2/13 8:00 AM	0.87	0.37	1.24
8/2/13 11:00 AM	0.86	0.50	1.36
8/2/13 2:00 PM	0.87	0.50	1.37
8/2/13 5:00 PM	0.93	0.49	1.42
8/2/13 8:00 PM	0.91	0.53	1.44
8/2/13 11:00 PM	0.91	0.29	1.21
8/3/13 2:00 AM	0.85	0.17	1.02
8/3/13 5:00 AM	0.67	0.14	0.80
8/3/13 8:00 AM	0.65	0.50	1.15
8/3/13 11:00 AM	0.54	0.49	1.03
8/3/13 2:00 PM	0.69	0.47	1.16
8/3/13 5:00 PM	0.79	0.48	1.27
8/3/13 8:00 PM	0.91	0.47	1.38
8/3/13 11:00 PM	0.90	0.12	1.03
8/4/13 2:00 AM	0.88	0.05	0.92
8/4/13 5:00 AM	0.84	0.05	0.89
8/4/13 8:00 AM	0.85	0.27	1.12
8/4/13 11:00 AM	0.91	0.54	1.45
8/4/13 2:00 PM	0.86	0.30	1.16
8/4/13 5:00 PM	0.91	0.35	1.27
8/4/13 8:00 PM	0.97	0.45	1.42
8/4/13 11:00 PM	0.83	0.37	1.21
8/5/13 2:00 AM	0.72	0.13	0.85
8/5/13 5:00 AM	0.67	0.19	0.86
8/5/13 8:00 AM	0.83	0.36	1.19
8/5/13 11:00 AM	0.91	0.35	1.26
8/5/13 2:00 PM	0.79	0.34	1.13
8/5/13 5:00 PM	0.73	0.25	0.98
8/5/13 8:00 PM	0.67	0.22	0.88
8/5/13 11:00 PM	0.65	0.22	0.87
8/6/13 2:00 AM	0.28	0.23	0.51
8/6/13 5:00 AM	0.29	0.28	0.56
8/6/13 8:00 AM	0.33	0.37	0.71
8/6/13 11:00 AM	0.36	0.39	0.75
8/6/13 2:00 PM	0.35	0.41	0.76
8/6/13 5:00 PM	0.32	0.42	0.74
8/6/13 8:00 PM	0.31	0.42	0.73
8/6/13 11:00 PM	0.31	0.45	0.75
8/7/13 2:00 AM	0.13	0.45	0.59
8/7/13 5:00 AM	0.12	0.45	0.57
8/7/13 8:00 AM	0.23	0.46	0.70
8/7/13 11:00 AM	0.23	0.47	0.70
8/7/13 2:00 PM	0.22	0.48	0.69
8/7/13 5:00 PM	0.20	0.50	0.70
8/7/13 8:00 PM	0.20	0.51	0.71
8/7/13 11:00 PM	0.19	0.49	0.68
8/8/13 2:00 AM	0.18	0.46	0.63
8/8/13 5:00 AM	0.18	0.47	0.64
8/8/13 8:00 AM	0.20	0.55	0.75
8/8/13 11:00 AM	0.20	0.51	0.71
8/8/13 2:00 PM	0.18	0.49	0.67
8/8/13 5:00 PM	0.16	0.43	0.59

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
8/8/13 8:00 PM	0.17	0.42	0.59
8/8/13 11:00 PM	0.17	0.41	0.58
8/9/13 2:00 AM	0.17	0.40	0.57
8/9/13 5:00 AM	0.18	0.40	0.57
8/9/13 8:00 AM	0.19	2.41	2.59
8/9/13 11:00 AM	0.19	0.41	0.61
8/9/13 2:00 PM	0.19	0.42	0.62
8/9/13 5:00 PM	0.18	0.40	0.58
8/9/13 8:00 PM	0.19	0.40	0.58
8/9/13 11:00 PM	0.20	0.37	0.57
8/10/13 2:00 AM	0.19	0.13	0.32
8/10/13 5:00 AM	0.13	0.14	0.27
8/10/13 8:00 AM	0.18	0.31	0.49
8/10/13 11:00 AM	0.20	0.49	0.69
8/10/13 2:00 PM	0.21	0.46	0.67
8/10/13 5:00 PM	0.20	0.45	0.66
8/10/13 8:00 PM	0.20	0.47	0.67
8/10/13 11:00 PM	0.20	0.47	0.67
8/11/13 2:00 AM	0.20	0.46	0.66
8/11/13 5:00 AM	0.19	0.48	0.67
8/11/13 8:00 AM	0.20	0.50	0.69
8/11/13 11:00 AM	0.18	0.50	0.69
8/11/13 2:00 PM	0.18	0.51	0.69
8/11/13 5:00 PM	0.19	0.54	0.73
8/11/13 8:00 PM	0.19	0.53	0.72
8/11/13 11:00 PM	0.17	0.45	0.62
8/12/13 2:00 AM	0.14	0.20	0.34
8/12/13 5:00 AM	0.17	0.41	0.58
8/12/13 8:00 AM	0.18	0.55	0.73
8/12/13 11:00 AM	0.19	0.59	0.78
8/12/13 2:00 PM	0.21	0.61	0.83
8/12/13 5:00 PM	0.21	0.60	0.81
8/12/13 8:00 PM	0.22	0.60	0.82
8/12/13 11:00 PM	0.22	0.58	0.80
8/13/13 2:00 AM	0.22	0.56	0.78
8/13/13 5:00 AM	0.22	0.56	0.78
8/13/13 8:00 AM	0.23	0.51	0.74
8/13/13 11:00 AM	0.24	0.51	0.75
8/13/13 2:00 PM	0.22	0.51	0.73
8/13/13 5:00 PM	0.20	0.52	0.72
8/13/13 8:00 PM	0.20	0.52	0.72
8/13/13 11:00 PM	0.19	0.50	0.69
8/14/13 2:00 AM	0.18	0.50	0.68
8/14/13 5:00 AM	0.18	0.51	0.69
8/14/13 8:00 AM	0.17	0.50	0.66
8/14/13 11:00 AM	0.13	0.48	0.61
8/14/13 2:00 PM	0.17	0.47	0.64
8/14/13 5:00 PM	0.20	0.47	0.67
8/14/13 8:00 PM	0.23	0.46	0.69
8/14/13 11:00 PM	0.15	0.46	0.61
8/15/13 2:00 AM	0.06	0.45	0.51
8/15/13 5:00 AM	0.08	0.44	0.52
8/15/13 8:00 AM	0.18	0.44	0.62
8/15/13 11:00 AM	0.20	0.43	0.63

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
8/15/13 2:00 PM	0.23	0.43	0.65
8/15/13 5:00 PM	0.23	0.43	0.66
8/15/13 8:00 PM	0.23	0.44	0.67
8/15/13 11:00 PM	0.25	0.43	0.68
8/16/13 2:00 AM	0.23	0.45	0.67
8/16/13 5:00 AM	0.22	0.46	0.68
8/16/13 8:00 AM	0.21	0.46	0.66
8/16/13 11:00 AM	0.22	0.47	0.69
8/16/13 2:00 PM	0.78	0.48	1.26
8/16/13 5:00 PM	0.90	0.48	1.38
8/16/13 8:00 PM	0.98	0.48	1.45
8/16/13 11:00 PM	0.97	0.19	1.16
8/17/13 2:00 AM	0.85	0.05	0.90
8/17/13 5:00 AM	0.87	0.06	0.93
8/17/13 8:00 AM	0.95	0.47	1.43
8/17/13 11:00 AM	1.03	0.55	1.58
8/17/13 2:00 PM	1.00	0.55	1.55
8/17/13 5:00 PM	1.00	0.52	1.52
8/17/13 8:00 PM	0.64	0.51	1.15
8/17/13 11:00 PM	0.55	0.50	1.05
8/18/13 2:00 AM	0.55	0.51	1.06
8/18/13 5:00 AM	0.57	0.50	1.06
8/18/13 8:00 AM	0.63	0.50	1.13
8/18/13 11:00 AM	0.78	0.51	1.29
8/18/13 2:00 PM	0.79	0.51	1.31
8/18/13 5:00 PM	0.76	0.50	1.26
8/18/13 8:00 PM	0.74	0.49	1.22
8/18/13 11:00 PM	0.61	0.43	1.04
8/19/13 2:00 AM	0.50	0.17	0.67
8/19/13 5:00 AM	0.56	0.15	0.71
8/19/13 8:00 AM	0.80	0.38	1.18
8/19/13 11:00 AM	0.86	0.38	1.23
8/19/13 2:00 PM	0.85	0.39	1.24
8/19/13 5:00 PM	0.81	0.42	1.23
8/19/13 8:00 PM	0.70	0.39	1.09
8/19/13 11:00 PM	0.56	0.43	0.99
8/20/13 2:00 AM	0.54	0.16	0.70
8/20/13 5:00 AM	0.56	0.16	0.72
8/20/13 8:00 AM	0.71	0.50	1.21
8/20/13 11:00 AM	0.82	0.50	1.32
8/20/13 2:00 PM	0.85	0.54	1.39
8/20/13 5:00 PM	0.86	0.48	1.34
8/20/13 8:00 PM	0.94	0.47	1.41
8/20/13 11:00 PM	0.66	0.44	1.11
8/21/13 2:00 AM	0.50	0.32	0.82
8/21/13 5:00 AM	0.61	0.33	0.94
8/21/13 8:00 AM	0.96	0.51	1.46
8/21/13 11:00 AM	0.94	0.49	1.43
8/21/13 2:00 PM	0.98	0.46	1.44
8/21/13 5:00 PM	0.96	0.46	1.42
8/21/13 8:00 PM	0.97	0.48	1.44
8/21/13 11:00 PM	0.99	0.11	1.10
8/22/13 2:00 AM	0.64	0.10	0.74
8/22/13 5:00 AM	0.78	0.20	0.98

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
8/22/13 8:00 AM	0.99	0.60	1.60
8/22/13 11:00 AM	0.99	0.49	1.47
8/22/13 2:00 PM	0.98	0.53	1.51
8/22/13 5:00 PM	0.93	0.51	1.45
8/22/13 8:00 PM	0.96	0.50	1.46
8/22/13 11:00 PM	0.86	0.48	1.34
8/23/13 2:00 AM	0.57	0.25	0.82
8/23/13 5:00 AM	0.69	0.25	0.94
8/23/13 8:00 AM	1.04	0.52	1.56
8/23/13 11:00 AM	0.97	0.51	1.48
8/23/13 2:00 PM	0.83	0.49	1.33
8/23/13 5:00 PM	0.88	0.49	1.37
8/23/13 8:00 PM	0.88	0.48	1.36
8/23/13 11:00 PM	0.79	0.41	1.20
8/24/13 2:00 AM	0.61	0.23	0.84
8/24/13 5:00 AM	0.45	0.18	0.62
8/24/13 8:00 AM	0.61	0.41	1.02
8/24/13 11:00 AM	0.99	0.48	1.47
8/24/13 2:00 PM	1.02	0.47	1.49
8/24/13 5:00 PM	1.01	0.31	1.32
8/24/13 8:00 PM	0.94	0.00	0.94
8/24/13 11:00 PM	0.97	0.00	0.97
8/25/13 2:00 AM	0.97	0.00	0.97
8/25/13 5:00 AM	0.96	0.00	0.96
8/25/13 8:00 AM	1.01	0.00	1.01
8/25/13 11:00 AM	1.03	0.00	1.03
8/25/13 2:00 PM	1.14	0.00	1.15
8/25/13 5:00 PM	0.90	0.22	1.12
8/25/13 8:00 PM	0.90	0.54	1.44
8/25/13 11:00 PM	0.87	0.45	1.31
8/26/13 2:00 AM	0.65	0.22	0.87
8/26/13 5:00 AM	0.78	0.33	1.11
8/26/13 8:00 AM	0.83	0.48	1.31
8/26/13 11:00 AM	0.85	0.47	1.32
8/26/13 2:00 PM	0.93	0.47	1.40
8/26/13 5:00 PM	0.84	0.48	1.33
8/26/13 8:00 PM	0.79	0.50	1.28
8/26/13 11:00 PM	0.58	0.48	1.06
8/27/13 2:00 AM	0.44	0.27	0.72
8/27/13 5:00 AM	0.49	0.32	0.80
8/27/13 8:00 AM	0.98	0.49	1.47
8/27/13 11:00 AM	0.87	0.48	1.35
8/27/13 2:00 PM	0.86	0.46	1.31
8/27/13 5:00 PM	0.92	0.46	1.39
8/27/13 8:00 PM	0.95	0.46	1.40
8/27/13 11:00 PM	0.72	0.21	0.93
8/28/13 2:00 AM	0.58	0.04	0.62
8/28/13 5:00 AM	0.62	0.05	0.67
8/28/13 8:00 AM	0.78	0.51	1.29
8/28/13 11:00 AM	0.91	0.50	1.41
8/28/13 2:00 PM	0.93	0.48	1.41
8/28/13 5:00 PM	0.86	0.48	1.34
8/28/13 8:00 PM	0.76	0.48	1.24
8/28/13 11:00 PM	0.76	0.42	1.18

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
8/29/13 2:00 AM	0.58	0.33	0.91
8/29/13 5:00 AM	0.69	0.28	0.97
8/29/13 8:00 AM	0.80	0.41	1.22
8/29/13 11:00 AM	0.81	0.41	1.22
8/29/13 2:00 PM	0.79	0.41	1.20
8/29/13 5:00 PM	0.78	0.41	1.19
8/29/13 8:00 PM	0.77	0.41	1.18
8/29/13 11:00 PM	0.80	0.41	1.21
8/30/13 2:00 AM	0.79	0.40	1.18
8/30/13 5:00 AM	0.79	0.41	1.20
8/30/13 8:00 AM	0.81	0.44	1.25
8/30/13 11:00 AM	0.81	0.45	1.26
8/30/13 2:00 PM	0.77	0.45	1.22
8/30/13 5:00 PM	0.76	0.52	1.27
8/30/13 8:00 PM	0.76	0.32	1.07
8/30/13 11:00 PM	0.70	0.16	0.86
8/31/13 2:00 AM	0.51	0.16	0.68
8/31/13 5:00 AM	0.50	0.16	0.66
8/31/13 8:00 AM	0.68	0.17	0.85
8/31/13 11:00 AM	0.72	0.17	0.89
8/31/13 2:00 PM	0.81	0.17	0.98
8/31/13 5:00 PM	0.80	0.17	0.96
8/31/13 8:00 PM	0.97	0.17	1.14
8/31/13 11:00 PM	0.93	0.16	1.10
9/1/13 2:00 AM	0.96	0.11	1.07
9/1/13 5:00 AM	0.86	0.11	0.97
9/1/13 8:00 AM	0.87	0.16	1.03
9/1/13 11:00 AM	0.92	0.16	1.08
9/1/13 2:00 PM	0.91	0.16	1.07
9/1/13 5:00 PM	0.91	0.16	1.07
9/1/13 8:00 PM	1.00	0.16	1.16
9/1/13 11:00 PM	0.85	0.10	0.95
9/2/13 2:00 AM	0.86	0.06	0.91
9/2/13 5:00 AM	0.85	0.06	0.90
9/2/13 8:00 AM	0.91	0.12	1.02
9/2/13 11:00 AM	0.94	0.18	1.12
9/2/13 2:00 PM	0.96	0.18	1.14
9/2/13 5:00 PM	0.95	0.17	1.12
9/2/13 8:00 PM	0.92	0.16	1.08
9/2/13 11:00 PM	0.92	0.15	1.06
9/3/13 2:00 AM	0.89	0.09	0.98
9/3/13 5:00 AM	0.87	0.14	1.01
9/3/13 8:00 AM	0.82	0.17	0.98
9/3/13 11:00 AM	0.76	0.16	0.92
9/3/13 2:00 PM	0.82	0.15	0.97
9/3/13 5:00 PM	0.79	0.13	0.92
9/3/13 8:00 PM	0.80	0.13	0.93
9/3/13 11:00 PM	0.76	0.13	0.89
9/4/13 2:00 AM	0.44	0.13	0.57
9/4/13 5:00 AM	0.58	0.14	0.72
9/4/13 8:00 AM	0.83	0.14	0.97
9/4/13 11:00 AM	0.88	0.15	1.03
9/4/13 2:00 PM	0.88	0.16	1.04
9/4/13 5:00 PM	0.86	0.17	1.02

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
9/4/13 8:00 PM	0.80	0.15	0.95
9/4/13 11:00 PM	0.80	0.15	0.95
9/5/13 2:00 AM	0.85	0.15	1.00
9/5/13 5:00 AM	0.90	0.16	1.06
9/5/13 8:00 AM	0.87	0.16	1.03
9/5/13 11:00 AM	0.84	0.16	1.00
9/5/13 2:00 PM	0.82	0.16	0.98
9/5/13 5:00 PM	0.77	0.17	0.94
9/5/13 8:00 PM	0.74	0.18	0.92
9/5/13 11:00 PM	0.79	0.20	0.98
9/6/13 2:00 AM	0.74	0.21	0.95
9/6/13 5:00 AM	0.74	0.22	0.96
9/6/13 8:00 AM	0.74	0.23	0.97
9/6/13 11:00 AM	0.73	0.21	0.94
9/6/13 2:00 PM	0.72	0.20	0.91
9/6/13 5:00 PM	0.72	0.21	0.93
9/6/13 8:00 PM	0.69	0.21	0.89
9/6/13 11:00 PM	0.71	0.18	0.89
9/7/13 2:00 AM	0.70	0.16	0.87
9/7/13 5:00 AM	0.72	0.16	0.88
9/7/13 8:00 AM	0.75	0.16	0.91
9/7/13 11:00 AM	0.76	0.15	0.92
9/7/13 2:00 PM	0.79	0.16	0.95
9/7/13 5:00 PM	0.79	0.21	1.00
9/7/13 8:00 PM	0.74	0.18	0.92
9/7/13 11:00 PM	0.73	0.17	0.90
9/8/13 2:00 AM	0.75	0.17	0.93
9/8/13 5:00 AM	0.81	0.19	1.00
9/8/13 8:00 AM	0.86	0.20	1.06
9/8/13 11:00 AM	0.86	0.24	1.10
9/8/13 2:00 PM	0.86	0.24	1.10
9/8/13 5:00 PM	0.94	0.26	1.20
9/8/13 8:00 PM	0.87	0.27	1.15
9/8/13 11:00 PM	0.87	0.28	1.15
9/9/13 2:00 AM	0.85	0.29	1.14
9/9/13 5:00 AM	0.86	0.28	1.14
9/9/13 8:00 AM	0.82	0.29	1.12
9/9/13 11:00 AM	0.80	0.29	1.09
9/9/13 2:00 PM	0.81	0.28	1.09
9/9/13 5:00 PM	0.78	0.49	1.27
9/9/13 8:00 PM	0.74	0.45	1.18
9/9/13 11:00 PM	0.58	0.43	1.00
9/10/13 2:00 AM	0.50	0.33	0.83
9/10/13 5:00 AM	0.61	0.35	0.96
9/10/13 8:00 AM	0.79	0.47	1.25
9/10/13 11:00 AM	0.82	0.50	1.32
9/10/13 2:00 PM	0.84	0.49	1.33
9/10/13 5:00 PM	0.77	0.41	1.18
9/10/13 8:00 PM	0.77	0.04	0.81
9/10/13 11:00 PM	0.70	0.00	0.70
9/11/13 2:00 AM	0.57	0.00	0.57
9/11/13 5:00 AM	0.62	0.00	0.62
9/11/13 8:00 AM	0.88	0.00	0.88
9/11/13 11:00 AM	0.85	0.00	0.85

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
9/11/13 2:00 PM	0.87	0.00	0.87
9/11/13 5:00 PM	0.84	0.00	0.84
9/11/13 8:00 PM	0.85	0.00	0.85
9/11/13 11:00 PM	0.83	0.00	0.83
9/12/13 2:00 AM	0.60	0.00	0.60
9/12/13 5:00 AM	0.61	0.03	0.64
9/12/13 8:00 AM	0.87	0.30	1.16
9/12/13 11:00 AM	0.85	0.59	1.44
9/12/13 2:00 PM	0.85	0.37	1.22
9/12/13 5:00 PM	0.80	0.29	1.08
9/12/13 8:00 PM	0.80	0.25	1.05
9/12/13 11:00 PM	0.63	0.18	0.81
9/13/13 2:00 AM	0.33	0.16	0.49
9/13/13 5:00 AM	0.35	0.18	0.53
9/13/13 8:00 AM	0.64	0.26	0.90
9/13/13 11:00 AM	0.76	0.26	1.02
9/13/13 2:00 PM	0.80	0.28	1.08
9/13/13 5:00 PM	0.74	0.28	1.03
9/13/13 8:00 PM	0.69	0.29	0.98
9/13/13 11:00 PM	0.56	0.10	0.66
9/14/13 2:00 AM	0.49	0.04	0.53
9/14/13 5:00 AM	0.42	0.04	0.46
9/14/13 8:00 AM	0.59	0.22	0.81
9/14/13 11:00 AM	0.67	0.46	1.13
9/14/13 2:00 PM	0.66	0.45	1.10
9/14/13 5:00 PM	0.72	0.43	1.14
9/14/13 8:00 PM	0.80	0.44	1.24
9/14/13 11:00 PM	0.55	0.41	0.96
9/15/13 2:00 AM	0.49	0.17	0.66
9/15/13 5:00 AM	0.51	0.25	0.75
9/15/13 8:00 AM	0.71	0.36	1.06
9/15/13 11:00 AM	0.75	0.43	1.18
9/15/13 2:00 PM	0.77	0.41	1.18
9/15/13 5:00 PM	0.65	0.43	1.08
9/15/13 8:00 PM	0.80	0.42	1.22
9/15/13 11:00 PM	0.73	0.40	1.13
9/16/13 2:00 AM	0.40	0.22	0.62
9/16/13 5:00 AM	0.52	0.24	0.76
9/16/13 8:00 AM	0.81	0.46	1.27
9/16/13 11:00 AM	0.73	0.46	1.19
9/16/13 2:00 PM	0.70	0.45	1.15
9/16/13 5:00 PM	0.73	0.45	1.18
9/16/13 8:00 PM	0.78	0.34	1.13
9/16/13 11:00 PM	0.79	0.03	0.82
9/17/13 2:00 AM	0.49	0.04	0.53
9/17/13 5:00 AM	0.64	0.17	0.81
9/17/13 8:00 AM	0.84	0.65	1.50
9/17/13 11:00 AM	0.82	0.53	1.36
9/17/13 2:00 PM	0.77	0.55	1.32
9/17/13 5:00 PM	0.73	0.49	1.22
9/17/13 8:00 PM	0.71	0.45	1.16
9/17/13 11:00 PM	0.44	0.53	0.97
9/18/13 2:00 AM	0.40	0.35	0.75
9/18/13 5:00 AM	0.33	0.29	0.62

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
9/18/13 8:00 AM	0.20	0.43	0.63
9/18/13 11:00 AM	0.34	0.47	0.80
9/18/13 2:00 PM	0.66	0.46	1.12
9/18/13 5:00 PM	0.75	0.45	1.20
9/18/13 8:00 PM	0.69	0.44	1.13
9/18/13 11:00 PM	0.49	0.43	0.92
9/19/13 2:00 AM	0.40	0.32	0.73
9/19/13 5:00 AM	0.47	0.34	0.81
9/19/13 8:00 AM	0.41	0.46	0.88
9/19/13 11:00 AM	0.49	0.47	0.96
9/19/13 2:00 PM	0.89	0.43	1.33
9/19/13 5:00 PM	0.77	0.44	1.21
9/19/13 8:00 PM	0.78	0.43	1.21
9/19/13 11:00 PM	0.53	0.40	0.93
9/20/13 2:00 AM	0.38	0.26	0.65
9/20/13 5:00 AM	0.47	0.29	0.76
9/20/13 8:00 AM	0.53	0.44	0.98
9/20/13 11:00 AM	0.48	0.43	0.91
9/20/13 2:00 PM	0.50	0.40	0.91
9/20/13 5:00 PM	0.51	0.39	0.90
9/20/13 8:00 PM	0.63	0.36	0.99
9/20/13 11:00 PM	0.73	0.11	0.84
9/21/13 2:00 AM	0.56	0.08	0.64
9/21/13 5:00 AM	0.53	0.07	0.60
9/21/13 8:00 AM	0.59	0.16	0.74
9/21/13 11:00 AM	0.49	0.46	0.95
9/21/13 2:00 PM	0.52	0.46	0.98
9/21/13 5:00 PM	0.51	0.47	0.97
9/21/13 8:00 PM	0.26	0.46	0.72
9/21/13 11:00 PM	0.19	0.46	0.65
9/22/13 2:00 AM	0.18	0.44	0.62
9/22/13 5:00 AM	0.18	0.42	0.60
9/22/13 8:00 AM	0.21	0.42	0.62
9/22/13 11:00 AM	0.35	0.42	0.77
9/22/13 2:00 PM	0.66	0.42	1.08
9/22/13 5:00 PM	0.80	0.43	1.23
9/22/13 8:00 PM	0.75	0.41	1.16
9/22/13 11:00 PM	0.68	0.40	1.08
9/23/13 2:00 AM	0.50	0.34	0.84
9/23/13 5:00 AM	0.62	0.27	0.89
9/23/13 8:00 AM	0.78	0.39	1.17
9/23/13 11:00 AM	0.75	0.38	1.13
9/23/13 2:00 PM	0.75	0.39	1.15
9/23/13 5:00 PM	0.79	0.38	1.17
9/23/13 8:00 PM	0.75	0.37	1.12
9/23/13 11:00 PM	0.54	0.36	0.90
9/24/13 2:00 AM	0.43	0.28	0.71
9/24/13 5:00 AM	0.46	0.31	0.76
9/24/13 8:00 AM	0.80	0.36	1.16
9/24/13 11:00 AM	0.81	0.35	1.16
9/24/13 2:00 PM	0.86	0.34	1.20
9/24/13 5:00 PM	0.84	0.33	1.18
9/24/13 8:00 PM	0.69	0.34	1.02
9/24/13 11:00 PM	0.27	0.32	0.59

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
9/25/13 2:00 AM	0.33	0.16	0.48
9/25/13 5:00 AM	0.36	0.23	0.60
9/25/13 8:00 AM	0.82	0.41	1.23
9/25/13 11:00 AM	0.88	0.38	1.26
9/25/13 2:00 PM	0.88	0.40	1.28
9/25/13 5:00 PM	0.88	0.40	1.27
9/25/13 8:00 PM	0.69	0.40	1.10
9/25/13 11:00 PM	0.65	0.05	0.70
9/26/13 2:00 AM	0.47	0.02	0.48
9/26/13 5:00 AM	0.49	0.02	0.51
9/26/13 8:00 AM	0.58	0.01	0.59
9/26/13 11:00 AM	0.62	0.00	0.62
9/26/13 2:00 PM	0.72	0.00	0.72
9/26/13 5:00 PM	0.58	0.00	0.58
9/26/13 8:00 PM	0.55	0.00	0.55
9/26/13 11:00 PM	0.61	0.00	0.61
9/27/13 2:00 AM	0.55	0.00	0.55
9/27/13 5:00 AM	0.55	0.00	0.55
9/27/13 8:00 AM	0.51	0.00	0.51
9/27/13 11:00 AM	0.56	0.00	0.56
9/27/13 2:00 PM	0.62	0.00	0.62
9/27/13 5:00 PM	0.63	0.00	0.63
9/27/13 8:00 PM	0.61	0.00	0.61
9/27/13 11:00 PM	0.57	0.00	0.57
9/28/13 2:00 AM	0.56	0.00	0.56
9/28/13 5:00 AM	0.44	0.03	0.47
9/28/13 8:00 AM	0.56	0.20	0.77
9/28/13 11:00 AM	0.71	0.58	1.29
9/28/13 2:00 PM	0.71	0.52	1.23
9/28/13 5:00 PM	0.67	0.48	1.15
9/28/13 8:00 PM	0.64	0.45	1.09
9/28/13 11:00 PM	0.60	0.41	1.02
9/29/13 2:00 AM	0.49	0.26	0.75
9/29/13 5:00 AM	0.43	0.15	0.58
9/29/13 8:00 AM	0.50	0.17	0.67
9/29/13 11:00 AM	0.72	0.45	1.17
9/29/13 2:00 PM	0.74	0.50	1.24
9/29/13 5:00 PM	0.73	0.48	1.22
9/29/13 8:00 PM	0.76	0.48	1.24
9/29/13 11:00 PM	0.58	0.39	0.97
9/30/13 2:00 AM	0.41	0.13	0.54
9/30/13 5:00 AM	0.51	0.15	0.66
9/30/13 8:00 AM	0.70	0.42	1.12
9/30/13 11:00 AM	0.72	0.41	1.13
9/30/13 2:00 PM	0.83	0.43	1.26
9/30/13 5:00 PM	0.83	0.42	1.24
9/30/13 8:00 PM	0.79	0.41	1.21
9/30/13 11:00 PM	0.74	0.41	1.15
10/1/13 2:00 AM	0.56	0.23	0.79
10/1/13 5:00 AM	0.62	0.29	0.91
10/1/13 8:00 AM	0.75	0.40	1.14
10/1/13 11:00 AM	0.77	0.41	1.18
10/1/13 2:00 PM	0.75	0.43	1.18
10/1/13 5:00 PM	0.69	0.41	1.11

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
10/1/13 8:00 PM	0.77	0.40	1.17
10/1/13 11:00 PM	0.76	0.40	1.16
10/2/13 2:00 AM	0.53	0.35	0.88
10/2/13 5:00 AM	0.48	0.30	0.77
10/2/13 8:00 AM	0.67	0.33	0.99
10/2/13 11:00 AM	0.55	0.40	0.95
10/2/13 2:00 PM	0.59	0.41	0.99
10/2/13 5:00 PM	0.63	0.40	1.03
10/2/13 8:00 PM	0.79	0.40	1.19
10/2/13 11:00 PM	0.79	0.40	1.19
10/3/13 2:00 AM	0.41	0.39	0.80
10/3/13 5:00 AM	0.48	0.39	0.87
10/3/13 8:00 AM	0.74	0.39	1.13
10/3/13 11:00 AM	0.73	0.39	1.12
10/3/13 2:00 PM	0.72	0.39	1.11
10/3/13 5:00 PM	0.71	0.40	1.11
10/3/13 8:00 PM	0.68	0.40	1.08
10/3/13 11:00 PM	0.68	0.39	1.07
10/4/13 2:00 AM	0.51	0.39	0.90
10/4/13 5:00 AM	0.55	0.40	0.95
10/4/13 8:00 AM	0.86	0.38	1.24
10/4/13 11:00 AM	0.83	0.41	1.24
10/4/13 2:00 PM	0.81	0.41	1.22
10/4/13 5:00 PM	0.73	0.40	1.13
10/4/13 8:00 PM	0.76	0.40	1.16
10/4/13 11:00 PM	0.76	0.25	1.00
10/5/13 2:00 AM	0.55	0.03	0.59
10/5/13 5:00 AM	0.54	0.03	0.57
10/5/13 8:00 AM	0.68	0.29	0.97
10/5/13 11:00 AM	0.77	0.45	1.22
10/5/13 2:00 PM	0.77	0.45	1.22
10/5/13 5:00 PM	0.78	0.45	1.23
10/5/13 8:00 PM	0.76	0.48	1.24
10/5/13 11:00 PM	0.73	0.45	1.18
10/6/13 2:00 AM	0.55	0.16	0.71
10/6/13 5:00 AM	0.47	0.17	0.65
10/6/13 8:00 AM	0.59	0.30	0.90
10/6/13 11:00 AM	0.79	0.55	1.34
10/6/13 2:00 PM	0.82	0.54	1.36
10/6/13 5:00 PM	0.70	0.55	1.25
10/6/13 8:00 PM	0.67	0.53	1.21
10/6/13 11:00 PM	0.65	0.53	1.17
10/7/13 2:00 AM	0.50	0.36	0.86
10/7/13 5:00 AM	0.60	0.47	1.07
10/7/13 8:00 AM	0.64	0.52	1.16
10/7/13 11:00 AM	0.62	0.52	1.14
10/7/13 2:00 PM	0.67	0.51	1.18
10/7/13 5:00 PM	0.68	0.53	1.20
10/7/13 8:00 PM	0.64	0.52	1.16
10/7/13 11:00 PM	0.65	0.50	1.15
10/8/13 2:00 AM	0.60	0.50	1.10
10/8/13 5:00 AM	0.63	0.50	1.12
10/8/13 8:00 AM	0.69	0.48	1.17
10/8/13 11:00 AM	0.72	0.47	1.19

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
10/8/13 2:00 PM	0.70	0.47	1.17
10/8/13 5:00 PM	0.68	0.50	1.18
10/8/13 8:00 PM	0.67	0.52	1.18
10/8/13 11:00 PM	0.66	0.15	0.80
10/9/13 2:00 AM	0.42	0.11	0.52
10/9/13 5:00 AM	0.51	0.21	0.72
10/9/13 8:00 AM	0.62	0.56	1.18
10/9/13 11:00 AM	0.64	0.51	1.15
10/9/13 2:00 PM	0.65	0.58	1.23
10/9/13 5:00 PM	0.67	0.62	1.29
10/9/13 8:00 PM	0.66	0.46	1.12
10/9/13 11:00 PM	0.39	0.50	0.89
10/10/13 2:00 AM	0.21	0.23	0.44
10/10/13 5:00 AM	0.36	0.13	0.48
10/10/13 8:00 AM	0.50	0.29	0.79
10/10/13 11:00 AM	0.70	0.59	1.29
10/10/13 2:00 PM	0.72	0.54	1.26
10/10/13 5:00 PM	0.67	0.56	1.23
10/10/13 8:00 PM	0.67	0.55	1.22
10/10/13 11:00 PM	0.53	0.21	0.74
10/11/13 2:00 AM	0.47	0.10	0.58
10/11/13 5:00 AM	0.49	0.11	0.61
10/11/13 8:00 AM	0.64	0.29	0.93
10/11/13 11:00 AM	0.71	0.54	1.25
10/11/13 2:00 PM	0.72	0.54	1.26
10/11/13 5:00 PM	0.69	0.50	1.19
10/11/13 8:00 PM	0.66	0.48	1.14
10/11/13 11:00 PM	0.60	0.09	0.69
10/12/13 2:00 AM	0.46	0.05	0.52
10/12/13 5:00 AM	0.40	0.05	0.45
10/12/13 8:00 AM	0.57	0.43	1.01
10/12/13 11:00 AM	0.72	0.54	1.26
10/12/13 2:00 PM	0.75	0.52	1.26
10/12/13 5:00 PM	0.64	0.50	1.15
10/12/13 8:00 PM	0.30	0.49	0.80
10/12/13 11:00 PM	0.16	0.46	0.62
10/13/13 2:00 AM	0.12	0.32	0.44
10/13/13 5:00 AM	0.12	0.19	0.31
10/13/13 8:00 AM	0.15	0.30	0.45
10/13/13 11:00 AM	0.18	0.51	0.70
10/13/13 2:00 PM	0.21	0.51	0.73
10/13/13 5:00 PM	0.23	0.54	0.77
10/13/13 8:00 PM	0.25	0.34	0.58
10/13/13 11:00 PM	0.26	0.36	0.62
10/14/13 2:00 AM	0.12	0.33	0.46
10/14/13 5:00 AM	0.15	0.32	0.47
10/14/13 8:00 AM	0.21	0.54	0.75
10/14/13 11:00 AM	0.20	0.54	0.74
10/14/13 2:00 PM	0.20	0.50	0.70
10/14/13 5:00 PM	0.19	0.50	0.69
10/14/13 8:00 PM	0.19	0.51	0.70
10/14/13 11:00 PM	0.19	0.52	0.71
10/15/13 2:00 AM	0.15	0.50	0.65
10/15/13 5:00 AM	0.16	0.52	0.68

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
10/15/13 8:00 AM	0.19	0.50	0.70
10/15/13 11:00 AM	0.18	0.51	0.69
10/15/13 2:00 PM	0.18	0.54	0.72
10/15/13 5:00 PM	0.17	0.49	0.66
10/15/13 8:00 PM	0.18	0.48	0.65
10/15/13 11:00 PM	0.16	0.48	0.64
10/16/13 2:00 AM	0.15	0.48	0.63
10/16/13 5:00 AM	0.17	0.49	0.66
10/16/13 8:00 AM	0.19	0.48	0.67
10/16/13 11:00 AM	0.15	0.49	0.64
10/16/13 2:00 PM	0.14	0.50	0.64
10/16/13 5:00 PM	0.14	0.53	0.67
10/16/13 8:00 PM	0.14	0.52	0.66
10/16/13 11:00 PM	0.15	0.43	0.58
10/17/13 2:00 AM	0.12	0.17	0.29
10/17/13 5:00 AM	0.13	0.29	0.42
10/17/13 8:00 AM	0.25	0.47	0.72
10/17/13 11:00 AM	0.30	0.60	0.90
10/17/13 2:00 PM	0.32	0.93	1.25
10/17/13 5:00 PM	0.34	0.50	0.84
10/17/13 8:00 PM	0.29	0.37	0.66
10/17/13 11:00 PM	0.03	0.38	0.40
10/18/13 2:00 AM	0.00	0.44	0.44
10/18/13 5:00 AM	0.00	0.46	0.46
10/18/13 8:00 AM	0.00	0.47	0.47
10/18/13 11:00 AM	0.00	0.47	0.47
10/18/13 2:00 PM	0.00	0.47	0.47
10/18/13 5:00 PM	0.00	0.45	0.45
10/18/13 8:00 PM	0.00	0.44	0.44
10/18/13 11:00 PM	0.00	0.45	0.45
10/19/13 2:00 AM	0.00	0.45	0.45
10/19/13 5:00 AM	0.00	0.46	0.46
10/19/13 8:00 AM	0.00	0.49	0.49
10/19/13 11:00 AM	0.00	0.51	0.51
10/19/13 2:00 PM	0.00	0.51	0.51
10/19/13 5:00 PM	0.00	0.52	0.52
10/19/13 8:00 PM	0.00	0.56	0.56
10/19/13 11:00 PM	0.00	0.56	0.56
10/20/13 2:00 AM	0.00	0.56	0.56
10/20/13 5:00 AM	0.00	0.57	0.57
10/20/13 8:00 AM	0.00	0.51	0.51
10/20/13 11:00 AM	0.01	0.52	0.53
10/20/13 2:00 PM	0.13	0.52	0.64
10/20/13 5:00 PM	0.18	0.53	0.71
10/20/13 8:00 PM	0.24	0.52	0.76
10/20/13 11:00 PM	0.42	0.50	0.92
10/21/13 2:00 AM	0.42	0.47	0.89
10/21/13 5:00 AM	0.42	0.47	0.89
10/21/13 8:00 AM	0.40	0.49	0.88
10/21/13 11:00 AM	0.39	0.48	0.88
10/21/13 2:00 PM	0.37	0.47	0.84
10/21/13 5:00 PM	0.36	0.48	0.84
10/21/13 8:00 PM	0.45	0.48	0.93
10/21/13 11:00 PM	0.46	0.48	0.94

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
10/22/13 2:00 AM	0.19	0.46	0.65
10/22/13 5:00 AM	0.47	0.43	0.89
10/22/13 8:00 AM	0.56	0.56	1.12
10/22/13 11:00 AM	0.59	0.53	1.12
10/22/13 2:00 PM	0.75	0.49	1.23
10/22/13 5:00 PM	0.86	0.49	1.35
10/22/13 8:00 PM	0.89	0.49	1.38
10/22/13 11:00 PM	0.86	0.16	1.02
10/23/13 2:00 AM	0.62	0.09	0.71
10/23/13 5:00 AM	0.76	0.20	0.97
10/23/13 8:00 AM	0.92	0.49	1.41
10/23/13 11:00 AM	0.98	0.52	1.50
10/23/13 2:00 PM	0.91	0.56	1.47
10/23/13 5:00 PM	1.03	0.08	1.11
10/23/13 8:00 PM	1.00	0.00	1.00
10/23/13 11:00 PM	0.75	0.00	0.75
10/24/13 2:00 AM	0.24	0.00	0.24
10/24/13 5:00 AM	0.60	0.00	0.60
10/24/13 8:00 AM	1.07	0.00	1.07
10/24/13 11:00 AM	0.95	0.00	0.95
10/24/13 2:00 PM	1.05	0.00	1.05
10/24/13 5:00 PM	1.04	0.00	1.04
10/24/13 8:00 PM	1.16	0.00	1.16
10/24/13 11:00 PM	0.90	0.00	0.90
10/25/13 2:00 AM	0.71	0.00	0.71
10/25/13 5:00 AM	0.73	0.00	0.73
10/25/13 8:00 AM	1.17	0.00	1.17
10/25/13 11:00 AM	1.07	0.00	1.07
10/25/13 2:00 PM	1.01	0.00	1.01
10/25/13 5:00 PM	1.07	0.00	1.07
10/25/13 8:00 PM	1.06	0.00	1.06
10/25/13 11:00 PM	1.09	0.00	1.09
10/26/13 2:00 AM	1.04	0.00	1.04
10/26/13 5:00 AM	1.06	0.00	1.06
10/26/13 8:00 AM	1.08	0.00	1.08
10/26/13 11:00 AM	0.99	0.00	0.99
10/26/13 2:00 PM	0.84	0.00	0.84
10/26/13 5:00 PM	0.70	0.00	0.70
10/26/13 8:00 PM	0.67	0.00	0.67
10/26/13 11:00 PM	0.65	0.00	0.65
10/27/13 2:00 AM	0.70	0.00	0.70
10/27/13 5:00 AM	0.80	0.00	0.80
10/27/13 8:00 AM	0.92	0.00	0.92
10/27/13 11:00 AM	0.92	0.00	0.92
10/27/13 2:00 PM	0.93	0.00	0.93
10/27/13 5:00 PM	0.89	0.00	0.89
10/27/13 8:00 PM	0.86	0.00	0.86
10/27/13 11:00 PM	0.77	0.00	0.77
10/28/13 2:00 AM	0.49	0.00	0.49
10/28/13 5:00 AM	0.75	0.00	0.75
10/28/13 8:00 AM	1.11	0.00	1.11
10/28/13 11:00 AM	0.97	0.00	0.97
10/28/13 2:00 PM	0.93	0.00	0.93
10/28/13 5:00 PM	0.93	0.00	0.93

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
10/28/13 8:00 PM	0.95	0.00	0.95
10/28/13 11:00 PM	0.77	0.00	0.77
10/29/13 2:00 AM	0.55	0.00	0.55
10/29/13 5:00 AM	0.75	0.00	0.75
10/29/13 8:00 AM	1.03	0.00	1.03
10/29/13 11:00 AM	1.03	0.00	1.03
10/29/13 2:00 PM	1.05	0.00	1.05
10/29/13 5:00 PM	0.99	0.00	0.99
10/29/13 8:00 PM	0.94	0.00	0.94
10/29/13 11:00 PM	0.57	0.00	0.57
10/30/13 2:00 AM	0.44	0.00	0.44
10/30/13 5:00 AM	0.50	0.00	0.50
10/30/13 8:00 AM	0.87	0.00	0.87
10/30/13 11:00 AM	0.95	0.00	0.95
10/30/13 2:00 PM	1.03	0.00	1.03
10/30/13 5:00 PM	0.98	0.00	0.98
10/30/13 8:00 PM	0.98	0.00	0.98
10/30/13 11:00 PM	0.76	0.00	0.76
10/31/13 2:00 AM	0.52	0.00	0.52
10/31/13 5:00 AM	0.65	0.00	0.65
10/31/13 8:00 AM	0.94	0.00	0.94
10/31/13 11:00 AM	0.95	0.00	0.95
10/31/13 2:00 PM	0.98	0.00	0.98
10/31/13 5:00 PM	0.95	0.00	0.95
10/31/13 8:00 PM	0.95	0.00	0.95
10/31/13 11:00 PM	0.94	0.00	0.94
11/1/13 2:00 AM	0.92	0.00	0.92
11/1/13 5:00 AM	0.89	0.00	0.89
11/1/13 8:00 AM	0.82	0.00	0.82
11/1/13 11:00 AM	0.89	0.00	0.89
11/1/13 2:00 PM	0.44	0.00	0.44
11/1/13 5:00 PM	0.91	0.00	0.91
11/1/13 8:00 PM	0.89	0.00	0.89
11/1/13 11:00 PM	0.91	0.00	0.91
11/2/13 2:00 AM	0.94	0.00	0.94
11/2/13 5:00 AM	0.91	0.00	0.91
11/2/13 8:00 AM	0.92	0.00	0.92
11/2/13 11:00 AM	0.78	0.00	0.78
11/2/13 2:00 PM	0.88	0.00	0.88
11/2/13 5:00 PM	0.83	0.00	0.83
11/2/13 8:00 PM	0.74	0.00	0.74
11/2/13 11:00 PM	0.56	0.00	0.56
11/3/13 2:00 AM	0.44	0.00	0.44
11/3/13 5:00 AM	0.49	0.00	0.49
11/3/13 8:00 AM	0.59	0.00	0.59
11/3/13 11:00 AM	0.81	0.00	0.81
11/3/13 2:00 PM	0.78	0.00	0.78
11/3/13 5:00 PM	0.71	0.00	0.71
11/3/13 8:00 PM	0.73	0.00	0.73
11/3/13 11:00 PM	0.71	0.00	0.71
11/4/13 2:00 AM	0.57	0.00	0.57
11/4/13 5:00 AM	0.74	0.00	0.74
11/4/13 8:00 AM	1.07	0.00	1.07
11/4/13 11:00 AM	1.18	0.00	1.18

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
11/4/13 2:00 PM	0.94	0.00	0.94
11/4/13 5:00 PM	0.81	0.00	0.81
11/4/13 8:00 PM	0.68	0.00	0.68
11/4/13 11:00 PM	0.71	0.00	0.71
11/5/13 2:00 AM	0.62	0.00	0.62
11/5/13 5:00 AM	0.61	0.00	0.61
11/5/13 8:00 AM	0.64	0.00	0.64
11/5/13 11:00 AM	0.72	0.00	0.72
11/5/13 2:00 PM	0.91	0.00	0.91
11/5/13 5:00 PM	0.97	0.00	0.97
11/5/13 8:00 PM	0.93	0.00	0.93
11/5/13 11:00 PM	0.91	0.09	0.99
11/6/13 2:00 AM	0.66	0.23	0.89
11/6/13 5:00 AM	0.62	0.20	0.81
11/6/13 8:00 AM	1.01	0.18	1.20
11/6/13 11:00 AM	1.06	0.28	1.34
11/6/13 2:00 PM	1.14	0.54	1.67
11/6/13 5:00 PM	1.05	0.50	1.55
11/6/13 8:00 PM	0.86	0.49	1.35
11/6/13 11:00 PM	0.55	0.47	1.02
11/7/13 2:00 AM	0.20	0.23	0.43
11/7/13 5:00 AM	0.30	0.30	0.60
11/7/13 8:00 AM	0.41	0.47	0.88
11/7/13 11:00 AM	0.42	0.47	0.89
11/7/13 2:00 PM	0.42	1.11	1.53
11/7/13 5:00 PM	0.41	0.41	0.82
11/7/13 8:00 PM	0.37	0.40	0.77
11/7/13 11:00 PM	0.38	0.39	0.78
11/8/13 2:00 AM	0.26	0.40	0.66
11/8/13 5:00 AM	0.17	0.39	0.56
11/8/13 8:00 AM	0.19	0.39	0.58
11/8/13 11:00 AM	0.18	0.36	0.54
11/8/13 2:00 PM	0.18	0.36	0.54
11/8/13 5:00 PM	0.18	0.35	0.52
11/8/13 8:00 PM	0.17	0.32	0.49
11/8/13 11:00 PM	0.17	0.33	0.50
11/9/13 2:00 AM	0.16	0.29	0.46
11/9/13 5:00 AM	0.15	0.31	0.46
11/9/13 8:00 AM	0.17	0.38	0.55
11/9/13 11:00 AM	0.17	0.39	0.55
11/9/13 2:00 PM	0.17	0.39	0.56
11/9/13 5:00 PM	0.16	0.39	0.55
11/9/13 8:00 PM	0.10	0.39	0.50
11/9/13 11:00 PM	0.00	0.40	0.41
11/10/13 2:00 AM	0.00	0.40	0.40
11/10/13 5:00 AM	0.00	0.40	0.40
11/10/13 8:00 AM	0.00	0.39	0.39
11/10/13 11:00 AM	0.00	0.39	0.39
11/10/13 2:00 PM	0.00	0.38	0.38
11/10/13 5:00 PM	0.01	0.40	0.41
11/10/13 8:00 PM	0.07	0.40	0.46
11/10/13 11:00 PM	0.14	0.40	0.54
11/11/13 2:00 AM	0.14	0.40	0.54
11/11/13 5:00 AM	0.12	0.40	0.53

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
11/11/13 8:00 AM	0.15	0.41	0.56
11/11/13 11:00 AM	0.18	0.42	0.60
11/11/13 2:00 PM	0.18	0.42	0.60
11/11/13 5:00 PM	0.19	0.43	0.62
11/11/13 8:00 PM	0.54	0.42	0.96
11/11/13 11:00 PM	0.84	0.41	1.25
11/12/13 2:00 AM	0.69	0.23	0.92
11/12/13 5:00 AM	0.29	0.41	0.69
11/12/13 8:00 AM	0.24	0.44	0.68
11/12/13 11:00 AM	0.39	0.43	0.82
11/12/13 2:00 PM	0.44	0.42	0.86
11/12/13 5:00 PM	0.36	0.41	0.77
11/12/13 8:00 PM	0.34	0.41	0.75
11/12/13 11:00 PM	0.21	0.41	0.62
11/13/13 2:00 AM	0.16	0.34	0.50
11/13/13 5:00 AM	0.13	0.22	0.36
11/13/13 8:00 AM	0.17	0.44	0.61
11/13/13 11:00 AM	0.17	0.43	0.61
11/13/13 2:00 PM	0.31	0.43	0.74
11/13/13 5:00 PM	0.23	0.43	0.66
11/13/13 8:00 PM	0.18	0.95	1.13
11/13/13 11:00 PM	0.17	1.47	1.64
11/14/13 2:00 AM	0.16	0.70	0.86
11/14/13 5:00 AM	0.12	0.50	0.62
11/14/13 8:00 AM	0.18	0.48	0.66
11/14/13 11:00 AM	0.19	0.51	0.69
11/14/13 2:00 PM	0.21	0.47	0.69
11/14/13 5:00 PM	0.24	0.47	0.71
11/14/13 8:00 PM	0.23	0.48	0.71
11/14/13 11:00 PM	0.18	0.48	0.66
11/15/13 2:00 AM	0.16	0.14	0.31
11/15/13 5:00 AM	0.18	0.06	0.24
11/15/13 8:00 AM	0.24	0.49	0.73
11/15/13 11:00 AM	0.22	0.57	0.79
11/15/13 2:00 PM	0.23	0.54	0.77
11/15/13 5:00 PM	0.23	0.55	0.78
11/15/13 8:00 PM	0.22	0.58	0.80
11/15/13 11:00 PM	0.21	0.50	0.71
11/16/13 2:00 AM	0.13	0.21	0.34
11/16/13 5:00 AM	0.12	0.09	0.21
11/16/13 8:00 AM	0.16	0.18	0.34
11/16/13 11:00 AM	0.28	0.60	0.88
11/16/13 2:00 PM	0.29	0.55	0.84
11/16/13 5:00 PM	0.28	0.57	0.85
11/16/13 8:00 PM	0.26	0.57	0.83
11/16/13 11:00 PM	0.27	0.53	0.80
11/17/13 2:00 AM	0.14	0.31	0.45
11/17/13 5:00 AM	0.08	0.23	0.31
11/17/13 8:00 AM	0.13	0.39	0.52
11/17/13 11:00 AM	0.30	0.57	0.86
11/17/13 2:00 PM	0.28	0.55	0.83
11/17/13 5:00 PM	0.29	0.55	0.84
11/17/13 8:00 PM	0.27	0.53	0.80
11/17/13 11:00 PM	0.26	0.51	0.77

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
11/18/13 2:00 AM	0.31	0.51	0.83
11/18/13 5:00 AM	0.33	0.49	0.82
11/18/13 8:00 AM	0.34	0.47	0.81
11/18/13 11:00 AM	0.44	0.44	0.88
11/18/13 2:00 PM	0.40	0.43	0.83
11/18/13 5:00 PM	0.41	0.41	0.82
11/18/13 8:00 PM	0.59	0.41	1.00
11/18/13 11:00 PM	1.06	0.41	1.47
11/19/13 2:00 AM	1.04	0.40	1.44
11/19/13 5:00 AM	0.91	0.39	1.30
11/19/13 8:00 AM	1.03	0.37	1.40
11/19/13 11:00 AM	1.07	0.38	1.44
11/19/13 2:00 PM	0.99	0.37	1.36
11/19/13 5:00 PM	0.89	0.37	1.26
11/19/13 8:00 PM	0.73	0.37	1.11
11/19/13 11:00 PM	0.78	0.35	1.13
11/20/13 2:00 AM	0.69	0.07	0.77
11/20/13 5:00 AM	0.66	0.15	0.81
11/20/13 8:00 AM	0.80	0.43	1.23
11/20/13 11:00 AM	0.77	0.42	1.19
11/20/13 2:00 PM	0.83	0.44	1.28
11/20/13 5:00 PM	0.79	0.44	1.23
11/20/13 8:00 PM	0.75	0.26	1.01
11/20/13 11:00 PM	0.83	0.25	1.08
11/21/13 2:00 AM	0.71	0.38	1.09
11/21/13 5:00 AM	0.72	0.27	0.99
11/21/13 8:00 AM	0.75	0.43	1.17
11/21/13 11:00 AM	0.69	0.42	1.12
11/21/13 2:00 PM	0.73	0.44	1.16
11/21/13 5:00 PM	0.64	0.48	1.12
11/21/13 8:00 PM	0.52	0.44	0.95
11/21/13 11:00 PM	0.28	0.43	0.71
11/22/13 2:00 AM	0.20	0.42	0.61
11/22/13 5:00 AM	0.17	0.42	0.59
11/22/13 8:00 AM	0.23	0.42	0.65
11/22/13 11:00 AM	0.21	0.42	0.63
11/22/13 2:00 PM	0.23	0.41	0.64
11/22/13 5:00 PM	0.26	0.42	0.68
11/22/13 8:00 PM	0.27	0.42	0.68
11/22/13 11:00 PM	0.26	0.52	0.78
11/23/13 2:00 AM	0.24	0.60	0.84
11/23/13 5:00 AM	0.20	0.50	0.70
11/23/13 8:00 AM	0.20	0.42	0.61
11/23/13 11:00 AM	0.17	0.43	0.60
11/23/13 2:00 PM	0.17	0.43	0.60
11/23/13 5:00 PM	0.18	0.50	0.68
11/23/13 8:00 PM	0.10	0.45	0.55
11/23/13 11:00 PM	0.00	0.44	0.44
11/24/13 2:00 AM	0.00	0.43	0.43
11/24/13 5:00 AM	0.00	0.43	0.43
11/24/13 8:00 AM	0.00	0.44	0.44
11/24/13 11:00 AM	0.00	0.46	0.46
11/24/13 2:00 PM	0.00	0.51	0.51
11/24/13 5:00 PM	0.00	0.61	0.61

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
11/24/13 8:00 PM	0.00	0.59	0.59
11/24/13 11:00 PM	0.00	0.57	0.57
11/25/13 2:00 AM	0.00	0.56	0.56
11/25/13 5:00 AM	0.00	0.59	0.59
11/25/13 8:00 AM	0.00	0.62	0.62
11/25/13 11:00 AM	0.01	0.60	0.61
11/25/13 2:00 PM	0.06	0.49	0.55
11/25/13 5:00 PM	0.19	0.45	0.64
11/25/13 8:00 PM	0.18	0.44	0.62
11/25/13 11:00 PM	0.19	0.44	0.63
11/26/13 2:00 AM	0.19	0.43	0.62
11/26/13 5:00 AM	0.22	0.37	0.59
11/26/13 8:00 AM	0.24	0.51	0.75
11/26/13 11:00 AM	0.21	0.63	0.84
11/26/13 2:00 PM	0.21	0.46	0.67
11/26/13 5:00 PM	0.21	0.43	0.64
11/26/13 8:00 PM	0.21	0.43	0.64
11/26/13 11:00 PM	0.22	0.43	0.65
11/27/13 2:00 AM	0.17	0.45	0.62
11/27/13 5:00 AM	0.13	0.43	0.56
11/27/13 8:00 AM	0.24	0.42	0.66
11/27/13 11:00 AM	0.21	0.40	0.61
11/27/13 2:00 PM	0.31	0.43	0.75
11/27/13 5:00 PM	0.31	0.44	0.75
11/27/13 8:00 PM	0.32	0.43	0.75
11/27/13 11:00 PM	0.33	0.71	1.04
11/28/13 2:00 AM	0.45	0.42	0.87
11/28/13 5:00 AM	0.70	0.58	1.29
11/28/13 8:00 AM	0.77	0.51	1.28
11/28/13 11:00 AM	0.74	0.47	1.21
11/28/13 2:00 PM	0.77	0.39	1.17
11/28/13 5:00 PM	0.56	0.25	0.81
11/28/13 8:00 PM	0.50	0.26	0.75
11/28/13 11:00 PM	0.57	0.22	0.79
11/29/13 2:00 AM	0.61	0.22	0.83
11/29/13 5:00 AM	0.54	0.22	0.76
11/29/13 8:00 AM	0.74	0.24	0.98
11/29/13 11:00 AM	0.89	0.33	1.22
11/29/13 2:00 PM	0.75	0.31	1.06
11/29/13 5:00 PM	0.64	0.31	0.94
11/29/13 8:00 PM	0.70	0.34	1.04
11/29/13 11:00 PM	0.61	0.17	0.78
11/30/13 2:00 AM	0.47	0.12	0.59
11/30/13 5:00 AM	0.48	0.12	0.60
11/30/13 8:00 AM	0.85	0.26	1.11
11/30/13 11:00 AM	0.99	0.48	1.47
11/30/13 2:00 PM	0.84	0.52	1.36
11/30/13 5:00 PM	0.86	0.32	1.19
11/30/13 8:00 PM	0.95	0.23	1.18
11/30/13 11:00 PM	0.76	0.11	0.87
12/1/13 2:00 AM	0.58	0.10	0.68
12/1/13 5:00 AM	0.54	0.11	0.65
12/1/13 8:00 AM	0.67	0.12	0.79
12/1/13 11:00 AM	0.86	0.44	1.30

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
12/1/13 2:00 PM	0.91	0.57	1.48
12/1/13 5:00 PM	0.89	0.58	1.47
12/1/13 8:00 PM	0.91	0.54	1.45
12/1/13 11:00 PM	0.74	0.36	1.10
12/2/13 2:00 AM	0.64	0.07	0.71
12/2/13 5:00 AM	0.61	0.08	0.69
12/2/13 8:00 AM	1.03	0.73	1.76
12/2/13 11:00 AM	1.10	0.67	1.77
12/2/13 2:00 PM	1.07	0.47	1.54
12/2/13 5:00 PM	0.82	0.49	1.30
12/2/13 8:00 PM	0.99	0.52	1.51
12/2/13 11:00 PM	0.77	0.24	1.01
12/3/13 2:00 AM	0.62	0.07	0.69
12/3/13 5:00 AM	0.60	0.08	0.67
12/3/13 8:00 AM	0.89	0.25	1.14
12/3/13 11:00 AM	0.83	0.56	1.39
12/3/13 2:00 PM	0.96	0.54	1.50
12/3/13 5:00 PM	0.94	0.54	1.49
12/3/13 8:00 PM	1.00	0.52	1.51
12/3/13 11:00 PM	0.86	0.41	1.28
12/4/13 2:00 AM	0.53	0.10	0.63
12/4/13 5:00 AM	0.52	0.11	0.62
12/4/13 8:00 AM	1.13	0.17	1.31
12/4/13 11:00 AM	0.91	0.58	1.49
12/4/13 2:00 PM	0.95	0.55	1.50
12/4/13 5:00 PM	0.93	0.54	1.47
12/4/13 8:00 PM	0.87	0.51	1.39
12/4/13 11:00 PM	0.62	0.47	1.09
12/5/13 2:00 AM	0.46	0.17	0.63
12/5/13 5:00 AM	0.43	0.23	0.66
12/5/13 8:00 AM	0.78	0.56	1.34
12/5/13 11:00 AM	0.92	0.64	1.55
12/5/13 2:00 PM	0.91	0.63	1.55
12/5/13 5:00 PM	0.91	0.59	1.50
12/5/13 8:00 PM	0.85	0.52	1.37
12/5/13 11:00 PM	0.71	0.51	1.22
12/6/13 2:00 AM	0.49	0.31	0.80
12/6/13 5:00 AM	0.46	0.34	0.79
12/6/13 8:00 AM	0.76	0.56	1.32
12/6/13 11:00 AM	0.84	0.56	1.40
12/6/13 2:00 PM	0.85	0.51	1.36
12/6/13 5:00 PM	0.73	0.52	1.26
12/6/13 8:00 PM	1.08	0.52	1.59
12/6/13 11:00 PM	0.91	0.53	1.44
12/7/13 2:00 AM	0.78	0.27	1.05
12/7/13 5:00 AM	0.76	0.25	1.00
12/7/13 8:00 AM	0.87	0.59	1.47
12/7/13 11:00 AM	1.02	0.50	1.53
12/7/13 2:00 PM	1.22	0.49	1.71
12/7/13 5:00 PM	0.95	0.52	1.47
12/7/13 8:00 PM	0.86	0.53	1.40
12/7/13 11:00 PM	0.83	0.48	1.31
12/8/13 2:00 AM	0.72	0.19	0.91
12/8/13 5:00 AM	0.65	0.14	0.79

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
12/8/13 8:00 AM	0.91	0.15	1.06
12/8/13 11:00 AM	1.21	0.50	1.71
12/8/13 2:00 PM	0.62	0.53	1.16
12/8/13 5:00 PM	0.47	0.55	1.02
12/8/13 8:00 PM	0.49	0.51	1.01
12/8/13 11:00 PM	0.52	0.49	1.02
12/9/13 2:00 AM	0.42	0.38	0.80
12/9/13 5:00 AM	0.40	0.36	0.76
12/9/13 8:00 AM	0.54	0.48	1.02
12/9/13 11:00 AM	0.57	0.48	1.05
12/9/13 2:00 PM	0.72	0.50	1.22
12/9/13 5:00 PM	0.87	0.54	1.41
12/9/13 8:00 PM	0.57	0.54	1.11
12/9/13 11:00 PM	0.50	0.52	1.02
12/10/13 2:00 AM	0.44	0.35	0.80
12/10/13 5:00 AM	0.44	0.32	0.75
12/10/13 8:00 AM	0.50	0.53	1.03
12/10/13 11:00 AM	0.54	0.55	1.09
12/10/13 2:00 PM	0.51	0.55	1.06
12/10/13 5:00 PM	0.34	0.55	0.90
12/10/13 8:00 PM	0.22	0.52	0.74
12/10/13 11:00 PM	0.22	0.51	0.73
12/11/13 2:00 AM	0.21	0.50	0.72
12/11/13 5:00 AM	0.23	0.54	0.77
12/11/13 8:00 AM	0.26	0.55	0.80
12/11/13 11:00 AM	0.23	0.55	0.79
12/11/13 2:00 PM	0.22	0.59	0.82
12/11/13 5:00 PM	0.24	0.59	0.83
12/11/13 8:00 PM	0.27	0.61	0.89
12/11/13 11:00 PM	0.28	0.59	0.87
12/12/13 2:00 AM	0.30	0.58	0.88
12/12/13 5:00 AM	0.30	0.57	0.87
12/12/13 8:00 AM	0.21	0.56	0.77
12/12/13 11:00 AM	0.19	0.57	0.76
12/12/13 2:00 PM	0.25	0.50	0.74
12/12/13 5:00 PM	0.20	0.45	0.65
12/12/13 8:00 PM	0.16	0.47	0.62
12/12/13 11:00 PM	0.01	0.52	0.53
12/13/13 2:00 AM	0.00	0.26	0.26
12/13/13 5:00 AM	0.00	0.24	0.24
12/13/13 8:00 AM	0.00	0.48	0.48
12/13/13 11:00 AM	0.00	0.47	0.47
12/13/13 2:00 PM	0.00	0.54	0.54
12/13/13 5:00 PM	0.00	0.54	0.54
12/13/13 8:00 PM	0.00	0.53	0.53
12/13/13 11:00 PM	0.00	0.57	0.57
12/14/13 2:00 AM	0.00	0.57	0.57
12/14/13 5:00 AM	0.00	0.58	0.58
12/14/13 8:00 AM	0.00	0.58	0.58
12/14/13 11:00 AM	0.00	0.54	0.54
12/14/13 2:00 PM	0.00	0.56	0.56
12/14/13 5:00 PM	0.01	0.57	0.57
12/14/13 8:00 PM	0.11	0.55	0.66
12/14/13 11:00 PM	0.17	0.58	0.75

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
12/15/13 2:00 AM	0.45	0.61	1.06
12/15/13 5:00 AM	0.34	0.42	0.76
12/15/13 8:00 AM	0.35	0.49	0.84
12/15/13 11:00 AM	0.61	0.58	1.19
12/15/13 2:00 PM	0.76	0.58	1.33
12/15/13 5:00 PM	0.70	0.55	1.25
12/15/13 8:00 PM	0.76	0.51	1.27
12/15/13 11:00 PM	0.79	0.38	1.17
12/16/13 2:00 AM	0.57	0.20	0.77
12/16/13 5:00 AM	0.62	0.16	0.78
12/16/13 8:00 AM	0.61	0.35	0.96
12/16/13 11:00 AM	0.51	0.03	0.54
12/16/13 2:00 PM	0.45	0.26	0.71
12/16/13 5:00 PM	0.36	0.33	0.69
12/16/13 8:00 PM	0.39	0.31	0.70
12/16/13 11:00 PM	0.38	0.29	0.68
12/17/13 2:00 AM	0.36	0.31	0.67
12/17/13 5:00 AM	0.23	0.33	0.56
12/17/13 8:00 AM	0.25	0.29	0.53
12/17/13 11:00 AM	0.27	0.02	0.29
12/17/13 2:00 PM	0.29	0.02	0.32
12/17/13 5:00 PM	0.30	0.17	0.47
12/17/13 8:00 PM	0.32	0.24	0.56
12/17/13 11:00 PM	0.32	0.23	0.55
12/18/13 2:00 AM	0.31	0.22	0.53
12/18/13 5:00 AM	0.31	0.21	0.52
12/18/13 8:00 AM	0.39	0.21	0.60
12/18/13 11:00 AM	0.62	0.19	0.81
12/18/13 2:00 PM	0.90	0.22	1.12
12/18/13 5:00 PM	0.86	0.24	1.10
12/18/13 8:00 PM	0.75	0.12	0.87
12/18/13 11:00 PM	0.68	0.31	0.99
12/19/13 2:00 AM	0.53	0.36	0.89
12/19/13 5:00 AM	0.49	0.37	0.86
12/19/13 8:00 AM	0.60	0.43	1.03
12/19/13 11:00 AM	0.69	0.48	1.17
12/19/13 2:00 PM	0.61	0.46	1.06
12/19/13 5:00 PM	0.62	0.44	1.07
12/19/13 8:00 PM	0.55	0.45	1.00
12/19/13 11:00 PM	0.54	0.45	0.99
12/20/13 2:00 AM	0.48	0.28	0.76
12/20/13 5:00 AM	0.43	0.37	0.80
12/20/13 8:00 AM	0.46	0.45	0.91
12/20/13 11:00 AM	0.43	0.49	0.92
12/20/13 2:00 PM	0.51	0.48	0.99
12/20/13 5:00 PM	0.51	0.49	1.00
12/20/13 8:00 PM	0.49	0.46	0.95
12/20/13 11:00 PM	0.50	0.49	0.99
12/21/13 2:00 AM	0.25	0.46	0.71
12/21/13 5:00 AM	0.27	0.38	0.64
12/21/13 8:00 AM	0.29	0.57	0.86
12/21/13 11:00 AM	0.26	0.76	1.01
12/21/13 2:00 PM	0.25	0.59	0.84
12/21/13 5:00 PM	0.19	0.54	0.73

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
12/21/13 8:00 PM	0.18	0.53	0.72
12/21/13 11:00 PM	0.20	0.54	0.74
12/22/13 2:00 AM	0.16	0.39	0.56
12/22/13 5:00 AM	0.18	0.19	0.37
12/22/13 8:00 AM	0.27	0.47	0.74
12/22/13 11:00 AM	0.26	0.64	0.90
12/22/13 2:00 PM	0.32	0.63	0.95
12/22/13 5:00 PM	0.41	0.62	1.03
12/22/13 8:00 PM	0.43	0.63	1.06
12/22/13 11:00 PM	0.48	0.67	1.15
12/23/13 2:00 AM	0.48	0.67	1.15
12/23/13 5:00 AM	0.47	0.55	1.01
12/23/13 8:00 AM	0.55	0.52	1.06
12/23/13 11:00 AM	0.43	0.55	0.98
12/23/13 2:00 PM	0.29	0.53	0.82
12/23/13 5:00 PM	0.34	0.52	0.86
12/23/13 8:00 PM	0.20	0.55	0.75
12/23/13 11:00 PM	0.00	0.57	0.57
12/24/13 2:00 AM	0.00	0.53	0.53
12/24/13 5:00 AM	0.00	0.32	0.32
12/24/13 8:00 AM	0.00	0.42	0.42
12/24/13 11:00 AM	0.00	0.51	0.51
12/24/13 2:00 PM	0.00	0.54	0.54
12/24/13 5:00 PM	0.00	0.54	0.54
12/24/13 8:00 PM	0.00	0.52	0.52
12/24/13 11:00 PM	0.00	0.52	0.52
12/25/13 2:00 AM	0.00	0.39	0.39
12/25/13 5:00 AM	0.00	0.24	0.24
12/25/13 8:00 AM	0.00	0.41	0.41
12/25/13 11:00 AM	0.00	0.52	0.52
12/25/13 2:00 PM	0.00	0.52	0.52
12/25/13 5:00 PM	0.00	0.50	0.50
12/25/13 8:00 PM	0.00	0.53	0.53
12/25/13 11:00 PM	0.00	0.52	0.52
12/26/13 2:00 AM	0.00	0.46	0.46
12/26/13 5:00 AM	0.03	0.22	0.25
12/26/13 8:00 AM	0.03	0.26	0.29
12/26/13 11:00 AM	0.04	0.48	0.52
12/26/13 2:00 PM	0.20	0.49	0.69
12/26/13 5:00 PM	0.38	0.50	0.88
12/26/13 8:00 PM	0.43	0.50	0.92
12/26/13 11:00 PM	0.38	0.51	0.88
12/27/13 2:00 AM	0.31	0.38	0.68
12/27/13 5:00 AM	0.26	0.16	0.42
12/27/13 8:00 AM	0.27	0.51	0.77
12/27/13 11:00 AM	0.26	0.51	0.77
12/27/13 2:00 PM	0.24	0.50	0.74
12/27/13 5:00 PM	0.21	0.48	0.69
12/27/13 8:00 PM	0.18	0.53	0.71
12/27/13 11:00 PM	0.17	0.49	0.66
12/28/13 2:00 AM	0.17	0.48	0.66
12/28/13 5:00 AM	0.21	0.37	0.57
12/28/13 8:00 AM	0.27	0.28	0.56
12/28/13 11:00 AM	0.34	0.21	0.55

Date	CS0W1 3 HR AVG tons	UNIT 3 3 HR AVG tons	Total 3 HR AVG SO2 tons
12/28/13 2:00 PM	0.33	0.09	0.43
12/28/13 5:00 PM	0.33	0.10	0.43
12/28/13 8:00 PM	0.45	0.10	0.56
12/28/13 11:00 PM	0.62	0.12	0.74
12/29/13 2:00 AM	0.55	0.14	0.69
12/29/13 5:00 AM	0.44	0.16	0.60
12/29/13 8:00 AM	0.62	0.18	0.79
12/29/13 11:00 AM	0.68	0.14	0.82
12/29/13 2:00 PM	0.57	0.00	0.57
12/29/13 5:00 PM	0.54	0.00	0.54
12/29/13 8:00 PM	0.56	0.00	0.56
12/29/13 11:00 PM	0.56	0.00	0.56
12/30/13 2:00 AM	0.52	0.00	0.52
12/30/13 5:00 AM	0.54	0.00	0.54
12/30/13 8:00 AM	0.61	0.00	0.61
12/30/13 11:00 AM	0.53	0.00	0.53
12/30/13 2:00 PM	0.75	0.00	0.75
12/30/13 5:00 PM	0.70	0.00	0.70
12/30/13 8:00 PM	0.59	0.00	0.59
12/30/13 11:00 PM	0.57	0.00	0.57
12/31/13 2:00 AM	0.59	0.00	0.59
12/31/13 5:00 AM	0.47	0.00	0.47
12/31/13 8:00 AM	0.49	0.17	0.66
12/31/13 11:00 AM	0.53	0.83	1.36
12/31/13 2:00 PM	0.58	0.58	1.16
12/31/13 5:00 PM	0.60	0.50	1.11
12/31/13 8:00 PM	0.63	0.46	1.09
12/31/13 11:00 PM	0.64	0.40	1.05
Average	0.52	0.27	0.70
Unit (Peak)	3.79	1.43	3.99
Units 1 - 3 (Peak)		9.21	
Units 1 - 3 Limit		31.50	

Date	CS0W1 24 hr Avg tons/hr	Unit 3 24 hr Avg tons/hr	Units 1,2,&3 Total SO2 tons/hr
1/1/2009	0.21	0.27	0.48
1/2/2009	0.23	0.16	0.39
1/3/2009	0.16	0.15	0.32
1/4/2009	0.19	0.12	0.30
1/5/2009	0.21	0.15	0.36
1/6/2009	0.21	0.16	0.36
1/7/2009	0.20	0.27	0.47
1/8/2009	0.20	0.54	0.74
1/9/2009	0.18	0.32	0.51
1/10/2009	0.07	0.28	0.35
1/11/2009	0.23	0.14	0.37
1/12/2009	0.32	0.16	0.49
1/13/2009	0.24	0.16	0.41
1/14/2009	0.24	0.15	0.40
1/15/2009	0.21	0.15	0.37
1/16/2009	0.18	0.18	0.36
1/17/2009	0.16	0.22	0.38
1/18/2009	0.18	0.41	0.58
1/19/2009	0.04	0.10	0.14
1/20/2009	0.00	0.00	0.00
1/21/2009	0.11	0.00	0.11
1/22/2009	0.53	0.24	0.77
1/23/2009	0.53	0.25	0.77
1/24/2009	0.45	0.34	0.78
1/25/2009	0.43	0.33	0.76
1/26/2009	0.52	0.38	0.90
1/27/2009	0.54	0.25	0.79
1/28/2009	0.45	0.28	0.73
1/29/2009	0.39	0.22	0.61
1/30/2009	0.32	0.19	0.51
1/31/2009	0.42	0.20	0.63
2/1/2009	0.41	0.26	0.67
2/2/2009	0.41	0.29	0.70
2/3/2009	0.43	0.19	0.62
2/4/2009	0.49	0.27	0.76
2/5/2009	0.49	0.31	0.80
2/6/2009	0.45	0.21	0.66
2/7/2009	0.53	0.26	0.79
2/8/2009	0.57	0.28	0.85
2/9/2009	0.00	0.23	0.23
2/10/2009	0.00	0.37	0.37
2/11/2009	0.00	0.20	0.20
2/12/2009	0.00	0.22	0.22
2/13/2009	0.00	0.27	0.27
2/14/2009	0.00	0.31	0.31
2/15/2009	0.00	0.39	0.39
2/16/2009	0.00	0.34	0.34
2/17/2009	0.40	0.33	0.74
2/18/2009	0.43	0.29	0.72
2/19/2009	0.40	0.27	0.68
2/20/2009	0.38	0.26	0.64
2/21/2009	0.37	0.00	0.37
2/22/2009	0.35	0.12	0.47
2/23/2009	0.30	0.21	0.50

Date	CS0W1 24 hr Avg tons/hr	Unit 3 24 hr Avg tons/hr	Units 1,2,&3 Total SO2 tons/hr
2/24/2009	0.31	0.22	0.53
2/25/2009	0.26	0.20	0.45
2/26/2009	0.33	0.25	0.58
2/27/2009	0.31	0.34	0.66
2/28/2009	0.16	0.40	0.56
3/1/2009	0.36	0.19	0.55
3/2/2009	0.33	0.20	0.53
3/3/2009	0.31	0.22	0.53
3/4/2009	0.34	0.31	0.64
3/5/2009	0.32	0.25	0.57
3/6/2009	0.22	0.15	0.37
3/7/2009	0.23	0.14	0.37
3/8/2009	0.20	0.16	0.35
3/9/2009	0.24	0.25	0.48
3/10/2009	0.11	0.25	0.36
3/11/2009	0.00	0.21	0.21
3/12/2009	0.00	0.20	0.20
3/13/2009	0.00	0.18	0.18
3/14/2009	0.00	0.17	0.17
3/15/2009	0.00	0.18	0.18
3/16/2009	0.00	0.26	0.26
3/17/2009	0.00	0.20	0.20
3/18/2009	0.00	0.14	0.14
3/19/2009	0.00	0.13	0.13
3/20/2009	0.00	0.09	0.09
3/21/2009	0.00	0.07	0.07
3/22/2009	0.00	0.13	0.13
3/23/2009	0.04	0.23	0.27
3/24/2009	0.33	0.39	0.72
3/25/2009	0.15	0.28	0.42
3/26/2009	0.23	0.14	0.38
3/27/2009	0.26	0.28	0.54
3/28/2009	0.42	0.18	0.60
3/29/2009	0.31	0.11	0.42
3/30/2009	0.69	0.11	0.80
3/31/2009	0.67	0.13	0.79
4/1/2009	0.54	0.15	0.69
4/2/2009	0.01	0.18	0.18
4/3/2009	0.81	0.17	0.98
4/4/2009	0.53	0.20	0.73
4/5/2009	0.34	0.21	0.55
4/6/2009	0.37	0.18	0.55
4/7/2009	0.39	0.23	0.62
4/8/2009	0.28	0.28	0.56
4/9/2009	0.36	0.30	0.66
4/10/2009	0.38	0.20	0.58
4/11/2009	0.47	0.21	0.67
4/12/2009	0.35	0.35	0.70
4/13/2009	0.55	0.30	0.85
4/14/2009	0.56	0.26	0.82
4/15/2009	0.72	0.32	1.04
4/16/2009	0.29	0.20	0.49
4/17/2009	0.21	0.23	0.43
4/18/2009	0.00	0.20	0.20

Date	CS0W1 24 hr Avg tons/hr	Unit 3 24 hr Avg tons/hr	Units 1,2,&3 Total SO2 tons/hr
4/19/2009	0.00	0.18	0.18
4/20/2009	0.18	0.20	0.39
4/21/2009	0.28	0.21	0.48
4/22/2009	0.20	0.22	0.42
4/23/2009	0.02	0.43	0.45
4/24/2009	0.00	0.33	0.33
4/25/2009	0.00	0.35	0.35
4/26/2009	0.09	0.32	0.40
4/27/2009	0.18	0.28	0.46
4/28/2009	0.15	0.23	0.38
4/29/2009	0.14	0.24	0.38
4/30/2009	0.38	0.00	0.38
5/1/2009	0.46	0.00	0.46
5/2/2009	0.09	0.00	0.09
5/3/2009	0.08	0.00	0.08
5/4/2009	0.08	0.00	0.08
5/5/2009	0.16	0.00	0.16
5/6/2009	0.14	0.00	0.14
5/7/2009	0.13	0.00	0.13
5/8/2009	0.12	0.00	0.12
5/9/2009	0.12	0.00	0.12
5/10/2009	0.13	0.03	0.15
5/11/2009	0.18	0.08	0.26
5/12/2009	0.31	0.11	0.41
5/13/2009	0.37	0.12	0.49
5/14/2009	0.37	0.23	0.59
5/15/2009	0.87	0.20	1.07
5/16/2009	0.35	0.17	0.52
5/17/2009	0.35	0.22	0.57
5/18/2009	0.38	0.25	0.64
5/19/2009	0.39	0.23	0.62
5/20/2009	0.35	0.23	0.58
5/21/2009	0.32	0.28	0.60
5/22/2009	0.32	0.22	0.54
5/23/2009	0.21	0.26	0.47
5/24/2009	0.00	0.29	0.29
5/25/2009	0.00	0.29	0.29
5/26/2009	0.20	0.32	0.52
5/27/2009	0.49	0.47	0.95
5/28/2009	0.42	0.47	0.88
5/29/2009	0.42	0.49	0.91
5/30/2009	0.40	0.50	0.89
5/31/2009	0.40	0.30	0.70
6/1/2009	0.32	0.35	0.68
6/2/2009	0.41	0.41	0.82
6/3/2009	0.59	0.33	0.93
6/4/2009	0.67	0.38	1.04
6/5/2009	0.64	0.43	1.07
6/6/2009	0.59	0.43	1.02
6/7/2009	0.53	0.28	0.81
6/8/2009	0.22	0.29	0.51
6/9/2009	0.32	0.31	0.63
6/10/2009	0.60	0.42	1.02
6/11/2009	0.56	0.27	0.83

Date	CS0W1 24 hr Avg tons/hr	Unit 3 24 hr Avg tons/hr	Units 1,2,&3 Total SO2 tons/hr
6/12/2009	0.60	0.00	0.60
6/13/2009	0.65	0.19	0.84
6/14/2009	0.57	0.15	0.73
6/15/2009	0.45	0.12	0.57
6/16/2009	0.50	0.23	0.73
6/17/2009	0.37	0.31	0.68
6/18/2009	0.46	0.00	0.46
6/19/2009	0.31	0.00	0.31
6/20/2009	0.42	0.00	0.42
6/21/2009	0.46	0.00	0.46
6/22/2009	0.13	0.00	0.13
6/23/2009	0.58	0.00	0.58
6/24/2009	0.71	0.00	0.71
6/25/2009	0.48	0.00	0.48
6/26/2009	0.49	0.00	0.49
6/27/2009	0.48	0.00	0.48
6/28/2009	0.47	0.20	0.67
6/29/2009	0.43	0.28	0.71
6/30/2009	0.24	0.24	0.48
7/1/2009	0.00	0.25	0.25
7/2/2009	0.00	0.35	0.35
7/3/2009	0.00	0.52	0.52
7/4/2009	0.00	0.39	0.39
7/5/2009	0.03	0.30	0.33
7/6/2009	0.09	0.28	0.37
7/7/2009	0.13	0.31	0.43
7/8/2009	0.27	0.26	0.52
7/9/2009	0.39	0.34	0.73
7/10/2009	0.44	0.52	0.96
7/11/2009	0.39	0.59	0.99
7/12/2009	0.42	0.43	0.85
7/13/2009	0.41	0.41	0.82
7/14/2009	0.72	0.44	1.17
7/15/2009	0.55	0.45	1.00
7/16/2009	0.76	0.47	1.22
7/17/2009	0.59	0.70	1.29
7/18/2009	0.45	0.37	0.82
7/19/2009	0.00	0.29	0.29
7/20/2009	0.00	0.21	0.21
7/21/2009	0.00	0.24	0.24
7/22/2009	0.00	0.38	0.38
7/23/2009	0.00	0.43	0.43
7/24/2009	0.23	0.35	0.58
7/25/2009	0.70	0.31	1.01
7/26/2009	0.46	0.17	0.63
7/27/2009	0.42	0.00	0.42
7/28/2009	0.44	0.03	0.46
7/29/2009	0.40	0.14	0.54
7/30/2009	0.58	0.15	0.73
7/31/2009	0.74	0.16	0.90
8/1/2009	0.76	0.16	0.92
8/2/2009	0.89	0.26	1.15
8/3/2009	0.80	0.45	1.25
8/4/2009	0.53	0.51	1.04

Date	CS0W1 24 hr Avg tons/hr	Unit 3 24 hr Avg tons/hr	Units 1,2,&3 Total SO2 tons/hr
8/5/2009	0.50	0.57	1.07
8/6/2009	0.54	0.38	0.92
8/7/2009	0.38	0.07	0.46
8/8/2009	0.36	0.00	0.36
8/9/2009	0.30	0.00	0.30
8/10/2009	0.34	0.32	0.66
8/11/2009	0.37	0.20	0.57
8/12/2009	0.37	0.22	0.58
8/13/2009	0.32	0.20	0.52
8/14/2009	0.27	0.19	0.46
8/15/2009	0.42	0.20	0.62
8/16/2009	0.51	0.23	0.74
8/17/2009	0.50	0.20	0.70
8/18/2009	0.37	0.08	0.45
8/19/2009	0.34	0.16	0.50
8/20/2009	0.25	0.43	0.68
8/21/2009	0.87	0.38	1.25
8/22/2009	0.86	0.32	1.19
8/23/2009	0.81	0.28	1.09
8/24/2009	0.74	0.26	1.00
8/25/2009	0.40	0.27	0.67
8/26/2009	0.43	0.39	0.82
8/27/2009	0.72	0.48	1.21
8/28/2009	0.75	0.56	1.30
8/29/2009	0.46	0.36	0.82
8/30/2009	0.51	0.35	0.86
8/31/2009	0.88	0.34	1.22
9/1/2009	0.95	0.26	1.22
9/2/2009	0.94	0.11	1.05
9/3/2009	0.86	0.18	1.04
9/4/2009	0.82	0.18	0.99
9/5/2009	0.69	0.18	0.87
9/6/2009	0.66	0.25	0.91
9/7/2009	0.92	0.39	1.31
9/8/2009	0.72	0.29	1.00
9/9/2009	0.24	0.20	0.44
9/10/2009	0.39	0.19	0.57
9/11/2009	0.56	0.18	0.74
9/12/2009	0.94	0.17	1.11
9/13/2009	0.89	0.17	1.07
9/14/2009	0.77	0.20	0.96
9/15/2009	0.79	0.21	1.00
9/16/2009	0.50	0.19	0.69
9/17/2009	0.69	0.29	0.99
9/18/2009	0.31	0.25	0.56
9/19/2009	0.45	0.30	0.75
9/20/2009	0.55	0.38	0.93
9/21/2009	0.89	0.35	1.24
9/22/2009	0.84	0.47	1.31
9/23/2009	0.83	0.51	1.33
9/24/2009	0.22	0.48	0.70
9/25/2009	0.28	0.57	0.85
9/26/2009	0.26	0.65	0.91
9/27/2009	0.55	0.77	1.32

Date	CS0W1 24 hr Avg tons/hr	Unit 3 24 hr Avg tons/hr	Units 1,2,&3 Total SO2 tons/hr
9/28/2009	0.84	0.00	0.84
9/29/2009	0.99	0.00	0.99
9/30/2009	0.90	0.00	0.90
10/1/2009	0.93	0.00	0.93
10/2/2009	0.96	0.00	0.96
10/3/2009	0.78	0.00	0.78
10/4/2009	0.72	0.00	0.72
10/5/2009	0.61	0.00	0.61
10/6/2009	0.63	0.04	0.67
10/7/2009	0.64	0.17	0.81
10/8/2009	0.60	0.20	0.81
10/9/2009	0.56	0.20	0.77
10/10/2009	0.53	0.20	0.73
10/11/2009	0.51	0.27	0.79
10/12/2009	0.59	0.34	0.93
10/13/2009	0.61	0.18	0.78
10/14/2009	0.59	0.39	0.98
10/15/2009	0.64	0.44	1.08
10/16/2009	0.55	0.38	0.93
10/17/2009	0.00	0.40	0.40
10/18/2009	0.00	0.33	0.33
10/19/2009	0.00	0.30	0.30
10/20/2009	0.36	0.27	0.63
10/21/2009	0.90	0.28	1.19
10/22/2009	0.74	0.31	1.06
10/23/2009	0.76	0.46	1.22
10/24/2009	1.00	0.28	1.28
10/25/2009	0.78	0.23	1.01
10/26/2009	0.72	0.20	0.92
10/27/2009	0.81	0.23	1.03
10/28/2009	0.56	0.20	0.76
10/29/2009	0.36	0.07	0.43
10/30/2009	0.46	0.00	0.46
10/31/2009	0.50	0.00	0.50
11/1/2009	0.52	0.00	0.52
11/2/2009	0.50	0.00	0.50
11/3/2009	0.55	0.00	0.55
11/4/2009	0.61	0.00	0.61
11/5/2009	0.60	0.00	0.60
11/6/2009	0.54	0.04	0.57
11/7/2009	0.34	0.13	0.47
11/8/2009	0.26	0.15	0.40
11/9/2009	0.25	0.19	0.45
11/10/2009	0.22	0.18	0.40
11/11/2009	0.09	0.15	0.24
11/12/2009	0.05	0.25	0.30
11/13/2009	0.15	0.24	0.40
11/14/2009	0.17	0.19	0.35
11/15/2009	0.04	0.16	0.20
11/16/2009	0.09	0.13	0.22
11/17/2009	0.08	0.14	0.22
11/18/2009	0.08	0.17	0.25
11/19/2009	0.08	0.25	0.32
11/20/2009	0.08	0.18	0.27

Date	CS0W1 24 hr Avg tons/hr	Unit 3 24 hr Avg tons/hr	Units 1,2,&3 Total SO2 tons/hr
11/21/2009	0.09	0.21	0.30
11/22/2009	0.09	0.07	0.17
11/23/2009	0.06	0.19	0.25
11/24/2009	0.03	0.18	0.21
11/25/2009	0.04	0.18	0.22
11/26/2009	0.04	0.22	0.26
11/27/2009	0.02	0.24	0.26
11/28/2009	0.02	0.23	0.26
11/29/2009	0.05	0.24	0.28
11/30/2009	0.05	0.26	0.31
12/1/2009	0.05	0.21	0.25
12/2/2009	0.04	0.27	0.31
12/3/2009	0.03	0.40	0.43
12/4/2009	0.03	0.38	0.40
12/5/2009	0.03	0.57	0.60
12/6/2009	0.03	0.43	0.46
12/7/2009	0.04	0.47	0.51
12/8/2009	0.06	0.39	0.45
12/9/2009	0.07	0.29	0.37
12/10/2009	0.07	0.38	0.44
12/11/2009	0.08	0.32	0.40
12/12/2009	0.07	0.28	0.35
12/13/2009	0.02	0.24	0.26
12/14/2009	0.05	0.25	0.31
12/15/2009	0.09	0.23	0.31
12/16/2009	0.09	0.21	0.29
12/17/2009	0.38	0.29	0.66
12/18/2009	0.28	0.37	0.65
12/19/2009	0.00	0.30	0.31
12/20/2009	0.31	0.35	0.66
12/21/2009	0.30	0.29	0.59
12/22/2009	0.21	0.24	0.44
12/23/2009	0.16	0.23	0.39
12/24/2009	0.03	0.20	0.23
12/25/2009	0.02	0.30	0.32
12/26/2009	0.05	0.01	0.06
12/27/2009	0.06	0.00	0.06
12/28/2009	0.06	0.00	0.06
12/29/2009	0.12	0.00	0.12
12/30/2009	0.20	0.00	0.20
12/31/2009	0.21	0.00	0.21
1/1/2010	0.23	0.00	0.23
1/2/2010	0.24	0.00	0.24
1/3/2010	0.22	0.00	0.22
1/4/2010	0.23	0.00	0.23
1/5/2010	0.24	0.00	0.24
1/6/2010	0.24	0.00	0.24
1/7/2010	0.25	0.00	0.25
1/8/2010	0.15	0.00	0.15
1/9/2010	0.20	0.00	0.20
1/10/2010	0.19	0.00	0.19
1/11/2010	0.27	0.00	0.27
1/12/2010	0.40	0.00	0.40
1/13/2010	0.37	0.00	0.37

Date	CS0W1 24 hr Avg tons/hr	Unit 3 24 hr Avg tons/hr	Units 1,2,&3 Total SO2 tons/hr
1/14/2010	0.29	0.00	0.29
1/15/2010	0.33	0.00	0.33
1/16/2010	0.30	0.00	0.30
1/17/2010	0.32	0.00	0.32
1/18/2010	0.31	0.00	0.31
1/19/2010	0.29	0.02	0.31
1/20/2010	0.26	0.11	0.38
1/21/2010	0.01	0.22	0.23
1/22/2010	0.00	0.28	0.28
1/23/2010	0.00	0.11	0.11
1/24/2010	0.00	0.13	0.13
1/25/2010	0.00	0.13	0.13
1/26/2010	0.00	0.14	0.14
1/27/2010	0.00	0.13	0.13
1/28/2010	0.00	0.14	0.14
1/29/2010	0.00	0.21	0.21
1/30/2010	0.00	0.13	0.13
1/31/2010	0.00	0.14	0.14
2/1/2010	0.00	0.12	0.12
2/2/2010	0.00	0.10	0.10
2/3/2010	0.00	0.13	0.13
2/4/2010	0.00	0.13	0.13
2/5/2010	0.00	0.11	0.11
2/6/2010	0.00	0.12	0.12
2/7/2010	0.00	0.13	0.13
2/8/2010	0.00	0.13	0.13
2/9/2010	0.03	0.13	0.16
2/10/2010	0.13	0.13	0.25
2/11/2010	0.47	0.15	0.61
2/12/2010	0.44	0.14	0.58
2/13/2010	0.40	0.15	0.55
2/14/2010	0.39	0.18	0.57
2/15/2010	0.43	0.21	0.64
2/16/2010	0.38	0.18	0.56
2/17/2010	0.39	0.16	0.55
2/18/2010	0.38	0.18	0.57
2/19/2010	0.38	0.16	0.55
2/20/2010	0.28	0.23	0.51
2/21/2010	0.15	0.10	0.25
2/22/2010	0.00	0.32	0.32
2/23/2010	0.00	0.38	0.38
2/24/2010	0.00	0.35	0.35
2/25/2010	0.00	0.35	0.35
2/26/2010	0.00	0.34	0.34
2/27/2010	0.00	0.21	0.21
2/28/2010	0.00	0.40	0.40
3/1/2010	0.00	0.37	0.37
3/2/2010	0.00	0.31	0.31
3/3/2010	0.00	0.31	0.31
3/4/2010	0.13	0.31	0.44
3/5/2010	0.07	0.31	0.38
3/6/2010	0.31	0.20	0.51
3/7/2010	0.35	0.20	0.55
3/8/2010	0.29	0.15	0.44

Date	CS0W1 24 hr Avg tons/hr	Unit 3 24 hr Avg tons/hr	Units 1,2,&3 Total SO2 tons/hr
3/9/2010	0.39	0.00	0.39
3/10/2010	0.36	0.00	0.36
3/11/2010	0.39	0.00	0.39
3/12/2010	0.29	0.00	0.29
3/13/2010	0.44	0.00	0.44
3/14/2010	0.41	0.07	0.48
3/15/2010	0.29	0.26	0.55
3/16/2010	0.28	0.25	0.53
3/17/2010	0.45	0.23	0.68
3/18/2010	0.34	0.19	0.53
3/19/2010	0.28	0.20	0.48
3/20/2010	0.30	0.20	0.50
3/21/2010	0.28	0.21	0.49
3/22/2010	0.33	0.21	0.54
3/23/2010	0.63	0.19	0.83
3/24/2010	0.72	0.23	0.95
3/25/2010	0.81	0.23	1.04
3/26/2010	0.73	0.25	0.97
3/27/2010	0.71	0.26	0.97
3/28/2010	0.40	0.24	0.64
3/29/2010	0.22	0.24	0.46
3/30/2010	0.65	0.18	0.83
3/31/2010	0.30	0.18	0.47
4/1/2010	0.00	0.10	0.10
4/2/2010	0.00	0.14	0.14
4/3/2010	0.07	0.17	0.24
4/4/2010	0.47	0.16	0.63
4/5/2010	0.47	0.16	0.64
4/6/2010	0.75	0.15	0.90
4/7/2010	0.94	0.13	1.07
4/8/2010	0.94	0.12	1.06
4/9/2010	0.96	0.13	1.09
4/10/2010	0.72	0.12	0.84
4/11/2010	0.80	0.13	0.93
4/12/2010	0.83	0.11	0.94
4/13/2010	0.68	0.13	0.81
4/14/2010	0.24	0.15	0.39
4/15/2010	0.24	0.16	0.40
4/16/2010	0.00	0.13	0.13
4/17/2010	0.00	0.14	0.14
4/18/2010	0.69	0.18	0.87
4/19/2010	0.46	0.24	0.70
4/20/2010	0.35	0.19	0.55
4/21/2010	0.29	0.19	0.48
4/22/2010	0.39	0.14	0.53
4/23/2010	0.31	0.14	0.45
4/24/2010	0.77	0.18	0.95
4/25/2010	0.91	0.22	1.13
4/26/2010	0.78	0.23	1.01
4/27/2010	0.58	0.30	0.88
4/28/2010	0.67	0.19	0.87
4/29/2010	0.67	0.27	0.94
4/30/2010	0.57	0.24	0.81
5/1/2010	0.66	0.23	0.89

Date	CS0W1 24 hr Avg tons/hr	Unit 3 24 hr Avg tons/hr	Units 1,2,&3 Total SO2 tons/hr
5/2/2010	0.47	0.22	0.70
5/3/2010	0.64	0.19	0.83
5/4/2010	0.80	0.14	0.94
5/5/2010	0.74	0.11	0.85
5/6/2010	0.54	0.13	0.66
5/7/2010	0.74	0.15	0.89
5/8/2010	0.64	0.20	0.85
5/9/2010	0.68	0.19	0.87
5/10/2010	0.66	0.22	0.88
5/11/2010	0.74	0.20	0.94
5/12/2010	0.29	0.17	0.46
5/13/2010	0.22	0.17	0.39
5/14/2010	0.20	0.20	0.40
5/15/2010	0.20	0.24	0.44
5/16/2010	0.31	0.21	0.52
5/17/2010	0.74	0.19	0.93
5/18/2010	0.83	0.16	0.99
5/19/2010	0.74	0.22	0.95
5/20/2010	0.86	0.26	1.11
5/21/2010	0.82	0.18	1.00
5/22/2010	0.77	0.14	0.91
5/23/2010	0.69	0.10	0.80
5/24/2010	0.49	0.14	0.63
5/25/2010	0.18	0.13	0.31
5/26/2010	0.18	0.13	0.31
5/27/2010	0.15	0.15	0.30
5/28/2010	0.13	0.16	0.29
5/29/2010	0.11	0.23	0.34
5/30/2010	0.11	0.23	0.34
5/31/2010	0.13	0.26	0.39
6/1/2010	0.54	0.17	0.72
6/2/2010	0.62	0.14	0.76
6/3/2010	0.79	0.15	0.94
6/4/2010	0.77	0.16	0.94
6/5/2010	0.84	0.20	1.05
6/6/2010	0.72	0.15	0.88
6/7/2010	0.87	0.14	1.02
6/8/2010	0.95	0.15	1.09
6/9/2010	0.41	0.37	0.79
6/10/2010	0.21	0.18	0.39
6/11/2010	0.26	0.17	0.42
6/12/2010	0.21	0.16	0.38
6/13/2010	0.20	0.23	0.43
6/14/2010	0.24	0.48	0.72
6/15/2010	0.43	0.17	0.60
6/16/2010	0.77	0.13	0.91
6/17/2010	0.77	0.13	0.89
6/18/2010	0.84	0.14	0.98
6/19/2010	0.96	0.16	1.12
6/20/2010	0.92	0.20	1.12
6/21/2010	1.00	0.19	1.18
6/22/2010	0.91	0.06	0.98
6/23/2010	0.80	0.09	0.89
6/24/2010	0.50	0.26	0.76

Date	CS0W1 24 hr Avg tons/hr	Unit 3 24 hr Avg tons/hr	Units 1,2,&3 Total SO2 tons/hr
6/25/2010	0.76	0.34	1.10
6/26/2010	0.77	0.48	1.25
6/27/2010	0.73	0.19	0.92
6/28/2010	0.72	0.11	0.83
6/29/2010	0.69	0.14	0.84
6/30/2010	0.18	0.32	0.50
7/1/2010	0.15	0.37	0.51
7/2/2010	0.57	0.24	0.81
7/3/2010	0.76	0.22	0.97
7/4/2010	0.64	0.17	0.82
7/5/2010	0.83	0.15	0.97
7/6/2010	0.82	0.21	1.04
7/7/2010	0.28	0.12	0.40
7/8/2010	0.49	0.09	0.57
7/9/2010	0.65	0.07	0.72
7/10/2010	1.04	0.09	1.12
7/11/2010	0.89	0.11	1.00
7/12/2010	0.82	0.14	0.96
7/13/2010	0.73	0.18	0.90
7/14/2010	0.74	0.28	1.02
7/15/2010	0.76	0.19	0.95
7/16/2010	0.82	0.14	0.96
7/17/2010	0.84	0.20	1.04
7/18/2010	0.82	0.12	0.93
7/19/2010	0.88	0.02	0.90
7/20/2010	0.76	0.13	0.88
7/21/2010	0.52	0.37	0.88
7/22/2010	0.42	0.32	0.75
7/23/2010	0.65	0.14	0.80
7/24/2010	0.71	0.11	0.83
7/25/2010	0.70	0.10	0.80
7/26/2010	0.70	0.10	0.80
7/27/2010	0.57	0.13	0.71
7/28/2010	0.69	0.12	0.81
7/29/2010	0.74	0.18	0.93
7/30/2010	0.89	0.08	0.97
7/31/2010	0.85	0.07	0.92
8/1/2010	0.84	0.08	0.92
8/2/2010	0.88	0.06	0.94
8/3/2010	0.79	0.00	0.79
8/4/2010	0.77	0.00	0.77
8/5/2010	0.87	0.00	0.87
8/6/2010	0.86	0.00	0.86
8/7/2010	0.87	0.15	1.01
8/8/2010	0.87	0.31	1.18
8/9/2010	0.86	0.14	1.00
8/10/2010	0.85	0.14	0.99
8/11/2010	0.85	0.21	1.06
8/12/2010	0.85	0.33	1.18
8/13/2010	0.70	0.39	1.09
8/14/2010	0.83	0.34	1.17
8/15/2010	0.97	0.32	1.29
8/16/2010	1.05	0.14	1.19
8/17/2010	0.93	0.18	1.11

Date	CS0W1 24 hr Avg tons/hr	Unit 3 24 hr Avg tons/hr	Units 1,2,&3 Total SO2 tons/hr
8/18/2010	0.84	0.21	1.05
8/19/2010	0.76	0.21	0.97
8/20/2010	0.42	0.36	0.77
8/21/2010	0.16	0.20	0.37
8/22/2010	0.75	0.20	0.95
8/23/2010	0.91	0.21	1.12
8/24/2010	0.81	0.31	1.12
8/25/2010	0.17	0.18	0.35
8/26/2010	0.56	0.19	0.74
8/27/2010	0.37	0.17	0.54
8/28/2010	0.28	0.15	0.43
8/29/2010	0.30	0.19	0.49
8/30/2010	0.31	0.21	0.52
8/31/2010	0.31	0.17	0.48
9/1/2010	0.35	0.13	0.47
9/2/2010	0.29	0.12	0.41
9/3/2010	0.26	0.16	0.42
9/4/2010	0.28	0.25	0.53
9/5/2010	0.30	0.29	0.59
9/6/2010	0.25	0.30	0.56
9/7/2010	0.24	0.34	0.58
9/8/2010	0.26	0.49	0.74
9/9/2010	0.26	0.41	0.67
9/10/2010	0.39	0.27	0.66
9/11/2010	0.49	0.29	0.79
9/12/2010	1.08	0.30	1.39
9/13/2010	0.94	0.31	1.25
9/14/2010	0.20	0.30	0.50
9/15/2010	0.21	0.27	0.48
9/16/2010	0.25	0.32	0.57
9/17/2010	0.25	0.32	0.58
9/18/2010	0.26	0.31	0.58
9/19/2010	0.26	0.48	0.74
9/20/2010	0.25	0.41	0.66
9/21/2010	0.20	0.32	0.51
9/22/2010	0.29	0.30	0.59
9/23/2010	0.27	0.31	0.57
9/24/2010	0.30	0.29	0.59
9/25/2010	0.29	0.29	0.58
9/26/2010	0.28	0.32	0.59
9/27/2010	0.23	0.33	0.56
9/28/2010	0.00	0.32	0.32
9/29/2010	0.00	0.39	0.39
9/30/2010	0.00	0.42	0.42
10/1/2010	0.00	0.41	0.41
10/2/2010	0.00	0.42	0.42
10/3/2010	0.13	0.35	0.47
10/4/2010	0.56	0.38	0.94
10/5/2010	0.25	0.33	0.58
10/6/2010	0.41	0.32	0.74
10/7/2010	0.80	0.00	0.80
10/8/2010	0.33	0.00	0.33
10/9/2010	0.76	0.00	0.76
10/10/2010	0.95	0.00	0.95

Date	CS0W1 24 hr Avg tons/hr	Unit 3 24 hr Avg tons/hr	Units 1,2,&3 Total SO2 tons/hr
10/11/2010	0.89	0.00	0.89
10/12/2010	0.45	0.00	0.45
10/13/2010	0.37	0.00	0.37
10/14/2010	0.29	0.00	0.29
10/15/2010	0.41	0.00	0.41
10/16/2010	0.45	0.00	0.45
10/17/2010	0.54	0.00	0.54
10/18/2010	0.42	0.00	0.42
10/19/2010	0.29	0.00	0.29
10/20/2010	0.38	0.00	0.38
10/21/2010	0.38	0.00	0.38
10/22/2010	0.33	0.00	0.33
10/23/2010	0.33	0.00	0.33
10/24/2010	0.33	0.00	0.33
10/25/2010	0.41	0.00	0.41
10/26/2010	0.39	0.00	0.39
10/27/2010	0.36	0.00	0.36
10/28/2010	0.40	0.00	0.40
10/29/2010	0.41	0.00	0.41
10/30/2010	0.19	0.00	0.19
10/31/2010	0.43	0.00	0.43
11/1/2010	0.95	0.00	0.95
11/2/2010	0.65	0.00	0.65
11/3/2010	0.54	0.03	0.57
11/4/2010	0.72	0.03	0.75
11/5/2010	0.69	0.00	0.69
11/6/2010	0.67	0.00	0.67
11/7/2010	0.53	0.11	0.64
11/8/2010	0.71	0.08	0.80
11/9/2010	0.46	0.11	0.57
11/10/2010	0.47	0.12	0.58
11/11/2010	0.37	0.25	0.61
11/12/2010	0.40	0.45	0.85
11/13/2010	0.46	0.23	0.69
11/14/2010	0.42	0.42	0.84
11/15/2010	0.38	0.38	0.75
11/16/2010	0.42	0.31	0.72
11/17/2010	0.44	0.03	0.47
11/18/2010	0.48	0.36	0.84
11/19/2010	0.49	0.23	0.73
11/20/2010	0.73	0.26	0.99
11/21/2010	0.58	0.28	0.85
11/22/2010	0.61	0.20	0.81
11/23/2010	0.54	0.20	0.74
11/24/2010	0.79	0.29	1.08
11/25/2010	0.69	0.38	1.07
11/26/2010	0.62	0.32	0.95
11/27/2010	0.71	0.21	0.92
11/28/2010	0.65	0.24	0.90
11/29/2010	0.80	0.00	0.80
11/30/2010	0.93	0.00	0.93
12/1/2010	0.93	0.00	0.93
12/2/2010	0.96	0.00	0.96
12/3/2010	0.84	0.02	0.86

Date	CS0W1 24 hr Avg tons/hr	Unit 3 24 hr Avg tons/hr	Units 1,2,&3 Total SO2 tons/hr
12/4/2010	0.62	0.17	0.78
12/5/2010	0.66	0.36	1.01
12/6/2010	0.58	0.41	0.99
12/7/2010	0.43	0.40	0.83
12/8/2010	0.63	0.38	1.01
12/9/2010	0.65	0.31	0.97
12/10/2010	0.78	0.24	1.02
12/11/2010	0.71	0.18	0.89
12/12/2010	0.63	0.31	0.93
12/13/2010	0.63	0.31	0.94
12/14/2010	0.76	0.32	1.08
12/15/2010	1.01	0.32	1.33
12/16/2010	0.97	0.30	1.27
12/17/2010	0.35	0.07	0.42
12/18/2010	0.23	0.29	0.53
12/19/2010	0.35	0.22	0.57
12/20/2010	0.47	0.26	0.73
12/21/2010	0.47	0.19	0.65
12/22/2010	0.36	0.25	0.61
12/23/2010	0.39	0.28	0.67
12/24/2010	0.74	0.24	0.98
12/25/2010	0.90	0.21	1.11
12/26/2010	0.62	0.28	0.90
12/27/2010	0.82	0.35	1.16
12/28/2010	0.90	0.30	1.20
12/29/2010	1.03	0.26	1.29
12/30/2010	0.82	0.21	1.03
12/31/2010	0.95	0.30	1.25
1/1/2011	0.73	0.28	1.02
1/2/2011	0.77	0.22	0.99
1/3/2011	0.82	0.31	1.13
1/4/2011	0.89	0.32	1.21
1/5/2011	0.65	0.28	0.94
1/6/2011	0.79	0.34	1.13
1/7/2011	0.83	0.30	1.13
1/8/2011	0.71	0.21	0.92
1/9/2011	0.93	0.23	1.15
1/10/2011	0.82	0.24	1.06
1/11/2011	0.81	0.16	0.97
1/12/2011	0.93	0.23	1.16
1/13/2011	0.87	0.22	1.09
1/14/2011	0.88	0.30	1.18
1/15/2011	0.94	0.30	1.24
1/16/2011	1.03	0.29	1.31
1/17/2011	0.69	0.26	0.95
1/18/2011	0.45	0.18	0.63
1/19/2011	0.49	0.23	0.72
1/20/2011	0.41	0.32	0.73
1/21/2011	0.28	0.24	0.52
1/22/2011	0.48	0.23	0.71
1/23/2011	0.56	0.00	0.56
1/24/2011	0.32	0.00	0.32
1/25/2011	0.33	0.00	0.33
1/26/2011	0.21	0.00	0.21

Date	CS0W1 24 hr Avg tons/hr	Unit 3 24 hr Avg tons/hr	Units 1,2,&3 Total SO2 tons/hr
1/27/2011	0.22	0.08	0.30
1/28/2011	0.21	0.28	0.49
1/29/2011	0.20	0.20	0.40
1/30/2011	0.18	0.25	0.43
1/31/2011	0.27	0.27	0.54
2/1/2011	0.27	0.28	0.55
2/2/2011	0.74	0.12	0.85
2/3/2011	0.66	0.34	1.00
2/4/2011	1.39	0.36	1.75
2/5/2011	0.70	0.24	0.94
2/6/2011	0.70	0.26	0.96
2/7/2011	0.48	0.28	0.76
2/8/2011	0.30	0.37	0.66
2/9/2011	0.26	0.50	0.76
2/10/2011	0.25	0.37	0.62
2/11/2011	0.30	0.33	0.63
2/12/2011	0.40	0.30	0.70
2/13/2011	0.28	0.41	0.69
2/14/2011	0.40	0.43	0.83
2/15/2011	0.49	0.47	0.96
2/16/2011	0.47	0.38	0.85
2/17/2011	0.48	0.42	0.89
2/18/2011	0.29	0.43	0.72
2/19/2011	0.00	0.35	0.35
2/20/2011	0.00	0.30	0.30
2/21/2011	0.00	0.28	0.28
2/22/2011	0.00	0.37	0.37
2/23/2011	0.00	0.40	0.40
2/24/2011	0.00	0.42	0.42
2/25/2011	0.00	0.46	0.46
2/26/2011	0.00	0.26	0.26
2/27/2011	0.00	0.40	0.40
2/28/2011	0.00	0.48	0.48
3/1/2011	0.00	0.47	0.47
3/2/2011	0.00	0.40	0.40
3/3/2011	0.00	0.57	0.57
3/4/2011	0.09	0.50	0.59
3/5/2011	0.35	0.42	0.76
3/6/2011	0.40	0.07	0.47
3/7/2011	0.37	0.00	0.37
3/8/2011	0.26	0.00	0.26
3/9/2011	0.14	0.00	0.14
3/10/2011	0.00	0.00	0.00
3/11/2011	0.00	0.00	0.00
3/12/2011	0.00	0.00	0.00
3/13/2011	0.00	0.00	0.00
3/14/2011	0.00	0.00	0.00
3/15/2011	0.05	0.00	0.05
3/16/2011	0.19	0.00	0.19
3/17/2011	0.58	0.00	0.58
3/18/2011	0.80	0.00	0.80
3/19/2011	0.53	0.22	0.75
3/20/2011	0.77	0.17	0.94
3/21/2011	0.89	0.21	1.10

Date	CS0W1 24 hr Avg tons/hr	Unit 3 24 hr Avg tons/hr	Units 1,2,&3 Total SO2 tons/hr
3/22/2011	0.34	0.28	0.62
3/23/2011	0.43	0.34	0.77
3/24/2011	0.73	0.31	1.04
3/25/2011	0.89	0.33	1.22
3/26/2011	0.77	0.32	1.10
3/27/2011	0.71	0.01	0.72
3/28/2011	0.63	0.00	0.63
3/29/2011	0.39	0.00	0.39
3/30/2011	0.44	0.01	0.44
3/31/2011	0.77	0.28	1.05
4/1/2011	0.73	0.20	0.93
4/2/2011	0.62	0.18	0.81
4/3/2011	0.57	0.22	0.79
4/4/2011	0.70	0.23	0.93
4/5/2011	0.52	0.30	0.82
4/6/2011	0.64	0.37	1.01
4/7/2011	0.79	0.25	1.04
4/8/2011	0.45	0.00	0.45
4/9/2011	0.83	0.00	0.83
4/10/2011	0.98	0.00	0.98
4/11/2011	0.55	0.21	0.75
4/12/2011	0.53	0.28	0.81
4/13/2011	0.69	0.24	0.93
4/14/2011	0.40	0.23	0.63
4/15/2011	0.36	0.28	0.64
4/16/2011	0.92	0.37	1.30
4/17/2011	0.93	0.35	1.28
4/18/2011	0.61	0.39	1.00
4/19/2011	0.71	0.43	1.14
4/20/2011	0.73	0.39	1.12
4/21/2011	0.71	0.28	1.00
4/22/2011	0.60	0.22	0.83
4/23/2011	0.54	0.21	0.75
4/24/2011	0.82	0.28	1.10
4/25/2011	0.78	0.31	1.09
4/26/2011	0.85	0.31	1.16
4/27/2011	0.96	0.34	1.30
4/28/2011	0.84	0.40	1.25
4/29/2011	0.82	0.37	1.19
4/30/2011	0.73	0.42	1.16
5/1/2011	0.80	0.35	1.14
5/2/2011	0.79	0.30	1.09
5/3/2011	0.85	0.34	1.20
5/4/2011	0.90	0.33	1.23
5/5/2011	0.76	0.32	1.08
5/6/2011	0.74	0.22	0.96
5/7/2011	0.63	0.30	0.92
5/8/2011	0.68	0.31	0.98
5/9/2011	0.77	0.18	0.95
5/10/2011	0.79	0.22	1.01
5/11/2011	0.62	0.23	0.86
5/12/2011	0.47	0.28	0.75
5/13/2011	0.17	0.27	0.44
5/14/2011	0.15	0.23	0.39

Date	CS0W1 24 hr Avg tons/hr	Unit 3 24 hr Avg tons/hr	Units 1,2,&3 Total SO2 tons/hr
5/15/2011	0.15	0.26	0.40
5/16/2011	0.06	0.28	0.34
5/17/2011	0.00	0.29	0.29
5/18/2011	0.00	0.30	0.30
5/19/2011	0.02	0.27	0.28
5/20/2011	0.52	0.28	0.79
5/21/2011	0.33	0.25	0.59
5/22/2011	0.27	0.26	0.53
5/23/2011	0.44	0.37	0.81
5/24/2011	0.44	0.39	0.83
5/25/2011	0.71	0.32	1.02
5/26/2011	0.84	0.43	1.27
5/27/2011	0.90	0.41	1.31
5/28/2011	0.58	0.17	0.75
5/29/2011	0.81	0.40	1.21
5/30/2011	0.95	0.03	0.98
5/31/2011	1.02	0.00	1.02
6/1/2011	0.76	0.00	0.76
6/2/2011	0.67	0.00	0.67
6/3/2011	0.73	0.00	0.73
6/4/2011	0.87	0.36	1.23
6/5/2011	0.88	0.27	1.15
6/6/2011	0.82	0.24	1.05
6/7/2011	0.40	0.19	0.59
6/8/2011	0.39	0.00	0.39
6/9/2011	0.43	0.00	0.43
6/10/2011	0.71	0.00	0.71
6/11/2011	0.74	0.00	0.74
6/12/2011	0.75	0.00	0.75
6/13/2011	0.83	0.00	0.83
6/14/2011	0.85	0.18	1.04
6/15/2011	0.83	0.27	1.10
6/16/2011	0.56	0.50	1.05
6/17/2011	0.66	0.23	0.89
6/18/2011	0.67	0.13	0.79
6/19/2011	0.55	0.04	0.59
6/20/2011	0.46	0.16	0.62
6/21/2011	0.57	0.17	0.73
6/22/2011	0.60	0.25	0.86
6/23/2011	0.67	0.34	1.02
6/24/2011	0.58	0.34	0.93
6/25/2011	0.71	0.25	0.95
6/26/2011	0.66	0.25	0.92
6/27/2011	0.62	0.23	0.85
6/28/2011	0.75	0.21	0.96
6/29/2011	0.70	0.22	0.93
6/30/2011	0.38	0.27	0.64
7/1/2011	0.24	0.18	0.42
7/2/2011	0.25	0.16	0.41
7/3/2011	0.22	0.17	0.40
7/4/2011	0.22	0.21	0.44
7/5/2011	0.24	0.29	0.53
7/6/2011	0.21	0.15	0.36
7/7/2011	0.31	0.00	0.31

Date	CS0W1 24 hr Avg tons/hr	Unit 3 24 hr Avg tons/hr	Units 1,2,&3 Total SO2 tons/hr
7/8/2011	0.51	0.00	0.51
7/9/2011	0.70	0.00	0.70
7/10/2011	0.41	0.00	0.41
7/11/2011	0.59	0.24	0.82
7/12/2011	0.63	0.50	1.12
7/13/2011	0.56	0.24	0.80
7/14/2011	0.58	0.18	0.76
7/15/2011	0.60	0.15	0.76
7/16/2011	0.26	0.23	0.49
7/17/2011	0.19	0.00	0.19
7/18/2011	0.19	0.00	0.19
7/19/2011	0.33	0.00	0.33
7/20/2011	0.61	0.00	0.61
7/21/2011	0.48	0.00	0.48
7/22/2011	0.72	0.00	0.72
7/23/2011	0.75	0.13	0.89
7/24/2011	0.62	0.25	0.87
7/25/2011	0.42	0.20	0.62
7/26/2011	0.38	0.22	0.60
7/27/2011	0.33	0.29	0.62
7/28/2011	0.33	0.35	0.67
7/29/2011	0.40	0.24	0.63
7/30/2011	0.55	0.43	0.98
7/31/2011	0.55	0.21	0.76
8/1/2011	0.28	0.39	0.66
8/2/2011	0.45	0.36	0.81
8/3/2011	0.29	0.38	0.67
8/4/2011	0.18	0.50	0.68
8/5/2011	0.21	0.43	0.64
8/6/2011	0.34	0.47	0.81
8/7/2011	1.00	0.27	1.27
8/8/2011	0.81	0.21	1.02
8/9/2011	0.79	0.34	1.13
8/10/2011	0.72	0.36	1.09
8/11/2011	0.37	0.33	0.70
8/12/2011	0.25	0.44	0.69
8/13/2011	0.22	0.46	0.68
8/14/2011	0.09	0.26	0.35
8/15/2011	0.17	0.48	0.64
8/16/2011	0.22	0.46	0.68
8/17/2011	0.70	0.38	1.08
8/18/2011	0.41	0.36	0.77
8/19/2011	0.47	0.25	0.72
8/20/2011	0.56	0.21	0.78
8/21/2011	0.61	0.24	0.85
8/22/2011	0.59	0.29	0.88
8/23/2011	0.81	0.26	1.07
8/24/2011	0.60	0.00	0.60
8/25/2011	0.34	0.01	0.35
8/26/2011	0.61	0.48	1.09
8/27/2011	0.66	0.37	1.04
8/28/2011	0.80	0.35	1.15
8/29/2011	0.67	0.32	0.99
8/30/2011	0.50	0.41	0.91

Date	CS0W1 24 hr Avg tons/hr	Unit 3 24 hr Avg tons/hr	Units 1,2,&3 Total SO2 tons/hr
8/31/2011	0.63	0.32	0.94
9/1/2011	0.70	0.28	0.98
9/2/2011	0.80	0.00	0.80
9/3/2011	0.86	0.00	0.86
9/4/2011	0.84	0.27	1.12
9/5/2011	0.79	0.42	1.20
9/6/2011	0.73	0.35	1.08
9/7/2011	0.66	0.57	1.23
9/8/2011	0.56	0.32	0.88
9/9/2011	0.48	0.31	0.79
9/10/2011	0.47	0.20	0.67
9/11/2011	0.66	0.18	0.84
9/12/2011	0.70	0.20	0.90
9/13/2011	0.66	0.28	0.94
9/14/2011	0.70	0.31	1.01
9/15/2011	0.65	0.31	0.95
9/16/2011	0.59	0.30	0.89
9/17/2011	0.74	0.33	1.07
9/18/2011	0.72	0.18	0.89
9/19/2011	0.35	0.23	0.58
9/20/2011	0.29	0.26	0.55
9/21/2011	0.58	0.37	0.95
9/22/2011	0.39	0.41	0.80
9/23/2011	0.68	0.23	0.91
9/24/2011	0.76	0.30	1.06
9/25/2011	0.65	0.46	1.10
9/26/2011	0.57	0.44	1.01
9/27/2011	0.52	0.24	0.75
9/28/2011	0.49	0.17	0.66
9/29/2011	0.46	0.27	0.73
9/30/2011	0.37	0.58	0.95
10/1/2011	0.15	0.12	0.27
10/2/2011	0.13	0.00	0.13
10/3/2011	0.15	0.00	0.15
10/4/2011	0.17	0.44	0.61
10/5/2011	0.19	0.29	0.47
10/6/2011	0.16	0.28	0.45
10/7/2011	0.13	0.29	0.42
10/8/2011	0.00	0.21	0.22
10/9/2011	0.00	0.01	0.01
10/10/2011	0.00	0.00	0.00
10/11/2011	0.00	0.32	0.32
10/12/2011	0.00	0.13	0.13
10/13/2011	0.00	0.44	0.44
10/14/2011	0.00	0.48	0.48
10/15/2011	0.02	0.40	0.42
10/16/2011	0.23	0.21	0.44
10/17/2011	0.21	0.28	0.49
10/18/2011	0.21	0.30	0.51
10/19/2011	0.10	0.28	0.39
10/20/2011	0.12	0.27	0.40
10/21/2011	0.16	0.09	0.26
10/22/2011	0.19	0.00	0.19
10/23/2011	0.21	0.00	0.21

Date	CS0W1 24 hr Avg tons/hr	Unit 3 24 hr Avg tons/hr	Units 1,2,&3 Total SO2 tons/hr
10/24/2011	0.29	0.00	0.29
10/25/2011	0.33	0.00	0.33
10/26/2011	0.38	0.00	0.38
10/27/2011	0.40	0.00	0.40
10/28/2011	0.35	0.00	0.35
10/29/2011	0.19	0.00	0.19
10/30/2011	0.39	0.00	0.39
10/31/2011	0.47	0.00	0.47
11/1/2011	0.35	0.00	0.35
11/2/2011	0.33	0.00	0.33
11/3/2011	0.33	0.00	0.33
11/4/2011	0.39	0.00	0.39
11/5/2011	0.42	0.00	0.42
11/6/2011	0.49	0.00	0.49
11/7/2011	0.45	0.00	0.45
11/8/2011	0.00	0.05	0.05
11/9/2011	0.00	0.13	0.13
11/10/2011	0.06	0.37	0.43
11/11/2011	0.40	0.26	0.66
11/12/2011	0.34	0.11	0.46
11/13/2011	0.42	0.19	0.61
11/14/2011	0.46	0.20	0.66
11/15/2011	0.42	0.18	0.60
11/16/2011	0.54	0.17	0.71
11/17/2011	0.41	0.14	0.55
11/18/2011	0.32	0.15	0.47
11/19/2011	0.22	0.18	0.40
11/20/2011	0.18	0.20	0.38
11/21/2011	0.18	0.21	0.40
11/22/2011	0.20	0.28	0.48
11/23/2011	0.17	0.27	0.44
11/24/2011	0.17	0.20	0.36
11/25/2011	0.17	0.27	0.44
11/26/2011	0.18	0.33	0.50
11/27/2011	0.16	0.36	0.51
11/28/2011	0.16	0.23	0.39
11/29/2011	0.16	0.21	0.37
11/30/2011	0.19	0.29	0.48
12/1/2011	0.19	0.14	0.33
12/2/2011	0.20	0.00	0.20
12/3/2011	0.32	0.30	0.61
12/4/2011	0.34	0.23	0.57
12/5/2011	0.49	0.19	0.68
12/6/2011	0.47	0.16	0.62
12/7/2011	0.49	0.19	0.67
12/8/2011	0.45	0.16	0.61
12/9/2011	0.51	0.20	0.71
12/10/2011	0.54	0.21	0.75
12/11/2011	0.54	0.23	0.77
12/12/2011	0.53	0.19	0.73
12/13/2011	0.59	0.00	0.59
12/14/2011	0.60	0.00	0.60
12/15/2011	0.60	0.00	0.60
12/16/2011	0.69	0.35	1.04

Date	CS0W1 24 hr Avg tons/hr	Unit 3 24 hr Avg tons/hr	Units 1,2,&3 Total SO2 tons/hr
12/17/2011	0.62	0.44	1.06
12/18/2011	0.64	0.34	0.98
12/19/2011	0.66	0.24	0.90
12/20/2011	0.60	0.15	0.74
12/21/2011	0.58	0.00	0.58
12/22/2011	0.51	0.00	0.51
12/23/2011	0.46	0.00	0.46
12/24/2011	0.48	0.00	0.48
12/25/2011	0.48	0.00	0.48
12/26/2011	0.50	0.00	0.50
12/27/2011	0.42	0.00	0.42
12/28/2011	0.20	0.31	0.51
12/29/2011	0.19	0.20	0.39
12/30/2011	0.16	0.15	0.31
12/31/2011	0.17	0.09	0.27
1/1/2012	0.35	0.07	0.42
1/2/2012	0.48	0.15	0.63
1/3/2012	0.61	0.20	0.81
1/4/2012	0.47	0.14	0.60
1/5/2012	0.15	0.14	0.28
1/6/2012	0.20	0.12	0.32
1/7/2012	0.21	0.00	0.21
1/8/2012	0.21	0.00	0.21
1/9/2012	0.20	0.00	0.20
1/10/2012	0.15	0.00	0.15
1/11/2012	0.19	0.00	0.19
1/12/2012	0.29	0.10	0.39
1/13/2012	0.24	0.22	0.45
1/14/2012	0.64	0.19	0.82
1/15/2012	0.46	0.21	0.67
1/16/2012	0.63	0.22	0.85
1/17/2012	0.73	0.23	0.96
1/18/2012	0.72	0.19	0.91
1/19/2012	0.48	0.31	0.79
1/20/2012	0.54	0.26	0.81
1/21/2012	0.89	0.23	1.12
1/22/2012	1.04	0.20	1.24
1/23/2012	0.81	0.25	1.07
1/24/2012	0.66	0.18	0.84
1/25/2012	0.61	0.13	0.74
1/26/2012	0.49	0.18	0.66
1/27/2012	0.66	0.18	0.84
1/28/2012	0.47	0.16	0.62
1/29/2012	0.57	0.18	0.75
1/30/2012	0.59	0.18	0.77
1/31/2012	0.58	0.15	0.73
2/1/2012	0.33	0.11	0.44
2/2/2012	0.72	0.17	0.89
2/3/2012	0.72	0.17	0.89
2/4/2012	0.70	0.17	0.87
2/5/2012	0.62	0.19	0.81
2/6/2012	0.60	0.21	0.80
2/7/2012	0.75	0.39	1.14
2/8/2012	0.59	0.23	0.83

Date	CS0W1 24 hr Avg tons/hr	Unit 3 24 hr Avg tons/hr	Units 1,2,&3 Total SO2 tons/hr
2/9/2012	0.58	0.22	0.80
2/10/2012	0.62	0.24	0.86
2/11/2012	0.71	0.25	0.96
2/12/2012	0.72	0.28	1.00
2/13/2012	0.59	0.23	0.82
2/14/2012	0.55	0.21	0.76
2/15/2012	0.64	0.19	0.83
2/16/2012	0.51	0.09	0.60
2/17/2012	0.65	0.07	0.72
2/18/2012	0.65	0.07	0.71
2/19/2012	0.58	0.07	0.65
2/20/2012	0.48	0.05	0.52
2/21/2012	0.56	0.07	0.63
2/22/2012	0.56	0.13	0.69
2/23/2012	0.48	0.20	0.69
2/24/2012	0.50	0.14	0.64
2/25/2012	0.69	0.09	0.78
2/26/2012	0.61	0.04	0.64
2/27/2012	0.71	0.11	0.82
2/28/2012	0.57	0.08	0.65
2/29/2012	0.52	0.12	0.64
3/1/2012	0.68	0.14	0.81
3/2/2012	0.52	0.13	0.65
3/3/2012	0.49	0.00	0.49
3/4/2012	0.65	0.00	0.65
3/5/2012	0.68	0.00	0.68
3/6/2012	0.58	0.00	0.58
3/7/2012	0.53	0.00	0.53
3/8/2012	0.49	0.00	0.49
3/9/2012	0.54	0.00	0.54
3/10/2012	0.47	0.00	0.47
3/11/2012	0.49	0.00	0.49
3/12/2012	0.57	0.00	0.57
3/13/2012	0.67	0.08	0.76
3/14/2012	0.52	0.14	0.66
3/15/2012	0.69	0.14	0.83
3/16/2012	0.70	0.13	0.83
3/17/2012	0.70	0.16	0.85
3/18/2012	0.71	0.28	0.98
3/19/2012	0.84	0.32	1.16
3/20/2012	0.68	0.37	1.05
3/21/2012	0.79	0.37	1.15
3/22/2012	0.61	0.22	0.83
3/23/2012	0.49	0.18	0.67
3/24/2012	0.34	0.16	0.50
3/25/2012	0.21	0.15	0.37
3/26/2012	0.22	0.18	0.40
3/27/2012	0.22	0.22	0.43
3/28/2012	0.43	0.20	0.63
3/29/2012	0.85	0.19	1.04
3/30/2012	0.89	0.15	1.04
3/31/2012	0.86	0.15	1.01
4/1/2012	0.86	0.00	0.86
4/2/2012	0.18	0.00	0.18

Date	CS0W1 24 hr Avg tons/hr	Unit 3 24 hr Avg tons/hr	Units 1,2,&3 Total SO2 tons/hr
4/3/2012	0.16	0.21	0.37
4/4/2012	0.24	0.23	0.47
4/5/2012	0.27	0.18	0.45
4/6/2012	0.28	0.22	0.49
4/7/2012	0.25	0.19	0.44
4/8/2012	0.22	0.25	0.46
4/9/2012	0.20	0.23	0.44
4/10/2012	0.20	0.22	0.42
4/11/2012	0.23	0.00	0.23
4/12/2012	0.21	0.00	0.21
4/13/2012	0.23	0.15	0.38
4/14/2012	0.19	0.05	0.24
4/15/2012	0.25	0.27	0.52
4/16/2012	0.00	0.30	0.30
4/17/2012	0.00	0.25	0.25
4/18/2012	0.00	0.28	0.28
4/19/2012	0.00	0.39	0.39
4/20/2012	0.00	0.51	0.51
4/21/2012	0.00	0.50	0.50
4/22/2012	0.00	0.00	0.00
4/23/2012	0.00	0.00	0.00
4/24/2012	0.00	0.00	0.00
4/25/2012	0.00	0.35	0.35
4/26/2012	0.00	0.53	0.53
4/27/2012	0.00	0.36	0.36
4/28/2012	0.00	0.46	0.46
4/29/2012	0.00	0.39	0.39
4/30/2012	0.01	0.15	0.16
5/1/2012	0.34	0.00	0.34
5/2/2012	0.34	0.25	0.59
5/3/2012	0.34	0.29	0.63
5/4/2012	0.25	0.30	0.55
5/5/2012	0.52	0.44	0.96
5/6/2012	0.46	0.36	0.82
5/7/2012	0.38	0.54	0.92
5/8/2012	0.28	0.33	0.61
5/9/2012	0.23	0.24	0.47
5/10/2012	0.19	0.21	0.41
5/11/2012	0.15	0.22	0.37
5/12/2012	0.19	0.21	0.40
5/13/2012	0.22	0.21	0.43
5/14/2012	0.20	0.12	0.32
5/15/2012	0.18	0.19	0.37
5/16/2012	0.17	0.23	0.40
5/17/2012	0.22	0.34	0.55
5/18/2012	0.21	0.44	0.65
5/19/2012	0.26	0.26	0.52
5/20/2012	0.15	0.27	0.42
5/21/2012	0.19	0.18	0.37
5/22/2012	0.15	0.20	0.36
5/23/2012	0.15	0.23	0.38
5/24/2012	0.19	0.01	0.20
5/25/2012	0.21	0.00	0.21
5/26/2012	0.24	0.00	0.24

Date	CS0W1 24 hr Avg tons/hr	Unit 3 24 hr Avg tons/hr	Units 1,2,&3 Total SO2 tons/hr
5/27/2012	0.28	0.13	0.41
5/28/2012	0.32	0.39	0.71
5/29/2012	0.30	0.39	0.70
5/30/2012	0.24	0.34	0.58
5/31/2012	0.41	0.18	0.59
6/1/2012	0.75	0.16	0.91
6/2/2012	0.62	0.20	0.82
6/3/2012	0.73	0.21	0.94
6/4/2012	0.83	0.19	1.02
6/5/2012	0.74	0.15	0.89
6/6/2012	0.35	0.05	0.40
6/7/2012	0.43	0.00	0.43
6/8/2012	0.19	0.00	0.19
6/9/2012	0.15	0.00	0.15
6/10/2012	0.16	0.00	0.16
6/11/2012	0.17	0.17	0.34
6/12/2012	0.17	0.00	0.17
6/13/2012	0.16	0.30	0.46
6/14/2012	0.14	0.32	0.46
6/15/2012	0.01	0.33	0.34
6/16/2012	0.20	0.23	0.43
6/17/2012	0.27	0.00	0.27
6/18/2012	0.25	0.14	0.39
6/19/2012	0.28	0.00	0.28
6/20/2012	0.27	0.00	0.27
6/21/2012	0.59	0.00	0.59
6/22/2012	0.81	0.00	0.81
6/23/2012	0.70	0.00	0.70
6/24/2012	0.90	0.00	0.90
6/25/2012	0.70	0.27	0.96
6/26/2012	0.54	0.06	0.60
6/27/2012	0.86	0.07	0.93
6/28/2012	0.93	0.09	1.02
6/29/2012	0.89	0.07	0.96
6/30/2012	0.74	0.04	0.78
7/1/2012	0.77	0.02	0.79
7/2/2012	0.90	0.00	0.90
7/3/2012	0.75	0.00	0.75
7/4/2012	0.60	0.00	0.60
7/5/2012	0.74	0.00	0.74
7/6/2012	0.67	0.00	0.67
7/7/2012	0.90	0.00	0.90
7/8/2012	0.89	0.00	0.89
7/9/2012	0.77	0.00	0.77
7/10/2012	0.83	0.00	0.83
7/11/2012	0.84	0.00	0.84
7/12/2012	0.68	0.00	0.68
7/13/2012	0.68	0.01	0.69
7/14/2012	0.89	0.12	1.01
7/15/2012	0.85	0.10	0.95
7/16/2012	0.81	0.09	0.90
7/17/2012	0.89	0.09	0.98
7/18/2012	0.60	0.10	0.70
7/19/2012	0.25	0.09	0.33

Date	CS0W1 24 hr Avg tons/hr	Unit 3 24 hr Avg tons/hr	Units 1,2,&3 Total SO2 tons/hr
7/20/2012	0.16	0.09	0.25
7/21/2012	0.13	0.08	0.21
7/22/2012	0.12	0.07	0.19
7/23/2012	0.18	0.08	0.26
7/24/2012	0.79	0.16	0.95
7/25/2012	0.77	0.12	0.89
7/26/2012	0.84	0.19	1.03
7/27/2012	0.52	0.20	0.71
7/28/2012	0.77	0.20	0.97
7/29/2012	0.74	0.18	0.92
7/30/2012	0.32	0.13	0.45
7/31/2012	0.34	0.10	0.44
8/1/2012	0.32	0.12	0.45
8/2/2012	0.29	0.16	0.45
8/3/2012	0.30	0.25	0.55
8/4/2012	0.34	0.18	0.51
8/5/2012	0.52	0.24	0.76
8/6/2012	0.73	0.29	1.02
8/7/2012	0.70	0.38	1.08
8/8/2012	1.03	0.23	1.25
8/9/2012	0.84	0.09	0.93
8/10/2012	0.69	0.10	0.78
8/11/2012	0.82	0.12	0.94
8/12/2012	0.81	0.16	0.98
8/13/2012	0.89	0.18	1.06
8/14/2012	0.68	0.08	0.76
8/15/2012	0.83	0.00	0.83
8/16/2012	1.01	0.00	1.01
8/17/2012	0.82	0.00	0.82
8/18/2012	0.69	0.14	0.83
8/19/2012	0.29	0.14	0.43
8/20/2012	0.28	0.14	0.42
8/21/2012	0.29	0.23	0.52
8/22/2012	0.29	0.29	0.57
8/23/2012	0.25	0.25	0.51
8/24/2012	0.29	0.29	0.58
8/25/2012	0.68	0.30	0.98
8/26/2012	0.91	0.25	1.16
8/27/2012	0.98	0.21	1.19
8/28/2012	1.01	0.20	1.21
8/29/2012	0.91	0.19	1.10
8/30/2012	0.93	0.21	1.14
8/31/2012	0.83	0.21	1.04
9/1/2012	0.76	0.22	0.98
9/2/2012	1.01	0.25	1.25
9/3/2012	0.83	0.26	1.09
9/4/2012	0.47	0.25	0.72
9/5/2012	0.21	0.21	0.42
9/6/2012	0.21	0.28	0.49
9/7/2012	0.19	0.25	0.44
9/8/2012	0.36	0.21	0.57
9/9/2012	0.94	0.23	1.17
9/10/2012	0.72	0.24	0.96
9/11/2012	0.51	0.27	0.77

Date	CS0W1 24 hr Avg tons/hr	Unit 3 24 hr Avg tons/hr	Units 1,2,&3 Total SO2 tons/hr
9/12/2012	0.76	0.25	1.01
9/13/2012	0.95	0.55	1.50
9/14/2012	0.43	0.27	0.69
9/15/2012	0.22	0.25	0.48
9/16/2012	0.25	0.30	0.55
9/17/2012	0.29	0.37	0.66
9/18/2012	0.97	0.26	1.24
9/19/2012	0.77	0.07	0.83
9/20/2012	0.98	0.23	1.21
9/21/2012	0.92	0.21	1.13
9/22/2012	0.49	0.31	0.80
9/23/2012	0.26	0.21	0.47
9/24/2012	0.35	0.21	0.57
9/25/2012	0.22	0.26	0.47
9/26/2012	0.21	0.33	0.54
9/27/2012	0.26	0.29	0.54
9/28/2012	0.26	0.41	0.67
9/29/2012	0.27	0.38	0.66
9/30/2012	0.33	0.39	0.73
10/1/2012	0.57	0.39	0.96
10/2/2012	0.96	0.30	1.25
10/3/2012	0.38	0.19	0.58
10/4/2012	0.53	0.35	0.89
10/5/2012	0.72	0.31	1.03
10/6/2012	0.53	0.14	0.67
10/7/2012	0.59	0.00	0.59
10/8/2012	0.93	0.00	0.93
10/9/2012	0.66	0.17	0.84
10/10/2012	1.01	0.21	1.21
10/11/2012	0.43	0.15	0.58
10/12/2012	0.44	0.13	0.57
10/13/2012	0.71	0.08	0.79
10/14/2012	0.55	0.17	0.72
10/15/2012	0.36	0.28	0.64
10/16/2012	0.43	0.17	0.60
10/17/2012	0.40	0.09	0.49
10/18/2012	0.41	0.14	0.55
10/19/2012	0.37	0.22	0.59
10/20/2012	0.49	0.23	0.72
10/21/2012	0.37	0.20	0.57
10/22/2012	0.45	0.32	0.77
10/23/2012	0.51	0.30	0.82
10/24/2012	0.48	0.29	0.77
10/25/2012	0.45	0.30	0.75
10/26/2012	0.47	0.37	0.84
10/27/2012	0.67	0.36	1.03
10/28/2012	0.53	0.30	0.84
10/29/2012	0.62	0.34	0.96
10/30/2012	0.64	0.32	0.96
10/31/2012	1.01	0.37	1.38
11/1/2012	0.58	0.38	0.96
11/2/2012	0.28	0.25	0.53
11/3/2012	0.22	0.16	0.39
11/4/2012	0.22	0.16	0.38

Date	CS0W1 24 hr Avg tons/hr	Unit 3 24 hr Avg tons/hr	Units 1,2,&3 Total SO2 tons/hr
11/5/2012	0.10	0.20	0.30
11/6/2012	0.56	0.28	0.84
11/7/2012	0.59	0.29	0.89
11/8/2012	0.59	0.33	0.92
11/9/2012	0.59	0.30	0.89
11/10/2012	0.81	0.38	1.18
11/11/2012	0.26	0.30	0.56
11/12/2012	0.48	0.19	0.67
11/13/2012	0.45	0.22	0.67
11/14/2012	0.37	0.23	0.61
11/15/2012	0.24	0.22	0.47
11/16/2012	0.25	0.25	0.50
11/17/2012	0.26	0.17	0.43
11/18/2012	0.60	0.24	0.84
11/19/2012	0.52	0.38	0.90
11/20/2012	0.57	0.37	0.94
11/21/2012	0.39	0.00	0.39
11/22/2012	0.21	0.00	0.21
11/23/2012	0.26	0.00	0.26
11/24/2012	0.30	0.27	0.56
11/25/2012	0.29	0.26	0.55
11/26/2012	0.40	0.31	0.71
11/27/2012	0.38	0.38	0.76
11/28/2012	0.36	0.32	0.69
11/29/2012	0.70	0.32	1.02
11/30/2012	0.61	0.26	0.87
12/1/2012	0.48	0.14	0.62
12/2/2012	0.44	0.21	0.65
12/3/2012	0.29	0.23	0.52
12/4/2012	0.29	0.24	0.54
12/5/2012	0.18	0.24	0.42
12/6/2012	0.17	0.23	0.40
12/7/2012	0.23	0.24	0.47
12/8/2012	0.26	0.25	0.52
12/9/2012	0.30	0.24	0.54
12/10/2012	0.36	0.28	0.64
12/11/2012	0.54	0.28	0.82
12/12/2012	0.59	0.26	0.85
12/13/2012	0.81	0.33	1.15
12/14/2012	0.87	0.38	1.25
12/15/2012	0.76	0.15	0.91
12/16/2012	1.00	0.24	1.24
12/17/2012	0.83	0.33	1.16
12/18/2012	0.69	0.42	1.12
12/19/2012	0.59	0.27	0.86
12/20/2012	0.49	0.30	0.78
12/21/2012	0.31	0.25	0.57
12/22/2012	0.28	0.31	0.59
12/23/2012	0.25	0.27	0.53
12/24/2012	0.23	0.35	0.59
12/25/2012	0.28	0.35	0.62
12/26/2012	0.23	0.40	0.62
12/27/2012	0.28	0.30	0.58
12/28/2012	0.31	0.28	0.59

Date	CS0W1 24 hr Avg tons/hr	Unit 3 24 hr Avg tons/hr	Units 1,2,&3 Total SO2 tons/hr
12/29/2012	0.30	0.28	0.59
12/30/2012	0.31	0.40	0.71
12/31/2012	0.34	0.45	0.79
1/1/2013	0.29	0.46	0.75
1/2/2013	0.30	0.45	0.75
1/3/2013	0.30	0.47	0.77
1/4/2013	0.35	0.39	0.75
1/5/2013	0.34	0.39	0.73
1/6/2013	0.02	0.41	0.43
1/7/2013	0.00	0.44	0.44
1/8/2013	0.00	0.50	0.50
1/9/2013	0.00	0.40	0.40
1/10/2013	0.00	0.45	0.45
1/11/2013	0.21	0.46	0.67
1/12/2013	0.34	0.38	0.72
1/13/2013	0.34	0.42	0.76
1/14/2013	0.41	0.32	0.73
1/15/2013	0.34	0.48	0.82
1/16/2013	0.37	0.35	0.73
1/17/2013	0.37	0.26	0.63
1/18/2013	0.35	0.37	0.71
1/19/2013	0.31	0.47	0.77
1/20/2013	0.38	0.47	0.84
1/21/2013	0.39	0.47	0.86
1/22/2013	0.35	0.50	0.85
1/23/2013	0.00	0.44	0.44
1/24/2013	0.00	0.38	0.38
1/25/2013	0.00	0.33	0.33
1/26/2013	0.00	0.22	0.22
1/27/2013	0.00	0.35	0.35
1/28/2013	0.00	0.42	0.42
1/29/2013	0.00	0.42	0.42
1/30/2013	0.00	0.45	0.45
1/31/2013	0.00	0.52	0.52
2/1/2013	0.00	0.29	0.29
2/2/2013	0.00	0.32	0.32
2/3/2013	0.00	0.32	0.32
2/4/2013	0.00	0.20	0.20
2/5/2013	0.00	0.25	0.25
2/6/2013	0.00	0.23	0.23
2/7/2013	0.00	0.29	0.29
2/8/2013	0.00	0.26	0.26
2/9/2013	0.02	0.25	0.28
2/10/2013	0.20	0.24	0.44
2/11/2013	0.18	0.24	0.42
2/12/2013	0.44	0.20	0.65
2/13/2013	0.86	0.50	1.36
2/14/2013	0.91	0.25	1.15
2/15/2013	0.60	0.32	0.92
2/16/2013	0.53	0.19	0.71
2/17/2013	0.32	0.21	0.54
2/18/2013	0.40	0.26	0.66
2/19/2013	0.14	0.25	0.40
2/20/2013	0.22	0.39	0.61

Date	CS0W1 24 hr Avg tons/hr	Unit 3 24 hr Avg tons/hr	Units 1,2,&3 Total SO2 tons/hr
2/21/2013	0.40	0.28	0.67
2/22/2013	0.42	0.16	0.59
2/23/2013	0.58	0.29	0.87
2/24/2013	0.65	0.35	1.00
2/25/2013	0.59	0.36	0.95
2/26/2013	0.57	0.33	0.89
2/27/2013	0.47	0.21	0.68
2/28/2013	0.62	0.17	0.79
3/1/2013	0.66	0.17	0.83
3/2/2013	0.66	0.00	0.66
3/3/2013	0.55	0.00	0.55
3/4/2013	0.67	0.00	0.67
3/5/2013	0.84	0.00	0.84
3/6/2013	0.74	0.00	0.74
3/7/2013	0.89	0.00	0.89
3/8/2013	0.94	0.00	0.94
3/9/2013	0.80	0.00	0.80
3/10/2013	0.74	0.00	0.74
3/11/2013	0.88	0.00	0.88
3/12/2013	0.85	0.00	0.85
3/13/2013	0.79	0.00	0.79
3/14/2013	0.18	0.00	0.18
3/15/2013	0.18	0.00	0.18
3/16/2013	0.18	0.00	0.18
3/17/2013	0.64	0.00	0.64
3/18/2013	0.93	0.00	0.93
3/19/2013	0.99	0.00	0.99
3/20/2013	0.89	0.00	0.89
3/21/2013	0.87	0.00	0.87
3/22/2013	0.86	0.00	0.86
3/23/2013	0.77	0.00	0.77
3/24/2013	0.84	0.00	0.84
3/25/2013	0.98	0.00	0.98
3/26/2013	1.00	0.00	1.00
3/27/2013	1.01	0.00	1.01
3/28/2013	0.86	0.00	0.86
3/29/2013	0.90	0.00	0.90
3/30/2013	0.91	0.00	0.91
3/31/2013	0.76	0.00	0.76
4/1/2013	0.75	0.00	0.75
4/2/2013	0.93	0.00	0.93
4/3/2013	0.96	0.00	0.96
4/4/2013	0.96	0.00	0.96
4/5/2013	0.90	0.00	0.90
4/6/2013	0.94	0.00	0.94
4/7/2013	0.91	0.00	0.91
4/8/2013	0.94	0.00	0.94
4/9/2013	0.95	0.00	0.95
4/10/2013	0.96	0.00	0.96
4/11/2013	0.89	0.00	0.89
4/12/2013	0.86	0.00	0.86
4/13/2013	0.87	0.00	0.87
4/14/2013	0.97	0.00	0.97
4/15/2013	0.94	0.00	0.94

Date	CS0W1 24 hr Avg tons/hr	Unit 3 24 hr Avg tons/hr	Units 1,2,&3 Total SO2 tons/hr
4/16/2013	1.03	0.00	1.03
4/17/2013	1.03	0.00	1.03
4/18/2013	1.20	0.00	1.20
4/19/2013	1.08	0.00	1.08
4/20/2013	0.70	0.00	0.70
4/21/2013	0.71	0.00	0.71
4/22/2013	0.60	0.00	0.60
4/23/2013	0.27	0.00	0.27
4/24/2013	0.18	0.00	0.18
4/25/2013	0.19	0.00	0.19
4/26/2013	0.20	0.00	0.20
4/27/2013	0.20	0.00	0.20
4/28/2013	0.00	0.00	0.00
4/29/2013	0.16	0.00	0.16
4/30/2013	0.27	0.00	0.27
5/1/2013	0.42	0.00	0.42
5/2/2013	0.21	0.00	0.21
5/3/2013	0.82	0.00	0.82
5/4/2013	0.89	0.00	0.89
5/5/2013	0.90	0.00	0.90
5/6/2013	0.86	0.00	0.86
5/7/2013	0.87	0.00	0.87
5/8/2013	0.31	0.00	0.31
5/9/2013	0.41	0.00	0.41
5/10/2013	0.98	0.00	0.98
5/11/2013	0.93	0.00	0.93
5/12/2013	0.91	0.00	0.91
5/13/2013	0.85	0.00	0.85
5/14/2013	0.83	0.00	0.83
5/15/2013	0.82	0.00	0.82
5/16/2013	0.47	0.00	0.47
5/17/2013	0.91	0.00	0.91
5/18/2013	0.94	0.00	0.94
5/19/2013	1.02	0.00	1.02
5/20/2013	1.03	0.00	1.03
5/21/2013	0.97	0.02	1.00
5/22/2013	0.99	0.26	1.25
5/23/2013	0.95	0.39	1.33
5/24/2013	0.95	0.47	1.42
5/25/2013	0.85	0.42	1.27
5/26/2013	0.89	0.36	1.25
5/27/2013	0.80	0.27	1.08
5/28/2013	0.80	0.35	1.15
5/29/2013	0.82	0.34	1.17
5/30/2013	0.94	0.35	1.30
5/31/2013	0.81	0.39	1.19
6/1/2013	0.67	0.31	0.98
6/2/2013	0.73	0.31	1.04
6/3/2013	0.74	0.34	1.08
6/4/2013	0.81	0.43	1.24
6/5/2013	0.87	0.47	1.35
6/6/2013	0.79	0.39	1.18
6/7/2013	0.84	0.47	1.30
6/8/2013	0.78	0.35	1.13

Date	CS0W1 24 hr Avg tons/hr	Unit 3 24 hr Avg tons/hr	Units 1,2,&3 Total SO2 tons/hr
6/9/2013	0.77	0.23	1.01
6/10/2013	0.81	0.24	1.05
6/11/2013	0.76	0.49	1.25
6/12/2013	0.74	0.40	1.14
6/13/2013	0.85	0.46	1.31
6/14/2013	0.81	0.24	1.05
6/15/2013	0.71	0.00	0.71
6/16/2013	0.48	0.00	0.48
6/17/2013	0.17	0.00	0.17
6/18/2013	0.13	0.36	0.50
6/19/2013	0.13	0.52	0.65
6/20/2013	0.14	0.49	0.63
6/21/2013	0.27	0.42	0.69
6/22/2013	0.71	0.41	1.12
6/23/2013	0.81	0.49	1.30
6/24/2013	0.71	0.48	1.19
6/25/2013	0.82	0.34	1.15
6/26/2013	0.72	0.39	1.11
6/27/2013	0.77	0.35	1.11
6/28/2013	0.95	0.26	1.21
6/29/2013	0.95	0.43	1.38
6/30/2013	0.93	0.30	1.23
7/1/2013	0.76	0.42	1.18
7/2/2013	0.82	0.43	1.25
7/3/2013	0.73	0.42	1.16
7/4/2013	0.73	0.33	1.07
7/5/2013	0.73	0.33	1.06
7/6/2013	0.70	0.35	1.05
7/7/2013	0.73	0.36	1.10
7/8/2013	0.80	0.50	1.30
7/9/2013	0.86	0.51	1.37
7/10/2013	0.76	0.44	1.20
7/11/2013	0.68	0.40	1.08
7/12/2013	0.79	0.32	1.11
7/13/2013	0.79	0.06	0.85
7/14/2013	0.85	0.06	0.90
7/15/2013	0.87	0.06	0.92
7/16/2013	0.74	0.06	0.79
7/17/2013	0.71	0.06	0.77
7/18/2013	0.72	0.12	0.83
7/19/2013	0.65	0.11	0.76
7/20/2013	0.79	0.32	1.11
7/21/2013	0.72	0.27	1.00
7/22/2013	0.68	0.32	1.01
7/23/2013	0.25	0.32	0.57
7/24/2013	0.33	0.31	0.63
7/25/2013	0.56	0.33	0.88
7/26/2013	0.54	0.20	0.74
7/27/2013	0.52	0.32	0.84
7/28/2013	0.49	0.27	0.76
7/29/2013	0.59	0.26	0.85
7/30/2013	0.64	0.35	0.99
7/31/2013	0.58	0.45	1.03
8/1/2013	0.71	0.47	1.18

Date	CS0W1 24 hr Avg tons/hr	Unit 3 24 hr Avg tons/hr	Units 1,2,&3 Total SO2 tons/hr
8/2/2013	0.83	0.35	1.18
8/3/2013	0.75	0.36	1.11
8/4/2013	0.88	0.30	1.18
8/5/2013	0.75	0.26	1.00
8/6/2013	0.32	0.37	0.69
8/7/2013	0.19	0.48	0.67
8/8/2013	0.18	0.47	0.65
8/9/2013	0.18	0.65	0.84
8/10/2013	0.19	0.37	0.55
8/11/2013	0.19	0.50	0.68
8/12/2013	0.19	0.52	0.71
8/13/2013	0.21	0.52	0.74
8/14/2013	0.18	0.48	0.66
8/15/2013	0.18	0.44	0.62
8/16/2013	0.56	0.43	0.99
8/17/2013	0.86	0.40	1.26
8/18/2013	0.68	0.49	1.17
8/19/2013	0.71	0.34	1.04
8/20/2013	0.74	0.41	1.15
8/21/2013	0.86	0.39	1.26
8/22/2013	0.89	0.43	1.32
8/23/2013	0.83	0.43	1.26
8/24/2013	0.83	0.26	1.09
8/25/2013	0.97	0.15	1.13
8/26/2013	0.78	0.43	1.21
8/27/2013	0.78	0.39	1.17
8/28/2013	0.78	0.37	1.14
8/29/2013	0.75	0.38	1.14
8/30/2013	0.77	0.39	1.17
8/31/2013	0.74	0.17	0.91
9/1/2013	0.91	0.14	1.05
9/2/2013	0.91	0.13	1.05
9/3/2013	0.81	0.14	0.95
9/4/2013	0.76	0.15	0.91
9/5/2013	0.82	0.17	0.99
9/6/2013	0.72	0.21	0.93
9/7/2013	0.75	0.17	0.92
9/8/2013	0.85	0.23	1.08
9/9/2013	0.78	0.35	1.13
9/10/2013	0.72	0.32	1.05
9/11/2013	0.79	0.00	0.79
9/12/2013	0.75	0.25	1.00
9/13/2013	0.61	0.23	0.84
9/14/2013	0.61	0.31	0.92
9/15/2013	0.68	0.36	1.03
9/16/2013	0.68	0.33	1.01
9/17/2013	0.68	0.43	1.11
9/18/2013	0.48	0.41	0.90
9/19/2013	0.59	0.41	1.01
9/20/2013	0.53	0.34	0.87
9/21/2013	0.45	0.33	0.78
9/22/2013	0.48	0.42	0.89
9/23/2013	0.68	0.36	1.04
9/24/2013	0.65	0.33	0.97

Date	CS0W1 24 hr Avg tons/hr	Unit 3 24 hr Avg tons/hr	Units 1,2,&3 Total SO2 tons/hr
9/25/2013	0.69	0.30	0.99
9/26/2013	0.58	0.01	0.58
9/27/2013	0.58	0.00	0.58
9/28/2013	0.61	0.33	0.95
9/29/2013	0.62	0.36	0.98
9/30/2013	0.69	0.35	1.04
10/1/2013	0.71	0.37	1.08
10/2/2013	0.63	0.37	1.00
10/3/2013	0.64	0.39	1.04
10/4/2013	0.73	0.38	1.11
10/5/2013	0.70	0.33	1.03
10/6/2013	0.66	0.42	1.07
10/7/2013	0.62	0.49	1.12
10/8/2013	0.67	0.45	1.12
10/9/2013	0.57	0.44	1.01
10/10/2013	0.54	0.39	0.93
10/11/2013	0.62	0.33	0.95
10/12/2013	0.50	0.38	0.88
10/13/2013	0.19	0.38	0.57
10/14/2013	0.18	0.47	0.65
10/15/2013	0.17	0.50	0.67
10/16/2013	0.15	0.49	0.64
10/17/2013	0.22	0.46	0.69
10/18/2013	0.00	0.46	0.46
10/19/2013	0.00	0.51	0.51
10/20/2013	0.12	0.53	0.65
10/21/2013	0.41	0.48	0.89
10/22/2013	0.65	0.45	1.10
10/23/2013	0.87	0.24	1.12
10/24/2013	0.88	0.00	0.88
10/25/2013	0.99	0.00	0.99
10/26/2013	0.88	0.00	0.88
10/27/2013	0.85	0.00	0.85
10/28/2013	0.86	0.00	0.86
10/29/2013	0.86	0.00	0.86
10/30/2013	0.81	0.00	0.81
10/31/2013	0.86	0.00	0.86
11/1/2013	0.84	0.00	0.84
11/2/2013	0.82	0.00	0.82
11/3/2013	0.66	0.00	0.66
11/4/2013	0.84	0.00	0.84
11/5/2013	0.79	0.01	0.80
11/6/2013	0.87	0.36	1.23
11/7/2013	0.36	0.47	0.84
11/8/2013	0.19	0.36	0.55
11/9/2013	0.14	0.37	0.50
11/10/2013	0.03	0.40	0.42
11/11/2013	0.29	0.42	0.71
11/12/2013	0.37	0.39	0.76
11/13/2013	0.19	0.59	0.78
11/14/2013	0.19	0.51	0.70
11/15/2013	0.21	0.43	0.64
11/16/2013	0.22	0.41	0.64
11/17/2013	0.22	0.45	0.67

Date	CS0W1 24 hr Avg tons/hr	Unit 3 24 hr Avg tons/hr	Units 1,2,&3 Total SO2 tons/hr
11/18/2013	0.49	0.45	0.93
11/19/2013	0.93	0.37	1.30
11/20/2013	0.77	0.31	1.08
11/21/2013	0.63	0.41	1.04
11/22/2013	0.23	0.43	0.66
11/23/2013	0.16	0.47	0.63
11/24/2013	0.00	0.50	0.50
11/25/2013	0.08	0.52	0.60
11/26/2013	0.21	0.46	0.68
11/27/2013	0.25	0.46	0.72
11/28/2013	0.63	0.39	1.02
11/29/2013	0.69	0.27	0.95
11/30/2013	0.78	0.27	1.05
12/1/2013	0.76	0.35	1.11
12/2/2013	0.88	0.41	1.29
12/3/2013	0.84	0.37	1.21
12/4/2013	0.81	0.38	1.19
12/5/2013	0.75	0.48	1.23
12/6/2013	0.76	0.48	1.25
12/7/2013	0.91	0.45	1.37
12/8/2013	0.70	0.38	1.08
12/9/2013	0.57	0.47	1.05
12/10/2013	0.40	0.49	0.89
12/11/2013	0.24	0.57	0.81
12/12/2013	0.20	0.53	0.73
12/13/2013	0.00	0.45	0.45
12/14/2013	0.04	0.57	0.60
12/15/2013	0.59	0.51	1.11
12/16/2013	0.49	0.24	0.73
12/17/2013	0.29	0.20	0.49
12/18/2013	0.60	0.22	0.82
12/19/2013	0.58	0.43	1.01
12/20/2013	0.48	0.44	0.92
12/21/2013	0.24	0.55	0.78
12/22/2013	0.31	0.53	0.84
12/23/2013	0.34	0.56	0.90
12/24/2013	0.00	0.49	0.49
12/25/2013	0.00	0.45	0.45
12/26/2013	0.19	0.43	0.61
12/27/2013	0.24	0.45	0.68
12/28/2013	0.34	0.22	0.56
12/29/2013	0.56	0.08	0.64
12/30/2013	0.60	0.00	0.60
12/31/2013	0.57	0.37	0.93
Average	0.51	0.27	0.69
Unit(s) (Peak)	1.39	0.77	1.75
Unit Limit	16.50	8.50	25.00

Date	Unit 1&2 30-Day Rolling SO2 Average lb/MMBtu	Unit 3 30-Day Rolling SO2 Average lb/MMBtu
4/1/2010	0.16	0.11
4/2/2010	0.16	0.10
4/3/2010	0.16	0.10
4/4/2010	0.16	0.10
4/5/2010	0.16	0.10
4/6/2010	0.16	0.09
4/7/2010	0.16	0.09
4/8/2010	0.16	0.09
4/9/2010	0.17	0.08
4/10/2010	0.17	0.08
4/11/2010	0.17	0.08
4/12/2010	0.17	0.08
4/13/2010	0.17	0.08
4/14/2010	0.17	0.08
4/15/2010	0.16	0.08
4/16/2010	0.16	0.08
4/17/2010	0.15	0.08
4/18/2010	0.16	0.08
4/19/2010	0.16	0.08
4/20/2010	0.16	0.08
4/21/2010	0.17	0.08
4/22/2010	0.17	0.08
4/23/2010	0.17	0.08
4/24/2010	0.17	0.08
4/25/2010	0.17	0.08
4/26/2010	0.17	0.08
4/27/2010	0.17	0.08
4/28/2010	0.16	0.09
4/29/2010	0.17	0.09
4/30/2010	0.17	0.09
5/1/2010	0.17	0.09
5/2/2010	0.17	0.09
5/3/2010	0.17	0.09
5/4/2010	0.17	0.09
5/5/2010	0.17	0.09
5/6/2010	0.17	0.09
5/7/2010	0.17	0.09
5/8/2010	0.17	0.09
5/9/2010	0.17	0.09
5/10/2010	0.17	0.09
5/11/2010	0.17	0.09
5/12/2010	0.16	0.09
5/13/2010	0.16	0.09
5/14/2010	0.16	0.09
5/15/2010	0.16	0.09
5/16/2010	0.16	0.10
5/17/2010	0.17	0.10
5/18/2010	0.17	0.10
5/19/2010	0.16	0.10
5/20/2010	0.17	0.10
5/21/2010	0.17	0.10
5/22/2010	0.17	0.10
5/23/2010	0.17	0.10

Date	Unit 1&2 30-Day Rolling SO2 Average lb/MMBtu	Unit 3 30-Day Rolling SO2 Average lb/MMBtu
5/24/2010	0.17	0.09
5/25/2010	0.16	0.09
5/26/2010	0.16	0.09
5/27/2010	0.16	0.09
5/28/2010	0.16	0.08
5/29/2010	0.15	0.08
5/30/2010	0.15	0.08
5/31/2010	0.14	0.08
6/1/2010	0.14	0.08
6/2/2010	0.14	0.08
6/3/2010	0.14	0.08
6/4/2010	0.14	0.08
6/5/2010	0.15	0.08
6/6/2010	0.15	0.08
6/7/2010	0.15	0.08
6/8/2010	0.15	0.08
6/9/2010	0.15	0.08
6/10/2010	0.15	0.09
6/11/2010	0.15	0.08
6/12/2010	0.15	0.08
6/13/2010	0.15	0.09
6/14/2010	0.15	0.09
6/15/2010	0.15	0.09
6/16/2010	0.15	0.09
6/17/2010	0.15	0.09
6/18/2010	0.15	0.08
6/19/2010	0.15	0.08
6/20/2010	0.15	0.08
6/21/2010	0.15	0.08
6/22/2010	0.15	0.08
6/23/2010	0.15	0.08
6/24/2010	0.15	0.08
6/25/2010	0.15	0.09
6/26/2010	0.16	0.09
6/27/2010	0.16	0.09
6/28/2010	0.16	0.09
6/29/2010	0.17	0.09
6/30/2010	0.17	0.09
7/1/2010	0.17	0.10
7/2/2010	0.17	0.10
7/3/2010	0.16	0.10
7/4/2010	0.16	0.10
7/5/2010	0.16	0.10
7/6/2010	0.16	0.10
7/7/2010	0.16	0.10
7/8/2010	0.16	0.10
7/9/2010	0.16	0.10
7/10/2010	0.16	0.10
7/11/2010	0.16	0.10
7/12/2010	0.16	0.10
7/13/2010	0.17	0.10
7/14/2010	0.17	0.10
7/15/2010	0.17	0.10

Date	Unit 1&2 30-Day Rolling SO2 Average lb/MMBtu	Unit 3 30-Day Rolling SO2 Average lb/MMBtu
7/16/2010	0.17	0.10
7/17/2010	0.17	0.10
7/18/2010	0.18	0.09
7/19/2010	0.17	0.10
7/20/2010	0.17	0.10
7/21/2010	0.17	0.10
7/22/2010	0.17	0.09
7/23/2010	0.17	0.09
7/24/2010	0.17	0.09
7/25/2010	0.17	0.09
7/26/2010	0.17	0.09
7/27/2010	0.17	0.09
7/28/2010	0.17	0.09
7/29/2010	0.17	0.09
7/30/2010	0.17	0.09
7/31/2010	0.18	0.09
8/1/2010	0.18	0.09
8/2/2010	0.18	0.09
8/3/2010	0.18	0.09
8/4/2010	0.18	0.09
8/5/2010	0.18	0.09
8/6/2010	0.19	0.09
8/7/2010	0.19	0.09
8/8/2010	0.19	0.09
8/9/2010	0.19	0.09
8/10/2010	0.19	0.09
8/11/2010	0.19	0.09
8/12/2010	0.19	0.10
8/13/2010	0.19	0.10
8/14/2010	0.19	0.10
8/15/2010	0.19	0.10
8/16/2010	0.19	0.10
8/17/2010	0.19	0.10
8/18/2010	0.19	0.10
8/19/2010	0.19	0.10
8/20/2010	0.19	0.10
8/21/2010	0.19	0.10
8/22/2010	0.19	0.10
8/23/2010	0.19	0.10
8/24/2010	0.19	0.10
8/25/2010	0.19	0.10
8/26/2010	0.19	0.10
8/27/2010	0.19	0.10
8/28/2010	0.19	0.10
8/29/2010	0.19	0.10
8/30/2010	0.19	0.10
8/31/2010	0.18	0.10
9/1/2010	0.18	0.10
9/2/2010	0.18	0.10
9/3/2010	0.18	0.10
9/4/2010	0.17	0.10
9/5/2010	0.17	0.10
9/6/2010	0.17	0.10

Date	Unit 1&2 30-Day Rolling SO2 Average lb/MMBtu	Unit 3 30-Day Rolling SO2 Average lb/MMBtu
9/7/2010	0.17	0.10
9/8/2010	0.16	0.10
9/9/2010	0.16	0.10
9/10/2010	0.16	0.10
9/11/2010	0.16	0.10
9/12/2010	0.16	0.10
9/13/2010	0.16	0.10
9/14/2010	0.16	0.10
9/15/2010	0.15	0.10
9/16/2010	0.15	0.10
9/17/2010	0.15	0.10
9/18/2010	0.14	0.10
9/19/2010	0.14	0.10
9/20/2010	0.15	0.10
9/21/2010	0.14	0.10
9/22/2010	0.14	0.10
9/23/2010	0.14	0.10
9/24/2010	0.14	0.10
9/25/2010	0.14	0.10
9/26/2010	0.14	0.10
9/27/2010	0.13	0.10
9/28/2010	0.13	0.10
9/29/2010	0.13	0.10
9/30/2010	0.13	0.10
10/1/2010	0.13	0.15
10/2/2010	0.13	0.15
10/3/2010	0.13	0.15
10/4/2010	0.14	0.16
10/5/2010	0.14	0.16
10/6/2010	0.14	0.16
10/7/2010	0.14	0.16
10/8/2010	0.14	0.16
10/9/2010	0.14	0.16
10/10/2010	0.15	0.16
10/11/2010	0.15	0.16
10/12/2010	0.15	0.16
10/13/2010	0.15	0.16
10/14/2010	0.15	0.16
10/15/2010	0.15	0.16
10/16/2010	0.14	0.16
10/17/2010	0.14	0.16
10/18/2010	0.13	0.16
10/19/2010	0.13	0.16
10/20/2010	0.14	0.16
10/21/2010	0.14	0.16
10/22/2010	0.14	0.16
10/23/2010	0.14	0.16
10/24/2010	0.14	0.16
10/25/2010	0.14	0.16
10/26/2010	0.15	0.16
10/27/2010	0.15	0.16
10/28/2010	0.15	0.16
10/29/2010	0.15	0.16

Date	Unit 1&2 30-Day Rolling SO2 Average lb/MMBtu	Unit 3 30-Day Rolling SO2 Average lb/MMBtu
10/30/2010	0.15	0.16
10/31/2010	0.15	0.16
11/1/2010	0.16	0.16
11/2/2010	0.16	0.16
11/3/2010	0.15	0.16
11/4/2010	0.16	0.16
11/5/2010	0.16	0.16
11/6/2010	0.15	0.16
11/7/2010	0.15	0.15
11/8/2010	0.15	0.15
11/9/2010	0.15	0.14
11/10/2010	0.15	0.14
11/11/2010	0.15	0.14
11/12/2010	0.15	0.14
11/13/2010	0.16	0.14
11/14/2010	0.16	0.15
11/15/2010	0.16	0.15
11/16/2010	0.17	0.15
11/17/2010	0.17	0.15
11/18/2010	0.17	0.15
11/19/2010	0.18	0.15
11/20/2010	0.18	0.15
11/21/2010	0.18	0.14
11/22/2010	0.18	0.14
11/23/2010	0.18	0.14
11/24/2010	0.18	0.14
11/25/2010	0.18	0.14
11/26/2010	0.18	0.14
11/27/2010	0.18	0.14
11/28/2010	0.18	0.14
11/29/2010	0.19	0.14
11/30/2010	0.19	0.14
12/1/2010	0.19	0.14
12/2/2010	0.19	0.14
12/3/2010	0.19	0.14
12/4/2010	0.19	0.14
12/5/2010	0.19	0.14
12/6/2010	0.19	0.14
12/7/2010	0.19	0.14
12/8/2010	0.19	0.14
12/9/2010	0.19	0.14
12/10/2010	0.19	0.13
12/11/2010	0.19	0.13
12/12/2010	0.19	0.13
12/13/2010	0.19	0.14
12/14/2010	0.19	0.14
12/15/2010	0.19	0.14
12/16/2010	0.19	0.14
12/17/2010	0.19	0.14
12/18/2010	0.18	0.14
12/19/2010	0.18	0.13
12/20/2010	0.17	0.13
12/21/2010	0.17	0.13

Date	Unit 1&2 30-Day Rolling SO2 Average lb/MMBtu	Unit 3 30-Day Rolling SO2 Average lb/MMBtu
12/22/2010	0.17	0.13
12/23/2010	0.18	0.13
12/24/2010	0.18	0.13
12/25/2010	0.18	0.13
12/26/2010	0.18	0.13
12/27/2010	0.18	0.13
12/28/2010	0.18	0.13
12/29/2010	0.18	0.12
12/30/2010	0.18	0.12
12/31/2010	0.18	0.12
1/1/2011	0.17	0.12
1/2/2011	0.17	0.12
1/3/2011	0.18	0.13
1/4/2011	0.18	0.12
1/5/2011	0.18	0.12
1/6/2011	0.18	0.12
1/7/2011	0.18	0.12
1/8/2011	0.18	0.12
1/9/2011	0.18	0.12
1/10/2011	0.18	0.12
1/11/2011	0.19	0.12
1/12/2011	0.19	0.11
1/13/2011	0.19	0.11
1/14/2011	0.19	0.11
1/15/2011	0.19	0.11
1/16/2011	0.19	0.12
1/17/2011	0.20	0.11
1/18/2011	0.20	0.11
1/19/2011	0.20	0.11
1/20/2011	0.20	0.12
1/21/2011	0.20	0.12
1/22/2011	0.20	0.12
1/23/2011	0.20	0.12
1/24/2011	0.19	0.12
1/25/2011	0.19	0.12
1/26/2011	0.18	0.12
1/27/2011	0.18	0.12
1/28/2011	0.18	0.12
1/29/2011	0.17	0.12
1/30/2011	0.17	0.12
1/31/2011	0.17	0.12
2/1/2011	0.17	0.12
2/2/2011	0.16	0.12
2/3/2011	0.16	0.12
2/4/2011	0.17	0.12
2/5/2011	0.17	0.12
2/6/2011	0.17	0.12
2/7/2011	0.17	0.12
2/8/2011	0.16	0.12
2/9/2011	0.16	0.13
2/10/2011	0.16	0.13
2/11/2011	0.16	0.13
2/12/2011	0.16	0.13

Date	Unit 1&2 30-Day Rolling SO2 Average lb/MMBtu	Unit 3 30-Day Rolling SO2 Average lb/MMBtu
2/13/2011	0.15	0.14
2/14/2011	0.15	0.14
2/15/2011	0.15	0.14
2/16/2011	0.15	0.15
2/17/2011	0.15	0.15
2/18/2011	0.15	0.15
2/19/2011	0.15	0.15
2/20/2011	0.15	0.16
2/21/2011	0.15	0.16
2/22/2011	0.15	0.16
2/23/2011	0.15	0.16
2/24/2011	0.15	0.16
2/25/2011	0.15	0.17
2/26/2011	0.15	0.17
2/27/2011	0.15	0.17
2/28/2011	0.15	0.17
3/1/2011	0.15	0.18
3/2/2011	0.15	0.18
3/3/2011	0.15	0.18
3/4/2011	0.15	0.19
3/5/2011	0.15	0.19
3/6/2011	0.16	0.19
3/7/2011	0.16	0.19
3/8/2011	0.16	0.19
3/9/2011	0.16	0.19
3/10/2011	0.16	0.19
3/11/2011	0.16	0.19
3/12/2011	0.16	0.19
3/13/2011	0.16	0.19
3/14/2011	0.16	0.19
3/15/2011	0.16	0.19
3/16/2011	0.16	0.19
3/17/2011	0.16	0.19
3/18/2011	0.17	0.18
3/19/2011	0.17	0.18
3/20/2011	0.17	0.18
3/21/2011	0.18	0.18
3/22/2011	0.18	0.18
3/23/2011	0.18	0.18
3/24/2011	0.18	0.18
3/25/2011	0.18	0.18
3/26/2011	0.17	0.18
3/27/2011	0.17	0.18
3/28/2011	0.17	0.18
3/29/2011	0.17	0.18
3/30/2011	0.17	0.18
3/31/2011	0.17	0.18
4/1/2011	0.17	0.18
4/2/2011	0.18	0.17
4/3/2011	0.18	0.17
4/4/2011	0.18	0.17
4/5/2011	0.17	0.17
4/6/2011	0.17	0.16

Date	Unit 1&2 30-Day Rolling SO2 Average lb/MMBtu	Unit 3 30-Day Rolling SO2 Average lb/MMBtu
4/7/2011	0.17	0.16
4/8/2011	0.17	0.16
4/9/2011	0.17	0.16
4/10/2011	0.17	0.16
4/11/2011	0.17	0.16
4/12/2011	0.17	0.16
4/13/2011	0.17	0.16
4/14/2011	0.17	0.16
4/15/2011	0.17	0.16
4/16/2011	0.17	0.16
4/17/2011	0.17	0.16
4/18/2011	0.17	0.15
4/19/2011	0.17	0.15
4/20/2011	0.17	0.16
4/21/2011	0.17	0.15
4/22/2011	0.17	0.15
4/23/2011	0.17	0.15
4/24/2011	0.17	0.14
4/25/2011	0.17	0.14
4/26/2011	0.17	0.14
4/27/2011	0.18	0.14
4/28/2011	0.18	0.15
4/29/2011	0.18	0.15
4/30/2011	0.18	0.15
5/1/2011	0.18	0.15
5/2/2011	0.18	0.15
5/3/2011	0.19	0.15
5/4/2011	0.19	0.15
5/5/2011	0.19	0.15
5/6/2011	0.19	0.15
5/7/2011	0.19	0.15
5/8/2011	0.19	0.16
5/9/2011	0.19	0.15
5/10/2011	0.19	0.15
5/11/2011	0.19	0.15
5/12/2011	0.19	0.15
5/13/2011	0.19	0.15
5/14/2011	0.19	0.15
5/15/2011	0.19	0.15
5/16/2011	0.19	0.15
5/17/2011	0.19	0.15
5/18/2011	0.19	0.15
5/19/2011	0.19	0.14
5/20/2011	0.18	0.14
5/21/2011	0.18	0.14
5/22/2011	0.18	0.14
5/23/2011	0.17	0.15
5/24/2011	0.17	0.15
5/25/2011	0.17	0.15
5/26/2011	0.17	0.15
5/27/2011	0.18	0.15
5/28/2011	0.17	0.15
5/29/2011	0.17	0.15

Date	Unit 1&2 30-Day Rolling SO2 Average lb/MMBtu	Unit 3 30-Day Rolling SO2 Average lb/MMBtu
5/30/2011	0.17	0.15
5/31/2011	0.17	0.15
6/1/2011	0.17	0.15
6/2/2011	0.17	0.15
6/3/2011	0.17	0.15
6/4/2011	0.17	0.15
6/5/2011	0.17	0.14
6/6/2011	0.17	0.14
6/7/2011	0.17	0.14
6/8/2011	0.16	0.14
6/9/2011	0.16	0.14
6/10/2011	0.16	0.14
6/11/2011	0.16	0.14
6/12/2011	0.16	0.14
6/13/2011	0.16	0.14
6/14/2011	0.16	0.14
6/15/2011	0.17	0.14
6/16/2011	0.17	0.14
6/17/2011	0.17	0.14
6/18/2011	0.17	0.14
6/19/2011	0.17	0.13
6/20/2011	0.17	0.13
6/21/2011	0.18	0.13
6/22/2011	0.18	0.13
6/23/2011	0.18	0.13
6/24/2011	0.18	0.13
6/25/2011	0.18	0.14
6/26/2011	0.18	0.14
6/27/2011	0.18	0.13
6/28/2011	0.18	0.13
6/29/2011	0.18	0.13
6/30/2011	0.17	0.13
7/1/2011	0.17	0.13
7/2/2011	0.16	0.13
7/3/2011	0.16	0.12
7/4/2011	0.16	0.12
7/5/2011	0.15	0.12
7/6/2011	0.15	0.12
7/7/2011	0.15	0.12
7/8/2011	0.15	0.12
7/9/2011	0.16	0.12
7/10/2011	0.15	0.12
7/11/2011	0.15	0.12
7/12/2011	0.15	0.12
7/13/2011	0.15	0.12
7/14/2011	0.15	0.11
7/15/2011	0.15	0.11
7/16/2011	0.15	0.11
7/17/2011	0.15	0.11
7/18/2011	0.14	0.11
7/19/2011	0.14	0.11
7/20/2011	0.14	0.11
7/21/2011	0.14	0.11

Date	Unit 1&2 30-Day Rolling SO2 Average lb/MMBtu	Unit 3 30-Day Rolling SO2 Average lb/MMBtu
7/22/2011	0.14	0.11
7/23/2011	0.14	0.11
7/24/2011	0.14	0.11
7/25/2011	0.14	0.11
7/26/2011	0.14	0.11
7/27/2011	0.14	0.11
7/28/2011	0.13	0.11
7/29/2011	0.13	0.12
7/30/2011	0.13	0.12
7/31/2011	0.13	0.12
8/1/2011	0.13	0.12
8/2/2011	0.13	0.12
8/3/2011	0.14	0.12
8/4/2011	0.13	0.13
8/5/2011	0.13	0.13
8/6/2011	0.14	0.13
8/7/2011	0.14	0.13
8/8/2011	0.14	0.13
8/9/2011	0.14	0.13
8/10/2011	0.14	0.14
8/11/2011	0.14	0.14
8/12/2011	0.14	0.14
8/13/2011	0.14	0.15
8/14/2011	0.14	0.15
8/15/2011	0.14	0.15
8/16/2011	0.14	0.15
8/17/2011	0.14	0.15
8/18/2011	0.14	0.15
8/19/2011	0.14	0.15
8/20/2011	0.14	0.15
8/21/2011	0.14	0.15
8/22/2011	0.14	0.15
8/23/2011	0.14	0.15
8/24/2011	0.14	0.15
8/25/2011	0.14	0.15
8/26/2011	0.14	0.16
8/27/2011	0.15	0.16
8/28/2011	0.15	0.16
8/29/2011	0.15	0.16
8/30/2011	0.15	0.16
8/31/2011	0.15	0.16
9/1/2011	0.16	0.16
9/2/2011	0.15	0.16
9/3/2011	0.16	0.16
9/4/2011	0.16	0.16
9/5/2011	0.16	0.16
9/6/2011	0.17	0.16
9/7/2011	0.16	0.16
9/8/2011	0.16	0.16
9/9/2011	0.16	0.16
9/10/2011	0.16	0.16
9/11/2011	0.16	0.16
9/12/2011	0.16	0.15

Date	Unit 1&2 30-Day Rolling SO2 Average lb/MMBtu	Unit 3 30-Day Rolling SO2 Average lb/MMBtu
9/13/2011	0.16	0.15
9/14/2011	0.17	0.15
9/15/2011	0.17	0.15
9/16/2011	0.17	0.15
9/17/2011	0.17	0.15
9/18/2011	0.17	0.15
9/19/2011	0.17	0.14
9/20/2011	0.17	0.14
9/21/2011	0.17	0.14
9/22/2011	0.16	0.14
9/23/2011	0.16	0.14
9/24/2011	0.17	0.14
9/25/2011	0.17	0.14
9/26/2011	0.17	0.15
9/27/2011	0.17	0.14
9/28/2011	0.16	0.14
9/29/2011	0.16	0.14
9/30/2011	0.16	0.14
10/1/2011	0.16	0.14
10/2/2011	0.16	0.14
10/3/2011	0.15	0.14
10/4/2011	0.15	0.14
10/5/2011	0.14	0.14
10/6/2011	0.14	0.14
10/7/2011	0.14	0.14
10/8/2011	0.14	0.14
10/9/2011	0.14	0.14
10/10/2011	0.14	0.14
10/11/2011	0.14	0.14
10/12/2011	0.14	0.13
10/13/2011	0.14	0.13
10/14/2011	0.14	0.13
10/15/2011	0.14	0.14
10/16/2011	0.14	0.14
10/17/2011	0.14	0.14
10/18/2011	0.13	0.14
10/19/2011	0.13	0.14
10/20/2011	0.13	0.14
10/21/2011	0.13	0.14
10/22/2011	0.12	0.14
10/23/2011	0.12	0.14
10/24/2011	0.12	0.14
10/25/2011	0.13	0.14
10/26/2011	0.13	0.14
10/27/2011	0.13	0.14
10/28/2011	0.14	0.14
10/29/2011	0.14	0.14
10/30/2011	0.14	0.14
10/31/2011	0.14	0.14
11/1/2011	0.14	0.14
11/2/2011	0.14	0.14
11/3/2011	0.14	0.14
11/4/2011	0.14	0.14

Date	Unit 1&2 30-Day Rolling SO2 Average lb/MMBtu	Unit 3 30-Day Rolling SO2 Average lb/MMBtu
11/5/2011	0.15	0.14
11/6/2011	0.15	0.14
11/7/2011	0.16	0.13
11/8/2011	0.16	0.13
11/9/2011	0.16	0.13
11/10/2011	0.16	0.13
11/11/2011	0.16	0.13
11/12/2011	0.16	0.13
11/13/2011	0.17	0.13
11/14/2011	0.17	0.13
11/15/2011	0.18	0.13
11/16/2011	0.18	0.12
11/17/2011	0.19	0.12
11/18/2011	0.19	0.12
11/19/2011	0.19	0.11
11/20/2011	0.19	0.12
11/21/2011	0.19	0.11
11/22/2011	0.19	0.11
11/23/2011	0.19	0.11
11/24/2011	0.19	0.11
11/25/2011	0.19	0.11
11/26/2011	0.19	0.11
11/27/2011	0.18	0.11
11/28/2011	0.18	0.11
11/29/2011	0.17	0.11
11/30/2011	0.17	0.11
12/1/2011	0.17	0.11
12/2/2011	0.16	0.11
12/3/2011	0.16	0.10
12/4/2011	0.16	0.10
12/5/2011	0.16	0.10
12/6/2011	0.16	0.10
12/7/2011	0.15	0.10
12/8/2011	0.15	0.10
12/9/2011	0.15	0.10
12/10/2011	0.14	0.10
12/11/2011	0.14	0.10
12/12/2011	0.14	0.10
12/13/2011	0.14	0.10
12/14/2011	0.14	0.10
12/15/2011	0.14	0.10
12/16/2011	0.13	0.10
12/17/2011	0.13	0.11
12/18/2011	0.13	0.11
12/19/2011	0.14	0.11
12/20/2011	0.14	0.11
12/21/2011	0.14	0.11
12/22/2011	0.14	0.11
12/23/2011	0.15	0.11
12/24/2011	0.15	0.11
12/25/2011	0.15	0.11
12/26/2011	0.15	0.11
12/27/2011	0.15	0.11

Date	Unit 1&2 30-Day Rolling SO2 Average lb/MMBtu	Unit 3 30-Day Rolling SO2 Average lb/MMBtu
12/28/2011	0.15	0.11
12/29/2011	0.15	0.11
12/30/2011	0.15	0.11
12/31/2011	0.15	0.11
1/1/2012	0.16	0.11
1/2/2012	0.16	0.11
1/3/2012	0.16	0.11
1/4/2012	0.16	0.11
1/5/2012	0.15	0.11
1/6/2012	0.15	0.10
1/7/2012	0.15	0.10
1/8/2012	0.15	0.10
1/9/2012	0.15	0.10
1/10/2012	0.14	0.10
1/11/2012	0.14	0.10
1/12/2012	0.14	0.10
1/13/2012	0.14	0.10
1/14/2012	0.14	0.10
1/15/2012	0.14	0.10
1/16/2012	0.13	0.10
1/17/2012	0.13	0.10
1/18/2012	0.13	0.10
1/19/2012	0.13	0.10
1/20/2012	0.13	0.11
1/21/2012	0.13	0.11
1/22/2012	0.14	0.11
1/23/2012	0.14	0.11
1/24/2012	0.14	0.11
1/25/2012	0.14	0.11
1/26/2012	0.14	0.11
1/27/2012	0.14	0.10
1/28/2012	0.14	0.10
1/29/2012	0.14	0.09
1/30/2012	0.14	0.09
1/31/2012	0.14	0.09
2/1/2012	0.14	0.09
2/2/2012	0.14	0.09
2/3/2012	0.14	0.09
2/4/2012	0.15	0.09
2/5/2012	0.15	0.09
2/6/2012	0.15	0.09
2/7/2012	0.16	0.09
2/8/2012	0.16	0.10
2/9/2012	0.16	0.10
2/10/2012	0.16	0.10
2/11/2012	0.17	0.10
2/12/2012	0.17	0.10
2/13/2012	0.17	0.10
2/14/2012	0.17	0.10
2/15/2012	0.17	0.10
2/16/2012	0.17	0.10
2/17/2012	0.17	0.09
2/18/2012	0.17	0.09

Date	Unit 1&2 30-Day Rolling SO2 Average lb/MMBtu	Unit 3 30-Day Rolling SO2 Average lb/MMBtu
2/19/2012	0.17	0.09
2/20/2012	0.16	0.08
2/21/2012	0.16	0.08
2/22/2012	0.16	0.08
2/23/2012	0.16	0.08
2/24/2012	0.16	0.08
2/25/2012	0.16	0.08
2/26/2012	0.16	0.08
2/27/2012	0.16	0.08
2/28/2012	0.16	0.08
2/29/2012	0.16	0.08
3/1/2012	0.16	0.08
3/2/2012	0.16	0.08
3/3/2012	0.16	0.08
3/4/2012	0.16	0.08
3/5/2012	0.16	0.08
3/6/2012	0.16	0.08
3/7/2012	0.16	0.08
3/8/2012	0.16	0.08
3/9/2012	0.16	0.08
3/10/2012	0.16	0.08
3/11/2012	0.16	0.08
3/12/2012	0.15	0.08
3/13/2012	0.16	0.08
3/14/2012	0.16	0.08
3/15/2012	0.16	0.08
3/16/2012	0.16	0.08
3/17/2012	0.16	0.07
3/18/2012	0.16	0.07
3/19/2012	0.16	0.08
3/20/2012	0.16	0.08
3/21/2012	0.17	0.08
3/22/2012	0.17	0.08
3/23/2012	0.17	0.08
3/24/2012	0.17	0.08
3/25/2012	0.17	0.08
3/26/2012	0.17	0.08
3/27/2012	0.17	0.08
3/28/2012	0.16	0.08
3/29/2012	0.17	0.09
3/30/2012	0.17	0.09
3/31/2012	0.17	0.09
4/1/2012	0.17	0.09
4/2/2012	0.17	0.09
4/3/2012	0.16	0.09
4/4/2012	0.16	0.09
4/5/2012	0.16	0.09
4/6/2012	0.16	0.09
4/7/2012	0.16	0.09
4/8/2012	0.16	0.10
4/9/2012	0.16	0.10
4/10/2012	0.16	0.10
4/11/2012	0.15	0.10

Date	Unit 1&2 30-Day Rolling SO2 Average lb/MMBtu	Unit 3 30-Day Rolling SO2 Average lb/MMBtu
4/12/2012	0.15	0.10
4/13/2012	0.15	0.10
4/14/2012	0.15	0.10
4/15/2012	0.14	0.10
4/16/2012	0.14	0.10
4/17/2012	0.14	0.10
4/18/2012	0.14	0.10
4/19/2012	0.14	0.11
4/20/2012	0.14	0.11
4/21/2012	0.14	0.12
4/22/2012	0.14	0.12
4/23/2012	0.14	0.12
4/24/2012	0.14	0.12
4/25/2012	0.14	0.12
4/26/2012	0.14	0.12
4/27/2012	0.14	0.12
4/28/2012	0.14	0.13
4/29/2012	0.14	0.13
4/30/2012	0.14	0.13
5/1/2012	0.15	0.13
5/2/2012	0.14	0.13
5/3/2012	0.14	0.13
5/4/2012	0.14	0.13
5/5/2012	0.14	0.13
5/6/2012	0.15	0.13
5/7/2012	0.15	0.14
5/8/2012	0.15	0.14
5/9/2012	0.14	0.14
5/10/2012	0.14	0.14
5/11/2012	0.14	0.14
5/12/2012	0.14	0.14
5/13/2012	0.14	0.14
5/14/2012	0.14	0.14
5/15/2012	0.13	0.14
5/16/2012	0.13	0.14
5/17/2012	0.13	0.14
5/18/2012	0.13	0.15
5/19/2012	0.13	0.15
5/20/2012	0.13	0.15
5/21/2012	0.13	0.15
5/22/2012	0.13	0.14
5/23/2012	0.13	0.14
5/24/2012	0.13	0.14
5/25/2012	0.13	0.14
5/26/2012	0.13	0.14
5/27/2012	0.13	0.14
5/28/2012	0.13	0.14
5/29/2012	0.13	0.14
5/30/2012	0.13	0.14
5/31/2012	0.13	0.13
6/1/2012	0.13	0.13
6/2/2012	0.13	0.13
6/3/2012	0.13	0.12

Date	Unit 1&2 30-Day Rolling SO2 Average lb/MMBtu	Unit 3 30-Day Rolling SO2 Average lb/MMBtu
6/4/2012	0.13	0.12
6/5/2012	0.13	0.12
6/6/2012	0.13	0.12
6/7/2012	0.13	0.12
6/8/2012	0.13	0.12
6/9/2012	0.13	0.12
6/10/2012	0.13	0.12
6/11/2012	0.13	0.12
6/12/2012	0.13	0.12
6/13/2012	0.13	0.12
6/14/2012	0.13	0.12
6/15/2012	0.13	0.11
6/16/2012	0.13	0.11
6/17/2012	0.13	0.11
6/18/2012	0.13	0.11
6/19/2012	0.13	0.11
6/20/2012	0.13	0.11
6/21/2012	0.14	0.11
6/22/2012	0.14	0.11
6/23/2012	0.14	0.11
6/24/2012	0.15	0.11
6/25/2012	0.15	0.11
6/26/2012	0.15	0.11
6/27/2012	0.16	0.11
6/28/2012	0.16	0.10
6/29/2012	0.16	0.10
6/30/2012	0.16	0.10
7/1/2012	0.16	0.10
7/2/2012	0.17	0.10
7/3/2012	0.17	0.10
7/4/2012	0.16	0.10
7/5/2012	0.16	0.10
7/6/2012	0.16	0.10
7/7/2012	0.16	0.10
7/8/2012	0.17	0.10
7/9/2012	0.17	0.10
7/10/2012	0.17	0.10
7/11/2012	0.18	0.10
7/12/2012	0.18	0.10
7/13/2012	0.18	0.10
7/14/2012	0.19	0.10
7/15/2012	0.19	0.10
7/16/2012	0.19	0.10
7/17/2012	0.20	0.09
7/18/2012	0.20	0.09
7/19/2012	0.20	0.09
7/20/2012	0.19	0.09
7/21/2012	0.19	0.08
7/22/2012	0.18	0.08
7/23/2012	0.18	0.08
7/24/2012	0.18	0.08
7/25/2012	0.18	0.07
7/26/2012	0.18	0.07

Date	Unit 1&2 30-Day Rolling SO2 Average lb/MMBtu	Unit 3 30-Day Rolling SO2 Average lb/MMBtu
7/27/2012	0.18	0.07
7/28/2012	0.17	0.07
7/29/2012	0.17	0.07
7/30/2012	0.17	0.07
7/31/2012	0.17	0.07
8/1/2012	0.17	0.07
8/2/2012	0.17	0.07
8/3/2012	0.17	0.07
8/4/2012	0.16	0.07
8/5/2012	0.16	0.07
8/6/2012	0.16	0.07
8/7/2012	0.16	0.07
8/8/2012	0.16	0.08
8/9/2012	0.16	0.08
8/10/2012	0.16	0.08
8/11/2012	0.16	0.08
8/12/2012	0.16	0.08
8/13/2012	0.16	0.08
8/14/2012	0.16	0.08
8/15/2012	0.16	0.08
8/16/2012	0.16	0.08
8/17/2012	0.17	0.08
8/18/2012	0.17	0.08
8/19/2012	0.17	0.08
8/20/2012	0.17	0.08
8/21/2012	0.17	0.09
8/22/2012	0.18	0.09
8/23/2012	0.17	0.09
8/24/2012	0.17	0.10
8/25/2012	0.17	0.10
8/26/2012	0.18	0.10
8/27/2012	0.18	0.10
8/28/2012	0.18	0.11
8/29/2012	0.18	0.11
8/30/2012	0.18	0.11
8/31/2012	0.19	0.11
9/1/2012	0.19	0.11
9/2/2012	0.19	0.11
9/3/2012	0.19	0.11
9/4/2012	0.19	0.11
9/5/2012	0.19	0.11
9/6/2012	0.19	0.12
9/7/2012	0.18	0.12
9/8/2012	0.18	0.12
9/9/2012	0.18	0.12
9/10/2012	0.18	0.11
9/11/2012	0.18	0.11
9/12/2012	0.18	0.12
9/13/2012	0.18	0.12
9/14/2012	0.18	0.13
9/15/2012	0.17	0.13
9/16/2012	0.17	0.13
9/17/2012	0.17	0.13

Date	Unit 1&2 30-Day Rolling SO2 Average lb/MMBtu	Unit 3 30-Day Rolling SO2 Average lb/MMBtu
9/18/2012	0.17	0.13
9/19/2012	0.17	0.13
9/20/2012	0.18	0.13
9/21/2012	0.18	0.13
9/22/2012	0.18	0.13
9/23/2012	0.18	0.13
9/24/2012	0.18	0.13
9/25/2012	0.17	0.13
9/26/2012	0.17	0.13
9/27/2012	0.16	0.14
9/28/2012	0.16	0.14
9/29/2012	0.16	0.14
9/30/2012	0.16	0.14
10/1/2012	0.16	0.15
10/2/2012	0.16	0.15
10/3/2012	0.15	0.15
10/4/2012	0.15	0.15
10/5/2012	0.16	0.15
10/6/2012	0.16	0.15
10/7/2012	0.16	0.15
10/8/2012	0.16	0.15
10/9/2012	0.16	0.15
10/10/2012	0.16	0.15
10/11/2012	0.16	0.15
10/12/2012	0.16	0.15
10/13/2012	0.15	0.14
10/14/2012	0.15	0.14
10/15/2012	0.15	0.14
10/16/2012	0.15	0.14
10/17/2012	0.15	0.13
10/18/2012	0.15	0.13
10/19/2012	0.14	0.13
10/20/2012	0.14	0.13
10/21/2012	0.14	0.13
10/22/2012	0.14	0.13
10/23/2012	0.14	0.13
10/24/2012	0.14	0.13
10/25/2012	0.14	0.14
10/26/2012	0.14	0.14
10/27/2012	0.14	0.14
10/28/2012	0.14	0.14
10/29/2012	0.14	0.14
10/30/2012	0.14	0.14
10/31/2012	0.15	0.14
11/1/2012	0.14	0.14
11/2/2012	0.15	0.14
11/3/2012	0.14	0.14
11/4/2012	0.14	0.13
11/5/2012	0.14	0.13
11/6/2012	0.14	0.13
11/7/2012	0.15	0.13
11/8/2012	0.14	0.13
11/9/2012	0.14	0.13

Date	Unit 1&2 30-Day Rolling SO2 Average lb/MMBtu	Unit 3 30-Day Rolling SO2 Average lb/MMBtu
11/10/2012	0.14	0.14
11/11/2012	0.14	0.14
11/12/2012	0.14	0.14
11/13/2012	0.14	0.14
11/14/2012	0.14	0.14
11/15/2012	0.14	0.14
11/16/2012	0.14	0.15
11/17/2012	0.14	0.15
11/18/2012	0.15	0.15
11/19/2012	0.15	0.15
11/20/2012	0.15	0.15
11/21/2012	0.15	0.15
11/22/2012	0.15	0.15
11/23/2012	0.15	0.15
11/24/2012	0.15	0.15
11/25/2012	0.15	0.15
11/26/2012	0.15	0.15
11/27/2012	0.15	0.15
11/28/2012	0.15	0.15
11/29/2012	0.15	0.15
11/30/2012	0.15	0.15
12/1/2012	0.15	0.15
12/2/2012	0.14	0.15
12/3/2012	0.14	0.14
12/4/2012	0.14	0.14
12/5/2012	0.14	0.14
12/6/2012	0.13	0.14
12/7/2012	0.13	0.14
12/8/2012	0.13	0.14
12/9/2012	0.13	0.14
12/10/2012	0.13	0.14
12/11/2012	0.13	0.14
12/12/2012	0.13	0.14
12/13/2012	0.13	0.14
12/14/2012	0.14	0.14
12/15/2012	0.14	0.14
12/16/2012	0.14	0.14
12/17/2012	0.15	0.15
12/18/2012	0.14	0.15
12/19/2012	0.15	0.15
12/20/2012	0.15	0.15
12/21/2012	0.15	0.15
12/22/2012	0.15	0.15
12/23/2012	0.15	0.15
12/24/2012	0.15	0.15
12/25/2012	0.15	0.15
12/26/2012	0.15	0.15
12/27/2012	0.15	0.15
12/28/2012	0.14	0.15
12/29/2012	0.14	0.15
12/30/2012	0.14	0.15
12/31/2012	0.14	0.15
1/1/2013	0.14	0.16

Date	Unit 1&2 30-Day Rolling SO2 Average lb/MMBtu	Unit 3 30-Day Rolling SO2 Average lb/MMBtu
1/2/2013	0.15	0.16
1/3/2013	0.15	0.16
1/4/2013	0.15	0.17
1/5/2013	0.15	0.17
1/6/2013	0.15	0.17
1/7/2013	0.15	0.18
1/8/2013	0.15	0.18
1/9/2013	0.15	0.18
1/10/2013	0.15	0.18
1/11/2013	0.15	0.19
1/12/2013	0.16	0.19
1/13/2013	0.16	0.19
1/14/2013	0.16	0.19
1/15/2013	0.16	0.19
1/16/2013	0.16	0.19
1/17/2013	0.16	0.19
1/18/2013	0.16	0.19
1/19/2013	0.16	0.20
1/20/2013	0.15	0.20
1/21/2013	0.15	0.20
1/22/2013	0.15	0.21
1/23/2013	0.15	0.21
1/24/2013	0.15	0.21
1/25/2013	0.15	0.21
1/26/2013	0.15	0.21
1/27/2013	0.15	0.21
1/28/2013	0.15	0.21
1/29/2013	0.15	0.21
1/30/2013	0.15	0.21
1/31/2013	0.15	0.21
2/1/2013	0.15	0.21
2/2/2013	0.15	0.21
2/3/2013	0.15	0.21
2/4/2013	0.15	0.20
2/5/2013	0.15	0.20
2/6/2013	0.15	0.20
2/7/2013	0.15	0.19
2/8/2013	0.15	0.19
2/9/2013	0.15	0.19
2/10/2013	0.15	0.18
2/11/2013	0.15	0.18
2/12/2013	0.15	0.18
2/13/2013	0.16	0.18
2/14/2013	0.17	0.18
2/15/2013	0.18	0.18
2/16/2013	0.19	0.18
2/17/2013	0.19	0.17
2/18/2013	0.19	0.17
2/19/2013	0.19	0.17
2/20/2013	0.19	0.17
2/21/2013	0.19	0.16
2/22/2013	0.20	0.16
2/23/2013	0.20	0.16

Date	Unit 1&2 30-Day Rolling SO2 Average lb/MMBtu	Unit 3 30-Day Rolling SO2 Average lb/MMBtu
2/24/2013	0.20	0.16
2/25/2013	0.21	0.16
2/26/2013	0.21	0.16
2/27/2013	0.21	0.16
2/28/2013	0.21	0.15
3/1/2013	0.22	0.15
3/2/2013	0.22	0.15
3/3/2013	0.22	0.15
3/4/2013	0.22	0.15
3/5/2013	0.22	0.15
3/6/2013	0.22	0.15
3/7/2013	0.23	0.15
3/8/2013	0.23	0.15
3/9/2013	0.23	0.15
3/10/2013	0.23	0.15
3/11/2013	0.23	0.15
3/12/2013	0.23	0.15
3/13/2013	0.24	0.15
3/14/2013	0.23	0.15
3/15/2013	0.23	0.15
3/16/2013	0.22	0.15
3/17/2013	0.21	0.15
3/18/2013	0.20	0.15
3/19/2013	0.20	0.15
3/20/2013	0.20	0.15
3/21/2013	0.21	0.15
3/22/2013	0.20	0.15
3/23/2013	0.20	0.15
3/24/2013	0.21	0.15
3/25/2013	0.23	0.15
3/26/2013	0.23	0.15
3/27/2013	0.23	0.15
3/28/2013	0.20	0.15
3/29/2013	0.21	0.15
3/30/2013	0.22	0.15
3/31/2013	0.19	0.15
4/1/2013	0.20	0.15
4/2/2013	0.20	0.15
4/3/2013	0.20	0.15
4/4/2013	0.20	0.15
4/5/2013	0.20	0.15
4/6/2013	0.20	0.15
4/7/2013	0.20	0.15
4/8/2013	0.20	0.15
4/9/2013	0.20	0.15
4/10/2013	0.20	0.15
4/11/2013	0.20	0.15
4/12/2013	0.20	0.15
4/13/2013	0.20	0.15
4/14/2013	0.21	0.15
4/15/2013	0.22	0.15
4/16/2013	0.22	0.15
4/17/2013	0.22	0.15

Date	Unit 1&2 30-Day Rolling SO2 Average lb/MMBtu	Unit 3 30-Day Rolling SO2 Average lb/MMBtu
4/18/2013	0.22	0.15
4/19/2013	0.22	0.15
4/20/2013	0.22	0.15
4/21/2013	0.22	0.15
4/22/2013	0.22	0.15
4/23/2013	0.22	0.15
4/24/2013	0.22	0.15
4/25/2013	0.21	0.15
4/26/2013	0.21	0.15
4/27/2013	0.20	0.15
4/28/2013	0.20	0.15
4/29/2013	0.20	0.15
4/30/2013	0.20	0.15
5/1/2013	0.19	0.15
5/2/2013	0.19	0.15
5/3/2013	0.19	0.15
5/4/2013	0.19	0.15
5/5/2013	0.19	0.15
5/6/2013	0.19	0.15
5/7/2013	0.19	0.15
5/8/2013	0.19	0.15
5/9/2013	0.18	0.15
5/10/2013	0.18	0.15
5/11/2013	0.18	0.15
5/12/2013	0.18	0.15
5/13/2013	0.18	0.15
5/14/2013	0.18	0.15
5/15/2013	0.18	0.14
5/16/2013	0.18	0.13
5/17/2013	0.18	0.13
5/18/2013	0.18	0.12
5/19/2013	0.17	0.12
5/20/2013	0.17	0.12
5/21/2013	0.17	0.12
5/22/2013	0.17	0.12
5/23/2013	0.17	0.12
5/24/2013	0.18	0.13
5/25/2013	0.18	0.13
5/26/2013	0.19	0.13
5/27/2013	0.19	0.13
5/28/2013	0.19	0.13
5/29/2013	0.20	0.13
5/30/2013	0.20	0.13
5/31/2013	0.20	0.13
6/1/2013	0.20	0.13
6/2/2013	0.20	0.13
6/3/2013	0.20	0.13
6/4/2013	0.20	0.13
6/5/2013	0.20	0.14
6/6/2013	0.20	0.16
6/7/2013	0.20	0.16
6/8/2013	0.21	0.17
6/9/2013	0.20	0.17

Date	Unit 1&2 30-Day Rolling SO2 Average lb/MMBtu	Unit 3 30-Day Rolling SO2 Average lb/MMBtu
6/10/2013	0.20	0.16
6/11/2013	0.20	0.17
6/12/2013	0.20	0.17
6/13/2013	0.20	0.17
6/14/2013	0.20	0.17
6/15/2013	0.20	0.17
6/16/2013	0.20	0.17
6/17/2013	0.20	0.17
6/18/2013	0.20	0.17
6/19/2013	0.19	0.17
6/20/2013	0.18	0.17
6/21/2013	0.18	0.17
6/22/2013	0.18	0.18
6/23/2013	0.17	0.18
6/24/2013	0.17	0.18
6/25/2013	0.17	0.18
6/26/2013	0.17	0.18
6/27/2013	0.17	0.18
6/28/2013	0.17	0.18
6/29/2013	0.17	0.18
6/30/2013	0.17	0.18
7/1/2013	0.18	0.18
7/2/2013	0.18	0.18
7/3/2013	0.18	0.18
7/4/2013	0.18	0.18
7/5/2013	0.18	0.18
7/6/2013	0.18	0.18
7/7/2013	0.18	0.18
7/8/2013	0.18	0.18
7/9/2013	0.18	0.19
7/10/2013	0.18	0.19
7/11/2013	0.18	0.18
7/12/2013	0.18	0.18
7/13/2013	0.18	0.18
7/14/2013	0.18	0.17
7/15/2013	0.18	0.17
7/16/2013	0.18	0.16
7/17/2013	0.18	0.16
7/18/2013	0.19	0.16
7/19/2013	0.18	0.15
7/20/2013	0.21	0.15
7/21/2013	0.20	0.15
7/22/2013	0.18	0.15
7/23/2013	0.10	0.14
7/24/2013	0.11	0.14
7/25/2013	0.15	0.14
7/26/2013	0.14	0.14
7/27/2013	0.14	0.14
7/28/2013	0.14	0.14
7/29/2013	0.15	0.13
7/30/2013	0.17	0.13
7/31/2013	0.16	0.13
8/1/2013	0.19	0.14

Date	Unit 1&2 30-Day Rolling SO2 Average lb/MMBtu	Unit 3 30-Day Rolling SO2 Average lb/MMBtu
8/2/2013	0.22	0.13
8/3/2013	0.21	0.13
8/4/2013	0.22	0.13
8/5/2013	0.20	0.13
8/6/2013	0.16	0.13
8/7/2013	0.10	0.13
8/8/2013	0.10	0.13
8/9/2013	0.10	0.13
8/10/2013	0.17	0.13
8/11/2013	0.17	0.14
8/12/2013	0.16	0.14
8/13/2013	0.16	0.15
8/14/2013	0.16	0.15
8/15/2013	0.15	0.16
8/16/2013	0.15	0.16
8/17/2013	0.15	0.17
8/18/2013	0.15	0.17
8/19/2013	0.15	0.17
8/20/2013	0.15	0.17
8/21/2013	0.15	0.17
8/22/2013	0.16	0.18
8/23/2013	0.16	0.18
8/24/2013	0.16	0.18
8/25/2013	0.17	0.18
8/26/2013	0.17	0.18
8/27/2013	0.17	0.18
8/28/2013	0.17	0.18
8/29/2013	0.17	0.19
8/30/2013	0.18	0.19
8/31/2013	0.18	0.19
9/1/2013	0.18	0.18
9/2/2013	0.18	0.18
9/3/2013	0.18	0.17
9/4/2013	0.18	0.17
9/5/2013	0.18	0.17
9/6/2013	0.18	0.17
9/7/2013	0.18	0.17
9/8/2013	0.19	0.17
9/9/2013	0.19	0.17
9/10/2013	0.19	0.17
9/11/2013	0.20	0.17
9/12/2013	0.20	0.16
9/13/2013	0.20	0.16
9/14/2013	0.20	0.16
9/15/2013	0.21	0.15
9/16/2013	0.20	0.15
9/17/2013	0.20	0.15
9/18/2013	0.20	0.15
9/19/2013	0.20	0.15
9/20/2013	0.20	0.15
9/21/2013	0.20	0.15
9/22/2013	0.19	0.15
9/23/2013	0.19	0.15

Date	Unit 1&2 30-Day Rolling SO2 Average lb/MMBtu	Unit 3 30-Day Rolling SO2 Average lb/MMBtu
9/24/2013	0.19	0.14
9/25/2013	0.19	0.14
9/26/2013	0.19	0.14
9/27/2013	0.19	0.14
9/28/2013	0.19	0.14
9/29/2013	0.19	0.14
9/30/2013	0.19	0.14
10/1/2013	0.18	0.14
10/2/2013	0.18	0.14
10/3/2013	0.18	0.14
10/4/2013	0.18	0.14
10/5/2013	0.18	0.14
10/6/2013	0.18	0.15
10/7/2013	0.18	0.15
10/8/2013	0.18	0.15
10/9/2013	0.18	0.16
10/10/2013	0.18	0.16
10/11/2013	0.18	0.16
10/12/2013	0.17	0.16
10/13/2013	0.17	0.16
10/14/2013	0.17	0.16
10/15/2013	0.17	0.16
10/16/2013	0.17	0.17
10/17/2013	0.17	0.17
10/18/2013	0.17	0.17
10/19/2013	0.17	0.17
10/20/2013	0.17	0.17
10/21/2013	0.17	0.17
10/22/2013	0.17	0.17
10/23/2013	0.18	0.17
10/24/2013	0.18	0.17
10/25/2013	0.18	0.17
10/26/2013	0.18	0.17
10/27/2013	0.19	0.17
10/28/2013	0.19	0.17
10/29/2013	0.19	0.17
10/30/2013	0.19	0.17
10/31/2013	0.19	0.17
11/1/2013	0.19	0.17
11/2/2013	0.20	0.17
11/3/2013	0.20	0.17
11/4/2013	0.20	0.17
11/5/2013	0.20	0.17
11/6/2013	0.20	0.17
11/7/2013	0.20	0.17
11/8/2013	0.20	0.18
11/9/2013	0.20	0.18
11/10/2013	0.19	0.18
11/11/2013	0.19	0.18
11/12/2013	0.19	0.18
11/13/2013	0.19	0.18
11/14/2013	0.19	0.18
11/15/2013	0.19	0.19

Date	Unit 1&2 30-Day Rolling SO2 Average lb/MMBtu	Unit 3 30-Day Rolling SO2 Average lb/MMBtu
11/16/2013	0.18	0.19
11/17/2013	0.18	0.19
11/18/2013	0.18	0.19
11/19/2013	0.19	0.19
11/20/2013	0.19	0.19
11/21/2013	0.19	0.19
11/22/2013	0.19	0.19
11/23/2013	0.19	0.19
11/24/2013	0.19	0.19
11/25/2013	0.19	0.19
11/26/2013	0.19	0.19
11/27/2013	0.19	0.19
11/28/2013	0.19	0.19
11/29/2013	0.19	0.19
11/30/2013	0.18	0.18
12/1/2013	0.18	0.18
12/2/2013	0.18	0.18
12/3/2013	0.19	0.18
12/4/2013	0.19	0.18
12/5/2013	0.19	0.18
12/6/2013	0.19	0.19
12/7/2013	0.19	0.19
12/8/2013	0.19	0.19
12/9/2013	0.19	0.19
12/10/2013	0.19	0.19
12/11/2013	0.19	0.19
12/12/2013	0.19	0.19
12/13/2013	0.19	0.19
12/14/2013	0.19	0.19
12/15/2013	0.19	0.19
12/16/2013	0.19	0.19
12/17/2013	0.19	0.19
12/18/2013	0.20	0.19
12/19/2013	0.20	0.19
12/20/2013	0.21	0.19
12/21/2013	0.21	0.19
12/22/2013	0.22	0.20
12/23/2013	0.22	0.20
12/24/2013	0.22	0.20
12/25/2013	0.22	0.20
12/26/2013	0.22	0.20
12/27/2013	0.22	0.19
12/28/2013	0.22	0.19
12/29/2013	0.23	0.19
12/30/2013	0.23	0.19
12/31/2013	0.22	0.20
Average	0.17	0.13
Maximum (peak)	0.24	0.21
Unit Limit	0.25	0.25

ATTACHMENT 4
Site Photographs
Abrasive Blasting Emission Calculations
MSDS

Response 4 - Existing Abrasive Blasting Building



Response 4 - Existing Abrasive Blasting Building - Passive Louver Vent (typ).



Response 4 - Former Abrasive Blasting Building (EU-033/EU-034)



Response 4 - Former Abrasive Blasting Building (EU-033/EU-034)



Emission Inventory Calculation Work Sheet

Big Bend Power Station

Facility ID No. 0570039

Emission Source Type

HAP Emissions - Boiler Chemical Cleaning Waste

Facility and Source Description

Unit No. 1 to 4 (EUs-001 to -004)

Calculation Inputs

Cleaning Fluid - EDTA

Volume of Cleaning Waste

300,000 gal/yr

Emission Calculations

Estimated Elemental Analysis	EDTA	Emissions
Antimony	1.3	3.3
Arsenic	0.4	1.0
Beryllium	0.0	0.0
Cadmium	0.8	1.9
Chromium	7.7	19.3
Chromium VI	3.0	7.5
Cobalt	1.8	4.5
Lead	23.0	57.6
Manganese	51.0	127.7
Mercury	0.0012	0.0
Nickel	160.0	400.5
Selenium	0.0	0.0

Emissions Summary

	Limit	Emissions
Lead Emissions (<500 lbs/yr)	500	58
Single HAP Emissions (<1000 lbs/yr)	1,000	401
Total Combined HAP Emissions (<2,500 lbs/yr)	2,500	623

Emission Estimation Equations

HAP Calculations

Mass emissions {lb/yr} = Concentration {mg/L} * Volume {gallons/yr} * 3.785 L/Gallons/(1,000 mg/g*453.6 g/lb)

Source of Input Data

Parameter	Source
Emissions Limit	Insignificant limits pursuant to Chapter 62-213.430(6) F.A.C.
Maximum EDTA limits in cleaning water	Electric Power Research Institute. Boiler Chemical Cleaning Waste Management Manual. TR-101095, Radian Corporation, 1992.

MATERIAL SAFETY DATA SHEET

1. Product and Company Identification

Material name THE ORIGINAL BLACK BEAUTY®
Version # 01
Issue date 11-30-2012
Revision date -
Supersedes date -
CAS # 68476-96-0
Product code Slag, coal
Product use Abrasives and Roofing Products and Other Aggregate Uses.
Manufacturer/Supplier Harsco
P.O. Box 0515, Camp Hill, PA 17001-0515
reedcs@harsco.com
Contact Person: Steve Stanislawczyk
717-506-4666
Emergency 855-393-9889
Access code 13793

2. Hazards Identification

Physical state Solid.
Appearance Black granular solid.
Emergency overview WARNING

Abrasive blasting agents may cause inflammation and pulmonary fibrosis. Dust may irritate the respiratory tract, skin and eyes.
OSHA regulatory status This product is hazardous according to OSHA 29 CFR 1910.1200.
Potential health effects
Routes of exposure Inhalation. Eye contact. Skin contact.
Eyes Dust in the eyes will cause irritation. May cause redness and pain.
Skin Dust may irritate skin.
Inhalation Abrasive blasting agents may cause inflammation and pulmonary fibrosis. Dust may irritate throat and respiratory system and cause coughing.
Ingestion Ingestion of dusts generated during working operations may cause nausea and vomiting.
Target organs Eyes. Respiratory system.
Chronic effects Frequent inhalation of fume/dust over a long period of time increases the risk of developing lung diseases.
Signs and symptoms Irritation of nose and throat. Irritation of eyes and mucous membranes.
Potential environmental effects The product is not classified as environmentally hazardous. However, this does not exclude the possibility that large or frequent spills can have a harmful or damaging effect on the environment.

3. Composition / Information on Ingredients

Components	CAS #	Percent
Coal, slag	68476-96-0	100
Constituents	CAS #	Percent
Silicon dioxide	7631-86-9	41-53
Iron oxide	1309-37-1	7-31
Aluminum oxide	1344-28-1	17-25
Calcium oxide	1305-78-8	3-15
Magnesium oxide	1309-48-4	0-4
Potassium Oxide	12136-45-7	0-3

BLACK BEAUTY®

CPH MSDS NA

Constituents	CAS #	Percent
Titanium dioxide	13463-67-7	0-2
Silicon dioxide, crystalline	14808-60-7	<0.1
Manganese	7439-96-5	0-0.05
Beryllium	7440-41-7	0-0.001
Cadmium	7440-43-9	0-0.001

Composition comments All concentrations are in percent by weight unless ingredient is a gas. Gas concentrations are in percent by volume.

4. First Aid Measures

First aid procedures

Eye contact	Do not rub eyes. Remove any contact lenses. Flush eyes thoroughly with water, taking care to rinse under eyelids. If irritation persists, continue flushing for 15 minutes, rinsing from time to time under eyelids. If discomfort continues, consult a physician.
Skin contact	Contact with dust: Wash with soap and water. Get medical attention if irritation develops or persists.
Inhalation	Move to fresh air. Get medical attention if discomfort persists.
Ingestion	Rinse mouth thoroughly if dust is ingested. Do not induce vomiting. Get medical attention if any discomfort continues.

Notes to physician Treat symptomatically.

General advice Show this safety data sheet to the doctor in attendance.

5. Fire Fighting Measures

Flammable properties The product is non-combustible.

Extinguishing media

Suitable extinguishing media	Use fire-extinguishing media appropriate for surrounding materials.
Unsuitable extinguishing media	None known.

Protection of firefighters

Specific hazards arising from the chemical	None known.
Protective equipment and precautions for firefighters	Self-contained breathing apparatus and full protective clothing must be worn in case of fire.

Fire fighting equipment/instructions Move container from fire area if it can be done without risk. Cool containers with flooding quantities of water until well after fire is out.

6. Accidental Release Measures

Personal precautions Avoid generation and spreading of dust. Avoid inhalation of dust and contact with skin and eyes. Wear suitable protective clothing. Use personal protection recommended in Section 8 of the MSDS.

Environmental precautions Prevent further leakage or spillage if safe to do so. Do not contaminate water.

Methods for containment Avoid dispersal of dust in the air (i.e., clearing dust surfaces with compressed air).

Methods for cleaning up Collect dust using a vacuum cleaner equipped with HEPA filter. If not possible, gently moisten dust with water fog before it is collected with shovel, broom or the like. Avoid dust formation. After removal flush contaminated area thoroughly with water.

Never return spills to original containers for re-use.

Other information Clean up in accordance with all applicable regulations.

7. Handling and Storage

Handling Avoid inhalation of dust and contact with skin and eyes. Use only with adequate ventilation. Use work methods which minimize dust production. Keep the workplace clean. Observe good industrial hygiene practices.

Storage Keep container tightly closed. Store away from incompatible materials.

8. Exposure Controls / Personal Protection

Occupational exposure limits

US. ACGIH Threshold Limit Values

Constituents	Type	Value	Form
Beryllium (CAS 7440-41-7)	TWA	0.00005 mg/m3	Inhalable fraction.
Cadmium (CAS 7440-43-9)	TWA	0.01 mg/m3	Respirable fraction.
		0.002 mg/m3	
Manganese (CAS 7439-96-5)	TWA	0.2 mg/m3	Respirable fraction.
Silicon dioxide, crystalline (CAS 14808-60-7)	TWA	0.025 mg/m3	
Titanium dioxide (CAS 13463-67-7)	TWA	10 mg/m3	Inhalable fraction.
Calcium oxide (CAS 1305-78-8)	TWA	2 mg/m3	
Magnesium oxide (CAS 1309-48-4)	TWA	10 mg/m3	Respirable fraction.
Aluminum oxide (CAS 1344-28-1)	TWA	1 mg/m3	Respirable fraction.
Iron oxide (CAS 1309-37-1)	TWA	5 mg/m3	Respirable fraction.

US. OSHA Specifically Regulated Substances (29 CFR 1910.1001-1050)

Constituents	Type	Value
Cadmium (CAS 7440-43-9)	TWA	0.005 mg/m3

US. OSHA Table Z-1 Limits for Air Contaminants (29 CFR 1910.1000)

Constituents	Type	Value	Form
Manganese (CAS 7439-96-5)	Ceiling	5 mg/m3	Fume.
Titanium dioxide (CAS 13463-67-7)	PEL	15 mg/m3	Total dust.
Calcium oxide (CAS 1305-78-8)	PEL	5 mg/m3	Total particulate.
Magnesium oxide (CAS 1309-48-4)	PEL	15 mg/m3	
Aluminum oxide (CAS 1344-28-1)	PEL	5 mg/m3	Respirable fraction.
Iron oxide (CAS 1309-37-1)	PEL	15 mg/m3	Total dust.
		10 mg/m3	Fume.

US. OSHA Table Z-2 (29 CFR 1910.1000)

Constituents	Type	Value	Form
Beryllium (CAS 7440-41-7)	Ceiling	0.005 mg/m3	Dust. Fume. Dust. Fume.
Cadmium (CAS 7440-43-9)	TWA	0.002 mg/m3	
	Ceiling	0.6 mg/m3	
	TWA	0.3 mg/m3	
		0.2 mg/m3	
		0.1 mg/m3	

US. OSHA Table Z-3 (29 CFR 1910.1000)

Constituents	Type	Value	Form
Silicon dioxide, crystalline (CAS 14808-60-7)	TWA	0.3 mg/m3	Total dust.
Silicon dioxide (CAS 7631-86-9)	TWA	0.1 mg/m3	Respirable.
		2.4 mppcf	Respirable.
		0.8 mg/m3	
		20 mppcf	

Canada. Alberta OELs (Occupational Health & Safety Code, Schedule 1, Table 2)

Constituents	Type	Value	Form
Beryllium (CAS 7440-41-7)	STEL	0.01 mg/m ³	Respirable particles.
	TWA	0.002 mg/m ³	
Cadmium (CAS 7440-43-9)	TWA	0.01 mg/m ³	
Manganese (CAS 7439-96-5)	TWA	0.2 mg/m ³	
Silicon dioxide, crystalline (CAS 14808-60-7)	TWA	0.025 mg/m ³	
Titanium dioxide (CAS 13463-67-7)	TWA	10 mg/m ³	
Calcium oxide (CAS 1305-78-8)	TWA	2 mg/m ³	
Magnesium oxide (CAS 1309-48-4)	TWA	10 mg/m ³	
Aluminum oxide (CAS 1344-28-1)	TWA	10 mg/m ³	
Iron oxide (CAS 1309-37-1)	TWA	5 mg/m ³	

Canada. British Columbia OELs. (Occupational Exposure Limits for Chemical Substances, Occupational Health and Safety Regulation 296/97, as amended)

Constituents	Type	Value	Form
Beryllium (CAS 7440-41-7)	STEL	0.01 mg/m ³	Respirable.
	TWA	0.002 mg/m ³	
Cadmium (CAS 7440-43-9)	TWA	0.01 mg/m ³	
		0.002 mg/m ³	
Manganese (CAS 7439-96-5)	TWA	0.2 mg/m ³	
Silicon dioxide, crystalline (CAS 14808-60-7)	TWA	0.025 mg/m ³	
Titanium dioxide (CAS 13463-67-7)	TWA	3 mg/m ³	
Calcium oxide (CAS 1305-78-8)	TWA	10 mg/m ³	
		2 mg/m ³	
Magnesium oxide (CAS 1309-48-4)	STEL	10 mg/m ³	
	TWA	3 mg/m ³	
Aluminum oxide (CAS 1344-28-1)	TWA	10 mg/m ³	Respirable dust and/or fume. Respirable dust and/or fume. Inhalable fume. Respirable.
		1 mg/m ³	
Iron oxide (CAS 1309-37-1)	STEL	10 mg/m ³	
	TWA	5 mg/m ³	
Silicon dioxide (CAS 7631-86-9)		5 mg/m ³	
		3 mg/m ³	
		10 mg/m ³	
		4 mg/m ³	
		1.5 mg/m ³	

Canada. Ontario OELs. (Control of Exposure to Biological or Chemical Agents)

Constituents	Type	Value	Form
Beryllium (CAS 7440-41-7)	STEL	0.01 mg/m ³	Respirable.
	TWA	0.002 mg/m ³	
Cadmium (CAS 7440-43-9)	TWA	0.01 mg/m ³	
Manganese (CAS 7439-96-5)	TWA	0.2 mg/m ³	
Silicon dioxide, crystalline (CAS 14808-60-7)	TWA	0.1 mg/m ³	
Titanium dioxide (CAS 13463-67-7)	TWA	10 mg/m ³	

Canada. Ontario OELs. (Control of Exposure to Biological or Chemical Agents)

Constituents	Type	Value	Form
Calcium oxide (CAS 1305-78-8)	TWA	2 mg/m3	
Magnesium oxide (CAS 1309-48-4)	TWA	10 mg/m3	Inhalable fraction.
Aluminum oxide (CAS 1344-28-1)	TWA	1 mg/m3	Respirable fraction.
Iron oxide (CAS 1309-37-1)	TWA	5 mg/m3	Respirable fraction.
Silicon dioxide (CAS 7631-86-9)	TWA	10 mg/m3	

Canada. Quebec OELs. (Ministry of Labor - Regulation Respecting the Quality of the Work Environment)

Constituents	Type	Value	Form
Beryllium (CAS 7440-41-7)	TWA	0.00015 mg/m3	
Cadmium (CAS 7440-43-9)	TWA	0.025 mg/m3	
Manganese (CAS 7439-96-5)	STEL	3 mg/m3	Fume.
	TWA	5 mg/m3	Dust.
		1 mg/m3	Fume.
Silicon dioxide, crystalline (CAS 14808-60-7)	TWA	0.1 mg/m3	Respirable dust.
Titanium dioxide (CAS 13463-67-7)	TWA	10 mg/m3	Total dust.
Calcium oxide (CAS 1305-78-8)	TWA	2 mg/m3	
Magnesium oxide (CAS 1309-48-4)	TWA	10 mg/m3	Fume.
Aluminum oxide (CAS 1344-28-1)	TWA	10 mg/m3	Total dust.
Iron oxide (CAS 1309-37-1)	TWA	5 mg/m3	Dust and fume.
		10 mg/m3	Total dust.
Silicon dioxide (CAS 7631-86-9)	TWA	6 mg/m3	Respirable dust.

Mexico. Occupational Exposure Limit Values

Constituents	Type	Value	Form
Beryllium (CAS 7440-41-7)	TWA	0.002 mg/m3	
Cadmium (CAS 7440-43-9)	TWA	0.01 mg/m3	Total dust.
		0.002 mg/m3	Respirable dust.
Manganese (CAS 7439-96-5)	STEL	3 mg/m3	Fume.
	TWA	1 mg/m3	Fume.
		0.2 mg/m3	
Silicon dioxide, crystalline (CAS 14808-60-7)	TWA	0.1 mg/m3	
Titanium dioxide (CAS 13463-67-7)	STEL	20 mg/m3	
	TWA	10 mg/m3	
Calcium oxide (CAS 1305-78-8)	TWA	2 mg/m3	
Magnesium oxide (CAS 1309-48-4)	TWA	10 mg/m3	Fume.
Aluminum oxide (CAS 1344-28-1)	TWA	10 mg/m3	
Iron oxide (CAS 1309-37-1)	STEL	10 mg/m3	
	TWA	5 mg/m3	

Engineering controls Use process enclosures, local exhaust ventilation, or other engineering controls to control airborne levels below recommended exposure limits.

Personal protective equipment

Eye / face protection Wear safety glasses with side shields. Use tight fitting goggles if dust is generated.

Skin protection Use protective gloves. Wear suitable protective clothing.

Respiratory protection

Selection and use of respiratory protective equipment should be in accordance with OSHA General Industry Standard 29 CFR 1910.134; or in Canada with CSA Standard Z94.4.

General hygiene considerations

Wash hands after handling. Routinely wash work clothing and protective equipment to remove contaminants. Handle in accordance with good industrial hygiene and safety practice.

9. Physical & Chemical Properties

Appearance	Black granular solid.
Physical state	Solid.
Form	Solid.
Color	Black.
Odor	Odorless.
Odor threshold	Not available.
pH	Not available.
Vapor pressure	Not available.
Vapor density	Not available.
Boiling point	Not available.
Melting point/Freezing point	> 2500 °F (> 1371.1 °C)
Solubility (water)	Negligible.
Specific gravity	2.7
Flash point	Not available.
Flammability limits in air, upper, % by volume	Not available.
Flammability limits in air, lower, % by volume	Not available.
Auto-ignition temperature	Not available.

10. Chemical Stability & Reactivity Information

Chemical stability	The product is stable and non reactive under normal conditions of use, storage and transport.
Conditions to avoid	None known.
Incompatible materials	Strong acids.
Hazardous decomposition products	None known.
Possibility of hazardous reactions	Hazardous polymerization does not occur.

11. Toxicological Information**Toxicological data**

Constituents	Species	Test Results
Cadmium (CAS 7440-43-9)		
Acute		
<i>Inhalation</i>		
LC50	Rat	0.025 mg/l, 900 Days
<i>Oral</i>		
LD50	Rat	225 mg/kg
Silicon dioxide (CAS 7631-86-9)		
Acute		
<i>Oral</i>		
LD50	Mouse	> 15000 mg/kg
	Rat	> 22500 mg/kg
Sensitization	Not a skin or respiratory sensitizer.	
ACGIH Sensitizer		
Beryllium (CAS 7440-41-7)	Sensitizer.	

Acute effects	Abrasive blasting agents may cause inflammation and pulmonary fibrosis. Ingestion of dusts generated during working operations may cause nausea and vomiting.
Local effects	May cause eye, skin and respiratory tract irritation.
US. ACGIH Threshold Limit Values	
Beryllium (CAS 7440-41-7)	Can be absorbed through the skin.
Chronic effects	Frequent inhalation of fume/dust over a long period of time increases the risk of developing lung diseases.
Carcinogenicity	
ACGIH Carcinogens	
Aluminum oxide (CAS 1344-28-1)	A4 Not classifiable as a human carcinogen.
Beryllium (CAS 7440-41-7)	A1 Confirmed human carcinogen.
Cadmium (CAS 7440-43-9)	A2 Suspected human carcinogen.
Iron oxide (CAS 1309-37-1)	A4 Not classifiable as a human carcinogen.
Magnesium oxide (CAS 1309-48-4)	A4 Not classifiable as a human carcinogen.
Silicon dioxide, crystalline (CAS 14808-60-7)	A2 Suspected human carcinogen.
Titanium dioxide (CAS 13463-67-7)	A4 Not classifiable as a human carcinogen.
IARC Monographs. Overall Evaluation of Carcinogenicity	
Beryllium (CAS 7440-41-7)	1 Carcinogenic to humans.
Cadmium (CAS 7440-43-9)	1 Carcinogenic to humans.
Iron oxide (CAS 1309-37-1)	3 Not classifiable as to carcinogenicity to humans.
Silicon dioxide (CAS 7631-86-9)	3 Not classifiable as to carcinogenicity to humans.
Silicon dioxide, crystalline (CAS 14808-60-7)	1 Carcinogenic to humans.
Titanium dioxide (CAS 13463-67-7)	2B Possibly carcinogenic to humans.
US NTP Report on Carcinogens: Known carcinogen	
Beryllium (CAS 7440-41-7)	Known To Be Human Carcinogen.
Cadmium (CAS 7440-43-9)	Known To Be Human Carcinogen.
Silicon dioxide, crystalline (CAS 14808-60-7)	Known To Be Human Carcinogen.
US. OSHA Specifically Regulated Substances (29 CFR 1910.1001-1050)	
Cadmium (CAS 7440-43-9)	Cancer hazard.
Mutagenicity	No data available.
Reproductive effects	No data available.
Symptoms and target organs	Irritation of nose and throat. Irritation of eyes and mucous membranes. May cause respiratory tract irritation. Shortness of breath.

12. Ecological Information

Ecotoxicity	The product is not classified as environmentally hazardous. However, this does not exclude the possibility that large or frequent spills can have a harmful or damaging effect on the environment.
Environmental effects	An environmental hazard cannot be excluded in the event of unprofessional handling or disposal.
Persistence and degradability	The product is not biodegradable.
Bioaccumulation / Accumulation	The product is not bioaccumulating.

13. Disposal Considerations

Waste codes	The Waste code should be assigned in discussion between the user, the producer and the waste disposal company.
Disposal instructions	Dispose in accordance with all applicable regulations.
Waste from residues / unused products	Dispose in accordance with all applicable regulations.
Contaminated packaging	Since emptied containers may retain product residue, follow label warnings even after container is emptied.

14. Transport Information

DOT	Not regulated as a hazardous material by DOT.
IATA	Not regulated as dangerous goods.
IMDG	Not regulated as dangerous goods.

TDG

Not regulated as dangerous goods.

15. Regulatory Information**US federal regulations**

This product is a "Hazardous Chemical" as defined by the OSHA Hazard Communication Standard, 29 CFR 1910.1200.
All components are on the U.S. EPA TSCA Inventory List.

TSCA Section 12(b) Export Notification (40 CFR 707, Subpt. D)

Not regulated.

Clean Air Act (CAA) Section 112 Hazardous Air Pollutants (HAPs) List

Beryllium (CAS 7440-41-7)
Cadmium (CAS 7440-43-9)
Manganese (CAS 7439-96-5)

US EPCRA (SARA Title III) Section 313 - Toxic Chemical: De minimis concentration

Aluminum oxide (CAS 1344-28-1)	1.0 %
Beryllium (CAS 7440-41-7)	0.1 %
Cadmium (CAS 7440-43-9)	0.1 %
Manganese (CAS 7439-96-5)	1.0 %

US EPCRA (SARA Title III) Section 313 - Toxic Chemical: Listed substance

Aluminum oxide (CAS 1344-28-1)	Listed.
Beryllium (CAS 7440-41-7)	Listed.
Cadmium (CAS 7440-43-9)	Listed.
Manganese (CAS 7439-96-5)	Listed.

CERCLA (Superfund) reportable quantity (lbs) (40 CFR 302.4)

None

Superfund Amendments and Reauthorization Act of 1986 (SARA)

Hazard categories	Immediate Hazard - Yes
	Delayed Hazard - Yes
	Fire Hazard - No
	Pressure Hazard - No
	Reactivity Hazard - No

Section 302 extremely hazardous substance (40 CFR 355, Appendix A)	No

Section 311/312 (40 CFR 370)	Yes

Drug Enforcement Administration (DEA) (21 CFR 1308.11-15)

Not controlled

Canadian regulations

This product has been classified in accordance with the hazard criteria of the CPR and the MSDS contains all the information required by the CPR.

WHMIS status

Non-controlled

Inventory status

Country(s) or region	Inventory name	On inventory (yes/no)*
Australia	Australian Inventory of Chemical Substances (AICS)	No
Canada	Domestic Substances List (DSL)	Yes
Canada	Non-Domestic Substances List (NDSL)	No
China	Inventory of Existing Chemical Substances in China (IECSC)	No
Europe	European Inventory of Existing Commercial Chemical Substances (EINECS)	Yes
Europe	European List of Notified Chemical Substances (ELINCS)	No
Japan	Inventory of Existing and New Chemical Substances (ENCS)	No
Korea	Existing Chemicals List (ECL)	Yes
New Zealand	New Zealand Inventory	No

Country(s) or region	Inventory name	On inventory (yes/no)*
Philippines	Philippine Inventory of Chemicals and Chemical Substances (PICCS)	Yes
United States & Puerto Rico	Toxic Substances Control Act (TSCA) Inventory	Yes

*A "Yes" indicates this product complies with the inventory requirements administered by the governing country(s)

State regulations WARNING: This product contains chemical(s) known to the State of California to cause cancer and birth defects or other reproductive harm.

US - California Hazardous Substances (Director's): Listed substance

Aluminum oxide (CAS 1344-28-1)	Listed.
Beryllium (CAS 7440-41-7)	Listed.
Cadmium (CAS 7440-43-9)	Listed.
Calcium oxide (CAS 1305-78-8)	Listed.
Iron oxide (CAS 1309-37-1)	Listed.
Magnesium oxide (CAS 1309-48-4)	Listed.
Manganese (CAS 7439-96-5)	Listed.
Silicon dioxide (CAS 7631-86-9)	Listed.

US - California Proposition 65 - Carcinogens & Reproductive Toxicity (CRT): Listed substance

Beryllium (CAS 7440-41-7)	Listed.
Cadmium (CAS 7440-43-9)	Listed.
Silicon dioxide, crystalline (CAS 14808-60-7)	Listed.
Titanium dioxide (CAS 13463-67-7)	Listed.

US - California Proposition 65 - CRT: Listed date/Carcinogenic substance

Beryllium (CAS 7440-41-7)	Listed: October 1, 1987 Carcinogenic.
Cadmium (CAS 7440-43-9)	Listed: October 1, 1987 Carcinogenic.
Silicon dioxide, crystalline (CAS 14808-60-7)	Listed: October 1, 1988 Carcinogenic.
Titanium dioxide (CAS 13463-67-7)	Listed: September 2, 2011 Carcinogenic.

US - California Proposition 65 - CRT: Listed date/Developmental toxin

Cadmium (CAS 7440-43-9)	Listed: May 1, 1997 Developmental toxin.

US - California Proposition 65 - CRT: Listed date/Male reproductive toxin

Cadmium (CAS 7440-43-9)	Listed: May 1, 1997 Male reproductive toxin.

US - New Jersey RTK - Substances: Listed substance

Aluminum oxide (CAS 1344-28-1)	Listed.
Beryllium (CAS 7440-41-7)	Listed.
Cadmium (CAS 7440-43-9)	Listed.
Calcium oxide (CAS 1305-78-8)	Listed.
Iron oxide (CAS 1309-37-1)	Listed.
Magnesium oxide (CAS 1309-48-4)	Listed.
Manganese (CAS 7439-96-5)	Listed.
Potassium Oxide (CAS 12136-45-7)	Listed.
Silicon dioxide (CAS 7631-86-9)	Listed.
Silicon dioxide, crystalline (CAS 14808-60-7)	Listed.
Titanium dioxide (CAS 13463-67-7)	Listed.

US - Pennsylvania RTK - Hazardous Substances: All compounds of this substance are considered environmental hazards

Beryllium (CAS 7440-41-7)	LISTED
Cadmium (CAS 7440-43-9)	LISTED
Manganese (CAS 7439-96-5)	LISTED

US - Pennsylvania RTK - Hazardous Substances: Special hazard

Beryllium (CAS 7440-41-7)	Special hazard.
Cadmium (CAS 7440-43-9)	Special hazard.

US. Massachusetts RTK - Substance List

Aluminum oxide (CAS 1344-28-1)	Listed.
Beryllium (CAS 7440-41-7)	Listed.
Cadmium (CAS 7440-43-9)	Listed.
Calcium oxide (CAS 1305-78-8)	Listed.
Iron oxide (CAS 1309-37-1)	Listed.
Magnesium oxide (CAS 1309-48-4)	Listed.
Manganese (CAS 7439-96-5)	Listed.
Silicon dioxide (CAS 7631-86-9)	Listed.
Silicon dioxide, crystalline (CAS 14808-60-7)	Listed.
Titanium dioxide (CAS 13463-67-7)	Listed.

US. New Jersey Worker and Community Right-to-Know Act

Aluminum oxide (CAS 1344-28-1)	500 LBS
Beryllium (CAS 7440-41-7)	500 LBS
Cadmium (CAS 7440-43-9)	500 LBS
Manganese (CAS 7439-96-5)	500 LBS

US. Pennsylvania RTK - Hazardous Substances

Aluminum oxide (CAS 1344-28-1)	Listed.
Beryllium (CAS 7440-41-7)	Listed.
Cadmium (CAS 7440-43-9)	Listed.
Calcium oxide (CAS 1305-78-8)	Listed.
Iron oxide (CAS 1309-37-1)	Listed.
Magnesium oxide (CAS 1309-48-4)	Listed.
Manganese (CAS 7439-96-5)	Listed.
Silicon dioxide (CAS 7631-86-9)	Listed.
Silicon dioxide, crystalline (CAS 14808-60-7)	Listed.
Titanium dioxide (CAS 13463-67-7)	Listed.

Mexico regulations This safety data sheet was prepared in accordance with the Official Mexican Standard (NOM-018-STPS-2000).

16. Other Information

Further information HMIS® is a registered trade and service mark of the NPCA.
A HMIS® Health rating including an * indicates a chronic hazard.

HMIS® ratings Health: 2*
Flammability: 0
Physical hazard: 0

NFPA ratings Health: 1
Flammability: 0
Instability: 0

Disclaimer The information in the sheet was written based on the best knowledge and experience currently available.

ATTACHMENT 5
NO_x Emission Calculations

Table B-7. TEC Big Bend Station
Simple Cycle Combustion Turbines; Unit 4
Hourly NO_x, CO, and VOC Emission Rates (Per CT) - ULSD Fuel Oil

Temp. (°F)	Case	Load (%)	NO _x			CO			VOC ¹		
			(ppmvd) ²	(lb/hr) ⁴	(g/sec)	(ppmvd) ²	(lb/hr)	(g/sec)	(ppmvd) ²	(lb/hr) ³	(g/sec) ³
20	1-Oil	100	74	87.0	10.97	2.1	1.5	0.19	2.5	1.0	0.13
	2-Oil	75	74	68.5	8.64	3.2	1.8	0.23	4.4	1.4	0.18
	3-Oil	50	74	50.6	6.37	5.1	2.1	0.26	12.7	3.0	0.38
59	4-Oil	100	74	89.0	11.21	2.0	1.5	0.19	2.5	1.1	0.13
	5-Oil	75	74	70.1	8.84	2.3	1.4	0.18	2.5	0.8	0.10
	6-Oil	50	74	51.6	6.50	3.8	1.6	0.20	6.6	1.6	0.20
90	7-Oil	100	74	90.4	11.39	2.0	1.5	0.19	2.5	1.1	0.13
	8-Oil	75	74	71.2	8.97	2.0	1.2	0.15	2.5	0.9	0.11
	9-Oil	50	74	52.5	6.62	3.8	0.6	0.08	3.9	1.0	0.12
Maximums			74	90.4	11.39	5.1	2.1	0.26	12.7	3.0	0.38

¹ 50% control for oxidation catalyst.

² Corrected to 15% O₂.

³ Expressed as methane.

⁴ New rate calculated: $M_{\text{new}} = M_{\text{old}} \cdot (74/42)$

Sources: ECT, 2014.

PWPS, 2008.

Table B-11. TEC Big Bend Station
Simple Cycle Combustion Turbines; Unit 4
Annual Criteria Pollution - Annual Profile No. 2

Source	Case	No. of CTs	Operations (hrs/yr)	NOx Emissions	
				(lb/hr)	(tpy)
Unit 4 ¹	4-Gas	2	3000	64.0	96.0
Unit 4 ²	4-Oil	2	500	180.8	45.2
		Totals	3500	N/A	141.2

¹ Natural emission data is Table B-11 used collected for ECT's application No. 071286-0100 (ECT 2008)

² Fuel oil emission data is from Revised Table B-7 (ECT 2014).

NOx Emission rate = No. CTs * Rate_oil {lb/hr} * Time {hr} * {1 ton/2000 lb} + No. CTs * Rate_gas {lb/hr} * Time {hr} * {1 ton/2000 lb}|gas