

STATE OF FLORIDA
DEPARTMENT OF ENVIRONMENTAL PROTECTION
NOTICE OF FINAL PERMIT

In the Matter of an
Application for Permit by:

Mr. J. Jeffery Pardue
Director, Environmental Services Department
Florida Power Corporation
3201 34th Street South
St. Petersburg, Florida 33711

FINAL Permit No.: 1030011-002-AV
and Permit No.: 1030011-006-AC
Bartow Facility

Enclosed is FINAL Permit Number 1030011-002-AV and Permit Number 1030011-006-AC for the operation of the Bartow Facility located at Weedon Island, St. Petersburg, Pinellas County issued pursuant to Chapter 403, Florida Statutes (F.S.).

Any party to this order (permit) has the right to seek judicial review of the permit pursuant to Section 120.68, F.S., by the filing of a Notice of Appeal pursuant to Rule 9.110, Florida Rules of Appellate Procedure, with the Clerk of the permitting authority in the Legal Office; and by filing a copy of the Notice of Appeal accompanied by the applicable filing fees with the appropriate District Court of Appeal. The Notice of Appeal must be filed within 30 (thirty) days from the date this Notice is filed with the Clerk of the permitting authority.

Executed in Tallahassee, Florida.



C. H. Fancy, P.E.
Chief
Bureau of Air Regulation


CERTIFICATE OF SERVICE

The undersigned duly designated deputy agency clerk hereby certifies that this NOTICE OF FINAL PERMIT (including the FINAL permit) was sent by certified mail (*) and copies were mailed by U.S. Mail before the close of business on 12/29/99 to the person(s) listed or as otherwise noted:

Mr. Kennard Kosky, PE, Golder Associates, Inc.
Mr. Scott Osbourn, FPC
Mr. Peter Hessling, PCDEM
Mr. Gregg Worley, USEPA, Region 4 (INTERNET E-mail Memorandum)
Ms. Elizabeth Bartlett, USEPA, Region 4 (INTERNET E-mail Memorandum)

Clerk Stamp

FILING AND ACKNOWLEDGMENT FILED, on this date, pursuant to Section 120.52(7), Florida Statutes, with the designated agency Clerk, receipt of which is hereby acknowledged.

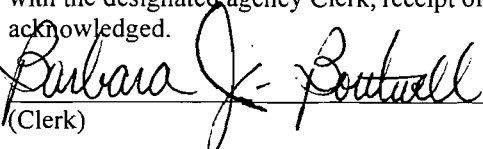 12/29/99
(Clerk) (Date)

12/29/99 cc: Ed Svec
Reading File

FINAL PERMIT DETERMINATION

I. Comment(s).

Objections were received from USEPA, the objections were resolved, approval of the resolutions were conveyed in a letter from Winston Smith dated December 16, 1999 and the PROPOSED Title V permit was changed. The comments were not considered significant enough to reissue a DRAFT Title V permit and require another public notice. The changes made are shown below.

A. EPA Objection Issues

1. Emissions Limitations - The statement of basis indicates that each emission unit is subject to a particulate matter emissions limit of 0.1 lb/MMBtu, and this limit is effectively equivalent to 0.149 lb/MMBtu due to rounding. This is also stated for conditions of soot blowing, where the particulate matter emission limit of 0.3 lb/MMBtu would be equivalent to 0.349 lb/MMBtu. However, these statements are incorrect. A measured emission rate of 0.149 lb/MMBtu actually rounds to 0.15 lb/MMBtu rather than 0.1 lb/MMBtu, which is in excess of the emission limit, and therefore not allowable.

Part 70 authorizes EPA to object "to issuance of any proposed permit determined by the Administrator not to be in compliance with applicable requirements or requirements under [part 70]." See 40 C.F.R. § 70.8(c)(1). We are objecting to the statement in the statement of basis indicating that the permit's 0.1 lb/MMBtu particulate limit is "effectively equivalent to 0.149 lb/MMBtu because of rounding." This represents an improper and incorrect statement of the legal and factual basis for the permit's 0.1 lb/MMBtu particulate limit, and therefore issuance of the proposed permit with this statement of basis does not comply with the requirement of part 70 at 40 C.F.R. § 70.7(a)(5). Moreover, emission levels of 0.149 lb/MMBtu will not assure compliance with the 0.1 lb/MMBtu particulate limit. Accordingly, issuance of the proposed permit with this statement of basis would not assure compliance with the applicable requirement represented by the 0.1 lb/MMBtu particulate limit.

The statement of basis justifies use of rounding based on "the agreement of March 10, 1998, between EPA, Region 4 and the Department to resolve an objection on this specific issue." However, EPA's March 16, 1998, response to FDEP's March 10, 1998, letter specifically requested that language on rounding be removed from the statement of basis for five Florida Power and Light permits "in order to avoid misinterpretation." As a result, all references to rounding must be removed from the statement of basis.

Future permit determinations should provide justification for allowing annual particulate matter stack testing based on past compliance with emission limits and the potential for variability of emissions based on review of historical data. Periodic monitoring should be based on a case-by-case evaluation of emissions data rather than on a "bright line" test of whether average emissions exceed fifty percent of a "rounded" emission limit.

RESPONSE: The Statement of Basis will be changed as follows:

From: Unit No. 1 is a front-fired, fossil fuel steam generator which produces 120 megawatts, electric power. The maximum heat input rate is 1,220 million Btu per hour and the unit fires No. 2 through No. 6 fuel oil, and on-specification used oil. Particulate matter emissions are controlled by a General Electric Services, Inc. Model 1-BAB1.2X37(9)36.0-434-4.3P electrostatic precipitator consisting of five fields in depth. The permit application indicates this ESP was designed to operate when utilizing a coal/oil mixture which is no longer burned by FPC. Because Unit 1 is oil fired and this unit is capable of meeting the applicable particulate matter and opacity limits in Conditions A.5., A.6., A.7., and A.8. without use of the ESP, the provisions of 40 CFR 64 do not apply [40 CFR 64.2(b)(ii)]. A Durag Model 281 Continuous Emissions Monitor for opacity with a recorder is used for continual observation of stack opacity. Unit 1 began commercial service in 1958. The Department has determined that the appropriate particulate matter testing frequency for the fossil fuel steam generators is annually whenever fuel oil is used for more than 400 hours in the preceding year. This frequency is justified by the low emission rate documented in previous emissions tests while firing fuel oil. This unit is subject to a steady-state PM emission limit of 0.1 lb/MMBtu, which is effectively equivalent to 0.149 lb/MMBtu because of rounding, in accordance with the agreement of March 10, 1998 between EPA, Region 4 and the Department to resolve an objection on this specific issue. The applicant has presented historical PM test results which show that the steady-state average results are less than half the applicable effective standard. The Department has determined that sources with emissions less than half of the effective standard shall test annually. A five year average of results of particulate matter emission testing in lb/MMBtu for Unit No. 1 is 0.054, steady-state.

Unit No. 2 is a tangential-fired fossil fuel fired steam generator which produces 120 megawatts, electric power. The maximum heat input rate is 1,317 million Btu per hour and the unit fires No. 2 through No. 6 fuel oil, on-specification used oil, and propane. Emissions from Unit No. 2 are uncontrolled. Unit 2 began commercial service in 1961. The Department has determined that the appropriate particulate matter testing frequency for the fossil fuel steam generators is annually whenever fuel oil is used for more than 400 hours in the preceding year. This frequency is justified by the low emission rate documented in previous emissions tests while firing fuel oil. This unit is subject to a steady-state PM emission limit of 0.1 lb/MMBtu, which is effectively equivalent to 0.149 lb/MMBtu because of rounding, in accordance with the agreement of March 10, 1998 between EPA, Region 4 and the Department to resolve an objection on this specific issue. The applicant has presented historical PM test results which show that the steady-state average results are less than half the applicable effective standard. The Department has determined that sources with emissions less than half of the effective standard shall test annually. A five year average of results of particulate matter emission testing in lb/MMBtu for Unit No. 2 is 0.069, steady-state.

Unit No. 3 is a tangential-fired fossil fuel fired steam generator which produces 225 megawatts, electric power. The maximum heat input rate is 2,211 million Btu per hour and the unit fires No. 2 through No. 6 fuel oil, on-specification used oil, natural gas, and propane. Emissions from Unit No. 3 are uncontrolled. Unit 3 began commercial service in 1963. The Department has determined that the appropriate particulate matter testing frequency for the fossil fuel steam generators is annually whenever fuel oil is used for more than 400 hours in the preceding year. This frequency is justified by the low emission rate documented in previous emissions tests while firing fuel oil. This unit is subject to a steady-state PM emission limit of 0.1 lb/MMBtu, which is effectively equivalent to 0.149 lb/MMBtu because of rounding, in accordance with the agreement of March 10, 1998 between EPA, Region 4 and the Department to resolve an objection on this specific issue. The applicant has presented historical PM test results which show that the steady-state average results are less than half the applicable effective standard. The Department has determined that sources with emissions less than half of the effective standard shall test annually. A five year average of results of particulate matter emission testing in lb/MMBtu for Unit No. 3 is 0.067, steady-state.

To: Unit No. 1 is a front-fired, fossil fuel steam generator which produces 120 megawatts, electric power. The maximum heat input rate is 1,220 million Btu per hour and the unit fires No. 2 through No. 6 fuel oil, and on-specification used oil. Particulate matter emissions are controlled by a General Electric Services, Inc. Model 1-BAB1.2X37(9)36.0-434-4.3P electrostatic precipitator consisting of five fields in depth. The permit application indicates this ESP was designed to operate when utilizing a coal/oil mixture which is no longer burned by FPC. Because Unit 1 is oil fired and this unit is capable of meeting the applicable particulate matter and opacity limits in Conditions A.5., A.6., A.7., and A.8. without use of the ESP, the provisions of 40 CFR 64 do not apply [40 CFR 64.2(b)(ii)]. A Durag Model 281 Continuous Emissions Monitor for opacity with a recorder is used for continual observation of stack opacity. Unit 1 began commercial service in 1958. The Department has determined that the appropriate particulate matter testing frequency for the fossil fuel steam generators is annually whenever fuel oil is used for more than 400 hours in the preceding year. This frequency is justified by the low emission rate documented in previous emissions tests while firing fuel oil. This unit is subject to a steady-state PM emission limit of 0.1 lb/MMBtu. The applicant has presented historical PM test results which show that the steady-state average results are well below the applicable effective standard. The Department has determined that sources that consistently test below the effective standard shall test annually. A five year average of results of particulate matter emission testing in lb/MMBtu for Unit No. 1 is 0.054, steady-state.

Unit No. 2 is a tangential-fired fossil fuel fired steam generator which produces 120 megawatts, electric power. The maximum heat input rate is 1,317 million Btu per hour and the unit fires No. 2 through No. 6 fuel oil, on-specification used oil, and propane. Emissions from Unit No. 2 are uncontrolled. Unit 2 began commercial service in 1961. The Department has determined that the appropriate particulate matter testing frequency for the fossil fuel steam generators is annually whenever fuel oil is used for more than 400 hours in the preceding year. This frequency is justified by the low emission rate documented in previous emissions tests while firing fuel oil. This unit is subject to a steady-state PM emission limit of 0.1 lb/MMBtu. The applicant has presented historical PM test results which show that the steady-state average results are well below the applicable effective standard. The Department has determined that sources that consistently test below the effective standard shall test annually. A five year average of results of particulate matter emission testing in lb/MMBtu for Unit No. 2 is 0.069, steady-state.

Unit No. 3 is a tangential-fired fossil fuel fired steam generator which produces 225 megawatts, electric power. The maximum heat input rate is 2,211 million Btu per hour and the unit fires No. 2 through No. 6 fuel oil, on-specification used oil, natural gas, and propane. Emissions from Unit No. 3 are uncontrolled. Unit 3 began commercial service in 1963. The Department has determined that the appropriate particulate matter testing frequency for the fossil fuel steam generators is annually whenever fuel oil is used for more than 400 hours in the preceding year. This frequency is justified by the low emission rate documented in previous emissions tests while firing fuel oil. This unit is subject to a steady-state PM emission limit of 0.1 lb/MMBtu. The applicant has presented historical PM test results which show that the steady-state average results are well below the applicable effective standard. The Department has determined that sources that consistently test below the effective standard shall test annually. A five year average of results of particulate matter emission testing in lb/MMBtu for Unit No. 3 is 0.067, steady-state.

2. Appropriate Averaging Times - The particulate matter emission limits in conditions A.7 and A.8 do not contain averaging times. Because the stringency of emission limits is a function of both magnitude and averaging time, appropriate averaging times must be added to the permit in order for the limits to be practicably enforceable. An approach that may be used to address this deficiency is to include a general condition in the permit stating that the averaging times for all specified emission standards are tied to or based on the run time of the test method(s) used for determining compliance.

RESPONSE: Add the following after both Specific Condition A.7. and A.8.:

Add: {Permitting note: The averaging time for the particulate matter standard corresponds to the cumulative sampling time of the specified test method.}

B. EPA General Comments

1. General Comment - The title page of the permit specifies that this permit determination is both a proposed title V permit and a draft construction permit. The statement of basis and the permit should both identify which conditions are part of the draft construction permit, and/or which units are subject to the construction permit.

RESPONSE: The following will be added to both the Statement of Basis and the Facility Description under Section I:

Add: The construction permitting action changes the status of a previously permitted emissions unit, the fly ash collection system associated with the Unit 1 electrostatic precipitator (ESP). The permit to construct reclassifies the fly ash system from a regulated emissions unit to an insignificant emissions unit/activity. A previous modification implemented a closed-loop fly ash system, which replaced a conventional fly ash silo/transfer system. The fly ash system (formally called Emissions Unit I.D. No. -009) now meets the requirements of Rules 62-210.300(3)(a) and 62-213.430(6)(b), F.A.C., and is reclassified as an Insignificant Emissions Unit/Activity, where it is currently listed.

2. CAM Applicability - The Unit No. 1 discussions in the statement of basis and in Section III, Subsection A on page 6 of the permit, state that "the provisions of 40 CFR 64 do not apply [40 CFR 64.2(b)(ii)]." While the electrostatic precipitator for Unit No. 1 may not meet the applicability requirement for CAM specified under 40 C.F.R. 64.2(a)(2), Region 4 believes that CAM should not be referenced in the permit until a formal applicability determination has been made through the title V permit renewal process. Furthermore, reference to CAM is not necessary to support the claim that particulate and opacity limits can be met without use of the ESP.

RESPONSE: No change is proposed.

3. Statement of Basis - The discussions for units 1 through 3 provide justification for annual testing of particulate matter based on five years of data showing emissions at less than half of the allowable limit. Review of the permit application indicates that FPC petitioned for annual particulate testing in accordance with the provisions of 62-296.405(1)(a) F.A.C. so that they would be allowed a visible emissions limit of 40 percent with annual, rather than quarterly, particulate testing. The statement of basis should be modified to reflect the allowance of annual particulate testing with a 40 percent VE in accordance with the SIP and supporting orders issued by FDEP.

RESPONSE: The following will be added to the Statement of Basis:

Add: In accordance with the provisions of Rule 62-296.405(1)(a), F.A.C., Units 1, 2 and 3 elected to test for particulate matter quarterly and were allowed visible emissions of 40 percent opacity. The Bartow Plant demonstrated that the particulate matter standard was regularly complied with for each unit and petitioned the Secretary for a reduction in the frequency of particulate matter testing from quarterly to annually, as provided by the rule. The request for annual testing was granted to Unit 1 by OGC Order No. 96-A-01, Unit 2 by OGC Order No. 87-1261 and Unit 3 by OGC Order No. 86-1577.

4. Compliance Certification - Facility-wide Condition 11 of the permit should specifically reference the required components of Appendix TV-3, item 51, which lists the compliance certification requirements of 40 C.F.R. 70.6(c)(5)(iii), to ensure that complete certification information is submitted to EPA.

RESPONSE: The requirement for the annual statement of compliance was contained in the Acid Rain Section of the permit. For consistency with other permits issued to date, the Specific Condition A.4. will be deleted from the Acid Rain Section and the condition will be added to the Facility-wide Requirements in Section II of the permit.

Delete: A.4. Statement of Compliance. The annual statement of compliance pursuant to Rule 62-213.440(3), F.A.C., shall be submitted within 60 (sixty) days after the end of the calendar year. {See condition 52., APPENDIX TV-3, TITLE V CONDITIONS}
[Rule 62-214.420(11), F.A.C.]

Add: 12. Statement of Compliance. The annual statement of compliance pursuant to Rule 62-213.440(3), F.A.C., shall be submitted within 60 (sixty) days after the end of the calendar year. {See condition 51., APPENDIX TV-3, TITLE V CONDITIONS}
[Rule 62-214.420(11), F.A.C.]

5. Minimum Sample Volume for Particulate Testing - Condition A.20. specifies a minimum sample volume of 30 dry standard cubic feet for particulate testing, in accordance with 62-296.405(e)2. F.A.C. of the SIP. Condition A.26.(b) specifies a minimum sample volume of 25 dscf, or other volume as required by rule. Since these permit conditions are contradictory, a permitting note should be added to Conditions A.26.(b) to clarify that the required sample volume is 30 dry standard cubic feet.

RESPONSE: The following change will be made to Specific Condition A.26.:

From: (b) Minimum Sample Volume. Unless otherwise specified in the applicable rule, the minimum sample volume per run shall be 25 dry standard cubic feet.

To: (b) Minimum Sample Volume. Unless otherwise specified in the applicable rule, the minimum sample volume per run shall be 25 dry standard cubic feet. See **Specific Condition A.20**.

6. Record keeping - Conditions D.19 and D.20 address record keeping for the relocatable generators. The permit states that this generator will be operated at six different facilities, five of which are not covered under this permit. This emission unit should also be included in the permits for the other five facilities. Please clarify in the statement of basis whether or not this is the case. The above referenced permit conditions require the source to keep records for the hours of operation as well as the fuel oil sulfur content in order to demonstrate compliance with operational and emission limitations. However, the permit does not indicate whether the records will be transferred with the emission unit when it is moved to another facility, or if each facility will be responsible for maintaining their own records. The permit and/or statement of basis should specify how these records will be maintained and if record keeping activities must be coordinated among the facilities.

RESPONSE: The following change is made to the Statement of Basis:

From: Relocatable diesel generator(s) will have a maximum (combined) heat input of 25.74 MMBtu/hour while being fueled by 186.3 gallons of new No. 2 fuel oil per hour with a maximum (combined) rating of 2460 kilowatts. Emissions from the generator(s) are uncontrolled. The generator(s) may be relocated at any of the following facilities:

1. Crystal River Plant, Powerline Road, Red Level, Citrus County.
2. Bartow Plant, Weedon Island, St. Petersburg, Pinellas County.
3. Higgins Plant, Shore Drive, Oldsmar, Pinellas County.
4. Bayboro Plant, 13th Ave. & 2nd St. South, St. Petersburg, Pinellas County.
5. Wildwood Reclamation Facility, State Road 462, 1 mi. east of U.S. 301, Wildwood, Sumter County.
6. Hines Energy Complex, County Road 555, 1 mi. southwest of Homeland, Polk County.
7. Anclote Power Plant, 1729 Baileys Road, Holiday, Pasco County

To: Relocatable diesel generator(s) will have a maximum (combined) heat input of 25.74 MMBtu/hour while being fueled by 186.3 gallons of new No. 2 fuel oil per hour with a maximum (combined) rating of 2460 kilowatts. Emissions from the generator(s) are uncontrolled. The generator(s) may be relocated at any of the following facilities:

1. Crystal River Plant, Powerline Road, Red Level, Citrus County.
2. Bartow Plant, Weedon Island, St. Petersburg, Pinellas County.
3. Higgins Plant, Shore Drive, Oldsmar, Pinellas County.
4. Bayboro Plant, 13th Ave. & 2nd St. South, St. Petersburg, Pinellas County.
5. Wildwood Reclamation Facility, State Road 462, 1 mi. east of U.S. 301, Wildwood, Sumter County.
6. Hines Energy Complex, County Road 555, 1 mi. southwest of Homeland, Polk County.
7. Anclote Power Plant, 1729 Baileys Road, Holiday, Pasco County

These generator(s) are included in the Title V permits for each of the above listed facilities. The records required by the permit shall be maintained at each individual site. FPC's corporate environmental services department shall be responsible for agency notifications and reporting and is functionally structured to provide coordination among the facilities.

8. Acid Rain Requirements - Please note that the allowances allocated to the Bartow facility units 001 through 003, as indicated under Section IV, Condition A.2. of the proposed permit have been changed. This revision was published in the Federal Register on September 28, 1998 (Vol. 63 No. 187, pp 51706-51765). We recommend that the allowances that are indicated for these units be adjusted to reflect the revised allocation.

RESPONSE: The following changes will be made to Specific Condition A.2. of the Acid Rain Section:

From: A.2. Sulfur dioxide (SO₂) allowance allocations requirements for each Acid Rain unit are as follows:

<u>E.U. ID No.</u>	<u>EPA ID</u>	<u>Year</u>	<u>2000</u>	<u>2001</u>	<u>2002</u>	<u>2003</u>	<u>2004</u>
-001	01	SO ₂ allowances, under Table 2 or 3 of 40 CFR Part 73	2785*	2785*	2785*	2785*	2785*
-002	02	SO ₂ allowances, under Table 2 or 3 of 40 CFR Part 73	2941*	2941*	2941*	2941*	2941*
-003	03	SO ₂ allowances, under Table 2 or 3 of 40 CFR Part 73	5383*	5383*	5383*	5383*	5383*

The number of allowances held by an Acid Rain source in a unit account may differ from the number allocated by the USEPA under Table 2 or 3 of 40 CFR 73.]

To: A.2. Sulfur dioxide (SO₂) allowance allocations requirements for each Acid Rain unit are as follows:

<u>E.U. ID No.</u>	<u>EPA ID</u>	<u>Year</u>	<u>2000</u>	<u>2001</u>	<u>2002</u>	<u>2003</u>	<u>2004</u>
-001	01	SO ₂ allowances, under Table 2 or 3 of 40 CFR Part 73	2805*	2805*	2805*	2805*	2805*
-002	02	SO ₂ allowances, under Table 2 or 3 of 40 CFR Part 73	2961*	2961*	2961*	2961*	2961*
-003	03	SO ₂ allowances, under Table 2 or 3 of 40 CFR Part 73	5428*	5428*	5428*	5428*	5428*

The number of allowances held by an Acid Rain source in a unit account may differ from the number allocated by the USEPA under Table 2 or 3 of 40 CFR 73.]

II. Conclusion.

In conclusion, the changes that have been made are insignificant in nature and do not impose additional noticing requirements. The permitting authority hereby issues the FINAL Title V permit, with any changes noted above.

Appendix U-1, List of Unregulated Emissions Units and/or Activities.

Florida Power Corporation
Bartow Plant

FINAL Permit No.: 1030011-002-AV
Facility ID No.: 1030011

Unregulated Emissions Units and/or Activities. An emissions unit which emits no "emissions-limited pollutant" and which is subject to no unit-specific work practice standard, though it may be subject to regulations applied on a facility-wide basis (e.g., unconfined emissions, odor, general opacity) or to regulations that require only that it be able to prove exemption from unit-specific emissions or work practice standards.

The below listed emissions units and/or activities are neither 'regulated emissions units' nor 'insignificant emissions units'.

E.U. ID

<u>No.</u>	<u>Brief Description of Emissions Units and/or Activity</u>
-010	General Boiler Building - Emergency diesel generator (basement) - 300 gallon fuel oil tank
-011	North Terminal - Diesel engine - Cummings 175 hp - 150 gallon No. 2 oil tank
-012	South Terminal - Gasoline tank, filling station
-013	South Terminal - No. 2 oil storage tank
-014	Turbine - Solvent Storage - Navee cleaner storage tank (4X4X4)
-015	Gas Turbine 1, 2, 3, and 4 - Lube oil vent with demister
-016	Gas Turbine 1, 2, 3, and 4 - Underground 2,600 gallon lube oil storage tank
-017	Gas Turbine 1, 2, 3, and 4 - 500 gallon waste oil storage tank
-018	Fuel Storage - Tank No. 1, 2 and 3 - 150,000 bbls No. 6 fuel oil
-019	Fuel Storage - Tank No. 4 and 5 - 200,000 bbls No. 6 fuel oil
-020	Fuel Storage - Tank No. 6 - 100,000 bbls No. 2 fuel oil
-021	Fuel Storage - Tank No. 7 and 8 - 259,000 bbls No. 6 fuel oil
-022	General Site - Two, 500 gallon propane gas tanks for Unit 2 and 3 ignitors
-023	Tank No. CT#01(2R), CT#02(3R), and CT#03(4R), CT#04(5R) - 5,509 gallons waste oil
-024	Tank No. CT#6(11) - 4,118,142 gallons No. 2 fuel oil
-025	Tank No. #1(1R) - 1,008 gallons unleaded gasoline
-026	Tank No. #2(16) - 34,128 gallons No. 2 fuel oil
-027	Tank No. #4(7) - 6,354,768 gallons No. 6 fuel oil
-028	Tank No. #12 - 100 gallons diesel - emergency fire pump
-029	Tank No. #13 - 200 gallons diesel - emergency generator
-030	Tank No. #15(6) - 550 gallons diesel - vehicle
-031	Tank No. #16(19) - 65,460 gallons fuel additive
-032	Tank No. Boiler Day Tk(15) - 18,675 gallons No. 2 fuel oil
-033	Tank No. Terminal #1(9) - 6,329,232 gallons No. 6 fuel oil
-034	Tank No. Terminal #2(10) - 8,447,544 gallons No. 6 fuel oil
-035	Tank No. Terminal #3(12) - 10,540,740 gallons No. 6 fuel oil
-036	Tank No. Terminal #4(13) - 10,542,294 gallons No. 6 fuel oil
-037	Tank No. Substation #1 and Substation #2 - 16,002 gallons cable oil

[electronic file name: 1030011u.doc]

Appendix I-1, List of Insignificant Emissions Units and/or Activities.

Florida Power Corporation
Bartow Plant

FINAL Permit No.: 1030011-002-AV
Facility ID No.: 1030011

The facilities, emissions units, or pollutant-emitting activities listed in Rule 62-210.300(3)(a), F.A.C., Categorical Exemptions, are exempt from the permitting requirements of Chapters 62-210 and 62-4, F.A.C.; provided, however, that exempt emissions units shall be subject to any applicable emission limiting standards and the emissions from exempt emissions units or activities shall be considered in determining the potential emissions of the facility containing such emissions units. Emissions units and pollutant-emitting activities exempt from permitting under Rule 62-210.300(3)(a), F.A.C., shall not be exempt from the permitting requirements of Chapter 62-213, F.A.C., if they are contained within a Title V source; however, such emissions units and activities shall be considered insignificant for Title V purposes provided they also meet the criteria of Rule 62-213.430(6)(b), F.A.C. No emissions unit shall be entitled to an exemption from permitting under Rule 62.210.300(3)(a), F.A.C., if its emissions, in combination with the emissions of other units and activities at the facility, would cause the facility to emit or have the potential to emit any pollutant in such amount as to make the facility a Title V source.

The below listed emissions units and/or activities are considered insignificant pursuant to Rule 62-213.430(6), F.A.C.

Brief Description of Emissions Units and/or Activities

1. Water Laboratory solvent use and hood-chemical analyses for water
2. Water Laboratory flammable chemical storage cabinet
3. Machine Shop sand blaster, drill press, welding, lathes, hand-held tools, ect.
4. General Boiler Building fire protection equipment
5. North Terminal - Diesel fire pump building flammable liquid cabinet
6. North Terminal - Foam Building Nat. foam XL - 3%; 2,600 gallons
7. South Terminal - Machine Shop sand blaster, drill press, welding, lathes, hand-held tools, ect.
8. Turbine - Fire Protection CO2 fire system
9. Fuel Storage foam fire protection system
10. General Site surface coating <6.0 gallons per day
11. General Site brazing, soldering and welding
12. Unit 1 Fly Ash Handling System

[electronic file name: 1030011g.doc]

APPENDIX TV-3, TITLE V CONDITIONS (version dated 04/30/99)

[Note: This attachment includes "canned conditions" developed from the "Title V Core List."]

{Permitting note: APPENDIX TV-3, TITLE V CONDITIONS, is distributed to the permittee only. Other persons requesting copies of these conditions shall be provided one copy when requested or otherwise appropriate.}

Chapter 62-4, F.A.C.

I. **Not federally enforceable.** General Prohibition. Any stationary installation which will reasonably be expected to be a source of pollution shall not be operated, maintained, or modified without the appropriate and valid permits issued by the Department, unless the source is exempted by Department rule. The Department may issue a permit only after it receives reasonable assurance that the installation will not cause pollution in violation of any of the provisions of Chapter 403, F.S., or the rules promulgated thereunder. A permitted installation may only be operated, maintained, constructed, expanded or modified in a manner that is consistent with the terms of the permit.

[Rule 62-4.030, Florida Administrative Code (F.A.C.); Section 403.087, Florida Statute (F.S.)]

2. **Not federally enforceable:** Procedure to Obtain Permits: Application.

(1) Any person desiring to obtain a permit from the Department shall apply on forms prescribed by the Department and shall submit such additional information as the Department by law may require.

(2) All applications and supporting documents shall be filed in quadruplicate with the Department.

(3) To ensure protection of public health, safety, and welfare, any construction, modification, or operation of an installation which may be a source of pollution shall be in accordance with sound professional engineering practices pursuant to Chapter 471, F.S. All applications for a Department permit shall be certified by a professional engineer registered in the State of Florida except when the application is for renewal of an air pollution operation permit at a minor facility as defined in Rule 62-210.200, F.A.C., or where professional engineering is not required by Chapter 471, F.S. Where required by Chapter 471 or 492, F.S., applicable portions of permit applications and supporting documents which are submitted to the Department for public record shall be signed and sealed by the professional(s) who prepared or approved them.

(4) Processing fees for air construction permits shall be in accordance with Rule 62-4.050(4), F.A.C.

(5)(a) To be considered by the Department, each application must be accompanied by the proper processing fee. The fee shall be paid by check, payable to the Department of Environmental Protection. The fee is non-refundable except as provided in Section 120.60, F.S., and in this section.

(c) Upon receipt of the proper application fee, the permit processing time requirements of Sections 120.60(2) and 403.0876, F.S., shall begin.

(d) If the applicant does not submit the required fee within ten days of receipt of written notification, the Department shall either return the unprocessed application or arrange with the applicant for the pick up of the application.

(e) If an applicant submits an application fee in excess of the required fee, the permit processing time requirements of Sections 120.60(2) and 403.0876, F.S., shall begin upon receipt, and the Department shall refund to the applicant the amount received in excess of the required fee.

(6) Any substantial modification to a complete application shall require an additional processing fee determined pursuant to the schedule set forth in Rule 62-4.050, F.A.C., and shall restart the time requirements of Sections 120.60 and 403.0876, F.S. For purposes of this Subsection, the term "substantial modification" shall mean a modification which is reasonably expected to lead to substantially different environmental impacts which require a detailed review.

(7) Modifications to existing permits proposed by the permittee which require substantial changes in the existing permit or require substantial evaluation by the Department of potential impacts of the proposed modifications shall require the same fee as a new application.

[Rule 62-4.050, F.A.C.]

3. Standards for Issuing or Denying Permits. Except as provided at Rule 62-213.460, F.A.C., the issuance of a permit does not relieve any person from complying with the requirements of Chapter 403, F.S., or Department rules.

[Rule 62-4.070(7), F.A.C.]

4. Modification of Permit Conditions.

(1) For good cause and after notice and an administrative hearing, if requested, the Department may require the permittee to conform to new or additional conditions. The Department shall allow the permittee a reasonable time to conform to the new or additional conditions and on application of the permittee the Department may grant additional time. For the purpose of this section, good cause shall include, but not be limited to, any of the following: (also, see Condition No. 38)

- (a) A showing that an improvement in effluent or emission quality or quantity can be accomplished because of technological advances without unreasonable hardship.
- (b) A showing that a higher degree of treatment is necessary to effect the intent and purpose of Chapter 403, F.S.
- (c) A showing of any change in the environment or surrounding conditions that requires a modification to conform to applicable air or water quality standards.
- (e) Adoption or revision of Florida Statutes, rules, or standards which require the modification of a permit condition for compliance.

(2) A permittee may request a modification of a permit by applying to the Department.

(3) A permittee may request that a permit be extended as a modification of the permit. Such a request must be submitted to the Department in writing before the expiration of the permit. Upon timely submittal of a request for extension, unless the permit automatically expires by statute or rule, the permit will remain in effect until final agency action is taken on the request. For construction permits, an extension shall be granted if the applicant can demonstrate reasonable assurances that, upon completion, the extended permit will comply with the standards and conditions required by applicable regulation. For all other permits, an extension shall be granted if the applicant can demonstrate reasonable assurances that the extended permit will comply with the standards and conditions applicable to the original permit. A permit for which the permit application fee was prorated in accordance with Rule 62-4.050(4)(1), F.A.C., shall not be extended. In no event shall a permit be extended or remain in effect longer than the time limits established by statute or rule.

[Rule 62-4.080, F.A.C.]

5. Renewals. Prior to one hundred eighty (180) days before the expiration of a permit issued pursuant to Chapter 62-213, F.A.C., the permittee shall apply for a renewal of a permit using forms incorporated by reference in the specific rule chapter for that kind of permit. A renewal application shall be timely and sufficient. If the application is submitted prior to 180 days before expiration of the permit, it will be considered timely and sufficient. If the renewal application is submitted at a later date, it will not be considered timely and sufficient unless it is submitted and made complete prior to the expiration of the operation permit. When the application for renewal is timely and sufficient, the existing permit shall remain in effect until the renewal application has been finally acted upon by the Department or, if there is court review of the Department's final agency action, until a later date is required by Section 120.60, F.S., provided that, for renewal of a permit issued pursuant to Chapter 62-213, F.A.C., the applicant complies with the requirements of Rules 62-213.420(1)(b)3. and 4., F.A.C.

[Rule 62-4.090(1), F.A.C.]

6. Suspension and Revocation.

(1) Permits shall be effective until suspended, revoked, surrendered, or expired and shall be subject to the provisions of Chapter 403, F.S., and rules of the Department.

(2) Failure to comply with pollution control laws and rules shall be grounds for suspension or revocation.

(3) A permit issued pursuant to Chapter 62-4, F.A.C., shall not become a vested property right in the permittee. The Department may revoke any permit issued by it if it finds that the permit holder or the permit holder's agent:

- (a) Submitted false or inaccurate information in application or operational reports.
- (b) Has violated law, Department orders, rules or permit conditions.
- (c) Has failed to submit operational reports or other information required by Department rules.
- (d) Has refused lawful inspection under Section 403.091, F.S.

[Rule 62-4.100, F.A.C.]

7. Not federally enforceable. Financial Responsibility. The Department may require an applicant to submit proof of financial responsibility and may require the applicant to post an appropriate bond to guarantee compliance with the law and Department rules.

[Rule 62-4.110, F.A.C.]

8. Transfer of Permits.

- (1) Within 30 days after the sale or legal transfer of a permitted facility, an "Application for Transfer of Permit" (DEP Form 62-1.201(1)) must be submitted to the Department. This form must be completed with the notarized signatures of both the permittee and the proposed new permittee.
- (2) The Department shall approve the transfer of a permit unless it determines that the proposed new permittee cannot provide reasonable assurances that conditions of the permit will be met. The determination shall be limited solely to the ability of the new permittee to comply with the conditions of the existing permit, and it shall not concern the adequacy of these permit conditions. If the Department proposes to deny the transfer, it shall provide both the permittee and the proposed new permittee a written objection to such transfer together with notice of a right to request a Chapter 120, F.S., proceeding on such determination.
- (3) Within 30 days of receiving a properly completed Application for Transfer of Permit form, the Department shall issue a final determination. The Department may toll the time for making a determination on the transfer by notifying both the permittee and the proposed new permittee that additional information is required to adequately review the transfer request. Such notification shall be served within 30 days of receipt of an Application for Transfer of Permit form, completed pursuant to Rule 62-4.120(1), F.A.C. If the Department fails to take action to approve or deny the transfer within 30 days of receipt of the completed Application for Transfer of Permit form, or within 30 days of receipt of the last item of timely requested additional information, the transfer shall be deemed approved.
- (4) The permittee is encouraged to apply for a permit transfer prior to the sale or legal transfer of a permitted facility. However, the transfer shall not be effective prior to the sale or legal transfer.
- (5) Until this transfer is approved by the Department, the permittee and any other person constructing, operating, or maintaining the permitted facility shall be liable for compliance with the terms of the permit. The permittee transferring the permit shall remain liable for corrective actions that may be required as a result of any violations occurring prior to the sale or legal transfer of the facility.

[Rule 62-4.120, F.A.C.]

9. Plant Operation-Problems. If the permittee is temporarily unable to comply with any of the conditions of the permit due to breakdown of equipment or destruction by hazard of fire, wind or by other cause, the permittee shall immediately notify the Department. Notification shall include pertinent information as to the cause of the problem, and what steps are being taken to correct the problem and to prevent its recurrence, and where applicable, the owner's intent toward reconstruction of destroyed facilities. Such notification does not release the permittee from any liability for failure to comply with Department rules. (also, see Condition No. 10)

[Rule 62-4.130, F.A.C.]

10. For purposes of notification to the Department pursuant to Condition No. 9, Condition No. 12(8), and Rule 62-4.130, F.A.C., Plant Operation-Problems, "immediately" shall mean the same day, if during a workday (i.e., 8:00 a.m. - 5:00 p.m.), or the first business day after the incident, excluding weekends and holidays; and, for purposes of 40 CFR 70.6(a)(3)(iii)(B), "prompt" shall have the same meaning as "immediately". [also, see Conditions Nos. 9 and 12(8)]

[40 CFR 70.6(a)(3)(iii)(B)]

11. Not federally enforceable. Review. Failure to request a hearing within 14 days of receipt of notice of proposed or final agency action on a permit application or as otherwise required in Chapter 62-103, F.A.C., shall be deemed a waiver of the right to an administrative hearing.

[Rule 62-4.150, F.A.C.]

12. Permit Conditions. All permits issued by the Department shall include the following general conditions:

- (1) The terms, conditions, requirements, limitations and restrictions set forth in this permit, are "permit conditions" and are binding and enforceable pursuant to Sections 403.141, 403.727, or 403.859 through 403.861, F.S. The permittee is placed on notice that the Department will review this permit periodically and may initiate enforcement action for any violation of these conditions.
- (2) This permit is valid only for the specific processes and operations applied for and indicated in the approved drawings or exhibits. Any unauthorized deviation from the approved drawings, exhibits, specifications, or conditions of this permit may constitute grounds for revocation and enforcement action by the Department.
- (3) As provided in subsections 403.087(6) and 403.722(5), F.S., the issuance of this permit does not convey any vested rights or any exclusive privileges. Neither does it authorize any injury to public or private property or any invasion of personal rights, nor any infringement of federal, state, or local laws or regulations. This permit is not a waiver of or approval of any other Department permit that may be required for other aspects of the total project which are not addressed in this permit.

- (4) This permit conveys no title to land or water, does not constitute State recognition or acknowledgment of title, and does not constitute authority for the use of submerged lands unless herein provided and the necessary title or leasehold interests have been obtained from the State. Only the Trustees of the Internal Improvement Trust Fund may express State opinion as to title.
- (5) This permit does not relieve the permittee from liability for harm or injury to human health or welfare, animal, or plant life, or property caused by the construction or operation of this permitted source, or from penalties therefore; nor does it allow the permittee to cause pollution in contravention of F.S. and Department rules, unless specifically authorized by an order from the Department.
- (6) The permittee shall properly operate and maintain the facility and systems of treatment and control (and related appurtenances) that are installed and used by the permittee to achieve compliance with the conditions of this permit, as required by Department rules. This provision includes the operation of backup or auxiliary facilities or similar systems when necessary to achieve compliance with the conditions of the permit and when required by Department rules.
- (7) The permittee, by accepting this permit, specifically agrees to allow authorized Department personnel, upon presentation of credentials or other documents as may be required by law and at reasonable times, access to the premises where the permitted activity is located or conducted to:
- (a) Have access to and copy any records that must be kept under conditions of the permit;
 - (b) Inspect the facility, equipment, practices, or operations regulated or required under this permit; and,
 - (c) Sample or monitor any substances or parameters at any location reasonable necessary to assure compliance with this permit or Department rules. Reasonable time may depend on the nature of the concern being investigated.
- (8) If, for any reason, the permittee does not comply with or will be unable to comply with any condition or limitation specified in this permit, the permittee shall immediately provide the Department with the following information: (also, see Condition No. 10)
- (a) A description of and cause of noncompliance; and,
 - (b) The period of noncompliance, including dates and times; or, if not corrected, the anticipated time the noncompliance is expected to continue, and steps being taken to reduce, eliminate, and prevent recurrence of the noncompliance. The permittee shall be responsible for any and all damages which may result and may be subject to enforcement action by the Department for penalties or for revocation of this permit.
- (9) In accepting this permit, the permittee understands and agrees that all records, notes, monitoring data and other information relating to the construction or operation of this permitted source which are submitted to the Department may be used by the Department as evidence in any enforcement case involving the permitted source arising under the F.S. or Department rules, except where such use is prescribed by Sections 403.111 and 403.73, F.S. Such evidence shall only be used to the extent it is consistent with the Florida Rules of Civil Procedure and appropriate evidentiary rules.
- (10) The permittee agrees to comply with changes in Department rules and F.S. after a reasonable time for compliance; provided, however, the permittee does not waive any other rights granted by F.S. or Department rules.
- (11) This permit is transferable only upon Department approval in accordance with Rule 62-4.120, F.A.C., as applicable. The permittee shall be liable for any non-compliance of the permitted activity until the transfer is approved by the Department.
- (12) This permit or a copy thereof shall be kept at the work site of the permitted activity.
- (14) The permittee shall comply with the following:
- (a) Upon request, the permittee shall furnish all records and plans required under Department rules. During enforcement actions, the retention period for all records will be extended automatically unless otherwise stipulated by the Department.
 - (b) The permittee shall hold at the facility or other location designated by this permit records of all monitoring information (including all calibration and maintenance records and all original strip chart recordings for continuous monitoring instrumentation) required by the permit, copies of all reports required by this permit, and records of all data used to complete the application for this permit. These materials shall be retained at least five (5) years from the date of the sample, measurement, report, or application unless otherwise specified by Department rule.
 - (c) Records of monitoring information shall include:
 - 1. the date, exact place, and time of sampling or measurements;
 - 2. the person responsible for performing the sampling or measurements;
 - 3. the dates analyses were performed;
 - 4. the person responsible for performing the analyses;
 - 5. the analytical techniques or methods used; and,
 - 6. the results of such analyses.
- (15) When requested by the Department, the permittee shall within a reasonable time furnish any information required by law which is needed to determine compliance with the permit. If the permittee becomes aware the relevant facts were not submitted or were incorrect in the permit application or in any report to the Department, such facts or information shall be corrected promptly.
- [Rules 62-4.160 and 62-213.440(1)(b), F.A.C.]

13. Construction Permits.

(1) No person shall construct any installation or facility which will reasonably be expected to be a source of air or water pollution without first applying for and receiving a construction permit from the Department unless exempted by statute or Department rule. In addition to the requirements of Chapter 62-4, F.A.C., applicants for a Department Construction Permit shall submit the following as applicable:

- (a) A completed application on forms furnished by the Department.
- (b) An engineering report covering:
 - 1. plant description and operations,
 - 2. types and quantities of all waste material to be generated whether liquid, gaseous or solid,
 - 3. proposed waste control facilities,
 - 4. the treatment objectives,
 - 5. the design criteria on which the control facilities are based, and,
 - 6. other information deemed relevant.

Design criteria submitted pursuant to Rule 62-4.210(1)(b)5., F.A.C., shall be based on the results of laboratory and pilot-plant scale studies whenever such studies are warranted. The design efficiencies of the proposed waste treatment facilities and the quantities and types of pollutants in the treated effluents or emissions shall be indicated. Work of this nature shall be subject to the requirements of Chapter 471, F.S. Where confidential records are involved, certain information may be kept confidential pursuant to Section 403.111, F.S.

- (c) The owners' written guarantee to meet the design criteria as accepted by the Department and to abide by Chapter 403, F.S. and the rules of the Department as to the quantities and types of materials to be discharged from the installation. The owner may be required to post an appropriate bond or other equivalent evidence of financial responsibility to guarantee compliance with such conditions in instances where the owner's financial resources are inadequate or proposed control facilities are experimental in nature.

(2) The construction permit may contain conditions and an expiration date as determined by the Secretary or the Secretary's designee.

(3) When the Department issues a permit to construct, the permittee shall be allowed a period of time, specified in the permit, to construct, and to operate and test to determine compliance with Chapter 403, F.S., and the rules of the Department and, where applicable, to apply for and receive an operation permit. The Department may require tests and evaluations of the treatment facilities by the permittee at his/her expense.

[Rule 62-4.210, F.A.C.]

14. Not federally enforceable. Operation Permit for New Sources. To properly apply for an operation permit for new sources, the applicant shall submit certification that construction was completed noting any deviations from the conditions in the construction permit and test results where appropriate.

[Rule 62-4.220, F.A.C.]

Chapters 28-106 and 62-110. F.A.C.

15. Public Notice, Public Participation, and Proposed Agency Action. The permittee shall comply with all of the requirements for public notice, public participation, and proposed agency action pursuant to Rule 62-110.106 and Rule 62-210.350, F.A.C.

[Rules 62-110.106, 62-210.350 and 62-213.430(1)(b), F.A.C.]

16. Administrative Hearing. The permittee shall comply with all of the requirements for a petition for administrative hearing or waiver of right to administrative proceeding pursuant to Rules 28-106.201, 28-106.301 and 62-110.106, F.A.C.

[Rules 28-106.201, 28-106.301 and 62-110.106, , F.A.C.]

Chapter 62-204. F.A.C.

17. Asbestos. This permit does not authorize any demolition or renovation of the facility or its parts or components which involves asbestos removal. This permit does not constitute a waiver of any of the requirements of Chapter 62-257, F.A.C., and 40 CFR Part 61, Subpart M, National Emission Standard for Asbestos, adopted and incorporated by reference in Rule 62-204.800, F.A.C. Compliance with Chapter 62-257, F.A.C., and 40 CFR 61, Subpart M, Section 61.145, is required for any asbestos demolition or renovation at the source.

[40 CFR 61; Rule 62-204.800, F.A.C.; and, Chapter 62-257, F.A.C.]

Chapter 62-210. F.A.C.

18. Permits Required. The owner or operator of any emissions unit which emits or can reasonably be expected to emit any air pollutant shall obtain an appropriate permit from the Department prior to beginning construction, modification, or initial or continued operation of the emissions unit unless exempted pursuant to Department rule or statute. All emissions limitations, controls, and other requirements imposed by such permits shall be at least as stringent as any applicable limitations and requirements contained in or enforceable under the State Implementation Plan (SIP) or that are otherwise federally enforceable. Except as provided at Rule 62-213.460, F.A.C., issuance of a permit does not relieve the owner or operator of an emissions unit from complying with any applicable requirements, any emission limiting standards or other requirements of the air pollution rules of the Department or any other such requirements under federal, state, or local law.

(1) Air Construction Permits.

(a) Unless exempt from permitting pursuant to Rule 62-210.300(3)(a) or (b), F.A.C., or Rule 62-4.040, F.A.C., an air construction permit shall be obtained by the owner or operator of any proposed new or modified facility or emissions unit prior to the beginning of construction or modification, in accordance with all applicable provisions of this chapter, Chapter 62-212, F.A.C., and Chapter 62-4, F.A.C. Except as provided under Rule 62-213.415, F.A.C., the owner or operator of any facility seeking to create or change an air emissions bubble shall obtain an air construction permit in accordance with all the applicable provisions of this chapter, Chapter 62-212, F.A.C., and Chapter 62-4, F.A.C. The construction permit shall be issued for a period of time sufficient to allow construction or modification of the facility or emissions unit and operation while the new or modified facility or emissions unit is conducting tests or otherwise demonstrating initial compliance with the conditions of the construction permit.

(b) Notwithstanding the expiration of an air construction permit, all limitations and requirements of such permit that are applicable to the design and operation of the permitted facility or emissions unit shall remain in effect until the facility or emissions unit is permanently shut down, except for any such limitation or requirement that is obsolete by its nature (such as a requirement for initial compliance testing) or any such limitation or requirement that is changed in accordance with the provisions of Rule 62-210.300(1)(b)1., F.A.C. Either the applicant or the Department can propose that certain conditions be considered obsolete. Any conditions or language in an air construction permit that are included for informational purposes only, if they are transferred to the air operation permit, shall be transferred for informational purposes only and shall not become enforceable conditions unless voluntarily agreed to by the permittee or otherwise required under Department rules.

1. Except for those limitations or requirements that are obsolete, all limitations and requirements of an air construction permit shall be included and identified in any air operation permit for the facility or emissions unit. The limitations and requirements included in the air operation permit can be changed, and thereby superseded, through the issuance of an air construction permit, federally enforceable state air operation permit, federally enforceable air general permit, or Title V air operation permit; provided, however, that:

a. Any change that would constitute an administrative correction may be made pursuant to Rule 62-210.360, F.A.C.;

b. Any change that would constitute a modification, as defined at Rule 62-210.200, F.A.C., shall be accomplished only through the issuance of an air construction permit; and

c. Any change in a permit limitation or requirement that originates from a permit issued pursuant to 40 CFR 52.21, Rule 62-204.800(10)(d)2., F.A.C., Rule 62-212.400, F.A.C., Rule 62-212.500, F.A.C., or any former codification of Rule 62-212.400 or 62-212.500, F.A.C., shall be accomplished only through the issuance of a new or revised air construction permit under Rule 62-204.800(10)(d)2., F.A.C., 62-212.400 or 62-212.500, F.A.C., as appropriate.

2. The force and effect of any change in a permit limitation or requirement made in accordance with the provisions of Rule 62-210.300(1)(b)1. F.A.C., shall be the same as if such change were made to the original air construction permit.

3. Nothing in Rule 62-210.300(1)(b), F.A.C., shall be construed as to allow operation of a facility or emissions unit without a valid air operation permit.

(2) Air Operation Permits. Upon expiration of the air operation permit for any existing facility or emissions unit, subsequent to construction or modification and demonstration of initial compliance with the conditions of the construction permit for any new or modified facility or emissions unit, or as otherwise provided in Chapter 62-210 or Chapter 62-213, the owner or operator of such facility or emissions unit shall obtain a renewal air operation permit, an initial air operation permit, or an administrative correction or revision of an existing air operation permit, whichever is appropriate, in accordance with all applicable provisions of Chapter 62-210, Chapter 62-213, and Chapter 62-4, F.A.C.

(a) Minimum Requirements for All Air Operation Permits. At a minimum, a permit issued pursuant to this subsection shall:

1. Specify the manner, nature, volume and frequency of the emissions permitted, and the applicable emission limiting standards or performance standards, if any;

2. Require proper operation and maintenance of any pollution control equipment by qualified personnel, where applicable in accordance with the provisions of any operation and maintenance plan required by the air pollution rules of the Department.

3. Contain an effective date stated in the permit which shall not be earlier than the date final action is taken on the application and be issued for a period, beginning on the effective date, as provided below.
- a. The operation permit for an emissions unit which is in compliance with all applicable rules and in operational condition, and which the owner or operator intends to continue operating, shall be issued or renewed for a five-year period, except that, for Title V sources subject to Rule 62-213.420(1)(a)1., F.A.C., operation permits shall be extended until 60 days after the due date for submittal of the facility's Title V permit application as specified in Rule 62-213.420(1)(a)1., F.A.C.
 - b. Except as provided in Rule 62-210.300(2)(a)3.d., F.A.C., the operation permit for an emissions unit which has been shut down for six months or more prior to the expiration date of the current operation permit, shall be renewed for a period not to exceed five years from the date of shutdown, even if the emissions unit is not maintained in operational condition, provided:
 - (i) the owner or operator of the emissions unit demonstrates to the Department that the emissions unit may need to be reactivated and used, or that it is the owner's or operator's intent to apply to the Department for a permit to construct a new emissions unit at the facility before the end of the extension period; and,
 - (ii) the owner or operator of the emissions unit agrees to and is legally prohibited from providing the allowable emission permitted by the renewed permit as an emissions offset to any other person under Rule 62-212.500, F.A.C.; and,
 - (iii) the emissions unit was operating in compliance with all applicable rules as of the time the source was shut down.
 - c. Except as provided in Rule 62-210.300(2)(a)3.d., F.A.C., the operation permit for an emissions unit which has been shut down for five years or more prior to the expiration date of the current operation permit shall be renewed for a maximum period not to exceed ten years from the date of shutdown, even if the emissions unit is not maintained in operational condition, provided the conditions given in Rule 62-210.300(2)(a)3.b., F.A.C., are met and the owner or operator demonstrates to the Department that failure to renew the permit would constitute a hardship, which may include economic hardship.
 - d. The operation permit for an electric utility generating unit on cold standby or long-term reserve shutdown shall be renewed for a five-year period, and additional five-year periods, even if the unit is not maintained in operational condition, provided the conditions given in Rules 62-210.300(2)(a)3.b.(i) through (iii), F.A.C., are met.
4. In the case of an emissions unit permitted pursuant to Rules 62-210.300(2)(a)3.b., c., and d., F.A.C., include reasonable notification and compliance testing requirements for reactivation of such emissions unit and provide that the owner or operator demonstrate to the Department prior to reactivation that such reactivation would not constitute reconstruction pursuant to Rule 62-204.800(7), F.A.C.

[Rules 62-210.300(1) & (2), F.A.C.]

19. **Not federally enforceable.** Notification of Startup. The owner or operator of any emissions unit or facility which has a valid air operation permit and which has been shut down more than one (1) year, shall notify the Department in writing of the intent to start up such emissions unit or facility, a minimum of sixty (60) days prior to the intended startup date.

- (a) The notification shall include the planned startup date, anticipated emission rates or pollutants released, changes to processes or control devices which will result in changes to emission rates, and any other conditions which may differ from the valid outstanding operation permit.
- (b) If, due to an emergency, a startup date is not known 60 days prior thereto, the owner shall notify the Department as soon as possible after the date of such startup is ascertained.

[Rule 62-210.300(5), F.A.C.]

20. Emissions Unit Reclassification.

(a) Any emissions unit whose operation permit has been revoked as provided for in Chapter 62-4, F.A.C., shall be deemed permanently shut down for purposes of Rule 62-212.500, F.A.C. Any emissions unit whose permit to operate has expired without timely renewal or transfer may be deemed permanently shut down, provided, however, that no such emissions unit shall be deemed permanently shut down if, within 20 days after receipt of written notice from the Department, the emissions unit owner or operator demonstrates that the permit expiration resulted from inadvertent failure to comply with the requirements of Rule 62-4.090, F.A.C., and that the owner or operator intends to continue the emissions unit in operation, and either submits an application for an air operation permit or complies with permit transfer requirements, if applicable.

(b) If the owner or operator of an emissions unit which is so permanently shut down, applies to the Department for a permit to reactivate or operate such emissions unit, the emissions unit will be reviewed and permitted as a new emissions unit.

[Rule 62-210.300(6), F.A.C.]

21. Public Notice and Comment.

(1) Public Notice of Proposed Agency Action.

(a) A notice of proposed agency action on permit application, where the proposed agency action is to issue the permit, shall be published by any applicant for:

1. An air construction permit;
2. An air operation permit, permit renewal or permit revision subject to Rule 62-210.300(2)(b), F.A.C., (i.e., a FESOP), except as provided in Rule 62-210.300(2)(b)1.b., F.A.C.; or
3. An air operation permit, permit renewal, or permit revision subject to Chapter 62-213, F.A.C., except those permit revisions meeting the requirements of Rule 62-213.412(1), F.A.C.

(b) The notice required by Rule 62-210.350(1)(a), F.A.C., shall be published in accordance with all otherwise applicable provisions of Rule 62-110.106, F.A.C. A public notice under Rule 62-210.350(1)(a)1., F.A.C., for an air construction permit may be combined with any required public notice under Rule 62-210.350(1)(a)2. or 3., F.A.C., for air operation permits. If such notices are combined, the public notice must comply with the requirements for both notices.

(c) Except as otherwise provided at Rules 62-210.350(2) and (5), F.A.C., each notice of intent to issue an air construction permit shall provide a 14-day period for submittal of public comments.

(2) Additional Public Notice Requirements for Emissions Units Subject to Prevention of Significant Deterioration or Nonattainment - Area Preconstruction Review.

(a) Before taking final agency action on a construction permit application for any proposed new or modified facility or emissions unit subject to the preconstruction review requirements of Rule 62-212.400 or 62-212.500, F.A.C., the Department shall comply with all applicable provisions of Rule 62-110.106, F.A.C., and provide an opportunity for public comment which shall include as a minimum the following:

1. A complete file available for public inspection in at least one location in the district affected which includes the information submitted by the owner or operator, exclusive of confidential records under Section 403.111, F.S., and the Department's analysis of the effect of the proposed construction or modification on ambient air quality, including the Department's preliminary determination of whether the permit should be approved or disapproved;
2. A 30-day period for submittal of public comments; and,
3. A notice, by advertisement in a newspaper of general circulation in the county affected, specifying the nature and location of the proposed facility or emissions unit, whether BACT or LAER has been determined, the degree of PSD increment consumption expected, if applicable, and the location of the information specified in paragraph 1. above; and notifying the public of the opportunity for submitting comments and requesting a public hearing.

(b) The notice provided for in Rule 62-210.350(2)(a)3., F.A.C., shall be prepared by the Department and published by the applicant in accordance with all applicable provisions of Rule 62-110.106, F.A.C., except that the applicant shall cause the notice to be published no later than thirty (30) days prior to final agency action.

(c) A copy of the notice provided for in Rule 62-210.350(2)(a)3., F.A.C., shall also be sent by the Department to the Regional Office of the U. S. Environmental Protection Agency and to all other state and local officials or agencies having cognizance over the location of such new or modified facility or emissions unit, including local air pollution control agencies, chief executives of city or county government, regional land use planning agencies, and any other state, Federal Land Manager, or Indian Governing Body whose lands may be affected by emissions from the new or modified facility or emissions unit.

(d) A copy of the notice provided for in Rule 62-210.350(2)(a)3., F.A.C., shall be displayed in the appropriate district, branch and local program offices.

(e) An opportunity for public hearing shall be provided in accordance with Chapter 120, F.S., and Rule 62-110.106, F.A.C.

(f) Any public comments received shall be made available for public inspection in the location where the information specified in Rule 62-210.350(2)(a)1., F.A.C., is available and shall be considered by the Department in making a final determination to approve or deny the permit.

(g) The final determination shall be made available for public inspection at the same location where the information specified in Rule 62-210.350(2)(a)1., F.A.C., was made available.

(h) For a proposed new or modified emissions unit which would be located within 100 kilometers of any Federal Class I area or whose emissions may affect any Federal Class I area, and which would be subject to the preconstruction review requirements of Rule 62-212.400, F.A.C., or Rule 62-212.500, F.A.C.:

1. The Department shall mail or transmit to the Administrator a copy of the initial application for an air construction permit and notice of every action related to the consideration of the permit application.
2. The Department shall mail or transmit to the Federal Land Manager of each affected Class I area a copy of any written notice of intent to apply for an air construction permit; the initial application for an air construction permit, including all required analyses and demonstrations; any subsequently submitted information related to the application; the preliminary determination and notice of proposed agency action on the permit application; and any petition for an administrative hearing regarding the application or the Department's proposed action. Each such document shall be mailed or transmitted to the Federal Land Manager within fourteen (14) days after its receipt by the Department.

(3) **Additional Public Notice Requirements for Facilities Subject to Operation Permits for Title V Sources.**

(a) Before taking final agency action to issue a new, renewed, or revised air operation permit subject to Chapter 62-213, F.A.C., the Department shall comply with all applicable provisions of Rule 62-110.106, F.A.C., and provide an opportunity for public comment which shall include as a minimum the following:

1. A complete file available for public inspection in at least one location in the district affected which includes the information submitted by the owner or operator, exclusive of confidential records under Section 403.111, F.S.; and,
2. A 30-day period for submittal of public comments.

(b) The notice provided for in Rule 62-210.350(3)(a), F.A.C., shall be prepared by the Department and published by the applicant in accordance with all applicable provisions of Rule 62-110.106, F.A.C., except that the applicant shall cause the notice to be published no later than thirty (30) days prior to final agency action.

(c) The notice shall identify:

1. The facility;
2. The name and address of the office at which processing of the permit occurs;
3. The activity or activities involved in the permit action;
4. The emissions change involved in any permit revision;
5. The name, address, and telephone number of a Department representative from whom interested persons may obtain additional information, including copies of the permit draft, the application, and all relevant supporting materials, including any permit application, compliance plan, permit, monitoring report, and compliance statement required pursuant to Chapter 62-213, F.A.C. (except for information entitled to confidential treatment pursuant to Section 403.111, F.S.), and all other materials available to the Department that are relevant to the permit decision;
6. A brief description of the comment procedures required by Rule 62-210.350(3), F.A.C.;
7. The time and place of any hearing that may be held, including a statement of procedure to request a hearing (unless a hearing has already been scheduled); and,
8. The procedures by which persons may petition the Administrator to object to the issuance of the proposed permit after expiration of the Administrator's 45-day review period.

[Rule 62-210.350, F.A.C.]

22. **Administrative Permit Corrections.**

(1) A facility owner shall notify the Department by letter of minor corrections to information contained in a permit. Such notifications shall include:

- (a) Typographical errors noted in the permit;
- (b) Name, address or phone number change from that in the permit;
- (c) A change requiring more frequent monitoring or reporting by the permittee;
- (d) Changes listed at 40 CFR 72.83(a)(1), (2), (6), (9) and (10), hereby adopted and incorporated by reference, to Title V sources subject to emissions limitations or reductions pursuant to 42 USC ss. 7651-7651o;
- (e) Changes listed at 40 CFR 72.83(a)(11), hereby adopted and incorporated by reference, to Title V sources subject to emissions limitations or reductions pursuant to 42 USC ss. 7651-7651o, provided the notification is accompanied by a copy of any EPA determination concerning the similarity of the change to those listed at Rule 62-210.360(1)(d), F.A.C.; and
- (f) Any other similar minor administrative change at the source.

(2) Upon receipt of any such notification the Department shall within 60 days correct the permit and provide a corrected copy to the owner.

(3) After first notifying the owner, the Department shall correct any permit in which it discovers errors of the types listed at Rule 62-210.360(1)(a) and (b), F.A.C., and provide a corrected copy to the owner.

(4) For Title V source permits, other than general permits, a copy of the corrected permit shall be provided to EPA and any approved local air program in the county where the facility or any part of the facility is located.

(5) The Department shall incorporate requirements resulting from issuance of a new or revised construction permit into an existing Title V source permit, if the construction permit or permit revision incorporates requirements of federally enforceable preconstruction review, and if the applicant requests at the time of application that all of the requirements of Rule 62-213.430(1), F.A.C., be complied with in conjunction with the processing of the construction permit application.

[Rule 62-210.360, F.A.C.]

23. Reports.

(3) Annual Operating Report for Air Pollutant Emitting Facility.

(a) The Annual Operating Report for Air Pollutant Emitting Facility (DEP Form No. 62-210.900(5)) shall be completed each year.

(c) The annual operating report shall be submitted to the appropriate Department District or Department approved local air pollution control program office by March 1 of the following year unless otherwise indicated by permit condition or Department request.

[Rule 62-210.370(3), F.A.C.]

24. Circumvention. No person shall circumvent any air pollution control device, or allow the emission of air pollutants without the applicable air pollution control device operating properly.

[Rule 62-210.650, F.A.C.]

25. Forms and Instructions. The forms used by the Department in the stationary source control program are adopted and incorporated by reference in this section. The forms are listed by rule number, which is also the form number, with the subject, title and effective date. Forms 62-210.900(1),(3),(4) and (5), F.A.C., including instructions, are available from the Department as hard-copy documents or executable files on computer diskettes. Copies of forms (hard-copy or diskette) may be obtained by writing to the Department of Environmental Protection, Division of Air Resources Management, 2600 Blair Stone Road, Tallahassee, Florida 32399-2400. Notwithstanding the requirement of Rule 62-4.050(2), F.A.C., to file application forms in quadruplicate, if an air permit application is submitted using the Department's electronic application form, only one copy of the diskette and signature pages is required to be submitted.

(1) Application for Air Permit - Title V Source, Form and Instructions (Effective 2-11-99).

(a) Acid Rain Part (Phase II), Form and Instructions (Effective 7-1-95).

1. Repowering Extension Plan, Form and Instructions (Effective 7-1-95).

2. New Unit Exemption, Form and Instructions (Effective 7-1-95).

3. Retired Unit Exemption, Form and Instructions (Effective 7-1-95).

4. Phase II NOx Compliance Plan, Form and Instructions (Effective 1-6-98).

5. Phase II NOx Averaging Plan, Form (Effective 1-6-98).

(b) Reserved.

(5) Annual Operating Report for Air Pollutant Emitting Facility, Form and Instructions (Effective 2-11-99).

[Rule 62-210.900, F.A.C.]

Chapter 62-213. F.A.C.

26. Annual Emissions Fee. Each Title V source permitted to operate in Florida must pay between January 15 and March 1 of each year, upon written notice from the Department, an annual emissions fee in accordance with Rule 62-213.205, F.A.C., and the appropriate form and associated instructions.

[Rules 62-213.205 and 62-213.900(1), F.A.C.]

27. Annual Emissions Fee. Failure to pay timely any required annual emissions fee, penalty, or interest constitutes grounds for permit revocation pursuant to Rule 62-4.100, F.A.C.

[Rule 62-213.205(1)(g), F.A.C.]

28. Annual Emissions Fee. Any documentation of actual hours of operation, actual material or heat input, actual production amount, or actual emissions used to calculate the annual emissions fee shall be retained by the owner for a minimum of five (5) years and shall be made available to the Department upon request.

[Rule 62-213.205(1)(j), F.A.C.]

29. Annual Emissions Fee. A completed DEP Form 62-213.900(1), F.A.C., "Major Air Pollution Source Annual Emissions Fee Form", must be submitted by the responsible official with the annual emissions fee.

[Rule 62-213.205(1)(k), F.A.C.]

30. Air Operation Permit Fees. After December 31, 1992, no permit application processing fee, renewal fee, modification fee or amendment fee is required for an operation permit for a Title V source.

[Rule 62-213.205(4), F.A.C.]

31. Permits and Permit Revisions Required. All Title V sources are subject to the permit requirements of Chapter 62-213, F.A.C.

(1) No Title V source may operate except in compliance with Chapter 62-213, F.A.C.

(2) Except as provided in Rule 62-213.410, F.A.C., no source with a permit issued under the provisions of this chapter shall make any changes in its operation without first applying for and receiving a permit revision if the change meets any of the following:

- (a) Constitutes a modification;
- (b) Violates any applicable requirement;
- (c) Exceeds the allowable emissions of any air pollutant from any unit within the source;
- (d) Contravenes any permit term or condition for monitoring, testing, recordkeeping, reporting or of a compliance certification requirement;
- (e) Requires a case-by-case determination of an emission limitation or other standard or a source specific determination of ambient impacts, or a visibility or increment analysis under the provisions of Chapters 62-212 or 62-296, F.A.C.;
- (f) Violates a permit term or condition which the source has assumed for which there is no corresponding underlying applicable requirement to which the source would otherwise be subject;
- (g) Results in the trading of emissions among units within a source except as specifically authorized pursuant to Rule 62-213.415, F.A.C.
- (h) Results in the change of location of any relocatable facility identified as a Title V source pursuant to paragraph (a)-(e), (g) or (h) of the definition of "major source of air pollution" at Rule 62-210.200, F.A.C
- (i) Constitutes a change at an Acid Rain Source under the provisions of 40 CFR 72.81(a)(1),(2),or (3),(b)(1) or (b)(3), hereby incorporated by reference;
- (j) Constitutes a change in a repowering plan, nitrogen oxides averaging plan, or nitrogen oxides compliance deadline extension at an Acid Rain Source.
- (k) Is a request for exemption pursuant to Rule 62-214.340, F.A.C.

[Rule 62-213.400(1) & (2), F.A.C.]

32. Changes Without Permit Revision. Title V sources having a valid permit issued pursuant to Chapter 62-213, F.A.C., may make the following changes without permit revision, provided that sources shall maintain source logs or records to verify periods of operation in each alternative method of operation:

- (1) Permitted sources may change among those alternative methods of operation allowed by the source's permit as provided by the terms of the permit;
- (2) Permitted sources may implement the terms or conditions of a new or revised construction permit if;
 - (a) The application for construction permit complied with the requirements of Rule 62-213.420(3) and (4), F.A.C.;
 - (b) The terms or conditions were subject to federally enforceable preconstruction review pursuant to Chapter 62-212, F.A.C.;and,
 - (c) The new or revised construction permit was issued after the Department and the applicant complied with all the requirements of Rule 62-213.430(1), F.A.C.;
- (3) A permitted source may implement operating changes after the source submits any forms required by any applicable requirement and provides the Department and EPA with at least 7 days written notice prior to implementation. The source and the Department shall attach each notice to the relevant permit;
 - (a) The written notice shall include the date on which the change will occur, and a description of the change within the permitted source, the pollutants emitted and any change in emissions, and any term or condition becoming applicable or no longer applicable as a result of the change;
 - (b) The permit shield described in Rule 62-213.460, F.A.C., shall not apply to such changes;
- (4) Permitted sources may implement changes involving modes of operation only in accordance with Rule 62-213.415, F.A.C.

[Rule 62-213.410, F.A.C.]

33. Immediate Implementation Pending Revision Process.

(1) Those permitted Title V sources making any change that constitutes a modification pursuant to the definition of modification at Rule 62-210.200, F.A.C., but which would not constitute a modification pursuant to 42 USC 7412(a) or to 40 CFR 52.01, 60.2, or 61.15, adopted and incorporated by reference at Rule 62-204.800, F.A.C., may implement such change prior to final issuance of a permit revision in accordance with this section, provided the change:

- (a) Does not violate any applicable requirement;
- (b) Does not contravene any permit term or condition for monitoring, testing, recordkeeping or reporting, or any compliance certification requirement;

- (c) Does not require or change a case-by-case determination of an emission limitation or other standard, or a source-specific determination of ambient impacts, or a visibility or increment analysis under the provisions of Chapter 62-212 or 62-296, F.A.C.;
- (d) Does not seek to establish or change a permit term or condition for which there is no corresponding underlying applicable requirement and that the source has assumed to avoid an applicable requirement to which the source would otherwise be subject including any federally enforceable emissions cap or federally enforceable alternative emissions limit.
- (2) A Title V source may immediately implement such changes after they have been incorporated into the terms and conditions of a new or revised construction permit issued pursuant to Chapter 62-212, F.A.C., and after the source provides to EPA, the Department, each affected state and any approved local air program having geographic jurisdiction over the source, a copy of the source's application for operation permit revision. The Title V source may conform its application for construction permit to include all information required by Rule 62-213.420, F.A.C., in lieu of submitting separate application forms.
- (3) The Department shall process the application for operation permit revision in accordance with the provisions of Chapter 62-213, F.A.C., except that the Department shall issue a draft permit revision or a determination to deny the revision within 60 days of receipt of a complete application for operation permit revision or, if the Title V source has submitted a construction permit application conforming to the requirements of Rule 62-213.420, F.A.C., the Department shall issue a draft permit or a determination to deny the revision at the same time the Department issues its determination on issuance or denial of the construction permit application. The Department shall not take final action until all the requirements of Rule 62-213.430(1)(a), (c), (d), and (e), F.A.C., have been complied with.
- (4) Pending final action on the operation permit revision application, the source shall implement the changes in accordance with the terms and conditions of the source's new or revised construction permit.
- (5) The permit shield described in Rule 62-213.460, F.A.C., shall not apply to such changes until after the Department takes final action to issue the operation permit revision.
- (6) If the Department denies the source's application for operation permit revision, the source shall cease implementation of the proposed changes.
- [Rule 62-213.412, F.A.C.]

34. Permit Applications.

(1) Duty to Apply. For each Title V source, the owner or operator shall submit a timely and complete permit application in compliance with the requirements of Rules 62-213.420, 62-4.050(1) & (2), and 62-210.900, F.A.C.

(a) Timely Application.

3. For purposes of permit renewal, a timely application is one that is submitted in accordance with Rule 62-4.090, F.A.C.

(b) Complete Application.

1. Any applicant for a Title V permit, permit revision or permit renewal must submit an application on DEP Form No. 62-210.900(1), which must include all the information specified by Rule 62-213.420(3), F.A.C., except that an application for permit revision must contain only that information related to the proposed change. The applicant shall include information concerning fugitive emissions and stack emissions in the application. Each application for permit, permit revision or permit renewal shall be certified by a responsible official in accordance with Rule 62-213.420(4), F.A.C.

2. For those applicants submitting initial permit applications pursuant to Rule 62-213.420(1)(a)1., F.A.C., a complete application shall be an application that substantially addresses all the information required by the application form number 62-210.900(1), and such applications shall be deemed complete within sixty days of receipt of a signed and certified application unless the Department notifies the applicant of incompleteness within that time. For all other applicants, the applications shall be deemed complete sixty days after receipt, unless the Department, within sixty days after receipt of a signed application for permit, permit revision or permit renewal, requests additional documentation or information needed to process the application. An applicant making timely and complete application for permit, or timely application for permit renewal as described by Rule 62-4.090(1), F.A.C., shall continue to operate the source under the authority and provisions of any existing valid permit or Florida Electrical Power Plant Siting Certification, provided the applicant complies with all the provisions of Rules 62-213.420(1)(b)3. and 4. F.A.C. Failure of the Department to request additional information within sixty days of receipt of a properly signed application shall not impair the Department's ability to request additional information pursuant to Rules 62-213.420(1)(b)3. and 4., F.A.C.

3. For those permit applications submitted pursuant to the provisions of Rule 62-213.420(1)(a)1., F.A.C., the Department shall notify the applicant if the Department becomes aware at any time during processing of the application that the application contains incorrect or incomplete information. The applicant shall submit the corrected or supplementary information to the Department within ninety days unless the applicant has requested and been granted additional time to submit the information. Failure of an applicant to submit corrected or supplementary information requested by the Department within ninety days or such additional time as requested and granted shall render the application incomplete.

4. For all applications other than those addressed at Rule 62-213.420(1)(b)3., F.A.C., should the Department become aware, during processing of any application that the application contains incorrect information, or should the Department become aware, as a result of comment from an affected State, an approved local air program, EPA, or the public that additional information is needed to evaluate the application, the Department shall notify the applicant within 30 days. When an applicant becomes aware that an application contains incorrect or incomplete information, the applicant shall submit the corrected or supplementary information to the Department. If the Department notifies an applicant that corrected or supplementary information is necessary to process the permit, and requests a response, the applicant shall provide the information to the Department within ninety days of the Department request unless the applicant has requested and been granted additional time to submit the information or, the applicant shall, within ninety days, submit a written request that the Department process the application without the information. Failure of an applicant to submit corrected or supplementary information requested by the Department within ninety days, or such additional time as requested and granted, or to demand in writing within ninety days that the application be processed without the information shall render the application incomplete. Nothing in this section shall limit any other remedies available to the Department.

[Rules 62-213.420(1)(a)3. and 62-213.420(1)(b)1., 2., 3. & 4., F.A.C.]

35. Confidential Information. Whenever an applicant submits information under a claim of confidentiality pursuant to Section 403.111, F.S., the applicant shall also submit a copy of all such information and claim directly to EPA. (also, see Condition No. 50.)

[Rule 62-213.420(2), F.A.C.]

36. Standard Application Form and Required Information. Applications shall be submitted under Chapter 62-213, F.A.C., on forms provided by the Department and adopted by reference in Rule 62-210.900(1), F.A.C. The information as described in Rule 62-210.900(1), F.A.C., shall be included for the Title V source and each emissions unit. An application must include information sufficient to determine all applicable requirements for the Title V source and each emissions unit and to evaluate a fee amount pursuant to Rule 62-213.205, F.A.C.

[Rule 62-213.420(3), F.A.C.]

37. Certification by Responsible Official (RO). In addition to the professional engineering certification required for applications by Rule 62-4.050(3), F.A.C., any application form, report, compliance statement, compliance plan and compliance schedule submitted pursuant to Chapter 62-213, F.A.C., shall contain a certification signed by a responsible official that, based on information and belief formed after reasonable inquiry, the statements and information in the document are true, accurate, and complete.

[Rule 62-213.420(4), F.A.C.]

38. a. Permit Renewal and Expiration. Permits being renewed are subject to the same requirements that apply to permit issuance at the time of application for renewal. Permit renewal applications shall contain that information identified in Rules 62-210.900(1) and 62-213.420(3), F.A.C. Unless a Title V source submits a timely application for permit renewal in accordance with the requirements of Rule 62-4.090(1), F.A.C., the existing permit shall expire and the source's right to operate shall terminate.

b. Permit Revision Procedures. Permit revisions shall meet all requirements of Chapter 62-213, F.A.C., including those for content of applications, public participation, review by approved local programs and affected states, and review by EPA, as they apply to permit issuance and renewal, except that permit revisions for those activities implemented pursuant to Rule 62-213.412, F.A.C., need not meet the requirements of Rule 62-213.430(1)(b), F.A.C. The Department shall require permit revision in accordance with the provisions of Rule 62-4.080, F.A.C., and 40 CFR 70.7(f), whenever any source becomes subject to any condition listed at 40 CFR 70.7(f)(1), hereby adopted and incorporated by reference. The below requirements from 40 CFR 70.7(f) are adopted and incorporated by reference in Rule 62-213.430(4), F.A.C.:

o 40 CFR 70.7(f): Reopening for Cause. (also, see Condition No. 4)

(1) This section contains provisions from 40 CFR 70.7(f) that specify the conditions under which a Title V permit shall be reopened prior to the expiration of the permit. A Title V permit shall be reopened and revised under any of the following circumstances:

- (i) Additional applicable requirements under the Act become applicable to a major Part 70 source with a remaining permit term of 3 or more years. Such a reopening shall be completed not later than 18 months after promulgation of the applicable requirement. No such reopening is required if the effective date of the requirement is later than the date on which the permit is due to expire, unless the original permit or any of its terms and conditions has been extended pursuant to 40 CFR 70.4(b)(10)(i) or (ii).
 - (ii) Additional requirements (including excess emissions requirements) become applicable to an affected source under the acid rain program. Upon approved by the Administrator, excess emissions offset plans shall be deemed to be incorporated into the permit.
 - (iii) The permitting authority or EPA determines that the permit contains a material mistake or that inaccurate statements were made in establishing the emissions standards or other terms or conditions of the permit.
 - (iv) The Administrator or the permitting authority determines that the permit must be revised or revoked to assure compliance with the applicable requirements.
- (2) Proceedings to reopen and issue a permit shall follow the same procedures as apply to initial permit issuance and shall affect only those parts of the permit for which cause to reopen exists. Such reopening shall be made as expeditiously as practicable.
- (3) Reopenings under 40 CFR 70.7(f)(1) shall not be initiated before a notice of such intent is provided to the Part 70 source by the permitting authority at least 30 days in advance of the date that the permit is to be reopened, except that the permitting authority may provide a shorter time period in the case of an emergency.

[Rules 62-213.430(3) & (4), F.A.C.; and, 40 CFR 70.7(f)]

39. Insignificant Emissions Units or Pollutant-Emitting Activities.

(a) All requests for determination of insignificant emissions units or activities made pursuant to Rule 62-213.420(3)(m), F.A.C., shall be processed in conjunction with the permit, permit renewal or permit revision application submitted pursuant to Chapter 62-213, F.A.C. Insignificant emissions units or activities shall be approved by the Department consistent with the provisions of Rule 62-4.040(1)(b), F.A.C. Emissions units or activities which are added to a Title V source after issuance of a permit under Chapter 62-213, F.A.C., shall be incorporated into the permit at its next renewal, provided such emissions units or activities have been exempted from the requirement to obtain an air construction permit and also qualify as insignificant pursuant to Rule 62-213.430(6), F.A.C.

(b) An emissions unit or activity shall be considered insignificant if:

1. Such unit or activity would be subject to no unit-specific applicable requirement;
2. Such unit or activity, in combination with other units or activities proposed as insignificant, would not cause the facility to exceed any major source threshold(s) as defined in Rule 62-213.420(3)(c)1., F.A.C., unless it is acknowledged in the permit application that such units or activities would cause the facility to exceed such threshold(s); and
3. Such unit or activity would not emit or have the potential to emit:
 - a. 500 pounds per year or more of lead and lead compounds expressed as lead;
 - b. 1,000 pounds per year or more of any hazardous air pollutant;
 - c. 2,500 pounds per year or more of total hazardous air pollutants; or
 - d. 5.0 tons per year or more of any other regulated pollutant.

[Rule 62-213.430(6), F.A.C.]

40. Permit Duration. Operation permits for Title V sources may not be extended as provided in Rule 62-4.080(3), F.A.C., if such extension will result in a permit term greater than five (5) years.

[Rule 62-213.440(1)(a), F.A.C.]

41. Monitoring Information. All records of monitoring information shall specify the date, place, and time of sampling or measurement and the operating conditions at the time of sampling or measurement, the date(s) analyses were performed, the company or entity that performed the analyses, the analytical techniques or methods used, and the results of such analyses.
[Rule 62-213.440(1)(b)2.a., F.A.C.]
42. Retention of Records. Retention of records of all monitoring data and support information shall be for a period of at least 5 years from the date of the monitoring sample, measurement, report, or application. Support information includes all calibration and maintenance records and all original strip-chart recordings for continuous monitoring instrumentation, and copies of all reports required by the permit.
[Rule 62-213.440(1)(b)2.b., F.A.C.]
43. Monitoring Reports. The permittee shall submit reports of any required monitoring at least every six (6) months. All instances of deviations from permit requirements must be clearly identified in such reports.
[Rule 62-213.440(1)(b)3.a., F.A.C.]
44. Deviation from Permit Requirements Reports. The permittee shall report in accordance with the requirements of Rules 62-210.700(6) and 62-4.130, F.A.C., any deviations from permit requirements, including those attributable to upset conditions as defined in the permit. Reports shall include the probable cause of such deviations, and any corrective actions or preventive measures taken.
[Rule 62-213.440(1)(b)3.b., F.A.C.]
45. Reports. All reports shall be accompanied by a certification by a responsible official, pursuant to Rule 62-213.420(4), F.A.C.
[Rule 62-213.440(1)(b)3.c., F.A.C.]
46. If any portion of the final permit is invalidated, the remainder of the permit shall remain in effect.
[Rule 62-213.440(1)(d)1., F.A.C.]
47. It shall not be a defense for a permittee in an enforcement action that maintaining compliance with any permit condition would necessitate halting of or reduction of the source activity.
[Rule 62-213.440(1)(d)3., F.A.C.]
48. A Title V source shall comply with all the terms and conditions of the existing permit until the Department has taken final action on any permit renewal or any requested permit revision, except as provided at Rule 62-213.412(2), F.A.C.
[Rule 62-213.440(1)(d)4., F.A.C.]
49. A situation arising from sudden and unforeseeable events beyond the control of the source which causes an exceedance of a technology-based emissions limitation because of unavoidable increases in emissions attributable to the situation and which requires immediate corrective action to restore normal operation, shall be an affirmative defense to an enforcement action in accordance with the provisions and requirements of 40 CFR 70.6(g)(2) and (3), hereby adopted and incorporated by reference.
[Rule 62-213.440(1)(d)5., F.A.C.]
50. Confidentiality Claims. Any permittee may claim confidentiality of any data or other information by complying with Rule 62-213.420(2), F.A.C. (also, see Condition No. 35.)
[Rule 62-213.440(1)(d)6., F.A.C.]

51. Statement of Compliance. The permittee shall submit a statement of compliance with all terms and conditions of the permit. Such statements shall be submitted to the Department and EPA annually, or more frequently if specified by Rule 62-213.440(2), F.A.C., or by any other applicable requirement. Such statements shall be accompanied by a certification in accordance with Rule 62-213.420(4), F.A.C. The statement of compliance shall include all the provisions of 40 CFR 70.6(c)(5)(iii), incorporated by reference at Rule 62-204.800, F.A.C.

o 40 CFR 70.6(c)(5)(iii). The compliance certification shall include all of the following (provided that the identification of applicable information may cross-reference the permit or previous reports, as applicable):

- (A) The identification of each term or condition of the permit that is the basis of the certification;
- (B) The identification of the method(s) or other means used by the owner or operator for determining the compliance status with each term and condition during the certification period, and whether such methods or other means provide continuous or intermittent data. Such methods and other means shall include, at a minimum, the methods and means required under 40 CFR 70.6(a)(3). If necessary, the owner or operator also shall identify any other material information that must be included in the certification to comply with section 113(c)(2) of the Act, which prohibits knowingly making a false certification or omitting material information;
- (C) The status of compliance with the terms and conditions of the permit for the period covered by the certification, based on the method or means designated in paragraph (c)(5)(iii)(B) of this section. The certification shall identify each deviation and take it into account in the compliance certification. The certification shall also identify as possible exceptions to compliance any periods during which compliance is required and in which an excursion or exceedance as defined under part 64 of this chapter occurred; and
- (D) Such other facts as the permitting authority may require to determine the compliance status of the source.

The statement shall be accompanied by a certification by a responsible official, in accordance with Rule 62-213.420(4), F.A.C. The responsible official may treat compliance with all other applicable requirements as a surrogate for compliance with Rule 62-296.320(2), Objectionable Odor Prohibited.

[Rule 62-213.440(3), F.A.C.]

52. Permit Shield. Except as provided in Chapter 62-213, F.A.C., compliance with the terms and conditions of a permit issued pursuant to Chapter 62-213, F.A.C., shall be deemed compliance with any applicable requirements in effect as of the date of permit issuance, provided that the source included such applicable requirements in the permit application. Nothing in Rule 62-213.460, F.A.C., or in any permit shall alter or affect the ability of EPA or the Department to deal with an emergency, the liability of an owner or operator of a source for any violation of applicable requirements prior to or at the time of permit issuance, or the requirements of the Federal Acid Rain Program.

{Permitting note: The permit shield is not in effect until the effective date of the permit.}

[Rule 62-213.460, F.A.C.]

53. Forms and Instructions. The forms used by the Department in the Title V source operation program are adopted and incorporated by reference in Rule 62-213.900, F.A.C. The form is listed by rule number, which is also the form number, and with the subject, title, and effective date. Copies of forms may be obtained by writing to the Department of Environmental Protection, Division of Air Resources Management, 2600 Blair Stone Road, Tallahassee, Florida 32399-2400, or by contacting the appropriate permitting authority.

(1) Major Air Pollution Source Annual Emissions Fee (AEF) Form.

[Rule 62-213.900(1), F.A.C.]

Chapter 62-256. F.A.C.

54. Not federally enforceable. Open Burning. This permit does not authorize any open burning nor does it constitute any waiver of the requirements of Chapter 62-256, F.A.C. Source shall comply with Chapter 62-256, F.A.C., for any open burning at the source.

[Chapter 62-256, F.A.C.]

Chapter 62-281. F.A.C.

55. Refrigerant Requirements. Any facility having refrigeration equipment, including air conditioning equipment, which uses a Class I or II substance (listed at 40 CFR 82, Subpart A, Appendices A and B), and any facility which maintains, services, or repairs motor vehicles using a Class I or Class II substance as refrigerant must comply with all requirements of 40 CFR 82, Subparts B and F, and with Rule 62-281.100, F.A.C. Those requirements include the following restrictions:

(1) Any facility having any refrigeration equipment normally containing 50 (fifty) pounds of refrigerant, or more, must keep servicing records documenting the date and type of all service and the quantity of any refrigerant added pursuant to 40 CFR 82.166;

- (2) No person repairing or servicing a motor vehicle may perform any service on a motor vehicle air conditioner (MVAC) involving the refrigerant for such air conditioner unless the person has been properly trained and certified as provided at 40 CFR 82.34 and 40 CFR 82.40, and properly uses equipment approved pursuant to 40 CFR 82.36 and 40 CFR 82.38, and complies with 40 CFR 82.42;
- (3) No person may sell or distribute, or offer for sale or distribution, any substance listed as a Class I or Class II substance at 40 CFR 82, Subpart A, Appendices A and B, except in compliance with Rule 62-281.100, F.A.C., and 40 CFR 82.34(b), 40 CFR 82.42, and/or 40 CFR 82.166;
- (4) No person maintaining, servicing, repairing, or disposing of appliances may knowingly vent or otherwise release into the atmosphere any Class I or Class II substance used as a refrigerant in such equipment and no other person may open appliances (except MVACs as defined at 40 CFR 82.152) for service, maintenance or repair unless the person has been properly trained and certified pursuant to 40 CFR 82.161 and unless the person uses equipment certified for that type of appliance pursuant to 40 CFR 82.158 and unless the person observes the practices set forth at 40 CFR 82.156 and 40 CFR 82.166;
- (5) No person may dispose of appliances (except small appliances, as defined at 40 CFR 82.152) without using equipment certified for that type of appliance pursuant to 40 CFR 82.158 and without observing the practices set forth at 40 CFR 82.156 and 40 CFR 82.166;
- (6) No person may recover refrigerant from small appliances, MVACs and MVAC-like appliances (as defined at 40 CFR 82.152), except in compliance with the requirements of 40 CFR 82, Subpart F.
[40 CFR 82; and, Chapter 62-281, F.A.C. (Chapter 62-281, F.A.C., is not federally enforceable)]

Chapter 62-296, F.A.C.

56. Industrial, Commercial, and Municipal Open Burning Prohibited. Open burning in connection with industrial, commercial, or municipal operations is prohibited, except when:

- (a) Open burning is determined by the Department to be the only feasible method of operation and is authorized by an air permit issued pursuant to Chapter 62-210 or 62-213, F.A.C.; or
- (b) An emergency exists which requires immediate action to protect human health and safety; or
- (c) A county or municipality would use a portable air curtain incinerator to burn yard trash generated by a hurricane, tornado, fire or other disaster and the air curtain incinerator would otherwise be operated in accordance with the permitting exemption criteria of Rule 62-210.300(3), F.A.C.

[Rule 62-296.320(3), F.A.C.]

57. Unconfined Emissions of Particulate Matter.

(4)(c)1. No person shall cause, let, permit, suffer or allow the emissions of unconfined particulate matter from any emissions unit whatsoever, including, but not limited to, vehicular movement, transportation of materials, construction, alteration, demolition or wrecking, or industrially related activities such as loading, unloading, storing or handling, without taking reasonable precautions to prevent such emission.

3. Reasonable precautions may include, but shall not be limited to the following:

- a. Paving and maintenance of roads, parking areas and yards.
- b. Application of water or chemicals to control emissions from such activities as demolition of buildings, grading roads, construction, and land clearing.
- c. Application of asphalt, water, oil, chemicals or other dust suppressants to unpaved roads, yards, open stock piles and similar emissions units.
- d. Removal of particulate matter from roads and other paved areas under the control of the owner or operator of the emissions unit to prevent reentrainment, and from buildings or work areas to prevent particulate from becoming airborne.
- e. Landscaping or planting of vegetation.
- f. Use of hoods, fans, filters, and similar equipment to contain, capture and/or vent particulate matter.
- g. Confining abrasive blasting where possible.
- h. Enclosure or covering of conveyor systems.

4. In determining what constitutes reasonable precautions for a particular facility, the Department shall consider the cost of the control technique or work practice, the environmental impacts of the technique or practice, and the degree of reduction of emissions expected from a particular technique or practice.

[Rules 62-296.320(4)(c)1., 3., & 4. F.A.C.]

[electronic file name: tv-3.doc]

APPENDIX SS-1, STACK SAMPLING FACILITIES (version dated 10/07/96)

Stack Sampling Facilities Provided by the Owner of an Emissions Unit. This section describes the minimum requirements for stack sampling facilities that are necessary to sample point emissions units. Sampling facilities include sampling ports, work platforms, access to work platforms, electrical power, and sampling equipment support. Emissions units must provide these facilities at their expense. All stack sampling facilities must meet any Occupational Safety and Health Administration (OSHA) Safety and Health Standards described in 29 CFR Part 1910, Subparts D and E.

(a) Permanent Test Facilities. The owner or operator of an emissions unit for which a compliance test, other than a visible emissions test, is required on at least an annual basis, shall install and maintain permanent stack sampling facilities.

(b) Temporary Test Facilities. The owner or operator of an emissions unit that is not required to conduct a compliance test on at least an annual basis may use permanent or temporary stack sampling facilities. If the owner chooses to use temporary sampling facilities on an emissions unit, and the Department elects to test the unit, such temporary facilities shall be installed on the emissions unit within 5 days of a request by the Department and remain on the emissions unit until the test is completed.

(c) Sampling Ports.

1. All sampling ports shall have a minimum inside diameter of 3 inches.

2. The ports shall be capable of being sealed when not in use.

3. The sampling ports shall be located in the stack at least 2 stack diameters or equivalent diameters downstream and at least 0.5 stack diameter or equivalent diameter upstream from any fan, bend, constriction or other flow disturbance.

4. For emissions units for which a complete application to construct has been filed prior to December 1, 1980, at least two sampling ports, 90 degrees apart, shall be installed at each sampling location on all circular stacks that have an outside diameter of 15 feet or less. For stacks with a larger diameter, four sampling ports, each 90 degrees apart, shall be installed. For emissions units for which a complete application to construct is filed on or after December 1, 1980, at least two sampling ports, 90 degrees apart, shall be installed at each sampling location on all circular stacks that have an outside diameter of 10 feet or less. For stacks with larger diameters, four sampling ports, each 90 degrees apart, shall be installed. On horizontal circular ducts, the ports shall be located so that the probe can enter the stack vertically, horizontally or at a 45-degree angle.

5. On rectangular ducts, the cross sectional area shall be divided into the number of equal areas in accordance with EPA Method 1. Sampling ports shall be provided which allow access to each sampling point. The ports shall be located so that the probe can be inserted perpendicular to the gas flow.

(d) Work Platforms.

1. Minimum size of the working platform shall be 24 square feet in area. Platforms shall be at least 3 feet wide.

2. On circular stacks with 2 sampling ports, the platform shall extend at least 110 degrees around the stack.

3. On circular stacks with more than two sampling ports, the work platform shall extend 360 degrees around the stack.

4. All platforms shall be equipped with an adequate safety rail (ropes are not acceptable), toeboard, and hinged floor-opening cover if ladder access is used to reach the platform. The safety rail directly in line with the sampling ports shall be removable so that no obstruction exists in an area 14 inches below each sample port and 6 inches on either side of the sampling port.

(e) Access to Work Platform.

APPENDIX SS-1, STACK SAMPLING FACILITIES (version dated 10/07/96)
(continued)

1. Ladders to the work platform exceeding 15 feet in length shall have safety cages or fall arresters with a minimum of 3 compatible safety belts available for use by sampling personnel.

2. Walkways over free-fall areas shall be equipped with safety rails and toeboards.

(f) Electrical Power.

1. A minimum of two 120-volt AC, 20-amp outlets shall be provided at the sampling platform within 20 feet of each sampling port.

2. If extension cords are used to provide the electrical power, they shall be kept on the plant's property and be available immediately upon request by sampling personnel.

(g) Sampling Equipment Support.

1. A three-quarter inch eyebolt and an angle bracket shall be attached directly above each port on vertical stacks and above each row of sampling ports on the sides of horizontal ducts.

a. The bracket shall be a standard 3 inch x 3 inch x one-quarter inch equal-legs bracket which is 1 and one-half inches wide. A hole that is one-half inch in diameter shall be drilled through the exact center of the horizontal portion of the bracket. The horizontal portion of the bracket shall be located 14 inches above the centerline of the sampling port.

b. A three-eighth inch bolt which protrudes 2 inches from the stack may be substituted for the required bracket. The bolt shall be located 15 and one-half inches above the centerline of the sampling port.

c. The three-quarter inch eyebolt shall be capable of supporting a 500 pound working load. For stacks that are less than 12 feet in diameter, the eyebolt shall be located 48 inches above the horizontal portion of the angle bracket. For stacks that are greater than or equal to 12 feet in diameter, the eyebolt shall be located 60 inches above the horizontal portion of the angle bracket. If the eyebolt is more than 120 inches above the platform, a length of chain shall be attached to it to bring the free end of the chain to within safe reach from the platform.

2. A complete monorail or dualrail arrangement may be substituted for the eyebolt and bracket.

3. When the sample ports are located in the top of a horizontal duct, a frame shall be provided above the port to allow the sample probe to be secured during the test.

[Rule 62-297.310(6), F.A.C.]

TABLE 297.310-1
CALIBRATION SCHEDULE

ITEM	MINIMUM CALIBRATION FREQUENCY	REFERENCE INSTRUMENT	TOLERANCE
Liquid in glass thermometer	Annually	ASTM Hg in glass ref. thermometer or equivalent, or thermometric points	+/-2%
Bimetallic thermometer	Quarterly	Calib. liq. in glass thermometer	5 degrees F
Thermocouple	Annually	ASTM Hg in glass ref. thermometer, NBS calibrated reference and potentiometer	5 degrees F
Barometer	Monthly	Hg barometer or NOAA station	+/-1% scale
Pitot Tube	When required or when damaged	By construction or measurements in wind tunnel D greater than 16" and standard pitot tube	See EPA Method 2, Fig. 2-2 & 2-3
Probe Nozzles	Before each test or when nicked, dented, or corroded	Micrometer	+/-0.001" mean of at least three readings Max. deviation between readings .004"
Dry Gas Meter and Orifice Meter	1. Full Scale: When received, When 5% change observed, Annually 2. One Point: Semiannually 3. Check after each test series	Spirometer or calibrated wet test or dry gas test meter	2%
		Comparison check	5%

Phase II Permit Application

For more information, see instructions and refer to 40 CFR 72.30 and 72.31 and Chapter 62-214, F.A.C.

This submission is: New Revised

STEP 1

Identify the source by plant name, State, and ORIS code from NADB

Bartow Plant, FL, 634

Compliance Plan

STEP 2

Enter the boiler ID# from NADB for each affected unit, and indicate whether a repowering plan is being submitted for the unit by entering "yes" or "no" at column c. For new units, enter the requested information in columns d and e

a	b	c	d	e
Boiler ID#	Unit Will Hold Allowances in Accordance with 40 CFR 72.9(c)(1)	Repowering Plan	New Units Commence Operation Date	New Units Monitor Certification Deadline
1	Yes	No		
2	Yes	No		
3	Yes	No		
	Yes			
	Yes			
	Yes			
	Yes			
	Yes			
	Yes			
	Yes			
	Yes			
	Yes			
	Yes			
	Yes			
	Yes			

STEP 3

Check the box if the response in column c of Step 2 is "Yes" for any unit

For each unit that will be repowered, the Repowering Extension Plan form is included and the Repowering Technology Petition form has been submitted or will be submitted by June 1, 1997.

Plant Name (from Step 1)

Bartow Plant

STEP 4
Read the standard requirements and certification, enter the name of the designated representative, and sign and date

Standard Requirements

Permit Requirements.

- (1) The designated representative of each Acid Rain source and each Acid Rain unit at the source shall:
 - (i) Submit a complete Acid Rain part application (including a compliance plan) under 40 CFR part 72, Rules 62-214.320 and 330, F.A.C. in accordance with the deadlines specified in Rule 62-214.320, F.A.C.; and
 - (ii) Submit in a timely manner any supplemental information that the permitting authority determines is necessary in order to review an Acid Rain part application and issue or deny an Acid Rain permit;
- (2) The owners and operators of each Acid Rain source and each Acid Rain unit at the source shall:
 - (i) Operate the unit in compliance with a complete Acid Rain part application or a superseding Acid Rain part issued by the permitting authority; and
 - (ii) Have an Acid Rain Part.

Monitoring Requirements.

- (1) The owners and operators and, to the extent applicable, designated representative of each Acid Rain source and each Acid Rain unit at the source shall comply with the monitoring requirements as provided in 40 CFR part 75, and Rule 62-214.420, F.A.C.
- (2) The emissions measurements recorded and reported in accordance with 40 CFR part 75 shall be used to determine compliance by the unit with the Acid Rain emissions limitations and emissions reduction requirements for sulfur dioxide and nitrogen oxides under the Acid Rain Program.
- (3) The requirements of 40 CFR part 75 shall not affect the responsibility of the owners and operators to monitor emissions of other pollutants or other emissions characteristics at the unit under other applicable requirements of the Act and other provisions of the operating permit for the source.

Sulfur Dioxide Requirements.

- (1) The owners and operators of each source and each Acid Rain unit at the source shall:
 - (i) Hold allowances, as of the allowance transfer deadline, in the unit's compliance subaccount (after deductions under 40 CFR 73.34(c)) not less than the total annual emissions of sulfur dioxide for the previous calendar year from the unit; and
 - (ii) Comply with the applicable Acid Rain emissions limitations for sulfur dioxide.
- (2) Each ton of sulfur dioxide emitted in excess of the Acid Rain emissions limitations for sulfur dioxide shall constitute a separate violation of the Act.
- (3) An Acid Rain unit shall be subject to the requirements under paragraph (1) of the sulfur dioxide requirements as follows:
 - (i) Starting January 1, 2000, an Acid Rain unit under 40 CFR 72.6(a)(2); or
 - (ii) Starting on the later of January 1, 2000 or the deadline for monitor certification under 40 CFR part 75, an Acid Rain unit under 40 CFR 72.6(a)(3).
- (4) Allowances shall be held in, deducted from, or transferred among Allowance Tracking System accounts in accordance with the Acid Rain Program.
- (5) An allowance shall not be deducted in order to comply with the requirements under paragraph (1)(i) of the sulfur dioxide requirements prior to the calendar year for which the allowance was allocated.
- (6) An allowance allocated by the Administrator under the Acid Rain Program is a limited authorization to emit sulfur dioxide in accordance with the Acid Rain Program. No provision of the Acid Rain Program, the Acid Rain permit application, the Acid Rain permit, or the written exemption under 40 CFR 72.7 and 72.8 and no provision of law shall be construed to limit the authority of the United States to terminate or limit such authorization.
- (7) An allowance allocated by the Administrator under the Acid Rain Program does not constitute a property right.

Nitrogen Oxides Requirements. The owners and operators of the source and each Acid Rain unit at the source shall comply with the applicable Acid Rain emissions limitation for nitrogen oxides.

Excess Emissions Requirements.

- (1) The designated representative of an Acid Rain unit that has excess emissions in any calendar year shall submit a proposed offset plan, as required under 40 CFR part 77.
- (2) The owners and operators of an Acid Rain unit that has excess emissions in any calendar year shall:
 - (i) Pay without demand the penalty required, and pay upon demand the interest on that penalty, as required by 40 CFR part 77; and
 - (ii) Comply with the terms of an approved offset plan, as required by 40 CFR part 77.

Recordkeeping and Reporting Requirements.

- (1) Unless otherwise provided, the owners and operators of the source and each Acid Rain unit at the source shall keep on site at the source each of the following documents for a period of 5 years from the date the document is created. This period may be extended for cause, at any time prior to the end of 5 years, in writing by the Administrator or permitting authority:
 - (i) The certificate of representation for the designated representative for the source and each Acid Rain unit at the source and all documents that demonstrate the truth of the statements in the certificate of representation, in accordance with Rule 62-214.350, F.A.C.; provided that the certificate and documents shall be retained on site at the source beyond such 5-year period until such documents are superseded because of the submission of a new certificate of representation changing the designated representative;
 - (ii) All emissions monitoring information, in accordance with 40 CFR part 75;
 - (iii) Copies of all reports, compliance certifications, and other submissions and all records made or required under the Acid Rain Program; and,

Plant Name (from Step 1)
Bartow Plant

Recordkeeping and Reporting Requirements (cont.)

- (iv) Copies of all documents used to complete an Acid Rain part application and any other submission under the Acid Rain Program or to demonstrate compliance with the requirements of the Acid Rain Program.
- (2) The designated representative of an Acid Rain source and each Acid Rain unit at the source shall submit the reports and compliance certifications required under the Acid Rain Program, including those under 40 CFR part 72 subpart I and 40 CFR part 75.

Liability.


- (1) Any person who knowingly violates any requirement or prohibition of the Acid Rain Program, a complete Acid Rain part application, an Acid Rain part, or a written exemption under 40 CFR 72.7 or 72.8, including any requirement for the payment of any penalty owed to the United States, shall be subject to enforcement pursuant to section 113(c) of the Act.
- (2) Any person who knowingly makes a false, material statement in any record, submission, or report under the Acid Rain Program shall be subject to criminal enforcement pursuant to section 113(c) of the Act and 18 U.S.C. 1001.
- (3) No permit revision shall excuse any violation of the requirements of the Acid Rain Program that occurs prior to the date that the revision takes effect.
- (4) Each Acid Rain source and each Acid Rain unit shall meet the requirements of the Acid Rain Program.
- (5) Any provision of the Acid Rain Program that applies to an Acid Rain source (including a provision applicable to the designated representative of an Acid Rain source) shall also apply to the owners and operators of such source and of the Acid Rain units at the source.
- (6) Any provision of the Acid Rain Program that applies to an Acid Rain unit (including a provision applicable to the designated representative of an Acid Rain unit) shall also apply to the owners and operators of such unit. Except as provided under 40 CFR 72.44 (Phase II repowering extension plans), and except with regard to the requirements applicable to units with a common stack under 40 CFR part 75 (including 40 CFR 75.16, 75.17, and 75.18), the owners and operators and the designated representative of one Acid Rain unit shall not be liable for any violation by any other Acid Rain unit of which they are not owners or operators or the designated representative and that is located at a source of which they are not owners or operators or the designated representative.
- (7) Each violation of a provision of 40 CFR parts 72, 73, 75, 77, and 78 by an Acid Rain source or Acid Rain unit, or by an owner or operator or designated representative of such source or unit, shall be a separate violation of the Act.

Effect on Other Authorities. No provision of the Acid Rain Program, an Acid Rain part application, an Acid Rain part, or a written exemption under 40 CFR 72.7 or 72.8 shall be construed as:

- (1) Except as expressly provided in title IV of the Act, exempting or excluding the owners and operators and, to the extent applicable, the designated representative of an Acid Rain source or Acid Rain unit from compliance with any other provision of the Act, including the provisions of title I of the Act relating to applicable National Ambient Air Quality Standards or State Implementation Plans;
- (2) Limiting the number of allowances a unit can hold; *provided*, that the number of allowances held by the unit shall not affect the source's obligation to comply with any other provisions of the Act;
- (3) Requiring a change of any kind in any State law regulating electric utility rates and charges, affecting any State law regarding such State regulation, or limiting such State regulation, including any prudence review requirements under such State law;
- (4) Modifying the Federal Power Act or affecting the authority of the Federal Energy Regulatory Commission under the Federal Power Act; or,
- (5) Interfering with or impairing any program for competitive bidding for power supply in a State in which such program is established.

Certification

I am authorized to make this submission on behalf of the owners and operators of the Acid Rain source or Acid Rain units for which the submission is made. I certify under penalty of law that I have personally examined, and am familiar with, the statements and information submitted in this document and all its attachments. Based on my inquiry of those individuals with primary responsibility for obtaining the information, I certify that the statements and information are to the best of my knowledge and belief true, accurate, and complete. I am aware that there are significant penalties for submitting false statements and information or omitting required statements and information, including the possibility of fine or imprisonment.

Name <i>W. Jeffrey Pardue, C.E.P., Director, Environmental Services Dept.</i>	
Signature 	Date <i>12/14/95</i>

STEP 5 (optional)
Enter the source AIRS
and FINDS identification
numbers, if known.

AIRS
FINDS

our RETURN ADDRESS completed on the reverse side?

SENDER:
 ■ Complete items 1 and/or 2 for additional services.
 ■ Complete items 3, 4a, and 4b.
 ■ Print your name and address on the reverse of this form so that we can return this card to you.
 ■ Attach this form to the front of the mailpiece, or on the back if space does not permit.
 ■ Write "Return Receipt Requested" on the mailpiece below the article number.
 ■ The Return Receipt will show to whom the article was delivered and the date delivered.

I also wish to receive the following services (for an extra fee):
 1. Addressee's Address
 2. Restricted Delivery
 Consult postmaster for fee.

3. Article Addressed to:
 Mr. W. Jeffrey Pardue, C.E.P.
 Director of Environmental Services
 One Power Plaza
 263 13th Avenue South
 BB1A
 St. Petersburg, Florida
 33701-5511

4a. Article Number
 Z 094 212 723

4b. Service Type
 Registered Certified
 Express Mail Insured
 Return Receipt for Merchandise COD

7. Date of Delivery
 11/16/00

8. Addressee's Address (Only if requested and fee is paid)

5. Received By: (Print Name)

6. Signature: (Addressee or Agent)
 x/ Dana Clark

Thank you for using Return Receipt Service.

Return Receipt

Z 094 212 723

US Postal Service
Receipt for Certified Mail
 No Insurance Coverage Provided.
 Do not use for International Mail (See reverse)

Sent to	Mr. W. Jeffrey Pardue
Street & Number	263 13th Avenue South
Post Office, State, & ZIP Code	St. Petersburg, FL 33701-5511
Postage	\$
Certified Fee	
Special Delivery Fee	
Restricted Delivery Fee	
Return Receipt Showing to Whom & Date Delivered	
Return Receipt Showing to Whom, Date, & Addressee's Address	
TOTAL Postage & Fees	\$

Postmark or Date 11/16/00
 FPC - Bartow Plant
 FINAL Permit No.: 1030011-002-AV + 1030011-006-AC

PS Form 3800, April 1995

Z 094 212 718

US Postal Service
Receipt for Certified Mail
 No Insurance Coverage Provided.
 Do not use for International Mail (See reverse)

Sent to	Mr. J. Jeffery Pardue
Street & Number	3201 34th Street South
Post Office, State, & ZIP Code	St. Petersburg, FL 33711
Postage	\$
Certified Fee	
Special Delivery Fee	
Restricted Delivery Fee	
Return Receipt Showing to Whom & Date Delivered	
Return Receipt Showing to Whom, Date, & Addressee's Address	
TOTAL Postage & Fees	\$

Postmark or Date 12/29/99
 FINAL Permit No.: 1030011-002-AV and Permit No.: 1030011-006-AC - Bartow Facility

PS Form 3800, April 1995

Returned on 11/16/00
 address had expired

STATE OF FLORIDA
DEPARTMENT OF ENVIRONMENTAL PROTECTION

In the matter of:)

Florida Electric Power Coordinating Group, Inc.,)

ASP No. 97-B-01

Petitioner.)

ORDER ON REQUEST
FOR
ALTERNATE PROCEDURES AND REQUIREMENTS

Pursuant to Rule 62-297.620, Florida Administrative Code (F.A.C.), the Florida Electric Coordinating Group, Incorporated, (FCG) petitioned for approval to: (1) Exempt fossil fuel steam generators which burn liquid and/or solid fuel for less than 400 hours during the federal fiscal year from the requirement to conduct an annual particulate matter compliance test; and, (2) Exempt fossil fuel steam generators which burn liquid and/or solid fuel for less than 400 hours during the federal fiscal year from the requirement to conduct an annual particulate matter compliance test during the year prior to renewal of an operation permit. This Order is intended to clarify particulate testing requirements for those fossil fuel steam generators which primarily burn gaseous fuels including, but not necessarily limited to natural gas.

Having considered the provisions of Rule 62-296.405(1), F.A.C., Rule 62-297.310(7), F.A.C., and all supporting documentation, the following Findings of Fact, Conclusions of Law, and Order are entered:

FINDINGS OF FACT

1. The Florida Electric Power Coordinating Group, Incorporated, petitioned the Department to exempt those fossil fuel steam generators which have a heat input of more than 250 million Btu per hour and burn solid and/or liquid fuel less than 400 hours during the year from the requirement to conduct an annual particulate matter compliance test. [Exhibit 1]
2. Rule 62-296.405(1)(a), F.A.C., applies to those fossil fuel steam generators that are not subject to the federal standards of performance for new stationary sources (NSPS) in 40 CFR 60 and which have a heat input of more than 250 million Btu per hour.
3. Rule 62-296.405(1)(a), F.A.C., limits visible emissions from affected fossil fuel steam generators to, "20 percent opacity except for either one six-minute period per hour during which

not exceed 40 percent. The option selected shall be specified in the emissions unit's construction and operation permits. Emissions units governed by this visible emission limit shall test for particulate emission compliance annually and as otherwise required by Rule 62-297, F.A.C."

4. Rule 62-296.405(1)(a), F.A.C., further states, "Emissions units electing to test for particulate matter emission compliance quarterly shall be allowed visible emissions of 40 percent opacity. The results of such tests shall be submitted to the Department. Upon demonstration that the particulate standard has been regularly complied with, the Secretary, upon petition by the applicant, shall reduce the frequency of particulate testing to no less than once annually."

5. Rule 297.310(7)(a)1., F.A.C., states, "The owner or operator of a new or modified emissions unit that is subject to an emission limiting standard shall conduct a compliance test that demonstrates compliance with the applicable emission limiting standard prior to obtaining an operation permit for such emissions unit."

6. Rule 297.310(7)(a)3., F.A.C., states, "The owner or operator of an emissions unit that is subject to any emission limiting standard shall conduct a compliance test that demonstrates compliance with the applicable emission limiting standard prior to obtaining a renewed operation permit. Emissions units that are required to conduct an annual compliance test may submit the most recent annual compliance test to satisfy the requirements of this provision."

7. Rule 297.310(7)(a)3., F.A.C., further states, "In renewing an air operation permit pursuant to Rule 62-210.300(2)(a)3.b., c., or d., F.A.C., the Department shall not require submission of emission compliance test results for any emissions unit that, during the year prior to renewal: a. Did not operate; or, b. In the case of a fuel burning emissions unit, burned liquid and/or solid fuel for a total of no more than 400 hours."

8. Rule 297.310(7)(a)4., F.A.C., states, "During each federal fiscal year (October 1 -- September 30), unless otherwise specified by rule, order, or permit, the owner or operator of each emissions unit shall have a formal compliance test conducted for: a. Visible emissions, if there is an applicable standard; b. Each of the following pollutants, if there is an applicable standard, and if the emissions unit emits or has the potential to emit: 5 tons per year or more of lead or lead compounds measured as elemental lead; 30 tons per year or more of acrylonitrile; or 100 tons per year or more of any other regulated air pollutant..."

9. Rule 297.310(7)(a)5., F.A.C., states, "An annual compliance test for particulate matter emissions shall not be required for any fuel burning emissions unit that, in a federal fiscal year, does not burn liquid and/or solid fuel, other than during startup, for a total of more than 400 hours."

10. Rule 297.310(7)(a)6., F.A.C., states, "For fossil fuel steam generators on a semi-annual particulate matter emission compliance testing schedule, a compliance test shall not be

required for any six-month period in which liquid and/or solid fuel is not burned for more than 200 hours other than during startup."

11. Rule 297.310(7)(a)7., F.A.C., states, "For emissions units electing to conduct particulate matter emission compliance testing quarterly pursuant to Rule 62-296.405(2)(a), F.A.C., a compliance test shall not be required for any quarter in which liquid and/or solid fuel is not burned for more than 100 hours other than during startup." [Note: The reference should be to Rule 62-296.405(1)(a), F.A.C., rather than Rule 62-296.405(2)(a), F.A.C.]

12. The fifth edition of the U. S. Environmental Protection Agency's Compilation of Air Pollutant Emission Factors, AP-42, that emissions of filterable particulate from gas-fired fossil fuel steam generators with a heat input of more than about 10 million Btu per hour may be expected to range from 0.001 to 0.006 pound per million Btu. [Exhibit 2]

13. Rule 62-296.405(1)(b), F.A.C. and the federal standards of performance for new stationary sources in 40 CFR 60.42, Subpart D, limit particulate emissions from uncontrolled fossil fuel fired steam generators with a heat input of more than 250 million Btu to 0.1 pound per million Btu.

CONCLUSIONS OF LAW

1. The Department has jurisdiction to consider the matter pursuant to Section 403.061, Florida Statutes (F.S.), and Rule 62-297.620, F.A.C.

2. Pursuant to Rule 62-297.310(7), F.A.C., the Department may require Petitioner to conduct compliance tests that identify the nature and quantity of pollutant emissions, if, after investigation, it is believed that any applicable emission standard or condition of the applicable permits is being violated.

3. There is reason to believe that a fossil fuel steam generator which does not burn liquid and/or solid fuel (other than during startup) for a total of more than 400 hours in a federal fiscal year and complies with all other applicable limits and permit conditions is in compliance with the applicable particulate mass emission limiting standard.

ORDER

Having considered the requirements of Rule 62-296.405, F.A.C., Rule 62-297.310, F.A.C., and supporting documentation, it is hereby ordered that:

1. An annual compliance test for particulate matter emissions shall not be required for any fuel burning emissions unit that, in a federal fiscal year, does not burn liquid and/or solid fuel, other than during startup, for a total of more than 400 hours;

2. For fossil fuel steam generators on a semi-annual particulate matter emission compliance testing schedule, a compliance test shall not be required for any six-month period in which liquid and/or solid fuel is not burned for more than 200 hours other than during startup;

3. For emissions units electing to conduct particulate matter emission compliance testing quarterly pursuant to Rule 62-296.405(1)(a), F.A.C., a compliance test shall not be required for any quarter in which liquid and/or solid fuel is not burned for more than 100 hours other than during startup;

4. In renewing an air operation permit pursuant to Rule 62-210.300(2)(a)3.b., c., or d., F.A.C., the Department shall not require submission of particulate matter emission compliance test results for any fossil fuel steam generator emissions unit that burned liquid and/or solid fuel for a total of no more than 400 hours during the year prior to renewal.

5. Pursuant to Rule 62-297.310(7), F.A.C., owners of affected fossil fuel steam generators may be required to conduct compliance tests that identify the nature and quantity of pollutant emissions, if, after investigation, it is believed that any applicable emission standard or condition of the applicable permits is being violated.

6. Pursuant to Rule 62-297.310(8), F.A.C., owners of affected fossil fuel steam generators shall submit the compliance test report to the District Director of the Department district office having jurisdiction over the emissions unit and, where applicable, the Air Program Administrator of the appropriate Department-approved local air program within 45 days of completion of the test.

PETITION FOR ADMINISTRATIVE REVIEW

The Department will take the action described in this Order unless a timely petition for an administrative hearing is filed pursuant to sections 120.569 and 120.57 of the Florida Statutes, or a party requests mediation as an alternative remedy under section 120.573 before the deadline for filing a petition. Choosing mediation will not adversely affect the right to a hearing if mediation does not result in a settlement. The procedures for petitioning for a hearing are set forth below, followed by the procedures for requesting mediation.

A person whose substantial interests are affected by the Department's proposed decision may petition for an administrative hearing in accordance with sections 120.569 and 120.57 of the Florida Statutes. The petition must contain the information set forth below and must be filed (received) in the Office of General Counsel of the Department at 3900 Commonwealth Boulevard, Mail Station 35, Tallahassee, Florida 32399-3000. Petitions must be filed within 21 days of receipt of this Order. A petitioner must mail a copy of the petition to the applicant at the address indicated above, at the time of filing. The failure of any person to file a petition (or a request for mediation, as discussed below) within the appropriate time period shall constitute a waiver of that person's right to request an administrative determination (hearing) under sections 120.569 and 120.57 of

the Florida Statutes, or to intervene in this proceeding and participate as a party to it. Any subsequent intervention will be only at the approval of the presiding officer upon the filing of a motion in compliance with Rule 28-5.207 of the Florida Administrative Code.

A petition must contain the following information:

(a) The name, address, and telephone number of each petitioner, the applicant's name and address, the Department File Number, and the county in which the project is proposed;

(b) A statement of how and when each petitioner received notice of the Department's action or proposed action;

(c) A statement of how each petitioner's substantial interests are affected by the Department's action or proposed action;

(d) A statement of the material facts disputed by each petitioner, if any;

(e) A statement of facts that the petitioner contends warrant reversal or modification of the Department's action or proposed action;

(f) A statement identifying the rules or statutes each petitioner contends require reversal or modification of the Department's action or proposed action; and,

(g) A statement of the relief sought by each petitioner, stating precisely the action each petitioner wants the Department to take with respect to the Department's action or proposed action in the notice of intent.

Because the administrative hearing process is designed to formulate final agency action, the filing of a petition means that the Department's final action may be different from the position taken by it in this Order. Persons whose substantial interests will be affected by any such final decision of the Department on the application have the right to petition to become a party to the proceeding, in accordance with the requirements set forth above.

A person whose substantial interests are affected by the Department's proposed decision, may elect to pursue mediation by asking all parties to the proceeding to agree to such mediation and by filing with the Department a request for mediation and the written agreement of all such parties to mediate the dispute. The request and agreement must be filed in (received by) the Office of General Counsel of the Department at 3900 Commonwealth Boulevard, Mail Station 35, Tallahassee, Florida 32399-3000, by the same deadline as set forth above for the filing of a petition.

A request for mediation must contain the following information:

(a) The name, address, and telephone number of the person requesting mediation and that person's representative, if any;

(b) A statement of the preliminary agency action;

(c) A statement of the relief sought; and

(d) Either an explanation of how the requester's substantial interests will be affected by the action or proposed action addressed in this notice of intent or a statement clearly identifying the petition for hearing that the requester has already filed, and incorporating it by reference.

The agreement to mediate must include the following:

(a) The names, addresses, and telephone numbers of any persons who may attend the mediation;

(b) The name, address, and telephone number of the mediator selected by the parties, or a provision for selecting a mediator within a specified time;

(c) The agreed allocation of the costs and fees associated with the mediation;

(d) The agreement of the parties on the confidentiality of discussions and documents introduced during mediation;

(e) The date, time, and place of the first mediation session, or a deadline for holding the first session, if no mediator has yet been chosen;

(f) The name of each party's representative who shall have authority to settle or recommend settlement; and

(g) The signatures of all parties or their authorized representatives.

As provided in section 120.573 of the Florida Statutes, the timely agreement of all parties to mediate will toll the time limitations imposed by sections 120.569 and 120.57 for requesting and holding an administrative hearing. Unless otherwise agreed by the parties, the mediation must be concluded within sixty days of the execution of the agreement. If mediation results in settlement of the administrative dispute, the Department must enter a final order incorporating the agreement of the parties. Persons whose substantial interests will be affected by such a modified final decision of the Department have a right to petition for a hearing only in accordance with the requirements for such petitions set forth above. If mediation terminates without settlement of the dispute, the Department shall notify all parties in writing that the administrative hearing processes under sections 120.569 and 120.57 remain available for disposition of the dispute, and the notice will

BEST AVAILABLE COPY

specify the deadlines that then will apply for challenging the agency action and electing remedies under those two statutes.

In addition to the above, a person subject to regulation has a right to apply for a variance from or waiver of the requirements of particular rules, on certain conditions, under section 120.542 of the Florida Statutes. The relief provided by this state statute applies only to state rules, not statutes, and not to any federal regulatory requirements. Applying for a variance or waiver does not substitute or extend the time for filing a petition for an administrative hearing or exercising any other right that a person may have in relation to the action proposed in this notice of intent.

The application for a variance or waiver is made by filing a petition with the Office of General Counsel of the Department, 3900 Commonwealth Boulevard, Mail Station 35, Tallahassee, Florida 32399-3000.

The petition must specify the following information:

- (a) The name, address, and telephone number of the petitioner;
- (b) The name, address, and telephone number of the attorney or qualified representative of the petitioner, if any;
- (c) Each rule or portion of a rule from which a variance or waiver is requested;
- (d) The citation to the statute underlying (implemented by) the rule identified in (c) above;
- (e) The type of action requested;
- (f) The specific facts that would justify a variance or waiver for the petitioner;
- (g) The reason why the variance or waiver would serve the purposes of the underlying statute (implemented by the rule); and
- (h) A statement whether the variance or waiver is permanent or temporary and, if temporary, a statement of the dates showing the duration of the variance or waiver requested.

The Department will grant a variance or waiver, when the petition demonstrates both that the application of the rule would create a substantial hardship or violate principles of fairness, as each of those terms is defined in section 120.542(2) of the Florida Statutes, and that the purpose of the underlying statute will be or has been achieved by other means by the petitioner. Persons subject to regulation pursuant to any federally delegated or approved air program should be aware that Florida is specifically not authorized to issue variances or waivers from any requirements of any such federally delegated or approved program. The requirements of the program remain fully

each of those terms is defined in section 120.542(2) of the Florida Statutes, and that the purpose of the underlying statute will be or has been achieved by other means by the petitioner. Persons subject to regulation pursuant to any federally delegated or approved air program should be aware that Florida is specifically not authorized to issue variances or waivers from any requirements of any such federally delegated or approved program. The requirements of the program remain fully enforceable by the Administrator of the EPA and by any person under the Clean Air Act unless and until the Administrator separately approves any variance or waiver in accordance with the procedures of the federal program.


This Order constitutes final agency action unless a petition is filed in accordance with the above paragraphs. Upon timely filing of a petition, this Order will not be effective until further Order of the Department.

RIGHT TO APPEAL

Any party to this Order has the right to seek judicial review of the Order pursuant to Section 120.68, F.S., by the filing of a Notice of Appeal pursuant to Rule 9.110, Florida Rules of Appellate Procedure, with the Clerk of the Department in the Office of General Counsel, 3900 Commonwealth Boulevard, Mail Station 35, Tallahassee, Florida 32399-3000; and, by filing a copy of the Notice of Appeal accompanied by the applicable filing fees with the appropriate District Court of Appeal. The Notice of Appeal must be filed within 30 days from the date the Notice of Agency Action is filed with the Clerk of the Department.

DONE AND ORDERED this 17 day of March, 1997 in Tallahassee, Florida.

STATE OF FLORIDA DEPARTMENT
OF ENVIRONMENTAL PROTECTION



HOWARD L. RHODES, Director
Division of Air Resources Management
Twin Towers Office Building
2600 Elair Stone Road
Tallahassee, Florida 32399-2400
(904) 488-0114

CERTIFICATE OF SERVICE

The undersigned duly designated deputy clerk hereby certifies that a copy of the foregoing was mailed to Rich Piper, Chair, Florida Power Coordinating Group, Inc., 405 Reo Street, Suite 100, Tampa, Florida 33609-1004, on this 18th day of March 1997.


Clerk Stamp

FILING AND ACKNOWLEDGMENT
FILED, on this date, pursuant to
§120.52(7), Florida Statutes, with the
designated Department Clerk, receipt of
which is hereby acknowledged.

Martha M. Wise 3-18-97
Clerk Date

FLORIDA ELECTRIC POWER COORDINATING GROUP, INC. (FCG)
 2500 S. GOLF STREET, SUITE 100 • (813) 299-5644 • FAX (813) 299-5646
 TAMPA, FLORIDA 33609-1004

January 28, 1997



Clair H. Fancy, P.E.
 Chief, Bureau of Air Regulation
 Florida Department of Environmental Protection
 2600 Blair Stone Road, MS 5505
 Tallahassee, FL 32301

RECEIVED

JAN 28 1997

BUREAU OF
 AIR REGULATION

RE: Comments Regarding Draft Title V Permits

Dear Mr. Fancy:

The Florida Electric Power Coordinating Group, Inc. (FCG), which is made up of 36 utilities owned by investors, municipalities, and cooperatives, has been following the implementation of Title V in Florida and recently submitted comments to you on draft Title V permit conditions by letter dated December 4, 1996. As indicated in that letter, representatives from the FCG would like to meet with you and other members of your air permitting staff to discuss some significant concerns that FCG member companies have regarding conditions that may be included in Title V permits issued by your office. While we will be discussing these issues with you and your staff in greater detail at that meeting, we would like to explain some of our concerns in this letter.

Primarily, the FCG members are concerned that the Title V permits may contain conditions that are much different in important respects than those conditions currently included in existing air permits. During the rulemaking workshops and seminars conducted by the Department to discuss the rules implementing the Title V permitting program, representations were made on several occasions that industry could expect to see permit conditions that were substantively similar to existing permit conditions and that primarily the format was changing. Representations were also made to industry that Title V did not impose additional substantive requirements beyond what was already required under the Department's rules. Based on the first draft Title V permit that we have reviewed, we are concerned that there may be some attempt to change the substantive requirements on existing facilities through the Title V permitting process, and we would like to discuss this with you at the meeting we have scheduled for January 30, 1997.

1. Federal Enforceability--The FCG has long been concerned about the designation of non-federally enforceable permit terms and conditions. We are concerned about this issue because the Department's first draft Title V permits have included language stating that all terms and conditions would become federally enforceable once the permit is issued. This approach is consistent with the Department's guidance memorandum dated September 15, 1996 (DAPM-FER/V-18), but we understand that the Department may now intend to remove all references to

BEST AVAILABLE COPY

Clair H. Fancy, P.E.
Chief, Bureau of Air Regulation
Florida Department of Environmental Protection
January 28, 1997
Page 2

the federal enforceability of permit terms and conditions. We are also concerned about this approach because a Title V permit is generally federally enforceable and, without any designation of non-federally enforceable terms and conditions, the entire permit could be interpreted to be federally enforceable. As we stated in the December 4 letter as well as our letter dated October 11, 1996, all terms and conditions in a Title V permit do *not* become enforceable by the U.S. Environmental Protection Agency and citizens under the Clean Air Act simply by inclusion in a Title V permit. To make it clear which provisions in a Title V permit are not federally enforceable (which are being included because of state or local requirements only), it is very important to specifically designate those conditions as having no federally enforceable basis. Such a designation is actually required under the federal Title V rules, which provide that permitting agencies are to "specifically designate as not being federally enforceable under the Act any terms and conditions included in the permit that are not required under the Act or under any of its applicable requirements." 40 CFR § 70.6(t). We would like to discuss with you our concerns about this issue and to again specifically request that when Title V permits are issued by the Department, conditions having no federally enforceable basis clearly be identified as such.

2. PM Testing on Gas--The FCG understands that the Department may attempt to require annual particulate matter compliance testing while firing natural gas to determine compliance with the 0.1 lb/mmBtu emission limit established under Rule 62-296.405(1)(f), F.A.C. The FCG member companies feel strongly that compliance testing for particulate matter should not be required while firing natural gas. The Department has not historically required particulate matter compliance testing while firing natural gas, it is not required under the current permits for these units, and it should not be necessary since natural gas is such a clean fuel. Typically only *de minimis* amounts of particulate matter would be expected from the firing of natural gas, so compliance testing would not provide meaningful information to the Department, and the expense to conduct such tests is not justified. We understand that Department representatives suggested that industry could pursue an alternative test procedure under Rule 62-297.620, F.A.C., to allow a visible emissions test to be used in lieu of a stack test for determining compliance with the particulate matter limit. While certainly a visible emissions test would be preferable over a stack test, neither of these tests should be needed to demonstrate compliance with the particulate matter limit of 0.1 lb/mmBtu while burning natural gas. The FCG strongly urges that the Department reconsider its position on this issue and clarify that compliance testing for particulate matter while firing natural gas is not required.

3. Excess Emissions--By letter dated December 5, 1996, the U.S. Environmental Protection Agency (EPA) submitted a letter commenting on a draft Title V permit that had been issued by the Department and indicated some concern regarding excess emission provisions included in conditions that were quoted from Rule 62-210.700, F.A.C. Because the permit conditions cited simply quote the applicable provisions of the Department's rules regarding

Clair H. Fancy, P.E.
Chief, Bureau of Air Regulation
Florida Department of Environmental Protection
January 28, 1997
Page 3

excess emissions and because these rules have been approved as part of Florida's State Implementation Plan, the permit conditions are appropriate to be included in the permit. We understand that the Department intends to include as applicable requirements in Title V permit conditions the provisions of Rule 62-210.700, F.A.C. If the Department receives any further adverse comments regarding the excess emissions rule under 62-210.700, F.A.C., we would appreciate your contacting us. Because this issue is so important to us, we would like to discuss it with you in greater detail at our meeting on January 30.

4. Compliance Testing for Combustion Turbines--While the Department's November 22, 1995, guidance regarding the compliance testing requirements for combustion turbines clearly states that the use of heat input curves based on ambient temperatures and humidities is to be included as a permit condition *only* if requested by a permittee, we understand that the Department may intend to include this requirement in Title V permits for all combustion turbines. As we are sure you recall, the FCG worked over a period of several months with the Department on the development of the guidance memorandum and it was clearly understood by FCG members that the heat input curves would not be mandated but would remain voluntary for any existing combustion turbine. It was also understood by FCG members that the requirement to conduct testing at 95 to 100 percent of capacity would be required only if the permit applicant requested the use of heat input curves. We understand that the Department may be interpreting the requirement to use heat input curves and to test at 95 to 100 percent of permitted capacity to be mandatory for all combustion turbines. We would like to clarify this with you during our meeting. Also, we would like to confirm that, regardless of whether a combustion turbine uses heat input curves or tests at 95 to 100 percent of permitted capacity, it is necessary to test at four load points and correct to ISO *only* to determine compliance with the nitrogen oxides (NOx) standard under New Source Performance Standard Subpart GG under 40 CFR § 60.332 and not annually thereafter.

5. Test Methods--The FCG is concerned about the possibility of the Department requiring a full permit revision to authorize the use of an approved test method not specifically identified in a Title V permit, even though the Department may have separately approved the use of the particular test method for a unit (i.e., through a compliance test protocol). It is the FCG's position that language should be included in all Title V permits indicating that other test methods approved by the Department may be used. Further, a full permit revision (including public notice) should *not* be necessary when a test method not previously identified in the permit is approved for use by a unit. The Department's subsequent approval of test methods should simply be included in the next permit renewal cycle. The FCG understands that the Department planned to confirm this approach with the U.S. Environmental Protection Agency Region IV, and we would like to discuss this issue with you at the January 30 meeting to learn of the agency's response.

Clair H. Fancy, P.E.
Chief, Bureau of Air Regulation
Florida Department of Environmental Protection
January 28, 1997
Page 4

6. Quarterly Reports--The FCG understands that the Department may be interpreting the quarterly reporting requirements under Rule 62-296.405(1)(g), F.A.C., to apply regardless of whether continuous emissions monitors were required under the preceding Rule 62-296.405(1)(f), F.A.C. It is the FCG's position that quarterly reports are required under Rule 62-296.405(1)(g) only when continuous emissions monitors are required under the preceding paragraph (f). While this may not be entirely clear from the language of the rules, paragraphs (f) and (g) were originally included in a separate rule on "continuous emission monitoring requirements" where it was very clear that the requirements of paragraph (g) applied *only* if continuous emission monitoring was required under paragraph (f). Research indicates that Rule 17-2.710, F.A.C. (copy attached), where these provisions were originally located, was first transferred to Rule 17-297.500, F.A.C. (which later became Rule 62-297.500), later repealed in November of 1994, and ultimately replaced with what is now Rule 62-296.405(1)(f) and (g), F.A.C. To the extent that an emissions unit is not subject to Rule 62-296.405(1)(f) and is not required to install and operate continuous emissions monitors (e.g., oil- and gas-fired units), the quarterly reporting requirements of paragraph (g) should not apply.

7. Trivial Activities--As you may recall, in May of 1996, the FCG submitted to the Department a list of small, *de minimis* emissions units and activities that it considered to be "trivial," consistent with the list developed by EPA as part of the Title V "White Paper" and incorporated by reference by the Department in its March 15, 1996, guidance memorandum (DAPM-PER/V-15-Revised). We never received a response from the Department and now understand that the Department may not have made a determination as to whether any of the emission units or activities on the list should qualify as "trivial." This is an important issue to the FCG because only "trivial" activities can be omitted from the Title V permit application and permit, and ultimately omitted from emission estimates in the annual air operation reports under Rule 62-310.370(3), F.A.C. The FCG remains hopeful that the Department will consider its request to determine that most, if not all, of the emission units and activities on the May, 1996, list to be "trivial." We would like to discuss a possible resolution of this issue with you and your staff at the January 30 meeting.

8. Permit Shield--The FCG continues to be concerned about the language in Conditions 5 and 20 of Appendix TV-1, Title V Conditions, which circumvents the permit shield provisions under Section 403.0872(15), Florida Statutes, and Rule 62-213.460, F.A.C. The FCG believes that these conditions should be deleted in their entirety. To the extent that the Department attempt to caveat the applicability of those conditions, the FCG believes that it is important to cite to not only the regulatory citation for the permit shield but the statutory citation as well.

Thank you again for considering the FCG's comments on the draft Title V permits. We very much appreciate the cooperation we have received from the Department throughout the

Clair H. Fancy, P.E.
Chief, Bureau of Air Regulation
Florida Department of Environmental Protection
January 28, 1997
Page 5

Title V Implementation process, and we look forward to our meeting later this week. If you have any questions in the meantime, please call me at 561-525-7661.

Sincerely,

Rich Piper

Rich Piper, Chair *hrw*
FCG Air Subcommittee

Enclosures

cc: Howard L. Rhodes, DEP
John Brown, DEP
Pat Comer, DEP OGC
Scott M. Sheplak, DEP
Edward Svec, DEP
FCG Air Subcommittee
Angela Morrison, HGSS

33601

AP-42
FIFTH EDITION
JANUARY 1995

COMPILATION
OF
AIR POLLUTANT
EMISSION FACTORS

VOLUME I:
STATIONARY POINT
AND AREA SOURCES

Office Of Air Quality Planning And Standards
Office Of Air And Radiation
U. S. Environmental Protection Agency
Research Triangle Park, NC 27711

January 1995

Exhibit 2

1.4 Natural Gas Combustion

1.4.1 General¹⁻²

Natural gas is one of the major fuels used throughout the country. It is used mainly for industrial process steam and heat production; for residential and commercial space heating; and for electric power generation. Natural gas consists of a high percentage of methane (generally above 80 percent) and varying amounts of ethane, propane, butane, and inert gases (typically nitrogen, carbon dioxide, and helium). Gas processing plants are required for the recovery of liquefiable constituents and removal of hydrogen sulfide before the gas is used (see Section 5.3, Natural Gas Processing). The average gross heating value of natural gas is approximately 8900 kilocalories per standard cubic meter (1000 British thermal units per standard cubic foot), usually varying from 8000 to 9500 kcal scm (900 to 1100 Btu/scf).

1.4.2 Emissions And Controls³⁻⁵

Even though natural gas is considered to be a relatively clean-burning fuel, some emissions can result from combustion. For example, improper operating conditions, including poor air/fuel mixing, insufficient air, etc., may cause large amounts of smoke, carbon monoxide (CO), and organic compound emissions. Moreover, because a sulfur-containing mercaptan is added to natural gas to permit leak detection, small amounts of sulfur oxides will be produced in the combustion process.

Nitrogen oxides (NO_x) are the major pollutants of concern when burning natural gas. Nitrogen oxide emissions depend primarily on the peak temperature within the combustion chamber as well as the furnace-zone oxygen concentration, nitrogen concentration, and time of exposure at peak temperatures. Emission levels vary considerably with the type and size of combustor and with operating conditions (particularly combustion air temperature, load, and excess air level in boilers).

Currently, the two most prevalent NO_x control techniques being applied to natural gas-fired boilers (which result in characteristic changes in emission rates) are low NO_x burners and flue gas recirculation. Low NO_x burners reduce NO_x by accomplishing the combustion process in stages. Staging partially delays the combustion process, resulting in a cooler flame which suppresses NO_x formation. The three most common types of low NO_x burners being applied to natural gas-fired boilers are staged air burners, staged fuel burners, and radiant fiber burners. Nitrogen oxide emission reductions of 40 to 85 percent (relative to uncontrolled emission levels) have been observed with low NO_x burners. Other combustion staging techniques which have been applied to natural gas-fired boilers include low excess air, reduced air preheat, and staged combustion (e. g., burners-out-of-service and overfire air). The degree of staging is a key operating parameter influencing NO_x emission rates for these systems.

In a flue gas recirculation (FGR) system, a portion of the flue gas is recycled from the stack to the burner windbox. Upon entering the windbox, the gas is mixed with combustion air prior to being fed to the burner. The FGR system reduces NO_x emissions by two mechanisms. The recycled flue gas is made up of combustion products which act as inert gases during combustion of the fuel/air mixture. This additional mass is heated in the combustion zone, thereby lowering the peak flame temperature and reducing the amount of NO_x formed. To a lesser extent, FGR also reduces NO_x formation by lowering the oxygen concentration in the primary flame zone. The amount of flue gas recirculated is a key operating parameter influencing NO_x emission rates for these systems. Flue gas

recirculation is normally used in combination with low NO_x burners. When used in combination, these techniques are capable of reducing uncontrolled NO_x emissions by 60 to 90 percent.

Two post-combustion technologies that may be applied to natural gas-fired boilers to reduce NO_x emissions by further amounts are selective noncatalytic reduction and selective catalytic reduction. These systems inject ammonia (or urea) into combustion flue gases to reduce inlet NO_x emission rates by 40 to 70 percent.

Although not measured, all particulate matter (PM) from natural gas combustion has been estimated to be less than 1 micrometer in size. Particulate matter is composed of filterable and condensable fractions, based on the EPA sampling method. Filterable and condensable emission rates are of the same order of magnitude for boilers; for residential furnaces, most of the PM is in the form of condensable material.

The rates of CO and trace organic emissions from boilers and furnaces depend on the efficiency of natural gas combustion. These emissions are minimized by combustion practices that promote high combustion temperatures, long residence times at those temperatures, and turbulent mixing of fuel and combustion air. In some cases, the addition of NO_x control systems such as FGR and low NO_x burners reduces combustion efficiency (due to lower combustion temperatures), resulting in higher CO and organic emissions relative to uncontrolled boilers.

Emission factors for natural gas combustion in boilers and furnaces are presented in Tables 1.4-1, 1.4-2, and 1.4-3.⁶ For the purposes of developing emission factors, natural gas combustors have been organized into four general categories: utility/large industrial boilers, small industrial boilers, commercial boilers, and residential furnaces. Boilers and furnaces within these categories share the same general design and operating characteristics and hence have similar emission characteristics when combusting natural gas. The primary factor used to demarcate the individual combustor categories is heat input.

Table 1.4-1 (Metric And English Units). EMISSION FACTORS FOR PARTICULATE MATTER (PM)
FROM NATURAL GAS COMBUSTION^a

Combustor Type (Size, 10 ⁶ Btu/hr Heat Input) (SCC) ^b	Filterable PM ^c			Condensable PM ^d		
	kg/10 ⁶ m ³	lb/10 ⁶ ft ³	RATING	kg/10 ⁶ m ³	lb/10 ⁶ ft ³	RATING
Utility/large industrial boilers (> 100) (1-01-006-01, 1-01-006-04)	16 - 80	1 - 5	B	ND	ND	NA
Small industrial boilers (10 - 100) (1-02-006-02)	99	6.2	B	120	7.5	D
Commercial boilers (0.3 - < 10) (1-03-006-03)	72	4.5	C	120	7.5	C
Residential furnaces (< 0.3) (No SCC)	2.8	0.18	C	180	11	D

^a References 9-14. All factors represent uncontrolled emissions. Units are kg of pollutant/10⁶ cubic meters natural gas fired and lb of pollutant/10⁶ cubic feet natural gas fired. Based on an average natural gas higher heating value of 8270 kcal/m³ (1000 Btu/scf). The emission factors in this table may be converted to other natural gas heating values by multiplying the given emission factor by the ratio of the specified heating value to this average heating value. ND = no data. NA = not applicable.

^b SCC = Source Classification Code.

^c Filterable PM is that particulate matter collected on or prior to the filter of an EPA Method 5 (or equivalent) sampling train.

^d Condensable PM is that particulate matter collected using EPA Method 202, (or equivalent). Total PM is the sum of the filterable PM and condensable PM. All PM emissions can be assumed to be less than 10 micrometers in aerodynamic equivalent diameter (PM-10).

BEST AVAILABLE COPY

Table 1.4-2 (Metric And English Units). EMISSION FACTORS FOR SULFUR DIOXIDE (SO₂), NITROGEN OXIDES (NO_x), AND CARBON MONOXIDE (CO) FROM NATURAL GAS COMBUSTION^a

Combustor Type (Size, 10 ⁶ Btu/hr Heat Input) (SCC) ^b	SO ₂ ^c			NO _x ^d			CO ^e		
	kg/10 ⁶ m ³	lb/10 ⁶ ft ³	RATING	kg/10 ⁶ m ³	lb/10 ⁶ ft ³	RATING	kg/10 ⁶ m ³	lb/10 ⁶ ft ³	RATING
Utility/Large Industrial Boilers (> 100) (1-01-006-01, 1-01-006-04)									
Uncontrolled	9.6	0.6	A	8800	550 ^f	A	640	40	A
Controlled - Low NO _x burners	9.6	0.6	A	1300	81 ^f	D	ND	ND	NA
Controlled - Flue gas recirculation	9.6	0.6	A	850	53 ^f	D	ND	ND	NA
Small Industrial Boilers (10 - 100) (1-02-006-02)									
Uncontrolled	9.6	0.6	A	2240	140	A	560	35	A
Controlled - Low NO _x burners	9.6	0.6	A	1300	81 ^f	D	980	61	D
Controlled - Flue gas recirculation	9.6	0.6	A	480	30	C	590	37	C
Commercial Boilers (0.3 - < 10) (1-03-006-03)									
Uncontrolled	9.6	0.6	A	1600	100	B	330	21	C
Controlled - Low NO _x burners	9.6	0.6	A	270	17	C	425	27	C
Controlled - Flue gas recirculation	9.6	0.6	A	580	36	D	ND	ND	NA
Residential Furnaces (< 0.3) (No SCC)									
Uncontrolled	9.6	0.6	A	1500	94	B	640	40	B

^a Units are kg of pollutant/10⁶ cubic meters natural gas fired and lb of pollutant/10⁶ cubic feet natural gas fired. Based on an average natural gas fired higher heating value of 8270 kcal/m³ (1000 Btu/scf). The emission factors in this table may be converted to other natural gas heating values by multiplying the given emission factor by the ratio of the specified heating value to this average heating value. ND = no data. NA = not applicable.

^b SCC = Source Classification Code.

^c Reference 7. Based on average sulfur content of natural gas, 4600 g/10⁶ Nm³ (2000 gr/10⁶ scf).

Table 1.4-2 (cont.).

^d References 10, 15-19. Expressed as NO_2 . For tangentially fired units, use $4400 \text{ kg}/10^6 \text{ m}^3$ ($275 \text{ lb}/10^6 \text{ ft}^3$). At reduced loads, multiply factor by load reduction coefficient in Figure 1.4-1. Note that NO_x emissions from controlled boilers will be reduced at low load conditions.

^e References 9-10, 16-18, 20-21.

^f Emission factors apply to packaged boilers only.

Table 1.4.7 Metric And English Units). EMISSION FACTORS FOR CARBON DIOXIDE (CO₂) AND TOTAL ORGANIC COMPOUNDS (TOC) FROM NATURAL GAS COMBUSTION^a

Combustor Type (Size, 10 ⁶ Btu/hr Heat Input) (SCC) ^b	CO ₂ ^c			TOC ^d		
	kg/10 ⁶ m ³	lb/10 ⁶ ft ³	RATING	kg/10 ⁶ m ³	lb/10 ⁶ ft ³	RATING
Utility/large industrial boilers (> 100) (1-01-006-01, 1-01-006-04)	ND ^e	ND	NA	28 ^f	1.7 ^f	C
Small industrial boilers (10 - 100) (1-02-006-02)	1.9 E+06	1.2 E+05	D	92 ^g	5.8 ^g	C
Commercial boilers (0.3 - < 10) (1-03-006-03)	1.9 E+06	1.2 E+05	C	128 ^h	8.0 ^h	C
Residential furnaces (No SCC)	2.0 E+06	1.3 E+05	D	180 ^h	11 ^h	D

^a All factors represent uncontrolled emissions. Units are kg of pollutant/10⁶ cubic meters and lb of pollutant/10⁶ cubic feet. Based on an average natural gas higher heating value of 8270 kcal/m³ (1000 Btu/scf). The emission factors in this table may be converted to other natural gas heating values by multiplying the given factor by the ratio of the specified heating value to this average heating value.

NA = not applicable.

^b SCC = Source Classification Code.

^c References 10,22-23.

^d References 9-10,18.

^e ND = no data.

^f Reference 8; methane comprises 17% of organic compounds.

^g Reference 8; methane comprises 52% of organic compounds.

^h Reference 8; methane comprises 34% of organic compounds.

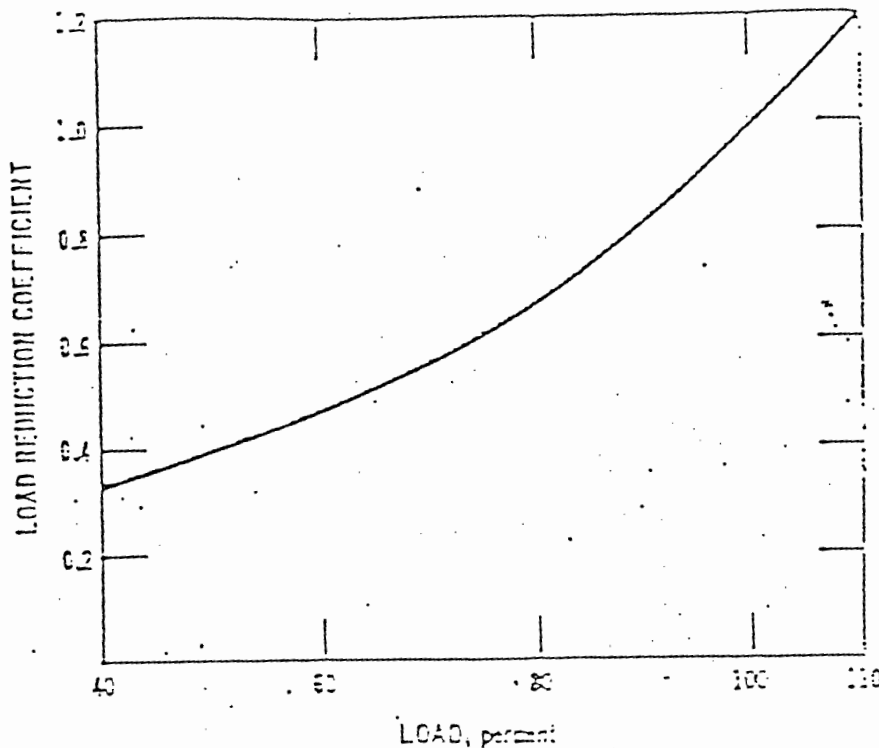



Figure 1.4-1. Load reduction coefficient as a function of boiler load.
(Used to determine NO_x reductions at reduced loads in large boilers.)

References For Section 1.4

1. *Exhaust Gases From Combustion and Industrial Processes*, EPA Contract No. EHSD 71-56, Engineering Science, Inc., Washington, DC, October 1971.
 2. *Chemical Engineers' Handbook, Fourth Edition*, J. H. Perry, Editor, McGraw-Hill Book Company, New York, NY, 1963.
 3. *Background Information Document For Industrial Boilers*, EPA-450/3-82-006a, U. S. Environmental Protection Agency, Research Triangle Park, NC, March 1982.
 4. *Background Information Document For Small Steam Generating Units*, EPA-450/3-87-000, U. S. Environmental Protection Agency, Research Triangle Park, NC, 1987.
- Fine Particulate Emissions From Stationary and Miscellaneous Sources in the South Coast Air Basin*, California Air Resources Board Contract No. A6-191-30, KVE, Inc., Tustin, CA, February 1979.
- Emission Factor Documentation for AP-42 Section 1.4 - Natural Gas Combustion (Draft)*, Technical Support Division, Office of Air Quality Planning and Standards, U. S. Environmental Protection Agency, Research Triangle Park, NC, April 1993.
- Systematic Field Study of NO_x Emission Control Methods For Utility Boilers*, APTD-1163, U. S. Environmental Protection Agency, Research Triangle Park, NC, December 1971.
- Compilation of Air Pollutant Emission Factors, Fourth Edition*, AP-42, U. S. Environmental Protection Agency, Research Triangle Park, NC, September 1985.

BEST AVAILABLE COPY

9. J. L. Muhlbaier, "Particulate and Gaseous Emissions From Natural Gas Furnaces and Water Heaters", *Journal of the Air Pollution Control Association*, December 1981.
10. *Field Investigation of Emissions From Combustion Equipment for Space Heating*, EPA-R2-73-084a, U. S. Environmental Protection Agency, Research Triangle Park, NC, June 1973.
11. N. F. Suprenant, et al., *Emissions Assessment of Conventional Stationary Combustion Systems, Volume I: Gas and Oil Fired Residential Heating Sources*, EPA-600/7-79-029b, U. S. Environmental Protection Agency, Washington, DC, May 1979.
12. C. C. Shih, et al., *Emissions Assessment of Conventional Stationary Combustion Systems, Volume III: External Combustion Sources for Electricity Generation*, EPA Contract No. 68-02-2197, TRW, Inc., Redondo Beach, CA, November 1980.
13. N. F. Suprenant, et al., *Emissions Assessment of Conventional Stationary Combustion Systems, Volume IV: Commercial/Institutional Combustion Sources*, EPA Contract No. 68-02-2197, GCA Corporation, Bedford, MA, October 1980.
14. N. F. Suprenant, et al., *Emissions Assessment of Conventional Stationary Combustion Systems, Volume V: Industrial Combustion Sources*, EPA Contract No. 68-02-2197, GCA Corporation, Bedford, MA, October 1980.
15. *Emissions Test on 200 HP Boiler at Kaiser Hospital in Woodland Hills*, Energy Systems Associates, Tustin, CA, June 1986.
16. *Results From Performance Tests: California Milk Producers Boiler No. 5*, Energy Systems Associates, Tustin, CA, November 1984.
17. *Source Test For Measurements of Nitrogen Oxides and Carbon Monoxide Emissions From Boiler Exhaust at GAF Building Materials*, Pacific Environmental Services, Inc., Baldwin Park, CA, May 1991.
18. J. P. Keeselring and W. V. Krill, "A Low-NO_x Burner For Gas-Fired Firetube Boilers", *Proceedings 1985 Symposium on Stationary Combustion NO_x Control, Volume 2*, EPRI CS-4360, Electric Power Research Institute, Palo Alto, CA, January 1986.
19. *NO_x Emission Control Technology Update*, EPA Contract No. 68-01-5553, Radian Corporation, Research Triangle Park, NC, January 1984.
20. *Background Information Document For Small Steam Generating Units*, EPA-450/7-87-009, U. S. Environmental Protection Agency, Research Triangle Park, NC, 1987.
21. *Evaluation of the Pollution Emissions From Gas-Fired Forced Air Furnaces*, Research Report No. 1503, American Gas Association Laboratories, Cleveland, OH, May 1975.
22. *Thirty-day Field Test of Industrial Boilers: Site 5 - Gas-fired Low-NO_x Burner*, EPA-600/7-81-095a, U. S. Environmental Protection Agency, Research Triangle Park, NC, May 1981.
23. Private communication from Jim Black (Industrial Combustion) to Peter Harris (MFR), Independent Third Party Source Tests, February 7, 1992.



Department of Environmental Protection

Lawton Chiles
Governor

Twin Towers Office Building
2600 Blair Stone Road
Tallahassee, Florida 32399-2400

Virginia E. Wetherell
Secretary

July 9, 1997

Certified Mail - Return Receipt Requested

Mr. Rich Piper, Chair
Florida Power Coordinating Group, Inc.
405, Reo Street, Suite 100
Tampa, Florida 33609-1004

Dear Mr. Piper:

Enclosed is a copy of a Scrivener's Order correcting an error in the Order concerning particulate matter testing of natural gas fired boilers.

If you have any questions concerning the above, please call Yogesh Manocha at 904/488-6140, or write to me.

Sincerely,

M. D. Harley, P.E., DEE
P.E. Administrator
Emissions Monitoring Section
Bureau of Air Monitoring and
Mobile Sources

MDH:ym

cc: Dotty Diltz, FDEP
Pat Comer, FDEP

STATE OF FLORIDA
DEPARTMENT OF ENVIRONMENTAL PROTECTION

In the matter of:)

Florida Electric Power Coordinating Group, Inc.,)

Petitioner.)

ASP No. 97-B-01

ORDER CORRECTING SCRIVENER'S ERROR

The Order which authorizes owners of natural gas fired fossil fuel steam generators to forgo particulate matter compliance testing on an annual basis and prior to renewal of an operation permit entered on the 17th day of March, 1997, is hereby corrected on page 4, paragraph number 4, by deleting the words "pursuant to Rule 62-210.300(2)(a)3.b., c., or d., F.A.C.":

4. In renewing an air operation permit ~~pursuant to Rule 62-210.300(2)(a)3.b., c., or d., F.A.C.~~, the Department shall not require submission of particulate matter emission compliance test results for any fossil fuel steam generator emissions unit that burned liquid and/or solid fuel for a total of no more than 400 hours during the year prior to renewal.

DONE AND ORDERED this 2 day of July, 1997 in Tallahassee, Florida.

STATE OF FLORIDA DEPARTMENT
OF ENVIRONMENTAL PROTECTION



HOWARD L. RHODES, Director
Division of Air Resources Management
Twin Towers Office Building
2600 Blair Stone Road
Tallahassee, Florida 32399-2400
(904) 488-0114

CERTIFICATE OF SERVICE

The undersigned duly designated deputy clerk hereby certifies that a copy of the foregoing was mailed to Rich Piper, Chair, Florida Power Coordinating Group, Inc., 405 Reo Street, Suite 100, Tampa, Florida 33609-1004, on this 10th day of July 1997.

Clerk Stamp

FILED AND ACKNOWLEDGMENT
FILED, on this date, pursuant to
§120.52(7), Florida Statutes, with the
designated Department Clerk, receipt of
which is hereby acknowledged.

Maithra J. Wells 7/10/97
Clerk Date

BEFORE THE STATE OF FLORIDA
DEPARTMENT OF ENVIRONMENTAL REGULATION

In the Matter of:)
)
Petition for Reduction in)
Semiannual Particulate)
Emissions Compliance Testing,) OGC File No. 86-1577
Bartow Unit No. 3;)
Florida Power Corporation)
)
Petitioner.)
_____)

ORDER

On February 18, 1986, the Petitioner, Florida Power Corporation, filed a Petition for Reduction in the Frequency of Particulate Emissions Compliance Testing pursuant to Florida Administrative Code Rule 17-2.600(5)(b)1. for the following fossil fuel steam generating unit:

Bartow Unit No. 3.

Pursuant to Florida Administrative Code Rule 17-2.600(5)(b)1., and by Order dated November 7, 1982, Petitioner has conducted semiannual particulate emission compliance tests. Florida Administrative Code Rule 17-2.600(5)(b)1. provides that the Department may reduce the frequency of particulate testing upon a demonstration that the particulate standard of 0.1 pound per million Btu heat input has been regularly met. The petition and supporting documentation submitted by Petitioner indicate that, since January 26, 1982, Petitioner has regularly met the particulate standard. It is therefore,

ORDERED that the Petition for Reduction in the Frequency of Particulate Emissions Compliance Testing is GRANTED. Petitioner may immediately commence testing on an annual basis. Test results from the first regularly scheduled compliance test conducted in FY 87 (October 1, 1986 - September 30, 1987), provided the results of that test meet the particulate standard and the 40% opacity standard, shall be accepted as results from the first annual test. Failure of Bartow Unit No.3 to meet


either the particulate standard or the 40% opacity standard in the future shall constitute grounds for revocation of this authorization.

Persons whose substantial interests are affected by the above proposed agency action have a right, pursuant to Section 120.57, Florida Statutes, to petition for an administrative determination (hearing) on the proposed action. The Petition must conform to the requirements of Chapters 17-103 and 28-5, Florida Administrative Code, and must be filed (received) with the Department's Office of General Counsel, 2600 Blair Stone Road, Tallahassee, Florida 32399-2400, within fourteen (14) days of publication of this notice. Failure to file a petition within the fourteen (14) days constitutes a waiver of any right such person has to an administrative determination (hearing) pursuant to Section 120.57, Florida Statutes.

If a petition is filed, the administrative hearing process is designed to formulate agency action. Accordingly, the Department's final action may be different from the proposed agency action. Persons whose substantial interests will be affected by any decision of the Department have the right to intervene in the proceeding. A petition for the intervention must be filed pursuant to Model Rule 28-5.207, Florida Administrative Code, at least five (5) days before the final hearing and be filed with the Hearing Officer if one has been assigned at the Division of Administrative Hearings, Department of Administration, 2009 Apalachee Parkway, Tallahassee, Florida 32301. If no Hearing Officer has been assigned, the petition is to be filed with the Department's Office of General Counsel, 2600 Blair Stone Road, Tallahassee, Florida 32399-2400. Failure to petition to intervene within the allowed time frame constitutes a

CERTIFICATE OF SERVICE

I HEREBY CERTIFY that a true and correct copy of the foregoing ORDER has been furnished by United States Mail to J.A. Hancock, Vice President, Fossil Operations, Florida Power Corporation, Post Office Box 14042, St. Petersburg, Florida 33733; on this 12 day of December, 1986, in Tallahassee, Florida.


E. Gary Early
Assistant General Counsel

STATE OF FLORIDA DEPARTMENT
OF ENVIRONMENTAL REGULATION

Twin Towers Office Building
2600 Blair Stone Road
Tallahassee, Florida
32399-2400
Telephone (904)486-9730

THE STATE OF FLORIDA
DEPARTMENT OF ENVIRONMENTAL REGULATION

In the matter of:)
)
Petition for Reduction in) OGC File No. 87-1261
Quarterly Particulate)
Emissions Compliance Testing)
)
FLORIDA POWER CORPORATION,)
Bartow Unit 2,)
)
Petitioner)
_____)

ORDER

On May 4, 1987, the Petitioner, Florida Power Corporation, filed a Petition for Reduction in the Frequency of Particulate Matter Emissions Compliance Testing pursuant to Florida Administrative Code Rule 17-2.600(5)(b)1. for the following fossil fuel-fired steam generating unit:

BARTOW UNIT 2

Pursuant to Florida Administrative Code Rule 17-2.600(5)(b)1., Petitioner has conducted semi-annual particulate matter emissions compliance tests. Florida Administrative Code Rule 17-2.600(5)(b)1. provides that the Department may reduce the frequency of particulate matter testing upon a demonstration that the particulate matter standard of 0.1 pounds per million Btu heat input has been regularly met. The petition and supporting documentation submitted by Petitioner indicate that, since December 21, 1982, Petitioner has regularly met the particulate matter standard. It is therefore,

ORDERED that the Petition for Reduction in the Frequency of Particulate Matter Emissions Compliance Testing is GRANTED, and that:

1. Petitioner's generating unit Bartow Unit 2 shall be

required to conduct one steady-state particulate matter emissions compliance test annually and one particulate matter emissions compliance test annually under soot blowing conditions.

2. Bartow Unit 2 shall be subject to a steady-state visible emissions limiting standard of forty (40) percent opacity (number 2 of the Ringelmann Chart).
3. This order supercedes all conflicting conditions relating to frequency of particulate matter emissions compliance testing contained in operating permit A052-56650 for Bartow Unit 2.
4. The Department, or its designee, if after investigation, has good reason (such as complaints, increased visible emissions or questionable maintenance of control equipment) to believe that any applicable emissions standard in Chapter 17-2 or in a permit issued pursuant to Chapter 17-2 is being violated, may require additional tests for particulate matter emissions pursuant to Florida Administrative Code Rule 17-2.700(2)(b).

Persons whose substantial interests are affected by the Department's above proposed agency action may petition for an administrative determination (hearing) in accordance with Section 120.57, Florida Statutes. The petition must conform to the requirements of Chapters 17-103 and 28-5, Florida Administrative Code, and must be filed (received) in the Department's Office of General Counsel, 2600 Blair Stone Road, Tallahassee, Florida 32399-2400, within twenty-one (21) days of publication of this notice. Failure to file a petition within the twenty-one (21) days constitutes a waiver of any right such person has to an administrative determination (hearing) pursuant to Section

120.57, Florida Statutes.

If a petition is filed, the administrative hearing process is designed to formulate agency action. Accordingly, the Department's final action may be different from the proposed agency action. Therefore, persons who may not desire to file a petition may want to intervene in the proceeding. A petition for intervention must be filed pursuant to Rule 28-5.207, Florida Administrative Code, at least five (5) days before the final hearing and must be filed with the Hearing Officer if one has been assigned, at the Division of Administrative Hearings, Department of Administration, 2009 Apalachee Parkway, Tallahassee, Florida 32301. If no Hearing Officer has been assigned, the petition is to be filed with the Department's Office of General Counsel, 2600 Blair Stone Road, Tallahassee, Florida 32399-2400. Failure to petition to intervene within the allowed time frame constitutes a waiver of any right such person has to request a hearing under Section 120.57, Florida Statutes.

DONE AND ORDERED this 12th day of October, 1987, in Tallahassee, Florida.

STATE OF FLORIDA DEPARTMENT OF ENVIRONMENTAL REGULATION

FILING AND ACKNOWLEDGEMENT
FILED, on this date, pursuant to S120.52 Florida Statutes, with the designated Department Clerk, receipt of which is hereby acknowledged.

C. Hutchison
Clerk

10-13-87
Date


DALE TWACHTMANN
Secretary

Twin Towers Office Building
2600 Blair Stone Road
Tallahassee, Florida 32399-2400
(904) 488-4805

Table 1-1, Summary of Air Pollutant Standards and Terms

Florida Power Corporation
Bartow Plant

FINAL Permit No.: 1030011-002-AV
Facility ID No.: 1030011

This table summarizes information for convenience purposes only. This table does not supersede any of the terms or conditions of this permit.

E.U. ID No.	Brief Description
[-001]	No. 1 Unit, Fossil Fuel Fired Steam Generator with Electrostatic Precipitator
[-002]	No. 2 Unit, Fossil Fuel Fired Steam Generator
[-003]	No. 3 Unit, Fossil Fuel Fired Steam Generator

Pollutant Name	Fuel(s)	Hours/Year	Allowable Emissions			Equivalent Emissions*		Regulatory Citation(s)	See permit condition(s)
			Standard(s)	lbs./hour	TPY	lbs./hour	TPY		
PM [EU-001]	All	8,760	0.1 lb/MMBtu	122.0	534.4			Rules 62-296.405(1)(b), 62-296.700(4)(b) & 62-296.702(2)(a)	A.7.
PM [EU-002]	All	8,760	0.1 lb/MMBtu	131.7	576.9			Rules 62-296.405(1)(b), 62-296.700(4)(b) & 62-296.702(2)(a)	A.7.
PM [EU-003]	All	8,760	0.1 lb/MMBtu	221.1	968.6			Rules 62-296.405(1)(b), 62-296.700(4)(b) & 62-296.702(2)(a)	A.7.
PM [EU-001]	All	8,760	0.3 lb/MMBtu	366.0				Rules 62-210.700(3) & 62-296.700(4)(b)	A.8.
PM [EU-002]	All	8,760	0.3 lb/MMBtu	395.1				Rules 62-210.700(3) & 62-296.700(4)(b)	A.8.
PM [EU-003]	All	8,760	0.3 lb/MMBtu	663.3				Rules 62-210.700(3) & 62-296.700(4)(b)	A.8.
SO ₂ [EU-001]	Liquid	8,760	2.75 lb/MMBtu			3,355.0	14,694.9	Rule 62-296.405(1)(c)1.j.	A.9.
SO ₂ [EU-002]	Liquid	8,760	2.75 lb/MMBtu			3,621.75	15,863.28	Rule 62-296.405(1)(c)1.j.	A.9.
SO ₂ [EU-003]	Liquid	8,760	2.75 lb/MMBtu			6,089.25	25,621.5	Rule 62-296.405(1)(c)1.j.	A.9.
SO ₂	Liquid	8,760	2.5% by weight sulfur					Rule 62-296.405(1)(e)3.	A.10.
VE	All	8,760	40% opacity					Rule 62-296.405(1)(a) & OGC Orders 86-1577 & 87-1261	A.5.
VE	All	3 hr/24 hr	60% opacity					Rule 62-210.700(3)	A.6.

Notes:
* The "Equivalent Emissions" listed are for informational purposes only.

[electronic file name: 10300111.xls]

Table 1-1, Summary of Air Pollutant Standards and Terms

Florida Power Corporation
Bartow Plant

FINAL Permit No.: 1030011-002-AV
Facility ID No.: 1030011

This table summarizes information for convenience purposes only. This table does not supersede any of the terms or conditions of this permit.

E.U. ID No. **Brief Description**
[I-004] Bartow-Anclote Pipeline Heating Boiler

Pollutant Name	Fuel(s)	Hours/Year	Allowable Emissions			Equivalent Emissions*		Regulatory Citation(s)	See permit condition(s)
			Standard(s)	lbs./hour	TPY	lbs./hour	TPY		
SO ₂	Liquid	8,760	0.5% by weight sulfur			8.52	37.34	Rule 62-296.406(3)	B.7.
VE	All	8,760	20% except 40% 2 min/hr					Rule 62-296.406(1)	B.5.
VE	All	3 hr/24 hr	60% opacity					Rule 62-210.700(3)	B.6.

Notes:
* The "Equivalent Emissions" listed are for informational purposes only.

[electronic file name: 10300111.xls]

Table 1-1, Summary of Air Pollutant Standards and Terms

Florida Power Corporation
Bartow Plant

FINAL Permit No.: 1030011-002-AV
Facility ID No.: 1030011

This table summarizes information for convenience purposes only. This table does not supersede any of the terms or conditions of this permit.

E.U. ID No.	Brief Description
[-005]	Gas Turbine Peaking Unit #P-1
[-006]	Gas Turbine Peaking Unit #P-2
[-007]	Gas Turbine Peaking Unit #P-3
[-008]	Gas Turbine Peaking Unit #P-4

Pollutant Name	Fuel(s)	Hours/Year	Allowable Emissions			Equivalent Emissions*		Regulatory Citation(s)	See permit condition(s)
			Standard(s)	lbs./hour	TPY	lbs./hour	TPY		
SO ₂	Liquid	8,760	0.5% by weight sulfur			392.7	1,720.0	AO52-253215A, 253216A, 253217A & 253218A	C.6.
VE	All	8,760	20% opacity					Rule 62-296.320(4)(b)1.	C.5.

Notes:
* The "Equivalent Emissions" listed are for informational purposes only.

Table 1-1, Summary of Air Pollutant Standards and Terms

Florida Power Corporation
Bartow Plant

FINAL Permit No.: 1030011-002-AV
Facility ID No.: 1030011

This table summarizes information for convenience purposes only. This table does not supersede any of the terms or conditions of this permit.

E.U. ID No. **Brief Description**
[-xxx] Relocatable Diesel Fired Generator(s)

Pollutant Name	Fuel(s)	Hours/Year	Allowable Emissions			Equivalent Emissions*		Regulatory Citation(s)	See permit condition(s)
			Standard(s)	lbs./hour	TPY	lbs./hour	TPY		
SO ₂	Liquid	2,970	0.5% by weight Sulfur			14.16	21.02	Applicant request & AC09-202080	D.4. & D.6.
VE	All	2,970	20% opacity					Applicant request & AO09-205952	D.5.

Notes:
* The "Equivalent Emissions" listed are for informational purposes only.

[electronic file name: 10300111.xls]

Table 2-1, Summary of Compliance Requirements

Florida Power Corporation
Bartow Plant

FINAL Permit No.: 1030011-002-AV
Facility ID No.: 1030011

This table summarizes information for convenience purposes only. This table does not supersede any of the terms or conditions of this permit.

E.U. ID No.	Brief Description
[-001]	No. 1 Unit, Fossil Fuel Fired Steam Generator with Electrostatic Precipitator
[-002]	No. 2 Unit, Fossil Fuel Fired Steam Generator
[-003]	No. 3 Unit, Fossil Fuel Fired Steam Generator

Pollutant Name or Parameter	Fuel(s)	Compliance Method	Testing Time Frequency	Frequency Base Date *	Min. Compliance Test Duration	CMS**	See permit condition(s)
VE EUI-002 & -003]	All	EPA Method 9	Annual	5/28 & 4/28	60 min		A.19.and A.30.
PM EUI-001]	All	EPA Method 17, 5, 5B or 5F	6 months	3/16 & 9/16	1 hr		A.20., A.29.and A.31.
PM EUI-002 & -003]	All	EPA Method 17, 5, 5B or 5F	Annual	5/28 & 4/28	1 hr		A.20.and A.31.
SO ₂	Liquid	EPA Method 6, 6A, 6B, or 6C; or fuel analysis	Annual	w/ PM test	1 hr		A.21.and A.22.
Used oil	On-specification	EPA SW-846	each batch				A.11., A.12., A.13., & A.32.

Notes:
 * The frequency base date is established for planning purposes only; see Rule 62-297.310, F.A.C.
 ** CMS [=] continuous monitoring system

[electronic file name: 10300112.xls]

Table 2-1, Summary of Compliance Requirements

Florida Power Corporation
Bartow Plant

FINAL Permit No.: 1030011-002-AV
Facility ID No.: 1030011

This table summarizes information for convenience purposes only. This table does not supersede any of the terms or conditions of this permit.

E.U. ID No. **Brief Description**
[-004] Bartow-Anclote Pipeline Heating Boiler

Pollutant Name or Parameter	Fuel(s)	Compliance Method	Testing Time Frequency	Frequency Base Date *	Min. Compliance Test Duration	CMS **	
							See permit condition(s)
VE SO ₂	All Liquid	DEP Method 9 ASTM Methods	Annual each delivery	31-May	30 min		B.12. & B.13. B.14. & B.15.

Notes:
 * The frequency base date is established for planning purposes only; see Rule 62-297.310, F.A.C.
 ** CMS [=] continuous monitoring system

[electronic file name: 10300112.xls]

Table 2-1, Summary of Compliance Requirements

Florida Power Corporation
Bartow Plant

FINAL Permit No.: 1030011-002-AV
Facility ID No.: 1030011

This table summarizes information for convenience purposes only. This table does not supersede any of the terms or conditions of this permit.

E.U. ID No.	Brief Description
[-005]	Gas Turbine Peaking Unit #P-1
[-006]	Gas Turbine Peaking Unit #P-2
[-007]	Gas Turbine Peaking Unit #P-3
[-008]	Gas Turbine Peaking Unit #P-4

Pollutant Name or Parameter	Fuel(s)	Compliance Method	Testing Time Frequency	Frequency Base Date *	Min. Compliance Test Duration	CMS **	See permit condition(s)

Notes:
 * The frequency base date is established for planning purposes only; see Rule 62-297.310, F.A.C.
 ** CMS [=] continuous monitoring system

[electronic file name: -10300112.xls]

Table 2-1, Summary of Compliance Requirements

Florida Power Corporation
Bartow Plant

FINAL Permit No.: 1030011-002-AV
Facility ID No.: 1030011

This table summarizes information for convenience purposes only. This table does not supersede any of the terms or conditions of this permit.

E.U. ID No. **Brief Description**
[-xxx] Relocatable Diesel Fired Generator(s)

Pollutant Name or Parameter	Fuel(s)	Compliance Method	Testing Time Frequency	Frequency Base Date *	Min. Compliance Test Duration	CMS**	See permit condition(s)

Notes:
 * The frequency base date is established for planning purposes only; see Rule 62-297.310, F.A.C.
 ** CMS [=] continuous monitoring system

[electronic file name: 10300112.xls]

Appendix H-1, Permit History/ID Number Changes

Florida Power Corporation
P. L. Bartow

FINAL Permit No.: 1030011-002-AV
Facility ID No.: 1030011

Permit History (for tracking purposes):

<u>E.U.</u> <u>ID No</u>	<u>Description</u>	<u>Permit No.</u>	<u>Issue</u> <u>Date</u>	<u>Expiration Date</u>	<u>Extended Date</u> ^{1,2}	<u>Revised Date(s)</u>
-001	Bartow Plant Unit #1	AO52-233149	12/29/93	12/28/98		02/19/97
-002	Bartow Plant Boiler #2	AO52-216412	01/26/93	09/16/98		02/19/97
-003	Bartow Plant Boiler #3	AO52-216413	01/27/93	09/16/98		08/16/95 02/19/97
-004	Bartow Pipeline Heater Boiler	AO52-244478	04/18/94	04/18/99		
-005	Gas Turbine Peaking Unit #P-1	AO52-253215	11/23/94	11/01/99		01/13/97
-006	Gas Turbine Peaking Unit #P-2	AO52-253216	11/23/94	11/01/99		01/13/97
-007	Gas Turbine Peaking Unit #P-3	AO52-253217	11/23/94	11/01/99		01/13/97
-008	Gas Turbine Peaking Unit #P-4	AO52-253218	11/23/94	11/01/99		01/13/97
-009	Flyash Storage Silo w/Baghouse	AO52-232464	08/30/93	08/26/98		09/04/98
-009	Flyash Storage Silo w/Baghouse	1030011-005-AC	09/04/98			
-009	Flyash Storage Silo w/Baghouse	1030011-006-AC				
-xxx	Relocatable Diesel Generator(s)	AO09-205952		03/31/97		

(if applicable) ID Number Changes (for tracking purposes):

From: **Facility ID No.:** 40PNL520011

To: **Facility ID No.:** 1030011


Notes:

1 - AO permit(s) automatic extension(s) in Rule 62-210.300(2)(a)3.a., F.A.C., effective 03/21/96.

2 - AC permit(s) automatic extension(s) in Rule 62-213.420(1)(a)4., F.A.C., effective 03/20/96.

{Rule 62-213.420(1)(b)2., F.A.C., allows Title V Sources to operate under existing valid permits that were in effect at the time of application until the Title V permit becomes effective}

Florida's FINAL Permit Electronic Notification Cover Memorandum

TO: Elizabeth Bartlett, U.S. EPA Region 4
CC: Gregg Worley, U.S. EPA Region 4
THRU: Scott M. Sheplak, P.E., Bureau of Air Regulation
FROM: Edward J. Svec, Permit Engineer 
DATE: 12/28/99
RE: U.S. EPA Region 4 FINAL Title V Operation Permit Review

The following FINAL Title V operation permit(s) and associated documents have been posted on the DEP World Wide Web Internet site. Any comments resulting from your review of the PROPOSED permit have been incorporated into this FINAL permit as requested. This message is only a courtesy to let you know that the subject permit is now FINAL and has been issued to the applicant.

<u>Applicant Name</u>	<u>County</u>	<u>Method of Transmittal</u>	<u>Electronic File Name(s)</u>
Florida Power Corporation Bartow Plant	Pinellas	INTERNET	1030011f.zip

This zipped file contains the following electronic files:

Final-d.doc
sob.doc
1030011f.doc
10300111.xls
10300112.xls
1030011g.doc
1030011u.doc
1030011h.doc

TO: Howard L. Rhodes
FROM: Clair H. Fancy
DATE: December 22, 1999
SUBJECT: FINAL Permit No.: 1030011-002-AV
and 1030011-006-AC
Florida Power Corporation
Bartow Plant

I signed

This permit is for the initial Title V air operation permit for the subject facility. The regulated emissions units at the facility include three fossil fuel fired steam generators subject to Phase II Acid Rain, a pipeline heating boiler, four gas turbine peaking units and relocatable diesel generators that can be located at various Florida Power Corporation power plants, as needed.

The construction permitting action changes the status of a previously permitted emissions unit, the fly ash collection system associated with the Unit 1 electrostatic precipitator (ESP). The permit to construct reclassifies the fly ash system from a regulated emissions unit to an insignificant emissions unit/activity. A previous modification implemented a closed-loop fly ash system, which replaced a conventional fly ash silo/transfer system. The fly ash system (formally called Emissions Unit I.D. No. -009) now meets the requirements of Rules 62-210.300(3)(a) and 62-213.430(6)(b), F.A.C., and is reclassified as an Insignificant Emissions Unit/Activity, where it is currently listed.

We received minor comments from Florida Power Corporation on the DRAFT permit.

We received objections from Region 4, U.S. EPA, on September 16, 1999, regarding the PROPOSED permit. The objections, involving emission limitation and averaging time issues, were resolved by letter on December 9, 1999 and the EPA removed their objections in a letter dated December 16, 1999.

I recommend your signature.

Attachment

CHF/es

STATEMENT OF BASIS

Florida Power Corporation
Bartow Plant
Facility ID No.: 1030011
Pinellas County

Initial Title V Air Operation Permit
FINAL Permit No.: 1030011-002-AV

This Title V air operation permit is issued under the provisions of Chapter 403, Florida Statutes (F.S.), and Florida Administrative Code (F.A.C.) Chapters 62-4, 62-210, 62-213, and 62-214. The above named permittee is hereby authorized to perform the work or operate the facility shown on the application and approved drawing(s), plans, and other documents, attached hereto or on file with the permitting authority, in accordance with the terms and conditions of this permit.

This facility consists of three fossil fuel fired steam generators subject to Phase II Acid Rain, a pipeline heating boiler, four gas turbine peaking units and relocatable diesel generators that can be located at various Florida Power Corporation power plants, as needed.

Unit No. 1 is a front-fired, fossil fuel steam generator which produces 120 megawatts, electric power. The maximum heat input rate is 1,220 million Btu per hour and the unit fires No. 2 through No. 6 fuel oil, and on-specification used oil. Particulate matter emissions are controlled by a General Electric Services, Inc. Model 1-BAB1.2X37(9)36.0-434-4.3P electrostatic precipitator consisting of five fields in depth. The permit application indicates this ESP was designed to operate when utilizing a coal/oil mixture which is no longer burned by FPC. Because Unit 1 is oil fired and this unit is capable of meeting the applicable particulate matter and opacity limits in Conditions A.5., A.6., A.7., and A.8. without use of the ESP, the provisions of 40 CFR 64 do not apply [40 CFR 64.2(b)(ii)]. A Durag Model 281 Continuous Emissions Monitor for opacity with a recorder is used for continual observation of stack opacity. Unit 1 began commercial service in 1958. The Department has determined that the appropriate particulate matter testing frequency for the fossil fuel steam generators is annually whenever fuel oil is used for more than 400 hours in the preceding year. This frequency is justified by the low emission rate documented in previous emissions tests while firing fuel oil. This unit is subject to a steady-state PM emission limit of 0.1 lb/MMBtu. The applicant has presented historical PM test results which show that the steady-state average results are well below the applicable effective standard. The Department has determined that sources that consistently test below the effective standard shall test annually. A five year average of results of particulate matter emission testing in lb/MMBtu for Unit No. 1 is 0.054, steady-state.

Unit No. 2 is a tangential-fired fossil fuel fired steam generator which produces 120 megawatts, electric power. The maximum heat input rate is 1,317 million Btu per hour and the unit fires No. 2 through No. 6 fuel oil, on-specification used oil, and propane. Emissions from Unit No. 2 are uncontrolled. Unit 2 began commercial service in 1961. The Department has determined that the appropriate particulate matter testing frequency for the fossil fuel steam generators is annually whenever fuel oil is used for more than 400 hours in the preceding year. This frequency is justified by the low emission rate documented in previous emissions tests while firing fuel oil. This unit is subject to a steady-state PM emission limit of 0.1 lb/MMBtu. The applicant has presented historical PM test results which show that the steady-state average results are well below the applicable effective standard. The Department has determined that sources that consistently test below the effective standard shall test annually. A five year average of results of particulate matter emission testing in lb/MMBtu for Unit No. 2 is 0.069, steady-state.

Unit No. 3 is a tangential-fired fossil fuel fired steam generator which produces 225 megawatts, electric power. The maximum heat input rate is 2,211 million Btu per hour and the unit fires No. 2 through No. 6 fuel oil, on-specification used oil, natural gas, and propane. Emissions from Unit No. 3 are uncontrolled. Unit 3 began commercial service in 1963. The Department has determined that the appropriate particulate matter testing frequency for the fossil fuel steam generators is annually whenever fuel oil is used for more than 400 hours in the preceding year. This frequency is justified by the low emission rate documented in previous emissions tests while firing fuel oil. This unit is subject to a steady-state PM emission limit of 0.1 lb/MMBtu. The applicant has presented historical PM test results which show that the steady-state average results are well below the applicable effective standard. The Department has determined that sources that consistently test below the effective standard shall test annually. A five year average of results of particulate matter emission testing in lb/MMBtu for Unit No. 3 is 0.067, steady-state.

In accordance with the provisions of Rule 62-296.405(1)(a), F.A.C., Units 1, 2 and 3 elected to test for particulate matter quarterly and were allowed visible emissions of 40 percent opacity. The Bartow Plant demonstrated that the particulate matter standard was regularly complied with for each unit and petitioned the Secretary for a reduction in the frequency of particulate matter testing from quarterly to annually, as provided by the rule. The request for annual testing was granted to Unit 1 by OGC Order No. 96-A-01, Unit 2 by OGC Order No. 87-1261 and Unit 3 by OGC Order No. 86-1577.

The Bartow-Anclote Pipeline Heating Boiler is used to heat fuel oil being transferred from the Bartow Plant to the Anclote Plant. The boiler's maximum heat input rate is 15.5 million Btu per hour firing natural gas, No. 2 fuel oil, or propane. Emissions from the boiler are uncontrolled.

The four gas turbines are natural gas and/or No. 2 fuel oil fired combustion turbines manufactured by General Electric (model number MS7000) and are designated as Gas Turbine Peaking Units #P-1, #P-2, #P-3 and #P-4. The manufacturers fuel flow and heat input ratings for each turbine are 5,174 gallons per hour of No. 2 fuel oil, or 714 million cubic feet per hour of natural gas (corresponds to approximately 714 million Btu per hour, at 59 degrees F). The actual heat input rate of the turbine is a function of the ambient temperature. These combustion turbines are used as peaking units during peak demand times to run a nominal 56 MW generator (each). Emissions from the combustion turbines are uncontrolled. The Department has determined that the appropriate visible emissions (VE) testing frequency for the four combustion turbines is a VE test upon exceeding 400 hours of operation on fuel oil in any federal fiscal year (October 1 through September 30). This frequency is justified by the low historical use of fuel oil for these emissions units and the previous VE tests, which documented compliance while firing fuel oil. Moreover, no Method 9 test since 1994 on these emissions units have resulted in an opacity measurement greater than half of the standard. Regarding hours of operation, these emissions units had not significantly exceeded 400 hours per year (going back to 1994), until the summer of 1998. The highest turbine hours of operation on oil for each year are: 1998 (P1) 724 hours; 1997 (P3) 297 hours; 1996 (P2) 308 hours; 1995 (P2) 355 hours; and, 1994 (P2) 235 hours. All electric generating units, not only within FPC's system, but state-wide, operated at record levels during the summer of 1998. The owner or operator will be conducting VE compliance tests while firing fuel oil for each combustion turbine upon that combustion turbine exceeding 400 hours of operation on fuel oil in any federal fiscal year (October 1 through September 30). Regardless of the number of hours of operation on fuel oil, at least one VE compliance test will be conducted on all four combustion turbines every five (5) years, coinciding with the term of the operation permit for these combustion turbines.

Relocatable diesel generator(s) will have a maximum (combined) heat input of 25.74 MMBtu/hour while being fueled by 186.3 gallons of new No. 2 fuel oil per hour with a maximum (combined) rating of 2460 kilowatts. Emissions from the generator(s) are uncontrolled. The generator(s) may be relocated at any of the following facilities:

1. Crystal River Plant, Powerline Road, Red Level, Citrus County.
2. Bartow Plant, Weedon Island, St. Petersburg, Pinellas County.
3. Higgins Plant, Shore Drive, Oldsmar, Pinellas County.
4. Bayboro Plant, 13th Ave. & 2nd St. South, St. Petersburg, Pinellas County.
5. Wildwood Reclamation Facility, State Road 462, 1 mi. east of U.S. 301, Wildwood, Sumter County.
6. Hines Energy Complex, County Road 555, 1 mi. southwest of Homeland, Polk County.
Anclote Power Plant, 1729 Baileys Road, Holiday, Pasco County

These generator(s) are included in the Title V permits for each of the above listed facilities. The records required by the permit shall be maintained at each individual site. FPC's corporate environmental services department shall be responsible for agency notifications and reporting and is functionally structured to provide coordination among the facilities.

The heat input limitations have been placed in each permit to identify the capacity of each unit for the purposes of confirming that emissions testing is conducted within 90 to 100 percent of the unit's rated capacity (or to limit future operation to 110 percent of the test load), to establish appropriate emission limits and to aid in determining future rule applicability. Regular record keeping is not required for heat input. Instead the owner or operator is expected to determine heat input whenever emission testing is required, to demonstrate at what percentage of the rated capacity that the unit was tested. Rule 62-297.310(5), F.A.C., included in the permit, requires measurement of the process variables for emission tests. Such heat input determination may be based on measurements of fuel consumption by various methods including but not limited to fuel flow metering or tank drop measurements, using the heat value of the fuel determined by the fuel vendor or the owner or operator, to calculate average hourly heat input during the test.

The construction permitting action changes the status of a previously permitted emissions unit, the fly ash collection system associated with the Unit 1 electrostatic precipitator (ESP). The permit to construct reclassifies the fly ash system from a regulated emissions unit to an insignificant emissions unit/activity. A previous modification implemented a closed-loop fly ash system, which replaced a conventional fly ash silo/transfer system. The fly ash system (formally called Emissions Unit I.D. No. -009) now meets the requirements of Rules 62-210.300(3)(a) and 62-213.430(6)(b), F.A.C., and is reclassified as an Insignificant Emissions Unit/Activity, where it is currently listed.

Also included in this permit are miscellaneous unregulated/insignificant emissions units and/or activities.

Based on the initial Title V permit application received June 14, 1997, this facility is a major source of hazardous air pollutants (HAPs).

STATE OF FLORIDA
DEPARTMENT OF ENVIRONMENTAL PROTECTION

TWIN TOWERS OFFICE BUILDING
2600 BLAIR STONE ROAD
TALLAHASSEE, FLORIDA 32399-2400

M & 5505




Z 094 212 718

MAIL

REASON FOR RETURN

<input type="checkbox"/>	Postage
<input type="checkbox"/>	Insufficient Postage
<input type="checkbox"/>	Insufficient Address
<input type="checkbox"/>	No Such Number or Name
<input type="checkbox"/>	Moved Left No Address
<input type="checkbox"/>	No Receptacle
<input checked="" type="checkbox"/>	Fwd. Expired
<input type="checkbox"/>	Deceased
<input type="checkbox"/>	Do Not Remail in This Envelope

FOE

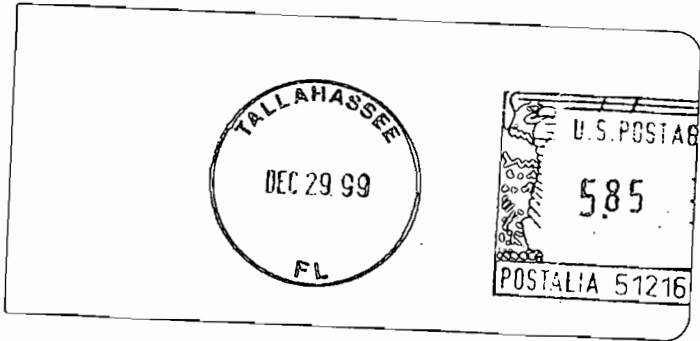

Mr. J. Jeffery Pardue
Director, Environmental Services Department
Florida Power Corporation
3201 34th Street South
St. Petersburg, Florida 33711

RECEIVED
JAN 06 2000
BUREAU OF AIR REGULATION

Is your RETURN ADDRESS completed on the reverse side?

SENDER:

- Complete items 1 and/or 2 for additional services.
- Complete items 3, 4a, and 4b.
- Print your name and address on the reverse of this form so that we can return this card to you.
- Attach this form to the front of the mailpiece, or on the back if space does not permit.
- Write "Return Receipt Requested" on the mailpiece below the article number.
- The Return Receipt will show to whom the article was delivered and the date delivered.

I also wish to receive the following services (for an extra fee):

- 1. Addressee's Address
- 2. Restricted Delivery

Consult postmaster for fee.

3. Article Addressed to:
 Mr. J. Jeffery Pardue
 Director, Environmental Services
 Department
 Florida Power Corporation
 3201 34th Street South
 St. Petersburg, Florida 33711

4a. Article Number
 Z 094 212 718

4b. Service Type

<input type="checkbox"/> Registered	<input checked="" type="checkbox"/> Certified
<input type="checkbox"/> Express Mail	<input type="checkbox"/> Insured
<input type="checkbox"/> Return Receipt for Merchandise	<input type="checkbox"/> COD

7. Date of Delivery

5. Received By: (Print Name)

8. Addressee's Address (Only if requested and fee is paid)

6. Signature: (Addressee or Agent)

X

Thank you for using Return Receipt Service.