

RECEIVED

AUG 26 1999

THE STATE OF FLORIDA  
DEPARTMENT OF ENVIRONMENTAL PROTECTION BUREAU OF AIR REGULATION

In the Matter of an  
Application for Permit by:

OGC CASE NO.: 97-1620

FDEP Revised Draft Permit No.: 1070025-001-AV

Seminole Electric Cooperative, Inc.  
Seminole Power Plant  
Putnam County, Florida

---

**NOTICE OF WITHDRAWAL OF EXTENSION OF TIME**

By and through undersigned counsel, Seminole Electric Cooperative, Inc. (Seminole) hereby withdraws its Request for Extension of Time to file a petition for formal administrative proceedings in accordance with Chapter 120, Florida Statutes. Seminole filed its last Request for Extension of Time until September 1, 1999, in response to the "Intent to Issue Title V Air Operation Permit" (**REVISED** Draft Permit No. 1070025-001-AV) for the Seminole Power Plant located in Putnam County, Florida, to negotiate certain changes in the Revised Draft Title V permit with the Department of Environmental Protection (Department). Following discussions with Department representatives, FPC and the Department came to an agreement on the issues involved in the above-referenced Revised Draft Title V permit. The agreement between Seminole and the Department is contained in the preliminary proposed Title V permit, a copy which is attached to this Notice. Therefore, Seminole hereby withdraws its Request for Extension, conditioned upon the Department's issuance of the Proposed Permit in accordance with the Department's agreement with Seminole.

**CERTIFICATE OF SERVICE**

I HEREBY CERTIFY that a copy of the foregoing has been furnished to the following by

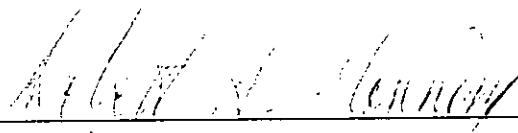
U.S. Mail on this 26 day of August, 1999:

Clair H. Fancy, P.E., Chief  
Bureau of Air Regulation  
Department of Environmental Protection  
2600 Blair Stone Road  
Tallahassee, FL 32399-2400

Jeff Brown, Esq.  
Department of Environmental Protection  
Room 669  
2600 Blair Stone Road  
Tallahassee, FL 32399-2400

Ed Svec  
Bureau of Air Regulation  
Department of Environmental Protection  
2600 Blair Stone Road  
Tallahassee, FL 32399-2400

6/26/99 cc: Ed Svec

  
\_\_\_\_\_  
Attorney

Respectfully submitted this 22 day of August, 1999.

HOPPING GREEN SAMS & SMITH, P.A.

By: Robert A. Manning

Robert A. Manning  
Fla. Bar No. 0035173  
123 South Calhoun Street  
Post Office Box 6526  
Tallahassee, FL 32314  
(850) 222-7500

Attorneys for SEMINOLE ELECTRIC  
COOPERATIVE, INC.

**RECEIVED**

**JUL 02 1999**

**BUREAU OF  
AIR REGULATION**

**THE STATE OF FLORIDA  
DEPARTMENT OF ENVIRONMENTAL PROTECTION**

In the Matter of an  
Application for Permit by:

OGC CASE NO.: 97-1620

FDEP Revised Draft Permit No.: 1070025-001-AV

Seminole Electric Cooperative, Inc.  
Seminole Power Plant  
Putnam County, Florida

---

**REQUEST FOR ENLARGEMENT OF TIME**

By and through undersigned counsel, Seminole Electric Cooperative, Inc. (Seminole) hereby requests, pursuant to Florida Administrative Code Rule 62-110.106(4), an enlargement of time, to and including September 1, 1999, in which to file a Petition for Administrative Proceedings in the above-styled matter. As good cause for granting this request, Seminole states the following:

1. On or about September 12, 1997, Seminole received from the Department of Environmental Protection (Department) an "Intent to Issue Title V Air Operation Permit" (Draft Permit No. 1070025-001-AV) for the Seminole Power Plant located in Putnam County, Florida. Seminole subsequently filed several extensions of time, until August 31, 1998, to preserve its right to file a Petition for Administrative Proceeding on this permit.

2. On or about August 20, 1998, Seminole received from the Department an "Intent to Issue Title V Air Operation Permit" (**REVISED** Draft Permit No. 1070025-001-AV) for the Seminole Power Plant. The Department issued this Revised Draft based on progressing

negotiations and the need to include additional applicable requirements pursuant to the Acid Rain program. Seminole subsequently filed extensions of time, until July 1, 1999, to preserve its right to file a Petition for Administrative Proceeding on this permit.

3. Mr. Scott Sheplak of the Department's Bureau of Air Regulation informed Seminole that the initial Draft Title V permit was effectively withdrawn upon the issuance of the Revised Draft Title V permit, and therefore no further proceedings could occur on the initial Draft permit. In reliance on this representation, Seminole has filed Requests for Extension of Time on the Revised Draft permit, and understands that no further extensions of time are needed to preserve its rights in relation to the initial Title V permit because it has been effectively withdrawn. Nonetheless, insofar as the initial Draft Title V permit may be determined to still be in effect, Seminole respectfully requests that this Request for Enlargement of Time apply to both the initial and the Revised Draft Title V permits.

4. Based on Seminole's review, the Revised Draft permit and associated documents contain several provisions that warrant clarification or correction.

5. This request is filed simply as a protective measure to avoid waiver of Seminole's right to challenge certain conditions contained in the Revised Draft Title V permit. Grant of this request will not prejudice either party, but will further their mutual interest and hopefully avoid the need to file a petition and proceed to a formal administrative hearing.

WHEREFORE, Seminole respectfully requests that the time for filing of a Petition for Administrative Proceedings in regard to the Department's Intent to Issue Title V Air Operation Permit for Revised Draft Permit No. 1070025-001-AV be formally extended to and including

September 1, 1999. If the Department denies this Request, Seminole requests the opportunity to file a Petition for Administrative Proceeding within 10 days of such denial.

Respectfully submitted this 1 day of July, 1999.

HOPPING GREEN SAMS & SMITH, P.A.

By: Robert A. Manning  
Robert A. Manning  
Fla. Bar No. 0035173  
123 South Calhoun Street  
Post Office Box 6526  
Tallahassee, FL 32314  
(850) 222-7500

Attorneys for SEMINOLE ELECTRIC  
COOPERATIVE, INC.

CERTIFICATE OF SERVICE

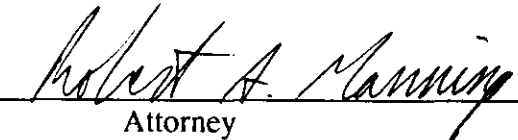
I HEREBY CERTIFY that a copy of the foregoing has been furnished to the following by

U.S. Mail on this   1   day of July, 1999:

Clair H. Fancy, P.E., Chief  
Bureau of Air Regulation  
Department of Environmental Protection  
2600 Blair Stone Road  
Tallahassee, FL 32399-2400

Ed Svec  
Bureau of Air Regulation  
Department of Environmental Protection  
2600 Blair Stone Road  
Tallahassee, FL 32399-2400

Jeff Brown, Esq.  
Department of Environmental Protection  
Room 669  
2600 Blair Stone Road  
Tallahassee, FL 32399-2400

  
\_\_\_\_\_  
Attorney

7/2/99 cc: Ed Svec  
Scott Sheplek

**RECEIVED**

MAR 31 1999

THE STATE OF FLORIDA  
DEPARTMENT OF ENVIRONMENTAL PROTECTION

BUREAU OF  
AIR REGULATION

In the Matter of an  
Application for Permit by:

OGC CASE NO.: 97-1620

FDEP Revised Draft Permit No.: 1070025-001-AV

Seminole Electric Cooperative, Inc.  
Seminole Power Plant  
Putnam County, Florida

---

**REQUEST FOR ENLARGEMENT OF TIME**

By and through undersigned counsel, Seminole Electric Cooperative, Inc. (Seminole) hereby requests, pursuant to Florida Administrative Code Rule 62-110.106(4), an enlargement of time, to and including July 1, 1999, in which to file a Petition for Administrative Proceedings in the above-styled matter. As good cause for granting this request, Seminole states the following:

1. On or about September 12, 1997, Seminole received from the Department of Environmental Protection (Department) an "Intent to Issue Title V Air Operation Permit" (Draft Permit No. 1070025-001-AV) for the Seminole Power Plant located in Putnam County, Florida. Seminole subsequently filed several extensions of time, until August 31, 1998, to preserve its right to file a Petition for Administrative Proceeding on this permit.

2. On or about August 20, 1998, Seminole received from the Department an "Intent to Issue Title V Air Operation Permit" (REVISED Draft Permit No. 1070025-001-AV) for the Seminole Power Plant. The Department issued this Revised Draft based on progressing negotiations and the need to include additional applicable requirements pursuant to the Acid Rain

program. Seminole subsequently filed extensions of time, until April 1, 1999, to preserve its right to file a Petition for Administrative Proceeding on this permit.

3. Mr. Scott Sheplak of the Department's Bureau of Air Regulation informed Seminole that the initial Draft Title V permit was effectively withdrawn upon the issuance of the Revised Draft Title V permit, and therefore no further proceedings could occur on the initial Draft permit. In reliance on this representation, Seminole has filed Requests for Extension of Time on the Revised Draft permit, and understands that no further extensions of time are needed to preserve its rights in relation to the initial Title V permit because it has been effectively withdrawn. Nonetheless, insofar as the initial Draft Title V permit may be determined to still be in effect, Seminole respectfully requests that this Request for Enlargement of Time apply to both the initial and the Revised Draft Title V permits.

4. Based on Seminole's review, the Revised Draft permit and associated documents contain several provisions that warrant clarification or correction.

5. This request is filed simply as a protective measure to avoid waiver of Seminole's right to challenge certain conditions contained in the Revised Draft Title V permit. Grant of this request will not prejudice either party, but will further their mutual interest and hopefully avoid the need to file a petition and proceed to a formal administrative hearing.

WHEREFORE, Seminole respectfully requests that the time for filing of a Petition for Administrative Proceedings in regard to the Department's Intent to Issue Title V Air Operation Permit for Revised Draft Permit No. 1070025-001-AV be formally extended to and including July 1, 1999. If the Department denies this Request, Seminole requests the opportunity to file a Petition for Administrative Proceeding within 10 days of such denial.

Respectfully submitted this 30 day of March, 1999.

HOPPING GREEN SAMS & SMITH, P.A.

By: Robert A. Manning

Robert A. Manning  
Fla. Bar No. 0035173  
123 South Calhoun Street  
Post Office Box 6526  
Tallahassee, FL 32314  
(850) 222-7500

Attorneys for SEMINOLE ELECTRIC  
COOPERATIVE, INC.

**CERTIFICATE OF SERVICE**

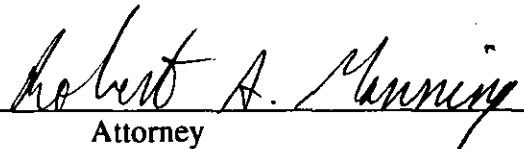
I HEREBY CERTIFY that a copy of the foregoing has been furnished to the following by

U.S. Mail on this 30 day of March, 1999:

Clair H. Fancy, P.E., Chief  
Bureau of Air Regulation  
Department of Environmental Protection  
2600 Blair Stone Road  
Tallahassee, FL 32399-2400

Ed Svec  
Bureau of Air Regulation  
Department of Environmental Protection  
2600 Blair Stone Road  
Tallahassee, FL 32399-2400

Jeff Brown, Esq.  
Department of Environmental Protection  
Room 669  
2600 Blair Stone Road  
Tallahassee, FL 32399-2400

  
\_\_\_\_\_  
Attorney

THE STATE OF FLORIDA  
DEPARTMENT OF ENVIRONMENTAL PROTECTION

In the Matter of an  
Application for Permit by:

OGC CASE NO.:

FDEP Revised Draft Permit No.: 1070025-001-AV

Seminole Electric Cooperative, Inc.  
Seminole Power Plant  
Putnam County, Florida

---

**REQUEST FOR ENLARGEMENT OF TIME**

By and through undersigned counsel, Seminole Electric Cooperative, Inc. (Seminole) hereby requests, pursuant to Florida Administrative Code Rule 62-110.106(4), an enlargement of time, to and including April 1, 1999, in which to file a Petition for Administrative Proceedings in the above-styled matter. As good cause for granting this request, Seminole states the following:

1. On or about September 12, 1997, Seminole received from the Department of Environmental Protection (Department) an "Intent to Issue Title V Air Operation Permit" (Draft Permit No. 1070025-001-AV) for the Seminole Power Plant located in Putnam County, Florida. Seminole subsequently filed several extensions of time, until August 31, 1998, to preserve its right to file a Petition for Administrative Proceeding on this permit.

2. On or about August 20, 1998, Seminole received from the Department an "Intent to Issue Title V Air Operation Permit" (REVISED Draft Permit No. 1070025-001-AV) for the Seminole Power Plant. The Department issued this Revised Draft based on progressing negotiations and the need to include additional applicable requirements pursuant to the Acid Rain

program. Seminole subsequently filed extensions of time, until March 1, 1999, to preserve its right to file a Petition for Administrative Proceeding on this permit.

3. Mr. Scott Sheplak of the Department's Bureau of Air Regulation informed Seminole that the initial Draft Title V permit was effectively withdrawn upon the issuance of the Revised Draft Title V permit, and therefore no further proceedings could occur on the initial Draft permit. In reliance on this representation, Seminole has filed Requests for Extension of Time on the Revised Draft permit, and understood that no further extensions of time would be needed to preserve its rights in relation to the initial Title V permit because it has been effectively withdrawn. Nonetheless, insofar as the initial Draft Title V permit may be determined to still be in effect, Seminole respectfully requests that this Request for Enlargement of Time apply to both the initial and the Revised Draft Title V permits.

4. Based on Seminole's review, the Revised Draft permit and associated documents contain several provisions that warrant clarification or correction.

5. This request is filed simply as a protective measure to avoid waiver of Seminole's right to challenge certain conditions contained in the Revised Draft Title V permit. Grant of this request will not prejudice either party, but will further their mutual interest and hopefully avoid the need to file a petition and proceed to a formal administrative hearing.

WHEREFORE, Seminole respectfully requests that the time for filing of a Petition for Administrative Proceedings in regard to the Department's Intent to Issue Title V Air Operation Permit for Revised Draft Permit No. 1070025-001-AV be formally extended to and including April 1, 1999. If the Department denies this Request, Seminole requests the opportunity to file a Petition for Administrative Proceeding within 10 days of such denial.

Respectfully submitted this 26 day of February, 1999.

HOPPING GREEN SAMS & SMITH, P.A.

By: Robert A. Manning

Robert A. Manning

Fla. Bar No. 0035173

123 South Calhoun Street

Post Office Box 6526

Tallahassee, FL 32314

(850) 222-7500

Attorneys for SEMINOLE ELECTRIC  
COOPERATIVE, INC.

**CERTIFICATE OF SERVICE**

I HEREBY CERTIFY that a copy of the foregoing has been furnished to the following by

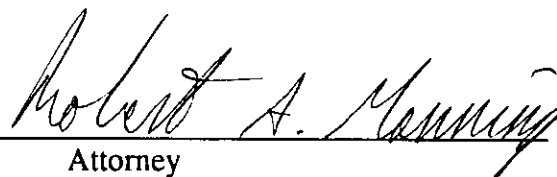
U.S. Mail on this 26 day of February, 1999:

Clair H. Fancy, P.E., Chief  
Bureau of Air Regulation  
Department of Environmental Protection  
2600 Blair Stone Road  
Tallahassee, FL 32399-2400

Ed Svec  
Bureau of Air Regulation  
Department of Environmental Protection  
2600 Blair Stone Road  
Tallahassee, FL 32399-2400

Jeff Brown, Esq.  
Department of Environmental Protection  
Room 669  
2600 Blair Stone Road  
Tallahassee, FL 32399-2400

3/4/99 Ed Svec

  
\_\_\_\_\_  
Attorney

**RECEIVED**

THE STATE OF FLORIDA  
DEPARTMENT OF ENVIRONMENTAL PROTECTION BUREAU OF  
AIR REGULATION

In the Matter of an  
Application for Permit by:

OGC CASE NO.:

FDEP Revised Draft Permit No.: 1070025-001-AV

Seminole Electric Cooperative, Inc.  
Seminole Power Plant  
Putnam County, Florida

---

**REQUEST FOR ENLARGEMENT OF TIME**

By and through undersigned counsel, Seminole Electric Cooperative, Inc. (Seminole) hereby requests, pursuant to Florida Administrative Code Rule 62-110.106(4), an enlargement of time, to and including March 1, 1999, in which to file a Petition for Administrative Proceedings in the above-styled matter. As good cause for granting this request, Seminole states the following:

1. On or about September 12, 1997, Seminole received from the Department of Environmental Protection (Department) an "Intent to Issue Title V Air Operation Permit" (Draft Permit No. 1070025-001-AV) for the Seminole Power Plant located in Putnam County, Florida. Seminole subsequently filed several extensions of time, until August 31, 1998, to preserve its right to file a Petition for Administrative Proceeding on this permit.

2. On or about August 20, 1998, Seminole received from the Department an "Intent to Issue Title V Air Operation Permit" (**REVISED** Draft Permit No. 1070025-001-AV) for the Seminole Power Plant. The Department issued this Revised Draft based on progressing negotiations and the need to include additional applicable requirements pursuant to the Acid Rain

program. Seminole subsequently filed extensions of time, until December 31, 1998, to preserve its right to file a Petition for Administrative Proceeding on this permit.

3. Mr. Scott Sheplak of the Department's Bureau of Air Regulation informed Seminole that the initial Draft Title V permit was effectively withdrawn upon the issuance of the Revised Draft Title V permit, and therefore no further proceedings could occur on the initial Draft permit. In reliance on this representation, Seminole has filed Requests for Extension of Time on the Revised Draft permit, and understood that no further extensions of time would be needed to preserve its rights in relation to the initial Title V permit because it has been effectively withdrawn. Nonetheless, insofar as the initial Draft Title V permit may be determined to still be in effect, Seminole respectfully requests that this Request for Enlargement of Time apply to both the initial and the Revised Draft Title V permits.

4. Based on Seminole's review, the Revised Draft permit and associated documents contain several provisions that warrant clarification or correction.

5. This request is filed simply as a protective measure to avoid waiver of Seminole's right to challenge certain conditions contained in the Revised Draft Title V permit. Grant of this request will not prejudice either party, but will further their mutual interest and hopefully avoid the need to file a petition and proceed to a formal administrative hearing.

WHEREFORE, Seminole respectfully requests that the time for filing of a Petition for Administrative Proceedings in regard to the Department's Intent to Issue Title V Air Operation Permit for Revised Draft Permit No. 1070025-001-AV be formally extended to and including March 1, 1999. If the Department denies this Request, Seminole requests the opportunity to file a Petition for Administrative Proceeding within 10 days of such denial.

Respectfully submitted this 18 day of December, 1998.

HOPPING GREEN SAMS & SMITH, P.A.

By: Robert A. Manning

Robert A. Manning  
Fla. Bar No. 0035173  
123 South Calhoun Street  
Post Office Box 6526  
Tallahassee, FL 32314  
(850) 222-7500

Attorneys for SEMINOLE ELECTRIC  
COOPERATIVE, INC.

**CERTIFICATE OF SERVICE**

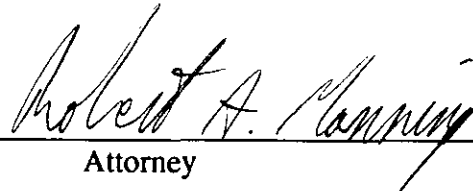
I HEREBY CERTIFY that a copy of the foregoing has been furnished to the following by

U.S. Mail on this 18 day of December, 1998:

Clair H. Fancy, P.E., Chief  
Bureau of Air Regulation  
Department of Environmental Protection  
2600 Blair Stone Road  
Tallahassee, FL 32399-2400

Ed Svec  
Bureau of Air Regulation  
Department of Environmental Protection  
2600 Blair Stone Road  
Tallahassee, FL 32399-2400

Jeff Brown, Esq.  
Department of Environmental Protection  
Room 669  
2600 Blair Stone Road  
Tallahassee, FL 32399-2400

  
\_\_\_\_\_  
Attorney

**RECEIVED**

THE STATE OF FLORIDA  
DEPARTMENT OF ENVIRONMENTAL PROTECTION

OCT 30 1998

BUREAU OF  
AIR REGULATION

In the Matter of an  
Application for Permit by:

OGC CASE NO.:

FDEP Revised Draft Permit No.: 1070025-001-AV

Seminole Electric Cooperative, Inc.  
Seminole Power Plant  
Putnam County, Florida

---

**REQUEST FOR EXTENSION OF TIME**

By and through undersigned counsel, Seminole Electric Cooperative, Inc. (Seminole) hereby requests, pursuant to Florida Administrative Code Rule 62-110.106(4), an enlargement of time, to and including December 31, 1998, in which to file a Petition for Administrative Proceedings in the above-styled matter. As good cause for granting this request, Seminole states the following:

1. On or about September 12, 1997, Seminole received from the Department of Environmental Protection (Department) an "Intent to Issue Title V Air Operation Permit" (Draft Permit No. 1070025-001-AV) for the Seminole Power Plant located in Putnam County, Florida. Seminole subsequently filed several extensions of time, until September 30, 1998, to preserve its right to file a Petition for Administrative Proceeding on this permit.

2. On or about August 20, 1998, Seminole received from the Department an "Intent to Issue Title V Air Operation Permit" (**REVISED** Draft Permit No. 1070025-001-AV) for the Seminole Power Plant. The Department issued this Revised Draft based on progressing negotiations and the need to include additional applicable requirements pursuant to the Acid Rain

program. Seminole filed an extension of time, until November 1, 1998, to preserve its right to file a Petition for Administrative Proceeding on this permit.

3. Mr. Scott Sheplak of the Department's Bureau of Air Regulation informed Seminole that the initial Draft Title V permit was effectively withdrawn upon the issuance of the Revised Draft Title V permit, and therefore no further proceedings could occur on the initial Draft permit. In reliance on this representation, Seminole filed its first Request for Extension of Time on the Revised Draft permit, and understood that no further extensions of time would be needed to preserve its rights in relation to the initial Title V permit because it has been effectively withdrawn. Nonetheless, insofar as the initial Draft Title V permit may be determined to still be in effect, Seminole respectfully requests that this third Request for Extension of Time apply to both the initial and the Revised Draft Title V permits.

4. Based on Seminole's review, the Revised Draft permit and associated documents contain several provisions that warrant clarification or correction.

5. This request is filed simply as a protective measure to avoid waiver of Seminole's right to challenge certain conditions contained in the Revised Draft Title V permit. Grant of this request will not prejudice either party, but will further their mutual interest and hopefully avoid the need to file a petition and proceed to a formal administrative hearing.

WHEREFORE, Seminole respectfully requests that the time for filing of a Petition for Administrative Proceedings in regard to the Department's Intent to Issue Title V Air Operation Permit for Revised Draft Permit No. 1070025-001-AV be formally extended to and including December 31, 1998. If the Department denies this Request, Seminole requests the opportunity to file a Petition for Administrative Proceeding within 10 days of such denial.

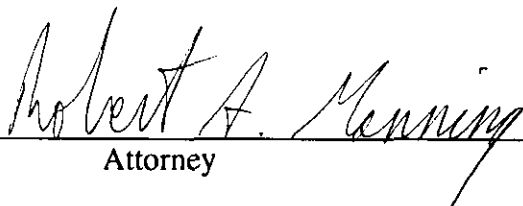
**CERTIFICATE OF SERVICE**

I HEREBY CERTIFY that a copy of the foregoing has been furnished to the following  
by U.S. Mail on this 29 day of October, 1998:

Clair H. Fancy, P.E., Chief  
Bureau of Air Regulation  
Department of Environmental Protection  
2600 Blair Stone Road  
Tallahassee, FL 32399-2400

Ed Svec  
Bureau of Air Regulation  
Department of Environmental Protection  
2600 Blair Stone Road  
Tallahassee, FL 32399-2400

Jeff Brown, Esq.  
Department of Environmental Protection  
Room 669  
2600 Blair Stone Road  
Tallahassee, FL 32399-2400

  
\_\_\_\_\_  
Attorney

11/3/94 cc: Ed Svec

**STATE OF FLORIDA  
DEPARTMENT OF ENVIRONMENTAL PROTECTION**

SEMINOLE ELECTRIC COOPERATIVE, INC.,

Petitioner,

vs.

OGC CASE NO. 97-1620

STATE OF FLORIDA DEPARTMENT  
OF ENVIRONMENTAL PROTECTION,

Respondent.

\_\_\_\_\_/

**RECEIVED**

OCT 13 1998

**ORDER GRANTING REQUEST FOR EXTENSION  
OF TIME TO FILE PETITION FOR HEARING**

BUREAU OF  
AIR REGULATION

This cause has come before the Florida Department of Environmental Protection (Department) on receipt of a request made by Petitioner, SEMINOLE ELECTRIC COOPERATIVE, INC., to grant an extension of time to file a petition for an administrative hearing on application No. 1070025-001-AV. See Exhibit 1.


Respondent, State of Florida Department of Environmental Protection, has no objection to it. Therefore,

**IT IS ORDERED:**

The request for an extension of time to file a petition for administrative proceeding is granted. Petitioner shall have until November 1, 1998, to file a petition in this matter. Filing shall be complete on receipt by the Office of General Counsel, Department of Environmental Protection, 3900 Commonwealth Boulevard, Mail Station #35, Tallahassee, Florida 32399-3000.

DONE AND ORDERED on this 12 day of October, 1998, in  
Tallahassee, Florida.

STATE OF FLORIDA DEPARTMENT  
OF ENVIRONMENTAL PROTECTION

  
F. PERRY ODOM  
General Counsel

Douglas Building  
3900 Commonwealth Boulevard  
Mail Station #35  
Tallahassee, FL. 32399-3000  
Telephone: (850) 488-9314

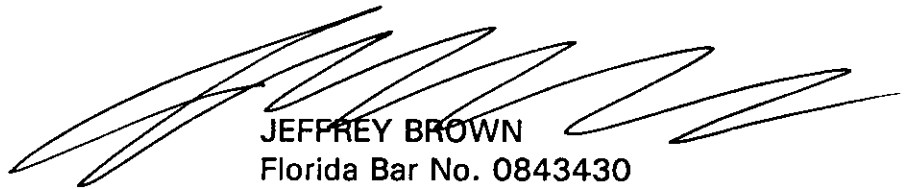
**CERTIFICATE OF SERVICE**

I CERTIFY that a copy of the foregoing has been mailed to:

Robert A. Manning, Esquire  
HOPPING, GREEN, SAMS & SMITH, P.A.  
Post Office Box 6526  
Tallahassee, FL 32314-6526

on this 13 day of October, 1998.

STATE OF FLORIDA DEPARTMENT  
OF ENVIRONMENTAL PROTECTION

  
JEFFREY BROWN  
Florida Bar No. 0843430  
Assistant General Counsel

3900 Commonwealth Boulevard  
Mail Station #35  
Tallahassee, FL. 32399-3000  
Telephone: (850) 488-9314

THE STATE OF FLORIDA  
DEPARTMENT OF ENVIRONMENTAL PROTECTION

In the Matter of an  
Application for Permit by:

OGC CASE NO.:

FDEP Revised Draft Permit No.: 1070025-001-AV

Seminole Electric Cooperative, Inc.  
Seminole Power Plant  
Putnam County, Florida

**RECEIVED**  
SEP 30 1998

~~Dept. of Environmental Protection~~  
Office of General Counsel

REQUEST FOR EXTENSION OF TIME

By and through undersigned counsel, Seminole Electric Cooperative, Inc. (Seminole) hereby requests, pursuant to Florida Administrative Code Rule 62-110.106(4), an enlargement of time, to and including November 1, 1998, in which to file a Petition for Administrative Proceedings in the above-styled matter. As good cause for granting this request, Seminole states the following:

1. On or about September 12, 1997, Seminole received from the Department of Environmental Protection (Department) an "Intent to Issue Title V Air Operation Permit" (Draft Permit No. 1070025-001-AV) for the Seminole Power Plant located in Putnam County, Florida. Seminole subsequently filed several extensions of time, until September 30, 1998, to preserve its right to file a Petition for Administrative Proceeding on this permit.

2. On or about August 20, 1998, Seminole received from the Department an "Intent to Issue Title V Air Operation Permit" (**REVISED** Draft Permit No. 1070025-001-AV) for the Seminole Power Plant. The Department issued this Revised Draft based on progressing

negotiations and the need to include additional applicable requirements pursuant to the Acid Rain program.

3. Mr. Scott Sheplak of the Department's Bureau of Air Regulation informed Seminole that the initial Draft Title V permit was effectively withdrawn upon the issuance of the Revised Draft Title V permit, and therefore no further proceedings could occur on the initial Draft permit. In reliance on this representation, Seminole filed its first Request for Extension of Time on the Revised Draft permit, and understood that no further extensions of time would be needed to preserve its rights in relation to the initial Title V permit because it has been effectively withdrawn. Nonetheless, insofar as the initial Draft Title V permit may be determined to still be in effect, Seminole respectfully requests that this second Request for Extension of Time apply to both the initial and the Revised Draft Title V permits.

4. Based on Seminole's review, the Revised Draft permit and associated documents contain several provisions that warrant clarification or correction.

5. This request is filed simply as a protective measure to avoid waiver of Seminole's right to challenge certain conditions contained in the Revised Draft Title V permit. Grant of this request will not prejudice either party, but will further their mutual interest and hopefully avoid the need to file a petition and proceed to a formal administrative hearing.

WHEREFORE, Seminole respectfully requests that the time for filing of a Petition for Administrative Proceedings in regard to the Department's Intent to Issue Title V Air Operation Permit for Revised Draft Permit No. 1070025-001-AV be formally extended to and including November 1, 1998. If the Department denies this Request, Seminole requests the opportunity to file a Petition for Administrative Proceeding within 10 days of such denial.

Respectfully submitted this 30 day of September, 1998.

HOPPING GREEN SAMS & SMITH, P.A.

By: Robert A. Manning

Robert A. Manning

Fla. Bar No. 0035173

123 South Calhoun Street

Post Office Box 6526

Tallahassee, FL 32314

(850) 222-7500

Attorneys for SEMINOLE ELECTRIC  
COOPERATIVE, INC.

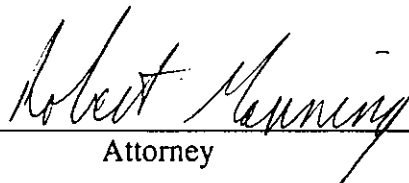
**CERTIFICATE OF SERVICE**

I HEREBY CERTIFY that a copy of the foregoing has been furnished to the following  
by U.S. Mail on this 30 day of September, 1998:

Clair H. Fancy, P.E., Chief  
Bureau of Air Regulation  
Department of Environmental Protection  
2600 Blair Stone Road  
Tallahassee, FL 32399-2400

Ed Svec  
Bureau of Air Regulation  
Department of Environmental Protection  
2600 Blair Stone Road  
Tallahassee, FL 32399-2400

Jeff Brown, Esq.  
Department of Environmental Protection  
Room 669  
2600 Blair Stone Road  
Tallahassee, FL 32399-2400

  
\_\_\_\_\_  
Attorney

10/15/98

cc: Scott Sheplak  
Ed Svec



CELEBRATING

YEARS  
1948-1998

SERVING OUR MEMBER SYSTEMS

RECEIVED

OCT 05 1998

BUREAU OF  
AIR REGULATION

October 2, 1998

Mr. Scott Sheplak, P.E.  
Bureau of Air Regulation  
Florida Department of Environmental Protection  
2600 Blairstone Road  
Tallahassee, FL 32399-2400

Dear Mr. Sheplak:

Attached for your files is a copy of the " Proof of Publication " for the Seminole Electric Cooperative, Inc. Revised Draft Title V Permit Public Notice. The notice ran in the Palatka Daily News on September 4, 1998.

Sincerely,

A handwritten signature in black ink, appearing to read 'Mike Roddy'.

Mike Roddy  
Environmental Engineer

10/5/98 cc: Scott Sheplak  
Ed Svec

STATE OF FLORIDA \

: SS:

County of Putnam /

The undersigned personally appeared before me, a Notary Public for the State of Florida, and deposes that the Daily News is a daily newspaper of general circulation, printed in the English Language and published in the City of Palatka, in said County and State: and that the attached order, notice, publication and/or advertisement:

Legal No 29376

PUBLIC NOTICE OF INTENT TO ISSUE TITLE

was Published in said Newspaper 1 time(s), said publication being made on the following dates:

09/04/98

The Daily News has been continuously published as a daily newspaper, and has been entered as second class matter at the post office at the City of Palatka. Putnam County, Florida, each for a period of more than one year next preceding date of the first publication of the above described order, notice, publication and/or advertisement.

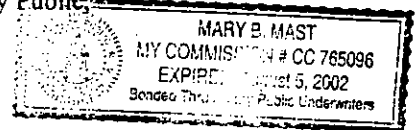
Mary Collins

Sworn to and subscribed before me this September 4, 1998 by, Tracy Collins Classified Phone Sales Coordinator of the Daily News, a Florida corporation, on behalf of the corporation.

Mary B. Mast

Mary B. Mast, Notary Public,  
State of Florida

NOTARY SEAL  
SEAL OF OFFICE:



X Personally known to me, or

       Produced Identification:

x Did take an oath

Name: Seminole Electric Coop., Inc.  
Address: P.O. Box 272000

Ad #: 29376

City: Tampa

State: FL

Zip: 33688-2000

Pub Times: 1

Class: 350

Legal Notices

Price: 233.53  
Prepaid: 0.00  
Balance: 233.53

# PUBLIC NOTICE

## PUBLIC NOTICE OF INTENT TO ISSUE TITLE V AIR OPERATION PERMIT

STATE OF FLORIDA  
DEPARTMENT OF  
ENVIRONMENTAL  
PROTECTION

Title V Revised DRAFT  
Permit No.: 1070025 001-AV  
Seminole Power Plant  
Putnam County

The Department of Environmental Protection (permitting authority) gives notice of its intent to issue a Title V air operation permit to Seminole Electric Cooperative, Inc. for the Seminole Power Plant located east of U.S. Highway 17, approximately seven miles north of Palatka, Putnam County. The applicant's name and address are: Seminole Electric Cooperative, Inc., 15313 North Dale Mabry Highway, Tampa, Florida 33618. The permitting authority will issue the Title V PROPOSED Permit, and subsequent Title V FINAL Permit, in accordance with the conditions of the Title V Revised DRAFT Permit unless a response received in accordance with the following procedures results in a different decision or significant change of terms or conditions. The permitting authority will accept written comments concerning the proposed Title V Revised DRAFT Permit issuance action for a period of 30 (thirty) days from the date of publication of this Notice. Written comments should be provided to the Department's Bureau of Air Regulation, 2500 Blair Stone Road, Mail Station #5505, Tallahassee, Florida 32399 2100. Any written comments filed shall be made available for public inspection. If written comments received result in a significant change in this Revised DRAFT Permit, the permitting authority shall issue another Revised DRAFT Permit and require, if applicable, another Public Notice. A person whose substantial interests are affected by the proposed permitting decision may petition for an

administrative hearing in accordance with Sections 120.569 and 120.57 of the Florida Statutes (F.S.). The petition must contain the information set forth below and must be filed (received) in the Office of General Counsel of the Department of Environmental Protection, 3800 Commonwealth Boulevard, Mail Station #35, Tallahassee, Florida 32399-3000 (Telephone: 850/488-9730; Fax: 850/487-4938). Petitions filed by any person other than those entitled to written notice under Section 120.56(3), F.S., must be filed within fourteen days of publication of the public notice or within fourteen days of receipt of the notice of intent, whichever occurs first. Under Section 120.56(3), F.S., however, any person who asked the permitting authority for notice of agency action may file a petition within fourteen days of receipt of that notice, regardless of the date of publication. A petitioner shall mail a copy of the petition to the applicant at the address indicated above, at the time of filing. The failure of any person to file a petition within the applicable time period shall constitute a waiver of that person's right to request an administrative determination (hearing) under Sections 120.569 and 120.57, F.S., or to intervene in this proceeding and participate as a party to it. Any subsequent intervention will be only at the approval of the presiding officer upon the filing of a motion in compliance with Rule 29-106.205 of the Florida Administrative Code (F.A.C.). A petition that disputes the material facts on which the permitting authority's action is based must contain the following information: (a) The name and address of each agency affected and each agency's file or identification number, if known; (b) The name, address and telephone number of the petitioner, name address and telephone number of the petitioner's representative, if any, which shall be the address for service purposes during the course of the proceedings; and an explanation of how petitioner's substantial

rights will be affected by the agency determination; (c) A statement of how and when the petitioner received notice of the agency action or proposed action; (d) A statement of all disputed issues of material fact. If there are none, the petition must so state; (e) A concise statement of the ultimate facts alleged, as well as the rules and statutes which entitle petitioner to relief; and (f) A demand for relief. A petition that does not dispute the material facts upon which the permitting authority's action is based shall state no such facts are in dispute and otherwise shall contain the same information as set forth above, as required by Rule 29-106.301, F.A.C. Because the administrative hearing process is designed to formulate agency action, the filing of a petition means that the permitting authority's final action may be different from the position taken by it in this notice of intent. Persons whose substantial interests will be affected by any such final decision of the permitting authority on the application have the right to petition to become a party to the proceeding, in accordance with the requirements set forth above. Mediation is not available for this proceeding. In addition to the above, pursuant to 42 United States Code (U.S.C.) Section 7661d(b)(2), any person may petition the Administrator of the EPA within 60 (sixty) days of the expiration of the Administrator's 45 (forty-five) day review period as established at 42 U.S.C. Section 7661d(b)(1), to object to issuance of any permit. Any petition shall be based only on objections to the permit that were raised with reasonable specificity during the 30 (thirty) day public comment period provided in this notice, unless the petitioner demonstrates to the Administrator of the EPA that it was impracticable to raise such objections within the comment period or unless the grounds for such objection arose after the comment period. Filing of a petition with the Administrator of the EPA

does not stay the effective date of any permit properly issued pursuant to the provisions of Chapter 62-213, F.A.C. Petitions filed with the Administrator of EPA must meet the requirements of 42 U.S.C. Section 7661d(b)(2) and must be filed with the Administrator of the EPA at U.S. EPA, 401 M Street, S.W., Washington, D.C. 20460. A complete project file is available for public inspection during normal business hours, 8:00 a.m. to 5:00 p.m., Monday through Friday, except legal holidays, at:

Permitting Authority:  
Department of  
Environmental  
Protection  
Bureau of Air Regulation  
111 South Magnolia Drive  
Suite 4  
Tallahassee, Florida 32301  
Telephone: 904/488-1344  
Fax: 850/922-6978

Affected District/Local  
Program  
Department of  
Environmental  
Protection  
Northeast District Office  
7825 Baymeadows Way,  
Suite 200B  
Jacksonville, FL 32256-7590  
Telephone: 904/448-4300  
Fax: 904/448-4363

The complete project file includes the Revised DRAFT Permit, the application, and the information submitted by the responsible official, exclusive of confidential records under Section 403.111, F.S. Interested persons may contact Scott M. Sheplek, P.E., at the above address, or call 850/921-3632, for additional information.

Legal NO. 29376 9/4/98

THE STATE OF FLORIDA  
DEPARTMENT OF ENVIRONMENTAL PROTECTION

In the Matter of an  
Application for Permit by:

OGC CASE NO.:

FDEP Revised Draft Permit No.: 1070025-001-AV

Seminole Electric Cooperative, Inc.  
Seminole Power Plant  
Putnam County, Florida

---

**REQUEST FOR EXTENSION OF TIME**

By and through undersigned counsel, Seminole Electric Cooperative, Inc. (Seminole) hereby requests, pursuant to Florida Administrative Code Rule 62-110.106(4), an enlargement of time, to and including November 1, 1998, in which to file a Petition for Administrative Proceedings in the above-styled matter. As good cause for granting this request, Seminole states the following:

1. On or about September 12, 1997, Seminole received from the Department of Environmental Protection (Department) an "Intent to Issue Title V Air Operation Permit" (Draft Permit No. 1070025-001-AV) for the Seminole Power Plant located in Putnam County, Florida. Seminole subsequently filed several extensions of time, until September 30, 1998, to preserve its right to file a Petition for Administrative Proceeding on this permit.

2. On or about August 20, 1998, Seminole received from the Department an "Intent to Issue Title V Air Operation Permit" (**REVISED** Draft Permit No. 1070025-001-AV) for the Seminole Power Plant. The Department issued this Revised Draft based on progressing

negotiations and the need to include additional applicable requirements pursuant to the Acid Rain program.

3. Mr. Scott Sheplak of the Department's Bureau of Air Regulation informed Seminole that the initial Draft Title V permit was effectively withdrawn upon the issuance of the Revised Draft Title V permit, and therefore no further proceedings could occur on the initial Draft permit. In reliance on this representation, Seminole filed its first Request for Extension of Time on the Revised Draft permit, and understood that no further extensions of time would be needed to preserve its rights in relation to the initial Title V permit because it has been effectively withdrawn. Nonetheless, insofar as the initial Draft Title V permit may be determined to still be in effect, Seminole respectfully requests that this second Request for Extension of Time apply to both the initial and the Revised Draft Title V permits.

4. Based on Seminole's review, the Revised Draft permit and associated documents contain several provisions that warrant clarification or correction.

5. This request is filed simply as a protective measure to avoid waiver of Seminole's right to challenge certain conditions contained in the Revised Draft Title V permit. Grant of this request will not prejudice either party, but will further their mutual interest and hopefully avoid the need to file a petition and proceed to a formal administrative hearing.

WHEREFORE, Seminole respectfully requests that the time for filing of a Petition for Administrative Proceedings in regard to the Department's Intent to Issue Title V Air Operation Permit for Revised Draft Permit No. 1070025-001-AV be formally extended to and including November 1, 1998. If the Department denies this Request, Seminole requests the opportunity to file a Petition for Administrative Proceeding within 10 days of such denial.

Respectfully submitted this 30 day of Sepetember, 1998.

HOPPING GREEN SAMS & SMITH, P.A.

By: Robert A. Manning

Robert A. Manning  
Fla. Bar No. 0035173  
123 South Calhoun Street  
Post Office Box 6526  
Tallahassee, FL 32314  
(850) 222-7500

Attorneys for SEMINOLE ELECTRIC  
COOPERATIVE, INC.

**CERTIFICATE OF SERVICE**

I HEREBY CERTIFY that a copy of the foregoing has been furnished to the following  
by U.S. Mail on this 30 day of September, 1998:

Clair H. Fancy, P.E., Chief  
Bureau of Air Regulation  
Department of Environmental Protection  
2600 Blair Stone Road  
Tallahassee, FL 32399-2400

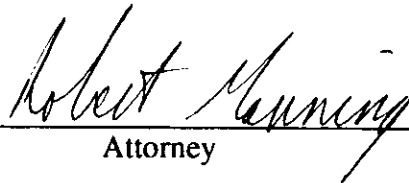
Ed Svec  
Bureau of Air Regulation  
Department of Environmental Protection  
2600 Blair Stone Road  
Tallahassee, FL 32399-2400

Jeff Brown, Esq.  
Department of Environmental Protection  
Room 669  
2600 Blair Stone Road  
Tallahassee, FL 32399-2400

**RECEIVED**

OCT 01 1998

BUREAU OF  
AIR REGULATION

  
\_\_\_\_\_  
Attorney



RECEIVED

SEP 14 1998

BUREAU OF  
AIR REGULATION

September 14, 1998

Mr. Scott M. Sheplak, P.E.  
Bureau of Air Regulation  
Florida Department of Environmental Protection  
2600 Blair Stone Road  
Tallahassee, FL 32399-2400

RE: Seminole Electric Cooperative, Inc.  
Revised DRAFT Title V Permit No. 1070025-001-AV

Dear Mr. Sheplak:

On behalf of Seminole Electric Cooperative, Inc. (Seminole), attached are comments on the Revised Draft Title V permit for the Seminole Power Plant. Seminole appreciates the Department's cooperation and attention thus far in processing this Title V permit, and looks forward to continuing to process this permit as expeditiously as possible. In this regard, Seminole has requested an Extension of Time until September 30, 1998 to resolve the issues contained herein. If this does not provide sufficient time, Seminole intends to request an additional extension request.

Also, Seminole published the Intent to Issue the Revised Draft Title V permit in the Palatka Daily News on September 4, 1998. We will forward a copy of the proof of publication as soon as we receive it.

After you have reviewed these comments, please contact me at your earliest convenience at (813)963-0994.

Sincerely,

*for Robert Manning*  
Mike Roddy  
Environmental Engineer

cc: Mike Opalinski  
Clair Fancy, P.E., DEP  
Ed Svec, DEP  
Tom Davis, P.E., ECT  
Robert Manning, HGSS

9/14/98 cc: *scott sheplak*

**SEMINOLE ELECTRIC COOPERATIVE  
COMMENTS ON REVISED DRAFT TITLE V PERMIT  
SEMINOLE POWER PLANT**

**Section I., Facility Information, Subsection B.**

1. Seminole included the following activities in its list of exempt/insignificant activities in its Title V application, and therefore certified that they meet the criteria under Rule 62-213.430(6), F.A.C. These activities are also exempt pursuant to Rule 62-210.300(3)(a)20., F.A.C., and Rule 62-210.300(3)(a)21., F.A.C. Accordingly, Seminole requests the deletion of the following two activities listed as Unregulated Emission Units and/or Activities.

~~xxx---One or more emergency generators not subject to the Acid Rain Program--~~  
~~xxx---One or more heating units and general purpose internal combustion~~  
~~engines not subject to the Acid Rain Program~~

**Section II., Facility-wide Conditions.**

1. Condition 8. Seminole appreciates the Department's response to our comments on the initial Draft Title V permit, specifically the Department's acknowledging that the reasonable precautions "will be employed as necessary."

**Section III. Subsection A.**

1. Condition A.3. For clarification, Seminole requests the following revisions to this condition to ensure that the limitations are applied on a per-unit basis: "The only fuels allowed to be fired in each unit are coal . . . . The maximum weight of petroleum coke burned in each unit shall not exceed . . . Also the regulatory citation for this condition should either be deleted or include a specific citation to Rule 62-213.410(1), F.A.C.

2. Conditions A.5. and A.6. Seminole requests the combination of these two Conditions as follows to clarify that the 0.03 lb/MMBtu PM limit applies to all solid and liquid fuels (i.e., coal, coal and petroleum coke blends, No. 2 fuel oil, and on-specification used oil). Compliance provisions are addressed separately in Condition A.24 and therefore need not be repeated in Condition A.5.

Particulate Matter (All Solid and Liquid Fuels). No owner or operator shall cause to be discharged into the atmosphere when combusting solid and/or liquid fuels ~~a coal and petroleum coke blend~~ any gases which contain particulate matter in excess of 13 ng/J (0.03 lb/million Btu) heat input, and one percent of the potential combustion concentration (99 percent reduction) when combusting solid fuels, and 30 percent of the potential combustion concentration (70 percent reduction) when combusting liquid fuels. [40 CFR 60.42a(a) and PSD-FL-018(A)]

3. Condition A.8. Seminole requests the following revision to Condition A.8.(1) to add the NSPS Subpart Da SO<sub>2</sub> 90 percent reduction requirement for coal firing. Condition A.8.(3) emission limits only apply to liquid or gaseous fuel combustion per 40 CFR 60.43a(b) and therefore should be deleted from Condition A.8. which addresses SO<sub>2</sub> emission limits for coal only.

(1) 520 ng/J (1.20 lb/million Btu) heat input and 10 percent of the potential combustion concentration (90 percent reduction), or

4. Condition A.9. Seminole requests the following revision to Condition A.9.(1) adds the NSPS Subpart Da SO<sub>2</sub> 90 percent reduction requirement for liquid fuel combustion:

(1) 340 ng/J (0.80 lb/million Btu) heat input and 10 percent of the potential combustion concentration (90 percent reduction), or

5. Condition A.10. This condition has been superseded by NSPS Subpart Da requirements and therefore is obsolete and should be deleted.

6. Condition A.15 and A.17. Seminole requests the following revisions to clarify the NSPS Subpart Da requirements and combine Conditions A.15 and A.17. Compliance provisions are addressed separately in Condition A.25 and therefore need not be repeated in Condition A.15.

No owner or operator subject to the provisions of 40 CFR 60, Subpart Da shall cause to be discharged into the atmosphere from any affected facility any gases which contain nitrogen oxides in excess of the following emission limits, based ~~on a 30-day rolling average~~.

(1) NO<sub>x</sub> emissions limits:

(a) Bituminous coal emission limit for heat input: 260 ng/J (0.60 lb/million Btu) heat input determined on a 30-day rolling average when combusting bituminous coal or bituminous coal and petroleum coke blends;

(b) All other liquid fuels emission limit for heat input: 130 ng/J (0.30 lb/million Btu) heat input determined on a 30-day rolling average when combusting liquid fuels, and

(c) 0.50 lb/MMBtu heat input determined on an annual average basis, when subject to the 40 CFR 76.8 Early Election Program for Group 1, Phase II Boilers or in any year when petroleum coke is burned.

(2) NO<sub>x</sub> reduction requirement. Solid fuels: 65 percent reduction of potential combustion concentration; Liquid fuels: 30 percent reduction of potential combustion concentration. [40 CFR 60.44a(a)(1) & (2) and PSD-FL-018(A)]

7. Condition A.19. This Condition should be deleted because it is not included in the PSD Final Determination.

8. Condition A.21 and A.22. These Conditions should be deleted because these units are subject to NSPS or NSPS-derived limits and are therefore only subject to the NSPS excess emission provisions; the state excess emission provisions do not apply. It is not appropriate to subject a unit that must comply with an NSPS or NSPS-derived limit, which was established by taking into account the NSPS excess emission provisions, to a more stringent state developed excess emission provision. Moreover, in DEP's June 12, 1998 response to an FCG comment letter, DEP stated that the excess emissions provisions under Rule 62-210.700, F.A.C. do not apply to NSPS emission limits.

9. Condition A.50. Seminole requests the following amendments to this Condition:  
(i) Condition A.50.(a)1. should be deleted. Units 1 and 2 are subject to annual compliance testing for PM. Sampling time for PM testing is specified in Condition A.42.(2)(i). Having two conditions which address the same issue is redundant and potentially confusing.

(ii) Condition A.50.(a)2.a. is not applicable because Units 1 and 2 are not batch, cyclical processes or operations which are normally completed within less than the minimum observation period.

(iii) Condition A.50.(a)2.c. addresses requirements pertinent to FDEP employees or their agents and therefore should not be included in the Title V permit; i.e., the requirements do not apply to Seminole.

(iv) Condition A.50.(b) should be deleted. Units 1 and 2 are subject to annual compliance testing for PM. Sampling volume for PM testing is specified in Condition A.42.(2)(i). Having two conditions which address the same issue is redundant and potentially confusing.

10. Condition A.52. Because Condition A.52(a) is a specific condition that only applies to Units 1 and 2, the requested condition revisions state only the specific requirements for these emission units; i.e., eliminates generic language. The requested revisions to Condition A.52.(a)(4) clarify that annual testing is only required for PM. Because compliance with the remaining regulated pollutants for Units 1 and 2 (i.e., SO<sub>2</sub>, NO<sub>x</sub>, and visible emissions) are determined continuously using CEMS, performing an annual compliance test for these two pollutants is not necessary. The SO<sub>2</sub> and NO<sub>x</sub> CEMS are operated, maintained, and certified pursuant to 40 CFR Part 75 requirements, including an annual Relative Accuracy Test Audit (RATA) using EPA reference methods.

The following provisions apply only to Units 1 and 2. ~~emissions units that are subject to an emissions-limiting standard for which compliance testing is required.--~~

(a) General Compliance Testing.

~~2.-- For excess emission limitations for particulate matter specified in Rule 62-210.700, F.A.C., a compliance test shall be conducted--~~

~~annually while the emissions unit is operating under soot blowing conditions in each federal fiscal year during which soot blowing is part of normal emissions unit operation; except that such test shall not be required in any federal fiscal year in which a fossil fuel steam generator does not burn liquid and/or solid fuel for more than 400 hours other than during startup.~~

3-1. a A compliance test that demonstrates compliance with the applicable particulate matter and visible emission limiting standards specified in Condition A.5. and Condition A.7. shall be submitted to the Department prior to obtaining a renewed operation permit. ~~Emissions units that are required to conduct an annual compliance test may submit t~~ The most recent annual compliance test may be submitted to satisfy the requirements of this provision. In renewing an air operation permit pursuant to Rule 62-210.300(2)(a)3.b., c., or d., F.A.C., the Department shall not require submission of emission compliance test results for Units 1 and 2 if the units ~~any emissions unit that~~, during the year prior to renewal:

- a. Did not operate; or
- b. ~~In the case of a fuel burning emissions unit; b~~ Burned liquid and/or solid fuel for a total of no more than 400 hours.

4-2. During each federal fiscal year (October 1 - September 30), unless otherwise specified by rule, order, or permit, the owner or operator of each emissions unit shall have a formal compliance test conducted for:

- a. ~~Visible emissions; if there is an applicable standard; and~~
- b. ~~Particulate Matter. Each of the following pollutants; if there is an applicable standard; and if the emissions unit emits or has the potential to emit: 5 tons per year or more of lead or lead compounds measured as elemental lead; 30 tons per year or more of acrylonitrile; or 100 tons per year or more of any other regulated air pollutant; and~~
- c. ~~Each NESHAP pollutant; if there is an applicable emission standard.~~

5-3. An annual compliance test for particulate matter or visible emissions shall not be required ~~for if a unit the any fuel burning emissions unit that~~, in a federal fiscal year, does not burn liquid and/or solid fuel, other than during startup, for a total of more than 400 hours.

9-4. The owner or operator shall notify the Department, at least 15 days prior to the date on which each formal compliance test is to begin, of the date, time, and place of each such test, and the test contact person who will be responsible for coordinating and having such test conducted for the owner or operator.

### Section III. Subsection B. Railcar Maintenance Facility

1. Condition B.9. Seminole requests the following revisions because Condition B.9 is a specific condition that only applies to the railcar maintenance emission unit. The requested revisions state only the specific requirements for this emission unit; i.e., eliminates generic language.

The following provisions apply only to the railcar maintenance emission unit. ~~those emissions units that are subject to an emissions limiting standard for which compliance testing is required.~~

(a) General Compliance Testing.

~~3.1. The owner or operator of an emissions unit that is subject to any emission limiting standard shall conduct a~~ A compliance test that demonstrates compliance with the applicable visible emission limiting standard specified in Condition B.3. shall be conducted and submitted to the Department prior to obtaining a renewed operation permit. ~~Emissions units that are required to conduct an annual compliance test may submit t~~ The most recent annual compliance test may be submitted to satisfy the requirements of this provision. In renewing an air operation permit pursuant to Rule 62-210.300(2)(a)3.b., c., or d., F.A.C., the Department shall not require submission of emission compliance test results if the railcar maintenance emission unit did not operate ~~for any emissions unit that~~; during the year prior to renewal ~~a. did not operate;~~

~~4.2. During each federal fiscal year (October 1 - September 30), unless otherwise specified by rule, order, or permit, the owner or operator of each emissions unit shall have a formal compliance test~~ shall be conducted for:--a. visible emissions:--if there is an applicable standard;

~~9.3. The owner or operator shall notify t~~The Department shall be notified, at least 15 days prior to the date on which each formal compliance test is to begin, of the date, time, and place of each such test, and the test contact person who will be responsible for coordinating and having such test conducted for the owner or operator.

2. Condition B.11. Seminole requests the following revisions state the specific VE test reporting requirements applicable to the railcar maintenance emission unit.

~~(a) The owner or operator of an emissions unit for which a compliance test is required shall file a report with the Department on the results of each such test.~~

~~(b) ----The required test report shall be filed with the Department as soon as practical but no later than 45 days after the last sampling run of each test is completed.~~

The results of each visible emission compliance test shall be filed with the Department in a test report as soon as practical but no later than 45 days after the last sampling run of each test is completed. [Rule 62-297.310(8), F.A.C.]

### **Section III. Subsection D - Limestone and FGD Sludge Handling and Storage System**

1. Condition D.10. Seminole requests the following revisions to state the specific VE test reporting requirements applicable to the limestone and FGD sludge handling and storage emission unit:

#### Test Reports.

~~(a)-----The owner or operator of an emissions unit for which a compliance test is required shall file a report with the Department on the results of each such test.~~

~~(b)-----The required test report shall be filed with the Department as soon as practical but no later than 45 days after the last sampling run of each test is completed.~~

The results of each visible emission compliance test shall be filed with the Department in a test report as soon as practical but no later than 45 days after the last sampling run of each test is completed. [Rule 62-297.310(8), F.A.C.]

### **Section IV. Acid Rain Part**

1. Condition A.4. This Condition applies to all of the Conditions in this Title V Permit, and not just the Acid Rain Conditions, and therefore this Condition should be moved to the facility wide section of this Permit.

2. It is unclear that the early election NO<sub>x</sub> requirements will apply after this permit becomes effective. The Conditions which state that the compliance plan applies from 2000 to 2007 is contained in the Phase I part of the permit, which states that it governs the units until December 31, 1999. Perhaps the NO<sub>x</sub> requirements should be included in the Phase II part of the permit as well.

### **Appendix U-1, List of Unregulated Emission Units and/or Activities**

1. Transfer deleted activities to Appendix E-1:

~~---One or more emergency generators not subject to the Acid Rain Program~~  
~~---One or more heating units and general purpose internal combustion engines not subject to the Acid Rain Program~~

The listed activities (emergency generators and heating units and general purpose internal combustion engines) were certified in the Title V application to meet the criteria of Rule 62-213.430(6), F.A.C., and are exempt pursuant to Rules 62-210.300(3)(a)20., F.A.C. and Rule 62-210.300(3)(a)21., F.A.C.

## APPENDIX E-1, List of Exempt Emission Units and/or Activities

1. Add Items 16. through and 18. as follows:
  16. One or more emergency generators which are not subject to the Acid Rain Program and have total fuel consumption, in the aggregate, of 32,000 gallons per year or less of diesel fuel, 4,000 gallons per year or less of gasoline, and 4.4 million cubic feet per year or less of natural gas or propane, or an equivalent prorated amount if multiple fuels are used.
  17. One or more heating units and general purpose internal combustion engines which are not subject to the Acid Rain Program and have total fuel consumption, in the aggregate, of 32,000 gallons per year or less of diesel fuel, 4,000 gallons per year or less of gasoline, and 4.4 million cubic feet per year or less of natural gas or propane, or an equivalent prorated amount if multiple fuels are used.
  17. Surface coating operations utilizing only coatings containing 5.0 percent or less VOCs, by volume.

The additional activities listed above were included in the Title V application and are specifically exempt pursuant to Rules 62-210.300(3)(a)20., 21., 24., and 26., F.A.C.

### Table 1-1, Summary of Air Pollutant Standards and Terms

1. Page 1 of 4. The heading to the Table under Allowable Emissions should include the parenthetical (per unit). Also, the standard for SO<sub>2</sub>, for coal and petcoke blend, should include a footnote to include the formula in Condition A.13. Also, the listed standards for SO<sub>2</sub>, for coal and petcoke, should contain a notation that they are for petcoke only and the correct standard for coal for Units 1 and 2 is 1.2 pounds per MMBtu.

### Table 2-1, Summary of Compliance Requirements

1. Page 1 of 4. In accordance with the authority for Seminole to utilize either CMS or Method 9 for the compliance method for VE, the testing time frequency should be revised. For SO<sub>2</sub> and NO<sub>x</sub>, the annual testing time frequency and one hour minimum compliance test duration notation should also be deleted. Finally, the testing for CO and H<sub>2</sub>SO<sub>4</sub> should contain a footnote which states that this testing frequency only applies for 5 years from the initiation of petcoke firing, in accordance with Conditions A.69 and A.70.

### Periodic Monitoring

1. For SO<sub>2</sub>, NO<sub>x</sub>, and opacity, Seminole requests the inclusion of the following sentence in the Statement of Basis for the permit (Seminole requests that this language not be included as a condition in the permit):

"For purposes of periodic monitoring for the pollutants SO<sub>2</sub>, NO<sub>x</sub>, and opacity, the permittee will utilize continuous emission monitors, which are otherwise required by the Acid Rain program and/or 40 CFR Part 60."

2. For particulate matter, Seminole is researching what degree of monitoring should be considered sufficient, based on historical compliance data. Seminole will forward its proposal regarding particulate matter as soon as our research is completed.

**RECEIVED**

SEP 01 1998

THE STATE OF FLORIDA  
DEPARTMENT OF ENVIRONMENTAL PROTECTION

BUREAU OF  
AIR REGULATION

In the Matter of an  
Application for Permit by:

OGC CASE NO.:

FDEP Revised Draft Permit No.: 1070025-001-AV

Seminole Electric Cooperative, Inc.  
Seminole Power Plant  
Putnam County, Florida

---

**REQUEST FOR EXTENSION OF TIME**

By and through undersigned counsel, Seminole Electric Cooperative, Inc. (Seminole) hereby requests, pursuant to Florida Administrative Code Rules 28-106.111(3) and 62-103.050(1), an extension of time, to and including September 30, 1998, in which to file a Petition for Administrative Proceedings in the above-styled matter. As good cause for granting this request, Seminole states the following:

1. On or about September 12, 1997, Seminole received from the Department of Environmental Protection (Department) an "Intent to Issue Title V Air Operation Permit" (Draft Permit No. 1070025-001-AV) for the Seminole Power Plant located in Putnam County, Florida. Seminole subsequently filed several extensions of time, until August 31, 1998, to preserve its right to file a Petition for Administrative Proceeding on this permit.

2. On or about August 20, 1998, Seminole received from the Department an "Intent to Issue Title V Air Operation Permit" (**REVISED** Draft Permit No. 1070025-001-AV) for the Seminole Power Plant. The Department issued this Revised Draft based on progressing

negotiations and the need to include additional applicable requirements pursuant to the Acid Rain program.

3. Mr. Scott Sheplak of the Department's Bureau of Air Regulation informed Seminole that the initial Draft Title V permit was effectively withdrawn upon the issuance of the Revised Draft Title V permit, and therefore no further proceedings could occur on the initial Draft permit. In reliance on this representation, Seminole hereby files this Request for Extension of Time on the Revised Draft permit, and understands that no further extensions of time are needed to preserve its rights in relation to the initial Title V permit because it has been effectively withdrawn. Nonetheless, insofar as the initial Draft Title V permit may be determined to still be in effect, Seminole respectfully requests that this Request for Extension of Time apply to both the initial and the Revised Draft Title V permits.

4. Based on Seminole's review, the Revised Draft permit and associated documents contain several provisions that warrant clarification or correction.

5. This request is filed simply as a protective measure to avoid waiver of Seminole's right to challenge certain conditions contained in the Revised Draft Title V permit. Grant of this request will not prejudice either party, but will further their mutual interest and hopefully avoid the need to file a petition and proceed to a formal administrative hearing.

6. Mr. Scott Sheplak has agreed to an extension on behalf of the Department until September 30, 1998.

WHEREFORE, Seminole respectfully requests that the time for filing of a Petition for Administrative Proceedings in regard to the Department's Intent to Issue Title V Air Operation

Permit for Revised Draft Permit No. 1070025-001-AV be formally extended to and including September 30, 1998.

Respectfully submitted this 31<sup>st</sup> day of August, 1998.

HOPPING GREEN SAMS & SMITH, P.A.

By: Robert A. Manning

Robert A. Manning  
Fla. Bar No. 0035173  
123 South Calhoun Street  
Post Office Box 6526  
Tallahassee, FL 32314  
(850) 222-7500

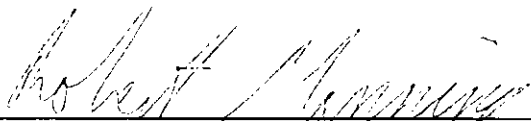
Attorneys for SEMINOLE ELECTRIC  
COOPERATIVE, INC.

**CERTIFICATE OF SERVICE**

I HEREBY CERTIFY that a copy of the foregoing has been furnished to the following  
by U.S. Mail on this 31<sup>st</sup> day of August, 1998:

Clair H. Fancy, P.E., Chief  
Bureau of Air Regulation  
Department of Environmental Protection  
2600 Blair Stone Road  
Tallahassee, FL 32399-2400

Jeff Brown, Esq.  
Department of Environmental Protection  
Room 669  
2600 Blair Stone Road  
Tallahassee, FL 32399-2400

  
\_\_\_\_\_  
Attorney

Date: 8/21/98 8:26:23 AM  
From: Mary Fillingim TAL  
Subject: New Posting #1070025  
To: See Below

There is a new posting on Florida's website.



1070025001AV  
SEMINOLE POWER PLANT

Draft

The notification letter is encoded and attached. If you have any questions  
feel free to contact me.

Thanks, Mary

## **Florida's DRAFT Permit Electronic Notification Cover Memorandum**

**TO:** Gracy Danois, U.S. EPA Region 4  
**CC:** Carla E. Pierce, U.S. EPA Region 4  
**THRU:** Scott Sheplak P.E., Bureau of Air Regulation   
**FROM:** Edward J. Svec, Permit Engineer   
**DATE:** 08/20/98  
**RE:** U.S. EPA Region 4 Revised DRAFT Title V Operation Permit Review

The following Revised DRAFT Title V operation permit(s) and associated documents have been posted on the DEP World Wide Web Internet site for your review. Please provide any comments via Internet E-mail, to Scott Sheplak, at "Sheplak\_S@dep.state.fl.us".

<u>Applicant Name</u>	<u>County</u>	<u>Method of Transmittal</u>	<u>Electronic File Name(s)</u>
Seminole Electric Cooperative Seminole Power Plant	Putnam	INTERNET	1070025r.zip

This zipped file contains the following electronic files:

sob.doc  
1070025i.doc  
1070025r.doc  
10700251.xls  
10700252.xls  
1070025g.doc  
1070025u.doc  
1070025h.doc

MEMORANDUM

TO: Scott Sheplak, P.E.  
FROM: Edward J. Svec  
DATE: August 11, 1998



Re: Intent package for Revised DRAFT Permit No.: 1070025-001-AV  
Seminole Electric Cooperative, Inc.  
Seminole Power Plant

**Permit Clock:** Today is ARMS Day 29  
**Day 90:** October 1, 1998

This Revised DRAFT incorporates our responses to Seminole Electric's comments plus it incorporates the Phase I/II NO<sub>x</sub> requirements of the Acid Rain Program. This permit is for the initial Title V air operation permit for the subject facility.

This facility consists of two 714.6 megawatt, electric, coal fired steam electric generators; a coal handling and storage system; a limestone unloading, handling and storage system; a flue gas desulfurization (FGD) sludge stabilization system; and a rail car maintenance facility. The facility elected into the Phase I NO<sub>x</sub> program.

No additional information was requested of the applicant. Comments were not received from the District office.

This facility reported that each emissions unit was in compliance at the time of the application.

I recommend that this Intent to Issue be sent out as attached.

SS/es

[electronic file name: memo-d.doc]

## **STATEMENT OF BASIS**

Seminole Electric Cooperative, Inc.  
Seminole Power Plant  
**Facility ID No.:** 1070025  
Putnam County

Initial Title V Air Operation Permit  
**Revised DRAFT Permit No.:** 1070025-001-AV

This Title V air operation permit is issued under the provisions of Chapter 403, Florida Statutes (F.S.), and Florida Administrative Code (F.A.C.) Chapters 62-4, 62-210, 62-213, and 62-214. The above named permittee is hereby authorized to perform the work or operate the facility shown on the application and approved drawing(s), plans, and other documents, attached hereto or on file with the permitting authority, in accordance with the terms and conditions of this permit.

This facility consists of two 714.6 megawatt, electric, coal fired steam electric generators; a coal handling and storage system; a limestone unloading, handling and storage system; a flue gas desulfurization (FGD) sludge stabilization system; and a rail car maintenance facility.

Steam Electric Generator Nos. 1 and 2 are coal fired utility, dry bottom wall-fired boilers, each having a generator nameplate rating of 714.6 megawatts, electric. The maximum heat input to each emissions unit is 7,172 million Btu per hour. Steam Electric Generator Nos. 1 and 2 are each equipped with an electrostatic precipitator (ESP) to control particulate matter, a wet limestone flue gas desulfurization (FGD) unit to control sulfur dioxide, and low NO<sub>x</sub> burners, and low excess-air firing to control nitrogen oxides.

The rail car maintenance facility consists of an abrasive blasting area and a surface coating operation.

The coal receiving, storage and transfer systems at the coal storage yard support the operation of the two power boilers. Particulate matter emissions are controlled at the "as-received transfer tower", the "as-fired transfer tower", and the conveyors to the silos by fabric filter systems. Water sprays, full enclosures or partial enclosures are also utilized, where appropriate.

The limestone and FGD sludge handling and storage system consists of a limestone unloading facility where particulate matter emissions are controlled by a panel filter, a limestone handling and storage system which utilizes a partial enclosure to control particulate matter emissions, and a FGD sludge stabilization system which controls emissions by utilizing bag house filters and scrubbers.

Also included in this permit are miscellaneous unregulated/insignificant emissions units and/or activities.

Based on the initial Title V permit application received June 17, 1996, this facility is a major source of hazardous air pollutants (HAPs).



# Department of Environmental Protection

Lawton Chiles  
Governor

Twin Towers Office Building  
2600 Blair Stone Road  
Tallahassee, Florida 32399-2400

Virginia B. Wetherell  
Secretary

## P.E. Certification Statement

**Permittee:**  
Seminole Electric Cooperative, Inc.  
Seminole Power Plant

**Revised DRAFT Permit No.:** 1070025-001-AV  
**Facility ID No.:** 1070025

**Project type:** Initial Title V Air Operation Permit

***I HEREBY CERTIFY** that the engineering features described in the above referenced application and subject to the proposed permit conditions provide reasonable assurance of compliance with applicable provisions of Chapter 403, Florida Statutes, and Florida Administrative Code Chapters 62-4 and 62-204 through 62-297. However, I have not evaluated and I do not certify aspects of the proposal outside of my area of expertise (including but not limited to the electrical, mechanical, structural, hydrological, and geological features).*

  
Scott M. Sheplak 08/20/98  
Scott M. Sheplak, P.E. date  
Registration Number: 0048866

Permitting Authority:  
Department of Environmental Protection  
Bureau of Air Regulation  
111 South Magnolia Drive, Suite 4  
Tallahassee, Florida 32301  
Telephone: 850/488-1344  
Fax: 850/922-6979



# Department of Environmental Protection

Lawton Chiles  
Governor

Twin Towers Office Building  
2600 Blair Stone Road  
Tallahassee, Florida 32399-2400

Virginia B. Wetherell  
Secretary

August 18, 1998

Mr. Richard Midulla  
Senior Vice President, Technical Division  
Seminole Electric Cooperative, Inc.  
16313 North Dale Mabry Highway  
Tampa, Florida 33618

Re: Revised DRAFT Title V Permit No.: 1070025-001-AV  
Seminole Power Plant


Dear Mr. Midulla:

One copy of the Revised DRAFT Title V Air Operation Permit for the Seminole Power Plant located east of U.S. Highway 17, approximately seven miles north of Palatka, Putnam County, is enclosed. The permitting authority's "INTENT TO ISSUE TITLE V AIR OPERATION PERMIT" is also included.

The "PUBLIC NOTICE OF INTENT TO ISSUE TITLE V AIR OPERATION PERMIT" must be published as soon as possible upon receipt of this letter. This issue is important in order for you to receive your Title IV Acid Rain permit by January 1, 1999, pursuant to the Clean Air Act and Section 403.0872, Florida Statutes. Proof of publication, i.e., newspaper affidavit, must be provided to the permitting authority's office within 7 (seven) days of publication. Failure to publish the notice and provide proof of publication within the allotted time may result in the denial of the permit.

Please submit any written comments you wish to have considered concerning the permitting authority's proposed action to Scott M. Sheplak, P.E., at the above letterhead address. If you have any other questions, please contact Edward J. Svec at 850/921-8985.

Sincerely,

  
C. H. Fancy, P.E.  
Chief  
Bureau of Air Regulation

CHF/s

Enclosures

cc: Ms. Carla E. Pierce, U.S. EPA, Region 4 (INTERNET E-mail Memorandum)  
Ms. Gracy Danois, U.S. EPA, Region 4 (INTERNET E-mail Memorandum)

PS Form 3800, April 1995

Z 333 638 494

**US Postal Service  
Receipt for Certified Mail**

No Insurance Coverage Provided.  
Do not use for International Mail (See reverse)

Sent to Mr. Richard Midulla	
Street & Number 16313 North Dale Mabry Hwy	
Post Office, State, & Zip Code Tampa, Florida 33618	
Postage	\$
Certified Fee	
Special Delivery Fee	
Restricted Delivery Fee	
Return Receipt Showing to Whom & Date Delivered	
Return Receipt Showing to Whom, Date, & Addressee's Address	
TOTAL Postage & Fees	\$

Postmark or Date  
8/18/98  
DRAFT Revised Permit  
Seminole - #1070025-001-AV

Is your RETURN ADDRESS completed on the reverse side?

**SENDER:**

- Complete items 1 and/or 2 for additional services.
- Complete items 3, 4a, and 4b.
- Print your name and address on the reverse of this form so that we can return this card to you.
- Attach this form to the front of the mailpiece, or on the back if space does not permit.
- Write "Return Receipt Requested" on the mailpiece below the article number.
- The Return Receipt will show to whom the article was delivered and the date delivered.

I also wish to receive the following services (for an extra fee):

- ☐ Addressee's Address
- ☐ Restricted Delivery

Consult postmaster for fee.

3. Article Addressed to:  
Mr. Richard Midulla  
Senior Vice President - Technical  
Division  
Seminole Electric Cooperative, Inc.  
16313 North Dale Mabry Highway  
Tampa, Florida 33618

4a. Article Number  
Z 333 638 494

4b. Service Type  
☐ Registered ☒ Certified  
☐ Express Mail ☐ Insured  
☐ Return Receipt for Merchandise ☐ COD

7. Date of Delivery  
8-20-98

5. Received By: (Print Name)

8. Addressee's Address (Only if requested and fee is paid)

6. Signature: (Addressee or Agent)  
X. Danese [Signature]

Thank you for using Return Receipt Service.

PS Form 3811, December 1994

102595-97-B-0179

Domestic Return Receipt

In the Matter of an  
Application for Permit by:

Seminole Electric Cooperative, Inc.  
16313 North Dale Mabry Highway  
Tampa, Florida 33618

---

Revised DRAFT Permit No.: 1070025-001-AV  
Seminole Power Plant  
Putnam County

### **INTENT TO ISSUE TITLE V AIR OPERATION PERMIT**

The Department of Environmental Protection (permitting authority) gives notice of its intent to issue a Title V air operation permit (copy of Revised DRAFT Permit enclosed) for the Title V source detailed in the application specified above, for the reasons stated below.

The applicant, Seminole Electric Cooperative, Inc., applied on June 17, 1996, to the permitting authority for a Title V air operation permit for the Seminole Power Plant located east of U.S. Highway 17, approximately seven miles north of Palatka, Putnam County. The permitting authority has permitting jurisdiction under the provisions of Chapter 403, Florida Statutes (F.S.), and Florida Administrative Code (F.A.C.) Chapters 62-4, 62-210, 62-213, and 62-214. This source is not exempt from Title V permitting procedures. The permitting authority has determined that a Title V air operation permit is required to commence or continue operations at the described facility.

The permitting authority intends to issue this Title V air operation permit based on the belief that reasonable assurances have been provided to indicate that operation of the source will not adversely impact air quality, and the source will comply with all appropriate provisions of Chapters 62-4, 62-204, 62-210, 62-212, 62-213, 62-214, 62-256, 62-257, 62-281, 62-296, and 62-297, F.A.C.

Pursuant to Sections 403.815 and 403.087, F.S., and Rules 62-110.106 and 62-210.350(3), F.A.C., you (the applicant) are required to publish at your own expense the enclosed "PUBLIC NOTICE OF INTENT TO ISSUE TITLE V AIR OPERATION PERMIT." The notice shall be published one time only as soon as possible in the legal advertisement section of a newspaper of general circulation in the area affected. For the purpose of these rules, "publication in a newspaper of general circulation in the area affected" means publication in a newspaper meeting the requirements of Sections 50.011 and 50.031, F.S., in the county where the activity is to take place. Where there is more than one newspaper of general circulation in the county, the newspaper used must be one with significant circulation in the area that may be affected by the permit. If you are uncertain that a newspaper meets these requirements, please contact the permitting authority at the address or telephone number listed below. The applicant shall provide proof of publication to the Department's Bureau of Air Regulation, 2600 Blair Stone Road, Mail Station #5505, Tallahassee, Florida 32399-2400 (Telephone: 850/488-1344; Fax: 850/922-6979), within 7 (seven) days of publication. Failure to publish the notice and provide proof of publication within the allotted time may result in the denial of the permit pursuant to Rule 62-110.106, F.A.C.

The permitting authority will issue the Title V PROPOSED Permit, and subsequent Title V FINAL Permit, in accordance with the conditions of the attached Title V Revised DRAFT Permit unless a response received in accordance with the following procedures results in a different decision or significant change of terms or conditions.

The permitting authority will accept written comments concerning the proposed permit issuance action for a period of 30 (thirty) days from the date of publication of the "PUBLIC NOTICE OF INTENT TO ISSUE TITLE V AIR OPERATION PERMIT." Written comments should be provided to the permitting authority office. Any written comments filed shall be made available for public inspection. If written comments received result in a significant change in this Revised DRAFT Permit, the permitting authority shall issue another Revised DRAFT Permit and require, if applicable, another Public Notice.

A person whose substantial interests are affected by the proposed permitting decision may petition for an administrative hearing in accordance with Sections 120.569 and 120.57, F.S. The petition must contain the information set forth below and must be filed (received) in the Office of General Counsel of the Department of Environmental Protection, 3900 Commonwealth Boulevard, Mail Station #35, Tallahassee, Florida 32399-3000 (Telephone: 850/488-9730; Fax: 850/487-4938). Petitions filed by the permit applicant or any of the parties listed below must be filed within fourteen days of receipt of this notice of intent. Petitions filed by any persons other than those entitled to written notice under Section 120.60(3), F.S., must be filed within fourteen days of publication of the public notice or within fourteen days of receipt of this notice of intent, whichever occurs first. Under Section 120.60(3), F.S., however, any person who asked the permitting authority for notice of agency action may file a petition within fourteen days of receipt of that notice, regardless of the date of publication. A petitioner shall mail a copy of the petition to the applicant at the address indicated above, at the time of filing. The failure of any person to file a petition within the appropriate time period shall constitute a waiver of that person's right to request an administrative determination (hearing) under Sections 120.569 and 120.57, F.S., or to intervene in this proceeding and participate as a party to it. Any subsequent intervention will be only at the approval of the presiding officer upon the filing of a motion in compliance with Rule 28-106.205, F.A.C.

A petition that disputes the material facts on which the permitting authority's action is based must contain the following information:

(a) The name and address of each agency affected and each agency's file or identification number, if known;

(b) The name, address, and telephone number of the petitioner; the name, address and telephone number of the petitioner's representative, if any, which shall be the address for service purposes during the course of the proceeding; and an explanation of how the petitioner's substantial interests will be affected by the agency determination;

(c) A statement of how and when each petitioner received notice of the agency action or proposed action;

(d) A statement of all disputed issues of material fact. If there are none, the petition must so indicate;

(e) A concise statement of the ultimate facts alleged, as well as the rules and statutes which entitle the petitioner to relief;

(f) A demand for relief.

A petition that does not dispute the material facts upon which the permitting authority's action is based shall state that no such facts are in dispute and otherwise shall contain the same information as set forth above, as required by Rule 28-106.301, F.A.C.

Because the administrative hearing process is designed to formulate final agency action, the filing of a petition means that the permitting authority's final action may be different from the position taken by it in this notice of intent. Persons whose substantial interests will be affected by any such final decision of the permitting authority on the application have the right to petition to become a party to the proceeding, in accordance with the requirements set forth above.

Mediation will not be available in this proceeding.

In addition to the above, a person subject to regulation has a right to apply to the Department of Environmental Protection for a variance from or waiver of the requirements of particular rules, on certain conditions, under Section 120.542, F.S. The relief provided by this state statute applies only to state rules, not statutes, and not to any federal regulatory requirements. Applying for a variance or waiver does not substitute or extend the time for filing a petition for an administrative hearing or exercising any other right that a person may have in relation to the action proposed in this notice of intent.

The application for a variance or waiver is made by filing a petition with the Office of General Counsel of the Department of Environmental Protection, 3900 Commonwealth Boulevard, Mail Station #35, Tallahassee, Florida 32399-3000. The petition must specify the following information:

- (a) The name, address, and telephone number of the petitioner;
- (b) The name, address, and telephone number of the attorney or qualified representative of the petitioner, if any;
- (c) Each rule or portion of a rule from which a variance or waiver is requested;
- (d) The citation to the statute underlying (implemented by) the rule identified in (c) above;
- (e) The type of action requested;
- (f) The specific facts that would justify a variance or waiver for the petitioner;
- (g) The reason why the variance or waiver would serve the purposes of the underlying statute (implemented by the rule); and,
- (h) A statement whether the variance or waiver is permanent or temporary and, if temporary, a statement of the dates showing the duration of the variance or waiver requested.


The Department will grant a variance or waiver when the petition demonstrates both that the application of the rule would create a substantial hardship or violate principles of fairness, as each of those terms is defined in Section 120.542(2), F.S., and that the purpose of the underlying statute will be or has been achieved by other means by the petitioner.

Persons subject to regulation pursuant to any federally delegated or approved air program should be aware that Florida is specifically not authorized to issue variances or waivers from any requirements of any such federally delegated or approved program. The requirements of the program remain fully enforceable by the Administrator of the United States Environmental Protection Agency and by any person under the Clean Air Act unless and until the Administrator separately approves any variance or waiver in accordance with the procedures of the federal program.

Finally, pursuant to 42 United States Code (U.S.C.) Section 7661d(b)(2), any person may petition the Administrator of the EPA within 60 (sixty) days of the expiration of the Administrator's 45 (forty-five) day review period as established at 42 U.S.C. Section 7661d(b)(1), to object to issuance of any permit. Any petition shall be based only on objections to the permit that were raised with reasonable specificity during the 30 (thirty) day public comment period provided in this notice, unless the petitioner demonstrates to the Administrator of the EPA that it was impracticable to raise such objections within the comment period or unless the grounds for such objection arose after the comment period. Filing of a petition with the Administrator of the EPA does not stay the effective date of any permit properly issued pursuant to the provisions of Chapter 62-213, F.A.C. Petitions filed with the Administrator of EPA must meet the requirements of 42 U.S.C. Section 7661d(b)(2) and must be filed with the Administrator of the EPA at: U.S. EPA, 401 M Street, S.W., Washington, D.C. 20460.

Executed in Tallahassee, Florida.

**STATE OF FLORIDA DEPARTMENT  
OF ENVIRONMENTAL PROTECTION**

  
\_\_\_\_\_  
C. H. Fancy, P.E.  
Chief  
Bureau of Air Regulation

**PUBLIC NOTICE OF INTENT TO ISSUE TITLE V AIR OPERATION PERMIT**

STATE OF FLORIDA  
DEPARTMENT OF ENVIRONMENTAL PROTECTION

Title V Revised DRAFT Permit No.: 1070025-001-AV  
Seminole Power Plant  
Putnam County

The Department of Environmental Protection (permitting authority) gives notice of its intent to issue a Title V air operation permit to Seminole Electric Cooperative, Inc. for the Seminole Power Plant located east of U.S. Highway 17, approximately seven miles north of Palatka, Putnam County. The applicant's name and address are: Seminole Electric Cooperative, Inc., 16313 North Dale Mabry Highway, Tampa, Florida 33618.

The permitting authority will issue the Title V PROPOSED Permit, and subsequent Title V FINAL Permit, in accordance with the conditions of the Title V Revised DRAFT Permit unless a response received in accordance with the following procedures results in a different decision or significant change of terms or conditions.

The permitting authority will accept written comments concerning the proposed Title V Revised DRAFT Permit issuance action for a period of 30 (thirty) days from the date of publication of this Notice. Written comments should be provided to the Department's Bureau of Air Regulation, 2600 Blair Stone Road, Mail Station #5505, Tallahassee, Florida 32399-2400. Any written comments filed shall be made available for public inspection. If written comments received result in a significant change in this Revised DRAFT Permit, the permitting authority shall issue another Revised DRAFT Permit and require, if applicable, another Public Notice.

A person whose substantial interests are affected by the proposed permitting decision may petition for an administrative hearing in accordance with Sections 120.569 and 120.57 of the Florida Statutes (F.S.). The petition must contain the information set forth below and must be filed (received) in Office of General Counsel of the Department of Environmental Protection, 3900 Commonwealth Boulevard, Mail Station #35, Tallahassee, Florida 32399-3000 (Telephone: 850/488-9730; Fax: 850/487-4938). Petitions filed by any persons other than those entitled to written notice under Section 120.60(3), F.S., must be filed within fourteen days of publication of the public notice or within fourteen days of receipt of the notice of intent, whichever occurs first. Under Section 120.60(3), F.S., however, any person who asked the permitting authority for notice of agency action may file a petition within fourteen days of receipt of that notice, regardless of the date of publication. A petitioner shall mail a copy of the petition to the applicant at the address indicated above, at the time of filing. The failure of any person to file a petition within the applicable time period shall constitute a waiver of that person's right to request an administrative determination (hearing) under Sections 120.569 and 120.57, F.S., or to intervene in this proceeding and participate as a party to it. Any subsequent intervention will be only at the approval of the presiding officer upon the filing of a motion in compliance with Rule 28-106.205 of the Florida Administrative Code (F.A.C.).

A petition that disputes the material facts on which the permitting authority's action is based must contain the following information:

- (a) The name and address of each agency affected and each agency's file or identification number, if known;
- (b) The name, address and telephone number of the petitioner; name address and telephone number of the petitioner's representative, if any, which shall be the address for service purposes during the course of the proceeding; and an explanation of how petitioner's substantial rights will be affected by the agency determination;

(c) A statement of how and when the petitioner received notice of the agency action or proposed action;

(d) A statement of all disputed issues of material fact. If there are none, the petition must so state;

(e) A concise statement of the ultimate facts alleged, as well as the rules and statutes which entitle petitioner to relief; and

(f) A demand for relief.

A petition that does not dispute the material facts upon which the permitting authority's action is based shall state that no such facts are in dispute and otherwise shall contain the same information as set forth above, as required by Rule 28-106.301, F.A.C.

Because the administrative hearing process is designed to formulate final agency action, the filing of a petition means that the permitting authority's final action may be different from the position taken by it in this notice of intent. Persons whose substantial interests will be affected by any such final decision of the permitting authority on the application have the right to petition to become a party to the proceeding, in accordance with the requirements set forth above.

Mediation is not available for this proceeding.

In addition to the above, pursuant to 42 United States Code (U.S.C.) Section 7661d(b)(2), any person may petition the Administrator of the EPA within 60 (sixty) days of the expiration of the Administrator's 45 (forty-five) day review period as established at 42 U.S.C. Section 7661d(b)(1), to object to issuance of any permit. Any petition shall be based only on objections to the permit that were raised with reasonable specificity during the 30 (thirty) day public comment period provided in this notice, unless the petitioner demonstrates to the Administrator of the EPA that it was impracticable to raise such objections within the comment period or unless the grounds for such objection arose after the comment period. Filing of a petition with the Administrator of the EPA does not stay the effective date of any permit properly issued pursuant to the provisions of Chapter 62-213, F.A.C. Petitions filed with the Administrator of EPA must meet the requirements of 42 U.S.C. Section 7661d(b)(2) and must be filed with the Administrator of the EPA at: U.S. EPA, 401 M Street, S.W., Washington, D.C. 20460.

A complete project file is available for public inspection during normal business hours, 8:00 a.m. to 5:00 p.m., Monday through Friday, except legal holidays, at:

Permitting Authority:

Department of Environmental Protection  
Bureau of Air Regulation  
111 South Magnolia Drive, Suite 4  
Tallahassee, Florida 32301  
Telephone: 850/488-1344  
Fax: 850/922-6979

Affected District/Local Program:

Department of Environmental Protection  
Northeast District Office  
7825 Baymeadows Way, Suite 200B  
Jacksonville, Florida 32256-7590  
Telephone: 904/448-4300  
Fax: 904/448-4363

The complete project file includes the Revised DRAFT Permit, the application, and the information submitted by the responsible official, exclusive of confidential records under Section 403.111, F.S. Interested persons may contact Scott M. Sheplak, P.E., at the above address, or call 850/921-9532, for additional information.

Seminole Electric Cooperative, Inc.  
Seminole Power Plant  
**Facility ID No.:** 1070025  
Putnam County

Initial Title V Air Operation Permit  
**Revised DRAFT Permit No.:** 1070025-001-AV

Permitting Authority:

State of Florida  
Department of Environmental Protection  
Division of Air Resources Management  
Bureau of Air Regulation  
Title V Section  
Mail Station #5505  
2600 Blair Stone Road  
Tallahassee, Florida 32399-2400  
Telephone: 850/488-1344  
Fax: 850/922-6979

Compliance Authority:

Department of Environmental Protection  
Northeast District Office  
7825 Baymeadows Way, Suite 200B  
Jacksonville, Florida 32256-7590  
Telephone: 904/448-4300  
Fax: 904/448-4363

Initial Title V Air Operation Permit  
Revised DRAFT Permit No.: 1070025-001-AV

**Table of Contents**

<b><u>Section</u></b>	<b><u>Page Number</u></b>
Placard Page .....	1
I. Facility Information .....	2 - 3
A. Facility Description.	
B. Summary of Emissions Unit ID No(s). and Brief Description(s).	
C. Relevant Documents.	
II. Facility-wide Conditions .....	4 - 5
III. Emissions Unit(s) and Conditions	
A. Emissions Unit -001 Steam Electric Generator No. 1 .....	6 - 28
-002 Steam Electric Generator No. 2	
B. Emissions Unit -003 Rail Car Maintenance .....	29 - 32
C. Emissions Unit -004 Coal Storage Yard .....	33 - 37
D. Emissions Unit -xxx Limestone and FGD Sludge Handling and Storage .....	38 - 41
IV. Acid Rain Part	
A. Acid Rain, Phase II .....	42 - 43
B. Acid Rain, Phase I .....	44 - 45



# Department of Environmental Protection

Lawton Chiles  
Governor

Twin Towers Office Building  
2600 Blair Stone Road  
Tallahassee, Florida 32399-2400

Virginia B. Wetherell  
Secretary

**Permittee:**

Seminole Electric Cooperative, Inc.  
16313 North Dale Mabry Highway  
Tampa, Florida 33618

**Revised DRAFT Permit No.:** 1070025-001-AV

**Facility ID No.:** 1070025

**SIC Nos.:** 49, 4911

**Project:** Initial Title V Air Operation Permit

This permit is for the operation of the Seminole Power Plant. This facility is located east of U.S. Highway 17, approximately seven miles north of Palatka, Putnam County; UTM Coordinates: Zone 17, 438.8 km East and 3289.2 km North; Latitude: 29° 43' 59" North and Longitude: 81° 37' 58" West.

STATEMENT OF BASIS: This Title V air operation permit is issued under the provisions of Chapter 403, Florida Statutes (F.S.), and Florida Administrative Code (F.A.C.) Chapters 62-4, 62-210, 62-213, and 62-214. The above named permittee is hereby authorized to perform the work or operate the facility shown on the application and approved drawing(s), plans, and other documents, attached hereto or on file with the permitting authority, in accordance with the terms and conditions of this permit.

**Referenced attachments made a part of this permit:**

Appendix U-1, List of Unregulated Emissions Units and/or Activities

Appendix I-1, List of Insignificant Emissions Units and/or Activities

APPENDIX TV-1, TITLE V CONDITIONS (version dated 12/02/97)

APPENDIX SS-1, STACK SAMPLING FACILITIES (version dated 10/07/96)

TABLE 297.310-1, CALIBRATION SCHEDULE (version dated 10/07/96)

FIGURE 1 - SUMMARY REPORT-GASEOUS AND OPACITY EXCESS EMISSION AND  
MONITORING SYSTEM PERFORMANCE REPORT (40 CFR 60; July 1996)

Appendix 40 CFR 60 Subpart A - General Provisions (version dated 07/23/97)

Phase II Acid Rain Application/Compliance Plan received December 5, 1995

**Effective Date:** January 1, 1999

**Renewal Application Due Date:** July 5, 2003

**Expiration Date:** December 31, 2003

---

Howard L. Rhodes, Director  
Division of Air Resources  
Management

HLR/sms/es

## **Section I. Facility Information.**

### **Subsection A. Facility Description.**

This facility consists of two 714.6 megawatt, electric, coal fired steam electric generators; a coal handling and storage system; a limestone unloading, handling and storage system; a flue gas desulfurization (FGD) sludge stabilization system; and a rail car maintenance facility.

Also included in this permit are miscellaneous unregulated/insignificant emissions units and/or activities.

Based on the initial Title V permit application received June 17, 1996, this facility is a major source of hazardous air pollutants (HAPs).

### **Subsection B. Summary of Emissions Unit ID No(s). and Brief Description(s).**

#### **E.U.**

<b><u>ID No.</u></b>	<b><u>Brief Description</u></b>
-001	Steam Electric Generator No. 1
-002	Steam Electric Generator No. 2
-003	Rail Car Maintenance
-004	Coal Storage Yard
-xxx	Limestone and FGD Sludge Handling and Storage

#### **Unregulated Emissions Units and/or Activities**

-xxx	One or more emergency generators not subject to the Acid Rain Program
-xxx	One or more heating units and general purpose internal combustion engines not subject to the Acid Rain Program
-xxx	General plant fugitives including plant-wide abrasive blasting, painting, moveable abrasive blast material bin, soil borrow pit, and vehicular travel on unpaved roads.

***Please reference the Permit No., Facility ID No., and appropriate Emissions Unit(s) ID No(s). on all correspondence, test report submittals, applications, etc.***

### **Subsection C. Relevant Documents.**

The documents listed below are not a part of this permit; however, they are specifically related to this permitting action.

These documents are provided to the permittee for information purposes only:

Table 1-1, Summary of Air Pollutant Standards and Terms

Table 2-1, Summary of Compliance Requirements

Appendix A-1, Abbreviations, Acronyms, Citations, and Identification Numbers

Appendix H-1, Permit History/ID Number Changes

These documents are on file with the permitting authority:

Initial Title V Permit Application received June 17, 1996.

Phase I Acid Rain permit dated March 27, 1997.

Letter received October 15, 1997, from Mr. Mike Roddy.

Phase II NO<sub>x</sub> Compliance Plan dated November 21, 1997.

Letter received December 19, 1997, from Mr. Robert Manning.

Letter received February 3, 1998, from Mr. Robert Manning.

## Section II. Facility-wide Conditions.

### The following conditions apply facility-wide:

1. APPENDIX TV-1, TITLE V CONDITIONS, is a part of this permit.

{Permitting note: APPENDIX TV-1, TITLE V CONDITIONS, is distributed to the permittee only. Other persons requesting copies of these conditions shall be provided a copy when requested or otherwise appropriate.}

2. **Not federally enforceable.** General Pollutant Emission Limiting Standards. Objectionable Odor Prohibited. The permittee shall not cause, suffer, allow, or permit the discharge of air pollutants which cause or contribute to an objectionable odor.  
[Rule 62-296.320(2), F.A.C.]

3. General Particulate Emission Limiting Standards. General Visible Emissions Standard.  
Except for emissions units that are subject to a particulate matter or opacity limit set forth or established by rule and reflected by conditions in this permit, no person shall cause, let, permit, suffer or allow to be discharged into the atmosphere the emissions of air pollutants from any activity, the density of which is equal to or greater than that designated as Number 1 on the Ringelmann Chart (20 percent opacity). EPA Method 9 is the method of compliance pursuant to Chapter 62-297, F.A.C.  
[Rules 62-296.320(4)(b)1. & 4., F.A.C.]

4. Prevention of Accidental Releases (Section 112(r) of CAA). If required by 40 CFR 68, the permittee shall submit to the implementing agency:  
a. a risk management plan (RMP) when, and if, such requirement becomes applicable; and  
b. certification forms and/or RMPs according to the promulgated rule schedule.  
[40 CFR 68]

5. Unregulated Emissions Units and/or Activities. Appendix U-1, List of Unregulated Emissions Units and/or Activities, is a part of this permit.  
[Rule 62-213.440(1), F.A.C.]

6. Insignificant Emissions Units and/or Activities. Appendix I-1, List of Insignificant Emissions Units and/or Activities, is a part of this permit.  
[Rules 62-213.440(1), 62-213.430(6) and 62-4.040(1)(b), F.A.C.]

**7. General Pollutant Emission Limiting Standards. Volatile Organic Compounds Emissions or Organic Solvents Emissions.** The permittee shall allow no person to store, pump, handle, process, load, unload or use in any process or installation, volatile organic compounds or organic solvents without applying known and existing vapor emission control devices or systems deemed necessary and ordered by the Department.

[Rule 62-296.320(1)(a), F.A.C.]

**8. Not federally enforceable.** Reasonable precautions to prevent emissions of unconfined particulate matter at this facility include: chemical or water application to unpaved roads or unpaved yard areas; paving and maintenance of roads, parking areas and plant grounds; landscaping and planting of vegetation; confining abrasive blasting where possible; and other techniques, as necessary.

[Rule 62-296.320(4)(c)2., F.A.C.; and, proposed by applicant in the initial Title V permit application received June 17, 1996.]

**9.** When appropriate, any recording, monitoring, or reporting requirements that are time-specific shall be in accordance with the effective date of the permit, which defines day one.

[Rule 62-213.440, F.A.C.]

**10.** The permittee shall submit all compliance related notifications and reports required of this permit to the Department's Northeast District office:

Department of Environmental Protection  
Northeast District Office  
7825 Baymeadows Way, Suite 200B  
Jacksonville, Florida 32256-7590  
Telephone: 904/448-4300  
Fax: 904/448-4363

**11.** Any reports, data, notifications, certifications, and requests required to be sent to the United States Environmental Protection Agency, Region 4, should be sent to:

United States Environmental Protection Agency  
Region 4  
Air, Pesticides & Toxics Management Division  
Operating Permits Section  
61 Forsyth Street  
Atlanta, Georgia 30303  
Telephone: 404/562-9099  
Fax: 404/562-9095

### Section III. Emissions Unit(s) and Conditions.

#### Subsection A. This section addresses the following emissions units.

##### E.U.

##### ID No.      Brief Description

-001	Steam Electric Generator No. 1
-002	Steam Electric Generator No. 2

Steam Electric Generator Nos. 1 and 2 are coal fired utility, dry bottom wall-fired boilers, each having a generator nameplate rating of 714.6 megawatts, electric. The maximum heat input to each emissions unit is 7,172 million Btu per hour. Steam Electric Generator Nos. 1 and 2 are each equipped with an electrostatic precipitator (ESP) to control particulate matter, a wet limestone flue gas desulfurization (FGD) unit to control sulfur dioxide, and low NO<sub>x</sub> burners and low excess-air firing to control nitrogen oxides.

{Permitting note(s): IMPORTANT REGULATORY CLASSIFICATIONS - The emissions units are regulated under Acid Rain, Phase II and Phase I; NSPS - 40 CFR 60, Subpart Da, Standards of Performance for Electric Utility Steam Generating Units for Which Construction is Commenced After September 18, 1978, adopted and incorporated by reference in Rule 62-204.800(7), F.A.C.; Rule 212.400(5), F.A.C., Prevention of Significant Deterioration (PSD); and Rule 62-212.400(6), F.A.C., Best Available Control Technology (BACT) Determination, dated August 9, 1979. Steam Electric Generator No. 2 began commercial operation in 1984 and Steam Electric Generator No. 1 began commercial operation in 1985.}

#### The following specific conditions apply to the emissions unit(s) listed above:

{Permitting note: In addition to the requirements listed below, these emissions units are also subject to the standards and requirements contained in the Acid Rain Part of this permit (see Section IV).}

##### Essential Potential to Emit (PTE) Parameters

**A.1. Permitted Capacity.** The maximum operation heat input rate is as follows:

<u>Emissions Unit No.</u>	<u>MMBtu/hr Heat Input</u>
-001	7,172
-002	7,172

[Rules 62-4.160(2) and 62-210.200(PTE), F.A.C.]

**A.2. Emissions Unit Operating Rate Limitation After Testing.** See specific condition A.48.  
[Rule 62-297.310(2), F.A.C.]

**A.3. Methods of Operation. Fuel(s).** The only fuels allowed to be fired are coal, coal with a maximum of 30 percent petroleum coke (by weight), No. 2 fuel oil, and on-specification used oil. The maximum weight of petroleum coke burned shall not exceed 186,000 pounds per hour (averaged over 24 hours). On-specification used oil containing any quantifiable levels of PCBs can only be fired when the emissions unit is at normal operating temperatures.

[Rule 62-213.410, F.A.C.; 40 CFR 271.20(e)(3); and PSD-FL-018(A)]

**A.4. Hours of Operation.** These emissions units are allowed to operate continuously, i.e., 8,760 hours/year.

[Rule 62-210.200(PTE), F.A.C.]

### **Emission Limitations and Standards**

{Permitting note: Table 1-1, Summary of Air Pollutant Standards and Terms, summarizes information for convenience purposes only. This table does not supersede any of the terms or conditions of this permit.}

**A.5. Particulate Matter.** No owner or operator subject to the provisions of 40 CFR 60, Subpart Da shall cause to be discharged into the atmosphere from any affected facility any gases which contain particulate matter in excess of:

- (1) 13 ng/J (0.03 lb/million Btu) heat input derived from the combustion of coal or fuel oil;
- (2) 1 percent of the potential combustion concentration (99 percent reduction) when combusting solid fuel; and
- (3) 30 percent of potential combustion concentration (70 percent reduction) when combusting liquid fuel.

[40 CFR 60.42a(a) and PSD-FL-018]

**A.6. Particulate Matter.** No owner or operator shall cause to be discharged into the atmosphere when combusting a coal and petroleum coke blend any gases which contain particulate matter in excess of 0.03 lb/million Btu heat input, and one percent of the potential combustion concentration (99 percent reduction). Compliance with the 0.03 lb/million Btu heat input emission limitation shall also constitute compliance with the 99 percent reduction requirement.

[PSD-FL-018(A)]

**A.7. Visible Emissions.** No owner or operator subject to the provisions of 40 CFR 60, Subpart Da shall cause to be discharged into the atmosphere from any affected facility any gases which exhibit greater than 20 percent opacity (6 minute average), except for one 6-minute period per hour of not more than 27 percent opacity.

[40 CFR 60.42a(b)]

**A.8. Sulfur Dioxide (Coal, Only).** No owner or operator subject to the provisions of 40 CFR 60, Subpart Da shall cause to be discharged into the atmosphere from any affected facility which combusts coal any gases which contain sulfur dioxide in excess of:

- (1) 520 ng/J (1.20 lb/million Btu) heat input, or
  - (2) 30 percent of the potential combustion concentration (70 percent reduction), when emissions are less than 260 ng/J (0.60 lb/million Btu) heat input.
  - (3) 100 percent of the potential combustion concentration (zero percent reduction), when emissions are less than 86 ng/J (0.20 lb/million Btu) heat input.
- [40 CFR 60.43a(a)(1) & (2); and, PSD-FL-018]

**A.9. Sulfur Dioxide.** No owner or operator subject to the provisions of 40 CFR 60, Subpart Da shall cause to be discharged into the atmosphere from any affected facility which combusts liquid fuel any gases which contain sulfur dioxide in excess of:

- (1) 340 ng/J (0.80 lb/million Btu) heat input, or
  - (2) 100 percent of the potential combustion concentration (zero percent reduction), when emissions are less than 86 ng/J (0.20 lb/million Btu) heat input.
- [40 CFR 60.43a(b)(1) & (2); and, PSD-FL-018]

**A.10. Sulfur Dioxide.** No owner or operator shall cause to be discharged into the atmosphere from any affected facility when combusting coal and/or oil any gases which contain sulfur dioxide in excess of 15 percent of the potential combustion concentration.  
[PSD-FL-018]

**A.11. Sulfur Dioxide.** Compliance with the emission limitation and percent reduction requirements are both determined on a 30-day rolling average basis.  
[40 CFR 60.43a(g)]

**A.12. Sulfur Dioxide.** When coal and fuel oil are combusted simultaneously, the applicable standard is determined by proration using the following formula:

$$PS_{SO_2} = X(340) + Y(520) / 100$$

where:

$PS_{SO_2}$  is the prorated standard for sulfur dioxide when combusting coal and fuel oil simultaneously (ng/J heat input).

X is the percentage of total heat input derived from the combustion of fuel oil.

Y is the percentage of total heat input derived from the combustion of coal.  
[PSD-FL-018]

**A.13. Sulfur Dioxide.** Stack emissions from Units 1 and 2 shall comply with the following standards when burning blends of coal and petroleum coke:

(1) Unit 1:

$$E_{SO_2} = [(\%C_{HI} / 100) * (P_S) * (1 - (\%R_O / 100))] + [(1 - (\%C_{HI} / 100)) * (0.74 \text{ lb } SO_2 / \text{MMBtu})]$$

(2) Unit 2:

$$E_{SO_2} = [(\%C_{HI} / 100) * (P_S) * (1 - (\%R_O / 100))] + [(1 - (\%C_{HI} / 100)) * (0.72 \text{ lb } SO_2 / \text{MMBtu})]$$

where:

$E_{SO_2}$  = allowable  $SO_2$  emission rate; pounds per million Btu heat input (lb  $SO_2$ /MMBtu), 30-day rolling average.

$\%C_{HI}$  = percent of coal used on a heat input basis.

$P_S$  = potential  $SO_2$  combustion concentration (unwashed coal without emission control systems) as defined by NSPS Subpart Da; lb  $SO_2$ /MMBtu, 30-day rolling average.

$\%R_O$  = overall percent  $SO_2$  reduction from Equation 19-21 of EPA Reference Method 19. Per NSPS Subpart Da,  $\%R_O$  must not be less than 90%, 30-day rolling average.

0.74 = historical 2-year annual average  $SO_2$  emission rate for Unit 1, lb/MMBtu.

0.72 = historical 2-year annual average  $SO_2$  emission rate for Unit 2, lb/MMBtu.

Compliance with the lb/MMBtu heat input emission limitations and percent reduction requirement shall be determined on a 30-day rolling average basis.

[PSD-FL-018(A)]

**A.14. Sulfur Dioxide.** The petroleum coke sulfur content shall not exceed 7.0 percent by weight, dry basis.

[PSD-FL-018(A)]

**A.15. Nitrogen Oxides.** No owner or operator subject to the provisions of 40 CFR 60, Subpart Da shall cause to be discharged into the atmosphere from any affected facility any gases which contain nitrogen oxides in excess of the following emission limits, based on a 30-day rolling average.

(1)  $NO_x$  emissions limits. Bituminous coal emission limit for heat input: 260 ng/J (0.60 lb/million Btu); All other liquid fuels emission limit for heat input: 130 ng/J (0.30 lb/million Btu).

(2) NO<sub>x</sub> reduction requirement. Solid fuels: 65 percent reduction of potential combustion concentration; Liquid fuels: 30 percent reduction of potential combustion concentration.  
[40 CFR 60.44a(a)(1) & (2)]

**A.16. Nitrogen Oxides.** When coal and fuel oil are combusted simultaneously, the applicable standard is determined by proration using the following formula:

$$PS_{NOX} = X(130) + Y(260) / 100$$

where:

PS<sub>NOX</sub> is the prorated standard for nitrogen oxides when combusting coal and fuel oil simultaneously (ng/J heat input).

X is the percentage of total heat input derived from the combustion of fuel oil.

Y is the percentage of total heat input derived from the combustion of coal.  
[PSD-FL-018]

**A.17. Nitrogen Oxides.** Stack emissions from Units 1 and 2 shall comply with the following standards when burning blends of coal and petroleum coke:

(1) 0.60 lb/MMBtu heat input, and 35 percent of the potential combustion concentration (65 percent reduction). Compliance with the lb/MMBtu heat input emission limitation and the percent reduction requirement shall be determined on a 30-day rolling average basis. Compliance with the 0.60 lb/MMBtu heat input emission limitation shall also constitute compliance with the 65 percent reduction requirement; and

(2) 0.50 lb/MMBtu heat input determined on an annual average basis, when subject to the 40 CFR 76.8 Early Election Program for Group 1, Phase II Boilers or in any year when petroleum coke is burned.  
[40 CFR 60.44a(a)(1) & (2) and PSD-FL-018(A)]

**A.18. "On-Specification" Used Oil.** Only "on-specification" used oil shall be fired in each unit. The quantity fired in each unit shall not exceed 500,000 gallons per calendar year. "On-specification" used oil is defined as used oil that meets the 40 CFR 279 (Standards for the Management of Used Oil) specifications listed below. Used oil that does not meet all of the following specifications is considered "off-specification" oil and shall not be fired.

<u>CONSTITUENT / PROPERTY *</u>	<u>ALLOWABLE LEVEL</u>
Arsenic	5 ppm maximum
Cadmium	2 ppm maximum
Chromium	10 ppm maximum
Lead	100 ppm maximum
Total Halogens	1000 ppm maximum
Flash Point	100 °F minimum
PCBs	less than 50 ppm

\* As determined by approved methods specified in EPA Publication SW-846 ( Test Methods for Evaluating Solid Waste, Physical/Chemical Methods).

[40 CFR 279.11; and, Requested by the Applicant in the initial Title V application received June 17, 1996]

### **Excess Emissions**

**A.19. Sulfur Dioxide.** The sulfur dioxide emissions allowed under specific conditions A.8. and A.9. may be exceeded up to three 24-hour periods during any calendar month; however, the sulfur dioxide emissions must be reduced to less than 25 percent of the potential combustion concentration (75 percent reduction) at all times.

[PSD-FL-018]

**A.20.** The opacity standards set forth in 40 CFR 60 shall apply at all times except during periods of startup, shutdown, malfunction and as otherwise provided in the applicable standard.

At all times, including periods of startup, shutdown, and malfunction, owners and operators shall, to the extent practicable, maintain and operate any affected facility including associated air pollution control equipment in a manner consistent with good air pollution control practice for minimizing emissions. Determination of whether acceptable operating and maintenance procedures are being used will be based on information available to the Administrator which may include, but is not limited to, monitoring results, opacity observations, review of operating and maintenance procedures, and inspection of the source.

[40 CFR 60.11(c) & (d)]

**A.21.** Excess emissions resulting from malfunction shall be permitted provided that best operational practices to minimize emissions are adhered to and the duration of excess emissions shall be minimized but in no case exceed two hours in any 24 hour period unless specifically authorized by the Department for longer duration.

[Rule 62-210.700(1), F.A.C.]

**A.22.** Excess emissions which are caused entirely or in part by poor maintenance, poor operation, or any other equipment or process failure which may reasonably be prevented during startup, shutdown or malfunction shall be prohibited.

[Rule 62-210.700(4), F.A.C.]

{Permitting note: The Excess Emissions Rule at Rule 62-210.700, F.A.C., cannot vary any requirement of a NSPS, NESHAP, or Acid Rain program provision.}

### **Monitoring of Operations**

#### **A.23. Determination of Process Variables.**

(a) **Required Equipment.** The owner or operator of an emissions unit for which compliance tests are required shall install, operate, and maintain equipment or instruments necessary to determine process variables, such as process weight input or heat input, when such data are needed in conjunction with emissions data to determine the compliance of the emissions unit with applicable emission limiting standards.

(b) **Accuracy of Equipment.** Equipment or instruments used to directly or indirectly determine process variables, including devices such as belt scales, weight hoppers, flow meters, and tank scales, shall be calibrated and adjusted to indicate the true value of the parameter being measured with sufficient accuracy to allow the applicable process variable to be determined within 10% of its true value.

[Rule 62-297.310(5), F.A.C.]

### **Compliance Provisions**

**A.24.** Compliance with the particulate matter emission limitation under 40 CFR 60.42a(a)(1) constitutes compliance with the percent reduction requirements for particulate matter under 40 CFR 60.42a(a)(2) and (3).

[40 CFR 60.46a(a)]

**A.25.** Compliance with the nitrogen oxides emission limitation under 40 CFR 60.44a(a)(1) constitutes compliance with the percent reduction requirements under 40 CFR 60.44a(a)(2).  
[40 CFR 60.46a(b)]

**A.26.** The particulate matter emission standards under 40 CFR 60.42a and the nitrogen oxide standards under 40 CFR 60.44a apply at all times except during periods of startup, shutdown, or malfunction. The sulfur dioxide emission standards under 40 CFR 60.43a apply at all times except during periods of startup, shutdown, or when both emergency conditions exist and the procedures under 40 CFR 60.46a(d) are implemented.  
[40 CFR 60.46a(c)]

**A.27.** During emergency conditions in the principle company, an affected facility with a malfunctioning flue gas desulfurization system may be operated if sulfur dioxide emissions are minimized by:  
(1) Operating all operable flue gas desulfurization modules, and bringing back into operation any malfunctioned module as soon as repairs are completed,  
(2) Bypassing flue gases around only those flue gas desulfurization system modules that have been taken out of operation because they were incapable of any sulfur dioxide emission reduction or which would have suffered significant physical damage if they had remained in operation.  
[40 CFR 60.46a(d)(1) & (2)]

**A.28.** Compliance with the sulfur dioxide emission limitations and the percentage reduction requirements under 40 CFR 60.43a and the nitrogen oxides emissions limitations under 40 CFR 60.44a is based on the average emission rate for 30 successive boiler operating days. A separate performance test is completed at the end of each boiler operating day and a new 30 day average emission rate for both sulfur dioxide and nitrogen oxides and a new percent reduction for sulfur dioxide are calculated to show compliance with the standards.  
[40 CFR 60.46a(e)]

**A.29.** Compliance is determined by calculating the arithmetic average of all hourly emission rates for SO<sub>2</sub> and NO<sub>x</sub> for the 30 successive boiler operating days, except for data obtained during startup, shutdown, or malfunction (NO<sub>x</sub> only), or emergency conditions (SO<sub>2</sub> only). Compliance with the percentage reduction requirement for SO<sub>2</sub> is determined based on the average inlet and average outlet SO<sub>2</sub> emissions rates for the 30 successive boiler operating days.  
[40 CFR 60.46a(g)]

**A.30.** If the owner or operator has not obtained the minimum quantity of emission data as required under 40 CFR 60.47a, compliance of the affected facility with the emission requirements under 40 CFR 60.43a and 60.44a for the day on which the 30-day period ends may be determined by the Administrator following the applicable procedures in section 7 of Method 19.  
[40 CFR 60.46a(h)]

**Continuous Monitoring Requirements**

**A.31. Opacity.** The owner or operator of an affected facility shall install, calibrate, maintain, and operate a continuous monitoring system, and record the output of the system, for measuring the opacity of emissions discharges to the atmosphere. If opacity interference due to water droplets exists in the stack (for example, from the use of a FGD system), the opacity is monitored upstream of the interference (at the inlet to the FGD system). If opacity interference is experienced at all locations (both at the inlet and outlet of the sulfur dioxide control system), alternate parameters indicative of the particulate matter control system's performance are monitored (subject to the approval of the Administrator).  
[40 CFR 60.47a(a)]

**A.32. Sulfur Dioxide.** The owner or operator of an affected facility shall install, calibrate, maintain, and operate a continuous monitoring system, and record the output of the system, for measuring sulfur dioxide emissions as follows:  
(1) Sulfur dioxide emissions are monitored at both the inlet and outlet of the sulfur dioxide control device.  
(3) An "as fired" fuel monitoring system (upstream of coal pulverizers) meeting the requirements of Method 19 (appendix A) may be used to determine potential sulfur dioxide emissions in place of a continuous sulfur dioxide emission monitor at the inlet to the sulfur dioxide control device as required by paragraph (1), above.  
[40 CFR 60.47a(b)(1) & (3)]

**A.33. Nitrogen Oxides.** The owner or operator of an affected facility shall install, calibrate, maintain, and operate a continuous monitoring system, and record the output of the system, for measuring nitrogen oxides emissions discharged to the atmosphere.  
[40 CFR 60.47a(c)]

**A.34.** The owner or operator of an affected facility shall install, calibrate, maintain, and operate a continuous monitoring system, and record the output of the system, for measuring the oxygen or carbon dioxide content of the flue gases at each location where sulfur dioxide or nitrogen oxides emissions are monitored.  
[40 CFR 60.47a(d)]

**A.35.** The continuous monitoring systems required under specific conditions A.32., A.33. and A.34. are operated and data recorded during all periods of operation at the affected facility including periods of startup, shutdown, malfunction, or emergency conditions, except for continuous monitoring system breakdowns, repairs, calibration checks, and zero and span adjustments.  
[40 CFR 60.47a(e)]

**A.36.** The owner or operator shall obtain emission data for at least 18 hours in at least 22 out of 30 successive boiler operating days. If this minimum data requirement cannot be met with a continuous monitoring system, the owner or operator shall supplement emission data with other monitoring systems approved by the Administrator or the reference methods and procedures as described in 40 CFR 60.47a(h).

[40 CFR 60.47a(f)]

**A.37.** The 1-hour averages required under 40 CFR 60.13(h) are expressed in ng/J (lb/million Btu) heat input and used to calculate the average emission rates under 40 CFR 60.46a. The 1-hour averages are calculated using the data points required under 40 CFR 60.13(b). At least two data points must be used to calculate the 1-hour averages.

[40 CFR 60.47a(g)]

**A.38.** When it becomes necessary to supplement continuous monitoring system data to meet the minimum data requirements in 40 CFR 60.47a(f), the owner or operator shall use the reference methods and procedures as specified in this paragraph. acceptable alternative methods are given in 40 CFR 60.47a(j).

- (1) Method 6 shall be used to determine the SO<sub>2</sub> concentration at the same location as the SO<sub>2</sub> monitor. Samples shall be taken at 60-minute intervals. The sampling time and sample volume for each sample shall be at least 20 minutes and 0.020 dscm (0.71 dscf). Each sample represents a 1-hour average.
- (2) Method 7 shall be used to determine the NO<sub>x</sub> concentration at the same location as the NO<sub>x</sub> monitor. Samples shall be taken at 30-minute intervals. The arithmetic average of two consecutive samples represents a 1-hour average.
- (3) The emission rate correction factor, integrated bag sampling and analysis procedure of Method 3B shall be used to determine the O<sub>2</sub> or CO<sub>2</sub> concentration at the same location as the O<sub>2</sub> or CO<sub>2</sub> monitor. Samples shall be taken for at least 30 minutes in each hour. Each sample represents a 1-hour average.
- (4) The procedures in Method 19 shall be used to compute each 1-hour average concentration in ng/J (lb/million Btu) heat input.

[40 CFR 60.47a(h)]

**A.39.** The owner or operator shall use methods and procedures in this paragraph to conduct monitoring system performance evaluations under 40 CFR 60.13(c) and calibration checks under 40 CFR 60.13(d). Acceptable alternative methods and procedures are given in 40 CFR 60.47a(j).

- (1) Methods 6, 7, and 3B, as applicable, shall be used to determine O<sub>2</sub>, SO<sub>2</sub>, and NO<sub>x</sub> concentrations.
- (2) SO<sub>2</sub> or NO<sub>x</sub> (NO), as applicable, shall be used for preparing the calibration gas mixtures (in N<sub>2</sub>, as applicable) under Performance Specification 2 of appendix B of 40 CFR 60.
- (3) For affected facilities burning only fossil fuel, the span value for a continuous monitoring system for measuring opacity is between 60 and 80 percent and for a continuous monitoring system measuring nitrogen oxides firing solid fuel is 1,000 ppm.

(5) For affected facilities burning fossil fuel, alone or in combination with non-fossil fuel, the span value of the sulfur dioxide continuous monitoring system at the inlet to sulfur dioxide control device is 125 percent of the maximum estimated hourly potential emissions of the fuel fired, and the outlet of the sulfur dioxide control device is 50 percent of maximum estimated hourly potential emissions of the fuel fired.

[40 CFR 60.47a(i)(1), (2), (3), & (5)]

**A.40.** The owner or operator may use the following as alternatives to the reference methods and procedures specified in 40 CFR 60.47a.

(1) For Method 6, Method 6A or 6B (whenever Methods 6 and 3 or 3B data are used) or 6C may be used. Each Method 6B sample obtained over 24 hours represents 24 1-hour averages. If Method 6A or 6B is used under 40 CFR 60.47a(i), the conditions under 40 CFR 60.46(d)(1) apply (see specific condition A.71.); these conditions do not apply under 40 CFR 60.47a(h).

(2) For Method 7, Method 7A, 7C, 7D, or 7E may be used. If Method 7C, 7D, or 7E is used, the sampling time is 1 hour.

(3) For Method 3, Method 3A or 3B may be used if the sampling time is 1 hour.

(4) For Method 3B, Method 3A may be used.

[40 CFR 60.47a(j)]

### **Test Methods and Procedures**

{Permitting note: Table 2-1, Summary of Compliance Requirements, summarizes information for convenience purposes only. This table does not supersede any of the terms or conditions of this permit.}

**A.41.** In conducting performance tests, the owner or operator shall use as reference methods and procedures the methods in appendix A of 40 CFR 60 or the methods and procedures as specified in 40 CFR 60.48a, except as provided in 40 CFR 60.8(b). 40 CFR 60.8(f) does not apply for SO<sub>2</sub> and NO<sub>x</sub>. Acceptable alternative methods are given in 40 CFR 60.48a(e).

[40 CFR 60.48a(a)]

**A.42. Particulate Matter.** The owner or operator shall determine compliance with the particulate matter standard as follows:

(1) The dry basis F factor (O<sub>2</sub>) procedures in Method 19 shall be used to compute the emission rate of particulate matter.

(2) For the particulate matter concentration, Method 5 shall be used at affected facilities without wet FGD systems and Method 5B shall be used after wet FGD systems.

(i) The sampling time and sample volume for each run shall be at least 120 minutes and 1.70 dscm (60 dscf). The probe and filter holder heating system in the sampling train may be set to provide an average gas temperature of no greater than 160 ± 14 °C (320 ± 25 °F).

- (ii) For each particulate run, the emission rate correction factor, integrated or grab sampling and analysis procedures of Method 3B shall be used to determine the O<sub>2</sub> concentration. The O<sub>2</sub> sample shall be obtained simultaneously with, and at the same traverse points as, the particulate run. If the particulate run has more than 12 traverse points, the O<sub>2</sub> traverse points may be reduced to 12 provided that Method 1 is used to locate the 12 O<sub>2</sub> traverse points. If the grab sampling procedure is used, the O<sub>2</sub> concentration for the run shall be the arithmetic mean of all the individual O<sub>2</sub> concentrations at each traverse point.
- (3) Method 9 and the procedures in 40 CFR 60.11 shall be used to determine opacity, or,
- (4) Use of a continuous opacity monitor is authorized to determine opacity.  
[40 CFR 60.48a(b) and 40 CFR 60.11(b)]

**A.43. Sulfur Dioxide.** The owner or operator shall determine compliance with the sulfur dioxide standards as follows:

- (1) The percent of potential SO<sub>2</sub> emissions (%P<sub>S</sub>) to the atmosphere shall be computed using the following equation:

$$\%P_S = [(100 - \%R_F) (100 - \%R_S)] / 100$$

where:

%P<sub>S</sub> = percent of potential SO<sub>2</sub> emissions, percent.

%R<sub>F</sub> = percent reduction from fuel pretreatment, percent.

%R<sub>S</sub> = percent reduction by SO<sub>2</sub> control system, percent.

- (2) The procedures in Method 19 may be used to determine percent reduction (%R<sub>F</sub>) of sulfur by such processes as fuel pretreatment (physical coal cleaning, hydrodesulfurization of fuel oil, ect.), coal pulverizers, and bottom and flyash interactions. This determination is optional.
- (3) The procedures in Method 19 shall be used to determine the percent SO<sub>2</sub> reduction (%R<sub>S</sub>) of any SO<sub>2</sub> control system. Alternatively, a combination of an "as fired" fuel monitor and emission rates measured after the control system, following the procedures in Method 19, may be used if the percent reduction is calculated using the average emission rate from the SO<sub>2</sub> control device and the average SO<sub>2</sub> input rate from the "as fired" fuel analysis for 30 consecutive boiler operating days.
- (4) The appropriate procedures in Method 19 shall be used to determine the emission rate.
- (5) The continuous monitoring system in 40 CFR 60.47a(b) and (d) shall be used to determine the concentrations of SO<sub>2</sub> and CO<sub>2</sub> or O<sub>2</sub>.  
[40 CFR 60.48a(c)]

**A.44. Nitrogen Oxides.** The owner or operator shall determine compliance with the NO<sub>x</sub> standard as follows:

- (1) The appropriate procedures in Method 19 shall be used to determine the emission rate of NO<sub>x</sub>.
- (2) The continuous monitoring system in 40 CFR 60.47a(c) and (d) shall be used to determine the concentrations of NO<sub>x</sub> and CO<sub>2</sub> or O<sub>2</sub>.  
[40 CFR 60.48a(d)]

**A.45.** The owner or operator may use the following as alternatives to the reference methods and procedures specified in 40 CFR 60.48a:

- (1) For Method 5 or 5B, Method 17 may be used at facilities with or without wet FGD systems if the stack temperature at the sampling location does not exceed the average temperature of 160 °C (320 °F). Procedures 2.1 and 2.3 of Method 5B in 40 CFR 60, Appendix A may be used in Method 17 only if it is used after wet FGD systems. Method 17 shall not be used after wet FGD systems if the effluent is saturated or laden with water droplets.
- (2) The F<sub>C</sub> factor (CO<sub>2</sub>) procedures in Method 19 may be used to compute the emission rate of particulate matter under the stipulations of 40 CFR 60.46(d)(1). The CO<sub>2</sub> shall be determined in the same manner as the O<sub>2</sub> concentration.  
[40 CFR 60.48a(e)]

**A.46.** Compliance with the "on-specification" used oil requirements will be determined as follows:

- (a) Analysis of a sample collected from each batch delivered for firing; or,
- (b) The new batch delivery is from a collection site that has an acceptable analysis already on file with the facility and the analytical results are assumed by the facility for the batch.
- (c) For quantification purposes, the highest concentration of each constituent as determined by any analysis is assumed to be the concentration of the constituent of the blended used oil.

See specific condition **A.18**.

[Rule 62-213.440(1)(b)2.a., F.A.C.]

**A.47. Required Number of Test Runs.** For mass emission limitations, a compliance test shall consist of three complete and separate determinations of the total air pollutant emission rate through the test section of the stack or duct and three complete and separate determinations of any applicable process variables corresponding to the three distinct time periods during which the stack emission rate was measured provided, however, that three complete and separate determinations shall not be required if the process variables are not subject to variation during a compliance test, or if three determinations are not necessary in order to calculate the unit's emission rate. The three required test runs shall be completed within one consecutive five day period. In the event that a sample is lost or one of the three runs must be discontinued because of circumstances beyond the control of the owner or operator, and a valid third run cannot be obtained within the five day period allowed for the test, the Secretary or his or her designee may accept the results of the two complete runs as proof of compliance, provided that the arithmetic mean of the results of the two complete runs is at least 20 percent below the allowable emission limiting standards.

[Rule 62-297.310(1), F.A.C.]

**A.48. Operating Rate During Testing.** Testing of emissions shall be conducted with the emissions unit operation at permitted capacity, which is defined as 90 to 100 percent of the maximum operation rate allowed by the permit. If it is impracticable to test at permitted capacity, an emissions unit may be tested at less than the minimum permitted capacity; in this case, subsequent emissions unit operation is limited to 110 percent of the test load until a new test is conducted. Once the emissions unit is so limited, operation at higher capacities is allowed for no more than 15 consecutive days for the purpose of additional compliance testing to regain the authority to operate at the permitted capacity.  
[Rules 62-297.310(2) & (2)(b), F.A.C.]

**A.49. Calculation of Emission Rate.** The indicated emission rate or concentration shall be the arithmetic average of the emission rate or concentration determined by each of the three separate test runs unless otherwise specified in a particular test method or applicable rule.  
[Rule 62-297.310(3), F.A.C.]

**A.50. Applicable Test Procedures.**

**(a) Required Sampling Time.**

1. Unless otherwise specified in the applicable rule, the required sampling time for each test run shall be no less than one hour and no greater than four hours, and the sampling time at each sampling point shall be of equal intervals of at least two minutes.
2. Opacity Compliance Tests. When either EPA Method 9 or DEP Method 9 is specified as the applicable opacity test method, the required minimum period of observation for a compliance test shall be sixty (60) minutes for emissions units which emit or have the potential to emit 100 tons per year or more of particulate matter, and thirty (30) minutes for emissions units which have potential emissions less than 100 tons per year of particulate matter and are not subject to a multiple-valued opacity standard. The opacity test observation period shall include the period during which the highest opacity emissions can reasonably be expected to occur. Exceptions to these requirements are as follows:
  - a. For batch, cyclical processes, or other operations which are normally completed within less than the minimum observation period and do not recur within that time, the period of observation shall be equal to the duration of the batch cycle or operation completion time.
  - b. The observation period for special opacity tests that are conducted to provide data to establish a surrogate standard pursuant to Rule 62-297.310(5)(k), F.A.C., Waiver of Compliance Test Requirements, shall be established as necessary to properly establish

the relationship between a proposed surrogate standard and an existing mass emission limiting standard.

c. The minimum observation period for opacity tests conducted by employees or agents of the Department to verify the day-to-day continuing compliance of a unit or activity with an applicable opacity standard shall be twelve minutes.

(b) Minimum Sample Volume. Unless otherwise specified in the applicable rule, the minimum sample volume per run shall be 25 dry standard cubic feet.

(c) Required Flow Rate Range. For EPA Method 5 particulate sampling, acid mist/sulfur dioxide, and fluoride sampling which uses Greenburg Smith type impingers, the sampling nozzle and sampling time shall be selected such that the average sampling rate will be between 0.5 and 1.0 actual cubic feet per minute, and the required minimum sampling volume will be obtained.

(d) Calibration of Sampling Equipment. Calibration of the sampling train equipment shall be conducted in accordance with the schedule shown in Table 297.310-1, attached as part of this permit.

(e) Allowed Modification to EPA Method 5. When EPA Method 5 is required, the following modification is allowed: the heated filter may be separated from the impingers by a flexible tube.  
[Rule 62-297.310(4), F.A.C.]

**A.51. Required Stack Sampling Facilities**. When a mass emissions stack test is required, the permittee shall comply with the requirements contained in Appendix SS-1, Stack Sampling Facilities, attached to this permit.

[Rule 62-297.310(6), F.A.C.]

**A.52. Frequency of Compliance Tests**. The following provisions apply only to those emissions units that are subject to an emissions limiting standard for which compliance testing is required.

(a) General Compliance Testing.

2. For excess emission limitations for particulate matter specified in Rule 62-210.700, F.A.C., a compliance test shall be conducted annually while the emissions unit is operating under soot blowing conditions in each federal fiscal year during which soot blowing is part of normal emissions unit operation, except that such test shall not be required in any federal fiscal year in which a fossil fuel steam generator does not burn liquid and/or solid fuel for more than 400 hours other than during startup.

3. The owner or operator of an emissions unit that is subject to any emission limiting standard shall conduct a compliance test that demonstrates compliance with the applicable emission limiting standard prior to obtaining a renewed operation permit. Emissions units that are required to conduct an annual compliance test may submit the most recent annual compliance test to satisfy the requirements of this provision. In renewing an air operation permit pursuant to Rule 62-210.300(2)(a)3.b., c., or d., F.A.C., the Department shall not require submission of emission compliance test results for any emissions unit that, during the year prior to renewal:

a Did not operate; or

- b. In the case of a fuel burning emissions unit, burned liquid and/or solid fuel for a total of no more than 400 hours.
  - 4. During each federal fiscal year (October 1 - September 30), unless otherwise specified by rule, order, or permit, the owner or operator of each emissions unit shall have a formal compliance test conducted for:
    - a. Visible emissions, if there is an applicable standard;
    - b. Each of the following pollutants, if there is an applicable standard, and if the emissions unit emits or has the potential to emit: 5 tons per year or more of lead or lead compounds measured as elemental lead; 30 tons per year or more of acrylonitrile; or 100 tons per year or more of any other regulated air pollutant; and
    - c. Each NESHAP pollutant, if there is an applicable emission standard.
  - 5. An annual compliance test for particulate matter emissions shall not be required for any fuel burning emissions unit that, in a federal fiscal year, does not burn liquid and/or solid fuel, other than during startup, for a total of more than 400 hours.
  - 9. The owner or operator shall notify the Department, at least 15 days prior to the date on which each formal compliance test is to begin, of the date, time, and place of each such test, and the test contact person who will be responsible for coordinating and having such test conducted for the owner or operator.
  - (b) Special Compliance Tests. When the Department, after investigation, has good reason (such as complaints, increased visible emissions or questionable maintenance of control equipment) to believe that any applicable emission standard contained in a Department rule or in a permit issued pursuant to those rules is being violated, it may require the owner or operator of the emissions unit to conduct compliance tests which identify the nature and quantity of pollutant emissions from the emissions unit and to provide a report on the results of said tests to the Department.
  - (c) Waiver of Compliance Test Requirements. If the owner or operator of an emissions unit that is subject to a compliance test requirement demonstrates to the Department, pursuant to the procedure established in Rule 62-297.620, F.A.C., that the compliance of the emissions unit with an applicable weight emission limiting standard can be adequately determined by means other than the designated test procedure, such as specifying a surrogate standard of no visible emissions for particulate matter sources equipped with a bag house or specifying a fuel analysis for sulfur dioxide emissions, the Department shall waive the compliance test requirements for such emissions units and order that the alternate means of determining compliance be used, provided, however, the provisions of Rule 62-297.310(7)(b), F.A.C., shall apply.
- [Rule 62-297.310(7), F.A.C.; and, SIP approved]

**Recordkeeping and Reporting Requirements**

**A.53.** For sulfur dioxide, nitrogen oxides, and particulate matter emissions, the performance test data from the performance evaluation of the continuous monitors (including the transmissometer) are submitted to the Administrator.

[40 CFR 60.49a(a)]

**A.54.** For sulfur dioxide and nitrogen oxides the following information is reported to the Administrator for each 24-hour period.

- (1) Calendar date.
- (2) The average sulfur dioxide and nitrogen oxides emission rates (ng/J or lb/million Btu) for each 30 successive boiler operating days, ending with the last 30-day period in the quarter; reasons for non-compliance with the standards; and, description of corrective actions taken.
- (3) Percent reduction of the potential combustion concentration of sulfur dioxide for each 30 successive boiler operating days, ending with the last 30-day period in the quarter; reasons for non-compliance with the standard; and, description of corrective actions taken.
- (4) Identification of the boiler operating days for which pollutant or diluent data have not been obtained by an approved method for at least 18 hours of operation of the facility; justification for not obtaining sufficient data; and, description of corrective actions taken.
- (5) Identification of the times when emissions data have been excluded from the calculation of average emission rates because of startup, shutdown, malfunction (NO<sub>x</sub> only), emergency conditions (SO<sub>2</sub> only), or other reasons, and justification for excluding data other than startup, shutdown, malfunction, or emergency conditions.
- (6) Identification of "F" factor used for calculations, method of determination, and type of fuel combusted.
- (7) Identification of the times when hourly averages have been obtained based on manual sampling methods.
- (8) Identification of the times when the pollutant concentration exceeded full span of the continuous monitoring system.
- (9) Description of any modifications to the continuous monitoring system which could affect the ability of the continuous monitoring system to comply with Performance Specifications 2 or 3.

[40 CFR 60.49a(b)]

**A.55.** If the minimum quantity of emission data as required by 40 CFR 60.47a is not obtained for any 30 successive boiler operating days, the following information obtained under the requirements of 40 CFR 60.46a(h) is reported to the Administrator for that 30-day period:

- (1) The number of hourly averages available for outlet emission rates ( $n_o$ ) and inlet emission rates ( $n_i$ ) as applicable.
- (2) The standard deviation of hourly averages for outlet emission rates ( $s_o$ ) and inlet emission rates ( $s_i$ ) as applicable.
- (3) The lower confidence limit for the mean outlet emission rate ( $E_o^*$ ) and the upper confidence limit for the mean inlet emission rate ( $E_i^*$ ) as applicable.

- (4) The applicable potential combustion concentration.
  - (5) The ratio of the upper confidence limit for the mean outlet emission rate ( $E_o^*$ ) and the allowable emission rate ( $E_{std}$ ) as applicable.
- [40 CFR 60.49a(c)]

**A.56.** If any standards under 40 CFR 60.43a are exceeded during emergency conditions because of control system malfunction, the owner or operator of the affected facility shall submit a signed statement:

- (1) Indicating if emergency conditions existed and requirements under 40 CFR 60.46a(d) were met during each period, and
- (2) Listing the following information:
  - (i) Time periods the emergency condition existed;
  - (ii) Electrical output and demand on the owner or operator's electric utility system and the affected facility;
  - (iii) Amount of power purchased from interconnected neighboring utility companies during the emergency period;
  - (iv) Percent reduction in emissions achieved;
  - (v) Atmospheric emission rate (ng/J) of the pollutant discharged; and
  - (vi) Actions taken to correct control system malfunction.

[40 CFR 60.49a(d)]

**A.57.** If fuel pretreatment credit toward the sulfur dioxide emission standard under 40 CFR 60.43a is claimed, the owner or operator of the affected facility shall submit a signed statement:

- (1) Indicating what percentage cleaning credit was taken for the calendar quarter, and whether the credit was determined in accordance with the provisions of 40 CFR 60.48a and Method 19 (appendix A); and
- (2) Listing the quantity, heat content, and date each pretreated fuel shipment was received during the previous quarter; the name and location of the pretreatment facility; and the total quantity and total heat content of all fuels received at the affected facility during the previous quarter.

[40 CFR 60.49a(e)]

**A.58.** For any periods for which opacity, sulfur dioxide or nitrogen oxides emissions data are not available, the owner or operator of the affected facility shall submit a signed statement indicating if any changes were made in operation of the emission control system during the period of data unavailability. Operations of the control system and the affected facility during periods of data unavailability are to be compared with operation of the control system and the affected facility before and following the period of data unavailability.

[40 CFR 60.49a(f)]

**A.59.** The owner or operator of the affected facility shall submit a signed statement indicating whether:

- (1) The required continuous monitoring system calibration, span, and drift checks or other periodic audits have or have not been performed as specified.

- (2) The data used to show compliance was or was not obtained in accordance with approved methods and procedures of this part and is representative of plant performance.
- (3) The minimum data requirements have or have not been met; or, the minimum data requirements have not been met for errors that were unavoidable.
- (4) Compliance with the standards has or has not been achieved during the reporting period.  
[40 CFR 60.49a(g)]

**A.60.** For the purposes of the reports required under 40 CFR 60.7, periods of excess emissions are defined as all 6-minute periods during which the average opacity exceeds the applicable opacity standards under 40 CFR 60.42a(b). Opacity levels in excess of the applicable opacity standard and the date of such excesses are to be submitted to the Administrator each calendar quarter.  
[40 CFR 60.49a(h)]

**A.61.** The owner or operator of an affected facility shall submit the written reports required under this section and Subpart A to the Administrator for every calendar quarter. All quarterly reports shall be postmarked by the 30th day following the end of each calendar quarter.  
[40 CFR 60.49a(i)]

**A.62.** In the case of excess emissions resulting from malfunctions, each owner or operator shall notify the Department in accordance with Rule 62-4.130, F.A.C. A full written report on the malfunctions shall be submitted in a quarterly report, if requested by the Department.  
[Rule 62-210.700(6), F.A.C.]

**A.63.** Submit to the Department a written report of emissions in excess of emission limiting for each calendar quarter. The nature and cause of the excess emissions shall be explained. This report does not relieve the owner or operator of the legal liability for violations. All recorded data shall be maintained on file by the Source for a period of five years.  
[Rule 62-213.440, F.A.C.]

**A.64. Test Reports.**

- (a) The owner or operator of an emissions unit for which a compliance test is required shall file a report with the Department on the results of each such test.
- (b) The required test report shall be filed with the Department as soon as practical but no later than 45 days after the last sampling run of each test is completed.
- (c) The test report shall provide sufficient detail on the emissions unit tested and the test procedures used to allow the Department to determine if the test was properly conducted and the test results properly computed. As a minimum, the test report, other than for an EPA or DEP Method 9 test, shall provide the following information:
  - 1. The type, location, and designation of the emissions unit tested.
  - 2. The facility at which the emissions unit is located.
  - 3. The owner or operator of the emissions unit.

4. The normal type and amount of fuels used and materials processed, and the types and amounts of fuels used and material processed during each test run.
  5. The means, raw data and computations used to determine the amount of fuels used and materials processed, if necessary to determine compliance with an applicable emission limiting standard.
  6. The type of air pollution control devices installed on the emissions unit, their general condition, their normal operating parameters (pressure drops, total operating current and GPM scrubber water), and their operating parameters during each test run.
  7. A sketch of the duct within 8 stack diameters upstream and 2 stack diameters downstream of the sampling ports, including the distance to any upstream and downstream bends or other flow disturbances.
  8. The date, starting time and duration of each sampling run.
  9. The test procedures used, including any alternative procedures authorized pursuant to Rule 62-297.620, F.A.C. Where optional procedures are authorized in this chapter, indicate which option was used.
  10. The number of points sampled and configuration and location of the sampling plane.
  11. For each sampling point for each run, the dry gas meter reading, velocity head, pressure drop across the stack, temperatures, average meter temperatures and sample time per point.
  12. The type, manufacturer and configuration of the sampling equipment used.
  13. Data related to the required calibration of the test equipment.
  14. Data on the identification, processing and weights of all filters used.
  15. Data on the types and amounts of any chemical solutions used.
  16. Data on the amount of pollutant collected from each sampling probe, the filters, and the impingers, are reported separately for the compliance test.
  17. The names of individuals who furnished the process variable data, conducted the test, analyzed the samples and prepared the report.
  18. All measured and calculated data required to be determined by each applicable test procedure for each run.
  19. The detailed calculations for one run that relate the collected data to the calculated emission rate.
  20. The applicable emission standard, and the resulting maximum allowable emission rate for the emissions unit, plus the test result in the same form and unit of measure.
  21. A certification that, to the knowledge of the owner or his authorized agent, all data submitted are true and correct. When a compliance test is conducted for the Department or its agent, the person who conducts the test shall provide the certification with respect to the test procedures used. The owner or his authorized agent shall certify that all data required and provided to the person conducting the test are true and correct to his knowledge.
- [Rule 62-297.310(8), F.A.C.]

**A.65.** Records shall be kept of each delivery of “on-specification” used oil with a statement of the origin of the used oil and the quantity delivered/stored for firing. In addition, monthly records shall be kept of the quantity of “on-specification” used oil fired in this unit. The above records shall be maintained in a form suitable for inspection, retained for a minimum of five years, and be made available upon request. [Rule 62-213.440(1)(b)2.b., F.A.C.]

**A.66.** The permittee shall include in the “Annual Operating Report for Air Pollutant Emitting Facility” a summary of the “on-specification” used oil analyses for the calendar year and a statement of the total quantity of “on-specification” used oil fired during the calendar year. [Rule 62-213.440(1)(b)2.b., F.A.C.]

**A.67. Reporting and Recordkeeping**

- (1) Documentation verifying that the coal and petroleum coke fuel blends combusted in Units 1 and 2 have not exceeded the 30 percent maximum petroleum coke by weight limit shall be maintained and submitted to the Department’s Northeast District office with each annual report; and
  - (2) The permittee shall maintain and submit to the Department, on an annual basis for a period of five years from the date the units begin firing petroleum coke, data demonstrating that the operational change associated with the use of petroleum coke did not result in a significant emission increase pursuant to Rule 62-210.200(12)(d), F.A.C.
- [PSD-FL-018(A)]

**Miscellaneous Requirements.**

**A.68.** The permittee shall comply with the requirements contained in Appendix 40 CFR 60, Subpart A, attached to this permit. [Rule 62-204.800(7)(d), F.A.C.]

**A.69. Carbon Monoxide.** The permittee shall maintain and submit to the Department on an annual basis for a period of five years from the date the units begin firing petroleum coke, test results demonstrating that the operational changes associated with the use of petroleum coke did not result in a significant emission increase of the pollutant when compared to past emissions while firing coal. The carbon monoxide emissions shall be based on test results using EPA Method 10. [PSD-FL-018(A)]

**A.70. Sulfuric Acid Mist.** The permittee shall maintain and submit to the Department on an annual basis for a period of five years from the date the units begin firing petroleum coke, test results demonstrating that the operational changes associated with the use of petroleum coke did not result in a significant emission increase of the pollutant when compared to past emissions while firing coal. The sulfuric acid mist emissions shall be based on test results using EPA Method 8.  
[PSD-FL-018(A)]

**A.71.** The owner or operator may use the following as alternatives to the reference methods and procedures in 40 CFR 60.46 or in other sections as specified:

(1) The emission rate (E) of particulate matter, SO<sub>2</sub> and NO<sub>x</sub> may be determined by using the F<sub>c</sub> factor, provided that the following procedure is used:

(i) The emission rate (E) shall be computed using the following equation:

$$E = C F_c (100 / \% \text{ CO}_2)$$

where:

E = emission rate of pollutant, ng/J (lb/million Btu).

C = concentration of pollutant, ng/dscm (lb/dscf).

% CO<sub>2</sub> = carbon dioxide concentration, percent dry basis.

F<sub>c</sub> = factor as determined in appropriate sections of Method 19.

(ii) If and only if the average F<sub>c</sub> factor in Method 19 is used to calculate E and either E is from 0.97 to 1.00 of the emission standard or the relative accuracy of a continuous emission monitoring system is from 17 to 20 percent, then three runs of Method 3B shall be used to determine the O<sub>2</sub> and CO<sub>2</sub> concentration according to the procedures in 40 CFR 60.46(b) (2)(ii), (4)(ii), or (5)(ii). Then if F<sub>o</sub> (average of three runs), as calculated from the equation in Method 3B, is more than ± 3 percent than the average F<sub>o</sub> value, as determined from the average values of F<sub>d</sub> and F<sub>c</sub> in Method 19, i.e., F<sub>oa</sub> = 0.209 (F<sub>da</sub> / F<sub>ca</sub>), then the following procedure shall be followed:

(A) When F<sub>o</sub> is less than 0.97 F<sub>oa</sub>, then E shall be increased by that proportion under 0.97 F<sub>oa</sub>, e.g., if F<sub>o</sub> is 0.95 F<sub>oa</sub>, E shall be increased by 2 percent. This recalculated value shall be used to determine compliance with the emission standard.

(B) When F<sub>o</sub> is less than 0.97 F<sub>oa</sub> and when the average difference ( $\bar{d}$ ) between the continuous monitor minus the reference methods is negative, then E shall be increased by that proportion under 0.97 F<sub>oa</sub>, e.g., if F<sub>o</sub> is 0.95 F<sub>oa</sub>, E shall be increased by 2 percent. This recalculated value shall be used to determine compliance with the relative accuracy specification.

(C) When  $F_o$  is greater than  $1.03 F_{oa}$  and when  $\bar{d}$  is positive, then E shall be decreased by that proportion over  $1.03 F_{oa}$ , e.g., if  $F_o$  is  $1.05 F_{oa}$ , E shall be decreased by 2 percent. This recalculated value shall be used to determine compliance with the relative accuracy specification.

[40 CFR 60.46(d)(1)]

**Ambient Monitoring.**

**A.72. Not Federally Enforceable Air Monitoring Program.** The permittee shall operate an ambient monitoring device for sulfur dioxide in accordance with EPA reference methods in 40 CFR, Part 53 an ambient monitoring device for suspended particulate as shown in Figure 1, previously submitted as a part of the Power Plant Site Certification. The monitoring device shall be specifically located at a location approved by the Department. The frequency of operation shall be every six days commencing as specified by the Department. The ambient monitoring program may be reviewed annually by the Department and the permittee.

[PA 78-10, Revised August 10, 1989]

**A.73. Not Federally Enforceable Air Monitoring Program Reporting.** Ambient air monitoring data shall be reported to the Department quarterly commencing on the date of certification by the last day of the month following the quarterly reporting period utilizing the SAROAD or other format approved by the Department in writing.

[PA 78-10, Revised August 10, 1989]

### **Section III. Emissions Unit(s) and Conditions.**

**Subsection B. This section addresses the following emissions unit(s).**

**E.U.**

<b><u>ID No.</u></b>	<b><u>Brief Description</u></b>
-003	Rail Car Maintenance

The rail car maintenance facility consists of an abrasive blasting area and a surface coating operation.

{Permitting note(s): IMPORTANT REGULATORY CLASSIFICATIONS - The emissions unit is regulated under Rules 62-296.320, F.A.C., General Pollutant Emission Limiting Standards and the Power Plant Siting Act.}

**The following specific conditions apply to the emissions unit(s) listed above:**

#### **Essential Potential to Emit (PTE) Parameters**

**B.1. Hours of Operation.** This emissions unit is allowed to operate continuously, i.e., 8,760 hours/year. [Rule 62-210.200(PTE), F.A.C.]

#### **Emission Limitations and Standards**

{Permitting note: Table 1-1, Summary of Air Pollutant Standards and Terms, summarizes information for convenience purposes only. This table does not supersede any of the terms or conditions of this permit.}

**B.2. Visible Emissions.** Visible emissions shall not exceed 20 percent opacity. The cover and the partial enclosure of the shelter will act as a windbreak to minimize the amount of residual particulate that becomes airborne.  
[PA 78-10, Modified March 26, 1991]

**B.3.** Containment screens shall be installed on the northern and southern ends of the shelter.  
[PA 78-10E, dated March 2, 1995]

**B.4. Volatile Organic Compounds.** Volatile organic compound emissions shall not exceed 38.75 pounds per hour or 11.84 tons per year.  
[PA 78-10E, dated March 2, 1995]

### **Monitoring of Operations**

**B.5. Determination of Process Variables.**

(a) Required Equipment. The owner or operator of an emissions unit for which compliance tests are required shall install, operate, and maintain equipment or instruments necessary to determine process variables, such as process weight input or heat input, when such data are needed in conjunction with emissions data to determine the compliance of the emissions unit with applicable emission limiting standards.

(b) Accuracy of Equipment. Equipment or instruments used to directly or indirectly determine process variables, including devices such as belt scales, weight hoppers, flow meters, and tank scales, shall be calibrated and adjusted to indicate the true value of the parameter being measured with sufficient accuracy to allow the applicable process variable to be determined within 10% of its true value.  
[Rule 62-297.310(5), F.A.C.]

{Permitting note: Emission limiting standards for the rail car maintenance emission unit consist only of visible emissions (VE) and volatile organic compounds (VOC). A determination of compliance with either emission limiting standard is through product constituents and is not dependent on the use of instruments or equipment to determine process variables.}

### **Test Methods and Procedures**

{Permitting note: Table 2-1, Summary of Compliance Requirements, summarizes information for convenience purposes only. This table does not supersede any of the terms or conditions of this permit.}

**B.6. Visible Emissions.** EPA Method 9 shall be used to determine compliance with the opacity limit pursuant to Chapter 62-297, F.A.C.  
[Rules 62-213.440 and 62-297.401, F.A.C.]

**B.7. Volatile Organic Compounds.** Material balance and record keeping shall be used to determine emissions of volatile organic compounds.  
[Rules 62-213.400 and 62-296.320(1)(a), F.A.C.]

**B.8. Applicable Test Procedures.**

**(a) Required Sampling Time.**

2. Opacity Compliance Tests. When either EPA Method 9 or DEP Method 9 is specified as the applicable opacity test method, the required minimum period of observation for a compliance test shall be sixty (60) minutes for emissions units which emit or have the potential to emit 100 tons per year or more of particulate matter, and thirty (30) minutes for emissions units which have potential emissions less than 100 tons per year of particulate matter and are not subject to a multiple-valued opacity standard. The opacity test observation period shall include the period during which the highest opacity emissions can reasonably be expected to occur. Exceptions to these requirements are as follows:

- c. The minimum observation period for opacity tests conducted by employees or agents of the Department to verify the day-to-day continuing compliance of a unit or activity with an applicable opacity standard shall be twelve minutes.

[Rule 62-297.310(4)(a)2.c., F.A.C.]

{Permitting note: EPA Method 9 has been previously specified as the applicable opacity test method. Potential PM emissions are less than 100 tons per year.}

**B.9. Frequency of Compliance Tests.** The following provisions apply only to those emissions units that are subject to an emissions limiting standard for which compliance testing is required.

**(a) General Compliance Testing.**

3. The owner or operator of an emissions unit that is subject to any emission limiting standard shall conduct a compliance test that demonstrates compliance with the applicable emission limiting standard prior to obtaining a renewed operation permit. Emissions units that are required to conduct an annual compliance test may submit the most recent annual compliance test to satisfy the requirements of this provision. In renewing an air operation permit pursuant to Rule 62-210.300(2)(a)3.b., c., or d., F.A.C., the Department shall not require submission of emission compliance test results for any emissions unit that, during the year prior to renewal:

- a. Did not operate;

4. During each federal fiscal year (October 1 - September 30), unless otherwise specified by rule, order, or permit, the owner or operator of each emissions unit shall have a formal compliance test conducted for:

- a. Visible emissions, if there is an applicable standard;

9. The owner or operator shall notify the Department, at least 15 days prior to the date on which each formal compliance test is to begin, of the date, time, and place of each such test, and the test contact person who will be responsible for coordinating and having such test conducted for the owner or operator.

(b) Special Compliance Tests. When the Department, after investigation, has good reason (such as complaints, increased visible emissions or questionable maintenance of control equipment) to believe that any applicable emission standard contained in a Department rule or in a permit issued pursuant to those rules is being violated, it may require the owner or operator of the emissions unit to conduct compliance tests which identify the nature and quantity of pollutant emissions from the emissions unit and to provide a report on the results of said tests to the Department.

(c) Waiver of Compliance Test Requirements. If the owner or operator of an emissions unit that is subject to a compliance test requirement demonstrates to the Department, pursuant to the procedure established in Rule 62-297.620, F.A.C., that the compliance of the emissions unit with an applicable weight emission limiting standard can be adequately determined by means other than the designated test procedure, such as specifying a surrogate standard of no visible emissions for particulate matter sources equipped with a bag house or specifying a fuel analysis for sulfur dioxide emissions, the Department shall waive the compliance test requirements for such emissions units and order that the alternate means of determining compliance be used, provided, however, the provisions of Rule 62-297.310(7)(b), F.A.C., shall apply.

[Rule 62-297.310(7), F.A.C.; and, SIP approved]

#### **Recordkeeping and Reporting Requirements**

**B.10. Record Keeping.** The owner or operator shall record the application rate of all surface coatings, the total of all coatings applied and calculate the rate of volatile organic compound emissions through the use of materials balance. These records will be maintained for five years and will be made available to the Department upon request.

[Rule 62-213.400, F.A.C.]

#### **B.11. Test Reports.**

(a) The owner or operator of an emissions unit for which a compliance test is required shall file a report with the Department on the results of each such test.

(b) The required test report shall be filed with the Department as soon as practical but no later than 45 days after the last sampling run of each test is completed.

[Rule 62-297.310(8), F.A.C.]

### **Section III. Emissions Unit(s) and Conditions.**

#### **Subsection C. This section addresses the following emissions unit(s).**

##### **E.U.**

<b><u>ID No.</u></b>	<b><u>Brief Description</u></b>
-004	Coal Storage Yard

The coal receiving, storage and transfer systems at the coal storage yard support the operation of the two power boilers. Particulate matter emissions are controlled at the "as-received transfer tower", the "as-fired transfer tower", and the conveyors to the silos by fabric filter systems. Water sprays, full enclosures or partial enclosures are also utilized, where appropriate.

{Permitting note(s): IMPORTANT REGULATORY CLASSIFICATIONS - The emissions unit is regulated under NSPS - 40 CFR 60, Subpart Y, Standards of Performance for Coal Preparation Plants, adopted and incorporated by reference in Rule 62-204.800(7), F.A.C.; Prevention of Significant Deterioration (PSD); Rule 62-212.400(6), F.A.C., Best Available Control Technology (BACT) Determination, dated June 15, 1979. The coal storage yard began commercial operation in 1985.}

#### **The following specific conditions apply to the emissions unit(s) listed above:**

##### **Essential Potential to Emit (PTE) Parameters**

**C.1. Permitted Capacity.** The maximum throughput rate shall not exceed 3,000 tons per hour.  
[Rules 62-4.160(2) and 62-210.200(PTE), F.A.C.; and, Initial Title V application received June 17, 1996]

**C.2. Emissions Unit Operating Rate Limitation After Testing.** See specific condition **C.7.**  
[Rule 62-297.310(2), F.A.C.]

**C.3. Hours of Operation.** This emissions unit is allowed to operate continuously, i.e., 8,760 hours/year.  
[Rule 62-210.200(PTE), F.A.C.]

### **Emission Limitations and Standards**

{Permitting note: Table 1-1, Summary of Air Pollutant Standards and Terms, summarizes information for convenience purposes only. This table does not supersede any of the terms or conditions of this permit.}

**C.4. Visible Emissions.** An owner or operator shall not cause to be discharged into the atmosphere from any coal processing and conveying equipment, coal storage system, or coal transfer and loading system processing coal, gases which exhibit 20 percent opacity or greater.  
[40 CFR 60.252(c); and, PSD-FL-018]

### **Monitoring of Operations**

#### **C.5. Determination of Process Variables.**

(a) **Required Equipment.** The owner or operator of an emissions unit for which compliance tests are required shall install, operate, and maintain equipment or instruments necessary to determine process variables, such as process weight input or heat input, when such data are needed in conjunction with emissions data to determine the compliance of the emissions unit with applicable emission limiting standards.

(b) **Accuracy of Equipment.** Equipment or instruments used to directly or indirectly determine process variables, including devices such as belt scales, weight hoppers, flow meters, and tank scales, shall be calibrated and adjusted to indicate the true value of the parameter being measured with sufficient accuracy to allow the applicable process variable to be determined within 10% of its true value.  
[Rule 62-297.310(5), F.A.C.]

{Permitting note: Emission limiting standards for the coal handling and storage emission unit consist only of visible emissions (VE). Compliance with the VE standard is determined using EPA Method 9. A determination of compliance is not dependent on the use of instruments or equipment to determine process variables.}

### **Test Methods and Procedures**

{Permitting note: Table 2-1, Summary of Compliance Requirements, summarizes information for convenience purposes only. This table does not supersede any of the terms or conditions of this permit.}

**C.6. Visible Emissions.** EPA Method 9 and the procedures in 40 CFR 60.11 shall be used to determine opacity.  
[40 CFR 60.254(b)(2); and, PSD-FL-018]

**C.7. Operating Rate During Testing.** Testing of emissions shall be conducted with the emissions unit operation at permitted capacity, which is defined as 90 to 100 percent of the maximum operation rate allowed by the permit. If it is impracticable to test at permitted capacity, an emissions unit may be tested at less than the minimum permitted capacity; in this case, subsequent emissions unit operation is limited to 110 percent of the test load until a new test is conducted. Once the emissions unit is so limited, operation at higher capacities is allowed for no more than 15 consecutive days for the purpose of additional compliance testing to regain the authority to operate at the permitted capacity.  
[Rules 62-297.310(2) & (2)(b), F.A.C.]

{Permitting note: The permitted capacity of the coal handling and storage emissions unit is based on conveyor belt capacity. Conveyor belt speed is set and does not vary during normal operation. However, feeder belts which supply coal to the conveyor belts are variable speed. Bins, crushers, and silos are filled on a batch process basis by the conveyor belts which are either on or off. The period at which the highest opacity emissions can reasonably be expected to occur at the emissions points subject to the standard, i.e., (CH-002, CH-011, and CH-012a and b) will be when the conveyor belts are on during normal operation. Therefore, the period during which the conveyor belts are on during normal operation shall represent permitted capacity of this emissions unit for purposes of compliance testing.}

**C.8. Applicable Test Procedures.**

**(a) Required Sampling Time.**

2. Opacity Compliance Tests. When either EPA Method 9 or DEP Method 9 is specified as the applicable opacity test method, the required minimum period of observation for a compliance test shall be sixty (60) minutes for emissions units which emit or have the potential to emit 100 tons per year or more of particulate matter, and thirty (30) minutes for emissions units which have potential emissions less than 100 tons per year of particulate matter and are not subject to a multiple-valued opacity standard. The opacity test observation period shall include the period during which the highest opacity emissions can reasonably be expected to occur. Exceptions to these requirements are as follows:

- c. The minimum observation period for opacity tests conducted by employees or agents of the Department to verify the day-to-day continuing compliance of a unit or activity with an applicable opacity standard shall be twelve minutes.

[Rule 62-297.310(4)(a)2.c., F.A.C.]

{Permitting note: EPA Method 9 has been previously specified as the applicable opacity test method.}

**C.9. Frequency of Compliance Tests.** The following provisions apply only to those emissions units that are subject to an emissions limiting standard for which compliance testing is required.

**(a) General Compliance Testing.**

3. The owner or operator of an emissions unit that is subject to any emission limiting standard shall conduct a compliance test that demonstrates compliance with the applicable emission limiting standard prior to obtaining a renewed operation permit. Emissions units that are required to conduct an annual compliance test may submit the most recent annual compliance test to satisfy the requirements of this provision. In renewing an air operation permit pursuant to Rule 62-210.300(2)(a)3.b., c., or d., F.A.C., the Department shall not require submission of emission compliance test results for any emissions unit that, during the year prior to renewal:

a. Did not operate;

4. During each federal fiscal year (October 1 - September 30), unless otherwise specified by rule, order, or permit, the owner or operator of each emissions unit shall have a formal compliance test conducted for:

a. Visible emissions, if there is an applicable standard;

9. The owner or operator shall notify the Department, at least 15 days prior to the date on which each formal compliance test is to begin, of the date, time, and place of each such test, and the test contact person who will be responsible for coordinating and having such test conducted for the owner or operator.

**(b) Special Compliance Tests.** When the Department, after investigation, has good reason (such as complaints, increased visible emissions or questionable maintenance of control equipment) to believe that any applicable emission standard contained in a Department rule or in a permit issued pursuant to those rules is being violated, it may require the owner or operator of the emissions unit to conduct compliance tests which identify the nature and quantity of pollutant emissions from the emissions unit and to provide a report on the results of said tests to the Department.

**(c) Waiver of Compliance Test Requirements.** If the owner or operator of an emissions unit that is subject to a compliance test requirement demonstrates to the Department, pursuant to the procedure established in Rule 62-297.620, F.A.C., that the compliance of the emissions unit with an applicable weight emission limiting standard can be adequately determined by means other than the designated test procedure, such as specifying a surrogate standard of no visible emissions for particulate matter sources equipped with a bag house or specifying a fuel analysis for sulfur dioxide emissions, the Department shall waive the compliance test requirements for such emissions units and order that the alternate means of determining compliance be used, provided, however, the provisions of Rule 62-297.310(7)(b), F.A.C., shall apply.

[Rule 62-297.310(7), F.A.C.; and, SIP approved]

{Permitting note: The individual coal handling and storage emission points requiring an annual VE test are those containing baghouse controls. These baghouse locations are emission points CH-002, CH-011, and CH-012a and b.}

**Recordkeeping and Reporting Requirements**

**C.10. Test Reports.**

(a) The owner or operator of an emissions unit for which a compliance test is required shall file a report with the Department on the results of each such test.

(b) The required test report shall be filed with the Department as soon as practical but no later than 45 days after the last sampling run of each test is completed.

[Rule 62-297.310(8), F.A.C.]

**Miscellaneous Requirements.**

**C.11.** The permittee shall comply with the requirements contained in Appendix 40 CFR 60, Subpart A, attached to this permit.

[Rule 62-204.800(7)(d), F.A.C.]

**C.12.** The opacity standards set forth in 40 CFR 60 shall apply at all times except during periods of startup, shutdown, malfunction and as otherwise provided in the applicable standard.

At all times, including periods of startup, shutdown, and malfunction, owners and operators shall, to the extent practicable, maintain and operate any affected facility including associated air pollution control equipment in a manner consistent with good air pollution control practice for minimizing emissions. Determination of whether acceptable operating and maintenance procedures are being used will be based on information available to the Administrator which may include, but is not limited to, monitoring results, opacity observations, review of operating and maintenance procedures, and inspection of the source.

[40 CFR 60.11(c) & (d)]

### Section III. Emissions Unit(s) and Conditions.

**Subsection D. This section addresses the following emissions unit(s).**

**E.U.**

**ID No.      Brief Description**

-xxx      Limestone and FGD Sludge Handling and Storage

The limestone and FGD sludge handling and storage system consists of a limestone unloading facility where particulate matter emissions are controlled by a panel filter, a limestone handling and storage system which utilizes a partial enclosure to control particulate matter emissions, and a FGD sludge stabilization system which controls emissions by utilizing bag house filters and scrubbers.

{Permitting note(s): IMPORTANT REGULATORY CLASSIFICATIONS - The emissions unit is regulated under Prevention of Significant Deterioration (PSD); Rule 62-212.400(6), F.A.C., Best Available Control Technology (BACT) Determination, dated June 15, 1979.}

**The following specific conditions apply to the emissions unit(s) listed above:**

**Essential Potential to Emit (PTE) Parameters**

**D.1. Permitted Capacity.** The maximum limestone unloading or transfer rate shall not exceed 72.38 tons per hour. The throughput rates for the sludge stabilization system are intermittent and variable. [Rules 62-4.160(2) and 62-210.200(PTE), F.A.C.; and, Initial Title V application received June 17, 1996]

**D.2. Emissions Unit Operating Rate Limitation After Testing.** See specific condition D.7. [Rule 62-297.310(2), F.A.C.]

**D.3. Hours of Operation.** This emissions unit is allowed to operate continuously, i.e., 8,760 hours/year. [Rule 62-210.200(PTE), F.A.C.]

### **Emission Limitations and Standards**

{Permitting note: Table 1-1, Summary of Air Pollutant Standards and Terms, summarizes information for convenience purposes only. This table does not supersede any of the terms or conditions of this permit.}

**D.4. Visible Emissions.** An owner or operator shall not cause to be discharged into the atmosphere gases which exhibit 20 percent opacity or greater.  
[PSD-FL-018]

### **Monitoring of Operations**

#### **D.5. Determination of Process Variables.**

(a) Required Equipment. The owner or operator of an emissions unit for which compliance tests are required shall install, operate, and maintain equipment or instruments necessary to determine process variables, such as process weight input or heat input, when such data are needed in conjunction with emissions data to determine the compliance of the emissions unit with applicable emission limiting standards.

(b) Accuracy of Equipment. Equipment or instruments used to directly or indirectly determine process variables, including devices such as belt scales, weight hoppers, flow meters, and tank scales, shall be calibrated and adjusted to indicate the true value of the parameter being measured with sufficient accuracy to allow the applicable process variable to be determined within 10% of its true value.  
[Rule 62-297.310(5), F.A.C.]

{Permitting note: Emission limiting standards for the limestone and FGD sludge handling and storage emission unit consist only of visible emissions (VE). Compliance with the VE standard is determined using EPA Method 9, which is not dependent on the use of instruments or equipment to determine process variables.}

### **Test Methods and Procedures**

{Permitting note: Table 2-1, Summary of Compliance Requirements, summarizes information for convenience purposes only. This table does not supersede any of the terms or conditions of this permit.}

**D.6. Visible Emissions.** EPA Method 9 shall be used to determine opacity compliance pursuant to Chapter 62-297, F.A.C.  
[Rules 62-213.440 and 62-297.401, F.A.C.]

**D.7. Operating Rate During Testing.** Testing of emissions shall be conducted with the emissions unit operation at permitted capacity, which is defined as 90 to 100 percent of the maximum operation rate allowed by the permit. If it is impracticable to test at permitted capacity, an emissions unit may be tested at less than the minimum permitted capacity; in this case, subsequent emissions unit operation is limited to 110 percent of the test load until a new test is conducted. Once the emissions unit is so limited, operation at higher capacities is allowed for no more than 15 consecutive days for the purpose of additional compliance testing to regain the authority to operate at the permitted capacity.

[Rules 62-297.310(2) & (2)(b), F.A.C.]

{Permitting note: The permitted capacity of the limestone handling and storage emissions unit is based on trucks per hour. Trucks per hour has no bearing on determining the period at which the highest opacity emissions can reasonably be expected to occur at emission point L-001. Normal operating conditions when trucks are delivering/unloading constitute the appropriate time period for VE testing. Therefore, such periods shall represent permitted capacity for compliance testing.}

**D.8. Applicable Test Procedures.**

(a) **Required Sampling Time.**

2. Opacity Compliance Tests. When either EPA Method 9 or DEP Method 9 is specified as the applicable opacity test method, the required minimum period of observation for a compliance test shall be sixty (60) minutes for emissions units which emit or have the potential to emit 100 tons per year or more of particulate matter, and thirty (30) minutes for emissions units which have potential emissions less than 100 tons per year of particulate matter and are not subject to a multiple-valued opacity standard. The opacity test observation period shall include the period during which the highest opacity emissions can reasonably be expected to occur. Exceptions to these requirements are as follows:

c. The minimum observation period for opacity tests conducted by employees or agents of the Department to verify the day-to-day continuing compliance of a unit or activity with an applicable opacity standard shall be twelve minutes.

[Rule 62-297.310(4)(a)2.c., F.A.C.]

{Permitting note: EPA Method 9 has been previously specified as the applicable opacity test method.}

**D.9. Frequency of Compliance Tests.** The following provisions apply only to those emissions units that are subject to an emissions limiting standard for which compliance testing is required.

(a) **General Compliance Testing.**

3. The owner or operator of an emissions unit that is subject to any emission limiting standard shall conduct a compliance test that demonstrates compliance with the applicable emission limiting standard prior to obtaining a renewed operation permit. Emissions units that are required to conduct an annual compliance test may submit the most recent annual compliance test to satisfy the

requirements of this provision. In renewing an air operation permit pursuant to Rule 62-210.300(2)(a)3.b., c., or d., F.A.C., the Department shall not require submission of emission compliance test results for any emissions unit that, during the year prior to renewal:

- a. Did not operate;
4. During each federal fiscal year (October 1 - September 30), unless otherwise specified by rule, order, or permit, the owner or operator of each emissions unit shall have a formal compliance test conducted for:
  - a. Visible emissions, if there is an applicable standard;
9. The owner or operator shall notify the Department, at least 15 days prior to the date on which each formal compliance test is to begin, of the date, time, and place of each such test, and the test contact person who will be responsible for coordinating and having such test conducted for the owner or operator.

(b) Special Compliance Tests. When the Department, after investigation, has good reason (such as complaints, increased visible emissions or questionable maintenance of control equipment) to believe that any applicable emission standard contained in a Department rule or in a permit issued pursuant to those rules is being violated, it may require the owner or operator of the emissions unit to conduct compliance tests which identify the nature and quantity of pollutant emissions from the emissions unit and to provide a report on the results of said tests to the Department.

(c) Waiver of Compliance Test Requirements. If the owner or operator of an emissions unit that is subject to a compliance test requirement demonstrates to the Department, pursuant to the procedure established in Rule 62-297.620, F.A.C., that the compliance of the emissions unit with an applicable weight emission limiting standard can be adequately determined by means other than the designated test procedure, such as specifying a surrogate standard of no visible emissions for particulate matter sources equipped with a bag house or specifying a fuel analysis for sulfur dioxide emissions, the Department shall waive the compliance test requirements for such emissions units and order that the alternate means of determining compliance be used, provided, however, the provisions of Rule 62-297.310(7)(b), F.A.C., shall apply.

[Rule 62-297.310(7), F.A.C.; and, SIP approved]

{Permitting note: The individual limestone and FGD sludge handling points requiring an annual VE test are those containing filter and wet scrubber equipment. These locations are emissions points L-001, FGD-002, FGD-003 or FGD-004, FGD-005 or FGD-006, FGD-007 or FGD-008, and FGD-009 or FGD-010.}

### **Recordkeeping and Reporting Requirements**

#### **D.10. Test Reports.**

- (a) The owner or operator of an emissions unit for which a compliance test is required shall file a report with the Department on the results of each such test.
- (b) The required test report shall be filed with the Department as soon as practical but no later than 45 days after the last sampling run of each test is completed.

[Rule 62-297.310(8), F.A.C.]

**Section IV. This section is the Acid Rain Part.**

**Operated by:** Seminole Electric Cooperative, Inc.  
**ORIS code:** 136

**Subsection A. This subsection addresses Acid Rain, Phase II.**

The emissions units listed below are regulated under Acid Rain, Phase II.

**E.U.**

**ID No.    Brief Description**

-001    Steam Electric Generator No. 1  
-002    Steam Electric Generator No. 2

**A.1.** The Phase II permit application(s) submitted for this facility, as approved by the Department, are a part of this permit. The owners and operators of these Phase II acid rain unit(s) must comply with the standard requirements and special provisions set forth in the application(s) listed below:

- a. DEP Form No. 62-210.900(1)(a), dated December 5, 1995; and  
[Chapter 62-213, F.A.C. and Rule 62-214.320, F.A.C.]

**A.2.** Sulfur dioxide (SO<sub>2</sub>) allowance allocations and nitrogen oxide (NO<sub>x</sub>) requirements for each Acid Rain unit is as follows:

<b><u>E.U. ID</u></b> <b><u>No.</u></b>	<b><u>EPA ID</u></b>	<b><u>Year</u></b>	<b>2000</b>	<b>2001</b>	<b>2002</b>	<b>2003</b>
-001	U1	SO2 allowances, under Table 2 or 3 of 40 CFR Part 73	18,232*	18,232*	18,232*	18,232*
-002	U2	SO2 allowances, under Table 2 or 3 of 40 CFR Part 73	18,232*	18,232*	18,232*	18,232*

\* The number of allowances held by an Acid Rain source in a unit account may differ from the number allocated by the USEPA under Table 2 or 3 of 40 CFR 73.]

**A.3. Emission Allowances.** Emissions from sources subject to the Federal Acid Rain Program (Title IV) shall not exceed any allowances that the source lawfully holds under the Federal Acid Rain Program. Allowances shall not be used to demonstrate compliance with a non-Title IV applicable requirement of the Act.

1. No permit revision shall be required for increases in emissions that are authorized by allowances acquired pursuant to the Federal Acid Rain Program, provided that such increases do not require a permit revision pursuant to Rule 62-213.400(3), F.A.C.

2. No limit shall be placed on the number of allowances held by the source under the Federal Acid Rain Program.

3. Allowances shall be accounted for under the Federal Acid Rain Program.

[Rule 62-213.440(1)(c), F.A.C.]

**A.4. Statement of Compliance.** The annual statement of compliance pursuant to Rule 62-213.440(3), F.A.C., shall be submitted within 60 (sixty) days after the end of the calendar year. {See condition 51., APPENDIX TV-1, TITLE V CONDITIONS}

[Rule 62-214.420(11), F.A.C.]

**A.5. Comments, notes, and justifications:** None.

**Subsection B. This subsection addresses Acid Rain, Phase I.**

{Permitting note: The U.S. EPA issues Acid Rain Phase I permit(s)}

The emissions unit listed below is regulated under Acid Rain Part, Phase I, for Seminole Electric Cooperative, Inc, Seminole Power Plant, **Facility ID No.:** 1070025, **ORIS code:** 136.

**E.U. ID**

<b><u>No.</u></b>	<b><u>Brief Description</u></b>
-001	Steam Electric Generator No. 1
-002	Steam Electric Generator No. 2

The provisions of the federal Acid Rain, Phase I permit(s), including Early Election Plans for NO<sub>x</sub>, govern(s) the above listed emissions unit(s) through December 31, 1999. The provisions of the Phase II permit govern(s) those emissions unit(s) from January 1, 2000 through the expiration date of this Title V permit. The Phase II permit governs all other affected units for the effective period of this permit.

**B.1.** The owners and operators of these Phase I acid rain unit(s) must comply with the standard requirements and special provisions set forth in the permit(s) listed below:

- a. Phase I permit dated 03/27/97.  
[Chapter 62-213, F.A.C.]

**B.2.** Nitrogen oxide (NO<sub>x</sub>) requirements for each Acid Rain unit is as follows:

<u>E.U. ID</u> <u>No.</u>	<u>EPA ID</u>	<u>NO<sub>x</sub> limit</u> *
-001	U1	<p>Pursuant to 40 CFR 76.8(d)(2), the Florida Department of Environmental Protection approves a NO<sub>x</sub> early election compliance plan for unit U1. The compliance plan is effective for calendar year 2000 through calendar year 2007. Under the compliance plan, this unit's annual average NO<sub>x</sub> emission rate for each year, determined in accordance with 40 CFR part 75, shall not exceed the applicable emission limitation, under "40 CFR 76.5(a)(2) of 0.50 lb/mmBtu" for dry bottom wall-fired boilers. If the unit is in compliance with its applicable emission limitation for each year of the plan, then the unit shall not be subject to the applicable emission limitation, under "40 CFR 76.7(a)(2) of 0.46 lb/mmBtu" for dry bottom wall-fired boilers until calendar year 2008.</p> <p>In addition to the described NO<sub>x</sub> compliance plan, this unit shall comply with all other applicable requirements of 40 CFR part 76, including the duty to reapply for a NO<sub>x</sub> compliance plan and the requirements covering excess emissions.</p>
-002	U2	<p>Pursuant to 40 CFR 76.8(d)(2), the Florida Department of Environmental Protection approves a NO<sub>x</sub> early election compliance plan for unit U2. The compliance plan is effective for calendar year 2000 through calendar year 2007. Under the compliance plan, this unit's annual average NO<sub>x</sub> emission rate for each year, determined in accordance with 40 CFR part 75, shall not exceed the applicable emission limitation, under "40 CFR 76.5(a)(2) of 0.50 lb/mmBtu" for dry bottom wall-fired boilers. If the unit is in compliance with its applicable emission limitation for each year of the plan, then the unit shall not be subject to the applicable emission limitation, under "40 CFR 76.7(a)(2) of 0.46 lb/mmBtu" for dry bottom wall-fired boilers until calendar year 2008.</p> <p>In addition to the described NO<sub>x</sub> compliance plan, this unit shall comply with all other applicable requirements of 40 CFR part 76, including the duty to reapply for a NO<sub>x</sub> compliance plan and the requirements covering excess emissions.</p>

\* Based on the Phase II NO<sub>x</sub> Compliance Plan dated November 21, 1997.

**B.3.** Comments, notes, and justifications: none

## Appendix 40 CFR 60 Subpart A-General Provisions (Version dated 07/23/97)

These conditions are based on the July 1996 CFR version.

**[Applicability note: These conditions are for an NSPS emissions unit (a.k.a. "federal facility") that has been built and has conducted the initial performance test(s) in accordance with 40 CFR 60.8.]**

{Note: Rule 62-204.800(d), F.A.C., did not adopt/incorporate 40 CFR 60.4, 40 CFR 60.16, and 40 CFR 60.17.}

---

1. Definitions. For the purposes of Rule 62-204.800(7), F.A.C., the definitions contained in the various provisions of 40 CFR 60, shall apply except that the term "Administrator" when used in 40 CFR 60, shall mean the Secretary or the Secretary's designee.

[40 CFR 60.2; Rule 62-204.800(7)(a), F.A.C.]

### **40 CFR 60.7 Notification and record keeping.**

2. The owner or operator subject to the provisions of 40 CFR 60 shall furnish the Administrator written notification as follows:

(4) A notification of any physical or operational change to an existing facility which may increase the emission rate of any air pollutant to which a standard applies, unless that change is specifically exempted under an applicable subpart or in 40 CFR 60.14(e). This notice shall be postmarked 60 days or as soon as practicable before the change is commenced and shall include information describing the precise nature of the change, present and proposed emission control systems, productive capacity of the facility before and after the change, and the expected completion date of the change. The Administrator may request additional relevant information subsequent to this notice.

[40 CFR 60.7(a)(4)]

3. The owner or operator subject to the provisions of 40 CFR 60 shall maintain records of the occurrence and duration of any startup, shutdown, or malfunction in the operation of an affected facility; any malfunction of the air pollution control equipment; or, any periods during which a continuous monitoring system or monitoring device is inoperative.

[40 CFR 60.7(b)]

4. Each owner or operator required to install a continuous monitoring system (CMS) or monitoring device shall submit an excess emissions and monitoring systems performance report (excess emissions are defined in applicable subparts) and/or a summary report form [see 40 CFR 60.7(d)] to the Administrator semiannually, except when: more frequent reporting is specifically required by an applicable subpart; or, the CMS data are to be used directly for compliance determination, in which case quarterly reports shall be submitted; or, the Administrator, on a case-by-case basis, determines that more frequent reporting is necessary to accurately assess the compliance status of the source. All reports shall be postmarked by the 30th day following the end of each calendar half (or quarter, as appropriate).

Written reports of excess emissions shall include the following information:

(1) The magnitude of excess emissions computed in accordance with 40 CFR 60.13(h), any conversion factor(s) used, and the date and time of commencement and completion of each time period of excess emissions. The process operating time during the reporting period.

(2) Specific identification of each period of excess emissions that occurs during startups, shutdowns, and malfunctions of the affected facility. The nature and cause of any malfunction (if known), the corrective action taken or preventative measures adopted.

- (3) The date and time identifying each period during which the continuous monitoring system was inoperative except for zero and span checks and the nature of the system repairs or adjustments.
- (4) When no excess emissions have occurred or the continuous monitoring system(s) have not been inoperative, repaired, or adjusted, such information shall be stated in the report.
- [40 CFR 60.7(c)(1), (2), (3), and (4)]

5. The summary report form shall contain the information and be in the format shown in Figure 1 (attached) unless otherwise specified by the Administrator. One summary report form shall be submitted for each pollutant monitored at each affected facility.

(1) If the total duration of excess emissions for the reporting period is less than 1 percent of the total operating time for the reporting period and CMS downtime for the reporting period is less than 5 percent of the total operating time for the reporting period, only the summary report form shall be submitted and the excess emission report described in 40 CFR 60.7(c) need not be submitted unless requested by the Administrator.

(2) If the total duration of excess emissions for the reporting period is 1 percent or greater of the total operating time for the reporting period or the total CMS downtime for the reporting period is 5 percent or greater of the total operating time for the reporting period, the summary report form and the excess emission report described in 40 CFR 60.7(c) shall both be submitted.

*{See attached Figure 1: Summary Report-Gaseous and Opacity Excess Emission and Monitoring System Performance}* (electronic file name: *figure1.doc*)

[40 CFR 60.7(d)(1) and (2)]

6. (1) Notwithstanding the frequency of reporting requirements specified in 40 CFR 60.7(c), an owner or operator who is required by an applicable subpart to submit excess emissions and monitoring systems performance reports (and summary reports) on a quarterly (or more frequent) basis may reduce the frequency of reporting for that standard to semiannual if the following conditions are met:

(i) For 1 full year (e.g., 4 quarterly or 12 monthly reporting periods) the affected facility's excess emissions and monitoring systems reports submitted to comply with a standard under this part continually demonstrate that the facility is in compliance with the applicable standard;

(ii) The owner or operator continues to comply with all recordkeeping and monitoring requirements specified in 40 CFR 60, Subpart A, and the applicable standard; and

(iii) The Administrator does not object to a reduced frequency of reporting for the affected facility, as provided in 40 CFR 60.7(e)(2).

(2) The frequency of reporting of excess emissions and monitoring systems performance (and summary) reports may be reduced only after the owner or operator notifies the Administrator in writing of his or her intention to make such a change and the Administrator does not object to the intended change. In deciding whether to approve a reduced frequency of reporting, the Administrator may review information concerning the source's entire previous performance history during the required recordkeeping period prior to the intended change, including performance test results, monitoring data, and evaluations of an owner or operator's conformance with operation and maintenance requirements. Such information may be used by the Administrator to make a judgment about the source's potential for noncompliance in the future. If the Administrator disapproves the owner or operator's request to reduce the frequency of reporting, the Administrator will notify the owner or operator in writing within 45 days after receiving notice of the owner or operator's intention. The notification from the Administrator to the owner or operator will specify the grounds on which the disapproval is based. In the absence of a notice of disapproval within 45 days, approval is automatically granted.

(3) As soon as monitoring data indicate that the affected facility is not in compliance with any emission limitation or operating parameter specified in the applicable standard, the frequency of reporting shall revert to the frequency specified in the applicable standard, and the owner or operator shall submit an excess emissions and monitoring systems performance report (and summary report, if required) at the next appropriate reporting period following the noncomplying event. After

demonstrating compliance with the applicable standard for another full year, the owner or operator may again request approval from the Administrator to reduce the frequency of reporting for that standard as provided for in 40 CFR 60.7(e)(1) and (e)(2).

[40 CFR 60.7(e)(1)]

7. Any owner or operator subject to the provisions of 40 CFR 60 shall maintain a file of all measurements, including continuous monitoring system, monitoring device, and performance testing measurements; all continuous monitoring system performance evaluations; all continuous monitoring system or monitoring device calibration checks; adjustments and maintenance performed on these systems or devices; and, all other information required by 40 CFR 60 recorded in a permanent form suitable for inspection. The file shall be retained for at least **5 (five)** years following the date of such measurements, maintenance, reports, and records.

[40 CFR 60.7(f); Rule 62-213.440(1)(b)2.b., F.A.C.]

#### **40 CFR 60.8 Performance tests.**

8. Performance tests shall be conducted under such conditions as the Administrator shall specify to the plant operator based on representative performance of the affected facility. The owner or operator shall make available to the Administrator such records as may be necessary to determine the conditions of the performance tests. Operations during periods of startup, shutdown, and malfunction shall not constitute representative conditions for the purpose of a performance test nor shall emissions in excess of the level of the applicable emission limit during periods of startup, shutdown, and malfunction be considered a violation of the applicable emission limit unless otherwise specified in the applicable standard.

[40 CFR 60.8(c)]

#### **40 CFR 60.11 Compliance with standards and maintenance requirements.**

9. Compliance with standards in 40 CFR 60, other than opacity standards, shall be determined only by performance tests established by 40 CFR 60.8, unless otherwise specified in the applicable standard.

[40 CFR 60.11(a)]

10. Compliance with opacity standards in 40 CFR 60 shall be determined by conducting observations in accordance with Reference Method 9 in Appendix A of 40 CFR 60, any alternative method that is approved by the Administrator, or as provided in 40 CFR 60.11(e)(5).

[40 CFR 60.11(b)]

11. The opacity standards set forth in 40 CFR 60 shall apply at all times except during periods of startup, shutdown, malfunction, and as otherwise provided in the applicable standard.

[40 CFR 60.11(c)]

12. At all times, including periods of startup, shutdown, and malfunction, owners and operators shall, to the extent practicable, maintain and operate any affected facility including associated air pollution control equipment in a manner consistent with good air pollution control practice for minimizing emissions. Determination of whether acceptable operating and maintenance procedures are being used will be based on information available to the Administrator which may include, but is not limited to, monitoring results, opacity observations, review of operating and maintenance procedures, and inspection of the source.

[40 CFR 60.11(d)]

13. The owner or operator of an affected facility subject to an opacity standard may submit, for compliance purposes, continuous opacity monitoring system (COMS) data results produced during any performance test required under 40 CFR 60.8 in lieu of EPA Method 9 observation data. If an owner or operator elects to submit COMS data for compliance with the opacity standard, he or she shall notify the

Administrator of that decision, in writing, at least 30 days before any performance test required under 40 CFR 60.8 is conducted. Once the owner or operator of an affected facility has notified the Administrator to that effect, the COMS data results will be used to determine opacity compliance during subsequent tests required under 40 CFR 60.8 until the owner or operator notifies the Administrator, in writing, to the contrary. For the purpose of determining compliance with the opacity standard during a performance test required under 40 CFR 60.8 using COMS data, the minimum total time of COMS data collection shall be averages of all 6-minute continuous periods within the duration of the mass emission performance test. Results of the COMS opacity determinations shall be submitted along with the results of the performance test required under 60.8. The owner or operator of an affected facility using a COMS for compliance purposes is responsible for demonstrating that the COMS meets the requirements specified in 40 CFR 60.13(c), that the COMS has been properly maintained and operated, and that the resulting data have not been altered in any way. If COMS data results are submitted for compliance with the opacity standard for a period of time during which EPA Method 9 data indicates noncompliance, the EPA Method 9 data will be used to determine opacity compliance.

[40 CFR 60.11(e)(5)]

#### **40 CFR 60.12 Circumvention.**

14. No owner or operator subject to the provisions of 40 CFR 60 shall build, erect, install, or use any article, machine, equipment or process, the use of which conceals an emission which would otherwise constitute a violation of an applicable standard. Such concealment includes, but is not limited to, the use of gaseous diluents to achieve compliance with an opacity standard or with a standard which is based on the concentration of a pollutant in the gases discharged to the atmosphere.

[40 CFR 60.12]

#### **40 CFR 60.13 Monitoring requirements.**

15. For the purposes of 40 CFR 60.13, all continuous monitoring systems (CMS) required under applicable subparts shall be subject to the provisions of 40 CFR 60.13 upon promulgation of performance specifications for continuous monitoring systems under Appendix B of 40 CFR 60 and, if the continuous monitoring system is used to demonstrate compliance with emission limits on a continuous basis, Appendix F of 40 CFR 60, unless otherwise specified in an applicable subpart or by the Administrator. Appendix F is applicable December 4, 1987.

[40 CFR 60.13(a)]

16. If the owner or operator of an affected facility elects to submit continuous opacity monitoring system (COMS) data for compliance with the opacity standard as provided under 40 CFR 60.11(e)(5), he shall conduct a performance evaluation of the COMS as specified in Performance Specification 1, Appendix B, of 40 CFR 60 before the performance test required under 40 CFR 60.8 is conducted. Otherwise, the owner or operator of an affected facility shall conduct a performance evaluation of the COMS or continuous emission monitoring system (CEMS) during any performance test required under 40 CFR 60.8 or within 30 days thereafter in accordance with the applicable performance specification in Appendix B of 40 CFR 60. The owner or operator of an affected facility shall conduct COMS or CEMS performance evaluations at such other times as may be required by the Administrator under section 114 of the Act.

(1) The owner or operator of an affected facility using a COMS to determine opacity compliance during any performance test required under 60.8 and as described in 40 CFR 60.11(e)(5) shall furnish the Administrator two or, upon request, more copies of a written report of the results of the COMS performance evaluation described in 40 CFR 60.13(c) at least 10 days before the performance test required under 60.8 is conducted.

[40 CFR 60.13(c)(1)]

17. (1) Owners and operators of all continuous emission monitoring systems (CEMS) installed in accordance with the provisions of this part shall check the zero (or low-level value between 0 and 20 percent of span value) and span (50 to 100 percent of span value) calibration drifts at least once daily in accordance with a written procedure. The zero and span shall, as a minimum, be adjusted whenever the 24-hour zero drift or 24-hour span drift exceeds two times the limits of the applicable performance specifications in Appendix B. The system must allow the amount of excess zero and span drift measured at the 24-hour interval checks to be recorded and quantified, whenever specified. For continuous monitoring systems measuring opacity of emissions, the optical surfaces exposed to the effluent gases shall be cleaned prior to performing the zero and span drift adjustments except that for systems using automatic zero adjustments. The optical surfaces shall be cleaned when the cumulative automatic zero compensation exceeds 4 percent opacity.

(2) Unless otherwise approved by the Administrator, the following procedures shall be followed for continuous monitoring systems measuring opacity of emissions. Minimum procedures shall include a method for producing a simulated zero opacity condition and an upscale (span) opacity condition using a certified neutral density filter or other related technique to produce a known obscuration of the light beam. Such procedures shall provide a system check of the analyzer internal optical surfaces and all electronic circuitry including the lamp and photo detector assembly.

[40 CFR 60.13(d)(1) and (2)]

18. Except for system breakdowns, repairs, calibration checks, and zero and span adjustments required under 40 CFR 60.13(d), all continuous monitoring systems (CMS) shall be in continuous operation and shall meet minimum frequency of operation requirements as follows:

(1) All continuous monitoring systems referenced by 40 CFR 60.13(c) for measuring opacity of emissions shall complete a minimum of one cycle of sampling and analyzing for each successive 10-second period and one cycle of data recording for each successive 6-minute period.

(2) All continuous monitoring systems referenced by 40 CFR 60.13(c) for measuring emissions, except opacity, shall complete a minimum of one cycle of operation (sampling, analyzing, and data recording) for each successive 15-minute period.

[40 CFR 60.13(e)(1) and (2)]

19. All continuous monitoring systems (CMS) or monitoring devices shall be installed such that representative measurements of emissions or process parameters from the affected facility are obtained. Additional procedures for location of continuous monitoring systems contained in the applicable Performance Specifications of Appendix B of 40 CFR 60 shall be used.

[40 CFR 60.13(f)]

20. When the effluents from a single affected facility or two or more affected facilities subject to the same emission standards are combined before being released to the atmosphere, the owner or operator may install applicable continuous monitoring systems (CMS) on each effluent or on the combined effluent. When the affected facilities are not subject to the same emission standards, separate continuous monitoring systems shall be installed on each effluent. When the effluent from one affected facility is released to the atmosphere through more than one point, the owner or operator shall install an applicable continuous monitoring system on each separate effluent unless the installation of fewer systems is approved by the Administrator. When more than one continuous monitoring system is used to measure the emissions from one affected facility (e.g., multiple breechings, multiple outlets), the owner or operator shall report the results as required from each continuous monitoring system.

[40 CFR 60.13(g)]

21. Owners or operators of all continuous monitoring systems for measurement of opacity shall reduce all data to 6-minute averages and for continuous monitoring systems other than opacity to 1-hour averages for time periods as defined in 40 CFR 60.2. Six-minute opacity averages shall be calculated from 36 or more data points equally spaced over each 6-minute period. For continuous monitoring systems other than opacity, 1-hour averages shall be computed from four or more data points equally

spaced over each 1-hour period. Data recorded during periods of continuous monitoring system breakdowns, repairs, calibration checks, and zero and span adjustments shall not be included in the data averages computed under this paragraph. An arithmetic or integrated average of all data may be used. The data may be recorded in reduced or non reduced form (e.g., ppm pollutant and percent O<sub>2</sub> or ng/J of pollutant). All excess emissions shall be converted into units of the standard using the applicable conversion procedures specified in subparts. After conversion into units of the standard, the data may be rounded to the same number of significant digits as used in the applicable subparts to specify the emission limit (e.g., rounded to the nearest 1 percent opacity).  
[40 CFR 60.13(h)]

[electronic file name: 40CFR60a.doc]

**RECEIVED**

DEC 11 1995

BUREAU OF  
AIR REGULATION**Phase II Permit Application**

Page 1

For more information, see instructions and refer to 40 CFR 72.30 and 72.31 and Chapter 62-214, F.A.C.

This submission is: ☒ New ☐ Revised**STEP 1**Identify the source by  
plant name, State, and  
ORIS code from NADB

Seminole Plant Name	FL State	00136 ORIS Code
------------------------	-------------	--------------------

**STEP 2**Enter the boiler ID#  
from NADB for each  
affected unit, and  
indicate whether a  
repowering plan is  
being submitted for  
the unit by entering  
"yes" or "no" at  
column c. For new  
units, enter the re-  
quested information  
in columns d and e

Compliance Plan				
a	b	c	d	e
Boiler ID#	Unit Will Hold Allowances in Accordance with 40 CFR 72.9(c)(1)	Repowering Plan	New Units  Commence Operation Date	New Units  Monitor Certification Deadline
U01	Yes	No	N/A	N/A
U02	Yes	No	N/A	N/A
	Yes			
	Yes			
	Yes			
	Yes			
	Yes			
	Yes			
	Yes			
	Yes			
	Yes			
	Yes			

**STEP 3**Check the box if the  
response in column c  
of Step 2 is "Yes"  
for any unit☐For each unit that will be repowered, the Repowering Extension Plan form is included and the Repowering Technology Petition form has been submitted or will be submitted by June 1, 1997.

Plant Name (from Step 1)

**STEP 4**

Read the standard requirements and certification, enter the name of the designated representative, and sign and date

Standard RequirementsPermit Requirements.

- (1) The designated representative of each Acid Rain source and each Acid Rain unit at the source shall:
  - (i) Submit a complete Acid Rain part application (including a compliance plan) under 40 CFR part 72, Rules 62-214.320 and 330, F.A.C. in accordance with the deadlines specified in Rule 62-214.320, F.A.C.; and
  - (ii) Submit in a timely manner any supplemental information that the permitting authority determines is necessary in order to review an Acid Rain part application and issue or deny an Acid Rain permit;
- (2) The owners and operators of each Acid Rain source and each Acid Rain unit at the source shall:
  - (i) Operate the unit in compliance with a complete Acid Rain part application or a superseding Acid Rain part issued by the permitting authority; and
  - (ii) Have an Acid Rain Part.

Monitoring Requirements.

- (1) The owners and operators and, to the extent applicable, designated representative of each Acid Rain source and each Acid Rain unit at the source shall comply with the monitoring requirements as provided in 40 CFR part 75, and Rule 62-214.420, F.A.C.
- (2) The emissions measurements recorded and reported in accordance with 40 CFR part 75 shall be used to determine compliance by the unit with the Acid Rain emissions limitations and emissions reduction requirements for sulfur dioxide and nitrogen oxides under the Acid Rain Program.
- (3) The requirements of 40 CFR part 75 shall not affect the responsibility of the owners and operators to monitor emissions of other pollutants or other emissions characteristics at the unit under other applicable requirements of the Act and other provisions of the operating permit for the source.

Sulfur Dioxide Requirements.

- (1) The owners and operators of each source and each Acid Rain unit at the source shall:
  - (i) Hold allowances, as of the allowance transfer deadline, in the unit's compliance subaccount (after deductions under 40 CFR 73.34(c)) not less than the total annual emissions of sulfur dioxide for the previous calendar year from the unit; and
  - (ii) Comply with the applicable Acid Rain emissions limitations for sulfur dioxide.
- (2) Each ton of sulfur dioxide emitted in excess of the Acid Rain emissions limitations for sulfur dioxide shall constitute a separate violation of the Act.
- (3) An Acid Rain unit shall be subject to the requirements under paragraph (1) of the sulfur dioxide requirements as follows:
  - (i) Starting January 1, 2000, an Acid Rain unit under 40 CFR 72.6(a)(2); or
  - (ii) Starting on the later of January 1, 2000 or the deadline for monitor certification under 40 CFR part 75, an Acid Rain unit under 40 CFR 72.6(a)(3).
- (4) Allowances shall be held in, deducted from, or transferred among Allowance Tracking System accounts in accordance with the Acid Rain Program.
- (5) An allowance shall not be deducted in order to comply with the requirements under paragraph (1)(i) of the sulfur dioxide requirements prior to the calendar year for which the allowance was allocated.
- (6) An allowance allocated by the Administrator under the Acid Rain Program is a limited authorization to emit sulfur dioxide in accordance with the Acid Rain Program. No provision of the Acid Rain Program, the Acid Rain permit application, the Acid Rain permit, or the written exemption under 40 CFR 72.7 and 72.8 and no provision of law shall be construed to limit the authority of the United States to terminate or limit such authorization.
- (7) An allowance allocated by the Administrator under the Acid Rain Program does not constitute a property right.

Nitrogen Oxides Requirements. The owners and operators of the source and each Acid Rain unit at the source shall comply with the applicable Acid Rain emissions limitation for nitrogen oxides.

Excess Emissions Requirements.

- (1) The designated representative of an Acid Rain unit that has excess emissions in any calendar year shall submit a proposed offset plan, as required under 40 CFR part 77.
- (2) The owners and operators of an Acid Rain unit that has excess emissions in any calendar year shall:
  - (i) Pay without demand the penalty required, and pay upon demand the interest on that penalty, as required by 40 CFR part 77; and
  - (ii) Comply with the terms of an approved offset plan, as required by 40 CFR part 77.

Recordkeeping and Reporting Requirements.

- (1) Unless otherwise provided, the owners and operators of the source and each Acid Rain unit at the source shall keep on site at the source each of the following documents for a period of 5 years from the date the document is created. This period may be extended for cause, at any time prior to the end of 5 years, in writing by the Administrator or permitting authority:
  - (i) The certificate of representation for the designated representative for the source and each Acid Rain unit at the source and all documents that demonstrate the truth of the statements in the certificate of representation, in accordance with Rule 62-214.350, F.A.C.; provided that the certificate and documents shall be retained on site at the source beyond such 5-year period until such documents are superseded because of the submission of a new certificate of representation changing the designated representative;
  - (ii) All emissions monitoring information, in accordance with 40 CFR part 75;
  - (iii) Copies of all reports, compliance certifications, and other submissions and all records made or required under the Acid Rain Program; and,

Plant Name (from Step 1)

Recordkeeping and Reporting Requirements (cont.)

- (iv) Copies of all documents used to complete an Acid Rain part application and any other submission under the Acid Rain Program or to demonstrate compliance with the requirements of the Acid Rain Program.
- (2) The designated representative of an Acid Rain source and each Acid Rain unit at the source shall submit the reports and compliance certifications required under the Acid Rain Program, including those under 40 CFR part 72 subpart I and 40 CFR part 75.

Liability.

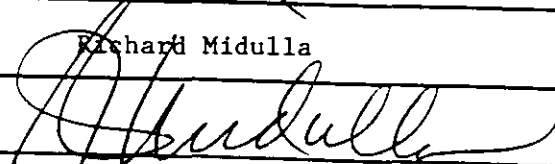
- (1) Any person who knowingly violates any requirement or prohibition of the Acid Rain Program, a complete Acid Rain part application, an Acid Rain part, or a written exemption under 40 CFR 72.7 or 72.8, including any requirement for the payment of any penalty owed to the United States, shall be subject to enforcement pursuant to section 113(c) of the Act.
- (2) Any person who knowingly makes a false, material statement in any record, submission, or report under the Acid Rain Program shall be subject to criminal enforcement pursuant to section 113(c) of the Act and 18 U.S.C. 1001.
- (3) No permit revision shall excuse any violation of the requirements of the Acid Rain Program that occurs prior to the date that the revision takes effect.
- (4) Each Acid Rain source and each Acid Rain unit shall meet the requirements of the Acid Rain Program.
- (5) Any provision of the Acid Rain Program that applies to an Acid Rain source (including a provision applicable to the designated representative of an Acid Rain source) shall also apply to the owners and operators of such source and of the Acid Rain units at the source.
- (6) Any provision of the Acid Rain Program that applies to an Acid Rain unit (including a provision applicable to the designated representative of an Acid Rain unit) shall also apply to the owners and operators of such unit. Except as provided under 40 CFR 72.44 (Phase II repowering extension plans), and except with regard to the requirements applicable to units with a common stack under 40 CFR part 75 (including 40 CFR 75.16, 75.17, and 75.18), the owners and operators and the designated representative of one Acid Rain unit shall not be liable for any violation by any other Acid Rain unit of which they are not owners or operators or the designated representative and that is located at a source of which they are not owners or operators or the designated representative.
- (7) Each violation of a provision of 40 CFR parts 72, 73, 75, 77, and 78 by an Acid Rain source or Acid Rain unit, or by an owner or operator or designated representative of such source or unit, shall be a separate violation of the Act.

Effect on Other Authorities. No provision of the Acid Rain Program, an Acid Rain part application, an Acid Rain part, or a written exemption under 40 CFR 72.7 or 72.8 shall be construed as:

- (1) Except as expressly provided in title IV of the Act, exempting or excluding the owners and operators and, to the extent applicable, the designated representative of an Acid Rain source or Acid Rain unit from compliance with any other provision of the Act, including the provisions of title I of the Act relating to applicable National Ambient Air Quality Standards or State Implementation Plans;
- (2) Limiting the number of allowances a unit can hold; *provided*, that the number of allowances held by the unit shall not affect the source's obligation to comply with any other provisions of the Act;
- (3) Requiring a change of any kind in any State law regulating electric utility rates and charges, affecting any State law regarding such State regulation, or limiting such State regulation, including any prudence review requirements under such State law;
- (4) Modifying the Federal Power Act or affecting the authority of the Federal Energy Regulatory Commission under the Federal Power Act; or,
- (5) Interfering with or impairing any program for competitive bidding for power supply in a State in which such program is established.

Certification

I am authorized to make this submission on behalf of the owners and operators of the Acid Rain source or Acid Rain units for which the submission is made. I certify under penalty of law that I have personally examined, and am familiar with, the statements and information submitted in this document and all its attachments. Based on my inquiry of those individuals with primary responsibility for obtaining the information, I certify that the statements and information are to the best of my knowledge and belief true, accurate, and complete. I am aware that there are significant penalties for submitting false statements and information or omitting required statements and information, including the possibility of fine or imprisonment.

Name	Richard Midulla	
Signature		Date 12/5/95

**STEP 5 (optional)**  
**Enter the source AIRS**  
**and FINDS identification**  
**numbers, if known**

AIRS	UNK
FINDS	UNK



# Certificate of Representation

Page 1

For more information, see instructions and refer to 40 CFR 72.24

This submission is: ☒ New ☐ Revised

**STEP 1**  
Identify the source by  
plant name, State, and  
ORIS code from NADB

Plant Name	Seminole Power Plant Boilers 1 & 2	State	FL	136 ORIS Code
------------	------------------------------------	-------	----	------------------

**STEP 2**  
Enter requested  
information for the  
designated  
representative

Name	Richard J. Midulla		
Address	Seminole Electric Cooperative, Inc. P. O. Box 272000 Tampa, FL 33688-2000		
Phone Number	(813) 963-0994	Fax Number	(813) 264-7906

**STEP 3**  
Enter requested  
information for the  
alternate designated  
representative  
(optional)

Name	Michael P. Opalinski		
Address	Seminole Electric Cooperative, Inc. P. O. Box 272000 Tampa, FL 33688-2000		
Phone Number	(813) 963-0994	Fax Number	(813) 264-7906

**STEP 4**  
Complete Step 5, read  
the certifications and  
sign and date

I certify that I was selected as the designated representative or alternate designated representative, as applicable, by an agreement binding on the owners and operators of the affected source and each affected unit at the source.

I certify that I have given notice of the agreement, selecting me as the designated representative or alternate designated representative, as applicable for the affected source and each affected unit at the source identified in this certificate of representation, daily for a period of one week in a newspaper of general circulation in the area where the source is located or in a State publication designed to give general public notice.

I certify that I have all necessary authority to carry out my duties and responsibilities under the Acid Rain Program on behalf of the owners and operators of the affected source and of each affected unit at the source and that each such owner and operator shall be fully bound by my actions, inactions, or submissions.

I certify that I shall abide by any fiduciary responsibilities imposed by the agreement by which I was selected as designated representative or alternate designated representative, as applicable.

I certify that the owners and operators of the affected source and of each affected unit at the source shall be bound by any order issued to me by the Administrator, the permitting authority, or a court regarding the source or unit.

Where there are multiple holders of a legal or equitable title to, or a leasehold interest in, an affected unit, or where a utility or industrial customer purchases power from an affected unit under life-of-the-unit, firm power contractual arrangements, I certify that:

I have given a written notice of my selection as the designated representative or alternate designated representative, as applicable, and of the agreement by which I was selected to each owner and operator of the affected source and of each affected unit at the source; and

Allowances and the proceeds of transactions involving allowances will be deemed to be held or distributed in proportion to each holder's legal, equitable, leasehold, or contractual reservation or entitlement or, if such multiple holders have expressly provided for a different distribution of allowances by contract, that allowances and the proceeds of transactions involving allowances will be deemed to be held or distributed in accordance with the contract.

The agreement by which I was selected as the alternate designated representative includes a procedure for the owners and operators of the source and affected units at the source to authorize the alternate designated representative to act in lieu of the designated representative.

**Certification**

I am authorized to make this submission on behalf of the owners and operators of the affected source or affected units for which the submission is made. I certify under penalty of law that I have personally examined, and am familiar with, the statements and information submitted in this document and all its attachments. Based on my inquiry of those individuals with primary responsibility for obtaining the information, I certify that the statements and information are to the best of my knowledge and belief true, accurate, and complete. I am aware that there are significant penalties for submitting false statements and information or omitting required statements and information, including the possibility of fine or imprisonment.

Signature (designated representative)	Date 3/1/94
Signature (alternate)	Date 3/1/94

**STEP 5**

Provide the name of every owner and operator of the source and each affected unit at the source. Identify the units they own and/or operate by boiler ID# from NADB. For owners only, identify each state or local utility regulatory authority with jurisdiction over each owner

Name Seminole Electric Cooperative, Inc.						<input checked="" type="checkbox"/> Owner	<input type="checkbox"/> Operator
ID# 1	ID#	ID#	ID#	ID#	ID#	ID#	
ID#	ID#	ID#	ID#	ID#	ID#	ID#	
Regulatory Authorities Seminole Electric Board of Trustees and REA							

Name Seminole Electric Cooperative, Inc.						<input type="checkbox"/> Owner	<input checked="" type="checkbox"/> Operator
ID# 2	ID#	ID#	ID#	ID#	ID#	ID#	
ID#	ID#	ID#	ID#	ID#	ID#	ID#	
Regulatory Authorities							

Name						<input type="checkbox"/> Owner	<input type="checkbox"/> Operator
ID#	ID#	ID#	ID#	ID#	ID#	ID#	
ID#	ID#	ID#	ID#	ID#	ID#	ID#	
Regulatory Authorities							

Name						<input type="checkbox"/> Owner	<input type="checkbox"/> Operator
ID#	ID#	ID#	ID#	ID#	ID#	ID#	
ID#	ID#	ID#	ID#	ID#	ID#	ID#	
Regulatory Authorities							

**Table 1-1, Summary of Air Pollutant Standards and Terms**

Seminole Electric Cooperative, Inc.  
Seminole Power Plant

Revised DRAFT Permit No.: 1070025-001-AV  
Facility ID No.: 1070025

This table summarizes information for convenience purposes only. This table does not supersede any of the terms or conditions of this permit.

**E.U. ID No. Brief Description**

[-001] Steam Electric Generator No. 1  
[-002] Steam Electric Generator No. 2

Pollutant Name	Fuel(s)	Hours/Year	Allowable Emissions		lbs./hour	IPY	Equivalent Emissions*	IPY	Regulatory Citation(s)	See permit condition(s)
			Standard(s)	Standard(s)						
PM	coal or oil	8,760	0.03 lb/MMBtu						40 CFR 60.42(a)	A. 5.
PM	coal & petcoke	8,760	0.03 lb/MMBtu						PSD-FL-018(A)	A. 6.
VE	all		20% except 27% one 6 min/hr						40 CFR 60.42a(b)	A. 7.
SO2	coal	8,760	1.20 lb/MMBtu						40 CFR 60.43a(1) & (2)	A. 8.
SO2	liquid	8,760	0.80 lb/MMBtu						40 CFR 60.43a(b)(1) & (2)	A. 9.
SO2	coal & liquid	8,760	X(340) + Y(520)/100						PSD-FL-018	A. 12.
SO2	coal & petcoke	8,760	Permit Condition A.13.						PSD-FL-018(A)	A. 13.
SO2	petcoke	8,760	7.0% sulfur by weight, dry base						PSD-FL-018(A)	A. 14.
NOX	coal	8,760	0.60 lb/MMBtu						40 CFR 60.44a(1) & (2)	A. 15.
NOX	liquid	8,760	0.30 lb/MMBtu						40 CFR 60.44a(1) & (2)	A. 15.
NOX	coal & liquid	8,760	X(130) + Y(260)/100						PSD-FL-018	A. 16.
NOX	coal & petcoke	8,760	0.50 lb/MMBtu						PSD-FL-018(A)	A. 17.
CO	coal & petcoke	8,760	No significant increase compared to coal						Rule 62.210.200(12)(d), FAC	A. 69.
H2SO4 Mist	coal & petcoke	8,760	No significant increase compared to coal						Rule 62.210.200(12)(d), FAC	A. 70.

Notes:

\* The "Equivalent Emissions" listed are for informational purposes only.

[electronic file name: 10700251.xls]

**Table 1-1, Summary of Air Pollutant Standards and Terms**

Seminole Electric Cooperative, Inc.  
Seminole Power Plant

Revised DRAFT Permit No.: 1070025-001-AV  
Facility ID No.: 1070025

This table summarizes information for convenience purposes only. This table does not supersede any of the terms or conditions of this permit.

E.U. ID No.                       
[003]                     

Brief Description  
                      
Rail Car Maintenance

Pollutant Name	Fuel(s)	Hours/Year	Allowable Emissions		Equivalent Emissions *		Regulatory Citation(s)	See permit condition(s)
			Standard(s)	lbs./hour	TPY	lbs./hour		
VE		8,760	20%				PA 78-10, Modified March 26, 1991	B.2.
VOC		8,760		38.75	11.84		PA 78-10, Modified March 26, 1991	B.4.
Notes:								
* The "Equivalent Emissions" listed are for informational purposes only.								

[electronic file name: 10700251.xls]

**Table 1-1, Summary of Air Pollutant Standards and Terms**

Seminole Electric Cooperative, Inc.  
Seminole Power Plant

Revised DRAFT Permit No.: 1070025-001-AV  
Facility ID No.: 1070025

This table summarizes information for convenience purposes only. This table does not supersede any of the terms or conditions of this permit.

**E.U. ID No.** I-004 **Brief Description**  
Coal Storage Yard

Pollutant Name	Fuel(s)	Hours/Year	Allowable Emissions		Equivalent Emissions *		Regulatory Citation(s)	See permit condition(s)
			Standard(s)	lbs./hour	TPY	lbs./hour	TPY	
VE		8,760	<20 %				40 CFR 60.252(c)	C.4.
Notes: • The "Equivalent Emissions" listed are for informational purposes only.								

**Table 1-1, Summary of Air Pollutant Standards and Terms**

Seminole Electric Cooperative, Inc.  
Seminole Power Plant

Revised DRAFT Permit No.: 1070025-001-AV  
Facility ID No.: 1070025

This table summarizes information for convenience purposes only. This table does not supersede any of the terms or conditions of this permit.

E.U. ID No. [xxx] **Brief Description**  
Limestone and FGD Sludge Handling and Storage

Pollutant Name	Fuels	Hours/Year	Allowable Emissions		Equivalent Emissions *		Regulatory Citation(s)	See permit condition(s)
			Standard(s)	lbs./hour	TPY	lbs./hour		
VE		8,760	20%				PSD-FL-018	D.4.
Notes: * The "Equivalent Emissions" listed are for informational purposes only.								

[electronic file name: 10700251.xls]

**Table 2-1. Summary of Compliance Requirements**

Seminole Electric Cooperative, Inc.  
Seminole Power Plant

Revised DRAFT Permit No.: 1070025-001-A  
Facility ID No.: 1070025

This table summarizes information for convenience purposes only. This table does not supersede any of the terms or conditions of this permit.

**E.U. ID No. Brief Description**

[-001] Steam Electric Generator No. 1  
[-002] Steam Electric Generator No. 2

Pollutant Name or Parameter	Fuel(s)	Compliance Method	Testing Time Frequency	Frequency Base Date *	Min. Compliance Test Duration	CMS**	
							See permit condition(s)
PM	All	EPA Method 19 & 5 or 5B	Annual	2/8/87	120 minutes		A.42.
VE	All	EPA Method 9 and CMS***	Annual & Continuous	2/8/87	1 hour	Yes	A.31., A.42
SO2	All	EPA Method 19 and CMS	Annual & Continuous	2/8/87	1 hour	Yes	A.32., A.43.
NOX	All	EPA Method 19 and CMS	Annual & Continuous	2/8/87	1 hour	Yes	A.33., A.44.
CO	coal & petcoke	EPA Method 10	Annual	2/8/87	1 hour		A.69.
H2SO4 Mist	coal & petcoke	EPA Method 8	Annual	2/8/87	1 hour		A.70.

**Notes:**

\* The frequency base date is established for planning purposes only; see Rule 62-297.310, F.A.C.

\*\*CMS [=] continuous monitoring system

\*\*\* Annual compliance may be shown using continuous opacity monitors in lieu of EPA Method 9

[electronic file name: 10700252.xls]

**Table 2-1, Summary of Compliance Requirements**

Seminole Electric Cooperative, Inc.  
Seminole Power Plant

Revised DRAFT Permit No.: 1070025-001-AV  
Facility ID No.: 1070025

This table summarizes information for convenience purposes only. This table does not supersede any of the terms or conditions of this permit.

**E.U. ID No. Brief Description**

[-003] Rail Car Maintenance

Pollutant Name or Parameter	Fuel(s)	Compliance Method	Testing Time Frequency	Frequency Base Date *	Min. Compliance Test Duration	CMS **	
							See permit condition(s)
VE VOC		EPA Method 9 Material Balance	Annual Annual	2/8/87 2/8/87	30 minutes	B.6. B.7.	

**Notes:**

\* The frequency base date is established for planning purposes only; see Rule 62-297.310, F.A.C.

\*\* CMS [=] continuous monitoring system

[electronic file name: 10700252.xls]

**Table 2-1, Summary of Compliance Requirements**

Seminole Electric Cooperative, Inc.  
Seminole Power Plant

Revised DRAFT Permit No.: 1070025-001-AV  
Facility ID No.: 1070025

This table summarizes information for convenience purposes only. This table does not supersede any of the terms or conditions of this permit.

**E.U. ID No.**      **Brief Description**

[-004]      Coal Storage Yard

Pollutant Name or Parameter	Fuel(s)	Compliance Method	Testing Time Frequency	Frequency Base Date *	Min. Compliance Test Duration	See permit condition(s)	
						CMS**	
VE		EPA Method 9	Annual	2/8/87	30 minutes		C.6.

Notes:

\* The frequency base date is established for planning purposes only; see Rule 62-297.310, F.A.C.

\*\*CMS [=] continuous monitoring system

[electronic file name: 10700252.xls]

**Table 2-1, Summary of Compliance Requirements**

Seminole Electric Cooperative, Inc.  
Seminole Power Plant

Revised DRAFT Permit No.: 1070025-001-AV  
Facility ID No.: 1070025

This table summarizes information for convenience purposes only. This table does not supersede any of the terms or conditions of this permit.

**E.U. ID No. Brief Description**

[>xxx] Limestone and FGD Sludge Handling and Storage

Pollutant Name or Parameter	Fuel(s)	Compliance Method	Testing Time Frequency	Frequency Base Date *	Min. Compliance Test Duration	See permit condition(s)	
						CMS**	
VE		EPA Method 9	Annual	2/8/87	30 minutes		D.6.

Notes:

\* The frequency base date is established for planning purposes only; see Rule 62-297.310, F.A.C.

\*\* CMS [=] continuous monitoring system

[electronic file name: 10700252.xls]

## **Appendix U-1, List of Unregulated Emissions Units and/or Activities.**

Seminole Electric Cooperative, Inc. **Revised DRAFT Permit No.:** 1070025-001-AV  
Seminole Power Plant **Facility ID No.:** 1070025

---

Unregulated Emissions Units and/or Activities. An emissions unit which emits no “emissions-limited pollutant” and which is subject to no unit-specific work practice standard, though it may be subject to regulations applied on a facility-wide basis (e.g., unconfined emissions, odor, general opacity) or to regulations that require only that it be able to prove exemption from unit-specific emissions or work practice standards.

The below listed emissions units and/or activities are neither ‘regulated emissions units’ nor ‘insignificant emissions units’.

### **E.U. ID**

<b><u>No.</u></b>	<b><u>Brief Description of Emissions Units and/or Activity</u></b>
-xxx	One or more emergency generators not subject to the Acid Rain Program
-xxx	One or more heating units and general purpose internal combustion engines not subject to the Acid Rain Program
-xxx	General plant fugitives including plant-wide abrasive blasting, painting, moveable abrasive blast material bin, soil borrow pit, and vehicular travel on unpaved roads.

[electronic file name: 1070025u.doc]

## **Appendix I-1, List of Insignificant Emissions Units and/or Activities.**

Seminole Electric Cooperative, Inc. **Revised DRAFT Permit No.:** 1070025-001-AV  
Seminole Power Plant **Facility ID No.:** 1070025

---

The facilities, emissions units, or pollutant-emitting activities listed in Rule 62-210.300(3)(a), F.A.C., Categorical Exemptions, are exempt from the permitting requirements of Chapters 62-210 and 62-4, F.A.C.; provided, however, that exempt emissions units shall be subject to any applicable emission limiting standards and the emissions from exempt emissions units or activities shall be considered in determining the potential emissions of the facility containing such emissions units. Emissions units and pollutant-emitting activities exempt from permitting under Rule 62-210.300(3)(a), F.A.C., shall not be exempt from the permitting requirements of Chapter 62-213, F.A.C., if they are contained within a Title V source; however, such emissions units and activities shall be considered insignificant for Title V purposes provided they also meet the criteria of Rule 62-213.430(6)(b), F.A.C. No emissions unit shall be entitled to an exemption from permitting under Rule 62-210.300(3)(a), F.A.C., if its emissions, in combination with the emissions of other units and activities at the facility, would cause the facility to emit or have the potential to emit any pollutant in such amount as to make the facility a Title V source.

The below listed emissions units and/or activities are considered insignificant pursuant to Rule 62-213.430(6), F.A.C.

### Brief Description of Emissions Units and/or Activities

1. Brazing, soldering and welding
2. Parts cleaning and degreasing stations
3. Storage tanks <550 gallons
4. Inorganic substance storage tanks >550 gallons
5. No. 2 fuel oil storage tanks >550 gallons
6. Laboratory equipment used exclusively for chemical or physical analysis
7. Fire and safety equipment
8. Turbine vapor extractor
9. Sand blasting and abrasive blasting where temporary total enclosures are used to contain particulate
10. Equipment used for steam cleaning
11. Belt conveyors not subject to 40 CFR 60, Subpart Y
12. Vehicle refueling operations
13. Vacuum pumps in laboratory operations
14. Equipment used exclusively for space heating, excluding boilers
15. Surface coating operations utilizing 6.0 gallons per day, or less, averaged monthly, of coatings
16. Degreasing units using heavier than air vapors exclusively, except any unit using or emitting any substance classified as a hazardous air pollutant.

## Appendix H-1, Permit History/ID Number Changes

Seminole Electric Cooperative, Inc.

Revised DRAFT Permit No.: 1070025-001-AV  
Facility ID No.: 1070025

### Permit History (for tracking purposes):

<u>E.U.</u>	<u>ID No</u>	<u>Description</u>	<u>Permit No.</u>	<u>Issue Date</u>	<u>Expiration Date</u>	<u>Extended Date</u>	<u>Revised Date(s)</u>
	-001	#1 Unit, W/ESP AND FGD	PA78-10 & PSD-FL-018	09/18/79 & 09/09/79			10/12/88, 8/10/89, 3/26/91, 10/14/92, 11/25/92, 3/2/95, 4/25/97 & 2/7/97
	-002	#2 Unit, W/ESP AND FGD	PA78-10 & PSD-FL-018	09/18/79 & 09/09/79			10/12/88, 8/10/89, 3/26/91, 10/14/92, 11/25/92, 3/2/95, 4/25/97 & 2/7/97
	-003	Rail Car Maintenance	PA78-10 & PSD-FL-018	09/18/79 & 09/09/79			10/12/88, 8/10/89, 3/26/91, 10/14/92, 11/25/92, 3/2/95, 4/25/97 & 2/7/97
	-004	Coal Storage Yard	PA78-10 & PSD-FL-018	09/18/79 & 09/09/79			10/12/88, 8/10/89, 3/26/91, 10/14/92, 11/25/92, 3/2/95, 4/25/97 & 2/7/97

### (if applicable) ID Number Changes (for tracking purposes):

From: Facility ID No.: 31JAX540025

To: Facility ID No.: 1070025

### Notes:

- 1 - AO permit(s) automatic extension(s) in Rule 62-210.300(2)(a)3.a., F.A.C., effective 03/21/96.
- 2 - AC permit(s) automatic extension(s) in Rule 62-213.420(1)(a)4., F.A.C., effective 03/20/96.
- {Rule 62-213.420(1)(b)2., F.A.C., effective 03/20/96, allows Title V Sources to operate under existing valid permits }