



Jeb Bush
Governor

Department of Environmental Protection

Twin Towers Office Building
2600 Blair Stone Road
Tallahassee, Florida 32399-2400

Colleen M. Castille
Secretary

P.E. Certification Statement

Permittee: Seminole Electric Cooperative, Inc. **DRAFT Permit No.:** 1070025-002-AV
Seminole Power Plant
Project: Title V Air Operation Permit Renewal

This facility consists of two nominal 714.6 megawatts, electric, coal fired steam electric generators; a coal handling and storage system; a limestone unloading, handling and storage system; a flue gas desulfurization (FGD) sludge stabilization system; and a rail car maintenance facility. Coal is the primary fuel used. Based on the Title V permit renewal application received July 2, 2004, this facility is a major source of hazardous air pollutants (HAPs). Compliance Assurance Monitoring does apply.

***I HEREBY CERTIFY** that the engineering features described in the above referenced application and subject to the proposed permit conditions provide reasonable assurance of compliance with applicable provisions of Chapter 403, Florida Statutes, and Florida Administrative Code Chapters 62-4 and 62-204 through 62-297. However, I have not evaluated and I do not certify aspects of the proposal outside of my area of expertise (including but not limited to the electrical, mechanical, structural, hydrological, and geological features).*


This draft permit was prepared under my direct supervision by Mr. Cleve Holladay of my staff.

James K. Pennington, P.E. Date
Registration Number: 34536

Permitting Authority:
Department of Environmental Protection
Bureau of Air Regulation
111 South Magnolia Drive, Suite 4
Tallahassee, Florida 32301
Telephone: 850/488-0144
Fax: 850/922-6979

"More Protection, Less Process"

Printed on recycled paper.

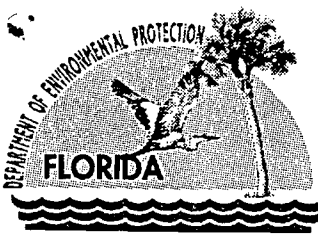

Jeb Bush
Governor

Department of Environmental Protection

Twin Towers Office Building
2600 Blair Stone Road
Tallahassee, Florida 32399-2400

Colleen M. Castille
Secretary

October 1, 2004

CERTIFIED MAIL - Return Receipt Requested

Mr. Michael P. Opalinski
Vice President of Technical Services
Seminole Electric Cooperative, Inc.
Seminole Power Plant
Post Office Box 272000
Tampa, Florida 33688

Re: DRAFT Title V Air Operation Permit Renewal No.: 1070025-002-AV
Seminole Power Plant

Dear Mr. Opalinski:

One copy of the DRAFT Permit for the renewal of a Title V Major Source Air Operation Permit for the Seminole Power Plant located East of U.S. Highway 17, approximately seven miles north of Palatka, Putnam County, is enclosed. The permitting authority's "INTENT TO ISSUE A TITLE V AIR OPERATION PERMIT RENEWAL" and the "PUBLIC NOTICE OF INTENT TO ISSUE A TITLE V AIR OPERATION PERMIT RENEWAL" are also included.

An electronic version of the DRAFT Title V Air Operation Permit Renewal has been posted on the Division of Air Resource Management's world wide web site for the United States Environmental Protection Agency (USEPA) Region 4 office's review. The web site address is:

"http://www.dep.state.fl.us/air/permitting/airpermits/AirSearch_ltd.asp"

The "PUBLIC NOTICE OF INTENT TO ISSUE A TITLE V AIR OPERATION PERMIT RENEWAL" must be published as soon as possible. Proof of publication, i.e., newspaper affidavit, must be provided to the permitting authority's office within 7 (seven) days of publication pursuant to Rule 62-110.106(5), F.A.C. Failure to publish the notice and provide proof of publication within the allotted time may result in the denial of the permit pursuant to Rule 62-110.106(11), F.A.C.

Please submit any written comments you wish to have considered concerning the permitting authority's proposed action to James K. Pennington, P.E., at the above letterhead address. If you have any other questions, please contact Cleve Holladay at 850/921-8986.

Sincerely,

Trina L. Vielhauer
Chief
Bureau of Air Regulation

TLV/jkp/ch

Enclosures

"More Protection, Less Process"

Printed on recycled paper.

In the Matter of an
Application for a Title V Air Operation Permit by:

Seminole Electric Cooperative, Inc.
890 North U.S. Highway 17
Palatka, Florida 32177

DRAFT Permit Project No.: 1070025-002-AV
Seminole Power Plant
Title V Air Operation Permit Renewal
Putnam County

WRITTEN NOTICE OF INTENT TO ISSUE TITLE V AIR OPERATION PERMIT RENEWAL

Facility Location: The applicant requests a Title V air operation permit (Permit) to operate the Seminole Power Plant located East of U.S. Highway 17, approximately seven miles north of Palatka, Putnam County.

Project: On July 2, 2004, the applicant applied to the Permitting Authority for a Permit. The Permit will be a renewal Permit for this facility. Details of the project are provided in the application and the enclosed "Statement of Basis".

This facility consists of two 714.6 megawatts, electric, coal fired steam electric generators; a coal handling and storage system; a limestone unloading, handling and storage system; a flue gas desulfurization (FGD) sludge stabilization system; and a rail car maintenance facility. Steam Electric Generators No. 2 and No. 1 began commercial operation in 1984 and 1985, respectively. These units are each equipped with an electrostatic precipitator (ESP) to control particulate matter, a wet limestone flue gas desulfurization (FGD) unit to control sulfur dioxide, and low NO_x burners and low excess-air firing to control nitrogen oxides. Each steam electric generator can fire coal, coal with a maximum of 30 percent petroleum coke (by weight), No. 2 fuel oil, and on-specification used oil. They are regulated under Acid Rain, Phase II and Phase I; NSPS - 40 CFR 60, Subpart Da, Standards of Performance for Electric Utility Steam Generating Units for Which Construction is Commenced After September 18, 1978, adopted and incorporated by reference in Rule 62-204.800(7), F.A.C.; Rule 212.400(5), F.A.C., Prevention of Significant Deterioration (PSD); the Power Plant Siting Act (PPSA); and, Rule 62-212.400(6), F.A.C., Best Available Control Technology (BACT) Determination, dated August 9, 1979.

The coal receiving, storage and transfer systems at the coal storage yard, which began commercial operation in 1985, are regulated under NSPS - 40 CFR 60, Subpart Y, Standards of Performance for Coal Preparation Plants, adopted and incorporated by reference in Rule 62-204.800(7), F.A.C.; PSD; the PPSA; Rule 62-212.400(6), F.A.C., BACT Determination, dated June 15, 1979. The limestone handling and storage system particulate matter emissions are controlled and regulated under PSD; Rule 62-212.400(6), and F.A.C., BACT Determination, dated June 15, 1979. The rail car maintenance facility is regulated under the Power Plant Siting Act.

Also, included in this permit are miscellaneous unregulated/insignificant emissions units and/or activities.

Permitting Authority: The application for this Permit renewal is subject to review in accordance with the provisions of Chapter 403, Florida Statutes (F.S.), and Chapters 62-4, 62-210, 62-213 and 62-214, Florida Administrative Code (F.A.C.). The proposed project is not exempt from air permitting requirements and an air permit is required to operate the facility. The Department's Bureau of Air Regulation is the Permitting Authority responsible for making a Permit determination regarding this project. The Permitting Authority's physical address is: 111 South Magnolia Drive, Suite 4, Tallahassee, Florida 32301. The Permitting Authority's mailing address is: 2600 Blair Stone Road, Mail Station #5505, Tallahassee, Florida 32399-2400 (Telephone: 850/488-0114).

Project File: A complete project file is available for public inspection during the normal business hours of 8:00 a.m. to 5:00 p.m., Monday through Friday (except legal holidays), at address indicated above for the Permitting Authority. The complete project file includes the DRAFT Permit, the Statement of Basis, the application, and the information submitted by the applicant, exclusive of confidential records under Section 403.111, F.S. Interested

Seminole Electric Cooperative, Inc.
Seminole Power Plant
DRAFT Permit No.: 1070025-002-AV
Page 2 of 4

persons may view the DRAFT Permit and file electronic comments by visiting the following website:
<http://www.dep.state.fl.us/air/eproducts/ards/>. A copy of the complete project file is also available at:

Permitting Authority:

Bureau of Air Regulation
111 South Magnolia Drive, Suite 4
Tallahassee, Florida 32301
Telephone: 850/488-0114
Fax: 850/921-9533

Affected District:

Department of Environmental Protection
Northeast District
7825 Baymeadows Way, Suite 200B
Jacksonville, Florida 32256-7577
Telephone: 904/804-3300
Fax: 904/448-4319

Notice of Intent to Issue An Air Permit: The Permitting Authority gives notice of its intent to issue an air permit to the applicant for the project described above. The applicant has provided reasonable assurance that operation of the facility will not adversely impact air quality and that the project will comply with all appropriate provisions of Chapters 62-4, 62-204, 62-210, 62-212, 62-213, 62-214, 62-256, 62-257, 62-281, 62-296, and 62-297, F.A.C. The Permitting Authority will issue a PROPOSED Permit and subsequent FINAL Permit in accordance with the conditions of the DRAFT Permit unless a response received in accordance with the following procedures results in a different decision or a significant change of terms or conditions.

Public Notice: Pursuant to Sections 403.815 and 403.087, F.S., and Rules 62-110.106 and 62-210.350(3), F.A.C., you (the applicant) are required to publish at your own expense the enclosed "PUBLIC NOTICE OF INTENT TO ISSUE TITLE V AIR OPERATION PERMIT RENEWAL" (Public Notice). The Public Notice shall be published one time only as soon as possible in the legal advertisement section of a newspaper of general circulation in the area affected by this project. The newspaper used must meet the requirements of Sections 50.011 and 50.031, F.S., in the county where the activity is to take place. If you are uncertain that a newspaper meets these requirements, please contact the Permitting Authority at the address or phone number. Pursuant to Rule 62-110.106(5), F.A.C., the applicant shall provide proof of publication to the Permitting Authority at the above address within seven (7) days of publication. Failure to publish the Public Notice and provide proof of publication may result in the denial of the Permit pursuant to Rule 62-110.106(11), F.A.C.

Comments: The Permitting Authority will accept written comments concerning the DRAFT Permit for a period of thirty (30) days from the date of publication of this Public Notice. Written comments must be post-marked, and all e-mail or facsimile comments must be received by the close of business (5 pm), on or before the end of this 30-day period by the Permitting Authority at the above address, e-mail or facsimile. As part of his or her comments, any person may also request that the Permitting Authority hold a public meeting on this permitting action. If the Permitting Authority determines there is sufficient interest for a public meeting, it will publish notice of the time, date, and location on the Department's official web site for notices at <http://tlhora6.dep.state.fl.us/onw> and in a newspaper of general circulation in the area affected by the permitting action. For additional information, contact the Permitting Authority at the above address or phone number. If written comments or comments received at a public meeting result in a significant change to the DRAFT Permit, the Permitting Authority shall issue a Revised DRAFT Permit and require, if applicable, another Public Notice. All comments filed will be made available for public inspection.

Petitions: A person whose substantial interests are affected by the proposed permitting decision may petition for an administrative hearing in accordance with Sections 120.569 and 120.57, F.S. The petition must contain the information set forth below and must be filed with (received by) the Department's Agency Clerk in the Office of General Counsel of the Department of Environmental Protection at 3900 Commonwealth Boulevard, Mail Station #35, Tallahassee, Florida 32399-3000. Petitions filed by the applicant or any of the parties listed below must be filed within fourteen (14) days of receipt of this Written Notice of Intent to Issue Title V Air Operation Permit. Petitions filed by any persons other than those entitled to written notice under Section 120.60(3), F.S., must be filed within fourteen (14) days of publication of the attached Public Notice or within fourteen (14) days of receipt of this Written Notice of Intent to Issue Title V Air Operation Permit, whichever occurs first. Under Section 120.60(3), F.S., however, any person who asked the Permitting Authority for notice of agency action may file a petition within fourteen (14) days of receipt of that notice, regardless of the date of publication. A petitioner shall mail a copy of the

petition to the applicant at the address indicated above, at the time of filing. The failure of any person to file a petition within the appropriate time period shall constitute a waiver of that person's right to request an administrative determination (hearing) under Sections 120.569 and 120.57, F.S., or to intervene in this proceeding and participate as a party to it. Any subsequent intervention will be only at the approval of the presiding officer upon the filing of a motion in compliance with Rule 28-106.205, F.A.C.

A petition that disputes the material facts on which the Permitting Authority's action is based must contain the following information: (a) The name and address of each agency affected and each agency's file or identification number, if known; (b) The name, address and telephone number of the petitioner; the name, address and telephone number of the petitioner's representative, if any, which shall be the address for service purposes during the course of the proceeding; and an explanation of how the petitioner's substantial interests will be affected by the agency determination; (c) A statement of how and when each petitioner received notice of the agency action or proposed action; (d) A statement of all disputed issues of material fact. If there are none, the petition must so state; (e) A concise statement of the ultimate facts alleged, including the specific facts the petitioner contends warrant reversal or modification of the agency's proposed action; (f) A statement of the specific rules or statutes the petitioner contends require reversal or modification of the agency's proposed action; and, (g) A statement of the relief sought by the petitioner, stating precisely the action the petitioner wishes the agency to take with respect to the agency's proposed action. A petition that does not dispute the material facts upon which the Permitting Authority's action is based shall state that no such facts are in dispute and otherwise shall contain the same information as set forth above, as required by Rule 28-106.301, F.A.C.


Because the administrative hearing process is designed to formulate final agency action, the filing of a petition means that the Permitting Authority's final action may be different from the position taken by it in this Written Notice of Intent to Issue title v Air Operation Permit. Persons whose substantial interests will be affected by any such final decision of the Permitting Authority on the application have the right to petition to become a party to the proceeding, in accordance with the requirements set forth above.

Mediation: Mediation is not available for this proceeding.

Objections: Finally, pursuant to 42 United States Code (U.S.C.) Section 7661d(b)(2), any person may petition the Administrator of the EPA within sixty (60) days of the expiration of the Administrator's 45 (forty-five) day review period as established at 42 U.S.C. Section 7661d(b)(1), to object to the issuance of any Permit. Any petition shall be based only on objections to the Permit that were raised with reasonable specificity during the thirty (30) day public comment period provided in the Public Notice, unless the petitioner demonstrates to the Administrator of the EPA that it was impracticable to raise such objections within the comment period or unless the grounds for such objection arose after the comment period. Filing of a petition with the Administrator of the EPA does not stay the effective date of any permit properly issued pursuant to the provisions of Chapter 62-213, F.A.C. Petitions filed with the Administrator of EPA must meet the requirements of 42 U.S.C. Section 7661d(b)(2) and must be filed with the Administrator of the EPA at: U.S. EPA, 401 M Street, S.W., Washington, D.C. 20460. For more information regarding EPA review and objections, visit EPA's Region 4 web site at: <http://www.epa.gov/region4/air/permits/Florida.htm>.

Executed in Tallahassee, Florida.

**STATE OF FLORIDA DEPARTMENT
OF ENVIRONMENTAL PROTECTION**



Trina L. Vielhauer
Chief
Bureau of Air Regulation

CERTIFICATE OF SERVICE

The undersigned duly designated deputy agency clerk hereby certifies that this INTENT TO ISSUE A TITLE V AIR OPERATION PERMIT RENEWAL (including the PUBLIC NOTICE and the DRAFT Permit) and all copies were sent by certified mail before the close of business on 10/11/04 to the person(s) listed:

Mr. Michael P. Opalinski, Vice President of Technical Services and R.O., SECI – Seminole Power Plant

In addition, the undersigned duly designated deputy agency clerk hereby certifies that copies of this INTENT TO ISSUE TITLE V AIR OPERATION PERMIT RENEWAL (including the DRAFT Permit package) were sent by INTERNET E-mail on the same date to the person(s) listed:

Mr. Thomas W. Davis, P.E., Ph.D., Environmental Consulting & Technology
Mr. Chris Kirts, NED
U.S. EPA, Region 4

Clerk Stamp

FILING AND ACKNOWLEDGMENT FILED, on this date, pursuant to Section 120.52(7), Florida Statutes, with the designated agency Clerk, receipt of which is hereby acknowledged.

Barbara J. Friday 10/11/04
(Clerk) (Date)

PUBLIC NOTICE OF INTENT TO ISSUE A TITLE V AIR OPERATION PERMIT RENEWAL

Permitting Authority
Department of Environmental Protection
Bureau of Air Regulation

DRAFT Title V Air Operation Permit No.: 1070025-002-AV
Seminole Electric Cooperative, Inc.
Seminole Power Plant
Putnam County

Applicant: The applicant for this project is Seminole Electric Cooperative, Inc, Seminole Power Plant, 890 U.S. Highway 17, Palatka, Florida 32177. The applicant's responsible official is: Mr. Michael P. Opalinski, Vice President of Technical Services, Seminole Electric Cooperative, Inc. – Post Office Box 272000, Tampa, Florida 33688.

Facility Location: The applicant operates the Seminole Power Plant, which is an electrical utility plant and located East of U.S. Highway 17, approximately seven miles north of Palatka, Putnam County.

Project: On July 2, 2004, the applicant applied to the Permitting Authority for a Title V air operation permit (Permit). This Permit will be a renewal Permit for this facility. Details of the project are provided in the application and the enclosed "Statement of Basis".

This facility consists of two 714.6 megawatts, electric, coal fired steam electric generators; a coal handling and storage system; a limestone unloading, handling and storage system; a flue gas desulfurization (FGD) sludge stabilization system; and a rail car maintenance facility. Steam Electric Generators No. 2 and No. 1 began commercial operation in 1984 and 1985, respectively. These units are each equipped with an electrostatic precipitator (ESP) to control particulate matter, a wet limestone flue gas desulfurization (FGD) unit to control sulfur dioxide, and low NO_x burners and low excess-air firing to control nitrogen oxides. Each steam electric generator can fire coal, coal with a maximum of 30 percent petroleum coke (by weight), No. 2 fuel oil, and on-specification used oil. They are regulated under Acid Rain, Phase II and Phase I; NSPS - 40 CFR 60, Subpart Da, Standards of Performance for Electric Utility Steam Generating Units for Which Construction is Commenced After September 18, 1978, adopted and incorporated by reference in Rule 62-204.800(7), F.A.C.; Rule 12.400(5), F.A.C., Prevention of Significant Deterioration (PSD); the Power Plant Siting Act (PPSA); and, Rule 62-212.400(6), F.A.C., Best Available Control Technology (BACT) Determination, dated August 9, 1979.

The coal receiving, storage and transfer systems at the coal storage yard, which began commercial operation in 1985, are regulated under NSPS - 40 CFR 60, Subpart Y, Standards of Performance for Coal Preparation Plants, adopted and incorporated by reference in Rule 62-204.800(7), F.A.C.; PSD; the PPSA; Rule 62-212.400(6), F.A.C., BACT Determination, dated June 15, 1979. The limestone handling and storage system particulate matter emissions are controlled and regulated under PSD; Rule 62-212.400(6), and F.A.C., BACT Determination, dated June 15, 1979. The rail car maintenance facility is regulated under the Power Plant Siting Act.

Also, included in this Permit are miscellaneous unregulated/insignificant emissions units and/or activities.

Permitting Authority: Applications for Permits are subject to review in accordance with the provisions of Chapter 403, Florida Statutes (F.S.), and Chapters 62-4, 62-210, 62-213 and 62-214, Florida Administrative Code (F.A.C.). The proposed project is not exempt from air permitting requirements and a Permit is required to operate the facility. The Department's Bureau of Air Regulation is the Permitting Authority responsible for making a Permit determination regarding this project. The Permitting Authority's physical address is: 111 South Magnolia Drive, Suite 4, Tallahassee, Florida 32301. The Permitting Authority's mailing address is: 2600 Blair Stone Road, Mail Station #5505, Tallahassee, Florida 32399-2400. The Permitting Authority's telephone number is: 850/488-0114.

Project File: A complete project file is available for public inspection during the normal business hours of 8:00 a.m. to 5:00 p.m., Monday through Friday (except legal holidays), at the address indicated above for the Permitting Authority. The complete project file includes the DRAFT Permit, the Statement of Basis, the application, and the information submitted by the applicant, exclusive of confidential records under Section 403.111, F.S. Interested persons may contact the Permitting Authority's project review engineer for additional information at the address and phone number listed, above, or may view the DRAFT Permit and file electronic comments by visiting the following website: <http://www.dep.state.fl.us/air/eproducts/ards/>. A copy of the complete project file is also available at:

Permitting Authority:

Bureau of Air Regulation
111 South Magnolia Drive, Suite 4
Tallahassee, Florida 32301
Telephone: 850/488-0114
Fax: 850/922-6979

Affected District:

Department of Environmental Protection
Northeast District
7825 Baymeadows Way, Suite 200B
Jacksonville, Florida 32256-7577
Telephone: 904/804-3300
Fax: 904/448-4319

Notice of Intent to Issue An Air Permit: The Permitting Authority gives notice of its intent to issue an air permit to the applicant for the project described above. The applicant has provided reasonable assurance that operation of the facility will not adversely impact air quality and that the project will comply with all appropriate provisions of Chapters 62-4, 62-204, 62-210, 62-212, 62-213, 62-214, 62-256, 62-257, 62-281, 62-296, and 62-297, F.A.C. The Permitting Authority will issue a PROPOSED Permit and subsequent FINAL Permit in accordance with the conditions of the DRAFT Permit unless a response received in accordance with the following procedures results in a different decision or a significant change of terms or conditions.

Comments: The Permitting Authority will accept written comments concerning the DRAFT Permit for a period of thirty (30) days from the date of publication of this Public Notice. Written comments must be post-marked and all e-mail or facsimile comments must be received by the close of business (5 pm) on or before the end of this 30-day period by the Permitting Authority at the above address, email or facsimile. As part of his or her comments, any person may also request that the Permitting Authority hold a public meeting on this permitting action. If the Permitting Authority determines there is sufficient interest for a public meeting, it will publish notice of the time, date, and location on the Department's official web site for notices (<http://tlhora6.dep.state.fl.us/onw/>) and in a newspaper of general circulation in the area affected by the permitting action. For additional information, contact the Permitting Authority at the above address or phone number. If written comments or comments received at a public meeting result in a significant change to the DRAFT Permit, the Permitting Authority shall issue a Revised DRAFT Permit and require, if applicable, another Public Notice. All comments filed will be made available for public inspection.

Petitions: A person whose substantial interests are affected by the proposed permitting decision may petition for an administrative hearing in accordance with Sections 120.569 and 120.57, F.S. The petition must contain the information set forth below and must be filed with (received by) the Department's Agency Clerk in the Office of General Counsel of the Department of Environmental Protection at 3900 Commonwealth Boulevard, Mail Station #35, Tallahassee, Florida 32399-3000. Petitions filed by any persons other than those entitled to written notice under Section 120.60(3), F.S., must be filed within fourteen (14) days of publication of this Public Notice or receipt of a written notice, whichever occurs first. Under Section 120.60(3), F.S., however, any person who asked the Permitting Authority for notice of agency action may file a petition within fourteen (14) days of receipt of that notice, regardless of the date of publication. A petitioner shall mail a copy of the petition to the applicant at the address indicated above, at the time of filing. The failure of any person to file a petition within the appropriate time period shall constitute a waiver of that person's right to request an administrative determination (hearing) under Sections 120.569 and 120.57, F.S., or to intervene in this proceeding and participate as a party to it. Any subsequent intervention will be only at the approval of the presiding officer upon the filing of a motion in compliance with Rule 28-106.205, F.A.C.

A petition that disputes the material facts on which the Permitting Authority's action is based must contain the following information: (a) The name and address of each agency affected and each agency's file or identification number, if known; (b) The name, address and telephone number of the petitioner; the name address and telephone number of the petitioner's representative, if any, which shall be the address for service purposes during the course of the proceeding; and an explanation of how the petitioner's substantial rights will be affected by the agency determination; (c) A statement of how and when the petitioner received notice of the agency action or proposed action; (d) A statement of all disputed issues of material fact. If there are none, the petition must so state; (e) A concise statement of the ultimate facts alleged, including the specific facts the petitioner contends warrant reversal or modification of the agency's proposed action; (f) A statement of the specific rules or statutes the petitioner contends require reversal or modification of the agency's proposed action; and, (g) A statement of the relief sought by the petitioner, stating precisely the action the petitioner wishes the agency to take with respect to the agency's proposed action. A petition that does not dispute the material facts upon which the Permitting Authority's action is based shall

state that no such facts are in dispute and otherwise shall contain the same information as set forth above, as required by Rule 28-106.301, F.A.C.

Because the administrative hearing process is designed to formulate final agency action, the filing of a petition means that the Permitting Authority's final action may be different from the position taken by it in this Public Notice of intent. Persons whose substantial interests will be affected by any such final decision of the Permitting Authority on the application have the right to petition to become a party to the proceeding, in accordance with the requirements set forth above.

Mediation: Mediation is not available for this proceeding.

Objections: In addition to the above right to petition, pursuant to 42 United States Code (U.S.C.) Section 7661d(b)(2), any person may petition the Administrator of the EPA within sixty (60) days of the expiration of the Administrator's 45 (forty-five) day review period as established at 42 U.S.C. Section 7661d(b)(1), to object to the issuance of any Permit. Any petition shall be based only on objections to the permit that were raised with reasonable specificity during the thirty (30) day public comment period provided in the Public Notice, unless the petitioner demonstrates to the Administrator of the EPA that it was impracticable to raise such objections within the comment period or unless the grounds for such objection arose after the comment period. Filing of a petition with the Administrator of the EPA does not stay the effective date of any permit properly issued pursuant to the provisions of Chapter 62-213, F.A.C. Petitions filed with the Administrator of EPA must meet the requirements of 42 U.S.C. Section 7661d(b)(2) and must be filed with the Administrator of the EPA at: U.S. EPA, 401 M Street, S.W., Washington, D.C. 20460. For more information regarding objections, visit the EPA Region 4 web site at: www.epa.gov/region4/air/permits

SENDER: COMPLETE THIS SECTION

- Complete items 1, 2, and 3. Also complete item 4 if Restricted Delivery is desired.
- Print your name and address on the reverse so that we can return the card to you.
- Attach this card to the back of the mailpiece, or on the front if space permits.

1. Article Addressed to:

Mr. Michael P. Opalinski
Vice President of Technical Services
Seminole Electric Cooperative, Inc.
Seminole Power Plant
Post Office Box 272000
Tampa, Florida 33688

COMPLETE THIS SECTION ON DELIVERY

A. Received by (Please Print Clearly) B. Date of Delivery

X *W. Achare* 5 2004

C. Signature

X *W. Achare*☐ Agent
☐ AddresseeD. Is delivery address different from item 1? ☐ Yes
If YES, enter delivery address below: ☐ No

3. Service Type

☒ Certified Mail ☐ Express Mail
☐ Registered ☐ Return Receipt for Merchandise
☐ Insured Mail ☐ C.O.D.4. Restricted Delivery? (Extra Fee) ☐ Yes

2. Article Number (Copy from service label)

7001 1140 0002 1577 7447

PS Form 3811, July 1999

Domestic Return Receipt

102595-99-M-1789

U.S. Postal Service

CERTIFIED MAIL RECEIPT

(Domestic Mail Only; No Insurance Coverage Provided)

7001 1140 0002 1577 7447

Mr. Michael P. Opalinski, Vice President

Postage	\$
Certified Fee	
Return Receipt Fee (Endorsement Required)	
Restricted Delivery Fee (Endorsement Required)	
Total Postage & Fees	\$

Postmark
Here**Sent To**

Mr. Michael P. Opalinski, Vice President

Street, Apt. No.;

or PO Box No. Post Office Box 272000

City, State, ZIP+ 4

Tampa, Florida 33688

PS Form 3800, January 2001

See Reverse for Instructions

STATEMENT OF BASIS

Seminole Electric Cooperative, Inc.

Seminole Power Plant

Facility ID No.: 1070025

Putnam County

Title V Air Operation Permit Renewal

DRAFT Permit No.: 1070025-002-AV

This Title V air operation permit renewal is issued under the provisions of Chapter 403, Florida Statutes (F.S.), and Florida Administrative Code (F.A.C.) Chapters 62-4, 62-210, 62-213, and 62-214. The above named permittee is hereby authorized to perform the work or operate the facility shown on the application and approved drawing(s), plans, and other documents, attached hereto or on file with the permitting authority, in accordance with the terms and conditions of this permit.

This facility consists of two 714.6 megawatts, electric, coal fired steam electric generators; a coal handling and storage system; a limestone unloading, handling and storage system; a flue gas desulfurization (FGD) sludge stabilization system; and a rail car maintenance facility.

Steam Electric Generator Nos. 1 and 2 are coal fired utility, dry bottom wall-fired boilers, each having a maximum generator rating of 714.6 megawatts, electric. The maximum heat input to each emissions unit is 7,172 million Btu per hour. Steam Electric Generator Nos. 1 and 2 are each equipped with an electrostatic precipitator (ESP) to control particulate matter, a wet limestone flue gas desulfurization (FGD) unit to control sulfur dioxide, and low NO_x burners and low excess-air firing to control nitrogen oxides. The emissions units are regulated under Acid Rain, Phase II and Phase I; NSPS - 40 CFR 60, Subpart Da, Standards of Performance for Electric Utility Steam Generating Units for Which Construction is Commenced After September 18, 1978, adopted and incorporated by reference in Rule 62-204.800(7), F.A.C.; Rule 212.400(5), F.A.C., Prevention of Significant Deterioration (PSD); and Rule 62-212.400(6), F.A.C., Best Available Control Technology (BACT) Determination, dated August 9, 1979. Steam Electric Generator No. 2 began commercial operation in 1984 and Steam Electric Generator No. 1 began commercial operation in 1985. These units are subject to a PM emission limit of 0.03 pound per million Btu heat input, which was established through BACT. The applicant has presented historical PM test results which show the average results of the annual tests for the past eleven years to be 0.0151 pound per million Btu for Unit #1 and 0.0146 pound per million Btu for Unit #2. The Department has determined that the appropriate test frequency is annual, as justified by the low emission rate documented in previous emissions tests. Units 1 and 2 are subject to CAM for monitoring controlled emissions of particulate matter. Units 1 and 2 are not subject to CAM for controlled emissions of SO₂ because CEMS are used for continuous compliance. Units 1 and 2 are not subject to CAM for NO_x because there are no add-on control devices.

The rail car maintenance facility consists of an abrasive blasting area and a surface coating operation. The emissions unit is regulated under the Power Plant Siting Act.

The coal receiving, storage and transfer systems at the coal storage yard support the operation of the two power boilers. Particulate matter emissions are controlled at the "as-received transfer tower", the "as-fired transfer tower", and the conveyors to the silos by fabric filter systems. Water sprays, full enclosures or partial enclosures are also utilized, where appropriate. The emissions unit is regulated under NSPS - 40 CFR 60, Subpart Y, Standards of Performance for Coal Preparation Plants, adopted and incorporated by reference in Rule 62-204.800(7), F.A.C.; Prevention of Significant Deterioration (PSD); Rule 62-212.400(6), F.A.C., Best Available Control Technology (BACT) Determination, dated June 15, 1979. The coal storage yard began commercial operation in 1985.

The limestone handling and storage system consists of a limestone unloading facility where particulate matter emissions are controlled by a panel filter, a limestone handling and storage system which utilizes a partial enclosure to control particulate matter emissions. In the FGD sludge processing system particulate emissions, which originate from the transfer of quicklime and flyash from both truck and rail delivery, are controlled by the use of bag house filters. Scrubbers are also utilized to control particulate emissions in the FGD sludge processing building. The emissions unit is regulated under Prevention of Significant Deterioration (PSD); Rule 62-212.400(6), F.A.C., Best Available Control Technology (BACT) Determination, dated June 15, 1979.

For purposes of periodic monitoring for the pollutants SO₂, NO_x, and opacity, the permittee will utilize continuous emission monitors, which are otherwise required by the Acid Rain program and/or 40 CFR Part 60.

Also included in this permit are miscellaneous unregulated/insignificant emissions units and/or activities.

Based on the Title V permit renewal application received July 2, 2004, this facility is a major source of hazardous air pollutants (HAPs).

Seminole Electric Cooperative, Inc.
Seminole Power Plant
Facility ID No.: 1070025
Putnam County

Title V Air Operation Permit Renewal

DRAFT Permit Project No.: 1070025-002-AV

Permitting Authority:

State of Florida
Department of Environmental Protection
Division of Air Resource Management
Bureau of Air Regulation
Permitting North Section
Mail Station #5505
2600 Blair Stone Road
Tallahassee, Florida 32399-2400
Telephone: 850/488-0114
Fax: 850/922-6979


Compliance Authority:

Department of Environmental Protection
Northeast District Office
7825 Baymeadows Way, Suite 200B
Jacksonville, Florida 32256-7590
Telephone: 904/807-3300
Fax: 904/448-4319

Title V Air Operation Permit Renewal

Table of Contents

Section	Page Number
Placard Page	1
I. Facility Information	2 - 3
A. Facility Description.	
B. Summary of Emissions Unit ID No(s). and Brief Description(s).	
C. Relevant Documents.	
II. Facility-wide Conditions	4 - 5
III. Emissions Unit(s) and Conditions	
A. Emissions Unit -001 Steam Electric Generator No. 1	6 - 24
Emissions Unit -002 Steam Electric Generator No. 2	
B. Emissions Unit -003 Rail Car Maintenance	25 - 28
C. Emissions Unit -004 Coal Storage Yard	29 - 32
D. Emissions Unit -005 Limestone and FGD Sludge Handling and Storage	33 - 36
IV. Acid Rain Part	
A. Acid Rain, Phase II	37 - 38
B. Acid Rain, Phase I	39 - 40

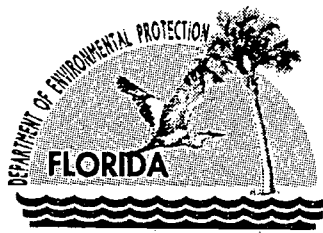

Jeb Bush
Governor

Department of Environmental Protection

Twin Towers Office Building
2600 Blair Stone Road
Tallahassee, Florida 32399-2400

Colleen M. Castille
Secretary

Permittee:

Seminole Electric Cooperative, Inc.
16313 North Dale Mabry Highway
Tampa, Florida 33618

DRAFT Permit No.: 1070025-002-AV

Facility ID No.: 1070025

SIC Nos.: 49, 4911

Project: Title V Air Operation Permit Renewal

The purpose of this permit is to renew Title V Air Operation Permit, No. **1070025-001-AV**, for the operation of the Seminole Power Plant. This facility is located east of U.S. Highway 17, approximately seven miles north of Palatka, Putnam County.

This Title V air operation permit renewal is issued under the provisions of Chapter 403, Florida Statutes (F.S.), and Florida Administrative Code (F.A.C.) Chapters 62-4, 62-210, 62-213, and 62-214. The above named permittee is hereby authorized to perform the work or operate the facility shown on the application and approved drawing(s), plans, and other documents, attached hereto or on file with the permitting authority, in accordance with the terms and conditions of this permit.

Referenced attachments made a part of this permit:

Appendix U-1, List of Unregulated Emissions Units and/or Activities

Appendix I-1, List of Insignificant Emissions Units and/or Activities

Appendix TV-4, Title V Conditions (version dated 02/12/02)

APPENDIX SS-1, STACK SAMPLING FACILITIES (version dated 10/07/96)

TABLE 297.310-1, CALIBRATION SCHEDULE (version dated 10/07/96)

FIGURE 1 - SUMMARY REPORT-GASEOUS AND OPACITY EXCESS EMISSION AND
MONITORING SYSTEM PERFORMANCE REPORT (40 CFR 60; July 1996)

Appendix 40 CFR 60 Subpart A - General Provisions (version dated 07/23/97)

Phase II Acid Rain Application/Compliance Plan received 06/08/04

Phase II NO_x Compliance Plan dated 06/29/04.

Attachment Seminole Electric Cooperative: Protocol for Startup and Shutdown

Appendix CAM

Seminole Electric Cooperative, Inc.: Support Systems Operation Manual Plant Practice Section

Effective Date: January 1, 2005

Renewal Application Due Date: July 5, 2009

Expiration Date: December 31, 2009

Michael G. Cooke, Director
Division of Air Resource Management

MGC/jkp/ch

"More Protection, Less Process"

Printed on recycled paper.

Section I. Facility Information.

Subsection A. Facility Description.

This facility consists of two 714.6 megawatt, electric, coal fired steam electric generators; a coal handling and storage system; a limestone unloading, handling and storage system; a flue gas desulfurization (FGD) sludge stabilization system; and a rail car maintenance facility.

Also included in this permit are miscellaneous unregulated/insignificant emissions units and/or activities.

Based on the Title V Air Operation Permit Renewal application received July 2, 2004, this facility is a major source of hazardous air pollutants (HAPs).

Subsection B. Summary of Emissions Unit ID No(s). and Brief Description(s).

E.U.

<u>ID No.</u>	<u>Brief Description</u>
-001	Steam Electric Generator No. 1
-002	Steam Electric Generator No. 2
-003	Rail Car Maintenance
-004	Coal Storage Yard
-005	Limestone and FGD Sludge Handling and Storage

Unregulated Emissions Units and/or Activities

- 006 One or more emergency generators not subject to the Acid Rain Program
- 007 One or more heating units and general purpose internal combustion engines not subject to the Acid Rain Program
- 008 General plant fugitives including plant-wide abrasive blasting, painting, moveable abrasive blast material bin, soil borrow pit, and vehicular travel on unpaved roads.

Please reference the Permit No., Facility ID No., and appropriate Emissions Unit(s) ID No(s). on all correspondence, test report submittals, applications, etc.

Subsection C. Relevant Documents.

The documents listed below are not a part of this permit; however, they are specifically related to this permitting action.

These documents are provided to the permittee for information purposes only:

Table 1-1, Summary of Air Pollutant Standards and Terms

Table 2-1, Summary of Compliance Requirements

Appendix A-1, Abbreviations, Acronyms, Citations, and Identification Numbers

Appendix H-1, Permit History

These documents are on file with the permitting authority:
Title V Permit Renewal Application received July 2, 2004.
Statement of Basis

Subsection D. Miscellaneous.

The use of 'Permitting Notes' throughout this permit are for informational purposes only and are not permit conditions.

Section II. Facility-wide Conditions.

The following conditions apply facility-wide:

1. APPENDIX TV-4, TITLE V CONDITIONS, is a part of this permit.

{Permitting note: APPENDIX TV-4, TITLE V CONDITIONS, is distributed to the permittee only. Other persons requesting copies of these conditions shall be provided a copy when requested or otherwise appropriate.}

2. **Not federally enforceable.** General Pollutant Emission Limiting Standards. Objectionable Odor Prohibited. The permittee shall not cause, suffer, allow, or permit the discharge of air pollutants which cause or contribute to an objectionable odor.

[Rule 62-296.320(2), F.A.C.]

3. General Particulate Emission Limiting Standards. General Visible Emissions Standard.

Except for emissions units that are subject to a particulate matter or opacity limit set forth or established by rule and reflected by conditions in this permit, no person shall cause, let, permit, suffer or allow to be discharged into the atmosphere the emissions of air pollutants from any activity, the density of which is equal to or greater than that designated as Number 1 on the Ringelmann Chart (20 percent opacity). EPA Method 9 is the method of compliance pursuant to Chapter 62-297, F.A.C.

[Rules 62-296.320(4)(b)1. & 4., F.A.C.]

4. Prevention of Accidental Releases (Section 112(r) of CAA).

a. The permittee shall submit its Risk Management Plan (RMP) to the Chemical Emergency Preparedness and Prevention Office (CEPPO) RMP Reporting Center when, and if, such requirement becomes applicable. Any Risk Management Plans, original submittals, revisions or updates to submittals, should be sent to:

RMP Reporting Center
Post Office Box 1515
Lanham-Seabrook, Maryland 20703-1515
Telephone: 301/429-5018

and,

b. The permittee shall submit to the permitting authority Title V certification forms or a compliance schedule in accordance with Rule 62-213.440(2), F.A.C.

[40 CFR 68]

5. Unregulated Emissions Units and/or Activities. Appendix U-1, List of Unregulated Emissions Units and/or Activities, is a part of this permit.

[Rule 62-213.440(1), F.A.C.]

6. Insignificant Emissions Units and/or Activities. Appendix I-1, List of Insignificant Emissions Units and/or Activities, is a part of this permit.

[Rules 62-213.440(1), 62-213.430(6) and 62-4.040(1)(b), F.A.C.]

7. General Pollutant Emission Limiting Standards. Volatile Organic Compounds Emissions or Organic Solvents Emissions. The permittee shall allow no person to store, pump, handle, process, load, unload or use in any process or installation, volatile organic compounds or organic solvents without applying known and existing vapor emission control devices or systems deemed necessary and ordered by the Department.

[Rule 62-296.320(1)(a), F.A.C.]

8. Emissions of Unconfined Particulate Matter. Pursuant to Rules 62-296.320(4)(c)1., 3. & 4., F.A.C., reasonable precautions to prevent emissions of unconfined particulate matter at this facility include the following requirements (see Condition 57. of APPENDIX TV-4, TITLE V CONDITIONS):

The following requirements are "not federally enforceable":

- a. Chemical or water application to unpaved roads and unpaved yard areas;
- b. Paving and maintenance of roads, parking areas and plant grounds;
- c. Landscaping or planting of vegetation;
- d. Confining abrasive blasting where possible; and,
- e. Other techniques as necessary.

[Rule 62-296.320(4)(c)2., F.A.C.; and, proposed by the applicant in the renewal Title V permit application received July 2, 2004.]

9. When appropriate, any recording, monitoring, or reporting requirements that are time-specific shall be in accordance with the effective date of the permit, which defines day one.

[Rule 62-213.440, F.A.C.]

10. Statement of Compliance. The annual statement of compliance pursuant to Rule 62-213.440(3)(a)2., F.A.C., shall be submitted to the Department and EPA within 60 (sixty) days after the end of the calendar year using DEP Form No. 62-213.900(7), F.A.C.

[Rules 62-213.440(3) and 62-213.900, F.A.C.]

{Permitting Note: This condition implements the requirements of Rules 62-213.440(3)(a)2. & 3., F.A.C. (see Condition 51. of APPENDIX TV-4, TITLE V CONDITIONS).}

11. The permittee shall submit all compliance related notifications and reports required of this permit to the Department's Northeast District office:

Department of Environmental Protection, Northeast District Office
7825 Baymeadows Way, Suite 200B
Jacksonville, Florida 32256-7590
Telephone: 904/807-3300; Fax: 904/448-4319

12. Any reports, data, notifications, certifications, and requests required to be sent to the United States Environmental Protection Agency, Region 4, should be sent to:

United States Environmental Protection Agency, Region 4
Air, Pesticides & Toxics Management Division
Air and EPRCA Enforcement Branch
Air Enforcement Section
61 Forsyth Street
Atlanta, Georgia 30303
Telephone: 404/562-9155; Fax: 404/562-9163

13. Certification by Responsible Official (RO). In addition to the professional engineering certification required for applications by Rule 62-4.050(3), F.A.C., any application form, report, compliance statement, compliance plan and compliance schedule submitted pursuant to Chapter 62-213, F.A.C., shall contain a certification signed by a responsible official that, based on information and belief formed after reasonable inquiry, the statements and information in the document are true, accurate, and complete. Any responsible official who fails to submit any required information or who has submitted incorrect information shall, upon becoming aware of such failure or incorrect submittal, promptly submit such supplementary information or correct information.

[Rule 62-213.420(4), F.A.C.]

Section III. Emissions Unit(s) and Conditions.

Subsection A. This section addresses the following emissions units.

E.U.

ID No. Brief Description

-001	Steam Electric Generator No. 1
-002	Steam Electric Generator No. 2

Steam Electric Generator Nos. 1 and 2 are coal fired utility, dry bottom wall-fired boilers, each having a maximum generator rating of 714.6 megawatts, electric. The maximum heat input to each emissions unit is 7,172 million Btu per hour. Steam Electric Generator Nos. 1 and 2 are each equipped with an electrostatic precipitator (ESP) to control particulate matter, a wet limestone flue gas desulfurization (FGD) unit to control sulfur dioxide, and low NO_x burners and low excess-air firing to control nitrogen oxides.

{Permitting note(s): IMPORTANT REGULATORY CLASSIFICATIONS - The emissions units are regulated under Acid Rain, Phase II and Phase I; NSPS - 40 CFR 60, Subpart Da, Standards of Performance for Electric Utility Steam Generating Units for Which Construction is Commenced After September 18, 1978, adopted and incorporated by reference in Rule 62-204.800(7), F.A.C.; Rule 212.400(5), F.A.C., Prevention of Significant Deterioration (PSD); and Rule 62-212.400(6), F.A.C., Best Available Control Technology (BACT) Determination, dated August 9, 1979. Steam Electric Generator No. 2 began commercial operation in 1984 and Steam Electric Generator No. 1 began commercial operation in 1985. Units 1 and 2 are subject to CAM for monitoring controlled emissions of particulate matter. Units 1 and 2 are not subject to CAM for controlled emissions of SO₂ because CEMS are used for continuous compliance. Units 1 and 2 are not subject to CAM for NO_x because there are no add-on control devices.}

The following specific conditions apply to the emissions unit(s) listed above:

{Permitting note: In addition to the requirements listed below, these emissions units are also subject to the standards and requirements contained in the Acid Rain Part of this permit (see Section IV).}

Essential Potential to Emit (PTE) Parameters

A.1. Permitted Capacity. The maximum operation heat input rate is as follows:

<u>Emissions Unit No.</u>	<u>MMBtu/hr Heat Input</u>
-001	7,172
-002	7,172

[Rules 62-4.160(2) and 62-210.200(PTE), F.A.C.]

{Permitting note: The heat input limitations have been placed in each permit to identify the capacity of each unit for the purposes of confirming that emissions testing is conducted within 90 to 100 percent of the unit's rated capacity (or to limit future operation to 110 percent of the test load), to establish appropriate emission limits and to aid in determining future rule applicability. Regular record keeping is not required for heat input. Instead the owner or operator is expected to determine heat input whenever emission testing is required, to demonstrate at what percentage of the rated capacity that the unit was tested. Rule 62-297.310(5), F.A.C., included in the permit, requires measurement of the process variables for emission tests. Such heat input determination may be based on measurements of fuel

consumption by various methods including but not limited to fuel flow metering or tank drop measurements, using the heat value of the fuel determined by the fuel vendor or the owner or operator, to calculate average hourly heat input during the test.}

A.2. Emissions Unit Operating Rate Limitation After Testing. See specific condition **A.47**.
[Rule 62-297.310(2), F.A.C.]

A.3. Methods of Operation. Fuel(s). The only fuels allowed to be fired are coal, coal with a maximum of 30 percent petroleum coke (by weight), No. 2 fuel oil, and on-specification used oil. The maximum weight of petroleum coke burned shall not exceed 186,000 pounds per hour (averaged over 24 hours), **see Specific Condition A.66**. On-specification used oil containing any quantifiable levels of PCBs can only be fired when the emissions unit is at normal operating temperatures.
[Rule 62-213.410(1), F.A.C.; 40 CFR 271.20(e)(3); and PSD-FL-018(A)]

{Permitting note: The fuel restrictions specified in Specific Condition **A.3**. apply to each emissions unit.}

A.4. Hours of Operation. These emissions units are allowed to operate continuously, i.e., 8,760 hours/year.
[Rule 62-210.200(PTE), F.A.C.]

Emission Limitations and Standards

{Permitting note: Table 1-1, Summary of Air Pollutant Standards and Terms, summarizes information for convenience purposes only. This table does not supersede any of the terms or conditions of this permit.}

{Permitting note: Unless otherwise specified, the averaging times for Specific Conditions **A.5**. through **A.17**. are based on the specified averaging time of the applicable test method.}

A.5. Particulate Matter. No owner or operator subject to the provisions of 40 CFR 60, Subpart Da shall cause to be discharged into the atmosphere from any affected facility any gases which contain particulate matter in excess of:

- (1) 13 ng/J (0.03 lb/million Btu) heat input derived from the combustion of coal or fuel oil;
- (2) 1 percent of the potential combustion concentration (99 percent reduction) when combusting solid fuel; and
- (3) 30 percent of potential combustion concentration (70 percent reduction) when combusting liquid fuel.

[40 CFR 60.42a(a) and PSD-FL-018]

A.6. Particulate Matter. No owner or operator shall cause to be discharged into the atmosphere when combusting a coal and petroleum coke blend any gases which contain particulate matter in excess of 0.03 lb/million Btu heat input, and one percent of the potential combustion concentration (99 percent reduction). Compliance with the 0.03 lb/million Btu heat input emission limitation shall also constitute compliance with the 99 percent reduction requirement.
[PSD-FL-018(A)]

A.7. Visible Emissions. No owner or operator subject to the provisions of 40 CFR 60, Subpart Da shall cause to be discharged into the atmosphere from any affected facility any gases which exhibit greater

than 20 percent opacity (6 minute average), except for one 6-minute period per hour of not more than 27 percent opacity.
[40 CFR 60.42a(b)]

A.8. Sulfur Dioxide (Coal, Only). No owner or operator subject to the provisions of 40 CFR 60, Subpart Da shall cause to be discharged into the atmosphere from any affected facility which combusts coal any gases which contain sulfur dioxide in excess of:

- (1) 520 ng/J (1.20 lb/million Btu) heat input and 10 percent of the potential combustion concentration (90 percent reduction), or
- (2) 30 percent of the potential combustion concentration (70 percent reduction), when emissions are less than 260 ng/J (0.60 lb/million Btu) heat input.

[40 CFR 60.43a(a)(1) & (2); and, PSD-FL-018]

A.9. Sulfur Dioxide. No owner or operator subject to the provisions of 40 CFR 60, Subpart Da shall cause to be discharged into the atmosphere from any affected facility which combusts liquid fuel any gases which contain sulfur dioxide in excess of:

- (1) 340 ng/J (0.80 lb/million Btu) heat input and 10 percent of the potential combustion concentration (90 percent reduction), or
- (2) 100 percent of the potential combustion concentration (zero percent reduction), when emissions are less than 86 ng/J (0.20 lb/million Btu) heat input.

[40 CFR 60.43a(b)(1) & (2); and, PSD-FL-018]

A.10. Sulfur Dioxide. Compliance with the emission limitation and percent reduction requirements are both determined on a 30-day rolling average basis.

[40 CFR 60.43a(g)]

A.11. Sulfur Dioxide. When coal and fuel oil are combusted simultaneously, the applicable standard is determined by proration using the following formula:

$$PS_{SO_2} = X(340) + Y(520) / 100$$

where:

PS_{SO_2} is the prorated standard for sulfur dioxide when combusting coal and fuel oil simultaneously (ng/J heat input).

X is the percentage of total heat input derived from the combustion of fuel oil.

Y is the percentage of total heat input derived from the combustion of coal.

[PSD-FL-018]

A.12. Sulfur Dioxide. Stack emissions from Units 1 and 2 shall comply with the following standards when burning blends of coal and petroleum coke:

(1) Unit 1:

$$E_{SO_2} = [(\%C_{HI} / 100) * (P_S) * (1 - (\%R_O / 100))] + [(1 - (\%C_{HI} / 100)) * (0.74 \text{ lb } SO_2 / \text{MMBtu})]$$

(2) Unit 2:

$$E_{SO_2} = [(\%C_{HI} / 100) * (P_S) * (1 - (\%R_O / 100))] + [(1 - (\%C_{HI} / 100)) * (0.72 \text{ lb } SO_2 / \text{MMBtu})]$$

where:

E_{SO_2} = allowable SO_2 emission rate; pounds per million Btu heat input (lb SO_2 /MMBtu), 30-day rolling average.

$\%C_{HI}$ = percent of coal used on a heat input basis.

P_S = potential SO_2 combustion concentration (unwashed coal without emission control systems) as defined by NSPS Subpart Da; lb SO_2 /MMBtu, 30-day rolling average.

$\%R_O$ = overall percent SO_2 reduction from Equation 19-21 of EPA Reference Method 19. Per NSPS Subpart Da, $\%R_O$ must not be less than 90%, 30-day rolling average.

0.74 = historical 2-year annual average SO_2 emission rate for Unit 1, lb/MMBtu.

0.72 = historical 2-year annual average SO_2 emission rate for Unit 2, lb/MMBtu.

Compliance with the lb/MMBtu heat input emission limitations and percent reduction requirement shall be determined on a 30-day rolling average basis.

[PSD-FL-018(A)]

A.13. Sulfur Dioxide. The petroleum coke sulfur content shall not exceed 7.0 percent by weight, dry basis.

[PSD-FL-018(A)]

A.14. Nitrogen Oxides. No owner or operator subject to the provisions of 40 CFR 60, Subpart Da shall cause to be discharged into the atmosphere from any affected facility any gases which contain nitrogen oxides in excess of the following emission limits, based on a 30-day rolling average.

(1) NO_X emissions limits. Bituminous coal emission limit for heat input: 260 ng/J (0.60 lb/million Btu); All other liquid fuels emission limit for heat input: 130 ng/J (0.30 lb/million Btu).

(2) NO_X reduction requirement. Solid fuels: 65 percent reduction of potential combustion concentration; Liquid fuels: 30 percent reduction of potential combustion concentration.

[40 CFR 60.44a(a)(1) & (2)]

A.15. Nitrogen Oxides. When coal and fuel oil are combusted simultaneously, the applicable standard is determined by proration using the following formula:

$$PS_{NOX} = X(130) + Y(260) / 100$$

where:

PS_{NOX} is the prorated standard for nitrogen oxides when combusting coal and fuel oil simultaneously (ng/J heat input).

X is the percentage of total heat input derived from the combustion of fuel oil.

Y is the percentage of total heat input derived from the combustion of coal.

[PSD-FL-018]

A.16. Nitrogen Oxides. Stack emissions from Units 1 and 2 shall comply with the following standards when burning blends of coal and petroleum coke:

(1) 0.60 lb/MMBtu heat input, and 35 percent of the potential combustion concentration (65 percent reduction). Compliance with the lb/MMBtu heat input emission limitation and the percent reduction requirement shall be determined on a 30-day rolling average basis. Compliance with the 0.60 lb/MMBtu heat input emission limitation shall also constitute compliance with the 65 percent reduction requirement; and

(2) 0.50 lb/MMBtu heat input determined on an annual average basis, when subject to the 40 CFR 76.8 Early Election Program for Group 1, Phase II Boilers or in any year when petroleum coke is burned.
[40 CFR 60.44a(a)(1) & (2) and PSD-FL-018(A)]

A.17. "On-Specification" Used Oil. Only "on-specification" used oil shall be fired in each unit. The quantity fired in each unit shall not exceed 500,000 gallons per calendar year. "On-specification" used oil is defined as used oil that meets the 40 CFR 279 (Standards for the Management of Used Oil) specifications listed below. Used oil that does not meet all of the following specifications is considered "off-specification" oil and shall not be fired.

<u>CONSTITUENT / PROPERTY *</u>	<u>ALLOWABLE LEVEL</u>
Arsenic	5 ppm maximum
Cadmium	2 ppm maximum
Chromium	10 ppm maximum
Lead	100 ppm maximum
Total Halogens	1000 ppm maximum
Flash Point	100 °F minimum
PCBs	less than 50 ppm

* As determined by approved methods specified in EPA Publication SW-846 (Test Methods for Evaluating Solid Waste, Physical/Chemical Methods).

[40 CFR 279.11; and, Requested by the Applicant in the initial Title V application received June 17, 1996]

Excess Emissions

A.18. The opacity standards set forth in 40 CFR 60 shall apply at all times except during periods of startup, shutdown, malfunction and as otherwise provided in the applicable standard.

At all times, including periods of startup, shutdown, and malfunction, owners and operators shall, to the extent practicable, maintain and operate any affected facility including associated air pollution control equipment in a manner consistent with good air pollution control practice for minimizing emissions. Determination of whether acceptable operating and maintenance procedures are being used will be based on information available to the Administrator which may include, but is not limited to, monitoring results, opacity observations, review of operating and maintenance procedures, and inspection of the source.

[40 CFR 60.11(c) & (d)]

{Permitting note: The Excess Emissions Rule at Rule 62-210.700, F.A.C., cannot vary any requirement of a NSPS, NESHAP, or Acid Rain program provision.}

A.19. Excess emissions resulting from malfunction shall be permitted provided that best operational practices to minimize emissions are adhered to and the duration of excess emissions shall be minimized but in no case exceed two hours in any 24 hour period unless specifically authorized by the Department for longer duration.

[Rule 62-210.700(1), F.A.C.]

A.20. As necessary, the permittee will operate in accordance with the Procedures for Startup and Shutdown attached to this permit. The Procedures shall be used where applicable and where there is/are conflict with Specific Condition A.19.

A.21. Excess emissions which are caused entirely or in part by poor maintenance, poor operation, or any other equipment or process failure which may reasonably be prevented during startup, shutdown or malfunction shall be prohibited.

[Rule 62-210.700(4), F.A.C.]

Monitoring of Operations

A.22. Determination of Process Variables.

(a) **Required Equipment.** The owner or operator of an emissions unit for which compliance tests are required shall install, operate, and maintain equipment or instruments necessary to determine process variables, such as process weight input or heat input, when such data are needed in conjunction with emissions data to determine the compliance of the emissions unit with applicable emission limiting standards.

(b) **Accuracy of Equipment.** Equipment or instruments used to directly or indirectly determine process variables, including devices such as belt scales, weight hoppers, flow meters, and tank scales, shall be calibrated and adjusted to indicate the true value of the parameter being measured with sufficient accuracy to allow the applicable process variable to be determined within 10% of its true value.

[Rule 62-297.310(5), F.A.C.]

Compliance Provisions

A.23. Compliance with the particulate matter emission limitation under 40 CFR 60.42a(a)(1) constitutes compliance with the percent reduction requirements for particulate matter under 40 CFR 60.42a(a)(2) and (3).

[40 CFR 60.46a(a)]

A.24. Compliance with the nitrogen oxides emission limitation under 40 CFR 60.44a(a)(1) constitutes compliance with the percent reduction requirements under 40 CFR 60.44a(a)(2).

[40 CFR 60.46a(b)]

A.25. The particulate matter emission standards under 40 CFR 60.42a and the nitrogen oxide standards under 40 CFR 60.44a apply at all times except during periods of startup, shutdown, or malfunction. The sulfur dioxide emission standards under 40 CFR 60.43a apply at all times except during periods of startup, shutdown, or when both emergency conditions exist and the procedures under 40 CFR 60.46a(d) are implemented.

[40 CFR 60.46a(c)]

A.26. During emergency conditions in the principle company, an affected facility with a malfunctioning flue gas desulfurization system may be operated if sulfur dioxide emissions are minimized by:

- (1) Operating all operable flue gas desulfurization modules, and bringing back into operation any malfunctioned module as soon as repairs are completed,
- (2) Bypassing flue gases around only those flue gas desulfurization system modules that have been taken out of operation because they were incapable of any sulfur dioxide emission reduction or which would have suffered significant physical damage if they had remained in operation.

[40 CFR 60.46a(d)(1) & (2)]

A.27. Compliance with the sulfur dioxide emission limitations and the percentage reduction requirements under 40 CFR 60.43a and the nitrogen oxides emissions limitations under 40 CFR 60.44a is based on the average emission rate for 30 successive boiler operating days. A separate performance test is completed at the end of each boiler operating day and a new 30 day average emission rate for both sulfur dioxide and nitrogen oxides and a new percent reduction for sulfur dioxide are calculated to show compliance with the standards.

[40 CFR 60.46a(e)]

A.28. Compliance is determined by calculating the arithmetic average of all hourly emission rates for SO₂ and NO_x for the 30 successive boiler operating days, except for data obtained during startup, shutdown, or malfunction (NO_x only), or emergency conditions (SO₂ only). Compliance with the percentage reduction requirement for SO₂ is determined based on the average inlet and average outlet SO₂ emissions rates for the 30 successive boiler operating days.

[40 CFR 60.46a(g)]

A.29. If the owner or operator has not obtained the minimum quantity of emission data as required under 40 CFR 60.47a, compliance of the affected facility with the emission requirements under 40 CFR 60.43a and 60.44a for the day on which the 30-day period ends may be determined by the Administrator following the applicable procedures in section 7 of Method 19.

[40 CFR 60.46a(h)]

Continuous Monitoring Requirements

A.30. Opacity. The owner or operator of an affected facility shall install, calibrate, maintain, and operate a continuous monitoring system, and record the output of the system, for measuring the opacity of emissions discharges to the atmosphere. If opacity interference due to water droplets exists in the stack (for example, from the use of a FGD system), the opacity is monitored upstream of the interference (at the inlet to the FGD system). If opacity interference is experienced at all locations (both at the inlet and outlet of the sulfur dioxide control system), alternate parameters indicative of the particulate matter control system's performance are monitored (subject to the approval of the Administrator).

[40 CFR 60.47a(a)]

A.31. Sulfur Dioxide. The owner or operator of an affected facility shall install, calibrate, maintain, and operate a continuous monitoring system, and record the output of the system, for measuring sulfur dioxide emissions as follows:

- (1) Sulfur dioxide emissions are monitored at both the inlet and outlet of the sulfur dioxide control device.
- (3) An "as fired" fuel monitoring system (upstream of coal pulverizers) meeting the requirements of Method 19 (appendix A) may be used to determine potential sulfur dioxide emissions in place of a

continuous sulfur dioxide emission monitor at the inlet to the sulfur dioxide control device as required by paragraph (1), above.

[40 CFR 60.47a(b)(1) & (3)]

A.32. Nitrogen Oxides. The owner or operator of an affected facility shall install, calibrate, maintain, and operate a continuous monitoring system, and record the output of the system, for measuring nitrogen oxides emissions discharged to the atmosphere.

[40 CFR 60.47a(c)]

A.33. The owner or operator of an affected facility shall install, calibrate, maintain, and operate a continuous monitoring system, and record the output of the system, for measuring the oxygen or carbon dioxide content of the flue gases at each location where sulfur dioxide or nitrogen oxides emissions are monitored.

[40 CFR 60.47a(d)]

A.34. The continuous monitoring systems required under specific conditions **A.31.**, **A.32.** and **A.33.** are operated and data recorded during all periods of operation at the affected facility including periods of startup, shutdown, malfunction, or emergency conditions, except for continuous monitoring system breakdowns, repairs, calibration checks, and zero and span adjustments.

[40 CFR 60.47a(e)]

A.35. The owner or operator shall obtain emission data for at least 18 hours in at least 22 out of 30 successive boiler operating days. If this minimum data requirement cannot be met with a continuous monitoring system, the owner or operator shall supplement emission data with other monitoring systems approved by the Administrator or the reference methods and procedures as described in 40 CFR 60.47a(h).

[40 CFR 60.47a(f)]

A.36. The 1-hour averages required under 40 CFR 60.13(h) are expressed in ng/J (lb/million Btu) heat input and used to calculate the average emission rates under 40 CFR 60.46a. The 1-hour averages are calculated using the data points required under 40 CFR 60.13(b). At least two data points must be used to calculate the 1-hour averages.

[40 CFR 60.47a(g)]

A.37. When it becomes necessary to supplement continuous monitoring system data to meet the minimum data requirements in 40 CFR 60.47a(f), the owner or operator shall use the reference methods and procedures as specified in this paragraph. acceptable alternative methods are given in 40 CFR 60.47a(j).

(1) Method 6 shall be used to determine the SO₂ concentration at the same location as the SO₂ monitor. Samples shall be taken at 60-minute intervals. The sampling time and sample volume for each sample shall be at least 20 minutes and 0.020 dscm (0.71 dscf). Each sample represents a 1-hour average.

(2) Method 7 shall be used to determine the NO_x concentration at the same location as the NO_x monitor. Samples shall be taken at 30-minute intervals. The arithmetic average of two consecutive samples represents a 1-hour average.

(3) The emission rate correction factor, integrated bag sampling and analysis procedure of Method 3B shall be used to determine the O₂ or CO₂ concentration at the same location as the O₂ or CO₂ monitor. Samples shall be taken for at least 30 minutes in each hour. Each sample represents a 1-hour average.

(4) The procedures in Method 19 shall be used to compute each 1-hour average concentration in ng/J (lb/million Btu) heat input.
[40 CFR 60.47a(h)]

A.38. The owner or operator shall use methods and procedures in this paragraph to conduct monitoring system performance evaluations under 40 CFR 60.13(c) and calibration checks under 40 CFR 60.13(d). Acceptable alternative methods and procedures are given in 40 CFR 60.47a(j).

(1) Methods 6, 7, and 3B, as applicable, shall be used to determine O₂, SO₂, and NO_x concentrations.

(2) SO₂ or NO_x (NO), as applicable, shall be used for preparing the calibration gas mixtures (in N₂, as applicable) under Performance Specification 2 of appendix B of 40 CFR 60.

(3) For affected facilities burning only fossil fuel, the span value for a continuous monitoring system for measuring opacity is between 60 and 80 percent and for a continuous monitoring system measuring nitrogen oxides firing solid fuel is 1,000 ppm.

(5) For affected facilities burning fossil fuel, alone or in combination with non-fossil fuel, the span value of the sulfur dioxide continuous monitoring system at the inlet to sulfur dioxide control device is 125 percent of the maximum estimated hourly potential emissions of the fuel fired, and the outlet of the sulfur dioxide control device is 50 percent of maximum estimated hourly potential emissions of the fuel fired.

[40 CFR 60.47a(i)(1), (2), (3), & (5)]

A.39. The owner or operator may use the following as alternatives to the reference methods and procedures specified in 40 CFR 60.47a.

(1) For Method 6, Method 6A or 6B (whenever Methods 6 and 3 or 3B data are used) or 6C may be used. Each Method 6B sample obtained over 24 hours represents 24 1-hour averages. If Method 6A or 6B is used under 40 CFR 60.47a(i), the conditions under 40 CFR 60.46(d)(1) apply (see specific condition **A.71.**); these conditions do not apply under 40 CFR 60.47a(h).

(2) For Method 7, Method 7A, 7C, 7D, or 7E may be used. If Method 7C, 7D, or 7E is used, the sampling time is 1 hour.

(3) For Method 3, Method 3A or 3B may be used if the sampling time is 1 hour.

(4) For Method 3B, Method 3A may be used.

[40 CFR 60.47a(j)]

Test Methods and Procedures

{Permitting note: Table 2-1, Summary of Compliance Requirements, summarizes information for convenience purposes only. This table does not supersede any of the terms or conditions of this permit.}

A.40. In conducting performance tests, the owner or operator shall use as reference methods and procedures the methods in appendix A of 40 CFR 60 or the methods and procedures as specified in 40 CFR 60.48a, except as provided in 40 CFR 60.8(b). 40 CFR 60.8(f) does not apply for SO₂ and NO_x. Acceptable alternative methods are given in 40 CFR 60.48a(e).

[40 CFR 60.48a(a)]

A.41. Particulate Matter. The owner or operator shall determine compliance with the particulate matter standard as follows:

(1) The dry basis F factor (O₂) procedures in Method 19 shall be used to compute the emission rate of particulate matter.

(2) For the particulate matter concentration, Method 5 shall be used at affected facilities without wet FGD systems and Method 5B shall be used after wet FGD systems.

(i) The sampling time and sample volume for each run shall be at least 120 minutes and

- 1.70 dscm (60 dscf). The probe and filter holder heating system in the sampling train may be set to provide an average gas temperature of no greater than 160 ± 14 °C (320 ± 25 °F).
- (ii) For each particulate run, the emission rate correction factor, integrated or grab sampling and analysis procedures of Method 3B shall be used to determine the O₂ concentration. The O₂ sample shall be obtained simultaneously with, and at the same traverse points as, the particulate run. If the particulate run has more than 12 traverse points, the O₂ traverse points may be reduced to 12 provided that Method 1 is used to locate the 12 O₂ traverse points. If the grab sampling procedure is used, the O₂ concentration for the run shall be the arithmetic mean of all the individual O₂ concentrations at each traverse point.
- (3) Method 9 and the procedures in 40 CFR 60.11 shall be used to determine opacity, or,
- (4) Use of a continuous opacity monitor is authorized to determine opacity.
[40 CFR 60.48a(b) and 40 CFR 60.11(b)]

A.42. Sulfur Dioxide. The owner or operator shall determine compliance with the sulfur dioxide standards as follows:

- (1) The percent of potential SO₂ emissions (%P_S) to the atmosphere shall be computed using the following equation:

$$\%P_S = [(100 - \%R_F) (100 - \%R_S)] / 100$$

where:

%P_S = percent of potential SO₂ emissions, percent.

%R_F = percent reduction from fuel pretreatment, percent.

%R_S = percent reduction by SO₂ control system, percent.

- (2) The procedures in Method 19 may be used to determine percent reduction (%R_F) of sulfur by such processes as fuel pretreatment (physical coal cleaning, hydrosulfurization of fuel oil, ect.), coal pulverizers, and bottom and flyash interactions. This determination is optional.
- (3) The procedures in Method 19 shall be used to determine the percent SO₂ reduction (%R_S) of any SO₂ control system. Alternatively, a combination of an “as fired” fuel monitor and emission rates measured after the control system, following the procedures in Method 19, may be used if the percent reduction is calculated using the average emission rate from the SO₂ control device and the average SO₂ input rate from the “as fired” fuel analysis for 30 consecutive boiler operating days.
- (4) The appropriate procedures in Method 19 shall be used to determine the emission rate.
- (5) The continuous monitoring system in 40 CFR 60.47a(b) and (d) shall be used to determine the concentrations of SO₂ and CO₂ or O₂.
[40 CFR 60.48a(c)]

A.43. Nitrogen Oxides. The owner or operator shall determine compliance with the NO_x standard as follows:

- (1) The appropriate procedures in Method 19 shall be used to determine the emission rate of NO_x.
- (2) The continuous monitoring system in 40 CFR 60.47a(c) and (d) shall be used to determine the concentrations of NO_x and CO₂ or O₂.
[40 CFR 60.48a(d)]

A.44. The owner or operator may use the following as alternatives to the reference methods and procedures specified in 40 CFR 60.48a:

(1) For Method 5 or 5B, Method 17 may be used at facilities with or without wet FGD systems if the stack temperature at the sampling location does not exceed the average temperature of 160 °C (320 °F). Procedures 2.1 and 2.3 of Method 5B in 40 CFR 60, Appendix A may be used in Method 17 only if it is used after wet FGD systems. Method 17 shall not be used after wet FGD systems if the effluent is saturated or laden with water droplets.

(2) The F_C factor (CO_2) procedures in Method 19 may be used to compute the emission rate of particulate matter under the stipulations of 40 CFR 60.46(d)(1). The CO_2 shall be determined in the same manner as the O_2 concentration.

[40 CFR 60.48a(e)]

A.45. Compliance with the "on-specification" used oil requirements will be determined as follows:

(a) Analysis of a sample collected from each batch delivered for firing; or,

(b) The new batch delivery is from a collection site that has an acceptable analysis already on file with the facility and the analytical results are assumed by the facility for the batch.

(c) For quantification purposes, the highest concentration of each constituent as determined by any analysis is assumed to be the concentration of the constituent of the blended used oil.

See specific condition A.17.

[Rule 62-213.440(1)(b)2.a., F.A.C.]

A.46. Required Number of Test Runs. For mass emission limitations, a compliance test shall consist of three complete and separate determinations of the total air pollutant emission rate through the test section of the stack or duct and three complete and separate determinations of any applicable process variables corresponding to the three distinct time periods during which the stack emission rate was measured provided, however, that three complete and separate determinations shall not be required if the process variables are not subject to variation during a compliance test, or if three determinations are not necessary in order to calculate the unit's emission rate. The three required test runs shall be completed within one consecutive five day period. In the event that a sample is lost or one of the three runs must be discontinued because of circumstances beyond the control of the owner or operator, and a valid third run cannot be obtained within the five day period allowed for the test, the Secretary or his or her designee may accept the results of the two complete runs as proof of compliance, provided that the arithmetic mean of the results of the two complete runs is at least 20 percent below the allowable emission limiting standards.

[Rule 62-297.310(1), F.A.C.]

A.47. Operating Rate During Testing. Testing of emissions shall be conducted with the emissions unit operation at permitted capacity, which is defined as 90 to 100 percent of the maximum operation rate allowed by the permit. If it is impracticable to test at permitted capacity, an emissions unit may be tested at less than the minimum permitted capacity; in this case, subsequent emissions unit operation is limited to 110 percent of the test load until a new test is conducted. Once the emissions unit is so limited, operation at higher capacities is allowed for no more than 15 consecutive days for the purpose of additional compliance testing to regain the authority to operate at the permitted capacity.

[Rules 62-297.310(2) & (2)(b), F.A.C.]

A.48. Calculation of Emission Rate. The indicated emission rate or concentration shall be the arithmetic average of the emission rate or concentration determined by each of the three separate test runs unless otherwise specified in a particular test method or applicable rule.

[Rule 62-297.310(3), F.A.C.]

A.49. Applicable Test Procedures.

(a) Required Sampling Time.

1. Unless otherwise specified in the applicable rule, the required sampling time for each test run shall be no less than one hour and no greater than four hours, and the sampling time at each sampling point shall be of equal intervals of at least two minutes.

2. Opacity Compliance Tests. When either EPA Method 9 or DEP Method 9 is specified as the applicable opacity test method, the required minimum period of observation for a compliance test shall be sixty (60) minutes for emissions units which emit or have the potential to emit 100 tons per year or more of particulate matter, and thirty (30) minutes for emissions units which have potential emissions less than 100 tons per year of particulate matter and are not subject to a multiple-valued opacity standard. The opacity test observation period shall include the period during which the highest opacity emissions can reasonably be expected to occur. Exceptions to these requirements are as follows:

a. For batch, cyclical processes, or other operations which are normally completed within less than the minimum observation period and do not recur within that time, the period of observation shall be equal to the duration of the batch cycle or operation completion time.

b. The observation period for special opacity tests that are conducted to provide data to establish a surrogate standard pursuant to Rule 62-297.310(5)(k), F.A.C., Waiver of Compliance Test Requirements, shall be established as necessary to properly establish the relationship between a proposed surrogate standard and an existing mass emission limiting standard.

c. The minimum observation period for opacity tests conducted by employees or agents of the Department to verify the day-to-day continuing compliance of a unit or activity with an applicable opacity standard shall be twelve minutes.

(b) Minimum Sample Volume. Unless otherwise specified in the applicable rule, the minimum sample volume per run shall be 25 dry standard cubic feet. **See Specific Condition A.41.**

(c) Required Flow Rate Range. For EPA Method 5 particulate sampling, acid mist/sulfur dioxide, and fluoride sampling which uses Greenburg Smith type impingers, the sampling nozzle and sampling time shall be selected such that the average sampling rate will be between 0.5 and 1.0 actual cubic feet per minute, and the required minimum sampling volume will be obtained.

(d) Calibration of Sampling Equipment. Calibration of the sampling train equipment shall be conducted in accordance with the schedule shown in Table 297.310-1, attached as part of this permit.

(e) Allowed Modification to EPA Method 5. When EPA Method 5 is required, the following modification is allowed: the heated filter may be separated from the impingers by a flexible tube.

[Rule 62-297.310(4), F.A.C.]

A.50. Required Stack Sampling Facilities. When a mass emissions stack test is required, the permittee shall comply with the requirements contained in Appendix SS-1, Stack Sampling Facilities, attached to this permit.

[Rule 62-297.310(6), F.A.C.]

A.51. Frequency of Compliance Tests. The following provisions apply only to those emissions units that are subject to an emissions limiting standard for which compliance testing is required.

(a) General Compliance Testing.

2. For excess emission limitations for particulate matter specified in Rule 62-210.700, F.A.C., a compliance test shall be conducted annually while the emissions unit is operating under soot blowing conditions in each federal fiscal year during which soot blowing is part of normal emissions unit operation, except that such test shall not be required in any federal fiscal year in which a fossil fuel

steam generator does not burn liquid and/or solid fuel for more than 400 hours other than during startup.

3. The owner or operator of an emissions unit that is subject to any emission limiting standard shall conduct a compliance test that demonstrates compliance with the applicable emission limiting standard prior to obtaining a renewed operation permit. Emissions units that are required to conduct an annual compliance test may submit the most recent annual compliance test to satisfy the requirements of this provision. In renewing an air operation permit pursuant to Rule 62-210.300(2)(a)3.b., c., or d., F.A.C., the Department shall not require submission of emission compliance test results for any emissions unit that, during the year prior to renewal:

a. Did not operate; or

b. In the case of a fuel burning emissions unit, burned liquid and/or solid fuel for a total of no more than 400 hours.

4. During each federal fiscal year (October 1 - September 30), unless otherwise specified by rule, order, or permit, the owner or operator of each emissions unit shall have a formal compliance test conducted for:

a. Visible emissions, if there is an applicable standard;

b. Each of the following pollutants, if there is an applicable standard, and if the emissions unit emits or has the potential to emit: 5 tons per year or more of lead or lead compounds measured as elemental lead; 30 tons per year or more of acrylonitrile; or 100 tons per year or more of any other regulated air pollutant; and

c. Each NESHAP pollutant, if there is an applicable emission standard.

5. An annual compliance test for particulate matter emissions shall not be required for any fuel burning emissions unit that, in a federal fiscal year, does not burn liquid and/or solid fuel, other than during startup, for a total of more than 400 hours.

9. The owner or operator shall notify the Department, at least 15 days prior to the date on which each formal compliance test is to begin, of the date, time, and place of each such test, and the test contact person who will be responsible for coordinating and having such test conducted for the owner or operator.

(b) Special Compliance Tests. When the Department, after investigation, has good reason (such as complaints, increased visible emissions or questionable maintenance of control equipment) to believe that any applicable emission standard contained in a Department rule or in a permit issued pursuant to those rules is being violated, it may require the owner or operator of the emissions unit to conduct compliance tests which identify the nature and quantity of pollutant emissions from the emissions unit and to provide a report on the results of said tests to the Department.

(c) Waiver of Compliance Test Requirements. If the owner or operator of an emissions unit that is subject to a compliance test requirement demonstrates to the Department, pursuant to the procedure established in Rule 62-297.620, F.A.C., that the compliance of the emissions unit with an applicable weight emission limiting standard can be adequately determined by means other than the designated test procedure, such as specifying a surrogate standard of no visible emissions for particulate matter sources equipped with a bag house or specifying a fuel analysis for sulfur dioxide emissions, the Department shall waive the compliance test requirements for such emissions units and order that the alternate means of determining compliance be used, provided, however, the provisions of Rule 62-297.310(7)(b), F.A.C., shall apply.

[Rule 62-297.310(7), F.A.C.; and, SIP approved]

Recordkeeping and Reporting Requirements

A.52. For sulfur dioxide, nitrogen oxides, and particulate matter emissions, the performance test data from the performance evaluation of the continuous monitors (including the transmissometer) are

submitted to the Administrator.
[40 CFR 60.49a(a)]

A.53. For sulfur dioxide and nitrogen oxides the following information is reported to the Administrator for each 24-hour period.

- (1) Calendar date.
- (2) The average sulfur dioxide and nitrogen oxides emission rates (ng/J or lb/million Btu) for each 30 successive boiler operating days, ending with the last 30-day period in the quarter; reasons for non-compliance with the standards; and, description of corrective actions taken.
- (3) Percent reduction of the potential combustion concentration of sulfur dioxide for each 30 successive boiler operating days, ending with the last 30-day period in the quarter; reasons for non-compliance with the standard; and, description of corrective actions taken.
- (4) Identification of the boiler operating days for which pollutant or diluent data have not been obtained by an approved method for at least 18 hours of operation of the facility; justification for not obtaining sufficient data; and, description of corrective actions taken.
- (5) Identification of the times when emissions data have been excluded from the calculation of average emission rates because of startup, shutdown, malfunction (NO_x only), emergency conditions (SO₂ only), or other reasons, and justification for excluding data other than startup, shutdown, malfunction, or emergency conditions.
- (6) Identification of "F" factor used for calculations, method of determination, and type of fuel combusted.
- (7) Identification of the times when hourly averages have been obtained based on manual sampling methods.
- (8) Identification of the times when the pollutant concentration exceeded full span of the continuous monitoring system.
- (9) Description of any modifications to the continuous monitoring system which could affect the ability of the continuous monitoring system to comply with Performance Specifications 2 or 3.

[40 CFR 60.49a(b)]

A.54. If the minimum quantity of emission data as required by 40 CFR 60.47a is not obtained for any 30 successive boiler operating days, the following information obtained under the requirements of 40 CFR 60.46a(h) is reported to the Administrator for that 30-day period:

- (1) The number of hourly averages available for outlet emission rates (n_o) and inlet emission rates (n_i) as applicable.
- (2) The standard deviation of hourly averages for outlet emission rates (s_o) and inlet emission rates (s_i) as applicable.
- (3) The lower confidence limit for the mean outlet emission rate (E_o^*) and the upper confidence limit for the mean inlet emission rate (E_i^*) as applicable.
- (4) The applicable potential combustion concentration.
- (5) The ratio of the upper confidence limit for the mean outlet emission rate (E_o^*) and the allowable emission rate (E_{std}) as applicable.

[40 CFR 60.49a(c)]

A.55. If any standards under 40 CFR 60.43a are exceeded during emergency conditions because of control system malfunction, the owner or operator of the affected facility shall submit a signed statement:

- (1) Indicating if emergency conditions existed and requirements under 40 CFR 60.46a(d) were met during each period, and
- (2) Listing the following information:
 - (i) Time periods the emergency condition existed;

- (ii) Electrical output and demand on the owner or operator's electric utility system and the affected facility;
- (iii) Amount of power purchased from interconnected neighboring utility companies during the emergency period;
- (iv) Percent reduction in emissions achieved;
- (v) Atmospheric emission rate (ng/J) of the pollutant discharged; and
- (vi) Actions taken to correct control system malfunction.

[40 CFR 60.49a(d)]

A.56. If fuel pretreatment credit toward the sulfur dioxide emission standard under 40 CFR 60.43a is claimed, the owner or operator of the affected facility shall submit a signed statement:

- (1) Indicating what percentage cleaning credit was taken for the calendar quarter, and whether the credit was determined in accordance with the provisions of 40 CFR 60.48a and Method 19 (appendix A); and
- (2) Listing the quantity, heat content, and date each pretreated fuel shipment was received during the previous quarter; the name and location of the pretreatment facility; and the total quantity and total heat content of all fuels received at the affected facility during the previous quarter.

[40 CFR 60.49a(e)]

A.57. For any periods for which opacity, sulfur dioxide or nitrogen oxides emissions data are not available, the owner or operator of the affected facility shall submit a signed statement indicating if any changes were made in operation of the emission control system during the period of data unavailability. Operations of the control system and the affected facility during periods of data unavailability are to be compared with operation of the control system and the affected facility before and following the period of data unavailability.

[40 CFR 60.49a(f)]

A.58. The owner or operator of the affected facility shall submit a signed statement indicating whether:

- (1) The required continuous monitoring system calibration, span, and drift checks or other periodic audits have or have not been performed as specified.
- (2) The data used to show compliance was or was not obtained in accordance with approved methods and procedures of this part and is representative of plant performance.
- (3) The minimum data requirements have or have not been met; or, the minimum data requirements have not been met for errors that were unavoidable.
- (4) Compliance with the standards has or has not been achieved during the reporting period.

[40 CFR 60.49a(g)]

A.59. For the purposes of the reports required under 40 CFR 60.7, periods of excess emissions are defined as all 6-minute periods during which the average opacity exceeds the applicable opacity standards under 40 CFR 60.42a(b). Opacity levels in excess of the applicable opacity standard and the date of such excesses are to be submitted to the Administrator each calendar quarter.

[40 CFR 60.49a(h)]

A.60. The owner or operator of an affected facility shall submit the written reports required under this section and Subpart A to the Administrator for every calendar quarter. All quarterly reports shall be postmarked by the 30th day following the end of each calendar quarter.

[40 CFR 60.49a(i)]

A.61. In the case of excess emissions resulting from malfunctions, each owner or operator shall notify the Department in accordance with Rule 62-4.130, F.A.C. A full written report on the malfunctions shall

be submitted in a quarterly report, if requested by the Department.
[Rule 62-210.700(6), F.A.C.]

A.62. Submit to the Department a written report of emissions in excess of emission limiting for each calendar quarter. The nature and cause of the excess emissions shall be explained. This report does not relieve the owner or operator of the legal liability for violations. All recorded data shall be maintained on file by the Source for a period of five years.
[Rule 62-213.440, F.A.C.]

A.63. Test Reports.

- (a) The owner or operator of an emissions unit for which a compliance test is required shall file a report with the Department on the results of each such test.
- (b) The required test report shall be filed with the Department as soon as practical but no later than 45 days after the last sampling run of each test is completed.
- (c) The test report shall provide sufficient detail on the emissions unit tested and the test procedures used to allow the Department to determine if the test was properly conducted and the test results properly computed. As a minimum, the test report, other than for an EPA or DEP Method 9 test, shall provide the following information:
 - 1. The type, location, and designation of the emissions unit tested.
 - 2. The facility at which the emissions unit is located.
 - 3. The owner or operator of the emissions unit.
 - 4. The normal type and amount of fuels used and materials processed, and the types and amounts of fuels used and material processed during each test run.
 - 5. The means, raw data and computations used to determine the amount of fuels used and materials processed, if necessary to determine compliance with an applicable emission limiting standard.
 - 6. The type of air pollution control devices installed on the emissions unit, their general condition, their normal operating parameters (pressure drops, total operating current and GPM scrubber water), and their operating parameters during each test run.
 - 7. A sketch of the duct within 8 stack diameters upstream and 2 stack diameters downstream of the sampling ports, including the distance to any upstream and downstream bends or other flow disturbances.
 - 8. The date, starting time and duration of each sampling run.
 - 9. The test procedures used, including any alternative procedures authorized pursuant to Rule 62-297.620, F.A.C. Where optional procedures are authorized in this chapter, indicate which option was used.
 - 10. The number of points sampled and configuration and location of the sampling plane.
 - 11. For each sampling point for each run, the dry gas meter reading, velocity head, pressure drop across the stack, temperatures, average meter temperatures and sample time per point.
 - 12. The type, manufacturer and configuration of the sampling equipment used.
 - 13. Data related to the required calibration of the test equipment.
 - 14. Data on the identification, processing and weights of all filters used.
 - 15. Data on the types and amounts of any chemical solutions used.
 - 16. Data on the amount of pollutant collected from each sampling probe, the filters, and the impingers, are reported separately for the compliance test.
 - 17. The names of individuals who furnished the process variable data, conducted the test, analyzed the samples and prepared the report.
 - 18. All measured and calculated data required to be determined by each applicable test procedure for each run.

19. The detailed calculations for one run that relate the collected data to the calculated emission rate.
20. The applicable emission standard, and the resulting maximum allowable emission rate for the emissions unit, plus the test result in the same form and unit of measure.
21. A certification that, to the knowledge of the owner or his authorized agent, all data submitted are true and correct. When a compliance test is conducted for the Department or its agent, the person who conducts the test shall provide the certification with respect to the test procedures used. The owner or his authorized agent shall certify that all data required and provided to the person conducting the test are true and correct to his knowledge.

[Rule 62-297.310(8), F.A.C.]

A.64. Records shall be kept of each delivery of “on-specification” used oil with a statement of the origin of the used oil and the quantity delivered/stored for firing. In addition, monthly records shall be kept of the quantity of “on-specification” used oil fired in this unit. The above records shall be maintained in a form suitable for inspection, retained for a minimum of five years, and be made available upon request.

[Rule 62-213.440(1)(b)2.b., F.A.C.]

A.65. The permittee shall include in the “Annual Operating Report for Air Pollutant Emitting Facility” a summary of the “on-specification” used oil analyses for the calendar year and a statement of the total quantity of “on-specification” used oil fired during the calendar year.

[Rule 62-213.440(1)(b)2.b., F.A.C.]

A.66. Reporting and Recordkeeping

(1) Documentation verifying that the coal and petroleum coke fuel blends combusted in Units 1 and 2 have not exceeded the 30 percent maximum petroleum coke by weight limit shall be maintained and submitted to the Department’s Northeast District office with each annual report; and

(2) The permittee shall maintain and submit to the Department, on an annual basis for a period of five years from the date the units begin firing petroleum coke, data demonstrating that the operational change associated with the use of petroleum coke did not result in a significant emission increase pursuant to Rule 62-210.200(12)(d), F.A.C.

[PSD-FL-018(A)]

Miscellaneous Requirements.

A.67. These emissions units are subject to the Compliance Assurance Monitoring (CAM) requirements contained in the attached Appendix CAM. Failure to adhere to the monitoring requirements specified does not necessarily indicate an exceedance of a specific emissions limitation; however, it may constitute good reason to require compliance testing pursuant to Rule 62-297.310(7)(b), F.A.C.

[40 CFR 64; Rules 62-204.800 and 62-213.440(1)(b)1.a., F.A.C.]

A.68. The permittee shall comply with the requirements contained in Appendix 40 CFR 60, Subpart A, attached to this permit.

[Rule 62-204.800(7)(d), F.A.C.]

A.69. Carbon Monoxide. The permittee shall maintain and submit to the Department on an annual basis for a period of five years from the date the units begin firing petroleum coke, test results demonstrating that the operational changes associated with the use of petroleum coke did not result in a significant emission increase of the pollutant when compared to past emissions while firing coal. The carbon monoxide emissions shall be based on test results using EPA Method 10.

[PSD-FL-018(A)]

A.70. Sulfuric Acid Mist. The permittee shall maintain and submit to the Department on an annual basis for a period of five years from the date the units begin firing petroleum coke, test results demonstrating that the operational changes associated with the use of petroleum coke did not result in a significant emission increase of the pollutant when compared to past emissions while firing coal. The sulfuric acid mist emissions shall be based on test results using EPA Method 8.
[PSD-FL-018(A)]

A.71. The owner or operator may use the following as alternatives to the reference methods and procedures in 40 CFR 60.46 or in other sections as specified:

(1) The emission rate (E) of particulate matter, SO₂ and NO_x may be determined by using the F_c factor, provided that the following procedure is used:

(i) The emission rate (E) shall be computed using the following equation:

$$E = C F_c (100 / \% \text{ CO}_2)$$

where:

E = emission rate of pollutant, ng/J (lb/million Btu).

C = concentration of pollutant, ng/dscm (lb/dscf).

% CO₂ = carbon dioxide concentration, percent dry basis.

F_c = factor as determined in appropriate sections of Method 19.

(ii) If and only if the average F_c factor in Method 19 is used to calculate E and either E is from 0.97 to 1.00 of the emission standard or the relative accuracy of a continuous emission monitoring system is from 17 to 20 percent, then three runs of Method 3B shall be used to determine the O₂ and CO₂ concentration according to the procedures in 40 CFR 60.46(b) (2)(ii), (4)(ii), or (5)(ii). Then if F_o (average of three runs), as calculated from the equation in Method 3B, is more than ± 3 percent than the average F_o value, as determined from the average values of F_d and F_c in Method 19, i.e., $F_{oa} = 0.209 (F_{da} / F_{ca})$, then the following procedure shall be followed:

(A) When F_o is less than 0.97 F_{oa}, then E shall be increased by that proportion under 0.97 F_{oa}, e.g., if F_o is 0.95 F_{oa}, E shall be increased by 2 percent. This recalculated value shall be used to determine compliance with the emission standard.

(B) When F_o is less than 0.97 F_{oa} and when the average difference (\bar{d}) between the continuous monitor minus the reference methods is negative, then E shall be increased by that proportion under 0.97 F_{oa}, e.g., if F_o is 0.95 F_{oa}, E shall be increased by 2 percent. This recalculated value shall be used to determine compliance with the relative accuracy specification.

(C) When F_o is greater than 1.03 F_{oa} and when \bar{d} is positive, then E shall be decreased by that proportion over 1.03 F_{oa}, e.g., if F_o is 1.05 F_{oa}, E shall be decreased by 2 percent. This recalculated value shall be used to determine compliance with the relative accuracy specification.

[40 CFR 60.46(d)(1)]

Ambient Monitoring.

A.72. Not Federally Enforceable Air Monitoring Program. The permittee shall operate an ambient monitoring device for sulfur dioxide in accordance with EPA reference methods in 40 CFR, Part 53 an ambient monitoring device for total suspended particulate as shown in Figure 1, previously submitted as a part of the Power Plant Site Certification. The monitoring device shall be specifically located at a

location approved by the Department. The frequency of operation shall be every six days commencing as specified by the Department. The ambient monitoring program may be reviewed annually by the Department and the permittee.

[PA 78-10, Revised August 10, 1989]

A.73. Not Federally Enforceable Air Monitoring Program Reporting. Ambient air monitoring data shall be reported to the Department quarterly commencing on the date of certification by the last day of the month following the quarterly reporting period utilizing the SAROAD or other format approved by the Department in writing.

[PA 78-10, Revised August 10, 1989]

Section III. Emissions Unit(s) and Conditions.

Subsection B. This section addresses the following emissions unit(s).

E.U.

<u>ID No.</u>	<u>Brief Description</u>
-003	Rail Car Maintenance

The rail car maintenance facility consists of an abrasive blasting area and a surface coating operation.

{Permitting note(s): IMPORTANT REGULATORY CLASSIFICATIONS - The emissions unit is regulated under the Power Plant Siting Act.}

{Permitting note: Unless otherwise specified, the averaging times for Specific Conditions **B.2.** through **B.4.** are based on the specified averaging time of the applicable test method.}

The following specific conditions apply to the emissions unit(s) listed above:

Essential Potential to Emit (PTE) Parameters

B.1. Hours of Operation. This emissions unit is allowed to operate continuously, i.e., 8,760 hours/year. [Rule 62-210.200(PTE), F.A.C.]

Emission Limitations and Standards

{Permitting note: Table 1-1, Summary of Air Pollutant Standards and Terms, summarizes information for convenience purposes only. This table does not supersede any of the terms or conditions of this permit.}

B.2. Visible Emissions. Visible emissions shall not exceed 20 percent opacity. The cover and the partial enclosure of the shelter will act as a windbreak to minimize the amount of residual particulate that becomes airborne.
[PA 78-10, Modified March 26, 1991]

B.3. Containment screens shall be installed on the northern and southern ends of the shelter.
[PA 78-10E, dated March 2, 1995]

B.4. Volatile Organic Compounds. Volatile organic compound emissions shall not exceed 38.75 pounds per hour or 11.84 tons per year.
[PA 78-10E, dated March 2, 1995]

Monitoring of Operations

B.5. Determination of Process Variables.

(a) **Required Equipment.** The owner or operator of an emissions unit for which compliance tests are required shall install, operate, and maintain equipment or instruments necessary to determine process variables, such as process weight input or heat input, when such data are needed in conjunction with emissions data to determine the compliance of the emissions unit with applicable emission limiting standards.

(b) **Accuracy of Equipment.** Equipment or instruments used to directly or indirectly determine process variables, including devices such as belt scales, weight hoppers, flow meters, and tank scales, shall be calibrated and adjusted to indicate the true value of the parameter being measured with sufficient accuracy to allow the applicable process variable to be determined within 10% of its true value.
[Rule 62-297.310(5), F.A.C.]

{Permitting note: Emission limiting standards for the rail car maintenance emission unit consist only of visible emissions (VE) and volatile organic compounds (VOC). A determination of compliance with either emission limiting standard is through product constituents and is not dependent on the use of instruments or equipment to determine process variables.}

Test Methods and Procedures

{Permitting note: Table 2-1, Summary of Compliance Requirements, summarizes information for convenience purposes only. This table does not supersede any of the terms or conditions of this permit.}

B.6. Visible Emissions. EPA Method 9 shall be used to determine compliance with the opacity limit pursuant to Chapter 62-297, F.A.C.
[Rules 62-213.440 and 62-297.401, F.A.C.]

{Permitting note: The averaging time for this condition is based on the run time of the specified test method.}

B.7. Volatile Organic Compounds. Material balance and record keeping shall be used to determine emissions of volatile organic compounds.
[Rules 62-213.400 and 62-296.320(1)(a), F.A.C.]

B.8. Applicable Test Procedures.

(a) Required Sampling Time.

2. **Opacity Compliance Tests.** When either EPA Method 9 or DEP Method 9 is specified as the applicable opacity test method, the required minimum period of observation for a compliance test shall be sixty (60) minutes for emissions units which emit or have the potential to emit 100 tons per year or more of particulate matter, and thirty (30) minutes for emissions units which have potential emissions less than 100 tons per year of particulate matter and are not subject to a multiple-valued opacity standard. The opacity test observation period shall include the period during which the highest opacity emissions can reasonably be expected to occur. Exceptions to these requirements are as follows:

c. The minimum observation period for opacity tests conducted by employees or agents of the Department to verify the day-to-day continuing compliance of a unit or activity with an applicable opacity standard shall be twelve minutes.

[Rule 62-297.310(4)(a)2.c., F.A.C.]

{Permitting note: EPA Method 9 has been previously specified as the applicable opacity test method. Potential PM emissions are less than 100 tons per year.}

B.9. Frequency of Compliance Tests. The following provisions apply only to those emissions units that are subject to an emissions limiting standard for which compliance testing is required.

(a) General Compliance Testing.

3. The owner or operator of an emissions unit that is subject to any emission limiting standard shall conduct a compliance test that demonstrates compliance with the applicable emission limiting standard prior to obtaining a renewed operation permit. Emissions units that are required to conduct an annual compliance test may submit the most recent annual compliance test to satisfy the requirements of this provision. In renewing an air operation permit pursuant to Rule 62-210.300(2)(a)3.b., c., or d., F.A.C., the Department shall not require submission of emission compliance test results for any emissions unit that, during the year prior to renewal:
- Did not operate;
4. During each federal fiscal year (October 1 - September 30), unless otherwise specified by rule, order, or permit, the owner or operator of each emissions unit shall have a formal compliance test conducted for:
- Visible emissions, if there is an applicable standard;
9. The owner or operator shall notify the Department, at least 15 days prior to the date on which each formal compliance test is to begin, of the date, time, and place of each such test, and the test contact person who will be responsible for coordinating and having such test conducted for the owner or operator.
- (b) Special Compliance Tests. When the Department, after investigation, has good reason (such as complaints, increased visible emissions or questionable maintenance of control equipment) to believe that any applicable emission standard contained in a Department rule or in a permit issued pursuant to those rules is being violated, it may require the owner or operator of the emissions unit to conduct compliance tests which identify the nature and quantity of pollutant emissions from the emissions unit and to provide a report on the results of said tests to the Department.
- (c) Waiver of Compliance Test Requirements. If the owner or operator of an emissions unit that is subject to a compliance test requirement demonstrates to the Department, pursuant to the procedure established in Rule 62-297.620, F.A.C., that the compliance of the emissions unit with an applicable weight emission limiting standard can be adequately determined by means other than the designated test procedure, such as specifying a surrogate standard of no visible emissions for particulate matter sources equipped with a bag house or specifying a fuel analysis for sulfur dioxide emissions, the Department shall waive the compliance test requirements for such emissions units and order that the alternate means of determining compliance be used, provided, however, the provisions of Rule 62-297.310(7)(b), F.A.C., shall apply.
- [Rule 62-297.310(7), F.A.C.; and, SIP approved]

Recordkeeping and Reporting Requirements

B.10. Record Keeping. The owner or operator shall record the application rate of all surface coatings, the total of all coatings applied and calculate the rate of volatile organic compound emissions through the use of materials balance. Seminole will keep records of hourly quantities (gallons) of paint consumed during painting operations. These hourly records, combined with the pound per gallon VOC concentration contained in the product's MSDS will be utilized to determine the hourly emissions rate and the total annual emissions. These records will be maintained for five years and will be made available to the Department upon request.

[Rule 62-213.400, F.A.C.; and, Applicant Request of 12/14/99]

B.11. Test Reports.

(a) The owner or operator of an emissions unit for which a compliance test is required shall file a report with the Department on the results of each such test.

(b) The required test report shall be filed with the Department as soon as practical but no later than 45 days after the last sampling run of each test is completed.

[Rule 62-297.310(8), F.A.C.]

Section III. Emissions Unit(s) and Conditions.

Subsection C. This section addresses the following emissions unit(s).

E.U.

<u>ID No.</u>	<u>Brief Description</u>
---------------	--------------------------

-004	Coal Storage Yard
------	-------------------

The coal receiving, storage and transfer systems at the coal storage yard support the operation of the two power boilers. Particulate matter emissions are controlled at the "as-received transfer tower", the "as-fired transfer tower", and the conveyors to the silos by fabric filter systems. Water sprays, full enclosures or partial enclosures are also utilized, where appropriate.

{Permitting note(s): IMPORTANT REGULATORY CLASSIFICATIONS - The emissions unit is regulated under NSPS - 40 CFR 60, Subpart Y, Standards of Performance for Coal Preparation Plants, adopted and incorporated by reference in Rule 62-204.800(7), F.A.C.; Prevention of Significant Deterioration (PSD); Rule 62-212.400(6), F.A.C., Best Available Control Technology (BACT) Determination, dated June 15, 1979. The coal storage yard began commercial operation in 1985.}

The following specific conditions apply to the emissions unit(s) listed above:

Essential Potential to Emit (PTE) Parameters

C.1. Permitted Capacity. The maximum throughput rate shall not exceed 3,000 tons per hour. [Rules 62-4.160(2) and 62-210.200(PTE), F.A.C.; and, Initial Title V application received June 17, 1996]

{Permitting note: The throughput limitations have been placed in each permit to identify the capacity of each unit for the purposes of confirming that emissions testing is conducted within 90 to 100 percent of the unit's rated capacity (or to limit future operation to 110 percent of the test load), to establish appropriate emission limits and to aid in determining future rule applicability. Regular record keeping is not required for throughput. Also, see permitting note under specific condition C.7.}

C.2. Emissions Unit Operating Rate Limitation After Testing. See specific condition C.7. [Rule 62-297.310(2), F.A.C.]

C.3. Hours of Operation. This emissions unit is allowed to operate continuously, i.e., 8,760 hours/year. [Rule 62-210.200(PTE), F.A.C.]

Emission Limitations and Standards

{Permitting note: Table 1-1, Summary of Air Pollutant Standards and Terms, summarizes information for convenience purposes only. This table does not supersede any of the terms or conditions of this permit.}

{Permitting note: Unless otherwise specified, the averaging times for Specific Condition C.4 is based on the specified averaging time of the applicable test method.}

C.4. Visible Emissions. An owner or operator shall not cause to be discharged into the atmosphere from any coal processing and conveying equipment, coal storage system, or coal transfer and loading system

processing coal, gases which exhibit 20 percent opacity or greater.
[40 CFR 60.252(c); and, PSD-FL-018]

{Permitting note: The averaging time for this condition is based on the run time of the specified test method.}

Monitoring of Operations

C.5. Determination of Process Variables.

(a) Required Equipment. The owner or operator of an emissions unit for which compliance tests are required shall install, operate, and maintain equipment or instruments necessary to determine process variables, such as process weight input or heat input, when such data are needed in conjunction with emissions data to determine the compliance of the emissions unit with applicable emission limiting standards.

(b) Accuracy of Equipment. Equipment or instruments used to directly or indirectly determine process variables, including devices such as belt scales, weight hoppers, flow meters, and tank scales, shall be calibrated and adjusted to indicate the true value of the parameter being measured with sufficient accuracy to allow the applicable process variable to be determined within 10% of its true value.
[Rule 62-297.310(5), F.A.C.]

{Permitting note: Emission limiting standards for the coal handling and storage emission unit consist only of visible emissions (VE). Compliance with the VE standard is determined using EPA Method 9. A determination of compliance is not dependent on the use of instruments or equipment to determine process variables.}

Test Methods and Procedures

{Permitting note: Table 2-1, Summary of Compliance Requirements, summarizes information for convenience purposes only. This table does not supersede any of the terms or conditions of this permit.}

C.6. Visible Emissions. EPA Method 9 and the procedures in 40 CFR 60.11 shall be used to determine opacity.
[40 CFR 60.254(b)(2); and, PSD-FL-018]

C.7. Operating Rate During Testing. Testing of emissions shall be conducted with the emissions unit operation at permitted capacity, which is defined as 90 to 100 percent of the maximum operation rate allowed by the permit. If it is impracticable to test at permitted capacity, an emissions unit may be tested at less than the minimum permitted capacity; in this case, subsequent emissions unit operation is limited to 110 percent of the test load until a new test is conducted. Once the emissions unit is so limited, operation at higher capacities is allowed for no more than 15 consecutive days for the purpose of additional compliance testing to regain the authority to operate at the permitted capacity.
[Rules 62-297.310(2) & (2)(b), F.A.C.]

{Permitting note: The permitted capacity of the coal handling and storage emissions unit is based on conveyor belt capacity. Conveyor belt speed is set and does not vary during normal operation. However, feeder belts which supply coal to the conveyor belts are variable speed. Bins, crushers, and silos are filled on a batch process basis by the conveyor belts which are either on or off. The period at which the highest opacity emissions can reasonably be expected to occur at the emissions points subject to the standard, (i.e., CH-002, CH-011, and CH-012a and b) will be when the conveyor belts are on during

normal operation. Therefore, the period during which the conveyor belts are on during normal operation shall represent permitted capacity of this emissions unit for purposes of compliance testing.}

C.8. Applicable Test Procedures.

(a) Required Sampling Time.

2. Opacity Compliance Tests. When either EPA Method 9 or DEP Method 9 is specified as the applicable opacity test method, the required minimum period of observation for a compliance test shall be sixty (60) minutes for emissions units which emit or have the potential to emit 100 tons per year or more of particulate matter, and thirty (30) minutes for emissions units which have potential emissions less than 100 tons per year of particulate matter and are not subject to a multiple-valued opacity standard. The opacity test observation period shall include the period during which the highest opacity emissions can reasonably be expected to occur. Exceptions to these requirements are as follows:

- c. The minimum observation period for opacity tests conducted by employees or agents of the Department to verify the day-to-day continuing compliance of a unit or activity with an applicable opacity standard shall be twelve minutes.

[Rule 62-297.310(4)(a)2.c., F.A.C.]

{Permitting note: EPA Method 9 has been previously specified as the applicable opacity test method.}

C.9. Frequency of Compliance Tests. The following provisions apply only to those emissions units that are subject to an emissions limiting standard for which compliance testing is required.

(a) General Compliance Testing.

3. The owner or operator of an emissions unit that is subject to any emission limiting standard shall conduct a compliance test that demonstrates compliance with the applicable emission limiting standard prior to obtaining a renewed operation permit. Emissions units that are required to conduct an annual compliance test may submit the most recent annual compliance test to satisfy the requirements of this provision. In renewing an air operation permit pursuant to Rule 62-210.300(2)(a)3.b., c., or d., F.A.C., the Department shall not require submission of emission compliance test results for any emissions unit that, during the year prior to renewal:

- a. Did not operate;

4. During each federal fiscal year (October 1 - September 30), unless otherwise specified by rule, order, or permit, the owner or operator of each emissions unit shall have a formal compliance test conducted for:

- a. Visible emissions, if there is an applicable standard;

9. The owner or operator shall notify the Department, at least 15 days prior to the date on which each formal compliance test is to begin, of the date, time, and place of each such test, and the test contact person who will be responsible for coordinating and having such test conducted for the owner or operator.

(b) Special Compliance Tests. When the Department, after investigation, has good reason (such as complaints, increased visible emissions or questionable maintenance of control equipment) to believe that any applicable emission standard contained in a Department rule or in a permit issued pursuant to those rules is being violated, it may require the owner or operator of the emissions unit to conduct compliance tests which identify the nature and quantity of pollutant emissions from the emissions unit and to provide a report on the results of said tests to the Department.

(c) Waiver of Compliance Test Requirements. If the owner or operator of an emissions unit that is subject to a compliance test requirement demonstrates to the Department, pursuant to the procedure established in Rule 62-297.620, F.A.C., that the compliance of the emissions unit with an applicable weight emission limiting standard can be adequately determined by means other than the designated test

procedure, such as specifying a surrogate standard of no visible emissions for particulate matter sources equipped with a bag house or specifying a fuel analysis for sulfur dioxide emissions, the Department shall waive the compliance test requirements for such emissions units and order that the alternate means of determining compliance be used, provided, however, the provisions of Rule 62-297.310(7)(b), F.A.C., shall apply.

[Rule 62-297.310(7), F.A.C.; and, SIP approved]

{Permitting note: The individual coal handling and storage emission points requiring an annual VE test are those containing baghouse controls. These baghouse locations are emission points CH-002, CH-011, and CH-012a and b. For those emissions points specified herein containing a baghouse, the permittee shall maintain daily records of the differential pressure to assure that the baghouse is operating properly. Differential pressure data will be collected and correlated to visible emissions. This data will be used to develop an action plan based on the differential pressure levels. The facility will provide the Department the results of this study within 180 days of the issuance date of this permit.}

Recordkeeping and Reporting Requirements

C.10. Test Reports.

(a) The owner or operator of an emissions unit for which a compliance test is required shall file a report with the Department on the results of each such test.

(b) The required test report shall be filed with the Department as soon as practical but no later than 45 days after the last sampling run of each test is completed.

[Rule 62-297.310(8), F.A.C.]

Miscellaneous Requirements.

C.11. The permittee shall comply with the requirements contained in Appendix 40 CFR 60, Subpart A, attached to this permit.

[Rule 62-204.800(7)(d), F.A.C.]

C.12. The opacity standards set forth in 40 CFR 60 shall apply at all times except during periods of startup, shutdown, malfunction and as otherwise provided in the applicable standard.

At all times, including periods of startup, shutdown, and malfunction, owners and operators shall, to the extent practicable, maintain and operate any affected facility including associated air pollution control equipment in a manner consistent with good air pollution control practice for minimizing emissions. Determination of whether acceptable operating and maintenance procedures are being used will be based on information available to the Administrator which may include, but is not limited to, monitoring results, opacity observations, review of operating and maintenance procedures, and inspection of the source.

[40 CFR 60.11(c) & (d)]

Section III. Emissions Unit(s) and Conditions.

Subsection D. This section addresses the following emissions unit(s).

E.U.

ID No. Brief Description

-005 Limestone and FGD Sludge Handling and Storage

The limestone handling and storage system consists of a limestone unloading facility where particulate matter emissions are controlled by a panel filter, a limestone handling and storage system which utilizes a partial enclosure to control particulate matter emissions. In the FGD sludge processing system particulate emissions, which originate from the transfer of quicklime and flyash from both truck and rail delivery, are controlled by the use of bag house filters. Scrubbers are also utilized to control particulate emissions in the FGD sludge processing building.

{Permitting note(s): IMPORTANT REGULATORY CLASSIFICATIONS - The emissions unit is regulated under Prevention of Significant Deterioration (PSD); Rule 62-212.400(6), F.A.C., Best Available Control Technology (BACT) Determination, dated June 15, 1979.}

The following specific conditions apply to the emissions unit(s) listed above:

Essential Potential to Emit (PTE) Parameters

D.1. Permitted Capacity. The maximum limestone unloading or transfer rate shall not exceed 72.38 tons per hour. The throughput rates for the sludge stabilization system are intermittent and variable. [Rules 62-4.160(2) and 62-210.200(PTE), F.A.C.; and, Initial Title V application received June 17, 1996]

{Permitting note: The limestone unloading or transfer rate limitations have been placed in each permit to identify the capacity of each unit for the purposes of confirming that emissions testing is conducted within 90 to 100 percent of the unit's rated capacity (or to limit future operation to 110 percent of the test load), to establish appropriate emission limits and to aid in determining future rule applicability. Regular record keeping is not required for unloading or transfer rates. Also, see permitting note under specific condition **D.7.**}

D.2. Emissions Unit Operating Rate Limitation After Testing. See specific condition **D.7.**
[Rule 62-297.310(2), F.A.C.]

D.3. Hours of Operation. This emissions unit is allowed to operate continuously, i.e., 8,760 hours/year.
[Rule 62-210.200(PTE), F.A.C.]

Emission Limitations and Standards

{Permitting note: Table 1-1, Summary of Air Pollutant Standards and Terms, summarizes information for convenience purposes only. This table does not supersede any of the terms or conditions of this permit.}

{Permitting note: Unless otherwise specified, the averaging times for Specific Condition **D.4** is based on the specified averaging time of the applicable test method.}

D.4. Visible Emissions. An owner or operator shall not cause to be discharged into the atmosphere gases which exhibit 20 percent opacity or greater.
[PSD-FL-018]

{Permitting note: The averaging time for this condition is based on the application time of the coating being applied.}

Monitoring of Operations

D.5. Determination of Process Variables.

(a) **Required Equipment.** The owner or operator of an emissions unit for which compliance tests are required shall install, operate, and maintain equipment or instruments necessary to determine process variables, such as process weight input or heat input, when such data are needed in conjunction with emissions data to determine the compliance of the emissions unit with applicable emission limiting standards.

(b) **Accuracy of Equipment.** Equipment or instruments used to directly or indirectly determine process variables, including devices such as belt scales, weight hoppers, flow meters, and tank scales, shall be calibrated and adjusted to indicate the true value of the parameter being measured with sufficient accuracy to allow the applicable process variable to be determined within 10% of its true value.
[Rule 62-297.310(5), F.A.C.]

{Permitting note: Emission limiting standards for the limestone and FGD sludge handling and storage emission unit consist only of visible emissions (VE). Compliance with the VE standard is determined using EPA Method 9, which is not dependent on the use of instruments or equipment to determine process variables.}

Test Methods and Procedures

{Permitting note: Table 2-1, Summary of Compliance Requirements, summarizes information for convenience purposes only. This table does not supersede any of the terms or conditions of this permit.}

D.6. Visible Emissions. EPA Method 9 shall be used to determine opacity compliance pursuant to Chapter 62-297, F.A.C.
[Rules 62-213.440 and 62-297.401, F.A.C.]

D.7. Operating Rate During Testing. Testing of emissions shall be conducted with the emissions unit operation at permitted capacity, which is defined as 90 to 100 percent of the maximum operation rate allowed by the permit. If it is impracticable to test at permitted capacity, an emissions unit may be tested at less than the minimum permitted capacity; in this case, subsequent emissions unit operation is limited to 110 percent of the test load until a new test is conducted. Once the emissions unit is so limited, operation at higher capacities is allowed for no more than 15 consecutive days for the purpose of additional compliance testing to regain the authority to operate at the permitted capacity.
[Rules 62-297.310(2) & (2)(b), F.A.C.]

{Permitting note: The permitted capacity of the limestone handling and storage emissions unit is based on trucks per hour. Trucks per hour has no bearing on determining the period at which the highest opacity emissions can reasonably be expected to occur at emission point L-001. Normal operating conditions when trucks are delivering/unloading constitute the appropriate time period for VE testing. Therefore, such periods shall represent permitted capacity for compliance testing.}

D.8. Applicable Test Procedures.

(a) Required Sampling Time.

2. Opacity Compliance Tests. When either EPA Method 9 or DEP Method 9 is specified as the applicable opacity test method, the required minimum period of observation for a compliance test shall be sixty (60) minutes for emissions units which emit or have the potential to emit 100 tons per year or more of particulate matter, and thirty (30) minutes for emissions units which have potential emissions less than 100 tons per year of particulate matter and are not subject to a multiple-valued opacity standard. The opacity test observation period shall include the period during which the highest opacity emissions can reasonably be expected to occur. Exceptions to these requirements are as follows:

- c. The minimum observation period for opacity tests conducted by employees or agents of the Department to verify the day-to-day continuing compliance of a unit or activity with an applicable opacity standard shall be twelve minutes.

[Rule 62-297.310(4)(a)2.c., F.A.C.]

{Permitting note: EPA Method 9 has been previously specified as the applicable opacity test method.}

D.9. Frequency of Compliance Tests. The following provisions apply only to those emissions units that are subject to an emissions limiting standard for which compliance testing is required.

(a) General Compliance Testing.

3. The owner or operator of an emissions unit that is subject to any emission limiting standard shall conduct a compliance test that demonstrates compliance with the applicable emission limiting standard prior to obtaining a renewed operation permit. Emissions units that are required to conduct an annual compliance test may submit the most recent annual compliance test to satisfy the requirements of this provision. In renewing an air operation permit pursuant to Rule 62-210.300(2)(a)3.b., c., or d., F.A.C., the Department shall not require submission of emission compliance test results for any emissions unit that, during the year prior to renewal:

- a. Did not operate;
4. During each federal fiscal year (October 1 - September 30), unless otherwise specified by rule, order, or permit, the owner or operator of each emissions unit shall have a formal compliance test conducted for:
- a. Visible emissions, if there is an applicable standard;
9. The owner or operator shall notify the Department, at least 15 days prior to the date on which each formal compliance test is to begin, of the date, time, and place of each such test, and the test contact person who will be responsible for coordinating and having such test conducted for the owner or operator.

(b) Special Compliance Tests. When the Department, after investigation, has good reason (such as complaints, increased visible emissions or questionable maintenance of control equipment) to believe that any applicable emission standard contained in a Department rule or in a permit issued pursuant to those rules is being violated, it may require the owner or operator of the emissions unit to conduct compliance tests which identify the nature and quantity of pollutant emissions from the emissions unit and to provide a report on the results of said tests to the Department.

(c) Waiver of Compliance Test Requirements. If the owner or operator of an emissions unit that is subject to a compliance test requirement demonstrates to the Department, pursuant to the procedure established in Rule 62-297.620, F.A.C., that the compliance of the emissions unit with an applicable weight emission limiting standard can be adequately determined by means other than the designated test procedure, such as specifying a surrogate standard of no visible emissions for particulate matter sources equipped with a bag house or specifying a fuel analysis for sulfur dioxide emissions, the Department shall waive the compliance test requirements for such emissions units and order that the alternate means

of determining compliance be used, provided, however, the provisions of Rule 62-297.310(7)(b), F.A.C., shall apply.

[Rule 62-297.310(7), F.A.C.; and, SIP approved]

{Permitting note: The individual limestone and FGD sludge handling points requiring an annual VE test are those containing filter and wet scrubber equipment. These locations are emissions points L-001, FGD-002, FGD-003 or FGD-004, FGD-005 or FGD-006, FGD-007 or FGD-008, and FGD-009 or FGD-010. For those emissions points specified herein containing a baghouse, the permittee shall maintain daily records of the differential pressure to assure that the baghouse is operating properly. Differential pressure data will be collected and correlated to visible emissions. This data will be used to develop an action plan based on the differential pressure levels. The facility will provide the Department the results of this study within 180 days of the issuance date of this permit.}

Recordkeeping and Reporting Requirements

D.10. Test Reports.

(a) The owner or operator of an emissions unit for which a compliance test is required shall file a report with the Department on the results of each such test.

(b) The required test report shall be filed with the Department as soon as practical but no later than 45 days after the last sampling run of each test is completed.

[Rule 62-297.310(8), F.A.C.]

Section IV. This section is the Acid Rain Part.

Operated by: Seminole Electric Cooperative, Inc.
ORIS code: 136

Subsection A. This subsection addresses Acid Rain, Phase II.

The emissions units listed below are regulated under Acid Rain, Phase II.

E.U.

ID No. Brief Description

-001 Steam Electric Generator No. 1
-002 Steam Electric Generator No. 2

A.1. The Phase II permit application(s) submitted for this facility, as approved by the Department, are a part of this permit. The owners and operators of these Phase II acid rain unit(s) must comply with the standard requirements and special provisions set forth in the application(s) listed below:

DEP Form No. 62-210.900(1)(a), dated June 8, 2004

A.2. Sulfur dioxide (SO₂) allowance allocations for each Acid Rain unit is as follows:

<u>E.U. ID</u> <u>No.</u>	<u>EPA ID</u>	<u>Year</u>	2005	2006	2007	2008	2009
-001	1	SO ₂ allowances, under Table 2 or 3 of 40 CFR Part 73	18,381*	18,381*	18,381*	18,381*	18,381*
-002	2	SO ₂ allowances, under Table 2 or 3 of 40 CFR Part 73	18,381*	18,381*	18,381*	18,381*	18,381*

* The number of allowances held by an Acid Rain source in a unit account may differ from the number allocated by the USEPA under Table 2 or 3 of 40 CFR 73.]

A.3. Emission Allowances. Emissions from sources subject to the Federal Acid Rain Program (Title IV) shall not exceed any allowances that the source lawfully holds under the Federal Acid Rain Program. Allowances shall not be used to demonstrate compliance with a non-Title IV applicable requirement of the Act.

1. No permit revision shall be required for increases in emissions that are authorized by allowances acquired pursuant to the Federal Acid Rain Program, provided that such increases do not require a permit revision pursuant to Rule 62-213.400(3), F.A.C.

2. No limit shall be placed on the number of allowances held by the source under the Federal Acid Rain Program.

3. Allowances shall be accounted for under the Federal Acid Rain Program.

[Rule 62-213.440(1)(c), F.A.C.]

A.4. Fast-Track Revisions of Acid Rain Parts. Those Acid Rain sources making a change described at Rule 62- 214.370(4), F.A.C., may request such change as provided in Rule 62-213.413, F.A.C., Fast-Track Revisions of Acid Rain Parts.
[Rules 62-213.413 and 62-214.370(4), F.A.C.]

A.5. No permit revision shall be required for increases in emissions that are authorized by allowances acquired pursuant to the Federal Acid Rain Program, provided that such increases do not require a permit revision pursuant to Rule 62-213.400, F.A.C.
[40 CFR 70.6(a)(4)(i); and, Rule 62-213.440(1)(c)1., F.A.C.]

A.6. Where an applicable requirement of the Act is more stringent than an applicable requirement of regulations promulgated under Title IV of the Act, both provisions shall be incorporated into the permit and shall be enforceable by the Administrator.
[40 CFR 70.6(a)(1)(ii); and, Rule 62-210.200, Definitions - Applicable Requirements, F.A.C.]

A.7. Comments, notes, and justifications: None.

Subsection B. This subsection addresses Acid Rain, Phase II.

The emissions unit listed below is regulated under Acid Rain Part, Phase II, for Seminole Electric Cooperative, Inc, Seminole Power Plant, **Facility ID No.:** 1070025, **ORIS code:** 136.

E.U. ID

<u>No.</u>	<u>Brief Description</u>
-001	Steam Electric Generator No. 1
-002	Steam Electric Generator No. 2

The provisions of the Phase II permit govern(s) those emissions unit(s) from January 1, 2000 through the expiration date of this Title V permit. The Phase II permit governs all other affected units for the effective period of this permit.

B.1. The owners and operators of these Phase II acid rain unit(s) must comply with the standard requirements and special provisions set forth in the plan(s) listed below:

Phase II NO_x Compliance Plan dated June 29, 2004. **See Specific Condition B.2.**
[Chapter 62-213, F.A.C. and Rule 62-214.320, F.A.C.]

B.2. Nitrogen oxide (NO_x) requirements for each Acid Rain unit is as follows:

<u>E.U. ID</u> No.	EPA ID	NO_x limit
-001	1	<p>Pursuant to 40 CFR 76.8(d)(2), the Florida Department of Environmental Protection approves a NO_x early election compliance plan for unit U1. The compliance plan is effective for calendar year 2000 through calendar year 2007. Under the compliance plan, this unit's annual average NO_x emission rate for each year, determined in accordance with 40 CFR part 75, shall not exceed the applicable emission limitation, under "40 CFR 76.5(a)(2) of 0.50 lb/mmBtu" for dry bottom wall-fired boilers. If the unit is in compliance with its applicable emission limitation for each year of the plan, then the unit shall not be subject to the applicable emission limitation, under "40 CFR 76.7(a)(2) of 0.46 lb/mmBtu" for dry bottom wall-fired boilers until calendar year 2008.</p> <p>In addition to the described NO_x compliance plan, this unit shall comply with all other applicable requirements of 40 CFR part 76, including the duty to reapply for a NO_x compliance plan and the requirements covering excess emissions.</p>
-002	2	<p>Pursuant to 40 CFR 76.8(d)(2), the Florida Department of Environmental Protection approves a NO_x early election compliance plan for unit U2. The compliance plan is effective for calendar year 2000 through calendar year 2007. Under the compliance plan, this unit's annual average NO_x emission rate for each year, determined in accordance with 40 CFR part 75, shall not exceed the applicable emission limitation, under "40 CFR 76.5(a)(2) of 0.50 lb/mmBtu" for dry bottom wall-fired boilers. If the unit is in compliance with its applicable emission limitation for each year of the plan, then the unit shall not be subject to the applicable emission limitation, under "40 CFR 76.7(a)(2) of 0.46 lb/mmBtu" for dry bottom wall-fired boilers until calendar year 2008.</p> <p>In addition to the described NO_x compliance plan, this unit shall comply with all other applicable requirements of 40 CFR part 76, including the duty to reapply for a NO_x compliance plan and the requirements covering excess emissions.</p>

B.3. Comments, notes, and justifications: none

Appendix U-1, List of Unregulated Emissions Units and/or Activities.

Seminole Electric Cooperative, Inc.
Seminole Power Plant

DRAFT Permit No.: 1070025-002-AV
Facility ID No.: 1070025

Unregulated Emissions Units and/or Activities. An emissions unit which emits no “emissions-limited pollutant” and which is subject to no unit-specific work practice standard, though it may be subject to regulations applied on a facility-wide basis (e.g., unconfined emissions, odor, general opacity) or to regulations that require only that it be able to prove exemption from unit-specific emissions or work practice standards.

The below listed emissions units and/or activities are neither ‘regulated emissions units’ nor ‘insignificant emissions units’.

E.U. ID

<u>No.</u>	<u>Brief Description of Emissions Units and/or Activity</u>
-006	One or more emergency generators not subject to the Acid Rain Program
-007	One or more heating units and general purpose internal combustion engines not subject to the Acid Rain Program
-008	General plant fugitives including plant-wide abrasive blasting, painting, moveable abrasive blast material bin, soil borrow pit, and vehicular travel on unpaved roads.

[electronic file name: 1070025u.doc]

Appendix I-1, List of Insignificant Emissions Units and/or Activities.

Seminole Electric Cooperative, Inc.
Seminole Power Plant

DRAFT Permit No.: 1070025-002-AV
Facility ID No.: 1070025

The facilities, emissions units, or pollutant-emitting activities listed in Rule 62-210.300(3)(a), F.A.C., Categorical Exemptions, are exempt from the permitting requirements of Chapters 62-210 and 62-4, F.A.C.; provided, however, that exempt emissions units shall be subject to any applicable emission limiting standards and the emissions from exempt emissions units or activities shall be considered in determining the potential emissions of the facility containing such emissions units. Emissions units and pollutant-emitting activities exempt from permitting under Rule 62-210.300(3)(a), F.A.C., shall not be exempt from the permitting requirements of Chapter 62-213, F.A.C., if they are contained within a Title V source; however, such emissions units and activities shall be considered insignificant for Title V purposes provided they also meet the criteria of Rule 62-213.430(6)(b), F.A.C. No emissions unit shall be entitled to an exemption from permitting under Rule 62-210.300(3)(a), F.A.C., if its emissions, in combination with the emissions of other units and activities at the facility, would cause the facility to emit or have the potential to emit any pollutant in such amount as to make the facility a Title V source.

The below listed emissions units and/or activities are considered insignificant pursuant to Rule 62-213.430(6), F.A.C.

Brief Description of Emissions Units and/or Activities

1. Brazing, soldering and welding
2. Parts cleaning and degreasing stations
3. Storage tanks <550 gallons
4. Inorganic substance storage tanks >550 gallons
5. No. 2 fuel oil storage tanks >550 gallons
6. Laboratory equipment used exclusively for chemical or physical analysis
7. Fire and safety equipment
8. Turbine vapor extractor
9. Sand blasting and abrasive blasting where temporary total enclosures are used to contain particulate
10. Equipment used for steam cleaning
11. Belt conveyors not subject to 40 CFR 60, Subpart Y
12. Vehicle refueling operations
13. Vacuum pumps in laboratory operations
14. Equipment used exclusively for space heating, excluding boilers
15. Surface coating operations utilizing 6.0 gallons per day, or less, averaged monthly, of coatings
16. Degreasing units using heavier than air vapors exclusively, except any unit using or emitting any substance classified as a hazardous air pollutant.
17. Surface coating operations utilizing only coatings containing 5.0 percent or less VOCs, by volume.
18. Lime transfer associated with water pretreatment.
19. Purge water treatment lime silo.

APPENDIX TV-4, TITLE V CONDITIONS (version dated 02/12/02)

[Note: This attachment includes "canned conditions" developed from the "Title V Core List."]

{Permitting note: APPENDIX TV-4, TITLE V CONDITIONS, is distributed to the permittee only. Other persons requesting copies of these conditions shall be provided one copy when requested or otherwise appropriate.}

Chapter 62-4, F.A.C.

1. **Not federally enforceable. General Prohibition.** Any stationary installation which will reasonably be expected to be a source of pollution shall not be operated, maintained, constructed, expanded, or modified without the appropriate and valid permits issued by the Department, unless the source is exempted by Department rule. The Department may issue a permit only after it receives reasonable assurance that the installation will not cause pollution in violation of any of the provisions of Chapter 403, F.S., or the rules promulgated thereunder. A permitted installation may only be operated, maintained, constructed, expanded or modified in a manner that is consistent with the terms of the permit.

[Rule 62-4.030, Florida Administrative Code (F.A.C.); Section 403.087, Florida Statute (F.S.)]

2. **Not federally enforceable. Procedures to Obtain Permits and Other Authorizations: Applications.**

(1) Any person desiring to obtain a permit from the Department shall apply on forms prescribed by the Department and shall submit such additional information as the Department by law may require.

(2) All applications and supporting documents shall be filed in quadruplicate with the Department.

(3) To ensure protection of public health, safety, and welfare, any construction, modification, or operation of an installation which may be a source of pollution, shall be in accordance with sound professional engineering practices pursuant to Chapter 471, F.S. All applications for a Department permit shall be certified by a professional engineer registered in the State of Florida except, when the application is for renewal of an air pollution operation permit at a non-Title V source as defined in Rule 62-210.200, F.A.C., or where professional engineering is not required by Chapter 471, F.S. Where required by Chapter 471 or 492, F.S., applicable portions of permit applications and supporting documents which are submitted to the Department for public record shall be signed and sealed by the professional(s) who prepared or approved them.

(4) Processing fees for air construction permits shall be in accordance with Rule 62-4.050(4), F.A.C.

(5)(a) To be considered by the Department, each application must be accompanied by the proper processing fee. The fee shall be paid by check, payable to the Department of Environmental Protection. The fee is non-refundable except as provided in Section 120.60, F.S., and in this section.

(c) Upon receipt of the proper application fee, the permit processing time requirements of Sections 120.60(2) and 403.0876, F.S., shall begin.

(d) If the applicant does not submit the required fee within ten days of receipt of written notification, the Department shall either return the unprocessed application or arrange with the applicant for the pick up of the application.

(e) If an applicant submits an application fee in excess of the required fee, the permit processing time requirements of Sections 120.60(2) and 403.0876, F.S., shall begin upon receipt, and the Department shall refund to the applicant the amount received in excess of the required fee.

(6) Any substantial modification to a complete application shall require an additional processing fee determined pursuant to the schedule set forth in Rule 62-4.050, F.A.C., and shall restart the time requirements of Sections 120.60 and 403.0876, F.S. For purposes of this Subsection, the term "substantial modification" shall mean a modification which is reasonably expected to lead to substantially different environmental impacts which require a detailed review.

(7) Modifications to existing permits proposed by the permittee which require substantial changes in the existing permit or require substantial evaluation by the Department of potential impacts of the proposed modifications shall require the same fee as a new application for the same time duration except for modification under Chapter 62-45, F.A.C.

[Rule 62-4.050, F.A.C.]

3. **Standards for Issuing or Denying Permits.** Except as provided at Rule 62-213.460, F.A.C., the issuance of a permit does not relieve any person from complying with the requirements of Chapter 403, F.S., or Department rules.

[Rule 62-4.070(7), F.A.C.]

4. Modification of Permit Conditions.

(1) For good cause and after notice and an administrative hearing, if requested, the Department may require the permittee to conform to new or additional conditions. The Department shall allow the permittee a reasonable time to conform to the new or additional conditions and on application of the permittee the Department may grant additional time. For the purpose of this section, good cause shall include, but not be limited to, any of the following: (also, see Condition No. 38.).

- (a) A showing that an improvement in effluent or emission quality or quantity can be accomplished because of technological advances without unreasonable hardship.
- (b) A showing that a higher degree of treatment is necessary to effect the intent and purpose of Chapter 403, F.S.
- (c) A showing of any change in the environment or surrounding conditions that requires a modification to conform to applicable air or water quality standards.
- (e) Adoption or revision of Florida Statutes, rules, or standards which require the modification of a permit condition for compliance.

(2) A permittee may request a modification of a permit by applying to the Department.

(3) A permittee may request that a permit be extended as a modification of the permit. Such a request must be submitted to the Department in writing before the expiration of the permit. Upon timely submittal of a request for extension, unless the permit automatically expires by statute or rule, the permit will remain in effect until final agency action is taken on the request. For construction permits, an extension shall be granted if the applicant can demonstrate reasonable assurances that, upon completion, the extended permit will comply with the standards and conditions required by applicable regulation. For all other permits, an extension shall be granted if the applicant can demonstrate reasonable assurances that the extended permit will comply with the standards and conditions applicable to the original permit. A permit for which the permit application fee was prorated in accordance with Rule 62-4.050(4)(1), F.A.C., shall not be extended. In no event shall a permit be extended or remain in effect longer than the time limits established by statute or rule.

[Rule 62-4.080, F.A.C.]

5. Renewals. Prior to 180 days before the expiration of a permit issued pursuant to Chapter 62-213, F.A.C., the permittee shall apply for a renewal of a permit using forms incorporated by reference in the specific rule chapter for that kind of permit. A renewal application shall be timely and sufficient. If the application is submitted prior to 180 days before expiration of the permit, it will be considered timely and sufficient. If the renewal application is submitted at a later date, it will not be considered timely and sufficient unless it is submitted and made complete prior to the expiration of the operation permit. When the application for renewal is timely and sufficient, the existing permit shall remain in effect until the renewal application has been finally acted upon by the Department or, if there is court review of the Department's final agency action, until a later date is required by Section 120.60, F.S., provided that, for renewal of a permit issued pursuant to Chapter 62-213, F.A.C., the applicant complies with the requirements of Rules 62-213.420(1)(b)3. and 4., F.A.C.

[Rule 62-4.090, F.A.C.]

6. Suspension and Revocation.

(1) Permits shall be effective until suspended, revoked, surrendered, or expired and shall be subject to the provisions of Chapter 403, F.S., and rules of the Department.

(2) Failure to comply with pollution control laws and rules shall be grounds for suspension or revocation.

(3) A permit issued pursuant to Chapter 62-4, F.A.C., shall not become a vested property right in the permittee. The Department may revoke any permit issued by it if it finds that the permit holder or the his agent:

- (a) Submitted false or inaccurate information in his application or operational reports.
- (b) Has violated law, Department orders, rules or permit conditions.
- (c) Has failed to submit operational reports or other information required by Department rules.
- (d) Has refused lawful inspection under Section 403.091, F.S.

(4) No revocation shall become effective except after notice is served by personal services, certified mail, or newspaper notice pursuant to Section 120.60(7), F.S., upon the person or persons named therein and a hearing held if requested within the time specified in the notice. The notice shall specify the provision of the law, or rule alleged to be violated, or the permit condition or Department order alleged to be violated, and the facts alleged to constitute a violation thereof.

[Rule 62-4.100, F.A.C.]

7. **Not federally enforceable. Financial Responsibility.** The Department may require an applicant to submit proof of financial responsibility and may require the applicant to post an appropriate bond to guarantee compliance with the law and Department rules. [Rule 62-4.110, F.A.C.]

8. **Transfer of Permits.**

(1) Within 30 days after the sale or legal transfer of a permitted facility, an "Application for Transfer of Permit" (DEP Form 62-1.201(1)) must be submitted to the Department. This form must be completed with the notarized signatures of both the permittee and the proposed new permittee. For air permits, an "Application for Transfer of Air Permit" (DEP Form 62-210.900(7)) shall be submitted.

(2) The Department shall approve the transfer of a permit unless it determines that the proposed new permittee cannot provide reasonable assurances that conditions of the permit will be met. The determination shall be limited solely to the ability of the new permittee to comply with the conditions of the existing permit, and it shall not concern the adequacy of these permit conditions. If the Department proposes to deny the transfer, it shall provide both the permittee and the proposed new permittee a written objection to such transfer together with notice of a right to request a Chapter 120, F.S., proceeding on such determination.

(3) Within 30 days of receiving a properly completed Application for Transfer of Permit form, the Department shall issue a final determination. The Department may toll the time for making a determination on the transfer by notifying both the permittee and the proposed new permittee that additional information is required to adequately review the transfer request. Such notification shall be served within 30 days of receipt of an Application for Transfer of Permit form, completed pursuant to Rule 62-4.120(1), F.A.C. If the Department fails to take action to approve or deny the transfer within 30 days of receipt of the completed Application for Transfer of Permit form, or within 30 days of receipt of the last item of timely requested additional information, the transfer shall be deemed approved.

(4) The permittee is encouraged to apply for a permit transfer prior to the sale or legal transfer of a permitted facility. However, the transfer shall not be effective prior to the sale or legal transfer.

(5) Until this transfer is approved by the Department, the permittee and any other person constructing, operating, or maintaining the permitted facility shall be liable for compliance with the terms of the permit. The permittee transferring the permit shall remain liable for corrective actions that may be required as a result of any violations occurring prior to the sale or legal transfer of the facility.

[Rule 62-4.120, F.A.C.]

9. **Plant Operation-Problems.** If the permittee is temporarily unable to comply with any of the conditions of the permit due to breakdown of equipment or destruction by hazard of fire, wind or by other cause, the permittee shall immediately notify the Department. Notification shall include pertinent information as to the cause of the problem, and what steps are being taken to correct the problem and to prevent its recurrence, and where applicable, the owner's intent toward reconstruction of destroyed facilities. Such notification does not release the permittee from any liability for failure to comply with Department rules. (also, see Condition No. 10.).

[Rule 62-4.130, F.A.C.]

10. For purposes of notification to the Department pursuant to Condition No. 9., Condition No. 12.(8), and Rule 62-4.130, F.A.C., Plant Operation-Problems, "immediately" shall mean the same day, if during a workday (i.e., 8:00 a.m. - 5:00 p.m.), or the first business day after the incident, excluding weekends and holidays; and, for purposes of 40 CFR 70.6(a)(3)(iii)(B), "prompt" shall have the same meaning as "immediately". [also, see Conditions Nos. 9. and 12.(8).]

[40 CFR 70.6(a)(3)(iii)(B)]

11. **Not federally enforceable. Review.** Failure to request a hearing within 14 days of receipt of notice of proposed or final agency action on a permit application or as otherwise required in Chapter 62-103, F.A.C., shall be deemed a waiver of the right to an administrative hearing.

[Rule 62-4.150, F.A.C.]

12. Permit Conditions. All permits issued by the Department shall include the following general conditions:

- (1) The terms, conditions, requirements, limitations and restrictions set forth in this permit, are "permit conditions" and are binding and enforceable pursuant to Sections 403.141, 403.727, or 403.859 through 403.861, F.S. The permittee is placed on notice that the Department will review this permit periodically and may initiate enforcement action for any violation of these conditions.
- (2) This permit is valid only for the specific processes and operations applied for and indicated in the approved drawings or exhibits. Any unauthorized deviation from the approved drawings, exhibits, specifications, or conditions of this permit may constitute grounds for revocation and enforcement action by the Department.
- (3) As provided in Subsections 403.087(7) and 403.722(5), F.S., the issuance of this permit does not convey any vested rights or any exclusive privileges. Neither does it authorize any injury to public or private property or any invasion of personal rights, nor any infringement of federal, state, or local laws or regulations. This permit is not a waiver of or approval of any other Department permit that may be required for other aspects of the total project which are not addressed in this permit.
- (4) This permit conveys no title to land or water, does not constitute State recognition or acknowledgment of title, and does not constitute authority for the use of submerged lands unless herein provided and the necessary title or leasehold interests have been obtained from the State. Only the Trustees of the Internal Improvement Trust Fund may express State opinion as to title.
- (5) This permit does not relieve the permittee from liability for harm or injury to human health or welfare, animal, or plant life, or property caused by the construction or operation of this permitted source, or from penalties therefore; nor does it allow the permittee to cause pollution in contravention of F.S. and Department rules, unless specifically authorized by an order from the Department.
- (6) The permittee shall properly operate and maintain the facility and systems of treatment and control (and related appurtenances) that are installed and used by the permittee to achieve compliance with the conditions of this permit, as required by Department rules. This provision includes the operation of backup or auxiliary facilities or similar systems when necessary to achieve compliance with the conditions of the permit and when required by Department rules.
- (7) The permittee, by accepting this permit, specifically agrees to allow authorized Department personnel, upon presentation of credentials or other documents as may be required by law and at reasonable times, access to the premises where the permitted activity is located or conducted to:
 - (a) Have access to and copy any records that must be kept under conditions of the permit;
 - (b) Inspect the facility, equipment, practices, or operations regulated or required under this permit; and,
 - (c) Sample or monitor any substances or parameters at any location reasonably necessary to assure compliance with this permit or Department rules. Reasonable time may depend on the nature of the concern being investigated.
- (8) If, for any reason, the permittee does not comply with or will be unable to comply with any condition or limitation specified in this permit, the permittee shall immediately provide the Department with the following information: **(also, see Condition No. 10.)**
 - (a) A description of and cause of noncompliance; and,
 - (b) The period of noncompliance, including dates and times; or, if not corrected, the anticipated time the noncompliance is expected to continue, and steps being taken to reduce, eliminate, and prevent recurrence of the noncompliance. The permittee shall be responsible for any and all damages which may result and may be subject to enforcement action by the Department for penalties or for revocation of this permit.
- (9) In accepting this permit, the permittee understands and agrees that all records, notes, monitoring data and other information relating to the construction or operation of this permitted source which are submitted to the Department may be used by the Department as evidence in any enforcement case involving the permitted source arising under the F.S. or Department rules, except where such use is prescribed by Sections 403.111 and 403.73, F.S. Such evidence shall only be used to the extent it is consistent with the Florida Rules of Civil Procedure and appropriate evidentiary rules.
- (10) The permittee agrees to comply with changes in Department rules and F.S. after a reasonable time for compliance; provided, however, the permittee does not waive any other rights granted by F.S. or Department rules.
- (11) This permit is transferable only upon Department approval in accordance with Rule 62-4.120, F.A.C., as applicable. The permittee shall be liable for any non-compliance of the permitted activity until the transfer is approved by the Department.
- (12) This permit or a copy thereof shall be kept at the work site of the permitted activity.
- (14) The permittee shall comply with the following:
 - (a) Upon request, the permittee shall furnish all records and plans required under Department rules. During enforcement actions, the retention period for all records will be extended automatically unless otherwise stipulated by the Department.
 - (b) The permittee shall hold at the facility or other location designated by this permit records of all monitoring information (including all calibration and maintenance records and all original strip chart recordings for continuous monitoring instrumentation) required by the permit, copies of all reports required by this permit, and records of all data used to complete the application for this permit. These materials shall be retained at least five (5) years from the date of the sample, measurement, report, or application unless otherwise specified by Department rule.

(c) Records of monitoring information shall include:

1. the date, exact place, and time of sampling or measurements;
2. the person responsible for performing the sampling or measurements;
3. the dates analyses were performed;
4. the person responsible for performing the analyses;
5. the analytical techniques or methods used;
6. the results of such analyses.

(15) When requested by the Department, the permittee shall within a reasonable time furnish any information required by law which is needed to determine compliance with the permit. If the permittee becomes aware the relevant facts were not submitted or were incorrect in the permit application or in any report to the Department, such facts or information shall be corrected promptly.

[Rules 62-4.160 and 62-213.440(1)(b), F.A.C.]

13. Construction Permits.

(1) No person shall construct any installation or facility which will reasonably be expected to be a source of air or water pollution without first applying for and receiving a construction permit from the Department unless exempted by statute or Department rule. In addition to the requirements of Chapter 62-4, F.A.C., applicants for a Department Construction Permit shall submit the following as applicable:

(a) A completed application on forms furnished by the Department.

(b) An engineering report covering:

1. plant description and operations,
2. types and quantities of all waste material to be generated whether liquid, gaseous or solid,
3. proposed waste control facilities,
4. the treatment objectives,
5. the design criteria on which the control facilities are based, and,
6. other information deemed relevant.

Design criteria submitted pursuant to Rule 62-4.210(1)(b)5., F.A.C., shall be based on the results of laboratory and pilot-plant scale studies whenever such studies are warranted. The design efficiencies of the proposed waste treatment facilities and the quantities and types of pollutants in the treated effluents or emissions shall be indicated. Work of this nature shall be subject to the requirements of Chapter 471, F.S. Where confidential records are involved, certain information may be kept confidential pursuant to Section 403.111, F.S.

(c) The owners' written guarantee to meet the design criteria as accepted by the Department and to abide by Chapter 403, F.S. and the rules of the Department as to the quantities and types of materials to be discharged from the installation. The owner may be required to post an appropriate bond or other equivalent evidence of financial responsibility to guarantee compliance with such conditions in instances where the owner's financial resources are inadequate or proposed control facilities are experimental in nature.

(2) The construction permit may contain conditions and an expiration date as determined by the Secretary or the Secretary's designee.

(3) When the Department issues a permit to construct, the permittee shall be allowed a period of time, specified in the permit, to construct, and to operate and test to determine compliance with Chapter 403, F.S., and the rules of the Department and, where applicable, to apply for and receive an operation permit. The Department may require tests and evaluations of the treatment facilities by the permittee at his/her expense.

[Rule 62-4.210, F.A.C.]

14. **Not federally enforceable.** Operation Permit for New Sources. To properly apply for an operation permit for new sources, the applicant shall submit the appropriate fee and certification that construction was completed noting any deviations from the conditions in the construction permit and test results where appropriate.

[Rule 62-4.220, F.A.C.]

Chapters 28-106 and 62-110, F.A.C.

15. Public Notice, Public Participation, and Proposed Agency Action. The permittee shall comply with all of the requirements for public notice, public participation, and proposed agency action pursuant to Rules 62-110.106 and 62-210.350, F.A.C.

[Rules 62-110.106, 62-210.350 and 62-213.430(1)(b), F.A.C.]

16. Administrative Hearing. The permittee shall comply with all of the requirements for a petition for administrative hearing or waiver of right to administrative proceeding pursuant to Rules 28-106.201, 28-106.301 and 62-110.106, F.A.C.
[Rules 28-106.201, 28-106.301 and 62-110.106, F.A.C.]

Chapter 62-204, F.A.C.

17. Asbestos. This permit does not authorize any demolition or renovation of the facility or its parts or components which involves asbestos removal. This permit does not constitute a waiver of any of the requirements of Chapter 62-257, F.A.C., and 40 CFR 61, Subpart M, National Emission Standard for Asbestos, adopted and incorporated by reference in Rule 62-204.800, F.A.C. Compliance with Chapter 62-257, F.A.C., and 40 CFR 61, Subpart M, Section 61.145, is required for any asbestos demolition or renovation at the source.
[40 CFR 61; Rule 62-204.800, F.A.C.; and, Chapter 62-257, F.A.C.]

Chapter 62-210, F.A.C.

18. Permits Required. The owner or operator of any emissions unit which emits or can reasonably be expected to emit any air pollutant shall obtain an appropriate permit from the Department prior to beginning construction, modification, or initial or continued operation of the emissions unit unless exempted pursuant to Department rule or statute. All emissions limitations, controls, and other requirements imposed by such permits shall be at least as stringent as any applicable limitations and requirements contained in or enforceable under the State Implementation Plan (SIP) or that are otherwise federally enforceable. Except as provided at Rule 62-213.460, F.A.C., issuance of a permit does not relieve the owner or operator of an emissions unit from complying with any applicable requirements, any emission limiting standards or other requirements of the air pollution rules of the Department or any other such requirements under federal, state, or local law.

(1) Air Construction Permits.

(a) Unless exempt from permitting pursuant to Rule 62-210.300(3)(a) or (b), F.A.C., or Rule 62-4.040, F.A.C., an air construction permit shall be obtained by the owner or operator of any proposed new or modified facility or emissions unit prior to the beginning of construction or modification, in accordance with all applicable provisions of Chapter 62-210, F.A.C., Chapter 62-212, F.A.C., and Chapter 62-4, F.A.C. Except as provided under Rule 62-213.415, F.A.C., the owner or operator of any facility seeking to create or change an air emissions bubble shall obtain an air construction permit in accordance with all the applicable provisions of Chapter 62-210, F.A.C., Chapter 62-212, F.A.C., and Chapter 62-4, F.A.C. The construction permit shall be issued for a period of time sufficient to allow construction or modification of the facility or emissions unit and operation while the new or modified facility or emissions unit is conducting tests or otherwise demonstrating initial compliance with the conditions of the construction permit.

(b) Notwithstanding the expiration of an air construction permit, all limitations and requirements of such permit that are applicable to the design and operation of the permitted facility or emissions unit shall remain in effect until the facility or emissions unit is permanently shut down, except for any such limitation or requirement that is obsolete by its nature (such as a requirement for initial compliance testing) or any such limitation or requirement that is changed in accordance with the provisions of Rule 62-210.300(1)(b)1., F.A.C. Either the applicant or the Department can propose that certain conditions be considered obsolete. Any conditions or language in an air construction permit that are included for informational purposes only, if they are transferred to the air operation permit, shall be transferred for informational purposes only and shall not become enforceable conditions unless voluntarily agreed to by the permittee or otherwise required under Department rules.

1. Except for those limitations or requirements that are obsolete, all limitations and requirements of an air construction permit shall be included and identified in any air operation permit for the facility or emissions unit. The limitations and requirements included in the air operation permit can be changed, and thereby superseded, through the issuance of an air construction permit, federally enforceable state air operation permit, federally enforceable air general permit, or Title V air operation permit; provided, however, that:

- a. Any change that would constitute an administrative correction may be made pursuant to Rule 62-210.360, F.A.C.;
- b. Any change that would constitute a modification, as defined at Rule 62-210.200, F.A.C., shall be accomplished only through the issuance of an air construction permit; and
- c. Any change in a permit limitation or requirement that originates from a permit issued pursuant to 40 CFR 52.21, Rule 62-204.800(10)(d)2., F.A.C., Rule 62-212.400, F.A.C., Rule 62-212.500, F.A.C., or any former codification of Rule 62-212.400 or Rule 62-212.500, F.A.C., shall be accomplished only through the issuance of a new or revised air construction permit under Rule 62-204.800(10)(d)2., Rule 62-212.400, or Rule 62-212.500, F.A.C., as appropriate.

2. The force and effect of any change in a permit limitation or requirement made in accordance with the provisions of Rule 62-210.300(1)(b)1., F.A.C., shall be the same as if such change were made to the original air construction permit.
3. Nothing in Rule 62-210.300(1)(b), F.A.C., shall be construed as to allow operation of a facility or emissions unit without a valid air operation permit.

(2) Air Operation Permits. Upon expiration of the air operation permit for any existing facility or emissions unit, subsequent to construction or modification, or subsequent to the creation of or change to a bubble, and demonstration of compliance with the conditions of the construction permit for any new or modified facility or emissions unit, any air emissions bubble, or as otherwise provided in Chapter 62-210, F.A.C., or Chapter 62-213, F.A.C., the owner or operator of such facility or emissions unit shall obtain a renewal air operation permit, an initial air operation permit or general permit, or an administrative correction or revision of an existing air operation permit, whichever is appropriate, in accordance with all applicable provisions of Chapter 62-210, F.A.C., Chapter 62-213, F.A.C., and Chapter 62-4, F.A.C.

(a) Minimum Requirements for All Air Operation Permits. At a minimum, a permit issued pursuant to this subsection shall:

1. Specify the manner, nature, volume and frequency of the emissions permitted, and the applicable emission limiting standards or performance standards, if any;
2. Require proper operation and maintenance of any pollution control equipment by qualified personnel, where applicable in accordance with the provisions of any operation and maintenance plan required by the air pollution rules of the Department.
3. Contain an effective date stated in the permit which shall not be earlier than the date final action is taken on the application and be issued for a period, beginning on the effective date, as provided below.
 - a. The operation permit for an emissions unit which is in compliance with all applicable rules and in operational condition, and which the owner or operator intends to continue operating, shall be issued or renewed for a five-year period, except that, for Title V sources subject to Rule 62-213.420(1)(a)1., F.A.C., operation permits shall be extended until 60 days after the due date for submittal of the facility's Title V permit application as specified in Rule 62-213.420(1)(a)1., F.A.C.
 - b. Except as provided in Rule 62-210.300(2)(a)3.d., F.A.C., the operation permit for an emissions unit which has been shut down for six months or more prior to the expiration date of the current operation permit, shall be renewed for a period not to exceed five years from the date of shutdown, even if the emissions unit is not maintained in operational condition, provided:
 - (i) the owner or operator of the emissions unit demonstrates to the Department that the emissions unit may need to be reactivated and used, or that it is the owner's or operator's intent to apply to the Department for a permit to construct a new emissions unit at the facility before the end of the extension period; and,
 - (ii) the owner or operator of the emissions unit agrees to and is legally prohibited from providing the allowable emission permitted by the renewed permit as an emissions offset to any other person under Rule 62-212.500, F.A.C.; and,
 - (iii) the emissions unit was operating in compliance with all applicable rules as of the time the source was shut down.
 - c. Except as provided in Rule 62-210.300(2)(a)3.d., F.A.C., the operation permit for an emissions unit which has been shut down for five years or more prior to the expiration date of the current operation permit shall be renewed for a maximum period not to exceed ten years from the date of shutdown, even if the emissions unit is not maintained in operational condition, provided the conditions given in Rule 62-210.300(2)(a)3.b., F.A.C., are met and the owner or operator demonstrates to the Department that failure to renew the permit would constitute a hardship, which may include economic hardship.
 - d. The operation permit for an electric utility generating unit on cold standby or long-term reserve shutdown shall be renewed for a five-year period, and additional five-year periods, even if the unit is not maintained in operational condition, provided the conditions given in Rules 62-210.300(2)(a)3.b.(i) through (iii), F.A.C., are met.
4. In the case of an emissions unit permitted pursuant to Rules 62-210.300(2)(a)3.b., c., and d., F.A.C., include reasonable notification and compliance testing requirements for reactivation of such emissions unit and provide that the owner or operator demonstrate to the Department prior to reactivation that such reactivation would not constitute reconstruction pursuant to Rule 62-204.800(7), F.A.C.

[Rules 62-210.300(1) & (2), F.A.C.]

19. **Not federally enforceable. Notification of Startup.** The owner or operator of any emissions unit or facility which has a valid air operation permit which has been shut down more than one year, shall notify the Department in writing of the intent to start up such emissions unit or facility, a minimum of 60 days prior to the intended startup date.

- (a) The notification shall include information as to the startup date, anticipated emission rates or pollutants released, changes to processes or control devices which will result in changes to emission rates, and any other conditions which may differ from the valid outstanding operation permit.

(b) If, due to an emergency, a startup date is not known 60 days prior thereto, the owner shall notify the Department as soon as possible after the date of such startup is ascertained.

[Rule 62-210.300(5), F.A.C.]

20. Emissions Unit Reclassification.

(a) Any emissions unit whose operation permit has been revoked as provided for in Chapter 62-4, F.A.C., shall be deemed permanently shut down for purposes of Rule 62-212.500, F.A.C. Any emissions unit whose permit to operate has expired without timely renewal or transfer may be deemed permanently shut down, provided, however, that no such emissions unit shall be deemed permanently shut down if, within 20 days after receipt of written notice from the Department, the emissions unit owner or operator demonstrates that the permit expiration resulted from inadvertent failure to comply with the requirements of Rule 62-4.090, F.A.C., and that the owner or operator intends to continue the emissions unit in operation, and either submits an application for an air operation permit or complies with permit transfer requirements, if applicable.

(b) If the owner or operator of an emissions unit which is so permanently shut down, applies to the Department for a permit to reactivate or operate such emissions unit, the emissions unit will be reviewed and permitted as a new emissions unit.

[Rule 62-210.300(6), F.A.C.]

21. Transfer of Air Permits.

(a) An air permit is transferable only after submission of an Application for Transfer of Air Permit (DEP Form 62-210.900(7)) and Department approval in accordance with Rule 62-4.120, F.A.C. For Title V permit transfers only, a complete application for transfer of air permit shall include the requirements of 40 CFR 70.7(d)(1)(iv), adopted and incorporated by reference at Rule 62-204.800, F.A.C. Within 30 days after approval of the transfer of permit, the Department shall update the permit by an administrative permit correction pursuant to Rule 62-210.360, F.A.C.

(b) For an air general permit, the provision of Rules 62-210.300(7)(a) and 62-4.120, F.A.C., do not apply. Thirty (30) days before using an air general permit, the new owner must submit an air general permit notification to the Department in accordance with Rule 62-210.300(4), F.A.C., or Rule 62-213.300(2)(b), F.A.C.

[Rule 62-210.300(7), F.A.C.]

22. Public Notice and Comment.

(1) Public Notice of Proposed Agency Action.

(a) A notice of proposed agency action on permit application, where the proposed agency action is to issue the permit, shall be published by any applicant for:

1. An air construction permit;
2. An air operation permit, permit renewal or permit revision subject to Rule 62-210.300(2)(b), F.A.C., (i.e., a FESOP), except as provided in Rule 62-210.300(2)(b)1.b., F.A.C.; or
3. An air operation permit, permit renewal, or permit revision subject to Chapter 62-213, F.A.C., except Title V air general permits or those permit revisions meeting the requirements of Rule 62-213.412(1), F.A.C.

(b) The notice required by Rule 62-210.350(1)(a), F.A.C., shall be published in accordance with all otherwise applicable provisions of Rule 62-110.106, F.A.C. A public notice under Rule 62-210.350(1)(a)1., F.A.C., for an air construction permit may be combined with any required public notice under Rule 62-210.350(1)(a)2. or 3., F.A.C., for air operation permits. If such notices are combined, the public notice must comply with the requirements for both notices.

(c) Except as otherwise provided at Rules 62-210.350(2) and (5), F.A.C., each notice of intent to issue an air construction permit shall provide a 14-day period for submittal of public comments.

(2) Additional Public Notice Requirements for Emissions Units Subject to Prevention of Significant Deterioration or Nonattainment - Area Preconstruction Review.

(a) Before taking final agency action on a construction permit application for any proposed new or modified facility or emissions unit subject to the preconstruction review requirements of Rule 62-212.400 or 62-212.500, F.A.C., the Department shall comply with all applicable provisions of Rule 62-110.106, F.A.C., and provide an opportunity for public comment which shall include as a minimum the following:

1. A complete file available for public inspection in at least one location in the district affected which includes the information submitted by the owner or operator, exclusive of confidential records under Section 403.111, F.S., and the Department's analysis of the effect of the proposed construction or modification on ambient air quality, including the Department's preliminary determination of whether the permit should be approved or disapproved;
2. A 30-day period for submittal of public comments; and,

3. A notice, by advertisement in a newspaper of general circulation in the county affected, specifying the nature and location of the proposed facility or emissions unit, whether BACT or LAER has been determined, the degree of PSD increment consumption expected, if applicable, and the location of the information specified in paragraph 1. above; and, notifying the public of the opportunity for submitting comments and requesting a public hearing.
- (b) The notice provided for in Rule 62-210.350(2)(a)3., F.A.C., shall be prepared by the Department and published by the applicant in accordance with all applicable provisions of Rule 62-110.106, F.A.C., except that the applicant shall cause the notice to be published no later than thirty (30) days prior to final agency action.
- (c) A copy of the notice provided for in Rule 62-210.350(2)(a)3., F.A.C., shall also be sent by the Department to the Regional Office of the U. S. Environmental Protection Agency and to all other state and local officials or agencies having cognizance over the location of such new or modified facility or emissions unit, including local air pollution control agencies, chief executives of city or county government, regional land use planning agencies, and any other state, Federal Land Manager, or Indian Governing Body whose lands may be affected by emissions from the new or modified facility or emissions unit.
- (d) A copy of the notice provided for in Rule 62-210.350(2)(a)3., F.A.C., shall be displayed in the appropriate district, branch and local program offices.
- (e) An opportunity for public hearing shall be provided in accordance with Chapter 120, F.S., and Rule 62-110.106, F.A.C.
- (f) Any public comments received shall be made available for public inspection in the location where the information specified in Rule 62-210.350(2)(a)1., F.A.C., is available and shall be considered by the Department in making a final determination to approve or deny the permit.
- (g) The final determination shall be made available for public inspection at the same location where the information specified in Rule 62-210.350(2)(a)1., F.A.C., was made available.
- (h) For a proposed new or modified emissions unit which would be located within 100 kilometers of any Federal Class I area or whose emissions may affect any Federal Class I area, and which would be subject to the preconstruction review requirements of Rule 62-212.400, F.A.C., or Rule 62-212.500, F.A.C.:
1. The Department shall mail or transmit to the Administrator a copy of the initial application for an air construction permit and notice of every action related to the consideration of the permit application.
 2. The Department shall mail or transmit to the Federal Land Manager of each affected Class I area a copy of any written notice of intent to apply for an air construction permit; the initial application for an air construction permit, including all required analyses and demonstrations; any subsequently submitted information related to the application; the preliminary determination and notice of proposed agency action on the permit application; and any petition for an administrative hearing regarding the application or the Department's proposed action. Each such document shall be mailed or transmitted to the Federal Land Manager within fourteen (14) days after its receipt by the Department.
- (3) Additional Public Notice Requirements for Facilities Subject to Operation Permits for Title V Sources.
- (a) Before taking final agency action to issue a new, renewed, or revised air operation permit subject to Chapter 62-213, F.A.C., the Department shall comply with all applicable provisions of Rule 62-110.106, F.A.C., and provide an opportunity for public comment which shall include as a minimum the following:
1. A complete file available for public inspection in at least one location in the district affected which includes the information submitted by the owner or operator, exclusive of confidential records under Section 403.111, F.S.; and,
 2. A 30-day period for submittal of public comments.
- (b) The notice provided for in Rule 62-210.350(3)(a), F.A.C., shall be prepared by the Department and published by the applicant in accordance with all applicable provisions of Rule 62-110.106, F.A.C., except that the applicant shall cause the notice to be published no later than thirty (30) days prior to final agency action. If written comments received during the 30-day comment period on a draft permit result in the Department's issuance of a revised draft permit in accordance with Rule 62-213.430(1), F.A.C., the Department shall require the applicant to publish another public notice in accordance with Rule 62-210.350(1)(a), F.A.C.
- (c) The notice shall identify:
1. The facility;
 2. The name and address of the office at which processing of the permit occurs;
 3. The activity or activities involved in the permit action;
 4. The emissions change involved in any permit revision;
 5. The name, address, and telephone number of a Department representative from whom interested persons may obtain additional information, including copies of the permit draft, the application, and all relevant supporting materials, including any permit application, compliance plan, permit, monitoring report, and compliance statement required pursuant to Chapter 62-213, F.A.C. (except for information entitled to confidential treatment pursuant to Section 403.111, F.S.), and all other materials available to the Department that are relevant to the permit decision;

6. A brief description of the comment procedures required by Rule 62-210.350(3), F.A.C.;
7. The time and place of any hearing that may be held, including a statement of procedure to request a hearing (unless a hearing has already been scheduled); and,
8. The procedures by which persons may petition the Administrator to object to the issuance of the proposed permit after expiration of the Administrator's 45-day review period.

[Rule 62-210.350, F.A.C.]

23. Administrative Permit Corrections.

- (1) A facility owner shall notify the Department by letter of minor corrections to information contained in a permit. Such notifications shall include:
 - (a) Typographical errors noted in the permit;
 - (b) Name, address or phone number change from that in the permit;
 - (c) A change requiring more frequent monitoring or reporting by the permittee;
 - (d) A change in ownership or operational control of a facility, subject to the following provisions:
 1. The Department determines that no other change in the permit is necessary;
 2. The permittee and proposed new permittee have submitted an Application for Transfer of Air Permit, and the Department has approved the transfer pursuant to Rule 62-210.300(7), F.A.C.; and
 3. The new permittee has notified the Department of the effective date of sale or legal transfer.
 - (e) Changes listed at 40 CFR 72.83(a)(1), (2), (6), (9) and (10), adopted and incorporated by reference at Rule 62-204.800, F.A.C., and changes made pursuant to Rules 62-214.340(1) and (2), F.A.C., to Title V sources subject to emissions limitations or reductions pursuant to 42 USC ss. 7651-7651o;
 - (f) Changes listed at 40 CFR 72.83(a)(11) and (12), adopted and incorporated by reference at Rule 62-204.800, F.A.C., to Title V sources subject to emissions limitations or reductions pursuant to 42 USC ss. 7651-7651o, provided the notification is accompanied by a copy of any EPA determination concerning the similarity of the change to those listed at Rule 62-210.360(1)(e), F.A.C.; and,
 - (g) Any other similar minor administrative change at the source.
- (2) Upon receipt of any such notification the Department shall within 60 days correct the permit and provide a corrected copy to the owner.
- (3) After first notifying the owner, the Department shall correct any permit in which it discovers errors of the types listed at Rules 62-210.360(1)(a) and (b), F.A.C., and provide a corrected copy to the owner.
- (4) For Title V source permits, other than general permits, a copy of the corrected permit shall be provided to EPA and any approved local air program in the county where the facility or any part of the facility is located.
- (5) The Department shall incorporate requirements resulting from issuance of a new or revised construction permit into an existing Title V source permit, if the construction permit or permit revision incorporates requirements of federally enforceable preconstruction review, and if the applicant requests at the time of application that all of the requirements of Rule 62-213.430(1), F.A.C., be complied with in conjunction with the processing of the construction permit application.

[Rule 62-210.360, F.A.C.]

24. Reports.

- (3) Annual Operating Report for Air Pollutant Emitting Facility.
 - (a) The Annual Operating Report for Air Pollutant Emitting Facility (DEP Form No. 62-210.900(5)) shall be completed each year.
 - (c) The annual operating report shall be submitted to the appropriate Department District or Department approved local air pollution control program office by March 1 of the following year unless otherwise indicated by permit condition or Department request.

[Rule 62-210.370(3), F.A.C.]

25. Circumvention. No person shall circumvent any air pollution control device, or allow the emission of air pollutants without the applicable air pollution control device operating properly.

[Rule 62-210.650, F.A.C.]

26. Forms and Instructions. The forms used by the Department in the stationary source control program are adopted and incorporated by reference in this section. The forms are listed by rule number, which is also the form number, with the subject, title and effective date. Forms 62-210.900(1),(3),(4) and (5), F.A.C., including instructions, are available from the Department as hard-copy documents or executable files on computer diskettes. Copies of forms (hard-copy or diskette) may be obtained by writing to the Department of Environmental Protection, Division of Air Resource Management, 2600 Blair Stone Road, Tallahassee, Florida 32399-2400. Notwithstanding the requirement of Rule 62-4.050(2), F.A.C., to file application forms in quadruplicate, if an air permit application is submitted using the Department's electronic application form, only one copy of the diskette and signature pages is required to be submitted.

(1) Application for Air Permit - Title V Source, Form and Instructions (Effective 02/11/1999).

(a) Acid Rain Part (Phase II), Form and Instructions (Effective 04/16/2001).

1. Repowering Extension Plan, Form and Instructions (Effective 07/01/1995).

2. New Unit Exemption, Form and Instructions (Effective 04/16/2001).

3. Retired Unit Exemption, Form and Instructions (Effective 04/16/2001).

4. Phase II NOx Compliance Plan, Form and Instructions (Effective 01/06/1998).

5. Phase II NOx Averaging Plan, Form (Effective 01/06/1998).

(b) Reserved.

(5) Annual Operating Report for Air Pollutant Emitting Facility, Form and Instructions (Effective 02/11/1999).

(7) Application for Transfer of Air Permit – Title V and Non-Title V Source, (Effective 04/16/2001).

[Rule 62-210.900, F.A.C.]

Chapter 62-213, F.A.C.

27. Annual Emissions Fee. Each Title V source permitted to operate in Florida must pay between January 15 and March 1 of each year, upon written notice from the Department, an annual emissions fee in an amount determined as set forth in Rule 62-213.205(1), F.A.C.

[Rules 62-213.205 and 62-213.900(1), F.A.C.]

28. Annual Emissions Fee. Failure to pay timely any required annual emissions fee, penalty, or interest constitutes grounds for permit revocation pursuant to Rule 62-4.100, F.A.C.

[Rule 62-213.205(1)(g), F.A.C.]

29. Annual Emissions Fee. Any documentation of actual hours of operation, actual material or heat input, actual production amount, or actual emissions used to calculate the annual emissions fee shall be retained by the owner for a minimum of five (5) years and shall be made available to the Department upon request.

[Rule 62-213.205(1)(i), F.A.C.]

30. Annual Emissions Fee. A completed DEP Form 62-213.900(1), F.A.C., "Major Air Pollution Source Annual Emissions Fee Form", must be submitted by the responsible official with the annual emissions fee.

[Rule 62-213.205(1)(j), F.A.C.]

31. Air Operation Permit Fees. No permit application processing fee, renewal fee, modification fee or amendment fee is required for an operation permit for a Title V source.

[Rule 62-213.205(4), F.A.C.]

32. Permits and Permit Revisions Required. All Title V sources are subject to the permit requirements of Chapter 62-213, F.A.C.

(1) No Title V source may operate except in compliance with Chapter 62-213, F.A.C.

(2) Except as provided in Rule 62-213.410, F.A.C., no source with a permit issued under the provisions of this chapter shall make any changes in its operation without first applying for and receiving a permit revision if the change meets any of the following:

(a) Constitutes a modification;

(b) Violates any applicable requirement;

(c) Exceeds the allowable emissions of any air pollutant from any unit within the source;

(d) Contravenes any permit term or condition for monitoring, testing, recordkeeping, reporting or of a compliance certification requirement;

(e) Requires a case-by-case determination of an emission limitation or other standard or a source specific determination of ambient impacts, or a visibility or increment analysis under the provisions of Chapters 62-212 or 62-296, F.A.C.;

(f) Violates a permit term or condition which the source has assumed for which there is no corresponding underlying applicable requirement to which the source would otherwise be subject;

(g) Results in the trading of emissions among units within a source except as specifically authorized pursuant to Rule 62-213.415, F.A.C.;

- (h) Results in the change of location of any relocatable facility identified as a Title V source pursuant to paragraph (a)-(e), (g) or (h) of the definition of "major source of air pollution" at Rule 62-210.200, F.A.C.;
- (i) Constitutes a change at an Acid Rain Source under the provisions of 40 CFR 72.81(a)(1),(2),or (3),(b)(1) or (b)(3), hereby incorporated by reference;
- (j) Constitutes a change in a repowering plan, nitrogen oxides averaging plan, or nitrogen oxides compliance deadline extension at an Acid Rain Source;
- (k) Is a request for industrial-utility unit exemption pursuant to Rule 62-214.340, F.A.C.

[Rules 62-213.400(1) & (2), F.A.C.]

33. Changes Without Permit Revision. Title V sources having a valid permit issued pursuant to Chapter 62-213, F.A.C., may make the following changes without permit revision, provided that sources shall maintain source logs or records to verify periods of operation in each alternative method of operation:

- (1) Permitted sources may change among those alternative methods of operation allowed by the source's permit as provided by the terms of the permit;
- (2) Permitted sources may implement the terms or conditions of a new or revised construction permit if;
 - (a) The application for construction permit complied with the requirements of Rule 62-213.420(3) and (4), F.A.C.;
 - (b) The terms or conditions were subject to federally enforceable preconstruction review pursuant to Chapter 62-212, F.A.C.; and,
 - (c) The new or revised construction permit was issued after the Department and the applicant complied with all the requirements of Rule 62-213.430(1), F.A.C.;
- (3) A permitted source may implement operating changes, as defined in Rule 62-210.200, F.A.C., after the source submits any forms required by any applicable requirement and provides the Department and EPA with at least 7 days written notice prior to implementation. The source and the Department shall attach each notice to the relevant permit;
 - (a) The written notice shall include the date on which the change will occur, and a description of the change within the permitted source, the pollutants emitted and any change in emissions, and any term or condition becoming applicable or no longer applicable as a result of the change;
 - (b) The permit shield described in Rule 62-213.460, F.A.C., shall not apply to such changes;
- (4) Permitted sources may implement changes involving modes of operation only in accordance with Rule 62-213.415, F.A.C.

[Rule 62-213.410, F.A.C.]

34. Immediate Implementation Pending Revision Process.

- (1) Those permitted Title V sources making any change that constitutes a modification pursuant to the definition of modification at Rule 62-210.200, F.A.C., but which would not constitute a modification pursuant to 42 USC 7412(a) or to 40 CFR 52.01, 60.2, or 61.15, adopted and incorporated by reference at Rule 62-204.800, F.A.C., may implement such change prior to final issuance of a permit revision in accordance with this section, provided the change:
 - (a) Does not violate any applicable requirement;
 - (b) Does not contravene any permit term or condition for monitoring, testing, recordkeeping or reporting, or any compliance certification requirement;
 - (c) Does not require or change a case-by-case determination of an emission limitation or other standard, or a source-specific determination of ambient impacts, or a visibility or increment analysis under the provisions of Chapter 62-212 or 62-296, F.A.C.;
 - (d) Does not seek to establish or change a permit term or condition for which there is no corresponding underlying applicable requirement and which the source has assumed to avoid an applicable requirement to which the source would otherwise be subject including any federally enforceable emissions cap or federally enforceable alternative emissions limit.
- (2) A Title V source may immediately implement such changes after they have been incorporated into the terms and conditions of a new or revised construction permit issued pursuant to Chapter 62-212, F.A.C., and after the source provides to EPA, the Department, each affected state and any approved local air program having geographic jurisdiction over the source, a copy of the source's application for operation permit revision. The Title V source may conform its application for construction permit to include all information required by Rule 62-213.420, F.A.C., in lieu of submitting separate application forms.

(3) The Department shall process the application for operation permit revision in accordance with the provisions of Chapter 62-213, F.A.C., except that the Department shall issue a draft permit revision or a determination to deny the revision within 60 days of receipt of a complete application for operation permit revision or, if the Title V source has submitted a construction permit application conforming to the requirements of Rule 62-213.420, F.A.C., the Department shall issue a draft permit or a determination to deny the revision at the same time the Department issues its determination on issuance or denial of the construction permit application. The Department shall not take final action until all the requirements of Rules 62-213.430(1)(a), (c), (d), and (e), F.A.C., have been complied with.

(4) Pending final action on the operation permit revision application, the source shall implement the changes in accordance with the terms and conditions of the source's new or revised construction permit.

(5) The permit shield described in Rule 62-213.460, F.A.C., shall not apply to such changes until after the Department takes final action to issue the operation permit revision.

(6) If the Department denies the source's application for operation permit revision, the source shall cease implementation of the proposed changes.

[Rule 62-213.412, F.A.C.]

35. Permit Applications.

(1) **Duty to Apply.** For each Title V source, the owner or operator shall submit a timely and complete permit application in compliance with the requirements of Rules 62-213.420, F.A.C., and Rules 62-4.050(1) through (3), F.A.C.

(a) Timely Application.

3. For purposes of permit renewal, a timely application is one that is submitted in accordance with Rule 62-4.090, F.A.C.

(b) Complete Application.

1. Any applicant for a Title V permit, permit revision or permit renewal must submit an application on DEP Form No. 62-210.900(1), which must include all the information specified by Rule 62-213.420(3), F.A.C., except that an application for permit revision must contain only that information related to the proposed change. The applicant shall include information concerning fugitive emissions and stack emissions in the application. Each application for permit, permit revision or permit renewal shall be certified by a responsible official in accordance with Rule 62-213.420(4), F.A.C.

2. For those applicants submitting initial permit applications pursuant to Rule 62-213.420(1)(a)1., F.A.C., a complete application shall be an application that substantially addresses all the information required by the application form number 62-210.900(1), and such applications shall be deemed complete within sixty days of receipt of a signed and certified application unless the Department notifies the applicant of incompleteness within that time. For all other applicants, the applications shall be deemed complete sixty days after receipt, unless the Department, within sixty days after receipt of a signed application for permit, permit revision or permit renewal, requests additional documentation or information needed to process the application. An applicant making timely and complete application for permit, or timely application for permit renewal as described by Rule 62-4.090(1), F.A.C., shall continue to operate the source under the authority and provisions of any existing valid permit or Florida Electrical Power Plant Siting Certification, and in accordance with applicable requirements of the Acid Rain Program, until the conclusion of proceedings associated with its permit application or until the new permit becomes effective, whichever is later, provided the applicant complies with all the provisions of Rules 62-213.420(1)(b)3. and 4. F.A.C. Failure of the Department to request additional information within sixty days of receipt of a properly signed application shall not impair the Department's ability to request additional information pursuant to Rules 62-213.420(1)(b)3. and 4., F.A.C.

3. For those permit applications submitted pursuant to the provisions of Rule 62-213.420(1)(a)1., F.A.C., the Department shall notify the applicant if the Department becomes aware at any time during processing of the application that the application contains incorrect or incomplete information. The applicant shall submit the corrected or supplementary information to the Department within ninety days unless the applicant has requested and been granted additional time to submit the information. Failure of an applicant to submit corrected or supplementary information requested by the Department within ninety days or such additional time as requested and granted shall render the application incomplete.

4. For all applications other than those addressed at Rule 62-213.420(1)(b)3., F.A.C., should the Department become aware, during processing of any application that the application contains incorrect information, or should the Department become aware, as a result of comment from an affected State, an approved local air program, EPA, or the public that additional information is needed to evaluate the application, the Department shall notify the applicant within 30 days. When an applicant becomes aware that an application contains incorrect or incomplete information, the applicant shall submit the corrected or supplementary information to the Department. If the Department notifies an applicant that corrected or supplementary information is necessary to process the permit, and requests a response, the applicant shall provide the information to the Department within ninety days of the Department request unless the applicant has requested

and been granted additional time to submit the information or, the applicant shall, within ninety days, submit a written request that the Department process the application without the information. Failure of an applicant to submit corrected or supplementary information requested by the Department within ninety days, or such additional time as requested and granted, or to demand in writing within ninety days that the application be processed without the information shall render the application incomplete. Nothing in this section shall limit any other remedies available to the Department.

[Rules 62-213.420(1)(a)3. and 62-213.420(1)(b)1., 2., 3. & 4., F.A.C.]

36. Confidential Information. Whenever an applicant submits information under a claim of confidentiality pursuant to Section 403.111, F.S., the applicant shall also submit a copy of all such information and claim directly to EPA. (also, see Condition No. 50.)

[Rule 62-213.420(2), F.A.C.]

37. Standard Application Form and Required Information. Applications shall be submitted under Chapter 62-213, F.A.C., on forms provided by the Department and adopted by reference in Rule 62-210.900(1), F.A.C. The information as described in Rule 62-210.900(1), F.A.C., shall be included for the Title V source and each emissions unit. An application must include information sufficient to determine all applicable requirements for the Title V source and each emissions unit and to evaluate a fee amount pursuant to Rule 62-213.205, F.A.C.

[Rule 62-213.420(3), F.A.C.]

38. a. Permit Renewal and Expiration. Permits being renewed are subject to the same requirements that apply to permit issuance at the time of application for renewal. Permit renewal applications shall contain that information identified in Rules 62-210.900(1) and 62-213.420(3), F.A.C. Unless a Title V source submits a timely application for permit renewal in accordance with the requirements of Rule 62-4.090(1), F.A.C., the existing permit shall expire and the source's right to operate shall terminate. No Title V permit will be issued for a new term except through the renewal process.

b. Permit Revision Procedures. Permit revisions shall meet all requirements of Chapter 62-213, F.A.C., including those for content of applications, public participation, review by approved local programs and affected states, and review by EPA, as they apply to permit issuance and permit renewal, except that permit revisions for those activities implemented pursuant to Rule 62-213.412, F.A.C., need not meet the requirements of Rule 62-213.430(1)(b), F.A.C. The Department shall require permit revision in accordance with the provisions of Rule 62-4.080, F.A.C., and 40 CFR 70.7(f), whenever any source becomes subject to any condition listed at 40 CFR 70.7(f)(1), hereby adopted and incorporated by reference. The below requirements from 40 CFR 70.7(f) are adopted and incorporated by reference in Rule 62-213.430(4), F.A.C.:

o 40 CFR 70.7(f): Reopening for Cause. (also, see Condition No. 4.)

(1) This section contains provisions from 40 CFR 70.7(f) that specify the conditions under which a Title V permit shall be reopened prior to the expiration of the permit. A Title V permit shall be reopened and revised under any of the following circumstances:

(i) Additional applicable requirements under the Act become applicable to a major Part 70 source with a remaining permit term of 3 or more years. Such a reopening shall be completed not later than 18 months after promulgation of the applicable requirement. No such reopening is required if the effective date of the requirement is later than the date on which the permit is due to expire, unless the original permit or any of its terms and conditions has been extended pursuant to 40 CFR 70.4(b)(10)(i) or (ii).

(ii) Additional requirements (including excess emissions requirements) become applicable to an affected source under the acid rain program. Upon approved by the Administrator, excess emissions offset plans shall be deemed to be incorporated into the permit.

(iii) The permitting authority or EPA determines that the permit contains a material mistake or that inaccurate statements were made in establishing the emissions standards or other terms or conditions of the permit.

(iv) The Administrator or the permitting authority determines that the permit must be revised or revoked to assure compliance with the applicable requirements.

(2) Proceedings to reopen and issue a permit shall follow the same procedures as apply to initial permit issuance and shall affect only those parts of the permit for which cause to reopen exists. Such reopening shall be made as expeditiously as practicable.

(3) Reopenings under 40 CFR 70.7(f)(1) shall not be initiated before a notice of such intent is provided to the Part 70 source by the permitting authority at least 30 days in advance of the date that the permit is to be reopened, except that the permitting authority may provide a shorter time period in the case of an emergency.

[Rules 62-213.430(3) & (4), F.A.C.; and, 40 CFR 70.7(f)]

39. Insignificant Emissions Units or Pollutant-Emitting Activities.

(a) All requests for determination of insignificant emissions units or activities made pursuant to Rule 62-213.420(3)(m), F.A.C., shall be processed in conjunction with the permit, permit renewal or permit revision application submitted pursuant to Chapter 62-213, F.A.C. Insignificant emissions units or activities shall be approved by the Department consistent with the provisions of Rule 62-4.040(1)(b), F.A.C. Emissions units or activities which are added to a Title V source after issuance of a permit under Chapter 62-213, F.A.C., shall be incorporated into the permit at its next renewal, provided such emissions units or activities have been exempted from the requirement to obtain an air construction permit and also qualify as insignificant pursuant to Rule 62-213.430(6), F.A.C.

(b) An emissions unit or activity shall be considered insignificant if all of the following criteria are met:

1. Such unit or activity would be subject to no unit-specific applicable requirement;
2. Such unit or activity, in combination with other units or activities proposed as insignificant, would not cause the facility to exceed any major source threshold(s) as defined in Rule 62-213.420(3)(c)1., F.A.C., unless it is acknowledged in the permit application that such units or activities would cause the facility to exceed such threshold(s);
3. Such unit or activity would not emit or have the potential to emit:
 - a. 500 pounds per year or more of lead and lead compounds expressed as lead;
 - b. 1,000 pounds per year or more of any hazardous air pollutant;
 - c. 2,500 pounds per year or more of total hazardous air pollutants; or
 - d. 5.0 tons per year or more of any other regulated pollutant.

[Rule 62-213.430(6), F.A.C.]

40. Permit Duration. Permits for sources subject to the Federal Acid Rain Program shall be issued for terms of five years, provided that the initial Acid Rain Part may be issued for a term less than five years where necessary to coordinate the term of such part with the term of a Title V permit to be issued to the source. Operation permits for Title V sources may not be extended as provided in Rule 62-4.080(3), F.A.C., if such extension will result in a permit term greater than five years.

[Rule 62-213.440(1)(a), F.A.C.]

41. Monitoring Information. All records of monitoring information shall specify the date, place, and time of sampling or measurement and the operating conditions at the time of sampling or measurement, the date(s) analyses were performed, the company or entity that performed the analyses, the analytical techniques or methods used, and the results of such analyses.

[Rule 62-213.440(1)(b)2.a., F.A.C.]

42. Retention of Records. Retention of records of all monitoring data and support information shall be for a period of at least 5 years from the date of the monitoring sample, measurement, report, or application. Support information includes all calibration and maintenance records and all original strip-chart recordings for continuous monitoring instrumentation, and copies of all reports required by the permit.

[Rule 62-213.440(1)(b)2.b., F.A.C.]

43. Monitoring Reports. The permittee shall submit reports of any required monitoring at least every six (6) months. All instances of deviations from permit requirements must be clearly identified in such reports.

[Rule 62-213.440(1)(b)3.a., F.A.C.]

44. Deviation from Permit Requirements Reports. The permittee shall report in accordance with the requirements of Rules 62-210.700(6) and 62-4.130, F.A.C., deviations from permit requirements, including those attributable to upset conditions as defined in the permit. Reports shall include the probable cause of such deviations, and any corrective actions or preventive measures taken.

[Rule 62-213.440(1)(b)3.b., F.A.C.]

45. Reports. All reports shall be accompanied by a certification by a responsible official, pursuant to Rule 62-213.420(4), F.A.C.

[Rule 62-213.440(1)(b)3.c., F.A.C.]

46. If any portion of the final permit is invalidated, the remainder of the permit shall remain in effect.

[Rule 62-213.440(1)(d)1., F.A.C.]

47. It shall not be a defense for a permittee in an enforcement action that maintaining compliance with any permit condition would necessitate halting of or reduction of the source activity.

[Rule 62-213.440(1)(d)3., F.A.C.]

48. Any Title V source shall comply with all the terms and conditions of the existing permit until the Department has taken final action on any permit renewal or any requested permit revision, except as provided at Rule 62-213.412(2), F.A.C.

[Rule 62-213.440(1)(d)4., F.A.C.]

49. A situation arising from sudden and unforeseeable events beyond the control of the source which causes an exceedance of a technology-based emissions limitation because of unavoidable increases in emissions attributable to the situation and which requires immediate corrective action to restore normal operation, shall be an affirmative defense to an enforcement action in accordance with the provisions and requirements of 40 CFR 70.6(g)(2) and (3), hereby adopted and incorporated by reference.

[Rule 62-213.440(1)(d)5., F.A.C.]

50. Confidentiality Claims. Any permittee may claim confidentiality of any data or other information by complying with Rule 62-213.420(2), F.A.C. (also, see Condition No. 36.).

[Rule 62-213.440(1)(d)6., F.A.C.]

51. Statement of Compliance. (a)2. The permittee shall submit a Statement of Compliance with all terms and conditions of the permit using DEP Form No. 62-213.900(7). Such statement shall be accompanied by a certification in accordance with Rule 62-213.420(4), F.A.C. Such statements shall be submitted (postmarked) to the Department and EPA:

- a. Annually, within 60 days after the end of each calendar year during which the Title V permit was effective, or more frequently if specified by Rule 62-213.440(2), F.A.C., or by any other applicable requirement; and
- b. Within 60 days after submittal of a written agreement for transfer of responsibility as required pursuant to 40 CFR 70.7(d)(1)(iv), adopted and incorporated by reference at Rule 62-204.800, F.A.C., or within 60 days after permanent shutdown of a facility permitted under Chapter 62-213, F.A.C.; provided that, in either such case, the reporting period shall be the portion of the calendar year the permit was effective up to the date of transfer of responsibility or permanent facility shutdown, as applicable.

3. The statement of compliance status shall include all the provisions of 40 CFR 70.6(c)(5)(iii), incorporated by reference at Rule 62-204.800, F.A.C.

(b) The responsible official may treat compliance with all other applicable requirements as a surrogate for compliance with Rule 62-296.320(2), Objectionable Odor Prohibited.

[Rules 62-213.440(3)(a)2. & 3. and (b), F.A.C.]

52. Permit Shield. Except as provided in Chapter 62-213, F.A.C., compliance with the terms and conditions of a permit issued pursuant to Chapter 62-213, F.A.C., shall, as of the effective date of the permit, be deemed compliance with any applicable requirements in effect, provided that the source included such applicable requirements in the permit application. Nothing in Rule 62-213.460, F.A.C., or in any permit shall alter or affect the ability of EPA or the Department to deal with an emergency, the liability of an owner or operator of a source for any violation of applicable requirements prior to or at the time of permit issuance, or the requirements of the Federal Acid Rain Program.

[Rule 62-213.460, F.A.C.]

53. Forms and Instructions. The forms used by the Department in the Title V source operation program are adopted and incorporated by reference in Rule 62-213.900, F.A.C. The form is listed by rule number, which is also the form number, and with the subject, title, and effective date. Copies of forms may be obtained by writing to the Department of Environmental Protection, Division of Air Resources Management, 2600 Blair Stone Road, Tallahassee, Florida 32399-2400, or by contacting the appropriate permitting authority.

(1) Major Air Pollution Source Annual Emissions Fee Form. (Effective 01/03/2001)

(7) Statement of Compliance Form. (Effective 01/03/2001)

[Rule 62-213.900, F.A.C.: Forms (1) and (7)]

Chapter 62-256, F.A.C.

54. **Not federally enforceable. Open Burning.** This permit does not authorize any open burning nor does it constitute any waiver of the requirements of Chapter 62-256, F.A.C. Source shall comply with Chapter 62-256, F.A.C., for any open burning at the source. [Chapter 62-256, F.A.C.]

Chapter 62-281, F.A.C.

55. **Refrigerant Requirements.** Any facility having refrigeration equipment, including air conditioning equipment, which uses a Class I or II substance (listed at 40 CFR 82, Subpart A, Appendices A and B), and any facility which maintains, services, or repairs motor vehicles using a Class I or Class II substance as refrigerant must comply with all requirements of 40 CFR 82, Subparts B and F, and with Rule 62-281.100, F.A.C. Those requirements include the following restrictions:

- (1) Any facility having any refrigeration equipment normally containing 50 (fifty) pounds of refrigerant, or more, must keep servicing records documenting the date and type of all service and the quantity of any refrigerant added pursuant to 40 CFR 82.166;
- (2) No person repairing or servicing a motor vehicle may perform any service on a motor vehicle air conditioner (MVAC) involving the refrigerant for such air conditioner unless the person has been properly trained and certified as provided at 40 CFR 82.34 and 40 CFR 82.40, and properly uses equipment approved pursuant to 40 CFR 82.36 and 40 CFR 82.38, and complies with 40 CFR 82.42;
- (3) No person may sell or distribute, or offer for sale or distribution, any substance listed as a Class I or Class II substance at 40 CFR 82, Subpart A, Appendices A and B, except in compliance with Rule 62-281.100, F.A.C., and 40 CFR 82.34(b), 40 CFR 82.42, and/or 40 CFR 82.166;
- (4) No person maintaining, servicing, repairing, or disposing of appliances may knowingly vent or otherwise release into the atmosphere any Class I or Class II substance used as a refrigerant in such equipment and no other person may open appliances (except MVACs as defined at 40 CFR 82.152) for service, maintenance or repair unless the person has been properly trained and certified pursuant to 40 CFR 82.161 and unless the person uses equipment certified for that type of appliance pursuant to 40 CFR 82.158 and unless the person observes the practices set forth at 40 CFR 82.156 and 40 CFR 82.166;
- (5) No person may dispose of appliances (except small appliances, as defined at 40 CFR 82.152) without using equipment certified for that type of appliance pursuant to 40 CFR 82.158 and without observing the practices set forth at 40 CFR 82.156 and 40 CFR 82.166;
- (6) No person may recover refrigerant from small appliances, MVACs and MVAC-like appliances (as defined at 40 CFR 82.152), except in compliance with the requirements of 40 CFR 82, Subpart F.

[40 CFR 82; and, Chapter 62-281, F.A.C. (**Chapter 62-281, F.A.C., is not federally enforceable**)]

Chapter 62-296, F.A.C.

56. **Industrial, Commercial, and Municipal Open Burning Prohibited.** Open burning in connection with industrial, commercial, or municipal operations is prohibited, except when:

- (a) Open burning is determined by the Department to be the only feasible method of operation and is authorized by an air permit issued pursuant to Chapter 62-210 or 62-213, F.A.C.; or,
- (b) An emergency exists which requires immediate action to protect human health and safety; or,
- (c) A county or municipality would use a portable air curtain incinerator to burn yard trash generated by a hurricane, tornado, fire or other disaster and the air curtain incinerator would otherwise be operated in accordance with the permitting exemption criteria of Rule 62-210.300(3), F.A.C.

[Rule 62-296.320(3), F.A.C.]

57. **Unconfined Emissions of Particulate Matter.**

(4)(c)1. No person shall cause, let, permit, suffer or allow the emissions of unconfined particulate matter from any activity, including vehicular movement; transportation of materials; construction; alteration; demolition or wrecking; or industrially related activities such as loading, unloading, storing or handling; without taking reasonable precautions to prevent such emissions.

3. Reasonable precautions include the following:

- a. Paving and maintenance of roads, parking areas and yards.
- b. Application of water or chemicals to control emissions from such activities as demolition of buildings, grading roads, construction, and land clearing.
- c. Application of asphalt, water, oil, chemicals or other dust suppressants to unpaved roads, yards, open stock piles and similar activities.

- d. Removal of particulate matter from roads and other paved areas under the control of the owner or operator of the facility to prevent reentrainment, and from buildings or work areas to prevent particulate from becoming airborne.
- e. Landscaping or planting of vegetation.
- f. Use of hoods, fans, filters, and similar equipment to contain, capture and/or vent particulate matter.
- g. Confining abrasive blasting where possible.
- h. Enclosure or covering of conveyor systems.

4. In determining what constitutes reasonable precautions for a particular facility, the Department shall consider the cost of the control technique or work practice, the environmental impacts of the technique or practice, and the degree of reduction of emissions expected from a particular technique or practice.

[Rules 62-296.320(4)(c)1., 3., & 4. F.A.C.]

[electronic file name: tv-4.doc]

APPENDIX SS-1, STACK SAMPLING FACILITIES (version dated 10/07/96)

Stack Sampling Facilities Provided by the Owner of an Emissions Unit. This section describes the minimum requirements for stack sampling facilities that are necessary to sample point emissions units. Sampling facilities include sampling ports, work platforms, access to work platforms, electrical power, and sampling equipment support. Emissions units must provide these facilities at their expense. All stack sampling facilities must meet any Occupational Safety and Health Administration (OSHA) Safety and Health Standards described in 29 CFR Part 1910, Subparts D and E.

(a) Permanent Test Facilities. The owner or operator of an emissions unit for which a compliance test, other than a visible emissions test, is required on at least an annual basis, shall install and maintain permanent stack sampling facilities.

(b) Temporary Test Facilities. The owner or operator of an emissions unit that is not required to conduct a compliance test on at least an annual basis may use permanent or temporary stack sampling facilities. If the owner chooses to use temporary sampling facilities on an emissions unit, and the Department elects to test the unit, such temporary facilities shall be installed on the emissions unit within 5 days of a request by the Department and remain on the emissions unit until the test is completed.

(c) Sampling Ports.

1. All sampling ports shall have a minimum inside diameter of 3 inches.
2. The ports shall be capable of being sealed when not in use.
3. The sampling ports shall be located in the stack at least 2 stack diameters or equivalent diameters downstream and at least 0.5 stack diameter or equivalent diameter upstream from any fan, bend, constriction or other flow disturbance.
4. For emissions units for which a complete application to construct has been filed prior to December 1, 1980, at least two sampling ports, 90 degrees apart, shall be installed at each sampling location on all circular stacks that have an outside diameter of 15 feet or less. For stacks with a larger diameter, four sampling ports, each 90 degrees apart, shall be installed. For emissions units for which a complete application to construct is filed on or after December 1, 1980, at least two sampling ports, 90 degrees apart, shall be installed at each sampling location on all circular stacks that have an outside diameter of 10 feet or less. For stacks with larger diameters, four sampling ports, each 90 degrees apart, shall be installed. On horizontal circular ducts, the ports shall be located so that the probe can enter the stack vertically, horizontally or at a 45 degree angle.

5. On rectangular ducts, the cross sectional area shall be divided into the number of equal areas in accordance with EPA Method 1. Sampling ports shall be provided which allow access to each sampling point. The ports shall be located so that the probe can be inserted perpendicular to the gas flow.

(d) Work Platforms.

1. Minimum size of the working platform shall be 24 square feet in area. Platforms shall be at least 3 feet wide.
2. On circular stacks with 2 sampling ports, the platform shall extend at least 110 degrees around the stack.
3. On circular stacks with more than two sampling ports, the work platform shall extend 360 degrees around the stack.
4. All platforms shall be equipped with an adequate safety rail (ropes are not acceptable), toeboard, and hinged floor-opening cover if ladder access is used to reach the platform. The safety rail directly in line with the sampling ports shall be removable so that no obstruction exists in an area 14 inches below each sample port and 6 inches on either side of the sampling port.

(e) Access to Work Platform.

APPENDIX SS-1, STACK SAMPLING FACILITIES (version dated 10/07/96)
(continued)

1. Ladders to the work platform exceeding 15 feet in length shall have safety cages or fall arresters with a minimum of 3 compatible safety belts available for use by sampling personnel.

2. Walkways over free-fall areas shall be equipped with safety rails and toeboards.

(f) Electrical Power.

1. A minimum of two 120-volt AC, 20-amp outlets shall be provided at the sampling platform within 20 feet of each sampling port.

2. If extension cords are used to provide the electrical power, they shall be kept on the plant's property and be available immediately upon request by sampling personnel.

(g) Sampling Equipment Support.

1. A three-quarter inch eyebolt and an angle bracket shall be attached directly above each port on vertical stacks and above each row of sampling ports on the sides of horizontal ducts.

a. The bracket shall be a standard 3 inch x 3 inch x one-quarter inch equal-legs bracket which is 1 and one-half inches wide. A hole that is one-half inch in diameter shall be drilled through the exact center of the horizontal portion of the bracket. The horizontal portion of the bracket shall be located 14 inches above the centerline of the sampling port.

b. A three-eighth inch bolt which protrudes 2 inches from the stack may be substituted for the required bracket. The bolt shall be located 15 and one-half inches above the centerline of the sampling port.

c. The three-quarter inch eyebolt shall be capable of supporting a 500 pound working load. For stacks that are less than 12 feet in diameter, the eyebolt shall be located 48 inches above the horizontal portion of the angle bracket. For stacks that are greater than or equal to 12 feet in diameter, the eyebolt shall be located 60 inches above the horizontal portion of the angle bracket. If the eyebolt is more than 120 inches above the platform, a length of chain shall be attached to it to bring the free end of the chain to within safe reach from the platform.

2. A complete monorail or dualrail arrangement may be substituted for the eyebolt and bracket.

3. When the sample ports are located in the top of a horizontal duct, a frame shall be provided above the port to allow the sample probe to be secured during the test.

[Rule 62-297.310(6), F.A.C.]

TABLE 297.310-1 CALIBRATION SCHEDULE
(version dated 10/07/96)

[Note: This table is referenced in Rule 62-297.310, F.A.C.]

ITEM	MINIMUM CALIBRATION FREQUENCY	REFERENCE INSTRUMENT	TOLERANCE
Liquid in glass thermometer	Annually	ASTM Hg in glass ref. thermometer or equivalent, or thermometric points	+/-2%
Bimetallic thermometer	Quarterly	Calib. liq. in glass thermometer	5 degrees F
Thermocouple	Annually	ASTM Hg in glass ref. thermometer, NBS calibrated reference and potentiometer	5 degrees F
Barometer	Monthly	Hg barometer or NOAA station	+/-1% scale
Pitot Tube	When required or when damaged	By construction or measurements in wind tunnel D greater than 16" and standard pitot tube	See EPA Method 2, Fig. 2-2 & 2-3
Probe Nozzles	Before each test or when nicked, dented, or corroded	Micrometer	+/-0.001" mean of at least three readings Max. deviation between readings .004"
Dry Gas Meter and Orifice Meter	1. Full Scale: When received, When 5% change observed, Annually	Spirometer or calibrated wet test or dry gas test meter	2%
	2. One Point: Semiannually 3. Check after each test series	Comparison check	5%

FIGURE 1--SUMMARY REPORT--GASEOUS AND OPACITY EXCESS EMISSION AND MONITORING SYSTEM PERFORMANCE

[Note: This form is referenced in 40 CFR 60.7, Subpart A-General Provisions]

Pollutant (*Circle One*): SO₂ NO_x TRS H₂S CO Opacity

Reporting period dates: From _____ to _____

Company: _____

Emission Limitation: _____

Address: _____

Monitor Manufacturer: _____

Model No.: _____

Date of Latest CMS Certification or Audit: _____

Process Unit(s) Description: _____

Total source operating time in reporting period ¹: _____

Emission data summary ¹	CMS performance summary ¹
1. Duration of excess emissions in reporting period due to: a. Startup/shutdown b. Control equipment problems c. Process problems d. Other known causes e. Unknown causes 2. Total duration of excess emissions 3. Total duration of excess emissions x (100) / [Total source operating time] % ²	1. CMS downtime in reporting period due to: a. Monitor equipment malfunctions b. Non-Monitor equipment malfunctions c. Quality assurance calibration d. Other known causes e. Unknown causes 2. Total CMS Downtime 3. [Total CMS Downtime] x (100) / [Total source operating time] % ²

¹ For opacity, record all times in minutes. For gases, record all times in hours.

² For the reporting period: If the total duration of excess emissions is 1 percent or greater of the total operating time or the total CMS downtime is 5 percent or greater of the total operating time, both the summary report form and the excess emission report described in 40 CFR 60.7(c) shall be submitted.

Note: On a separate page, describe any changes since last quarter in CMS, process or controls.

I certify that the information contained in this report is true, accurate, and complete.

Name: _____

Signature: _____ Date: _____

Title: _____

Attachment "40 CFR 60, Subpart A"

General Provisions

40 CFR 60.1 Applicability.

- (a) Except as provided in 40 CFR 60 subparts B and C, the provisions of this part apply to the owner or operator of any stationary source which contains an affected facility, the construction or modification of which is commenced after the date of publication in this part of any standard (or, if earlier, the date of publication of any proposed standard) applicable to that facility.
- (b) Any new or revised standard of performance promulgated pursuant to section 111(b) of the Act shall apply to the owner or operator of any stationary source which contains an affected facility, the construction or modification of which is commenced after the date of publication in this part of such new or revised standard (or, if earlier, the date of publication of any proposed standard) applicable to that facility.
- (c) In addition to complying with the provisions of this part, the owner or operator of an affected facility may be required to obtain an operating permit issued to stationary sources by an authorized State air pollution control agency or by the Administrator of the U.S. Environmental Protection Agency (EPA) pursuant to Title V of the Clean Air Act (CAA) as amended November 15, 1990 (42 U.S.C. 7661).
[Rule 62-204.800, F.A.C.; and, 40 CFR 60.1(a), (b) and (c)]

40 CFR 60.2 Definitions.

- (a) *Administrator* means the Administrator of the Environmental Protection Agency or the Secretary or the Secretary's designee.
[Rule 62-204.800(7)(a), F.A.C.; and, 40 CFR 60.2]

40 CFR 60.7 Notification and record keeping.

- (a) The owner or operator subject to the provisions of this part shall furnish the Administrator written notification as follows:
- (1) A notification of the date construction (or reconstruction as defined under 40 CFR 60.15) of an affected facility is commenced postmarked no later than 30 days after such date. This requirement shall not apply in the case of mass-produced facilities which are purchased in completed form.
 - (2) A notification of the anticipated date of initial startup of an affected facility postmarked not more than 60 days nor less than 30 days prior to such date.
 - (3) A notification of the actual date of initial startup of an affected facility postmarked within 15 days after such date.
 - (4) A notification of any physical or operational change to an existing facility which may increase the emission rate of any air pollutant to which a standard applies, unless that change is specifically exempted under an applicable subpart or in 40 CFR 60.14(e). This notice shall be postmarked 60 days or as soon as practicable before the change is commenced and shall include information describing the precise nature of the change, present and proposed emission control systems, productive capacity of the facility before and after the change, and the expected completion date of the change. The Administrator may request additional relevant information subsequent to this notice.
 - (5) A notification of the date upon which demonstration of the continuous monitoring system performance commences in accordance with 40 CFR 60.13(c). Notification shall be postmarked not less than 30 days prior to such date.

Attachment "40 CFR 60, Subpart A"

Page 2

- (6) A notification of the anticipated date for conducting the opacity observations required by 40 CFR 60.11(e)(1) of this part. The notification shall also include, if appropriate, a request for the Administrator to provide a visible emissions reader during a performance test. The notification shall be postmarked not less than 30 days prior to such date.
- (7) A notification that continuous opacity monitoring system data results will be used to determine compliance with the applicable opacity standard during a performance test required by 40 CFR 60.8 in lieu of Method 9 observation data as allowed by 40 CFR 60.11(e)(5) of 40 CFR 60. This notification shall be postmarked not less than 30 days prior to the date of the performance test.
- (b) The owner or operator subject to the provisions of this part shall maintain records of the occurrence and duration of any startup, shutdown, or malfunction in the operation of an affected facility; any malfunction of the air pollution control equipment; or any periods during which a continuous monitoring system or monitoring device is inoperative.
- (c) The owner or operator required to install a continuous monitoring system (CMS) or monitoring device shall submit an excess emissions and monitoring systems performance report (excess emissions are defined in applicable subparts) and/or a summary report form (see 40 CFR 60.7(d) to the Administrator semiannually, except when: more frequent reporting is specifically required by an applicable subpart; or the CMS data are to be used directly for compliance determination, in which case quarterly reports shall be submitted; or the Administrator, on a case-by-case basis, determines that more frequent reporting is necessary to accurately assess the compliance status of the source. All reports shall be postmarked by the 30th day following the end of each calendar half (or quarter, as appropriate). Written reports of excess emissions shall include the following information:
- (1) The magnitude of excess emissions computed in accordance with 40 CFR 60.13(h), any conversion factor(s) used, and the date and time of commencement and completion of each time period of excess emissions. The process operating time during the reporting period.
 - (2) Specific identification of each period of excess emissions that occurs during startups, shutdowns, and malfunctions of the affected facility. The nature and cause of any malfunction (if known), the corrective action taken or preventative measures adopted.
 - (3) The date and time identifying each period during which the continuous monitoring system was inoperative except for zero and span checks and the nature of the system repairs or adjustments.
 - (4) When no excess emissions have occurred or the continuous monitoring system(s) have not been inoperative, repaired, or adjusted, such information shall be stated in the report.
- (d) The summary report form shall contain the information and be in the format shown in Figure 1 unless otherwise specified by the Administrator. One summary report form shall be submitted for each pollutant monitored at each affected facility.
- (1) If the total duration of excess emissions for the reporting period is less than 1 percent of the total operating time for the reporting period and CMS downtime for the reporting period is less than 5 percent of the total operating time for the reporting period, only the summary report form shall be submitted and the excess emission report described in 40 CFR 60.7(c) need not be submitted unless requested by the Administrator.
 - (2) If the total duration of excess emissions for the reporting period is 1 percent or greater of the total operating time for the reporting period or the total CMS downtime for the reporting period is 5 percent or greater of the total operating time for the reporting period, the summary report form and the excess emission report described in 40 CFR 60.7(c) shall both be submitted.

[See Attached Figure 1-Summary Report-Gaseous and Opacity Excess Emission and Monitoring System Performance]

Attachment "40 CFR 60, Subpart A"

Page 3

(e) The owner or operator subject to the provisions of this part shall maintain a file of all measurements, including continuous monitoring system, monitoring device, and performance testing measurements; all continuous monitoring system performance evaluations; all continuous monitoring system or monitoring device calibration checks; adjustments and maintenance performed on these systems or devices; and all other information required by this part recorded in a permanent form suitable for inspection. The file shall be retained for at least two years following the date of such measurements, maintenance, reports, and records.

(f) If notification substantially similar to that in 40 CFR 60.7(a) is required by any other State or local agency, sending the Administrator a copy of that notification will satisfy the requirements of 40 CFR 60.7(a).

(g) Individual subparts of this part may include specific provisions which clarify or make inapplicable the provisions set forth in this section.

[Rule 62-204.800, F.A.C.; and, 40 CFR 60.7(a), (b), (c), (d), (e), (f) and (g)]

40 CFR 60.8 Performance tests.

(a) Within 60 days after achieving the maximum production rate at which the affected facility will be operated, but not later than 180 days after initial startup of such facility and at such other times as may be required by the Administrator under section 114 of the Act, the owner or operator of such facility shall conduct performance test(s) and furnish the Administrator a written report of the results of such performance test(s).

(b) Performance tests shall be conducted and data reduced in accordance with the test methods and procedures contained in each applicable subpart unless the Administrator (1) specifies or approves, in specific cases, the use of a reference method with minor changes in methodology, (4) waives the requirement for performance tests because the owner or operator of a source has demonstrated by other means to the Administrator's satisfaction that the affected facility is in compliance with the standard, or (5) approves shorter sampling times and smaller sample volumes when necessitated by process variables or other factors. Nothing in 40 CFR 60.8 shall be construed to abrogate the Administrator's authority to require testing under section 114 of the Act.

(c) Performance tests shall be conducted under such conditions as the Administrator shall specify to the plant operator based on representative performance of the affected facility. The owner or operator shall make available to the Administrator such records as may be necessary to determine the conditions of the performance tests. Operations during periods of startup, shutdown, and malfunction shall not constitute representative conditions for the purpose of a performance test nor shall emissions in excess of the level of the applicable emission limit during periods of startup, shutdown, and malfunction be considered a violation of the applicable emission limit unless otherwise specified in the applicable standard.

(e) The owner or operator of an affected facility shall provide, or cause to be provided, performance testing facilities as follows:

(1) Sampling ports adequate for test methods applicable to such facility. This includes (i) constructing the air pollution control system such that volumetric flow rates and pollutant emission rates can be accurately determined by applicable test methods and procedures and (ii) providing a stack or duct free of cyclonic flow during performance tests, as demonstrated by applicable test methods and procedures.

(2) Safe sampling platform(s).

(3) Safe access to sampling platform(s).

(4) Utilities for sampling and testing equipment.

(f) Unless otherwise specified in the applicable subpart, each performance test shall consist of three separate runs using the applicable test method. Each run shall be conducted for the time and under the conditions specified in the applicable standard. For the purpose of determining compliance with an applicable standard, the arithmetic means of results of the three runs shall apply. In the event that a sample is accidentally lost or conditions occur in which one of the three runs must be discontinued because of forced shutdown, failure of an irreplaceable portion of the sample train, extreme meteorological conditions, or other circumstances, beyond the owner or operator's control, compliance may, upon the Administrator's approval, be determined using the arithmetic mean of the results of the two other runs.

[Rule 62-204.800, F.A.C.; and, 40 CFR 60.8(a), (b)(1), (4) & (5), (c), (e) and (f)]

40 CFR 60.10 State authority.

The provisions of 40 CFR 60 shall not be construed in any manner to preclude any State or political subdivision thereof from:

- (a) Adopting and enforcing any emission standard or limitation applicable to an affected facility, provided that such emission standard or limitation is not less stringent than the standard applicable to such facility.
 - (b) Requiring the owner or operator of an affected facility to obtain permits, licenses, or approvals prior to initiating construction, modification, or operation of such facility.
- [Rule 62-204.800, F.A.C.; and, 40 CFR 60.10(a) and (b)].

40 CFR 60.11 Compliance with standards and maintenance requirements.

- (a) Compliance with standards in this part, other than opacity standards, shall be determined by performance tests established by 40 CFR 60.8, unless otherwise specified in the applicable standard.
- (b) Compliance with opacity standards in this part shall be determined by conducting observations in accordance with Reference Method 9 in appendix A of this part, any alternative method that is approved by the Administrator, or as provided in 40 CFR 60.11(e)(5). For purposes of determining initial compliance, the minimum total time of observations shall be 3 hours (30 6-minute averages) for the performance test or other set of observations (meaning those fugitive-type emission sources subject only to an opacity standard).
- (c) The opacity standards set forth in this part shall apply at all times except during periods of startup, shutdown, malfunction, and as otherwise provided in the applicable standard.
- (d) At all times, including periods of startup, shutdown, and malfunction, owners and operators shall, to the extent practicable, maintain and operate any affected facility including associated air pollution control equipment in a manner consistent with good air pollution control practice for minimizing emissions. Determination of whether acceptable operating and maintenance procedures are being used will be based on information available to the Administrator which may include, but is not limited to, monitoring results, opacity observations, review of operating and maintenance procedures, and inspection of the source.
- (e)(1) For the purpose of demonstrating initial compliance, opacity observations shall be conducted concurrently with the initial performance test required in 40 CFR 60.8 unless one of the following conditions apply. If no performance test under 40 CFR 60.8 is required, then opacity observations shall be conducted within 60 days after achieving the maximum production rate at which the affected facility will be operated but no later than 180 days after initial startup of the facility. If visibility or other conditions prevent the opacity observations from being conducted concurrently with the initial performance test required under 40 CFR 60.8, the source owner or operator shall reschedule the opacity observations as soon after the initial performance test as possible, but not later than 30 days thereafter, and shall advise the Administrator of the rescheduled date. In these cases, the 30-day prior notification to the Administrator required in 40 CFR 60.7(a)(6) shall be waived. The rescheduled opacity observations shall be conducted (to the extent possible) under the same operating conditions that existed during the initial performance test conducted under 40 CFR 60.8. The visible emissions observer shall determine whether visibility or other conditions prevent the opacity observations from being made concurrently with the initial performance test in accordance with procedures contained in Reference Method 9 of appendix B of this part. Opacity readings of portions of plumes which contain condensed, uncombined water vapor shall not be used for purposes of determining compliance with opacity standards. The owner or operator of an affected facility shall make available, upon request by the Administrator, such records as may be necessary to determine the conditions under which the visual observations were made and shall provide evidence indicating proof of current visible observer emission certification. Except as provided in 40 CFR 60.11(e)(5), the results of continuous monitoring by transmissometer which indicate that the opacity at the time visual observations were made was not in excess of the standard are probative but not conclusive evidence of the actual opacity of an emission, provided that the source shall meet the burden of proving that the instrument used meets (at the time of the alleged violation) Performance Specification 1 in appendix B of 40 CFR 60, has been properly maintained and (at the time of the alleged violation) that the resulting data have not been altered in any way.

- (2) Except as provided in 40 CFR 60.11(e)(3), the owner or operator of an affected facility to which an opacity standard in this part applies shall conduct opacity observations in accordance with 40 CFR 60.11(b), shall record the opacity of emissions, and shall report to the Administrator the opacity results along with the results of the initial performance test required under 40 CFR 60.8. The inability of an owner or operator to secure a visible emissions observer shall not be considered a reason for not conducting the opacity observations concurrent with the initial performance test.
- (3) The owner or operator of an affected facility to which an opacity standard in this part applies may request the Administrator to determine and to record the opacity of emissions from the affected facility during the initial performance test and at such times as may be required. The owner or operator of the affected facility shall report the opacity results. Any request to the Administrator to determine and to record the opacity of emissions from an affected facility shall be included in the notification required in 40 CFR 60.7(a)(6). If, for some reason, the Administrator cannot determine and record the opacity of emissions from the affected facility during the performance test, then the provisions of 40 CFR 60.7(e)(1) shall apply.
- (4) The owner or operator of an affected facility using a continuous opacity monitor (transmissometer) shall record the monitoring data produced during the initial performance test required by 40 CFR 60.8 and shall furnish the Administrator a written report of the monitoring results along with Method 9 and 40 CFR 60.8 performance test results.
- (5) The owner or operator of an affected facility subject to an opacity standard may submit, for compliance purposes, continuous opacity monitoring system (COMS) data results produced during any performance test required under 40 CFR 60.8 in lieu of Method 9 observation data. If an owner or operator elects to submit COMS data for compliance with the opacity standard, he shall notify the Administrator of that decision, in writing, at least 30 days before any performance test required under 40 CFR 60.8 is conducted. Once the owner or operator of an affected facility has notified the Administrator to that effect, the COMS data results will be used to determine opacity compliance during subsequent tests required under 40 CFR 60.8 until the owner or operator notifies the Administrator, in writing, to the contrary. For the purpose of determining compliance with the opacity standard during a performance test required under 40 CFR 60.8 using COMS data, the minimum total time of COMS data collection shall be averages of all 6-minute continuous periods within the duration of the mass emission performance test. Results of the COMS opacity determinations shall be submitted along with the results of the performance test required under 60.8. The owner or operator of an affected facility using a COMS for compliance purposes is responsible for demonstrating that the COMS meets the requirements specified in 40 CFR 60.13(c), that the COMS has been properly maintained and operated, and that the resulting data have not been altered in any way. If COMS data results are submitted for compliance with the opacity standard for a period of time during which Method 9 data indicates noncompliance, the Method 9 data will be used to determine opacity compliance.
- (6) Upon receipt from an owner or operator of the written reports of the results of the performance tests required by 40 CFR 60.8, the opacity observation results and observer certification required by 40 CFR 60.11(e)(1), and the COMS results, if applicable, the Administrator will make a finding concerning compliance with opacity and other applicable standards. If COMS data results are used to comply with an opacity standard, only those results are required to be submitted along with the performance test results required by 40 CFR 60.8. If the Administrator finds that an affected facility is in compliance with all applicable standards for which performance tests are conducted in accordance with 40 CFR 60.8 of this part but during the time such performance tests are being conducted fails to meet any applicable opacity standard, the shall notify the owner or operator and advise him that he may petition the Administrator within 10 days of receipt of notification to make appropriate adjustment to the opacity standard for the affected facility.
- (7) The Administrator will grant such a petition upon a demonstration by the owner or operator that the affected facility and associated air pollution control equipment was operated and maintained in a manner to minimize the opacity of emissions during the performance tests; that the performance tests were performed under the conditions established by the Administrator; and that the affected facility and associated air pollution control equipment were incapable of being adjusted or operated to meet the applicable opacity standard.

Attachment "40 CFR 60, Subpart A"

Page 6

(8) The Administrator will establish an opacity standard for the affected facility meeting the above requirements at a level at which the source will be able, as indicated by the performance and opacity tests, to meet the opacity standard at all times during which the source is meeting the mass or concentration emission standard. The Administrator will promulgate the new opacity standard in the Federal Register.

(f) Special provisions set forth under an applicable subpart of 40 CFR 60 shall supersede any conflicting provisions of 40 CFR 60.11.

(g) For the purpose of submitting compliance certifications or establishing whether or not a person has violated or is in violation of any standard in this part, nothing in this part shall preclude the use, including the exclusive use, of any credible evidence or information, relevant to whether a source would have been in compliance with applicable requirements if the appropriate performance or compliance test or procedure had been performed.

[Rule 62-204.800, F.A.C.; and, 40 CFR 60.11(a), (b), (c), (d), (e), (f) and (g)]

40 CFR 60.12 Circumvention.

No owner or operator subject to the provisions of this part shall build, erect, install, or use any article, machine, equipment or process, the use of which conceals an emission which would otherwise constitute a violation of an applicable standard. Such concealment includes, but is not limited to, the use of gaseous diluents to achieve compliance with an opacity standard or with a standard which is based on the concentration of a pollutant in the gases discharged to the atmosphere.

[Rule 62-204.800, F.A.C.; and, 40 CFR 60.12]

40 CFR 60.13 Monitoring requirements.

(a) For the purposes of this section, all continuous monitoring systems required under applicable subparts shall be subject to the provisions of this section upon promulgation of performance specifications for continuous monitoring systems under appendix B of 40 CFR 60 and, if the continuous monitoring system is used to demonstrate compliance with emission limits on a continuous basis, appendix F to 40 CFR 60, unless otherwise specified in an applicable subpart or by the Administrator. Appendix F is applicable December 4, 1987.

(b) All continuous monitoring systems and monitoring devices shall be installed and operational prior to conducting performance tests under 40 CFR 60.8. Verification of operational status shall, as a minimum, include completion of the manufacturer's written requirements or recommendations for installation, operation, and calibration of the device.

(c) If the owner or operator of an affected facility elects to submit continuous opacity monitoring system (COMS) data for compliance with the opacity standard as provided under 40 CFR 60.11(e)(5), he/she shall conduct a performance evaluation of the COMS as specified in Performance Specification 1, appendix B, of 40 CFR 60 before the performance test required under 40 CFR 60.8 is conducted. Otherwise, the owner or operator of an affected facility shall conduct a performance evaluation of the COMS or continuous emission monitoring system (CEMS) during any performance test required under 40 CFR 60.8 or within 30 days thereafter in accordance with the applicable performance specification in appendix B of 40 CFR 60. The owner or operator of an affected facility shall conduct COMS or CEMS performance evaluations at such other times as may be required by the Administrator under section 114 of the Act.

(1) The owner or operator of an affected facility using a COMS to determine opacity compliance during any performance test required under 40 CFR 60.8 and as described in 40 CFR 60.11(e)(5), shall furnish the Administrator two or, upon request, more copies of a written report of the results of the COMS performance evaluation described in 40 CFR 60.13(c) at least 10 days before the performance test required under 40 CFR 60.8 is conducted.

(2) Except as provided in 40 CFR 60.13(c)(1), the owner or operator of an affected facility shall furnish the Administrator within 60 days of completion two or, upon request, more copies of a written report of the results of the performance evaluation.

- (d)(1) Owners and operators of all continuous emission monitoring systems installed in accordance with the provisions of this part shall check the zero (or low-level value between 0 and 20 percent of span value) and span (50 to 100 percent of span value) calibration drifts at least once daily in accordance with a written procedure. The zero and span shall, as a minimum, be adjusted whenever the 24-hour zero drift or 24-hour span drift exceeds two times the limits of the applicable performance specifications in appendix B. The system must allow the amount of excess zero and span drift measured at the 24-hour interval checks to be recorded and quantified, whenever specified. For continuous monitoring systems measuring opacity of emissions, the optical surfaces exposed to the effluent gases shall be cleaned prior to performing the zero and span drift adjustments except that for systems using automatic zero adjustments. The optical surfaces shall be cleaned when the cumulative automatic zero compensation exceeds 4 percent opacity.
- (2) Unless otherwise approved by the Administrator, the following procedures shall be followed for continuous monitoring systems measuring opacity of emissions. Minimum procedures shall include a method for producing a simulated zero opacity condition and an upscale (span) opacity condition using a certified neutral density filter or other related technique to produce a known obscuration of the light beam. Such procedures shall provide a system check of the analyzer internal optical surfaces and all electronic circuitry including the lamp and photo detector assembly.
- (e) Except for system breakdowns, repairs, calibration checks, and zero and span adjustments required under 40 CFR 60.13(d), all continuous monitoring systems shall be in continuous operation and shall meet minimum frequency of operation requirements as follows:
- (1) All continuous monitoring systems referenced by 40 CFR 60.13(c) for measuring opacity of emissions shall complete a minimum of one cycle of sampling and analyzing for each successive 10-second period and one cycle of data recording for each successive 6-minute period.
- (2) All continuous monitoring systems referenced by 40 CFR 60.13(c) for measuring emissions, except opacity, shall complete a minimum of one cycle of operation (sampling, analyzing, and data recording) for each successive 15-minute period.
- (f) All continuous monitoring systems or monitoring devices shall be installed such that representative measurements of emissions or process parameters from the affected facility are obtained. Additional procedures for location of continuous monitoring systems contained in the applicable Performance Specifications of appendix B of 40 CFR 60 shall be used.
- (g) When the effluents from a single affected facility or two or more affected facilities subject to the same emission standards are combined before being released to the atmosphere, the owner or operator may install applicable continuous monitoring systems on each effluent or on the combined effluent. When the affected facilities are not subject to the same emission standards, separate continuous monitoring systems shall be installed on each effluent. When the effluent from one affected facility is released to the atmosphere through more than one point, the owner or operator shall install an applicable continuous monitoring system on each separate effluent unless the installation of fewer systems is approved by the Administrator. When more than one continuous monitoring system is used to measure the emissions from one affected facility (e.g., multiple breechings, multiple outlets), the owner or operator shall report the results as required from each continuous monitoring system.
- (h) Owners or operators of all continuous monitoring systems for measurement of opacity shall reduce all data to 6-minute averages and for continuous monitoring systems other than opacity to 1-hour averages for time periods as defined in 40 CFR 60.2. Six-minute opacity averages shall be calculated from 36 or more data points equally spaced over each 6-minute period. For continuous monitoring systems other than opacity, 1-hour averages shall be computed from four or more data points equally spaced over each 1-hour period. Data recorder during periods of continuous monitoring system breakdowns, repairs, calibration checks, and zero and span adjustments shall not be included in the data averages computed under this paragraph. An arithmetic or integrated average of all data may be used. The data may be recorded in reduced or non reduced form (e.g., ppm pollutant and percent O₂ or ng/J of pollutant). All excess emissions shall be converted into units of the standard using the applicable conversion procedures specified in subparts. After conversion into units of the standard, the data may be rounded to the same number of significant digits as used in the applicable subparts to specify the emission limit (e.g., rounded to the nearest 1 percent opacity).

(i) After receipt and consideration of written application, the Administrator may approve alternatives to any monitoring procedures or requirements of this part including, but not limited to the following:

- (1) Alternative monitoring requirements when installation of a continuous monitoring system or monitoring device specified by this part would not provide accurate measurements due to liquid water or other interferences caused by substances with the effluent gases.
- (2) Alternative monitoring requirements when the affected facility is infrequently operated.
- (3) Alternative monitoring requirements to accommodate continuous monitoring systems that require additional measurements to correct for stack moisture conditions.
- (4) Alternative locations for installing continuous monitoring systems or monitoring devices when the owner or operator can demonstrate that installation at alternate locations will enable accurate and representative measurements.
- (5) Alternative methods of converting pollutant concentration measurements to units of the standards.
- (6) Alternative procedures for performing daily checks of zero and span drift that do not involve use of span gases or test cells.
- (7) Alternatives to the A.S.T.M. test methods or sampling procedures specified by any subpart.
- (8) Alternative continuous monitoring systems that do not meet the design or performance requirements in Performance Specification 1, appendix B, but adequately demonstrate a definite and consistent relationship between its measurements and the measurements of opacity by a system complying with the requirements in Performance Specification 1. The Administrator may require that such demonstration be performed for each affected facility.
- (9) Alternative monitoring requirements when the effluent from a single affected facility or the combined effluent from two or more affected facilities are released to the atmosphere through more than one point.

(j) An alternative to the relative accuracy test specified in Performance Specification 2 of appendix B may be requested as follows:

- (1) An alternative to the reference method tests for determining relative accuracy is available for sources with emission rates demonstrated to be less than 50 percent of the applicable standard. A source owner or operator may petition the Administrator to waive the relative accuracy test in section 7 of Performance Specification 2 and substitute the procedures in section 10 if the results of a performance test conducted according to the requirements in 40 CFR 60.8 of this subpart or other tests performed following the criteria in 40 CFR 60.8 demonstrate that the emission rate of the pollutant of interest in the units of the applicable standard is less than 50 percent of the applicable standard. For sources subject to standards expressed as control efficiency levels, a source owner or operator may petition the Administrator to waive the relative accuracy test and substitute the procedures in section 10 of Performance Specification 2 if the control device exhaust emission rate is less than 50 percent of the level needed to meet the control efficiency requirement. The alternative procedures do not apply if the continuous emission monitoring system is used to determine compliance continuously with the applicable standard. The petition to waive the relative accuracy test shall include a detailed description of the procedures to be applied. Included shall be location and procedure for conducting the alternative, the concentration or response levels of the alternative RA materials, and the other equipment checks included in the alternative procedure. The Administrator will review the petition for completeness and applicability. The determination to grant a waiver will depend on the intended use of the CEMS data (e.g., data collection purposes other than NSPS) and may require specifications more stringent than in Performance Specification 2 (e.g., the applicable emission limit is more stringent than NSPS).
- (2) The waiver of a CEMS relative accuracy test will be reviewed and may be rescinded at such time following successful completion of the alternative RA procedure that the CEMS data indicate the source emissions approaching the level of the applicable standard. The criterion for reviewing the waiver is the collection of CEMS data showing that emissions have exceeded 70 percent of the applicable standard for seven, consecutive, averaging periods as specified by the applicable regulation(s). For sources subject to standards expressed as control efficiency levels, the criterion for reviewing the waiver is the collection of CEMS data showing that exhaust emissions have exceeded 70 percent of the level needed to meet the control efficiency requirement for seven, consecutive, averaging periods as specified by the applicable regulation(s) [e.g., 40 CFR 60.45(g)(2) and 40 CFR 60.45(g)(3), 40 CFR 60.73(e), and 40 CFR 60.84(e)]. It is the

responsibility of the source operator to maintain records and determine the level of emissions relative to the criterion on the waiver of relative accuracy testing. If this criterion is exceeded, the owner or operator must notify the Administrator within 10 days of such occurrence and include a description of the nature and cause of the increasing emissions. The Administrator will review the notification and may rescind the waiver and require the owner or operator to conduct a relative accuracy test of the CEMS as specified in section 7 of Performance Specification 2.

[Rule 62-204.800, F.A.C.; and, 40 CFR 60.13(a) thru (j)].

40 CFR 60.14 Modification.

- (a) Except as provided under 40 CFR 60.14(e) and 40 CFR 60.14(f), any physical or operational change to an existing facility which results in an increase in the emission rate to the atmosphere of any pollutant to which a standard applies shall be considered a modification within the meaning of section 111 of the Act. Upon modification, an existing facility shall become an affected facility for each pollutant to which a standard applies and for which there is an increase in the emission rate to the atmosphere.
- (b) Emission rate shall be expressed as kg/hr (lbs/hour) of any pollutant discharged into the atmosphere for which a standard is applicable. The Administrator shall use the following to determine emission rate:
 - (1) Emission factors as specified in the latest issue of "Compilation of Air Pollutant Emission Factors", EPA Publication No. AP-42, or other emission factors determined by the Administrator to be superior to AP-42 emission factors, in cases where utilization of emission factors demonstrate that the emission level resulting from the physical or operational change will either clearly increase or clearly not increase.
 - (2) Material balances, continuous monitor data, or manual emission tests in cases where utilization of emission factors as referenced in 40 CFR 60.14(b)(1) does not demonstrate to the Administrator's satisfaction whether the emission level resulting from the physical or operational change will either clearly increase or clearly not increase, or where an owner or operator demonstrates to the Administrator's satisfaction that there are reasonable grounds to dispute the result obtained by the Administrator utilizing emission factors as referenced in 40 CFR 60.14(b)(1). When the emission rate is based on results from manual emission tests or continuous monitoring systems, the procedures specified in 40 CFR 60 appendix C of 40 CFR 60 shall be used to determine whether an increase in emission rate has occurred. Tests shall be conducted under such conditions as the Administrator shall specify to the owner or operator based on representative performance of the facility. At least three valid test runs must be conducted before and at least three after the physical or operational change. All operating parameters which may affect emissions must be held constant to the maximum feasible degree for all test runs.
- (c) The addition of an affected facility to a stationary source as an expansion to that source or as a replacement for an existing facility shall not by itself bring within the applicability of this part any other facility within that source.
- (d) [Reserved]
- (e) The following shall not, by themselves, be considered modifications under this part:
 - (1) Maintenance, repair, and replacement which the Administrator determines to be routine for a source category, subject to the provisions of 40 CFR 60.14(c) and 40 CFR 60.15.
 - (2) An increase in production rate of an existing facility, if that increase can be accomplished without a capital expenditure on that facility.
 - (3) An increase in the hours of operation.
 - (4) Use of an alternative fuel or raw material if, prior to the date any standard under this part becomes applicable to that source type, as provided by 40 CFR 60.1, the existing facility was designed to accommodate that alternative use. A facility shall be considered to be designed to accommodate an alternative fuel or raw material if that use could be accomplished under the facility's construction specifications as amended prior to the change. Conversion to coal required for energy considerations, as specified in section 111(a)(8) of the Act, shall not be considered a modification.
 - (5) The addition or use of any system or device whose primary function is the reduction of air pollutants, except when an emission control system is removed or is replaced by a system which the Administrator determines to be less environmentally beneficial.

- (6) The relocation or change in ownership of an existing facility.
- (f) Special provisions set forth under an applicable subpart of this part shall supersede any conflicting provisions of this section.
- (g) Within 180 days of the completion of any physical or operational change subject to the control measures specified in 40 CFR 60.14(a), compliance with all applicable standards must be achieved.
[Rule 62-204.800, F.A.C.; and, 40 CFR 60.14(a) thru (g)].

40 CFR 60.15 Reconstruction.

- (a) An existing facility, upon reconstruction, becomes an affected facility, irrespective of any change in emission rate.
- (b) "Reconstruction" means the replacement of components of an existing facility to such an extent that:
 - (1) The fixed capital cost of the new components exceeds 50 percent of the fixed capital cost that would be required to construct a comparable entirely new facility, and
 - (2) It is technologically and economically feasible to meet the applicable standards set forth in this part.
- (c) "Fixed capital cost" means the capital needed to provide all the depreciable components.
- (d) If an owner or operator of an existing facility proposes to replace components, and the fixed capital cost of the new components exceeds 50 percent of the fixed capital cost that would be required to construct a comparable entirely new facility, he shall notify the Administrator of the proposed replacements. The notice must be postmarked 60 days (or as soon as practicable) before construction of the replacements is commenced and must include the following information:
 - (1) Name and address of the owner or operator.
 - (2) The location of the existing facility.
 - (3) A brief description of the existing facility and the components which are to be replaced.
 - (4) A description of the existing air pollution control equipment and the proposed air pollution control equipment.
 - (5) An estimate of the fixed capital cost of the replacements and of constructing a comparable entirely new facility.
 - (6) The estimated life of the existing facility after the replacements.
 - (7) A discussion of any economic or technical limitations the facility may have in complying with the applicable standards of performance after the proposed replacements.
- (e) The Administrator will determine, within 30 days of the receipt of the notice required by 40 CFR 60.15(d) and any additional information he may reasonably require, whether the proposed replacement constitutes reconstruction.
- (f) The Administrator's determination under 40 CFR 60.15(e) shall be based on:
 - (1) The fixed capital cost of the replacements in comparison to the fixed capital cost that would be required to construct a comparable entirely new facility;
 - (2) The estimated life of the facility after the replacements compared to the life of a comparable entirely new facility;
 - (3) The extent to which the components being replaced cause or contribute to the emissions from the facility; and
 - (4) Any economic or technical limitations on compliance with applicable standards of performance which are inherent in the proposed replacements.
- (g) Individual subparts of this part may include specific provisions which refine and delimit the concept of reconstruction set forth in this section.
[Rule 62-204.800, F.A.C.; and, 40 CFR 60.15(a) thru (g)].

Acid Rain Part Application

For more information, see instructions and refer to 40 CFR 72.30 and 72.31 and Chapter 62-214, F.A.C.

This submission is: ☐ New ☒ Revised

STEP 1

Identify the source by plant name, State, and ORIS code

Plant Name: Seminole Generating Station	State: FL	ORIS Code: 1360
---	-----------	-----------------

STEP 2

Enter the unit ID# for every Acid Rain unit at the Acid Rain source in column "a." For new units, enter the requested information in columns "c" and "d."

a Unit ID#	b Unit will hold allowances in accordance with 40 CFR 72.9(c)(1)	c New Units Commence Operation Date	d New Units Monitor Certification Deadline
001	Yes		
002	Yes		
	Yes		
	Yes		
	Yes		
	Yes		
	Yes		
	Yes		
	Yes		
	Yes		
	Yes		
	Yes		
	Yes		
	Yes		

Plant Name (from Step 1) Seminole Generating Station

STEP 3 Read the standard requirements

Acid Rain Part Requirements

- (1) The designated representative of each Acid Rain source and each Acid Rain unit at the source shall:
 - (i) Submit a complete Acid Rain part application (including a compliance plan) under 40 CFR part 72 and Rules 62-214.320 and 330, F.A.C., in accordance with the deadlines specified in Rule 62-214.320, F.A.C.; and
 - (ii) Submit in a timely manner any supplemental information that the Department determines is necessary in order to review an Acid Rain part application and issue or deny an Acid Rain part;
- (2) The owners and operators of each Acid Rain source and each Acid Rain unit at the source shall:
 - (i) Operate the unit in compliance with a complete Acid Rain part application or a superseding Acid Rain part issued by the Department; and
 - (ii) Have an Acid Rain Part.

Monitoring Requirements

- (1) The owners and operators and, to the extent applicable, designated representative of each Acid Rain source and each Acid Rain unit at the source shall comply with the monitoring requirements as provided in 40 CFR part 75, and Rule 62-214.420, F.A.C.
- (2) The emissions measurements recorded and reported in accordance with 40 CFR part 75 shall be used to determine compliance by the unit with the Acid Rain emissions limitations and emissions reduction requirements for sulfur dioxide and nitrogen oxides under the Acid Rain Program.
- (3) The requirements of 40 CFR part 75 shall not affect the responsibility of the owners and operators to monitor emissions of other pollutants or other emissions characteristics at the unit under other applicable requirements of the Act and other provisions of the operating permit for the source.

Sulfur Dioxide Requirements

- (1) The owners and operators of each source and each Acid Rain unit at the source shall:
 - (i) Hold allowances, as of the allowance transfer deadline, in the unit's compliance subaccount (after deductions under 40 CFR 73.34(c)), or in the compliance subaccount of another Acid Rain unit at the same source to the extent provided in 40 CFR 73.35(b)(3), not less than the total annual emissions of sulfur dioxide for the previous calendar year from the unit; and
 - (ii) Comply with the applicable Acid Rain emissions limitations for sulfur dioxide.
- (2) Each ton of sulfur dioxide emitted in excess of the Acid Rain emissions limitations for sulfur dioxide shall constitute a separate violation of the Act.
- (3) An Acid Rain unit shall be subject to the requirements under paragraph (1) of the sulfur dioxide requirements as follows:
 - (i) Starting January 1, 2000, an Acid Rain unit under 40 CFR 72.6(a)(2); or
 - (ii) Starting on the later of January 1, 2000 or the deadline for monitor certification under 40 CFR part 75, an Acid Rain unit under 40 CFR 72.6(a)(3).
- (4) Allowances shall be held in, deducted from, or transferred among Allowance Tracking System accounts in accordance with the Acid Rain Program.
- (5) An allowance shall not be deducted in order to comply with the requirements under paragraph (1) of the sulfur dioxide requirements prior to the calendar year for which the allowance was allocated.
- (6) An allowance allocated by the Administrator under the Acid Rain Program is a limited authorization to emit sulfur dioxide in accordance with the Acid Rain Program. No provision of the Acid Rain Program, the Acid Rain part application, the Acid Rain part, or an exemption under 40 CFR 72.7 or 72.8 and no provision of law shall be construed to limit the authority of the United States to terminate or limit such authorization.
- (7) An allowance allocated by the Administrator under the Acid Rain Program does not constitute a property right.

Nitrogen Oxides Requirements The owners and operators of the source and each Acid Rain unit at the source shall comply with the applicable Acid Rain emissions limitation for nitrogen oxides.

Excess Emissions Requirements

- (1) The designated representative of an Acid Rain unit that has excess emissions in any calendar year shall submit a proposed offset plan, as required under 40 CFR part 77.
- (2) The owners and operators of an Acid Rain unit that has excess emissions in any calendar year shall:
 - (i) Pay without demand the penalty required, and pay upon demand the interest on that penalty, as required by 40 CFR part 77; and
 - (ii) Comply with the terms of an approved offset plan, as required by 40 CFR part 77.

Recordkeeping and Reporting Requirements

- (1) Unless otherwise provided, the owners and operators of the source and each Acid Rain unit at the source shall keep on site at the source each of the following documents for a period of 5 years from the date the document is created. This period may be extended for cause, at any time prior to the end of 5 years, in writing by the EPA or the Department:
 - (i) The certificate of representation for the designated representative for the source and each Acid Rain unit at the source and all documents that demonstrate the truth of the statements in the certificate of representation, in accordance with Rule 62-214.350, F.A.C.; provided that the certificate and documents shall be retained on site at the source beyond such 5-year period until such documents are superseded because of the submission of a new certificate of representation changing the designated representative;
 - (ii) All emissions monitoring information, in accordance with 40 CFR part 75, provided that to the extent that 40 CFR part 75 provides for a 3-year period for recordkeeping, the 3-year period shall apply;
 - (iii) Copies of all reports, compliance certifications, and other submissions and all records made or required under the Acid Rain Program; and

Plant Name (from Step 1) Seminole Generating Station
--

STEP 3,
Cont'd.

Recordkeeping and Reporting Requirements (cont)

(iv) Copies of all documents used to complete an Acid Rain part application and any other submission under the Acid Rain Program or to demonstrate compliance with the requirements of the Acid Rain Program.

(2) The designated representative of an Acid Rain source and each Acid Rain unit at the source shall submit the reports and compliance certifications required under the Acid Rain Program, including those under 40 CFR part 72 subpart I and 40 CFR part 75.

Liability.

(1) Any person who knowingly violates any requirement or prohibition of the Acid Rain Program, a complete Acid Rain part application, an Acid Rain part, or an exemption under 40 CFR 72.7 or 72.8, including any requirement for the payment of any penalty owed to the United States, shall be subject to enforcement pursuant to section 113(c) of the Act.

(2) Any person who knowingly makes a false, material statement in any record, submission, or report under the Acid Rain Program shall be subject to criminal enforcement pursuant to section 113(c) of the Act and 18 U.S.C. 1001.

(3) No permit revision shall excuse any violation of the requirements of the Acid Rain Program that occurs prior to the date that the revision takes effect.

(4) Each Acid Rain source and each Acid Rain unit shall meet the requirements of the Acid Rain Program.

(5) Any provision of the Acid Rain Program that applies to an Acid Rain source (including a provision applicable to the designated representative of an Acid Rain source) shall also apply to the owners and operators of such source and of the Acid Rain units at the source.

(6) Any provision of the Acid Rain Program that applies to an Acid Rain unit (including a provision applicable to the designated representative of an Acid Rain unit) shall also apply to the owners and operators of such unit. Except as provided under 40 CFR 72.44 (Phase II repowering extension plans) and 40 CFR 76.11 (NO_x averaging plans), and except with regard to the requirements applicable to units with a common stack under 40 CFR part 75 (including 40 CFR 75.16, 75.17, and 75.18), the owners and operators and the designated representative of one Acid Rain unit shall not be liable for any violation by any other Acid Rain unit of which they are not owners or operators or the designated representative and that is located at a source of which they are not owners or operators or the designated representative.

(7) Each violation of a provision of 40 CFR parts 72, 73, 75, 76, 77, and 78 by an Acid Rain source or Acid Rain unit, or by an owner or operator or designated representative of such source or unit, shall be a separate violation of the Act.

Effect on Other Authorities.

No provision of the Acid Rain Program, an Acid Rain part application, an Acid Rain part, or an exemption under 40 CFR 72.7 or 72.8 shall be construed as:

(1) Except as expressly provided in title IV of the Act, exempting or excluding the owners and operators and, to the extent applicable, the designated representative of an Acid Rain source or Acid Rain unit from compliance with any other provision of the Act, including the provisions of title I of the Act relating to applicable National Ambient Air Quality Standards or State Implementation Plans;

(2) Limiting the number of allowances a unit can hold; *provided*, that the number of allowances held by the unit shall not affect the source's obligation to comply with any other provisions of the Act;

(3) Requiring a change of any kind in any State law regulating electric utility rates and charges, affecting any State law regarding such State regulation, or limiting such State regulation, including any prudence review requirements under such State law;

(4) Modifying the Federal Power Act or affecting the authority of the Federal Energy Regulatory Commission under the Federal Power Act; or,


(5) Interfering with or impairing any program for competitive bidding for power supply in a State in which such program is established.

STEP 4

Certification

Read the
certification
statement, sign,
and date

I am authorized to make this submission on behalf of the owners and operators of the Acid Rain source or Acid Rain units for which the submission is made. I certify under penalty of law that I have personally examined, and am familiar with, the statements and information submitted in this document and all its attachments. Based on my inquiry of those individuals with primary responsibility for obtaining the information, I certify that the statements and information are to the best of my knowledge and belief true, accurate, and complete. I am aware that there are significant penalties for submitting false statements and information or omitting required statements and information, including the possibility of fine or imprisonment.

Name	Michael P. Opalinski	
Signature		Date 6/8/04

Florida Department of Environmental Protection

Phase II NO_x Compliance Plan

For more information, see instructions and refer to 40 CFR 76.9

This submission is:

☐ New ☒ Revised

Page 1 of 3

STEP 1 Indicate plant name, state, and ORIS code from NADB, if applicable.	Seminole Generating Station Plant Name	FL State	000136 ORIS Code
STEP 2	Identify each affected Group 1 and Group 2 boiler using the boiler ID# from NADB, if applicable. Indicate boiler type: "CB" for cell burner, "CY" for cyclone, "DBW" for dry bottom wall-fired, "T" for tangentially fired, "V" for vertically fired, and "WB" for wet bottom. Indicate the compliance option selected for each unit.		

ID#	ID#	ID#	ID#	ID#	ID#
U01	U02				
Type	Type	Type	Type	Type	Type
DBW	DBW				

(a) Standard annual average emission limitation of 0.50 lb/mmBtu (for Phase I dry bottom wall-fired boilers)

☒ ☒ ☐ ☐ ☐ ☐

(b) Standard annual average emission limitation of 0.45 lb/mmBtu (for Phase I tangentially fired boilers)

☐ ☐ ☐ ☐ ☐ ☐

(c) EPA-approved early election plan under 40 CFR 76.8 through 12/31/07 (also indicate above emission limit specified in plan)

☒ ☒ ☐ ☐ ☐ ☐

(d) Standard annual average emission limitation of 0.46 lb/mmBtu (for Phase II dry bottom wall-fired boilers)

☐ ☐ ☐ ☐ ☐ ☐

(e) Standard annual average emission limitation of 0.40 lb/mmBtu (for Phase II tangentially fired boilers)

☐ ☐ ☐ ☐ ☐ ☐

(f) Standard annual average emission limitation of 0.68 lb/mmBtu (for cell burner boilers)

☐ ☐ ☐ ☐ ☐ ☐

(g) Standard annual average emission limitation of 0.86 lb/mmBtu (for cyclone boilers)

☐ ☐ ☐ ☐ ☐ ☐

(h) Standard annual average emission limitation of 0.80 lb/mmBtu (for vertically fired boilers)

☐ ☐ ☐ ☐ ☐ ☐

(i) Standard annual average emission limitation of 0.84 lb/mmBtu (for wet bottom boilers)

☐ ☐ ☐ ☐ ☐ ☐

(j) NO_x Averaging Plan (include NO_x Averaging form)

☐ ☐ ☐ ☐ ☐ ☐

(k) Common stack pursuant to 40 CFR 75.17(a)(2)(i)(A) (check the standard emission limitation box above for most stringent limitation applicable to any unit utilizing stack)

☐ ☐ ☐ ☐ ☐ ☐

Seminole Generating Station
Plant Name (from Step 1)

STEP 2, cont'd.

ID#	ID#	ID#	ID#	ID#	ID#
U01	U02				
Type	Type	Type	Type	Type	Type
DBW	DBW				

(l) Common stack pursuant to 40 CFR 75.17(a)(2)(I)(B) with NO_x Averaging (check the NO_x Averaging Plan box and Include NO_x Averaging Form)

☐ ☐ ☐ ☐ ☐ ☐

(m) EPA-approved common stack apportionment method pursuant to 40 CFR 75.17 (a)(2)(I)(C), (a)(2)(III)(B), or (b)(2)

☐ ☐ ☐ ☐ ☐ ☐

(n) AEL (Include Phase II AEL Demonstration Period, Final AEL Petition, or AEL Renewal form as appropriate)

☐ ☐ ☐ ☐ ☐ ☐

(o) Petition for AEL demonstration period or final AEL under review by U.S. EPA or demonstration period ongoing

☐ ☐ ☐ ☐ ☐ ☐

(p) Repowering extension plan approved or under review

☐ ☐ ☐ ☐ ☐ ☐

STEP 3

Read the standard requirements and certification, enter the name of the designated representative, sign and date.

Standard Requirements

General. This source is subject to the standard requirements in 40 CFR 72.9 (consistent with 40 CFR 76.8(e)(1)(i)). These requirements are listed in this source's Acid Rain Part of its Title V permit.

Special Provisions for Early Election Units


Nitrogen Oxides. A unit that is governed by an approved early election plan shall be subject to an emissions limitation for NO_x as provided under 40 CFR 76.8(a)(2) except as provided under 40 CFR 76.8(e)(3)(iii).

Liability. The owners and operators of a unit governed by an approved early election plan shall be liable for any violation of the plan or 40 CFR 76.8 at that unit. The owners and operators shall be liable, beginning January 1, 2000, for fulfilling the obligations specified in 40 CFR Part 77.

Termination. An approved early election plan shall be in effect only until the earlier of January 1, 2008 or January 1 of the calendar year for which a termination of the plan takes effect. If the designated representative of the unit under an approved early election plan fails to demonstrate compliance with the applicable emissions limitation under 40 CFR 76.5 for any year during the period beginning January 1 of the first year the early election takes effect and ending December 31, 2007, the permitting authority will terminate the plan. The termination will take effect beginning January 1 of the year after the year for which there is a failure to demonstrate compliance, and the designated representative may not submit a new early election plan. The designated representative of the unit under an approved early election plan may terminate the plan any year prior to 2008 but may not submit a new early election plan. In order to terminate the plan, the designated representative must submit a notice under 40 CFR 72.40(d) by January 1 of the year for which the termination is to take effect. If an early election plan is terminated any year prior to 2000, the unit shall meet, beginning January 1, 2000, the applicable emissions limitation for NO_x for Phase II units with Group 1 boilers under 40 CFR 76.7. If an early election plan is terminated on or after 2000, the unit shall meet, beginning on the effective date of the termination, the applicable emissions limitation for NO_x for Phase II units with Group 1 boilers under 40 CFR 76.7.

Certification**STEP 3, cont'd.**

I am authorized to make this submission on behalf of the owners and operators of the affected source or affected units for which the submission is made. I certify under penalty of law that I have personally examined, and am familiar with, the statements and information submitted in this document and all its attachments. Based on my inquiry of those individuals with primary responsibility for obtaining the information, I certify that the statements and information are to the best of my knowledge and belief true, accurate, and complete. I am aware that there are significant penalties for submitting false statements and information or omitting required statements and information, including the possibility of fine or imprisonment.

Name	Michael P. Opalinski	
Signature		Date 6/29/04

Subject:

UNIT COLD START-UP/SUPERHEAT BOIL OUT

Section:

EQUIPMENT OPERATION PROCEDURE

This procedure is to be followed for cold start-ups of the unit. If it is necessary to deviate from this procedure, OA-1 SHALL be followed.

CAUTION: U-2 has an ABB sliding pressure live steam pressure controller. This controller must have its set point adjusted prior to placing the unit on the line to avoid inadvertent trips from the live steam pressure controller coming into action.

- ____ 1. Verify all necessary clearances released, confined space logs have been signed off, and jumper/lifted lead log has been reviewed and cleared of any inappropriate jumpers/lifted leads.
- ____ 2. Verify from the condensate system checklist that the condensate system is lined up and ready for service with condensate polishers by-passed.
- ____ 3. Verify circulating water system is in service with two pumps in operation.
- ____ 4. Have condensate storage tank water quality checked by lab. Fill hotwell to normal level and drain to waste. If hotwell had not been drained, drain and refill to normal level. Restart condensate system.
 - ____ 4.1 Ensure there are adequate levels in the ammonia and carbonylhydrazide chemical addition tanks. If tanks are low, a normal charge of 7 bolts in the sight glass of the charge tank mixed with 1/2 tank of condensate in the chemical addition tank for ammonia, and 4 bolts in the sight glass of the charge tank mixed with 1/2 tank of condensate in the chemical addition tank for carbonylhydrazide should be added.
- ____ 5. The dewatering system should be ready to receive waste slurry from the FGD and to send return supernate to the supernate tank in the FGD area.
 - ____ 5.1 Start the service water booster pump using the selector switch. If the required water pressure at the battery limit of the SW booster pump is available, and the manual suction and discharge valves are in the "open" position, the pump will start.
 - ____ 5.2 Place the waste slurry-supernate return loop in service.

Subject:

UNIT COLD START-UP/SUPERHEAT BOIL OUT

Section:

EQUIPMENT OPERATION PROCEDURE

- _____ 5.2.1 Contact EPF to have their return pump placed in service.
- _____ 5.2.2 Place the supernate pump selector switch in the "Start" position. If the low-level sensing switch (LSL 0702) is satisfied and the EPF return tank level is adequate, the pump will start.
- _____ 5.3 Reagent Slurry Loop Start-Up
- _____ 5.3.1 Place the reagent slurry transfer pump selector switch in the "Start" position. If the level of the reagent storage tank satisfies the low level condition, the pump will start.
- _____ 5.3.2 Have the Support Systems Operator verify good return flow of reagent back to the reagent storage tank.

NOTE: Step 6 below may be omitted if D.A. has not been drained.

- _____ 6. With polisher vessels by-passed, fill the D.A. to normal level with one condensate pump and the D.A. level control by-pass valve. Keep remaining condensate pumps in pull-to-lock. shut down the condensate pump (pull-to-lock) and drain the D.A. to waste through the hotwell. Drain hotwell and refill to normal level. Restart condensate system.
- _____ 7. With polisher vessels by-passed, fill D.A. to high level as in Step 5 while maintaining hotwell level. Begin the condensate loop flow through D.A. high level dump to hotwell. It may be necessary to bleed condensate to waste (hotwell drain) and make-up from the condensate storage tank to lower iron oxide reading to <2000 ppb. If condensate flow is stable, controls may be placed in automatic.
- _____ 8. HD270 and LCV625 bypass should be opened to ensure adequate flow through D.A. flow loop. Also ensure the D.A. belly drain is open to drain any sediment. This line-up is to remain this way until unit is on bypass.
- _____ 9. When condensate pump discharge iron oxide is less than 2000 ppb, specific conductivity is less than 20 mmho, the chloride is less than 1 mg/l, (verified by lab personnel) place one polisher vessel in service. Change to clean vessel as

Subject:

UNIT COLD START-UP/SUPERHEAT BOIL OUT

Section:

EQUIPMENT OPERATION PROCEDURE

necessary.

- _____ 10. With adequate chemistry bypass polishers prior to filling boiler. Place one carbohydrazide pump in service and adjust feed rate with manual loader (1-HK-4039) until #3 F.W. heater discharge carbohydrazide residue is 40-100 ppb. Place one ammonia pump in service and adjust feed rate with manual loader (1-CCC-4038) until #3 F.W. heater discharge specific conductivity is 2.5 to 5.0 mmho or pH 8.5 – 9.3.
- _____ 11. If available, cross tie the auxiliary steam system in order to seal the turbine and pull vacuum on condenser. This will help remove dissolved oxygen from the condensate which helps prevent iron build-up in the preboiler piping and boiler. Ensure vacuum breakers have seal water.
 - _____ A. Place the gland steam function group “on”.
 - _____ B. Place lube oil and jacking oil function group “on” lube oil 70-100°F.
 - _____ C. Establish seal oil.
 - _____ D. Check turbine oil and EHC fluid tank levels.
 - _____ E. Put main turbine on turbine gear.
 - _____ F. Check valving for exhaust hood sprays.
 - _____ G. Ensure all charts/recorders are in service.

NOTE: If cross tied, this will add steam to the unit that is starting up, thus causing the hotwell level to increase. If start-up is delayed for an abnormal period, untie the units when pressure is adequate.

- _____ 12. When condensate polisher effluent reading is down to 100 ppb iron oxide, the water quality is sufficient to be used in the boiler.
- _____ 13. A. Check start **ALL** auxiliary lube oil pumps, I.D., F.D., P.A., ball mills, etc.

Subject:

UNIT COLD START-UP/SUPERHEAT BOIL OUT

Section:

EQUIPMENT OPERATION PROCEDURE

- _____ B. Check for any problems.
- _____ C. Leave either all "A": or all "B" pumps in service.
- _____ D. Place B.F.P.s on T.G. and open HMV-1301 bypass valve.
- _____ 14. Verify the "pre-fire" requirements are completed by the control room, unit and auxiliary operator checklists.
- _____ 15. When adequate vacuum is achieved, reset main turbine and L.P. bypass. (To locate any problems)
- _____ 16. Open bypass on polisher to allow more chemicals to boiler. Contact laboratory personnel prior to filling boiler. Have lab verify proper concentration of ammonia and carbonylhydrazide as boiler is filled. (pH 8.5 – 9.3, conductivity 2.5 – 5.0 umho carbonylhydrazide 40-100 ppg). Fill the boiler using the boiler fill line off of the condensate pump discharge header to 5 ports. Verify locally at drum and
compare
with control room indication. Drain drum level back down (3 ports) for firing and verify level locally at drum. Have lab check iron level, at water wall drains, should be (<2000 ppb).
- _____ 17. Start air preheaters, and open secondary air inlet and outlet and gas inlet and
outlet
dampers.
- _____ 18. Verify clear path for air flow from fans to stack utilizing the FGD system bypass.
- _____ 19. Place one ID fan in service and one FD fan in service maintaining furnace draft at – ½". Place in service ID fan in "AUTO."
- _____ 20. Place second ID fan in service and second FD fan in service maintaining furnace draft at – ½". Parallel in service ID fans and place the second ID fan in "AUTO."

NOTE: If problems are encountered in starting the second ID or FD, do not delay startup. Proceed with the startup sequence while attempting to start the second set of fans. One set of fans is adequate to initially fire boiler and

synchronize generator. Normally, #1 or #2 ID is started with #1 FD and #3 or #4 ID is started with #2 FD. This is for even flow through precipitators.

_____ 21. Parallel FD fans and raise air flow to 2.2 million LB/hr. Verify the air flow MFT signal and air flow <30% alarm clear as air flow is increased.

_____ A. Parallel running amps on FD Fans using BOMAR and 6.9kv breaker indications. As air flow increases throughout the start-up, maintain balanced fan amps. If amps are balanced, and there is an indicated discrepancy of >5% with blade pitch positions, contact Mech. Maint. and/or I&C for proper operation or correction. Compare and verify blade pitch position locally with the operator.

This step shall be followed and maintained throughout the unit start-up, as well as when the unit is on line. When the FD Fans are in "auto", and a bias of >5% is needed to balance the amps between fans, this could be an indication of APH pluggage, or other air flow restrictions. This is especially important between outages when there is a possibility of a potential APH wash needed. Early detection of APH pluggage is important so that some corrective action can be taken.

_____ 22. Start tertiary air fans and a scanner fan. Place redundant fans in standby.

NOTE: Contact lab personnel when ready to light off ignitors.

_____ 23. Start one ignition oil pump.

_____ 24. Select "BYPASS" mode on turbomat prior to boiler purge.

_____ 25. Depress the purge start button on the Forney panel. If all permissives are met, the 5 minute purge will begin. Purge permissives are:

_____ A. Air heaters in service.

_____ B. FD & ID fans in service.

_____ C. All mills and feeders stopped.



Issue Date: 01/19/2004	Page 6 of 15
Approved By: Ron Waugh	Number: EO-2 R9

Subject: UNIT COLD START-UP/SUPERHEAT BOIL OUT	Section: EQUIPMENT OPERATION PROCEDURE
--	--

- _____ D. All burner shut-off dampers closed.
- _____ E. Ignitor trip valve closed.
- _____ F. No primary air fan funning.
- _____ G. No flame detected.
- _____ H. 80% burner air registers to light off position.
- _____ I. Both reheat and economizer pass dampers open.
- _____ J. Full air flow path established.
- _____ K. Tertiary air fans in service.
- _____ L. All precipitators tripped.
- _____ M. All ignition oil valves closed.
- _____ N. All P.A.S.O. dampers closed.
- _____ O. Furnace pressure in limits.
- _____ P. All auxiliary air dampers closed.
- _____ Q. All S.A.S.O. dampers closed.
- _____ R. No boiler trip cond. present.
- _____ S. Precipitator seal air fans running.
- _____ T. Primary air dampers closed.
- _____ U. Scanner cooling fan running.

Subject:
UNIT COLD START-UP/SUPERHEAT BOIL OUT

Section:
EQUIPMENT OPERATION PROCEDURE

V. Air flow >25% <40%.

CAUTION: Station an operator on the lower burner decks to check for oil leaks before opening ignitor trip valve. The initial placing of ignitors in service will require an operator present to identify any oil leaks.

27. When purge is complete, open the ignitor trip valve. When oil pressure is stabilized, place ignitors in service associated with mills 5 and 6. This operation **SHALL** be observed locally so that visual observation of flames may occur. The local operator **SHALL** monitor ignitor fires and make adjustments as necessary to reduce smoke from oil guns and optimize opacity until 2 pulverizers are in service.
 - A. MFT and IFT relays reset when the ignitor trip valve opens.
 - B. Maintain drum level within limits and air flow above 25%.
28. Close R.H. damper to approximately 25%, since there is not flow yet in the R.H. section.
29. Open the continuous blowdown 100% and use the boiler fill line from the condensate discharge header to maintain drum level in limits. If proper firing rate is held and blowdown controlled, -5" in drum is enough water, due to swelling.
30. Line up dampers and auxiliary equipment and start the primary air fans. Do not load fans at this time. Load when placing ball mills in service.
31. Verify three air compressors in service. Start the air heater blowing sequence using steam as the blowing medium, if the aux steam is cross tied. If not, use compressed air.
32. Firing rate must be controlled so as not to exceed 200°F between top and bottom drum metal temperature and 1000°F gas temperature on thermoprobes. The pass dampers will allow some flexibility in controlling temperatures. Computer points for drum metal temps are: Unit 1 BT1007 through BT1016, AT⁵ BC1003 through BC1007, Unit 2 BT20076 through BT2016, AT⁵ BC2003 through BC2007.

Issue Date: 01/19/2004	Page 8 of 15
Approved By: Ron Waugh	Number: EO-2 R9

Subject: UNIT COLD START-UP/SUPERHEAT BOIL OUT	Section: EQUIPMENT OPERATION PROCEDURE
--	--

- _____ 33. Jog down #7 F.W. heater outlet valve to approximately 5% open, and open #7 heater extraction M.O.V. from cold reheat 100%. This is to help preheat feedwater and minimize L.P. bypass flow into the condenser (efficiency). If unable to jog down #7 R.W. heater, then jog down #8 F.W. heater outlet M.O.V. Jogging down is to assure S.H. sprays, when necessary. If #8 is jogged down, still have #7 in service.
- _____ 34. If units were not cross tied on auxiliary steam system, the open the auxiliary steam supply valve to allow the auxiliary steam line to warm up with the boiler and to prevent a drum level excursion if opened later.
- _____ 35. Open the pegging steam valve to the D.A.
- _____ 36. When 25 lbs. of drum pressure is attained, close the drum and superheater vents. Verify the "25 PSI drum pressure requirements" have been completed per the control room, unit and auxiliary operator boiler checklist. Add ignitors to increase firing rate up to the limit for T on steam drum, or 1000°F probe limit.
- _____ 37. At approximately 150 PSI drum pressure, the drum level will start to rise (swell). It may be necessary to utilize the mass blowdown to maintain drum level within limits. Firing rate can also be manipulated to control this.
- _____ 38. When 250 PSI drum pressure is attained, place the No. 3 boiler feed pump in service and close the condensate boiler fill valve. The mass blowdown should be opened to 50% at this time, and remain there, until turbine bypass operation for sufficient flow to control drum level. If adequate drum level control is attained, the No. 3 boiler feed pump may be placed on automatic. If a T.D.B.F.P. is used, operate with recirc. 100% open in manual until pump is working hard enough to keep turbine exhaust from overheating. Drum pressure might need to be higher if a T.D.B.F.P. is utilized.
- _____ 39. If boiler drum blowdown pH (1-XR-4042) is between 8.3 and 9.2, iron oxide is less than 200 ppb, and specific conductivity (1-CJR-4044) is between 2.5 and 3.5 mmho, continue increasing drum pressure as required. Lab personnel should provide hourly readings.

Subject:

UNIT COLD START-UP/SUPERHEAT BOIL OUT

Section:

EQUIPMENT OPERATION PROCEDURE

- _____ 40. Condensate flow should be sufficient to place the DA level control valve on automatic as well as hotwell make-up valves.
- _____ 41. If boiler drum blowdown pH (1-XR-4042) is below 8.3, iron oxide is greater than 200 ppb, or specific conductivity (1-CJR-4041) is greater than 3.5 mmho due to ionic contamination, alternately open and close the boiler bottom drains for 30 seconds on each valve (not to exceed drum level limitations) between 400 PSI and 800 PSI drum pressure.

CAUTION: DO NOT BLOWDOWN USING BOILER BOTTOM DRAINS WHEN PRESSURE IS OVER 800 PSI.

- _____ 42. Keep continuous boiler drum blowdown valve 100% open until water quality permits reduced blowdown rate. Mass blowdown is to be closed when unit is stable on bypass, unless water quality/lab deems it necessary to do otherwise.
- _____ 43. If vacuum was not pulled earlier, place the turbine gland steam function group in the "ON" position. This will open the drain on the gland steam header and start the warm-up period. Gland steam function group can be placed in stop-manual, and open drain manually also.
- _____ 44. As soon as the temperature is adequate for the gland steam function group (superheat >90°F and aux. steam >446°F) the supply valve will open.
- _____ 45. Ensure vacuum breakers are closed and have seal water on them, then start two vacuum pumps to establish vacuum.
- _____ 46. When vacuum is established, reset the LP bypass system. Verify the LP stop valves open (7" to 5" Hg). Check that LP bypass spray water is valved in. Should not reset without adequate spray water. Also reset the main turbine and verify the HP and IP stop valves open.
- _____ 47. Initiate a pre-bypass checklist and rest H.P. bypass, if tripped.
- _____ 48. At 400 psi start pressurizing and warming the electromatic power relief valves

by slowly opening the bypass valves on both isolation valves. The relief valves must be warmed for at least 30 minutes prior to operating.

At 500 psi have the electromatics valved in. Then test them one at a time approximately 5 to 10 seconds. Be prepared for a sharp increase in drum level when this is done.

- _____ 49. P.A. fans will need to be loaded at this time. Have the first mill in service when boiler pressure reaches 500 psig. Verify there is no coal laying out in burners. Start one of the lower ball mills.
- _____ 50. Just prior to opening the Paso on the first mill, open the H.P. bypass 10% manually. Control HP bypass discharge temperature at 650°F. Open the Paso on the in-service mill and start the coal feeders. Establish and maintain normal mill level and temperature. Continue to monitor and control steam drum T. Fire mill lightly until 600 psi is achieved (M.S.). Ensure H.P. warm-up valves open 100%.

NOTE: Opening of HP bypass valves will cause drum level to go high if opened too much. Do not close the HP bypass valves while on manual control or a MFT will occur.

- _____ 51. Notify Support Systems operators to place electrostatic precipitators in service when coal fire is visually verified in the furnace.
- _____ 52. Increase firing rate (not to exceed limitations in step 31) and increase opening of HP bypass valves to increase steam flow while allowing pressure to slowly increase as well.
- _____ 53. When coal fires are established, it is necessary to utilize the superheat sprays to control main steam temperature at or below 750°F.
- _____ 54. When boiler pressure reaches 1200 PSI and HP bypass should be approximately 50% open (480,000 to 500,000 lb/hr).
- _____ 55. Set the HP bypass setpoint at 1200 PSI and place the HP bypass valves on automatic.

Subject:

UNIT COLD START-UP/SUPERHEAT BOIL OUT

Section:

EQUIPMENT OPERATION PROCEDURE

- _____ 56. Place the reheat and superheat pass dampers on automatic with R.H. setpoint at 700°F (115 psi @ 700°F = 361.92° Sh).
- _____ 57. Verify the “10% steam flow” requirements have been completed per the control room, unit and auxiliary operators boiler checklists.
- _____ 58. Place the second bottom elevation coal mill in service with 4 burners in service after purging coal conduits. If lower mill is unavailable, mills 2 or 4 can be utilized.

NOTE: This may cause drum level to swell rapidly. Use method as noted in Step 49. Have the absorber liquid side on three (3) modules in service.

- _____ 59. Increase firing rate until thermal megawatts are approximately 130 as indicated on the L&N master panel.

NOTE: Steam flow should then be greater than 10% and the HP bypass approximately 90% open.

- _____ 60. Increase firing rate until:
 - _____ A. Thermal megawatts approx. 130 MW.
 - _____ B. Throttle pressure approx. 1200.
 - _____ C. Main steam temperature 750°, R.H. temperature @ 700°F.
 - _____ D. HP bypass open approx. 90% to 100%.
 - _____ E. All conditions under control.
 - _____ F. Boiler/manual control mode.
- _____ 61. All F.W. controls should/could be in auto at this time.
- _____ 62. When the O₂ is below 10%, the scrubber modules should be put into service by notifying the Support Systems Control Room Operator.

Subject:

UNIT COLD START-UP/SUPERHEAT BOIL OUT

Section:

EQUIPMENT OPERATION PROCEDURE

- _____ 63. Verify all turbine drains open, oil temperature 85 to 110°F, >40 PSI header pressure, and stator cooling system in service, and generator H₂ pressure at 65 lbs. minimum.
- _____ 64. Select "IDLE" mode on the turbomat panel. (Turbine should have been on turning gear at least 4 hours prior to rolling.) Main steam temperature may have to be increased to provide permissive to roll turbine.
- _____ 65. Roll the turbine up to 500 RPM and hold for approximately 20 minutes. Check the turbine/generator for rubbing, vibration, oil flow, etc.
- _____ 66. Roll the turbine up to 1200 RPM and hold for approximately 20 minutes checking the turbine/generator conditions as above. (Check that turning gear motor has stopped >800 RPM.) Hold at 1200 RPM until HP probe shows a decreasing trend. Begin procedure for starting next (3rd) mill (2 or 4). 3rd mill should be available for service just before synchronization.
- _____ 67. Roll the turbine up to 3600 RPM. The control system will roll the turbine up at a rate allowed by the HP and IP probes. 30/min. Check all turbine/generator supervisory instrumentation as well as local checks.

NOTE: Roll time will be approximately 2 hours from initial roll to rated speed. When 3600 RPMs is reached, notify dispatcher of intentions to synch. and tie.

- _____ 68. When the turbine reaches 3600 RPM, select "LOAD" mode on turbomat, close the generator field breaker. Observe that generator terminal voltage increases, and
is matched with grid voltage.

NOTE: If load mode is selected early, the synchronization mode times out (640 seconds) before the Unit can tie on in the auto mode. Load mode should be selected when ready to tie-on.

- _____ 69. Set the target load at 100 MWS and the load gradient at 25 MWS/MIN.

Subject:

UNIT COLD START-UP/SUPERHEAT BOIL OUT

Section:

EQUIPMENT OPERATION PROCEDURE

- _____ 70. Remove one of the switches for the generator OCBs (either 8W30 or 8W40) from the pull-to-lock position to the green flag position (normal after trip position).
- _____ 71. Unlock the sync. switch for the corresponding breaker taken out of pull-to-lock in step #69. Turn the spring loaded sync. switch all the way to the "auto on" position and let it return to the "auto" position. The "auto" sync. circuit should automatically adjust the generator voltage to match the line voltage on the grid and the frequency. **THIS IS TO BE VERIFIED**. The selected OCB will not auto close in the "GREEN FLAG" position (normal after trip position). When frequency and voltage are matched, as the sync. scope is moving in the clockwise direction the selected OCB control switch is to be placed in the "RED FLAG" position **only** when the sync. scope is between the 10 o'clock and 12 o'clock position. If the OCB doesn't auto close between 10 o'clock and 12 o'clock it is to be placed back in the "GREEN FLAG" position until the sync. scope is moving clockwise and between 10 o'clock and 12 o'clock. Verify a breaker close signal is being sent by observing the synchronization red lamp illuminates in pulse fashion when the synchroscope pointer is between the 10 o'clock and 12 o'clock position. The OCB control switch should **never** be in the "RED FLAG" position unless these conditions exist or the OCB is close in. Upon synchronization, zero vars. (Do not totally depend on automatic mode!) If unable to sync. in auto, take the sync. switch for the corresponding breaker taken out of pull-to-lock in step 69, and turn the sync. switch to manual. Use the frequency controller to adjust cycles so that the sync. scope starts slowly turning in a clockwise direction. Re-verify that generator voltage and grid voltage are still matched. When the sync. scope indication is at 11 o'clock and approaching 12 o'clock, close the pre-selected OCB. Zero VARs.
- _____ 72. Verify unit load comes up to the target load set value that was set in step #68.
- _____ 73. Place F.W. heaters 1-6 and #8 in service. Place steam driven B.F.P. in service, if #3 B.F.P. is in service.
- _____ 74. Turn the selected sync. switch off. Unlock the other sync. switch and close the corresponding generator breaker.
- _____ 75. At this point the IP probe will probably be limiting. With this condition, most of

Subject:

UNIT COLD START-UP/SUPERHEAT BOIL OUT

Section:

EQUIPMENT OPERATION PROCEDURE

the steam will be by-passing the IP and LP turbines. The firing rate will be higher than normal at this low load. The HP bypass must remain in "AUTO" and in service during this time.

- _____ 76. If the bypass is closing to a point of closing off, it may be necessary to increase the firing rate. This is accomplished by manually raising the air flow and fuel flow.

When the IP probe is no longer limiting start picking up load using the target load set value on the turbotrol panel. Set the load gradient at 5 MWS/MIN. Load increases should be approximately 25 MW intervals.

- _____ 77. Close boiler and turbine drains. Downstream valves first, then all root valves.

NOTE: Do not select turbine follow mode if the HP bypass is still open.

- _____ 78. Continue increasing firing rate and load slowly, keeping H.P. bypass approximately 25% open for pressure control. Increase pressure as allowed by lab.

- _____ 79. Transfer station service when load is >200 mw.

- _____ 80. When unit is stable at 250 MW, increase the target load set value, slightly, which will cause the H.P. bypass to close slowly. (Note: The H.P. bypass setpoint will have to be increased to a higher setpoint than throttle pressure setpoint, to prevent H.P. bypass from opening unnecessarily.) Re-correct target load set value, or firing rate, to re-stabilize unit. Unit still in boiler manual/turbine base, TT42, @ 250 MW. Match throttle pressure control setpoint with actual pressure, and select turbine follow mode only. Boiler base should only be selected after feedwater temperature is constant.

- _____ 81. When unit is stabilized at 2200 PSI throttle pressure (HP bypass setpoint at 2425 PSI) raise unit load to 300 MWS while placing another mill in service to accommodate the needed firing rate.

NOTE: Throttle pressure kept down to 2200 to ensure the L.P. bypass will not come into service.

Issue Date: 01/19/2004	Page 15 of 15
Approved By: Ron Waugh	Number: EO-2 R9

Subject: UNIT COLD START-UP/SUPERHEAT BOIL OUT	Section: EQUIPMENT OPERATION PROCEDURE
--	--

- _____ 82. When unit is at 300 MWS it will be necessary to place the other boiler feed pump turbine in service. Once the second pump is in service the loading should be approximately equal and the second pump placed on automatic.

NOTE: The second pump should be brought into service slowly allowing the already in service pump to decrease automatically while maintaining drum level.

- _____ 83. At 300 MWS all essential equipment should be in service to allow unit load capability throughout the entire load range. Equipment that is not required at this time should be in a "ready for service" type of condition. Also, throttle pressure can be increased to 2400 PSI if chemistry allows.

- _____ 84. The generator hydrogen pressure should be at the 75 lb. maximum pressure.

- _____ 85. Notify the dispatcher the unit is available for system load requirements within the 300 to 650 MW range.

NOTE: Any known restrictions that would prevent the unit from attaining full load (650 MWS) capability should be reported to the dispatcher at this time, or earlier, and logged on the derate information form.

Issue Date: 01/08/04	Page 1 of 9
Approved By: Ron L. Waugh	Number: EO-16 R3
Subject: UNIT SHUT DOWN	Section: EQUIPMENT OPERATING PROCEDURE

1.0 PURPOSE

To provide an approved operating procedure for removing a unit from on-line status to off-line status for outage work.

2.0 SCOPE

This operating procedure will outline steps to be taken from full load operation to off-line/turning gear operation.

3.0 SKILL LEVEL

When performing this task, it will require no less than the proficiency of a Control Room Operator, Unit Operator and Auxiliary Operator.

4.0 RESPONSIBILITIES

It shall be the responsibility of the Control Room Operator to perform the following:

- 4.1 Ensure the Unit is maintained in a stable condition throughout all load drops to off-line status.
- 4.2 Ensure all equipment is removed from service and secured properly in a timely manner.
- 4.3 Ensure that all required permissive and logics are met as required when reducing load and removing Unit from the grid.
- 4.4 Ensure that the shutdown procedure is followed throughout its entirety. Should any deviation be required, authorization from the Shift Supervisor must be obtained first. Exception to this rule is (1) safety to personnel or equipment or (2) if stipulated in this procedure, authorizing deviation without prior approval.
- 4.5 Maintain an open communication with all departments involved at ALL times.

5.0 REMOVING THE UNIT FROM SERVICE

Subject:
UNIT SHUT DOWN

Section:
EQUIPMENT OPERATING PROCEDURE

NOTE 1: Assume Unit is at 650 MWs, 5 and 2/3 mills in service, 2400 psi throttle pressure, 1000 degrees main steam temperature, 4 ID fans in service and associated modules for full load requirements.

NOTE 2: Upon notice of Unit being removed from service, clean the boiler of slag with the sootblowing system. It will require approximately 5 hours to complete the cleaning process using all blowers.

5.1 Select DEB/LFC or DEB/TB mode at a 5 MW a minute ramp rate. Deviation to ramp rate is authorized to accommodate state load requirements. Deviation from Boiler/Turbine modes is also authorized if they are not available or stable.

5.1.1 Verify that the in-service ignition oil tank has a level greater than 15'.

5.2 Begin decreasing MWs (load) at the given ramp rate. As load is reduced, slide pressure to maintain turbine valve position at no less than 90% valve position. Large load drops may result in a valve position less than 90%. Continue sliding pressure after load drop until 90% or greater turbine valve position is achieved. This valve position is to maintain steam flow velocities to assist in cooling the turbine/boiler. This accelerated flow rate will aid in control of steam temperatures at lower loads.

5.3 Reduce the Main steam and Hot Reheat steam temperature set points to a degree not to exceed the minimum BBC requirements. BBC requires no less than 150 degrees of steam temperature above saturation point being admitted to the turbines. (Reference Steam Tables)

5.4 Reducing thermal MWs for load reduction is done by removing fire power, i.e., mills from service. Dependent upon related outage repair requirements when removing a mill from service, stripping and/or emptying the silo may be required. If there is not any related outage work to be performed, the CRO will remove the mill from service by the normal accepted practice.

5.5 Repairs requiring the silo to be emptied will require at least twelve hours advanced notice. This will give adequate time for pre-planning to ensure that the silo is prepared properly allowing repairs to be performed during unit shut down.

Subject:

UNIT SHUT DOWN

Section:

EQUIPMENT OPERATING PROCEDURE

NOTE: When and at what load to remove fire power is at the discretion of the Control Room Operator. Unit fire power configuration is dictated by the mills and burners available for use. Another determining factor is the need introduced by pre-planning as to which mill is removed from service first and in what desired order.

6.0 LOAD REDUCTION

- 6.1** Reduce load by reducing fire power from the upper mills first. Remove the upper mills, if able: first, Mill #1 and then Mill #3.
- 6.2** When dropping load, constant monitoring of the HP/IP probes is required. There is an expected deflection to occur to the probes. The probes are expected to respond by indicating 50% towards the negative direction on the probe chart. This is acceptable. However, sharp increases in position (spikes) or an elevated percentage above 65% will require the immediate attention of the Control Room Operator.
- 6.3** Monitor throttle pressure and drum pressures frequently. These pressures must remain stable. Unstable throttle or drum pressures will not be conducive of a controlled shutdown.
- 6.4** Monitor main steam temperature vigilantly throughout all load reductions and constant conditions. Main steam temperature becomes increasingly difficult to maintain at a steady rate as low load and low flow conditions become realized.
- 6.5** UNIT STATUS:
 - 6.5.1** LOAD AT 580 MWS.
 - 6.5.2** THROTTLE PRESSURE 2300 PSI APPROXIMATELY.
 - 6.5.3** FIVE MILLS IN SERVICE.
 - 6.5.4** MAIN STEAM TEMPERATURE 950 DEGREES AND APPROXIMATELY 300 DEGREES SUPERHEAT.

Subject:

UNIT SHUT DOWN

Section:

EQUIPMENT OPERATING PROCEDURE

6.5.5 FOUR ID FANS IN SERVICE.

6.5.6 FOUR MODULES IN SERVICE.

6.6 Remove one of the four ID Fans from service as soon as load conditions permit. This will allow Supports to remove one module from service as long as logics are met.

6.7 Have the Unit Operator verify that the hood sprays are lined up for service.

6.8 Place the Start Up Boiler Feed Pump in service. Do not initiate any increases to the pump output at this time, i.e., feed pump discharge being placed into the feedwater header. Placing the Start Up Boiler Feed Pump in service is only to ensure pump operation. Placing the pump in service at this time will supply ample time for check out and field repairs if any are needed.

6.9 UNIT STATUS:

6.9.1 450 MWS.

6.9.2 FOUR MILLS IN SERVICE.

6.9.3 THROTTLE PRESSURE AT 1800 PSI.

6.9.4 MAIN STEAM TEMPERATURE 900 DEGREES, SUPERHEAT STEAM 270 DEGREES.

6.9.5 THREE ID FANS IN SERVICE.

6.9.6 THREE MODULES IN SERVICE.

NOTE: To obtain 900 degrees main steam temperature, it will require the #7 FWH discharge valve to be throttled to 25%. This will produce sufficient spray flow to the sprays to control superheat temperature at the desired temperature. **CAUTION:** When 35% open on the #7

Issue Date: 01/08/04	Page 5 of 9
Approved By: Ron L. Waugh	Number: EO-16 R3
Subject: UNIT SHUT DOWN	Section: EQUIPMENT OPERATING PROCEDURE

FWH discharge valve has been obtained, reduce as needed, not to exceed the 25% mark. Closely monitor drum level chart. Should drum level become erratic at anytime, open the discharge valve to 50% and wait until load begins to drop below 450 MWs. Should temperature of 900 degrees still be a problem to obtain, blow the wall blowers as well as bull nose sootblowers. The economizer damper should already be 100% open at this time. If it is not, open the economizer to 100% now. Do not throttle the #7 FWH outlet valve below 5% at any time.

NOTE: If the Unit is being shut down for short term repairs to something other than boiler internals or turbine/generator, there is no need to reduce temperatures to the degree outlined in this procedure.

6.10 Check to ensure the auxiliary steam system is valved in and operational from the boiler source.

6.11 UNIT STATUS:

6.11.1 300 MWS.

6.11.2 THREE MILLS IN SERVICE.

6.11.3 THROTTLE PRESSURE 1400 PSI.

6.11.4 MAIN STEAM TEMPERATURE 800 DEGREES, SUPERHEAT APPROXIMATELY 212 DEGREES.

6.11.5 THREE ID FANS IN SERVICE.

6.11.6 INSTRUCT UNIT OPERATOR TO CONDUCT A THOROUGH INSPECTION OF THE BOILER FURNACE SECTION, ESPECIALLY THE BULL NOSE AND SUPERHEAT AREA, FOR A SLAGGING STATUS. REPORT THE STATUS TO THE CRO FOR DOCUMENTATION IN THE CRO LOG.

6.12 Test the HP bypass operation electronically and actually. Perform the electronic

Issue Date: 01/08/04	Page 6 of 9
Approved By: Ron L. Waugh	Number: EO-16 R3

Subject: UNIT SHUT DOWN	Section: EQUIPMENT OPERATING PROCEDURE
-----------------------------------	--

test procedure through the test mode located at the HP bypass panel. Actual test will be opening the HP bypass slightly to ensure all components work properly.

- 6.13** Remove one of the Steam Driven Boiler Feed Pumps from service under 300 MWs. CRO discretion. Ensure HMV-1301 OPEN, and HMV-1301 bypass OPEN 100%.
- 6.14** If unit is coming off line and fast cool down is not required, modules will be removed from service as needed.
- 6.15** Unit status reaches 450 MWs or less and only three ID Fans in service or less, remove fourth module from service.
- 6.16** Unit status reaches 300 MWs or less with three ID Fans still in service, leave the third module in service to accommodate air flow needed for force cooling.

NOTE: Unit loads **BELOW 300 MWs** place the Unit Master Control in a manual mode to ensure stable unit operation.

NOTE: Swap station service at approximately 200 MWs.

7.0 TURBINE SOAKING

Should repairs necessitate reduction of metal temperatures, soak time must be at least two to three hours consecutively in duration to remove the latent heat. Steam flow of approximately 2.5 million lbs. per hour should equate out to ~275 to 300 MWs. Ensure that the throttle pressure versus main steam temperatures are such that 150 degrees superheat steam temperature above saturation is maintained at all times. (REFERENCE STEAM TABLES)

8.0 LOAD REDUCTION CONTINUED

- 8.1** Remove the fourth mill at approximately 190 MWs. This MW value is flexible and fire power requirements should dictate at what time the mill is removed from service. However, when this mill is removed from service the fifth mill should be prepared for removal.

Subject:
UNIT SHUT DOWN

Section:
EQUIPMENT OPERATING PROCEDURE

8.2 UNIT STATUS:

8.2.1 150 MWS.

8.2.2 TWO MILLS IN SERVICE.

8.2.3 THROTTLE PRESSURE 1000 PSI.

**8.2.4 MAIN STEAM TEMPERATURE ~750 DEGREES AND
APPROXIMATELY 250 DEGREES SUPERHEAT.**

8.2.5 THREE ID FANS IN SERVICE.

8.3 When the Unit is stable and at 150 MWs, request authorization from the dispatcher to remove the Unit from operation. When authorization is obtained, prepare the Unit for final load reduction. Place HP bypass in service at 1000 psi set point. With the HP bypass in service boiler energy from the boiler will be diverted through the HP bypass. This will reduce the impact to the boiler pressure and alleviate drum level excursions.

9.0 REMOVING UNIT FROM THE GRID

9.1 Reduce load by reducing valve position in the turbine manual mode. Be advised that when C valve closes, the probes will indicate a sharp change in position. C valve should be fully closed by 85% indication of the live steam valve position indication located on TT42. Actual valve position can be seen on the Bently Nevada panel.

9.2 When C valve indicates closed, Unit load should be such that one of the two remaining mills may be removed from service. Prepare the last mill for removal, i.e., cool the mill down.

9.3 Once load has been reduced to 50 MWs, place the turbine controls in the idle mode load gradient above 3 MWs a minute and the Unit will decrease rapidly to zero MWs. HP bypass.

9.4 UNIT STATUS:

Subject:
UNIT SHUT DOWN

Section:
EQUIPMENT OPERATING PROCEDURE

9.4.1 TURBINE/GENERATOR OFF LINE.

9.4.2 THROTTLE PRESSURE 1000 PSI.

9.4.3 ONE MILL IN SERVICE.

9.4.4 ONE TURBINE DRIVEN BOILER FEED PUMP IN SERVICE.

9.4.5 THREE ID FANS IN SERVICE.

9.5 With no Tests/PMs required, remove the last mill from service, purging all coal conduits. Once the last coal fire is out and coal conduits are purged, remove and purge out all ignitors.

9.6 When boiler comes off line and MFT relay activates, T/R sets trip automatically.

9.7 Check to ensure main turbine turning gear comes into operation at 600 RPMs and that it maintains 25 RPMs on the rotor.

9.8 Isolate both electromatic power relief valves at 500 psi by closing the isolation gate valves and the isolation valve bypass valves.

9.9 Continue to depressurize the boiler through the HP/LP bypass loop down to the desired pressure ~200 to 300 psi.

9.10 When boiler depressurization is complete, fully break condenser vacuum. Vacuum may require being broken earlier if turbine steam seals are lost.

NOTE: If the Main Turbine did not reach turning gear RPMs at “9.7” of this procedure, RPM deceleration will increase now that vacuum is broken. Monitor Turbine speed to ensure proper operation of the turning gear occurs.

APPENDIX CAM

Compliance Assurance Monitoring Requirements

Compliance Assurance Monitoring Requirements

Pursuant to Rule 62-213.440(1)(b)1.a., F.A.C., the CAM plans that are included in this appendix contain the monitoring requirements necessary to satisfy 40 CFR 64. Conditions 1. – 17. are generic conditions applicable to all emissions units that are subject to the CAM requirements. Specific requirements related to each emissions unit are contained in the attached tables, as submitted by the applicant and approved by the Department.

40 CFR 64.6 Approval of Monitoring.

1. The attached CAM plan(s), as submitted by the applicant, is/are approved for the purposes of satisfying the requirements of 40 CFR 64.3.
[40 CFR 64.6(a)]
2. The attached CAM plan(s) include the following information:
 - (i) The indicator(s) to be monitored (such as temperature, pressure drop, emissions, or similar parameter);
 - (ii) The means or device to be used to measure the indicator(s) (such as temperature measurement device, visual observation, or CEMS); and
 - (iii) The performance requirements established to satisfy 40 CFR 64.3(b) or (d), as applicable.[40 CFR 64.6(c)(1)]
3. The attached CAM plan(s) describe the means by which the owner or operator will define an exceedance of the permitted limits or an excursion from the stated indicator ranges and averaging periods for purposes of responding to (see **CAM Conditions 5. - 9.**) and reporting exceedances or excursions (see **CAM Conditions 10. – 14.**).
[40 CFR 64.6(c)(2)]
4. The permittee is required to conduct the monitoring specified in the attached CAM plan(s) and shall fulfill the obligations specified in the conditions below (see **CAM Conditions 5. - 17.**).
[40 CFR 64.6(c)(3)]

40 CFR 64.7 Operation of Approved Monitoring.

5. Commencement of operation. The owner or operator shall conduct the monitoring required under this appendix upon the effective date of this Title V permit.
[40 CFR 64.7(a)]
6. Proper maintenance. At all times, the owner or operator shall maintain the monitoring, including but not limited to, maintaining necessary parts for routine repairs of the monitoring equipment.
[40 CFR 64.7(b)]
7. Continued operation. Except for, as applicable, monitoring malfunctions, associated repairs, and required quality assurance or control activities (including, as applicable, calibration checks and required zero and span adjustments), the owner or operator shall conduct all monitoring in continuous operation (or shall collect data at all required intervals) at all times that the pollutant-specific emissions unit is operating. Data recorded during monitoring malfunctions, associated repairs, and required quality assurance or control activities shall not be used for purposes of this part, including data averages and calculations, or fulfilling a minimum data availability requirement, if applicable. The owner or operator shall use all the data collected during all other periods in assessing the

operation of the control device and associated control system. A monitoring malfunction is any sudden, infrequent, not reasonably preventable failure of the monitoring to provide valid data. Monitoring failures that are caused in part by poor maintenance or careless operation are not malfunctions.

[40 CFR 64.7(c)]

8. Response to excursions or exceedances.

- a. Upon detecting an excursion or exceedance, the owner or operator shall restore operation of the pollutant-specific emissions unit (including the control device and associated capture system) to its normal or usual manner of operation as expeditiously as practicable in accordance with good air pollution control practices for minimizing emissions. The response shall include minimizing the period of any startup, shutdown or malfunction and taking any necessary corrective actions to restore normal operation and prevent the likely recurrence of the cause of an excursion or exceedance (other than those caused by excused startup or shutdown conditions, if allowed by this permit). Such actions may include initial inspection and evaluation, recording that operations returned to normal without operator action (such as through response by a computerized distribution control system), or any necessary follow-up actions to return operation to within the indicator range, designated condition, or below the applicable emission limitation or standard, as applicable.
- b. Determination of whether the owner or operator has used acceptable procedures in response to an excursion or exceedance will be based on information available, which may include but is not limited to, monitoring results, review of operation and maintenance procedures and records, and inspection of the control device, associated capture system, and the process.

[40 CFR 64.7(d)(1) & (2)]

9. Documentation of need for improved monitoring. If the owner or operator identifies a failure to achieve compliance with an emission limitation or standard for which the approved monitoring did not provide an indication of an excursion or exceedance while providing valid data, or the results of compliance or performance testing document a need to modify the existing indicator ranges or designated conditions, the owner or operator shall promptly notify the permitting authority and, if necessary, submit a proposed modification to the Title V permit to address the necessary monitoring changes. Such a modification may include, but is not limited to, reestablishing indicator ranges or designated conditions, modifying the frequency of conducting monitoring and collecting data, or the monitoring of additional parameters.

[40 CFR 64.7(e)]

40 CFR 64.8 Quality Improvement Plan (QIP) Requirements.

10. Based on the results of a determination made under **CAM Condition 8.a.**, above, the permitting authority may require the owner or operator to develop and implement a QIP. Consistent with **CAM Condition 4.**, an accumulation of exceedances or excursions exceeding 5 percent duration of a pollutant-specific emissions unit's operating time for a reporting period, may require the implementation of a QIP. The threshold may be set at a higher or lower percent or may rely on other criteria for purposes of indicating whether a pollutant-specific emissions unit is being maintained and operated in a manner consistent with good air pollution control practices.

[40 CFR 64.8(a)]

11. Elements of a QIP:

- a. The owner or operator shall maintain a written QIP, if required, and have it available for inspection.
- b. The plan initially shall include procedures for evaluating the control performance problems and, based on the results of the evaluation procedures, the owner or operator shall modify the plan to include procedures for conducting one or more of the following actions, as appropriate:

- (i) Improved preventive maintenance practices.
- (ii) Process operation changes.
- (iii) Appropriate improvements to control methods.
- (iv) Other steps appropriate to correct control performance.
- (v) More frequent or improved monitoring (only in conjunction with one or more steps under **CAM Condition 11.b(i)** through **(iv)**, above).

[40 CFR 64.8(b)]

12. If a QIP is required, the owner or operator shall develop and implement a QIP as expeditiously as practicable and shall notify the permitting authority if the period for completing the improvements contained in the QIP exceeds 180 days from the date on which the need to implement the QIP was determined.

[40 CFR 64.8(c)]

13. Following implementation of a QIP, upon any subsequent determination pursuant to **CAM Condition 8.b.**, the permitting authority may require that an owner or operator make reasonable changes to the QIP if the QIP is found to have:

- a. Failed to address the cause of the control device performance problems; or
- b. Failed to provide adequate procedures for correcting control device performance problems as expeditiously as practicable in accordance with good air pollution control practices for minimizing emissions.

[40 CFR 64.8(d)]

14. Implementation of a QIP shall not excuse the owner or operator of a source from compliance with any existing emission limitation or standard, or any existing monitoring, testing, reporting or recordkeeping requirement that may apply under federal, state, or local law, or any other applicable requirements under the Act.

[40 CFR 64.8(e)]

40 CFR 64.9 Reporting And Recordkeeping Requirements.

15. General reporting requirements.

- a. On and after the date specified in **CAM Condition 5.** by which the owner or operator must use monitoring that meets the requirements of this appendix, the owner or operator shall submit monitoring reports semi-annually to the permitting authority in accordance with Rule 62-213.440(1)(b)3.a., F.A.C.
- b. A report for monitoring under this part shall include, at a minimum, the information required under Rule 62-213.440(1)(b)3.a., F.A.C., and the following information, as applicable:
 - (i) Summary information on the number, duration and cause (including unknown cause, if applicable) of excursions or exceedances, as applicable, and the corrective actions taken;
 - (ii) Summary information on the number, duration and cause (including unknown cause, if applicable) for monitor downtime incidents (other than downtime associated with zero and span or other daily calibration checks, if applicable); and
 - (iii) A description of the actions taken to implement a QIP during the reporting period as specified in **CAM Conditions 10.** through **14.** Upon completion of a QIP, the owner or operator shall include in the next summary report documentation that the implementation of the plan has been completed and reduced the likelihood of similar levels of excursions or exceedances occurring.

[40 CFR 64.9(a)]

16. General recordkeeping requirements.

- a. The owner or operator shall comply with the recordkeeping requirements specified in Rule 62-213.440(1)(b)2., F.A.C. The owner or operator shall maintain records of monitoring data,

monitor performance data, corrective actions taken, any written quality improvement plan required pursuant to **CAM Conditions 10.** through **14.**, and any activities undertaken to implement a quality improvement plan, and other supporting information required to be maintained under this part (such as data used to document the adequacy of monitoring, or records of monitoring maintenance or corrective actions).

- b. Instead of paper records, the owner or operator may maintain records on alternative media, such as microfilm, computer files, magnetic tape disks, or microfiche, provided that the use of such alternative media allows for expeditious inspection and review, and does not conflict with other applicable recordkeeping requirements.

[40 CFR 64.9(b)]

40 CFR 64.10 Savings Provisions.

17. It should be noted that nothing in this appendix shall:

- a. Excuse the owner or operator of a source from compliance with any existing emission limitation or standard, or any existing monitoring, testing, reporting or recordkeeping requirement that may apply under federal, state, or local law, or any other applicable requirements under the Act. The requirements of this appendix shall not be used to justify the approval of monitoring less stringent than the monitoring which is required under separate legal authority and are not intended to establish minimum requirements for the purpose of determining the monitoring to be imposed under separate authority under the Act, including monitoring in permits issued pursuant to title I of the Act. The purpose of this part is to require, as part of the issuance of a permit under Title V of the Act, improved or new monitoring at those emissions units where monitoring requirements do not exist or are inadequate to meet the requirements of this part.
- b. Restrict or abrogate the authority of the Administrator or the permitting authority to impose additional or more stringent monitoring, recordkeeping, testing, or reporting requirements on any owner or operator of a source under any provision of the Act, including but not limited to sections 114(a)(1) and 504(b), or state law, as applicable.
- c. Restrict or abrogate the authority of the Administrator or permitting authority to take any enforcement action under the Act for any violation of an applicable requirement or of any person to take action under section 304 of the Act.

[40 CFR 64.10]

Emissions Units -001 & -002

**2 - 7,172 MMBtu/Hr Coal, Petroleum Coke and Oil-Fired Boilers
Particulate Matter Emissions Controlled By ESPs**

Monitoring Approach

	Indicator No. 1	Indicator No. 2
I. Indicator	Duct opacity	Scrubber operation following existing procedures.
Measurement Approach	The opacity is measured using a Continuous Opacity Monitoring System (COMS) in the duct of each boiler downstream of the ESP.	Scrubber interference is measured by operating parameter evaluation.
II. Indicator Range	An excursion is defined as any one-hour average opacity greater than 6.5 percent or any 6-minute opacity reading greater than 12%, excluding those events defined as startup/shutdown and malfunctions. Corrective action must be conducted to restore opacity below the excursion threshold and assist in preventing future ESP malfunctions from occurring.	An excursion is defined as not adhering to the established operating parameters and practices described in the company's Support Systems Operation manual.
III. Performance Criteria		
A. Data Representativeness	<p>Opacity is related to the size and concentration of particles in the flue gas. As particulate mass emissions increase, it can be reasonably expected that stack opacity will also increase.</p> <p>Each boiler discharges to a single, dedicated stack. Each duct is equipped with a COMS that meets the installation and minimum acceptable accuracy requirements of 40 CFR Part 60, Performance Specification 1. The COMS is located downstream of the ESP and, therefore, reflects the performance of the primary particulate control device.</p>	<p>The wet flue gas desulfurization (FGD) system for control of SO₂ emissions is monitored and operated according to the operating parameters and practices which have been established during annual particulate matter compliance testing to minimize scrubber carryover.</p> <p>(These operating parameters and practices are described in the "Plant Section" of the company's Support Systems Operation manual, which is attached to the permit for convenience purposes only).</p>
B. Verification of Operational Status	Not applicable. Monitoring approach uses existing equipment and procedures.	Not Applicable.
C. QA/QC Practices and Criteria	Daily zero and calibration drift check, periodic cleaning of optical surfaces and other periodic QA/QC checks as specified in the applicable version of Performance Specification 1.	Support System Operators (SSO) are adequately trained and report directly to the Support Systems Shift Supervisor.
D. Monitoring Frequency	Continuous.	Continuous.
E. Data Collection Procedures	The COMS collects a data point every 10 seconds and the data logger reduces the data to six minute block averages.	SSO evaluate and manually record the pertinent scrubber data according to procedure.
F. Averaging Period	The averaging period for opacity observations is a 6-minute block average.	Continuous observation of scrubber operation.

SUPPORT SYSTEMS OPERATION MANUAL

PLANT PRACTICE SECTION

(Included for convenience purposes only)

Insert Plant section of manual here

Subject

Section

SUPPORT SYSTEMS OPERATION**PLANT PRACTICE****1.0 PURPOSE**

To ensure a uniform approach to routine equipment and systems checks on the FGD system.

2.0 SCOPE

This establishes uniform guidelines for operation and monitoring FGD systems and equipment.

3.0 SKILL LEVEL

To perform these tasks it will require no less than the proficiency level of Support Systems Shift Supervisor, Support Systems Control Room Operator, Support Systems Operator and Support Systems Utility Operator.

4.0 PROCEDURE

The FGD equipment listed below will be checked thoroughly two times per twelve hour shift. The first tour all readings will be logged on the appropriate reading sheet. The second tour all equipment will be checked visually. The Oxidation Blowers will have readings logged every two hours. Control room instrumentation is monitored constantly with readings being logged every four hours. The Chemistry Laboratory also performs daily analyses for FGD module chemistry. Operators will begin FGD system walkdown and equipment checks by following the FGD Operator Log sheet. The walkdown consists of the following areas:

4.1 Fly Ash Conveying System

- 4.1.1 The fly ash blowers, in service or not, are required to be checked and status logged.
- 4.1.2 When in service, the blowers are to be checked for motor running amps, oil level, cooling water status and temperature, and the intake filter condition.
NOTE:(While in this area, record the hour meter readings on the Stack Sump Pumps located on the 480 vacb breaker cabinet door.)
- 4.1.3 If out of service, the blower oil level, and the intake filter condition are to be checked and noted on the log.
- 4.1.4 All associated equipment on the fly ash system is then to be physically checked and any abnormal conditions are to be promptly reported in an effort to maintain efficient operation of this environmental system. Nuvafeeder air lines, gates and hoppers are each to be inspected, and problems corrected immediately, if possible. Fly ash leaks are to be reported immediately, no matter how small. This is to stay in compliance with Title V Permitting.

Subject

Section

SUPPORT SYSTEMS OPERATION**PLANT PRACTICE**

4.1.5 Fly Ash Hopper level lights are constantly monitored by the Support Systems Control Room Operator with the goal being to keep all lights cleared. Hopper level high and high high lights are recorded every four hours. If the Support Systems Control Room Operator suspects a problem with the system, a Support Systems Operator is dispatched to correct the problem.

4.2 Absorber Recycle Pumps

4.2.1 All of these pumps, in service or not, are required to be checked and status logged. Total number of pumps in service, per unit shall be logged every four hours by the Support Systems Control Room Operator plus once per shift by the Support Systems Operator.

4.2.2 When in service, the seal water supply and flow, pump discharge pressure, and oil level are to be checked and noted. In addition, the motor condition, bearing temperatures, belts, packing and valving must be checked.

4.2.3 If out of service, check the valving status, and note the pump oil level on the log sheet.

4.2.4 Any abnormal operating conditions with these pumps should be noted and followed up with the proper corrective actions. Slurry leaks are to be reported immediately.

4.3 Waste Slurry Pumps

4.3.1 All of these pumps, in service or not, are required to be checked and status logged.

4.3.2 When in service, the seal water supply and flow, pump discharge pressure and oil level are to be checked and noted on the log. In addition, motor condition, bearing temperatures, belts, packing and valving must be checked.

4.3.3 If out of service, check the above and verify the pump is in a ready standby mode for operation as needed to maintain sump level control.

4.3.4 Monitor condition and operation of the waste slurry sump pit pumps and agitator at this time.

4.3.5 Monitor all associated waste sump equipment. The sump level control valves status and operation should be checked, along with all incoming discharges into the sump. Check the oil level and operation of the waste slurry sump agitator.

Subject

Section

SUPPORT SYSTEMS OPERATION**PLANT PRACTICE**

4.3.6 At the time of checking the equipment listed in 4.3.5, also record the flow totalizer reading for the stack sump pump discharge flow.

4. 3.7 Any problems with the waste slurry system are to be promptly reported in an effort to maintain efficient operation of this environmental system.

4. 4 Supernate Pumps

4. 4.1 Both of these pumps, in service or not, are required to be checked and status logged.

4. 4.2 When in service, the pump discharge pressure, oil level and motor running amps are to be checked and noted on the log. In addition, motor condition, bearing temperatures, belts, packing and valving must be checked.

4. 4.3 If out of service, pump must be checked and verified to be in a ready standby mode to ensure prompt availability of supernate back-up supply to the FGD. Oil level is to be noted on the log.

4. 5 Service Water Booster Pumps

4. 5.1 Both of these pumps, in service or not, are required to be checked and status logged.

4. 5.2 When in service, the discharge pressure and oil level are to be checked and noted. Monitor general pump running condition. Report low discharge pressure promptly. (< 90 psi)

4. 5.3 If out of service, both the suction and discharge manual valves are to be verified open and oil level checked to be sure this pump is in ready standby for prompt availability of service water back up supply to the FGD.

4. 5.4 Check valving to the service water booster pumps to verify which supply is valved in, log same. Check other supply valving to the Service Water Booster Pumps to ensure they are isolated.

4. 6 Deluge Pumps

4. 6.1 Both of these pumps, normally out of service, are required to be checked and status logged.

4. 6.2 The oil level is to be checked and noted on the log. In addition, valving is to be verified to ensure prompt availability of these pumps if needed to fill or maintain

Subject

Section

SUPPORT SYSTEMS OPERATION
PLANT PRACTICE

level in the deluge tanks.

4. 6.3 Check to be sure that the normal supply to the suction of these pumps is valved in, (cooling tower blowdown) and that the alternate supply (service water) is valved out.

4.7 Oxidation System - #1 FGD

- 4.7.1 The oxidation blowers, in service or not, are required to be checked and status logged.
- 4.7.2 When in service, all of the fields for all of the parameters listed on the reading sheet shall be filled in with the proper reading. This will insure that all parameters and components are checked on each compressor.
- 4.7.3 All associated equipment with the running of the oxidation system is to be monitored. Status of each individual module's air flow control valve operation and the blower discharge air cooling water supply must be checked. Promptly report any equipment problems to maintain efficient operation of this FGD system.

4.8 Wash Slurry Pumps

4. 8.1 These pumps, in service or not, are required to be checked and status logged.
4. 8.2 When in service, the oil level is to be noted on the log. In addition, motor conditions, bearing temperatures, belts and packing are to be checked. Since these pumps do not use seal water, packing must be monitored closely.
4. 8.3 If out of service, the pump oil level, belts and valving are to be checked.
4. 8.4 Any abnormal operating conditions with these pumps should be followed up with proper corrective action.

4. 9 Module Auxiliary Equipment

The following auxiliary equipment is required to be checked and status logged.

- 4.9.1 Recycle tank level - the local transmitter level indication is noted on the log.
- 4.9.2 System, Absorber module and mist eliminator DP's are to be logged by the Support Systems Control Room Operator every 4 hours on their reading sheets.
- 4.9.3 Recycle tank pH - the local pH indication is to be noted on the log.

Subject

Section

SUPPORT SYSTEMS OPERATION**PLANT PRACTICE**

- 4.9.4 DBA tank - the local tank level indication and the tank temperature are to be noted on the reading sheet. In addition, the DBA metering pump operation and oil level are to be checked. Temperature of this tank must be monitored closely, as DBA will crystallize if the temperature is not maintained above 60°F.
- 4.9.5 Well pump status is to be checked and the pump in service noted on the log. In addition, the control status is to be checked. The Support Systems Shift Supervisor is to be notified any time the south well pump is in service.
- 4.9.6 Mist eliminator valve stations on each absorber are to be checked and the flow at each one noted on the log. In addition, each individual valve's operation is to be checked. Any problems with the mist eliminators are to be promptly reported for corrective action.
- 4.9.7 Deluge tanks - levels are to be checked and noted on the log. These tanks must be full to maintain availability of the FGD, and for protection of absorber liners with heat excursions. Promptly inform the Support Systems Control Room Operator if the tanks are not full.
- 4.9.8 Inlet and outlet seal air blowers, normally left in service, are to be checked and general running status noted on the log. In addition, motor condition, bearings, discharge valve status should be checked, along with the damper seals. It is also important for the operator to closely inspect the associated damper chains, to ensure they are in good condition, intact, and reliable for use.
- 4.9.9 Switchgear walkdown includes a physical check of the FGD system breakers. 6.9KV breakers are to be checked, and targets, if any, noted on the log - reset if allowed. The status of the UPS and availability of power supplies to the system are to be verified and noted on the log. The 480V MCC's are to be checked and noted. It is the Operator's responsibility to be completely familiar with the status of all equipment on the different MCC's. Switchgear problems should be reported immediately.
- 4.9.10 While performing their walkdown, the Operator will utilize the top inspection window of each "In Service" module to look for any signs of carry over. If any signs of carry over are observed, the operator should notify that unit's Support System Control Room Operator immediately. The Support Systems Control Room Operator will then inform the Support Systems Shift Supervisor who will initiate steps to improve the conditions to minimize carry over.

Subject

Section

SUPPORT SYSTEMS OPERATION**PLANT PRACTICE****4.10 Mill Recycle Pumps**

- 4.10.1 The mill recycle pumps, in service or not, are required to be checked and status logged.
- 4.10.2 When in service, the seal water supply and flow and the oil level are to be checked and noted on the log. In addition, motor condition, bearing temperatures, belts, packing, and valving must be checked.
- 4.10.3 If out of service, the pump oil level, belts, and valving are to be checked.
- 4.10.4 Any abnormal operating conditions with these pumps should be noted and followed up with corrective action.

4.11 Reagent Storage Tank Agitators

- 4.11.1 These agitators, in service or not, are required to be checked and status logged.
- 4.11.2 When in service, the oil level is to be checked and noted on the log. In addition, motor condition and bearings are to be checked.
- 4.11.3 If out of service, the oil level is to be noted, and availability for use in case of one of the other agitators is removed from service verified.
- 4.11.4 Any abnormal operating conditions with this equipment should be noted and followed with corrective action.

4.12 Limestone Ball Mill Lube Oil Pumps

- 4.12.1 These pumps, in service or not, are required to be checked and status logged.
- 4.12.2 When in service, the pump selection is to be noted, along with the discharge and bearing temperatures. Also, the filter conditions, cooling water supply, temperature and the oil reservoir level are to be checked and noted on the log. In addition, check and note the limestone ball mill air receiver tank pressure.
- 4.12.3 If out of service, the oil reservoir level, system valving and the air receiver tank pressure are to be checked.
- 4.12.4 Report any problems with the lube oil equipment promptly to maintain availability of the milling system for the FGD.

Subject

Section

SUPPORT SYSTEMS OPERATION**PLANT PRACTICE****4.13 Miscellaneous**

Other areas and equipment that need to be checked include the following:

- 4.13.1 FGD area sump and agitator - general operation and running condition of this system are to be checked. Pump discharge to the waste slurry sump must be verified.
- 4.13.2 Ball mill area sump pumps and agitator - general operation and running condition of this system is to be checked. Pump discharge to the appropriate reagent storage tank must be verified.
- 4.13.3 Limestone Scraper Reclaimer, general operation and running condition of this system is to be checked. When in the "A" Frame, count and log the number of each; 500 pound and 190 pound bags of adipic acid.
- 4.13.4 Other routine equipment checks of the FGD are to be made, and abnormal operating conditions are to be noted on the "Comments" section of the log; then followed with the necessary corrective actions.
- 4.13.5 It is the Support Systems Operator's responsibility to have a thorough and complete knowledge of all equipment associated with the FGD. This includes the location of all equipment, flow paths, valving and controls. In addition, each operator must be familiar with start-up/shut-down procedures for the equipment, its relationship to the FGD systems and its normal operating parameters. Equipment that is not available for service and the reason it is not available must be known to the Operator as part of his daily routine.
- 4.13.6 Each Support Systems Operator has other routine tasks assigned to the particular shift and crew that they work on. It is the Operator's responsibility to become familiar with crew and shift duties, and to include these routines as required.
- 4.13.7 Each Support Systems Operator must be aware of the environmental importance associated with FGD operation. The necessity of properly monitoring all FGD systems and equipment should be understood.

4.14 Stack Equipment

- 4.14.1 Stack sumps and agitator - general operation and running condition of this system is to be checked. Pump(s) discharge to the waste slurry sump must be verified. Promptly report any abnormal operating condition with these pumps or agitator to ensure reliability of this environmental system. Liquid and/or gases escaping from the sump must be reported immediately. Stack Sump pump flow needs to be

Subject

Section

SUPPORT SYSTEMS OPERATION
PLANT PRACTICE

monitored in the following manner; log the hour meter readings located on the breaker of each stack sump pump as mentioned above in 4.1.2. Log the flow totalizer reading as mentioned above in 4.3.6.

- 4.14.2 Stack pressurization fans - these fans are required to be checked. Note the fan selection, general operating conditions, motor condition, louvers status and the internal stack pressure. The status of the outside doors, the roll-up door, vents and elevator position are to be checked. Any condition that will decrease the internal stack pressure is to be immediately reported to the Support Systems Shift Supervisor. The Operator should take corrective action, if possible, to restore internal stack pressurization right away.

Subject

Section

SUPPORT SYSTEMS OPERATION**PLANT PRACTICE****ATTACHMENT 1**

Module Chemistry is constantly monitored by the Support Systems Control Room Operator by use of monitoring instrumentation. It is also checked daily by the Chemistry Laboratory and recorded on a spreadsheet on the plant computer systems "M" drive. The target set points are listed on this spreadsheet.

Stack Sump pump hour meters and flow totalizer readings are one of the major indicators used to monitor the amount of carry-over. These readings must be logged.

Oil levels are checked to ensure pump bearings are properly lubricated.

Seal water is checked to ensure pump packing is properly protected.

Discharge pressure is checked to ensure pump is pumping to capacity.

Motor condition and motor bearing temperatures are checked to identify any motor problems before they become critical or damage the motor.

Belts are checked for wear or damage that will cause them to break or reduce pump efficiency.

Slurry leaks are identified and reported for several reasons.

1. Safety concern due to slippery floor conditions.
2. Environmental concern if leak is outside containment area.
3. Equipment protection.

Amps are checked to ensure pump is efficiently pumping to capacity.

Service water pump valving is to be checked to ensure prompt availability of alternate supply in the event it is needed.

Cooling water is checked to ensure equipment is properly cooled and does not cause equipment damage or failure.

Wash pump inlet header pressure is checked to ensure there is adequate supernate supply to pumps to prevent pump damage and to ensure rough cut trays are adequately washed.

Recycle tank levels are checked to ensure liquid seals are maintained to prevent flue gas from escaping to the atmosphere.

Recycle tank PH is checked to ensure the scrubber module is efficiently scrubbing flue gas (SO_2) (range is 4.8 - 5.8) with optimum efficiency at .2 above equilibrium PH.

Subject

Section

SUPPORT SYSTEMS OPERATION**PLANT PRACTICE**

Mist eliminator valves are checked to ensure they are cycling and are also checked for proper flow to ensure the mist eliminator trays are being washed efficiently.

Check seal air blowers are to ensure damper seals are preventing SO^2 from escaping to the atmosphere.

Appendix A-1, Abbreviations, Acronyms, Citations, and Identification Numbers (version dated 02/05/97)

Abbreviations and Acronyms:

°F: Degrees Fahrenheit
BACT: Best Available Control Technology
CFR: Code of Federal Regulations
DEP: State of Florida, Department of Environmental Protection
DARM: Division of Air Resource Management
EPA: United States Environmental Protection Agency
F.A.C.: Florida Administrative Code
F.S.: Florida Statute
ISO: International Standards Organization
LAT: Latitude
LONG: Longitude
MMBtu: million British thermal units
MW: Megawatt
ORIS: Office of Regulatory Information Systems
SOA: Specific Operating Agreement
UTM: Universal Transverse Mercator

Citations:

The following examples illustrate the methods used in this permit to abbreviate and cite the references of rules, regulations, guidance memorandums, permit numbers, and ID numbers.

Code of Federal Regulations:

Example: [40 CFR 60.334]

Where:	40	reference to	Title 40
	CFR	reference to	Code of Federal Regulations
	60	reference to	Part 60
	60.334	reference to	Regulation 60.334

Florida Administrative Code (F.A.C.) Rules:

Example: [Rule 62-213, F.A.C.]

Where:	62	reference to	Title 62
	62-213	reference to	Chapter 62-213
	62-213.205	reference to	Rule 62-213.205, F.A.C.

ISO: International Standards Organization refers to those conditions at 288 degrees K, 60 percent relative humidity, and 101.3 kilopascals pressure.

**Appendix A-1, Abbreviations, Acronyms, Citations, and Identification Numbers
(version dated 02/05/97) (continued)**

Identification Numbers:

Facility Identification (ID) Number:

Example: Facility ID No.: 1050221

Where:

105 = 3-digit number code identifying the facility is located in Polk County
0221 = 4-digit number assigned by state database.

Permit Numbers:

Example: 1050221-002-AV, or
1050221-001-AC

Where:

AC = Air Construction Permit
AV = Air Operation Permit (Title V Source)
105 = 3-digit number code identifying the facility is located in Polk County
0221 = 4-digit number assigned by permit tracking database
001 or 002 = 3-digit sequential project number assigned by permit tracking database

Example: PSD-FL-185
PA95-01
AC53-208321

Where:

PSD = Prevention of Significant Deterioration Permit
PA = Power Plant Siting Act Permit
AC = old Air Construction Permit numbering

Appendix H-1, Permit History/ID Number Changes

Seminole Electric Cooperative, Inc.

DRAFT Permit No.: 1070025-002-AV

Facility ID No.: 1070025

Permit History (for tracking purposes):

<u>E.U.</u> <u>ID No</u>	<u>Description</u>	<u>Permit No.</u>	<u>Issue Date</u>	<u>Expiration Date</u>	<u>Extended Date</u>	<u>Revised Date(s)</u>
-001	#1 Unit, W/ESP AND FGD	PA78-10 & PSD-FL-018	09/18/79 & 09/09/79			10/12/88, 8/10/89, 3/26/91, 10/14/92, 11/25/92, 3/2/95, 4/25/97 & 2/7/97
-002	#2 Unit, W/ESP AND FGD	PA78-10 & PSD-FL-018	09/18/79 & 09/09/79			10/12/88, 8/10/89, 3/26/91, 10/14/92, 11/25/92, 3/2/95, 4/25/97 & 2/7/97
-003	Rail Car Maintenance	PA78-10 & PSD-FL-018	09/18/79 & 09/09/79			10/12/88, 8/10/89, 3/26/91, 10/14/92, 11/25/92, 3/2/95, 4/25/97 & 2/7/97
-004	Coal Storage Yard	PA78-10 & PSD-FL-018	09/18/79 & 09/09/79			10/12/88, 8/10/89, 3/26/91, 10/14/92, 11/25/92, 3/2/95, 4/25/97 & 2/7/97
-005	Limestone & FGD Sludge Handling and Storage	PSD-FL-018	09/09/79			
ALL	Title V Renewal	1070025-002-AV	01/01/05	12/31/09		

Notes:

1 - AO permit(s) automatic extension(s) in Rule 62-210.300(2)(a)3.a., F.A.C., effective 03/21/96.

2 - AC permit(s) automatic extension(s) in Rule 62-213.420(1)(a)4., F.A.C., effective 03/20/96.

{Rule 62-213.420(1)(b)2., F.A.C., effective 03/20/96, allows Title V Sources to operate under existing valid permits}

Table 1-1, Summary of Air Pollutant Standards and Terms

Seminole Electric Cooperative, Inc.
Seminole Power Plant

DRAFT Permit No.: 1070025-002-AV
Facility ID No.: 1070025

This table summarizes information for convenience purposes only. This table does not supersede any of the terms or conditions of this permit.

E.U. ID No. Brief Description

[-001] Steam Electric Generator No. 1
[-002] Steam Electric Generator No. 2

Pollutant Name	Fuel(s)	Hours/Year	Allowable Emissions			Equivalent Emissions*		Regulatory Citation(s)	See permit condition(s)
			Standard(s)	lbs./hour	TPY	lbs./hour	TPY		
PM	coal or oil	8,760	0.03 lb/MMBtu			215.16	942	40 CFR 60.42a(a)	A.5.
PM	coal & petcoke	8,760	0.03 lb/MMBtu			215.16	942	PSD-FL-018(A)	A.6.
VE	all		20% except 27% one 6 min/hr					40 CFR 60.42a(b)	A.7.
SO2	coal	8,760	1.20 lb/MMBtu			8,606.4	37,896	40 CFR 60.43a(a)(1) & (2)	A.8.
SO2	liquid	8,760	0.80 lb/MMBtu			5,737.6	25,131	40 CFR 60.43a(b)(1) & (2)	A.9.
SO2	coal & liquid	8,760	X(340) + Y(520)/100					PSD-FL-018	A.11.
SO2	coal & petcoke	8,760	Permit Condition A.12.			7,538.3 / 7,491.6	33,018 / 32,814	PSD-FL-018(A)	A.12.
SO2	petcoke	8,760	7.0% sulfur by weight, dry basis					PSD-FL-018(A)	A.13.
NOX	coal	8,760	0.60 lb/MMBtu			4,303.2	18,848	40 CFR 60.44a(a)(1) & (2)	A.14.
NOX	liquid	8,760	0.30 lb/MMBtu			2,151.6	9,424	40 CFR 60.44a(a)(1) & (2)	A.14.
NOX	coal & liquid	8,760	X(130) + Y(260)/100					PSD-FL-018	A.15.
NOX	coal & petcoke	8,760	0.50 lb/MMBtu			3,586.0	15,707	PSD-FL-018(A)	A.16.
CO	coal & petcoke	8,760	No significant increase compared to coal					Rule 62-210.200(12)(d), FAC	A.69.
H2SO4 Mist	coal & petcoke	8,760	No significant increase compared to coal					Rule 62-210.200(12)(d), FAC	A.70.

Notes:
* The "Equivalent Emissions" listed are for informational purposes only.

[electronic file name: 10700251.xls]

Table 1-1, Summary of Air Pollutant Standards and Terms

Seminole Electric Cooperative, Inc.
Seminole Power Plant

DRAFT Permit No.: 1070025-002-AV
Facility ID No.: 1070025

This table summarizes information for convenience purposes only. This table does not supersede any of the terms or conditions of this permit.

E.U. ID No. **Brief Description**
[-003] Rail Car Maintenance

Pollutant Name	Fuel(s)	Hours/Year	Allowable Emissions			Equivalent Emissions*		Regulatory Citation(s)	See permit condition(s)
			Standard(s)	lbs./hour	TPY	lbs./hour	TPY		
VE		8,760	20%					PA 78-10, Modified March 26, 1991	B.2.
VOC		8,760		38.75	11.84			PA 78-10, Modified March 26, 1991	B.4.
Notes: * The "Equivalent Emissions" listed are for informational purposes only.									

[electronic file name: 10700251.xls]

Table 1-1, Summary of Air Pollutant Standards and Terms

Seminole Electric Cooperative, Inc.
Seminole Power Plant

DRAFT Permit No.: 1070025-002-AV
Facility ID No.: 1070025

This table summarizes information for convenience purposes only. This table does not supersede any of the terms or conditions of this permit.

E.U. ID No. **Brief Description**

[-004] Coal Storage Yard

Pollutant Name	Fuel(s)	Hours/Year	Allowable Emissions			Equivalent Emissions*		Regulatory Citation(s)	See permit condition(s)
			Standard(s)	lbs./hour	TPY	lbs./hour	TPY		
VE		8,760	<20%					40 CFR 60.252(c)	C.4.
Notes: • The "Equivalent Emissions" listed are for informational purposes only.									

[electronic file name: 10700251.xls]

Table 1-1, Summary of Air Pollutant Standards and Terms

Seminole Electric Cooperative, Inc.
Seminole Power Plant

DRAFT Permit No.: 1070025-002-AV
Facility ID No.: 1070025

This table summarizes information for convenience purposes only. This table does not supersede any of the terms or conditions of this permit.

E.U. ID No. **Brief Description**
[-005] Limestone and FGD Sludge Handling and Storage

Pollutant Name	Fuel(s)	Hours/Year	Allowable Emissions			Equivalent Emissions*		Regulatory Citation(s)	See permit condition(s)
			Standard(s)	lbs./hour	TPY	lbs./hour	TPY		
VE		8,760	20%					PSD-FL-018	D.4.

Notes:

* The "Equivalent Emissions" listed are for informational purposes only.

[electronic file name: 10700251.xls]

Table 2-1, Summary of Compliance Requirements

Seminole Electric Cooperative, Inc.
Seminole Power Plant

DRAFT Permit No.: 1070025-002-AV
Facility ID No.: 1070025

This table summarizes information for convenience purposes only. This table does not supersede any of the terms or conditions of this permit.

E.U. ID No.	Brief Description
[-001]	Steam Electric Generator No. 1
[-002]	Steam Electric Generator No. 2

Pollutant Name or Parameter	Fuel(s)	Compliance Method	Testing Time	Frequency	Min. Compliance	CMS**	See permit condition(s)
			Frequency	Base Date *	Test Duration		
PM	All	EPA Method 19 & 5 or 5B	Annual	2/8/1987	120 minutes		A.41.
VE	All	EPA Method 9 and CMS***	Annual & Continuous	2/8/1987	1 hour	Yes	A.30., A.40.
SO2	All	EPA Method 19 and CMS	Annual & Continuous	2/8/1987	1 hour	Yes	A.31., A.42.
NOX	All	EPA Method 19 and CMS	Annual & Continuous	2/8/1987	1 hour	Yes	A.32., A.43.
CO	coal & petcoke	EPA Method 10	Annual	2/8/1987	1 hour		A.69.
H2SO4 Mist	coal & petcoke	EPA Method 8	Annual	2/8/1987	1 hour		A.70.

Notes:

* The frequency base date is established for planning purposes only; see Rule 62-297.310, F.A.C.

**CMS [=] continuous monitoring system

*** Annual compliance may be shown using continuous opacity monitors in lieu of EPA Method 9

[electronic file name: 10700252.xls]

Table 2-1, Summary of Compliance Requirements

Seminole Electric Cooperative, Inc.
Seminole Power Plant

DRAFT Permit No.: 1070025-002-AV
Facility ID No.: 1070025

This table summarizes information for convenience purposes only. This table does not supersede any of the terms or conditions of this permit.

E.U. ID No. **Brief Description**
[-003] Rail Car Maintenance

Pollutant Name or Parameter	Fuel(s)	Compliance Method	Testing Time	Frequency Base Date *	Min. Compliance Test	CMS**	See permit condition(s)
			Frequency		Duration		
VE		EPA Method 9	Annual	2/8/1987	30 minutes		B.6.
VOC		Material Balance	Annual	2/8/1987			B.7.
Notes: * The frequency base date is established for planning purposes only; see Rule 62-297.310, F.A.C. **CMS [=] continuous monitoring system							

[electronic file name: 10700252.xls]

Table 2-1, Summary of Compliance Requirements

Seminole Electric Cooperative, Inc.
Seminole Power Plant

DRAFT Permit No.: 1070025-002-AV
Facility ID No.: 1070025

This table summarizes information for convenience purposes only. This table does not supersede any of the terms or conditions of this permit.

E.U. ID No. **Brief Description**
[-004] Coal Storage Yard

Pollutant Name or Parameter	Fuel(s)	Compliance Method	Testing Time	Frequency	Base	Min. Compliance	CMS**	See permit condition(s)
			Frequency	Date *	Test	Duration		
VE		EPA Method 9	Annual	2/8/1987	30 minutes			C.6.

Notes:

* The frequency base date is established for planning purposes only; see Rule 62-297.310, F.A.C.

**CMS [=] continuous monitoring system

[electronic file name: 10700252.xls]

Table 2-1, Summary of Compliance Requirements

Seminole Electric Cooperative, Inc.
Seminole Power Plant

DRAFT Permit No.: 1070025-002-AV
Facility ID No.: 1070025

This table summarizes information for convenience purposes only. This table does not supersede any of the terms or conditions of this permit.

E.U. ID No. **Brief Description**
[-005] Limestone and FGD Sludge Handling and Storage

Pollutant Name or Parameter	Fuel(s)	Compliance Method	Testing Time Frequency	Frequency Base Date *	Min. Compliance Test Duration	CMS**	See permit condition(s)
VE		EPA Method 9	Annual	2/8/1987	30 minutes		D.6.

Notes:

* The frequency base date is established for planning purposes only; see Rule 62-297.310, F.A.C.

**CMS [=] continuous monitoring system

[electronic file name: 10700252.xls]

Friday, Barbara

To: Kirts, Christopher; 'tdavis@ectinc.com'

Cc: Holladay, Cleve

Subject: DRAFT Title V Permit Renewal #1070025-002-AV - Seminole Electric Cooperative, Inc. - Seminole Power Plant

Find attached the subject DRAFT Title V Permit Renewal for your information and files.

If I may be of further assistance, please feel free to contact me.

Barbara J. Friday
Planner II
Bureau of Air Regulation
(850)921-9524
Barbara.Friday@dep.state.fl.us

10/5/2004



October 20, 2004

Mr. Cleve Holladay, P.E.
Bureau of Air Regulation
Florida Department of Environmental Protection
2600 Blair Stone Road
Tallahassee, FL 32399-2400

RECEIVED

OCT 22 2004

BUREAU OF AIR REGULATION

RE: Seminole Electric Cooperative, Inc.
DRAFT Title V Permit No. 1070025-002-AV

Dear Mr. Holladay:

On behalf of Seminole Electric Cooperative, Inc. (Seminole), attached are comments regarding the DRAFT Title V permit for the Seminole Power Plant as identified above. Seminole appreciates the Department's efforts in processing our Title V permit and understands the need to resolve any outstanding issues in a timely manner. In this regard, Seminole was granted a Request for an Enlargement of Time until November 1, 2004, to allow the submittal and resolution of comments. If we are unable to reach a resolution of the following comments by this time, we would appreciate the opportunity to file an additional Request for Enlargement of Time.

After you have had a chance to review these comments, please contact me or Mike Roddy at (813) 963-0994.

Sincerely,

Mike Opalinski
Title V Responsible Official

cc: Jim Frauen
Mike Roddy
Trina Vielhauer, DEP
Jim Pennington, DEP
Tom Davis, P.E., ECT
Robert Manning, HGSS

**SEMINOLE ELECTRIC COOPERATIVE
COMMENTS ON DRAFT TITLE V PERMIT
SEMINOLE GENERATING STATION**

General Comments

1. Although we published the public notice provided on October 5, 2004, we question DEP's authority to allow for a "public meeting."
2. Specific Comments are detailed below and are reflected in the attached strike-through/underline version of the draft permit.

Specific Comments

1. Please change the name of the facility to Seminole Generating Station.
2. As indicated in our renewal application, Seminole no longer conducts railcar maintenance at this site. Accordingly, we request that Emission Unit B be deleted from the permit, as well as references to this activity in the Table of Contents, Facility Information and Description, Statement of Basis, etc.
3. In the referenced attachments to the permit, please update the version of Appendix 40 CFR Part 60 to (version dated 7/1/03).
4. Insignificant activities. 20. " Periodic abrasive blasting in permanent enclosure (old railcar maintenance building)."
5. Please update TV-3 to TV-4 throughout the permit.
6. Condition A.20. Add a reference to Condition A.18. at end of sentence, in addition to A.19.
7. Delete Conditions A.69. and A.70. because these conditions have been satisfied and are now obsolete.
8. Delete Conditions A.72. and A.73. because this information is redundant (an FDEP monitoring station is located approximately 1 mile away), these requirements are not federally enforceable, and the equipment has reached the end of its useful life.
9. Condition C.1., add the following language: "The maximum through put rate shall not exceed 3,000 tons per hour for unloading trains and 1,700 tons per hour for reclaim operation."

10. In the permitting note for Condition C.7., clarify the emission points subject to the standard.
11. In the permitting notes for Conditions C.9. and D.9., revise to reflect Seminole's prior submission of an Action Plan.
12. In Condition D.1., revise the unloading or transfer rate to 400 tons per hour.
13. In the description of Emission Unit D, edit to reflect the use of lime rather than quicklime.
14. Acid Rain Part. Revise the allowances to reflect the current amount for each unit to 18,388, and the correct years for this permit.
15. Revise the CAM Plan to reflect the exact agreement reached between Seminole and DEP on September 22, 2004. Specifically the indicator range should read: "An excursion is defined as measured duct opacity greater than 6.5 percent for ten consecutive six minute readings or greater than 12 % opacity for one six minute reading...".