



UNITED STATES ENVIRONMENTAL PROTECTION AGENCY

REGION IV

345 COURTLAND STREET  
ATLANTA, GEORGIA 30365

MAR 13 1984

Mr Bill

REF: 4AW-AM

DER

MAR 16 1984

BAQM

Mr. C. H. Fancy, Deputy Chief  
Bureau of Air Quality Management  
Department of Environmental Regulation  
Twin Towers Office Building  
2600 Blair Stone Road  
Tallahassee, Florida 32301

RE: PSD-FL-014 Florida Power Corporation Suwannee River Peaking  
Units

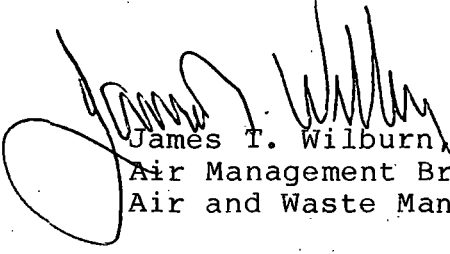
Dear Mr. Fancy:

We have reviewed Mr. G. W. Schaefer's letter to you dated February 9, 1984, requesting to modify Condition 3(b) of their PSD permit. Since these units are subject to New Source Performance Standards for Stationary Gas Turbines, it is not possible to delete the monitoring requirements of 40 CFR 60.334 contained within the permit. However, the frequency of determination of the sulfur content and nitrogen content of the fuels may be adjusted in accordance with the provisions of 40 CFR 60.334(b)(1) and (2).

These provisions state that: (1) if the turbine is supplied from a bulk storage tank, values shall be determined on each occasion that fuel is transferred to the storage tank from any other source; and (2) if the turbine is supplied its fuel without intermediate bulk storage, the values shall be determined and recorded daily. However, custom schedules may be submitted for approval by the Administrator for use in complying with the fuel monitoring requirement of the above referenced provisions.

If you have any questions regarding the use of such a schedule or the documentation required to verify the validity of the schedule, please do not hesitate to contact Jesse Baskerville, Acting Chief, Air Engineering Section at 404/881-4901.

Sincerely yours,

  
James T. Wilburn, Chief  
Air Management Branch  
Air and Waste Management Division