


P.O. Drawer L.
Plant City, Florida 33564-9007
Telephone: 813/782-1591



CF Industries, Inc.
Plant City Phosphate Complex

June 21, 1999

Mr. Jerry Kissel
Florida Department of
Environmental Protection
3804 Coconut Palm Drive
Tampa, FL 33619-8318

SUBJECT: COMPLIANCE TEST - "B" PAP
Permit No. 0570005-007-AV
Emission Unit 009

Dear Mr. Kissel:

Enclosed are duplicate copies of the two recent compliance tests conducted at CF Industries, Inc., Plant City Phosphate Complex, on "B" Phosphoric Acid Plant. The tests were performed in accordance with "Specific Conditions 12 through 17" of Air Permit No. 0570005-007-AV, and at the rates specified in FDEP's letter dated May 26, 1999 (see Attachment 1).

In addition to the two compliance tests, CFII staff has enclosed copies of two preliminary test runs conducted on June 3, 1999, at 10% above the permitted rate, and June 4, 1999, at the permitted rate (see Attachment 2).

If there are any questions concerning the results, please give Michael Messina a call at 813-782-1591, ext. 290.

Sincerely,

T.A. Edwards,
Superintendent, Environmental Affairs

TAE/JHF/gm
u:\envrpt\225960.doc
Enclosures

cc: ~~J.M. Messina~~
T.V. Ortoski
Sterlin Woodard/HCEPC

PERMIT NO. 0570005-007-Av

EMISSION UNIT 009

CF INDUSTRIES, INC.

PLANT CITY PHOSPHATE COMPLEX

"B" PHOSPHORIC ACID PRODUCTION

PLANT CITY, FLORIDA

June 7 & 8, 1999

TEST CONDUCTED BY:

Laboratory
CF INDUSTRIES, INC.
Plant City Phosphate Complex
Plant City, Florida 33564

TABLE OF CONTENTS

	<u>PAGE</u>
INTRODUCTION	1
PROCESS DESCRIPTION	1
LOCATION OF SAMPLING POINTS	2
DESCRIPTION OF SAMPLE POINTS	3
SAMPLING AND ANALYTICAL PROCEDURES	4
APPENDIX:	<u>PAGES</u>
APPENDIX "A" Emmission Calculation and Results	5 - 16
APPENDIX "B" Field Data	17 - 53
APPENDIX "C" Project Participants	54 - 55

INTRODUCTION:

The Environmental Control Laboratory of CF Industries, Inc., Plant City Phosphate Complex, conducted an emission test at "B" Phosphoric Acid Production Facility in Plant City, Florida on June 7 and 8, 1999. Six (6) 60-minute test runs were performed. The purpose of the test was to obtain emission data demonstrating compliance with the State of Florida DEP performance standards.


The measurements were made for fluoride and moisture at the stack outlet to the atmosphere. The measurements were within the permitted limits on all tests.

Complete results are give in APPENDIX "A".



PROCESS DESCRIPTION

Phosphoric Acid is made by reacting sulfuric acid with phosphate rock along with a given amount of water to make an acid slurry. The mixing of sulfuric acid, rock and water takes place in a continuous reactor.

The principal reaction takes place as follows:




Other reactions as follows:



The resulting Phosphoric Acid will be 28 to 30% P2O5 content. This 28 to 30% P2O5 Phosphoric Acid solution will be further concentrated by evaporators until the acid strength reaches 52 to 54% P2O5.

LOCATION OF SAMPLING POINTS

The sampling sites and number of traverse points were selected as per Figure 1-2 EPA Method 1 specified in 40 CFR 60, Appendix A.

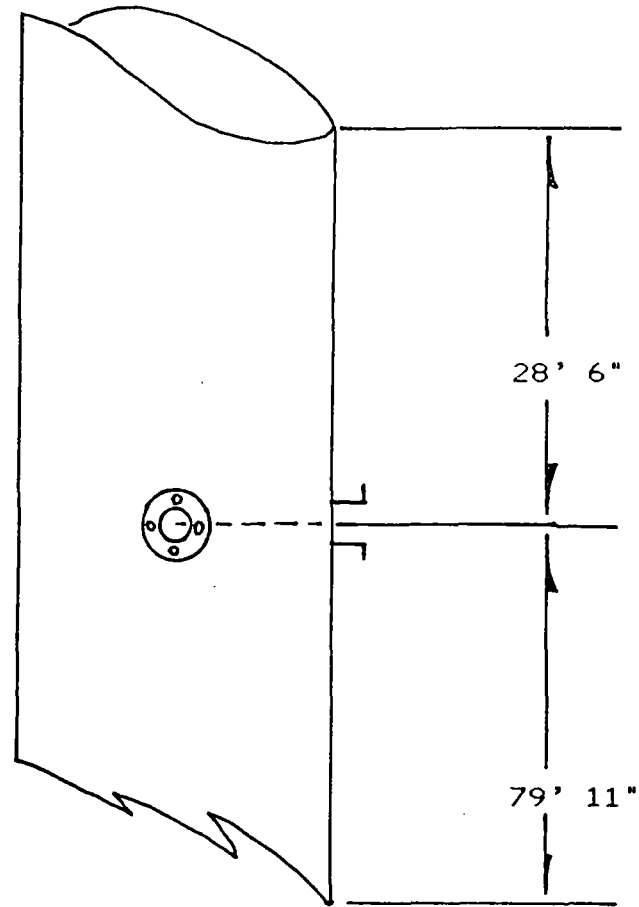

Traverse Point Number	Distance from inside wall
1	2.1"
2	7.0"
3	14.2"
4	33.8"
5	41.0"
6	45.9"

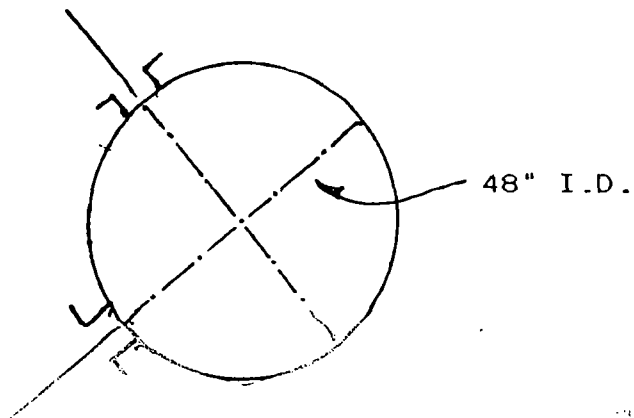


FIGURE 1

TRaverse POINT DESCRIPTION

"B" PAPER PRODUCTION

SAMPLING AND ANALYTICAL PROCEDURES

The methods described in EPA Methods 1, 2, 3, 4, 9 and 13B contained in 40 CFR 60, Appendix A and adopted by reference in Chapter 62-297.401 F.A.C. are used when testing during compliance by CF Industries, Inc.

APPENDIX "A"

EMISSION CALCULATIONS AND RESULTS

CF INDUSTRIES, INC.
PLANT CITY PHOSPHATE COMPLEX

SOURCE SAMPLING NOMENCLATURE SHEET

Pb	= Barometric pressure, in Hg
Ps	= Stack pressure, in Hg
As	= Stack area, sq. ft.
As'	= Effective area of positive stack gas flow, sq. ft.
Ts	= Stack temperature 'R'
Tm	= Meter temperature "R"
Δ Pavg	= Average square root of velocity head in. H ₂ O
Cp	= S-type pitot tube correction factor
Kp	= 85.48 ft/sec (lb mole - °R) 1/2
Ms	= Molecular weight of gas at stack conditions
Md	= Molecular weight of gas at dry conditions
lwo	= Proportion by volume of water vapor in gas stream
Vwstd	= Volume of water vapor in gas sample
Vic	= Total volume of liquid collected in impinger & silica gel
PH ₂ O	= Density of water 1 gm/ml
MH ₂ O	= Molecular weight of water 18 lb/lb mole
R	= Ideal gas constant, 28.83 in. Hg-cu ft/lb-mole °R
Tstd	= Absolute temp. at standard conditions, 528 °R
Pstd	= Absolute pressure at standard conditions, 29.92 in. Hg.
Vmstd	= Volume of gas sample through dry gas meter (standard conditions) cu. ft.
Vm	= Volume of gas sample through the dry gas meter (meter condition) cu. ft.
Δ h	= Orifice pressure of sampling meter
S.T.P.	= Standard condition, dry, 528 °R, 29.92 in. Hg
An	= Sampling nozzle area, square feet
Vs	= Velocity of stack gas, feet per second
Qs	= Volumetric flow rate, dry basis, standard conditions, CFM
Cs	= Concentration of particulate matter in stack gas, gr/SCF
CF	= Concentration of fluoride in stack gas gr/SCF
MF	= Total amount of fluoride collected, mg
Mn	= Total amount of particulate matter collected, mg
I	= Percent isokinetic volume sampled
O	= Sampling time

$$V_{wstd} = 0.04707 \text{ cuft/ml } (V_1)$$

$$V_{mstd} = V_m \left(\frac{T_{std}}{T_m} \right) \left(\frac{P_{bar} + \frac{\Delta H}{13.6}}{P_{std}} \right)$$

$$B_{wo} = \frac{V_{wstd}}{V_{wstd} + V_{mstd}}$$

$$M_s = M_d (1 - B_{wo}) + 18 (B_{wo})$$

$$V_s(\text{avg}) = K_p C_p \sqrt{P(\text{avg})} \sqrt{\frac{460 + T_s}{M_s P_s}}$$

$$Q_s = 60 (1 - B_{wo}) V_s A_s \left(\frac{T_{std}}{T_s} \right) \left(\frac{P_s}{P_{std}} \right)$$

PERCENT ISOKINETIC

$$I = \frac{T_s (1.667) \left[(0.00267) V_1 + \left(\frac{T_{std}}{T_m} \right) P_{bar} + \frac{\Delta H}{13.6} \right]}{\theta V_s P_s A_n}$$

$$C_s = 0.0154 \text{ grs/mg } \frac{M_f \text{ or } M_n}{V_{mstd}}$$

$$\text{lbs/hr} = (C_s \times Q_s \times 60) / 7000$$

$$\text{lbs/day} = \text{lbs/hr} \times 24 \text{ hrs/day}$$

J. H. Falls
3/15/93

B PAP

Permit No. 0570005-007-AV
Emission Unit 009

RUN NUMBER	1	2	3	4	5	6
DATE	07-Jun-99	07-Jun-99	07-Jun-99	08-Jun-99	08-Jun-99	08-Jun-99
TIME START	11:05 AM	3:12 PM	4:51 PM	10:40 AM	12:27 PM	12:27 PM
TIME END	12:17 PM	4:23 PM	6:00 PM	11:51 AM	1:35 PM	3:10 PM
BP, INCHES Hg	30.02	30.02	30.02	29.96	29.97	29.96
STACK PRESSURE, INCHES Hg	30.09	30.05	30.03	30.04	30.04	30.04
AVG.SQ.ROOT(VEL. HEAD) IN Hg	0.7040	0.6590	0.6470	0.6860	0.6590	0.6590
ORIFICE PRESS. OF METER, IN WATER	2.6200	2.3700	2.3400	2.6200	2.4000	2.4000
AVG STACK T, F	112.1	112.8	112.3	112.1	112.8	111.6
STACK, DRY BULB	112.1	112.8	112.3	112.1	112.8	111.6
METER TEMPERATURE, F	90.3	98.9	100.9	91.3	100.9	100.9
VOL. OF GAS, DM CONDITIONS, FT3	42.476	40.183	39.824	42.175	40.183	40.183
VOL. GAS, STP, DRY COND. FT3	41.153	38.309	37.829	40.707	38.309	37.430
STACK GAS MOISTURE, % VOLUME	6.46	6.97	7.04	7.08	7.25	7.05
MW OF STACK GAS, DRY COND.	28.85	28.85	28.85	28.85	28.85	28.85
MW OF STACK GAS, STACK COND.	28.15	28.09	28.09	28.08	28.09	28.09
PITOT CORRECTION FACTOR	0.84	0.84	0.84	0.84	0.84	0.84
STACK GAS VELOCITY, STACK COND. FT3/SEC	41.54	38.98	38.27	40.56	38.77	37.27
STACK AREA, FT2	12.566	12.566	12.566	12.566	12.566	12.566
EFFECTIVE STACK AREA, FT2	12.566	12.566	12.566	12.566	12.566	12.566
STACK GAS FLOW-RATE AT STP, SCFMD	27194	25309	24835	26333	25060	24151
NET TIME OF TEST, MINUTES	60	60	60	60	60	60
SAMPLE NOZZLE AREA, FT2	0.000325	0.000325	0.000325	0.000325	0.000325	0.000325
PERCENT ISOKINETIC	97.5	97.6	98.2	99.6	99.8	99.8
FLUORIDE, MG.	2.81	2.88	2.71	2.86	3.01	2.70
FLUORIDE, LB/HR	0.25	0.25	0.23	0.24	0.26	0.23
FLUORIDE, LB/DAY	5.88	6.03	5.64	5.86	6.16	5.86
FLUORIDE, LB/HR. LIMIT	1.04	1.04	1.04	1.04	1.04	1.04
FLUORIDE, LB/DAY LIMIT	24.9	24.9	24.9	24.9	24.9	24.9
PRODUCTION RATE, TPH P2O5 INPUT	96.5	96.5	96.5	96.5	96.5	96.5
PRODUCTION RATE, TPH LIMIT	97.0	97.0	97.0	97.0	97.0	97.0
PRODUCTION RATE, TPD P2O5 INPUT	2316	2316	2316	2316	2314	2314
PRODUCTION RATE, TPD LIMIT	2328	2328	2328	2328	2326	2328
PHOSPHATE ROCK SLURRY, TPH	476.37	476.37	476.37	469.62	467.97	467.83
100 % SULFURIC ACID, TPH	247.16	245.88	248.09	241.28	241.57	242.68
WATER, TPH	18.99	18.99	18.99	18.99	18.96	18.97
LBS F/TON OF P2O5 (INPUT)	0.003	0.003	0.002	0.002	0.003	0.002
LBS F/TON OF P2O5 LIMIT	0.02	0.02	0.02	0.02	0.02	0.02

EMISSION CALCULATIONS

Date: June 7, 1999

Unit: B PAP

Run no. 1

$$\begin{aligned}V_{wstd} &= 0.04707 \text{ Cuft/ml} \times (v_1) \\ &= 0.04707 \text{ Cuft/ml} \times 60.4 \text{ ml} \\ &= \mathbf{2.843 \text{ Cuft.}}\end{aligned}$$

$$\begin{aligned}V_{mstd} &= V_m \left[\frac{T_{std}}{T_m + 460} \right] \left[\frac{P_{bar} + (H / 13.6)}{P_{std}} \right] Y_i \\ &= 42.476 \text{ Cuft} \times \left[\frac{528}{460 + 90.3} \right] \times \left[\frac{(30.02 + (2.62 / 13.6))}{29.92} \right] \times 1.00 \\ &= \mathbf{41.153 \text{ Cuft.}}\end{aligned}$$

$$\begin{aligned}B_{wo} &= \frac{V_{wstd}}{V_{wstd} + V_{mstd}} \\ &= \frac{2.843}{2.843 + 41.153} \times 100 \\ &= \mathbf{6.46 \%}\end{aligned}$$

$$\begin{aligned}M_s &= M_d (1 - B_{wo}) + 18 (B_{wo}) \\ &= 28.85 \times (1 - 0.0646) + 18 \times 0.0646 \\ &= \mathbf{28.15}\end{aligned}$$

$$\begin{aligned}V_s (\text{avg}) &= K_p C_p \sqrt{P(\text{avg}) (460 + T_s) / (M_s P_s)} \\ &= 85.48 \times 0.84 \times 0.7040 \sqrt{(460 + 112.1) / (28.15 \times 30.09)} \\ &= \mathbf{41.54 \text{ ft/sec}}\end{aligned}$$

$$\begin{aligned}Q_s &= 60 (1 - B_{wo}) V_s A_s (T_{std} / T_s) (P_s / P_{std}) \\ &= 60 (1 - 0.0646) \times 41.54 \times 12.566 \times (528 / (460 + 112.1)) \times (30.09 / 29.92) \\ &= \mathbf{27,194 \text{ scfm}}\end{aligned}$$

$$\begin{aligned}
 Cs &= 0.0154 \text{ grs/mg} \times (\text{total mg of sample}) / Vmstd \\
 &= 0.0154 \text{ grs/mg} \times 2.81 \text{ mg} / 41.153 \text{ cuft} \\
 &= 0.0011 \text{ grs/cuft}
 \end{aligned}$$

$$\begin{aligned}
 \text{lbs/hr} &= (Cs \times Qs \times 60 \text{ min/hr}) / 7000 \text{ grs/lb} \\
 &= (0.0011 \times 27194 \times 60) / 7000 \\
 &= 0.25 \text{ lbs/hr Fluoride}
 \end{aligned}$$

$$\begin{aligned}
 \text{lbs/day} &= \text{lbs/hr} \times 24 \text{ hrs/day} \\
 &= 0.25 \times 24 \\
 &= 5.88 \text{ lbs/day Fluoride}
 \end{aligned}$$

Percent Isokinetic:

$$\begin{aligned}
 I &= \frac{Ts (1.667) ((0.00267) V1) + (Vm / Tm) ((Pbar + (^H / 13.6)))}{0 Vs Ps An} \\
 &= \frac{(460 + 112.1) (1.667) ((0.00267 \times 60.4) + (42.476 / (460 + 90.3))) \times ((30.02 + (2.62 / 13.6)))}{60 \times 41.54 \times 30.09 \times 0.000325} \\
 &= 97.5 \%
 \end{aligned}$$

EMISSION CALCULATIONS

Date: June 8, 1999

Unit: B PAP

Run no. 4

$$\begin{aligned}
 V_{wstd} &= 0.04707 \text{ Cuft/ml} \times (v_1) \\
 &= 0.04707 \text{ Cuft/ml} \times 65.9 \text{ ml} \\
 &= \mathbf{3.102 \text{ Cuft.}}
 \end{aligned}$$

$$\begin{aligned}
 V_{mstd} &= V_m \left[\frac{T_{std}}{T_m + 460} \right] \left[\frac{P_{bar} + (H / 13.6)}{P_{std}} \right] Y_i \\
 &= 42.175 \text{ Cuft} \times \left[\frac{528}{460 + 91.3} \right] \times \left[\frac{(29.96 + (2.62 / 13.6))}{29.92} \right] \times 1.00 \\
 &= \mathbf{40.707 \text{ Cuft.}}
 \end{aligned}$$

$$\begin{aligned}
 B_{wo} &= \frac{V_{wstd}}{V_{wstd} + V_{mstd}} \\
 &= \frac{3.102}{3.102 + 40.707} \times 100 \\
 &= \mathbf{7.08 \%}
 \end{aligned}$$

$$\begin{aligned}
 M_s &= M_d (1 - B_{wo}) + 18 (B_{wo}) \\
 &= 28.85 \times (1 - 0.0708) + 18 \times 0.0708 \\
 &= \mathbf{28.08}
 \end{aligned}$$

$$\begin{aligned}
 V_s (\text{avg}) &= K_p C_p \sqrt{P(\text{avg})} \sqrt{(460 + T_s) / (M_s P_s)} \\
 &= 85.48 \times .84 \times 0.6860 \sqrt{(460 + 112.1) / (28.08 \times 30.04)} \\
 &= \mathbf{40.56 \text{ ft/sec}}
 \end{aligned}$$

$$\begin{aligned}
 Q_s &= 60 (1 - B_{wo}) V_s A_s (T_{std} / T_s) (P_s / P_{std}) \\
 &= 60 (1 - 0.0708) \times 40.56 \times 12.566 \times (528 / (460 + 112.1)) \times (30.04 / 29.92) \\
 &= \mathbf{26,333 \text{ scfm}}
 \end{aligned}$$

$$\begin{aligned}
Cs &= 0.0154 \text{ grs/mg} \times (\text{total mg of sample}) / Vmstd \\
&= 0.0154 \text{ grs/mg} \times 2.86 \text{ mg} / 40.707 \text{ cuft} \\
&= 0.0011 \text{ grs/cuft}
\end{aligned}$$

$$\begin{aligned}
\text{lbs/hr} &= (Cs \times Qs \times 60 \text{ min/hr}) / 7000 \text{ grs/lb} \\
&= (0.0011 \times 26333 \times 60) / 7000 \\
&= 0.24 \text{ lbs/hr Fluoride}
\end{aligned}$$

$$\begin{aligned}
\text{lbs/day} &= \text{lbs/hr} \times 24 \text{ hrs/day} \\
&= 0.24 \times 24 \\
&= 5.86 \text{ lbs/day Fluoride}
\end{aligned}$$

Percent Isokinetic:

$$\begin{aligned}
I &= \frac{Ts (1.667) ((0.00267) V1) + (Vm / Tm) ((Pbar + (^H / 13.6)))}{0 Vs Ps An} \\
&= \frac{(460 + 112.1) (1.667) ((0.00267 \times 65.9) + (42.175 / (460 + 91.3))) \times ((29.96 + (2.62 / 13.6)))}{60 \times 40.56 \times 30.04 \times 0.000325} \\
&= 99.6 \%
\end{aligned}$$

Production Rate

DATE: 07-Jun-99

SAMPLING TIME FROM: 11:05 AM

TO 6:00 PM

STATEMENT OF PROCESS WEIGHT:

COMPANY NAME: CF INDUSTRIES, INC. PLANT CITY PHOSPHATE COMPLEX
 MAILING ADDRESS: P.O. DRAWER L PLANT CITY, FL 33564
 SOURCE IDENTIFICATION: "B" PAP PRODUCTION FACILITY
 SOURCE LOCATION: "B" PAP PRODUCTION STACK

PERMIT SOURCE: 0570005-007-AV
 Emission Unit 009

DATA ON OPERATING CYCLE TIME:

START OF OPERATION, TIME
 END OF OPERATION, TIME
 ELAPSED TIME
 IDLE TIME DURING CYCLE

	RUN #1	RUN #2	RUN #3	
START OF OPERATION, TIME	11:05 AM	3:12 PM	4:51 PM	
END OF OPERATION, TIME	12:17 PM	4:23 PM	6:00 PM	
ELAPSED TIME	72 MIN	71 MIN	69 MIN	
IDLE TIME DURING CYCLE	0	0	0	

DESIGN PROCESS RATING:

PROCESS WEIGHT RATE (INPUT) 77.3 TPH P2O5

PRODUCT (OUTPUT) _____ TPH

DATA ON ACTUAL PROCESS RATE DURING OPERATION CYCLE:

MATERIAL: PHOSPHATE ROCK, TPH P2O5
 MATERIAL: 100 % SULFURIC ACID, TPH
 MATERIAL: WATER, TPH

RUN #1	RUN #2	RUN #3
476.37	476.37	476.37
247.16	245.53	243.09
13.99	13.99	13.99

TOTAL PROCESS WEIGHT RATE:
 PRODUCT: PHOSPHORIC ACID SLURRY, TPH
 INPUT RATE: P2O5, TPH

RUN #1	RUN #2	RUN #3
772.52	771.24	773.75
96.50	96.50	96.50

I certify that the above statement is true to the best of my knowledge and belief:

Signature: _____

F. S. Simpson

Title: _____

Prod. Eng.

Scrubber's Operating Parameters

DATE: 07-Jun-99 SAMPLING TIME FROM: 11:05 AM TO 6:00 PM

COMPANY NAME: CF INDUSTRIES, INC. PLANT CITY PHOSPHATE COMPLEX
 MAILING ADDRESS: P.O. DRAWER L PLANT CITY, FL 33564
 SOURCE IDENTIFICATION: "B" PAP PRODUCTION FACILITY
 SOURCE LOCATION: "B" PAP PRODUCTION STACK

PERMIT SOURCE: 0570005-007-AV

TYPE OF SCRUBBER LIQUID: Pond Water

PACKED BED SCRUBBER	START	RUN #1	RUN #2	RUN #3	COMMENTS
		END	11:05 AM	3:12 PM	
OUTLET	AVERAGE	100°	102°	100°	
TEMPERATURES F	HIGH	100°	102°	100°	
	LOW	100°	102°	100°	

PACKED BED SCRUBBER	START	RUN #1	RUN #2	RUN #3	COMMENTS
		END	11:05 AM	3:12 PM	
FAN	AVERAGE	151	177	151	
AMPS	HIGH	151	177	151	
	LOW	151	177	151	

I certify that the above statement is true to the best of my knowledge and belief:

Signature: *J. E. Simpson*
 Title: *Prod. Eng.*

bpaprate.xls

Production Rate

DATE: 08-Jun-99 SAMPLING TIME FROM: 10:40 AM TO 3:10 PM

STATEMENT OF PROCESS WEIGHT:

COMPANY NAME: CF INDUSTRIES, INC. PLANT CITY PHOSPHATE COMPLEX
 MAILING ADDRESS: P.O. DRAWER L PLANT CITY, FL 33564
 SOURCE IDENTIFICATION: "B" PAP PRODUCTION FACILITY
 SOURCE LOCATION: "B" PAP PRODUCTION STACK

PERMIT SOURCE: 0570005-007-AV
 Emission Unit 009

DATA ON OPERATING CYCLE TIME:

START OF OPERATION, TIME
 END OF OPERATION, TIME
 ELAPSED TIME
 IDLE TIME DURING CYCLE

	RUN #1	RUN #2	RUN #3	
START OF OPERATION, TIME	10:40 AM	12:23 PM	2:00 PM	
END OF OPERATION, TIME	11:51 AM	1:35 PM	3:10 PM	
ELAPSED TIME	71 MIN	72 MIN	70 MIN	
IDLE TIME DURING CYCLE	0	0	0	

DESIGN PROCESS RATING:

PROCESS WEIGHT RATE (INPUT) 37.8 TPH P2O5 PRODUCT (OUTPUT) _____ TPH

DATA ON ACTUAL PROCESS RATE DURING OPERATION CYCLE:

MATERIAL: PHOSPHATE ROCK, TPH P2O5
 MATERIAL: 100 % SULFURIC ACID, TPH
 MATERIAL: WATER, TPH

RUN #1	RUN #2	RUN #3
469.62	467.97	467.33
241.23	241.57	242.63
13.49	13.96	13.97

TOTAL PROCESS WEIGHT RATE:
 PRODUCT: PHOSPHORIC ACID SLURRY, TPH
 INPUT RATE: P2O5, TPH

RUN #1	RUN #2	RUN #3
729.39	723.50	729.43
96.50	96.33	96.42

I certify that the above statement is true to the best of my knowledge and belief:

Signature: J.E. Sivamajin
 Title: Prodⁿ Eng.

Scrubber's Operating Parameters

DATE: 08-Jun-99

SAMPLING TIME FROM: 10:40 AM TO 3:10 PM

COMPANY NAME: CF INDUSTRIES, INC. PLANT CITY PHOSPHATE COMPLEX
 MAILING ADDRESS: P.O. DRAWER L PLANT CITY, FL 33564
 SOURCE IDENTIFICATION: "B" PAP PRODUCTION FACILITY
 SOURCE LOCATION: "B" PAP PRODUCTION STACK

PERMIT SOURCE: 0570005-007-AV

TYPE OF SCRUBBER LIQUID: POND WATER

	START	RUN #1	RUN #2	RUN #3	COMMENTS
PACKED BED SCRUBBER		10:40 AM	12:23 PM	2:00 PM	
	END	11:51 AM	1:35 PM	3:10 PM	
OUTLET	AVERAGE	100°	101°	102°	
TEMPERATURES F	HIGH	100°	102°	102°	
	LOW	100°	100°	102°	

	START	RUN #1	RUN #2	RUN #3	COMMENTS
PACKED BED SCRUBBER		10:40 AM	12:23 PM	2:00 PM	
	END	11:51 AM	1:35 PM	3:10 PM	
FAN	AVERAGE	180	179.5	179	
AMPS	HIGH	180	180	179	
	LOW	180	179	179	

I certify that the above statement is true to the best of my knowledge and belief:

Signature: FE Simpson
 Title: Prod. Eng

bpaprate.xls

APPENDIX "B"

FIELD DATA

4C0110

METHOD 5 FIELD DATA

Run 1

Plant Site: Plant City, Fl.
Sampling Location: B Pap

Date: 06/07/1999
Stack ID (in): 48.01

Pt	Time min	Volume ft3	System Vacuum inHg	Delta P inH2O	Delta H inH2O	Ti °F	To °F	Ts °F	Tf °F	Wing °F
1	5.0	2.958	1.28	0.353	2.093	81.44	81.82	106.14	240.75	57.80
2	10.0	6.779	1.94	0.600	2.901	83.00	82.73	112.14	242.33	58.24
3	15.0	10.793	2.10	0.649	3.123	85.10	84.26	113.33	242.27	61.90
4	20.0	14.518	1.86	0.558	2.780	87.19	85.98	113.22	241.01	61.55
5	25.0	18.067	1.69	0.498	2.584	89.04	87.66	113.41	244.46	61.48
6	30.0	21.171	1.38	0.383	2.237	90.48	89.16	112.53	242.49	61.41
7	35.0	24.405	1.45	0.414	2.302	92.29	92.17	109.06	239.05	58.74
8	40.0	28.162	1.84	0.551	2.779	93.61	92.83	112.46	240.17	55.74
9	45.0	32.093	1.98	0.603	2.981	95.12	93.87	113.61	243.29	56.14
10	50.0	35.872	1.86	0.553	2.801	96.49	94.93	113.49	244.29	57.86
11	55.0	39.651	1.87	0.555	2.811	97.57	95.94	113.39	242.06	57.09
12	60.0	42.476	1.21	0.305	2.055	98.34	96.92	112.95	243.21	58.73

4C0110

METHOD 5 FIELD DATA

Run 2

Plant Site: Plant City Fla
Sampling Location: B Pap

Date: 06/07/1999
Stack ID (in): 48.00

Pt	Time min	Volume ft3	System Vacuum inHg	Delta P inH2O	Delta H inH2O	Ti °F	To °F	Ts °F	Tf °F	Temp °F
1	5.0	2.810	1.20	0.350	1.961	96.91	97.31	108.77	242.64	73.15
2	10.0	6.471	1.87	0.517	2.586	96.89	97.39	114.19	243.20	61.12
3	15.0	10.331	2.07	0.575	2.822	97.61	97.64	114.78	243.47	61.78
4	20.0	13.978	1.89	0.511	2.599	98.55	98.13	114.51	240.82	57.00
5	25.0	17.292	1.62	0.420	2.317	99.25	98.60	114.20	242.33	57.11
6	30.0	20.231	1.36	0.331	2.072	99.60	98.90	113.63	244.13	58.11
7	35.0	22.976	1.19	0.287	1.930	99.15	99.08	107.05	242.43	64.10
8	40.0	26.466	1.76	0.468	2.436	99.20	99.01	112.57	244.40	59.62
9	45.0	30.228	2.00	0.543	2.699	99.72	99.17	113.54	242.52	61.20
10	50.0	33.821	1.86	0.492	2.526	100.30	99.46	113.50	243.66	62.68
11	55.0	37.389	1.85	0.486	2.510	100.92	99.89	113.79	244.10	63.54
12	60.0	40.183	1.29	0.294	1.972	101.41	100.47	113.42	244.55	65.21

†C011©

METHOD 5 FIELD DATA

Run 3

Plant Site: Plant City Fla
Sampling Location: BPap

Date: 06/07/1999
Stack ID (in): 48.00

Pt	Time min	Volume ft3	System Vacuum inHg	Delta P inH2O	Delta H inH2O	Ti °F	To °F	Ts °F	Tf °F	Wt %
1	5.0	3.022	1.29	0.349	2.095	100.70	100.47	106.97	236.42	66.44
2	10.0	6.633	1.73	0.499	2.559	100.89	100.33	113.04	243.18	61.26
3	15.0	10.481	1.93	0.563	2.806	101.54	100.57	113.95	242.01	62.21
4	20.0	14.077	1.74	0.491	2.544	102.04	100.84	113.82	241.00	61.79
5	25.0	17.378	1.52	0.416	2.291	102.18	101.01	113.72	243.97	60.40
6	30.0	20.270	1.25	0.316	2.016	102.11	101.08	113.23	242.56	59.43
7	35.0	22.756	1.02	0.233	1.772	100.89	100.72	108.47	241.69	66.94
8	40.0	26.244	1.66	0.465	2.418	100.61	100.39	112.40	241.66	60.84
9	45.0	29.982	1.87	0.534	2.657	100.75	100.18	113.15	244.01	60.97
10	50.0	33.534	1.74	0.479	2.472	101.04	100.16	113.00	243.04	61.46
11	55.0	37.103	1.76	0.485	2.498	101.19	100.24	113.33	242.96	61.29
12	60.0	39.824	1.21	0.279	1.912	101.17	100.31	112.66	242.79	63.28

†C0110

METHOD 5 FIELD DATA

RUN 4

Plant Site: Plant City, FL
Sampling Location: B PAP

Date: 06/08/1999
Stack ID (in): 48.00

Pt	Time	Volume	System	Delta	Delta	Ti	To	Ts	Tf	Timp
	min	ft3	Vacuum	P	H	°F	°F	°F	°F	°F
			inHg	inH2O	inH2O					
1	5.0	3.135	1.53	0.385	2.224	82.63	82.92	107.24	238.47	60.49
2	10.0	7.045	2.25	0.600	3.015	84.35	83.94	112.30	243.22	55.13
3	15.0	11.138	2.42	0.649	3.236	86.55	85.45	113.27	240.75	58.03
4	20.0	14.940	2.12	0.556	2.862	88.74	87.18	113.23	243.17	58.87
5	25.0	18.464	1.86	0.476	2.573	90.54	88.85	113.29	243.38	56.54
6	30.0	21.618	1.56	0.377	2.270	91.97	90.41	112.79	244.05	56.62
7	35.0	24.478	1.31	0.318	2.052	93.20	93.00	107.80	241.49	62.20
8	40.0	28.219	2.03	0.529	2.761	94.36	93.54	112.38	242.04	56.84
9	45.0	32.143	2.21	0.578	2.977	95.79	94.48	113.46	243.32	57.94
10	50.0	35.906	2.06	0.529	2.783	97.09	95.47	113.14	243.11	58.64
11	55.0	39.676	2.07	0.526	2.787	98.16	96.45	113.36	242.88	58.87
12	60.0	42.175	1.14	0.230	1.870	98.73	97.32	112.68	245.22	61.33

4C0110

METHOD 5 FIELD DATA

RUN 5

Plant Site: Plant City, FL
Sampling Location: B PAP

Date: 06/08/1999
Stack ID (in): 48.00

Pt	Time min	Volume ft ³	System Vacuum inHg	Delta P inH ₂ O	Delta H inH ₂ O	Ti °F	To °F	Ts °F	Tf °F	Temp °F
1	5.0	2.993	1.28	0.331	2.112	98.83	98.91	108.17	240.24	58.42
2	10.0	6.733	1.90	0.520	2.732	99.20	98.90	113.02	244.42	59.42
3	15.0	10.708	2.14	0.586	3.010	99.86	99.06	114.01	243.00	59.58
4	20.0	14.390	1.88	0.498	2.667	100.87	99.64	113.78	242.44	59.72
5	25.0	17.748	1.61	0.415	2.382	101.38	100.14	113.66	243.61	59.84
6	30.0	20.704	1.32	0.319	2.106	101.56	100.47	113.29	243.53	59.96
7	35.0	23.377	1.10	0.275	1.921	100.85	100.64	108.84	244.28	60.08
8	40.0	26.962	1.78	0.474	2.548	100.93	100.55	113.30	243.64	56.10
9	45.0	30.799	2.02	0.544	2.817	101.52	100.75	114.07	241.96	56.75
10	50.0	34.445	1.86	0.487	2.618	102.29	101.23	114.08	245.37	59.42
11	55.0	38.063	1.84	0.477	2.588	102.85	101.69	114.39	241.79	60.29
12	60.0	40.941	1.31	0.301	2.051	103.27	102.17	113.95	245.50	61.95

4C0110

METHOD 5 FIELD DATA

Qunb

Plant Site: Plant City, FL
Sampling Location: B PAP

Date: 06/08/1999
Stack ID (in): 48.00

Pt	Time min	Volume ft3	System Vacuum inHg	Delta P inH2O	Delta H inH2O	Ti °F	To °F	Ts °F	Tf °F	Flow CF
1	5.0	2.749	1.08	0.273	1.941	101.39	101.39	104.13	239.51	65.62
2	10.0	6.330	1.65	0.468	2.559	101.16	100.98	111.49	242.71	58.67
3	15.0	10.193	1.87	0.546	2.828	101.50	100.89	113.44	243.83	59.36
4	20.0	13.768	1.66	0.467	2.535	101.98	101.04	113.34	242.95	61.21
5	25.0	17.039	1.45	0.391	2.278	102.11	101.13	113.01	242.95	62.57
6	30.0	19.895	1.21	0.298	2.017	102.14	101.25	112.73	243.80	63.57
7	35.0	22.754	1.20	0.302	2.003	101.43	101.27	108.61	239.57	69.51
8	40.0	26.345	1.70	0.473	2.537	101.53	101.16	111.85	242.37	58.33
9	45.0	30.086	1.82	0.510	2.679	101.83	101.14	112.74	242.01	59.33
10	50.0	33.652	1.70	0.462	2.498	102.28	101.33	112.26	244.72	57.38
11	55.0	37.112	1.62	0.436	2.411	102.58	101.54	112.62	242.89	61.09
12	60.0	39.537	1.03	0.214	1.771	102.51	101.67	112.47	242.82	62.87

METHOD 5 LEAK TEST DATA

Plant Site: Plant City, FL

Sampling Location: B PAP

Date: 06/07/1999

Stack ID: 009

Test	Leak Rate ft3/min	Sys Vac Pressure inHg	Initial Vol ft3	Final Vol ft3
6:10 AM 1 <i>EL</i>	0.01250	16.10	0.07200	0.08100
10:50 AM 2 <i>EL</i>	0.01390	5.48	42.49800	42.51200
12:35 PM 3 <i>EL</i>	0.01200	4.75	42.52300	42.54700
2:00 PM 4 <i>EL</i>	0.01200	5.45	40.20200	40.21700
4:30 PM 5 <i>EL</i>	0.01200	14.13	40.27100	41.54900
6:10 PM 6 <i>EL</i>	0.01200	5.47	39.84400	39.85800
7	0.00000	0.00	0.00000	0.00000
8	0.00000	0.00	0.00000	0.00000

METHOD 5 LEAK TEST DATA

Plant Site: Plant City, FL

Sampling Location: B PAP

Date: 06/08/1999

Stack ID: 009

Test	Leak Rate ft3/min	Sys Vac Pressure inHg	Initial Vol ft3	Final Vol ft3
6/8/99 10:30 AM 1 <i>EL</i>	0.01200	16.00	0.08000	0.09400
11:53 AM 2 <i>EL</i>	0.01200	5.40	42.19400	42.20900
12:15 PM 3 <i>EL</i>	0.01200	4.80	42.22100	42.23400
1:45 PM 4 <i>EL</i>	0.01200	5.33	40.96100	40.98900
1:55 PM 5 <i>EL</i>	0.01200	4.83	41.00000	41.02700
3:20 PM 6 <i>EL</i>	0.01200	6.82	39.59300	39.61900
7	0.00000	0.00	0.00000	0.00000
8	0.00000	0.00	0.00000	0.00000

CF INDUSTRIES, INC.

PLANT CITY PHOSPHATE COMPLEX LABORATORY ANALYSIS RECORD

DATE	<u>07-Jun-99</u>
TIME	<u>11:05 - 12:17</u>
STACK	<u>B PAP</u>
RUN	<u>#1</u>

MOISTURE CONTENTS

IMPINGER	#1	#2	#3	#4
WEIGHT AFTER RUN, GRAMS	<u>707.7</u>	<u>700.3</u>	<u>583.3</u>	<u>884.0</u>
WEIGHT BEFORE RUN, GRAMS	<u>676.0</u>	<u>678.8</u>	<u>580.9</u>	<u>879.2</u>
WEIGHT GAIN/LOSS, GRAMS	<u>31.7</u>	<u>21.5</u>	<u>2.4</u>	<u>4.8</u>
TOTAL WEIGHT GAIN, GRAMS	<u>60.4</u>			

SAMPLE SOLUTIONS ANALYSIS

VOLUME OF SAMPLE, ML	<u>1000</u>
CONCENTRATION, UG/ML	<u>2.81</u>
TOTAL WEIGHT POLLUTANT, MGS	<u>2.81</u>

ANALYST

Lloyd B. Camp

padcomp.xls

CF INDUSTRIES, INC.

PLANT CITY PHOSPHATE COMPLEX LABORATORY ANALYSIS RECORD

DATE	07-Jun-99
TIME	15:12 - 16:23
STACK	B PAP
RUN	#2

MOISTURE CONTENTS

IMPINGER	#1	#2	#3	#4
WEIGHT AFTER RUN, GRAMS	717.1	669.9	580.7	876.0
WEIGHT BEFORE RUN, GRAMS	672.1	660.8	579.4	870.4
WEIGHT GAIN/LOSS, GRAMS	45.0	9.1	1.3	5.6
TOTAL WEIGHT GAIN, GRAMS	<u>61.0</u>			

SAMPLE SOLUTIONS ANALYSIS

	F
VOLUME OF SAMPLE, ML	<u>1000</u>
CONCENTRATION, UG/ML	<u>2.88</u>
TOTAL WEIGHT POLLUTANT, MGS	<u>2.88</u>

ANALYST

Lloyd B. Camp

padcomp.xls

CF INDUSTRIES, INC.

PLANT CITY PHOSPHATE COMPLEX LABORATORY ANALYSIS RECORD

DATE	<u>07-Jul-99</u>
TIME	<u>16:51 - 18:00</u>
STACK	<u>3-P-2</u>
RUN	<u>3</u>

MOISTURE CONTENTS

IMPINGER	#1	#2	#3	#4
WEIGHT AFTER RUN, GRAMS	<u>712.5</u>	<u>667.9</u>	<u>588.7</u>	<u>36.9</u>
WEIGHT BEFORE RUN, GRAMS	<u>669.2</u>	<u>659.0</u>	<u>586.5</u>	<u>387.1</u>
WEIGHT GAIN/LOSS, GRAMS	<u>43.3</u>	<u>8.9</u>	<u>2.2</u>	<u>6.5</u>
TOTAL WEIGHT GAIN, GRAMS	<u>60.9</u>			

SAMPLE SOLUTIONS ANALYSIS

	F
VOLUME OF SAMPLE, ML	<u>1000</u>
CONCENTRATION, UG/ML	<u>2.71</u>
TOTAL WEIGHT POLLUTANT, MGS	<u>2.71</u>

ANALYST Lloyd B. Camp

padcomp.xls

CF INDUSTRIES, INC.

PLANT CITY PHOSPHATE COMPLEX LABORATORY ANALYSIS RECORD

DATE
TIME
STACK
RUN

03-Jun-99
10:40 - 11:51
3 P.P.
#

MOISTURE CONTENTS

IMPINGER

	#1	#2	#3	#4
WEIGHT AFTER RUN, GRAMS	721.7	688.3	578.1	335.0
WEIGHT BEFORE RUN, GRAMS	676.0	677.8	576.0	227.4
WEIGHT GAIN/LOSS, GRAMS	45.7	10.5	2.1	7.6
TOTAL WEIGHT GAIN, GRAMS	<u>65.9</u>			

SAMPLE SOLUTIONS ANALYSIS

	F
VOLUME OF SAMPLE, ML	<u>1000</u>
CONCENTRATION, UG/ML	<u>2.86</u>
TOTAL WEIGHT POLLUTANT, MGS	<u>2.86</u>

ANALYST

Floyd B. Camp

padcomp.xls

CF INDUSTRIES, INC.

PLANT CITY PHOSPHATE COMPLEX LABORATORY ANALYSIS RECORD

DATE	08-Jun-99
TIME	12:23 - 13:35
STACK	B PAP
RUN	#5

MOISTURE CONTENTS

IMPINGER	#1	#2	#3	#4
WEIGHT AFTER RUN, GRAMS	715.7	668.5	580.8	880.2
WEIGHT BEFORE RUN, GRAMS	670.8	658.7	579.0	872.2
WEIGHT GAIN/LOSS, GRAMS	44.9	9.8	1.8	8.0
TOTAL WEIGHT GAIN, GRAMS	64.5			

SAMPLE SOLUTIONS ANALYSIS

	F
VOLUME OF SAMPLE, ML	1000
CONCENTRATION, UG/ML	3.01
TOTAL WEIGHT POLLUTANT, MGS	3.01

ANALYST *Floyd H. Camp*

padcomp.xls

CF INDUSTRIES, INC.

PLANT CITY PHOSPHATE COMPLEX LABORATORY ANALYSIS RECORD

DATE	08-Jun-99
TIME	14:00 - 15:10
STACK	B PAP
RUN	#6

MOISTURE CONTENTS

IMPINGER	#1	#2	#3	#4
WEIGHT AFTER RUN, GRAMS	713.4	667.8	587.3	870.1
WEIGHT BEFORE RUN, GRAMS	668.9	658.7	586.5	864.2
WEIGHT GAIN/LOSS, GRAMS	44.5	9.1	0.8	5.9
TOTAL WEIGHT GAIN, GRAMS	60.3			

SAMPLE SOLUTIONS ANALYSIS

VOLUME OF SAMPLE, ML	1000
CONCENTRATION, UG/ML	2.70
TOTAL WEIGHT POLLUTANT, MGS	2.70

ANALYST

Wayne D. Camp

padcomp.xls

VISIBLE EMISSION OBSERVATION FORM

COMPANY NAME
CF Industries, Inc. Plant City Complex

STREET ADDRESS
10608 Paul Buchman Highway

10 miles north of Plant City

CITY *Plant City* STATE *FL* ZIP *33564*

PHONE (KEY CONTACT) *(813) 782-1591 (Ext. 290)* SOURCE ID NUMBER *0570005 009*

OBSERVATION DATE		START TIME			
<i>6/3/99</i>		<i>1350</i>			
MIN	SEC	0	15	30	45
1	0	0	0	0	0
2	0	0	0	0	0
3	0	0	0	0	0
4	0	0	0	0	0
5	0	0	0	0	0
6	0	0	0	0	0
7	0	0	0	0	0
8	0	0	0	0	0
9	0	0	0	0	0
10	0	0	0	0	0
11	0	0	0	0	0
12	0	0	0	0	0
13	0	0	0	0	0
14	0	0	0	0	0
15	0	0	0	0	0
16	0	0	0	0	0
17	0	0	0	0	0
18	0	0	0	0	0
19	0	0	0	0	0
20	0	0	0	0	0
21	0	0	0	0	0
22	0	0	0	0	0
23	0	0	0	0	0
24	0	0	0	0	0
25	0	0	0	0	0
26	0	0	0	0	0
27	0	0	0	0	0
28	0	0	0	0	0
29	0	0	0	0	0
30	0	0	0	0	0

PROCESS EQUIPMENT *3 Phosphoric Acid Production Facility* OPERATING MODE *Normal*

CONTROL EQUIPMENT *North American steel packed bed scrubber with Kimre backing or equivalent* OPERATING MODE *Normal*

DESCRIBE EMISSION POINT
Circular stack opening 4 feet in diameter

HEIGHT ABOVE GROUND LEVEL *~108.5'* HEIGHT RELATIVE TO OBSERVER
Start *~108.5'* End *~108.5'*

DISTANCE FROM OBSERVER Start *~275'* End *~275'* DIRECTION FROM OBSERVER Start *NE* End *NE*

DESCRIBE EMISSIONS
Start *None* End *None*

EMISSION COLOR Start *NA* End *NA* IF WATER DROPLET PLUME Attached Detached


POINT IN THE PLUME AT WHICH OPACITY WAS DETERMINED
Start *~4' from stack* End *~4' from stack*

DESCRIBE PLUME BACKGROUND
Start *Scattered sky* End *Scattered sky*

BACKGROUND COLOR Start *Blue, gray, white* End *white* SKY CONDITIONS Start *Scattered* End *Scattered*

WIND SPEED Start *2-3 mph* End *4-5 mph* WIND DIRECTION Start *E* End *SE*

AMBIENT TEMP Start *83°F* End *85°F* WET BULB TEMP RH. percent *65%*

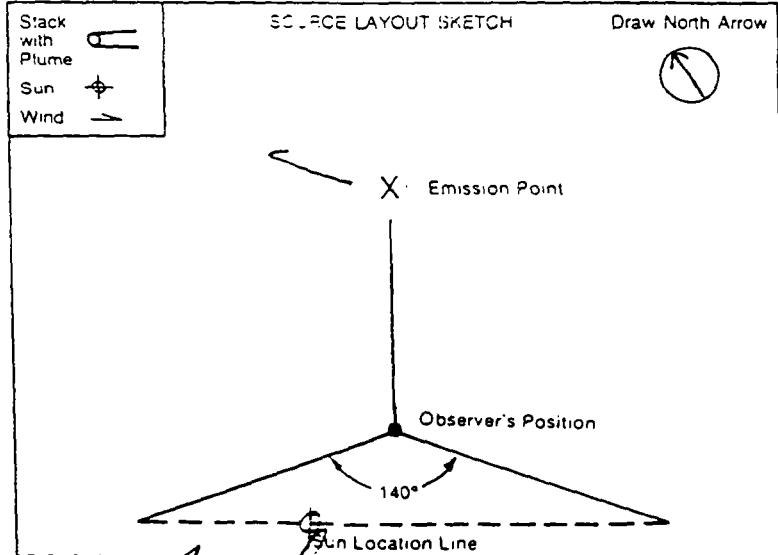

OBSERVER'S NAME (PRINT) *Lloyd G. Camp*

OBSERVER'S SIGNATURE *Lloyd G. Camp* DATE *6/3/99*

ORGANIZATION *CF Industries, Inc. Plant City Complex*

CERTIFIED BY *Eastern Technical Associates* DATE *2/24/99*

ADDITIONAL INFORMATION
Harold J. [Signature]
Chief Chemist

VISIBLE EMISSION OBSERVATION FORM

No. 2

COMPANY NAME
CF Industries, Inc. Plant City Complex

STREET ADDRESS
10308 Paul Buchman Highway

10 miles north of Plant City

CITY *Plant City* STATE *FL* ZIP *33564*

PHONE (KEY CONTACT) *(813) 782-1591 (Ext. 290)* SOURCE ID NUMBER *0570005 009*

PROCESS EQUIPMENT *B Phosphoric Acid Production Facility* OPERATING MODE *Normal*

CONTROL EQUIPMENT *North American steel packed bed scrubber with Kinross packing or equivalent* OPERATING MODE *Normal*

DESCRIBE EMISSION POINT
Circular stack opening 4 Feet in diameter

HEIGHT ABOVE GROUND LEVEL *~ 108.5'* HEIGHT RELATIVE TO OBSERVER
Start *~ 108.5'* End *~ 108.5'*

DISTANCE FROM OBSERVER *Start ~ 275' End ~ 275'* DIRECTION FROM OBSERVER
Start *NE* End *NE*

DESCRIBE EMISSIONS
Start *None* End *None*

EMISSION COLOR *Start NA End NA* IF WATER DROPLET PLUME
Attached Detached


POINT IN THE PLUME AT WHICH OPACITY WAS DETERMINED
Start *~ 4' from stack* End *~ 4' from stack*

DESCRIBE PLUME BACKGROUND
Start *Scattered sky* End *Scattered sky*

BACKGROUND COLOR *Start Blue, gray, white End white* SKY CONDITIONS
Start *Scattered* End *Scattered*

WIND SPEED *Start ~ 5 mph End 6-11 mph* WIND DIRECTION
Start *SE* End *E*

AMBIENT TEMP *Start 89°F End 90°F* WET BULB TEMP *64* RH, percent

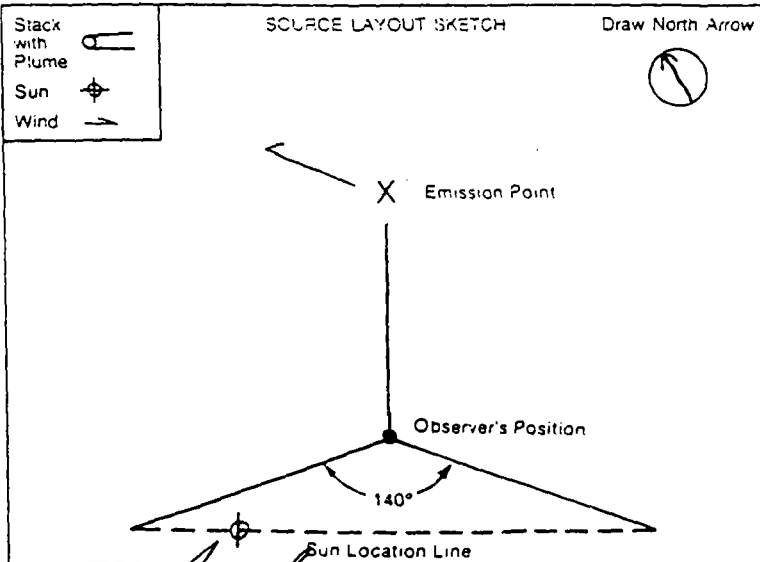

ADDITIONAL INFORMATION
Harriet Hill
Cheryl Stewart

OBSERVATION DATE		START TIME				END TIME
6/3/99		1420				1450
SEC	0	15	30	45		
MIN						
1	0	0	0	0		
2	0	0	0	0		
3	0	0	0	0		
4	0	0	0	0		
5	0	0	0	0		
6	0	0	0	0		
7	0	0	0	0		
8	0	0	0	0		
9	0	0	0	0		
10	0	0	0	0		
11	0	0	0	0		
12	0	0	0	0		
13	0	0	0	0		
14	0	0	0	0		
15	0	0	0	0		
16	0	0	0	0		
17	0	0	0	0		
18	0	0	0	0		
19	0	0	0	0		
20	0	0	0	0		
21	0	0	0	0		
22	0	0	0	0		
23	0	0	0	0		
24	0	0	0	0		
25	0	0	0	0		
26	0	0	0	0		
27	0	0	0	0		
28	0	0	0	0		
29	0	0	0	0		
30	0	0	0	0		

OBSERVER'S NAME (PRINT)
Lloyd G. Camp

OBSERVER'S SIGNATURE
Lloyd G. Camp DATE *6/3/99*

ORGANIZATION
CF Industries, Inc. Plant City Complex

CERTIFIED BY
Eastern Technical Associates DATE *2/24/99*

CONTINUED ON VEO FORM NUMBER

SAMPLE CHAIN OF CUSTODY

Plant Name CF INDUSTRIES, INC. PLANT CITY PHOSPHATE COMPLEX

Source Identification "B" PHOSPHORIC ACID PRODUCTION FACILITY

Date Sampled: JUNE 7, 1999 Sampling Time: 11:05 AM to 6:00 PM

Test for MOISTURE AND FLUORIDE

SAMPLE RECOVERY

<u>Sample Run</u>	<u>Description</u>
<u>1</u>	<u>#1 COLD BOX ASSEMBLY</u>
<u>2</u>	<u>#2 COLD BOX ASSEMBLY</u>
<u>3</u>	<u>#3 COLD BOX ASSEMBLY</u>

Person engaged in sample recoveries:

Signature 

Title ANALYST II



Location at which recovery "B" PHOSPHORIC ACID STACK

Laboratory person receiving samples:

Signature 

Title "A" CLASS TECHNICIAN

ANALYSIS

<u>Constituent</u>	<u>Method</u>	<u>Date</u>	<u>Time</u>	<u>Signature(s)</u>
<u>MOISTURE</u>	<u>EPA METHOD 4</u>	<u>6/7/99</u>	<u>12:47 - 18:30</u>	<u></u>
<u>FLUORIDE</u>	<u>EPA METHOD 13 B</u>	<u>6/7/99</u>	<u>13:10 - 19:15</u>	<u></u>

SAMPLE CHAIN OF CUSTODY

Plant Name CF INDUSTRIES, INC. PLANT CITY PHOSPHATE COMPLEX

Source Identification "B" PHOSPHORIC ACID PRODUCTION FACILITY

Date Sampled: JUNE 8, 1999 Sampling Time: 10:40 AM to 3:10 PM

Test for MOISTURE AND FLUORIDE

SAMPLE RECOVERY

Sample Run	Description
1	#1 COLD BOX ASSEMBLY
2	#2 COLD BOX ASSEMBLY
3	#3 COLD BOX ASSEMBLY


Person engaged in sample recoveries:

Signature 

Title ANALYST II



Location at which recovery "B" PHOSPHORIC ACID STACK

Laboratory person receiving samples:

Signature 

Title "A" CLASS TECHNICIAN

ANALYSIS

Constituent	Method	Date	Time	Signature(s)
MOISTURE	EPA METHOD 4	6/8/99	12:21 - 15:40	
FLUORIDE	EPA METHOD 13 B	6/8/99	12:40 - 16:06	


ANDERSEN

INSTRUMENTS INCORPORATED

DATE 7-14-98

TO WHOM IT MAY CONCERN:

THIS CERTIFIES THAT S-TYPE PITOT TUBES CONSTRUCTED AND CALIBRATED BY ANDERSEN INSTRUMENTS INC. COMPLY WITH PROCEDURES PROVIDED IN THE U.S. ENVIRONMENTAL PROTECTION AGENCY REFERENCE METHOD 2-DETERMINATION OF STACK GAS VELOCITY AND VOLUMETRIC FLOW RATE, VOL. 42, NO. 160 THURSDAY, AUGUST 18, 1977. ANDERSEN INSTRUMENTS INC. CERTIFIES THAT AT TIME OF SHIPMENT BASELINE COEFFICIENT VALUES OF 0.84 MAY BE ASSIGNED TO THE PITOT TUBES.


NATHAN D. CANUP
SERVICE MANAGER

ANDERSEN INSTRUMENTS INC.
A Subsidiary of Thermo Instruments Systems Inc.
500 TECHNOLOGY COURT, SMYRNA, GA 30082-5211, USA
TEL: 770 319 9999 - 800 241 6898 FAX: 770 319 0336

CF INDUSTRIES

TYPE S PITOT TUBE INSPECTION DATA FORM


PROBE SS 45-1

MANUFACTURER PANDERSON INSTRUMENTS


PROBE LENGTH 4.5'

DETACHABLE END PIECE SS N-01

cut back
4/23/99

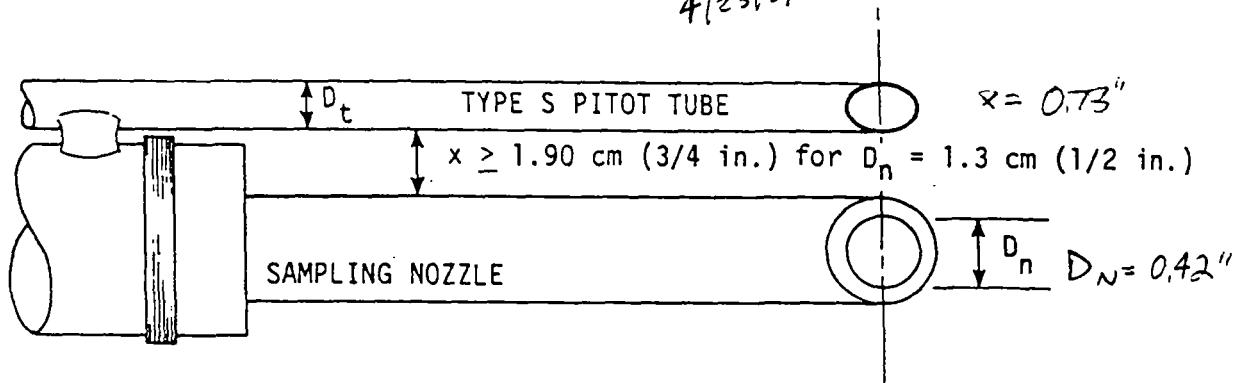

(a) BOTTOM VIEW: SHOWING MINIMUM PITOT-NOZZLE SEPARATION.

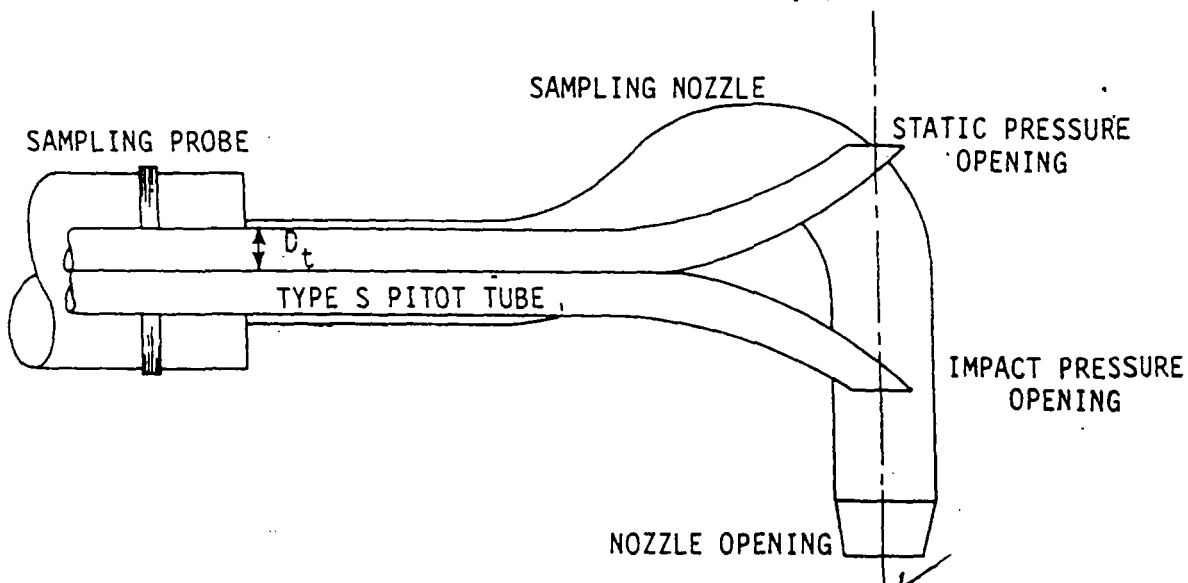

(b) SIDE VIEW: TO PREVENT PITOT TUBE FROM INTERFERING WITH GAS FLOW STREAMLINES APPROACHING THE NOZZLE, THE IMPACT PRESSURE OPENING PLANE OF THE PITOT TUBE SHALL BE EVEN WITH OR DOWNSTREAM FROM THE NOZZLE ENTRY PLANE

Figure 2.1 Required pitot tube-sampling nozzle configuration to prevent aerodynamic interference; buttonhook-type nozzle; centers of nozzle and pitot opening aligned; in respect to flow direction, D_t between 0.48 and 0.95 cm (3/16 and 3/8 in.).

CF INDUSTRIES

TYPE S PITOT TUBE INSPECTION DATA FORM


PROBE SS 45-1

MANUFACTURER ANDERSON INSTRUMENTS

PROBE LENGTH 4.5'

DETACHABLE END PIECE SS N-01

TRANSVERSE
TUBE AXIS

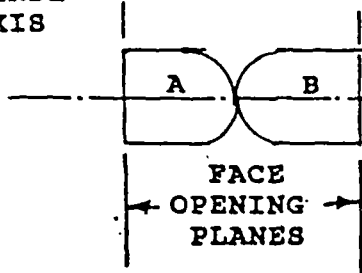


(a)



(c)

LONGITUDINAL
TUBE AXIS

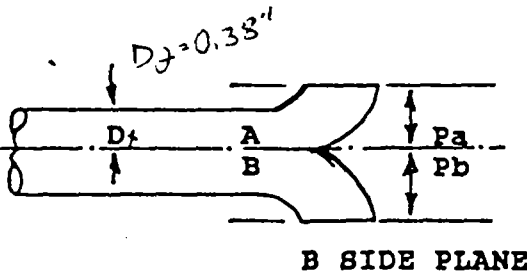

B SIDE PLANE

(b)

$P_a = .63''$

Note:


$$1.05 D \leq P \leq 1.5 D$$

$$P_a = P_b$$

$P_o = .62''$


Figure 2.2 Properly constructed Type S pitot tube shown in: (a) end view: face opening planes perpendicular to transverse axis: (b) top view: face opening planes parallel to to longitudinal axis: (c) side view: both legs of equal length and centerlines coincident, when viewed from both sides. Baseline coefficient values of 0.84 may be assigned to pitot tubes constructed this way.

TRANSVERSE
TUBE AXIS




(b)


LONGITUDINAL
TUBE AXIS

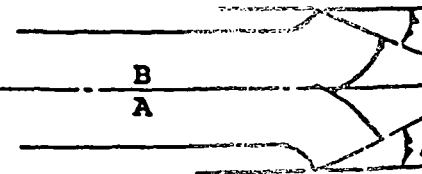

(a)

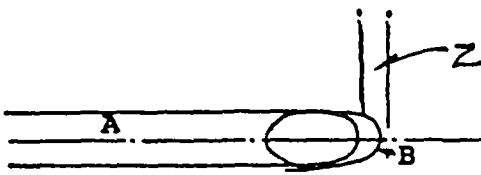

(c)

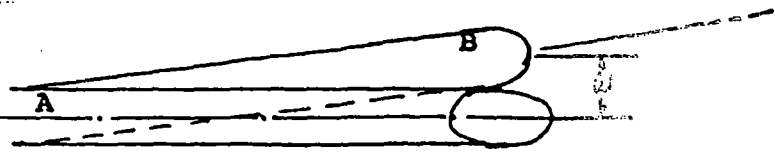

(d)

α_1 1° Less than 10°
 α_2 1°
 Z < 1/32 Less than 0.32 cm
 (1/8 ")

β_1 1° Less than 5°
 β_2 1°
 w < 1/32 Less than 0.08 cm
 (1/32 ")

CF INDUSTRIES

TYPE S PITOT TUBE INSPECTION DATA FORM


PROBE SS 45-1

MANUFACTURER ANDERSON INSTRUMENTS

PROBE LENGTH 4.5'

DETACHABLE END PIECE SS N-01

4/23/98 *[Signature]*

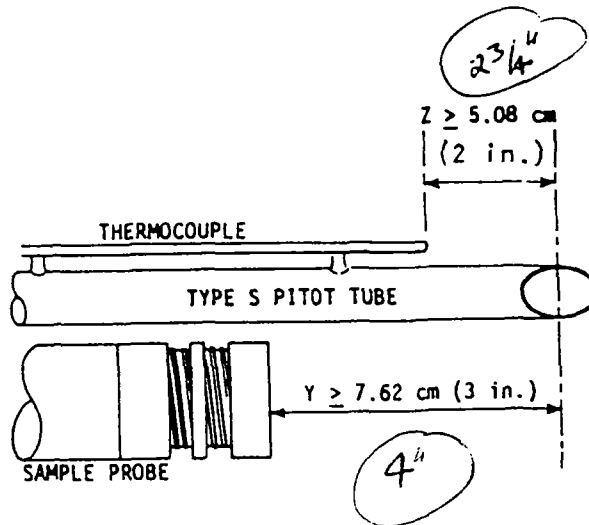


Required thermocouple and probe placement to prevent interference: D_t between 0.48 and 0.95 cm (3/16 and 3/8 in.).

CF INDUSTRIES, INC.
Plant City Phosphate Complex
LABORATORY ANALYSIS RECORD

"B" PAP Production Plant
June 7, 1999

CF Industries, Inc., Plant City Phosphate Complex, uses a Fischer Accumet Model 50 pH meter with selective ion concentration capacity. The instrument has microprocessor function which calculates efficiency of the Orion Model 96-09 fluoride electrode being used and alerts the user in case of electrode malfunction.

<u>STANDARDS</u>	<u>ELECTRODE EFFICIENCY</u>
	(See Technical Information Section)
0.1 $\mu\text{g/ml}$	0.8981
1.0 $\mu\text{g/ml}$	0.9864
2.0 $\mu\text{g/ml}$	
Quality Assurance Sample #1 - 0.38 $\mu\text{g/ml}$. Analysis was 0.37 $\mu\text{g/ml}$.	
Quality Assurance Sample #2 - 0.76 $\mu\text{g/ml}$. Analysis was 0.76 $\mu\text{g/ml}$.	
Quality Assurance Sample #3 - 1.90 $\mu\text{g/ml}$. Analysis was 1.90 $\mu\text{g/ml}$.	

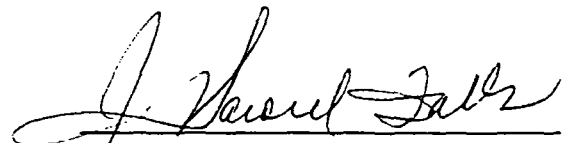
J. Harold Falls
Chief Chemist, Laboratory

JHF/gm
9/89

CF INDUSTRIES, INC.
Plant City Phosphate Complex
LABORATORY ANALYSIS RECORD

"B" PAP Production Plant
June 8, 1999

CF Industries, Inc., Plant City Phosphate Complex, uses a Fischer Accumet Model 50 pH meter with selective ion concentration capacity. The instrument has microprocessor function which calculates efficiency of the Orion Model 96-09 fluoride electrode being used and alerts the user in case of electrode malfunction.

STANDARDS

ELECTRODE
EFFICIENCY


(See Technical Information Section)

0.1 $\mu\text{g/ml}$	0.8998
1.0 $\mu\text{g/ml}$	0.9780
2.0 $\mu\text{g/ml}$	

Quality Assurance Sample #1 - 0.38 $\mu\text{g/ml}$.
Analysis was 0.37 $\mu\text{g/ml}$.

Quality Assurance Sample #2 - 0.76 $\mu\text{g/ml}$.
Analysis was 0.75 $\mu\text{g/ml}$.

Quality Assurance Sample #3 - 1.90 $\mu\text{g/ml}$.
Analysis was 1.90 $\mu\text{g/ml}$.


J. Harold Falls
Chief Chemist, Laboratory

JHF/gm
9/89

Overview

The Model 50 is a state-of-the-art, microprocessor based meter designed for uniquely simple operation with an extensive range of capabilities. The sealed keypad incorporates both numeric and function keys, as well as a convenient Help function. The large liquid crystal display offers a continuous display of a variety of information, including measurement results, time/date, standardization data and status icons. The large display also permits user information to be conveyed in simple, complete sentences, not the cryptic prompts more typical for laboratory meters.

The Model 50 includes dual input channels. A novel split-screen function allows the display to simultaneously track both inputs when desired. In addition to pH and millivolt measurement, this model also performs analyses with ion selective electrodes by direct potentiometry. Additionally, the Model 50 offers four incremental methods: known addition and subtraction and analate addition and subtraction.

In pH operation, the meter may be set up to automatically recognize both Fisher color-coded buffers and NIST buffers, for maximum user convenience. Auto-recognized buffers are both identified and corrected by the meter for the temperature dependence of the buffer.

The Model 50 performs conductivity measurements in Siemens (umhos) or salinity units. Probes with a variety of cell constants may be accommodated through software setup. Alternatively, the Model 50 may be set up to measure resistivity (ohms).

It is recommended that the user first complete the Installation instructions, then become familiar with Controls and Connectors, and finally review the Operation sections for procedures of interest.

Performance Characteristics

Model 50

Ranges	-2 to 20 pH/pX -1800 to 1800 mV -5 to 105 °C 10 ⁻⁹ to 10 ⁹ Conc 0 to 40 ppt practical salinity 0 to 70 ppt NaCl equivalents 3 x 10 ⁴ μ-Siemens/cm 33 to ∞ Ω-cm
Resolution	0.1/0.01/0.001 pH 0.1 mV 0.1 °C 1, 2 or 3 significant figures ion 1, 2 or 3 significant figures conductivity
Relative Accuracy	+/-0.002 pH +/-0.1 mV @ 25 °C +/-0.2 °C

Ion Operation

The Model 50 allows ion concentrations to be determined conveniently in any desired units of concentration, such as molarity, ppm or mg/L, and using any one of several techniques. Prior to analyzing samples by any of the ion methods, the operator should consult the following sections on *Method Selection*, *Low-Level Correction*, *Ionic Strength Adjustors* and *Temperature Compensation*.

Method Selection

The Model 50 features a variety of methods for measuring ion concentrations in samples using ion selective electrodes (ISE's). Direct reading potentiometric methods offer speed and convenience, are applicable to wide ranges of sample concentrations and require no volumetric measurements. Conversely, sample-to-sample variations in ionic strength frequently require the use of an ionic strength adjusting buffer (ISA) with direct reading potentiometry.

Incremental methods offer a tolerance for samples of varying ionic strength and the ability to analyze samples containing complexing agents. One incremental method, analate subtraction, can even permit analyzing concentrations of ions to which no ion selective electrode directly responds. Conversely, volumetric measurements of both the sample and a standard increment are required by these methods. Additionally, the incremental methods are generally unworkable if sample concentrations are expected to vary over more than one or, at most two, orders of magnitude.

As a general rule, it is usually simplest to select direct reading unless prior knowledge about the sample indicates that incremental methods are to be preferred.

Low-Level Correction

With samples containing very low levels of the ion of interest (often referred to as the "mud zone"), electrode response fails to conform to the Nernstian model. In the mud zone, changes in electrode output (slope) successively decrease as the sample concentration is further reduced. A plot of electrode output in millivolts versus logarithm of the sample concentration then becomes increasingly non-linear at very low concentrations.

The Model 50 offers two approaches to correcting for non-Nernstian response with low-level samples. In the first, the actual non-linear response curve of the electrode is approximated by a series of linear segments. Up to five different standards may be used, spanning the entire range of concentrations anticipated for samples. The meter then stores in memory a series of slope values corresponding to each successive pair of standards. These slopes, and the corresponding standard values, may be viewed individually by means of the slope key.

In linear segment measurements, the meter first identifies the general concentration range of the current sample, then computes its exact concentration by applying the nearest or bracketing standards. Use of the *Linear Segments* option can increase accuracy with dilute samples near the limits of the electrode's operating range.

The *Blank* feature provides an alternative means for measuring low-level samples. With this approach, the non-linear response curve of the electrode is fit by a mathematical model which assumes that all samples and standards have a constant background level of the species of interest. This situation may occur, for example, if the electrode can "self-sense" due to the finite solubility of the solid state sensing element. Standardization is performed with two standards from the electrode's linear region, as well as a blank sample. Measuring with the *Blank* option substantially enhances accuracy with dilute samples when the assumption of a constant background is true and a stable blank can be prepared.

Ionic Strength Adjustors

Used directly, all selective ion electrodes respond to the *activity* of the ion of interest. The activity of an ion may be thought of as its effective concentration—a hybrid quantity derived from both the actual concentration of the ion as well as its mobility in the given solution.

In relatively dilute samples (typically less than 0.01 M), ions in the sample are relatively far removed from the influence of neighboring ions and act independently. In this event, ion activity and ion concentration are essentially identical. With more concentrated solutions, however, the presence of near neighbors acts to limit the mobility and effect of individual ions.

With increasing total ionic concentrations (ionic strength), ion activity becomes progressively diminished from actual ion concentration. This trend generally continues throughout the usable range of the electrode, although at extremely high concentrations, other effects may actually reverse it. In any event, in solutions of total ionic strength greater than perhaps 0.01 M, selective ion electrodes respond to an ion activity which may differ substantially from the ion concentration.

Slope

The slope S of an electrode is defined as the change in its output voltage resulting from a decade change in the activity of the ion to which it responds. From the Nernst equation, the slope at any temperature T is given by

$$S_T = \xi (2.303 RT/F)$$

The quantity in the parentheses represents the slope for an ideal, monovalent, cation-sensing ISE (e.g., a pH or Na^+ ion electrode), and has a value of 59.16 mV at 25 °C.

Because of their temperature dependence, the raw slope values do not provide a convenient measure of an electrode's performance. Consequently, slope values are usually mathematically corrected ("referenced") to a temperature of 25 °C:

$$S_{25} = S_T (298.16/T)$$

The value of its temperature referenced slope reflects the condition of an ISE since it may be compared simply and directly with the theoretical value of 59.16 at 25 °C. The Model 50 reports slope values temperature referenced to 25 °C.

Efficiency Factor

Efficiency factor ξ is the actual slope value for an electrode, divided by its theoretical value. The efficiency factor for an electrode is thus easily interpretable in terms of its performance. For example, a pH electrode functioning ideally would exhibit an efficiency factor of exactly 1. Properly functioning, real pH electrodes typically will produce efficiency factors in the range of 0.90 to 1.05.

Efficiency factors for cation-sensing electrodes are positive, while those for anion-sensing electrodes are negative. Mathematically, the efficiency factor for an ideal electrode is always the reciprocal of the number of electrons exchanged in its electrode reaction, with the appropriate algebraic sign. Several examples appear in the table below:

ISE Type	Ideal Efficiency Factor
H_3O^+ (pH)	+ 1
F^-	- 1
Cl^-	- 1
Ca^{+2}	+ 0.5
S^{-2}	- 0.5

The efficiency factor for a real electrode, like its slope, may be determined experimentally from two-point (or more) standardization data.

Efficiency

A related quantity, frequently used instead of efficiency factor, is electrode efficiency. The efficiency of an electrode is simply its efficiency factor expressed as a percent by multiplying by 100 and ignoring algebraic sign.

On this scale, properly functioning pH electrodes typically exhibit efficiencies between 90 and 105%. The Model 50 automatically compute and display electrode efficiencies, as well slopes temperature referenced to 25 °C, when the slope/eff key is pressed.

pH Measurements

The pH of a solution is defined as

$$\text{pH} = -\log a_{\text{H}}$$

where a_{H} is the activity of the hydrogen ion in the solution. For hydrogen ions, the distinction between activity and concentration can usually be ignored.

Substituting the definitions of pH and slope into the Nernst equation, yields a working equation for computing sample pH:

$$E = E_0 + S_T \text{ pH}$$

In practice, E_0 and S_T may be determined through standardization with buffers of known pH. The pH value of a sample then may be calculated from this equation and the measured output E of the electrode when placed in the sample.

Ion Measurements

Ion measurements are complicated somewhat by the dependence of activity on the total ionic strength of the solution. For relatively dilute solutions, ion concentration and activity are essentially equivalent. However, to measure samples more concentrated than roughly 0.01 M, a special procedure is required to measure sample concentration directly.

Section 1

INTRODUCTION

1.1 Principle of Operation

The AST® Sampler is designed to sample gas stream effluents isokinetically in accordance with the U.S. Environmental Protection Agency (EPA) standards as outlined in the Code of Federal Regulations, Title 40, Part 60 (40CFR60), Appendix A. Stack gases are extracted through a nozzle and a heated probe into a heated filter chamber where the particulate is removed. The hot gases are then passed through a series of impingers where condensibles are removed and the gases are cooled before going to the pump, dry gas meter, and orifice.

The AST® Sampler is manufactured with all the mechanical hardware specified in 40CFR60 for EPA Methods 1, 2, 4 and 5. The AST® Sampler can be used with Andersen hardware to sample additional EPA Methods including methods 6, 8, 12, 13A, 13B, 17, 23, 26A, 29, 101, 101A, 103, 104, 108, 202, 315. Consult the Graseby Technical Sales Department or your local sales representative for application notes.

P.O. Drawer L.
Plant City, Florida 33564-9947
Telephone: 813/782-1500




CF Industries, Inc.
Plant City Phosphate Complex

PROBE NOZZLE CALIBRATION DATA

Nozzle Identification Number: 250-1

Calibrated by: ERNEST LEWIS/SMAN

Date: 5/23/97

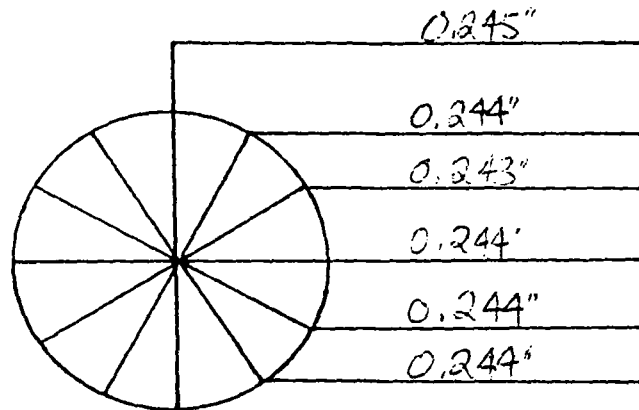

Instructions:

Measure to nearest 0.001"

Tolerance:

0.001" for mean of at least three readings.
Maximum deviation between readings ≤ 0.004 ".

Nozzle diameter, D_n : 0.244 In.

Nozzle area A_n : 0.000325 ft²

$$A_n = \frac{\pi}{144} \left(\frac{D_n}{2} \right)^2$$

Exhibit N

ANNUAL GRASEBY STACKBOX THERMOCOUPLE CALIBRATIONS

-UNIT #1200


DATE 7/13/98

FOR TEMPERATURES 0 TO 110 DEGREES C
NIST Traceable Thermometer # J96-258

FOR TEMPERATURES 110 TO 200 DEGREES C
NIST Traceable Thermometer # 90B-2024

Time: 1100-1530

Initial



Thermocouple		Ice Water Point			Ambient Point			Hot Water Point			Hot Oil Point		
		Thermocouple Reading (Degrees F)	NIST Reading		Thermocouple Reading (Degrees F)	NIST Reading		Thermocouple Reading (Degrees F)	NIST Reading		Thermocouple Reading (Degrees F)	NIST Reading	
			Actual	Con- version to		Actual	Con- version to		Actual	Con- version to		Actual	Con- version to
			Degrees			Degrees			Degrees			Degrees	
C	F	C	F	C	F	C	F	C	F				
[1] Stack	Probe 4.5 ft. #45-1	32.6	0.6	33.1	78.1	26.6	79.8	184.4	86.3	187.4	N/A	N/A	N/A
	Probe 6.0ft. #60-1	32.1	0.6	33.1	81.3	29.2	84.6	184.6	86.3	187.4	N/A	N/A	N/A
	Probe 10.5ft. #105-1	32.6	0.8	33.4	71.8	22.4	72.3	188.2	87.2	189.0	N/A	N/A	N/A
	Probe 11.0ft. #110-1	32.1	0.6	33.1	80.7	28.4	83.1	183.3	86.0	186.8	N/A	N/A	N/A
[2] Probe (Probe Liner Heater)	Probe 4.5 ft. #45-1	31.8	0.8	33.1	82.6	29.0	84.2	N/A	N/A	N/A	234.6	113.4	236.1
	Probe 6.0ft. #60-1	32.8	0.8	33.4	82.2	29.2	84.6	N/A	N/A	N/A	234.8	113.2	235.8
	Probe 10.5ft. #105-1	32.4	1.0	33.8	71.4	22.2	72.0	N/A	N/A	N/A	238.6	115.6	240.1
	Probe 11.0ft. #110-1	32.6	0.8	33.4	81.9	28.4	83.1	N/A	N/A	N/A	235.1	114.6	238.3
[3] Hot Box	Box	32.4	1.0	33.8	82.2	28.6	83.5	N/A	N/A	N/A	237.1	115.2	239.4
	Filter Exit	32.2	1.0	33.8	82.3	28.6	83.5	N/A	N/A	N/A	238.2	115.0	239.0
[4] Umbilical	Coldbox Exit	33.6	1.0	33.8	82.8	28.4	83.1	185.1	85.6	186.1	N/A	N/A	N/A
[5] DGM Inlet	Control Box	33.2	1.0	33.8	81.9	28.6	83.5	185.1	85.4	185.7	N/A	N/A	N/A
[6] DGM Exit	Control Box	33.2	1.0	33.8	82.5	28.6	83.5	185.1	85.4	185.7	N/A	N/A	N/A
[7] Spare	Ambient	32.8	0.2	33.8	82.1	28.6	83.5	185.1	85.2	185.4	N/A	N/A	N/A

NOTE:

10.5FT PROBE SENSOR REPAIRED & CALIBRATED 4/1/00 *110*

4R

DRY GAS METER CALIBRATION

Anderson AST Meter Box

Meter Box Number: 1200 Barometric Pressure: 30.03
 Date: 12/16/98 Dry Gas Test Meter#: Rockwell 631105
 Initial *[Signature]* Dry Gas AST Box Meter#: Schlumberger 1102

Flowrate Setting (CFM)	Gas Volume		Temperature		AST Box Meter Delta H (" H2O)	Time (Theta) min.	Actual Flowrate (CFM)	Yi (Software) (Setpoint)	Delta H@ in. H2O	
	DGM Test Meter (Vw) ft.^3	AST Box Meter (Vd) ft.^3	DGM Test Meter (Tw) Deg F	AST Box Meter (Td) Deg F						
0.40	11.660	11.697	69.6	71.8	0.736	28.85	0.404	1.0000	2.512	
0.50	7.500	7.556	69.6	74.2	1.152	14.83	0.506	1.0000	2.498	
0.60	10.358	10.470	70.2	76.7	1.625	17.20	0.602	1.0000	2.477	
0.70	31.644	32.310	70.2	82.3	2.232	45.40	0.697	1.0000	2.512	
0.80	19.097	19.557	70.2	84.6	2.658	24.25	0.788	1.0000	2.333	
0.90	14.301	14.684	70.7	86.1	3.237	16.18	0.884	1.0000	2.255	
1.00	16.701	17.123	73.0	87.8	3.937	17.15	0.974	1.0000	2.271	
1.10	7.302	7.491	73.0	88.3	4.722	6.87	1.063	1.0000	2.282	
1.20	32.996	34.085	73.0	92.2	5.472	28.7	1.150	1.0000	2.247	
								Average	1.0000	2.376
								Max. Diff.	0	0.136

$$Y_i = \frac{V_w P_b (t_d + 460)}{V_d (P_b + \Delta H / 13.6) (T_w + 460)}$$

$$\Delta H @ = \frac{.0317 (\Delta H)}{P_b (t_d + 460)} [(t_w + 460) (\theta) / V_w]^2$$

- Where:
- Vw = Gas Volume passing through the std test meter, ft.^3.
 - Vd = Gas Volume passing through the dry gas meter, ft.^3.
 - Tw = Temperature of the gas in the std test meter, deg. F.
 - Td = Average temperature of the gas in the dry gas meter, deg.F.
 - Delta H = Pressure differential across orifice. in, H2O.
 - Yi = Ratio of accuracy of std test meter to dry gas meter for each run.
 - Y = Average ratio of accuracy of std test meter to dry gas meter.
 - Pb = Barometric pressure, in. Hg.
 - Theta = Time of calibration run, min.

SOUTHERN ENVIRONMENTAL SCIENCES, INC.

WET TEST METER CALIBRATION CHECK

Wet Test Meter No. P-576					
Date: 3/29/98					
Checked by: B. Nelson					
TEST NO.	Gas Volume		Temperature		Corr Factor
	Liquid Displacement (Ft ³)	Wet Test Meter (Ft ³)	Liquid Displacement (°F)	Wet Test Meter (°F)	
1	1.115	1.10	78	78	1.020
2	1.090	1.10	78	78	.991
3	1.088	1.10	78	78	.989
Avg.					1.000

Standard Dry Gas Meter Calibration

GAS METER MANUF.	ROCKWELL	PERFORMED FOR	C.F. INDUSTRIES
MODEL #	175-S	DATE	2/12/99
SERIAL #	JA 631105	BAROMETRIC PRES.	30.22
WET TEST METER #	P - 576	LEAK CHECK	0.00 CFM at 15 in. Hg

Approximate Flowrate (CFM)	Gas Volume		Temperature		Dry Gas Meter Delta P (in. H2O)	Time (Theta) (min)	Flowrate (CFM)	DRY GAS METER COEFF. (Yds)	AVG. GAS METER COEFF.
	Wet Test Meter (Vw) (ft. ³)	Dry Gas Meter (Vd) (ft. ³)	Wet Test Meter (Tw) (Deg F)	Dry Gas Meter (Td) (Deg F)					
0.40	5.000	4.931	71.0	72.0	0.06	14.05	0.357	1.016	1.016
0.40	5.000	4.921	71.0	72.0	0.06	14.02	0.358	1.014	
0.40	5.000	4.905	71.0	72.0	0.06	14.04	0.358	1.017	
0.60	5.000	4.944	71.0	72.0	0.1	8.25	0.608	1.009	1.009
0.60	5.000	4.949	71.0	73.0	0.1	8.21	0.611	1.006	
0.60	5.000	4.931	71.0	73.0	0.1	8.18	0.614	1.010	
0.80	5.000	4.945	72.0	73.5	0.12	5.91	0.848	1.008	1.008
0.80	5.000	4.936	72.0	73.5	0.12	5.96	0.841	1.010	
0.80	5.000	4.942	72.0	73.5	0.12	5.97	0.839	1.009	
1.00	5.000	4.962	72.0	73.5	0.17	4.90	1.022	1.004	1.005
1.00	5.000	4.957	72.0	73.5	0.17	4.86	1.031	1.005	
1.00	5.000	4.962	72.0	73.5	0.17	4.86	1.031	1.004	
1.20	5.000	4.955	72.0	73.5	0.20	4.08	1.228	1.006	1.006
1.20	5.000	4.955	72.0	73.5	0.20	4.09	1.225	1.006	
1.20	5.000	4.953	72.0	73.5	0.20	4.09	1.225	1.006	

$$Q = \frac{P_b \times V_w \times 528}{(T_w + 460) \times \Theta \times 29.92}$$

$$Y_{ds} = \frac{V_w}{V_d} \times \frac{(T_d + 460)}{(T_w + 460)} \times \frac{P_b}{[P_b + (\Delta P / 13.6)]}$$

where:

- V_w = Gas Volume passing through the std test meter, ft.³.
- V_d = Gas Volume passing through the dry gas meter, ft.³
- T_w = Temperature of the gas in the std test meter, deg. F.
- T_d = Average temperature of the gas in the dry gas meter, Deg F.
- Delta H = Pressure differential across orifice, in. H₂O.
- Y_{ds} = Dry gas meter coefficient.
- P_b = Barometric pressure, in. Hg.
- Theta = Time of calibration run, min.

STANDARD METER CALIBRATION CURVE

GAS METER MANUF. ROCKWELL	PERFORMED FOR C.F. INDUSTRIES
MODEL # 175-S	DATE 2/12/99
SERIAL # JA 631105	

Regression Output:

Flowrate (CFM)	DRY GAS METER COEFF. (Yds)
0.358	1.016
0.611	1.008
0.843	1.009
1.028	1.005
1.226	1.006

Constant	72.47
Std Err of Y Est	0.18
R Squared	0.78
No. of Observations	5.00
Degrees of Freedom	3.00

X Coefficient(s)	-71.04
Std Err of Coef.	21.53

CALIBRATION CURVE

FLOW (CFM)	CORRECTION FACTOR
0.42	1.014
0.45	1.014
0.50	1.013
0.55	1.012
0.60	1.012
0.65	1.011
0.70	1.010
0.75	1.010
0.80	1.009
0.85	1.008
0.90	1.007
0.95	1.007
1.00	1.006
1.05	1.005
1.10	1.005
1.15	1.004
1.20	1.003

POSTTEST DRY GAS METER CALIBRATION DATA FORM (English units)

Test numbers _____ Date 6/10/99 Meter box number 1200 Plant B PAD
 Barometric pressure, $P_b = 30.00$ in. Hg Dry gas meter number 1102 Pretest Y 1.000

Orifice manometer setting, (ΔH) , in. H ₂ O	Gas volume		Temperature			Time (θ) , min	Vacuum setting, in. Hg	Y_i	$Y_i = \frac{V_w P_b (t_d + 460)}{V_d P_b + \frac{\Delta H}{13.6} (t_w + 460)}$	
	Dry test meter (V_w) , ft ³	Dry gas meter (V_d) , ft ³	Dry test meter (t_w) , °F	Dry gas meter						Average (t_d) , °F
				Inlet (t_{d_i}) , °F	Outlet (t_{d_o}) , °F					
<u>(.681 CFM)</u> 2.73	6.763	6.8085	73.4°	73.3°	73.3°	73.3°	10.00	2.4	0.9967	$\frac{(6.763)(30.00)(538.8)}{(6.8085)(30.20)(533.4)}$
2.73	6.772	6.8051	71.6°	79.9°	79.9°	79.9°	10.02	2.4	1.0040	$\frac{(6.772)(30.00)(539.9)}{(6.8051)(30.20)(531.6)}$
2.73	6.720	6.8090	71.2°	81.0°	81.0°	81.0°	10.00	2.4	0.9985	$\frac{(6.720)(30.00)(541.0)}{(6.8090)(30.20)(531.2)}$
									$Y = 0.9997$	

^a If there is only one thermometer on the dry gas meter, record the temperature under t_d .

V_w = Gas volume passing through the wet test meter, ft³.

V_d = Gas volume passing through the dry gas meter, ft³.

t_w = Temperature of the gas in the wet test meter, °F.

t_{d_i} = Temperature of the inlet gas of the dry gas meter, °F.

t_{d_o} = Temperature of the outlet gas of the dry gas meter, °F.

t_d = Average temperature of the gas in the dry gas meter, obtained by the average of t_{d_i} and t_{d_o} , °F.

ΔH = Pressure differential across orifice, in H₂O.

Y_i = Ratio of accuracy of wet test meter to dry gas meter for each run.

Y = Average ratio of accuracy of wet test meter to dry gas meter for all three runs; tolerance = pretest Y $\pm 0.05Y$

P_b = Barometric pressure, in. Hg.

θ = Time of calibration run, min.

Dry test meter number Rockwell-JA631105

Quality Assurance Handbook M5-2.4A

6/10/99 3:32 PM
 within $\pm 0.05Y$
 but if not

APPENDIX "C"

PROJECT PARTICIPANTS

PROJECT PARTICIPANTS

CF INDUSTRIES, INC.

PLANT CITY PHOSPHATE COMPLEX

H.E. Morris	General Manager
R.C. May	Manager of Engineering
T.A. Edwards	Supt., Environmental Affairs
J.M. Messina	Chief of Environmental Affairs
J.H. Falls	Chief Chemist, Laboratory
J.I. Longest	Staff Chemist
T. Ortoski	Environmental Supervisor
E. Kretschmar	Analyst II
S. Willoughby	"A" Class Technician
L. Camp	"A" Class Technician
W. Cherry	"A" Class Technician

CF INDUSTRIES, INC.
PLANT CITY PHOSPHATE COMPLEX
COMPLIANCE TEST - B PAP
PERMIT No. 0570005-007-AV
EMISSION UNIT 009
ATTACHMENT 1

813.744.6100
TAC cc: [Handwritten initials and notes]



Department of Environmental Protection

Jeb Bush
Governor

Southwest District
3804 Coconut Palm Drive
Tampa, Florida 33619

May 26, 1999

Mr. Thomas A. Edwards
Superintendent, Environmental Affairs
CF Industries, Inc.
P.O. Drawer L
Plant City, FL 33564-9007

Re: Compliance tests for A & B Phosphoric Acid Units, 0570005-007-AV

Dear Mr. Edwards:

This letter authorizes CF Industries, Inc., to temporarily operate A & B Phosphoric Acid Units at process rates approximately 10% beyond their current, maximum-permitted rates in order to conduct the annual compliance tests. Each unit's test must take no longer than 15 days (your letter indicates that each unit's test will take no longer than one week to complete), and each unit's production rate must be returned to the permitted range that existed before the test. Your estimates of the increases in emissions of fluoride indicate that existing limits will not be exceeded, even at the higher process rates. Test results at the temporary, higher rates will be used to support a subsequent application to modify the permit.

Notify the Hillsborough County Environmental Protection Commission of your schedule. If you have any questions, please contact Mr. Henry Gotsch, in our permitting division, at (813) 744-6100, ext. 113.

Sincerely,

[Handwritten signature], P.E.

FOR W.C. Thomas, P.E.,
District Air Administrator
Southwest District

cc: Mr. Rick Kirby, HCEPC

CF INDUSTRIES, INC.
PLANT CITY PHOSPHATE COMPLEX
COMPLIANCE TEST - B PAP
PERMIT No. 0570005-007-AV
EMISSION UNIT 009
ATTACHMENT 2

PERMIT NO. 0570005-007-Av

EMISSION UNIT 009

CF INDUSTRIES, INC.

PLANT CITY PHOSPHATE COMPLEX

"B" PHOSPHORIC ACID PRODUCTION

PLANT CITY, FLORIDA

June 3 & 4, 1999

TEST CONDUCTED BY:

Laboratory
CF INDUSTRIES, INC.
Plant City Phosphate Complex
Plant City, Florida 33564

TABLE OF CONTENTS

	<u>PAGE</u>
INTRODUCTION	1
PROCESS DESCRIPTION	1
LOCATION OF SAMPLING POINTS	2
DESCRIPTION OF SAMPLE POINTS	3
SAMPLING AND ANALYTICAL PROCEDURES	4
APPENDIX:	<u>PAGES</u>
APPENDIX "A" Emmission Calculation and Results	5 - 20
APPENDIX "C" Project Participants	21 - 22

INTRODUCTION:

The Environmental Control Laboratory of CF Industries, Inc., Plant City Phosphate Complex, conducted an emission test at "B" Phosphoric Acid Production Facility in Plant City, Florida on June 3 and 4, 1999. Two (2) 60-minute test runs were performed. The purpose of the test was to obtain emission data demonstrating compliance with the State of Florida DEP performance standards.


The measurements were made for fluoride and moisture at the stack outlet to the atmosphere. The measurements were within the permitted limits on all tests.

Complete results are give in APPENDIX "A".



PROCESS DESCRIPTION

Phosphoric Acid is made by reacting sulfuric acid with phosphate rock along with a given amount of water to make an acid slurry. The mixing of sulfuric acid, rock and water takes place in a continuous reactor.

The principal reaction takes place as follows:




Other reactions as follows:



The resulting Phosphoric Acid will be 28 to 30% P2O5 content. This 28 to 30% P2O5 Phosphoric Acid solution will be further concentrated by evaporators until the acid strength reaches 52 to 54% P2O5.

LOCATION OF SAMPLING POINTS

The sampling sites and number of traverse points were selected as per Figure 1-2 EPA Method 1 specified in 40 CFR 60, Appendix A.

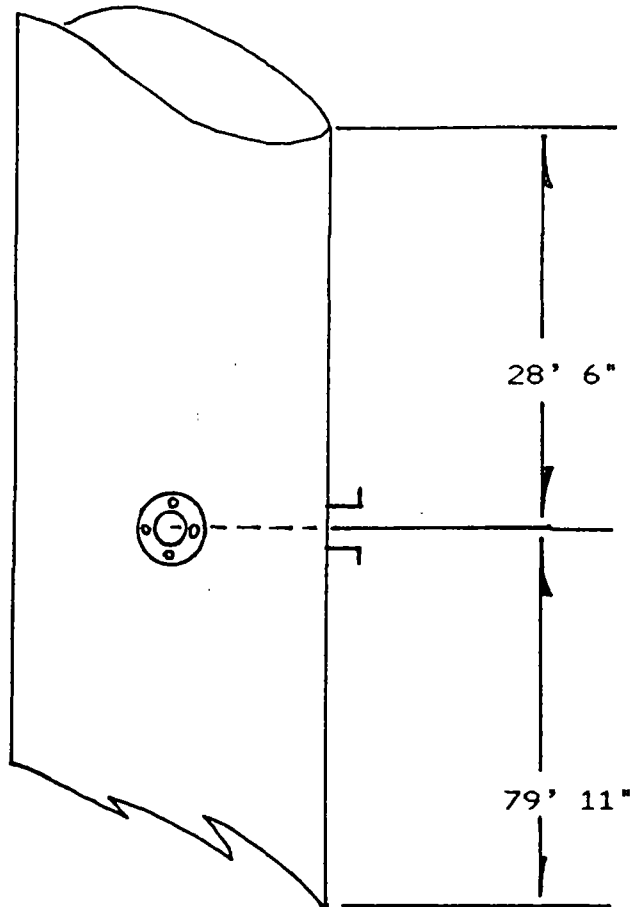

Traverse Point Number	Distance from inside wall
1	2.1"
2	7.0"
3	14.2"
4	33.8"
5	41.0"
6	45.9"

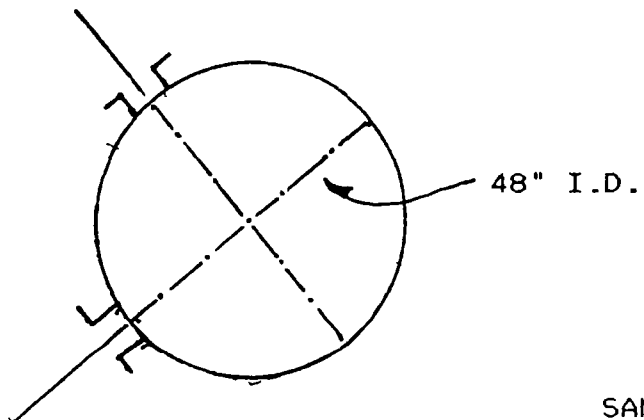


FIGURE 1

SAMPLE POINT DESCRIPTION

"B" PAP PRODUCTION

SAMPLING AND ANALYTICAL PROCEDURES

The methods described in EPA Methods 1, 2, 3, 4, 9 and 13B contained in 40 CFR 60, Appendix A and adopted by reference in Chapter 62-297.401 F.A.C. are used when testing during compliance by CF Industries, Inc.

APPENDIX "A"

EMISSION CALCULATIONS AND RESULTS

B PAP

Permit No. 0570005-007-AV
Emission Unit 009

RUN NUMBER	1	1
DATE	03-Jun-99	04-Jun-99
TIME START	1:45 PM	10:33 AM
TIME END	2:55 PM	11:45 AM
BP, INCHES Hg	30.05	30.03
STACK PRESSURE, INCHES Hg	30.10	30.09
AVG.SQ.ROOT(VEL. HEAD) IN Hg	0.6650	0.6550
ORIFICE PRESS. OF METER, IN WATER	2.5400	2.4400
AVG STACK ,F	126.5	120.5
STACK, DRY BULB	126.5	120.5
METER TEMPERATURE, F	101.5	97.8
VOL. OF GAS, DM CONDITIONS, FT3	40.714	39.777
VOL. GAS, STP, DRY COND. FT3	38.690	38.016
STACK GAS MOISTURE, % VOLUME	10.23	8.81
MW OF STACK GAS, DRY COND.	28.85	28.85
MW OF STACK GAS, STACK COND.	27.74	27.89
PITOT CORRECTION FACTOR	0.84	0.84
STACK GAS VELOCITY, STACK COND. FT3/SEC	40.02	39.11
STACK AREA, FT2	12.566	12.566
EFFECTIVE STACK AREA, FT2	12.566	12.566
STACK GAS FLOW-RATE AT STP, SCFMD	24530	24599
NET TIME OF TEST, MINUTES	60	60
SAMPLE NOZZLE AREA, FT2	0.000325	0.000325
PERCENT ISOKINETIC	101.7	99.6
FLUORIDE, MG.	6.44	4.40
FLUORIDE, LB/HR	0.54	0.38
FLUORIDE, LB/DAY	12.94	9.02
FLUORIDE, LB/HR. LIMIT	1.04	1.04
FLUORIDE, LB/DAY LIMIT	24.9	24.9
PRODUCTION RATE, TPH P2O5 INPUT	96.8	86.3
PRODUCTION RATE, TPH LIMIT	97.0	87.8
PRODUCTION RATE, TPD P2O5 INPUT	2323	2071
PRODUCTION RATE, TPD LIMIT	2328	2107
PHOSPHATE ROCK SLURRY, TPH	478.74	437.02
100 % SULFURIC ACID, TPH	258.02	232.64
WATER, TPH	19.04	16.97
LBS F/TON OF P2O5 (INPUT)	0.006	0.004
LBS F/TON OF P2O5 LIMIT	0.02	0.02
VISIBLE EMISSIONS	0%	
VISIBLE EMISSIONS LIMIT	20%	

EMISSION CALCULATIONS

Date: June 3, 1999

Unit: B PAP

Run no. 1

$$\begin{aligned}
 V_{wstd} &= 0.04707 \text{ Cuft/ml} \times (v_1) \\
 &= 0.04707 \text{ Cuft/ml} \times 93.7 \text{ ml} \\
 &= \mathbf{4.410 \text{ Cuft.}}
 \end{aligned}$$

$$\begin{aligned}
 V_{mstd} &= V_m \left[\frac{T_{std}}{T_m + 460} \right] \left[\frac{P_{bar} + (H / 13.6)}{P_{std}} \right] Y_i \\
 &= 40.714 \text{ Cuft} \times \left[\frac{528}{460 + 101.5} \right] \times \left[\frac{(30.05 + (2.54 / 13.6))}{29.92} \right] \times 1.00 \\
 &= \mathbf{38.690 \text{ Cuft.}}
 \end{aligned}$$

$$\begin{aligned}
 B_{wo} &= \frac{V_{wstd}}{V_{wstd} + V_{mstd}} \\
 &= \frac{4.410}{4.410 + 38.690} \times 100 \\
 &= \mathbf{10.23 \%}
 \end{aligned}$$

$$\begin{aligned}
 M_s &= M_d (1 - B_{wo}) + 18 (B_{wo}) \\
 &= 28.85 \times (1 - 0.1023) + 18 \times 0.1023 \\
 &= \mathbf{27.74}
 \end{aligned}$$

$$\begin{aligned}
 V_s (\text{avg}) &= K_p C_p \sqrt{P(\text{avg})} \sqrt{(460 + T_s) / (M_s P_s)} \\
 &= 85.48 \times .84 \times 0.6650 \sqrt{(460 + 126.5) / (27.74 \times 30.10)} \\
 &= \mathbf{40.02 \text{ ft/sec}}
 \end{aligned}$$

$$\begin{aligned}
 Q_s &= 60 (1 - B_{wo}) V_s A_s (T_{std} / T_s) (P_s / P_{std}) \\
 &= 60 (1 - 0.1023) \times 40.02 \times 12.566 \times (528 / (460 + 126.5)) \times (30.10 / 29.92) \\
 &= \mathbf{24,530 \text{ scfm}}
 \end{aligned}$$

$$\begin{aligned}
Cs &= 0.0154 \text{ grs/mg} \times (\text{total mg of sample}) / Vmstd \\
&= 0.0154 \text{ grs/mg} \times 6.44 \text{ mg} / 38.690 \text{ cuft} \\
&= \mathbf{0.0026 \text{ grs/cuft}}
\end{aligned}$$

$$\begin{aligned}
\text{lbs/hr} &= (Cs \times Qs \times 60 \text{ min/hr}) / 7000 \text{ grs/lb} \\
&= (0.0026 \times 24530 \times 60) / 7000 \\
&= \mathbf{0.54 \text{ lbs/hr Fluoride}}
\end{aligned}$$

$$\begin{aligned}
\text{lbs/day} &= \text{lbs/hr} \times 24 \text{ hrs/day} \\
&= 0.54 \times 24 \\
&= \mathbf{12.94 \text{ lbs/day Fluoride}}
\end{aligned}$$

Percent Isokinetic:

$$\begin{aligned}
I &= \frac{Ts (1.667) ((0.00267) V1) + (Vm / Tm) ((Pbar + (^H / 13.6)))}{0 Vs Ps An} \\
&= \frac{(460 + 126.5) (1.667) ((0.00267 \times 93.7) + (40.714 / (460 + 101.5))) \times ((30.05 + (2.54 / 13.6)))}{60 \times 40.02 \times 30.10 \times 0.000325} \\
&= \mathbf{101.7 \%}
\end{aligned}$$

EMISSION CALCULATIONS

Date: June 4, 1999

Unit: B PAP

Run no. 1

$$\begin{aligned}V_{wstd} &= 0.04707 \text{ Cuft/ml} \times (v_1) \\ &= 0.04707 \text{ Cuft/ml} \times 78.0 \text{ ml} \\ &= \mathbf{3.671 \text{ Cuft.}}\end{aligned}$$

$$\begin{aligned}V_{mstd} &= V_m \frac{[T_{std}]}{[T_m + 460]} \frac{[P_{bar} + (^H / 13.6)]}{[P_{std}]} Y_i \\ &= 39.777 \text{ Cuft} \times \frac{[528]}{[460 + 97.8]} \times \frac{[(30.03 + (2.44 / 13.6))]}{[29.92]} \times 1.00 \\ &= \mathbf{38.016 \text{ Cuft.}}\end{aligned}$$

$$\begin{aligned}B_{wo} &= \frac{V_{wstd}}{V_{wstd} + V_{mstd}} \\ &= \frac{3.671}{3.671 + 38.016} \times 100 \\ &= \mathbf{8.81 \%}\end{aligned}$$

$$\begin{aligned}M_s &= M_d (1 - B_{wo}) + 18 (B_{wo}) \\ &= 28.85 \times (1 - 0.0881) + 18 \times 0.0881 \\ &= \mathbf{27.89}\end{aligned}$$

$$\begin{aligned}V_s (\text{avg}) &= K_p C_p \sqrt{P(\text{avg})} \sqrt{(460 + T_s)} / (M_s P_s) \\ &= 85.48 \times .84 \times 0.6550 \sqrt{(460 + 120.5)} / (27.89 \times 30.09) \\ &= \mathbf{39.11 \text{ ft/sec}}\end{aligned}$$

$$\begin{aligned}Q_s &= 60 (1 - B_{wo}) V_s A_s (T_{std} / T_s) (P_s / P_{std}) \\ &= 60 (1 - 0.0881) \times 39.11 \times 12.566 \times (528 / (460 + 120.5)) \times (30.09 / 29.92) \\ &= \mathbf{24,599 \text{ scfm}}\end{aligned}$$

$$\begin{aligned}
Cs &= 0.0154 \text{ grs/mg} \times (\text{total mg of sample}) / Vmstd \\
&= 0.0154 \text{ grs/mg} \times 4.40 \text{ mg} / 38.016 \text{ cuft} \\
&= \mathbf{0.0018 \text{ grs/cuft}}
\end{aligned}$$

$$\begin{aligned}
\text{lbs/hr} &= (Cs \times Qs \times 60 \text{ min/hr}) / 7000 \text{ grs/lb} \\
&= (0.0018 \times 24599 \times 60) / 7000 \\
&= \mathbf{0.38 \text{ lbs/hr Fluoride}}
\end{aligned}$$

$$\begin{aligned}
\text{lbs/day} &= \text{lbs/hr} \times 24 \text{ hrs/day} \\
&= 0.38 \times 24 \\
&= \mathbf{9.02 \text{ lbs/day Fluoride}}
\end{aligned}$$

Percent Isokinetic:

$$\begin{aligned}
I &= \frac{Ts (1.667) ((0.00267) V1) + (Vm / Tm) ((Pbar + (^H / 13.6)))}{0 Vs Ps An} \\
&= \frac{(460 + 120.5) (1.667) ((0.00267 \times 78.0) + (39.777 / (460 + 97.8)) \times ((30.03 + (2.44 / 13.6)))}{60 \times 39.11 \times 30.09 \times 0.000325} \\
&= \mathbf{99.6 \%}
\end{aligned}$$

Production Rate

DATE: 03-Jun-99

SAMPLING TIME FROM: 1:45 PM TO 2:55 PM

STATEMENT OF PROCESS WEIGHT:

COMPANY NAME: CF INDUSTRIES, INC. PLANT CITY PHOSPHATE COMPLEX
 MAILING ADDRESS: P.O. DRAWER L PLANT CITY, FL 33564
 SOURCE IDENTIFICATION: "B" PAP PRODUCTION FACILITY
 SOURCE LOCATION: "B" PAP PRODUCTION STACK

PERMIT SOURCE: 0570005-007-AV
 Emission Unit 009

DATA ON OPERATING CYCLE TIME:

START OF OPERATION, TIME
 END OF OPERATION, TIME
 ELAPSED TIME
 IDLE TIME DURING CYCLE

	RUN #1			
	1:45 PM			
	2:55 PM			
	70 MIN			
	0			

DESIGN PROCESS RATING:

PROCESS WEIGHT RATE (INPUT) 87.8 TPH P2O5 PRODUCT (OUTPUT) TPH

DATA ON ACTUAL PROCESS RATE DURING OPERATION CYCLE:

MATERIAL: PHOSPHATE ROCK, TPH P2O5
 MATERIAL: 100 % SULFURIC ACID, TPH
 MATERIAL: WATER, TPH

RUN #1		
478.74		
258.02		
19.04		

TOTAL PROCESS WEIGHT RATE:
 PRODUCT: PHOSPHORIC ACID SLURRY, TPH
 INPUT RATE: P2O5, TPH

RUN #1		
755.80		
96.79		

I certify that the above statement is true to the best of my knowledge and belief:

Signature: Frank Severino
 Title: Prodⁿ Eng.

Scrubber's Operating Parameters

DATE: 03-Jun-99

SAMPLING TIME FROM: 1:45 PM TO 2:55 PM

COMPANY NAME: CF INDUSTRIES, INC. PLANT CITY PHOSPHATE COMPLEX
 MAILING ADDRESS: P.O. DRAWER L PLANT CITY, FL 33564
 SOURCE IDENTIFICATION: "B" PAP PRODUCTION FACILITY
 SOURCE LOCATION: "B" PAP PRODUCTION STACK

PERMIT SOURCE: 0570005-007-AV

TYPE OF SCRUBBER LIQUID: Pond Water

PACKED BED SCRUBBER		RUN #1			COMMENTS
	START	1:45 PM			
	END	2:55 PM			
OUTLET	AVERAGE	106°			
TEMPERATURES F	HIGH	106°			
	LOW	106°			

PACKED BED SCRUBBER		RUN #1			COMMENTS
	START	1:45 PM			
	END	2:55 PM			
FAN	AVERAGE	163			
AMPS	HIGH	163			
	LOW	163			

I certify that the above statement is true to the best of my knowledge and belief:

Signature: Frank Swengripes
 Title: Prodⁿ Eng.

bpaprate.xls

Production Rate

DATE: 04-Jun-99 SAMPLING TIME FROM: 10:33 AM TO 11:45 AM

STATEMENT OF PROCESS WEIGHT:

COMPANY NAME: CF INDUSTRIES, INC. PLANT CITY PHOSPHATE COMPLEX
 MAILING ADDRESS: P.O. DRAWER L PLANT CITY, FL 33564
 SOURCE IDENTIFICATION: "B" PAP PRODUCTION FACILITY
 SOURCE LOCATION: "B" PAP PRODUCTION STACK

PERMIT SOURCE: 0570005-007-AV
 Emission Unit 009

DATA ON OPERATING CYCLE TIME:

START OF OPERATION, TIME
 END OF OPERATION, TIME
 ELAPSED TIME
 IDLE TIME DURING CYCLE

	RUN #1			
	10:33 AM			
	11:45 AM			
	72 MIN			
	0			

DESIGN PROCESS RATING:

PROCESS WEIGHT RATE (INPUT) 87.8 TPH P2O5 PRODUCT (OUTPUT) _____ TPH

DATA ON ACTUAL PROCESS RATE DURING OPERATION CYCLE:

MATERIAL: PHOSPHATE ROCK, TPH P2O5
 MATERIAL: 100 % SULFURIC ACID, TPH
 MATERIAL: WATER, TPH

RUN #1		
437.02		
232.64		
16.97		

TOTAL PROCESS WEIGHT RATE:
 PRODUCT: PHOSPHORIC ACID SLURRY, TPH
 INPUT RATE: P2O5, TPH

RUN #1		
686.63		
86.25		

I certify that the above statement is true to the best of my knowledge and belief:

Signature: Frank Scimpigro
 Title: Prod. Eng.

Scrubber's Operating Parameters

DATE: 04-Jun-99

SAMPLING TIME FROM: 10:33 AM TO 11:45 AM

COMPANY NAME: CF INDUSTRIES, INC. PLANT CITY PHOSPHATE COMPLEX
 MAILING ADDRESS: P.O. DRAWER L PLANT CITY, FL 33564
 SOURCE IDENTIFICATION: "B" PAP PRODUCTION FACILITY
 SOURCE LOCATION: "B" PAP PRODUCTION STACK

PERMIT SOURCE: 0570005-007-AV

TYPE OF SCRUBBER LIQUID: POND WATER

PACKED BED SCRUBBER	START	RUN #1	COMMENTS
	10:33 AM		
	END	11:45 AM	
OUTLET	AVERAGE	96	
TEMPERATURES F	HIGH	100	
	LOW	92	

PACKED BED SCRUBBER	START	RUN #1	COMMENTS
	10:33 AM		
	END	11:45 AM	
FAN	AVERAGE	168.5	
AMPS	HIGH	169	
	LOW	168	

I certify that the above statement is true to the best of my knowledge and belief:

Signature: Frank Sumpster
 Title: Pond #1 Eng'

VISIBLE EMISSION OBSERVATION FORM

No. 1

COMPANY NAME
CF Industries, Inc. Plant City Complex

STREET ADDRESS
10608 Paul Buchman Highway

10 miles north of Plant City

CITY *Plant City* STATE *FL* ZIP *33564*

PHONE (KEY CONTACT) *(813) 782-1591 (Ext. 290)* SOURCE ID NUMBER *0570005 009*

PROCESS EQUIPMENT *B Phosphoric Acid Production Facility* OPERATING MODE *Normal*

CONTROL EQUIPMENT *North American steel packed bed scrubber with Kimre packing or equivalent* OPERATING MODE *Normal*

DESCRIBE EMISSION POINT
Circular stack opening 4 feet in diameter

HEIGHT ABOVE GROUND LEVEL *~108.5'* HEIGHT RELATIVE TO OBSERVER
Start *~108.5'* End *~108.5'*

DISTANCE FROM OBSERVER Start *~275'* End *~275'* DIRECTION FROM OBSERVER
Start *NE* End *NE*

DESCRIBE EMISSIONS
Start *None* End *None*

EMISSION COLOR Start *NA* End *NA* IF WATER DROPLET PLUME
Attached Detached


POINT IN THE PLUME AT WHICH OPACITY WAS DETERMINED
Start *~4' from stack* End *~4' from stack*

DESCRIBE PLUME BACKGROUND
Start *Scattered sky* End *Scattered sky*

BACKGROUND COLOR *Blue, gray, white* SKY CONDITIONS
Start *Blue, gray, white* End *white* Start *Scattered* End *Scattered*

WIND SPEED Start *2-6 mph* End *4-8 mph* WIND DIRECTION
Start *E* End *SE*

AMBIENT TEMP Start *88°F* End *89°F* WET BULB TEMP *65%* RH, percent

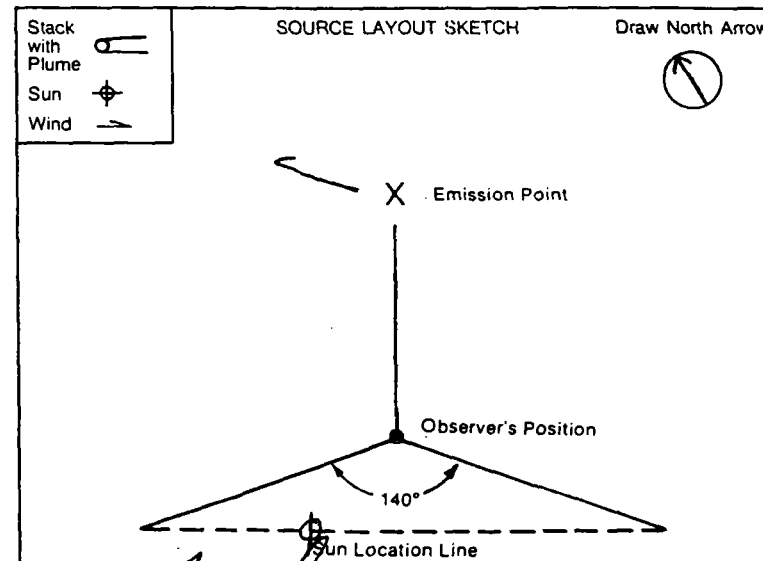

ADDITIONAL INFORMATION
J. David Jelle
Chief Chemist

OBSERVATION DATE		START TIME			END TIME
6/3/99		1350			1420
SEC	0	15	30	45	COMMENTS
MIN					
1	0	0	0	0	
2	0	0	0	0	
3	0	0	0	0	
4	0	0	0	0	
5	0	0	0	0	
6	0	0	0	0	
7	0	0	0	0	
8	0	0	0	0	
9	0	0	0	0	
10	0	0	0	0	
11	0	0	0	0	
12	0	0	0	0	
13	0	0	0	0	
14	0	0	0	0	
15	0	0	0	0	
16	0	0	0	0	
17	0	0	0	0	
18	0	0	0	0	
19	0	0	0	0	
20	0	0	0	0	
21	0	0	0	0	
22	0	0	0	0	
23	0	0	0	0	
24	0	0	0	0	
25	0	0	0	0	
26	0	0	0	0	
27	0	0	0	0	
28	0	0	0	0	
29	0	0	0	0	
30	0	0	0	0	

OBSERVER'S NAME (PRINT)
Lloyd G. Camp

OBSERVER'S SIGNATURE
Lloyd G. Camp DATE *6/3/99*

ORGANIZATION
CF Industries, Inc. Plant City Complex

CERTIFIED BY
Eastern Technical Associates DATE *2/24/99*

CONTINUED ON VEO FORM NUMBER *2*

VISIBLE EMISSION OBSERVATION FORM

No. 2

COMPANY NAME
CF Industries, Inc. Plant City Complex

STREET ADDRESS
10608 Paul Buchman Highway

10 miles north of Plant City

CITY
Plant City STATE
FL ZIP
33564

PHONE (KEY CONTACT)
(813) 782-1591 (Ext.290) SOURCE ID NUMBER
0570005 009

PROCESS EQUIPMENT
B Phosphoric Acid Production Facility OPERATING MODE
Normal

CONTROL EQUIPMENT
North American steel packed bed scrubber with Kinta packing or equivalent OPERATING MODE
Normal

DESCRIBE EMISSION POINT
Circular stack opening 4 Feet in diameter

HEIGHT ABOVE GROUND LEVEL
~ 108.5' HEIGHT RELATIVE TO OBSERVER
Start ~ 108.5' End ~ 108.5'

DISTANCE FROM OBSERVER
Start ~ 275' End ~ 275' DIRECTION FROM OBSERVER
Start NE End NE

DESCRIBE EMISSIONS
Start *None* End *None*

EMISSION COLOR
Start *NA* End *NA* IF WATER DROPLET PLUME
Attached Detached


POINT IN THE PLUME AT WHICH OPACITY WAS DETERMINED
Start *~ 4' from stack* End *~ 4' from stack*

DESCRIBE PLUME BACKGROUND
Start *Scattered sky* End *Scattered sky*

BACKGROUND COLOR
Start *Blue, gray, white* End *white* SKY CONDITIONS
Start *Scattered* End *Scattered*

WIND SPEED
Start *4-8mph* End *6-10mph* WIND DIRECTION
Start *SE* End *E*

AMBIENT TEMP
Start *89°F* End *90°F* WET BULB TEMP
64 RH, percent

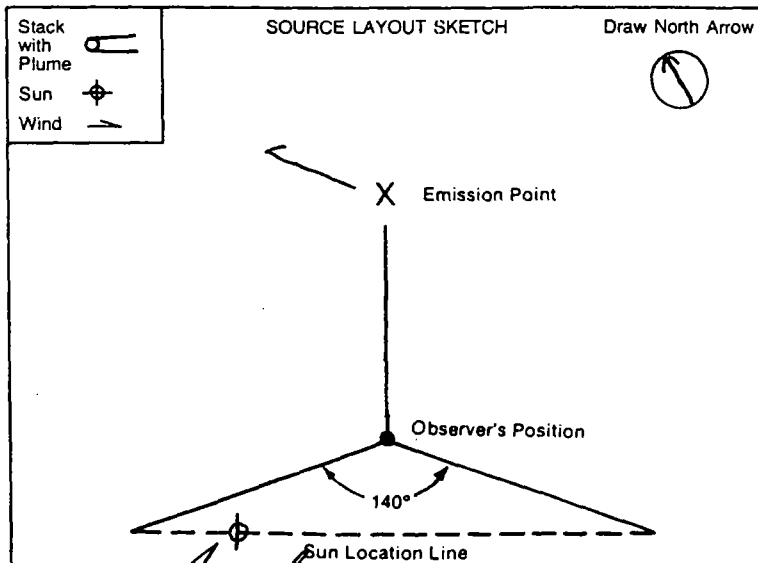

ADDITIONAL INFORMATION
Harriet Zell
Cheryl Bennett

OBSERVATION DATE		START TIME			END TIME
6/3/99		1420			1450
SEC	0	15	30	45	COMMENTS
MIN					
1	0	0	0	0	
2	0	0	0	0	
3	0	0	0	0	
4	0	0	0	0	
5	0	0	0	0	
6	0	0	0	0	
7	0	0	0	0	
8	0	0	0	0	
9	0	0	0	0	
10	0	0	0	0	
11	0	0	0	0	
12	0	0	0	0	
13	0	0	0	0	
14	0	0	0	0	
15	0	0	0	0	
16	0	0	0	0	
17	0	0	0	0	
18	0	0	0	0	
19	0	0	0	0	
20	0	0	0	0	
21	0	0	0	0	
22	0	0	0	0	
23	0	0	0	0	
24	0	0	0	0	
25	0	0	0	0	
26	0	0	0	0	
27	0	0	0	0	
28	0	0	0	0	
29	0	0	0	0	
30	0	0	0	0	

OBSERVER'S NAME (PRINT)
Lloyd G. Camp

OBSERVER'S SIGNATURE
Lloyd G. Camp DATE
6/3/99

ORGANIZATION
CF Industries, Inc. Plant City Complex

CERTIFIED BY
Eastern Technical Associates DATE
2/24/99

CONTINUED ON VEO FORM NUMBER

SAMPLE CHAIN OF CUSTODY

Plant Name CF INDUSTRIES, INC. PLANT CITY PHOSPHATE COMPLEX

Source Identification "B" PHOSPHORIC ACID PRODUCTION FACILITY

Date Sampled: JUNE 3, 1999 Sampling Time: 1:45 PM to 2:55 PM

Test for MOISTURE, FLUORIDE, AND VISIBLE EMISSION

SAMPLE RECOVERY

Sample Run	Description
1	#1 COLD BOX ASSEMBLY
2	#2 COLD BOX ASSEMBLY
3	#3 COLD BOX ASSEMBLY


Person engaged in sample recoveries:

Signature 

Title ANALYST II




Location at which recovery "B" PHOSPHORIC ACID STACK

Laboratory person receiving samples:

Signature 

Title "A" CLASS TECHNICIAN

ANALYSIS

Constituent	Method	Date	Time	Signature(s)
MOISTURE	EPA METHOD 4	6/3/99	15:15 - 15:25	
FLUORIDE	EPA METHOD 13 B	6/3/99	16:20 - 16:30	
VISIBLE EMISSION	EPA METHOD 9	6/3/99	13:50 - 14:50	

SAMPLE CHAIN OF CUSTODY

Plant Name CF INDUSTRIES, INC. PLANT CITY PHOSPHATE COMPLEX

Source Identification "B" PHOSPHORIC ACID PRODUCTION FACILITY

Date Sampled: JUNE 4, 1999 Sampling Time: 10:33 AM to 11:45 AM

Test for MOISTURE AND FLUORIDE

SAMPLE RECOVERY

Sample Run	Description
1	#1 COLD BOX ASSEMBLY
2	#2 COLD BOX ASSEMBLY
3	#3 COLD BOX ASSEMBLY


Person engaged in sample recoveries:

Signature 

Title ANALYST II



Location at which recovery "B" PHOSPHORIC ACID STACK

Laboratory person receiving samples:

Signature 

Title "A" CLASS TECHNICIAN

ANALYSIS

Constituent	Method	Date	Time	Signature(s)
MOISTURE	EPA METHOD 4	6/4/99	12:05 - 12:15	
FLUORIDE	EPA METHOD 13 B	6/4/99	12:20 - 12:30	

CF INDUSTRIES, INC.
Plant City Phosphate Complex
LABORATORY ANALYSIS RECORD

"B" PAP Production Plant
June 3, 1999

CF Industries, Inc., Plant City Phosphate Complex, uses a Fischer Accumet Model 50 pH meter with selective ion concentration capacity. The instrument has microprocessor function which calculates efficiency of the Orion Model 96-09 fluoride electrode being used and alerts the user in case of electrode malfunction.

STANDARDS

ELECTRODE
EFFICIENCY


(See Technical Information Section)

0.1 $\mu\text{g/ml}$	0.9083
1.0 $\mu\text{g/ml}$	0.9739
2.0 $\mu\text{g/ml}$	

Quality Assurance Sample #1 - 0.38 $\mu\text{g/ml}$.
Analysis was 0.39 $\mu\text{g/ml}$.

Quality Assurance Sample #2 - 0.76 $\mu\text{g/ml}$.
Analysis was 0.77 $\mu\text{g/ml}$.

Quality Assurance Sample #3 - 1.90 $\mu\text{g/ml}$.
Analysis was 1.88 $\mu\text{g/ml}$.



J. Harold Falls
Chief Chemist, Laboratory

JHF/gm
9/89

CF INDUSTRIES, INC.
Plant City Phosphate Complex
LABORATORY ANALYSIS RECORD

"B" PAP Production Plant
June 4, 1999

CF Industries, Inc., Plant City Phosphate Complex, uses a Fischer Accumet Model 50 pH meter with selective ion concentration capacity. The instrument has microprocessor function which calculates efficiency of the Orion Model 96-09 fluoride electrode being used and alerts the user in case of electrode malfunction.

STANDARDS

ELECTRODE
EFFICIENCY


(See Technical Information Section)

0.1 $\mu\text{g/ml}$	0.8964
1.0 $\mu\text{g/ml}$	0.9729
2.0 $\mu\text{g/ml}$	

Quality Assurance Sample #1 - 0.38 $\mu\text{g/ml}$.
Analysis was 0.40 $\mu\text{g/ml}$.

Quality Assurance Sample #2 - 0.76 $\mu\text{g/ml}$.
Analysis was 0.77 $\mu\text{g/ml}$.

Quality Assurance Sample #3 - 1.90 $\mu\text{g/ml}$.
Analysis was 1.89 $\mu\text{g/ml}$.

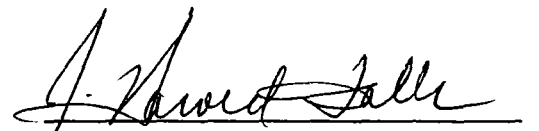
J. Harold Falls
Chief Chemist, Laboratory

JHF/gm
9/89

APPENDIX "C"

PROJECT PARTICIPANTS

PROJECT PARTICIPANTS

CF INDUSTRIES, INC.

PLANT CITY PHOSPHATE COMPLEX

H.E. Morris	General Manager
R.C. May	Manager of Engineering
T.A. Edwards	Supt., Environmental Affairs
J.M. Messina	Chief of Environmental Affairs
J.H. Falls	Chief Chemist, Laboratory
J.I. Longest	Staff Chemist
T. Ortoski	Environmental Supervisor
E. Kretschmar	Analyst II
S. Willoughby	"A" Class Technician
L. Camp	"A" Class Technician
W. Cherry	"A" Class Technician