

TO: Clair H. Fancy

THROUGH: Scott Sheplak *smk*

FROM: Cindy Phillips *cp*

DATE: October 9, 1998

SUBJECT: DRAFT Permit No. 0870003-001-AV
Utility Board of the City of Key West
Stock Island Power Plant

The Stock Island Power Plant consists of five regulated emission units with a total generating capacity of 80.7 MW. There are two regulated diesel generators, three simple cycle combustion turbines, and miscellaneous unregulated units. To reduce pollution, a combination of control techniques are used including water injection, ignition timing retardation, and low sulfur fuel oil. The Ralph Garcia Steam Plant was retired January 1, 1998.

There are no outstanding issues.

Attachment

CLP/sw

STATEMENT OF BASIS

Utility Board of the City of Key West
Stock Island Power Plant
Facility ID No. 0870003
Monroe County

Initial Title V Air Operation Permit
DRAFT Permit No. 0870003-001-AV

This Title V air operation permit is issued under the provisions of Chapter 403, Florida Statutes (F.S.), and Florida Administrative Code (F.A.C.) Chapters 62-4, 62-210, 62-213, and 62-214. The above named permittee is hereby authorized to perform the work or operate the facility shown in the application and approved drawings, plans, and other documents, attached hereto or on file with the permitting authority, in accordance with the terms and conditions of this permit.

This facility consists of five regulated emission units with a total generating capacity of 80.7 MW. There are two regulated diesel generators, three simple cycle combustion turbines, and miscellaneous unregulated units. To reduce pollution, a combination of control techniques are used including water injection, ignition timing retardation, and low sulfur fuel oil. The Ralph Garcia Steam Plant was retired January 1, 1998.

Emissions units 005 (D-1) & 006 (D-2) are 8.8 MW (nominal) electric Fairbanks Morse diesel generators which burn No. 2 distillate fuel oil and each has a maximum heat input rate of 85.4 million Btu per hour. Sulfur dioxide emissions are controlled by limiting the sulfur content of the fuel oil to 0.05% by weight. Nitrogen oxides emissions are controlled by ignition timing retard and by limiting the hours operation. Visible emissions and NOx emissions are continuously monitored. These units are exempt from Acid Rain requirements via New Unit Exemptions effective 01/01/99 through 12/31/03, pursuant to 40 CFR 72.7.

Emissions unit 007 (CT-1) is a General Electric (GE) Frame 5 model PG5341 CT equipped with water injection for fuel oil firing. It has a rated capacity of 23.5 MW and a heat input of 312 MMBtu per hour at ISO conditions. The CT is fired with low sulfur fuel oil. NOx emissions are controlled by a water injection system. This turbine began operation at this location January 1, 1996. This unit was exempted from Acid Rain requirements via a New Unit Exemption effective 01/01/99 through 12/31/03, pursuant to 40 CFR 72.7.

Emissions units 008 (CT-2) & 009 (CT-3) are two refurbished General Electric Model MS-5001R 19.77 MW combustion turbines. These units are exempt from Acid Rain requirements via New Unit Exemptions effective 01/01/99 through 12/31/03, pursuant to 40 CFR 72.7. CT-2 had a startup date of June 1, 1998, while CT-3 had a startup date of August 1, 1998.

Emissions unit 010 combines all unregulated activities. This includes three 2 MW diesel peaking generators that are only subject to the visible emissions standard. Also included in this permit are miscellaneous insignificant emissions units and activities.

Based on the initial Title V permit application received June 12, 1996, this Title V Source is not a major source of hazardous air pollutants (HAPs).



Department of Environmental Protection

Lawton Chiles
Governor

Twin Towers Office Building
2600 Blair Stone Road
Tallahassee, Florida 32399-2400

Virginia B. Wetherell
Secretary

P.E. Certification Statement

Permittee:
Utility Board of the City of Key West
Stock Island

DRAFT Permit No.: 0870003-001-AV
Facility ID No.: 0870003

Project type: Initial Title V Air Operation Permit

I HEREBY CERTIFY that the engineering features described in the above referenced application and subject to the proposed permit conditions provide reasonable assurance of compliance with applicable provisions of Chapter 403, Florida Statutes, and Florida Administrative Code Chapters 62-4 and 62-204 through 62-297. However, I have not evaluated and I do not certify aspects of the proposal outside of my area of expertise (including but not limited to the electrical, mechanical, structural, hydrological, geological features, and Acid Rain Part).



C. L. Phillips, P.E.

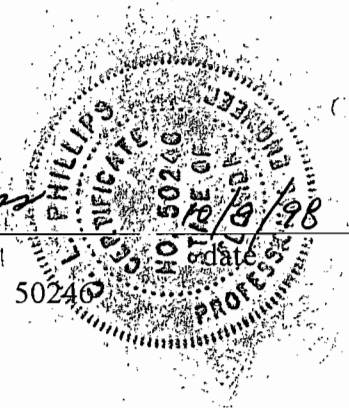
Registration Number: 50240


Permitting Authority:

State of Florida
Department of Environmental Protection
Division of Air Resources Management
Bureau of Air Regulation
Title V Section MS #5505
2600 Blair Stone Road
Tallahassee, FL 323992400

Telephone: 850/488-1344

Fax: 805/922-6979





Department of Environmental Protection

Lawton Chiles
Governor

Twin Towers Office Building
2600 Blair Stone Road
Tallahassee, Florida 32399-2400

Virginia B. Wetherell
Secretary

October 12, 1998

Mr. Larry Thompson
Manager
Utility Board of the City of Key West
P.O. Drawer 6100
Key West, Florida 33041-6100

Re: DRAFT Title V Permit No. 0870003-001-AV
Stock Island Power Plant

Dear Mr. Carey:

One copy of the DRAFT Title V Air Operation Permit for the Stock Island Power Plant located at 6900 Front Street, Stock Island, Monroe County, is enclosed. The permitting authority's "INTENT TO ISSUE TITLE V AIR OPERATION PERMIT" is also included.

The "PUBLIC NOTICE OF INTENT TO ISSUE TITLE V AIR OPERATION PERMIT" must be published as soon as possible upon receipt of this letter. This issue is important in order for you to receive your Title IV Acid Rain permit by January 1, 1999, pursuant to the Clean Air Act and Section 403.782, Florida Statutes. Proof of publication, i.e., newspaper affidavit, must be provided to the permitting authority's office within seven days of publication. Failure to publish the notice and provide proof of publication within the allotted time may result in denial of the permit.

Please submit any written comments you wish to have considered concerning the permitting authority's proposed action to Scott M. Sheplak, P.E., at the above letterhead address. If you have any other questions, please contact Steve Welsh at 850/921-9585.

Sincerely,

C. H. Fancy, P.E.
Chief
Bureau of Air Regulation

CHF/w

Enclosures

cc: Ms. Carla E. Pierce, U.S. EPA, Region 4 (INTERNET E-mail Memorandum)
Ms. Gracy Danois, U.S. EPA, Region 4 (INTERNET E-Mail Memorandum)

10/15/98 cc: Reading File
Steve Welsh

"Protect, Conserve and Manage Florida's Environment and Natural Resources"

Is your RETURN ADDRESS completed on the reverse side?

SENDER:

- Complete items 1 and/or 2 for additional services.
- Complete items 3, 4a, and 4b.
- Print your name and address on the reverse of this form so that we can return this card to you.
- Attach this form to the front of the mailpiece, or on the back if space does not permit.
- Write "Return Receipt Requested" on the mailpiece below the article number.
- The Return Receipt will show to whom the article was delivered and the date delivered.

I also wish to receive the following services (for an extra fee):

- Addressee's Address
- Restricted Delivery

Consult postmaster for fee.

3. Article Addressed to:

Mr. Carl R. Jansen, Jr.
 Utility Board of the City of
 Key West
 P.O. Drawer 6100
 Key West, Florida 33041-6100

4a. Article Number

P 265 301 742

4b. Service Type

- Registered Certified
- Express Mail Insured
- Return Receipt for Merchandise COD

7. Date of Delivery

10/19/98

5. Received By: (Print Name)

6. Signature: (Addressee or Agent)

[Signature] 10/19/98

8. Addressee's Address (Only if requested and fee is paid)

PS Form 3811, December 1994

102595-97-B-0179

Domestic Return Receipt

P 265 301 741

US Postal Service

Receipt for Certified Mail

No Insurance Coverage Provided.

Do not use for International Mail (See reverse)

Sent to Mr. Larry Thompson	
Street & Number P.O. Drawer 6100	
Post Office, State, & ZIP Code Key West, Florida 33041-6100	
Postage	\$
Certified Fee	
Special Delivery Fee	
Restricted Delivery Fee	
Return Receipt Showing to Whom & Date Delivered	
Return Receipt Showing to Whom, Date, & Addressee's Address	
TOTAL Postage & Fees	\$
Postmark or Date 10/15/98	
City of Key West - Stock Island, ID#0870003-001-AV	

Thank you for using Return Receipt Service.

PS Form 3800, April 1995

Is your RETURN ADDRESS completed on the reverse side?

SENDER:

- Complete items 1 and/or 2 for additional services.
- Complete items 3, 4a, and 4b.
- Print your name and address on the reverse of this form so that we can return this card to you.
- Attach this form to the front of the mailpiece, or on the back if space does not permit.
- Write "Return Receipt Requested" on the mailpiece below the article number.
- The Return Receipt will show to whom the article was delivered and the date delivered.

I also wish to receive the following services (for an extra fee):

- Addressee's Address
- Restricted Delivery

Consult postmaster for fee.

3. Article Addressed to:

Mr. Larry Thompson
 Manager
 Utility Board of the City of
 Key West
 P.O. Drawer 6100
 Key West, Florida 33041-6100

4a. Article Number

P 265 301 741

4b. Service Type

- Registered Certified
- Express Mail Insured
- Return Receipt for Merchandise COD

7. Date of Delivery

10/19/98

5. Received By: (Print Name)

6. Signature: (Addressee or Agent)

[Signature] 10/19/98

8. Addressee's Address (Only if requested and fee is paid)

PS Form 3811, December 1994

102595-97-B-0179

Domestic Return Receipt

P 265 301 742

US Postal Service

Receipt for Certified Mail

No Insurance Coverage Provided.

Do not use for International Mail (See reverse)

Sent to Mr. Carl R. Jansen, Jr.	
Street & Number P. O. Drawer 6100	
Post Office, State, & ZIP Code Key West, FL 33041-6100	
Postage	\$
Certified Fee	
Special Delivery Fee	
Restricted Delivery Fee	
Return Receipt Showing to Whom & Date Delivered	
Return Receipt Showing to Whom, Date, & Addressee's Address	
TOTAL Postage & Fees	\$
Postmark or Date 10/15/98	
City of Key West - Stock Island, ID#0870003-001-AV	

Thank you for using Return Receipt Service.

PS Form 3800, April 1995

In the Matter of an
Application for Permit by:
Utility Board of the City of Key West
P.O. Drawer 6100
Key West, Florida 33041-6100

DRAFT Permit No. 0870003-001-AV
Stock Island Power Plant
Monroe County

INTENT TO ISSUE TITLE V AIR OPERATION PERMIT

The Department of Environmental Protection (permitting authority) gives notice of its intent to issue a Title V air operation permit (copy of DRAFT Permit enclosed) for the Title V source detailed in the application specified above, for the reasons stated below.

The applicant, Utility Board of the City of Key West, applied on June 12, 1996, to the permitting authority for a Title V air operation permit for the Stock Island Power Plant located at 6900 Front Street, Stock Island, Monroe County.

The permitting authority has permitting jurisdiction under the provisions of Chapter 403, Florida Statutes (F.S.), and Florida Administrative Code (F.A.C.) Chapters 62-4, 62-210, 62-213, and 62-214. This source is not exempt from Title V permitting procedures. The permitting authority has determined that a Title V air operation permit is required to commence or continue operations at the described facility.

The permitting authority intends to issue this Title V air operation permit based on the belief that reasonable assurances have been provided to indicate that operation of the source will not adversely impact air quality, and the source will comply with all appropriate provisions of Chapters 62-4, 62-204, 62-210, 62-212, 62-213, 62-214, 62-256, 62-257, 62-281, 62-296, and 62-297, F.A.C.

Pursuant to Sections 403.815 and 403.0872, F.S., and Rules 62-103.150 and 62-210.350(3), F.A.C., you (the applicant) are required to publish at your own expense the enclosed "PUBLIC NOTICE OF INTENT TO ISSUE TITLE V AIR OPERATION PERMIT." The notice shall be published one time only within 30 (thirty) days in the legal advertisement section of a newspaper of general circulation in the area affected. For the purpose of these rules, "publication in a newspaper of general circulation in the area affected" means publication in a newspaper meeting the requirements of Sections 50.011 and 50.031, F.S., in the county where the activity is to take place. Where there is more than one newspaper of general circulation in the county, the newspaper used must be one with significant circulation in the area that may be affected by the permit. If you are uncertain that a newspaper meets these requirements, please contact the permitting authority at the address or telephone number listed below. The applicant shall provide proof of publication to the Department's Bureau of Air Regulation, 2600 Blair Stone Road, Mail Station #5505, Tallahassee, Florida 32399-2400 (Telephone: 850/488-1344; Fax: 850/922-6979), within 7 (seven) days of publication. Failure to publish the notice and provide proof of publication within the allotted time may result in the denial of the permit pursuant to Rule 62-103.150(6), F.A.C.

The permitting authority will issue the Title V PROPOSED Permit, and subsequent Title V FINAL Permit, in accordance with the conditions of the enclosed Title V DRAFT Permit unless a response received in accordance with the following procedures results in a different decision or significant change of terms or conditions.

The permitting authority will accept written comments concerning the proposed permit issuance action for a period of 30 (thirty) days from the date of publication of "PUBLIC NOTICE OF INTENT TO ISSUE TITLE V AIR OPERATION PERMIT." Written comments should be provided to the permitting authority office. Any written comments filed shall be made available for public inspection. If written comments received result in a significant change in this DRAFT Permit, the permitting authority shall issue a Revised DRAFT Permit and require, if applicable, another Public Notice.

The permitting authority will issue the permit with the attached conditions unless a timely petition for an administrative hearing is filed pursuant to Sections 120.569 and 120.57, Florida Statutes. Mediation under Section 120.573, F.S., will not be available for this proposed action.

A person whose substantial interests are affected by the proposed permitting decision may petition for an administrative hearing in accordance with Sections 120.569 and 120.57, F.S. The petition must contain the information set forth below and must be filed (received) in the Office of General Counsel of the Department of Environmental Protection, 3900 Commonwealth Boulevard, Mail Station #35, Tallahassee, Florida 32399-3000 (Telephone: 850/488-9730; Fax: 850/487-4938). Petitions filed by the permit applicant or any of the parties listed below must be filed within 14 (fourteen) days of receipt of this notice of intent. Petitions filed by any other person must be filed within 14 (fourteen) days of publication of the public notice or within 14 (fourteen) days of receipt of this notice of intent, whichever occurs first. A petitioner must mail a copy of the petition to the applicant at the address indicated above, at the time of filing. The failure of any person to file a petition (or a request for mediation, as discussed below) within the appropriate time period shall constitute a waiver of that person's right to request an administrative determination (hearing) under Sections 120.569 and 120.57, F.S., or to intervene in this proceeding and participate as a party to it. Any subsequent intervention will be only at the approval of the presiding officer upon the filing of a motion in compliance with Rule 28-5.207, F.A.C.

A petition must contain the following information:

- (a) The name, address, and telephone number of each petitioner, the applicant's name and address, the Permit File Number, and the county in which the project is proposed;
- (b) A statement of how and when each petitioner received notice of the permitting authority's action or proposed action;
- (c) A statement of how each petitioner's substantial interests are affected by the permitting authority's action or proposed action;
- (d) A statement of the material facts disputed by the petitioner, if any;
- (e) A statement of the facts that the petitioner contends warrant reversal or modification of the permitting authority's action or proposed action;

(f) A statement identifying the rules or statutes that the petitioner contends require reversal or modification of the permitting authority's action or proposed action; and,

(g) A statement of the relief sought by the petitioner, stating precisely the action that the petitioner wants the permitting authority to take with respect to the action or proposed action addressed in this notice of intent.

Because the administrative hearing process is designed to formulate final agency action, the filing of a petition means that the permitting authority's final action may be different from the position taken by it in this notice of intent. Persons whose substantial interests will be affected by any such final decision of the permitting authority on the application have the right to petition to become a party to the proceeding, in accordance with the requirements set forth above.

In addition to the above, a person subject to regulation has a right to apply to the Department of Environmental Protection for a variance from or waiver of the requirements of particular rules, on certain conditions, under Section 120.542, F.S. The relief provided by this state statute applies only to state rules, not statutes, and not to any federal regulatory requirements. Applying for a variance or waiver does not substitute or extend the time for filing a petition for an administrative hearing or exercising any other right that a person may have in relation to the action proposed in this notice of intent.

The application for a variance or waiver is made by filing a petition with the Office of General Counsel of the Department of Environmental Protection, 3900 Commonwealth Boulevard, Mail Station #35, Tallahassee, Florida 32399-3000. The petition must specify the following information:

- (a) The name, address, and telephone number of the petitioner;
- (b) The name, address, and telephone number of the attorney or qualified representative of the petitioner, if any;
- (c) Each rule or portion of a rule from which a variance or waiver is requested;
- (d) The citation to the statute underlying (implemented by) the rule identified in (c) above;
- (e) The type of action requested;
- (f) The specific facts that would justify a variance or waiver for the petitioner;
- (g) The reason why the variance or waiver would serve the purposes of the underlying statute (implemented by the rule); and,
- (h) A statement whether the variance or waiver is permanent or temporary and, if temporary, a statement of the dates showing the duration of the variance or waiver requested.

The Department will grant a variance or waiver when the petition demonstrates both that the application of the rule would create a substantial hardship or violate principles of fairness, as each of those terms is defined in Section 120.542(2), F.S., and that the purpose of the underlying statute will be or has been achieved by other means by the petitioner.

Persons subject to regulation pursuant to any federally delegated or approved air program should be aware that Florida is specifically not authorized to issue variances or waivers from any requirements of any such federally delegated or approved program. The requirements of the program remain fully enforceable by the Administrator of the United States Environmental Protection Agency and by any person under the Clean Air Act unless and until the Administrator separately approves any variance or waiver in accordance with the procedures of the federal program.

Finally, pursuant to 42 United States Code (U.S.C.) Section 7661d(b)(2), any person may petition the Administrator of the EPA within 60 (sixty) days of the expiration of the Administrator's 45 (forty-five) day review period as established at 42 U.S.C. Section 7661d(b)(1), to object to issuance of any permit. Any petition shall be based only on objections to the permit that were raised with reasonable specificity during the 30 (thirty) day public comment period provided in this notice, unless the petitioner demonstrates to the Administrator of the EPA that it was impracticable to raise such objections within the comment period or unless the grounds for such objection arose after the comment period. Filing of a petition with the Administrator of the EPA does not stay the effective date of any permit properly issued pursuant to the provisions of Chapter 62-213, F.A.C. Petitions filed with the Administrator of EPA must meet the requirements of 42 U.S.C. Section 7661d(b)(2) and must be filed with the Administrator of the EPA at 401 M. Street, SW, Washington, D.C. 20460.

Executed in Tallahassee, Florida.

**STATE OF FLORIDA DEPARTMENT
OF ENVIRONMENTAL PROTECTION**



C. H. Fancy, P.E.

Chief

Bureau of Air Regulation

CERTIFICATE OF SERVICE

The undersigned duly designated deputy agency clerk hereby certifies that this INTENT TO ISSUE TITLE V AIR OPERATION PERMIT (including the PUBLIC NOTICE and the DRAFT permit) and all copies were sent by certified mail before the close of business on 10/15/98 to the persons listed:

Mr. Larry Thompson, Utility Board of the City of Key West
Mr. Carl R. Jansen, Jr., Utility Board of the City of Key West

In addition, the undersigned duly designated deputy agency clerk hereby certifies that copies of this INTENT TO ISSUE TITLE V AIR OPERATION PERMIT (including the PUBLIC NOTICE and the DRAFT permit) were sent by U.S. mail on the same date to the persons listed:

Mr. Ivan Clark, P.E., R.W. Beck Engineering
South Florida District Office, FDEP, attn. David Knowles
South Florida District Branch Office, FDEP, attn. Jim Edds

Clerk Stamp

FILING AND ACKNOWLEDGMENT FILED, on this date, pursuant to Section 120.52(7), Florida Statutes, with the designated agency Clerk, receipt of which is hereby acknowledged.

Barbara J. Portwell 10/15/98
(Clerk) (Date)

PUBLIC NOTICE OF INTENT TO ISSUE TITLE V AIR OPERATION PERMIT

STATE OF FLORIDA
DEPARTMENT OF ENVIRONMENTAL PROTECTION

Title V DRAFT Permit No. 0870003-001-AV
Stock Island Power Plant
Monroe County

The Department of Environmental Protection (permitting authority) gives notice of its intent to issue a Title V air operation permit to Utility Board of the City of Key West for the Stock Island Power Plant located at 6900 Front Street, Stock Island, Monroe County. The applicant's name and address are: Utility Board of the City of Key West, P.O. Drawer 6100, Key West, Florida 33041-6100.

The permitting authority will issue the Title V DRAFT Permit, and subsequent Title V FINAL Permit, in accordance with the conditions of the Title V DRAFT Permit unless a response received in accordance with the following procedures results in a different decision or significant change of terms or conditions.

The permitting authority will accept written comments concerning the proposed Title V DRAFT Permit issuance action for a period of 30 (thirty) days from the date of publication of this Notice. Written comments should be provided to the Department's Bureau of Air Regulation, 2600 Blair Stone Road, Mail Station #5505, Tallahassee, Florida 32399-2400. Any written comments filed shall be made available for public inspection. If written comments received result in a significant change in this DRAFT Permit, the permitting authority shall issue a Revised DRAFT Permit and require, if applicable, another Public Notice.

The permitting authority will issue the permit unless a timely petition for an administrative hearing is filed pursuant to Sections 120.569 and 120.57, F.S. Mediation under Section 120.573, F.S., will not be available for this proposed action.

A person whose substantial interests are affected by the proposed permitting decision may petition for an administrative hearing in accordance with Sections 120.569 and 120.57, F.S. The petition must contain the information set forth below and must be filed (received) in the Office of General Counsel of the Department of Environmental Protection, 3900 Commonwealth Boulevard, Mail Station #35, Tallahassee, Florida 32399-3000 (Telephone: 850/488-9730; Fax: 850/487-4938). Petitions must be filed within 14 (fourteen) days of publication of the public notice or within 14 (fourteen) days of receipt of the notice of intent, whichever occurs first. A petitioner must mail a copy of the petition to the applicant at the address indicated above, at the time of filing. The failure of any person to file a petition within the applicable time period shall constitute a waiver of that person's right to request an administrative determination (hearing) under Sections 120.569 and 120.57, F.S., or to intervene in this proceeding and participate as a party to it. Any subsequent intervention will be only at the approval of the presiding officer upon the filing of a motion in compliance with Rule 28-5.207 of the Florida Administrative Code.

A petition must contain the following information:

- (a) The name, address, and telephone number of each petitioner, the applicant's name and address, the Permit File Number, and the county in which the project is proposed;
- (b) A statement of how and when each petitioner received notice of the permitting authority's action or proposed action;
- (c) A statement of how each petitioner's substantial interests are affected by the permitting authority's action or proposed action;
- (d) A statement of the material facts disputed by the petitioner, if any;
- (e) A statement of the facts that the petitioner contends warrant reversal or modification of the permitting authority's action or proposed action;

(f) A statement identifying the rules or statutes that the petitioner contends require reversal or modification of the permitting authority's action or proposed action; and,

(g) A statement of the relief sought by the petitioner, stating precisely the action that the petitioner wants the permitting authority to take with respect to the action or proposed action addressed in this notice of intent.

Because the administrative hearing process is designed to formulate final agency action, the filing of a petition means that the permitting authority's final action may be different from the position taken by it in this notice of intent. Persons whose substantial interests will be affected by any such final decision of the permitting authority on the application have the right to petition to become a party to the proceeding, in accordance with the requirements set forth above.

In addition to the above, pursuant to 42 United States Code (U.S.C.) Section 7661d(b)(2), any person may petition the Administrator of the EPA within 60 (sixty) days of the expiration of the Administrator's 45 (forty-five) day review period as established at 42 U.S.C. Section 7661d(b)(1), to object to issuance of any permit. Any petition shall be based only on objections to the permit that were raised with reasonable specificity during the 30 (thirty) day public comment period provided in this notice, unless the petitioner demonstrates to the Administrator of the EPA that it was impracticable to raise such objections within the comment period or unless the grounds for such objection arose after the comment period. Filing of a petition with the Administrator of the EPA does not stay the effective date of any permit properly issued pursuant to the provisions of Chapter 62-213, F.A.C. Petitions filed with the Administrator of EPA must meet the requirements of 42 U.S.C. Section 7661d(b)(2) and must be filed with the Administrator of the EPA at 401 M. Street, SW, Washington, D.C. 20460.

A complete project file is available for public inspection during normal business hours, 8:00 a.m. to 5:00 p.m., Monday through Friday, except legal holidays, at:

Permitting Authority:

Department of Environmental Protection
Bureau of Air Regulation
111 South Magnolia Drive, Suite 4
Tallahassee, Florida 32301
Telephone: 850/488-1344
Fax: 850/922-6979

Affected District:

FDEP South Florida District Office
2295 Victoria Avenue, Suite 364
Fort Myers, Florida 33901
Telephone: 941/332-6975
Fax: 941/332-6969

FDEP South Florida District Branch Office
2796 Overseas Highway, Suite 221
Marathon, Florida 33050
Telephone: 305/289-2310
Fax: 305/289-2314

The complete project file includes the DRAFT Permit, the application, and the information submitted by the responsible official, exclusive of confidential records under Section 403.111, F.S. Interested persons may contact Scott M. Sheplak, P.E., at the above address, or call 850/488-1344, for additional information.

Utility Board of the City of Key West
Stock Island Power Plant
Facility ID No. 0870003
Monroe County

Initial Title V Air Operation Permit
DRAFT Permit No. 0870003-001-AV

Permitting Authority:

State of Florida
Department of Environmental Protection
Division of Air Resources Management
Bureau of Air Regulation
Title V Section

Mail Station #5505
2600 Blair Stone Road
Tallahassee, Florida 32399-2400

Telephone: 850/488-1344
Fax: 850/922-6979

October 9, 1998

Initial Title V Air Operation Permit
DRAFT Permit No. 0870003-001-AV

TABLE OF CONTENTS

Section	Page
Placard Page.....	1
I. Facility Information.....	2
A. Facility Description	2
B. Summary of Emissions Unit ID Nos. and Brief Descriptions	2
C. Retired Acid Rain Units.....	2
D. Relevant Documents	3
II. Facility-wide Conditions	4
III. Emissions Units and Conditions.....	7
A. Two Diesel Generators, 8.8 MW.....	7
B. 23.5 MW Combustion Turbine	13
C. 19.77 MW Combustion Turbine	16
D. Common Conditions I.....	20
E. Common Conditions II	22
IV. Acid Rain Part.....	37



Department of Environmental Protection

Lawton Chiles
Governor

Twin Towers Office Building
2600 Blair Stone Road
Tallahassee, Florida 32399-2400

Virginia B. Wetherell
Secretary

Permittee:

Utility Board of the City of Key West
P.O. Drawer 6100
Key West, Florida 33041-6100

DRAFT Permit No. 0870003-001-AV

Facility ID No. 0870003

SIC Nos. 49, 4911

Project: Initial Title V Air Operation Permit

This permit is for the operation of the Stock Island Power Plant. This facility is located at 6900 Front Street, Stock Island, Monroe County; UTM Coordinates: Zone 17, 425.65 km East and 2716.67 km North; Latitude: 24° 33' 49" North and Longitude: 81° 44' 03" West.

STATEMENT OF BASIS: This Title V air operation permit is issued under the provisions of Chapter 403, Florida Statutes (F.S.) and Florida Administrative Code (F.A.C.) Chapters 62-4, 62-210, 62-213, and 62-214. The Utility Board of the City of Key West is authorized to operate the Stock Island Power Plant as shown in the application and approved drawings, plans, and other documents, in accordance with the terms and conditions of this permit.

Referenced attachments made a part of this permit:

Appendix U-1, List of Unregulated Emissions Units

Appendix I-1, List of Insignificant Emissions Units and Activities

APPENDIX TV-1, TITLE V CONDITIONS (Version Dated 12/02/97)

APPENDIX SS-1, STACK SAMPLING FACILITIES (Version dated 10/07/96)

TABLE 297.310-1, CALIBRATION SCHEDULE (Version Dated 10/07/96)

FIGURE 1 - SUMMARY REPORT - GASEOUS AND OPACITY EXCESS EMISSION AND MONITORING SYSTEM REPORT (version dated 7/96)

ORDER EXTENDING PERMIT EXPIRATION DATE

Acid Rain Retired Unit Exemption (Ralph Garcia Steam Plant)

Phase II Acid Rain New Unit Exemptions (D-1, D-2, CT-1, CT-2, & CT-3)

Effective Date: January 1, 1999

Renewal Application Due Date: July 5, 2003

Expiration Date: December 31, 2003

Howard L. Rhodes, Director
Division of Air Resources
Management

HLR/clp/stw

Section I. Facility Information

Subsection A. Facility Description

This facility consists of five regulated emission units with a total generating capacity of 80.7 MW. There are two regulated diesel generators, three simple cycle combustion turbines, and miscellaneous unregulated units. To reduce pollution, a combination of control techniques are used including water injection, ignition timing retardation, and low sulfur fuel oil. The Ralph Garcia Steam Plant [EPA ID #1] was retired January 1, 1998. Also included in this permit are insignificant emissions units and activities.

Based on the initial Title V permit application received June 12, 1996, this facility is not a major source of hazardous air pollutants (HAPs).

Subsection B. Summary of Emissions Units

E.U.

<u>ID No.</u>	<u>Brief Description</u>
005	8.8 MW Medium Speed Diesel Generator [Unit #1; EPA ID #D-1]
006	8.8 MW Medium Speed Diesel Generator [Unit #2; EPA ID #D-2]
007	23.5 MW Simple Cycle Combustion Turbine [CT-1]
008	19.77 MW Simple Cycle Combustion Turbine [CT-2]
009	19.77 MW Simple Cycle Combustion Turbine [CT-3]
010	Unregulated Emissions Units (See Appendix U-1.)

Emission units 002, 003, and 004 were moved to emissions unit 010.

Subsection C. Retired Acid Rain Unit

001	37 MW Ralph Garcia Steam Plant [EPA ID #1][Retired January 1998]
-----	--

Please reference the Permit No., Facility ID No., and appropriate Emissions Unit ID Nos. on all correspondence, test report submittals, applications, and other information.

Subsection D. Relevant Documents

The documents listed below are not a part of this permit; however they are specifically related to this permitting action.

These documents are provided to the Permittee for information purposes only:

Table 1-1, Summary of Air Pollutant Standards and Terms

Table 2-1, Summary of Compliance Requirements

Appendix A-1, Abbreviations, Acronyms, Citations, and Identification Numbers

Appendix H-1, Permit History/ID Number Transfers

These documents are on file with permitting authority:

Initial Title V Permit Application received June 12, 1996.

Section II. Facility-wide Conditions

1. APPENDIX TV-1, TITLE V CONDITIONS (version dated 8/11/97), is a part of this permit.

{Permitting note: APPENDIX TV-1, TITLE V CONDITIONS, is distributed to the Permittee only. Other persons requesting copies of these conditions shall be provided a copy when requested or otherwise appropriate.}

2. Not federally enforceable. General Pollutant Emission Limiting Standards.

Objectionable Odor Prohibited. The Permittee shall not cause, suffer, allow, or permit the discharge of air pollutants which cause or contribute to an objectionable odor.

[Rule 62-296.320(2), F.A.C.]

3. General Particulate Emission Limiting Standards. General Visible Emissions Standard.

Except for emissions units that are subject to a particulate matter or opacity limit set forth or established by rule and reflected by conditions in this permit, no person shall cause, let, permit, suffer or allow to be discharged into the atmosphere the emissions of air pollutants from any activity, the density of which is equal to or greater than that designated as Number 1 on the Ringelmann Chart (20 percent opacity). EPA Method 9 is the method of compliance pursuant to Chapter 62-297, F.A.C.

[Rule 62-296.320(4)(b)1. & 4., F.A.C.]

{Permitting Note: Although the Permittee is not required to perform a visible emissions compliance test to demonstrate compliance with the facility-wide limitations annually or before renewal, if the Department believes that the general visible emissions standard is being violated, the Department may require that the owner or operator perform a visible emissions compliance test per Chapter 62-297.310(7)(b), Special Compliance Tests. In addition, Department personnel who are certified to perform visible emissions tests may determine compliance with the general visible emissions standard.}

4. Prevention of Accidental Releases (Section 112(r) of CAA). If required by 40 CFR 68, the Permittee shall submit to the implementing agency:

a. a risk management plan (RMP) when, and if, such requirement becomes applicable, and

b. certification forms and/or RMPs according to the promulgated rule schedule.

[40 CFR 68]

5. General Pollutant Emission Limiting Standards. Volatile Organic Compounds (VOC) Emissions or Organic Solvents (OS) Emissions.

The Permittee shall allow no person to store, pump, handle, process, load, unload or use in any process or installation, volatile organic compounds or organic solvents without applying known and existing vapor emission control devices or systems deemed necessary and ordered by the Department.

[Rule 62-296.320(1)(a), F.A.C.]

6. Insignificant Emissions Units and/or Activities. Appendix I-1, List of Exempt Emissions Units and/or Activities, is a part of this permit.

[Rules 62-213.440(1), 62-213.430(6), and 62-4.040(1)(b), F.A.C.]

7. Not federally enforceable. The Permittee shall take reasonable precautions to prevent emissions of unconfined particulate matter at this facility. These precautions include receiving delivery of fuel oil by barge rather than trucks, and using paved roads for the fuel trucks which deliver vehicle fuel. Additionally, watering will be used as needed to prevent emissions from unpaved areas.

[Rule 62-296.320(4)(c)2., F.A.C.; Proposed by applicant in the initial Title V permit application received June 12, 1996]

8. The Permittee shall submit all compliance, annual operating reports and other correspondence required of this permit to the Department's South District and Marathon Branch offices:

Department of Environmental Protection
South District Office
2295 Victoria Avenue, Suite 364
Fort Myers, Florida, 33901
Telephone: 941/332-6975
Fax: 941/332-6969

Department of Environmental Protection
Marathon Branch Office
2796 Overseas Highway, Suite 221
Marathon Florida, 33901
Telephone: 305/289-2310
Fax: 305/289-2314

9. Any reports, data, notifications, certifications, and requests required to be sent to the United States Environmental Protection Agency, Region 4, should be sent to:

United States Environmental Protection Agency

Region 4

Air, Pesticides, & Toxics Management Division

Operating Permits Section

61 Forsyth Street

Atlanta, Georgia 30303

Telephone: 404/562-9099

Fax: 404/562-9095

10. When appropriate, any recording, monitoring, or reporting requirements that are time-specific shall be in accordance with the effective date of the permit, which defines day one. [Rule 62-213.440, F.A.C.]

Section III. Emissions Units and Conditions

Subsection A. Two Medium Speed Diesel Generators

E.U.

<u>ID No.</u>	<u>Brief Description</u>
005	8.8 MW Medium Speed Diesel Generator [Unit #1; EPA ID #D-1]
006	8.8 MW Medium Speed Diesel Generator [Unit #2; EPA ID #D-2]

Each of the two 8.8 MW (nominal) electric Fairbanks Morse diesel generators (Model PC-2.6V) burns No. 2 distillate fuel oil and has a maximum heat input rate of 85.4 million Btu per hour. Sulfur dioxide emissions are controlled by limiting the sulfur content of the No. 2 fuel oil to 0.05% by weight. Nitrogen oxides emissions are controlled by ignition timing retard and by limiting the hours operation. Visible emissions and NOx emissions are continuously monitored. Commercial operation commenced April 1, 1991. The units are exempt from acid rain regulations by the attached New Unit Exemptions, effective January 1, 1999 through December 31, 2003.

{Rule 212.400, F.A.C., Prevention of Significant Deterioration (PSD); Rule 62-212.400(6), F.A.C., Best Available Control Technology (BACT) Determination dated 6/5/89, AO44-207419 & PSD-FL-135}

Essential Potential to Emit (PTE) Parameters

A.1. Permitted Capacity. The maximum heat input rate to each diesel generator shall not exceed 85.4 MMBtu per hour (606 gallons per hour). The sum total consumption of fuel oil for both diesel generators combined shall not exceed 2.27 million gallons in any consecutive 12-month period.

[Rule 62-4.160(2), F.A.C. and Rule 62-210.200, F.A.C., Definitions - (PTE) and AC44-207419/PSD-FL-135]

A.2. Emissions Unit Operating Rate Limitation During and After Testing. Testing of emissions shall be conducted with the emissions unit operation at permitted capacity, which is defined as 90 to 100 percent of the maximum operation rate allowed by the permit. If it is impracticable to test at permitted capacity, an emissions unit may be tested at less than the minimum permitted capacity; in this case, subsequent emissions unit operation is limited to 110 percent of the test load until a new test is conducted. Once the emissions unit is so limited, operation at higher capacities is allowed for no more than 15 consecutive days for the purpose of additional compliance testing to regain the authority to operate at the permitted capacity

[Rule 62-297.310(2), F.A.C.]

A.3. Methods of Operation - Fuels. The only fuel to be burned in this unit is new (virgin) No. 2 fuel oil. The sulfur content shall not exceed 0.05 percent by weight.
[Rules 62-213.440(1), F.A.C.; AC44-221256/PSD-FL-135; and Acid Rain Program New Unit Exemptions.]

A.4. Hours of Operation. For both units combined, the hours of operation shall not exceed a combined total of 3,740 full load equivalent engine hours in any consecutive 12-month period.
[Rule 62-212.400(6), F.A.C.]

Emission Limitations and Standards

{Permitting Note: The attached Table 1-1, Summary of Air Pollutant Standards and Terms, summarizes information for convenience purposes only. This table does not supersede any of the terms or conditions of this permit.}

A.5. Oxides of Nitrogen. NO_x emissions shall not exceed any of the following limits:

- 160.9 pounds per hour from each engine;
- 6.0 grams per horsepower-hour from each engine;
- 300.9 tons in any consecutive 12-month period for the combined sum total from both engines.

[Rule 62-212.400(6), 62-212.400(1)(c), and 62-212.400(2)(d)4., F.A.C., and AC44-221256]

A.6. Sulfur Dioxide. SO₂ emissions shall not exceed either of the following limits:

- 43.6 pounds per hour from each engine;
- 81.6 tons in any consecutive 12-month period for the combined sum total from both engines.

[Rule 62-212.400(6), 62-212.400(1)(c), and 62-212.400(2)(d)4., F.A.C., and AC44-221256]

A.7. Particulate Matter. PM/PM₁₀ emissions shall not exceed any of the following limits:

- 8.5 pounds per hour from each engine;
- 0.1 million pound per million Btu heat input;
- 16.0 tons in any consecutive 12-month period for the combined sum total from both engines.

[Rule 62-212.400(6), 62-212.400(1)(c), and 62-212.400(2)(d)4., F.A.C., and AC44-221256]

A.8. Carbon Monoxide. CO emissions shall not exceed any of the following limits:

- 53.6 pounds per hour from each engine;
- 2.0 grams per horsepower-hour from each engine;

c. 100.3 tons in any consecutive 12-month period for the combined sum total from both engines.

[Rule 62-212.400(6), 62-212.400(1)(c), and 62-212.400(2)(d)4., F.A.C., and AC44-221256]

A.9. Volatile Organic Compounds. VOC emissions shall not exceed any of the following limits:

a. 26.8 pounds per hour from each engine;

b. 1.0 grams per horsepower-hour from each engine;

c. 50.1 tons in any consecutive 12-month period for the combined sum total from both engines.

[Rule 62-212.400(6), 62-212.400(1)(c), and 62-212.400(2)(d)4., F.A.C., and AC44-221256]

A.10. Beryllium (Be). Beryllium emissions shall not exceed 0.00054 pounds per hour from each engine and shall not exceed 2.0 pounds in any consecutive 12-month period for the combined sum total from both engines.

[Rule 62-212.400(6), 62-212.400(1)(c), and 62-212.400(2)(d)4., F.A.C., AC44-221256]

A.11. Objectionable Odor. The Permittee shall not discharge air pollutants which cause or contribute to an objectionable odor.

[Rule 62-296.320(1)(a)2, F.A.C., AC44-221256]

Excess Emissions

A.12. Excess emissions resulting from malfunction shall be permitted provided that best operational practices to minimize emissions are adhered to and the duration of excess emissions shall be minimized but in no case exceed two hours in any 24 hour period unless specifically authorized by the Department for longer duration.

[Rule 62-210.700(1), F.A.C.]

A.13. Excess emissions which are caused entirely or in part by poor maintenance, poor operation, or any other equipment or process failure which may reasonably be prevented during startup, shutdown or malfunction shall be prohibited.

[Rule 62-210.700(4), F.A.C.]

Monitoring Requirements

A.14. The Permittee shall calibrate, maintain, and operate continuous monitoring equipment, in accordance with the manufacturer's instructions, to continuously monitor

and record opacity and NOx emissions. The Permittee shall maintain a complete file of all measurements, including continuous emissions monitoring system, monitoring device, and performance testing measurements; all continuous emissions monitoring system performance evaluations, all continuous emissions monitoring system or monitoring device calibration checks; adjustments and maintenance performed on these systems or devices; and all other information required, recorded in an a permanent legible form suitable for inspection. The file shall be retained for at least two years following the date of such measurements, maintenance, reports, and records.

[Rule 62-4.070(3), F.A.C. and AC44-221256/PSD-FL-135]

Test Methods and Procedures

{Permitting Note: The attached Table 2-1, Summary of Compliance Requirements, summarizes information for convenience purposes only. This table does not supersede any terms or conditions of this permit. }

A.15. The Permittee shall conduct a compliance test for each diesel generator on an *annual basis* for the following pollutants. Each compliance test shall be conducted in accordance with 40 CFR 60, Appendix A, using the method indicated.

- a) Oxides of Nitrogen (NOx) - EPA Method 20.
- b) Carbon Monoxide (CO) - EPA Method 10.
- c) Beryllium (Be) - EPA Method 104.
- d) Particulate Matter (PM/PM₁₀) - EPA Method 5.

An annual compliance test for particulate matter emissions shall not be required for any fuel burning emissions unit that, in a federal fiscal year, does not burn liquid and/or solid fuel, other than during startup, for a total of more than 400 hours.

[Rule 62-297.310(7)(a)4. & 5., F.A.C., AC44-152197]

A.16. The Permittee shall conduct a compliance test for each of the following pollutants *prior to obtaining a renewed operation permit*. Emissions units that are required to conduct an annual compliance test may submit the most recent annual compliance test to satisfy this requirement. In renewing an air operation permit pursuant to Rule 62-210.300(2)(a)3.b., c., or d., F.A.C., the Department shall not require submission of compliance test results for any emissions unit that, during the year prior to renewal: a) did not operate; or b) in the case of a fuel burning emissions unit, burned liquid and/or solid fuel for a total of no more than 400 hours. Each compliance test shall be conducted in accordance with 40 CFR 60 Appendix A, using the method indicated.

- a) Sulfur Dioxide (SO₂) - EPA Method 6 or ASTM D 2880-71 for sulfur in oil.
- b) Particulate Matter (PM/PM₁₀) - EPA Method 5.
- c) Volatile Organic Compounds (VOC) - EPA Method 25.

[Rule 62-297.310(7)(a)3., F.A.C., AC44-152197]

A.17. By this permit, annual emissions compliance testing for visible emissions and particulate matter is not required for these emissions units while burning liquid fuel(s) for less than 400 hours per year.

[Rule 62-297.310(7)(a)4., F.A.C.]

{Permitting note: See also Subsection D.}

Reporting and Recordkeeping Requirements

A.18. In order to document compliance with the hours of operation limitation of specific condition A.4, the fuel oil consumption limit of specific condition A.1, and the annual NOx emission limit of specific condition A.5, the Permittee shall keep daily records of the hours of operation, the fuel oil consumption, and the NOx emissions. At a minimum, the records shall indicate:

- (a) the daily hours of operation for each individual diesel generator,
- (b) the daily hours of operation expressed as full load equivalent engine hours (both units combined);
- (c) the daily sum total fuel oil consumption in gallons for both units combined;
- (d) the daily sum total NOx emissions in pounds for both units combined;
- (e) a cumulative total hours of operation expressed as full load equivalent engine hours for the current month;
- (f) a cumulative sum total fuel oil consumed in gallons for the current month;
- (g) a cumulative sum total NOx emissions in tons for the current month;
- (h) a rolling cumulative total hours of operation expressed as full load equivalent engine hours for the previous 12 consecutive months;
- (i) a rolling cumulative sum total fuel oil consumed in gallons for the previous 12 months; and
- (j) a rolling cumulative sum total NOx emissions in tons for the previous 12 consecutive months.

[Rule 62-4.070(3), F.A.C. and AC44-221256/PSD-FL-135]

A.19. For each calendar quarter, the Permittee shall submit to the Department a written report of emissions in excess of the emission limiting standards as set forth in this permit. The report shall be postmarked by the 30th day following the end of each calendar quarter. The report shall include at least the following information:

1. The quarterly hours of operation for each individual diesel generator.
2. The magnitude of excess emissions, any conversion factors used, and the date and time of commencement and completion of each time period of excess emissions.
3. Specific identification of each period of excess emissions that occurs during startups, shutdowns, and malfunctions.
4. The date and time identifying each period during which the continuous monitoring system was inoperative except for zero and span checks, and the nature of the system repairs or adjustments.

5. When no excess emissions have occurred or the continuous monitoring systems have not been inoperative, repaired, or adjusted, such information shall be stated in the report.

[Rule 62-4.070(3), F.A.C. and AC44-221256/PSD-FL-135]

A.20. In order to document compliance with the hourly SO₂ emission limit of specific condition A.6 and the fuel sulfur limit of specific condition A.3, the Permittee shall keep records of the as-fired fuel sulfur content, in percent by weight. For each shipment of fuel oil, the sulfur content shall be based on either vendor provided analysis or other analysis using ASTM D2622-94, ASTM D4294-90 (95), ASTM D1552-95, ASTM D1266-91, or both ASTM D4057-88 and ASTM D129-95 (or the latest editions). The records shall be maintained for a minimum of five years and shall be made available to the Department upon request.

[Rule 62-4.070(3), F.A.C. and AC44-221256/PSD-FL-135]

Source Commitments

A.21. If the Permittee requests relaxation of any federally enforceable limits for these units, then the Department will determine whether the NSR requirements of Rule 62-212.400, F.A.C. shall apply, as though the construction permit AC44-221256 had not been issued.

[Rule 62-4.070(3), F.A.C. and AC44-221256/PSD-FL-135]

A.22. Best Available Control Technology (BACT) will be re-evaluated if the Permittee requests an increase in or exceeds the permitted hours of operation. Selective Catalytic Reduction for NO_x control will be required at a minimum for BACT if deemed technologically feasible. In no event shall the BACT control installation and compliance testing occur later than 30 months from the date that the Permittee requested to exceed the permitted hours of operation or actually exceeded the permitted hours of operation.

[Rule 62-4.070(3), F.A.C. and AC44-221256/PSD-FL-135]

A.23. The three existing 16.5 MW steam units at the Key West Plant shall not operate.

[AC44-221256/PSD-FL-135 and AC44-152197]

Subsection B. 23.5 MW Combustion Turbine

E.U. Brief Description

ID No.

007 23.5 MW Simple Cycle Combustion Turbine [CT-1]

Emissions unit 007 is a General Electric (GE) Frame 5 model PG5341 CT equipped with water injection for fuel oil firing. It has a rated capacity of 23.5 MW at ISO conditions. The GE CT has a heat input of 312 MMBtu per hour (at 59° F) while burning oil. The CT is fired with No. 2 fuel oil with a sulfur content not to exceed 0.05 % by weight. NOx emissions are controlled by a water injection system. The water to fuel ratio is continuously monitored. This turbine began operation January 1, 1996.

{Permitting notes: This emissions unit is regulated under Rule 62-210.300, F.A.C., Permits Required; NSPS - 40 CFR 60, Subpart GG, Standards of Performance for Stationary Gas Turbines, adopted and incorporated by reference in Rule 62-204.800(7)(b)38., F.A.C.; NSPS - 40 CFR 60 Subpart A; Rule 212.400, F.A.C., Prevention of Significant Deterioration; PSD-FL-210; and AC44-245399. The unit is not affected by the Acid Rain Program, since it meets the requirements of 40 CFR 72.7 by serving a generator with less than 25 MW.}

Essential Potential to Emit (PTE) Parameters

B.1. Permitted Capacity. The maximum heat input to the GE combustion turbine (CT) at an ambient temperature of 59° F shall not exceed 312 MMBtu/hr while firing fuel oil. Heat input may vary depending on ambient conditions and the CT's characteristics. The approved manufacturer's curves shall be used to establish heat input rates over a range of temperatures for the purpose of compliance determination.

[Rule 62-210.200, F.A.C., AC44-245399/PSD-FL-210]

B.2. Methods of Operation - Fuels. The only fuel to be burned in this unit is new No. 2 fuel oil. The sulfur content shall not exceed 0.050 percent by weight.

[Rules 62-4.160(2), 62-210.200, and 62-213.440(1), F.A.C., AC44-245399/PSD-FL-210]

B.3. Hours of Operation/Fuel Consumption. The maximum No. 2 fuel oil consumption allowed to be burned in the CT is 7.1 million gallons per year, which is equivalent to 2,888.5 hours per year at full-load; the CT may operate for more than this if operating at part-load.

[Rule 62-212.500(56), F.A.C., AC44-245399, PSD-FL-210]

Emission Limitations and Standards

{Permitting Note: The attached Table 1-1, Summary of Air Pollutant Standards and Terms, summarizes information for convenience purposes only. This table does not supersede any of the terms or conditions of this permit. }

Pursuant to Rule 62-212.410, F.A.C., BACT, the maximum allowable emissions from the CT, when firing No. 2 fuel oil at 15% O₂, shall not exceed:

B.4. Oxides of Nitrogen. NO_x emissions shall not exceed any of the following limits:

a. Nitrogen oxides emissions, expressed as NO_x, shall not exceed:

$$STD = 0.0075 (14.4)/Y + F$$

where:

STD = allowable NO_x emissions (percent by volume at 15 percent oxygen and on a dry basis).

Y = manufacturer's rated heat rate at manufacturer's rated load (kilojoules per watt hour) or, actual measured heat rate based on lower heating value of fuel as measured at actual peak load for the facility. The value of Y shall not exceed 14.4 kilojoules per watt hour.

F = NO_x emission allowance for fuel-bound nitrogen as defined in 40 CFR 60.332(a)(3).

F shall be defined according to the nitrogen content of the fuel as follows:

<u>Fuel-bound nitrogen (% by weight)</u>	<u>F (NO_x% by volume)</u>
N ≤ 0.015.....	0
0.015 < N ≤ 0.1.....	0.04(N)
0.1 < N ≤ 0.25.....	0.004 + 0.0067(N - 0.1)
N > 0.25.....	0.005

where:

N = the nitrogen content of the fuel (percent by weight);

b. 75 ppmvd, based on a 1-hour average at 15% O₂;

c. 96 lbs./hour, based on a 1-hour average at 15% O₂;

d. 138 TPY.

[AC44-245399/PSD-FL-210, 40 CFR 60.332]

B.5. Sulfur Dioxide. SO₂ emissions shall be controlled by limiting the sulfur content of the fuel to a maximum of 0.05 percent by weight.

[AC44-245399/PSD-FL-210, 40 CFR 60.333]

B.6. Particulate Matter/PM₁₀. PM/PM₁₀ emissions shall be limited to 18 lbs./hour, based on a 1-hour average; 43 TPY.

[AC44-245399, PSD-FL-210]

B.7. Carbon Monoxide. CO shall be limited to 20 PPM at 100% load, and 136 PPM at 50% load; 64 lbs. per hour, based on a 1-hour average; 152 TPY.
[AC44-245399/PSD-FL-210]

B.8. Visible Emissions. Visible emissions shall be limited to 20 percent opacity.
[AC44-245399/PSD-FL-210]

Excess Emissions
See Subsection E.

Monitoring Requirements
See Subsection E.

Test Methods & Procedures
See Subsection D. & E.

Reporting and Recordkeeping Requirements

B.9. Two copies of the results of the emission tests for the pollutants listed in conditions B.4. through B.7. shall be submitted within forty-five days of the last sampling run to the South District office in Ft. Myers. All reports shall be in a format consistent with and shall include the information in accordance with Rule 62-297.310 (8), F.A.C.
[Rule 62-297.310(8), F.A.C.]

Also, see Subsection E. for additional reporting and recordkeeping requirements.

Subsection C. 19.77 MW Combustion Turbines

E.U. Brief Description
ID No.

008	19.77 MW Simple Cycle Combustion Turbine [CT-2]
009	19.77 MW Simple Cycle Combustion Turbine [CT-3]

These emissions units are two refurbished General Electric Model MS-5001R 19.77 MW combustion turbines. CT-2 had a startup date of June 1, 1998, while CT-3 had a startup date of August 1, 1998.

{Permitting notes: These emissions units are regulated under Rule 62-210.300, F.A.C., Permits Required; NSPS - 40 CFR 60, Subparts A (General Provisions) and GG, (Standards of Performance for Stationary Gas Turbines), adopted and incorporated by reference in Rule 62-204.800(7)(b)38., F.A.C.; Rule 212.400, F.A.C., Prevention of Significant Deterioration; and AC0870003-003, issued January 8, 1998. The units are not affected by the Acid Rain Program, since they meet the requirements of 40 CFR 72.7 by serving a generator with less than 25 MW. }

General Provisions

Notification and Record Keeping

C.1. A notification of the date upon which demonstration of the continuous monitoring system performance commences in accordance with 40 CFR 60.13(c) shall be postmarked not less than 30 days prior to such date. The notification shall be sent to the Department's South District Office and Marathon Branch Office.
[40 CFR 60.7(a)(5)]

C.2. When it has been demonstrated that these units meet the emission limitations established in permit AC-0870003-003, a properly signed and sealed certification from the permittee's Professional Engineer shall be submitted to the offices listed in C.1. stating that 1) the construction of CT-2 and CT-3 was completed in accordance with permit AC-870003-003 and, 2) the units have been tested and are in compliance with the terms and conditions contained within permit AC-870003-003.
[Rules 62-212.400(7)(b) and 62-213.420(1)(a)5., F.A.C., AC-870003-003]

Performance Tests

C.3. Within 60 days after achieving the maximum production rate at which the emissions unit will be operated, but not later than 180 days after initial startup, the Permittee shall conduct performance test(s) and furnish the offices listed in C.1. a written report of the results of such performance test(s).
[40 CFR 60.8(a)] See Subsection E. for additional requirements.

Essential Potential to Emit (PTE) Parameters

C.4. Hours of Operation. Each emission unit is allowed to operate 4,000 hours per year. The combined operation of both units shall also be limited to 4,000 hours per year. [AC-870003-003].

C.5. Method of Operation - Fuels. Only No. 2 fuel oil can be fired in the combustion turbines. The maximum sulfur content of the No. 2 fuel oil shall not exceed 0.05 percent, by weight. [AC-870003-003]

C.6. Permitted Capacity. The maximum heat input rate to each combustion turbine shall not exceed 305 million Btu per hour (MMBtu/hr). [AC-870003-003]

C.7. Fuel Consumption. The maximum No. 2 fuel oil consumption allowed to be burned in either emission unit No. 008 or emission unit No. 009 is 8,840,000 gallons per year, which is equivalent to 4,000 hours per year of operation at full load. The combined fuel oil consumption for both units shall be limited to 8,840,000 gallons per year. [AC-870003-003]

Emission Limitations and Standards

Note: The emission limits of LB/hr apply to each unit, while the TPY limit apply to each unit individually and both units collectively.

C.8. Oxides of Nitrogen. For each turbine, NO_x emissions shall not exceed any of the following limits:

a. Nitrogen oxides emissions, expressed as NO_x, shall not exceed:

$$\text{STD} = 0.0075(14.4)/Y + F$$

where:

STD = allowable NO_x emissions (percent by volume at 15 percent oxygen and on a dry basis).

Y = manufacturer's rated heat rate at manufacturer's rated load (kilojoules per watt hour) or, actual measured heat rate based on lower heating value of fuel as measured at actual peak load for the facility. The value of Y shall not exceed 14.4 kilojoules per watt hour.

F = NO_x emission allowance for fuel-bound nitrogen as defined in 40 CFR 60.332(a)(3).

F shall be defined according to the nitrogen content of the fuel as follows:

Fuel-bound nitrogen (% by weight)	F (NO _x % by volume)
N ≤ 0.015.....	0
0.015 < N ≤ 0.1.....	0.04(N)
0.1 < N ≤ 0.25.....	0.004 + 0.0067(N - 0.1)
N > 0.25.....	0.005

where: N = the nitrogen content of the fuel (percent by weight);

b. 75 ppmvd, based on a 1-hour average at 15% O₂; and

c. 93.8 lb./hour, based on a 1-hour average at 15% O₂; and 40 degrees F from each turbine.

d. 172 TPY, based on an average hourly concentration of 86 pounds per hour at 85 degrees F ambient temperature from both turbines combined.

e. no more than 4,000 hours per year of operation, from either or both turbines combined.

[40 CFR 60.332, AC-870003-003]

C.9. Sulfur Dioxide. For each turbine, SO₂ emissions shall be controlled by limiting the sulfur content of the fuel to a maximum of 0.05 percent by weight.

[40 CFR 60.333, AC-870003-003]

C.10. Particulate Matter/PM₁₀. For each turbine, PM/PM₁₀ emissions shall be limited to 16.6 lb./hour, based on a 1-hour average; PM and PM₁₀ from both turbines combined shall be limited to 55 TPY and 45 TPY, respectively.

[AC-870003-003]

C.11. Carbon Monoxide. For each turbine, CO shall be limited to 25.2 lb./hour, based on a 1-hour average; and from both turbines combined, 101 TPY.

[AC-870003-003]

C.12. Visible Emissions. Visible emissions shall be limited to 20 percent opacity.

[AC-870003-003]

Excess Emissions

See Subsection E.

Monitoring Requirements

See Subsection E.

Test Methods & Procedures

See Subsections D. & E.

Reporting and Recordkeeping Requirements

C.13. Two copies of the results of the emission tests for the pollutants listed in conditions C.8. through C.11. shall be submitted within forty-five days of the last sampling run to the South District office in Ft. Myers. All reports shall be in a format consistent with and shall include the information in accordance with Rule 62-297.310 (8), F.A.C.

[Rule 62-297.310(8), F.A.C.]

Also, see Subsection E. for additional recordkeeping and reporting requirements.

Subsection D. Common Conditions I

The following conditions apply to all emissions units listed in Section III, Subsections A., B., and C., of this permit.

Test Methods & Procedures

D.1. Required Number of Test Runs. For mass emission limitations, a compliance test shall consist of three complete and separate determinations of the total air pollutant emission rate through the test section of the stack or duct and three complete and separate determinations of any applicable process variables corresponding to the three distinct time periods during which the stack emission rate was measured provided, however, that three complete and separate determinations shall not be required if the process variables are not subject to variation during a compliance test, or if three determinations are not necessary in order to calculate the unit's emission rate. The three required test runs shall be completed within one consecutive five day period. In the event that a sample is lost or one of the three runs must be discontinued because of circumstances beyond the control of the owner or operator, and a valid third run cannot be obtained within the five day period allowed for the test, the Secretary or his or her designee may accept the results of the two complete runs as proof of compliance, provided that the arithmetic mean of the results of the two complete runs is at least 20 percent below the allowable emission limiting standards.

[Rule 62-297.310(1), F.A.C.]

D.2. Calculation of Emission Rate. The indicated emission rate or concentration shall be the arithmetic average of the emission rate or concentration determined by each of the separate test runs unless otherwise specified in a particular test method or applicable rule.

[Rule 62-297.310(3), F.A.C.]

D.3. Applicable Test Procedures.

(a) Required Sampling Time.

1. Unless otherwise specified in the applicable rule, the required sampling time for each test run shall be no less than one hour and no greater than four hours, and the sampling time at each sampling point shall be of equal intervals of at least two minutes.

2. **Opacity Compliance Tests.** When either EPA Method 9 or DEP Method 9 is specified as the applicable opacity test method, the required minimum period of observation for a compliance test shall be sixty (60) minutes for emissions units which emit or have the potential to emit 100 tons per year or more of particulate matter, and thirty (30) minutes for emissions units which have potential emissions less than 100 tons per year of particulate matter and are not subject to a multiple-valued opacity standard. The opacity test observation period shall include the period during which the highest opacity emissions can reasonably be expected to occur.

Exceptions to these requirements are as follows:

- a. (not applicable)
- b. (not applicable)
- c. The minimum observation period for opacity tests conducted by employees or agents of the Department to verify the day-to-day continuing compliance of a unit or activity with an applicable opacity standard shall be twelve minutes.

(b) Minimum Sample Volume. Unless otherwise specified in the applicable rule, the minimum sample volume per run shall be 25 dry standard cubic feet.

(c) Required Flow Rate Range. For EPA Method 5 particulate sampling, acid mist/sulfur dioxide, and fluoride sampling which uses Greenburg Smith type impingers, the sampling nozzle and sampling time shall be selected such that the average sampling rate will be between 0.5 and 1.0 actual cubic feet per minute, and the required minimum sampling volume will be obtained.

(d) Calibration of Sampling Equipment. Calibration of the sampling train equipment shall be conducted in accordance with the schedule shown in Table 297.310-1. (See attachment.)

(e) Allowed Modification to EPA Method 5. When EPA Method 5 is required, the following modification is allowed: the heated filter may be separated from the impingers by a flexible tube.

[Rule 62-297.310(4), F.A.C.]

D.4. Special Compliance Tests. When the Department, after investigation, has good reason (such as complaints, increased visible emissions or questionable maintenance of control equipment) to believe that any applicable emission standard contained in a Department rule or in a permit issued pursuant to those rules is being violated, it shall require the owner or operator of the emissions unit to conduct compliance tests which identify the nature and quantity of pollutant emissions from the emissions unit and to provide a report on the results of said tests to the Department.

[Rule 62-297.310(7)(b), F.A.C., SIP approved]

D.5. Waiver of Compliance Test Requirements. If the owner or operator of an emissions unit that is subject to a compliance test requirement demonstrates to the Department, pursuant to the procedure established in Rule 62-297.620, F.A.C., that the compliance of the emissions unit with an applicable weight emission limiting standard can be adequately determined by means other than the designated test procedure, such as specifying a surrogate standard of no visible emissions for particulate matter sources equipped with a bag house or specifying a fuel analysis for sulfur dioxide emissions, the Department shall waive the compliance test requirements for such emissions units and order that the alternate means of determining compliance be used, provided, however, the provisions of Rule 62-297.310(7)(b), F.A.C., shall apply.

[Rule 62-297.310(7)(c), F.A.C., SIP approved]

Subsection E. Common Conditions II

The following conditions apply only to the Combustion Turbines listed in listed in Section III, Subsections B. and C. of this permit.

Excess Emissions

E.1. Excess emissions from the CT resulting from start-up, shutdown, malfunction, or load change shall be acceptable providing (1) best operational practices to minimize emissions are adhered to and (2) the duration of excess emissions shall be minimized, but in no case exceed two hours in any 24-hour period unless specifically authorized by the Department for a longer duration.

[AC44-245399/PSD-FL-210, 0870003-003-AC]

E.2. Excess Emissions Defined. For the purpose of reports required under 40 CFR 60.7(c) (see specific condition C.24.), periods of excess emissions that shall be reported are defined as follows:

a. *Nitrogen oxides.* Any one-hour period during which the average water-to-fuel ratio, as measured by the continuous monitoring system, falls below the water-to-fuel ratio determined to demonstrate compliance with 40 CFR 60.332 by the performance test required in 40 CFR 60.8 or any period during which the fuel-bound nitrogen of the fuel is greater than the maximum nitrogen content allowed by the fuel-bound nitrogen allowance used during the performance test required in 40 CFR 60.8. Each report shall include the average water-to-fuel ratio, average fuel consumption, ambient conditions, gas turbine load, and nitrogen content of the fuel during the period of excess emissions, and the graphs or figures developed under 40 CFR 60.335(a).

b. *Sulfur dioxide.* Any daily period during which the sulfur content of the fuel being fired in the gas turbine exceeds 0.05 percent.

[40 CFR 60.334(c)(1)&(c)(2), 0870003-003-AC]

Monitoring Requirements

E.3. CMS Requirements. The Permittee shall install, operate, and maintain a continuous monitoring system (CMS) to monitor and record the fuel consumption, the ratio of water to fuel being fired in the turbine, and the electrical output in MW. The system shall be accurate to within ± 5.0 percent and shall be approved by the Department. Quarterly calibrations shall be performed on the CMS.

[40 CFR 60.334(a); AC44-245399/PSD-FL-210, 0870003-003-AC]

E.4. Critical Fuel Parameters. The Permittee shall monitor sulfur content, nitrogen content, and the lower heating value of the fuel being fired in the turbine. The frequency of determination of these values shall be as follows:

a. If the turbine is supplied its fuel from a bulk storage tank, the values shall be determined on each occasion that fuel is transferred to the storage tank from any other source.

b. If the turbine is supplied its fuel without intermediate bulk storage, the values shall be determined and recorded daily. Owners, operators or fuel vendors may develop custom schedules for determination of the values based on the design and operation of the affected facility and the characteristics of the fuel supply. These custom schedules shall be substantiated with data and must be approved by the Bureau of Air Regulation before they can be used to comply with 40 CFR 60.334(b).

[AC44-245399/PSD-FL-210, 40 CFR 60.334(b)(1)&(b)(2), 0870003-003-AC]

Test Methods & Procedures

E.5 Testing of emissions shall be conducted with the source operating at capacity. Capacity is defined as 95 to 100 percent of the manufacturer's rated heat input achievable for the average ambient (or conditioned) air temperature during the test. If it is impracticable to test at capacity, then sources may be tested at less than capacity. In such cases, the entire heat input versus inlet temperature curve will be adjusted by the increment equal to the difference between the design heat input value and 105 percent of the value reached during the test. Data, curves, and calculations necessary to demonstrate the heat input rate correction at both design and test conditions shall be submitted to the Department with the compliance test report.

To demonstrate compliance with federal new source performance standard Subpart GG - Standards of performance Stationary Gas Turbines, the initial test shall be conducted at four load points and corrected to ISO conditions for comparison to the NSPS allowable. *Subsequent annual compliance tests conducted to establish compliance with NOx limits that are more stringent than the NSPS standard shall not require an ISO correction or testing at four load points; rather, the testing shall be done at capacity, as defined above.* However, when testing shows that NOx emissions exceed the standard when operating at capacity, the company shall recalibrate the NOx emission control system using emission testing at four loads as required in Subpart GG.

[Rule 62-4.070(3), F.A.C.]

E.6. Performance tests shall be conducted and data reduced in accordance with the test methods and procedures contained in each applicable subpart unless the Department (1) specifies or approves, in specific cases, the use of a reference method with minor changes in methodology, (2) waives the requirement for performance tests because the owner or operator of a source has demonstrated by other means to the Department's satisfaction that the affected facility is in compliance with the standard, or (3) approves shorter sampling times and smaller sample volumes when necessitated by process variables or

other factors. Nothing in 40 CFR 60.8 shall be construed to abrogate the Department's authority to require testing under section 114 of the Act.

[40 CFR 60.8(b)(1), (4) & (5)]

E.7. Performance tests shall be conducted under such conditions as the Department shall specify to the plant operator based on representative performance of the affected facility. The owner or operator shall make available to the Department such records as may be necessary to determine the conditions of the performance tests. Operations during periods of startup, shutdown, and malfunction shall not constitute representative conditions for the purpose of a performance test nor shall emissions in excess of the level of the applicable emission limit during periods of startup, shutdown, and malfunction be considered a violation of the applicable emission limit unless otherwise specified in the applicable standard.

[40 CFR 60.8(c)].

E.8. The Utility Board of the City of Key West shall provide, or cause to be provided, performance testing facilities as follows:

1. Sampling ports adequate for test methods applicable to such facility. This includes (a) constructing the air pollution control system such that volumetric flow rates and pollutant emission rates can be accurately determined by applicable test methods and procedures and (b) providing a stack or duct free of cyclonic flow during performance tests, as demonstrated by applicable test methods and procedures.

2. Safe sampling platform(s).

3. Safe access to sampling platform(s).

4. Utilities for sampling and testing equipment.

[40 CFR 60.8(e)]

E.9. Each performance test shall consist of three separate runs using the applicable test method. Each run shall be conducted for the time and under the conditions specified in the applicable standard. For the purpose of determining compliance with an applicable standard, the arithmetic means of results of the three runs shall apply. In the event that a sample is accidentally lost or conditions occur in which one of the three runs must be discontinued because of forced shutdown, failure of an irreplaceable portion of the sample train, extreme meteorological conditions, or other circumstances, beyond the owner or operator's control, compliance may, upon the Department's approval, be determined using the arithmetic mean of the results of the two other runs.

[40 CFR 60.8(f)].

E.10. Compliance tests shall be performed on the CT while firing oil. Testing of emissions shall be conducted at 95-100% of the manufacturer's rated heat input based on the average ambient air temperature during the test.

Annual compliance tests shall be performed on the CT if the No. 2 fuel was used for more than 400 hours in the preceding 12-month period. Tests shall be conducted using EPA reference methods in accordance with 40 CFR 60, Appendix A, as adopted by reference in Chapter 62-297, F.A.C.:

- a. Reference Method 5B for PM.
- b. Reference Method 9 for VE.
- c. Reference Method 10 for CO.
- d. Reference Method 20 for NO_x.
- e. Other methods may be used for compliance testing after obtaining prior Departmental approval, in writing.

[Rule 62-297.310(7)(a)(4), F.A.C., AC44-2445399, 0870003-003-AC]

E.11. Sulfur Content. The Permittee shall determine compliance with the sulfur content standard in 40 CFR 60.333(b) as follows: ASTM D 2880-96, or more recent version, shall be used to determine the sulfur content of liquid fuels and ASTM D 1072-90(94)E-1, D 3031-81(86), D 4084-94, or D 3246-92, or more recent versions, shall be used for the sulfur content of gaseous fuels (incorporated by reference-see 40 CFR 60.17). The applicable ranges of some ASTM methods mentioned above are not adequate to measure the levels of sulfur in some fuel gases. Dilution of samples before analysis (with verification of the dilution ratio) may be used, subject to the approval of the Department.
[40 CFR 60.335(d)]

E.12. To compute the nitrogen oxides emissions, the Permittee shall use analytical methods and procedures that are accurate to within +-5 percent and are approved by the Department to determine the nitrogen content of the fuel being fired.
[40 CFR 60.335(a)]

E.13. The NO_x emission rate shall be computed for each run using the following equation:

$$NO_x = (NO_{xO}) (P_r/P_o)^{0.5} e^{19(H_o-0.00633)} (288^\circ K/T_a)^{1.53}$$

where:

NO_x = emission rate of NO_x at 15 percent O₂ and ISO standard ambient conditions, volume percent.

NO_{xO} = observed NO_x concentration, PPM by volume.

P_r = reference combustor inlet absolute pressure at 101.3 kilopascals ambient pressure, mm Hg.

P_o = observed combustor inlet absolute pressure at test, mm Hg.

H_o = observed humidity of ambient air, g H₂O/g air.

e = transcendental constant, 2.718.

T_a = ambient temperature, °K. [40 CFR 60.335(c)(1)]

E.14. The owner or operator may use the following as an alternative to the reference methods and procedures specified in 40 CFR 60.335:

Instead of using the equation in paragraph 40 CFR 60.335(c)(1), manufacturers may develop ambient condition correction factors to adjust the nitrogen oxides emission level measured by the performance test as provided in 40 CFR 60.8 to ISO standard day conditions. These factors are developed for each gas turbine model they manufacture in terms of combustion inlet pressure, ambient air pressure, ambient air humidity, and ambient air temperature. They shall be substantiated with data and must be approved for use by the Department before the initial performance test required by 40 CFR 60.8. Notices of approval of custom ambient condition correction factors will be published in the Federal Register.

[40 CFR 60.335(f)(1)]

E.15. The monitoring device of 40 CFR 60.334(a) shall be used to determine the fuel consumption and the water-to-fuel ratio necessary to comply with 40 CFR 60.332 at 30, 50, 75, and 100 percent of peak load or at four points in the normal operating range of the gas turbine, including the minimum point in the range and peak load. All loads shall be corrected to ISO conditions using the appropriate equations supplied by the manufacturer.

[40 CFR 60.335(c)(2)]

E.16. Compliance with the allowable emission limiting standards given in Subsections B. and C. shall be determined by using EPA Reference Method 20 as described in 40 CFR 60, Appendix A (1996, version) adopted by reference in Rule 62-204.800, F.A.C. The span values shall be 300 PPM of nitrogen oxide and 21 percent oxygen. The NO_x emissions shall be determined at 30, 50, 75, and 100 percent of peak load or at four points in the normal operating range of the gas turbine, including the minimum point in the range and peak load. An annual compliance test shall be performed on the unit if operated for more than 400 hours in the preceding 12-month period.

[Rule 62-297.310, F.A.C. and 40 CFR 60.335(c)(3)]

E.17. In conducting the performance tests required in 40 CFR 60.8, the owner or operator shall use as reference methods and procedures the test methods in appendix A of 40 CFR 60 or other methods and procedures as specified in this permit, except as provided for in 40 CFR 60.8(b). Acceptable alternative methods and procedures are given in paragraph 40 CFR 60.335(f).

[40 CFR 60.335(b)]

E.18. (a) For the purposes of this section, all continuous monitoring systems required under applicable subparts shall be subject to the provisions of this section upon promulgation of performance specifications for continuous monitoring systems under appendix B of 40 CFR 60 and, if the continuous monitoring system is used to demonstrate

compliance with emission limits on a continuous basis, appendix F to 40 CFR 60, unless otherwise specified in an applicable subpart or by the Department. Appendix F is applicable December 4, 1987.

(b) All continuous monitoring systems and monitoring devices shall be installed and operational prior to conducting performance tests under 40 CFR 60.8. Verification of operational status shall, as a minimum, include completion of the manufacturer's written requirements or recommendations for installation, operation, and calibration of the device.

(c) If the owner or operator of an affected facility elects to submit continuous opacity monitoring system (COMS) data for compliance with the opacity standard as provided under 40 CFR 60.11(e)(5), he/she shall conduct a performance evaluation of the COMS as specified in Performance Specification 1, appendix B, of 40 CFR 60 before the performance test required under 40 CFR 60.8 is conducted. Otherwise, the owner or operator of an affected facility shall conduct a performance evaluation of the COMS or continuous emission monitoring system (CEMS) during any performance test required under 40 CFR 60.8 or within 30 days thereafter in accordance with the applicable performance specification in appendix B of 40 CFR 60. The owner or operator of an affected facility shall conduct COMS or CEMS performance evaluations at such other times as may be required by the Department under section 114 of the Act.

(1) The owner or operator of an affected facility using a COMS to determine opacity compliance during any performance test required under 40 CFR 60.8 and as described in 40 CFR 60.11(e)(5), shall furnish the Department two or, upon request, more copies of a written report of the results of the COMS performance evaluation described in 40 CFR 60.13(c) at least 10 days before the performance test required under 40 CFR 60.8 is conducted.

(2) Except as provided in 40 CFR 60.13(c)(1), the owner or operator of an affected facility shall furnish the Department within 60 days of completion two or, upon request, more copies of a written report of the results of the performance evaluation.

(d)(1) Permittee's of all continuous emission monitoring systems installed in accordance with the provisions of 40 CFR 60 shall check the zero (or low-level value between 0 and 20 percent of span value) and span (50 to 100 percent of span value) calibration drifts at least once daily in accordance with a written procedure. The zero and span shall, as a minimum, be adjusted whenever the 24-hour zero drift or 24-hour span drift exceeds two times the limits of the applicable performance specifications in appendix B. The system must allow the amount of excess zero and span drift measured at the 24-hour interval checks to be recorded and quantified, whenever specified. For continuous monitoring systems measuring opacity of emissions, the optical surfaces exposed to the effluent gases shall be cleaned prior to performing the zero and span drift adjustments except that for systems using automatic zero adjustments. The optical surfaces shall be cleaned when the cumulative automatic zero compensation exceeds 4 percent opacity.

(3) Unless otherwise approved by the Department, the following procedures shall be followed for continuous monitoring systems measuring opacity of emissions. Minimum

procedures shall include a method for producing a simulated zero opacity condition and upscale (span) opacity condition using a certified neutral density filter or other related technique to produce a known obscuration of the light beam. Such procedures shall provide a system check of the analyzer internal optical surfaces and all electronic circuitry including the lamp and photo detector assembly.

(e) Except for system breakdowns, repairs, calibration checks, and zero and span adjustments required under 40 CFR 60.13(d), all continuous monitoring systems shall be in continuous operation and shall meet minimum frequency of operation requirements as follows:

(1) All continuous monitoring systems referenced by 40 CFR 60.13(c) for measuring opacity of emissions shall complete a minimum of one cycle of sampling and analyzing for each successive 10-second period and one cycle of data recording for each successive 6-minute period.

(2) All continuous monitoring systems referenced by 40 CFR 60.13(c) for measuring emissions, except opacity, shall complete a minimum of one cycle of operation (sampling, analyzing, and data recording) for each successive 15-minute period.

(f) All continuous monitoring systems or monitoring devices shall be installed such that representative measurements of emissions or process parameters from the affected facility are obtained. Additional procedures for location of continuous monitoring systems contained in the applicable Performance Specifications of appendix B of 40 CFR 60 shall be used.

(g) When the effluents from a single affected facility or two or more affected facilities subject to the same emission standards are combined before being released to the atmosphere, the owner or operator may install applicable continuous monitoring systems on each effluent or on the combined effluent. When the affected facilities are not subject to the same emission standards, separate continuous monitoring systems shall be installed on each effluent. When the effluent from one affected facility is released to the atmosphere through more than one point, the owner or operator shall install an applicable continuous monitoring system on each separate effluent unless the installation of fewer systems is approved by the Department. When more than one continuous monitoring system is used to measure the emissions from one affected facility (e.g., multiple breechings, multiple outlets), the owner or operator shall report the results as required from each continuous monitoring system.

(h) Owners or operators of all continuous monitoring systems for measurement of opacity shall reduce all data to 6-minute averages and for continuous monitoring systems other than opacity to 1-hour averages for time periods as defined in 40 CFR 60.2. Six-minute opacity averages shall be calculated from 36 or more data points equally spaced over each 6-minute period. For continuous monitoring systems other than opacity, 1-hour averages shall be computed from four or more data points equally spaced over each 1-hour period. Data recorder during periods of continuous monitoring system breakdowns, repairs, calibration checks, and zero and span adjustments shall not be included in the data averages computed under this paragraph. An arithmetic or integrated average of all data

may be used. The data may be recorded in reduced or non reduced form (e.g., PPM pollutant and percent O₂ or ng/J of pollutant). All excess emissions shall be converted into units of the standard using the applicable conversion procedures specified in subparts. After conversion into units of the standard, the data may be rounded to the same number of significant digits as used in the applicable subparts to specify the emission limit (e.g., rounded to the nearest 1 percent opacity).

[Rule 62-296.800, F.A.C.; 40 CFR 60.13(a)-(h)].

E.19. After receipt and consideration of written application, the Department may approve alternatives to any monitoring procedures or requirements of 40 CFR 60 including, but not limited to the following:

(1) Alternative monitoring requirements when installation of a continuous monitoring system or monitoring device specified by 40 CFR 60 would not provide accurate measurements due to liquid water or other interferences caused by substances with the effluent gases.

(2) Alternative monitoring requirements when the affected facility is infrequently operated.

(3) Alternative monitoring requirements to accommodate continuous monitoring systems that require additional measurements to correct for stack moisture conditions.

(4) Alternative locations for installing continuous monitoring systems or monitoring devices when the owner or operator can demonstrate that installation at alternate locations will enable accurate and representative measurements.

(5) Alternative methods of converting pollutant concentration measurements to units of the standards.

(6) Alternative procedures for performing daily checks of zero and span drift that do not involve use of span gases or test cells.

(7) Alternatives to the ASTM test methods or sampling procedures specified by any subpart.

(8) Alternative continuous monitoring systems that do not meet the design or performance requirements in Performance Specification 1, appendix B, but adequately demonstrate a definite and consistent relationship between its measurements and the measurements of opacity by a system complying with the requirements in Performance Specification 1. The Department may require that such demonstration be performed for each affected facility.

(9) Alternative monitoring requirements when the effluent from a single affected facility or the combined effluent from two or more affected facilities are released to the atmosphere through more than one point.

[Rule 62-296.800, F.A.C.; 40 CFR 60.13(i)].

Reporting and Recordkeeping Requirements

E.20. To determine compliance with the fuel oil firing heat input limitation, the Permittee shall maintain daily records of fuel oil consumption for the turbine and the heating value for the fuel. All records shall be maintained for a minimum of five years after the date of each record and shall be made available to representatives of the Department upon request.

[Rule 62-4.070(3)]

E.21. Excess Emissions Report. The Permittee shall record the occurrence and duration of any startup, shutdown, or malfunctions of the turbine and any malfunction of the air pollution control equipment or CMS. Additionally, the Permittee shall notify the Department in accordance with Rule 62-4.130, F.A.C. A full written report on the malfunctions shall be submitted in a quarterly report, if requested by the Department.

[Rule 62-210.700(6), F.A.C., and 40 CFR 60.7(b)]

E.22. Quarterly Report. The Permittee shall submit a quarterly excess emissions and monitoring systems performance report. All reports shall be postmarked by the 30th day following the end of each calendar half (or quarter, as appropriate). Written reports of excess emissions shall include the following information:

1. The magnitude of excess emissions computed in accordance with 40 CFR 60.13(h), any conversion factor(s) used, and the date and time of commencement and completion of each time period of excess emissions. The process operating time during the reporting period.

2. Specific identification of each period of excess emissions that occurs during startups, shutdowns and malfunctions of the affected facility. The nature and cause of any malfunction (if known), the corrective action taken or preventative measures adopted.

3. The date and time identifying each period during which the continuous monitoring system was inoperative except for zero and span checks and the nature of the system repairs or adjustments.

4. When no excess emissions have occurred or the continuous monitoring system(s) have not been inoperative, repaired, or adjusted, such information shall be stated in the report.

[40 CFR 60.7(c)]

E.23. Summary Report. The summary report form shall contain the information and be in the format shown in Figure 1 (attached) unless otherwise specified by the Department. One summary report form shall be submitted for each pollutant monitored.

1. If the total duration of excess emissions for the reporting period is less than one percent of the operating time for the reporting period and CMS downtime for the reporting period is less than five percent of the total operating time for the reporting

period, only the summary report form shall be submitted and the excess emission report described in 40 CFR 60.7(c) need not be submitted unless requested by the Department.

2. If the total duration of excess emissions for the reporting period is one percent or greater of the total operating time for the reporting period or the total CMS downtime for the reporting period is five percent or greater of the total operating time for the reporting period, the summary report form and the excess emission report described in 40 CFR 60.7(c) shall both be submitted.

[40 CFR 60.7(d)]

E.24. Reporting Frequency. (1) Notwithstanding the frequency of reporting requirements specified in 40 CFR 60.7(c), an owner or operator who is required by an applicable subpart to submit excess emissions and monitoring systems performance reports (and summary reports) on a quarterly (or more frequent) basis may reduce the frequency of reporting for that standard to semiannual if the following conditions are met:

(i) For 1 full year (e.g., 4 quarterly or 12 monthly reporting periods) the affected facility's excess emissions and monitoring systems reports submitted to comply with a standard under 40 CFR 60 continually demonstrate that the facility is in compliance with the applicable standard;

(ii) The owner or operator continues to comply with all recordkeeping and monitoring requirements specified in 40 CFR 60, Subpart A, and the applicable standard; and

(iii) The Department does not object to a reduced frequency of reporting for the affected facility, as provided in 40 CFR 60.7(e)(2).

(2) The frequency of reporting of excess emissions and monitoring systems performance (and summary) reports may be reduced only after the owner or operator notifies the Department in writing of his or her intention to make such a change and the Department does not object to the intended change. In deciding whether to approve a reduced frequency of reporting, the Department may review information concerning the source's entire previous performance history during the required recordkeeping period prior to the intended change, including performance test results, monitoring data, and evaluations of an owner or operator's conformance with operation and maintenance requirements. Such information may be used by the Department to make a judgment about the source's potential for noncompliance in the future. If the Department disapproves the Permittee's request to reduce the frequency of reporting, the Department will notify the Permittee in writing within 45 days after receiving notice of the owner or operator's intention. The notification from the Department to the Permittee will specify the grounds on which the disapproval is based. In the absence of a notice of disapproval within 45 days, approval is automatically granted.

(3) As soon as monitoring data indicate that the affected facility is not in compliance with any emission limitation or operating parameter specified in the applicable standard, the frequency of reporting shall revert to the frequency specified in the applicable standard, and the Permittee shall submit an excess emissions and monitoring systems performance report (and summary report, if required) at the next appropriate reporting

period following the noncomplying event. After demonstrating compliance with the applicable standard for another full year, the Permittee may again request approval from the Department to reduce the frequency of reporting for that standard as provided for in 40 CFR 60.7(e)(1) and (e)(2).
[40 CFR 60.7(e)]

E.25. Records Retention. The Permittee shall maintain a file of all measurements, including continuous monitoring system, monitoring device, and performance testing measurements; all continuous monitoring system performance evaluations; all continuous monitoring system or monitoring device calibration checks; adjustments and maintenance performed on these systems or devices; and, all other information required by 40 CFR 60 recorded in a permanent form suitable for inspection. The file shall be retained for at least **5 (five)** years following the date of such measurements, maintenance, reports, and records.
[40 CFR 60.7(f); Rule 62-213.440(1)(b)2.b., F.A.C.]

Additional General Provisions - 40 CFR 60 Subpart A

E.26. Department Notification.

(a) The Permittee shall provide to the Department's South District office at least 15 days prior notice of any compliance or performance test, except as specified under other subparts, to afford the District office the opportunity to have an observer present. Test results shall be submitted to the District office no later than 45 days after completion of the test.

(b) The Permittee shall give written notification to the Department when there is any modification to this facility. This notice shall be submitted timely and in advance of any critical date involved to allow sufficient time for review, discussion, and revision of plans, if necessary. Such notice shall include, but not be limited to, information describing the precise nature of the change; modifications to any emission control system; production capacity of the facility before and after the change; and, the anticipated completion date of the change.

[40 CFR 60.8(d) and Rule 62-297.310(7)(a)8., F.A.C.]

Compliance with Standards and Maintenance Requirements

E.27. Compliance with opacity standards in 40 CFR 60 shall be determined by conducting observations in accordance with Reference Method 9 in appendix A of 40 CFR 60, any alternative method that is approved by the Department, or as provided in 40 CFR 60.11(e)(5). For purposes of determining initial compliance, the minimum total time of observations shall be 3 hours (30 6-minute averages) for the performance test or other set of observations (meaning those fugitive-type emission sources subject only to an opacity standard).

[40 CFR 60.11(b)].

E.28. The Permittee shall follow the manufacturer's instructions during periods of start-up, shutdown, malfunction, or load change to ensure that the best operational practices to minimize emissions will be adhered to and the duration of any excess emissions will be minimized. The instructions shall be kept on file at the plant site and made available for inspection upon request by the Department.

[40 CFR 60.11(d)]

E.29. Credible Evidence. For the purpose of submitting compliance certifications or establishing whether or not a person has violated or is in violation of any standard in 40 CFR 60, nothing in 40 CFR 60 shall preclude the use, including the exclusive use, of any credible evidence or information, relevant to whether a source would have been in compliance with applicable requirements if the appropriate performance or compliance test or procedure had been performed.

[40 CFR 60.11(g)].

E.30. Circumvention. No owner or operator subject to the provisions of 40 CFR 60 shall build, erect, install, or use any article, machine, equipment or process, the use of which conceals an emission which would otherwise constitute a violation of an applicable standard. Such concealment includes, but is not limited to, the use of gaseous diluents to achieve compliance with an opacity standard or with a standard which is based on the concentration of a pollutant in the gases discharged to the atmosphere.

[40 CFR 60.12]

Monitoring Requirements

E.31. An alternative to the relative accuracy test specified in Performance Specification 2 of 40 CFR 60 Appendix B, may be requested as follows:

(1) An alternative to the reference method tests for determining relative accuracy is available for sources with emission rates demonstrated to be less than 50 percent of the applicable standard. A source owner or operator may petition the Department to waive the relative accuracy test in section 7 of Performance Specification 2 and substitute the procedures in section 10 if the results of a performance test conducted according to the requirements in 40 CFR 60.8 of this subpart or other tests performed following the criteria in 40 CFR 60.8 demonstrate that the emission rate of the pollutant of interest in the units of the applicable standard is less than 50 percent of the applicable standard. For sources subject to standards expressed as control efficiency levels, a source owner or operator may petition the Department to waive the relative accuracy test and substitute the procedures in section 10 of Performance Specification 2 if the control device exhaust emission rate is less than 50 percent of the level needed to meet the control efficiency requirement. The alternative procedures do not apply if the continuous emission monitoring system is used to determine compliance continuously with the applicable standard. The petition to waive the relative accuracy test shall include a detailed

description of the procedures to be applied. Included shall be location and procedure for conducting the alternative, the concentration or response levels of the alternative RA materials, and the other equipment checks included in the alternative procedure. The Department will review the petition for completeness and applicability. The determination to grant a waiver will depend on the intended use of the CEMS data (e.g., data collection purposes other than NSPS) and may require specifications more stringent than in Performance Specification 2 (e.g., the applicable emission limit is more stringent than NSPS).

(2) The waiver of a CEMS relative accuracy test will be reviewed and may be rescinded at such time following successful completion of the alternative RA procedure that the CEMS data indicate the source emissions approaching the level of the applicable standard. The criterion for reviewing the waiver is the collection of CEMS data showing that emissions have exceeded 70 percent of the applicable standard for seven, consecutive, averaging periods as specified by the applicable regulation(s). For sources subject to standards expressed as control efficiency levels, the criterion for reviewing the waiver is the collection of CEMS data showing that exhaust emissions have exceeded 70 percent of the level needed to meet the control efficiency requirement for seven, consecutive, averaging periods as specified by the applicable regulation(s) [e.g., 40 CFR 60.45(g)(2) and 40 CFR 60.45(g)(3), 40 CFR 60.73(e), and 40 CFR 60.84(e)]. It is the responsibility of the source operator to maintain records and determine the level of emissions relative to the criterion on the waiver of relative accuracy testing. If this criterion is exceeded, the owner or operator must notify the Department within 10 days of such occurrence and include a description of the nature and cause of the increasing emissions. The Department will review the notification and may rescind the waiver and require the owner or operator to conduct a relative accuracy test of the CEMS as specified in section 7 of Performance Specification 2.

[Rule 62-296.800, F.A.C.; 40 CFR 60.13(j)].

Modifications

E.32. Except as provided under 40 CFR 60.14(e) and 40 CFR 60.14(f), any physical or operational change to an existing facility which results in an increase in the emission rate to the atmosphere of any pollutant to which a standard applies shall be considered a modification within the meaning of section 111 of the Act. Upon modification, an existing facility shall become an affected facility for each pollutant to which a standard applies and for which there is an increase in the emission rate to the atmosphere.

[Rule 62-296.800, F.A.C.; 40 CFR 60.14(a)].

E.33. Emission rate shall be expressed as kg/hr (lbs./hour) of any pollutant discharged into the atmosphere for which a standard is applicable. The Department shall use the following to determine emission rate:

(1) Emission factors as specified in the latest issue of "Compilation of Air Pollutant Emission Factors", EPA Publication No. AP-42, or other emission factors determined by the Department to be superior to AP-42 emission factors, in cases where utilization of emission factors demonstrate that the emission level resulting from the physical or operational change will either clearly increase or clearly not increase.

(2) Material balances, continuous monitor data, or manual emission tests in cases where utilization of emission factors as referenced in 40 CFR 60.14(b)(1) does not demonstrate to the Department's satisfaction whether the emission level resulting from the physical or operational change will either clearly increase or clearly not increase, or where an owner or operator demonstrates to the Department's satisfaction that there are reasonable grounds to dispute the result obtained by the Department utilizing emission factors as referenced in 40 CFR 60.14(b)(1). When the emission rate is based on results from manual emission tests or continuous monitoring systems, the procedures specified in 40 CFR 60 appendix C of 40 CFR 60 shall be used to determine whether an increase in emission rate has occurred. Tests shall be conducted under such conditions as the Department shall specify to the owner or operator based on representative performance of the facility. At least three valid test runs must be conducted before and at least three after the physical or operational change. All operating parameters which may affect emissions must be held constant to the maximum feasible degree for all test runs.

[Rule 62-296.800, F.A.C.; 40 CFR 60.14(b)].

E.34. The addition of an affected facility to a stationary source as an expansion to that source or as a replacement for an existing facility shall not by itself bring within the applicability of 40 CFR 60 any other facility within that source.

[Rule 62-296.800, F.A.C.; 40 CFR 60.14(c)].

E.35. The following shall not, by themselves, be considered modifications under 40 CFR 60:

(1) Maintenance, repair, and replacement which the Department determines to be routine for a source category, subject to the provisions of 40 CFR 60.14(c) and 40 CFR 60.15.

(2) An increase in production rate of an existing facility, if that increase can be accomplished without a capital expenditure on that facility.

(3) An increase in the hours of operation.

(4) Use of an alternative fuel or raw material if, prior to the date any standard under 40 CFR 60 becomes applicable to that source type, as provided by 40 CFR 60.1, the existing facility was designed to accommodate that alternative use. A facility shall be considered to be designed to accommodate an alternative fuel or raw material if that use could be accomplished under the facility's construction specifications as amended prior to the change. Conversion to coal required for energy considerations, as specified in section 111(a)(8) of the Act, shall not be considered a modification.

(5) The addition or use of any system or device whose primary function is the reduction of air pollutants, except when an emission control system is removed or is replaced by a system which the Department determines to be less environmentally beneficial.

(6) The relocation or change in ownership of an existing facility.
[Rule 62-296.800, F.A.C.; 40 CFR 60.14(e)].

E.36. Special provisions set forth under an applicable subpart of 40 CFR 60 shall supersede any conflicting provisions of this section.
[Rule 62-296.800, F.A.C.; 40 CFR 60.14(f)].

E.37. Within 180 days of the completion of any physical or operational change subject to the control measures specified in 40 CFR 60.14(a), compliance with all applicable standards must be achieved.
[Rule 62-296.800, F.A.C.; 40 CFR 60.14(g)].

Section IV. Acid Rain Part

Operated by: Utility Board of the City of Key West
ORIS code: 6584

The following emissions units are regulated under the Acid Rain Program:

E.U.

<u>ID No.</u>	<u>Description</u>
001	Ralph Garcia Steam Plant [EPA ID #1][Retired]
005	8.8 MW Medium Speed Diesel Generator [Unit #1; EPA ID #D-1]
006	8.8 MW Medium Speed Diesel Generator [Unit #2; EPA ID #D-2]
007	23.5 MW Simple Cycle Combustion Turbine [CT-1]
008	19.77 MW Simple Cycle Combustion Turbine [CT-2]
009	19.77 MW Simple Cycle Combustion Turbine [CT-3]

1. The Utility Board of the City of Key West must comply with all the requirements and provisions as set forth in the applications listed below:

Ralph Garcia Steam Plant: "Retired Unit Exemption" DEP Form No. 62-210.900(1)(a)3., effective 01/01/98.

D-1, D-2, CT-1, CT-2, & CT-3: "New Unit Exemption" DEP Form No. 62-210.900(1)(a)2., effective 01/01/99 through 12/31/03.

[Chapter 62-213, F.A.C. and Rule 62-214.320, F.A.C. 40 CFR 72]

2. The following table lists the Phase II sulfur dioxide allowances for the above units:

E.U. ID No.	EPA ID #	YEAR	2000	2001	2002	2003
001 (retired)	1	SO ₂ allowances, under Table 2 of 40 CFR 73	2550*	2550*	2550*	2550*
005, 006	D-1, D-2	SO ₂ allowances, under Table 2 of 40 CFR 73	99	99	99	99

*The number of allowances held by an Acid Rain source in a unit account may differ from the number allocated by the US EPA under Table 2 of 40 CFR 73.]

3. Emission Allowances. Emissions from sources subject to the Federal Acid Rain Program (Title IV) shall not exceed any allowances that the source lawfully holds under the Federal Acid Rain Program. Allowances shall not be used to demonstrate compliance with a non-Title IV applicable requirement of the Act.

- a. No permit revision shall be required for increases in emissions that are authorized by allowances acquired pursuant to the Federal Acid Rain Program, provided that such increases do not require a permit revision pursuant to Rule 62-213.400(3), F.A.C.
- b. No limit shall be placed on the number of allowances held by the source under the Federal Acid Rain Program.
- c. Allowances shall be accounted for under the Federal Acid Rain Program.
[Rule 62-213.440(1)(c)1., 2. & 3., F.A.C.]

4. Retired Unit Exemption - Ralph Garcia. The designated representative of this acid rain unit applied for an exemption from the requirements of the Federal Acid Rain Program by submitting a completed and signed "Retired Unit Exemption" form (DEP Form No. 62-210.900(1)(a)3., F.A.C.) to the Department. The date of permanent retirement is January 1, 1998. The unit has been completely dismantled and has ceased operation.
[Rule 62-214.340(2), F.A.C.; and, 40 CFR 72.8.]

5. New Unit Exemption - D-1, D-2, CT-1, CT-2, & CT-3. The designated representative of this acid rain unit applied for an exemption from 40 CFR 72.1 through 72.6, and 40 CFR 72.10 through 72.13 of the Federal Acid Rain Program by submitting a completed and signed "New Unit Exemption" form (DEP Form No. 62-210.900(1)(a)2., F.A.C.) to the Department. The date of exemption is effective 01/01/99 through 12/31/03. This exemption may be renewed.
[Rule 62-214.340(2), F.A.C.; and, 40 CFR 72.7.]

6. Statement of Compliance. The annual statement of compliance pursuant to Rule 62-213.440(3), F.A.C., shall be submitted within 60 (sixty) days after the end of the calendar year. {See condition No. 51., Appendix TV-1, Title V Conditions.}
[Rule 62-214.420(11), F.A.C.]

7. Comments, notes, and justifications: Stock Island has no Phase I allowances.

Acid Rain Attachments and Relevant Documents:

Ralph Garcia Steam Plant: "Retired Unit Exemption" DEP Form No. 62-210.900(1)(a)3., effective 01/01/98.

D-1, D-2, CT-1, CT-2, & CT-3: "New Unit Exemption" DEP Form No. 62-210.900(1)(a)2., effective 01/01/99 through 12/31/03.

Appendix U-1, List of Unregulated Emissions Units and Activities

Utility Board of the City of Key West
Stock Island

DRAFT Permit No. 0870003-001-AV

Unregulated Emissions Units and Activities. An emissions unit which emits no “emissions-limited pollutant” and which is subject to no unit-specific work practice standard, though it may be subject to regulations applied on a facility-wide basis (e.g., unconfined emissions, odor, general opacity) or to regulations that require only that it be able to prove exemption from unit-specific emissions or work practice standards.

The below listed emissions units and activities are neither “regulated emissions units” nor “insignificant emissions units”.

E.U.

ID No. Brief Description of Emissions Units and Activities

010 Two No. 2 Fuel Oil Storage Tanks - 500,000 gallons each;
subject only to 40 CFR 60.116b (a) and (b)

No. 6 Fuel Oil Storage Tank - 1.9 million gallons; no applicable standards

Two No. 2 Fuel Oil Storage “day” Tanks - 16,000 gallons each

Eight Vehicular Fleet Fuel Tanks - 2,000 gallons each

Three Diesel Peaking Generators (2 MW): Units #1, #2, #3 (formerly E.U. 002, 003, & 004)

Appendix I-1, List of Insignificant Emissions Units and Activities

Utility Board of the City of Key West

DRAFT Permit No. 0870003-001-AV

Stock Island Plant

Page 1 of 2

The facilities, emissions units, or pollutant-emitting activities listed in Rule 62-210.300(3)(a), F.A.C., Categorical Exemptions, are exempt from the permitting requirements of Chapters 62-210 and 62-4, F.A.C.; provided, however, that exempt emissions units shall be subject to any applicable emission limiting standards and the emissions from exempt emissions units or activities shall be considered in determining the potential emissions of the facility containing such emissions units. Emissions units and pollutant-emitting activities exempt from permitting under Rule 62-210.300(3)(a), F.A.C., shall not be exempt from the permitting requirements of Chapter 62-213, F.A.C., if they are contained within a Title V source; however, such emissions units and activities shall be considered insignificant for Title V purposes provided they also meet the criteria of Rule 62-213.430(6)(b), F.A.C. No emissions unit shall be entitled to an exemption from permitting under Rule 62.210.300(3)(a), F.A.C., if its emissions, in combination with the emissions of other units and activities at the facility, would cause the facility to emit or have the potential to emit any pollutant in such amount as to make the facility a Title V source.

The below listed emissions units and activities are considered insignificant pursuant to Rule 62-213.430(6), F.A.C.

Brief Description of Emissions Units and Activities

1. Internal combustion engines in boats, aircraft and vehicles used for transportation of passengers or freight.
2. Cold storage refrigeration equipment, except for any such equipment located at a Title V source using an ozone-depleting substance regulated under 40 CFR Part 82.
3. Vacuum pumps in laboratory operations.
4. Equipment used for steam cleaning.
5. Belt or drum sanders having a total sanding surface of five square feet or less and other equipment used exclusively on wood or plastics or their products having a density of 20 pounds per cubic foot or more.
6. Equipment used exclusively for space heating, other than boilers.
7. Laboratory equipment used exclusively for chemical or physical analyses.
8. Brazing, soldering or welding equipment.
9. One or more emergency generators located within a single facility provided:
 - a. None of the emergency generators is subject to the Federal Acid Rain Program; and
 - b. Total fuel consumption by all such emergency generators within the facility is limited to 32,000 gallons per year of diesel fuel, 4,000 gallons per year of gasoline, 4.4 million standard cubic feet per year of natural gas or propane, or an equivalent prorated amount if multiple fuels are used.
10. One or more heating units and general purpose internal combustion engines located within a single facility provided:
 - a. None of the heating units or general purpose internal combustion engines is subject to the Federal Acid Rain Program; and
 - b. Total fuel consumption by all such heating units and general purpose internal combustion engines within the facility is limited to 32,000 gallons per year of diesel

Appendix I-1, List of Insignificant Emissions Units and Activities

Utility Board of the City of Key West

DRAFT Permit No. 0870003-001-AV

Stock Island Plant

Page 2 of 2

- fuel, 4,000 gallons per year of gasoline, 4.4 million standard cubic feet per year of natural gas or propane, or an equivalent prorated amount if multiple fuels are used.
11. Fire and safety equipment.
 12. Surface coating operations within a single facility if the total quantity of coatings containing greater than 5.0 percent VOCs, by volume, used is 6.0 gallons per day or less, averaged monthly, provided:
 - a. Such operations are not subject to a volatile organic compound Reasonably Available Control Technology (RACT) requirement of Chapter 62-296, F.A.C.; and
 - b. The amount of coatings used shall include any solvents and thinners used in the process including those used for cleanup.
 13. Surface coating operations utilizing only coatings containing 5.0 percent or less VOCs, by volume.
 14. Degreasing units using heavier-than-air vapors exclusively, except any such unit using or emitting any substance classified as a hazardous air pollutant.

Note: No exemption shall be granted to any emissions unit or activity if:

1. Such unit or activity would be subject to any unit-specific applicable requirement;
2. Such unit or activity, in combination with other units and activities proposed for exemption, would cause the facility to exceed any major source threshold(s) as defined in Rule 62-213.420(3)(c)1., F.A.C., unless it is acknowledged in the permit application that such units or activities would cause the facility to exceed such threshold(s); or
3. Such unit or activity would emit or have the potential to emit:
 - a. 500 pounds per year or more of lead and lead compounds expressed as lead;
 - b. 1,000 pounds per year or more of any hazardous air pollutant;
 - c. 2,500 pounds per year or more of total hazardous air pollutants; or
 - d. 5.0 tons per year or more of any other regulated pollutant.

[Rule 62-213.430(6), F.A.C.]

Table 1-1, Summary of Air Pollutant Standards and Terms

Utility Board of the City of Key West
Stock Island Power Plant

DRAFT Permit # 0870003-001-AV
Facility ID # 0870003

This table summarizes information for convenience purposes only, & does not supersede any terms or conditions of this permit.

E.U. 005, 006 8.8 MW 85.4 MMBtu/hr Medium Speed Diesel Generators, Two Units

Emission Limits are for Each Engine

Pollutant/Parameter	Fuel	Hours/Year	Allowable Emissions			Equivalent Emissions		Regulatory Citations	See Permit Condition	
			Standards	lbs/hour	TPY	lbs./hour	TPY			
SO2	#2 oil	3740 full-load equivalent engine hours	0.05% fuel	43.6	41.00			Rule 62-212.400, BACT	III.A.3, A.6	
PM	#2 oil		0.1 lbs/MMBtu	8.5	8			Rule 62-296.702	III.A.7	
VE	#2 oil		20% opacity					Rule 62-296.320(4)(b)1	II.3	
NOx	#2 oil		6.0 grams/hp-hour	160.9	151			Rule 62-212.400, BACT	III.A.5	
CO	#2 oil		2.0 grams/hp-hour	53.6	50			Rule 62-212.400, BACT	III.A.8	
Beryllium (Be)	#2 oil				0.00054	1			Rule 62-212.400, BACT	III.A.10
VOC	#2 oil		1.0 grams/hp-hour	26.8	25			Rule 62-212.400, BACT	III.A.9	

Notes:

* -- Equivalent Emissions provided for information only.

Table 1-1, Summary of Air Pollutant Standards and Terms

Utility Board of the City of Key West
 Stock Island Power Plant

DRAFT Permit # 0870003-001-AV
 Facility ID # 0870003

This table summarizes information for convenience purposes only, & does not supersede any terms or conditions of this permit.

E.U. 007 23.5 MW 312 MMBtu/hour Simple Cycle Combustion Turbine

Pollutant/Parameter	Fuel	Hours/Year	Allowable Emissions			Equivalent Emissions*		Regulatory Citations	See Permit Condition
			Standard(s)	lbs/hour	TPY	lbs./hour	TPY		
SO2	#2 oil		0.05% fuel only	-					III.B.2
PM	#2 oil			18	43	51.4	225**	PSD-FL-210	III.B.6
CO	#2 oil		20ppm@100% load & 136ppm@50% load	64	152			PSD-FL-210	III.B.7
NOx	#2 oil		75 ppm	96	138			PSD-FL-210	III.B.4
VE	#2 oil		20%	n/a				PSD-FL-210	III.B.8

Notes:

* -- Equivalent Emissions provided for information only.

Table 1-1, Summary of Air Pollutant Standards and Terms

Utility Board of the City of Key West
Stock Island Power Plant

DRAFT Permit # 0870003-001-AV
Facility ID # 0870003

This table summarizes information for convenience purposes only, & does not supersede any terms or conditions of this permit.

E.U. 008, 009 19.77 MW 305 MMBtu/hour Simple Cycle Combustion Turbine, Two Units

Pounds/hour apply to each turbine, while TPY limit is for both units combined

Pollutant/Parameter	Fuel	Hours/Year	Allowable Emissions			Equivalent Emissions*		Regulatory Citations	See Permit Condition
			Standard(s)	lbs/hour	TPY	lbs./hour	TPY		
SO2	#2 oil		0.05% fuel only			15.9	31.8	AC-0870003-003	III.C.5,C.9
PM	#2 oil			16.6	45	16.6	55	AC-0870003-003	III.C.10
CO	#2 oil			25.2	101	25.2	50.5	AC-0870003-003	III.C.11
NOx	#2 oil		75 ppm	93.8	172			AC-0870003-003	III.C.8
VE	#2 oil		20%				n/a	AC-0870003-003	III.C.11

Notes: ** -- Annual emissions (TPY) based on 3 hours per day at 0.3 lb/mmBtu and 21 hours per day at 0.1lb/MMBtu.
* -- Equivalent Emissions provided for information only.

Table 2-1, Summary of Compliance Requirements

Utility Board of the City of Key West
Stock Island Power Plant

DRAFT Permit # 0870003-001-AV
Facility ID # 0870003

This table summarizes information for convenience purposes only, & does not supersede any terms or conditions of this permit.

E.U. 005, 006

8.8 MW 85.4 MMBtu/hour Two Medium Speed Diesel Generators

Pollutant/ Parameter	Fuel	Compliance Method	Frequency of Sampling	Frequency Base Date *	Min. Compliance Test Duration	CMS**	Permit Condition
CO	#2 oil	EPA Method 10	annual	1-Jun			III.A.15
VE	#2 oil	DEP Method 9	permit renewal	1-Jun			II.3 & III.A.17
NOx	#2 oil	EPA Method 20	annual	1-Jun			III.A.15
SO2	#2 oil	EPA Method 6 or ASTM D 2880-71	permit renewal	1-Jun			III.A.16
PM	#2 oil	EPA Method 5	annual	1-Jun			III.A.15
VOC	#2 oil	EPA Method 25	permit renewal	1-Jun			III.A.16
Beryllium	#2 oil	EPA Method 104	annual	1-Jun			III.A.15

Notes:

*Frequency base date established for planning purposes only; see Rule 62-297.310, F.A.C.

**CMS = continuous monitoring system

Table 2-1, Summary of Compliance Requirements

Utility Board of the City of Key West
Stock Island Power Plant

DRAFT Permit # 0870003-001-AV
Facility ID # 0870003

This table summarizes information for convenience purposes only, & does not supersede any terms or conditions of this permit.

E.U. 007 23.5 MW 312 MMBtu/hour Simple Cycle Combustion Turbine

E.U. 008, 009 19.77 MW 305 MMBtu/hour Simple Cycle Combustion Turbine, Two Units

Pollutant/ Parameter	Fuel	Compliance Method	Frequency of Sampling	Frequency Base Date *	Min. Compliance Test Duration	CMS**	Permit Condition
SO ₂	#2 oil	ASTM4294 or equivalent	After each fuel oil shipment	Per 40 CFR 60.334			III.E.11
PM	#2 oil	EPA Method 5B	annual				III.E.10
VE	#2 oil	DEP Method 9	annual				III.E.10
CO	#2 oil	EPA Method 10	annual				III.E.10
NO _x	#2 oil	EPA Method 20	annual				III.E.10

Notes:

*Frequency base date established for planning purposes only; see Rule 62-297.310, F.A.C.

**CMS = continuous monitoring system

Appendix H-1, Permit History/ID Number Changes

Utility Board of the City of Key West
Stock Island Power Plant

DRAFT Permit No. 0870003-001-AV
Facility ID No. 0870003

Permit History

E.U.

<u>ID No</u>	<u>Description</u>	<u>Permit No.</u>	<u>Issued</u>	<u>Expiration Date</u>	
001	Steam Turbine (EPA ID #1)	AO44-245479 AC44-61820	05/03/94 12/17/82	04/25/99 06/15/83	RETIRED January, 1998
002	Diesel Peaking Unit #1	AO44-175804	02/20/90	02/20/95	Now in E.U. 010
003	Diesel Peaking Unit #2	AO44-175804	02/20/90	02/20/95	Now in E.U. 010
004	Diesel Peaking Unit #3	AO44-175804	02/20/90	02/20/95	Now in E.U. 010
005 & 006	8.8 MW Medium Speed Diesel Generators D-1 & D-2	AO44-207419 AC44-221256/ PSD-FL-135 AC4452197/ PSD-FL-135	03/19/93 03/19/93	12/31/97 03/18/94 04/01/91	
007	23.5 MW Simple Cycle Combustion Turbine CT-1	AC44-245399/ PSD-FL-210	09/28/95	12/31/96	
008 & 009	19.8 MW Simple Cycle Combustion Turbines CT-2 & CT-3	0870003-003-AC & 0870003-004- AC	01/08/98 04/13/98	01/08/00 05/19/00	
010	Unregulated Emissions Units	0870003-001-AV	01/01/99	12/31/03	

ID Number Changes: From: Facility ID No. 52FTM440003; To: Facility ID No. 0870003
From: E.U. ID No. 002, 003, 004; To: E.U. ID No. 010; Note: 010 units are all unregulated units.

Notes: 1 - AO permits automatic extensions in Rule 62-210.300(2)(a)3.a., F.A.C., effective 03/21/96.
{Rule 62-213.420(1)(b)2., F.A.C., effective 03/20/96, allows Title V Sources to operate under existing valid permits}



Department of Environmental Protection

Lawton Chiles
Governor

Twin Towers Office Building
2600 Blair Stone Road
Tallahassee, Florida 32399-2400

Virginia B. Wetherell
Secretary

NEW UNIT EXEMPTION

Issued to: Stock Island Power Plant
Unit ID#: CT-1, CT-2, CT-3, D-1, D-2
Operated by: Utility Board of the City of Key West
Effective: January 1, 1999 to December 31, 2003

Statutory and Regulatory Authorities:

In accordance with Title IV of the Clean Air Act Amendments of 1990, the U.S. Environmental Protection Agency exempts this unit from the requirements of the Acid Rain Program, except for the requirements in 40 CFR 72.1 through 72.7, and 72.10 through 72.13.

Conditions, Notes and Justifications that Apply to the Unit:

The petition for a new unit written exemption, submitted for this unit, is incorporated by reference. The requirements from which the unit is exempt during the effective period include, but are not limited to, the requirements to hold a permit (part 72), hold allowances (part 73), and monitor emissions (part 75).

Consistent with 40 CFR 72.7(d) (4), the unit shall only serve generators with a total nameplate capacity of 25 MWe or less and burn fuel with a sulfur content of 0.05 percent or less by weight.

The owners and operators shall apply the procedures under 40 CFR 72.7 (d) (2) for all fuels used at any time during the period for which the unit is exempted.

The owners and operators, and to the extent applicable, the designated representative, shall comply with the requirements of the Acid Rain Program concerning all years for which the unit is not exempted, even if such requirements arise or must be complied with after the exemption takes effect. The exemption shall not be a defense against any violation of such requirements whether the violation occurs before or after the exemption takes effect.

Approval:

Signature

Date

Howard L. Rhodes, Director
Division of Air Resources Management
Department of Environmental Protection
Telephone: (850) 488-0114 Facsimile: (850) 922-6979

New Unit Exemption

For more information, see instructions and refer to 40 CFR 72.7

This submission is: New Revised

STEP 1

Identify the new unit by plant name, State, and ORIS Code and boiler ID# from NADB.

Plant Name	State	ORIS Code	Boiler ID#
STOCK ISLAND POWER PLANT	FLORIDA	CT-1	

STEP 2

List to one decimal place the nameplate capacity of each generator served by the unit. Then total these entries and enter the result.

					TOTAL
23.5					23.5
MWe	MWe	MWe	MWe	MWe	MWe

STEP 3

List all fuels currently burned or expected to be burned, by the unit and the percent sulfur content by weight of each.

Fuel (current)	Percent SO ₂ (current)	Fuel (expected)	Percent SO ₂ (expected)
No. 2 Fuel Oil	0.05%	No. 2 Fuel Oil	0.05%
	%		%
	%		%

STEP 4

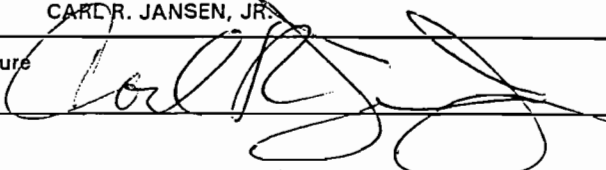
Read the special provisions and the certification, and sign and date.

Special Provisions

- (1) The owners and operators of each unit exempted under 40 CFR 72.7 and Rule 62-214.340, F.A.C., shall surrender allowances equal in number to, and with the same or an earlier compliance use date as, all of those allocated to the unit under subpart B of 40 CFR part 73 for any year for which the unit is exempted and shall waive the right to receive any allowances to be allocated under subpart B of 40 CFR part 73 for any year for which the unit is exempted.
- (2) The owners and operators of each unit exempted under 40 CFR 72.7 and Rule 62-214.340(1), F.A.C., shall determine the sulfur content by weight of its fuel as follows:
 - (i) For petroleum or petroleum products that the unit burns starting on the first day on which the exemption takes effect until the exemption terminates, a sample of each delivery of such fuel shall be tested using ASTM methods ASTM D4067-88 and ASTM D129-91, ASTM D2622-92, or ASTM D4294-90.
 - (ii) For natural gas that the unit burns starting on the first day on which the exemption takes effect until the exemption terminates, the sulfur content shall be assumed to be 0.06 percent or less by weight.
 - (iii) For gaseous fuel (other than natural gas) that the unit burns starting on the first day on which the exemption takes effect until the exemption terminates, a sample of each delivery of such fuel shall be tested using ASTM methods ASTM D1072-90 and ASTM D1285-92; provided that if the gaseous fuel is delivered by pipeline to the unit, a sample of the fuel shall be tested, at least once every quarter in which the unit operates during any year for which the exemption is in effect, using ASTM method ASTM D1072-90.
- (3) The owners and operators of each unit exempted under 40 CFR 72.7 and Rule 62-214.340(1), F.A.C., shall retain at the source that includes the unit, the records of the results of the tests performed under paragraph (2)(i) and (iii) of the special provisions and a copy of the purchase agreements for the fuel under paragraph (2) of the special provisions, stating the sulfur content of such fuel. Such records and documents shall be retained for 5 years from the date they are created.
- (4) On the earlier of the date the written exemption expires, the date a unit exempted under 40 CFR 72.7 and Rule 62-214.340(1), F.A.C., burns any fuel with a sulfur content in excess of 0.06 percent by weight (as determined in accordance with paragraph (2) of the special provisions), or 24 months prior to the date the unit first serves one or more generators with total nameplate capacity in excess of 25 MWe, the unit shall no longer be exempted under 40 CFR 72.7 and Rule 62-214.340(1), F.A.C., and shall be subject to all requirements of the Acid Rain Program, except that:
 - (i) Notwithstanding 40 CFR 72.30(b) and (c), the designated representative of the source that includes the unit shall submit a complete Acid Rain part application on the later of January 1, 1998 or the date the unit is no longer exempted under 40 CFR 72.7 and Rule 62-214.340(1), F.A.C.
 - (ii) For purposes of applying monitoring requirements under part 76 of this chapter, the unit shall be treated as a new unit that commenced commercial operation on the date the unit no longer meets the requirements of 40 CFR 72.7(a).

Certification

I am authorized to make this submission on behalf of the owners and operators of the acid rain source or Acid Rain units for which the submission is made. I certify under penalty of law that I have personally examined, and am familiar with, the statements and information submitted in this document and all its attachments. Based on my inquiry of those individuals with primary responsibility for obtaining the information, I certify that the statements and information are to the best of my knowledge and belief true, accurate, and complete. I am aware that there are significant penalties for submitting false statements and information or omitting required statements and information, including the possibility of fine or imprisonment.

Name	CARL R. JANSEN, JR.
Signature	
Date	9/9/98

New Unit Exemption

For more information, see instructions and refer to 40 CFR 72.7

This submission is: New Revised

Page 1 of 2

STEP 1
Identify the new unit by plant name, State, and ORIS Code and boiler ID# from NADB.

Plant Name	Stock Island Power Plant	State	FL	ORIS Code	6584	Boiler ID#	CT 2
							TOTAL

STEP 2
List to one decimal place the nameplate capacity of each generator served by the unit. Then total these entries and enter the result.

MWe	MWe	MWe	MWe	MWe	MWe
19.8					19.8
Fuel (current)	Percent SO ₂ (current)			Fuel (expected)	Percent SO ₂ (expected)

STEP 3
List all fuels currently burned or expected to be burned, by the unit and the percent sulfur content by weight of each.

	%	No. 2 Diesel Oil	0.05 or less	%
	%			%

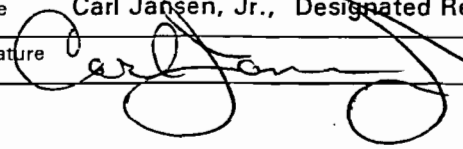
STEP 4
Read the special provisions and the certification, and sign and date.

Special Provisions

- (1) The owners and operators of each unit exempted under 40 CFR 72.7 and Rule 62-214.340, F.A.C., shall surrender allowances equal in number to, and with the same or an earlier compliance use date as, all of those allocated to the unit under subpart B of 40 CFR part 73 for any year for which the unit is exempted and shall waive the right to receive any allowances to be allocated under subpart B of 40 CFR part 73 for any year for which the unit is exempted.
- (2) The owners and operators of each unit exempted under 40 CFR 72.7 and Rule 62-214.340(1), F.A.C., shall determine the sulfur content by weight of its fuel as follows:
 - (i) For petroleum or petroleum products that the unit burns starting on the first day on which the exemption takes effect until the exemption terminates, a sample of each delivery of such fuel shall be tested using ASTM methods ASTM D4057-88 and ASTM D129-91, ASTM D2622-92, or ASTM D4294-90.
 - (ii) For natural gas that the unit burns starting on the first day on which the exemption takes effect until the exemption terminates, the sulfur content shall be assumed to be 0.05 percent or less by weight.
 - (iii) For gaseous fuel (other than natural gas) that the unit burns starting on the first day on which the exemption takes effect until the exemption terminates, a sample of each delivery of such fuel shall be tested using ASTM methods ASTM D1072-90 and ASTM D1265-92; provided that if the gaseous fuel is delivered by pipeline to the unit, a sample of the fuel shall be tested, at least once every quarter in which the unit operates during any year for which the exemption is in effect, using ASTM method ASTM D1072-90.
- (3) The owners and operators of each unit exempted under 40 CFR 72.7 and Rule 62-214.340(1), F.A.C., shall retain at the source that includes the unit, the records of the results of the tests performed under paragraph (2)(i) and (iii) of the special provisions and a copy of the purchase agreements for the fuel under paragraph (2) of the special provisions, stating the sulfur content of such fuel. Such records and documents shall be retained for 5 years from the date they are created.
- (4) On the earlier of the date the written exemption expires, the date a unit exempted under 40 CFR 72.7 and Rule 62-214.340(1), F.A.C., burns any fuel with a sulfur content in excess of 0.05 percent by weight (as determined in accordance with paragraph (2) of the special provisions), or 24 months prior to the date the unit first serves one or more generators with total nameplate capacity in excess of 25 MWe, the unit shall no longer be exempted under 40 CFR 72.7 and Rule 62-214.340(1), F.A.C., and shall be subject to all requirements of the Acid Rain Program, except that:
 - (i) Notwithstanding 40 CFR 72.30(b) and (c), the designated representative of the source that includes the unit shall submit a complete Acid Rain part application on the later of January 1, 1998 or the date the unit is no longer exempted under 40 CFR 72.7 and Rule 62-214.340(1), F.A.C.
 - (ii) For purposes of applying monitoring requirements under part 75 of this chapter, the unit shall be treated as a new unit that commenced commercial operation on the date the unit no longer meets the requirements of 40 CFR 72.7(a).

Certification

I am authorized to make this submission on behalf of the owners and operators of the acid rain source or Acid Rain units for which the submission is made. I certify under penalty of law that I have personally examined, and am familiar with, the statements and information submitted in this document and all its attachments. Based on my inquiry of those individuals with primary responsibility for obtaining the information, I certify that the statements and information are to the best of my knowledge and belief true, accurate, and complete. I am aware that there are significant penalties for submitting false statements and information or omitting required statements and information, including the possibility of fine or imprisonment.

Name	Carl Jansen, Jr., Designated Representative	
Signature		Date
		4/30/98

New Unit Exemption

For more information, see instructions and refer to 40 CFR 72.7

This submission is: New Revised

Page 2 of 2

STEP 1

Identify the new unit by plant name, State, and ORIS Code and boiler ID# from NADB.

Plant Name	Stock Island Power Plant	State	FL	ORIS Code	6584	Boiler ID#	CT 3
							TOTAL

STEP 2

List to one decimal place the nameplate capacity of each generator served by the unit. Then total these entries and enter the result.

MWe	MWe	MWe	MWe	MWe	MWe
19.8					19.8
Fuel (current)	Percent SO ₂ (current)			Fuel (expected)	Percent SO ₂ (expected)

STEP 3

List all fuels currently burned or expected to be burned, by the unit and the percent sulfur content by weight of each.

	%	No. 2 Diesel Oil	0.05 or less	%
	%			%

STEP 4

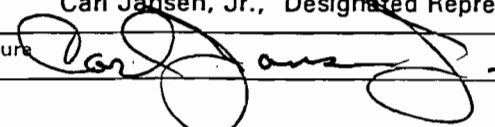
Read the special provisions and the certification, and sign and date.

Special Provisions

- (1) The owners and operators of each unit exempted under 40 CFR 72.7 and Rule 62-214.340, F.A.C., shall surrender allowances equal in number to, and with the same or an earlier compliance use date as, all of those allocated to the unit under subpart B of 40 CFR part 73 for any year for which the unit is exempted and shall waive the right to receive any allowances to be allocated under subpart B of 40 CFR part 73 for any year for which the unit is exempted.
- (2) The owners and operators of each unit exempted under 40 CFR 72.7 and Rule 62-214.340(1), F.A.C., shall determine the sulfur content by weight of its fuel as follows:
 - (i) For petroleum or petroleum products that the unit burns starting on the first day on which the exemption takes effect until the exemption terminates, a sample of each delivery of such fuel shall be tested using ASTM methods ASTM D4057-88 and ASTM D129-91, ASTM D2622-92, or ASTM D4294-90.
 - (ii) For natural gas that the unit burns starting on the first day on which the exemption takes effect until the exemption terminates, the sulfur content shall be assumed to be 0.05 percent or less by weight.
 - (iii) For gaseous fuel (other than natural gas) that the unit burns starting on the first day on which the exemption takes effect until the exemption terminates, a sample of each delivery of such fuel shall be tested using ASTM methods ASTM D1072-90 and ASTM D1265-92; provided that if the gaseous fuel is delivered by pipeline to the unit, a sample of the fuel shall be tested, at least once every quarter in which the unit operates during any year for which the exemption is in effect, using ASTM method ASTM D1072-90.
- (3) The owners and operators of each unit exempted under 40 CFR 72.7 and Rule 62-214.340(1), F.A.C., shall retain at the source that includes the unit, the records of the results of the tests performed under paragraph (2)(i) and (iii) of the special provisions and a copy of the purchase agreements for the fuel under paragraph (2) of the special provisions, stating the sulfur content of such fuel. Such records and documents shall be retained for 5 years from the date they are created.
- (4) On the earlier of the date the written exemption expires, the date a unit exempted under 40 CFR 72.7 and Rule 62-214.340(1), F.A.C., burns any fuel with a sulfur content in excess of 0.05 percent by weight (as determined in accordance with paragraph (2) of the special provisions), or 24 months prior to the date the unit first serves one or more generators with total nameplate capacity in excess of 25 MWe, the unit shall no longer be exempted under 40 CFR 72.7 and Rule 62-214.340(1), F.A.C., and shall be subject to all requirements of the Acid Rain Program, except that:
 - (i) Notwithstanding 40 CFR 72.30(b) and (c), the designated representative of the source that includes the unit shall submit a complete Acid Rain part application on the later of January 1, 1998 or the date the unit is no longer exempted under 40 CFR 72.7 and Rule 62-214.340(1), F.A.C.
 - (ii) For purposes of applying monitoring requirements under part 75 of this chapter, the unit shall be treated as a new unit that commenced commercial operation on the date the unit no longer meets the requirements of 40 CFR 72.7(a).

Certification

I am authorized to make this submission on behalf of the owners and operators of the acid rain source or Acid Rain units for which the submission is made. I certify under penalty of law that I have personally examined, and am familiar with, the statements and information submitted in this document and all its attachments. Based on my inquiry of those individuals with primary responsibility for obtaining the information, I certify that the statements and information are to the best of my knowledge and belief true, accurate, and complete. I am aware that there are significant penalties for submitting false statements and information or omitting required statements and information, including the possibility of fine or imprisonment.

Name	Carl Jansen, Jr., Designated Representative	
Signature		Date
		4/30/98



UNITED STATES ENVIRONMENTAL PROTECTION AGENCY

REGION 4

345 COURTLAND STREET, N.E.
ATLANTA, GEORGIA 30365

NEW UNIT EXEMPTION

Issued to: Stock Island Power Plant
Boiler ID#: D-1
Operated by: Utility Board of the City of Key West
Effective: January 1, 1995 to December 31, 1999

Statutory and Regulatory Authorities. In accordance with Title IV of the Clean Air Act Amendments of 1990, the U. S. Environmental Protection Agency exempts this unit from the requirements of the Acid Rain Program, except for the requirements in 40 CFR 72.1 through 72.7, and 72.10 through 72.13.

Conditions, notes and justifications that apply to the unit:

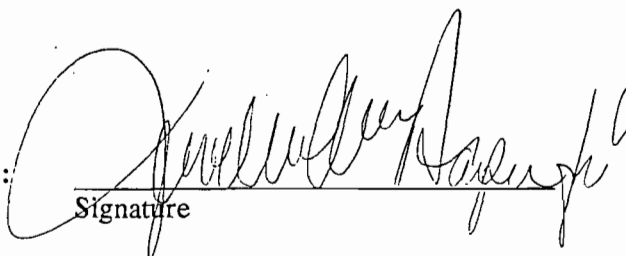
The petition for a new unit written exemption, submitted for this unit, is incorporated by reference. The requirements from which the unit is exempt during the effective period include, but are not limited to, the requirements to hold a permit (part 72), hold allowances (part 73), and monitor emissions (part 75).

Consistent with 40 CFR 72.7(d)(4), the unit shall only serve generators with a total nameplate capacity of 25 MWe or less and burn fuel with a sulfur content of 0.05 percent or less by weight.

The owners and operators shall apply the procedures under 40 CFR 72.7(d)(2) for all fuels used at any time during the period for which the unit is exempted.

The owners and operators, and to the extent applicable, the designated representative, shall comply with the requirements of the Acid Rain Program concerning all years for which the unit is not exempted, even if such requirements arise or must be complied with after the exemption takes effect. The exemption shall not be a defense against any violation of such requirements whether the violation occurs before or after the exemption takes effect.

Approval:

 ^{WAS}
Signature _____ Date 2/9/95

Winston A. Smith
Director, Air, Pesticides and Toxics Management Division
U.S. Environmental Protection Agency, Region IV
345 Courtland Street, N.E.
Atlanta, Georgia 30365
Telephone: (404) 347-3043 Facsimile: (404) 347-5207



UNITED STATES ENVIRONMENTAL PROTECTION AGENCY

REGION IV

345 COURTLAND STREET, N.E.
ATLANTA, GEORGIA 30365

NEW UNIT EXEMPTION

Issued to: Stock Island Power Plant
Boiler ID#: D-2
Operated by: Utility Board of the City of Key West
Effective: January 1, 1995 to December 31, 1999

Statutory and Regulatory Authorities. In accordance with Title IV of the Clean Air Act Amendments of 1990, the U. S. Environmental Protection Agency exempts this unit from the requirements of the Acid Rain Program, except for the requirements in 40 CFR 72.1 through 72.7, and 72.10 through 72.13.

Conditions, notes and justifications that apply to the unit:

The petition for a new unit written exemption, submitted for this unit, is incorporated by reference. The requirements from which the unit is exempt during the effective period include, but are not limited to, the requirements to hold a permit (part 72), hold allowances (part 73), and monitor emissions (part 75).

Consistent with 40 CFR 72.7(d)(4), the unit shall only serve generators with a total nameplate capacity of 25 MWe or less and burn fuel with a sulfur content of 0.05 percent or less by weight.

The owners and operators shall apply the procedures under 40 CFR 72.7(d)(2) for all fuels used at any time during the period for which the unit is exempted.

The owners and operators, and to the extent applicable, the designated representative, shall comply with the requirements of the Acid Rain Program concerning all years for which the unit is not exempted, even if such requirements arise or must be complied with after the exemption takes effect. The exemption shall not be a defense against any violation of such requirements whether the violation occurs before or after the exemption takes effect.

Approval:

Winston A. Smith
Signature

FEB 07 1995

Date

Winston A. Smith
Director, Air, Pesticides and Toxics Management Division
U.S. Environmental Protection Agency, Region IV
345 Courtland Street, N.E.
Atlanta, Georgia 30365
Telephone: (404) 347-3043 Facsimile: (404) 347-5207

Retired Unit Exemption

For more information, see instructions and refer to 40 CFR 72.8

This submission is: New Revised

STEP 1

Identify the unit that is or will be retired by plant name, State, and ORIS Code and boiler ID# from NADB.

Plant Name	RALPH GARCIA STEAM PLANT	State	FL	ORIS Code	6584	Boiler ID#	#1
------------	--------------------------	-------	----	-----------	------	------------	----

STEP 2

Check one box to indicate the deadline for this application.

- This petition is being submitted on or before the deadline for submitting an Acid Rain part application for Phase II.
- The unit has a Phase II Acid Rain part. This petition is being submitted on or before the deadline for reapplying for the Acid Rain part.

STEP 3

Read the certification and enter the actual or expected date of retirement of the unit.

I certify that this unit is or will be permanently retired on the date specified in this petition and will not emit any sulfur dioxide or nitrogen oxides after such date. The date for the permanent retirement of this unit is or will be:

01/01/98 mm/dd/yy

STEP 4

Indicate that the required information is attached.

- A description of any actions that have been or will be taken and that provide the basis for the certification in Step 3.

Turbine Removed, All Piping Removed, Controls removed AND circulating water pumps removed

STEP 5

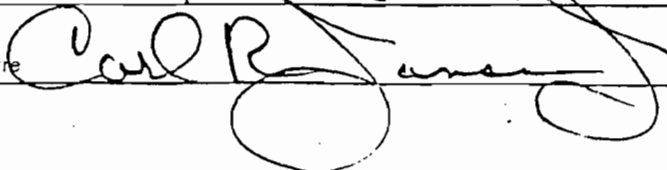
Read the special provisions and the certifications, and sign and date.

Special Provisions

- (1) A unit exempted under 40 CFR 72.8 and Rule 62-214.340(2), F.A.C., shall not emit any sulfur dioxide and nitrogen oxides starting on the date it is exempted.
- (2) The owners and operators of a unit exempted under 40 CFR 72.8 and Rule 62-214.340(2), F.A.C., shall comply with monitoring requirements in accordance with part 75 and will be allocated allowances in accordance with 40 CFR part 73.
- (3) A unit exempted under 40 CFR 72.8 shall not resume operation unless the designated representative of the source that includes the unit submits an Acid Rain part application for the unit not less than 24 months prior to the later of January 1, 2000, or the date the unit is to resume operation. On the earlier of the date the written exemption expires or the date an Acid Rain part application is submitted or is required to be submitted under this paragraph (3), the unit shall no longer be exempted and shall be subject to all requirements of 40 CFR part 72.

Certification


I am authorized to make this submission on behalf of the owners and operators of the Acid Rain source or Acid Rain units for which the submission is made. I certify under penalty of law that I have personally examined, and am familiar with, the statements and information submitted in this document and all its attachments. Based on my inquiry of those individuals with primary responsibility for obtaining the information, I certify that the statements and information are to the best of my knowledge and belief true, accurate, and complete. I am aware that there are significant penalties for submitting false statements and information or omitting required statements and information, including the possibility of fine or imprisonment.

Name	CARL R JAUSED JR		
Signature		Date	01/05/98

Anderson *Boyle*

UTILITY BOARD OF THE CITY OF KEY WEST

POST OFFICE DRAWER 6100
KEY WEST, FLORIDA 33041-6100



TELEPHONE: (305) 295-1000
www.kwcityelectric.com

January 5, 1998

Mr. A. A. Linero
Administrator
New Source Review Section
Division of Air Resources Management
Florida Department of Environmental Protection
Twin Towers Office Building
2600 Blair Stone Road
Tallahassee, FL 32399-2400

Subject: Official Retirement of the Ralph Garcia Steam Plant

Dear Mr. Linero:

As a condition of the draft construction permit (No. 0870003-003-AC) for two 19.77 MW simple cycle combustion turbines, we are officially retiring the Ralph Garcia Steam Plant as a steam generation plant. It is our understanding that a final construction permit will be issued upon the retirement of this unit. I have enclosed DEP Form No. 62-210.900(1)(a)3.

If you have any questions or comments, please do not hesitate to contact Joe Stone at (305) 295-1148.

Sincerely,

UTILITY BOARD - CITY OF KEY WEST
CITY ELECTRIC SYSTEM

Larry J. Thompson
Larry J. Thompson
General Manager

LJT/me

cc:
R. Rodriguez, Assistant General Manager
J. Stone, Environmental Services Supervisor
R. Williams, FMPA
I. Clark, R.W. Beck & Associates
File: SOF-110

cc: C. Phillips, BAR
S. Aziz, BAR

retirergsp.DOC

RECEIVED

JAN 06 1998

BUREAU OF
AIR REGULATION

UTILITY BOARD MEMBERS:

Robert R. Padron, Chairman • Dr. Otha P. Cox, Vice-Chairman
Leonard H. Knowles, Member • Gayle Swofford, Member • Lou Hernandez, Member