



Department of Environmental Protection

Jeb Bush
Governor

Twin Towers Office Building
2600 Blair Stone Road
Tallahassee, Florida 32399-2400

David B. Struhs
Secretary

Certified Mail – Return Receipt Requested

July 25, 2002

Mr. Michael Lentz
Plant Manager and Responsible Official
Florida Power / Progress Energy
100 Central Avenue, Mail Code BP44
St. Petersburg, Florida 33701

Re: Title V Air Operation Permit Renewal Application
Higgins Power Plant
Facility ID: **1030012**; ORIS Code: **0630**

Dear Mr. Lentz:

Thank you for your recent submission of a Title V Air Operation Permit Renewal Application for the referenced plant. However, we must deem your application *incomplete*, due to the omission of an updated Phase II Acid Rain Part Application. Please be advised that Department Rule 62-214.320(1)(i), F.A.C. requires that, "the designated representative of any Title V source having a Title V permit with an Acid Rain Part shall submit a complete application for renewal of the Title V permit with the Acid Rain Part for each Acid Rain unit at the source."

Also, please check if there are any changes to the Designated Representative for the facility, and submit an updated Certificate of Representation if necessary.

When we receive this information we will continue processing your application. If you have any questions, please contact Edward J. Svec at 850/921-8985.

Sincerely,

Scott M. Sheplak, P.E.
Administrator
Title V Section

Cc: Kennard Kosky, P.E., Golder Associates
Gerald Kissel, P.E., DEP SWD

SENDER: COMPLETE THIS SECTION

- Complete items 1, 2, and 3. Also complete item 4 if Restricted Delivery is desired.
- Print your name and address on the reverse so that we can return the card to you.
- Attach this card to the back of the mailpiece, or on the front if space permits.

1. Article Addressed to:
 Mr. Michael Lentz
 Plant Manager and Responsible Official
 Florida Power/Progress Energy
 100 Central Avenue, Mail Code BP44
 St. Petersburg, Florida 33701

2. Article Number (Copy from service label)
 7000 0600 0021 6524 3479

COMPLETE THIS SECTION ON DELIVERY

A. Received by (Please Print Clearly) *Maria Clark* B. Date of Delivery *7/29/02*

C. Signature *Maria Clark* Agent Addressee

D. Is delivery address different from item 1? Yes No
 If YES, enter delivery address below:

3. Service Type
 Certified Mail Express Mail
 Registered Return Receipt for Merchandise
 Insured Mail C.O.D.

4. Restricted Delivery? (Extra Fee) Yes

PS Form 3811, July 1999

Domestic Return Receipt

102595-00-M-0952

7000 0600 0021 6524 3479

**U.S. Postal Service
 CERTIFIED MAIL RECEIPT**
 (Domestic Mail Only; No Insurance Coverage Provided)

Article Sent To:
 Mr. Michael Lentz

Postage	\$
Certified Fee	
Return Receipt Fee (Endorsement Required)	
Restricted Delivery Fee (Endorsement Required)	
Total Postage & Fees	\$

Postmark
 Here

Name (Please Print Clearly) (to be completed by mailer)
 Mr. Michael Lentz
 Street, Apt. No., or PO Box No.
 100 Central Avenue, Mail Code BP44
 City, State ZIP+4
 St. Petersburg, Florida 33701

PS Form 3811, July 1999 See Reverse for Instructions



Florida Power

A Progress Energy Company

Received By
SMY OK BJD
RECEIVED

OCT 30 2002

RECEIVED

NOV 04 2002

BUREAU OF AIR REGULATION

BUREAU OF AIR REGULATION

October 25, 2002

Mr. Scott Sheplak, P.E.
Florida Department of Environmental Protection
Bureau of Air Regulation, Title V Section
Mail Station #5505
2600 Blair Stone Road
Tallahassee, FL 32399-2400

Re: Comment on Draft Title V Air Operation Permit No. 1030012-002-AV
Higgins Plant

Dear Mr. Sheplak:

Florida Power wishes to express a comment on the above referenced draft permit. Florida Power requests a change in the language of permit condition B.13. to read:

Operating Rate During Testing. Testing of emissions shall be conducted with the emissions unit operation at permitted capacity, which is defined as 90 to 100 percent of the maximum operation rate allowed by the permit. If it is impracticable to test at permitted capacity, an emissions unit may be tested at less than the minimum permitted capacity; in this case, subsequent emissions unit operation is limited to 110 percent of the test load until a new test is conducted. Once the emissions unit is so limited, operation at higher capacities is allowed for no more than 15 consecutive days for the purpose of additional compliance testing to regain the authority to operate at the permitted capacity.

[Rules 62-297.310(2) & (2)(b), F.A.C.]

This language is consistent with the Department's guidance document, *Guidance on Rate of Operation during Compliance Testing*, issued on March 1, 2001.

Please contact Matt Lydon at (727) 826-4152 if you have any questions or need additional information.

Sincerely,

Michael Lentz
Plant Manager



Florida Power
A Progress Energy Company

E-MAIL
RECEIVED

OCT 30 2002

BUREAU OF AIR REGULATION

October 25, 2002

Mr. Scott Sheplak, P.E.
Florida Department of Environmental Protection
Bureau of Air Regulation, Title V Section
Mail Station #5505
2600 Blair Stone Road
Tallahassee, FL 32399-2400

Re: Comment on Draft Title V Air Operation Permit No. 1030012-002-AV
Higgins Plant

Dear Mr. Sheplak:

Florida Power wishes to express a comment on the above referenced draft permit. Florida Power requests a change in the language of permit condition B.13. to read:

Operating Rate During Testing. Testing of emissions shall be conducted with the emissions unit operation at permitted capacity, which is defined as 90 to 100 percent of the maximum operation rate allowed by the permit. If it is impracticable to test at permitted capacity, an emissions unit may be tested at less than the minimum permitted capacity; in this case, subsequent emissions unit operation is limited to 110 percent of the test load until a new test is conducted. Once the emissions unit is so limited, operation at higher capacities is allowed for no more than 15 consecutive days for the purpose of additional compliance testing to regain the authority to operate at the permitted capacity.

[Rules 62-297.310(2) & (2)(b), F.A.C.]

This language is consistent with the Department's guidance document, *Guidance on Rate of Operation during Compliance Testing*, issued on March 1, 2001.

Please contact Matt Lydon at (727) 826-4152 if you have any questions or need additional information.

Sincerely,

Michael Lentz
Plant Manager



Florida Power

A Progress Energy Company

RECEIVED

OCT 28 2002

October 17, 2002

BUREAU OF AIR REGULATION

Mr. Scott Sheplak, P.E.
Florida Department of Environmental Protection
Bureau of Air Regulation, Title V Section
Mail Station #5505
2600 Blair Stone Road
Tallahassee, FL 32399-2400

Re: Comment on Draft Title V Air Operation Permit No. 1030012-002-AV
Higgins Plant

Dear Mr. Sheplak:

Florida Power wishes to express several comments on the above referenced draft permit.
Florida Power requests to include the following language in permit condition A.2.:

The heat input limitations have been placed in each permit to identify the capacity of each unit for the purposes of confirming that emissions testing is conducted within 90 to 100 percent of the unit's rated capacity (or to limit future operation to 110 percent of the test load), to establish appropriate emission limits and to aid in determining future rule applicability. This is not a limit, therefore regular record keeping is not required for heat input. Instead, the owner or operator is expected to determine heat input whenever emission testing is required, to demonstrate at what percentage of the rated capacity that the unit was tested. Rule 62-297.310(5), F.A.C., included in the permit, requires measurement of the process variables for emission tests. Such heat input determination may be based on measurements of fuel consumption by various methods including but not limited to fuel flow metering or tank drop measurements, using the heat value of the fuel determined by the fuel vendor or the owner or operator, to calculate average hourly heat input during the test. [Rules 62-4.160(2), 62-210.200(PTE) and 62-296.405, F.A.C.]

Please revise the permitting note corresponding to permit conditions A.5. – A.9. to read:

{Permitting note: Unless otherwise specified, the averaging time for conditions A.5. - A.9. are based on the specified averaging time of the applicable test method.}

Florida Power requests a change in the language of permit condition A.29. to read:

In the case of malfunctions resulting in excess emissions greater than two hours in a 24 hour period, the owner or operator shall notify the Air Quality Division of the Pinellas County Department of Environmental Management in accordance with Rule 62-4.130, F.A.C. A full written report on the malfunctions shall be submitted in a quarterly report, if requested by the Air Quality Division of the Pinellas County Department of Environmental Management. [Rule 62-210.700(6), F.A.C.]

Florida Power requests a change in the language of permit condition B.1.:

Permitted Capacity. CTP 1 and CTP 2 each have a maximum heat input of 566 MMBtu/hour at 59° F and each powers a generator rated at 37.0 MW (megawatts of electricity). CTP 3 and CTP 4 each have a maximum heat input of 631 MMBtu/hour at 59° F and each powers a generator rated at 42.9 MW. At other ambient temperatures, the units shall be operated in accordance with established performance curves, which will be made available at the site during compliance testing. The heat input limitations have been placed in each permit to identify the capacity of each unit for the purposes of confirming that emissions testing is conducted within 90 to 100 percent of the unit's rated capacity (or to limit future operation to 110 percent of the test load), to establish appropriate emission limits and to aid in determining future rule applicability. This is not a limit, therefore regular record keeping is not required for heat input. Instead, the owner or operator is expected to determine heat input whenever emission testing is required, to demonstrate at what percentage of the rated capacity that the unit was tested. Rule 62-297.310(5), F.A.C., included in the permit, requires measurement of the process variables for emission tests. Such heat input determination may be based on measurements of fuel consumption by various methods including but not limited to fuel flow metering or tank drop measurements, using the heat value of the fuel determined by the fuel vendor or the owner or operator, to calculate average hourly heat input during the test. [Rules 62-4.160(2) and 62-210.200(PTE), F.A.C.; and, AO 52-216420, AO 52-216421, AO 52-216422, AO 52-216423.]

Please revise the permitting note corresponding to permit condition B.5. to read:

{Permitting note: Unless otherwise specified, the averaging time for condition A.5. is based on the specified averaging time of the applicable test method.}

Florida Power requests a change in the language of permit condition B.9. to read:

The permittee shall demonstrate compliance with the sulfur content limit with a fuel analysis provided by the vendor or permittee upon each fuel delivery.

Florida Power requests a change in the language of permit condition B.12. to read:

*The fuel sulfur content, percent by weight, provided by the vendor or permittee of liquid fuels shall be evaluated using either ASTM D2622-94, ASTM D4294-90, both ASTM D4057-88 and ASTM D129-91, or the latest edition(s).
[Rules 62-213.440 and 62-297.440, F.A.C.]*


Florida Power requests a change in the language of permit condition B.17. to read:

In the case of malfunctions resulting in excess emissions greater than two hours in a 24 hour period, the owner or operator shall notify the Air Quality Division of the Pinellas County Department of Environmental Management in accordance with Rule 62-4.130, F.A.C. A full written report on the malfunctions shall be submitted in a quarterly report, if requested by the Air Quality Division of the Pinellas County Department of Environmental Management. [Rule 62-210.700(6), F.A.C.]

Mr. Scott Sheplak
October 17, 2002
Page 3

Please contact Matt Lydon at (727) 826-4152 if you have any questions or need additional information.

Sincerely,

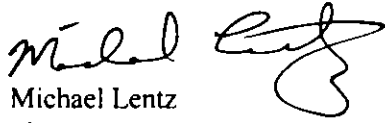
Michael Lentz
Plant Manager



Florida Power
A Progress Energy Company

RECEIVED

OCT 22 2002

October 17, 2002

BUREAU OF AIR REGULATION

Mr. Ed Svec
Florida Department of Environmental Protection
Bureau of Air Regulation
2600 Blaire Stone Road
Mail Station: 5505
Tallahassee, FL 32399-2400

Re: Higgins Facility's Title V Draft Permit Public Notice Proof of Publication

Dear Mr. Svec,

I have enclosed the original proof of publication of the intent to issue the Title V air operating permit renewal public notice. The public notice was published on October 1, 2002 in the St. Petersburg Times. Due to a mail delivery error Florida Power did not receive the proof of publication in the necessary time frame to delivery the proof of publication to the Florida Department of Environmental Protection within 7 days of publication.

Please contact me (727) 826-4152 if you have any questions.

Sincerely,

Matt Lydon
Associate Environmental Specialist

enclosures

ST. PETERSBURG TIMES

Published Daily
St. Petersburg, Pinellas County, Florida

STATE OF FLORIDA } S.S.
COUNTY OF PINELLAS }

Before the undersigned authority personally appeared N. Olsen
who on oath says that he is Legal Clerk
of the North Pinellas Times
a daily newspaper published at St. Petersburg, in Pinellas County, Florida; that the
attached copy of advertisement, being a Legal Notice
in the matter RE: Notice of Intent

was published in said newspaper in the issues of October 1, 2002

Affiant further says the said North Pinellas Times
is a newspaper published at St. Petersburg, in said Pinellas County, Florida, and that the said
newspaper has heretofore been continuously published in said Pinellas County, Florida, each
day and has been entered as second class mail matter at the post office in St. Petersburg, in
said Pinellas County, Florida, for a period of one year next preceding the first publication of
the attached copy of advertisement, and affiant further says that he has neither paid nor
promised any person, firm, or corporation any discount, rebate, commission or refund for the
purpose of securing this advertisement for publication in the said newspaper.

N. Olsen
Signature of Affiant

Sworn to and subscribed before
me this 1st day of
October A.D. 2002

Kathleen J. Klase
Notary Public

OFFICIAL NOTARY SEAL
KATHLEEN J. KLAUSE
NOTARY PUBLIC STATE OF FLORIDA
COMMISSION NO. CC947304
MY COMMISSION EXPIRES JUNE 20 2004

RECEIVED

OCT 22 2002

BUREAU OF AIR REGULATION

LEGAL NOTICE

PUBLIC NOTICE OF INTENT TO ISSUE TITLE V AIR OPERATION PERMIT RENEWAL

Department of Environmental Protection
Title V Air Operation Permit Renewal
DRAFT Permit No. 1030012-007 AV
Florida Power
Pinellas County

The Department of Environmental Protection (permitting authority) gives notice of its intent to issue a Title V Air Operation Permit Renewal to Florida Power for Higgins Power Plant located at 998 East Shore Drive, Oklawaha, Pinellas County. This is a renewal to Title V Air Operation Permit No. 1030012-001-AV. The Applicant's name and address are: Florida Power, Michael Lentz, Plant Manager Higgins, 100 Central Avenue, May Code BP44, St. Petersburg, Florida 33701.

The permitting authority will issue the PROPOSED Permit, and subsequent FINAL Permit, in accordance with the conditions of the DRAFT Permit unless a response received in accordance with the following procedures results in a different decision or significant change of terms or conditions.

The permitting authority will accept written comments concerning the proposed DRAFT Permit issuance action for a period of 30 (thirty) days from the date of publication of this notice. Written comments should be brought to the Department's Bureau of Air Regulation, 2600 Blair Stone Road, Mail Station #5505, Tallahassee, Florida 32309-2400. Any written comments filed shall be made available for public inspection. If written comments received result in a significant change in the DRAFT Permit, the permitting authority shall issue a Revised DRAFT Permit and require, if applicable, another Public Notice.

A person whose substantial interests are affected by the proposed permitting decision may petition for an administrative hearing in accordance with Sections 120.569 and 120.57, Florida Statutes (F.S.). The petition must contain the information set forth below and must be filed (received) in the Office of General Counsel of the Department of Environmental Protection, 3900 Commonwealth Boulevard, Mail Station #35, Tallahassee, Florida 32309-3000 (Telephone: 850-488-9700; Fax: 850-487-4938). Petitions filed by any persons other than those entitled to written notice under Section 120.60(3), F.S., must be filed within fourteen days of publication of the public notice or within fourteen days of receipt of that notice, regardless of the date of publication. A petitioner shall mail a copy of the petition to the applicant at the address indicated above, at the time of filing. The failure of any person to file a petition within the applicable time period shall constitute a waiver of that person's right to request an administrative determination (hearing) under Section 120.569 and 120.57, F.S., or to intervene in this proceeding and participate as a party to it. Any subsequent intervention will be only at the approval of the presiding officer upon the filing of a motion in compliance with Rule 28-106.205, Florida Administrative Code (F.A.C.). A petition that disputes the material facts on which the permitting authority's action is based must contain the following information:

- (a) The name and address of each agency affected and each agency's file or identification number, if known.
- (b) The name, address and telephone number of the petitioner; name, address and telephone number of the petitioner's representative, if any, which shall be the address for service purposes during the course of the proceeding; and an explanation of how petitioner's substantial rights will be affected by the agency determination.
- (c) A statement of how and when the petitioner received notice of the agency action or proposed action.
- (d) A statement of all disputed issues of material fact. If there is none, the petition must so state.
- (e) A concise statement of the ultimate facts alleged, as well as the rules and statutes which entitle petitioner to relief.
- (f) A statement of the specific rules or statutes the petitioner contends require reversal or modification of the agency's proposed action; and
- (g) A statement of the relief sought by the petitioner, stating precisely the action petitioner wishes the agency to take with respect to the agency's proposed action.

A petition that does not dispute the material facts upon which the permitting authority's action is based shall state that no such facts are in dispute and otherwise shall contain the same information as set forth above, as required by Rule 28-106.301, F.A.C.

Because the administrative hearing process is designed to formulate final agency action, the filing of a petition means that the permitting authority's final action may be different from the position taken by it in this notice of intent. Persons whose substantial interests will be affected by any such final decision of the permitting authority on the application have the right to petition to become a party to the proceeding in accordance with the requirements set forth above.

Mediation is not available for this proceeding.
In addition to the above, pursuant to 42 United States Code (U.S.C.) Section 7661d(b)(2), any person may petition the Administrator of the EPA within 60 (sixty) days of the expiration of the Administrator's 45 (forty-five) day review period as established at 42 U.S.C. Section 7661d(b)(1), to object to issuance of any permit renewal. Any petition shall be based only on objections to the permit renewal that were raised with reasonable specificity during the 30 (thirty) day public comment period provided in this notice, unless the petitioner demonstrates to the Administrator of the EPA that it was impracticable to raise such objections within the comment period or unless the grounds for such objection arose after the comment period. Filing of a petition with the Administrator of the EPA does not stay the effective date of any permit properly issued pursuant to the provisions of Chapter 62-213, F.A.C. Petitions filed with the Administrator of the EPA must meet the requirements of 42 U.S.C. Section 7661d(b)(2) and must be filed with the Administrator of the EPA at: U.S. EPA, 401 M Street, S.W., Washington, D.C. 20460. A complete project file is available for public inspection during normal business hours, 8:00 a.m. to 5:00 p.m. Monday through Friday, except legal holidays, at:

Department of Environmental Protection
Bureau of Air Regulation
111 S. Ashford Drive, Suite 4
Tallahassee, Florida 32301
Telephone: 850-488-0114
Fax: 850-922-6979

Department of Environmental Protection
Southwest District Office
3804 Coconut Palm Drive
Tampa, Florida 33619-8218
Telephone: 813-744-6100
Fax: 813-744-6084

The complete project file includes the DRAFT Permit, the application and the information submitted by the respondent, except all, exclusive of confidential records under Section 403.111, F.S. Interested persons may contact Scott M. Shebak, PE, at the above address or call 850-921-9532 for additional information.



Florida Power

A Progress Energy Company

Mr. Scott Sheplak, P.E.
Florida Department of Environmental
Protection
Mail Station #5505
2600 Blair Stone Road
Tallahassee FL 32399-2400

32399+2400 01



THE STATE OF FLORIDA
DEPARTMENT OF ENVIRONMENTAL PROTECTION

BUREAU OF AIR REGULATION
OCT 03 2002

RECEIVED

In the Matter of an
Application for Permit by:

OGC CASE NO.: _____

FDEP Draft Permit No.: 1030012-002-AV

Florida Power Corporation
Higgins Power Plant
Pinellas County, Florida

REQUEST FOR ENLARGEMENT OF TIME

By and through undersigned counsel, Florida Power Corporation ("FPC") hereby requests, pursuant to Florida Administrative Code Rule 62-110.106(4), an enlargement of time, to and including November 8, 2002, in which to file a Petition for Administrative Proceedings in the above-styled matter. As good cause for granting this request, FPC states the following:

1. On or about September 26, 2002, FPC received from the Department of Environmental Protection ("Department") by Certified Mail an "Intent to Issue Title V Air Operation Permit Renewal" (Draft Permit No. 1030012-002-AV) for the Higgins Power Plant, located in Pinellas County, Florida. Along with the Intent to Issue, FPC received a Draft Title V Permit Renewal and "Public Notice of Intent to Issue Title V Air Operation Permit Renewal."
2. Based on FPC's review, the Draft Permit and associated documents contain several provisions that warrant clarification or corrections.
3. This request is filed simply as a protective measure to avoid waiver of FPC's right to challenge certain conditions contained in the Draft Title V Permit. Grant of this request will

not prejudice either party, but will further their mutual interest and hopefully avoid the need to file a Petition and proceed to a formal administrative hearing. In the event all issues are resolved prior to November 8, 2002, FPC will withdraw this Request.

WHEREFORE, FPC respectfully requests that the time for filing of a Petition for Administrative Proceedings in regard to the Department's Intent to Issue Title V Air Operation Permit for Permit No. 1030012-002-AV be formally extended to and including November 8, 2002.

RESPECTFULLY SUBMITTED this 2nd day of October, 2002.

By: Robert Manning
Robert A. Manning
Florida Bar ID No. 0035173
Hopping Green & Sams, P.A.
123 South Calhoun Street
Post Office Box 6526
Tallahassee, Florida 32314
(850) 222-7500
(850) 224-8551 Facsimile


Attorneys for FLORIDA POWER CORPORATION

CERTIFICATE OF SERVICE

I HEREBY CERTIFY that a true and correct copy of the foregoing has been furnished to the following by U.S. Mail this 2nd day of October, 2002:

Scott Sheplak, P.E. Administrator
Bureau of Air Regulation
Department of Environmental Protection
2600 Blair Stone Road, MS 5505
Tallahassee, FL 32399-2400


W. Douglas Beason
Office of the General Counsel
Department of Environmental Protection
3900 Commonwealth Blvd., Room 353-A
Tallahassee, FL 32399-2600

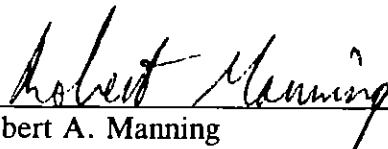

Robert A. Manning

10/4/02 cc: Ed Svec
Scott Sheplak

HOPPING GREEN & SAMS
PROFESSIONAL ASSOCIATION
POST OFFICE BOX 6526
TALLAHASSEE, FLORIDA 32314

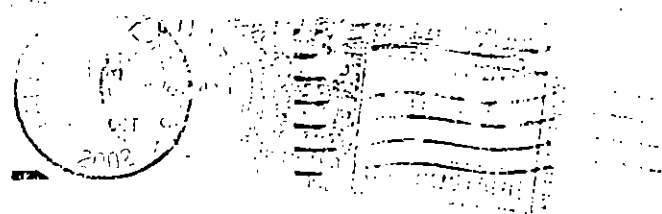



Scott Sheplak, P.E. Administrator
Bureau of Air Regulation
Florida Dept. Of Environmental Protection
2600 Blair Stone Rd., MS 5505
Tallahassee, FL 32399-2400

32399+2400 

Memorandum

Florida Department of
Environmental Protection

TO: Al Linero 
THRU: Scott Sheplak
FROM: Edward Svec 
DATE: September 20, 2002
SUBJECT: Florida Power
Title V Permit Renewal
1030012-002-AV


Attached for approval and signature is the intent to issue a Title V permit renewal for the Higgins Power Plant. No changes were requested from the initial Title V permit.

September 20, 2002 is day 45 of the 90 day timeclock.

Attachments

/es

Florida's DRAFT Permit Electronic Notification Cover Memorandum


TO: Gracy Danois, U.S. EPA Region 4
CC: Gregg Worley, U.S. EPA Region 4
THRU: Scott Sheplak P.E., Bureau of Air Regulation
FROM: Edward J. Svec, Permit Engineer 
DATE: 09/23/02
RE: U.S. EPA Region 4 DRAFT Title V Operation Permit Renewal Review

The following DRAFT Title V operation permit(s) and associated documents have been posted on the DEP World Wide Web Internet site for your review. The DRAFT permit is for the renewal of Florida Power, Higgins Power Plant. Please provide any comments via Internet E-mail, to Scott Sheplak, at "Sheplak_S@dep.state.fl.us".

<u>Applicant Name</u>	<u>County</u>	<u>Method of Transmittal</u>	<u>Electronic File Name(s)</u>
Florida Power Higgins Power Plant	Pinellas	INTERNET	1030012-002-AVd.zip

This zipped file contains the following electronic files:

sob.doc
1030012i.doc
1030012d.doc
10300121.doc
10300122.doc
1030012g.doc
1030012u.doc
1030012h.doc

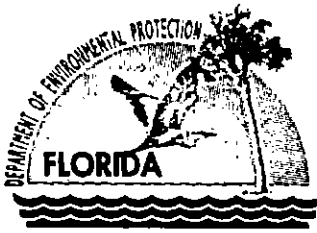

Jeb Bush
Governor

Department of Environmental Protection

Twin Towers Office Building
2600 Blair Stone Road
Tallahassee, Florida 32399-2400

David B. Struhs
Secretary


P.E. Certification Statement

Permittee:
Florida Power Corporation
Higgins Power Plant

DRAFT Permit No.: 1030012-002-AV

Project type: Title V Air Operation Permit Renewal

I HEREBY CERTIFY that the engineering features described in the above referenced application and subject to the proposed permit conditions provide reasonable assurance of compliance with applicable provisions of Chapter 403, Florida Statutes, and Florida Administrative Code Chapters 62-4 and 62-204 through 62-297. However, I have not evaluated and I do not certify aspects of the proposal outside of my area of expertise (including but not limited to the electrical, mechanical, structural, hydrological, and geological features).


Scott M. Sheplak 09/23/02
Scott M. Sheplak, P.E. date
Registration Number: 48866

Permitting Authority:
Department of Environmental Protection
Bureau of Air Regulation
111 South Magnolia Drive, Suite 4
Tallahassee, Florida 32301
Telephone: 850/488-0144
Fax: 850/922-6979

SENDER: COMPLETE THIS SECTION

- Complete items 1, 2, and 3. Also complete item 4 if Restricted Delivery is desired.
- Print your name and address on the reverse so that we can return the card to you.
- Attach this card to the back of the mailpiece, or on the front if space permits.

1. Article Addressed to
 Mr. Michael W. Lentz
 Plant Manager Higgins
 Florida Power
 100 Central Avenue,
 Mail Code BP44
 St. Petersburg, FL 33701

2. Article Number (Copy from service label)
 7000 0600 0021 6524 3011

PS Form 3811, July 1999

Domestic Return Receipt

102595-00-M-0952

COMPLETE THIS SECTION ON DELIVERY

A. Received by (Please Print Clearly) B. Date of Delivery

C. Signature Agent AddresseeD. Is delivery address different from item 1? Yes No
 If YES, enter delivery address below:

3. Service Type
 Certified Mail Express Mail
 Registered Return Receipt for Merchandise
 Insured Mail C.O.D.

4. Restricted Delivery? (Extra Fee) Yes
U.S. Postal Service
CERTIFIED MAIL RECEIPT
 (Domestic Mail Only; No Insurance Coverage Provided)

Article Sent To:

Mr. Michael W. Lentz

Postage \$

Certified Fee

Return Receipt Fee
(Endorsement Required)Restricted Delivery Fee
(Endorsement Required)

Total Postage & Fees \$

Postmark
Here

Name (Please Print Clearly) (to be completed by mailer)

Mr. Michael W. Lentz

Street, Apt. No., or PO Box No.

100 Central Avenue, Mail Code BP44


City, State, ZIP+4

St. Petersburg, Florida 33701

PS Form 3800, July 1999

See Reverse for Instructions

7000 0600 0021 6524 3011

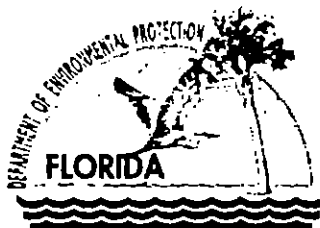

Jeb Bush
Governor

Department of Environmental Protection

Twin Towers Office Building
2600 Blair Stone Road
Tallahassee, Florida 32399-2400

David B. Struhs
Secretary

September 23, 2002

Mr. Michael W. Lentz
Plant Manager Higgins
Florida Power
100 Central Avenue, Mail Code BP44
St. Petersburg, Florida 33701

Re: Title V Air Operation Permit Renewal
DRAFT Permit No.: 1030012-002-AV
Higgins Power Plant

Dear Mr. Lentz:

One copy of the DRAFT Permit for the Title V Air Operation Permit Renewal for the Higgins Power Plant located at 998 East Shore Drive, Oldsmar, Pinellas County, is enclosed. The permitting authority's "INTENT TO ISSUE TITLE V AIR OPERATION PERMIT RENEWAL" and the "PUBLIC NOTICE OF INTENT TO ISSUE TITLE V AIR OPERATION PERMIT RENEWAL" are also included.

The "PUBLIC NOTICE OF INTENT TO ISSUE TITLE V AIR OPERATION PERMIT" must be published as soon as possible. Please expedite your review of this DRAFT permit, because of the requirement that all Title V permits with Acid Rain Parts must *have an effective date of January 1*". To stay on this schedule, the Public Notice should be published by October 3, 2002. Proof of publication, i.e., newspaper affidavit, must be provided to the permitting authority's office within 7 (seven) days of publication pursuant to Rule 62-110.106(5), F.A.C. Failure to publish the notice and provide proof of publication within the allotted time may result in the denial of the permit pursuant to Rule 62-110.106(11), F.A.C.

Please submit any written comments you wish to have considered concerning the permitting authority's proposed action to Scott M. Sheplak, P.E., at the above letterhead address. If you have any other questions, please contact Edward J. Svec, at 850/921-8985.

Sincerely,

A. A. Linero, P.E.
Bureau of Air Regulation

AAL/es

Enclosures

"More Protection, Less Process"

Printed on recycled paper.

In the Matter of an
Application for Permit Renewal by:

Florida Power
100 Central Avenue, Mail Code BP44
St. Petersburg, Florida 33701

DRAFT Permit No.: 1030012-002-AV
Higgins Power Plant
Pinellas County

INTENT TO ISSUE TITLE V AIR OPERATION PERMIT RENEWAL

The Department of Environmental Protection (permitting authority) gives notice of its intent to issue a Title V Air Operation Permit Renewal (copy of DRAFT Permit attached) for the Title V source detailed in the application specified above, for the reasons stated below. This is a renewal to Title V Air Operation Permit No. 1030012-001-AV.

The applicant, Florida Power applied on July 3, 2002, to the permitting authority for a Title V Air Operation Permit Renewal for the Higgins Power Plant located at 998 East Shore Drive, Oldsmar, Pinellas County.

The permitting authority has permitting jurisdiction under the provisions of Chapter 403, Florida Statutes (F.S.), and Florida Administrative Code (F.A.C.) Chapters 62-4, 62-210, 62-213 and 62-214. This source is not exempt from Title V permitting procedures. The permitting authority has determined that a Title V Air Operation Permit Renewal is required to commence or continue operations at the described facility.

The permitting authority intends to issue this Title V Air Operation Permit Renewal based on the belief that reasonable assurances have been provided to indicate that operation of the source will not adversely impact air quality, and the source will comply with all appropriate provisions of Chapters 62-4, 62-204, 62-210, 62-212, 62-213, 62-214, 62-256, 62-257, 62-281, 62-296, and 62-297, F.A.C.

Pursuant to Sections 403.815 and 403.087, F.S., and Rules 62-110.106 and 62-210.350(3), F.A.C., you (the applicant) are required to publish at your own expense the enclosed "**PUBLIC NOTICE OF INTENT TO ISSUE TITLE V AIR OPERATION PERMIT RENEWAL**." The notice shall be published one time only as soon as possible in the legal advertisement section of a newspaper of general circulation in the area affected. For the purpose of these rules, "publication in a newspaper of general circulation in the area affected" means publication in a newspaper meeting the requirements of Sections 50.011 and 50.031, F.S., in the county where the activity is to take place. Where there is more than one newspaper of general circulation in the county, the newspaper used must be one with significant circulation in the area that may be affected by the permit renewal. If you are uncertain that a newspaper meets these requirements, please contact the permitting authority at the address or telephone number

listed below. The applicant shall provide proof of publication to the Department's Bureau of Air Regulation, 2600 Blair Stone Road, Mail Station #5505, Tallahassee, Florida 32399-2400 (Telephone: 850/488-1344; Fax: 850/922-6979), within 7 (seven) days of publication. Failure to publish the notice and provide proof of publication within the allotted time may result in the denial of the permit renewal pursuant to Rule 62-110.106, F.A.C.

The permitting authority will issue the PROPOSED Permit, and subsequent FINAL Permit, in accordance with the conditions of the attached DRAFT Permit unless a response received in accordance with the following procedures results in a different decision or significant change of terms or conditions.

The permitting authority will accept written comments concerning the proposed permit renewal issuance action for a period of 30 (thirty) days from the date of publication of the "PUBLIC NOTICE OF INTENT TO ISSUE TITLE V AIR OPERATION PERMIT RENEWAL." Written comments should be provided to the permitting authority office. Any written comments filed shall be made available for public inspection. If written comments received result in a significant change in this DRAFT Permit, the permitting authority shall issue a Revised DRAFT Permit and require, if applicable, another Public Notice.

A person whose substantial interests are affected by the proposed permitting decision may petition for an administrative hearing in accordance with Sections 120.569 and 120.57, F.S. The petition must contain the information set forth below and must be filed (received) in the Office of General Counsel of the Department of Environmental Protection, 3900 Commonwealth Boulevard, Mail Station #35, Tallahassee, Florida 32399-3000 (Telephone: 850/488-9730; Fax: 850/487-4938). Petitions filed by the permit renewal applicant or any of the parties listed below must be filed within fourteen days of receipt of this notice of intent. Petitions filed by any persons other than those entitled to written notice under Section 120.60(3), F.S., must be filed within fourteen days of publication of the public notice or within fourteen days of receipt of this notice of intent, whichever occurs first. Under Section 120.60(3), F.S., however, any person who asked the permitting authority for notice of agency action may file a petition within fourteen days of receipt of that notice, regardless of the date of publication. A petitioner shall mail a copy of the petition to the applicant at the address indicated above, at the time of filing. The failure of any person to file a petition within the appropriate time period shall constitute a waiver of that person's right to request an administrative determination (hearing) under Sections 120.569 and 120.57, F.S., or to intervene in this proceeding and participate as a party to it. Any subsequent intervention will be only at the approval of the presiding officer upon the filing of a motion in compliance with Rule 28-106.205, F.A.C.

A petition that disputes the material facts on which the permitting authority's action is based must contain the following information:

(a) The name and address of each agency affected and each agency's file or identification number, if known;

(b) The name, address, and telephone number of the petitioner; the name, address and telephone number of the petitioner's representative, if any, which shall be the address for service purposes during the course of the proceeding; and an explanation of how the petitioner's substantial interests will be affected by the agency determination;

(c) A statement of how and when each petitioner received notice of the agency action or proposed action;

(d) A statement of all disputed issues of material fact. If there are none, the petition must so indicate;

(e) A concise statement of the ultimate facts alleged, as well as the rules and statutes which entitle the petitioner to relief;

(f) A statement of the specific rules or statutes the petitioner contends require reversal or modification of the agency's proposed action; and,

(g) A statement of the relief sought by the petitioner, stating precisely the action petitioner wishes the agency to take with respect to the agency's proposed action.

A petition that does not dispute the material facts upon which the permitting authority's action is based shall state that no such facts are in dispute and otherwise shall contain the same information as set forth above, as required by Rule 28-106.301, F.A.C.

Because the administrative hearing process is designed to formulate final agency action, the filing of a petition means that the permitting authority's final action may be different from the position taken by it in this notice of intent. Persons whose substantial interests will be affected by any such final decision of the permitting authority on the application have the right to petition to become a party to the proceeding, in accordance with the requirements set forth above.

Mediation will not be available in this proceeding.

In addition to the above, a person subject to regulation has a right to apply to the Department of Environmental Protection for a variance from or waiver of the requirements of particular rules, on certain conditions, under Section 120.542, F.S. The relief provided by this state statute applies only to state rules, not statutes, and not to any federal regulatory requirements. Applying for a variance or waiver does not substitute or extend the time for filing a petition for an administrative hearing or exercising any other right that a person may have in relation to the action proposed in this notice of intent.

The application for a variance or waiver is made by filing a petition with the Office of General Counsel of the Department of Environmental Protection, 3900 Commonwealth Boulevard, Mail Station #35, Tallahassee, Florida 32399-3000. The petition must specify the following information:

(a) The name, address, and telephone number of the petitioner;

(b) The name, address, and telephone number of the attorney or qualified representative of the petitioner, if any;

(c) Each rule or portion of a rule from which a variance or waiver is requested;

(d) The citation to the statute underlying (implemented by) the rule identified in (c) above;

(e) The type of action requested;

(f) The specific facts that would justify a variance or waiver for the petitioner;

(g) The reason why the variance or waiver would serve the purposes of the underlying statute (implemented by the rule); and,

(h) A statement whether the variance or waiver is permanent or temporary and, if temporary, a statement of the dates showing the duration of the variance or waiver requested.

The Department will grant a variance or waiver when the petition demonstrates both that the application of the rule would create a substantial hardship or violate principles of fairness, as each of those terms is defined in Section 120.542(2), F.S., and that the purpose of the underlying statute will be or has been achieved by other means by the petitioner.

Persons subject to regulation pursuant to any federally delegated or approved air program should be aware that Florida is specifically not authorized to issue variances or waivers from any requirements of any such federally delegated or approved program. The requirements of the program remain fully enforceable by the Administrator of the United States Environmental Protection Agency and by any person under the Clean Air Act unless and until the Administrator separately approves any variance or waiver in accordance with the procedures of the federal program.

Finally, pursuant to 42 United States Code (U.S.C.) Section 7661d(b)(2), any person may petition the Administrator of the EPA within 60 (sixty) days of the expiration of the Administrator's 45 (forty-five) day review period as established at 42 U.S.C. Section 7661d(b)(1), to object to issuance of any permit renewal. Any petition shall be based only on objections to the permit renewal that were raised with reasonable specificity during the 30 (thirty) day public comment period provided in this notice, unless the petitioner demonstrates to the Administrator of the EPA that it was impracticable to raise such objections within the comment period or unless the grounds for such objection arose after the comment period. Filing of a petition with the Administrator of the EPA does not stay the effective date of any permit properly issued pursuant to the provisions of Chapter 62-213, F.A.C. Petitions filed with the Administrator of EPA must meet the requirements of 42 U.S.C. Section 7661d(b)(2) and must be filed with the Administrator of the EPA at: U.S. EPA, 401 M Street, S.W., Washington, D.C. 20460.

Executed in Tallahassee, Florida.

**STATE OF FLORIDA DEPARTMENT
OF ENVIRONMENTAL PROTECTION**



A. A. Linero, P.E.
Bureau of Air Regulation

CERTIFICATE OF SERVICE

The undersigned duly designated deputy agency clerk hereby certifies that this INTENT TO ISSUE TITLE V AIR OPERATION PERMIT RENEWAL (including the PUBLIC NOTICE and the DRAFT Permit) and all copies were sent by certified mail before the close of business on 9/24/02 to the person(s) listed:

Michael Lentz, Plant Manager Higgins, Florida Power

In addition, the undersigned duly designated deputy agency clerk hereby certifies that copies of this INTENT TO ISSUE TITLE V AIR OPERATION PERMIT RENEWAL (including the PUBLIC NOTICE and the Statement of Basis) were sent by U.S. mail on the same date to the person(s) listed or as otherwise noted:

Kennard Kosky, PE, Golder Associates Inc.

In addition, the undersigned duly designated deputy agency clerk hereby certifies that copies of this INTENT TO ISSUE TITLE V AIR OPERATION PERMIT RENEWAL (including the DRAFT Permit package) were sent by INTERNET E-mail on the same date to the person(s) listed:

Gerald Kissel, PE, FDEP SWD
Peter Hessling, PCDEM AQD
U.S. EPA, Region 4

9/24/02 cc: Ed Spec
Reading File

Clerk Stamp

FILING AND ACKNOWLEDGMENT FILED, on this date, pursuant to Section 120.52(7), Florida Statutes, with the designated agency Clerk, receipt of which is hereby acknowledged.

Barbara J. Friday 9/24/02
(Clerk) (Date)

PUBLIC NOTICE OF INTENT TO ISSUE TITLE V AIR OPERATION PERMIT RENEWAL

Department of Environmental Protection

Title V Air Operation Permit Renewal
DRAFT Permit No.: 1030012-002-AV

Florida Power
Pinellas County

The Department of Environmental Protection (permitting authority) gives notice of its intent to issue a Title V Air Operation Permit Renewal to Florida Power for Higgins Power Plant located at 998 East Shore Drive, Oldsmar, Pinellas County. This is a renewal to Title V Air Operation Permit No. 1030012-001-AV. The applicant's name and address are: Florida Power, Michael Lentz, Plant Manager Higgins, 100 Central Avenue, Mail Code BP44, St. Petersburg, Florida 33701.

The permitting authority will issue the PROPOSED Permit, and subsequent FINAL Permit, in accordance with the conditions of the DRAFT Permit unless a response received in accordance with the following procedures results in a different decision or significant change of terms or conditions.

The permitting authority will accept written comments concerning the proposed DRAFT Permit issuance action for a period of 30 (thirty) days from the date of publication of this Notice. Written comments should be provided to the Department's Bureau of Air Regulation, 2600 Blair Stone Road, Mail Station #5505, Tallahassee, Florida 32399-2400. Any written comments filed shall be made available for public inspection. If written comments received result in a significant change in this DRAFT Permit, the permitting authority shall issue a Revised DRAFT Permit and require, if applicable, another Public Notice.

A person whose substantial interests are affected by the proposed permitting decision may petition for an administrative hearing in accordance with Sections 120.569 and 120.57, Florida Statutes (F.S.). The petition must contain the information set forth below and must be filed (received) in the Office of General Counsel of the Department of Environmental Protection, 3900 Commonwealth Boulevard, Mail Station #35, Tallahassee, Florida 32399-3000 (Telephone: 850/488-9730; Fax: 850/487-4938). Petitions filed by any persons other than those entitled to written notice under Section 120.60(3), F.S., must be filed within fourteen days of publication of the public notice or within fourteen days of receipt of the notice of intent, whichever occurs first. Under Section 120.60(3), F.S., however, any person who asked the permitting authority for notice of agency action may file a petition within fourteen days of receipt of that notice, regardless of the date of publication. A petitioner shall mail a copy of the petition to the applicant at the address indicated above, at the time of filing. The failure of any person to file a petition within the applicable time period shall constitute a waiver of that person's right to request an administrative determination (hearing) under Sections 120.569 and 120.57, F.S., or to intervene in this proceeding and participate as a party to it. Any subsequent intervention will be only at the approval of the presiding officer upon the filing of a motion in compliance with Rule 28-106.205, Florida Administrative Code (F.A.C.).

A petition that disputes the material facts on which the permitting authority's action is based must contain the following information:

(a) The name and address of each agency affected and each agency's file or identification number, if known;

(b) The name, address and telephone number of the petitioner; name address and telephone number of the petitioner's representative, if any, which shall be the address for service purposes during the course of the proceeding; and an explanation of how petitioner's substantial rights will be affected by the agency determination;

(c) A statement of how and when the petitioner received notice of the agency action or proposed action;

(d) A statement of all disputed issues of material fact. If there are none, the petition must so state;

(e) A concise statement of the ultimate facts alleged, as well as the rules and statutes which entitle petitioner to relief;

(f) A statement of the specific rules or statutes the petitioner contends require reversal or modification of the agency's proposed action; and,

(g) A statement of the relief sought by the petitioner, stating precisely the action petitioner wishes the agency to take with respect to the agency's proposed action.

A petition that does not dispute the material facts upon which the permitting authority's action is based shall state that no such facts are in dispute and otherwise shall contain the same information as set forth above, as required by Rule 28-106.301, F.A.C.

Because the administrative hearing process is designed to formulate final agency action, the filing of a petition means that the permitting authority's final action may be different from the position taken by it in this notice of intent. Persons whose substantial interests will be affected by any such final decision of the permitting authority on the application have the right to petition to become a party to the proceeding, in accordance with the requirements set forth above.

Mediation is not available for this proceeding.

In addition to the above, pursuant to 42 United States Code (U.S.C.) Section 7661d(b)(2), any person may petition the Administrator of the EPA within 60 (sixty) days of the expiration of the Administrator's 45 (forty-five) day review period as established at 42 U.S.C. Section 7661d(b)(1), to object to issuance of any permit renewal. Any petition shall be based only on objections to the permit renewal that were raised with reasonable specificity during the 30 (thirty) day public comment period provided in this notice, unless the petitioner demonstrates to the Administrator of the EPA that it was impracticable to raise such objections within the comment period or unless the grounds for such objection arose after the comment period. Filing of a petition with the Administrator of the EPA does not stay the effective date of any permit properly issued pursuant to the provisions of Chapter 62-213, F.A.C. Petitions filed with the Administrator of EPA must meet the requirements of 42 U.S.C. Section 7661d(b)(2) and must be filed with the Administrator of the EPA at: U.S. EPA, 401 M Street, S.W., Washington, D.C. 20460.

A complete project file is available for public inspection during normal business hours, 8:00 a.m. to 5:00 p.m., Monday through Friday, except legal holidays, at:

Department of Environmental Protection
Bureau of Air Regulation
111 S. Magnolia Drive, Suite 4
Tallahassee, Florida, 32301
Telephone: 850/488-0114
Fax: 850/922-6979

Department of Environmental Protection
Southwest District Office
3804 Coconut Palm Drive
Tampa, Florida 33619-8218
Telephone: 813/744-6100
Fax: 813/744-6084

The complete project file includes the DRAFT Permit, the application, and the information submitted by the responsible official, exclusive of confidential records under Section 403.111, F.S. Interested persons may contact Scott M. Sheplak, P.E., at the above address, or call 850/921-9532, for additional information.

STATEMENT OF BASIS

Florida Power
Higgins Power Plant
Facility ID No.: 1030012
Pinellas County

Title V Air Operation Permit Renewal
DRAFT Permit Project No.: 1030012-002-AV
Renewal of Title V Air Operation Permit No.: 1030012-001-AV

The initial Title V Air Operation Permit, No. 1030012-001-AV, was effective on January 1, 1998. This Title V Air Operation Permit Renewal is issued under the provisions of Chapter 403, Florida Statutes (F.S.), and Florida Administrative Code (F.A.C.) Chapters 62-4, 62-210 and 62-213. The above named permittee is hereby authorized to operate the facility shown on the application and approved drawing(s), plans, and other documents, attached hereto or on file with the permitting authority, in accordance with the terms and conditions of this permit.

The subject of this permit is for the renewal of Title V Air Operation Permit, No. 1030012-001-AV.

This facility consists of three fossil fuel fired steam generators (SG) and four simple cycle combustion turbine peaking units (CTP), all of which are pre-NSPS sources. The SGs are on long-term reserve shutdown. The CTPs and SGs are pre-NSPS sources. Each CT and SG exhausts through a separate stack. Relocatable diesel fired generator(s) with a maximum heat input of 25.74 MMBtu/hour and a maximum rating of 2460 Kilowatts may be relocated to this and six other Florida Power facilities.

Fossil Fuel Fired Steam Generators SG 1, SG 2, and SG 3 were all placed on "Long Term Reserve Shutdown" on January 24, 1994 (Rule 62-210.300(2)(a)3.d., F.A.C.). The maximum permitted heat input rates for SG 1, SG 2, and SG 3 are 548, 523, and 548 MMBtu/ hour, respectively. The emissions units are fired on new No. 6 or lighter grades of fuel oil, as permitted herein. Natural gas and on-specification used oil, as permitted herein, may be fired in these emissions units as an alternate fuel. SG 1, SG 2, and SG 3 generate steam to power turbines that drive generators with name plate ratings of 43, 42, and 41 megawatts, respectively. These units are regulated under the Acid Rain Program, Phase II. Each SG exhausts through a single stack. Emissions from these units are uncontrolled. The combustion turbine peaking units (CTPs) may only fire new No. 2 fuel oil or natural gas having a maximum sulfur content of 0.5 percent, by weight, and 1 grain per 100 dry standard cubic feet (dscf), respectively. CTP 1 and CTP 2 have a maximum heat input of 566 MMBtu/hour at 59° F and each powers a generator rated at 37.0 MW (megawatts of electricity). CTP 3 and CTP 4 have a maximum heat input of 631 MMBtu/hour at 59° F and each powers a generator rated at 42.9 MW (megawatts of electricity). Emissions are not controlled and each turbine exhausts through a separate stack. These emissions units are pre-NSPS and not subject to the Acid Rain Program. CTP 1, CTP 2, CTP 3, and CTP 4 began commercial service on March 15, 1969, April 12, 1969, December 1, 1970, and January 9, 1971, respectively. The relocatable diesel generator(s) will have a maximum (combined) heat input of 25.74 MMBtu/hour while being fueled by 186.3 gallons of new No. 2 fuel oil per hour with a maximum (combined) rating of 2460 kilowatts. Emissions from the generator(s) are uncontrolled. These conditions were requested in the Initial Title V Permit Application for the Anclote Power Plant received June 14, 1996. The generator(s) began commercial operation on August 10, 1994. CAM does not apply.

Also included in this permit are miscellaneous unregulated/insignificant emissions units and/or activities.

Based on the Title V Air Operation Permit Renewal application received July 3, 2002, this facility is not a major source of hazardous air pollutants (HAPs).

Florida Power
Higgins Power Plant
Facility ID No.: 1030012
Pinellas County

Title V Air Operation Permit Renewal

DRAFT Permit Project No.: 1030012-002-AV
Renewal of Title V Air Operation Permit No.: 1030012-001-AV

Permitting Authority:

State of Florida
Department of Environmental Protection
Division of Air Resources Management
Bureau of Air Regulation
Title V Section
Telephone: 850/488-0114
Fax: 850/922-6979

Compliance Authority:


Pinellas County Department of Environmental Management
Air Quality Division
300 South Garden Avenue
Clearwater, Florida 34616
Telephone: 813/464-4422
Fax: 813/464-4420

Title V Air Operation Permit Renewal

DRAFT Permit Project No.: 1030012-002-AV
Renewal of Title V Air Operation Permit No.: 1030012-001-AV

Table of Contents

<u>Section</u>	<u>Page Number</u>
Placard Page	1
I. Facility Information	2 - 3
A. Facility Description.	
B. Summary of Emissions Unit ID No(s). and Brief Description(s).	
C. Relevant Documents.	
II. Facility-wide Conditions	4 - 6
III. Emissions Unit(s) and Conditions	
A. Fossil Fuel Fired Steam Generators	7-20
B. Combustion Turbine Peaking Units	21-25
C. Relocatable Diesel Fired Generator(s)	26-31
IV. Acid Rain Program	
A. Acid Rain, Phase II.....	32 - 33

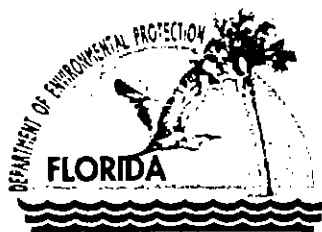

Jeb Bush
Governor

Department of Environmental Protection

Twin Towers Office Building
2600 Blair Stone Road
Tallahassee, Florida 32399-2400

David B. Struhs
Secretary

Permittee:

Florida Power
100 Central Avenue, Mail Code BP44
St. Petersburg, Florida 33701

DRAFT Permit No.: 1030012-002-AV

Facility ID No.: 1030012

SIC No(s).: 49

Project: Title V Air Operation Permit Renewal

The purpose of this permit is to renew Title V Air Operation Permit, No. 1030012-001-AV for the Higgins Power Plant. This existing facility is located at 998 East Shore Drive, Oldsmar, Pinellas County; UTM Coordinates: Zone 17, 336.5 km East and 3098.4 km North; Latitude: 28° 00' 02" North and Longitude: 82° 39' 46" West.

This Title V Air Operation Permit Renewal is issued under the provisions of Chapter 403, Florida Statutes (F.S.), and Florida Administrative Code (F.A.C.) Chapters 62-4, 62-210 and 62-213. The above named permittee is hereby authorized to operate the facility shown on the application and approved drawing(s), plans, and other documents, attached hereto or on file with the permitting authority, in accordance with the terms and conditions of this permit.

Referenced attachments made a part of this permit:

Appendix U-1, List of Unregulated Emissions Units and/or Activities

Appendix I-1, List of Insignificant Emissions Units and/or Activities

APPENDIX TV-4, TITLE V CONDITIONS version dated 02/12/02

APPENDIX SS-1, STACK SAMPLING FACILITIES version dated 10/07/96

Alternate Sampling Procedure: ASP Number 97-B-01

OGC File Nos. 86-1580, 86-1581, 86-1582 dated December 11, 1986.

Effective Date: January 1, 2003

Renewal Application Due Date: July 5, 2007

Expiration Date: December 31, 2007

Howard L. Rhodes, Director
Division of Air Resource
Management

HLR/sms/es

"More Protection, Less Process"

Printed on recycled paper.

Section I. Facility Information.

Subsection A. Facility Description.

This facility consists of three fossil fuel fired steam generators (SG) and four simple cycle combustion turbine peaking units (CTP), all of which are pre-NSPS sources. The SGs are on long-term reserve shutdown. The CTPs and SGs are pre-NSPS sources. Each CT and SG exhausts through a separate stack. Relocatable diesel fired generator(s) with a maximum heat input of 25.74 MMBtu/hour and a maximum rating of 2460 Kilowatts may be relocated to this and six other Florida Power facilities.

Also included in this permit are miscellaneous unregulated/insignificant emissions units and/or activities.

Based on the Title V Air Operation Permit Renewal application received July 3, 2002, this facility is not a major source of hazardous air pollutants (HAPs).

Subsection B. Summary of Emissions Unit ID No(s). and Brief Description(s).

<u>E.U. ID No.</u>	<u>Brief Description</u>
-001 - 003	3 - Fossil Fuel Fired Steam Generators (Pre-NSPS) - SG 1, SG 2, & SG 3
-004 - 007	4 - Combustion Turbine Peaking Units (Pre-NSPS) - CTP 1, CTP 2, CTP 3, & CTP 4
7775047 -001	Relocatable Diesel Generator(s)

Unregulated Emissions Units and/or Activities

-009	General Purpose Engines
-010	Fuel Storage Tanks
-011	Emergency Generator

Please reference the Permit No., Facility ID No., and appropriate Emissions Unit(s) ID No(s). on all correspondence, test report submittals, applications, etc.

Subsection C. Relevant Documents.

The documents listed below are not a part of this permit; however, they are specifically related to this permitting action.

These documents are provided to the permittee for information purposes only:

- Table 1-1: Summary of Air Pollutant Standards and Terms
- Table 2-1: Summary of Compliance Requirements
- Appendix A-1, Abbreviations, Acronyms, Citations, and Identification Numbers
- Appendix H-1, Permit History
- Statement of Basis

These documents are on file with the permitting authority:

Initial Title V Air Operation Permit effective January 1, 1998

Application for a Title V Air Operation Permit Renewal received July 3, 2002

Additional Information Request dated July 25, 2002

Additional Information Response received August 7, 2002

Subsection D. Miscellaneous.

The use of 'Permitting Notes' throughout this permit are for informational purposes only and are not permit conditions.

Section II. Facility-wide Conditions.

The following conditions apply facility-wide:

1. APPENDIX TV-4, TITLE V CONDITIONS, is a part of this permit.
{Permitting note: APPENDIX TV-4, TITLE V CONDITIONS, is distributed to the permittee only. Other persons requesting copies of these conditions shall be provided a copy when requested or otherwise appropriate.}
2. **Not federally enforceable.** General Pollutant Emission Limiting Standards. Objectionable Odor Prohibited. No person shall cause, suffer, allow, or permit the discharge of air pollutants which cause or contribute to an objectionable odor.
[Rule 62-296.320(2), F.A.C.]
3. General Particulate Emission Limiting Standards. General Visible Emissions Standard. Except for emissions units that are subject to a particulate matter or opacity limit set forth or established by rule and reflected by conditions in this permit, no person shall cause, let, permit, suffer or allow to be discharged into the atmosphere the emissions of air pollutants from any activity, the density of which is equal to or greater than that designated as Number 1 on the Ringelmann Chart (20 percent opacity). EPA Method 9 is the method of compliance pursuant to Chapter 62-297, F.A.C.
[Rules 62-296.320(4)(b)1. & 4., F.A.C.]
4. Prevention of Accidental Releases (Section 112(r) of CAA).
 - a. The permittee shall submit its Risk Management Plan (RMP) to the Chemical Emergency Preparedness and Prevention Office (CEPPO) RMP Reporting Center when, and if, such requirement becomes applicable. Any Risk Management Plans, original submittals, revisions or updates to submittals, should be sent to:

RMP Reporting Center
Post Office Box 3346
Merrifield, VA 22116-3346
Telephone: 703/816-4434
 - and,
 - b. The permittee shall submit to the permitting authority Title V certification forms or a compliance schedule in accordance with Rule 62-213.440(2), F.A.C.
[40 CFR 68]
5. Unregulated Emissions Units and/or Activities. Appendix U-1, List of Unregulated Emissions Units and/or Activities, is a part of this permit.
[Rule 62-213.440(1), F.A.C.]
6. Insignificant Emissions Units and/or Activities. Appendix I-1, List of Insignificant Emissions Units and/or Activities, is a part of this permit.
[Rules 62-213.440(1), 62-213.430(6) and 62-4.040(1)(b), F.A.C.]

7. General Pollutant Emission Limiting Standards, Volatile Organic Compounds Emissions or Organic Solvents Emissions. The permittee shall allow no person to store, pump, handle, process, load, unload or use in any process or installation, volatile organic compounds or organic solvents without applying known and existing vapor emission control devices or systems deemed necessary and ordered by the Department. **Nothing was deemed necessary and ordered at this time.**

[Rule 62-296.320(1)(a), F.A.C.]

8. **Not federally enforceable.** Reasonable precautions to prevent emissions of unconfined particulate matter at this facility include: Maintenance of paved areas as needed, Regular mowing of grass and care of vegetation, and Limiting access to plant property by unnecessary vehicles.

[Rule 62-296.320(4)(c)2., F.A.C. and proposed by applicant in the Title V permit renewal application received July 3, 2002.]

9. When appropriate, any recording, monitoring, or reporting requirements that are time-specific shall be in accordance with the effective date of the permit, which defines day one.

[Rule 62-213.440, F.A.C.]

10. Statement of Compliance. The annual statement of compliance pursuant to Rule 62-213.440(3)(a)2., F.A.C., shall be submitted to the Department and EPA within 60 (sixty) days after the end of the calendar year using DEP Form No. 62-213.900(7), F.A.C.

[Rules 62-213.440(3) and 62-213.900, F.A.C.]

{Permitting Note: This condition implements the requirements of Rules 62-213.440(3)(a)2. & 3., F.A.C. (see Condition 51. of APPENDIX TV-4, TITLE V CONDITIONS.)}

11. The permittee shall submit all compliance related notifications and reports required of this permit to the Air Quality Division of the Pinellas County Department of Environmental Management:

Pinellas County Department of Environmental Management
Air Quality Division
300 South Garden Avenue
Clearwater, Florida 33756
Telephone: 813/464-4422
Fax: 813/464-4420

12. Any reports, data, notifications, certifications, and requests required to be sent to the United States Environmental Protection Agency, Region 4, should be sent to:

United States Environmental Protection Agency
Region 4
Air, Pesticides & Toxics Management Division
Air and EPCRA Enforcement Branch
Air Enforcement Section
61 Forsyth Street
Atlanta, Georgia 30303-8960
Telephone: 404/562-9155; Fax: 404/562-9163

13. Certification by Responsible Official (RO). In addition to the professional engineering certification required for applications by Rule 62-4.050(3), F.A.C., any application form, report, compliance statement, compliance plan and compliance schedule submitted pursuant to Chapter 62-213, F.A.C., shall contain a certification signed by a responsible official that, based on information and belief formed after reasonable inquiry, the statements and information in the document are true, accurate, and complete. Any responsible official who fails to submit any required information or who has submitted incorrect information shall, upon becoming aware of such failure or incorrect submittal, promptly submit such supplementary information or correct information.

[Rule 62-213.420(4), F.A.C.]

14. Subsection C of Section III addresses specific conditions for a Relocatable Diesel Fired Generator(s) that may be relocated to this and five other FPC facilities. These specific conditions, requested in the Initial Title V Permit Application for the Anclote Power Plant received June 14, 1996, will become active and enforceable when FPC has notified the Department (as per specific condition III.C.24) that the relocatable generator(s) will be relocated to the Higgins Power Plant.

[AO 09-205952; and, Initial Title V Permit Application for the Anclote Power Plant received June 14, 1996.]

Section III. Emissions Unit(s) and Conditions.

Subsection A. This section addresses the following emissions unit(s).

E.U. ID No.	Brief Description
-001	Fossil Fuel Fired Steam Generator - SG 1
-002	Fossil Fuel Fired Steam Generator - SG 2
-003	Fossil Fuel Fired Steam Generator - SG 3

SG 1, SG 2, and SG 3 were all placed on "Long Term Reserve Shutdown" on January 24, 1994 (Rule 62-210.300(2)(a)3.d., F.A.C.). The maximum permitted heat input rates for SG 1, SG 2, and SG 3 are 548, 523, and 548 MMBtu/ hour, respectively. The emissions units are fired on new No. 6 or lighter grades of fuel oil, as permitted herein. Natural gas and on-specification used oil, as permitted herein, may be fired in these emissions units as an alternate fuel. SG 1, SG 2, and SG 3 generate steam to power turbines that drive generators with name plate ratings of 43, 42, and 41 megawatts, respectively. These units are regulated under the Acid Rain Program, Phase II.

Each SG exhausts through a single stack. Emissions from these units are uncontrolled.

{Permitting note(s): These emissions units are Pre-NSPS, regulated under Rules 62-296.405, F.A.C. (Fossil Fuel Steam Generators with More than 250 million Btu per Hour Heat Input), and regulated under 62-296.700, F.A.C. (Reasonably Available Control Technology, RACT, Particulate Matter). SG 1 began commercial operation on June 6, 1951; SG 2 began commercial operation on June 30, 1953; and, SG 3 began commercial operation on January 30, 1954.}

The following specific conditions apply to the emissions units listed above:

Essential Potential to Emit (PTE) Parameters

A.1. Methods of Operation. Fuel(s).

- a. Startup & Shutdown: The only fuels allowed to be burned are new #6 or lighter grades of fuel oils. On-specification used oil shall only be burned if the PCB's are less than 2 ppm and may be blended with new #2 fuel oil. The maximum sulfur content is 2.5 percent, by weight.
- b. Normal: The only fuels allowed to be burned are new #6 or lighter grades of fuel oils and on-specification used oil. The maximum sulfur content is 2.5 percent, by weight.
- c. The maximum annual cumulative amount of on-specification used oil, whether generated on or off-site, that can be burned in these emissions units shall not exceed 5 percent of the total permitted heat input for emissions units SG 1, SG 2, and SG 3.

d. The heat inputs in Specific Condition A.2. are based on the following fuel consumption rates while firing No. 6 fuel oil and natural gas. These rates may vary depending on the heating values of the fuels:

Emissions Unit	Hours/year	Fuel Oil(s)	Natural Gas
SG 1	8760	3,654 gallons/hour	0.50 MMSCF/hour
SG 2	8760	3,486 gallons/hour	0.49 MMSCF/hour
SG 3	8760	3,654 gallons/hour	0.50 MMSCF/hour

[Rule 62-213.410, F.A.C.; and AO's 52-216382, 52-216383, & 52-216384; and Title V application received on June 14, 1996.]

A.2. Permitted Capacity. The maximum operation heat input rates are as follows:

Unit No.	MMBtu/hr Heat Input	Fuel Type
SG 1	548	New No. 1, 2, 3, 4, 5 or 6 Fuel Oil & On-Specification Used Oil.*
	525	Natural Gas as an alternate fuel when available.
SG 2	523	New No. 1, 2, 3, 4, 5 or 6 Fuel Oil & On-Specification Used Oil.*
	515	Natural Gas as an alternate fuel when available.
SG 3	548	New No. 1, 2, 3, 4, 5 or 6 Fuel Oil & On-Specification Used Oil.*
	525	Natural Gas as an alternate fuel when available.

* The on-specification used oil burned at this facility may be generated on or off-site.
[Rules 62-4.160(2), 62-210.200(PTE) and 62-296.405, F.A.C.]

A.3. Emissions Unit Operating Rate Limitation After Testing. See Specific Condition A.22.
[Rule 62-297.310(2), F.A.C.]

A.4. Hours of Operation. These emissions units may operate continuously, i.e., 8,760 hours/year/unit.
[Rule 62-210.200(PTE), F.A.C.]

Emission Limitations and Standards

{Permitting note: Table 1-1, Summary of Air Pollutant Standards and Terms, summarizes information for convenience purposes only. This table does not supersede any of the terms or conditions of this permit.}

{Permitting note: The averaging time for conditions A.5. - A.9. are based on the run time of the specified test method, unless otherwise specified in this permit.}

A.5. Visible Emissions. Visible emissions from SG 1, SG 2, and SG 3 shall not exceed 40 percent opacity. The emissions units subject to the opacity standards of this condition shall conduct a compliance test for particulate matter emissions annually. The Department reserves the right to require the permittee to return to the more frequent testing schedule in Rule 62-296.405(1)(a), F.A.C., if the emission limiting standard for particulate matter is not regularly complied with.
[Rule 62-296.405(1)(a), F.A.C.; and, OGC Order File Nos. 86-1580, 86-1581, and 86-1582 dated December 11, 1986.]

A.6. Visible Emissions - Soot Blowing and Load Change. Visible emissions shall not exceed 60 percent opacity during the 3-hours in any 24 hour period of excess emissions allowed for boiler cleaning (soot blowing) and load change.

A load change occurs when the operational capacity of a unit is in the 10 percent to 100 percent capacity range, other than startup or shutdown, which exceeds 10 percent of the unit's rated capacity and which occurs at a rate of 0.5 percent per minute or more.

[Rule 62-210.700(3), F.A.C.]

A.7. Particulate Matter. Particulate matter emissions during normal operations shall not exceed 0.1 pound per million Btu heat input [(54.8 lb/hr & 240 TPY for SG 1 & SG 3, based on 548 MMBtu/hr.) and (52.3 lb/hr & 229 TPY for SG 2, based on 523 MMBtu/hr.)] as measured by the applicable compliance methods specified in Specific Condition A.18.

[Rule 62-296.405(1)(b), F.A.C.]

A.8. Particulate Matter - Soot Blowing and Load Change. Particulate matter emissions shall not exceed an average of 0.3 pound per million Btu heat input [164.4 lb/hr for SG 1 & SG 3 (based on 548 MMBtu/hr.) and 156.9 lb/hr for SG 2 (based on 523 MMBtu/hr)] during the 3-hours in any 24-hour period of excess emissions allowed for boiler cleaning (soot blowing) and load change.

[Rule 62-210.700(3), F.A.C.]

A.9. Sulfur Dioxide. When burning liquid fuel (fuel oil), sulfur dioxide emissions shall not exceed 2.75 pounds per million Btu heat input, as measured by test methods in Specific Condition A.19.

[Rule 62-296.405(1)(c)1.j., F.A.C.]

A.10. Sulfur Dioxide - Sulfur Content. The sulfur content of fuel oils, on-specification used oil, or any combination of the two burned in these units, shall not exceed 2.5 percent, by weight. See Specific Condition A.20.

[Rule 62-296.405(1)(e)3., F.A.C.]

Excess Emissions

A.11. Excess emissions resulting from malfunction shall be permitted provided that best operational practices to minimize emissions are adhered to and the duration of excess emissions shall be minimized but in no case exceed two hours in any 24 hour period unless specifically authorized by the Department for longer duration.

[Rule 62-210.700(1), F.A.C.]

A.12. Excess emissions resulting from startup or shutdown shall be permitted provided that best operational practices to minimize emissions are adhered to and the duration of excess emissions shall be minimized.

[Rule 62-210.700(2), F.A.C.]

A.13. Excess emissions which are caused entirely or in part by poor maintenance, poor operation, or any other equipment or process failure which may reasonably be prevented during startup, shutdown or malfunction shall be prohibited.

[Rule 62-210.700(4), F.A.C.]

Monitoring of Operations

A.14. Sulfur Dioxide. The permittee elected to demonstrate compliance by accepting a liquid fuel sulfur limit that will be verified with a fuel analysis provided by the vendor or permittee upon each fuel delivery. This protocol is allowed because the emissions units do not have an operating flue gas desulfurization device. See Specific Conditions A.9., A.10., A.19. and A.20.

[Rule 62-296.405(1)(f)1.b., F.A.C.]

A.15. Determination of Process Variables.

(a) Required Equipment. The owner or operator of an emissions unit for which compliance tests are required shall install, operate, and maintain equipment or instruments necessary to determine process variables, such as process weight input or heat input, when such data are needed in conjunction with emissions data to determine the compliance of the emissions unit with applicable emission limiting standards.

(b) Accuracy of Equipment. Equipment or instruments used to directly or indirectly determine process variables, including devices such as belt scales, weight hoppers, flow meters, and tank scales, shall be calibrated and adjusted to indicate the true value of the parameter being measured with sufficient accuracy to allow the applicable process variable to be determined within 10% of its true value.

[Rule 62-297.310(5), F.A.C.]

Test Methods and Procedures

{Permitting note: Table 2-1, Summary of Compliance Requirements, summarizes information for convenience purposes only. This table does not supersede any of the terms or conditions of this permit.}

A.16. Visible emissions. The test method for visible emissions shall be DEP Method 9, incorporated in Chapter 62-297, F.A.C. A transmissometer may be used and calibrated according to Rule 62-297.520, F.A.C. See Specific Condition A.17.

[Rule 62-296.405(1)(e)1., F.A.C.]

A.17. DEP Method 9. The provisions of EPA Method 9 (40 CFR 60, Appendix A) are adopted by reference with the following exceptions:

1. EPA Method 9, Section 2.4, Recording Observations. Opacity observations shall be made and recorded by a certified observer at sequential fifteen second intervals during the required period of observation.

2. EPA Method 9, Section 2.5, Data Reduction. For a set of observations to be acceptable, the observer shall have made and recorded, or verified the recording of, at least 90 percent of the possible individual observations during the required observation period. For single-valued opacity standards (e.g., 20 percent opacity), the test result shall be the highest valid six-minute average for the set of observations taken. For multiple-valued opacity standards (e.g., 20 percent opacity, except that an opacity of 40 percent is permissible for not more than two minutes per hour) opacity shall be computed as follows:

a. For the basic part of the standard (i.e., 20 percent opacity) the opacity shall be determined as specified above for a single-valued opacity standard.

b. For the short-term average part of the standard, opacity shall be the highest valid short-term average (i.e., two-minute, three-minute average) for the set of observations taken.

In order to be valid, any required average (i.e., a six-minute or two-minute average) shall be based on all of the valid observations in the sequential subset of observations selected, and the selected subset shall contain at least 90 percent of the observations possible for the required averaging time. Each required average shall be calculated by summing the opacity value of each of the valid observations in the appropriate subset, dividing this sum by the number of valid observations in the subset, and rounding the result to the nearest whole number. The number of missing observations in the subset shall be indicated in parenthesis after the subset average value. [Rule 62-297.401, F.A.C.]

A.18. Particulate Matter. The test methods for particulate emissions shall be EPA Methods 17, 5, 5B, or 5F, incorporated by reference in Chapter 62-297, F.A.C. The minimum sample volume shall be 30 dry standard cubic feet. EPA Method 5 may be used with filter temperature no more than 320 degrees Fahrenheit. For EPA Method 17, stack temperature shall be less than 375 degrees Fahrenheit. The owner or operator may use EPA Method 5 to demonstrate compliance. EPA Method 3 or 3A with Orsat analysis shall be used when the oxygen based F-factor, computed according to EPA Method 19, is used in lieu of heat input. Acetone wash shall be used with EPA Method 5 or 17.

[Rules 62-296.405(1)(e)2. and 62-297.401, F.A.C.]

A.19. Sulfur Dioxide. The test methods for sulfur dioxide emissions shall be EPA Methods 6, 6A, 6B, or 6C, incorporated by reference in Chapter 62-297, F.A.C. Fuel sampling and analysis may be used as an alternate sampling procedure if such a procedure is incorporated into the operation permit for the emissions unit. If the emissions unit obtains an alternate procedure under the provisions of Rule 62-297.620, F.A.C., the procedure shall become a condition of the emissions unit's permit. The Department will retain the authority to require EPA Method 6 or 6C if it has reason to believe that exceedences of the sulfur dioxide emissions limiting standard are occurring. Results of an approved fuel sampling and analysis program shall have the same effect as EPA Method 6 test results for purposes of demonstrating compliance or noncompliance with sulfur dioxide standards. **The permittee may use the EPA test methods, referenced above, to demonstrate compliance; however, as an alternate sampling procedure authorized by permit, the permittee elected to demonstrate compliance by accepting a liquid fuel sulfur limit that will be verified with a fuel analysis provided by the vendor or permittee upon each fuel delivery.** See Specific Conditions A.9., A.10. and A.20.

[Rules 62-213.440, 62-296.405(1)(e)3. and 62-297.401, F.A.C.; and, Permits AO 64-185095.]

A.20. The fuel sulfur content, percent by weight, for liquid fuels shall be evaluated using either ASTM D2622-94, ASTM D4294-90, both ASTM D4057-88 and ASTM D129-95, or the latest edition.

[Rules 62-213.440, 62-296.405(1)(e)3., 62-296.405(1)(f)1.b. and 62-297.440, F.A.C.]

A.21. Required Number of Test Runs. For mass emission limitations, a compliance test shall consist of three complete and separate determinations of the total air pollutant emission rate through the test section of the stack or duct and three complete and separate determinations of any applicable process variables corresponding to the three distinct time periods during which the stack emission rate was measured provided, however, that three complete and separate determinations shall not be required if the process variables are not subject to variation during a

compliance test, or if three determinations are not necessary in order to calculate the unit's emission rate. The three required test runs shall be completed within one consecutive five-day period. In the event that a sample is lost or one of the three runs must be discontinued because of circumstances beyond the control of the owner or operator, and a valid third run cannot be obtained within the five day period allowed for the test, the Secretary or his or her designee may accept the results of the two complete runs as proof of compliance, provided that the arithmetic mean of the results of the two complete runs is at least 20 percent below the allowable emission limiting standards.

[Rule 62-297.310(1), F.A.C.]

A.22. Operating Rate During Testing. Testing of emissions shall be conducted with the emissions unit operation at permitted capacity, which is defined as 90 to 100 percent of the maximum operation rate allowed by the permit. If it is impracticable to test at permitted capacity, an emissions unit may be tested at less than the minimum permitted capacity; in this case, subsequent emissions unit operation is limited to 110 percent of the test load until a new test is conducted. Once the emissions unit is so limited, operation at higher capacities is allowed for no more than 15 consecutive days for the purpose of additional compliance testing to regain the authority to operate at the permitted capacity.

[Rules 62-297.310(2) & (2)(b), F.A.C.]

A.23. Calculation of Emission Rate. The indicated emission rate or concentration shall be the arithmetic average of the emission rate or concentration determined by each of the separate test runs unless otherwise specified in a particular test method or applicable rule.

[Rule 62-297.310(3), F.A.C.]

A.24. Applicable Test Procedures.

(a) **Required Sampling Time.**

1. Unless otherwise specified in the applicable rule, the required sampling time for each test run shall be no less than one hour and no greater than four hours, and the sampling time at each sampling point shall be of equal intervals of at least two minutes.

2. **Opacity Compliance Tests.** The required minimum period of observation for a compliance test shall be sixty (60) minutes for emissions units which emit or have the potential to emit 100 tons per year or more of particulate matter, and thirty (30) minutes for emissions units which have potential emissions less than 100 tons per year of particulate matter and are not subject to a multiple-valued opacity standard. The opacity test observation period shall include the period during which the highest opacity emissions can reasonably be expected to occur. Exceptions to these requirements are as follows:

c. The minimum observation period for opacity tests conducted by employees or agents of the Department to verify the day-to-day continuing compliance of a unit or activity with an applicable opacity standard shall be twelve minutes.

(b) **Minimum Sample Volume.** Unless otherwise specified in the applicable rule, the minimum sample volume per run shall be 25 dry standard cubic feet.

(c) **Required Flow Rate Range.** For EPA Method 5 particulate sampling, acid mist/sulfur dioxide, and fluoride sampling which uses Greenburg Smith type impingers, the sampling nozzle and sampling time shall be selected such that the average sampling rate will be between 0.5 and 1.0 actual cubic feet per minute, and the required minimum sampling volume will be obtained.

(d) **Calibration of Sampling Equipment.** Calibration of the sampling train equipment shall be conducted in accordance with the schedule shown in Table 297.310-1.

(e) Allowed Modification to EPA Method 5. When EPA Method 5 is required, the following modification is allowed: the heated filter may be separated from the impingers by a flexible tube. [Rule 62-297.310(4), F.A.C.]

A.25. Required Stack Sampling Facilities. When a mass emissions stack test is required, the permittee shall comply with the requirements contained in Appendix SS-1, Stack Sampling Facilities, attached to this permit. [Rule 62-297.310(6), F.A.C.]

A.26. Frequency of Compliance Tests. The following provisions apply only to those emissions units that are subject to an emissions limiting standard for which compliance testing is required.

(a) General Compliance Testing.

2. For excess emission limitations for particulate matter specified in Rule 62-210.700, F.A.C., a compliance test shall be conducted annually while the emissions unit is operating under soot blowing conditions in each federal fiscal year during which soot blowing is part of normal emissions unit operation, except that such test shall not be required in any federal fiscal year in which a fossil fuel steam generator does not burn liquid for more than 400 hours other than during startup.

3. The owner or operator of an emissions unit that is subject to any emission limiting standard shall conduct a compliance test that demonstrates compliance with the applicable emission limiting standard prior to obtaining a renewed operation permit. Emissions units that are required to conduct an annual compliance test may submit the most recent annual compliance test to satisfy the requirements of this provision. In renewing an air operation permit pursuant to Rule 62-210.300(2)(a)3.b., c., or d., F.A.C., the Department shall not require submission of emission compliance test results for any emissions unit that, during the year prior to renewal:

- a. Did not operate; or
- b. In the case of a fuel burning emissions unit, burned liquid fuel for a total of no more than 400 hours.

TABLE 297.310-1
CALIBRATION SCHEDULE

ITEM	MINIMUM CALIBRATION FREQUENCY	REFERENCE INSTRUMENT	TOLERANCE
Liquid in glass thermometer	Annually	ASTM Hg in glass ref. thermometer or equivalent, or thermometric points	+/-2%
Bimetallic thermometer	Quarterly	Calib. liq. in glass thermometer	5 degrees F
Thermocouple	Annually	ASTM Hg in glass ref. thermometer, NBS calibrated reference and	5 degrees F

Barometer	Monthly	potentiometer Hg barometer or NOAA station	+/-1% scale
Pitot Tube	When required or when damaged	By construction or measurements in wind tunnel D greater than 16" and standard pitot tube	See EPA Method 2, Fig. 2-2 & 2-3
Probe Nozzles	Before each test or when nicked, dented, or corroded	Micrometer	+/-0.001" mean of at least three readings Max. deviation between readings .004"
Dry Gas Meter and Orifice Meter	1. Full Scale: When received, When 5% change observed, Annually 2. One Point: Semiannually 3. Check after each test series	Spirometer or calibrated wet test or dry gas test meter	2%
		Comparison check	5%

4. During each federal fiscal year (October 1 - September 30), unless otherwise specified by rule, order, or permit, the owner or operator of each emissions unit shall have a formal compliance test conducted for:

- a. Visible emissions, if there is an applicable standard;
- b. Each of the following pollutants, if there is an applicable standard, and if the emissions unit emits or has the potential to emit: 5 tons per year or more of lead or lead compounds measured as elemental lead; 30 tons per year or more of acrylonitrile; or 100 tons per year or more of any other regulated air pollutant; and
- c. Each NESHAP pollutant, if there is an applicable emission standard.

5. An annual compliance test for particulate matter emissions shall not be required for any fuel burning emissions unit that, in a federal fiscal year, does not burn liquid fuel, other than during startup, for a total of more than 400 hours.

9. The owner or operator shall notify the Air Quality Division of the Pinellas County Department of Environmental Management, at least 15 days prior to the date on which each formal compliance test is to begin, of the date, time, and place of each such test, and the test contact person who will be responsible for coordinating and having such test conducted for the owner or operator.

(b) Special Compliance Tests. When the Air Quality Division of the Pinellas County Department of Environmental Management, after investigation, has good reason (such as complaints, increased visible emissions or questionable maintenance of control equipment) to believe that any applicable emission standard contained in a Department rule or in a permit issued pursuant to those rules is being violated, it may require the owner or operator of the emissions unit to conduct compliance tests which identify the nature and quantity of pollutant

emissions from the emissions unit and to provide a report on the results of said tests to the Air Quality Division of the Pinellas County Department of Environmental Management.

(c) Waiver of Compliance Test Requirements. If the owner or operator of an emissions unit that is subject to a compliance test requirement demonstrates to the Department, pursuant to the procedure established in Rule 62-297.620, F.A.C., that the compliance of the emissions unit with an applicable weight emission limiting standard can be adequately determined by means other than the designated test procedure, such as specifying a surrogate standard of no visible emissions for particulate matter sources equipped with a bag house or specifying a fuel analysis for sulfur dioxide emissions, the Department shall waive the compliance test requirements for such emissions units and order that the alternate means of determining compliance be used, provided, however, the provisions of Rule 62-297.310(7)(b), F.A.C., shall apply. [Rule 62-297.310(7), F.A.C.; and, SIP approved.]

A.27. By this permit, annual emissions compliance testing for visible emissions is not required for these emissions units while burning:

- a. only gaseous fuel(s); or
- b. gaseous fuel(s) in combination with any amount of liquid fuel(s) for less than 400 hours per year; or
- c. only liquid fuel(s) for less than 400 hours per year.

[Rule 62-297.310(7)(a)4., F.A.C.]

A.28. Annual and permit renewal compliance testing for particulate matter emissions is not required for these emissions units while burning:

- a. only gaseous fuel(s); or
- b. gaseous fuel(s) in combination with any amount of liquid fuel(s) for less than 400 hours per year; or
- c. only liquid fuel(s) for less than 400 hours per year.

[Rules 62-297.310(7)(a)3. & 5., F.A.C.; and, ASP Number 97-B-01.]

Record keeping and Reporting Requirements

A.29. In the case of excess emissions resulting from malfunctions, each owner or operator shall notify the Air Quality Division of the Pinellas County Department of Environmental Management in accordance with Rule 62-4.130, F.A.C. A full written report on the malfunctions shall be submitted in a quarterly report, if requested by the Air Quality Division of the Pinellas County Department of Environmental Management.

[Rule 62-210.700(6), F.A.C.]

A.30. Submit to the Air Quality Division of the Pinellas County Department of Environmental Management a written report of emissions in excess of emission limiting standards as set forth in Rule 62-296.405(1), F.A.C., for each calendar quarter. The nature and cause of the excess emissions shall be explained. This report does not relieve the owner or operator of the legal liability for violations. All recorded data shall be maintained on file by the Source for a period of five years.

[Rules 62-213.440 and 62-296.405(1)(g), F.A.C.]

A.31. Test Reports.

(a) The owner or operator of an emissions unit for which a compliance test is required shall file a report with the Air Quality Division of the Pinellas County Department of Environmental Management on the results of each such test.

(b) The required test report shall be filed with the Air Quality Division of the Pinellas County Department of Environmental Management as soon as practical but no later than 45 days after the last sampling run of each test is completed.

(c) The test report shall provide sufficient detail on the emissions unit tested and the test procedures used to allow the Air Quality Division of the Pinellas County Department of Environmental Management to determine if the test was properly conducted and the test results properly computed. As a minimum, the test report, other than for an EPA or DEP Method 9 test, shall provide the following information:

1. The type, location, and designation of the emissions unit tested.
2. The facility at which the emissions unit is located.
3. The owner or operator of the emissions unit.
4. The normal type and amount of fuels used and materials processed, and the types and amounts of fuels used and material processed during each test run.
5. The means, raw data and computations used to determine the amount of fuels used and materials processed, if necessary to determine compliance with an applicable emission limiting standard.
6. The type of air pollution control devices installed on the emissions unit, their general condition, their normal operating parameters (pressure drops, total operating current and GPM scrubber water), and their operating parameters during each test run.
7. A sketch of the duct within 8 stack diameters upstream and 2 stack diameters downstream of the sampling ports, including the distance to any upstream and downstream bends or other flow disturbances.
8. The date, starting time and duration of each sampling run.
9. The test procedures used, including any alternative procedures authorized pursuant to Rule 62-297.620, F.A.C. Where optional procedures are authorized in this chapter, indicate which option was used.
10. The number of points sampled and configuration and location of the sampling plane.
11. For each sampling point for each run, the dry gas meter reading, velocity head, pressure drop across the stack, temperatures, average meter temperatures and sample time per point.
12. The type, manufacturer and configuration of the sampling equipment used.
13. Data related to the required calibration of the test equipment.
14. Data on the identification, processing and weights of all filters used.
15. Data on the types and amounts of any chemical solutions used.
16. Data on the amount of pollutant collected from each sampling probe, the filters, and the impingers, are reported separately for the compliance test.
17. The names of individuals who furnished the process variable data, conducted the test, analyzed the samples and prepared the report.
18. All measured and calculated data required to be determined by each applicable test procedure for each run.
19. The detailed calculations for one run that relate the collected data to the calculated emission rate.
20. The applicable emission standard, and the resulting maximum allowable emission rate for the emissions unit, plus the test result in the same form and unit of measure.
21. A certification that, to the knowledge of the owner or his authorized agent, all data submitted are true and correct. When a compliance test is conducted for the Department or

its agent, the person who conducts the test shall provide the certification with respect to the test procedures used. The owner or his authorized agent shall certify that all data required and provided to the person conducting the test are true and correct to his knowledge.
[Rules 62-213.440 and 62-297.310(8), F.A.C.]

A.32. Not federally enforceable. Compliance with the fuel oil sulfur content (% by wt) and sulfur dioxide emissions rate (lbs/MMBtu) of this permit shall be documented by the permittee through the submittal of quarterly reports for this facility. These quarterly reports shall be submitted within 30 days of the end of each calendar quarter to the Air Quality Division of the Pinellas County Department of Environmental Management.
[Rule 62-213.440, F.A.C.; and, AO 52-216382, AO 52-216383, and AO 52-216384.]

Addition limitations for On-Specification Used Oil

A.33. On-Specification Used Oil. On-specification used oil generated at this facility or off-site may only be burned in these emissions units if compliance with all the conditions of this permit and the following additional conditions are demonstrated:

a. On-specification Used Oil Allowed as Fuel: This permit allows the burning of used fuel oil meeting EPA "on-specification" used oil specifications, with a maximum sulfur content of 2.5 percent, by weight, and a PCB concentration of no greater than 49 ppm.

On-specification used oil shall meet the following specifications: [40 CFR 279, Subpart B.]

1. Arsenic shall not exceed 5.0 ppm;
2. Cadmium shall not exceed 2.0 ppm;
3. Chromium shall not exceed 10.0 ppm;
4. Lead shall not exceed 100.0 ppm;
5. Total halogens shall not exceed 1000 ppm;
6. Flash point shall not be less than 100 degrees F.

Used oil that does not meet the specifications for on-specification used oil shall not be burned at this facility.

b. Quantity Limited: The maximum cumulative annual amount of on-specification used oil that can be burned at this facility shall not exceed 5 % of the total allowable heat input for SG 1, SG 2, and SG 3.

c. Used Oil Containing PCBs Not Allowed: Used oil containing a PCB concentration of 50 or more ppm shall not be burned at this facility. Used oil shall not be blended to meet this requirement or any part of this condition.

d. PCB Concentration of 2 to 49 ppm: On-specification used oil with a PCB concentration of 2 to 49 ppm shall be burned only at normal source operating temperatures. On specification used oil with a PCB concentration of 2 to 49 ppm shall not be burned during periods of startup or shutdown. Before accepting from each marketer the first shipment of on-specification used oil with a PCB concentration of 2 to 49 ppm, the owner or operator shall provide each marketer with a one-time written and signed notice certifying that the owner or operator will burn the used oil in a qualified combustion device. The notice must state that EPA or a RCRA-delegated state agency has been given a description of the used oil management activities at the facility and that an industrial boiler or furnace will be used to burn the used oil with a PCB concentration of 2 to 49 ppm. The description of the used oil management activities shall be submitted to the Administrator of EPA or Administrator, Hazardous Waste Regulation Section, Florida Department of Environmental Protection, 2600 Blair Stone Road, Tallahassee, FL 32399-2400.

e. Certification Required: The owner or operator shall receive from the marketer, for each load of used oil received, a certification that the used oil meets the specifications for on-specification used oil and contains a PCB concentration of no greater than 49 ppm. This certification shall also describe the basis for the certification, such as analytical results.

{Note that a claim that used oil does not contain quantifiable levels of PCBs (that is, that the used oil contains less than 2 ppm of PCBs) must be documented by testing or other information. The first person making the claim that the used oil does not contain PCBs is responsible for furnishing the documentation. The documentation can be tests, personal or special knowledge of the source and composition of the used oil, or a certification from the person generating the used oil claiming that the used oil contains no detectable PCBs.}

f. Testing Required: If the owner or operator does not receive certification from the marketer as described above, the owner or operator shall properly sample and test each load of used oil received for the following parameters:

Arsenic, cadmium, chromium, lead, total halogens, flash point, PCBs*, and percent sulfur content by weight, ash, and BTU value (BTU per gallon). Testing (sampling, extraction and analysis) shall be performed using approved methods specified in EPA Publication SW-846 (Test Methods for Evaluating Solid Waste, Physical/Chemical Methods).

* Testing for PCB's is not necessary if quantifiable levels are less than 2 ppm (ref. to Specific Condition A.34.e.) If the owner or operator relies on certification from the marketer as described above, the owner or operator shall, at a minimum, each calendar quarter, sample one load of used oil received, selected at random by the owner or operator, and analyze the sample for the above parameters. If the analytical results show that the used oil does not meet the specification for on-specification used oil, or that it contains a PCB concentration of 50 ppm or greater, the owner or operator shall immediately notify the Air Quality Division of the Pinellas County Department of Environmental Management and provide the analytical results to the Department. The owner or operator ***shall immediately cease burning of the used oil.***

g. Special Record Keeping Requirements: The owner or operator shall obtain, make, and keep the following records related to the use of used oil:

- (1) The gallons of on-specification used oil received and burned each month. (This record shall be completed no later than the fifteenth day of the succeeding month.)
- (2) The total gallons of on-specification used oil burned in the preceding consecutive 12-month period. (This record shall be completed no later than the fifteenth day of the succeeding month.)
- (3) The name and address of all marketers delivering used oil to the facility.
- (4) Copies of the marketer certifications, if obtained, and any supporting information.
- (5) Documentation that the used oil contains less than 2 ppm PCBs, if claimed, including the name and address of the person making the claim.
- (6) Results of the analyses required above.
- (7) A copy of the notice to EPA and a copy of the one-time written notice provided to each marketer.
- (8) The hourly usage if the on-specification used oil is burned exclusively (not blended).

The records shall be retained in a form suitable for inspection at the facility by the Department, and shall be retained for 5 years.

h. Quarterly Reporting Required: The owner or operator shall submit to the Air Quality Division of the Pinellas County Department of Environmental Management, within thirty days of

the end of each calendar quarter, a summary of the quarterly analyses and the total amount of on-specification used oil received and burned during the quarter.

The owner or operator shall submit, with the Annual Operation Report form, the analytical results and the amount of on-specification used oil burned during the previous calendar year. [40 CFR 279.61 and 761.20(e); Rules 62-4.070(3), 62-212.400(2)(f)1. and 62-213.440, F.A.C.; and, initial Title V Application received June 14, 1996.]

Operation and Maintenance Plan

A.34. The following is the specified Operation and Maintenance Plan for Particulate Control as required by Rule.

A. Process Parameters

1. Heat Input Rate: SG 1 & SG 3 - 548 MMBtu/hr (Maximum), SG 2 - 523 MMBtu/hr (Maximum)
2. Fuel: No. 6 or lighter grades of fuel oil, on-specification used fuel oil, and natural gas with a maximum sulfur content, by weight, of 2.50%, 1 grain per 100 dry standard cubic feet, and 2.50%, respectively.
3. Fuel Firing Rate: SG 1 & SG 3 - 3654 gal/hr for fuel oils. SG 2 - 3486 gal/hr for fuel oil. SG 1 and SG 3 - natural gas at 0.5 MMCF/hour and SG 2 - natural gas at 0.49 MMCF/hr.
4. Ash Content: as sampled.
5. Steam Temperature: 950 °F
6. Steam Pressure: 1315 psig
7. Steam Flow Rate: 450,000 lb/hr
8. Stack Height: 174 ft
9. Boiler Manufacture: Babcock and Wilcox
10. Burner Arrangement: Front Fired

B. Inspection and Maintenance Program

1. Scheduled during major outages: Boilers, controls, auxiliaries, burners and duct work are to be inspected and repaired as necessary. All parts are to be inspected, cleaned and replaced as necessary.
2. Scheduled during non-peak load periods in spring and fall: This schedule is affected by forced outage requirements.
3. The following operating parameters are to be continuously monitored and maintained at appropriate levels to produce efficient fuel combustion:
 - a. fuel flow rate
 - b. fuel temperature
 - c. fuel pressure
 - d. air flow rate
 - e. steam flow rate
 - f. steam temperature
 - g. steam pressure
4. Plant operators are to monitor, adjust and record the following operating parameters at least once per day to assure efficient plant operations:
 - a. temperatures (superheat, fuel)
 - b. flows (steam, feedwater, fuel)
 - c. unit load
5. Fuel oil quality is to be checked prior to delivery and/or burning. Fuel oil shall be analyzed, by the most recent ASTM method, for the determination of the following:

- a. heat content (Btu/gal)
- b. sulfur content (% by wt)
- c. API gravity and density (lbs/gal)

C. Recordkeeping

Records of inspections, maintenance, and performance parameters shall be retained for a minimum of five years and shall be made available to the Department or Air Quality Division of the Pinellas County Department of Environmental Management upon request.

[Rule 62-296.700(6), F.A.C.; and, AO 52-216382, AO 52-216383, and AO 52-216384.]

Section III. Emissions Unit(s) and Conditions.

Subsection B. This section addresses the following emissions unit(s).

E. U. ID No.	Brief Description
-004 - 007	Combustion Turbine Peaking Units, CTP 1, CTP 2, CTP 3, and CTP 4

The above referenced combustion turbine peaking units (CTPs) may only fire new No. 2 fuel oil or natural gas having a maximum sulfur content of 0.5 percent, by weight, and 1 grain per 100 dry standard cubic feet (dscf), respectively. CTP 1 and CTP 2 have a maximum heat input of 566 MMBtu/hour at 59° F and each powers a generator rated at 37.0 MW (megawatts of electricity). CTP 3 and CTP 4 have a maximum heat input of 631 MMBtu/hour at 59° F and each powers a generator rated at 42.9 MW (megawatts of electricity). Emissions are not controlled and each turbine exhausts through a separate stack. These emissions units are pre-NSPS and not subject to the Acid Rain Program. CTP 1, CTP 2, CTP 3, and CTP 4 began commercial service on March 15, 1969, April 12, 1969, December 1, 1970, and January 9, 1971, respectively.

{Permitting Note: The emissions units are regulated under Rule 62-210.300, F.A.C., Permits Required.}

The following specific conditions apply to the above referenced emissions units:

Essential Potential to Emit (PTE) Parameters

B.1. Permitted Capacity. CTP 1 and CTP 2 each have a maximum heat input of 566 MMBtu/hour at 59° F and each powers a generator rated at 37.0 MW (megawatts of electricity). CTP 3 and CTP 4 each have a maximum heat input of 631 MMBtu/hour at 59° F and each powers a generator rated at 42.9 MW. At other ambient temperatures, the units shall be operated in accordance with established performance curves, which will be made available at the site during compliance testing.

[Rules 62-4.160(2) and 62-210.200(PTE), F.A.C.; and, AO 52-216420, AO 52-216421, AO 52-216422, AO 52-216423.]

B.2. Emissions Unit Operating Rate Limitation After Testing. See Specific Condition B.13.

B.3. Hours of Operation. Each emissions unit may operate continuously, i.e., 8,760 hours/year/CT.

[Rules 62-4.160(2) and 62-210.200(PTE), F.A.C.]

B.4. Methods of Operation - Fuels.

(a). Only new No. 2 fuel oil having a maximum sulfur content of 0.5 percent, by weight, or natural gas having a maximum sulfur content of 1 grain per 100 dscf shall be fired in these turbines.

(b). The heat inputs in Specific Condition B.1 are based on the following fuel consumption rates while firing new No. 2 fuel oil and natural gas. These rates may vary depending on the heating values of the fuels:

Emissions Unit(s)	New No. 2 Fuel Oil	Natural Gas
CTP 1 & CTP 2	4,032 gals/hr (96 bbl/hr)	0.57 MMCF/hr
CTP 3 & CTP 4	4,494 gals/hr (107 bbl/hr)	0.63 MMCF/hr

[Rules 62-4.160(2) and 62-213.440(1), F.A.C.; and, AO 64-216420, AO-216421, AO 64-216422, AO 64-216423.]

Emission Limitations and Standards

{Permitting note: Table 1-1, Summary of Air Pollutant Standards and Terms, summarizes information for convenience purposes only. This table does not supersede any of the terms or conditions of this permit.}

{Permitting note: The averaging time for condition B.5. is based on the run time of the specified test method, unless otherwise specified in this permit.}

B.5. Visible Emissions. Visible emissions from each turbine shall not be equal to or greater than 20 percent opacity.

[Rule 62-296.320(4)(b)1., F.A.C.; and, AO 64-216420, AO-216421, AO 64-216422, AO 64-216423.]

B.6. Sulfur Content. The sulfur content of the new No. 2 fuel oil shall not exceed 0.5 percent, by weight, and the sulfur content of the natural gas shall not exceed 1 gr/100 dscf.

[Rule 62-213.440, F.A.C.; and, AO 64-216420, AO-216421, AO 64-216422, AO 64-216423.]

Excess Emissions

B.7. Excess emissions from these emissions units resulting from startup, shutdown or malfunction shall be permitted provided that best operational practices to minimize emissions are adhered to and the duration of excess emissions shall be minimized but in no case exceed two hours in any 24 hour period unless specifically authorized by the Department for longer duration.

[Rule 62-210.700(1), F.A.C.]

B.8. Excess emissions which are caused entirely or in part by poor maintenance, poor operation, or any other equipment or process failure which may reasonably be prevented during startup, shutdown or malfunction shall be prohibited.

[Rule 62-210.700(4), F.A.C.]

Monitoring of Operations

B.9. The permittee shall demonstrate compliance with the sulfur content limit with a fuel analysis provided by the vendor upon each fuel delivery. See Specific Condition B.12.

[Rule 62-213.440, F.A.C.; and, AO 52-216420, AO 52-216421, AO 52-216422, AO 52-216423.]

B.10. Determination of Process Variables.

(a) Required Equipment. The owner or operator of an emissions unit for which compliance tests are required shall install, operate, and maintain equipment or instruments necessary to determine process variables, such as process weight input or heat input, when such data are needed in conjunction with emissions data to determine the compliance of the emissions unit with applicable emission limiting standards.

(b) Accuracy of Equipment. Equipment or instruments used to directly or indirectly determine process variables, including devices such as belt scales, weight hoppers, flow meters, and tank scales, shall be calibrated and adjusted to indicate the true value of the parameter being measured with sufficient accuracy to allow the applicable process variable to be determined within 10% of its true value.

[Rule 62-297.310(5), F.A.C.]

Test Methods and Procedures

{Permitting note: Table 2-1, Summary of Compliance Requirements, summarizes information for convenience purposes only. This table does not supersede any of the terms or conditions of this permit.}

B.11. The test method for visible emissions shall be EPA Method 9, incorporated and adopted by reference in Chapter 62-297, F.A.C.

[Rules 62-204.800, 62-296.320(4)(b)4.a. and 62-297.401, F.A.C.]

B.12. The fuel sulfur content, percent by weight, provided by the vendor or permittee for each delivery of liquid fuels shall be evaluated using either ASTM D2622-94, ASTM D4294-90, both ASTM D4057-88 and ASTM D129-91, or the latest edition.

[Rules 62-213.440 and 62-297.440, F.A.C.]

B.13. Operating Rate During Testing.

Testing of emissions shall be conducted with the emissions unit operating at capacity. Capacity is defined as 95 - 100 percent of the manufacturer's rated heat input achievable for the average ambient (or conditioned) air temperature during the test. If it is impracticable to test at permitted capacity, an emissions unit may be tested at less than capacity. In such cases, the entire heat input vs. inlet temperature curve will be adjusted by the increment equal to the difference between the design heat input value and 105 percent of the value reached during the test, provided however, operations do not exceed 100 percent of the maximum operation rate allowed by this permit. Data, curves, and calculations necessary to demonstrate the heat input rate correction at both design and test conditions shall be submitted to the Department's local office with the compliance test report.

[Rule 62-297.310(2), F.A.C.; and, AO 64-216420, AO-216421, AO 64-216422, AO 64-216423.]

B.14. Applicable Test Procedures.

(a) Required Sampling Time.

2. Opacity Compliance Tests. When EPA Method 9 is specified as the applicable opacity test method, the required minimum period of observation for a compliance test shall be sixty (60) minutes for emissions units which emit or have the potential to emit 100 tons per year or more of particulate matter, and thirty (30) minutes for emissions units which have potential emissions less than 100 tons per year of particulate matter and are not subject to a multiple-valued opacity standard. The opacity test observation period shall include the period during

which the highest opacity emissions can reasonably be expected to occur. Exceptions to these requirements are as follows:

- c. The minimum observation period for opacity tests conducted by employees or agents of the Department to verify the day-to-day continuing compliance of a unit or activity with an applicable opacity standard shall be twelve minutes.

[Rule 62-297.310(4)(a)2.c., F.A.C.]

B.15. Frequency of Compliance Tests. The following provisions apply only to those emissions units that are subject to an emissions limiting standard for which compliance testing is required.

(a) General Compliance Testing.

3. The owner or operator of an emissions unit that is subject to any emission limiting standard shall conduct a compliance test that demonstrates compliance with the applicable emission limiting standard prior to obtaining a renewed operation permit. Emissions units that are required to conduct an annual compliance test may submit the most recent annual compliance test to satisfy the requirements of this provision. In renewing an air operation permit pursuant to Rule 62-210.300(2)(a)3.b., c., or d., F.A.C., the Department shall not require submission of emission compliance test results for any emissions unit that, during the year prior to renewal:

- a. Did not operate; or
- b. In the case of a fuel burning emissions unit, burned liquid fuel for a total of no more than 400 hours.

4. During each federal fiscal year (October 1 - September 30), unless otherwise specified by rule, order, or permit, the owner or operator of each emissions unit shall have a formal compliance test conducted for:

- a. Visible emissions, if there is an applicable standard;

8. Any combustion turbine that does not operate for more than 400 hours per year shall conduct a visible emissions compliance test once per each five-year period, coinciding with the term of its air operation permit.

9. The owner or operator shall notify the Air Quality Division of the Pinellas County Department of Environmental Management, at least 15 days prior to the date on which each formal compliance test is to begin, of the date, time, and place of each such test, and the test contact person who will be responsible for coordinating and having such test conducted for the owner or operator.

(b) Special Compliance Tests. When the Air Quality Division of the Pinellas County Department of Environmental Management, after investigation, has good reason (such as complaints, increased visible emissions or questionable maintenance of control equipment) to believe that any applicable emission standard contained in a Department rule or in a permit issued pursuant to those rules is being violated, it may require the owner or operator of the emissions unit to conduct compliance tests which identify the nature and quantity of pollutant emissions from the emissions unit and to provide a report on the results of said tests to the Air Quality Division of the Pinellas County Department of Environmental Management.

(c) Waiver of Compliance Test Requirements. If the owner or operator of an emissions unit that is subject to a compliance test requirement demonstrates to the Department, pursuant to the procedure established in Rule 62-297.620, F.A.C., that the compliance of the emissions unit with an applicable weight emission limiting standard can be adequately determined by means other than the designated test procedure, such as specifying a surrogate standard of no visible emissions for particulate matter sources equipped with a bag house or specifying a fuel analysis for sulfur dioxide emissions, the Department shall waive the compliance test requirements for

such emissions units and order that the alternate means of determining compliance be used, provided, however, the provisions of Rule 62-297.310(7)(b), F.A.C., shall apply.

[Rule 62-297.310(7), F.A.C.; and, SIP approved]

B.16. Visible Emissions Testing - Annual. By this permit, annual emissions compliance testing for visible emissions is not required for these emissions units while burning:

- a. only gaseous fuels; or
- b. gaseous fuels in combination with any amount of liquid fuels for less than 400 hours per year; or
- c. only liquid fuels for less than 400 hours per year.

[Rules 62-297.310(7)(a)4. and 8., F.A.C.]

Record keeping and Reporting Requirements

B.17. Malfunction Reporting. In the case of excess emissions resulting from malfunctions as defined in Specific Conditions B.7 and B.8, each owner or operator shall notify the Department in accordance with Rule 62-4.130, F.A.C. A full written report on the malfunctions shall be submitted in a quarterly report, if requested by the Air Quality Division of the Pinellas County Department of Environmental Management.

[Rule 62-210.700(6), F.A.C.]

B.18. Test Reports.

(a) The owner or operator of an emissions unit for which a compliance test is required shall file a report with the Air Quality Division of the Pinellas County Department of Environmental Management on the results of each such test.

(b) The required test report shall be filed with the Air Quality Division of the Pinellas County Department of Environmental Management as soon as practical but no later than 45 days after the last sampling run of each test is completed.

[Rule 62-297.310(8), F.A.C.]

Section III. Emissions Unit(s) and Conditions.

Subsection C. This section addresses the following emissions unit(s).

E.U. ID No.	Brief Description
-7775047 -001	Relocatable Diesel Fired Generator(s)

The relocatable diesel generator(s) will have a maximum (combined) heat input of 25.74 MMBtu/hour while being fueled by 186.3 gallons of new No. 2 fuel oil per hour with a maximum (combined) rating of 2460 kilowatts. Emissions from the generator(s) are uncontrolled. These conditions were requested in the Initial Title V Permit Application for the Anclote Power Plant received June 14, 1996. The generator(s) may be relocated at this facility and any of the following facilities:

1. Crystal River Plant, Powerline Road, Red Level, Citrus County.
2. Bartow Plant, Weedon Island, St. Petersburg, Pinellas County.
3. Anclote Power Plant, 1729 Baileys Bluff Road, Holliday, Pasco County.
4. Bayboro Plant, 13th Ave. & 2nd St. South, St. Petersburg, Pinellas County.
5. Wildwood Reclamation Facility, State Road 462, 1 mi. east of U.S. 301, Wildwood, Sumter County.
6. The future FPC Polk County Site, County Road 555, 1 mi. southwest of Homeland, Polk County.

{Permitting notes: These emissions units are regulated under Rule 62-210.300, F.A.C., Permits Required. Each generator has its own stack.}

The following specific conditions apply to the emissions units listed above regardless of location:

Essential Potential to Emit (PTE) Parameters

C.1. These conditions become active and enforceable once FPC has given notification to the Air Quality Division of the Pinellas County Department of Environmental Management, if appropriate, that these units will be relocated to this facility. Notification shall be given as per Specific Condition C.24.

[Rule 62-4.070(3), F.A.C.; Anclote Power Plant Permit AC 09-202080; and, Initial Title V Permit Application for the Anclote Power Plant received June 14, 1996.]

C.2. Permitted Capacity. The maximum operation heat input rates are as follows:
[Rules 62-4.160(2) and 62-210.200(PTE), F.A.C.]

Unit No.	MMBtu/hr/generator(s) Heat Input	Fuel Type
-7775047 -001	25.74	New Low Sulfur No. 2 Fuel Oil

C.3. Emissions Unit Operating Rate Limitation After Testing. See Specific Condition C.14.
[Rule 62-297.310(2), F.A.C.]

C.4. Methods of Operation - Fuels. Only new low sulfur No. 2 fuel oil shall be fired in the combustion turbine(s).
[Rule 62-213.410, F.A.C.]

C.5. Hours of Operation. The hours of operation expressed as "engine-hours" shall not exceed 2970 hours in any consecutive 12 month period. The total hours of operation, expressed as "engine-hours", shall be the summation of the individual hours of operation of each generator. [Rules 62-4.160(2) and 62-210.200(PTE), F.A.C.; and, Anclote Power Plant Permit AO 09-205952.]

Emission Limitations and Standards

{Permitting note: Table I-1, Summary of Air Pollutant Standards and Terms, summarizes information for convenience purposes only. This table does not supersede any of the terms or conditions of this permit.}

{Permitting note: The averaging time for condition C.6. is based on the run time of the specified test method, unless otherwise specified in this permit.}

C.6. Visible Emissions. Visible emissions from each generator shall not be equal to or greater than 20 percent opacity. [Rule 62-296.320(4)(b)1., F.A.C.; and, Anclote Power Plant Permit AO 09-205952.]

C.7. Sulfur Dioxide - Sulfur Content. The sulfur content of the new No. 2 fuel oil shall not exceed 0.50 percent, by weight. [Requested in initial Title V Permit application dated June 14, 1996; and, Anclote Power Plant Permit AC 09-202080.]

Excess Emissions

C.8. Excess emissions from these emissions units resulting from startup, shutdown or malfunction shall be permitted provided that best operational practices to minimize emissions are adhered to and the duration of excess emissions shall be minimized but in no case exceed two hours in any 24 hour period unless specifically authorized by the Department for longer duration. [Rule 62-210.700(1), F.A.C.]

C.9. Excess emissions which are caused entirely or in part by poor maintenance, poor operation, or any other equipment or process failure which may reasonably be prevented during startup, shutdown or malfunction shall be prohibited. [Rule 62-210.700(4), F.A.C.]

Monitoring of Operations

C.10. The permittee shall demonstrate compliance with the liquid fuel sulfur limit by means of a fuel analysis provided by the vendor or permittee upon each fuel delivery. See Specific Condition C.13. [Rule 62-213.440, F.A.C.]

C.11. Determination of Process Variables.

(a) Required Equipment. The owner or operator of an emissions unit for which compliance tests are required shall install, operate, and maintain equipment or instruments necessary to determine process variables, such as process weight input or heat input, when such data are needed in

conjunction with emissions data to determine the compliance of the emissions unit with applicable emission limiting standards.

(b) Accuracy of Equipment. Equipment or instruments used to directly or indirectly determine process variables, including devices such as belt scales, weight hoppers, flow meters, and tank scales, shall be calibrated and adjusted to indicate the true value of the parameter being measured with sufficient accuracy to allow the applicable process variable to be determined within 10% of its true value.

[Rule 62-297.310(5), F.A.C.]

Test Methods and Procedures

{Permitting note: Table 2-1, Summary of Compliance Requirements, summarizes information for convenience purposes only. This table does not supersede any of the terms or conditions of this permit.}

C.12. The test method for visible emissions shall be EPA Method 9, incorporated and adopted by reference in Chapter 62-297, F.A.C.

[Rules 62-296.320(4)(b)4.a. and 62-297.401, F.A.C.]

C.13. The fuel sulfur content, percent by weight, for liquid fuels shall be evaluated using either ASTM D2622-94, ASTM D4294-90, both ASTM D4057-88 and ASTM D129-95, or the latest edition(s).

[Rules 62-213.440 and 62-297.440, F.A.C.]

C.14. Operating Rate During Testing. Testing of emissions shall be conducted with the generator(s) operating at 90 to 100 percent of the maximum fuel firing rate of 186.3 gallons per hour. If it is impracticable to test at permitted capacity, an emissions unit may be tested at less than the minimum permitted capacity (i.e., at less than 90 percent of the maximum operation rate allowed by the permit); in this case, subsequent emissions unit operations may be limited to 110 percent of the test load until a new test is conducted, provided however, operations do not exceed 100 percent of the maximum operation rate allowed by the permit. Once the emissions unit is so limited, operation at higher capacities is allowed for no more than 15 consecutive days for the purpose of additional compliance testing to regain the authority to operate at the permitted capacity. Failure to submit the actual operating rate may invalidate the test.

[Rules 62-297.310(2), F.A.C.; and, Anclote Power Plant Permit AO 09-205952.]

C.15. Applicable Test Procedures.

(a) Required Sampling Time.

2. Opacity Compliance Tests. The required minimum period of observation for a compliance test shall be sixty (60) minutes for emissions units which emit or have the potential to emit 100 tons per year or more of particulate matter, and thirty (30) minutes for emissions units which have potential emissions less than 100 tons per year of particulate matter and are not subject to a multiple-valued opacity standard. The opacity test observation period shall include the period during which the highest opacity emissions can reasonably be expected to occur. Exceptions to these requirements are as follows:

c. The minimum observation period for opacity tests conducted by employees or agents of the Department to verify the day-to-day continuing compliance of a unit or activity with an applicable opacity standard shall be twelve minutes.

[Rule 62-297.310(4)(a)2.c., F.A.C.]

C.16. Frequency of Compliance Tests. The following provisions apply only to those emissions units that are subject to an emissions limiting standard for which compliance testing is required.

(a) General Compliance Testing.

3. The owner or operator of an emissions unit that is subject to any emission limiting standard shall conduct a compliance test that demonstrates compliance with the applicable emission limiting standard prior to obtaining a renewed operation permit. Emissions units that are required to conduct an annual compliance test may submit the most recent annual compliance test to satisfy the requirements of this provision. In renewing an air operation permit pursuant to Rule 62-210.300(2)(a)3.b., c., or d., F.A.C., the Department shall not require submission of emission compliance test results for any emissions unit that, during the year prior to renewal:

a. Did not operate; or

b. In the case of a fuel burning emissions unit, burned liquid fuel for a total of no more than 400 hours.

4. During each federal fiscal year (October 1 - September 30), unless otherwise specified by rule, order, or permit, the owner or operator of each emissions unit shall have a formal compliance test conducted for:

a. Visible emissions, if there is an applicable standard;

8. Any combustion turbine that does not operate for more than 400 hours per year shall conduct a visible emissions compliance test once per each five-year period, coinciding with the term of its air operation permit.

9. The owner or operator shall notify the Air Quality Division of the Pinellas County Department of Environmental Management at least 15 days prior to the date on which each formal compliance test is to begin, of the date, time, and place of each such test, and the test contact person who will be responsible for coordinating and having such test conducted for the owner or operator.

(b) Special Compliance Tests. When the Air Quality Division of the Pinellas County Department of Environmental Management, after investigation, has good reason (such as complaints, increased visible emissions or questionable maintenance of control equipment) to believe that any applicable emission standard contained in a Department rule or in a permit issued pursuant to those rules is being violated, it may require the owner or operator of the emissions unit to conduct compliance tests which identify the nature and quantity of pollutant emissions from the emissions unit and to provide a report on the results of said tests to the Air Quality Division of the Pinellas County Department of Environmental Management.

(c) Waiver of Compliance Test Requirements. If the owner or operator of an emissions unit that is subject to a compliance test requirement demonstrates to the Department, pursuant to the procedure established in Rule 62-297.620, F.A.C., that the compliance of the emissions unit with an applicable weight emission limiting standard can be adequately determined by means other than the designated test procedure, such as specifying a surrogate standard of no visible emissions for particulate matter sources equipped with a bag house or specifying a fuel analysis for sulfur dioxide emissions, the Department shall waive the compliance test requirements for such emissions units and order that the alternate means of determining compliance be used, provided, however, the provisions of Rule 62-297.310(7)(b), F.A.C., shall apply.

[Rule 62-297.310(7), F.A.C.; SIP approved; and, Anclote Power Plant Permit AO 09-205952.]

C.17. Visible Emissions Testing - Annual. By this permit, annual emissions compliance testing for visible emissions is not required for these emissions units while burning liquid fuels for less than 400 hours per year.

[Rules 62-297.310(7)(a)4. & 8., F.A.C.]

C.18. After each relocation, each generator shall be tested within 30 days of startup for opacity and the fuel shall be analyzed for the sulfur content. See Specific Conditions C.6, C.7, C.10, C.13, and C.14.

[Rules 62-4.070(3) and 62-297.310(7)(b), F.A.C.; and, Anclote Power Plant Permit AO 09-205952.]

Recordkeeping and Reporting Requirements

C.19. Malfunction Reporting. In the case of excess emissions resulting from malfunctions, the owner or operator shall notify the Air Quality Division of the Pinellas County Department of Environmental Management in accordance with Rule 62-4.130, F.A.C. A full written report on the malfunctions shall be submitted in a quarterly report, if requested by the Air Quality Division of the Pinellas County Department of Environmental Management.

[Rule 62-210.700(6), F.A.C.]

C.20. Test Reports

(a) Each generator shall be tested on an annual basis within 30 days of the date October 25.

(b) The owner or operator of an emissions unit for which a compliance test is required shall file a report with the Air Quality Division of the Pinellas County Department of Environmental Management on the results of each such test.

(c) The required test report shall be filed with the Air Quality Division of the Department of Environmental Management as soon as practical but no later than 45 days after the last sampling run of each test is completed.

(d) The test reports for a unit that has been relocated shall be submitted to the Department office that will handle compliance issues for the new location within 45 days of testing.

[Rule 62-297.310(8), F.A.C.; and, Anclote Power Plant Permit AO 09-25952.]

C.21. To demonstrate compliance with Specific Condition C.5, records shall indicate the daily hours of operation for each diesel generator, the daily hours of operation expressed as "engine-hours", and cumulative total hours of operation expressed as "engine hours" for each month. The records shall be maintained for a minimum of 5 years and made available to the Air Quality Division of the Pinellas County Department of Environmental Management upon request.

[Rules 62-213.440 and 62-297.310(8), F.A.C.; and, Anclote Power Plant Permit AO 09-205952.]

C.22. To demonstrate compliance with Specific Condition C.7, records of the sulfur content, in percent by weight, of all the fuel burned shall be kept based on either vendor provided as-delivered or as-received fuel sample analysis. The records shall be maintained for a minimum of 5 years and made available to the Air Quality Division of the Pinellas County Department of Environmental Management upon request.

[Rule 62-297.310(8), F.A.C.; and, AO 09-205952.]

Source Obligation

C.23. Specific conditions in Anclote Power Plant construction permit AC 09-202080, limiting the “engine hours” were accepted by the applicant to escape Prevention of Significant Deterioration review. If Florida Power Corporation requests a relaxation of any of the federally enforceable emission limits in this permit, the relaxation of limits may be subject to the preconstruction review requirements of Rule 62-212.400(5), F.A.C., as though construction had not yet begun.

[Rule 62-212.400(2)(g), F.A.C.; and, Anclote Power Plant Permits AC 09-202080 and AO 09-205952.]

C.24. Florida Power Corporation shall notify the Department’s district office and the local air program (when applicable) of where the diesel generator(s) is/are presently located and where the diesel generator(s) is/are to be relocated, in writing, at least 15 days prior to the date on which any diesel generator(s) is/are to be relocated. The notification shall specify the following:

- a. which generator(s), by serial number, is/are being relocated,
- b. which location the generator(s) is being relocated from and which location it is being relocated to, and
- c. the approximate startup date at the new location.

[Rule 62-4.070(3), F.A.C.; and, Anclote Power Plant Permit AC 09-202080]

Section IV. This section is the Acid Rain Part.

Operated by: Florida Power
ORIS code: 630

Subsection A. This subsection addresses Acid Rain, Phase II.

The emissions units listed below are regulated under Acid Rain Program, Phase II.

E.U. ID No.	Description
-001	Fossil Fuel Fired Steam Generator - SG 1
-002	Fossil Fuel Fired Steam Generator - SG 2
-003	Fossil Fuel Fired Steam Generator - SG 3

A.1. The Phase II permit application submitted for this facility, as approved by the Department, is a part of this permit. The owners and operators of these Phase II acid rain unit(s) must comply with the standard requirements and special provisions set forth in the application(s) listed below:

- a. DEP Form No. 62-210.900(1)(a), dated July 30, 2002
[Chapter 62-213, F.A.C. and Rule 62-214.320, F.A.C.]

A.2. Sulfur dioxide (SO₂) allowance allocations requirements for each Acid Rain unit are as follows:

<u>E.U. ID No.</u>	<u>EPA ID</u>	<u>Year</u>	<u>2003</u>	<u>2004</u>	<u>2005</u>	<u>2006</u>	<u>2007</u>
-001	1	SO ₂ allowances, under Table 2 or 3 of 40 CFR Part 73	418*	418*	418*	418*	418*
-002	2	SO ₂ allowances, under Table 2 or 3 of 40 CFR Part 73	469*	469*	469*	469*	469*
-003	3	SO ₂ allowances, under Table 2 or 3 of 40 CFR Part 73	964*	964*	964*	964*	964*

*The number of allowances held by an Acid Rain source in a unit account may differ from the number allocated by the USEPA under Table 2 or 3 of 40 CFR 73.

**If applicable, by January 1, 1999, this Part will be reopened to add NO_x requirements in accordance with the regulations implementing section 407 of the Clean Air Act.

A.3. Emission Allowances. Emissions from sources subject to the Federal Acid Rain Program (Title IV) shall not exceed any allowances that the source lawfully holds under the Federal Acid Rain Program. Allowances shall not be used to demonstrate compliance with a non-Title IV applicable requirement of the Act.

1. No permit revision shall be required for increases in emissions that are authorized by allowances acquired pursuant to the Federal Acid Rain Program, provided that such increases do not require a permit revision pursuant to Rule 62-213.400(3), F.A.C.

2. No limit shall be placed on the number of allowances held by the source under the Federal Acid Rain Program.

3. Allowances shall be accounted for under the Federal Acid Rain Program.
[Rule 62-213.440(1)(c), F.A.C.]

A.4. Fast-Track Revisions of Acid Rain Parts. Those Acid Rain sources making a change described at Rule 62- 214.370(4), F.A.C., may request such change as provided in Rule 62-213.413, F.A.C., Fast-Track Revisions of Acid Rain Parts.
[Rules 62-213.413 and 62-214.370(4), F.A.C.]

A.5. Comments, notes, and justifications: none

A.6. Where an applicable requirement of the Act is more stringent than an applicable requirement of regulations promulgated under Title IV of the Act, both provisions shall be incorporated into the permit and shall be enforceable by the Administrator.
[40 CFR 70.6(a)(1)(ii); and, Rule 62-210.200, Definitions - Applicable Requirements, F.A.C.]

Appendix U-1: List of Unregulated Emissions Units and/or Activities.

Florida Power
Higgins Power Plant

DRAFT Permit No.: 1030012-002-AV
Facility ID No.: 1030012

Unregulated Emissions Units and/or Activities. An emissions unit which emits no "emissions-limited pollutant" and which is subject to no unit-specific work practice standard, though it may be subject to regulations applied on a facility-wide basis (e.g., unconfined emissions, odor, general opacity) or to regulations that require only that it be able to prove exemption from unit-specific emissions or work practice standards.

The below listed emissions units and/or activities are neither 'regulated emissions units' nor 'insignificant emissions units'.

E.U. ID

<u>No.</u>	<u>Brief Description of Emissions Units and/or Activity</u>
-009	General Purpose Engines
-010	Fuel Storage Tanks
-011	Emergency Generator

Appendix I-1: List of Insignificant Emissions Units and/or Activities.

Florida Power
Higgins Power Plant

DRAFT Permit No.: 1030012-002-AV
Facility ID No.: 1030012

The facilities, emissions units, or pollutant-emitting activities listed in Rule 62-210.300(3)(a), F.A.C., Categorical Exemptions, or that meet the criteria specified in Rule 62-210.300(3)(b)1., F.A.C., Generic Emissions Unit Exemption, are exempt from the permitting requirements of Chapters 62-210, 62-212 and 62-4, F.A.C.; provided, however, that exempt emissions units shall be subject to any applicable emission limiting standards and the emissions from exempt emissions units or activities shall be considered in determining the potential emissions of the facility containing such emissions units. Emissions units and pollutant-emitting activities exempt from permitting under Rules 62-210.300(3)(a) and (b)1., F.A.C., shall not be exempt from the permitting requirements of Chapter 62-213, F.A.C., if they are contained within a Title V source; however, such emissions units and activities shall be considered insignificant for Title V purposes provided they also meet the criteria of Rule 62-213.430(6)(b), F.A.C. No emissions unit shall be entitled to an exemption from permitting under Rules 62-210.300(3)(a) and (b)1., F.A.C., if its emissions, in combination with the emissions of other units and activities at the facility, would cause the facility to emit or have the potential to emit any pollutant in such amount as to make the facility a Title V source.

The below listed emissions units and/or activities are considered insignificant pursuant to Rule 62-213.430(6), F.A.C.

<u>Brief Description of Emissions Units and/or Activities.</u>	
1	Lube Oil System Vents
2	Lube Oil Reservoir Tank
3	Oil Water Separators
4	Hazardous Waste Building
5	Parts Washers/Degreasers
6	Waste Oil Storage Tanks
7	Lube Oil Storage Building
8	Portable Unleaded Gasoline Tank
9	Surface Coating and Solvent Cleaning
10	No. 2 Diesel Fuel Tank

Steam Generating Units - SAG 2, SAG 3, & SAG 4

Evaporation of on-site generated boiler non-hazardous cleaning chemicals (citrosolv and ammonia). This activity occurs once every three to five years or longer.

Appendix H-1: Permit History

Florida Power
Higgins Power Plant

DRAFT Permit No.: 1030012-002-AV
Facility ID No.: 1030012

E.U. ID No.	Description	Permit No.	Effective Date	Expiration Date	Project Type ¹
All	Facility	1030012-001-AV	01/01/1998	12/31/2002	Initial
All	Facility	1030012-002-AV	Pending		Renewal

¹ Project Type (select one): Title V: Initial, Revision, Renewal, or Admin. Correction; Construction (new or mod.); or, Extension (AC only).

Appendix H-1: Permit History

Florida Power
Higgins Power Plant

DRAFT Permit No.: 1030012-002-AV
Facility ID No.: 1030012

E.U. ID No.	Description	Permit No.	Effective Date	Expiration Date	Project Type ¹
All	Facility	1030012-001-AV	01/01/1998	12/31/2002	Initial
All	Facility	1030012-002-AV	Pending		Renewal

¹ Project Type (select one): Title V: Initial, Revision, Renewal, or Admin. Correction; Construction (new or mod.); or, Extension (AC only).

Florida Power
Higgins Power Plant

DRAFT Permit ID No.: 1030012-002-AV
Facility ID No.: 1030012

E.U. ID Nos. Brief Description

-001 & -003		Fossil Fuel Fired Steam Generator - SG 1 & SG 3							
			Allowable Emissions			Equivalent Emissions			
Pollutant Name	Fuel(s) *	Hours/ Year *	Standards	lb/ hour	TPY	lb/hour **	TPY **	Regulatory Citation(s)	See Permit Condition(s)
Visible Emissions Steady state Soot Blowing or Load Changing	F.O. & OSUO or N.G.	8760	40% Opacity 60% Opacity					Rule 62-296.405(1)(a), F.A.C. Rule 62.210.700(3), F.A.C.	A.5 A.6
PM Emissions Steady State Soot Blowing or Load Changing	F.O. & OSUO or N.G.	8760	0.1 lb/MMBtu 0.3 lb/MMBtu	54.8 164.4	240.0			Rule 62.296.405(1)(b), F.A.C. Rule 62.210.700(3), F.A.C.	A.7 A.8
Sulfur Dioxide	F.O. & OSUO or N.G.	8760 8760	2.75 lb/MMBtu, max. 2.5% S or 1 gr/100 dscf			1,507.0	6,600.7	Rules 62-213.440, 62-296.405(1)(c)3., 62-296.405(1)(c)1.i., F.A.C.	A.9 A.10

-002		Fossil Fuel Fired Steam Generators - SG 2							
			Allowable Emissions			Equivalent Emissions			
Pollutant Name	Fuel(s) *	Hours/ Year *	Standards	lb/ hour	TPY	lb/hour **	TPY **	Regulatory Citation(s)	See Permit Condition(s)
Visible Emissions Steady state Soot Blowing or Load Changing	F.O. & OSUO or N.G.	8760	40% Opacity 60% Opacity					Rule 62-296.405(1)(a), F.A.C. Rule 62.210.700(3), F.A.C. OGC Order TFR-92-A-01	A.5 a.6
PM Emissions Steady State Soot Blowing or Load Changing	F.O. & OSUO or N.G.	8760	0.1 lb/MMBtu 0.3 lb/MMBtu	52.3 156.9	229.0			Rule 62.296.405(1)(b), F.A.C. Rule 62.210.700(3), F.A.C.	A.7 A.8
Sulfur Dioxide	F.O. & OSUO or N.G.	8760 8760	2.75 lb/MMBtu, max. 2.5% S or 1 gr/100 dscf			1,438.3	6,299.5	Rules 62-213.440, 62-296.405(1)(e)3., 62-296.405(1)(c)1.i.,	A.9 A.10

*Natural Gas (N.G.), No. 1, 2, 3, 4, 5, & 6 fuel oil (F.O.) and on-specification used oil (OSUO). OSUO is limited to 5% of the total heat input for these units (Cond. A.1 & A.34)

** The "Equivalent Emissions" listed are for informational purposes only.

This table summarizes information for convenience purposes only. This table does not supersede any of the terms or conditions of this permit.

Table 1-1, Air Pollutant Emission Allowables and Terms

Florida Power
Higgins Power Plant

DRAFT Permit ID No.: 1030012-002-AV
Facility ID No.: 1030012

Additional Standards for On-Specification Used Oil (OSUO)

E.U. ID Nos. Brief Description

-001-003		Fossil Fuel Fired Steam Generators, SG 1, SG 2, & SG 3							
			Allowable Emissions			Equivalent Emissions			
Pollutant Name	Fuel(s)	Hours/Year	Standards	lbs./hour	TPY	lbs./hour	TPY	Regulatory Citation(s)	See Permit Condition(s)
Arsenic	OSUO		5.0 ppm						A.33
Cadmium	OSUO		2.0 ppm						A.33
Chromium	OSUO		10.0 ppm						A.33
Lead	OSUO		100.0 ppm						A.33
Total Halogens	OSUO		1000 ppm						A.33
Flash Point	OSUO		> 100 degrees F						A.33
PCB	OSUO		≤ 49 ppm						A.33
SO ₂			max. 2.5% S by wt.						A.33

* Burning of on-specification used oil shall not exceed 5 percent of the total heat input to units SG 1, SG 2, & SG 3 (Cond. A.1 & A.33).

This table summarizes information for convenience purposes only. This table does not supersede any of the terms or conditions of this permit.

** Rules 62-4.070(3) and 62-213.440, F.A.C.; and, AO 52-216382, AO 52-216383, & AO 52-216384.

Florida Power
Higgins Power Plant

DRAFT Permit ID No.: 1030012-002-AV
Facility ID No.: 1030012

E.U. ID Nos. Brief Description

-004 & -005		Combustion Turbine Peaking Units - CTP 1 & CTP 2							
		Allowable Emissions				Equivalent Emissions *			
Pollutant Name	Fuel(s)	Hours/Year	Standards	lb/hour	TPY	lb/hour	TPY	Regulatory Citation(s)	See Permit Condition(s)
Visible Emissions	New No. 2 F.O.	8760	< 20% Opacity					Rule 62-296.320(4)(b)1., F.A.C.	B.5
Sulfur Dioxide	New No. 2 F.O. N.G.	8760	max. 0.50% S by wt. or 1 gr/100 dscf			286.3 **	1253.9 **	Rule 62-213.440, F.A.C.	B.6

-006 & -007		Combustion Turbine Peaking Units - CTP 3 & CTP 4							
		Allowable Emissions				Equivalent Emissions			
Pollutant Name	Fuel(s) *	Hours/Year *	Standards	lb/hour	TPY	lb/hour	TPY	Regulatory Citation(s)	See Permit Condition(s)
Visible Emissions	New No. 2 F.O.	8760	< 20% Opacity					Rule 62-296.320(4)(b)1., F.A.C.	B.5
Sulfur Dioxide	New No. 2 F.O. N.G.	8760	max. 0.50% S by wt. or 1 gr/100 dscf			319.1 ***	1397.5 ***	Rule 62-213.440, F.A.C.	B.6

* The "Equivalent Emissions" listed are for informational purposes only.

** Based on a maximum F.O. consumption of 96.0 bbl/hr, 7.1 lb/gal, operating 8760 hr/yr., and maximum F.O. sulfur content of 0.50 %, by wt.

*** Based on a maximum F.O. consumption of 107.0 bbl/hr, 7.1 lb/gal, operating 8760 hr/yr., and maximum F.O. sulfur content of 0.50 %, by wt.

This table summarizes information for convenience purposes only and does not supersede any of the terms or conditions of this permit.

Table 1-1, Air Pollutant Emission Allowables and Terms

Florida Power
Higgins Power Plant

DRAFT Permit ID No.: 1030012-002-AV
Facility ID No.: 1030012

-7775047-001		Relocatable Generator(s)				Equivalent Emissions		Regulatory Citation(s)	See Permit Condition(s)
Pollutant Name	Fuel(s) *	Hours/ Year *	Standards	lb/ hour	TPY	lb/hour **	TPY **		
Visible Emissions	#2 F.O.	8760	20% Opacity					Rule 62-296.320(4)(b)1., F.A.C.	C.6
Sulfur Dioxide	#2 F.O.	8760	0.50% by wt.					Rule 62-296.320(4)(b)1., F.A.C.	C.7

** The "Equivalent Emissions" listed are for informational purposes only.

This table summarizes information for convenience purposes only. This table does not supersede any of the terms or conditions of this permit.

Note. The above unit(s), which are permitted to be located at seven facilities.

Table 2-1, Compliance Testing Requirements

Florida Power
Higgins Power Plant

DRAFT Permit ID No.: 1030012-002-AV
Facility ID No.: 1030012

E.U. ID							
Pollutant Name or parameter	Fuel(s)	EPA/Reference Method	Testing Time or Frequency	Frequency Base Date ²	Min. Compl. Test Time	CMS	Permit Condition(s)

E.U. CTR 1, 2, 3, & 4							
SO ₂	Oil	F.O. Analysis ¹	Per Delivery ¹		NA		B.12
VE	Oil	EPA Meth. 9	Annual		1 Hour		B. 11,14,15, & 16

E.U. SG 2, 3, & 4							
SO ₂	Gas						
	Oil	F.O. Analysis ¹	Per Delivery ¹				A.19 & 20
PM	Gas						
	Oil	EPA Meth. 5	Annual				A.18, A.19, 24, & 28
VE	Gas	EPA Meth. 9	Annual		1 Hour		A.16, 17, 24, & 27

1- Sulfur content of the fuel oil shall be provided by the supplier or permittee for every delivery.

Table 2-1, Compliance Testing Requirements

Florida Power
Higgins Power Plant

DRAFT Permit ID No.: 1030012-002-AV
Facility ID No.: 1030012

Relocatable Diesel Generator(s)

E.U. 7775047-001							
SO ₂	Oil	F.O. Analysis ¹	Per Delivery ¹		NA		C.12
VE	Oil	EPA Meth. 9	Annual		1 Hour		C.13, 15, 17, & 18

Note: The above unit(s) are permitted to be located at seven facilities.

BEFORE THE STATE OF FLORIDA
DEPARTMENT OF ENVIRONMENTAL REGULATION

In the Matter of:)
)
Petition for Reduction in)
Semiannual Particulate)
Emissions Compliance Testing,) OGC File No. 86-1580
Higgins Unit No. 1;)
Florida Power Corporation)
)
Petitioner.)
_____)

ORDER

On February 18, 1986, the Petitioner, Florida Power Corporation, filed a Petition for Reduction in the Frequency of Particulate Emissions Compliance Testing pursuant to Florida Administrative Code Rule 17-2.600(5)(b)1. for the following fossil fuel steam generating unit:

Higgins Unit No.1

Pursuant to Florida Administrative Code Rule 17-2.600(5)(b)1., and by Order dated November 7, 1982, Petitioner has conducted semiannual particulate emission compliance tests. Florida Administrative Code Rule 17-2.600(5)(b)1. provides that the Department may reduce the frequency of particulate testing upon a demonstration that the particulate standard of 0.1 pound per million Btu heat input has been regularly met. The petition and supporting documentation submitted by Petitioner indicate that, since May 12, 1982, Petitioner has regularly met the particulate standard. It is therefore,

ORDERED that the Petition for Reduction in the Frequency of Particulate Emissions Compliance Testing is GRANTED. Petitioner may immediately commence testing on an annual basis. Test results from the first regularly scheduled compliance test conducted in FY 87 (October 1, 1986 - September 30, 1987), provided the results of that test meet the particulate standard and the 40% opacity standard, shall be accepted as results from the first annual test. Failure of Higgins Unit No.1 to meet

either the particulate standard or the 40% opacity standard in the future shall constitute grounds for revocation of this authorization.

Persons whose substantial interests are affected by the above proposed agency action have a right, pursuant to Section 120.57, Florida Statutes, to petition for an administrative determination (hearing) on the proposed action. The Petition must conform to the requirements of Chapters 17-103 and 28-5, Florida Administrative Code, and must be filed (received) with the Department's Office of General Counsel, 2600 Blair Stone Road, Tallahassee, Florida 32399-2400, within fourteen (14) days of publication of this notice. Failure to file a petition within the fourteen (14) days constitutes a waiver of any right such person has to an administrative determination (hearing) pursuant to Section 120.57, Florida Statutes.

If a petition is filed, the administrative hearing process is designed to formulate agency action. Accordingly, the Department's final action may be different from the proposed agency action. Persons whose substantial interests will be affected by any decision of the Department have the right to intervene in the proceeding. A petition for the intervention must be filed pursuant to Model Rule 26-5.207, Florida Administrative Code, at least five (5) days before the final hearing and be filed with the Hearing Officer if one has been assigned at the Division of Administrative Hearings, Department of Administration, 2009 Apalachee Parkway, Tallahassee, Florida 32301. If no Hearing Officer has been assigned, the petition is to be filed with the Department's Office of General Counsel, 2600 Blair Stone Road, Tallahassee, Florida 32399-2400. Failure to petition to intervene within the allowed time frame constitutes a

walver of any right such person has to an administrative determination (hearing) under Section 120.57, Florida Statutes.

DONE AND ORDERED this 11th day of Dec, in Tallahassee, Florida.

STATE OF FLORIDA DEPARTMENT
OF ENVIRONMENTAL REGULATION

FILING AND ACKNOWLEDGEMENT


FILED on this date pursuant to §120.52 Florida Statutes, with the designated Department Clerk, receipt of which is hereby acknowledged

C. Hutchins

Clerk

12-15-86


Date


VICTORIA J. TSCHINKEL
Secretary

Twin Towers Office Building
2600 Blair Stone Road
Tallahassee, Florida
32399-2400
Telephone (904)486-9730

CERTIFICATE OF SERVICE

I HEREBY CERTIFY that a true and correct copy of the foregoing ORDER has been furnished by United States Mail to J.A. Hancock, Vice President, Fossil Operations, Florida Power Corporation, Post Office Box 14042, St. Petersburg, Florida 33733; on this 12 day of December, 1986, in Tallahassee, Florida.


E. Gary Early
Assistant General Counsel

STATE OF FLORIDA DEPARTMENT
OF ENVIRONMENTAL REGULATION

Twin Towers Office Building
2600 Blair Stone Road
Tallahassee, Florida
32399-2400
Telephone (904)486-9730

BEFORE THE STATE OF FLORIDA
DEPARTMENT OF ENVIRONMENTAL REGULATION

In the Matter of:)
)
Petition for Reduction in)
Semiannual Particulate)
Emissions Compliance Testing,) OGC File No. 86-1581
Higgins Unit No. 2;)
Florida Power Corporation)
)
Petitioner.)
_____)

ORDER

On February 18, 1986, the Petitioner, Florida Power Corporation, filed a Petition for Reduction in the Frequency of Particulate Emissions Compliance Testing pursuant to Florida Administrative Code Rule 17-2.600(5)(b)1. for the following fossil fuel steam generating unit:

Higgins Unit No.2

Pursuant to Florida Administrative Code Rule 17-2.600(5)(b)1., and by Order dated November 7, 1982, Petitioner has conducted semiannual particulate emission compliance tests. Florida Administrative Code Rule 17-2.600(5)(b)1. provides that the Department may reduce the frequency of particulate testing upon a demonstration that the particulate standard of 0.1 pound per million Btu heat input has been regularly met. The petition and supporting documentation submitted by Petitioner indicate that, since April 27, 1982, Petitioner has regularly met the particulate standard. It is therefore,

ORDERED that the Petition for Reduction in the Frequency of Particulate Emissions Compliance Testing is GRANTED. Petitioner may immediately commence testing on an annual basis. Test results from the first regularly scheduled compliance test conducted in FY 87 (October 1, 1986 - September 30, 1987), provided the results of that test meet the particulate standard and the 40% opacity standard, shall be accepted as results from the first annual test. Failure of Higgins Unit No.2 to meet

either the particulate standard or the 40% opacity standard in the future shall constitute grounds for revocation of this authorization.

Persons whose substantial interests are affected by the above proposed agency action have a right, pursuant to Section 120.57, Florida Statutes, to petition for an administrative determination (hearing) on the proposed action. The Petition must conform to the requirements of Chapters 17-103 and 28-5, Florida Administrative Code, and must be filed (received) with the Department's Office of General Counsel, 2600 Blair Stone Road, Tallahassee, Florida 32399-2400, within fourteen (14) days of publication of this notice. Failure to file a petition within the fourteen (14) days constitutes a waiver of any right such person has to an administrative determination (hearing) pursuant to Section 120.57, Florida Statutes.

If a petition is filed, the administrative hearing process is designed to formulate agency action. Accordingly, the Department's final action may be different from the proposed agency action. Persons whose substantial interests will be affected by any decision of the Department have the right to intervene in the proceeding. A petition for the intervention must be filed pursuant to Model Rule 28-5.207, Florida Administrative Code, at least five (5) days before the final hearing and be filed with the Hearing Officer if one has been assigned at the Division of Administrative Hearings, Department of Administration, 2009 Apalachee Parkway, Tallahassee, Florida 32301. If no Hearing Officer has been assigned, the petition is to be filed with the Department's Office of General Counsel, 2600 Blair Stone Road, Tallahassee, Florida 32399-2400. Failure to petition to intervene within the allowed time frame constitutes a


waiver of any right such person has to an administrative determination (hearing) under Section 120.57, Florida Statutes.

DONE AND ORDERED this 11th day of Dec, in Tallahassee, Florida.

STATE OF FLORIDA DEPARTMENT
OF ENVIRONMENTAL REGULATION

FILING AND ACKNOWLEDGEMENT
FILED on this date pursuant to S120.52
Florida Statutes, with the designated Department Clerk, receipt of which is hereby acknowledged.

C Hutchins 12-12-86
Clerk Date




VICTORIA J. TSCHINKEL
Secretary

Twin Towers Office Building
2600 Blair Stone Road
Tallahassee, Florida
32399-2400
Telephone (904)486-9730

CERTIFICATE OF SERVICE

I HEREBY CERTIFY that a true and correct copy of the foregoing ORDER has been furnished by United States Mail to J.A. Hancock, Vice President, Fossil Operations, Florida Power Corporation, Post Office Box 14042, St. Petersburg, Florida 33733; on this 12 day of December, 1986, in Tallahassee, Florida.


E. Gary Early
Assistant General Counsel

STATE OF FLORIDA DEPARTMENT
OF ENVIRONMENTAL REGULATION

Twin Towers Office Building
2600 Blair Stone Road
Tallahassee, Florida
32399-2400
Telephone (904)486-9730

BEFORE THE STATE OF FLORIDA
DEPARTMENT OF ENVIRONMENTAL REGULATION

In the Matter of:)
)
Petition for Reduction in)
Semiannual Particulate)
Emissions Compliance Testing,) OGC File No. 86-1582
Higgins Unit No. 3;)
Florida Power Corporation)
)
Petitioner.)
_____)

ORDER

On February 18, 1986, the Petitioner, Florida Power Corporation, filed a Petition for Reduction in the Frequency of Particulate Emissions Compliance Testing pursuant to Florida Administrative Code Rule 17-2.600(5)(b)1. for the following fossil fuel steam generating unit:

Higgins Unit No.3

Pursuant to Florida Administrative Code Rule 17-2.600(5)(b)1., and by Order dated November 7, 1982, Petitioner has conducted semiannual particulate emission compliance tests. Florida Administrative Code Rule 17-2.600(5)(b)1. provides that the Department may reduce the frequency of particulate testing upon a demonstration that the particulate standard of 0.1 pound per million Btu heat input has been regularly met. The petition and supporting documentation submitted by Petitioner indicate that, since May 5, 1982, Petitioner has regularly met the particulate standard. It is therefore,

ORDERED that the Petition for Reduction in the Frequency of Particulate Emissions Compliance Testing is GRANTED. Petitioner may immediately commence testing on an annual basis. Test results from the first regularly scheduled compliance test conducted in FY 87 (October 1, 1986 - September 30, 1987), provided the results of that test meet the particulate standard and the 40% opacity standard, shall be accepted as results from the first annual test. Failure of Higgins Unit No.3 to meet

either the particulate standard or the 40% opacity standard in the future shall constitute grounds for revocation of this authorization.

Persons whose substantial interests are affected by the above proposed agency action have a right, pursuant to Section 120.57, Florida Statutes, to petition for an administrative determination (hearing) on the proposed action. The Petition must conform to the requirements of Chapters 17-103 and 28-5, Florida Administrative Code, and must be filed (received) with the Department's Office of General Counsel, 2600 Blair Stone Road, Tallahassee, Florida 32399-2400, within fourteen (14) days of publication of this notice. Failure to file a petition within the fourteen (14) days constitutes a waiver of any right such person has to an administrative determination (hearing) pursuant to Section 120.57, Florida Statutes.

If a petition is filed, the administrative hearing process is designed to formulate agency action. Accordingly, the Department's final action may be different from the proposed agency action. Persons whose substantial interests will be affected by any decision of the Department have the right to intervene in the proceeding. A petition for the intervention must be filed pursuant to Model Rule 28-5.207, Florida Administrative Code, at least five (5) days before the final hearing and be filed with the Hearing Officer if one has been assigned at the Division of Administrative Hearings, Department of Administration, 2009 Apalachee Parkway, Tallahassee, Florida 32301. If no Hearing Officer has been assigned, the petition is to be filed with the Department's Office of General Counsel, 2600 Blair Stone Road, Tallahassee, Florida 32399-2400. Failure to petition to intervene within the allowed time frame constitutes a

waiver of any right such person has to an administrative determination (hearing) under Section 120.57, Florida Statutes.

DONE AND ORDERED this 11th day of Dec, in Tallahassee, Florida.

STATE OF FLORIDA DEPARTMENT
OF ENVIRONMENTAL REGULATION

FILING AND ACKNOWLEDGEMENT

FILED on this date pursuant to §120.52 Florida Statutes, with the designated Department Clerk, receipt of which is hereby acknowledged.

C Hutchins

Clerk

12-12-86

Date



VICTORIA J. TSCHINKEL
Secretary

Twin Towers Office Building
2600 Blair Stone Road
Tallahassee, Florida
32399-2400
Telephone (904)486-9730

CERTIFICATE OF SERVICE

I HEREBY CERTIFY that a true and correct copy of the foregoing ORDER has been furnished by United States Mail to J.A. Hancock, Vice President, Fossil Operations, Florida Power Corporation, Post Office Box 14042, St. Petersburg, Florida 33733; on this 12 day of December, 1986, in Tallahassee, Florida.



E. Gary Early
Assistant General Counsel

STATE OF FLORIDA DEPARTMENT
OF ENVIRONMENTAL REGULATION

Twin Towers Office Building
2600 Blair Stone Road
Tallahassee, Florida
32399-2400
Telephone (904)486-9730