

Florida Department of
Environmental Protection

Memorandum

TO: Trina Vielhauer, Bureau of Air Regulation
THROUGH: Jon Holtom, Title V Section *JH*
FROM: Tom Cascio *TC*
DATE: October 14, 2009
SUBJECT: Draft/Proposed Permit No. 0110036-009-AV
Florida Power and Light Company, Port Everglades Plant
Title V Air Operation Permit CAM Plan Revision

Attached for your review are the following items:

- Written Notice of Intent to Issue Air Permit;
- Public Notice of Intent to Issue Air Permit;
- Statement of Basis;
- Draft/Proposed Permit; and,
- P.E. Certification.

The draft/proposed Title V air operation permit revises the Title V air operation permit for the Port Everglades Plant, which is located in Broward County, Florida. The Statement of Basis provides a summary of the project and the rationale for issuance. The P.E. certification briefly summarizes the proposed project.

The application was received on July 29, 2009, and deemed complete. Day 90 is October 27, 2009. There is no ongoing/open enforcement case for this facility, as advised by the Broward County Office.

I recommend your approval of the attached draft/proposed Title V air operation permit.

Attachments

P.E. CERTIFICATION STATEMENT

PERMITTEE

Florida Power and Light Company
8100 Eisenhower Boulevard
Fort Lauderdale, Florida 33316


Permit No. 0110036-009-AV
Facility ID No. 0110036
Port Everglades Plant
Title V Air Operation Permit Revision
Broward County, Florida

PROJECT DESCRIPTION

This project is a revision of Title V air operation permit No. 0110036-007-AV for the above referenced facility. The compliance assurance monitoring (CAM) plan has been revised for the electrostatic precipitators installed at the plant.

I HEREBY CERTIFY that the air pollution control engineering features described in the above referenced application and subject to the proposed permit conditions provide reasonable assurance of compliance with applicable provisions of Chapter 403, Florida Statutes, and Florida Administrative Code Chapters 62-4 and 62-204 through 62-297. However, I have not evaluated and I do not certify aspects of the proposal outside of my area of expertise (including, but not limited to, the electrical, mechanical, structural, hydrological, geological, and meteorological features).

This review was conducted by Tom Cascio under my responsible supervision.

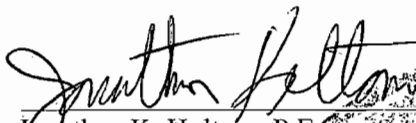 10/15/09
Jonathan K. Holtom, P.E. Date
Registration Number: 0052664





Florida Department of Environmental Protection

Bob Martinez Center
2600 Blair Stone Road
Tallahassee, Florida 32399-2400

Charlie Crist
Governor

Jeff Kottkamp
Lt. Governor

Michael W. Sole
Secretary

Electronic Mail – Received Receipt Requested.

Mr. Jeff Smith, Plant General Manager
Florida Power and Light Company
8100 Eisenhower Boulevard
Fort Lauderdale, Florida 33316

Re: Permit No. 0110036-009-AV
Port Everglades Plant
Title V Air Operation Permit Revision


Dear Mr. Smith:

Enclosed is the draft/proposed permit package to revise the Compliance Assurance Monitoring (CAM) plan contained within Title V air operation permit for the Port Everglades Plant. This facility is located in Broward County, at 8100 Eisenhower Boulevard, Fort Lauderdale, Florida. The permit package includes the following documents:

- The Statement of Basis, which summarizes the facility, the equipment, the primary rule applicability, and the changes since the last Title V air operation permit revision.
- The draft/proposed Title V air operation permit revision, which includes the specific permit conditions that regulate the emissions units covered by the proposed project.
- The Written Notice of Intent to Issue a Revised Air Permit provides important information regarding: the Permitting Authority's intent to issue an air permit for the proposed project; the requirements for publishing a Public Notice of the Permitting Authority's intent to issue an air permit revision; the procedures for submitting comments on the draft/proposed revised permit; the process for filing a petition for an administrative hearing; and the availability of mediation.
- The Public Notice of Intent to Issue Air Permit is the actual notice that you must have published in the legal advertisement section of a newspaper of general circulation in the area affected by this project. The Public Notice of Intent to Issue a Revised Title V Air Permit must be published as soon as possible and the proof of publication must be provided to the Department within seven days of the date of publication.

If you have any questions, please contact the Project Engineer, Tom Cascio, by telephone at 850-921-9526 or by email at Tom.Cascio@dep.state.fl.us.

Sincerely,

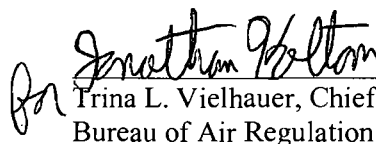
Trina L. Vielhauer, Chief
Bureau of Air Regulation

10/15/09
Date

Enclosures
TLV/jkh/tbc

WRITTEN NOTICE OF INTENT TO ISSUE TITLE V AIR OPERATION PERMIT REVISION

*In the Matter of an
Application for Title V Air Operation Permit by:*

Florida Power and Light Company
8100 Eisenhower Boulevard
Fort Lauderdale, Florida 33316

Responsible Official:
Mr. Jeff Smith, Plant General Manager

Permit No. 0110036-009-AV
Facility ID No. 0110036
Port Everglades Plant
Title V Air Operation Permit Revision
Broward County, Florida

Facility Location: Florida Power and Light Company operates the Port Everglades Plant, which is located in Broward County at 8100 Eisenhower Boulevard, Fort Lauderdale, Florida.

Project: The purpose of this project is to revise Title V air operation permit No. 0110036-007-AV. Details of the project are provided in the application and the enclosed Statement of Basis.

Permitting Authority: Applications for Title V air operation permits for facilities that operate Acid Rain units are subject to review in accordance with the provisions of Chapter 403, Florida Statutes (F.S.) and Chapters 62-4, 62-210, 62-213 and 62-214 of the Florida Administrative Code (F.A.C.). The proposed project is not exempt from air permitting requirements and a Title V air operation permit is required to operate the facility. The Bureau of Air Regulation is the Permitting Authority responsible for making a permit determination for this project. The Permitting Authority's physical address is: 111 South Magnolia Drive, Suite #4, Tallahassee, Florida. The Permitting Authority's mailing address is: 2600 Blair Stone Road, MS #5505, Tallahassee, Florida 32399-2400. The Permitting Authority's telephone number is 850/488-0114.

Project File: A complete project file is available for public inspection during the normal business hours of 8:00 a.m. to 5:00 p.m., Monday through Friday (except legal holidays), at the address indicated above for the Permitting Authority. The complete project file includes the draft/proposed permit revision, the Statement of Basis, the application, and the information submitted by the applicant, exclusive of confidential records under Section 403.111, F.S. Interested persons may view the draft/proposed revised permit by visiting the following website: <http://www.dep.state.fl.us/air/emission/apds/default.asp> and entering the permit number shown above. Interested persons may contact the Permitting Authority's project review engineer for additional information at the address or phone number listed above.

Notice of Intent to Issue Permit: The Permitting Authority gives notice of its intent to issue a draft/proposed Title V air operation permit revision to the applicant for the project described above. The applicant has provided reasonable assurance that continued operation of the existing equipment will not adversely impact air quality and that the project will comply with all appropriate provisions of Chapters 62-4, 62-204, 62-210, 62-212, 62-213, 62-214, 62-296 and 62-297, F.A.C. The Permitting Authority will issue a final revised permit in accordance with the conditions of the draft/proposed revised permit unless a response received in accordance with the following procedures results in a different decision or a significant change of terms or conditions.

Public Notice: Pursuant to Section 403.815, F.S. and Rules 62-110.106 and 62-210.350, F.A.C., you (the applicant) are required to publish at your own expense the enclosed Public Notice of Intent to Issue Air Permit Revision (Public Notice). The Public Notice shall be published one time only as soon as possible in the legal advertisement section of a newspaper of general circulation in the area affected by this project. The newspaper used must meet the requirements of Sections 50.011 and 50.031, F.S. in the county where the activity is to take place. If you are uncertain that a newspaper meets these requirements, please contact the Permitting Authority at the above address or phone number. Pursuant to Rule 62-110.106(5) and (9), F.A.C., the applicant shall provide proof of publication to the Permitting Authority at the above address within 7 days of publication. Failure to publish the notice and provide proof of publication may result in the denial of the permit pursuant to Rule 62-110.106(11), F.A.C.

WRITTEN NOTICE OF INTENT TO ISSUE TITLE V AIR OPERATION PERMIT REVISION

Comments: The Permitting Authority will accept written comments concerning the draft/proposed Title V air operation permit revision for a period of 30 days from the date of publication of the Public Notice. Written comments must be received by the close of business (5:00 p.m.), on or before the end of this 30-day period by the Permitting Authority at the above address. As part of his or her comments, any person may also request that the Permitting Authority hold a public meeting on this permitting action. If the Permitting Authority determines there is sufficient interest for a public meeting, it will publish notice of the time, date, and location in the Florida Administrative Weekly (FAW). If a public meeting is requested within the 30-day comment period and conducted by the Permitting Authority, any oral and written comments received during the public meeting will also be considered by the Permitting Authority. If timely received written comments or comments received at a public meeting result in a significant change to the revised draft/proposed permit, the Permitting Authority shall issue a revised draft/proposed permit and require, if applicable, another Public Notice. All comments filed will be made available for public inspection. For additional information, contact the Permitting Authority at the above address or phone number.

Petitions: A person whose substantial interests are affected by the proposed permitting decision may petition for an administrative hearing in accordance with Sections 120.569 and 120.57, F.S. The petition must contain the information set forth below and must be filed with (received by) the Department's Agency Clerk in the Office of General Counsel of the Department of Environmental Protection, 3900 Commonwealth Boulevard, Mail Station #35, Tallahassee, Florida 32399-3000. Petitions filed by the applicant or any of the parties listed below must be filed within 14 days of receipt of this Written Notice of Intent to Issue Air Permit. Petitions filed by any persons other than those entitled to written notice under Section 120.60(3), F.S., must be filed within 14 days of publication of the attached Public Notice or within 14 days of receipt of this Written Notice of Intent to Issue Air Permit, whichever occurs first. Under Section 120.60(3), F.S., however, any person who asked the Permitting Authority for notice of agency action may file a petition within 14 days of receipt of that notice, regardless of the date of publication. A petitioner shall mail a copy of the petition to the applicant at the address indicated above, at the time of filing. The failure of any person to file a petition within the appropriate time period shall constitute a waiver of that person's right to request an administrative determination (hearing) under Sections 120.569 and 120.57, F.S., or to intervene in this proceeding and participate as a party to it. Any subsequent intervention (in a proceeding initiated by another party) will be only at the approval of the presiding officer upon the filing of a motion in compliance with Rule 28-106.205, F.A.C.

A petition that disputes the material facts on which the Permitting Authority's action is based must contain the following information: (a) The name and address of each agency affected and each agency's file or identification number, if known; (b) The name, address, and telephone number of the petitioner; the name, address and telephone number of the petitioner's representative, if any, which shall be the address for service purposes during the course of the proceeding; and an explanation of how the petitioner's substantial interests will be affected by the agency determination; (c) A statement of when and how each petitioner received notice of the agency action or proposed decision; (d) A statement of all disputed issues of material fact. If there are none, the petition must so indicate; (e) A concise statement of the ultimate facts alleged, including the specific facts the petitioner contends warrant reversal or modification of the agency's proposed action; (f) A statement of the specific rules or statutes the petitioner contends require reversal or modification of the agency's proposed action including an explanation of how the alleged facts relate to the specific rules or statutes; and, (g) A statement of the relief sought by the petitioner, stating precisely the action the petitioner wishes the agency to take with respect to the agency's proposed action. A petition that does not dispute the material facts upon which the Permitting Authority's action is based shall state that no such facts are in dispute and otherwise shall contain the same information as set forth above, as required by Rule 28-106.301, F.A.C.

Because the administrative hearing process is designed to formulate final agency action, the filing of a petition means that the Permitting Authority's final action may be different from the position taken by it in this Written Notice of Intent to Issue Air Permit. Persons whose substantial interests will be affected by any such final decision of the Permitting Authority on the application have the right to petition to become a party to the

WRITTEN NOTICE OF INTENT TO ISSUE TITLE V AIR OPERATION PERMIT REVISION


proceeding, in accordance with the requirements set forth above.

Mediation: Mediation is not available in this proceeding.

EPA Review: EPA has agreed to treat the draft/proposed Title V air operation permit as a proposed Title V air operation permit and to perform its 45-day review provided by the law and regulations concurrently with the public comment period. Although EPA's 45-day review period will be performed concurrently with the public comment period, the deadline for submitting a citizen petition to object to the EPA Administrator will be determined as if EPA's 45-day review period is performed after the public comment period has ended. The final Title V air operation permit will be issued after the conclusion of the 45-day EPA review period so long as no adverse comments are received that result in a different decision or significant change of terms or conditions. The status regarding EPA's 45-day review of this project and the deadline for submitting a citizen petition can be found at the following website address: <http://www.epa.gov/region4/air/permits/Florida.htm>.

Objections: Finally, pursuant to 42 United States Code (U.S.C.) Section 7661d(b)(2), any person may petition the Administrator of the EPA within 60 days of the expiration of the Administrator's 45-day review period as established at 42 U.S.C. Section 7661d(b)(1), to object to the issuance of any Title V air operation permit. Any petition shall be based only on objections to the permit that were raised with reasonable specificity during the 30-day public comment period provided in the Public Notice, unless the petitioner demonstrates to the Administrator of the EPA that it was impracticable to raise such objections within the comment period or unless the grounds for such objection arose after the comment period. Filing of a petition with the Administrator of the EPA does not stay the effective date of any permit properly issued pursuant to the provisions of Chapter 62-213, F.A.C. Petitions filed with the Administrator of EPA must meet the requirements of 42 U.S.C. Section 7661d(b)(2) and must be filed with the Administrator of the EPA at: U.S. EPA, 401 M Street, S.W., Washington, D.C. 20460. For more information regarding EPA review and objections, visit EPA's Region 4 web site at <http://www.epa.gov/region4/air/permits/Florida.htm>.

Executed in Tallahassee, Florida.


for Trina L. Vielhauer, Chief
Bureau of Air Regulation

WRITTEN NOTICE OF INTENT TO ISSUE TITLE V AIR OPERATION PERMIT REVISION

CERTIFICATE OF SERVICE

The undersigned duly designated deputy agency clerk hereby certifies that either this Written Notice of Intent to Issue Title V Air Operation Permit Revision (including the Public Notice, the Statement of Basis, and the draft/proposed permit), or a link to these documents available electronically on a publicly accessible server, was sent by electronic mail with received receipt requested before the close of business on 10/16/09 to the persons listed below.

- Mr. Jeff Smith, Florida Power and Light Company: jeff_smith@fpl.com
- Ms. Sheila M. Wilkinson, Florida Power and Light Company: sheila_wilkinson@fpl.com
- Mr. Edward Preast, P.E., Florida Power and Light Company: ed.preast@fpl.com
- Ms. Katy Forney, U.S. EPA Region 4: forney.kathleen@epa.gov
- Ms. Ana Oquendo, U.S. EPA Region 4: oquendo.ana@epamail.epa.gov
- Ms. Daniela Banu, Broward County: dbanu@co.broward.fl.us
- Ms. Barbara Friday, DEP BAR: barbara.friday@dep.state.fl.us (for posting with U.S. EPA, Region 4)
- Ms. Vickie Gibson, DEP BAR: victoria.gibson@dep.state.fl.us (read file copy)

Clerk Stamp

FILING AND ACKNOWLEDGMENT FILED, on this date, pursuant to Section 120.52(7), Florida Statutes, with the designated agency clerk, receipt of which is hereby acknowledged.

Barbara J. Friday 10/16/09
(Clerk) (Date)

PUBLIC NOTICE OF INTENT TO ISSUE TITLE V AIR OPERATION PERMIT REVISION

Florida Department of Environmental Protection
Division of Air Resource Management, Bureau of Air Regulation
Draft/Proposed Permit No. 0110036-009-AV
Florida Power and Light Company, Port Everglades Plant
Broward County, Florida

Applicant: The applicant for this project is Florida Power and Light Company (FPL). The applicant's responsible official and mailing address are: Mr. Jeff Smith, Plant General Manager, Florida Power and Light Company, Port Everglades Plant, 8100 Eisenhower Boulevard, in Fort Lauderdale, Florida 33316.

Facility Location: The applicant operates the existing Port Everglades Plant, which is located in Broward County at 8100 Eisenhower Boulevard, in Fort Lauderdale, Florida.

Project: The applicant applied on July 29, 2009, to the Department for a Title V air operation permit revision to effect changes to the Compliance Assurance Monitoring (CAM) plan of Title V air operation permit No. 0110036-007-AV. The existing facility consists of four fossil fuel steam generators and twelve simple cycle combustion turbines as described below.

Fossil fuel fired steam generators Unit 001 and Unit 002 are each 225 megawatt (MW) (electric) steam generators. The emissions units are fired on a variable combination of No. 6 fuel oil, No. 2 fuel oil, natural gas, propane and on-specification used oil from Florida Power and Light operations. When firing fuel oil, the maximum heat input for each boiler is 2300 million British thermal units (MMBtu) per hour, and when firing natural gas or propane, the maximum heat input for each boiler is 2400 MMBtu per hour. Each emissions unit consists of a boiler that drives a turbine generator. Emissions are controlled with low NO_x burners, and electrostatic precipitators for particulate matter (PM) control. Each unit is equipped with a 344-foot stack.

Fossil fuel fired steam generators Unit 003 and Unit 004 are each 402 MW (electric) steam generators. The emissions units are fired on a variable combination of No. 6 fuel oil, No. 2 fuel oil, natural gas, propane and on-specification used oil from FPL operations. When firing fuel oil, the maximum heat input for each boiler is 4000 MMBtu per hour, and when firing natural gas or propane, the maximum heat input for each boiler is 4180 mmBtu per hour. Each emissions unit consists of a boiler which drives a turbine generator. Emissions are controlled with low NO_x burners and electrostatic precipitators for PM control. Each unit is equipped with a 344-foot stack.

Emissions unit 005 consists of 12 simple cycle gas turbines (GT1 through GT12) manufactured by the Pratt & Whitney Company, with a total capacity rated at 504 MW and 8424 MMBtu/hr. The emissions units are fired on any combination of No. 2 fuel oil and natural gas. Each turbine unit consists of two turbine engines which drive a turbine generator. Emissions are uncontrolled. Each unit is equipped with a 44-foot stack. The turbines are regulated collectively as one emission unit. Also included in this permit are miscellaneous unregulated/insignificant emissions units and/or activities.

Permitting Authority: Applications for Title V air operation permits for facilities that operate Acid Rain units are subject to review in accordance with the provisions of Chapter 403, Florida Statutes (F.S.) and Chapters 62-4, 62-210, 62-213 and 62-214, of the Florida Administrative Code (F.A.C.). The proposed project is not exempt from air permitting requirements and a Title V air operation permit is required to operate the facility. The Bureau of Air Regulation is the Permitting Authority responsible for making a permit determination for this project. The Permitting Authority's physical address is: 111 South Magnolia Drive, Suite #4, Tallahassee, Florida. The Permitting Authority's mailing address is: 2600 Blair Stone Road, MS #5505, Tallahassee, Florida 32399-2400. The Permitting Authority's telephone number is 850/488-0114.

Project File: A complete project file is available for public inspection during the normal business hours of 8:00 a.m. to 5:00 p.m., Monday through Friday (except legal holidays), at the address indicated above for the Permitting Authority. The complete project file includes the draft/proposed revised permit, the Statement of Basis, the application, and the information submitted by the applicant, exclusive of confidential records under

(Public Notice to be Published in the Newspaper)

PUBLIC NOTICE OF INTENT TO ISSUE TITLE V AIR OPERATION PERMIT REVISION

Section 403.111, F.S. Interested persons may view the draft/proposed revised permit by visiting the following website: <http://www.dep.state.fl.us/air/emission/apds/default.asp> and entering the permit number shown above. Interested persons may contact the Permitting Authority's project review engineer for additional information at the address or phone number listed above.

Notice of Intent to Issue Air Permit: The Permitting Authority gives notice of its intent to issue an air permit to the applicant for the project described above. The applicant has provided reasonable assurance that continued operation of existing equipment will not adversely impact air quality and that the project will comply with all appropriate provisions of Chapters 62-4, 62-204, 62-210, 62-212, 62-213, 62-214, 62-296 and 62-297, F.A.C. The Permitting Authority will issue a revised final Title V air operation permit in accordance with the conditions of the revised draft/proposed permit unless a timely petition for an administrative hearing is filed under Sections 120.569 and 120.57, F.S. or unless public comment received in accordance with this notice results in a different decision or a significant change of terms or conditions.

Comments: The Permitting Authority will accept written comments concerning the draft/proposed Title V air operation permit for a period of 30 days from the date of publication of the Public Notice. Written comments must be received by the close of business (5:00 p.m.), on or before the end of this 30-day period by the Permitting Authority at the above address. As part of his or her comments, any person may also request that the Permitting Authority hold a public meeting on this permitting action. If the Permitting Authority determines there is sufficient interest for a public meeting, it will publish notice of the time, date, and location in the Florida Administrative Weekly (FAW). If a public meeting is requested within the 30-day comment period and conducted by the Permitting Authority, any oral and written comments received during the public meeting will also be considered by the Permitting Authority. If timely received written comments or comments received at a public meeting result in a significant change to the revised draft/proposed permit, the Permitting Authority shall issue a revised draft/proposed permit and require, if applicable, another Public Notice. All comments filed will be made available for public inspection. For additional information, contact the Permitting Authority at the above address or phone number.

Petitions: A person whose substantial interests are affected by the proposed permitting decision may petition for an administrative hearing in accordance with Sections 120.569 and 120.57, F.S. The petition must contain the information set forth below and must be filed with (received by) the Department's Agency Clerk in the Office of General Counsel of the Department of Environmental Protection at 3900 Commonwealth Boulevard, Mail Station #35, Tallahassee, Florida 32399-3000. Petitions filed by any persons other than those entitled to written notice under Section 120.60(3), F.S. must be filed within 14 days of publication of the Public Notice or receipt of a written notice, whichever occurs first. Under Section 120.60(3), F.S., however, any person who asked the Permitting Authority for notice of agency action may file a petition within 14 days of receipt of that notice, regardless of the date of publication. A petitioner shall mail a copy of the petition to the applicant at the address indicated above, at the time of filing. The failure of any person to file a petition within the appropriate time period shall constitute a waiver of that person's right to request an administrative determination (hearing) under Sections 120.569 and 120.57, F.S., or to intervene in this proceeding and participate as a party to it. Any subsequent intervention (in a proceeding initiated by another party) will be only at the approval of the presiding officer upon the filing of a motion in compliance with Rule 28-106.205, F.A.C.

A petition that disputes the material facts on which the Permitting Authority's action is based must contain the following information: (a) The name and address of each agency affected and each agency's file or identification number, if known; (b) The name, address and telephone number of the petitioner; the name address and telephone number of the petitioner's representative, if any, which shall be the address for service purposes during the course of the proceeding; and an explanation of how the petitioner's substantial rights will be affected by the agency determination; (c) A statement of when and how the petitioner received notice of the agency action or proposed decision; (d) A statement of all disputed issues of material fact. If there are none, the petition must so indicate; (e) A concise statement of the ultimate facts alleged, including the specific facts the petitioner contends warrant reversal or modification of the agency's proposed action; (f) A statement of the specific rules or statutes the petitioner contends require reversal or modification of the agency's proposed

(Public Notice to be Published in the Newspaper)

PUBLIC NOTICE OF INTENT TO ISSUE TITLE V AIR OPERATION PERMIT REVISION

action including an explanation of how the alleged facts relate to the specific rules or statutes; and, (g) A statement of the relief sought by the petitioner, stating precisely the action the petitioner wishes the agency to take with respect to the agency's proposed action. A petition that does not dispute the material facts upon which the Permitting Authority's action is based shall state that no such facts are in dispute and otherwise shall contain the same information as set forth above, as required by Rule 28-106.301, F.A.C.

Because the administrative hearing process is designed to formulate final agency action, the filing of a petition means that the Permitting Authority's final action may be different from the position taken by it in this Public Notice of Intent to Issue a Revised Air Permit. Persons whose substantial interests will be affected by any such final decision of the Permitting Authority on the application have the right to petition to become a party to the proceeding, in accordance with the requirements set forth above.

Mediation: Mediation is not available for this proceeding.

EPA Review: EPA has agreed to treat the draft/proposed Title V air operation permit as a proposed Title V air operation permit and to perform its 45-day review provided by the law and regulations concurrently with the public comment period. Although EPA's 45-day review period will be performed concurrently with the public comment period, the deadline for submitting a citizen petition to object to the EPA Administrator will be determined as if EPA's 45-day review period is performed after the public comment period has ended. The final Title V air operation permit will be issued after the conclusion of the 45-day EPA review period so long as no adverse comments are received that result in a different decision or significant change of terms or conditions. The status regarding EPA's 45-day review of this project and the deadline for submitting a citizen petition can be found at the following website address: <http://www.epa.gov/region4/air/permits/Florida.htm>.

Objections: Finally, pursuant to 42 United States Code (U.S.C.) Section 7661d(b)(2), any person may petition the Administrator of the EPA within 60 days of the expiration of the Administrator's 45-day review period as established at 42 U.S.C. Section 7661d(b)(1), to object to the issuance of any Title V air operation permit. Any petition shall be based only on objections to the permit that were raised with reasonable specificity during the 30-day public comment period provided in the Public Notice, unless the petitioner demonstrates to the Administrator of the EPA that it was impracticable to raise such objections within the comment period or unless the grounds for such objection arose after the comment period. Filing of a petition with the Administrator of the EPA does not stay the effective date of any permit properly issued pursuant to the provisions of Chapter 62-213, F.A.C. Petitions filed with the Administrator of EPA must meet the requirements of 42 U.S.C. Section 7661d(b)(2) and must be filed with the Administrator of the EPA at: U.S. EPA, 401 M Street, S.W., Washington, D.C. 20460. For more information regarding EPA review and objections, visit EPA's Region 4 web site at <http://www.epa.gov/region4/air/permits/Florida.htm>.

STATEMENT OF BASIS

Title V Air Operation Permit Revision Permit No. 0110036-009-AV

APPLICANT

The applicant for this project is Florida Power and Light Company (FPL). The applicant's responsible official and mailing address are: Mr. Jeff Smith, Plant General Manager, Port Everglades Plant, 8100 Eisenhower Boulevard, Fort Lauderdale, Florida 33316.

FACILITY DESCRIPTION

The applicant operates the existing Port Everglades Plant, which is located in Broward County at 8100 Eisenhower Boulevard, Fort Lauderdale, Florida.

This facility consists of four fossil fuel steam generators and twelve simple cycle combustion turbines. Also included in this permit are miscellaneous unregulated/insignificant emissions units and/or activities.

Fossil fuel fired steam generators Unit 1 and Unit 2 are each 225 megawatt (MW) (electric) steam generators. The emissions units are fired on a variable combination of No. 6 fuel oil, No. 2 fuel oil, natural gas, propane and on-specification used oil from FPL operations. When firing fuel oil, the maximum heat input for each boiler is 2,300 million British thermal units (MMBtu) per hour, and when firing natural gas or propane, the maximum heat input for each boiler is 2,400 MMBtu per hour.

Each emissions unit consists of a boiler that drives a turbine generator. Emissions are controlled with low nitrogen oxides (NO_x) burners, and electrostatic precipitators (ESP) for particulate matter (PM) control. Each unit is equipped with a 343-foot stack with a 14-foot exit diameter. Units 1 and 2 have a flow rate of 813,929 actual cubic feet per minute (acfm). Exit velocity is 88.1 feet per second (fps) at 289 ° Fahrenheit (F). These emissions units are subject to Compliance Assurance Monitoring (CAM) for the ESP control devices.

Fossil fuel fired steam generators Unit 3 and Unit 4 are each 402 MW (electric) steam generators. The emissions units are fired on a variable combination of No. 6 fuel oil, No. 2 fuel oil, natural gas, propane and on-specification used oil from FPL operations. When firing fuel oil, the maximum heat input for each boiler is 4000 MMBtu per hour, and when firing natural gas or propane, the maximum heat input for each boiler is 4180 MMBtu per hour. Each emissions unit consists of a boiler which drives a turbine generator. Emissions are controlled with low NO_x burners and electrostatic precipitators (ESP) for PM control. Each unit is equipped with a 343-foot stack with an 18.1-foot exit diameter. Units 3 and 4 have a flow rate of 1,263,181 actual cubic feet per minute (acfm). Exit velocity is 81.8 feet per second (fps) at 287 ° F. These emissions units are subject to Compliance Assurance Monitoring (CAM) for the ESP control devices.

Emissions unit 005 consists of 12 simple cycle gas turbines (GT1 through GT12) manufactured by Pratt & Whitney, with a total capacity rated at 504 MW, and 8424 MMBtu/hr. The emissions units are fired on any combination of No. 2 fuel oil and natural gas. Each turbine unit consists of two turbine engines which drive a turbine generator. Emissions are uncontrolled. Each unit is equipped with a 45-foot stack with a 15.6-foot exit diameter. The units have a flow rate of 1,069,740 actual cubic feet per minute (acfm). Exit velocity is 93.3 feet per second (fps) at 860 ° F. The turbines are regulated collectively as one emission unit.

PROJECT DESCRIPTION

The purpose of this permitting project is to revise the Compliance Assurance Monitoring (CAM) plan for the existing Title V air operation permit for the above referenced facility.

PROCESSING SCHEDULE AND RELATED DOCUMENTS

Application for a Title V air operation permit revision received July 29, 2009.

PRIMARY REGULATORY REQUIREMENTS

Title III: The facility is identified as a major source of hazardous air pollutants (HAP).

STATEMENT OF BASIS

Title IV: The facility operates units subject to the acid rain provisions of the Clean Air Act.

Title V: The facility is a Title V major source of air pollution in accordance with Chapter 62-213, Florida Administrative Code (F.A.C.).

PSD: The facility is a Prevention of Significant Deterioration (PSD)-major source of air pollution in accordance with Rule 62-212.400, F.A.C.

CAM: The facility is subject to compliance assurance monitoring (CAM).

PROJECT REVIEW

In the permit application, FPL requested a revision to the Port Everglades Plant CAM Plan. The original CAM Plan submitted to the Department in the Fall of 2007 contained minimum secondary power values as a demonstration of compliance that were calculated by the original equipment manufacturer (OEM) from their engineering data. During the course of the Title V permit renewal development in 2008, which incorporated the CAM Plan, the Department requested minimum power values that were associated with compliance testing, rather than OEM calculated values. FPL provided the Department a revised copy of the CAM Plan (Rev 1 November 2008) which contained power values that were observed during the original commissioning tests in 2005 and 2007. When the revision was supplied to the Department, FPL recognized that the minimum power values were overly conservative by a considerable margin. At the time, they were the only data available coincident with compliance testing and were not optimized for minimum power scenarios.

In March of this year FPL conducted a series of particulate matter (PM) tests to optimize the minimum number of transformer-rectifier (TR) sets in service, and the minimum secondary power values needed to demonstrate compliance with the PM standard of 0.03 lb/MMBtu.

This change is acceptable to the Department, and Appendix CAM of the current Title V air operation permit is revised to incorporate the new minimum secondary power values and minimum number of TR sets in service as follows (~~strike through~~ indicates deletion and double underline indicates addition of text):

Appendix CAM, Page 8 of 9, II. Indicator Range, Indicator 1 - For Units 001 and 002, an excursion is defined as any hourly average of the ESP secondary power level less than ~~264~~ 46 kilowatts. For Units 003 and 004, an excursion is defined as any hourly average of the ESP secondary power level less than ~~524~~ 88 kilowatts. An excursion will trigger an investigation of the occurrence, corrective actions, and a reporting/documentation requirement.

Appendix CAM, Page 9 of 9, III Performance Criteria, G. Operational Requirements, Indicator 1 and Indicator 2: At least six of the eight TR sets installed on ~~each of the four (4) ESP units~~ Units 001 and 002 shall be in service at all times when 100% fuel oil is being fired. At least two of the eight TR sets installed on Units 003 and 004 shall be in service at all times when 100% fuel oil is being fired.

In addition, the annual emissions fee web site address was updated in facility-wide condition FW7 and the Risk Management Plan reporting center address was updated in facility-wide condition FW9.

CONCLUSION

This project revises Title V air operation permit No. 0110036-007-AV, which was issued on January 1, 2009. This Title V air operation permit revision is issued under the provisions of Chapter 403, Florida Statutes (F.S.), and Chapters 62-4, 62-210, 62-213 and 62-214, F.A.C.

Florida Power and Light Company
Port Everglades Plant
Facility ID No. 0110036
Broward County

Title V Air Operation Permit Revision

Draft/Proposed Permit No. 0110036-009-AV
(Second Revision of Title V Air Operation Permit No. 0110036-007-AV)

Permitting Authority

State of Florida
Department of Environmental Protection
Division of Air Resource Management
Bureau of Air Regulation
Title V Section

Mail Station #5505
2600 Blair Stone Road
Tallahassee, Florida 32399-2400

Telephone: 850/488-0114
Fax: 850/921-9533

Compliance Authority

State of Florida
Broward County Environmental Protection Department
Air Quality Division

115 South Andrews Avenue, Room A-240
Fort Lauderdale, Florida 33301

Telephone: 954-519-1220
Fax: 954-519-1495

Title V Air Operation Permit Revision

Permit No. 0110036-009-AV

Table of Contents

<u>Section</u>	<u>Page Number</u>
I. Facility Information.	
A. Facility Description.	2
B. Summary of Emissions Units.	2
C. Applicable Regulations.	2
II. Facility-wide Conditions.	4
III. Emissions Units and Conditions.	
A. Emissions Units 001 & 002, Fossil Fuel Steam Generators, Units 1 & 2.	6
B. Emissions Units 003 & 004, Fossil Fuel Steam Generators, Units 3 & 4.	11
C. Emissions Unit 005, 12 Simple Cycle Gas Turbines, GT1 through GT1.2.	16
D. Common Conditions.	19
IV. Acid Rain Part.	
A. Acid Rain, Phase II.	22
Phase II Acid Rain Application/Compliance Plan.	
V. Clean Air Interstate Rule (CAIR) Part (this Section added under revision project No. 0110036-008-AV). ..	26
VI. Appendices.	32
Appendix A, Glossary.	
Appendix ASP, ASP Number 97-B-01 (With Scrivener’s Order Dated July 9, 1997).	
Appendix CAM, Compliance Assurance Monitoring Plan (<u>revised under Project No. 0110036-009-AV</u>).	
Appendix I, List of Insignificant Emissions Units and/or Activities.	
Appendix O, Order Granting Petition for Reduced Frequency of Particulate Testing.	
Appendix RR, Facility-wide Reporting Requirements.	
Appendix TR, Facility-wide Testing Requirements.	
Appendix TV, Title V General Conditions.	
Appendix U, List of Unregulated Emissions Units and/or Activities.	
Referenced Attachments.	At End
Table H, Permit History	
Table 1, Summary of Air Pollutant Standards.	
Table 2, Summary of Compliance Requirements.	

DRAFT/PROPOSED PERMIT

PERMITTEE:

Florida Power and Light Company
8100 Eisenhower Boulevard
Fort Lauderdale, Florida 33316

Permit No. 0110036-009-AV
Port Everglades Plant
Facility ID No. 0110036
Title V Air Operation Permit Revision

The purpose of this permit is to revise the Title V air operation permit for the above referenced facility. The existing Port Everglades Plant is located at 8100 Eisenhower Boulevard, Fort Lauderdale, in Broward County. UTM coordinates are: Zone 17, 587.38 km East and 2885.25 km North. Latitude is: 26° 05' 08" North; and, Longitude is: 80° 07' 31" West.

The Title V air operation permit is issued under the provisions of Chapter 403, Florida Statutes (F.S.), and Florida Administrative Code (F.A.C.) Chapters 62-4, 62-210, 62-213 and 62-214. The above named permittee is hereby authorized to operate the facility shown on the application and approved drawings, plans, and other documents, attached hereto or on file with the permitting authority, in accordance with the terms and conditions of this permit.

0110036-007-AV Effective Date: January 1, 2009

0110036-008-AV Effective Date: March 26, 2009

0110036-009-AV Effective Date:

Renewal Application Due Date: May 20, 2013

Expiration Date: December 31, 2013

(Draft/Proposed)

Joseph Kahn, Director
Division of Air Resource Management

SECTION I. FACILITY INFORMATION.

Subsection A. Facility Description.

This facility consists of four fossil fuel steam generators and twelve simple cycle combustion turbines. Also included in this permit are miscellaneous unregulated/insignificant emissions units and/or activities.

Subsection B. Summary of Emissions Units.

EU No.	Brief Description
<i>Regulated Emissions Units</i>	
001	Fossil Fuel Steam Generator, Unit 1, rated at 225 megawatts (MW), 2,400 million British thermal units per hour (MMBtu/hr) for natural gas and 2,300 MMBtu/hr for number 6 fuel oil, capable of burning any combination of natural gas, No. 6 fuel oil, No. 2 fuel oil, propane and on-specification used oil from Florida Power and Light Company (FPL) operations, with emissions exhausted through a 344 ft. stack.
002	Fossil Fuel Steam Generator, Unit 2, rated at 225 MW, 2,400 MMBtu/hr for natural gas and 2,300 MMBtu/hr for number 6 fuel oil, capable of burning any combination of natural gas, No. 6 fuel oil, No. 2 fuel oil, propane and on-specification used oil from FPL operations, with emissions exhausted through a 344 ft. stack.
003	Fossil Fuel Steam Generator, Unit 3, rated at 402 MW, 4,180 MMBtu/hr for natural gas and 4,000 MMBtu/hr for No. 6 fuel oil, capable of burning any combination of natural gas, No. 6 fuel oil, No. 2 fuel oil, propane and on-specification used oil from FPL operations, with emissions exhausted through a 344 ft. stack.
004	Fossil Fuel Steam Generator, Unit 4, rated at 402 MW, 4,180 MMBtu/hr for natural gas and 4,000 MMBtu/hr for No. 6 fuel oil, capable of burning any combination of natural gas, No. 6 fuel oil, diesel fuel, propane and on-specification used oil from FPL operations, with emissions exhausted through a 344 ft. stack.
005	12 Simple Cycle Gas Turbines, GT1 through GT12, with a total capacity rated at 504 MW, 8,424 MMBtu/hr, capable of burning any combination of, No. 2 fuel oil and natural gas, with emissions exhausted through twelve 44 ft. stacks.
<i>Unregulated Emissions Units and Activities</i>	
017	Above ground fuel oil storage tanks.
018	Miscellaneous internal combustion engines and portable equipment.

Subsection C. Applicable Regulations.

Based on the Title V air operation renewal application received July 2, 2008, this facility is a major source of hazardous air pollutants (HAP). This facility is classified as a PSD major facility. A summary of applicable regulations is shown in the following table.

Regulation	EU No(s).
40 CFR 75 Acid Rain Monitoring Provisions	001, 002, 003, 004
State Rule Citations	
Rule 62-4, Florida Administrative Code (F.A.C.) (Permitting Requirements)	001, 002, 003, 004, 005
Rule 62-204, F.A.C. (Ambient Air Quality Requirements, PSD Increments, and Federal Regulations Adopted by Reference)	
Rule 62-210, F.A.C. (Permits Required, Public Notice, Reports, Stack	

SECTION I. FACILITY INFORMATION.

Height Policy, Circumvention, Excess Emissions, and Forms)	
Rule 62-212, F.A.C. (Preconstruction Review, PSD Review and Best Available Control Technology (BACT))	
Rule 62-213, F.A.C. (Title V Air Operation Permits for Major Sources of Air Pollution)	
Rule 62-214, F.A.C. (Requirements For Sources Subject To The Federal Acid Rain Program)	001, 002, 003,004
Rule 62-296, F.A.C. (Emission Limiting Standards)	
Rule 62-297, F.A.C. (Test Methods and Procedures, Continuous Monitoring Specifications, and Alternate Sampling Procedures)	001, 002, 003, 004, 005

SECTION II. FACILITY-WIDE CONDITIONS.

The following conditions apply facility-wide to all emission units and activities:

FW1. Appendices. The permittee shall comply with all documents identified in Section V, Appendices, listed in the Table of Contents. Each document is an enforceable part of this permit unless otherwise indicated. [Rule 62-213.440, F.A.C.]

Emissions and Controls

FW2. Objectionable Odor Prohibited. No person shall cause, suffer, allow or permit the discharge of air pollutants, which cause or contribute to an objectionable odor. An "objectionable odor" means any odor present in the outdoor atmosphere which by itself or in combination with other odors, is or may be harmful or injurious to human health or welfare, which unreasonably interferes with the comfortable use and enjoyment of life or property, or which creates a nuisance. [Rule 62-296.320(2) and 62-210.200(Definitions), F.A.C.]

FW3. General Volatile Organic Compounds (VOC) Emissions or Organic Solvents (OS) Emissions. The permittee shall allow no person to store, pump, handle, process, load, unload or use in any process or installation, volatile organic compounds or organic solvents without applying known and existing vapor emission control devices or systems deemed necessary and ordered by the Department. Nothing is deemed necessary and ordered at this time. [Rule 62-296.320(1)(a), F.A.C.]

FW4. General Visible Emissions. No person shall cause, let, permit, suffer or allow to be discharged into the atmosphere the emissions of air pollutants from any activity equal to or greater than 20% opacity. EPA Method 9 is the method of compliance pursuant to Chapter 62-297, F.A.C. This regulation does not impose a specific testing requirement. [Rule 62-296.320(4)(b)1, F.A.C.]

FW5. Unconfined Particulate Matter. Reasonable precautions to prevent emissions of unconfined particulate matter at this facility include:

- a. The facility shall construct temporary sandblasting enclosures when necessary, in order to perform sandblasting on fixed plant equipment.
- b. Maintenance of paved areas shall be performed as needed.
- c. Regular mowing of grass and care of vegetation shall be performed.
- d. Access to plant property by unnecessary vehicles shall be limited.
- e. Bagged chemical products shall be stored in weather-tight buildings until they are used.
- f. Spills of powdered chemical products shall be cleaned up as soon as practicable.
- g. Vehicles shall be restricted to slow speeds on the plant site.

[Rule 62-296.320(4)(c)2., F.A.C.; and provided by the applicant in Title V air operation permit renewal application received July 2, 2008.]

Annual Reports and Fees

See Appendix RR, Facility-wide Reporting Requirements for additional details.

FW6. Annual Operating Report. The permittee shall submit an annual report that summarizes the actual operating rates and emissions from this facility. Annual operating reports shall be submitted to the Compliance Authority by May 1st for 2009 and April 1st of each year thereafter. [Rule 62-210.370(3), F.A.C.]

FW7. Annual Emissions Fee Form and Fee. The annual Title V emissions fees are due by March 1st of each year. The completed form and calculated fee shall be submitted to: Major Air Pollution Source Annual Emissions Fee, P.O. Box 3070, Tallahassee, Florida 32315-3070. The forms are available for download by accessing the Title V Annual Emissions Fee On-line Information Center at the following Internet web site: <http://www.dep.state.fl.us/air/emission/tvfee.htm>. [Rule 62-213.205, F.A.C.]

FW8. Annual Statement of Compliance. The permittee shall submit an annual statement of compliance to the compliance authority at the address shown on the cover of this permit within 60 days after the end of each calendar year during which the Title V air operation permit was effective. [Rules 62-213.440(3)(a)2. & 3. and (b), F.A.C.]

SECTION II. FACILITY-WIDE CONDITIONS.

FW9. Prevention of Accidental Releases (Section 112(r) of CAA).

- a. The permittee shall submit its Risk Management Plan (RMP) to the Chemical Emergency Preparedness and Prevention Office (CEPPO) RMP Reporting Center when, and if, such requirement becomes applicable. Any Risk Management Plans, original submittals, revisions or updates to submittals, should be sent to: RMP Reporting Center, Post Office Box 10162, Fairfax, VA 22038, Telephone: (703) 227-7650.
- b. The permittee shall submit to the permitting authority Title V certification forms or a compliance schedule in accordance with Rule 62-213.440(2), F.A.C.

[40 CFR 68]

~~**FW10. Clean Air Interstate Rule (CAIR) Applicable Units.** This facility contains emissions units that are subject to CAIR. On July 11, 2008, the U.S. Court of Appeals for the District of Columbia recommended vacature of the Clean Air Interstate Rule. Because of this decision, the applicable CAIR requirements that were identified in the renewal application are not being included in the permit at this time. If, and at such time that, CAIR is ultimately upheld, you must begin complying with the CAIR program requirements contained in the renewal application and the Title V air operation permit must be revised accordingly. [Rules 62-213.440 and 62-296.470, F.A.C.] (This condition removed as part of revision project No. 0110036-008-AV)~~

SECTION III. EMISSIONS UNITS AND SPECIFIC CONDITIONS.

Subsection A. Emissions Units 001 and 002

The specific conditions in this section apply to the following emissions unit(s):

EU No.	Brief Description
001	Fossil Fuel Steam Generator, Unit 1
002	Fossil Fuel Steam Generator, Unit 2

Fossil fuel fired steam generators Unit 1 and Unit 2 are each 225 MW (electric) steam generators. The emissions units are fired on a variable combination of No. 6 fuel oil, No. 2 fuel oil, natural gas, propane, and on-specification used oil from FPL operations. When firing fuel oil, the maximum heat input for each boiler is 2,300 MMBtu per hour, and when firing natural gas or propane, the maximum heat input for each boiler is 2,400 MMBtu per hour.

Each emissions unit consists of a boiler that drives a turbine generator. Emissions are controlled with low nitrogen oxides (NO_x) burners, and electrostatic precipitators (ESP) for particulate matter (PM) control. Each unit is equipped with a 343-foot stack with a 14-foot exit diameter. Units 1 and 2 have a flow rate of 813,929 actual cubic feet per minute (acfm). Exit velocity is 88.1 feet per second (fps) at 289 °F. These emissions units are subject to Compliance Assurance Monitoring (CAM) for the ESP control devices.

{Permitting note(s): These emissions units are regulated under Acid Rain, Phase II; and Rule 62-296.405, F.A.C., Fossil Fuel Steam Generators with More than 250 million Btu per Hour Heat Input. Fossil fuel fired steam generator Unit 1 began commercial operation in 1960 and fossil fuel fired steam generator Unit 2 began commercial operation in 1961.}

Essential Potential to Emit (PTE) Parameters

A.1. Permitted Capacity. The maximum operation heat input rate is as follows:

<u>Unit No.</u>	<u>MMBtu/hr Heat Input*</u>	<u>Fuel Type</u>
1	2,400	Natural Gas, Propane
	2,300	No. 2 or 6 Fuel Oil
2	2,400	Natural Gas, Propane
	2,300	No. 2 or 6 Fuel Oil

*When a blend of fuel oil and natural gas or propane is burned, the heat input is prorated based upon the percent heat input of each fuel.

[Rules 62-4.160(2), 62-204.800, 62-210.200(PTE) and 62-296.405, F.A.C.]

{Permitting note: The heat input limitations have been placed in each permit to identify the capacity of each unit for the purposes of confirming that emissions testing is conducted within 90 to 100 percent of the unit's rated capacity (or to limit future operation to 110 percent of the test load), to establish appropriate emission limits and to aid in determining future rule applicability.}

A.2. Emissions Unit Operating Rate Limitation After Testing. See the related testing provisions in Appendix TR, Facility-wide Testing Requirements. [Rule 62-297.310(2), F.A.C.]

A.3. Methods of Operation.

- a. *Fuels.* The only fuels allowed to be burned are any combination of No. 6 fuel oil, No. 2 fuel oil, natural gas, propane, and on-specification used oil from FPL operations.
- b. *Other.* These emissions units may have additives, such as magnesium hydroxide and related compounds, injected into each boiler for boiler cleaning.

[Rule 62-213.410, F.A.C.]

A.4. Hours of Operation. See Specific Condition **D.1.**

SECTION III. EMISSIONS UNITS AND SPECIFIC CONDITIONS.

Subsection A. Emissions Units 001 and 002

Emission Limitations and Standards

{Permitting Note: The attached Table 1, Summary of Air Pollutant Standards, summarizes information for convenience purposes only. This table does not supersede any of the terms or conditions of this permit.}

Unless otherwise specified, the averaging times for Specific Conditions A.5.-A.10. are based on the specified averaging time of the applicable test method.

- A.5. Visible Emissions – Steady State Operation.** Visible emissions shall not exceed 20 percent opacity. Emissions units governed by this visible emissions standard shall conduct a compliance test for visible emissions annually using EPA Reference Method 9. [0110036-005-AC, Specific Condition A.16.]
- A.6. Visible Emissions – Soot Blowing and Load Change.** Visible emissions shall not exceed 40 percent opacity during the 3-hours in any 24-hour period of excess emissions allowed for boiler cleaning (soot blowing) and load change.
A load change occurs when the operational capacity of a unit is in the 10 percent to 100 percent capacity range, other than startup or shutdown, which exceeds 10 percent of the unit's rated capacity and which occurs at a rate of 0.5 percent per minute or more.
Visible emissions above 40 percent opacity shall be allowed for not more than 4, six (6)-minute periods, during the 3-hour period of excess emissions allowed by this condition.
Note: these units have operational continuous opacity monitors.
[Rule 62-210.700(3), F.A.C.; and 0110036-005-AC, Specific Condition A.17.]
- A.7. Particulate Matter – Steady State Operation.** Particulate matter emissions shall not exceed 0.03 pound per million Btu heat input, as measured by applicable compliance methods. [0110036-005-AC, Specific Condition A.18.]
- A.8. Particulate Matter – Soot Blowing and Load Change.** Particulate matter emissions shall not exceed an average of 0.1 pound per million Btu heat input during the 3-hours in any 24-hour period of excess emissions allowed for boiler cleaning (soot blowing) and load change. [0110036-005-AC, Specific Condition A.19.]
- A.9. Sulfur Dioxide.** Sulfur dioxide (SO₂) emissions shall not exceed 2.75 pounds per million Btu heat input, as measured by applicable compliance methods. Compliance shall be based on the total heat input from all liquid and gaseous fuels burned. The SO₂ emission limitation shall apply at all times including startup, shutdown, and load change. [Rules 62-213.440 and 62-296.405, F.A.C.]
- A.10. Nitrogen Oxides.** Nitrogen oxides emissions shall not exceed 0.20 pounds per million Btu while firing natural gas, and 0.36 pounds per million Btu while firing oil. Compliance shall be demonstrated based on a 30-day rolling average as measured by a continuous emissions monitoring system (CEMS). The CEMS must meet the performance specifications contained in 40 CFR 60, Appendix B, or 40 CFR 75. [Rule 62-296.570, F.A.C.]

Excess Emissions

Rule 62-210.700 (Excess Emissions), F.A.C. cannot vary any requirement of an NSPS, NESHAP or Acid Rain program provision.

- A.11. Excess Emissions.** See Specific Conditions D.2, D.3 and D.4.

Monitoring of Operations

- A.12. CAM Plan.** These emissions units are subject to the Compliance Assurance Monitoring (CAM) requirements contained in the attached Appendix CAM. Failure to adhere to the monitoring requirements specified does not necessarily indicate an exceedance of a specific emissions limitation; however, it may constitute good reason to require compliance testing pursuant to Rule 62-297.310(7)(b), F.A.C. [40 CFR 64; Rules 62-204.800 and 62-213.440, F.A.C.]

SECTION III. EMISSIONS UNITS AND SPECIFIC CONDITIONS.

Subsection A. Emissions Units 001 and 002

Continuous Monitoring Requirements

- A.13. COMS for Periodic Monitoring.** The owner or operator has installed continuous opacity monitoring systems (COMS) pursuant to 40 CFR Part 75. The owner or operator shall maintain and operate the COMS and shall make and maintain records of opacity measured by the COMS, for purposes of periodic monitoring. [Rule 62-213.440, F.A.C.; and applicant agreement with EPA on March 3, 1998]
- A.14. Sulfur Dioxide.** The owner or operator of the emission units shall demonstrate compliance with the sulfur dioxide limit of this permit by the following:
- Through the use of a continuous emission monitoring system (CEMS) installed, calibrated, operated and maintained in accordance with the quality assurance requirements of 40 CFR 75, adopted and incorporated by reference in Rule 62-204.800, F.A.C. A Relative Accuracy Test Audit of the SO₂ CEMS shall be conducted no less than annually. Compliance shall be demonstrated based on a 3-hour rolling average.
 - In the event the CEMS becomes temporarily inoperable or interrupted, the fuels and the maximum fuel oil to natural gas firing ratio that shall be used is limited to that which was last used to demonstrate compliance prior to the loss of the CEMS, or the emissions units shall fuel switch and be fired with a fuel oil containing a maximum sulfur content of 2.5%, by weight, or less.
 - When burning 100% fuel oil, the emissions units shall be fired with a fuel oil containing a maximum sulfur content of 2.5%, by weight, or less.
- [Rules 62-213.440, 62-204.800 and 62-296.405, F.A.C.]

Test Methods and Procedures

- A.15. Test Methods.** Required tests shall be performed in accordance with the following reference methods:

Method	Description of Method and Comments
1-4	Traverse Points, Velocity and Flow Rate, Gas Analysis, and Moisture Content
3A	Determination of Oxygen and Carbon Dioxide Concentrations in Emissions from Stationary Sources
5B	Method for Determining Particulate Matter Emissions (All PM is assumed to be PM ₁₀ .)
7E	Determination of Nitrogen Oxide Emissions from Stationary Sources
9	Visual Determination of the Opacity of Emissions from Stationary Sources
19	Determination of Sulfur Dioxide Removal Efficiency and Particulate Matter, Sulfur Dioxide, and Nitrogen Oxides Emission Rates (Optional F-factor method may be used to determine flow rate and gas analysis to calculate mass emissions in lieu of Methods 1-4.)
20	Determination of Nitrogen Oxides, Sulfur Dioxide and Diluent Emissions from Stationary Gas Turbines

The above methods are described in 40 CFR 60, Appendix A, and adopted by reference in Rule 62-204.800, F.A.C. No other methods may be used unless prior written approval is received from the Department. [Rules 62-4.070(3) and 62-213.440, F.A.C.]

- A.16. Visible Emissions.** The test method for visible emissions shall be DEP Method 9, incorporated in Chapter 62-297, F.A.C. A transmissometer may be used and calibrated according to Rule 62-297.520, F.A.C. [Rules 62-296.405 and 62-297.401, F.A.C.]
- A.17. Annual Tests Required for PM and VE.** Except as provided in specific conditions **A.18** and **A.19** of this permit, emission testing for particulate emissions and visible emissions shall be performed annually, no later than September 30th of each year, except for units that are not operating because of scheduled maintenance

SECTION III. EMISSIONS UNITS AND SPECIFIC CONDITIONS.

Subsection A. Emissions Units 001 and 002

outages and emergency repairs, which will be tested within thirty days of returning to service. Unless specifically requested by the Compliance Authority pursuant to Rule 62-297.310(7)(b), F.A.C., periodic opacity tests are not required when firing natural gas. [Rules 62-4.070(3), 62-213.440 and 62-297.310(7), F.A.C.]

A.18. When PM Tests Not Required. See Specific Condition **D.5.**

A.19. When VE Tests Not Required. See Specific Condition **D.6.**

A.20. Testing While Injecting Additives. The owner or operator shall conduct emission tests while injecting additives consistent with normal operating practices. [Rule 62-213.440, F.A.C., applicant agreement with EPA on March 3, 1998]

A.21. Particulate Matter. The test methods for particulate emissions shall be EPA Methods 17, 5, 5B, or 5F, incorporated by reference in Chapter 62-297, F.A.C. The minimum sample volume shall be 30 dry standard cubic feet. EPA Method 5 may be used with filter temperature no more than 320 degrees Fahrenheit. For EPA Method 17, stack temperature shall be less than 375 degrees Fahrenheit. The owner or operator may use EPA Method 5 to demonstrate compliance. EPA Method 3 or 3A shall be used when the oxygen based F-factor, computed according to EPA Method 19, is used in lieu of heat input. Acetone wash shall be used with EPA Method 5 or 17. [Rules 62-213.440, 62-296.405, and 62-297.401, F.A.C.]

A.22. Sulfur Dioxide. The test methods for sulfur dioxide emissions shall be EPA Methods 6, 6A, 6B, or 6C, incorporated by reference in Chapter 62-297, F.A.C. If the emissions unit obtains an alternate procedure under the provisions of Rule 62-297.620, F.A.C., the procedure shall become a condition of the emissions unit's permit. The Department will retain the authority to require EPA Method 6 or 6C if it has reason to believe that exceedences of the sulfur dioxide emissions limiting standard are occurring. The permittee may use the EPA test methods, referenced above, to demonstrate compliance; however, as an alternate sampling procedure authorized by permit, the permittee shall demonstrate compliance using CEMS for sulfur dioxide. [Rules 62-213.440 and 62-296.405, F.A.C.]

A.23. Operating Conditions During Testing - PM and VE. Compliance testing during sootblowing and steady-state operation for particulate matter and visible emissions shall be conducted at least once annually, if liquid fuel is fired for more than 400 hours. A visible emissions test shall be conducted during one run of each particulate matter test. Testing shall be conducted as follows:

- a. *When Burning 100% Fuel Oil.* Particulate matter and visible emissions tests during sootblowing and steady-state operation shall be performed on such emissions unit while firing solely fuel oil of less than or equal to 2.5% sulfur by weight (stoichiometrically representative of sulfur dioxide emissions of the SO₂ emission limit of 2.75 lb/MMBtu), except that such test shall not be required to be performed during any year that testing is performed in accordance with the following paragraph.
- b. *When Burning Fuel Oil While Co-firing With Natural Gas.* Particulate matter and visible emissions tests during sootblowing and steady-state operation shall be performed on such emissions unit while co-firing oil with the appropriate proportion of natural gas required to maintain SO₂ emissions below the emission limit of 2.75 lb/MMBtu heat input.
- c. *Test Required if Target SO₂ Emission Rate Increased.* Following successful completion of such PM and VE testing, further PM and VE testing shall not be required during the next 12 months unless fuel oil is fired that contains greater than 0.20% sulfur above the percentage sulfur concentration fired during the most recent co-firing test. If fuel oil is co-fired containing greater than 0.20% sulfur above the percentage sulfur concentration fired during the most recent co-firing test, additional PM and VE tests shall be performed as described above as soon as practicable, but in no event more than 60 days after firing such higher sulfur fuel oil.

[Rules 62-4.070(3), 62-213.440, 62-296.405 and 62-297.310, F.A.C.; request of applicant; and Administrative Correction 0110036-002-AV.]

SECTION III. EMISSIONS UNITS AND SPECIFIC CONDITIONS.

Subsection A. Emissions Units 001 and 002

A.24. Common Testing Requirements. Unless otherwise specified, tests shall be conducted in accordance with the requirements and procedures specified in Appendix TR, Facility-Wide Testing Requirements, of this permit. [Rule 62-297.310(7), F.A.C.]

Recordkeeping and Reporting Requirements

See Appendix RR, Facility-Wide Reporting Requirements, for additional reporting requirements.

A.25. Fuel Records. The owner or operator shall create and maintain for each emission unit hourly records of the amount of each fuel fired, the ratio of fuel oil to natural gas if co-fired, and the heating value and sulfur content of each fuel fired. These records must be of sufficient detail to identify the testing requirements for SO₂ of this permit. Fuel oil heating value and sulfur content shall be determined by taking a daily sample of the fuel fired, combining those samples into a monthly composite, and analyzing a representative sample of the composite. Analysis for sulfur content shall be performed using one of ASTM D2622-94, ASTM D4294-90(95), ASTM D1552-95, ASTM D1266-91, both ASTM D4057-88 and ASTM D129-95, or the latest edition(s). Comparison of the as-fired fuel oil sulfur content shall be made and recorded monthly upon receipt of each monthly composite analysis. [Rules 62-4.070(3), 62-213.410, 62-213.440 and 62-296.405, F.A.C.]

SECTION III. EMISSIONS UNITS AND SPECIFIC CONDITIONS.

Subsection B. Emissions Units 003 and 004

The specific conditions in this section apply to the following emissions unit(s):

EU No.	Brief Description
003	Fossil Fuel Steam Generator, Unit 3
004	Fossil Fuel Steam Generator, Unit 4

Fossil fuel fired steam generators Unit 3 and Unit 4 are each 402 MW (electric) steam generators. The emissions units are fired on a variable combination of No. 6 fuel oil, No. 2 fuel oil, natural gas, propane, and on-specification used oil from FPL operations. When firing fuel oil, the maximum heat input for each boiler is 4,000 MMBtu per hour, and when firing natural gas or propane, the maximum heat input for each boiler is 4,180 MMBtu per hour. Each emissions unit consists of a boiler which drives a turbine generator. Emissions are controlled with low NO_x burners and electrostatic precipitators (ESP) for PM control. Each unit is equipped with a 343-foot stack with an 18.1-foot exit diameter. Units 3 and 4 have a flow rate of 1,263,181 actual cubic feet per minute (acfm). Exit velocity is 81.8 feet per second (fps) at 287° F. These emissions units are subject to Compliance Assurance Monitoring (CAM) for the ESP control devices.

{Permitting note(s): These emissions units are regulated under Acid Rain, Phase II; and Rule 62-296.405, F.A.C., Fossil Fuel Steam Generators with More than 250 million Btu per Hour Heat Input. Fossil fuel fired steam generator Unit 3 began commercial operation in 1965, and fossil fuel fired steam generator Unit 4 began commercial operation in 1964.}

Essential Potential to Emit (PTE) Parameters

B.1. Permitted Capacity. The maximum operation heat input rate is as follows:

<u>Unit No.</u>	<u>MMBtu/hr Heat Input*</u>	<u>Fuel Type</u>
3	4,180	Natural Gas, Propane
	4,000	No. 2 or 6 Fuel Oil
4	4,180	Natural Gas, Propane
	4,000	No. 2 or 6 Fuel Oil

*When a blend of fuel oil and natural gas or propane is burned, the heat input is prorated based upon the percent heat input of each fuel. [Rules 62-4.160(2), 62-204.800, 62-210.200(PTE) and 62-296.405, F.A.C.]

{Permitting note: The heat input limitations have been placed in each permit to identify the capacity of each unit for the purposes of confirming that emissions testing is conducted within 90 to 100 percent of the unit's rated capacity (or to limit future operation to 110 percent of the test load), to establish appropriate emission limits and to aid in determining future rule applicability.}

B.2. Emissions Unit Operating Rate Limitation After Testing. See the related testing provisions in Appendix TR, Facility-wide Testing Requirements. [Rule 62-297.310(2), F.A.C.]

B.3. Methods of Operation.

- a. *Fuels.* The only fuels allowed to be burned are any combination of No. 6 fuel oil, No. 2 fuel oil, natural gas, propane, and on-specification used oil from FPL operations.
- b. *Other.* These emissions units may have additives, such as magnesium hydroxide and related compounds, injected into each boiler for boiler cleaning.

[Rule 62-213.410, F.A.C.]

B.4. Hours of Operation. See Specific Condition D.1.

Emission Limitations and Standards

B.5. Visible Emissions – Steady State Operation. Visible emissions shall not exceed 20 percent opacity. Emissions units governed by this visible emissions standard shall conduct a compliance test for visible

SECTION III. EMISSIONS UNITS AND SPECIFIC CONDITIONS.

Subsection B. Emissions Units 003 and 004

emissions annually using EPA Reference Method 9. [0110036-005-AC, Specific Condition A.16.]

- B.6. Visible Emissions – Soot Blowing and Load Change.** Visible emissions shall not exceed 40 percent opacity during the 3-hours in any 24-hour period of excess emissions allowed for boiler cleaning (soot blowing) and load change.

A load change occurs when the operational capacity of a unit is in the 10 percent to 100 percent capacity range, other than startup or shutdown, which exceeds 10 percent of the unit's rated capacity and which occurs at a rate of 0.5 percent per minute or more.

Visible emissions above 40 percent opacity shall be allowed for not more than 4, six (6)-minute periods, during the 3-hour period of excess emissions allowed by this condition.

Note: these units have operational continuous opacity monitors.

[Rule 62-210.700(3), F.A.C.; and 0110036-005-AC, Specific Condition A.17.]

- B.7. Particulate Matter – Steady State Operation.** Particulate matter emissions shall not exceed 0.03 pound per million Btu heat input, as measured by applicable compliance methods. [0110036-005-AC, Specific Condition A.18.]
- B.8. Particulate Matter – Soot Blowing and Load Change.** Particulate matter emissions shall not exceed an average of 0.1 pound per million Btu heat input during the 3-hours in any 24-hour period of excess emissions allowed for boiler cleaning (soot blowing) and load change. [0110036-005-AC, Specific Condition A.19.]
- B.9. Sulfur Dioxide.** Sulfur dioxide emissions shall not exceed 2.75 pounds per million Btu heat input, as measured by applicable compliance methods. Compliance shall be based on the total heat input from all liquid and gaseous fuels burned. The sulfur dioxide emission limitation shall apply at all times including startup, shutdown, and load change. [Rules 62-213.440 and 62-296.405, F.A.C.]
- B.10. Nitrogen Oxides.** Nitrogen oxides emissions shall not exceed 0.40 pounds per million Btu while firing natural gas, and 0.53 pounds per million Btu while firing oil. Compliance shall be demonstrated based on a 30-day rolling average as measured by a CEMS. The CEMS must meet the performance specifications contained in 40 CFR 60, Appendix B, or 40 CFR 75. [Rules 62-296.570(4)(a)4. and (4)(b)2., F.A.C.]

Excess Emissions

Rule 62-210.700 (Excess Emissions), F.A.C. cannot vary any requirement of an NSPS, NESHAP or Acid Rain program provision.

- B.11.** See Specific Conditions **D.2**, **D.3** and **D.4**.

Monitoring of Operations

- B.12. CAM Plan.** These emissions units are subject to the Compliance Assurance Monitoring (CAM) requirements contained in the attached Appendix CAM. Failure to adhere to the monitoring requirements specified does not necessarily indicate an exceedance of a specific emissions limitation; however, it may constitute good reason to require compliance testing pursuant to Rule 62-297.310(7)(b), F.A.C. [40 CFR 64; Rules 62-204.800 and 62-213.440(1)(b)1.a., F.A.C.]

Continuous Monitoring Requirements

- B.13. COMS for Periodic Monitoring.** The owner or operator has installed continuous opacity monitoring systems (COMS) pursuant to 40 CFR Part 75. The owner or operator shall maintain and operate COMS and shall make and maintain records of opacity measured by the COMS, for purposes of periodic monitoring. [Rule 62-213.440, F.A.C., and applicant agreement with EPA on March 3, 1998]
- B.14. Sulfur Dioxide.** The owner or operator of the emission units shall demonstrate compliance with the sulfur dioxide limit of this permit by the following:

SECTION III. EMISSIONS UNITS AND SPECIFIC CONDITIONS.

Subsection B. Emissions Units 003 and 004

- a. Through the use of a continuous emission monitoring system (CEMS) installed, calibrated, operated and maintained in accordance with the quality assurance requirements of 40 CFR 75, adopted and incorporated by reference in Rule 62-204.800, F.A.C. A Relative Accuracy Test Audit of the SO₂ CEMS shall be conducted no less than annually. Compliance shall be demonstrated based on a 3-hour rolling average.
- b. In the event the CEMS becomes temporarily inoperable or interrupted, the fuels and the maximum fuel oil to natural gas firing ratio that shall be used is limited to that which was last used to demonstrate compliance prior to the loss of the CEMS, or the emissions units shall fuel switch and be fired with a fuel oil containing a maximum sulfur content of 2.5%, by weight, or less.
- c. When burning 100% fuel oil, the emissions units shall be fired with a fuel oil containing a maximum sulfur content of 2.5%, by weight, or less.

[Rules 62-213.440, 62-204.800 and 62-296.405, F.A.C.]

Test Methods and Procedures

B.15. Test Methods. Required tests shall be performed in accordance with the following reference methods.

Method	Description of Method and Comments
1-4	Traverse Points, Velocity and Flow Rate, Gas Analysis, and Moisture Content
3A	Determination of Oxygen and Carbon Dioxide Concentrations in Emissions from Stationary Sources
5B	Method for Determining Particulate Matter Emissions (All PM is assumed to be PM ₁₀ .)
6	Determination of Sulfur Dioxide Emissions from Stationary Sources
7E	Determination of Nitrogen Oxide Emissions from Stationary Sources
9	Visual Determination of the Opacity of Emissions from Stationary Sources
19	Determination of Sulfur Dioxide Removal Efficiency and Particulate Matter, Sulfur Dioxide, and Nitrogen Oxides Emission Rates (Optional F-factor method may be used to determine flow rate and gas analysis to calculate mass emissions in lieu of Methods 1-4.)
20	Determination of Nitrogen Oxides, Sulfur Dioxide and Diluent Emissions from Stationary Gas Turbines

The above methods are described in 40 CFR 60, Appendix A, and adopted by reference in Rule 62-204.800, F.A.C. No other methods may be used unless prior written approval is received from the Department. [Rules 62-213.440, 62-296.405, and 62-297.401, F.A.C.]

B.16. Testing While Injecting Additives. The owner or operator shall conduct emission tests while injecting additives consistent with normal operating practices. [Rule 62-213.440, F.A.C., applicant agreement with EPA on March 3, 1998]

B.17. Particulate Matter. The test methods for particulate emissions shall be EPA Methods 17, 5, 5B, or 5F, incorporated by reference in Chapter 62-297, F.A.C. The minimum sample volume shall be 30 dry standard cubic feet. EPA Method 5 may be used with filter temperature no more than 320 degrees Fahrenheit. For EPA Method 17, stack temperature shall be less than 375 degrees Fahrenheit. The owner or operator may use EPA Method 5 to demonstrate compliance. EPA Method 3 or 3A shall be used when the oxygen based F-factor, computed according to EPA Method 19, is used in lieu of heat input. Acetone wash shall be used with EPA Method 5 or 17. [Rules 62-213.440, 62-296.405(1)(e)2., and 62-297.401, F.A.C.]

B.18. Sulfur Dioxide. The test methods for sulfur dioxide emissions shall be EPA Methods 6, 6A, 6B, or 6C, incorporated by reference in Chapter 62-297, F.A.C. If the emissions unit obtains an alternate procedure

SECTION III. EMISSIONS UNITS AND SPECIFIC CONDITIONS.

Subsection B. Emissions Units 003 and 004

under the provisions of Rule 62-297.620, F.A.C., the procedure shall become a condition of the emissions unit's permit. The Department will retain the authority to require EPA Method 6 or 6C if it has reason to believe that exceedences of the sulfur dioxide emissions limiting standard are occurring. The permittee may use the EPA test methods, referenced above, to demonstrate compliance; however, as an alternate sampling procedure authorized by permit, the permittee shall demonstrate compliance using CEMS for sulfur dioxide. [Rules 62-213.440 and 62-296.405(1)(c)3. and (1)(e)3., F.A.C.]

- B.19. Operating Conditions During Testing - PM and VE.** Compliance testing during sootblowing and steady-state operation for particulate matter and visible emissions shall be conducted at least once annually, if liquid fuel is fired for more than 400 hours. A visible emissions test shall be conducted during one run of each particulate matter test. Testing shall be conducted as follows:
- a. When Burning 100% Fuel Oil.** Particulate matter and visible emissions tests during sootblowing and steady-state operation shall be performed on such emissions unit while firing solely fuel oil of less than or equal to 2.5% sulfur by weight (stoichiometrically representative of sulfur dioxide emissions of the SO₂ emission limit of 2.75 lb/MMBtu), except that such test shall not be required to be performed during any year that testing is performed in accordance with the following paragraph.
 - b. When Burning Fuel Oil While Co-firing With Natural Gas.** Particulate matter and visible emissions tests during sootblowing and steady-state operation shall be performed on such emissions unit while co-firing oil with the appropriate proportion of natural gas required to maintain SO₂ emissions below the emission limit of 2.75 lb/MMBtu heat input.
 - c. Test Required if Target SO₂ Emission Rate Increased.** Following successful completion of such PM and VE testing, further PM and VE testing shall not be required during the next 12 months unless fuel oil is fired that contains greater than 0.20% sulfur above the percentage sulfur concentration fired during the most recent co-firing test. If fuel oil is co-fired containing greater than 0.20% sulfur above the percentage sulfur concentration fired during the most recent co-firing test, additional PM and VE tests shall be performed as described above as soon as practicable, but in no event more than 60 days after firing such higher sulfur fuel oil.

[Rules 62-4.070(3), 62-213.440, 62-296.405 and 62-297.310, F.A.C., Request of applicant; Administrative Correction 0110036-002-AV.]

- B.20. Visible Emissions.** The test method for visible emissions for shall be DEP Method 9, incorporated in Chapter 62-297, F.A.C. A transmissometer may be used and calibrated according to Rule 62-297.520, F.A.C. [Rules 62-296.405. and 62-297.401, F.A.C.]

- B.21. Annual Tests Required for PM and VE.** Except as provided in Specific Conditions **B.22** and **B.23** of this permit, emission testing for particulate emissions and visible emissions shall be performed annually, no later than September 30th of each year, except for units that are not operating because of scheduled maintenance outages and emergency repairs, which will be tested within thirty days of returning to service. Unless specifically requested by the Compliance Authority pursuant to Rule 62-297.310(7)(b), F.A.C., periodic opacity tests are not required when firing natural gas. [Rules 62-4.070(3), 62-213.440 and 62-297.310(7), F.A.C.]

- B.22. When PM Tests Not Required.** See Specific Condition **D.5**.

- B.23. When VE Tests Not Required.** See Specific Condition **D.6**.

- B.24. Common Testing Requirements.** Unless otherwise specified, tests shall be conducted in accordance with the requirements and procedures specified in Appendix TR, Facility-Wide Testing Requirements, of this permit. [Rule 62-297.310(7), F.A.C.]

Recordkeeping and Reporting Requirements

See Appendix RR, Facility-Wide Reporting Requirements, for additional reporting requirements.

SECTION III. EMISSIONS UNITS AND SPECIFIC CONDITIONS.

Subsection B. Emissions Units 003 and 004

B.25. Fuel Records. The owner or operator shall create and maintain for each emission unit hourly records of the amount of each fuel fired, the ratio of fuel oil to natural gas if co-fired, and the heating value and sulfur content of each fuel fired. These records must be of sufficient detail to identify the testing requirements and allow demonstration of compliance with the specific conditions for SO₂ emissions of this permit. Fuel oil heating value and sulfur content shall be determined by taking a daily sample of the fuel fired, combining those samples into a monthly composite, and analyzing a representative sample of the composite. Analysis for sulfur content shall be performed using one of ASTM D2622-94, ASTM D4294-90(95), ASTM D1552-95, ASTM D1266-91, both ASTM D4057-88 and ASTM D129-95, or the latest edition(s). Comparison of the as-fired fuel oil sulfur content shall be made and recorded monthly upon receipt of each monthly composite analysis. [Rules 62-4.070(3), 62-213.410, 62-213.440 and 62-296.405, F.A.C.]

SECTION III. EMISSIONS UNITS AND SPECIFIC CONDITIONS.

Subsection C. Emissions Unit 005

Subsection C. The specific conditions in this section apply to the following emissions unit:

EU No.	Brief Description
005	12 Simple Cycle Gas Turbines, GT1 through GT12

Emissions unit 005 consists of 12 simple cycle gas turbines (GT1 through GT12) manufactured by Pratt & Whitney, with a total capacity rated at 504 MW, and 8,424 MMBtu/hr. The emissions units are fired on any combination of No. 2 fuel oil and natural gas. Each turbine unit consists of two turbine engines which drive a turbine generator. Emissions are uncontrolled. Each unit is equipped with a 45-foot stack with a 15.6-foot exit diameter. The units have a flow rate of 1,069,740 actual cubic feet per minute (acfm). Exit velocity is 93.3 feet per second (fps) at 860° F. The turbines are regulated collectively as one emission unit.

{Permitting notes: These emissions units are regulated under Rule 62-210.300, F.A.C., Permits Required. These emissions units are not subject to 40 CFR 60, Subpart GG, Standards of Performance for New Stationary Gas Turbines. All turbines began commercial operation in 1971.}

Essential Potential to Emit (PTE) Parameters

C.1. Permitted Capacity. The maximum operation heat input rate is as follows:

Unit No.	MMBtu/hr Heat Input*	Fuel Type
GT1 through GT12	8424	Natural Gas
GT12	8424	No. 2 Fuel Oil

*Total heat input for all twelve combustion turbines. [Rules 62-4.160(2), 62-204.800, and 62-210.200(PTE), F.A.C.]

C.2. Emissions Unit Operating Rate Limitation After Testing. See the related testing provisions in Appendix TR, Facility-wide Testing Requirements. [Rule 62-297.310(2), F.A.C.]

C.3. Methods of Operation. Fuels. The only fuels allowed to be burned are any combination of No. 2 fuel oil and natural gas. [Rule 62-213.410, F.A.C.]

C.4. Hours of Operation. See Specific Condition D.1.

Emission Limitations and Standards

{Permitting Note: The attached Table 1, Summary of Air Pollutant Standards, summarizes information for convenience purposes only. This table does not supersede any of the terms or conditions of this permit.}

Unless otherwise specified, the averaging times for Specific Conditions C.5. - C.7. are based on the specified averaging time of the applicable test method.

C.5. Visible Emissions. Visible emissions from each turbine shall not be equal to or greater than 20 percent opacity. [Rule 62-296.320(4)(b)1., F.A.C.]

C.6. When VE Tests Not Required. See Specific Condition D.6.

C.7. Nitrogen Oxides. Nitrogen oxides emissions shall not exceed 0.50 pounds per million Btu while firing natural gas, and 0.90 pounds per million Btu while firing oil. [Rule 62-296.570(4)(b)5., F.A.C.]

Excess Emissions

Rule 62-210.700 (Excess Emissions), F.A.C. cannot vary any requirement of an NSPS, NESHAP or Acid Rain program provision.

C.8. See Specific Conditions D.2, D.3 and D.4.

SECTION III. EMISSIONS UNITS AND SPECIFIC CONDITIONS.

Subsection C. Emissions Unit 005

Test Methods and Procedures

{Permitting Note: The attached Table 2, Summary of Compliance Requirements, summarizes information for convenience purposes only. This table does not supersede any of the terms or conditions of this permit.}

C.9. Test Methods. Required tests shall be performed in accordance with the following reference methods.

Method	Description of Method and Comments
1-4	Traverse Points, Velocity and Flow Rate, Gas Analysis, and Moisture Content
3A	Determination of Oxygen and Carbon Dioxide Concentrations in Emissions from Stationary Sources
7E	Determination of Nitrogen Oxide Emissions from Stationary Sources
9	Visual Determination of the Opacity of Emissions from Stationary Sources
19	Determination of Sulfur Dioxide Removal Efficiency and Particulate Matter, Sulfur Dioxide, and Nitrogen Oxides Emission Rates (Optional F-factor method may be used to determine flow rate and gas analysis to calculate mass emissions in lieu of Methods 1-4.)
20	Determination of Nitrogen Oxides, Sulfur Dioxide and Diluent Emissions from Stationary Gas Turbines

The above methods are described in 40 CFR 60, Appendix A, and adopted by reference in Rule 62-204.800, F.A.C. No other methods may be used unless prior written approval is received from the Department. [Rules 62-204.800 and 62-297.401, F.A.C.]

- C.10. Visible Emissions.** The test method for visible emissions for emissions unit 005 (bank of twelve combustion turbines) shall be EPA Method 9, adopted and incorporated by reference in Rule 62-204.800, F.A.C., and referenced in Chapter 62-297, F.A.C. [Rules 62-204.800 and 62-297.401, F.A.C.]
- C.11. Nitrogen Oxides.** The test method for nitrogen oxides emissions shall be EPA Method 20, or EPA Method 7E, incorporated by reference in Chapter 62-297, F.A.C. If the owner or operator obtains an alternate procedure under the provisions of Rule 62-297.620, F.A.C., the procedure shall automatically become a condition of this permit. [Rules 62-213.440, 62-296.570(4)(a)3., 62-297.401, F.A.C.; and applicant request.]
- C.12. Visible Emissions Testing Required.** The owner or operator shall conduct testing for visible emissions, using EPA Method 9, while the combustion turbine is operating at 90-100 percent of its capacity, according to the following schedule:
The owner or operator shall conduct testing for visible emissions while firing fuel oil for each simple-cycle turbine unit upon that turbine's exceeding 400 hours of operation on fuel oil, and every 150 hours of operation on fuel oil thereafter, in any given federal fiscal year (October 1 through September 30). Such tests shall be performed within 15 days of exceeding such operating hours, to allow for prior notification of the tests.
[Rule 62-213.440, F.A.C.; applicant agreement with EPA on March 3, 1998; and AO 06-230618.]
- C.13. Nitrogen Oxides.** Provided operation is no more than 320 hours/year/turbine on oil, NO_x emissions for the combustion turbines shall be tested every five (5) years by EPA Method 20 or EPA Method 7E tests as described in 40 CFR 60, Appendix A on any representative unit in the bank of the combustion turbines. Tests shall be conducted both while burning 100% natural gas and 100% light distillate oil. [Rule 62-296.570, F.A.C.; and requested by the applicant in a letter dated September 19, 2000.]
- C.14. Common Testing Requirements.** Unless otherwise specified, tests shall be conducted in accordance with the requirements and procedures specified in Appendix TR, Facility-Wide Testing Requirements, of this permit. [Rule 62-297.310(7), F.A.C.]

SECTION III. EMISSIONS UNITS AND SPECIFIC CONDITIONS.

Subsection C. Emissions Unit 005

Recordkeeping and Reporting Requirements

See Appendix RR, Facility-Wide Reporting Requirements, for additional reporting requirements.

C.15. Records of Fuel Consumption and Operating Time Required. The owner or operator shall make and maintain records of the hours of operation of each turbine and the total fuel oil consumption of all twelve turbines in sufficient detail to ensure compliance with specific conditions of this permit. [Rule 62-4.070(3), F.A.C.]

SECTION III. EMISSIONS UNITS AND SPECIFIC CONDITIONS.

Subsection D. Emissions Units 001, 002, 003, 004, 005

Subsection D. Common Conditions

Subsection D. The specific conditions in this section apply to the following emissions units:

EU No.	Brief Description
001	Fossil Fuel Steam Generator, Unit 1.
002	Fossil Fuel Steam Generator, Unit 2.
003	Fossil Fuel Steam Generator, Unit 3.
004	Fossil Fuel Steam Generator, Unit 4.
005	12 Simple Cycle Gas Turbines, GT1 through GT12.

Essential Potential to Emit (PTE) Parameters

D.1. Hours of Operation. These emissions units may operate continuously (8760 hours/year). [Rule 62-210.200(PTE), F.A.C.]

Excess Emissions

- D.2. Excess Emissions From Malfunction.** Excess emissions resulting from malfunction shall be permitted provided that best operational practices to minimize emissions are adhered to and the duration of excess emissions shall be minimized but in no case exceed two hours in any 24 hour period unless specifically authorized by the Department for longer duration. [Rule 62-210.700(1), F.A.C.]
- D.3. Excess Emissions From Startup or Shutdown.** Excess emissions resulting from startup or shutdown shall be permitted provided that best operational practices to minimize emissions are adhered to and the duration of excess emissions shall be minimized. [Rule 62-210.700(2), F.A.C.]
- D.4. Excess Emissions Prohibited.** Excess emissions which are caused entirely or in part by poor maintenance, poor operation, or any other equipment or process failure which may reasonably be prevented during startup, shutdown or malfunction shall be prohibited. [Rule 62-210.700(4), F.A.C.]
- D.5. When PM Tests Not Required.** Annual and permit renewal compliance testing for particulate matter emissions is not required for these emissions units while burning:
- a. only gaseous fuel(s); or
 - b. gaseous fuel(s) in combination with any amount of liquid fuel(s) for less than 400 hours per year; or
 - c. only liquid fuel(s) for less than 400 hours per year.
- [Rules 62-297.310(7)(a)3. & 5., F.A.C.; and ASP Number 97-B-01.]
- D.6. When VE Tests Not Required.** By this permit, annual emissions compliance testing for visible emissions is not required for these emissions units while burning:
- a. only gaseous fuel(s); or
 - b. gaseous fuel(s) in combination with any amount of liquid fuel(s) for less than 400 hours per year; or
 - c. only liquid fuel(s) for less than 400 hours per year.
- [Rule 62-4.070(3), F.A.C.]

Test Methods and Procedures

- D.7. DEP Method 9.** The provisions of EPA Method 9 (40 CFR 60, Appendix A) are adopted by reference with the following exceptions:
- a. EPA Method 9, Section 2.4, Recording Observations. Opacity observations shall be made and recorded by a certified observer at sequential fifteen second intervals during the required period of observation.

SECTION III. EMISSIONS UNITS AND SPECIFIC CONDITIONS.

Subsection D. Emissions Units 001, 002, 003, 004, 005

- b. EPA Method 9, Section 2.5, Data Reduction. For a set of observations to be acceptable, the observer shall have made and recorded, or verified the recording of, at least 90 percent of the possible individual observations during the required observation period. For single-valued opacity standards (e.g., 20 percent opacity), the test result shall be the highest valid six-minute average for the set of observations taken. For multiple-valued opacity standards (e.g., 20 percent opacity, except that an opacity of 40 percent is permissible for not more than two minutes per hour) opacity shall be computed as follows:
- (1) For the basic part of the standard (i.e., 20 percent opacity) the opacity shall be determined as specified above for a single-valued opacity standard.
 - (2) For the short-term average part of the standard, opacity shall be the highest valid short-term average (i.e., two-minute, three-minute average) for the set of observations taken.
- In order to be valid, any required average (i.e., a six-minute or two-minute average) shall be based on all of the valid observations in the sequential subset of observations selected, and the selected subset shall contain at least 90 percent of the observations possible for the required averaging time. Each required average shall be calculated by summing the opacity value of each of the valid observations in the appropriate subset, dividing this sum by the number of valid observations in the subset, and rounding the result to the nearest whole number. The number of missing observations in the subset shall be indicated in parenthesis after the subset average value. [Rule 62-297.401, F.A.C.]

Recordkeeping and Reporting Requirements

- D.8. Malfunctions - Notification.** In the case of excess emissions resulting from malfunctions, each owner or operator shall notify the Broward County Department of Planning and Environmental Protection, Air Quality Division, in accordance with Rule 62-4.130, F.A.C. Notification shall include pertinent information as to the cause of the problem, and what steps are being taken to correct the problem and to prevent its recurrence; and where applicable, the owner's intent toward reconstruction of destroyed facilities. Such notification does not release the permittee from any liability for failure to comply with Department rules. A full written report on the malfunctions shall be submitted in a quarterly report, if requested by the Broward County Department of Planning and Environmental Protection, Air Quality Division. [Rule 62-210.700(6), F.A.C.]
- D.9. Excess Emissions - Report.** Submit to the Broward County Department of Planning and Environmental Protection, Air Quality Division, a written report of emissions in excess of emission limiting standards as set forth in this permit, for each calendar quarter. The nature and cause of the excess emissions shall be explained. This report does not relieve the owner or operator of the legal liability for violations. [Rules 62-213.440 and 62-296.405(1)(g), F.A.C.]

Other Specific Conditions

- D.10. Used Oil.** Burning of on-specification used oil is allowed in emissions units 001, 002, 003 and 004 in accordance with all other conditions of this permit and the following additional conditions:
- a. *On-specification Used Oil Allowed as Fuel.* This permit allows the burning of used oil fuel meeting EPA "on-specification" used oil specifications, with a PCB concentration of less than 50 ppm, originating from FPL operations. Used oil that does not meet the specifications for on-specification used oil shall not be burned at this facility.

On-specification used oil shall meet the following specifications: [40 CFR 279, Subpart B.]

- Arsenic shall not exceed 5.0 ppm;
- Cadmium shall not exceed 2.0 ppm;
- Chromium shall not exceed 10.0 ppm;
- Lead shall not exceed 100.0 ppm;
- Total halogens shall not exceed 1000 ppm;
- Flash point shall not be less than 100 degrees F.

SECTION III. EMISSIONS UNITS AND SPECIFIC CONDITIONS.

Subsection D. Emissions Units 001, 002, 003, 004, 005

- b. *Quantity Limited.* The maximum total quantity of used oil that may be burned in all four emissions units is 1.5 million gallons in any consecutive 12-month period.
- c. *Used Oil Containing PCBs Not Allowed.* Used oil containing a PCB concentration of 50 or more ppm shall not be burned at this facility. Used oil shall not be blended to meet this requirement.
- d. *PCB Concentration of 2 to less than 50 ppm.* On-specification used oil with a PCB concentration of 2 to less than 50 ppm shall be burned only at normal source operating temperatures. On-specification used oil with a PCB concentration of 2 to less than 50 ppm shall not be burned during periods of startup or shutdown.
- e. *Testing Required.* The owner or operator shall sample and analyze each batch of used oil to be burned for the following parameters:

Arsenic, cadmium, chromium, lead, total halogens, flash point, and PCBs.

Testing (sampling, extraction and analysis) shall be performed using approved methods specified in EPA Publication SW-846 (Test Methods for Evaluating Solid Waste, Physical/Chemical Methods), latest edition.

- f. *Record Keeping Required.* The owner or operator shall obtain, make, and keep the following records related to the use of used oil in a form suitable for inspection at the facility by the Department: [40 CFR 279.61 and 761.20(e)]
 - (1) The gallons of on-specification used oil received and burned each month. (This record shall be completed no later than the fifteenth day of the succeeding month.)
 - (2) The total gallons of on-specification used oil burned in the preceding consecutive 12-month period. (This record shall be completed no later than the fifteenth day of the succeeding month.)
 - (3) Results of the analyses required above.
- g. *Reporting Required.* The owner or operator shall submit, with the Annual Operation Report form, the analytical results and the total amount of on-specification used oil burned during the previous calendar year.

[Rules 62-4.070(3) and 62-213.440, F.A.C., 40 CFR 279 and 40 CFR 761, unless otherwise noted]

SECTION IV. ACID RAIN PART.

Subsection A. Phase II

Operated by: Florida Power and Light Company
 ORIS Code: 0617

The emissions units listed below are regulated under Acid Rain, Phase II.

E.U.

<u>ID No.</u>	<u>Brief Description</u>
001	Fossil Fuel Steam Generator, Unit 1
002	Fossil Fuel Steam Generator, Unit 2
003	Fossil Fuel Steam Generator, Unit 3
004	Fossil Fuel Steam Generator, Unit 4

A.1. Application. The Phase II Acid Rain Part application submitted for this facility, as approved by the Department, is a part of this permit. The owners and operators of these Phase II acid rain units must comply with the standard requirements and special provisions set forth in the application listed below:

- a. DEP Form No. 62-210.900(1)(a), dated 04/15/08, received 07/02/08.
 [Chapter 62-213, F.A.C. and Rule 62-214.320, F.A.C.]

A.2. Allowances. Sulfur dioxide (SO₂) allowance allocations for each Acid Rain unit are as follows:

E.U. ID No.	EPA ID	Year	2009	2010	2011	2012	2013
001	PPE1	SO ₂ allowances, under Table 2 of 40 CFR 73	2,339*	2,343*	2,343*	2,343*	2,343*
002	PPE2	SO ₂ allowances, under Table 2 of 40 CFR 73	2,413*	2,417*	2,417*	2,417*	2,417*
003	PPE3	SO ₂ allowances, under Table 2 of 40 CFR 73	5,880*	5,891*	5,891*	5,891*	5,891*
004	PPE4	SO ₂ allowances, under Table 2 of 40 CFR 73	5,962*	5,973*	5,973*	5,973*	5,973*

* The number of allowances held by an Acid Rain source in a unit account may differ from the number allocated by the USEPA under Table 2 of 40 CFR 73.

A.3. Emission Allowances. Emissions from sources subject to the Federal Acid Rain Program (Title IV) shall not exceed any allowances that the source lawfully holds under the Federal Acid Rain Program. Allowances shall not be used to demonstrate compliance with a non-Title IV applicable requirement of the Act.

- a. No permit revision shall be required for increases in emissions that are authorized by allowances acquired pursuant to the Federal Acid Rain Program, provided that such increases do not require a permit revision pursuant to Rule 62-213.400(3), F.A.C.
- b. No limit shall be placed on the number of allowances held by the source under the Federal Acid Rain Program.
- c. Allowances shall be accounted for under the Federal Acid Rain Program.

[Rule 62-213.440(1)(c)1., 2. & 3., F.A.C.]

A.4. Comments, notes, and justifications: None.

SECTION IV. ACID RAIN PART.

Subsection A. Phase II

Acid Rain Part- Page 1

Acid Rain Part Application

For more information, see instructions and refer to 40 CFR 72.30 and 72.31 and Chapter 62-214, F.A.C.

This submission is: New Revised

STEP 1
Identify the source by plant name, State, and ORIS code

Plant Name: Port Everglades	State: Florida	ORIS Code: 617
------------------------------------	-----------------------	-----------------------

STEP 2

Enter the unit ID# for every Acid Rain unit at the Acid Rain source in column "a." For new units, enter the requested information in columns "c" and "d."

a	b	c	d
Unit ID#	Unit will hold allowances in accordance with 40 CFR 72.9(c)(1)	New Units Commence Operation Date	New Units Monitor Certification Deadline
PPE 1	Yes	N/A	N/A
PPE 2	Yes	N/A	N/A
PPE 3	Yes	N/A	N/A
PPE 4	Yes	N/A	N/A
	Yes		
	Yes		
	Yes		
	Yes		
	Yes		
	Yes		
	Yes		
	Yes		
	Yes		

DEP Form No. 62-210.900(1)(a) - Form
Effective: 06/16/03

SECTION IV. ACID RAIN PART.

Subsection A. Phase II

Acid Rain Part - Page 2

Port Everglades
Plant Name (from Step 1)

STEP 3 Read the standard requirements

Acid Rain Part Requirements

- (1) The designated representative of each Acid Rain source and each Acid Rain unit at the source shall:
 - (i) Submit a complete Acid Rain part application (including a compliance plan) under 40 CFR part 72 and Rules 62-214.320 and 330, F.A.C., in accordance with the deadlines specified in Rule 62-214.320, F.A.C.; and
 - (ii) Submit in a timely manner any supplemental information that the Department determines is necessary in order to review an Acid Rain part application and issue or deny an Acid Rain part.
- (2) The owners and operators of each Acid Rain source and each Acid Rain unit at the source shall:
 - (i) Operate the unit in compliance with a complete Acid Rain part application or a superseding Acid Rain part issued by the Department; and
 - (ii) Have an Acid Rain Part.

Monitoring Requirements

- (1) The owners and operators and, to the extent applicable, designated representative of each Acid Rain source and each Acid Rain unit at the source shall comply with the monitoring requirements as provided in 40 CFR part 75, and Rule 62-214.420, F.A.C.
- (2) The emissions measurements recorded and reported in accordance with 40 CFR part 75 shall be used to determine compliance by the unit with the Acid Rain emissions limitations and emissions reduction requirements for sulfur dioxide and nitrogen oxides under the Acid Rain Program.
- (3) The requirements of 40 CFR part 75 shall not affect the responsibility of the owners and operators to monitor emissions of other pollutants or other emissions characteristics at the unit under other applicable requirements of the Act and other provisions of the operating permit for the source.

Sulfur Dioxide Requirements

- (1) The owners and operators of each source and each Acid Rain unit at the source shall:
 - (i) Hold allowances, as of the allowance transfer deadline, in the unit's compliance subaccount (after deductions under 40 CFR 73.34(c)), or in the compliance subaccount of another Acid Rain unit at the same source to the extent provided in 40 CFR 73.35(b)(3), not less than the total annual emissions of sulfur dioxide for the previous calendar year from the unit; and
 - (ii) Comply with the applicable Acid Rain emissions limitations for sulfur dioxide.
- (2) Each ton of sulfur dioxide emitted in excess of the Acid Rain emissions limitations for sulfur dioxide shall constitute a separate violation of the Act.
- (3) An Acid Rain unit shall be subject to the requirements under paragraph (1) of the sulfur dioxide requirements as follows:
 - (i) Starting January 1, 2000, an Acid Rain unit under 40 CFR 72.6(a)(2); or
 - (ii) Starting on the later of January 1, 2000 or the deadline for monitor certification under 40 CFR part 75, an Acid Rain unit under 40 CFR 72.6(a)(3).
- (4) Allowances shall be held in, deducted from, or transferred among Allowance Tracking System accounts in accordance with the Acid Rain Program.
- (5) An allowance shall not be deducted in order to comply with the requirements under paragraph (1) of the sulfur dioxide requirements prior to the calendar year for which the allowance was allocated.
- (6) An allowance allocated by the Administrator under the Acid Rain Program is a limited authorization to emit sulfur dioxide in accordance with the Acid Rain Program. No provision of the Acid Rain Program, the Acid Rain part application, the Acid Rain part, or an exemption under 40 CFR 72.7 or 72.8 and no provision of law shall be construed to limit the authority of the United States to terminate or limit such authorization.
- (7) An allowance allocated by the Administrator under the Acid Rain Program does not constitute a property right.

Nitrogen Oxides Requirements The owners and operators of the source and each Acid Rain unit at the source shall comply with the applicable Acid Rain emissions limitation for nitrogen oxides.

Excess Emissions Requirements

- (1) The designated representative of an Acid Rain unit that has excess emissions in any calendar year shall submit a proposed offset plan, as required under 40 CFR part 77.
- (2) The owners and operators of an Acid Rain unit that has excess emissions in any calendar year shall:
 - (i) Pay without demand the penalty required, and pay upon demand the interest on that penalty, as required by 40 CFR part 77; and
 - (ii) Comply with the terms of an approved offset plan, as required by 40 CFR part 77.

Recordkeeping and Reporting Requirements

- (1) Unless otherwise provided, the owners and operators of the source and each Acid Rain unit at the source shall keep on site at the source each of the following documents for a period of 5 years from the date the document is created. This period may be extended for cause, at any time prior to the end of 5 years, in writing by the EPA or the Department:
 - (i) The certificate of representation for the designated representative for the source and each Acid Rain unit at the source and all documents that demonstrate the truth of the statements in the certificate of representation, in accordance with Rule 62-214.350, F.A.C.; provided that the certificate and documents shall be retained on site at the source beyond such 5-year period until such documents are superseded because of the submission of a new certificate of representation changing the designated representative;
 - (ii) All emissions monitoring information, in accordance with 40 CFR part 75, provided that to the extent that 40 CFR part 75 provides for a 3-year period for recordkeeping, the 3-year period shall apply;
 - (iii) Copies of all reports, compliance certifications, and other submissions and all records made or required under the Acid Rain Program; and

SECTION IV. ACID RAIN PART.

Subsection A. Phase II

Port Everglades
Plant Name (from Step 1)

STEP 3,
Cont'd.

Recordkeeping and Reporting Requirements (cont)

(iv) Copies of all documents used to complete an Acid Rain part application and any other submission under the Acid Rain Program or to demonstrate compliance with the requirements of the Acid Rain Program.

(2) The designated representative of an Acid Rain source and each Acid Rain unit at the source shall submit the reports and compliance certifications required under the Acid Rain Program, including those under 40 CFR part 72 subpart I and 40 CFR part 75.

Liability.

(1) Any person who knowingly violates any requirement or prohibition of the Acid Rain Program, a complete Acid Rain part application, an Acid Rain part, or an exemption under 40 CFR 72.7 or 72.8, including any requirement for the payment of any penalty owed to the United States, shall be subject to enforcement pursuant to section 113(c) of the Act.

(2) Any person who knowingly makes a false, material statement in any record, submission, or report under the Acid Rain Program shall be subject to criminal enforcement pursuant to section 113(c) of the Act and 18 U.S.C. 1001.

(3) No permit revision shall excuse any violation of the requirements of the Acid Rain Program that occurs prior to the date that the revision takes effect.

(4) Each Acid Rain source and each Acid Rain unit shall meet the requirements of the Acid Rain Program.

(5) Any provision of the Acid Rain Program that applies to an Acid Rain source (including a provision applicable to the designated representative of an Acid Rain source) shall also apply to the owners and operators of such source and of the Acid Rain units at the source.

(6) Any provision of the Acid Rain Program that applies to an Acid Rain unit (including a provision applicable to the designated representative of an Acid Rain unit) shall also apply to the owners and operators of such unit. Except as provided under 40 CFR 72.44 (Phase II repowering extension plans) and 40 CFR 75.11 (NO_x averaging plans), and except with regard to the requirements applicable to units with a common stack under 40 CFR part 75 (including 40 CFR 75.16, 75.17, and 75.18), the owners and operators and the designated representative of one Acid Rain unit shall not be liable for any violation by any other Acid Rain unit of which they are not owners or operators or the designated representative and that is located at a source of which they are not owners or operators or the designated representative.

(7) Each violation of a provision of 40 CFR parts 72, 73, 75, 76, 77, and 78 by an Acid Rain source or Acid Rain unit, or by an owner or operator or designated representative of such source or unit, shall be a separate violation of the Act.

Effect on Other Authorities.

No provision of the Acid Rain Program, an Acid Rain part application, an Acid Rain part, or an exemption under 40 CFR 72.7 or 72.8 shall be construed as:

(1) Except as expressly provided in title IV of the Act, exempting or excluding the owners and operators and, to the extent applicable, the designated representative of an Acid Rain source or Acid Rain unit from compliance with any other provision of the Act, including the provisions of title I of the Act relating to applicable National Ambient Air Quality Standards or State Implementation Plans;

(2) Limiting the number of allowances a unit can hold; provided, that the number of allowances held by the unit shall not affect the source's obligation to comply with any other provisions of the Act;

(3) Requiring a change of any kind in any State law regulating electric utility rates and charges, affecting any State law regarding such State regulation, or limiting such State regulation, including any prudence review requirements under such State law;

(4) Modifying the Federal Power Act or affecting the authority of the Federal Energy Regulatory Commission under the Federal Power Act; or


(5) Interfering with or impairing any program for competitive bidding for power supply in a State in which such program is established.

STEP 4

Certification

Read the certification statement, sign, and date

I am authorized to make this submission on behalf of the owners and operators of the Acid Rain source or Acid Rain units for which the submission is made. I certify under penalty of law that I have personally examined, and am familiar with, the statements and information submitted in this document and all its attachments. Based on my inquiry of those individuals with primary responsibility for obtaining the information, I certify that the statements and information are to the best of my knowledge and belief true, accurate, and complete. I am aware that there are significant penalties for submitting false statements and information or omitting required statements and information, including the possibility of fine or imprisonment.

Name: Sheila M. Wilkinson	
Signature 	Date 4/15/08

SECTION V. CAIR PART FORM
CLEAN AIR INTERSTATE RULE PROVISIONS

Clean Air Interstate Rule (CAIR).

Operated by: Florida Power and Light Company

Plant Name: Port Everglades Plant

ORIS Code: 0617

The emissions units below are regulated under the Clean Air Interstate Rule.

E.U. ID No.	EPA Unit ID#	Brief Description
-001	PPE1	Fossil Fuel Steam Generator, Unit 1
-002	PPE2	Fossil Fuel Steam Generator, Unit 2
-003	PPE3	Fossil Fuel Steam Generator, Unit 3
-004	PPE4	Fossil Fuel Steam Generator, Unit 4
-005	GPE01	Simple Cycle Gas Turbine, GT1
-005	GPE02	Simple Cycle Gas Turbine, GT2
-005	GPE03	Simple Cycle Gas Turbine, GT3
-005	GPE04	Simple Cycle Gas Turbine, GT4
-005	GPE05	Simple Cycle Gas Turbine, GT5
-005	GPE06	Simple Cycle Gas Turbine, GT6
-005	GPE07	Simple Cycle Gas Turbine, GT7
-005	GPE08	Simple Cycle Gas Turbine, GT8
-005	GPE09	Simple Cycle Gas Turbine, GT9
-005	GPE10	Simple Cycle Gas Turbine, GT10
-005	GPE11	Simple Cycle Gas Turbine, GT11
-005	GPE12	Simple Cycle Gas Turbine, GT12

- Clean Air Interstate Rule Application.** The Clean Air Interstate Rule Part Form submitted for this facility is a part of this permit. The owners and operators of these CAIR units as identified in this form must comply with the standard requirements and special provisions set forth in the CAIR Part Form (DEP Form No. 62-210.900(1)(b) - Form, Effective: 3/16/08), which is attached at the end of this section. [Chapter 62-213, F.A.C. and Rule 62-210.200, F.A.C.]

SECTION V. CAIR PART FORM
CLEAN AIR INTERSTATE RULE PROVISIONS

Clean Air Interstate Rule (CAIR) Part

For more information, see instructions and refer to 40 CFR 96.121, 96.122, 96.221, 96.222, 96.321 and 96.322; and Rule 62-296.470, F.A.C.

This submission is: New Revised Renewal

RECEIVED
 DEPARTMENT OF ENVIRONMENTAL REGULATION
 MAY 24 2008

STEP 1

Identify the source by plant name and ORIS or EIA plant code

Plant Name: Port Everglades	State: Florida	ORIS or EIA Plant Code: 000617
-----------------------------	----------------	---------------------------------------

STEP 2

In column "a" enter the unit ID# for every CAIR unit at the CAIR source.

In columns "b," "c," and "d," indicate to which CAIR program(s) each unit is subject by placing an "X" in the column(s).

For new units, enter the requested information in columns "e" and "f."

a	b	c	d	e	f
Unit ID#	Unit will hold nitrogen oxides (NO _x) allowances in accordance with 40 CFR 96.106(c)(1)	Unit will hold sulfur dioxide (SO ₂) allowances in accordance with 40 CFR 96.206(c)(1)	Unit will hold NO _x Ozone Season allowances in accordance with 40 CFR 96.306(c)(1)	New Units Expected Commence Commercial Operation Date	New Units Expected Monitor Certification Deadline
PPE1	X	X	X		
PPE2	X	X	X		
PPE3	X	X	X		
PPE4	X	X	X		
GPE01	X	X	X		
GPE02	X	X	X		
GPE03	X	X	X		
GPE04	X	X	X		
GPE05	X	X	X		
GPE06	X	X	X		
GPE07	X	X	X		
GPE08	X	X	X		
GPE09	X	X	X		
GPE10	X	X	X		
GPE11	X	X	X		
GPE12	X	X	X		

SECTION V. CAIR PART FORM
CLEAN AIR INTERSTATE RULE PROVISIONS

STEP 3

Read the standard requirements.

Plant Name (from STEP 1)	Port Everglades
--------------------------	-----------------

CAIR NO_x ANNUAL TRADING PROGRAM

CAIR Part Requirements.

- (1) The CAIR designated representative of each CAIR NO_x source and each CAIR NO_x unit at the source shall:
 - (i) Submit to the DEP a complete and certified CAIR Part form under 40 CFR 96.122 and Rule 62-296.470, F.A.C., in accordance with the deadlines specified in Rule 62-213.420, F.A.C.; and
 - (ii) [Reserved];
- (2) The owners and operators of each CAIR NO_x source and each CAIR NO_x unit at the source shall have a CAIR Part included in the Title V operating permit issued by the DEP under 40 CFR Part 96, Subpart CC, and operate the source and the unit in compliance with such CAIR Part.

Monitoring, Reporting, and Recordkeeping Requirements.

- (1) The owners and operators, and the CAIR designated representative, of each CAIR NO_x source and each CAIR NO_x unit at the source shall comply with the monitoring, reporting, and recordkeeping requirements of 40 CFR Part 96, Subpart HH, and Rule 62-296.470, F.A.C.
- (2) The emissions measurements recorded and reported in accordance with 40 CFR Part 96, Subpart HH, shall be used to determine compliance by each CAIR NO_x source with the following CAIR NO_x Emissions Requirements.

NO_x Emission Requirements.

- (1) As of the allowance transfer deadline for a control period, the owners and operators of each CAIR NO_x source and each CAIR NO_x unit at the source shall hold, in the source's compliance account, CAIR NO_x allowances available for compliance deductions for the control period under 40 CFR 96.154(a) in an amount not less than the tons of total NO_x emissions for the control period from all CAIR NO_x units at the source, as determined in accordance with 40 CFR Part 96, Subpart HH.
- (2) A CAIR NO_x unit shall be subject to the requirements under paragraph (1) of the NO_x Requirements starting on the later of January 1, 2009, or the deadline for meeting the unit's monitor certification requirements under 40 CFR 96.170(b)(1) or (2) and for each control period thereafter.
- (3) A CAIR NO_x allowance shall not be deducted, for compliance with the requirements under paragraph (1) of the NO_x Requirements, for a control period in a calendar year before the year for which the CAIR NO_x allowance was allocated.
- (4) CAIR NO_x allowances shall be held in, deducted from, or transferred into or among CAIR NO_x Allowance Tracking System accounts in accordance with 40 CFR Part 96, Subparts FF and GG.
- (5) A CAIR NO_x allowance is a limited authorization to emit one ton of NO_x in accordance with the CAIR NO_x Annual Trading Program. No provision of the CAIR NO_x Annual Trading Program, the CAIR Part, or an exemption under 40 CFR 96.105 and no provision of law shall be construed to limit the authority of the state or the United States to terminate or limit such authorization.
- (6) A CAIR NO_x allowance does not constitute a property right.
- (7) Upon recordation by the Administrator under 40 CFR Part 96, Subpart EE, FF, or GG, every allocation, transfer, or deduction of a CAIR NO_x allowance to or from a CAIR NO_x unit's compliance account is incorporated automatically in any CAIR Part of the source that includes the CAIR NO_x unit.

Excess Emissions Requirements.

If a CAIR NO_x source emits NO_x during any control period in excess of the CAIR NO_x emissions limitation, then:

- (1) The owners and operators of the source and each CAIR NO_x unit at the source shall surrender the CAIR NO_x allowances required for deduction under 40 CFR 96.154(d)(1) and pay any fine, penalty, or assessment or comply with any other remedy imposed, for the same violations, under the Clean Air Act or applicable state law; and
- (2) Each ton of such excess emissions and each day of such control period shall constitute a separate violation of 40 CFR Part 96, Subpart AA, the Clean Air Act, and applicable state law.

Recordkeeping and Reporting Requirements.

- (1) Unless otherwise provided, the owners and operators of the CAIR NO_x source and each CAIR NO_x unit at the source shall keep on site at the source each of the following documents for a period of 5 years from the date the document is created. This period may be extended for cause, at any time before the end of 5 years, in writing by the DEP or the Administrator.
 - (i) The certificate of representation under 40 CFR 96.113 for the CAIR designated representative for the source and each CAIR NO_x unit at the source and all documents that demonstrate the truth of the statements in the certificate of representation; provided that the certificate and documents shall be retained on site at the source beyond such 5-year period until such documents are superseded because of the submission of a new certificate of representation under 40 CFR 96.113 changing the CAIR designated representative.
 - (ii) All emissions monitoring information, in accordance with 40 CFR Part 96, Subpart HH, of this part, provided that to the extent that 40 CFR Part 96, Subpart HH, provides for a 3-year period for recordkeeping, the 3-year period shall apply.
 - (iii) Copies of all reports, compliance certifications, and other submissions and all records made or required under the CAIR NO_x Annual Trading Program.
 - (iv) Copies of all documents used to complete a CAIR Part form and any other submission under the CAIR NO_x Annual Trading Program or to demonstrate compliance with the requirements of the CAIR NO_x Annual Trading Program.
- (2) The CAIR designated representative of a CAIR NO_x source and each CAIR NO_x unit at the source shall submit the reports required under the CAIR NO_x Annual Trading Program, including those under 40 CFR Part 96, Subpart HH.

SECTION V. CAIR PART FORM
CLEAN AIR INTERSTATE RULE PROVISIONS

**STEP 3,
Continued**

Plant Name (from STEP 1)	Port Everglades
--------------------------	-----------------

Liability.

- (1) Each CAIR NO_x source and each CAIR NO_x unit shall meet the requirements of the CAIR NO_x Annual Trading Program.
- (2) Any provision of the CAIR NO_x Annual Trading Program that applies to a CAIR NO_x source or the CAIR designated representative of a CAIR NO_x source shall also apply to the owners and operators of such source and of the CAIR NO_x units at the source.
- (3) Any provision of the CAIR NO_x Annual Trading Program that applies to a CAIR NO_x unit or the CAIR designated representative of a CAIR NO_x unit shall also apply to the owners and operators of such unit.

Effect on Other Authorities.

No provision of the CAIR NO_x Annual Trading Program, a CAIR Part, or an exemption under 40 CFR 96.105 shall be construed as exempting or excluding the owners and operators, and the CAIR designated representative, of a CAIR NO_x source or CAIR NO_x unit from compliance with any other provision of the applicable, approved State Implementation Plan, a federally enforceable permit, or the Clean Air Act.

CAIR SO₂ TRADING PROGRAM

CAIR Part Requirements.

- (1) The CAIR designated representative of each CAIR SO₂ source and each CAIR SO₂ unit at the source shall:
 - (i) Submit to the DEP a complete and certified CAIR Part form under 40 CFR 96.222 and Rule 62-296.470, F.A.C., in accordance with the deadlines specified in Rule 62-213.420, F.A.C.; and
 - (ii) [Reserved];
- (2) The owners and operators of each CAIR SO₂ source and each CAIR SO₂ unit at the source shall have a CAIR Part included in the Title V operating permit issued by the DEP under 40 CFR Part 96, Subpart CCC, for the source and operate the source and each CAIR unit in compliance with such CAIR Part.

Monitoring, Reporting, and Recordkeeping Requirements.

- (1) The owners and operators, and the CAIR designated representative, of each CAIR SO₂ source and each SO₂ CAIR unit at the source shall comply with the monitoring, reporting, and recordkeeping requirements of 40 CFR Part 96, Subpart HHH, and Rule 62-296.470, F.A.C.
- (2) The emissions measurements recorded and reported in accordance with 40 CFR Part 96, Subpart HHH, shall be used to determine compliance by each CAIR SO₂ source with the following CAIR SO₂ Emission Requirements.

SO₂ Emission Requirements.

- (1) As of the allowance transfer deadline for a control period, the owners and operators of each CAIR SO₂ source and each CAIR SO₂ unit at the source shall hold, in the source's compliance account, a tonnage equivalent in CAIR SO₂ allowances available for compliance deductions for the control period, as determined in accordance with 40 CFR 96.254(a) and (b), not less than the tons of total sulfur dioxide emissions for the control period from all CAIR SO₂ units at the source, as determined in accordance with 40 CFR Part 96, Subpart HHH.
- (2) A CAIR SO₂ unit shall be subject to the requirements under paragraph (1) of the Sulfur Dioxide Emission Requirements starting on the later of January 1, 2010 or the deadline for meeting the unit's monitor certification requirements under 40 CFR 96.270(b)(1) or (2) and for each control period thereafter.
- (3) A CAIR SO₂ allowance shall not be deducted, for compliance with the requirements under paragraph (1) of the SO₂ Emission Requirements, for a control period in a calendar year before the year for which the CAIR SO₂ allowance was allocated.
- (4) CAIR SO₂ allowances shall be held in, deducted from, or transferred into or among CAIR SO₂ Allowance Tracking System accounts in accordance with 40 CFR Part 96, Subparts FFF and GGG.
- (5) A CAIR SO₂ allowance is a limited authorization to emit sulfur dioxide in accordance with the CAIR SO₂ Trading Program. No provision of the CAIR SO₂ Trading Program, the CAIR Part, or an exemption under 40 CFR 96.205 and no provision of law shall be construed to limit the authority of the state or the United States to terminate or limit such authorization.
- (6) A CAIR SO₂ allowance does not constitute a property right.
- (7) Upon recordation by the Administrator under 40 CFR Part 96, Subpart FFF or GGG, every allocation, transfer, or deduction of a CAIR SO₂ allowance to or from a CAIR SO₂ unit's compliance account is incorporated automatically in any CAIR Part of the source that includes the CAIR SO₂ unit.

Excess Emissions Requirements.

- If a CAIR SO₂ source emits SO₂ during any control period in excess of the CAIR SO₂ emissions limitation, then:
- (1) The owners and operators of the source and each CAIR SO₂ unit at the source shall surrender the CAIR SO₂ allowances required for deduction under 40 CFR 96.254(d)(1) and pay any fine, penalty, or assessment or comply with any other remedy imposed, for the same violations, under the Clean Air Act or applicable state law; and
 - (2) Each ton of such excess emissions on each day of such control period shall constitute a separate violation of 40 CFR Part 96, Subpart AAA, the Clean Air Act, and applicable state law.

DEP Form No. 62-210.900(1)(b) – Form
Effective: 3/16/08

SECTION V. CAIR PART FORM
CLEAN AIR INTERSTATE RULE PROVISIONS

Plant Name (from STEP 1)	Port Everglades
--------------------------	-----------------

**STEP 3,
Continued**

Recordkeeping and Reporting Requirements.

(1) Unless otherwise provided, the owners and operators of the CAIR SO₂ source and each CAIR SO₂ unit at the source shall keep on site at the source each of the following documents for a period of 5 years from the date the document is created. This period may be extended for cause, at any time before the end of 5 years, in writing by the Department or the Administrator.

(i) The certificate of representation under 40 CFR 96.213 for the CAIR designated representative for the source and each CAIR SO₂ unit at the source and all documents that demonstrate the truth of the statements in the certificate of representation; provided that the certificate and documents shall be retained on site at the source beyond such 5-year period until such documents are superseded because of the submission of a new certificate of representation under 40 CFR 96.213 changing the CAIR designated representative.

(ii) All emissions monitoring information, in accordance with 40 CFR Part 96, Subpart HHH, of this part, provided that to the extent that 40 CFR Part 96, Subpart HHH, provides for a 3-year period for recordkeeping, the 3-year period shall apply.

(iii) Copies of all reports, compliance certifications, and other submissions and all records made or required under the CAIR SO₂ Trading Program.

(iv) Copies of all documents used to complete a CAIR Part form and any other submission under the CAIR SO₂ Trading Program or to demonstrate compliance with the requirements of the CAIR SO₂ Trading Program.

(2) The CAIR designated representative of a CAIR SO₂ source and each CAIR SO₂ unit at the source shall submit the reports required under the CAIR SO₂ Trading Program, including those under 40 CFR Part 96, Subpart HHH.

Liability.

(1) Each CAIR SO₂ source and each CAIR SO₂ unit shall meet the requirements of the CAIR SO₂ Trading Program.

(2) Any provision of the CAIR SO₂ Trading Program that applies to a CAIR SO₂ source or the CAIR designated representative of a CAIR SO₂ source shall also apply to the owners and operators of such source and of the CAIR SO₂ units at the source.

(3) Any provision of the CAIR SO₂ Trading Program that applies to a CAIR SO₂ unit or the CAIR designated representative of a CAIR SO₂ unit shall also apply to the owners and operators of such unit.

Effect on Other Authorities.

No provision of the CAIR SO₂ Trading Program, a CAIR Part, or an exemption under 40 CFR 96.205 shall be construed as exempting or excluding the owners and operators, and the CAIR designated representative, of a CAIR SO₂ source or CAIR SO₂ unit from compliance with any other provision of the applicable, approved State Implementation Plan, a federally enforceable permit, or the Clean Air Act.

CAIR NO_x OZONE SEASON TRADING PROGRAM

CAIR Part Requirements.

(1) The CAIR designated representative of each CAIR NO_x Ozone Season source and each CAIR NO_x Ozone Season unit at the source shall:

(i) Submit to the DEP a complete and certified CAIR Part form under 40 CFR 96.322 and Rule 62-296.470, F.A.C., in accordance with the deadlines specified in Rule 62-213.420, F.A.C.; and

(ii) [Reserved];

(2) The owners and operators of each CAIR NO_x Ozone Season source required to have a Title V operating permit or air construction permit, and each CAIR NO_x Ozone Season unit required to have a Title V operating permit or air construction permit at the source shall have a CAIR Part included in the Title V operating permit or air construction permit issued by the DEP under 40 CFR Part 96, Subpart CCCC, for the source and operate the source and the unit in compliance with such CAIR Part.

Monitoring, Reporting, and Recordkeeping Requirements.

(1) The owners and operators, and the CAIR designated representative, of each CAIR NO_x Ozone Season source and each CAIR NO_x Ozone Season unit at the source shall comply with the monitoring, reporting, and recordkeeping requirements of 40 CFR Part 96, Subpart HHHH, and Rule 62-296.470, F.A.C.

(2) The emissions measurements recorded and reported in accordance with 40 CFR Part 96, Subpart HHHH, shall be used to determine compliance by each CAIR NO_x Ozone Season source with the following CAIR NO_x Ozone Season Emissions Requirements.

NO_x Ozone Season Emission Requirements.

(1) As of the allowance transfer deadline for a control period, the owners and operators of each CAIR NO_x Ozone Season source and each CAIR NO_x Ozone Season unit at the source shall hold, in the source's compliance account, CAIR NO_x Ozone Season allowances available for compliance deductions for the control period under 40 CFR 96.354(a) in an amount not less than the tons of total NO_x emissions for the control period from all CAIR NO_x Ozone Season units at the source, as determined in accordance with 40 CFR Part 96, Subpart HHHH.

(2) A CAIR NO_x Ozone Season unit shall be subject to the requirements under paragraph (1) of the NO_x Ozone Season Emission Requirements starting on the later of May 1, 2009 or the deadline for meeting the unit's monitoring certification requirements under 40 CFR 96.370(b)(1),(2), or (3) and for each control period thereafter.

(3) A CAIR NO_x Ozone Season allowance shall not be deducted, for compliance with the requirements under paragraph (1) of the NO_x Ozone Season Emission Requirements, for a control period in a calendar year before the year for which the CAIR NO_x Ozone Season allowance was allocated.

(4) CAIR NO_x Ozone Season allowances shall be held in, deducted from, or transferred into or among CAIR NO_x Ozone Season Allowance Tracking System accounts in accordance with 40 CFR Part 96, Subparts FFFF and GGGG.

(5) A CAIR NO_x Ozone Season allowance is a limited authorization to emit one ton of NO_x in accordance with the CAIR NO_x Ozone Season Trading Program. No provision of the CAIR NO_x Ozone Season Trading Program, the CAIR Part, or an exemption under 40 CFR 96.305 and no provision of law shall be construed to limit the authority of the state or the United States to terminate or limit such authorization.

**SECTION V. CAIR PART FORM
CLEAN AIR INTERSTATE RULE PROVISIONS**

(6) A CAIR NO_x Ozone Season allowance does not constitute a property right.
 (7) Upon recordation by the Administrator under 40 CFR Part 96, Subpart EEEE, FFFF or GGGG, every allocation, transfer, or deduction of a CAIR NO_x Ozone Season allowance to or from a CAIR NO_x Ozone Season unit's compliance account is incorporated automatically in any CAIR Part of the source that includes the CAIR NO_x Ozone Season unit.

Plant Name (from STEP 1)	Port Everglades
--------------------------	-----------------

**STEP 3,
Continued**

Excess Emissions Requirements.

If a CAIR NO_x Ozone Season source emits NO_x during any control period in excess of the CAIR NO_x Ozone Season emissions limitation, then:
 (1) The owners and operators of the source and each CAIR NO_x Ozone Season unit at the source shall surrender the CAIR NO_x Ozone Season allowances required for deduction under 40 CFR 96.354(d)(1) and pay any fine, penalty, or assessment or comply with any other remedy imposed, for the same violations, under the Clean Air Act or applicable state law; and
 (2) Each ton of such excess emissions and each day of such control period shall constitute a separate violation of 40 CFR Part 96, Subpart AAAA, the Clean Air Act, and applicable state law.

Recordkeeping and Reporting Requirements.

(1) Unless otherwise provided, the owners and operators of the CAIR NO_x Ozone Season source and each CAIR NO_x Ozone Season unit at the source shall keep on site at the source each of the following documents for a period of 5 years from the date the document is created. This period may be extended for cause, at any time before the end of 5 years, in writing by the DEP or the Administrator.
 (i) The certificate of representation under 40 CFR 96.313 for the CAIR designated representative for the source and each CAIR NO_x Ozone Season unit at the source and all documents that demonstrate the truth of the statements in the certificate of representation; provided that the certificate and documents shall be retained on site at the source beyond such 5-year period until such documents are superseded because of the submission of a new certificate of representation under 40 CFR 96.113 changing the CAIR designated representative.
 (ii) All emissions monitoring information, in accordance with 40 CFR Part 96 Subpart HHHH, of this part, provided that to the extent that 40 CFR Part 96, Subpart HHHH, provides for a 3-year period for recordkeeping, the 3-year period shall apply.
 (iii) Copies of all reports, compliance certifications, and other submissions and all records made or required under the CAIR NO_x Ozone Season Trading Program.
 (iv) Copies of all documents used to complete a CAIR Part form and any other submission under the CAIR NO_x Ozone Season Trading Program or to demonstrate compliance with the requirements of the CAIR NO_x Ozone Season Trading Program.
 (2) The CAIR designated representative of a CAIR NO_x Ozone Season source and each CAIR NO_x Ozone Season unit at the source shall submit the reports required under the CAIR NO_x Ozone Season Trading Program, including those under 40 CFR Part 96, Subpart HHHH.

Liability.

(1) Each CAIR NO_x Ozone Season source and each CAIR NO_x Ozone Season unit shall meet the requirements of the CAIR NO_x Ozone Season Trading Program.
 (2) Any provision of the CAIR NO_x Ozone Season Trading Program that applies to a CAIR NO_x Ozone Season source or the CAIR designated representative of a CAIR NO_x Ozone Season source shall also apply to the owners and operators of such source and of the CAIR NO_x Ozone Season units at the source.
 (3) Any provision of the CAIR NO_x Ozone Season Trading Program that applies to a CAIR NO_x Ozone Season unit or the CAIR designated representative of a CAIR NO_x Ozone Season unit shall also apply to the owners and operators of such unit.

Effect on Other Authorities.


No provision of the CAIR NO_x Ozone Season Trading Program, a CAIR Part, or an exemption under 40 CFR 96.305 shall be construed as exempting or excluding the owners and operators, and the CAIR designated representative, of a CAIR NO_x Ozone Season source or CAIR NO_x Ozone Season unit from compliance with any other provision of the applicable, approved State Implementation Plan, a federally enforceable permit, or the Clean Air Act.

STEP 4

Read the certification statement; provide name, title, owner company name, phone, and e-mail address; sign, and date.

Certification (for designated representative or alternate designated representative only)

I am authorized to make this submission on behalf of the owners and operators of the CAIR source or CAIR units for which the submission is made. I certify under penalty of law that I have personally examined, and am familiar with, the statements and information submitted in this document and all its attachments. Based on my inquiry of those individuals with primary responsibility for obtaining the information, I certify that the statements and information are to the best of my knowledge and belief true, accurate, and complete. I am aware that there are significant penalties for submitting false statements and information or omitting required statements and information, including the possibility of fine or imprisonment.

Name: Sheila Wilkinson	Title: PGD Environmental Manager (DR)
Company Owner Name: Florida Power & Light	
Phone: 561-691-2287	E-mail Address: Sheila_M_Wilkinson@fpl.com
Signature: 	Date: 5/27/08

SECTION VI. APPENDICES.

The Following Appendices Are Enforceable As Allowed By Rule Applicability And Are Supporting Documents For The Air Operating Permit:

Appendix A, Glossary.

Appendix ASP, ASP Number 97-B-01 (With Scrivener's Order Dated July 9, 1997).

Appendix CAM, Compliance Assurance Monitoring Plan.

Appendix I, List of Insignificant Emissions Units and/or Activities.

Appendix O, Order Granting Petition for Reduced Frequency of Particulate Testing.

Appendix RR, Facility-wide Reporting Requirements.

Appendix TR, Facility-wide Testing Requirements.

Appendix TV, Title V General Conditions.

Appendix U, List of Unregulated Emissions Units and/or Activities.

APPENDIX A

ABBREVIATIONS, ACRONYMS, CITATIONS AND IDENTIFICATION NUMBERS

° F: degrees Fahrenheit
acfm: actual cubic feet per minute
AOR: Annual Operating Report
ARMS: Air Resource Management System (Department's database)
BACT: best available control technology
Btu: British thermal units
CAM: compliance assurance monitoring
CEMS: continuous emissions monitoring system
cfm: cubic feet per minute
CFR: Code of Federal Regulations
CO: carbon monoxide
COMS: continuous opacity monitoring system
DARM: Division of Air Resources Management
DCA: Department of Community Affairs
DEP: Department of Environmental Protection
Department: Department of Environmental Protection
dscfm: dry standard cubic feet per minute
EPA: Environmental Protection Agency
ESP: electrostatic precipitator (control system for reducing particulate matter)
EU: emissions unit
F.A.C.: Florida Administrative Code
F.D.: forced draft
F.S.: Florida Statutes
FGR: flue gas recirculation
Fl: fluoride
ft²: square feet
ft³: cubic feet
gpm: gallons per minute
gr: grains
HAP: hazardous air pollutant
Hg: mercury
I.D.: induced draft
ID: identification
ISO: International Standards Organization (refers to those conditions at 288 Kelvin, 60% relative humidity and 101.3 kilopascals pressure.)
kPa: kilopascals
LAT: Latitude
lb: pound

APPENDIX A

ABBREVIATIONS, ACRONYMS, CITATIONS AND IDENTIFICATION NUMBERS

lbs/hr: pounds per hour
LONG: Longitude
MACT: maximum achievable technology
mm: millimeter
MMBtu: million British thermal units
MSDS: material safety data sheets
MW: megawatt
NESHAP: National Emissions Standards for Hazardous Air Pollutants
NO_x: nitrogen oxides
NSPS: New Source Performance Standards
O&M: operation and maintenance
O₂: oxygen
ORIS: Office of Regulatory Information Systems
OS: Organic Solvent
Pb: lead
PM: particulate matter
PM₁₀: particulate matter with a mean aerodynamic diameter of 10 microns or less
PSD: prevention of significant deterioration
psi: pounds per square inch
PTE: potential to emit
RACT: reasonably available control technology
RATA: relative accuracy test audit
RMP: Risk Management Plan
RO: Responsible Official
SAM: sulfuric acid mist
scf: standard cubic feet
scfm: standard cubic feet per minute
SIC: standard industrial classification code
SNCR: selective non-catalytic reduction (control system used for reducing emissions of nitrogen oxides)
SOA: Specific Operating Agreement
SO₂: sulfur dioxide
TPH: tons per hour
lbs/hr: pounds per hour
LONG: Longitude
MACT: maximum achievable technology
mm: millimeter
MMBtu: million British thermal units
MSDS: material safety data sheets

APPENDIX A

ABBREVIATIONS, ACRONYMS, CITATIONS AND IDENTIFICATION NUMBERS

MW: megawatt
NESHAP: National Emissions Standards for Hazardous Air Pollutants
NO_x: nitrogen oxides
NSPS: New Source Performance Standards
O&M: operation and maintenance
O₂: oxygen
ORIS: Office of Regulatory Information Systems
OS: Organic Solvent
Pb: lead
PM: particulate matter
PM₁₀: particulate matter with a mean aerodynamic diameter of 10 microns or less
PSD: prevention of significant deterioration
psi: pounds per square inch
PTE: potential to emit
RACT: reasonably available control technology
RATA: relative accuracy test audit
RMP: Risk Management Plan
RO: Responsible Official
SAM: sulfuric acid mist
scf: standard cubic feet
scfm: standard cubic feet per minute
SIC: standard industrial classification code
SNCR: selective non-catalytic reduction (control system used for reducing emissions of nitrogen oxides)
SOA: Specific Operating Agreement
SO₂: sulfur dioxide
TPH: tons per hour
TPY: tons per year
UTM: Universal Transverse Mercator coordinate system
VE: visible emissions
VOC: volatile organic compounds
x: By or times

Citations:

The following examples illustrate the methods used in this permit to abbreviate and cite the references of rules, regulations, guidance memorandums, permit numbers and ID numbers.

Code of Federal Regulations:

APPENDIX A

ABBREVIATIONS, ACRONYMS, CITATIONS AND IDENTIFICATION NUMBERS

Example: [40 CFR 60.334]

Where:	40	refers to	Title 40
	CFR	refers to	Code of Federal Regulations
	60	refers to	Part 60
	60.334	refers to	Regulation 60.334

Florida Administrative Code (F.A.C.) Rules:

Example: [Rule 62-213.205, F.A.C.]

Where:	62	refers to	Title 62
	62-213	refers to	Chapter 62-213
	62-213.205	refers to	Rule 62-213.205, F.A.C.

Identification Numbers:

Facility Identification (ID) Number:

Example: Facility ID No.: 1050221

Where:

105 =	3-digit number code identifying the facility is located in Polk County
0221 =	4-digit number assigned by state database.

Permit Numbers:

Example: 1050221-002-AV, or
1050221-001-AC

Where:

AC =	Air Construction Permit
AV =	Air Operation Permit (Title V Source)
105 =	3-digit number code identifying the facility is located in Polk County
0221=	4-digit number assigned by permit tracking database
001 or 002=	3-digit sequential project number assigned by permit tracking database

Example: PSD-FL-185
PA95-01
AC53-208321

Where:

PSD =	Prevention of Significant Deterioration Permit
PA =	Power Plant Siting Act Permit
AC53 =	old Air Construction Permit numbering identifying the facility is located in Polk County

STATE OF FLORIDA
DEPARTMENT OF ENVIRONMENTAL PROTECTION

In the matter of:)
)
Florida Electric Power Coordinating Group, Inc.,) ASP No. 97-B-01
)
Petitioner.)

ORDER ON REQUEST
FOR
ALTERNATE PROCEDURES AND REQUIREMENTS

Pursuant to Rule 62-297.620, Florida Administrative Code (F.A.C.), the Florida Electric Coordinating Group, Incorporated, (FCG) petitioned for approval to: (1) Exempt fossil fuel steam generators which burn liquid and/or solid fuel for less than 400 hours during the federal fiscal year from the requirement to conduct an annual particulate matter compliance test; and, (2) Exempt fossil fuel steam generators which burn liquid and/or solid fuel for less than 400 hours during the federal fiscal year from the requirement to conduct an annual particulate matter compliance test during the year prior to renewal of an operation permit. This Order is intended to clarify particulate testing requirements for those fossil fuel steam generators which primarily burn gaseous fuels including, but not necessarily limited to natural gas.

Having considered the provisions of Rule 62-296.405(1), F.A.C., Rule 62-297.310(7), F.A.C., and all supporting documentation, the following Findings of Fact, Conclusions of Law, and Order are entered:

FINDINGS OF FACT

1. The Florida Electric Power Coordinating Group, Incorporated, petitioned the Department to exempt those fossil fuel steam generators which have a heat input of more than 250 million Btu per hour and burn solid and/or liquid fuel less than 400 hours during the year from the requirement to conduct an annual particulate matter compliance test. [Exhibit 1]
2. Rule 62-296.405(1)(a), F.A.C., applies to those fossil fuel steam generators that are not subject to the federal standards of performance for new stationary sources (NSPS) in 40 CFR 60 and which have a heat input of more than 250 million Btu per hour.
3. Rule 62-296.405(1)(a), F.A.C., limits visible emissions from affected fossil fuel steam generators to, "20 percent opacity except for either one six-minute period per hour during which

not exceed 40 percent. The option selected shall be specified in the emissions unit's construction and operation permits. Emissions units governed by this visible emission limit shall test for particulate emission compliance annually and as otherwise required by Rule 62-297, F.A.C."

4. Rule 62-296.405(1)(a), F.A.C., further states, "Emissions units electing to test for particulate matter emission compliance quarterly shall be allowed visible emissions of 40 percent opacity. The results of such tests shall be submitted to the Department. Upon demonstration that the particulate standard has been regularly complied with, the Secretary, upon petition by the applicant, shall reduce the frequency of particulate testing to no less than once annually.

5. Rule 297.310(7)(a)1., F.A.C., states, "The owner or operator of a new or modified emissions unit that is subject to an emission limiting standard shall conduct a compliance test that demonstrates compliance with the applicable emission limiting standard prior to obtaining an operation permit for such emissions unit."

6. Rule 297.310(7)(a)3., F.A.C., states, "The owner or operator of an emissions unit that is subject to any emission limiting standard shall conduct a compliance test that demonstrates compliance with the applicable emission limiting standard prior to obtaining a renewed operation permit. Emissions units that are required to conduct an annual compliance test may submit the most recent annual compliance test to satisfy the requirements of this provision.

7. Rule 297.310(7)(a)3., F.A.C., further states, "In renewing an air operation permit pursuant to Rule 62-210.300(2)(a)3.b., c., or d., F.A.C., the Department shall not require submission of emission compliance test results for any emissions unit that, during the year prior to renewal: a. Did not operate; or, b. In the case of a fuel burning emissions unit, burned liquid and/or solid fuel for a total of no more than 400 hours."

8. Rule 297.310(7)(a)4., F.A.C., states, "During each federal fiscal year (October 1 – September 30), unless otherwise specified by rule, order, or permit, the owner or operator of each emissions unit shall have a formal compliance test conducted for: a. Visible emissions, if there is an applicable standard; b. Each of the following pollutants, if there is an applicable standard, and if the emissions unit emits or has the potential to emit: 5 tons per year or more of lead or lead compounds measured as elemental lead; 30 tons per year or more of acrylonitrile; or 100 tons per year or more of any other regulated air pollutant..."

9. Rule 297.310(7)(a)5., F.A.C., states, "An annual compliance test for particulate matter emissions shall not be required for any fuel burning emissions unit that, in a federal fiscal year, does not burn liquid and/or solid fuel, other than during startup, for a total of more than 400 hours."

10. Rule 297.310(7)(a)6., F.A.C., states, "For fossil fuel steam generators on a semi-annual particulate matter emission compliance testing schedule, a compliance test shall not be

required for any six-month period in which liquid and/or solid fuel is not burned for more than 200 hours other than during startup."

11. Rule 297.310(7)(a)7., F.A.C., states, "For emissions units electing to conduct particulate matter emission compliance testing quarterly pursuant to Rule 62-296.405(2)(a), F.A.C., a compliance test shall not be required for any quarter in which liquid and/or solid fuel is not burned for more than 100 hours other than during startup." [Note: The reference should be to Rule 62-296.405(1)(a), F.A.C., rather than Rule 62-296.405(2)(a), F.A.C.]

12. The fifth edition of the U. S. Environmental Protection Agency's Compilation of Air Pollutant Emission Factors, AP-42, that emissions of filterable particulate from gas-fired fossil fuel steam generators with a heat input of more than about 10 million Btu per hour may be expected to range from 0.001 to 0.006 pound per million Btu. [Exhibit 2]

13. Rule 62-296.405(1)(b), F.A.C. and the federal standards of performance for new stationary sources in 40 CFR 60.42, Subpart D, limit particulate emissions from uncontrolled fossil fuel fired steam generators with a heat input of more than 250 million Btu to 0.1 pound per million Btu.

CONCLUSIONS OF LAW

1. The Department has jurisdiction to consider the matter pursuant to Section 403.061, Florida Statutes (F.S.), and Rule 62-297.620, F.A.C.

2. Pursuant to Rule 62-297.310(7), F.A.C., the Department may require Petitioner to conduct compliance tests that identify the nature and quantity of pollutant emissions, if, after investigation, it is believed that any applicable emission standard or condition of the applicable permits is being violated.

3. There is reason to believe that a fossil fuel steam generator which does not burn liquid and/or solid fuel (other than during startup) for a total of more than 400 hours in a federal fiscal year and complies with all other applicable limits and permit conditions is in compliance with the applicable particulate mass emission limiting standard.

ORDER

Having considered the requirements of Rule 62-296.405, F.A.C., Rule 62-297.310, F.A.C., and supporting documentation, it is hereby ordered that:

1. An annual compliance test for particulate matter emissions shall not be required for any fuel burning emissions unit that, in a federal fiscal year, does not burn liquid and/or solid fuel, other than during startup, for a total of more than 400 hours;

2. For fossil fuel steam generators on a semi-annual particulate matter emission compliance testing schedule, a compliance test shall not be required for any six-month period in which liquid and/or solid fuel is not burned for more than 200 hours other than during startup;

3. For emissions units electing to conduct particulate matter emission compliance testing quarterly pursuant to Rule 62-296.405(1)(a), F.A.C., a compliance test shall not be required for any quarter in which liquid and/or solid fuel is not burned for more than 100 hours other than during startup;

4. In renewing an air operation permit pursuant to Rule 62-210.300(2)(a)3.b., c., or d., F.A.C., the Department shall not require submission of particulate matter emission compliance test results for any fossil fuel steam generator emissions unit that burned liquid and/or solid fuel for a total of no more than 400 hours during the year prior to renewal.

5. Pursuant to Rule 62-297.310(7), F.A.C., owners of affected fossil fuel steam generators may be required to conduct compliance tests that identify the nature and quantity of pollutant emissions, if, after investigation, it is believed that any applicable emission standard or condition of the applicable permits is being violated.

6. Pursuant to Rule 62-297.310(8), F.A.C., owners of affected fossil fuel steam generators shall submit the compliance test report to the District Director of the Department district office having jurisdiction over the emissions unit and, where applicable, the Air Program Administrator of the appropriate Department-approved local air program within 45 days of completion of the test.

PETITION FOR ADMINISTRATIVE REVIEW

The Department will take the action described in this Order unless a timely petition for an administrative hearing is filed pursuant to sections 120.569 and 120.57 of the Florida Statutes, or a party requests mediation as an alternative remedy under section 120.573 before the deadline for filing a petition. Choosing mediation will not adversely affect the right to a hearing if mediation does not result in a settlement. The procedures for petitioning for a hearing are set forth below, followed by the procedures for requesting mediation.

A person whose substantial interests are affected by the Department's proposed decision may petition for an administrative hearing in accordance with sections 120.569 and 120.57 of the Florida Statutes. The petition must contain the information set forth below and must be filed (received) in the Office of General Counsel of the Department at 3900 Commonwealth Boulevard, Mail Station 35, Tallahassee, Florida 32399-3000. Petitions must be filed within 21 days of receipt of this Order. A petitioner must mail a copy of the petition to the applicant at the address indicated above, at the time of filing. The failure of any person to file a petition (or a request for mediation, as discussed below) within the appropriate time period shall constitute a waiver of that person's right to request an administrative determination (hearing) under sections 120.569 and 120.57 of

the Florida Statutes, or to intervene in this proceeding and participate as a party to it. Any subsequent intervention will be only at the approval of the presiding officer upon the filing of a motion in compliance with Rule 28-5.207 of the Florida Administrative Code.

A petition must contain the following information:

- (a) The name, address, and telephone number of each petitioner, the applicant's name and address, the Department File Number, and the county in which the project is proposed;
- (b) A statement of how and when each petitioner received notice of the Department's action or proposed action;
- (c) A statement of how each petitioner's substantial interests are affected by the Department's action or proposed action;
- (d) A statement of the material facts disputed by each petitioner, if any;
- (e) A statement of facts that the petitioner contends warrant reversal or modification of the Department's action or proposed action;
- (f) A statement identifying the rules or statutes each petitioner contends require reversal or modification of the Department's action or proposed action; and,
- (g) A statement of the relief sought by each petitioner, stating precisely the action each petitioner wants the Department to take with respect to the Department's action or proposed action in the notice of intent.

Because the administrative hearing process is designed to formulate final agency action, the filing of a petition means that the Department's final action may be different from the position taken by it in this Order. Persons whose substantial interests will be affected by any such final decision of the Department on the application have the right to petition to become a party to the proceeding, in accordance with the requirements set forth above.

A person whose substantial interests are affected by the Department's proposed decision, may elect to pursue mediation by asking all parties to the proceeding to agree to such mediation and by filing with the Department a request for mediation and the written agreement of all such parties to mediate the dispute. The request and agreement must be filed in (received by) the Office of General Counsel of the Department at 3900 Commonwealth Boulevard, Mail Station 35, Tallahassee, Florida 32399-3000, by the same deadline as set forth above for the filing of a petition.

A request for mediation must contain the following information:

APPENDIX ASP
ASP NUMBER 97-B-01

- (a) The name, address, and telephone number of the person requesting mediation and that person's representative, if any;
- (b) A statement of the preliminary agency action;
- (c) A statement of the relief sought; and
- (d) Either an explanation of how the requester's substantial interests will be affected by the action or proposed action addressed in this notice of intent or a statement clearly identifying the petition for hearing that the requester has already filed, and incorporating it by reference.

The agreement to mediate must include the following:

- (a) The names, addresses, and telephone numbers of any persons who may attend the mediation;
- (b) The name, address, and telephone number of the mediator selected by the parties, or a provision for selecting a mediator within a specified time;
- (c) The agreed allocation of the costs and fees associated with the mediation;
- (d) The agreement of the parties on the confidentiality of discussions and documents introduced during mediation;
- (e) The date, time, and place of the first mediation session, or a deadline for holding the first session, if no mediator has yet been chosen;
- (f) The name of each party's representative who shall have authority to settle or recommend settlement; and
- (g) The signatures of all parties or their authorized representatives.

As provided in section 120.573 of the Florida Statutes, the timely agreement of all parties to mediate will toll the time limitations imposed by sections 120.569 and 120.57 for requesting and holding an administrative hearing. Unless otherwise agreed by the parties, the mediation must be concluded within sixty days of the execution of the agreement. If mediation results in settlement of the administrative dispute, the Department must enter a final order incorporating the agreement of the parties. Persons whose substantial interests will be affected by such a modified final decision of the Department have a right to petition for a hearing only in accordance with the requirements for such petitions set forth above. If mediation terminates without settlement of the dispute, the Department shall notify all parties in writing that the administrative hearing processes under sections 120.569 and 120.57 remain available for disposition of the dispute, and the notice will

—Page 6 of 8—

APPENDIX ASP
ASP NUMBER 97-B-01

specify the deadlines that then will apply for challenging the agency action and electing remedies under those two statutes.

In addition to the above, a person subject to regulation has a right to apply for a variance from or waiver of the requirements of particular rules, on certain conditions, under section 120.542 of the Florida Statutes. The relief provided by this state statute applies only to state rules, not statutes, and not to any federal regulatory requirements. Applying for a variance or waiver does not substitute or extend the time for filing a petition for an administrative hearing or exercising any other right that a person may have in relation to the action proposed in this notice of intent.

The application for a variance or waiver is made by filing a petition with the Office of General Counsel of the Department, 3900 Commonwealth Boulevard, Mail Station 35, Tallahassee, Florida 32399-3000.

The petition must specify the following information:

- (a) The name, address, and telephone number of the petitioner;
- (b) The name, address, and telephone number of the attorney or qualified representative of the petitioner, if any;
- (c) Each rule or portion of a rule from which a variance or waiver is requested;
- (d) The citation to the statute underlying (implemented by) the rule identified in (c) above;
- (e) The type of action requested;
- (f) The specific facts that would justify a variance or waiver for the petitioner;
- (g) The reason why the variance or waiver would serve the purposes of the underlying statute (implemented by the rule); and
- (h) A statement whether the variance or waiver is permanent or temporary and, if temporary, a statement of the dates showing the duration of the variance or waiver requested.

The Department will grant a variance or waiver, when the petition demonstrates both that the application of the rule would create a substantial hardship or violate principles of fairness, as each of those terms is defined in section 120.542(2) of the Florida Statutes, and that the purpose of the underlying statute will be or has been achieved by other means by the petitioner. Persons subject to regulation pursuant to any federally delegated or approved air program should be aware that Florida is specifically not authorized to issue variances or waivers from any requirements of any such federally delegated or approved program. The requirements of the program remain fully

APPENDIX ASP
ASP NUMBER 97-B-01

each of those terms is defined in section 120.542(2) of the Florida Statutes, and that the purpose of the underlying statute will be or has been achieved by other means by the petitioner. Persons subject to regulation pursuant to any federally delegated or approved air program should be aware that Florida is specifically not authorized to issue variances or waivers from any requirements of any such federally delegated or approved program. The requirements of the program remain fully enforceable by the Administrator of the EPA and by any person under the Clean Air Act unless and until the Administrator separately approves any variance or waiver in accordance with the procedures of the federal program.


This Order constitutes final agency action unless a petition is filed in accordance with the above paragraphs. Upon timely filing of a petition, this Order will not be effective until further Order of the Department.

RIGHT TO APPEAL

Any party to this Order has the right to seek judicial review of the Order pursuant to Section 120.68, F.S., by the filing of a Notice of Appeal pursuant to Rule 9.110, Florida Rules of Appellate Procedure, with the Clerk of the Department in the Office of General Counsel, 3900 Commonwealth Boulevard, Mail Station 35, Tallahassee, Florida 32399-3000; and, by filing a copy of the Notice of Appeal accompanied by the applicable filing fees with the appropriate District Court of Appeal. The Notice of Appeal must be filed within 30 days from the date the Notice of Agency Action is filed with the Clerk of the Department.

DONE AND ORDERED this 17 day of March, 1997 in Tallahassee, Florida.

STATE OF FLORIDA DEPARTMENT
OF ENVIRONMENTAL PROTECTION



HOWARD L. RHODES, Director
Division of Air Resources Management
Twin Towers Office Building
2600 Blair Stone Road
Tallahassee, Florida 32399-2400
(904) 488-0114

—Page 8 of 8—

CERTIFICATE OF SERVICE

The undersigned duly designated deputy clerk hereby certifies that a copy of the foregoing was mailed to Rich Piper, Chair, Florida Power Coordinating Group, Inc., 405 Reo Street, Suite 100, Tampa, Florida 33609-1004, on this 18th day of March 1997.

Clerk Stamp

FILING AND ACKNOWLEDGMENT
FILED, on this date, pursuant to §120.52(7), Florida Statutes, with the designated Department Clerk, receipt of which is hereby acknowledged.

Martha Olden 3-18-97
Clerk Date

APPENDIX ASP
ASP NUMBER 97-B-01

STATE OF FLORIDA
DEPARTMENT OF ENVIRONMENTAL PROTECTION

In the matter of:)
)
Florida Electric Power Coordinating Group, Inc.,) ASP No. 97-B-01
)
Petitioner.)

ORDER CORRECTING SCRIVENER'S ERROR

The Order which authorizes owners of natural gas fired fossil fuel steam generators to forgo particulate matter compliance testing on an annual basis and prior to renewal of an operation permit entered on the 17th day of March, 1997, is hereby corrected on page 4, paragraph number 4, by deleting the words "pursuant to Rule 62-210.300(2)(a)3.b., c., or d., F.A.C.":

4. In renewing an air operation permit pursuant to ~~Rule 62-210.300(2)(a)3.b., c., or d., F.A.C.~~, the Department shall not require submission of particulate matter emission compliance test results for any fossil fuel steam generator emissions unit that burned liquid and/or solid fuel for a total of no more than 400 hours during the year prior to renewal.

DONE AND ORDERED this 2 day of July, 1997 in Tallahassee, Florida.


STATE OF FLORIDA DEPARTMENT
OF ENVIRONMENTAL PROTECTION



HOWARD L. RHODES, Director
Division of Air Resources Management
Twin Towers Office Building
2600 Blair Stone Road
Tallahassee, Florida 32399-2400
(904) 488-0114

APPENDIX ASP
ASP NUMBER 97-B-01

The above two documents comprise Appendix ASP.

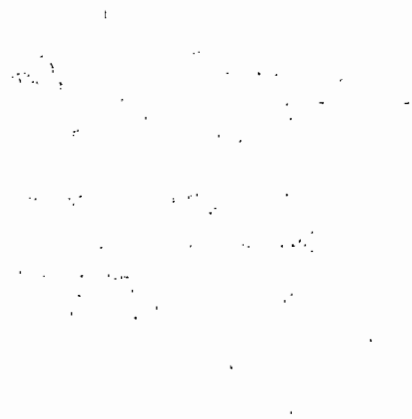

APPENDIX CAM

Compliance Assurance Monitoring Requirements

Compliance Assurance Monitoring Requirements

Pursuant to Rule 62-213.440(1)(b)1.a., F.A.C., the CAM plans that are included in this appendix contain the monitoring requirements necessary to satisfy 40 CFR 64. Conditions 1. – 17. are generic conditions applicable to all emissions units that are subject to the CAM requirements. Specific requirements related to each emissions unit are contained in the attached tables, as submitted by the applicant and approved by the Department.

40 CFR 64.6 Approval of Monitoring.

1. The attached CAM plan(s), as submitted by the applicant, is/are approved for the purposes of satisfying the requirements of 40 CFR 64.3. [40 CFR 64.6(a)]
2. The attached CAM plan(s) include the following information:
 - a. The indicator(s) to be monitored (such as temperature, pressure drop, emissions, or similar parameter);
 - b. The means or device to be used to measure the indicator(s) (such as temperature measurement device, visual observation, or CEMS); and
 - c. The performance requirements established to satisfy 40 CFR 64.3(b) or (d), as applicable. [40 CFR 64.6(c)(1)]
3. The attached CAM plan(s) describe the means by which the owner or operator will define an exceedance of the permitted limits or an excursion from the stated indicator ranges and averaging periods for purposes of responding to (see **CAM Conditions 5. - 9.**) and reporting exceedances or excursions (see **CAM Conditions 10. – 14.**). [40 CFR 64.6(c)(2)]
4. The permittee is required to conduct the monitoring specified in the attached CAM plan(s) and shall fulfill the obligations specified in the conditions below (see **CAM Conditions 5. - 17.**). [40 CFR 64.6(c)(3)]

40 CFR 64.7 Operation of Approved Monitoring.

5. Commencement of operation. The owner or operator shall conduct the monitoring required under this appendix upon the effective date of this Title V permit. [40 CFR 64.7(a)]
6. Proper maintenance. At all times, the owner or operator shall maintain the monitoring, including but not limited to, maintaining necessary parts for routine repairs of the monitoring equipment. [40 CFR 64.7(b)]
7. Continued operation. Except for, as applicable, monitoring malfunctions, associated repairs, and required quality assurance or control activities (including, as applicable, calibration checks and required zero and span adjustments), the owner or operator shall conduct all monitoring in continuous operation (or shall collect data at all required intervals) at all times that the pollutant-specific emissions unit is operating. Data recorded during monitoring malfunctions, associated repairs, and required quality assurance or control activities shall not be used for purposes of this part, including data averages and calculations, or fulfilling a minimum data availability requirement, if applicable. The owner or operator shall use all the data collected during all other periods in assessing the operation of the control device and associated control system. A monitoring malfunction is any sudden, infrequent, not reasonably preventable failure of the monitoring to provide valid data. Monitoring failures that are caused in part by poor maintenance or careless operation are not malfunctions. [40 CFR 64.7(c)]

8. Response to excursions or exceedances.

a. Upon detecting an excursion or exceedance, the owner or operator shall restore operation of the pollutant-specific emissions unit (including the control device and associated capture system) to its normal or usual manner of operation as expeditiously as practicable in accordance with good air pollution control practices for minimizing emissions. The response shall include minimizing the period of any startup, shutdown or malfunction and taking any necessary corrective actions to restore normal operation and prevent the likely recurrence of the cause of an excursion or exceedance (other than those caused by excused startup or shutdown conditions, if allowed by this permit). Such actions may include initial inspection and evaluation, recording that operations returned to normal without operator action (such as through response by a computerized distribution control system), or any necessary follow-up actions to return operation to within the indicator range, designated condition, or below the applicable emission limitation or standard, as applicable.

b. Determination of whether the owner or operator has used acceptable procedures in response to an excursion or exceedance will be based on information available, which may include but is not limited to, monitoring results, review of operation and maintenance procedures and records, and inspection of the control device, associated capture system, and the process.

[40 CFR 64.7(d)(1) & (2)]

9. Documentation of need for improved monitoring. If the owner or operator identifies a failure to achieve compliance with an emission limitation or standard for which the approved monitoring did not provide an indication of an excursion or exceedance while providing valid data, or the results of compliance or performance testing document a need to modify the existing indicator ranges or designated conditions, the owner or operator shall promptly notify the permitting authority and, if necessary, submit a proposed modification to the Title V permit to address the necessary monitoring changes. Such a modification may include, but is not limited to, reestablishing indicator ranges or designated conditions, modifying the frequency of conducting monitoring and collecting data, or the monitoring of additional parameters. [40 CFR 64.7(e)]

40 CFR 64.8 Quality Improvement Plan (QIP) Requirements.

10. Based on the results of a determination made under **CAM Condition 8.a.**, above, the permitting authority may require the owner or operator to develop and implement a QIP. Consistent with **CAM Condition 4.**, an accumulation of exceedances or excursions exceeding 5 percent duration of a pollutant-specific emissions unit's operating time for a reporting period, may require the implementation of a QIP. The threshold may be set at a higher or lower percent or may rely on other criteria for purposes of indicating whether a pollutant-specific emissions unit is being maintained and operated in a manner consistent with good air pollution control practices. [40 CFR 64.8(a)]

11. Elements of a QIP.

a. The owner or operator shall maintain a written QIP, if required, and have it available for inspection.

b. The plan initially shall include procedures for evaluating the control performance problems and, based on the results of the evaluation procedures, the owner or operator shall modify the plan to include procedures for conducting one or more of the following actions, as appropriate:

- (1) Improved preventive maintenance practices.
- (2) Process operation changes.
- (3) Appropriate improvements to control methods.
- (4) Other steps appropriate to correct control performance.

(5) More frequent or improved monitoring (only in conjunction with one or more steps under **CAM Condition 11.b(i)** through **(iv)**, above).

[40 CFR 64.8(b)]

12. If a QIP is required, the owner or operator shall develop and implement a QIP as expeditiously as practicable and shall notify the permitting authority if the period for completing the improvements contained in the QIP exceeds 180 days from the date on which the need to implement the QIP was determined. [40 CFR 64.8(c)]

13. Following implementation of a QIP, upon any subsequent determination pursuant to **CAM Condition 8.b.**, the permitting authority may require that an owner or operator make reasonable changes to the QIP if the QIP is found to have:

- a. Failed to address the cause of the control device performance problems; or
- b. Failed to provide adequate procedures for correcting control device performance problems as expeditiously as practicable in accordance with good air pollution control practices for minimizing emissions.

[40 CFR 64.8(d)]

14. Implementation of a QIP shall not excuse the owner or operator of a source from compliance with any existing emission limitation or standard, or any existing monitoring, testing, reporting or recordkeeping requirement that may apply under federal, state, or local law, or any other applicable requirements under the Act. [40 CFR 64.8(e)]

40 CFR 64.9 Reporting And Recordkeeping Requirements.

15. General reporting requirements.

a. On and after the date specified in **CAM Condition 5.** by which the owner or operator must use monitoring that meets the requirements of this appendix, the owner or operator shall submit monitoring reports semi-annually to the permitting authority in accordance with Rule 62-213.440(1)(b)3.a., F.A.C.

b. A report for monitoring under this part shall include, at a minimum, the information required under Rule 62-213.440(1)(b)3.a., F.A.C., and the following information, as applicable:

(1) Summary information on the number, duration and cause (including unknown cause, if applicable) of excursions or exceedances, as applicable, and the corrective actions taken;

(2) Summary information on the number, duration and cause (including unknown cause, if applicable) for monitor downtime incidents (other than downtime associated with zero and span or other daily calibration checks, if applicable); and

(3) A description of the actions taken to implement a QIP during the reporting period as specified in **CAM Conditions 10.** through **14.** Upon completion of a QIP, the owner or operator shall include in the next summary report documentation that the implementation of the plan has been completed and reduced the likelihood of similar levels of excursions or exceedances occurring.

[40 CFR 64.9(a)]

16. General recordkeeping requirements.

a. The owner or operator shall comply with the recordkeeping requirements specified in Rule 62-213.440(1)(b)2., F.A.C. The owner or operator shall maintain records of monitoring data, monitor performance data, corrective actions taken, any written quality improvement plan required pursuant to **CAM Conditions 10.** through **14.** and any activities undertaken to implement a quality improvement plan, and other supporting information required to be maintained under this part (such as data used to document the adequacy of monitoring, or records of monitoring maintenance or corrective actions).

b. Instead of paper records, the owner or operator may maintain records on alternative media, such as microfilm, computer files, magnetic tape disks, or microfiche, provided that the use of such alternative media allows for expeditious inspection and review, and does not conflict with other applicable recordkeeping requirements.

[40 CFR 64.9(b)]

40 CFR 64.10 Savings Provisions.

17. It should be noted that nothing in this appendix shall:

a. Excuse the owner or operator of a source from compliance with any existing emission limitation or standard, or any existing monitoring, testing, reporting or recordkeeping requirement that may apply under federal, state, or local law, or any other applicable requirements under the Act. The requirements of this appendix shall not be used to justify the approval of monitoring less stringent than the monitoring which is required under separate legal authority and are not intended to establish minimum requirements for the purpose of determining the monitoring to be imposed under separate authority under the Act, including monitoring in permits issued pursuant to Title I of the Act. The purpose of this part is to require, as part of the issuance of a permit under Title V of the Act, improved or new monitoring at those emissions units where monitoring requirements do not exist or are inadequate to meet the requirements of this part.

b. Restrict or abrogate the authority of the Administrator or the permitting authority to impose additional or more stringent monitoring, recordkeeping, testing, or reporting requirements on any owner or operator of a source under any provision of the Act, including but not limited to sections 114(a)(1) and 504(b), or state law, as applicable.

c. Restrict or abrogate the authority of the Administrator or permitting authority to take any enforcement action under the Act for any violation of an applicable requirement or of any person to take action under section 304 of the Act.

[40 CFR 64.10]

Florida Power and Light Company Port Everglades Plant

Emissions Units 001, 002, 003 and 004

**Fossil Fuel Steam Generators
PM Emissions Controlled By Electro-static Precipitators (ESP)**

Monitoring Approach

TABLE 1: MONITORING APPROACH (This table revised under project No. 0110036-009-AV)

EMISSION UNITS 001 – 004 ESP		
	Indicator No. 1	Indicator No. 2
I. Indicator		Change in duct opacity
Measurement Approach	<p>Power (in Watts)</p> <p>The secondary voltage and secondary milliamps for each transformer-rectifier (TR) set will be read from the meters in place on the ESP, either manually or through remote monitoring.</p> <p>Parameters to Monitor: Performance of the ESP will be measured by the secondary kilovolts and secondary milliamps for each cell of the ESP. The readings from each TR set will be recorded once each day to determine the power to each cell of the ESP.</p> $P_t = V_1I_1 + V_2I_2 + V_3I_3 + V_4I_4 + V_5I_5 + V_6I_6 + V_7I_7 + V_8I_8$ <p>P_t = Total ESP power (watts)</p> <p>V_1 = Secondary voltage (kV), ESP field 1</p> <p>I_1 = Secondary current (ma), ESP field 1</p> <p>V_2 = Secondary voltage (kV), ESP field 2</p> <p>I_2 = Secondary current (ma), ESP field 2</p> <p>V_3 = Secondary voltage (kV), ESP field 3</p> <p>I_3 = Secondary current (ma), ESP field 3</p> <p>V_4 = Secondary voltage (kV), ESP field 4</p> <p>I_4 = Secondary current (ma), ESP field 4</p> <p>V_5 = Secondary voltage (kV), ESP field 5</p> <p>I_5 = Secondary current (ma), ESP field 5</p>	<p>Continuous opacity monitoring system (COMS)</p>

APPENDIX CAM

	<p>V_6 = Secondary voltage (kV), ESP field 6</p> <p>I_6 = Secondary current (ma), ESP field 6</p> <p>V_7 = Secondary voltage (kV), ESP field 7</p> <p>I_7 = Secondary current (ma), ESP field 7</p> <p>V_8 = Secondary voltage (kV), ESP field 8</p> <p>I_8 = Secondary current (ma), ESP field 8</p>	
II. Indicator Range	<p>For Units 001 and 002, an excursion is defined as any hourly average of the ESP <u>secondary</u> power level less than 264 <u>46</u> kilowatts. For Units 003 and 004, an excursion is defined as any hourly average of the ESP <u>secondary</u> power level less than 524 <u>88</u> kilowatts. An excursion will trigger an investigation of the occurrence, corrective actions, and a reporting/documentation requirement.</p>	<p>An excursion is defined as any sudden and sustained step-change (increase) in opacity as documented by the trend of the consecutive 6-minute averages (other than startup and shutdown periods).</p>
III. Performance Criteria		
A. Data Representativeness	<p>ESP secondary voltage and secondary current for fields 1, 2, 3, 4, 5, 6, 7 and 8 are recorded at least four times per hour.</p>	<p>Based on available data under normal operation, opacity varies with load and operating conditions. Variability is typically a gradual increase or decrease, with occasional sudden spikes and dips. A sudden and sustained step-increase in opacity could indicate a failure in one or more of the transformer-rectifiers.</p>
B. Verification of Operational Status	<p>Not Applicable</p>	<p>The COM system is audited quarterly.</p>
C. QA/QC Practices and Criteria	<p>The voltmeter and ammeter will be calibrated and maintained as required by the manufacturer, but no less than annually.</p>	<p>Install and operate COMS according to 40 CFR 60, Appendix B, Performance Specification 1 and general provisions 60.13.</p>
D. Monitoring Frequency	<p>The power will be calculated from secondary kilovolt and milliamp readings to be taken at least four times per hour. The reading will consist of averaging 4 readings approximately 15 minutes apart, over a one hour period</p>	<p>Continuous.</p>

APPENDIX CAM

E. Data Collection Procedures	The secondary kilovolt and milliamp readings will be taken from the voltmeter and ammeter. The values for each cell will be multiplied and then added together to determine the status.	The COMS collects data that are reduced to 6-minute averages. Consecutive 6-minute averages are tracked through the Distributed Control System (DCS) and CEM software.
F. Averaging Period	Four readings, approximately 15 minutes apart, over a one-hour period.	Six Minutes.
G. Operational Requirements	At least six (6) of the eight (8) TR sets installed on each of the four (4) ESP units Units 001 and 002 shall be in service at all times when 100% fuel oil is being fired. <u>At least two (2) of the eight (8) TR sets installed on Units 003 and 004 shall be in service at all times when 100% fuel oil is being fired.</u>	At least six (6) of the eight (8) TR sets installed on each of the four (4) ESP units Units 001 and 002 shall be in service at all times when 100% fuel oil is being fired. <u>At least two (2) of the eight (8) TR sets installed on Units 003 and 004 shall be in service at all times when 100% fuel oil is being fired.</u>

APPENDIX I

LIST OF INSIGNIFICANT EMISSIONS UNITS AND/OR ACTIVITIES

The facilities, emissions units, or pollutant-emitting activities listed in Rule 62-210.300(3)(a), F.A.C., Categorical Exemptions, or that meet the criteria specified in Rule 62-210.300(3)(b)1., F.A.C., Generic Emissions Unit Exemption, are exempt from the permitting requirements of Chapters 62-210, 62-212 and 62-4, F.A.C.; provided, however, that exempt emissions units shall be subject to any applicable emission limiting standards and the emissions from exempt emissions units or activities shall be considered in determining the potential emissions of the facility containing such emissions units. Emissions units and pollutant-emitting activities exempt from permitting under Rules 62-210.300(3)(a) and (b)1., F.A.C., shall not be exempt from the permitting requirements of Chapter 62-213, F.A.C., if they are contained within a Title V source; however, such emissions units and activities shall be considered insignificant for Title V purposes provided they also meet the criteria of Rule 62-213.430(6)(b), F.A.C. No emissions unit shall be entitled to an exemption from permitting under Rules 62-210.300(3)(a) and (b)1., F.A.C., if its emissions, in combination with the emissions of other units and activities at the facility, would cause the facility to emit or have the potential to emit any pollutant in such amount as to make the facility a Title V source.

The below listed emissions units and/or activities are considered insignificant pursuant to Rule 62-213.430(6), F.A.C.

Brief Description of Emissions Units and/or Activities
1. Spent boiler chemical cleaning liquid evaporation.
2. Laboratory equipment used exclusively for chemical or physical analysis.
3. Brazing, soldering, or welding equipment.
4. Surface coating facilities provided that 6.0 gallons of coatings per day or less are applied.
5. Hydrazine feed line vent.
6. Lube oil system.
7. Oil/water separators and related equipment.
8. Misc. mobile vehicle operation.
9. Paint & lube oil building.
10. Chemical storage building.
11. Hazardous waste storage area.
12. Natural gas metering station.
13. Internal combustion engine.
14. Fire and safety equipment.

APPENDIX O

ORDER GRANTING PETITION FOR REDUCED FREQUENCY OF PARTICULATE TESTING

00093

STATE OF FLORIDA
DEPARTMENT OF ENVIRONMENTAL REGULATION

In the Matter of:)
 Petition for Reduction in Quarterly) OGC Case Nos.: 83-0578
 Particulate Emissions Compliance) 83-0577, 83-0576,
 Testing;) 83-0585, 83-0586,
 FLORIDA POWER AND LIGHT COMPANY.) 83-0587, 83-0588,
 Petitioner.) 83-0581, 83-0580

ORDER GRANTING PETITION FOR REDUCED FREQUENCY OF PARTICULATE TESTING

On September 16, 1983, the Petitioner, FLORIDA POWER AND LIGHT COMPANY, filed a Petition for Reduction in Quarterly Particulate Emissions Compliance Testing pursuant to Florida Administrative Code Rule 17-2.600(5)(b)1 for the following fossil fuel steam generating units:

- Port Everglades Plant Unit No. 2
- Port Everglades Plant Unit No. 3
- Port Everglades Plant Unit No. 4
- Turkey Point Plant Unit No. 1
- Turkey Point Plant Unit No. 2
- Riveria Plant Unit No. 3
- Riveria Plant Unit No. 4
- Manatee Plant Unit No. 1
- Manatee Plant Unit No. 2

Each of the units has a heat input exceeding 250 million Btu per hour.

The petition and supporting documentation submitted by the Petitioner indicate that between August 1979 and July 21, 1983, these units were afforded relief from the particulate standard contained in Florida Administrative Code Rule 17-2.600(5)(b)2 under the terms of a Department-issued variance. During the same period of time the Company elected to test quarterly as permitted under Rule 17-2.600(5)(b)1. Despite the existence of the variance, the tests results submitted during the last two years reveal that each of the above-listed units met the particulate emissions limitations contained in Rule 17-2.600(5)(b)1 of 0.1 pounds per million Btu heat input.


Florida Administrative Code Rule 17-2.600(5)(b)1 specifically provides that I may reduce the frequency of particulate testing

Positive brand fax transmittal memo 7/2/83 page 3

To: Scott Shoyak	From: RICH PIPER
Cc:	Cc:
Dept:	Project:
Date:	Fax:

APPENDIX O

ORDER GRANTING PETITION FOR REDUCED FREQUENCY OF PARTICULATE TESTING



00094

upon a demonstration that the particulate standard has been regularly met. The particulate standard referred to is the general standard found in the rule--0.1 parts per million by heat input--not a relaxed emission limit established by a variance.

The intent of Rule 17-2.600(5)(b)1 is to ensure that before the frequency of particulate testing is reduced, the source has established a record of complying with the requirements of Florida Administrative Code Chapter 17-2 relating to particulate matter emissions. Petitioner has documented that each of these units has a history of regularly complying with the particulate matter standard applicable to them.

IT IS ORDERED that the present petition is GRANTED. Under the terms of Rule 17-2.600(5)(b)1, Petitioner may reduce the frequency of particulate testing to an annual basis for each of the units named in this Order. If, however, any of the units fails to comply with the applicable particulate or visible emission standard, this Order will terminate upon written notice by the Department.

The Petitioner may request a hearing in accordance with Section 120.57, Florida Statutes, and Florida Administrative Code Chapters 17-1 and 28-5. The request for hearing must be filed (received) in the Office of General Counsel of the Department, 2600 Blair Stone Road, Twin Towers Office Building, Tallahassee, Florida 32301, within (14) days of receipt of this Order. Failure to file a request for hearing within this time shall constitute a waiver of Petitioner's right to request a hearing under Section 120.57, Florida Statutes.


DONE and ORDERED this 24 day of April, 1984.

RETURN AND ACKNOWLEDGEMENT
 FEE on this form equivalent to \$120.52 (7).
 Florida Statute, with the designated Departmental Clerk, receipt of which is hereby acknowledged.

Victor J. Schenkel 4/24/84
 Clerk Date

Victoria J. Schenkel
 VICTORIA J. SCHENKEL
 Secretary

STATE OF FLORIDA DEPARTMENT
 OF ENVIRONMENTAL REGULATION
 2600 Blair Stone Road
 Tallahassee, Florida 32301
 (904)488-4805

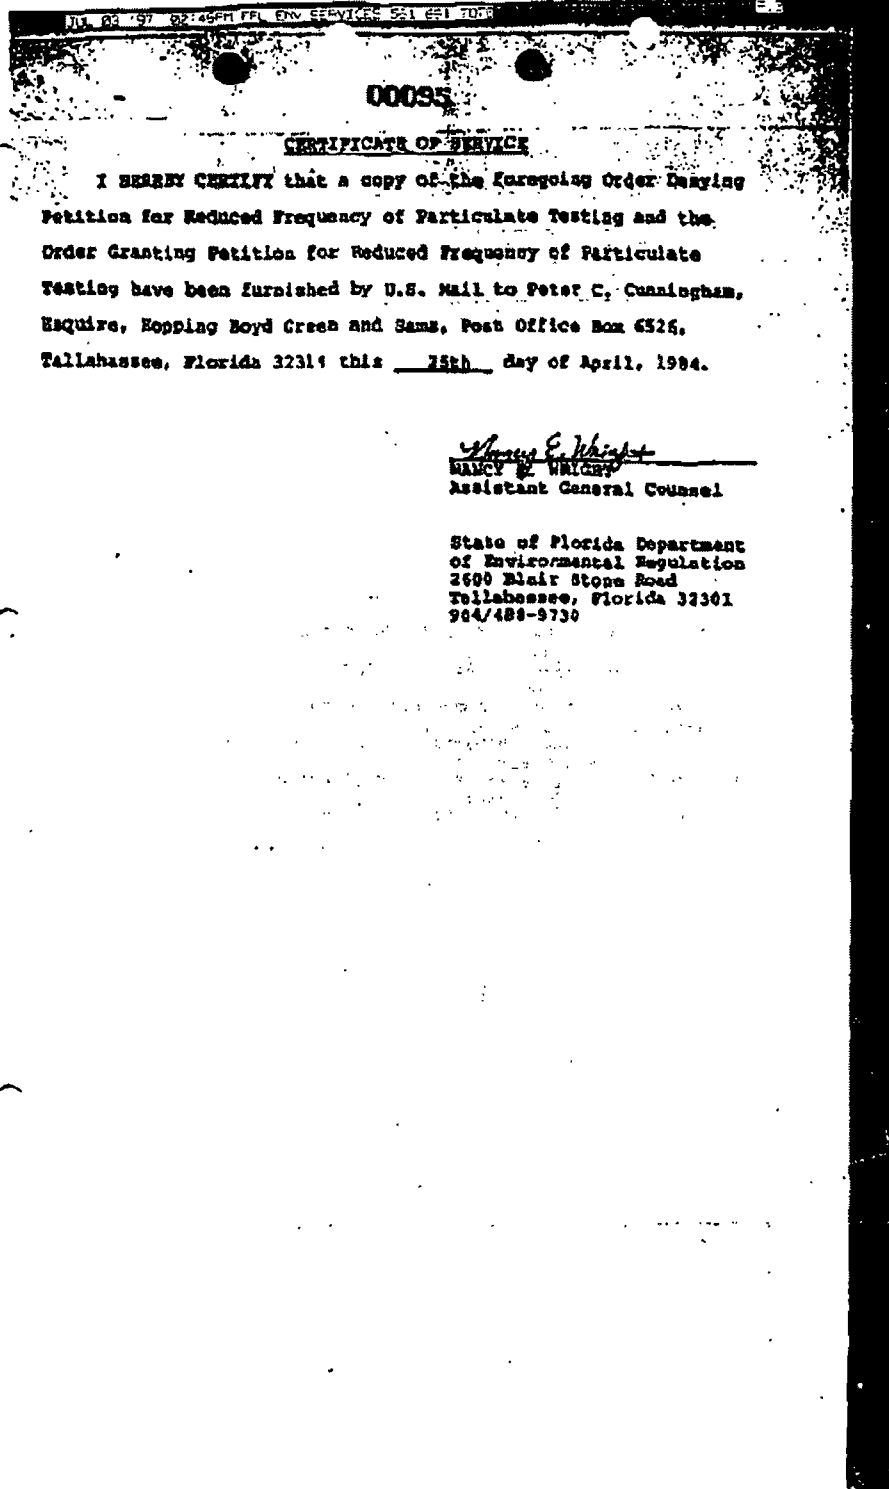

APPENDIX RR

FACILITY-WIDE REPORTING REQUIREMENTS

RR1. Reporting Schedule. This table summarizes information for convenience purposes only. It does not supersede any of the terms or conditions of this permit.

Report	Reporting Deadline(s)	Related Condition(s)
Plant Problems/Permit Deviations	Immediately upon occurrence (See RR2.d.)	RR2, RR3
Semi-Annual Monitoring Report	Every 6 months	RR4
Annual Operating Report	April 1	RR5
Annual Emissions Fee Form and Fee	March 1	RR6
Annual Statement of Compliance	Within 60 days after the end of each calendar year (or more frequently if specified by Rule 62-213.440(2), F.A.C., or by any other applicable requirement); and Within 60 days after submittal of a written agreement for transfer of responsibility, or Within 60 days after permanent shutdown.	RR7
Notification of Administrative Permit Corrections	As needed	RR8
Notification of Startup after Shutdown for More than One Year	Minimum of 60 days prior to the intended startup date or, if emergency startup, as soon as possible after the startup date is ascertained	RR9
Permit Renewal Application	225 days prior to the expiration date of permit	TV17
Test Reports	Maximum 45 days following compliance tests	TR8

{Permitting Note: See permit Section III. Emissions Units and Specific Conditions, for any additional Emission Unit-specific reporting requirements.}

RR2. Reports of Problems.

- a. Plant Operation-Problems. If the permittee is temporarily unable to comply with any of the conditions of the permit due to breakdown of equipment or destruction by hazard of fire, wind or by other cause, the permittee shall immediately notify the Department. Notification shall include pertinent information as to the cause of the problem, and what steps are being taken to correct the problem and to prevent its recurrence, and where applicable, the owner's intent toward reconstruction of destroyed facilities. Such notification does not release the permittee from any liability for failure to comply with Department rules.
- b. If, for any reason, the permittee does not comply with or will be unable to comply with any condition or limitation specified in this permit, the permittee shall immediately provide the Department with the following information:
 - (1) A description of and cause of noncompliance; and
 - (2) The period of noncompliance, including dates and times; or, if not corrected, the anticipated time the noncompliance is expected to continue, and steps being taken to reduce, eliminate, and prevent recurrence of the noncompliance. The permittee shall be responsible for any and all damages which may result and may be subject to enforcement action by the Department for penalties or for revocation of this permit.
- c. When requested by the Department, the permittee shall within a reasonable time furnish any information required by law which is needed to determine compliance with the permit. If the permittee becomes aware the relevant facts were not submitted or were incorrect in the permit application or in any report to the Department, such facts or information shall be corrected promptly.

APPENDIX RR

FACILITY-WIDE REPORTING REQUIREMENTS

- d. "Immediately" shall mean the same day, if during a workday (i.e., 8:00 a.m. - 5:00 p.m.), or the first business day after the incident, excluding weekends and holidays; and, for purposes of Rule 62-4.160(15) and 40 CFR 70.6(a)(3)(iii)(B), "promptly" or "prompt" shall have the same meaning as "immediately". [Rule 62-4.130, Rule 62-4.160(8), Rule 62-4.160(15), and Rule 62-213.440(1)(b), F.A.C.; 40 CFR 70.6(a)(3)(iii)(B)]

RR3. Reports of Deviations from Permit Requirements. The permittee shall report in accordance with the requirements of Rule 62-210.700(6), F.A.C. (below), and Rule 62-4.130, F.A.C. (condition RR2.), deviations from permit requirements, including those attributable to upset conditions as defined in the permit. Reports shall include the probable cause of such deviations, and any corrective actions or preventive measures taken.
Rule 62-210.700(6): In case of excess emissions resulting from malfunctions, each owner or operator shall notify the Department or the appropriate Local Program in accordance with Rule 62-4.130, F.A.C. (See condition RR2.). A full written report on the malfunctions shall be submitted in a quarterly report, if requested by the Department.
[Rules 62-213.440(1)(b)3.b., and 62-210.700(6)F.A.C.]

RR4. Semi-Annual Monitoring Reports. The permittee shall submit reports of any required monitoring at least every six (6) months. All instances of deviations from permit requirements must be clearly identified in such reports. [Rule 62-213.440(1)(b)3.a., F.A.C.]

RR5. Annual Operating Report.

- a. The permittee shall submit to the Compliance Authority, each calendar year, on or before April 1, a completed DEP Form No 62-210.900(5), "Annual Operating Report for Air Pollutant Emitting Facility", for the preceding calendar year.
- b. Emissions shall be computed in accordance with the provisions of Rule 62-210.370(2), F.A.C.
[Rules 62-210.370(2) & (3), and 62-213.440(3)2., F.A.C.]

RR6. Annual Emissions Fee Form and Fee. Each Title V source permitted to operate in Florida must pay between January 15 and March 1 of each year, an annual emissions fee in an amount determined as set forth in Rule 62-213.205(1), F.A.C.

- a. If the Department has not received the fee by February 15 of the year following the calendar year for which the fee is calculated, the Department will send the primary responsible official of the Title V source a written warning of the consequences for failing to pay the fee by March 1. If the fee is not postmarked by March 1 of the year due, the Department shall impose, in addition to the fee, a penalty of 50 percent of the amount of the fee unpaid plus interest on such amount computed in accordance with Section 220.807, F.S. If the Department determines that a submitted fee was inaccurately calculated, the Department shall either refund to the permittee any amount overpaid or notify the permittee of any amount underpaid. The Department shall not impose a penalty or interest on any amount underpaid, provided that the permittee has timely remitted payment of at least 90 percent of the amount determined to be due and remits full payment within 60 days after receipt of notice of the amount underpaid. The Department shall waive the collection of underpayment and shall not refund overpayment of the fee, if the amount is less than 1 percent of the fee due, up to \$50.00. The Department shall make every effort to provide a timely assessment of the adequacy of the submitted fee. Failure to pay timely any required annual emissions fee, penalty, or interest constitutes grounds for permit revocation pursuant to Rule 62-4.100, F.A.C.
- b. Any documentation of actual hours of operation, actual material or heat input, actual production amount, or actual emissions used to calculate the annual emissions fee shall be retained by the owner for a minimum of five (5) years and shall be made available to the Department upon request.
- c. A completed DEP Form 62-213.900(1), "Major Air Pollution Source Annual Emissions Fee Form", must be submitted by a responsible official with the annual emissions fee.

[Rules 62-213.205(1), (1)(g), (1)(i) & (1)(j), F.A.C.]

RR7. Annual Statement of Compliance.

APPENDIX RR
FACILITY-WIDE REPORTING REQUIREMENTS

- a. The permittee shall submit a Statement of Compliance with all terms and conditions of the permit that includes all the provisions of 40 CFR 70.6(c)(5)(iii), incorporated by reference at Rule 62-204.800, F.A.C., using DEP Form No. 62-213.900(7). Such statement shall be accompanied by a certification in accordance with Rule 62-213.420(4), F.A.C., for Title V requirements and with Rule 62-214.350, F.A.C., for Acid Rain requirements. Such statements shall be submitted (postmarked) to the Department and EPA:
 - (1) Annually, within 60 days after the end of each calendar year during which the Title V permit was effective, or more frequently if specified by Rule 62-213.440(2), F.A.C., or by any other applicable requirement; and
 - (2) Within 60 days after submittal of a written agreement for transfer of responsibility as required pursuant to 40 CFR 70.7(d)(1)(iv), adopted and incorporated by reference at Rule 62-204.800, F.A.C., or within 60 days after permanent shutdown of a facility permitted under Chapter 62-213, F.A.C.; provided that, in either such case, the reporting period shall be the portion of the calendar year the permit was effective up to the date of transfer of responsibility or permanent facility shutdown, as applicable.
- b. In lieu of individually identifying all applicable requirements and specifying times of compliance with, non-compliance with, and deviation from each, the responsible official may use DEP Form No. 62-213.900(7) as such statement of compliance so long as the responsible official identifies all reportable deviations from and all instances of non-compliance with any applicable requirements and includes all information required by the federal regulation relating to each reportable deviation and instance of non-compliance.
- c. The responsible official may treat compliance with all other applicable requirements as a surrogate for compliance with Rule 62-296.320(2), Objectionable Odor Prohibited.
[Rules 62-213.440(3)(a)2. & 3. and (b), F.A.C.]

RR8. Notification of Administrative Permit Corrections.

- a. A facility owner shall notify the Department by letter of minor corrections to information contained in a permit. Such notifications shall include:
 - (1) Typographical errors noted in the permit;
 - (2) Name, address or phone number change from that in the permit;
 - (3) A change requiring more frequent monitoring or reporting by the permittee;
 - (4) A change in ownership or operational control of a facility, subject to the following provisions:
 - (a) The Department determines that no other change in the permit is necessary;
 - (b) The permittee and proposed new permittee have submitted an Application for Transfer of Air Permit, and the Department has approved the transfer pursuant to Rule 62-210.300(7), F.A.C.; and
 - (c) The new permittee has notified the Department of the effective date of sale or legal transfer.
 - (5) Changes listed at 40 CFR 72.83(a)(1), (2), (6), (9) and (10), adopted and incorporated by reference at Rule 62-204.800, F.A.C., and changes made pursuant to Rules 62-214.340(1) and (2), F.A.C., to Title V sources subject to emissions limitations or reductions pursuant to 42 USC ss. 7651-7651o;
 - (6) Changes listed at 40 CFR 72.83(a)(11) and (12), adopted and incorporated by reference at Rule 62-204.800, F.A.C., to Title V sources subject to emissions limitations or reductions pursuant to 42 USC ss. 7651-7651o, provided the notification is accompanied by a copy of any EPA determination concerning the similarity of the change to those listed at Rule 62-210.360(1)(e), F.A.C.; and
 - (7) Any other similar minor administrative change at the source.
- b. Upon receipt of any such notification, the Department shall within 60 days correct the permit and provide a corrected copy to the owner.
- c. After first notifying the owner, the Department shall correct any permit in which it discovers errors of the types listed at Rules 62-210.360(1)(a) and (b), F.A.C., and provide a corrected copy to the owner.

APPENDIX RR
FACILITY-WIDE REPORTING REQUIREMENTS

- d. For Title V source permits, other than general permits, a copy of the corrected permit shall be provided to EPA and any approved local air program in the county where the facility or any part of the facility is located.

[Rule 62-210.360, F.A.C.]

RR9. Notification of Startup. The owners or operator of any emissions unit or facility which has a valid air operation permit which has been shut down more than one year, shall notify the Department in writing of the intent to start up such emissions unit or facility, a minimum of 60 days prior to the intended startup date.

- a. The notification shall include information as to the startup date, anticipated emission rates or pollutants released, changes to processes or control devices which will result in changes to emission rates, and any other conditions which may differ from the valid outstanding operation permit.
- b. If, due to an emergency, a startup date is not known 60 days prior thereto, the owner shall notify the Department as soon as possible after the date of such startup is ascertained.

[Rule 62-210.300(5), F.A.C.]

RR10. Report Submission. The permittee shall submit all compliance related notifications and reports required of this permit to the Compliance Authority. {See front of permit for address and phone number.}

RR11. EPA Report Submission. Any reports, data, notifications, certifications, and requests required to be sent to the United States Environmental Protection Agency, Region 4, should be sent to: Air, Pesticides & Toxics Management Division, United States Environmental Protection Agency, Region 4, Sam Nunn Atlanta Federal Center, 61 Forsyth Street SW, Atlanta, GA 30303-8960. Phone: 404/562-9077.

RR12. Acid Rain Report Submission. Acid Rain Program Information shall be submitted, as necessary, to: Department of Environmental Protection, 2600 Blair Stone Road, Mail Station #5510, Tallahassee, Florida 32399-2400. Phone: 850/488-6140. Fax: 850/922-6979.

RR13. Report Certification. All reports shall be accompanied by a certification by a responsible official, pursuant to Rule 62-213.420(4), F.A.C. [Rule 62-213.440(1)(b)3.c, F.A.C.]

RR14. Certification by Responsible Official (RO). In addition to the professional engineering certification required for applications by Rule 62-4.050(3), F.A.C., any application form, report, compliance statement, compliance plan and compliance schedule submitted pursuant to Chapter 62-213, F.A.C., shall contain a certification signed by a responsible official that, based on information and belief formed after reasonable inquiry, the statements and information in the document are true, accurate, and complete. Any responsible official who fails to submit any required information or who has submitted incorrect information shall, upon becoming aware of such failure or incorrect submittal, promptly submit such supplementary information or correct information. [Rule 62-213.420(4), F.A.C.]

RR15. Confidential Information. Whenever an applicant submits information under a claim of confidentiality pursuant to Section 403.111, F.S., the applicant shall also submit a copy of all such information and claim directly to EPA. Any permittee may claim confidentiality of any data or other information by complying with this procedure. [Rules 62-213.420(2), and 62-213.440(1)(d)6., F.A.C.]

RR16. Forms and Instructions. The forms used by the Department in the Title V source operation program are adopted and incorporated by reference in Rule 62-213.900, F.A.C. The forms are listed by rule number, which is also the form number, and with the subject, title, and effective date. Copies of forms may be obtained by writing to the Department of Environmental Protection, Division of Air Resource Management, 2600 Blair Stone Road, Tallahassee, Florida 32399-2400, by contacting the appropriate permitting authority or by accessing the Department's web site at:
<http://www.dep.state.fl.us/air/rules/forms.htm>.

- a. Major Air Pollution Source Annual Emissions Fee Form (Effective 01/03/2001).
- b. Statement of Compliance Form (Effective 06/02/2002).
- c. Responsible Official Notification Form (Effective 06/02/2002).

APPENDIX RR

FACILITY-WIDE REPORTING REQUIREMENTS

[Rule 62-213.900, F.A.C.: Forms (1), (7) and (8)]

APPENDIX TR
FACILITY-WIDE TESTING REQUIREMENTS

Unless otherwise specified in the permit, the following testing requirements apply to each emissions unit for which testing is required. The terms “stack” and “duct” are used interchangeably in this appendix.

- TR1.** Required Number of Test Runs. For mass emission limitations, a compliance test shall consist of three complete and separate determinations of the total air pollutant emission rate through the test section of the stack or duct and three complete and separate determinations of any applicable process variables corresponding to the three distinct time periods during which the stack emission rate was measured; provided, however, that three complete and separate determinations shall not be required if the process variables are not subject to variation during a compliance test, or if three determinations are not necessary in order to calculate the unit's emission rate. The three required test runs shall be completed within one consecutive five-day period. In the event that a sample is lost or one of the three runs must be discontinued because of circumstances beyond the control of the owner or operator, and a valid third run cannot be obtained within the five-day period allowed for the test, the Secretary or his or her designee may accept the results of two complete runs as proof of compliance, provided that the arithmetic mean of the two complete runs is at least 20% below the allowable emission limiting standard. [Rule 62-297.310(1), F.A.C.]
- TR2.** Operating Rate During Testing. Testing of emissions shall be conducted with the emissions unit operating at permitted capacity. If it is impractical to test at permitted capacity, an emissions unit may be tested at less than the maximum permitted capacity; in this case, subsequent emissions unit operation is limited to 110 percent of the test rate until a new test is conducted. Once the unit is so limited, operation at higher capacities is allowed for no more than 15 consecutive days for the purpose of additional compliance testing to regain the authority to operate at the permitted capacity. Permitted capacity is defined as 90 to 100 percent of the maximum operation rate allowed by the permit. [Rule 62-297.310(2), F.A.C.]
- TR3.** Calculation of Emission Rate. For each emissions performance test, the indicated emission rate or concentration shall be the arithmetic average of the emission rate or concentration determined by each of the three separate test runs unless otherwise specified in a particular test method or applicable rule. [Rule 62-297.310(3), F.A.C.]
- TR4.** Applicable Test Procedures.
- a. Required Sampling Time.
- (1) Unless otherwise specified in the applicable rule, the required sampling time for each test run shall be no less than one hour and no greater than four hours, and the sampling time at each sampling point shall be of equal intervals of at least two minutes.
 - (2) Opacity Compliance Tests. When either EPA Method 9 or DEP Method 9 is specified as the applicable opacity test method, the required minimum period of observation for a compliance test shall be sixty (60) minutes for emissions units which emit or have the potential to emit 100 tons per year or more of particulate matter, and thirty (30) minutes for emissions units which have potential emissions less than 100 tons per year of particulate matter and are not subject to a multiple-valued opacity standard. The opacity test observation period shall include the period during which the highest opacity emissions can reasonably be expected to occur. Exceptions to these requirements are as follows:
 - (a) For batch, cyclical processes, or other operations which are normally completed within less than the minimum observation period and do not recur within that time, the period of observation shall be equal to the duration of the batch cycle or operation completion time.
 - (b) The observation period for special opacity tests that are conducted to provide data to establish a surrogate standard pursuant to Rule 62-297.310(5)(k), F.A.C., Waiver of Compliance Test Requirements, shall be established as necessary to properly establish the relationship between a proposed surrogate standard and an existing mass emission limiting standard.
 - (c) The minimum observation period for opacity tests conducted by employees or agents of the

APPENDIX TR
FACILITY-WIDE TESTING REQUIREMENTS

Department to verify the day-to-day continuing compliance of a unit or activity with an applicable opacity standard shall be twelve minutes.

- b. *Minimum Sample Volume.* Unless otherwise specified in the applicable rule or test method, the minimum sample volume per run shall be 25 dry standard cubic feet.
- c. *Required Flow Rate Range.* For EPA Method 5 particulate sampling, acid mist/sulfur dioxide, and fluoride sampling which uses Greenburg Smith type impingers, the sampling nozzle and sampling time shall be selected such that the average sampling rate will be between 0.5 and 1.0 actual cubic feet per minute, and the required minimum sampling volume will be obtained.
- d. *Calibration of Sampling Equipment.* Calibration of the sampling train equipment shall be conducted in accordance with the schedule shown in Table 297.310-1, F.A.C.

TABLE 297.310-1 CALIBRATION SCHEDULE			
ITEM	MINIMUM CALIBRATION FREQUENCY	REFERENCE INSTRUMENT	TOLERANCE
Liquid in glass thermometer	Annually	ASTM Hg in glass ref. thermometer or equivalent or thermometric points	+/-2%
Bimetallic thermometer	Quarterly	Calib: liq. in glass	5° F
Thermocouple	Annually	ASTM Hg in glass ref. thermometer, NBS calibrated reference and potentiometer	5° F
Barometer	Monthly	Hg barometer or NOAA station	+/-1% scale
Pitot Tube	When required or when damaged	By construction or measurements in wind tunnel D greater than 16" and standard pitot tube	See EPA Method 2, Fig. 2-2 & 2-3
Probe Nozzles	Before each test or when nicked, dented, or corroded	Micrometer	+/- 0.001" mean of at least three readings; Max. deviation between readings, 0.004"
Dry Gas Meter and Orifice Meter	1. Full Scale: When received, when 5% change observed, annually	Spirometer or calibrated wet test or dry gas test meter	2%
	2. One Point: Semiannually		
	3. Check after each test series	Comparison check	5%

- e. *Allowed Modification to EPA Method 5.* When EPA Method 5 is required, the following modification is allowed: the heated filter may be separated from the impingers by a flexible tube.

[Rule 62-297.310(4), F.A.C.]

APPENDIX TR
FACILITY-WIDE TESTING REQUIREMENTS

TR5. Determination of Process Variables.

- a. *Required Equipment.* The owner or operator of an emissions unit for which compliance tests are required shall install, operate, and maintain equipment or instruments necessary to determine process variables, such as process weight input or heat input, when such data are needed in conjunction with emissions data to determine the compliance of the emissions unit with applicable emission limiting standards.
- b. *Accuracy of Equipment.* Equipment or instruments used to directly or indirectly determine process variables, including devices such as belt scales, weight hoppers, flow meters, and tank scales, shall be calibrated and adjusted to indicate the true value of the parameter being measured with sufficient accuracy to allow the applicable process variable to be determined within 10% of its true value.

[Rule 62-297.310(5), F.A.C.]

TR6. Sampling Facilities. The permittee shall install permanent stack sampling ports and provide sampling facilities that meet the requirements of Rule 62-297.310(6), F.A.C. Sampling facilities include sampling ports, work platforms, access to work platforms, electrical power, and sampling equipment support. All stack sampling facilities must also comply with all applicable Occupational Safety and Health Administration (OSHA) Safety and Health Standards described in 29 CFR Part 1910, Subparts D and E.

- a. *Permanent Test Facilities.* The owner or operator of an emissions unit for which a compliance test, other than a visible emissions test, is required on at least an annual basis, shall install and maintain permanent stack sampling facilities.
- b. *Temporary Test Facilities.* The owner or operator of an emissions unit that is not required to conduct a compliance test on at least an annual basis may use permanent or temporary stack sampling facilities. If the owner chooses to use temporary sampling facilities on an emissions unit, and the Department elects to test the unit, such temporary facilities shall be installed on the emissions unit within 5 days of a request by the Department and remain on the emissions unit until the test is completed.
- c. *Sampling Ports.*
 - (1) All sampling ports shall have a minimum inside diameter of 3 inches.
 - (2) The ports shall be capable of being sealed when not in use.
 - (3) The sampling ports shall be located in the stack at least 2 stack diameters or equivalent diameters downstream and at least 0.5 stack diameter or equivalent diameter upstream from any fan, bend, constriction or other flow disturbance.
 - (4) For emissions units for which a complete application to construct has been filed prior to December 1, 1980, at least two sampling ports, 90 degrees apart, shall be installed at each sampling location on all circular stacks that have an outside diameter of 15 feet or less. For stacks with a larger diameter, four sampling ports, each 90 degrees apart, shall be installed. For emissions units for which a complete application to construct is filed on or after December 1, 1980, at least two sampling ports, 90 degrees apart, shall be installed at each sampling location on all circular stacks that have an outside diameter of 10 feet or less. For stacks with larger diameters, four sampling ports, each 90 degrees apart, shall be installed. On horizontal circular ducts, the ports shall be located so that the probe can enter the stack vertically, horizontally or at a 45 degree angle.
 - (5) On rectangular ducts, the cross sectional area shall be divided into the number of equal areas in accordance with EPA Method 1. Sampling ports shall be provided which allow access to each sampling point. The ports shall be located so that the probe can be inserted perpendicular to the gas flow.
- d. *Work Platforms.*
 - (1) Minimum size of the working platform shall be 24 square feet in area. Platforms shall be at least 3 feet wide.
 - (2) On circular stacks with 2 sampling ports, the platform shall extend at least 110 degrees around the stack.
 - (3) On circular stacks with more than two sampling ports, the work platform shall extend 360 degrees around the stack.

APPENDIX TR
FACILITY-WIDE TESTING REQUIREMENTS

- (4) All platforms shall be equipped with an adequate safety rail (ropes are not acceptable), toe board, and hinged floor-opening cover if ladder access is used to reach the platform. The safety rail directly in line with the sampling ports shall be removable so that no obstruction exists in an area 14 inches below each sample port and 6 inches on either side of the sampling port.
- e. *Access to Work Platform.*
- (1) Ladders to the work platform exceeding 15 feet in length shall have safety cages or fall arresters with a minimum of 3 compatible safety belts available for use by sampling personnel.
- (2) Walkways over free-fall areas shall be equipped with safety rails and toe boards.
- f. *Electrical Power.*
- (1) A minimum of two 120-volt AC, 20-amp outlets shall be provided at the sampling platform within 20 feet of each sampling port.
- (2) If extension cords are used to provide the electrical power, they shall be kept on the plant's property and be available immediately upon request by sampling personnel.
- g. *Sampling Equipment Support.*
- (1) A three-quarter inch eyebolt and an angle bracket shall be attached directly above each port on vertical stacks and above each row of sampling ports on the sides of horizontal ducts.
- (a) The bracket shall be a standard 3 inch × 3 inch × one-quarter inch equal-legs bracket which is 1 and one-half inches wide. A hole that is one-half inch in diameter shall be drilled through the exact center of the horizontal portion of the bracket. The horizontal portion of the bracket shall be located 14 inches above the centerline of the sampling port.
- (b) A three-eighth inch bolt which protrudes 2 inches from the stack may be substituted for the required bracket. The bolt shall be located 15 and one-half inches above the centerline of the sampling port.
- (c) The three-quarter inch eyebolt shall be capable of supporting a 500 pound working load. For stacks that are less than 12 feet in diameter, the eyebolt shall be located 48 inches above the horizontal portion of the angle bracket. For stacks that are greater than or equal to 12 feet in diameter, the eyebolt shall be located 60 inches above the horizontal portion of the angle bracket. If the eyebolt is more than 120 inches above the platform, a length of chain shall be attached to it to bring the free end of the chain to within safe reach from the platform.
- (2) A complete monorail or dual rail arrangement may be substituted for the eyebolt and bracket.
- (3) When the sample ports are located in the top of a horizontal duct, a frame shall be provided above the port to allow the sample probe to be secured during the test.

[Rule 62-297.310(6), F.A.C.]

TR7. Special Compliance Tests. When the Department, after investigation, has good reason (such as complaints, increased visible emissions or questionable maintenance of control equipment) to believe that any applicable emission standard contained in a Department rule or in a permit issued pursuant to those rules is being violated, it shall require the owner or operator of the emissions unit to conduct compliance tests which identify the nature and quantity of pollutant emissions from the emissions unit and to provide a report on the results of said tests to the Department. [Rule 62-297.310(7)(b), F.A.C.]

TR8. Waiver of Compliance Test Requirements. If the owner or operator of an emissions unit that is subject to a compliance test requirement demonstrates to the Department, pursuant to the procedure established in Rule 62-297.620, F.A.C., that the compliance of the emissions unit with an applicable weight emission limiting standard can be adequately determined by means other than the designated test procedure, such as specifying a surrogate standard of no visible emissions for particulate matter sources equipped with a bag house or specifying a fuel analysis for sulfur dioxide emissions, the Department shall waive the compliance test requirements for such emissions units and order that the alternate means of determining compliance be used, provided, however, the provisions of paragraph 62-297.310(7)(b), F.A.C., shall apply.

[Rule 62-297.310(7)(c), F.A.C.]

APPENDIX TR
FACILITY-WIDE TESTING REQUIREMENTS

TR9. Test Reports.

- a. The owner or operator of an emissions unit for which a compliance test is required shall file a report with the Department on the results of each such test.
- b. The required test report shall be filed with the Department as soon as practical but no later than 45 days after the last sampling run of each test is completed.
- c. The test report shall provide sufficient detail on the emissions unit tested and the test procedures used to allow the Department to determine if the test was properly conducted and the test results properly computed. As a minimum, the test report, other than for an EPA or DEP Method 9 test, shall provide the following information.
 - (1) The type, location, and designation of the emissions unit tested.
 - (2) The facility at which the emissions unit is located.
 - (3) The owner or operator of the emissions unit.
 - (4) The normal type and amount of fuels used and materials processed, and the types and amounts of fuels used and material processed during each test run.
 - (5) The means, raw data and computations used to determine the amount of fuels used and materials processed, if necessary to determine compliance with an applicable emission limiting standard.
 - (6) The type of air pollution control devices installed on the emissions unit, their general condition, their normal operating parameters (pressure drops, total operating current and GPM scrubber water), and their operating parameters during each test run.
 - (7) A sketch of the duct within 8 stack diameters upstream and 2 stack diameters downstream of the sampling ports, including the distance to any upstream and downstream bends or other flow disturbances.
 - (8) The date, starting time and duration of each sampling run.
 - (9) The test procedures used, including any alternative procedures authorized pursuant to Rule 62-297.620, F.A.C. Where optional procedures are authorized in this chapter, indicate which option was used.
 - (10) The number of points sampled and configuration and location of the sampling plane.
 - (11) For each sampling point for each run, the dry gas meter reading, velocity head, pressure drop across the stack, temperatures, average meter temperatures and sample time per point.
 - (12) The type, manufacturer and configuration of the sampling equipment used.
 - (13) Data related to the required calibration of the test equipment.
 - (14) Data on the identification, processing and weights of all filters used.
 - (15) Data on the types and amounts of any chemical solutions used.
 - (16) Data on the amount of pollutant collected from each sampling probe, the filters, and the impingers, are reported separately for the compliance test.
 - (17) The names of individuals who furnished the process variable data, conducted the test, analyzed the samples and prepared the report.
 - (18) All measured and calculated data required to be determined by each applicable test procedure for each run.
 - (19) The detailed calculations for one run that relate the collected data to the calculated emission rate.
 - (20) The applicable emission standard and the resulting maximum allowable emission rate for the emissions unit plus the test result in the same form and unit of measure.
 - (21) A certification that, to the knowledge of the owner or his authorized agent, all data submitted are true and correct. When a compliance test is conducted for the Department or its agent, the person who conducts the test shall provide the certification with respect to the test procedures used. The owner or his authorized agent shall certify that all data required and provided to the person conducting the test are true and correct to his knowledge.

[Rule 62-297.310(8), F.A.C.]

APPENDIX TV

TITLE V GENERAL CONDITIONS

(Version dated 9/12/2008)

Operation

- TV1. General Prohibition.** A permitted installation may only be operated, maintained, constructed, expanded or modified in a manner that is consistent with the terms of the permit. [Rule 62-4.030, Florida Administrative Code (F.A.C.)]
- TV2. Validity.** This permit is valid only for the specific processes and operations applied for and indicated in the approved drawings or exhibits. Any unauthorized deviation from the approved drawings, exhibits, specifications, or conditions of this permit may constitute grounds for revocation and enforcement action by the Department. [Rule 62-4.160(2), F.A.C.]
- TV3. Proper Operation and Maintenance.** The permittee shall properly operate and maintain the facility and systems of treatment and control (and related appurtenances) that are installed and used by the permittee to achieve compliance with the conditions of this permit, as required by Department rules. This provision includes the operation of backup or auxiliary facilities or similar systems when necessary to achieve compliance with the conditions of the permit and when required by Department rules. [Rule 62-4.160(6), F.A.C.]
- TV4. Not Federally Enforceable. Health, Safety and Welfare.** To ensure protection of public health, safety, and welfare, any construction, modification, or operation of an installation which may be a source of pollution, shall be in accordance with sound professional engineering practices pursuant to Chapter 471, F.S. [Rule 62-4.050(3), F.A.C.]
- TV5. Continued Operation.** An applicant making timely and complete application for permit, or for permit renewal, shall continue to operate the source under the authority and provisions of any existing valid permit or Florida Electrical Power Plant Siting Certification, and in accordance with applicable requirements of the Acid Rain Program, applicable requirements of the CAIR Program, and applicable requirements of the Hg Budget Trading Program, until the conclusion of proceedings associated with its permit application or until the new permit becomes effective, whichever is later, provided the applicant complies with all the provisions of subparagraphs 62-213.420(1)(b)3., F.A.C. [Rules 62-213.420(1)(b)2., F.A.C.]
- TV6. Changes Without Permit Revision.** Title V sources having a valid permit issued pursuant to Chapter 62-213, F.A.C., may make the following changes without permit revision, provided that sources shall maintain source logs or records to verify periods of operation:
- a. Permitted sources may change among those alternative methods of operation;
 - b. A permitted source may implement operating changes, as defined in Rule 62-210.200, F.A.C., after the source submits any forms required by any applicable requirement and provides the Department and EPA with at least 7 days written notice prior to implementation. The source and the Department shall attach each notice to the relevant permit;
 - (1) The written notice shall include the date on which the change will occur, and a description of the change within the permitted source, the pollutants emitted and any change in emissions, and any term or condition becoming applicable or no longer applicable as a result of the change;
 - (2) The permit shield described in Rule 62-213.460, F.A.C., shall not apply to such changes;
 - c. Permitted sources may implement changes involving modes of operation only in accordance with Rule 62-213.415, F.A.C.
- [Rule 62-213.410, F.A.C.]
- TV7. Circumvention.** No person shall circumvent any air pollution control device, or allow the emission of air pollutants without the applicable air pollution control device operating properly. [Rule 62-210.650, F.A.C.]

Compliance

- TV8. Compliance with Chapter 403, F.S., and Department Rules.** Except as provided at Rule 62-213.460, Permit Shield, F.A.C., the issuance of a permit does not relieve any person from complying with the requirements of Chapter 403, F.S., or Department rules. [Rule 62-4.070(7), F.A.C.]
- TV9. Compliance with Federal, State and Local Rules.** Except as provided at Rule 62-213.460, F.A.C., issuance of a permit does not relieve the owner or operator of a facility or an emissions unit from complying

APPENDIX TV

TITLE V GENERAL CONDITIONS

(Version dated 9/12/2008)

with any applicable requirements, any emission limiting standards or other requirements of the air pollution rules of the Department or any other such requirements under federal, state, or local law. [Rule 62-210.300, F.A.C.]

- TV10. Binding and enforceable.** The terms, conditions, requirements, limitations and restrictions set forth in this permit, are "permit conditions" and are binding and enforceable pursuant to Sections 403.141, 403.727, or 403.859 through 403.861, F.S. The permittee is placed on notice that the Department will review this permit periodically and may initiate enforcement action for any violation of these conditions. [Rule 62-4.160(1), F.A.C.]
- TV11. Timely information.** When requested by the Department, the permittee shall within a reasonable time furnish any information required by law which is needed to determine compliance with the permit. If the permittee becomes aware the relevant facts were not submitted or were incorrect in the permit application or in any report to the Department, such facts or information shall be corrected promptly. [Rule 62-4.160(15), F.A.C.]
- TV12. Halting or reduction of source activity.** It shall not be a defense for a permittee in an enforcement action that maintaining compliance with any permit condition would necessitate halting of or reduction of the source activity. [Rule 62-213.440(1)(d)3., F.A.C.]
- TV13. Final permit action.** Any Title V source shall comply with all the terms and conditions of the existing permit until the Department has taken final action on any permit renewal or any requested permit revision, except as provided at Rule 62-213.412(2), F.A.C. [Rule 62-213.440(1)(d)4., F.A.C.]
- TV14. Sudden and unforeseeable events beyond the control of the source.** A situation arising from sudden and unforeseeable events beyond the control of the source which causes an exceedance of a technology-based emissions limitation because of unavoidable increases in emissions attributable to the situation and which requires immediate corrective action to restore normal operation, shall be an affirmative defense to an enforcement action in accordance with the provisions and requirements of 40 CFR 70.6(g)(2) and (3), hereby adopted and incorporated by reference. [Rule 62-213.440(1)(d)5., F.A.C.]
- TV15. Permit Shield.** Except as provided in Chapter 62-213, F.A.C., compliance with the terms and conditions of a permit issued pursuant to Chapter 62-213, F.A.C., shall, as of the effective date of the permit, be deemed compliance with any applicable requirements in effect, provided that the source included such applicable requirements in the permit application. Nothing in this condition or in any permit shall alter or affect the ability of EPA or the Department to deal with an emergency, the liability of an owner or operator of a source for any violation of applicable requirements prior to or at the time of permit issuance, or the requirements of the Federal Acid Rain Program, the CAIR Program. [Rule 62-213.460, F.A.C.]

Permit Procedures

- TV16. Permit Revision Procedures.** The permittee shall revise its permit as required by Rules 62-213.400, 62-213.412, 62-213.420, 62-213.430 & 62-4.080, F.A.C.; and, in addition, the Department shall revise permits as provided in Rule 62-4.080, F.A.C. & 40 CFR 70.7(f).
- TV17. Permit Renewal.** The permittee shall renew its permit as required by Rules 62-4.090, 62-213.420(1) and 62-213.430(3), F.A.C. Permits being renewed are subject to the same requirements that apply to permit issuance at the time of application for renewal. Permit renewal applications shall contain that information identified in Rules 62-210.900(1) [Application for Air Permit - Long Form], 62-213.420(3) [Required Information], 62-213.420(6) [CAIR Part Form], F.A.C. Unless a Title V source submits a timely and complete application for permit renewal in accordance with the requirements this rule, the existing permit shall expire and the source's right to operate shall terminate. For purposes of a permit renewal, a timely application is one that is submitted 225 days before the expiration of a permit that expires on or after June 1, 2009. No Title V permit will be issued for a new term except through the renewal process. [Rules 62-213.420 & 62-213.430, F.A.C.]

APPENDIX TV

TITLE V GENERAL CONDITIONS

(Version dated 9/12/2008)

TV18. Insignificant Emissions Units or Pollutant-Emitting Activities. The permittee shall identify and evaluate insignificant emissions units and activities as set forth in Rule 62-213.430(6), F.A.C.

TV19. Savings Clause. If any portion of the final permit is invalidated, the remainder of the permit shall remain in effect. [Rule 62-213.440(1)(d)1., F.A.C.]

TV20. Suspension and Revocation.

- a. Permits shall be effective until suspended, revoked, surrendered, or expired and shall be subject to the provisions of Chapter 403, F.S., and rules of the Department.
- b. Failure to comply with pollution control laws and rules shall be grounds for suspension or revocation.
- c. A permit issued pursuant to Chapter 62-4, F.A.C., shall not become a vested property right in the permittee. The Department may revoke any permit issued by it if it finds that the permit holder or his agent:
 - (1) Submitted false or inaccurate information in his application or operational reports.
 - (2) Has violated law, Department orders, rules or permit conditions.
 - (3) Has failed to submit operational reports or other information required by Department rules.
 - (4) Has refused lawful inspection under Section 403.091, F.S.
- d. No revocation shall become effective except after notice is served by personal services, certified mail, or newspaper notice pursuant to Section 120.60(7), F.S., upon the person or persons named therein and a hearing held if requested within the time specified in the notice. The notice shall specify the provision of the law, or rule alleged to be violated, or the permit condition or Department order alleged to be violated, and the facts alleged to constitute a violation thereof.

[Rule 62-4.100, F.A.C.]

TV21. Not federally enforceable. Financial Responsibility. The Department may require an applicant to submit proof of financial responsibility and may require the applicant to post an appropriate bond to guarantee compliance with the law and Department rules. [Rule 62-4.110, F.A.C.]

TV22. Emissions Unit Reclassification.

- a. Any emissions unit whose operation permit has been revoked as provided for in Chapter 62-4, F.A.C., shall be deemed permanently shut down for purposes of Rule 62-212.500, F.A.C. Any emissions unit whose permit to operate has expired without timely renewal or transfer may be deemed permanently shut down, provided, however, that no such emissions unit shall be deemed permanently shut down if, within 20 days after receipt of written notice from the Department, the emissions unit owner or operator demonstrates that the permit expiration resulted from inadvertent failure to comply with the requirements of Rule 62-4.090, F.A.C., and that the owner or operator intends to continue the emissions unit in operation, and either submits an application for an air-operation permit or complies with permit transfer requirements, if applicable.
- b. If the owner or operator of an emissions unit which is so permanently shut down, applies to the Department for a permit to reactivate or operate such emissions unit, the emissions unit will be reviewed and permitted as a new emissions unit.

[Rule 62-210.300(6), F.A.C.]

TV23. Transfer of Permits. Per Rule 62-4.160(11), F.A.C., this permit is transferable only upon Department approval in accordance with Rule 62-4.120, F.A.C., as applicable. The permittee shall be liable for any non-compliance of the permitted activity until the transfer is approved by the Department. The permittee transferring the permit shall remain liable for corrective actions that may be required as a result of any violations occurring prior to the sale or legal transfer of the facility. The permittee shall also comply with the requirements of Rule 62-210.300(7), F.A.C., and use DEP Form No. 62-210.900(7). [Rules 62-4.160(11), 62-4.120, and 62-210.300(7), F.A.C.]

Rights, Title, Liability, and Agreements

TV24. Rights. As provided in Subsections 403.987(6) and 403.722(5), F.S., the issuance of this permit does not convey any vested rights or any exclusive privileges. Neither does it authorize any injury to public or private property or any invasion of personal rights, nor any infringement of federal, state, or local laws or regulations.

APPENDIX TV

TITLE V GENERAL CONDITIONS

(Version dated 9/12/2008)

This permit is not a waiver of or approval of any other Department permit that may be required for other aspects of the total project which are not addressed in this permit. [Rule 62-4.160(3), F.A.C.]

TV25. Title. This permit conveys no title to land or water, does not constitute State recognition or acknowledgment of title, and does not constitute authority for the use of submerged lands unless herein provided and the necessary title or leasehold interests have been obtained from the State. Only the Trustees of the Internal Improvement Trust Fund may express State opinion as to title. [Rule 62-4.160(4), (F.A.C.)]

TV26. Liability. This permit does not relieve the permittee from liability for harm or injury to human health or welfare, animal, or plant life, or property caused by the construction or operation of this permitted source, or from penalties therefore; nor does it allow the permittee to cause pollution in contravention of F.S. and Department rules, unless specifically authorized by an order from the Department. [Rule 62-4.160(5), F.A.C.]

TV27. Agreements.

- a. The permittee, by accepting this permit, specifically agrees to allow authorized Department personnel, upon presentation of credentials or other documents as may be required by law and at reasonable times, access to the premises where the permitted activity is located or conducted to:
 - (1) Have access to and copy any records that must be kept under conditions of the permit;
 - (2) Inspect the facility, equipment, practices, or operations regulated or required under this permit; and,
 - (3) Sample or monitor any substances or parameters at any location reasonably necessary to assure compliance with this permit or Department rules. Reasonable time may depend on the nature of the concern being investigated.
- b. In accepting this permit, the permittee understands and agrees that all records, notes, monitoring data and other information relating to the construction or operation of this permitted source which are submitted to the Department may be used by the Department as evidence in any enforcement case involving the permitted source arising under the Florida Statutes or Department rules, except where such use is prescribed by Sections 403.111 and 403.73, F.S. Such evidence shall only be used to the extent it is consistent with the Florida Rules of Civil Procedure and appropriate evidentiary rules.
- c. The permittee agrees to comply with changes in Department rules and Florida Statutes after a reasonable time for compliance; provided, however, the permittee does not waive any other rights granted by Florida Statutes or Department rules.

[Rules 62-4.160(7), (9), and (10), F.A.C.]

Recordkeeping and Emissions Computation

TV28. Permit. The permittee shall keep this permit or a copy thereof at the work site of the permitted activity. [Rule 62-4.160(12), F.A.C.]

TV29. Recordkeeping.

- a. Upon request, the permittee shall furnish all records and plans required under Department rules. During enforcement actions, the retention period for all records will be extended automatically unless otherwise stipulated by the Department.
- b. The permittee shall hold at the facility or other location designated by this permit records of all monitoring information (including all calibration and maintenance records and all original strip chart recordings for continuous monitoring instrumentation) required by the permit, copies of all reports required by this permit, and records of all data used to complete the application for this permit. These materials shall be retained at least five (5) years from the date of the sample, measurement, report, or application unless otherwise specified by Department rule.
- c. Records of monitoring information shall include:
 - (1) The date, exact place, and time of sampling or measurements, and the operating conditions at the time of sampling or measurement;
 - (2) The person responsible for performing the sampling or measurements;
 - (3) The dates analyses were performed;
 - (4) The person and company that performed the analyses;
 - (5) The analytical techniques or methods used;

APPENDIX TV

TITLE V GENERAL CONDITIONS

(Version dated 9/12/2008)

(6) The results of such analyses.

[Rules 62-4.160(14) and 62-213.440(1)(b)2., F.A.C.]

TV30. Emissions Computation. Pursuant to Rule 62-210.370, F.A.C., the following required methodologies are to be used by the owner or operator of a facility for computing actual emissions, baseline actual emissions, and net emissions increase, as defined at Rule 62-210.200, F.A.C., and for computing emissions for purposes of the reporting requirements of subsection 62-210.370(3) and paragraph 62-212.300(1)(e), F.A.C., or of any permit condition that requires emissions be computed in accordance with Rule 62-210.370, F.A.C. Rule 62-210.370, F.A.C., is not intended to establish methodologies for determining compliance with the emission limitations of any air permit.

For any of the purposes specified above, the owner or operator of a facility shall compute emissions in accordance with the requirements set forth in this subsection.

- a. **Basic Approach.** The owner or operator shall employ, on a pollutant-specific basis, the most accurate of the approaches set forth below to compute the emissions of a pollutant from an emissions unit; provided, however, that nothing in this rule shall be construed to require installation and operation of any continuous emissions monitoring system (CEMS), continuous parameter monitoring system (CPMS), or predictive emissions monitoring system (PEMS) not otherwise required by rule or permit, nor shall anything in this rule be construed to require performance of any stack testing not otherwise required by rule or permit.
 - (1) If the emissions unit is equipped with a CEMS meeting the requirements of paragraph 62-210.370(2)(b), F.A.C., the owner or operator shall use such CEMS to compute the emissions of the pollutant, unless the owner or operator demonstrates to the department that an alternative approach is more accurate because the CEMS represents still-emerging technology.
 - (2) If a CEMS is not available or does not meet the requirements of paragraph 62-210.370(2)(b), F.A.C., but emissions of the pollutant can be computed pursuant to the mass balance methodology of paragraph 62-210.370(2)(c), F.A.C., the owner or operator shall use such methodology, unless the owner or operator demonstrates to the department that an alternative approach is more accurate.
 - (3) If a CEMS is not available or does not meet the requirements of paragraph 62-210.370(2)(b), F.A.C., and emissions cannot be computed pursuant to the mass balance methodology, the owner or operator shall use an emission factor meeting the requirements of paragraph 62-210.370(2)(d), F.A.C., unless the owner or operator demonstrates to the department that an alternative approach is more accurate.
- b. **Continuous Emissions Monitoring System (CEMS).**
 - (1) An owner or operator may use a CEMS to compute emissions of a pollutant for purposes of this rule provided:
 - (a) The CEMS complies with the applicable certification and quality assurance requirements of 40 CFR Part 60, Appendices B and F, or, for an acid rain unit, the certification and quality assurance requirements of 40 CFR Part 75, all adopted by reference at Rule 62-204.800, F.A.C.; or,
 - (b) The owner or operator demonstrates that the CEMS otherwise represents the most accurate means of computing emissions for purposes of this rule.
 - (2) Stack gas volumetric flow rates used with the CEMS to compute emissions shall be obtained by the most accurate of the following methods as demonstrated by the owner or operator:
 - (a) A calibrated flowmeter that records data on a continuous basis, if available; or
 - (b) The average flow rate of all valid stack tests conducted during a five-year period encompassing the period over which the emissions are being computed, provided all stack tests used shall represent the same operational and physical configuration of the unit.
 - (3) The owner or operator may use CEMS data in combination with an appropriate f-factor, heat input data, and any other necessary parameters to compute emissions if such method is demonstrated by the owner or operator to be more accurate than using a stack gas volumetric flow rate as set forth at subparagraph 62-210.370(2)(b)2., F.A.C., above.
- c. **Mass Balance Calculations.**

APPENDIX TV

TITLE V GENERAL CONDITIONS

(Version dated 9/12/2008)

- (1) An owner or operator may use mass balance calculations to compute emissions of a pollutant for purposes of this rule provided the owner or operator:
 - (a) Demonstrates a means of validating the content of the pollutant that is contained in or created by all materials or fuels used in or at the emissions unit; and,
 - (b) Assumes that the emissions unit emits all of the pollutant that is contained in or created by any material or fuel used in or at the emissions unit if it cannot otherwise be accounted for in the process or in the capture and destruction of the pollutant by the unit's air pollution control equipment.
 - (2) Where the vendor of a raw material or fuel which is used in or at the emissions unit publishes a range of pollutant content from such material or fuel, the owner or operator shall use the highest value of the range to compute the emissions, unless the owner or operator demonstrates using site-specific data that another content within the range is more accurate.
 - (3) In the case of an emissions unit using coatings or solvents, the owner or operator shall document, through purchase receipts, records and sales receipts, the beginning and ending VOC inventories, the amount of VOC purchased during the computational period, and the amount of VOC disposed of in the liquid phase during such period.
- d. Emission Factors.
- (1) An owner or operator may use an emission factor to compute emissions of a pollutant for purposes of this rule provided the emission factor is based on site-specific data such as stack test data, where available, unless the owner or operator demonstrates to the department that an alternative emission factor is more accurate. An owner or operator using site-specific data to derive an emission factor, or set of factors, shall meet the following requirements.
 - (a) If stack test data are used, the emission factor shall be based on the average emissions per unit of input, output, or gas volume, whichever is appropriate, of all valid stack tests conducted during at least a five-year period encompassing the period over which the emissions are being computed, provided all stack tests used shall represent the same operational and physical configuration of the unit.
 - (b) Multiple emission factors shall be used as necessary to account for variations in emission rate associated with variations in the emissions unit's operating rate or operating conditions during the period over which emissions are computed.
 - (c) The owner or operator shall compute emissions by multiplying the appropriate emission factor by the appropriate input, output or gas volume value for the period over which the emissions are computed. The owner or operator shall not compute emissions by converting an emission factor to pounds per hour and then multiplying by hours of operation, unless the owner or operator demonstrates that such computation is the most accurate method available.
 - (2) If site-specific data are not available to derive an emission factor, the owner or operator may use a published emission factor directly applicable to the process for which emissions are computed. If no directly-applicable emission factor is available, the owner or operator may use a factor based on a similar, but different, process.
- e. Accounting for Emissions During Periods of Missing Data from CEMS, PEMS, or CPMS. In computing the emissions of a pollutant, the owner or operator shall account for the emissions during periods of missing data from CEMS, PEMS, or CPMS using other site-specific data to generate a reasonable estimate of such emissions.
- f. Accounting for Emissions During Periods of Startup and Shutdown. In computing the emissions of a pollutant, the owner or operator shall account for the emissions during periods of startup and shutdown of the emissions unit.
- g. Fugitive Emissions. In computing the emissions of a pollutant from a facility or emissions unit, the owner or operator shall account for the fugitive emissions of the pollutant, to the extent quantifiable, associated with such facility or emissions unit.

APPENDIX TV

TITLE V GENERAL CONDITIONS

(Version dated 9/12/2008)

- h. Recordkeeping. The owner or operator shall retain a copy of all records used to compute emissions pursuant to this rule for a period of five years from the date on which such emissions information is submitted to the department for any regulatory purpose.

[Rule 62-210.370(1) & (2), F.A.C.]

Responsible Official

TV31. Designation and Update. The permittee shall designate and update a responsible official as required by Rule 62-213.202, F.A.C.

Prohibitions and Restrictions

TV32. Asbestos. This permit does not authorize any demolition or renovation of the facility or its parts or components which involves asbestos removal. This permit does not constitute a waiver of any of the requirements of Chapter 62-257, F.A.C., and 40 CFR 61, Subpart M, National Emission Standard for Asbestos, adopted and incorporated by reference in Rule 62-204.800, F.A.C. Compliance with Chapter 62-257, F.A.C., and 40 CFR 61, Subpart M, Section 61.145, is required for any asbestos demolition or renovation at the source. [40 CFR 61; Rule 62-204.800, F.A.C.; and, Chapter 62-257, F.A.C.]

TV33. Refrigerant Requirements. Any facility having refrigeration equipment, including air conditioning equipment, which uses a Class I or II substance (listed at 40 CFR 82, Subpart A, Appendices A and B), and any facility which maintains, services, or repairs motor vehicles using a Class I or Class II substance as refrigerant must comply with all requirements of 40 CFR 82, Subparts B and F, and with Chapter 62-281, F.A.C.

TV34. Open Burning Prohibited. Unless otherwise authorized by Rule 62-296.320(3) or Chapter 62-256, F.A.C., open burning is prohibited.

APPENDIX U

LIST OF UNREGULATED EMISSIONS UNITS AND/OR ACTIVITIES

Unregulated Emissions Units and/or Activities. An emissions unit which emits no “emissions-limited pollutant” and which is subject to no unit-specific work practice standard, though it may be subject to regulations applied on a facility-wide basis (e.g., unconfined emissions, odor, general opacity) or to regulations that require only that it be able to prove exemption from unit-specific emissions or work practice standards.

The below listed emissions units and/or activities are neither ‘regulated emissions units’ nor ‘insignificant emissions units’.

E.U. ID No.	Brief Description of Emissions Units and/or Activity
017	Above ground fuel oil storage tanks
018	Miscellaneous internal combustion engines and portable equipment

REFERENCED ATTACHMENTS.

The Following Attachments Are Included for Applicant Convenience:

Table H, Permit History.

Table 1, Summary of Air Pollutant Standards.

Table 2, Summary of Compliance Requirements.

TABLE H**Permit History**

E.U. ID No.	Description	Permit No.	Issue Date	Expiration Date
001	Fossil Fuel Steam Generator #1	AO 06-223345	04/21/93	02/28/98
002	Fossil Fuel Steam Generator #2	AO 06-223350	04/21/93	02/15/98
003	Fossil Fuel Steam Generator #3	AO 06-223351	04/21/93	02/15/98
004	Fossil Fuel Steam Generator #4	AO 06-223352	04/21/93	02/15/98
005	Gas Turbine Generator #1 - 12	AO 06-230618	06/16/93	06/04/98
001 002 003 004 005	As noted above.	0110036-001-AV (Initial Title V Permit) 0110036-002-AV (Administrative Correction) 0110036-003-AV (Title V Revision)	01/01/99 02/26/01	12/31/03 12/31/03 12/31/03 12/31/03
001 002 003 004	As noted above.	0110036-005-AC	07/14/03	04/01/07
001 002 003 004 005	As noted above.	0110036-006-AV (Title V Renewal)	1/1/04	12/31/08
001 002 003 004 005	As noted above.	0110036-007-AV (Title V Renewal)	1/1/09	12/31/13
001 002 003 004 005	As noted above.	0110036-008-AV (CAIR Revision)	3/26/09	12/31/13

ID Number Changes (for tracking purposes):From: **Facility ID No.:** 50BRO060036To: **Facility ID No.:** 0110036Florida Power and Light Company
Port Everglades PlantPermit No. 0110036-009-AV
Title V Air Operation Permit Revision

TABLE 1, SUMMARY OF AIR POLLUTANT EMISSIONS STANDARDS

This table summarizes information for convenience purposes only. This table does not supersede any of the terms or conditions of this permit.

Emissions Unit		Brief Description							
001		Fossil Fuel Steam Generator, Unit 1							
002		Fossil Fuel Steam Generator, Unit 2							
		Allowable Emissions				Equivalent Emissions ^{1,2}			
Pollutant	Fuel(s)	Hours per Year	Standard(s)	lb/hour	TPY	lb/hour	TPY	Regulatory Citations	See Permit Condition(s)
VE Steady State	Oil, Natural Gas or Propane	8760	20% opacity					Rule 62-296.405(1)(a), F.A.C.	A.5.
VE Soot Blowing or Load Change	Oil, Natural Gas or Propane	8760	40 % opacity (>40% opacity for not more than 4, six-minute periods)					Rule 62-210.700(3), F.A.C.	A.6.
PM Steady State	Oil, Natural Gas or Propane	8760	0.03 lb/mmBtu			69		Rule 62-296.405(1)(b), F.A.C.	A.7.
PM Soot Blowing or Load Change	Oil, Natural Gas or Propane	8760	0.1 lb/mmBtu			230		Rule 62-210.700(3), F.A.C.	A.8.

TABLE 1, SUMMARY OF AIR POLLUTANT EMISSIONS STANDARDS

Emissions Unit	Brief Description
001	Fossil Fuel Steam Generator, Unit 1
002	Fossil Fuel Steam Generator, Unit 2

Pollutant	Fuel(s)	Hours per Year	Allowable Emissions			Equivalent Emissions ^{1,2}		Regulatory Citations	See Permit Condition(s)
			Standard(s)	lb/hour	TPY	lb/hour	TPY		
SO₂	Oil, Natural Gas	8760	2.75 lb/mmBtu			6325*	27704*	Rule 62-296.405(1)(c)1 j., F.A.C.	A.9.
NO_x	Oil	8760	0.36 lb/mmBtu			828	3626.6	Rule 62-296.570(4)(b)1, F.A.C.	A.10.
NO_x	Natural Gas	8760	0.20 lb/mmBtu			480	2102.4	Rule 62-296.570(4)(b)1, F.A.C.	A.10.

TABLE 1, SUMMARY OF AIR POLLUTANT EMISSIONS STANDARDS

Emissions Unit	Brief Description
003	Fossil Fuel Steam Generator, Unit 3
004	Fossil Fuel Steam Generator, Unit 4

Pollutant	Fuel(s)	Hours per Year	Allowable Emissions			Equivalent Emissions ^{1,2}		Regulatory Citations	See Permit Condition(s)
			Standard(s)	lb/hour	TPY	lb/hour	TPY		
VE Steady State	Oil, Natural Gas or Propane	8760	20% opacity					Rule 62-296.405(1)(a), F.A.C.	B.5.
VE Soot Blowing or Load Change	Oil, Natural Gas or Propane	8760	40 % opacity (>40% opacity for not more than 4, six-minute periods)					Rule 62-210.700(3), F.A.C.	B.6.
PM Steady State	Oil, Natural Gas or Propane	8760	0.03 lb/mmBtu			120		Rule 62-296.405(1)(b), F.A.C.	B.7.
PM Soot Blowing or Load Change	Oil, Natural Gas or Propane	8760	0.1 lb/mmBtu			400		Rule 62-210.700(3), F.A.C.	B.8.

TABLE 1, SUMMARY OF AIR POLLUTANT EMISSIONS STANDARDS

Emissions Unit	Brief Description
003	Fossil Fuel Steam Generator, Unit 3
004	Fossil Fuel Steam Generator, Unit 4

Pollutant	Fuel(s)	Hours per Year	Allowable Emissions			Equivalent Emissions ^{1,2}		Regulatory Citations	See Permit Condition(s)
			Standard(s)	lb/hour	TPY	lb/hour	TPY		
SO ₂	Oil, Natural Gas	8760	2.75 lb/mmBtu			11000*	48180*	Rule 62-296.405(1)(c)1.j., F.A.C.	B.9.
NO _x	Oil	8760	0.53 lb/mmBtu			2120	9285.6	Rules 62-296.570(4)(b)2, F.A.C.	B.10.
NO _x	Natural Gas	8760	0.40 lb/mmBtu			1672	7323.4	Rule 62-296.570(4)(b)2, F.A.C.	B.10.

TABLE 1, SUMMARY OF AIR POLLUTANT EMISSIONS STANDARDS

Emissions Unit	Brief Description
005	12 Simple Cycle Gas Turbines, GT1 through GT12.

Pollutant	Fuel(s)	Hours per Year	Allowable Emissions			Equivalent Emissions ^{1,3}		Regulatory Citations	See Permit Condition(s)
			Standard(s)	lb/hour	TPY	lb/hour	TPY		
VE Steady State	Oil, Natural Gas or Propane	8760	20% opacity					Rule 62-296.320(4)(b)1., F.A.C.	C.5.
NO_x	Oil	8760	0.90 lb/mmBtu			7581.6	33207	Rule 62-296.570(4)(b)2, F.A.C.	C.7.
NO_x	Natural Gas	8760	0.50 lb/mmBtu			4212	18449	Rule 62-296.570(4)(b)5, F.A.C.	C.7.

Notes:

- ¹ The "Equivalent Emissions" listed are for informational purposes only.
 - ² The "Equivalent Emissions" are for each emission unit, unless otherwise noted.
 - ³ The "Equivalent Emissions" are for all twelve turbines combined.
- *Lb/hr and TPY values are for SO₂ emissions using fuel oil.

TABLE 2, SUMMARY OF COMPLIANCE REQUIREMENTS

This table summarizes information for convenience purposes only. This table does not supersede any of the terms or conditions of this permit.

Emissions Unit	Brief Description
001	Fossil Fuel Steam Generator, Unit 1
002	Fossil Fuel Steam Generator, Unit 2

Pollutant or Parameter	Fuel(s)	Compliance Method	Testing Frequency	Frequency Base Date ¹	Minimum Compliance Test Duration	CMS ²	See Permit Condition(s)
VE	Oil, Natural Gas or Propane	DEP Method 9	Annual	September 30	1 hour	No	A.15., A.16.
PM	Oil, Natural Gas or Propane	EPA Test Methods 5, 5B, or 17	Annual	September 30	3 hours	No	A.15., A.17., A.21.
SO₂	Oil, Natural Gas or Propane	Continuous Emissions Monitor	Continuous			Yes	A.17., A.23.
NO_x	Oil, Natural Gas or Propane	Continuous Emissions Monitor	Continuous			Yes	A.17.

TABLE 2, SUMMARY OF COMPLIANCE REQUIREMENTS

Emissions Unit	Brief Description
003	Fossil Fuel Steam Generator, Unit 3
004	Fossil Fuel Steam Generator, Unit 4

Pollutant or Parameter	Fuel(s)	Compliance Method	Testing Frequency	Frequency Base Date ¹	Minimum Compliance Test Duration	CMS ²	See Permit Condition(s)
VE	Oil, Natural Gas or Propane	DEP Method 9	Annual	September 30	1 hour	No	B.15.
PM	Oil, Natural Gas or Propane	EPA Test Methods 5, 5B, or 17	Annual	September 30	3 hours	No	B.15, B.17.
SO₂	Oil, Natural Gas or Propane	Continuous Emissions Monitor	Continuous			Yes	B.18.
NO_x	Oil, Natural Gas or Propane	Continuous Emissions Monitor	Continuous			Yes	B.15.

TABLE 2, SUMMARY OF COMPLIANCE REQUIREMENTS

Emissions Unit		Brief Description					
005		12 Simple Cycle Gas Turbines, GT1 through GT12.					

Pollutant or Parameter	Fuel(s)	Compliance Method	Testing Frequency	Frequency Base Date ¹	Minimum Compliance Test Duration	CMS ²	See Permit Condition(s)
VE	Oil, Natural Gas	EPA Method 9	Annual, each turbine exceeding fuel limit.	October 31	30 min.	No	C.9., C.10.
NO_x	Oil, Natural Gas	EPA Method 20 or EPA Method 7E	Every five years, one turbine only, provided operation is no more than 320 hours/year/ turbine on oil.	September 30	3 hours	No	C.9., C.11.

Notes:

¹ Frequency base date established for planning purposes only; see Rule 62-297.310, F.A.C.

² CMS = continuous monitoring system

Friday, Barbara

To: Jeff_Smith@fpl.com
Cc: Sheila_Wilkinson@fpl.com; ed_prest@fpl.com; Forney.Kathleen@epamail.epa.gov; Oquendo.Ana@epamail.epa.gov; 'dbanu@co.broward.fl.us'; Gibson, Victoria; Cascio, Tom; Holtom, Jonathan
Subject: FLORIDA POWER & LIGHT COMPANY - PORT EVERGLADES POWER PLANT; 0110036-009-AV
Attachments: 0110036009SignedWrittenNoticeRevision.pdf

Dear Sir/ Madam:

Attached is the official **Written Notice of Intent to Issue Air Permit** for the project referenced below. Click on the link displayed below to access the permit project documents and send a "reply" message verifying receipt of the document(s) provided in the link; this may be done by selecting "Reply" on the menu bar of your e-mail software, noting that you can view the documents, and then selecting "Send".

Note: We must receive verification that you are able to access the documents. Your immediate reply will preclude subsequent e-mail transmissions to verify accessibility of the document(s).

Click on the following link to access the permit project documents:

http://ARM-PERMIT2K.dep.state.fl.us/adh/prod/pdf_permit_zip_files/0110036.009.AV.D_pdf.zip

Attention: Tom Cascio

Owner/Company Name: FLORIDA POWER and LIGHT (PPE)
Facility Name: PORT EVERGLADES POWER PLANT
Project Number: 0110036-009-AV
Permit Status: DRAFT/PROPOSED
Permit Activity: PERMIT REVISION
Facility County: BROWARD

“The Bureau of Air Regulation is issuing electronic documents for permits, notices and other correspondence in lieu of hard copies through the United States Postal System, to provide greater service to the applicant and the engineering community. Access these documents by clicking on the link provided above, or search for other project documents using the “*Air Permit Documents Search*” website at <http://www.dep.state.fl.us/air/emission/apds/default.asp> . “

Permit project documents that are addressed in this email may require immediate action within a specified time frame. Please open and review the document(s) as soon as possible, and verify that they are accessible. Please advise this office of any changes to your e-mail address or that of the Engineer-of-Record. If you have any problems opening the documents or would like further information, please contact the Florida Department of Environmental Protection, Bureau of Air Regulation.

Barbara Friday
Bureau of Air Regulation
Division of Air Resource Management (DARM)
(850)921-9524

Friday, Barbara

From: Exchange Administrator
Sent: Friday, October 16, 2009 9:07 AM
To: Friday, Barbara
Subject: Delivery Status Notification (Relay)
Attachments: ATT252121.txt; FLORIDA POWER & LIGHT COMPANY - PORT EVERGLADES POWER PLANT; 0110036-009-AV

This is an automatically generated Delivery Status Notification.

Your message has been successfully relayed to the following recipients, but the requested delivery status notifications may not be generated by the destination.

Jeff_Smith@fpl.com
Sheila_Wilkinson@fpl.com
ed_prest@fpl.com

Friday, Barbara

From: Smith, Jeff [Jeff.Smith@fpl.com]
Sent: Tuesday, October 20, 2009 10:01 AM
To: Friday, Barbara
Cc: Sheila_Wilkinson@fpl.com; Preast, Ed; Forney.Kathleen@epamail.epa.gov; Oquendo.Ana@epamail.epa.gov; dbanu@co.broward.fl.us; Gibson, Victoria; Cascio, Tom; Holtom, Jonathan; Stokes, Idayna; Washington, Kevin
Subject: RE: FLORIDA POWER & LIGHT COMPANY - PORT EVERGLADES POWER PLANT; 0110036-009-AV

Barbara,

I am able to retrieve and view the document,

Thank you..

Jeff Smith
Plant General Manager
Riviera Plant
Port Everglades Plant
Gas Turbine Power Park

Office 954-527-3601
Mobile 561-307-7188
jeff.smith@fpl.com

NOTICE: This e-mail and attachments transmitted with it may contain privileged and confidential information that is solely for the use of the named addressee. If you are not the intended recipient, you are hereby notified that any review, dissemination, distribution or other use of this message or its contents and attachments are prohibited. If you received this e-mail in error, please notify the sender by reply e-mail and delete this message and destroy copies or back ups thereof. Thank you for your assistance.

From: Friday, Barbara [mailto:Barbara.Friday@dep.state.fl.us]
Sent: Friday, October 16, 2009 9:07 AM
To: Smith, Jeff
Cc: Sheila_Wilkinson@fpl.com; Preast, Ed; Forney.Kathleen@epamail.epa.gov; Oquendo.Ana@epamail.epa.gov; dbanu@co.broward.fl.us; Gibson, Victoria; Cascio, Tom; Holtom, Jonathan
Subject: FLORIDA POWER & LIGHT COMPANY - PORT EVERGLADES POWER PLANT; 0110036-009-AV

Dear Sir/ Madam:

Attached is the official **Written Notice of Intent to Issue Air Permit** for the project referenced below. Click on the link displayed below to access the permit project documents and send a "reply" message verifying receipt of the document(s) provided in the link; this may be done by selecting "Reply" on the menu bar of your e-mail software, noting that you can view the documents, and then selecting "Send".

Note: We must receive verification that you are able to access the documents. Your immediate reply will preclude subsequent e-mail transmissions to verify accessibility of the document(s).

Click on the following link to access the permit project documents:

http://ARM-PERMIT2K.dep.state.fl.us/adh/prod/pdf_permit_zip_files/0110036.009.AV.D_pdf.zip

Attention: Tom Cascio

Owner/Company Name: FLORIDA POWER and LIGHT (PPE)

Facility Name: PORT EVERGLADES POWER PLANT

Project Number: 0110036-009-AV

Permit Status: DRAFT/PROPOSED

Permit Activity: PERMIT REVISION

Facility County: BROWARD

“The Bureau of Air Regulation is issuing electronic documents for permits, notices and other correspondence in lieu of hard copies through the United States Postal System, to provide greater service to the applicant and the engineering community. Access these documents by clicking on the link provided above, or search for other project documents using the “*Air Permit Documents Search*” website at <http://www.dep.state.fl.us/air/emission/apds/default.asp> . “

Permit project documents that are addressed in this email may require immediate action within a specified time frame. Please open and review the document(s) as soon as possible, and verify that they are accessible. Please advise this office of any changes to your e-mail address or that of the Engineer-of-Record. If you have any problems opening the documents or would like further information, please contact the Florida Department of Environmental Protection, Bureau of Air Regulation.

Barbara Friday
Bureau of Air Regulation
Division of Air Resource Management (DARM)
(850)921-9524

The Department of Environmental Protection values your feedback as a customer. DEP Secretary Michael W. Sole is committed to continuously assessing and improving the level and quality of services provided to you. Please take a few minutes to comment on the quality of service you received. Simply click on [this link to the DEP Customer Survey](#). Thank you in advance for completing the survey.

Friday, Barbara

From: Wilkinson, Sheila M [Sheila.M.Wilkinson@fpl.com]
Sent: Friday, October 16, 2009 9:08 AM
To: Friday, Barbara
Subject: Out of Office: FLORIDA POWER & LIGHT COMPANY - PORT EVERGLADES POWER PLANT; 0110036-009-AV

I will be on vacation starting the afternoon of Friday 10/9/09. I will return to the office on Monday 10/19/09.

If you need immediate assistance, please contact:

Christian Kiernan for Environmental issues at 561-691-2781 or 561-676-3975.
Melanie Roger for Water Chemistry issues at 561-691-2754 or 561-371-6048.
Augie de la Vega for Emission Testing issues at 305-242-3896 or 786-236-8614.
Susan Mazur for Central Lab issues at 561-640-2010 or 561-310-6028.

Thank you and have a safe day!

Friday, Barbara

From: Wilkinson, Sheila M [Sheila.M.Wilkinson@fpl.com]
To: Friday, Barbara
Sent: Monday, October 19, 2009 3:10 PM
Subject: Read: FLORIDA POWER & LIGHT COMPANY - PORT EVERGLADES POWER PLANT;
0110036-009-AV

Your message

To: Sheila.M.Wilkinson@fpl.com
Subject:

was read on 10/19/2009 3:10 PM.

Friday, Barbara

From: Preast, Ed [Ed.Prest@fpl.com]
To: Friday, Barbara
Sent: Friday, October 16, 2009 9:35 AM
Subject: Read: FLORIDA POWER & LIGHT COMPANY - PORT EVERGLADES POWER PLANT;
0110036-009-AV

Your message

To: Ed.Prest@fpl.com
Subject:

was read on 10/16/2009 9:35 AM.

Friday, Barbara

From: Exchange Administrator
Sent: Friday, October 16, 2009 9:07 AM
To: Friday, Barbara
Subject: Delivery Status Notification (Relay)
Attachments: ATT252120.txt; FLORIDA POWER & LIGHT COMPANY - PORT EVERGLADES POWER PLANT; 0110036-009-AV.

This is an automatically generated Delivery Status Notification.

Your message has been successfully relayed to the following recipients, but the requested delivery status notifications may not be generated by the destination.

dbanu@co.broward.fl.us

Friday, Barbara

From: Mail Delivery System [MAILER-DAEMON@mseive02.rtp.epa.gov]
Sent: Friday, October 16, 2009 9:07 AM
To: Friday, Barbara
Subject: Successful Mail Delivery Report
Attachments: Delivery report; Message Headers

This is the mail system at host mseive02.rtp.epa.gov.

Your message was successfully delivered to the destination(s) listed below. If the message was delivered to mailbox you will receive no further notifications. Otherwise you may still receive notifications of mail delivery errors from other systems.

The mail system

<Forney.Kathleen@epamail.epa.gov>: delivery via 127.0.0.1[127.0.0.1]:10025: 250 OK, sent 4AD87001_7065_16786_1 C021B47906

<Oquendo.Ana@epamail.epa.gov>: delivery via 127.0.0.1[127.0.0.1]:10025: 250 OK, sent 4AD87001_7065_16786_1 C021B47906

Friday, Barbara

From: System Administrator
To: Cascio, Tom; Gibson, Victoria
Sent: Friday, October 16, 2009 9:07 AM
Subject: Delivered:FLORIDA POWER & LIGHT COMPANY - PORT EVERGLADES POWER PLANT; 0110036-009-AV

Your message

To: Jeff_Smith@fpl.com
Cc: Sheila_Wilkinson@fpl.com; ed_prest@fpl.com; Forney.Kathleen@epamail.epa.gov; Oquendo.Ana@epamail.epa.gov; 'dbanu@co.broward.fl.us'; Gibson, Victoria; Cascio, Tom; Holtom, Jonathan
Subject: FLORIDA POWER & LIGHT COMPANY - PORT EVERGLADES POWER PLANT; 0110036-009-AV
Sent: 10/16/2009 9:07 AM

was delivered to the following recipient(s):

Cascio, Tom on 10/16/2009 9:07 AM
Gibson, Victoria on 10/16/2009 9:07 AM

Friday, Barbara

From: Cascio, Tom
To: Friday, Barbara
Sent: Friday, October 16, 2009 9:43 AM
Subject: Read: FLORIDA POWER & LIGHT COMPANY - PORT EVERGLADES POWER PLANT; 0110036-009-AV

Your message

To: [Jeff Smith@fpl.com](mailto:Jeff.Smith@fpl.com)
Cc: [Sheila Wilkinson@fpl.com](mailto:Sheila.Wilkinson@fpl.com); ed_prest@fpl.com; Forney.Kathleen@epamail.epa.gov; Oquendo.Ana@epamail.epa.gov; 'dbanu@co.broward.fl.us'; Gibson, Victoria; Cascio, Tom; Holtom, Jonathan
Subject: FLORIDA POWER & LIGHT COMPANY - PORT EVERGLADES POWER PLANT; 0110036-009-AV
Sent: 10/16/2009 9:07 AM

was read on 10/16/2009 9:43 AM.

Friday, Barbara

From: Gibson, Victoria
To: Friday, Barbara
Sent: Wednesday, October 21, 2009 10:22 AM
Subject: Read: FLORIDA POWER & LIGHT COMPANY - PORT EVERGLADES POWER PLANT; 0110036-009-AV

Your message

To: [Jeff Smith@fpl.com](mailto:Jeff.Smith@fpl.com)
Cc: [Sheila Wilkinson@fpl.com](mailto:Sheila.Wilkinson@fpl.com); [ed preast@fpl.com](mailto:ed_prest@fpl.com); Forney.Kathleen@epamail.epa.gov; Oquendo.Ana@epamail.epa.gov; 'dbanu@co.broward.fl.us'; Gibson, Victoria; Cascio, Tom; Holtom, Jonathan
Subject: FLORIDA POWER & LIGHT COMPANY - PORT EVERGLADES POWER PLANT; 0110036-009-AV
Sent: 10/16/2009 9:07 AM

was read on 10/21/2009 10:22 AM.

Friday, Barbara

From: Gibson, Victoria
Sent: Friday, October 16, 2009 9:07 AM
To: Friday, Barbara
Subject: Out of Office AutoReply: FLORIDA POWER & LIGHT COMPANY - PORT EVERGLADES POWER PLANT; 0110036-009-AV

on Friday, 10/16 and Monday, 10/19. I will return on Tuesday, 10/20.
Have a great weekend.

Friday, Barbara

From: System Administrator
To: Holtom, Jonathan
Sent: Friday, October 16, 2009 9:07 AM
Subject: Delivered:FLORIDA POWER & LIGHT COMPANY - PORT EVERGLADES POWER PLANT; 0110036-009-AV

Your message

To: Jeff_Smith@fpl.com
Cc: Sheila_Wilkinson@fpl.com; ed_prest@fpl.com; Forney.Kathleen@epamail.epa.gov; Oquendo.Ana@epamail.epa.gov; 'dbanu@co.broward.fl.us'; Gibson, Victoria; Cascio, Tom; Holtom, Jonathan
Subject: FLORIDA POWER & LIGHT COMPANY - PORT EVERGLADES POWER PLANT; 0110036-009-AV
Sent: 10/16/2009 9:07 AM

was delivered to the following recipient(s):

Holtom, Jonathan on 10/16/2009 9:07 AM

Friday, Barbara

From: Holtom, Jonathan
To: Friday, Barbara
Sent: Friday, October 16, 2009 9:31 AM
Subject: Read: FLORIDA POWER & LIGHT COMPANY - PORT EVERGLADES POWER PLANT; 0110036-009-AV

Your message

To: [Jeff Smith@fpl.com](mailto:Jeff.Smith@fpl.com)
Cc: [Sheila Wilkinson@fpl.com](mailto:Sheila.Wilkinson@fpl.com); [ed preast@fpl.com](mailto:ed_prest@fpl.com); Forney.Kathleen@epamail.epa.gov; Oquendo.Ana@epamail.epa.gov; 'dbanu@co.broward.fl.us'; Gibson, Victoria; Cascio, Tom; Holtom, Jonathan
Subject: FLORIDA POWER & LIGHT COMPANY - PORT EVERGLADES POWER PLANT; 0110036-009-AV
Sent: 10/16/2009 9:07 AM

was read on 10/16/2009 9:31 AM.