



# Department of Environmental Protection

Jeb Bush  
Governor

Twin Towers Office Building  
2600 Blair Stone Road  
Tallahassee, Florida 32399-2400

Colleen M. Castille  
Secretary

## P.E. Certification Statement

**Permittee:**

Reliant Energy Osceola, L.L.C.  
**Reliant Energy Osceola, L.L.C. Facility**

DRAFT Permit Revision No. **0970071-005-AV**  
Draft Air Construction Permit **0970071-006-AC**  
**(PSD-FL-273A)**

**Project:** Title V Air Operation Permit Revision and Air Construction Permit

This facility consists of three dual-fuel nominal 170 megawatt (MW) General Electric PG7241FA combustion turbine-electrical generators (CT's) with three 75-foot stacks. Emissions from the CT's are controlled by Dry Low NO<sub>x</sub> (DLN-2.6) combustors when operating on natural gas and wet injection when firing fuel oil. Inherently clean fuels and good combustion practices are employed to control all pollutants. The emissions units are regulated under Acid Rain, Phase II; NSPS - 40 CFR 60, Subpart GG, Standards of Performance for Stationary Gas Turbines, adopted and incorporated by reference in Rule 62-204.800(7), F.A.C.; Rule 62-212.400(5), F.A.C., Prevention of Significant Deterioration (PSD); Rule 62-212.400(6), F.A.C., Best Available Control Technology (BACT) Determination, dated December 28, 1999. The simple-cycle combustion turbines began operation in 2002.

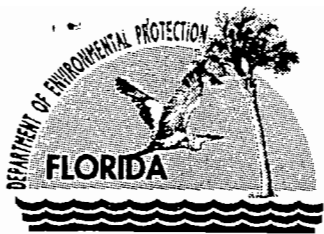
*I HEREBY CERTIFY that the engineering features described in the above referenced application and subject to the proposed permit conditions provide reasonable assurance of compliance with applicable provisions of Chapter 403, Florida Statutes, and Florida Administrative Code Chapters 62-4 and 62-204 through 62-297. However, I have not evaluated and I do not certify aspects of the proposal outside of my area of expertise (including but not limited to the electrical, mechanical, structural, hydrological, and geological features). This draft permit was prepared under my direct supervision by Dr. Tom Cascio of my staff.*

Alvaro A. Linero, P.E.  
Registration Number: 26032

7/6/04  
date

Permitting Authority:  
Department of Environmental Protection  
Bureau of Air Regulation  
Permitting South Section  
111 South Magnolia Drive, Suite 4  
Tallahassee, Florida 32301  
Telephone: 850/488-0144  
Fax: 850/922-6979

7/6/04



Jeb Bush  
Governor

# Department of Environmental Protection

Twin Towers Office Building  
2600 Blair Stone Road  
Tallahassee, Florida 32399-2400

Colleen M. Castille  
Secretary

July 2, 2004

Mr. Terry E. Gish  
Responsible Official  
Reliant Energy Osceola, L.L.C.  
7800 U.S. Highway One South  
Titusville, FL 32780

Re: Draft Air Construction Permit No. **0970071-006-AC (PSD-FL-273A)**  
DRAFT Title V Air Operation Permit Revision No. **0970071-005-AV**  
**Reliant Energy Osceola, L.L.C. Facility**

Dear Mr. Gish:

One copy of the Technical Evaluation and Preliminary Determination, the combined Public Notice, the Draft Air Construction Permit, and the DRAFT Title V Air Operation Permit Revision for the Reliant Energy Osceola, L.L.C. Facility located at 5200 West Holopaw Road, St. Cloud, Osceola County, is enclosed. The permitting authority's "INTENT TO ISSUE AN AIR CONSTRUCTION PERMIT AND A TITLE V AIR OPERATION PERMIT REVISION" and the "PUBLIC NOTICE OF INTENT TO ISSUE AN AIR CONSTRUCTION PERMIT AND A TITLE V AIR OPERATION PERMIT REVISION" are also included.

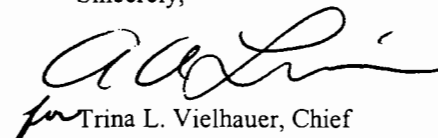
Electronic versions of these documents have been posted on the Division of Air Resource Management's world wide web site for the United States Environmental Protection Agency (U.S. EPA) Region 4 office's review. The web site address is:

<http://www.dep.state.fl.us/air/eproducts/airpermit/AirSearch.asp>

The "PUBLIC NOTICE OF INTENT TO ISSUE AN AIR CONSTRUCTION PERMIT AND A TITLE V AIR OPERATION PERMIT REVISION" must be published as soon as possible. Proof of publication, i.e., newspaper affidavit, must be provided to the permitting authority's office within 7 (seven) days of publication pursuant to Rule 62-110.106(5), F.A.C. Failure to publish the notice and provide proof of publication within the allotted time may result in the denial of the permits pursuant to Rule 62-110.106(11), F.A.C.

Please submit any written comments you wish to have considered concerning the permitting authority's proposed action to the Program Administrator, Permitting South Section, at the above letterhead address. If you have any other questions, please contact Tom Cascio, at 850/921-9526.

Sincerely,

  
for Trina L. Vielhauer, Chief  
Bureau of Air Regulation

Enclosures

U.S. EPA, Region 4 (INTERNET E-mail)

"More Protection, Less Process"

Printed on recycled paper.



#5505, Tallahassee, Florida 32399-2400 (Telephone: 850/488-0114; Fax: 850/922-6979, within 7 (seven) days of publication pursuant to Rule 62-110.106(5), F.A.C. Failure to publish the notice and provide proof of publication may result in the denial of the permits pursuant to Rule 62-110.106(11), F.A.C.

The permitting authority will issue the Air Construction Permit and the PROPOSED Title V Air Operation Permit Revision and subsequent FINAL Title V Air Operation Permit Revision, in accordance with the conditions of the attached Draft Air Construction Permit and the DRAFT Title V Air Operation Permit Revision unless a response received in accordance with the following procedures results in a different decision or significant change of terms or conditions.

The permitting authority will accept written comments concerning the proposed Air Construction Permit issuance action for a period of 30 (thirty) days from the date of publication of the "PUBLIC NOTICE OF INTENT TO ISSUE AN AIR CONSTRUCTION PERMIT AND A TITLE V AIR OPERATION PERMIT REVISION." Written comments should be provided to the permitting authority office. Any written comments filed shall be made available for public inspection. If written comments received result in a significant change in this Draft Air Construction Permit, the permitting authority shall issue a Revised Draft Air Construction Permit and require, if applicable, another Public Notice.

The permitting authority will accept written comments concerning the proposed Title V Air Operation Permit Revision issuance action for a period of 30 (thirty) days from the date of publication of the "PUBLIC NOTICE OF INTENT TO ISSUE AN AIR CONSTRUCTION PERMIT AND A TITLE V AIR OPERATION PERMIT REVISION." Written comments should be provided to the permitting authority office. Any written comments filed shall be made available for public inspection. If written comments received result in a significant change in this DRAFT Title V Air Operation Permit Revision, the permitting authority shall issue a Revised DRAFT Title V Air Operation Permit Revision and require, if applicable, another Public Notice.

A person whose substantial interests are affected by the proposed permitting decision may petition for an administrative hearing in accordance with Sections 120.569 and 120.57, F.S. The petition must contain the information set forth below and must be filed (received) in the Office of General Counsel of the Department of Environmental Protection, 3900 Commonwealth Boulevard, Mail Station #35, Tallahassee, Florida 32399-3000 (Telephone: 850/245-2242; Fax: 850/245-2303). Petitions filed by the permits's (construction and revision) applicant or any of the parties listed below must be filed within 14 (fourteen) days of receipt of this notice of intent. Petitions filed by any persons other than those entitled to written notice under Section 120.60(3), F.S., must be filed within 14 (fourteen) days of publication of the public notice or within 14 (fourteen) days of receipt of this notice of intent, whichever occurs first. Under Section 120.60(3), F.S., however, any person who asked the permitting authority for notice of agency action may file a petition within 14 (fourteen) days of receipt of that notice, regardless of the date of publication. A petitioner shall mail a copy of the petition to the applicant at the address indicated above, at the time of filing. The failure of any person to file a petition within the appropriate time period shall constitute a waiver of that person's right to request an administrative determination (hearing) under Sections 120.569 and 120.57, F.S., or to intervene in this proceeding and participate as a party to it. Any subsequent intervention will be only at the approval of the presiding officer upon the filing of a motion in compliance with Rule 28-106.205, F.A.C.

A petition that disputes the material facts on which the permitting authority's action is based must contain the following information:

(a) The name and address of each agency affected and each agency's file or identification number, if known;

(b) The name, address, and telephone number of the petitioner; the name, address and telephone number of the petitioner's representative, if any, which shall be the address for service purposes during the course of the proceeding; and an explanation of how the petitioner's substantial interests will be affected by the agency determination;

(c) A statement of how and when each petitioner received notice of the agency action or proposed action;

(d) A statement of all disputed issues of material fact. If there are none, the petition must so indicate;

(e) A concise statement of the ultimate facts alleged, as well as the rules and statutes which entitle the petitioner to relief;

(f) A statement of the specific rules or statutes the petitioner contends require reversal or modification of the agency's proposed action; and,

(g) A statement of the relief sought by the petitioner, stating precisely the action petitioner wishes the agency to take with respect to the agency's proposed action.

A petition that does not dispute the material facts upon which the permitting authority's action is based shall state that no such facts are in dispute and otherwise shall contain the same information as set forth above, as required by Rule 28-106.301, F.A.C.

Because the administrative hearing process is designed to formulate final agency action, the filing of a petition means that the permitting authority's final action may be different from the position taken by it in this notice of intent. Persons whose substantial interests will be affected by any such final decision of the permitting authority on the application(s) have the right to petition to become a party to the proceeding, in accordance with the requirements set forth above.

Mediation will not be available in this proceeding.

In addition to the above, a person subject to regulation has a right to apply to the Department of Environmental Protection for a variance from or waiver of the requirements of particular rules, on certain conditions, under Section 120.542, F.S. The relief provided by this state statute applies only to state rules, not statutes, and not to any federal regulatory requirements. Applying for a variance or waiver does not substitute or extend the time for filing a petition for an administrative hearing or exercising any other right that a person may have in relation to the action proposed in this notice of intent.

The application for a variance or waiver is made by filing a petition with the Office of General Counsel of the Department of Environmental Protection, 3900 Commonwealth Boulevard, Mail Station #35, Tallahassee, Florida 32399-3000. The petition must specify the following information:

(a) The name, address, and telephone number of the petitioner;

(b) The name, address, and telephone number of the attorney or qualified representative of the petitioner, if any;

(c) Each rule or portion of a rule from which a variance or waiver is requested;

(d) The citation to the statute underlying (implemented by) the rule identified in (c) above;

(e) The type of action requested;

(f) The specific facts that would justify a variance or waiver for the petitioner;

(g) The reason why the variance or waiver would serve the purposes of the underlying statute (implemented by the rule); and,

(h) A statement whether the variance or waiver is permanent or temporary and, if temporary, a statement of the dates showing the duration of the variance or waiver requested.

The Department will grant a variance or waiver when the petition demonstrates both that the application of the rule would create a substantial hardship or violate principles of fairness, as each of

those terms is defined in Section 120.542(2), F.S., and that the purpose of the underlying statute will be or has been achieved by other means by the petitioner.

Persons subject to regulation pursuant to any federally delegated or approved air program should be aware that Florida is specifically not authorized to issue variances or waivers from any requirements of any such federally delegated or approved program. The requirements of the program remain fully enforceable by the Administrator of the United States Environmental Protection Agency and by any person under the Clean Air Act unless and until the Administrator separately approves any variance or waiver in accordance with the procedures of the federal program.

Finally, pursuant to 42 United States Code (U.S.C.) Section 7661d(b)(2), any person may petition the Administrator of the EPA within 60 (sixty) days of the expiration of the Administrator's 45 (forty-five) day review period as established at 42 U.S.C. Section 7661d(b)(1), to object to issuance of any permit revision. Any petition shall be based only on objections to the permit revision that were raised with reasonable specificity during the 30 (thirty) day public comment period provided in this notice, unless the petitioner demonstrates to the Administrator of the EPA that it was impracticable to raise such objections within the comment period or unless the grounds for such objection arose after the comment period. Filing of a petition with the Administrator of the EPA does not stay the effective date of any permit properly issued pursuant to the provisions of Chapter 62-213, F.A.C. Petitions filed with the Administrator of EPA must meet the requirements of 42 U.S.C. Section 7661d(b)(2) and must be filed with the Administrator of the EPA at: U.S. EPA, 401 M Street, S.W., Washington, D.C. 20460.

Executed in Tallahassee, Florida.

**STATE OF FLORIDA DEPARTMENT  
OF ENVIRONMENTAL PROTECTION**

  
for Trina L. Vielhauer, Chief  
Bureau of Air Regulation

**CERTIFICATE OF SERVICE**

The undersigned duly designated deputy agency clerk hereby certifies that this INTENT TO ISSUE AN AIR CONSTRUCTION PERMIT AND A TITLE V AIR OPERATION PERMIT REVISION (including the combined PUBLIC NOTICE, the Draft Air Construction Permit and the DRAFT Title V Air Operation Permit Revision) and all copies were sent by certified mail before the close of business on 7/7/04 to the person listed:

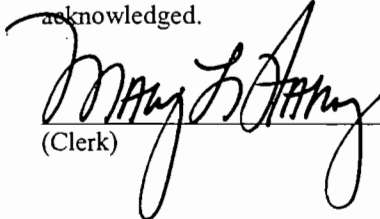
Terry E. Gish, Reliant Energy Osceola, L.L.C..

In addition, the undersigned duly designated deputy agency clerk hereby certifies that copies of this INTENT TO ISSUE AN AIR CONSTRUCTION PERMIT AND A TITLE V AIR OPERATION PERMIT REVISION (including the combined PUBLIC NOTICE, the Draft Air Construction Permit and the DRAFT Title V Air Operation Permit Revision) were sent by U.S. mail on the same date to the persons listed or as otherwise noted:

Len Kozlov, P.E., Central District Office  
Joe Araiza, Reliant Energy Osceola, L.L.C.

Clerk Stamp

**FILING AND ACKNOWLEDGMENT FILED**, on this date, pursuant to Section 120.52(7), Florida Statutes, with the designated agency Clerk, receipt of which is hereby acknowledged.

  
(Clerk) 7/7/04  
(Date)

**PUBLIC NOTICE OF INTENT TO ISSUE AN AIR CONSTRUCTION PERMIT AND A TITLE V AIR  
OPERATION PERMIT REVISION**

Department of Environmental Protection

Draft Air Construction Permit No. 0970071-006-AC (PSD-FL-273A)  
DRAFT Title V Air Operation Permit Revision No. 0970071-005-AV  
Reliant Energy Osceola, L.L.C. Facility  
Osceola County

The Department of Environmental Protection (permitting authority) gives notice of its intent to issue an Air Construction Permit and a Title V Air Operation Permit Revision to Reliant Energy Osceola, L.L.C. for the Reliant Energy Osceola, L.L.C. Facility located at 5200 West Holopaw Road, St. Cloud, Osceola County. A determination of best available control technology (BACT) was not required. The applicant's name and address are: Mr. Terry E. Gish, Responsible Official, Reliant Energy Osceola, L.L.C., 7800 U.S. Highway One South, Titusville, Florida 32780.

The facility consists of three 170-megawatt gas fired combustion turbines that occasionally use low sulfur (0.05 percent) fuel oil for backup. The construction permit (modification to PSD-FL-273), and corresponding Title V permit revision, are to: (a) clarify the wording concerning performance testing requirements; (b) remove the requirement of providing an analysis of the nitrogen content of fuel oil received at the facility (given the use of a continuous emission monitor); and (c) change the time frame for compliance with a given heat input ratio of fuel oil to natural gas from a consecutive 12-months to a consecutive 24-months. The Department has determined that these changes do not require a review pursuant to the rule for the Prevention of Significant Deterioration of Air Quality (PSD).

The permitting authority will issue the Air Construction Permit and the PROPOSED Title V Air Operation Permit Revision and subsequent FINAL Title V Air Operation Permit Revision, in accordance with the conditions of the Draft Air Construction Permit and the DRAFT Title V Air Operation Permit Revision unless a response received in accordance with the following procedures results in a different decision or significant change of terms or conditions.

The permitting authority will accept written comments concerning the proposed Draft Air Construction Permit issuance action for a period of 30 (thirty) days from the date of publication of this Notice. Written comments should be provided to the Department's Bureau of Air Regulation, 2600 Blair Stone Road, Mail Station #5505, Tallahassee, Florida 32399-2400. Any written comments filed shall be made available for public inspection. If written comments received result in a significant change in this Draft Air Construction Permit, the permitting authority shall issue a Revised Draft Air Construction Permit and require, if applicable, another Public Notice.

The permitting authority will accept written comments concerning the proposed DRAFT Title V Air Operation Permit Revision issuance action for a period of 30 (thirty) days from the date of publication of this Notice. Written comments should be provided to the Department's Bureau of Air Regulation, 2600 Blair Stone Road, Mail Station #5505, Tallahassee, Florida 32399-2400. Any written comments filed shall be made available for public inspection. If written comments received result in a significant change in this DRAFT Title V Air Operation Permit Revision, the permitting authority shall issue a Revised DRAFT Title V Air Operation Permit Revision and require, if applicable, another Public Notice.

A person whose substantial interests are affected by the proposed permitting decision may petition for an administrative hearing in accordance with Sections 120.569 and 120.57 of the Florida Statutes (F.S.). The petition must contain the information set forth below and must be filed (received) in the Office of General Counsel of the Department of Environmental Protection, 3900 Commonwealth Boulevard, Mail Station #35, Tallahassee, Florida 32399-3000 (Telephone: 850/245-2242; Fax: 850/245-2303). Petitions filed by any persons other than those entitled to written notice under Section 120.60(3), F.S., must be filed within 14 (fourteen) days of publication of the public notice or within 14 (fourteen) days of receipt of the notice of intent, whichever occurs first. Under Section 120.60(3), F.S., however, any person who asked the permitting authority



for notice of agency action may file a petition within 14 (fourteen) days of receipt of that notice, regardless of the date of publication. A petitioner shall mail a copy of the petition to the applicant at the address indicated above, at the time of filing. The failure of any person to file a petition within the applicable time period shall constitute a waiver of that person's right to request an administrative determination (hearing) under Sections 120.569 and 120.57, F.S., or to intervene in this proceeding and participate as a party to it. Any subsequent intervention will be only at the approval of the presiding officer upon the filing of a motion in compliance with Rule 28-106.205 of the Florida Administrative Code (F.A.C.).

A petition that disputes the material facts on which the permitting authority's action is based must contain the following information:

- (a) The name and address of each agency affected and each agency's file or identification number, if known;
- (b) The name, address and telephone number of the petitioner; name address and telephone number of the petitioner's representative, if any, which shall be the address for service purposes during the course of the proceeding; and an explanation of how petitioner's substantial rights will be affected by the agency determination;
- (c) A statement of how and when the petitioner received notice of the agency action or proposed action;
- (d) A statement of all disputed issues of material fact. If there are none, the petition must so state;
- (e) A concise statement of the ultimate facts alleged, as well as the rules and statutes which entitle petitioner to relief;
- (f) A statement of the specific rules or statutes the petitioner contends require reversal or modification of the agency's proposed action; and,
- (g) A statement of the relief sought by the petitioner, stating precisely the action petitioner wishes the agency to take with respect to the agency's proposed action.

A petition that does not dispute the material facts upon which the permitting authority's action is based shall state that no such facts are in dispute and otherwise shall contain the same information as set forth above, as required by Rule 28-106.301, F.A.C.

Because the administrative hearing process is designed to formulate final agency action, the filing of a petition means that the permitting authority's final action may be different from the position taken by it in this notice of intent. Persons whose substantial interests will be affected by any such final decision of the permitting authority on the application(s) have the right to petition to become a party to the proceeding, in accordance with the requirements set forth above.

Mediation is not available for this proceeding.

In addition to the above, pursuant to 42 United States Code (U.S.C.) Section 7661d(b)(2), any person may petition the Administrator of the EPA within 60 (sixty) days of the expiration of the Administrator's 45 (forty-five) day review period as established at 42 U.S.C. Section 7661d(b)(1), to object to issuance of any permit revision. Any petition shall be based only on objections to the permit revision that were raised with reasonable specificity during the 30 (thirty) day public comment period provided in this notice, unless the petitioner demonstrates to the Administrator of the EPA that it was impracticable to raise such objections within the comment period or unless the grounds for such objection arose after the comment period. Filing of a petition with the Administrator of the EPA does not stay the effective date of any permit properly issued pursuant to the provisions of Chapter 62-213, F.A.C. Petitions filed with the Administrator of EPA must meet the requirements of 42 U.S.C. Section 7661d(b)(2) and must be filed with the Administrator of the EPA at: U.S. EPA, 401 M Street, S.W., Washington, D.C. 20460.

A complete project file is available for public inspection during normal business hours, 8:00 a.m. to 5:00 p.m., Monday through Friday, except legal holidays, at:

Permitting Authority:

Department of Environmental Protection  
Bureau of Air Regulation  
111 South Magnolia Drive, Suite 4  
Tallahassee, Florida 32301  
Telephone: 850/488-0114  
Fax: 850/922-6979

Affected District/Local Program:

Department of Environmental Protection  
Central District Office  
3319 Maguire Boulevard, Suite 232  
Orlando, Florida 32803-3767  
Telephone: 407/894-7555  
Fax: 407/897-2966

The complete project file includes the Technical Evaluation and Preliminary Determination and associated Draft Air Construction Permit and DRAFT Title V Air Operation Permit Revision, the application(s), and the information submitted by the responsible official, exclusive of confidential records under Section 403.111, F.S. Interested persons may contact the Program Administrator, Permitting South Section, at the above address, or call 850/488-0114, for additional information.



Jeb Bush  
Governor

# Department of Environmental Protection

Twin Towers Office Building  
2600 Blair Stone Road  
Tallahassee, Florida 32399-2400

Colleen M. Castille  
Secretary

DRAFT

Certified Mail - Return Receipt Requested

Mr. Terry E. Gish  
Responsible Official  
Reliant Energy Osceola, L.L.C.  
7800 U.S. Highway One South  
Titusville, FL 32780

Re: Air Construction Permit **0970071-006-AC (PSD-FL-273A)**  
Modification to PSD-FL-273  
**Reliant Energy Osceola, L.L.C. Facility**

The applicant, Reliant Energy Osceola, L.L.C., applied on April 8, 2004, to the Department for modifications to PSD permit number PSD-FL-273 for its Reliant Energy Osceola, L.L.C. Facility located at 5200 West Holopaw Road, St. Cloud, Osceola County. The application was revised on June 18, 2004. The revised application contained requested changes to three specific conditions. This air construction permit modification implements the requested changes. The permit modification is to: (a) clarify the wording concerning performance testing requirements, (b) remove the requirement of providing an analysis of the nitrogen content of fuel oil received at the facility, and (c) change the time frame for compliance with a given heat input ratio (i.e., less than or equal to one) of fuel oil to natural gas from a consecutive 12-months to a consecutive 24-months. Please refer to the Technical Evaluation and Preliminary Determination document associated with this project. The Department has reasonable assurance that there are no significant changes to the potential to emit air pollutants associated with this project.

The three specific conditions of permit PSD-FL-273, regulating combustion turbines, are hereby changed as noted below.

#### Specific Condition 29.

From:

29. Initial (I) performance tests (for both fuels) shall be performed on each unit while firing natural gas as well as while firing oil. Initial tests shall also be conducted after any modifications (and shake down period not to exceed 100 days after re-starting the CT) of air pollution control equipment such as change or tuning of combustors. Annual (A) compliance tests shall be performed during every federal fiscal year (October 1 – September 30) pursuant to Rule 62-297.310(7), F.A.C., on each unit as indicated. The following reference methods shall be used. No other test methods may be used for compliance testing unless prior DEP approval is received in writing.

- EPA Reference Method 9, "Visual Determination of the Opacity of Emissions from Stationary Sources" (I, A).

*"More Protection, Less Process"*

*Printed on recycled paper.*

- EPA Reference Method 10, “Determination of Carbon Monoxide Emissions from Stationary Sources” (I, A).
- EPA Reference Method 20, “Determination of Oxides of Nitrogen Oxide, Sulfur Dioxide and Diluent Emissions from Stationary Gas Turbines.” Initial tests for compliance with 40 CFR 60 Subpart GG and (I, A) short-term NOx BACT limits (EPA Reference Method 7E, “Determination of Nitrogen Oxides Emissions from Stationary Sources” or RATA test data may be used to demonstrate compliance for annual test requirements).
- EPA Reference method 18, 25 and/or 25A, “Determination of Volatile Organic Concentrations.” Initial test only.

To:

29. Initial (I) performance tests (for both fuels) shall be performed on each unit while firing natural gas as well as while firing oil. The Department may require the permittee to conduct additional tests after major replacement or repair of any air pollution control equipment, such as the water injection system, DLN combustors, etc. Annual (A) compliance tests shall be performed during every federal fiscal year (October 1 – September 30) pursuant to Rule 62-297.310(7), F.A.C., on each unit as indicated. The following reference methods shall be used. No other test methods may be used for compliance testing unless prior DEP approval is received in writing.

- EPA Reference Method 9, “Visual Determination of the Opacity of Emissions from Stationary Sources” (I, A).
- EPA Reference Method 10, “Determination of Carbon Monoxide Emissions from Stationary Sources” (I, A).
- EPA Reference Method 20, “Determination of Oxides of Nitrogen Oxide, Sulfur Dioxide and Diluent Emissions from Stationary Gas Turbines.” Initial tests for compliance with 40 CFR 60 Subpart GG and (I, A) short-term NOx BACT limits (EPA Reference Method 7E, “Determination of Nitrogen Oxides Emissions from Stationary Sources” or RATA test data may be used to demonstrate compliance for annual test requirements).
- EPA Reference method 18, 25 and/or 25A, “Determination of Volatile Organic Concentrations.” Initial test only.

Specific Condition 46.

From:

46. Fuel Oil Monitoring Schedule. The following monitoring schedule for No. 2 or superior grade fuel oil shall be followed: For all bulk shipments of No. 2 fuel oil received at this facility an analysis which reports the sulfur content and nitrogen content of the fuel shall be provided by the fuel vendor. The analysis shall also specify the methods by which the analyses were conducted and shall comply with the requirements of 40 CFR 60.335(d).

To:

46. Fuel Oil Monitoring Schedule. The following monitoring schedule for No. 2 or superior grade fuel oil shall be followed: For all bulk shipments of No. 2 fuel oil received at this facility an analysis which reports the sulfur content of the fuel shall be provided by the fuel vendor. The analysis shall also specify the methods by which the analyses were conducted and shall comply with the requirements of 40 CFR 60.335(d).

Specific Condition 14.

From:

14. The amount of back-up fuel (fuel oil) burned at the site (in BTU's) shall not exceed the amount of natural gas (primary fuel) burned at the site (in BTU's) during any consecutive 12-month period. [Rule 62-210, F.A.C. (BACT)]

To:

14. The amount of back-up fuel (fuel oil) burned at the site (in BTU's) shall not exceed the amount of natural gas (primary fuel) burned at the site (in BTU's) during any consecutive 24-month period. [Rule 62-210, F.A.C. (BACT)]

A copy of this letter shall be filed with the referenced permit and shall become part of the permit. This permit modification is issued pursuant to Chapter 403, Florida Statutes.

Any party to this order (permit modification) has the right to seek judicial review of it under Section 120.68, F.S., by filing a notice of appeal under Rule 9.110 of the Florida Rules of Appellate Procedure with the clerk of the Department of Environmental Protection in the Office of General Counsel, Mail Station #35, 3900 Commonwealth Boulevard, Tallahassee, Florida, 32399-3000, and by filing a copy of the notice of appeal accompanied by the applicable filing fees with the appropriate District Court of Appeal. The notice must be filed within thirty days after this order is filed with the clerk of the Department.

Executed in Tallahassee, Florida.

---

Michael G. Cooke, Director  
Division of Air Resource  
Management

**CERTIFICATE OF SERVICE**

The undersigned duly designated deputy agency clerk hereby certifies that this permit modification was sent by certified mail (\*) and copies were mailed by U.S. Mail before the close of business on \_\_\_\_\_ to the persons listed:

Terry Gish, Reliant Energy Osceola, L.L.C.\*  
Len Kozlov, P.E., Central District Office  
U.S. EPA Region 4

Clerk Stamp

**FILING AND ACKNOWLEDGMENT FILED,**  
on this date, pursuant to §120.52, Florida Statutes,  
with the designated Department Clerk, receipt of  
which is hereby acknowledged.

\_\_\_\_\_  
(Clerk)

\_\_\_\_\_  
(Date)

TECHNICAL EVALUATION  
AND  
PRELIMINARY DETERMINATION

Reliant Energy Osceola, L.L.C..  
**Reliant Energy Osceola, L.L.C. Facility**  
Osceola County

DEP File No. **0970071-006-AC**  
**PSD-FL-273A**

Department of Environmental Protection  
Division of Air Resource Management  
Bureau of Air Regulation  
Permitting South Section

June 25, 2004

# TECHNICAL EVALUATION AND PRELIMINARY DETERMINATION

## 1.0. GENERAL INFORMATION

### 1.1. APPLICANT NAME AND ADDRESS

Reliant Energy Osceola, L.L.C.  
7800 U.S. Highway One South  
Titusville, FL 32780

Responsible Official: Mr. Terry Gish

### 1.2. REVIEW AND PROCESS SCHEDULE

April 8, 2004                      Permit application received.  
April 8, 2004                      Application deemed complete.

## 2.0. FACILITY INFORMATION

This facility is located at 5200 West Holopaw Road, St. Cloud, Osceola County; UTM Coordinates: Zone 17, 490.43 km East and 3111.31 km North; and, Latitude: 28° 07' 44" North and Longitude: 81° 05' 50" West. SIC codes are:

Industry Group No.	49	Electric, Gas and Sanitary Services
Industry No.	4911	Electric Generation

The facility was issued a PSD permit, PSD-FL-273, on December 28, 1999. The corresponding air construction permit was numbered 0970071-001-AC. The regulated emissions units at the facility include three nominal 170 megawatts (MW) simple-cycle General Electric PG7241 FA combustion turbines. The turbines use low NO<sub>x</sub> technologies. The facility utilizes natural gas as its primary fuel source with low sulfur (0.05 percent sulfur) distillate fuel oil serving as a backup fuel.

Each unit may operate up to 3000 hours in any consecutive twelve month period, of which up to 750 hours may be on fuel oil.

This facility is classified as a Major or Title V Source of air pollution because emissions of at least one regulated air pollutant, such as particulate matter (PM/PM<sub>10</sub>), sulfur dioxide (SO<sub>2</sub>), nitrogen oxides (NO<sub>x</sub>), carbon monoxide (CO), or volatile organic compounds (VOC) exceeds 100 tons per year (TPY).

This facility is within an industry included in the list of the 28 Major Facility Categories per Table 62-212.400-1, F.A.C. Because emissions are greater than 100 TPY for at least one criteria pollutant, the facility is also a Major Facility with respect to Rule 62-212.400, Prevention of Significant Deterioration (PSD). This facility is a major source of hazardous air pollutants (HAPs).

## 3.0. Permit Modification Request

The construction permit (modification to PSD-FL-273) is to:

- clarify when the Department can or shall require future "Initial Tests" following changes or tuning of combustors;
- remove the requirement of providing an analysis of the nitrogen content of fuel oil received at the facility; and
- revise the time frame for compliance with a given heat input ratio (i.e., less than or equal to one) of fuel oil to natural gas from a consecutive 12-months to a consecutive 24-month period.



# TECHNICAL EVALUATION AND PRELIMINARY DETERMINATION

The first request is not considered a modification for purposes of PSD review. The second change is justified because NO<sub>x</sub> CEMS are used to demonstrate compliance with NO<sub>x</sub> limitations at the facility. The final change requires further assessment to determine PSD Review is triggered.

## 4.0. Characterization of Change in Fuel Oil to Natural Gas Ratio

The original permit allowed each unit to operate 3000 hours per year. All of the operation can be on natural gas but fuel oil can only be used for 750 hours per year per unit. Additionally the amount of back-up fuel (0.05% sulfur) burned shall not exceed the amount of natural gas (primary fuel) burned during any consecutive 12-month period.

These requirements were part of the best available control technology (BACT) determination that was included to insure that the units were in fact "gas-fired combustion turbines." Emissions of NO<sub>x</sub> and SO<sub>2</sub> are much less when burning natural gas than when burning fuel oil. For example the NO<sub>x</sub> limit is 42 parts per million by volume, dry at 15 percent excess oxygen (ppmvd @15% O<sub>2</sub>). On the other hand the limit when burning natural gas is 10.5 ppmvd @15% O<sub>2</sub>.

The requested change will allow Reliant to balance natural gas and fuel oil use over a 24-month period instead of a 12-month period. This may best be described as a "change in the method of operation."

## 5.0. Evaluation of PSD Applicability

As a major source, a modification or change in method of operation resulting in **significant net emissions increases** (major modification) is subject to PSD review.

According to information in the Department's emission database and information provided by Reliant, the annual input values since startup in 2001 are as follows:

Year	Annual Heat Input x 10 <sup>12</sup> Btu during 2001 – 2003						
	<u>2001</u>		<u>2002</u>			<u>2003</u>	
Fuel	Gas	Oil	Gas	Oil	Gas	Oil	
Unit 1	0.357	0.070	1.656	0.058	1.551	0.163	
Unit 2	0.221	0.047	2.109	0.227	2.361	0.130	
Unit 3	0	0	0.892	0.110	0.704	0.019	

From the data, it is clear that much more gas is used than low sulfur fuel oil. In fact the ratio of gas use to fuel oil use has been increasing since the facility started up. It appears that the requirement to use more gas than fuel oil in a period of 12 months has not been an impediment.

The expressed concern of Reliant is that in a given year when possibly one or more units are nearly idle, fuel oil use may in fact exceed natural gas use. That seems remote but not out of the realm of possibility.

Normally the Department requires an evaluation of past actual emissions to future potential emissions when evaluating a change in method of operation. However this is not the kind of change that cause increases on such a basis. It is not reasonable to assume that switching to a 24-month averaging time to insure more gas is used than oil will *cause* the facility to operate at full capacity.

Full capacity operation cause by this change in method of operation would mean that at worst each unit would operate 2,250 hours on natural gas and 750 hours on oil. However the ratio would still be 3 to 1 in favor of natural gas use. Emissions comparisons are typically made on a 2-year basis anyway.

There is no plausible reason to fear an increase of emissions for the present request regarding the natural gas to fuel oil ratio. However, there is no outright exemption from the procedure for the peakers.

# **TECHNICAL EVALUATION AND PRELIMINARY DETERMINATION**

---

In the present case the units will not be replaced or physically modified. Low sulfur fuel oil has always been more expensive than natural gas except for brief spikes. The company and equipment manufacturer much prefer to use natural gas for operational and maintenance purposes.

Historical records reveal that the total natural gas capacity in Florida was approximately one billion standard cubic feet per day (SCFD) in year 2000. Over the past few years, a number of improvements have raised this number to over 3 billion SCFD. The biggest project, the Gulfstream Natural Gas System, L.L.C. project recently added 1.1 billion SCFD to Florida's capacity. The project originates at Mobile, Alabama, with a pipeline running offshore in the Gulf of Mexico and terminating onshore in Manatee County. The onshore portion of the network includes a fork with a terminus in Holopaw, Osceola County (i.e., the project site).

When the project was permitted, the reviewers had valid reasons to expect a situation where the facility would be primarily an oil fired plant because the Gulfstream Pipeline was a more remote possibility. The many projects permitted in Florida to use natural gas actually stimulated the investment.

The concerns are no longer present or less likely to arise. Reliant is planning for a possible low operation year and the possibility of failing to comply with the required ratio.

The Department has reasonable assurance and sufficient conditions in the permit such that significant emissions increases will not occur. The change cannot possibly cause operation reflecting the potential to emit.

## **6.0. Conclusions**

The Department also concludes that PSD is not applicable to this project since the project as presented is not a major modification to a major facility. The changes will not cause a significant impact or cause or contribute to a violation of any ambient air quality standard or PSD increment. The Department review of the details of the project reveals that it is a trivial case.

The Department's conclusion does not set a precedent for other projects implemented at any facilities other than the one reviewed. The application and determination of the Department's rules does not constitute an interpretation of the EPA rules under 40CFR52.21, Prevention of Significant Deterioration.

## **STATEMENT OF BASIS**

Reliant Energy Osceola, L.L.C.  
**Reliant Energy Osceola, L.L.C. Facility**  
Facility ID No. **0970071**  
Osceola County

Title V Air Operation Permit Revision  
DRAFT Permit No. **0970071-005-AV**

This Title V air operation permit is issued under the provisions of Chapter 403, Florida Statutes (F.S.), and Florida Administrative Code (F.A.C.) Chapters 62-4, 62-210, 62-213, and 62-214. The above named permittee is hereby authorized to perform the work or operate the facility shown on the application and approved drawing(s), plans, and other documents, attached hereto or on file with the permitting authority, in accordance with the terms and conditions of this permit.

This facility consists of three dual-fuel, simple cycle combustion turbines.

The emissions units are three dual-fuel nominal 170 megawatt (MW) General Electric PG7241FA combustion turbine-electrical generators with three 75-foot stacks. Emissions from the CT's are controlled by Dry Low NO<sub>x</sub> (DLN-2.6) combustors when operating on natural gas and wet injection when firing fuel oil. Inherently clean fuels and good combustion practices are employed to control all pollutants. The emissions units are regulated under Acid Rain, Phase II; NSPS - 40 CFR 60, Subpart GG, Standards of Performance for Stationary Gas Turbines, adopted and incorporated by reference in Rule 62-204.800(7), F.A.C.; Rule 62-212.400(5), F.A.C., Prevention of Significant Deterioration (PSD); Rule 62-212.400(6), F.A.C., Best Available Control Technology (BACT) Determination, dated December 28, 1999. The simple-cycle combustion turbines began operation in 2002.

This revision is to: (a) clarify the wording concerning performance testing requirements, (b) remove the requirement of providing an analysis of the nitrogen content of fuel oil received at the facility, and (c) change the time frame for compliance with a given heat input ratio of fuel oil to natural gas from a consecutive 12-months to a consecutive 24-months.

Specific conditions established in Title V Air Operation Permit No. 0970071-004-AV, and based on an AC permitting action No. 0970071-006-AC, are changed as follows:

### **Specific Condition A.3.**

From:

#### **A.3. Methods of Operation. Fuels.**

Only pipeline natural gas or maximum 0.05 percent sulfur fuel oil No. 2 or superior grade of distillate fuel oil shall be fired in these units. [Applicant Request, Rule 62-210.200, F.A.C. (Definitions - Potential Emissions)] {Note: The limitation of this specific condition is more stringent than the NSPS sulfur dioxide limitation and thus assures compliance with 40 CFR

60.333 and 60.334}. The amount of back-up fuel (fuel oil) burned at the site (in BTU's) shall not exceed the amount of natural gas (primary fuel) burned at the site (in BTU's) during any consecutive 12-month period.

[Rules 62-212.400, 62-212.410, and 62-213.410, F.A.C.; and, PSD-FL-273]

To:

**A.3. Methods of Operation. Fuels.**

Only pipeline natural gas or maximum 0.05 percent sulfur fuel oil No. 2 or superior grade of distillate fuel oil shall be fired in these units. [Applicant Request, Rule 62-210.200, F.A.C. (Definitions - Potential Emissions)] {Note: The limitation of this specific condition is more stringent than the NSPS sulfur dioxide limitation and thus assures compliance with 40 CFR 60.333 and 60.334}. The amount of back-up fuel (fuel oil) burned at the site (in BTU's) shall not exceed the amount of natural gas (primary fuel) burned at the site (in BTU's) during any consecutive 24-month period.

[Rules 62-212.400, 62-212.410, and 62-213.410, F.A.C.; and PSD-FL-273A, Specific Condition 14.]

**Specific Condition A.15.**

From:

**A.15.** The owner or operator of any stationary gas turbine subject to the provisions of 40 CFR 60, Subpart GG shall monitor sulfur content and nitrogen content of the fuel being fired in the turbine. The frequency of determination of these values shall be as follows:

- (1) If the turbine is supplied its fuel from a bulk storage tank, the values shall be determined on each occasion that fuel is transferred to the storage tank from any other source.
- (2) If the turbine is supplied its fuel without intermediate bulk storage the values shall be determined and recorded daily. Owners, operators or fuel vendors may develop custom schedules for determination of the values based on the design and operation of the affected facility and the characteristics of the fuel supply. These custom schedules shall be substantiated with data and must be approved by the Administrator before they can be used to comply with 40 CFR 60.334(b).

See Specific Conditions **A.28.** and **A.29.**

[40 CFR 60.334(b)(1) & (2)]

To:

**A.15.** The owner or operator of any stationary gas turbine subject to the provisions of 40 CFR 60, Subpart GG shall monitor sulfur content of the fuel being fired in the turbine. The frequency of determination of these values shall be as follows:

- (1) If the turbine is supplied its fuel from a bulk storage tank, the values shall be determined on each occasion that fuel is transferred to the storage tank from any other source.
- (2) If the turbine is supplied its fuel without intermediate bulk storage the values shall be determined and recorded daily. Owners, operators or fuel vendors may develop custom schedules for determination of the values based on the design and operation of the affected

facility and the characteristics of the fuel supply. These custom schedules shall be substantiated with data and must be approved by the Administrator before they can be used to comply with 40 CFR 60.334(b).

See Specific Conditions **A.28.** and **A.29.**

[40 CFR 60.334(b)(1) & (2); and PSD-FL-273A, Specific Condition 46.]

Specific Condition **A.21.**

From:

**A.21.** Initial performance tests (for both fuels) shall be performed on each unit while firing natural gas as well as while firing oil. Initial tests shall also be conducted after any modifications (and shake down period not to exceed 100 days after re-starting the CT) of air pollution control equipment such as change or tuning of combustors. The following reference methods shall be used. No other test methods may be used for compliance testing unless prior DEP approval is received in writing.

[PSD-FL-273]

To:

**A.21.** Initial performance tests (for both fuels) shall be performed on each unit while firing natural gas as well as while firing oil. The Department may require the permittee to conduct additional tests after major replacement or repair of any air pollution control equipment, such as the water injection system, DLN combustors, etc. The following reference methods shall be used. No other test methods may be used for compliance testing unless prior DEP approval is received in writing.

[PSD-FL-273A, Specific Condition 29.]

Specific Condition **A.29.**

From:

**A.29.** Fuel Oil Monitoring Schedule. The following monitoring schedule for No. 2 or superior grade fuel oil shall be followed: For all bulk shipments of No. 2 fuel oil received at this facility an analysis which reports the sulfur content and nitrogen content of the fuel shall be provided by the fuel vendor. The analysis shall also specify the methods by which the analyses were conducted and shall comply with the requirements of 40 CFR 60.335(d), see Specific Condition **A.26.**

[PSD-FL-273]

To:

**A.29.** Fuel Oil Monitoring Schedule. The following monitoring schedule for No. 2 or superior grade fuel oil shall be followed: For all bulk shipments of No. 2 fuel oil received at this facility an analysis which reports the sulfur content of the fuel shall be provided by the fuel vendor. The analysis shall also specify the methods by which the analyses were conducted and shall comply with the requirements of 40 CFR 60.335(d). See Specific Condition **A.26.**

[PSD-FL-273A, Specific Condition 46.]

Also included in this permit are miscellaneous unregulated/insignificant emissions units and/or activities.

Based on the Title V permit revision application received April 8, 2004, this facility is a major source of hazardous air pollutants (HAPs).

Reliant Energy Osceola, L.L.C.

**Reliant Energy Osceola, L.L.C. Facility**

Facility ID No. **0970071**

Osceola County

DRAFT Permit Revision No. **0970071-005-AV**

Permitting Authority:

State of Florida  
Department of Environmental Protection  
Division of Air Resource Management  
Bureau of Air Regulation  
Permitting South Section  
Mail Station #5505  
2600 Blair Stone Road  
Tallahassee, Florida 32399-2400  
Telephone: 850/488-0114  
Fax: 850/922-6979

Compliance Authority:

Department of Environmental Protection  
Central District Office  
3319 Maguire Boulevard, Suite 232  
Orlando, Florida 32803-3767  
Telephone: 407/894-7555  
Fax: 407/897-2966

Title V Air Operation Permit Revision  
DRAFT Permit Revision No. 0970071-005-AV

**Table of Contents**

<b>Section</b>	<b>Page Number</b>
Placard Page .....	1
I. Facility Information .....	2 - 3
A. Facility Description.	
B. Summary of Emissions Unit ID No(s). and Brief Description(s).	
C. Relevant Documents.	
II. Facility-wide Conditions .....	4 - 6
III. Emissions Units and Conditions	
A. Emissions Unit -001 170 MW Simple-Cycle Combustion Turbine	
Emissions Unit -002 170 MW Simple-Cycle Combustion Turbine	
Emissions Unit -003 170 MW Simple-Cycle Combustion Turbine.....	7 - 24
IV. Acid Rain Part	
A. Acid Rain, Phase II .....	25 - 26



**Permittee:**

Reliant Energy Osceola, L.L.C.  
7800 U.S. Highway One South  
Titusville, Florida 32780

**DRAFT Permit No.:** 0970071-005-AV**Facility ID No.:** 0970071**SIC Nos.:** 49, 4911**Project:** Title V Air Operation Permit Revision

This permit is for the operation of the Reliant Energy Osceola, L.L.C. facility. This facility is located at 5200 West Holopaw Road, St. Cloud, Osceola County; UTM Coordinates: Zone 17, 490.43 km East and 3111.31 km North; and, Latitude: 28° 07' 44" North and Longitude: 81° 05' 50" West.

This Title V Air Operation Permit is issued under the provisions of Chapter 403, Florida Statutes (F.S.), and Florida Administrative Code (F.A.C.) Chapters 62-4, 62-210, 62-213 and 62-214. The above named permittee is hereby authorized to perform the work or operate the facility shown on the application and approved drawing(s), plans, and other documents, attached hereto or on file with the permitting authority, in accordance with the terms and conditions of this permit.

**Referenced attachments made a part of this permit:**

Appendix U-1, List of Unregulated Emissions Units and/or Activities

Appendix I-1, List of Insignificant Emissions Units and/or Activities

APPENDIX TV-4, TITLE V CONDITIONS version dated 02/12/02

APPENDIX SS-1, STACK SAMPLING FACILITIES version dated 10/07/96

TABLE 297.310-1, CALIBRATION SCHEDULE version dated 10/07/96

FIGURE 1 - SUMMARY REPORT-GASEOUS AND OPACITY EXCESS EMISSION AND  
MONITORING SYSTEM PERFORMANCE REPORT version dated 07/96

PHASE II ACID RAIN APPLICATION/COMPLIANCE PLAN (received November 30, 1999)

**Effective Date:** January 1, 2003**Revision Effective Date:****Renewal Application Due Date:** July 5, 2007**Expiration Date:** December 31, 2007

---

Michael G. Cooke, Director  
Division of Air Resource  
Management

**Section I. Facility Information.**

**Subsection A. Facility Description.**

The regulated emissions units at the facility include three nominal 170 megawatts (MW) simple-cycle General Electric PG7241 FA combustion turbines. The turbines use low NO<sub>x</sub> technologies. The facility utilizes pipeline natural gas as its primary fuel source with distillate fuel oil serving as a backup fuel. The units operate in intermittent duty.

Also included in this permit are miscellaneous unregulated/insignificant emissions units and/or activities.

Based on the Title V permit revision application received on April 8, 2004, this facility is a major source of hazardous air pollutants (HAPs).

**Subsection B. Summary of Emissions Unit ID No(s). and Brief Description(s).**

<b>E.U. ID No.</b>	<b>Brief Description</b>
-001	170 MW Simple-Cycle Combustion Turbine
-002	170 MW Simple-Cycle Combustion Turbine
-003	170 MW Simple-Cycle Combustion Turbine

Unregulated Emissions Units and/or Activities

<b>E.U. ID No.</b>	<b>Brief Description of Emissions Units and/or Activity</b>
-005	Two, pipeline natural gas heaters

*Please reference the Permit No., Facility ID No., and appropriate Emissions Unit(s) ID No(s). on all correspondence, test report submittals, applications, etc.*

**Subsection C. Relevant Documents.**

The documents listed below are not a part of this permit; however, they are specifically related to this permitting action.

These documents are provided to the permittee for information purposes only:

Table 1-1, Summary of Air Pollutant Standards and Terms  
Table 2-1, Summary of Compliance Requirements  
Appendix A-1: Abbreviations, Acronyms, Citations, and Identification Numbers  
Appendix H-1: Permit History/ID Number Changes  
Statement of Basis

These documents are on file with permitting authority:

Title V Permit Revision Application received on April 8, 2004.  
Revision to application received on June 18, 2004.

## **Section II. Facility-wide Conditions.**

### **The following conditions apply facility-wide:**

1. APPENDIX TV-4, TITLE V CONDITIONS, is a part of this permit.  
{Permitting note: APPENDIX TV-4, TITLE V CONDITIONS, is distributed to the permittee only. Other persons requesting copies of these conditions shall be provided one copy when requested or otherwise appropriate.}
2. **Not federally enforceable.** General Pollutant Emission Limiting Standards. Objectionable Odor Prohibited. No person shall cause, suffer, allow, or permit the discharge of air pollutants which cause or contribute to an objectionable odor.  
[Rule 62-296.320(2), F.A.C.]
3. General Particulate Emission Limiting Standards. General Visible Emissions Standard. Except for emissions units that are subject to a particulate matter or opacity limit set forth or established by rule and reflected by conditions in this permit, no person shall cause, let, permit, suffer or allow to be discharged into the atmosphere the emissions of air pollutants from any activity, the density of which is equal to or greater than that designated as Number 1 on the Ringelmann Chart (20 percent opacity). EPA Method 9 is the method of compliance pursuant to Chapter 62-297, F.A.C.  
[Rules 62-296.320(4)(b)1. & 4., F.A.C.]
4. Prevention of Accidental Releases (Section 112(r) of CAA).
  - a. The permittee shall submit its Risk Management Plan (RMP) to the Chemical Emergency Preparedness and Prevention Office (CEPPO) RMP Reporting Center when, and if, such requirement becomes applicable. Any Risk Management Plans, original submittals, revisions or updates to submittals, should be sent to:  

RMP Reporting Center  
Post Office Box 1515  
Lanham-Seabrook, Maryland 20703-1515  
Telephone: 301/429-5018
- and,
- b. The permittee shall submit to the permitting authority Title V certification forms or a compliance schedule in accordance with Rule 62-213.440(2), F.A.C.  
[40 CFR 68]
5. Unregulated Emissions Units and/or Activities. Appendix U-1, List of Unregulated Emissions Units and/or Activities, is a part of this permit.  
[Rule 62-213.440(1), F.A.C.]
6. Insignificant Emissions Units and/or Activities. Appendix I-1, List of Insignificant Emissions Units and/or Activities, is a part of this permit.  
[Rules 62-213.440(1), 62-213.430(6), and 62-4.040(1)(b), F.A.C.]

7. General Pollutant Emission Limiting Standards. Volatile Organic Compounds (VOC) Emissions or Organic Solvents (OS) Emissions. The permittee shall allow no person to store, pump, handle, process, load, unload or use in any process or installation, volatile organic compounds (VOC) or organic solvents (OS) without applying known and existing vapor emission control devices or systems deemed necessary and ordered by the Department.

[Rule 62-296.320(1)(a), F.A.C.]

8. Any permit issued to a facility with emissions of unconfined particulate matter shall specify the reasonable precautions to be taken by that facility to control the emissions of unconfined particulate matter.

[Rule 62-296.320(4)(c)2., F.A.C.]

{Note: This condition implements the requirements of Rules 62-296.320(4)(c)1., 3., & 4., F.A.C. (see Condition 57. of APPENDIX TV-4, TITLE V CONDITIONS).}

9. When appropriate, any recording, monitoring, or reporting requirements that are time-specific shall be in accordance with the effective date of the permit, which defines day one.

[Rule 62-213.440, F.A.C.]

10. Statement of Compliance. The annual statement of compliance pursuant to Rule 62-213.440(3)(a)2., F.A.C., shall be submitted to the Department and EPA within 60 (sixty) days after the end of the calendar year using DEP Form No. 62-213.900(7), F.A.C.

[Rules 62-213.440(3) and 62-213.900, F.A.C.]

{Permitting Note: This condition implements the requirements of Rules 62-213.440(3)(a)2. & 3., F.A.C. (see Condition 51. of APPENDIX TV-4, TITLE V CONDITIONS).}

11. The permittee shall submit all compliance related notifications and reports required of this permit to the Department's Central District office.

Department of Environmental Protection  
Central District Office  
3319 Maguire Boulevard, Suite 232  
Orlando, Florida 32803-3767  
Telephone: 407/894-7555  
Fax: 407/897-2966

12. Any reports, data, notifications, certifications, and requests required to be sent to the United States Environmental Protection Agency, Region 4, should be sent to:

United States Environmental Protection Agency  
Region 4  
Air, Pesticides & Toxics Management Division  
Air and EPCRA Enforcement Branch, Air Enforcement Section  
61 Forsyth Street  
Atlanta, Georgia 30303

Telephone: 404/562-9155, Fax: 404/562-9164

**13. Certification by Responsible Official (RO).** In addition to the professional engineering certification required for applications by Rule 62-4.050(3), F.A.C., any application form, report, compliance statement, compliance plan and compliance schedule submitted pursuant to Chapter 62-213, F.A.C., shall contain a certification signed by a responsible official that, based on information and belief formed after reasonable inquiry, the statements and information in the document are true, accurate, and complete. Any responsible official who fails to submit any required information or who has submitted incorrect information shall, upon becoming aware of such failure or incorrect submittal, promptly submit such supplementary information or correct information.  
[Rule 62-213.420(4), F.A.C.]

**Section III. Emissions Unit(s) and Conditions.**

**Subsection A. This section addresses the following emissions unit(s).**

<b>E.U. ID No.</b>	<b>Brief Description</b>
-001	170 MW Simple-Cycle Combustion Turbine
-002	170 MW Simple-Cycle Combustion Turbine
-003	170 MW Simple-Cycle Combustion Turbine

The emissions units addressed in this subsection are three dual-fuel nominal 170 megawatt (MW) General Electric PG7241FA combustion turbine-electrical generators with three 75-foot stacks. Emissions from the new CT's are controlled by Dry Low NO<sub>x</sub> (DLN-2.6) combustors when operating on natural gas, and wet injection when firing fuel oil. Inherently clean fuels and good combustion practices are employed to control all pollutants.

{Permitting note(s): The emissions units are regulated under Acid Rain, Phase II; NSPS - 40 CFR 60, Subpart GG, Standards of Performance for Stationary Gas Turbines, adopted and incorporated by reference in Rule 62-204.800(7), F.A.C.; Rule 62-212.400(5), F.A.C., Prevention of Significant Deterioration (PSD); Rule 62-212.400(6), F.A.C., Best Available Control Technology (BACT) Determination, dated December 28, 1999. Emissions Units -001 and -002 began operation in 2001, Emissions Unit -003 began operation in 2002.}

**The following specific conditions apply to the emissions unit(s) listed above:**

**Essential Potential to Emit (PTE) Parameters**

**A.1. Permitted Capacity.** The maximum heat input rates, based on the lower heating value (LHV) of each fuel to each Unit (1-3) at ambient conditions of 19°F temperature, 60% relative humidity, 100% load, and 14.7 psi pressure shall not exceed 1,709 million Btu per hour (MMBtu/hr) when firing natural gas, nor 1,942 MMBtu/hr when firing No. 2 or superior grade of distillate fuel oil. These maximum heat input rates will vary depending upon ambient conditions and the combustion turbine characteristics. Manufacturer's curves corrected for site conditions or equations for correction to other ambient conditions shall be provided to the Department of Environmental Protection (DEP) within 45 days of completing the initial compliance testing.  
[Rules 62-4.160(2) and 62-210.200(PTE), F.A.C.; and, PSD-FL-273]

**A.2. Emissions Unit Operating Rate Limitation After Testing.** See Specific Condition **A.31**.  
[Rule 62-297.310(2), F.A.C.]

**A.3. Methods of Operation. Fuels.**

Only pipeline natural gas or maximum 0.05 percent sulfur fuel oil No. 2 or superior grade of distillate fuel oil shall be fired in these units. [Applicant Request, Rule 62-210.200, F.A.C. (Definitions - Potential Emissions)] {Note: The limitation of this specific condition is more stringent than the NSPS sulfur dioxide limitation and thus assures compliance with 40 CFR 60.333 and 60.334}. The amount of back-up fuel (fuel oil) burned at the site (in BTU's) shall not exceed the amount of natural gas (primary fuel) burned at the site (in BTU's) during any consecutive 24-month period.

[Rules 62-212.400, 62-212.410, and 62-213.410, F.A.C.; and PSD-FL-273A, Specific Condition 14.]

**A.4. Hours of Operation.** Each stationary gas turbine shall only operate up to 3,000 hours in any consecutive twelve month period, of which up to 750 hours may be on fuel oil.

[Rule 62-210.200(PTE), F.A.C.; and, PSD-FL-273]

**Control Technology**

**A.5.** Dry Low NO<sub>x</sub> (DLN-2.6) combustors shall be installed on the stationary combustion turbine to control nitrogen oxides (NO<sub>x</sub>) emissions while firing natural gas.

[PSD-FL-273]

**A.6.** A water injection (WI) system shall be installed for use when firing No. 2 or superior grade distillate fuel oil for control of NO<sub>x</sub> emissions.

[PSD-FL-273]

**A.7.** The permittee shall provide manufacturer's emissions performance versus load diagrams for the DLN and wet injection systems prior to their installation. DLN systems shall each be tuned upon initial operation to optimize emissions reductions consistent with normal operation and maintenance practices and shall be maintained to minimize NO<sub>x</sub> emissions and CO emissions, consistent with normal operation and maintenance practices. Operation of the DLN systems in the diffusion-firing mode shall be minimized when firing natural gas.

[PSD-FL-273]

**Emission Limitations and Standards**

{Permitting note: Table 1-1, Summary of Air Pollutant Standards and Terms, summarizes information for convenience purposes only. This table does not supersede any of the terms or conditions of this permit.}



**A.8.** Pursuant to Rule 62-212.410, F.A.C., BACT, the maximum allowable emission limitations from each combustion turbine, when firing natural gas or No. 2 fuel oil, shall not exceed the following:

Nitrogen Oxides (NO<sub>x</sub>) Emissions:

- While firing Natural Gas: The emission rate of NO<sub>x</sub> in the exhaust gas shall not exceed 10.5 ppmvd @15% O<sub>2</sub> on a 24 hr block average as measured by the continuous emission monitoring system (CEMS). In addition, NO<sub>x</sub> emissions calculated as NO<sub>2</sub> shall not exceed 60 pounds per hour (at ISO conditions).
- While firing Fuel oil: The concentration of NO<sub>x</sub> in the exhaust gas shall not exceed 42 ppmvd at 15% O<sub>2</sub> on the basis of a 3-hr average as measured by the continuous emission monitoring system (CEMS). In addition, NO<sub>x</sub> emissions calculated as NO<sub>2</sub> shall not exceed 323 lb/hr (at ISO conditions) and 42 ppmvd @15% O<sub>2</sub> to be demonstrated by stack test.

The permittee shall develop a NO<sub>x</sub> reduction plan when the hours of oil firing on any individual combustion turbine reaches 750 hours. This plan shall include a testing protocol designed to establish the maximum water injection rate and the lowest NO<sub>x</sub> emissions possible without affecting the actual performance of the gas turbine. The testing protocol shall set a range of water injection rates and attempt to quantify the corresponding NO<sub>x</sub> emissions for each rate and noting any problems with performance. Based on the test results, the plan shall recommend a new NO<sub>x</sub> emissions limiting standard and shall be submitted to the Department's Bureau of Air Regulation and Compliance Authority for review. If the Department determines that a lower NO<sub>x</sub> emissions standard is warranted for oil firing, this permit shall be revised.

Carbon Monoxide (CO) Emissions: The concentration of CO in the stack exhaust gas shall exceed neither 10.5 ppmvd and 36.2 lb/hr (at ISO conditions) while firing gas and neither 20 ppmvd and 70.0 lb/hr (at ISO conditions) while firing oil. The permittee shall demonstrate compliance with these limits by stack test using EPA Method 10.

Volatile Organic Compounds (VOC) Emissions: The concentration of VOC in the stack exhaust gas with the combustion turbine operating on natural gas shall exceed neither 1.5 ppmvw nor 3.0 lb/hr (ISO conditions) and neither 3.7 ppmvw nor 8.0 lb/hr (ISO conditions) while operating on oil to be demonstrated by initial stack test using EPA Method 18, 25 or 25A.

Sulfur Dioxide (SO<sub>2</sub>) Emissions: SO<sub>2</sub> emissions shall be limited by firing pipeline natural gas (sulfur content less than 2 grains per 100 standard cubic foot) or by firing No. 2 or superior grade distillate fuel oil with a maximum 0.05 percent sulfur for 750 hours per year per unit. Emissions of SO<sub>2</sub> (at ISO conditions) shall not exceed 1.1 lb/hr (natural gas) and 104.3 lb/hr (fuel oil) as measured by applicable compliance methods described below.

Particulate Matter (PM/PM<sub>10</sub>) PM/PM<sub>10</sub> emissions shall not exceed 18.0 lb/hr when operating on natural gas and shall not exceed 34.0 lb/hr when operating on fuel oil. Visible emissions testing shall serve as a surrogate for PM/PM<sub>10</sub> compliance testing.

Visible Emissions (VE): VE emissions shall serve as a surrogate for PM/PM<sub>10</sub> emissions and shall not exceed 10 percent opacity.

[PSD-FL-273]

### Excess Emissions

**A.9.** Excess emissions resulting from startup, shutdown or malfunction of any emissions unit shall be permitted provided (1) best operational practices to minimize emissions are adhered to and (2) the duration of excess emissions shall be minimized but in no case exceed two hours in any 24 hour period unless specifically authorized by the Department for longer duration. Operation below 50% output shall be limited to 2 hours per unit cycle (breaker closed to breaker open).

[Rule 62-210.700(1), F.A.C.; and, PSD-FL-273]

**A.10.** Excess emissions which are caused entirely or in part by poor maintenance, poor operation, or any other equipment or process failure which may reasonably be prevented during startup, shutdown or malfunction shall be prohibited. These emissions shall be included in the 24-hr average for NO<sub>x</sub>.

[Rule 62-210.700(4), F.A.C.; and, PSD-FL-273]

**A.11.** Considering operational variations in types of industrial equipment operations affected by this rule, the Department may adjust maximum and minimum factors to provide reasonable and practical regulatory controls consistent with the public interest.

[Rule 62-210.700(5), F.A.C.]

{Permitting note: The Excess Emissions Rule at Rule 62-210.700, F.A.C., cannot vary any requirement of a NSPS, NESHAP, or Acid Rain program provision.}

### Monitoring of Operations

**A.12.** At all times, including periods of startup, shutdown and malfunction, owners and operators shall, to the extent practicable, maintain and operate any affected facility including associated pollution control equipment in a manner consistent with good air pollution control practice for minimizing emissions. Determination of whether acceptable operating and maintenance procedures are being used will be based on information available to the Administrator which may include, but is not limited to, monitoring results, opacity observations, review of operating and maintenance procedures, and inspection of the source.

[40 CFR 60.11(d)]

**A.13.** Continuous Monitoring System: The permittee shall install, calibrate, maintain, and operate a continuous emission monitor in the stack to measure and record the nitrogen oxides emissions from these units. Upon request from EPA or DEP, the CEMS emission rates for NO<sub>x</sub> on these Units shall be corrected to ISO conditions to demonstrate compliance with the NO<sub>x</sub> standard established in 40 CFR 60.332.

[PSD-FL-273]

**A.14.** The owner or operator of any stationary gas turbine subject to the provisions of 40 CFR 60, Subpart GG and using water injection to control NO<sub>x</sub> emissions shall operate a continuous monitoring system to monitor and record the fuel consumption and the ratio of water to fuel being fired in the turbine. This system shall be accurate to within  $\pm 5.0$  percent and shall be approved by the Administrator. The NO<sub>x</sub> CEMS shall be used in lieu of the water/fuel monitoring system for reporting excess emissions in accordance with 40 CFR 60.334(c)(1), Subpart GG (1998 version). The calibration of the water/fuel monitoring device required in 40 CFR 60.335 (c)(2) (1998 version) will be replaced by the 40 CFR 75 certification tests of the NO<sub>x</sub> CEMS.  
[40 CFR 60.334(a); and, PSD-FL-273]

**A.15.** The owner or operator of any stationary gas turbine subject to the provisions of 40 CFR 60, Subpart GG shall monitor sulfur content of the fuel being fired in the turbine. The frequency of determination of these values shall be as follows:

- (1) If the turbine is supplied its fuel from a bulk storage tank, the values shall be determined on each occasion that fuel is transferred to the storage tank from any other source.
- (2) If the turbine is supplied its fuel without intermediate bulk storage the values shall be determined and recorded daily. Owners, operators or fuel vendors may develop custom schedules for determination of the values based on the design and operation of the affected facility and the characteristics of the fuel supply. These custom schedules shall be substantiated with data and must be approved by the Administrator before they can be used to comply with 40 CFR 60.334(b).

See Specific Conditions **A.28.** and **A.29.**

[40 CFR 60.334(b)(1) & (2); and PSD-FL-273A, Specific Condition 46.]

**A.16. Determination of Process Variables.**

(a) **Required Equipment.** The owner or operator of an emissions unit for which compliance tests are required shall install, operate, and maintain equipment or instruments necessary to determine process variables, such as process weight input or heat input, when such data are needed in conjunction with emissions data to determine the compliance of the emissions unit with applicable emission limiting standards.

(b) **Accuracy of Equipment.** Equipment or instruments used to directly or indirectly determine process variables, including devices such as belt scales, weight hoppers, flow meters, and tank scales, shall be calibrated and adjusted to indicate the true value of the parameter being measured with sufficient accuracy to allow the applicable process variable to be determined within 10% of its true value.

[Rule 62-297.310(5), F.A.C.]

### Test Methods and Procedures

{Permitting note: Table 2-1, Summary of Compliance Requirements, summarizes information for convenience purposes only. This table does not supersede any of the terms or conditions of this permit.}

**A.17.** To compute the nitrogen oxides emissions, the owner or operator shall use analytical methods and procedures that are accurate to within 5 percent and are approved by the Department to determine the nitrogen content of the fuel being fired. **This requirement is satisfied through the use of the nitrogen oxides continuous emissions monitor.** See Specific Condition **A.38**.  
[40 CFR 60.335(a); and, guidance from EPA Region 4 dated May 26, 2000]

**A.18.** During performance tests to determine compliance, measured NO<sub>x</sub> emissions at 15 percent oxygen will be adjusted to ISO ambient atmospheric conditions by the following correction factor:

$$NO_x = [NO_x \text{ obs}] [(P_{ref})^{0.5} / P_{obs}] e^{19 [H_{obs} - 0.00633]} [288^\circ K / T_{amb}] 1.53$$

where:

NO<sub>x</sub> = Emissions of NO<sub>x</sub> at 15 percent oxygen and ISO standard ambient conditions.

NO<sub>x</sub> obs = Measured NO<sub>x</sub> emission at 15 percent oxygen, ppmv.

P<sub>ref</sub> = Reference combustor inlet absolute pressure at 101.3 kilopascals ambient pressure.

P<sub>obs</sub> = Measured combustor inlet absolute pressure at test ambient pressure.

e = Transcendental constant ( 2.718 )

H<sub>obs</sub> = Specific humidity of ambient air at test.

T<sub>amb</sub> = Temperature of ambient air at test.

See Specific Condition **A.38**.

[40 CFR 60.335(c)(1)]

**A.19.** When determining compliance with 40 CFR 60.332, Subpart GG - Standards of Performance for Stationary Gas Turbines, the monitoring device of 60.334(a) shall be used to determine the fuel consumption and the water-to-fuel ratio necessary to comply with the permitted NO<sub>x</sub> standard at 30, 50, 75, and 100 percent of peak load or at four points in the normal operating range of the gas turbine, including the minimum point in the range and peak load. All loads shall be corrected to ISO conditions using the appropriate equations supplied by the manufacturer. See Specific Condition **A.14**.

[40 CFR 60.335(c)(2)]

**A.20.** The owner or operator shall determine compliance with the nitrogen oxides and sulfur dioxide standards in 40 CFR 60.332 as follows:

c. U.S. EPA Method 20 (40 CFR 60, Appendix A) shall be used to determine the nitrogen oxides, sulfur dioxide, and oxygen concentrations. The span values shall be 300 ppm of nitrogen oxide and 21 percent oxygen. The NO<sub>x</sub> emissions shall be determined at each of the load conditions specified in 40 CFR 60.335(c)(2). See Specific Condition **A.38**.

[40 CFR 60.335(c)(3)]

**A.21.** Initial performance tests (for both fuels) shall be performed on each unit while firing natural gas as well as while firing oil. The Department may require the permittee to conduct additional tests after major replacement or repair of any air pollution control equipment, such as the water injection system, DLN combustors, etc. The following reference methods shall be used. No other test methods may be used for compliance testing unless prior DEP approval is received in writing.  
[PSD-FL-273A, Specific Condition 29.]

**A.22. Volatile Organic Compounds.** The initial test method for volatile organic compounds shall be EPA Method 18, 25 and/or 25A, incorporated by reference in Chapter 62-297, F.A.C. An initial test is required to demonstrate compliance with the VOC emission limit. Thereafter, the CO emission limit and periodic tuning data will be employed as surrogate and no annual testing is required.  
[PSD-FL-273]

**A.23. Carbon Monoxide.** The initial and annual test method for carbon monoxide shall be EPA Method 10, incorporated by reference in Chapter 62-297, F.A.C. An initial test for CO shall be conducted concurrently with the initial NO<sub>x</sub> test, as required. The initial NO<sub>x</sub> and CO test results shall be the average of three valid one-hour runs. Annual compliance testing for CO may be conducted at less than capacity when compliance testing is conducted concurrent with the annual RATA testing for the NO<sub>x</sub> CEMS required pursuant to 40 CFR 75.  
[PSD-FL-273]

**A.24. PM/PM<sub>10</sub>.** Visible emissions testing shall serve as a surrogate for PM/PM<sub>10</sub> compliance testing.  
[PSD-FL-273]

**A.25. Nitrogen Oxides.** The initial and annual test method for NO<sub>x</sub> shall be EPA Method 20 or EPA Method 7E, incorporated by reference in Chapter 62-297, F.A.C. Initial test only for compliance with 40CFR60 Subpart GG and short-term NO<sub>x</sub> BACT limits (EPA reference Method 7E, "Determination of Nitrogen Oxides Emissions from Stationary Sources" or RATA test data may be used to demonstrate compliance for annual test requirements). Annual compliance demonstration via EPA Method 7E shall not be required upon satisfactory demonstration that the emission unit is operating at 9 ppmvd NO<sub>x</sub> emissions or less. This demonstration shall consist of an average of each of all valid CEMS 24-hour block average compliance periods (described in Specific Condition **A.35.**) for which the unit operated on natural gas since the last compliance test requirement. This demonstration shall be provided within the test notification letter (described in Specific Condition **A.37.**), but does not relieve the permittee of the annual CEMS RATA requirement.  
[PSD-FL-273]

**A.26.** The owner or operator shall determine compliance with the liquid fuel sulfur content standard of 0.05 percent, by weight, and the gaseous fuel sulfur dioxide standard as follows: ASTM D 2880-96, or the latest edition shall be used to determine the sulfur content of liquid fuels and ASTM D 1072-90(94)E-1, D 3031-81(86), D 4084-94, or D 3246-92, or the latest edition, shall be used for the sulfur content of gaseous fuels (incorporated by reference-see 40 CFR 60.17). The applicable ranges of some ASTM methods mentioned above are not adequate to measure the levels of sulfur in some fuel gases. Dilution of samples before analysis (with verification of the dilution ratio) may be used, subject to the approval of the Administrator. See Specific Condition **A.27**.  
[40 CFR 60.335(d)]

**A.27. SO<sub>2</sub> and PM/PM<sub>10</sub>.** Notwithstanding the requirements of Rule 62-297.340, F.A.C., the use of pipeline natural gas, is the method for determining compliance for SO<sub>2</sub> and PM<sub>10</sub>. For the purposes of demonstrating compliance with the 40 CFR 60.333 SO<sub>2</sub> standard, ASTM methods D4084-82 or D3246-81 (or equivalent) for sulfur content of gaseous fuel shall be utilized in accordance with the EPA-approved custom fuel monitoring schedule or natural gas supplier data may be submitted or the natural gas sulfur content referenced in 40 CFR 75 Appendix D may be utilized. However, the applicant is responsible for ensuring that the procedures in 40 CFR 60.335 or 40 CFR 75 are used when determination of fuel sulfur content is made. Analysis may be performed by the owner or operator, a service contractor retained by the owner or operator, the fuel vendor, or any other qualified agency pursuant to 40 CFR 60.335(e) (1998 version).  
[PSD-FL-273]

**A.28. Natural Gas Monitoring Schedule.** A custom fuel monitoring schedule pursuant to 40 CFR 75 Appendix D for natural gas may be used in lieu of the daily sampling requirements of 40 CFR 60.334 (b)(2), see Specific Condition **A.15.**, provided the following requirements are met:

- The permittee shall apply for an Acid Rain permit within the deadlines specified in 40 CFR 72.30.
- The permittee shall submit a monitoring plan, certified by signature of the Designated Representative, that commits to using a primary fuel of pipeline supplied natural gas (sulfur content less than 2 gr/100 scf pursuant to 40 CFR 75.11(d)(2)).
- Each unit shall be monitored for SO<sub>2</sub> emissions using methods consistent with the requirements of 40 CFR 75 and certified by the USEPA.

This custom fuel monitoring schedule will only be valid when pipeline natural gas is used as a primary fuel. If the primary fuel for these units is changed to a higher sulfur fuel, SO<sub>2</sub> emissions must be accounted for as required pursuant to 40 CFR 75.11(d).  
[PSD-FL-273]

**A.29. Fuel Oil Monitoring Schedule.** The following monitoring schedule for No. 2 or superior grade fuel oil shall be followed: For all bulk shipments of No. 2 fuel oil received at this facility an analysis which reports the sulfur content of the fuel shall be provided by the fuel vendor. The analysis shall also specify the methods by which the analyses were conducted and shall comply with the requirements of 40 CFR 60.335(d). See Specific Condition **A.26**.  
[PSD-FL-273A, Specific Condition 46.]

**A.30. Visible Emissions.** The initial and annual test method for visible emissions shall be EPA Method 9, incorporated by reference in Chapter 62-297, F.A.C. [PSD-FL-273]

**A.31. Operating Rate During Testing.** Testing of emissions shall be conducted with the combustion turbine operating at permitted capacity. Permitted capacity is defined as 90-100 percent of the maximum heat input rate allowed by the permit, corrected for the average ambient air temperature during the test (with 100 percent represented by a curve depicting heat input vs. ambient temperature). If it is impracticable to test at permitted capacity, the source may be tested at less than permitted capacity. In this case, subsequent operation is limited by adjusting the entire heat input vs. ambient temperature curve downward by an increment equal to the difference between the maximum permitted heat input (corrected for ambient temperature) and 110 percent of the value reached during the test until a new test is conducted. Once the unit is so limited, operation at higher capacities is allowed for no more than 15 consecutive days for the purposes of additional compliance testing to regain the permitted capacity. Procedures for these tests shall meet all applicable requirements (i.e., testing time frequency, minimum compliance duration, etc.) of Chapters 62-204 and 62-297, F.A.C. [Rule 62-297.310(2), F.A.C.; and, PSD-FL-273]

**A.32.** Performance tests shall be conducted under such conditions as the Administrator shall specify to the plant operator based on representative performance of the affected facility. The owner or operator shall make available to the Administrator such records as may be necessary to determine the conditions of the performance tests. Operations during periods of startup, shutdown, and malfunction shall not constitute representative conditions for the purpose of a performance test nor shall emissions in excess of the level of the applicable emission limit during periods of startup, shutdown, and malfunction be considered a violation of the applicable emission limit unless otherwise specified in the applicable standard. [40 CFR 60.8(c)]

**A.33. Required Number of Test Runs.** For mass emission limitations, a compliance test shall consist of three complete and separate determinations of the total air pollutant emission rate through the test section of the stack or duct and three complete and separate determinations of any applicable process variables corresponding to the three distinct time periods during which the stack emission rate was measured provided, however, that three complete and separate determinations shall not be required if the process variables are not subject to variation during a compliance test, or if three determinations are not necessary in order to calculate the unit's emission rate. The three required test runs shall be completed within one consecutive five day period. In the event that a sample is lost or one of the three runs must be discontinued because of circumstances beyond the control of the owner or operator, and a valid third run cannot be obtained within the five day period allowed for the test, the Secretary or his or her designee may accept the results of the two complete runs as proof of compliance, provided that the arithmetic mean of the results of the two complete runs is at least 20 percent below the allowable emission limiting standards. [Rule 62-297.310(1), F.A.C.]

**A.34. Calculation of Emission Rate.** The indicated emission rate or concentration shall be the arithmetic average of the emission rate or concentration determined by each of the three separate test runs unless otherwise specified in a particular test method or applicable rule.  
[Rule 62-297.310(3), F.A.C.]

**A.35. Applicable Test Procedures.**

(a) Required Sampling Time.

1. Unless otherwise specified in the applicable rule, the required sampling time for each test run shall be no less than one hour and no greater than four hours, and the sampling time at each sampling point shall be of equal intervals of at least two minutes.

2. Opacity Compliance Tests. When either EPA Method 9 or DEP Method 9 is specified as the applicable opacity test method, the required minimum period of observation for a compliance test shall be sixty (60) minutes for emissions units which emit or have the potential to emit 100 tons per year or more of particulate matter, and thirty (30) minutes for emissions units which have potential emissions less than 100 tons per year of particulate matter and are not subject to a multiple-valued opacity standard. The opacity test observation period shall include the period during which the highest opacity emissions can reasonably be expected to occur. Exceptions to these requirements are as follows:

c. The minimum observation period for opacity tests conducted by employees or agents of the Department to verify the day-to-day continuing compliance of a unit or activity with an applicable opacity standard shall be twelve minutes.

(b) Minimum Sample Volume. Unless otherwise specified in the applicable rule, the minimum sample volume per run shall be 25 dry standard cubic feet.

(c) Required Flow Rate Range. For EPA Method 5 particulate sampling, acid mist/sulfur dioxide, and fluoride sampling which uses Greenburg Smith type impingers, the sampling nozzle and sampling time shall be selected such that the average sampling rate will be between 0.5 and 1.0 actual cubic feet per minute, and the required minimum sampling volume will be obtained.

(d) Calibration of Sampling Equipment. Calibration of the sampling train equipment shall be conducted in accordance with the schedule shown in Table 297.310-1, attached to this permit.

[Rule 62-297.310(4), F.A.C.]

**A.36.** The permittee shall comply with the requirements contained in APPENDIX SS-1, Stack Sampling Facilities, attached to this permit.

[Rule 62-297.310(6), F.A.C.]



**Reliant Energy Osceola, L.L.C. Facility**

Page 17

**A.37. Frequency of Compliance Tests.** The following provisions apply only to those emissions units that are subject to an emissions limiting standard for which compliance testing is required.

(a) General Compliance Testing.

3. The owner or operator of an emissions unit that is subject to any emission limiting standard shall conduct a compliance test that demonstrates compliance with the applicable emission limiting standard prior to obtaining a renewed operation permit. Emissions units that are required to conduct an annual compliance test may submit the most recent annual compliance test to satisfy the requirements of this provision. In renewing an air operation permit pursuant to Rule 62-210.300(2)(a)3.b., c., or d., F.A.C., the Department shall not require submission of emission compliance test results for any emissions unit that, during the year prior to renewal:

- a. Did not operate; or
- b. In the case of a fuel burning emissions unit, burned liquid and/or solid fuel for a total of no more than 400 hours.

4. During each federal fiscal year (October 1 - September 30), unless otherwise specified by rule, order, or permit, the owner or operator of each emissions unit shall have a formal compliance test conducted for:

- a. Visible emissions, if there is an applicable standard;
- b. Each of the following pollutants, if there is an applicable standard, and if the emissions unit emits or has the potential to emit: 5 tons per year or more of lead or lead compounds measured as elemental lead; 30 tons per year or more of acrylonitrile; or 100 tons per year or more of any other regulated air pollutant; and
- c. Each NESHAP pollutant, if there is an applicable emission standard.

5. An annual compliance test for particulate matter emissions shall not be required for any fuel burning emissions unit that, in a federal fiscal year, does not burn liquid and/or solid fuel, other than during startup, for a total of more than 400 hours.

8. Any combustion turbine that does not operate for more than 400 hours per year shall term of its air operation permit.

9. The owner or operator shall notify the Department, at least 15 days prior to the date on which each formal compliance test is to begin, of the date, time, and place of each such test, and the test contact person who will be responsible for coordinating and having such test conducted for the owner or operator.

(b) Special Compliance Tests. When the Department, after investigation, has good reason (such as complaints, increased visible emissions or questionable maintenance of control equipment) to believe that any applicable emission standard contained in a Department rule or in a permit issued pursuant to those rules is being violated, it may require the owner or operator of the emissions unit to conduct compliance tests which identify the nature and quantity of pollutant emissions from the emissions unit and to provide a report on the results of said tests to the Department.

(c) Waiver of Compliance Test Requirements. If the owner or operator of an emissions unit that is subject to a compliance test requirement demonstrates to the Department, pursuant to the procedure established in Rule 62-297.620, F.A.C., that the compliance of the emissions unit with an applicable weight emission limiting standard can be adequately determined by means other than the designated test procedure, such as specifying a surrogate standard of no visible emissions for particulate matter sources equipped with a bag house or specifying a fuel analysis for sulfur dioxide emissions, the Department

shall waive the compliance test requirements for such emissions units and order that the alternate means of determining compliance be used, provided, however, the provisions of Rule 62-297.310(7)(b), F.A.C., shall apply.

[Rule 62-297.310(7), F.A.C.; and, SIP approved]

### **Continuous Monitoring Requirements**

**A.38. Continuous compliance with the NO<sub>x</sub> emission limits.** Continuous compliance with the NO<sub>x</sub> emission limits shall be demonstrated with the CEM system based on the applicable averaging time of 24-hr block average (DLN). Based on CEMS data, a separate compliance determination is conducted at the end of each operating day and a new average emission rate is calculated from the arithmetic average of all valid hourly emission rates from the previous operating day. A valid hourly emission rate shall be calculated for each hour in which at least two NO<sub>x</sub> concentrations are obtained at least 15 minutes apart. Valid hourly emission rates shall not include periods of start up, shutdown, or malfunction unless prohibited by 62-210.700 F.A.C. These excess emissions periods shall be reported as required in Conditions **A.9.** and **A.10.**

[PSD-FL-273]

**A.39.** A performance evaluation of the CEMS shall be conducted during any required performance test or within 30 days thereafter in accordance with the applicable performance specifications of 40 CFR 60, Appendix B and at other times as required by the Administrator.

[40 CFR 60.13(c)]

**A.40.** The zero (or low-level value between 0 and 20 percent of span value) and span (50 to 100 percent of span value) calibration drifts shall be checked at least once daily in accordance with a written procedure. The zero and span shall, at a minimum, be adjusted whenever the 24-hour zero drift or 24-hour span drift exceeds two times the limits of the applicable performance specifications of 40 CFR 60, Appendix B. The system must allow the amount of excess zero and span drift measured at the 24-hour interval checks to be recorded and quantified.

[40 CFR 60.13(d)(1)]

**A.41.** Reserved.

**A.42.** Except for system breakdowns, repairs, calibration checks, and zero and span adjustments required under 40 CFR 60.13(d), all continuous monitoring systems (CMS) shall be in continuous operation and shall meet minimum frequency of operation requirements as follows:

(2) All continuous monitoring systems referenced by 40 CFR 60.13(c) for measuring emissions, except opacity, shall complete a minimum of one cycle of operation (sampling, analyzing, and data recording) for each successive 15-minute period.

[40 CFR 60.13(e)(2)]

**A.43.** All continuous monitoring systems (CMS) or monitoring devices shall be installed such that representative measurements of emissions or process parameters from the affected facility are obtained. Additional procedures for location of continuous monitoring systems contained in the applicable Performance Specifications of Appendix B of 40 CFR 60 shall be used.

[40 CFR 60.13(f)]

**A.44.** For continuous monitoring systems other than opacity, 1-hour averages shall be computed from four or more data points equally spaced over each 1-hour period. Data recorded during periods of continuous monitoring system breakdown, repairs, calibration checks, and zero and span adjustments shall not be included in the data averages computed under this paragraph. An arithmetic or integrated average of all data may be used. The data may be recorded in reduced or non-reduced form (e.g. ppm pollutant and percent O<sub>2</sub> or ng/J of pollutant). All excess emissions shall be converted into units of the standard using the applicable conversion procedures specified in the subparts. After conversion into units of the standard, the data may be rounded to the same number of significant digits as used in the applicable subparts to specify the emission limit. (e.g. rounded to the nearest 1 percent opacity).

[40 CFR 60.13(h)]

**Record Keeping and Reporting Requirements**

**A.45.** The owner or operator subject to the provisions of 40 CFR 60 shall furnish the Administrator written notification as follows:

(4) A notification of any physical or operational change to an existing facility which may increase the emission rate of any air pollutant to which a standard applies, unless that change is specifically exempted under an applicable subpart or in 40 CFR 60.14(e). This notice shall be postmarked 60 days or as soon as practicable before the change is commenced and shall include information describing the precise nature of the change, present and proposed emission control systems, productive capacity of the facility before and after the change, and the expected completion date of the change. The Administrator may request additional relevant information subsequent to this notice.

[40 CFR 60.7(a)(4)]

**A.46. Excess Emissions Report.** If excess emissions occur due to malfunction, the owner or operator shall notify DEP's Central District within (1) working day of: the nature, extent, and duration of the excess emissions; the cause of the excess emissions; and the actions taken to correct the problem. In addition, the Department may request a written summary report of the incident. Following the NSPS format, 40 CFR 60.7 Subpart A, periods of startup, shutdown, malfunction, shall be monitored, recorded, and reported as excess emissions when emission levels exceed the permitted standards listed in Specific Condition **A.8.**

[PSD-FL-273]

**A.47.** The owner or operator subject to the provisions of 40 CFR 60 shall maintain records of the occurrence and duration of any startup, shutdown, or malfunction in the operation of an affected facility; any malfunction of the air pollution control equipment; or, any periods during which a continuous monitoring system or monitoring device is inoperative.

[40 CFR 60.7(b)]

**A.48.** For the purpose of reports required under 40 CFR 60.7(c), periods of excess emissions that shall be reported are defined as follows:

Nitrogen oxides. Any one-hour period during which the average water-to-fuel ratio, as measured by the continuous monitoring system, falls below the water-to-fuel ratio determined to demonstrate compliance with the permitted nitrogen oxide standard by the initial performance test required in 40 CFR 60.8 or any period during which the fuel-bound nitrogen of the fuel is greater than the maximum nitrogen content allowed by the fuel-bound nitrogen allowance used during the initial performance test. Each report shall include the average water-to-fuel ratio, average fuel consumption, ambient conditions, gas turbine load, and nitrogen content of the fuel during the period of excess emissions, and the graphs or figures developed under 40 CFR 60.335(a). See Specific Condition **A.14.**

[Rule 62-296.800, F.A.C.; and, 40 CFR 60.334(c)(1)]

**A.49.** The owner or operator required to install a continuous monitoring system (CMS) or monitoring device shall submit an excess emissions and monitoring systems performance report (excess emissions are defined in applicable subparts) and/or a summary report form [see 40 CFR 60.7(d)] to the Administrator semiannually, except when: more frequent reporting is specifically required by an applicable subpart; or, the CMS data are to be used directly for compliance determination, in which case quarterly reports shall be submitted; or, the Administrator, on a case-by-case basis, determines that more frequent reporting is necessary to accurately assess the compliance status of the source. All reports shall be postmarked by the 30th day following the end of each calendar half (or quarter, as appropriate).

Written reports of excess emissions shall include the following information:

- (1) The magnitude of excess emissions computed in accordance with 40 CFR 60.13(h), any conversion factor(s) used, and the date and time of commencement and completion of each time period of excess emissions. The process operating time during the reporting period.
- (2) Specific identification of each period of excess emissions that occurs during startups, shutdowns, and malfunctions of the affected facility. The nature and cause of any malfunction (if known), the corrective action taken or preventative measures adopted.
- (3) The date and time identifying each period during which the continuous monitoring system was inoperative except for zero and span checks and the nature of the system repairs or adjustments.
- (4) When no excess emissions have occurred or the continuous monitoring system(s) have not been inoperative, repaired, or adjusted, such information shall be stated in the report.

[40 CFR 60.7(c)(1), (2), (3), & (4)]

**A.50.** The summary report form shall contain the information and be in the format shown in Figure 1 (attached) unless otherwise specified by the Administrator. One summary report form shall be submitted for each pollutant monitored at each affected facility.

- (1) If the total duration of excess emissions for the reporting period is less than 1 percent of the total operating time for the reporting period and CMS downtime for the reporting period is less than 5 percent of the total operating time for the reporting period, only the summary report form shall be submitted and the excess emission report described in 40 CFR 60.7(c) need not be submitted unless requested by the Administrator.
- (2) If the total duration of excess emissions for the reporting period is 1 percent or greater of the total operating time for the reporting period or the total CMS downtime for the reporting period is 5 percent or greater of the total operating time for the reporting period, the summary report form and the excess emission report described in 40 CFR 60.7(c) shall both be submitted.

[40 CFR 60.7(d)(1) & (2)]

**A.51.** (1) Notwithstanding the frequency of reporting requirements specified in 40 CFR 60.7(c), an owner or operator who is required by an applicable subpart to submit excess emissions and monitoring systems performance reports (and summary reports) on a quarterly (or more frequent) basis may reduce the frequency of reporting for that standard to semiannual if the following conditions are met:

- (i) For 1 full year (e.g., 4 quarterly or 12 monthly reporting periods) the affected facility's excess emissions and monitoring systems reports submitted to comply with a standard under this part continually demonstrate that the facility is in compliance with the applicable standard;
- (ii) The owner or operator continues to comply with all recordkeeping and monitoring requirements specified in 40 CFR 60, Subpart A, and the applicable standard; and
- (iii) The Administrator does not object to a reduced frequency of reporting for the affected facility, as provided in 40 CFR 60.7(e)(2).

(2) The frequency of reporting of excess emissions and monitoring systems performance (and summary) reports may be reduced only after the owner or operator notifies the Administrator in writing of his or her intention to make such a change and the Administrator does not object to the intended change. In deciding whether to approve a reduced frequency of reporting, the Administrator may review information concerning the source's entire previous performance history during the required recordkeeping period prior to the intended change, including performance test results, monitoring data, and evaluations of an owner or operator's conformance with operation and maintenance requirements. Such information may be used by the Administrator to make a judgment about the source's potential for noncompliance in the future. If the Administrator disapproves the owner or operator's request to reduce the frequency of reporting, the Administrator will notify the owner or operator in writing within 45 days after receiving notice of the owner or operator's intention. The notification from the Administrator to the owner or operator will specify the grounds on which the disapproval is based. In the absence of a notice of disapproval within 45 days, approval is automatically granted.

(3) As soon as monitoring data indicate that the affected facility is not in compliance with any emission limitation or operating parameter specified in the applicable standard, the frequency of reporting shall revert to the frequency specified in the applicable standard, and the owner or operator shall submit an excess emissions and monitoring systems performance report (and summary report, if required) at the next appropriate reporting period following the noncomplying event. After demonstrating compliance with the applicable standard for another full year, the owner or operator may again request approval from the Administrator to reduce the frequency of reporting for that standard as provided for in 40 CFR 60.7(e)(1) and (e)(2).

[40 CFR 60.7(e)]

**A.52. CEMS for reporting excess emissions:** Periods when NO<sub>x</sub> emissions (ppmvd @ 15% oxygen) are above the BACT standards, listed in Specific Condition **A.8.**, shall be reported to the DEP Central District within one working day (verbally) followed up by a written explanation not later than three (3) working days (alternatively by facsimile within one working day).

[PSD-FL-273]

**A.53. Malfunction Reporting.** In the case of excess emissions resulting from malfunctions, each owner or operator shall notify the Department in accordance with Rule 62-4.130, F.A.C. A full written report on the malfunctions shall be submitted in a quarterly report, if requested by the Department.

[Rule 62-210.700(6), F.A.C.]

**A.54.** All recorded data shall be maintained on file by the Source for a period of five years.  
[Rule 62-213.440, F.A.C.]

**A.55.** Any owner or operator subject to the provisions of 40 CFR 60 shall maintain a file of all measurements, including continuous monitoring system, monitoring device, and performance testing measurements; all continuous monitoring system performance evaluations; all continuous monitoring system or monitoring device calibration checks; adjustments and maintenance performed on these systems or devices; and, all other information required by 40 CFR 60 recorded in a permanent form suitable for inspection.  
[40 CFR 60.7(f)]

**A.56. Hours of Operation and Fuel Usage:** Reliant shall maintain records on-site of each CT's "hours of operation by fuel type" and "BTU input by fuel type" for each month. These shall be tabulated for each consecutive 12-month period (as per specific permit conditions identified herein) and made available upon request for Department use. Additionally, this data shall be submitted annually with the AOR.  
[PSD-FL-273]

**A.57. Test Reports.**

- (a) The owner or operator of an emissions unit for which a compliance test is required shall file a report with the Department on the results of each such test.
- (b) The required test report shall be filed with the Department as soon as practical but no later than 45 days after the last sampling run of each test is completed.
- (c) The test report shall provide sufficient detail on the emissions unit tested and the test procedures used to allow the Department to determine if the test was properly conducted and the test results properly computed. As a minimum, the test report, other than for an EPA or DEP Method 9 test, shall provide the following information:
1. The type, location, and designation of the emissions unit tested.
  2. The facility at which the emissions unit is located.
  3. The owner or operator of the emissions unit.
  4. The normal type and amount of fuels used and materials processed, and the types and amounts of fuels used and material processed during each test run.
  5. The means, raw data and computations used to determine the amount of fuels used and materials processed, if necessary to determine compliance with an applicable emission limiting standard.
  6. The type of air pollution control devices installed on the emissions unit, their general condition, their normal operating parameters (pressure drops, total operating current and GPM scrubber water), and their operating parameters during each test run.
  7. A sketch of the duct within 8 stack diameters upstream and 2 stack diameters downstream of the sampling ports, including the distance to any upstream and downstream bends or other flow disturbances.
  8. The date, starting time and duration of each sampling run.

9. The test procedures used, including any alternative procedures authorized pursuant to Rule 62-297.620, F.A.C. Where optional procedures are authorized in this chapter, indicate which option was used.
10. The number of points sampled and configuration and location of the sampling plane.
11. For each sampling point for each run, the dry gas meter reading, velocity head, pressure drop across the stack, temperatures, average meter temperatures and sample time per point.
12. The type, manufacturer and configuration of the sampling equipment used.
13. Data related to the required calibration of the test equipment.
14. Data on the identification, processing and weights of all filters used.
15. Data on the types and amounts of any chemical solutions used.
16. Data on the amount of pollutant collected from each sampling probe, the filters, and the impingers, are reported separately for the compliance test.
17. The names of individuals who furnished the process variable data, conducted the test, analyzed the samples and prepared the report.
18. All measured and calculated data required to be determined by each applicable test procedure for each run.
19. The detailed calculations for one run that relate the collected data to the calculated emission rate.
20. The applicable emission standard, and the resulting maximum allowable emission rate for the emissions unit, plus the test result in the same form and unit of measure.
21. A certification that, to the knowledge of the owner or his authorized agent, all data submitted are true and correct. When a compliance test is conducted for the Department or its agent, the person who conducts the test shall provide the certification with respect to the test procedures used. The owner or his authorized agent shall certify that all data required and provided to the person conducting the test are true and correct to his knowledge.

[Rules 62-213.440 and 62-297.310(8), F.A.C.]

### **Miscellaneous Requirements.**

**A.58. Definitions.** For the purposes of Rule 62-204.800(7), F.A.C., the definitions contained in the various provisions of 40 CFR 60, shall apply except that the term "Administrator" when used in 40 CFR 60, shall mean the Secretary or the Secretary's designee.

[40 CFR 60.2; and, Rule 62-204.800(7)(a), F.A.C.]

**A.59. Circumvention.** No owner or operator subject to the provisions of 40 CFR 60 shall build, erect, install, or use any article, machine, equipment or process, the use of which conceals an emission which would otherwise constitute a violation of an applicable standard. Such concealment includes, but is not limited to, the use of gaseous diluents to achieve compliance with an opacity standard or with a standard which is based on the concentration of a pollutant in the gases discharged to the atmosphere.

[40 CFR 60.12]



**Section IV. This section is the Acid Rain Part.**

**Operated by:** Reliant Energy Osceola, L.L.C.  
**ORIS code:** 55192

**Subsection A. This subsection addresses Acid Rain, Phase II.**

The emissions units listed below are regulated under Phase II of the Acid Rain Program.

<b>E.U. ID No.</b>	<b>Brief Description</b>
-001	170 MW Simple-Cycle Combustion Turbine
-002	170 MW Simple-Cycle Combustion Turbine
-003	170 MW Simple-Cycle Combustion Turbine

**A.1.** The Phase II permit applications submitted for this facility, as approved by the Department, are a part of this permit. The owners and operators of these Phase II acid rain units must comply with the standard requirements and special provisions set forth in the application listed below:

- a. DEP Form No. 62-210.900(1)(a).

[Chapter 62-213, F.A.C. and Rule 62-214.320, F.A.C.]

**A.2.** Sulfur dioxide (SO<sub>2</sub>) allowance allocations requirements for each Acid Rain unit are as follows:

<b>E.U. ID No.</b>	<b>EPA ID</b>	<b>Year</b>	<b>2003</b>	<b>2004</b>	<b>2005</b>	<b>2006</b>	<b>2007</b>
-001	**OSC1	<b>SO<sub>2</sub> allowances, under Table 2 or 3 of 40 CFR Part 73</b>	0*	0*	0*	0*	0*
-002	**OSC2	<b>SO<sub>2</sub> allowances, under Table 2 or 3 of 40 CFR Part 73</b>	0*	0*	0*	0*	0*
-003	**OSC3	<b>SO<sub>2</sub> allowances, under Table 2 or 3 of 40 CFR Part 73</b>	0*	0*	0*	0*	0*

\* The number of allowances held by an Acid Rain source in a unit account may differ from the number allocated by the USEPA under Table 2 or 3 of 40 CFR 73.

**A.3. Emission Allowances.** Emissions from sources subject to the Federal Acid Rain Program (Title IV) shall not exceed any allowances that the source lawfully holds under the Federal Acid Rain Program. Allowances shall not be used to demonstrate compliance with a non-Title IV applicable requirement of the Act.

1. No permit revision shall be required for increases in emissions that are authorized by allowances acquired pursuant to the Federal Acid Rain Program, provided that such increases do not require a permit revision pursuant to Rule 62-213.400(3), F.A.C.

2. No limit shall be placed on the number of allowances held by the source under the Federal Acid Rain Program.

3. Allowances shall be accounted for under the Federal Acid Rain Program.  
[Rule 62-213.440(1)(c), F.A.C.]

**A.4.** Where an applicable requirement of the Act is more stringent than an applicable requirement of regulations promulgated under Title IV of the Act, both provisions shall be incorporated into the permit and shall be enforceable by the Administrator.

[40 CFR 70.6(a)(1)(ii); and, Rule 62-210.200, Definitions - Applicable Requirements, F.A.C.]

**Appendix H-1. Permit History/ID Number Changes.**

**Permit History (for tracking purposes):**

<b>E.U. ID No.</b>	<b>Description</b>	<b>Permit No.</b>	<b>Issue Date</b>	<b>Expiration Date</b>
-001 -002 -003	Three 170 MW Simple-Cycle Combustion Turbines	0970071-001-AC (PSD-FL-273)	12/28/99	12/28/04
		0970071-004-AV (Initial Title V Permit)	1/01/03	12/31/07

**Table 1-1, Summary of Air Pollutant Standards and Terms**

Reliant Energy Osceola, L.L.C.  
 Reliant Energy Osceola, L.L.C. Facility

Permit No.: 0970071-005-AV  
 Facility ID No.: 0970071

This table summarizes information for convenience purposes only. This table does not supersede any of the terms or conditions of this permit.

E.U. ID No.	Brief Description
[-001]	170 MW Simple-Cycle Combustion Turbine
[-002]	170 MW Simple-Cycle Combustion Turbine
[-003]	170 MW Simple-Cycle Combustion Turbine

Pollutant Name	Fuel(s)	Hours/Year	Allowable Emissions			Equivalent Emissions*		Regulatory Citation(s)	See permit condition(s)
			Standard(s)	lbs./hour	TPY	lbs./hour	TPY		
VE	All	3,000	10% Opacity					PSD-FL-273	III.A.8.
NO <sub>x</sub>	Gas	3,000	10.5 ppmvd	60.0			90.0	PSD-FL-273	III.A.8.
NO <sub>x</sub>	Oil	750	42 ppmvd	323			121.1	PSD-FL-273	III.A.8.
VOC	Gas	3,000	1.5 ppmvw	3.0			4.5	PSD-FL-273	III.A.8.
VOC	Oil	750	3.7 ppmvw	8.0			3.0	PSD-FL-273	III.A.8.
CO	Gas	3,000	10.5 ppmvd	36.2			54.3	PSD-FL-273	III.A.8.
CO	Oil	750	20 ppmvd	70.0			26.3	PSD-FL-273	III.A.8.
PM / PM <sub>10</sub>	Gas	3,000		18.0			27.0	PSD-FL-273	III.A.8.
PM / PM <sub>10</sub>	Oil	750		34.0			12.8	PSD-FL-273	III.A.8.
SO <sub>2</sub>	Gas	3,000	2 gr./ 100 cf	1.1			1.65	PSD-FL-273	III.A.8.
SO <sub>2</sub>	Oil	750	0.05% Sulfur	104.3			39.1	PSD-FL-273	III.A.8.

Notes:

\* The "Equivalent Emissions" listed are for informational purposes only.

[electronic file name: 09700711.xls]

## Table 2-1, Summary of Compliance Requirements

Reliant Energy Osceola, L.L.C.  
Reliant Energy Osceola, L.L.C. Facility

Permit No. 0970071-005-AV  
Facility ID No. 0970071

This table summarizes information for convenience purposes only. This table does not supersede any of the terms or conditions of this permit.

E.U. ID No.	Brief Description
[-001]	170 MW Simple-Cycle Combustion Turbine
[-002]	170 MW Simple-Cycle Combustion Turbine
[-003]	170 MW Simple-Cycle Combustion Turbine

Pollutant Name or Parameter	Fuel(s)	Compliance Method	Testing Time Frequency	Frequency Base Date *	Min. Compliance Test Duration	Compliance	
						CMS**	See permit condition(s)
NO <sub>x</sub>	All	EPA Method 20 or 7E	Annual	5/22/02	1-hour	Yes	III.A.25.
SO <sub>2</sub>	Gas	ASTM Methods		5/22/02			III.A.27.
SO <sub>2</sub> % Sulfur	Oil	ASTM Methods	Fuel Transfer	5/22/02			III.A.26.
VOC	All	Compliance with CO	Annual	5/22/02			III.A.22.
CO	All	EPA Method 10	Annual	5/22/02	1-hour		III.A.23.
PM / PM <sub>10</sub>	All	EPA Method 9	Annual	5/22/02	30-minutes		III.A.24.
VE	All	EPA Method 9	Annual	5/22/02	30-minutes		III.A.30.

**Notes:**

\* The frequency base date is established for planning purposes only; see Rule 62-297.310, F.A.C.

\*\*CMS [=] continuous monitoring system

[electronic file name: 09700712.xls]

SENDER: COMPLETE THIS SECTION	COMPLETE THIS SECTION ON DELIVERY
<ul style="list-style-type: none"> <li>Complete items 1, 2, and 3. Also complete item 4 if Restricted Delivery is desired.</li> <li>Print your name and address on the reverse so that we can return the card to you.</li> <li>Attach this card to the back of the mailpiece, or on the front if space permits.</li> </ul>	<p>A. Signature  X. <i>James B. W. [Signature]</i> <input type="checkbox"/> Agent  <input type="checkbox"/> Addressee</p> <p>B. Received by (Printed Name) _____ C. Date of Delivery  7/9</p>
<p>1. Article Addressed to:  Mr. Terry E. Gish  Responsible Official  Reliant Energy Osceola, L.L.C.  7800 U.S. Highway One South  Titusville, Florida 32780</p>	<p>D. Is delivery address different from item 1? <input type="checkbox"/> Yes  If YES, enter delivery address below: <input type="checkbox"/> No</p> <p>3. Service Type  <input checked="" type="checkbox"/> Certified Mail <input type="checkbox"/> Express Mail  <input type="checkbox"/> Registered <input type="checkbox"/> Return Receipt for Merchandise  <input type="checkbox"/> Insured Mail <input type="checkbox"/> C.O.D.</p> <p>4. Restricted Delivery? (Extra Fee) <input type="checkbox"/> Yes</p>
<p>2. Article Number <span style="float: right;">7001 0320 0001 3692 6716</span>  (Transfer from service label)</p>	
<p>PS Form 3811, August 2001 <span style="margin-left: 150px;">Domestic Return Receipt</span> <span style="float: right;">102595-02-M-1540</span></p>	

**U.S. Postal Service**  
**CERTIFIED MAIL RECEIPT**  
(Domestic Mail Only; No Insurance Coverage Provided)

---

OFFICIAL USE

Postage	\$	Postmark Here
Certified Fee		
Return Receipt Fee (Endorsement Required)		
Restricted Delivery Fee (Endorsement Required)		
<b>Total Postage &amp; Fees</b>	<b>\$</b>	

Sent To  
Mr. Terry E. Gish

Street, Apt. No.,  
or P.O. Box  
7800 U.S. Highway One South

City, State, ZIP+4  
Titusville, Florida 32780

PS Form 3800, January 2001 See Reverse for Instructions

7001 0320 0001 3692 6716