




Florida Department of Environmental Protection

Memorandum

TO: Joseph Kahn, Division of Air Resource Management
THROUGH: Trina L. Vielhauer, Chief, Bureau of Air Regulation 
Jon Holtom, P.E., Title V Section 
FROM: Scott M. Sheplak, P.E., Title V Section 
DATE: June 9, 2009
SUBJECT: Final Permit No. 1010056-006-AV
Pasco County, Pasco County Resource Recovery Facility
Title V Air Operation Permit Revision

Permitting Clock: ARMS Day 45 was 06/08/2009

The final permit for this project is attached for your approval and signature, which revises the Title V air operation permit to include all of the recent amendments to the federal regulations 40 Code of Federal Regulations (CFR) 60, Subpart Cb - Emission Guidelines, promulgated on May 10, 2006, for the existing Units 1, 2 & 3 into the Title V air operation permit No. 1010056-005-AV.

The attached final determination identifies issuance of the combined draft/proposed permit, summarizes the publication process, and provides the Department's response(s) to comment(s) (if any) on the draft permit. There are no pending petitions for administrative hearings or extensions of time to file a petition for an administrative hearing.

I recommend your approval of the attached final permit for this project.

TLV/jkh/sms

Attachments

NOTICE OF FINAL PERMIT

*In the Matter of an
Application for Permit by:*

Pasco County
Pasco County Resource Recovery Facility
7530 Little Road
New Port Richey, Florida 34654

Responsible Official:

Mr. John Power, Solid Waste Manager


Final Permit No. 1010056-006-AV
Pasco County Resource Recovery Facility

Title V Air Operation Permit Revision
Pasco County

Enclosed is the final permit package to revise the Title V air operation permit for the Pasco County Resource Recovery Facility. This Title V air operation permit revision is being issued to include all of the recent amendments to the federal regulations 40 Code of Federal Regulations (CFR) 60, Subpart Cb - Emission Guidelines, promulgated on May 10, 2006, for the existing Units 1, 2 & 3 into the Title V air operation permit No. 1010056-005-AV. This existing facility is located at 14230 Hays Road, Spring Hill in Pasco County, Florida. This permit is issued pursuant to Chapter 403, Florida Statutes.

Any party to this order (permit) has the right to seek judicial review of it under Section 120.68 of the Florida Statutes by filing a notice of appeal under Rule 9.110 of the Florida Rules of Appellate Procedure with the clerk of the Department of Environmental Protection in the Office of General Counsel (Mail Station #35, 3900 Commonwealth Boulevard, Tallahassee, Florida, 32399-3000) and by filing a copy of the notice of appeal accompanied by the applicable filing fees with the appropriate District Court of Appeal. The notice must be filed within 30-days after this order is filed with the clerk of the Department.

Executed in Tallahassee, Florida.



Trina L. Vielhauer, Chief
Bureau of Air Regulation

TLV/jkh/sms

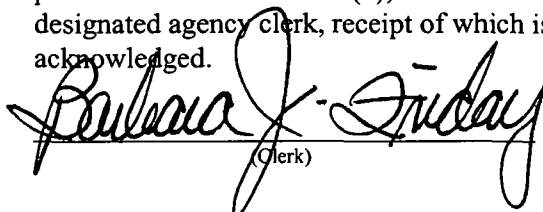
CERTIFICATE OF SERVICE

The undersigned duly designated deputy agency clerk hereby certifies that this Notice of Final Permit (including the Final Determination, the Statement of Basis and the Final Permit), or a link to these documents available electronically on a publicly accessible server, was sent by electronic mail with received receipt requested to the persons listed below:

Mr. John Power, Solid Waste Manager: jpower@pascocountyfl.net
Mr. Jason M. Gorrie, P.E., Covanta Energy: jgorrie@CovantaEnergy.com
Mr. Bill Crellin, Camp Dresser McKee: crellinwr@cdm.com
Ms. Cindy Zhang-Torres, P.E., DEP SWD: Zhang-Torres@dep.state.fl.us
Ms. Katy R. Forney, U.S. EPA, Region 4: Forney.Kathleen@epamail.epa.gov
Ms. Ana Oquendo, US EPA, Region 4: Oquendo.Ana@epamail.epa.gov
Ms. Barbara Friday, DEP BAR: Barbara.Friday@dep.state.fl.us (for posting with U.S. EPA, Region 4)
Ms. Victoria Gibson, DEP BAR: Victoria.Gibson@dep.state.fl.us (for reading file)

Clerk Stamp

FILING AND ACKNOWLEDGMENT FILED, on this date, pursuant to Section 120.52(7), Florida Statutes, with the designated agency clerk, receipt of which is hereby acknowledged.

 6/18/09
(Clerk) (Date)

FINAL DETERMINATION

PERMITTEE

Pasco County
Pasco County Resource Recovery Facility

PERMITTING AUTHORITY

Florida Department of Environmental Protection (Department)
Division of Air Resource Management
Bureau of Air Regulation, Title V Section
2600 Blair Stone Road, MS #5505
Tallahassee, Florida 32399-2400

PROJECT

The purpose of this permit revision is to incorporate all of the recent amendments to the federal regulations 40 Code of Federal Regulations (CFR) 60, Subpart Cb - Emission Guidelines, promulgated on May 10, 2006, for the existing Units 1, 2 & 3 into the Title V air operation permit. The compliance deadline with the May 10, 2006 federal amendments was April 28, 2009.

This permit was processed using a parallel review.

PUBLIC NOTICE

A Written Notice of Intent to Issue a Title V Air Operation Permit Revision to Pasco County for the Pasco County Resource Recovery Facility located at 14230 Hays Road, Spring Hill in Pasco County, Florida, was clerked on February 18, 2009. The Public Notice of Intent to Issue a Title V Air Operation Permit Revision was published in the St. Petersburg Times, Pasco Edition on April 23, 2009 and the Tampa Tribune on April 24, 2009. The draft/proposed Title V air operation permit was available for public inspection at the permitting authority's office in Tallahassee. Proof of publication of both Public Notices of Intent to Issue a Title V Air Operation Permit Revision was received on April 30, 2009.

COMMENTS

No comments on the draft/proposed permit were received from the US EPA Region 4 Office. No comments were received from the public during the 30-day public comment period.

DEPARTMENT INITIATED CHANGES

Changes initiated by the Department were made in this final permit.

1. Obsolete Requirements. The applicability of NSPS 40 CFR 60 Subpart Db to 40 CFR 60 Subpart Cb units was changed in the federal register on June 13, 2007, CFR edition 7-1-2008. Units regulated under 40 CFR 60 Subpart Cb are no longer covered under 40 CFR 60 Subpart Db. The requirement specified in the permit in specific condition number **A.7.2.0.** related to 40 CFR 60 Subpart Db is therefore obsolete and is removed.

A.7.2.0. Auxiliary Fuel Burners. These devices shall be used at startup during the introduction of MSW fuel until design furnace gas temperature is achieved. They shall be fueled only with natural or propane gas. ~~If the annual capacity value for natural or propane gas is greater than 10%, as determined by 40 CFR 60.43b(d), the facility shall be subject to 40 CFR 60.44b, Standards for Nitrogen Oxides.~~
[Rules 62-4.160(2), 62-210.200, and 62-213.440(1), F.A.C.; and, PSD-FL-127.]

FINAL DETERMINATION

2. For consistency with other municipal waste combustor permits, specific condition number **A.0.4.** is changed to read as follows:

A.0.4. The BACT emission standard & limit for NO_x of 0.643 lb/MMBtu heat input equivalent to 90.02 lb/hour from the PSD-FL-127 permit for Units 1, 2 & 3 remains more stringent than the Emission Guideline 40 CFR 60 Subpart Cb, including the amendments. Where multiple applicable requirements exist, the more stringent requirement ~~always applies~~ guarantees compliance with the less stringent limit. The May 10, 2006 amendments do change some of the emission standards & limitations currently in effect for Units 1, 2 & 3. Five (5) pollutant limits are, however, lowered under the amendments: PM, Hg, Pb, Cd and CO. This Title V permit revision contains each lower limit with the compliance deadline of April 28, 2009.
[Rules 62-204.800 and 62-213.440(1), F.A.C.]

CONCLUSION

The final action of the Department is to issue the final permit with the changes noted above.

STATEMENT OF BASIS

Pasco County, Pasco County Resource Recovery Facility
Pasco County

Title V Air Operation Permit Revision
Final Permit No. 1010056-006-AV

APPLICANT

The applicant for this project is Pasco County, Pasco County Resource Recovery Facility. The applicant's responsible official and mailing address are: Mr. John Power, Solid Waste Manager, Pasco County, Pasco County Resource Recovery Facility, 7530 Little Road, New Port Richey, Florida 34654.

FACILITY DESCRIPTION

The facility is owned by Pasco County, was designed and built by Ogden-Martin Systems of Pasco, Inc. (OMSP), and is currently operated by the Covanta Energy Group, Inc. This existing facility is located in Pasco County at 14230 Hays Road, Spring Hill.

This facility consists primarily of three Municipal Waste Combustor (MWC) emissions units identical in configuration, and each has a nameplate rating of 350 tons per day of waste at 4,800 Btu/lb. Emissions are controlled by: a spray dryer absorber (SDA), fabric filter baghouse, selective non-catalytic reduction (SNCR), and a carbon injector system.

PROJECT DESCRIPTION

The purpose of this permit revision is to incorporate all of the recent amendments to the federal regulations 40 Code of Federal Regulations (CFR) 60, Subpart Cb - Emission Guidelines, promulgated on May 10, 2006, for the existing Units 1, 2 & 3 into the facility's Title V air operation permit. The compliance deadline with the May 10, 2006 federal amendments was April 28, 2009.

Units 1, 2 & 3 are regulated as 'existing' units under 40 CFR 60, Subpart Cb - Emission Guidelines.

The federal amendments to 40 CFR 60, Subparts Cb & Eb were promulgated by U.S. EPA on May 10, 2006, and were adopted by reference into the Florida rules on May 31, 2007, at Rule 62-204.800(9)(b), Florida Administrative Code (F.A.C.) and Rule 62-204.800(8)(b)7., F.A.C., respectively. Certain exceptions were made in Florida's adoption of 40 CFR 60, Subpart Cb at Rule 62-204.800(9)(b), F.A.C. The federal amendments are included in this permit for all three units. According to the applicant, no modifications to Units 1, 2 & 3 are necessary to comply with the amendments.

PROCESSING SCHEDULE AND RELATED DOCUMENTS

Application for a Title V Air Operation Permit Revision received on September 15, 2008.
Additional Information Request dated November 5, 2008, sent on November 6, 2008.
Additional Information Response dated November 14, 2008, received on November 20, 2008.
Draft/Proposed Permit posted on web site on February 18, 2009.
Public Notice published on April 23 & 24, 2009.
Proof of Publication of Public Notices received on April 30, 2009.
Notification to U.S. EPA Region 4 of Publication of Public Notice on May 1, 2009.

PRIMARY REGULATORY REQUIREMENTS

STATEMENT OF BASIS

Title III: This facility is a major source of hazardous air pollutants (HAP), based on the Title V air operation permit renewal application received on April 15, 2005.

Title V: This facility is a Title V major source of air pollution in accordance with Chapter 62-213, Florida Administrative Code (F.A.C.).

PSD: This facility is a Prevention of Significant Deterioration (PSD)-major source of air pollution in accordance with Rule 62-212.400, F.A.C.

40 CFR 60, EG & NSPS: This facility has emissions units that are subject to 40 CFR 60, Subpart Cb, Emission Guidelines (EG) and Compliance Times for Large Municipal Waste Combustors That Are Constructed on or Before September 20, 1994, adopted and incorporated by reference in Rule 62-204.800(9)(b), F.A.C. Also, please note that certain applicable requirements in 40 CFR 60, Subpart Cb, are detailed in 40 CFR 60, Subpart Eb, adopted and incorporated by reference in Rule 62-204.800(8)(b)7., F.A.C.

CAM: Compliance Assurance Monitoring (CAM) applies to emissions units at this facility. A CAM Plan has previously been included in Title V air operation permit No. 1010056-005-AV.

PROJECT REVIEW

The following permitting documents were changed as a result of this Title V air operation permit revision and are included in this package: (a) Permit; (b) Appendix A, 40 CFR 60, Subpart A - General Provisions; (c) Appendix H-1, Permit History/ID Number Changes; and, (d) Table 1-1, Summary of Air Pollutant Standards and Terms.

As part of this Title V air operation permit revision project, the following changes and corrections have been made to Title V air operation permit No. 1010056-005-AV:

1. Units 1, 2 & 3 - Incorporation of May 10, 2006 Federal Amendments.

The previous Title V air operation permit No. 1010056-005-AV did include the revised emission standards & limitations from the May 10, 2006 federal amendment but, did not include all of the May 10, 2006 federal amendment changes.

Emission Standards & Limitations

The applicant prepared a chart comparing the May 10, 2006 federal amendments as they potentially affected the emission standards & limitations for Units 1, 2 & 3 in the Additional Information Response dated November 14, 2008. The following chart prepared by the Department compares the May 10, 2006 federal amendments as they potentially affected the current emission standards & limitations for Units 1, 2 & 3.

Units 1, 2 & 3: May 10, 2006 Amendments vs. Current Permitted Standard(s)

Pollutant Name	Current Permitted Standard(s)	May 10, 2006 Cb standard	Current Permitted Standard(s) more stringent?
Particulate Matter (PM ₁₀)	27 mg/dscm, corrected to 7% O ₂	25 mg/dscm, corrected to 7% O ₂	No
MWC Metals (PM)	27 mg/dscm, corrected to 7% O ₂	25 mg/dscm, corrected to 7% O ₂	No
Mercury (Hg)	0.070 mg/dscm @ 7% O ₂ or 85% reduction ⁽¹⁾	0.050 mg/dscm @ 7% O ₂ or 85% reduction ⁽¹⁾	No
Lead (Pb)	0.44 mg/dscm, corrected to 7% O ₂	0.400	No
Cadmium (Cd)	0.040 mg/dscm @ 7% O ₂	0.035	No
Nitrogen Oxides (NO _x)	0.643 lb/MMBtu heat input (equivalent to 90.02 lb/hour)	205 ppmvd, corrected to 7% O ₂	Yes

STATEMENT OF BASIS

		(equivalent to 113.62 lb/hour)	
Carbon Monoxide (CO)	400 ppmvd, corrected to 7% O ₂ (equivalent to 134.96 lb/hour)	100 ppmvd, corrected to 7% O ₂ (equivalent to 33.76 lb/hour)	No
Dioxin/Furans (CDD/CDF)	30 ng/dscm @ 7% O ₂	30 ng/dscm @ 7% O ₂	No

Notes to table:

(1) Whichever standard is less stringent.

Abbreviations

mg/dscm: Milligrams per dry standard cubic meter

Under the amendments to the Emission Guidelines 40 CFR 60 Subpart Cb, seven (7) pollutant limits were lowered which potentially affected Units 1, 2 & 3: PM, Hg, Pb, Cd, NO_x, CO and dioxin/furan. The BACT emission standard & limit for NO_x of 0.643 lb/MMBtu heat input (equivalent to 90.02 lb/hour) from the PSD-FL-127 permit for Units 1, 2 & 3 remains more stringent than the Emission Guideline 40 CFR 60 Subpart Cb, including the amendments. The current permitted Dioxin/Furans limit did not change. Five (5) pollutant limits are, however, lowered under the amendments to the Emission Guidelines 40 CFR 60 Subpart Cb: PM, Hg, Pb, Cd and CO.

The equivalent lbs/hr and TPY values for mercury, lead and NO_x, at 100% capacity were added to specific conditions A.20., A.22. and A.30.

In summary, the May 10, 2006 amendments do change some of the emission standards & limitations currently in effect for Units 1, 2 & 3. Changes were previously made to the PM, Hg, Pb, Cd and CO emission standards & limitations in Title V air operation permit No. 1010056-005-AV for Units 1, 2 & 3.

Other Requirements

Other changes from the May 10, 2006 federal amendments are fully integrated into the body of the permit within Subsection III.A. The other significant changes from the amendments were related to: Operating Practices & Requirements; Operator Training & Certification; Excess Emissions; Test Methods & Procedures; Monitoring Requirements; and, Recordkeeping & Reporting Requirements. This Title V air operation permit revision contains these new requirements.

The federal amendments related to the optional use of continuous emissions monitoring systems (CEMS) to monitor PM and Hg were not included at the applicant's request.

On January 22, 2009, the Department received an e-mail from U.S. EPA confirming an error in the Code of Federal Regulations (CFR) regarding the testing schedule for fugitive ash and hydrogen chloride (HCl) emissions. In the federal register U.S. EPA clearly intended to make the testing schedule change apply to all air pollutants (see the May 10, 2006 federal register, page number 27326). In the e-mail U.S. EPA confirmed the error in the CFR and they plan to correct the error as soon as possible. Until the error is corrected in the federal regulation, the testing schedule for fugitive ash and HCl emissions is kept intact.

2. An updated version of the following appendix is attached: Appendix 40 CFR 60 Subpart A (version dated 06/01/2006). The previously attached "Appendix Cb, 40 CFR 60, Subpart Cb Standard Conditions" and "Appendix Eb, 40 CFR 60, Subpart Eb Standard Conditions" are deleted as the specific applicable requirements from these appendices are contained within the body of the permit in Subsection III.A.

3. The permitting note related to the State Plan approval date of November 13, 1997 was moved before specific condition A.12.

Department Initiated Changes

STATEMENT OF BASIS

The following Department initiated changes are made in this permitting action:

1. Statewide Format Change. As a result of a recent rule change to Rule 62-213.420(1)(a)2., F.A.C., the Renewal Application Due Date for Permit No. 1010056-005-AV as shown on the placard page of the permit is changed from: September 16, 2011 to: August 4, 2011. {The rule change requires the renewal application to be submitted 225 days prior to expiration instead of the previous 180 days.}
2. Obsolete Requirements. The applicability of NSPS 40 CFR 60 Subpart Db to 40 CFR 60 Subpart Cb units was changed in the federal register on June 13, 2007, CFR edition 7-1-2008. Units regulated under 40 CFR 60 Subpart Cb are no longer covered under 40 CFR 60 Subpart Db. The requirement specified in the permit related to 40 CFR 60 Subpart Db is therefore obsolete and is removed.

CONCLUSION

This project revises Title V air operation permit No. 1010056-005-AV, which was effective March 16, 2007. This Title V air operation permit is issued under the provisions of Chapter 403, Florida Statutes (F.S.), and Chapters 62-4, 62-210, 62-213 and 214, Florida Administrative Code (F.A.C.). In accordance with the terms and conditions of this permit, the above named permittee is hereby authorized to operate the facility as shown on the application and approved drawings, plans, and other documents, on file with the permitting authority.

Pasco County Resource Recovery Facility

Facility ID No. 1010056
Pasco County

Title V Air Operation Permit Revision
Final Permit No. 1010056-006-AV
(1st revision to Permit No. 1010056-005-AV)

Permitting Authority:
State of Florida
Department of Environmental Protection
Division of Air Resource Management
Bureau of Air Regulation
Title V Section

Mail Station #5505
2600 Blair Stone Road
Tallahassee, Florida 32399-2400

Telephone: 850/488-0114
Fax: 850/921-9533

Compliance Authority:
State of Florida
Department of Environmental Protection
Southwest District

13051 North Telecom Parkway
Temple Terrace, FL 33637-0926

Telephone: 813/632-7600
Fax: 813/632-7668

Table of Contents

<u>Section</u>	<u>Page Number</u>
Placard Page	1
I. Facility Information	2
II. Facility-wide Conditions.....	4
III. Emissions Units and Conditions	
A. Municipal Waste Combustion Units	6
B. Storage Silo for Activated Carbon.....	48
C. Reserved (Leachate Treatment Facility removed from service)	51
D. Fugitive Landfill Gas Emissions	52
E. Ash Building and Handling System.....	60
Appendix U-1, List of Unregulated Emissions Units and/or Activities.....	62
Appendix I-1, List of Insignificant Emissions Units and/or Activities.....	63
Attachments.....	64
Appendix A, 40 CFR 60, Subpart A - General Provisions	
Appendix A-1, Abbreviations, Definitions, Citations, and Identification Numbers	
Appendix BW, Biomedical Waste Definitions	
Appendix CAM, Compliance Assurance Monitoring	
Appendix H-1, Permit History/ID Number Changes	
Appendix I-1, List of Insignificant Emissions Units and/or Activities	
Appendix SS-1, Stack Sampling Facilities (version dated 10/7/96)	
Appendix TV-6, Title V Conditions (version dated 06/23/06)	
Appendix U-1, List of Unregulated Emissions Units and/or Activities	
Table 1-1, Summary of Air Pollutant Standards and Terms	



Florida Department of Environmental Protection

Bob Martinez Center
2600 Blair Stone Road
Tallahassee, Florida 32399-2400

Charlie Crist
Governor

Jeff Kottkamp
Lt. Governor

Michael W. Sole
Secretary

Permittee:

Pasco County
14230 Hays Road
Spring Hill, Florida 34610

Final Permit No. 1010056-006-AV

Facility ID No. 1010056

SIC Nos. 49, 4953

Project: Title V Air Operation Permit Revision

This permit revision is to incorporate all of the recent amendments to the federal regulations 40 Code of Federal Regulations (CFR) 60, Subpart Cb - Emission Guidelines, promulgated on May 10, 2006, for the existing Units 1, 2 & 3 into the facility's Title V air operation permit. Permit No. 1010056-005-AV is for the operation of the Pasco County Resource Recovery Facility. This facility is located at 14230 Hays Road, Spring Hill, Pasco County, Florida.

This Title V air operation permit revision is issued under the provisions of Chapter 403, Florida Statutes (F.S.), Chapters 62-4, 62-210, and 62-213 of the Florida Administrative Code (F.A.C.). The above named permittee is hereby authorized to perform the work or operate the facility shown on the application and approved drawing(s), plans, and other documents, attached hereto or on file with the permitting authority, in accordance with the terms and conditions of this permit.

Referenced attachments made a part of this permit revision:

Appendix A, 40 CFR 60, Subpart A - General Provisions (version dated 10/09/08)

1010056-005-AV Effective Date: March 16, 2007

Revision Effective Date: June 18, 2009

Renewal Application Due Date: August 4, 2011

Expiration Date: March 16, 2012

Joseph Kahn, Director
Division of Air Resource Management

JK/tlv/jkh/sms

Section I. Facility Information.

Subsection A. Facility Description.

The Pasco County Resource Recovery Facility began commercial operation in May 1991. It has a nameplate rating of 1,050 tons per day of non-recycled waste at 4,800 Btu/lb, which it converts into saleable energy. It produces up to 31.2 megawatts (MW) of electricity daily that are sold to Progress Energy Florida, Inc. The facility is owned by Pasco County, and was designed and built, and is currently operated by, Ogden-Martin Systems of Pasco, Inc. (OMSP). OMSP has a twenty-year operating contract with the County. OMSP is now called the Covanta Energy Group.

The facility's mass burn combustion system incorporates the technology of German-based Martin GmbH. Waste is combusted at furnace temperatures exceeding 1,800 degrees Fahrenheit, and reduced to an inert ash residue that is approximately ten percent of the original volume. The ash is disposed of in an adjacent County landfill.

Based on the Title V permit renewal application received April 19, 2005, this facility is a major source of hazardous air pollutants (HAP).

Subsection B. Summary of Emissions Unit ID Nos. and Brief Descriptions.

E.U. ID No.	Brief Description
-001	Municipal Waste Combustion Unit No. 1
-002	Municipal Waste Combustion Unit No. 2
-003	Municipal Waste Combustion Unit No. 3
-004	Storage Silo for Activated Carbon
-005	Leachate Treatment Facility (removed from service)
-007	Fugitive Landfill Gas Emissions
-008	Ash Building and Handling System

Unregulated Emissions Unit

E.U. ID No.	Brief Description
-006	Cooling Tower

Please reference the Permit No., Facility ID No., and appropriate Emissions Unit(s) ID No(s). on all correspondence, test report submittals, applications, etc.

Subsection C. Relevant Documents.

The documents listed below are not a part of this permit; however, they are specifically related to this permitting action.

These documents are provided to the permittee for information purposes only:

Table 1-1, Summary of Air Pollutant Standards and Terms

Appendix A-1, Abbreviations, Acronyms, Citations, and Identification Numbers

Appendix H-1, Permit History/ID Number Changes

Statement of Basis

These documents are on file with permitting authority:

U.S. EPA Motion to Remand the May 10, 2006 amendments on November 9, 2007.

Title V Air Operation Permit Revision Application received on September 15, 2008.

Department's Request for Additional Information dated November 5, 2008.

Applicant's Response to Request for Additional Information dated November 14, 2008.

E-mail from U.S. EPA regarding Testing Schedule for Fugitive Ash and HCl Emissions dated January 22, 2009.

Section II. Facility-wide Conditions.

The following Conditions apply facility-wide:

1. APPENDIX TV-6, TITLE V CONDITIONS, is a part of this permit.
{Permitting note: APPENDIX TV-6, TITLE V CONDITIONS, is distributed to the permittee only. Other persons requesting copies of these conditions shall be provided a copy when requested or otherwise appropriate.}
2. General Pollutant Emission Limiting Standards. Objectionable Odor Prohibited. No person shall cause, suffer, allow, or permit the discharge of air pollutants which cause or contribute to an objectionable odor.
[Rule 62-296.320(2), F.A.C.; and PSD-FL-127]
3. General Particulate Emission Limiting Standards. General Visible Emissions Standard. Except for emissions units that are subject to a particulate matter or opacity limit set forth or established by rule and reflected by conditions in this permit, no person shall cause, let, permit, suffer or allow to be discharged into the atmosphere the emissions of air pollutants from any activity, the density of which is equal to or greater than that designated as Number 1 on the Ringelmann Chart (20 percent opacity). EPA Method 9 is the method of compliance pursuant to Chapter 62-297, F.A.C.
[Rules 62-296.320(4)(b)1. & 4., F.A.C.]
4. Prevention of Accidental Releases (Section 112(r) of CAA).
 - a. The permittee shall submit its Risk Management Plan (RMP) to the Chemical Emergency Preparedness and Prevention Office (CEPPO) RMP Reporting Center when, and if, such requirement becomes applicable; and
 - b. The permittee shall submit to the permitting authority Title V certification forms or a compliance schedule in accordance with Rule 62-213.440(2), F.A.C.
[40 CFR 68]

{Permitting Note: The permittee has stated that the facility does not store any 112(r) materials in regulated quantities.}
5. Unregulated Emissions Units and/or Activities. Appendix U-1, List of Unregulated Emissions Units and/or Activities, is a part of this permit.
[Rule 62-213.440(1), F.A.C.]
6. Insignificant Units and/or Activities. Appendix I-1, List of Insignificant Emissions Units and/or Activities, is a part of this permit.
[Rules 62-213.440(1), 62-213.430(6) and 62-4.040(1)(b), F.A.C.]
7. General Pollutant Emission Limiting Standards. Volatile Organic Compounds Emissions or Organic Solvents Emissions. The permittee shall allow no person to store, pump, handle, process, load, unload or use in any process or installation, volatile organic compounds or organic solvents without applying known and existing vapor emission control devices or systems deemed necessary and ordered by the Department.
[Rule 62-296.320(1)(a), F.A.C.]

{Permitting Note: The Department has not ordered any control devices or systems under the referenced rule}.

8. Not federally enforceable. Reasonable Precautions. The following techniques shall be used to control unconfined particulate matter emissions on an as needed basis:

- a. Roads, parking areas, and yards are paved.
- b. The unpaved areas of the facility are maintained and either sodded or landscaped.
- c. The conveyor systems of the facility are fully enclosed.
- d. A street sweeper is used to remove particulate matter from roads and other paved areas.
- e. A windscreen is employed at the landfill.

[Rule 62-296.320(4)(c)2., F.A.C.; PSD-FL-127; and Title V Permit Renewal Application]

9. When appropriate, any recording, monitoring, or reporting requirements that are time-specific shall be in accordance with the effective date of the permit, which defines day one.

[Rule 62-213.440, F.A.C.]

10. Statement of Compliance. The annual statement of compliance pursuant to Rule 62-213.440(3)(a)2., F.A.C., shall be submitted to the Department and EPA within 60 (sixty) days after the end of the calendar year using DEP Form No. 62-213.900(7), F.A.C.

[Rules 62-213.440(3) and 62-213.900, F.A.C.]

{Permitting Note: This condition implements the requirements of Rules 62-213.440(3)(a)2. & 3., F.A.C. (see Condition 51. of APPENDIX TV-6, TITLE V CONDITIONS.)}

11. The permittee shall submit all compliance related notifications and reports required of this permit to the Department's Southwest District office:

Department of Environmental Protection
Southwest District Office
13051 N. Telecom Parkway
Temple Terrace, FL 33637-0926
Telephone: (813) 632-7600; Fax: 813/744-6458

12. Any reports, data, notifications, certifications, and requests required to be sent to the United States Environmental Protection Agency, Region 4, should be sent to:

United States Environmental Protection Agency
Region 4
Air, Pesticides & Toxics Management Division
Air & EPCRA Enforcement Branch, Air Enforcement Section
61 Forsyth Street
Atlanta, Georgia 30303-8960
Telephone: 404/562-9155; Fax: 404/562-9163

13. Certification by Responsible Official (RO). In addition to the professional engineering certification required for applications by Rule 62-4.050(3), F.A.C., any application form, report, compliance statement, compliance plan and compliance schedule submitted pursuant to Chapter 62-213, F.A.C., shall contain a certification signed by a responsible official that, based on information and belief formed after reasonable inquiry, the statements and information in the document are true, accurate, and complete. Any responsible official who fails to submit any required information or who has submitted incorrect information shall, upon becoming aware of such failure or incorrect submittal, promptly submit such supplementary information or correct information. [Rule 62-213.420(4), F.A.C.]

Section III. Emissions Unit(s) and Conditions.

Subsection A. This section addresses the following emissions units.

E.U. ID No.	Brief Description
-001	Municipal Waste Combustion Unit No. 1
-002	Municipal Waste Combustion Unit No. 2
-003	Municipal Waste Combustion Unit No. 3

These three Municipal Waste Combustor (MWC) emissions units are identical in configuration, and each has a nameplate rating of 350 tons per day of waste at 4,800 Btu/lb. Emissions are controlled by: a spray dryer absorber (SDA), fabric filter baghouse, selective non-catalytic reduction (SNCR), and a carbon injector system. Using lime slurry, the scrubber neutralizes acid-forming gases, such as sulfur oxides, hydrogen fluorides and hydrogen chloride. The baghouse captures the particulate matter. Captured dry ash particles fall into hoppers and are transported by an enclosed conveyor system to the combined ash discharger where they are wetted to prevent dust, and mixed with the bottom ash. Activated carbon is injected into the flue gases prior to the baghouse to control mercury emissions. Nitrogen oxide emissions are controlled by the use of ammonia injection (SNCR). Stack height is 275 feet. Exit diameter is 4.7 feet. Exit temperature is 250°F. Actual volumetric flow rate is 85,300 acfm. Dry standard flow rate is 47,600 dscfm. The emissions units' initial startup date was in January of 1991.

Pasco County has installed a selective noncatalytic reduction system (SNCR) employing the use of aqueous ammonia (19%) for the control of NOX emissions. The system basically includes an aqueous ammonia storage tank, associated piping, injection lances at the boilers and controls. The construction was completed in March 2000.

{Permitting note(s): These emissions units are regulated under 40 CFR 60, Subpart Cb, Emission Guidelines (EG) and Compliance Times for Large Municipal Waste Combustors That Are Constructed on or Before September 20, 1994, adopted and incorporated by reference, subject to provisions, in Rule 62-204.800(9)(b), F.A.C.; Rule 62-212.400(5), F.A.C., Prevention of Significant Deterioration (PSD), PSD-FL-127; Rule 62-212.400(6), F.A.C., Best Available Control Technology (BACT); Rule 62-296.401(2), F.A.C., Incinerators; Rule 62-296.416, F.A.C., Waste-to-Energy Facilities. Also please note that certain conditions in 40 CFR 60, Subpart Cb, are detailed in 40 CFR 60, Subpart Eb.}

The following conditions apply to the emissions unit(s) listed above:

Emission Guidelines Requirements

{Permitting note(s): Some requirements of 40 CFR 60, Subpart Cb, are contained in 40 CFR 60, Subpart Eb.}

A.0.1. NSPS Requirements - Subpart A. The affected emissions units shall comply with all applicable requirements of 40 CFR 60, Subpart A, General Provisions including:

- 40 CFR 60.7, Notification and Recordkeeping
- 40 CFR 60.8, Performance Tests
- 40 CFR 60.11, Compliance with Standards and Maintenance Requirements
- 40 CFR 60.12, Circumvention

40 CFR 60.13, Monitoring Requirements

40 CFR 60.19, General Notification and Reporting requirements adopted by reference in Rule 62-204.800(8)(d), F.A.C., except that the Secretary is not the Administrator for purposes of 40 CFR 60.4, 40 CFR 60.8(b)(2) and (3), 40 CFR 60.11(e)(7) and (8), 40 CFR 60.13(g), (i) and (j)(2), and 40 CFR 60.16.

These emissions units shall comply with **Appendix 40 CFR 60 Subpart A** attached to this permit.
[Rule 62-204.800(8)(c), (d) & (e), F.A.C.]

A.0.2. Emission Guidelines. 40 CFR 60 Subpart Cb. The affected emissions units shall comply with all applicable provisions of the 40 CFR 60, Subpart Cb-Emission Guidelines and Compliance Times for Large Municipal Waste Combustors That Are Constructed on or Before September 20, 1994, which are incorporated within this revision. {Note: exceptions were made in Florida's adoption of 40 CFR 60, Subpart Cb.}
[Rule 62-204.800(9)(b), F.A.C.]

A.0.3. Compliance Deadline. The owner or operator shall comply with the May 10, 2006, federal amendments to 40 CFR 60, Subpart Cb as incorporated into this permit no later than April 28, 2009 {2 years from approval of state plan}.
[Rule 62-204.800, F.A.C.]

A.0.4. The BACT emission standard & limit for NO_x of 0.643 lb/MMBtu heat input equivalent to 90.02 lb/hour from the PSD-FL-127 permit for Units 1, 2 & 3 remains more stringent than the Emission Guideline 40 CFR 60 Subpart Cb, including the amendments. Where multiple applicable requirements exist, the more stringent requirement guarantees compliance with the less stringent limit. The May 10, 2006 amendments do change some of the emission standards & limitations currently in effect for Units 1, 2 & 3. Five (5) pollutant limits are, however, lowered under the amendments: PM, Hg, Pb, Cd and CO. This Title V permit revision contains each lower limit with the compliance deadline of April 28, 2009.
[Rules 62-204.800 and 62-213.440(1), F.A.C.]

General

A.1.0. Definitions.

A.1.1. For the purposes of Rule 62-204.800(8), F.A.C., the definitions contained in the various provisions of 40 CFR 60, shall apply except that the term "Administrator" when used in 40 CFR 60, shall mean the Secretary or the Secretary's designee.
[40 CFR 60.2; Rule 62-204.800(8)(a), F.A.C.]

A.1.2. For the purposes of Rule 62-204.800(7), F.A.C., the definitions contained in the various provisions of 40 CFR 60, shall apply except that the term "Administrator" when used in 40 CFR 60, shall mean the Secretary or the Secretary's designee.
[40 CFR 60.2; Rule 62-204.800(7)(a), F.A.C.]

A.2.0. Compliance with Standards.

A.2.1. Credible Evidence. For the purpose of submitting compliance certifications or establishing whether or not a person has violated or is in violation of any standard in 40 CFR 60, nothing in 40 CFR 60 shall preclude the use, including the exclusive use, of any credible evidence or information, relevant

to whether a source would have been in compliance with applicable requirements if the appropriate performance or compliance test or procedure had been performed.

[40 CFR 60.11(g)]

A.2.2. Circumvention. No owner or operator subject to the provisions of 40 CFR 60 shall build, erect, install, or use any article, machine, equipment or process, the use of which conceals an emission which would otherwise constitute a violation of an applicable standard. Such concealment includes, but is not limited to, the use of gaseous diluents to achieve compliance with an opacity standard or with a standard which is based on the concentration of a pollutant in the gases discharged to the atmosphere.

[40 CFR 60.12]

A.2.3. Federal Requirements. These emissions units are also subject to all of the applicable terms and conditions contained in the following attached appendices:

Appendix A, 40 CFR 60, Subpart A - General Provisions
[Rule 62-213.440, F.A.C.]

Essential Potential to Emit (PTE) Parameters

A.3. Capacity.

(a) Each of the three MWC's have a design rated capacity of 350 tons of municipal solid waste (MSW) per day, and 140 MMBtu heat input per hour, assuming a heating value of 4,800 Btu per pound. The maximum individual MWC's throughput shall not exceed 114% of either the design MSW charging rate of 350 TPD or the heat input of 140 MMBtu/hr. **This is equivalent to a limit of 103,850 pounds of steam per hour (four-hour average) per emissions unit.**

(b) The procedures specified in paragraph (1) shall be used for calculating municipal waste combustor unit capacity as defined under 40 CFR 60.51b.

(1) For municipal waste combustor units capable of combusting municipal solid waste continuously for a 24-hour period, municipal waste combustor unit capacity shall be calculated based on 24 hours of operation at the maximum charging rate. The maximum charging rate shall be determined as specified in paragraphs (i) and (ii) as applicable.

(i) For combustors that are designed based on heat capacity, the maximum charging rate shall be calculated based on the maximum design heat input capacity of the unit and a heating value of 12,800 kilojoules per kilogram for combustors firing refuse-derived fuel and a heating value of 10,500 kilojoules per kilogram for combustors firing municipal solid waste that is not refuse-derived fuel.

(ii) For combustors that are not designed based on heat capacity, the maximum charging rate shall be the maximum design charging rate.

[40 CFR 60.31b and 40 CFR 60.58b(j); Rules 62-4.160(2) and 62-210.200(PTE), F.A.C.; and PSD-FL-127]

A.4. Emissions Unit Operating Rate Limitation After Testing. See Specific Condition A.51.

[Rule 62-297.310(2), F.A.C.]

A.5. Maximum Demonstrated Municipal Waste Combustor Unit Load. Maximum demonstrated municipal waste combustor unit load means the highest 4-hour arithmetic average municipal waste combustor unit load achieved during four consecutive hours during the most recent dioxin/furan performance test demonstrating compliance with the applicable limit for municipal waste combustor organics specified in Specific Condition A.28.

[40 CFR 60.34b(b) and 40 CFR 60.51b]

A.6. Maximum Demonstrated Particulate Matter Control Device Temperature. Maximum demonstrated particulate matter control device temperature means the highest 4-hour arithmetic average flue gas temperature measured at the particulate matter control device inlet during four consecutive hours during the most recent dioxin/furan performance test demonstrating compliance with the applicable limit for municipal waste combustor organics specified in Specific Condition A.28.
[40 CFR 60.34b(b) and 40 CFR 60.51b]

A.7.0.0. Methods of Operation.

A.7.1.0. Fuels.

A.7.1.1. Except as provided below, the primary fuel allowed to be burned in the MWC's is municipal solid waste. Other wastes shall not be burned without written prior approval from the Department.

A.7.1.2. The primary fuel for the facility is municipal solid waste (MSW), including the items and materials that fit within the definition of MSW contained in either 40 CFR 60.51b or Section 403.706(5), F.S.

A.7.1.3. Unauthorized Fuel. Subject to the limitations contained in this permit, the authorized fuels for the facility also include the other solid wastes that are not MSW which are described in Specific Conditions A.7.1.7., A.7.1.8., and A.7.1.9., below. However, the facility

(a) shall not burn:

- (1) those materials that are prohibited by state or federal law;
- (2) those materials that are prohibited by this permit;
- (3) lead acid batteries;
- (4) hazardous waste;
- (5) nuclear waste;
- (6) radioactive waste;
- (7) sewage sludge;
- (8) explosives;
- (9) beryllium-containing waste, as defined in 40 CFR 61, Subpart C.

(b) and shall not knowingly burn:

- (1) untreated biomedical waste from biomedical waste generators regulated pursuant to Chapter 64E-16, F.A.C., and from other similar generators (or sources);
- (2) segregated loads of biological waste.

[Rules 62-4.070(3), 62-213.410, and 62-213.440, F.A.C.]

{Permitting Note: See the attached Appendix BW, Biomedical Waste Definitions, for definitions of what constitutes biomedical waste.}

A.7.1.4. The fuel may be received either as a mixture or as a single-item stream (segregated load) of discarded materials. If the facility intends to use an authorized fuel that is segregated non-MSW material, the fuel shall be either:

- (a) well mixed with MSW in the refuse pit; or
- (b) alternately charged with MSW in the hopper.

[Rules 62-4.070(3) and 62-213.440, F.A.C.]

A.7.1.5. The facility operator shall prepare and maintain records concerning the description and quantities of all segregated loads of non-MSW material which are received and used as fuel at the facility, and subject to a percentage weight limitation, below (Specific Conditions A.7.1.8. and A.7.1.9.). For the purposes of this permit, a segregated load is defined to mean a container or truck that is almost completely or exclusively filled with a single item or homogeneous composition of waste material, as determined by visual observation.

[Rules 62-4.070(3) and 62-213.440, F.A.C.]

A.7.1.6. To ensure that the facility's fuel does not adversely affect the facility's combustion process or emissions, the facility operator shall:

- (a) comply with good combustion operating practices in accordance with 40 CFR 60.53b;
- (b) install, operate and maintain continuous emissions monitors (CEMS) for oxygen, carbon monoxide, sulfur dioxide, oxides of nitrogen and temperature in accordance with 40 CFR 60.58b; and
- (c) record and maintain the CEMS data in accordance with 40 CFR 60.59b.

These steps shall be used to ensure and verify continuous compliance with the emissions limitations in this permit.

Natural or propane gas may be used as fuel during warm-up, startup, shutdown, and malfunction periods, and at other times when necessary and consistent with good combustion practices.

[Rules 62-4.070(3) and 62-213.440, F.A.C.]

A.7.1.7. Subject to the conditions and limitations contained in this permit, the following other solid waste may be used as fuel at the facility:

- (a) Confidential, proprietary or special documents (including but not limited to business records, lottery tickets, event tickets, coupons and microfilm);
- (b) Contraband which is being destroyed at the request of appropriately authorized local, state or federal governmental agencies, provided that such material is not an explosive, a propellant, a hazardous waste, or otherwise prohibited at the facility. For the purposes of this section, contraband includes but is not limited to drugs, narcotics, fruits, vegetables, plants, counterfeit money, and counterfeit consumer goods;
- (c) Wood pallets, clean wood, and land clearing debris;
- (d) Packaging materials and containers;
- (e) Clothing, natural and synthetic fibers, fabric remnants, and similar debris, including but not limited to aprons and gloves; or
- (f) Rugs, carpets, and floor coverings, but not asbestos-containing materials or polyethylene or polyurethane vinyl floor coverings.

[Rules 62-4.070(3) and 62-213.440, F.A.C.]

A.7.1.8. Subject to the conditions and limitations contained in this permit, waste tires may be used as fuel at the facility. The total quantity of waste tires received as segregated loads and burned at the facility shall not exceed 3%, by weight, of the facility's total fuel. Compliance with this limitation shall be determined by using a calendar month average.

[Rules 62-4.070(3) and 62-213.440, F.A.C.]

A.7.1.9. Subject to the conditions and limitations contained in this permit, the following other solid waste materials may be used as fuel at the facility (i.e., the following are authorized fuels that are non-MSW material). The total quantity of the following non-MSW material received as segregated loads and

burned at the facility shall not exceed 5%, by weight, of the facility's total fuel. Compliance with this limitation shall be determined by using a calendar month average.

- (a) Construction and demolition debris.
- (b) Oil spill debris from aquatic, coastal, estuarine or river environments. Such items or materials include but are not limited to rags, wipes, and absorbents.
- (c) Items suitable for human, plant or domesticated animal use, consumption or application where the item's shelf-life has expired or the generator wishes to remove the items from the market. Such items or materials include but are not limited to off-specification or expired consumer products, pharmaceuticals, medications, health and personal care products, cosmetics, foodstuffs, nutritional supplements, returned goods, and controlled substances.
- (d) Consumer-packaged products intended for human or domesticated animal use or application but not consumption. Such items or materials include but are not limited to carpet cleaners, household or bathroom cleaners, polishes, waxes and detergents.
- (e) Waste materials that:
 - (i) are generated in the manufacture of items in categories (c) or (d), above and are functionally or commercially useless (expired, rejected or spent); or
 - (ii) are not yet formed or packaged for commercial distribution. Such items or materials must be substantially similar to other items or materials routinely found in MSW.
- (f) Waste materials that contain oil from:
 - (i) the routine cleanup of industrial or commercial establishments and machinery; or
 - (ii) spills of virgin or used petroleum products. Such items or materials include but are not limited to rags, wipes, and absorbents.
- (g) Used oil and used oil filters. Used oil containing a PCB concentration equal or greater than 50 ppm shall not be burned, pursuant to the limitations of 40 CFR 761.20(e).
- (h) Waste materials generated by manufacturing, industrial or agricultural activities, provided that these items or materials are substantially similar to items or materials that are found routinely in MSW, subject to prior approval of the Department.

Waste materials specifically authorized above do not require prior Department approval before combustion.

[Rules 62-4.070(3) and 62-213.440, F.A.C.]

A.7.2.0. Auxiliary Fuel Burners. These devices shall be used at startup during the introduction of MSW fuel until design furnace gas temperature is achieved. They shall be fueled only with natural or propane gas.

[Rules 62-4.160(2), 62-210.200, and 62-213.440(1), F.A.C.; and, PSD-FL-127.]

A.8. Hours of Operation. These emissions units are allowed to operate continuously, i.e., 8,760 hours/year.

[Rule 62-210.200(PTE), F.A.C.; PSD-FL-127]

Operating Practices and Requirements

A.9. No owner or operator of an affected facility shall cause such facility to operate at a load level greater than 110 percent of the maximum demonstrated municipal waste combustor unit load as defined in Specific Condition A.5., except as specified below. The averaging time is specified in Specific Condition A.11.

(1) During the annual dioxin/furan or mercury performance test and the 2 weeks preceding the annual dioxin/furan or mercury performance test, no municipal waste combustor unit load limit is applicable if the provisions of paragraph (b)(2) of this section are met.

(2) The municipal waste combustor unit load limit may be waived in writing by the Administrator for the purpose of evaluating system performance, testing new technology or control technologies, diagnostic testing, or related activities for the purpose of improving facility performance or advancing the state-of-the-art for controlling facility emissions. The municipal waste combustor unit load limit continues to apply, and remains enforceable, until and unless the Administrator grants the waiver.

[40 CFR 60.34b(b) and 40 CFR 60.53b(b)]

A.10. No owner or operator of an affected facility shall cause such facility to operate at a temperature, measured at the particulate matter control device inlet, exceeding 17°C above the maximum demonstrated particulate matter control device temperature as defined in Specific Condition A.6., except as specified below. The averaging time is specified in Specific Condition A.11. These requirements apply to each particulate matter control device utilized at the affected facility.

(1) During the annual dioxin/furan or mercury performance test and the 2 weeks preceding the annual dioxin/furan or mercury performance test, no particulate matter control device temperature limitations are applicable if the provisions of paragraph (b)(2) of this section are met.

(2) The particulate matter control device temperature limits may be waived in writing by the Administrator for the purpose of evaluating system performance, testing new technology or control technologies, diagnostic testing, or related activities for the purpose of improving facility performance or advancing the state-of-the-art for controlling facility emissions. The temperature limits continue to apply, and remain enforceable, until and unless the Administrator grants the waiver.

[40 CFR 60.34b(b) and 40 CFR 60.53b(c)]

A.11. Operating Requirements. The procedures specified in paragraphs (1) through (12) shall be used for determining compliance with the operating requirements under 40 CFR 60.53b.

(1) Compliance with the carbon monoxide emission limits in 40 CFR 60.53b(a) shall be determined using a 4-hour block arithmetic average.

(2) Reserved.

(3) The owner or operator of an affected facility shall install, calibrate, maintain, and operate a continuous emission monitoring system for measuring carbon monoxide at the combustor outlet and record the output of the system and shall follow the procedures and methods specified in paragraphs(i) through(iii).

(i) The continuous emission monitoring system shall be operated according to Performance Specification 4A in appendix B of 40 CFR 60.

(ii) During each relative accuracy test run of the continuous emission monitoring system required by Performance Specification 4A in appendix B of 40 CFR 60, carbon monoxide and oxygen (or carbon dioxide) data shall be collected concurrently (or within a 30- to 60-minute period) by both the continuous emission monitors and the test methods specified in paragraphs (A) and(B). For affected facilities subject to the 100 parts per million dry volume carbon monoxide standard, the relative accuracy criterion of 5 parts per million dry volume is calculated as the absolute value of the mean difference between the reference method and continuous emission monitoring systems.

(A) For carbon monoxide, EPA Reference Method 10, 10A, or 10B shall be used.

(B) For oxygen (or carbon dioxide), EPA Reference Method 3, 3A, or 3B, or ASME PTC-19-10-1981—Part 10 (incorporated by reference, see 40 CFR 60.17 of subpart A of this part), as applicable shall be used.

- (iii) The span value of the continuous emission monitoring system shall be 125 percent of the maximum estimated hourly potential carbon monoxide emissions of the municipal waste combustor unit.
- (4) The 4-hour block and 24-hour daily arithmetic averages specified in paragraph (1) shall be calculated from 1-hour arithmetic averages expressed in parts per million by volume corrected to 7 percent oxygen (dry basis). The 1-hour arithmetic averages shall be calculated using the data points generated by the continuous emission monitoring system. At least two data points shall be used to calculate each 1-hour arithmetic average.
- (5) The owner or operator of an affected facility may request that compliance with the carbon monoxide emission limit be determined using carbon dioxide measurements corrected to an equivalent of 7 percent oxygen. The relationship between oxygen and carbon dioxide levels for the affected facility shall be established as specified in 40 CFR 60.58b(b)(6).
- (6) The procedures specified in paragraphs (i) through (v) shall be used to determine compliance with load level requirements under 40 CFR 60.53b(b).
- (i) The owner or operator of an affected facility with steam generation capability shall install, calibrate, maintain, and operate a steam flow meter or a feedwater flow meter; measure steam (or feedwater) flow in kilograms per hour (or pounds per hour) on a continuous basis; and record the output of the monitor. Steam (or feedwater) flow shall be calculated in 4-hour block arithmetic averages.
- (ii) The method included in the "American Society of Mechanical Engineers Power Test Codes: Test Code for Steam Generating Units, Power Test Code 4.1-1964 (R1991)" section 4 (incorporated by reference, see 40 CFR 60.17) shall be used for calculating the steam (or feedwater) flow required under paragraph (6)(i). The recommendations in "American Society of Mechanical Engineers Interim Supplement 19.5 on Instruments and Apparatus: Application, Part II of Fluid Meters, 6th edition (1971)," chapter 4 (incorporated by reference-see 40 CFR 60.17) shall be followed for design, construction, installation, calibration, and use of nozzles and orifices except as specified in (iii).
- (iii) Measurement devices such as flow nozzles and orifices are not required to be recalibrated after they are installed.
- (iv) All signal conversion elements associated with steam (or feedwater flow) measurements must be calibrated according to the manufacturer's instructions before each dioxin/furan performance test, and at least once per year.
- (7) To determine compliance with the maximum particulate matter control device temperature requirements under 40 CFR 60.53b(c), the owner or operator of an affected facility shall install, calibrate, maintain, and operate a device for measuring on a continuous basis the temperature of the flue gas stream at the inlet to each particulate matter control device utilized by the affected facility. Temperature shall be calculated in 4-hour block arithmetic averages.
- (8) The maximum demonstrated municipal waste combustor unit load shall be determined during the initial performance test for dioxins/furans and each subsequent performance test during which compliance with the dioxin/furan emission limit specified in 40 CFR 60.33b(c)(1) is achieved. The maximum demonstrated municipal waste combustor unit load shall be the highest 4-hour arithmetic average load achieved during four consecutive hours during the most recent test during which compliance with the dioxin/furan emission limit was achieved. If a subsequent dioxin/furan performance test is being performed on only one affected facility at the MWC plant, as provided in paragraph (g)(5)(iii) of this section, the owner or operator may elect to apply the same maximum municipal waste combustor unit load from the tested facility for all the similarly designed and operated affected facilities at the MWC plant.

(9) For each particulate matter control device employed at the affected facility, the maximum demonstrated particulate matter control device temperature shall be determined during the initial performance test for dioxins/furans and each subsequent performance test during which compliance with the dioxin/furan emission limit specified in 40 CFR 60.52b(c) is achieved. The maximum demonstrated particulate matter control device temperature shall be the highest 4-hour arithmetic average temperature achieved at the particulate matter control device inlet during four consecutive hours during the most recent test during which compliance with the dioxin/furan limit was achieved. If a subsequent dioxin/furan performance test is being performed on only one affected facility at the MWC plant, as provided in paragraph (g)(5)(iii) of this section, the owner or operator may elect to apply the same maximum particulate matter control device temperature from the tested facility for all the similarly designed and operated affected facilities at the MWC plant.

(10) At a minimum, valid continuous emission monitoring system hourly averages shall be obtained as specified in paragraphs(i) and(ii) for at least 90 percent of the operating hours per calendar quarter and 95 percent of the operating hours per calendar year that the affected facility is combusting municipal solid waste.

(i) At least two data points per hour shall be used to calculate each 1-hour arithmetic average.

(ii) At a minimum, each carbon monoxide 1-hour arithmetic average shall be corrected to 7 percent oxygen on an hourly basis using the 1-hour arithmetic average of the oxygen continuous emission monitoring system data.

(11) All valid continuous emission monitoring system data must be used in calculating the parameters specified under 40 CFR 60.58b(i) even if the minimum data requirements of paragraph (10) are not met. When carbon monoxide continuous emission data are not obtained because of continuous emission monitoring system breakdowns, repairs, calibration checks, and zero and span adjustments, emissions data shall be obtained using other monitoring systems as approved by the Administrator or EPA Reference Method 10 to provide, as necessary, the minimum valid emission data.

(12) Quarterly accuracy determinations and daily calibration drift tests for the carbon monoxide continuous emission monitoring system shall be performed in accordance with procedure 1 in appendix F of 40 CFR 60.

[40 CFR 60.38b and 40 CFR 60.58b(i)]

Operator Training and Certification

{Permitting note: The State 111(d) plan was approved by U.S. EPA on November 13, 1997. The facility start-up date was in January, 1991.}

A.12. Standards for municipal waste combustor operator training and certification.

(a) No later than the date 6 months after the date of startup of an affected facility or 12 months after State plan approval [40 CFR 60.39b(c)(4)(ii)], whichever is later, each chief facility operator and shift supervisor shall obtain and maintain a current provisional operator certification from either the American Society of Mechanical Engineers [QRO-1-1994 (incorporated by reference - see 40 CFR 60.17 of Subpart A)] or a State certification program.

(b) No later than the date 6 months after the date of startup of an affected facility or 12 months after State plan approval [40 CFR 60.39b(c)(4)(ii)], whichever is later, each chief facility operator and shift supervisor shall have completed full certification or shall have scheduled a full certification exam with either the American Society of Mechanical Engineers [QRO-1-1994 (incorporated by reference - see 40 CFR 60.17 of Subpart A)] or a State certification program.

(c) No owner or operator of an affected facility shall allow the facility to be operated at any time unless one of the following persons is on duty and at the affected facility: A fully certified chief facility

operator, a provisionally certified chief facility operator who is scheduled to take the full certification exam according to the schedule specified in paragraph (b), a fully certified shift supervisor, or a provisionally certified shift supervisor who is scheduled to take the full certification exam according to the schedule specified in paragraph (b).

(1) The requirement specified in paragraph (c) shall take effect 6 month after the date of startup of the affected facility or 12 months after State plan approval [40 CFR 60.39b(c)(4)(ii)], whichever is later.

(2) If both the certified chief facility operator and certified shift supervisor are unavailable, a provisionally certified control room operator on site at the municipal waste combustion unit may fulfill the certified operator requirement. Depending on the length of time that a certified chief facility operator and certified shift supervisor are away, the owner or operator of the affected facility must meet one of three criteria:

(i) When the certified chief facility operator and certified shift supervisor are both off site for 12 hours or less, and no other certified operator is on site, the provisionally certified control room operator may perform the duties of the certified chief facility operator or certified shift supervisor.

(ii) When the certified chief facility operator and certified shift supervisor are off site for more than 12 hours, but for two weeks or less, and no other certified operator is on site, the provisionally certified control room operator may perform the duties of the certified chief facility operator or certified shift supervisor without notice to, or approval by, the Administrator. However, the owner or operator of the affected facility must record the period when the certified chief facility operator and certified shift supervisor are off site and include that information in the annual report as specified under 40 CFR 60.59b(g)(5).

(iii) When the certified chief facility operator and certified shift supervisor are off site for more than two weeks, and no other certified operator is on site, the provisionally certified control room operator may perform the duties of the certified chief facility operator or certified shift supervisor without approval by the Administrator. However, the owner or operator of the affected facility must take two actions:

(A) Notify the Administrator in writing. In the notice, state what caused the absence and what actions are being taken by the owner or operator of the facility to ensure that a certified chief facility operator or certified shift supervisor is on site as expeditiously as practicable.

(B) Submit a status report and corrective action summary to the Administrator every four weeks following the initial notification. If the Administrator provides notice that the status report or corrective action summary is disapproved, the municipal waste combustion unit may continue operation for 90 days, but then must cease operation. If corrective actions are taken in the 90-day period such that the Administrator withdraws the disapproval, municipal waste combustion unit operation may continue.

(3) A provisionally certified operator who is newly promoted or recently transferred to a shift supervisor position or a chief facility operator position at the municipal waste combustion unit may perform the duties of the certified chief facility operator or certified shift supervisor without notice to, or approval by, the Administrator for up to six months before taking the ASME QRO certification exam.

(d) All chief facility operators, shift supervisors, and control room operators at affected facilities must complete the EPA or State municipal waste combustor operator training course no later than the date 6 months after the date of startup of the affected facility, or by 12 months after State plan approval [40 CFR 60.39b(c)(4)(iii)], whichever is later.

(e) The owner or operator of an affected facility shall develop and update on a yearly basis a site-specific operating manual that shall, at a minimum, address the elements of municipal waste combustor unit operation specified in paragraph (e)(1) through (e)(11).

- (1) A summary of the applicable standards;
- (2) A description of basic combustion theory applicable to a municipal waste combustor unit;
- (3) Procedures for receiving, handling, and feeding municipal solid waste;
- (4) Municipal waste combustor unit startup, shutdown, and malfunction procedures;
- (5) Procedures for maintaining proper combustion air supply levels;
- (6) Procedures for operating the municipal waste combustor unit within the standards established;
- (7) Procedures for responding to periodic upset or off-specification conditions;
- (8) Procedures for minimizing particulate matter carryover;
- (9) Procedures for handling ash;
- (10) Procedures for monitoring municipal waste combustor unit emissions; and
- (11) Reporting and recordkeeping procedures.

(f) The owner or operator of an affected facility shall establish a training program to review the operating manual according to the schedule specified in paragraphs (f)(1) and (f)(2) with each person who has responsibilities affecting the operation of an affected facility including, but not limited to, chief facility operators, shift supervisors, control room operators, ash handlers, maintenance personnel, and crane/load handlers.

(1) Each person specified in paragraph (f) shall undergo initial training no later than the date specified in paragraph (f)(1)(i), (f)(1)(ii), or (f)(1)(iii), whichever is later.

- (i) The date 6 months after the date of startup of the affected facility;
- (ii) The date prior to the day the person assumes responsibilities affecting municipal waste combustor unit operation; or
- (iii) 12 months after State plan approval [40 CFR 60.39b(c)(4)(iii)].

(2) Annually, following the initial review required by paragraph (f)(1).

(g) The operating manual required by paragraph (e) shall be kept in a readily accessible location for all persons required to undergo training under paragraph (f). The operating manual and records of training shall be available for inspection by the EPA or its delegated enforcement agency upon request.

[40 CFR 60.35b, 40 CFR 60.39b(c)(4)(ii) & (iii), and 40 CFR 60.54b]

A.13. The requirement specified in 40 CFR 60.54b(d) does not apply to chief operators, shift supervisors, and control room operators who have obtained full certification from the American Society of Mechanical Engineers on or before the date of State plan approval.

[40 CFR 60.39b(c)(4)(iii)(A)]

A.14. [Reserved.]

A.15. The initial training requirements specified in 40 CFR 60.54b(f)(1) shall be completed no later than the date specified in (1), (2), or (3), whichever is later.

- (1) The date six (6) months after the date of startup of the affected facility;
- (2) Twelve (12) months after State plan approval; or
- (3) The date prior to the day when the person assumes responsibilities affecting municipal waste combustor unit operation.

[40 CFR 60.39b(c)(4)(iii)(C)]

Emission Limitations and Standards

{Permitting note: Table 1-1, Summary of Air Pollutant Standards and Terms, summarizes information for convenience purposes only. This table does not supersede any of the terms or conditions of this permit.}

{Permitting Note: Unless otherwise specified, the averaging times for Specific Conditions A.16. - A.32. are based on the specified averaging time of the applicable test method.}

Particulate Matter

A.16.0. The Subpart Cb emission limit for particulate matter contained in the gases discharged to the atmosphere is 27 milligrams per dry standard cubic meter, corrected to 7 percent oxygen (Equivalent to 7.82 lbs/hr at 100% capacity). On and after April 28, 2009, the Subpart Cb emission limit for particulate matter contained in the gases discharged to the atmosphere from a designated facility is 25 milligrams per dry standard cubic meter, corrected to 7 percent oxygen (Equivalent to 7.24 lbs/hr at 100% capacity). Testing shall be on an annual basis.
[40 CFR 60.33b(a)(1)(i)]

A.16.1. The BACT emission limit for particulate matter contained in the gases discharged to the atmosphere is 0.015 grains/dscf corrected to 12% CO₂ (Equivalent to 9.74 lbs/hr at 100% capacity). Compliance with the streamlined limit in Specific Condition A.16.2 assures compliance with all particulate matter emissions limits. Testing shall be on an annual basis.
[PSD-FL-127]

A.16.2. Streamlined Particulate Matter Emission Limit. Pursuant to Rule 62-213.440(1), F.A.C., the following emissions limits apply for particulate matter. Prior to April 28, 2009, the emissions limit for particulate matter contained in gases discharged to the atmosphere from these emissions units shall not exceed 27 mg/dscm (Equivalent to 7.82 lbs per hour at 100% capacity). On and after April 28, 2009, the emissions limit for particulate matter contained in gases discharged to the atmosphere from these emissions units shall not exceed 25 mg/dscm (Equivalent to 7.24 lbs per hour at 100% capacity). Compliance with this streamlined limit assures compliance with all particulate matter emissions limits. Testing shall be on an annual basis.
[Rule 62-213.440(1), F.A.C.; and, applicant request]

A.16.3. Compliance Assurance Monitoring. These emissions units are subject to the Compliance Assurance Monitoring (CAM) requirements contained in the attached Appendix CAM. Failure to adhere to the monitoring requirements specified does not necessarily indicate an exceedance of a specific emissions limitation; however, it may constitute good reason to require compliance testing pursuant to Rule 62-297.310(7)(b), F.A.C. The CAM plan satisfies the monitoring requirements for the particulate matter control equipment.
[40 CFR 64; Rules 62-204.800 and 62-213.440(1)(b)1.a., F.A.C.]

Visible Emissions

A.17.0. The Subpart Cb emission limit for opacity exhibited by the gases discharged to the atmosphere is 10 percent (6-minute block average). Testing shall be on an annual basis. Pursuant to Appendix TV-6, Title V Conditions, condition number 12.(9), the COMS data may be used as evidence to determine compliance with the opacity standard.
[40 CFR 60.33b(a)(1)(iii); Rules 64-4.160 and 62-213.440(1)(b), F.A.C.]

A.17.1. The BACT emission limit for opacity exhibited by the gases discharged to the atmosphere is 15 percent (6-minute block average). Testing shall be on an annual basis. Pursuant to Appendix TV-6, Title V Conditions, condition number 12.(9), the COMS data may be used as evidence to determine compliance with the opacity standard.

[PSD-FL-127]

Cadmium

A.18. Before April 28, 2009, the emission limit for cadmium contained in the gases discharged to the atmosphere from a designated facility is 40 micrograms per dry standard cubic meter, corrected to 7 percent oxygen. On and after April 28, 2009, the emission limit for cadmium contained in the gases discharged to the atmosphere from a designated facility is 35 micrograms per dry standard cubic meter, corrected to 7 percent oxygen. Testing frequency shall be annual.

[40 CFR 60.33b(a)(2)(i)]

Mercury

A.19.0. Before April 28, 2009, the Subpart Cb emission limit for mercury contained in the gases discharged to the atmosphere from a designated facility is 80 micrograms per dry standard cubic meter or 15 percent of the potential mercury emission concentration (85-percent reduction by weight), corrected to 7 percent oxygen, whichever is less stringent. On and after April 28, 2009, the Subpart Cb emission limit for mercury contained in the gases discharged to the atmosphere from a designated facility is 50 micrograms per dry standard cubic meter or 15 percent of the potential mercury emission concentration (85-percent reduction by weight), corrected to 7 percent oxygen, whichever is less stringent. Testing frequency shall be annual.

[40 CFR 60.33b(a)(3)]

A.19.1. The SIP-based emissions limit for mercury contained in the gases discharged to the atmosphere is 70 micrograms per dry standard cubic meter of flue gas, corrected to 7 percent O₂, or 20 percent by weight of the mercury in the flue gas upstream of the mercury control device (80 percent reduction by weight), whichever occurs first. Testing frequency shall be annual.

[Rule 62-296.416(3)(a)1., F.A.C.]

A.20. The BACT emission limit for mercury contained in the gases discharged to the atmosphere is 0.0008 lb/MMBtu heat input. Testing frequency shall be annual.

[PSD-FL-127]

{For informational purposes, equivalent to 0.11 lbs/hr and 0.49 TPY at 100% capacity.}

Lead

A.21. Before April 28, 2009, the Subpart Cb emission limit for lead contained in the gases discharged to the atmosphere is 440 micrograms per dry standard cubic meter, corrected to 7 percent oxygen. On and after April 28, 2009, the Subpart Cb emission limit for lead contained in the gases discharged to the atmosphere from a designated facility is 400 micrograms per dry standard cubic meter, corrected to 7 percent oxygen. Testing frequency shall be annual.

[40 CFR 60.33b(a)(4)]

A.22. The BACT emission limit for lead contained in the gases discharged to the atmosphere from each unit shall not exceed 0.0007 lb/MMBtu heat input. Testing frequency shall be annual.

[PSD-FL-127]

{For informational purposes, equivalent to 0.098 lbs/hr and 0.43 TPY at 100% capacity.}

Fluoride

A.23. Fluoride flue gas emissions from each unit shall not exceed 0.008 lb/MMBtu heat input. Testing frequency shall be annual.

[PSD-FL-127]

Beryllium

A.24. Beryllium flue gas emissions from each unit shall not exceed 1.35×10^{-7} lb/MMBtu heat input. Testing frequency shall be annual.

[PSD-FL-127]

Volatile Organic Compounds (VOC's)

A.25. VOC flue gas emissions from each unit shall not exceed 0.021 lb/MMBtu heat input. Testing frequency shall be every five years.

[PSD-FL-127]

Sulfur Dioxide

A.26.0. The Subpart Cb emission limit for sulfur dioxide contained in the gases discharged to the atmosphere is 29 parts per million by volume or 25 percent of the potential sulfur dioxide emission concentration (75-percent reduction by weight or volume), corrected to 7 percent oxygen (dry basis), whichever is less stringent. Compliance with this emission limit is based on a 24-hour daily geometric mean, and is demonstrated through the use of a certified continuous emissions monitor (see Specific Condition A.42.).

[40 CFR 60.33b(b)(3)(i)]

{Permitting Note: The annual SO₂ test that is required by Rule 62-297.310(7), F.A.C., can be done during the annual RATA as satisfaction of this requirement, provided all other testing requirements specified in the permit are met.}

A.26.1. The BACT emission limit for sulfur dioxide flue gas emissions from each unit shall not exceed 104 ppmvd corrected to 7% O₂ 3-hour (rolling) average, and 60 ppmvd corrected to 7% O₂ 6-hour (rolling) average; or 70% reduction of uncontrolled SO₂ emissions, 6-hour (rolling) average, but not to exceed 100 ppmvd corrected to 7% O₂, 6-hour (rolling) average. Continuous compliance is demonstrated through the use of a certified continuous emissions monitor.

[PSD-FL-127]

Hydrogen Chloride

A.27. The emission limit for hydrogen chloride contained in the gases discharged to the atmosphere is 29 parts per million by volume or 5 percent of the potential hydrogen chloride emission concentration

(95-percent reduction by weight or volume), corrected to 7 percent oxygen (dry basis), whichever is less stringent. Testing frequency shall be annual.
[40 CFR 60.33b(b)(3)(ii)]

Dioxins/Furans

A.28. The emission limit for dioxins/furans contained in the gases discharged to the atmosphere that do not employ an electrostatic precipitator-based emission control system is 30 nanograms per dry standard cubic meter (total mass), corrected to 7 percent oxygen. Testing frequency shall be annual. See Specific Condition A.44.

[40 CFR 60.33b(c)(1)(ii)]

Nitrogen Oxides

A.29. The Subpart Cb emission limit for nitrogen oxides contained in the gases discharged to the atmosphere is 205 parts per million by volume, corrected to 7 percent oxygen, dry basis. Continuous compliance is demonstrated through the use of a certified continuous emissions monitor.

[40 CFR 60.33b(d)]

A.30. The BACT emissions limit for nitrogen oxides contained in the gases discharged to the atmosphere is 0.643 lb/MMBtu heat input. Continuous compliance is demonstrated through the use of a certified continuous emissions monitor.

[PSD-FL-127]

{For informational purposes, equivalent to 90.02 lbs/hr and 394.29 TPY at 100% capacity.}

Carbon Monoxide

A.31.0. The Subpart Cb emission limit for carbon monoxide contained in the gases discharged to the atmosphere is 100 parts per million by volume, measured at the combustor outlet in conjunction with a measurement of oxygen concentration, corrected to 7 percent oxygen, dry basis. Calculated as an arithmetic average. Averaging time is a 4-hour block average beginning at midnight. Continuous compliance is demonstrated through the use of a certified continuous emissions monitor.

[40 CFR 60.34b(a)]

A.31.1. The BACT emission limit for carbon monoxide contained in the gases discharged to the atmosphere is 400 parts per million by volume, measured at the combustor outlet in conjunction with a measurement of oxygen concentration, corrected to 7 percent oxygen, dry basis, 1-hour average; and 100 ppmvd corrected to 7% O₂ on an 8-hour rolling average. Continuous compliance is demonstrated through the use of a certified continuous emissions monitor.

[PSD-FL-127]

{Permitting Note: The annual CO test that is required by Rule 62-297.310(7), F.A.C., can be done during the annual RATA as satisfaction of this requirement, provided all other testing requirements specified in the permit are met.}

Fugitive Ash Visible Emissions

A.32. Fugitive Ash Visible Emissions.

(a) On and after the date on which the initial performance test is completed or is required to be completed under 40 CFR 60.8 of Subpart A, no owner or operator of an affected facility shall cause to be discharged to the atmosphere visible emissions of combustion ash from an ash conveying system (including conveyor transfer points) in excess of 5 percent of the observation period (i.e., 9 minutes per 3-hour period), as determined by EPA Reference Method 22 observations as specified in 40 CFR 60.58b(k), except as provided in paragraphs (b) and (c). See Specific Condition A.49.

(b) The emission limit specified in paragraph (a) does not cover visible emissions discharged inside buildings or enclosures of ash conveying systems; however, the emission limit specified in paragraph (a) does cover visible emissions discharged to the atmosphere from buildings or enclosures of ash conveying systems.

(c) The provisions of paragraph (a) do not apply during maintenance and repair of ash conveying systems.

[40 CFR 60.36b and 40 CFR 60.55b]

Excess Emissions

{Permitting Note: The Excess Emissions Rule at Rule 62-210.700, F.A.C., cannot vary any requirement of an NSPS or NESHAP provision.}

A.33. The opacity standards set forth in 40 CFR 60 shall apply at all times except during periods of startup, shutdown, malfunction, and as otherwise provided in the applicable standard.

[40 CFR 60.11(c)]

A.34. At all times, including periods of startup, shutdown, and malfunction, owners and operators shall, to the extent practicable, maintain and operate any affected facility including associated air pollution control equipment in a manner consistent with good air pollution control practice for minimizing emissions. Determination of whether acceptable operating and maintenance procedures are being used will be based on information available to the Administrator which may include, but is not limited to, monitoring results, opacity observations, review of operating and maintenance procedures, and inspection of the source.

[40 CFR 60.11(d)]

A.35. Startup, Shutdown and Malfunction. The provisions for startup, shutdown, and malfunction are provided in paragraph (1).

(1) The standards under 40 CFR 60, Subpart Cb, as incorporated in Rule 62-204.800(8)(b), F.A.C., apply at all times except during periods of startup, shutdown, or malfunction. Duration of startup, shutdown, or malfunction periods are limited to 3 hours per occurrence, except as provided in 40 CFR 60.58b(a)(1)(iii). During periods of startup, shutdown, or malfunction, monitoring data shall be dismissed or excluded from compliance calculations, but shall be recorded and reported in accordance with the provisions of 40 CFR 60.59b(d)(7).

(i) The startup period commences when the affected facility begins the continuous burning of municipal solid waste and does not include any warm-up period when the affected facility is combusting fossil fuel or other non-municipal solid waste fuel, and no municipal solid waste is being fed to the combustor.

(ii) Continuous burning is the continuous, semi-continuous, or batch feeding of municipal solid waste for purposes of waste disposal, energy production, or providing heat to the combustion system in preparation for waste disposal or energy production. The use of municipal solid waste solely to

provide thermal protection of the grate or hearth during the startup period when municipal solid waste is not being fed to the grate is not considered to be continuous burning.

(iii) For the purpose of compliance with the carbon monoxide emission limits in 40 CFR 60.53b(a), if a loss of boiler water level control (e.g., boiler waterwall tube failure) or a loss of combustion air control (e.g., loss of combustion air fan, induced draft fan, combustion grate bar failure) is determined to be a malfunction, the duration of the malfunction period is limited to 15 hours per occurrence. During such periods of malfunction, monitoring data shall be dismissed or excluded from compliance calculations, but shall be recorded and reported in accordance with the provisions of 40 CFR 60.59b(d)(7).

[40 CFR 60.38b and 40 CFR 60.58b(a)]

A.36. Excess emissions resulting from malfunction shall be permitted provided that best operational practices to minimize emissions are adhered to and the duration of excess emissions shall be minimized but in no case exceed three hours in any 24 hour period unless specifically authorized by the Department for longer duration.

[Rule 62-210.700(1), F.A.C.; and, Applicant Request, dated March 31, 2000]

A.37. Excess emissions which are caused entirely or in part by poor maintenance, poor operation, or any other equipment or process failure which may reasonably be prevented during startup, shutdown, or malfunction shall be prohibited.

[Rule 62-210.700(4), F.A.C.]

Test Methods and Procedures

{Permitting note: Table 2-1, Summary of Compliance Requirements, summarizes information for convenience purposes only. This table does not supersede any of the terms or conditions of this permit.}

A.38. Performance tests shall be conducted under such conditions as the Administrator shall specify to the plant operator based on representative performance of the affected facility. The owner or operator shall make available to the Administrator such records as may be necessary to determine the conditions of the performance tests. Operations during periods of startup, shutdown, and malfunction shall not constitute representative conditions for the purpose of a performance test nor shall emissions in excess of the level of the applicable emission limit during periods of startup, shutdown, and malfunction be considered a violation of the applicable emission limit unless otherwise specified in the applicable standard. See Specific Condition **A.51**.

[40 CFR 60.8(c)]

Particulate Matter and Opacity

A.39. Except as provided in paragraph (c)(10) of this section, the procedures and test methods specified in paragraphs (1) through (11) shall be used to determine compliance with the emission limits for particulate matter and opacity.

(1) The EPA Reference Method 1 shall be used to select sampling site and number of traverse points.

(2) The EPA Reference Method 3, 3A, or 3B, or as an alternative ASME PTC-19-10-1981—Part 10, as applicable shall be used for gas analysis.

(3) The EPA Reference Method 5 shall be used for determining compliance with the particulate matter emission limit. The minimum sample volume shall be 1.7 cubic meters. The probe and filter holder

heating systems in the sample train shall be set to provide a gas temperature no greater than 160 °C. An oxygen or carbon dioxide measurement shall be obtained simultaneously with each Method 5 run.

(4) The owner or operator of an affected facility may request that compliance with the particulate matter emission limit be determined using carbon dioxide measurements corrected to an equivalent of 7 percent oxygen. The relationship between oxygen and carbon dioxide levels for the affected facility shall be established as specified in paragraph (6).

(5) As specified under 40 CFR 60.8, all performance tests shall consist of three test runs. The average of the particulate matter emission concentrations from the three test runs is used to determine compliance.

(6) In accordance with paragraphs (7) and (11), EPA Reference Method 9 shall be used for determining compliance with the opacity limit except as provided under 40 CFR 60.11(e)

(7) The owner or operator of an affected facility shall conduct an initial performance test for particulate matter emissions and opacity as required under 40 CFR 60.8.

(8) The owner or operator of an affected facility shall install, calibrate, maintain, and operate a continuous opacity monitoring system for measuring opacity and shall follow the methods and procedures specified in paragraphs (8)(i) through (8)(iv).

(i) The output of the continuous opacity monitoring system shall be recorded on a 6-minute block average basis.

(ii) The continuous opacity monitoring system shall be installed, evaluated, and operated in accordance with 40 CFR 60.13.

(iii) The continuous opacity monitoring system shall conform to Performance Specification 1 in appendix B of 40 CFR 60.

(iv) The initial performance evaluation shall be completed no later than 180 days after the date of the initial startup of the municipal waste combustor unit, as specified under 40 CFR 60.8.

(9) Following the date that the initial performance test for particulate matter is completed or is required to be completed under 40 CFR 60.8 for an affected facility, the owner or operator shall conduct a performance test for particulate matter on a calendar year basis (no less than 9 calendar months and no more than 15 calendar months following the previous performance test; and must complete five performance tests in each 5-year calendar period).

(10) <intentionally left blank>

(11) Following the date that the initial performance test for opacity is completed or is required to be completed under 40 CFR 60.8 for an affected facility, the owner or operator shall conduct a performance test for opacity on an annual basis (no less than 9 calendar months and no more than 15 calendar months following the previous performance test; and must complete five performance tests in each 5-year calendar period) using the test method specified in paragraph (c)(6) of this section.

[40 CFR 60.38b and 40 CFR 60.58b(c); and, PSD-FL-127]

Cadmium, Lead and Mercury

A.40. The procedures and test methods specified in paragraphs (1) and (2) shall be used to determine compliance with the emission limits for cadmium, lead, and mercury.

(1) The procedures and test methods specified in paragraphs (1)(i) through (1)(ix) shall be used to determine compliance with the emission limits for cadmium and lead.

(i) The EPA Reference Method 1 shall be used for determining the location and number of sampling points.

(ii) The EPA Reference Method 3, 3A, or 3B, or as an alternative ASME PTC-19-10-1981—Part 10, as applicable, shall be used for flue gas analysis.

(iii) The EPA Reference Method 29 shall be used for determining compliance with the cadmium and lead emission limits.

- (iv) An oxygen or carbon dioxide measurement shall be obtained simultaneously with each Method 29 test run for cadmium and lead required under paragraph (1)(iii).
 - (v) The owner or operator of an affected facility may request that compliance with the cadmium or lead emission limit be determined using carbon dioxide measurements corrected to an equivalent of 7 percent oxygen. The relationship between oxygen and carbon dioxide levels for the affected facility shall be established as specified in paragraph 40 CFR 60.58b(b)(6).
 - (vi) All performance tests shall consist of a minimum of three test runs conducted under representative full load operating conditions. The average of the cadmium or lead emission concentrations from three test runs or more shall be used to determine compliance.
 - (vii) Following the date of the initial performance test or the date on which the initial performance test is required to be completed under 40 CFR 60.8, the owner or operator of an affected facility shall conduct a performance test for compliance with the emission limits for cadmium and lead on a calendar year basis (no less than 9 calendar months and no more than 15 calendar months following the previous performance test; and must complete five performance tests in each 5-year calendar period).
 - (viii) [reserved]
 - (ix) [reserved]
- (2) The procedures and test methods specified in paragraphs (2)(i) through (2)(xi) shall be used to determine compliance with the mercury emission limit.
- (i) The EPA Reference Method 1 shall be used for determining the location and number of sampling points.
 - (ii) The EPA Reference Method 3, 3A, or 3B, or as an alternative ASME PTC-19-10-1981—Part 10, as applicable, shall be used for flue gas analysis.
 - (iii) The EPA Reference Method 29 or as an alternative ASTM D6784-02 shall be used to determine the mercury emission concentration. The minimum sample volume when using Method 29 for mercury shall be 1.7 cubic meters.
 - (iv) An oxygen (or carbon dioxide) measurement shall be obtained simultaneously with each Method 29 or as an alternative ASTM D6784-02 test run for mercury required under paragraph (2)(iii).
 - (v) The percent reduction in the potential mercury emissions (%P_{Hg}) is computed using equation 1:

$$[\%P_{HG}] = \left[\frac{E_i - E_o}{E_i} \right] \times 100 \quad (\text{equation 1})$$

where:

%P_{Hg} = percent reduction of the potential mercury emissions achieved.

E_i = potential mercury emission concentration measured at the control device inlet, corrected to 7 percent oxygen (dry basis).

E_o = controlled mercury emission concentration measured at the mercury control device outlet, corrected to 7 percent oxygen (dry basis).

- (vi) All performance tests shall consist of a minimum of three test runs conducted under representative full load operating conditions. The average of the mercury emission concentrations or percent reductions from three test runs or more is used to determine compliance.

(vii) The owner or operator of an affected facility may request that compliance with the mercury emission limit be determined using carbon dioxide measurements corrected to an equivalent of 7 percent oxygen. The relationship between oxygen and carbon dioxide levels for the affected facility shall be established as specified in paragraph 40 CFR 60.58b(b)(6).

(viii) The owner or operator of an affected facility shall conduct an initial performance test for mercury emissions as required under 40 CFR 60.8.

(ix) Following the date that the initial performance test for mercury is completed or is required to be completed under 40 CFR 60.8, the owner or operator of an affected facility shall conduct a performance test for mercury emissions on a calendar year basis (no less than 9 calendar months and no more than 15 calendar months from the previous performance test; and must complete five performance tests in each 5-year calendar period).

(x) [reserved]

(xi) The owner or operator of an affected facility where activated carbon injection is used to comply with the mercury emission limit shall follow the procedures specified in 40 CFR 60.58b(m) for measuring and calculating carbon usage. See Specific Condition A.86.

[40 CFR 60.38b and 40 CFR 60.58b(d)]

A.41. Mercury Emissions Test Method and Procedures. All mercury emissions tests performed pursuant to the requirements of this rule shall comply with the following provisions.

1. The test method for mercury shall be EPA Method 29 adopted in Rule 62-297, F.A.C.

2. Test procedures shall meet all applicable requirements of Chapter 62-297, F.A.C.

(4) Flue Gas Temperature Standard. Waste-to-energy facilities choosing to control mercury emissions through the use of post-combustion control equipment designed to remove mercury from flue gases shall comply with the flue gas temperature standard of Rule 62-296.416(4)(a), F.A.C.

(a) Temperature Standard. The flue gas temperature standard set forth in 40 CFR 60.53b(c), incorporated by reference in Rule 62-2-4.800, F.A.C., shall apply.

(b) Temperature Monitoring. The temperature monitoring requirements set forth in 40 CFR 60.58b(i), incorporated by reference in Rule 62-204.800, F.A.C., shall apply.

(5) Carbon Usage Rate. The carbon injection rate operating standard and monitoring requirements set forth in 40 CFR 60.58b(m), incorporated by reference in Rule 62-204.800, F.A.C.; shall apply.

See Specific Condition A.86.

[Rule 62-296.416(3)(d), F.A.C.]

Sulfur Dioxide

A.42. The procedures and test methods specified in paragraphs (1) through (14) shall be used for determining compliance with the sulfur dioxide emission.

(1) The EPA Reference Method 19, section 4.3, shall be used to calculate the daily geometric average sulfur dioxide emission concentration.

(2) The EPA Reference Method 19, section 5.4, shall be used to determine the daily geometric average percent reduction in the potential sulfur dioxide emission concentration.

(3) The owner or operator of an affected facility may request that compliance with the sulfur dioxide emission limit be determined using carbon dioxide measurements corrected to an equivalent of 7 percent oxygen. The relationship between oxygen and carbon dioxide levels for the affected facility shall be established as specified in 40 CFR 60.58b(b)(6).

(4) The owner or operator of an affected facility shall conduct an initial performance test for sulfur dioxide emissions as required under 40 CFR 60.8. Compliance with the sulfur dioxide emission limit (concentration or percent reduction) shall be determined by using the continuous emission monitoring system specified in paragraph (5) to measure sulfur dioxide and calculating a 24-hour daily geometric

average emission concentration or a 24-hour daily geometric average percent reduction using EPA Reference Method 19, sections 4.3 and 5.4, as applicable.

(5) The owner or operator of an affected facility shall install, calibrate, maintain, and operate a continuous emission monitoring system for measuring sulfur dioxide emissions discharged to the atmosphere and record the output of the system.

(6) Following the date that the initial performance test for sulfur dioxide is completed or is required to be completed under 40 CFR 60.8, compliance with the sulfur dioxide emission limit shall be determined based on the 24-hour daily geometric average of the hourly arithmetic average emission concentrations using continuous emission monitoring system outlet data if compliance is based on an emission concentration, or continuous emission monitoring system inlet and outlet data if compliance is based on a percent reduction.

(7) At a minimum, valid continuous monitoring system hourly averages shall be obtained as specified in paragraphs (7)(i) and (7)(ii) for 90 percent of the operating hours per calendar quarter and 95 percent of the operating days per calendar year that the affected facility is combusting municipal solid waste.

(i) At least two data points per hour shall be used to calculate each 1-hour arithmetic average.

(ii) Each sulfur dioxide 1-hour arithmetic average shall be corrected to 7 percent oxygen on an hourly basis using the 1-hour arithmetic average of the oxygen (or carbon dioxide) continuous emission monitoring system data.

(8) The 1-hour arithmetic averages required under paragraph (6) shall be expressed in parts per million corrected to 7 percent oxygen (dry basis) and used to calculate the 24-hour daily geometric average emission concentrations and daily geometric average emission percent reductions. The 1-hour arithmetic averages shall be calculated using the data points required under 40 CFR 60.13(e)(2).

(9) All valid continuous emission monitoring system data shall be used in calculating average emission concentrations and percent reductions even if the minimum continuous emission monitoring system data requirements of paragraph (7) are not met.

(10) The procedures under 40 CFR 60.13 shall be followed for installation, evaluation, and operation of the continuous emission monitoring system.

(11) The initial performance evaluation shall be completed no later than 180 days after the date of initial startup of the municipal waste combustor as specified under 40 CFR 60.8.

(12) The continuous emission monitoring system shall be operated according to Performance Specification 2 in 40 CFR 60 Appendix B. For sources that have actual inlet emissions less than 100 parts per million dry volume, the relative accuracy criterion for inlet sulfur dioxide continuous emission monitoring systems should be no greater than 20 percent of the mean value of the reference method test data in terms of the units of the emission standard, or 5 parts per million dry volume absolute value of the mean difference between the reference method and the continuous emission monitoring systems, whichever is greater.

(i) During each relative accuracy test run of the continuous emission monitoring system required by Performance Specification 2 in 40 CFR 60 appendix B, sulfur dioxide and oxygen (or carbon dioxide) data shall be collected concurrently (or within a 30- to 60-minute period) by both the continuous emission monitors and the test methods specified in paragraphs (A) and (B).

(A) For sulfur dioxide, EPA Reference Method 6, 6A, or 6C or as an alternative ASME PTC-19-10-1981—Part 10, shall be used.

(B) For oxygen (or carbon dioxide), EPA Reference Method 3, 3A, or 3B, or as an alternative ASME PTC-19-10-1981—Part 10, as applicable shall be used.

(ii) The span value of the continuous emissions monitoring system at the inlet to the sulfur dioxide control device shall be 125 percent of the maximum estimated hourly potential sulfur dioxide emissions of the municipal waste combustor unit. The span value of the continuous emission

monitoring system at the outlet of the sulfur dioxide control device shall be 50 percent of the maximum estimated hourly potential sulfur dioxide emissions of the municipal waste combustor unit.
(13) Quarterly accuracy determinations and daily calibration drift tests shall be performed in accordance with procedure 1 in appendix F of 40 CFR 60.

(14) When sulfur dioxide emissions data are not obtained because of continuous emission monitoring system breakdowns, repairs, calibration checks, and zero and span adjustments, emissions data shall be obtained by using other monitoring systems as approved by the Administrator or EPA Reference Method 19 to provide, as necessary, valid emissions data for a minimum of 90 percent of the hours per calendar quarter and 95 percent of the hours per calendar year that the affected facility is operated and combusting municipal solid waste for 90 percent of the days per calendar quarter that the affected facility is operated and combusting municipal solid waste.

[40 CFR 60.38b and 40 CFR 60.58b(e)]

Hydrogen Chloride

A.43. The procedures and test methods specified in paragraphs (1) through (8) shall be used for determining compliance with the hydrogen chloride emission limit.

(1) The EPA Reference Method 26 or 26A, as applicable, shall be used to determine the hydrogen chloride emission concentration. The minimum sampling time for Method 26 shall be 1 hour.

(2) An oxygen (or carbon dioxide) measurement shall be obtained simultaneously with each Method 26 test run for hydrogen chloride required by paragraph (1).

(3) The percent reduction in potential hydrogen chloride emissions (% P_{HCl}) is computed using equation 2:

$$[\%P_{HCl}] = \left[\frac{E_i - E_o}{E_i} \right] \times 100 \quad (\text{equation 2})$$

where:

%P_{HCl}=percent reduction of the potential hydrogen chloride emissions achieved.

E_i=potential hydrogen chloride emission concentration measured at the control device inlet, corrected to 7 percent oxygen (dry basis).

E_o=controlled hydrogen chloride emission concentration measured at the control device outlet, corrected to 7 percent oxygen (dry basis).

(4) The owner or operator of an affected facility may request that compliance with the hydrogen chloride emission limit be determined using carbon dioxide measurements corrected to an equivalent of 7 percent oxygen. The relationship between oxygen and carbon dioxide levels for the affected facility shall be established as specified in 40 CFR 60.58b(b)(6).

(5) As specified under 40 CFR 60.8, all performance tests shall consist of three test runs. The average of the hydrogen chloride emission concentrations or percent reductions from the three test runs is used to determine compliance.

(6) The owner or operator of an affected facility shall conduct an initial performance test for hydrogen chloride as required under 40 CFR 60.8.

(7) Following the date that the initial performance test for hydrogen chloride is completed or is required to be completed under 40 CFR 60.8, the owner or operator of an affected facility shall conduct a

performance test for hydrogen chloride emissions on an annual basis (no more than 12 calendar months following the previous performance test).

(8) [reserved]

[40 CFR 60.38b, 40 CFR 60.58b(f)]

Dioxin/Furan

A.44. The procedures and test methods specified in paragraphs (1) through (9) shall be used to determine compliance with the limits for dioxin/furan emissions.

(1) The EPA Reference Method 1 shall be used for determining the location and number of sampling points.

(2) The EPA Reference Method 3, 3A, or 3B, or as an alternative ASME PTC-19-10-1981—Part 10, as applicable, shall be used for flue gas analysis.

(3) The EPA Reference Method 23 shall be used for determining the dioxin/furan emission concentration.

(i) The minimum sample time shall be 4 hours per test run.

(ii) An oxygen measurement shall be obtained simultaneously with each Method 23 test run for dioxins/furans.

(4) The owner or operator of an affected facility shall conduct an initial performance test for dioxin/furan emissions in accordance with paragraph (3), as required under 40 CFR 60.8.

(5) Following the date that the initial performance test for dioxins/furans is completed or is required to be completed under 40 CFR 60.8, the owner or operator of an affected facility shall conduct performance tests for dioxin/furan emissions in accordance with paragraph (3), according to one of the schedules specified in paragraphs (i) through (iii).

(i) For affected facilities, performance tests shall be conducted on a calendar year basis (no less than 9 calendar months and no more than 15 calendar months following the previous performance test; and must complete five performance tests in each 5-year calendar period).

(ii) For the purpose of evaluating system performance to establish new operating parameter levels, testing new technology or control technologies, diagnostic testing, or related activities for the purpose of improving facility performance or advancing the state-of-the-art for controlling facility emissions, the owner or operator of an affected facility that qualifies for the performance testing schedule specified in paragraph (g)(5)(iii) of this section, may test one unit for dioxin/furan and apply the dioxin/furan operating parameters to similarly designed and equipped units on site by meeting the requirements specified in paragraphs (g)(5)(ii)(A) through (g)(5)(ii)(D) of this section.

(A) Follow the testing schedule established in paragraph (g)(5)(iii) of this section. For example, each year a different affected facility at the municipal waste combustor plant shall be tested, and the affected facilities at the plant shall be tested in sequence (e.g. , unit 1, unit 2, unit 3, as applicable).

(B) Upon meeting the requirements in paragraph (g)(5)(iii) of this section for one affected facility, the owner or operator may elect to apply the average carbon mass feed rate and associated carbon injection system operating parameter levels for dioxin/furan as established in paragraph (m) of this section to similarly designed and equipped units on site.

(C) Upon testing each subsequent unit in accordance with the testing schedule established in paragraph (g)(5)(iii) of this section, the dioxin/furan and mercury emissions of the subsequent unit shall not exceed the dioxin/furan and mercury emissions measured in the most recent test of that unit prior to the revised operating parameter levels.

- (D) The owner or operator of an affected facility that selects to follow the performance testing schedule specified in paragraph (g)(5)(iii) of this section and apply the carbon injection system operating parameters to similarly designed and equipped units on site shall follow the procedures specified in 40 CFR 60.59b(g)(4) for reporting.
- (iii) Where all performance tests over a 2-year period indicate that dioxin/furan emissions are less than or equal to 15 nanograms per dry standard cubic meter (total mass) for all affected facilities located within a municipal waste combustor plant, the owner or operator of the municipal waste combustor plant may elect to conduct annual performance tests for one affected facility (i.e., unit) per year at the municipal waste combustor plant. At a minimum, a performance test for dioxin/furan emissions shall be conducted on a calendar year basis (no less than 9 calendar months and no more than 15 months following the previous performance test; and must complete five performance tests in each 5-year calendar period) for one affected facility at the municipal waste combustor plant. Each year a different affected facility at the municipal waste combustor plant shall be tested, and the affected facilities at the plant shall be tested in sequence (e.g., unit 1, unit 2, unit 3, as applicable). If each annual performance test continues to indicate a dioxin/furan emission level less than or equal to 15 nanograms per dry standard cubic meter (total mass), the owner or operator may continue conducting a performance test on only one affected facility per calendar year. If any annual performance test indicates either a dioxin/furan emission level greater than 15 nanograms per dry standard cubic meter (total mass), performance tests shall thereafter be conducted annually on all affected facilities at the plant until and unless all annual performance tests for all affected facilities at the plant over a 2-year period indicate a dioxin/furan emission level less than or equal to 15 nanograms per dry standard cubic meter (total mass). {Note: The 7 is changed to 15 ng/dscm per Rule 62-204.800(9)(b)7.b., F.A.C.}
- (6) The owner or operator of an affected facility that elects to follow the performance testing schedule specified in paragraph (5)(iii) shall follow the procedures specified in 40 CFR 60.59b(g)(4) for reporting the selection of this schedule.
- (7) The owner or operator of an affected facility where activated carbon is used shall follow the procedures specified in paragraph (m) of this section for measuring and calculating the carbon usage rate.
- (8) The owner or operator of an affected facility may request that compliance with the dioxin/furan emission limit be determined using carbon dioxide measurements corrected to an equivalent of 7 percent oxygen. The relationship between oxygen and carbon dioxide levels for the affected facility shall be established as specified in 40 CFR 60.58b(b)(6).
- (9) As specified under 40 CFR 60.8, all performance tests shall consist of three test runs. The average of the dioxin/furan emission concentrations from the three test runs is used to determine compliance. [40 CFR 60.38b and 40 CFR 60.58b(g) and Rule 62-204.800(9)(b)7.b., F.A.C.]

Nitrogen Oxides

- A.45.** The procedures and test methods specified in paragraphs (1) through (12) shall be used to determine compliance with the nitrogen oxides emission limit for affected facilities under Sec. 60.52b(d).
- (1) The EPA Reference Method 19, section 4.1, shall be used for determining the daily arithmetic average nitrogen oxides emission concentration.
- (2) The owner or operator of an affected facility may request that compliance with the nitrogen oxides emission limit be determined using carbon dioxide measurements corrected to an equivalent of 7 percent oxygen. The relationship between oxygen and carbon dioxide levels for the affected facility shall be established as specified in 40 CFR 60.58b(b)(6).
- (3) The owner or operator of an affected facility subject to the nitrogen oxides limit shall conduct an initial performance test for nitrogen oxides as required under 40 CFR 60.8. Compliance with the

nitrogen oxides emission limit shall be determined by using the continuous emission monitoring system specified in paragraph (4) for measuring nitrogen oxides and calculating a 24-hour daily arithmetic average emission concentration using EPA Reference Method 19, section 4.1.

(4) The owner or operator of an affected facility subject to the nitrogen oxides emission shall install, calibrate, maintain, and operate a continuous emission monitoring system for measuring nitrogen oxides discharged to the atmosphere, and record the output of the system.

(5) Following the date that the initial performance test for nitrogen oxides is completed or is required to be completed under 40 CFR 60.8, compliance with the emission limit for nitrogen oxides shall be determined based on the 24-hour daily arithmetic average of the hourly emission concentrations using continuous emission monitoring system outlet data.

(6) At a minimum, valid continuous emission monitoring system hourly averages shall be obtained as specified in paragraphs (i) and (ii) for 90 percent of the operating hours per calendar quarter and for 95 percent of the operating hours per calendar year that the affected facility is combusting municipal solid waste.

(i) At least 2 data points per hour shall be used to calculate each 1-hour arithmetic average.

(ii) Each nitrogen oxides 1-hour arithmetic average shall be corrected to 7 percent oxygen on an hourly basis using the 1-hour arithmetic average of the oxygen (or carbon dioxide) continuous emission monitoring system data.

(7) The 1-hour arithmetic averages required by paragraph (5) shall be expressed in parts per million by volume (dry basis) and used to calculate the 24-hour daily arithmetic average concentrations. The 1-hour arithmetic averages shall be calculated using the data points required under 40 CFR 60.13(e)(2).

(8) All valid continuous emission monitoring system data must be used in calculating emission averages even if the minimum continuous emission monitoring system data requirements of paragraph (6) are not met.

(9) The procedures under 40 CFR 60.13 shall be followed for installation, evaluation, and operation of the continuous emission monitoring system. The initial performance evaluation shall be completed no later than 180 days after the date of initial startup of the municipal waste combustor unit, as specified under 40 CFR 60.8.

(10) The owner or operator of an affected facility shall operate the continuous emission monitoring system according to Performance Specification 2 in appendix B of 40 CFR 60 and shall follow the procedures and methods specified in paragraphs(i) and (ii).

(i) During each relative accuracy test run of the continuous emission monitoring system required by Performance Specification 2 of appendix B of 40 CFR 60, nitrogen oxides and oxygen (or carbon dioxide) data shall be collected concurrently (or within a 30- to 60-minute period) by both the continuous emission monitors and the test methods specified in paragraphs(A) and (B).

(A) For nitrogen oxides, EPA Reference Method 7, 7A, 7C, 7D, or 7E shall be used.

(B) For oxygen (or carbon dioxide), EPA Reference Method 3, 3A, or 3B, or as an alternative ASME PTC-19-10-1981—Part 10, as applicable shall be used.

(ii) The span value of the continuous emission monitoring system shall be 125 percent of the maximum estimated hourly potential nitrogen oxide emissions of the municipal waste combustor unit.

(11) Quarterly accuracy determinations and daily calibration drift tests shall be performed in accordance with procedure 1 in appendix F of 40 CFR 60.

(12) When nitrogen oxides continuous emissions data are not obtained because of continuous emission monitoring system breakdowns, repairs, calibration checks, and zero and span adjustments, emissions data shall be obtained using other monitoring systems as approved by the Administrator or EPA Reference Method 19 to provide, as necessary, valid emissions data for a minimum of 90 percent of the

hours per calendar quarter and 95 percent of the hours per calendar year the unit is operated and combusting municipal solid waste.

[40 CFR 60.38b and 40 CFR 60.58b(h); and PSD-FL-127]

Fluoride

A.46. EPA Method 13A or 13B shall be used to ensure compliance.

[PSD-FL-127]

Beryllium

A.47. EPA Method 29 or 104 shall be used to ensure compliance.

[PSD-FL-127]

Carbon Monoxide

A.48.0. Continuous compliance is demonstrated through use of a certified Continuous Emissions Monitor. See Specific Condition **A.11**.

Volatile Organic Compounds

A.48.1. EPA Method 18, 25, or 25A shall be used to ensure compliance.

[PSD-FL-127]

Fugitive Ash

A.49. The procedures specified in paragraphs (1) through (4) shall be used for determining compliance with the fugitive ash emission limit under 40 CFR 60.55b.

(1) The EPA Reference Method 22 shall be used for determining compliance with the fugitive ash emission limit under 40 CFR 60.55b. The minimum observation time shall be a series of three 1-hour observations. The observation period shall include times when the facility is transferring ash from the municipal waste combustor unit to the area where ash is stored or loaded into containers or trucks.

(2) The average duration of visible emissions per hour shall be calculated from the three 1-hour observations. The average shall be used to determine compliance with 40 CFR 60.55b.

(3) The owner or operator of an affected facility shall conduct an initial performance test for fugitive ash emissions as required under 40 CFR 60.8.

(4) Following the date that the initial performance test for fugitive ash emissions is completed or is required to be completed under Sec. 60.8 for an affected facility, the owner or operator shall conduct a performance test for fugitive ash emissions on an annual basis (no more than 12 calendar months following the previous performance test).

[40 CFR 60.38b and 40 CFR 60.58b(k)]

A.50. Required Number of Test Runs. For mass emission limitations, a compliance test shall consist of three complete and separate determinations of the total air pollutant emission rate through the test section of the stack or duct and three complete and separate determinations of any applicable process variables corresponding to the three distinct time periods during which the stack emission rate was measured provided, however, that three complete and separate determinations shall not be required if the process variables are not subject to variation during a compliance test, or if three determinations are not

necessary in order to calculate the unit's emission rate. The three required test runs shall be completed within one consecutive five day period. In the event that a sample is lost or one of the three runs must be discontinued because of circumstances beyond the control of the owner or operator, and a valid third run cannot be obtained within the five day period allowed for the test, the Secretary or his or her designee may accept the results of the two complete runs as proof of compliance, provided that the arithmetic mean of the results of the two complete runs is at least 20 percent below the allowable emission limiting standards.

[Rule 62-297.310(1), F.A.C.]

A.51. Operating Rate During Testing. Testing of emissions shall be conducted with the emissions unit operation at permitted capacity, which is defined as 90 to 100 percent of the maximum operation rate allowed by the permit. If it is impracticable to test at permitted capacity, an emissions unit may be tested at less than the minimum permitted capacity; in this case, subsequent emissions unit operation is limited to 110 percent of the test load until a new test is conducted. Once the emissions unit is so limited, operation at higher capacities is allowed for no more than 15 consecutive days for the purpose of additional compliance testing to regain the authority to operate at the permitted capacity.

[Rules 62-297.310(2) & (2)(b), F.A.C.]

A.52. Calculation of Emission Rate. The indicated emission rate or concentration shall be the arithmetic average of the emission rate or concentration determined by each of the three separate test runs unless otherwise specified in a particular test method or applicable rule.

[Rule 62-297.310(3), F.A.C.]

A.53. Applicable Test Procedures.

(a) **Required Sampling Time.**

1. Unless otherwise specified in the applicable rule, the required sampling time for each test run shall be no less than one hour and no greater than four hours, and the sampling time at each sampling point shall be of equal intervals of at least two minutes.

2. **Opacity Compliance Tests.** When either EPA Method 9 or DEP Method 9 is specified as the applicable opacity test method, the required minimum period of observation for a compliance test shall be sixty (60) minutes for emissions units which emit or have the potential to emit 100 tons per year or more of particulate matter, and thirty (30) minutes for emissions units which have potential emissions less than 100 tons per year of particulate matter and are not subject to a multiple-valued opacity standard. The opacity test observation period shall include the period during which the highest opacity emissions can reasonably be expected to occur. Exceptions to these requirements are as follows:

a. For batch, cyclical processes, or other operations which are normally completed within less than the minimum observation period and do not recur within that time, the period of observation shall be equal to the duration of the batch cycle or operation completion time.

b. The observation period for special opacity tests that are conducted to provide data to establish a surrogate standard pursuant to Rule 62-297.310(5)(k), F.A.C., Waiver of Compliance Test Requirements, shall be established as necessary to properly establish the relationship between a proposed surrogate standard and an existing mass emission limiting standard.

c. The minimum observation period for opacity tests conducted by employees or agents of the Department to verify the day-to-day continuing compliance of a unit or activity with an applicable opacity standard shall be twelve minutes.

(b) **Minimum Sample Volume.** Unless otherwise specified in the applicable rule, the minimum sample volume per run shall be 25 dry standard cubic feet.

(c) Required Flow Rate Range. For EPA Method 5 particulate sampling, acid mist/sulfur dioxide, and fluoride sampling which uses Greenburg Smith type impingers, the sampling nozzle and sampling time shall be selected such that the average sampling rate will be between 0.5 and 1.0 actual cubic feet per minute, and the required minimum sampling volume will be obtained.

(d) Calibration of Sampling Equipment. Calibration of the sampling train equipment shall be conducted in accordance with the schedule shown in Table 297.310-1, attached as part of this permit.

(e) Allowed Modification to EPA Method 5. When EPA Method 5 is required, the following modification is allowed: the heated filter may be separated from the impingers by a flexible tube.

[Rule 62-297.310(4), F.A.C.]

A.54. Required Stack Sampling Facilities. When a mass emissions stack test is required, the permittee shall comply with the requirements contained in Appendix SS-1, Stack Sampling Facilities, attached to this permit.

[Rule 62-297.310(6), F.A.C.]

A.55. Frequency of Compliance Tests. The following provisions apply only to those emissions units that are subject to an emissions limiting standard for which compliance testing is required.

(a) General Compliance Testing.

1. [Reserved.]

2. [Reserved.]

3. The owner or operator of an emissions unit that is subject to any emission limiting standard shall conduct a compliance test that demonstrates compliance with the applicable emission limiting standard prior to obtaining a renewed operation permit. Emissions units that are required to conduct an annual compliance test may submit the most recent annual compliance test to satisfy the requirements of this provision. In renewing an air operation permit pursuant to Rule 62-210.300(2)(a)3.b., c., or d., F.A.C., the Department shall not require submission of emission compliance test results for any emissions unit that, during the year prior to renewal:

a. Did not operate; or

b. In the case of a fuel burning emissions unit, burned liquid and/or solid fuel for a total of no more than 400 hours.

4. During each federal fiscal year (October 1 - September 30), unless otherwise specified by rule, order, or permit, the owner or operator of each emissions unit shall have a formal compliance test conducted for:

a. Visible emissions, if there is an applicable standard;

b. Each of the following pollutants, if there is an applicable standard, and if the emissions unit emits or has the potential to emit: 5 tons per year or more of lead or lead compounds measured as elemental lead; or 100 tons per year or more of any other regulated air pollutant; and

c. Each NESHAP pollutant, if there is an applicable emission standard.

5. An annual compliance test for particulate matter emissions shall not be required for any fuel burning emissions unit that, in a federal fiscal year, does not burn liquid and/or solid fuel, other than during startup, for a total of more than 400 hours.

6. [Reserved.]

7. [Reserved.]

8. [Reserved.]

9. The owner or operator shall notify the Department, at least 15 days prior to the date on which each formal compliance test is to begin, of the date, time, and place of each such test, and the test contact person who will be responsible for coordinating and having such test conducted for the owner or operator.

10. [Reserved.]

(b) Special Compliance Tests. When the Department, after investigation, has good reason (such as complaints, increased visible emissions or questionable maintenance of control equipment) to believe that any applicable emission standard contained in a Department rule or in a permit issued pursuant to those rules is being violated, it may require the owner or operator of the emissions unit to conduct compliance tests which identify the nature and quantity of pollutant emissions from the emissions unit and to provide a report on the results of said tests to the Department.

(c) Waiver of Compliance Test Requirements. If the owner or operator of an emissions unit that is subject to a compliance test requirement demonstrates to the Department, pursuant to the procedure established in Rule 62-297.620, F.A.C., that the compliance of the emissions unit with an applicable weight emission limiting standard can be adequately determined by means other than the designated test procedure, such as specifying a surrogate standard of no visible emissions for particulate matter sources equipped with a bag house or specifying a fuel analysis for sulfur dioxide emissions, the Department shall waive the compliance test requirements for such emissions units and order that the alternate means of determining compliance be used, provided, however, the provisions of Rule 62-297.310(7)(b), F.A.C., shall apply.

[Rule 62-297.310(7), F.A.C.; and, SIP approved]

{Permitting note: Appropriate *testing frequency* is indicated as necessary, by pollutant, within each condition under the Emissions Limitations and Standards Section, above.}

Compliance With Standards and Maintenance Requirements

A.56. Compliance with standards in 40 CFR 60, other than opacity standards, shall be determined by performance tests established by 40 CFR 60.8, unless otherwise specified in the applicable standard.
[40 CFR 60.11(a)]

A.57. Compliance with opacity standards in 40 CFR 60 shall be determined by conducting observations in accordance with Reference Method 9 in Appendix A of 40 CFR 60, any alternative method that is approved by the Administrator, or as provided in 40 CFR 60.11(e)(5).
[40 CFR 60.11(b)]

A.58. The owner or operator of an affected facility subject to an opacity standard may submit, for compliance purposes, continuous opacity monitoring system (COMS) data results produced during any performance test required under 40 CFR 60.8 in lieu of EPA Method 9 observation data. If an owner or operator elects to submit COMS data for compliance with the opacity standard, he or she shall notify the Administrator of that decision, in writing, at least 30 days before any performance test required under 40 CFR 60.8 is conducted. Once the owner or operator of an affected facility has notified the Administrator to that effect, the COMS data results will be used to determine opacity compliance during subsequent tests required under 40 CFR 60.8 until the owner or operator notifies the Administrator, in writing, to the contrary. For the purpose of determining compliance with the opacity standard during a performance test required under 40 CFR 60.8 using COMS data, the minimum total time of COMS data collection shall be averages of all 6-minute continuous periods within the duration of the mass emission performance test. Results of the COMS opacity determinations shall be submitted along with the results of the performance test required under 60.8. The owner or operator of an affected facility using a COMS for compliance purposes is responsible for demonstrating that the COMS meets the requirements specified in 40 CFR 60.13(c), that the COMS has been properly maintained and operated, and that the resulting data have not been altered in any way. If COMS data results are submitted for compliance with the opacity

standard for a period of time during which EPA Method 9 data indicates noncompliance, the EPA Method 9 data will be used to determine opacity compliance.
[40 CFR 60.11(e)(5)]

Monitoring Requirements

A.59. For the purposes of 40 CFR 60.13, all continuous monitoring systems (CMS) required under applicable subparts shall be subject to the provisions of 40 CFR 60.13 upon promulgation of performance specifications for continuous monitoring systems under Appendix B of 40 CFR 60 and, if the continuous monitoring system is used to demonstrate compliance with emission limits on a continuous basis, Appendix F of 40 CFR 60, unless otherwise specified in an applicable subpart or by the Administrator. Appendix F is applicable December 4, 1987.
[40 CFR 60.13(a)]

A.60. If the owner or operator of an affected facility elects to submit continuous opacity monitoring system (COMS) data for compliance with the opacity standard as provided under 40 CFR 60.11(e)(5), he shall conduct a performance evaluation of the COMS as specified in Performance Specification 1, Appendix B, of 40 CFR 60 before the performance test required under 40 CFR 60.8 is conducted. Otherwise, the owner or operator of an affected facility shall conduct a performance evaluation of the COMS or continuous emission monitoring system (CEMS) during any performance test required under 40 CFR 60.8 or within 30 days thereafter in accordance with the applicable performance specification in Appendix B of 40 CFR 60. The owner or operator of an affected facility shall conduct COMS or CEMS performance evaluations at such other times as may be required by the Administrator under section 114 of the Act.

(1) The owner or operator of an affected facility using a COMS to determine opacity compliance during any performance test required under 60.8 and as described in 40 CFR 60.11(e)(5) shall furnish the Administrator two or, upon request, more copies of a written report of the results of the COMS performance evaluation described in 40 CFR 60.13(c) at least 10 days before the performance test required under 60.8 is conducted.

[40 CFR 60.13(c)(1)]

A.61. (1) Owners and operators of all continuous emission monitoring systems (CEMS) installed in accordance with the provisions of this part shall check the zero (or low-level value between 0 and 20 percent of span value) and span (50 to 100 percent of span value) calibration drifts at least once daily in accordance with a written procedure. The zero and span shall, as a minimum, be adjusted whenever the 24-hour zero drift or 24-hour span drift exceeds two times the limits of the applicable performance specifications in Appendix B. The system must allow the amount of excess zero and span drift measured at the 24-hour interval checks to be recorded and quantified, whenever specified. For continuous monitoring systems measuring opacity of emissions, the optical surfaces exposed to the effluent gases shall be cleaned prior to performing the zero and span drift adjustments except that for systems using automatic zero adjustments. The optical surfaces shall be cleaned when the cumulative automatic zero compensation exceeds 4 percent opacity.

(2) Unless otherwise approved by the Administrator, the following procedures shall be followed for continuous monitoring systems measuring opacity of emissions. Minimum procedures shall include a method for producing a simulated zero opacity condition and an upscale (span) opacity condition using a certified neutral density filter or other related technique to produce a known obscuration of the light beam. Such procedures shall provide a system check of the analyzer internal optical surfaces and all electronic circuitry including the lamp and photo detector assembly.

[40 CFR 60.13(d)(1) and (2)]

A.62. Except for system breakdowns, repairs, calibration checks, and zero and span adjustments required under 40 CFR 60.13(d), all continuous monitoring systems (CMS) shall be in continuous operation and shall meet minimum frequency of operation requirements as follows:

(1) All continuous monitoring systems referenced by 40 CFR 60.13(c) for measuring opacity of emissions shall complete a minimum of one cycle of sampling and analyzing for each successive 10-second period and one cycle of data recording for each successive 6-minute period.

(2) All continuous monitoring systems referenced by 40 CFR 60.13(c) for measuring emissions, except opacity, shall complete a minimum of one cycle of operation (sampling, analyzing, and data recording) for each successive 15-minute period.

[40 CFR 60.13(e)(1) and (2)]

A.63. All continuous monitoring systems (CMS) or monitoring devices shall be installed such that representative measurements of emissions or process parameters from the affected facility are obtained. Additional procedures for location of continuous monitoring systems contained in the applicable Performance Specifications of Appendix B of 40 CFR 60 shall be used.

[40 CFR 60.13(f)]

A.64. [Reserved.]

A.65. Owners or operators of all continuous monitoring systems for measurement of opacity shall reduce all data to 6-minute averages and for continuous monitoring systems other than opacity to 1-hour averages for time periods as defined in 40 CFR 60.2. Six-minute opacity averages shall be calculated from 36 or more data points equally spaced over each 6-minute period. For continuous monitoring systems other than opacity, 1-hour averages shall be computed from four or more data points equally spaced over each 1-hour period. Data recorded during periods of continuous monitoring system breakdowns, repairs, calibration checks, and zero and span adjustments shall not be included in the data averages computed under this paragraph. An arithmetic or integrated average of all data may be used. The data may be recorded in reduced or non reduced form (e.g., ppm pollutant and percent O₂ or ng/J of pollutant). All excess emissions shall be converted into units of the standard using the applicable conversion procedures specified in subparts. After conversion into units of the standard, the data may be

rounded to the same number of significant digits as used in the applicable subparts to specify the emission limit (e.g., rounded to the nearest 1 percent opacity).
[40 CFR 60.13(h)]

A.66. Determination of Process Variables.

(a) Required Equipment. The owner or operator of an emissions unit for which compliance tests are required shall install, operate, and maintain equipment or instruments necessary to determine process variables, such as process weight input or heat input, when such data are needed in conjunction with emissions data to determine the compliance of the emissions unit with applicable emission limiting standards.

(b) Accuracy of Equipment. Equipment or instruments used to directly or indirectly determine process variables, including devices such as flow meters, shall be calibrated and adjusted to indicate the true value of the parameter being measured with sufficient accuracy to allow the applicable process variable to be determined within 10% of its true value.

[Rule 62-297.310(5), F.A.C.]

CEMS for Oxygen or Carbon Dioxide

A.67. The owner or operator of an affected facility shall install, calibrate, maintain, and operate a continuous emission monitoring system and record the output of the system for measuring the oxygen or carbon dioxide content of the flue gas at each location where carbon monoxide, sulfur dioxide, or nitrogen oxides emissions are monitored and record the output of the system and shall comply with the test procedures and test methods specified in paragraphs (1) through (8).

(1) The span value of the oxygen (or carbon dioxide) monitor shall be 25 percent oxygen (or 20 percent carbon dioxide).

(2) The monitor shall be installed, evaluated, and operated in accordance with 40 CFR 60.13.

(3) The initial performance evaluation shall be completed no later than 180 days after the date of initial startup of the affected facility, as specified under 40 CFR 60.8.

(4) The monitor shall conform to Performance Specification 3 in appendix B of 40 CFR 60 except for section 2.3 (relative accuracy requirement).

(5) The quality assurance procedures of appendix F of 40 CFR 60 except for section 5.1.1 (relative accuracy test audit) shall apply to the monitor.

(6) If carbon dioxide is selected for use in diluent corrections, the relationship between oxygen and carbon dioxide levels shall be established during the initial performance test according to the procedures and methods specified in paragraphs (b)(6)(i) through (b)(6)(iv) of this section. This relationship may be reestablished during performance compliance tests.

(i) The fuel factor equation in Method 3B shall be used to determine the relationship between oxygen and carbon dioxide at a sampling location. Method 3, 3A, or 3B, or as an alternative ASME PTC-19-10-1981—Part 10, as applicable, shall be used to determine the oxygen concentration at the same location as the carbon dioxide monitor.

(ii) Samples shall be taken for at least 30 minutes in each hour.

(iii) Each sample shall represent a 1-hour average.

(iv) A minimum of three runs shall be performed.

(7) The relationship between carbon dioxide and oxygen concentrations that is established in accordance with paragraph (b)(6) of this section shall be submitted to EPA as part of the initial performance test report and, if applicable, as part of the annual test report if the relationship is reestablished during the annual performance test.

(8) During a loss of boiler water level control or loss of combustion air control malfunction period as specified in paragraph (a)(1)(iii) of this section, a diluent cap of 14 percent for oxygen or 5 percent for carbon dioxide may be used in the emissions calculations for sulfur dioxide and nitrogen oxides.
[40 CFR 60.38b and 40 CFR 60.58b(b)]

Recordkeeping and Reporting Requirements

A.68. The owner or operator subject to the provisions of 40 CFR 60 shall furnish the Administrator written notification as follows:

(4) A notification of any physical or operational change to an existing facility which may increase the emission rate of any air pollutant to which a standard applies, unless that change is specifically exempted under an applicable subpart or in 40 CFR 60.14(e). This notice shall be postmarked 60 days or as soon as practicable before the change is commenced and shall include information describing the precise nature of the change, present and proposed emission control systems, productive capacity of the facility before and after the change, and the expected completion date of the change. The Administrator may request additional relevant information subsequent to this notice.
[40 CFR 60.7(a)(4)]

A.69. The owner or operator subject to the provisions of 40 CFR 60 shall maintain records of the occurrence and duration of any startup, shutdown, or malfunction in the operation of an affected facility; any malfunction of the air pollution control equipment; or, any periods during which a continuous monitoring system or monitoring device is inoperative.
[40 CFR 60.7(b)]

A.70. Each owner or operator required to install a continuous monitoring system (CMS) or monitoring device shall submit an excess emissions and monitoring systems performance report (excess emissions are defined in applicable subparts) and/or a summary report form [see 40 CFR 60.7(d)] to the Administrator semiannually, except when: more frequent reporting is specifically required by an applicable subpart; or, the Administrator, on a case-by-case basis, determines that more frequent reporting is necessary to accurately assess the compliance status of the source. All reports shall be postmarked by the 30th day following the end of each six-month period. Written reports of excess emissions shall include the following information:

- (1) The magnitude of excess emissions computed in accordance with 40 CFR 60.13(h), any conversion factor(s) used, and the date and time of commencement and completion of each time period of excess emissions. The process operating time during the reporting period.
- (2) Specific identification of each period of excess emissions that occurs during startups, shutdowns, and malfunctions of the affected facility. The nature and cause of any malfunction (if known), the corrective action taken or preventative measures adopted.
- (3) The date and time identifying each period during which the continuous monitoring system was inoperative except for zero and span checks and the nature of the system repairs or adjustments.
- (4) When no excess emissions have occurred or the continuous monitoring system(s) have not been inoperative, repaired, or adjusted, such information shall be stated in the report.

[40 CFR 60.7(c)(1), (2), (3), and (4)]

A.71. The summary report form shall contain the information and be in the format shown in Figure 1 (attached) unless otherwise specified by the Administrator. One summary report form shall be submitted for each pollutant monitored at each affected facility.

(1) If the total duration of excess emissions for the reporting period is less than 1 percent of the total operating time for the reporting period and CMS downtime for the reporting period is less than 5 percent of the total operating time for the reporting period, only the summary report form shall be submitted and the excess emission report described in 40 CFR 60.7(c) need not be submitted unless requested by the Administrator.

(2) If the total duration of excess emissions for the reporting period is 1 percent or greater of the total operating time for the reporting period or the total CMS downtime for the reporting period is 5 percent or greater of the total operating time for the reporting period, the summary report form and the excess emission report described in 40 CFR 60.7(c) shall both be submitted.

[40 CFR 60.7(d)(1) and (2)]

{See attached Figure 1: Summary Report-Gaseous and Opacity Excess Emission and Monitoring System Performance}

A.72. (1) Notwithstanding the frequency of reporting requirements specified in 40 CFR 60.7(c), an owner or operator who is required by an applicable subpart to submit excess emissions and monitoring systems performance reports (and summary reports) on a quarterly (or more frequent) basis may reduce the frequency of reporting for that standard to semiannual if the following conditions are met:

(i) For 1 full year (e.g., 4 quarterly or 12 monthly reporting periods) the affected facility's excess emissions and monitoring systems reports submitted to comply with a standard under this part continually demonstrate that the facility is in compliance with the applicable standard;

(ii) The owner or operator continues to comply with all recordkeeping and monitoring requirements specified in 40 CFR 60, Subpart A, and the applicable standard; and

(iii) The Administrator does not object to a reduced frequency of reporting for the affected facility, as provided in 40 CFR 60.7(e)(2).

(2) The frequency of reporting of excess emissions and monitoring systems performance (and summary) reports may be reduced only after the owner or operator notifies the Administrator in writing of his or her intention to make such a change and the Administrator does not object to the intended change. In deciding whether to approve a reduced frequency of reporting, the Administrator may review information concerning the source's entire previous performance history during the required recordkeeping period prior to the intended change, including performance test results, monitoring data, and evaluations of an owner or operator's conformance with operation and maintenance requirements. Such information may be used by the Administrator to make a judgment about the source's potential for noncompliance in the future. If the Administrator disapproves the owner or operator's request to reduce the frequency of reporting, the Administrator will notify the owner or operator in writing within 45 days after receiving notice of the owner or operator's intention. The notification from the Administrator to the owner or operator will specify the grounds on which the disapproval is based. In the absence of a notice of disapproval within 45 days, approval is automatically granted.

(3) As soon as monitoring data indicate that the affected facility is not in compliance with any emission limitation or operating parameter specified in the applicable standard, the frequency of reporting shall revert to the frequency specified in the applicable standard, and the owner or operator shall submit an excess emissions and monitoring systems performance report (and summary report, if required) at the next appropriate reporting period following the noncomplying event. After demonstrating compliance with the applicable standard for another full year, the owner or operator may again request approval from the Administrator to reduce the frequency of reporting for that standard as provided for in 40 CFR 60.7(e)(1) and (e)(2).

[40 CFR 60.7(e)(1)]

A.73. Any owner or operator subject to the provisions of 40 CFR 60 shall maintain a file of all measurements, including continuous monitoring system, monitoring device, and performance testing measurements; all continuous monitoring system performance evaluations; all continuous monitoring system or monitoring device calibration checks; adjustments and maintenance performed on these systems or devices; and, all other information required by 40 CFR 60 recorded in a permanent form suitable for inspection. The file shall be retained for at least **5 (five)** years following the date of such measurements, maintenance, reports, and records.

[40 CFR 60.7(f); Rule 62-213.440(1)(b)2.b., F.A.C.]

A.74. Notification of Construction or Reconstruction. The owner or operator of an affected facility with a capacity to combust greater than 250 tons per day shall submit a notification of construction, which includes the information specified in paragraphs (1) through (4).

(1) Intent to construct.

(2) Planned initial startup date.

(3) The types of fuels that the owner or operator plans to combust in the affected facility.

(4) The municipal waste combustor unit capacity and supporting capacity calculations prepared in accordance with 40 CFR 60.58b(j).

[40 CFR 60.39b and 40 CFR 60.59b(b)]

A.75. The owner or operator of an affected facility subject to the standards under 40 CFR 60.53b, 60.54b, and 60.55b shall maintain records of the information specified in paragraphs (1) through (15), as applicable, for each affected facility for a period of at least 5 years.

(1) The calendar date of each record.

(2) The emission concentrations and parameters measured using continuous monitoring systems as specified under paragraphs (i) and (ii).

(i) The measurements specified in paragraphs (A) through (D) shall be recorded and be available for submittal to the Administrator or review onsite by an EPA, State, or approved Local Air Program inspector.

(A) All 6-minute average opacity levels as specified under 40 CFR 60.58b(c).

(B) All 1-hour average sulfur dioxide emission concentrations as specified under 40 CFR 60.58b(e).

(C) All 1-hour average nitrogen oxides emission concentrations as specified under 40 CFR 60.58b(h).

(D) All 1-hour average carbon monoxide emission concentrations, municipal waste combustor unit load measurements, and particulate matter control device inlet temperatures as specified under 40 CFR 60.58b(i).

(ii) The average concentrations and percent reductions, as applicable, specified in paragraphs (2)(ii)(A) through (2)(ii)(D) shall be computed and recorded, and shall be available for submittal to the Administrator or review on-site by an EPA, State, or approved Local Air Program inspector.

(A) All 24-hour daily geometric average sulfur dioxide emission concentrations and all 24-hour daily geometric average percent reductions in sulfur dioxide emissions as specified under 40 CFR 60.58b(e).

(B) All 24-hour daily arithmetic average nitrogen oxides emission concentrations as specified under 40 CFR 60.58b(h).

(C) All 4-hour block or 24-hour daily arithmetic average carbon monoxide emission concentrations, as applicable, as specified under 40 CFR 60.58b(i).

(D) All 4-hour block arithmetic average municipal waste combustor unit load levels and particulate matter control device inlet temperatures as specified under 40 CFR 60.58b(i).

- (3) Identification of the calendar dates when any of the average emission concentrations, percent reductions, or operating parameters recorded under paragraphs (2)(ii)(A) through (2)(ii)(D), or the opacity levels recorded under paragraph (2)(i)(A) are above the applicable limits, with reasons for such exceedances and a description of corrective actions taken.
- (4) For affected facilities that apply activated carbon for mercury or dioxin/furan control, the records specified in paragraphs (i) through (v).
- (i) The average carbon mass feed rate (in kilograms per hour or pounds per hour) estimated as required under 40 CFR 60.58b(m)(1)(i) during the initial mercury performance test and all subsequent annual performance tests, with supporting calculations.
 - (ii) The average carbon mass feed rate (in kilograms per hour or pounds per hour) estimated as required under 40 CFR 60.58b(m)(1)(ii) during the initial dioxin/furan performance test and all subsequent annual performance tests, with supporting calculations.
 - (iii) The average carbon mass feed rate (in kilograms per hour or pounds per hour) estimated for each hour of operation as required under 40 CFR 60.58b(m)(3)(ii), with supporting calculations.
 - (iv) The total carbon usage for each calendar quarter estimated as specified by 40 CFR 60.58b(m)(3), with supporting calculations.
 - (v) Carbon injection system operating parameter data for the parameter(s) that are the primary indicator(s) of carbon feed rate (e.g., screw feeder speed).
- (5) [Reserved]
- (6) Identification of the calendar dates and times (hours) for which valid hourly data specified in paragraphs (i) through (v) have not been obtained including reasons for not obtaining sufficient data and a description of corrective actions taken.
- (i) Sulfur dioxide emissions data;
 - (ii) Nitrogen oxides emissions data;
 - (iii) Carbon monoxide emissions data;
 - (iv) Municipal waste combustor unit load data; and
 - (v) Particulate matter control device temperature data.
- (7) Identification of each occurrence that sulfur dioxide emissions data, nitrogen oxides emissions data (large municipal waste combustors only), or operational data (i.e., carbon monoxide emissions, unit load, and particulate matter control device temperature) have been excluded from the calculation of average emission concentrations or parameters, and the reasons for excluding the data.
- (8) The results of daily drift tests and quarterly accuracy determinations for sulfur dioxide, nitrogen oxides, and carbon monoxide continuous emission monitoring systems, as required under appendix F of this part, procedure 1.
- (9) The test reports documenting the results of the initial performance test and all annual performance tests listed in paragraphs (i) and (ii) shall be recorded along with supporting calculations.
- (i) The results of the initial performance test and all annual performance tests conducted to determine compliance with the particulate matter, opacity, cadmium, lead, mercury, dioxins/furans, hydrogen chloride, and fugitive ash emission limits.
 - (ii) For the initial dioxin/furan performance test and all subsequent dioxin/furan performance tests recorded under paragraph (9)(i), the maximum demonstrated municipal waste combustor unit load and maximum demonstrated particulate matter control device temperature (for each particulate matter control device).
- (10) [Reserved]
- (11) [Reserved]
- (12) The records specified in paragraphs (i) through (iii).
- (i) Records showing the names of the municipal waste combustor chief facility operator, shift supervisors, and control room operators who have been provisionally certified by the American

Society of Mechanical Engineers or an equivalent State-approved certification program as required by 40 CFR 60.54b(a) including the dates of initial and renewal certifications and documentation of current certification.

(ii) Records showing the names of the municipal waste combustor chief facility operator, shift supervisors, and control room operators who have been fully certified by the American Society of Mechanical Engineers or an equivalent State-approved certification program as required by 40 CFR 60.54b(b) including the dates of initial and renewal certifications and documentation of current certification.

(iii) Records showing the names of the municipal waste combustor chief facility operator, shift supervisors, and control room operators who have completed the EPA municipal waste combustor operator training course or a State-approved equivalent course as required by 40 CFR 60.54b(d) including documentation of training completion.

(iv) Records of when a certified operator is temporarily off site. Include two main items:

(A) If the certified chief facility operator and certified shift supervisor are off site for more than 12 hours, but for 2 weeks or less, and no other certified operator is on site, record the dates that the certified chief facility operator and certified shift supervisor were off site.

(B) When all certified chief facility operators and certified shift supervisors are off site for more than 2 weeks and no other certified operator is on site, keep records of four items:

(1) Time of day that all certified persons are off site.

(2) The conditions that cause those people to be off site.

(3) The corrective actions taken by the owner or operator of the affected facility to ensure a certified chief facility operator or certified shift supervisor is on site as soon as practicable.

(4) Copies of the written reports submitted every 4 weeks that summarize the actions taken by the owner or operator of the affected facility to ensure that a certified chief facility operator or certified shift supervisor will be on site as soon as practicable.

(13) Records showing the names of persons who have completed a review of the operating manual as required by 40 CFR 60.54b(f) including the date of the initial review and subsequent annual reviews.

(14) For affected facilities that apply activated carbon, identification of the calendar dates when the average carbon mass feed rates recorded under paragraph (d)(4)(iii) of this section were less than either of the hourly carbon feed rates estimated during performance tests for mercury emissions and recorded under paragraphs (d)(4)(i) and (d)(4)(ii) of this section, respectively, with reasons for such feed rates and a description of corrective actions taken. For affected facilities that apply activated carbon, identification of the calendar dates when the average carbon mass feed rates recorded under paragraph (d)(4)(iii) of this section were less than either of the hourly carbon feed rates estimated during performance tests for dioxin/furan emissions and recorded under paragraphs (d)(4)(i) and (d)(4)(ii) of this section, respectively, with reasons for such feed rates and a description of corrective actions taken.

(15) For affected facilities that apply activated carbon for mercury or dioxin/furan control, identification of the calendar dates when the carbon injection system operating parameter(s) that are the primary indicator(s) of carbon mass feed rate (e.g., screw feeder speed) recorded under paragraph (4)(v) are below the level(s) estimated during the performance tests as specified in 40 CFR 60.58b(m)(1)(i) and 40 CFR 60.58b(m)(1)(ii), with reasons for such occurrences and a description of corrective actions taken.

[40 CFR 60.39b and 40 CFR 60.59b(d)]

A.76. The owner or operator of an affected facility shall submit the information specified in paragraphs (1) through (6) in the initial performance test report.

(1) The initial performance test data as recorded under 40 CFR 60.59b(d)(2)(ii)(A) through (d)(2)(ii)(D) for the initial performance test for sulfur dioxide, nitrogen oxides, carbon monoxide, municipal waste combustor unit load level, and particulate matter control device inlet temperature.

- (2) The test report documenting the initial performance test recorded under 40 CFR 60.59b(d)(9) for particulate matter, opacity, cadmium, lead, mercury, dioxins/furans, hydrogen chloride, and fugitive ash emissions.
 - (3) The performance evaluation of the continuous emission monitoring system using the applicable performance specifications in appendix B of this part.
 - (4) The maximum demonstrated municipal waste combustor unit load and maximum demonstrated particulate matter control device inlet temperature(s) established during the initial dioxin/furan performance test as recorded under 40 CFR 60.59b(d)(9).
 - (5) For affected facilities that apply activated carbon injection for mercury control, the owner or operator shall submit the average carbon mass feed rate recorded under 40 CFR 60.59b(d)(4)(i).
 - (6) For those affected facilities that apply activated carbon injection for dioxin/furan control, the owner or operator shall submit the average carbon mass feed rate recorded under 40 CFR 60.59b(d)(4)(ii).
- [40 CFR 60.39b and 40 CFR 60.59b(f)]

A.77. Following the first year of municipal combustor operation, the owner or operator of an affected facility shall submit an annual report including the information specified in paragraphs (1) through (4), as applicable, no later than February 1 of each year following the calendar year in which the data were collected (once the unit is subject to permitting requirements under Title V of the Act, the owner or operator of an affected facility must submit these reports semiannually).

(1) A summary of data collected for all pollutants and parameters regulated under this subpart, which includes the information specified in paragraphs (i) through (v).

(i) A list of the particulate matter, opacity, cadmium, lead, mercury, dioxins/furans, hydrogen chloride, and fugitive ash emission levels achieved during the performance tests recorded under 40 CFR 60.59b (d)(9).

(ii) A list of the highest emission level recorded for sulfur dioxide, nitrogen oxides, carbon monoxide, municipal waste combustor unit load level, and particulate matter control device inlet temperature based on the data recorded under 40 CFR 60.59b(d)(2)(ii)(A) through (d)(2)(ii)(D).

(iii) List the highest opacity level measured, based on the data recorded under 40 CFR 60.59b(d)(2)(i)(A).

(iv) Periods when valid data were not obtained as described in paragraphs (g)(1)(iv)(A) of this section.

(A) The total number of hours per calendar quarter and hours per calendar year that valid data for sulfur dioxide, nitrogen oxides, carbon monoxide, municipal waste combustor unit load, or particulate matter control device temperature data were not obtained based on the data recorded under paragraph (d)(6) of this section.

(v) Periods when valid data were excluded from the calculation of average emission concentrations or parameters as described in paragraphs (g)(1)(v)(A) of this section.

(A) The total number of hours that data for sulfur dioxide, nitrogen oxides, carbon monoxide, municipal waste combustor unit load, and particulate matter control device temperature were excluded from the calculation of average emission concentrations or parameters based on the data recorded under paragraph (d)(7) of this section.

(2) The summary of data reported under paragraph (1) shall also provide the types of data specified in paragraphs (1)(i) through (1)(vi) for the calendar year preceding the year being reported, in order to provide the Administrator with a summary of the performance of the affected facility over a 2-year period.

(3) The summary of data including the information specified in paragraphs (1) and (2) shall highlight any emission or parameter levels that did not achieve the emission or parameter limits specified under this subpart.

(4) A notification of intent to begin the reduced dioxin/furan performance testing schedule specified in 40 CFR 60.58b(g)(5)(iii) during the following calendar year and notification of intent to apply the average carbon mass feed rate and associated carbon injection system operating parameter levels as established in §60.58b(m) to similarly designed and equipped units on site.

(5) Documentation of periods when all certified chief facility operators and certified shift supervisors are off site for more than 12 hours.

[40 CFR 60.39b and 40 CFR 60.59b(g)]

A.78. The owner or operator of an affected facility shall submit a semiannual report that includes the information specified in paragraphs (1) through (5) for any recorded pollutant or parameter that does not comply with the pollutant or parameter limit specified under this subpart, according to the schedule specified under paragraph (6).

(1) The semiannual report shall include information recorded under 40 CFR 60.59b(d)(3) for sulfur dioxide, nitrogen oxides, carbon monoxide, municipal waste combustor unit load level, particulate matter control device inlet temperature, and opacity.

(2) For each date recorded as required by 40 CFR 60.59b(d)(3) and reported as required by paragraph (1), the semiannual report shall include the sulfur dioxide, nitrogen oxides, carbon monoxide, municipal waste combustor unit load level, particulate matter control device inlet temperature, or opacity data, as applicable, recorded under 40 CFR 60.59b(d)(2)(i)(A) through (d)(2)(i)(D) and (d)(2)(i)(A), as applicable.

(3) If the test reports recorded under 40 CFR 60.59b(d)(9) document any particulate matter, opacity, cadmium, lead, mercury, dioxins/furans, hydrogen chloride, and fugitive ash emission levels that were above the applicable pollutant limits, the semiannual report shall include a copy of the test report documenting the emission levels and the corrective actions taken.

(4) The semiannual report shall include the information recorded under 40 CFR 60.59b(d)(15) for the carbon injection system operating parameter(s) that are the primary indicator(s) of carbon mass feed rate.

(5) For each operating date reported as required by paragraph (4), the semiannual report shall include the carbon feed rate data recorded under 40 CFR 60.59b(d)(4)(iii).

(6) Semiannual reports required by this condition shall be submitted according to the schedule specified in paragraphs (i) and (ii).

(i) If the data reported in accordance with paragraphs (1) through (5) were collected during the first calendar half, then the report shall be submitted by August 1 following the first calendar half.

(ii) If the data reported in accordance with paragraphs (1) through (5) were collected during the second calendar half, then the report shall be submitted by February 1 following the second calendar half.

[40 CFR 60.39b and 40 CFR 60.59b(h)]

A.79. All reports specified under 40 CFR 60.59b(a), (b), (c), (f), (g), (h), and (i) shall be submitted as a paper copy, postmarked on or before the submittal dates specified under these paragraphs, and maintained onsite as a paper copy for a period of 5 years.

[40 CFR 60.39b and 40 CFR 60.59b(j)]

A.80. All records specified under 40 CFR 60.59b(d) and (e) shall be maintained onsite in either paper copy or computer-readable format, unless an alternative format is approved by the Administrator.

[40 CFR 60.39b and 40 CFR 60.59b(k)]

A.81. If the owner or operator of an affected facility would prefer a different annual or semiannual date for submitting the periodic reports required by 40 CFR 60.59b(g), (h) and (i), then the dates may be

changed by mutual agreement between the owner or operator and the Administrator according to the procedures specified in 40 CFR 60.19(c) of subpart A of this part.
[40 CFR 60.39b and 40 CFR 60.59b(l)]

A.82. In the case of excess emissions resulting from malfunctions, each owner or operator shall notify the Department in accordance with Rule 62-4.130, F.A.C. A full written report on the malfunctions shall be submitted in a quarterly report, if requested by the Department.
[Rule 62-210.700(6), F.A.C.]

A.83. [Reserved.]

A.84. Test Reports.

- (a) The owner or operator of an emissions unit for which a compliance test is required shall file a report with the Department on the results of each such test.
- (b) The required test report shall be filed with the Department as soon as practical but no later than 45 days after the last sampling run of each test is completed.
- (c) The test report shall provide sufficient detail on the emissions unit tested and the test procedures used to allow the Department to determine if the test was properly conducted and the test results properly computed. As a minimum, the test report, other than for an EPA or DEP Method 9 test, shall provide the following information:
 - 1. The type, location, and designation of the emissions unit tested.
 - 2. The facility at which the emissions unit is located.
 - 3. The owner or operator of the emissions unit.
 - 4. The normal type and amount of fuels used and materials processed, and the types and amounts of fuels used and material processed during each test run.
 - 5. The means, raw data and computations used to determine the amount of fuels used and materials processed, if necessary to determine compliance with an applicable emission limiting standard.
 - 6. The type of air pollution control devices installed on the emissions unit, their general condition, their normal operating parameters (pressure drops, total operating current and GPM scrubber water), and their operating parameters during each test run.
 - 7. A sketch of the duct within 8 stack diameters upstream and 2 stack diameters downstream of the sampling ports, including the distance to any upstream and downstream bends or other flow disturbances.
 - 8. The date, starting time and duration of each sampling run.
 - 9. The test procedures used, including any alternative procedures authorized pursuant to Rule 62-297.620, F.A.C. Where optional procedures are authorized in this chapter, indicate which option was used.
 - 10. The number of points sampled and configuration and location of the sampling plane.
 - 11. For each sampling point for each run, the dry gas meter reading, velocity head, pressure drop across the stack, temperatures, average meter temperatures and sample time per point.
 - 12. The type, manufacturer and configuration of the sampling equipment used.
 - 13. Data related to the required calibration of the test equipment.
 - 14. Data on the identification, processing and weights of all filters used.
 - 15. Data on the types and amounts of any chemical solutions used.
 - 16. Data on the amount of pollutant collected from each sampling probe, the filters, and the impingers, are reported separately for the compliance test.

17. The names of individuals who furnished the process variable data, conducted the test, analyzed the samples and prepared the report.

18. All measured and calculated data required to be determined by each applicable test procedure for each run.

19. The detailed calculations for one run that relate the collected data to the calculated emission rate.

20. The applicable emission standard, and the resulting maximum allowable emission rate for the emissions unit, plus the test result in the same form and unit of measure.

21. A certification that, to the knowledge of the owner or his authorized agent, all data submitted are true and correct. When a compliance test is conducted for the Department or its agent, the person who conducts the test shall provide the certification with respect to the test procedures used. The owner or his authorized agent shall certify that all data required and provided to the person conducting the test are true and correct to his knowledge.

[Rule 62-297.310(8), F.A.C.]

A.85. Segregated Solid Waste Record Keeping. The following records shall be made and kept to demonstrate compliance with the segregated non-MSW percentage limitations of Specific Conditions A.7.1.8. and A.7.1.9.

(a) Each segregated load of non-MSW materials, that is subject to the percentage weight limitations of Specific Conditions A.7.1.8. and A.7.1.9., which is received for processing shall be documented as to waste description and weight. The weight of all waste materials received for processing shall be measured using the facility truck scale and recorded.

(b) Each day the total weight of segregated tires received shall be computed, and the daily total shall be added to the sum of the daily totals from the previous days of the current calendar month. At the end of each calendar month, the resultant calendar month's total weight of tires shall be divided by the total weight of all waste materials received in the same calendar month period, and the resultant number shall be multiplied by 100 to express the ratio in percentage terms. The percentage computed shall be compared to the 3% limitation.

(c) Each day the total weight of segregated non-MSW materials received that are subject to the 5% restriction shall be computed, and the daily total shall be added to the sum of the daily totals from the previous days of the current calendar month. At the end of each calendar month, the resultant calendar month's total weight of segregated non-MSW materials shall be divided by the total weight of all waste materials received in the same calendar month period, and the resultant number shall be multiplied by 100 to express the ratio in percentage terms. The percentage computed shall be compared to the 5% limitation.

[Rule 62-213.440, F.A.C.]

Miscellaneous Requirements

Activated Carbon Injection

A.86. The owner or operator of an affected facility where activated carbon injection is used to comply with the mercury emission limit, or the dioxin/furan emission limits, or the dioxin/furan emission level specified in 40 CFR 60.58b(g)(5)(iii) shall follow the procedures specified in paragraphs (1) through (3).

(1) During the performance tests for dioxins/furans and mercury, as applicable, the owner or operator shall estimate an average carbon mass feed rate based on carbon injection system operating parameters such as the screw feeder speed, hopper volume, hopper refill frequency, or other parameters appropriate to the feed system being employed, as specified in paragraphs (i) and(ii).

- (i) An average carbon mass feed rate in kilograms per hour or pounds per hour shall be estimated during the initial performance test for mercury emissions and each subsequent performance test for mercury emissions.
- (ii) An average carbon mass feed rate in kilograms per hour or pounds per hour shall be estimated during the initial performance test for dioxin/furan emissions and each subsequent performance test for dioxin/furan emissions. If a subsequent dioxin/furan performance test is being performed on only one affected facility at the MWC plant, as provided in paragraph (g)(5)(iii) of this section, the owner or operator may elect to apply the same estimated average carbon mass feed rate from the tested facility for all the similarly designed and operated affected facilities at the MWC plant.
- (2) During operation of the affected facility, the carbon injection system operating parameter(s) that are the primary indicator(s) of the carbon mass feed rate (e.g. , screw feeder setting) shall be averaged over a block 8-hour period, and the 8-hour block average must equal or exceed the level(s) documented during the performance tests specified under paragraphs (m)(1)(i) and (m)(1)(ii) of this section, except as specified in paragraphs (m)(2)(i) and (m)(2)(ii) of this section.
 - (i) During the annual dioxin/furan or mercury performance test and the 2 weeks preceding the annual dioxin/furan or mercury performance test, no limit is applicable for average mass carbon feed rate if the provisions of paragraph (m)(2)(ii) of this section are met.
 - (ii) The limit for average mass carbon feed rate may be waived in accordance with permission granted by the Administrator for the purpose of evaluating system performance, testing new technology or control technologies, diagnostic testing, or related activities for the purpose of improving facility performance or advancing the state-of-the-art for controlling facility emissions.
- (3) The owner or operator of an affected facility shall estimate the total carbon usage of the plant (kilograms or pounds) for each calendar quarter by two independent methods, according to the procedures in paragraphs (i) and (ii).
 - (i) The weight of carbon delivered to the plant.
 - (ii) Estimate the average carbon mass feed rate in kilograms per hour or pounds per hour for each hour of operation for each affected facility based on the parameters specified under paragraph (1), and sum the results for all affected facilities at the plant for the total number of hours of operation during the calendar quarter.
- (4) Pneumatic injection pressure or other carbon injection system operational indicator shall be used to provide additional verification of proper carbon injection system operation. The operational indicator shall provide an instantaneous visual and/or audible alarm to alert the operator of a potential interruption in the carbon feed that would not normally be indicated by direct monitoring of carbon mass feed rate (e.g. , continuous weight loss feeder) or monitoring of the carbon system operating parameter(s) that are the indicator(s) of carbon mass feed rate (e.g. , screw feeder speed). The carbon injection system operational indicator used to provide additional verification of carbon injection system operation, including basis for selecting the indicator and operator response to the indicator alarm, shall be included in section (e)(6) of the site-specific operating manual required under §60.54b(e) of this subpart. [40 CFR 60.38b and 40 CFR 60.58b(m)]

A.87. General Applicability and Definitions. The Emission Guidelines for Existing Sources adopted by reference in this rule shall be controlling over other standards in the air pollution rules of the Department except that any emissions limiting standard contained in or determined pursuant to the air pollution rules of the Department which is more stringent than one contained in an Emission Guideline, or which regulates emissions of pollutants or emissions units not regulated by an applicable Emission Guideline, shall apply.

[Rule 62-204.800(8)(a)1., F.A.C.]

Subsection B. This section addresses the following emissions unit.

E.U. ID No.	Brief Description
-004	Storage Silo for Activated Carbon

This emissions unit, which includes associated transport and injection equipment, is used to store and inject dry activated carbon into the flue gas of the Resource Recovery Facility. The carbon injection is used to control mercury emissions. Particulate matter (PM) emissions from the silo during pneumatic loading are controlled by a baghouse dust collector. The emissions unit is located in a PM “area of influence” and is subject to the requirements of Rule 62-296.700, F.A.C., Reasonably Available Control Technology (PM-RACT), but qualifies for an exemption per Rule 62-296.700(2)(b), F.A.C.

General

B.1. The permittee shall not allow any person to circumvent the operation of the baghouse collector. The baghouse must be operational during the pneumatic loading of the storage silo.
[AC51-266667]

Essential Potential to Emit (PTE) Parameters

B.2. Hours of Operation. These emissions units are allowed to operate continuously, i.e., 8,760 hours/year.
[Rule 62-210.200(PTE), F.A.C.; and AC51-266667]

Emission Limitations and Standards

{Permitting note: Table 1-1, Summary of Air Pollutant Standards and Terms, summarizes information for convenience purposes only. This table does not supersede any of the terms or conditions of this permit.}

B.3. Visible Emissions. Testing shall be conducted annually. Visible emissions from the baghouse exhaust and the support equipment (the dry carbon transport piping and metering system) shall not exceed 5% opacity, pursuant to Rule 62-297.620(4), F.A.C., for an emissions unit equipped with a baghouse. This visible emission limitation is established in lieu of a particulate matter emissions stack test. Should the Department have reason to believe the particulate matter standard as specified in this Specific Condition is not being met, the Department may require that compliance with the particulate matter standard be demonstrated by testing in accordance with Chapter 62-297, F.A.C.
[Rule 62-297.620(4), F.A.C.; and AC51-266667]

B.4. Particulate Matter. The maximum allowable particulate matter emission rate from storage silo exhaust shall not exceed 0.084 pounds per hour and 0.37 tons per year.
[AC51-266667]

Test Methods and Procedures

B.5. Visible Emissions. Compliance with the visible emission limitation shall be determined using EPA Method 9, and be a minimum of 30 minutes in duration. The test observation period shall include the period during which the highest opacity emissions can reasonably be expected to occur. This period is

expected to be the last minutes of silo loading. For a silo loading operation that is normally completed in less than 30 minutes, the visible emissions test shall be conducted for the normal duration of the silo loading operation.

[AC51-266667]

B.6. Visible Emissions. The visible emissions test shall be conducted while pneumatically loading the silo at a rate that is representative of the normal silo loading rate. The silo loading rate shall be at least 25 tons per hour and shall occur in less than one hour. Each test report shall include a calculation indicating the actual silo loading rate during the visible emission test. The dry carbon injections system is assumed to be in continuous operation and should be operating normally during all visible emission testing. If these operations are not in simultaneous operation during a scheduled visible emissions test, it shall be so noted on the test report.

[AC51-266667]

B.7. Excess emissions resulting from malfunction shall be permitted provided that best operational practices to minimize emissions are adhered to and the duration of excess emissions shall be minimized but in no case exceed two hours in any 24 hour period unless specifically authorized by the Department for longer duration.

[Rule 62-210.700(1), F.A.C.]

B.8. Frequency of Compliance Tests. The following provisions apply only to those emissions units that are subject to an emissions limiting standard for which compliance testing is required.

(a) General Compliance Testing.

1. [Reserved.]

2. [Reserved.]

3. The owner or operator of an emissions unit that is subject to any emission limiting standard shall conduct a compliance test that demonstrates compliance with the applicable emission limiting standard prior to obtaining a renewed operation permit. Emissions units that are required to conduct an annual compliance test may submit the most recent annual compliance test to satisfy the requirements of this provision. In renewing an air operation permit pursuant to Rule 62-210.300(2)(a)3.b., c., or d., F.A.C., the Department shall not require submission of emission compliance test results for any emissions unit that, during the year prior to renewal:

a. Did not operate; or

b. In the case of a fuel burning emissions unit, burned liquid and/or solid fuel for a total of no more than 400 hours.

4. During each federal fiscal year (October 1 - September 30), unless otherwise specified by rule, order, or permit, the owner or operator of each emissions unit shall have a formal compliance test conducted for:

a. Visible emissions, if there is an applicable standard;

b. Each of the following pollutants, if there is an applicable standard, and if the emissions unit emits or has the potential to emit: 5 tons per year or more of lead or lead compounds measured as elemental lead; or 100 tons per year or more of any other regulated air pollutant; and

c. Each NESHAP pollutant, if there is an applicable emission standard.

5. An annual compliance test for particulate matter emissions shall not be required for any fuel burning emissions unit that, in a federal fiscal year, does not burn liquid and/or solid fuel, other than during startup, for a total of more than 400 hours.

6. [Reserved.]

7. [Reserved.]

8. [Reserved.]

9. The owner or operator shall notify the Department, at least 15 days prior to the date on which each formal compliance test is to begin, of the date, time, and place of each such test, and the test contact person who will be responsible for coordinating and having such test conducted for the owner or operator.

(b) Special Compliance Tests. When the Department, after investigation, has good reason (such as complaints, increased visible emissions or questionable maintenance of control equipment) to believe that any applicable emission standard contained in a Department rule or in a permit issued pursuant to those rules is being violated, it may require the owner or operator of the emissions unit to conduct compliance tests which identify the nature and quantity of pollutant emissions from the emissions unit and to provide a report on the results of said tests to the Department.

(c) Waiver of Compliance Test Requirements. If the owner or operator of an emissions unit that is subject to a compliance test requirement demonstrates to the Department, pursuant to the procedure established in Rule 62-297.620, F.A.C., that the compliance of the emissions unit with an applicable weight emission limiting standard can be adequately determined by means other than the designated test procedure, such as specifying a surrogate standard of no visible emissions for particulate matter sources equipped with a bag house or specifying a fuel analysis for sulfur dioxide emissions, the Department shall waive the compliance test requirements for such emissions units and order that the alternate means of determining compliance be used, provided, however, the provisions of Rule 62-297.310(7)(b), F.A.C., shall apply.

[Rule 62-297.310(7), F.A.C.; and, SIP approved]

B.8.1. Operating Rate During Testing. Testing of emissions shall be conducted with the emissions unit operation at permitted capacity, which is defined as 90 to 100 percent of the maximum operation rate allowed by the permit. If it is impracticable to test at permitted capacity, an emissions unit may be tested at less than the minimum permitted capacity; in this case, subsequent emissions unit operation is limited to 110 percent of the test load until a new test is conducted. Once the emissions unit is so limited, operation at higher capacities is allowed for no more than 15 consecutive days for the purpose of additional compliance testing to regain the authority to operate at the permitted capacity.

[Rules 62-297.310(2) & (2)(b), F.A.C.]

Recordkeeping and Reporting Requirements

B.9. The permittee shall notify the Department's Southwest District Office in writing at least 15 days prior to the date on which a compliance test is to begin. The notice shall include the date, time, and place of each test, and the contact person who will be responsible for coordinating the test.

[AC51-266667]

Subsection C. This section addresses the following emissions unit.

E.U. ID No.	Brief Description
-005	Leachate Treatment Facility

At applicant request in letter dated May 16, 2006 from Mr. Jason Gorrie, P.E., the authority to operate the Leachate Treatment facility has been rescinded.

(Subsection C. Reserved)

Subsection D. This section addresses the following emissions unit.

E.U. ID No.	Brief Description
-007	Fugitive Landfill Gas Emissions

Although the Pasco County Landfill is primarily an ash landfill, it also accepts small amounts of municipal solid waste (MSW) as bypass from the associated municipal waste combustors. The landfill has accepted waste since 1987, and the current design capacity is estimated to be 18,586,137 cubic yards (14,210,031 cubic meters). Total area of waste placement storage is estimated at 238 acres. Approximately 619,296 tons (522,805 megagrams) of ash have been accepted between 1991 and 1999. Approximately 45,390 tons (41,175 megagrams) of MSW bypass were accepted in the same period. There is no gas collection and control system in place. All emissions from the landfill are fugitive.

The scheduled landfill closure date is 2067. In compliance with 40 CFR Subpart Cc regulations adopted and incorporated by Rule 62-204.800(8), F.A.C., NMOC emissions from the landfill were calculated. Tier I calculations yielded an NMOC value for 1999 of 8.9 megagrams per year (Mg/year), which is less than the threshold NMOC value of 50 Mg/yr., and therefore a gas collection and control system was not installed at this landfill site.

{Permitting notes: This emissions unit is regulated under 40 CFR 60, Subpart Cc, Emissions Guidelines and Compliance Times for Municipal Solid Waste Landfills, adopted and incorporated by reference, subject to provisions, in Rule 62-204.800(8)(c), F.A.C. Also, please note that conditions in 40 CFR 60, Subpart Cc, are contained in 40 CFR 60, Subpart WWW.}

The following Specific Conditions apply to the emissions units listed above:

General

D.1. Designated Facility.

- (a) The designated facility to which the guidelines apply is each existing MSW landfill
 - (i) for which construction, reconstruction or modification was commenced before May 30, 1991; and
 - (ii) which has accepted waste at any time since November 8, 1987, or has additional design capacity available for future waste deposition.
- (b) Physical or operational changes made to an existing MSW landfill solely to comply with the provisions of Rule 62-204.800(8)(c), F.A.C. are not considered a modification or reconstruction and would not subject an existing MSW landfill to the requirements of 40 CFR 60, Subpart WWW [see 40 CFR 60.750].
- (c) N/A
- (d) When a MSW landfill subject to 40 CFR 60, Subpart Cc is closed, the owner or operator is no longer subject to the requirement to maintain an operating permit under 40 CFR 70 or 71 for the landfill if the landfill is not otherwise subject to the requirements of either 40 CFR 70 or 71 and if either of the following conditions are met.
 - (1) The landfill was never subject to the requirement for a control system under Rule 62-204.800(8)(c)3.; or
 - (2) The owner or operator meets the conditions for control system removal specified in 40 CFR 60.752(b)(2)(v).

[Rules 62-204.800(8)(c)1. & 3., F.A.C.; 40 CFR 60.32c; and, 40 CFR 60.33c(a)(1)]

D.2. Definitions. For the purposes of Rule 62-204.800(8), F.A.C., the definitions contained in the various provisions of 40 CFR Part 60, adopted herein shall apply except that the term "Administrator" when used in 40 CFR Part 60, shall mean the Secretary or the Secretary's designee.
[Rule 62-204.800(8)(a)2., F.A.C.; and, 40 CFR 60.2]

D.3. Definitions – Subpart Cc. The terms used but not defined in 40 CFR 60, Subpart Cc have the meaning given to them in the Act and in Subparts A, B, and WWW of 40 CFR 60.
[Rule 62-204.800(8)(c)2., F.A.C.; and, 40 CFR 60.31c]

D.4. Standards for Air Emissions from MSW Landfills. Any MSW landfill which has a design capacity greater than or equal to 2.5 million Megagrams and 2.5 million cubic meters but whose NMOC emission rate as of December 31, 1996, is less than 50 Megagrams per year shall comply with the provisions of 40 CFR 60.752(b)(2)(i) through (v) (see specific condition D.5.) commencing from December 31 of the first year after 1996 for which the nonmethane organic compound emission rate equals or exceeds 50 Megagrams per year.
[Rule 62-204.800(8)(c)3.b., F.A.C.]

D.5. Collection and Control System Requirements.

(2) If the calculated NMOC emission rate is equal to or greater than 50 megagrams per year, the owner or operator shall:

(i) Submit a collection and control system design plan prepared by a professional engineer to the Administrator **within 1 year**:

(A) The collection and control system as described in the plan shall meet the design requirements of paragraph (ii) below.

(B) The collection and control system design plan shall include any alternatives to the operational standards, test methods, procedures, compliance measures, monitoring, recordkeeping or reporting provisions of 40 CFR 60.753 through 60.758 proposed by the owner or operator.

(C) The collection and control system design plan shall either conform with specifications for active collection systems in 40 CFR 60.759 or include a demonstration to the Administrator's satisfaction of the sufficiency of the alternative provisions to 40 CFR 60.759.

(D) The Administrator shall review the information submitted under paragraphs (i) (A), (B) and (C) above and either approve it, disapprove it, or request that additional information be submitted. Because of the many site-specific factors involved with landfill gas system design, alternative systems may be necessary. A wide variety of system designs are possible, such as vertical wells, combination horizontal and vertical collection systems, or horizontal trenches only, leachate collection components, and passive systems.

(ii) Install a collection and control system that captures the gas generated within the landfill as required by paragraphs (ii)(A) or (B) and (iii) below within 30 months after the first annual report in which the emission rate equals or exceeds 50 megagrams per year, unless Tier 2 or Tier 3 sampling demonstrates that the emission rate is less than 50 megagrams per year, as specified in 40 CFR 60.757(c)(1) or (2).

(A) An active collection system shall:

(1) Be designed to handle the maximum expected gas flow rate from the entire area of the landfill that warrants control over the intended use period of the gas control or treatment system equipment;

- (2) Collect gas from each area, cell, or group of cells in the landfill in which the initial solid waste has been placed for a period of:
 - (i) 5 years or more if active; or
 - (ii) 2 years or more if closed or at final grade;
 - (3) Collect gas at a sufficient extraction rate;
 - (4) Be designed to minimize off-site migration of subsurface gas.
 - (B) A passive collection system shall:
 - (1) Comply with the provisions specified in paragraphs (b)(2)(ii), (A) (1), (2), and (4) of this section.
 - (2) Be installed with liners on the bottom and all sides in all areas in which gas is to be collected. The liners shall be installed as required under Sec. 258.40 of this title.
 - (iii) Route all the collected gas to a control system that complies with the requirements in either paragraph (iii) (A), (B) or (C) below.
 - (A) An open flare designed and operated in accordance with 40 CFR 60.18;
 - (B) A control system designed and operated to reduce NMOC by 98 weight-percent, or, when an enclosed combustion device is used for control, to either reduce NMOC by 98 weight percent or reduce the outlet NMOC concentration to less than 20 parts per million by volume, dry basis as hexane at 3 percent oxygen. The reduction efficiency or parts per million by volume shall be established by an initial performance test to be completed no later than 180 days after the initial startup of the approved control system using the test methods specified in 40 CFR 60.754(d).
 - (C) Route the collected gas to a treatment system that processes the collected gas for subsequent sale or use. All emissions from any atmospheric vent from the gas treatment system shall be subject to the requirements of paragraph (iii) (A) or (B) above.
 - (iv) Operate the collection and control device installed to comply with 40 CFR 60, Subpart WWW in accordance with the provisions of 40 CFR 60.753, 60.755 and 60.756, and applicable provisions of 60.757, 60.758, and Rules 62-213.440 and 62-297.310(8), F.A.C..
 - (v) The collection and control system may be capped or removed provided that all the conditions of paragraphs (v) (A), (B), and (C) below are met:
 - (A) The landfill shall be a closed landfill as defined in 40 CFR 60.751. A closure report shall be submitted to the Administrator as provided in 40 CFR 60.757(d);
 - (B) The collection and control system shall have been in operation a minimum of 15 years; and
 - (C) Following the procedures specified in 40 CFR 60.754(b), the calculated NMOC gas produced by the landfill shall be less than 50 megagrams per year on three successive test dates. The test dates shall be no less than 90 days apart, and no more than 180 days apart.
- [40 CFR 60.752(b)(2)(i) through (v)]

D.6. Hours of Operation. The landfill may operate continuously, i.e., 8,760 hrs/yr.
[Rules 62-213.440 and 62-210.200(PTE), F.A.C.]

Test Methods and Procedures

D.7. The provisions of 40 CFR 60.754, as applicable, shall be used to calculate the landfill NMOC emission rate for the purposes of the submittal of NMOC emission rate reports and determining whether the landfill has a nonmethane organic compound (NMOC) emission rate of 50 Megagrams per year or more.
[Rule 62-204.800(c)5., F.A.C.]

D.8. Method of Calculating NMOC Emissions.

The landfill owner or operator shall calculate the NMOC emission rate using either the equation provided in paragraph (i) below or the equation provided in paragraph (ii) below. Both equations may be used if the actual year-to-year solid waste acceptance rate is known, as specified in paragraph (i), for part of the life of the landfill and the actual year-to-year solid waste acceptance rate is unknown, as specified in paragraph (ii), for part of the life of the landfill. The values to be used in both equations are 0.05 per year for k , 170 cubic meters per megagram for L_o , and 4,000 parts per million by volume as hexane for the C_{NMOC} . For landfills located in geographical areas with a thirty year annual average precipitation of less than 25 inches, as measured at the nearest representative official meteorologic site, the k value to be used is 0.02 per year.

(i) The following equation shall be used if the actual year-to-year solid waste acceptance rate is known.

$$M_{NMOC} = \sum_{i=1}^n 2kL_o M_i (e^{-kt_i}) (C_{NMOC}) (3.6 \times 10^{-9})$$

where,

M_{NMOC} = Total NMOC emission rate from the landfill, megagrams per year

k = methane generation rate constant, year⁻¹

L_o = methane generation potential, cubic meters per megagram solid waste

M_i = mass of solid waste in the i^{th} section, megagrams

t_i = age of the i^{th} section, years

C_{NMOC} = concentration of NMOC, parts per million by volume as hexane

3.6×10^{-9} = conversion factor

The mass of non-degradable solid waste may be subtracted from the total mass of solid waste in a particular section of the landfill when calculating the value for M_i if documentation of the nature and amount of such wastes is maintained.

(ii) The following equation shall be used if the actual year-to-year solid waste acceptance rate is unknown.

$$M_{NMOC} = 2L_o R (e^{-kc} - e^{-kt}) (C_{NMOC}) (3.6 \times 10^{-9})$$

where,

M_{NMOC} = mass emission rate of NMOC, megagrams per year

L_o = methane generation potential, cubic meters per megagram solid waste

R = average annual acceptance rate, megagrams per year

k = methane generation rate constant, year⁻¹

t = age of landfill, years

C_{NMOC} = concentration of NMOC, parts per million by volume as hexane

c = time since closure, years. For active landfill $c = 0$ and $e^{-kc} = 1$

3.6×10^{-9} = conversion factor

The mass of non-degradable solid waste may be subtracted from the average annual acceptance rate when calculating a value for R , if documentation of the nature and amount of such wastes is maintained.

[40 CFR 60.754(a)(1)]

D.9. Requirements if Calculated NMOC Emissions are less than 50 megagrams per year.

Tier 1. The owner or operator shall compare the calculated NMOC mass emission rate to the standard of 50 megagrams per year.

(i) If the NMOC emission rate calculated in 40 CFR 60.754(a)(1) is less than 50 megagrams per year, then the landfill owner shall submit an emission rate report as provided in 40 CFR 60.757(b)(1), and shall recalculate the NMOC mass emission rate annually as required under 40 CFR 60.752(b)(1).

(ii) If the calculated NMOC emission rate is equal to or greater than 50 megagrams per year, then the landfill owner shall either comply with 40 CFR 60.752(b)(2), or determine a site-specific NMOC concentration and recalculate the NMOC emission rate using the procedures provided in 40 CFR 60.754(a)(3).

[40 CFR 60.754(a)(2)]

D.10. Method for Determining Site-Specific NMOC Emissions.

Tier 2. The landfill owner or operator shall determine the NMOC concentration using the following sampling procedure. The landfill owner or operator shall install at least two sample probes per hectare of landfill surface that has retained waste for at least 2 years. If the landfill is larger than 25 hectares in area, only 50 samples are required. The sample probes should be located to avoid known areas of non-degradable solid waste. The owner or operator shall collect and analyze one sample of landfill gas from each probe to determine the NMOC concentration using Method 25C or Method 18 of 40 CFR 60 Appendix A. If using Method 18 of 40 CFR 60 Appendix A, the minimum list of compounds to be tested shall be those published in the most recent Compilation of Air Pollutant Emission Factors (AP-42). If composite sampling is used, equal volumes shall be taken from each sample probe. If more than the required number of samples are taken, all samples shall be used in the analysis. The landfill owner or operator shall divide the NMOC concentration from Method 25C of 40 CFR 60 Appendix A by six to convert from C_{NMOC} as carbon to C_{NMOC} as hexane.

(i) The landfill owner or operator shall recalculate the NMOC mass emission rate using the equations provided in 40 CFR 60.754(a)(1)(i) or (a)(1)(ii) and using the average NMOC concentration from the collected samples instead of the default value in the equation provided in 40 CFR 60.754(a)(1).

(ii) If the resulting mass emission rate calculated using the site-specific NMOC concentration is equal to or greater than 50 megagrams per year, then the landfill owner or operator shall either comply with 40 CFR 60.752(b)(2), or determine the site-specific methane generation rate constant and recalculate the NMOC emission rate using the site-specific methane generation rate using the procedure specified in 40 CFR 60.754(a)(4).

(iii) If the resulting NMOC mass emission rate is less than 50 megagrams per year, the owner or operator shall submit a periodic estimate of the emission rate report as provided in 40 CFR 60.757(b)(1) and retest the site-specific NMOC concentration every 5 years using the methods specified in 40 CFR 60.754(a)(3).

[40 CFR 60.754(a)(3)]

D.11. Method for Determining Site-Specific Methane Generation Rate.

Tier 3. The site-specific methane generation rate constant shall be determined using the procedures provided in Method 2E of 40 CFR 60 Appendix A. The landfill owner or operator shall estimate the NMOC mass emission rate using equations in 40 CFR 60.754(a)(1)(i) or (a)(1)(ii) and using a site-specific methane generation rate constant k , and the site-specific NMOC concentration as determined in 40 CFR 60.754(a)(3) instead of the default values provided in 40 CFR 60.754(a)(1). The landfill owner

or operator shall compare the resulting NMOC mass emission rate to the standard of 50 megagrams per year.

(i) If the NMOC mass emission rate as calculated using the site-specific methane generation rate and concentration of NMOC is equal to or greater than 50 megagrams per year, the owner or operator shall comply with 40 CFR 60.752(b)(2).

(ii) If the NMOC mass emission rate is less than 50 megagrams per year, then the owner or operator shall submit a periodic emission rate report as provided in 40 CFR 60.757(b)(1) and shall recalculate the NMOC mass emission rate annually, as provided in 40 CFR 60.757(b)(1) using the equations in 40 CFR 60.754(a)(1) and using the site-specific methane generation rate constant and NMOC concentration obtained in 40 CFR 60.754(a)(3). The calculation of the methane generation rate constant is performed only once, and the value obtained from this test shall be used in all subsequent annual NMOC emission rate calculations.

[40 CFR 60.754(a)(4)]

D.12. Alternative Methods. The owner or operator may use other methods to determine the NMOC concentration or a site-specific k as an alternative to the methods required in 40 CFR 60.754(a)(3) and (a)(4) if the method has been approved by the Administrator.

[40 CFR 60.754(a)(5)]

Reporting Requirements

D.13. The NMOC emission rate shall be recalculated annually, except as provided in 40 CFR 60.757(b)(1)(ii).

(1) If the calculated NMOC emission rate is less than 50 megagrams per year, the owner or operator shall:

- (i) submit an annual emission report, except as provided for in 40 CFR 60.757(b)(1)(ii); and,
- (ii) recalculate the NMOC emission rate annually using the procedures specified in 40 CFR 60.754(a)(1) until such time as the calculated NMOC emission rate is equal to or greater than 50 megagrams per year, or the landfill is closed.

(2) (i) If the NMOC emission rate, upon initial calculation or annual recalculation required in paragraph (1)(ii) above, is equal to or greater than 50 megagrams per year, the owner or operator shall install a collection and control system as provided in 40 CFR 60.752(b)(2).

(ii) If the landfill is permanently closed, a closure notification shall be submitted to the Administrator as provided in 40 CFR 60.757(d).

[40 CFR 60.33c(e)]

D.14. Reporting. Each owner or operator of an MSW landfill to which Rule 62-204.800(8)(c), F.A.C., applies shall comply with the reporting provisions of 40 CFR 60.757, as applicable.

[Rule 62-204.800(c)5., F.A.C.]

D.15. Notification of any Increase in Design Capacity. An amended design capacity report shall be submitted to the Administrator providing notification of an increase in the design capacity of the landfill, within 90 days of an increase in the maximum design capacity of the landfill to or above 2.5 million megagrams and 2.5 million cubic meters. This increase in design capacity may result from an increase in the permitted volume of the landfill or an increase in the density as documented in the annual recalculation required in 40 CFR 60.758(f).

[40 CFR 60.757(a)(3)]

D.16. Annual NMOC Emission Rate. Each owner or operator subject to the requirements of Rule 62-204.800(8)(c), F.A.C., shall submit an NMOC emission rate report to the Administrator annually, except as provided for in paragraphs (1)(ii) or (3) below. The Administrator may request such additional information as may be necessary to verify the reported NMOC emission rate.

(1) The NMOC emission rate report shall contain an annual or 5-year estimate of the NMOC emission rate calculated using the formula and procedures provided in 40 CFR 60.754(a) or (b), as applicable.

(i) NMOC emission rate reports shall be submitted annually, except as provided for in paragraphs (1)(ii) and (3) below.

(ii) If the estimated NMOC emission rate as reported in the annual report to the Administrator is less than 50 megagrams per year in each of the next 5 consecutive years, the owner or operator may elect to submit an estimate of the NMOC emission rate for the next 5-year period in lieu of the annual report. This estimate shall include the current amount of solid waste-in-place and the estimated waste acceptance rate for each year of the 5 years for which an NMOC emission rate is estimated. All data and calculations upon which this estimate is based shall be provided to the Administrator. This estimate shall be revised at least once every 5 years. If the actual waste acceptance rate exceeds the estimated waste acceptance rate in any year reported in the 5-year estimate, a revised 5-year estimate shall be submitted to the Administrator. The revised estimate shall cover the 5-year period beginning with the year in which the actual waste acceptance rate exceeded the estimated waste acceptance rate.

(2) The NMOC emission rate report shall include all the data, calculations, sample reports and measurements used to estimate the annual or 5-year emissions.

(3) Each owner or operator subject to the requirements of 40 CFR 60, Subpart Cc is exempted from the requirements of paragraphs (1) and (2) above, after the installation of a collection and control system in compliance with 40 CFR 60.752(b)(2), during such time as the collection and control system is in operation and in compliance with 40 CFR 60.753 and 60.755.

[Rule 62-204.800(8)(c)5., F.A.C.; and, 40 CFR 60.757(b)]

D.17. Collection and Control System Design Plan. Each owner or operator subject to the provisions of 40 CFR 60.752(b)(2)(i) shall submit a collection and control system design plan to the Administrator within 1 year of the first report, required under 40 CFR 60.757(b), in which the emission rate exceeds 50 megagrams per year, except as follows:

(1) If the owner or operator elects to recalculate the NMOC emission rate after Tier 2 NMOC sampling and analysis as provided in 40 CFR 60.754(a)(3) and the resulting rate is less than 50 megagrams per year, annual periodic reporting shall be resumed, using the Tier 2 determined site-specific NMOC concentration, until the calculated emission rate is equal to or greater than 50 megagrams per year or the landfill is closed. The revised NMOC emission rate report, with the recalculated emission rate based on NMOC sampling and analysis, shall be submitted within 180 days of the first calculated exceedance of 50 megagrams per year.

(2) If the owner or operator elects to recalculate the NMOC emission rate after determining a site-specific methane generation rate constant (k), as provided in Tier 3 in 40 CFR 60.754(a)(4), and the resulting NMOC emission rate is less than 50 Mg/yr, annual periodic reporting shall be resumed. The resulting site-specific methane generation rate constant (k) shall be used in the emission rate calculation until such time as the emissions rate calculation results in an exceedance. The revised NMOC emission rate report based on the provisions of 40 CFR 60.754(a)(4) and the resulting site-specific methane generation rate constant (k) shall be submitted to the Administrator within 1 year of the first calculated emission rate exceeding 50 megagrams per year.

[40 CFR 60.757(c)]

D.18. [Reserved.]

D.19. Uncontrolled Landfill Closure Report. Each owner or operator of an uncontrolled landfill shall submit a closure report to the DEP Southwest District Office within 30 days of waste acceptance cessation. The Department may request additional information as may be necessary to verify that permanent closure has taken place in accordance with the requirements of 40 CFR 258.60. If a closure report has been submitted to the Department, no additional wastes may be placed into the landfill without filing a notification of modification as described under 40 CFR 60.7(a)(4).
[Rule 62-213.440, F.A.C.]

Recordkeeping Requirements

D.20. [Reserved.]

D.21. Capacity and Acceptance Reports. Except as provided in 40 CFR 60.752(b)(2)(i)(B), each owner or operator of an MSW landfill subject to the provisions of 40 CFR 60.752(b) shall keep for at least 5 years up-to-date, readily accessible, on-site records of the design capacity report which triggered 40 CFR 60.752(b), the current amount of solid waste in-place, and the year-by-year waste acceptance rate. Off-site records may be maintained if they are retrievable within 4 hours. Either paper copy or electronic formats are acceptable.
[40 CFR 60.758(a)]

D.22. Design Capacity Calculations. Landfill owners or operators who convert design capacity from volume to mass or mass to volume to demonstrate that landfill design capacity is less than 2.5 million megagrams or 2.5 million cubic meters, as provided in the definition of "design capacity", shall keep readily accessible, on-site records of the annual recalculation of site-specific density, design capacity, and the supporting documentation. Off-site records may be maintained if they are retrievable within 4 hours. Either paper copy or electronic formats are acceptable.
[40 CFR 60.758(f)]

D.23. Recordkeeping. Each owner or operator of an MSW landfill to which Rule 62-204.800(8)(c), F.A.C., applies shall comply with the recordkeeping provisions of 40 CFR 60.758, as applicable.
[40 CFR 60.758]

Subsection E. This section addresses the following emissions unit.

E.U. ID No.	Brief Description
-008	Ash Building and Handling System

Emission Limitations and Standards

{Permitting note: Table 1-1, Summary of Air Pollutant Standards and Terms, summarizes information for convenience purposes only. This table does not supersede any of the terms or conditions of this permit.}

Fugitive Ash Visible Emissions

E.1. Fugitive Ash Visible Emissions.

(a) On and after the date on which the initial performance test is completed or is required to be completed under 40 CFR 60.8 of Subpart A, no owner or operator of an affected facility shall cause to be discharged to the atmosphere visible emissions of combustion ash from an ash conveying system (including conveyor transfer points) in excess of 5 percent of the observation period (i.e., 9 minutes per 3-hour period), as determined by EPA Reference Method 22 observations as specified in 40 CFR 60.58b(k), except as provided in paragraphs (b) and (c). See Specific Condition E.2.

(b) The emission limit specified in paragraph (a) does not cover visible emissions discharged inside buildings or enclosures of ash conveying systems; however, the emission limit specified in paragraph (a) does cover visible emissions discharged to the atmosphere from buildings or enclosures of ash conveying systems.

(c) The provisions of paragraph (a) do not apply during maintenance and repair of ash conveying systems.

[40 CFR 60.36b and 40 CFR 60.55b]

Test Methods and Procedures

{Permitting note: Table 2-1, Summary of Compliance Requirements, summarizes information for convenience purposes only. This table does not supersede any of the terms or conditions of this permit.}

Fugitive Ash

E.2. The procedures specified in paragraphs (1) through (4) shall be used for determining compliance with the fugitive ash emission limit under 40 CFR 60.55b.

(1) The EPA Reference Method 22 shall be used for determining compliance with the fugitive ash emission limit under 40 CFR 60.55b. The minimum observation time shall be a series of three 1-hour observations. The observation period shall include times when the facility is transferring ash from the municipal waste combustor unit to the area where ash is stored or loaded into containers or trucks.

(2) The average duration of visible emissions per hour shall be calculated from the three 1-hour observations. The average shall be used to determine compliance with 40 CFR 60.55b.

(3) The owner or operator of an affected facility shall conduct an initial performance test for fugitive ash emissions as required under 40 CFR 60.8.

(4) Following the date that the initial performance test for fugitive ash emissions is completed or is required to be completed under Sec. 60.8 for an affected facility, the owner or operator shall conduct a

performance test for fugitive ash emissions on an annual basis (no more than 12 calendar months following the previous performance test).
[40 CFR 60.38b, 40 CFR 60.58b(k)]

Appendix U-1. List of Unregulated Emissions Units and/or Activities.

Unregulated Emissions Units and/or Activities. An emissions unit which emits no “emissions-limited pollutant” and which is subject to no unit-specific work practice standard, though it may be subject to regulations applied on a facility-wide basis (e.g., unconfined emissions, odor, general opacity) or to regulations that require only that it be able to prove exemption from unit-specific emissions or work practice standards.

The below listed emissions unit and/or activity is neither a ‘regulated emissions unit’ nor an ‘insignificant emissions unit’.

E.U. ID No.	Brief Description
-006	Cooling Tower

Appendix I-1. List of Insignificant Emissions Units and/or Activities.

The facilities, emissions units, or pollutant-emitting activities listed in Rule 62-210.300(3)(a), F.A.C., Categorical Exemptions, are exempt from the permitting requirements of Chapters 62-210 and 62-4, F.A.C.; provided, however, that exempt emissions units shall be subject to any applicable emission limiting standards and the emissions from exempt emissions units or activities shall be considered in determining the potential emissions of the facility containing such emissions units. Emissions units and pollutant-emitting activities exempt from permitting under Rule 62-210.300(3)(a), F.A.C., shall not be exempt from the permitting requirements of Chapter 62-213, F.A.C., if they are contained within a Title V source; however, such emissions units and activities shall be considered insignificant for Title V purposes provided they also meet the criteria of Rule 62-213.430(6)(b), F.A.C. No emissions unit shall be entitled to an exemption from permitting under Rule 62.210.300(3)(a), F.A.C., if its emissions, in combination with the emissions of other units and activities at the facility, would cause the facility to emit or have the potential to emit any pollutant in such amount as to make the facility a Title V source.

The below listed emissions units and/or activities are considered insignificant pursuant to Rule 62-213.430(6), F.A.C.

	Brief Description of Emissions Units and/or Activities
1	Fire and Safety Equipment
2	Paint
3	Diesel Storage Tanks (300 gallons, 1100 gallons)
4	Vehicular Traffic
5	Emergency Generator
6	Refuse Pit
7	Dolomitic Lime Ash Conditioning System
8	Cooling Water Treatment Chemicals
9	Flanges and Valves
10	Indoor Lime Storage Silo
11	Ammonia Tank (10,000 gallons at 19% solution)
12	Chlorine Cylinders (1350 pounds, total)
13	Propane Tank (30000 gallons)

Referenced Attachments

Appendix A, 40 CFR 60, Subpart A - General Provisions

Appendix A-1, Abbreviations, Definitions, Citations, and Identification Numbers

Appendix BW, Biomedical Waste Definitions

Appendix CAM, Compliance Assurance Monitoring Plan

Appendix H-1, Permit History/ID Number Changes

Appendix SS-1, Stack Sampling Facilities (version dated 10/7/96)

Appendix TV-6, Title V Conditions (version dated 06/23/06)

Table 1-1, Summary of Air Pollutant Standards and Terms

APPENDIX 40 CFR 60 SUBPART A

GENERAL PROVISIONS

(version dated 10/9/2008)

E.U. ID No.	Brief Description
-001	Municipal Waste Combustion Unit No. 1
-002	Municipal Waste Combustion Unit No. 2
-003	Municipal Waste Combustion Unit No. 3

Federal Regulations Adopted by Reference

In accordance with Rule 62-204.800, F.A.C., the following federal regulation in Title 40 of the Code of Federal Regulations (CFR) was adopted by reference. The original federal rule numbering has been retained.

Federal Revision Date: June 13, 2007

Rule Effective Date: October 1, 2007

Standardized Conditions Revision Date: October 9, 2008

40 CFR Part 60, Subpart A - General Provisions**Index**

40 CFR 60.1	Applicability.
40 CFR 60.2	Definitions.
40 CFR 60.3	Units and abbreviations.
40 CFR 60.4	Address.
40 CFR 60.5	Determination of construction or modification.
40 CFR 60.6	Review of plans.
40 CFR 60.7	Notification and record keeping.
40 CFR 60.8	Performance tests.
40 CFR 60.9	Availability of information.
40 CFR 60.10	State authority.
40 CFR 60.11	Compliance with standards and maintenance requirements.
40 CFR 60.12	Circumvention.
40 CFR 60.13	Monitoring requirements.
40 CFR 60.14	Modification.
40 CFR 60.15	Reconstruction.
40 CFR 60.16	Priority list.
40 CFR 60.17	Incorporations by reference.
40 CFR 60.18	General control device requirements.
40 CFR 60.19	General notification and reporting requirements.

End of Index**§ 60.1 Applicability.**

- (a) Except as provided in subparts B and C, the provisions of this part apply to the owner or operator of any stationary source which contains an affected facility, the construction or modification of which is commenced after the date of publication in this part of any standard (or, if earlier, the date of publication of any proposed standard) applicable to that facility.
- (b) Any new or revised standard of performance promulgated pursuant to section 111(b) of the Act shall apply to the owner or operator of any stationary source which contains an affected facility, the construction or modification of which is commenced after the date of publication in this part of such new or revised standard (or, if earlier, the date of publication of any proposed standard) applicable to that facility.
- (c) In addition to complying with the provisions of this part, the owner or operator of an affected facility may be required to obtain an operating permit issued to stationary sources by an authorized State air pollution control agency or by the Administrator of the U.S. Environmental Protection Agency (EPA) pursuant to Title V of the Clean Air Act (Act) as amended November 15, 1990 (42 U.S.C. 7661). For more information about obtaining an operating permit see part 70 of this chapter.

GENERAL PROVISIONS

(version dated 10/9/2008)

(d) *Site-specific standard for Merck & Co., Inc.'s Stonewall Plant in Elkton, Virginia. {Not Applicable}*

§ 60.2 Definitions.

The terms used in this part are defined in the Act or in this section as follows:

Act means the Clean Air Act (42 U.S.C. 7401 *et seq.*)

Administrator means the Administrator of the Environmental Protection Agency or his authorized representative.

Affected facility means, with reference to a stationary source, any apparatus to which a standard is applicable.

Alternative method means any method of sampling and analyzing for an air pollutant which is not a reference or equivalent method but which has been demonstrated to the Administrator's satisfaction to, in specific cases, produce results adequate for his determination of compliance.

Approved permit program means a State permit program approved by the Administrator as meeting the requirements of part 70 of this chapter or a Federal permit program established in this chapter pursuant to Title V of the Act (42 U.S.C. 7661).

Capital expenditure means an expenditure for a physical or operational change to an existing facility which exceeds the product of the applicable "annual asset guideline repair allowance percentage" specified in the latest edition of Internal Revenue Service (IRS) Publication 534 and the existing facility's basis, as defined by section 1012 of the Internal Revenue Code. However, the total expenditure for a physical or operational change to an existing facility must not be reduced by any "excluded additions" as defined in IRS Publication 534, as would be done for tax purposes.

Clean coal technology demonstration project means a project using funds appropriated under the heading 'Department of Energy-Clean Coal Technology', up to a total amount of \$2,500,000,000 for commercial demonstrations of clean coal technology, or similar projects funded through appropriations for the Environmental Protection Agency.

Commenced means, with respect to the definition of *new source* in section 111(a)(2) of the Act, that an owner or operator has undertaken a continuous program of construction or modification or that an owner or operator has entered into a contractual obligation to undertake and complete, within a reasonable time, a continuous program of construction or modification.

Construction means fabrication, erection, or installation of an affected facility.

Continuous monitoring system means the total equipment, required under the emission monitoring sections in applicable subparts, used to sample and condition (if applicable), to analyze, and to provide a permanent record of emissions or process parameters.

Electric utility steam generating unit means any steam electric generating unit that is constructed for the purpose of supplying more than one-third of its potential electric output capacity and more than 25 MW electrical output to any utility power distribution system for sale. Any steam supplied to a steam distribution system for the purpose of providing steam to a steam-electric generator that would produce electrical energy for sale is also considered in determining the electrical energy output capacity of the affected facility.

Equivalent method means any method of sampling and analyzing for an air pollutant which has been demonstrated to the Administrator's satisfaction to have a consistent and quantitatively known relationship to the reference method, under specified conditions.

Excess Emissions and Monitoring Systems Performance Report is a report that must be submitted periodically by a source in order to provide data on its compliance with stated emission limits and operating parameters, and on the performance of its monitoring systems.

Existing facility means, with reference to a stationary source, any apparatus of the type for which a standard is promulgated in this part, and the construction or modification of which was commenced before the date of proposal of that standard; or any apparatus which could be altered in such a way as to be of that type.

Force majeure means, for purposes of §60.8, an event that will be or has been caused by circumstances beyond the control of the affected facility, its contractors, or any entity controlled by the affected facility that prevents the owner or operator from complying with the regulatory requirement to conduct performance tests within the specified timeframe despite the affected facility's best efforts to fulfill the obligation. Examples of such events are acts of nature, acts of war or terrorism, or equipment failure or safety hazard beyond the control of the affected facility.

GENERAL PROVISIONS

(version dated 10/9/2008)

Isokinetic sampling means sampling in which the linear velocity of the gas entering the sampling nozzle is equal to that of the undisturbed gas stream at the sample point.

Issuance of a part 70 permit will occur, if the State is the permitting authority, in accordance with the requirements of part 70 of this chapter and the applicable, approved State permit program. When the EPA is the permitting authority, issuance of a Title V permit occurs immediately after the EPA takes final action on the final permit.

Malfunction means any sudden, infrequent, and not reasonably preventable failure of air pollution control equipment, process equipment, or a process to operate in a normal or usual manner. Failures that are caused in part by poor maintenance or careless operation are not malfunctions.

Modification means any physical change in, or change in the method of operation of, an existing facility which increases the amount of any air pollutant (to which a standard applies) emitted into the atmosphere by that facility or which results in the emission of any air pollutant (to which a standard applies) into the atmosphere not previously emitted.

Monitoring device means the total equipment, required under the monitoring of operations sections in applicable subparts, used to measure and record (if applicable) process parameters.

Nitrogen oxides means all oxides of nitrogen except nitrous oxide, as measured by test methods set forth in this part.

One-hour period means any 60-minute period commencing on the hour.

Opacity means the degree to which emissions reduce the transmission of light and obscure the view of an object in the background.

Owner or operator means any person who owns, leases, operates, controls, or supervises an affected facility or a stationary source of which an affected facility is a part.

Part 70 permit means any permit issued, renewed, or revised pursuant to part 70 of this chapter.

Particulate matter means any finely divided solid or liquid material, other than uncombined water, as measured by the reference methods specified under each applicable subpart, or an equivalent or alternative method.

Permit program means a comprehensive State operating permit system established pursuant to title V of the Act (42 U.S.C. 7661) and regulations codified in part 70 of this chapter and applicable State regulations, or a comprehensive Federal operating permit system established pursuant to title V of the Act and regulations codified in this chapter.

Permitting authority means:

- (1) The State air pollution control agency, local agency, other State agency, or other agency authorized by the Administrator to carry out a permit program under part 70 of this chapter; or
- (2) The Administrator, in the case of EPA-implemented permit programs under title V of the Act (42 U.S.C. 7661).

Proportional sampling means sampling at a rate that produces a constant ratio of sampling rate to stack gas flow rate.

Reactivation of a very clean coal-fired electric utility steam generating unit means any physical change or change in the method of operation associated with the commencement of commercial operations by a coal-fired utility unit after a period of discontinued operation where the unit:

- (1) Has not been in operation for the two-year period prior to the enactment of the Clean Air Act Amendments of 1990, and the emissions from such unit continue to be carried in the permitting authority's emissions inventory at the time of enactment;
- (2) Was equipped prior to shut-down with a continuous system of emissions control that achieves a removal efficiency for sulfur dioxide of no less than 85 percent and a removal efficiency for particulates of no less than 98 percent;
- (3) Is equipped with low-NO_x burners prior to the time of commencement of operations following reactivation; and
- (4) Is otherwise in compliance with the requirements of the Clean Air Act.

Reference method means any method of sampling and analyzing for an air pollutant as specified in the applicable subpart.

GENERAL PROVISIONS

(version dated 10/9/2008)

Repowering means replacement of an existing coal-fired boiler with one of the following clean coal technologies: atmospheric or pressurized fluidized bed combustion, integrated gasification combined cycle, magnetohydrodynamics, direct and indirect coal-fired turbines, integrated gasification fuel cells, or as determined by the Administrator, in consultation with the Secretary of Energy, a derivative of one or more of these technologies, and any other technology capable of controlling multiple combustion emissions simultaneously with improved boiler or generation efficiency and with significantly greater waste reduction relative to the performance of technology in widespread commercial use as of November 15, 1990. Repowering shall also include any oil and/or gas-fired unit which has been awarded clean coal technology demonstration funding as of January 1, 1991, by the Department of Energy.

Run means the net period of time during which an emission sample is collected. Unless otherwise specified, a run may be either intermittent or continuous within the limits of good engineering practice.

Shutdown means the cessation of operation of an affected facility for any purpose.

Six-minute period means any one of the 10 equal parts of a one-hour period.

Standard means a standard of performance proposed or promulgated under this part.

Standard conditions means a temperature of 293 K (68F) and a pressure of 101.3 kilopascals (29.92 in Hg).

Startup means the setting in operation of an affected facility for any purpose.

State means all non-Federal authorities, including local agencies, interstate associations, and State-wide programs, that have delegated authority to implement: (1) The provisions of this part; and/or (2) the permit program established under part 70 of this chapter. The term State shall have its conventional meaning where clear from the context.

Stationary source means any building, structure, facility, or installation which emits or may emit any air pollutant.

Title V permit means any permit issued, renewed, or revised pursuant to Federal or State regulations established to implement title V of the Act (42 U.S.C. 7661). A title V permit issued by a State permitting authority is called a part 70 permit in this part.

Volatile Organic Compound means any organic compound which participates in atmospheric photochemical reactions; or which is measured by a reference method, an equivalent method, an alternative method, or which is determined by procedures specified under any subpart.

[44 FR 55173, Sept. 25, 1979, as amended at 45 FR 5617, Jan. 23, 1980; 45 FR 85415, Dec. 24, 1980; 54 FR 6662, Feb. 14, 1989; 55 FR 51382, Dec. 13, 1990; 57 FR 32338, July 21, 1992; 59 FR 12427, Mar. 16, 1994; 72 FR 27442, May 16, 2007]

§ 60.3 Units and abbreviations.

Used in this part are abbreviations and symbols of units of measure. These are defined as follows:

(a) System International (SI) units of measure:

A—ampere

g—gram

Hz—hertz

J—joule

K—degree Kelvin

kg—kilogram

m—meter

m³—cubic meter

mg—milligram—10⁻³ gram

mm—millimeter—10⁻³ meter

GENERAL PROVISIONS

(version dated 10/9/2008)

Mg—megagram— 10^6 gram

mol—mole

N—newton

ng—nanogram— 10^{-9} gram

nm—nanometer— 10^{-9} meter

Pa—pascal

s—second

V—volt

W—watt

Ω —ohm

μ g—microgram— 10^{-6} gram

(b) Other units of measure:

Btu—British thermal unit

$^{\circ}$ C—degree Celsius (centigrade)

cal—calorie

cfm—cubic feet per minute

cu ft—cubic feet

dcf—dry cubic feet

dcm—dry cubic meter

dscf—dry cubic feet at standard conditions

dscm—dry cubic meter at standard conditions

eq—equivalent

$^{\circ}$ F—degree Fahrenheit

ft—feet

gal—gallon

gr—grain

g-eq—gram equivalent

hr—hour

in—inch

k—1,000

l—liter

lpm—liter per minute

lb—pound

meq—milliequivalent

min—minute

GENERAL PROVISIONS

(version dated 10/9/2008)

ml—milliliter

mol. wt.—molecular weight

ppb—parts per billion

ppm—parts per million

psia—pounds per square inch absolute

psig—pounds per square inch gage

°R—degree Rankine

scf—cubic feet at standard conditions

scfh—cubic feet per hour at standard conditions

scm—cubic meter at standard conditions

sec—second

sq ft—square feet

std—at standard conditions

(c) Chemical nomenclature:

CdS—cadmium sulfide

CO—carbon monoxide

CO₂—carbon dioxide

HCl—hydrochloric acid

Hg—mercury

H₂O—waterH₂S—hydrogen sulfideH₂SO₄—sulfuric acidN₂—nitrogen

NO—nitric oxide

NO₂—nitrogen dioxideNO_x—nitrogen oxidesO₂—oxygenSO₂—sulfur dioxideSO₃—sulfur trioxideSO_x—sulfur oxides

(d) Miscellaneous:

A.S.T.M.—American Society for Testing and Materials

[42 FR 37000, July 19, 1977; 42 FR 38178, July 27, 1977]

§ 60.4 Address.

All addresses that pertain to Florida have been incorporated. To see the complete list of addresses please go to <http://ecfr.gpoaccess.gov/cgi/t/text/text-idx?c=ecfr&rgn=div6&view=text&node=40:6.0.1.1.1&idno=40>.

GENERAL PROVISIONS

(version dated 10/9/2008)

Link to an amendment published at 73 FR 18164, Apr. 3, 2008.

- (a) All requests, reports, applications, submittals, and other communications to the Administrator pursuant to this part shall be submitted in duplicate to the appropriate Regional Office of the U.S. Environmental Protection Agency to the attention of the Director of the Division indicated in the following list of EPA Regional Offices.

Region IV (Alabama, Florida, Georgia, Kentucky, Mississippi, North Carolina, South Carolina, Tennessee), Director, Air and Waste Management Division, U.S. Environmental Protection Agency, 345 Courtland Street, NE., Atlanta, GA 30365.

- (b) Section 111(c) directs the Administrator to delegate to each State, when appropriate, the authority to implement and enforce standards of performance for new stationary sources located in such State. All information required to be submitted to EPA under paragraph (a) of this section, must also be submitted to the appropriate State Agency of any State to which this authority has been delegated (provided, that each specific delegation may except sources from a certain Federal or State reporting requirement). The appropriate mailing address for those States whose delegation request has been approved is as follows:

(K) Bureau of Air Quality Management, Department of Environmental Regulation, Twin Towers Office Building, 2600 Blair Stone Road, Tallahassee, FL 32301.

[40 FR 18169, Apr. 25, 1975]

Editorial Note: For Federal Register citations affecting §60.4 see the List of CFR Sections Affected which appears in the Finding Aids section of the printed volume and on GPO Access.

§ 60.5 Determination of construction or modification.

- (a) When requested to do so by an owner or operator, the Administrator will make a determination of whether action taken or intended to be taken by such owner or operator constitutes construction (including reconstruction) or modification or the commencement thereof within the meaning of this part.
- (b) The Administrator will respond to any request for a determination under paragraph (a) of this section within 30 days of receipt of such request.

[40 FR 58418, Dec. 16, 1975]

§ 60.6 Review of plans.

- (a) When requested to do so by an owner or operator, the Administrator will review plans for construction or modification for the purpose of providing technical advice to the owner or operator.
- (b)
- (1) A separate request shall be submitted for each construction or modification project.
 - (2) Each request shall identify the location of such project, and be accompanied by technical information describing the proposed nature, size, design, and method of operation of each affected facility involved in such project, including information on any equipment to be used for measurement or control of emissions.
- (c) Neither a request for plans review nor advice furnished by the Administrator in response to such request shall (1) relieve an owner or operator of legal responsibility for compliance with any provision of this part or of any applicable State or local requirement, or (2) prevent the Administrator from implementing or enforcing any provision of this part or taking any other action authorized by the Act.

[36 FR 24877, Dec. 23, 1971, as amended at 39 FR 9314, Mar. 8, 1974]

§ 60.7 Notification and record keeping.

- (a) Any owner or operator subject to the provisions of this part shall furnish the Administrator written notification or, if acceptable to both the Administrator and the owner or operator of a source, electronic notification, as follows:

GENERAL PROVISIONS

(version dated 10/9/2008)

- (1) A notification of the date construction (or reconstruction as defined under §60.15) of an affected facility is commenced postmarked no later than 30 days after such date. This requirement shall not apply in the case of mass-produced facilities which are purchased in completed form.
 - (2) [Reserved]
 - (3) A notification of the actual date of initial startup of an affected facility postmarked within 15 days after such date.
 - (4) A notification of any physical or operational change to an existing facility which may increase the emission rate of any air pollutant to which a standard applies, unless that change is specifically exempted under an applicable subpart or in §60.14(e). This notice shall be postmarked 60 days or as soon as practicable before the change is commenced and shall include information describing the precise nature of the change, present and proposed emission control systems, productive capacity of the facility before and after the change, and the expected completion date of the change. The Administrator may request additional relevant information subsequent to this notice.
 - (5) A notification of the date upon which demonstration of the continuous monitoring system performance commences in accordance with §60.13(c). Notification shall be postmarked not less than 30 days prior to such date.
 - (6) A notification of the anticipated date for conducting the opacity observations required by §60.11(e)(1) of this part. The notification shall also include, if appropriate, a request for the Administrator to provide a visible emissions reader during a performance test. The notification shall be postmarked not less than 30 days prior to such date.
 - (7) A notification that continuous opacity monitoring system data results will be used to determine compliance with the applicable opacity standard during a performance test required by §60.8 in lieu of Method 9 observation data as allowed by §60.11(e)(5) of this part. This notification shall be postmarked not less than 30 days prior to the date of the performance test.
- (b) Any owner or operator subject to the provisions of this part shall maintain records of the occurrence and duration of any startup, shutdown, or malfunction in the operation of an affected facility; any malfunction of the air pollution control equipment; or any periods during which a continuous monitoring system or monitoring device is inoperative.
- (c) Each owner or operator required to install a continuous monitoring device shall submit excess emissions and monitoring systems performance report (excess emissions are defined in applicable subparts) and/or summary report form (see paragraph (d) of this section) to the Administrator semiannually, except when: more frequent reporting is specifically required by an applicable subpart; or the Administrator, on a case-by-case basis, determines that more frequent reporting is necessary to accurately assess the compliance status of the source. All reports shall be postmarked by the 30th day following the end of each six-month period. Written reports of excess emissions shall include the following information:
- (1) The magnitude of excess emissions computed in accordance with §60.13(h), any conversion factor(s) used, and the date and time of commencement and completion of each time period of excess emissions. The process operating time during the reporting period.
 - (2) Specific identification of each period of excess emissions that occurs during startups, shutdowns, and malfunctions of the affected facility. The nature and cause of any malfunction (if known), the corrective action taken or preventative measures adopted.
 - (3) The date and time identifying each period during which the continuous monitoring system was inoperative except for zero and span checks and the nature of the system repairs or adjustments.
 - (4) When no excess emissions have occurred or the continuous monitoring system(s) have not been inoperative, repaired, or adjusted, such information shall be stated in the report.
- (d) The summary report form shall contain the information and be in the format shown in figure 1 unless otherwise specified by the Administrator. One summary report form shall be submitted for each pollutant monitored at each affected facility.
- (1) If the total duration of excess emissions for the reporting period is less than 1 percent of the total operating time for the reporting period and CMS downtime for the reporting period is less than 5 percent of the total operating time for the reporting period, only the summary report form shall be submitted and the excess emission report described in §60.7(c) need not be submitted unless requested by the Administrator.

GENERAL PROVISIONS

(version dated 10/9/2008)

- (2) If the total duration of excess emissions for the reporting period is 1 percent or greater of the total operating time for the reporting period or the total CMS downtime for the reporting period is 5 percent or greater of the total operating time for the reporting period, the summary report form and the excess emission report described in §60.7(c) shall both be submitted.

APPENDIX 40 CFR 60 SUBPART A

GENERAL PROVISIONS

(version dated 10/9/2008)

Figure 1—Summary Report—Gaseous and Opacity Excess Emission and Monitoring System Performance

Pollutant (Circle One—SO₂/NO_x/TRS/H₂S/CO/Opacity)

Reporting period dates: From _____ to _____

Company: _____

Emission Limitation _____

Address: _____

Monitor Manufacturer and Model No. _____

Date of Latest CMS Certification or Audit _____

Process Unit(s) Description: _____

Total source operating time in reporting period¹ _____

Emission data summary ¹		CMS performance summary ¹	
1. Duration of excess emissions in reporting period due to:		1. CMS downtime in reporting period due to:	
a. Startup/shutdown		a. Monitor equipment malfunctions	
b. Control equipment problems		b. Non-Monitor equipment malfunctions	
c. Process problems		c. Quality assurance calibration	
d. Other known causes		d. Other known causes	
e. Unknown causes		e. Unknown causes	
2. Total duration of excess emission		2. Total CMS Downtime	
3. Total duration of excess emissions × (100) [Total source operating time]	% ²	3. [Total CMS Downtime] × (100) [Total source operating time]	% ²

¹For opacity, record all times in minutes. For gases, record all times in hours.

²For the reporting period: If the total duration of excess emissions is 1 percent or greater of the total operating time or the total CMS downtime is 5 percent or greater of the total operating time, both the summary report form and the excess emission report described in §60.7(c) shall be submitted.

On a separate page, describe any changes since last quarter in CMS, process or controls. I certify that the information contained in this report is true, accurate, and complete.

Name

Signature

Title

Date

GENERAL PROVISIONS

(version dated 10/9/2008)

(e)

- (1) Notwithstanding the frequency of reporting requirements specified in paragraph (c) of this section, an owner or operator who is required by an applicable subpart to submit excess emissions and monitoring systems performance reports (and summary reports) on a quarterly (or more frequent) basis may reduce the frequency of reporting for that standard to semiannual if the following conditions are met:
 - (i) For 1 full year (e.g., 4 quarterly or 12 monthly reporting periods) the affected facility's excess emissions and monitoring systems reports submitted to comply with a standard under this part continually demonstrate that the facility is in compliance with the applicable standard;
 - (ii) The owner or operator continues to comply with all recordkeeping and monitoring requirements specified in this subpart and the applicable standard; and
 - (iii) The Administrator does not object to a reduced frequency of reporting for the affected facility, as provided in paragraph (e)(2) of this section.
- (2) The frequency of reporting of excess emissions and monitoring systems performance (and summary) reports may be reduced only after the owner or operator notifies the Administrator in writing of his or her intention to make such a change and the Administrator does not object to the intended change. In deciding whether to approve a reduced frequency of reporting, the Administrator may review information concerning the source's entire previous performance history during the required recordkeeping period prior to the intended change, including performance test results, monitoring data, and evaluations of an owner or operator's conformance with operation and maintenance requirements. Such information may be used by the Administrator to make a judgment about the source's potential for noncompliance in the future. If the Administrator disapproves the owner or operator's request to reduce the frequency of reporting, the Administrator will notify the owner or operator in writing within 45 days after receiving notice of the owner or operator's intention. The notification from the Administrator to the owner or operator will specify the grounds on which the disapproval is based. In the absence of a notice of disapproval within 45 days, approval is automatically granted.
- (3) As soon as monitoring data indicate that the affected facility is not in compliance with any emission limitation or operating parameter specified in the applicable standard, the frequency of reporting shall revert to the frequency specified in the applicable standard, and the owner or operator shall submit an excess emissions and monitoring systems performance report (and summary report, if required) at the next appropriate reporting period following the noncomplying event. After demonstrating compliance with the applicable standard for another full year, the owner or operator may again request approval from the Administrator to reduce the frequency of reporting for that standard as provided for in paragraphs (e)(1) and (e)(2) of this section.

(f) Any owner or operator subject to the provisions of this part shall maintain a file of all measurements, including continuous monitoring system, monitoring device, and performance testing measurements; all continuous monitoring system performance evaluations; all continuous monitoring system or monitoring device calibration checks; adjustments and maintenance performed on these systems or devices; and all other information required by this part recorded in a permanent form suitable for inspection. The file shall be retained for at least two years following the date of such measurements, maintenance, reports, and records, except as follows:

- (1) This paragraph applies to owners or operators required to install a continuous emissions monitoring system (CEMS) where the CEMS installed is automated, and where the calculated data averages do not exclude periods of CEMS breakdown or malfunction. An automated CEMS records and reduces the measured data to the form of the pollutant emission standard through the use of a computerized data acquisition system. In lieu of maintaining a file of all CEMS subhourly measurements as required under paragraph (f) of this section, the owner or operator shall retain the most recent consecutive three averaging periods of subhourly measurements and a file that contains a hard copy of the data acquisition system algorithm used to reduce the measured data into the reportable form of the standard.
- (2) This paragraph applies to owners or operators required to install a CEMS where the measured data is manually reduced to obtain the reportable form of the standard, and where the calculated data averages do not exclude periods of CEMS breakdown or malfunction. In lieu of maintaining a file of all CEMS subhourly measurements as required under paragraph (f) of this section, the owner or operator shall retain all subhourly measurements for the most recent

GENERAL PROVISIONS

(version dated 10/9/2008)

reporting period. The subhourly measurements shall be retained for 120 days from the date of the most recent summary or excess emission report submitted to the Administrator.

- (3) The Administrator or delegated authority, upon notification to the source, may require the owner or operator to maintain all measurements as required by paragraph (f) of this section, if the Administrator or the delegated authority determines these records are required to more accurately assess the compliance status of the affected source.
- (g) If notification substantially similar to that in paragraph (a) of this section is required by any other State or local agency, sending the Administrator a copy of that notification will satisfy the requirements of paragraph (a) of this section.
- (h) Individual subparts of this part may include specific provisions which clarify or make inapplicable the provisions set forth in this section.

[36 FR 24877, Dec. 28, 1971, as amended at 40 FR 46254, Oct. 6, 1975; 40 FR 58418, Dec. 16, 1975; 45 FR 5617, Jan. 23, 1980; 48 FR 48335, Oct. 18, 1983; 50 FR 53113, Dec. 27, 1985; 52 FR 9781, Mar. 26, 1987; 55 FR 51382, Dec. 13, 1990; 59 FR 12428, Mar. 16, 1994; 59 FR 47265, Sep. 15, 1994; 64 FR 7463, Feb. 12, 1999]

§ 60.8 Performance tests.

- (a) Except as specified in paragraphs (a)(1), (a)(2), (a)(3), and (a)(4) of this section, within 60 days after achieving the maximum production rate at which the affected facility will be operated, but not later than 180 days after initial startup of such facility, or at such other times specified by this part, and at such other times as may be required by the Administrator under section 114 of the Act, the owner or operator of such facility shall conduct performance test(s) and furnish the Administrator a written report of the results of such performance test(s).
 - (1) If a force majeure is about to occur, occurs, or has occurred for which the affected owner or operator intends to assert a claim of force majeure, the owner or operator shall notify the Administrator, in writing as soon as practicable following the date the owner or operator first knew, or through due diligence should have known that the event may cause or caused a delay in testing beyond the regulatory deadline, but the notification must occur before the performance test deadline unless the initial force majeure or a subsequent force majeure event delays the notice, and in such cases, the notification shall occur as soon as practicable.
 - (2) The owner or operator shall provide to the Administrator a written description of the force majeure event and a rationale for attributing the delay in testing beyond the regulatory deadline to the force majeure; describe the measures taken or to be taken to minimize the delay; and identify a date by which the owner or operator proposes to conduct the performance test. The performance test shall be conducted as soon as practicable after the force majeure occurs.
 - (3) The decision as to whether or not to grant an extension to the performance test deadline is solely within the discretion of the Administrator. The Administrator will notify the owner or operator in writing of approval or disapproval of the request for an extension as soon as practicable.
 - (4) Until an extension of the performance test deadline has been approved by the Administrator under paragraphs (a)(1), (2), and (3) of this section, the owner or operator of the affected facility remains strictly subject to the requirements of this part.
- (b) Performance tests shall be conducted and data reduced in accordance with the test methods and procedures contained in each applicable subpart unless the Administrator (1) specifies or approves, in specific cases, the use of a reference method with minor changes in methodology, (2) approves the use of an equivalent method, (3) approves the use of an alternative method the results of which he has determined to be adequate for indicating whether a specific source is in compliance, (4) waives the requirement for performance tests because the owner or operator of a source has demonstrated by other means to the Administrator's satisfaction that the affected facility is in compliance with the standard, or (5) approves shorter sampling times and smaller sample volumes when necessitated by process variables or other factors. Nothing in this paragraph shall be construed to abrogate the Administrator's authority to require testing under section 114 of the Act.
- (c) Performance tests shall be conducted under such conditions as the Administrator shall specify to the plant operator based on representative performance of the affected facility. The owner or operator shall make available to the Administrator

GENERAL PROVISIONS

(version dated 10/9/2008)

such records as may be necessary to determine the conditions of the performance tests. Operations during periods of startup, shutdown, and malfunction shall not constitute representative conditions for the purpose of a performance test nor shall emissions in excess of the level of the applicable emission limit during periods of startup, shutdown, and malfunction be considered a violation of the applicable emission limit unless otherwise specified in the applicable standard.

- (d) The owner or operator of an affected facility shall provide the Administrator at least 30 days prior notice of any performance test, except as specified under other subparts, to afford the Administrator the opportunity to have an observer present. If after 30 days notice for an initially scheduled performance test, there is a delay (due to operational problems, etc.) in conducting the scheduled performance test, the owner or operator of an affected facility shall notify the Administrator (or delegated State or local agency) as soon as possible of any delay in the original test date, either by providing at least 7 days prior notice of the rescheduled date of the performance test, or by arranging a rescheduled date with the Administrator (or delegated State or local agency) by mutual agreement.
- (e) The owner or operator of an affected facility shall provide, or cause to be provided, performance testing facilities as follows:
 - (1) Sampling ports adequate for test methods applicable to such facility. This includes (i) constructing the air pollution control system such that volumetric flow rates and pollutant emission rates can be accurately determined by applicable test methods and procedures and (ii) providing a stack or duct free of cyclonic flow during performance tests, as demonstrated by applicable test methods and procedures.
 - (2) Safe sampling platform(s).
 - (3) Safe access to sampling platform(s).
 - (4) Utilities for sampling and testing equipment.
- (f) Unless otherwise specified in the applicable subpart, each performance test shall consist of three separate runs using the applicable test method. Each run shall be conducted for the time and under the conditions specified in the applicable standard. For the purpose of determining compliance with an applicable standard, the arithmetic means of results of the three runs shall apply. In the event that a sample is accidentally lost or conditions occur in which one of the three runs must be discontinued because of forced shutdown, failure of an irreplaceable portion of the sample train, extreme meteorological conditions, or other circumstances, beyond the owner or operator's control, compliance may, upon the Administrator's approval, be determined using the arithmetic mean of the results of the two other runs.

[36 FR 24877, Dec. 23, 1971, as amended at 39 FR 9314, Mar. 8, 1974; 42 FR 57126, Nov. 1, 1977; 44 FR 33612, June 11, 1979; 54 FR 6662, Feb. 14, 1989; 54 FR 21344, May 17, 1989; 64 FR 7463, Feb. 12, 1999; 72 FR 27442, May 16, 2007]

§ 60.9 Availability of information.

The availability to the public of information provided to, or otherwise obtained by, the Administrator under this part shall be governed by part 2 of this chapter. (Information submitted voluntarily to the Administrator for the purposes of §§60.5 and 60.6 is governed by §§2.201 through 2.213 of this chapter and not by §2.301 of this chapter.)

§ 60.10 State authority.

The provisions of this part shall not be construed in any manner to preclude any State or political subdivision thereof from:

- (a) Adopting and enforcing any emission standard or limitation applicable to an affected facility, provided that such emission standard or limitation is not less stringent than the standard applicable to such facility.
- (b) Requiring the owner or operator of an affected facility to obtain permits, licenses, or approvals prior to initiating construction, modification, or operation of such facility.

§ 60.11 Compliance with standards and maintenance requirements.

- (a) Compliance with standards in this part, other than opacity standards, shall be determined in accordance with performance tests established by §60.8, unless otherwise specified in the applicable standard.
- (b) Compliance with opacity standards in this part shall be determined by conducting observations in accordance with Method 9 in appendix A of this part, any alternative method that is approved by the Administrator, or as provided in

GENERAL PROVISIONS

(version dated 10/9/2008)

paragraph (e)(5) of this section. For purposes of determining initial compliance, the minimum total time of observations shall be 3 hours (30 6-minute averages) for the performance test or other set of observations (meaning those fugitive-type emission sources subject only to an opacity standard).

- (c) The opacity standards set forth in this part shall apply at all times except during periods of startup, shutdown, malfunction, and as otherwise provided in the applicable standard.
- (d) At all times, including periods of startup, shutdown, and malfunction, owners and operators shall, to the extent practicable, maintain and operate any affected facility including associated air pollution control equipment in a manner consistent with good air pollution control practice for minimizing emissions. Determination of whether acceptable operating and maintenance procedures are being used will be based on information available to the Administrator which may include, but is not limited to, monitoring results, opacity observations, review of operating and maintenance procedures, and inspection of the source.
- (e)
 - (1) For the purpose of demonstrating initial compliance, opacity observations shall be conducted concurrently with the initial performance test required in §60.8 unless one of the following conditions apply. If no performance test under §60.8 is required, then opacity observations shall be conducted within 60 days after achieving the maximum production rate at which the affected facility will be operated but no later than 180 days after initial startup of the facility. If visibility or other conditions prevent the opacity observations from being conducted concurrently with the initial performance test required under §60.8, the source owner or operator shall reschedule the opacity observations as soon after the initial performance test as possible, but not later than 30 days thereafter, and shall advise the Administrator of the rescheduled date. In these cases, the 30-day prior notification to the Administrator required in §60.7(a)(6) shall be waived. The rescheduled opacity observations shall be conducted (to the extent possible) under the same operating conditions that existed during the initial performance test conducted under §60.8. The visible emissions observer shall determine whether visibility or other conditions prevent the opacity observations from being made concurrently with the initial performance test in accordance with procedures contained in Method 9 of appendix B of this part. Opacity readings of portions of plumes which contain condensed, uncombined water vapor shall not be used for purposes of determining compliance with opacity standards. The owner or operator of an affected facility shall make available, upon request by the Administrator, such records as may be necessary to determine the conditions under which the visual observations were made and shall provide evidence indicating proof of current visible observer emission certification. Except as provided in paragraph (e)(5) of this section, the results of continuous monitoring by transmissometer which indicate that the opacity at the time visual observations were made was not in excess of the standard are probative but not conclusive evidence of the actual opacity of an emission, provided that the source shall meet the burden of proving that the instrument used meets (at the time of the alleged violation) Performance Specification 1 in appendix B of this part, has been properly maintained and (at the time of the alleged violation) that the resulting data have not been altered in any way.
 - (2) Except as provided in paragraph (e)(3) of this section, the owner or operator of an affected facility to which an opacity standard in this part applies shall conduct opacity observations in accordance with paragraph (b) of this section, shall record the opacity of emissions, and shall report to the Administrator the opacity results along with the results of the initial performance test required under §60.8. The inability of an owner or operator to secure a visible emissions observer shall not be considered a reason for not conducting the opacity observations concurrent with the initial performance test.
 - (3) The owner or operator of an affected facility to which an opacity standard in this part applies may request the Administrator to determine and to record the opacity of emissions from the affected facility during the initial performance test and at such times as may be required. The owner or operator of the affected facility shall report the opacity results. Any request to the Administrator to determine and to record the opacity of emissions from an affected facility shall be included in the notification required in §60.7(a)(6). If, for some reason, the Administrator cannot determine and record the opacity of emissions from the affected facility during the performance test, then the provisions of paragraph (e)(1) of this section shall apply.
 - (4) An owner or operator of an affected facility using a continuous opacity monitor (transmissometer) shall record the monitoring data produced during the initial performance test required by §60.8 and shall furnish the Administrator a written report of the monitoring results along with Method 9 and §60.8 performance test results.

APPENDIX 40 CFR 60 SUBPART A

GENERAL PROVISIONS

(version dated 10/9/2008)

- (5) An owner or operator of an affected facility subject to an opacity standard may submit, for compliance purposes, continuous opacity monitoring system (COMS) data results produced during any performance test required under §60.8 in lieu of Method 9 observation data. If an owner or operator elects to submit COMS data for compliance with the opacity standard, he shall notify the Administrator of that decision, in writing, at least 30 days before any performance test required under §60.8 is conducted. Once the owner or operator of an affected facility has notified the Administrator to that effect, the COMS data results will be used to determine opacity compliance during subsequent tests required under §60.8 until the owner or operator notifies the Administrator, in writing, to the contrary. For the purpose of determining compliance with the opacity standard during a performance test required under §60.8 using COMS data, the minimum total time of COMS data collection shall be averages of all 6-minute continuous periods within the duration of the mass emission performance test. Results of the COMS opacity determinations shall be submitted along with the results of the performance test required under §60.8. The owner or operator of an affected facility using a COMS for compliance purposes is responsible for demonstrating that the COMS meets the requirements specified in §60.13(c) of this part, that the COMS has been properly maintained and operated, and that the resulting data have not been altered in any way. If COMS data results are submitted for compliance with the opacity standard for a period of time during which Method 9 data indicates noncompliance, the Method 9 data will be used to determine compliance with the opacity standard.
- (6) Upon receipt from an owner or operator of the written reports of the results of the performance tests required by §60.8, the opacity observation results and observer certification required by §60.11(e)(1), and the COMS results, if applicable, the Administrator will make a finding concerning compliance with opacity and other applicable standards. If COMS data results are used to comply with an opacity standard, only those results are required to be submitted along with the performance test results required by §60.8. If the Administrator finds that an affected facility is in compliance with all applicable standards for which performance tests are conducted in accordance with §60.8 of this part but during the time such performance tests are being conducted fails to meet any applicable opacity standard, he shall notify the owner or operator and advise him that he may petition the Administrator within 10 days of receipt of notification to make appropriate adjustment to the opacity standard for the affected facility.
- (7) The Administrator will grant such a petition upon a demonstration by the owner or operator that the affected facility and associated air pollution control equipment was operated and maintained in a manner to minimize the opacity of emissions during the performance tests; that the performance tests were performed under the conditions established by the Administrator; and that the affected facility and associated air pollution control equipment were incapable of being adjusted or operated to meet the applicable opacity standard.
- (8) The Administrator will establish an opacity standard for the affected facility meeting the above requirements at a level at which the source will be able, as indicated by the performance and opacity tests, to meet the opacity standard at all times during which the source is meeting the mass or concentration emission standard. The Administrator will promulgate the new opacity standard in the Federal Register.
- (f) Special provisions set forth under an applicable subpart shall supersede any conflicting provisions in paragraphs (a) through (e) of this section.
- (g) For the purpose of submitting compliance certifications or establishing whether or not a person has violated or is in violation of any standard in this part, nothing in this part shall preclude the use, including the exclusive use, of any credible evidence or information, relevant to whether a source would have been in compliance with applicable requirements if the appropriate performance or compliance test or procedure had been performed.

[38 FR 28565, Oct. 15, 1973, as amended at 39 FR 39873, Nov. 12, 1974; 43 FR 8800, Mar. 3, 1978; 45 FR 23379, Apr. 4, 1980; 48 FR 48335, Oct. 18, 1983; 50 FR 53113, Dec. 27, 1985; 51 FR 1790, Jan. 15, 1986; 52 FR 9781, Mar. 26, 1987; 62 FR 8328, Feb. 24, 1997; 65 FR 61749, Oct. 17, 2000]

§ 60.12 Circumvention.

No owner or operator subject to the provisions of this part shall build, erect, install, or use any article, machine, equipment or process, the use of which conceals an emission which would otherwise constitute a violation of an applicable standard. Such concealment includes, but is not limited to, the use of gaseous diluents to achieve compliance with an opacity standard or with a standard which is based on the concentration of a pollutant in the gases discharged to the atmosphere.

[39 FR 9314, Mar. 8, 1974]

GENERAL PROVISIONS

(version dated 10/9/2008)

§ 60.13 Monitoring requirements.

- (a) For the purposes of this section, all continuous monitoring systems required under applicable subparts shall be subject to the provisions of this section upon promulgation of performance specifications for continuous monitoring systems under appendix B to this part and, if the continuous monitoring system is used to demonstrate compliance with emission limits on a continuous basis, appendix F to this part, unless otherwise specified in an applicable subpart or by the Administrator. Appendix F is applicable December 4, 1987.
- (b) All continuous monitoring systems and monitoring devices shall be installed and operational prior to conducting performance tests under §60.8. Verification of operational status shall, as a minimum, include completion of the manufacturer's written requirements or recommendations for installation, operation, and calibration of the device.
- (c) If the owner or operator of an affected facility elects to submit continuous opacity monitoring system (COMS) data for compliance with the opacity standard as provided under §60.11(e)(5), he shall conduct a performance evaluation of the COMS as specified in Performance Specification 1, appendix B, of this part before the performance test required under §60.8 is conducted. Otherwise, the owner or operator of an affected facility shall conduct a performance evaluation of the COMS or continuous emission monitoring system (CEMS) during any performance test required under §60.8 or within 30 days thereafter in accordance with the applicable performance specification in appendix B of this part. The owner or operator of an affected facility shall conduct COMS or CEMS performance evaluations at such other times as may be required by the Administrator under section 114 of the Act.
 - (1) The owner or operator of an affected facility using a COMS to determine opacity compliance during any performance test required under §60.8 and as described in §60.11(e)(5) shall furnish the Administrator two or, upon request, more copies of a written report of the results of the COMS performance evaluation described in paragraph (c) of this section at least 10 days before the performance test required under §60.8 is conducted.
 - (2) Except as provided in paragraph (c)(1) of this section, the owner or operator of an affected facility shall furnish the Administrator within 60 days of completion two or, upon request, more copies of a written report of the results of the performance evaluation.
- (d)
 - (1) Owners and operators of a CEMS installed in accordance with the provisions of this part, must check the zero (or low level value between 0 and 20 percent of span value) and span (50 to 100 percent of span value) calibration drifts at least once daily in accordance with a written procedure. The zero and span must, as a minimum, be adjusted whenever either the 24-hour zero drift or the 24-hour span drift exceeds two times the limit of the applicable performance specification in appendix B of this part. The system must allow the amount of the excess zero and span drift to be recorded and quantified whenever specified. Owners and operators of a COMS installed in accordance with the provisions of this part, must automatically, intrinsic to the opacity monitor, check the zero and upscale (span) calibration drifts at least once daily. For a particular COMS, the acceptable range of zero and upscale calibration materials is as defined in the applicable version of PS-1 in appendix B of this part. For a COMS, the optical surfaces, exposed to the effluent gases, must be cleaned before performing the zero and upscale drift adjustments, except for systems using automatic zero adjustments. The optical surfaces must be cleaned when the cumulative automatic zero compensation exceeds 4 percent opacity.
 - (2) Unless otherwise approved by the Administrator, the following procedures must be followed for a COMS. Minimum procedures must include an automated method for producing a simulated zero opacity condition and an upscale opacity condition using a certified neutral density filter or other related technique to produce a known obstruction of the light beam. Such procedures must provide a system check of all active analyzer internal optics with power or curvature, all active electronic circuitry including the light source and photodetector assembly, and electronic or electro-mechanical systems and hardware and or software used during normal measurement operation.
- (e) Except for system breakdowns, repairs, calibration checks, and zero and span adjustments required under paragraph (d) of this section, all continuous monitoring systems shall be in continuous operation and shall meet minimum frequency of operation requirements as follows:

GENERAL PROVISIONS

(version dated 10/9/2008)

- (1) All continuous monitoring systems referenced by paragraph (c) of this section for measuring opacity of emissions shall complete a minimum of one cycle of sampling and analyzing for each successive 10-second period and one cycle of data recording for each successive 6-minute period.
 - (2) All continuous monitoring systems referenced by paragraph (c) of this section for measuring emissions, except opacity, shall complete a minimum of one cycle of operation (sampling, analyzing, and data recording) for each successive 15-minute period.
- (f) All continuous monitoring systems or monitoring devices shall be installed such that representative measurements of emissions or process parameters from the affected facility are obtained. Additional procedures for location of continuous monitoring systems contained in the applicable Performance Specifications of appendix B of this part shall be used.
- (g) When the effluents from a single affected facility or two or more affected facilities subject to the same emission standards are combined before being released to the atmosphere, the owner or operator may install applicable continuous monitoring systems on each effluent or on the combined effluent. When the affected facilities are not subject to the same emission standards, separate continuous monitoring systems shall be installed on each effluent. When the effluent from one affected facility is released to the atmosphere through more than one point, the owner or operator shall install an applicable continuous monitoring system on each separate effluent unless the installation of fewer systems is approved by the Administrator. When more than one continuous monitoring system is used to measure the emissions from one affected facility (e.g., multiple breechings, multiple outlets), the owner or operator shall report the results as required from each continuous monitoring system.
- (h)
- (1) Owners or operators of all continuous monitoring systems for measurement of opacity shall reduce all data to 6-minute averages and for continuous monitoring systems other than opacity to 1-hour averages for time periods as defined in §60.2. Six-minute opacity averages shall be calculated from 36 or more data points equally spaced over each 6-minute period.
 - (2) For continuous monitoring systems other than opacity, 1-hour averages shall be computed as follows, except that the provisions pertaining to the validation of partial operating hours are only applicable for affected facilities that are required by the applicable subpart to include partial hours in the emission calculations:
 - (i) Except as provided under paragraph (h)(2)(iii) of this section, for a full operating hour (any clock hour with 60 minutes of unit operation), at least four valid data points are required to calculate the hourly average, *i.e.*, one data point in each of the 15-minute quadrants of the hour.
 - (ii) Except as provided under paragraph (h)(2)(iii) of this section, for a partial operating hour (any clock hour with less than 60 minutes of unit operation), at least one valid data point in each 15-minute quadrant of the hour in which the unit operates is required to calculate the hourly average.
 - (iii) For any operating hour in which required maintenance or quality-assurance activities are performed:
 - (A) If the unit operates in two or more quadrants of the hour, a minimum of two valid data points, separated by at least 15 minutes, is required to calculate the hourly average; or
 - (B) If the unit operates in only one quadrant of the hour, at least one valid data point is required to calculate the hourly average.
 - (iv) If a daily calibration error check is failed during any operating hour, all data for that hour shall be invalidated, unless a subsequent calibration error test is passed in the same hour and the requirements of paragraph (h)(2)(iii) of this section are met, based solely on valid data recorded after the successful calibration.
 - (v) For each full or partial operating hour, all valid data points shall be used to calculate the hourly average.
 - (vi) Except as provided under paragraph (h)(2)(vii) of this section, data recorded during periods of continuous monitoring system breakdown, repair, calibration checks, and zero and span adjustments shall not be included in the data averages computed under this paragraph.
 - (vii) Owners and operators complying with the requirements of §60.7(f)(1) or (2) must include any data recorded during periods of monitor breakdown or malfunction in the data averages.

GENERAL PROVISIONS

(version dated 10/9/2008)

- (viii) When specified in an applicable subpart, hourly averages for certain partial operating hours shall not be computed or included in the emission averages (*e.g.* hours with < 30 minutes of unit operation under §60.47b(d)).
- (ix) Either arithmetic or integrated averaging of all data may be used to calculate the hourly averages. The data may be recorded in reduced or nonreduced form (*e.g.* , ppm pollutant and percent O₂ or ng/J of pollutant).
- (3) All excess emissions shall be converted into units of the standard using the applicable conversion procedures specified in the applicable subpart. After conversion into units of the standard, the data may be rounded to the same number of significant digits used in the applicable subpart to specify the emission limit.
 - (i) After receipt and consideration of written application, the Administrator may approve alternatives to any monitoring procedures or requirements of this part including, but not limited to the following:
 - (1) Alternative monitoring requirements when installation of a continuous monitoring system or monitoring device specified by this part would not provide accurate measurements due to liquid water or other interferences caused by substances in the effluent gases.
 - (2) Alternative monitoring requirements when the affected facility is infrequently operated.
 - (3) Alternative monitoring requirements to accommodate continuous monitoring systems that require additional measurements to correct for stack moisture conditions.
 - (4) Alternative locations for installing continuous monitoring systems or monitoring devices when the owner or operator can demonstrate that installation at alternate locations will enable accurate and representative measurements.
 - (5) Alternative methods of converting pollutant concentration measurements to units of the standards.
 - (6) Alternative procedures for performing daily checks of zero and span drift that do not involve use of span gases or test cells.
 - (7) Alternatives to the A.S.T.M. test methods or sampling procedures specified by any subpart.
 - (8) Alternative continuous monitoring systems that do not meet the design or performance requirements in Performance Specification 1, appendix B, but adequately demonstrate a definite and consistent relationship between its measurements and the measurements of opacity by a system complying with the requirements in Performance Specification 1. The Administrator may require that such demonstration be performed for each affected facility.
 - (9) Alternative monitoring requirements when the effluent from a single affected facility or the combined effluent from two or more affected facilities is released to the atmosphere through more than one point.
- (j) An alternative to the relative accuracy (RA) test specified in Performance Specification 2 of appendix B may be requested as follows:
 - (1) An alternative to the reference method tests for determining RA is available for sources with emission rates demonstrated to be less than 50 percent of the applicable standard. A source owner or operator may petition the Administrator to waive the RA test in Section 8.4 of Performance Specification 2 and substitute the procedures in Section 16.0 if the results of a performance test conducted according to the requirements in §60.8 of this subpart or other tests performed following the criteria in §60.8 demonstrate that the emission rate of the pollutant of interest in the units of the applicable standard is less than 50 percent of the applicable standard. For sources subject to standards expressed as control efficiency levels, a source owner or operator may petition the Administrator to waive the RA test and substitute the procedures in Section 16.0 of Performance Specification 2 if the control device exhaust emission rate is less than 50 percent of the level needed to meet the control efficiency requirement. The alternative procedures do not apply if the continuous emission monitoring system is used to determine compliance continuously with the applicable standard. The petition to waive the RA test shall include a detailed description of the procedures to be applied. Included shall be location and procedure for conducting the alternative, the concentration or response levels of the alternative RA materials, and the other equipment checks included in the alternative procedure. The Administrator will review the petition for completeness and applicability. The determination to grant a waiver will depend on the intended use of the CEMS data (*e.g.*, data collection purposes

GENERAL PROVISIONS

(version dated 10/9/2008)

other than NSPS) and may require specifications more stringent than in Performance Specification 2 (e.g., the applicable emission limit is more stringent than NSPS).

- (2) The waiver of a CEMS RA test will be reviewed and may be rescinded at such time, following successful completion of the alternative RA procedure, that the CEMS data indicate that the source emissions are approaching the level. The criterion for reviewing the waiver is the collection of CEMS data showing that emissions have exceeded 70 percent of the applicable standard for seven, consecutive, averaging periods as specified by the applicable regulation(s). For sources subject to standards expressed as control efficiency levels, the criterion for reviewing the waiver is the collection of CEMS data showing that exhaust emissions have exceeded 70 percent of the level needed to meet the control efficiency requirement for seven, consecutive, averaging periods as specified by the applicable regulation(s) [e.g., §60.45(g) (2) and (3), §60.73(e), and §60.84(e)]. It is the responsibility of the source operator to maintain records and determine the level of emissions relative to the criterion on the waiver of RA testing. If this criterion is exceeded, the owner or operator must notify the Administrator within 10 days of such occurrence and include a description of the nature and cause of the increasing emissions. The Administrator will review the notification and may rescind the waiver and require the owner or operator to conduct a RA test of the CEMS as specified in Section 8.4 of Performance Specification 2.

[40 FR 46255, Oct. 6, 1975; 40 FR 59205, Dec. 22, 1975, as amended at 41 FR 35185, Aug. 20, 1976; 48 FR 13326, Mar. 30, 1983; 48 FR 23610, May 25, 1983; 48 FR 32986, July 20, 1983; 52 FR 9782, Mar. 26, 1987; 52 FR 17555, May 11, 1987; 52 FR 21007, June 4, 1987; 64 FR 7463, Feb. 12, 1999; 65 FR 48920, Aug. 10, 2000; 65 FR 61749, Oct. 17, 2000; 66 FR 44980, Aug. 27, 2001; 71 FR 31102, June 1, 2006; 72 FR 32714, June 13, 2007]

Editorial Note: At 65 FR 61749, Oct. 17, 2000, §60.13 was amended by revising the words “ng/J of pollutant” to read “ng of pollutant per J of heat input” in the sixth sentence of paragraph (h). However, the amendment could not be incorporated because the words “ng/J of pollutant” do not exist in the sixth sentence of paragraph (h).

§ 60.14 Modification.

- (a) Except as provided under paragraphs (e) and (f) of this section, any physical or operational change to an existing facility which results in an increase in the emission rate to the atmosphere of any pollutant to which a standard applies shall be considered a modification within the meaning of section 111 of the Act. Upon modification, an existing facility shall become an affected facility for each pollutant to which a standard applies and for which there is an increase in the emission rate to the atmosphere.
- (b) Emission rate shall be expressed as kg/hr of any pollutant discharged into the atmosphere for which a standard is applicable. The Administrator shall use the following to determine emission rate:
- (1) Emission factors as specified in the latest issue of “Compilation of Air Pollutant Emission Factors,” EPA Publication No. AP-42, or other emission factors determined by the Administrator to be superior to AP-42 emission factors, in cases where utilization of emission factors demonstrates that the emission level resulting from the physical or operational change will either clearly increase or clearly not increase.
 - (2) Material balances, continuous monitor data, or manual emission tests in cases where utilization of emission factors as referenced in paragraph (b)(1) of this section does not demonstrate to the Administrator's satisfaction whether the emission level resulting from the physical or operational change will either clearly increase or clearly not increase, or where an owner or operator demonstrates to the Administrator's satisfaction that there are reasonable grounds to dispute the result obtained by the Administrator utilizing emission factors as referenced in paragraph (b)(1) of this section. When the emission rate is based on results from manual emission tests or continuous monitoring systems, the procedures specified in appendix C of this part shall be used to determine whether an increase in emission rate has occurred. Tests shall be conducted under such conditions as the Administrator shall specify to the owner or operator based on representative performance of the facility. At least three valid test runs must be conducted before and at least three after the physical or operational change. All operating parameters which may affect emissions must be held constant to the maximum feasible degree for all test runs.
- (c) The addition of an affected facility to a stationary source as an expansion to that source or as a replacement for an existing facility shall not by itself bring within the applicability of this part any other facility within that source.
- (d) [Reserved]

GENERAL PROVISIONS

(version dated 10/9/2008)

- (e) The following shall not, by themselves, be considered modifications under this part:
- (1) Maintenance, repair, and replacement which the Administrator determines to be routine for a source category, subject to the provisions of paragraph (c) of this section and §60.15.
 - (2) An increase in production rate of an existing facility, if that increase can be accomplished without a capital expenditure on that facility.
 - (3) An increase in the hours of operation.
 - (4) Use of an alternative fuel or raw material if, prior to the date any standard under this part becomes applicable to that source type, as provided by §60.1, the existing facility was designed to accommodate that alternative use. A facility shall be considered to be designed to accommodate an alternative fuel or raw material if that use could be accomplished under the facility's construction specifications as amended prior to the change. Conversion to coal required for energy considerations, as specified in section 111(a)(8) of the Act, shall not be considered a modification.
 - (5) The addition or use of any system or device whose primary function is the reduction of air pollutants, except when an emission control system is removed or is replaced by a system which the Administrator determines to be less environmentally beneficial.
 - (6) The relocation or change in ownership of an existing facility.
- (f) Special provisions set forth under an applicable subpart of this part shall supersede any conflicting provisions of this section.
- (g) Within 180 days of the completion of any physical or operational change subject to the control measures specified in paragraph (a) of this section, compliance with all applicable standards must be achieved.
- (h) No physical change, or change in the method of operation, at an existing electric utility steam generating unit shall be treated as a modification for the purposes of this section provided that such change does not increase the maximum hourly emissions of any pollutant regulated under this section above the maximum hourly emissions achievable at that unit during the 5 years prior to the change.
- (i) Repowering projects that are awarded funding from the Department of Energy as permanent clean coal technology demonstration projects (or similar projects funded by EPA) are exempt from the requirements of this section provided that such change does not increase the maximum hourly emissions of any pollutant regulated under this section above the maximum hourly emissions achievable at that unit during the five years prior to the change.
- (j)
- (1) Repowering projects that qualify for an extension under section 409(b) of the Clean Air Act are exempt from the requirements of this section, provided that such change does not increase the actual hourly emissions of any pollutant regulated under this section above the actual hourly emissions achievable at that unit during the 5 years prior to the change.
 - (2) This exemption shall not apply to any new unit that:
 - (i) Is designated as a replacement for an existing unit;
 - (ii) Qualifies under section 409(b) of the Clean Air Act for an extension of an emission limitation compliance date under section 405 of the Clean Air Act; and
 - (iii) Is located at a different site than the existing unit.
- (k) The installation, operation, cessation, or removal of a temporary clean coal technology demonstration project is exempt from the requirements of this section. A *temporary clean coal control technology demonstration project*, for the purposes of this section is a clean coal technology demonstration project that is operated for a period of 5 years or less, and which complies with the State implementation plan for the State in which the project is located and other requirements necessary to attain and maintain the national ambient air quality standards during the project and after it is terminated.

GENERAL PROVISIONS

(version dated 10/9/2008)

- (l) The reactivation of a very clean coal-fired electric utility steam generating unit is exempt from the requirements of this section.

[40 FR 58419, Dec. 16, 1975, as amended at 43 FR 34347, Aug. 3, 1978; 45 FR 5617, Jan. 23, 1980; 57 FR 32339, July 21, 1992; 65 FR 61750, Oct. 17, 2000]

§ 60.15 Reconstruction.

- (a) An existing facility, upon reconstruction, becomes an affected facility, irrespective of any change in emission rate.
- (b) "Reconstruction" means the replacement of components of an existing facility to such an extent that:
- (1) The fixed capital cost of the new components exceeds 50 percent of the fixed capital cost that would be required to construct a comparable entirely new facility, and
 - (2) It is technologically and economically feasible to meet the applicable standards set forth in this part.
- (c) "Fixed capital cost" means the capital needed to provide all the depreciable components.
- (d) If an owner or operator of an existing facility proposes to replace components, and the fixed capital cost of the new components exceeds 50 percent of the fixed capital cost that would be required to construct a comparable entirely new facility, he shall notify the Administrator of the proposed replacements. The notice must be postmarked 60 days (or as soon as practicable) before construction of the replacements is commenced and must include the following information:
- (1) Name and address of the owner or operator.
 - (2) The location of the existing facility.
 - (3) A brief description of the existing facility and the components which are to be replaced.
 - (4) A description of the existing air pollution control equipment and the proposed air pollution control equipment.
 - (5) An estimate of the fixed capital cost of the replacements and of constructing a comparable entirely new facility.
 - (6) The estimated life of the existing facility after the replacements.
 - (7) A discussion of any economic or technical limitations the facility may have in complying with the applicable standards of performance after the proposed replacements.
- (e) The Administrator will determine, within 30 days of the receipt of the notice required by paragraph (d) of this section and any additional information he may reasonably require, whether the proposed replacement constitutes reconstruction.
- (f) The Administrator's determination under paragraph (e) shall be based on:
- (1) The fixed capital cost of the replacements in comparison to the fixed capital cost that would be required to construct a comparable entirely new facility;
 - (2) The estimated life of the facility after the replacements compared to the life of a comparable entirely new facility;
 - (3) The extent to which the components being replaced cause or contribute to the emissions from the facility; and
 - (4) Any economic or technical limitations on compliance with applicable standards of performance which are inherent in the proposed replacements.
- (g) Individual subparts of this part may include specific provisions which refine and delimit the concept of reconstruction set forth in this section.

[40 FR 58420, Dec. 16, 1975]

§ 60.16 Priority list.

A list of prioritized major source categories may be found at the following EPA web site:

<http://ecfr.gpoaccess.gov/cgi/t/text/text-idx?c=ecfr&rgn=div6&view=text&node=40:6.0.1.1.1.1&idno=40>

§ 60.17 Incorporations by reference.

GENERAL PROVISIONS

(version dated 10/9/2008)

The materials listed below are incorporated by reference in the corresponding sections noted. These incorporations by reference were approved by the Director of the Federal Register on the date listed. These materials are incorporated as they exist on the date of the approval, and a notice of any change in these materials will be published in the Federal Register. The materials are available for purchase at the corresponding address noted below, and all are available for inspection at the Library (C267-01), U.S. EPA, Research Triangle Park, NC or at the National Archives and Records Administration (NARA). For information on the availability of this material at NARA, call 202-741-6030, or go to: http://www.archives.gov/federal_register/code_of_federal_regulations/ibr_locations.html.

- (a) The following materials are available for purchase from at least one of the following addresses: American Society for Testing and Materials (ASTM), 100 Barr Harbor Drive, Post Office Box C700, West Conshohocken, PA 19428-2959; or ProQuest, 300 North Zeeb Road, Ann Arbor, MI 48106.
- (1) ASTM A99-76, 82 (Reapproved 1987), Standard Specification for Ferromanganese, incorporation by reference (IBR) approved for §60.261.
 - (2) ASTM A100-69, 74, 93, Standard Specification for Ferrosilicon, IBR approved for §60.261.
 - (3) ASTM A101-73, 93, Standard Specification for Ferrochromium, IBR approved for §60.261.
 - (4) ASTM A482-76, 93, Standard Specification for Ferrochromesilicon, IBR approved for §60.261.
 - (5) ASTM A483-64, 74 (Reapproved 1988), Standard Specification for Silicomanganese, IBR approved for §60.261.
 - (6) ASTM A495-76, 94, Standard Specification for Calcium-Silicon and Calcium Manganese-Silicon, IBR approved for §60.261.
 - (7) ASTM D86-78, 82, 90, 93, 95, 96, Distillation of Petroleum Products, IBR approved for §§60.562-2(d), 60.593(d), 60.593a(d), and 60.633(h).
 - (8) ASTM D129-64, 78, 95, 00, Standard Test Method for Sulfur in Petroleum Products (General Bomb Method), IBR approved for §§60.106(j)(2), 60.335(b)(10)(i), and Appendix A: Method 19, 12.5.2.2.3.
 - (9) ASTM D129-00 (Reapproved 2005), Standard Test Method for Sulfur in Petroleum Products (General Bomb Method), IBR approved for §60.4415(a)(1)(i).
 - (10) ASTM D240-76, 92, Standard Test Method for Heat of Combustion of Liquid Hydrocarbon Fuels by Bomb Calorimeter, IBR approved for §§60.46(c), 60.296(b), and Appendix A: Method 19, Section 12.5.2.2.3.
 - (11) ASTM D270-65, 75, Standard Method of Sampling Petroleum and Petroleum Products, IBR approved for Appendix A: Method 19, Section 12.5.2.2.1.
 - (12) ASTM D323-82, 94, Test Method for Vapor Pressure of Petroleum Products (Reid Method), IBR approved for §§60.111(l), 60.111a(g), 60.111b(g), and 60.116b(f)(2)(ii).
 - (13) ASTM D388-77, 90, 91, 95, 98a, 99 (Reapproved 2004)^{e1}, Standard Specification for Classification of Coals by Rank, IBR approved for §§60.24(h)(8), 60.41 of subpart D of this part, 60.45(f)(4)(i), 60.45(f)(4)(ii), 60.45(f)(4)(vi), 60.41Da of subpart Da of this part, 60.41b of subpart Db of this part, 60.41c of subpart Dc of this part, and 60.4102.
 - (14) ASTM D388-77, 90, 91, 95, 98a, Standard Specification for Classification of Coals by Rank, IBR approved for §§60.251(b) and (c) of subpart Y of this part.
 - (15) ASTM D396-78, 89, 90, 92, 96, 98, Standard Specification for Fuel Oils, IBR approved for §§60.41b of subpart Db of this part, 60.41c of subpart Dc of this part, 60.111(b) of subpart K of this part, and 60.111a(b) of subpart Ka of this part.
 - (16) ASTM D975-78, 96, 98a, Standard Specification for Diesel Fuel Oils, IBR approved for §§60.111(b) of subpart K of this part and 60.111a(b) of subpart Ka of this part.
 - (17) ASTM D1072-80, 90 (Reapproved 1994), Standard Test Method for Total Sulfur in Fuel Gases, IBR approved for §60.335(b)(10)(ii).

APPENDIX 40 CFR 60 SUBPART A

GENERAL PROVISIONS

(version dated 10/9/2008)

- (18) ASTM D1072–90 (Reapproved 1999), Standard Test Method for Total Sulfur in Fuel Gases, IBR approved for §60.4415(a)(1)(ii).
- (19) ASTM D1137–53, 75, Standard Method for Analysis of Natural Gases and Related Types of Gaseous Mixtures by the Mass Spectrometer, IBR approved for §60.45(f)(5)(i).
- (20) ASTM D1193–77, 91, Standard Specification for Reagent Water, IBR approved for Appendix A: Method 5, Section 7.1.3; Method 5E, Section 7.2.1; Method 5F, Section 7.2.1; Method 6, Section 7.1.1; Method 7, Section 7.1.1; Method 7C, Section 7.1.1; Method 7D, Section 7.1.1; Method 10A, Section 7.1.1; Method 11, Section 7.1.3; Method 12, Section 7.1.3; Method 13A, Section 7.1.2; Method 26, Section 7.1.2; Method 26A, Section 7.1.2; and Method 29, Section 7.2.2.
- (21) ASTM D1266–87, 91, 98, Standard Test Method for Sulfur in Petroleum Products (Lamp Method), IBR approved for §§60.106(j)(2) and 60.335(b)(10)(i).
- (22) ASTM D1266–98 (Reapproved 2003)e1, Standard Test Method for Sulfur in Petroleum Products (Lamp Method), IBR approved for §60.4415(a)(1)(i).
- (23) ASTM D1475–60 (Reapproved 1980), 90, Standard Test Method for Density of Paint, Varnish Lacquer, and Related Products, IBR approved for §60.435(d)(1), Appendix A: Method 24, Section 6.1; and Method 24A, Sections 6.5 and 7.1.
- (24) ASTM D1552–83, 95, 01, Standard Test Method for Sulfur in Petroleum Products (High-Temperature Method), IBR approved for §§60.106(j)(2), 60.335(b)(10)(i), and Appendix A: Method 19, Section 12.5.2.2.3.
- (25) ASTM D1552–03, Standard Test Method for Sulfur in Petroleum Products (High-Temperature Method), IBR approved for §60.4415(a)(1)(i).
- (26) ASTM D1826–77, 94, Standard Test Method for Calorific Value of Gases in Natural Gas Range by Continuous Recording Calorimeter, IBR approved for §§60.45(f)(5)(ii), 60.46(c)(2), 60.296(b)(3), and Appendix A: Method 19, Section 12.3.2.4.
- (27) ASTM D1835–87, 91, 97, 03a, Standard Specification for Liquefied Petroleum (LP) Gases, IBR approved for §60.41Da of subpart Da of this part, 60.41b of subpart Db of this part, and 60.41c of subpart Dc of this part.
- (28) ASTM D1945–64, 76, 91, 96, Standard Method for Analysis of Natural Gas by Gas Chromatography, IBR approved for §60.45(f)(5)(i).
- (29) ASTM D1946–77, 90 (Reapproved 1994), Standard Method for Analysis of Reformed Gas by Gas Chromatography, IBR approved for §§60.18(f)(3), 60.45(f)(5)(i), 60.564(f)(1), 60.614(e)(2)(ii), 60.614(e)(4), 60.664(e)(2)(ii), 60.664(e)(4), 60.704(d)(2)(ii), and 60.704(d)(4).
- (30) ASTM D2013–72, 86, Standard Method of Preparing Coal Samples for Analysis, IBR approved for Appendix A: Method 19, Section 12.5.2.1.3.
- (31) ASTM D2015–77 (Reapproved 1978), 96, Standard Test Method for Gross Calorific Value of Solid Fuel by the Adiabatic Bomb Calorimeter, IBR approved for §60.45(f)(5)(ii), 60.46(c)(2), and Appendix A: Method 19, Section 12.5.2.1.3.
- (32) ASTM D2016–74, 83, Standard Test Methods for Moisture Content of Wood, IBR approved for Appendix A: Method 28, Section 16.1.1.
- (33) ASTM D2234–76, 96, 97b, 98, Standard Methods for Collection of a Gross Sample of Coal, IBR approved for Appendix A: Method 19, Section 12.5.2.1.1.
- (34) ASTM D2369–81, 87, 90, 92, 93, 95, Standard Test Method for Volatile Content of Coatings, IBR approved for Appendix A: Method 24, Section 6.2.
- (35) ASTM D2382–76, 88, Heat of Combustion of Hydrocarbon Fuels by Bomb Calorimeter (High-Precision Method), IBR approved for §§60.18(f)(3), 60.485(g)(6), 60.485a(g)(6), 60.564(f)(3), 60.614(e)(4), 60.664(e)(4), and 60.704(d)(4).

APPENDIX 40 CFR 60 SUBPART A**GENERAL PROVISIONS**

(version dated 10/9/2008)

- (36) ASTM D2504–67, 77, 88 (Reapproved 1993), Noncondensable Gases in C3 and Lighter Hydrocarbon Products by Gas Chromatography, IBR approved for §§60.485(g)(5) and 60.485a(g)(5).
- (37) ASTM D2584–68 (Reapproved 1985), 94, Standard Test Method for Ignition Loss of Cured Reinforced Resins, IBR approved for §60.685(c)(3)(i).
- (38) ASTM D2597–94 (Reapproved 1999), Standard Test Method for Analysis of Demethanized Hydrocarbon Liquid Mixtures Containing Nitrogen and Carbon Dioxide by Gas Chromatography, IBR approved for §60.335(b)(9)(i).
- (39) ASTM D2622–87, 94, 98, Standard Test Method for Sulfur in Petroleum Products by Wavelength Dispersive X-Ray Fluorescence Spectrometry, IBR approved for §§60.106(j)(2) and 60.335(b)(10)(i).
- (40) ASTM D2622–05, Standard Test Method for Sulfur in Petroleum Products by Wavelength Dispersive X-Ray Fluorescence Spectrometry, IBR approved for §60.4415(a)(1)(i).
- (41) ASTM D2879–83, 96, 97, Test Method for Vapor Pressure-Temperature Relationship and Initial Decomposition Temperature of Liquids by Isoteniscope, IBR approved for §§60.111b(f)(3), 60.116b(e)(3)(ii), 60.116b(f)(2)(i), 60.485(e)(1), and 60.485a(e)(1).
- (42) ASTM D2880–78, 96, Standard Specification for Gas Turbine Fuel Oils, IBR approved for §§60.111(b), 60.111a(b), and 60.335(d).
- (43) ASTM D2908–74, 91, Standard Practice for Measuring Volatile Organic Matter in Water by Aqueous-Injection Gas Chromatography, IBR approved for §60.564(j).
- (44) ASTM D2986–71, 78, 95a, Standard Method for Evaluation of Air, Assay Media by the Monodisperse DOP (Diocetyl Phthalate) Smoke Test, IBR approved for Appendix A: Method 5, Section 7.1.1; Method 12, Section 7.1.1; and Method 13A, Section 7.1.1.2.
- (45) ASTM D3173–73, 87, Standard Test Method for Moisture in the Analysis Sample of Coal and Coke, IBR approved for Appendix A: Method 19, Section 12.5.2.1.3.
- (46) ASTM D3176–74, 89, Standard Method for Ultimate Analysis of Coal and Coke, IBR approved for §60.45(f)(5)(i) and Appendix A: Method 19, Section 12.3.2.3.
- (47) ASTM D3177–75, 89, Standard Test Method for Total Sulfur in the Analysis Sample of Coal and Coke, IBR approved for Appendix A: Method 19, Section 12.5.2.1.3.
- (48) ASTM D3178–73 (Reapproved 1979), 89, Standard Test Methods for Carbon and Hydrogen in the Analysis Sample of Coal and Coke, IBR approved for §60.45(f)(5)(i).
- (49) ASTM D3246–81, 92, 96, Standard Test Method for Sulfur in Petroleum Gas by Oxidative Microcoulometry, IBR approved for §60.335(b)(10)(ii).
- (50) ASTM D3246–05, Standard Test Method for Sulfur in Petroleum Gas by Oxidative Microcoulometry, IBR approved for §60.4415(a)(1)(ii).
- (51) ASTM D3270–73T, 80, 91, 95, Standard Test Methods for Analysis for Fluoride Content of the Atmosphere and Plant Tissues (Semiautomated Method), IBR approved for Appendix A: Method 13A, Section 16.1.
- (52) ASTM D3286–85, 96, Standard Test Method for Gross Calorific Value of Coal and Coke by the Isoperibol Bomb Calorimeter, IBR approved for Appendix A: Method 19, Section 12.5.2.1.3.
- (53) ASTM D3370–76, 95a, Standard Practices for Sampling Water, IBR approved for §60.564(j).
- (54) ASTM D3792–79, 91, Standard Test Method for Water Content of Water-Reducible Paints by Direct Injection into a Gas Chromatograph, IBR approved for Appendix A: Method 24, Section 6.3.
- (55) ASTM D4017–81, 90, 96a, Standard Test Method for Water in Paints and Paint Materials by the Karl Fischer Titration Method, IBR approved for Appendix A: Method 24, Section 6.4.
- (56) ASTM D4057–81, 95, Standard Practice for Manual Sampling of Petroleum and Petroleum Products, IBR approved for Appendix A: Method 19, Section 12.5.2.2.3.

APPENDIX 40 CFR 60 SUBPART A

GENERAL PROVISIONS

(version dated 10/9/2008)

- (57) ASTM D4057–95 (Reapproved 2000), Standard Practice for Manual Sampling of Petroleum and Petroleum Products, IBR approved for §60.4415(a)(1).
- (58) ASTM D4084–82, 94, Standard Test Method for Analysis of Hydrogen Sulfide in Gaseous Fuels (Lead Acetate Reaction Rate Method), IBR approved for §60.334(h)(1).
- (59) ASTM D4084–05, Standard Test Method for Analysis of Hydrogen Sulfide in Gaseous Fuels (Lead Acetate Reaction Rate Method), IBR approved for §§60.4360 and 60.4415(a)(1)(ii).
- (60) ASTM D4177–95, Standard Practice for Automatic Sampling of Petroleum and Petroleum Products, IBR approved for Appendix A: Method 19, Section 12.5.2.2.1.
- (61) ASTM D4177–95 (Reapproved 2000), Standard Practice for Automatic Sampling of Petroleum and Petroleum Products, IBR approved for §60.4415(a)(1).
- (62) ASTM D4239–85, 94, 97, Standard Test Methods for Sulfur in the Analysis Sample of Coal and Coke Using High Temperature Tube Furnace Combustion Methods, IBR approved for Appendix A: Method 19, Section 12.5.2.1.3.
- (63) ASTM D4294–02, Standard Test Method for Sulfur in Petroleum and Petroleum Products by Energy-Dispersive X-Ray Fluorescence Spectrometry, IBR approved for §60.335(b)(10)(i).
- (64) ASTM D4294–03, Standard Test Method for Sulfur in Petroleum and Petroleum Products by Energy-Dispersive X-Ray Fluorescence Spectrometry, IBR approved for §60.4415(a)(1)(i).
- (65) ASTM D4442–84, 92, Standard Test Methods for Direct Moisture Content Measurement in Wood and Wood-base Materials, IBR approved for Appendix A: Method 28, Section 16.1.1.
- (66) ASTM D4444–92, Standard Test Methods for Use and Calibration of Hand-Held Moisture Meters, IBR approved for Appendix A: Method 28, Section 16.1.1.
- (67) ASTM D4457–85 (Reapproved 1991), Test Method for Determination of Dichloromethane and 1, 1, 1-Trichloroethane in Paints and Coatings by Direct Injection into a Gas Chromatograph, IBR approved for Appendix A: Method 24, Section 6.5.
- (68) ASTM D4468–85 (Reapproved 2000), Standard Test Method for Total Sulfur in Gaseous Fuels by Hydrogenolysis and Rateometric Colorimetry, IBR approved for §§60.335(b)(10)(ii) and 60.4415(a)(1)(ii).
- (69) ASTM D4629–02, Standard Test Method for Trace Nitrogen in Liquid Petroleum Hydrocarbons by Syringe/Inlet Oxidative Combustion and Chemiluminescence Detection, IBR approved for §§60.49b(e) and 60.335(b)(9)(i).
- (70) ASTM D4809–95, Standard Test Method for Heat of Combustion of Liquid Hydrocarbon Fuels by Bomb Calorimeter (Precision Method), IBR approved for §§60.18(f)(3), 60.485(g)(6), 60.485a(g)(6), 60.564(f)(3), 60.614(d)(4), 60.664(e)(4), and 60.704(d)(4).
- (71) ASTM D4810–88 (Reapproved 1999), Standard Test Method for Hydrogen Sulfide in Natural Gas Using Length of Stain Detector Tubes, IBR approved for §§60.4360 and 60.4415(a)(1)(ii).
- (72) ASTM D5287–97 (Reapproved 2002), Standard Practice for Automatic Sampling of Gaseous Fuels, IBR approved for §60.4415(a)(1).
- (73) ASTM D5403–93, Standard Test Methods for Volatile Content of Radiation Curable Materials, IBR approved for Appendix A: Method 24, Section 6.6.
- (74) ASTM D5453–00, Standard Test Method for Determination of Total Sulfur in Light Hydrocarbons, Motor Fuels and Oils by Ultraviolet Fluorescence, IBR approved for §60.335(b)(10)(i).
- (75) ASTM D5453–05, Standard Test Method for Determination of Total Sulfur in Light Hydrocarbons, Motor Fuels and Oils by Ultraviolet Fluorescence, IBR approved for §60.4415(a)(1)(i).
- (76) ASTM D5504–01, Standard Test Method for Determination of Sulfur Compounds in Natural Gas and Gaseous Fuels by Gas Chromatography and Chemiluminescence, IBR approved for §§60.334(h)(1) and 60.4360.

APPENDIX 40 CFR 60 SUBPART A

GENERAL PROVISIONS

(version dated 10/9/2008)

- (77) ASTM D5762–02, Standard Test Method for Nitrogen in Petroleum and Petroleum Products by Boat-Inlet Chemiluminescence, IBR approved for §60.335(b)(9)(i).
- (78) ASTM D5865–98, Standard Test Method for Gross Calorific Value of Coal and Coke, IBR approved for §60.45(f)(5)(ii), 60.46(c)(2), and Appendix A: Method 19, Section 12.5.2.1.3.
- (79) ASTM D6216–98, Standard Practice for Opacity Monitor Manufacturers to Certify Conformance with Design and Performance Specifications, IBR approved for Appendix B, Performance Specification 1.
- (80) ASTM D6228–98, Standard Test Method for Determination of Sulfur Compounds in Natural Gas and Gaseous Fuels by Gas Chromatography and Flame Photometric Detection, IBR approved for §60.334(h)(1).
- (81) ASTM D6228–98 (Reapproved 2003), Standard Test Method for Determination of Sulfur Compounds in Natural Gas and Gaseous Fuels by Gas Chromatography and Flame Photometric Detection, IBR approved for §§60.4360 and 60.4415.
- (82) ASTM D6348–03, Standard Test Method for Determination of Gaseous Compounds by Extractive Direct Interface Fourier Transform Infrared (FTIR) Spectroscopy, IBR approved for table 7 of Subpart IIII of this part and table 2 of subpart JJJJ of this part.
- (83) ASTM D6366–99, Standard Test Method for Total Trace Nitrogen and Its Derivatives in Liquid Aromatic Hydrocarbons by Oxidative Combustion and Electrochemical Detection, IBR approved for §60.335(b)(9)(i).
- (84) ASTM D6420–99 (Reapproved 2004) Standard Test Method for Determination of Gaseous Organic Compounds by Direct Interface Gas Chromatography-Mass Spectrometry, IBR approved for table 2 of subpart JJJJ of this part.
- (85) ASTM D6522–00, Standard Test Method for Determination of Nitrogen Oxides, Carbon Monoxide, and Oxygen Concentrations in Emissions from Natural Gas-Fired Reciprocating Engines, Combustion Turbines, Boilers, and Process Heaters Using Portable Analyzers, IBR approved for §60.335(a).
- (86) ASTM D6522–00 (Reapproved 2005), Standard Test Method for Determination of Nitrogen Oxides, Carbon Monoxide, and Oxygen Concentrations in Emissions from Natural Gas-Fired Reciprocating Engines, Combustion Turbines, Boilers, and Process Heaters Using Portable Analyzers, IBR approved for table 2 of subpart JJJJ of this part.
- (87) ASTM D6667–01, Standard Test Method for Determination of Total Volatile Sulfur in Gaseous Hydrocarbons and Liquefied Petroleum Gases by Ultraviolet Fluorescence, IBR approved for §60.335(b)(10)(ii).
- (88) ASTM D6667–04, Standard Test Method for Determination of Total Volatile Sulfur in Gaseous Hydrocarbons and Liquefied Petroleum Gases by Ultraviolet Fluorescence, IBR approved for §60.4415(a)(1)(ii).
- (89) ASTM D6784–02, Standard Test Method for Elemental, Oxidized, Particle-Bound and Total Mercury in Flue Gas Generated from Coal-Fired Stationary Sources (Ontario Hydro Method), IBR approved for Appendix B to part 60, Performance Specification 12A, Section 8.6.2.
- (90) ASTM E168–67, 77, 92, General Techniques of Infrared Quantitative Analysis, IBR approved for §§60.485a(d)(1), 60.593(b)(2), 60.593a(b)(2), and 60.632(f).
- (91) ASTM E169–63, 77, 93, General Techniques of Ultraviolet Quantitative Analysis, IBR approved for §§60.485a(d)(1), 60.593(b)(2), 60.593a(b)(2), and 60.632(f).
- (92) ASTM E260–73, 91, 96, General Gas Chromatography Procedures, IBR approved for §§60.485a(d)(1), 60.593(b)(2), 60.593a(b)(2), and 60.632(f).
- (b) The following material is available for purchase from the Association of Official Analytical Chemists, 1111 North 19th Street, Suite 210, Arlington, VA 22209.
 - (1) AOAC Method 9, Official Methods of Analysis of the Association of Official Analytical Chemists, 11th edition, 1970, pp. 11–12, IBR approved January 27, 1983 for §§60.204(b)(3), 60.214(b)(3), 60.224(b)(3), 60.234(b)(3).
- (c) The following material is available for purchase from the American Petroleum Institute, 1220 L Street NW., Washington, DC 20005.

APPENDIX 40 CFR 60 SUBPART A

GENERAL PROVISIONS

(version dated 10/9/2008)

- (1) API Publication 2517, Evaporation Loss from External Floating Roof Tanks, Second Edition, February 1980, IBR approved January 27, 1983, for §§60.111(i), 60.111a(f), 60.111a(f)(1) and 60.116b(e)(2)(i).
- (d) The following material is available for purchase from the Technical Association of the Pulp and Paper Industry (TAPPI), Dunwoody Park, Atlanta, GA 30341.
 - (1) TAPPI Method T624 os-68, IBR approved January 27, 1983 for §60.285(d)(3).
- (e) The following material is available for purchase from the Water Pollution Control Federation (WPCF), 2626 Pennsylvania Avenue NW., Washington, DC 20037.
 - (1) Method 209A, Total Residue Dried at 103–105 °C, in Standard Methods for the Examination of Water and Wastewater, 15th Edition, 1980, IBR approved February 25, 1985 for §60.683(b).
- (f) The following material is available for purchase from the following address: Underwriter's Laboratories, Inc. (UL), 333 Pfingsten Road, Northbrook, IL 60062.
 - (1) UL 103, Sixth Edition revised as of September 3, 1986, Standard for Chimneys, Factory-built, Residential Type and Building Heating Appliance.
- (g) The following material is available for purchase from the following address: West Coast Lumber Inspection Bureau, 6980 SW. Barnes Road, Portland, OR 97223.
 - (1) West Coast Lumber Standard Grading Rules No. 16, pages 5–21 and 90 and 91, September 3, 1970, revised 1984.
- (h) The following material is available for purchase from the American Society of Mechanical Engineers (ASME), Three Park Avenue, New York, NY 10016–5990.
 - (1) ASME QRO–1–1994, Standard for the Qualification and Certification of Resource Recovery Facility Operators, IBR approved for §§60.56a, 60.54b(a), 60.54b(b), 60.1185(a), 60.1185(c)(2), 60.1675(a), and 60.1675(c)(2).
 - (2) ASME PTC 4.1–1964 (Reaffirmed 1991), Power Test Codes: Test Code for Steam Generating Units (with 1968 and 1969 Addenda), IBR approved for §§60.46b of subpart Db of this part, 60.58a(h)(6)(ii), 60.58b(i)(6)(ii), 60.1320(a)(3) and 60.1810(a)(3).
 - (3) ASME Interim Supplement 19.5 on Instruments and Apparatus: Application, Part II of Fluid Meters, 6th Edition (1971), IBR approved for §§60.58a(h)(6)(ii), 60.58b(i)(6)(ii), 60.1320(a)(4), and 60.1810(a)(4).
 - (4) ANSI/ASME PTC 19.10–1981, Flue and Exhaust Gas Analyses [Part 10, Instruments and Apparatus], IBR approved for Tables 1 and 3 of subpart EEEE, Tables 2 and 4 of subpart FFFF, Table 2 of subpart JJJJ, and §§60.4415(a)(2) and 60.4415(a)(3) of subpart KKKK of this part.
- (i) Test Methods for Evaluating Solid Waste, Physical/Chemical Methods,” EPA Publication SW–846 Third Edition (November 1986), as amended by Updates I (July 1992), II (September 1994), IIA (August, 1993), IIB (January 1995), and III (December 1996). This document may be obtained from the U.S. EPA, Office of Solid Waste and Emergency Response, Waste Characterization Branch, Washington, DC 20460, and is incorporated by reference for appendix A to part 60, Method 29, Sections 7.5.34; 9.2.1; 9.2.3; 10.2; 10.3; 11.1.1; 11.1.3; 13.2.1; 13.2.2; 13.3.1; and Table 29–3.
- (j) “Standard Methods for the Examination of Water and Wastewater,” 16th edition, 1985. Method 303F: “Determination of Mercury by the Cold Vapor Technique.” This document may be obtained from the American Public Health Association, 1015 18th Street, NW., Washington, DC 20036, and is incorporated by reference for appendix A to part 60, Method 29, Sections 9.2.3; 10.3; and 11.1.3.
- (k) This material is available for purchase from the American Hospital Association (AHA) Service, Inc., Post Office Box 92683, Chicago, Illinois 60675–2683. You may inspect a copy at EPA's Air and Radiation Docket and Information Center (Docket A–91–61, Item IV–J–124), Room M–1500, 1200 Pennsylvania Ave., NW., Washington, DC.
 - (1) An Ounce of Prevention: Waste Reduction Strategies for Health Care Facilities. American Society for Health Care Environmental Services of the American Hospital Association. Chicago, Illinois. 1993. AHA Catalog No. 057007. ISBN 0–87258–673–5. IBR approved for §60.35e and §60.55c.

GENERAL PROVISIONS

(version dated 10/9/2008)

- (l) This material is available for purchase from the National Technical Information Services, 5285 Port Royal Road, Springfield, Virginia 22161. You may inspect a copy at EPA's Air and Radiation Docket and Information Center (Docket A-91-61, Item IV-J-125), Room M-1500, 1200 Pennsylvania Ave., NW., Washington, DC.
- (1) OMB Bulletin No. 93-17: Revised Statistical Definitions for Metropolitan Areas. Office of Management and Budget, June 30, 1993. NTIS No. PB 93-192-664. IBR approved for §60.31e.
- (m) This material is available for purchase from at least one of the following addresses: The Gas Processors Association, 6526 East 60th Street, Tulsa, OK, 74145; or Information Handling Services, 15 Inverness Way East, PO Box 1154, Englewood, CO 80150-1154. You may inspect a copy at EPA's Air and Radiation Docket and Information Center, Room B108, 1301 Constitution Ave., NW., Washington, DC 20460.
- (1) Gas Processors Association Method 2377-86, Test for Hydrogen Sulfide and Carbon Dioxide in Natural Gas Using Length of Stain Tubes, IBR approved for §§60.334(h)(1), 60.4360, and 60.4415(a)(1)(ii).
- (2) [Reserved]
- (n) This material is available for purchase from IHS Inc., 15 Inverness Way East, Englewood, CO 80112.
- (1) International Organization for Standards 8178-4: 1996(E), Reciprocating Internal Combustion Engines—Exhaust Emission Measurement—Part 4: Test Cycles for Different Engine Applications, IBR approved for §60.4241(b).
- (2) [Reserved]

[48 FR 3735, Jan. 27, 1983]

Editorial Note: For Federal Register citations affecting §60.17, see the List of CFR Sections Affected, which appears in the Finding Aids section of the printed volume and on GPO Access.

§ 60.18 General control device requirements.

- (a) *Introduction.* This section contains requirements for control devices used to comply with applicable subparts of parts 60 and 61. The requirements are placed here for administrative convenience and only apply to facilities covered by subparts referring to this section.
- (b) *Flares.* Paragraphs (c) through (f) apply to flares.
- (c)
- (1) Flares shall be designed for and operated with no visible emissions as determined by the methods specified in paragraph (f), except for periods not to exceed a total of 5 minutes during any 2 consecutive hours.
- (2) Flares shall be operated with a flame present at all times, as determined by the methods specified in paragraph (f).
- (3) An owner/operator has the choice of adhering to either the heat content specifications in paragraph (c)(3)(ii) of this section and the maximum tip velocity specifications in paragraph (c)(4) of this section, or adhering to the requirements in paragraph (c)(3)(i) of this section.
- (i)
- (A) Flares shall be used that have a diameter of 3 inches or greater, are nonassisted, have a hydrogen content of 8.0 percent (by volume), or greater, and are designed for and operated with an exit velocity less than 37.2 m/sec (122 ft/sec) and less than the velocity, V_{\max} , as determined by the following equation:

$$V_{\max} = (X_{H_2} - K_1) * K_2$$

Where:

V_{\max} = Maximum permitted velocity, m/sec.

K_1 = Constant, 6.0 volume-percent hydrogen.

K_2 = Constant, 3.9(m/sec)/volume-percent hydrogen.

GENERAL PROVISIONS

(version dated 10/9/2008)

X_{H_2} = The volume-percent of hydrogen, on a wet basis, as calculated by using the American Society for Testing and Materials (ASTM) Method D1946-77. (Incorporated by reference as specified in §60.17).

(B) The actual exit velocity of a flare shall be determined by the method specified in paragraph (f)(4) of this section.

(ii) Flares shall be used only with the net heating value of the gas being combusted being 11.2 MJ/scm (300 Btu/scf) or greater if the flare is steam-assisted or air-assisted; or with the net heating value of the gas being combusted being 7.45 MJ/scm (200 Btu/scf) or greater if the flare is nonassisted. The net heating value of the gas being combusted shall be determined by the methods specified in paragraph (f)(3) of this section.

(4)

(i) Steam-assisted and nonassisted flares shall be designed for and operated with an exit velocity, as determined by the methods specified in paragraph (f)(4) of this section, less than 18.3 m/sec (60 ft/sec), except as provided in paragraphs (c)(4) (ii) and (iii) of this section.

(ii) Steam-assisted and nonassisted flares designed for and operated with an exit velocity, as determined by the methods specified in paragraph (f)(4), equal to or greater than 18.3 m/sec (60 ft/sec) but less than 122 m/sec (400 ft/sec) are allowed if the net heating value of the gas being combusted is greater than 37.3 MJ/scm (1,000 Btu/scf).

(iii) Steam-assisted and nonassisted flares designed for and operated with an exit velocity, as determined by the methods specified in paragraph (f)(4), less than the velocity, V_{max} , as determined by the method specified in paragraph (f)(5), and less than 122 m/sec (400 ft/sec) are allowed.

(5) Air-assisted flares shall be designed and operated with an exit velocity less than the velocity, V_{max} , as determined by the method specified in paragraph (f)(6).

(6) Flares used to comply with this section shall be steam-assisted, air-assisted, or nonassisted.

(d) Owners or operators of flares used to comply with the provisions of this subpart shall monitor these control devices to ensure that they are operated and maintained in conformance with their designs. Applicable subparts will provide provisions stating how owners or operators of flares shall monitor these control devices.

(e) Flares used to comply with provisions of this subpart shall be operated at all times when emissions may be vented to them.

(f)

(1) Method 22 of appendix A to this part shall be used to determine the compliance of flares with the visible emission provisions of this subpart. The observation period is 2 hours and shall be used according to Method 22.

(2) The presence of a flare pilot flame shall be monitored using a thermocouple or any other equivalent device to detect the presence of a flame.

(3) The net heating value of the gas being combusted in a flare shall be calculated using the following equation:

$$H_T = K \sum_{i=1}^n C_i H_i$$

[View or download PDF](#)

where:

H_T = Net heating value of the sample, MJ/scm; where the net enthalpy per mole of off gas is based on combustion at 25 °C and 760 mm Hg, but the standard temperature for determining the volume corresponding to one mole is 20 °C;

$$K = \text{Constant, } 1.740 \times 10^{-7} \left(\frac{1}{\text{ppm}} \right) \left(\frac{\text{g mole}}{\text{scm}} \right) \left(\frac{\text{MJ}}{\text{kcal}} \right)$$

where the standard temperature for $\left(\frac{\text{g mole}}{\text{scm}} \right)$ is 20°C;

GENERAL PROVISIONS

(version dated 10/9/2008)

[View or download PDF](#)

C_i = Concentration of sample component i in ppm on a wet basis, as measured for organics by Reference Method 18 and measured for hydrogen and carbon monoxide by ASTM D1946–77 or 90 (Reapproved 1994) (Incorporated by reference as specified in §60.17); and

H_i = Net heat of combustion of sample component i , kcal/g mole at 25 °C and 760 mm Hg. The heats of combustion may be determined using ASTM D2382–76 or 88 or D4809–95 (incorporated by reference as specified in §60.17) if published values are not available or cannot be calculated.

(4) The actual exit velocity of a flare shall be determined by dividing the volumetric flowrate (in units of standard temperature and pressure), as determined by Reference Methods 2, 2A, 2C, or 2D as appropriate; by the unobstructed (free) cross sectional area of the flare tip.

(5) The maximum permitted velocity, V_{max} , for flares complying with paragraph (c)(4)(iii) shall be determined by the following equation.

$$\text{Log}_{10}(V_{max}) = (H_T + 28.8) / 31.7$$

V_{max} = Maximum permitted velocity, M/sec

28.8 = Constant

31.7 = Constant

H_T = The net heating value as determined in paragraph (f)(3).

(6) The maximum permitted velocity, V_{max} , for air-assisted flares shall be determined by the following equation.

$$V_{max} = 8.706 + 0.7084 (H_T)$$

V_{max} = Maximum permitted velocity, m/sec

8.706 = Constant

0.7084 = Constant

H_T = The net heating value as determined in paragraph (f)(3).

[51 FR 2701, Jan. 21, 1986, as amended at 63 FR 24444, May 4, 1998; 65 FR 61752, Oct. 17, 2000]

§ 60.19 General notification and reporting requirements.

- (a) For the purposes of this part, time periods specified in days shall be measured in calendar days, even if the word “calendar” is absent, unless otherwise specified in an applicable requirement.
- (b) For the purposes of this part, if an explicit postmark deadline is not specified in an applicable requirement for the submittal of a notification, application, report, or other written communication to the Administrator, the owner or operator shall postmark the submittal on or before the number of days specified in the applicable requirement. For example, if a notification must be submitted 15 days before a particular event is scheduled to take place, the notification shall be postmarked on or before 15 days preceding the event; likewise, if a notification must be submitted 15 days after a particular event takes place, the notification shall be delivered or postmarked on or before 15 days following the end of the event. The use of reliable non-Government mail carriers that provide indications of verifiable delivery of information required to be submitted to the Administrator, similar to the postmark provided by the U.S. Postal Service, or alternative means of delivery, including the use of electronic media, agreed to by the permitting authority, is acceptable.
- (c) Notwithstanding time periods or postmark deadlines specified in this part for the submittal of information to the Administrator by an owner or operator, or the review of such information by the Administrator, such time periods or deadlines may be changed by mutual agreement between the owner or operator and the Administrator. Procedures governing the implementation of this provision are specified in paragraph (f) of this section.
- (d) If an owner or operator of an affected facility in a State with delegated authority is required to submit periodic reports under this part to the State, and if the State has an established timeline for the submission of periodic reports that is

GENERAL PROVISIONS

(version dated 10/9/2008)

consistent with the reporting frequency(ies) specified for such facility under this part, the owner or operator may change the dates by which periodic reports under this part shall be submitted (without changing the frequency of reporting) to be consistent with the State's schedule by mutual agreement between the owner or operator and the State. The allowance in the previous sentence applies in each State beginning 1 year after the affected facility is required to be in compliance with the applicable subpart in this part. Procedures governing the implementation of this provision are specified in paragraph (f) of this section.

- (e) If an owner or operator supervises one or more stationary sources affected by standards set under this part and standards set under part 61, part 63, or both such parts of this chapter, he/she may arrange by mutual agreement between the owner or operator and the Administrator (or the State with an approved permit program) a common schedule on which periodic reports required by each applicable standard shall be submitted throughout the year. The allowance in the previous sentence applies in each State beginning 1 year after the stationary source is required to be in compliance with the applicable subpart in this part, or 1 year after the stationary source is required to be in compliance with the applicable 40 CFR part 61 or part 63 of this chapter standard, whichever is latest. Procedures governing the implementation of this provision are specified in paragraph (f) of this section.
- (f)
 - (1)
 - (i) Until an adjustment of a time period or postmark deadline has been approved by the Administrator under paragraphs (f)(2) and (f)(3) of this section, the owner or operator of an affected facility remains strictly subject to the requirements of this part.
 - (ii) An owner or operator shall request the adjustment provided for in paragraphs (f)(2) and (f)(3) of this section each time he or she wishes to change an applicable time period or postmark deadline specified in this part.
 - (2) Notwithstanding time periods or postmark deadlines specified in this part for the submittal of information to the Administrator by an owner or operator, or the review of such information by the Administrator, such time periods or deadlines may be changed by mutual agreement between the owner or operator and the Administrator. An owner or operator who wishes to request a change in a time period or postmark deadline for a particular requirement shall request the adjustment in writing as soon as practicable before the subject activity is required to take place. The owner or operator shall include in the request whatever information he or she considers useful to convince the Administrator that an adjustment is warranted.
 - (3) If, in the Administrator's judgment, an owner or operator's request for an adjustment to a particular time period or postmark deadline is warranted, the Administrator will approve the adjustment. The Administrator will notify the owner or operator in writing of approval or disapproval of the request for an adjustment within 15 calendar days of receiving sufficient information to evaluate the request.
 - (4) If the Administrator is unable to meet a specified deadline, he or she will notify the owner or operator of any significant delay and inform the owner or operator of the amended schedule.

[59 FR 12428, Mar. 16, 1994, as amended at 64 FR 7463, Feb. 12, 1998]

Appendix H-1. Permit History/ID Number Changes.

Pasco County Resource Recovery Facility

Final Permit Revision No. 1010056-006-AV
Facility ID No. 1010056

Permit History (for tracking purposes):

E.U. ID No	Description	Permit No.	Issue Date	Expiration Date	Extended Date ^{1,2}	Revised Date(s)
-001	Municipal Waste Combustion Unit No. 1	PSD-FL-127	09/22/88			06/25/97
-002	Municipal Waste Combustion Unit No. 2	PSD-FL-127	09/22/88			06/25/97
-003	Municipal Waste Combustion Unit No. 3	PSD-FL-127	09/22/88			06/25/97
-004	Storage Silo for Activated Carbon	AC51-266667	04/20/95	03/15/98		
-005	Leachate Treatment Facility	1010056-001-AC	03/20/96	08/20/97		
		1010056-003-AC	03/13/97	08/20/97		
All	Initial Title V permit	1010056-002-AV	10/20/00	10/20/05		
-001, - 002, - 003	Emission Units 1, 2 and 3 removal of requirement to monitor furnace temperature	1010056-004-AV	07/02/02	10/20/05		
All	Title V Renewal	1010056-005-AV*	03/16/2007	03/16/2012		
-001, - 002, - 003, - 008	Title V Revision to include the May 10, 2006 federal amendments	1010056-006-AV	06/12/2009	NA		

Notes:

1 - AO permit(s) automatic extension(s) in Rule 62-210.300(2)(a)3.a., F.A.C., effective 03/21/96.

2 - AC permit(s) automatic extension(s) in Rule 62-213.420(1)(a)4., F.A.C., effective 03/20/96.

{Rule 62-213.420(1)(b)2., F.A.C., allows Title V Sources to operate under valid permits that were in effect at the time of application until the Title V permit becomes effective}

* The most recently posted Title V air operation permit on the web site.

"NA" represents not applicable.

Table 1-1, Air Pollutant Standards and Terms										
Pasco County								Final Permit Revision No. 1010056-006-AV		
Pasco County Resource Recovery Facility								Facility ID No. 1010056		
This table summarizes information for convenience purposes only and does not supersede any of the terms or conditions of this permit, or add any conditions.										
E.U.	Brief	Pollutant	Fuel	Hours/Year	Basis	Equivalent Emissions*		Total	See Permit	
ID Nos.	Description					lb/hr	TPY	TPY	Regulatory Citations	Conditions
-001	MWC Unit No. 1	The following apply to each individual emissions unit listed								
-002	MWC Unit No. 2									
-003	MWC Unit No. 3									
		PM	MSW	8760	before 4/28/09 - 27 mg/dscm, corrected to 7% O2	7.800	34.16	102.49	62-213.440(1), F.A.C.	A.16.
		PM	MSW	8760	after 4/28/09 - 25 mg/dscm, corrected to 7% O2	7.200	31.54	94.61	62-213.440(1), F.A.C.	A.16.
		NOx	MSW	8760	0.643 lb/MMBtu	90.020	394.29	1182.86	PSD-FL-127	A.30.
		CO	MSW	8760	100 ppmv, corrected to 7% O2	33.760	147.87	443.61	40 CFR 60.34b(a)	A.31.1.
		Cadmium	MSW	8760	before 4/28/09 - 0.040 mg/dscm, corrected to 7% O2	1.150E-02	0.0504	0.15	40 CFR 60.33b(a)(2)(i)	A.18.
		Cadmium	MSW	8760	after 4/28/09 - 0.035 mg/dscm, corrected to 7% O2	1.010E-02	0.0442	0.13	40 CFR 60.33b(a)(2)(i)	A.18.
		Mercury	MSW	8760	before 4/28/09 - 0.070 mg/dscm, corrected to 7% O2	2.030E-02	0.0889	0.27	62-296.416(3)(a)1., F.A.C.	A.19.
		Mercury	MSW	8760	after 4/28/09 - 0.050 mg/dscm, corrected to 7% O2	1.450E-02	0.064	0.19	40 CFR 60.33b(a)(3)	A.19.
		Lead	MSW	8760	before 4/28/09 - 0.44 mg/dscm, corrected to 7% O2	1.275E-01	0.5585	1.68	40 CFR 60.33b(a)(4)	A.21.
		Lead	MSW	8760	after 4/28/09 - 0.40 mg/dscm, corrected to 7% O2	1.159E-01	0.5076	1.52	40 CFR 60.33b(a)(4)	A.21.
		Lead	MSW	8760	0.0007 lb/MMBtu	9.800E-02	0.4292	1.29	PSD-FL-127	A.22.
		Fluoride	MSW	8760	0.008 lb/MMBtu	1.120	4.906	14.72	PSD-FL-127, SC No. 3	A.23.
		Beryllium	MSW	8760	1.35 x 10 ⁻⁷ lb/MMBtu	1.890E-05	8.28E-05	2.483E-04	PSD-FL-127, SC No. 3	A.24.
		VOC	MSW	8760	0.021 lb/MMBtu	2.940	12.88	38.63	PSD-FL-127, SC No. 3	A.25.
		SO2	MSW	8760	29 ppmv, corrected to 7% O2	22.392	98.08	294.23	40 CFR 60.33b(b)(3)(i)	A.26.
		HCl	MSW	8760	29 ppmv, corrected to 7% O2	12.746	55.827	167.48	40 CFR 60.33b(b)(3)(ii)	A.27.
		Dioxins/Furans	MSW	8760	30 nanograms per dscm, corrected to 7% O2	8.690E-06	3.806E-05	1.142E-04	40 CFR 60.33b(c)(1)(ii)	A.28.
		Opacity	MSW	8760	Not > 10%				40 CFR 60.33b(a)(1)(iii)	A.17.
						*for each MWC				
-004	Storage Silo for Carbon	PM				0.08	0.37		AC51-266667	B.4.
		Opacity			Not > 5%				AC51-266667	B.3.
-005	Leachate Treatment	(Removed from service)								
-008	Ash Building	Opacity			Not > 5%				40 CFR 60.36b; 40 CFR 60.54	E.1.

Friday, Barbara

To: John Power
Cc: jgorrie@CovantaEnergy.com; crellinwr@cdm.com; Zhang-Torres; Forney.Kathleen@epamail.epa.gov; Oquendo.Ana@epamail.epa.gov; Gibson, Victoria; Sheplak, Scott; Holtom, Jonathan
Subject: PASCO COUNTY RESOURCE RECOVERY FACILITY; 1010056-006-AV
Attachments: 1010056-006-AV SignedNoticeofFinalPermit.pdf

Dear Sir/ Madam:

Attached is the official **Notice of Final Permit** for the project referenced below. Click on the link displayed below to access the permit project documents and send a "reply" message verifying receipt of the document(s) provided in the link; this may be done by selecting "Reply" on the menu bar of your e-mail software, noting that you can view the documents, and then selecting "Send".

Note: We must receive verification that you are able to access the documents. Your immediate reply will preclude subsequent e-mail transmissions to verify accessibility of the document(s).

Click on the following link to access the permit project documents:

http://ARM-PERMIT2K.dep.state.fl.us/adh/prod/pdf_permit_zip_files/1010056.006.AV.F_pdf.zip

Attention: Scott Sheplak

Owner/Company Name: PASCO COUNTY
Facility Name: PASCO COUNTY RESOURCE RECOVERY FACILITY
Project Number: 1010056-006-AV
Permit Status: FINAL
Permit Activity: PERMIT REVISION
Facility County: PASCO

The Bureau of Air Regulation is issuing electronic documents for permits, notices and other correspondence in lieu of hard copies through the United States Postal System, to provide greater service to the applicant and the engineering community. Access these documents by clicking on the link provided above, or search for other project documents using the "Air Permit Documents Search" website at <http://www.dep.state.fl.us/air/eproducts/apds/default.asp>.

Permit project documents that are addressed in this email may require immediate action within a specified time frame. Please open and review the document(s) as soon as possible, and verify that they are accessible. Please advise this office of any changes to your e-mail address or that of the Engineer-of-Record. If you have any problems opening the documents or would like further information, please contact the Florida Department of Environmental Protection, Bureau of Air Regulation.

Barbara Friday
Bureau of Air Regulation
Division of Air Resource Management (DARM)
(850) 921-9524

Friday, Barbara

From: Exchange Administrator
Sent: Thursday, June 18, 2009 1:09 PM
To: Friday, Barbara
Subject: Delivery Status Notification (Relay)
Attachments: ATT227468.txt; PASCO COUNTY RESOURCE RECOVERY FACILITY; 1010056-006-AV

This is an automatically generated Delivery Status Notification.

Your message has been successfully relayed to the following recipients, but the requested delivery status notifications may not be generated by the destination.

jpower@pascocountyfl.net

Friday, Barbara

From: John Power [jpower@pascocountyfl.net]
To: Friday, Barbara
Sent: Thursday, June 18, 2009 1:25 PM
Subject: Read: PASCO COUNTY RESOURCE RECOVERY FACILITY; 1010056-006-AV

Your message

To: jpower@pascocountyfl.net
Subject:

was read on 6/18/2009 1:25 PM.

Friday, Barbara

From: John Power [jpower@pascocountyfl.net]
Sent: Thursday, June 18, 2009 2:42 PM
To: Friday, Barbara
Cc: jgorrie@CovantaEnergy.com; crellinwr@cdm.com; Zhang-Torres; Forney.Kathleen@epamail.epa.gov; Oquendo.Ana@epamail.epa.gov; Gibson, Victoria; Sheplak, Scott; Holtom, Jonathan; 'Ta,Viet'
Subject: RE: PASCO COUNTY RESOURCE RECOVERY FACILITY; 1010056-006-AV

I am in receipt of the document (s) provided in the link. Thank you for your quick response.

John Power

From: Friday, Barbara [mailto:Barbara.Friday@dep.state.fl.us]
Sent: Thursday, June 18, 2009 1:09 PM
To: John Power
Cc: jgorrie@CovantaEnergy.com; crellinwr@cdm.com; Zhang-Torres; Forney.Kathleen@epamail.epa.gov; Oquendo.Ana@epamail.epa.gov; Gibson, Victoria; Sheplak, Scott; Holtom, Jonathan
Subject: PASCO COUNTY RESOURCE RECOVERY FACILITY; 1010056-006-AV

Dear Sir/ Madam:

Attached is the official **Notice of Final Permit** for the project referenced below. Click on the link displayed below to access the permit project documents and send a "reply" message verifying receipt of the document(s) provided in the link; this may be done by selecting "Reply" on the menu bar of your e-mail software, noting that you can view the documents, and then selecting "Send".

Note: We must receive verification that you are able to access the documents. Your immediate reply will preclude subsequent e-mail transmissions to verify accessibility of the document(s).

Click on the following link to access the permit project documents:

http://ARM-PERMIT2K.dep.state.fl.us/adh/prod/pdf_permit_zip_files/1010056.006.AV.F_pdf.zip

Attention: Scott Sheplak

Owner/Company Name: PASCO COUNTY
Facility Name: PASCO COUNTY RESOURCE RECOVERY FACILITY
Project Number: 1010056-006-AV
Permit Status: FINAL
Permit Activity: PERMIT REVISION
Facility County: PASCO

The Bureau of Air Regulation is issuing electronic documents for permits, notices and other correspondence in lieu of hard copies through the United States Postal System, to provide greater service to the applicant and the engineering community. Access these documents by clicking on the link provided above, or search for other project documents using the "Air Permit Documents Search" website at <http://www.dep.state.fl.us/air/eproducts/apds/default.asp>.

Permit project documents that are addressed in this email may require immediate action within a specified time frame. Please open and review the document(s) as soon as possible, and verify that they are accessible. Please advise this office of any changes to your e-mail address or that of the Engineer-of-Record. If you have any

problems opening the documents or would like further information, please contact the Florida Department of Environmental Protection, Bureau of Air Regulation.

Barbara Friday
Bureau of Air Regulation
Division of Air Resource Management (DARM)
(850) 921-9524

The Department of Environmental Protection values your feedback as a customer. DEP Secretary Michael W. Sole is committed to continuously assessing and improving the level and quality of services provided to you. Please take a few minutes to comment on the quality of service you received. Simply click on [this link to the DEP Customer Survey](#). Thank you in advance for completing the survey.

Friday, Barbara

From: Gorrie,Jason [jgorrie@CovantaEnergy.com]
To: Friday, Barbara
Sent: Thursday, June 18, 2009 1:16 PM
Subject: Read: PASCO COUNTY RESOURCE RECOVERY FACILITY; 1010056-006-AV

Your message

To: jgorrie@CovantaEnergy.com
Subject:

was read on 6/18/2009 1:16 PM.

Friday, Barbara

From: Exchange Administrator
Sent: Thursday, June 18, 2009 1:09 PM
To: Friday, Barbara
Subject: Delivery Status Notification (Relay)
Attachments: ATT227477.txt; PASCO COUNTY RESOURCE RECOVERY FACILITY; 1010056-006-AV

This is an automatically generated Delivery Status Notification.

Your message has been successfully relayed to the following recipients, but the requested delivery status notifications may not be generated by the destination.

crellinwr@cdm.com

Friday, Barbara

From: System Administrator
To: Zhang-Torres; Gibson, Victoria
Sent: Thursday, June 18, 2009 1:09 PM
Subject: Delivered: PASCO COUNTY RESOURCE RECOVERY FACILITY; 1010056-006-AV

Your message

To: John Power
Cc: jgorrie@CovantaEnergy.com; crellinwr@cdm.com; Zhang-Torres;
Forney.Kathleen@epamail.epa.gov; Oquendo.Ana@epamail.epa.gov; Gibson, Victoria;
Sheplak, Scott; Holtom, Jonathan
Subject: PASCO COUNTY RESOURCE RECOVERY FACILITY; 1010056-006-AV
Sent: 6/18/2009 1:09 PM

was delivered to the following recipient(s):

Zhang-Torres on 6/18/2009 1:09 PM
Gibson, Victoria on 6/18/2009 1:09 PM

Friday, Barbara

From: Zhang-Torres
To: Friday, Barbara
Sent: Thursday, June 18, 2009 1:29 PM
Subject: Read: PASCO COUNTY RESOURCE RECOVERY FACILITY; 1010056-006-AV

Your message

To: John Power
Cc: jgorrie@CovantaEnergy.com; crellinwr@cdm.com; Zhang-Torres;
Forney.Kathleen@epamail.epa.gov; Oquendo.Ana@epamail.epa.gov; Gibson, Victoria;
Sheplak, Scott; Holtom, Jonathan
Subject: PASCO COUNTY RESOURCE RECOVERY FACILITY; 1010056-006-AV
Sent: 6/18/2009 1:09 PM

was read on 6/18/2009 1:29 PM.

Friday, Barbara

From: Gibson, Victoria
To: Friday, Barbara
Sent: Thursday, June 18, 2009 1:13 PM
Subject: Read: PASCO COUNTY RESOURCE RECOVERY FACILITY; 1010056-006-AV

Your message

To: John Power
Cc: jgorrie@CovantaEnergy.com; crellinwr@cdm.com; Zhang-Torres;
Forney.Kathleen@epamail.epa.gov; Oquendo.Ana@epamail.epa.gov; Gibson, Victoria;
Sheplak, Scott; Holtom, Jonathan
Subject: PASCO COUNTY RESOURCE RECOVERY FACILITY; 1010056-006-AV
Sent: 6/18/2009 1:09 PM

was read on 6/18/2009 1:13 PM.

Friday, Barbara

From: Mail Delivery System [MAILER-DAEMON@mseive01.rtp.epa.gov]
Sent: Thursday, June 18, 2009 1:09 PM
To: Friday, Barbara
Subject: Successful Mail Delivery Report
Attachments: Delivery report; Message Headers

This is the mail system at host mseive01.rtp.epa.gov.

Your message was successfully delivered to the destination(s) listed below. If the message was delivered to mailbox you will receive no further notifications. Otherwise you may still receive notifications of mail delivery errors from other systems.

The mail system

<Forney.Kathleen@epamail.epa.gov>: delivery via 127.0.0.1[127.0.0.1]:10025: 250
OK, sent 4A3A74B7_3546_26989_1 889254436F

<Oquendo.Ana@epamail.epa.gov>: delivery via 127.0.0.1[127.0.0.1]:10025: 250 OK,
sent 4A3A74B7_3546_26989_1 889254436F

Friday, Barbara

From: System Administrator
To: Sheplak, Scott
Sent: Thursday, June 18, 2009 1:09 PM
Subject: Delivered: PASCO COUNTY RESOURCE RECOVERY FACILITY; 1010056-006-AV

Your message

To: John Power
Cc: jgorrie@CovantaEnergy.com; crellinwr@cdm.com; Zhang-Torres;
Forney.Kathleen@epamail.epa.gov; Oquendo.Ana@epamail.epa.gov; Gibson, Victoria;
Sheplak, Scott; Holtom, Jonathan
Subject: PASCO COUNTY RESOURCE RECOVERY FACILITY; 1010056-006-AV
Sent: 6/18/2009 1:09 PM

was delivered to the following recipient(s):

Sheplak, Scott on 6/18/2009 1:09 PM

Friday, Barbara

From: Sheplak, Scott
To: Friday, Barbara
Sent: Thursday, June 18, 2009 3:26 PM
Subject: Read: PASCO COUNTY RESOURCE RECOVERY FACILITY; 1010056-006-AV

Your message

To: John Power
Cc: jgorrie@CovantaEnergy.com; crellinwr@cdm.com; Zhang-Torres;
Forney.Kathleen@epamail.epa.gov; Quendo.Ana@epamail.epa.gov; Gibson, Victoria;
Sheplak, Scott; Holtom, Jonathan
Subject: PASCO COUNTY RESOURCE RECOVERY FACILITY; 1010056-006-AV
Sent: 6/18/2009 1:09 PM

was read on 6/18/2009 3:26 PM.

Friday, Barbara

From: System Administrator
To: Holtom, Jonathan
Sent: Thursday, June 18, 2009 1:09 PM
Subject: Delivered: PASCO COUNTY RESOURCE RECOVERY FACILITY; 1010056-006-AV

Your message

To: John Power
Cc: jgorrie@CovantaEnergy.com; crellinwr@cdm.com; Zhang-Torres;
Forney.Kathleen@epamail.epa.gov; Oquendo.Ana@epamail.epa.gov; Gibson, Victoria;
Sheplak, Scott; Holtom, Jonathan
Subject: PASCO COUNTY RESOURCE RECOVERY FACILITY; 1010056-006-AV
Sent: 6/18/2009 1:09 PM

was delivered to the following recipient(s):

Holtom, Jonathan on 6/18/2009 1:09 PM

Friday, Barbara

From: Holtom, Jonathan
To: Friday, Barbara
Sent: Thursday, June 18, 2009 1:13 PM
Subject: Read: PASCO COUNTY RESOURCE RECOVERY FACILITY; 1010056-006-AV

Your message

To: John Power
Cc: jgorrie@CovantaEnergy.com; crellinwr@cdm.com; Zhang-Torres;
Forney.Kathleen@epamail.epa.gov; Oquendo.Ana@epamail.epa.gov; Gibson, Victoria;
Sheplak, Scott; Holtom, Jonathan
Subject: PASCO COUNTY RESOURCE RECOVERY FACILITY; 1010056-006-AV
Sent: 6/18/2009 1:09 PM

was read on 6/18/2009 1:13 PM.