



RECEIVED

APR 26 2000

BUREAU OF AIR REGULATION

April 25, 2000

Mr. A. A. Linero, P.E.
Florida Department of Environmental Protection
111 South Magnolia Drive, Suite 4
Tallahassee, Florida 32301

Via FedEx
Airbill No. 7910 7616 1036

Re: Tampa Electric Company (TEC)
Polk Power Station – CTG's 2 and 3
Manufacturer's Emissions Versus Load Diagrams
FDEP File No. PSD-FL-263

Dear Mr. Linero:

Please find enclosed copies of the manufacturer's emissions performance versus load diagrams for the DLN and wet injection systems for the above units. This submittal is being made to satisfy the requirement in Condition 17 of the above referenced PSD permit.

If you have any concerns or questions feel free to contact me at (813) 641-5033.

Sincerely,

Jamie Hunter
Consulting Engineer
Environmental Planning


EPgmJJH919

Enclosures

cc: J. Kahn
J. Koerner
M. Halpin
T. Heron

PG7241FA with DLN2.6 Combustor

Estimated Emissions vs Gas Turbine Load

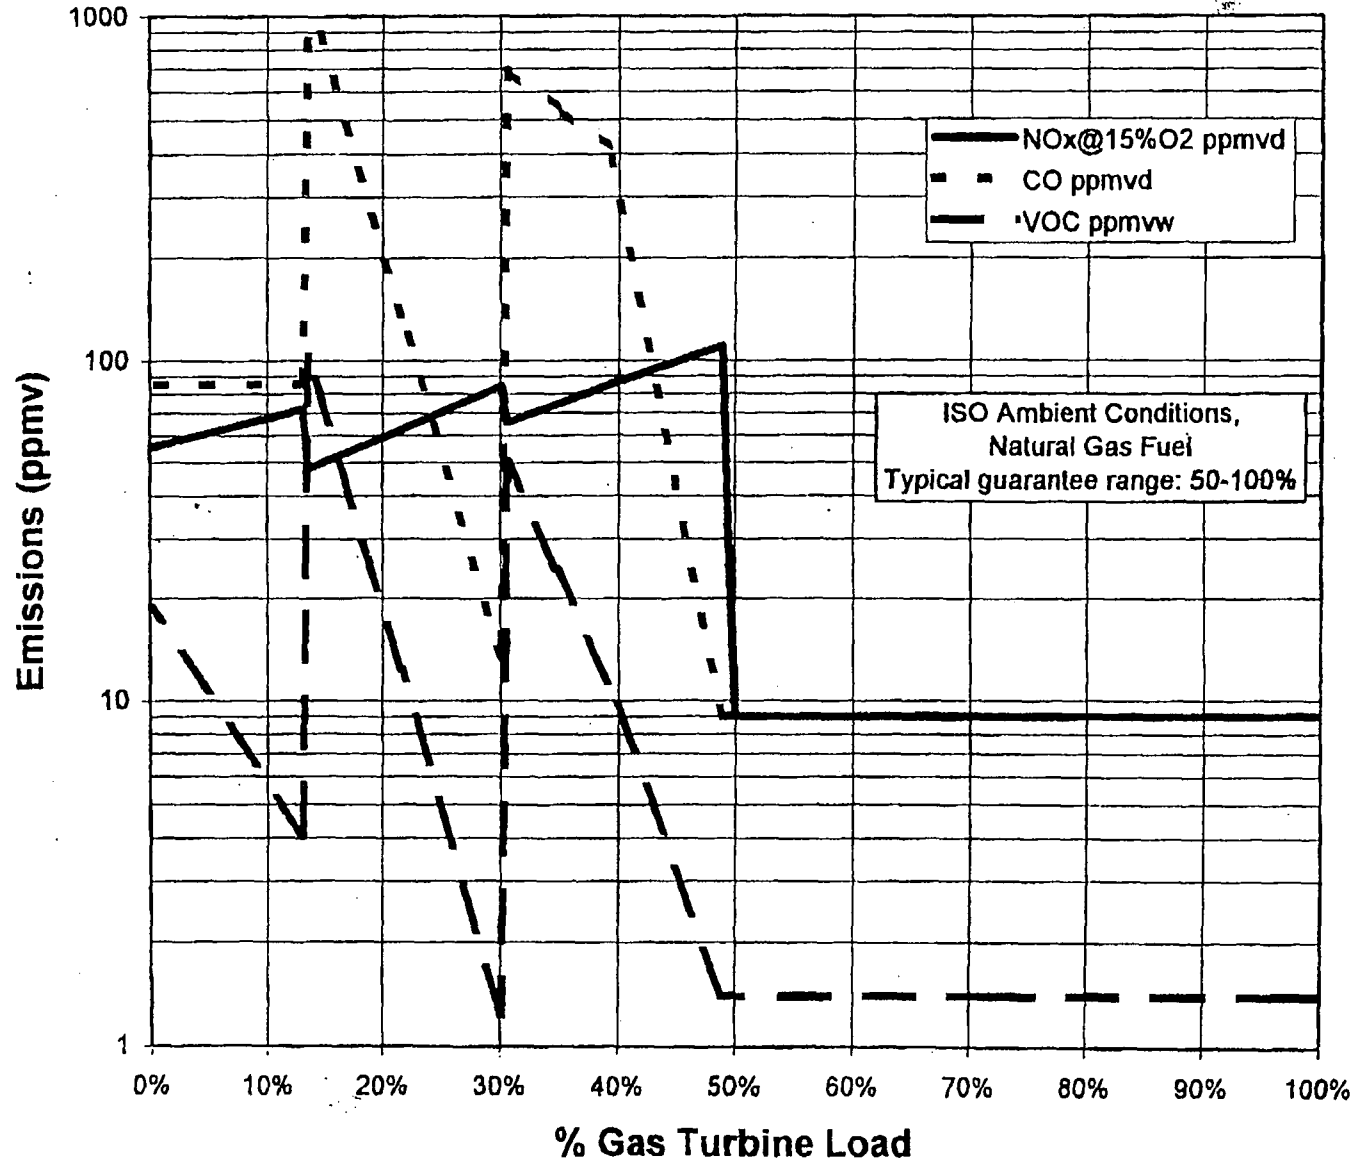

7241FA with DLN2.6 Combustor Estimated Emissions - Liquid Fuel

