



Jeb Bush
Governor

Department of Environmental Protection

Twin Towers Office Building
2600 Blair Stone Road
Tallahassee, Florida 32399-2400

David B. Struhs
Secretary


P.E. Certification Statement

Permittee:
Florida Power & Light Company
Turkey Point Fossil Plant

DRAFT Permit No.: 0250003-005-AV

Project type: Title V Air Operation Permit Renewal

I HEREBY CERTIFY that the engineering features described in the above referenced application and subject to the proposed permit conditions provide reasonable assurance of compliance with applicable provisions of Chapter 403, Florida Statutes, and Florida Administrative Code Chapters 62-4, and 62-204 through 62-297. However, I have not evaluated and I do not certify aspects of the proposal outside of my area of expertise (including but not limited to the electrical, mechanical, structural, hydrological, and geological features).



Scott M. Sheplak, P.E.
Registration Number: 48866



Date 08/06/03

Permitting Authority:
Department of Environmental Protection
Bureau of Air Regulation
111 South Magnolia Drive, Suite 4
Tallahassee, Florida 32301
Telephone: 850/488-0114
Fax: 850/922-6979

"More Protection, Less Process"

Printed on recycled paper.

STATEMENT OF BASIS

Florida Power & Light
Turkey Point Fossil Plant
Facility ID No. 0250003
Dade County

Title V Air Operation Permit Renewal
DRAFT Permit No. 0250003-005-AV

This Title V Air Operation Permit Renewal is issued under the provisions of Chapter 403, Florida Statutes (F.S.), and Florida Administrative Code (F.A.C.) Chapters 62-4, 62-210, 62-213, and 62-214. The above named permittee is hereby authorized to perform the work or operate the facility shown in the application and approved drawings, plans, and other documents, attached hereto or on file with the permitting authority, in accordance with the terms and conditions of this permit.

The Turkey Point Title V Source is composed of two separate co-located power plants: the Fossil Plant and the Nuclear Plant. This permit, No. 0250003-005-AV, addresses only the operations at the Fossil Plant. The (non-nuclear) operations at the Nuclear Plant are addressed in a separate Title V permit, No. 0250003-004-AV.

The Fossil Plant consists of two fossil steam generating units, and five "black start" diesel peaking generators. The boilers began operation in 1967 and 1968. To reduce pollution, both boilers incorporate "low-NOx burners" and mechanical cyclone dust collectors.

Emissions units 001 and 002 consist of two Foster-Wheeler 440 MW Class Steam Generating Units that burn a variable combination of natural gas, used oil from FP&L operations, & No. 6 fuel oil. Stack height is 400 feet. The units are equipped with low excess air burners and UOP Air Correction Division multiple cyclones with reinjection. Visible emissions are monitored by a transmissometer in the stack. The units are subject to NOx RACT. Sulfur dioxide, carbon dioxide, nitrogen oxides, visible emissions, and gas flow rate are all continuously monitored. The units began operation in April 1967 (001) and April 1968 (002), respectively. CAM does not apply.

FPL may inject additives such as magnesium oxide, magnesium hydroxide and related compounds into each boiler for the purposes of reducing build-up of particulate matter on the interior boiler surfaces, to facilitate proper heat transfer and other boiler operation, and to reduce the particulate matter required to be removed from boiler surfaces during soot blowing and other boiler cleaning operations. The rate of additive injection is not large, generally on the order of 1 gallon of additive per approximately 2,500 (\pm 500) gallons of fuel oil (this is approximately 0.04% by volume). The permit requires that emission tests be conducted while injecting additives consistent with normal operating practices.

Emissions unit 003 consists of five MKW Powersystems, Inc. Model EMD MP-45 "black start" emergency diesel generators. The generators support boilers 001 and 002 as "peaking units", and, in the event the facility loses primary power, they serve as a backup. These units fire No. 2 fuel oil. The generators commenced operation in April, 1968. CAM does not apply.


The heat input limitations have been placed in each permit to identify the capacity of each unit for the purposes of confirming that emissions testing is conducted within 90 to 100 percent of the

unit's rated capacity (or to limit future operation to 110 percent of the test load), to establish appropriate emission limits and to aid in determining future rule applicability. A note below the permitted capacity condition clarifies this. Regular record keeping is not required for heat input. Instead the owner or operator is expected to determine heat input whenever emission testing is required, to demonstrate at what percentage of the rated capacity that the unit was tested. Rule 62-297.310(5), F.A.C., included in the permit, requires measurement of process variables for emission tests. Such heat input determination may be based on measurements of fuel consumption by various methods including but not limited to fuel flow metering or tank drop measurements, using the heat value of the fuel determined by the fuel vendor or the owner or operator, to calculate average hourly heat input during the test.

This facility is allowed to co-fire natural gas with fuel oil in any ratio that will cause emissions to not exceed the sulfur dioxide limitation of this permit. The permit specifies that compliance with the sulfur dioxide standard shall be based on the total heat input from all liquid and gaseous fuels burned. The permit also requires that the sulfur dioxide emission limitation shall apply at all times including startup, shutdown, and load change. However, excess emissions of sulfur dioxide are allowed during malfunctions in accordance with the excess emissions conditions of this permit, which are based on Rule 62-210.700, F.A.C. Malfunctions that could occur and affect sulfur dioxide emissions include unexpected loss of natural gas supply at the plant, failure of the fuel feed system or burner failure.

Also included in this permit are miscellaneous unregulated and insignificant emissions units and activities.

Based on the Title V Air Operation Permit Renewal application received July 3, 2003, this Title V Source is a major source of hazardous air pollutants (HAPs).

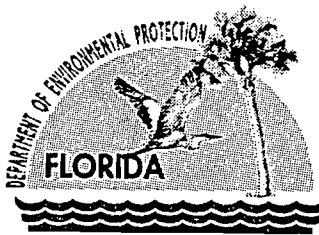

Jeb Bush
Governor

Department of Environmental Protection

Twin Towers Office Building
2600 Blair Stone Road
Tallahassee, Florida 32399-2400

David B. Struhs
Secretary

August 11, 2003

H.O. Nunez
Responsible Official
FPL Turkey Point Fossil Plant
9760 SW 344th Street
Florida City, FL 33034

Re: Title V Air Operation Permit Renewal
DRAFT Permit Project No.: 0250003-005-AV
FPL Turkey Point Fossil Plant

Dear Mr. Nunez,

One copy of the DRAFT Permit for the renewal of a Title V Air Operation Permit for the Turkey Point Fossil Plant located at 9760 SW 344th Street, Florida City, Dade County, is enclosed. The permitting authority's "INTENT TO ISSUE TITLE V AIR OPERATION PERMIT RENEWAL" and the "PUBLIC NOTICE OF INTENT TO ISSUE TITLE V AIR OPERATION PERMIT RENEWAL" are also included.

The "PUBLIC NOTICE OF INTENT TO ISSUE TITLE V AIR OPERATION PERMIT RENEWAL" must be published as soon as possible. Proof of publication, i.e., newspaper affidavit, must be provided to the permitting authority's office within 7 (seven) days of publication pursuant to Rule 62-110.106(5), F.A.C. Failure to publish the notice and provide proof of publication within the allotted time may result in the denial of the permit pursuant to Rule 62-110.106(11), F.A.C.

Please submit any written comments you wish to have considered concerning the permitting authority's proposed action to Scott M. Sheplak, P.E., at the above letterhead address. If you have any other questions, please contact Bobby Bull, at (850) 921-9585.

Sincerely,

Trina L. Vielhauer
Chief
Bureau of Air Regulation

TV/sms/rlb
Enclosures

"More Protection, Less Process"

Printed on recycled paper.

SENDER: COMPLETE THIS SECTION

- Complete items 1, 2, and 3. Also complete item 4 if Restricted Delivery is desired.
- Print your name and address on the reverse so that we can return the card to you.
- Attach this card to the back of the mailpiece, or on the front if space permits.

1. Article Addressed to:

H.O. Nunez
Responsible Official
FPL Turkey Point Fossil Plant
9760 SW 34th Street
Florida City, Florida 33034

2. Article Number

(Transfer from service label) 7000 2870 0000 7028 1778

COMPLETE THIS SECTION ON DELIVERY

A. Signature

x *Randy Brown*

 Agent Addressee

B. Received by (Printed Name)

Randy Brown

C. Date of Delivery

8/19/03

D. Is delivery address different from item 1? Yes

If YES, enter delivery address below: No

3. Service Type

Certified Mail Express Mail

Registered

Return Receipt for Merchandise

Insured Mail

C.O.D.

4. Restricted Delivery? (Extra Fee)

Yes

PS Form 3811, August 2001

Domestic Return Receipt

102595-02-M-1540

U.S. Postal Service CERTIFIED MAIL RECEIPT (Domestic Mail Only; No Insurance Coverage Provided)	
OFFICIAL USE	
H.O. Nunez	
Postage	\$
Certified Fee	
Return Receipt Fee (Endorsement Required)	
Restricted Delivery Fee (Endorsement Required)	
Total Postage & Fees	\$
Postmark Here	
Sent To H.O. Nunez	
Street, Apt. No., or PO Box No. 9760 SW 34th Street	
City, State, ZIP+4 Florida City, Florida 33034	
PS Form 3800, May 2000	
See Reverse for Instructions	

In the Matter of an
Application for Permit Renewal by:

Florida Power and Light Company
700 Universe Boulevard
Juno Beach, FL 33408

DRAFT Permit Project No.: 0250003-005-AV
Turkey Point Fossil Plant
Dade County

INTENT TO ISSUE TITLE V AIR OPERATION PERMIT RENEWAL

The Department of Environmental Protection (permitting authority) gives notice of its intent to issue a Title V Air Operation Permit Renewal (copy of DRAFT Permit attached) for the Title V source detailed in the application specified above, for the reasons stated below.

The applicant, Florida Power and Light Company, applied on July 3, 2003, to the permitting authority for a Title V Air Operation Permit Renewal for the Turkey Point Fossil Plant located at 9760 SW 344th Street, Florida City, Dade County.

The permitting authority has permitting jurisdiction under the provisions of Chapter 403, Florida Statutes (F.S.), and Florida Administrative Code (F.A.C.) Chapters 62-4, 62-210, 62-213, and 62-214. This source is not exempt from Title V permitting procedures. The permitting authority has determined that a Title V Air Operation Permit Renewal is required to commence or continue operations at the described facility.

The permitting authority intends to issue this Title V Air Operation Permit Renewal based on the belief that reasonable assurances have been provided to indicate that operation of the source will not adversely impact air quality, and the source will comply with all appropriate provisions of Chapters 62-4, 62-204, 62-210, 62-212, 62-213, 62-214, 62-256, 62-257, 62-281, 62-296, and 62-297, F.A.C.

Pursuant to Sections 403.815 and 403.087, F.S., and Rules 62-110.106 and 62-210.350(3), F.A.C., you (the applicant) are required to publish at your own expense the enclosed "PUBLIC NOTICE OF INTENT TO ISSUE TITLE V AIR OPERATION PERMIT RENEWAL." The notice shall be published one time only as soon as possible in the legal advertisement section of a newspaper of general circulation in the area affected. For the purpose of these rules, "publication in a newspaper of general circulation in the area affected" means publication in a newspaper meeting the requirements of Sections 50.011 and 50.031, F.S., in the county where the activity is to take place. If you are uncertain that a newspaper meets these requirements, please contact the permitting authority at the address or telephone number listed below. The applicant shall provide proof of publication to Department's Bureau of Air Regulation, 2600 Blair Stone Road, Mail Station #5505, Tallahassee, Florida 32399-2400 (Telephone: 850/488-0114; Fax: 850/922-6979), within 7 (seven) days of publication pursuant to Rule 62-110.106(5), F.A.C. Failure to publish the notice and provide proof of publication may result in the denial of the permit pursuant to Rule 62-110.106(11), F.A.C.

The permitting authority will issue the PROPOSED Permit, and subsequent FINAL Permit, in accordance with the conditions of the attached DRAFT Permit unless a response received in accordance with the following procedures results in a different decision or significant change of terms or conditions.

The permitting authority will accept written comments concerning the proposed permit issuance action for a period of 30 (thirty) days from the date of publication of the "PUBLIC NOTICE OF INTENT TO ISSUE TITLE V AIR OPERATION PERMIT RENEWAL." Written comments should be provided to the permitting authority office. Any written comments filed shall be made available for public inspection. If written comments received result in a significant change in this DRAFT Permit, the permitting authority shall issue a Revised DRAFT Permit and require, if applicable, another Public Notice.

A person whose substantial interests are affected by the proposed permitting decision may petition for an administrative hearing in accordance with Sections 120.569 and 120.57, F.S. The petition must contain the information set forth below and must be filed (received) in the Office of General Counsel of the Department of Environmental Protection, 3900 Commonwealth Boulevard, Mail Station #35, Tallahassee, Florida 32399-3000 (Telephone: 850/488-9730; Fax: 850/487-4938). Petitions filed by the permit applicant or any of the parties listed below must be filed within fourteen days of receipt of this notice of intent. Petitions filed by any persons other than those entitled to written notice under Section 120.60(3), F.S., must be filed within fourteen days of publication of the public notice or within fourteen days of receipt of this notice of intent, whichever occurs first. Under Section 120.60(3), F.S., however, any person who asked the permitting authority for notice of agency action may file a petition within fourteen days of receipt of that notice, regardless of the date of publication. A petitioner shall mail a copy of the petition to the applicant at the address indicated above, at the time of filing. The failure of any person to file a petition within the appropriate time period shall constitute a waiver of that person's right to request an administrative determination (hearing) under Sections 120.569 and 120.57, F.S., or to intervene in this proceeding and participate as a party to it. Any subsequent intervention will be only at the approval of the presiding officer upon the filing of a motion in compliance with Rule 28-106.205, F.A.C.

A petition that disputes the material facts on which the permitting authority's action is based must contain the following information:

(a) The name and address of each agency affected and each agency's file or identification number, if known;

(b) The name, address, and telephone number of the petitioner; the name, address and telephone number of the petitioner's representative, if any, which shall be the address for service purposes during the course of the proceeding; and an explanation of how the petitioner's substantial interests will be affected by the agency determination;

(c) A statement of how and when each petitioner received notice of the agency action or proposed action;

(d) A statement of all disputed issues of material fact. If there are none, the petition must so indicate;

(e) A concise statement of the ultimate facts alleged, as well as the rules and statutes which entitle the petitioner to relief;

(f) A statement of the specific rules or statutes the petitioner contends require reversal or modification of the agency's proposed action; and,

(g) A statement of the relief sought by the petitioner, stating precisely the action petitioner wishes the agency to take with respect to the agency's proposed action.

A petition that does not dispute the material facts upon which the permitting authority's action is based shall state that no such facts are in dispute and otherwise shall contain the same information as set forth above, as required by Rule 28-106.301, F.A.C.

Because the administrative hearing process is designed to formulate final agency action, the filing of a petition means that the permitting authority's final action may be different from the position taken by it in this notice of intent. Persons whose substantial interests will be affected by any such final decision of the permitting authority on the application have the right to petition to become a party to the proceeding, in accordance with the requirements set forth above.

Mediation will not be available in this proceeding.

In addition to the above, a person subject to regulation has a right to apply to the Department of Environmental Protection for a variance from or waiver of the requirements of particular rules, on certain conditions, under Section 120.542, F.S. The relief provided by this state statute applies only to state rules, not statutes, and not to any federal regulatory requirements. Applying for a variance or waiver does not substitute or extend the time for filing a petition for an administrative hearing or exercising any other right that a person may have in relation to the action proposed in this notice of intent.

The application for a variance or waiver is made by filing a petition with the Office of General Counsel of the Department of Environmental Protection, 3900 Commonwealth Boulevard, Mail Station #35, Tallahassee, Florida 32399-3000. The petition must specify the following information:

- (a) The name, address, and telephone number of the petitioner;
- (b) The name, address, and telephone number of the attorney or qualified representative of the petitioner, if any;
- (c) Each rule or portion of a rule from which a variance or waiver is requested;
- (d) The citation to the statute underlying (implemented by) the rule identified in (c) above;
- (e) The type of action requested;
- (f) The specific facts that would justify a variance or waiver for the petitioner;
- (g) The reason why the variance or waiver would serve the purposes of the underlying statute (implemented by the rule); and,
- (h) A statement whether the variance or waiver is permanent or temporary and, if temporary, a statement of the dates showing the duration of the variance or waiver requested.

The Department will grant a variance or waiver when the petition demonstrates both that the application of the rule would create a substantial hardship or violate principles of fairness, as each of those terms is defined in Section 120.542(2), F.S., and that the purpose of the underlying statute will be or has been achieved by other means by the petitioner.

Persons subject to regulation pursuant to any federally delegated or approved air program should be aware that Florida is specifically not authorized to issue variances or waivers from any requirements of any such federally delegated or approved program. The requirements of the program remain fully enforceable by the Administrator of the United States Environmental Protection Agency and by any person under the Clean Air Act unless and until the Administrator separately approves any variance or waiver in accordance with the procedures of the federal program.

Finally, pursuant to 42 United States Code (U.S.C.) Section 7661d(b)(2), any person may petition the Administrator of the EPA within 60 (sixty) days of the expiration of the Administrator's 45 (forty-five) day review period as established at 42 U.S.C. Section 7661d(b)(1), to object to issuance of any permit. Any petition shall be based only on objections to the permit that were raised with reasonable specificity during the 30 (thirty) day public comment period provided in this notice, unless the petitioner demonstrates to the Administrator of the EPA that it was impracticable to raise such objections within the comment period or unless the grounds for such objection arose after the comment period. Filing of a

DRAFT Permit No.: 0250003-005-AV

Page 4 of 5

petition with the Administrator of the EPA does not stay the effective date of any permit properly issued pursuant to the provisions of Chapter 62-213, F.A.C. Petitions filed with the Administrator of EPA must meet the requirements of 42 U.S.C. Section 7661d(b)(2) and must be filed with the Administrator of the EPA at: U.S. EPA, 401 M Street, S.W., Washington, D.C. 20460.

Executed in Tallahassee, Florida.

**STATE OF FLORIDA DEPARTMENT
OF ENVIRONMENTAL PROTECTION**



Trina Vielhauer, Chief
Bureau of Air Regulation

CERTIFICATE OF SERVICE

The undersigned duly designated deputy agency clerk hereby certifies that this INTENT TO ISSUE TITLE V AIR OPERATION PERMIT RENEWAL (including the PUBLIC NOTICE and the DRAFT Permit) and all copies were sent by certified mail before the close of business on 8/13/03 to the person(s) listed:

H.O. Nunez, Responsible Official, Turkey Point Fossil Plant

In addition, the undersigned duly designated deputy agency clerk hereby certifies that copies of this INTENT TO ISSUE TITLE V AIR OPERATION PERMIT RENEWAL (including the PUBLIC NOTICE and Statement of Basis) were sent by U.S. mail on the same date to the person(s) listed:

John C. Hampp, Florida Power and Light Company
Kennard F. Kosky, P.E., Golder Associates, Inc.

In addition, the undersigned duly designated deputy agency clerk hereby certifies that copies of this INTENT TO ISSUE TITLE V AIR OPERATION PERMIT RENEWAL (including the DRAFT Permit package) were sent by INTERNET E-mail on the same date to the person(s) listed:

Patrick Wong, Dade County DERM, AWQD
U.S. EPA, Region 4

8/13/03 cc: Bobby Bull
Reading Site
Thomas Site

Clerk Stamp

FILING AND ACKNOWLEDGMENT
FILED, on this date, pursuant to Section 120.52(7), Florida Statutes, with the designated agency Clerk, receipt of which is hereby acknowledged.

Barbara J. Sunday 8/13/03
(Clerk) (Date)

PUBLIC NOTICE OF INTENT TO ISSUE TITLE V AIR OPERATION PERMIT RENEWAL

STATE OF FLORIDA
DEPARTMENT OF ENVIRONMENTAL PROTECTION

DRAFT Permit Project No.: 0250003-005-AV
Turkey Point Power Plant
Dade County

The Department of Environmental Protection (permitting authority) gives notice of its intent to issue a Title V Air Operation Permit Renewal to Florida Power and Light Company for the Turkey Point Fossil Plant located at 9760 SW 344th Street, Florida City, Dade County. The applicant's name and address are: H.O. Nunez, Responsible Official, Florida Power and Light Company, 700 Universe Blvd., Juno Beach, FL, 33408.

The Turkey Point Title V Source is composed of two separate co-located power plants: the Fossil Plant and the Nuclear Plant. This permit, No. 0250003-005-AV, addresses only the operations at the Fossil Plant. The (non-nuclear) operations at the Nuclear Plant are addressed in a separate Title V permit, No. 0250003-004-AV.

The permitting authority will issue the PROPOSED Permit, and subsequent FINAL Permit, in accordance with the conditions of the DRAFT Permit unless a response received in accordance with the following procedures results in a different decision or significant change of terms or conditions.

The permitting authority will accept written comments concerning the proposed DRAFT Permit issuance action for a period of 30 (thirty) days from the date of publication of this Notice. Written comments should be provided to the Department's Bureau of Air Regulation, 2600 Blair Stone Road, Mail Station #5505, Tallahassee, Florida 32399-2400 (Telephone: 850/488-0114; Fax: 850/922-6979). Any written comments filed shall be made available for public inspection. If written comments received result in a significant change in this DRAFT Permit, the permitting authority shall issue a Revised DRAFT Permit and require, if applicable, another Public Notice.

A person whose substantial interests are affected by the proposed permitting decision may petition for an administrative hearing in accordance with Sections 120.569 and 120.57 of the Florida Statutes (F.S.). The petition must contain the information set forth below and must be filed (received) in the Office of General Counsel of the Department of Environmental Protection, 3900 Commonwealth Boulevard, Mail Station #35, Tallahassee, Florida 32399-3000 (Telephone: 850/488-9730; Fax: 850/487-4938). Petitions filed by any persons other than those entitled to written notice under Section 120.60(3), F.S., must be filed within fourteen days of publication of the public notice or within fourteen days of receipt of the notice of intent, whichever occurs first. Under Section 120.60(3), F.S., however, any person who asked the permitting authority for notice of agency action may file a petition within fourteen days of receipt of that notice, regardless of the date of publication. A petitioner shall mail a copy of the petition to the applicant at the address indicated above, at the time of filing. The failure of any person to file a petition within the applicable time period shall constitute a waiver of that person's right to request an administrative determination (hearing) under Sections 120.569 and 120.57, F.S., or to intervene in this proceeding and participate as a party to it. Any subsequent intervention will be only at the approval of the presiding officer upon the filing of a motion in compliance with Rule 28-106.205 of the Florida Administrative Code (F.A.C.).

A petition that disputes the material facts on which the permitting authority's action is based must contain the following information:

- (a) The name and address of each agency affected and each agency's file or identification number, if known;
- (b) The name, address and telephone number of the petitioner; name address and telephone number of the petitioner's representative, if any, which shall be the address for service purposes during the course of the proceeding; and an explanation of how petitioner's substantial rights will be affected by the agency determination;
- (c) A statement of how and when the petitioner received notice of the agency action or proposed action;
- (d) A statement of all disputed issues of material fact. If there are none, the petition must so state;
- (e) A concise statement of the ultimate facts alleged, as well as the rules and statutes which entitle petitioner to relief;
- (f) A statement of the specific rules or statutes the petitioner contends require reversal or modification of the agency's proposed action; and,

(g) A statement of the relief sought by the petitioner, stating precisely the action petitioner wishes the agency to take with respect to the agency's proposed action.

A petition that does not dispute the material facts upon which the permitting authority's action is based shall state that no such facts are in dispute and otherwise shall contain the same information as set forth above, as required by Rule 28-106.301, F.A.C.

Because the administrative hearing process is designed to formulate final agency action, the filing of a petition means that the permitting authority's final action may be different from the position taken by it in this notice of intent. Persons whose substantial interests will be affected by any such final decision of the permitting authority on the application have the right to petition to become a party to the proceeding, in accordance with the requirements set forth above.

Mediation is not available for this proceeding.

In addition to the above, pursuant to 42 United States Code (U.S.C.) Section 7661d(b)(2), any person may petition the Administrator of the EPA within 60 (sixty) days of the expiration of the Administrator's 45 (forty-five) day review period as established at 42 U.S.C. Section 7661d(b)(1), to object to issuance of any permit. Any petition shall be based only on objections to the permit that were raised with reasonable specificity during the 30 (thirty) day public comment period provided in this notice, unless the petitioner demonstrates to the Administrator of the EPA that it was impracticable to raise such objections within the comment period or unless the grounds for such objection arose after the comment period. Filing of a petition with the Administrator of the EPA does not stay the effective date of any permit properly issued pursuant to the provisions of Chapter 62-213, F.A.C. Petitions filed with the Administrator of EPA must meet the requirements of 42 U.S.C. Section 7661d(b)(2) and must be filed with the Administrator of the EPA at: U.S. EPA, 401 M Street, S.W., Washington, D.C. 20460.

A complete project file is available for public inspection during normal business hours, 8:00 a.m. to 5:00 p.m., Monday through Friday, except legal holidays, at:

Permitting Authority:

Department of Environmental Protection
Bureau of Air Regulation
111 South Magnolia Drive, Suite 4
Tallahassee, Florida 32301
Telephone: 850/488-0114
Fax: 850/922-6979

Affected District/Local Program:

Dade County Department of Environmental Resource Management
Air and Water Quality Division
33 SW Second Ave., Suite 900
Miami, FL 33130-6954

The complete project file includes the DRAFT Permit, the application for renewal, and the information submitted by the responsible official, exclusive of confidential records under Section 403.111, F.S. Interested persons may contact Scott M. Sheplak, P.E., at the above address, or call (850) 921-9532, for additional information.

Florida Power & Light
Turkey Point Fossil Plant
Facility ID No. 0250003
Dade County

Title V Air Operation Permit Renewal
DRAFT Permit No. 0250003-005-AV

Permitting Authority:

State of Florida
Department of Environmental Protection
Division of Air Resources Management
Bureau of Air Regulation
Title V Section

Mail Station #5505
2600 Blair Stone Road
Tallahassee, Florida 32399-2400

Telephone: 850/488-0114
Fax: 850/922-6979

Compliance Authority:


Dade County Department of Environmental Resources Management
33 Southwest Second Avenue, Suite 900
Miami, Florida 33130-1540

Telephone: 305/372-6925
Fax: 305/372-6954

Title V Air Operation Permit Renewal
DRAFT Permit No. 0250003-005-AV

TABLE OF CONTENTS

Section	Page
Placard Page	1
I. Facility Information	2
A. Facility Description	2
B. Summary of Emissions Unit ID Nos. and Brief Description	2
C. Relevant Documents	2
II. Facility-wide Conditions	3
III. Emissions Unit Conditions	6
A. (2) 440 MW Boilers	6
B. (5) 2.75 MW Diesel Generators	13
C. Common Conditions	15
IV. Acid Rain Part	21

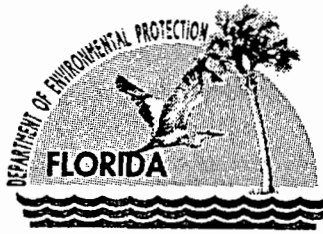

Jeb Bush
Governor

Department of Environmental Protection

Twin Towers Office Building
2600 Blair Stone Road
Tallahassee, Florida 32399-2400

David B. Struhs
Secretary

Permittee:

Florida Power & Light
Turkey Point Fossil Plant
700 Universe Boulevard
Juno Beach, Florida 33408

DRAFT Permit No. 0250003-005-AV

Facility ID No. 0250003

SIC Nos. 49, 4911

Project: Initial Title V Air Operation Permit

The purpose of this permit is for the operation of the Turkey Point Fossil Plant, and to renew Title V Air Operation Permit No. 0250003-001-AV. This facility is located at 9.5 miles east of Florida City on SW 344 Street, Florida City, Dade County; UTM Coordinates: Zone 17, 567.2 km East and 2813.2 km North; Latitude: 25° 26' 09" North and Longitude: 80° 19' 52" West.

This Title V Air Operation Permit Renewal is issued under the provisions of Chapter 403, Florida Statutes (F.S.), and Florida Administrative Code (F.A.C.) Chapters 62-4, 62-210, 62-213, and 62-214. The above named permittee is hereby authorized to operate the Turkey Point Fossil Plant as described in the application in accordance with the terms and conditions of this permit.

Referenced attachments made a part of this permit:

Appendix I-1, List of Insignificant Emissions Units and Activities

Appendix U-1, List of Unregulated Emissions Units and/or Activities

APPENDIX TV-4, TITLE V CONDITIONS (version dated 2/12/02)

APPENDIX SS-1, STACK SAMPLING FACILITIES (version dated 10/07/96)

TABLE 297.310-1, CALIBRATION SCHEDULE (version dated 10/07/96)

Figure 1 - SUMMARY REPORT - GASEOUS AND OPACITY EXCESS EMISSION AND
MONITORING SYSTEM REPORT (version dated 7/96)

Phase II Permit Application dated 7/03/03

Order of the Department's Secretary dated April 24, 1984

ASP Number 97-B-01

Effective Date: January 1, 2004

Renewal Application Due Date: July 5, 2008

Expiration Date: December 31, 2008

Michael G. Cooke, Director
Division of Air Resource Management

MC/sms/rlb

Section I. Facility Information

Subsection A. Facility Description

The Turkey Point Title V Source is composed of two separate co-located power plants: the Fossil Plant and the Nuclear Plant. This permit, No. 0250003-005-AV, addresses only the operations at the Fossil Plant. The (non-nuclear) operations at the Nuclear Plant are addressed in a separate permit, No. 0250003-004-AV.

The Fossil Plant consists of two fossil steam generating units, and five "Black Start" diesel peaking generators. The boilers began operation in 1967 and 1968. To reduce pollution, both boilers incorporate "low-NOx burners" and mechanical cyclone dust collectors. Also included in this permit are miscellaneous unregulated and insignificant emissions units and activities.

Based on the Title V Air Operation Permit Renewal application received July 3, 2003, this Title V Source is a major source of hazardous air pollutants (HAPs).

Subsection B. Summary of Emissions Unit ID Nos. and Brief Description

E.U. ID

<u>No.</u>	<u>Brief Description</u>
001	440 MW Boiler (EPA ID # PTP1)
002	440 MW Boiler (EPA ID # PTP2)
003	(5) 2.75 MW Diesel Peaking Generators
004	Unregulated Emissions Units and Activities (See Appendix U-1.)

Please reference the Permit No., Facility ID No., and appropriate Emissions Unit(s) ID No(s) on all correspondence, test report submittals, applications, etc.

Subsection C. Relevant Documents

The documents listed below are not a part of this permit; however, they are specifically related to this permitting action.

These documents are provided to the permittee for information purposes only:

Table 1-1, Summary of Air Pollutant Standards and Terms
Table 2-1, Summary of Compliance Requirements
Appendix A-1, Abbreviations, Acronyms, Citations, and Identification Numbers
Appendix H-1, Permit History/ID Number Changes
Statement of Basis

These documents are on file with the permitting authority:

Title V Permit Renewal Application received July 3, 2003

Section II. Facility-wide Conditions

The following conditions apply facility-wide:

1. APPENDIX TV-4, TITLE V CONDITIONS, is a part of this permit.

{Permitting note: APPENDIX TV-4, TITLE V CONDITIONS, is distributed to the permittee only. Other persons requesting copies of these conditions shall be provided a copy when requested or otherwise appropriate.}

2. **Not Federally Enforceable. General Pollutant Emission Limiting Standards. Objectionable Odor Prohibited.** The permittee shall not cause, suffer, allow, or permit the discharge of air pollutants which cause or contribute to an objectionable odor.

[Rule 62-296.320(2), F.A.C.]

3. **General Particulate Emission Limiting Standards. General Visible Emissions Standard.**

Except for emissions units that are subject to a particulate matter or opacity limit set forth or established by rule and reflected by conditions in this permit, no person shall cause, let, permit, suffer or allow to be discharged into the atmosphere the emissions of air pollutants from any activity, the density of which is equal to or greater than that designated as Number 1 on the Ringelmann Chart (20 percent opacity). EPA Method 9 is the method of compliance pursuant to Chapter 62-297, F.A.C.

[Rule 62-296.320(4)(b)1. & 4., F.A.C.]

4. **Prevention of Accidental Releases (Section 112(r) of CAA).**

a. The permittee shall submit its Risk Management Plan (RMP) to the Chemical Emergency Preparedness and Prevention Office (CEPPO) PMP Reporting Center when, and if, such requirement becomes applicable. Any Risk Management Plans, original submittals, revisions, or updates to submittals, should be sent to

RMP Reporting Center
Post Office Box 3346
Merrifield, VA 22116-3346
Telephone: 703/816-4434

b. The Permittee shall submit to the permitting authority Title V certification forms or a compliance schedule in accordance with Rule F.A.C. 62-213.440(2), F.A.C.

[40 CFR 68]

5. **Unregulated Emissions Units and/or Activities.** Appendix U-1, List of Unregulated Emissions Units and Activities, is a part of this permit.

[Rule 62-213.440(1), F.A.C.]

6. **Insignificant Emissions Units and Activities.** Appendix I-1, List of Insignificant Emissions Units and Activities, is a part of this permit.

[Rules 62-213.440(1), 62-213.430(6), and 62-4.040(1)(b), F.A.C.]

7. **General Pollutant Emission Limiting Standards. Volatile Organic Compounds (VOC) Emissions or Organic Solvents (OS) Emissions.** The permittee shall allow no person to store,

pump, handle, process, load, unload or use in any process or installation, volatile organic compounds (VOC) or organic solvents (OS) without applying known and existing vapor emission control devices or systems deemed necessary and ordered by the Department.
[Rule 62-296.320(1)(a), F.A.C.]

8. Not Federally Enforceable. Reasonable precautions to prevent emissions of unconfined particulate matter at this facility include:

1. Paving of roads, parking areas and equipment yards;
2. Landscaping and planting vegetation;
3. Maintenance of paved areas;
4. Regular mowing of grass and care of vegetation;
5. Limiting access to plant property by unnecessary vehicles;
6. Bagged chemical products are stored in weather-tight buildings until they are used. Spills of powdered chemical products are cleaned up as soon as possible.
7. Vehicles are restricted to slow speeds on the plant site.

[Rule 62-296.320(4)(c)2., F.A.C.; Proposed by applicant in the initial Title V permit application received June 12, 1996]

9. When appropriate, any recording, monitoring, or reporting requirements that are time-specific shall be in accordance with the effective date of the permit, which defines day one.

[Rule 62-213.440. F.A.C.]

10. Statement of Compliance. The annual statement of compliance pursuant to Rule 62-213.440(3), F.A.C., shall be submitted to the Department and EPA within 60 (sixty) days after the end of the calendar year using DEP Form No. 62-213.900(7), F.A.C. [Rules 62-213.440(3) and 62-213.900, F.A.C.]

{Permitting Note: This condition implements the requirements of Rules 62-213.440(3)(a)2. & 3., F.A.C. (see Condition 51. of APPENDIX TV-4, TITLE V CONDITIONS)}

11. The permittee shall submit all compliance, annual operating reports and other correspondence required of this permit to:

Dade County Department of Environmental Resources Management (DERM)
33 Southwest Second Avenue, Suite 900
Miami, Florida 33130-1540
Telephone: 305/372-6925
Fax: 305/372-6954

Note: if acceptable to the agency, applicable correspondence may be submitted by electronic mail.

12. Unless otherwise directed, reports, data, notification, certifications, or other correspondence required of the United States Environmental Protection Agency should be sent to:

United States Environmental Protection Agency
Region 4
Air, Pesticides, & Toxics Management Division

Operating Permits Section
61 Forsyth Street
Atlanta, Georgia 30303-8960
Telephone: 404/562-9155
Fax: 404/562-9163

Note: if acceptable to the agency, applicable correspondence may be submitted by electronic mail.

13. Certification by Responsible Official (R.O.). In addition to the professional engineering certification required for applications by Rule 62-4.050(3), F.A.C., any application form, report, compliance statement, compliance plan and compliance schedule submitted pursuant to Chapter 62-213, F.A.C., shall contain a certification signed by a responsible official that, based on information and belief formed after reasonable inquiry, that statements and information in the document are true, accurate, and complete. Any responsible official who fails to submit any required information or who has submitted incorrect information shall, upon becoming aware of such failure or incorrect submittal, promptly submit such supplementary information or correct information.

[Rule 62-213.420(4), F.A.C.]

Section III. Emissions Units and Conditions

Subsection A.

<u>E.U. ID No.</u>	<u>Brief Description</u>
001	440 MW Boiler (EPA ID # PTP1)
002	440 MW Boiler (EPA ID # PTP2)

Emissions units 001 and 002 consist of two Foster-Wheeler 400 MW Class (440 MW gross capacity) Steam Generating Units that burn a variable combination of natural gas, used oil from FP&L operations, No. 6 and No. 2 fuel oils, and propane. Power ratings are nominal and are not limiting of either unit. The height of each of the two stacks is 400 feet. Each unit is equipped with low excess air burners and UOP Air Correction Division multiple cyclones with reinjection. Visible emissions are monitored by a transmissometer in each stack. The units are subject to NOx RACT. Sulfur dioxide, carbon dioxide, nitrogen oxides, visible emissions, and gas flow rate are all continuously monitored. Unit 001 began commercial operation in April 1967; unit 002 in April 1968.

{Permitting note: The emissions units are regulated under Acid Rain-Phase II, Fossil Fuel Steam Generators with more than 250 million Btu per Hour Heat Input - Rule 62-296.405, F.A.C., and RACT Requirements for Major VOC- and NOx-Emitting Facilities - Rule 62-296.570, F.A.C.}

The following specific conditions apply to the emissions units listed above:

Essential Potential to Emit (PTE) Parameters

A.1. Permitted Capacity. For each emissions unit, the maximum heat input (mmBtu per Hour) shall not exceed 4,025 mmBtu per hour while firing natural gas, or 3,850 mmBtu per hour while firing fuel oil. If a blend of fuels is fired, the heat input shall be prorated based on the percent heat input of each fuel. Power ratings are nominal and are not limiting of either unit.

[Rules 62-4.160(2) and 62-210.200(PTE), F.A.C.]

{Permitting note: The heat input limitations have been placed in each permit to identify the capacity of each unit for the purposes of confirming that emissions testing is conducted within 90 to 100 percent of the unit's rated capacity (or to limit future operation to 110 percent of the test load), to establish appropriate emission limits and to aid in determining future rule applicability.}

A.2. Emissions Unit Operating Rate Limitation After Testing. See specific condition C.6.

[Rule 62-297.310(2), F.A.C.]

A.3. Methods of Operation - Fuels The only fuels allowed to be burned are new No. 2 fuel oil, new No. 6 residual oil, natural gas, propane, and on-specification used oil generated exclusively from FPL operations.

The used oil shall comply with the requirements given in specific condition A.22. Additionally, no more than 750,000 gallons shall be burned annually.

Magnesium hydroxide fuel additives are authorized to be added to the boiler units as needed to enhance combustion and facilitate furnace cleaning in a manner consistent with Best Operational Practices.

[Rule 62-4.160(2), 62-210.200, 62-213.440(1), F.A.C., AO13-238939, AO13-238932]

A.4. Hours of Operation. The emissions units may operate continuously, i.e., 8,760 hours per year. [Rule 62-210.200(PTE), F.A.C.]

Emission Limitations and Standards

{Permitting note: Table 1-1, Summary of Air Pollutant Standards and Terms, summarizes information for convenience purposes only. This table does not supersede any of the terms or conditions of this permit.}

{Permitting Note: Unless otherwise specified, the averaging time(s) for Specific Conditions A.5.-A.10. are based on the specified averaging time of the applicable test method.}

A.5. Visible Emissions. Visible emissions shall not exceed 40 percent opacity. Emissions units governed by this visible emissions standard shall compliance test for particulate matter and visible emissions annually.

[Rule 62-296.405(1)(a), F.A.C.; and, authorized by Order of the Department's Secretary dated April 24, 1984.]

A.6. Visible Emissions - Soot Blowing and Load Change. Visible emissions shall not exceed 60 percent opacity during the 3-hours in any 24 hour period of excess emissions allowed for boiler cleaning (soot blowing) and load change. Additionally, visible emissions above 60 percent opacity shall be allowed for not more than four, six minute periods, during the 3-hour period of excess emissions.

A load change occurs when the operational capacity of a unit is in the 10 percent to 100 percent capacity range, other than startup or shutdown, which exceeds 10 percent of the unit's rated capacity and which occurs at a rate of 0.5 percent per minute or more.

[Rule 62-210.700(3), F.A.C.]

A.7. Particulate Matter. Particulate matter emissions shall not exceed 0.1 pound per million Btu heat input, as measured by applicable compliance methods.

[Rule 62-296.405(1)(b), F.A.C.]

A.8. Particulate Matter - Soot Blowing and Load Change. Particulate matter emissions shall not exceed an average of 0.3 pound per million Btu heat input during the 3 hours in any 24-hour period of excess emissions allowed for boiler cleaning (soot blowing) and load change.

[Rule 62-210.700(3), F.A.C.]

A.9. Sulfur Dioxide. Sulfur dioxide emissions shall not exceed 1.1 pounds per million Btu heat input, as measured by applicable compliance methods. Compliance shall be based on the total heat input from all liquid and gaseous fuels burned. The sulfur dioxide emission limitation shall

apply at all times including startup, shutdown, and load change. See specific condition A.13. [Rules 62-213.440, F.A.C., and AO13-238939 and AO13-238932, Dade County Code Section 24-17]

A.10. Nitrogen Oxides. NOx emissions from each boiler stack shall not exceed the following limits based on a 30-day rolling average:

	<u>Natural Gas</u>	<u>Fuel Oil</u>
lbs./mmBtu	0.40	0.53
lbs./hour	1,610	2,041

These limits shall apply at all times except during periods of startup, shutdown, or malfunction as provided by Rule 62-210.700, F.A.C. Compliance shall be based on the use of a CEMS. See specific condition A.14.

[Rule 62-296.570(4)(b)2, and (c), F.A.C.]

Monitoring and Testing Requirements

{Permitting Note: The attached Table 2-1, Summary of Compliance Requirements, summarizes information for convenience purposes only. This table does not supersede any of the terms or conditions of this permit.}

A.11. Visible Emissions. The test method for visible emissions shall be DEP Method 9, incorporated in Chapter 62-297, F.A.C. A transmissometer may be used and calibrated according to Rule 62-297.520, F.A.C. See specific condition A.12.

[Rule 62-296.405(1)(e)1., F.A.C.]

A.12. DEP Method 9. The provisions of EPA Method 9 (40 CFR 60, Appendix A) are adopted by reference with the following exceptions:

1. EPA Method 9, Section 2.4, Recording Observations. Opacity observations shall be made and recorded by a certified observer at sequential fifteen second intervals during the required period of observation.
2. EPA Method 9, Section 2.5, Data Reduction. For a set of observations to be acceptable, the observer shall have made and recorded, or verified the recording of, at least 90 percent of the possible individual observations during the required observation period. For single-valued opacity standards (e.g., 20 percent opacity), the test result shall be the highest valid six-minute average for the set of observations taken. For multiple-valued opacity standards (e.g., 20 percent opacity, except that an opacity of 40 percent is permissible for not more than two minutes per hour) opacity shall be computed as follows:
 - a. For the basic part of the standard (i.e., 20 percent opacity) the opacity shall be determined as specified above for a single-valued opacity standard.
 - b. For the short-term average part of the standard, opacity shall be the highest valid short-term average (i.e., two-minute, three-minute average) for the set of observations taken.

In order to be valid, any required average (i.e., a six-minute or two-minute average) shall be based on all of the valid observations in the sequential subset of observations selected, and the selected subset shall contain at least 90 percent of the observations possible for the required

averaging time. Each required average shall be calculated by summing the opacity value of each of the valid observations in the appropriate subset, dividing this sum by the number of valid observations in the subset, and rounding the result to the nearest whole number. The number of missing observations in the subset shall be indicated in parenthesis after the subset average value. [Rule 62-297.401, F.A.C.]

A.13. Sulfur Dioxide. The permittee shall demonstrate compliance with the sulfur dioxide limit of specific condition A.9 of this permit by the following:

a. Through the use of CEMS installed, operated, and maintained in accordance with the quality assurance requirements of 40 CFR 75, adopted and incorporated by reference in Rule 62-204.800 F.A.C. A relative accuracy test audit of the SO₂ CEMS shall be conducted at least annually. Compliance shall be demonstrated on a 3-hour rolling average.

b. In the event the CEMS becomes temporarily inoperable or interrupted, the fuel oil sulfur content and the maximum fuel oil to natural gas firing ratio is limited to that which was last used to demonstrate compliance prior to the loss of the CEMS. Alternatively, the boilers may fire 100 percent fuel oil with a maximum sulfur content of 1.0 percent by weight, or less or 100 percent natural gas. See specific condition A.18.

[Rule 62-204.800, 62-213.440, 62-296.405(1)(c)3., F.A.C., AO13-238932, AO13-238939]

A.14. Nitrogen Oxides. The permittee shall operate, maintain, and calibrate a CEMS to determine compliance with the NO_x emission limits as specified above. Determination of compliance shall be in accordance with the testing, compliance, emission monitoring, reporting, recordkeeping, certification and quality assurance provisions of 40 CFR 75.

[Rule 62-296.405(1)(f), F.A.C., AO13-238939, AO13-238932]

A.15. Particulate Matter. The test methods for particulate emissions shall be EPA Methods 17, 5, 5B, or 5F, incorporated by reference in Chapter 62-297, F.A.C. The minimum sample volume shall be 30 dry standard cubic feet. EPA Method 5 may be used with filter temperature no more than 320 degrees Fahrenheit. For EPA Method 17, stack temperature shall be less than 375 degrees Fahrenheit. The owner or operator may use EPA Method 5 to demonstrate compliance. EPA Method 3 or 3A with Orsat analysis shall be used when the oxygen based F-factor, computed according to EPA Method 19, is used in lieu of heat input. Acetone wash shall be used with EPA Method 5 or 17.

[Rules 62-213.440, 62-296.405(1)(e)2., and 62-297.401, F.A.C.]

A.16. By this permit, annual emissions compliance testing for visible emissions is not required for these emissions units while burning:

- a. only gaseous fuel(s); or
- b. gaseous fuel(s) in combination with any amount of liquid fuel(s) for less than 400 hours per year; or
- c. only liquid fuel(s) for less than 400 hours per year.

[Rule 62-297.310(7)(a)4., F.A.C.]

A.17. Annual and permit renewal compliance testing for particulate matter emissions is not required for these emissions units while burning:

- a. only gaseous fuel; or
- b. gaseous fuel in combination with any amount of liquid fuel for less than 400 hours per year; or
- c. only liquid fuel for less than 400 hours per year.

[Rules 62-297.310(7)(a)3. & 5., F.A.C.; and, ASP Number 97-B-01.]

A.18. Operating Conditions During Testing - PM and VE. Compliance testing during sootblowing and steady-state operation for particulate matter and visible emissions shall be conducted at least once annually, if liquid fuel is fired for more than 400 hours. A visible emissions test shall be conducted during one run of each particulate matter test. Testing shall be conducted as follows:

- a. **When Burning Fuel Oil Up To 1% Sulfur.** When only fuel oil containing less than or equal to 1% sulfur, by weight, is fired (or co-fired with natural gas) in an emissions unit, particulate matter and visible emissions tests during sootblowing and steady-state operation shall be performed on such emissions unit while firing solely fuel oil containing at least 90% of the average sulfur content of the fuel oils fired in the previous 12 month period, except that such test shall not be required to be performed during any year that testing is performed in accordance with specific condition A.18.b.
- b. **When Burning Fuel Oil Greater Than 1% Sulfur.** When fuel oil containing greater than 1% sulfur, by weight, is co-fired with natural gas in an emissions unit, particulate matter and visible emissions tests during sootblowing and steady-state operation shall be performed as soon as practicable, but in no event more than 60 days after firing such fuel oil, while co-firing such oil with the appropriate proportion of natural gas required to maintain SO₂ emissions between 90 to 100% of the SO₂ emission limit (corresponding to 0.99 and 1.1 lb/mmBtu heat input). Following successful completion of such PM and VE testing, further PM and VE testing shall not be required during the next 12 months unless fuel oil is fired that contains greater than 0.20% sulfur above the percentage sulfur concentration fired during the most recent co-firing test. If fuel oil is co-fired containing greater than 0.20% sulfur above the percentage sulfur concentration fired during the most recent co-firing test, additional PM and VE tests shall be performed as described above as soon as practicable, but in no event more than 60 days after firing such higher sulfur fuel oil.

[Rules 62-4.070(3), 62-213.440, 62-296.405(1)(c)3. and 62-297.310(7)(a)9., F.A.C.]

A.19. Testing While Injecting Additives. The owner or operator shall conduct emission tests while injecting additives consistent with normal operating practices.

[Rule 62-213.440, F.A.C., applicant agreement with EPA on March 3, 1998]

Recordkeeping and Reporting Requirements

A.20. Fuel Records and Sampling Protocol. In conjunction with specific condition A.13.(b), when the CEMS becomes disabled for periods exceeding 60 minutes, the following information shall be collected:

- a. **Fuel Records.** For each boiler, the quantity of fuel(s) fired or when co-firing, the ratio of fuel oil to natural gas shall be recorded.

b. Sampling Protocol. A fuel oil sample shall be collected hourly, by taking a small portion of the fuel fired and pouring it into a container. On a daily basis the fuel oil from this container shall be analyzed for heating value and sulfur content. Analysis for sulfur content shall be performed using one of the following: ASTM D2622-94, ASTM D4294-90(95), ASTM D1552-95, ASTM D1266-91, both ASTM D4057-88 and ASTM D129-95, or the latest edition(s). [Rules 62-4.070(3), 62-213.410, 62-213.440 and 62-296.405(1)(c)3., F.A.C.]

A.21. COMS for Periodic Monitoring. The owner or operator is required to install continuous opacity monitoring systems (COMS) pursuant to 40 CFR Part 75. The owner or operator shall maintain and operate COMS and shall make and maintain records of opacity measured by the COMS, for purposes of periodic monitoring. [Rule 62-213.440, F.A.C., and applicant agreement with EPA on March 3, 1998]

Miscellaneous Conditions

A.22. Used Oil. Burning of on-specification used oil is allowed by these emissions units in accordance with all other conditions of this permit and the following conditions:

a. On-specification Used Oil Emissions Limitations: This emissions unit is permitted to burn on-specification used oil, which contains a PCB concentration of less than 50 ppm. On-specification used oil is defined as used oil that meets the specifications of 40 CFR 279 - Standards for the Management of Used Oil, listed below. "Off-specification" used oil shall not be burned. Used oil which fails to comply with any of these specification levels is considered "off-specification" used oil.

CONSTITUENT/PROPERTY	ALLOWABLE LEVEL
Arsenic	5 ppm maximum
Cadmium	2 ppm maximum
Chromium	10 ppm maximum
Lead	100 ppm maximum
Total Halogens	1000 ppm maximum
Flash point	100 degrees F minimum

b. Quantity Limitation: This emissions unit is permitted to burn "on-specification" used oil that is generated by FP&L in the production and distribution of electricity, not to exceed 750,000 gallons during any consecutive 12 month period.

c. PCB Limitation: Used oil containing a PCB concentration of 50 or more ppm shall not be burned at this facility. Used oil shall not be blended to meet this requirement.

d. Operational Requirements: On-specification used oil with a PCB concentration of greater than or equal to 2, and less than 50 ppm shall be burned only at normal source operating temperatures. On-specification used oil with a PCB concentration of greater than or equal to 2 ppm shall not be burned during periods of startup or shutdown.

e. Testing Requirements: The owner or operator shall sample and analyze each batch of used oil to be burned for the following parameters:

Arsenic, cadmium, chromium, lead, total halogens, flash point and PCBs.

Testing (sampling, extraction and analysis) shall be performed using approved methods specified in EPA Publication SW-846 (Test Methods for Evaluating Solid Waste, Physical/Chemical Methods).

f. Record Keeping Requirements: The owner or operator shall obtain, make, and keep the following records related to the use of used oil in a form suitable for inspection at the facility by the Department:

(1) The gallons of on-specification used oil generated and burned each month. (This record shall be completed no later than the fifteenth day of the succeeding month.)

(2) The total gallons of on-specification used oil burned in the preceding consecutive 12-month period. (This record shall be completed no later than the fifteenth day of the succeeding month.)

(3) Results of the analyses required above.

g. Reporting Requirements: The owner or operator shall submit to DERM, within thirty days of the end of each calendar quarter, the analytical results and the total amount of on-specification used oil generated and burned during the quarter.

The owner or operator shall submit, with the Annual Operation Report form, the analytical results and the total amount of on-specification used oil burned during the previous calendar year.

[Rule 62-4.070(3) and 62-213.440, F.A.C., 40 CFR 279 and 40 CFR 761, unless otherwise noted.]

A.23. Additionally, all conditions of Subsection C. apply to these emissions units.

Subsection B.

E.U. ID

<u>No.</u>	<u>Brief Description</u>
003	(5) 2.75 MW Diesel Generators

This emissions unit consists of five MKW Powersystems, Inc. Model EMD MP-45 "black start" emergency diesel generators. The generators support boilers 001 and 002 as "peaking units", and, in the event the facility loses primary power, they serve as a backup. These units fire No. 2 fuel oil. The emissions from the generators are limited by the fuel type. The units commenced operation in April, 1968.

{Permitting note: These units are regulated under Reasonably Available Control Technology (RACT) - Requirements for Major VOC- and NOx-Emitting Facilities Rule 62-297.570, F.A.C.}

Essential Potential to Emit (PTE) Parameters

B.1. Permitted Capacity. The maximum heat input to each generator shall not exceed 24.89 mmBtu per hour.

[Rule 62-4.160(2), F.A.C. and Rule 62-210.200, F.A.C., Definitions - (PTE) and 62-296.405, F.A.C.]

{Permitting note: The heat input limitations have been placed in each permit to identify the capacity of each unit for the purposes of confirming that emissions testing is conducted within 90 to 100 percent of the unit's rated capacity (or to limit future operation to 110 percent of the test load), to establish appropriate emission limits and to aid in determining future rule applicability.}

B.2. Emissions Unit Operating Rate Limitation After Testing. See specific condition C.6.

B.3. Methods of Operation - Fuels. The only fuel authorized to be burned in this unit is new No. 2 fuel oil. The sulfur content shall not exceed 0.5 percent by weight.

[Rules 62-4.160(2), 62-210.200, and 62-213.440(1), F.A.C., and requested by applicant.]

B.4. Hours of Operation. The generators may operate continuously, i.e., 8,760 hours per year.

[Rule 62-210.200, F.A.C.]

Emission Limitations and Standards

{Permitting note: Table 1-1, Summary of Air Pollutant Standards and Terms, summarizes information for convenience purposes only. This table does not supersede any of the terms or conditions of this permit.}

{Permitting Note: Unless otherwise specified, the averaging time(s) for Specific Conditions B.5.-B.6. are based on the specified averaging time of the applicable test method.}

B.5. Visible Emissions. Visible emissions shall not exceed 20 percent opacity.

[Rule 62-296.320(4)(b)1., F.A.C.]

B.6. Nitrogen Oxides. NOx emissions shall not exceed 4.75 lb per million Btu heat input. These limits shall apply at all times except during periods of startup, shutdown, or malfunction as provided by Rule 62-210.700, F.A.C.

[Rule 62-296.570(4)(b)7. and (c), F.A.C.]

Test Methods and Procedures

{Permitting Note: The attached Table 2-1, Summary of Compliance Requirements, summarizes information for convenience purposes only. This table does not supersede any of the terms or conditions of this permit.}

B.7. Visible Emissions: The test method for visible emissions shall be EPA Method 9, incorporated and adopted by reference in Chapter 62-297, F.A.C.

[Rule 62-297.310(7)(a), F.A.C.]

B.8. NOx Emissions: For units that are not equipped with a continuous emissions monitoring system (CEMS) for NOx, compliance with the emissions testing in accordance with applicable EPA Reference Methods from Rule 62-297.401, F.A.C., or other methods approved by the Department in accordance with the requirements of Rule 62-297.620, F.A.C., except as otherwise provided in Rule 62-296.570(4)(b), F.A.C. Annual emission testing shall be conducted during each federal fiscal year (October 1 - September 30). *Annual compliance testing for NOx while firing oil is unnecessary for units operating less than 400 hours in the current federal fiscal year.*

[Rule 62-296.570(4)(a)3., F.A.C.]

B.9. The test method for NOx shall be EPA Method 7 or 7E, incorporated and adopted by reference in Chapter 62-297, F.A.C.

[Rules 62-296.570(4)(a)3. and 62-297.401(7), F.A.C.]

B.10. Additionally, all conditions of Subsection C. apply to this emissions unit.

Subsection C. Common Conditions

This section contains conditions applicable to the emissions units described in Subsections A. and B.

Excess Emissions

C.1. Excess emissions resulting from malfunction shall be permitted provided that best operational practices to minimize emissions are adhered to and the duration of excess emissions shall be minimized but in no case exceed two hours in any 24 hour period unless specifically authorized by the Department for longer duration.

[Rule 62-210.700(1), F.A.C.]

C.2. Excess emissions resulting from startup or shutdown shall be permitted provided that best operational practices to minimize emissions are adhered to and the duration of excess emissions shall be minimized.

[Rule 62-210.700(2), F.A.C.]

C.3. Excess emissions which are caused entirely or in part by poor maintenance, poor operation, or any other equipment or process failure which may reasonably be prevented during startup, shutdown or malfunction shall be prohibited.

[Rule 62-210.700(4), F.A.C.]

Monitoring of Operations

C.4. Determination of Process Variables.

(a) **Required Equipment.** The owner or operator of an emissions unit for which compliance tests are required shall install, operate, and maintain equipment or instruments necessary to determine process variables, such as process weight input or heat input, when such data are needed in conjunction with emissions data to determine the compliance of the emissions unit with applicable emission limiting standards.

(b) **Accuracy of Equipment.** Equipment or instruments used to directly or indirectly determine process variables, including devices such as belt scales, weight hoppers, flow meters, and tank scales, shall be calibrated and adjusted to indicate the true value of the parameter being measured with sufficient accuracy to allow the applicable process variable to be determined within 10% of its true value.

[Rule 62-297.310(5), F.A.C.]

Test Methods and Procedures

C.5. Required Number of Test Runs. For mass emission limitations, a compliance test shall consist of three complete and separate determinations of the total air pollutant emission rate through the test section of the stack or duct and three complete and separate determinations of any applicable process variables corresponding to the three distinct time periods during which the stack emission rate was measured provided, however, that three complete and separate determinations shall not be

required if the process variables are not subject to variation during a compliance test, or if three determinations are not necessary in order to calculate the unit's emission rate. The three required test runs shall be completed within one consecutive five day period. In the event that a sample is lost or one of the three runs must be discontinued because of circumstances beyond the control of the owner or operator, and a valid third run cannot be obtained within the five day period allowed for the test, the Secretary or his or her designee may accept the results of the two complete runs as proof of compliance, provided that the arithmetic mean of the results of the two complete runs is at least 20 percent below the allowable emission limiting standards.

[Rule 62-297.310(1), F.A.C.]

C.6. Operating Rate During Testing. Testing of emissions shall be conducted with each emissions unit operating at permitted capacity, which is defined as 90 to 100 percent of the maximum operation rate allowed by the permit. If it is impracticable to test at permitted capacity, an emissions unit may be tested at less than the permitted capacity; in this case, subsequent emissions unit operation is limited to 110 percent of the test load until a new test is conducted. Once the emissions unit is so limited, operation at higher capacities is allowed for no more than 15 consecutive days for the purpose of additional compliance testing to regain the authority to operate at the permitted capacity.

[Rules 62-297.310(2) & (2)(b), F.A.C.]

C.7. Calculation of Emission Rate. The indicated emission rate or concentration shall be the arithmetic average of the emission rate or concentration determined by each of the separate test runs unless otherwise specified in a particular test method or applicable rule.

[Rule 62-297.310(3), F.A.C.]

C.8. Applicable Test Procedures.

(a) **Required Sampling Time.**

1. Unless otherwise specified in the applicable rule, the required sampling time for each test run shall be no less than one hour and no greater than four hours, and the sampling time at each sampling point shall be of equal intervals of at least two minutes.

2. **Opacity Compliance Tests.** When either EPA Method 9 or DEP Method 9 is specified as the applicable opacity test method, the required minimum period of observation for a compliance test shall be sixty (60) minutes for emissions units which emit or have the potential to emit 100 tons per year or more of particulate matter, and thirty (30) minutes for emissions units which have potential emissions less than 100 tons per year of particulate matter and are not subject to a multiple-valued opacity standard. The opacity test observation period shall include the period during which the highest opacity emissions can reasonably be expected to occur. Exceptions to these requirements are as follows:

a. (Not applicable.)

b. (Not applicable.)

c. The minimum observation period for opacity tests conducted by employees or agents of the Department to verify the day-to-day continuing compliance of a unit or activity with an applicable opacity standard shall be twelve minutes.

- (b) Minimum Sample Volume. Unless otherwise specified in the applicable rule, the minimum sample volume per run shall be 25 dry standard cubic feet.
- (c) Required Flow Rate Range. For EPA Method 5 particulate sampling, acid mist/sulfur dioxide, and fluoride sampling which uses Greenburg Smith type impingers, the sampling nozzle and sampling time shall be selected such that the average sampling rate will be between 0.5 and 1.0 actual cubic feet per minute, and the required minimum sampling volume will be obtained.
- (d) Calibration of Sampling Equipment. Calibration of the sampling train equipment shall be conducted in accordance with the schedule shown in Table 297.310-1. (See attachment).
- (e) Allowed Modification to EPA Method 5. When EPA Method 5 is required, the following modification is allowed: the heated filter may be separated from the impingers by a flexible tube. [Rule 62-297.310(4), F.A.C.]

C.9. Required Stack Sampling Facilities. When a mass emissions stack test is required, the permittee shall comply with the requirements contained in Appendix SS-1, Stack Sampling Facilities, attached to this permit.
[Rule 62-297.310(6), F.A.C.]

C.10. Frequency of Compliance Tests. The following provisions apply only to those emissions units that are subject to an emissions limiting standard for which compliance testing is required.

(a) General Compliance Testing.

1. (Not applicable.)
2. For excess emission limitations for particulate matter specified in Rule 62-210.700, F.A.C., a compliance test shall be conducted annually while the emissions unit is operating under soot blowing conditions in each federal fiscal year during which soot blowing is part of normal emissions unit operation, except that such test shall not be required in any federal fiscal year in which a fossil fuel steam generator does not burn liquid fuel for more than 400 hours other than during startup.
3. The owner or operator of an emissions unit that is subject to any emission limiting standard shall conduct a compliance test that demonstrates compliance with the applicable emission limiting standard prior to obtaining a renewed operation permit. Emissions units that are required to conduct an annual compliance test may submit the most recent annual compliance test to satisfy the requirements of this provision. In renewing an air operation permit pursuant to Rule 62-210.300(2)(a)3.b., c., or d., F.A.C., the Department shall not require submission of emission compliance test results for any emissions unit that, during the year prior to renewal:
 - a. Did not operate; or
 - b. In the case of a fuel burning emissions unit, burned liquid fuel for a total of no more than 400 hours.
4. During each federal fiscal year (October 1 - September 30), unless otherwise specified by rule, order, or permit, the owner or operator of each emissions unit shall have a formal compliance test conducted for:
 - a. Visible emissions, if there is an applicable standard;
 - b. Each of the following pollutants, if there is an applicable standard, and if the emissions unit emits or has the potential to emit: 5 tons per year or more of lead or

- lead compounds measured as elemental lead; 30 tons per year or more of acrylonitrile; or 100 tons per year or more of any other regulated air pollutant; and
- c. Each NESHAP pollutant, if there is an applicable emission standard.
5. An annual compliance test for particulate matter emissions shall not be required for any fuel burning emissions unit that, in a federal fiscal year, does not burn liquid fuel, other than during startup, for a total of more than 400 hours.
6. (Not applicable.)
7. (Not applicable.)
8. (Not applicable.)
9. (See Specific Condition C.14.)
10. An annual compliance test conducted for visible emissions shall not be required for units exempted from permitting at Rule 62-210.300(3)(a), F.A.C., or units permitted under the General Permit provisions at Rule 62-210.300(4), F.A.C.

(b) Special Compliance Tests. When the Department, after investigation, has good reason (such as complaints, increased visible emissions or questionable maintenance of control equipment) to believe that any applicable emission standard contained in a Department rule or in a permit issued pursuant to those rules is being violated, it may require the owner or operator of the emissions unit to conduct compliance tests which identify the nature and quantity of pollutant emissions from the emissions unit and to provide a report on the results of said tests to the Department.

(c) Waiver of Compliance Test Requirements. If the owner or operator of an emissions unit that is subject to a compliance test requirement demonstrates to the Department, pursuant to the procedure established in Rule 62-297.620, F.A.C., that the compliance of the emissions unit with an applicable weight emission limiting standard can be adequately determined by means other than the designated test procedure, such as specifying a surrogate standard of no visible emissions for particulate matter sources equipped with a bag house or specifying a fuel analysis for sulfur dioxide emissions, the Department shall waive the compliance test requirements for such emissions units and order that the alternate means of determining compliance be used, provided, however, the provisions of Rule 62-297.310(7)(b), F.A.C., shall apply.
[Rule 62-297.310(7)(a)2., 3., 4., 5., 10., (b) & (c), F.A.C.; SIP approved]

Recordkeeping and Reporting Requirements

C.11. In the case of excess emissions resulting from malfunctions, the permittee shall notify the Dade County Department of Environmental Resources Management in accordance with Rule 62-4.130, F.A.C. A full written report on the malfunctions shall be submitted in a quarterly report, if requested by the Dade County Department of Environmental Resources Management.
[Rule 62-210.700(6), F.A.C.]

C.12. Submit to the Dade County Department of Environmental Resources Management a written report of emissions in excess of emission limiting standards as set forth in Rule 62-296.405(1), F.A.C., for each calendar quarter. The nature and cause of the excess emissions shall be explained. This report does not relieve the permittee of the legal liability for violations. All recorded data shall be maintained on file by the Source for a period of five years.
[Rules 62-213.440 and 62-296.405(1)(g), F.A.C.]

C.13. Test Reports.

(a) The owner or operator of an emissions unit for which a compliance test is required shall file a report with the Department and Dade County Department of Environmental Resources Management on the results of each such test.

(b) The required test report shall be filed with the Department and Dade County Department of Environmental Resources Management as soon as practical but no later than 45 days after the last sampling run of each test is completed.

(c) The test report shall provide sufficient detail on the emissions unit tested and the test procedures used to allow the Department and Dade County Environmental Resources Management to determine if the test was properly conducted and the test results properly computed. As a minimum, the test report, other than for an EPA or DEP Method 9 test, shall provide the following information:

1. The type, location, and designation of the emissions unit tested.
2. The facility at which the emissions unit is located.
3. The owner or operator of the emissions unit.
4. The normal type and amount of fuels used and materials processed, and the types and amounts of fuels used and material processed during each test run.
5. The means, raw data and computations used to determine the amount of fuels used and materials processed, if necessary to determine compliance with an applicable emission limiting standard.
6. The type of air pollution control devices installed on the emissions unit, their general condition, their normal operating parameters (pressure drops, total operating current and GPM scrubber water), and their operating parameters during each test run.
7. A sketch of the duct within 8 stack diameters upstream and 2 stack diameters downstream of the sampling ports, including the distance to any upstream and downstream bends or other flow disturbances.
8. The date, starting time and duration of each sampling run.
9. The test procedures used, including any alternative procedures authorized pursuant to Rule 62-297.620, F.A.C. Where optional procedures are authorized in this chapter, indicate which option was used.
10. The number of points sampled and configuration and location of the sampling plane.
11. For each sampling point for each run, the dry gas meter reading, velocity head, pressure drop across the stack, temperatures, average meter temperatures and sample time per point.
12. The type, manufacturer and configuration of the sampling equipment used.
13. Data related to the required calibration of the test equipment.
14. Data on the identification, processing and weights of all filters used.
15. Data on the types and amounts of any chemical solutions used.
16. Data on the amount of pollutant collected from each sampling probe, the filters, and the impingers, are reported separately for the compliance test.
17. The names of individuals who furnished the process variable data, conducted the test, analyzed the samples and prepared the report.
18. All measured and calculated data required to be determined by each applicable test procedure for each run.
19. The detailed calculations for one run that relate the collected data to the calculated emission rate.

20. The applicable emission standard, and the resulting maximum allowable emission rate for the emissions unit, plus the test result in the same form and unit of measure.

21. A certification that, to the knowledge of the owner or his authorized agent, all data submitted are true and correct. When a compliance test is conducted for the Department or its agent, the person who conducts the test shall provide the certification with respect to the test procedures used. The owner or his authorized agent shall certify that all data required and provided to the person conducting the test are true and correct to his knowledge.

[Rules 62-213.440 and 62-297.310(8), F.A.C.]

C.14. The owner or operator shall notify the Dade County Department of Environmental Resources Management, at least 15 days prior to the date on which each formal compliance test is to begin, of the date, time, and place of each such test, and the test contact person who will be responsible for coordinating and having such test conducted for the owner or operator.

[Rule 62-297.310(7)(a)9., F.A.C.]

Section IV. Acid Rain Part

Turkey Point Fossil Plant -- Facility ID No. 0250003
Operated by: Florida Power and Light Company
ORIS code: 621

The emissions units listed below are regulated under Acid Rain Part, Phase II.

E.U.

<u>ID No.</u>	<u>Description</u>
001	440 MW Boiler (EPA ID # PTP1)
002	440 MW Boiler (EPA ID # PTP2)

A.1. The Acid Rain Part application submitted for this facility, as approved by the Department, is a part of this permit. The owners and operators of these acid rain units must comply with the standard requirements and special provisions set forth in the application listed below:

- a. DEP Form No. 62-210.900(1)(a), dated 07/01/95.

[Chapter 62-213, F.A.C. and Rule 62-214.320, F.A.C.]

A.2. Sulfur dioxide (SO₂) allowance allocations requirements for each Acid Rain unit:

E.U. ID No.	EPA ID No.	Year	2004	2005	2006	2008	2008
001	PTP1	SO₂ allowances, under Table 2 of 40 CFR 73	5868*	5868*	5868*	5868*	5868*
002	PTP2	SO₂ allowances, under Table 2 of 40 CFR 73	5911*	5911*	5911*	5911*	5911*

*The number of allowances held by an Acid Rain source in a unit account may differ from the number allocated by the USEPA under Table 2 of 40 CFR 73.

A.3. Emission Allowances. Emissions from sources subject to the Federal Acid Rain Program (Title IV) shall not exceed any allowances that the source lawfully holds under the Federal Acid Rain Program. Allowances shall not be used to demonstrate compliance with a non-Title IV applicable requirement of the Act.

- a. No permit revision shall be required for increases in emissions that are authorized by allowances acquired pursuant to the Federal Acid Rain Program, provided that such increases do not require a permit revision pursuant to Rule 62-213.400(3), F.A.C.

- b. No limit shall be placed on the number of allowances held by the source under the Federal Acid Rain Program.

c. Allowances shall be accounted for under the Federal Acid Rain Program.
[Rule 62-213.440(1)(c)1., 2. & 3., F.A.C.]

A.4. Fast-Track Revisions of Acid Rain Parts. Those Acid Rain sources making a change described at Rule 62-214.370(4), F.A.C., may request such change as provided in Rule 62-213.413, Fast-Track Revisions of Acid Rain Parts.
[Rule 62-214.370(4), and Rule 62-213.413, F.A.C]

A.5. Comments, notes, and justifications: None

Appendix I-1, List of Insignificant Emissions Units and Activities

Florida Power & Light

DRAFT Permit No. 0250003-005-AV

Turkey Point Fossil Plant

Page 1 of 6

The facilities, emissions units, or pollutant-emitting activities listed in Rule 62-210.300(3)(a), F.A.C., Categorical Exemptions, are exempt from the permitting requirements of Chapters 62-210 and 62-4, F.A.C.; provided, however, that exempt emissions units shall be subject to any applicable emission limiting standards and the emissions from exempt emissions units or activities shall be considered in determining the potential emissions of the facility containing such emissions units. Emissions units and pollutant-emitting activities exempt from permitting under Rule 62-210.300(3)(a), F.A.C., shall not be exempt from the permitting requirements of Chapter 62-213, F.A.C., if they are contained within a Title V source; however, such emissions units and activities shall be considered insignificant for Title V purposes provided they also meet the criteria of Rule 62-213.430(6)(b), F.A.C. No emissions unit shall be entitled to an exemption from permitting under Rule 62.210.300(3)(a), F.A.C., if its emissions, in combination with the emissions of other units and activities at the facility, would cause the facility to emit or have the potential to emit any pollutant in such amount as to make the facility a Title V source.

The below listed emissions units and activities are considered insignificant pursuant to Rule 62-213.430(6), F.A.C.

Brief Description of Emissions Units and Activities

1. Internal combustion engines in boats, aircraft and vehicles used for transportation of passengers or freight.
2. Cold storage refrigeration equipment, except for any such equipment located at a Title V source using an ozone-depleting substance regulated under 40 CFR Part 82.
3. Vacuum pumps in laboratory operations.
4. Equipment used for steam cleaning.
5. Belt or drum sanders having a total sanding surface of five square feet or less and other equipment used exclusively on wood or plastics or their products having a density of 20 pounds per cubic foot or more.
6. Equipment used exclusively for space heating, other than boilers.
7. Laboratory equipment used exclusively for chemical or physical analyses.
8. Brazing, soldering or welding equipment.
9. One or more emergency generators located within a single facility provided:
 - a. None of the emergency generators is subject to the Federal Acid Rain Program; and
 - b. Total fuel consumption by all such emergency generators within the facility is limited to 32,000 gallons per year of diesel fuel, 4,000 gallons per year of gasoline, 4.4 million standard cubic feet per year of natural gas or propane, or an equivalent prorated amount if multiple fuels are used.
10. One or more heating units and general purpose internal combustion engines located within a single facility provided:
 - a. None of the heating units or general purpose internal combustion engines is subject to the Federal Acid Rain Program; and

Appendix I-1, List of Exempt Emissions Units and Activities

Florida Power & Light
Turkey Point Fossil Plant
Page 2 of 6

DRAFT Permit No. 0250003-005-AV

- b. Total fuel consumption by all such heating units and general purpose internal combustion engines within the facility is limited to 32,000 gallons per year of diesel fuel, 4,000 gallons per year of gasoline, 4.4 million standard cubic feet per year of natural gas or propane, or an equivalent prorated amount if multiple fuels are used.
11. Fire and safety equipment.
12. Surface coating operations within a single facility if the total quantity of coatings containing greater than 5.0 percent VOCs, by volume, used is 6.0 gallons per day or less, averaged monthly, provided:
- a. Such operations are not subject to a volatile organic compound Reasonably Available Control Technology (RACT) requirement of Chapter 62-296, F.A.C.; and
 - b. The amount of coatings used shall include any solvents and thinners used in the process including those used for cleanup.
13. Surface coating operations utilizing only coatings containing 5.0 percent or less VOCs, by volume.
14. Degreasing units using heavier-than-air vapors exclusively, except any such unit using or emitting any substance classified as a hazardous air pollutant.

Steam and Air Systems:

Steam Drum 3" Relief Valves
Steam Drum " Valves to Vent
Main Steam 2 ½" Relief Valves with Silencer
Main Steam Stop Valve Vents
Main Steam 1" Free Blow and Vent
Reheat Outlet Header 2" Vents
Reheat Outlet Header 6" relief Valves
Hot Reheat 2" Vents
Cold Reheat at Inlet Header 6" Relief Valves
Blowdown Tank 16" Silencer Tank
Main Steam 6" Relief Valve at Desuperheater
After Condenser ½" Vent from Drainer
After Condenser 2" Vents
Hogging Ejector 10 Exhaust Head with Silencer
Moisture Separator 10" Exhaust Head with Silencer
Moisture Separator 1" Vent
Vacuum Tanks 2A, B, C, & D 4" Vents
Steam Relief Valves at Steam Seal Regulator
Boiler Blowdown Heat Exchanger 1" Vent
Boiler Feed Condensate, Heater Drains
Condensate Storage Tank Vent
Condensate Recovery Tank Vents
Condensate Recovery Cooler – ¾" Vent
Condensate Recovery Flash Tank – 8" Relief Valve
Vent Condenser ½" Vent
After Condenser ½" Vent
Inter-Condenser ½" Vent
Boiler Feeder Pumps 1" Vent

Appendix I-1, List of Exempt Emissions Units and Activities

Florida Power & Light
Turkey Point Fossil Plant
Page 3 of 6

DRAFT Permit No. 0250003-005-AV

Boiler Feed Condensate, Heater Drains

Boiler Feeder Pumps Relief Valves
Extraction Heater 3" & 4" Relief Valves
Gland Steam Condenser Air Ejector
Extraction Heaters ¾" & 1" Vents
Hydrazine Storage Tank
Ammonia Storage Tank
Phosphate Storage Tank

Service Water, Cooling Water, and Fire Protection

Water Storage Tank (500,000 Gal.) 6" Vent
Closed C.W. Heat Exchanger A&B 1" Vent
F.D. Fan Hydraulic Coupling A & B ¾" Vent
H₂ Coolers A, B, C, & D ½" Vent
Boiler Feed Pump Hydrogen Coupling Coolers ¾" Vent
Cooling Water Surge Tank 8" Vent
Closed Cooling Water System Units A and B ¾"
Boiler Feed Pump seal Piping Cooler Vents

Fuel Oil, Lube Oil, and Lube Oil Purification

Fuel Oil Storage Tanks (256,000 BBL.) 6" Vents
Fuel Oil Metering Tanks (12,000 BBL.) 6" Vents
Fuel Oil Storage Tanks (256,000 BBL.) Draw-off Sump
Blowback Tank at Metering Tank 1" Relief Valve
Blowback Tank at Metering 2" Valve
Blowback Tank at Fuel Oil Burner Pumps – 1" Relief Valves
Blowback Tank at Fuel Oil Burner Pumps – 2" Valves
Fuel Oil Lines 1: Relief Valves
Fuel Oil Lines ¾" Valves
Blowback Tanks at Each Level of Burners – 2" Vent
Blowback Tanks at Each Level of Burners- 1" Relief Valve
Fuel Oil Burner Booster Pump Vents
8" Fuel Oil Line at Heaters Vents
Station Air at all Blowback Tanks 2"Vent
Generator Loop Seal Tank Exhaust Head- 4"
Oil Mist Eliminator 6" Vent
Lube Oil Coolers ½" Vent
Lube Oil Conditioner Filter Vent
Lube Oil Piping High Point Filter Vent
Magnesium Hydroxide Tank (Fuel Additive)

Lime Slurry, Caustic Wash, Nitrogen Purge Instrument Air

Nitrogen Release Valve
High Pressure Heater Nitrogen Vents
Steam Drum Nitrogen Vent
Secondary S.H. Outlet Nitrogen Vent

Appendix I-1, List of Exempt Emissions Units and Activities

Florida Power & Light
Turkey Point Fossil Plant
Page 4 of 6

DRAFT Permit No. 0250003-005-AV

Primary S.H. Outlet Nitrogen Vent
Instrument Air/Air Receiver/Relief Valves
Instrument Air After Cooler Relief Valves
Station Air After Cooler Relief Valves
Station Air/Air Receiver/Relief Valves
Slurry Mixing Tank
Slurry Service Tank
Soda Ash Service Tank
Soda Ash Mixing Tank

Miscellaneous Buildings HVAC

Stores Building
Control Building
Service Building
North Gate Guard House
Switchyard Buildings
CEM Building
Switchgear Room
Water Treatment/Lab
Elevators
Administration Building

Sanitary Vents/Stacks

Control Building
Recreation Building
Service Building
Administration Building
Port-a-Johns
Sheet Metal Shop
Chemical Lab
Chemical Storage Building
Switchyard Control Building
Battery Room
Paint and Lube Oil Building
Dry Storage Building
Electrical Building
Warehouses
Boiler Feed Pump Building
Chlorination Building
I&C Building
Weld Shop

Kitchen Vent/Exhaust Systems

Control Room
Administration Building
Recreation Pavilion

Appendix I-1, List of Exempt Emissions Units and Activities

Florida Power & Light
Turkey Point Fossil Plant
Page 5 of 6

DRAFT Permit No. 0250003-005-AV

CEM Equipment
Monitoring Gases

Gas Bottle Storage
Nitrogen, CO₂, Hydrogen, Oxygen, Acetylene, Argon
Oily Waste Water Sumps
Filling Station 2000 Gallon Diesel Fuel Tank 2" Vent
2000 Gallon Unleaded Fuel Tank 2" Vent

Hazardous Waste Storage Area
Sealed Drums and Containers
Natural Gas Gas Metering Station
Ignition Gas (Liquid Propane)
Propane Storage Tank

Water Treatment
Chemical Storage Area
Waste Water Treatment
Storm Water Sumps
Oil/Water Separator Tank Vent
Waste Neutralization Basin
Storm Water Basin
Ash Disposal System

Miscellaneous Activities
Home Heating and comfort Heating with a gross maximum heat output of less than one million BTU/hour
Internal combustion engines in boats, aircraft and vehicles used for transportation of passengers or freight
Vacuum Pumps used in laboratory operations
Equipment used for Steam Cleaning
Belt or drum sanders having a total sanding surface of five square feet or less and other equipment used exclusively on wood or plastics of their products having a density of 20 pounds per cubic foot or more
Equipment used exclusively for space heating, other than boilers
Laboratory equipment used exclusively for chemical and physical analysis
Brazing, soldering or welding equipment
Laundry Dryers, extractors, or tumblers for fabrics cleaned with only water solutions of bleach or detergents
Fire and Safety Equipment
Surface Coating facilities in ozone attainment areas (provided that 6.0 gallons of coatings per day are applied)
Degreasing units using heavier than air vapors exclusively, except any such unit using or emitting any substance classified as a hazardous air pollutant.
Plant Grounds Maintenance

Appendix I-1, List of Exempt Emissions Units and Activities

Florida Power & Light

DRAFT Permit No. 0250003-005-AV

Turkey Point Fossil Plant

Page 6 of 6

Routine Maintenance/ Repair Activities

Non-Halogenated Solvent Cleaning Operations

Use of Spray Cans or solvents for routine maintenance activities

Internal Combustion Engines which Drive Compressors, Generators, Water Pumps or Other

Auxiliary Equipment

Transformers, Switches, and Switchgear, Processing and Venting

Electrically Heated Equipment Used for Heat Treating, Tracing, Drying, Soaking, Case

Hardening, or Surface Conditioning

Air Compressors and Centrifuges Used for Compressing Air

Storage of Products in Sealed Containers

Painting of Plant Equipment

Miscellaneous Mobile Vehicle Operation

Cars, Light Trucks, Heavy Duty Trucks, Back Hoes, Tractors, Forklifts, Cranes, Etc.

Miscellaneous Mobile Equipment Operation

Compressors, Chain Saws, Small Generators, (<100KW) Welding Machines, Electric Saws and Drills, Etc.

Appendix U-1, List of Unregulated Emissions Units and Activities

Florida Power & Light
Turkey Point Fossil Plant

DRAFT Permit No. 0250003-005-AV

Unregulated Emissions Units and Activities. An emissions unit which emits no "emissions-limited pollutant" and which is subject to no unit-specific work practice standard, though it may be subject to regulations applied on a facility-wide basis (e.g., unconfined emissions, odor, general opacity) or to regulations that require only that it be able to prove exemption from unit-specific emissions or work practice standards.

The following emissions units and activities are neither "regulated emissions units" nor "insignificant emissions units":

E.U. ID No. Brief Description of Emissions Units and/or Activity

004	20,000 gallon No. 2 fuel oil tank
	25,000 gallon No. 2 fuel oil tank
	2,000 gallon unleaded gasoline tank
	2,000 gallon vehicular diesel tank
	11,256,000 gallon No. 5 & 6 fuel oil tank, installed 07/67
	11,256,000 gallon No. 5 & 6 fuel oil tank, installed 07/68
	504,000 gallon No. 5 & 6 fuel oil tank, installed 07/68
	504,000 gallon No. 5 & 6 fuel oil tank, installed 07/68
	1,500 gallon mineral acid tank, installed 04/95
	Hydrazine tank
	Ammonia tank
	Phosphate tank
	Off-loading of Fuel from Tankers
	Propane Storage Tank
	Sandblast Shed
	Unleaded gasoline dispensing facility with a monthly gasoline throughput of less than 20,000 gallons.

Appendix H-1, Permit History/ID Number Changes

Florida Power & Light
Turkey Point

DRAFT Permit No.: 0250003-005-AV
Facility ID No.: 0250003

Permit History

E.U.

<u>ID No</u>	<u>Description</u>	<u>Permit No.</u>	<u>Issue Date</u>	<u>Expiration Date</u>	<u>Extended Date</u>	<u>Revised Date</u>
-001	440 MW Steam Generating Unit #1	AO13-238939	12/23/93	12/01/98		
-002	440 MW Steam Generating Unit #2	AO13-238932	01/07/94	12/01/98		
-003	Five 2.75 MW Diesel Generators	new unit				
All	Facility	0250003-001-AV	1/1/1999	12/31/03		
All	Facility	0250003-005-AV	1/1/2004	12/31/008		

ID Number Changes:

From: Facility ID No.: 50DAD130003

To: Facility ID No.: 0250003

Phase II Permit Application

For more information, see instructions and refer to 40 CFR 72.30 and 72.31 and Chapter 214, F.A.C.

This submission is: New Revised

STEP 1
Identify the source by plant name, State, and ORIS code from NADB

Turkey Point Fossil Plant	FL	621
Plant Name	State	ORIS Code

Compliance Plan

STEP 2
Enter the boiler ID# from NADB for each affected unit, and indicate whether a repowering plan is being submitted for the unit by entering "yes" or "no" at column c. For new units, enter the requested information in columns d and e

a	b	c	d	e
Boiler ID#	Unit Will Hold Allowances in Accordance with 40 CFR 72.9(c)(1)	Repowering Plan	New Units Commence Operation Date	New Units Monitor Certification Deadline
PTP1	Yes	N/A	N/A	N/A
PTP2	Yes	N/A	N/A	N/A
	Yes			
	Yes			
	Yes			
	Yes			
	Yes			
	Yes			
	Yes			
	Yes			
	Yes			
	Yes			
	Yes			

STEP 3
Check the box if the response in column c of Step 2 is "Yes" for any unit

For each unit that will be repowered, the Repowering Extension Plan form is included and the Repowering Technology Petition form has been submitted or will be submitted by June 1, 1997.

Plant Name (from Step 1)

STEP 4..

Read the standard requirements and certification, enter the name of the designated representative, and sign and date

Standard RequirementsPermit Requirements.

- (1) The designated representative of each Acid Rain source and each Acid Rain unit at the source shall:
 - (i) Submit a complete Acid Rain part application (including a compliance plan) under 40 CFR part 72, Rules 62-214.320 and 330, F.A.C. in accordance with the deadlines specified in Rule 62-214.320, F.A.C.; and
 - (ii) Submit in a timely manner any supplemental information that the permitting authority determines is necessary in order to review an Acid Rain part application and issue or deny an Acid Rain permit;
- (2) The owners and operators of each Acid Rain source and each Acid Rain unit at the source shall:
 - (i) Operate the unit in compliance with a complete Acid Rain part application or a superseding Acid Rain part issued by the permitting authority; and
 - (ii) Have an Acid Rain Part.

Monitoring Requirements.

- (1) The owners and operators and, to the extent applicable, designated representative of each Acid Rain source and each Acid Rain unit at the source shall comply with the monitoring requirements as provided in 40 CFR part 75, and Rule 62-214.420, F.A.C.
- (2) The emissions measurements recorded and reported in accordance with 40 CFR part 75 shall be used to determine compliance by the unit with the Acid Rain emissions limitations and emissions reduction requirements for sulfur dioxide and nitrogen oxides under the Acid Rain Program.
- (3) The requirements of 40 CFR part 75 shall not affect the responsibility of the owners and operators to monitor emissions of other pollutants or other emissions characteristics at the unit under other applicable requirements of the Act and other provisions of the operating permit for the source.

Sulfur Dioxide Requirements.

- (1) The owners and operators of each source and each Acid Rain unit at the source shall:
 - (i) Hold allowances, as of the allowance transfer deadline, in the unit's compliance subaccount (after deductions under 40 CFR 73.34(c)) not less than the total annual emissions of sulfur dioxide for the previous calendar year from the unit; and
 - (ii) Comply with the applicable Acid Rain emissions limitations for sulfur dioxide.
- (2) Each ton of sulfur dioxide emitted in excess of the Acid Rain emissions limitations for sulfur dioxide shall constitute a separate violation of the Act.
- (3) An Acid Rain unit shall be subject to the requirements under paragraph (1) of the sulfur dioxide requirements as follows:
 - (i) Starting January 1, 2000, an Acid Rain unit under 40 CFR 72.6(a)(2); or
 - (ii) Starting on the later of January 1, 2000 or the deadline for monitor certification under 40 CFR part 75, an Acid Rain unit under 40 CFR 72.6(a)(3).
- (4) Allowances shall be held in, deducted from, or transferred among Allowance Tracking System accounts in accordance with the Acid Rain Program.
- (5) An allowance shall not be deducted in order to comply with the requirements under paragraph (1)(i) of the sulfur dioxide requirements prior to the calendar year for which the allowance was allocated.
- (6) An allowance allocated by the Administrator under the Acid Rain Program is a limited authorization to emit sulfur dioxide in accordance with the Acid Rain Program. No provision of the Acid Rain Program, the Acid Rain permit application, the Acid Rain permit, or the written exemption under 40 CFR 72.7 and 72.8 and no provision of law shall be construed to limit the authority of the United States to terminate or limit such authorization.
- (7) An allowance allocated by the Administrator under the Acid Rain Program does not constitute a property right.

Nitrogen Oxides Requirements. The owners and operators of the source and each Acid Rain unit at the source shall comply with the applicable Acid Rain emissions limitation for nitrogen oxides.

Excess Emissions Requirements.

- (1) The designated representative of an Acid Rain unit that has excess emissions in any calendar year shall submit a proposed offset plan, as required under 40 CFR part 77.
- (2) The owners and operators of an Acid Rain unit that has excess emissions in any calendar year shall:
 - (i) Pay without demand the penalty required, and pay upon demand the interest on that penalty, as required by 40 CFR part 77; and
 - (ii) Comply with the terms of an approved offset plan, as required by 40 CFR part 77.

Recordkeeping and Reporting Requirements.

- (1) Unless otherwise provided, the owners and operators of the source and each Acid Rain unit at the source shall keep on site at the source each of the following documents for a period of 5 years from the date the document is created. This period may be extended for cause, at any time prior to the end of 5 years, in writing by the Administrator or permitting authority:
 - (i) The certificate of representation for the designated representative for the source and each Acid Rain unit at the source and all documents that demonstrate the truth of the statements in the certificate of representation, in accordance with Rule 62-214.350, F.A.C.; provided that the certificate and documents shall be retained on site at the source beyond such 5-year period until such documents are superseded because of the submission of a new certificate of representation changing the designated representative;
 - (ii) All emissions monitoring information, in accordance with 40 CFR part 75;
 - (iii) Copies of all reports, compliance certifications, and other submissions and all records made or required under the Acid Rain Program; and

Plant Name (from Step 1)

Recordkeeping and Reporting Requirements (cont.)

(iv) Copies of all documents used to complete an Acid Rain part application and any other submission under the Acid Rain Program or to demonstrate compliance with the requirements of the Acid Rain Program.

(2) The designated representative of an Acid Rain source and each Acid Rain unit at the source shall submit the reports and compliance certifications required under the Acid Rain Program, including those under 40 CFR part 72 subpart I and 40 CFR part 75.

Liability.

- (1) Any person who knowingly violates any requirement or prohibition of the Acid Rain Program, a complete Acid Rain part application, an Acid Rain part, or a written exemption under 40 CFR 72.7 or 72.8, including any requirement for the payment of any penalty owed to the United States, shall be subject to enforcement pursuant to section 113(c) of the Act.
- (2) Any person who knowingly makes a false, material statement in any record, submission, or report under the Acid Rain Program shall be subject to criminal enforcement pursuant to section 113(c) of the Act and 18 U.S.C. 1001.
- (3) No permit revision shall excuse any violation of the requirements of the Acid Rain Program that occurs prior to the date that the revision takes effect.
- (4) Each Acid Rain source and each Acid Rain unit shall meet the requirements of the Acid Rain Program.
- (5) Any provision of the Acid Rain Program that applies to an Acid Rain source (including a provision applicable to the designated representative of an Acid Rain source) shall also apply to the owners and operators of such source and of the Acid Rain units at the source.
- (6) Any provision of the Acid Rain Program that applies to an Acid Rain unit (including a provision applicable to the designated representative of an Acid Rain unit) shall also apply to the owners and operators of such unit. Except as provided under 40 CFR 72.44 (Phase II repowering extension plans), and except with regard to the requirements applicable to units with a common stack under 40 CFR part 75 (including 40 CFR 75.16, 75.17, and 75.18), the owners and operators and the designated representative of one Acid Rain unit shall not be liable for any violation by any other Acid Rain unit of which they are not owners or operators or the designated representative and that is located at a source of which they are not owners or operators or the designated representative.
- (7) Each violation of a provision of 40 CFR parts 72, 73, 75, 77, and 78 by an Acid Rain source or Acid Rain unit, or by an owner or operator or designated representative of such source or unit, shall be a separate violation of the Act.

Effect on Other Authorities. No provision of the Acid Rain Program, an Acid Rain part application, an Acid Rain part, or a written exemption under 40 CFR 72.7 or 72.8 shall be construed as:

- (1) Except as expressly provided in title IV of the Act, exempting or excluding the owners and operators and, to the extent applicable, the designated representative of an Acid Rain source or Acid Rain unit from compliance with any other provision of the Act, including the provisions of title I of the Act relating to applicable National Ambient Air Quality Standards or State Implementation Plans;
- (2) Limiting the number of allowances a unit can hold; *provided*, that the number of allowances held by the unit shall not affect the source's obligation to comply with any other provisions of the Act;
- (3) Requiring a change of any kind in any State law regulating electric utility rates and charges, affecting any State law regarding such State regulation, or limiting such State regulation, including any prudence review requirements under such State law;
- (4) Modifying the Federal Power Act or affecting the authority of the Federal Energy Regulatory Commission under the Federal Power Act; or,
- (5) Interfering with or impairing any program for competitive bidding for power supply in a State in which such program is established.

Certification

I am authorized to make this submission on behalf of the owners and operators of the Acid Rain source or Acid Rain units for which the submission is made. I certify under penalty of law that I have personally examined, and am familiar with, the statements and information submitted in this document and all its attachments. Based on my inquiry of those individuals with primary responsibility for obtaining the information, I certify that the statements and information are to the best of my knowledge and belief true, accurate, and complete. I am aware that there are significant penalties for submitting false statements and information, or omitting required statements and information, including the possibility of fine or imprisonment. (There are no attachments to this document)

William M. Reichel	
Name	
Signature <i>William M. Reichel</i>	Date 12/4/95

3. (Optional)
Enter the source AIRS
and FINDS Identification
numbers, if known

BEST AVAILABLE COPY

AIRS
FINDS

BEST AVAILABLE COPY

TO THE DIRECTOR OF:

Petition for Reduction in Quarterly
 Particulate Emissions Compliance
 Testing;
 FLORIDA POWER AND LIGHT COMPANY,

Petitioner.

OGC Case Nos.: 83-0578
 83-0577, 83-0576,
 83-0585, 83-0586,
 83-0587, 83-0588
 83-0581, 83-0580

ED

ORDER GRANTING PETITION FOR REDUCED
 FREQUENCY OF PARTICULATE TESTING

On September 16, 1983, the Petitioner, FLORIDA POWER AND LIGHT COMPANY, filed a Petition for Reduction in Quarterly Particulate Emissions Compliance Testing pursuant to Florida Administrative Code Rule 17-2.600(5)(b)1 for the following fossil fuel steam generating units:

- Port Everglades Plant Unit No. 2
- Port Everglades Plant Unit No. 3
- Port Everglades Plant Unit No. 4
- Turkey Point Plant Unit No. 1
- Turkey Point Plant Unit No. 2
- Riveria Plant Unit No. 3
- Riveria Plant Unit No. 4
- Manatee Plant Unit No. 1
- Manatee Plant Unit No. 2

Each of the units has a heat input exceeding 250 million Btu per hour.

The petition and supporting documentation submitted by the Petitioner indicate that between August 1979 and July 21, 1983, these units were afforded relief from the particulate standard contained in Florida Administrative Code Rule 17-2.600(5)(b)2 under the terms of a Department-issued variance. During the same period of time the Company elected to test quarterly as permitted under Rule 17-2.600(5)(b)1. Despite the existence of the variance, the tests results submitted during the last two years reveal that each of the above-listed units met the particulate emissions limitations contained in Rule 17-2.600(5)(b)2 of 0.1 pounds per million Btu heat input.

Florida Administrative Code Rule 17-2.600(5)(b)1 specifically provides that I may reduce the frequency of particulate testing

upon a demonstration that the particulate standard has been regularly met. The particulate standard referred to is the general standard found in the rule--0.1 parts per million Btu heat input--not a relaxed emission limit established by a variance.

The intent of Rule 17-2.600(5)(b)1 is to ensure that before the frequency of particulate testing is reduced, the source has established a record of complying with the requirements of Florida Administrative Code Chapter 17-2 relating to particulate matter emissions. Petitioner has documented that each of these units has a history of regularly complying with the particulate matter standard applicable to them.

IT IS ORDERED that the present petition is GRANTED. Under the terms of Rule 17-2.600(5)(b)1, Petitioner may reduce the frequency of particulate testing to an annual basis for each of the units named in this Order. If, however, any of the units fails to comply with the applicable particulate or visible emission standard, this Order will terminate upon written notice by the Department.


The Petitioner may request a hearing in accordance with Section 120.57, Florida Statutes, and Florida Administrative Code Chapters 17-1 and 28-5. The request for hearing must be filed (received) in the Office of General Counsel of the Department, 2600 Blair Stone Road, Twin Towers Office Building, Tallahassee, Florida 32301, within (14) days of receipt of this Order. Failure to file a request for hearing within this time shall constitute a waiver of Petitioner's right to request a hearing under Section 120.57, Florida Statutes.

DONE and ORDERED this 24 day of April, 1984.

ADJUDICATORY PROCEEDINGS
 UPON THIS ORDER pursuant to S120.52 (9),
 Florida Statutes, with the designated Department
 Clerk, receipt of which is hereby acknowledged.

 Clerk

 Date


 VICTORIA J. TSCHINKEL
 Secretary

STATE OF FLORIDA DEPARTMENT
 OF ENVIRONMENTAL REGULATION
 2600 Blair Stone Road
 Tallahassee, Florida 32301
 (904)488-4805

CERTIFICATE OF SERVICE

I HEREBY CERTIFY that a copy of the foregoing Order Denying
Petition for Reduced Frequency of Particulate Testing and the
Order Granting Petition for Reduced Frequency of Particulate
Testing have been furnished by U.S. Mail to Peter C. Cunningham,
Esquire, Hoping Boyd Green and Sams, Post Office Box 6326,
Tallahassee, Florida 32314 this 25th day of April, 1984.

Nancy E. Wright

NANCY E. WRIGHT
Assistant General Counsel

State of Florida Department
of Environmental Regulation
2600 Blair Stone Road
Tallahassee, Florida 32301
904/488-9730



ENVIRONMENTAL SERVICES DEPARTMENT
P.O. BOX 14000
JUNO BEACH, FL 33408

FACSIMILE COVER SHEET

DATE: 9/17/03

SEND TO: Bob Bell

COMPANY: _____

PHONE NUMBER: _____

FAX NUMBER: _____

=====

FROM: John Hamp

PHONE NUMBER: (561) 691 - _____

FAX NUMBER: (561) 691 - 7049

NUMBER OF PAGES (Including Cover Sheet): _____

COMMENTS / INSTRUCTIONS:

The Miami Herald

www.herald.com
www.eherald.com

**PUBLISHED DAILY
MIAMI-DADE-FLORIDA**

**STATE OF FLORIDA
COUNTY OF MIAMI-DADE**

Before the undersigned authority personally appeared:

JEANNETTE MARTINEZ

who on oath says that he/she is

CUSTODIAN OF RECORDS

of The Miami Herald, a daily newspaper published at Miami in Miami-Dade County, Florida; that the attached copy of advertisement was published in said newspaper in the issues of:


August 27, 2003

Affiant further says that the said The Miami Herald is a newspaper published at Miami, in the said Miami-Dade County, Florida and that the said newspaper has heretofore been continuously published in said Miami-Dade County, Florida each day and has been entered as second class mail matter at the post office in Miami, in said Miami-Dade County, Florida, for a period of one year next preceding the first publication of the attached copy of advertisement; and affiant further says that he has neither paid nor promised any person, firm or corporation any discount, rebate, commission or refund for the purpose of securing this advertisement for publication in the said newspaper(s).

Sworn to and subscribed before me this
27th day of August, 2003

My Commission
Expires: August 1, 2006
Silvia Acosta

Notary

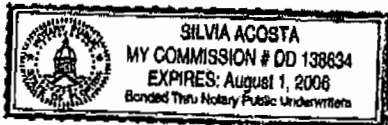

**PUBLIC NOTICE OF
INTENT TO ISSUE
TITLE V AIR OPERATION
PERMIT RENEWAL
STATE OF FLORIDA
DEPARTMENT OF
ENVIRONMENTAL
PROTECTION
DRAFT Permit Project**

Turkey Point Power Plant Dade County

The Department of Environmental Protection (DEP) gives notice of its intent to issue a Title V Air Operation Permit Renewal to Florida Power and Light Company for the Turkey Point Fossil Plant located at 9760 SW 344th Street, Florida City, Dade County. The applicant's name and address are: H.O. Nunez, Responsible Official, Florida Power and Light Company, 700 Universe Blvd, Juno Beach, FL 33408. The Turkey Point Title V Source is composed of two separate co-located power plants: the Fossil Plant and the Nuclear Plant. This permit, No. 0250003-005-AV, addresses only the operations at the Fossil Plant. The (non-nuclear) operations at the Nuclear Plant are addressed in a separate Title V permit No. 0250003-004-AV. The permitting authority will issue the PROPOSED Permit, and subsequent Final Permit, in accordance with the conditions of the DRAFT Permit unless a response received in accordance with the following procedures results in a different decision or significant change of terms or conditions. The permitting authority will accept written comments concerning the proposed DRAFT Permit issuance action for a period of 30 (thirty) days from the date of publication of this Notice. Written comments should be provided to the Department's Bureau of Air Regulation, 2600 Blair Stone Road, Mail Station 3505, Tallahassee, Florida 32399-2400 (Telephone: 850/488-0114; Fax: 850/322-8279). Any written comments filed shall be made available for public inspection. If written comments received result in a significant change in this DRAFT Permit, the permitting authority shall issue a Revised DRAFT Permit and require, if applicable, another Public Notice. Written comments whose substantial interests are affected by the proposed permitting decision may petition for an administrative hearing in accordance with Sections 120.568 and 120.57 of the Florida Statutes (F.S.). The petition must contain the information set forth below and must be filed (received) in the Office of General Counsel of the Department of Environmental Protection, 3900 Commonwealth Boulevard, Mail Station #36, Tallahassee, Florida 32399-3000 (Telephone: 850/488-9730; Fax: 850/487-4938). Petitions filed by any persons other than those entitled to written notice under section 120.60(3), F.S., must be filed within fourteen (14) days of publication of the public notice or within fourteen (14) days of receipt of the notice of intent, whichever occurs first. Under Section 120.60(3), F.S., however, any person who asked the permitting authority for notice of agency action may file a petition within fourteen (14) days of receipt of that notice regardless of the date of publication. A petitioner shall file a copy of the petition to the applicant at the address indicated above at the time of filing. The failure of any person to file a petition within the applicable time period shall constitute a waiver of that person's right to request an administrative determination (hearing) under sections 120.568 and 120.57, F.S., or to intervene in this

it. Any subsequent intervention will be only at the approval of the presiding officer upon the filing of a motion in compliance with Rule 28-106.205 of the Florida Administrative Code: (F.A.C.). A petition that disputes the material facts on which the permitting authority's action is based must contain the following information: (a) The name and address of each agency affected and each agency's file or identification number, if known. (b) The name, address, and telephone number of the petitioner, the name, address, and telephone number of the petitioner's representative, if any, which shall be the address for service purposes during the course of the proceeding; and an explanation of how the petitioner's rights will be affected by the agency determination. (c) A statement of how and when the petitioner received notice of the agency action or proposed action. (d) A statement of all disputed issues of material fact. If there are none, the petition must so state. (e) A concise statement of the ultimate facts alleged, as well as the rules or statutes which entitle the petitioner to relief. (f) A statement of the specific rules or statutes the petitioner contends require reversal or modification of the agency's proposed action. (g) A statement of the relief sought by the petitioner, stating precisely the action the petitioner wishes the agency to take with respect to the agency's proposed action. A petition that does not dispute the material facts upon which the permitting authority's action is based shall state that no such facts no such are in dispute and otherwise shall contain no such information as set forth above, as required by Rule 28-106.301, F.A.C. Because the administrative hearing process is designed to formulate final agency action, the filing of a petition means that the permitting authority's final action may be different from the action intended by it in this notice of intent. Persons whose substantial interests will be affected by any such final decision of the permitting authority on the application have the right to petition to become a party to the proceeding, in accordance with the requirements set forth above. Mediation is not available for this proceeding. In addition to the above, pursuant to 42 U.S.C. Section 7602, any person may petition the Administrator of the EPA within 60 (sixty) days of the expiration of the Administrator's 45 (forty-five) day review period as established at 42 U.S.C. 7601(d)(1) to object to the issuance of any permit. Any petition shall be based only on objections to the permit that were raised with reasonable specificity during the 30 (thirty) day public comment period provided in this notice. If the petitioner demonstrates to the Administrator of the EPA that it was impracticable to raise such objections within the comment period or unless the grounds for such objection arose after the comment period, filing of a petition with the Administrator of the EPA does not stay the effective date of any permit properly issued pursuant to the provisions of Chapter 42-219, P.A.C. Petitioner

Administrator of EPA must meet the requirements of 42 U.S.C. Section 7601(d)(2) and must be filed with the Administrator of the EPA at: U.S. EPA, 401 M Street, S.W., Washington, D.C. 20460. A complete project file is available for public inspection during normal business hours, 8:00 a.m. to 5:00 p.m., Monday through Friday, except legal holidays at: Permitting Authority: Department of Environmental Protection, Bureau of Air Regulation, 111 South Magnolia Drive, Suite 4, Tallahassee, Florida 32301. Telephone: 850/488-0114 Fax: 850/922-6879. Affected District/Local Program: Dade County, Department of Environmental Resource Management, Air and Water Quality Division, 33 SW Second Ave., Suite 900, Miami, FL 33130-6854. The complete project file includes the DRAFT Permit, the application for renewal, and the information submitted by the responsible official exclusive of confidential records under Section 403.111, F.S. Interested persons may contact Scott Shephard, P.E., at the above address, or call (850) 921-9832, for additional information.